

Q1

# State of the Market Report for PJM

Monitoring Analytics, LLC

Independent  
Market Monitor  
for PJM

5.12.2016

2016



## Preface

The PJM Market Monitoring Plan provides:

The Market Monitoring Unit shall prepare and submit contemporaneously to the Commission, the State Commissions, the PJM Board, PJM Management and to the PJM Members Committee, annual state-of-the-market reports on the state of competition within, and the efficiency of, the PJM Markets, and quarterly reports that update selected portions of the annual report and which may focus on certain topics of particular interest to the Market Monitoring Unit. The quarterly reports shall not be as extensive as the annual reports. In its annual, quarterly and other reports, the Market Monitoring Unit may make recommendations regarding any matter within its purview. The annual reports shall, and the quarterly reports may, address, among other things, the extent to which prices in the PJM Markets reflect competitive outcomes, the structural competitiveness of the PJM Markets, the effectiveness of bid mitigation rules, and the effectiveness of the PJM Markets in signaling infrastructure investment. These annual reports shall, and the quarterly reports may include recommendations as to whether changes to the Market Monitoring Unit or the Plan are required.<sup>1</sup>

Accordingly, Monitoring Analytics, LLC, which serves as the Market Monitoring Unit (MMU) for PJM Interconnection, L.L.C. (PJM),<sup>2</sup> and is also known as the Independent Market Monitor for PJM (IMM), submits this *2016 Quarterly State of the Market Report for PJM: January through March*.<sup>3</sup>

---

<sup>1</sup> PJM Open Access Transmission Tariff (OATT) Attachment M (PJM Market Monitoring Plan) § VI.A. Capitalized terms used herein and not otherwise defined have the meaning provided in the OATT, PJM Operating Agreement, PJM Reliability Assurance Agreement or other tariff that PJM has on file with the Federal Energy Regulatory Commission (FERC or Commission).

<sup>2</sup> OATT Attachment M § II(f).

<sup>3</sup> All references to this report should refer to the source as Monitoring Analytics, LLC, and should include the complete name of the report: *2016 Quarterly State of the Market Report for PJM: January through March*.



# Table of Contents

## Preface i

## SECTION 1 Introduction 1

2016 Q1 in Review	1
PJM Market Summary Statistics	4
PJM Market Background	4
Conclusions	6
Role of MMU	9
Reporting	10
Monitoring	10
Market Design	11
New Recommendations	11
New Recommendation from Section 5, Capacity Market	11
Total Price of Wholesale Power	11
Components of Total Price	12
Section Overviews	13
Overview: Section 3, “Energy Market”	13
Section 3 - Recommendations	16
Section 3 - Conclusion	18
Overview: Section 4, “Energy Uplift”	20
Section 4 - Energy Uplift Recommendations	21
Section 4 - Conclusion	23
Overview: Section 5, “Capacity Market”	24
Section 5 - Recommendations	26
Section 5 - Conclusion	28
Overview: Section 6, “Demand Response”	28
Section 6 - Recommendations	29
Section 6 - Conclusion	31
Overview: Section 7, “Net Revenue”	32
Section 7 - Conclusion	33
Overview: Section 8, “Environmental and Renewables”	33
Section 8 - Conclusion	35

Overview: Section 9, “Interchange Transactions”	36
Section 9 - Recommendations	38
Section 9 - Conclusion	39
Overview: Section 10, “Ancillary Services”	39
Section 10 - Conclusion	45
Overview: Section 11, “Congestion and Marginal Losses”	46
Section 11 - Conclusion	47
Overview: Section 12, “Planning”	48
Section 12 - Recommendations	49
Section 12 - Conclusion	50
Overview: Section 13, “FTR and ARRs”	51
Section 13 - Recommendations	53
Section 13 - Conclusion	54

## SECTION 2 Recommendations 59

New Recommendations	59
New Recommendation from Section 5, Capacity Market	60
Complete List of Current MMU Recommendations	60
Section 3, Energy Market	60
Section 4, Energy Uplift	61
Section 5, Capacity	63
Section 6, Demand Response	65
Section 7, Net Revenue	67
Section 8, Environmental	67
Section 9, Interchange Transactions	67
Section 10, Ancillary Services	68
Section 11, Congestion and Marginal Losses	69
Section 12, Planning	69
Section 13, FTRs and ARRs	70

<b>SECTION 3 Energy Market</b>	<b>73</b>	<b>SECTION 4 Energy Uplift (Operating Reserves)</b>	<b>155</b>
Overview	74	Overview	155
Market Structure	74	Energy Uplift Results	155
Market Behavior	75	Characteristics of Credits	155
Market Performance	76	Geography of Charges and Credits	156
Scarcity	77	Energy Uplift Issues	156
Recommendations	77	Energy Uplift Recommendations	156
Conclusion	79	Recommendations	156
Market Structure	80	Conclusion	158
Market Concentration	80	Energy Uplift	159
Ownership of Marginal Resources	82	Credits and Charges Categories	159
Type of Marginal Resources	83	Energy Uplift Results	161
Supply	85	Energy Uplift Charges	161
Demand	94	Operating Reserve Rates	164
Supply and Demand: Load and Spot Market	101	Reactive Services Rates	167
Market Behavior	103	Balancing Operating Reserve Determinants	168
Offer Capping for Local Market Power	103	Energy Uplift Credits	170
TPS Test Statistics	107	Characteristics of Credits	170
Parameter Limited Schedules	108	Types of Units	170
Markup Index	110	Concentration of Energy Uplift Credits	171
Frequently Mitigated Units and Associated Units	112	Economic and Noneconomic Generation	173
Virtual Offers and Bids	114	Geography of Charges and Credits	175
Generator Offers	124	Energy Uplift Issues	177
Market Performance	125	Lost Opportunity Cost Credits	177
Markup	125	Closed Loop Interfaces	179
Prices	133	Price Setting Logic	181
Scarcity	150	Confidentiality of Energy Uplift Information	182
Emergency procedures	150	Energy Uplift Recommendations	183
Scarcity and Scarcity Pricing	153	Recommendations for Calculation of Credits	183
PJM Cold Weather Operations 2016	154	Recommendations for Allocation of Charges	187
		Quantifiable Recommendations Impact	190
		January through March Energy Uplift Charges Analysis	192



<b>SECTION 9 Interchange Transactions</b>	<b>291</b>		
Overview	291		
Interchange Transaction Activity	291		
Interactions with Bordering Areas	292		
Recommendations	292		
Conclusion	294		
Interchange Transaction Activity	294		
Aggregate Imports and Exports	294		
Real-Time Interface Imports and Exports	295		
Real-Time Interface Pricing Point Imports and Exports	298		
Day-Ahead Interface Imports and Exports	300		
Day-Ahead Interface Pricing Point Imports and Exports	303		
Loop Flows	309		
PJM and MISO Interface Prices	316		
PJM and NYISO Interface Prices	318		
Neptune Underwater Transmission Line to Long Island, New York	319		
Linden Variable Frequency Transformer (VFT) facility	321		
Hudson Direct Current (DC) Merchant Transmission Line	322		
Operating Agreements with Bordering Areas	324		
PJM and MISO Joint Operating Agreement	325		
PJM and New York Independent System Operator Joint Operating Agreement (JOA)	326		
PJM and TVA Joint Reliability Coordination Agreement (JRCA)	328		
PJM and Duke Energy Progress, Inc. Joint Operating Agreement	328		
PJM and VACAR South Reliability Coordination Agreement	330		
Balancing Authority Operations Coordination Agreement between Wisconsin Electric Power Company (WEC) and PJM Interconnection, LLC	330		
Northeastern ISO-Regional Transmission Organization Planning Coordination Protocol	330		
Interface Pricing Agreements with Individual Balancing Authorities	330		
Other Agreements with Bordering Areas	331		
Interchange Transaction Issues	332		
		PJM Transmission Loading Relief Procedures (TLRs)	332
		Up to Congestion	333
		Sham Scheduling	337
		Elimination of Ontario Interface Pricing Point	338
		PJM and NYISO Coordinated Interchange Transactions	339
		Reserving Ramp on the PJM/NYISO Interface	342
		PJM and MISO Coordinated Interchange Transaction Proposal	343
		Willing to Pay Congestion and Not Willing to Pay Congestion	346
		Spot Imports	346
		Interchange Optimization	348
		Interchange Cap During Emergency Conditions	348
		45 Minute Schedule Duration Rule	349
		Interchange Transaction Credit Screening Process	349
		<b>SECTION 10 Ancillary Service Markets</b>	<b>351</b>
		Overview	352
		Primary Reserve	352
		Tier 1 Synchronized Reserve	352
		Tier 2 Synchronized Reserve Market	353
		Non-Synchronized Reserve Market	354
		Secondary Reserve (Day-Ahead Scheduling Reserve)	355
		Regulation Market	355
		Black Start Service	356
		Reactive	356
		Ancillary Services Costs per MWh of Load: 2004 through 2015	357
		Recommendations	357
		Conclusion	358
		Primary Reserve	359
		Market Structure	359
		Price and Cost	362
		Tier 1 Synchronized Reserve	363
		Market Structure	364
		Tier 1 Synchronized Reserve Event Response	365

Tier 2 Synchronized Reserve Market	369	Constraint Duration	428
Market Structure	370	Constraint Costs	430
Market Behavior	374	Congestion-Event Summary for MISO Flowgates	433
Market Performance	376	Congestion-Event Summary for NYISO Flowgates	434
Non-Synchronized Reserve Market	382	Congestion-Event Summary for the 500 kV System	434
Market Structure	382	Congestion Costs by Physical and Financial Participants	436
Secondary Reserve (DASR)	384	Congestion-Event Summary before and after September 8, 2014	437
Market Structure	384	Marginal Losses	437
Market Conduct	386	Marginal Loss Accounting	437
Market Performance	386	Marginal Loss Accounting	438
Regulation Market	389	Total Marginal Loss Costs	439
Market Design	389	Energy Costs	443
Market Structure	398	Energy Accounting	443
Market Conduct	401	Total Energy Costs	443
Market Performance	404		
Black Start Service	406	<b>SECTION 12 Generation and Transmission Planning</b>	<b>447</b>
Reactive Service	409	Overview	447
		Planned Generation and Retirements	447
<b>SECTION 11 Congestion and Marginal Losses</b>	<b>411</b>	Generation and Transmission Interconnection Planning Process	447
Overview	411	Regional Transmission Expansion Plan (RTEP)	448
Congestion Cost	411	Backbone Facilities	448
Marginal Loss Cost	413	Transmission Facility Outages	448
Energy Cost	413	Recommendations	448
Conclusion	413	Conclusion	449
Locational Marginal Price (LMP)	413	Planned Generation and Retirements	450
Components	413	Planned Generation Additions	450
Hub Components	417	Planned Retirements	454
Component Costs	418	Generation Mix	457
Congestion	418	Generation and Transmission Interconnection Planning Process	460
Congestion Accounting	418	Interconnection Study Phase	460
Total Congestion	420	Regional Transmission Expansion Plan (RTEP)	471
Congested Facilities	424	RTEP Cost Allocation	471
Congestion by Facility Type and Voltage	424	TranSource	472

Backbone Facilities	473
Transmission Facility Outages	473
Scheduling Transmission Facility Outage Requests	473
Rescheduling Transmission Facility Outage Requests	476
Long Duration Transmission Facility Outage Requests	477
Transmission Facility Outage Analysis for the FTR Market	478
Transmission Facility Outage Analysis in the Day-Ahead Market	482

## SECTION 13 Financial Transmission and Auction

Revenue Rights	485
Overview	486
Auction Revenue Rights	486
Financial Transmission Rights	487
Markets Timeline	488
Recommendations	488
Conclusion	489
Auction Revenue Rights	492
Market Structure	492
Market Performance	497
Financial Transmission Rights	499
Market Performance	503
Revenue Adequacy Issues and Solutions	513
ARRs as a Congestion Offset for Load	521
Credit Issues	522
FTR Forfeitures	522

## Figures

### SECTION 1 Introduction

- Figure 1-1 PJM's footprint and its 20 control zones  
 Figure 1-2 PJM reported monthly billings (\$ Billion): 2008 through March, 2016

### SECTION 3 Energy Market

- Figure 3-1 Fuel source distribution in unit segments: January through March, 2016  
 Figure 3-2 PJM hourly energy market HHI: January through March, 2016  
 Figure 3-3 Day-ahead marginal up to congestion transaction and generation units: January 2014 through March of 2016  
 Figure 3-4 Average PJM aggregate real-time generation supply curves by offer price: January through March, 2015 and 2016  
 Figure 3-5 Distribution of PJM real-time generation plus imports: January through March, 2015 and 2016  
 Figure 3-6 PJM real-time average monthly hourly generation: January 2015 through March 2016  
 Figure 3-7 Distribution of PJM day-ahead supply plus imports: January through March 2015 and 2016  
 Figure 3-8 PJM day-ahead real-time average hourly supply: January 2015 through March 2016  
 Figure 3-9 Day-ahead and real-time supply (Average hourly volumes): January through March, 2016  
 Figure 3-10 Difference between day-ahead and real-time supply (Average daily volumes): January 2015 through March 2016  
 Figure 3-11 Map of PJM real-time generation less real-time load by zone: January through March, 2016  
 Figure 3-12 PJM footprint calendar year peak loads: January 1999 to March 2016

1	Figure 3-13 PJM peak-load comparison: Tuesday, January 19, 2016 and Friday, February 20, 2015	95
5	Figure 3-14 Distribution of PJM real-time accounting load plus exports: January through March, 2015 and 2016	95
5	Figure 3-15 PJM real-time monthly average hourly load: January 2015 through March 2016	96
73	Figure 3-16 PJM heating and cooling degree days: January 2015 through March 2016	97
82	Figure 3-17 Distribution of PJM day-ahead demand plus exports: January through March, 2015 and 2016	98
82	Figure 3-18 PJM day-ahead monthly average hourly demand: January 2015 through March 2016	99
84	Figure 3-19 Day-ahead and real-time demand (Average hourly volumes): January through March, 2016	101
85	Figure 3-20 Difference between day-ahead and real-time demand (Average daily volumes): January 2015 through March 2016	101
87	Figure 3-21 Offers with varying markups at different MW output levels)	104
88	Figure 3-22 Offers with a positive markup but different economic minimum MW	104
89	Figure 3-23 Dual fuel unit offers	105
90	Figure 3-24 Real-time offer capped unit statistics: January through March, 2015 and 2016	107
92	Figure 3-25 Frequently mitigated units and associated units (By month): February, 2006 through March, 2016	113
92	Figure 3-26 PJM day-ahead aggregate supply curves: 2016 example day	114
93	Figure 3-27 Monthly bid and cleared INCs, DECs, and UTCs (MW): January 2005 through March 2016	117
94	Figure 3-28 Daily bid and cleared INCs, DECs, and UTCs (MW): 2015 through March 2016	117
	Figure 3-29 PJM monthly cleared up to congestion transactions by type (MW): January 2005 through March 2016	123
	Figure 3-30 PJM daily cleared up to congestion transaction by type (MW): January 2015 through March 2016	124

Figure 3-31 Markup contribution to real-time hourly load-weighted LMP (Unadjusted): January through March, 2015 and 2016	128	Figure 4-4 Daily lost opportunity cost and canceled resources rates (\$/MWh): 2015 and 2016	166
Figure 3-32 Markup contribution to real-time hourly load-weighted LMP (Adjusted): January through March, 2015 and 2016	128	Figure 4-5 Daily reactive transfer interface support rates (\$/MWh): 2015 and 2016	168
Figure 3-33 Average LMP for the PJM Real-Time Energy Market: January through March, 2015 and 2016	134	Figure 4-6 Cumulative share of energy uplift credits in January through March of 2015 and 2016 by unit	172
Figure 3-34 PJM real-time, load-weighted, average LMP: January through March, 2016	136	Figure 4-7 PJM Closed loop interfaces map	180
Figure 3-35 PJM real-time, monthly and annual, load-weighted, average LMP: 1999 through March 2016	137	Figure 4-8 Energy uplift charges change from January through March 2015 to January through March 2016 by category	192
Figure 3-36 Spot average fuel price comparison with fuel delivery charges: January 2012 through March 2016 (\$/MMBtu)	137		
Figure 3-37 Average LMP for the PJM Day-Ahead Energy Market: January through March 2015 and 2016	141	<b>SECTION 5 Capacity Market</b>	<b>193</b>
Figure 3-38 Day-ahead, monthly and annual, load-weighted, average LMP: June 2000 through March 2016	143	Figure 5-1 Percentage of PJM installed capacity (By fuel source): June 1, 2007 through June 1, 2018	200
Figure 3-39 Real-time hourly LMP minus day-ahead hourly LMP: January through March, 2016	148	Figure 5-2 Capacity market load obligation served: June 1, 2007 through June 1, 2015	202
Figure 3-40 Monthly average of real-time minus day-ahead LMP: 2015 through March 2016	149	Figure 5-3 Map of PJM Locational Deliverability Areas	204
Figure 3-41 PJM system hourly average LMP: January through March, 2016	149	Figure 5-4 Map of PJM RPM EMAAC subzonal LDAs	205
Figure 3-42 Average daily delivered price for natural gas: January through March, 2015 and 2016 (\$/MMBtu)	154	Figure 5-5 Map of PJM RPM ATSI subzonal LDA	205
		Figure 5-6 History of PJM capacity prices: 1999/2000 through 2018/2019	216
<b>SECTION 4 Energy Uplift (Operating Reserves)</b>	<b>155</b>	Figure 5-7 Map of RPM capacity prices: 2015/2016 through 2018/2019	217
Figure 4-1 Daily day-ahead operating reserve rate (\$/MWh): 2015 and 2016	165	Figure 5-8 PJM outages (MW): 2012 through March 2016	219
Figure 4-2 Daily balancing operating reserve reliability rates (\$/MWh): 2015 and 2016	165	Figure 5-9 PJM equivalent outage and availability factors: January through March, 2007 to 2016	219
Figure 4-3 Daily balancing operating reserve deviation rates (\$/MWh): 2015 and 2016	166	Figure 5-10 Trends in the PJM equivalent demand forced outage rate (EFORd): 1999 through 2016	221
		Figure 5-11 PJM distribution of EFORd data by unit type: January through March, 2016	222
		Figure 5-12 PJM EFORd, XEFORd and EFORp: January through March, 2016	228
		Figure 5-13 PJM monthly generator performance factors: January through March, 2016	229

<b>SECTION 6 Demand Response</b>	<b>231</b>		
Figure 6-1 Demand response revenue by market: January through March 2008 through 2016	237		
Figure 6-2 Economic program credits and MWh by month: January 2010 through March 2016	239		
<b>SECTION 7 Net Revenue</b>	<b>251</b>		
Figure 7-1 Energy market net revenue factor trends: 2009 through March 2016	252		
Figure 7-2 Hourly spark spread (gas) for peak hours: 2011 through March 2016	253		
Figure 7-3 Hourly dark spread (coal) for peak hours: 2011 through March 2016	253		
Figure 7-4 Hourly quark spread (uranium) for selected zones: 2011 through March 2016	254		
Figure 7-5 Average short run marginal costs: 2009 through March 2016	255		
<b>SECTION 8 Environmental and Renewable Energy Regulations</b>	<b>263</b>		
Figure 8-1 Spot monthly average emission price comparison: 2015 through March 2016	276		
Figure 8-2 Average solar REC price by jurisdiction: 2009 through March 2016	280		
Figure 8-3 Average Tier I REC price by jurisdiction: 2009 through March 2016	280		
Figure 8-4 Average Tier II REC price by jurisdiction: 2009 through March 2016	281		
Figure 8-5 CO <sub>2</sub> emissions by year (millions of short tons), by PJM units: January 1999 through March 2016	285		
Figure 8-6 SO <sub>2</sub> and NO <sub>x</sub> emissions by year (thousands of short tons), by PJM units: January 1999 through March 2016	286		
		Figure 8-7 Average hourly real-time generation of wind units in PJM: January through March 2016	286
		Figure 8-8 Average hourly day-ahead generation of wind units in PJM: January through March 2016	287
		Figure 8-9 Marginal fuel at time of wind generation in PJM: January through March 2016	288
		Figure 8-10 Average hourly real-time generation of solar units in PJM: January through March 2016	288
		Figure 8-11 Average hourly day-ahead generation of solar units in PJM: January through March 2016	289
		<b>SECTION 9 Interchange Transactions</b>	<b>291</b>
		Figure 9-1 PJM real-time and day-ahead scheduled imports and exports: January through March, 2016	295
		Figure 9-2 PJM real-time and day-ahead scheduled import and export transaction volume history: January, 1999 through March, 2016	295
		Figure 9-3 PJM's footprint and its external day-ahead and real-time scheduling interfaces	308
		Figure 9-4 Real-time and day-ahead daily hourly average price difference (MISO/PJM Interface minus PJM/MISO Interface): January through March, 2016	317
		Figure 9-5 Real-time and day-ahead daily hourly average price difference (NY/PJM proxy - PJM/NYIS Interface): January through March, 2016	319
		Figure 9-6 Neptune hourly average flow: January through March, 2016	321
		Figure 9-7 Linden hourly average flow: January through March, 2016	322
		Figure 9-8 Hudson hourly average flow: January through March, 2016	324
		Figure 9-9 Credits for coordinated congestion management: January, 2015 through March, 2016	326

Figure 9-10 Credits for coordinated congestion management (flowgates): January, 2015 through March, 2016	327	Figure 10-10 RTO reserve zone monthly average synchronized reserve required vs. tier 2 synchronized reserve scheduled MW: January 2015 through March 2016	373
Figure 9-11 Credits for coordinated congestion management (Ramapo PARs): January, 2015 through March, 2016	328	Figure 10-11 Tier 2 synchronized reserve hourly offer and eligible volume (MW), averaged daily: January through March, 2016	375
Figure 9-12 Monthly up to congestion cleared bids in MWh: January, 2005 through March, 2016	334	Figure 10-12 Mid-Atlantic Dominion subzone average daily tier 2 synchronized reserve offer by unit type (MW): January through March, 2013 through 2016	376
Figure 9-13 Monthly cleared PJM/NYIS CTS bid volume: November, 2014 through March, 2016	342	Figure 10-13 RTO Zone average daily tier 2 synchronized reserve offer by unit type (MW): January through March, 2013 through 2016	376
Figure 9-14 Spot import service use: January, 2013 through March, 2016	347	Figure 10-14 Synchronized reserve events duration distribution curve: 2011 through 2016	382
<b>SECTION 10 Ancillary Service Markets</b>	<b>351</b>	Figure 10-15 Daily average RTO zone non-synchronized reserve market clearing price and MW purchased: January through March 2016	384
Figure 10-1 PJM RTO Zone and MAD Subzone geography: 2016	360	Figure 10-16 Daily average components of DASR clearing price (\$/MW), marginal unit offer and LOC: January through March 2016	388
Figure 10-2 Mid-Atlantic Dominion Subzone primary reserve MW by source (Daily Averages): January through March, 2016	362	Figure 10-17 Daily average DASR MW by Unit Type sorted from highest to lowest daily requirement: January through March 2016	389
Figure 10-3 RTO Reserve Zone primary reserve MW by source (Daily Averages): January through March, 2016	362	Figure 10-18 Hourly average performance score by unit type: January through March, 2016	391
Figure 10-4 Daily weighted average market clearing prices (\$/MW) for synchronized reserve and non-synchronized reserve: January through March, 2016	363	Figure 10-19 Hourly average performance score by regulation signal type: January through March, 2016	391
Figure 10-5 Daily average tier 1 synchronized reserve supply (MW) in the MAD Subzone: January through March 2016	365	Figure 10-20 Daily average marginal benefit factor and mileage ratio during excursion and non excursion hours: January through March, 2016	393
Figure 10-6 Cleared tier 2 synchronized reserve average hourly MW per hour by unit type, RTO Zone: January 2015 through March 2016	371	Figure 10-21 Average cleared RegD MW and average cleared RegD with an effective price of \$0.00 by month: January 2015 through March 2016	393
Figure 10-7 Average hourly tier 2 MW by unit type by SRMCP Range: January through March 2016	371	Figure 10-22 Maximum, minimum, and average PJM calculated marginal benefit factor by month for excursion and nonexcursion hours: January through March, 2016	394
Figure 10-8 Monthly average actual vs default synchronized reserve requirements, RTO Zone and MAD Subzone: January 2015 through March 2016	372		
Figure 10-9 Mid-Atlantic Dominion reserve subzone monthly average synchronized reserve required vs. tier 2 synchronized reserve scheduled MW: January 2015 through March 2016	373		

Figure 10-23 Marginal benefit factor curve before and after December 14, 2015, revisions by PJM	395	Figure 11-6 PJM monthly marginal loss costs (Dollars (Millions)): 2009 through March of 2016	441
Figure 10-24 Example marginal benefit line in percent RegD and RegD MW terms	396	Figure 11-7 PJM monthly energy costs (Millions): 2009 through March of 2016	445
Figure 10-25 Illustration of correct method for calculating effective MW	396	<b>SECTION 12 Generation and Transmission Planning</b>	<b>447</b>
Figure 10-26 Example of Pre and Post December 14, 2015, Effective MW Calculations for RegD MW offered at \$0.00 or as Self Supply	397	Figure 12-1 Map of PJM unit retirements: 2011 through 2020	455
Figure 10-27 Average monthly peak effective MW: PJM market calculated versus benefit factor based: January 2015 through March 2016	397	Figure 12-2 PJM capacity (MW) by age (years): At March 31, 2016	458
Figure 10-28 Cost of excess effective MW cleared by month, peak and off peak: January 2015 through March 2016	398	Figure 12-3 RTEP cost allocation rules	471
Figure 10-29 Off peak and on peak regulation levels: January 2015 through March 2016	402	Figure 12-4 PJM Backbone Projects	473
Figure 10-30 PJM regulation market daily weighted average market-clearing price, marginal unit opportunity cost and offer price (Dollars per MW): January through March 2016	404	<b>SECTION 13 Financial Transmission and Auction Revenue Rights</b>	<b>485</b>
Figure 10-31 PJM monthly CPS1 and BAAL performance: January 2011 through March 2016	406	Figure 13-1 Historic Stage 1B and Stage 2 ARR Allocations from the 2011 to 2012 through 2015 to 2016 planning periods	495
<b>SECTION 11 Congestion and Marginal Losses</b>	<b>411</b>	Figure 13-2 Dollars per ARR MW paid to ARR holders: Planning periods 2010 to 2011 through 2015 to 2016	499
Figure 11-1 PJM monthly total congestion cost (Dollars (Millions)): 2009 through March of 2016	423	Figure 13-3 Monthly excess ARR revenue: Planning periods 2011 to 2012 through 2015 to 2016	499
Figure 11-2 Location of the top 10 constraints by PJM total congestion costs: January through March of 2016	432	Figure 13-4 Cleared auction volume (MW) as a percent of total FTR cleared volume by calendar month: June 2004 through March 2016	504
Figure 11-3 Location of the top 10 constraints by PJM day-ahead congestion costs: January through March of 2016	432	Figure 13-5 Long Term, Annual and Monthly FTR Auction bid and cleared volume: June 2003 through March 2016	505
Figure 11-4 Location of the top 10 constraints by PJM balancing congestion costs: January through March of 2016	432	Figure 13-6 Ten largest positive and negative FTR target allocations summed by sink: 2015 to 2016 planning period	507
Figure 11-5 Daily congestion event hours: 2014 through March of 2016	437	Figure 13-7 Ten largest positive and negative FTR target allocations summed by source: 2015 to 2016 planning period	508
		Figure 13-8 FTR payout ratio by month, excluding and including excess revenue distribution: January 2004 through March 2016	512
		Figure 13-9 FTR surplus and the collected Day-Ahead, Balancing and Total congestion: January 2005 through March 2016	520

Figure 13-10 FTR target allocation compared to sources of positive and negative congestion revenue	521
Figure 13-11 Illustration of INC/DEC FTR forfeiture rule	522
Figure 13-12 Monthly FTR forfeitures for physical and financial participants: June 2010 through March 2016	523
Figure 13-13 FTR forfeitures for INCs/DECs and INCs/DECs/UTCs for both the PJM and MMU methods: January 2013 through March 2016	523
Figure 13-14 Illustration of UTC FTR forfeiture rule	524
Figure 13-15 Illustration of UTC FTR Forfeiture rule with one point far from constraint	525

## Tables

### SECTION 1 Introduction

Table 1-1 PJM Market Summary Statistics, January through March, 2015 and 2016

Table 1-2 The Energy Market results were competitive

Table 1-3 The Capacity Market results were competitive

Table 1-4 The Regulation Market results were competitive

Table 1-5 The Tier 2 Synchronized Reserve Markets results were competitive

Table 1-6 The Day-Ahead Scheduling Reserve Market results were competitive

Table 1-7 The FTR Auction Markets results were competitive

Table 1-8 Total price per MWh by category: January through March, 2015 and 2016

### SECTION 3 Energy Market

Table 3-1 The energy market results were competitive

Table 3-2 PJM hourly energy market HHI: January through March, 2015 and 2016

Table 3-3 PJM hourly energy market HHI (By supply segment): January through March, 2015 and 2016

Table 3-4 Marginal unit contribution to PJM real-time, load-weighted LMP (By parent company): January through March, 2015 and 2016

Table 3-5 Marginal resource contribution to PJM day-ahead, load-weighted LMP (By parent company): January through March, 2015 and 2016

Table 3-6 Type of fuel used (By real-time marginal units): January through March, 2012 through 2016

Table 3-7 Day-ahead marginal resources by type/fuel: January through March, 2011 through 2016

Table 3-8 PJM generation (By fuel source (GWh)): January through March, 2015 and 2016

Table 3-9 Monthly PJM generation (By fuel source (GWh)): 2016

Table 3-10 PJM real-time average hourly generation and real-time average hourly generation plus average hourly imports: January through March, 2000 through 2015

Table 3-11 PJM day-ahead average hourly supply and day-ahead average hourly supply plus average hourly imports: January through March, 2000 through 2016

Table 3-12 Day-ahead and real-time supply (MWh): January through March, 2015 and 2016

Table 3-13 PJM real-time generation less real-time load by zone (GWh): January through March, 2015 and 2016

Table 3-14 Actual PJM footprint peak loads: 1999 to 2015

Table 3-15 PJM real-time average hourly load and real-time average hourly load plus average hourly exports: January through March 1998 through 2016

Table 3-16 PJM heating and cooling degree days: January 2015 through March 2016

Table 3-17 PJM day-ahead average demand and day-ahead average hourly demand plus average hourly exports: January through March, 2000 through 2016

Table 3-18 Cleared day-ahead and real-time demand (MWh): January through March, 2015 and 2016

Table 3-19 Monthly average percentage of real-time self-supply load, bilateral-supply load and spot-supply load based on parent companies: 2015 through March 2016

Table 3-20 Monthly average percentage of day-ahead self-supply demand, bilateral supply demand, and spot-supply demand based on parent companies: 2015 through March 2016

Table 3-21 Offer capping statistics – energy only: January through March, 2012 to 2016

Table 3-22 Offer capping statistics for energy and reliability: January through March, 2012 to 2016

Table 3-23 Offer capping statistics for reliability: January through March, 2012 through 2016

Table 3-24 Real-time offer capped unit statistics: January through March, 2015 and 2016	106	Table 3-39 PJM import and export transactions by type of parent organization (MW): January through March, 2015 and 2016	118
Table 3-25 Numbers of hours when control zones experienced congestion resulting from one or more constraints binding for 25 or more hours or from an interface constraint: January through March, 2009 through 2016	107	Table 3-40 PJM virtual offers and bids by top ten locations (MW): January through March, 2015 and 2016	119
Table 3-26 Three pivotal supplier test details for interface constraints: January through March, 2016	108	Table 3-41 PJM cleared up to congestion import bids by top ten source and sink pairs (MW): January through March, 2015 and 2016	120
Table 3-27 Summary of three pivotal supplier tests applied for interface constraints: January through March, 2016	108	Table 3-42 PJM cleared up to congestion export bids by top ten source and sink pairs (MW): January through March, 2015 and 2016	120
Table 3-28 Average, real-time marginal unit markup index (By offer price category unadjusted): January through March, 2015 and 2016	111	Table 3-43 PJM cleared up to congestion wheel bids by top ten source and sink pairs (MW): January through March, 2015 and 2016	121
Table 3-29 Average, real-time marginal unit markup index (By offer price category adjusted): January through March, 2015 and 2016	111	Table 3-44 PJM cleared up to congestion internal bids by top ten source and sink pairs (MW): January through March, 2015 and 2016	121
Table 3-30 Average, real-time offered unit markup (By Fuel Price Unadjusted): January through March, 2015 and 2016	111	Table 3-45 Number of PJM offered and cleared source and sink pairs: January 2013 through March 2016	122
Table 3-31 Average day-ahead marginal unit markup index (By offer price category, unadjusted): January through March, 2015 and 2016	112	Table 3-46 PJM cleared up to congestion transactions by type (MW): January through March, 2015 and 2016	123
Table 3-32 Average day-ahead marginal unit markup index (By offer price category, adjusted): January through March, 2015 and 2016	112	Table 3-47 Distribution of MW for dispatchable unit offer prices: January through March, 2016	124
Table 3-33 Hourly average number of cleared and submitted INCs, DECs by month: January 2015 through March 2016	115	Table 3-48 Distribution of MW for self scheduled offer prices: January through March, 2016	125
Table 3-34 Hourly average of cleared and submitted up to congestion bids by month: January 2015 through March 2016	116	Table 3-49 Markup component of the overall PJM real-time, load-weighted, average LMP by primary fuel type and unit type: January through March, 2015 and 2016	127
Table 3-35 Hourly average number of cleared and submitted import and export transactions by month: January 2015 through March 2016	116	Table 3-50 Monthly markup components of real-time load-weighted LMP (Unadjusted): January through March, 2015 and 2016	127
Table 3-36 Type of day-ahead marginal units: January through March, 2015 and 2016	117	Table 3-51 Monthly markup components of real-time load-weighted LMP (Adjusted): January through March, 2015 and 2016	127
Table 3-37 PJM INC and DEC bids by type of parent organization (MW): January through March, 2015 and 2016	118	Table 3-52 Average real-time zonal markup component (Unadjusted): January through March, 2015 and 2016	129
Table 3-38 PJM up to congestion transactions by type of parent organization (MW): January through March, 2015 and 2016	118	Table 3-53 Average real-time zonal markup component (Adjusted): January through March, 2015 and 2016	129

Table 3-54 Average real-time markup component (By price category, unadjusted): January through March, 2015 and 2016	130	Table 3-70 PJM day-ahead, average LMP (Dollars per MWh): January through March, 2001 through 2016	141
Table 3-55 Average real-time markup component (By price category, adjusted): January through March, 2015 and 2016	130	Table 3-71 PJM day-ahead, load-weighted, average LMP (Dollars per MWh): 2001 through 2016	142
Table 3-56 Markup component of the annual PJM day-ahead, load-weighted, average LMP by primary fuel type and unit type: January through March, 2015 and 2016	130	Table 3-72 Zone day-ahead and day-ahead, load-weighted, average LMP (Dollars per MWh): January through March, 2015 and 2016	142
Table 3-57 Monthly markup components of day-ahead (Unadjusted), load-weighted LMP: January through March, 2015 and 2016	131	Table 3-73 Components of PJM day-ahead, (unadjusted), load-weighted, average LMP (Dollars per MWh): January through March, 2015 and 2016	144
Table 3-58 Monthly markup components of day-ahead (Adjusted), load-weighted LMP: January through March, 2015 and 2016	131	Table 3-74 Components of PJM day-ahead, (adjusted), load-weighted, average LMP (Dollars per MWh): January through March, 2015 and 2016	144
Table 3-59 Day-ahead, average, zonal markup component (Unadjusted): January through March of 2015 and 2016	132	Table 3-75 Cleared UTC profitability by source and sink point: January through March, 2015 and 2016	145
Table 3-60 Day-ahead, average, zonal markup component (Adjusted): January through March, 2015 and 2016	132	Table 3-76 Day-ahead and real-time average LMP (Dollars per MWh): January through March, 2015 and 2016	146
Table 3-61 Average, day-ahead markup (By LMP category, unadjusted): January through March, 2015 and 2016	133	Table 3-77 Day-ahead and real-time average LMP (Dollars per MWh): January through March, 2001 through 2016	146
Table 3-62 Average, day-ahead markup (By LMP category, adjusted): January through March, 2015 and 2016	133	Table 3-78 Frequency distribution by hours of PJM real-time LMP minus day-ahead LMP (Dollars per MWh): January through March, 2007 through 2016	147
Table 3-63 PJM real-time, average LMP (Dollars per MWh): January through March, 1998 through 2016”	135	Table 3-78 Frequency distribution by hours of PJM real-time LMP minus day-ahead LMP (Dollars per MWh): January through March, 2007 through 2016 (continued)	148
Table 3-64 PJM real-time, load-weighted, average LMP (Dollars per MWh): January through March, 1998 through 2016	135	Table 3-79 Summary of emergency events declared: January through March, 2015 and 2016	150
Table 3-65 Zone real-time and real-time, load-weighted, average LMP (Dollars per MWh): January through March, 2015 and 2016	136	Table 3-80 Description of emergency procedures	152
Table 3-66 PJM real-time annual, fuel-cost adjusted, load-weighted average LMP (Dollars per MWh): January through March, 2015 and 2016	138	Table 3-81 PJM declared emergency alerts, warnings and actions: January through March, 2016	153
Table 3-67 Change in PJM real-time annual, fuel-cost adjusted, load-weighted average LMP (Dollars per MWh) by Fuel-type: January through March, 2015 and 2016	138		
Table 3-68 Components of PJM real-time (Unadjusted), load-weighted, average LMP: January through March, 2015 and 2016	140		
Table 3-69 Components of PJM real-time (Adjusted), load-weighted, average LMP: January through March 2015 and 2016	140		

<b>SECTION 4 Energy Uplift (Operating Reserves)</b>	<b>155</b>		
Table 4-1 Day-ahead and balancing operating reserve credits and charges	160	Table 4-18 Energy uplift credits by unit type: January through March 2015 and 2016	171
Table 4-2 Reactive services, synchronous condensing and black start services credits and charges	160	Table 4-19 Energy uplift credits by unit type: January through March 2016	171
Table 4-3 Total energy uplift charges: January through March, 2001 through 2016	161	Table 4-20 Top 10 units and organizations energy uplift credits: January through March 2016	172
Table 4-4 Energy uplift charges by category: January through March 2015 and 2016	161	Table 4-21 Identification of balancing operating reserve credits received by the top 10 units by category and region: January through March 2016	172
Table 4-5 Monthly energy uplift charges: 2015 and 2016	162	Table 4-22 Daily energy uplift credits HHI: January through March 2016	173
Table 4-6 Day-ahead operating reserve charges: January through March, 2015 and 2016	162	Table 4-23 Day-ahead and real-time generation (GWh): January through March 2015	173
Table 4-7 Balancing operating reserve charges: January through March, 2015 and 2016	163	Table 4-24 Day-ahead and real-time economic and noneconomic generation from units eligible for operating reserve credits (GWh): January through March 2015	174
Table 4-8 Balancing operating reserve deviation charges: January through March, 2015 and 2016	163	Table 4-25 Day-ahead and real-time generation receiving operating reserve credits (GWh): January through March 2015	174
Table 4-9 Additional energy uplift charges: January through March, 2015 and 2016	163	Table 4-26 Day-ahead generation scheduled as must run by PJM (GWh): 2015 and 2016	174
Table 4-10 Regional balancing charges allocation (Millions): January through March, 2015	164	Table 4-27 Day-ahead generation scheduled as must run by PJM by category (GWh): January through March 2016	175
Table 4-11 Regional balancing charges allocation (Millions): January through March, 2016	164	Table 4-28 Geography of regional charges and credits: January through March 2015	176
Table 4-12 Operating reserve rates (\$/MWh): January through March, 2015 and 2016	167	Table 4-29 Monthly lost opportunity cost credits (Millions): 2015 and 2016	177
Table 4-13 Operating reserve rates statistics (\$/MWh): January through March, 2016	167	Table 4-30 Day-ahead generation from combustion turbines and diesels (GWh): 2015 and 2016	178
Table 4-14 Local voltage support rates: January through March, 2015 and 2016	168	Table 4-31 Lost opportunity cost credits paid to combustion turbines and diesels by scenario (Millions): 2015 and 2016	179
Table 4-15 Balancing operating reserve determinants (MWh): January through March 2015 and 2016	169	Table 4-32 Day-ahead generation (GWh) from combustion turbines and diesels receiving lost opportunity cost credits by value: 2015 and 2016	179
Table 4-16 Deviations by transaction type: January through March 2016	169	Table 4-33 PJM closed loop interfaces	180
Table 4-17 Energy uplift credits by category: January through March 2015 and 2016	170	Table 4-34 Current energy uplift allocation	190

Table 4-35 MMU energy uplift allocation proposal	190	Table 5-17 PJM capacity factor (By unit type (GWh)): January through March, 2015 and 2016	218
Table 4-36 Current and proposed energy uplift charges by allocation (Millions): 2015 and January through March 2016	191	Table 5-18 EAF by unit type: January through March, 2007 through 2016	220
Table 4-37 Current and proposed average energy uplift rate by transaction: 2015 and January through March 2016	192	Table 5-19 EMOF by unit type: January through March, 2007 through 2016	220
<b>SECTION 5 Capacity Market</b>	<b>193</b>	Table 5-20 EPOF by unit type: January through March, 2007 through 2016	220
Table 5-1 The capacity market results were competitive	193	Table 5-21 EFOF by unit type: January through March, 2007 through 2016	220
Table 5-2 RPM related MMU reports, 2015 through 2016	198	Table 5-22 PJM EFORD data for different unit types: January through March, 2007 through 2016	222
Table 5-3 PJM installed capacity (By fuel source): January 1, January 31, February 29, and March 31, 2016	200	Table 5-23 OMC outages: January through March, 2016	224
Table 5-4 Generation capacity changes: 2007/2008 through 2015/2016	201	Table 5-24 Contribution to EFOF by unit type by cause: January through March, 2016	227
Table 5-5 Capacity market load obligations served: June 1, 2015	202	Table 5-25 Contributions to Economic Outages: January through March, 2016	227
Table 5-6 RSI results: 2015/2016 through 2018/2019 RPM Auctions	203	Table 5-26 PJM EFORD, XEFORD and EFORp data by unit type: January through March, 2016	228
Table 5-7 RPM imports: 2007/2008 through 2018/2019 RPM Base Residual Auctions	207	<b>SECTION 6 Demand Response</b>	<b>231</b>
Table 5-8 RPM load management statistics by LDA: June 1, 2014 to June 1, 2018	209	Table 6-1 Overview of demand response programs	236
Table 5-9 RPM load management cleared capacity and ILR: 2007/2008 through 2018/2019	210	Table 6-2 Economic program registrations on the last day of the month: January 2010 through March 2016	238
Table 5-10 RPM load management statistics: June 1, 2007 to June 1, 2018	210	Table 6-3 Sum of peak MW reductions for all registrations per month: January through March of 2010 through 2016	238
Table 5-11 ACR statistics: 2016/2017 RPM Auctions	212	Table 6-4 Credits paid to the PJM economic program participants: January through March of 2010 through 2016	239
Table 5-12 Capacity prices: 2007/2008 through 2018/2019 RPM Auctions	213	Table 6-5 PJM economic program participation by zone: January through March of 2015 and 2016	240
Table 5-12 Capacity prices: 2007/2008 through 2018/2019 RPM Auctions (continued)	214	Table 6-6 Settlements submitted by year in the economic program: January through March of 2010 through 2016	240
Table 5-13 Weighted average clearing prices by zone: 2015/2016 through 2018/2019	215		
Table 5-14 RPM revenue by type: 2007/2008 through 2018/2019	215		
Table 5-15 RPM revenue by calendar year: 2007 through 2019	216		
Table 5-16 RPM cost to load: 2015/2016 through 2018/2019 RPM Auctions	218		

Table 6-7 Participants and CSPs submitting settlements in the economic program by year: January through March of 2010 through 2016	240
Table 6-8 HHI and market concentration in the economic program: January through March of 2015 and 2016	241
Table 6-9 Hourly frequency distribution of economic program MWh reductions and credits: January through March of 2015 and 2016	241
Table 6-10 Frequency distribution of economic program zonal, load-weighted, average LMP (By hours): January through March of 2015 and 2016	242
Table 6-11 Net benefits test threshold prices: April 2012 through March 2016	242
Table 6-12 Hours with price higher than NBT and DR occurrences in those hours: January through March of 2015 and 2016	243
Table 6-13 Zonal DR charge: January through March 2016	243
Table 6-14 Zonal DR charge per MWh of load and exports: January through March of 2016	244
Table 6-15 Monthly day-ahead and real-time DR charge: January through March of 2015 and 2016	244
Table 6-16 HHI value for LDAs by delivery year: 2014/2015 and 2015/2016 Delivery Year	245
Table 6-17 Zonal monthly capacity revenue: January through March 2016	245
Table 6-18 Energy efficiency resources by MW: 2012/2013 through 2015/2016 Delivery Year	246
Table 6-19 Lead time by product type: 2015/2016 Delivery Year	246
Table 6-20 Reduction MW by each demand response method: 2015/2016 Delivery Year	247
Table 6-21 On-site generation fuel type by MW: 2015/2016 Delivery Year	247
Table 6-22 Demand response cleared MW UCAP for PJM: 2011/2012 through 2015/2016 Delivery Year	248
Table 6-23 Distribution of registrations and associated MW in the emergency full option across ranges of minimum dispatch prices: 2015/2016 Delivery Year	250

<b>SECTION 7 Net Revenue</b>	<b>251</b>
Table 7-1 Average short run marginal costs: 2016	255
Table 7-2 Energy net revenue for a new entrant gas fired CT under economic dispatch (Dollars per installed MW-year)	256
Table 7-3 Energy net revenue for a new entrant CC under economic dispatch (Dollars per installed MW-year)	257
Table 7-4 Energy net revenue for a new entrant CP (Dollars per installed MW-year)	258
Table 7-5 Energy market net revenue for a new entrant DS (Dollars per installed MW-year)	259
Table 7-6 Energy net revenue for a new entrant nuclear plant (Dollars per installed MW-year)	260
Table 7-7 Net revenue for a wind installation (Dollars per installed MW-year)	261
Table 7-8 PSEG Energy Market net revenue for a solar installation (Dollars per installed MW-year)	261
<b>SECTION 8 Environmental and Renewable Energy Regulations</b>	<b>263</b>
Table 8-1 Current and Proposed CSPAR Ozone Season NO <sub>x</sub> Budgets for Electric Generating Units (before accounting for variability)	268
Table 8-2 Interim and final targets for CO <sub>2</sub> emissions goals for PJM states (Short Tons of CO <sub>2</sub> )	271
Table 8-3 Minimum Criteria for Existing CCR Ponds (Surface Impoundments) and Landfills and Date by which Implementation is Expected	273
Table 8-4 HEDD maximum NO <sub>x</sub> emission rates	273
Table 8-5 RGGI CO <sub>2</sub> allowance auction prices and quantities in short tons and metric tonnes: 2009-2011, 2012-2014 and 2015-2017 Compliance Periods	275
Table 8-6 Renewable standards of PJM jurisdictions: 2016 to 2028	277
Table 8-7 REC Tracking Systems in PJM States with Renewable Portfolio Standards	277

Table 8-8 Geographical restrictions on REC purchases for renewable portfolio standard compliance in PJM states	278	<b>SECTION 9 Interchange Transactions</b>	<b>291</b>
Table 8-9 Solar renewable standards by percent of electric load for PJM jurisdictions: 2016 to 2028	279	Table 9-1 Real-time scheduled net interchange volume by interface (GWh): January through March, 2016	297
Table 8-10 Additional renewable standards of PJM jurisdictions: 2016 to 2028	279	Table 9-2 Real-time scheduled gross import volume by interface (GWh): January through March, 2016	297
Table 8-11 Renewable alternative compliance payments in PJM jurisdictions: As of March 31, 2016	281	Table 9-3 Real-time scheduled gross export volume by interface (GWh): January through March, 2016	298
Table 8-12 Renewable resource generation by jurisdiction and renewable resource type (GWh): January through March 2016	282	Table 9-4 Real-time scheduled net interchange volume by interface pricing point (GWh): January through March, 2016	299
Table 8-13 PJM renewable capacity by jurisdiction (MW): April 1, 2016	282	Table 9-5 Real-time scheduled gross import volume by interface pricing point (GWh): January through March, 2016	300
Table 8-14 Renewable capacity by jurisdiction, non-PJM units registered in GATS (MW), on April 1, 2016	283	Table 9-6 Real-time scheduled gross export volume by interface pricing point (GWh): January through March, 2016	300
Table 8-15 SO <sub>2</sub> emission controls by fuel type (MW): as of March 31, 2016	284	Table 9-7 Day-Ahead scheduled net interchange volume by interface (GWh): January through March, 2016	302
Table 8-16 NO <sub>x</sub> emission controls by fuel type (MW), as of March 31, 2015	284	Table 9-8 Day-Ahead scheduled gross import volume by interface (GWh): January through March, 2016	302
Table 8-17 Particulate emission controls by fuel type (MW), as of March 31, 2016	284	Table 9-9 Day-Ahead scheduled gross export volume by interface (GWh): January through March, 2016	303
Table 8-18 Capacity factor of wind units in PJM: January through March 2016	286	Table 9-10 Day-ahead scheduled net interchange volume by interface pricing point (GWh): January through March, 2016	305
Table 8-19 Capacity factor of wind units in PJM by month: 2015 through March 2016	287	Table 9-11 Up to congestion scheduled net interchange volume by interface pricing point (GWh): January through March, 2016	305
Table 8-20 Capacity factor of wind units in PJM: January through March 2016	288	Table 9-12 Day-ahead scheduled gross import volume by interface pricing point (GWh): January through March, 2016	306
Table 8-21 Capacity factor of solar units in PJM by month: 2015 through March 2016	289	Table 9-13 Up to congestion scheduled gross import volume by interface pricing point (GWh): January through March, 2016	306
		Table 9-14 Day-ahead scheduled gross export volume by interface pricing point (GWh): January through March, 2016	307
		Table 9-15 Up to congestion scheduled gross export volume by interface pricing point (GWh): January through March, 2016	307
		Table 9-16 Active real-time and day-ahead scheduling interfaces: January through March, 2016	308

Table 9-17 Active day-ahead and real-time scheduled interface pricing points: January through March, 2016	308	Table 9-32 Percent of scheduled interchange across the Hudson Line by primary rights holder: May, 2013 through March, 2016	323
Table 9-18 Net scheduled and actual PJM flows by interface (GWh): January through March, 2016	310	Table 9-33 Summary of elements included in operating agreements with bordering areas	325
Table 9-19 Net scheduled and actual PJM flows by interface pricing point (GWh): January through March, 2016	311	Table 9-34 Real-time average hourly LMP comparison for Duke, PEC and NCMAPA: January through March, 2016	331
Table 9-20 Net scheduled and actual PJM flows by interface pricing point (GWh) (Adjusted for IMO Scheduled Interfaces): January through March, 2016	312	Table 9-35 Day-ahead average hourly LMP comparison for Duke, PEC and NCMAPA: January through March, 2016	331
Table 9-21 Net scheduled and actual PJM flows by interface and interface pricing point (GWh): January through March, 2016	313	Table 9-36 PJM MISO, and NYISO TLR procedures: January, 2013 through March, 2016	333
Table 9-22 Net scheduled and actual PJM flows by interface pricing point and interface (GWh): January through March, 2016	314	Table 9-37 Number of TLRs by TLR level by reliability coordinator: January through March, 2016	333
Table 9-23 PJM and MISO flow based hours and average hourly price differences: January through March, 2016	317	Table 9-38 Monthly volume of cleared and submitted up to congestion bids: January, 2011 through March, 2016	335
Table 9-24 Distribution of hourly flows that are consistent and inconsistent with price differences between PJM and MISO: January through March, 2016	318	Table 9-39 Credit risk associated with varying levels of potential uplift: September 8, 2014 through December 7, 2015	336
Table 9-25 PJM and NYISO flow based hours and average hourly price differences: January through March, 2016	318	Table 9-40 Differences between forecast and actual PJM/NYIS interface prices: January through March, 2016	339
Table 9-26 Distribution of hourly flows that are consistent and inconsistent with price differences between PJM and NYISO: January through March, 2016	319	Table 9-41 Differences between forecast and actual PJM/NYIS interface prices: January through March, 2016	340
Table 9-27 PJM and NYISO flow based hours and average hourly price differences (Neptune): January through March, 2016	320	Table 9-42 Monthly Differences between forecast and actual PJM/NYIS interface prices (percent of intervals): January through March, 2016	341
Table 9-28 Percent of scheduled interchange across the Neptune line by primary rights holder: July, 2007 through March, 2016	320	Table 9-43 Monthly differences between forecast and actual PJM/NYIS interface prices (average price difference): January through March, 2016	341
Table 9-29 PJM and NYISO flow based hours and average hourly price differences (Linden): January through March, 2016	321	Table 9-44 Differences between forecast and actual PJM/MISO interface prices: January through March, 2016	344
Table 9-30 Percent of scheduled interchange across the Linden VFT Line by primary rights holder: November, 2009 through March, 2016	322	Table 9-45 Differences between forecast and actual PJM/MISO interface prices: January through March, 2016	344
Table 9-31 PJM and NYISO flow based hours and average hourly price differences (Hudson): January through March, 2016	323	Table 9-46 Monthly Differences between forecast and actual PJM/MISO interface prices (percent of intervals): January through March, 2016	345

Table 9-47 Monthly differences between forecast and actual PJM/MISO interface prices (average price difference): January through March, 2016	345	Table 10-12 Tier 1 compensation as currently implemented by PJM	368
Table 9-48 Monthly uncollected congestion charges: January, 2010 through March, 2016	346	Table 10-13 Tier 1 compensation as recommended by MMU	368
<b>SECTION 10 Ancillary Service Markets</b>	<b>351</b>	Table 10-14 ASO tier 1 estimate biasing, January 2014 through March, 2016	369
Table 10-1 The Regulation Market results were competitive	351	Table 10-15 Default Tier 2 Synchronized Reserve Markets required MW, RTO Zone and Mid-Atlantic Dominion Subzone	372
Table 10-2 The Tier 2 Synchronized Reserve Market results were competitive	351	Table 10-16 Three pivotal supplier test results for the RTO Zone and MAD Subzone: January 2015 through March 2016	374
Table 10-3 The Day-Ahead Scheduling Reserve Market results were competitive	352	Table 10-17 Mid-Atlantic Dominion subzone, weighted SRMCP and cleared MW (excludes self-scheduled): January 2015 through March 2016	377
Table 10-4 History of ancillary services costs per MWh of Load: January through March, 2004 through 2016	357	Table 10-18 RTO zone weighted SRMCP and cleared MW (excludes self-scheduled): January 2015 through March 2016	377
Table 10-5 Average monthly tier 1 and tier 2 synchronized reserve, plus non-synchronized reserve used to satisfy the primary reserve requirement, MAD Subzone: January through March, 2016	361	Table 10-19 RTO Zone, Mid-Atlantic Subzone tier 2 synchronized reserve MW, credits, weighted price, and cost (including self-scheduled): January through March, 2016	378
Table 10-6 Average monthly tier 1 and tier 2 synchronized reserve, and non-synchronized reserve used to satisfy the primary reserve requirement, RTO Zone: January through March, 2016	361	Table 10-20 Synchronized reserve events 10 minutes or longer, tier 2 response compliance, RTO Reserve Zone: January through March, 2016	378
Table 10-7 MW credited, price, cost, and all-in price for primary reserve and its component products, RTO Reserve Zone: January through March 2016	363	Table 10-21 Synchronized reserve events, January 2010 through March 2016	380
Table 10-8 Monthly average market solution Tier 1 Synchronized Reserve (MW) identified hourly, January through March, 2016	364	Table 10-21 Synchronized reserve events, January 2010 through March 2016 (continued)	381
Table 10-9 Tier 1 synchronized reserve event response costs: January 2015 through March 2016	366	Table 10-22 Non-synchronized reserve market HHIs: January through March, 2016	383
Table 10-10 Weighted price of tier 1 synchronized reserve attributable to a non-synchronized reserve price above zero: January 2015 to March 2016	367	Table 10-23 Non-synchronized reserve market pivotal supply test: January through March, 2016	383
Table 10-11 Dollar impact of paying tier 1 synchronized reserve the SRMCP when the NSRMCP goes above \$0: January 2015 through March 2016	368	Table 10-24 RTO zone, MAD subzone non-synchronized reserve MW, credits, price, and cost: January through March 2016	384
		Table 10-25 Adjusted Fixed Demand Days: 2016	386
		Table 10-26 DASR market three pivotal supplier test results and number of hours with DASRMCP above \$0: January 2015 through March 2016	386
		Table 10-27 DASR Market, regular hours vs. adjusted fixed demand hours: January 2015 through March 2016	387

Table 10-28 DASR Market all hours of DASR market clearing price greater than \$0, January 2015 through March 2016	388
Table 10-29 Active battery storage projects in the PJM queue system by submitted year from 2012 to 2016	390
Table 10-30 PJM regulation capability, daily offer and hourly eligible: January through March 2016	399
Table 10-31 PJM regulation by source in January through March 2016	399
Table 10-32 PJM Regulation Market required MW and ratio of eligible supply to requirement for on and off peak hours: January through March 2015 and 2016	400
Table 10-33 Regulation market monthly three pivotal supplier results: 2014 through March 2016	401
Table 10-34 RegD self-scheduled regulation by month, October 2012 through March 2016	402
Table 10-35 Regulation sources: spot market, self-scheduled, bilateral purchases: January 2014 through March 2016	403
Table 10-36 Regulation sources by year: 2011 through 2016	403
Table 10-37 PJM regulation market monthly weighted average market-clearing price, marginal unit opportunity cost and offer price from five minute market solution data (Dollars per MW): January through March 2016	405
Table 10-38 Total regulation charges: January 2015 through March 2016	405
Table 10-39 Components of regulation cost: January through March, 2016	406
Table 10-40 Comparison of average price and cost for PJM Regulation, January through March 2011 through 2016	406
Table 10-41 Black start revenue requirement charges: 2010 through 2016	408
Table 10-42 Black start zonal charges for network transmission use: 2015 and 2016	408
Table 10-43 Black start zonal revenue requirement estimate: 2016/2017 through 2018/2019 delivery years	409
Table 10-44 Reactive zonal charges for network transmission use: 2015 and 2016	410

<b>SECTION 11 Congestion and Marginal Losses</b>	<b>411</b>
Table 11-1 PJM real-time, load-weighted average LMP components (Dollars per MWh): January through March of 2009 through 2016	414
Table 11-2 PJM day-ahead, load-weighted average LMP components (Dollars per MWh): January through March of 2009 through 2016	415
Table 11-3 Zonal and PJM real-time, load-weighted average LMP components (Dollars per MWh): January through March of 2015 and 2016	415
Table 11-4 Zonal and PJM day-ahead, load-weighted average LMP components (Dollars per MWh): January through March of 2015 and 2016	416
Table 11-5 Hub real-time, load-weighted average LMP components (Dollars per MWh): January through March of 2015 and 2016	417
Table 11-6 Hub day-ahead, load-weighted average LMP components (Dollars per MWh): January through March of 2015 and 2016	417
Table 11-7 Total PJM costs by component (Dollars (Millions)): January through March of 2009 through 2016	418
Table 11-8 Total PJM congestion (Dollars (Millions)): January through March of 2008 through 2016	420
Table 11-9 Total PJM congestion costs by accounting category by market (Dollars (Millions)): January through March of 2008 through 2016	420
Table 11-10 Total PJM congestion costs by transaction type by market (Dollars (Millions)): January through March of 2016	421
Table 11-11 Total PJM congestion costs by transaction type by market (Dollars (Millions)): January through March of 2015	421
Table 11-12 Total PJM congestion costs by transaction type by market: January through March of 2015 to 2016 change (Dollars (Millions))	422
Table 11-13 Monthly PJM congestion costs by market (Dollars (Millions)): January through March of 2015 and 2016	422

Table 11-14 Monthly PJM congestion costs by virtual transaction type and by market (Dollars (Millions)): January through March of 2016	423	Table 11-29 Top two congestion cost impacts from NYISO flowgates affecting PJM dispatch (By facility): January through March of 2015	435
Table 11-15 Monthly PJM congestion costs by virtual transaction type and by market (Dollars (Millions)): January through March of 2015	423	Table 11-30 Regional constraints summary (By facility): January through March of 2016	435
Table 11-16 Congestion summary (By facility type): January through March of 2016	425	Table 11-31 Regional constraints summary (By facility): January through March of 2015	435
Table 11-17 Congestion summary (By facility type): January through March of 2015	425	Table 11-32 Congestion cost by type of participant: January through March of 2016	436
Table 11-18 Congestion event hours (Day-Ahead against Real-Time): January through March of 2015 and 2016	426	Table 11-33 Congestion cost by type of participant: January through March of 2015	436
Table 11-20 Congestion summary (By facility voltage): January through March of 2016	426	Table 11-34 Total component costs (Dollars (Millions)): January through March of 2009 through 2016	439
Table 11-19 Congestion event hours (Real-Time against Day-Ahead): January through March of 2015 and 2016	426	Table 11-35 Total PJM marginal loss costs by accounting category (Dollars (Millions)): January through March 2009 through 2016	439
Table 11-21 Congestion summary (By facility voltage): January through March of 2015	427	Table 11-36 Total PJM marginal loss costs by accounting category by market (Dollars (Millions)): January through March 2009 through 2016	440
Table 11-22 Top 25 constraints with frequent occurrence: January through March of 2015 and 2016	428	Table 11-37 Total PJM loss costs by transaction type by market (Dollars (Millions)): January through March 2016	440
Table 11-23 Top 25 constraints with largest year-to-year change in occurrence: January through March of 2015 and 2016	429	Table 11-38 Total PJM loss costs by transaction type by market (Dollars (Millions)): January through March 2015	441
Table 11-24 Top 25 constraints affecting PJM congestion costs (By facility): January through March of 2016	430	Table 11-39 Monthly marginal loss costs by market (Millions): January through March of 2015 and 2016	441
Table 11-25 Top 25 constraints affecting PJM congestion costs (By facility): January through March of 2015	431	Table 11-40 Monthly PJM loss costs by virtual transaction type and by market (Dollars (Millions)): January through March 2016	442
Table 11-26 Top 20 congestion cost impacts from MISO flowgates affecting PJM dispatch (By facility): January through March of 2016	433	Table 11-41 Monthly PJM loss costs by virtual transaction type and by market (Dollars (Millions)): January through March 2015	442
Table 11-27 Top 20 congestion cost impacts from MISO flowgates affecting PJM dispatch (By facility): January through March of 2015	434	Table 11-42 Marginal loss credits (Dollars (Millions)): January through March 2009 through 2016	443
Table 11-28 Top two congestion cost impacts from NYISO flowgates affecting PJM dispatch (By facility): January through March of 2016	435	Table 11-43 Total PJM costs by energy component (Dollars (Millions)): January through March 2009 through 2016	443
		Table 11-44 Total PJM energy costs by accounting category (Dollars (Millions)): January through March 2009 through 2016	443

Table 11-45 Total PJM energy costs by market category (Dollars (Millions)): January through March 2009 through 2016	444	Table 12-13 Expected capacity (MW) in five years: as of March 31, 2016	459
Table 11-46 Total PJM energy costs by transaction type by market (Dollars (Millions)): January through March 2016	444	Table 12-14 PJM generation planning process	460
Table 11-47 Total PJM energy costs by transaction type by market (Dollars (Millions)): January through March 2015	445	Table 12-15 Last milestone completed at time of withdrawal: January 1, 1997 through March 31, 2016	461
Table 11-48 Monthly energy costs by market type (Dollars (Millions)): January through March 2015 and 2016	445	Table 12-16 Completed (withdrawn or in service) queue MW: January 1, 1997 through March 31, 2016	461
Table 11-49 Monthly PJM energy costs by virtual transaction type and by market (Dollars (Millions)): January through March 2016	446	Table 12-17 Average project queue times (days): At March 31, 2016	461
Table 11-50 Monthly PJM energy costs by virtual transaction type and by market (Dollars (Millions)): January through March 2015	446	Table 12-18 PJM generation planning summary: At March 31, 2016	461
<b>SECTION 12 Generation and Transmission Planning</b>	<b>447</b>	Table 12-19 Number of projects entered in the queue as of March 31, 2016	462
Table 12-1 Year-to-year capacity additions from PJM generation queue: Calendar years 2000 through March 31, 2016	451	Table 12-20 Queue details by fuel group: At March 31, 2016	462
Table 12-2 Queue comparison by expected completion year (MW): December 31, 2015 vs. March 31, 2016	451	Table 12-21 Status of all generation queue projects: January 1, 1997 through March 31, 2016	463
Table 12-3 Change in project status (MW): December 31, 2015 vs. March 31, 2016	452	Table 12-22 Status of all generation queue projects as percent of total projects by classification: January 1, 1997 through March 31, 2016	463
Table 12-4 Capacity in PJM queues (MW): At March 31, 2016	452	Table 12-23 Status of all generation capacity (MW) in the PJM generation queue: January 1, 1997 through March 31, 2016	464
Table 12-5 Queue capacity by LDA, control zone and fuel (MW): At March 31, 2016	453	Table 12-24 Status of all generation queue projects as percent of total MW in project classification: January 1, 1997 through March 31, 2016	464
Table 12-6 Summary of PJM unit retirements by fuel (MW): 2011 through 2020	454	Table 12-25 Status of all natural gas generation queue projects: January 1, 1997 through March 31, 2016	465
Table 12-7 Planned retirement of PJM units: as of March 31, 2016	456	Table 12-26 Status of all natural gas generation capacity (MW) in the PJM generation queue: January 1, 1997 through March 31, 2016	465
Table 12-8 Retirements by fuel type: 2011 through 2020	456	Table 12-27 Status of all wind generation queue projects: January 1, 1997 through March 31, 2016	466
Table 12-9 Retirements (MW) by fuel type and state: 2011 through 2020	456	Table 12-28 Status of all wind generation capacity (MW) in the PJM generation queue: January 1, 1997 through March 31, 2016	466
Table 12-10 Unit deactivations in 2016	457	Table 12-29 Status of all solar generation queue projects: January 1, 1997 through March 31, 2016	467
Table 12-11 Existing PJM capacity: At March 31, 2016 (By zone and unit type (MW))	457		
Table 12-12 PJM capacity (MW) by age (years): At March 31, 2016	458		

Table 12-30 Current status of all solar generation capacity (MW) in the PJM generation queue: January 1, 1997 through March 31, 2016	468	Table 12-46 Transmission facility outage requests by received status and processed status: Planning periods 2014 to 2015 and 2015 to 2016	480
Table 12-31 Summary of project developer relationship to TO parent company	469	Table 12-47 Transmission facility outage requests by received status, processed status, emergency and congestion: Planning periods 2014 to 2015 and 2015 to 2016	481
Table 12-32 Developer-transmission owner relationship by fuel type	470	Table 12-48 Transmission facility outage requests by received status and bidding opening date: Planning periods 2014 to 2015 and 2015 to 2016	482
Table 12-33 Transmission facility outage request summary by planned duration: January through March of 2015 and 2016	474	Table 12-49 Late transmission facility outage requests that are submitted after annual bidding opening date: Planning periods 2014 to 2015 and 2015 to 2016	482
Table 12-34 PJM transmission facility outage request received status definition	474	Table 12-50 Transmission facility outage request instance summary by congestion and emergency: January through March of 2015 and 2016	483
Table 12-35 Transmission facility outage request summary by received status: January through March of 2015 and 2016	475	Table 12-51 Late transmission facility outage request instance status summary by congestion and emergency: January through March of 2015 and 2016	483
Table 12-36 Transmission facility outage request summary by emergency: January through March of 2015 and 2016	475	Table 12-52 Transmission facility outage request instances submitted, cancelled or revised late for the Day-ahead Market summary by transmission owner/zone: January through March of 2015 and 2016	483
Table 12-37 Transmission facility outage request summary by congestion: January through March of 2015 and 2016	475		
Table 12-38 Transmission facility outage requests that by received status, congestion and emergency: January through March of 2015 and 2016	476	<b>SECTION 13 Financial Transmission and Auction Revenue Rights</b>	<b>485</b>
Table 12-39 Transmission facility outage requests that might cause congestion status summary: January through March of 2015 and 2016	476	Table 13-1 The FTR Auction Markets results were competitive	486
Table 12-40 Rescheduled and cancelled transmission outage request summary: January through March of 2015 and 2016	477	Table 13-2 Annual FTR product dates	488
Table 12-41 Transmission outage summary: January through March of 2015 and 2016	478	Table 13-3 Historic Stage 1B and Stage 2 ARR Allocations from the 2011 to 2012 through 2015 to 2016 planning periods	495
Table 12-42 Summary of potentially long duration (> 30 days) outages: January through March of 2015 and 2016	478	Table 13-4 ARRs and ARR revenue automatically reassigned for network load changes by control zone: June 1, 2014, through March 31, 2016	496
Table 12-43 Transmission facility outage requests by received status: Planning periods 2014 to 2015 and 2015 to 2016	478		
Table 12-44 Transmission facility outage requests by received status and emergency: Planning periods 2014 to 2015 and 2015 to 2016	479		
Table 12-45 Transmission facility outage requests by submission status and congestion: Planning periods 2014 to 2015 and 2015 to 2016	479		

Table 13-5 Incremental ARR allocation volume: Planning periods 2008 to 2009 through 2015 to 2016	496	Table 13-23 Example of FTR payouts from portfolio netting and without portfolio netting	515
Table 13-6 IARRs allocated for the 2015 to 2016 Annual ARR Allocation for RTEP upgrades	496	Table 13-24 Monthly positive and negative target allocations and payout ratios with and without hourly netting: Planning period 2014 to 2015 and 2015 to 2016	516
Table 13-7 Residual ARR allocation volume and target allocation: 2016	497	Table 13-25 Change in positive target allocation payout ratio given portfolio construction	517
Table 13-8 Projected ARR revenue adequacy (Dollars (Millions)): Planning periods 2014 to 2015 and 2015 to 2016	498	Table 13-26 Nodal day-ahead CLMPs	518
Table 13-9 Monthly Balance of Planning Period FTR Auction patterns of ownership by FTR direction: 2016	502	Table 13-27 Mathematically equivalent FTR payments with and without portfolio netting	518
Table 13-10 Daily FTR net position ownership by FTR direction: 2016	503	Table 13-28 Example implementation of counter flow adjustment method	519
Table 13-11 Monthly Balance of Planning Period FTR Auction market volume: 2016	503	Table 13-29 Counter flow FTR payout ratio adjustment impacts: Planning period 2014 to 2015 and 2015 to 2016	520
Table 13-12 Monthly Balance of Planning Period FTR Auction buy-bid, bid and cleared volume (MW per period): 2016	504	Table 13-30 ARR and FTR total congestion offset (in millions) for ARR holders: Planning periods 2014 to 2015 and 2015 to 2016	521
Table 13-13 Secondary bilateral FTR market volume: Planning periods 2014 to 2015 and 2015 to 2016	505		
Table 13-14 Monthly Balance of Planning Period FTR Auction cleared, weighted-average, buy-bid price per period (Dollars per MW): January through March 2016	506		
Table 13-15 FTR profits by organization type and FTR direction: 2016	506		
Table 13-16 Monthly FTR profits by organization type: 2016	506		
Table 13-17 Monthly Balance of Planning Period FTR Auction revenue: 2016	507		
Table 13-18 Total annual PJM FTR revenue detail (Dollars (Millions)): Planning periods 2014 to 2015 and 2015 to 2016	510		
Table 13-19 Monthly FTR accounting summary (Dollars (Millions)): Planning period 2014 to 2015 and 2015 to 2016	511		
Table 13-20 PJM reported FTR payout ratio by planning period	512		
Table 13-21 End of planning period FTR uplift charge example	513		
Table 13-22 PJM Reported and Actual Monthly Payout Ratios: Planning period 2015 to 2016	514		

## Introduction

### 2016 Q1 in Review

The results of the energy market, the results of the capacity market and the results of the regulation market were competitive in the first three months of 2016. The PJM markets work. The PJM markets bring customers the benefits of competition. The goal of competition is to provide customers wholesale power at the lowest possible price, but no lower.

The PJM market design must be robust to stress. Markets that only work under normal conditions are not effective markets. Continued success requires markets that are flexible and adaptive. However, wholesale power markets are defined by complex rules. Markets do not automatically provide competitive and efficient outcomes. Despite the complex rules, these are markets and not administrative constructs, and have all the potential efficiency benefits of markets. There are areas of market design that need further improvement in order to ensure that the PJM markets continue to adapt successfully to changing conditions. The details of market design matter.

Competitive markets were introduced as an alternative form of regulation to ensure that wholesale power is provided at the lowest possible price. The PJM market design does not incorporate a laissez faire approach. The PJM market remains regulated. The PJM market design incorporates a variety of rules designed to help ensure competitive outcomes. When basic elements of those rules are modified, e.g. the raising of the overall \$1,000 per MWh offer cap and the introduction of hourly offers in place of daily offers, it is essential that effective market power mitigation be maintained. While the three pivotal supplier test addresses local market power associated with transmission constrained markets, it does not address aggregate market power. Aggregate market power exists when generation owners have the ability to raise market prices above competitive levels in the absence of transmission constraints, for example when demand is high and market conditions are tight. A direct and effective substitute for the current market power mitigation rule limiting units to one offer per day would be to limit any hourly offer changes during the

day to changes in the cost of fuel. The failure to maintain limits on aggregate market power will lead to the exercise of market power and the associated negative impacts on the competitiveness of PJM markets.

The overall energy market results support the conclusion that energy prices in PJM are set, generally, by marginal units offering at, or close to, their short run marginal costs, although this is not always the case during high demand hours. This is evidence of generally competitive behavior, although the behavior of some participants during the high demand periods in 2014 and 2015 raises concerns about economic withholding. The performance of the PJM markets under high load conditions raised a number of concerns related to capacity market incentives, participant offer behavior in the energy market under tight market conditions, natural gas availability and pricing, demand response and interchange transactions. In particular, there are issues related to aggregate market power, or the ability to increase markups substantially in tight market conditions, to the uncertainties about the pricing and availability of natural gas, and to the lack of adequate incentives for unit owners to take all necessary actions to acquire fuel and generate power rather than take an outage.

One of the benefits of competitive power markets is that changes in input prices and changes in the balance of supply and demand are reflected immediately in energy prices. The load-weighted average real-time LMP was 47.4 percent lower in the first three months of 2016 than in the first three months of 2015, \$26.80 per MWh versus \$50.91 per MWh. PJM real-time monthly load-weighted average LMP in March 2016 was \$22.90, which is the lowest real-time monthly load-weighted average LMP since February 2002. Energy prices were lower as a combined result of lower fuel prices and lower demand. If fuel and emission costs in the first three months of 2016 had been the same as in the first three months of 2015, holding everything else constant, the load-weighted LMP would have been higher, \$34.85 per MWh instead of the observed \$26.80 per MWh.

The markup conduct of individual owners and units has an identifiable impact on market prices. In the Real-Time Energy Market, the adjusted markup

component of LMP decreased from \$3.54 in the first three months of 2015 to \$0.46 in the first three months of 2016. The adjusted markup decreased from 7.0 percent of real-time load-weighted average LMP in the first three months of 2015 to 1.7 percent in the first three months of 2016. Participant behavior was evaluated as competitive because marginal units generally made offers at, or close to, their short run marginal costs. But the markup results for high demand periods in 2014 and 2015 are a reminder that aggregate market power remains an issue when market conditions are tight and that market design choices must account for the potential to exercise aggregate market power. There are also generation owners who routinely include high markups in price based offers on some units. These markups do not affect prices under normal conditions.

The three pivotal supplier (TPS) test is applied by PJM on an ongoing basis for local energy markets in order to determine whether offer capping is required for transmission constraints. The TPS test is a flexible, targeted real-time measure of market structure which replaced the prior approach of offer capping all units required to relieve a constraint. But there are some issues with the application of mitigation when market sellers fail the TPS test. There is no tariff or manual language that defines in detail the application of the TPS test and mitigation in the Day-Ahead Energy Market and the Real-Time Energy Market. In both the Day-Ahead and Real-Time Energy Markets, generators have the ability to avoid mitigation by using varying markups in their price-based offers, offering different operating parameters in their price-based and cost-based offers, and using different fuels in their price-based and cost-based offers. These issues with mitigation can and should be resolved by simple rule changes requiring that markup be constant across price and cost offers, that there be at least one cost-based offer using the same fuel as the available price-based offer, that the price-MW pairs in the price based PLS offer be exactly equal to the price based non PLS offer, and requiring cost-based and price-based PLS offers to be at least as flexible as price-based non-PLS offers. The significance of implementing these rule changes is substantially increased with the introduction of hourly offers.

Net revenue is a key measure of overall market performance as well as a measure of the incentive to invest in new generation to serve PJM markets. Net revenues are significantly affected by fuel prices, energy prices and capacity prices. Coal and natural gas prices and energy prices were lower in the first three months of 2016 than in the first three months of 2015. Net revenues from the energy market for all plant types were affected by the lower prices.

In the first three months of 2016, average energy market net revenues decreased from the first three months of 2015 by 62 percent for a new combustion turbine, 51 percent for a new combined cycle unit, 82 percent for a new coal plant, 85 percent for a new diesel unit, 56 percent for a new nuclear plant, 38 percent for a new wind installation, and 62 percent for a new solar installation.

Particularly in times of stress on markets and when some flaws in markets are revealed, non-market solutions may appear attractive. Top down, integrated resource planning approaches are tempting because it is easy to think that experts know exactly the right mix and location of generation resources and the appropriate definition of resource diversity and therefore which technologies should be favored through exceptions to market rules. The provision of subsidies to favored technologies, whether solar, wind, coal or nuclear, is tempting for those who would benefit, but subsidies are a form of integrated resource planning that is not consistent with markets. Subsidies to existing units are no different in concept than subsidies to planned units and are equally inconsistent with markets. Cost of service regulation is tempting because guaranteed rates of return and fixed prices may look attractive to asset owners in uncertain markets and because cost of service regulation incorporates integrated resource planning.

But the market paradigm and the quasi-market paradigm are mutually exclusive. Once the decision is made that market outcomes must be fundamentally modified, it will be virtually impossible to return to markets. While there are entities in the PJM markets that continue to operate under the quasi-market paradigm, they have made a long term decision on a regulatory model and the PJM rules generally limit any associated, potential negative impacts on

markets. That consistent approach to the regulatory model is very different from current attempts to subsidize specific uneconomic market assets using various planning concepts as a rationale. The subsidy model is inconsistent with the PJM market design and inconsistent with the market paradigm and constitutes a significant threat to both.

Much of the reason that market outcomes are subject to legitimate criticism is that the markets have not been permitted to reveal the underlying supply and demand fundamentals in prices. Before market outcomes are rejected in favor of non-market choices, markets should be permitted to work. It is more critical than ever to get capacity market prices correct. A number of capacity market design elements resulted in a substantial suppression of capacity market prices for multiple years.

These market design choices have substantial impacts. Capacity prices that were suppressed substantially below the level consistent with supply and demand fundamentals affected some participants' long term decisions and led some market participants to seek subsidies. PJM has addressed the fundamental issues of the capacity market design in its Capacity Performance design, including price formation, product definition and performance incentives.

The price of energy must also reflect supply and demand fundamentals. While the rules on gas procurement and the inclusion of gas costs in energy market offers need clarification, cost-based offer caps should be increased to ensure that offer caps reflect actual short run marginal costs, even when those marginal costs are well in excess of \$1,000 per MWh. But when cost based offers are greater than \$1,000 per MWh, price based offers should not exceed cost based offers and cost based offers should not include a ten percent adder. Generators should have the ability to reflect gas cost changes in energy offers during the day in order to permit the energy market to reflect the current cost of gas. But offer changes should be based only on verifiable changes in gas cost and therefore not permit the exercise of market power. PJM's reserve requirements should reflect dispatchers' actual need for reserves to maintain reliability and those reserve requirements should be reflected in prices and should trigger scarcity pricing when they are not met. Better energy

market pricing will help reduce uplift and a broader allocation of uplift to all participants, including UTCs, will help reduce uplift to the level of noise rather than the significant friction on markets that it is today.

Load pays for the transmission system and contributes all congestion revenues. For that reason, FTRs and later ARR were intended to return congestion revenues to load. The annual ARR allocation should be designed to return congestion revenues to load, without requiring contract path physical transmission rights that are difficult or impossible to define and enforce in LMP markets. The current ARR/FTR design does not serve as an efficient or effective way to ensure that load receives all the congestion revenues or has the ability to receive the auction revenues associated with all the potential congestion revenues.

In recent planning years, ARRs did not serve as an effective way to return congestion revenues to load. Total ARR and self scheduled FTR revenues offset only 44.7 percent of total congestion costs for the 2013 to 2014 planning period and 63.8 percent for the 2014 to 2015 planning period. In the first ten months of the 2015 to 2016 planning period, total ARR and self scheduled FTR revenues offset 83.6 percent of total congestion costs.

If the original PJM FTR design had simply been designed to return congestion revenues to load, many of the subsequent issues with the FTR design would have been avoided. Now is a good time to address the issues of the FTR design and to return the design to its original purpose. This would eliminate much of the complexity associated with ARRs and FTRs and eliminate unnecessary controversy about the appropriate recipients of congestion revenues.

On January 25, 2016, the U.S. Supreme Court voted 6-2 to reverse the decision of the lower court in the EPSA case. The Supreme Court's decision was about jurisdiction over demand side resources and not about the substance of Order 745. In resolving the uncertainty about jurisdiction, the decision creates an opportunity to rethink the ways in which demand side resources can most effectively participate in wholesale power markets based on market principles. The Commission has the clear authority to modify or reverse Order 745.

The long term appropriate end state for demand resources in the PJM markets should be comparable to the demand side of any market. Rather than demand response programs, with their complex and difficult to administer rules, customers would be able to avoid capacity and energy charges by not using capacity and energy at their discretion. Customers should use energy as they wish and that usage will determine the amount of capacity and energy for which each customer pays. There is no need for counterfactual and inaccurate measurement and verification.

Under this approach, customers that wish to avoid capacity payments would reduce their load during expected high load hours. Capacity costs would be assigned to customers based on actual load on the system during these hours. Customers that wish to avoid high energy prices would reduce their load during high price hours. Customers would pay for what they actually use, as measured by meters, rather than relying on flawed measurement and verification methods.

This approach provides more flexibility to customers to limit usage at their discretion. There is no requirement to be available year round or every hour of every day. There is no 30 minute notice requirement. There is no requirement to offer energy into the day-ahead market. All decisions about interrupting are up to the customers only and they may enter into bilateral commercial arrangements with CSPs at their discretion. Customers would pay for capacity and energy depending solely on metered load.

The PJM markets and PJM market participants from all sectors face significant challenges. PJM and its market participants will need to continue to work constructively to address these challenges to ensure the continued effectiveness of PJM markets.

## PJM Market Summary Statistics

Table 1-1 shows selected summary statistics describing PJM markets.

**Table 1-1 PJM Market Summary Statistics, January through March, 2015 and 2016<sup>1</sup>**

	Jan - Mar, 2015	Jan - Mar, 2016	Percent Change
Load	211,444 GWh	194,990 GWh	(7.8%)
Generation	213,119 GWh	195,328 GWh	(8.3%)
Net Actual Interchange	5,502 GWh	6,564 GWh	19%
Losses	5,127 GWh	3,879 GWh	(24.3%)
Regulation Requirement*	664 MW	664 MW	0.0%
RTO Primary Reserve Requirement	2,175 MW	2,175 MW	0.0%
Total Billing	\$14.04 Billion	\$9.50 Billion	(32.3%)
Peak	Feb 20, 2015 7:00	Jan 19, 2016 7:00	
Peak Load	143,086 MW	129,876 MW	(9.2%)
Load Factor	0.69	0.70	0.5%
Installed Capacity	As of 3/31/2015	As of 3/31/2016	
Installed Capacity	183,792 MW	178,492 MW	(2.9%)

\* This is an hourly average stated in effective MW.

## PJM Market Background

The PJM Interconnection, L.L.C. (PJM) operates a centrally dispatched, competitive wholesale electric power market that, as of March 31, 2016, had installed generating capacity of 178,492 megawatts (MW) and 961 members including market buyers, sellers and traders of electricity in a region including more than 61 million people in all or parts of Delaware, Illinois, Indiana, Kentucky, Maryland, Michigan, New Jersey, North Carolina, Ohio, Pennsylvania, Tennessee, Virginia, West Virginia and the District of Columbia (Figure 1-1).<sup>2 3 4</sup>

As part of the market operator function, PJM coordinates and directs the operation of the transmission grid and plans transmission expansion improvements to maintain grid reliability in this region.


<sup>1</sup> The load reported in this table is the accounting load plus net withdrawals at generator buses. The average hourly accounting load is reported in Section 3, "Energy Market."

<sup>2</sup> See PJM's "Member List," which can be accessed at: <<http://pjm.com/about-pjm/member-services/member-list.aspx>>.

<sup>3</sup> See PJM's "Who We Are," which can be accessed at: <<http://pjm.com/about-pjm/who-we-are.aspx>>.


<sup>4</sup> See the 2015 State of the Market Report for PJM, Volume II, Appendix A, "PJM Geography" for maps showing the PJM footprint and its evolution prior to 2015.

Figure 1-1 PJM's footprint and its 20 control zones

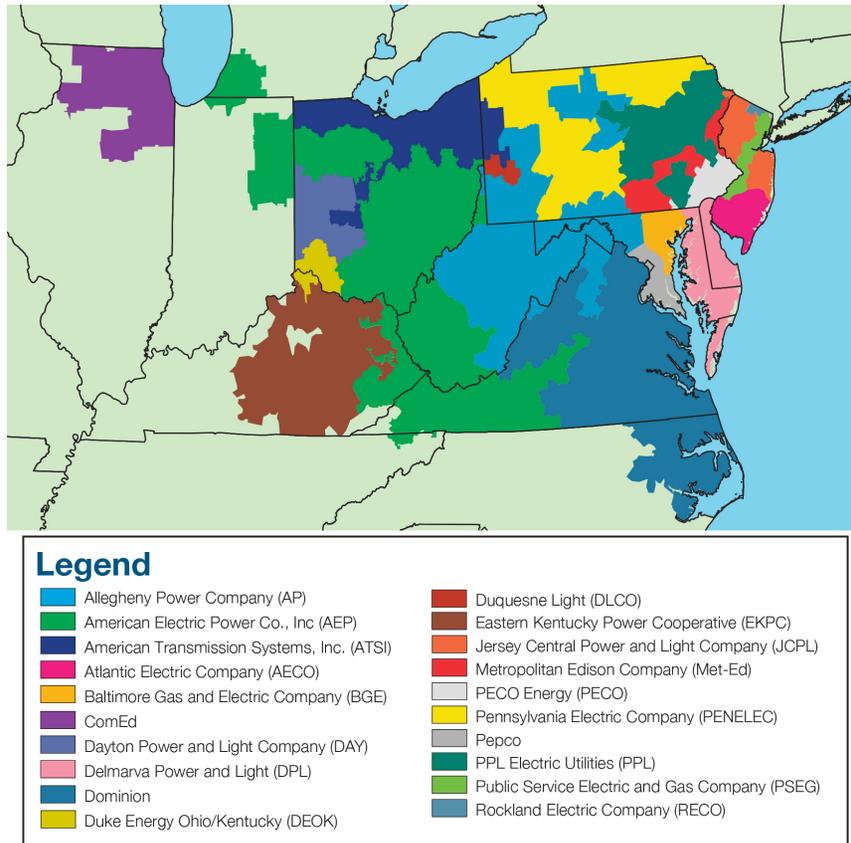

In the first three months of 2016, PJM had total billings of \$9.50 billion, down 32 percent from \$14.04 billion in the first three months of 2015 (Figure 1-2).<sup>5</sup>

Figure 1-2 PJM reported monthly billings (\$ Billion): 2008 through March, 2016

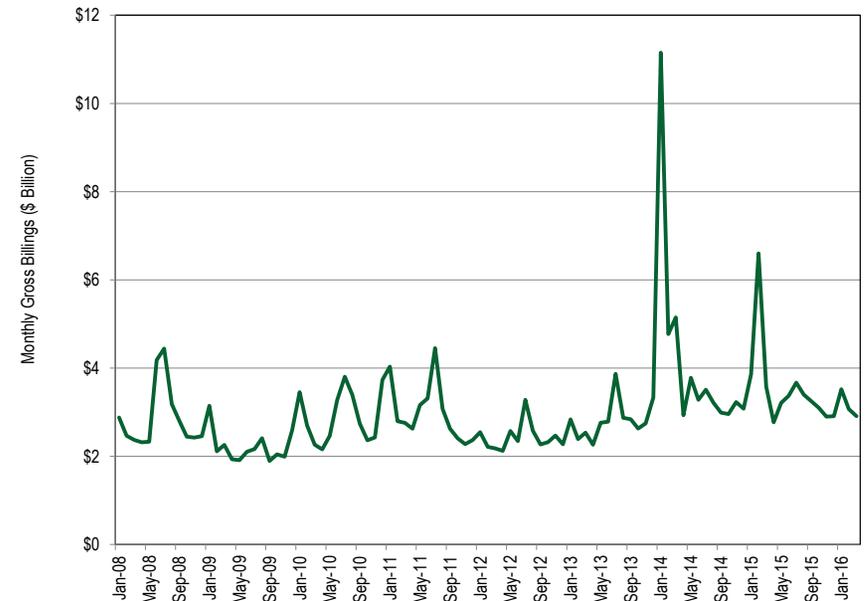

PJM operates the Day-Ahead Energy Market, the Real-Time Energy Market, the Reliability Pricing Model (RPM) Capacity Market, the Regulation Market, the Synchronized Reserve Market, the Day-Ahead Scheduling Reserve (DASR) Market and the Financial Transmission Rights (FTRs) Markets.

PJM introduced energy pricing with cost-based offers and market-clearing nodal prices on April 1, 1998, and market-clearing nodal prices with market-based offers on April 1, 1999. PJM introduced the Daily Capacity Market on January 1, 1999, and the Monthly and Multimonthly Capacity Markets for the January through May 1999 period. PJM implemented FTRs on May 1, 1999.

<sup>5</sup> Monthly billing values are provided by PJM.

PJM implemented the Day-Ahead Energy Market and the Regulation Market on June 1, 2000. PJM modified the Regulation Market design and added a market in Synchronized Reserve on December 1, 2002. PJM introduced an Auction Revenue Rights (ARR) allocation process and an associated Annual FTR Auction effective June 1, 2003. PJM introduced the RPM Capacity Market effective June 1, 2007. PJM implemented the DASR Market on June 1, 2008.<sup>6,7</sup> PJM introduced the Capacity Performance capacity market design effective on August 10, 2015, with the Base Residual Auction for 2018/2019.

## Conclusions

This report assesses the competitiveness of the markets managed by PJM in the first three months of 2016, including market structure, participant behavior and market performance. This report was prepared by and represents the analysis of the Independent Market Monitor for PJM, also referred to as the Market Monitoring Unit or MMU.

For each PJM market, the market structure is evaluated as competitive or not competitive, and participant behavior is evaluated as competitive or not competitive. Most important, the outcome of each market, market performance, is evaluated as competitive or not competitive.

The MMU also evaluates the market design for each market. The market design serves as the vehicle for translating participant behavior within the market structure into market performance. This report evaluates the effectiveness of the market design of each PJM market in providing market performance consistent with competitive results.

Market structure refers to the ownership structure of the market. The three pivotal supplier (TPS) test is the most relevant measure of market structure because it accounts for both the ownership of assets and the relationship

<sup>6</sup> See also the *2015 State of the Market Report for PJM*, Volume II, Appendix B, "PJM Market Milestones."

<sup>7</sup> Analysis of 2016 market results requires comparison to prior years. During calendar years 2004 and 2005, PJM conducted the phased integration of five control zones: ComEd, American Electric Power (AEP), The Dayton Power & Light Company (DAY), Duquesne Light Company (DLCO) and Dominion. In June 2011, the American Transmission Systems, Inc. (ATS) Control Zone joined PJM. In January 2012, the Duke Energy Ohio/Kentucky Control Zone joined PJM. In June 2013, the Eastern Kentucky Power Cooperative (EKPC) joined PJM. By convention, control zones bear the name of a large utility service provider working within their boundaries. The nomenclature applies to the geographic area, not to any single company. For additional information on the integrations, their timing and their impact on the footprint of the PJM service territory prior to 2015, see *2014 State of the Market Report for PJM*, Volume II, Appendix A, "PJM Geography."

between the pattern of ownership among multiple entities and the market demand using actual market conditions with both temporal and geographic granularity. Market shares and the related Herfindahl-Hirschman Index (HHI) are also measures of market structure.

Participant behavior refers to the actions of individual market participants, also sometimes referred to as participant conduct.

Market performance refers to the outcome of the market. Market performance reflects the behavior of market participants within a market structure, mediated by market design.

Market design means the rules under which the entire relevant market operates, including the software that implements the market rules. Market rules include the definition of the product, the definition of short run marginal cost, rules governing offer behavior, market power mitigation rules, and the definition of demand. Market design is characterized as effective, mixed or flawed. An effective market design provides incentives for competitive behavior and permits competitive outcomes. A mixed market design has significant issues that constrain the potential for competitive behavior to result in competitive market outcomes, and does not have adequate rules to mitigate market power or incent competitive behavior. A flawed market design produces inefficient outcomes which cannot be corrected by competitive behavior.

The MMU concludes for the first three months of 2016:

**Table 1-2 The Energy Market results were competitive**

Market Element	Evaluation	Market Design
Market Structure: Aggregate Market	Competitive	
Market Structure: Local Market	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Effective

- The aggregate market structure was evaluated as competitive because the calculations for hourly HHI (Herfindahl-Hirschman Index) indicate that by the FERC standards, the PJM Energy Market in the first three months of 2016 was moderately concentrated. Average HHI was 1300 with a minimum of 1133 and a maximum of 1561 in the first three months of 2016. The fact that the average HHI was in the moderately concentrated range does not mean that the aggregate market was competitive in all hours. The PJM Energy Market intermediate and peaking segments of supply were highly concentrated.
- The local market structure was evaluated as not competitive due to the highly concentrated ownership of supply in local markets created by transmission constraints. The results of the three pivotal supplier (TPS) test, used to test local market structure, indicate the existence of market power in local markets created by transmission constraints. The local market performance is competitive as a result of the application of the TPS test. While transmission constraints create the potential for the exercise of local market power, PJM's application of the three pivotal supplier test identified local market power and resulted in offer capping to force competitive offers, correcting for structural issues created by local transmission constraints. There are, however, identified issues with the application of market power mitigation to resources whose owners fail the TPS test that need to be addressed.
- Participant behavior was evaluated as competitive because the analysis of markup shows that marginal units generally make offers at, or close to, their marginal costs in both Day-Ahead and Real-Time Energy Markets, although the behavior of some participants both routinely and during periods of high demand is consistent with economic withholding.
- Market performance was evaluated as competitive because market results in the energy market reflect the outcome of a competitive market, as PJM prices are set, on average, by marginal units operating at, or close to, their marginal costs in both Day-Ahead and Real-Time Energy Markets, although high markups during periods of high demand did affect prices.
- Market design was evaluated as effective because the analysis shows that the PJM energy market resulted in competitive market outcomes. In general, PJM's energy market design provides incentives for competitive behavior and results in competitive outcomes. In local markets, where market power is an issue, the market design identifies market power and causes the market to provide competitive market outcomes. The role of UTCs in the Day-Ahead Energy Market continues to cause concerns.

PJM markets are designed to promote competitive outcomes derived from the interaction of supply and demand in each of the PJM markets. Market design itself is the primary means of achieving and promoting competitive outcomes in PJM markets. One of the MMU's primary goals is to identify actual or potential market design flaws.<sup>8</sup> The approach to market power mitigation in PJM has focused on market designs that promote competition (a structural basis for competitive outcomes) and on limiting market power mitigation to instances where the market structure is not competitive and thus where market design alone cannot mitigate market power. In the PJM energy market, this occurs primarily in the case of local market power. When a transmission constraint creates the potential for local market power, PJM applies a structural test to determine if the local market is competitive, applies a behavioral test to determine if generator offers exceed competitive levels and applies a market performance test to determine if such generator offers would affect the market price.<sup>9</sup> There are, however, identified issues with the application of market power mitigation to resources whose owners fail the TPS test that can result in the exercise of local market power. These issues need to be addressed. There are issues related to the definition of gas costs includable in energy offers that need to be addressed. There are currently no market power mitigation rules in place that limit the ability to exercise market power when aggregate market conditions are tight. If market-based offer caps are raised, or if generators are allowed to modify offers hourly, market design must reflect appropriate incentives for competitive behavior and aggregate market power mitigation rules need to be developed.

<sup>8</sup> PJM. OATT Attachment M (PJM Market Monitoring Plan).

<sup>9</sup> The market performance test means that offer capping is not applied if the offer does not exceed the competitive level and therefore market power would not affect market performance.

**Table 1-3 The Capacity Market results were competitive**

Market Element	Evaluation	Market Design
Market Structure: Aggregate Market	Not Competitive	
Market Structure: Local Market	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Mixed

- The aggregate market structure was evaluated as not competitive. For almost all auctions held from 2007 to the present, the PJM region failed the three pivotal supplier test (TPS), which is conducted at the time of the auction.<sup>10</sup>
- The local market structure was evaluated as not competitive. For almost every auction held, all LDAs have failed the TPS test, which is conducted at the time of the auction.<sup>11</sup>
- Participant behavior was evaluated as competitive. Market power mitigation measures were applied when the Capacity Market Seller failed the market power test for the auction, the submitted sell offer exceeded the defined offer cap, and the submitted sell offer, absent mitigation, would increase the market clearing price. Market power mitigation rules were also applied when the Capacity Market Seller submitted a sell offer for a new resource or uprate that was below the Minimum Offer Price Rule (MOPR) threshold.
- Market performance was evaluated as competitive. Although structural market power exists in the Capacity Market, a competitive outcome resulted from the application of market power mitigation rules.
- Market design was evaluated as mixed because while there are many positive features of the Reliability Pricing Model (RPM) design and the Capacity Performance modifications to RPM, there are several features of the RPM design which still threaten competitive outcomes. These include the definition of DR which permits inferior products to substitute for capacity, the replacement capacity issue, the definition of unit offer parameters and the inclusion of imports which are not substitutes for internal capacity resources.

<sup>10</sup> In the 2008/2009 RPM Third Incremental Auction, 18 participants in the RTO market passed the TPS test.

<sup>11</sup> In the 2012/2013 RPM Base Residual Auction, six participants included in the incremental supply of EMAAC passed the TPS test. In the 2014/2015 RPM Base Residual Auction, seven participants in the incremental supply in MAAC passed the TPS test.

**Table 1-4 The Regulation Market results were competitive**

Market Element	Evaluation	Market Design
Market Structure	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Flawed

- The Regulation Market structure was evaluated as not competitive for the first three months of 2016 because the Regulation Market failed the three pivotal supplier (TPS) test in 90.9 percent of the hours in the first three months of 2016.
- Participant behavior in the Regulation Market was evaluated as competitive for the first three months of 2016 because market power mitigation requires competitive offers when the three pivotal supplier test is failed and there was no evidence of generation owners engaging in anti-competitive behavior.
- Market performance was evaluated as competitive, despite significant issues with the market design.
- Market design was evaluated as flawed. While the design of the Regulation Market was significantly improved with changes introduced October 1, 2012, a number of issues remain. The market design has failed to correctly incorporate a consistent implementation of the marginal benefit factor in optimization, pricing and settlement. The market results continue to include the incorrect definition of opportunity cost.

**Table 1-5 The Tier 2 Synchronized Reserve Markets results were competitive**

Market Element	Evaluation	Market Design
Market Structure: Regional Markets	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Mixed

- The Tier 2 Synchronized Reserve Market structure was evaluated as not competitive because of high levels of supplier concentration.

- Participant behavior was evaluated as competitive because the market rules require competitive, cost based offers, although there is concern about failure to comply with the must offer requirement.
- Market performance was evaluated as competitive because the interaction of participant behavior with the market design results in competitive prices.
- Market design was evaluated as mixed. Market power mitigation rules result in competitive outcomes despite high levels of supplier concentration. However, tier 1 reserves are inappropriately compensated when the non-synchronized reserve market clears with a nonzero price.

**Table 1-6 The Day-Ahead Scheduling Reserve Market results were competitive**

Market Element	Evaluation	Market Design
Market Structure	Competitive	
Participant Behavior	Mixed	
Market Performance	Competitive	Mixed

- The Day-Ahead Scheduling Reserve Market structure was evaluated as competitive because market participants failed the three pivotal supplier test in only 0.9 percent of all cleared hours in the first three months of 2016.
- Participant behavior was evaluated as mixed because while most offers were equal to marginal costs, a significant proportion of offers reflected economic withholding.
- Market performance was evaluated as competitive because there were adequate offers in every hour to satisfy the requirement and the clearing prices reflected those offers, although there is concern about offers above the competitive level affecting prices. Offers above \$0.00 set the clearing price in 90 (4.1 percent) hours.
- Market design was evaluated as mixed because while the market is functioning effectively to provide DASR, the three pivotal supplier test and appropriate market power mitigation should be added to the market to ensure that market power cannot be exercised at times of system stress.

**Table 1-7 The FTR Auction Markets results were competitive**

Market Element	Evaluation	Market Design
Market Structure	Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Flawed

- Market structure was evaluated as competitive because the FTR auction is voluntary and the ownership positions resulted from the distribution of ARRs and voluntary participation.
- Participant behavior was evaluated as competitive because there was no evidence of anti-competitive behavior.
- Market performance was evaluated as competitive because it reflected the interaction between participant demand behavior and FTR supply, limited by PJM's analysis of system feasibility.
- Market design was evaluated as flawed because there are significant flaws with the basic ARR/FTR design which need to be addressed. The market design is not an efficient way to ensure that congestion revenues are returned to load.

## Role of MMU

The FERC assigns three core functions to MMUs: reporting, monitoring and market design.<sup>12</sup> These functions are interrelated and overlap. The PJM Market Monitoring Plan establishes these functions, providing that the MMU is responsible for monitoring: compliance with the PJM Market Rules; actual or potential design flaws in the PJM Market Rules; structural problems in the PJM Markets that may inhibit a robust and competitive market; the actual or potential exercise of market power or violation of the market rules by a Market Participant; PJM's implementation of the PJM Market Rules or operation of the PJM Markets; and such matters as are necessary to prepare reports.<sup>13</sup>

<sup>12</sup> 18 CFR § 35.28(g)(3)(ii); see also *Wholesale Competition in Regions with Organized Electric Markets*, Order No. 719, FERC Stats. & Regs. ¶31,281 (2008) ("Order No. 719"), *order on reh'g*, Order No. 719-A, FERC Stats. & Regs. ¶31,292 (2009), *reh'g denied*, Order No. 719-B, 129 FERC ¶ 61,252 (2009).

<sup>13</sup> OATT Attachment M § IV; 18 CFR § 1c.2.

## Reporting

The MMU performs its reporting function primarily by issuing and filing annual and quarterly state of the market reports; regular reports on market issues; such as RPM auction reports; reports responding to requests from regulators and other authorities; and ad hoc reports on specific topics. The state of the market reports provide a comprehensive analysis of the structure, behavior and performance of PJM markets. State of the market reports and other reports are intended to inform PJM, the PJM Board, FERC, other regulators, other authorities, market participants, stakeholders and the general public about how well PJM markets achieve the competitive outcomes necessary to realize the goals of regulation through competition, and how the markets can be improved.

## Monitoring

To perform its monitoring function, the MMU screens and monitors the conduct of Market Participants under the MMU's broad purview to monitor, investigate, evaluate and report on the PJM Markets.<sup>14</sup> The MMU has direct, confidential access to the FERC.<sup>15</sup> The MMU may also refer matters to the attention of state commissions.<sup>16</sup>

The MMU monitors market behavior for violations of FERC Market Rules.<sup>17</sup> The MMU will investigate and refer "Market Violations," which refers to any of "a tariff violation, violation of a Commission-approved order, rule or regulation, market manipulation, or inappropriate dispatch that creates

substantial concerns regarding unnecessary market inefficiencies..."<sup>18 19 20</sup> The MMU also monitors PJM for compliance with the rules, in addition to market participants.<sup>21</sup>

Another important component of the monitoring function is the review of inputs to mitigation. The actual or potential exercise of market power is addressed in part through *ex ante* mitigation rules incorporated in PJM's market clearing software for the energy market, the capacity market and the regulation market. If a market participant fails the TPS test in any of these markets its offer is set to the lower of its price based or cost based offer. This prevents the exercise of market power and ensures competitive pricing, provided that the cost based offer accurately reflects short run marginal cost. Cost based offers for the energy market and the regulation market are based on incremental costs as defined in the PJM Cost Development Guidelines (PJM Manual 15).<sup>22</sup> The MMU evaluates every offer in each capacity market (RPM) auction using data submitted to the MMU through web-based data input systems developed by the MMU.<sup>23</sup>

The MMU also reviews operational parameter limits included with unit offers, evaluates compliance with the requirement to offer into the energy and capacity markets, evaluates the economic basis for unit retirement requests and evaluates and compares offers in the Day-Ahead and Real-Time Energy Markets.<sup>24 25 26 27</sup>

<sup>14</sup> OATT Attachment M § IV.

<sup>15</sup> OATT Attachment M § IV.K.3.

<sup>16</sup> OATT Attachment M § IV.H.

<sup>17</sup> OATT Attachment M § II(d)&(q) ("FERC Market Rules" mean the market behavior rules and the prohibition against electric energy market manipulation codified by the Commission in its Rules and Regulations at 18 CFR §§ 1c.2 and 35.37, respectively; the Commission-approved PJM Market Rules and any related proscriptions or any successor rules that the Commission from time to time may issue, approve or otherwise establish... "PJM Market Rules" mean the rules, standards, procedures, and practices of the PJM Markets set forth in the PJM Tariff, the PJM Operating Agreement, the PJM Reliability Assurance Agreement, the PJM Consolidated Transmission Owners Agreement, the PJM Manuals, the PJM Regional Practices Document, the PJM-Midwest Independent Transmission System Operator Joint Operating Agreement or any other document setting forth market rules.")

<sup>18</sup> The FERC defines manipulation as engaging "in any act, practice, or course of business that operates or would operate as a fraud or deceit upon any entity." 18 CFR § 1c.2(a)(3). Manipulation may involve behavior that is consistent with the letter of the rules, but violates their spirit. An example is market behavior that is economically meaningless, such as equal and opposite transactions, which may entitle the transacting party to a benefit associated with volume. Unlike market power or rule violations, manipulation must be intentional. The MMU must build its case, including an inference of intent, on the basis of market data.

<sup>19</sup> OATT Attachment M § II(h-1).

<sup>20</sup> The MMU has no prosecutorial or enforcement authority. The MMU notifies the FERC when it identifies a significant market problem or market violation. OATT Attachment M § IV.1.1. If the problem or violation involves a market participant, the MMU discusses the matter with the participant(s) involved and analyzes relevant market data. If that investigation produces sufficient credible evidence of a violation, the MMU prepares a formal referral and thereafter undertakes additional investigation of the specific matter only at the direction of FERC staff. *Id.* If the problem involves an existing or proposed law, rule or practice that exposes PJM markets to the risk that market power or market manipulation could compromise the integrity of the markets, the MMU explains the issue, as appropriate, to the FERC, state regulators, stakeholders or other authorities. The MMU may also participate as a party or provide information or testimony in regulatory or other proceedings.

<sup>21</sup> OATT Attachment M § IV.C.

<sup>22</sup> See OATT Attachment M-Appendix § II.A.

<sup>23</sup> OATT Attachment M-Appendix § II.E.

<sup>24</sup> OATT Attachment M-Appendix § II.B.

<sup>25</sup> OATT Attachment M-Appendix § II.C.

<sup>26</sup> OATT Attachment M-Appendix § IV.

<sup>27</sup> OATT Attachment M-Appendix § VII.

The MMU reviews offers and inputs in order to evaluate whether those offers raise market power concerns.<sup>28</sup> Market participants, not the MMU, determine and take responsibility for offers that they submit and the market conduct that those offers represent.<sup>29</sup> If the MMU has a concern about an offer, the MMU may raise that concern with the FERC or other regulatory authorities. The FERC and other regulators have enforcement and regulatory authority that they may exercise with respect to offers submitted by market participants. PJM also reviews offers, but it does so in order to determine whether offers comply with the PJM tariff and manuals.<sup>30</sup> PJM, in its role as the market operator, may reject an offer that fails to comply with the market rules. The respective reviews performed by the MMU and PJM are separate and non-sequential.

The PJM Markets monitored by the MMU include market related procurement processes conducted by PJM, such as for Black Start resources included in the PJM system restoration plan.<sup>31</sup> <sup>32</sup> With the introduction of competitive transmission development policy in Order No. 1000, a competitive procurement process for including projects in PJM Regional Transmission Expansion Plan is now in place.<sup>33</sup>

## Market Design

In order to perform its role in PJM market design, the MMU evaluates existing and proposed PJM Market Rules and the design of the PJM Markets.<sup>34</sup> The MMU initiates and proposes changes to the design of such markets or the PJM Market Rules in stakeholder or regulatory proceedings.<sup>35</sup> In support of this function, the MMU engages in discussions with stakeholders, State Commissions, PJM Management, and the PJM Board; participates in PJM stakeholder meetings or working groups regarding market design matters; publishes proposals, reports or studies on such market design issues; and makes filings with the Commission on market design issues.<sup>36</sup> The MMU also recommends changes to

<sup>28</sup> OATT Attachment M § IV.

<sup>29</sup> OATT § 12A.

<sup>30</sup> OATT § 12A.

<sup>31</sup> See OATT Attachment M–Appendix § II(p).

<sup>32</sup> See OATT Attachment M–Appendix § III.

<sup>33</sup> OA Schedule 6 § 1.5.

<sup>34</sup> OATT Attachment M § IV.D.

<sup>35</sup> *Id.*

<sup>36</sup> *Id.*

the PJM Market Rules to the staff of the Commission’s Office of Energy Market Regulation, State Commissions, and the PJM Board.<sup>37</sup> The MMU may provide in its annual, quarterly and other reports “recommendations regarding any matter within its purview.”<sup>38</sup>

## New Recommendation

Consistent with its core function to “[e]valuate existing and proposed market rules, tariff provisions and market design elements and recommend proposed rule and tariff changes,”<sup>39</sup> the MMU recommends specific enhancements to existing market rules and implementation of new rules that are required for competitive results in PJM markets and for continued improvements in the functioning of PJM markets.

In this *2016 Quarterly State of the Market Report for PJM: January through March*, the MMU includes one new recommendation.

## New Recommendation from Section 5, Capacity Market

- The MMU recommends that all capacity imports be required to be deliverable to PJM load prior to the relevant Delivery Year to ensure that they are as close to full substitutes for internal, physical capacity resources as possible. Pseudo ties alone are not adequate to ensure deliverability. (Priority: High. New recommendation. Status: Not adopted.)

## Total Price of Wholesale Power

The total price of wholesale power is the total price per MWh of purchasing wholesale electricity from PJM markets. The total price is an average price and actual prices vary by location. The total price includes the price of energy, capacity, ancillary services, and transmission service, administrative fees, regulatory support fees and uplift charges billed through PJM systems. Table 1-8 provides the average price and total revenues paid, by component, for the first three months of 2015 and 2016.

<sup>37</sup> *Id.*

<sup>38</sup> OATT Attachment M § VI.A.

<sup>39</sup> 18 CFR § 35.28(g)(3)(ii)(A); see also OATT Attachment M § IV.D.

Table 1-8 shows that Energy, Capacity and Transmission Service Charges are the three largest components of the total price per MWh of wholesale power, comprising 96.7 percent of the total price per MWh in the first three months of 2016.

Each of the components is defined in PJM's Open Access Transmission Tariff (OATT) and PJM Operating Agreement and each is collected through PJM's billing system.

## Components of Total Price

- The Energy component is the real time load weighted average PJM locational marginal price (LMP).
- The Capacity component is the average price per MWh of Reliability Pricing Model (RPM) payments.
- The Transmission Service Charges component is the average price per MWh of network integration charges, and firm and non firm point to point transmission service.<sup>40</sup>
- The Energy Uplift (Operating Reserves) component is the average price per MWh of day-ahead and balancing operating reserves and synchronous condensing charges.<sup>41</sup>
- The Reactive component is the average cost per MWh of reactive supply and voltage control from generation and other sources.<sup>42</sup>
- The Regulation component is the average cost per MWh of regulation procured through the Regulation Market.<sup>43</sup>
- The PJM Administrative Fees component is the average cost per MWh of PJM's monthly expenses for a number of administrative services, including Advanced Control Center (AC<sup>2</sup>) and OATT Schedule 9 funding of FERC, OPSI and the MMU.
- The Transmission Enhancement Cost Recovery component is the average cost per MWh of PJM billed (and not otherwise collected through utility

rates) costs for transmission upgrades and projects, including annual recovery for the TrAIL and PATH projects.<sup>44</sup>

- The Capacity (FRR) component is the average cost per MWh under the Fixed Resource Requirement (FRR) Alternative for an eligible LSE to satisfy its Unforced Capacity obligation.<sup>45</sup>
- The Emergency Load Response component is the average cost per MWh of the PJM Emergency Load Response Program.<sup>46</sup>
- The Day-Ahead Scheduling Reserve component is the average cost per MWh of Day-Ahead scheduling reserves procured through the Day-Ahead Scheduling Reserve Market.<sup>47</sup>
- The Transmission Owner (Schedule 1A) component is the average cost per MWh of transmission owner scheduling, system control and dispatch services charged to transmission customers.<sup>48</sup>
- The Synchronized Reserve component is the average cost per MWh of synchronized reserve procured through the Synchronized Reserve Market.<sup>49</sup>
- The Black Start component is the average cost per MWh of black start service.<sup>50</sup>
- The RTO Startup and Expansion component is the average cost per MWh of charges to recover AEP, ComEd and DAY's integration expenses.<sup>51</sup>
- The NERC/RFC component is the average cost per MWh of NERC and RFC charges, plus any reconciliation charges.<sup>52</sup>
- The Economic Load Response component is the average cost per MWh of day ahead and real time economic load response program charges to LSEs.<sup>53</sup>

40 OATT §§ 13.7, 14.5, 27A & 34.

41 OA Schedules 1 §§ 3.2.3 & 3.3.3.

42 OATT Schedule 2 and OA Schedule 1 § 3.2.3B. The line item in Table 1-8 includes all reactive services charges.

43 OA Schedules 1 §§ 3.2.2, 3.2.2A, 3.3.2, & 3.3.2A; OATT Schedule 3.

44 OATT Schedule 12.

45 Reliability Assurance Agreement Schedule 8.1.

46 OATT PJM Emergency Load Response Program.

47 OA Schedules 1 §§ 3.2.3A.01 & OATT Schedule 6.

48 OATT Schedule 1A.

49 OA Schedule 1 § 3.2.3A.01; PJM OATT Schedule 6.

50 OATT Schedule 6A. The line item in Table 1-8 includes all Energy Uplift (Operating Reserves) charges for Black Start.

51 OATT Attachments H-13, H-14 and H-15 and Schedule 13.

52 OATT Schedule 10-NERC and OATT Schedule 10-RFC.

53 OA Schedule 1 § 3.6.

- The Transmission Facility Charges component is the average cost per MWh of Ramapo Phase Angle Regulators charges allocated to PJM Mid-Atlantic transmission owners.<sup>54</sup>
- The Non-Synchronized Reserve component is the average cost per MWh of non-synchronized reserve procured through the Non-Synchronized Reserve Market.<sup>55</sup>
- The Emergency Energy component is the average cost per MWh of emergency energy.<sup>56</sup>

**Table 1-8 Total price per MWh by category: January through March, 2015 and 2016**

Category	Jan-Mar 2015 \$/MWh	Jan-Mar 2015 Percent of Total	Jan-Mar 2016 \$/MWh	Jan-Mar 2016 Percent of Total	Percent Change Totals
Load Weighted Energy	\$50.91	74.0%	\$26.80	55.6%	(47.4%)
Capacity	\$8.48	12.3%	\$12.26	25.4%	44.7%
Transmission Service Charges	\$6.28	9.1%	\$7.56	15.7%	20.4%
PJM Administrative Fees	\$0.44	0.6%	\$0.45	0.9%	2.0%
Reactive	\$0.36	0.5%	\$0.39	0.8%	7.8%
Energy Uplift (Operating Reserves)	\$0.82	1.2%	\$0.20	0.4%	(75.9%)
Transmission Enhancement Cost Recovery	\$0.42	0.6%	\$0.18	0.4%	(57.8%)
Regulation	\$0.32	0.5%	\$0.11	0.2%	(65.2%)
Transmission Owner (Schedule 1A)	\$0.09	0.1%	\$0.09	0.2%	0.6%
Black Start	\$0.07	0.1%	\$0.07	0.1%	(6.8%)
Synchronized Reserves	\$0.20	0.3%	\$0.04	0.1%	(79.7%)
NERC/RFC	\$0.03	0.0%	\$0.03	0.1%	4.1%
Non-Synchronized Reserves	\$0.03	0.0%	\$0.01	0.0%	(51.9%)
Load Response	\$0.01	0.0%	\$0.01	0.0%	(33.4%)
Inadvertent Cost	\$0.00	0.0%	\$0.00	0.0%	0.0%
Day Ahead Scheduling Reserve (DASR)	\$0.03	0.1%	\$0.00	0.0%	(87.2%)
RTO Startup and Expansion	\$0.01	0.0%	\$0.00	0.0%	(66.5%)
Transmission Facility Charges	\$0.00	0.0%	\$0.00	0.0%	46.3%
Capacity (FRR)	\$0.27	0.4%	\$0.00	0.0%	(100.0%)
Emergency Energy	\$0.00	0.0%	\$0.00	0.0%	0.0%
Emergency Load Response	\$0.00	0.0%	\$0.00	0.0%	0.0%
Total	\$68.78	100.0%	\$48.21	100.0%	(29.9%)

54 OA Schedule 1 § 5.3b.

55 OA Schedule 1 § 3.2.3A.001.

56 OA Schedule 1 § 3.2.6.

## Section Overviews

### Overview: Section 3, “Energy Market”

#### Market Structure

- **Supply.** Supply includes physical generation and imports and virtual transactions. Average offered real-time generation decreased by 3,886 MW, or 2.4 percent, in the first three months of 2016 from an average maximum of 164,790 in the first three months 2015 to 160,904 MW in the first three months 2016. In the first three months 2016, 994.8 MW of new capacity were added and 51.0 MW were retired.

PJM average real-time generation in the first three months of 2016 decreased by 9.5 percent from the first three months of 2015, from 97,741 MW to 88,470 MW.

PJM average day-ahead supply in the first three months of 2016, including INCs and up to congestion transactions, increased by 8.0 percent from the first three months of 2015, from 123,424 MW to 133,263 MW, primarily as a result of an increase in UTC volumes.

- **Market Concentration.** The PJM energy market was moderately concentrated overall with moderate concentration in the baseload segment, but high concentration in the intermediate and peaking segments.
- **Generation Fuel Mix.** During the first three months of 2016, coal units provided 32.1 percent, nuclear units 36.6 percent and gas units 25.4 percent of total generation. Compared to the first three months 2015, generation from coal units decreased 31.7 percent, generation from gas units increased 19.0 percent and generation from nuclear units increased 2.0 percent.

- **Marginal Resources.** In the PJM Real-Time Energy Market, in the first three months of 2016, coal units were 43.36 percent of marginal resources and natural gas units were 44.55 percent of marginal resources. In the first three months of 2015, coal units were 57.21 percent and natural gas units were 33.10 percent of the marginal resources.

In the PJM Day-Ahead Energy Market, in the first three months of 2016, up to congestion transactions were 83.2 percent of marginal resources, INCs were 4.0 percent of marginal resources, DECs were 6.9 percent of marginal resources, and generation resources were 5.9 percent of marginal resources. In the first three months of 2015, up to congestion transactions were 72.8 percent of marginal resources, INCs were 5.7 percent of marginal resources, DECs were 8.5 percent of marginal resources, and generation resources were 12.3 percent of marginal resources.

- **Demand.** Demand includes physical load and exports and virtual transactions. The PJM system peak load during the first three months of 2016 was 129,876 MW in the HE 0800 on January 19, 2016, which was 13,210 MW, or 9.2 percent, lower than the PJM peak load for the first three months of 2015, which was 143,086 MW in the HE 0800 on February 20, 2015.

PJM average real-time load in the first three months of 2016 decreased by 8.8 percent from the first three months of 2015, from 97,936 MW to 89,322 MW. PJM average day-ahead demand in the first three months of 2016, including DECs and up to congestion transactions, increased by 9.6 percent from the first three months of 2015, from 119,078 MW to 130,534 MW.

- **Supply and Demand: Load and Spot Market.** Companies that serve load in PJM can do so using a combination of self-supply, bilateral market purchases and spot market purchases. For the first three months of 2016, 7.4 percent of real-time load was supplied by bilateral contracts, 26.6 percent by spot market purchases and 66.0 percent by self-supply. Compared with the first three months of 2015, reliance on bilateral contracts increased by 1.1 percent, reliance on spot market purchases

decreased by 6.6 percentage points and reliance on self-supply increased by 5.5 percentage points.

- **Supply and Demand: Scarcity.** There were no shortage pricing events in the first three months of 2016.

## Market Behavior

- **Offer Capping for Local Market Power.** PJM offer caps units when the local market structure is noncompetitive. Offer capping is an effective means of addressing local market power. Offer capping levels have historically been low in PJM. In the Day-Ahead Energy Market, for units committed to provide energy for local constraint relief, offer-capped unit hours decreased from 0.3 percent in the first three months of 2015 to 0.1 percent in the first three months of 2016. In the Real-Time Energy Market, for units committed to provide energy for local constraint relief, offer-capped unit hours decreased from 0.6 percent in the first three months of 2015 to 0.4 percent in the first three months of 2016.

In the first three months of 2016, 10 control zones experienced congestion resulting from one or more constraints binding for 25 or more hours. The analysis of the application of the TPS test to local markets demonstrates that it is working successfully to identify pivotal owners when the market structure is noncompetitive and to ensure that owners are not subject to offer capping when the market structure is competitive. There are, however, identified issues with the application of market power mitigation to resources whose owners fail the TPS test that can result in the exercise of local market power. These issues need to be addressed.

- **Offer Capping for Reliability.** PJM also offer caps units that are committed for reliability reasons, specifically for black start service and reactive service. In the Day-Ahead Energy Market, for units committed for reliability reasons, offer-capped unit hours decreased from 0.3 percent in the first three months of 2015 to 0.1 percent in the first three months of 2016. In the Real-Time Energy Market, for units committed for reliability reasons, offer-capped unit hours decreased from 0.3 percent in the first three months of 2015 to 0.1 percent in the first three months of 2016.

- **Markup Index.** The markup index is a summary measure of participant offer behavior for individual marginal units. In the PJM Real-Time Energy Market, when using unadjusted cost offers, in the first three months of 2016, 89.2 percent of marginal units had average dollar markups less than zero and had an average markup index less than zero. Using adjusted cost offers, in the first three months of 2016, 89.2 percent of marginal units had average dollar markups less than zero and average markup index less than or equal to zero. Some marginal units did have substantial markups. Among the units that were marginal in the first three months of 2016, none had offer prices above \$400 per MWh.

In the PJM Day-Ahead Energy Market, when using unadjusted cost offers, in the first three months of 2016, no marginal generating units had an average markup index less than or equal to zero. Using adjusted cost offers, in the first three months of 2016, no marginal units had an average markup index less than or equal to zero.

- **Frequently Mitigated Units (FMU) and Associated Units (AU).** A new FMU rule became effective November 1, 2014, limiting the availability of FMU adders to units with net revenues less than unit going forward costs. The number of units that were eligible for an FMU or AU adder declined from an average of 70 units during the first 11 months of 2014, to zero since December 2014.
- **Virtual Offers and Bids.** Any market participant in the PJM Day-Ahead Energy Market can use increment offers, decrement bids, up to congestion transactions, import transactions and export transactions as financial instruments that do not require physical generation or load. The reduction in up to congestion transactions (UTC) that had followed a FERC order setting September 8, 2014, as the effective date for any uplift charges subsequently assigned to UTCs, was reversed. There was an increase in up to congestion volume as a result of the expiration of the fifteen month resettlement period for the proceeding related to uplift charges for UTC transactions. In the first three months of 2016, the average hourly up to congestion submitted MW increased by 146.1 percent from 59,004 MW in the first three months of 2015 to 145,243 MW in the first three months of 2016, and cleared MW increased by 113.6 percent from 17,178 MW in

the first three months of 2015 to 36,688 MW in the first three months of 2016.

- **Generator Offers.** Generator offers are categorized as dispatchable and self scheduled. Units which are available for economic dispatch are dispatchable. Units which are self scheduled to generate fixed output are categorized as self scheduled. Units which are self scheduled at their economic minimum and are available for economic dispatch up to their economic maximum are categorized as self scheduled and dispatchable. Of all generator offers in the first three months of 2016, 54.0 percent were offered as available for economic dispatch, 22.1 percent were offered as self scheduled, and 16.3 percent were offered as self scheduled and dispatchable.

## Market Performance

- **Prices.** PJM LMPs are a direct measure of market performance. Price level is a good, general indicator of market performance, although the number of factors influencing the overall level of prices means it must be analyzed carefully. Among other things, overall average prices reflect changes in supply and demand, generation fuel mix, the cost of fuel, emission related expenses, markup and local price differences caused by congestion. PJM also may administratively set prices with the creation of a closed loop interface related to demand side resources or reactive power or the application of price setting logic.

PJM Real-Time Energy Market prices decreased in the first three months of 2016 compared to the first three months of 2015. The load-weighted average real-time LMP was 47.4 percent lower in the first three months of 2016 than in the first three months of 2015, \$26.80 per MWh versus \$50.91 per MWh.

PJM Day-Ahead Energy Market prices decreased in the first three months of 2016 compared to the first three months of 2015. The load-weighted average day-ahead LMP was 46.3 percent lower in the first three months of 2016 than in the first three months of 2015, \$27.94 per MWh versus \$52.02 per MWh.

- **Components of LMP.** In the PJM Real-Time Energy Market, for the first three months of 2016, 54.2 percent of the load-weighted LMP was the result of coal costs, 22.3 percent was the result of gas costs and 2.28 percent was the result of the cost of emission allowances.
- In the PJM Day-Ahead Energy Market for the first three months of 2016, 35.5 percent of the load-weighted LMP was the result of the cost of coal, 20.8 percent was the result of DECs, 12.5 percent was the result of the cost of gas, 13.8 percent was the result of INCs, and 4.6 percent was the result of up to congestion transactions.
- **Markup.** The markup conduct of individual owners and units has an identifiable impact on market prices. Markup is a key indicator of the competitiveness of the Energy Market.

In the PJM Real-Time Energy Market in the first three months of 2016, the adjusted markup component of LMP was \$0.46 per MWh or 1.7 percent of the PJM real-time, load-weighted average LMP. The month of March had the highest adjusted markup component, \$1.82 per MWh, or 7.44 percent of the real-time load-weighted average LMP. Using the unadjusted cost offers, the highest markup in the first three months of 2016 was \$216.98 per MWh.

In the PJM Day-Ahead Energy Market, marginal INCs, DECs and UTCs have zero markups. In the first three months of 2016, the adjusted markup component of LMP resulting from generation resources was \$0.86 per MWh or 3.1 percent of the PJM day-ahead load-weighted average LMP. The month of February had the highest adjusted markup component, \$0.90 per MWh or 3.2 percent of the day-ahead load-weighted average LMP.

Participant behavior was evaluated as competitive because the analysis of markup shows that marginal units generally make offers at, or close to, their marginal costs in both the Day-Ahead and Real-Time Energy Markets, although the behavior of some participants during the high demand periods in the first three months of 2016 is consistent with economic withholding.

- **Price Convergence.** Hourly and daily price differences between the Day-Ahead and Real-Time Energy Markets fluctuate continuously and substantially from positive to negative. The difference between the average day-ahead and real-time prices was -\$1.23 per MWh in the first three months of 2015 and -\$1.30 per MWh in the first three months of 2016. The difference between average day-ahead and real-time prices, by itself, is not a measure of the competitiveness or effectiveness of the Day-Ahead Energy Market.

### Scarcity

- There were no shortage pricing events in the first three months of 2016.

### Section 3 – Recommendations

- The MMU recommends that PJM retain the \$1,000 per MWh offer cap in the PJM energy market except when cost-based offers exceed \$1,000 per MWh, and retain other existing rules that limit incentives to exercise market power. (Priority: High. First reported 1999. Status: Partially adopted, 1999.)
- The MMU recommends that the rules governing the application of the TPS test be clarified and documented. (Priority: High. First reported 2010. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation when the TPS test is failed, that markup be constant across price and cost offers, that there be at least one cost-based offer using the same fuel as the available price-based offer. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that in order to ensure effective market power mitigation when the TPS test is failed, the operating parameters in the cost-based offer and the price-based parameter limited schedule (PLS) offer be at least as flexible as the operating parameters in the available non-PLS price-based offer, and that the price-MW pairs in the price based PLS offer be exactly equal to the price based non PLS offer. (Priority: High. First reported 2015. Status: Not adopted.)

- The MMU recommends that PJM require all generating units to identify the fuel type associated with each of their offered schedules. (Priority: Low. First reported Q2, 2014. Status: Adopted in full, Q4, 2014.)
- The MMU recommends that under the Capacity Performance construct, PJM recognize the difference between operational parameters that indicate to PJM dispatchers what a unit is capable of during the operating day and the parameters that are used for capacity performance assessment as well as uplift payments. The parameters which determine non-performance charges and the amount of uplift payments to those generators should reflect the flexibility goals of the capacity performance construct. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that capacity performance resources and base capacity resources (during the June through September period) be held to the OEM operating parameters of the capacity market CONE reference resource for performance assessment and energy uplift payments. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM remove non-specific fuel types such as “other” or “co-fire other” from the list of fuel types available for market participants to identify the fuel type associated with their price and cost schedules. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that a unit which is not capable of supplying energy consistent with its day-ahead offer should reflect an appropriate outage rather than indicating its availability to supply energy on an emergency basis. (Priority: Low. First reported 2009. Status: Not Adopted.)
- The MMU recommends that PJM explain how LMPs are calculated when demand response is marginal. The LMPs in excess of \$1,800 per MWh on January 7, 2014, were potentially a result of the way in which PJM modeled zonal (not nodal) demand response as a marginal resource. (Priority: Low. First reported Q1, 2014. Status: Not Adopted.)
- The MMU recommends that PJM explicitly state its policy on the use of transmission penalty factors including the level of the penalty factors, the triggers for the use of the penalty factors, the appropriate line ratings to trigger the use of penalty factors, and when the transmission penalty factors will be used to set the shadow price. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM routinely review all transmission facility ratings and any changes to those ratings to ensure that the normal, emergency and load dump ratings used in modeling the transmission system are accurate and reflect standard ratings practice. (Priority: Low. First reported 2013. Status: Partially adopted.)
- The MMU recommends that the definition of maximum emergency status in the tariff apply at all times rather than just during maximum emergency events.<sup>57</sup> (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM update the outage impact studies, the reliability analyses used in RPM for capacity deliverability and the reliability analyses used in RTEP for transmission upgrades to be consistent with the more conservative emergency operations (post contingency load dump limit exceedance analysis) in the energy market that were implemented in June 2013. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that the roles of PJM and the transmission owners in the decision making process to control for local contingencies be clarified, that PJM’s role be strengthened and that the process be made transparent. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM include in the appropriate manual an explanation of the initial creation of hubs, the process for modifying hub definitions and a description of how hub definitions have changed.<sup>58</sup> There is currently no PJM documentation in the tariff or manuals explaining how hubs are created and how their definitions are changed.<sup>59</sup> (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that during hours when a generation bus shows a net withdrawal, the energy withdrawal be treated as load, not negative generation, for purposes of calculating load and load-weighted LMP.

<sup>57</sup> PJM. OATT Section: 6A.1.3 Maximum Emergency, (February 25, 2014), p. 1740, 1795.

<sup>58</sup> According to minutes from the first meeting of the Energy Market Committee (EMC) on January 28, 1998, the EMC unanimously agreed to be responsible for approving additions, deletions and changes to the hub definitions to be published and modeled by PJM. Since the EMC has become the Market Implementation Committee (MIC), the MIC now appears to be responsible for such changes.

<sup>59</sup> The general definition of a hub can be found in PJM. “Manual 35: Definitions and Acronyms,” Revision 23 (April 11, 2014).

The MMU recommends that during hours when a load bus shows a net injection, the energy injection be treated as generation, not negative load, for purposes of calculating generation and load-weighted LMP. (Priority: Low. First reported 2013. Status: Not adopted.)

- The MMU recommends that PJM identify and collect data on available behind the meter generation resources, including nodal location information and relevant operating parameters. (Priority: Low. First reported 2013. Status: Partially adopted.)
- The MMU recommends that PJM continue to enhance its posting of market data to promote market efficiency. (Priority: Medium. First reported 2005. Status: Partially Adopted.)
- The MMU recommends the elimination of FMU and AU adders. FMU and AU adders no longer serve the purpose for which they were created and interfere with the efficient operation of PJM markets. (Priority: Medium. First reported 2012. Status: Adopted partially, Q4, 2014.)

### Section 3 – Conclusion

The MMU analyzed key elements of PJM energy market structure, participant conduct and market performance in the first three months of 2016, including aggregate supply and demand, concentration ratios, three pivotal supplier test results, offer capping, participation in demand response programs, loads and prices.

Average PJM real-time generation decreased by 3,886 MW, or 2.4 percent, and peak load decreased by 13,210 MW, in the first three months of 2016 compared to the first three months of 2015. Market concentration levels remained moderate although there is high concentration in the intermediate and peaking segments of the supply curve which adds to concerns about market power when market conditions are tight. The relationship between supply and demand, regardless of the specific market, balanced by market concentration, is referred to as the supply-demand fundamentals or economic fundamentals. While the market structure does not guarantee competitive outcomes, overall the market structure of the PJM aggregate energy market

remains reasonably competitive for most hours although aggregate market power does exist during high demand hours.

Prices are a key outcome of markets. Prices vary across hours, days and years for multiple reasons. Price is an indicator of the level of competition in a market although individual prices are not always easy to interpret. In a competitive market, prices are directly related to the marginal cost of the most expensive unit required to serve load in each hour. The pattern of prices within days and across months and years illustrates how prices are directly related to supply and demand conditions and thus also illustrates the potential significance of the impact of the price elasticity of demand on prices. Energy market results in the first three months of 2016 generally reflected supply-demand fundamentals, although the behavior of some participants during high demand periods is consistent with economic withholding. Economic withholding is the ability to increase markups substantially in tight market conditions. There are additional issues in the energy market including the uncertainties about the pricing and availability of natural gas, the way that generation owners incorporate natural gas costs in offers, and the lack of adequate incentives for unit owners to take all necessary actions to acquire fuel and operate rather than take an outage.

The three pivotal supplier test is applied by PJM on an ongoing basis for local energy markets in order to determine whether offer capping is required for transmission constraints.<sup>60</sup> This is a flexible, targeted real-time measure of market structure which replaced the offer capping of all units required to relieve a constraint. A generation owner or group of generation owners is pivotal for a local market if the output of the owners' generation facilities is required in order to relieve a transmission constraint. When a generation owner or group of owners is pivotal, it has the ability to increase the market price above the competitive level. The three pivotal supplier test explicitly incorporates the impact of excess supply and implicitly accounts for the impact of the price elasticity of demand in the market power tests. The result of the introduction of the three pivotal supplier test was to limit offer capping to times when the local market structure was noncompetitive and specific

<sup>60</sup> The MMU reviews PJM's application of the TPS test and brings issues to the attention of PJM.

owners had structural market power. The analysis of the application of the three pivotal supplier test demonstrates that it is working for most hours to exempt owners when the local market structure is competitive and to require offer capping of owners when the local market structure is noncompetitive.

However, there are some issues with the application of mitigation in the Day-Ahead Energy Market and the Real-Time Energy Market when market sellers fail the TPS test. There is no tariff or manual language that defines in detail the application of the TPS test and offer capping in the Day-Ahead Energy Market and the Real-Time Energy Market. In both the Day-Ahead and Real-Time Energy Markets, generators have the ability to avoid mitigation by using varying markups in their price-based offers, offering different operating parameters in their price-based and cost-based offers, and using different fuels in their price-based and cost-based offers. These issues can be resolved by simple rule changes requiring that markup be constant across price and cost offers, that there be at least one cost-based offer using the same fuel as the available price-based offer, that the price-MW pairs in the price-based PLS offer be exactly equal to the price-based non PLS offer, and requiring cost-based and price-based PLS offers to be at least as flexible as price-based non-PLS offers.

PJM also offer caps units that are committed for reliability reasons in addition to units committed to provide constraint relief. Specifically, units that are committed to provide reactive support and black start service are offer capped in the energy market. These units are committed manually in both the Day-Ahead and Real-Time Energy Markets.

With or without a capacity market, energy market design must permit scarcity pricing when such pricing is consistent with market conditions and constrained by reasonable rules to ensure that market power is not exercised. Scarcity pricing can serve two functions in wholesale power markets: revenue adequacy and price signals. Scarcity pricing for revenue adequacy is not required in PJM. Scarcity pricing for price signals that reflect market conditions during periods of scarcity is required in PJM. Scarcity pricing is also part of an appropriate incentive structure facing both load and generation owners

in a working wholesale electric power market design. Scarcity pricing must be designed to ensure that market prices reflect actual market conditions, that scarcity pricing occurs with transparent triggers based on measured reserve levels and transparent prices and that there are strong incentives for competitive behavior and strong disincentives to exercise market power. Such administrative scarcity pricing is a key link between energy and capacity markets. The PJM Capacity Market is explicitly designed to provide revenue adequacy and the resultant reliability. Nonetheless, with a market design that includes a direct and explicit scarcity pricing net revenue true up mechanism, scarcity pricing can be a mechanism to appropriately increase reliance on the energy market as a source of revenues and incentives in a competitive market without reliance on the exercise of market power. PJM implemented scarcity pricing rules in 2012. There are significant issues with the scarcity pricing net revenue true up mechanism in the PJM scarcity pricing design, which will create issues when scarcity pricing occurs. There are also significant issues with PJM's scarcity pricing rules, including the absence of a clear trigger based on measured reserve levels (the current triggers are based on estimated reserves) and the lack of adequate locational scarcity pricing options.

The overall energy market results support the conclusion that energy prices in PJM are set, generally, by marginal units operating at, or close to, their marginal costs, although this was not always the case during the high demand hours in the first three months of 2014, 2015 or 2016. This is evidence of generally competitive behavior and competitive market outcomes, although the behavior of some participants during the high demand periods is consistent with economic withholding. Given the structure of the energy market which can permit the exercise of aggregate market power at times of high demand, the tighter market conditions and the change in some participants' behavior are sources of concern in the energy market and provide a reason to use cost as the sole basis for hourly changes in offers or offers greater than \$1,000 per MWh. The MMU concludes that the PJM energy market results were competitive in the first three months of 2016.

## Overview: Section 4, “Energy Uplift”

### Energy Uplift Results

- **Energy Uplift Charges.** Total energy uplift charges decreased by \$147.3 million, or 79.0 percent, in the first three months of 2016 compared to the first three months of 2015, from \$186.4 million to \$39.1 million.
- **Energy Uplift Charges Categories.** The decrease of \$147.3 million in the first three months of 2016 is comprised of a \$33.9 million decrease in day-ahead operating reserve charges, a \$102.7 million decrease in balancing operating reserve charges, a \$6.0 million decrease in reactive services charges, a \$0.0 million decrease in synchronous condensing charges and a \$4.7 million decrease in black start services charges.
- **Average Effective Operating Reserve Rates in the Eastern Region.** Day-ahead load paid \$0.105 per MWh, real-time load paid \$0.031 per MWh, a DEC paid \$0.483 per MWh and an INC and any load, generation or interchange transaction deviation paid \$0.378 per MWh.
- **Average Effective Operating Reserve Rates in the Western Region.** Day-ahead load paid \$0.105 per MWh, real-time load paid \$0.031 per MWh, a DEC paid \$0.355 per MWh and an INC and any load, generation or interchange transaction deviation paid \$0.250 per MWh.
- **Reactive Services Rates.** The DPL, PENELEC and AEP control zones had the three highest local voltage support rates: \$0.049, \$0.002 and \$0.000 per MWh. The reactive transfer interface support rate averaged \$0.0000 per MWh.

### Characteristics of Credits

- **Types of units.** Combined cycles received 15.1 percent of all day-ahead generator credits and 24.0 percent of all balancing generator credits. Combustion turbines and diesels received 89.3 percent of the lost opportunity cost credits. Coal units received 0.0 percent of all reactive services credits.
- **Concentration of Energy Uplift Credits.** The top 10 units receiving energy uplift credits received 54.0 percent of all credits. The top 10

organizations received 86.9 percent of all credits. Concentration indexes for energy uplift categories classify them as highly concentrated. Day-ahead operating reserves HHI was 5397, balancing operating reserves HHI was 4165, and lost opportunity cost HHI was 5101.

- **Economic and Noneconomic Generation.** In the first three months of 2016, 88.1 percent of the day-ahead generation eligible for operating reserve credits was economic and 74.0 percent of the real-time generation eligible for operating reserve credits was economic.
- **Day-Ahead Unit Commitment for Reliability.** In the first three months of 2016, 3.1 percent of the total day-ahead generation MWh was scheduled as must run by PJM, of which 39.9 percent received energy uplift payments.

### Geography of Charges and Credits

- In the first three months of 2016, 91.2 percent of all uplift charges allocated regionally (day-ahead operating reserves and balancing operating reserves) were paid by transactions at control zones or buses within a control zone, demand and generation, 4.1 percent by transactions at hubs and aggregates and 4.7 percent by interchange transactions at interfaces.
- Generators in the Eastern Region received 70.3 percent of all balancing generator credits, including lost opportunity cost and canceled resources credits.
- Generators in the Western Region received 29.3 percent of all balancing generator credits, including lost opportunity cost and canceled resources credits.
- External generators received 0.4 percent of all balancing generator credits, including lost opportunity cost and canceled resources credits.

### Energy Uplift Issues

- **Lost Opportunity Cost Credits.** In the first three months of 2016, lost opportunity cost credits decreased by \$42.0 million compared to the first three months of 2015. In the first three months of 2016, resources in the top three control zones receiving lost opportunity cost credits, AEP,

Dominion and ComEd, accounted for 64.7 percent of all lost opportunity cost credits, 50.1 percent of all day-ahead generation from pool-scheduled combustion turbines and diesels, 46.5 percent of all day-ahead generation not committed in real time by PJM from those unit types and 58.3 percent of all day-ahead generation not committed in real time by PJM and receiving lost opportunity cost credits from those unit types.

- **Con Edison – PJM Transmission Service Agreements Support.** Certain units located near the boundary between New Jersey and New York City have been operated to support the transmission service agreements between Con Ed and PJM, formerly known as the Con Ed – PSEG Wheeling Contracts. These units are often run out of merit and received substantial operating reserves credits.

## Section 4 – Energy Uplift Recommendations

- **Impact of Quantifiable Recommendations.** The impact of implementing the recommendations related to energy uplift proposed by the MMU on the rates paid by participants would be significant. For example, in the first three months of 2016, the average rate paid by a DEC in the Eastern Region would have been \$0.043 per MWh under the MMU proposal, which is \$0.440 per MWh, or 91.2 percent, lower than the actual average rate paid.

The MMU recognizes that many of the issues addressed in the recommendations are being discussed in PJM stakeholder processes. Until new rules are in place, the MMU’s recommendations and the reported status of those recommendations are based on the existing market rules.

- The MMU recommends that PJM not use closed loop interface constraints to artificially override the nodal prices that are based on fundamental LMP logic in order to: accommodate rather than resolve the inadequacies of the demand side resource capacity product; address the inability of the power flow model to incorporate the need for reactive power; accommodate rather than resolve the flaws in PJM’s approach to scarcity pricing; or for any other reason. (Priority: Medium. First reported 2013. Status: Not adopted.)

- The MMU recommends that PJM not use price setting logic to artificially override the nodal prices that are based on fundamental LMP logic in order to reduce uplift. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM initiate an analysis of the reasons why some combustion turbines and diesels scheduled in the Day-Ahead Energy Market are not called in real time when they are economic. (Priority: Medium. First Reported 2012. Status: Not adopted.)
- The MMU recommends that PJM clearly identify and classify all reasons for incurring operating reserves in the Day-Ahead and the Real-Time Energy Markets and the associated operating reserve charges in order for all market participants to be made aware of the reasons for these costs and to help ensure a long term solution to the issue of how to allocate the costs of operating reserves. (Priority: Medium. First reported 2011. Status: Adopted 2014.)
- The MMU recommends that PJM revise the current operating reserve confidentiality rules in order to allow the disclosure of complete information about the level of operating reserve charges by unit and the detailed reasons for the level of operating reserve credits by unit in the PJM region. (Priority: High. First reported 2013. Status: Partially adopted.)
- The MMU recommends the elimination of the day-ahead operating reserve category to ensure that units receive an energy uplift payment based on their real-time output and not their day-ahead scheduled output. (Priority: Medium. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends reincorporating the use of net regulation revenues as an offset in the calculation of balancing operating reserve credits. (Priority: Medium. First reported 2009. Status: Not adopted. Stakeholder process.)
- The MMU recommends not compensating self-scheduled units for their startup cost when the units are scheduled by PJM to start before the self-scheduled hours. (Priority: Low. First reported 2013. Status: Not adopted. Stakeholder process.)

- The MMU recommends seven modifications to the energy lost opportunity cost calculations:
  - The MMU recommends that the lost opportunity cost in the energy market be calculated using the schedule on which the unit was scheduled to run in the energy market. (Priority: High. First reported 2012. Status: Adopted 2015.)
  - The MMU recommends including no load and startup costs as part of the total avoided costs in the calculation of lost opportunity cost credits paid to combustion turbines and diesels scheduled in the Day-Ahead Energy Market but not committed in real time. (Priority: Medium. First reported 2012. Status: Adopted 2015.)
  - The MMU recommends using the entire offer curve and not a single point on the offer curve to calculate energy lost opportunity cost. (Priority: Medium. First reported 2012. Status: Adopted 2015.)
  - The MMU recommends calculating LOC based on 24 hour daily periods or multi-hour segments of hours for combustion turbines and diesels scheduled in the Day-Ahead Energy Market but not committed in real time. (Priority: Medium. First reported 2014. Status: Not adopted.)
  - The MMU recommends that units scheduled in the Day-Ahead Energy Market and not committed in real time should be compensated for LOC based on their real-time desired and achievable output, not their scheduled day-ahead output. (Priority: Medium. First reported 2015. Status: Not adopted.)
  - The MMU recommends that units scheduled in the Day-Ahead Energy Market and not committed in real time be compensated for LOC incurred within an hour. (Priority: Medium. First reported 2013. Status: Not adopted.)
  - The MMU recommends that only flexible fast start units (startup plus notification times of 30 minutes or less) and short minimum run times (one hour or less) be eligible by default for the LOC compensation to units scheduled in the Day-Ahead Energy Market and not committed in real time. Other units should be eligible for LOC compensation only if PJM explicitly cancels their day-ahead commitment. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that up to congestion transactions be required to pay energy uplift charges. (Priority: High. First reported 2011. Status: Not adopted. Stakeholder process.)
- The MMU recommends eliminating the use of internal bilateral transactions (IBTs) in the calculation of deviations used to allocate balancing operating reserve charges. (Priority: High. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends allocating the energy uplift payments to units scheduled as must run in the Day-Ahead Energy Market for reasons other than voltage/reactive or black start services as a reliability charge to real-time load, real-time exports and real-time wheels. (Priority: Medium. First reported 2014. Status: Not adopted. Stakeholder process.)
- The MMU recommends reallocating the operating reserve credits paid to units supporting the Con Edison – PJM Transmission Service Agreements. (Priority: Medium. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends that the total cost of providing reactive support be categorized and allocated as reactive services. Reactive services credits should be calculated consistent with the operating reserve credits calculation. (Priority: Medium. First reported 2012. Status: Not adopted. Stakeholder process.)
- The MMU recommends including real-time exports and real-time wheels in the allocation of the cost of providing reactive support to the 500 kV system or above, which is currently allocated solely to real-time RTO load. (Priority: Low. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends enhancing the current energy uplift allocation rules to reflect the elimination of day-ahead operating reserves, the timing of commitment decisions and the commitment reasons. (Priority: High. First reported Q2, 2012. Status: Not adopted. Stakeholder process.)

## Section 4 – Conclusion

Energy uplift is paid to market participants under specified conditions in order to ensure that resources are not required to operate for the PJM system at a loss. Referred to in PJM as day-ahead operating reserves, balancing operating reserves, energy lost opportunity cost credits, reactive services credits, synchronous condensing credits or black start services credits, these payments are intended to be one of the incentives to generation owners to offer their energy to the PJM energy market at marginal cost and to operate their units at the direction of PJM dispatchers. These credits are paid by PJM market participants as operating reserve charges, reactive services charges, synchronous condensing charges or black start charges.

In PJM all energy payments to demand response resources are also uplift payments. The energy payments to these resources are not part of the supply and demand balance, they are not paid by LMP revenues and therefore the energy payments to demand response resources have to be paid as out of market uplift. The energy payments to economic DR are funded by real-time load and real-time exports. The energy payments to emergency DR are funded by participants with net energy purchases in the Real-Time Energy Market.

From the perspective of those participants paying energy uplift charges, these costs are an unpredictable and unhedgeable component of participants' costs in PJM. While energy uplift charges are an appropriate part of the cost of energy, market efficiency would be improved by ensuring that the level and variability of these charges are as low as possible consistent with the reliable operation of the system and that the allocation of these charges reflects the reasons that the costs are incurred to the extent possible.

The goal should be to reflect the impact of physical constraints in market prices to the maximum extent possible and thus to reduce the necessity for out of market energy uplift payments. When units receive substantial revenues through energy uplift payments, these payments are not transparent to the market because of the current confidentiality rules. As a result, other market participants, including generation and transmission developers, do not have the opportunity to compete to displace them. As a result, substantial

energy uplift payments to a concentrated group of units and organizations has persisted for more than ten years.

One part of addressing the level and allocation of uplift payments is to eliminate all day-ahead operating reserve credits. It is illogical and unnecessary to pay units day-ahead operating reserve credits because units do not incur any costs to run and any revenue shortfalls are addressed by balancing operating reserve credits.

The level of energy uplift paid to specific units depends on the level of the unit's energy offer, the unit's operating parameters, the details of the rules which define payments and the decisions of PJM operators. Energy uplift payments result in part from decisions by PJM operators, who follow reliability requirements and market rules, to start units or to keep units operating even when hourly LMP is less than the offer price including energy, no load and startup costs. Energy uplift payments also result from units' operational parameters that may require PJM to schedule or commit resources during noneconomic hours. The balance of these costs not covered by energy revenues are collected as energy uplift rather than reflected in price as a result of the rules governing the determination of LMP.

PJM's goal should be to minimize the total level of energy uplift paid and to ensure that the associated charges are paid by all those whose market actions result in the incurrence of such charges. For example, up to congestion transactions continue to pay no energy uplift charges, which means that all others who pay these charges are paying too much. In addition, the netting of transactions against internal bilateral transactions should be eliminated. The goal should be to minimize the total incurred energy uplift charges and to increase the transactions over which those charges are spread in order to reduce the impact of energy uplift charges on markets. The result would be to reduce the level of per MWh charges, to reduce the uncertainty associated with uplift charges and to reduce the impact of energy uplift charges on decisions about how and when to participate in PJM markets.

But it is also important that the reduction of uplift payments not be a goal to be achieved at the expense of the fundamental logic of an LMP system. For example, the use of closed loop interfaces to reduce uplift should be eliminated because it is not consistent with LMP fundamentals and constitutes a form of subjective price setting. The same is true of what PJM terms its price setting logic.

## Overview: Section 5, “Capacity Market”

### RPM Capacity Market

#### Market Design

The Reliability Pricing Model (RPM) Capacity Market is a forward-looking, annual, locational market, with a must offer requirement for Existing Generation Capacity Resources and mandatory participation by load, with performance incentives, that includes clear market power mitigation rules and that permits the direct participation of demand-side resources.<sup>61</sup>

Under RPM, capacity obligations are annual. Base Residual Auctions (BRA) are held for Delivery Years that are three years in the future. Effective with the 2012/2013 Delivery Year, First, Second and Third Incremental Auctions (IA) are held for each Delivery Year.<sup>62</sup> Prior to the 2012/2013 Delivery Year, the Second Incremental Auction was conducted if PJM determined that an unforced capacity resource shortage exceeded 100 MW of unforced capacity due to a load forecast increase. Effective January 31, 2010, First, Second, and Third Incremental Auctions are conducted 20, 10, and three months prior to the Delivery Year.<sup>63</sup> Also effective for the 2012/2013 Delivery Year, a Conditional Incremental Auction may be held if there is a need to procure additional capacity resulting from a delay in a planned large transmission upgrade that was modeled in the BRA for the relevant Delivery Year.<sup>64</sup>

The 2016/2017 RPM Third Incremental Auction was conducted in the first three months of 2016.

<sup>61</sup> The terms *PJM Region*, *RTO Region* and *RTO* are synonymous in this report and include all capacity within the PJM footprint.

<sup>62</sup> See 126 FERC ¶ 61,275 (2009) at P 86.

<sup>63</sup> See *PJM Interconnection, LLC*, Letter Order in Docket No. ER10-366-000 (January 22, 2010).

<sup>64</sup> See 126 FERC ¶ 61,275 (2009) at P 88.

On June 9, 2015, FERC accepted changes to the PJM capacity market rules proposed in PJM’s Capacity Performance (CP) filing.<sup>65</sup> For a transition period during the 2018/2019 and 2019/2020 Delivery Years, PJM will procure two product types, Capacity Performance and Base Capacity. PJM also procured Capacity Performance resources in two transition auctions for Delivery Years 2016/2017 and 2017/2018. Effective with the 2020/2021 Delivery Year, PJM will procure a single capacity product, Capacity Performance. CP Resources are expected to be available and capable of providing energy and reserves when needed at any time during the Delivery Year.<sup>66</sup> Effective for the 2018/2019 through the 2019/2020 Delivery Years, a Base Capacity Demand Resource Constraint and a Base Capacity Resource Constraint are established for each modeled LDA. These maximum quantities are set for reliability purposes to limit the quantity procured of the less available products, including Base Capacity Generation Resources, Base Capacity Demand Resources, and Base Capacity Energy Efficiency Resources. The Capacity Performance (CP) Transition Incremental Auctions (IAs) were held as part of a five year transition to a single capacity product type in the 2020/2021 Delivery Year. Participation in the CP Transition IAs was voluntary. If a resource cleared a CP Transition IA and had a prior commitment for the relevant Delivery Year, the existing commitment was converted to a CP commitment which is subject to the CP performance requirements and Non-Performance Charges. The Transition IAs were not designed to minimize the cost of purchasing Capacity Performance resources for the two delivery years and were not designed to maximize economic welfare for the two delivery years.<sup>67</sup>

RPM prices are locational and may vary depending on transmission constraints.<sup>68</sup> Existing generation capable of qualifying as a capacity resource must be offered into RPM Auctions, except for resources owned by entities that elect the fixed resource requirement (FRR) option. Participation by LSEs is mandatory, except for those entities that elect the FRR option. There is an administratively determined demand curve that defines scarcity pricing levels and that, with the supply curve derived from capacity offers, determines

<sup>65</sup> See Docket No. ER15-623-000 (December 12, 2014) and 151 FERC ¶ 61,208 (2015).

<sup>66</sup> See PJM, “Manual 18: PJM Capacity Market,” Revision 32 (April 1, 2016), p. 7.

<sup>67</sup> The MMU will publish a detailed report on the operation and design of the transition auctions in 2016.

<sup>68</sup> Transmission constraints are local capacity import capability limitations (low capacity emergency transfer limit (CETL) margin over capacity emergency transfer objective (CETO)) caused by transmission facility limitations, voltage limitations or stability limitations.

market prices in each BRA. RPM rules provide performance incentives for generation, including the requirement to submit generator outage data and the linking of capacity payments to the level of unforced capacity, and the performance incentives have been strengthened significantly under the Capacity Performance modifications to RPM. Under RPM there are explicit market power mitigation rules that define the must offer requirement, that define structural market power based on the marginal cost of capacity, that define offer caps, that define the minimum offer price, and that have flexible criteria for competitive offers by new entrants. Demand Resources and Energy Efficiency Resources may be offered directly into RPM Auctions and receive the clearing price without mitigation.

## Market Structure

- **PJM Installed Capacity.** During the first three months of 2016, PJM installed capacity increased 809.2 MW or 0.5 percent, from 177,682.8 MW on January 1 to 178,492.0 MW on March 31. Installed capacity includes net capacity imports and exports and can vary on a daily basis.
- **PJM Installed Capacity by Fuel Type.** Of the total installed capacity on March 31, 2016, 37.4 percent was coal; 34.3 percent was gas; 18.6 percent was nuclear; 3.8 percent was oil; 5.0 percent was hydroelectric; 0.5 percent was wind; 0.4 percent was solid waste; and 0.1 percent was solar.
- **Market Concentration.** In the 2016/2017 RPM Third Incremental Auction all participants in the total PJM market as well as the LDA RPM markets failed the three pivotal supplier (TPS) test.<sup>69</sup> Offer caps were applied to all sell offers for resources which were subject to mitigation when the Capacity Market Seller did not pass the test, the submitted sell offer exceeded the defined offer cap, and the submitted sell offer, absent mitigation, increased the market clearing price.<sup>70 71 72</sup>

<sup>69</sup> There are 27 Locational Deliverability Areas (LDAs) identified to recognize locational constraints as defined in "Reliability Assurance Agreement Among Load Serving Entities in the PJM Region", Schedule 10.1. PJM determines, in advance of each BRA, whether the defined LDAs will be modeled in the given Delivery Year using the rules defined in OATT Attachment DD (Reliability Pricing Model) § 5.10(a)(ii).

<sup>70</sup> See PJM. OATT Attachment DD § 6.5.

<sup>71</sup> Prior to November 1, 2009, existing DR and EE resources were subject to market power mitigation in RPM Auctions. See 129 FERC ¶ 61,081 (2009) at P 30.

<sup>72</sup> Effective January 31, 2011, the RPM rules related to market power mitigation were changed, including revising the definition for Planned Generation Capacity Resource and creating a new definition for Existing Generation Capacity Resource for purposes of the must-offer requirement and market power mitigation, and treating a proposed increase in the capability of a Generation Capacity Resource the same in terms of mitigation as a Planned Generation Capacity Resource. See 134 FERC ¶ 61,065 (2011).

- **Imports and Exports.** Of the 599.7 MW of imports in the 2016/2017 RPM Third Incremental Auction, 8.0 MW cleared. Of the cleared imports, 4.9 MW (61.3 percent) were from MISO.
- **Demand-Side and Energy Efficiency Resources.** Capacity in the RPM load management programs was 12,149.5 MW for June 1, 2015, as a result of cleared capacity for Demand Resources and Energy Efficiency Resources in RPM Auctions for the 2015/2016 Delivery Year (16,643.3 MW) less replacement capacity from sources other than Demand Resources and Energy Efficiency (4,493.8 MW).

## Market Conduct

- **2016/2017 RPM Third Incremental Auction.** Of the 296 generation resources that submitted offers, the MMU calculated offer caps for 52 generation resources (17.6 percent), of which 35 were based on the technology specific default (proxy) ACR values and 17 were unit-specific offer caps (5.7 percent).

## Market Performance

- The 2016/2017 RPM Third Incremental Auction was conducted in the first three months of 2016. The weighted average capacity price for the 2016/2017 Delivery Year is \$121.85 per MW-day, including all RPM Auctions for the 2016/2017 Delivery Year. The weighted average capacity price for the 2017/2018 Delivery Year is \$142.83, including all RPM Auctions for the 2017/2018 Delivery Year held through the first three months of 2016. The weighted average capacity price for the 2018/2019 Delivery Year is \$179.60, including all RPM Auctions for the 2018/2019 Delivery Year held through the first three months of 2016.
- For the 2015/2016 Delivery Year, RPM annual charges to load are \$9.6 billion. For the 2016/2017 Delivery Year, RPM annual charges to load are \$7.7 billion.
- The Delivery Year weighted average capacity price was \$160.01 per MW-day in 2015/2016.

## Generator Performance

- **Forced Outage Rates.** The average PJM EFORd for the first three months of 2016 was 6.0 percent, a decrease from 9.4 percent for the first three months of 2015.<sup>73</sup>
- **Generator Performance Factors.** The PJM aggregate equivalent availability factor for the first three months of 2016 was 86.4 percent, a slight increase from 86.3 percent for the first three months of 2015.
- **Outages Deemed Outside Management Control (OMC).** In the first three months of 2016, 4.0 percent of forced outages were classified as OMC outages, an increase from 3.2 percent in 2015.

## Section 5 – Recommendations<sup>74</sup>

The MMU recognizes that PJM has implemented the Capacity Performance Construct to replace some of the existing core market rules and to address fundamental performance incentive issues. The MMU recognizes that the Capacity Performance Construct addresses many of the MMU's recommendations. The MMU's recommendations are based on the existing capacity market rules. The status is reported as adopted if the recommendation was included in FERC's order approving PJM's Capacity Performance filing.<sup>75</sup>

- The MMU recommends the enforcement of a consistent definition of capacity resource. The MMU recommends that the requirement to be a physical resource be enforced and enhanced. The requirement to be a physical resource should apply at the time of auctions and should also constitute a commitment to be physical in the relevant Delivery Year. The requirement to be a physical resource should be applied to all resource types, including planned generation, demand resources and imports.<sup>76 77</sup>

<sup>73</sup> The generator performance analysis includes all PJM capacity resources for which there are data in the PJM generator availability data systems (GADS) database. This set of capacity resources may include generators in addition to those in the set of generators committed as capacity resources in RPM. Data was downloaded from the PJM GADS database on April 26, 2016. EFORd data presented in state of the market reports may be revised based on data submitted after the publication of the reports as generation owners may submit corrections at any time with permission from PJM GADS administrators.

<sup>74</sup> The MMU has identified serious market design issues with RPM and the MMU has made specific recommendations to address those issues. These recommendations have been made in public reports. See Table 5-2.

<sup>75</sup> *PJM Interconnection, LLC*, 151 FERC ¶ 61,208 (June 9, 2015).

<sup>76</sup> See also Comments of the Independent Market Monitor for PJM. Docket No. ER14-503-000 (December 20, 2013).

<sup>77</sup> See "Analysis of Replacement Capacity for RPM Commitments: June 1, 2007 to June 1, 2013," <[http://www.monitoringanalytics.com/reports/Reports/2013/JMM\\_Report\\_on\\_Capacity\\_Replacement\\_Activity\\_2\\_20130913.pdf](http://www.monitoringanalytics.com/reports/Reports/2013/JMM_Report_on_Capacity_Replacement_Activity_2_20130913.pdf)> (September 13, 2013).

(Priority: High. First reported 2013. Status: Not adopted. Pending before FERC.)

- The MMU recommends that the test for determining modeled Locational Deliverability Areas in RPM be redefined. A detailed reliability analysis of all at risk units should be included in the redefined model. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that there be an explicit requirement that Capacity Resource offers in the Day-Ahead Energy Market be competitive, where competitive is defined to be the short run marginal cost of the units. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that explicit and detailed rules that define the conditions under which PJM will and will not recall energy from PJM capacity resources and prohibit new energy exports from PJM capacity resources. The MMU recommends that those rules define the conditions under which PJM will purchase emergency energy while at the same time not recalling energy exports from PJM capacity resources. PJM has modified these rules, but they need additional clarification and operational details. (Priority: Low. First reported 2010. Status: Partially adopted.)
- The MMU recommends that the net revenue calculation used by PJM to calculate the net Cost of New Entry (CONE) VRR parameter reflect the actual flexibility of units in responding to price signals rather than using assumed fixed operating blocks that are not a result of actual unit limitations.<sup>78 79</sup> The result of reflecting the actual flexibility is higher net revenues, which affect the parameters of the RPM demand curve and market outcomes. (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that modifications to existing resources not be treated as new resources for purposes of market power related offer caps or MOPR offer floors. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that, as part of the MOPR unit specific standard of review, all projects be required to use the same basic modeling

<sup>78</sup> See *PJM Interconnection, LLC*, Docket No. ER12-513-000 (December 1, 2011) ("Triennial Review").

<sup>79</sup> See the *2012 State of the Market Report for PJM*, Volume II, Section 6, Net Revenue.

assumptions. That is the only way to ensure that projects compete on the basis of actual costs rather than on the basis of modeling assumptions.<sup>80</sup> (Priority: High. First reported 2013. Status: Not adopted.)

- The MMU recommends two changes to the RPM solution methodology related to make-whole payments and the iterative reconfiguration of the VRR curve:
  - The MMU recommends changing the RPM solution methodology to explicitly incorporate the cost of make-whole payments in the objective function. (Priority: Medium. First reported 2014. Status: Not adopted.)
  - The MMU also recommends changing the RPM solution methodology to define variables for the nesting relationships in the BRA optimization model directly rather than employing the current iterative approach, in order to improve the efficiency and stability. (Priority: Medium. First reported 2014. Status: Not adopted.)
- The MMU recommends that the use of the 2.5 percent demand adjustment (Short Term Resource Procurement Target) be terminated immediately. The 2.5 percent should be added back to the overall market demand curve. (Priority: Medium. First reported 2013. Status: Adopted.)
- The MMU recommends that the definition of demand side resources be modified in order to ensure that such resources be fully substitutable for other generation capacity resources. Both the Limited and the Extended Summer DR products should be eliminated in order to ensure that the DR product has the same unlimited obligation to provide capacity year round as generation capacity resources. (Priority: High. First reported 2013. Status: Adopted.)
- The MMU recommends three changes with respect to capacity imports into PJM:

- The MMU recommends that all capacity have firm transmission to the PJM border acquired prior to the offering in an RPM auction. (Priority: High. First reported 2014. Status: Adopted.)
- The MMU recommends that all capacity imports be required to be deliverable to PJM load prior to the relevant Delivery Year to ensure that they are as close to full substitutes for internal, physical capacity resources as possible. Pseudo ties alone are not adequate to ensure deliverability. (Priority: High. New recommendation. Status: Adopted.)
- The MMU recommends that all capacity imports be required to be pseudo tied prior to the relevant Delivery Year in order to ensure that imports are as close to full substitutes for internal, physical capacity resources as possible. (Priority: High. First reported 2014. Status: Adopted.)
- The MMU recommends that all resources importing capacity into PJM accept a must offer requirement. (Priority: High. First reported 2014. Status: Adopted.)
- The MMU recommends improvements to the performance incentive requirements of RPM:
  - The MMU recommends that Generation Capacity Resources be paid on the basis of whether they produce energy when called upon during any of the hours defined as critical. One hundred percent of capacity market revenue should be at risk rather than only fifty percent. (Priority: High. First reported 2012. Status: Adopted.)
  - The MMU recommends that a unit which is not capable of supplying energy consistent with its day-ahead offer should reflect an appropriate outage. (Priority: Medium. First reported 2013. Status: Not adopted. Pending before FERC.)
  - The MMU recommends that PJM eliminate all OMC outages from the calculation of forced outage rates used for any purpose in the PJM Capacity Market. (Priority: Medium. First reported 2012. Status: Adopted 2015.)

<sup>80</sup> See 143 FERC ¶ 61,090 (2013) (“We encourage PJM and its stakeholders to consider, for example, whether the unit-specific review process would be more effective if PJM requires the use of common modeling assumptions for establishing unit-specific offer floors while, at the same time, allowing sellers to provide support for objective, individual cost advantages. Moreover, we encourage PJM and its stakeholders to consider these modifications to the unit-specific review process together with possible enhancements to the calculation of Net CONE.”); see also, Comments of the Independent Market Monitor for PJM, Docket No. ER13-535-001 (March 25, 2013); Complaint of the Independent Market Monitor for PJM v. Unnamed Participant, Docket No. EL12-63-000 (May 1, 2012); Motion for Clarification of the Independent Market Monitor for PJM, Docket No. ER11-2875-000, et al. (February 17, 2012); Protest of the Independent Market Monitor for PJM, Docket No. ER11-2875-002 (June 2, 2011); Comments of the Independent Market Monitor for PJM, Docket Nos. EL11-20 and ER11-2875 (March 4, 2011).

- The MMU recommends that PJM eliminate the broad exception related to lack of gas during the winter period for single-fuel, natural gas-fired units.<sup>81</sup> (Priority: Medium. First reported 2013. Status: Adopted 2015.)
- The MMU recommends that treatment of costs in RMR filings be emphasized. Customers should bear all the incremental costs, including incremental investment costs, required by the RMR service that the unit owner would not have incurred if the unit owner had deactivated its unit as it proposed. Generation owners should bear all other costs. (Priority: Low. First reported 2010. Status: Not adopted.)

## Section 5 – Conclusion

The analysis of PJM Capacity Markets begins with market structure, which provides the framework for the actual behavior or conduct of market participants. The analysis examines participant behavior within that market structure. In a competitive market structure, market participants are constrained to behave competitively. The analysis examines market performance, measured by price and the relationship between price and marginal cost, that results from the interaction of market structure and participant behavior.

The MMU found serious market structure issues, measured by the three pivotal supplier test results, but no exercise of market power in the PJM Capacity Market in the first three months of 2016. Explicit market power mitigation rules in the RPM construct offset the underlying market structure issues in the PJM Capacity Market under RPM. The PJM Capacity Market results were competitive in the first three months of 2016.

The MMU has identified serious market design issues with RPM and the MMU has made specific recommendations to address those issues.<sup>82 83 84 85</sup>

<sup>81</sup> See OATT Attachment DD § 10(e). For more on this issue and related incentive issues, see the MMU's White Paper included in: Monitoring Analytics, LLC and PJM Interconnection, LLC, "Capacity in the PJM Market," <[http://www.monitoringanalytics.com/reports/Reports/2012/IMM\\_And\\_PJM\\_Capacity\\_White\\_Papers\\_On\\_OPSI\\_Issues\\_20120820.pdf](http://www.monitoringanalytics.com/reports/Reports/2012/IMM_And_PJM_Capacity_White_Papers_On_OPSI_Issues_20120820.pdf)> (August 20, 2012).

<sup>82</sup> See "Analysis of the 2013/2014 RPM Base Residual Auction Revised and Updated," <[http://www.monitoringanalytics.com/reports/Reports/2010/Analysis\\_of\\_2013\\_2014\\_RPM\\_Base\\_Residual\\_Auction\\_20090920.pdf](http://www.monitoringanalytics.com/reports/Reports/2010/Analysis_of_2013_2014_RPM_Base_Residual_Auction_20090920.pdf)> (September 20, 2010).

<sup>83</sup> See "Analysis of the 2014/2015 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2012/Analysis\\_of\\_2014\\_2015\\_RPM\\_Base\\_Residual\\_Auction\\_20120409.pdf](http://www.monitoringanalytics.com/reports/Reports/2012/Analysis_of_2014_2015_RPM_Base_Residual_Auction_20120409.pdf)> (April 9, 2012).

<sup>84</sup> See "Analysis of the 2015/2016 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2013/Analysis\\_of\\_2015\\_2016\\_RPM\\_Base\\_Residual\\_Auction\\_20130924.pdf](http://www.monitoringanalytics.com/reports/Reports/2013/Analysis_of_2015_2016_RPM_Base_Residual_Auction_20130924.pdf)> (September 24, 2013).

<sup>85</sup> See "Analysis of the 2016/2017 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2014/IMM\\_Analysis\\_of\\_the\\_20162017\\_RPM\\_Base\\_Residual\\_Auction\\_20140418.pdf](http://www.monitoringanalytics.com/reports/Reports/2014/IMM_Analysis_of_the_20162017_RPM_Base_Residual_Auction_20140418.pdf)> (April 18, 2014).

<sup>86</sup> In 2015 and 2016, the MMU prepared a number of RPM-related reports and testimony, shown in Table 5-2. The Capacity Performance modifications to the RPM construct have significantly improved the capacity market and addressed many of the issues identified by the MMU. The MMU will publish more detailed reports on the first Capacity Performance BRA for 2018/2019 and on the CP Transition Incremental Auctions which include more specific issues and suggestions for improvements.

## Overview: Section 6, "Demand Response"

- **Demand Response Jurisdiction.** In a panel decision issued May 23, 2014, the U.S. Court of Appeals for the District of Columbia Circuit vacated Order No. 745, which provided for payment of demand-side resources at full LMP.<sup>87</sup> The court found that the FERC lacked jurisdiction to issue Order No. 745 because the "rule entails direct regulation of the retail market - a matter exclusively within state control."<sup>88</sup> On January 25, 2016, the Supreme Court voted 6-2 to reverse the decision of the lower court.<sup>89</sup> The result is that FERC retains jurisdiction over demand-side programs.
- **Demand Response Activity.** Demand response includes the economic program and the emergency program. The economic program includes the response to energy prices in the energy market. The emergency and pre-emergency program is the capacity market program which includes both capacity payments and associated energy revenues when the capacity is called on to respond.<sup>90</sup> The emergency program accounted for 99.1 percent of all revenue received by demand response providers, the economic program for 0.5 percent and synchronized reserve for 0.3 percent. In the first three months of 2016, total emergency revenue increased by \$55.7 million, or 33.0 percent, from \$168.9 million in the first three months of 2015 to \$224.6 million in the first three months of 2016. Capacity market revenue increased by \$55.7 million, or 33.0 percent, from \$168.9 million in the first three months of 2015 to \$224.6 million the first three

<sup>86</sup> See "Analysis of the 2017/2018 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2014/IMM\\_Analysis\\_of\\_the\\_2017\\_2018\\_RPM\\_Base\\_Residual\\_Auction\\_20141006.pdf](http://www.monitoringanalytics.com/reports/Reports/2014/IMM_Analysis_of_the_2017_2018_RPM_Base_Residual_Auction_20141006.pdf)> (October 6, 2014).

<sup>87</sup> *Electric Power Supply Association v. FERC*, No. 11-1486, *petition for en banc review denied*; see *Demand Response Compensation in Organized Wholesale Energy Markets*, Order No. 745, FERC Stats. & Regs. ¶ 31,322 (2011); *order on reh'g*, Order No. 745-A, 137 FERC ¶ 61,215 (2011); *order on reh'g*, Order No. 745-B, 138 FERC 61,148 (2012).

<sup>88</sup> *Id.*

<sup>89</sup> *FERC v. Electric Power Supply Association*, Slip Op. No. 14-840.

<sup>90</sup> Throughout this document, emergency demand response refers to both emergency and pre-emergency demand response.

months of 2016.<sup>91</sup> Economic program revenue decreased by \$3.0 million, from \$4.2 million in the first three months of 2015 to \$1.2 million in the first three months of 2016, a 71.3 percent decrease.<sup>92</sup> Synchronized reserve revenue decreased by \$0.9 million, a 55.5 percent decrease. Total demand response revenue in the first three months of 2016 increased by 29.7 percent from \$174.8 million the first three months of 2015 to \$226.6 million in the first three months of 2016. Not all DR activities in the first three months 2016 have been reported to PJM at the time of this report.

All demand response energy payments are uplift. LMP does not cover demand response energy payments although emergency demand response can and does set LMP. Emergency demand response energy costs are paid by PJM market participants in proportion to their net purchases in the real-time market. Economic demand response energy costs are paid by real-time exports from the PJM Region and real-time loads in each zone for which the load-weighted average real-time LMP for the hour during which the reduction occurred is greater than the single system price determined under the net benefits test for that month.<sup>93</sup>

- **Demand Response Market Concentration.** The ownership of economic demand response was highly concentrated in the first three months of 2015 and 2016. The HHI for economic demand response reductions increased from 7623 in the first three months of 2015 to 8055 in 2016. The ownership of emergency demand response was moderately concentrated in 2015. The HHI for emergency demand response registrations was 1760 for the 2014/2015 Delivery Year and 1497 for the 2015/2016 Delivery Year. In the first three months of 2016, the four largest companies contributed 65.3 percent of all registered emergency demand response resources.
- **Locational Dispatch of Demand Resources.** Beginning with the 2014/2015 Delivery Year, demand resources are dispatchable for mandatory reduction on a subzonal basis, defined by zip codes, only if the subzone is defined at least one day before it is dispatched. More locational dispatch of demand resources in a nodal market improves market efficiency. The goal should

be nodal dispatch of demand resources with no advance notice required as is the case for generation resources.

## Section 6 – Recommendations

The MMU recognizes that PJM has incorporated some of these recommendations in the Capacity Performance filing. The status of each recommendation reflects the status at March 31, 2016.

- The MMU recommends, as a preferred alternative to having PJM demand side programs, that demand response be on the demand side of the markets and that customers be able to avoid capacity and energy charges by not using capacity and energy at their discretion and that customer payments be determined only by metered load. (Priority: High. First reported 2014. Status: Not adopted.)
- The MMU recommends that there be only one demand response product, with an obligation to respond when called for all hours of the year, and that the demand response be on the demand side of the capacity market. (Priority: High. First reported 2011. Status: Partially Adopted.<sup>94</sup>)
- The MMU recommends that the option to specify a minimum dispatch price under the Emergency and Pre-Emergency Program Full option be eliminated and that participating resources receive the hourly real-time LMP less any generation component of their retail rate. (Priority: Medium. First reported 2010. Status: Not adopted.)
- The MMU recommends that the emergency load response program be classified as an economic program, responding to economic price signals and not an emergency program responding only after an emergency is called and not triggering the definition of a PJM emergency. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends that the Emergency Program Energy Only option be eliminated because the opportunity to receive the appropriate energy market incentive is already provided in the Economic Program. (Priority: Low. First reported 2010. Status: Not adopted.)

<sup>91</sup> The total credits and MWh numbers for demand resources were calculated as of April 18, 2016 and may change as a result of continued PJM billing updates.

<sup>92</sup> Economic credits are synonymous with revenue received for reductions under the economic load response program.

<sup>93</sup> PJM: "Manual 28: Operating Agreement Accounting," Revision 64 (April 11, 2014), p. 70.

<sup>94</sup> PJM's Capacity Performance proposal includes this change. See "Reforms to the Reliability Pricing Market ("RPM") and Related Rules in the PJM Open Access Transmission Tariff ("Tariff") and Reliability Assurance Agreement Among Load Serving Entities ("RAA)," Docket No. ER15-632-000 and "PJM Interconnection, L.L.C." Docket No. EL15-29-000.

- The MMU recommends that a daily energy market must offer requirement apply to demand resources, comparable to the rule applicable to generation capacity resources.<sup>95</sup> (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that the lead times for demand resources be shortened to 30 minutes with an hour minimum dispatch for all resources. (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends that demand resources be required to provide their nodal location, comparable to generation resources. (Priority: High. First reported 2011. Status: Not adopted.)
- The MMU recommends that PJM require nodal dispatch of demand resources with no advance notice required or, if nodal location is not required, subzonal dispatch of demand resources with no advance notice required. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM eliminate the measurement of compliance across zones within a compliance aggregation area (CAA). The multiple zone approach is less locational than the zonal and subzonal approach and creates larger mismatches between the locational need for the resources and the actual response. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends capping the baseline for measuring compliance under GLD, for the limited summer product, at the customers' PLC. (Priority: High. First reported 2010. Status: Adopted.)
- The MMU recommends capping the baseline for measuring capacity compliance under winter compliance at the customers' PLC, similar to GLD, to avoid double counting. (Priority: High. First reported 2010. Status: Partially adopted.)
- The MMU recommends that measurement and verification methods for demand resources be modified to reflect compliance more accurately. (Priority: Medium. First reported 2009. Status: Not adopted.)
- The MMU recommends that compliance rules be revised to include submittal of all necessary hourly load data, and that negative values be included when calculating event compliance across hours and registrations. (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM adopt the ISO-NE five-minute metering requirements in order to ensure that dispatchers have the necessary information for reliability and that market payments to demand resources be calculated based on interval meter data at the site of the demand reductions.<sup>96</sup> (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that demand response event compliance be calculated for each hour and the penalty structure reflect hourly compliance for the base and capacity performance products. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that demand resources whose load drop method is designated as "Other" explicitly record the method of load drop. (Priority: Low. First reported 2013. Status: Adopted, Q2, 2014.)
- The MMU recommends that load management testing be initiated by PJM with limited warning to CSPs in order to more accurately represent the conditions of an emergency event. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that shutdown cost be defined as the cost to curtail load for a given period that does not vary with the measured reduction or, for behind the meter generators, be the start cost defined in Manual 15 for generators. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that the Net Benefits Test be eliminated and that demand response resources be paid LMP less any generation component of the applicable retail rate. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that the tariff rules for demand response clarify that a resource and its CSP, if any, must notify PJM of material changes

<sup>95</sup> See "Complaint and Motion to Consolidate of the Independent Market Monitor for PJM," Docket No. EL14-20-000 (January 27, 2014) at 1.

<sup>96</sup> See ISO-NE Tariff, Section III, Market Rule 1, Appendix E1 and Appendix E2, "Demand Response," <[http://www.iso-ne.com/regulatory/tariff/sect\\_3/mr1\\_append-e.pdf](http://www.iso-ne.com/regulatory/tariff/sect_3/mr1_append-e.pdf)>. (Accessed February 17, 2015) ISO-NE requires that DR have an interval meter with five minute data reported to the ISO and each behind the meter generator is required to have a separate interval meter. After June 1, 2017, demand response resources in ISO-NE must also be registered at a single node.

affecting the capability of the resource to perform as registered and to terminate registrations that are no longer capable of responding to PJM dispatch directives because load has been reduced or eliminated, such as in the case of bankrupt and/or out of service facilities. (Priority: Medium. First reported 2015. Status: Not adopted.)

## Section 6 - Conclusion

A fully functional demand side of the electricity market means that end use customers or their designated intermediaries will have the ability to see real-time energy price signals in real time, will have the ability to react to real-time prices in real time and will have the ability to receive the direct benefits or costs of changes in real-time energy use. In addition, customers or their designated intermediaries will have the ability to see current capacity prices, will have the ability to react to capacity prices and will have the ability to receive the direct benefits or costs of changes in the demand for capacity in the same year in which demand for capacity changes. A functional demand side of these markets means that customers will have the ability to make decisions about levels of power consumption based both on the value of the uses of the power and on the actual cost of that power.

In the energy market, if there is to be a demand side program, demand resources should be paid the value of energy, which is LMP less any generation component of the applicable retail rate. There is no reason to have the net benefits test. The necessity for the net benefits test is an illustration of the illogical approach to demand side compensation embodied in paying full LMP to demand resources. The benefit of demand side resources is not that they suppress market prices, but that customers can choose not to consume at the current price of power, that individual customers benefit from their choices and that the choices of all customers are reflected in market prices. If customers face the market price, customers should have the ability to not purchase power and the market impact of that choice does not require a test for appropriateness.

If demand resources are to continue competing directly with generation capacity resources in the PJM Capacity Market, the product must be defined

such that it can actually serve as a substitute for generation. This is a prerequisite to a functional market design.

In order to be a substitute for generation, demand resources should be defined in PJM rules as an economic resource, as generation is defined. Demand resources should be required to offer in the Day-Ahead Energy Market and should be called when the resources are required and prior to the declaration of an emergency. Demand resources should be available for every hour of the year and not be limited to a small number of hours.

In order to be a substitute for generation, demand resources should be subject to robust measurement and verification techniques to ensure that transitional DR programs incent the desired behavior. The methods used in PJM programs today are not adequate to determine and quantify deliberate actions taken to reduce consumption.

In order to be a substitute for generation, demand resources should provide a nodal location and should be dispatched nodally to enhance the effectiveness of demand resources and to permit the efficient functioning of the energy market. Both subzonal and multi-zone compliance should be eliminated because they are inconsistent with an efficient nodal market.

In order to be a substitute for generation, compliance by demand resources to PJM dispatch instructions should include both increases and decreases in load. The current method applied by PJM simply ignores increases in load and thus artificially overstates compliance.

In order to be a substitute for generation, reductions should be calculated hourly for dispatched DR. The current rules use the average reduction for the duration of an event. The average reduction across multiple hours does not provide an accurate metric for each hour of the event and is inconsistent with the measurement of generation resources. Measuring compliance hourly would provide accurate information to the PJM system. Under the new CP rules, the performance of demand response during Performance Assessment Hours will

be measured on an hourly basis. Overall demand response compliance is still measured by performance across the entire event.<sup>97</sup>

In order to be a substitute for generation, any demand resource and its Curtailment Service Provider (CSP), should be required to notify PJM of material changes affecting the capability of the resource to perform as registered and to terminate registrations that are no longer capable of responding to PJM dispatch directives, such as in the case of bankrupt and out of service facilities. Generation resources are required to inform PJM of any change in availability status, including outages and shutdown status.

As a preferred alternative, demand response should be on the demand side of the capacity market rather than on the supply side. Rather than complex demand response programs with their attendant complex and difficult to administer rules, customers would be able to avoid capacity and energy charges by not using capacity and energy at their discretion.

The long term appropriate end state for demand resources in the PJM markets should be comparable to the demand side of any market. Customers should use energy as they wish and that usage will determine the amount of capacity and energy for which each customer pays. There would be no counterfactual measurement and verification.

Under this approach, customers that wish to avoid capacity payments would reduce their load during expected high load hours. Capacity costs would be assigned to LSEs and by LSEs to customers, based on actual load on the system during these critical hours. Customers wishing to avoid high energy prices would reduce their load during high price hours. Customers would pay for what they actually use, as measured by meters, rather than relying on flawed measurement and verification methods. No M&V estimates are required. No promises of future reductions which can only be verified by M&V are required. To the extent that customers enter into contracts with CSPs or LSEs to manage their payments, M&V can be negotiated as part of a bilateral commercial contract between a customer and its CSP or LSE.

<sup>97</sup> PJM "Manual 18: Capacity Market," Revision 29 (October 16, 2015), p 148.

This approach provides more flexibility to customers to limit usage at their discretion. There is no requirement to be available year round or every hour of every day. There is no 30 minute notice requirement. There is no requirement to offer energy into the day-ahead market. All decisions about interrupting are up to the customers only and they may enter into bilateral commercial arrangements with CSPs at their sole discretion. Customers would pay for capacity and energy depending solely on metered load.

A transition to this end state should be defined in order to ensure that appropriate levels of demand side response are incorporated in PJM's load forecasts and thus in the demand curve in the capacity market for the next three years. That transition should be defined by the PRD rules, modified as proposed by the Market Monitor.

This approach would work under the current RPM design and this approach would work under the CP design. This approach is entirely consistent with the Supreme Court decision in *EPSA* as it does not depend on whether FERC has jurisdiction over the demand side. This approach will allow FERC to more fully realize its overriding policy objective to create competitive and efficient wholesale energy markets. The decision of the Supreme Court addressed jurisdictional issues and did not address the merits of FERC's approach. The Supreme Court's decision has removed the uncertainty surrounding the jurisdictional issues and created the opportunity for FERC to revisit its approach to demand side.

## Overview: Section 7, "Net Revenue"

### Net Revenue

- Energy net revenues are significantly affected by fuel prices and energy prices. Coal and natural gas prices and energy prices were lower in the first three months of 2016 than in the first three months of 2015. Net revenues from the energy market for all plant types were affected by the lower prices.
- In the first three months of 2016, average energy market net revenues decreased from the first three months of 2015 by 62 percent for a new

CT, 51 percent for a new CC, 82 percent for a new CP, 85 percent for a new DS, 56 percent for a new nuclear plant, 38 percent for a new wind installation, and 62 percent for a new solar installation.

## Section 7 - Conclusion

Wholesale electric power markets are affected by externally imposed reliability requirements. A regulatory authority external to the market makes a determination as to the acceptable level of reliability which is enforced through a requirement to maintain a target level of installed or unforced capacity. The requirement to maintain a target level of installed capacity can be enforced via a variety of mechanisms, including government construction of generation, full-requirement contracts with developers to construct and operate generation, state utility commission mandates to construct capacity, or capacity markets of various types. Regardless of the enforcement mechanism, the exogenous requirement to construct capacity in excess of what is constructed in response to energy market signals has an impact on energy markets. The reliability requirement results in maintaining a level of capacity in excess of the level that would result from the operation of an energy market alone. The result of that additional capacity is to reduce the level and volatility of energy market prices and to reduce the duration of high energy market prices. This, in turn, reduces net revenue to generation owners which reduces the incentive to invest. The exact level of both aggregate and locational excess capacity is a function of the calculation methods used by RTOs and ISOs.

## Overview: Section 8, “Environmental and Renewables”

### Federal Environmental Regulation

- **EPA Mercury and Air Toxics Standards Rule.** On December 16, 2011, the U.S. Environmental Protection Agency (EPA) issued its Mercury and Air Toxics Standards rule (MATS), which applies the Clean Air Act (CAA) maximum achievable control technology (MACT) requirement to new or modified sources of emissions of mercury and arsenic, acid gas, nickel,

selenium and cyanide.<sup>98</sup> The rule established a compliance deadline of April 16, 2015.

In a related EPA rule also issued on December 16, 2011, regarding utility New Source Performance Standards (NSPS), the EPA requires new coal and oil fired electric utility generating units constructed after May 3, 2011, to comply with amended emission standards for SO<sub>2</sub>, NO<sub>x</sub> and filterable particulate matter (PM).

On June 29, 2015, the U.S. Supreme Court remanded MATS to the D.C. Circuit Court and ordered the EPA to consider cost earlier in the process when making the decision whether to regulate power plants under MATS.<sup>99</sup> On April 14, 2016, the EPA issued the finding that “a consideration of cost does not cause us to change our determination that regulation of hazardous air pollutant (HAP) emissions from coal- and oil-fired EGUs is appropriate and necessary.”<sup>100</sup>

- **Air Quality Standards (NO<sub>x</sub> and SO<sub>2</sub> Emissions).** The CAA requires each state to attain and maintain compliance with fine PM and ozone national ambient air quality standards (NAAQS). Much recent regulatory activity concerning emissions has concerned the development and implementation of a transport rule to address the CAA’s requirement that each state prohibit emissions that significantly interfere with the ability of another state to meet NAAQS.<sup>101</sup>

On April 29, 2014, the U.S. Supreme Court upheld the EPA’s Cross-State Air Pollution Rule (CSAPR) and on October 23, 2014, the U.S. Court of Appeals for the District of Columbia Circuit lifted the stay imposed on CSAPR, clearing the way for the EPA to implement this rule and to replace the Clean Air Interstate Rule (CAIR).<sup>102 103</sup>

<sup>98</sup> *National Emission Standards for Hazardous Air Pollutants From Coal and Oil-Fired Electric Utility Steam Generating Units and Standards of Performance for Fossil Fuel Fired Electric Utility, Industrial-Commercial-Institutional, and Small Industrial-Commercial-Institutional Steam Generating Units*, EPA Docket No. EPA-HQ-OAR-2009-0234, 77 Fed. Reg. 9304 (February 16, 2012).

<sup>99</sup> *Michigan et al. v. EPA*, Slip Op. No. 14-46.

<sup>100</sup> *Supplemental Finding that it is Appropriate and Necessary to Regulate Hazardous Air Pollutants from Coal- and Oil-Fired Electric Utility Steam Generating Units*, EPA Docket No. EPA-HQ-OAR-2009-0234; see also *White Stallion Energy Center, LLC v. EPA*, Slip Op. No. 12-1100 (D.C. Cir. 2015) [per curiam].

<sup>101</sup> CAA § 110(a)(2)(D)(i)(I).

<sup>102</sup> See *EPA et al. v. EME Homer City Generation, L.P. et al.*, 134 S. Ct. 1584 (2014), reversing 696 F.3d 7 (D.C. Cir. 2012).

<sup>103</sup> See *EME Homer City Generation, L.P. v. EPA et al.*, No. 11-1302.

In the same decision, the U.S. Supreme Court remanded “particularized as-applied challenge[s]” to the EPA’s 2014 emissions budgets.<sup>104</sup> On July 28, 2015, on remand, the U.S. Court of Appeals for the District of Columbia Circuit invalidated the 2014 SO<sub>2</sub> budgets for a number of states, including PJM states Maryland, New Jersey, North Carolina, Ohio, Pennsylvania, Virginia and West Virginia.<sup>105</sup> The court directed the EPA to reconsider the 2015 emissions budgets for these states based on the actual amount of reduced emissions that states in upwind states needed to attain in order to bring each downwind state into attainment.<sup>106</sup> Under the invalidated approach, the EPA calculated how much pollution each upwind state could eliminate if all of its sources applied pollution control at particular cost thresholds.<sup>107</sup> A new approach likely will significantly reduce the emission budgets (lower emissions levels will be allowed) for the indicated states. The court did not vacate the currently assigned budgets which remain effective until replaced.<sup>108</sup>

On November 21, 2014, the EPA issued a rule tolling by three years CSAPR’s original deadlines. The rule means that compliance with CSAPR’s Phase 1 emissions budgets is now required in 2015 and 2016 and CSAPR’s Phase 2 emissions in 2017 and beyond.<sup>109</sup>

- **National Emission Standards for Reciprocating Internal Combustion Engines.** On May 1, 2015, the U.S. Court of Appeals for the District of Columbia Circuit reversed the portion of the final rule exempting 100 hours of run time for certain stationary reciprocating internal combustion engines (RICE) participating in emergency demand response programs.<sup>110</sup> As a result, the national emissions standards uniformly apply to all RICE.<sup>111</sup> The Court held that the “EPA acted arbitrarily and capriciously when it modified the National Emissions Standards and the Performance Standards to allow backup generators to operate without emissions

<sup>104</sup> 134 S. Ct. at 1609.

<sup>105</sup> *EME Homer City Generation, L.P. v. EPA et al.*, Slip Op. No. 11-1302 (July 28, 2015).

<sup>106</sup> *Id.* at 11–12.

<sup>107</sup> *Id.* at 11.

<sup>108</sup> Emissions Budget Decision at 24–25.

<sup>109</sup> *Rulemaking to Amend Dates in Federal Implementation Plans Addressing Interstate Transport of Ozone and Fine Particulate Matter*, EPA-HQ-OAR-2009-0491 (Nov. 21, 2014).

<sup>110</sup> *Delaware Department of Natural Resources and Environmental Control (DENREC) v. EPA*, Slip Op. No. 13-1093; *National Emission Standards for Hazardous Air Pollutants for Reciprocating Internal Combustion Engines; New Source Performance Standards for Stationary Internal Combustion Engines*, Final Rule, EPA Docket No. EPA-HQ-OAR-2008-0708, 78 Fed. Reg. 9403 (January 30, 2013).

<sup>111</sup> *Id.*

controls for up to 100 hours per year as part of an emergency demand-response program.”<sup>112</sup> Specifically, the Court found that the EPA failed to consider arguments concerning the rule’s “impact on the efficiency and reliability of the energy grid,” including arguments raised by the MMU.<sup>113</sup> On May 3, 2016, the Court issued a mandate to implement the May 1, 2015, order.

- **Greenhouse Gas Emissions Rule.** On August 3, 2015, the EPA issued a final rule for regulating CO<sub>2</sub> from certain existing power generation facilities titled *Carbon Pollution Emission Guidelines for Existing Stationary Sources: Electric Utility Generating Units (the Clean Power Plan)*.<sup>114</sup> The rule requires that individual state plans be submitted by September 6, 2016. However, on February 9, 2016, the U.S. Supreme Court issued a stay on the rule that will prevent its taking effect until judicial review is completed.<sup>115</sup>
- **Cooling Water Intakes.** The EPA has promulgated a rule implementing Section 316(b) of the Clean Water Act (CWA), which requires that cooling water intake structures reflect the best technology available for minimizing adverse environmental impacts.<sup>116</sup> The rule is implemented as National Pollutant Discharge Elimination System (NPDES) permits are issued, with exceptions in certain cases for permits expiring prior to July 14, 2018.
- **Waste Disposal.** On December 19, 2014, the EPA issued its Coal Combustion Residuals rule (CCRR), effective October 19, 2015. The CCRR likely will raise the costs of disposal of CCRs to meet the EPA criteria.

## State Environmental Regulation

- **NJ High Electric Demand Day (HEDD) Rule.** New Jersey addressed the issue of NO<sub>x</sub> emissions on peak energy demand days with a rule that defines peak energy usage days, referred to as high electric demand days

<sup>112</sup> *DENREC v. EPA* at 3, 20–21.

<sup>113</sup> *Id.* at 22, citing Comments of the Independent Market Monitor for PJM, EPA Docket No. EPA-HQ-OAR-2008-0708 (August 9, 2012) at 2.

<sup>114</sup> *Carbon Pollution Emission Guidelines for Existing Stationary Sources: Electric Utility Generating Units*, EPA-HQ-OAR-2013-0602, Final Rule *mimeo* (August 3, 2015), also known as the “Clean Power Plan.”

<sup>115</sup> *North Dakota v. EPA, et al.*, Order 15A793.

<sup>116</sup> See EPA, *National Pollutant Discharge Elimination System—Final Regulations to Establish Requirements for Cooling Water Intake Structures at Existing Facilities and Amend Requirements at Phase I Facilities*, EPA-HQ-OW-2008-0667, 79 Fed. Reg. 48300 (Aug. 15, 2014).

or HEDD, and imposes operational restrictions and emissions control requirements on units responsible for significant NO<sub>x</sub> emissions on such high energy demand days.<sup>117</sup> New Jersey's HEDD rule, which became effective May 19, 2009, applies to HEDD units, which include units that have a NO<sub>x</sub> emissions rate on HEDD equal to or exceeding 0.15 lbs/MMBtu and lack identified emission control technologies.<sup>118</sup>

- **Illinois Air Quality Standards (NO<sub>x</sub>, SO<sub>2</sub> and Hg).** The State of Illinois has promulgated its own standards for NO<sub>x</sub>, SO<sub>2</sub> and Hg (mercury) known as Multi-Pollutant Standards ("MPS") and Combined Pollutants Standards ("CPS").<sup>119</sup> MPS and CPS establish standards that are more stringent and take effect earlier than comparable Federal regulations, such as the EPA MATS rule.
- **Regional Greenhouse Gas Initiative (RGGI).** The Regional Greenhouse Gas Initiative (RGGI) is a cooperative effort by Connecticut, Delaware, Maine, Maryland, Massachusetts, New Hampshire, New York, Rhode Island, and Vermont to cap CO<sub>2</sub> emissions from power generation facilities and facilitate trading of emissions allowances. Auction prices in the first three months of 2016 for the 2015–2017 compliance period were \$5.25 per ton. The clearing price is equivalent to a price of \$5.79 per metric tonne, the unit used in other carbon markets.

## Emissions Controls in PJM Markets

Environmental regulations affect decisions about emission control investments in existing units, investment in new units and decisions to retire units lacking emission controls. As a result of environmental regulations and agreements to limit emissions, many PJM units burning fossil fuels have installed emission control technology. On December 31, 2015, 76.7 percent of coal steam MW had some type of FGD (flue-gas desulfurization) technology to reduce SO<sub>2</sub> emissions, while 99.5 percent of coal steam MW had some type of particulate control, and 92.8 percent of fossil fuel fired capacity in PJM had NO<sub>x</sub> emission control technology.

<sup>117</sup> N.J.A.C. § 7:27–19.

<sup>118</sup> CTS must have either water injection or selective catalytic reduction (SCR) controls; steam units must have either an SCR or selective non-catalytic reduction (SNCR).

<sup>119</sup> 35 Ill. Admin. Code §§ 225.233 (Multi-Pollutant Standard (MPS)), 224.295 (Combined Pollutant Standard: Emissions Standards for NO<sub>x</sub> and SO<sub>2</sub> (CPS)).

## State Renewable Portfolio Standards

Many PJM jurisdictions have enacted legislation to require that a defined percentage of retail suppliers' load be served by renewable resources, for which there are many standards and definitions. These are typically known as renewable portfolio standards, or RPS. As of March 31, 2016, Delaware, Illinois, Maryland, Michigan, New Jersey, North Carolina, Ohio, Pennsylvania, and Washington D.C. had renewable portfolio standards. Virginia and Indiana have enacted voluntary renewable portfolio standards. Kentucky and Tennessee have not enacted renewable portfolio standards. Ohio delayed a scheduled increase from 2.5 percent to 3.5 percent in its RPS standards from 2015 until 2017 and removed the 12.5 percent alternative energy requirement. Ohio currently has an ongoing Ohio Energy Mandates Study Committee that is discussing the costs and benefits of the RPS as outlined in Senate Bill 310.<sup>120</sup> West Virginia had a voluntary standard, but the state Legislature repealed the West Virginia renewable portfolio standard on January 22, 2015.

## Section 8 – Conclusion

Environmental requirements and renewable energy mandates at both the federal and state levels have a significant impact on the cost of energy and capacity in PJM markets. Attempts to extend the definition of renewable energy to include nuclear power in order to provide subsidies to nuclear power could increase this impact if successful. Renewable energy credit markets are markets related to the production and purchase of wholesale power, but FERC has determined that RECs are not regulated under the Federal Power Act unless the REC is sold as part of a transaction that also includes a wholesale sale of electric energy in a bundled transaction.<sup>121</sup>

Renewable energy credits (RECs), federal investment tax credits and federal production tax credits provide out of market payments to qualifying resources, primarily wind and solar, which create an incentive to generate MWh until the LMP is equal to the marginal cost of producing power minus the credit

<sup>120</sup> See Ohio Senate Bill 310.

<sup>121</sup> See 139 FERC ¶ 61,061 at PP 18, 22 (2012) ("[W]e conclude that unbundled REC transactions fall outside of the Commission's jurisdiction under sections 201, 205 and 206 of the FPA. We further conclude that bundled REC transactions fall within the Commission's jurisdiction under sections 201, 205 and 206 of the FPA.... [A]lthough a transaction may not directly involve the transmission or sale of electric energy, the transaction could still fall under the Commission's jurisdiction because it is "in connection with" or "affects" jurisdictional rates or charges."

received for each MWh. The credits provide an incentive to make negative energy offers and more generally provide an incentive to operate whenever possible. These subsidies affect the offer behavior and the operational behavior of these resources in PJM markets and thus the market prices and the mix of clearing resources.

RECs clearly affect prices in the PJM wholesale power market. Some resources are not economic except for the ability to purchase or sell RECs. REC markets are not transparent. Data on REC prices and markets are not publicly available for all PJM states. RECs markets are, as an economic fact, integrated with PJM markets including energy and Capacity markets, but are not formally recognized as part of PJM markets.

PJM markets provide a flexible mechanism for incorporating the costs of environmental controls and meeting environmental requirements in a cost effective manner. Costs for environmental controls are part of bids for capacity resources in the PJM Capacity Market. The costs of emissions credits are included in energy offers. PJM markets also provide a flexible mechanism that incorporates renewable resources and the impacts of renewable energy credit markets, and ensure that renewable resources have access to a broad market. PJM markets provide efficient price signals that permit valuation of resources with very different characteristics when they provide the same product.

PJM markets could also provide a flexible mechanism for states to comply with the EPA's Clean Power Plan, for example by incorporating a carbon price in unit offers which would be reflected in PJM's economic dispatch. The imposition of specific and prescriptive environmental dispatch rules would, in contrast, pose a threat to economic dispatch and create very difficult market power monitoring and mitigation issues.

## Overview: Section 9, "Interchange Transactions"

### Interchange Transaction Activity

- **Aggregate Imports and Exports in the Real-Time Energy Market.** In the first three months of 2016, PJM was a net importer of energy in the

Real-Time Energy Market in all months.<sup>122</sup> In the first three months of 2016, the real-time net interchange of 5,689.8 GWh was higher than net interchange of 5,516.5 GWh in the first three months of 2015.

- **Aggregate Imports and Exports in the Day-Ahead Energy Market.** In the first three months of 2016, PJM was a net importer of energy in the Day-Ahead Energy Market in all months. In the first three months of 2016, the total day-ahead net interchange of 1,369.2 GWh was higher than net interchange of 212.5 GWh in the first three months of 2015. The large difference in the day-ahead net interchange totals was a result of up to congestion transaction volumes.<sup>123</sup>
- **Aggregate Imports and Exports in the Day-Ahead and the Real-Time Energy Market.** In the first three months of 2016, gross imports in the Day-Ahead Energy Market were 108.1 percent of gross imports in the Real-Time Energy Market (68.8 percent in the first three months of 2015). In the first three months of 2016, gross exports in the Day-Ahead Energy Market were 174.3 percent of the gross exports in the Real-Time Energy Market (103.9 percent in the first three months of 2015).
- **Interface Imports and Exports in the Real-Time Energy Market.** In the first three months of 2016, there were net scheduled exports at seven of PJM's 20 interfaces in the Real-Time Energy Market.
- **Interface Pricing Point Imports and Exports in the Real-Time Energy Market.** In the first three months of 2016, there were net scheduled exports at 10 of PJM's 18 interface pricing points eligible for real-time transactions in the Real-Time Energy Market.<sup>124</sup>
- **Interface Imports and Exports in the Day-Ahead Energy Market.** In the first three months of 2016, there were net scheduled exports at eight of PJM's 20 interfaces in the Day-Ahead Energy Market.
- **Interface Pricing Point Imports and Exports in the Day-Ahead Energy Market.** In the first three months of 2016, there were net scheduled

<sup>122</sup> Calculated values shown in Section 9, "Interchange Transactions," are based on unrounded, underlying data and may differ from calculations based on the rounded values in the tables.

<sup>123</sup> On August 29, 2014, FERC issued an Order which created an obligation for UTCs to pay any uplift determined to be appropriate in the Commission review, effective September 8, 2014. 18 CFR § 385.213.

<sup>124</sup> There is one interface pricing point eligible for day-ahead transaction scheduling only (NIPSCO).

exports at nine of PJM's 19 interface pricing points eligible for day-ahead transactions in the Day-Ahead Energy Market.

- **Up to Congestion Interface Pricing Point Imports and Exports in the Day-Ahead Energy Market.** In the first three months of 2016, up to congestion transactions were net exports at three of PJM's 19 interface pricing points eligible for day-ahead transactions in the Day-Ahead Market.
- **Inadvertent Interchange.** In the first three months of 2016, net scheduled interchange was 5,690 GWh and net actual interchange was 6,564 GWh, a difference of 874 GWh. In the first three months of 2015, the difference was 14 GWh. This difference is inadvertent interchange.
- **Loop Flows.** In the first three months of 2016, the Wisconsin Energy Corporation (WEC) interface had the largest loop flows of any interface with -153 GWh of net scheduled interchange and 2,340 GWh of net actual interchange, a difference of 2,493 GWh. (Table 9-18.) In the first three months of 2016, the SouthIMP interface pricing point had the largest loop flows of any interface pricing point with 5,766 GWh of net scheduled interchange and 8,674 GWh of net actual interchange, a difference of 2,908 GWh.

## Interactions with Bordering Areas

### PJM Interface Pricing with Organized Markets

- **PJM and MISO Interface Prices.** In the first three months of 2016, the direction of the hourly flow was consistent with the real-time hourly price differences between the PJM/MISO Interface and the MISO/PJM Interface in 57.4 percent of the hours.
- **PJM and New York ISO Interface Prices.** In the first three months of 2016, the direction of the hourly flow was consistent with the real-time hourly price differences between the PJM/NYIS Interface and the NYISO/PJM proxy bus in 57.0 percent of the hours.
- **Neptune Underwater Transmission Line to Long Island, New York.** In the first three months of 2016, the hourly flow (PJM to NYISO) was

consistent with the real-time hourly price differences between the PJM Neptune Interface and the NYISO Neptune bus in 53.7 percent of the hours.

- **Linden Variable Frequency Transformer (VFT) Facility.** In the first three months of 2016, the hourly flow (PJM to NYISO) was consistent with the real-time hourly price differences between the PJM Linden Interface and the NYISO Linden bus in 56.0 percent of the hours.
- **Hudson DC Line.** In the first three months of 2016, the hourly flow (PJM to NYISO) was consistent with the real-time hourly price differences between the PJM Hudson Interface and the NYISO Hudson bus in 0.9 percent of the hours.

## Interchange Transaction Issues

- **PJM Transmission Loading Relief Procedures (TLRs).** PJM issued eight TLRs of level 3a or higher in the first three months of 2016, compared to 16 such TLRs issued in the first three months of 2015.
- **Up to congestion.** On August 29, 2014, FERC issued an Order which created an obligation for up to congestion transactions to pay any uplift determined to be appropriate after Commission review, effective September 8, 2014.<sup>125</sup> As a result of the uncertainty about the level of the required uplift charges, market participants reduced up to congestion trading. There was an increase in up to congestion volume starting in December 2015, coincident with the expiration of the fifteen month limit on the payment of prior uplift charges.<sup>126</sup> The average number of up to congestion bids increased by 117.9 percent and the average cleared volume of up to congestion bids increased by 113.2 percent in the first three months of 2016, compared to the first three months of 2015.
- **45 Minute Schedule Duration Rule.** Effective May 19, 2014, PJM removed the 45 minute scheduling duration rule in response to FERC Order No. 764.<sup>127</sup> <sup>128</sup> PJM and the MMU issued a statement indicating

<sup>125</sup> 148 FERC ¶ 61,144 (2014). *Order Instituting Section 206 Proceeding and Establishing Procedures.*

<sup>126</sup> 16 U.S.C. § 824e.

<sup>127</sup> *Integration of Variable Energy Resources*, Order No. 764, 139 FERC ¶ 61,246 (2012), *order on reh'g*, Order No. 764-A, 141 FERC ¶ 61231 (2012).

<sup>128</sup> See Letter Order, Docket No. ER14-381-000 (June 30, 2014).

ongoing concern about market participants' scheduling behavior, and a commitment to address any scheduling behavior that raises operational or market manipulation concerns.<sup>129</sup>

## Section 9 – Recommendations

- The MMU recommends that PJM eliminate the IMO interface pricing point, and assign the transactions that originate or sink in the IESO balancing authority to the MISO interface pricing point. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM monitor, and adjust as necessary, the weights applied to the components of the interfaces to ensure that the interface prices reflect ongoing changes in system conditions. The MMU also recommends that PJM review the mappings of external balancing authorities to individual interface pricing points to reflect changes to the impact of the external power source on PJM tie lines as a result of system topology changes. The MMU recommends that this review occur at least annually. (Priority: Low. First reported 2009. Status: Not adopted.)
- The MMU recommends that the submission deadline for real-time dispatchable transactions be modified from 1800 on the day prior, to three hours prior to the requested start time, and that the minimum duration be modified from one hour to 15 minutes. These changes would give PJM a more flexible product that could be used to meet load in the most economic manner. (Priority: Medium. First reported 2014. Status: Adopted partially, Q1 2015.)
- The MMU recommends that PJM explore an interchange optimization solution with its neighboring balancing authorities that would remove the need for market participants to schedule physical transactions across seams. Such a solution would include an optimized, but limited, joint dispatch approach that uses supply curves and treats seams between balancing authorities as constraints, similar to other constraints within an LMP market. (Priority: Medium. First reported 2014. Status: Not adopted.)
- The MMU recommends that PJM permit unlimited spot market imports as well as unlimited non-firm point-to-point willing to pay congestion imports and exports at all PJM interfaces in order to improve the efficiency of the market. (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM implement a validation method for submitted transactions that would prohibit market participants from breaking transactions into smaller segments to defeat the interface pricing rule by concealing the true source or sink of the transaction. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM implement a validation method for submitted transactions that would require market participants to submit transactions on market paths that reflect the expected actual power flow in order to reduce unscheduled loop flows. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM implement rules to prevent sham scheduling. The MMU's proposed validation rules would address sham scheduling. (Priority: High. First reported 2012. Status: Not adopted. Stakeholder process.)
- The MMU requests that, in order to permit a complete analysis of loop flow, FERC and NERC ensure that the identified data are made available to market monitors as well as other industry entities determined appropriate by FERC. (Priority: Medium. First reported 2003. Status: Not adopted.)
- The MMU recommends that PJM implement additional business rules to remove the incentive to engage in sham scheduling activities using the PJM/IMO interface price. (Priority: Medium. First reported 2014. Status: Not adopted. Stakeholder process.)
- The MMU recommends that PJM eliminate the NIPSCO, Southeast and Southwest interface pricing points from the Day-Ahead and Real-Time Energy Markets and, with VACAR, assign the transactions created under the reserve sharing agreement to the SouthIMP/EXP pricing point. (Priority: Low. First reported 2013. Status: Not adopted.)

<sup>129</sup> See joint statement of PJM and the MMU re Interchange Scheduling issued July 29, 2014, which can be accessed at: <<http://www.pjm.com/~media/documents/reports/20140729-pjm-imm-joint-statement-on-interchange-scheduling.ashx>>.

- The MMU recommends that PJM immediately provide the required 12-month notice to Duke Energy Progress (DEP) to unilaterally terminate the Joint Operating Agreement. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM and MISO work together to align interface pricing definitions, using the same number of external buses and selecting buses in close proximity on either side of the border with comparable bus weights. (Priority: Medium. First reported 2012. Status: Adopted partially, Q4 2013.)
- The MMU recommends that PJM Settlement Inc. immediately request a credit evaluation from all companies that engaged in up to congestion transactions between September 8, 2014, and December 31, 2015. If PJM has the authority, PJM should ensure that the potential exposure to uplift for that period be included as a contingency in the companies' calculations for credit levels and/or collateral requirements. If PJM does not have the authority to take such steps, PJM should request guidance from FERC. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that the emergency interchange cap be replaced with a market based solution. (Priority: Low. First reported 2015. Status: Not adopted.)

## Section 9 – Conclusion

Transactions between PJM and multiple balancing authorities in the Eastern Interconnection are part of a single energy market. While some of these balancing authorities are termed market areas and some are termed non-market areas, all electricity transactions are part of a single energy market. Nonetheless, there are significant differences between market and non-market areas. Market areas, like PJM, include essential features such as locational marginal pricing, financial congestion offsets (FTRs and ARRs in PJM) and transparent, least cost, security constrained economic dispatch for all available generation. Non-market areas do not include these features. The market areas are extremely transparent and the non-market areas are not transparent.

The MMU's recommendations related to transactions with external balancing authorities all share the goal of improving the economic efficiency of interchange transactions. The standard of comparison is an LMP market. In an LMP market, redispatch based on LMP and competitive generator offers results in an efficient dispatch and efficient prices. The goal of designing interface transaction rules should be to match the outcome that would exist in an LMP market.

## Overview: Section 10, “Ancillary Services”

### Primary Reserve

PJM's primary reserves are made up of resources, both synchronized and non-synchronized, that can provide energy within 10 minutes. Primary reserve is PJM's implementation of the NERC 15-minute contingency reserve requirement.<sup>130</sup>

### Market Structure

- **Supply.** Primary reserve is satisfied by both synchronized reserve (generation or demand response currently synchronized to the grid and available within 10 minutes), and non-synchronized reserve (generation currently off-line but available to start and provide energy within 10 minutes).
- **Demand.** The PJM primary reserve requirement is 150 percent of the largest contingency. The primary reserve requirement in the RTO Zone was raised on January 8, 2015, to 2,175 MW of which at least 1,700 MW must be available within the Mid-Atlantic Dominion (MAD) Subzone. Adjustments to the primary reserve requirement can occur when grid maintenance or outages change the largest contingency. The actual demand for primary reserve in the RTO Zone in the first three months of 2016 was 2,181.6 MW. The actual demand for primary reserve in the MAD Subzone was 1,700.0 MW.

<sup>130</sup> See PJM, "Manual 10: Pre-Scheduling Operations," Revision. 33 (December 22, 2015), p. 24.

## Tier 1 Synchronized Reserve

Synchronized reserve is energy or demand reduction synchronized to the grid and capable of increasing output or decreasing load within 10 minutes. Synchronized reserve is of two distinct types, tier 1 and tier 2.

Tier 1 synchronized reserve is part of primary reserve and is the capability of on-line resources following economic dispatch to ramp up in 10 minutes from their current output in response to a synchronized reserve event. There is no formal market for tier 1 synchronized reserve.

- **Supply.** No offers are made for tier 1 synchronized reserve. The market solution estimates tier 1 synchronized reserve as available 10-minute ramp from the energy dispatch. In the first three months of 2016, there was an average hourly supply of 1,434.4 MW of tier 1 for the RTO Synchronized Reserve Zone, and an average hourly supply of 1,160.6 MW of tier 1 in the Mid-Atlantic Dominion Subzone.
- **Demand.** The default hourly required synchronized reserve requirement is 1,450 MW in the RTO Reserve Zone and 1,450 MW for the Mid-Atlantic Dominion Reserve Subzone. The requirement can be met with tier 1 or tier 2 synchronized reserves.
- **Tier 1 Synchronized Reserve Event Response.** Tier 1 synchronized reserve is paid when a synchronized reserve event occurs and it responds. When a synchronized reserve event is called, all tier 1 response is paid the average of five-minute LMPs during the event, rather than hourly integrated LMP, plus \$50/MW. This is the Synchronized Energy Premium Price. The synchronized reserve event response credits for tier 1 response are independent of the tier 2 synchronized reserve market clearing price and independent of the non-synchronized reserve market clearing price. Of tier 1 synchronized reserve resources estimated at market clearing, 68.2 percent actually responded during the two distinct synchronized reserve events with duration of 10 minutes or longer in the first three months of 2016. PJM made changes to the way it calculated tier 1 MW for settlements beginning in July 2014. These changes improved the reported response rate by reducing the initial tier 1 estimate.

- **Issues.** The competitive offer for tier 1 synchronized reserves is zero, as there is no incremental cost associated with the ability to ramp up from the current economic dispatch point and the appropriate payment for responding to an event is the five-minute LMP plus \$50 per MWh. A tariff change included in the shortage pricing tariff changes (October 1, 2012) added the requirement to pay tier 1 synchronized reserve the tier 2 synchronized reserve market clearing price whenever the non-synchronized reserve market clearing price rises above zero.

The rationale for this change was and is unclear, but it has had a significant impact on the cost of tier 1 synchronized reserves, resulting in a windfall payment of \$10,406,363 to tier 1 resources in 2014, and \$34,135,671 in 2015. During the first three months of 2016, payments to tier 1 synchronized reserve resources when the NSRMCP is above \$0.00 were \$1,753,468. This is a significant reduction from the first three months of 2015 when payments to tier 1 synchronized reserve when the NSRMCP was above \$0.00 were \$17,877,658.

## Tier 2 Synchronized Reserve Market

Tier 2 synchronized reserve is part of primary reserve and is comprised of resources that are synchronized to the grid, that incur costs to be synchronized, that have an obligation to respond with corresponding penalties, and that must be dispatched in order to satisfy the synchronized reserve requirement.

When the synchronized reserve requirement cannot be met with tier 1 synchronized reserve, PJM conducts a market to satisfy the balance of the requirement with tier 2 synchronized reserve. The Tier 2 Synchronized Reserve Market includes the PJM RTO Reserve Zone and a subzone, the Mid-Atlantic Dominion Reserve Subzone (MAD).

## Market Structure

- **Supply.** In the first three months of 2016, the supply of offered and eligible synchronized reserve was 13,446.9 MW in the RTO Zone of which 5,340.6 MW (including DSR) was available to the MAD Subzone.

- **Demand.** The default hourly required synchronized reserve requirement was 1,450 MW in the RTO Reserve Zone and 1,450 MW for the Mid-Atlantic Dominion Reserve Subzone. The requirement can be met with tier 1 or tier 2 synchronized reserves. After subtracting the tier 1 synchronized reserve estimate from the default requirement, the hourly average required tier 2 synchronized reserve was 318.6 MW in the MAD subzone (including self-scheduled) and 557.1 MW in the RTO zone (including self-scheduled).
- **Market Concentration.** In the first three months of 2016, the weighted average HHI for cleared tier 2 synchronized reserve in the Mid-Atlantic Dominion Subzone was 5963 which is classified as highly concentrated. The MMU calculates that 47.3 percent of hours would have failed a three pivotal supplier test in the Mid-Atlantic Dominion Subzone.

In the first three months of 2016, the weighted average HHI for cleared tier 2 synchronized reserve in the RTO Synchronized Reserve Zone was 5161 which is classified as highly concentrated. The MMU calculates that 69.9 percent of hours would have failed a three pivotal supplier test in the RTO Synchronized Reserve Zone.

The MMU concludes from these results that both the Mid-Atlantic Dominion Subzone Tier 2 Synchronized Reserve Market and the RTO Synchronized Reserve Zone Market were characterized by structural market power in the first three months of 2016.

## Market Conduct

- **Offers.** There is a must offer requirement for tier 2 synchronized reserve. All non-emergency generation capacity resources are required to submit a daily offer for tier 2 synchronized reserve. Tier 2 synchronized reserve offers from generating units are subject to an offer cap of marginal cost plus \$7.50 per MW, plus opportunity cost, which is calculated by PJM.

## Market Performance

- **Price.** The weighted average price for tier 2 synchronized reserve for all cleared hours in the Mid-Atlantic Dominion (MAD) Subzone was \$4.99

per MW in the first three months of 2016, a decrease of \$7.97, 61.5 percent from the same time period of 2015.

The weighted average price for tier 2 synchronized reserve for all cleared hours in the RTO Synchronized Reserve Zone was \$4.96 per MW in the first three months of 2016, a decrease of \$6.18, 55.5 percent from the same time period in 2015.

## Non-Synchronized Reserve Market

Non-synchronized reserve is part of primary reserve and includes the RTO Reserve Zone and the Mid-Atlantic Dominion Reserve Subzone (MAD). Non-synchronized reserve is comprised of non-emergency energy resources not currently synchronized to the grid that can provide energy within 10 minutes. Non-synchronized reserve is available to fill the primary reserve requirement above the synchronized reserve requirement. There is no formal market for non-synchronized reserve.

## Market Structure

- **Supply.** In the first three months of 2016, the supply of eligible non-synchronized reserve was 2,288.0 MW in the RTO Zone and 1,768.7 MW in MAD Subzone.<sup>131</sup>
- **Demand.** Demand for non-synchronized reserve is the remaining primary reserve requirement after tier 1 synchronized reserve is estimated and tier 2 synchronized reserve is scheduled. In the RTO Zone, the market cleared an hourly average of 901.9 MW of non-synchronized reserve in the first three months of 2016. The MAD Subzone did not clear separately.
- **Market Concentration.** In the first three months of 2016, the weighted average HHI for cleared non-synchronized reserve in the MAD Subzone was 3760 which is classified as highly concentrated. In the RTO Zone the weighted average HHI was 5163, which is also highly concentrated. The MMU calculates that 21.7 percent of hours would have failed a three pivotal supplier test in the MAD Subzone and 0.0 hours would have failed a three pivotal supplier test in the RTO Zone.

<sup>131</sup> See PJM, "Manual 11; Energy & Ancillary Services Markets," Revision 79 (December 17, 2015), p. 81. "Because Synchronized Reserve may be utilized to meet the Primary Reserve requirement, there is no explicit requirement for non-synchronized reserves."

## Market Conduct

- **Offers.** No offers are made for non-synchronized reserve. Non-emergency generation resources that are available to provide energy and can start in 10 minutes or less are considered available for non-synchronized reserves by the market solution software.

## Market Performance

- **Price.** The non-synchronized reserve price is determined by the opportunity cost of the marginal non-synchronized reserve unit. The non-synchronized reserve weighted average price for all cleared hours (124 hours) in the RTO Reserve Zone was \$0.82 per MW in the first three months of 2016 and in 94.6 percent of hours the market clearing price was \$0. The non-synchronized reserve weighted average price for the MAD Subzone was the RTO price because the MAD Subzone did not clear separately.

## Secondary Reserve (Day-Ahead Scheduling Reserve)

PJM maintains a day-ahead, offer-based market for 30-minute secondary reserve, designed to provide price signals to encourage resources to provide 30-minute reserve.<sup>132</sup> The DASR Market has no performance obligations.

## Market Structure

- **Supply.** The DASR Market is a must offer market. Any resources that do not make an offer have their offer set to \$0.00 per MW. DASR is calculated by the day-ahead market solution as the lesser of the thirty minute energy ramp rate or the economic maximum MW minus the day-ahead dispatch point for all online units. In the first three months of 2016, the average available hourly DASR was 40,087.1 MW.
- **Demand.** The DASR requirement in 2016 is 5.70 percent of peak load forecast, down from 5.93 percent in 2015. The average DASR MW purchased was 4,543.0 MW per hour in the first three months of 2016.

<sup>132</sup> See PJM, "Manual 35: Definitions and Acronyms," Revision 23 (April 11, 2014), p. 22.

- **Concentration.** In the first three months of 2016, the DASR Market would have failed a three pivotal supplier test in 0.9 percent of hours.

## Market Conduct

- **Withholding.** Economic withholding remains an issue in the DASR Market. The direct marginal cost of providing DASR is zero. All offers greater than zero constitute economic withholding. In the first three months of 2016 a daily average of 36.2 percent of units offered above \$0.00. In the first three months of 2016, a daily average of 13.6 percent of units offered above \$5.
- **DR.** Demand resources are eligible to participate in the DASR Market. Six demand resources have entered offers for DASR.

## Market Performance

- **Price.** The weighted average DASR market clearing price for all cleared hours in 2015 was \$0.20 per MW, a decrease from \$1.54 per MW in the first three months of 2016.

## Regulation Market

The PJM Regulation Market is a real-time market. Regulation is provided by generation resources and demand response resources that qualify to follow a regulation signal (RegA or RegD). PJM jointly optimizes regulation with synchronized reserve and energy to provide all three services at least cost. The PJM regulation market design includes three clearing price components: capability; performance; and lost opportunity cost. The marginal benefit factor and performance score translate a resource's capability in actual MW into effective MW.

## Market Structure

- **Supply.** In the first three months of 2016, the average hourly eligible supply of regulation was 1,206.4 actual MW (930.2 effective MW). This was an increase of 52.7 actual MW (an increase of 32.0 effective MW)

from the same period of 2015, when the average hourly eligible supply of regulation was 1,153.7 actual MW (898.2 effective MW).

- **Demand.** The hourly regulation demand is set to 525.0 effective MW for off peak hours (00:00 to 04:59), and 700.0 effective MW for on peak hours (05:00 to 23:59). The average hourly cleared MW for off peak hours was 540.1 actual MW in the first three months of 2016. This is an increase of 39.8 actual MW from the same period of 2015, when the average hourly regulation cleared MW for off peak hours was 500.3 actual MW. The average hourly cleared MW for on peak hours was 653.6 actual MW in the first three months of 2016. This is a decrease of 33.0 actual MW from the same period of 2015, where the average hourly regulation cleared MW for on peak hours was 686.6 actual MW.
- **Supply and Demand.** The ratio of the average hourly eligible supply of regulation to average hourly regulation demand required was 1.91. This is an increase of 7.3 percent from the same period of 2015, when the ratio was 1.78.
- **Market Concentration.** In the first three months of 2016, the weighted average (HHI) was 1169 which is classified as moderately concentrated. In the first three months of 2016, the three pivotal supplier test was failed in 90.9 percent of hours.

## Market Conduct

- **Offers.** Daily regulation offer prices are submitted for each unit by the unit owner. Owners are required to submit a cost-based offer and may submit a price-based offer. Offers include both a capability offer and a performance offer. Owners must specify which signal type the unit will be following, RegA or RegD.<sup>133</sup> In the first three months of 2016, there were 168 resources following the RegA signal and 43 resources following the RegD signal.

<sup>133</sup> See the 2015 State of the Market Report for PJM, Volume II, Appendix F "Ancillary Services Markets."

## Market Performance

- **Price and Cost.** The weighted average clearing price for regulation was \$15.55 per effective MW of regulation in the first three months of 2016, a decrease of \$32.35 per MW, or 67.5 percent, from the same period of 2015. The cost of regulation in the first three months of 2016 was \$17.92 per effective MW of regulation, a decrease of \$40.31 per MW, or 69.2 percent, from the same period of 2015. The decreases in regulation price and regulation cost in the first three months of 2016 resulted primarily from reductions in the LOC component of the regulation clearing prices due to lower energy prices in the first three months of 2016 compared to the first three months of 2015.
- **RMCP Credits.** RegD resources continue to be incorrectly compensated relative to RegA resources due to an inconsistent application of the marginal benefit factor in the optimization, assignment, pricing, and settlement processes. If the Regulation Market were functioning efficiently, RegD and RegA resources would be paid the same price per effective MW.
- **Marginal Benefit Factor Function.** The marginal benefit factor (MBF) measures the substitutability of RegD resources for RegA resources. The marginal benefit factor function is incorrectly applied in the market clearing and incorrectly describes the operational relationship between RegA and RegD.
- **Interim changes to the MBF function.** On December 14, 2015, PJM changed the MBF curve. The modification to the marginal benefit curve did not correct the identified issues with the optimization engine.

## Black Start Service

Black start service is required for the reliable restoration of the grid following a blackout. Black start service is the ability of a generating unit to start without an outside electrical supply, or is the demonstrated ability of a generating unit to automatically remain operating at reduced levels when disconnected from the grid (automatic load rejection or ALR).<sup>134</sup>

<sup>134</sup> OATT Schedule 1 § 1.3BB.

In the first three months of 2016, total black start charges were \$12.9 million with \$12.8 million in revenue requirement charges and \$16.8 thousand in operating reserve charges. Black start revenue requirements for black start units consist of fixed black start service costs, variable black start service costs, training costs, fuel storage costs, and an incentive factor. Black start operating reserve charges are paid to units scheduled in the Day-Ahead Energy Market or committed in real time to provide black start service under the ALR option or for black start testing. Black start zonal charges for the first three months in 2016 ranged from \$0.02 per MW-day in the APS Zone (total charges were \$15,117) to \$3.31 per MW-day in the BGE Zone (total charges were \$2,024,438)

## Reactive

Reactive service, reactive supply and voltage control are provided by generation and other sources of reactive power (measured in VAR). Reactive power helps maintain appropriate voltages on the transmission system and is essential to the flow of real power (measured in MW).

In first three months of 2016, total reactive service charges were \$75.2 million, a 1.0 percent decrease from \$76.0 million in the first three months of 2015. Revenue requirement charges increased from \$69.7 million to \$75.0 million and operating reserve charges fell from \$6.3 million to \$250.5 thousand in the first three months of 2016. Total charges in 2016 ranged from \$0.00 in the DLCO and RECO Zone to \$9.3 million in the PSEG Zone. Reactive service revenue requirements are based on FERC approved filings. Reactive service operating reserve charges are paid for scheduling in the Day-Ahead Energy Market and committing in real time units that provide reactive service.

## Section 10 – Recommendations

- The MMU recommends that the Regulation Market be modified to incorporate a consistent application of the marginal benefit factor throughout the optimization, assignment and settlement process. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends a number of market design changes to improve the performance of the Regulation Market, including use of a single clearing price based on actual LMP, modifications to the LOC calculation methodology, a software change to save some data elements necessary for verifying market outcomes, and further documentation of the implementation of the market design through SPREGO. (Priority: Medium. First reported 2010. Status: Partially adopted in 2012.)
- The MMU recommends that the lost opportunity cost in the ancillary services markets be calculated using the schedule on which the unit was scheduled to run in the energy market. (Priority: High. First reported 2010. Status: Partially Adopted.)
- The MMU recommends that the single clearing price for synchronized reserves be determined based on the actual LMP and not the forecast LMP. (Priority: Low. First reported 2010. Status: Adopted.)
- The MMU recommends that the rule requiring the payment of tier 1 synchronized reserve resources when the non-synchronized reserve price is above zero be eliminated immediately. (Priority: High. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends that no payments be made to tier 1 resources if they are deselected in the PJM market solution. The MMU also recommends that documentation of the Tier 1 synchronized reserve deselection process be published. (Priority: High. First reported 2014. Status: Adopted July 2014.)
- The MMU recommends that the tier 2 synchronized reserve must offer requirement be enforced. The MMU recommends that PJM define a set of acceptable reasons why a unit can be made unavailable daily or hourly and require operators to select a reason in Markets Gateway whenever making a unit unavailable. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM be explicit about why tier 1 biasing is used in the Tier 2 Synchronized Reserve Market. The MMU recommends that PJM define explicit rules for the use of tier 1 biasing during any phase

of the market solution and identify the relevant rule for each instance of biasing. (Priority: Low. First reported 2012. Status: Not adopted.)

- The MMU recommends that PJM replace the DASR Market with a real-time secondary reserve product that is available and dispatchable in real time. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM revise the current confidentiality rules in order to specifically allow a more transparent disclosure of information regarding black start resources and their associated payments in PJM. (Priority: Low. First reported 2013. Status: Partially adopted, 2014.)
- The MMU recommends that the three pivotal supplier test and market power mitigation be incorporated in the DASR Market. (Priority: Low. First reported 2009. Status: Not adopted.)
- The MMU recommends that a reason code be attached to every hour in which PJM market operations adds additional DASR MW. (Priority: Medium. First reported 2015. Status: not adopted.)

## Section 10 – Conclusion

While the design of the Regulation Market was significantly improved with changes introduced October 1, 2012, a number of issues remain. The market results continue to include the incorrect definition of opportunity cost. The market design has failed to correctly incorporate the marginal benefit factor in optimization, pricing and settlement. The market design uses the marginal benefit factor in the optimization and pricing, but a mileage ratio in settlement. This failure to correctly incorporate marginal benefit factor into the regulation market design has resulted in both underpayment and overpayment of RegD resources and in the over procurement of RegD resources in some hours. These issues have led to the MMU’s conclusion that the regulation market design is flawed.

The structure of each Tier 2 Synchronized Reserve Market has been evaluated and the MMU has concluded that these markets are not structurally competitive as they are characterized by high levels of supplier concentration and inelastic demand. As a result, these markets are operated with market-clearing prices and with offers based on the marginal cost of producing the service plus a

margin. As a result of these requirements, the conduct of market participants within these market structures has been consistent with competition, and the market performance results have been competitive. However, compliance with calls to respond to actual synchronized reserve events has been an issue. The must offer requirement for tier 2 synchronized reserve has not been enforced.

The rule that requires payment of the tier 2 synchronized reserve price to tier 1 synchronized reserve resources when the non-synchronized reserve price is greater than zero, is inefficient and results in a substantial windfall payment to the holders of tier 1 synchronized reserve resources. Such tier 1 resources have no obligation to perform and pay no penalties if they do not perform. Tier 1 resources are paid for their response if they do respond. Such resources are not tier 2 resources, although they have the option to offer as tier 2, to take on tier 2 obligations and to be paid as tier 2. If tier 1 resources wish to be paid as tier 2 resources, that option is available. Application of this rule added \$10.4 million to the cost of primary reserve in 2014, \$34.1 million to the cost of primary reserve in 2015, and \$1.75 million to the cost of primary reserve in the first three months of 2016.

The benefits of markets are realized under these approaches to ancillary service markets. Even in the presence of structurally noncompetitive markets, there can be transparent, market clearing prices based on competitive offers that account explicitly and accurately for opportunity cost. This is consistent with the market design goal of ensuring competitive outcomes that provide appropriate incentives without reliance on the exercise of market power and with explicit mechanisms to prevent the exercise of market power.

The MMU concludes that the regulation market results were competitive. The MMU concludes that the synchronized reserve market results were competitive. The MMU concludes that the DASR market results were competitive, although there is concern about offers above the competitive level affecting prices.

## Overview: Section 11, “Congestion and Marginal Losses”

### Congestion Cost

- **Total Congestion.** Total congestion costs decreased by \$339.5 million or 53.7 percent, from \$631.7 million in the first three months of 2015 to \$292.2 million in the first three months of 2016.
- **Day-Ahead Congestion.** Day-ahead congestion costs decreased by \$451.0 million or 58.3 percent, from \$773.9 million in the first three months of 2015 to \$322.9 million in the first three months of 2016.
- **Balancing Congestion.** Balancing congestion costs increased by \$111.5 million or 78.4 percent, from -\$142.2 million in the first three months of 2015 to -\$30.8 million in the first three months of 2016.
- **Real-Time Congestion.** Real-time congestion costs decreased by \$284.7 million or 49.2 percent, from \$579.0 million in the first three months of 2015 to \$294.3 million in the first three months of 2016.
- **Monthly Congestion.** In the first three months of 2016, 38.1 percent (\$111.3 million) of total congestion cost was incurred in February. Monthly total congestion costs in the first three months of 2016 ranged from \$73.3 million in March to \$111.3 million in February.
- **Geographic Differences in CLMP.** Differences in CLMP among eastern, southern and western control zones in PJM were primarily a result of congestion on the Graceton Transformer, the Bagley – Graceton Line, the Conastone – Northwest Line the Milford – Steele Line and the Person – Halifax Flowgate.
- **Congestion Frequency.** Congestion frequency continued to be significantly higher in the Day-Ahead Energy Market than in the Real-Time Energy Market in the first three months of 2016. The number of congestion event hours in the Day-Ahead Energy Market was about six times higher than the number of congestion event hours in the Real-Time Energy Market. Day-ahead congestion frequency increased by 31.7 percent from 50,384 congestion event hours in the first three months of 2015 to 66,373

congestion event hours in the first three months of 2016. The day-ahead congestion event hours decreased significantly after September 8, 2014. The reduction was the result of the reduction in up to congestion (UTC) activity which was a result of FERC’s UTC uplift refund notice, retroactive to September 8, 2014.

Real-time congestion frequency decreased by 30.5 percent from 9,735 congestion event hours in the first three months of 2015 to 6,763 congestion event hours in the first three months of 2016.

- **Congested Facilities.** Day-ahead, congestion-event hours decreased on flowgates and interfaces and increased on lines and transformers. Real-time, congestion-event hours decreased on all types of facilities.

The Graceton Transformer was the largest contributor to congestion costs in the first three months of 2016. With \$29.8 million in total congestion costs, it accounted for 10.2 percent of the total PJM congestion costs in the first three months of 2016.

- **Zonal Congestion.** ComEd had the largest total congestion costs among all control zones in the first three months of 2016. ComEd had \$69.7 million in total congestion costs, comprised of -\$88.1 million in total load congestion payments, -\$163.4 million in total generation congestion credits and -\$5.7 million in explicit congestion costs. The Mercer IP – Galesburg Flowgate, the Cherry Valley Flowgate, the Cherry Valley Transformer, the Cherry Valley – Silver Lake Flowgate, and the Person – Halifax Flowgate contributed \$37.6 million, or 53.9 percent of the total ComEd control zone congestion costs.
- **Ownership.** In the first three months of 2016, financial entities as a group were net recipients of congestion credits and physical entities were net payers of congestion charges. Explicit costs are the primary source of congestion credits to financial entities. In the first three months of 2016, financial entities received \$16.7 million in congestion credits, a decrease of \$52.5 million or 75.9 percent compared to the first three months of 2015. In the first three months of 2016, physical entities paid \$308.8 million in congestion charges, a decrease of \$392.0 million or 55.9 percent compared to the first three months of 2015. UTCs are in the

explicit congestion cost category and comprise most of that category. The total explicit cost is equal to day-ahead explicit cost plus balancing explicit cost. In the first three months of 2016, the total explicit cost is -\$8.5 million and 153.0 percent of the total explicit cost is comprised of congestion cost by UTCs, which is -\$13.0 million.

## Marginal Loss Cost

- **Total Marginal Loss Costs.** Total marginal loss costs decreased by \$255.0 million or 60.0 percent, from \$425.1 million in the first three months of 2015 to \$170.1 million in the first three months of 2016. The loss MWh in PJM decreased by 1,247.3 GWh or 24.3 percent, from 5,126.6 GWh in the first three months of 2015 to 3,879.2 GWh in the first three months of 2016. The loss component of LMP decreased from \$0.03 in the first three months of 2015 to \$0.01 in the first three months of 2016.
- **Monthly Total Marginal Loss Costs.** Monthly total marginal loss costs in the first three months of 2016 ranged from \$40.6 million in March to \$72.0 million in January.
- **Day-Ahead Marginal Loss Costs.** Day-ahead marginal loss costs decreased by \$248.7 million or 57.6 percent, from \$432.0 million in the first three months of 2015 to \$183.3 million in the first three months of 2016.
- **Balancing Marginal Loss Costs.** Balancing marginal loss costs decreased by \$6.3 million or 91.3 percent, from -\$6.9 million in the first three months of 2015 to -\$13.2 million in the first three months of 2016.
- **Total Marginal Loss Surplus.** The total marginal loss surplus decreased in the first three months of 2016 by \$92.0 million or 62.0 percent, from \$148.5 million in the first three months of 2015, to \$56.4 million in the first three months of 2016.

## Energy Cost

- **Total Energy Costs.** Total energy costs increased by \$158.0 million or 58.2 percent, from -\$271.7 million in the first three months of 2015 to -\$113.6 million in the first three months of 2016.
- **Day-Ahead Energy Costs.** Day-ahead energy costs increased by \$162.2 million or 51.9 percent, from -\$312.6 million in the first three months of 2015 to -\$150.4 million in the first three months of 2016.
- **Balancing Energy Costs.** Balancing energy costs decreased by \$2.6 million or 6.8 percent, from \$38.4 million in the first three months of 2015 to \$35.8 million in the first three months of 2016.
- **Monthly Total Energy Costs.** Monthly total energy costs in the first three months of 2016 ranged from -\$47.7 million in January to -\$27.4 million in March.

## Section 11 - Conclusion

Congestion, as defined, is the total congestion payments by load in excess of the total congestion credits received by generation. The level and distribution of congestion reflects the underlying characteristics of the power system, including the nature and capability of transmission facilities, the offers and geographic distribution of generation facilities, the level and geographic distribution of incremental bids and offers and the geographic and temporal distribution of load.

The current ARR/FTR design does not serve as an efficient way to ensure that load receives all the congestion revenues or has the ability to receive the auction revenues associated with all the potential congestion revenues. Total ARR and self scheduled FTR revenue offset only 63.8 percent of total congestion costs including congestion in the Day-Ahead Energy Market and the balancing energy market for the 2014 to 2015 planning period. For the first ten months of the 2015 to 2016 planning period ARRs and self scheduled FTRs offset 83.6 percent of total congestion costs

## Overview: Section 12, “Planning”

### Planned Generation and Retirements

- **Planned Generation.** As of March 31, 2016, 81,936.3 MW of capacity were in generation request queues for construction through 2024, compared to an average installed capacity of 187,281.3 MW as of March 31, 2016. Of the capacity in queues, 5,999.7 MW, or 7.3 percent, are uprates and the rest are new generation. Wind projects account for 15,686.2 MW of nameplate capacity or 19.1 percent of the capacity in the queues. Combined cycle projects account for 53,202.8 MW of capacity or 64.9 percent of the capacity in the queues.
- **Generation Retirements.** As shown in Table 12-6, 26,486.5 MW have been, or are planned to be, retired between 2011 and 2020. Of that, 2,997.3 MW are planned to retire after 2016. In the first three months of 2016, 53 MW were retired. Of the 2,656.8 MW pending retirement, 1,263 MW are coal units. The coal unit retirements were a result of low gas prices, and the EPA’s Mercury and Air Toxics Standards (MATS) for some units.
- **Generation Mix.** A significant shift in the distribution of unit types within the PJM footprint continues as natural gas fired units enter the queue and steam units retire. There are 1,957.0 MW of coal fired steam capacity and 56,645.1 MW of gas fired capacity are in the queue. The replacement of coal steam units by units burning natural gas could significantly affect future congestion, the role of firm and interruptible gas supply, and natural gas supply infrastructure.

### Generation and Transmission Interconnection Planning Process

- Any entity that requests interconnection of a new generating facility, including increases to the capacity of an existing generating unit, or that requests interconnection of a merchant transmission facility, must follow the process defined in the PJM tariff to obtain interconnection service.<sup>135</sup> The process is complex and time consuming at least in part as a result of the required analyses. The cost, time and uncertainty associated

with interconnecting to the grid may create barriers to entry for potential entrants.

- The queue contains a substantial number of projects that are not likely to be built. Excluding currently active projects and projects currently under construction, 2,329 projects, representing 334,777.6 MW, have completed the queue process since its inception. Of those, 621 projects, 43,797.8 MW, went into service. Of the projects that entered the queue process, 86.9 percent of the MW withdrew prior to completion. Such projects may create barriers to entry for projects that would otherwise be completed by taking up queue positions, increasing interconnection costs and creating uncertainty.
- Feasibility, impact and facilities studies may be delayed for reasons including disputes with developers, circuit and network issues and retooling as a result of projects being withdrawn. The Earlier Queue Submittal Task Force (EQSTF) was established in August 2015 to address delays.<sup>136</sup>
- As defined in the tariff, a transmission owner (TO) is an “entity that owns, leases or otherwise has a possessory interest in facilities used for the transmission of electric energy in interstate commerce under the tariff.”<sup>137</sup> Where the transmission owner is a vertically integrated company that also owns generation, there is a potential conflict of interest when the transmission owner evaluates the interconnection requirements of new generation which is a competitor to the generation of the parent company and when the transmission owner evaluates the interconnection requirements of new generation which is part of the same company as the transmission owner. There is also a potential conflict of interest when the transmission owner evaluates the interconnection requirements of a merchant transmission developer which is a competitor of the transmission owner.

<sup>135</sup> See PJM, OATT Parts IV & VI.

<sup>136</sup> See Earlier Queue Submittal Task Force at <<http://www.pjm.com/committees-and-groups/task-forces/eqstf.aspx>>

<sup>137</sup> See PJM, OATT, Part I, § 1 “Definitions.”

## Regional Transmission Expansion Plan (RTEP)

- Artificial Island is an area in southern New Jersey that includes nuclear units at Salem and at Hope Creek in the PSEG Zone. On April 29, 2013, PJM issued a request for proposal (RFP), seeking technical solutions to improve stability issues and operational performance under a range of anticipated system conditions, and the elimination of potential planning criteria violations in this area. On July 30, 2015, the PJM Board of Managers accepted PJM's recommendation to assign the project to LS Power, a merchant developer, PSEG, and PHI with a total cost estimate between \$263M and \$283M.<sup>138 139</sup>
- On October 25, 2012, Schedule 12 of the tariff and Schedule 6 of the OA were changed to address FERC Order No. 1000 reforms to the cost allocation requirements for local and regional transmission planning projects that were formerly defined in Order No. 890. The new approach was applied for the first time to the 2013 RTEP.

## Backbone Facilities

- PJM baseline transmission projects are implemented to resolve reliability criteria violations. PJM backbone transmission projects are a subset of significant baseline projects, which are intended to resolve multiple reliability criteria violations and congestion issues and which may have substantial impacts on energy and capacity markets. There is currently only one backbone project under development, Surry Skiffes Creek 500kV.

## Transmission Facility Outages

- PJM maintains a list of reportable transmission facilities. When the reportable transmission facilities need to be taken out of service, PJM transmission owners are required to report planned transmission facility outages as early as possible. PJM processes the transmission facility outage requests according to rules in PJM's Manual 3 to decide if the

outage is on time, late, or past its deadline and whether or not they will allow the outage.<sup>140</sup>

- There were 4,052 transmission outage requests submitted for the first three months of 2016. Of the requested outages, 85.6 percent were planned for five days or shorter and 1.6 percent were planned for longer than 30 days. Of the requested outages, 53.6 percent were late according to the rules in PJM's Manual 3.

## Section 12 - Recommendations

The MMU recommends improvements to the planning process.

- The MMU recommends that PJM continue to incorporate the principle that the goal of transmission planning should be the incorporation of transmission investment decisions into market driven processes as much as possible. (Priority: Low. First reported 2001. Status: Not adopted.)
- The MMU recommends the creation of a mechanism to permit a direct comparison, or competition, between transmission and generation alternatives, including which alternative is less costly and who bears the risks associated with each alternative. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that rules be implemented to permit competition to provide financing for transmission projects. This competition could reduce the cost of capital for transmission projects and significantly reduce total costs to customers. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that rules be implemented to require that project cost caps on new transmission projects be part of the evaluation of competing projects. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that barriers to entry be addressed in a timely manner in order to help ensure that the capacity market will result in the entry of new capacity to meet the needs of PJM market participants and reflect the uncertainty and resultant risks in the cost of new entry used to

<sup>138</sup> See "Artificial Island Recommendations," presented at the TEAC meeting on April 28, 2015 at <<http://www.pjm.com/~media/committees-groups/committees/teac/20150428-ai/20150428-artificial-island-recommendations.ashx>>.

<sup>139</sup> See letter from Terry Boston concerning the Artificial Island Project at <<http://www.pjm.com/~media/documents/reports/board-statement-on-artificial-island-project.ashx>>.

<sup>140</sup> PJM. "Manual 03: Transmission Operations," Revision 46 (December 1, 2014), Section 4.

establish the capacity market demand curve in RPM. (Priority: Low. First reported 2012. Status: Not adopted.)

- The MMU recommends that the question of whether Capacity Injection Rights (CIRs) should persist after the retirement of a unit be addressed. Even if the treatment of CIRs remains unchanged, the rules need to ensure that incumbents cannot exploit control of CIRs to block or postpone entry of competitors.<sup>141</sup> (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends outsourcing interconnection studies to an independent party to avoid potential conflicts of interest. Currently, these studies are performed by incumbent transmission owners under PJM's direction. This creates potential conflicts of interest, particularly when transmission owners are vertically integrated and the owner of transmission also owns generation. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends improvements in queue management including that PJM establish a review process to ensure that projects are removed from the queue if they are not viable, as well as a process to allow commercially viable projects to advance in the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming. (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends an analysis of the study phase of PJM's transmission planning to reduce the need for postponements of study results, to decrease study completion times, and to improve the likelihood that a project at a given phase in the study process will successfully go into service. (Priority: Medium. First reported 2014. Status: Partially adopted.)
- The MMU recommends that PJM establish fair terms of access to rights of way and property, such as at substations, in order to remove any barriers to entry and permit competition between incumbent transmission providers and merchant transmission providers in the RTEP. (Priority: Medium. First reported 2014. Status: Not adopted.)

<sup>141</sup> See "Comments of the Independent Market Monitor for PJM," Docket No. ER12-1177-000, <[http://www.monitoringanalytics.com/reports/Reports/2012/IMM\\_Comments\\_ER12-1177-000\\_20120312.pdf](http://www.monitoringanalytics.com/reports/Reports/2012/IMM_Comments_ER12-1177-000_20120312.pdf)>.

- The MMU recommends that PJM enhance the transparency and queue management process for merchant transmission investment. Issues related to data access and complete explanations of cost impacts should be addressed. The goal should be to remove barriers to competition from merchant transmission. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends consideration of changing the minimum distribution factor in the method of allocating costs for baseline projects from .01 to .00 and adding a threshold minimum usage impact on the line. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM reevaluate all transmission outage tickets as on time or late as if they were new requests when an outage is rescheduled and apply the standard rules for late submissions to any such outages. (Priority: Low. First reported 2014. Status: Not adopted.)
- The MMU recommends that PJM draft a clear definition of the congestion analysis required for transmission outage requests to include in Manual 3 after appropriate review. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM modify the rules to reduce or eliminate the approval of late outage requests submitted or rescheduled after the FTR auction bidding opening date. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM not permit transmission owners to divide long duration outages into smaller segments to avoid complying with the requirements for long duration outages. (Priority: Low. First reported 2015. Status: Not adopted.)

## Section 12 – Conclusion

The goal of PJM market design should be to enhance competition and to ensure that competition is the driver for all the key elements of PJM markets. But transmission investments have not been fully incorporated into competitive markets. The construction of new transmission facilities has significant impacts on the energy and capacity markets. But when generating units retire

or load increases, there is no market mechanism in place that would require direct competition between transmission and generation to meet loads in the affected area. In addition, despite FERC Order No. 1000, there is not yet a transparent, robust and clearly defined mechanism to permit competition to build transmission projects, to ensure that competitors provide a total project cost cap, or to obtain least cost financing through the capital markets.

The addition of a planned transmission project changes the parameters of the capacity auction for the area, changes the amount of capacity needed in the area, changes the capacity market supply and demand fundamentals in the area and may effectively forestall the ability of generation to compete. But there is no mechanism to permit a direct comparison, let alone competition, between transmission and generation alternatives. There is no mechanism to evaluate whether the generation or transmission alternative is less costly, whether there is more risk associated with the generation or transmission alternatives, or who bears the risks associated with each alternative. Creating such a mechanism should be an explicit goal of PJM market design.

The PJM queue evaluation process should be improved to ensure that barriers to competition for new generation investments are not created. Issues that need to be addressed include the ownership rights to CIRs, whether transmission owners should perform interconnection studies, and improvements in queue management.

The PJM rules for competitive transmission development through the RTEP should build upon FERC Order No. 1000 to create real competition between incumbent transmission providers and merchant transmission providers. PJM should enhance the transparency and queue management process for merchant transmission investment. Issues related to data access and complete explanations of cost impacts should be addressed. The goal should be to remove barriers to competition from merchant transmission. Another element of opening competition would be to consider transmission owners' ownership of property and rights of way at or around transmission substations. In many cases, the land acquired included property intended to support future expansion of the grid. Incumbents have included the costs of the property

in their rate base. Because PJM now has the responsibility for planning the development of the grid under its RTEP process, property bought to facilitate future expansion should be a part of the RTEP process and be made available to all providers on equal terms.

There are currently no market incentives for transmission owners to submit and complete transmission outages in a timely and efficient manner. Requiring transmission owners to pay does not create an effective incentive when those payments are passed through to transmission customers. The process for the submission of planned transmission outages needs to be carefully reviewed and redesigned to limit the ability of transmission owners to submit transmission outages that are late for FTR Auction bid submission dates and are late for the Day-Ahead Energy Market. The submission of late transmission outages can inappropriately affect market outcomes when market participants do not have the ability to modify market bids and offers.

## Overview: Section 13, “FTR and ARR”

### Auction Revenue Rights

#### Market Structure

- **Residual ARRs.** If ARR allocations are reduced as the result of a modeled transmission outage and the transmission outage ends during the relevant planning year, the result is that residual ARRs may be available. These residual ARRs are automatically assigned to eligible participants the month before the effective date. Residual ARRs are only available on paths prorated in Stage 1 of the annual ARR allocation, are only effective for single, whole months and cannot be self scheduled. Residual ARR clearing prices are based on monthly FTR auction clearing prices.
- In the 2015 to 2016 planning period, PJM allocated a total of 30,118.1 MW of residual ARRs, up from 19,928.0 MW in the first ten months of the 2014 to 2015 planning period, with a total target allocation of \$7.7 million for the 2015 to 2016 planning period, down from \$7.9 million for the first ten months of the 2014 to 2015 planning period. Total Residual ARR allocations for the 2013 to 2014 planning period were 15,417.5 MW

for \$4.7 million. This large increase in residual ARR allocations over the 2013 to 2014 planning period was primarily a result of PJM's significant reductions in Annual ARR Stage 1B allocations. The outages were only assumed in order to reduce the initial allocation. As a result, there were more available ARRs during the year which were distributed as residual ARRs.

- **ARR Reassignment for Retail Load Switching.** There were 53,343 MW of ARRs associated with \$503,400 of revenue that were reassigned in the 2014 to 2015 planning period. There were 52,046 MW of ARRs associated with \$612,900 of revenue that were reassigned for the first ten months of the 2015 to 2016 planning period.

## Market Performance

- **Revenue Adequacy.** For the 2015 to 2016 planning period, the ARR target allocations, which are based on the nodal price differences from the Annual FTR Auction, were \$930.7 million, while PJM collected \$967.4 million from the combined Long Term, Annual and Monthly Balance of Planning Period FTR Auctions, making ARRs revenue adequate. For the 2014 to 2015 planning period, the ARR target allocations were \$735.3 million while PJM collected \$767.9 million from the combined Long Term, Annual and Monthly Balance of Planning Period FTR Auctions. The increase in ARR target allocations and auction revenue, despite decreased volume, is a result of increased prices resulting from the reduced allocation of Stage 1B and Stage 2 ARRs. For the 2015 to 2016 planning period ARR dollars per MW increased 15.6 percent relative to the 2013 to 2014 planning period.
- **ARRs as an Offset to Congestion.** ARRs did not serve as an effective way to return congestion revenues to load. Total ARR and self scheduled FTR revenue offset only 63.8 percent of total congestion costs, which include congestion in the Day-Ahead Energy Market and the balancing energy market, for the 2014 to 2015 planning period. In the first ten months of the 2015 to 2016 planning period, total ARR and self scheduled FTR revenues offset 83.6 percent of total congestion costs.

## Financial Transmission Rights

### Market Structure

- **Supply.** In the Monthly Balance of Planning Period FTR Auctions for the 2015 to 2016 planning period, total participant FTR sell offers were 4,500,555 MW, up from 3,230,754 MW for the same period during the 2014 to 2015 planning period.
- **Demand.** The total FTR buy bids from the Monthly Balance of Planning Period FTR Auctions for the 2015 to 2016 planning period increased 0.6 percent from 23,099,689 MW for the same time period of the prior planning period, to 23,243,499 MW.
- **Patterns of Ownership.** For the Monthly Balance of Planning Period Auctions, financial entities purchased 81.7 percent of prevailing flow and 75.2 percent of counter flow FTRs for January through March of 2016. Financial entities owned 65.9 percent of all prevailing and counter flow FTRs, including 58.6 percent of all prevailing flow FTRs and 76.4 percent of all counter flow FTRs during the period from January through March 2016.

### Market Behavior

- **FTR Forfeitures.** Total forfeitures for the 2015 to 2016 planning period were \$0.2 million for Increment Offers, Decrement Bids and UTC Transactions.
- **Credit Issues.** There were no defaults in January through March 2016.

### Market Performance

- **Volume.** In the first ten months of the 2015 to 2016 planning period Monthly Balance of Planning Period FTR Auctions 2,154,584 MW (9.3 percent) of FTR buy bids and 1,098,875 MW (24.4 percent) of FTR sell offers cleared.
- **Price.** The weighted-average buy-bid cleared FTR price in the Monthly Balance of Planning Period FTR Auctions for the first ten months of the

2015 to 2016 planning period was \$0.21, up from \$0.18 per MW for the same period in the 2014 to 2015 planning period.

- **Revenue.** The Monthly Balance of Planning Period FTR Auctions generated \$31.1 million in net revenue for all FTRs for the 2015 to 2016 planning period, up from \$17.3 million for the same time period in the 2014 to 2015 planning period.
- **Revenue Adequacy.** FTRs were paid at 100 percent of the target allocation level for the 2015 to 2016 planning period. This high level of revenue adequacy was primarily a result of actions taken by PJM to reduce the level of available ARRs and FTRs. PJM's actions included PJM's decision to assume higher outage levels and PJM's decision to include additional constraints (closed loop interfaces) both of which reduced system capability in the FTR auction model. PJM's actions led to a significant reduction in the allocation of Stage 1B and Stage 2 ARRs.
- **Profitability.** FTR profitability is the difference between the revenue received for an FTR and the cost of the FTR. In 2016, FTRs were profitable overall, with \$68.8 million in profits for physical entities, of which \$61.2 million was from self-scheduled FTRs, and \$46.9 million for financial entities.

## Section 13 – Recommendations

- The MMU recommends that the ARR/FTR design be modified to ensure that all congestion revenues are returned to load. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that all FTR auction revenue be distributed to ARR holders. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that historical generation to load paths be eliminated as a basis for allocating ARRs. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that counter flow FTRs be eliminated. (Priority: High. First reported 2015. Status: Not adopted.)

- The MMU recommends that FTR auction revenues not be used to buy counter flow FTRs with the purpose of improving FTR payout ratios.<sup>142</sup> (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM report correct monthly payout ratios to reduce understatement of payout ratios on a monthly basis. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM eliminate portfolio netting to eliminate cross subsidies among FTR marketplace participants. (Priority: High. First reported 2012. Status: Not adopted. Pending before FERC.)
- The MMU recommends that PJM eliminate subsidies to counter flow FTRs by applying the payout ratio to counter flow FTRs in the same way the payout ratio is applied to prevailing flow FTRs. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM eliminate geographic cross subsidies. (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM improve transmission outage modeling in the FTR auction models. (Priority: Low. First reported 2013. Status: Adopted partially, 14/15 planning period.)
- The MMU recommends that PJM reduce FTR sales on paths with persistent overallocation of FTRs including clear rules for what defines persistent overallocation and how the reduction will be applied. (Priority: High. First reported 2013. Status: Adopted partially, 14/15 planning period.)
- The MMU recommends that PJM implement a seasonal ARR and FTR allocation system to better represent outages. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that the basis for the Stage 1A assignments be reviewed and made explicit, that the role of out of date generation to load paths be reviewed and that the building of the transmission capability required to provide all defined Stage 1A allocations be reviewed. (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM apply the FTR forfeiture rule to up to congestion transactions consistent with the application of the FTR

<sup>142</sup> See PJM. "Manual 6: Financial Transmission Rights" Revision 16 (June 1, 2014), p. 56.

forfeiture rule to increment offers and decrement bids. (Priority: High. First reported 2013. Status: Not adopted. Pending before FERC.)

- The MMU recommends that PJM examine the mechanism by which self scheduled FTRs are allocated when load switching among LSEs occurs throughout the planning period. (Priority: Low. First reported 2011. Status: Not adopted.)

## Section 13 - Conclusion

The annual ARR allocation should be designed to return congestion revenues to firm transmission service customers, without requiring contract path physical transmission rights that are difficult or impossible to define and enforce in LMP markets. The fixed charges paid for firm transmission services result in the transmission system which provides physically firm transmission service which results in load paying congestion revenues.

After the introduction of LMP markets, financial transmission rights (FTRs) permitted the loads which pay for the transmission system to continue to receive those benefits in the form of revenues which offset congestion to the extent permitted by the transmission system. Financial transmission rights and the associated revenues were directly provided to loads in recognition of the fact that loads pay for the transmission system which permits low cost generation to be delivered to load. Another way of describing the result is that FTRs and the associated revenues were directly provided to loads in recognition of the fact that load pays locational prices which result in load payments in excess of generation revenues which are the source congestion revenues in an LMP market. In other words, load payments in excess of generation revenues are the source of the funds to pay FTRs. In an LMP system, the only way to ensure that load receives the benefits associated with the use of the transmission system to deliver low cost energy is to use FTRs to pay back to load the difference between the total load payments and the total generation revenues, which equals total congestion revenues.

With the creation of ARRs, FTRs no longer serve their original function of providing firm transmission customers with the financial equivalent of

physically firm transmission service. FTR holders, with the creation of ARRs, do not have the right to financially firm transmission service and FTR holders do not have the right to revenue adequacy.

As a result of the creation of ARRs and other changes to the design, the current ARR/FTR design does not serve as an efficient way to ensure that load receives all the congestion revenues or has the ability to receive the auction revenues associated with all the potential congestion revenues. Total ARR and self scheduled FTR revenue offset only 63.8 percent of total congestion costs including congestion in the Day-Ahead Energy Market and the balancing energy market for the 2014 to 2015 planning period. For the first ten months of the 2015 to 2016 planning period ARRs and self scheduled FTRs offset 83.6 percent of total congestion costs.

For these reasons, load should never be required to subsidize payments to FTR holders, regardless of the reason. Such subsidies have been suggested repeatedly.<sup>143</sup> One form of recommended subsidies would ignore balancing congestion when calculating total congestion dollars available to fund FTRs. This approach would ignore the fact that loads must pay both day-ahead and balancing congestion and that congestion is defined, in an accounting sense, to equal the sum of day ahead and balancing congestion. To eliminate balancing congestion from the FTR revenue calculation would require load to pay twice for congestion. Load would have to continue paying for the physical transmission system, would have to continue paying in excess of generator revenues and not have balancing congestion included in the calculation of congestion in order to increase the payout to holders of FTRs who are not loads and who therefore did not receive an allocation of ARRs. In other words, load would have to continue providing all the funding of FTRs, while payments to FTR holders who did not receive ARRs exceed total congestion on their FTR paths and result in profits to FTR holders.

Revenue adequacy has received a lot of attention in the PJM FTR Market. There are several factors that can affect the reporting, distribution of and quantity of funding in the FTR Market. Revenue adequacy is misunderstood.

<sup>143</sup> See "FirstEnergy Solutions Corp. Allegheny Energy Supply Company, LLC v PJM Interconnection, LLC," Docket No. EL13-47-000 (February 15, 2013).

FTR holders, with the creation of ARR, do not have the right to financially firm transmission service and FTR holders do not have the right to revenue adequacy even when defined correctly. Load does have those rights based on load's payment for the transmission system and load's payment of total congestion.

Reported FTR revenue adequacy uses target allocations as the relevant benchmark. But target allocations are not the relevant benchmark. Target allocations are based on day-ahead congestion only, ignoring balancing congestion which is the other part of total congestion. FTR holders appropriately receive revenues based on actual congestion in both day-ahead and balancing markets. When day-ahead congestion differs significantly from real-time congestion, as has occurred only in recent years, this is evidence that there are reporting issues, cross subsidization issues, issues with the level of FTRs sold, and issues with modeling differences between the day-ahead and real-time markets. Such differences are not an indication that FTR holders are under paid.

The difference between the congestion payout using total congestion and the congestion payout using only day-ahead congestion illustrates the issue. For January through March 2016, total day-ahead congestion was \$322.9 million while total day-ahead plus balancing congestion was \$292.2 million, compared to target allocations of \$285.9 million in the same time period.

PJM used a more conservative approach to modeling the transmission capability for the 2014 to 2015 planning period. PJM simply assumed higher outage levels and included additional constraints, both of which reduced system capability in the FTR auction model. The result was a significant reduction in Stage 1B and Stage 2 ARR allocations, and a corresponding reduction in the available quantity of FTRs, an increase in FTR prices and an increase in ARR target allocations. The market response to the reduced supply of FTRs was increased bid prices, increased clearing prices and reduced clearing quantities.

Clearing prices fell and cleared quantities increased from the 2010 to 2011 planning period through the 2013 to 2014 planning period. The market response to lower revenue adequacy was to reduce bid prices and to increase bid volumes and offer volumes. In the 2014 to 2015 and 2015 to 2016 planning periods, due to reduced ARR allocations, FTR volume decreased relative to the 2013 to 2014 planning period. The reduction in ARR allocations and resulting FTR volume caused, by definition, an improvement in revenue adequacy, and also resulted in an increase in the prices of FTRs. Increased FTR prices resulted in increased ARR target allocations, because ARR target allocations are based on the Annual FTR Auction nodal prices.

FTR target allocations are currently netted within each organization in each hour. This means that within an hour, positive and negative target allocations within an organization's portfolio are offset prior to the application of the payout ratio to the positive target allocation FTRs. The payout ratios are also calculated based on these net FTR positions. The current method requires those participants with fewer negative target allocation FTRs to subsidize those with more negative target allocation FTRs. The current method treats a positive target allocation FTR differently depending on the portfolio of which it is a part. The correct method would treat all FTRs with positive target allocations exactly the same, which would eliminate this form of cross subsidy. This should also be extended to include the end of planning period FTR uplift calculation. The net of a participant's portfolio should not determine their FTR uplift liability, rather their portion of total positive target allocations should be used to determine a participant's uplift charge. The FTR market cannot work efficiently if FTR buyers do not receive payments consistent with the performance of their FTRs. Eliminating the portfolio subsidy would be a good first step in that direction.

If netting within portfolios were eliminated and the payout ratio were calculated correctly, the payout ratio in the 2013 to 2014 planning period would have been 87.5 percent instead of the reported 72.8 percent. The MMU recommends that netting of positive and negative target allocations within portfolios be eliminated.

The current rules create an asymmetry between the treatment of counter flow and prevailing flow FTRs. Counter flow FTR holders make payments over the planning period, in the form of negative target allocations. These negative target allocations are paid at 100 percent regardless of whether positive target allocation FTRs are paid at less than 100 percent.

There is no reason to treat counter flow FTRs more favorably than prevailing flow FTRs. Counter flow FTRs should also be affected when the payout ratio is less than 100 percent. This would mean that counter flow FTRs would pay back an increased amount that mirrors the decreased payments to prevailing flow FTRs. The adjusted payout ratio would evenly divide the impact of lower payouts among counter flow FTR holders and prevailing flow FTR holders by increasing negative counter flow target allocations by the same amount it decreases positive target allocations. The FTR Market cannot work efficiently if FTR buyers do not receive payments consistent with the performance of their FTRs. Eliminating the counter flow subsidy would be another good step in that direction.

The result of removing portfolio netting and applying a payout ratio to counter flow FTRs would have increased the calculated payout ratio in the 2013 to 2014 planning period from the reported 72.8 percent to 91.0 percent. For the 2014 to 2015 and 2015 to 2016 planning period the payout ratio was 100 percent. The MMU recommends that counter flow and prevailing flow FTRs be treated symmetrically with respect to the application of a payout ratio.

The overallocation of Stage 1A ARR results in FTR overallocations on the same facilities. Stage 1A ARR overallocation is a source of revenue inadequacy and cross subsidy. The origin and basis for the requirement to assign Stage 1A ARRs needs further investigation. The issues associated with over allocation appear to be based on the use of out of date generation to load ARR paths and on whether PJM has appropriately built transmission to meet the requirement.

The MMU recommends that the basis for the Stage 1A assignments be reviewed and made explicit, that the role of out of date generation to load paths be reviewed and that the building of the transmission capability required to

provide all defined Stage 1A allocations be reviewed. The implementation of the MMU's recommendation to return all congestion revenues to load would also significantly affect this issue.

The result of removing portfolio netting, applying a payout ratio to counter flow FTRs and eliminating Stage 1A ARR overallocation in the 2013 to 2014 planning period would have increased the payout ratio to 94.6 percent without reducing ARR allocations in Stage 1B and Stage 2.

In addition to addressing these issues, the approach to the question of FTR funding should also look at the fundamental reasons that there has been a significant and persistent difference between day-ahead and balancing congestion. These reasons include the inadequate transmission outage modeling in the FTR auction model which ignores all but long term outages known in advance; the different approach to transmission line ratings in the day-ahead and real-time markets, including reactive interfaces, which directly results in differences in congestion between day-ahead and real-time markets; differences in day-ahead and real-time modeling including the treatment of loop flows, the treatment of outages, the modeling of PARs and the nodal location of load, which directly results in differences in congestion between day-ahead and real-time markets; the overallocation of ARRs which directly results in a difference between congestion revenue and the payment obligation; the appropriateness of seasonal ARR allocations to better match actual market conditions with the FTR auction model; geographic subsidies from the holders of positively valued FTRs in some locations to the holders of consistently negatively valued FTRs in other locations; the contribution of up to congestion transactions to the differences between day-ahead and balancing congestion and thus to FTR payout ratios; and the continued sale of FTR capability on pathways with a persistent difference between FTRs and total congestion revenue. The MMU recommends that these issues be reviewed and modifications implemented. Regardless of how these issues are addressed, funding issues that persist as a result of modeling differences and flaws in the design of the FTR Market should be borne by FTR holders operating in the voluntary FTR market and not imposed on load through the mechanism of balancing congestion.

For the 2014 to 2015 and 2015 to 2016 planning periods FTRs have been revenue adequate. This is not because the underlying problems have been fixed. Revenue adequacy has been accomplished by limiting the amount of available ARR and FTRs by arbitrarily decreasing the ARR allocations for Stage 1B and Stage 2 which also results in a redistribution of ARRs based on differences in allocations between Stage 1A and Stage 1B ARRs.



## Recommendations

In order to perform its role in PJM market design, the MMU evaluates existing and proposed PJM Market Rules and the design of the PJM Markets.<sup>1</sup> The MMU initiates and proposes changes to the design of the markets and the PJM Market Rules in stakeholder and regulatory proceedings.<sup>2</sup> In support of this function, the MMU engages in discussions with stakeholders, State Commissions, PJM management, and the PJM Board; participates in PJM stakeholder meetings and working groups regarding market design matters; publishes proposals, reports and studies on market design issues; and makes filings with the Commission on market design issues.<sup>3</sup> The MMU also recommends changes to the PJM Market Rules to the staff of the Commission's Office of Energy Market Regulation, State Commissions, and the PJM Board.<sup>4</sup> The MMU may provide in its annual, quarterly and other reports "recommendations regarding any matter within its purview."<sup>5</sup>

Priority rankings are relative. The creation of rankings recognizes that there are limited resources available to address market issues and that problems must be ranked in order to determine the order in which to address them. It does not mean that all the problems should not be addressed. Priority rankings are dynamic and as new issues are identified, priority rankings will change. The rankings reflect a number of factors including the significance of the issue for efficient markets, the difficulty of completion and the degree to which items are already in progress. A low ranking does not necessarily mean that an issue is not important, but could mean that the issue would be easy to resolve.

There are three priority rankings: High, Medium and Low. High priority indicates that the recommendation requires action because it addresses a market design issue that creates significant market inefficiencies and/or long lasting negative market effects. Medium priority indicates that the recommendation addresses a market design issue that creates intermediate

market inefficiencies and/or near term negative market effects. Low priority indicates that the recommendation addresses a market design issue that creates smaller market inefficiencies and/or more limited market effects or that it could be easily resolved.

The MMU is also tracking PJM's progress in addressing these recommendations. The MMU recognizes that part of the process of addressing recommendations may include discussions in the stakeholder process, FERC decisions and court decisions and those elements are included in the tracking. Each recommendation includes a status. The status categories are:

- **Adopted:** PJM has implemented the recommendation made by the MMU.
- **Adopted partially:** PJM has implemented part of the recommendation made by the MMU.
- **Not adopted:** PJM does not plan to implement the recommendation made by the MMU, or has not yet implemented any part of the recommendation made by the MMU. Where the subject of the recommendation is pending stakeholder or FERC action, that status is noted.

## New Recommendation

Consistent with its core function to "[e]valuate existing and proposed market rules, tariff provisions and market design elements and recommend proposed rule and tariff changes,"<sup>6</sup> the MMU recommends specific enhancements to existing market rules and implementation of new rules that are required for competitive results in PJM markets and for continued improvements in the functioning of PJM markets.

In this *2016 Quarterly State of the Market Report for PJM: January through March*, the MMU includes one new recommendation.

<sup>1</sup> OATT Attachment M § IV.D.

<sup>2</sup> *Id.*

<sup>3</sup> *Id.*

<sup>4</sup> *Id.*

<sup>5</sup> OATT Attachment M § VI.A.

<sup>6</sup> 18 CFR § 35.28(g)(3)(ii)(A); see also OATT Attachment M § IV.D.

## New Recommendation from Section 5, Capacity Market

The MMU recommends that all capacity imports be required to be deliverable to PJM load prior to the relevant Delivery Year to ensure that they are as close to full substitutes for internal, physical capacity resources as possible. Pseudo ties alone are not adequate to ensure deliverability. (Priority: High. New recommendation. Status: Not adopted.)

## Complete List of Current MMU Recommendations

The following recommendations are explained in greater detail in each section of the report.

### Section 3, Energy Market

- The MMU recommends that PJM retain the \$1,000 per MWh offer cap in the PJM energy market except when cost-based offers exceed \$1,000 per MWh, and retain other existing rules that limit incentives to exercise market power. (Priority: High. First reported 1999. Status: Partially adopted, 1999.)
- The MMU recommends that the rules governing the application of the TPS test be clarified and documented. (Priority: High. First reported 2010. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation when the TPS test is failed, that markup be constant across price and cost offers, that there be at least one cost-based offer using the same fuel as the available price-based offer. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that in order to ensure effective market power mitigation when the TPS test is failed, the operating parameters in the cost-based offer and the price-based parameter limited schedule (PLS) offer be at least as flexible as the operating parameters in the available non-PLS price-based offer, and that the price-MW pairs in the price based PLS offer be exactly equal to the price based non PLS offer. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM require all generating units to identify the fuel type associated with each of their offered schedules. (Priority: Low. First reported Q2, 2014. Status: Adopted in full, Q4, 2014.)
- The MMU recommends that under the Capacity Performance construct, PJM recognize the difference between operational parameters that indicate to PJM dispatchers what a unit is capable of during the operating day and the parameters that are used for capacity performance assessment as well as uplift payments. The parameters which determine non-performance charges and the amount of uplift payments to those generators should reflect the flexibility goals of the capacity performance construct. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that capacity performance resources and base capacity resources (during the June through September period) be held to the OEM operating parameters of the capacity market CONE reference resource for performance assessment and energy uplift payments. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM remove non-specific fuel types such as “other” or “co-fire other” from the list of fuel types available for market participants to identify the fuel type associated with their price and cost schedules. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that a unit which is not capable of supplying energy consistent with its day-ahead offer should reflect an appropriate outage rather than indicating its availability to supply energy on an emergency basis. (Priority: Low. First reported 2009. Status: Not Adopted.)
- The MMU recommends that PJM explain how LMPs are calculated when demand response is marginal. The LMPs in excess of \$1,800 per MWh on January 7, 2014, were potentially a result of the way in which PJM modeled zonal (not nodal) demand response as a marginal resource. (Priority: Low. First reported Q1, 2014. Status: Not Adopted.)
- The MMU recommends that PJM explicitly state its policy on the use of transmission penalty factors including the level of the penalty factors,

the triggers for the use of the penalty factors, the appropriate line ratings to trigger the use of penalty factors, and when the transmission penalty factors will be used to set the shadow price. (Priority: Medium. First reported 2015. Status: Not adopted.)

- The MMU recommends that PJM routinely review all transmission facility ratings and any changes to those ratings to ensure that the normal, emergency and load dump ratings used in modeling the transmission system are accurate and reflect standard ratings practice. (Priority: Low. First reported 2013. Status: Partially adopted.)
- The MMU recommends that the definition of maximum emergency status in the tariff apply at all times rather than just during maximum emergency events.<sup>7</sup> (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM update the outage impact studies, the reliability analyses used in RPM for capacity deliverability and the reliability analyses used in RTEP for transmission upgrades to be consistent with the more conservative emergency operations (post contingency load dump limit exceedance analysis) in the energy market that were implemented in June 2013. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that the roles of PJM and the transmission owners in the decision making process to control for local contingencies be clarified, that PJM's role be strengthened and that the process be made transparent. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM include in the appropriate manual an explanation of the initial creation of hubs, the process for modifying hub definitions and a description of how hub definitions have changed.<sup>8</sup> There is currently no PJM documentation in the tariff or manuals explaining how hubs are created and how their definitions are changed.<sup>9</sup> (Priority: Low. First reported 2013. Status: Not adopted.)

<sup>7</sup> PJM. OATT Section: 6A.1.3 Maximum Emergency, (February 25, 2014), p. 1740, 1795.

<sup>8</sup> According to minutes from the first meeting of the Energy Market Committee (EMC) on January 28, 1998, the EMC unanimously agreed to be responsible for approving additions, deletions and changes to the hub definitions to be published and modeled by PJM. Since the EMC has become the Market Implementation Committee (MIC), the MIC now appears to be responsible for such changes.

<sup>9</sup> The general definition of a hub can be found in PJM. "Manual 35: Definitions and Acronyms," Revision 23 (April 11, 2014).

- The MMU recommends that during hours when a generation bus shows a net withdrawal, the energy withdrawal be treated as load, not negative generation, for purposes of calculating load and load-weighted LMP. The MMU recommends that during hours when a load bus shows a net injection, the energy injection be treated as generation, not negative load, for purposes of calculating generation and load-weighted LMP. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM identify and collect data on available behind the meter generation resources, including nodal location information and relevant operating parameters. (Priority: Low. First reported 2013. Status: Partially adopted.)
- The MMU recommends that PJM continue to enhance its posting of market data to promote market efficiency. (Priority: Medium. First reported 2005. Status: Partially Adopted.)
- The MMU recommends the elimination of FMU and AU adders. FMU and AU adders no longer serve the purpose for which they were created and interfere with the efficient operation of PJM markets. (Priority: Medium. First reported 2012. Status: Adopted partially, Q4, 2014.)

## Section 4, Energy Uplift

The MMU recognizes that many of the issues addressed in the recommendations are being discussed in PJM stakeholder processes. Until new rules are in place, the MMU's recommendations and the reported status of those recommendations are based on the existing market rules.

- The MMU recommends that PJM not use closed loop interface constraints to artificially override the nodal prices that are based on fundamental LMP logic in order to: accommodate rather than resolve the inadequacies of the demand side resource capacity product; address the inability of the power flow model to incorporate the need for reactive power; accommodate rather than resolve the flaws in PJM's approach to scarcity pricing; or for any other reason. (Priority: Medium. First reported 2013. Status: Not adopted.)

- The MMU recommends that PJM not use price setting logic to artificially override the nodal prices that are based on fundamental LMP logic in order to reduce uplift. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM initiate an analysis of the reasons why some combustion turbines and diesels scheduled in the Day-Ahead Energy Market are not called in real time when they are economic. (Priority: Medium. First Reported 2012. Status: Not adopted.)
- The MMU recommends that PJM clearly identify and classify all reasons for incurring operating reserves in the Day-Ahead and the Real-Time Energy Markets and the associated operating reserve charges in order for all market participants to be made aware of the reasons for these costs and to help ensure a long term solution to the issue of how to allocate the costs of operating reserves. (Priority: Medium. First reported 2011. Status: Adopted 2014.)
- The MMU recommends that PJM revise the current operating reserve confidentiality rules in order to allow the disclosure of complete information about the level of operating reserve charges by unit and the detailed reasons for the level of operating reserve credits by unit in the PJM region. (Priority: High. First reported 2013. Status: Partially adopted.)
- The MMU recommends the elimination of the day-ahead operating reserve category to ensure that units receive an energy uplift payment based on their real-time output and not their day-ahead scheduled output. (Priority: Medium. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends reincorporating the use of net regulation revenues as an offset in the calculation of balancing operating reserve credits. (Priority: Medium. First reported 2009. Status: Not adopted. Stakeholder process.)
- The MMU recommends not compensating self-scheduled units for their startup cost when the units are scheduled by PJM to start before the self-scheduled hours. (Priority: Low. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends seven modifications to the energy lost opportunity cost calculations:
  - The MMU recommends that the lost opportunity cost in the energy market be calculated using the schedule on which the unit was scheduled to run in the energy market. (Priority: High. First reported 2012. Status: Adopted 2015.)
  - The MMU recommends including no load and startup costs as part of the total avoided costs in the calculation of lost opportunity cost credits paid to combustion turbines and diesels scheduled in the Day-Ahead Energy Market but not committed in real time. (Priority: Medium. First reported 2012. Status: Adopted 2015.)
  - The MMU recommends using the entire offer curve and not a single point on the offer curve to calculate energy lost opportunity cost. (Priority: Medium. First reported 2012. Status: Adopted 2015.)
  - The MMU recommends calculating LOC based on 24 hour daily periods or multi-hour segments of hours for combustion turbines and diesels scheduled in the Day-Ahead Energy Market but not committed in real time. (Priority: Medium. First reported 2014. Status: Not adopted.)
  - The MMU recommends that units scheduled in the Day-Ahead Energy Market and not committed in real time should be compensated for LOC based on their real-time desired and achievable output, not their scheduled day-ahead output. (Priority: Medium. First reported 2015. Status: Not adopted.)
  - The MMU recommends that units scheduled in the Day-Ahead Energy Market and not committed in real time be compensated for LOC incurred within an hour. (Priority: Medium. First reported 2013. Status: Not adopted.)
  - The MMU recommends that only flexible fast start units (startup plus notification times of 30 minutes or less) and short minimum run times (one hour or less) be eligible by default for the LOC compensation to units scheduled in the Day-Ahead Energy Market and not committed in real time. Other units should be eligible for LOC compensation

only if PJM explicitly cancels their day-ahead commitment. (Priority: Medium. First reported 2015. Status: Not adopted.)

- The MMU recommends that up to congestion transactions be required to pay energy uplift charges. (Priority: High. First reported 2011. Status: Not adopted. Stakeholder process.)
- The MMU recommends eliminating the use of internal bilateral transactions (IBTs) in the calculation of deviations used to allocate balancing operating reserve charges. (Priority: High. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends allocating the energy uplift payments to units scheduled as must run in the Day-Ahead Energy Market for reasons other than voltage/reactive or black start services as a reliability charge to real-time load, real-time exports and real-time wheels. (Priority: Medium. First reported 2014. Status: Not adopted. Stakeholder process.)
- The MMU recommends reallocating the operating reserve credits paid to units supporting the Con Edison – PJM Transmission Service Agreements. (Priority: Medium. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends that the total cost of providing reactive support be categorized and allocated as reactive services. Reactive services credits should be calculated consistent with the operating reserve credits calculation. (Priority: Medium. First reported 2012. Status: Not adopted. Stakeholder process.)
- The MMU recommends including real-time exports and real-time wheels in the allocation of the cost of providing reactive support to the 500 kV system or above, which is currently allocated solely to real-time RTO load. (Priority: Low. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends enhancing the current energy uplift allocation rules to reflect the elimination of day-ahead operating reserves, the timing of commitment decisions and the commitment reasons. (Priority: High. First reported Q2, 2012. Status: Not adopted. Stakeholder process.)

## Section 5, Capacity<sup>10</sup>

The MMU recognizes that PJM has implemented the Capacity Performance Construct to replace some of the existing core market rules and to address fundamental performance incentive issues. The MMU recognizes that the Capacity Performance Construct addresses many of the MMU's recommendations. The MMU's recommendations are based on the existing capacity market rules. The status is reported as adopted if the recommendation was included in FERC's order approving PJM's Capacity Performance filing.<sup>11</sup>

- The MMU recommends the enforcement of a consistent definition of capacity resource. The MMU recommends that the requirement to be a physical resource be enforced and enhanced. The requirement to be a physical resource should apply at the time of auctions and should also constitute a commitment to be physical in the relevant Delivery Year. The requirement to be a physical resource should be applied to all resource types, including planned generation, demand resources and imports.<sup>12 13</sup> (Priority: High. First reported 2013. Status: Not adopted. Pending before FERC.)
- The MMU recommends that the test for determining modeled Locational Deliverability Areas in RPM be redefined. A detailed reliability analysis of all at risk units should be included in the redefined model. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that there be an explicit requirement that Capacity Resource offers in the Day-Ahead Energy Market be competitive, where competitive is defined to be the short run marginal cost of the units. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends clear, explicit and detailed rules that define the conditions under which PJM will and will not recall energy from PJM capacity resources and prohibit new energy exports from PJM capacity resources. The MMU recommends that those rules define the conditions under which PJM will purchase emergency energy while at the same

<sup>10</sup> The MMU has identified serious market design issues with RPM and the MMU has made specific recommendations to address those issues. These recommendations have been made in public reports.

<sup>11</sup> *PJM Interconnection, LLC*, 151 FERC ¶ 61,208 (June 9, 2015).

<sup>12</sup> See also Comments of the Independent Market Monitor for PJM. Docket No. ER14-503-000 (December 20, 2013).

<sup>13</sup> See "Analysis of Replacement Capacity for RPM Commitments: June 1, 2007 to June 1, 2013," <[http://www.monitoringanalytics.com/reports/Reports/2013/IMM\\_Report\\_on\\_Capacity\\_Replacement\\_Activity\\_2\\_20130913.pdf](http://www.monitoringanalytics.com/reports/Reports/2013/IMM_Report_on_Capacity_Replacement_Activity_2_20130913.pdf)> (September 13, 2013).

time not recalling energy exports from PJM capacity resources. PJM has modified these rules, but they need additional clarification and operational details. (Priority: Low. First reported 2010. Status: Partially adopted.)

- The MMU recommends that the net revenue calculation used by PJM to calculate the net Cost of New Entry (CONE) VRR parameter reflect the actual flexibility of units in responding to price signals rather than using assumed fixed operating blocks that are not a result of actual unit limitations.<sup>14 15</sup> The result of reflecting the actual flexibility is higher net revenues, which affect the parameters of the RPM demand curve and market outcomes. (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that modifications to existing resources not be treated as new resources for purposes of market power related offer caps or MOPR offer floors. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that, as part of the MOPR unit specific standard of review, all projects be required to use the same basic modeling assumptions. That is the only way to ensure that projects compete on the basis of actual costs rather than on the basis of modeling assumptions.<sup>16</sup> (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends two changes to the RPM solution methodology related to make-whole payments and the iterative reconfiguration of the VRR curve:
  - The MMU recommends changing the RPM solution methodology to explicitly incorporate the cost of make-whole payments in the objective function. (Priority: Medium. First reported 2014. Status: Not adopted.)

<sup>14</sup> See PJM Interconnection, LLC, Docket No. ER12-513-000 (December 1, 2011) ("Triennial Review").

<sup>15</sup> See the 2012 State of the Market Report for PJM, Volume II, Section 6, Net Revenue.

<sup>16</sup> See 143 FERC ¶ 61,090 (2013) ("We encourage PJM and its stakeholders to consider, for example, whether the unit-specific review process would be more effective if PJM requires the use of common modeling assumptions for establishing unit-specific offer floors while, at the same time, allowing sellers to provide support for objective, individual cost advantages. Moreover, we encourage PJM and its stakeholders to consider these modifications to the unit-specific review process together with possible enhancements to the calculation of Net CONE."); see also, Comments of the Independent Market Monitor for PJM, Docket No. ER13-535-001 (March 25, 2013); Complaint of the Independent Market Monitor for PJM v. Unnamed Participant, Docket No. EL12-63-000 (May 1, 2012); Motion for Clarification of the Independent Market Monitor for PJM, Docket No. ER11-2875-000, et al. (February 17, 2012); Protest of the Independent Market Monitor for PJM, Docket No. ER11-2875-002 (June 2, 2011); Comments of the Independent Market Monitor for PJM, Docket Nos. EL11-20 and ER11-2875 (March 4, 2011).

- The MMU also recommends changing the RPM solution methodology to define variables for the nesting relationships in the BRA optimization model directly rather than employing the current iterative approach, in order to improve the efficiency and stability. (Priority: Medium. First reported 2014. Status: Not adopted.)
- The MMU recommends that the use of the 2.5 percent demand adjustment (Short Term Resource Procurement Target) be terminated immediately. The 2.5 percent should be added back to the overall market demand curve. (Priority: Medium. First reported 2013. Status: Adopted.)
- The MMU recommends that the definition of demand side resources be modified in order to ensure that such resources be fully substitutable for other generation capacity resources. Both the Limited and the Extended Summer DR products should be eliminated in order to ensure that the DR product has the same unlimited obligation to provide capacity year round as generation capacity resources. (Priority: High. First reported 2012. Status: Adopted.)
- The MMU recommends four changes with respect to capacity imports into PJM:
  - The MMU recommends that all capacity have firm transmission to the PJM border acquired prior to the offering in an RPM auction. (Priority: High. First reported 2014. Status: Adopted.)
  - The MMU recommends that all capacity imports be required to be deliverable to PJM load prior to the relevant Delivery Year to ensure that they are as close to full substitutes for internal, physical capacity resources as possible. Pseudo ties alone are not adequate to ensure deliverability. (Priority: High. New recommendation. Status: Not adopted.)
  - The MMU recommends that all capacity imports be required to be pseudo tied prior to the relevant Delivery Year in order to ensure that imports are as close to full substitutes for internal, physical capacity resources as possible. (Priority: High. First reported 2014. Status: Adopted.)

- The MMU recommends that all resources importing capacity into PJM accept a must offer requirement. (Priority: High. First reported 2014. Status: Adopted.)
- The MMU recommends improvements to the performance incentive requirements of RPM:
  - The MMU recommends that Generation Capacity Resources be paid on the basis of whether they produce energy when called upon during any of the hours defined as critical. One hundred percent of capacity market revenue should be at risk rather than only fifty percent. (Priority: High. First reported 2012. Status: Adopted.)
  - The MMU recommends that a unit which is not capable of supplying energy consistent with its day-ahead offer should reflect an appropriate outage. (Priority: Medium. First reported 2013. Status: Not adopted. Pending before FERC.)
  - The MMU recommends that PJM eliminate all OMC outages from the calculation of forced outage rates used for any purpose in the PJM Capacity Market. (Priority: Medium. First reported 2013. Status: Adopted 2015.)
  - The MMU recommends that PJM eliminate the broad exception related to lack of gas during the winter period for single-fuel, natural gas-fired units.<sup>17</sup> (Priority: Medium. First reported 2013. Status: Adopted 2015.)
- The MMU recommends that treatment of costs in RMR filings be emphasized. Customers should bear all the incremental costs, including incremental investment costs, required by the RMR service that the unit owner would not have incurred if the unit owner had deactivated its unit as it proposed. Generation owners should bear all other costs. (Priority: Low. First reported 2010. Status: Not adopted.)

<sup>17</sup> See OATT Attachment DD § 10(e). For more on this issue and related incentive issues, see the MMU's White Paper included in: Monitoring Analytics, LLC and PJM Interconnection, LLC, "Capacity in the PJM Market," <[http://www.monitoringanalytics.com/reports/Reports/2012/IMM\\_And\\_PJM\\_Capacity\\_White\\_Papers\\_On\\_OPSI\\_Issues\\_20120820.pdf](http://www.monitoringanalytics.com/reports/Reports/2012/IMM_And_PJM_Capacity_White_Papers_On_OPSI_Issues_20120820.pdf)> (August 20, 2012).

## Section 6, Demand Response

The MMU recognizes that PJM has incorporated some of these recommendations in the Capacity Performance filing. The status of each recommendation reflects the status at March 31, 2016.

- The MMU recommends, as a preferred alternative to having PJM demand side programs, that demand response be on the demand side of the markets and that customers be able to avoid capacity and energy charges by not using capacity and energy at their discretion and that customer payments be determined only by metered load. (Priority: High. First reported 2014. Status: Not adopted.)
- The MMU recommends that there be only one demand response product, with an obligation to respond when called for all hours of the year, and that the demand response be on the demand side of the capacity market. (Priority: High. First reported 2011. Status: Partially Adopted.<sup>18</sup>)
- The MMU recommends that the option to specify a minimum dispatch price under the Emergency and Pre-Emergency Program Full option be eliminated and that participating resources receive the hourly real-time LMP less any generation component of their retail rate. (Priority: Medium. First reported 2010. Status: Not adopted.)
- The MMU recommends that the emergency load response program be classified as an economic program, responding to economic price signals and not an emergency program responding only after an emergency is called and not triggering the definition of a PJM emergency. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends that the Emergency Program Energy Only option be eliminated because the opportunity to receive the appropriate energy market incentive is already provided in the Economic Program. (Priority: Low. First reported 2010. Status: Not adopted.)
- The MMU recommends that a daily energy market must offer requirement apply to demand resources, comparable to the rule applicable to generation

<sup>18</sup> PJM's Capacity Performance proposal includes this change. See "Reforms to the Reliability Pricing Market ("RPM") and Related Rules in the PJM Open Access Transmission Tariff ("Tariff") and Reliability Assurance Agreement Among Load Serving Entities ("RAA)," Docket No. ER15-632-000 and "PJM Interconnection, LLC." Docket No. EL15-29-000.

capacity resources.<sup>19</sup> (Priority: High. First reported 2013. Status: Not adopted.)

- The MMU recommends that the lead times for demand resources be shortened to 30 minutes with an hour minimum dispatch for all resources. (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends that demand resources be required to provide their nodal location, comparable to generation resources. (Priority: High. First reported 2011. Status: Not adopted.)
- The MMU recommends that PJM require nodal dispatch of demand resources with no advance notice required or, if nodal location is not required, subzonal dispatch of demand resources with no advance notice required. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM eliminate the measurement of compliance across zones within a compliance aggregation area (CAA). The multiple zone approach is less locational than the zonal and subzonal approach and creates larger mismatches between the locational need for the resources and the actual response. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends capping the baseline for measuring compliance under GLD, for the limited summer product, at the customers' PLC. (Priority: High. First reported 2010. Status: Adopted.)
- The MMU recommends capping the baseline for measuring capacity compliance under winter compliance at the customers' PLC, similar to GLD, to avoid double counting. (Priority: High. First reported 2010. Status: Partially adopted.)
- The MMU recommends that measurement and verification methods for demand resources be modified to reflect compliance more accurately. (Priority: Medium. First reported 2009. Status: Not adopted.)
- The MMU recommends that compliance rules be revised to include submittal of all necessary hourly load data, and that negative values

be included when calculating event compliance across hours and registrations. (Priority: Medium. First reported 2012. Status: Not adopted.)

- The MMU recommends that PJM adopt the ISO-NE five-minute metering requirements in order to ensure that dispatchers have the necessary information for reliability and that market payments to demand resources be calculated based on interval meter data at the site of the demand reductions.<sup>20</sup> (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that demand response event compliance be calculated for each hour and the penalty structure reflect hourly compliance for the base and capacity performance products. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that demand resources whose load drop method is designated as "Other" explicitly record the method of load drop. (Priority: Low. First reported 2013. Status: Adopted, Q2, 2014.)
- The MMU recommends that load management testing be initiated by PJM with limited warning to CSPs in order to more accurately represent the conditions of an emergency event. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that shutdown cost be defined as the cost to curtail load for a given period that does not vary with the measured reduction or, for behind the meter generators, be the start cost defined in Manual 15 for generators. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that the Net Benefits Test be eliminated and that demand response resources be paid LMP less any generation component of the applicable retail rate. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that the tariff rules for demand response clarify that a resource and its CSP, if any, must notify PJM of material changes affecting the capability of the resource to perform as registered and to terminate registrations that are no longer capable of responding to PJM

<sup>19</sup> See "Complaint and Motion to Consolidate of the Independent Market Monitor for PJM," Docket No. EL14-20-000 (January 27, 2014) at 1.

<sup>20</sup> See ISO-NE Tariff, Section III, Market Rule 1, Appendix E1 and Appendix E2, "Demand Response," <[http://www.iso-ne.com/regulatory/tariff/sect\\_3/mr1\\_append-e.pdf](http://www.iso-ne.com/regulatory/tariff/sect_3/mr1_append-e.pdf)>. (Accessed February 17, 2015) ISO-NE requires that DR have an interval meter with five minute data reported to the ISO and each behind the meter generator is required to have a separate interval meter. After June 1, 2017, demand response resources in ISO-NE must also be registered at a single node.

dispatch directives because load has been reduced or eliminated, such as in the case of bankrupt and/or out of service facilities. (Priority: Medium. First reported 2015. Status: Not adopted.)

## Section 7, Net Revenue

There are no recommendations in this section.

## Section 8, Environmental

There are no recommendations in this section.

## Section 9, Interchange Transactions

- The MMU recommends that PJM eliminate the IMO interface pricing point, and assign the transactions that originate or sink in the IESO balancing authority to the MISO interface pricing point. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM monitor, and adjust as necessary, the weights applied to the components of the interfaces to ensure that the interface prices reflect ongoing changes in system conditions. The MMU also recommends that PJM review the mappings of external balancing authorities to individual interface pricing points to reflect changes to the impact of the external power source on PJM tie lines as a result of system topology changes. The MMU recommends that this review occur at least annually. (Priority: Low. First reported 2009. Status: Not adopted.)
- The MMU recommends that the submission deadline for real-time dispatchable transactions be modified from 1800 on the day prior, to three hours prior to the requested start time, and that the minimum duration be modified from one hour to 15 minutes. These changes would give PJM a more flexible product that could be used to meet load in the most economic manner. (Priority: Medium. First reported 2014. Status: Adopted partially, Q1 2015.)
- The MMU recommends that PJM explore an interchange optimization solution with its neighboring balancing authorities that would remove the need for market participants to schedule physical transactions across seams. Such a solution would include an optimized, but limited, joint dispatch approach that uses supply curves and treats seams between balancing authorities as constraints, similar to other constraints within an LMP market. (Priority: Medium. First reported 2014. Status: Not adopted.)
- The MMU recommends that PJM permit unlimited spot market imports as well as unlimited non-firm point-to-point willing to pay congestion imports and exports at all PJM interfaces in order to improve the efficiency of the market. (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM implement a validation method for submitted transactions that would prohibit market participants from breaking transactions into smaller segments to defeat the interface pricing rule by concealing the true source or sink of the transaction. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM implement a validation method for submitted transactions that would require market participants to submit transactions on market paths that reflect the expected actual power flow in order to reduce unscheduled loop flows. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM implement rules to prevent sham scheduling. The MMU's proposed validation rules would address sham scheduling. (Priority: High. First reported 2012. Status: Not adopted. Stakeholder process.)
- The MMU requests that, in order to permit a complete analysis of loop flow, FERC and NERC ensure that the identified data are made available to market monitors as well as other industry entities determined appropriate by FERC. (Priority: Medium. First reported 2003. Status: Not adopted.)
- The MMU recommends that PJM implement additional business rules to remove the incentive to engage in sham scheduling activities using the PJM/IMO interface price. (Priority: Medium. First reported 2014. Status: Not adopted. Stakeholder process.)
- The MMU recommends that PJM eliminate the NIPSCO, Southeast and Southwest interface pricing points from the Day-Ahead and Real-Time

Energy Markets and, with VACAR, assign the transactions created under the reserve sharing agreement to the SouthIMP/EXP pricing point. (Priority: Low. First reported 2013. Status: Not adopted.)

- The MMU recommends that PJM immediately provide the required 12-month notice to Duke Energy Progress (DEP) to unilaterally terminate the Joint Operating Agreement. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM and MISO work together to align interface pricing definitions, using the same number of external buses and selecting buses in close proximity on either side of the border with comparable bus weights. (Priority: Medium. First reported 2012. Status: Adopted partially, Q4 2013.)
- The MMU recommends that PJMSettlement Inc. immediately request a credit evaluation from all companies that engaged in up to congestion transactions between September 8, 2014, and December 31, 2015. If PJM has the authority, PJM should ensure that the potential exposure to uplift for that period be included as a contingency in the companies' calculations for credit levels and/or collateral requirements. If PJM does not have the authority to take such steps, PJM should request guidance from FERC. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that the emergency interchange cap be replaced with a market based solution. (Priority: Low. First reported 2015. Status: Not adopted.)

## Section 10, Ancillary Services

- The MMU recommends that the Regulation Market be modified to incorporate a consistent application of the marginal benefit factor throughout the optimization, assignment and settlement process. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends a number of market design changes to improve the performance of the Regulation Market, including use of a single clearing price based on actual LMP, modifications to the LOC calculation methodology, a software change to save some data elements necessary

for verifying market outcomes, and further documentation of the implementation of the market design through SPREGO. (Priority: Medium. First reported 2010. Status: Partially adopted in 2012.)

- The MMU recommends that the lost opportunity cost in the ancillary services markets be calculated using the schedule on which the unit was scheduled to run in the energy market. (Priority: High. First reported 2010. Status: Partially Adopted.)
- The MMU recommends that the single clearing price for synchronized reserves be determined based on the actual LMP and not the forecast LMP. (Priority: Low. First reported 2010. Status: Adopted.)
- The MMU recommends that the rule requiring the payment of tier 1 synchronized reserve resources when the non-synchronized reserve price is above zero be eliminated immediately. (Priority: High. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends that no payments be made to tier 1 resources if they are deselected in the PJM market solution. The MMU also recommends that documentation of the Tier 1 synchronized reserve deselection process be published. (Priority: High. First reported 2014. Status: Adopted July 2014.)
- The MMU recommends that the tier 2 synchronized reserve must offer requirement be enforced. The MMU recommends that PJM define a set of acceptable reasons why a unit can be made unavailable daily or hourly and require operators to select a reason in Markets Gateway whenever making a unit unavailable. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM be explicit about why tier 1 biasing is used in the Tier 2 Synchronized Reserve Market. The MMU recommends that PJM define explicit rules for the use of tier 1 biasing during any phase of the market solution and identify the relevant rule for each instance of biasing. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM replace the DASR Market with a real-time secondary reserve product that is available and dispatchable in real time. (Priority: Low. First reported 2013. Status: Not adopted.)

- The MMU recommends that PJM revise the current confidentiality rules in order to specifically allow a more transparent disclosure of information regarding black start resources and their associated payments in PJM. (Priority: Low. First reported 2013. Status: Partially adopted, 2014.)
- The MMU recommends that the three pivotal supplier test and market power mitigation be incorporated in the DASR Market. (Priority: Low. First reported 2009. Status: Not adopted.)
- The MMU recommends that a reason code be attached to every hour in which PJM market operations adds additional DASR MW. (Priority: Medium. First reported 2015. Status: not adopted.)

## Section 11, Congestion and Marginal Losses

There are no recommendations in this section.

## Section 12, Planning

The MMU recommends improvements to the planning process.

- The MMU recommends that PJM continue to incorporate the principle that the goal of transmission planning should be the incorporation of transmission investment decisions into market driven processes as much as possible. (Priority: Low. First reported 2001. Status: Not adopted.)
- The MMU recommends the creation of a mechanism to permit a direct comparison, or competition, between transmission and generation alternatives, including which alternative is less costly and who bears the risks associated with each alternative. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that rules be implemented to permit competition to provide financing for transmission projects. This competition could reduce the cost of capital for transmission projects and significantly reduce total costs to customers. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that rules be implemented to require that project cost caps on new transmission projects be part of the evaluation

of competing projects. (Priority: Low. First reported 2015. Status: Not adopted.)

- The MMU recommends that barriers to entry be addressed in a timely manner in order to help ensure that the capacity market will result in the entry of new capacity to meet the needs of PJM market participants and reflect the uncertainty and resultant risks in the cost of new entry used to establish the capacity market demand curve in RPM. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that the question of whether Capacity Injection Rights (CIRs) should persist after the retirement of a unit be addressed. Even if the treatment of CIRs remains unchanged, the rules need to ensure that incumbents cannot exploit control of CIRs to block or postpone entry of competitors.<sup>21</sup> (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends outsourcing interconnection studies to an independent party to avoid potential conflicts of interest. Currently, these studies are performed by incumbent transmission owners under PJM's direction. This creates potential conflicts of interest, particularly when transmission owners are vertically integrated and the owner of transmission also owns generation. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends improvements in queue management including that PJM establish a review process to ensure that projects are removed from the queue if they are not viable, as well as a process to allow commercially viable projects to advance in the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming. (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends an analysis of the study phase of PJM's transmission planning to reduce the need for postponements of study results, to decrease study completion times, and to improve the likelihood that a project at a given phase in the study process will successfully go into service. (Priority: Medium. First reported 2014. Status: Partially adopted.)

<sup>21</sup> See "Comments of the Independent Market Monitor for PJM," Docket No. ER12-1177-000, <[http://www.monitoringanalytics.com/reports/Reports/2012/IMM\\_Comments\\_ER12-1177-000\\_20120312.pdf](http://www.monitoringanalytics.com/reports/Reports/2012/IMM_Comments_ER12-1177-000_20120312.pdf)>.

- The MMU recommends that PJM establish fair terms of access to rights of way and property, such as at substations, in order to remove any barriers to entry and permit competition between incumbent transmission providers and merchant transmission providers in the RTEP. (Priority: Medium. First reported 2014. Status: Not adopted.)
- The MMU recommends that PJM enhance the transparency and queue management process for merchant transmission investment. Issues related to data access and complete explanations of cost impacts should be addressed. The goal should be to remove barriers to competition from merchant transmission. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends consideration of changing the minimum distribution factor in the allocation from .01 to .00 and adding a threshold minimum usage impact on the line. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM reevaluate all transmission outage tickets as on time or late as if they were new requests when an outage is rescheduled and apply the standard rules for late submissions to any such outages. (Priority: Low. First reported 2014. Status: Not adopted.)
- The MMU recommends that PJM draft a clear definition of the congestion analysis required for transmission outage requests to include in Manual 3 after appropriate review. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM modify the rules to reduce or eliminate the approval of late outage requests submitted or rescheduled after the FTR auction bidding opening date. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM not permit transmission owners to divide long duration outages into smaller segments to avoid complying with the requirements for long duration outages. (Priority: Low. First reported 2015. Status: Not adopted.)

## Section 13, FTRs and ARR

- The MMU recommends that the ARR/FTR design be modified to ensure that all congestion revenues are returned to load. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that all FTR auction revenue be distributed to ARR holders. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that historical generation to load paths be eliminated as a basis for allocating ARRs. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that counter flow FTRs be eliminated. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that FTR auction revenues not be used to buy counter flow FTRs with the purpose of improving FTR payout ratios.<sup>22</sup> (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM report correct monthly payout ratios to reduce understatement of payout ratios on a monthly basis. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM eliminate portfolio netting to eliminate cross subsidies among FTR marketplace participants. (Priority: High. First reported 2012. Status: Not adopted. Pending before FERC.)
- The MMU recommends that PJM eliminate subsidies to counter flow FTRs by applying the payout ratio to counter flow FTRs in the same way the payout ratio is applied to prevailing flow FTRs. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM eliminate geographic cross subsidies. (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM improve transmission outage modeling in the FTR auction models. (Priority: Low. First reported 2013. Status: Adopted partially, 14/15 planning period.)
- The MMU recommends that PJM reduce FTR sales on paths with persistent overallocation of FTRs including clear rules for what defines persistent

<sup>22</sup> See PJM. "Manual 6: Financial Transmission Rights" Revision 16 (June 1, 2014), p. 56.

overallocation and how the reduction will be applied. (Priority: High. First reported 2013. Status: Adopted partially, 14/15 planning period.)

- The MMU recommends that PJM implement a seasonal ARR and FTR allocation system to better represent outages. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that the basis for the Stage 1A assignments be reviewed and made explicit, that the role of out of date generation to load paths be reviewed and that the building of the transmission capability required to provide all defined Stage 1A allocations be reviewed. (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM apply the FTR forfeiture rule to up to congestion transactions consistent with the application of the FTR forfeiture rule to increment offers and decrement bids. (Priority: High. First reported 2013. Status: Not adopted. Pending before FERC.)
- The MMU recommends that PJM examine the mechanism by which self scheduled FTRs are allocated when load switching among LSEs occurs throughout the planning period. (Priority: Low. First reported 2011. Status: Not adopted.)



## Energy Market

The PJM Energy Market comprises all types of energy transactions, including the sale or purchase of energy in PJM's Day-Ahead and Real-Time Energy Markets, bilateral and forward markets and self-supply. Energy transactions analyzed in this report include those in the PJM Day-Ahead and Real-Time Energy Markets. These markets provide key benchmarks against which market participants may measure results of transactions in other markets.

The Market Monitoring Unit (MMU) analyzed measures of market structure, participant conduct and market performance for the first three months of 2016, including market size, concentration, residual supply index, and price.<sup>1</sup> The MMU concludes that the PJM energy market results were competitive in the first three months of 2016.

**Table 3-1 The energy market results were competitive**

Market Element	Evaluation	Market Design
Market Structure: Aggregate Market	Competitive	
Market Structure: Local Market	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Effective

- The aggregate market structure was evaluated as competitive because the calculations for hourly HHI (Herfindahl-Hirschman Index) indicate that by the FERC standards, the PJM Energy Market in the first three months of 2016 was moderately concentrated. Average HHI was 1300 with a minimum of 1133 and a maximum of 1561 in the first three months of 2016. The fact that the average HHI was in the moderately concentrated range does not mean that the aggregate market was competitive in all hours. The PJM Energy Market intermediate and peaking segments of supply were highly concentrated.

- The local market structure was evaluated as not competitive due to the highly concentrated ownership of supply in local markets created by transmission constraints. The results of the three pivotal supplier (TPS) test, used to test local market structure, indicate the existence of market power in local markets created by transmission constraints. The local market performance is competitive as a result of the application of the TPS test. While transmission constraints create the potential for the exercise of local market power, PJM's application of the three pivotal supplier test identified local market power and resulted in offer capping to force competitive offers, correcting for structural issues created by local transmission constraints. There are, however, identified issues with the application of market power mitigation to resources whose owners fail the TPS test that need to be addressed.
- Participant behavior was evaluated as competitive because the analysis of markup shows that marginal units generally make offers at, or close to, their marginal costs in both Day-Ahead and Real-Time Energy Markets, although the behavior of some participants both routinely and during periods of high demand is consistent with economic withholding.
- Market performance was evaluated as competitive because market results in the energy market reflect the outcome of a competitive market, as PJM prices are set, on average, by marginal units operating at, or close to, their marginal costs in both Day-Ahead and Real-Time Energy Markets, although high markups during periods of high demand did affect prices.
- Market design was evaluated as effective because the analysis shows that the PJM energy market resulted in competitive market outcomes. In general, PJM's energy market design provides incentives for competitive behavior and results in competitive outcomes. In local markets, where market power is an issue, the market design identifies market power and causes the market to provide competitive market outcomes. The role of UTCs in the Day-Ahead Energy Market continues to cause concerns.

PJM markets are designed to promote competitive outcomes derived from the interaction of supply and demand in each of the PJM markets. Market design itself is the primary means of achieving and promoting competitive

<sup>1</sup> Analysis of 2015 market results requires comparison to prior years. In 2004 and 2005, PJM conducted the phased integration of five control zones: ComEd, American Electric Power (AEP), The Dayton Power & Light Company (DAY), Duquesne Light Company (DLCO) and Dominion. In June 2011, PJM integrated the American Transmission Systems, Inc. (ATSI) Control Zone. In January 2012, PJM integrated the Duke Energy Ohio/Kentucky (DEOK) Control Zone. In June 2013, PJM integrated the Eastern Kentucky Power Cooperative (EKPC). By convention, control zones bear the name of a large utility service provider working within their boundaries. The nomenclature applies to the geographic area, not to any single company. For additional information on the control zones, the integrations, their timing and their impact on the footprint of the PJM service territory, see the 2015 State of the Market Report for PJM, Appendix A, "PJM Geography."

outcomes in PJM markets. One of the MMU's primary goals is to identify actual or potential market design flaws.<sup>2</sup> The approach to market power mitigation in PJM has focused on market designs that promote competition (a structural basis for competitive outcomes) and on limiting market power mitigation to instances where the market structure is not competitive and thus where market design alone cannot mitigate market power. In the PJM energy market, this occurs primarily in the case of local market power. When a transmission constraint creates the potential for local market power, PJM applies a structural test to determine if the local market is competitive, applies a behavioral test to determine if generator offers exceed competitive levels and applies a market performance test to determine if such generator offers would affect the market price.<sup>3</sup> There are, however, identified issues with the application of market power mitigation to resources whose owners fail the TPS test that can result in the exercise of local market power. These issues need to be addressed. There are issues related to the definition of gas costs includable in energy offers that need to be addressed. There are currently no market power mitigation rules in place that limit the ability to exercise market power when aggregate market conditions are tight. If market-based offer caps are raised, or if generators are allowed to modify offers hourly, market design must reflect appropriate incentives for competitive behavior and aggregate market power mitigation rules need to be developed.

## Overview

### Market Structure

- **Supply.** Supply includes physical generation and imports and virtual transactions. Average offered real-time generation decreased by 3,886 MW, or 2.4 percent, in the first three months of 2016 from an average maximum of 164,790 in the first three months 2015 to 160,904 MW in the first three months 2016. In the first three months 2016, 994.8 MW of new capacity were added and 51.0 MW were retired.

<sup>2</sup> PJM. OATT Attachment M (PJM Market Monitoring Plan).

<sup>3</sup> The market performance test means that offer capping is not applied if the offer does not exceed the competitive level and therefore market power would not affect market performance.

PJM average real-time generation in the first three months of 2016 decreased by 9.5 percent from the first three months of 2015, from 97,741 MW to 88,470 MW.

PJM average day-ahead supply in the first three months of 2016, including INCs and up to congestion transactions, increased by 8.0 percent from the first three months of 2015, from 123,424 MW to 133,263 MW, primarily as a result of an increase in UTC volumes.

- **Market Concentration.** The PJM energy market was moderately concentrated overall with moderate concentration in the baseload segment, but high concentration in the intermediate and peaking segments.
- **Generation Fuel Mix.** During the first three months of 2016, coal units provided 32.1 percent, nuclear units 36.6 percent and gas units 25.4 percent of total generation. Compared to the first three months 2015, generation from coal units decreased 31.7 percent, generation from gas units increased 19.0 percent and generation from nuclear units increased 2.0 percent.
- **Marginal Resources.** In the PJM Real-Time Energy Market, in the first three months of 2016, coal units were 43.36 percent of marginal resources and natural gas units were 44.55 percent of marginal resources. In the first three months of 2015, coal units were 57.21 percent and natural gas units were 33.10 percent of the marginal resources.

In the PJM Day-Ahead Energy Market, in the first three months of 2016, up to congestion transactions were 83.2 percent of marginal resources, INCs were 4.0 percent of marginal resources, DECs were 6.9 percent of marginal resources, and generation resources were 5.9 percent of marginal resources. In the first three months of 2015, up to congestion transactions were 72.8 percent of marginal resources, INCs were 5.7 percent of marginal resources, DECs were 8.5 percent of marginal resources, and generation resources were 12.3 percent of marginal resources.

- **Demand.** Demand includes physical load and exports and virtual transactions. The PJM system peak load during the first three months of 2016 was 129,876 MW in the HE 0800 on January 19, 2016, which was 13,210 MW, or 9.2 percent, lower than the PJM peak load for the

first three months of 2015, which was 143,086 MW in the HE 0800 on February 20, 2015.

PJM average real-time load in the first three months of 2016 decreased by 8.8 percent from the first three months of 2015, from 97,936 MW to 89,322 MW. PJM average day-ahead demand in the first three months of 2016, including DECs and up to congestion transactions, increased by 9.6 percent from the first three months of 2015, from 119,078 MW to 130,534 MW.

- **Supply and Demand: Load and Spot Market.** Companies that serve load in PJM can do so using a combination of self-supply, bilateral market purchases and spot market purchases. For the first three months of 2016, 7.4 percent of real-time load was supplied by bilateral contracts, 26.6 percent by spot market purchases and 66.0 percent by self-supply. Compared with the first three months of 2015, reliance on bilateral contracts increased by 1.1 percent, reliance on spot market purchases decreased by 6.6 percentage points and reliance on self-supply increased by 5.5 percentage points.
- **Supply and Demand: Scarcity.** There were no shortage pricing events in the first three months of 2016.

## Market Behavior

- **Offer Capping for Local Market Power.** PJM offer caps units when the local market structure is noncompetitive. Offer capping is an effective means of addressing local market power. Offer capping levels have historically been low in PJM. In the Day-Ahead Energy Market, for units committed to provide energy for local constraint relief, offer-capped unit hours decreased from 0.3 percent in the first three months of 2015 to 0.1 percent in the first three months of 2016. In the Real-Time Energy Market, for units committed to provide energy for local constraint relief, offer-capped unit hours decreased from 0.6 percent in the first three months of 2015 to 0.4 percent in the first three months of 2016.

In the first three months of 2016, 10 control zones experienced congestion resulting from one or more constraints binding for 25 or more hours. The

analysis of the application of the TPS test to local markets demonstrates that it is working successfully to identify pivotal owners when the market structure is noncompetitive and to ensure that owners are not subject to offer capping when the market structure is competitive. There are, however, identified issues with the application of market power mitigation to resources whose owners fail the TPS test that can result in the exercise of local market power. These issues need to be addressed.

- **Offer Capping for Reliability.** PJM also offer caps units that are committed for reliability reasons, specifically for black start service and reactive service. In the Day-Ahead Energy Market, for units committed for reliability reasons, offer-capped unit hours decreased from 0.3 percent in the first three months of 2015 to 0.1 percent in the first three months of 2016. In the Real-Time Energy Market, for units committed for reliability reasons, offer-capped unit hours decreased from 0.3 percent in the first three months of 2015 to 0.1 percent in the first three months of 2016.
- **Markup Index.** The markup index is a summary measure of participant offer behavior for individual marginal units. In the PJM Real-Time Energy Market, when using unadjusted cost offers, in the first three months of 2016, 89.2 percent of marginal units had average dollar markups less than zero and had an average markup index less than zero. Using adjusted cost offers, in the first three months of 2016, 89.2 percent of marginal units had average dollar markups less than zero and average markup index less than or equal to zero. Some marginal units did have substantial markups. Among the units that were marginal in the first three months of 2016, none had offer prices above \$400 per MWh.

In the PJM Day-Ahead Energy Market, when using unadjusted cost offers, in the first three months of 2016, no marginal generating units had an average markup index less than or equal to zero. Using adjusted cost offers, in the first three months of 2016, no marginal units had an average markup index less than or equal to zero.

- **Frequently Mitigated Units (FMU) and Associated Units (AU).** A new FMU rule became effective November 1, 2014, limiting the availability of FMU adders to units with net revenues less than unit going forward costs.

The number of units that were eligible for an FMU or AU adder declined from an average of 70 units during the first 11 months of 2014, to zero since December 2014.

- **Virtual Offers and Bids.** Any market participant in the PJM Day-Ahead Energy Market can use increment offers, decrement bids, up to congestion transactions, import transactions and export transactions as financial instruments that do not require physical generation or load. The reduction in up to congestion transactions (UTC) that had followed a FERC order setting September 8, 2014, as the effective date for any uplift charges subsequently assigned to UTCs, was reversed. There was an increase in up to congestion volume as a result of the expiration of the fifteen month resettlement period for the proceeding related to uplift charges for UTC transactions. In the first three months of 2016, the average hourly up to congestion submitted MW increased by 146.1 percent from 59,004 MW in the first three months of 2015 to 145,243 MW in the first three months of 2016, and cleared MW increased by 113.6 percent from 17,178 MW in the first three months of 2015 to 36,688 MW in the first three months of 2016.
- **Generator Offers.** Generator offers are categorized as dispatchable and self scheduled. Units which are available for economic dispatch are dispatchable. Units which are self scheduled to generate fixed output are categorized as self scheduled. Units which are self scheduled at their economic minimum and are available for economic dispatch up to their economic maximum are categorized as self scheduled and dispatchable. Of all generator offers in the first three months of 2016, 54.0 percent were offered as available for economic dispatch, 22.1 percent were offered as self scheduled, and 16.3 percent were offered as self scheduled and dispatchable.

## Market Performance

- **Prices.** PJM LMPs are a direct measure of market performance. Price level is a good, general indicator of market performance, although the number of factors influencing the overall level of prices means it must be analyzed carefully. Among other things, overall average prices reflect

changes in supply and demand, generation fuel mix, the cost of fuel, emission related expenses, markup and local price differences caused by congestion. PJM also may administratively set prices with the creation of a closed loop interface related to demand side resources or reactive power or the application of price setting logic.

PJM Real-Time Energy Market prices decreased in the first three months of 2016 compared to the first three months of 2015. The load-weighted average real-time LMP was 47.4 percent lower in the first three months of 2016 than in the first three months of 2015, \$26.80 per MWh versus \$50.91 per MWh.

PJM Day-Ahead Energy Market prices decreased in the first three months of 2016 compared to the first three months of 2015. The load-weighted average day-ahead LMP was 46.3 percent lower in the first three months of 2016 than in the first three months of 2015, \$27.94 per MWh versus \$52.02 per MWh.

- **Components of LMP.** In the PJM Real-Time Energy Market, for the first three months of 2016, 54.2 percent of the load-weighted LMP was the result of coal costs, 22.3 percent was the result of gas costs and 2.28 percent was the result of the cost of emission allowances.

In the PJM Day-Ahead Energy Market for the first three months of 2016, 35.5 percent of the load-weighted LMP was the result of the cost of coal, 20.8 percent was the result of DECs, 12.5 percent was the result of the cost of gas, 13.8 percent was the result of INCs, and 4.6 percent was the result of up to congestion transactions.

- **Markup.** The markup conduct of individual owners and units has an identifiable impact on market prices. Markup is a key indicator of the competitiveness of the Energy Market.

In the PJM Real-Time Energy Market in the first three months of 2016, the adjusted markup component of LMP was \$0.46 per MWh or 1.7 percent of the PJM real-time, load-weighted average LMP. The month of March had the highest adjusted markup component, \$1.82 per MWh, or 7.44 percent of the real-time load-weighted average LMP. Using the unadjusted cost

offers, the highest markup in the first three months of 2016 was \$216.98 per MWh.

In the PJM Day-Ahead Energy Market, marginal INCs, DECs and UTCs have zero markups. In the first three months of 2016, the adjusted markup component of LMP resulting from generation resources was \$0.86 per MWh or 3.1 percent of the PJM day-ahead load-weighted average LMP. The month of February had the highest adjusted markup component, \$0.90 per MWh or 3.2 percent of the day-ahead load-weighted average LMP.

Participant behavior was evaluated as competitive because the analysis of markup shows that marginal units generally make offers at, or close to, their marginal costs in both the Day-Ahead and Real-Time Energy Markets, although the behavior of some participants during the high demand periods in the first three months of 2016 is consistent with economic withholding.

- **Price Convergence.** Hourly and daily price differences between the Day-Ahead and Real-Time Energy Markets fluctuate continuously and substantially from positive to negative. The difference between the average day-ahead and real-time prices was  $-\$1.23$  per MWh in the first three months of 2015 and  $-\$1.30$  per MWh in the first three months of 2016. The difference between average day-ahead and real-time prices, by itself, is not a measure of the competitiveness or effectiveness of the Day-Ahead Energy Market.

## Scarcity

- There were no shortage pricing events in the first three months of 2016.

## Recommendations

- The MMU recommends that PJM retain the \$1,000 per MWh offer cap in the PJM energy market except when cost-based offers exceed \$1,000 per MWh, and retain other existing rules that limit incentives to exercise market power. (Priority: High. First reported 1999. Status: Partially adopted, 1999.)

- The MMU recommends that the rules governing the application of the TPS test be clarified and documented. (Priority: High. First reported 2010. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation when the TPS test is failed, that markup be constant across price and cost offers, that there be at least one cost-based offer using the same fuel as the available price-based offer. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that in order to ensure effective market power mitigation when the TPS test is failed, the operating parameters in the cost-based offer and the price-based parameter limited schedule (PLS) offer be at least as flexible as the operating parameters in the available non-PLS price-based offer, and that the price-MW pairs in the price based PLS offer be exactly equal to the price based non-PLS offer. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM require all generating units to identify the fuel type associated with each of their offered schedules. (Priority: Low. First reported Q2, 2014. Status: Adopted in full, Q4, 2014.)
- The MMU recommends that under the Capacity Performance construct, PJM recognize the difference between operational parameters that indicate to PJM dispatchers what a unit is capable of during the operating day and the parameters that are used for capacity performance assessment as well as uplift payments. The parameters which determine non-performance charges and the amount of uplift payments to those generators should reflect the flexibility goals of the capacity performance construct. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that capacity performance resources and base capacity resources (during the June through September period) be held to the OEM operating parameters of the capacity market CONE reference resource for performance assessment and energy uplift payments. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM remove non-specific fuel types such as “other” or “co-fire other” from the list of fuel types available for market

participants to identify the fuel type associated with their price and cost schedules. (Priority: Medium. First reported 2015. Status: Not adopted.)

- The MMU recommends that a unit which is not capable of supplying energy consistent with its day-ahead offer should reflect an appropriate outage rather than indicating its availability to supply energy on an emergency basis. (Priority: Low. First reported 2009. Status: Not Adopted.)
- The MMU recommends that PJM explain how LMPs are calculated when demand response is marginal. The LMPs in excess of \$1,800 per MWh on January 7, 2014, were potentially a result of the way in which PJM modeled zonal (not nodal) demand response as a marginal resource. (Priority: Low. First reported Q1, 2014. Status: Not Adopted.)
- The MMU recommends that PJM explicitly state its policy on the use of transmission penalty factors including the level of the penalty factors, the triggers for the use of the penalty factors, the appropriate line ratings to trigger the use of penalty factors, and when the transmission penalty factors will be used to set the shadow price. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM routinely review all transmission facility ratings and any changes to those ratings to ensure that the normal, emergency and load dump ratings used in modeling the transmission system are accurate and reflect standard ratings practice. (Priority: Low. First reported 2013. Status: Partially adopted.)
- The MMU recommends that the definition of maximum emergency status in the tariff apply at all times rather than just during maximum emergency events.<sup>4</sup> (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM update the outage impact studies, the reliability analyses used in RPM for capacity deliverability and the reliability analyses used in RTEP for transmission upgrades to be consistent with the more conservative emergency operations (post contingency load dump limit exceedance analysis) in the energy market that were implemented in June 2013. (Priority: Low. First reported 2013. Status: Not adopted.)

<sup>4</sup> PJM. OATT Section: 6A.1.3 Maximum Emergency, (February 25, 2014), p. 1740, 1795.

- The MMU recommends that the roles of PJM and the transmission owners in the decision making process to control for local contingencies be clarified, that PJM's role be strengthened and that the process be made transparent. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM include in the appropriate manual an explanation of the initial creation of hubs, the process for modifying hub definitions and a description of how hub definitions have changed.<sup>5</sup> There is currently no PJM documentation in the tariff or manuals explaining how hubs are created and how their definitions are changed.<sup>6</sup> (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that during hours when a generation bus shows a net withdrawal, the energy withdrawal be treated as load, not negative generation, for purposes of calculating load and load-weighted LMP. The MMU recommends that during hours when a load bus shows a net injection, the energy injection be treated as generation, not negative load, for purposes of calculating generation and load-weighted LMP. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM identify and collect data on available behind the meter generation resources, including nodal location information and relevant operating parameters. (Priority: Low. First reported 2013. Status: Partially adopted.)
- The MMU recommends that PJM continue to enhance its posting of market data to promote market efficiency. (Priority: Medium. First reported 2005. Status: Partially Adopted.)
- The MMU recommends the elimination of FMU and AU adders. FMU and AU adders no longer serve the purpose for which they were created and interfere with the efficient operation of PJM markets. (Priority: Medium. First reported 2012. Status: Adopted partially, Q4, 2014.)

<sup>5</sup> According to minutes from the first meeting of the Energy Market Committee (EMC) on January 28, 1998, the EMC unanimously agreed to be responsible for approving additions, deletions and changes to the hub definitions to be published and modeled by PJM. Since the EMC has become the Market Implementation Committee (MIC), the MIC now appears to be responsible for such changes.

<sup>6</sup> The general definition of a hub can be found in PJM. "Manual 35: Definitions and Acronyms," Revision 23 (April 11, 2014).

## Conclusion

The MMU analyzed key elements of PJM energy market structure, participant conduct and market performance in the first three months of 2016, including aggregate supply and demand, concentration ratios, three pivotal supplier test results, offer capping, participation in demand response programs, loads and prices.

Average PJM real-time generation decreased by 3,886 MW, or 2.4 percent, and peak load decreased by 13,210 MW, in the first three months of 2016 compared to the first three months of 2015. Market concentration levels remained moderate although there is high concentration in the intermediate and peaking segments of the supply curve which adds to concerns about market power when market conditions are tight. The relationship between supply and demand, regardless of the specific market, balanced by market concentration, is referred to as the supply-demand fundamentals or economic fundamentals. While the market structure does not guarantee competitive outcomes, overall the market structure of the PJM aggregate energy market remains reasonably competitive for most hours although aggregate market power does exist during high demand hours.

Prices are a key outcome of markets. Prices vary across hours, days and years for multiple reasons. Price is an indicator of the level of competition in a market although individual prices are not always easy to interpret. In a competitive market, prices are directly related to the marginal cost of the most expensive unit required to serve load in each hour. The pattern of prices within days and across months and years illustrates how prices are directly related to supply and demand conditions and thus also illustrates the potential significance of the impact of the price elasticity of demand on prices. Energy market results in the first three months of 2016 generally reflected supply-demand fundamentals, although the behavior of some participants during high demand periods is consistent with economic withholding. Economic withholding is the ability to increase markups substantially in tight market conditions. There are additional issues in the energy market including the uncertainties about the pricing and availability of natural gas, the way that

generation owners incorporate natural gas costs in offers, and the lack of adequate incentives for unit owners to take all necessary actions to acquire fuel and operate rather than take an outage.

The three pivotal supplier test is applied by PJM on an ongoing basis for local energy markets in order to determine whether offer capping is required for transmission constraints.<sup>7</sup> This is a flexible, targeted real-time measure of market structure which replaced the offer capping of all units required to relieve a constraint. A generation owner or group of generation owners is pivotal for a local market if the output of the owners' generation facilities is required in order to relieve a transmission constraint. When a generation owner or group of owners is pivotal, it has the ability to increase the market price above the competitive level. The three pivotal supplier test explicitly incorporates the impact of excess supply and implicitly accounts for the impact of the price elasticity of demand in the market power tests. The result of the introduction of the three pivotal supplier test was to limit offer capping to times when the local market structure was noncompetitive and specific owners had structural market power. The analysis of the application of the three pivotal supplier test demonstrates that it is working for most hours to exempt owners when the local market structure is competitive and to require offer capping of owners when the local market structure is noncompetitive.

However, there are some issues with the application of mitigation in the Day-Ahead Energy Market and the Real-Time Energy Market when market sellers fail the TPS test. There is no tariff or manual language that defines in detail the application of the TPS test and offer capping in the Day-Ahead Energy Market and the Real-Time Energy Market. In both the Day-Ahead and Real-Time Energy Markets, generators have the ability to avoid mitigation by using varying markups in their price-based offers, offering different operating parameters in their price-based and cost-based offers, and using different fuels in their price-based and cost-based offers. These issues can be resolved by simple rule changes requiring that markup be constant across price and cost offers, that there be at least one cost-based offer using the same fuel as the available price-based offer, that the price-MW pairs in the price-based

<sup>7</sup> The MMU reviews PJM's application of the TPS test and brings issues to the attention of PJM.

PLS offer be exactly equal to the price-based non-PLS offer, and requiring cost-based and price-based PLS offers to be at least as flexible as price-based non-PLS offers.

PJM also offer caps units that are committed for reliability reasons in addition to units committed to provide constraint relief. Specifically, units that are committed to provide reactive support and black start service are offer capped in the energy market. These units are committed manually in both the Day-Ahead and Real-Time Energy Markets.

With or without a capacity market, energy market design must permit scarcity pricing when such pricing is consistent with market conditions and constrained by reasonable rules to ensure that market power is not exercised. Scarcity pricing can serve two functions in wholesale power markets: revenue adequacy and price signals. Scarcity pricing for revenue adequacy is not required in PJM. Scarcity pricing for price signals that reflect market conditions during periods of scarcity is required in PJM. Scarcity pricing is also part of an appropriate incentive structure facing both load and generation owners in a working wholesale electric power market design. Scarcity pricing must be designed to ensure that market prices reflect actual market conditions, that scarcity pricing occurs with transparent triggers based on measured reserve levels and transparent prices and that there are strong incentives for competitive behavior and strong disincentives to exercise market power. Such administrative scarcity pricing is a key link between energy and capacity markets. The PJM Capacity Market is explicitly designed to provide revenue adequacy and the resultant reliability. Nonetheless, with a market design that includes a direct and explicit scarcity pricing net revenue true up mechanism, scarcity pricing can be a mechanism to appropriately increase reliance on the energy market as a source of revenues and incentives in a competitive market without reliance on the exercise of market power. PJM implemented scarcity pricing rules in 2012. There are significant issues with the scarcity pricing net revenue true up mechanism in the PJM scarcity pricing design, which will create issues when scarcity pricing occurs. There are also significant issues with PJM's scarcity pricing rules, including the absence of a clear trigger

based on measured reserve levels (the current triggers are based on estimated reserves) and the lack of adequate locational scarcity pricing options.

The overall energy market results support the conclusion that energy prices in PJM are set, generally, by marginal units operating at, or close to, their marginal costs, although this was not always the case during the high demand hours in the first three months of 2014 or 2015. This is evidence of generally competitive behavior and competitive market outcomes, although the behavior of some participants during the high demand periods is consistent with economic withholding. Given the structure of the energy market which can permit the exercise of aggregate market power at times of high demand, the tighter market conditions and the change in some participants' behavior are sources of concern in the energy market and provide a reason to use cost as the sole basis for hourly changes in offers or offers greater than \$1,000 per MWh. The MMU concludes that the PJM energy market results were competitive in the first three months of 2016.

## Market Structure

### Market Concentration

Analysis of supply curve segments of the PJM energy market in the first three months of 2016 indicates moderate concentration in the base load segment, but high concentration in the intermediate and peaking segments.<sup>8</sup> High concentration levels, particularly in the peaking segment, increase the probability that a generation owner will be pivotal in the aggregate market during high demand periods.

When transmission constraints exist, local markets are created with ownership that is typically significantly more concentrated than the overall energy market. PJM offer capping rules that limit the exercise of local market power were generally effective in preventing the exercise of market power in the first three months of 2016 although there are issues with the application of market power mitigation for resources whose owners fail the TPS test.

<sup>8</sup> A unit is classified as base load if it runs for more than 50 percent of hours in the year, as intermediate if it runs for less than 50 percent but greater than 10 percent of hours in the year, and as peak if it runs for less than 10 percent of hours in the year.

The concentration ratio used here is the Herfindahl-Hirschman Index (HHI), calculated by summing the squares of the market shares of all firms in a market. Hourly PJM energy market HHIs were calculated based on the real-time energy output of generators, adjusted for hourly net imports by owner (Table 3-2).

The HHI may not accurately capture market power issues in situations where, for example, there is moderate concentration in all on line resources but there is a high level of concentration in resources needed to meet increases in load. The HHIs for supply curve segments is an indication of such issues. An aggregate pivotal supplier test is required to accurately measure the ability of incremental resources to exercise market power when load is high, for example.

Hourly HHIs were also calculated for baseload, intermediate and peaking segments of generation supply. Hourly energy market HHIs by supply curve segment were calculated based on hourly energy market shares, unadjusted for imports.

The “Merger Policy Statement” of the FERC states that a market can be broadly characterized as:

- **Unconcentrated.** Market HHI below 1000, equivalent to 10 firms with equal market shares;
- **Moderately Concentrated.** Market HHI between 1000 and 1800; and
- **Highly Concentrated.** Market HHI greater than 1800, equivalent to between five and six firms with equal market shares.<sup>9</sup>

## PJM HHI Results

Calculations for hourly HHI indicate that by the FERC standards, the PJM energy market during the first three months of 2016 was moderately concentrated (Table 3-2).

**Table 3-2 PJM hourly energy market HHI: January through March, 2015 and 2016<sup>10</sup>**

	Hourly Market HHI (Jan - Mar, 2015)	Hourly Market HHI (Jan - Mar, 2016)
Average	1087	1300
Minimum	922	1133
Maximum	1269	1561
Highest market share (One hour)	26%	31%
Average of the highest hourly market share	20%	23%
# Hours	2,159	2,183
# Hours HHI > 1800	0	0
% Hours HHI > 1800	0%	0%

Table 3-3 includes HHI values by supply curve segment, including base, intermediate and peaking plants for the first three months of 2015 and 2016. The PJM energy market was moderately concentrated overall with moderate concentration in the baseload segment, but high concentration in the intermediate and peaking segments.

**Table 3-3 PJM hourly energy market HHI (By supply segment): January through March, 2015 and 2016**

	Jan - Mar, 2015			Jan - Mar, 2016		
	Minimum	Average	Maximum	Minimum	Average	Maximum
Base	978	1076	1278	990	1132	1347
Intermediate	955	2743	8819	767	1965	5603
Peak	806	6064	10000	951	6073	10000

Figure 3-1 shows the number of units in the baseload, intermediate and peaking segments by fuel source in the first three months of 2016.

<sup>9</sup> 77 FERC ¶ 61,263, pp. 64-70 (1996), “Inquiry Concerning the Commission’s Merger Policy under the Federal Power Act: Policy Statement.”

<sup>10</sup> This analysis includes all hours in the first three months of 2015 and 2016, regardless of congestion.

Figure 3-1 Fuel source distribution in unit segments: January through March, 2016<sup>11</sup>


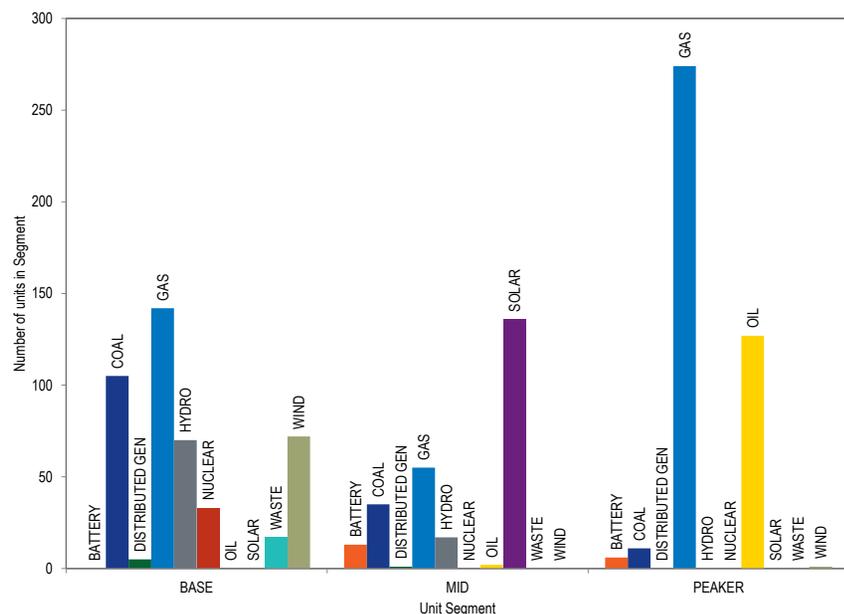


Figure 3-2 presents the hourly HHI values in chronological order and an HHI duration curve for the first three months of 2016.

Figure 3-2 PJM hourly energy market HHI: January through March, 2016

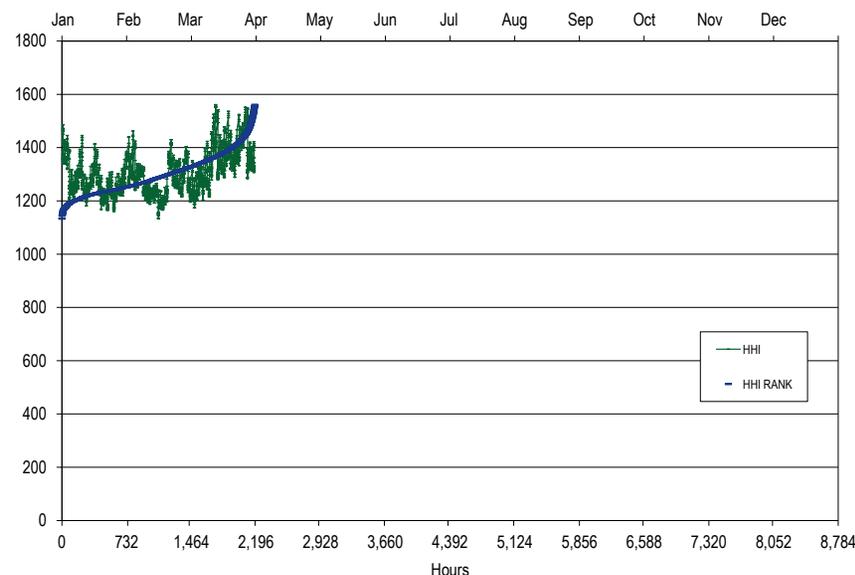

### Ownership of Marginal Resources

Table 3-4 shows the contribution to real-time, load-weighted LMP by individual marginal resource owner.<sup>12</sup> The contribution of each marginal resource to price at each load bus is calculated for each five-minute interval of 2015, and summed by the parent company that offers the marginal resource into the Real-Time Energy Market. The results show that in the first three months of 2016, the offers of one company contributed 23.1 percent of the real-time, load-weighted PJM system LMP and that the offers of the top four companies contributed 61.1 percent of the real-time, load-weighted, average PJM system LMP. During the first three months of 2015, the offers of one company contributed 17.3 percent of the real time, load-weighted PJM system LMP and offers of the top four companies contributed 54.4 percent of the real-time, load-weighted, average PJM system LMP.

<sup>11</sup> The units classified as Distributed Gen are buses within Electric Distribution Companies (EDCs) that are modeled as generation buses to accurately reflect net energy injections from distribution level load buses. The modeling change was the outcome of the Net Energy Metering Task Force stakeholder group in July, 2012. See PJM, "Net Energy Metering Senior Task Force (NEMSTF) Action on Proposed Manual 28 Revisions" (July 26, 2012) <<http://www.pjm.com/~media/committees-groups/committees/nemstf/20120726/20120726-item-04-nemstf-report-and-proposed-manual-revisions.ashx>>.

<sup>12</sup> See the *MMU Technical Reference for PJM Markets*, at "Calculation and Use of Generator Sensitivity/Unit Participation Factors."

**Table 3-4 Marginal unit contribution to PJM real-time, load-weighted LMP (By parent company): January through March, 2015 and 2016**

2015 (Jan-Mar)		2016 (Jan-Mar)	
Company	Percent of Price	Company	Percent of Price
1	17.3%	1	23.1%
2	14.4%	2	16.6%
3	13.0%	3	11.1%
4	9.7%	4	10.4%
5	9.0%	5	7.3%
6	8.2%	6	6.8%
7	6.6%	7	3.1%
8	4.2%	8	3.1%
9	2.7%	9	2.8%
Other (47 companies )	14.9%	Other (63 companies )	15.8%

Table 3-5 shows the contribution to day-ahead, load-weighted LMP by individual marginal resource owners.<sup>13</sup> The contribution of each marginal resource to price at each load bus is calculated hourly, and summed by the parent company that offers the marginal resource into the Day-Ahead Energy Market. The results show that in the first three months of 2016, the offers of one company contributed 19.2 percent of the day-ahead, load-weighted PJM system LMP and that the offers of the top four companies contributed 57.8 percent of the day-ahead, load-weighted, average PJM system LMP. In the first three months of 2015, the offers of one company contributed 22.4 percent of the day-ahead, load-weighted PJM system LMP and offers of the top four companies contributed 62.4 percent of the day-ahead, load-weighted, average PJM system LMP.

<sup>13</sup> See the *MMU Technical Reference for PJM Markets*, at "Calculation and Use of Generator Sensitivity/Unit Participation Factors."

**Table 3-5 Marginal resource contribution to PJM day-ahead, load-weighted LMP (By parent company): January through March, 2015 and 2016**

2015 (Jan - Mar)		2016 (Jan - Mar)	
Company	Percent of Price	Company	Percent of Price
1	22.4%	1	19.2%
2	18.0%	2	15.7%
3	11.1%	3	13.6%
4	10.9%	4	9.3%
5	8.3%	5	6.8%
6	7.6%	6	6.5%
7	6.0%	7	6.2%
8	5.4%	8	3.2%
9	2.9%	9	3.2%
Other (76 companies)	7.3%	Other (63 companies)	16.2%

## Type of Marginal Resources

LMPs result from the operation of a market based on security-constrained, least-cost dispatch in which marginal resources determine system LMPs, based on their offers. Marginal resource designation is not limited to physical resources in the Day-Ahead Energy Market. INC offers, DEC bids and up to congestion transactions are dispatchable injections and withdrawals in the Day-Ahead Energy Market that can set price via their offers and bids.

Table 3-6 shows the type of fuel used by marginal resources in the Real-Time Energy Market. There can be more than one marginal resource in any given interval as a result of transmission constraints. In the first three months of 2016, coal units were 43.36 percent and natural gas units were 44.55 percent of marginal resources. In the first three months of 2015, coal units were 57.21 percent and natural gas units were 33.10 percent of the total marginal resources. In the first three months of 2016, 88.57 percent of the wind marginal units had negative offer prices, 9.09 percent had zero offer prices and 2.34 percent had positive offer prices.

The results reflect the dynamics of an LMP market. When there is a single constraint, there are two marginal units. For example, a significant west to east constraint could be binding with a gas unit marginal in the east and a coal unit marginal in the west. As a result, although the dispatch of natural

gas units has increased and gas units set price for more hours as marginal resources in the Real-Time Energy Market, this does not necessarily reduce the proportion of hours in which coal units are marginal.<sup>14</sup>

**Table 3-6 Type of fuel used (By real-time marginal units): January through March, 2012 through 2016**

Type/Fuel	Year (Jan - Mar)				
	2012	2013	2014	2015	2016
Gas	27.30%	32.40%	42.61%	33.10%	44.55%
Coal	60.90%	57.74%	46.59%	57.21%	43.36%
Oil	4.30%	4.79%	4.53%	6.29%	7.89%
Wind	7.10%	4.76%	5.17%	2.91%	3.90%
Other	0.20%	0.02%	0.76%	0.43%	0.18%
Uranium	0.00%	0.02%	0.15%	0.01%	0.10%
Municipal Waste	0.20%	0.07%	0.03%	0.05%	0.02%
Emergency DR	0.00%	0.02%	0.15%	0.00%	0.00%

Table 3-7 shows the type and fuel type where relevant, of marginal resources in the Day-Ahead Energy Market. In the first three months of 2016, up to congestion transactions were 83.21 percent of marginal resources. Up to congestion transactions were 72.79 percent of marginal resources in the first three months of 2015.


**Table 3-7 Day-ahead marginal resources by type/fuel: January through March, 2011 through 2016**

Type/Fuel	(Jan - Mar)					
	2011	2012	2013	2014	2015	2016
Up to Congestion Transaction	65.72%	84.85%	93.54%	94.68%	72.79%	83.21%
DEC	14.80%	5.78%	1.71%	1.60%	8.48%	6.86%
INC	9.08%	5.51%	1.44%	1.07%	5.74%	3.99%
Coal	7.43%	2.70%	2.26%	1.27%	8.15%	2.76%
Gas	2.40%	0.95%	0.92%	1.08%	3.67%	2.44%
Oil	0.00%	0.00%	0.00%	0.04%	0.36%	0.59%
Dispatchable Transaction	0.27%	0.08%	0.09%	0.19%	0.58%	0.06%
Wind	0.00%	0.03%	0.02%	0.05%	0.16%	0.04%
Nuclear	0.00%	0.00%	0.00%	0.00%	0.00%	0.04%
Other	0.00%	0.00%	0.00%	0.00%	0.00%	0.01%
Municipal Waste	0.02%	0.00%	0.00%	0.00%	0.01%	0.00%
Total	100.00%	100.00%	99.99%	100.00%	100.00%	100.00%

<sup>14</sup> Prior to April 1, 2015, for the generation units that are capable of using multiple fuel types, PJM did not require the participants to disclose the fuel type associated with their offer schedule. For these units, the cleared offer schedules on a given day were compared to the cost associated with each fuel to determine the fuel type most likely to have been the basis for the cleared schedule.

Figure 3-3 shows, for the Day-Ahead Market from January 1, 2014, through March 31, 2016, the daily proportion of marginal resources that were up to congestion transaction and/or generation units. The percentage of marginal up to congestion transactions decreased significantly beginning on September 8, 2014, as a result of the FERC's UTC uplift refund notice which became effective on that date.<sup>15</sup> The percentage of marginal up to congestion transaction decreased and that of generation units increased. That trend has begun to reverse as a result of the expiration of the fifteen month resettlement period for the proceeding related to uplift charges for UTC transactions.

**Figure 3-3 Day-ahead marginal up to congestion transaction and generation units: January 2014 through March of 2016**

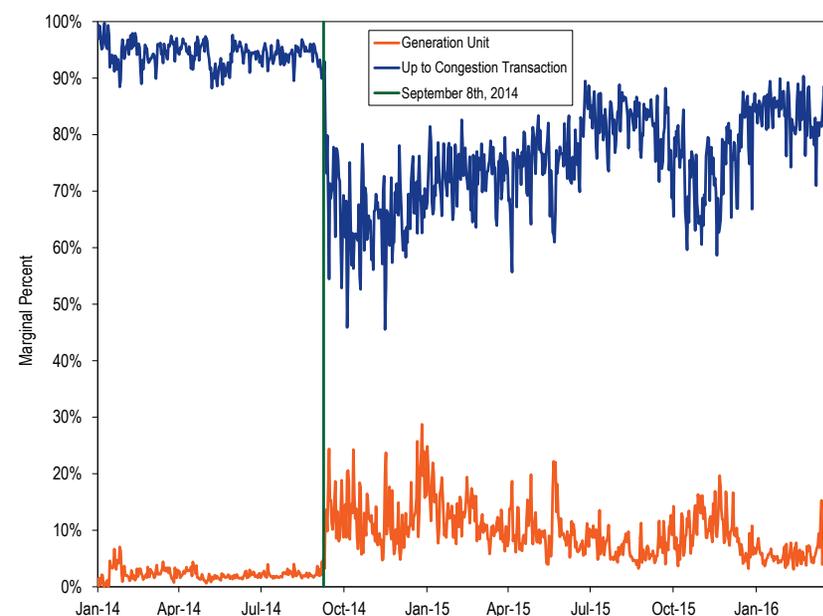


<sup>15</sup> See 18 CFR § 385.213 (2014).

## Supply

Supply includes physical generation and imports and virtual transactions.

Figure 3-4 shows the average PJM aggregate real-time generation supply curves by offer price, peak load and average load for the first three months of 2015 and 2016. Total average PJM aggregate real-time generation supply decreased by 3,886 MW, or 2.4 percent, in the first three months of 2016 from an average maximum of 164,790 MW in the first three months of 2015 to 160,904 MW in the first three months of 2016.

**Figure 3-4 Average PJM aggregate real-time generation supply curves by offer price: January through March, 2015 and 2016**

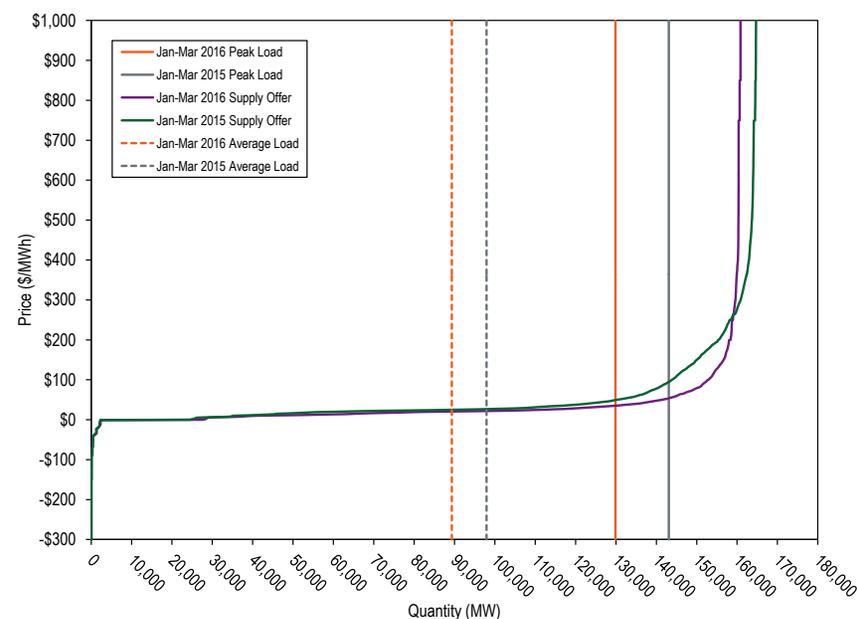

## Energy Production by Fuel Source

Table 3-8 shows PJM generation by fuel source in GWh for the first three months of 2015 and the first three months of 2016. In the first three months of 2016, generation from coal units decreased 31.7 percent and generation from natural gas units increased 19.4 percent compared to the first three months of 2015.<sup>16</sup>

**Table 3-8 PJM generation (By fuel source (GWh)): January through March, 2015 and 2016<sup>17 18</sup>**

	2015		2016		Change in Output
	Jan-Mar GWh	Percent	Jan-Mar GWh	Percent	
Coal	91,883.7	43.1%	62,765.4	32.1%	(31.7%)
Standard Coal	90,891.9	42.6%	61,925.7	31.7%	(31.9%)
Waste Coal	991.8	0.5%	839.7	0.4%	(15.3%)
Nuclear	70,167.1	32.9%	71,578.3	36.6%	2.0%
Gas	41,641.4	19.5%	49,557.4	25.4%	19.0%
Natural Gas	40,680.6	19.1%	48,584.0	24.9%	19.4%
Landfill Gas	610.0	0.3%	583.3	0.3%	(4.4%)
Biomass Gas	350.8	0.2%	390.1	0.2%	11.2%
Hydroelectric	2,869.5	1.3%	4,155.8	2.1%	44.8%
Pumped Storage	1,132.3	0.5%	1,073.7	0.5%	(5.2%)
Run of River	1,737.2	0.8%	3,018.3	1.5%	73.7%
Wind	4,876.8	2.3%	5,802.6	3.0%	19.0%
Waste	1,082.0	0.5%	1,106.3	0.6%	2.2%
Solid Waste	935.5	0.4%	979.4	0.5%	4.7%
Miscellaneous	146.5	0.1%	126.9	0.1%	(13.4%)
Oil	502.6	0.2%	176.7	0.1%	(64.8%)
Heavy Oil	379.3	0.2%	125.4	0.1%	(66.9%)
Light Oil	82.8	0.0%	47.3	0.0%	(42.9%)
Diesel	38.8	0.0%	3.9	0.0%	(89.9%)
Kerosene	1.7	0.0%	0.1	0.0%	(93.0%)
Jet Oil	0.0	0.0%	0.0	0.0%	NA
Solar, Net Energy Metering	94.1	0.0%	181.3	0.0%	92.6%
Battery	1.2	0.0%	4.2	0.0%	243.2%
<b>Total</b>	<b>213,118.5</b>	<b>100.0%</b>	<b>195,328.0</b>	<b>100.0%</b>	<b>(8.3%)</b>

<sup>16</sup> Generation data are the sum of MWh for each fuel by source at every generation bus in PJM with positive output and reflect gross generation without offset for station use of any kind.

<sup>17</sup> All generation is total gross generation output and does not net out the MWh withdrawn at a generation bus to provide auxiliary/parasitic power or station power, power to synchronous condenser motors, or power to run pumped storage pumps.

<sup>18</sup> Net Energy Metering is combined with Solar due to data confidentiality reasons.

**Table 3-9 Monthly PJM generation (By fuel source (GWh)): 2016**

	Jan	Feb	Mar	Total
Coal	25,360.9	21,937.9	15,466.6	62,765.4
Standard Coal	25,015.0	21,647.1	15,263.7	61,925.7
Waste Coal	346.0	290.8	202.9	839.7
Nuclear	25,876.0	22,914.1	22,788.2	71,578.3
Gas	16,367.5	15,850.2	17,339.7	49,557.4
Natural Gas	16,028.5	15,538.6	17,016.9	48,584.0
Landfill Gas	200.3	187.0	196.0	583.3
Biomass Gas	138.7	124.6	126.8	390.1
Hydroelectric	1,455.6	1,421.6	1,278.6	4,155.8
Pumped Storage	402.3	316.5	354.9	1,073.7
Run of River	1,053.3	1,105.0	923.7	3,082.0
Wind	2,095.6	1,925.5	1,781.6	5,802.6
Waste	389.0	339.1	378.1	1,106.3
Solid Waste	344.8	297.0	337.5	979.4
Miscellaneous	44.2	42.1	40.6	126.9
Oil	99.2	52.9	24.6	176.7
Heavy Oil	82.8	42.6	0.0	125.4
Light Oil	14.9	8.9	23.5	47.3
Diesel	1.4	1.3	1.2	3.9
Kerosene	0.0	0.1	0.0	0.1
Jet Oil	0.0	0.0	0.0	0.0
Solar, Net Energy Metering	45.6	50.4	85.2	181.3
Battery	1.3	1.5	1.4	4.2
<b>Total</b>	<b>71,690.9</b>	<b>64,493.0</b>	<b>59,144.1</b>	<b>195,328.0</b>

## Net Generation and Load

PJM sums all negative (injections) and positive (withdrawals) load at each designated load bus when calculating net load (accounting load). PJM sums all of the negative (withdrawals) and positive (injections) generation at each generation bus when calculating net generation. Netting withdrawals and injections by bus type (generation or load) affects the measurement of total load and total generation. Energy withdrawn at a generation bus to provide, for example, auxiliary/parasitic power or station power, power to synchronous condenser motors, or power to run pumped storage pumps, is actually load, not negative generation. Energy injected at load buses by behind the meter generation is actually generation, not negative load.

The zonal load-weighted LMP is calculated by weighting the zone's load bus LMPs by the zone's load bus accounting load. The definition of injections and withdrawals of energy as generation or load affects PJM's calculation of zonal load-weighted LMP.

The MMU recommends that during hours when a generation bus shows a net withdrawal, the energy withdrawal be treated as load, not negative generation, for purposes of calculating load and load-weighted LMP. The MMU also recommends that during hours when a load bus shows a net injection, the energy injection be treated as generation, not negative load, for purposes of calculating generation and load-weighted LMP.

## Real-Time Supply

Average offered real-time generation decreased by 3,886 MW, or 2.4 percent, in the first three months of 2016 from an average maximum of 164,790 MW in the first three months of 2015 to 160,904 MW in the first three months of 2016.<sup>19</sup>

In the first three months of 2016, 994.8 MW of new capacity were added to PJM and 51 MW of generation were retired.

PJM average real-time generation in the first three months of 2016 decreased by 9.5 percent from the first three months of 2015, from 97,741 MW to 88,470 MW.<sup>20</sup>

PJM average real-time supply including imports decreased by 10.1 percent in the first three months of 2016 from the first three months of 2015, from 105,027 MW to 94,383 MW.

In the PJM Real-Time Energy Market, there are three types of supply offers:

- **Self-Scheduled Generation Offer.** Offer to supply a fixed block of MWh, as a price taker, from a unit that may also have a dispatchable component above the minimum.

<sup>19</sup> Calculated values shown in Section 3, "Energy Market," are based on unrounded, underlying data and may differ from calculations based on the rounded values shown in tables.


<sup>20</sup> Generation data are the net MWh injections and withdrawals MWh at every generation bus in PJM.

- **Dispatchable Generation Offer.** Offer to supply a schedule of MWh and corresponding offer prices from a specific unit.
- **Import.** An import is an external energy transaction scheduled to PJM from another balancing authority. A real-time import must have a valid OASIS reservation when offered, must have available ramp room to support the import, must be accompanied by a NERC Tag, and must pass the neighboring balancing authority checkout process.

### PJM Real-Time Supply Duration

Figure 3-5 shows the hourly distribution of PJM real-time generation plus imports for the first three months of 2015 and 2016.

Figure 3-5 Distribution of PJM real-time generation plus imports: January through March, 2015 and 2016<sup>21</sup>

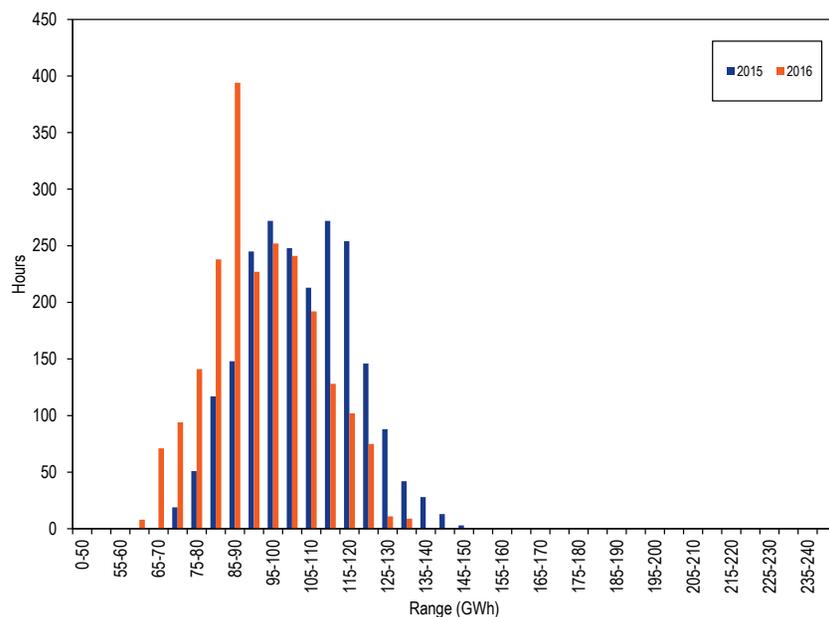

<sup>21</sup> Each range on the horizontal axis excludes the start value and includes the end value.

### PJM Real-Time, Average Supply

Table 3-10 presents summary real-time supply statistics for the first three months of each year for the 17-year period from 2000 through 2016.<sup>22</sup>

Table 3-10 PJM real-time average hourly generation and real-time average hourly generation plus average hourly imports: January through March, 2000 through 2016


Jan-Mar	PJM Real-Time Supply (MWh)				Year-to-Year Change			
	Generation		Generation Plus Imports		Generation		Generation Plus Imports	
	Generation	Standard Deviation	Supply	Standard Deviation	Generation	Standard Deviation	Supply	Standard Deviation
2000	NA	NA	NA	NA	NA	NA	NA	NA
2001	30,923	3,488	33,806	3,358	NA	NA	NA	NA
2002	27,948	3,416	31,465	3,508	(9.6%)	(2.1%)	(6.9%)	4.5%
2003	38,731	5,187	42,498	5,092	38.6%	51.8%	35.1%	45.1%
2004	37,790	4,660	41,960	4,899	(2.4%)	(10.2%)	(1.3%)	(3.8%)
2005	74,187	8,269	80,184	9,017	96.3%	77.4%	91.1%	84.1%
2006	82,550	7,921	87,729	8,565	11.3%	(4.2%)	9.4%	(5.0%)
2007	86,286	10,018	91,454	11,351	4.5%	26.5%	4.2%	32.5%
2008	86,690	9,375	92,075	10,150	0.5%	(6.4%)	0.7%	(10.6%)
2009	81,987	11,417	88,148	12,213	(5.4%)	21.8%	(4.3%)	20.3%
2010	81,676	12,801	87,009	13,236	(0.4%)	12.1%	(1.3%)	8.4%
2011	83,505	10,116	88,750	10,884	2.2%	(21.0%)	2.0%	(17.8%)
2012	88,068	11,177	93,128	11,685	5.5%	10.5%	4.9%	7.4%
2013	92,776	10,030	98,002	10,812	5.3%	(10.3%)	5.2%	(7.5%)
2014	100,655	12,427	106,879	13,255	8.5%	23.9%	9.1%	22.6%
2015	97,741	13,085	105,027	14,350	(2.9%)	5.3%	(1.7%)	8.3%
2016	88,470	12,666	94,383	13,890	(9.5%)	(3.2%)	(10.1%)	(3.2%)

<sup>22</sup> The import data in this table is not available before June 1, 2000. The data that includes imports in 2000 is calculated from the last six months of that year.

## PJM Real-Time, Monthly Average Generation

Figure 3-6 compares the real-time, monthly average hourly generation, from January 1, 2015 through March 31, 2016.

**Figure 3-6 PJM real-time average monthly hourly generation: January 2015 through March 2016**

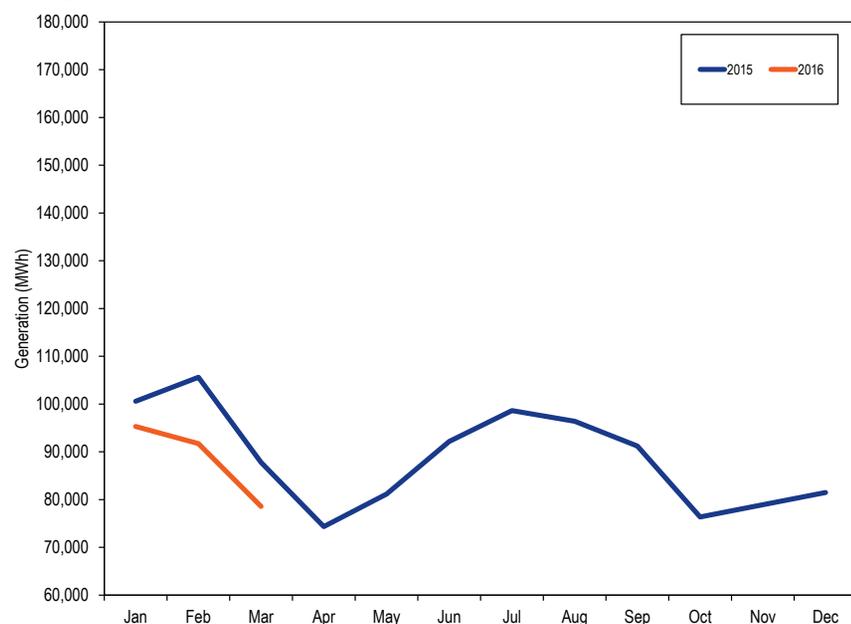

## Day-Ahead Supply

PJM average day-ahead supply in the first three months of 2016, including INCs and up to congestion transactions, increased by 8.0 percent from the first three months of 2015, from 123,424 MW to 133,263 MW.

PJM average day-ahead supply in the first three months of 2016, including INCs, up to congestion transactions, and imports, increased by 7.7 percent from the first three months of 2015, from 125,973 MW to 135,638 MW. The increase in PJM day-ahead supply was a result of an increase in in UTCs

beginning in December 2015 based on a FERC order setting December 8, 2015, as the last effective date for any uplift charges subsequently assigned to UTCs.<sup>23</sup>

In the PJM Day-Ahead Energy Market, there are five types of financially binding supply offers:


- **Self-Scheduled Generation Offer.** Offer to supply a fixed block of MWh, as a price taker, from a unit that may also have a dispatchable component above the minimum.
- **Dispatchable Generation Offer.** Offer to supply a schedule of MWh and corresponding offer prices from a unit.
- **Increment Offer (INC).** Financial offer to supply MWh and corresponding offer prices. INCs can be submitted by any market participant.
- **Up to Congestion Transaction (UTC).** Conditional transaction that permits a market participant to specify a maximum price spread between the transaction source and sink. An up to congestion transaction is evaluated as a matched pair of an injection and a withdrawal analogous to a matched pair of an INC offer and a DEC bid.
- **Import.** An import is an external energy transaction scheduled to PJM from another balancing authority. An import must have a valid willing to pay congestion (WPC) OASIS reservation when offered. An import energy transaction that clears the Day-Ahead Energy Market is financially binding. There is no link between transactions submitted in the PJM Day-Ahead Energy Market and the PJM Real-Time Energy Market, so an import energy transaction approved in the Day-Ahead Energy Market will not physically flow in real time unless it is also submitted through the real-time energy market scheduling process.

## PJM Day-Ahead Supply Duration

Figure 3-7 shows the hourly distribution of PJM day-ahead supply, including increment offers, up to congestion transactions, and imports for the first three months of 2015 and 2016.

<sup>23</sup> 148 FERC ¶ 61,144 (2014).

Figure 3-7 Distribution of PJM day-ahead supply plus imports: January through March 2015 and 2016<sup>24</sup>

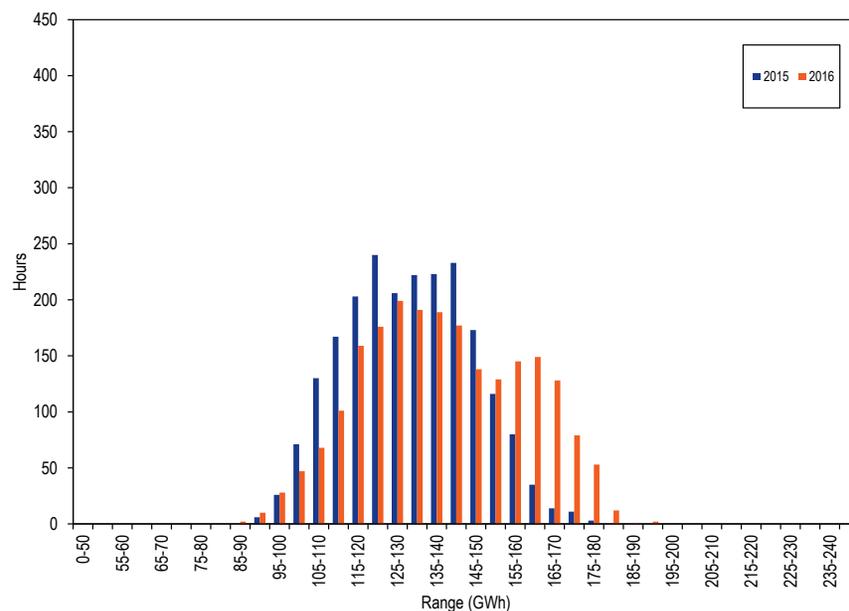

<sup>24</sup> Each range on the horizontal axis excludes the start value and includes the end value.

### PJM Day-Ahead, Average Supply

Table 3-11 presents summary day-ahead supply statistics for the first three months of each year of the 17-year period from 2000 through 2016.<sup>25</sup>

Table 3-11 PJM day-ahead average hourly supply and day-ahead average hourly supply plus average hourly imports: January through March, 2000 through 2016


Jan-Mar	PJM Day-Ahead Supply (MWh)				Year-to-Year Change			
	Supply		Supply Plus Imports		Supply		Supply Plus Imports	
	Supply	Standard Deviation	Supply	Standard Deviation	Supply	Standard Deviation	Supply	Standard Deviation
2000	NA	NA	NA	NA	NA	NA	NA	NA
2001	28,494	2,941	29,252	3,021	NA	NA	NA	NA
2002	20,274	10,131	20,827	10,134	(28.8%)	244.5%	(28.8%)	235.5%
2003	37,147	4,337	37,807	4,389	83.2%	(57.2%)	81.5%	(56.7%)
2004	46,591	4,794	47,377	5,039	25.4%	10.5%	25.3%	14.8%
2005	89,011	9,434	90,502	9,443	91.0%	96.8%	91.0%	87.4%
2006	97,319	9,035	99,551	9,061	9.3%	(4.2%)	10.0%	(4.0%)
2007	110,099	11,938	112,561	12,141	13.1%	32.1%	13.1%	34.0%
2008	109,711	10,479	112,165	10,671	(0.4%)	(12.2%)	(0.4%)	(12.1%)
2009	104,880	13,895	107,325	14,031	(4.4%)	32.6%	(4.3%)	31.5%
2010	101,733	13,835	104,858	13,917	(3.0%)	(0.4%)	(2.3%)	(0.8%)
2011	110,310	12,200	112,854	12,419	8.4%	(11.8%)	7.6%	(10.8%)
2012	132,178	13,701	134,405	13,804	19.8%	12.3%	19.1%	11.2%
2013	147,246	13,054	149,300	13,244	11.4%	(4.7%)	11.1%	(4.1%)
2014	168,373	11,875	170,778	11,935	14.3%	(9.0%)	14.4%	(9.9%)
2015	123,424	14,671	125,973	14,915	(26.7%)	23.5%	(26.2%)	25.0%
2016	133,263	19,105	135,638	19,405	8.0%	30.2%	7.7%	30.1%

<sup>25</sup> Since the Day-Ahead Energy Market did not start until June 1, 2000, the day-ahead data for 2000 only includes data for the last six months of that year.

### PJM Day-Ahead, Monthly Average Supply

Figure 3-8 compares the day-ahead, monthly average hourly supply, including increment offers and up to congestion transactions, from January 1, 2015, through March 31, 2016.

**Figure 3-8 PJM day-ahead monthly average hourly supply: January 2015 through March 2016**

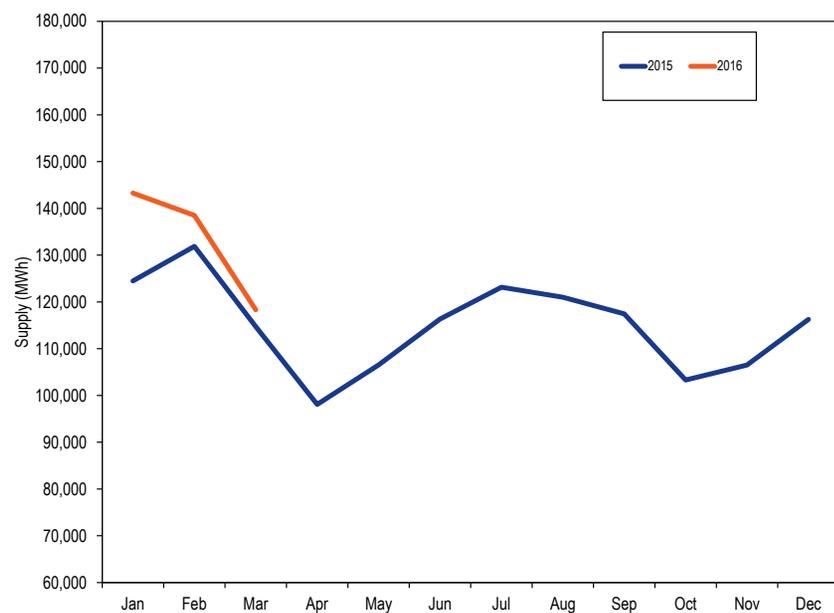

### Real-Time and Day-Ahead Supply

Table 3-12 presents summary statistics for the first three months of 2015 and 2016, for day-ahead and real-time supply. The last two columns of Table 3-12 are the day-ahead supply minus the real-time supply. The first of these columns is the total day-ahead supply less the total real-time supply and the second of these columns is the total physical day-ahead generation less the total physical real-time generation. In the first three months of 2016, up to congestion transactions were 27.1 percent of the total day-ahead supply compared to 13.6 percent in the first three months of 2015.

Table 3-12 Day-ahead and real-time supply (MWh): January through March, 2015 and 2016

	Jan-Mar	Day Ahead				Real Time		Day Ahead Less Real Time		
		Generation	Cleared INC	Up-to Congestion	Imports	Total Supply	Generation	Total Supply	Total Supply	Total Generation
Average	2015	101,548	4,691	17,186	2,549	125,973	97,741	105,027	20,946	3,807
	2016	91,348	5,202	36,714	2,375	135,638	88,470	94,383	41,255	2,877
Median	2015	101,823	4,640	17,251	2,538	126,093	97,649	104,628	21,464	4,174
	2016	90,440	5,070	36,167	2,296	134,690	87,392	93,082	41,607	3,048
Standard Deviation	2015	13,968	628	2,993	466	14,915	13,085	14,350	565	883
	2016	14,074	948	7,532	526	19,405	12,666	13,890	5,515	1,408
Peak Average	2015	108,676	4,946	17,523	2,770	133,915	103,837	111,780	22,135	4,839
	2016	98,217	5,357	38,779	2,479	144,832	94,434	100,852	43,980	3,783
Peak Median	2015	109,930	4,921	17,660	2,773	134,738	104,735	112,881	21,858	5,196
	2016	98,337	5,182	38,102	2,389	144,990	94,091	100,313	44,677	4,246
Peak Standard Deviation	2015	11,662	600	2,750	401	12,466	11,462	12,446	20	200
	2016	11,631	939	7,538	598	16,837	10,883	12,107	4,730	748
Off-Peak Average	2015	95,116	4,460	16,881	2,350	118,808	92,241	98,934	19,873	2,876
	2016	85,097	5,061	34,834	2,281	127,274	83,044	88,498	38,776	2,053
Off-Peak Median	2015	95,006	4,412	16,914	2,309	117,651	91,915	98,458	19,192	3,091
	2016	83,797	4,977	34,249	2,248	125,757	81,979	87,218	38,539	1,817
Off-Peak Standard Deviation	2015	12,701	560	3,166	430	13,222	11,978	13,184	38	723
	2016	13,165	934	7,020	430	17,737	11,702	12,748	4,989	1,463

Figure 3-9 shows the average hourly cleared volumes of day-ahead supply and real-time supply for the first three months of 2016. The day-ahead supply consists of day-ahead generation, imports, cleared increments and up to congestion transactions. The real-time generation includes generation and imports.

**Figure 3-9 Day-ahead and real-time supply (Average hourly volumes): January through March, 2016**

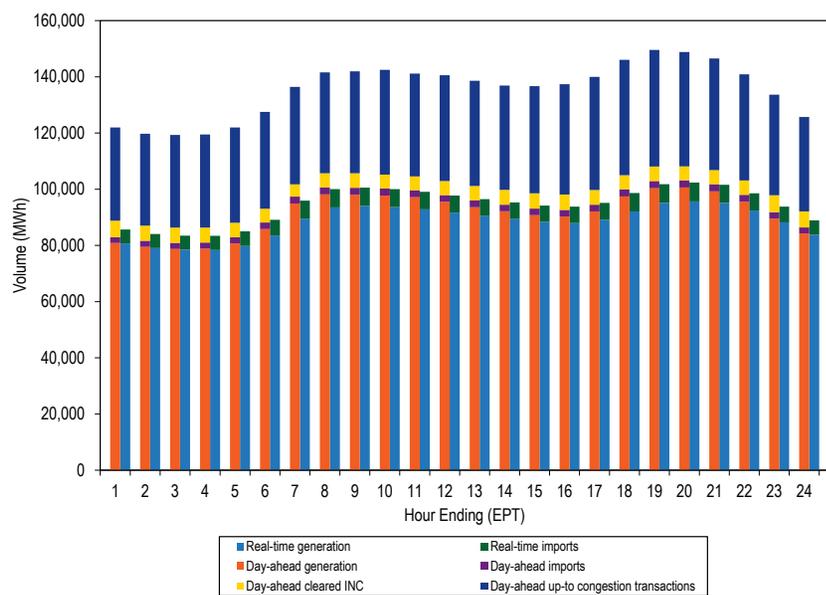


Figure 3-10 shows the difference between the day-ahead and real-time average daily supply for January 1, 2015, through March 31, 2016.

**Figure 3-10 Difference between day-ahead and real-time supply (Average daily volumes): January 2015 through March 2016**

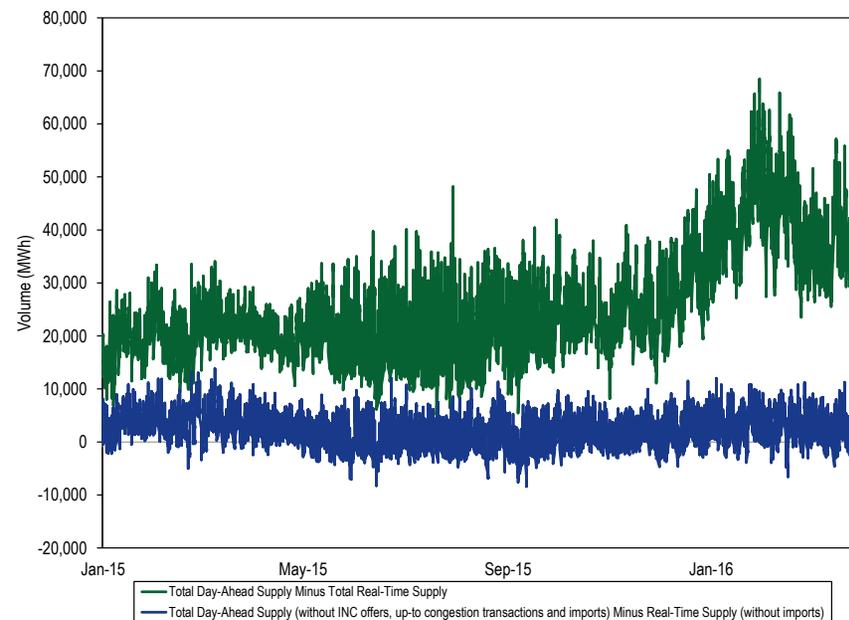


Figure 3-11 shows the difference between the PJM real-time generation and real-time load by zone in the first three months of 2016. Figure 3-11 is color coded on a scale on which red shades represent zones that have less generation than load and green shades represent zones that have more generation than load, with darker shades meaning greater amounts of net generation or load. For example, the Pepco Control Zone has less generation than load, while the PENELEC Control Zone has more generation than load. Table 3-13 shows the difference between the PJM real-time generation and real-time load by zone in the first three months of 2015 and 2016.



## Demand

Demand includes physical load and exports and virtual transactions.

### Peak Demand

In this section, demand refers to physical load and exports and in the Day-Ahead Energy Market also includes virtual transactions.

The PJM system real-time peak load for the first three months of 2016 was 129,876 MW in the HE 8 on January 19, 2016, which was 13,210 MW, or 9.2 percent, lower than the peak load for the first three months of 2015, which was 143,086 MW in the HE 8 on February 20, 2015.

Table 3-14 shows the peak loads for the first three months of 1999 through 2016.

**Table 3-14 Actual PJM footprint peak loads: 1999 to 2016<sup>27</sup>**

(Jan - Mar)	Date	Hour Ending (EPT)	PJM Load (MW)	Annual Change (MW)	Annual Change (%)
1999	Tue, January 05	19	99,982	NA	NA
2000	Thu, January 27	20	102,359	2,377	2.4%
2001	Tue, January 02	19	100,411	(1,948)	(1.9%)
2002	Mon, March 04	20	97,334	(3,077)	(3.1%)
2003	Thu, January 23	19	112,755	15,421	15.8%
2004	Mon, January 26	19	106,760	(5,995)	(5.3%)
2005	Tue, January 18	19	111,973	5,213	4.9%
2006	Mon, February 13	20	100,065	(11,908)	(10.6%)
2007	Mon, February 05	20	118,800	18,736	18.7%
2008	Thu, January 03	19	111,724	(7,076)	(6.0%)
2009	Fri, January 16	19	117,169	5,445	4.9%
2010	Mon, January 04	19	109,210	(7,959)	(6.8%)
2011	Mon, January 24	8	110,659	1,448	1.3%
2012	Tue, January 03	19	122,539	11,880	10.7%
2013	Tue, January 22	19	126,632	4,093	3.3%
2014	Tue, January 07	19	140,467	13,835	10.9%
2015	Fri, February 20	8	143,086	2,619	1.9%
2016	Tue, January 19	8	129,876	(13,210)	(9.2%)

<sup>27</sup> Peak loads shown are eMTR load. See the *MMU Technical Reference for the PJM Markets*, at "Load Definitions" for detailed definitions of load. <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

Figure 3-12 shows the peak loads for 1999 through 2016.

**Figure 3-12 PJM footprint calendar year peak loads: January 1999 to March 2016**


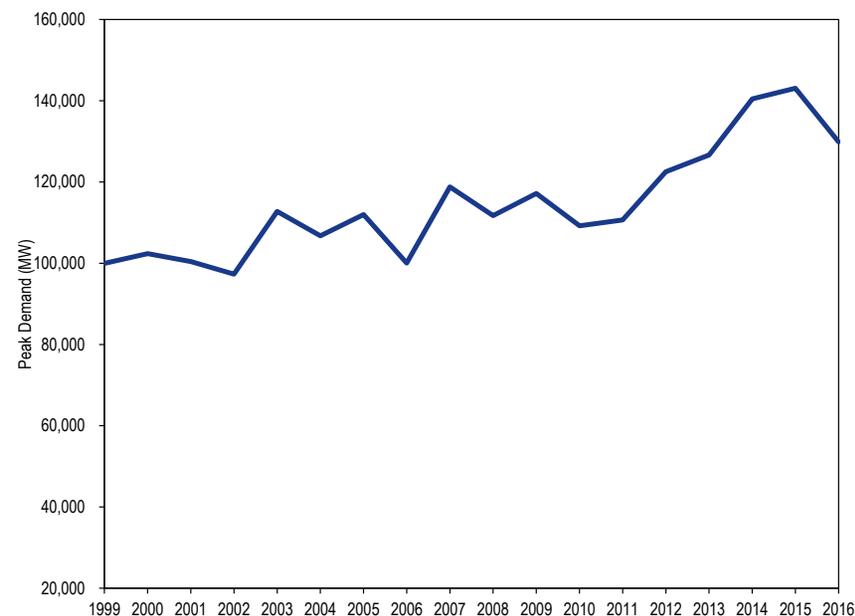


Figure 3-13 compares the peak load days during the first three months of 2015 and 2016. The average hourly real-time LMP peaked at \$162.73 on January 18, 2016 and peaked at \$418.74 on February 20, 2015.

**Figure 3-13 PJM peak-load comparison: Tuesday, January 19, 2016 and Friday, February 20, 2015**

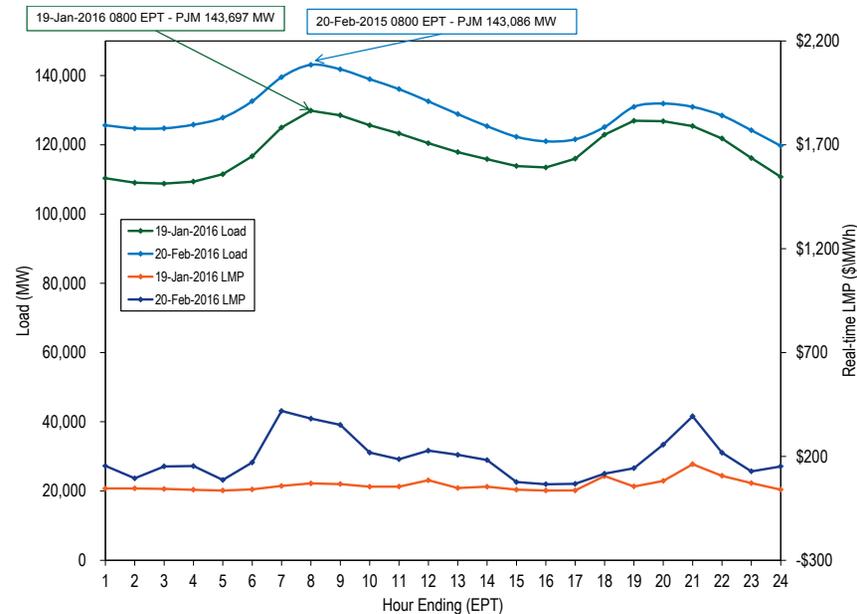

### Real-Time Demand

PJM average real-time load in the first three months of 2016 decreased by 8.8 percent from the first three months of 2015, from 97,936 MW to 89,322 MW.<sup>28</sup>

PJM average real-time demand in the first three months of 2016 decreased 9.8 percent from the first three months of 2015, from 102,821 MW to 92,777 MW.

<sup>28</sup> Load data are the net MWh injections and withdrawals MWh at every load bus in PJM.


In the PJM Real-Time Energy Market, there are two types of demand:

- **Load.** The actual MWh level of energy used by load within PJM.
- **Export.** An export is an external energy transaction scheduled from PJM to another balancing authority. A real-time export must have a valid OASIS reservation when offered, must have available ramp room to support the export, must be accompanied by a NERC Tag, and must pass the neighboring balancing authority checkout process.

### PJM Real-Time Demand Duration

Figure 3-14 shows the hourly distribution of PJM real-time load plus exports for the first three months of 2015 and 2016.<sup>29</sup>

**Figure 3-14 Distribution of PJM real-time accounting load plus exports: January through March, 2015 and 2016<sup>30</sup>**

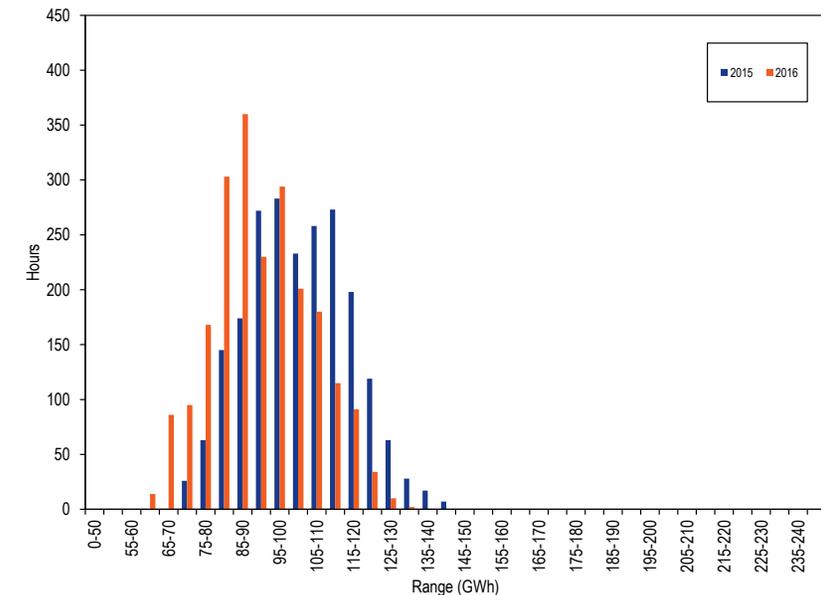

<sup>29</sup> All real-time load data in Section 3, "Energy Market," "Market Performance: Load and LMP," are based on PJM accounting load. See the *Technical Reference for PJM Markets, "Load Definitions,"* for detailed definitions of accounting load. <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

<sup>30</sup> Each range on the horizontal axis excludes the start value and includes the end value.

### PJM Real-Time, Average Load

Table 3-15 presents summary real-time demand statistics for the first three months of 1998 to 2016. Before June 1, 2007, transmission losses were included in accounting load. After June 1, 2007, transmission losses were excluded from accounting load and losses were addressed through marginal loss pricing.<sup>31</sup>

**Table 3-15 PJM real-time average hourly load and real-time average hourly load plus average hourly exports: January through March 1998 through 2016<sup>32</sup>**

Jan-Mar	PJM Real-Time Demand (MWh)				Year-to-Year Change			
	Load		Load Plus Exports		Load		Load Plus Exports	
	Load	Standard Deviation	Demand	Standard Deviation	Load	Standard Deviation	Demand	Standard Deviation
1998	28,019	3,762	28,019	3,762	NA	NA	NA	NA
1999	29,784	4,027	29,784	4,027	6.3%	7.0%	6.3%	7.0%
2000	30,367	4,624	30,367	4,624	2.0%	14.8%	2.0%	14.8%
2001	31,254	3,846	33,452	3,704	2.9%	(16.8%)	10.2%	(19.9%)
2002	29,968	4,083	30,988	3,932	(4.1%)	6.1%	(7.4%)	6.1%
2003	39,249	5,546	41,600	5,701	31.0%	35.8%	34.2%	45.0%
2004	39,549	5,761	41,198	5,394	0.8%	3.9%	(1.0%)	(5.4%)
2005	71,388	8,966	79,319	9,587	80.5%	55.6%	92.5%	77.8%
2006	80,179	8,977	86,567	9,378	12.3%	0.1%	9.1%	(2.2%)
2007	84,586	12,040	90,304	12,012	5.5%	34.1%	4.3%	28.1%
2008	82,235	10,184	89,092	10,621	(2.8%)	(15.4%)	(1.3%)	(11.6%)
2009	81,170	11,718	86,110	11,948	(1.3%)	15.1%	(3.3%)	12.5%
2010	81,121	10,694	86,843	11,262	(0.1%)	(8.7%)	0.9%	(5.7%)
2011	81,018	10,273	86,635	10,613	(0.1%)	(3.9%)	(0.2%)	(5.8%)
2012	86,329	10,951	91,090	11,293	6.6%	6.6%	5.1%	6.4%
2013	91,337	10,610	95,835	10,452	5.8%	(3.1%)	5.2%	(7.4%)
2014	98,317	13,484	104,454	12,843	7.6%	27.1%	9.0%	22.9%
2015	97,936	13,445	102,821	13,855	(0.4%)	(0.3%)	(1.6%)	7.9%
2016	89,322	13,262	92,777	13,409	(8.8%)	(1.4%)	(9.8%)	(3.2%)


<sup>31</sup> Accounting load is used here because PJM uses accounting load in the settlement process, which determines how much load customers pay for. In addition, the use of accounting load with losses before June 1, and without losses after June 1, 2007, is consistent with PJM's calculation of LMP, which excludes losses prior to June 1 and includes losses after June 1.

<sup>32</sup> Export data are not available before June 1, 2000. The export data for 2000 are for the last six months of 2000.

### PJM Real-Time, Monthly Average Load

Figure 3-15 compares the real-time, monthly average hourly loads from January 1, 2015, through March 31, 2016.

**Figure 3-15 PJM real-time monthly average hourly load: January 2015 through March 2016**

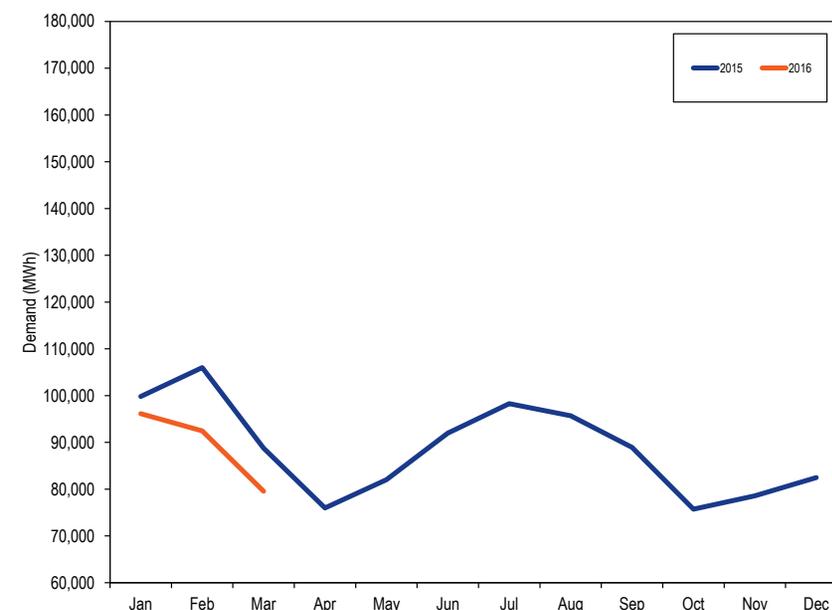

PJM real-time load is significantly affected by temperature. Figure 3-16 and Table 3-16 compare the PJM monthly heating and cooling degree days in the first three months of 2015 and 2016.<sup>33</sup> Heating degree days decreased 26.3 percent from the first three months of 2015 to 2016.

<sup>33</sup> A heating degree day is defined as the number of degrees that a day's average temperature is below 65 degrees F (the temperature below which buildings need to be heated). A cooling degree day is the number of degrees that a day's average temperature is above 65 degrees F (the temperature when people will start to use air conditioning to cool buildings). PJM uses 60 degrees F for a heating degree day as stated in Manual 19.

Heating and cooling degree days are calculated by weighting the temperature at each weather station in the individual transmission zones using weights provided by PJM in Manual 19. Then the temperature is weighted by the real-time zonal accounting load for each transmission zone. After calculating an average hourly temperature across PJM, the heating and cooling degree formulas are used to calculate the daily heating and cooling degree days, which are summed for monthly reporting. The weather stations that provided the basis for the analysis are ABE, ACY, AVP, BWI, CAK, CLE, CMH, CRW, CVG, DAY, DCA, ERI, EWR, FWA, IAD, ILG, IPT, LEX, ORD, ORF, PHL, PIT, RIC, ROA, TOL and WAL.

Figure 3-16 PJM heating and cooling degree days: January 2015 through March 2016

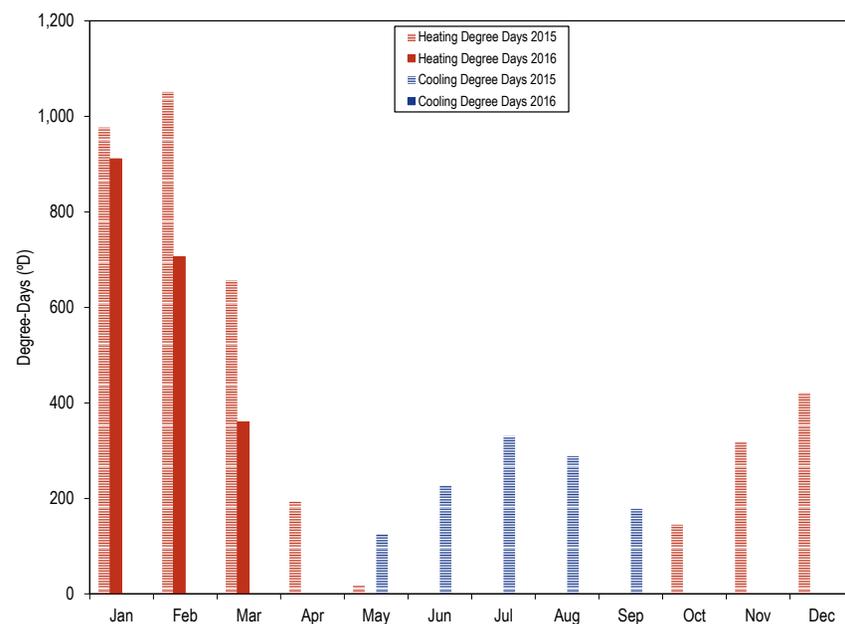


Table 3-16 PJM heating and cooling degree days: January 2015 through March 2016

	2015		2016		Percent Change	
	Heating Degree Days	Cooling Degree Days	Heating Degree Days	Cooling Degree Days	Heating Degree Days	Cooling Degree Days
Jan	977	0	911	0	(6.7%)	0.0%
Feb	1,051	0	706	0	(32.8%)	0.0%
Mar	656	0	360	0	(45.1%)	0.0%
Apr	193	0	NA	NA	NA	NA
May	18	125	NA	NA	NA	NA
Jun	1	228	NA	NA	NA	NA
Jul	0	330	NA	NA	NA	NA
Aug	0	289	NA	NA	NA	NA
Sep	0	179	NA	NA	NA	NA
Oct	145	0	NA	NA	NA	NA
Nov	319	0	NA	NA	NA	NA
Dec	421	0	NA	NA	NA	NA
Total	3,781	1,151	1,977	0	(31.7%)	(100.0%)

### Day-Ahead Demand

PJM average day-ahead demand in the first three months of 2016, including DECs and up to congestion transactions, increased by 9.6 percent from the first three months of 2015, from 119,078 MW to 130,534 MW.

PJM average day-ahead demand in the first three months of 2016, including DECs, up to congestion transactions, and exports, increased by 8.2 percent from the first three months of 2015, from 123,282 MW to 133,386 MW.

The reduction in up to congestion transactions (UTC) that had followed a FERC order setting September 8, 2014, as the effective date for any uplift charges subsequently assigned to UTCs, was reversed. There was an increase in up to congestion volume as a result of the expiration of the fifteen month resettlement period for the proceeding related to uplift charges for UTC transactions.<sup>34</sup>

<sup>34</sup> 148 FERC ¶ 61,144 (2014).

In the PJM Day-Ahead Energy Market, five types of financially binding demand bids are made and cleared:


- **Fixed-Demand Bid.** Bid to purchase a defined MWh level of energy, regardless of LMP.
- **Price-Sensitive Bid.** Bid to purchase a defined MWh level of energy only up to a specified LMP, above which the load bid is zero.
- **Decrement Bid (DEC).** Financial bid to purchase a defined MWh level of energy up to a specified LMP, above which the bid is zero. A DEC can be submitted by any market participant.
- **Up to Congestion Transaction (UTC).** A conditional transaction that permits a market participant to specify a maximum price spread between the transaction source and sink. An up to congestion transaction is evaluated as a matched pair of an injection and a withdrawal analogous to a matched pair of an INC offer and a DEC bid.
- **Export.** An external energy transaction scheduled from PJM to another balancing authority. An export must have a valid willing to pay congestion (WPC) OASIS reservation when offered. An export energy transaction that clears the Day-Ahead Energy Market is financially binding. There is no link between transactions submitted in the PJM Day-Ahead Energy Market and the PJM Real-Time Energy Market, so an export energy transaction approved in the Day-Ahead Energy Market will not physically flow in real time unless it is also submitted through the Real-Time Energy Market scheduling process.

PJM day-ahead demand is the hourly total of the five types of cleared demand bids.

### PJM Day-Ahead Demand Duration

Figure 3-17 shows the hourly distribution of PJM day-ahead demand, including decrement bids, up to congestion transactions, and exports for the first three months of 2015 and 2016.

Figure 3-17 Distribution of PJM day-ahead demand plus exports: January through March, 2015 and 2016<sup>35</sup>

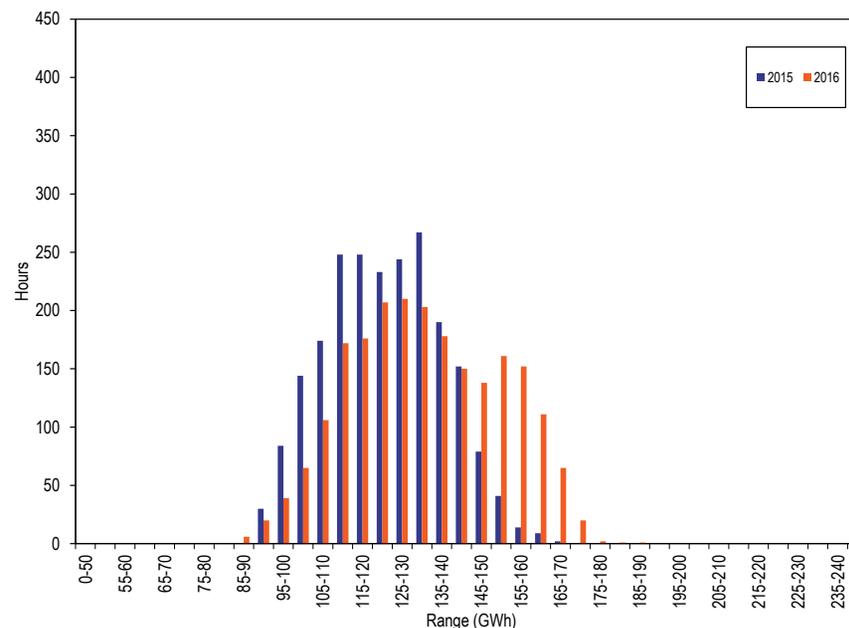

<sup>35</sup> Each range on the horizontal axis excludes the start value and includes the end value.

## PJM Day-Ahead, Average Demand

Table 3-17 presents summary day-ahead demand statistics for the first three months of each year from 2000 to 2016.<sup>36</sup>

**Table 3-17 PJM day-ahead average demand and day-ahead average hourly demand plus average hourly exports: January through March, 2000 through 2016**


Jan-Mar	PJM Day-Ahead Demand (MWh)				Year-to-Year Change			
	Demand		Demand Plus Exports		Demand		Demand Plus Exports	
	Demand	Standard Deviation	Demand	Standard Deviation	Demand	Standard Deviation	Demand	Standard Deviation
2000	NA	NA	NA	NA	NA	NA	NA	NA
2001	33,731	4,557	34,523	4,390	NA	NA	NA	NA
2002	33,976	4,960	34,004	4,964	0.7%	8.9%	(1.5%)	13.1%
2003	47,034	6,841	47,147	6,853	38.4%	37.9%	38.7%	38.1%
2004	46,885	5,591	47,123	5,537	(0.3%)	(18.3%)	(0.1%)	(19.2%)
2005	87,341	9,810	90,288	9,947	86.3%	75.5%	91.6%	79.7%
2006	96,244	9,453	99,342	9,777	10.2%	(3.6%)	10.0%	(1.7%)
2007	108,699	12,601	111,831	12,746	12.9%	33.3%	12.6%	30.4%
2008	105,995	10,677	109,428	10,975	(2.5%)	(15.3%)	(2.1%)	(13.9%)
2009	102,366	13,619	105,023	13,758	(3.4%)	27.5%	(4.0%)	25.4%
2010	101,012	11,937	104,866	12,103	(1.3%)	(12.4%)	(0.1%)	(12.0%)
2011	107,116	11,890	110,865	12,157	6.0%	(0.4%)	5.7%	0.4%
2012	129,258	13,163	132,757	13,481	20.7%	10.7%	19.7%	10.9%
2013	143,585	13,120	146,878	13,108	11.1%	(0.3%)	10.6%	(2.8%)
2014	163,031	11,914	167,318	11,717	13.5%	(9.2%)	13.9%	(10.6%)
2015	119,078	14,226	123,282	14,565	(27.0%)	19.4%	(26.3%)	24.3%
2016	130,534	18,683	133,386	18,860	9.6%	31.3%	8.2%	29.5%

<sup>36</sup> Since the Day-Ahead Energy Market did not start until June 1, 2000, the day-ahead data for 2000 only includes data for the last six months of that year.

## PJM Day-Ahead, Monthly Average Demand

Figure 3-18 compares the day-ahead, monthly average hourly demand, including decrement bids and up to congestion transactions, from January 1, 2015, through March 31, 2016.

**Figure 3-18 PJM day-ahead monthly average hourly demand: January 2015 through March 2016**

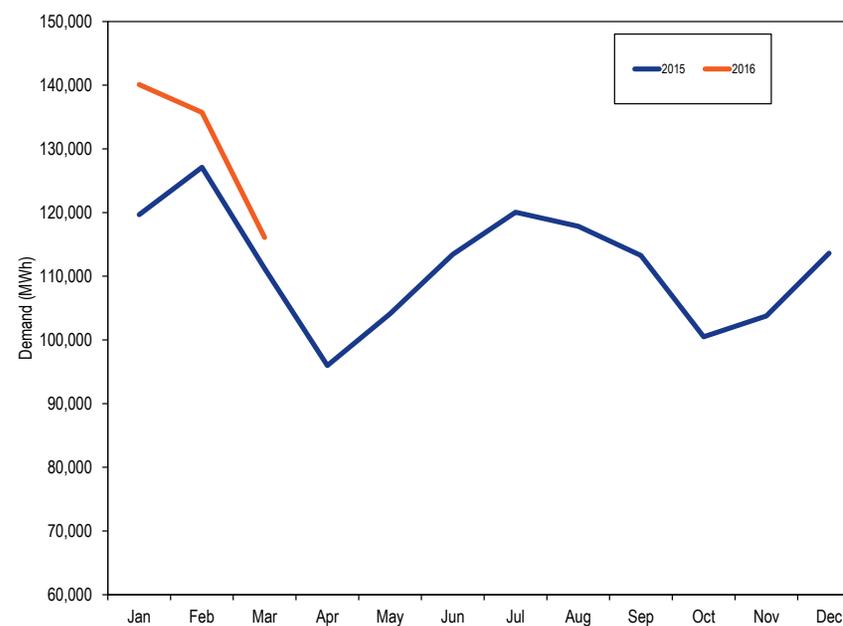

## Real-Time and Day-Ahead Demand

Table 3-18 presents summary statistics for the first three months of 2015 and 2016 day-ahead and real-time demand. The last two columns of Table 3-18 are the day-ahead demand minus the real-time demand. The first such column is the total day-ahead demand less the total real-time demand and the second such column is the total physical day-ahead load (fixed demand plus price sensitive demand) less the physical real-time load.

**Table 3-18 Cleared day-ahead and real-time demand (MWh): January through March, 2015 and 2016**

	Jan-Mar Year	Day-Ahead						Real-Time		Day-Ahead Less Real- Time	
		Fixed Demand	Price Sensitive	DEC Bids	Up-to Congestion	Exports	Total Demand	Load	Total Demand	Total Demand	Total Load
Average	2015	94,043	3,189	4,661	17,186	4,204	123,282	97,936	102,821	20,461	(705)
	2016	86,525	3,221	4,075	36,714	2,852	133,386	89,322	92,777	40,608	424
Median	2015	93,680	3,406	4,342	17,251	4,275	123,310	97,412	102,392	20,919	(327)
	2016	85,443	3,208	3,735	36,167	2,762	132,475	87,962	91,595	40,880	689
Standard Deviation	2015	12,818	815	1,181	2,993	946	14,565	13,445	13,855	710	188
	2016	12,090	396	1,305	7,532	608	18,860	13,262	13,409	5,452	(776)
Peak Average	2015	100,929	3,385	4,798	17,523	4,363	130,998	104,394	109,400	21,597	(80)
	2016	92,978	3,428	4,315	38,779	2,851	142,351	95,708	99,063	43,288	698
Peak Median	2015	101,250	3,638	4,534	17,660	4,374	131,859	104,660	110,370	21,489	229
	2016	92,889	3,404	4,166	38,102	2,785	142,530	95,338	98,602	43,928	955
Peak Standard Deviation	2015	10,738	825	1,147	2,750	976	12,281	11,578	12,006	275	(15)
	2016	9,791	323	1,157	7,538	571	16,338	11,312	11,683	4,655	(1,198)
Off-Peak Average	2015	87,830	3,012	4,538	16,881	4,061	116,321	92,110	96,885	19,436	(1,268)
	2016	80,653	3,031	3,856	34,834	2,853	125,228	83,511	87,058	38,170	174
Off-Peak Median	2015	87,272	3,178	4,205	16,914	4,163	115,311	91,187	96,438	18,873	(737)
	2016	79,956	2,984	3,417	34,249	2,745	123,918	82,392	85,932	37,985	547
Off-Peak Standard Deviation	2015	11,278	764	1,199	3,166	895	12,861	12,305	12,686	175	(263)
	2016	10,937	360	1,392	7,020	640	17,234	12,194	12,272	4,961	(897)

Figure 3-19 shows the average hourly cleared volumes of day-ahead demand and real-time demand for the first three months of 2016. The day-ahead demand includes day-ahead load, day-ahead exports, decrement bids and up to congestion transactions. The real-time demand includes real-time load and real-time exports.

**Figure 3-19 Day-ahead and real-time demand (Average hourly volumes): January through March, 2016**


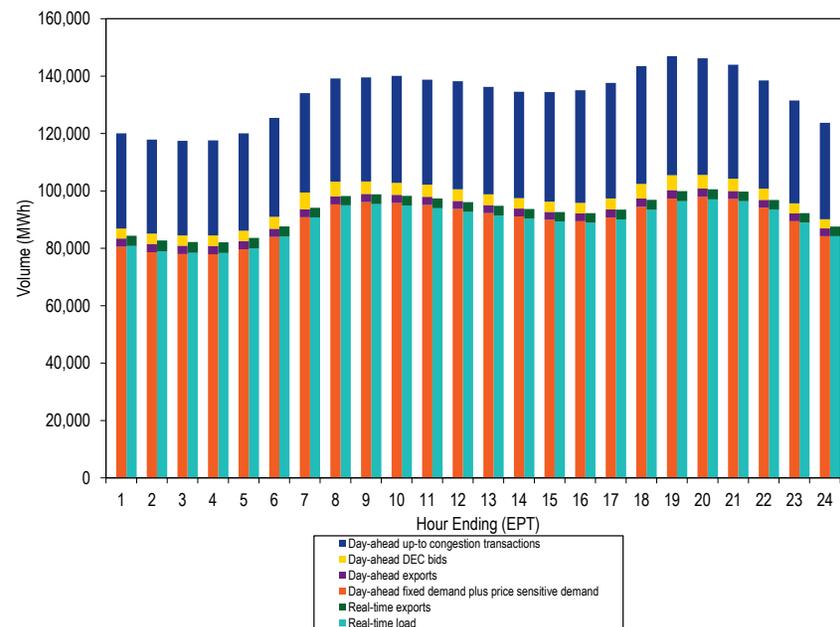


Figure 3-20 shows the difference between the day-ahead and real-time average daily demand from January 1, 2015 through March 31, 2016.

**Figure 3-20 Difference between day-ahead and real-time demand (Average daily volumes): January 2015 through March 2016**

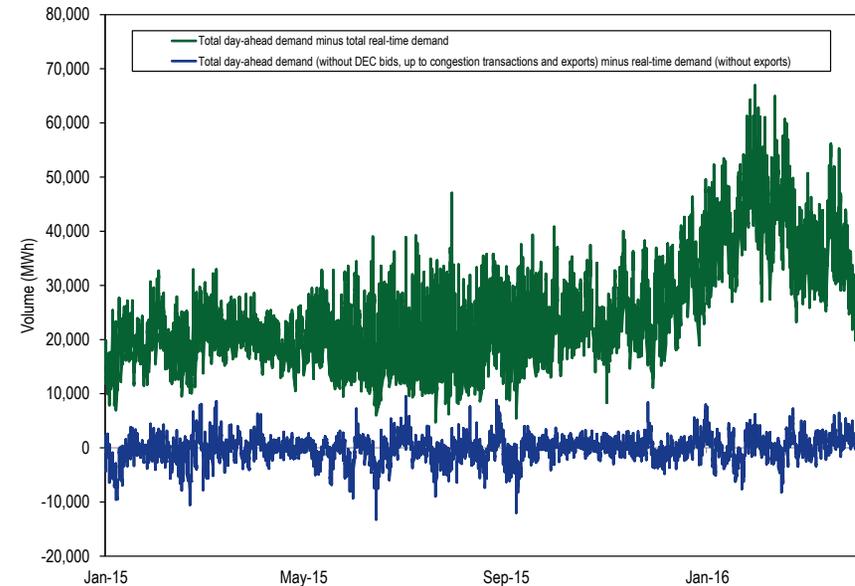

## Supply and Demand: Load and Spot Market

### Real-Time Load and Spot Market

Participants in the PJM Real-Time Energy Market can use their own generation to meet load, to sell in the bilateral market or to sell in the spot market in any hour. Participants can both buy and sell via bilateral contracts and buy and sell in the spot market in any hour. If a participant has positive net bilateral transactions in an hour, it is buying energy through bilateral contracts (bilateral purchase). If a participant has negative net bilateral transactions in an hour, it is selling energy through bilateral contracts (bilateral sale). If a participant has positive net spot transactions in an hour, it is buying energy

from the spot market (spot purchase). If a participant has negative net spot transactions in an hour, it is selling energy to the spot market (spot sale).

Real-time load is served by a combination of self-supply, bilateral market purchases and spot market purchases. From the perspective of a parent company of a PJM billing organization that serves load, its load could be supplied by any combination of its own generation, net bilateral market purchases and net spot market purchases. In addition to directly serving load, load serving entities can also transfer their responsibility to serve load to other parties through eSchedules transactions referred to as wholesale load responsibility (WLR) or retail load responsibility (RLR) transactions. When the responsibility to serve load is transferred via a bilateral contract, the entity to which the responsibility is transferred becomes the load serving entity. Supply from its own generation (self-supply) means that the parent company is generating power from plants that it owns in order to meet demand. Supply from bilateral purchases means that the parent company is purchasing power under bilateral contracts from a non-affiliated company at the same time that it is meeting load. Supply from spot market purchases means that the parent company is generating less power from owned plants and/or purchasing less power under bilateral contracts than required to meet load at a defined time and, therefore, is purchasing the required balance from the spot market.

The PJM system's reliance on self-supply, bilateral contracts and spot purchases to meet real-time load is calculated by summing across all the parent companies of PJM billing organizations that serve load in the Real-Time Energy Market for each hour. Table 3-19 shows the monthly average share of real-time load served by self-supply, bilateral contracts and spot purchase in 2015 and the first three months of 2016 based on parent company. In the first three months of 2016, 7.4 percent of real-time load was supplied by bilateral contracts, 26.6 percent by spot market purchase and 66.0 percent by self-supply. Compared with the first three months of 2015, reliance on bilateral contracts increased by 1.1 percentage points, reliance on spot supply decreased by 6.6 percentage points and reliance on self-supply increased by 5.5 percentage points.

**Table 3-19 Monthly average percentage of real-time self-supply load, bilateral-supply load and spot-supply load based on parent companies: 2015 through March 2016**

	2015			2016			Difference in Percentage Points		
	Bilateral Contract	Spot	Self-Supply	Bilateral Contract	Spot	Self-Supply	Bilateral Contract	Spot	Self-Supply
Jan	6.7%	31.6%	61.7%	7.1%	26.4%	66.5%	0.4%	(5.2%)	4.8%
Feb	6.3%	33.7%	59.9%	7.6%	26.3%	66.1%	1.2%	(7.4%)	6.2%
Mar	5.9%	34.4%	59.7%	7.6%	27.1%	65.3%	1.7%	(7.3%)	5.6%
Apr	6.3%	35.5%	58.2%						
May	5.5%	33.6%	61.0%						
Jun	6.2%	27.6%	66.2%						
Jul	6.4%	27.4%	66.1%						
Aug	6.5%	27.0%	66.6%						
Sep	6.5%	27.4%	66.1%						
Oct	7.3%	27.6%	65.1%						
Nov	7.3%	27.5%	65.3%						
Dec	7.9%	26.5%	65.6%						
Annual	6.5%	30.1%	63.4%	7.4%	26.6%	66.0%	0.9%	(3.5%)	2.6%

## Day-Ahead Load and Spot Market

In the PJM Day-Ahead Energy Market, participants can not only use their own generation, bilateral contracts and spot market purchases to supply their load serving obligation, but can also use virtual resources to meet their load serving obligations in any hour. Virtual supply is treated as supply in the day-ahead analysis and virtual demand is treated as demand in the day-ahead analysis.

The PJM system's reliance on self-supply, bilateral contracts, and spot purchases to meet day-ahead demand (cleared fixed-demand, price-sensitive load and decrement bids) is calculated by summing across all the parent companies of PJM billing organizations that serve demand in the Day-Ahead Energy Market for each hour. Table 3-20 shows the monthly average share of day-ahead demand served by self-supply, bilateral contracts and spot purchases in 2015 through March 2016, based on parent companies. In the first three months of 2016, 8.5 percent of day-ahead demand was supplied by bilateral contracts, 25.7 percent by spot market purchases, and 65.7 percent by self-supply. Compared with the first three months of 2015, reliance on

bilateral contracts decreased by 1.3 percentage points, reliance on spot supply increased by 0.6 percentage points, and reliance on self-supply increased by 0.8 percentage points.

**Table 3-20 Monthly average percentage of day-ahead self-supply demand, bilateral supply demand, and spot-supply demand based on parent companies: 2015 through March 2016**

	2015			2016			Difference in Percentage Points		
	Bilateral Contract	Spot	Self-Supply	Bilateral Contract	Spot	Self-Supply	Bilateral Contract	Spot	Self-Supply
Jan	10.3%	24.8%	64.9%	8.4%	25.4%	66.1%	(1.8%)	0.6%	1.2%
Feb	9.9%	24.2%	65.8%	8.9%	25.0%	66.1%	(1.1%)	0.8%	0.3%
Mar	9.4%	26.4%	64.2%	8.3%	26.9%	64.8%	(1.2%)	0.6%	0.6%
Apr	9.5%	29.0%	61.5%						
May	9.0%	26.7%	64.2%						
Jun	7.9%	27.7%	64.3%						
Jul	8.3%	26.8%	64.9%						
Aug	8.1%	26.7%	65.2%						
Sep	7.8%	27.6%	64.6%						
Oct	8.3%	27.9%	63.8%						
Nov	8.4%	27.7%	64.0%						
Dec	9.2%	26.6%	64.3%						
Annual	8.8%	27.1%	64.1%	8.5%	25.7%	65.7%	(0.3%)	(1.3%)	1.6%

## Market Behavior

### Offer Capping for Local Market Power


In the PJM energy market, offer capping occurs as a result of structurally noncompetitive local markets and noncompetitive offers in the Day-Ahead and Real-Time Energy Markets. PJM also uses offer capping for units that are committed for reliability reasons, specifically for providing black start and reactive service as well as for conservative operations. There are no explicit rules governing market structure or the exercise of market power in the aggregate energy market. PJM's market power mitigation goals have focused on market designs that promote competition and that limit market power mitigation to situations where market structure is not competitive and thus where market design alone cannot mitigate market power.

The analysis of the application of the three pivotal supplier test demonstrates that it is working for most hours to exempt owners when the local market structure is competitive and to offer cap owners when the local market structure is noncompetitive. However, there are some issues with the application of mitigation in the Day-Ahead Energy Market and the Real-Time Energy Market when market sellers fail the TPS test. There is no tariff or manual language that defines in detail the application of the TPS test and offer capping in the Day-Ahead Energy Market and the Real-Time Energy Market.

In both the Day-Ahead and Real-Time Energy Markets, generators have the ability to avoid mitigation by using varying markups in their price-based offers, offering different operating parameters in their price-based and cost-based offers, and using different fuels in their price-based and cost-based offers. These issues can be resolved by simple rule changes.

When an owner fails the TPS test, the units offered by the owner that are committed to provide relief are committed on the cheaper of cost or price-based offers. With the ability to submit offer curves with varying markups at different output levels in the price-based offer, units can avoid mitigation by using a low markup at low output levels and a high markup at higher output levels. Figure 3-21 shows an example of offers from a unit that has a negative markup at the economic minimum MW level and a positive markup at the economic maximum MW level. The result would be that a unit that failed the TPS test would be committed on its price-based offer even though the price-based offer is higher than cost at higher output levels and includes positive markups, inconsistent with the explicit goal of local market power mitigation.


Figure 3-21 Offers with varying markups at different MW output levels)

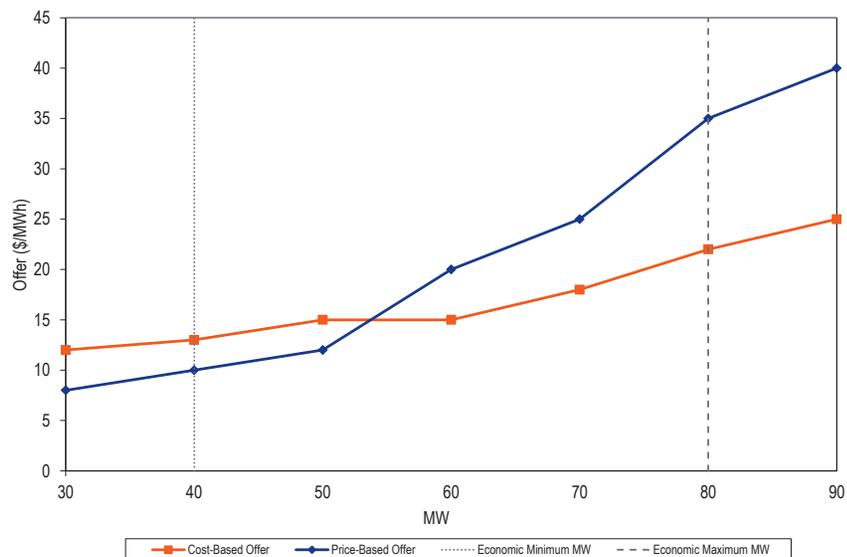

Offering a different economic minimum MW level, different minimum run times, different start up and notification times on the cost-based and price-based offers can also be used to avoid mitigation. For example, a unit may offer its price-based offer with a negative markup, but have a longer minimum run time (MRT) on the price-based offer. For example, a unit may offer a lower economic minimum MW level on the price-based offer than the cost-based offer. Such a unit may appear to be cheaper to commit on the price-based offer even with a positive markup because the total cost of commitment (calculated as a product of MW and the offer in dollars per MWh plus the startup and no-load cost) can be lower on price-based offer at the lower economic minimum level compared to cost-based offer at a higher economic minimum level. Figure 3-22 shows an example of offers from a unit that has a positive markup and a price based offer with a lower economic minimum MW than the cost based offer. The cost of commitment (area under the curve) for this unit is lower on the price-based offer than on the cost-based offer. However, the price-based offer includes a positive markup and could result


in setting the market price at a non-competitive level even after the resource owner fails the TPS test.

Figure 3-22 Offers with a positive markup but different economic minimum MW

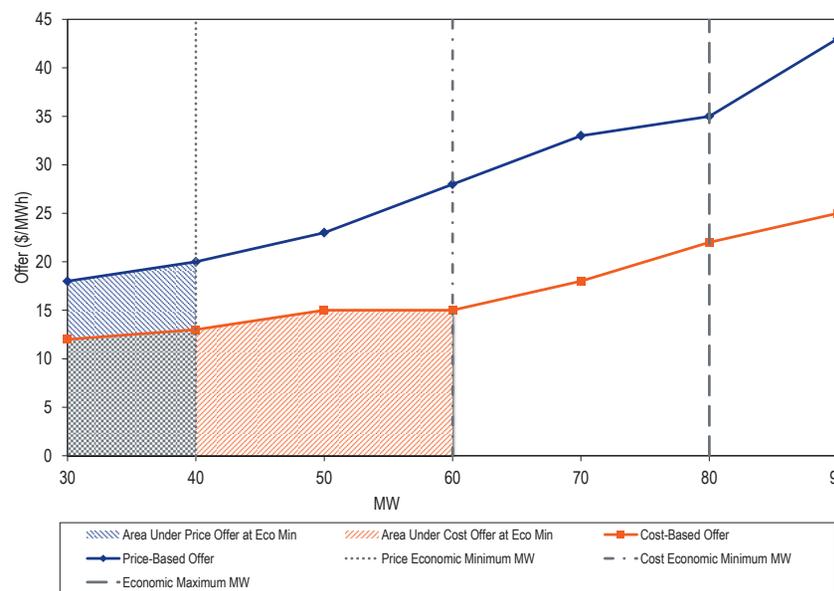

In case of dual fuel units, if the price-based offer uses a cheaper fuel and the cost-based offer uses a more expensive fuel, the price-based offer will appear to be lower cost even when it includes a markup. Figure 3-23 shows an example of offers by a dual fuel unit, where the active cost-based offer uses a more expensive fuel and the price-based offer uses a cheaper fuel and includes a markup.

Figure 3-23 Dual fuel unit offers

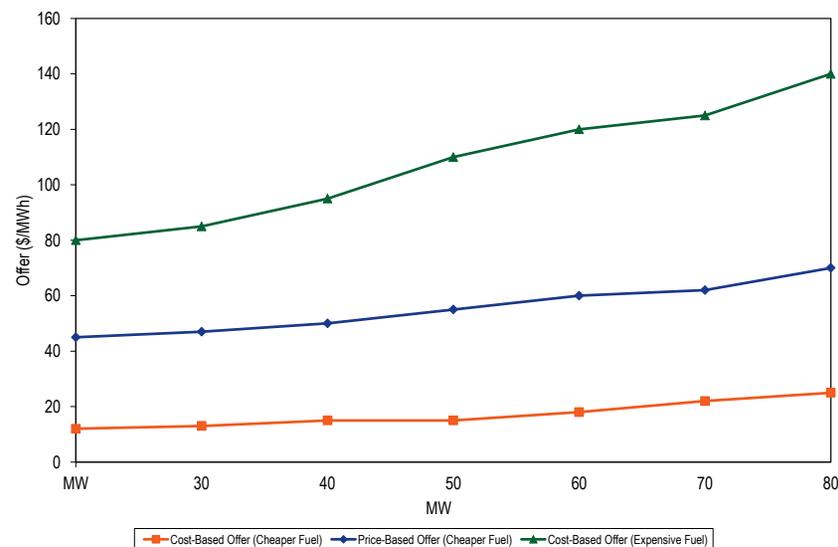

These issues can be solved by simple rule changes.<sup>37</sup> The MMU recommends that markup of price based offers over cost-based offers be constant across the offer curve, that there be at least one cost-based offer using the same fuel as the available price-based offer, and that operating parameters on parameter limited schedules (PLS) be at least as flexible as price-based non-PLS offers.

Levels of offer capping have historically been low in PJM, as shown in Table 3-21. The offer capping percentages shown in Table 3-21 include units that are committed to provide constraint relief whose owners failed the TPS test in the energy market as well as units committed as part of conservative operations, excluding units that were committed for providing black start and reactive service.

Table 3-21 Offer capping statistics – energy only: January through March, 2012 to 2016

(Jan-Mar)	Real-Time		Day-Ahead	
	Unit Hours Capped	MW Capped	Unit Hours Capped	MW Capped
2012	1.0%	0.5%	0.1%	0.2%
2013	0.3%	0.1%	0.1%	0.0%
2014	1.1%	0.4%	0.3%	0.2%
2015	0.6%	0.2%	0.3%	0.1%
2016	0.4%	0.2%	0.1%	0.1%

Table 3-22 shows the offer capping percentages including units committed to provide constraint relief and units committed to provide black start service and reactive support. The units that are committed and offer capped for black start service and reactive support reasons increased from 2011 through 2013. Before 2011, the units that ran to provide black start service and reactive support were generally economic in the energy market. From 2011 through 2013, the percentage of hours when these units were not economic (and were therefore committed on their cost schedule for reliability reasons) increased. This trend reversed in 2014 and 2015 because higher LMPs (in the first three months) resulted in the increased economic dispatch of black start and reactive service resources. As of April 2015, the Automatic Load Rejection (ALR) units that were committed for black start previously no longer provide black start service, and are not included in the offer capping statistics for black start. PJM also created closed loop interfaces to, in some cases, model reactive constraints. The result was higher LMPs, which increased economic dispatch, which contributed to the reduction in units offer capped for reactive support. In instances where units are now committed for the modeled closed loop interface constraints, they are considered offer capped for providing constraint relief. They are included in the offer capping percentages in Table 3-21.

<sup>37</sup> The MMU proposed these offer rule changes as part of a broader reform to address generator offer flexibility and associated impact on market power mitigation rules in the Generator Offer Flexibility Senior Task Force (GOFSTF).

**Table 3-22 Offer capping statistics for energy and reliability: January through March, 2012 to 2016**

(Jan-Mar)	Real-Time		Day-Ahead	
	Unit Hours Capped	MW Capped	Unit Hours Capped	MW Capped
2012	1.5%	1.0%	0.1%	0.2%
2013	2.7%	1.9%	3.1%	1.8%
2014	1.5%	0.9%	0.8%	0.6%
2015	0.8%	0.4%	0.5%	0.3%
2016	0.5%	0.3%	0.2%	0.1%

Table 3-23 shows the offer capping percentages for units committed to provide black start service and reactive support. The data in Table 3-23 is the difference between the offer cap percentages shown in Table 3-22 and Table 3-21.

**Table 3-23 Offer capping statistics for reliability: January through March, 2012 through 2016**

(Jan-Mar)	Real-Time		Day-Ahead	
	Unit Hours Capped	MW Capped	Unit Hours Capped	MW Capped
2012	0.5%	0.5%	0.0%	0.0%
2013	2.4%	1.8%	3.0%	1.8%
2014	0.4%	0.5%	0.5%	0.4%
2015	0.3%	0.2%	0.3%	0.2%
2016	0.1%	0.1%	0.1%	0.1%


Table 3-24 presents data on the frequency with which units were offer capped in the first three months of 2015 and 2016, for failing the TPS test to provide energy for constraint relief in the Real-Time Energy Market. Table 3-24 shows that seven units were offer capped for 90 percent or more of their run hours in the first three months of 2016 compared to one in the first three months of 2015.

**Table 3-24 Real-time offer capped unit statistics: January through March, 2015 and 2016**

Run Hours Offer-Capped, Percent Greater Than Or Equal To:	(Jan - Mar)	Offer-Capped Hours					
		Hours ≥ 500	Hours ≥ 400 and < 500	Hours ≥ 300 and < 400	Hours ≥ 200 and < 300	Hours ≥ 100 and < 200	Hours ≥ 1 and < 100
		2016	0	0	0	3	1
90%	2015	0	0	0	0	0	14
	2016	0	0	0	0	0	8
80% and < 90%	2015	0	0	0	0	0	9
	2016	0	0	0	0	0	8
75% and < 80%	2015	0	0	0	0	0	3
	2016	0	0	0	0	0	8
70% and < 75%	2015	0	0	0	0	0	3
	2016	0	0	0	1	0	6
60% and < 70%	2015	0	0	1	1	0	18
	2016	0	0	0	0	0	10
50% and < 60%	2015	0	0	0	4	0	5
	2016	0	0	0	0	0	16
25% and < 50%	2015	0	0	0	0	0	35
	2016	0	0	0	0	0	27
10% and < 25%	2015	0	0	0	1	2	36

Figure 3-24 shows, in a graphical version, the frequency with which units were offer capped in the first three months of 2015 and 2016, for failing the TPS test to provide energy for constraint relief in the Real-Time Energy Market.

Figure 3-24 Real-time offer capped unit statistics: January through March, 2015 and 2016

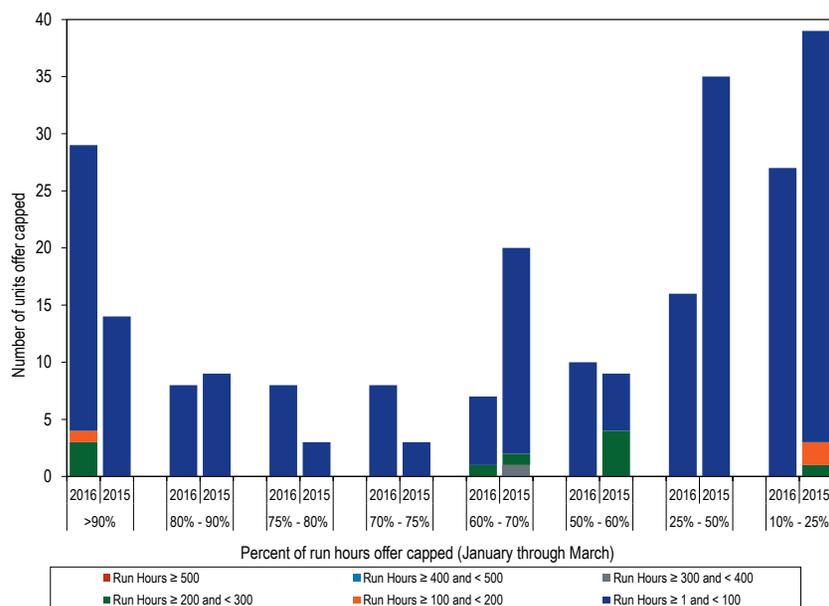

### TPS Test Statistics

In the first three months of 2016, the AECO, AEP, AP, ATSI, BGE, ComEd, Dominion, DPL, PECO, PENELEC, and PSEG control zones experienced congestion resulting from one or more constraints binding for 25 or more hours or resulting from an interface constraint. The DAY, DEOK, DLCO, EKPC, JCPL, Met-Ed, Pepco, PPL and RECO control zones did not have constraints binding for 25 or more hours in the first three months of 2016. Table 3-25 shows that AEP, AP, ComEd and PSEG were the control zones that experienced congestion resulting from one or more constraints binding for 25 or more hours or resulting from an interface constraint that was binding for one or more hours in every year in the first three months of 2009 through 2016.

Table 3-25 Numbers of hours when control zones experienced congestion resulting from one or more constraints binding for 25 or more hours or from an interface constraint: January through March, 2009 through 2016

	(Jan - Mar)							
	2009	2010	2011	2012	2013	2014	2015	2016
AECO	149	0	70	40	32	0	41	252
AEP	890	157	423	100	447	840	1,405	283
AP	125	165	89	56	38	309	417	72
ATSI	101	37	0	1	46	428	391	30
BGE	0	25	0	650	150	29	232	1,418
ComEd	325	816	123	525	973	1,233	651	1,426
DEOK	0	0	0	33	0	68	0	0
DLCO	0	141	0	146	0	211	674	0
Dominion	130	114	73	0	0	52	423	458
DPL	43	0	28	133	0	297	388	694
JCPL	0	0	0	0	0	44	79	0
Met-Ed	0	0	0	0	0	34	144	0
PECO	30	0	158	0	77	327	242	287
PENELEC	0	0	58	32	29	179	517	237
Pepco	0	0	44	66	71	39	0	0
PPL	0	0	52	0	167	41	0	0
PSEG	336	344	281	199	1,408	1,445	2,550	55

The local market structure in the Real-Time Energy Market associated with each of the frequently binding constraints was analyzed using the three pivotal supplier results in the first three months of 2016.<sup>38</sup> The three pivotal supplier (TPS) test is applied every time the system solution indicates that out of merit resources are needed to relieve a transmission constraint. Only uncommitted resources, which would be started to relieve the transmission constraint, are subject to offer capping. Already committed units that can provide incremental relief cannot be offer capped. The results of the TPS test are shown for tests that could have resulted in offer capping and tests that resulted in offer capping.

Overall, the results confirm that the three pivotal supplier test results in offer capping when the local market is structurally noncompetitive and does not result in offer capping when that is not the case. Local markets are noncompetitive when the number of suppliers is relatively small.

<sup>38</sup> See the *MMU Technical Reference for PJM Markets*, at "Three Pivotal Supplier Test" for a more detailed explanation of the three pivotal supplier test. <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

Table 3-26 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owners passing and failing for the transfer interface constraints.

**Table 3-26 Three pivotal supplier test details for interface constraints: January through March, 2016**

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
AEP - DOM	Peak	537	867	10	0	10
	Off Peak	372	548	10	0	10
Bedington - Black Oak	Peak	140	212	12	2	10
	Off Peak	91	110	9	1	8
Western	Peak	157	287	16	5	11
	Off Peak	0	0	0	0	0

**Table 3-27 Summary of three pivotal supplier tests applied for interface constraints: January through March, 2016**

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping
AEP - DOM	Peak	6	3	50%	2	33%	67%
	Off Peak	19	3	16%	2	11%	67%
Bedington - Black Oak	Peak	189	10	5%	3	2%	30%
	Off Peak	132	2	2%	1	1%	50%
Western	Peak	4	1	25%	0	0%	0%
	Off Peak	0	0	0%	0	0%	0%

The three pivotal supplier test is applied every time the PJM market system solution indicates that incremental relief is needed to relieve a transmission constraint. While every system solution that requires incremental relief to transmission constraints will result in a test, not all tested providers of effective supply are eligible for capping. Only uncommitted resources, which would be started as a result of incremental relief needs, are eligible to be offer capped. Already committed units that can provide incremental relief cannot, regardless of test score, be switched from price to cost offers. Table 3-27 provides, for the identified interface constraints, information on total tests

applied, the subset of three pivotal supplier tests that could have resulted in the offer capping of uncommitted units and the portion of those tests that did result in offer capping uncommitted units.

## Parameter Limited Schedules

All capacity resources in PJM are required to submit at least one cost-based offer. All cost-based offers, submitted by resources that are not Capacity Performance resources, are parameter limited in accordance with the Parameter Limited Schedule (PLS) matrix or to the level of a prior approved exception.<sup>39</sup> During the delivery year 2016-2017, all cost-based offers, submitted by Capacity Performance resources, are parameter limited in accordance with predetermined unit specific parameter limits. All capacity resources that choose to offer price-based schedules are required to make available at least one price-based parameter limited schedule. For resources that are not Capacity Performance resources, this schedule is to be used by

PJM for committing generation resources when a maximum emergency generation alert is declared. For Capacity Performance resources, the price-based parameter limited schedule is to be used by PJM for committing generation resources when hot weather and cold weather alerts are declared.

During the extreme cold weather conditions in the first three months of 2016 as well as 2015 and 2014, a number

of gas fired generators requested temporary exceptions to parameter limits for their parameter limited schedules due to restrictions imposed by natural gas pipelines. The parameters that were affected because of gas pipeline restrictions include minimum run time (MRT) and turn down ratio (TDR, ratio of economic maximum MW to economic minimum MW). When pipelines issue critical notices and enforce ratable take requirements, generators may be forced to nominate an equal amount of gas for each hour in a 24 hour

<sup>39</sup> See PJM, OATT, § 6.6 Minimum Generator Operating Parameters - Parameter-Limited Schedules, (September 10, 2014), pp. 1937- 1940.

period, with penalties for deviating from the nominated quantity. This led to requests for 24 hour minimum run times and turn down ratios close to 1, to avoid deviations from the hourly nominated quantity.

Key parameters like startup and notification time were not limited by the PLS matrix in the first three months of 2016 and prior periods. Some resource owners notified PJM that they needed extended notification times based on the claimed necessity for generation owners to nominate gas prior to gas nomination cycle deadlines.

Currently, there are no specific rules in the PJM tariff or manuals that specify the limits on price-based PLS offers. The intent of the price-based PLS offer is to prevent the exercise of market power during high demand conditions by units offering inflexible operating parameters to extract uplift payments. However, a generator can use a price-based PLS offer but include a higher markup than the price-based non-PLS schedule. The result would be that it is more expensive to commit a unit on the price-based PLS, thus permitting the exercise of market power using the PLS offer. This defeats the purpose of having the price-based PLS offers.

The MMU recommends that in order to ensure rigorous market power mitigation when the TPS test is failed, the operating parameters in the cost-based offer and the price-based parameter limited schedule (PLS) offer be at least as flexible as the operating parameters in the available non-PLS price-based offer, and that the price-MW pairs in the price-based PLS offer be exactly equal to the price-based non-PLS offer.

### Parameter Limited Schedules under Capacity Performance

Beginning in delivery year 2016/2017, resources that have Capacity Performance (CP) commitments are required to submit, in their parameter limited schedules (cost-based offers and price-based PLS offers), unit specific parameters that reflect the physical capability of the technology type of the resource. In its order on Capacity Performance, the Commission determined that resources should be able to reflect actual constraints based on not just the resource physical constraints, but also other constraints, such as contractual

limits that are not based on the physical characteristics of the generator.<sup>40</sup> The Commission found that it is unjust and unreasonable to not provide uplift payments to resources with parameters based on non-physical constraints.<sup>41</sup> The Commission directed PJM to submit tariff language to establish a process through which resources that operate outside the defined unit-specific parameter limits can justify such operation and therefore remain eligible for make-whole payments.<sup>42</sup>

A primary goal of the Capacity Performance market design is to assign performance risk to generation owners and to ensure that capacity prices reflect underlying supply and demand conditions, including the cost of taking on performance risk. The Order's determination on parameters is not consistent with that goal. By permitting generation owners to establish unit parameters based on non-physical limits, the June 9<sup>th</sup> Order has weakened the incentives for units to be flexible and has weakened the assignment of performance risk to generation owners. Contractual limits, unlike generating unit operational limits, are a function of the interests and incentives of the parties to the contracts. If a generation owner expects to be compensated through uplift payments for running for 24 hours regardless of whether the energy is economic or needed, that generation owner has no incentive to pay more to purchase the flexible gas service that would permit the unit to be flexible in response to dispatch.

The fact that a contract may be just and reasonable because it was an arm's length contract entered into by two willing parties does not mean that is the only possible arrangement between the two parties or that it is consistent with an efficient market outcome. The actual contractual terms are a function of the incentives and interests of the parties. The fact that a just and reasonable contract exists between a generation owner and a gas supplier does not mean that it is appropriate or efficient to impose the resultant costs on electric customers or that it incorporates an efficient allocation of performance risk between the generation owner and other market participants.

<sup>40</sup> *PJM Interconnection, LLC et al.*, 151 FERC ¶ 61,208 at P 437 (June 9<sup>th</sup> Order).

<sup>41</sup> *Id.* at P 439.

<sup>42</sup> *Id.* at P 440.

The approach to parameters defined in the June 9<sup>th</sup> Order would increase energy market uplift payments substantially. Uplift costs are unpredictable, opaque and unhedgeable. Electric customers are not in a position to determine the terms of the contracts that resources enter into. Customers rely on the market rules to create incentives that protect them by assigning operational risk to generators, who are in the best position to efficiently manage those risks.

The MMU recommends that the revised rules recognize the difference between operational parameters that indicate to PJM dispatchers what a unit is capable of during the operating day and the parameters that are reflected in uplift payments. The parameters provided to PJM dispatchers each day should reflect what units are physically capable of. That is an operational necessity. However, the parameters which determine the amount of uplift payments to those generators should reflect the flexibility goals of the capacity performance construct.

The MMU recommends that resources be held to the OEM operating parameters of the capacity market CONE reference resource for performance assessment and energy uplift payments. This solution creates the incentives for flexibility and preserves, to the extent possible, the incentives to follow PJM's dispatch instructions during tight conditions. The proposed operating parameters should be based on the physical capability of the Reference Resource used in the Cost of New Entry, currently two GE Frame 7FA turbines with dual fuel capability. All resources that are less flexible than the Reference Resource are expected to be scheduled and running during tight conditions anyway, while the flexible CTs that are used as peaking plants would still have the incentive to follow LMP and dispatch instructions. CCs would also have the capability to be as flexible as the reference resource. These units will be exempt from non-performance charges and made whole as long as they perform in accordance with their parameters. This ensures that all the peaking units that are needed by PJM for flexible operation do not self schedule at their maximum output, and follow PJM dispatch instructions during tight conditions. If any of the less flexible resources need to be dispatched down by PJM for reliability reasons, they would be exempt from non-performance charges.

Such an approach is consistent with the Commission's no excuses policy for non-performance because the flexibility target is set based on the optimal OEM-defined capability for the marginal resource that is expected to meet peak demand, which is consistent with the level of performance that customers are paying for in the capacity market. Any resource that is less flexible is not excused for non-performance and any resource that meets the flexibility target is performing according to the commitments made in the capacity market.

The June 9<sup>th</sup> Order pointed out that the way to ensure that a resource's parameters are exposed to market consequences is to not allow any parameter limitations as an excuse for non-performance. The same logic should apply to energy market uplift rules. A resource's parameters should be exposed to market consequences and the resource should not be made whole if it is operating less flexibly than the reference resource. Paying energy market uplift on the basis of parameters consistent with the flexibility goals of the capacity performance construct would ensure that performance incentives are consistent across the capacity and energy markets and ensure that performance risk is appropriately assigned to generation owners.

## Markup Index

The markup index is a summary measure of participant offer behavior or conduct for individual marginal units. The markup index for each marginal unit is calculated as  $(\text{Price} - \text{Cost})/\text{Price}$ .<sup>43</sup> The markup index is normalized and can vary from -1.00 when the offer price is less than short run marginal cost, to 1.00 when the offer price is higher than short run marginal cost. The markup index does not measure the impact of unit markup on total LMP.

## Real-Time Markup

Table 3-28 shows the average markup index of marginal units in the Real-Time Energy Market, by offer price category using unadjusted cost offers. Table 3-29 shows the average markup index of marginal units in the Real-Time Energy Market, by offer price category using adjusted cost offers. The markup is negative if the cost-based offer of the marginal unit exceeds its

<sup>43</sup> In order to normalize the index results (i.e., bound the results between +1.00 and -1.00), the index is calculated as  $(\text{Price} - \text{Cost})/\text{Price}$  when price is greater than cost, and  $(\text{Price} - \text{Cost})/\text{Cost}$  when price is less than cost.

price-based offer at its operating point. In the first three months of 2016, 89.2 percent of marginal units had average dollar markups less than zero, when using unadjusted offers. In the first three months of 2016, 89.2 percent of marginal units had average dollar markups less than zero, when using adjusted offers. The data shows that some marginal units did have substantial markups. Among the units that were marginal in the first three months of 2016, none of them had offer prices above \$400 per MWh. Among the units that were marginal in the first three months of 2015, 0.52 percent of units had offer prices greater than \$400 per MWh with average dollar markup of \$60.88 per MWh. Using the unadjusted cost offers, the highest markup in the first three months of 2016 was \$216.98 while the highest markup the first three months of 2015 was \$792.21.

**Table 3-28 Average, real-time marginal unit markup index (By offer price category unadjusted): January through March, 2015 and 2016**

Offer Price Category	2015 (Jan-Mar)			2016 (Jan-Mar)		
	Average Markup Index	Average Dollar Markup	Frequency	Average Markup Index	Average Dollar Markup	Frequency
< \$25	(0.10)	(\$3.28)	25.4%	0.01	(\$1.09)	66.5%
\$25 to \$50	(0.03)	(\$1.31)	53.6%	(0.05)	(\$3.10)	22.7%
\$50 to \$75	0.05	\$3.02	5.5%	0.14	\$8.49	1.8%
\$75 to \$100	0.06	\$4.15	2.7%	0.24	\$21.23	0.8%
\$100 to \$125	0.06	\$5.48	2.5%	0.05	\$6.32	2.0%
\$125 to \$150	0.05	\$4.69	1.8%	0.01	\$0.81	5.9%
>= \$150	0.07	\$18.34	8.6%	0.19	\$34.75	0.4%

**Table 3-29 Average, real-time marginal unit markup index (By offer price category adjusted): January through March, 2015 and 2016**

Offer Price Category	2015 (Jan-Mar)			2016 (Jan-Mar)		
	Average Markup Index	Average Dollar Markup	Frequency	Average Markup Index	Average Dollar Markup	Frequency
< \$25	(0.06)	(\$1.97)	25.4%	0.04	(\$0.20)	66.5%
\$25 to \$50	0.02	\$0.42	53.6%	(0.00)	(\$1.39)	22.7%
\$50 to \$75	0.08	\$4.29	5.5%	0.15	\$9.54	1.8%
\$75 to \$100	0.06	\$4.62	2.7%	0.25	\$21.83	0.8%
\$100 to \$125	0.06	\$5.81	2.5%	0.05	\$6.32	2.0%
\$125 to \$150	0.05	\$5.10	1.8%	0.01	\$0.81	5.9%
>= \$150	0.07	\$18.64	8.6%	0.19	\$34.88	0.4%

Table 3-30 shows the average highest markup of all offered units by the fuel type. Unlike a marginal unit's markup, which was calculated at the specified dispatch point, the highest markup offered by a unit within its economic operating range is included in this measure.

In the first three months of 2016, the average highest markup of a coal unit was \$12.90 per MWh. In the first three months of 2015, the average highest markup of a coal unit was \$9.06. In the first three months of 2016, the average highest markup of a natural gas unit was \$21.84 per MWh. In the first three months of 2015, the average highest markup of a natural gas unit was \$34.76 per MWh.

**Table 3-30 Average, real-time offered unit markup (By Fuel Price Unadjusted): January through March, 2015 and 2016**

Fuel Type	2015 (Jan-Mar)	2016 (Jan-Mar)
	Average Highest Markup	Average Highest Markup
Coal	\$9.06	\$12.90
Gas	\$34.76	\$21.84
Municipal Waste	\$5.07	\$0.10
Oil	\$72.64	\$39.96
Other	\$52.21	\$15.51
Uranium	(\$0.12)	(\$0.84)
Wind	(\$3.03)	(\$3.01)

## Day-Ahead Markup

Table 3-31 shows the average markup index of marginal units in the Day-Ahead Energy Market, by offer price category using unadjusted offers. In the first three months of 2016, 0.0 percent of marginal units had average dollar markups less than zero and an average markup index less than or equal to 0.00. The data show that some marginal units in the first three months of 2016 did have substantial markups. The average markup index increased significantly, for example, from 0.09 in the first three months of 2015, to 0.24 in the first three months of 2016 in the offer price category from \$50 to \$75.

**Table 3-31 Average day-ahead marginal unit markup index (By offer price category, unadjusted): January through March, 2015 and 2016**

Offer Price Category	2015 (Jan - Mar)			2016 (Jan - Mar)		
	Average Markup Index	Average Dollar Markup	Frequency	Average Markup Index	Average Dollar Markup	Frequency
< \$25	(0.11)	(\$3.53)	28.2%	0.16	\$1.15	58.7%
\$25 to \$50	(0.02)	(\$0.76)	57.0%	0.10	\$2.44	28.1%
\$50 to \$75	0.09	\$4.89	4.7%	0.24	\$13.05	2.6%
\$75 to \$100	0.04	\$2.52	2.8%	0.12	\$10.16	0.2%
\$100 to \$125	(0.01)	(\$3.30)	2.0%	0.04	\$4.97	0.7%
\$125 to \$150	(0.00)	(\$4.56)	1.4%	0.03	\$3.45	9.5%
>= \$150	0.04	\$6.02	3.8%	0.00	\$0.00	0.0%

Table 3-32 shows the average markup index of marginal units in the Day-Ahead Energy Market, by offer price category using adjusted offers. In the first three months of 2016, 0.01 percent of marginal units had average dollar markups less than zero and an average markup index less than or equal to 0.00. The average markup index increased significantly, for example, from 0.11 in the first three months of 2015, to 0.28 in the first three months of 2016 in the offer price category from \$50 to \$75.

**Table 3-32 Average day-ahead marginal unit markup index (By offer price category, adjusted): January through March, 2015 and 2016**

Offer Price Category	2015 (Jan - Mar)			2016 (Jan - Mar)		
	Average Markup Index	Average Dollar Markup	Frequency	Average Markup Index	Average Dollar Markup	Frequency
< \$25	(0.04)	(\$1.46)	28.2%	0.19	\$2.14	58.7%
\$25 to \$50	0.04	\$1.36	57.0%	0.15	\$4.31	28.1%
\$50 to \$75	0.11	\$6.25	4.7%	0.28	\$15.46	2.6%
\$75 to \$100	0.04	\$2.76	2.8%	0.12	\$10.16	0.2%
\$100 to \$125	(0.00)	(\$2.76)	2.0%	0.04	\$4.97	0.7%
\$125 to \$150	0.00	(\$4.05)	1.4%	0.03	\$3.45	9.5%
>= \$150	0.04	\$6.13	3.8%	0.00	\$0.00	0.0%

## Frequently Mitigated Units and Associated Units

An FMU is a frequently mitigated unit. The results reported here include units that were mitigated for any reason, including both structural market power

in the energy market and units called on for reliability reasons, including reactive and black start service.

The FMU adder was filed with FERC in 2005, and approved effective February 2006.<sup>44</sup> The goal, in 2005, was to ensure that units that were offer capped for most of their run hours could cover their going forward or avoidable costs (also known as ACR in the PJM Capacity Market). That function became unnecessary with the introduction of the RPM capacity market design in 2007, and changes to the scarcity pricing rules in 2012. Under the RPM design, units can make offers in the capacity market that include their ACR net of net revenues. Thus, if there is a shortfall in ACR recovery, that shortfall is included in the RPM offer. If the unit clears in RPM, it covers its shortfall in ACR costs. If the unit does not clear, then the market result means that PJM can provide reliability without the unit and no additional revenue is needed.

For those reasons, the MMU recommended the elimination of FMU and AU adders.<sup>45</sup> FMU and AU adders no longer serve the purpose for which they were created and interfere with the efficient operation of PJM markets.

The MMU and PJM proposed a compromise on the elimination of FMU adders that maintains the ability of generating units to qualify for FMU adders when units have net revenues less than unit going forward costs or ACR. PJM submitted the joint MMU/PJM proposal to the Commission pursuant to section 206 of the Federal Power Act. On October 31, 2014, the Commission conditionally approved the filing and the new rule became effective November 1, 2014.

The definition of FMUs provides for a set of graduated adders associated with increasing levels of offer capping. Units capped for 60 percent or more of their run hours and less than 70 percent are eligible for an adder of either 10 percent of their cost-based offer or \$20 per MWh. Units capped for 70 percent or more of their run hours and less than 80 percent are eligible for an adder of either 10 percent of their cost-based offer or \$30 per MWh. Units capped for 80 percent or more of their run hours are eligible for an adder of either

<sup>44</sup> 110 FERC ¶ 61,053 (2005).

<sup>45</sup> See the "FMU Problem Statement and Issue Charge," <[http://www.monitoringanalytics.com/reports/Presentations/2013/IMM\\_MIC\\_FMU\\_Problem\\_Statement\\_and\\_Issue\\_Charge\\_20130306.pdf](http://www.monitoringanalytics.com/reports/Presentations/2013/IMM_MIC_FMU_Problem_Statement_and_Issue_Charge_20130306.pdf)>.

10 percent of their cost-based offer or \$40 per MWh. These categories are designated Tier 1, Tier 2 and Tier 3.


In addition to being offer capped for the designated percent of run hours, in order to qualify for an FMU adder, a generating unit's Projected PJM Market Revenues plus the unit's PJM capacity market revenues on a rolling 12-month basis, divided by the unit's MW of installed capacity (in \$/MW-year) must be less than its accepted unit specific Avoidable Cost Rate (in \$/MW-year) (excluding APIR and ARPIR), or its default Avoidable Cost Rate (in \$/MW-year) if no unit-specific Avoidable Cost Rate is accepted for the BRAs for the Delivery Years included in the rolling 12-month period, determined pursuant to Sections 6.7 and 6.8 of Attachment DD of the Tariff. (The relevant Avoidable Cost Rate is the weighted average of the Avoidable Cost Rates for each Delivery Year included in the rolling 12-month period, weighted by month.) No portion of the unit may be included in an FRR capacity plan or be receiving compensation under Part V of the PJM Tariff and the unit must be internal to the PJM Region and subject only to PJM dispatch.<sup>46</sup>

An AU, or associated unit, is a unit that is physically, electrically and economically identical to an FMU, but does not qualify for the same FMU adder based on the number of run-hours the unit is offer capped.<sup>47</sup> For example, if a generating station had two identical units with identical electrical impacts on the system, one of which was offer capped for more than 80 percent of its run hours, that unit would be designated a Tier 3 FMU. If the second unit were capped for 30 percent of its run hours, that unit would be an AU and receive the same Tier 3 adder as the FMU at the site. The AU designation was implemented to ensure that the associated unit is not dispatched in place of the FMU, resulting in no effective adder for the FMU. In the absence of the AU designation, the associated unit would be an FMU after its dispatch and the FMU would be dispatched in its place after losing its FMU designation.

Figure 3-25 shows the total number of FMUs and AUs that qualified for an adder since the inception of the business rule in February 2006. The new

rules for determining the qualification of a unit as an FMU or AU became effective November 1, 2014. FMUs and AUs are designated monthly, and a unit's capping percentage is based on a rolling 12-month average, effective with a one-month lag.<sup>48</sup> The number of units that were eligible for an FMU or AU adder declined from an average of 70 units during the first 11 months of 2014, to zero since December 2014.

**Figure 3-25 Frequently mitigated units and associated units (By month): February, 2006 through March, 2016**

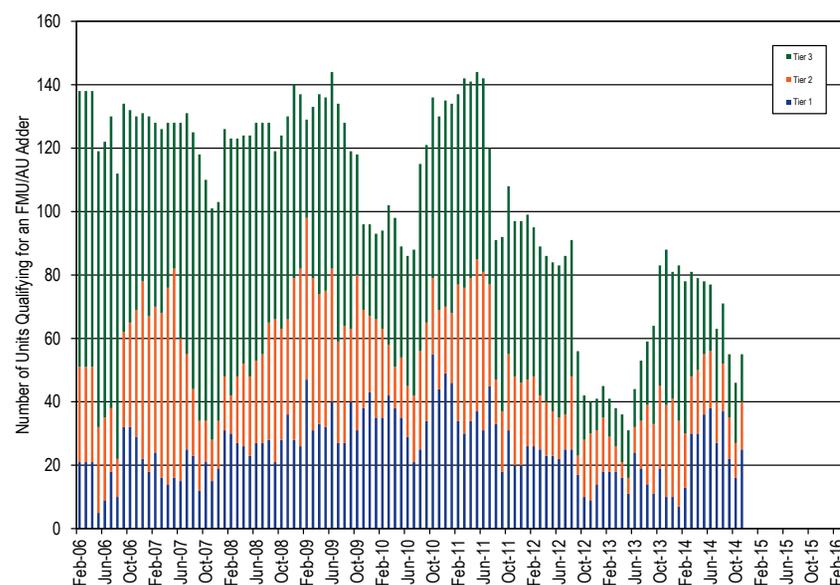

<sup>46</sup> PJM. OA, Schedule 1 § 6.4.2.

<sup>47</sup> An associated unit (AU) must belong to the same design class (where a design class includes generation that is the same size and utilizes the same technology, without regard to manufacturer) and uses the identical primary fuel as the FMU.

<sup>48</sup> PJM. OA, Schedule 1 § 6.4.2. In 2007, the FERC approved OA revisions to clarify the AU criteria.

## Virtual Offers and Bids

There is a substantial volume of virtual offers and bids in the PJM Day-Ahead Energy Market and such offers and bids may be marginal, based on the way in which the PJM optimization algorithm works.

Any market participant in the PJM Day-Ahead Energy Market can use increment offers, decrement bids, up to congestion transactions, import transactions and export transactions as financial instruments that do not require physical generation or load. Increment offers and decrement bids may be submitted at any hub, transmission zone, aggregate, or single bus for which LMP is calculated. Up to congestion transactions may be submitted between any two buses on a list of 431 buses, eligible for up to congestion transaction bidding.<sup>49</sup> Financial Transaction Rights (FTRs) bids may be submitted at any bus on a list of selected buses that change every planning period, eligible for FTRs. Import and export transactions may be submitted at any interface pricing point, where an import is equivalent to a virtual offer that is injected into PJM and an export is equivalent to a virtual bid that is withdrawn from PJM.

Figure 3-26 shows the PJM day-ahead daily aggregate supply curve of increment offers, the system aggregate supply curve of imports, the system aggregate supply curve without increment offers and imports, the system aggregate supply curve with increment offers, and the system aggregate supply curve with increment offers and imports for an example day in 2016.

Figure 3-26 PJM day-ahead aggregate supply curves: 2016 example day

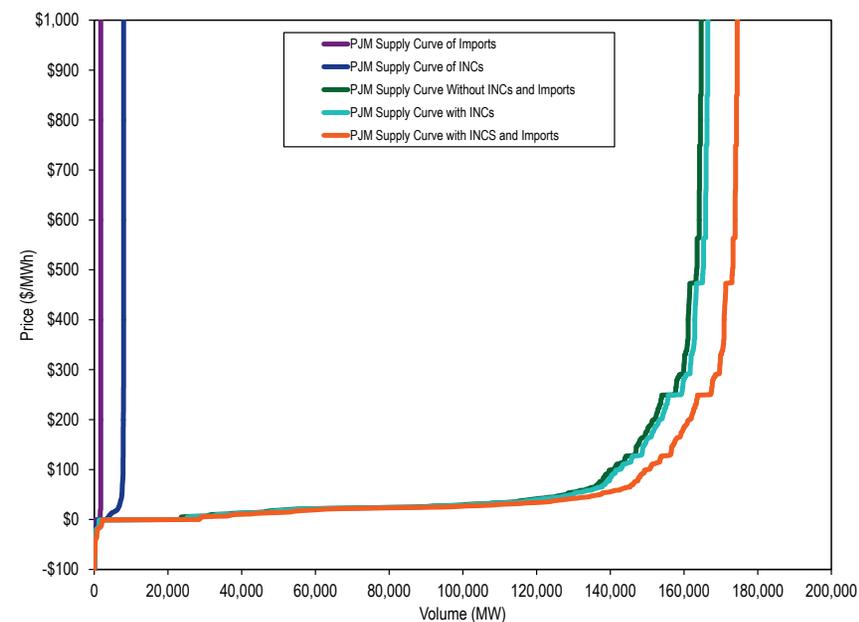


Table 3-33 shows the hourly average number of cleared and submitted increment and decrements by month for 2015 through March 2016. The hourly average submitted and cleared increment MW increased by 13.7 and 10.9 percent, from 7,425 MW and 4,691 MW in the first three months of 2015 to 8,445 MW and 5,202 MW in the first three months of 2016. The hourly average submitted and cleared decrement MW decreased by 7.0 and 12.6 percent, from 7,901 MW and 4,661 MW in the first three months of 2015 to 7,344 MW and 4,074 MW in the first three months of 2016.

<sup>49</sup> Market participants were required to specify an interface pricing point as the source for imports, an interface pricing point as the sink for exports or an interface pricing point as both the source and sink for transactions wheeling through PJM. On November 1, 2012, PJM eliminated this requirement. For the list of eligible sources and sinks for up to congestion transactions, see [www.pjm.com/~media/etools/oasis/references/oasis-source-sink-link.xls](http://www.pjm.com/~media/etools/oasis/references/oasis-source-sink-link.xls).

**Table 3-33 Hourly average number of cleared and submitted INCs, DEC by month: January 2015 through March 2016**

Year		Increment Offers				Decrement Bids			
		Average Cleared MW	Average Submitted MW	Average Cleared Volume	Average Submitted Volume	Average Cleared MW	Average Submitted MW	Average Cleared Volume	Average Submitted Volume
2015	Jan	4,350	6,447	78	398	5,153	7,320	76	295
2015	Feb	4,754	7,109	116	578	4,511	7,445	72	409
2015	Mar	4,973	8,689	142	760	4,305	8,894	101	648
2015	Apr	4,511	6,351	187	558	3,453	6,990	84	451
2015	May	5,089	7,459	181	656	4,171	6,823	94	404
2015	Jun	4,592	7,043	143	697	4,196	6,696	89	410
2015	Jul	4,101	6,534	128	745	3,335	5,830	86	448
2015	Aug	4,457	6,956	135	749	3,433	5,506	74	398
2015	Sep	4,527	6,772	148	733	4,391	7,030	112	437
2015	Oct	4,631	7,112	199	846	3,990	6,757	112	462
2015	Nov	5,022	7,822	223	1,008	3,671	6,435	109	482
2015	Dec	5,102	7,775	189	1,010	4,028	6,869	129	486
2015	Annual	4,675	7,175	156	729	4,051	6,879	95	444
2016	Jan	5,035	8,093	174	1,066	4,286	7,569	100	534
2016	Feb	4,831	8,710	178	1,150	4,259	8,158	113	572
2016	Mar	5,715	8,548	208	1,045	3,690	6,357	101	502
2016	Annual	5,202	8,445	187	1,085	4,074	7,344	104	535

Table 3-34 shows the average hourly number of up to congestion transactions and the average hourly MW for 2015 through March 2016. In the first three months of 2016, the average hourly up to congestion submitted MW increased 146.1 percent and cleared MW increased 113.6 percent, compared to the first three months of 2015, as a result of the expiration of the fifteen month resettlement period for the proceeding related to uplift charges for UTC transactions in December 2015. Section 206(b) of the Federal Power Act states that "...the Commission may order refunds of any amounts paid, for the period subsequent to the refund effective date through a date fifteen months after such refund effective date..."<sup>50</sup>

<sup>50</sup> 16 U.S.C. § 824e.

**Table 3-34 Hourly average of cleared and submitted up to congestion bids by month: January 2015 through March 2016**

		Up to Congestion			
Year		Average Cleared MW	Average Submitted MW	Average Cleared Volume	Average Submitted Volume
2015	Jan	15,903	46,626	806	2,132
2015	Feb	17,255	57,318	892	2,695
2015	Mar	18,382	72,906	978	2,909
2015	Apr	16,300	73,446	811	2,734
2015	May	18,929	81,358	941	3,219
2015	Jun	17,714	81,452	896	3,220
2015	Jul	18,883	88,543	952	3,502
2015	Aug	18,490	102,084	1,126	4,291
2015	Sep	20,779	108,730	1,451	4,909
2015	Oct	20,183	100,673	1,493	4,736
2015	Nov	20,880	86,857	1,468	4,067
2015	Dec	27,124	99,083	1,933	4,841
2015	Annual	19,255	83,422	1,147	3,611
2016	Jan	39,446	135,369	2,455	6,015
2016	Feb	38,818	152,891	2,091	5,748
2016	Mar	31,938	147,963	1,704	5,094
2016	Annual	36,688	145,243	2,083	5,616

Table 3-35 shows the average hourly number of import and export transactions and the average hourly MW for January 2015 through March 2016. In the first three months of 2016, the average hourly submitted MW decreased by 45.4 percent, cleared import transaction MW decreased by 30.4 percent, and the average hourly submitted and cleared export transaction MW decreased 38.6 and 37.9 percent, compared to the first three months of 2015.

Table 3-36 shows the frequency with which generation offers, import or export transactions, up to congestion transactions, decrement bids, increment offers and price-sensitive demand are marginal for the first three months of 2015 and 2016.

**Table 3-35 Hourly average number of cleared and submitted import and export transactions by month: January 2015 through March 2016**

		Imports				Exports			
Year		Average Cleared MW	Average Submitted MW	Average Cleared Volume	Average Submitted Volume	Average Cleared MW	Average Submitted MW	Average Cleared Volume	Average Submitted Volume
2015	Jan	2,579	4,559	26	26	4,473	4,559	26	26
2015	Feb	4,383	4,469	23	25	4,383	4,469	23	25
2015	Mar	3,268	3,302	16	17	3,268	3,302	16	17
2015	Apr	2,624	2,626	13	13	2,624	2,626	13	13
2015	May	2,612	2,623	17	17	2,612	2,623	17	17
2015	Jun	2,895	2,906	14	14	2,895	2,906	14	14
2015	Jul	2,961	2,983	14	14	2,961	2,983	14	14
2015	Aug	3,209	3,239	15	15	3,209	3,239	15	15
2015	Sep	3,873	3,913	18	18	3,873	3,913	18	18
2015	Oct	2,190	2,197	11	11	2,190	2,197	11	11
2015	Nov	2,715	2,734	15	15	2,715	2,734	15	15
2015	Dec	2,475	2,483	13	13	2,475	2,483	13	13
2015	Annual	3,131	3,160	16	17	3,131	3,160	16	17
2016	Jan	2,059	2,103	15	16	2,564	2,571	13	14
2016	Feb	2,396	2,480	20	22	2,634	2,653	13	13
2016	Mar	2,097	2,145	17	18	2,324	2,330	11	11
2016	Annual	2,179	2,237	17	19	2,504	2,515	12	13

Table 3-36 Type of day-ahead marginal units: January through March, 2015 and 2016

	2015 (Jan - Mar)						2016 (Jan - Mar)				
	Generation	Dispatchable Transaction	Up to Congestion Transaction	Decrement Bid	Increment Offer	Price Sensitive Demand	Generation	Dispatchable Transaction	Up to Congestion Transaction	Decrement Bid	Increment Offer
Jan	14.2%	0.5%	71.9%	6.9%	6.3%	0.1%	5.3%	0.1%	85.2%	5.6%	3.8%
Feb	13.1%	0.4%	73.1%	7.6%	5.6%	0.1%	5.5%	0.0%	83.5%	7.4%	3.6%
Mar	10.0%	0.7%	73.3%	10.6%	5.3%	0.0%	7.0%	0.1%	80.6%	7.7%	4.7%
Annual	12.3%	0.6%	72.8%	8.5%	5.7%	0.1%	5.9%	0.1%	83.2%	6.9%	4.0%

Figure 3-27 shows the monthly volume of bid and cleared INC, DEC and up to congestion bids by month for the period from January 2005 through March 2016.

Figure 3-27 Monthly bid and cleared INCs, DEC, and UTCs (MW): January 2005 through March 2016


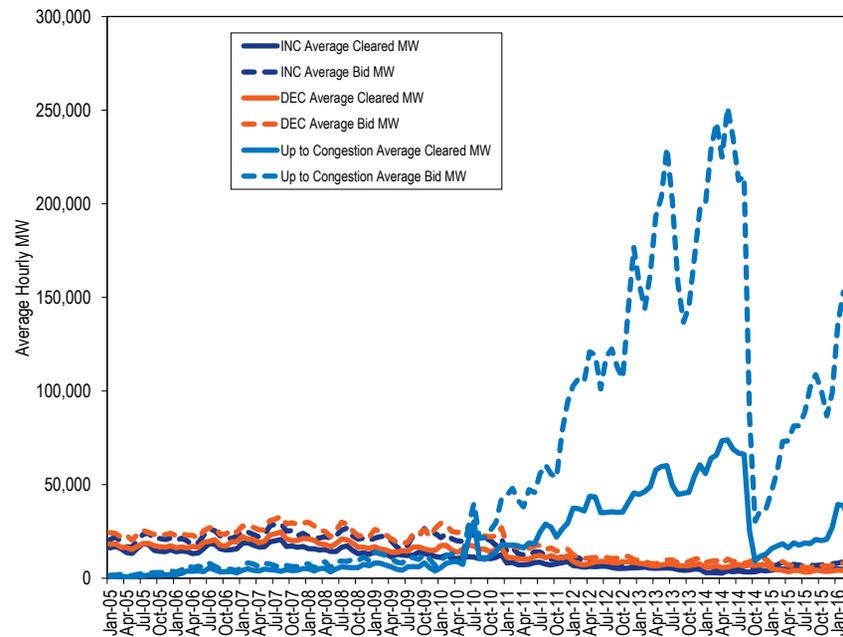


Figure 3-28 shows the daily volume of bid and cleared INC, DEC and up to congestion bids for the period from January 2015 through March 2016.

Figure 3-28 Daily bid and cleared INCs, DEC, and UTCs (MW): 2015 through March 2016

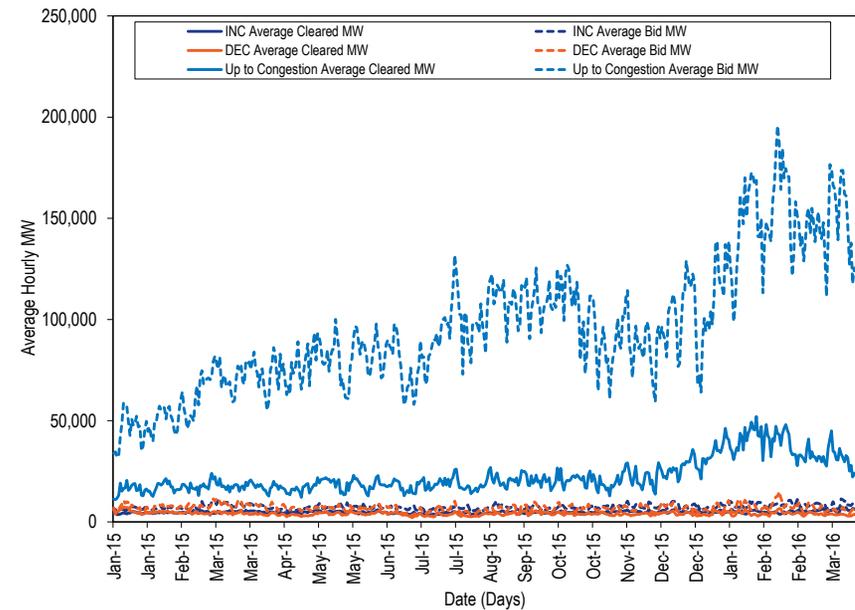

In order to evaluate the ownership of virtual bids, the MMU categorizes all participants making virtual bids in PJM as either physical or financial. Physical entities include utilities and customers which primarily take physical positions in PJM markets. Financial entities include banks and hedge funds which primarily take financial positions in PJM markets. International market participants that primarily take financial positions in PJM markets are generally considered to be financial entities even if they are utilities in their own countries.

Table 3-37 shows, for the first three months of 2015 and 2016, the total increment offers and decrement bids by whether the parent organization is financial or physical.

**Table 3-37 PJM INC and DEC bids by type of parent organization (MW): January through March, 2015 and 2016**

Category	Jan-Mar 2015		Jan-Mar 2016	
	Total Virtual Bids MW	Percent	Total Virtual Bids MW	Percent
Financial	14,180,138	42.9%	18,105,554	52.5%
Physical	18,907,884	57.1%	16,365,988	47.5%
Total	33,088,022	100.0%	34,471,542	100.0%

Table 3-38 shows, for the first three months of 2015 and 2016, the total up to congestion transactions by whether the parent organization is financial or physical.

**Table 3-38 PJM up to congestion transactions by type of parent organization (MW): January through March, 2015 and 2016**

Category	Jan-Mar 2015		Jan-Mar 2016	
	Total Up to Congestion MW	Percent	Total Up to Congestion MW	Percent
Financial	31,266,760	84.3%	71,900,985	89.7%
Physical	5,836,951	15.7%	8,226,179	10.3%
Total	37,103,711	100.0%	80,127,163	100.0%

Table 3-39 shows for the first three months of 2015 and 2016, the total import and export transactions by whether the parent organization is financial or physical.

**Table 3-39 PJM import and export transactions by type of parent organization (MW): January through March, 2015 and 2016**

Category	Jan-Mar 2015		Jan-Mar 2016	
	Total Import and Export MW	Percent	Total Import and Export MW	Percent
Financial	5,805,117	39.8%	3,928,922	34.4%
Physical	8,775,060	60.2%	7,480,995	65.6%
Total	14,580,176	100.0%	11,409,917	100.0%

Table 3-40 shows increment offers and decrement bids bid by top ten locations for the first three months of 2015 and 2016.

Table 3-40 PJM virtual offers and bids by top ten locations (MW): January through March, 2015 and 2016

Jan-Mar 2015					Jan-Mar 2016				
Aggregate/Bus Name	Aggregate/Bus Type	INC MW	DEC MW	Total MW	Aggregate/Bus Name	Aggregate/Bus Type	INC MW	DEC MW	Total MW
WESTERN HUB	HUB	5,067,777	5,641,302	10,709,079	WESTERN HUB	HUB	5,403,807	5,218,719	10,622,527
SOUTHIMP	INTERFACE	2,163,931	0	2,163,931	SOUTHIMP	INTERFACE	1,503,450	0	1,503,450
IMO	INTERFACE	1,445,422	15,158	1,460,581	N ILLINOIS HUB	HUB	189,476	589,534	779,010
N ILLINOIS HUB	HUB	196,550	615,842	812,392	NYIS	INTERFACE	466,833	253,568	720,401
NYIS	INTERFACE	515,715	181,585	697,300	BGE	ZONE	96,804	612,646	709,450
LINDENVFT	INTERFACE	29,307	515,462	544,769	AEP-DAYTON HUB	HUB	321,804	173,426	495,230
ZIMMER2 25 KV ZM1_C	GEN	0	349,217	349,217	IMO	INTERFACE	426,618	1,050	427,668
MISO	INTERFACE	161,558	180,425	341,983	SOUTHEXP	INTERFACE	0	415,678	415,678
DOMINION HUB	HUB	116,586	171,753	288,339	LINDENVFT	INTERFACE	874	380,395	381,269
MIAMIFOR22 KV MI7	GEN	0	270,135	270,135	MISO	INTERFACE	131,637	208,923	340,560
Top ten total		9,696,846	7,940,879	17,637,725			8,541,304	7,853,939	16,395,243
PJM total		16,029,901	17,057,354	33,087,255			18,437,329	16,034,213	34,471,542
Top ten total as percent of PJM total		60.5%	46.6%	53.3%			46.3%	49.0%	47.6%

Table 3-41 shows up to congestion transactions by import bids for the top ten locations for the first three months of 2015 and 2016.<sup>51</sup>

**Table 3-41 PJM cleared up to congestion import bids by top ten source and sink pairs (MW): January through March, 2015 and 2016**

Jan-Mar 2015				
Imports				
Source	Source Type	Sink	Sink Type	MW
SOUTHIMP	INTERFACE	NAGELAEP	EHVAGG	831,465
SOUTHIMP	INTERFACE	WOLF HILLS 1-5	AGGREGATE	192,702
OVEC	INTERFACE	AEP-DAYTON HUB	HUB	189,830
SOUTHEAST	INTERFACE	CLOVER	EHVAGG	124,338
NORTHWEST	INTERFACE	N ILLINOIS HUB	HUB	110,618
MISO	INTERFACE	21 KINCA ATR24304	AGGREGATE	107,410
SOUTHWEST	INTERFACE	NAGELAEP	EHVAGG	84,361
IMO	INTERFACE	RECO	ZONE	81,374
NYIS	INTERFACE	MARION	AGGREGATE	76,900
IMO	INTERFACE	CABOT	EHVAGG	74,568
Top ten total				1,873,565
PJM total				5,080,429
Top ten total as percent of PJM total				36.9%
Jan-Mar 2016				
Imports				
Source	Source Type	Sink	Sink Type	MW
MISO	INTERFACE	COOK	EHVAGG	242,432
HUDSONTP	INTERFACE	LEONIA 230 T-2	AGGREGATE	182,923
OVEC	INTERFACE	CONESVILLE 5	AGGREGATE	180,391
OVEC	INTERFACE	CABOT	EHVAGG	178,741
MISO	INTERFACE	112 WILTON	EHVAGG	171,689
SOUTHWEST	INTERFACE	DUMONT	EHVAGG	150,019
NEPTUNE	INTERFACE	SOUTHTRIV 230	AGGREGATE	146,950
MISO	INTERFACE	CHICAGO GEN HUB	HUB	128,058
OVEC	INTERFACE	COOK	EHVAGG	125,000
NORTHWEST	INTERFACE	POWERTON 5-6	AGGREGATE	118,597
Top ten total				1,624,800
PJM total				8,037,920
Top ten total as percent of PJM total				20.2%

<sup>51</sup> The source and sink aggregates in these tables refer to the name and location of a bus and do not include information about the behavior of any individual market participant.

Table 3-42 shows up to congestion transactions by export bids for the top ten locations for the first three months of 2015 and 2016.

**Table 3-42 PJM cleared up to congestion export bids by top ten source and sink pairs (MW): January through March, 2015 and 2016**

Jan-Mar 2015				
Exports				
Source	Source Type	Sink	Sink Type	MW
MARION	AGGREGATE	HUDSONTP	INTERFACE	74,499
FOWLER RIDGE II WF	AGGREGATE	SOUTHWEST	INTERFACE	69,031
WHIPPANY BK 7	AGGREGATE	NYIS	INTERFACE	57,805
FOWLER RIDGE II WF	AGGREGATE	OVEC	INTERFACE	57,582
SMITHBURG	EHVAGG	NEPTUNE	INTERFACE	46,101
SOUTHTRIV 230	AGGREGATE	NEPTUNE	INTERFACE	41,825
QUAD CITIES 1	AGGREGATE	NORTHWEST	INTERFACE	37,484
BRANCHBURG	EHVAGG	NYIS	INTERFACE	37,401
FOWLER 34.5 KV				
FWLR1AWF	AGGREGATE	OVEC	INTERFACE	36,487
SOMERVIL 230 KV T-2	AGGREGATE	NEPTUNE	INTERFACE	31,981
Top ten total				490,196
PJM total				1,670,287
Top ten total as percent of PJM total				29.3%
Jan-Mar 2016				
Exports				
Source	Source Type	Sink	Sink Type	MW
COMED	ZONE	NIPSCO	INTERFACE	397,071
21 KINCA ATR24304	AGGREGATE	NIPSCO	INTERFACE	269,188
SULLIVAN-AEP	EHVAGG	OVEC	INTERFACE	267,964
SOMERVIL 230 KV T-2	AGGREGATE	NEPTUNE	INTERFACE	138,665
UNIV PARK 1-6	AGGREGATE	NIPSCO	INTERFACE	131,157
EAST BEND 2	AGGREGATE	SOUTHWEST	INTERFACE	129,678
NAGELAEP	EHVAGG	SOUTHEXP	INTERFACE	127,681
21 KINCA ATR24404	AGGREGATE	SOUTHWEST	INTERFACE	113,339
21 KINCA ATR24304	AGGREGATE	SOUTHWEST	INTERFACE	109,798
MADISON	AGGREGATE	SOUTHWEST	INTERFACE	103,633
Top ten total				1,788,174
PJM total				6,032,764
Top ten total as percent of PJM total				29.6%

Table 3-43 shows up to congestion transactions by wheel bids for the top ten locations for the first three months of 2015 and 2016.

**Table 3-43 PJM cleared up to congestion wheel bids by top ten source and sink pairs (MW): January through March, 2015 and 2016**

Jan-Mar 2015				
Wheels				
Source	Source Type	Sink	Sink Type	MW
MISO	INTERFACE	NORTHWEST	INTERFACE	100,683
IMO	INTERFACE	NYIS	INTERFACE	33,480
MISO	INTERFACE	NIPSCO	INTERFACE	15,980
SOUTHWEST	INTERFACE	SOUTHEXP	INTERFACE	13,294
NYIS	INTERFACE	HUDSONTP	INTERFACE	13,229
SOUTHEAST	INTERFACE	SOUTHEXP	INTERFACE	7,781
NORTHWEST	INTERFACE	MISO	INTERFACE	6,924
NYIS	INTERFACE	IMO	INTERFACE	5,804
SOUTHIMP	INTERFACE	MISO	INTERFACE	4,710
SOUTHIMP	INTERFACE	IMO	INTERFACE	4,287
Top ten total				206,173
PJM total				236,931
Top ten total as percent of PJM total				87.0%
Jan-Mar 2016				
Wheels				
Source	Source Type	Sink	Sink Type	MW
NORTHWEST	INTERFACE	MISO	INTERFACE	139,843
MISO	INTERFACE	NIPSCO	INTERFACE	133,330
SOUTHWEST	INTERFACE	SOUTHEXP	INTERFACE	74,640
NYIS	INTERFACE	IMO	INTERFACE	64,680
MISO	INTERFACE	NORTHWEST	INTERFACE	56,606
IMO	INTERFACE	NYIS	INTERFACE	53,799
SOUTHWEST	INTERFACE	NIPSCO	INTERFACE	41,078
HUDSONTP	INTERFACE	NYIS	INTERFACE	23,450
MISO	INTERFACE	SOUTHEXP	INTERFACE	21,489
IMO	INTERFACE	MISO	INTERFACE	21,422
Top ten total				630,337
PJM total				717,476
Top ten total as percent of PJM total				87.9%

On November 1, 2012, PJM eliminated the requirement for market participants to specify an interface pricing point as either the source or sink of an up to congestion transaction. The top ten internal up to congestion transaction locations were 6.0 percent of the PJM total internal up to congestion transactions in the first three months of 2016.

Table 3-44 shows up to congestion transactions by internal bids for the top ten locations for the first three months of 2015 and 2016.

**Table 3-44 PJM cleared up to congestion internal bids by top ten source and sink pairs (MW): January through March, 2015 and 2016**

Jan-Mar 2015				
Internal				
Source	Source Type	Sink	Sink Type	MW
BERGEN 2CC	AGGREGATE	LEONIA 230 T-1	AGGREGATE	744,646
JEFFERSON	EHVAGG	COOK	EHVAGG	457,524
BELMONT	EHVAGG	PLEASANTS	EHVAGG	348,369
VALLEY	EHVAGG	DOOMS	EHVAGG	338,582
BYRON 1	AGGREGATE	ROCKFORD	AGGREGATE	299,122
AEP-DAYTON HUB	HUB	N ILLINOIS HUB	HUB	289,981
RONCO	EHVAGG	HATFIELD	EHVAGG	247,144
ROCKPORT	EHVAGG	JEFFERSON	EHVAGG	245,298
167 PLANO	EHVAGG	112 WILTON	EHVAGG	236,206
PSEG	ZONE	WESTERN HUB	HUB	224,035
Top ten total				3,430,906
PJM total				30,116,064
Top ten total as percent of PJM total				11.4%
Jan-Mar 2016				
Internal				
Source	Source Type	Sink	Sink Type	MW
112 WILTON	EHVAGG	DUMONT	EHVAGG	586,362
BERGEN 2CC	AGGREGATE	LEONIA 230 T-1	AGGREGATE	576,605
21 KINCA ATR24404	AGGREGATE	MICHFE	AGGREGATE	507,970
ROCKPORT	EHVAGG	JEFFERSON	EHVAGG	410,366
21 KINCA ATR24404	AGGREGATE	DUMONT - OLIVE	AGGREGATE	359,025
21 KINCA ATR24304	AGGREGATE	DUMONT - OLIVE	AGGREGATE	337,626
WHIPPANY BK 7	AGGREGATE	TRAYNOR	AGGREGATE	336,485
MOUNTAINEER	EHVAGG	COOK	EHVAGG	269,624
JEFFERSON	EHVAGG	COOK	EHVAGG	256,334
BLACKOAK	EHVAGG	BEDINGTON	EHVAGG	251,293
Top ten total				3,891,689
PJM total				65,339,002
Top ten total as percent of PJM total				6.0%

Table 3-45 shows the number of source-sink pairs that were offered and cleared monthly in January 2013 through March 2016. The annual row in Table 3-45 is the average hourly number of offered and cleared source-sink pairs for the year for the average columns and the maximum hourly number of offered and cleared source-sink pairs for the year for the maximum columns. The increase in average offered and cleared source-sink pairs beginning in January 2013 and continuing through the first eight months of 2014 illustrates that PJM's modification of the rules governing the location of up to congestion transactions bids resulted in a significant increase in the number of offered and cleared up to congestion transactions. The subsequent reduction in up to congestion transactions (UTC) that followed a FERC order setting September 8, 2014, as the effective date for any uplift charges subsequently assigned to UTCs, was reversed. There was an increase in up to congestion volume as a result of the expiration of the fifteen month resettlement period for the proceeding related to uplift charges for UTC transactions in mid December 2015.<sup>52</sup>

<sup>52</sup> See 148 FERC ¶ 61,144 (2014).

**Table 3-45 Number of PJM offered and cleared source and sink pairs: January 2013 through March 2016**

Year	Month	Daily Number of Source-Sink Pairs			
		Average Offered	Max Offered	Average Cleared	Max Cleared
2013	Jan	6,580	10,548	3,291	5,060
2013	Feb	4,891	7,415	2,755	3,907
2013	Mar	4,858	7,446	2,868	4,262
2013	Apr	6,426	9,064	3,464	4,827
2013	May	5,729	7,914	3,350	4,495
2013	Jun	6,014	8,437	3,490	4,775
2013	Jul	5,955	9,006	3,242	4,938
2013	Aug	6,215	9,751	3,642	5,117
2013	Sep	3,496	4,222	2,510	3,082
2013	Oct	4,743	7,134	3,235	4,721
2013	Nov	8,605	14,065	5,419	8,069
2013	Dec	8,346	11,728	6,107	7,415
2013	Annual	5,996	14,065	3,620	8,069
2014	Jan	7,977	11,191	5,179	7,714
2014	Feb	10,087	11,688	7,173	8,463
2014	Mar	11,360	14,745	7,284	9,943
2014	Apr	11,487	14,106	8,589	10,253
2014	May	11,215	13,477	7,734	9,532
2014	Jun	10,613	14,112	7,374	10,143
2014	Jul	10,057	12,304	7,202	8,486
2014	Aug	10,877	12,863	7,609	9,254
2014	Sep	5,618	11,269	4,281	8,743
2014	Oct	2,871	4,092	1,972	2,506
2014	Nov	2,463	3,988	1,812	3,163
2014	Dec	2,803	3,672	2,197	2,786
2014	Annual	8,109	10,614	5,690	7,570
2015	Jan	3,337	5,422	2,263	3,270
2015	Feb	4,600	7,041	2,775	4,147
2015	Mar	4,061	5,799	2,625	3,244
2015	Apr	3,777	6,967	2,343	3,378
2015	May	4,025	5,513	2,587	3,587
2015	Jun	3,852	5,967	2,781	3,748
2015	Jul	3,957	5,225	2,786	4,044
2015	Aug	4,996	6,143	3,702	4,378
2015	Sep	5,775	7,439	4,222	5,462
2015	Oct	6,000	7,414	4,221	5,397
2015	Nov	5,846	7,148	4,494	5,842
2015	Dec	7,097	8,250	5,709	6,610
2015	Annual	4,259	6,152	2,897	3,912
2016	Jan	7,714	8,793	6,174	7,374
2016	Feb	9,200	11,172	7,203	7,957
2016	Mar	8,826	11,572	6,338	8,126
2016	Annual	8,580	10,512	6,572	7,819


Table 3-46 and Figure 3-29 show total cleared up to congestion transactions by type for the first three months of 2015 and 2016. Internal up to congestion transactions in the first three months of 2016 were 81.5 percent of all up to congestion transactions compared to 81.2 percent in the first three months of 2015.

**Table 3-46 PJM cleared up to congestion transactions by type (MW): January through March, 2015 and 2016**

Jan-Mar 2015					
Cleared Up to Congestion Bids					
	Import	Export	Wheel	Internal	Total
Top ten total (MW)	1,873,565	490,196	206,173	3,430,906	6,000,840
PJM total (MW)	5,080,429	1,670,287	236,931	30,116,064	37,103,711
Top ten total as percent of PJM total	36.9%	29.3%	87.0%	11.4%	16.2%
PJM total as percent of all up-to congestion transactions	13.7%	4.5%	0.6%	81.2%	100.0%
Jan-Mar 2016					
Cleared Up to Congestion Bids					
	Import	Export	Wheel	Internal	Total
Top ten total (MW)	1,624,800	1,788,174	630,337	3,891,689	7,935,000
PJM total (MW)	8,037,920	6,032,764	717,476	65,339,002	80,127,162
Top ten total as percent of PJM total	20.2%	29.6%	87.9%	6.0%	9.9%
PJM total as percent of all up-to congestion transactions	10.0%	7.5%	0.9%	81.5%	100.0%

Figure 3-29 shows the initial increase and continued increase in internal up to congestion transactions by month following the November 1, 2012 rule change permitting such transactions, until September 8, 2014. The reduction in up to congestion transactions (UTC) that followed a FERC order setting September 8, 2014, as the effective date for any uplift charges subsequently assigned to UTCs, was reversed. There was an increase in up to congestion volume as a result of the expiration of the fifteen month resettlement period for the proceeding related to uplift charges for UTC transactions.<sup>53</sup>


**Figure 3-29 PJM monthly cleared up to congestion transactions by type (MW): January 2005 through March 2016**

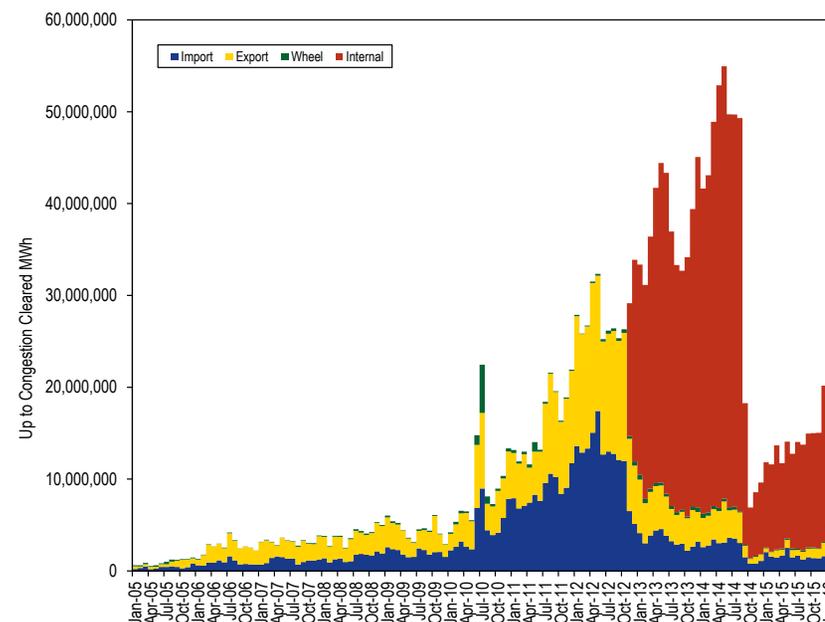

<sup>53</sup> See 148 FERC ¶ 61,144 (2014).

Figure 3-30 shows the daily cleared up to congestion MW by transaction type for the period from January 2015 through March 2016.

**Figure 3-30 PJM daily cleared up to congestion transaction by type (MW): January 2015 through March 2016**

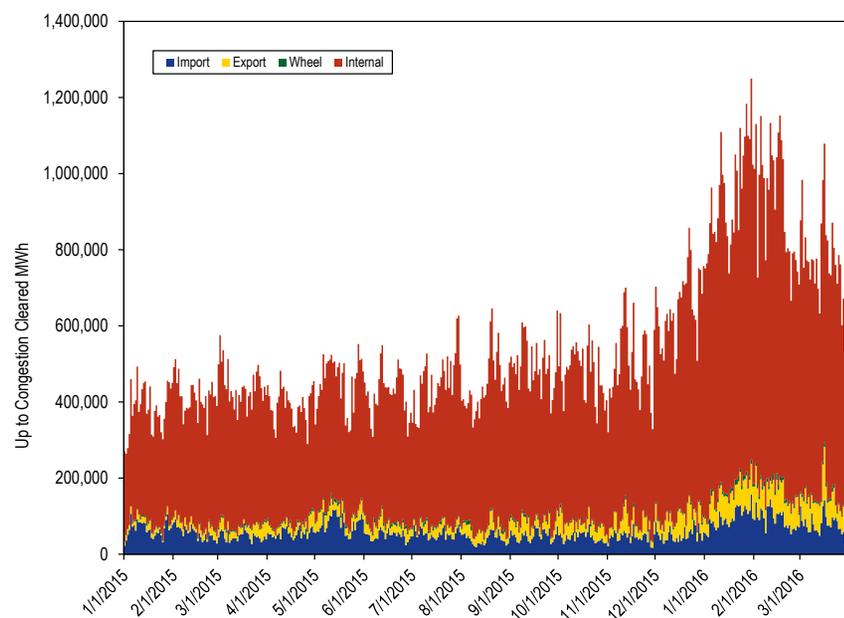

### Generator Offers

Generator offers are categorized as dispatchable (Table 3-47) or self scheduled (Table 3-48).<sup>54</sup> Units which are available for economic dispatch are dispatchable. Units which are self scheduled to generate fixed output are self scheduled and must run. Units which are self scheduled at their economic minimum and are available for economic dispatch up to their economic maximum are self scheduled and dispatchable. Table 3-47 and Table 3-48 do not include units that did not indicate their offer status and units that were offered as available to run only during emergency events. The MW offered beyond the economic

<sup>54</sup> Each range in the tables is greater than or equal to the lower value and less than the higher value. The unit type battery is not included in these tables because batteries do not make energy offers. The unit type fuel cell is not included in these tables because of the small number owners and the small number of units of this type of generation.

range of a unit are categorized as emergency MW. The emergency MW are included in both tables.

Table 3-47 shows the proportion of MW offers by dispatchable units, by unit type and by offer price range, for the first three months of 2016. For example, 76.6 percent of CC offers were dispatchable and in the \$0 to \$200 per MWh price range. The total column is the proportion of all MW offers by unit type that were dispatchable. For example, 83.8 percent of all CC MW offers were dispatchable, including the 6.5 percent of emergency MW offered by CC units. The all dispatchable offers row is the proportion of MW that were offered as available for economic dispatch within a given range by all unit types. For example, 50.0 percent of all dispatchable offers were in the \$0 to \$200 per MWh price range. The total column in the all dispatchable offers row is the proportion of all MW offers that were offered as available for economic dispatch, including emergency MW. Among all the generator offers in the first three months of 2016, 54.0 percent were offered as available for economic dispatch.

**Table 3-47 Distribution of MW for dispatchable unit offer prices: January through March, 2016**

Unit Type	Dispatchable (Range)						Emergency	Total
	(\$200) - \$0	\$0 - \$200	\$200 - \$400	\$400 - \$600	\$600 - \$800	\$800 - \$1,000		
CC	0.0%	76.6%	0.4%	0.3%	0.0%	0.0%	6.5%	83.8%
CT	0.0%	82.7%	3.9%	0.2%	0.8%	0.0%	11.5%	99.1%
Diesel	3.4%	32.6%	16.4%	6.0%	0.0%	0.0%	18.5%	76.9%
Fuel Cell	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Nuclear	0.0%	6.4%	0.0%	0.0%	0.0%	0.0%	0.1%	6.5%
Pumped Storage	64.5%	0.1%	0.0%	0.0%	0.0%	0.0%	2.4%	67.1%
Run of River	0.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.1%
Solar	30.3%	5.6%	0.0%	0.0%	0.0%	0.0%	4.3%	40.2%
Steam	0.1%	50.4%	0.7%	0.0%	0.0%	0.0%	2.8%	54.1%
Transaction	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Wind	50.5%	10.3%	0.0%	0.0%	0.0%	0.0%	0.5%	61.3%
All Dispatchable Offers	2.6%	50.0%	1.1%	0.1%	0.2%	0.0%	4.6%	58.6%

**Table 3-48 Distribution of MW for self scheduled offer prices: January through March, 2016**

Unit Type	Self Scheduled		Self Scheduled and Dispatchable (Range)							Total
	Must Run	Emergency	(\$200 - \$0	\$0 - \$200	\$200 - \$400	\$400 - \$600	\$600 - \$800	\$800 - \$1,000	Emergency	
CC	3.5%	1.6%	0.3%	9.9%	0.1%	0.0%	0.0%	0.0%	0.9%	16.2%
CT	0.5%	0.1%	0.0%	0.2%	0.1%	0.0%	0.0%	0.0%	0.0%	0.9%
Diesel	19.2%	0.9%	1.1%	1.3%	0.0%	0.0%	0.0%	0.0%	0.6%	23.1%
Fuel Cell	100.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	100.0%
Nuclear	91.2%	0.9%	1.3%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	93.5%
Pumped Storage	19.2%	6.8%	2.9%	0.0%	0.0%	0.0%	0.0%	0.0%	4.0%	32.9%
Run of River	59.9%	12.2%	0.2%	19.0%	0.0%	0.0%	0.0%	1.3%	7.3%	99.9%
Solar	45.3%	13.5%	0.9%	0.1%	0.0%	0.0%	0.0%	0.0%	0.0%	59.8%
Steam	5.2%	1.7%	0.1%	36.3%	0.0%	0.0%	0.0%	0.0%	2.5%	45.9%
Transaction	77.3%	22.7%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	100.0%
Wind	4.4%	3.9%	24.0%	2.8%	0.0%	0.0%	0.0%	0.0%	3.6%	38.7%
All Self-Scheduled Offers	22.1%	1.5%	0.9%	15.4%	0.0%	0.0%	0.0%	0.0%	1.4%	41.4%

Table 3-48 shows the proportion of MW offers by unit type that were self scheduled to generate fixed output and by unit type and price range for self-scheduled and dispatchable units, for the first three months of 2016. For example, 9.9 percent of CC offers were self scheduled and dispatchable and in the \$0 to \$200 price range. The total column is the proportion of all MW offers by unit type that were self scheduled to generate fixed output and are self scheduled and dispatchable. For example, 16.2 percent of all CC MW offers were either self scheduled to generate at fixed output or self scheduled to generate at economic minimum and dispatchable up to economic maximum, including the 2.9 percent of emergency MW offered by CC units. The all self scheduled offers row is the proportion of MW that were offered as either self scheduled to generate at fixed output or self scheduled to generate at economic minimum and dispatchable up to economic maximum within a given range by all unit types. For example, units that were self scheduled to generate at fixed output accounted for 22.1 percent of all offers and self scheduled and dispatchable units accounted for 16.3 percent of all offers. The total column in the all self scheduled offers row is the proportion of all MW offers that were either self scheduled to generate at fixed output or self scheduled to generate at economic minimum and dispatchable up to economic maximum, including emergency MW. Among all the generator offers in the

first three months of 2016, 23.7 percent were offered as self scheduled and 17.7 percent were offered as self scheduled and dispatchable.

## Market Performance

The PJM average locational marginal price (LMP) reflects the configuration of the entire RTO. The PJM energy market includes the Real-Time Energy Market and the Day-Ahead Energy Market.

## Markup

The markup index, which is a measure of participant conduct for individual marginal units, does not measure the impact of participant behavior on market prices. As an example, if unit

A has a \$90 cost and a \$100 price, while unit B has a \$9 cost and a \$10 price, both would show a markup of 10 percent, but the price impact of unit A's markup at the generator bus would be \$10 while the price impact of unit B's markup at the generator bus would be \$1. Depending on each unit's location on the transmission system, those bus-level impacts could also translate to different impacts on total system price.

The MMU calculates the impact on system prices of marginal unit price-cost markup, based on analysis using sensitivity factors. The calculation shows the markup component of price-based on a comparison between the price-based offer and the cost-based offer of each actual marginal unit on the system.<sup>55</sup>

The price impact of markup must be interpreted carefully. The markup calculation is not based on a full redispatch of the system to determine the marginal units and their marginal costs that would have occurred if all units had made all offers at short run marginal cost. Thus the results do not reflect a counterfactual market outcome based on the assumption that all units made all offers at short run marginal cost. It is important to note that a full redispatch analysis is practically impossible and a limited redispatch analysis would not

<sup>55</sup> This is the same method used to calculate the fuel cost adjusted LMP and the components of LMP.

be dispositive. Nonetheless, such a hypothetical counterfactual analysis would reveal the extent to which the actual system dispatch is less than competitive if it showed a difference between dispatch based on short run marginal cost and actual dispatch. It is possible that the unit-specific markup, based on a redispatch analysis, would be lower than the markup component of price if the reference point were an inframarginal unit with a lower price and a higher cost than the actual marginal unit. If the actual marginal unit has short run marginal costs that would cause it to be inframarginal, a new unit would be marginal. If the offer of that new unit were greater than the cost of the original marginal unit, the markup impact would be lower than the MMU measure. If the newly marginal unit is on a price-based schedule, the analysis would have to capture the markup impact of that unit as well.

The MMU calculated an explicit measure of the impact of marginal unit markups on LMP. The markup impact includes the impact of the identified markup conduct on a unit by unit basis, but the inclusion of negative markup impacts has an offsetting effect. The markup analysis does not distinguish between intervals in which a unit has local market power or has a price impact in an unconstrained interval. The markup analysis is a more general measure of the competitiveness of the energy market.

## Real-Time Markup

### Markup Component of Real-Time Price by Fuel, Unit Type

The markup component of price is the difference between the system price, when the system price is determined by the active offers of the marginal units, whether price or cost-based, and the system price, based on the cost-based offers of those marginal units.

Table 3-49 shows the average unit markup component of LMP for marginal units, by unit type and primary fuel. The markup component of LMP is a measure of the impact of the markups of marginal units shown in Table 3-49 on the system-wide load-weighted LMP. The negative markup components of LMP reflect the negative markups shown in the Table 3-28.

All generating units, including coal units, are allowed to include a 10 percent adder in their cost offer. The 10 percent adder was included in the definition of cost offers prior to the implementation of PJM markets in 1999, based on the uncertainty of calculating the hourly operating costs of CTs under changing ambient conditions. Coal units do not face the same cost uncertainty as gas-fired CTs. A review of actual participant behavior supports this view, as the owners of coal units, facing competition, typically exclude the 10 percent adder from their actual offers. The unadjusted markup is calculated as the difference between the price offer and the cost offer including the 10 percent adder in the cost offer. The adjusted markup is calculated as the difference between the price offer and the cost offer excluding the 10 percent adder from the cost offer. Even the adjusted markup underestimates the markup because coal units facing increased competitive pressure have excluded both the ten percent adder and some or all components of operating and maintenance cost. While both these elements are permitted under the definition of cost-based offers in the relevant PJM manual, they are not part of a competitive offer for a coal unit because they are not actually short run marginal costs, and market behavior reflected that fact.<sup>56</sup>

In order to accurately assess the markup behavior of market participants, real-time and day-ahead LMPs are decomposed using two different approaches. In the first approach, markup is the difference between the active offer of the marginal unit and the cost offer. In the second approach, the 10 percent markup is removed from the cost offers of coal units because coal units do not face the same cost uncertainty as gas fired CTs. The adjusted markup is calculated as the difference between the active offer and the cost offer excluding the 10 percent adder. The unadjusted markup is calculated as the difference between the active offer and the cost offer including the 10 percent adder in the cost offer.

Table 3-49 shows the mark-up component of the load-weighted LMP by fuel type and unit type using unadjusted and adjusted offers. The adjusted markup component of LMP decreased from \$3.54 in the first three months of 2015 to \$0.46 in the first three months of 2016. The adjusted markup contribution of

<sup>56</sup> See PJM, "Manual 15: Cost Development Guidelines," Revision 26 (November 5, 2014).

coal units in 2016 was -\$0.71. The adjusted mark-up component of all gas-fired units in the first three months of 2016 was \$1.20, an increase of \$0.74 from the first three months of 2015. Coal units accounted for 61.98 percent of the decrease in the markup component of LMP in the first three months of 2016. The markup component of wind units was \$0.02. If a price-based offer is negative, but less negative than a cost-based offer, the markup is positive. In the first three months of 2016, among the wind units that were marginal, 2.34 percent had positive offer prices.

**Table 3-49 Markup component of the overall PJM real-time, load-weighted, average LMP by primary fuel type and unit type: January through March, 2015 and 2016<sup>57</sup>**

		2015 (Jan-Mar)		2016 (Jan-Mar)	
Fuel Type	Unit Type	Markup Component of LMP (Unadjusted)	Markup Component of LMP (Adjusted)	Markup Component of LMP (Unadjusted)	Markup Component of LMP (Adjusted)
Coal	Steam	(\$0.71)	\$1.20	(\$2.23)	(\$0.71)
Gas	CC	\$1.79	\$1.79	\$0.95	\$0.95
Gas	CT	\$0.15	\$0.15	\$0.10	\$0.10
Gas	Diesel	\$0.00	\$0.00	\$0.00	\$0.00
Gas	Steam	(\$0.00)	(\$0.00)	\$0.15	\$0.15
Municipal Waste	Steam	(\$0.01)	(\$0.01)	\$0.00	\$0.00
Oil	CC	\$0.17	\$0.17	(\$0.00)	(\$0.00)
Oil	CT	\$0.11	\$0.11	\$0.02	\$0.02
Oil	Diesel	\$0.01	\$0.01	\$0.00	\$0.00
Oil	Steam	\$0.08	\$0.08	\$0.00	\$0.00
Other	Steam	(\$0.02)	(\$0.02)	(\$0.07)	(\$0.07)
Uranium	Steam	\$0.00	\$0.00	\$0.00	\$0.00
Wind	Wind	\$0.07	\$0.07	\$0.02	\$0.02
Total		\$1.63	\$3.54	(\$1.06)	\$0.46

### Markup Component of Real-Time Price

Table 3-50 shows the markup component, calculated using unadjusted offers, of average prices and of average monthly on-peak and off-peak prices. Table 3-51 shows the markup component, calculated using adjusted offers, of average prices and of average monthly on-peak and off-peak prices. In the first three months of 2016, when using unadjusted cost offers, -\$1.06 per MWh of the PJM real-time load-weighted average LMP was attributable

<sup>57</sup> The Unit Type Diesel refers to power generation using reciprocating internal combustion engines. Such Diesel units can use a variety of fuel types including diesel, natural gas, oil and gas from municipal waste.

to markup. Using adjusted cost offers, \$0.46 per MWh of the PJM real-time load-weighted average LMP was attributable to markup. In the first three months of 2016, the peak markup component was highest in March, \$0.42 per MWh using unadjusted cost offers and \$1.82 per MWh using adjusted cost offers. This corresponds to 1.71 percent and 7.44 percent of the real time load-weighted average LMP in March.

**Table 3-50 Monthly markup components of real-time load-weighted LMP (Unadjusted): January through March, 2015 and 2016**

	2015			2016		
	Markup Component (All Hours)	Off Peak Markup Component	Peak Markup Component	Markup Component (All Hours)	Off Peak Markup Component	Peak Markup Component
Jan	(\$1.42)	(\$2.62)	(\$0.15)	(\$1.66)	(\$1.58)	(\$1.75)
Feb	\$4.62	\$1.72	\$7.46	(\$1.06)	(\$0.84)	(\$1.26)
Mar	\$1.84	\$1.82	\$1.86	(\$0.35)	(\$1.22)	\$0.42
Total	\$1.63	\$0.19	\$3.08	(\$1.06)	(\$1.24)	(\$0.89)


**Table 3-51 Monthly markup components of real-time load-weighted LMP (Adjusted): January through March, 2015 and 2016**

	2015			2016		
	Markup Component (All Hours)	Off Peak Markup Component	Peak Markup Component	Markup Component (All Hours)	Off Peak Markup Component	Peak Markup Component
Jan	\$0.61	(\$0.61)	\$1.90	(\$0.02)	(\$0.14)	\$0.12
Feb	\$6.44	\$3.57	\$9.24	\$0.53	\$0.58	\$0.48
Mar	\$3.71	\$3.69	\$3.74	\$0.97	\$0.01	\$1.82
Total	\$3.54	\$2.10	\$4.98	\$0.46	\$0.13	\$0.78


### Hourly Markup Component of Real-Time Prices

Figure 3-31 shows the markup contribution to the hourly load-weighted LMP using unadjusted cost offers for the first three months of 2016 and 2015. Figure 3-32 shows the markup contribution to the hourly load-weighted LMP using adjusted cost offers for the first three months of 2016 and 2015. In 2015, high markups were seen during the cold winter days observed in February and March. In contrast, the first three months of 2016 had low markups.

**Figure 3-31 Markup contribution to real-time hourly load-weighted LMP (Unadjusted): January through March, 2015 and 2016**

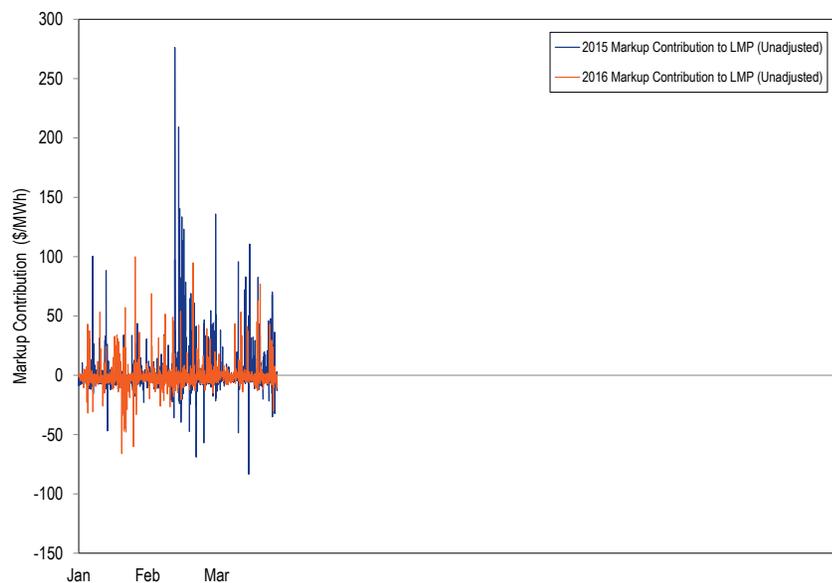

**Figure 3-32 Markup contribution to real-time hourly load-weighted LMP (Adjusted): January through March, 2015 and 2016**

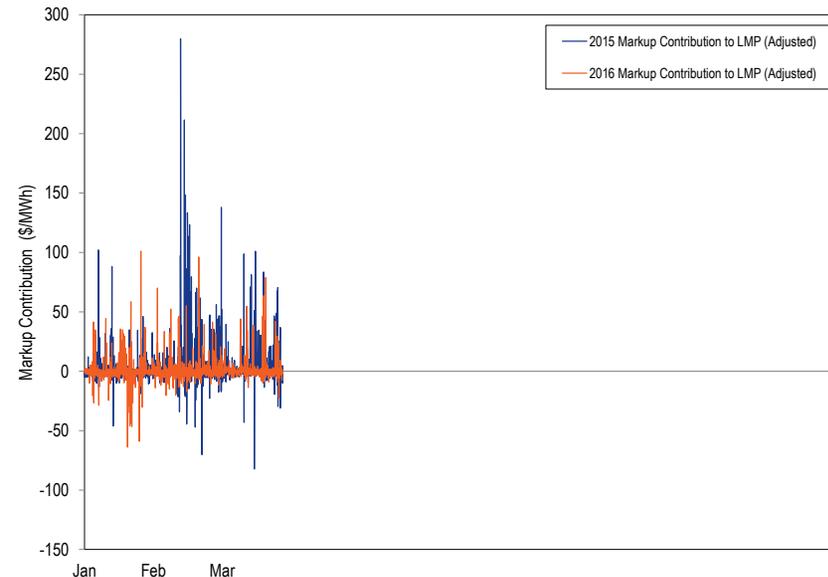

### Markup Component of Real-Time Zonal Prices

The unit markup component of average real-time price using unadjusted offers is shown for each zone for the first three months of 2015 and the first three months of 2016 in Table 3-52 and for adjusted offers in Table 3-53. The smallest zonal all hours average markup component using unadjusted offers for the first three months of 2016 was in the BGE Zone, -\$2.10 per MWh, while the highest was in the PECO Control Zone, \$0.12 per MWh. The smallest zonal on peak average markup was in the BGE Control Zone, -\$1.96 per MWh, while the highest was in the PECO Control Zone, \$0.48 per MWh.

Table 3-52 Average real-time zonal markup component (Unadjusted): January through March, 2015 and 2016

	2015 (Jan-Mar)			2016 (Jan-Mar)		
	Markup Component (All Hours)	Off Peak Markup Component	Peak Markup Component	Markup Component (All Hours)	Off Peak Markup Component	Peak Markup Component
AECO	\$1.60	\$0.38	\$2.84	\$0.01	(\$0.38)	\$0.41
AEP	\$0.73	(\$0.98)	\$2.48	(\$1.29)	(\$1.54)	(\$1.04)
APS	\$2.40	\$0.96	\$3.88	(\$1.28)	(\$1.48)	(\$1.08)
ATSI	\$0.97	(\$0.64)	\$2.55	(\$1.44)	(\$1.75)	(\$1.14)
BGE	\$2.72	\$1.69	\$3.79	(\$2.10)	(\$2.23)	(\$1.96)
ComEd	\$1.29	(\$0.51)	\$3.02	(\$1.21)	(\$1.23)	(\$1.19)
DAY	\$0.87	(\$1.01)	\$2.70	(\$1.70)	(\$1.71)	(\$1.69)
DEOK	\$0.93	(\$1.18)	\$3.03	(\$1.53)	(\$1.61)	(\$1.45)
DLCO	\$0.38	(\$0.81)	\$1.54	(\$1.32)	(\$1.72)	(\$0.94)
DPL	\$2.09	\$0.72	\$3.53	(\$0.08)	(\$0.52)	\$0.36
Dominion	\$2.22	\$1.60	\$2.88	(\$1.40)	(\$1.39)	(\$1.40)
EKPC	\$1.16	(\$1.18)	\$3.69	(\$1.50)	(\$1.24)	(\$1.78)
JCPL	\$1.30	\$0.21	\$2.36	(\$0.10)	(\$0.23)	\$0.03
Met-Ed	\$1.41	\$0.36	\$2.45	(\$0.13)	(\$0.44)	\$0.17
PECO	\$1.50	\$0.45	\$2.54	\$0.12	(\$0.25)	\$0.48
PENELEC	\$2.31	\$0.60	\$3.98	(\$0.83)	(\$1.13)	(\$0.55)
PPL	\$2.20	\$0.62	\$3.80	(\$0.04)	(\$0.42)	\$0.33
PSEG	\$2.99	\$1.04	\$4.87	(\$0.12)	(\$0.17)	(\$0.07)
Pepco	\$2.52	\$1.55	\$3.49	(\$1.68)	(\$1.76)	(\$1.61)
RECO	\$4.18	\$0.73	\$7.34	(\$0.14)	(\$0.49)	\$0.18

Table 3-53 Average real-time zonal markup component (Adjusted): January through March, 2015 and 2016

	2015 (Jan-Mar)			2016 (Jan-Mar)		
	Markup Component (All Hours)	Off Peak Markup Component	Peak Markup Component	Markup Component (All Hours)	Off Peak Markup Component	Peak Markup Component
AECO	\$3.33	\$2.16	\$4.52	\$0.73	\$0.31	\$1.15
AEP	\$2.70	\$0.95	\$4.48	\$0.37	(\$0.04)	\$0.79
APS	\$4.31	\$2.90	\$5.76	\$0.41	\$0.06	\$0.77
ATSI	\$3.09	\$1.42	\$4.72	\$0.18	(\$0.27)	\$0.60
BGE	\$4.76	\$3.75	\$5.80	\$0.75	\$0.29	\$1.21
ComEd	\$3.13	\$1.30	\$4.88	\$0.25	\$0.02	\$0.47
DAY	\$2.93	\$0.98	\$4.82	\$0.03	(\$0.16)	\$0.21
DEOK	\$2.92	\$0.74	\$5.09	\$0.16	(\$0.11)	\$0.42
DLCO	\$2.43	\$1.19	\$3.64	\$0.24	(\$0.27)	\$0.74
DPL	\$3.89	\$2.62	\$5.22	\$0.64	\$0.23	\$1.07
Dominion	\$4.17	\$3.60	\$4.77	\$0.62	\$0.37	\$0.88
EKPC	\$3.06	\$0.74	\$5.58	\$0.28	\$0.30	\$0.25
JCPL	\$2.90	\$1.88	\$3.89	\$0.63	\$0.45	\$0.80
Met-Ed	\$3.11	\$2.11	\$4.11	\$0.61	\$0.23	\$0.97
PECO	\$3.15	\$2.20	\$4.10	\$0.79	\$0.41	\$1.15
PENELEC	\$4.33	\$2.58	\$6.04	\$0.45	\$0.08	\$0.81
PPL	\$3.87	\$2.34	\$5.40	\$0.76	\$0.33	\$1.18
PSEG	\$4.89	\$2.93	\$6.80	\$0.62	\$0.50	\$0.74
Pepco	\$4.50	\$3.57	\$5.42	\$0.62	\$0.28	\$0.95
RECO	\$6.51	\$3.05	\$9.69	\$0.69	\$0.27	\$1.07

## Markup by Real Time Price Levels

Table 3-54 show the average markup component of observed prices, based on the unadjusted cost-based offers and adjusted cost-based offers of the marginal units, when the PJM average LMP was in the identified price range.

**Table 3-54 Average real-time markup component (By price category, unadjusted): January through March, 2015 and 2016**

LMP Category	2015 (Jan-Mar)		2016 (Jan-Mar)	
	Average Markup Component	Frequency	Average Markup Component	Frequency
< \$25	\$1.64	100.0%	(\$1.28)	65.8%
\$25 to \$50	\$0.00	0.0%	(\$0.70)	30.3%
\$50 to \$75	\$0.00	0.0%	\$0.48	2.9%
\$75 to \$100	\$0.00	0.0%	\$0.23	0.6%
\$100 to \$125	\$0.00	0.0%	\$0.06	0.2%
\$125 to \$150	\$0.00	0.0%	\$0.08	0.1%
>= \$150	\$0.00	0.0%	\$0.05	0.1%

**Table 3-55 Average real-time markup component (By price category, adjusted): January through March, 2015 and 2016**

LMP Category	2015 (Jan-Mar)		2016 (Jan-Mar)	
	Average Markup Component	Frequency	Average Markup Component	Frequency
< \$25	\$3.55	100.0%	(\$0.46)	65.8%
\$25 to \$50	\$0.00	0.0%	(\$0.04)	30.3%
\$50 to \$75	\$0.00	0.0%	\$0.53	2.9%
\$75 to \$100	\$0.00	0.0%	\$0.24	0.6%
\$100 to \$125	\$0.00	0.0%	\$0.07	0.2%
\$125 to \$150	\$0.00	0.0%	\$0.09	0.1%
>= \$150	\$0.00	0.0%	\$0.05	0.1%

## Day-Ahead Markup

### Markup Component of Day-Ahead Price by Fuel, Unit Type

The markup component of the PJM day-ahead, load-weighted average LMP by primary fuel and unit type is shown in Table 3-56. INC, DEC and up to congestion transactions have zero markups. Up to congestion transactions were 83.2 percent of marginal resources, INCs were 4.0 percent of marginal

resources, and DECs were 6.9 percent of marginal resources in the first three months of 2016. The share of marginal up to congestion transactions decreased significantly beginning on September 8, 2014, as a result of the FERC's UTC uplift refund notice which became effective on September 8, 2014.<sup>58</sup> The adjusted markup of coal units is calculated as the difference between the price offer, and the cost offer excluding the 10 percent adder. Table 3-56 shows the markup component of LMP for marginal generating resources. Generating resources were only 5.9 percent of marginal resources in the first three months of 2016. The markup component of LMP for marginal generating resources decreased in coal-fired steam units and oil-fired CT units. The markup component of LMP for coal units decreased from \$0.94 in the first three months of 2015 to \$0.52 in the first three months of 2016 using adjusted offers. The markup component of LMP for gas-fired CCs increased from -\$0.39 in the first three months of 2015 to \$0.00 in the first three months of 2016 using adjusted offers.

**Table 3-56 Markup component of the annual PJM day-ahead, load-weighted, average LMP by primary fuel type and unit type: January through March, 2015 and 2016**

Fuel Type	Unit Type	2015 (Jan - Mar)		2016 (Jan - Mar)	
		Markup Component of LMP (Unadjusted)	Markup Component of LMP (Adjusted)	Markup Component of LMP (Unadjusted)	Markup Component of LMP (Adjusted)
Coal	Steam	(\$0.58)	\$0.94	(\$0.61)	\$0.52
Gas	CC	(\$0.39)	(\$0.39)	\$0.00	\$0.00
Gas	CT	\$0.10	\$0.10	\$0.00	\$0.00
Gas	Diesel	\$0.01	\$0.01	\$0.00	\$0.00
Gas	Steam	\$0.08	\$0.08	\$0.43	\$0.43
Municipal Waste	Steam	(\$0.01)	(\$0.01)	\$0.00	\$0.00
Oil	CC	\$0.12	\$0.12	\$0.00	\$0.00
Oil	CT	\$0.06	\$0.06	\$0.00	\$0.00
Oil	Steam	\$0.24	\$0.24	\$0.01	\$0.01
Other	Steam	\$0.00	\$0.00	(\$0.11)	(\$0.11)
Wind	Wind	\$0.00	\$0.00	\$0.02	\$0.02
Total		(\$0.36)	\$1.16	(\$0.26)	\$0.86

<sup>58</sup> See 18 CFR § 385.213 (2014).

### Markup Component of Day-Ahead Price

The markup component of price is the difference between the system price, when the system price is determined by the active offers of the marginal units, whether price or cost-based, and the system price, based on the cost-based offers of those marginal units. Only hours when generating units were marginal on either priced-based offers or on cost-based offers were included in the markup calculation.

Table 3-57 shows the markup component of average prices and of average monthly on-peak and off-peak prices using unadjusted offers. Table 3-58 shows the markup component of average prices and of average monthly on-peak and off-peak prices using adjusted offers. In the first three months of 2016, when using adjusted cost-offers, \$0.86 per MWh of the PJM day-ahead load-weighted average LMP was attributable to markup. In the first three months of 2016, the peak markup component was highest in January, \$2.62 per MWh using adjusted cost offers. Using adjusted cost offers, the markup component in the first three months of 2016 decreased in every month except January from the first three months of 2015. Using adjusted cost offers, the markup component increased from -\$0.29 to \$1.64 in January.

**Table 3-57 Monthly markup components of day-ahead (Unadjusted), load-weighted LMP: January through March, 2015 and 2016**

	2015 (Jan - Mar)			2016 (Jan - Mar)		
	Markup Component (All Hours)	Peak Markup Component	Off-Peak Markup Component	Markup Component (All Hours)	Peak Markup Component	Off-Peak Markup Component
Jan	(\$1.98)	(\$1.27)	(\$2.66)	\$0.39	\$1.45	(\$0.56)
Feb	\$1.39	\$3.35	(\$0.62)	(\$0.20)	(\$0.24)	(\$0.16)
Mar	(\$0.43)	\$0.49	(\$1.38)	(\$1.10)	(\$0.78)	(\$1.47)
Annual	(\$0.36)	\$0.86	(\$1.59)	(\$0.26)	\$0.16	(\$0.69)

**Table 3-58 Monthly markup components of day-ahead (Adjusted), load-weighted LMP: January through March, 2015 and 2016**

	2015 (Jan - Mar)			2016 (Jan - Mar)		
	Markup Component (All Hours)	Peak Markup Component	Off-Peak Markup Component	Markup Component (All Hours)	Peak Markup Component	Off-Peak Markup Component
Jan	(\$0.29)	\$0.21	(\$0.76)	\$1.64	\$2.62	\$0.78
Feb	\$2.81	\$4.51	\$1.06	\$0.90	\$0.94	\$0.85
Mar	\$1.01	\$1.79	\$0.21	(\$0.10)	\$0.21	(\$0.46)
Annual	\$1.16	\$2.18	\$0.14	\$0.86	\$1.28	\$0.45

### Markup Component of Day-Ahead Zonal Prices

The markup component of annual average day-ahead price using unadjusted offers is shown for each zone in Table 3-59. The markup component of annual average day-ahead price using adjusted offers is shown for each zone in Table 3-60. The markup component of the average day-ahead price increased in all zones from the first three months of 2015 to the first three months of 2016 except BGE, DLCO, Dominion, and Pepco control zones. The smallest zonal all hours average markup component using adjusted offers for the first three months of 2016 was in the BGE Zone, \$0.49 per MWh, while the highest was in the DPL Control Zone, \$1.44 per MWh. The smallest zonal on peak average markup was in the BGE Control Zone, \$0.63 per MWh, while the highest was in the PSEG Control Zone, \$2.24 per MWh.

Table 3-59 Day-ahead, average, zonal markup component (Unadjusted): January through March, 2015 and 2016

	2015 (Jan - Mar)			2016 (Jan - Mar)		
	Markup Component (All Hours)	Peak Markup Component	Off-Peak Markup Component	Markup Component (All Hours)	Peak Markup Component	Off-Peak Markup Component
AECO	(\$0.60)	\$0.25	(\$1.45)	\$0.31	\$0.96	(\$0.35)
AEP	(\$0.41)	\$1.03	(\$1.82)	(\$0.35)	(\$0.01)	(\$0.69)
AP	(\$0.39)	\$0.45	(\$1.22)	(\$0.38)	\$0.00	(\$0.76)
ATSI	(\$0.49)	\$1.23	(\$2.28)	(\$0.40)	(\$0.02)	(\$0.79)
BGE	\$0.07	\$1.30	(\$1.14)	(\$0.83)	(\$0.70)	(\$0.95)
ComEd	(\$0.85)	\$0.47	(\$2.25)	(\$0.38)	(\$0.09)	(\$0.68)
DAY	(\$0.61)	\$1.05	(\$2.35)	(\$0.40)	(\$0.03)	(\$0.79)
DEOK	(\$0.55)	\$1.11	(\$2.22)	(\$0.38)	(\$0.00)	(\$0.76)
DLCO	(\$0.18)	\$2.17	(\$2.63)	(\$0.41)	(\$0.05)	(\$0.78)
Dominion	\$0.11	\$0.93	(\$0.66)	(\$0.47)	(\$0.19)	(\$0.74)
DPL	(\$0.51)	\$0.33	(\$1.31)	\$0.53	\$1.16	(\$0.07)
EKPC	(\$0.33)	\$1.29	(\$1.84)	(\$0.30)	\$0.04	(\$0.63)
JCPL	(\$0.63)	\$0.25	(\$1.56)	\$0.32	\$0.77	(\$0.16)
Met-Ed	(\$0.56)	\$0.34	(\$1.49)	\$0.05	\$0.59	(\$0.52)
PECO	(\$0.54)	\$0.34	(\$1.42)	\$0.24	\$0.91	(\$0.46)
PENELEC	(\$0.35)	\$0.92	(\$1.59)	(\$0.29)	\$0.28	(\$0.88)
Pepco	\$0.21	\$1.43	(\$0.99)	(\$0.62)	(\$0.35)	(\$0.90)
PPL	(\$0.29)	\$0.98	(\$1.57)	\$0.19	\$0.81	(\$0.44)
PSEG	(\$0.40)	\$0.53	(\$1.39)	\$0.24	\$1.39	(\$1.00)
RECO	(\$0.31)	\$0.84	(\$1.58)	(\$0.12)	\$0.92	(\$1.27)

Table 3-60 Day-ahead, average, zonal markup component (Adjusted): January through March, 2015 and 2016

	2015 (Jan - Mar)			2016 (Jan - Mar)		
	Markup Component (All Hours)	Peak Markup Component	Off-Peak Markup Component	Markup Component (All Hours)	Peak Markup Component	Off-Peak Markup Component
AECO	\$0.73	\$1.36	\$0.10	\$1.13	\$1.82	\$0.43
AEP	\$1.23	\$2.43	\$0.04	\$0.85	\$1.15	\$0.54
AP	\$1.13	\$1.81	\$0.46	\$0.83	\$1.18	\$0.47
ATSI	\$1.21	\$2.71	(\$0.35)	\$0.81	\$1.14	\$0.47
BGE	\$1.63	\$2.67	\$0.62	\$0.49	\$0.63	\$0.36
ComEd	\$0.86	\$2.01	(\$0.34)	\$0.75	\$1.02	\$0.46
DAY	\$1.07	\$2.50	(\$0.42)	\$0.84	\$1.17	\$0.50
DEOK	\$1.08	\$2.52	(\$0.36)	\$0.83	\$1.16	\$0.50
DLCO	\$1.55	\$3.68	(\$0.67)	\$0.78	\$1.09	\$0.45
Dominion	\$1.58	\$2.21	\$0.97	\$0.76	\$1.07	\$0.45
DPL	\$0.73	\$1.31	\$0.16	\$1.44	\$2.06	\$0.84
EKPC	\$1.27	\$2.63	(\$0.00)	\$0.88	\$1.14	\$0.64
JCPL	\$0.70	\$1.36	(\$0.01)	\$1.23	\$1.70	\$0.72
Met-Ed	\$0.74	\$1.44	\$0.03	\$0.97	\$1.56	\$0.36
PECO	\$0.74	\$1.41	\$0.06	\$1.12	\$1.79	\$0.42
PENELEC	\$1.11	\$2.11	\$0.11	\$0.81	\$1.36	\$0.24
Pepco	\$1.75	\$2.83	\$0.69	\$0.64	\$0.94	\$0.34
PPL	\$1.01	\$2.07	(\$0.07)	\$1.10	\$1.73	\$0.44
PSEG	\$0.85	\$1.56	\$0.10	\$1.12	\$2.24	(\$0.08)
RECO	\$0.98	\$1.92	(\$0.07)	\$0.76	\$1.78	(\$0.36)

## Markup by Day-Ahead Price Levels

Table 3-61 and Table 3-62 show the average markup component of observed prices, based on the unadjusted cost-based offers and adjusted cost-based offers of the marginal units, when the PJM system LMP was in the identified price range.

**Table 3-61 Average, day-ahead markup (By LMP category, unadjusted): January through March, 2015 and 2016**

LMP Category	2015 (Jan - Mar)		2016 (Jan - Mar)	
	Average Markup Component	Frequency	Average Markup Component	Frequency
< \$25	(\$2.77)	5.6%	(\$1.27)	50.2%
\$25 to \$50	(\$1.33)	69.7%	\$0.09	47.4%
\$50 to \$75	\$0.60	10.1%	\$5.68	2.3%
\$75 to \$100	(\$1.80)	6.6%	\$7.07	0.1%
\$100 to \$125	\$1.04	3.9%	\$0.00	0.0%
\$125 to \$150	\$9.48	1.7%	\$0.00	0.0%
>= \$150	\$13.21	2.5%	\$0.00	0.0%

**Table 3-62 Average, day-ahead markup (By LMP category, adjusted): January through March, 2015 and 2016**

LMP Category	2015 (Jan - Mar)		2016 (Jan - Mar)	
	Average Markup Component	Frequency	Average Markup Component	Frequency
< \$25	(\$1.24)	5.6%	(\$0.04)	50.2%
\$25 to \$50	\$0.55	69.7%	\$1.36	47.4%
\$50 to \$75	\$1.66	10.1%	\$6.12	2.3%
\$75 to \$100	(\$1.02)	6.6%	\$7.07	0.1%
\$100 to \$125	\$1.75	3.9%	\$0.00	0.0%
\$125 to \$150	\$10.20	1.7%	\$0.00	0.0%
>= \$150	\$13.60	2.5%	\$0.00	0.0%

## Prices

The conduct of individual market entities within a market structure is reflected in market prices. PJM locational marginal prices (LMPs) are a direct measure of market performance. Price level is a good, general indicator of market performance, although overall price results must be interpreted carefully because of the multiple factors that affect them. Among other things, overall

average prices reflect changes in supply and demand, generation fuel mix, the cost of fuel, emission related expenses, markup and local price differences caused by congestion. PJM also may administratively set prices with the creation of a closed loop interface related to demand side resources or reactive power.

Real-time and day-ahead energy market load-weighted prices were 47.4 percent and 46.3 percent lower in the first three months of 2016 than in the first three months of 2015 as a result of lower fuel costs and lower demand in 2016. Coal and natural gas prices decreased in 2016. Comparing fuel prices in the first three months of 2016 to the first three months of 2015, the price of Northern Appalachian coal was 22.7 percent lower; the price of Central Appalachian coal was 15.5 percent lower; the price of Powder River Basin coal was 11.0 percent lower; the price of eastern natural gas was 67.2 percent lower; and the price of western natural gas was 32.1 percent lower.

PJM real-time energy market prices decreased in the first three months of 2016 compared to the first three months of 2015. The average LMP was 46.0 percent lower in the first three months of 2016 than in the first three months of 2015, \$25.60 per MWh versus \$47.39 per MWh. The load-weighted average LMP was 47.4 percent lower in the first three months of 2016 than in the first three months of 2015, \$26.80 per MWh versus \$50.91 per MWh.

The fuel-cost adjusted, load-weighted, average LMP in the first three months of 2016 was 30.1 percent higher than the load-weighted, average LMP for the first three months of 2016. If fuel and emission costs in the first three months of 2016 had been the same as in the first three months of 2015, holding everything else constant, the load-weighted LMP would have been higher, \$34.85 per MWh instead of the observed \$26.80 per MWh.

PJM day-ahead energy market prices decreased in the first three months of 2016 compared to the first three months of 2015. The average LMP was 44.7 percent lower in the first three months of 2016 than in the first three months of 2015, \$26.90 per MWh versus \$48.62 per MWh. The day-ahead load-weighted

average LMP was 46.3 percent lower in the first three months of 2016 than in the first three months of 2015, \$27.94 per MWh versus \$52.02 per MWh.

Occasionally, in a constrained market, the LMPs at some pricing nodes can exceed the offer price of the highest cleared generator in the supply stack.<sup>59</sup> In the nodal pricing system, the LMP at a pricing node is the total cost of meeting incremental demand at that node. When there are binding transmission constraints, satisfying the marginal increase in demand at a node may require increasing the output of some generators while simultaneously decreasing the output of other generators, such that the transmission constraints are not violated. The total cost of redispatching multiple generators can at times exceed the cost of marginally increasing the output of the most expensive generator offered. Thus the LMPs at some pricing nodes exceed \$1,000 per MWh, the cap on the generators' offer price in the PJM market.<sup>60</sup>

### Real-Time LMP


Real-time average LMP is the hourly average LMP for the PJM Real-Time Energy Market.<sup>61</sup>

### Real-Time Average LMP

#### PJM Real-Time Average LMP Duration

Figure 3-33 shows the hourly distribution of PJM real-time average LMP for the first three months of 2015 and 2016.

Figure 3-33 Average LMP for the PJM Real-Time Energy Market: January through March, 2015 and 2016

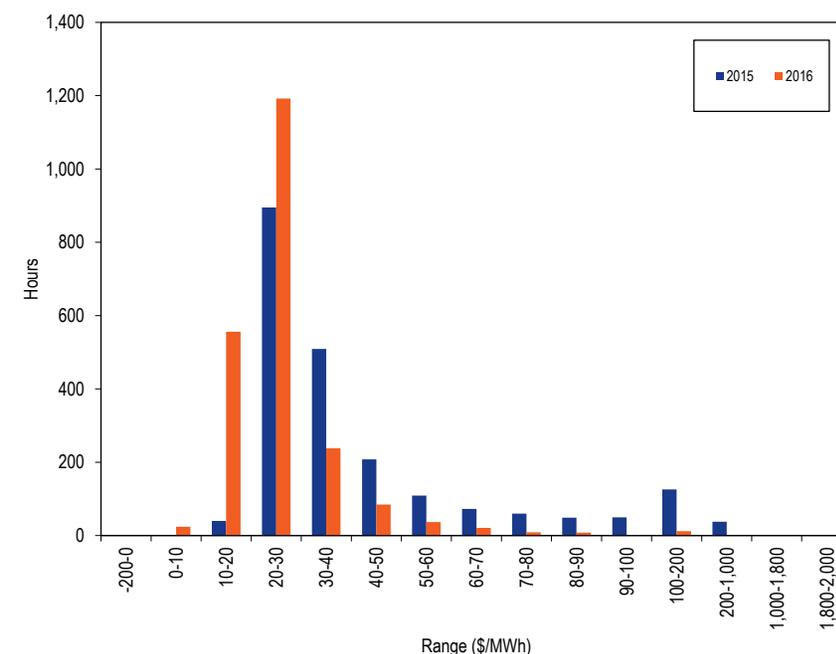

<sup>59</sup> See O'Neill R. P., Mead D. and Malvadkar P. "On Market Clearing Prices Higher than the Highest Bid and Other Almost Paranormal Phenomena." *The Electricity Journal* 2005; 18(2): pp 19-27.

<sup>60</sup> The offer cap in PJM was temporarily increased to \$1,800 per MWh prior to the winter of 2014/2015. A new cap of \$2,000 per MWh, only for offers with costs exceeding \$1,000 per MWh, went into effect on December, 14, 2015, 153 FERC ¶ 61,289 (2015).

<sup>61</sup> See the *MMU Technical Reference for the PJM Markets*, at "Calculating Locational Marginal Price," for detailed definition of Real-Time LMP. <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

### PJM Real-Time, Average LMP

Table 3-63 shows the PJM real-time, average LMP for the first three months of each year, from 1998 through 2016.<sup>62</sup>

**Table 3-63 PJM real-time, average LMP (Dollars per MWh): January through March, 1998 through 2016"**

Jan-Mar	Real-Time LMP			Year-to-Year Change		
	Average	Median	Standard Deviation	Average	Median	Standard Deviation
1998	\$17.51	\$15.30	\$7.84	NA	NA	NA
1999	\$18.79	\$16.56	\$7.29	7.3%	8.3%	(7.0%)
2000	\$23.66	\$17.73	\$16.22	25.9%	7.0%	122.4%
2001	\$33.77	\$26.01	\$20.79	42.8%	46.8%	28.2%
2002	\$22.23	\$19.22	\$9.61	(34.2%)	(26.1%)	(53.8%)
2003	\$49.57	\$43.08	\$30.54	123.0%	124.2%	217.9%
2004	\$46.37	\$41.04	\$24.07	(6.5%)	(4.8%)	(21.2%)
2005	\$46.51	\$40.62	\$22.07	0.3%	(1.0%)	(8.3%)
2006	\$52.98	\$46.15	\$23.29	13.9%	13.6%	5.5%
2007	\$55.34	\$47.15	\$33.29	4.5%	2.2%	43.0%
2008	\$66.75	\$57.05	\$35.54	20.6%	21.0%	6.8%
2009	\$47.29	\$40.56	\$21.99	(29.2%)	(28.9%)	(38.1%)
2010	\$44.13	\$37.82	\$21.87	(6.7%)	(6.8%)	(0.6%)
2011	\$44.76	\$38.14	\$23.10	1.4%	0.8%	5.6%
2012	\$30.38	\$28.82	\$11.63	(32.1%)	(24.4%)	(49.7%)
2013	\$36.33	\$32.29	\$18.47	19.6%	12.1%	58.9%
2014	\$84.04	\$48.77	\$119.84	131.3%	51.0%	548.8%
2015	\$47.39	\$31.95	\$42.42	(43.6%)	(34.5%)	(64.6%)
2016	\$25.60	\$22.91	\$12.99	(46.0%)	(28.3%)	(69.4%)

### Real-Time, Load-Weighted, Average LMP

Higher demand (load) generally results in higher prices, all else constant. As a result, load-weighted, average prices are generally higher than average prices. Load-weighted LMP reflects the average LMP paid for actual MWh consumed during a year. Load-weighted, average LMP is the average of PJM hourly LMP, each weighted by the PJM total hourly load. The real-time, load-weighted, average LMP decreased by 47.4 percent compared to the first three months of 2015.

<sup>62</sup> The system average LMP is the average of the hourly LMP without any weighting. The only exception is that market-clearing prices (MCPs) are included for January to April 1998. MCP was the single market-clearing price calculated by PJM prior to implementation of LMP.

### PJM Real-Time, Load-Weighted, Average LMP

Table 3-64 shows the PJM real-time, load-weighted, average LMP for the first three months of each year, from 1998 through 2016.

**Table 3-64 PJM real-time, load-weighted, average LMP (Dollars per MWh): January through March, 1998 through 2016**

Jan-Mar	Real-Time, Load-Weighted, Average LMP			Year-to-Year Change		
	Average	Median	Standard Deviation	Average	Median	Standard Deviation
1998	\$18.13	\$15.80	\$8.14	NA	NA	NA
1999	\$19.38	\$16.90	\$7.66	6.9%	7.0%	(5.9%)
2000	\$25.10	\$18.25	\$17.22	29.5%	8.0%	124.9%
2001	\$35.16	\$27.38	\$21.52	40.1%	50.0%	25.0%
2002	\$23.01	\$19.89	\$9.93	(34.6%)	(27.4%)	(53.8%)
2003	\$51.93	\$46.12	\$30.99	125.6%	131.9%	211.9%
2004	\$48.77	\$43.22	\$24.62	(6.1%)	(6.3%)	(20.6%)
2005	\$48.37	\$42.20	\$22.62	(0.8%)	(2.4%)	(8.1%)
2006	\$54.43	\$47.62	\$23.69	12.5%	12.9%	4.7%
2007	\$58.07	\$50.60	\$34.44	6.7%	6.3%	45.4%
2008	\$69.35	\$60.11	\$36.56	19.4%	18.8%	6.2%
2009	\$49.60	\$42.23	\$23.38	(28.5%)	(29.8%)	(36.1%)
2010	\$45.92	\$39.01	\$22.99	(7.4%)	(7.6%)	(1.7%)
2011	\$46.35	\$39.11	\$24.26	0.9%	0.3%	5.5%
2012	\$31.21	\$29.25	\$12.02	(32.7%)	(25.2%)	(50.5%)
2013	\$37.41	\$32.79	\$19.90	19.9%	12.1%	65.7%
2014	\$92.98	\$51.62	\$134.40	148.5%	57.4%	575.3%
2015	\$50.91	\$33.51	\$46.43	(45.2%)	(35.1%)	(65.5%)
2016	\$26.80	\$23.45	\$13.98	(47.4%)	(30.0%)	(69.9%)


Table 3-65 shows zonal real-time, and real-time, load-weighted, average LMP for the first three months of 2015 and 2016.

**Table 3-65 Zone real-time and real-time, load-weighted, average LMP (Dollars per MWh): January through March, 2015 and 2016**

Zone	Real-Time Average LMP			Real-Time, Load-Weighted, Average LMP		
	2015 (Jan-Mar)	2016 (Jan-Mar)	Percent Change	2015 (Jan-Mar)	2016 (Jan-Mar)	Percent Change
AECO	\$55.69	\$24.13	(56.7%)	\$60.14	\$25.73	(57.2%)
AEP	\$39.70	\$25.46	(35.9%)	\$42.23	\$26.49	(37.3%)
AP	\$49.68	\$26.36	(46.9%)	\$53.65	\$27.63	(48.5%)
ATSI	\$40.41	\$25.28	(37.4%)	\$41.94	\$26.03	(37.9%)
BGE	\$56.35	\$33.96	(39.7%)	\$62.50	\$36.11	(42.2%)
ComEd	\$34.86	\$22.80	(34.6%)	\$36.14	\$23.45	(35.1%)
Day	\$39.26	\$25.19	(35.8%)	\$41.35	\$26.08	(36.9%)
DEOK	\$37.36	\$24.52	(34.4%)	\$39.49	\$25.42	(35.6%)
DLCO	\$35.60	\$24.92	(30.0%)	\$36.84	\$25.68	(30.3%)
Dominion	\$52.64	\$29.09	(44.7%)	\$59.35	\$31.29	(47.3%)
DPL	\$60.61	\$28.02	(53.8%)	\$68.76	\$30.56	(55.6%)
EKPC	\$36.90	\$24.56	(33.4%)	\$40.63	\$25.78	(36.6%)
JCPL	\$56.04	\$22.39	(60.0%)	\$60.26	\$23.79	(60.5%)
Met-Ed	\$55.00	\$22.32	(59.4%)	\$59.58	\$23.63	(60.3%)
PECO	\$55.05	\$21.94	(60.1%)	\$59.70	\$23.29	(61.0%)
PENELEC	\$50.65	\$24.34	(51.9%)	\$53.46	\$25.29	(52.7%)
Pepco	\$54.43	\$30.50	(44.0%)	\$60.19	\$32.38	(46.2%)
PPL	\$55.10	\$22.46	(59.2%)	\$60.18	\$23.88	(60.3%)
PSEG	\$62.85	\$22.77	(63.8%)	\$66.47	\$23.95	(64.0%)
RECO	\$64.86	\$22.61	(65.1%)	\$68.51	\$23.79	(65.3%)
PJM	\$47.39	\$25.60	(46.0%)	\$50.91	\$26.80	(47.4%)

Figure 3-34 is a contour map of the real-time, load-weighted, average LMP in the first three months of 2016. In the legend, green represents the system marginal price (SMP) and each increment to the right and left of the SMP represents five percent of the pricing nodes above and below the SMP. The LMP for each five percent increment is the highest nodal average LMP for that set of nodes. Each increment to the left of the SMP is the lowest nodal average LMP for that set of nodes.


**Figure 3-34 PJM real-time, load-weighted, average LMP: January through March, 2016**

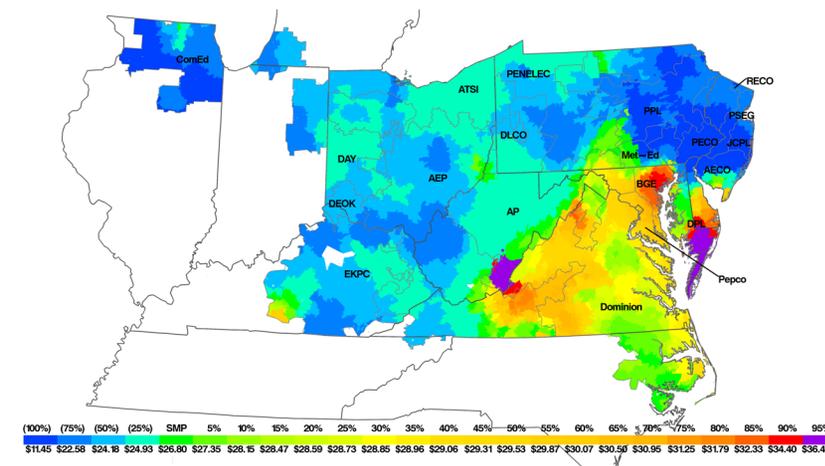

### PJM Real-Time, Monthly, Load-Weighted, Average LMP

Figure 3-35 shows the PJM real-time monthly and annual load-weighted LMP for 1999 through 2015. PJM real-time monthly load-weighted average LMP in March 2016 was \$22.90, which is the lowest real-time monthly load-weighted average LMP since February 2002 at \$21.39.

**Figure 3-35 PJM real-time, monthly and annual, load-weighted, average LMP: 1999 through March 2016**

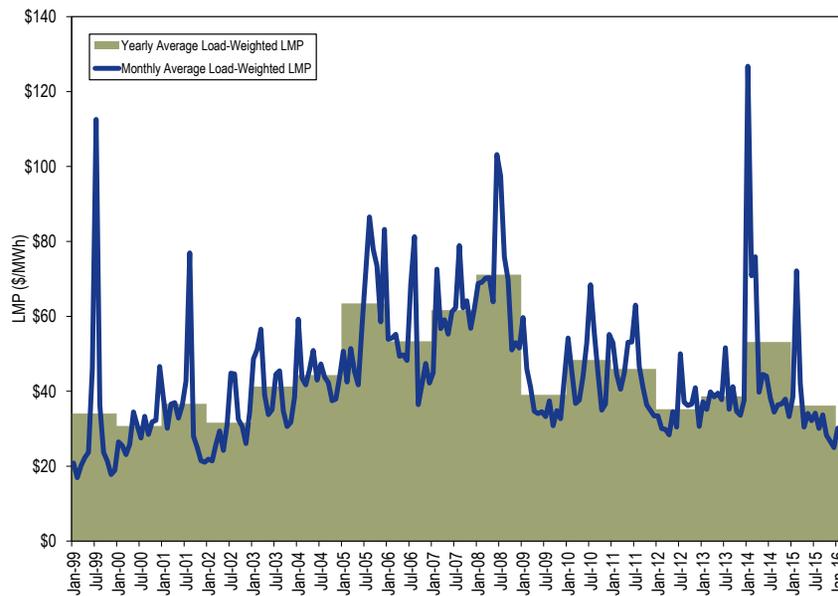


### Fuel Price Trends and LMP

Changes in LMP can result from changes in the marginal costs of marginal units, the units setting LMP. In general, fuel costs make up between 80 percent and 90 percent of marginal cost depending on generating technology, unit efficiency, unit age and other factors. The impact of fuel cost on marginal cost and on LMP depends on the fuel burned by marginal units and changes in fuel costs. Changes in emission allowance costs are another contributor to changes in the marginal cost of marginal units. Coal and natural gas prices

decreased in 2016. Comparing fuel prices in the first three months of 2016 to the first three months of 2015, the price of Northern Appalachian coal was 22.7 percent lower; the price of Central Appalachian coal was 15.5 percent lower; the price of Powder River Basin coal was 11.0 percent lower; the price of eastern natural gas was 67.2 percent lower; and the price of western natural gas was 32.1 percent lower. Figure 3-36 shows monthly average spot fuel prices.<sup>63</sup>

**Figure 3-36 Spot average fuel price comparison with fuel delivery charges: January 2012 through March 2016 (\$/MMBtu)**

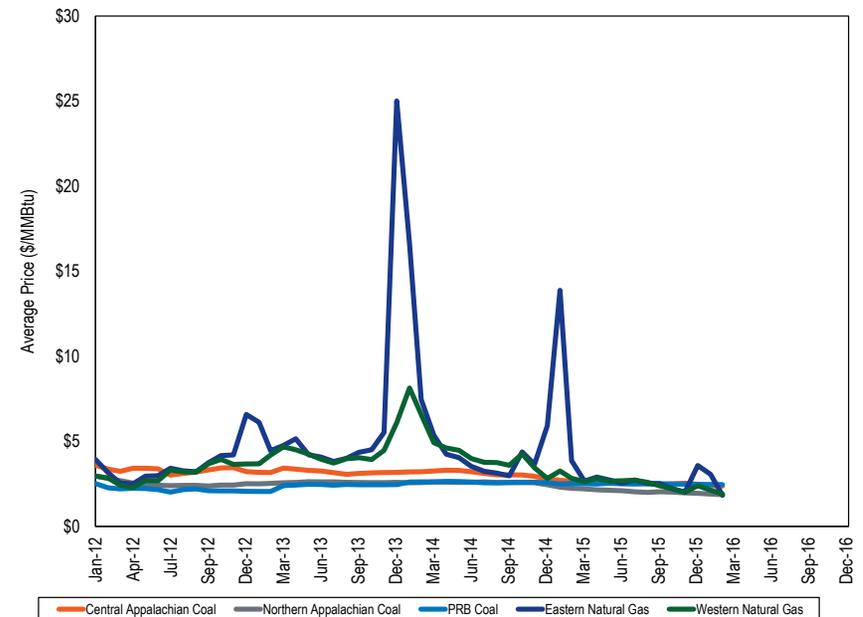

<sup>63</sup> Eastern natural gas consists of the average of Texas M3, Transco Zone 6 non-NY, Transco Zone 6 NY and Transco Zone 5 daily fuel price indices. Western natural gas prices are the average of Dominion North Point, Columbia Appalachia and Chicago Citygate daily fuel price indices. Coal prices are the average of daily fuel prices for Central Appalachian coal, Northern Appalachian coal, and Powder River Basin coal. All fuel prices are from Platts.

Table 3-66 compares the first three months of 2016 PJM real time fuel-cost adjusted, load-weighted, average LMP to the first three months of 2016 load-weighted, average LMP.<sup>64</sup> The real time fuel-cost adjusted, load-weighted, average LMP for the first three months of 2016 was 30.1 percent higher than the real time load-weighted, average LMP for the first three months of 2016. The real-time, fuel-cost adjusted, load-weighted, average LMP for the first three months of 2016 was 31.5 percent lower than the real time load-weighted LMP for the first three months of 2015. If fuel and emissions costs in the first three months of 2016 had been the same as in the first three months of 2015, holding everything else constant, the real time load-weighted LMP in the first three months of 2016 would have been higher, \$34.85 per MWh instead of the observed \$26.80 per MWh.

**Table 3-66 PJM real-time annual, fuel-cost adjusted, load-weighted average LMP (Dollars per MWh): January through March, 2015 and 2016**

	2016 Load-Weighted LMP	2016 Fuel-Cost Adjusted, Load-Weighted LMP	Change
Average	\$26.80	\$34.85	30.1%
	2015 Load-Weighted LMP	2016 Fuel-Cost Adjusted, Load-Weighted LMP	Change
Average	\$50.91	\$34.85	(31.5%)
	2015 Load-Weighted LMP	2016 Load-Weighted LMP	Change
Average	\$50.91	\$26.80	(47.4%)

Table 3-67 shows the impact of each fuel type on the difference between the fuel-cost adjusted, load-weighted average LMP and the load-weighted LMP in the first three months of 2016. Table 3-67 shows that lower coal, natural gas and oil prices explain almost all of the fuel-cost related decrease in the real time annual load-weighted average LMP in the first three months of 2016. Unlike oil and natural gas, there was no substantial change in the price of coal from the first three months of 2015 to the first three months of 2016.

<sup>64</sup> The fuel-cost adjusted LMP reflects both the fuel and emissions where applicable, including NO<sub>x</sub>, CO<sub>2</sub> and SO<sub>x</sub> costs.

**Table 3-67 Change in PJM real-time annual, fuel-cost adjusted, load-weighted average LMP (Dollars per MWh) by Fuel-type: January through March, 2015 and 2016**

Fuel Type	Share of Change in Fuel Cost Adjusted, Load Weighted LMP	Percent
Coal	(\$2.24)	27.8%
Gas	(\$5.53)	68.7%
Municipal Waste	\$0.00	0.0%
Oil	(\$0.28)	3.5%
Other	(\$0.00)	0.0%
Uranium	\$0.00	0.0%
Wind	(\$0.00)	0.0%
Total	(\$8.05)	100.0%

### Components of Real-Time, Load-Weighted LMP

LMPs result from the operation of a market based on security-constrained, economic (least-cost) dispatch (SCED) in which marginal units determine system LMPs, based on their offers and five minute ahead forecasts of system conditions. Those offers can be decomposed into components including fuel costs, emission costs, variable operation and maintenance costs, markup, FMU adder and the 10 percent cost adder. As a result, it is possible to decompose LMP by the components of unit offers.

Cost offers of marginal units are separated into their component parts. The fuel related component is based on unit specific heat rates and spot fuel prices. Emission costs are calculated using spot prices for NO<sub>x</sub>, SO<sub>2</sub> and CO<sub>2</sub> emission credits, emission rates for NO<sub>x</sub>, emission rates for SO<sub>2</sub> and emission rates for CO<sub>2</sub>. The CO<sub>2</sub> emission costs are applicable to PJM units in the PJM states that participate in RGGI: Delaware and Maryland.<sup>65</sup> The FMU adder is the calculated contribution of the FMU and AU adders to LMP that results when units with FMU or AU adders are marginal.

Since the implementation of scarcity pricing on October 1, 2012, PJM jointly optimizes the commitment and dispatch of energy and ancillary services. In periods of scarcity when generators providing energy have to be dispatched down from their economic operating level to meet reserve requirements, the joint optimization of energy and reserves takes into account the opportunity

<sup>65</sup> New Jersey withdrew from RGGI, effective January 1, 2012.

cost of the reduced generation and the associated incremental cost to maintain reserves. If a unit incurring such opportunity costs is a marginal resource in the energy market, this opportunity cost will contribute to LMP. In addition, in periods when generators providing energy cannot meet the reserve requirements, PJM can invoke shortage pricing. PJM invoked shortage pricing on January 6 and January 7 of 2014.<sup>66</sup> During the shortage conditions, the LMPs of marginal generators reflect the cost of not meeting the reserve requirements, the scarcity adder, which is defined by the operating reserve demand curve.

LMP may, at times, be set by transmission penalty factors. When a transmission constraint is binding and there are no generation alternatives to resolve the constraint, system operators may allow the transmission limit to be violated. When this occurs, the shadow price of the constraint is set by transmission penalty factors. The shadow price directly affects the LMP. Transmission penalty factors are administratively determined and can be thought of as a form of locational scarcity pricing.

Transmission penalty factors should be stated explicitly and publicly and applied without discretion. Penalty factors should be set high enough so that they do not act to suppress prices based on available generator solutions. But rather than permit the transmission penalty factor to set the shadow price, PJM has been using a procedure called constraint relaxation logic to prevent the penalty factors from setting the shadow price of the constraint. The result is that the transmission penalty factor does not set the shadow price. The details of PJM's logic and practice are not entirely clear. But in 2015, for all transmission constraints for which a penalty factor at or above \$2,000 per MWh was used, 41 percent of the constraints' shadow prices were within ten percent of the penalty factor.

The MMU recommends that PJM explicitly state its policy on the use of transmission penalty factors including the level of the penalty factors, the triggers for the use of the penalty factors, the appropriate line ratings to

trigger the use of penalty factors, and when the transmission penalty factors will be used to set the shadow price.

The components of LMP are shown in Table 3-68, including markup using unadjusted cost offers.<sup>67</sup> Table 3-68 shows that for the first three months of 2016, 54.2 percent of the load-weighted LMP was the result of coal costs, 22.3 percent was the result of gas costs and 2.28 percent was the result of the cost of emission allowances. Using adjusted cost offers, markup was 1.7 percent of the load-weighted LMP. The fuel-related components of LMP reflect the degree to which the cost of the identified fuel affects LMP and does not reflect the other components of the offers of units burning that fuel. The component NA is the unexplained portion of load-weighted LMP. Occasionally, PJM fails to provide all the data needed to accurately calculate generator sensitivity factors. As a result, the LMP for those intervals cannot be decomposed into component costs. The cumulative effect of excluding those five-minute intervals is the component NA. In the first three months of 2016, nearly ten percent of all five-minute intervals had insufficient data. The percent column is the difference in the proportion of LMP represented by each component between the first three months of 2016 and the first three months of 2015.

<sup>66</sup> PJM triggered shortage pricing on January 6, 2015, following a RTO-wide voltage reduction action. PJM triggered shortage pricing on January 7, 2014 due to RTO-wide shortage of synchronized reserve.

<sup>67</sup> These components are explained in the *Technical Reference for PJM Markets*, at "Calculation and Use of Generator Sensitivity/Unit Participation Factors."

Table 3-68 Components of PJM real-time (Unadjusted), load-weighted, average LMP: January through March, 2015 and 2016

Element	2015 (Jan-Mar)		2016 (Jan-Mar)		Change Percent
	Contribution to LMP	Percent	Contribution to LMP	Percent	
Coal	\$18.31	36.0%	\$14.54	54.2%	18.3%
Gas	\$16.50	32.4%	\$5.97	22.3%	(10.1)%
Ten Percent Adder	\$4.20	8.2%	\$2.39	8.9%	0.7%
VOM	\$2.60	5.1%	\$2.07	7.7%	2.6%
NA	\$0.99	1.9%	\$0.83	3.1%	1.2%
NO <sub>x</sub> Cost	\$0.02	0.0%	\$0.52	1.9%	1.9%
LPA Rounding Difference	\$0.31	0.6%	\$0.49	1.8%	1.2%
Oil	\$3.97	7.8%	\$0.47	1.8%	(6.0)%
Ancillary Service Redispatch Cost	\$1.78	3.5%	\$0.30	1.1%	(2.4)%
Increase Generation Adder	\$0.34	0.7%	\$0.17	0.6%	(0.0)%
SO <sub>2</sub> Cost	\$0.01	0.0%	\$0.09	0.3%	0.3%
Other	\$0.04	0.1%	\$0.07	0.3%	0.2%
Market-to-Market Adder	\$0.01	0.0%	\$0.01	0.0%	0.0%
Municipal Waste	\$0.01	0.0%	\$0.00	0.0%	(0.0)%
FMU Adder	\$0.01	0.0%	\$0.00	0.0%	(0.0)%
CO <sub>2</sub> Cost	\$0.29	0.6%	\$0.00	0.0%	(0.6)%
Uranium	(\$0.00)	(0.0)%	\$0.00	0.0%	0.0%
Constraint Violation Adder	(\$0.00)	(0.0)%	\$0.00	0.0%	0.0%
LPA-SCED Differential	(\$0.00)	(0.0)%	(\$0.01)	(0.0)%	(0.0)%
Decrease Generation Adder	(\$0.08)	(0.2)%	(\$0.02)	(0.1)%	0.1%
Wind	(\$0.02)	(0.0)%	(\$0.04)	(0.1)%	(0.1)%
Markup	\$1.63	3.2%	(\$1.06)	(4.0)%	(7.2)%
Total	\$50.91	100.0%	\$26.80	100.0%	0.0%

In order to accurately assess the markup behavior of market participants, real-time and day-ahead LMPs are decomposed using two different approaches. In the first approach, (Table 3-68 and Table 3-73) markup is simply the difference between the price offer and the cost offer. In the second approach, (Table 3-69 and Table 3-74) the 10 percent markup is removed from the cost offers of coal units.

The components of LMP are shown in Table 3-69, including markup using adjusted cost offers.

Table 3-69 Components of PJM real-time (Adjusted), load-weighted, average LMP: January through March, 2015 and 2016

Element	2015 (Jan-Mar)		2016 (Jan-Mar)		Change Percent
	Contribution to LMP	Percent	Contribution to LMP	Percent	
Coal	\$18.31	36.0%	\$14.54	54.2%	18.3%
Gas	\$16.50	32.4%	\$5.97	22.3%	(10.1)%
VOM	\$2.60	5.1%	\$2.07	7.7%	2.6%
Ten Percent Adder	\$2.29	4.5%	\$0.86	3.2%	(1.3)%
NA	\$0.99	1.9%	\$0.83	3.1%	1.2%
NO <sub>x</sub> Cost	\$0.02	0.0%	\$0.52	1.9%	1.9%
LPA Rounding Difference	\$0.31	0.6%	\$0.49	1.8%	1.2%
Oil	\$3.97	7.8%	\$0.47	1.8%	(6.0)%
Markup	\$3.54	7.0%	\$0.46	1.7%	(5.2)%
Ancillary Service Redispatch Cost	\$1.78	3.5%	\$0.30	1.1%	(2.4)%
Increase Generation Adder	\$0.34	0.7%	\$0.17	0.6%	(0.0)%
SO <sub>2</sub> Cost	\$0.01	0.0%	\$0.09	0.3%	0.3%
Other	\$0.04	0.1%	\$0.07	0.3%	0.2%
Market-to-Market Adder	\$0.01	0.0%	\$0.01	0.0%	0.0%
Municipal Waste	\$0.01	0.0%	\$0.00	0.0%	(0.0)%
FMU Adder	\$0.01	0.0%	\$0.00	0.0%	(0.0)%
Municipal Waste	\$0.01	0.0%	\$0.00	0.0%	(0.0)%
CO <sub>2</sub> Cost	\$0.29	0.6%	\$0.00	0.0%	(0.6)%
Uranium	(\$0.00)	(0.0)%	\$0.00	0.0%	0.0%
Constraint Violation Adder	(\$0.00)	(0.0)%	\$0.00	0.0%	0.0%
LPA-SCED Differential	(\$0.00)	(0.0)%	(\$0.01)	(0.0)%	(0.0)%
Decrease Generation Adder	(\$0.08)	(0.2)%	(\$0.02)	(0.1)%	0.1%
Wind	(\$0.02)	(0.0)%	(\$0.04)	(0.1)%	(0.1)%
Total	\$50.91	100.0%	\$26.80	100.0%	0.0%

## Day-Ahead LMP


Day-ahead average LMP is the hourly average LMP for the PJM Day-Ahead Energy Market.<sup>68</sup>

## Day-Ahead Average LMP

### PJM Day-Ahead Average LMP Duration

Figure 3-37 shows the hourly distribution of PJM day-ahead average LMP for the first three months of 2015 and 2016.

**Figure 3-37 Average LMP for the PJM Day-Ahead Energy Market: January through March 2015 and 2016**

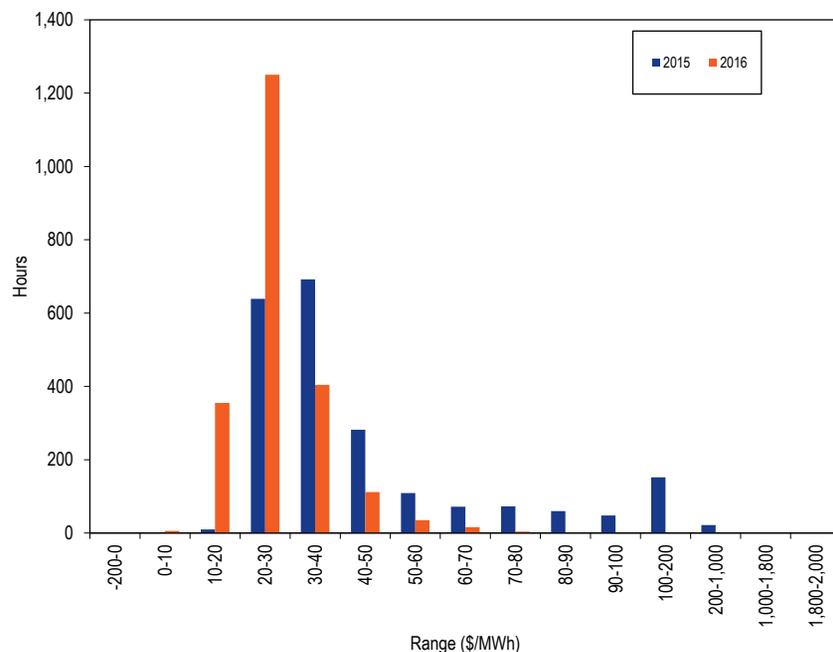

<sup>68</sup> See the *MMU Technical Reference for the PJM Markets*, at "Calculating Locational Marginal Price" for a detailed definition of Day-Ahead LMP. <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

## PJM Day-Ahead, Average LMP

Table 3-70 shows the PJM day-ahead, average LMP for the first three months of each year of the 16-year period 2001 through 2016.

**Table 3-70 PJM day-ahead, average LMP (Dollars per MWh): January through March, 2001 through 2016**

Jan-Mar	Day-Ahead LMP			Year-to-Year Change		
	Average	Median	Standard Deviation	Average	Median	Standard Deviation
2001	\$36.45	\$32.72	\$16.39	NA	NA	NA
2002	\$22.43	\$20.59	\$7.56	(38.5%)	(37.1%)	(53.9%)
2003	\$51.20	\$46.06	\$25.65	128.2%	123.7%	239.3%
2004	\$45.84	\$43.01	\$18.85	(10.5%)	(6.6%)	(26.5%)
2005	\$45.14	\$41.56	\$16.19	(1.5%)	(3.4%)	(14.1%)
2006	\$51.23	\$48.53	\$14.16	13.5%	16.8%	(12.6%)
2007	\$52.76	\$49.43	\$22.59	3.0%	1.9%	59.5%
2008	\$66.10	\$62.57	\$23.90	25.3%	26.6%	5.8%
2009	\$47.41	\$43.43	\$16.85	(28.3%)	(30.6%)	(29.5%)
2010	\$46.13	\$41.99	\$15.93	(2.7%)	(3.3%)	(5.5%)
2011	\$45.60	\$41.10	\$16.82	(1.2%)	(2.1%)	5.6%
2012	\$30.82	\$30.04	\$6.63	(32.4%)	(26.9%)	(60.6%)
2013	\$36.46	\$34.45	\$9.78	18.3%	14.7%	47.5%
2014	\$86.52	\$52.80	\$92.80	137.3%	53.3%	848.8%
2015	\$48.62	\$35.48	\$36.77	(43.8%)	(32.8%)	(60.4%)
2016	\$26.90	\$25.11	\$8.83	(44.7%)	(29.2%)	(76.0%)

### Day-Ahead, Load-Weighted, Average LMP

Day-ahead, load-weighted LMP reflects the average LMP paid for day-ahead MWh. Day-ahead, load-weighted LMP is the average of PJM day-ahead hourly LMP, each weighted by the PJM total cleared day-ahead hourly load, including day-ahead fixed load, price-sensitive load, decrement bids and up to congestion.

### PJM Day-Ahead, Load-Weighted, Average LMP

Table 3-71 shows the PJM day-ahead, load-weighted, average LMP for the first three months of each year of the 16-year period 2001 through 2016.

**Table 3-71 PJM day-ahead, load-weighted, average LMP (Dollars per MWh): 2001 through 2016**

	Day-Ahead, Load-Weighted, Average LMP			Year-to-Year Change		
	Average	Median	Standard Deviation	Average	Median	Standard Deviation
2001	\$37.70	\$34.55	\$16.66	NA	NA	NA
2002	\$23.17	\$21.18	\$7.76	(38.5%)	(38.7%)	(53.4%)
2003	\$53.16	\$48.69	\$25.75	129.5%	129.9%	231.7%
2004	\$47.75	\$45.02	\$19.19	(10.2%)	(7.5%)	(25.4%)
2005	\$46.54	\$42.88	\$16.46	(2.5%)	(4.8%)	(14.2%)
2006	\$52.40	\$49.51	\$14.29	12.6%	15.5%	(13.2%)
2007	\$54.87	\$51.89	\$23.16	4.7%	4.8%	62.0%
2008	\$68.00	\$64.70	\$24.35	23.9%	24.7%	5.1%
2009	\$49.44	\$44.85	\$17.54	(27.3%)	(30.7%)	(28.0%)
2010	\$47.77	\$43.62	\$16.52	(3.4%)	(2.7%)	(5.8%)
2011	\$47.14	\$42.49	\$17.73	(1.3%)	(2.6%)	7.3%
2012	\$31.51	\$30.44	\$6.83	(33.2%)	(28.3%)	(61.5%)
2013	\$37.26	\$35.02	\$10.26	18.3%	15.0%	50.3%
2014	\$94.97	\$56.53	\$102.23	154.9%	61.4%	896.7%
2015	\$52.02	\$36.94	\$40.10	(45.2%)	(34.7%)	(60.8%)
2016	\$27.94	\$25.99	\$9.28	(46.3%)	(29.6%)	(76.8%)

Table 3-72 shows zonal day-ahead, and day-ahead, load-weighted, average LMP for the first three months of 2015 and 2016.


**Table 3-72 Zone day-ahead and day-ahead, load-weighted, average LMP (Dollars per MWh): January through March, 2015 and 2016**

Zone	Day-Ahead Average LMP			Day-Ahead, Load-Weighted, Average LMP		
	2015 (Jan-Mar)	2016 (Jan-Mar)	Percent Change	2015 (Jan-Mar)	2016 (Jan-Mar)	Percent Change
AECO	\$55.69	\$24.13	(56.7%)	\$62.12	\$25.38	(59.1%)
AEP	\$39.70	\$25.46	(35.9%)	\$42.83	\$27.30	(36.3%)
AP	\$49.68	\$26.36	(46.9%)	\$52.75	\$28.84	(45.3%)
ATSI	\$40.41	\$25.28	(37.4%)	\$42.45	\$27.04	(36.3%)
BGE	\$56.35	\$33.96	(39.7%)	\$64.68	\$38.70	(40.2%)
ComEd	\$34.86	\$22.80	(34.6%)	\$35.21	\$24.21	(31.3%)
Day	\$39.26	\$25.19	(35.8%)	\$41.43	\$27.02	(34.8%)
DEOK	\$37.36	\$24.52	(34.4%)	\$39.70	\$26.55	(33.1%)
DLCO	\$35.60	\$24.92	(30.0%)	\$36.93	\$26.71	(27.7%)
Dominion	\$52.64	\$29.09	(44.7%)	\$64.37	\$33.27	(48.3%)
DPL	\$60.61	\$28.02	(53.8%)	\$70.58	\$32.49	(54.0%)
EKPC	\$36.90	\$24.56	(33.4%)	\$41.02	\$26.41	(35.6%)
JCPL	\$56.04	\$22.39	(60.0%)	\$62.97	\$24.08	(61.8%)
Met-Ed	\$55.00	\$22.32	(59.4%)	\$59.99	\$23.96	(60.1%)
PECO	\$55.05	\$21.94	(60.1%)	\$61.73	\$23.56	(61.8%)
PENELEC	\$50.65	\$24.34	(51.9%)	\$52.10	\$26.45	(49.2%)
Pepco	\$54.43	\$30.50	(44.0%)	\$63.05	\$34.70	(45.0%)
PPL	\$55.10	\$22.46	(59.2%)	\$61.49	\$24.20	(60.6%)
PSEG	\$62.85	\$22.77	(63.8%)	\$65.62	\$25.19	(61.6%)
RECO	\$64.86	\$22.61	(65.1%)	\$66.21	\$24.56	(62.9%)
PJM	\$47.39	\$25.60	(46.0%)	\$52.02	\$27.94	(46.3%)

### PJM Day-Ahead, Monthly, Load-Weighted, Average LMP

Figure 3-38 shows the PJM day-ahead, monthly and annual, load-weighted LMP from June 2000 through March 2016.<sup>69</sup> The PJM day-ahead monthly load-weighted average LMP in March 2016 was \$24.58, which is the lowest day-ahead monthly load-weighted average since May 2002 at \$23.74.

**Figure 3-38 Day-ahead, monthly and annual, load-weighted, average LMP: June 2000 through March 2016**

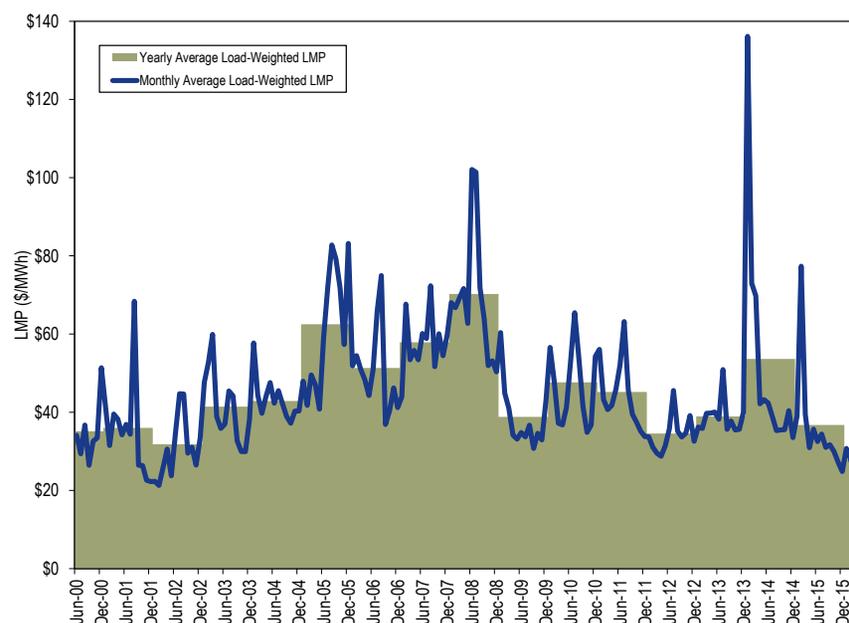

### Components of Day-Ahead, Load-Weighted LMP

LMPs result from the operation of a market based on security-constrained, least-cost dispatch in which marginal resources determine system LMPs, based on their offers. For physical units, those offers can be decomposed into their components including fuel costs, emission costs, variable operation and maintenance costs, markup, FMU adder, day-ahead scheduling reserve

<sup>69</sup> Since the Day-Ahead Energy Market did not start until June 1, 2000, the day-ahead data for 2000 only includes data for the last six months of that year.

(DASR) adder and the 10 percent cost offer adder. INC offers, DEC bids and up to congestion transactions are dispatchable injections and withdrawals in the Day-Ahead Energy Market with an offer price that cannot be decomposed. Using identified marginal resource offers and the components of unit offers, it is possible to decompose PJM system LMP using the components of unit offers and sensitivity factors.

Cost offers of marginal units are separated into their component parts. The fuel related component is based on unit specific heat rates and spot fuel prices. Emission costs are calculated using spot prices for NO<sub>x</sub>, SO<sub>2</sub> and CO<sub>2</sub> emission credits, emission rates for NO<sub>x</sub>, emission rates for SO<sub>2</sub> and emission rates for CO<sub>2</sub>. CO<sub>2</sub> emission costs are applicable to PJM units in the PJM states that participate in RGGI: Delaware and Maryland.<sup>70</sup> Day-ahead scheduling reserve (DASR) lost opportunity cost (LOC) and DASR offer adders are the calculated contribution to LMP when redispatch of resources is needed in order to satisfy DASR requirements. The FMU adder is the calculated contribution of the FMU and AU adders to LMP that results when units with FMU or AU adders are marginal.

Table 3-73 shows the components of the PJM day-ahead, annual, load-weighted average LMP. In the first three months of 2016, 35.5 percent of the load-weighted LMP was the result of coal cost, 12.5 percent of the load-weighted LMP was the result of gas cost, 4.6 percent was the result of the up to congestion transaction cost, 20.8 percent was the result of DEC bid cost and 13.8 percent was the result of INC bid cost.

<sup>70</sup> New Jersey withdrew from RGGI, effective January 1, 2012.

Table 3-73 Components of PJM day-ahead, (unadjusted), load-weighted, average LMP (Dollars per MWh): January through March, 2015 and 2016

Element	2015 (Jan - Mar)		2016 (Jan - Mar)		Change Percent
	Contribution to LMP	Percent	Contribution to LMP	Percent	
Coal	\$14.02	27.0%	\$9.91	35.5%	8.5%
DEC	\$10.39	20.0%	\$5.82	20.8%	0.8%
INC	\$8.21	15.8%	\$3.84	13.8%	(2.0)%
Gas	\$9.15	17.6%	\$3.49	12.5%	(5.1)%
Ten Percent Cost Adder	\$2.76	5.3%	\$1.53	5.5%	0.2%
VOM	\$1.76	3.4%	\$1.32	4.7%	1.3%
Up to Congestion Transaction	\$1.39	2.7%	\$1.29	4.6%	2.0%
Dispatchable Transaction	\$1.90	3.7%	\$0.42	1.5%	(2.2)%
NOx	\$0.01	0.0%	\$0.35	1.2%	1.2%
Other	\$0.00	0.0%	\$0.11	0.4%	0.4%
SO <sub>2</sub>	\$0.01	0.0%	\$0.06	0.2%	0.2%
Oil	\$2.47	4.8%	\$0.06	0.2%	(4.6)%
DASR LOC Adder	(\$0.00)	(0.0)%	\$0.02	0.1%	0.1%
Constrained Off	\$0.00	0.0%	\$0.01	0.0%	0.0%
CO <sub>2</sub>	\$0.14	0.3%	\$0.00	0.0%	(0.3)%
DASR Offer Adder	\$0.03	0.1%	\$0.00	0.0%	(0.1)%
Wind	(\$0.00)	(0.0)%	(\$0.01)	(0.1)%	(0.0)%
Markup	(\$0.36)	(0.7)%	(\$0.26)	(0.9)%	(0.2)%
Municipal Waste	\$0.02	0.0%	\$0.00	0.0%	(0.0)%
Price Sensitive Demand	\$0.12	0.2%	\$0.00	0.0%	(0.2)%
NA	(\$0.00)	(0.0)%	\$0.00	0.0%	0.0%
Total	\$52.02	100.0%	\$27.94	100.0%	0.0%

Table 3-74 shows the components of the PJM day-ahead, load-weighted average LMP including the adjusted markup calculated by excluding the 10 percent adder from the coal units.

Table 3-74 Components of PJM day-ahead, (adjusted), load-weighted, average LMP (Dollars per MWh): January through March, 2015 and 2016

Element	2015 (Jan - Mar)		2016 (Jan - Mar)		Change Percent
	Contribution to LMP	Percent	Contribution to LMP	Percent	
Coal	\$14.02	27.0%	\$9.03	32.3%	5.4%
DEC	\$10.39	20.0%	\$5.82	20.8%	0.8%
INC	\$8.21	15.8%	\$3.84	13.8%	(2.0)%
Gas	\$9.15	17.6%	\$3.49	12.5%	(5.1)%
Ten Percent Cost Adder	\$1.23	2.4%	\$1.41	5.1%	2.7%
Up to Congestion Transaction	\$1.39	2.7%	\$1.29	4.6%	2.0%
VOM	\$1.76	3.4%	\$1.22	4.4%	1.0%
Markup	\$1.16	2.2%	\$0.86	3.1%	0.9%
Dispatchable Transaction	\$1.90	3.7%	\$0.42	1.5%	(2.2)%
NO <sub>x</sub>	\$0.01	0.0%	\$0.32	1.1%	1.1%
Other	\$0.00	0.0%	\$0.11	0.4%	0.4%
SO <sub>2</sub>	\$0.01	0.0%	\$0.06	0.2%	0.2%
Oil	\$2.47	4.8%	\$0.06	0.2%	(4.6)%
DASR LOC Adder	(\$0.00)	(0.0)%	\$0.02	0.1%	0.1%
Constrained Off	\$0.00	0.0%	\$0.01	0.0%	0.0%
CO <sub>2</sub>	\$0.14	0.3%	\$0.00	0.0%	(0.3)%
DASR Offer Adder	\$0.03	0.1%	\$0.00	0.0%	(0.1)%
Wind	(\$0.00)	(0.0)%	(\$0.01)	(0.1)%	(0.0)%
Municipal Waste	\$0.02	0.0%	\$0.00	0.0%	(0.0)%
Price Sensitive Demand	\$0.12	0.2%	\$0.00	0.0%	(0.2)%
NA	(\$0.00)	(0.0)%	\$0.00	0.0%	0.0%
Total	\$52.02	100.0%	\$27.94	100.0%	0.0%

## Price Convergence

The introduction of the PJM Day-Ahead Energy Market created the possibility that competition, exercised through the use of virtual offers and bids, would tend to cause prices in the Day-Ahead and Real-Time Energy Markets to converge. Convergence is not the goal of virtual trading, but it is a possible outcome. The degree of convergence, by itself, is not a measure of the competitiveness or effectiveness of the Day-Ahead Energy Market. Price convergence does not necessarily mean a zero or even a very small difference in prices between Day-Ahead and Real-Time Energy Markets. There may be factors, from operating reserve charges to differences in risk that result in a competitive, market-based differential. In addition, convergence in the sense that day-ahead and real-time prices are equal at individual buses or aggregates

on a day to day basis is not a realistic expectation as a result of uncertainty, lags in response time and modeling differences, such as differences in modeled contingencies and marginal loss calculations, between the Day-Ahead and Real-Time Energy Market.

Where arbitrage opportunities are created by differences between day-ahead and real-time energy market expectations, reactions by market participants may lead to more efficient market outcomes by improving day-ahead commitments relative to real-time system requirements.

But there is no guarantee that the results of virtual bids and offers will result in more efficient market outcomes.

Where arbitrage incentives are created by systematic modeling differences, such as differences between the day-ahead and real-time modeled transmission contingencies and marginal loss calculations, virtual bids and offers cannot result in more efficient market outcomes. Such offers may be profitable but cannot change the underlying reason for the price difference. The virtual transactions will continue to profit from the activity for that reason regardless of the volume of those transactions. This is termed false arbitrage.

INCs, DECs and UTCs allow participants to arbitrage price differences between the Day-Ahead and Real-Time Energy Market. Absent a physical position in real time, the seller of an INC must buy energy in the Real-Time Energy Market to fulfill the financial obligation to provide energy. If the day-ahead price for energy is higher than the real-time price for energy, the INC makes a profit. Absent a physical position in real time, the buyer of a DEC must sell energy in the Real-Time Energy Market to fulfill the financial obligation to buy energy. If the day-ahead price for energy is lower than the real-time price for energy, the DEC makes a profit.

Profitability is a less reliable indicator of whether a UTC contributes to price convergence than for INCs and DECs. The profitability of a UTC transaction is the net of the separate profitability of the component INC and DEC. A UTC can be net profitable if the profit on one side of the UTC transaction exceeds

the losses on the other side. A profitable UTC can contribute to both price divergence on one side and to price convergence on the other side.

Table 3-75 shows the number of cleared UTC transactions, the number of profitable cleared UTCs, the number of cleared UTCs that were profitable at their source point and the number of cleared UTCs that were profitable at their sink point in the first three months of 2015 and 2016. In the first three months of 2016, 47.5 percent of all cleared UTC transactions were net profitable, with 70.2 percent of the source side profitable and 28.4 percent of the sink side profitable.

**Table 3-75 Cleared UTC profitability by source and sink point: January through March, 2015 and 2016<sup>71</sup>**

Jan-Mar	Cleared UTCs	Profitable UTCs	UTC		Profitable UTC	Profitable Source	Profitable Sink
			Profitable at Source Bus	Profitable at Sink Bus			
2015	1,926,421	1,021,066	1,303,225	672,857	53.0%	67.7%	34.9%
2016	4,549,904	2,160,463	3,192,971	1,290,673	47.5%	70.2%	28.4%

There are incentives to use virtual transactions to arbitrage price differences between the Day-Ahead and Real-Time Energy Markets, but there is no guarantee that such activity will result in price convergence and no data to support that claim. As a general matter, virtual offers and bids are based on expectations about both day-ahead and real-time energy market conditions and reflect the uncertainty about conditions in both markets and the fact that these conditions change hourly and daily. PJM markets do not provide a mechanism that could result in immediate convergence after a change in system conditions as there is at least a one day lag after any change in system conditions before offers could reflect such changes.

Substantial virtual trading activity does not guarantee that market power cannot be exercised in the Day-Ahead Energy Market. Hourly and daily price differences between the Day-Ahead and Real-Time Energy Markets fluctuate continuously and substantially from positive to negative. There may be

<sup>71</sup> Calculations exclude PJM administrative charges.

substantial, persistent differences between day-ahead and real-time prices even on a monthly basis (Figure 3-40).

Analysis of the data from September 1, 2013, through September 31, 2015, does not support the conclusion that UTCs contribute in any measurable way to price convergence. In addition, the sudden and significant reduction in UTC activity in September of 2014 did not cause a measurable change in price convergence.

Table 3-76 shows that the difference between the average real-time price and the average day-ahead price was  $-\$1.23$  per MWh in the first three months of 2015, and  $-\$1.30$  per MWh in the first three months of 2016. The difference between average peak real-time price and the average peak day-ahead price was  $-\$3.88$  per MWh in 2015 and  $-\$0.96$  per MWh in 2016.

**Table 3-76 Day-ahead and real-time average LMP (Dollars per MWh): January through March, 2015 and 2016<sup>72</sup>**

	Jan-Mar 2015				Jan-Mar 2016			
	Day Ahead	Real Time	Difference	Percent of Real Time	Day Ahead	Real Time	Difference	Percent of Real Time
Average	\$48.62	\$47.39	(\$1.23)	(2.6%)	\$26.90	\$25.60	(\$1.30)	(5.1%)
Median	\$35.48	\$31.95	(\$3.53)	(11.1%)	\$25.11	\$22.91	(\$2.20)	(9.6%)
Standard deviation	\$36.77	\$42.42	\$5.66	13.3%	\$8.83	\$12.99	\$4.15	32.0%
Peak average	\$57.47	\$53.60	(\$3.88)	(7.2%)	\$29.85	\$28.89	(\$0.96)	(3.3%)
Peak median	\$40.10	\$36.75	(\$3.35)	(9.1%)	\$27.68	\$24.72	(\$2.96)	(12.0%)
Peak standard deviation	\$44.14	\$46.67	\$2.54	5.4%	\$8.00	\$13.87	\$5.88	42.3%
Off peak average	\$40.88	\$41.96	\$1.08	2.6%	\$24.28	\$22.69	(\$1.59)	(7.0%)
Off peak median	\$31.35	\$28.53	(\$2.83)	(9.9%)	\$22.44	\$20.87	(\$1.57)	(7.5%)
Off peak standard deviation	\$26.50	\$37.50	\$11.01	29.3%	\$8.72	\$11.39	\$2.67	23.5%

The price difference between the Real-Time and the Day-Ahead Energy Markets results in part, from conditions in the Real-Time Energy Market that are difficult, or impossible, to anticipate in the Day-Ahead Energy Market.

Table 3-77 shows the difference between the real-time and the day-ahead energy market prices for the first three months of each year from 2001 through 2016.

<sup>72</sup> The averages used are the annual average of the hourly average PJM prices for day-ahead and real-time.

**Table 3-77 Day-ahead and real-time average LMP (Dollars per MWh): January through March, 2001 through 2016**

Jan-Mar	Day Ahead	Real Time	Difference	Percent of Real Time
2001	\$36.45	\$33.77	(\$2.68)	(7.9%)
2002	\$22.43	\$22.23	(\$0.20)	(0.9%)
2003	\$51.20	\$49.57	(\$1.63)	(3.3%)
2004	\$45.84	\$46.37	\$0.52	1.1%
2005	\$45.14	\$46.51	\$1.37	2.9%
2006	\$51.23	\$52.98	\$1.75	3.3%
2007	\$52.76	\$55.34	\$2.58	4.7%
2008	\$66.10	\$66.75	\$0.65	1.0%
2009	\$47.41	\$47.29	(\$0.12)	(0.3%)
2010	\$46.13	\$44.13	(\$2.00)	(4.5%)
2011	\$45.60	\$44.76	(\$0.84)	(1.9%)
2012	\$30.82	\$30.38	(\$0.43)	(1.4%)
2013	\$36.46	\$36.33	(\$0.13)	(0.4%)
2014	\$86.52	\$84.04	(\$2.48)	(2.9%)
2015	\$48.62	\$47.39	(\$1.23)	(2.6%)
2016	\$26.90	\$25.60	(\$1.30)	(5.1%)

Table 3-78 provides frequency distributions of the differences between PJM real-time hourly LMP and PJM day-ahead hourly LMP for the first three months of 2007 through 2016.

**Table 3-78 Frequency distribution by hours of PJM real-time LMP minus day-ahead LMP (Dollars per MWh): January through March, 2007 through 2016**

LMP	2007		2008		2009		2010		2011		2012		2013	
	Frequency	Cumulative Percent												
< (\$1,000)	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
(\$1,000) to (\$750)	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
(\$750) to (\$500)	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
(\$500) to (\$450)	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
(\$450) to (\$400)	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
(\$400) to (\$350)	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
(\$350) to (\$300)	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
(\$300) to (\$250)	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
(\$250) to (\$200)	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
(\$200) to (\$150)	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
(\$150) to (\$100)	0	0.00%	0	0.00%	0	0.00%	0	0.00%	1	0.05%	0	0.00%	0	0.00%
(\$100) to (\$50)	14	0.65%	21	0.96%	1	0.05%	5	0.23%	17	0.83%	2	0.09%	0	0.00%
(\$50) to \$0	1,214	56.88%	1,309	60.93%	1,347	62.44%	1,569	72.90%	1,464	68.64%	1,566	71.83%	1,542	71.42%
\$0 to \$50	847	96.11%	740	94.82%	788	98.93%	547	98.24%	619	97.31%	601	99.36%	587	98.61%
\$50 to \$100	73	99.49%	97	99.27%	21	99.91%	33	99.77%	51	99.68%	12	99.91%	23	99.68%
\$100 to \$150	7	99.81%	14	99.91%	2	100.00%	1	99.81%	6	99.95%	2	100.00%	3	99.81%
\$150 to \$200	0	99.81%	1	99.95%	0	100.00%	4	100.00%	1	100.00%	0	100.00%	3	99.95%
\$200 to \$250	1	99.86%	1	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	99.95%
\$250 to \$300	1	99.91%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	1	100.00%
\$300 to \$350	2	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
\$350 to \$400	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
\$400 to \$450	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
\$450 to \$500	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
\$500 to \$750	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
\$750 to \$1,000	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
\$1,000 to \$1,250	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
>= \$1,250	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%

**Table 3-78 Frequency distribution by hours of PJM real-time LMP minus day-ahead LMP (Dollars per MWh): January through March, 2007 through 2016 (continued)**

LMP	2014		2015		2016	
	Frequency	Cumulative Percent	Frequency	Cumulative Percent	Frequency	Cumulative Percent
< (\$1,000)	0	0.00%	0	0.00%	0	0.00%
(\$1,000) to (\$750)	2	0.09%	0	0.00%	0	0.00%
(\$750) to (\$500)	3	0.23%	0	0.00%	0	0.00%
(\$500) to (\$450)	1	0.28%	0	0.00%	0	0.00%
(\$450) to (\$400)	6	0.56%	0	0.00%	0	0.00%
(\$400) to (\$350)	5	0.79%	0	0.00%	0	0.00%
(\$350) to (\$300)	5	1.02%	0	0.00%	0	0.00%
(\$300) to (\$250)	6	1.30%	0	0.00%	0	0.00%
(\$250) to (\$200)	14	1.95%	0	0.00%	0	0.00%
(\$200) to (\$150)	14	2.59%	2	0.09%	0	0.00%
(\$150) to (\$100)	45	4.68%	12	0.65%	0	0.00%
(\$100) to (\$50)	88	8.75%	43	2.64%	0	0.00%
(\$50) to \$0	1,242	66.28%	1,504	72.30%	1,657	75.90%
\$0 to \$50	595	93.84%	516	96.20%	514	99.45%
\$50 to \$100	55	96.39%	54	98.70%	8	99.82%
\$100 to \$150	27	97.64%	21	99.68%	4	100.00%
\$150 to \$200	16	98.38%	5	99.91%	0	100.00%
\$200 to \$250	9	98.80%	1	99.95%	0	100.00%
\$250 to \$300	8	99.17%	1	100.00%	0	100.00%
\$300 to \$350	2	99.26%	0	100.00%	0	100.00%
\$350 to \$400	3	99.40%	0	100.00%	0	100.00%
\$400 to \$450	1	99.44%	0	100.00%	0	100.00%
\$450 to \$500	0	99.44%	0	100.00%	0	100.00%
\$500 to \$750	7	99.77%	0	100.00%	0	100.00%
\$750 to \$1,000	0	99.77%	0	100.00%	0	100.00%
\$1,000 to \$1,250	1	99.81%	0	100.00%	0	100.00%
>= \$1,250	4	100.00%	0	100.00%	0	100.00%

Figure 3-39 shows the hourly differences between day-ahead and real-time hourly LMP in the first three months of 2016.

**Figure 3-39 Real-time hourly LMP minus day-ahead hourly LMP: January through March, 2016**

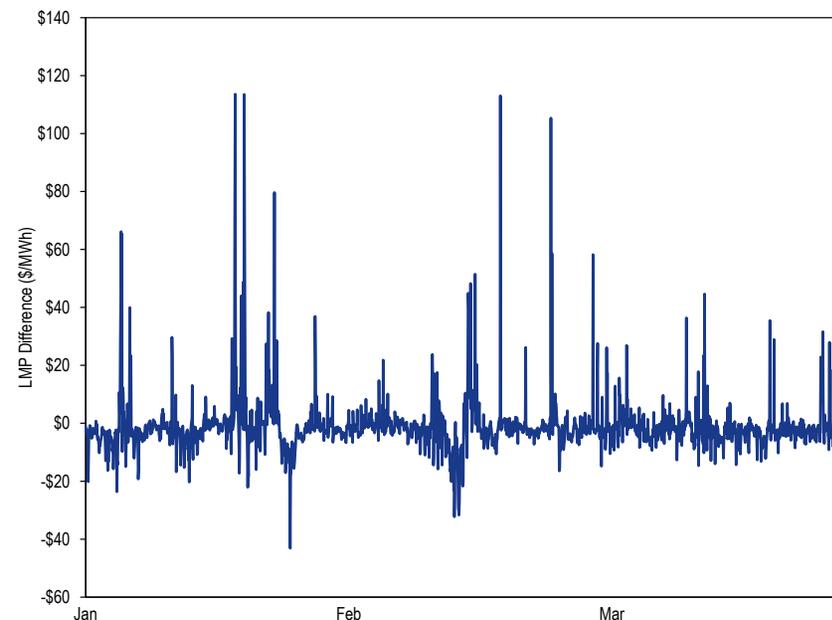


Figure 3-40 shows the monthly average differences between the day-ahead and real-time LMP from January 1, 2015, through March 31, 2016.

**Figure 3-40 Monthly average of real-time minus day-ahead LMP: January 2015 through March 2016**


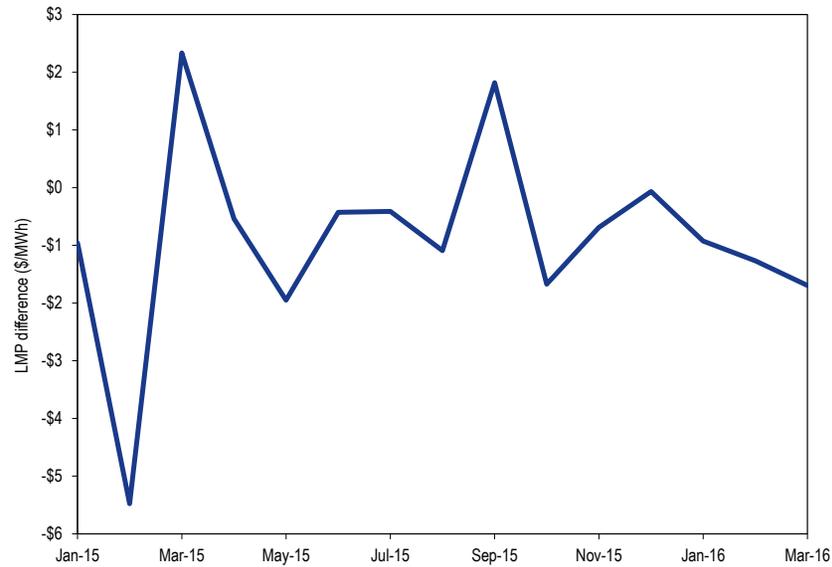


Figure 3-41 shows day-ahead and real-time LMP on an average hourly basis for the first three months of 2016.

**Figure 3-41 PJM system hourly average LMP: January through March, 2016**

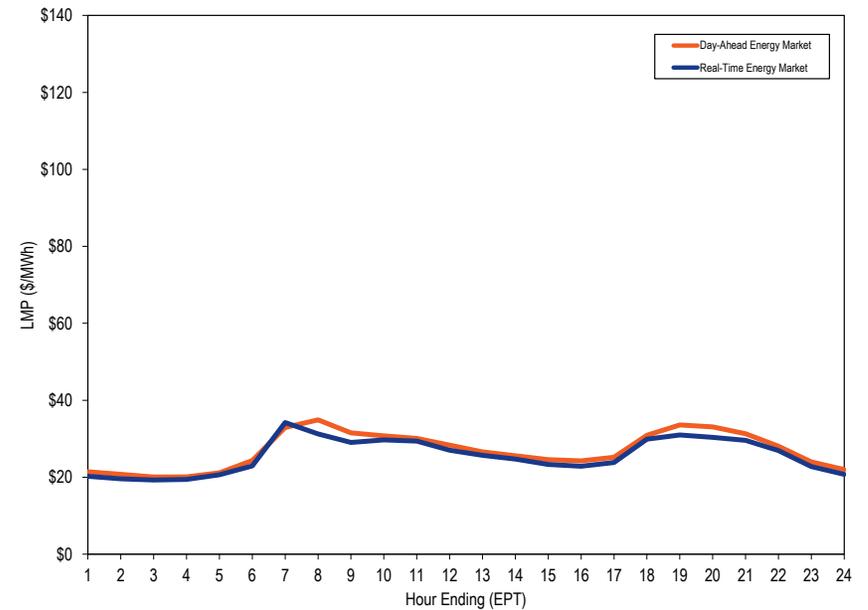

## Scarcity

PJM's Energy Market experienced no shortage pricing events in the first three months of 2016. Table 3-79 shows a summary of the number of days emergency alerts, warnings and actions were declared in PJM in the first three months of 2015 and 2016.

**Table 3-79 Summary of emergency events declared: January through March, 2015 and 2016**

Event Type	Number of days events declared	
	Jan - Mar, 2015	Jan - Mar, 2016
Cold Weather Alert	26	4
Hot Weather Alert	0	0
Maximum Emergency Generation Alert	0	0
Primary Reserve Alert	0	0
Voltage Reduction Alert	0	0
Primary Reserve Warning	0	0
Voltage Reduction Warning	0	0
Pre Emergency Mandatory Load Management Reduction Action	0	0
Emergency Load Management Long Lead Time	0	0
Emergency Load Management Short Lead Time	0	0
Maximum Emergency Action	0	0
Emergency Energy Bids Requested	0	0
Voltage Reduction Action	0	0
Shortage Pricing	0	0
Energy export recalls from PJM capacity resources	0	0

## Emergency procedures

PJM declares alerts at least a day prior to the operating day to warn members of possible emergency actions that could be taken during the operating day. In real time on the operating day, PJM issues warnings notifying members of system conditions that could result in emergency actions during the operating day.

PJM declared cold weather alerts on four days in the first three months of 2016 compared to 26 days in the first three months of 2015.<sup>73</sup> The purpose of a cold weather alert is to prepare personnel and facilities for expected

<sup>73</sup> See PJM. "Manual 13: Emergency Operations," Revision 59 (January 1, 2016), Section 3.3 Cold Weather Alert, p. 46.

extreme cold weather conditions, generally when temperatures are forecast to approach minimums or fall below ten degrees Fahrenheit.

PJM did not declare any hot weather alerts in the first three months of 2015 and 2016.<sup>74</sup> The purpose of a hot weather alert is to prepare personnel and facilities for expected extreme hot and humid weather conditions, generally when temperatures are forecast to exceed 90 degrees Fahrenheit with high humidity.

PJM did not declare any maximum emergency generation alert in the first three months of 2015 and 2016. The purpose of a maximum emergency generation alert is to provide an alert at least one day prior to the operating day that system conditions may require use of PJM emergency actions. It is called to alert PJM members that maximum emergency generation may be requested in the operating capacity.<sup>75</sup> This means that if PJM directs members to load maximum emergency generation during the operating day, the resources must be able to increase generation above the maximum economic level of their offer.

PJM did not declare any primary reserve alerts in the first three months of 2016 and 2015. The purpose of a primary reserve alert is to alert members at least one day prior to the operating day that available primary reserves are anticipated to be short of the primary reserve requirement on the operating day. It is issued when the estimated primary reserves are less than the forecast primary reserve requirement.

PJM did not declare any voltage reduction alert in the first three months of 2016 and 2015. The purpose of a voltage reduction alert is to alert members at least one day prior to the operating day that a voltage reduction may be required on the operating day. It is issued when the estimated operating reserve is less than the forecast synchronized reserve requirement.

PJM did not declare any primary reserve warning in the first three months of 2016 and 2015. The purpose of a primary reserve warning is to warn members

<sup>74</sup> See PJM. "Manual 13: Emergency Operations," Revision 59 (January 1, 2016), Section 3.4 Hot Weather Alert, p. 50.

<sup>75</sup> See PJM. "Manual 13: Emergency Operations," Revision 59 (January 1, 2016), Section 2.3.1 Advance Notice Emergency Procedures: Alerts, p. 17.

that available primary reserves are less than the primary reserve requirement but greater than the synchronized reserve requirement.

PJM did not declare any voltage reduction warnings and reductions of non-critical plant load in the first three months of 2016 and 2015. The purpose of a voltage reduction warning and reduction of non-critical plant load is to warn members that available synchronized reserves are less than the synchronized reserve requirement and that a voltage reduction may be required. It can be issued for the RTO or for specific control zones.

PJM did not declare any emergency mandatory load management reductions in the first three months of 2016 and 2015 in all or parts of the PJM service territory. The purpose of emergency mandatory load management is to request curtailment service providers (CSP) to implement load reductions from demand resources registered in PJM demand response programs that have a lead time of between one and two hours (long lead time) and a lead time of up to one hour (short lead time). Starting in June 2014, PJM combined the long lead and short lead emergency load management action procedures into Emergency Mandatory Load Management Reduction Action (30, 60 or 120 minute lead time). PJM dispatch declares NERC Energy Emergency Alert level 2 (EEA2) concurrent with Emergency Mandatory load Management Reductions. PJM also added a Pre-Emergency Mandatory Load Management Reduction Action (30, 60 or 120 minute lead time) step to request load reductions before declaring emergency load management reductions.

PJM did not declare any maximum emergency generation action in the first three months of 2016 and 2015. The purpose of a maximum emergency generation action is to request generators to increase output to the maximum emergency level which unit owners may define at a level above the maximum economic level. A maximum emergency generation action can be issued for the RTO, for specific control zones or for parts of control zones.

PJM did not request any bids for emergency energy purchases in the first three months of 2016 and 2015.

PJM did not declare any voltage reduction actions in the first three months of 2016 and 2015. The purpose of a voltage reduction is to reduce load to provide sufficient reserves, to maintain tie flow schedules, and to preserve limited energy sources. When a voltage reduction action is issued for a reserve zone or subzone, the primary reserve penalty factor and synchronized reserve penalty factor are incorporated into the synchronized and non-synchronized reserve market clearing prices and locational marginal prices until the voltage reduction action has been terminated.

PJM declared three synchronized reserve events in the first three months of 2016 compared to seven synchronized reserve events in the first three months of 2015.<sup>76</sup> Synchronized reserve events may occur at any time of the year due to sudden loss of generation or transmission facilities and do not necessarily coincide with capacity emergency conditions such as maximum generation emergency events or emergency load management events.

Table 3-80 provides a description of PJM declared emergency procedures.

<sup>76</sup> See 2016 Quarterly State of the Market Report for PJM, Section 10: Ancillary Service Markets for details on the spinning events.

Table 3–80 Description of emergency procedures

Emergency Procedure	Purpose
Cold Weather Alert	To prepare personnel and facilities for extreme cold weather conditions, generally when forecast weather conditions approach minimum or temperatures fall below ten degrees Fahrenheit.
Hot Weather Alert	To prepare personnel and facilities for extreme hot and/or humid weather conditions, generally when forecast temperatures exceed 90 degrees with high humidity.
Maximum Emergency Generation Alert	To provide an early alert at least one day prior to the operating day that system conditions may require the use of the PJM emergency procedures and resources must be able to increase generation above the maximum economic level of their offers.
Primary Reserve Alert	To alert members of a projected shortage of primary reserve for a future period. It is implemented when estimated primary reserve is less than the forecast requirement.
Voltage Reduction Alert	To alert members that a voltage reduction may be required during a future critical period. It is implemented when estimated reserve capacity is less than forecasted synchronized reserve requirement.
Pre-Emergency Load Management Reduction Action	To request load reductions from customers registered in the PJM Demand Response program that need 30, 60, or 120 minute lead time before declaring emergency load management reductions
Emergency Mandatory Load Management Reduction Action	To request load reductions from customers registered in the PJM Demand Response program that need 30, 60, or 120 minute lead time to provide additional load relief, generally declared simultaneously with NERC Energy Emergency Alert Level 2 (EEA2)
Primary Reserve Warning	To warn members that available primary reserve is less than required and present operations are becoming critical. It is implemented when available primary reserve is less than the primary reserve requirement but greater than the synchronized reserve requirement.
Maximum Emergency Generation Action	To provide real time notice to increase generation above the maximum economic level. It is implemented whenever generation is needed that is greater than the maximum economic level.
Voltage Reduction Warning & Reduction of Non-Critical Plant Load	To warn members that actual synchronized reserves are less than the synchronized reserve requirement and that voltage reduction may be required.
Manual Load Dump Warning	To warn members of the critical condition of present operations that may require manually dumping load. Issued when available primary reserve capacity is less than the largest operating generator or the loss of a transmission facility jeopardizes reliable operations after all other possible measures are taken to increase reserve.
Voltage Reduction Action	To reduce load to provide sufficient reserve capacity to maintain tie flow schedules and preserve limited energy sources. It is implemented when load relief is needed to maintain tie schedules.
Manual Load Dump Action	To provide load relief when all other possible means of supplying internal PJM RTO load have been used to prevent a catastrophe within the PJM RTO or to maintain tie schedules so as not to jeopardize the reliability of the other interconnected regions.

Table 3-81 shows the dates when emergency alerts and warnings were declared and when emergency actions were implemented in the first three months of 2016.

**Table 3-81 PJM declared emergency alerts, warnings and actions: January through March, 2016**

Dates	Cold Weather Alert	Maximum Emergency Generation Alert	Primary Reserve Alert	Voltage Reduction Alert	Primary Reserve Warning	Voltage Reduction Warning and Reduction of Non-Critical Plant Load	Maximum Emergency Generation Action	Pre-Emergency Mandatory Load Management Reduction	Emergency Mandatory Load Management Reduction	Voltage Reduction	Manual Load Dump Warning
1/18/2016	PJM Western Region										
1/19/2016	PJM Western Region										
2/13/2016	PJM Western Region										
2/15/2016	PJM except Dominion										

## Scarcity and Scarcity Pricing

In electricity markets, scarcity means that demand, including reserve requirements, is nearing the limits of the available capacity of the system. Under the PJM rules that were in place through September 30, 2012, high prices, or scarcity pricing, resulted from high offers by individual generation owners for specific units when the system was close to its available capacity. But this was not an efficient way to manage scarcity pricing and made it difficult to distinguish between market power and scarcity pricing.

On October 1, 2012, PJM introduced a new administrative scarcity pricing regime. Under the current PJM market rules, shortage pricing conditions are triggered when there is a shortage of synchronized or primary reserves in the RTO or in the Mid-Atlantic and Dominion (MAD) Subzone. In times of reserve shortage, the value of reserves is included as a penalty factor in the optimization and in the price of energy.<sup>77</sup> Shortage pricing is also triggered when PJM issues a voltage reduction action or a manual load dump action for a reserve zone or a reserve subzone. When shortage pricing is triggered, the primary reserve penalty factor and the synchronized reserve penalty factor are incorporated in the calculation of the synchronized and non-synchronized reserve market clearing prices and the locational marginal price.

In the first three months of 2016, there were no shortage pricing events triggered in PJM.

<sup>77</sup> See PJM OATT, 2.2 (d) General, (February 25, 2014), pp. 1815, 1819.

## NOPR on Shortage Pricing

On September 17, 2015, the Commission issued a Notice of Proposed Rulemaking (NOPR) in which the Commission proposed to address price formation issues in RTOs/ISOs (“price formation NOPR”).<sup>78</sup> In particular, the price formation NOPR proposes (i) to require the alignment of settlement and dispatch intervals for energy and operating reserves; and (ii) to require that each RTO/ISO trigger shortage pricing for any dispatch interval during which a shortage of energy or operating reserves occurs. These proposed reforms are intended to ensure that resources have price signals that provide incentives to conform their output to dispatch instructions, and that prices reflect operating needs at each dispatch interval.<sup>79</sup>

Currently in PJM, if the dispatch tools reflect shortage of reserves (primary or synchronized) for a time period shorter than a defined threshold (30 minutes in practice) due to ramp limitations or unit startup delays, it is considered a ‘transient shortage,’ a shortage event is not declared, and shortage pricing is not implemented. The rationale for having a minimum threshold time for a reserve shortage is to reflect the fact that the level of reserve measurement accuracy does not support a shorter time period. The rationale for including voltage reduction actions and manual load dump actions as triggers for shortage pricing is to reflect the fact that when dispatchers need to take these emergency actions to maintain reliability, the system is short reserves and prices should reflect that condition, even if the data does not show a shortage of reserves.<sup>80</sup>

<sup>78</sup> 152 FERC ¶ 61,218 (September 17, 2015).

<sup>79</sup> *Id.* at P 5.

<sup>80</sup> See, e.g., Scarcity and Shortage Pricing, Offer Mitigation and Offer Caps Workshop, Docket No. AD14-14-000, Transcript 29:21- 30:14 (Oct. 28, 2014).


If PJM were to move to a shortage pricing mechanism that is triggered by transient shortages, there needs to be accurate measurement of real time reserves that can support such a definition. That does not appear to be the case at present in PJM.

## PJM Cold Weather Operations 2016

### Natural gas supply and prices

As of January 1, 2016, gas fired generation was 34 percent (60,487.4 MW) of the total installed PJM capacity (177,682.8 MW).<sup>81</sup> The extreme cold weather conditions and the associated high demand for natural gas led to supply constraints on the gas transmission system which resulted in natural gas price volatility and interruptions to customers without firm transportation. Figure 3-42 shows the average daily price of delivered natural gas for eastern and western parts of PJM service territory in the first three months of 2015 and 2016.<sup>82</sup>

**Figure 3-42 Average daily delivered price for natural gas: January through March, 2015 and 2016 (\$/MMBtu)**

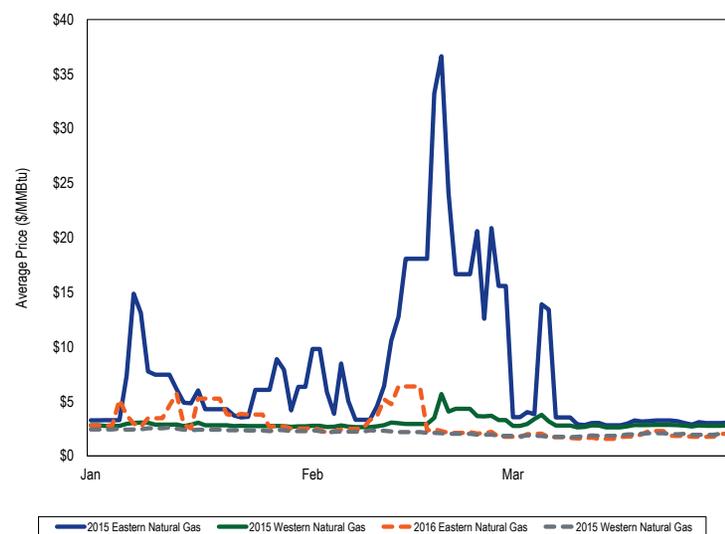

<sup>81</sup> 2016 Quarterly State of the Market Report for PJM: January through March, Section 5: Capacity Market, at Installed Capacity.

<sup>82</sup> Eastern natural gas consists of the average of Texas Eastern M3, Transco Zone 6 non-NY, Transco Zone 6 NY and Transco Zone 5 daily fuel price indices. Western natural gas prices are the average of Dominion North Point, Columbia Appalachia and Chicago City gate daily fuel price indices.

During the first three months of 2015 and 2016, a number of interstate gas pipelines that supply fuel for generators in the PJM service territory issued restriction notices limiting the availability of non-firm transportation services. These notices include warnings of operational flow orders (OFO) and actual OFOs. OFOs may restrict the provision of gas to 24 hour ratable takes which means that hourly nominations must be the same for each of the 24 hours in the day, with penalties for deviating from the nominated quantities. Pipelines may also enforce strict balancing constraints which limit the ability of gas users (without no notice service or storage service) to deviate from the 24 hour ratable take and which limit the ability of users to have access to unused gas.

Pipeline operators use restrictive and inflexible rules to manage the balance of supply and demand during extreme operating conditions. The independent operations of geographically overlapping pipelines during extreme conditions highlights the potential shortcomings of a gas pipeline network that relies on individual pipelines to manage the balancing of supply and demand. The independent operational restrictions imposed by pipelines and the impact on electric generators during extreme conditions suggests there may be potential benefits to creating an ISO/RTO structure to coordinate the supply of gas across pipelines and with the electric RTOs, or the creation of a gas supply coordination framework under existing electric ISO/RTOs.

## Energy Uplift (Operating Reserves)

Energy uplift is paid to market participants under specified conditions in order to ensure that resources are not required to operate for the PJM system at a loss.<sup>1</sup> Referred to in PJM as operating reserve credits, lost opportunity cost credits, reactive services credits, synchronous condensing credits or black start services credits, these payments are intended to be one of the incentives to generation owners to offer their energy to the PJM energy market for dispatch based on incremental offer curves and to operate their units at the direction of PJM dispatchers. These credits are paid by PJM market participants as operating reserve charges, reactive services charges, synchronous condensing charges or black start services charges.

In PJM all energy payments to demand response resources are also uplift payments. The energy payments to these resources are not part of the supply and demand balance, they are not paid by LMP revenues and therefore the energy payments to demand response resources have to be paid as out of market uplift. The energy payments to economic DR are funded by real-time load and real-time exports. The energy payments to emergency DR are funded by participants with net energy purchases in the Real-Time Energy Market.

## Overview

### Energy Uplift Results

- **Energy Uplift Charges.** Total energy uplift charges decreased by \$147.3 million, or 79.0 percent, in the first three months of 2016 compared to the first three months of 2015, from \$186.4 million to \$39.1 million.
- **Energy Uplift Charges Categories.** The decrease of \$147.3 million in the first three months of 2016 is comprised of a \$33.9 million decrease in day-ahead operating reserve charges, a \$102.7 million decrease in balancing operating reserve charges, a \$6.0 million decrease in reactive services charges, a \$0.0 million decrease in synchronous condensing charges and a \$4.7 million decrease in black start services charges.

<sup>1</sup> Loss is defined as gross energy and ancillary services market revenues less than total energy offer, which are startup, no load and incremental offers.

- **Average Effective Operating Reserve Rates in the Eastern Region.** Day-ahead load paid \$0.105 per MWh, real-time load paid \$0.031 per MWh, a DEC paid \$0.483 per MWh and an INC and any load, generation or interchange transaction deviation paid \$0.378 per MWh.
- **Average Effective Operating Reserve Rates in the Western Region.** Day-ahead load paid \$0.105 per MWh, real-time load paid \$0.031 per MWh, a DEC paid \$0.355 per MWh and an INC and any load, generation or interchange transaction deviation paid \$0.250 per MWh.
- **Reactive Services Rates.** The DPL, PENELEC and AEP control zones had the three highest local voltage support rates: \$0.049, \$0.002 and \$0.000 per MWh. The reactive transfer interface support rate averaged \$0.0000 per MWh.

## Characteristics of Credits

- **Types of units.** Combined cycles received 15.1 percent of all day-ahead generator credits and 24.0 percent of all balancing generator credits. Combustion turbines and diesels received 89.3 percent of the lost opportunity cost credits. Coal units received 0.0 percent of all reactive services credits.
- **Concentration of Energy Uplift Credits.** The top 10 units receiving energy uplift credits received 54.0 percent of all credits. The top 10 organizations received 86.9 percent of all credits. Concentration indexes for energy uplift categories classify them as highly concentrated. Day-ahead operating reserves HHI was 5397, balancing operating reserves HHI was 4165, and lost opportunity cost HHI was 5101.
- **Economic and Noneconomic Generation.** In the first three months of 2016, 88.1 percent of the day-ahead generation eligible for operating reserve credits was economic and 74.0 percent of the real-time generation eligible for operating reserve credits was economic.
- **Day-Ahead Unit Commitment for Reliability.** In the first three months of 2016, 3.1 percent of the total day-ahead generation MWh was scheduled as must run by PJM, of which 39.9 percent received energy uplift payments.

## Geography of Charges and Credits

- In the first three months of 2016, 91.2 percent of all uplift charges allocated regionally (day-ahead operating reserves and balancing operating reserves) were paid by transactions at control zones or buses within a control zone, demand and generation, 4.1 percent by transactions at hubs and aggregates and 4.7 percent by interchange transactions at interfaces.
- Generators in the Eastern Region received 70.3 percent of all balancing generator credits, including lost opportunity cost and canceled resources credits.
- Generators in the Western Region received 29.3 percent of all balancing generator credits, including lost opportunity cost and canceled resources credits.
- External generators received 0.4 percent of all balancing generator credits, including lost opportunity cost and canceled resources credits.

## Energy Uplift Issues

- **Lost Opportunity Cost Credits.** In the first three months of 2016, lost opportunity cost credits decreased by \$42.0 million compared to the first three months of 2015. In the first three months of 2016, resources in the top three control zones receiving lost opportunity cost credits, AEP, Dominion and ComEd, accounted for 64.7 percent of all lost opportunity cost credits, 50.1 percent of all day-ahead generation from pool-scheduled combustion turbines and diesels, 46.5 percent of all day-ahead generation not committed in real time by PJM from those unit types and 58.3 percent of all day-ahead generation not committed in real time by PJM and receiving lost opportunity cost credits from those unit types.
- **Con Edison – PJM Transmission Service Agreements Support.** Certain units located near the boundary between New Jersey and New York City have been operated to support the transmission service agreements between Con Ed and PJM, formerly known as the Con Ed – PSEG Wheeling Contracts. These units are often run out of merit and received substantial operating reserves credits.

## Energy Uplift Recommendations

- **Impact of Quantifiable Recommendations.** The impact of implementing the recommendations related to energy uplift proposed by the MMU on the rates paid by participants would be significant. For example, in the first three months of 2016, the average rate paid by a DEC in the Eastern Region would have been \$0.043 per MWh under the MMU proposal, which is \$0.440 per MWh, or 91.2 percent, lower than the actual average rate paid.

## Recommendations

The MMU recognizes that many of the issues addressed in the recommendations are being discussed in PJM stakeholder processes. Until new rules are in place, the MMU's recommendations and the reported status of those recommendations are based on the existing market rules.

- The MMU recommends that PJM not use closed loop interface constraints to artificially override the nodal prices that are based on fundamental LMP logic in order to: accommodate rather than resolve the inadequacies of the demand side resource capacity product; address the inability of the power flow model to incorporate the need for reactive power; accommodate rather than resolve the flaws in PJM's approach to scarcity pricing; or for any other reason. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM not use price setting logic to artificially override the nodal prices that are based on fundamental LMP logic in order to reduce uplift. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM initiate an analysis of the reasons why some combustion turbines and diesels scheduled in the Day-Ahead Energy Market are not called in real time when they are economic. (Priority: Medium. First Reported 2012. Status: Not adopted.)
- The MMU recommends that PJM clearly identify and classify all reasons for incurring operating reserves in the Day-Ahead and the Real-Time Energy Markets and the associated operating reserve charges in order for

all market participants to be made aware of the reasons for these costs and to help ensure a long term solution to the issue of how to allocate the costs of operating reserves. (Priority: Medium. First reported 2011. Status: Adopted 2014.)

- The MMU recommends that PJM revise the current operating reserve confidentiality rules in order to allow the disclosure of complete information about the level of operating reserve charges by unit and the detailed reasons for the level of operating reserve credits by unit in the PJM region. (Priority: High. First reported 2013. Status: Partially adopted.)
- The MMU recommends the elimination of the day-ahead operating reserve category to ensure that units receive an energy uplift payment based on their real-time output and not their day-ahead scheduled output. (Priority: Medium. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends reincorporating the use of net regulation revenues as an offset in the calculation of balancing operating reserve credits. (Priority: Medium. First reported 2009. Status: Not adopted. Stakeholder process.)
- The MMU recommends not compensating self-scheduled units for their startup cost when the units are scheduled by PJM to start before the self-scheduled hours. (Priority: Low. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends seven modifications to the energy lost opportunity cost calculations:
  - The MMU recommends that the lost opportunity cost in the energy market be calculated using the schedule on which the unit was scheduled to run in the energy market. (Priority: High. First reported 2012. Status: Adopted 2015.)
  - The MMU recommends including no load and startup costs as part of the total avoided costs in the calculation of lost opportunity cost credits paid to combustion turbines and diesels scheduled in the Day-Ahead Energy Market but not committed in real time. (Priority: Medium. First reported 2012. Status: Adopted 2015.)
  - The MMU recommends using the entire offer curve and not a single point on the offer curve to calculate energy lost opportunity cost. (Priority: Medium. First reported 2012. Status: Adopted 2015.)
  - The MMU recommends calculating LOC based on 24 hour daily periods or multi-hour segments of hours for combustion turbines and diesels scheduled in the Day-Ahead Energy Market but not committed in real time. (Priority: Medium. First reported 2014. Status: Not adopted.)
  - The MMU recommends that units scheduled in the Day-Ahead Energy Market and not committed in real time should be compensated for LOC based on their real-time desired and achievable output, not their scheduled day-ahead output. (Priority: Medium. First reported 2015. Status: Not adopted.)
  - The MMU recommends that units scheduled in the Day-Ahead Energy Market and not committed in real time be compensated for LOC incurred within an hour. (Priority: Medium. First reported 2013. Status: Not adopted.)
  - The MMU recommends that only flexible fast start units (startup plus notification times of 30 minutes or less) and short minimum run times (one hour or less) be eligible by default for the LOC compensation to units scheduled in the Day-Ahead Energy Market and not committed in real time. Other units should be eligible for LOC compensation only if PJM explicitly cancels their day-ahead commitment. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that up to congestion transactions be required to pay energy uplift charges. (Priority: High. First reported 2011. Status: Not adopted. Stakeholder process.)
- The MMU recommends eliminating the use of internal bilateral transactions (IBTs) in the calculation of deviations used to allocate balancing operating reserve charges. (Priority: High. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends allocating the energy uplift payments to units scheduled as must run in the Day-Ahead Energy Market for reasons other than voltage/reactive or black start services as a reliability charge to real-

time load, real-time exports and real-time wheels. (Priority: Medium. First reported 2014. Status: Not adopted. Stakeholder process.)

- The MMU recommends reallocating the operating reserve credits paid to units supporting the Con Edison – PJM Transmission Service Agreements. (Priority: Medium. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends that the total cost of providing reactive support be categorized and allocated as reactive services. Reactive services credits should be calculated consistent with the operating reserve credits calculation. (Priority: Medium. First reported 2012. Status: Not adopted. Stakeholder process.)
- The MMU recommends including real-time exports and real-time wheels in the allocation of the cost of providing reactive support to the 500 kV system or above, which is currently allocated solely to real-time RTO load. (Priority: Low. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends enhancing the current energy uplift allocation rules to reflect the elimination of day-ahead operating reserves, the timing of commitment decisions and the commitment reasons. (Priority: High. First reported Q2, 2012. Status: Not adopted. Stakeholder process.)

## Conclusion

Energy uplift is paid to market participants under specified conditions in order to ensure that resources are not required to operate for the PJM system at a loss. Referred to in PJM as day-ahead operating reserves, balancing operating reserves, energy lost opportunity cost credits, reactive services credits, synchronous condensing credits or black start services credits, these payments are intended to be one of the incentives to generation owners to offer their energy to the PJM energy market at marginal cost and to operate their units at the direction of PJM dispatchers. These credits are paid by PJM market participants as operating reserve charges, reactive services charges, synchronous condensing charges or black start charges.

In PJM all energy payments to demand response resources are also uplift payments. The energy payments to these resources are not part of the supply and demand balance, they are not paid by LMP revenues and therefore the energy payments to demand response resources have to be paid as out of market uplift. The energy payments to economic DR are funded by real-time load and real-time exports. The energy payments to emergency DR are funded by participants with net energy purchases in the Real-Time Energy Market.

From the perspective of those participants paying energy uplift charges, these costs are an unpredictable and unhedgeable component of participants' costs in PJM. While energy uplift charges are an appropriate part of the cost of energy, market efficiency would be improved by ensuring that the level and variability of these charges are as low as possible consistent with the reliable operation of the system and that the allocation of these charges reflects the reasons that the costs are incurred to the extent possible.

The goal should be to reflect the impact of physical constraints in market prices to the maximum extent possible and thus to reduce the necessity for out of market energy uplift payments. When units receive substantial revenues through energy uplift payments, these payments are not transparent to the market because of the current confidentiality rules. As a result, other market participants, including generation and transmission developers, do not have the opportunity to compete to displace them. As a result, substantial energy uplift payments to a concentrated group of units and organizations has persisted for more than ten years.

One part of addressing the level and allocation of uplift payments is to eliminate all day-ahead operating reserve credits. It is illogical and unnecessary to pay units day-ahead operating reserve credits because units do not incur any costs to run and any revenue shortfalls are addressed by balancing operating reserve credits.

The level of energy uplift paid to specific units depends on the level of the unit's energy offer, the unit's operating parameters, the details of the rules which define payments and the decisions of PJM operators. Energy

uplift payments result in part from decisions by PJM operators, who follow reliability requirements and market rules, to start units or to keep units operating even when hourly LMP is less than the offer price including energy, no load and startup costs. Energy uplift payments also result from units' operational parameters that may require PJM to schedule or commit resources during noneconomic hours. The balance of these costs not covered by energy revenues are collected as energy uplift rather than reflected in price as a result of the rules governing the determination of LMP.

PJM's goal should be to minimize the total level of energy uplift paid and to ensure that the associated charges are paid by all those whose market actions result in the incurrence of such charges. For example, up to congestion transactions continue to pay no energy uplift charges, which means that all others who pay these charges are paying too much. In addition, the netting of transactions against internal bilateral transactions should be eliminated. The goal should be to minimize the total incurred energy uplift charges and to increase the transactions over which those charges are spread in order to reduce the impact of energy uplift charges on markets. The result would be to reduce the level of per MWh charges, to reduce the uncertainty associated with uplift charges and to reduce the impact of energy uplift charges on decisions about how and when to participate in PJM markets.

But it is also important that the reduction of uplift payments not be a goal to be achieved at the expense of the fundamental logic of an LMP system. For example, the use of closed loop interfaces to reduce uplift should be eliminated because it is not consistent with LMP fundamentals and constitutes a form of subjective price setting. The same is true of what PJM terms its price setting logic.

## Energy Uplift

The level of energy uplift credits paid to specific units depends on the level of the resource's energy offer, the LMP, the resource's operating parameters and the decisions of PJM operators. Energy uplift credits result in part from decisions by PJM operators, who follow reliability requirements and market rules, to start resources or to keep resources operating even when hourly LMP is less than the offer price including energy, no load and startup costs.

## Credits and Charges Categories

Energy uplift charges include day-ahead and balancing operating reserves, reactive services, synchronous condensing and black start services categories. Total energy uplift credits paid to PJM participants equal the total energy uplift charges paid by PJM participants. Table 4-1 and Table 4-2 show the categories of credits and charges and their relationship. These tables show how the charges are allocated.

**Table 4-1 Day-ahead and balancing operating reserve credits and charges**

Credits Received For:	Credits Category:	Charges Category:	Charges Paid By:
<b>Day-Ahead</b>			
Day-Ahead Import Transactions and Generation Resources	Day-Ahead Operating Reserve Transaction Day-Ahead Operating Reserve Generator	→ Day-Ahead Operating Reserve	Day-Ahead Load Day-Ahead Export Transactions Decrement Bids in RTO Region
Economic Load Response Resources	Day-Ahead Operating Reserves for Load Response	→ Day-Ahead Operating Reserve for Load Response	Day-Ahead Load Day-Ahead Export Transactions Decrement Bids in RTO Region
Unallocated Negative Load Congestion Charges Unallocated Positive Generation Congestion Credits		→ Unallocated Congestion	Day-Ahead Load Day-Ahead Export Transactions Decrement Bids in RTO Region
<b>Balancing</b>			
Generation Resources	Balancing Operating Reserve Generator	→ Balancing Operating Reserve for Reliability Balancing Operating Reserve for Deviations Balancing Local Constraint	Real-Time Load plus Real-Time Export Transactions Deviations Applicable Requesting Party in RTO, Eastern or Western Region
Canceled Resources Lost Opportunity Cost (LOC)	Balancing Operating Reserve Startup Cancellation Balancing Operating Reserve LOC	→ Balancing Operating Reserve for Deviations	Deviations in RTO Region
Real-Time Import Transactions	Balancing Operating Reserve Transaction		
Economic Load Response Resources	Balancing Operating Reserves for Load Response	→ Balancing Operating Reserve for Load Response	Deviations in RTO Region

**Table 4-2 Reactive services, synchronous condensing and black start services credits and charges**

Credits Received For:	Credits Category:	Charges Category:	Charges Paid By:
<b>Reactive</b>			
Resources Providing Reactive Service	Day-Ahead Operating Reserve Reactive Services Generator Reactive Services LOC Reactive Services Condensing Reactive Services Synchronous Condensing LOC	→ Reactive Services Charge Reactive Services Local Constraint	Zonal Real-Time Load Applicable Requesting Party
<b>Synchronous Condensing</b>			
Resources Providing Synchronous Condensing	Synchronous Condensing Synchronous Condensing LOC	→ Synchronous Condensing	Real-Time Load Real-Time Export Transactions
<b>Black Start</b>			
Resources Providing Black Start Service	Day-Ahead Operating Reserve Balancing Operating Reserve Black Start Testing	→ Black Start Service Charge	Zone/Non-zone Peak Transmission Use and Point to Point Transmission Reservations

## Energy Uplift Results

### Energy Uplift Charges

Total energy uplift charges decreased by \$147.3 million or 79.0 percent in the first three months of 2016 compared to the first three months of 2015. Table 4-3 shows total energy uplift charges in the first three months of the years 2001 through 2016.<sup>2</sup>

**Table 4-3 Total energy uplift charges: January through March, 2001 through 2016**

(Jan-Mar)	Total Energy Uplift Charges (Millions)	Change (Millions)	Percent Change
2001	\$63.4	NA	NA
2002	\$26.7	(\$36.7)	(57.9%)
2003	\$97.9	\$71.2	266.6%
2004	\$98.7	\$0.9	0.9%
2005	\$109.0	\$10.3	10.4%
2006	\$69.8	(\$39.2)	(35.9%)
2007	\$113.0	\$43.2	61.8%
2008	\$103.9	(\$9.1)	(8.1%)
2009	\$101.7	(\$2.2)	(2.1%)
2010	\$105.7	\$4.1	4.0%
2011	\$130.3	\$24.6	23.2%
2012	\$122.7	(\$7.6)	(5.9%)
2013	\$258.9	\$136.2	111.0%
2014	\$742.8	\$483.9	186.9%
2015	\$186.4	(\$556.3)	(74.9%)
2016	\$39.1	(\$147.3)	(79.0%)

Table 4-4 compares energy uplift charges by category for the first three months of 2015 and 2016. The decrease of \$147.3 million in the first three months of 2016 is comprised of a decrease of \$33.9 million in day-ahead operating reserve charges, a decrease of \$102.7 million in balancing operating reserve charges, a decrease of \$6.0 million in reactive services charges, no change in synchronous condensing charges and a decrease of \$4.7 million in black start services charges.

<sup>2</sup> Table 4-3 includes all categories of charges as defined in Table 4-1 and Table 4-2 and includes all PJM Settlements billing adjustments. Billing data can be modified by PJM Settlements at any time to reflect changes in the evaluation of energy uplift. The billing data reflected in this report were current on April 20, 2016.

The decrease in total energy uplift charges was mainly a result of low natural gas prices in the first three months of 2016 compared to the first three months of 2016.

**Table 4-4 Energy uplift charges by category: January through March 2015 and 2016**

Category	Jan - Mar 2015 Charges (Millions)	Jan - Mar 2016 Charges (Millions)	Change (Millions)	Percent Change
Day-Ahead Operating Reserves	\$55.2	\$21.3	(\$33.9)	(61.4%)
Balancing Operating Reserves	\$120.2	\$17.5	(\$102.7)	(85.4%)
Reactive Services	\$6.3	\$0.3	(\$6.0)	(96.0%)
Synchronous Condensing	\$0.0	\$0.0	\$0.0	0.0%
Black Start Services	\$4.7	\$0.0	(\$4.7)	(99.6%)
Total	\$186.4	\$39.1	(\$147.3)	(79.0%)

The decrease in energy uplift charges in the first three months of 2016 was greatest for February. Total energy uplift charges decreased by \$92.1 million from February 2015. Table 4-5 compares monthly energy uplift charges by category for 2015 and 2016.

Table 4-5 Monthly energy uplift charges: 2015 and 2016

	2015 Charges (Millions)						2016 Charges (Millions)					
	Day-Ahead	Balancing	Reactive Services	Synchronous Condensing	Black Start Services	Total	Day-Ahead	Balancing	Reactive Services	Synchronous Condensing	Black Start Services	Total
Jan	\$16.8	\$24.5	\$1.8	\$0.0	\$1.7	\$44.8	\$7.4	\$7.5	\$0.00	\$0.0	\$0.0	\$14.9
Feb	\$31.4	\$71.0	\$2.4	\$0.0	\$1.1	\$105.9	\$7.6	\$6.2	\$0.0	\$0.0	\$0.0	\$13.9
Mar	\$7.0	\$24.7	\$2.1	\$0.0	\$1.9	\$35.8	\$6.4	\$3.8	\$0.2	\$0.0	\$0.0	\$10.3
Apr	\$3.1	\$8.5	\$1.7	\$0.0	\$0.1	\$13.4						
May	\$5.7	\$15.4	\$0.7	\$0.0	\$0.2	\$22.0						
Jun	\$9.1	\$8.6	\$0.5	\$0.0	\$0.0	\$18.2						
Jul	\$5.1	\$11.9	\$0.1	\$0.0	\$0.0	\$17.1						
Aug	\$4.5	\$9.0	\$0.1	\$0.0	\$0.0	\$13.6						
Sep	\$4.1	\$8.9	\$0.6	\$0.0	\$0.0	\$13.7						
Oct	\$3.0	\$5.5	\$0.4	\$0.0	\$0.1	\$9.0						
Nov	\$4.3	\$6.3	\$0.1	\$0.0	\$0.0	\$10.7						
Dec	\$4.6	\$4.2	\$0.1	\$0.0	\$0.0	\$8.9						
Total (Jan - Mar)	\$55.2	\$120.2	\$6.3	\$0.0	\$4.7	\$186.4	\$21.3	\$17.5	\$0.3	\$0.0	\$0.0	\$39.1
Share (Jan - Mar)	\$0.3	\$0.6	\$0.0	\$0.0	\$0.0	\$1.0	\$0.5	\$0.4	\$0.0	\$0.0	\$0.0	\$1.0
Total	\$98.7	\$198.7	\$10.5	\$0.0	\$5.2	\$313.1	\$21.3	\$17.5	\$0.3	\$0.0	\$0.0	\$39.1
Share	\$0.3	\$0.6	\$0.0	\$0.0	\$0.0	\$1.0	\$0.5	\$0.4	\$0.0	\$0.0	\$0.0	\$1.0

Table 4-6 shows the composition of the day-ahead operating reserve charges. Day-ahead operating reserve charges consist of day-ahead operating reserve charges that pay for credits to generators and import transactions, day-ahead operating reserve charges for economic load response resources and day-ahead operating reserve charges from unallocated congestion charges.<sup>3</sup> Day-ahead operating reserve charges decreased by \$33.9 million or 61.4 percent in the first three months of 2016 compared to 2015. Day-ahead operating reserve charges remain high primarily because of uplift payments to units scheduled as must run by PJM. Units are typically scheduled as must run by PJM in the Day-Ahead Energy Market when the day-ahead model does not reflect certain real-time conditions or requirements (for example, reactive or ALR black start) or when units have parameters that extend beyond the 24 hour day-ahead model.

Table 4-6 Day-ahead operating reserve charges: January through March, 2015 and 2016

Type	Jan - Mar 2015 Charges (Millions)	Jan - Mar 2016 Charges (Millions)	Change (Millions)	Jan - Mar 2015 Share	Jan - Mar 2016 Share
Day-Ahead Operating Reserve Charges	\$55.0	\$21.3	(\$33.7)	99.7%	100.0%
Day-Ahead Operating Reserve Charges for Load Response	\$0.2	\$0.0	(\$0.2)	0.3%	0.0%
Unallocated Congestion Charges	\$0.0	\$0.0	\$0.0	0.0%	0.0%
Total	\$55.2	\$21.3	(\$33.9)	100.0%	100.0%

<sup>3</sup> See PJM. OATT Attachment K-Appendix § 3.2.3 (c). Unallocated congestion charges are added to the total costs of day-ahead operating reserves. Congestion charges have been allocated to day-ahead operating reserves ten times, totaling \$26.9 million.

Table 4-7 shows the composition of the balancing operating reserve charges. Balancing operating reserve charges consist of balancing operating reserve reliability charges (credits to generators), balancing operating reserve deviation charges (credits to generators and import transactions), balancing operating reserve charges for economic load response and balancing local constraint charges. Balancing operating reserve charges decreased by \$102.7 million in the first three months of 2016 compared to 2015.

**Table 4-7 Balancing operating reserve charges: January through March, 2015 and 2016**

Type	Jan - Mar 2015 Charges (Millions)	Jan - Mar 2016 Charges (Millions)	Change (Millions)	Jan - Mar 2015 Share	Jan - Mar 2016 Share
Balancing Operating Reserve Reliability Charges	\$22.1	\$5.0	(\$17.0)	18.4%	28.7%
Balancing Operating Reserve Deviation Charges	\$98.0	\$12.4	(\$85.6)	81.5%	70.9%
Balancing Operating Reserve Charges for Load Response	\$0.1	\$0.0	(\$0.1)	0.0%	0.0%
Balancing Local Constraint Charges	\$0.1	\$0.1	(\$0.0)	0.1%	0.3%
Total	\$120.2	\$17.5	(\$102.7)	100.0%	100.0%

Table 4-8 shows the composition of the balancing operating reserve deviation charges. Balancing operating reserve deviation charges equal make whole credits paid to generators and import transactions, energy lost opportunity costs paid to generators and payments to resources canceled by PJM before coming online. In the first three months of 2016, 63.7 percent of balancing operating reserve deviation charges were for make whole credits paid to generators and import transactions, an increase of 11.3 percentage points compared to the share in the first three months of 2015.

**Table 4-8 Balancing operating reserve deviation charges: January through March, 2015 and 2016**

Charge Attributable To	Jan - Mar 2015 Charges (Millions)	Jan - Mar 2016 Charges (Millions)	Change (Millions)	Jan - Mar 2015 Share	Jan - Mar 2016 Share
Make Whole Payments to Generators and Imports	\$51.4	\$7.9	(\$43.4)	52.4%	63.7%
Energy Lost Opportunity Cost	\$46.6	\$4.5	(\$42.0)	47.5%	36.2%
Canceled Resources	\$0.1	\$0.0	(\$0.1)	0.1%	0.0%
Total	\$98.0	\$12.4	(\$85.6)	100.0%	100.0%

Table 4-9 shows reactive services, synchronous condensing and black start services charges. Reactive services charges decreased by \$6.0 million in the first three months of 2016 compared to 2015. Black start services charges decreased by \$4.7 million in the first three months of 2016 compared to 2015 as a result of the replacement of black start units under the ALR (automatic load rejection) option in the second quarter of 2015.

**Table 4-9 Additional energy uplift charges: January through March, 2015 and 2016**

Type	Jan - Mar 2015 Charges (Millions)	Jan - Mar 2016 Charges (Millions)	Change (Millions)	Jan - Mar 2015 Share	Jan - Mar 2016 Share
Reactive Services Charges	\$6.3	\$0.3	(\$6.0)	57.2%	93.7%
Synchronous Condensing Charges	\$0.0	\$0.0	\$0.0	0.0%	0.0%
Black Start Services Charges	\$4.7	\$0.0	(\$4.7)	42.8%	6.3%
Total	\$11.0	\$0.3	(\$10.7)	100.0%	100.0%

Table 4-10 and Table 4-11 show the amount and percent shares of regional balancing charges in the first three months of 2015 and 2016. Regional balancing operating reserve charges consist of balancing operating reserve reliability and deviation charges. These charges are allocated regionally across PJM. The largest share of regional charges was paid by demand deviations. The regional balancing charges allocation table does not include charges attributed for resources controlling local constraints.

In the first three months of 2016, regional balancing operating reserve charges decreased by \$102.6 million compared to the first three months of 2015. Balancing operating reserve reliability charges decreased by \$17.0 million or 77.2 percent and balancing operating reserve deviation charges decreased by \$85.6 million or 87.3 percent.

**Table 4-10 Regional balancing charges allocation (Millions): January through March, 2015**

Charge	Allocation	RTO		East		West		Total	
Reliability Charges	Real-Time Load	\$19.3	16.0%	\$1.8	1.5%	\$0.5	0.4%	\$21.6	18.0%
	Real-Time Exports	\$0.4	0.4%	\$0.1	0.1%	\$0.0	0.0%	\$0.5	0.4%
	Total	\$19.7	16.4%	\$1.9	1.6%	\$0.5	0.4%	\$22.1	18.4%
Deviation Charges	Demand	\$53.4	44.5%	\$1.2	1.0%	\$0.6	0.5%	\$55.2	46.0%
	Supply	\$16.3	13.6%	\$0.4	0.3%	\$0.2	0.2%	\$16.9	14.1%
	Generator	\$25.2	21.0%	\$0.5	0.4%	\$0.2	0.2%	\$25.9	21.6%
	Total	\$95.0	79.1%	\$2.0	1.7%	\$1.1	0.9%	\$98.0	81.6%
Total Regional Balancing Charges		\$114.7	95.5%	\$3.9	3.2%	\$1.6	1.3%	\$120.1	100%

**Table 4-11 Regional balancing charges allocation (Millions): January through March, 2016**

Charge	Allocation	RTO		East		West		Total	
Reliability Charges	Real-Time Load	\$3.2	18.0%	\$1.7	9.5%	\$0.1	0.7%	\$4.9	28.2%
	Real-Time Exports	\$0.1	0.3%	\$0.1	0.3%	\$0.0	0.0%	\$0.1	0.6%
	Total	\$3.2	18.4%	\$1.7	9.8%	\$0.1	0.7%	\$5.0	28.8%
Deviation Charges	Demand	\$5.1	28.9%	\$1.8	10.6%	\$0.1	0.6%	\$7.0	40.1%
	Supply	\$1.9	11.0%	\$0.5	2.7%	\$0.0	0.2%	\$2.4	14.0%
	Generator	\$2.2	12.3%	\$0.8	4.5%	\$0.0	0.2%	\$3.0	17.0%
	Total	\$9.1	52.3%	\$3.1	17.8%	\$0.2	1.1%	\$12.4	71.2%
Total Regional Balancing Charges		\$12.3	70.7%	\$4.8	27.6%	\$0.3	1.8%	\$17.5	100%

## Operating Reserve Rates

Under the operating reserves cost allocation rules, PJM calculates nine separate rates, a day-ahead operating reserve rate, a reliability rate for each region, a deviation rate for each region, a lost opportunity cost rate and a canceled resources rate for the entire RTO region. See Table 4-1 for how these charges are allocated.<sup>4</sup>

Figure 4-1 shows the daily day-ahead operating reserve rate for the first three months of 2015 and 2016. The average rate in the first three months of 2016 was \$0.103 per MWh, \$0.143 per MWh lower than the average in the first three months of 2015. The highest rate in the first three months of 2016 occurred on February 16, when the rate reached \$0.402 per MWh, \$1.198 per MWh lower than the \$1.600 per MWh reached in the first three months of 2015, also on February 16. Figure 4-1 also shows the daily day-ahead operating reserve rate including the congestion charges allocated to day-ahead operating reserves. There were no congestion charges allocated to day-ahead operating reserves in 2015 and 2016.

<sup>4</sup> The lost opportunity cost and canceled resources rates are not posted separately by PJM. PJM adds the lost opportunity cost and the canceled resources rates to the deviation rate for the RTO region since these three charges are allocated following the same rules.

Figure 4-1 Daily day-ahead operating reserve rate (\$/MWh): 2015 and 2016

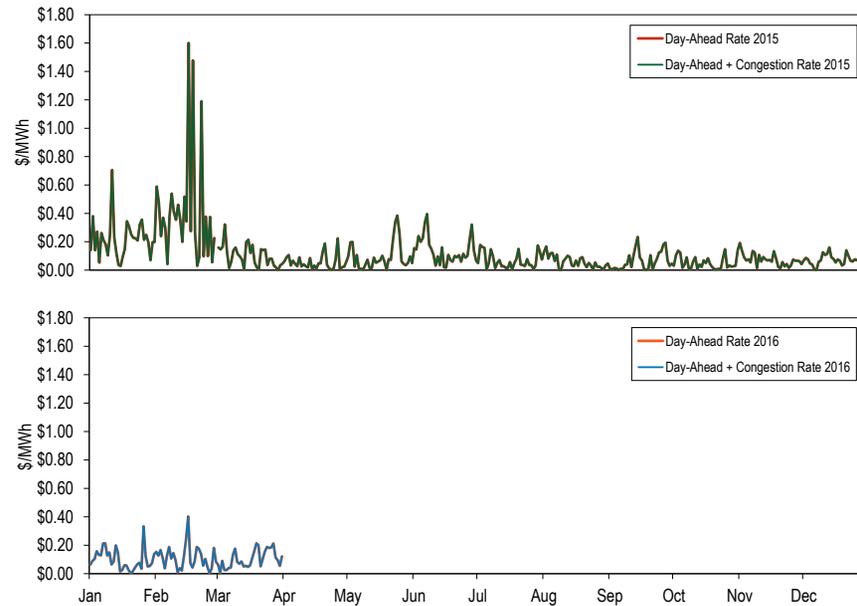


Figure 4-2 shows the RTO and the regional reliability rates for 2015 and first three months of 2016. The average daily RTO reliability rate was \$0.016 per MWh. The highest RTO reliability rate in the first three months of 2016 occurred on January 19, when the rate reached \$0.085 per MWh, \$0.687 per MWh lower than the \$0.772 per MWh rate reached in the first three months of 2015, on February 19.

Figure 4-2 Daily balancing operating reserve reliability rates (\$/MWh): 2015 and 2016

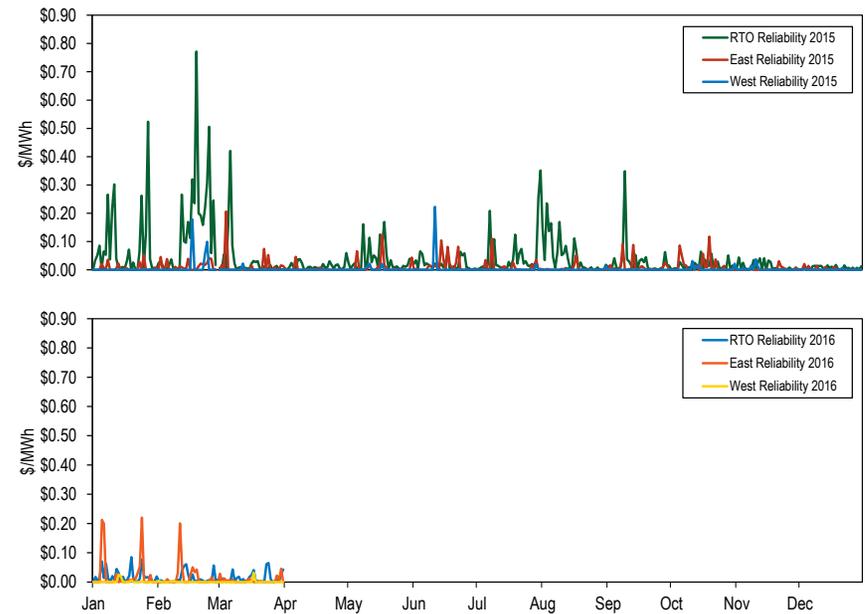


Figure 4-3 shows the RTO and regional deviation rates for 2015 and 2016. The average daily RTO deviation rate was \$0.126 per MWh. The highest daily rate in the first three months of 2016 occurred on January 19, when the RTO deviation rate reached \$0.817 per MWh, \$11.691 per MWh lower than the \$12.507 per MWh rate reached in the first three months of 2015, on February 17.

Figure 4-3 Daily balancing operating reserve deviation rates (\$/MWh): 2015 and 2016

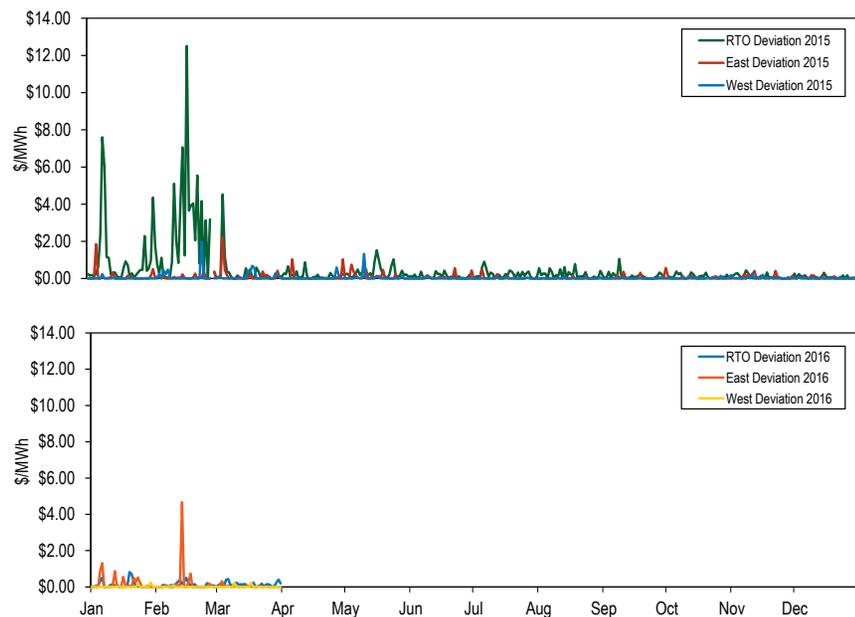


Figure 4-4 Daily lost opportunity cost and canceled resources rates (\$/MWh): 2015 and 2016

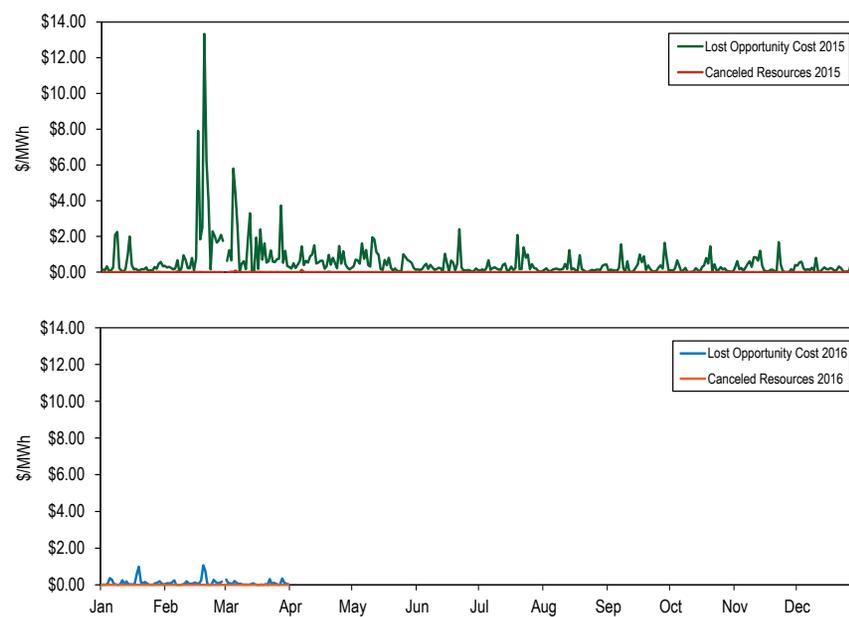


Figure 4-4 shows the daily lost opportunity cost rate and the daily canceled resources rate for 2015 and 2016. The lost opportunity cost rate averaged \$0.122 per MWh. The highest lost opportunity cost rate occurred on February 19, when it reached \$1.066 per MWh, \$12.264 per MWh lower than the \$13.330 per MWh rate reached in 2015, February 19.

Table 4-12 shows the average rates for each region in each category in the first three months of 2015 and 2016.

**Table 4-12 Operating reserve rates (\$/MWh): January through March, 2015 and 2016**

Rate	Jan - Mar 2015 (\$/MWh)	Jan - Mar 2016 (\$/MWh)	Difference (\$/MWh)	Percent Difference
Day-Ahead	0.246	0.103	(0.143)	(58.1%)
Day-Ahead with Unallocated Congestion	0.246	0.103	(0.143)	(58.1%)
RTO Reliability	0.091	0.016	(0.075)	(82.2%)
East Reliability	0.018	0.018	0.000	0.9%
West Reliability	0.004	0.001	(0.003)	(75.5%)
RTO Deviation	1.415	0.126	(1.289)	(91.1%)
East Deviation	0.113	0.157	0.044	39.0%
West Deviation	0.065	0.011	(0.054)	(82.5%)
Lost Opportunity Cost	1.364	0.122	(1.241)	(91.0%)
Canceled Resources	0.003	0.000	(0.003)	(97.7%)

Table 4-13 shows the operating reserve cost of a one MW transaction in the first three months of 2016. For example, a decrement bid in the Eastern Region (if not offset by other transactions) paid an average rate of \$0.483 per MWh with a maximum rate of \$4.907 per MWh, a minimum rate of \$0.047 per MWh and a standard deviation of \$0.597 per MWh. The rates in Table 4-13 include all operating reserve charges including RTO deviation charges. Table 4-13 illustrates both the average level of operating reserve charges by transaction types and the uncertainty reflected in the maximum, minimum and standard deviation levels.

**Table 4-13 Operating reserve rates statistics (\$/MWh): January through March, 2016**

Region	Transaction	Rates Charged (\$/MWh)			Standard Deviation
		Maximum	Average	Minimum	
East	INC	4.886	0.378	0.008	0.609
	DEC	4.907	0.483	0.047	0.597
	DA Load	0.402	0.105	0.002	0.072
	RT Load	0.297	0.031	0.000	0.053
	Deviation	4.886	0.378	0.008	0.609
West	INC	1.805	0.250	0.008	0.278
	DEC	1.829	0.355	0.047	0.274
	DA Load	0.402	0.105	0.002	0.072
	RT Load	0.091	0.017	0.000	0.021
	Deviation	1.805	0.250	0.008	0.278

## Reactive Services Rates

Reactive services charges associated with local voltage support are allocated to real-time load in the control zone or zones where the service is provided. These charges result from uplift payments to units committed by PJM to support reactive/voltage requirements that do not recover their energy offer through LMP payments. These charges are separate from the reactive service revenue requirement charges which are a fixed annual charge based on approved FERC filings. Reactive services charges associated with supporting reactive transfer interfaces above 345 kV are allocated to real-time load across the entire RTO. These charges are allocated daily based on the real-time load ratio share of each network customer.


While reactive services rates are not posted by PJM, a local voltage support rate for each control zone can be calculated and a reactive transfer interface support rate can be calculated for the entire RTO. Table 4-14 shows the reactive services rates associated with local voltage support in the first three months of 2015 and 2016. Table 4-14 shows that in the first three months of 2016 the DPL Control Zone had the highest rate. Real-time load in the DPL Control Zone paid an average of \$0.049 per MWh for reactive services associated with local voltage support, \$0.011 or 27.4 percent lower than the average rate paid in the first three months of 2015.

**Table 4-14 Local voltage support rates: January through March, 2015 and 2016**

Control Zone	Jan - Mar 2015 (\$/MWh)	Jan - Mar 2016 (\$/MWh)	Difference (\$/MWh)	Percent Difference
AECO	0.000	0.000	0.000	0.0%
AEP	0.006	0.000	(0.005)	(92.2%)
AP	0.000	0.000	0.000	0.0%
ATSI	0.118	0.000	(0.118)	(100.0%)
BGE	0.000	0.000	0.000	0.0%
ComEd	0.000	0.000	0.000	NA
DAY	0.000	0.000	0.000	0.0%
DEOK	0.000	0.000	0.000	0.0%
DLCO	0.000	0.000	0.000	0.0%
Dominion	0.091	0.000	(0.091)	(100.0%)
DPL	0.038	0.049	0.011	27.4%
EKPC	0.000	0.000	0.000	0.0%
JCPL	0.000	0.000	0.000	0.0%
Met-Ed	0.008	0.000	(0.008)	(100.0%)
PECO	0.000	0.000	0.000	0.0%
PENELEC	0.036	0.002	(0.034)	(93.4%)
Pepco	0.000	0.000	0.000	0.0%
PPL	0.000	0.000	0.000	0.0%
PSEG	0.000	0.000	0.000	0.0%
RECO	0.000	0.000	0.000	0.0%

Figure 4-5 shows the daily RTO wide reactive transfer interface rate in the first three months of 2015 and 2016. The average rate in the first three months of 2016 was zero, compared to the \$0.0056 per MWh average rate in the first three months of 2015.

**Figure 4-5 Daily reactive transfer interface support rates (\$/MWh): 2015 and 2016**

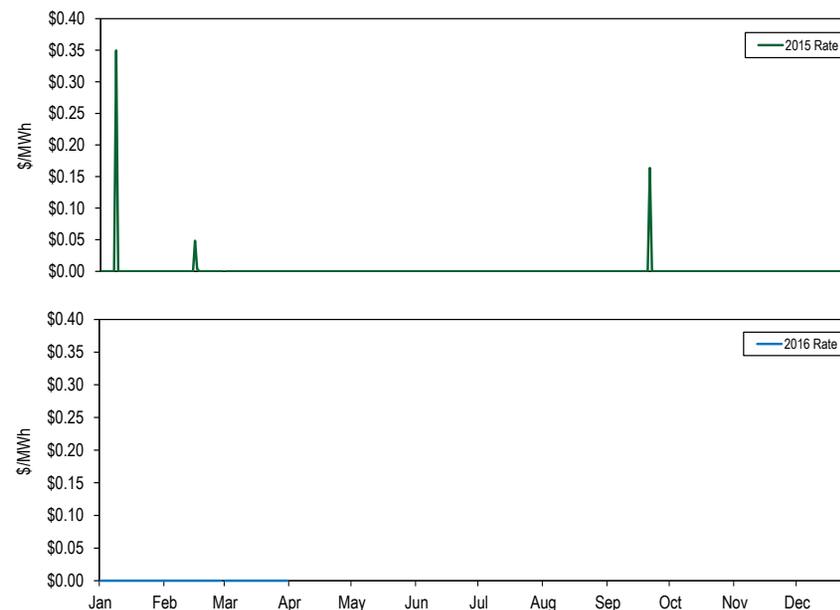

### Balancing Operating Reserve Determinants

Table 4-15 shows the determinants used to allocate the regional balancing operating reserve charges in the first three months of 2015 and 2016. Total real-time load and real-time exports were 20,066,741 MWh or 9.2 percent lower in the first three months of 2016 compared to 2015. Total deviations summed across the demand, supply, and generator categories were 2,314,630 MWh or 6.7 percent higher in the first three months of 2016 compared to 2015.

Table 4-15 Balancing operating reserve determinants (MWh): January through March 2015 and 2016

		Reliability Charge Determinants (MWh)			Deviation Charge Determinants (MWh)			
		Real-Time Load	Real-Time Exports	Reliability Total	Demand Deviations (MWh)	Supply Deviations (MWh)	Generator Deviations (MWh)	Deviations Total
Jan - Mar 2015	RTO	213,419,611	5,236,430	218,656,041	20,073,206	5,898,113	8,506,064	34,477,383
	East	101,402,083	3,881,322	105,283,405	10,406,860	3,299,513	4,167,763	17,874,136
	West	112,017,528	1,355,108	113,372,636	9,517,416	2,487,200	4,338,302	16,342,918
Jan - Mar 2016	RTO	194,989,510	3,599,790	198,589,300	20,424,011	7,707,437	8,660,565	36,792,013
	East	91,356,425	2,370,642	93,727,068	10,491,685	4,201,587	5,001,837	19,695,109
	West	103,633,084	1,229,148	104,862,232	9,782,106	3,434,507	3,658,728	16,875,341
Difference	RTO	(18,430,102)	(1,636,640)	(20,066,741)	350,805	1,809,325	154,501	2,314,630
	East	(10,045,658)	(1,510,680)	(11,556,338)	84,825	902,074	834,074	1,820,973
	West	(8,384,444)	(125,960)	(8,510,404)	264,689	947,307	(679,574)	532,422

Deviations fall into three categories, demand, supply and generator deviations. Table 4-16 shows the different categories by the type of transactions that incurred deviations. In the first three months of 2016, 27.7 percent of all RTO deviations were incurred by participants that deviated due to INCs and DECs or due to combinations of INCs and DECs with other transactions, the remaining 72.3 percent of all RTO deviations were incurred by participants that deviated due to other transaction types or due to combinations of other transaction types.

Table 4-16 Deviations by transaction type: January through March 2016

Deviation Category	Transaction	Deviation (MWh)			Share		
		RTO	East	West	RTO	East	West
Demand	Bilateral Sales Only	265,844	225,136	40,708	0.7%	1.1%	0.2%
	DECs Only	2,857,204	1,289,942	1,417,043	7.8%	6.5%	8.4%
	Exports Only	741,811	365,268	376,543	2.0%	1.9%	2.2%
	Load Only	14,276,528	6,984,072	7,292,456	38.8%	35.5%	43.2%
	Combination with DECs	1,778,395	1,412,039	366,357	4.8%	7.2%	2.2%
	Combination without DECs	504,228	215,230	288,998	1.4%	1.1%	1.7%
Supply	Bilateral Purchases Only	239,084	198,376	40,708	0.6%	1.0%	0.2%
	Imports Only	1,890,176	820,881	1,069,295	5.1%	4.2%	6.3%
	INCs Only	4,541,573	2,497,368	1,972,862	12.3%	12.7%	11.7%
	Combination with INCs	1,018,024	669,495	348,529	2.8%	3.4%	2.1%
	Combination without INCs	18,580	15,467	3,113	0.1%	0.1%	0.0%
Generators		8,660,565	5,001,837	3,658,728	23.5%	25.4%	21.7%
Total		36,792,013	19,695,109	16,875,341	100.0%	100.0%	100.0%

## Energy Uplift Credits

Table 4-17 shows the totals for each credit category in the first three months of 2015 and 2016. During the first three months of 2016, 44.7 percent of total energy uplift credits were in the balancing operating reserve category, a decrease of 19.8 percentage points from 64.5 in 2015.

**Table 4-17 Energy uplift credits by category: January through March 2015 and 2016**

Category	Type	Jan - Mar 2015 Credits (Millions)	Jan - Mar 2016 Credits (Millions)	Change	Percent Change	Jan - Mar 2015 Share	Jan - Mar 2016 Share
Day-Ahead	Generators	\$55.0	\$21.3	(\$33.7)	(61.3%)	29.5%	54.6%
	Imports	\$0.0	\$0.0	(\$0.0)	(11.8%)	0.0%	0.0%
	Load Response	\$0.2	\$0.0	(\$0.2)	(100.0%)	0.1%	0.0%
Balancing	Canceled Resources	\$0.1	\$0.0	(\$0.1)	(97.5%)	0.1%	0.0%
	Generators	\$73.3	\$13.0	(\$60.3)	(82.3%)	39.3%	33.2%
	Imports	\$0.2	\$0.0	(\$0.2)	(92.1%)	0.1%	0.0%
	Load Response	\$0.0	\$0.0	(\$0.0)	(87.7%)	0.0%	0.0%
	Local Constraints Control	\$0.1	\$0.1	(\$0.0)	(27.2%)	0.0%	0.1%
	Lost Opportunity Cost	\$46.6	\$4.4	(\$42.1)	(90.5%)	25.0%	11.3%
	Day-Ahead	\$5.8	\$0.0	(\$5.8)	(100.0%)	3.1%	0.0%
Reactive Services	Local Constraints Control	\$0.0	\$0.0	(\$0.0)	(100.0%)	0.0%	0.0%
	Lost Opportunity Cost	\$0.1	\$0.0	(\$0.1)	(84.7%)	0.0%	0.0%
	Reactive Services	\$0.3	\$0.2	(\$0.1)	(28.6%)	0.2%	0.6%
	Synchronous Condensing	\$0.2	\$0.0	(\$0.2)	(100.0%)	0.1%	0.0%
Synchronous Condensing	\$0.0	\$0.0	\$0.0	NA	0.0%	0.0%	
Black Start Services	Day-Ahead	\$4.3	\$0.0	(\$4.3)	(100.0%)	2.3%	0.0%
	Balancing	\$0.4	\$0.0	(\$0.4)	(100.0%)	0.2%	0.0%
	Testing	\$0.0	\$0.0	(\$0.0)	(48.7%)	0.0%	0.0%
<b>Total</b>		<b>\$186.4</b>	<b>\$39.0</b>	<b>(\$147.4)</b>	<b>(79.1%)</b>	<b>100.0%</b>	<b>100.0%</b>

## Characteristics of Credits

### Types of Units

Table 4-18 shows the distribution of total energy uplift credits by unit type in the first three months of 2015 and 2016. The decrease in energy uplift in the first three months of 2016 compared to 2015 was primarily a result of lower credits paid to combined cycles, combustion turbines and steam turbines (not fired by coal) in the 2016 winter compared to the 2015 winter as a result of lower natural gas costs. Credits to these units decreased \$125.4 million or 87.1 percent.

**Table 4-18 Energy uplift credits by unit type: January through March 2015 and 2016**

Unit Type	Jan - Mar 2015 Credits (Millions)	Jan - Mar 2016 Credits (Millions)	Change	Percent Change	Jan - Mar 2015 Share	Jan - Mar 2016 Share
Combined Cycle	\$56.7	\$6.6	(\$50.1)	(88.4%)	30.5%	16.8%
Combustion Turbine	\$61.2	\$11.1	(\$50.1)	(81.9%)	32.9%	28.4%
Diesel	\$0.9	\$0.3	(\$0.5)	(60.2%)	0.5%	0.9%
Hydro	\$0.3	\$0.0	(\$0.3)	(99.0%)	0.2%	0.0%
Nuclear	\$0.2	\$0.1	(\$0.1)	(32.5%)	0.1%	0.3%
Steam - Coal	\$40.3	\$19.9	(\$20.4)	(50.7%)	21.7%	50.9%
Steam - Other	\$26.0	\$0.8	(\$25.1)	(96.8%)	13.9%	2.1%
Wind	\$0.6	\$0.2	(\$0.4)	(65.4%)	0.3%	0.5%
Total	\$186.1	\$39.0	(\$147.1)	(79.0%)	100.0%	100.0%

Table 4-19 shows the distribution of energy uplift credits by category and by unit type in the first three months of 2016. Combined cycle units received 15.1 percent of the day-ahead generator credits in the first three months of 2016, 24.5 percentage points lower than the share received in the first three months of 2015. Combined cycle units received 24.0 percent of the balancing generator credits in the first three months of 2016, 22.5 percentage points lower than the share received in the first three months of 2015. Combustion turbines and diesels received 89.3 percent of the lost opportunity cost credits in the first three months of 2015, 0.7 percentage points higher than the share received in the first three months of 2015.

**Table 4-19 Energy uplift credits by unit type: January through March 2016**

Unit Type	Day-Ahead Generator	Balancing Generator	Canceled Resources	Local Constraints Control	Lost Opportunity Cost	Reactive Services	Synchronous Condensing	Black Start Services
Combined Cycle	15.1%	24.0%	0.0%	0.0%	1.1%	80.8%	0.0%	0.0%
Combustion Turbine	3.3%	51.1%	0.0%	0.0%	83.5%	18.8%	0.0%	100.0%
Diesel	0.0%	0.7%	0.0%	0.0%	5.7%	0.4%	0.0%	0.0%
Hydro	0.0%	0.0%	100.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Nuclear	0.0%	0.0%	0.0%	0.0%	2.7%	0.0%	0.0%	0.0%
Steam - Coal	79.6%	21.1%	0.0%	84.5%	2.5%	0.0%	0.0%	0.0%
Steam - Others	2.0%	3.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Wind	0.0%	0.1%	0.0%	15.5%	4.5%	0.0%	0.0%	0.0%
Total (Millions)	\$21.3	\$13.0	\$0.0	\$0.1	\$4.4	\$0.3	\$0.0	\$0.0

Table 4-19 also shows the distribution of reactive service credits and black start services credits by unit type. In the first three months of 2016, coal units received 0.0 percent of all reactive services credits, compared to 57.0 percent in the first three months of 2015.

## Concentration of Energy Uplift Credits

There continues to be a high level of concentration in the units and companies receiving energy uplift credits. This concentration results from a combination of unit operating characteristics, PJM's persistent need to commit specific units out of merit in particular locations and the fact that the lack of transparency makes it almost impossible for competition to affect these payments.

Figure 4-6 shows the concentration of energy uplift credits. The top 10 units received 54.0 percent of total energy uplift credits in the first three months of 2016, compared to 38.1 percent in 2015. In the first three months of 2016, 226 units received 90 percent of all energy uplift credits, compared to 246 units in 2015.

**Figure 4-6 Cumulative share of energy uplift credits in January through March of 2015 and 2016 by unit**

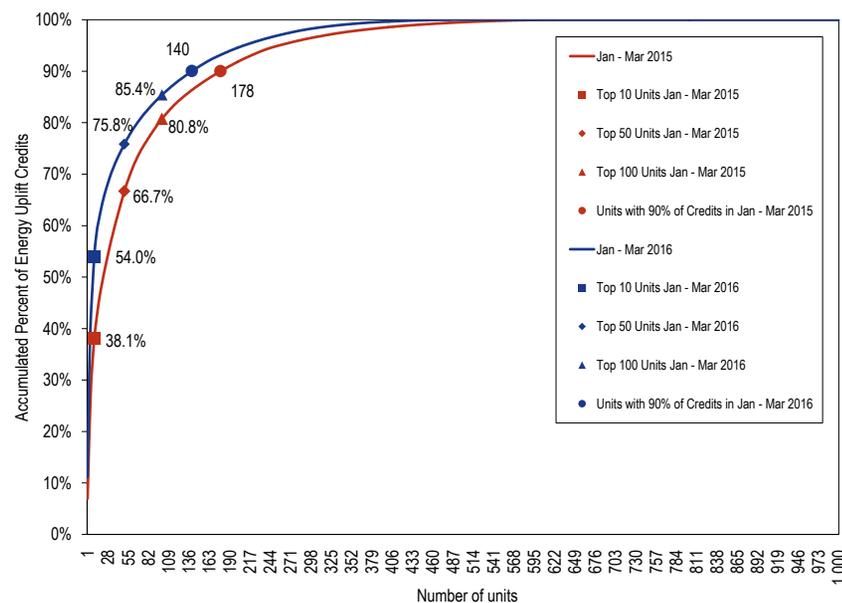


Table 4-20 shows the credits received by the top 10 units and top 10 organizations in each of the energy uplift categories paid to generators.

**Table 4-20 Top 10 units and organizations energy uplift credits: January through March 2016**

Category	Type	Top 10 Units		Top 10 Organizations	
		Credits (Millions)	Credits Share	Credits (Millions)	Credits Share
Day-Ahead	Generators	\$16.3	76.3%	\$21.0	98.4%
	Canceled Resources	\$0.0	100.0%	\$0.0	100.0%
Balancing	Generators	\$4.9	37.5%	\$11.0	84.5%
	Local Constraints Control	\$0.1	100.0%	\$0.1	100.0%
	Lost Opportunity Cost	\$2.5	56.6%	\$3.9	88.4%
Reactive Services		\$0.2	99.7%	\$0.3	100.0%
Synchronous Condensing		\$0.0	0.0%	\$0.0	0.0%
Black Start Services		\$0.0	100.0%	\$0.0	100.0%
<b>Total</b>		<b>\$21.1</b>	<b>54.0%</b>	<b>\$33.9</b>	<b>86.9%</b>

Table 4-21 shows balancing operating reserve credits received by the top 10 units identified for reliability or for deviations in each region. In the first three months of 2016, 80.1 percent of all credits paid to these units were allocated to deviations while the remaining 19.9 percent were paid for reliability reasons.

**Table 4-21 Identification of balancing operating reserve credits received by the top 10 units by category and region: January through March 2016**

	Reliability			Deviations			Total
	RTO	East	West	RTO	East	West	
Credits (Millions)	\$0.9	\$0.1	\$0.0	\$2.0	\$1.8	\$0.0	\$4.9
Share	18.0%	1.9%	0.0%	42.1%	38.0%	0.0%	100.0%

In the first three months of 2016, concentration in all energy uplift credit categories was high.<sup>5 6</sup> The HHI for energy uplift credits was calculated based on each organization’s share of daily credits for each category. Table 4-22 shows the average HHI for each category. HHI for day-ahead operating reserve credits to generators was 5397, for balancing operating reserve credits to generators was 4165, for lost opportunity cost credits was 5101 and for reactive services credits was 9883.

<sup>5</sup> See 2015 State of the Market Report for PJM, Volume II: Section 3: "Energy Market" at "Market Concentration" for a discussion of concentration ratios and the Herfindahl-Hirschman Index (HHI).

<sup>6</sup> Table 4-22 excludes local constraints control categories.

**Table 4-22 Daily energy uplift credits HHI: January through March 2016**

Category	Type	Average	Minimum	Maximum	Highest Market Share (One day)	Highest Market Share (All days)
Day-Ahead	Generators	5397	2440	10000	100.0%	37.9%
	Imports	10000	10000	10000	100.0%	68.6%
	Load Response	NA	NA	NA	NA	NA
Balancing	Canceled Resources	10000	10000	10000	100.0%	100.0%
	Generators	4165	1230	9554	97.7%	21.2%
	Imports	10000	10000	10000	100.0%	100.0%
	Load Response	10000	10000	10000	100.0%	52.1%
	Lost Opportunity Cost	5101	1507	10000	100.0%	23.3%
Reactive Services		9883	6772	10000	100.0%	81.2%
Synchronous Condensing		NA	NA	NA	NA	NA
Black Start Services		10000	10000	10000	100.0%	45.5%
<b>Total</b>		<b>3432</b>	<b>871</b>	<b>7583</b>	<b>86.6%</b>	<b>24.7%</b>

## Economic and Noneconomic Generation<sup>7</sup>

Economic generation includes units scheduled day ahead or producing energy in real time at an incremental offer less than or equal to the LMP at the unit's bus. Noneconomic generation includes units that are scheduled or producing energy at an incremental offer higher than the LMP at the unit's bus. Units are paid day-ahead operating reserve credits based on their scheduled operation for the entire day. Balancing generator operating reserve credits are paid on a segmented basis for each period defined by the greater of the day-ahead schedule and minimum run time. Table 4-23 shows PJM's day-ahead and real-time total generation and the amount of generation eligible for operating reserve credits. In the Day-Ahead Energy Market only pool-scheduled resources are eligible for day-ahead operating reserve credits. In the Real-Time Energy Market only pool-scheduled resources that follow PJM's dispatch instructions are eligible for balancing operating reserve credits.

The MMU analyzed PJM's day-ahead and real-time generation eligible for operating reserve credits to determine the shares of economic and noneconomic generation. Each unit's hourly generation was determined to be economic or noneconomic based on the unit's hourly incremental offer, excluding the hourly no load cost and any applicable startup cost. A unit could be economic

<sup>7</sup> The analysis of economic and noneconomic generation is based on units' incremental offers, the value used by PJM to calculate LMP. The analysis does not include no load or startup costs.

for every hour during a day or segment, but still receive operating reserve credits because the energy revenues did not cover the hourly no load costs and startup costs. A unit could be noneconomic for an hour or multiple hours and not receive operating reserve credits whenever the total energy revenues covered the total offer (including no load and startup costs) for the entire day or segment. In the first three months of 2016, 37.2 percent of the day-ahead generation was eligible for day-ahead operating reserve credits and 35.1 percent of the real-time generation was eligible for balancing operating reserve credits.<sup>8</sup>

**Table 4-23 Day-ahead and real-time generation (GWh): January through March 2015**

Energy Market	Total Generation	Generation Eligible for Operating Reserve Credits	Generation Eligible for Operating Reserve Credits Percent
Day-Ahead	200,618	74,729	37.2%
Real-Time	197,748	69,454	35.1%

Table 4-24 shows PJM's economic and noneconomic generation by hour eligible for operating reserve credits. In the first three months of 2016, 88.1 percent of the day-ahead generation eligible for operating reserve credits was economic and 74.0 percent of the real-time generation eligible for operating reserve credits was economic. A unit's generation may be noneconomic for a portion of their daily generation and economic for the rest. Table 4-24 shows the separate amounts of economic and noneconomic generation even if the daily generation was economic.

<sup>8</sup> In the Day-Ahead Energy Market only pool-scheduled resources are eligible for day-ahead operating reserve credits. In the Real-Time Energy Market only pool-scheduled resources that operate as requested by PJM are eligible for balancing operating reserve credits.

**Table 4-24 Day-ahead and real-time economic and noneconomic generation from units eligible for operating reserve credits (GWh): January through March 2015**

Energy Market	Economic Generation	Noneconomic Generation	Economic Generation Percent	Noneconomic Generation Percent
Day-Ahead	65,842	8,887	88.1%	11.9%
Real-Time	51,366	18,089	74.0%	26.0%

Noneconomic generation only leads to operating reserve credits when units' generation for the day or segment, scheduled or committed, is noneconomic, including no load and startup costs. Table 4-25 shows the generation receiving day-ahead and balancing operating reserve credits. In the first three months of 2016, 4.0 percent of the day-ahead generation eligible for operating reserve credits received credits and 3.4 percent of the real-time generation eligible for operating reserve credits was made whole.

**Table 4-25 Day-ahead and real-time generation receiving operating reserve credits (GWh): January through March 2015**

Energy Market	Generation Eligible for Operating Reserve Credits	Generation Receiving Operating Reserve Credits	Generation Receiving Operating Reserve Credits Percent
Day-Ahead	74,729	2,979	4.0%
Real-Time	69,454	1,763	2.5%

## Day-Ahead Unit Commitment for Reliability

PJM may schedule units as must run in the Day-Ahead Energy Market when needed in real time to address reliability issues of various types. PJM puts such reliability issues in four categories: voltage issues (high and low); black start requirements (from automatic load rejection (ALR) units); local contingencies not modeled in the Day-Ahead Energy Market; and long lead time units not able to be scheduled in the Day-Ahead Energy Market.<sup>9</sup> Participants can submit units as self-scheduled (must run), meaning that the unit must be committed, but a unit submitted as must run by a participant is not eligible for day-ahead

<sup>9</sup> See PJM, "Item 12 - October 2012 MIC DAM Cost Allocation," PJM Presentation to the Market Implementation Committee (October 12, 2012) <<http://www.pjm.com/~media/committees-groups/committees/mic/20121010/20121010-minutes.ashx>>.

operating reserve credits.<sup>10</sup> Units scheduled as must run by PJM may set LMP if raised above economic minimum and following the dispatch signal and are eligible for day-ahead operating reserve credits. Table 4-26 shows the total day-ahead generation and the subset of that generation scheduled as must run by PJM. In the first three months of 2016, 1.5 percent of the total day-ahead generation was scheduled as must run by PJM, 1.7 percentage points lower than the first three months of 2015.

**Table 4-26 Day-ahead generation scheduled as must run by PJM (GWh): 2015 and 2016**

	2015			2016		
	Total Day-Ahead Generation	Day-Ahead PJM Must Run Generation	Share	Total Day-Ahead Generation	Day-Ahead PJM Must Run Generation	Share
Jan	77,937	2,143	2.7%	73,821	935	1.3%
Feb	74,224	2,904	3.9%	66,367	979	1.5%
Mar	68,201	1,857	2.7%	60,431	1,047	1.7%
Apr	55,957	1,138	2.0%			
May	61,955	1,523	2.5%			
Jun	68,558	1,447	2.1%			
Jul	75,490	1,201	1.6%			
Aug	73,934	922	1.2%			
Sep	66,927	616	0.9%			
Oct	58,731	763	1.3%			
Nov	58,517	486	0.8%			
Dec	62,976	551	0.9%			
Total (Jan - Mar)	220,362	6,904	3.1%	200,618	2,961	1.5%
Total	803,408	15,552	1.9%	200,618	2,961	1.5%

Pool-scheduled units are made whole in the Day-Ahead Energy Market if their total offer (including no load and startup costs) is greater than the revenues from the Day-Ahead Energy Market. Such units are paid day-ahead operating reserve credits. Pool-scheduled units scheduled as must run by PJM are only paid day-ahead operating reserve credits when their total offer is greater than the revenues from the Day-Ahead Energy Market.

<sup>10</sup> See PJM, "PJM eMkt Users Guide," Section Managing Unit Data (version July 9, 2015) p. 42, <<http://www.pjm.com/~media/etools/emkt/ts-userguide.ashx>>.

It is illogical and unnecessary to pay units day-ahead operating reserves because units do not incur any costs to run and any revenue shortfalls are addressed by balancing operating reserve payments.

Table 4-27 shows the total day-ahead generation scheduled as must run by PJM by category. In the first three months of 2016, 56.4 percent of the day-ahead generation scheduled as must run by PJM received operating reserve credits, all paid through normal day-ahead operating reserve credits, not black start or reactive services. The remaining 43.6 percent of the day-ahead generation scheduled as must run by PJM did not need to be made whole.

**Table 4-27 Day-ahead generation scheduled as must run by PJM by category (GWh): January through March 2016**

	Black Start Services	Reactive Services	Day-Ahead Operating Reserves	Economic	Total
Jan	0	0	375	560	935
Feb	0	0	584	395	979
Mar	0	0	712	335	1,047
Total (Jan - Mar)	0	0	1,671	1,291	2,961
Share	0.0%	0.0%	56.4%	43.6%	100.0%

Total day-ahead operating reserve credits in the first three months of 2016 were \$21.3 million, of which \$18.2 million or 85.3 percent was paid to units scheduled as must run by PJM, and not scheduled to provide black start or reactive services.

## Geography of Charges and Credits

Table 4-28 shows the geography of charges and credits in the first three months of 2016. Table 4-28 includes only day-ahead operating reserve charges and balancing operating reserve reliability and deviation charges since these categories are allocated regionally, while other charges, such as reactive services, synchronous condensing and black start services are allocated by control zone, and balancing local constraint charges are charged to the requesting party.

Charges are categorized by the location (control zone, hub, aggregate or interface) where they are allocated according to PJM's operating reserve rules. Credits are categorized by the location where the resources are located. The shares columns reflect the operating reserve credits and charges balance for each location. For example, transactions in the AEP Control Zone paid 14.8 percent of all operating reserve charges allocated regionally, and resources in the AEP Control Zone were paid 6.1 percent of the corresponding credits. The AEP Control Zone received less operating reserve credits than operating reserve charges paid and had 16.0 percent of the deficit. The deficit is the sum of the negative entries in the balance column. Transactions in the PSEG Control Zone paid 5.1 percent of all operating reserve charges allocated regionally, and resources in the PSEG Control Zone were paid 16.5 percent of the corresponding credits. The PSEG Control Zone received more operating reserve credits than operating reserve charges paid and had 20.9 percent of the surplus. The surplus is the sum of the positive entries in the balance column. Table 4-28 also shows that 91.2 percent of all charges were allocated in control zones, 4.1 percent in hubs and aggregates and 4.7 percent in interfaces.

Table 4-28 Geography of regional charges and credits: January through March 2015

Location		Charges (Millions)	Credits (Millions)	Balance	Shares			
					Total Charges	Total Credits	Deficit	Surplus
Zones	AECO	\$0.5	\$1.5	\$1.0	1.4%	3.9%	0.0%	4.6%
	AEP	\$5.1	\$1.9	(\$3.2)	13.2%	4.8%	15.4%	0.0%
	AP	\$2.1	\$0.7	(\$1.4)	5.4%	1.7%	6.7%	0.0%
	ATSI	\$2.6	\$0.4	(\$2.2)	6.7%	1.0%	10.3%	0.0%
	BGE	\$1.9	\$10.9	\$9.1	4.8%	28.2%	0.0%	42.8%
	ComEd	\$3.8	\$1.7	(\$2.1)	9.9%	4.4%	10.0%	0.0%
	DAY	\$0.7	\$0.5	(\$0.2)	1.8%	1.4%	0.7%	0.0%
	DEOK	\$1.0	\$0.2	(\$0.8)	2.6%	0.6%	3.7%	0.0%
	DLCO	\$0.5	\$0.1	(\$0.4)	1.4%	0.3%	2.0%	0.0%
	Dominion	\$4.5	\$3.3	(\$1.1)	11.6%	8.6%	5.4%	0.0%
	DPL	\$1.0	\$3.6	\$2.6	2.7%	9.4%	0.0%	12.3%
	EKPC	\$0.6	\$0.5	(\$0.1)	1.6%	1.3%	0.6%	0.0%
	External	(\$0.0)	\$0.1	\$0.1	-0.0%	0.2%	0.0%	0.3%
	JCPL	\$1.1	\$0.3	(\$0.8)	2.8%	0.8%	3.6%	0.0%
	Met-Ed	\$0.8	\$0.3	(\$0.5)	2.1%	0.7%	2.5%	0.0%
	PECO	\$2.0	\$0.1	(\$1.9)	5.1%	0.2%	8.9%	0.0%
	PENELEC	\$1.1	\$0.3	(\$0.8)	2.9%	0.8%	3.9%	0.0%
	Pepco	\$1.6	\$5.7	\$4.1	4.2%	14.6%	0.0%	19.2%
	PPL	\$2.3	\$0.2	(\$2.1)	5.8%	0.5%	9.8%	0.0%
	PSEG	\$2.0	\$6.4	\$4.4	5.1%	16.5%	0.0%	20.8%
	RECO	\$0.1	\$0.0	(\$0.1)	0.2%	0.0%	0.3%	0.0%
All Zones	\$35.3	\$38.7	\$3.4	91.1%	100.0%	69.8%	60.0%	
Hubs and Aggregates	AEP - Dayton	\$0.1	\$0.0	(\$0.1)	0.2%	0.0%	0.3%	0.0%
	Dominion	\$0.1	\$0.0	(\$0.1)	0.2%	0.0%	0.3%	0.0%
	Eastern	\$0.0	\$0.0	(\$0.0)	0.1%	0.0%	0.2%	0.0%
	New Jersey	\$0.0	\$0.0	(\$0.0)	0.1%	0.0%	0.2%	0.0%
	Ohio	\$0.0	\$0.0	(\$0.0)	0.0%	0.0%	0.0%	0.0%
	Western Interface	\$0.0	\$0.0	(\$0.0)	0.0%	0.0%	0.1%	0.0%
	Western	\$1.4	\$0.0	(\$1.4)	3.6%	0.0%	6.5%	0.0%
	RTEP B0328 Source	\$0.0	\$0.0	\$0.0	0.0%	0.0%	0.0%	0.0%
All Hubs and Aggregates	\$1.6	\$0.0	(\$1.6)	4.2%	0.0%	7.6%	0.0%	
Interfaces	CPL Imp	\$0.0	\$0.0	\$0.0	0.0%	0.0%	0.0%	0.0%
	Hudson	\$0.0	\$0.0	(\$0.0)	0.0%	0.0%	0.0%	0.0%
	IMO	\$0.2	\$0.0	(\$0.2)	0.4%	0.0%	0.8%	0.0%
	Linden	\$0.1	\$0.0	(\$0.1)	0.2%	0.0%	0.4%	0.0%
	MISO	\$0.4	\$0.0	(\$0.4)	1.1%	0.0%	1.9%	0.0%
	Neptune	\$0.2	\$0.0	(\$0.2)	0.5%	0.0%	0.9%	0.0%
	NIPSCO	\$0.0	\$0.0	(\$0.0)	0.0%	0.0%	0.0%	0.0%
	Northwest	\$0.0	\$0.0	(\$0.0)	0.1%	0.0%	0.2%	0.0%
	NYIS	\$0.3	\$0.0	(\$0.3)	0.9%	0.0%	1.6%	0.0%
	OVEC	\$0.0	\$0.0	(\$0.0)	0.1%	0.0%	0.2%	0.0%
	South Exp	\$0.1	\$0.0	(\$0.1)	0.2%	0.0%	0.4%	0.0%
	South Imp	\$0.5	\$0.0	(\$0.5)	1.2%	0.0%	2.3%	0.0%
	All Interfaces	\$1.8	\$0.0	(\$1.8)	4.7%	0.0%	8.6%	0.0%
	Total	\$38.7	\$38.7	\$0.0	100.0%	100.0%	86.0%	60.0%

## Energy Uplift Issues

### Lost Opportunity Cost Credits

Balancing operating reserve lost opportunity cost (LOC) credits are paid to units under two scenarios. If a combustion turbine or a diesel is scheduled to operate in the Day-Ahead Energy Market, but is not requested by PJM in real time, the unit will receive a credit which covers the day-ahead financial position of the unit plus balancing spot energy market charges that the unit has to pay. For purposes of this report, this LOC will be referred to as day-ahead LOC.<sup>11</sup> If a unit generating in real time with an offer price lower than the real-time LMP at the unit's bus is reduced or suspended by PJM due to a transmission constraint or other reliability issue, the unit will receive a credit for LOC based on the desired output. For purposes of this report, this LOC will be referred to as real-time LOC.

**Table 4-29 Monthly lost opportunity cost credits (Millions): 2015 and 2016**

	2015			2016		
	Day-Ahead Lost Opportunity Cost	Real-Time Lost Opportunity Cost	Total	Day-Ahead Lost Opportunity Cost	Real-Time Lost Opportunity Cost	Total
Jan	\$4.4	\$0.9	\$5.2	\$1.6	\$0.2	\$1.8
Feb	\$23.0	\$3.0	\$25.9	\$1.7	\$0.1	\$1.8
Mar	\$13.9	\$1.5	\$15.4	\$0.6	\$0.2	\$0.8
Apr	\$5.2	\$0.5	\$5.7			
May	\$5.6	\$1.8	\$7.4			
Jun	\$3.8	\$0.4	\$4.2			
Jul	\$4.1	\$0.4	\$4.5			
Aug	\$2.1	\$0.4	\$2.5			
Sep	\$3.2	\$1.2	\$4.4			
Oct	\$1.8	\$0.6	\$2.3			
Nov	\$2.1	\$1.6	\$3.7			
Dec	\$2.4	\$0.0	\$2.5			
Total (Jan - Mar)	\$41.2	\$5.4	\$46.6	\$3.9	\$0.5	\$4.4
Share (Jan - Mar)	88.5%	11.5%	100.0%	89.3%	10.7%	100.0%
Total	\$71.5	\$12.3	\$83.8	\$3.9	\$0.5	\$4.4
Share	85.4%	14.6%	100.0%	89.3%	10.7%	100.0%

In the first three months of 2016, LOC credits decreased by \$42.1 million, 90.5 percent, compared to the first three months of 2015. The decrease of \$42.1 million is comprised of a decrease of \$37.2 million in day-ahead LOC and a decrease of \$4.9 million in real-time LOC. Table 4-29 shows the monthly composition of LOC credits in 2015 and 2016. In the first three months of 2016, 10.4 percent of the day-ahead scheduled generation from combustion turbines and diesels was not committed in real time and paid LOC credits, 22.2 percentage points lower than in the first three months of 2015.

Table 4-30 shows, for combustion turbines and diesels scheduled day ahead, the total day-ahead generation, the day-ahead generation from units that were not requested by PJM in real time and the subset of that generation that received lost opportunity costs credits. Table 4-30 shows that day-ahead scheduled generation from CTs and diesels decreased by 1,248 GWh, 32.9 percent, from 3,789 GWh in the first three months of 2015 to 2,541 GWh in the first three months of 2016 and that the generation that received LOC credits decreased by 985 GWh or 78.9 percent.

<sup>11</sup> A unit's day-ahead financial position equals the revenues from the Day-Ahead Energy Market minus the expected costs (valued at the unit's offer curve cleared in day ahead). A unit scheduled in the Day-Ahead Energy Market and not committed in real time incurs balancing spot energy charges since it has to cover its day-ahead scheduled energy position in real time.

Table 4-30 Day-ahead generation from combustion turbines and diesels (GWh): 2015 and 2016

	2015			2016		
	Day-Ahead Generation	Day-Ahead Generation Not Requested in Real Time	Day-Ahead Generation Not Requested in Real Time Receiving LOC Credits	Day-Ahead Generation	Day-Ahead Generation Not Requested in Real Time	Day-Ahead Generation Not Requested in Real Time Receiving LOC Credits
Jan	827	347	244	705	214	117
Feb	1,593	838	499	746	197	89
Mar	1,368	688	505	1,090	165	59
Apr	1,392	536	408			
May	1,898	556	365			
Jun	1,736	406	242			
Jul	2,651	432	273			
Aug	1,881	331	202			
Sep	1,714	277	192			
Oct	1,375	224	116			
Nov	1,258	212	102			
Dec	1,041	317	182			
Total (Jan - Mar)	3,789	1,872	1,249	2,541	576	264
Share (Jan - Mar)	100.0%	49.4%	33.0%	100.0%	22.7%	10.4%
Total	18,734	5,164	3,333	2,541	576	264
Share	100.0%	27.6%	17.8%	100.0%	22.7%	10.4%

In the first three months of 2016, the top three control zones in which generation received LOC credits, AECO, AEP and ComEd, accounted for 64.7 percent of all LOC credits, 45.2 percent of all the day-ahead generation from combustion turbines and diesels, 57.8 percent of all day-ahead generation not committed in real time by PJM from those unit types and 62.2 percent of all day-ahead generation not committed in real time by PJM and receiving LOC credits from those unit types.

Combustion turbines and diesels receive LOC credits on an hourly basis. For example, if a combustion turbine is scheduled day ahead to run from hour 10 to hour 18 and the unit only runs from hour 12 to hour 16, the unit is eligible for LOC credits for hours 10, 11, 17 and 18. Table 4-31 shows the LOC credits paid to combustion turbines and diesels scheduled in the Day-Ahead Energy Market for units that did not run in real time and units that ran in real time for at least one hour of their day-ahead schedule. Table 4-31 shows that in the first three months of 2016, \$2.0 million or 49.4 percent of all LOC credits were paid to combustion turbines and diesels that did not run for any hour in real time, 15.9 percentage points lower than the first three months of 2015.

**Table 4-31 Lost opportunity cost credits paid to combustion turbines and diesels by scenario (Millions): 2015 and 2016**

	2015			2016		
	Units that did not run in real time	Units that ran in real time for at least one hour of their day-ahead schedule	Total	Units that did not run in real time	Units that ran in real time for at least one hour of their day-ahead schedule	Total
Jan	\$2.4	\$2.0	\$4.4	\$0.9	\$0.7	\$1.6
Feb	\$15.4	\$7.5	\$23.0	\$0.8	\$0.9	\$1.7
Mar	\$9.1	\$4.8	\$13.9	\$0.2	\$0.4	\$0.6
Apr	\$3.0	\$2.2	\$5.2			
May	\$3.0	\$2.6	\$5.6			
Jun	\$2.2	\$1.6	\$3.8			
Jul	\$2.5	\$1.6	\$4.1			
Aug	\$1.3	\$0.8	\$2.1			
Sep	\$1.7	\$1.5	\$3.2			
Oct	\$1.0	\$0.8	\$1.8			
Nov	\$1.2	\$0.9	\$2.1			
Dec	\$1.8	\$0.6	\$2.4			
Total (Jan - Mar)	\$26.9	\$14.3	\$41.2	\$2.0	\$2.0	\$3.9
Share (Jan - Mar)	65.3%	34.7%	100.0%	49.4%	50.6%	100.0%
Total	\$44.6	\$27.0	\$71.5	\$2.0	\$2.0	\$3.9
Share	62.3%	37.7%	100.0%	49.4%	50.6%	100.0%

**Table 4-32 Day-ahead generation (GWh) from combustion turbines and diesels receiving lost opportunity cost credits by value: 2015 and 2016<sup>12</sup>**

	2015			2016		
	Economic Scheduled Generation (GWh)	Noneconomic Scheduled Generation (GWh)	Total (GWh)	Economic Scheduled Generation (GWh)	Noneconomic Scheduled Generation (GWh)	Total (GWh)
Jan	246	102	348	144	43	187
Feb	497	335	832	102	60	161
Mar	543	140	682	62	64	126
Apr	366	168	534			
May	280	258	538			
Jun	240	125	365			
Jul	259	124	383			
Aug	163	123	286			
Sep	217	74	292			
Oct	149	59	208			
Nov	121	70	191			
Dec	214	75	289			
Total (Jan - Mar)	1,285	576	1,861	307	167	474
Share (Jan - Mar)	69.1%	30.9%	100.0%	64.8%	35.2%	100.0%
Total	3,294	1,653	4,946	307	167	474
Share	66.6%	33.4%	100.0%	64.8%	35.2%	100.0%

<sup>12</sup> The total generation in Table 4-32 is lower than the day-ahead generation not requested in real time in Table 4-30 because the former only includes generation from units that received lost opportunity costs during at least one hour of the day. Table 4-32 includes all generation, including generation from units that were not committed in real time and did not receive LOC credits.

PJM may not run units in real time if the real-time value of the energy (generation multiplied by the real-time LMP) is lower than the units' total offer (including no load and startup costs). Table 4-32 shows the total day-ahead generation from combustion turbines and diesels that were not committed in real time by PJM and received LOC credits. Table 4-32 shows the scheduled generation that had a total offer (including no load and startup costs) lower than its real-time value (generation multiplied by the real-time LMP), defined here as economic scheduled generation, and the scheduled generation that had a total offer greater than its real-time value or noneconomic scheduled generation. In the first three months of 2016, 64.8 percent of the scheduled generation not committed by PJM from units receiving LOC credits was economic and the remaining 35.2 percent was noneconomic.

The MMU recommends that PJM initiate an analysis of the reasons why some combustion turbines and diesels scheduled in the Day-Ahead Energy Market are not committed by PJM in real time when they are economic.

## Closed Loop Interfaces

PJM implemented closed loop interfaces with the stated purpose of improving the incorporation of reactive constraints into energy prices and to allow emergency DR to set price.<sup>13</sup> PJM applies closed loop interfaces so that it can use units needed for reactive support to set the energy price when they would not

<sup>13</sup> See PJM/Alstom, "Approaches to Reduce Energy Uplift and PJM Experiences," presented at the FERC Technical Conference: Increasing Real-Time and Day-Ahead Market Efficiency Through Improved Software in Docket No. AD10-12-006 <<http://www.ferc.gov/june-tech-conf/2015/presentations/m2-3.pdf>> (June 23, 2015).

otherwise set price under the LMP algorithm. PJM also applies closed loop interfaces so that it can use emergency DR resources to set the real-time LMP when DR resources would not otherwise set price under the fundamental LMP logic. Of the 17 closed loop interface definitions, 11(65 percent) were created for the purpose of allowing emergency DR to set price.

Closed loop interfaces are used to model the transfer capability into a specific area. Areas or regions are defined in PJM by hubs, aggregates or control zones, all comprised of buses. Closed loop interfaces are not defined by buses, but defined by the transmission facilities that connect the buses inside the loop with the rest of PJM. PJM reduces the interface real transfer capability to a level that will artificially make marginal the resource selected by PJM. Table 4-33 shows the closed loop interfaces that PJM has defined.

Figure 4-7 PJM Closed loop interfaces map

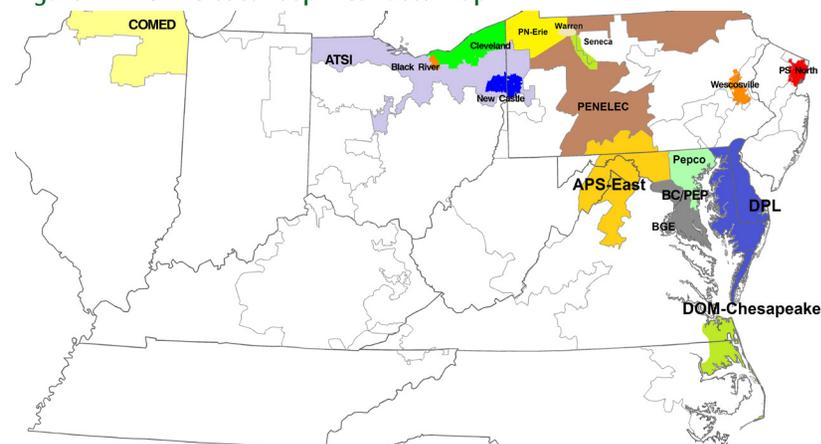


Table 4-33 PJM closed loop interfaces<sup>14 15 16</sup>

Interface	Control Zone(s)	Objective	Effective Date	Limit Calculation
APS-East	AP	Allow emergency DR resources / unit(s) needed for reactive to set real-time LMP	June 19, 2015	Limit equal to actual flow
ATSI	ATSI	Allow emergency DR resources / unit(s) needed for reactive to set real-time LMP	July 17, 2013	Limit equal to actual flow
BC	BGE	Allow emergency DR resources / unit(s) needed for reactive to set real-time LMP	June 19, 2015	Limit equal to actual flow
BC/PEP	BGE and Pepco	Reactive Interface (not an IROL). Used to model import capability into the BGE/PEPCO/Doubs/Northern Virginia area	NA	PJM Transfer Limit Calculator
Black River	ATSI	Allow emergency DR resources set real-time LMP	September 1, 2014	Limit equal to actual flow
Cleveland	ATSI	Reactive Interface (IROL)	NA	PJM Transfer Limit Calculator
COMED	ComEd	Reactive Interface (IROL)	NA	PJM Transfer Limit Calculator
DOM-Chesapeake	Dominion	Allow emergency DR resources / unit(s) needed for reactive to set real-time LMP	August 14, 2015	Limit equal to actual flow
DPL	DPL	Allow emergency DR resources / unit(s) needed for reactive to set real-time LMP	June 19, 2015	Limit equal to actual flow
New Castle	ATSI	Allow emergency DR resources set real-time LMP	July 1, 2014	Limit equal to actual flow
PENELEC	PENELEC	Allow emergency DR resources / unit(s) needed for reactive to set real-time LMP	April 22, 2015	Limit equal to actual flow
Pepco	Pepco	Allow emergency DR resources / unit(s) needed for reactive to set real-time LMP	June 19, 2015	Limit equal to actual flow
PL-Wescosville	PPL	Allow emergency DR resources / unit(s) needed for reactive to set real-time LMP	July 24, 2014	Limit equal to actual flow
PN-Erie	PENELEC	Allow emergency DR resources set real-time LMP	April 22, 2015	Limit equal to actual flow
PS North	PSEG	Objective not identified. Interface was modeled in 2014/2015 Annual FTR auction	NA	NA
Seneca	PENELEC	Allow unit(s) needed for reactive to set day-ahead and real-time LMP	February 1, 2014	Limit equal to actual flow
Warren	PENELEC	Allow unit(s) needed for reactive to set day-ahead and real-time LMP	September 26, 2014	Limit equal to actual flow

Figure 4-7 shows the approximate geographic location of PJM’s closed loop interfaces.

<sup>14</sup> See PJM, "Manual 3: Transmission Operations," Revision 48 (December 1, 2015) at "Section 3.8: Transfer Limits (Reactive/Voltage Transfer Limits)," for a description of reactive interfaces.  
<sup>15</sup> See closed loop interfaces definitions at <<http://www.pjm.com/markets-and-operations/etools/oasis/system-information.aspx>>.  
<sup>16</sup> See the PS North interface definition at <<http://www.pjm.com/pub/account/auction-user-info/model-annual/Annual-PJM-interface-definitions-limits.csv>>.

PJM's uses closed loop interfaces to artificially use the strike price of emergency DR to set LMP. This use of closed loop interfaces permits subjective price setting by PJM. PJM has not explained why the economic fundamentals require that DR strike prices set LMP when the resource is not marginal. Although DR should be nodal, DR is not nodal and cannot routinely set price in an LMP model. The MMU has recommended that DR be nodal so that it can set price when appropriate. The current PJM rules permit emergency DR to set a strike price as high as \$1,849. There are no incentives for DR to set strike prices at an economically rational level because emergency DR is guaranteed the payment of its strike price whenever called. The MMU has recommended that emergency DR have an offer cap no higher than generation resources, that emergency DR be required to make offers in the Day-Ahead Energy Market like other capacity resources and the emergency DR be paid LMP rather than a guaranteed strike price when called on. PJM's use of closed loop interfaces is a result of significant deficiencies in the rules governing DR. PJM's use of closed loop interfaces is also a result of significant issues with PJM's scarcity pricing model which is not adequately locational. PJM uses closed loop interfaces and emergency DR strike prices as a substitute for improved scarcity pricing.

In a DC power flow model, such as the one used by PJM for dispatch and pricing, units scheduled for reactive support are only marginal when they are needed to supply energy above their economic minimum. With the use of closed loop interface, these units are forced to be marginal in the model even when not needed for energy, by adjusting the limit of the closed loop interface. This artificially creates congestion in the area that can only be relieved by the units providing reactive support inside the loop. The goal is to reduce energy uplift from the noneconomic operation of units needed for reactive support by forcing these units to be marginal when they are not, raising energy prices and thereby reducing uplift.<sup>17</sup>

The MMU has recommended and supports PJM's goal of having dispatcher decisions reflected in transparent market outcomes, preferably LMP, to the maximum extent possible and to minimize the level and rate of energy uplift

<sup>17</sup> See "PJM Price-Setting Changes," presented to the EMUSTF at <<http://www.pjm.com/~media/committees-groups/task-forces/emustf/20131220/20131220-item-02c-price-setting-option.ashx>>.

charges. But part of that goal is to avoid distortion of the way in which the transmission network is modeled. The use of closed loop interfaces is a distortion of the model.

The MMU recommends that PJM not use closed loop interface constraints to artificially override the nodal prices that are based on fundamental LMP logic in order to: accommodate rather than resolve the inadequacies of the demand side resource capacity product; address the inability of the power flow model to incorporate the need for reactive power; accommodate rather than resolve the flaws in PJM's approach to scarcity pricing; or for any other reason.

Market prices should be a function of market fundamentals and energy market prices should be a function of energy market fundamentals. PJM has not explained why the other consequences of deviating from market fundamentals do not outweigh any benefits of artificially creating constraints in order to let reactive resources set price when they are not in fact marginal. PJM has not explained why the use of closed loop interfaces to permit emergency DR to set price is not simply a crude workaround to a viable solution, consistent with the LMP model, which would be to make DR nodal. The need for closed loop interfaces to let emergency DR set price is primarily a result of the fact that DR is zonal, or subzonal with one day's notice, and therefore cannot be dispatched nodally or set price nodally. The reduction of uplift is a reasonable goal in general, but the reduction of uplift is not a goal that justifies creating distortions in the price setting mechanism.

## Price Setting Logic

In November 2014, PJM implemented a software change to its day ahead and real time market solution tools that would enable PJM to reduce energy uplift by artificially selecting the marginal unit for any constraint. The goal is to make marginal any unit committed by PJM to provide reactive services, black start or transmission constraint relief if such unit would otherwise run with an incremental offer greater than the correctly calculated LMP. PJM calls this approach price setting logic.

The application of the price setting logic reduces energy uplift payments by artificially increasing the LMP. The price setting logic is a form of subjective pricing because it varies from fundamental LMP logic based on an administrative decision to reduce energy uplift.

PJM and Alstom presented examples of this approach at the FERC Technical Conference: Increasing Real-Time and Day-Ahead Market Efficiency Through Improved Software.<sup>18</sup> The presentation shows a two bus model connected by one transmission line, three generators (A, B and C) and load at one of the buses. In the solution based on the fundamental LMP logic that PJM has used since the inception of markets, two of the generators are committed (A at 50 MW and B at 50 MW) to serve load (100 MW). The LMP is set at \$50 per MWh (the offer of generator A) at both buses. Generator B has to be made whole (paid energy uplift) because the LMP (\$50 per MWh) does not cover the generator's offer (\$100 per MWh). Generator B does not set the LMP because its economic minimum is higher than the relief needed to relieve the constraint. This solution is not acceptable for PJM because the most expensive generator would have to be made whole. In order to reduce energy uplift, PJM shows two alternatives. Solution 2: Reduce the economic minimum of generator B to zero MW. Solution 3: Reduce the limit of the transmission line to a level that would make the LMP higher at the bus where the most expensive generator is connected.

In solution 2, generator B is dispatched at 10 MW, despite the fact that this is physically impossible. This allows generator A to increase its output to 80 MW, which makes the transmission constraint binding and causes price separation between the two buses. This is an artificial result, not consistent with actual dispatch, designed to achieve an administrative goal.

In solution 3, the line limit is reduced from 80 MW to 40 MW, despite the fact that this is not the actual limit. As a result, generator A is dispatched to 40 MW (10 MW less than the original solution), the transmission line constraint is binding and congestion occurs. The goal is met and energy uplift is reduced

<sup>18</sup> See PJM/Alstom. "Approaches to Reduce Energy Uplift and PJM Experiences," presented at the FERC Technical Conference: Increasing Real-Time and Day-Ahead Market Efficiency Through Improved Software in Docket No. AD10-12-006 <<http://www.ferc.gov/june-tech-conf/2015/presentations/m2-3.pdf>> (June 23, 2015).

to zero because the LMPs at both buses are increased so that they equal or exceed the generators' offers. Again, this is an artificial result, not consistent with actual dispatch, designed to achieve an administrative goal.

Attempting to reduce uplift at the expense of fundamental LMP logic is not consistent with the objective of clearing the market using a least cost approach. The result of PJM's price setting logic in this example is to increase total production costs.

The MMU recommends that PJM not use price setting logic to artificially override the nodal prices that are based on fundamental LMP logic in order to reduce uplift.

## Confidentiality of Energy Uplift Information

All data posted publicly by PJM or the MMU must comply with confidentiality rules. Prior to March 31, 2016, confidentiality rules did not allow posting data for three or fewer PJM participants and did not permit aggregation for a geographic area smaller than a control zone.<sup>19</sup>

Energy uplift charges are out of market, non-transparent payments made to resources operating at PJM's direction. Energy uplift charges are highly concentrated in a small number of zones and paid to a small number of PJM participants. These costs are not reflected in PJM market prices. Current confidentiality rules prevent the publication of detailed data concerning the reasons and locations of these payments, making it difficult for other participants to compete with the resources receiving energy uplift payments. Uplift charges are not included in the transmission planning process meaning that transmission solutions are not considered. The confidentiality rules were implemented in order to protect competition. The application of confidentiality rules in the case of energy uplift information does exactly the opposite. Energy uplift is not a market and the absence of relevant information creates a barrier to entry. The MMU recommends that PJM revise the current energy uplift confidentiality rules in order to allow the disclosure of energy uplift credits by zone, by owner and by resource. PJM partially

<sup>19</sup> See PJM. Manual 33: Administrative Services for the PJM Interconnection Operating Agreement, Revision 12 (March 31, 2016) at "Market Data Postings."

adopted the MMU recommendation at the March 31, 2016, Markets and Reliability Committee (MRC).<sup>20</sup> PJM adopted a rule permitting the posting of energy uplift information by control zone, regardless of the number of PJM participants receiving energy uplift payments in that control zone.

## Energy Uplift Recommendations

### Recommendations for Calculation of Credits

#### Day-Ahead Operating Reserve Elimination

The only reason to pay energy uplift in the Day-Ahead Energy Market is that a day-ahead schedule could cause a unit to incur losses as a result of differences between the Day-Ahead and Balancing Markets. Units cannot incur losses in the Day-Ahead Energy Market. Units do not incur costs in the Day-Ahead Energy Market. There is no reason to pay energy uplift in the Day-Ahead Energy Market. All energy uplift should be paid in real time including energy uplift that results from differences between day-ahead and real-time schedules. Paying energy uplift in the Day-Ahead Energy Market results in overpayments.

Day-ahead operating reserve credits are paid to market participants under specific conditions in order to ensure that units are not scheduled in the Day-Ahead Energy Market by PJM to operate at a loss in real time. Balancing operating reserve credits are paid to market participants under specific conditions in order to ensure that units are not operated by PJM at a loss in real time. Units are paid day-ahead operating reserve credits whenever their total offer (including no load and startup costs and based on their day-ahead scheduled output) is not covered by the day-ahead energy revenues (day-ahead LMP times day-ahead scheduled output). Units are paid balancing operating reserve credits whenever their total offer (including no load and startup costs and based on their real-time output) are not covered by their day-ahead energy revenues, balancing energy revenues and a subset of net ancillary services revenues.<sup>21</sup>

<sup>20</sup> See the Markets and Reliability Committee (March 31, 2016) minutes <<http://www.pjm.com/~media/committees-groups/committees/mrc/20160418-special/20160418-item-01-draft-minutes-mrc.ashx>>

<sup>21</sup> The balancing operating reserve credit calculation includes net DASR revenues, net synchronized reserve revenues, net non-synchronized reserve revenues and reactive services revenues.

Units scheduled in the Day-Ahead Energy Market do not operate until committed or dispatched in real time. Therefore, it cannot be determined if a unit was operated at a loss until the unit actually operates or does not operate. The current operating reserve rules governing the day-ahead operating reserve credits assume that units are going to operate exactly as scheduled because they are made whole based on their day-ahead scheduled output. A unit's real-time output may be greater or lower than their day-ahead scheduled output. Units dispatched in real time by PJM above their day-ahead scheduled output could be paid energy uplift in the form of balancing operating reserve credits if by increasing their output they operate at a loss because their offers are greater than the real-time LMP. Units dispatched in real time by PJM below their day-ahead scheduled output could be paid energy uplift in the form of balancing operating reserve credits if by decreasing their output the units operate at a loss or incur opportunity costs because real-time LMP is greater than the day-ahead LMP. The balancing operating reserve credits and lost opportunity costs credits ensure that units recover their total offers or keep their net revenues in real time.

Units scheduled in the Day-Ahead Energy Market that receive day-ahead operating reserve credits and for which real-time operation results in additional losses, are paid energy uplift in the form of balancing operating reserve or lost opportunity cost credits to ensure that they do not operate at a loss. This determination is not symmetrical because units scheduled in the Day-Ahead Energy Market that receive day-ahead operating reserve credits and for which real-time operation results in reduced losses or not loss do not have a reduction in energy uplift payments.

Units that follow PJM dispatch instructions are made whole through operating reserve credits to ensure that they do not operate at a loss. In order to determine if a unit operated at a loss, it needs to be committed or dispatched. The day-ahead scheduled output is one of PJM's dispatch instructions, but it does not determine if a unit actually operated at a loss. In order to determine if a unit operated at a loss it is necessary to take into account the unit's real-time output and both the day-ahead and balancing energy revenues and ancillary services net revenues.

In order to properly compensate units, the MMU recommended enhancing the day-ahead operating reserve credits calculation to ensure that units receive an energy uplift payment based on their real-time output and not their day-ahead scheduled output whenever their real time operation results in a lower loss or no loss at all. The MMU also recommended including net DASR revenues as part of the offsets used in determining day-ahead operating reserve credits.<sup>22</sup> These recommendations are superseded by the MMU's recommendation to eliminate day-ahead operating reserve payments.<sup>23</sup> The elimination of day-ahead operating reserve payments also ensures that units are always made whole based on their actual operation and actual revenues.

The MMU calculated the impact of this recommendation in 2015 and the first three months of 2016. In 2015 and the first three months of 2016, energy uplift costs associated with units scheduled in the Day-Ahead Energy Market would have had been reduced by \$29.3 million or 16.4 percent (\$2.4 million paid to units providing reactive support, \$0.9 million paid to units providing black start support and \$26.0 million paid to units as day-ahead and balancing operating reserves).

The elimination of the day-ahead operating reserve category would change the allocation of such charges under the current energy uplift rules. If the day-ahead operating reserve category were eliminated but the MMU's uplift allocation recommendations were not implemented, units that clear the Day-Ahead Energy Market would be made whole through balancing operating reserve credits, which under the current rules are allocated to deviations or real-time load plus real-time exports. Therefore, this recommendation should be implemented concurrently with the MMU's allocation recommendations.

## Net Regulation Revenues Offset

On October 1, 2008, PJM filed revisions to the Operating Agreement and Tariff with FERC related to the PJM Regulation Market. The filing included four elements: implement the TPS test in the PJM Regulation Market; increase the

regulation offer adder from \$7.50 per MW to \$12.00 per MW; eliminate the use of net regulation revenues as an offset in the balancing operating reserve calculation; and calculate the lost opportunity cost on the lower of a unit's price-based or cost-based offer. The four elements were based on a settlement rather than a rational evaluation of an efficient market design.

The elimination of the use of net regulation revenues as an offset in the balancing operating reserve calculation had a direct impact on the level of energy uplift paid to participants that regulate while operating noneconomic. The result of not using the net regulation revenues as an offset in the balancing operating reserve credit calculation is that PJM does not accurately calculate whether a unit is running at a loss. PJM procures energy, regulation, synchronized and non-synchronized reserves in a jointly optimized manner. PJM determines the mix of resources that could provide all of those services in a least-cost manner. Excluding the net regulation revenues from the balancing operating reserve credit calculation is inconsistent with the process used by PJM to procure these services and inconsistent with the basic PJM uplift logic. Whether a unit is running for PJM at a loss defined by marginal costs cannot be determined if some of the revenues are arbitrarily excluded.

Another issue related to this exclusion is the treatment of pool-scheduled units that elect to self-schedule a portion of their capacity for regulation. A unit can be pool-scheduled for energy, which means PJM may commit or dispatch the unit based on economics, but it can also self-schedule some of its capacity for regulation. When this happens the capacity self-scheduled for regulation is treated as a price-taker, but in the energy market any increase in MW to provide regulation are treated as additional costs, which can result in increased balancing operating reserve credits whenever the real-time LMP is lower than the unit's offer. For example, if a unit raises its economic minimum in order to provide regulation and the additional costs resulting from operating at a higher economic minimum are not covered by the real-time LMP, the unit will be made whole for the additional costs through balancing operating reserve credits.

<sup>22</sup> See 2013 State of the Market Report for PJM, Volume II Section 4, "Energy Uplift," at "Day-Operating Reserve Credits," and at "Net DASR Revenues Offset" for an explanation of these recommendations.

<sup>23</sup> PJM agrees with this recommendation. See "Explanation of PJM Proposals," from the Energy Market Uplift Senior Task Force (April 30, 2014). <<http://www.pjm.com/~media/committees-groups/task-forces/emustf/20140417/20140417-explanation-of-pjm-proposals.ashx>>.

The MMU recommends reincorporating the use of net regulation revenues as an offset in the calculation of balancing operating reserve credits. In 2015 and the first three months of 2016, using net regulation revenues as an offset in the balancing operating reserve calculation would have resulted in a net decrease of balancing operating reserve charges of \$7.5 million, of which \$5.8 million or 77.1 percent was due to generators that elected to self-schedule for regulation while noneconomic and receiving balancing operating reserve credits.<sup>24</sup>

### Self Scheduled Start

Participants may offer their units as pool-scheduled (economic) or self-scheduled (must run).<sup>25</sup> Units offered as pool-scheduled clear the Day-Ahead Energy Market based on their offers and operate in real time following PJM dispatch instructions. Units offered as self-scheduled clear the Day-Ahead Energy Market regardless of their offers and may operate in real time following PJM dispatch instructions. Units offered as self-scheduled follow PJM dispatch instructions when they are offered with a minimum must run output from which the units may be dispatched up but not down. Self-scheduled units are not eligible to receive day-ahead or balancing operating reserve credits. The current rules determine if a unit is pool-scheduled or self-scheduled for operating reserve credits purposes separately for each hour using the hourly commitment status flag. If the flag is set as economic the unit is assumed to be pool-scheduled, if the flag is set as must run the unit is assumed to be self-scheduled. When a unit submits different flags within a day, the day-ahead operating reserve credit calculation treats each group of hours separately. The day-ahead operating reserve credit calculation only uses the hours flagged as economic and excludes any hours flagged as must run.

Units offered as self-scheduled for some hours of the day and pool-scheduled for the remaining hours are made whole for startup cost when they should not be. For example, if a unit is offered as self-scheduled for hours 10 through 24 and as pool-scheduled for the balance of the day and PJM selects the unit to start for hour nine, the unit will be made whole for its startup cost if the

hourly revenues do not cover the costs. The only hour used in the day-ahead or balancing operating reserve credit calculation is hour nine because the unit is not eligible for operating reserve credits for hours 10 through 24. The result is that any net revenue from hours 10 through 18 will not be used to offset the unit's startup cost despite the fact that the unit would have started and incurred those costs regardless of PJM dispatch instructions.

The MMU recommends that self-scheduled units not be paid energy uplift for their startup cost when the units are scheduled by PJM to start before the self-scheduled hours.

### Lost Opportunity Cost Calculation

The current energy LOC calculations are inaccurate and create unreasonable compensation. The MMU recommended four modifications, of which three were adopted on September 1, 2015.<sup>26 27</sup> The one outstanding modification not adopted by PJM is the calculation of LOC using segments of hours. Current rules calculate LOC on an hourly basis; each hour is treated as a standalone calculation. This means that units receive an LOC payment during hours in which it is economic for them to run and receive the benefit of not being called on during hours in which it is not economic for them to run. PJM dispatchers might make the right decision to not call a unit in real time because the operation of the unit during all the hours in which the unit cleared the Day-Ahead Energy Market would not be economic, but the unit could still receive an LOC payment.

This is inconsistent with the basic PJM energy uplift logic. If a unit does not run in real time, it loses net revenues if the real-time LMP is greater than the unit's offer but it gains net revenues if the real-time LMP is lower than the unit's offer. The correct lost opportunity costs for units that clear the Day-Ahead Energy Market and are not committed in real time cannot be determined if profitable hours are arbitrarily excluded. In the case of separate hourly calculations, units are overcompensated compared to the net revenues they would have received had they run.

<sup>24</sup> These estimates take into account the elimination of the day-ahead operating reserve category.

<sup>25</sup> See "PJM eMkt Users Guide," Section Managing Unit Data (version July 9, 2015) p. 42. <<http://www.pjm.com/~media/etools/emkt/ts-userguide.ashx>>.

<sup>26</sup> See 2015 State of the Market Report for PJM, Volume II Section 4, "Energy Uplift," at "Lost Opportunity Cost Calculation" for an explanation of the adopted recommendations.

<sup>27</sup> 152 FERC ¶ 61,165 (2015).

The MMU recommends calculating LOC based on 24 hour daily periods or multi-hour segments of hours for combustion turbines and diesels scheduled in the Day-Ahead Energy Market but not committed in real time. This recommendation has not been adopted. The MMU calculated the impact of this recommendation in the first three months of 2016. In the first three months of 2016, lost opportunity cost payments would have had been reduced by \$1.2 million or 22.0 percent.

In addition to the initial four recommendations, the MMU recommends three additional steps to address issues with the current LOC calculations:

- **Achievable Output:** CTs and diesels are compensated for LOC when scheduled in the Day-Ahead Energy Market and not committed in real time. This LOC calculation uses the day-ahead scheduled output as the achievable output for which units are entitled to receive LOC compensation. Units are paid LOC based on the difference between the real-time energy price (RT LMP) and the unit's offer times the day-ahead scheduled output. The actual LOC is a function of the real-time desired and achievable output rather than the day-ahead scheduled output. If a unit is capable of profitably producing more or fewer MWh in real time than the day-ahead scheduled MWh, it is the actual foregone MWh in real time that define actual LOC. Also, if a unit is not capable of producing at the day-ahead scheduled output level in real time it should not be compensated based on an output that cannot be achieved.

The MMU recommends that units scheduled in the Day-Ahead Energy Market and not committed in real time should be compensated for LOC based on their real-time desired and achievable output, not their scheduled day-ahead output.
- **Intra-Hour Calculations:** CTs and diesels scheduled in the Day-Ahead Energy Market and not committed in real time are compensated for LOC based on their real-time hourly integrated output. In order to compensate a unit for LOC, PJM must determine if the unit was scheduled in the Day-Ahead Energy Market and if the unit was not committed in real time. Units clear the Day-Ahead Energy Market for full hours. That means that if a unit cleared the Day-Ahead Energy Market in an hour it is expected

to produce energy in real time for the entire hour. The determination by PJM of whether a unit is committed or not committed in real time is based on the unit's hourly integrated output. If the hourly integrated output is greater than zero that means the unit was committed during that hour. But in real time a unit may be committed for part of an hour. The calculation of LOC does not reflect the exact time at which the unit was turned on.

The MMU recommends that units scheduled in the Day-Ahead Energy Market and not committed in real time be compensated for LOC incurred within an hour.

- **LOC Unit Type Eligibility:** The current rules compensate only CTs and diesels for LOC when scheduled in the Day-Ahead Energy Market and not committed in real time. The reason for this difference is that other unit types have a commitment obligation when scheduled in the Day-Ahead Energy Market. For example, steam turbines and combined cycle units commitment instructions are their day-ahead schedule. Units of these types that clear the Day-Ahead Energy Market are automatically committed to be on or remain on in real time. These units are eligible for LOC compensation only if PJM explicitly cancels their day-ahead commitment for reliability purposes. CT and diesel commitment instructions occur in real time even if these units were committed in the Day-Ahead Energy Market. CTs and diesels are committed in real time, after PJM dispatch has a more complete knowledge of real-time conditions. The goal is to permit the dispatch of flexible units in real time based on real-time conditions as they evolve. The reason for this special treatment of CTs and diesels is that historically, such units were usually more flexible to commit than other unit types. But that is no longer correct and should not be assumed to be correct.

The MMU recommends that only flexible fast start units (startup plus notification times of 30 minutes or less) and short minimum run times (one hour or less) be eligible by default for the LOC compensation to units scheduled in the Day-Ahead Energy Market and not committed in real time.

## Recommendations for Allocation of Charges

### Up to Congestion Transactions

Up to congestion transactions do not pay energy uplift charges. An up to congestion transaction affects unit commitment and dispatch in the same way that increment offers and decrement bids affect unit commitment and dispatch in the Day-Ahead Energy Market. All such virtual transactions affect the results of the Day-Ahead Energy Market and contribute to energy uplift costs. Up to congestion transactions are currently receiving preferential treatment, relative to increment offers and decrement bids and other transactions because they are not charged energy uplift.

The MMU recommends that up to congestion transactions be required to pay energy uplift charges.

The MMU calculated the impact on energy uplift rates if up to congestion transactions had paid energy uplift charges based on deviations in the same way that increment offers and decrement bids do along with other recommendations that impact the total costs of energy uplift and its allocation.

Up to congestion transactions would have paid an average rate between \$0.291 and \$0.296 per MWh in 2015 and between \$0.050 and \$0.085 per MWh in the first three months of 2016 if the MMU's recommendations regarding energy uplift had been in place.<sup>28 29</sup>

### Internal Bilateral Transactions

Market participants are allocated a portion of the costs of balancing operating reserves based on their deviations. Deviations are calculated in three categories, demand, supply and generation. Generators deviate when their real-time output is different than the desired output or their day-ahead scheduled

output.<sup>30</sup> Load, interchange transactions, internal bilateral transactions, demand resources, increment offers and decrement bids also incur deviations.

Generators are allowed to offset their deviations with other generators at the same bus if the generators have the same electrical impact on the transmission system. For example, a generator with a negative deviation (generation below the desired level) can offset such deviation if a generator at the same bus has a positive deviation (generation above the desired level) if this occurs in the same hour.

Load, interchange transactions, internal bilateral transactions, demand resources, increment offers and decrement bids are also allowed to offset their deviations. These transactions are grouped by demand and supply, and then aggregated by location. A negative deviation from one transaction can offset a positive deviation from another transaction in the same category, as long as both transactions are at the same location at the same hour.<sup>31</sup> Demand transactions such as load, exports, internal bilateral sales and decrement bids may offset. The same applies to supply transactions such as imports, internal bilateral purchases and increment offers. Unlike all other transaction types, internal bilateral sales and purchases do not impact dispatch or market prices. Internal bilateral transactions (IBTs) are used by participants to transfer the financial responsibility or right of the energy withdrawn or injected into the system in the Day-Ahead and Real-Time Energy Markets.

IBTs should not pay for balancing operating reserves and should not be used to offset other transactions that deviate. IBTs shift the responsibility for an injection or withdrawal in PJM from one participant to another but IBTs are not part of the day-ahead unit commitment process, do not set energy prices and do not impact the energy flows in either the Day-Ahead or the Real-Time Energy Market, and thus IBTs should not be considered in the allocation of balancing operating reserve charges. The use of IBTs has been extended to offset deviations from other transactions that do impact the energy market. The elimination of the use of IBTs in the deviation calculation would eliminate

<sup>28</sup> The range of operating reserve rates paid by up to congestion transactions depends on the location of the transactions' source and sink.  
<sup>29</sup> This analysis assumes that not all costs associated with units providing support to the Con Edison – PJM Transmission Service Agreements would be reallocated under the MMU's proposal. The 2013 State of the Market Report for PJM analysis assumed that all such costs would be reallocated. This analysis also assumes that only 50 percent of all cleared up to congestion transactions would have cleared had this recommendation been in place prior to September 8, 2014 and all cleared up to congestion transactions would have cleared after September 8, 2014. The 2013 State of the Market Report for PJM analysis showed that more than 66.7 percent of up to congestion transactions would have remained under the MMU proposal.

<sup>30</sup> See PJM. OATT 3.2.3 (o) for a complete description of how generators deviate.

<sup>31</sup> Locations can be control zones, hubs, aggregates and interfaces. See "Determinants and Deviation Categories" in this section for a description of balancing operating reserve locations.

the balancing operating reserve charges to participants that use IBTs only in real time. Such elimination would increase the balancing operating reserve charges to participants that use IBTs to offset deviations from day-ahead transactions.

The MMU recommends eliminating the use of internal bilateral transactions (IBTs) in the calculation of deviations used to allocate balancing operating reserve charges.

### Day-Ahead Reliability Energy Uplift Allocation

PJM may schedule units as must run in the Day-Ahead Energy Market when needed in real time to address reliability issues in four categories: voltage issues (high and low); black start requirements (from automatic load rejection units); local contingencies not modeled in the Day-Ahead Energy Market; and long lead time units not able to be scheduled in the Day-Ahead Energy Market.<sup>32</sup> The energy uplift paid to units scheduled for voltage is allocated to real-time load. The energy uplift associated with units scheduled for black start is allocated to real-time load and interchange reservations. The energy uplift paid to units scheduled because of local contingencies not modeled in the Day-Ahead Energy Market and scheduled because of their long lead times is allocated to day-ahead demand, day-ahead exports and decrement bids.

The MMU recommends allocating the energy uplift payments to units scheduled as must run in the Day-Ahead Energy Market for reasons other than voltage/reactive or black start services as a reliability charge to real-time load, real-time exports and real-time wheels.

### Con Edison – PJM Transmission Service Agreements Support

It appears that certain units located near the boundary between New Jersey and New York City are frequently operated to support the transmission service agreements between Con Ed and PJM, formerly known as the Con Ed – PSEG

Wheeling Contracts.<sup>33</sup> These units are often run out of merit and receive substantial day-ahead and balancing operating reserve credits.

The MMU recommends that this issue be addressed by PJM in order to determine if the cost of running these units is being allocated properly.

### Reactive Services Credits and Balancing Operating Reserve Credits

Energy uplift credits to resources providing reactive services are separate from balancing operating reserve credits.<sup>34</sup> Under the current rules regarding energy uplift credits for reactive services, units are not assured recovery of the entire offer including no load and startup costs as they are under the operating reserve credits rules. Units providing reactive services at the request of PJM are made whole through reactive service credits. But when the reactive services credits do not cover a unit's entire offer, the unit is made whole for the balance through balancing operating reserves. The result is a misallocation of the costs of providing reactive services. Reactive services credits are paid by real-time load in the control zone or zones where the service is provided while balancing operating reserve charges are paid by deviations from day-ahead or real-time load plus exports in the RTO, Eastern or Western Region depending on the allocation process rather than by zone.

In the first three months of 2016, units providing reactive services were paid \$0.1 million in balancing operating reserve credits in order to cover their total energy offer. In 2015, this misallocation was \$1.0 million.

The MMU recommends that reactive services credits be calculated consistent with the balancing operating reserve credit calculation. The MMU also recommends including real-time exports and real-time wheels in the allocation of the cost of providing reactive support to the 500 kV system or above, in addition to real-time load.<sup>35</sup>

<sup>32</sup> See PJM, "Item 12 - October 2012 MIC DAM Cost Allocation," PJM presentation to the Market Implementation Committee (October 12, 2012).

<sup>33</sup> See the 2015 State of the Market Report for PJM, Volume II, Section 9, "Interchange Transactions" at "Consolidated Edison Company of New York, Inc. (Con Edison) Wheeling Contracts" for a description of the contracts.

<sup>34</sup> PJM, OATT Attachment K - Appendix § 3.2.3B (f).

<sup>35</sup> See the Day-Ahead Reliability and Reactive Cost Allocation Final Report (December 13, 2013) for a complete description of the issues discussed in that group. <<http://www.pjm.com/~media/committees-groups/task-forces/emustf/20131220/20131220-item-02b-darrrca-final-report.ashx>>.

## Allocation Proposal

The day-ahead operating reserve category elimination and other MMU recommendations require enhancements to the current method of energy uplift allocation.

The current method allocates day-ahead operating reserve charges to day-ahead load, day-ahead exports and decrement bids. The elimination of the day-ahead operating reserve category would shift these costs to the balancing operating reserve category which would be paid by deviations or by real-time load plus real-time exports depending on the balancing operating reserve allocation rules.

The MMU recommends creating a new category for energy uplift payments to units scheduled in the Day-Ahead Energy Market (for reasons other than reactive or black start services), which would be allocated to all day-ahead transactions and resources. All these transaction types have an impact on the outcome of the day-ahead scheduling process, so allocating these costs to all day-ahead transactions ensures that all transactions that affect the way the Day-Ahead Energy Market clears are responsible for any energy uplift credits paid to the units scheduled in the Day-Ahead Energy Market. Energy uplift payments to units scheduled as must run in the Day-Ahead Energy Market (for reasons related to expected conditions in the real-time market not including reactive or black start services) should be allocated to real-time load, real-time exports and real-time wheels.

The MMU recommends allocating energy uplift payments to units not scheduled in the Day-Ahead Energy Market and committed in real time, but before the operating day, to the current deviation categories with the addition of up to congestion, wheels and units that clear the Day-Ahead Scheduling Reserve Market but do not perform.

The MMU recommends the exclusion of offsets based on internal bilateral transactions. These costs should be allocated to the current deviation categories whenever the units receiving energy uplift payments are committed before the operating day.

The MMU recommends allocating energy uplift payments to units committed during the operating day to a new deviation category which would include physical transactions or resources (day-ahead minus real-time load, day-ahead minus real-time interchange transactions, generators and DR not following dispatch). This allocation would ensure that commitment changes that occur during the operating day and that result in energy uplift payments are paid by transactions or resources affecting the commitment of units during the operating day. For example, real-time load or interchange transactions that do not bid in the Day-Ahead Energy Market, generators and DR resources that do not follow dispatch would be allocated these costs. Any reliability commitment should be allocated to real-time load, real-time exports and real-time wheels independently of the timing of the commitment.

The MMU recommends changing the allocation of lost opportunity cost and canceled resources. LOC paid to units scheduled in the Day-Ahead Energy Market and not committed in real time should be allocated to deviations based on the proposed definition of deviations. LOC paid to units reduced for reliability in real time and payments to canceled resources should be allocated to real-time load, real-time exports and real-time wheels.

Table 4-34 shows the current allocation by energy uplift reason. For example, energy uplift payments to units scheduled in the Day-Ahead Energy Market are called day-ahead operating reserves, these costs are paid by day-ahead load, day-ahead exports and decrement bids. Any additional payment resulting from the real time operation of these units are called balancing operating reserves, these costs are paid by either deviations or real-time load and real-time exports depending on the amount of intervals the units are economic.

**Table 4-34 Current energy uplift allocation**

Reason	Energy Uplift Category	Allocation Logic	Allocation
Units scheduled in the Day-Ahead Energy Market	Day-Ahead Operating Reserve	NA	Day-Ahead Load, Day-Ahead Exports and Decrement Bids
Units scheduled in the Day-Ahead Energy Market	Balancing Operating Reserve	LMP < Offer for at least four intervals	Real-Time Load and Real-Time Exports
		LMP > Offer for at least four intervals	Deviations
Unit not scheduled in the Day-Ahead Energy Market and committed in real time	Balancing Operating Reserve	Committed before the operating day for reliability	Real-Time Load and Real-Time Exports
		Committed before the operating day to meet forecasted load and reserves	Deviations
		Committed during the operating day and LMP < Offer for at least four intervals	Real-Time Load and Real-Time Exports
		Committed during the operating day and LMP > Offer for at least four intervals	Deviations
Units scheduled in the Day-Ahead Energy Market not committed in real time	LOC Credit	NA	Deviations
Units reduced for reliability in real time	LOC Credit	NA	Deviations
Units canceled before coming online	Cancellation Credit	NA	Deviations

Table 4-35 shows the MMU allocation proposal by energy uplift reason. The proposal eliminates the day-ahead operating reserve category and creates a new category for any energy uplift payments to units scheduled in the Day-Ahead Energy Market and committed in real time. This new category would be allocated to day-ahead transactions and resources. The proposal also eliminates the need to determine the number of intervals that units are economic to determine if the energy uplift charge should be allocated to deviations or to real-time load and real-time exports. In the proposal, any commitment instruction before the operating day would be allocated based on the proposed definition of deviations; any commitment instruction during the operating day would be allocated to physical deviations.

**Table 4-35 MMU energy uplift allocation proposal**

Reason	Energy Uplift Category	Allocation Logic	Allocation
Units scheduled in the Day-Ahead Energy Market and committed in real time	Day-Ahead Segment Make Whole Credit	Scheduled by the day ahead model (not must run)	Day-Ahead Transactions and Day-Ahead Resources
		Scheduled as must run in the day ahead model	Real-Time Load, Real-Time Exports and Withdrawal Side of Real-Time Wheels
Units not scheduled in the Day-Ahead Energy Market and committed in real time	Real Time Segment Make Whole Credit	Committed before the operating day	Deviations
		Committed during the operating day	Physical Deviations
		Any commitment for reliability	Real-Time Load, Real-Time Exports and Withdrawal Side of Real-Time Wheels
Units scheduled in the Day-Ahead Energy Market not committed in real time	Day-Ahead LOC	NA	Deviations
Units reduced for reliability in real time	Real-Time LOC	NA	Real-Time Load, Real-Time Exports and Withdrawal Side of Real-Time Wheels
Units canceled before coming online	Cancellation Credit	NA	Real-Time Load, Real-Time Exports and Withdrawal Side of Real-Time Wheels

## Quantifiable Recommendations Impact

Table 4-36 shows energy uplift charges based on the current allocation and energy uplift charges based on the MMU allocation proposal including the MMU recommendations regarding energy uplift credit calculations. Total charges (excluding black start and reactive services charges) would have been reduced by \$56.0 million or 16.7 percent in 2015 and the first three months of 2016 if three recommendations regarding energy uplift credit calculations proposed by the MMU had been implemented. The elimination of the day-ahead operating reserve credit would have resulted in a decrease of \$26.0 million, the proposed changes to lost opportunity cost calculations would have resulted in a decrease of \$22.6 million and the use of net regulation revenues offset would have

resulted in a decrease of \$7.5 million.<sup>36</sup> Table 4-36 shows that deviations charges would have been reduced by \$94.5 million or 55.9 percent. The reason for this change is that, besides the reduction in the overall charges, under the MMU proposal, a subset of charges is reallocated to a new physical deviation category (based on the timing of the commitment of the resource being paid energy uplift) and another subset of charges is allocated to real-time load, real-time exports and real-time wheels (based on reliability actions).

**Table 4-36 Current and proposed energy uplift charges by allocation (Millions): 2015 and January through March 2016<sup>37</sup>**

Allocation	Jan - Mar		Total
	2015	2016	
<b>Current</b>			
Day-Ahead Demand, Day-Ahead Exports and Decrement Bids	\$98.5	\$21.3	\$119.9
Real-Time Load and Real-Time Exports	\$41.1	\$5.0	\$46.2
Deviations	\$156.5	\$12.4	\$169.0
Total	\$296.2	\$38.8	\$335.0
<b>Proposal</b>			
Day-Ahead Transactions and Day-Ahead Resources	\$27.5	\$2.5	\$30.1
Real-Time Load and Real-Time Exports	\$99.1	\$17.0	\$116.0
Deviations	\$68.5	\$6.0	\$74.5
Physical Deviations	\$51.0	\$7.4	\$58.4
Total	\$246.1	\$32.9	\$279.0
<b>Impact</b>			
Impact (\$)	(\$50.0)	(\$5.9)	(\$56.0)
Impact (%)	(16.9%)	(15.3%)	(16.7%)

The MMU calculated the rates that participants would have paid in 2015 and the first three months of 2016 if all the MMU's recommendations on energy uplift had been in place. These recommendations have been included in the analysis: day-ahead operating reserve elimination; net regulation revenues offset; implementation of the proposed changes to lost opportunity cost calculations; reallocation of operating reserve credits paid to units scheduled as must run in the Day-Ahead Energy Market (for reasons other than reactive or black start services); reallocation of operating reserve credits paid to units supporting the Con Edison - PJM Transmission Service Agreements; elimination of internal bilateral transactions from the deviations calculation;

<sup>36</sup> The total impact of the elimination of the day-ahead operating reserve credit and the impact of net regulation revenues offset is greater because they also impact black start and reactive services charges.

<sup>37</sup> These energy uplift charges do not include black start and reactive services charges.

allocation of energy uplift charges to up to congestion transactions and the MMU energy uplift allocation proposal.

Table 4-37 shows the energy uplift cost of a 1 MW transaction if these recommendations had been implemented in 2015 and the first three months of 2016. Table 4-37 assumes two scenarios under the MMU proposal. The first scenario assumes all the up to congestion transactions volume cleared. The second scenario assumes zero volume of up to congestion transactions in 2015 and the first three months of 2016, in this scenario, the cost reflects the expected cost for the first 1 MW cleared up to congestion transaction. Table 4-37 shows for example that a decrement bid in the Eastern Region (if not offset by other transactions) would have paid an average rate of \$0.148 and \$0.043 per MWh in the 2015 and the first three months of 2016, under the first scenario, \$1.030 and \$0.440 per MWh less than the actual average rate paid. Up to congestion transactions sourced in the Eastern Region and sinking in the Western Region would have paid an average rate of \$0.294 and \$0.068 per MWh in 2015 and in the first three months of 2016 under the first scenario. Table 4-37 shows the current and proposed averages energy uplift rates for all transactions.

**Table 4-37 Current and proposed average energy uplift rate by transaction: 2015 and January through March 2016<sup>38</sup>**

Transaction	2015			Jan - Mar 2016		
	Current Rates (\$/MWh)	Proposed Rates - 100% UTC (\$/MWh)	Proposed Rates - 0% UTC (\$/MWh)	Current Rates (\$/MWh)	Proposed Rates - 100% UTC (\$/MWh)	Proposed Rates - 0% UTC (\$/MWh)
INC	1.063	0.148	0.378	0.378	0.043	0.154
DEC	1.178	0.148	0.378	0.483	0.043	0.154
East						
DA Load	0.115	0.013	0.015	0.105	0.004	0.006
RT Load	0.050	0.117	0.117	0.031	0.088	0.088
Deviation	1.063	0.498	0.726	0.378	0.290	0.400
West						
INC	1.027	0.146	0.379	0.250	0.025	0.101
DEC	1.143	0.146	0.379	0.355	0.025	0.101
DA Load	0.115	0.013	0.015	0.105	0.004	0.006
RT Load	0.042	0.117	0.117	0.017	0.088	0.088
Deviation	1.027	0.430	0.661	0.250	0.150	0.225
UTC						
East to East	NA	0.296	0.756	NA	0.085	0.308
West to West	NA	0.291	0.757	NA	0.050	0.203
East to/from West	NA	0.294	0.757	NA	0.068	0.255


## January through March Energy Uplift Charges Analysis

Energy uplift charges decreased by \$147.3 million (79.0 percent), from \$186.4 million in the first three months of 2015 to \$39.1 million in the first three months of 2016. This change resulted from a decrease of \$33.9 million in day-ahead operating reserve charges, a decrease of \$102.7 million in balancing operating reserve charges, a decrease of \$6.0 million in reactive services charges and a decrease of \$4.7 in black start services charges.

Figure 4-8 shows the net impact of each category on the change in total energy uplift charges from the first three months of 2015 level to the first three months of 2016 level. The outside bars show the total energy uplift charges in the first three months of 2015 (left side) and total energy uplift charges in the first three months of 2016 (right side). The other bars show the change in each energy uplift category. For example, the second bar from the left shows the change in day-ahead operating reserve charges in the first three months of 2015 compared to the first three months of 2016 (a decrease of \$33.9 million).

<sup>38</sup> The deviation transaction means load, interchange transactions, generators and DR deviations.

**Figure 4-8 Energy uplift charges change from January through March 2015 to January through March 2016 by category**

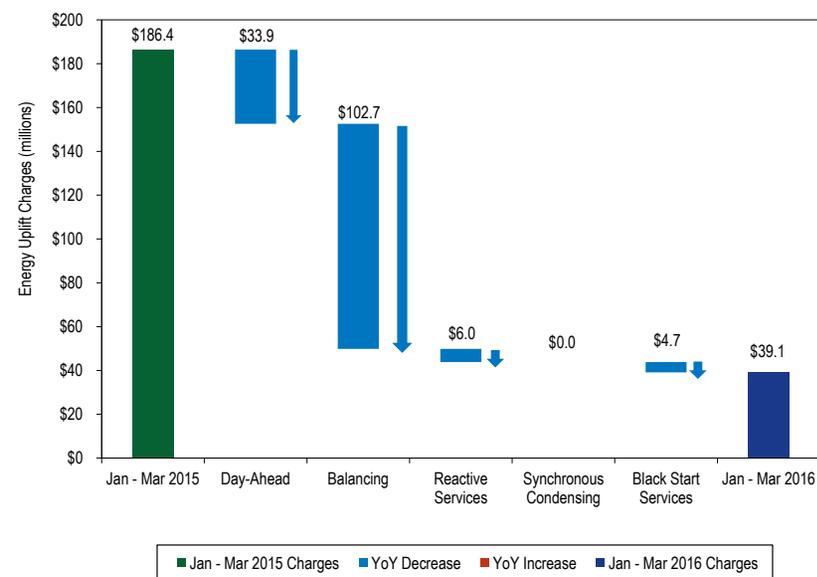

## Capacity Market

Each organization serving PJM load must meet its capacity obligations through the PJM Capacity Market, where load serving entities (LSEs) must pay the locational capacity price for their zone. LSEs can also construct generation and offer it into the capacity market, enter into bilateral contracts, develop demand resources and energy efficiency (EE) resources and offer them into the capacity market, or construct transmission upgrades and offer them into the capacity market.

The Market Monitoring Unit (MMU) analyzed market structure, participant conduct and market performance in the PJM Capacity Market for the first three months of 2016, including supply, demand, concentration ratios, pivotal suppliers, volumes, prices, outage rates and reliability.<sup>1</sup>

**Table 5-1 The capacity market results were competitive**

Market Element	Evaluation	Market Design
Market Structure: Aggregate Market	Not Competitive	
Market Structure: Local Market	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Mixed

- The aggregate market structure was evaluated as not competitive. For almost all auctions held from 2007 to the present, the PJM region failed the three pivotal supplier test (TPS), which is conducted at the time of the auction.<sup>2</sup>
- The local market structure was evaluated as not competitive. For almost every auction held, all LDAs have failed the TPS test, which is conducted at the time of the auction.<sup>3</sup>
- Participant behavior was evaluated as competitive. Market power mitigation measures were applied when the Capacity Market Seller failed the market power test for the auction, the submitted sell offer exceeded

<sup>1</sup> The values stated in this report for the RTO and LDAs refer to the aggregate level including all nested LDAs unless otherwise specified. For example, RTO values include the entire PJM market and all LDAs. Rest of RTO values are RTO values net of nested LDA values.

<sup>2</sup> In the 2008/2009 RPM Third Incremental Auction, 18 participants in the RTO market passed the TPS test.

<sup>3</sup> In the 2012/2013 RPM Base Residual Auction, six participants included in the incremental supply of EMAAC passed the TPS test. In the 2014/2015 RPM Base Residual Auction, seven participants in the incremental supply in MAAC passed the TPS test.

the defined offer cap, and the submitted sell offer, absent mitigation, would increase the market clearing price. Market power mitigation rules were also applied when the Capacity Market Seller submitted a sell offer for a new resource or uprate that was below the Minimum Offer Price Rule (MOPR) threshold.

- Market performance was evaluated as competitive. Although structural market power exists in the Capacity Market, a competitive outcome resulted from the application of market power mitigation rules.
- Market design was evaluated as mixed because while there are many positive features of the Reliability Pricing Model (RPM) design and the Capacity Performance modifications to RPM, there are several features of the RPM design which still threaten competitive outcomes. These include the definition of DR which permits inferior products to substitute for capacity, the replacement capacity issue, the definition of unit offer parameters and the inclusion of imports which are not substitutes for internal capacity resources.

## Overview

### RPM Capacity Market

#### Market Design

The Reliability Pricing Model (RPM) Capacity Market is a forward-looking, annual, locational market, with a must offer requirement for Existing Generation Capacity Resources and mandatory participation by load, with performance incentives, that includes clear market power mitigation rules and that permits the direct participation of demand-side resources.<sup>4</sup>

Under RPM, capacity obligations are annual. Base Residual Auctions (BRA) are held for Delivery Years that are three years in the future. Effective with the 2012/2013 Delivery Year, First, Second and Third Incremental Auctions (IA) are held for each Delivery Year.<sup>5</sup> Prior to the 2012/2013 Delivery Year, the Second Incremental Auction was conducted if PJM determined that an

<sup>4</sup> The terms *PJM Region*, *RTO Region* and *RTO* are synonymous in this report and include all capacity within the PJM footprint.

<sup>5</sup> See 126 FERC ¶ 61,275 (2009) at P 86.

unforced capacity resource shortage exceeded 100 MW of unforced capacity due to a load forecast increase. Effective January 31, 2010, First, Second, and Third Incremental Auctions are conducted 20, 10, and three months prior to the Delivery Year.<sup>6</sup> Also effective for the 2012/2013 Delivery Year, a Conditional Incremental Auction may be held if there is a need to procure additional capacity resulting from a delay in a planned large transmission upgrade that was modeled in the BRA for the relevant Delivery Year.<sup>7</sup>

The 2016/2017 RPM Third Incremental Auction was conducted in the first three months of 2016.

On June 9, 2015, FERC accepted changes to the PJM capacity market rules proposed in PJM's Capacity Performance (CP) filing.<sup>8</sup> For a transition period during the 2018/2019 and 2019/2020 Delivery Years, PJM will procure two product types, Capacity Performance and Base Capacity. PJM also procured Capacity Performance resources in two transition auctions for Delivery Years 2016/2017 and 2017/2018. Effective with the 2020/2021 Delivery Year, PJM will procure a single capacity product, Capacity Performance. CP Resources are expected to be available and capable of providing energy and reserves when needed at any time during the Delivery Year.<sup>9</sup> Effective for the 2018/2019 through the 2019/2020 Delivery Years, a Base Capacity Demand Resource Constraint and a Base Capacity Resource Constraint are established for each modeled LDA. These maximum quantities are set for reliability purposes to limit the quantity procured of the less available products, including Base Capacity Generation Resources, Base Capacity Demand Resources, and Base Capacity Energy Efficiency Resources. The Capacity Performance (CP) Transition Incremental Auctions (IAs) were held as part of a five year transition to a single capacity product type in the 2020/2021 Delivery Year. Participation in the CP Transition IAs was voluntary. If a resource cleared a CP Transition IA and had a prior commitment for the relevant Delivery Year, the existing commitment was converted to a CP commitment which is subject to the CP performance requirements and Non-Performance Charges. The Transition IAs were not designed to minimize the cost of purchasing Capacity

<sup>6</sup> See *PJM Interconnection, LLC*, Letter Order in Docket No. ER10-366-000 (January 22, 2010).

<sup>7</sup> See 126 FERC ¶ 61,275 (2009) at P 88.

<sup>8</sup> See Docket No. ER15-623-000 (December 12, 2014) and 151 FERC ¶ 61,208 (2015).

<sup>9</sup> See PJM, "Manual 18: PJM Capacity Market," Revision 32 (April 1, 2016), p. 7.

Performance resources for the two delivery years and were not designed to maximize economic welfare for the two delivery years.<sup>10</sup>

RPM prices are locational and may vary depending on transmission constraints.<sup>11</sup> Existing generation capable of qualifying as a capacity resource must be offered into RPM Auctions, except for resources owned by entities that elect the fixed resource requirement (FRR) option. Participation by LSEs is mandatory, except for those entities that elect the FRR option. There is an administratively determined demand curve that defines scarcity pricing levels and that, with the supply curve derived from capacity offers, determines market prices in each BRA. RPM rules provide performance incentives for generation, including the requirement to submit generator outage data and the linking of capacity payments to the level of unforced capacity, and the performance incentives have been strengthened significantly under the Capacity Performance modifications to RPM. Under RPM there are explicit market power mitigation rules that define the must offer requirement, that define structural market power based on the marginal cost of capacity, that define offer caps, that define the minimum offer price, and that have flexible criteria for competitive offers by new entrants. Demand Resources and Energy Efficiency Resources may be offered directly into RPM Auctions and receive the clearing price without mitigation.

## Market Structure

- **PJM Installed Capacity.** During the first three months of 2016, PJM installed capacity increased 809.2 MW or 0.5 percent, from 177,682.8 MW on January 1 to 178,492.0 MW on March 31. Installed capacity includes net capacity imports and exports and can vary on a daily basis.
- **PJM Installed Capacity by Fuel Type.** Of the total installed capacity on March 31, 2016, 37.4 percent was coal; 34.3 percent was gas; 18.6 percent was nuclear; 3.8 percent was oil; 5.0 percent was hydroelectric; 0.5 percent was wind; 0.4 percent was solid waste; and 0.1 percent was solar.

<sup>10</sup> The MMU will publish a detailed report on the operation and design of the transition auctions in 2016.

<sup>11</sup> Transmission constraints are local capacity import capability limitations (low capacity emergency transfer limit (CETL) margin over capacity emergency transfer objective (CETO)) caused by transmission facility limitations, voltage limitations or stability limitations.

- **Market Concentration.** In the 2016/2017 RPM Third Incremental Auction all participants in the total PJM market as well as the LDA RPM markets failed the three pivotal supplier (TPS) test.<sup>12</sup> Offer caps were applied to all sell offers for resources which were subject to mitigation when the Capacity Market Seller did not pass the test, the submitted sell offer exceeded the defined offer cap, and the submitted sell offer, absent mitigation, increased the market clearing price.<sup>13 14 15</sup>
- **Imports and Exports.** Of the 599.7 MW of imports in the 2016/2017 RPM Third Incremental Auction, 8.0 MW cleared. Of the cleared imports, 4.9 MW (61.3 percent) were from MISO.
- **Demand-Side and Energy Efficiency Resources.** Capacity in the RPM load management programs was 12,149.5 MW for June 1, 2015, as a result of cleared capacity for Demand Resources and Energy Efficiency Resources in RPM Auctions for the 2015/2016 Delivery Year (16,643.3 MW) less replacement capacity from sources other than Demand Resources and Energy Efficiency (4,493.8 MW).

## Market Conduct

- **2016/2017 RPM Third Incremental Auction.** Of the 296 generation resources that submitted offers, the MMU calculated offer caps for 52 generation resources (17.6 percent), of which 35 were based on the technology specific default (proxy) ACR values and 17 were unit-specific offer caps (5.7 percent).

<sup>12</sup> There are 27 Locational Deliverability Areas (LDAs) identified to recognize locational constraints as defined in "Reliability Assurance Agreement Among Load Serving Entities in the PJM Region", Schedule 10.1. PJM determines, in advance of each BRA, whether the defined LDAs will be modeled in the given Delivery Year using the rules defined in OATT Attachment DD (Reliability Pricing Model) § 5.10(a)(ii).

<sup>13</sup> See PJM. OATT Attachment DD § 6.5.

<sup>14</sup> Prior to November 1, 2009, existing DR and EE resources were subject to market power mitigation in RPM Auctions. See 129 FERC ¶ 61,081 (2009) at P 30.

<sup>15</sup> Effective January 31, 2011, the RPM rules related to market power mitigation were changed, including revising the definition for Planned Generation Capacity Resource and creating a new definition for Existing Generation Capacity Resource for purposes of the must-offer requirement and market power mitigation, and treating a proposed increase in the capability of a Generation Capacity Resource the same in terms of mitigation as a Planned Generation Capacity Resource. See 134 FERC ¶ 61,065 (2011).

## Market Performance

- The 2016/2017 RPM Third Incremental Auction was conducted in the first three months of 2016. The weighted average capacity price for the 2016/2017 Delivery Year is \$121.85 per MW-day, including all RPM Auctions for the 2016/2017 Delivery Year. The weighted average capacity price for the 2017/2018 Delivery Year is \$142.83, including all RPM Auctions for the 2017/2018 Delivery Year held through the first three months of 2016. The weighted average capacity price for the 2018/2019 Delivery Year is \$179.60, including all RPM Auctions for the 2018/2019 Delivery Year held through the first three months of 2016.
- For the 2015/2016 Delivery Year, RPM annual charges to load are \$9.6 billion. For the 2016/2017 Delivery Year, RPM annual charges to load are \$7.7 billion.
- The Delivery Year weighted average capacity price was \$160.01 per MW-day in 2015/2016.

## Generator Performance

- **Forced Outage Rates.** The average PJM EFORD for the first three months of 2016 was 6.0 percent, a decrease from 9.4 percent for the first three months of 2015.<sup>16</sup>
- **Generator Performance Factors.** The PJM aggregate equivalent availability factor for the first three months of 2016 was 86.4 percent, a slight increase from 86.3 percent for the first three months of 2015.
- **Outages Deemed Outside Management Control (OMC).** In the first three months of 2016, 4.0 percent of forced outages were classified as OMC outages, an increase from 3.2 percent in 2015.

<sup>16</sup> The generator performance analysis includes all PJM capacity resources for which there are data in the PJM generator availability data systems (GADS) database. This set of capacity resources may include generators in addition to those in the set of generators committed as capacity resources in RPM. Data was downloaded from the PJM GADS database on April 26, 2016. EFORD data presented in state of the market reports may be revised based on data submitted after the publication of the reports as generation owners may submit corrections at any time with permission from PJM GADS administrators.

## Recommendations<sup>17</sup>

The MMU recognizes that PJM has implemented the Capacity Performance Construct to replace some of the existing core market rules and to address fundamental performance incentive issues. The MMU recognizes that the Capacity Performance Construct addresses many of the MMU's recommendations. The MMU's recommendations are based on the existing capacity market rules. The status is reported as adopted if the recommendation was included in FERC's order approving PJM's Capacity Performance filing.<sup>18</sup>

- The MMU recommends the enforcement of a consistent definition of capacity resource. The MMU recommends that the requirement to be a physical resource be enforced and enhanced. The requirement to be a physical resource should apply at the time of auctions and should also constitute a commitment to be physical in the relevant Delivery Year. The requirement to be a physical resource should be applied to all resource types, including planned generation, demand resources and imports.<sup>19 20</sup> (Priority: High. First reported 2013. Status: Not adopted. Pending before FERC.)
- The MMU recommends that the test for determining modeled Locational Deliverability Areas in RPM be redefined. A detailed reliability analysis of all at risk units should be included in the redefined model. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that there be an explicit requirement that Capacity Resource offers in the Day-Ahead Energy Market be competitive, where competitive is defined to be the short run marginal cost of the units. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends clear, explicit and detailed rules that define the conditions under which PJM will and will not recall energy from PJM capacity resources and prohibit new energy exports from PJM capacity resources. The MMU recommends that those rules define the conditions under which PJM will purchase emergency energy while at the same

time not recalling energy exports from PJM capacity resources. PJM has modified these rules, but they need additional clarification and operational details. (Priority: Low. First reported 2010. Status: Partially adopted.)

- The MMU recommends that the net revenue calculation used by PJM to calculate the net Cost of New Entry (CONE) VRR parameter reflect the actual flexibility of units in responding to price signals rather than using assumed fixed operating blocks that are not a result of actual unit limitations.<sup>21 22</sup> The result of reflecting the actual flexibility is higher net revenues, which affect the parameters of the RPM demand curve and market outcomes. (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that modifications to existing resources not be treated as new resources for purposes of market power related offer caps or MOPR offer floors. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that, as part of the MOPR unit specific standard of review, all projects be required to use the same basic modeling assumptions. That is the only way to ensure that projects compete on the basis of actual costs rather than on the basis of modeling assumptions.<sup>23</sup> (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends two changes to the RPM solution methodology related to make-whole payments and the iterative reconfiguration of the VRR curve:
  - The MMU recommends changing the RPM solution methodology to explicitly incorporate the cost of make-whole payments in the objective function. (Priority: Medium. First reported 2014. Status: Not adopted.)

<sup>17</sup> The MMU has identified serious market design issues with RPM and the MMU has made specific recommendations to address those issues. These recommendations have been made in public reports. See Table 5-2.

<sup>18</sup> *PJM Interconnection, L.L.C.*, 151 FERC ¶ 61,208 (June 9, 2015).

<sup>19</sup> See also Comments of the Independent Market Monitor for PJM. Docket No. ER14-503-000 (December 20, 2013).

<sup>20</sup> See "Analysis of Replacement Capacity for RPM Commitments: June 1, 2007 to June 1, 2013," <[http://www.monitoringanalytics.com/reports/Reports/2013/IMM\\_Report\\_on\\_Capacity\\_Replacement\\_Activity\\_2\\_20130913.pdf](http://www.monitoringanalytics.com/reports/Reports/2013/IMM_Report_on_Capacity_Replacement_Activity_2_20130913.pdf)> (September 13, 2013).

<sup>21</sup> See *PJM Interconnection, L.L.C.*, Docket No. ER12-513-000 (December 1, 2011) ("Triennial Review").

<sup>22</sup> See the *2012 State of the Market Report for PJM*, Volume II, Section 6, Net Revenue.

<sup>23</sup> See 143 FERC ¶ 61,090 (2013) ("We encourage PJM and its stakeholders to consider, for example, whether the unit-specific review process would be more effective if PJM requires the use of common modeling assumptions for establishing unit-specific offer floors while, at the same time, allowing sellers to provide support for objective, individual cost advantages. Moreover, we encourage PJM and its stakeholders to consider these modifications to the unit-specific review process together with possible enhancements to the calculation of Net CONE."); see also, Comments of the Independent Market Monitor for PJM, Docket No. ER13-535-001 (March 25, 2013); Complaint of the Independent Market Monitor for PJM v. Unnamed Participant, Docket No. EL12-63-000 (May 1, 2012); Motion for Clarification of the Independent Market Monitor for PJM, Docket No. ER11-2875-000, et al. (February 17, 2012); Protest of the Independent Market Monitor for PJM, Docket No. ER11-2875-002 (June 2, 2011); Comments of the Independent Market Monitor for PJM, Docket Nos. EL11-20 and ER11-2875 (March 4, 2011).

- The MMU also recommends changing the RPM solution methodology to define variables for the nesting relationships in the BRA optimization model directly rather than employing the current iterative approach, in order to improve the efficiency and stability. (Priority: Medium. First reported 2014. Status: Not adopted.)
- The MMU recommends that the use of the 2.5 percent demand adjustment (Short Term Resource Procurement Target) be terminated immediately. The 2.5 percent should be added back to the overall market demand curve. (Priority: Medium. First reported 2013. Status: Adopted.)
- The MMU recommends that the definition of demand side resources be modified in order to ensure that such resources be fully substitutable for other generation capacity resources. Both the Limited and the Extended Summer DR products should be eliminated in order to ensure that the DR product has the same unlimited obligation to provide capacity year round as generation capacity resources. (Priority: High. First reported 2012. Status: Adopted.)
- The MMU recommends four changes with respect to capacity imports into PJM:
  - The MMU recommends that all capacity have firm transmission to the PJM border acquired prior to the offering in an RPM auction. (Priority: High. First reported 2014. Status: Adopted.)
  - The MMU recommends that all capacity imports be required to be deliverable to PJM load prior to the relevant Delivery Year to ensure that they are as close to full substitutes for internal, physical capacity resources as possible. Pseudo ties alone are not adequate to ensure deliverability. (Priority: High. New recommendation. Status: Not Adopted.)
  - The MMU recommends that all capacity imports be required to be pseudo tied prior to the relevant Delivery Year in order to ensure that imports are as close to full substitutes for internal, physical capacity resources as possible. (Priority: High. First reported 2014. Status: Adopted.)
- The MMU recommends that all resources importing capacity into PJM accept a must offer requirement. (Priority: High. First reported 2014. Status: Adopted.)
- The MMU recommends improvements to the performance incentive requirements of RPM:
  - The MMU recommends that Generation Capacity Resources be paid on the basis of whether they produce energy when called upon during any of the hours defined as critical. One hundred percent of capacity market revenue should be at risk rather than only fifty percent. (Priority: High. First reported 2012. Status: Adopted.)
  - The MMU recommends that a unit which is not capable of supplying energy consistent with its day-ahead offer should reflect an appropriate outage. (Priority: Medium. First reported 2013. Status: Not adopted. Pending before FERC.)
  - The MMU recommends that PJM eliminate all OMC outages from the calculation of forced outage rates used for any purpose in the PJM Capacity Market. (Priority: Medium. First reported 2013. Status: Adopted 2015.)
  - The MMU recommends that PJM eliminate the broad exception related to lack of gas during the winter period for single-fuel, natural gas-fired units.<sup>24</sup> (Priority: Medium. First reported 2013. Status: Adopted 2015.)
- The MMU recommends that treatment of costs in RMR filings be emphasized. Customers should bear all the incremental costs, including incremental investment costs, required by the RMR service that the unit owner would not have incurred if the unit owner had deactivated its unit as it proposed. Generation owners should bear all other costs. (Priority: Low. First reported 2010. Status: Not adopted.)

<sup>24</sup> See OATT Attachment DD § 10(e). For more on this issue and related incentive issues, see the MMU's White Paper included in: Monitoring Analytics, LLC and PJM Interconnection, LLC, "Capacity in the PJM Market," <[http://www.monitoringanalytics.com/reports/Reports/2012/IMM\\_And\\_PJM\\_Capacity\\_White\\_Papers\\_On\\_OPSI\\_Issues\\_20120820.pdf](http://www.monitoringanalytics.com/reports/Reports/2012/IMM_And_PJM_Capacity_White_Papers_On_OPSI_Issues_20120820.pdf)> (August 20, 2012).

Table 5-2 RPM related MMU reports, 2015 through 2016

Date	Name
January 14, 2015	IMM Comments re Capacity Performance Docket Nos. EL15-738-000 and EL15-739-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_No_EL15-738-000_EL15-739-000_20150114.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_No_EL15-738-000_EL15-739-000_20150114.pdf</a>
January 20, 2015	IMM Comments re Capacity Performance Docket No. ER15-623-000 and EL15-29-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_No_ER15-623-000_EL15-29-000_20150120.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_No_ER15-623-000_EL15-29-000_20150120.pdf</a>
January 29, 2015	IMM Protest re IMEA Waiver Docket No. ER15-834-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Protest_Docket_No_ER15-834-000_20150129.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Protest_Docket_No_ER15-834-000_20150129.pdf</a>
January 30, 2015	IMM Answer and Motion for Leave to Answer re Calpine Waiver Docket No. ER15-376-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Answer_and_Motion_for_Leave_to_Answer_Docket_No_ER15-376-000_20150130.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Answer_and_Motion_for_Leave_to_Answer_Docket_No_ER15-376-000_20150130.pdf</a>
February 13, 2015	Comments of the Independent Market Monitor for PJM re DR in RPM Docket No. ER15-852-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_No_ER15-852-000_20150213.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_No_ER15-852-000_20150213.pdf</a>
February 22, 2015	Generation Capacity Resources in PJM Region Subject to RPM Must Offer Obligation for 2015/2016, 2016/2017 and 2017/2018 Delivery Years <a href="http://www.monitoringanalytics.com/reports/Market_Messages/Messages/RPM_Must_Offer_Obligation_20150222.pdf">http://www.monitoringanalytics.com/reports/Market_Messages/Messages/RPM_Must_Offer_Obligation_20150222.pdf</a>
February 25, 2015	IMM Answer and Motion for Leave to Answer re Capacity Performance Docket Nos. ER15-623-000 and EL15-29-000, Not Consolidated <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Answer_and_Motion_for_Leave_to_Answer_Docket_Nos_ER15-623-000_EL15-29-000_20150225.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Answer_and_Motion_for_Leave_to_Answer_Docket_Nos_ER15-623-000_EL15-29-000_20150225.pdf</a>
February 27, 2015	IMM Answer and Motion for Leave to Answer Errata re Capacity Performance Docket Nos. ER15-623-000 and EL15-29-000, Not Consolidated <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Answer_and_Motion_for_Leave_to_Answer_Errata_Docket_Nos_ER15-623-000_EL15-29-000_20150227.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Answer_and_Motion_for_Leave_to_Answer_Errata_Docket_Nos_ER15-623-000_EL15-29-000_20150227.pdf</a>
March 6, 2015	IMM Comments re Champion Energy Complaint Docket No. EL15-46-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_No_EL15-46-000_20150306.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_No_EL15-46-000_20150306.pdf</a>
March 20, 2015	IMM Answer and Motion for Leave to Answer re Capacity Performance Docket Nos. ER15-623-000 and EL15-29-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Answer_and_Motion_for_Leave_to_Answer_ER15-623-000_EL15-29-000_20150320.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Answer_and_Motion_for_Leave_to_Answer_ER15-623-000_EL15-29-000_20150320.pdf</a>
March 25, 2015	IMM Protest re IMEA Waiver Docket No. ER15-1232-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Protest_Docket_No_ER15-1232-000_20150325.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Protest_Docket_No_ER15-1232-000_20150325.pdf</a>
March 26, 2015	IMM Answer re Capacity Performance Docket Nos. ER15-623-000 and EL15-29-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Answer_and_Motion_for_Leave_to_Answer_Docket_Nos_ER15-623-000_EL15-29-000_20150326.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Answer_and_Motion_for_Leave_to_Answer_Docket_Nos_ER15-623-000_EL15-29-000_20150326.pdf</a>
April 15, 2015	IMM Comments re Capacity Performance Docket Nos. ER15-623-001 and ER15-1470-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_Nos_ER15-623-001_ER15-1470-000_20150415.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_Nos_ER15-623-001_ER15-1470-000_20150415.pdf</a>
June 30, 2015	Generation Capacity Resources in PJM Region Subject to RPM Must Offer Obligation for 2016/2017, 2017/2018 and 2018/2019 Delivery Years <a href="http://www.monitoringanalytics.com/reports/Market_Messages/Messages/RPM_Must_Offer_Obligation_20150630.pdf">http://www.monitoringanalytics.com/reports/Market_Messages/Messages/RPM_Must_Offer_Obligation_20150630.pdf</a>
July 6, 2015	IMM Limited Request for Rehearing re Capacity Performance Docket Nos. ER15-623-000, -001 and EL15-29-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Limited_Request_for_Rehearing_Docket_Nos_ER15-623-000_001_and_EL15-29-000_20150706.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Limited_Request_for_Rehearing_Docket_Nos_ER15-623-000_001_and_EL15-29-000_20150706.pdf</a>
July 8, 2015	Intermittent Resources Capacity Performance Value Methodology <a href="http://www.monitoringanalytics.com/reports/Market_Messages/Messages/Intermittent_Resources_Capacity_Performance_Value_Methodology_20150708.pdf">http://www.monitoringanalytics.com/reports/Market_Messages/Messages/Intermittent_Resources_Capacity_Performance_Value_Methodology_20150708.pdf</a>
July 20, 2015	IMM Comments re Capacity Performance Docket Nos. ER15-623-004 and EL15-29-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_Nos_ER15-623-004_EL15-29-000_20150720.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_Nos_ER15-623-004_EL15-29-000_20150720.pdf</a>
July 31, 2015	IMM Answer and Motion for Leave to Answer Request for Rehearing re Capacity Performance Docket Nos. ER15-623-000, -001 and EL15-29-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Answer_and_Motion_for_Leave_to_Answer_Request_for_Rehearing_Docket_No_ER15-623-000_001_EL15-29-000_20150731.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Answer_and_Motion_for_Leave_to_Answer_Request_for_Rehearing_Docket_No_ER15-623-000_001_EL15-29-000_20150731.pdf</a>
September 11, 2015	Generation Capacity Resources in PJM Region Subject to RPM Must Offer Obligation for 2016/2017, 2017/2018 and 2018/2019 Delivery Years <a href="http://www.monitoringanalytics.com/reports/Market_Messages/Messages/RPM_Must_Offer_Obligation_20150911.pdf">http://www.monitoringanalytics.com/reports/Market_Messages/Messages/RPM_Must_Offer_Obligation_20150911.pdf</a>
November 4, 2015	IMM Comments re MISO Resources Docket Nos. EL15-70-000, EL15-71-000, EL15-72-000 and EL15-82-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_Nos_ER15-70-000_EL15-71-000_EL15-72-000_EL15-82-000_20151104.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_Nos_ER15-70-000_EL15-71-000_EL15-72-000_EL15-82-000_20151104.pdf</a>
November 18, 2015	External Capacity: Pseudo Ties <a href="http://www.monitoringanalytics.com/reports/Presentations/2015/IMM_PJM_MISO_JCM_External_Capacity_Pseudo_Ties_20151118.pdf">http://www.monitoringanalytics.com/reports/Presentations/2015/IMM_PJM_MISO_JCM_External_Capacity_Pseudo_Ties_20151118.pdf</a>
November 30, 2015	IMM Comments re AEP Waiver Request Docket No. ER16-298-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_No_ER16-298-000_20151130.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Comments_Docket_No_ER16-298-000_20151130.pdf</a>
December 2, 2015	IMM Answer re AEMA Protest Docket No. ER15-623-000,-008 <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Answer_Docket_No_ER15-623-000_008_201512-2.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_Answer_Docket_No_ER15-623-000_008_201512-2.pdf</a>
December 23, 2015	Generation Capacity Resources in PJM Region Subject to RPM Must Offer Obligation for 2016/2017, 2017/2018 and 2018/2019 Delivery Years <a href="http://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/RPM_Must_Offer_Obligation_20151223.pdf">http://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/RPM_Must_Offer_Obligation_20151223.pdf</a>
December 28, 2015	IMM First Supplemental Testimony of Joseph E. Bowring on Behalf of the Independent Market Monitor for PJM re AEP Ohio Case Nos. 14-1693 EL-RDR and 14-1694 EL-AAM <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_First_Supplemental_Testimony_AEP_Case_Nos_14-1693_14-1694_20151228.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_First_Supplemental_Testimony_AEP_Case_Nos_14-1693_14-1694_20151228.pdf</a>
December 30, 2015	IMM First Supplemental Testimony of Joseph E. Bowring on Behalf of the Independent Market Monitor for PJM re FE Case No. 14-1297 EL-SSO <a href="http://www.monitoringanalytics.com/reports/Reports/2015/IMM_First_Supplemental_Testimony_of_Joseph_E_Bowring_14-1297_20151230.pdf">http://www.monitoringanalytics.com/reports/Reports/2015/IMM_First_Supplemental_Testimony_of_Joseph_E_Bowring_14-1297_20151230.pdf</a>
January 13, 2016	IMM Response re Capacity Performance Docket No. ER15-623-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Response_ER15-623-000_20160113.pdf">http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Response_ER15-623-000_20160113.pdf</a>
February 1, 2016	IMM Post-Hearing Brief re AEP Ohio Case Nos. 14-1693 EL-RDR and 14-1694 EL-AAM <a href="http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Post_Hearing_Brief_Case_No_14-1693_and_14-1694_20160201.pdf">http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Post_Hearing_Brief_Case_No_14-1693_and_14-1694_20160201.pdf</a>
February 8, 2016	IMM Post-Hearing Reply Brief re AEP Ohio Case Nos. 14-1693-EL-RDR and 14-1694-EL-AAM <a href="http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Post_Hearing_Reply_Brief_Case_No_14-1693-14-1694_20160208.pdf">http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Post_Hearing_Reply_Brief_Case_No_14-1693-14-1694_20160208.pdf</a>
February 11, 2016	PJM IMM Joint Statement re Capacity Performance Docket Nos. ER15-623-000, -004 and EL15-29-000, and -003 <a href="http://www.monitoringanalytics.com/reports/Reports/2016/PJM_IMM_Joint_Statement_Docket_Nos_ER15-623-000_004_EL15-29-000_003_20160211.pdf">http://www.monitoringanalytics.com/reports/Reports/2016/PJM_IMM_Joint_Statement_Docket_Nos_ER15-623-000_004_EL15-29-000_003_20160211.pdf</a>
February 16, 2016	IMM Post-Hearing Brief re FE Ohio Case No. 14-1297-EL-SSO <a href="http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Post_Hearing_Brief_Case_No_14-1297_20160216.pdf">http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Post_Hearing_Brief_Case_No_14-1297_20160216.pdf</a>
February 24, 2016	IMM Comments re DR CBL Testing <a href="http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Comments_Docket_No_ER16-873_20160223.pdf">http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Comments_Docket_No_ER16-873_20160223.pdf</a>
February 25, 2016	Generation Capacity Resources in PJM Region Subject to RPM Must Offer Obligation for 2016/2017, 2017/2018 and 2018/2019 Delivery Years <a href="http://www.monitoringanalytics.com/reports/Market_Messages/Messages/RPM_Must_Offer_Obligation_20160225.pdf">http://www.monitoringanalytics.com/reports/Market_Messages/Messages/RPM_Must_Offer_Obligation_20160225.pdf</a>
February 26, 2016	IMM Post-Hearing Reply Brief re FE Ohio Case No. 14-1297-EL-SSO <a href="http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Post_Hearing_Reply_Brief_Case_No_14-1297-EL-SSO_20160226.pdf">http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Post_Hearing_Reply_Brief_Case_No_14-1297-EL-SSO_20160226.pdf</a>
March 22, 2016	IMM Answer re DR CBL Docket No. ER16-873-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Answer_Docket_No_ER16-873-000_20160322.pdf">http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Answer_Docket_No_ER16-873-000_20160322.pdf</a>
March 28, 2016	IMM Motion for Clarification or Rehearing re Net Revenue Docket No. EL14-94-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Request_for_Rehearing_EL14-94-000_20160328.pdf">http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Request_for_Rehearing_EL14-94-000_20160328.pdf</a>
April 11, 2016	IMM Comments re Calpine MOPR Complaint Docket No. EL16-49-000 <a href="http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Comments_Docket_No_EL16-49-000_20160411.pdf">http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Comments_Docket_No_EL16-49-000_20160411.pdf</a>

## Conclusion

The analysis of PJM Capacity Markets begins with market structure, which provides the framework for the actual behavior or conduct of market participants. The analysis examines participant behavior within that market structure. In a competitive market structure, market participants are constrained to behave competitively. The analysis examines market performance, measured by price and the relationship between price and marginal cost, that results from the interaction of market structure and participant behavior.

The MMU found serious market structure issues, measured by the three pivotal supplier test results, but no exercise of market power in the PJM Capacity Market in the first three months of 2016. Explicit market power mitigation rules in the RPM construct offset the underlying market structure issues in the PJM Capacity Market under RPM. The PJM Capacity Market results were competitive in the first three months of 2016.

The MMU has identified serious market design issues with RPM and the MMU has made specific recommendations to address those issues.<sup>25 26 27 28</sup> In 2015 and 2016, the MMU prepared a number of RPM-related reports and testimony, shown in Table 5-2. The Capacity Performance modifications to the RPM construct have significantly improved the capacity market and addressed many of the issues identified by the MMU. The MMU will publish more detailed reports on the first Capacity Performance BRA for 2018/2019 and on the CP Transition Incremental Auctions which include more specific issues and suggestions for improvements.

25 See "Analysis of the 2013/2014 RPM Base Residual Auction Revised and Updated," <[http://www.monitoringanalytics.com/reports/Reports/2010/Analysis\\_of\\_2013\\_2014\\_RPM\\_Base\\_Residual\\_Auction\\_20090920.pdf](http://www.monitoringanalytics.com/reports/Reports/2010/Analysis_of_2013_2014_RPM_Base_Residual_Auction_20090920.pdf)> (September 20, 2010).

26 See "Analysis of the 2014/2015 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2012/Analysis\\_of\\_2014\\_2015\\_RPM\\_Base\\_Residual\\_Auction\\_20120409.pdf](http://www.monitoringanalytics.com/reports/Reports/2012/Analysis_of_2014_2015_RPM_Base_Residual_Auction_20120409.pdf)> (April 9, 2012).

27 See "Analysis of the 2015/2016 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2013/Analysis\\_of\\_2015\\_2016\\_RPM\\_Base\\_Residual\\_Auction\\_20130924.pdf](http://www.monitoringanalytics.com/reports/Reports/2013/Analysis_of_2015_2016_RPM_Base_Residual_Auction_20130924.pdf)> (September 24, 2013).

28 See "Analysis of the 2016/2017 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2014/IMM\\_Analysis\\_of\\_the\\_20162017\\_RPM\\_Base\\_Residual\\_Auction\\_20140418.pdf](http://www.monitoringanalytics.com/reports/Reports/2014/IMM_Analysis_of_the_20162017_RPM_Base_Residual_Auction_20140418.pdf)> (April 18, 2014).

29 See "Analysis of the 2017/2018 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2014/IMM\\_Analysis\\_of\\_the\\_2017\\_2018\\_RPM\\_Base\\_Residual\\_Auction\\_20141006.pdf](http://www.monitoringanalytics.com/reports/Reports/2014/IMM_Analysis_of_the_2017_2018_RPM_Base_Residual_Auction_20141006.pdf)> (October 6, 2014).

## Installed Capacity

On January 1, 2016, PJM installed capacity was 177,682.8 MW (Table 5-3).<sup>30</sup> Over the next three months, new generation, unit deactivations, facility reratings, plus import and export shifts resulted in PJM installed capacity of 178,492.0 MW on March 31, 2016, an increase of 809.2 MW or 0.5 percent from the January 1 level.<sup>31 32</sup> The 809.2 MW increase was the result of capacity modifications (105.0 MW) and new or reactivated generation (994.8 MW), offset by deactivations (51.0 MW), derates (54.6 MW), and a decrease in imports (185.0 MW).

At the beginning of the new Delivery Year on June 1, 2015, PJM installed capacity was 176,737.4 MW, a decrease of 6,239.4 MW or 3.4 percent from the May 31 level.

Figure 5-1 shows the share of installed capacity by fuel source for the first day of each Delivery Year, from June 1, 2007, to June 1, 2015, as well as the expected installed capacity for the next three Delivery Years, based on the results of all auctions held through March 31, 2016.<sup>33</sup> On June 1, 2007, coal comprised 40.7 percent of the installed capacity, reached a maximum of 42.9 percent in 2012, decreased to 37.8 percent on June 1, 2015 and will decrease to 31.4 percent by June 1, 2018. The share of gas increased from 29.1 percent in 2007 to 33.6 percent in 2015, and will increase to 42.2 percent in 2018.

30 Percent values shown in Table 5-3 are based on unrounded, underlying data and may differ from calculations based on the rounded values in the tables.

31 Unless otherwise specified, the capacity described in this section is the summer installed capacity rating of all PJM generation capacity resources, as entered into the eRPM system, regardless of whether the capacity cleared in the RPM Auctions.


32 Wind resources accounted for 918.4 MW of installed capacity in PJM on March 31, 2016. This value represents approximately 13 percent of wind nameplate capability in PJM. PJM administratively reduces the capabilities of all wind generators to 13 percent of nameplate capacity when determining the system installed capacity because wind resources cannot be assumed to be available on peak and cannot respond to dispatch requests. As data become available, unforced capability of wind resources will be calculated using actual data. There are additional wind resources not reflected in total capacity because they are energy only resources and do not participate in the PJM Capacity Market.

33 Due to EFORd values not being finalized for future Delivery Years, the projected installed capacity is based on cleared unforced capacity (UCAP) MW using the EFORd submitted with the offer.

Table 5-3 PJM installed capacity (By fuel source): January 1, January 31, February 29, and March 31, 2016

	1-Jan-16		31-Jan-16		29-Feb-16		31-Mar-16	
	MW	Percent	MW	Percent	MW	Percent	MW	Percent
Coal	66,674.8	37.5%	66,674.8	37.3%	66,672.7	37.4%	66,672.7	37.4%
Gas	60,487.4	34.0%	61,180.9	34.3%	61,144.8	34.3%	61,187.9	34.3%
Hydroelectric	8,787.5	4.9%	8,846.4	5.0%	8,846.4	5.0%	8,854.8	5.0%
Nuclear	33,071.5	18.6%	33,175.5	18.6%	33,175.5	18.6%	33,175.5	18.6%
Oil	6,851.8	3.9%	6,851.8	3.8%	6,787.2	3.8%	6,787.2	3.8%
Solar	128.0	0.1%	128.0	0.1%	128.0	0.1%	128.0	0.1%
Solid waste	769.4	0.4%	769.4	0.4%	767.5	0.4%	767.5	0.4%
Wind	912.4	0.5%	918.4	0.5%	918.4	0.5%	918.4	0.5%
Total	177,682.8	100.0%	178,545.2	100.0%	178,440.5	100.0%	178,492.0	100.0%

Figure 5-1 Percentage of PJM installed capacity (By fuel source): June 1, 2007 through June 1, 2018

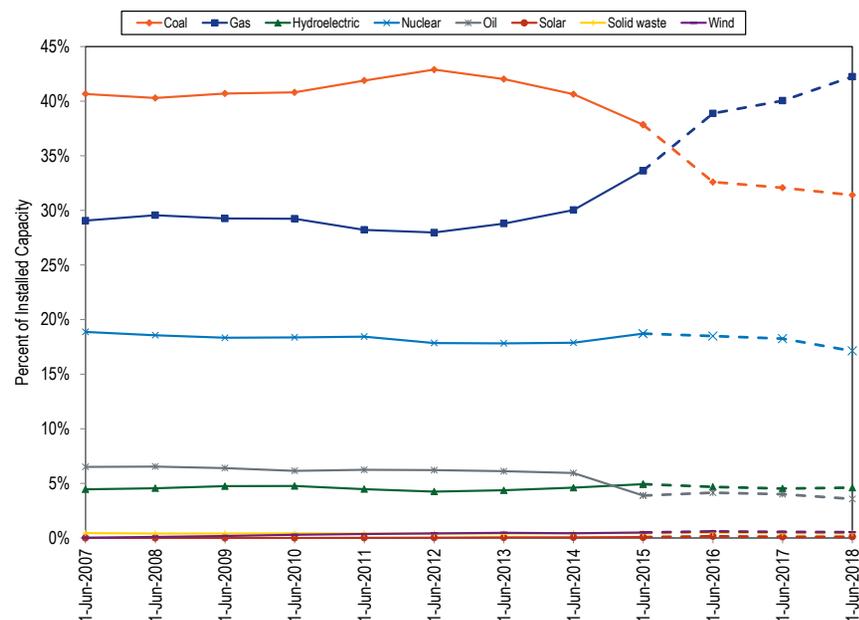

## RPM Capacity Market

The RPM Capacity Market, implemented June 1, 2007, is a forward-looking, annual, locational market, with a must-offer requirement for Existing Generation Capacity Resources and mandatory participation by load, with performance incentives, that includes clear market power mitigation rules and that permits the direct participation of demand-side resources.

Annual base auctions are held in May for Delivery Years that are three years in the future. Effective January 31, 2010, First, Second, and Third Incremental Auctions are conducted 20, 10, and three months prior to the Delivery Year.<sup>34</sup> In the first three months of 2016, the 2016/2017 RPM Third Incremental Auction was conducted.

<sup>34</sup> See *PJM Interconnection, LLC*, Letter Order in Docket No. ER10-366-000 (January 22, 2010).

Table 5-4 Generation capacity changes: 2007/2008 through 2015/2016

	ICAP (MW)									
	Total at June 1	New	Reactivations	Uprates	Integration	Net Change in Capacity Imports	Net Change in Capacity Exports	Deactivations	Derates	Net Change
2007/2008	163,659.4	372.8	156.8	1,238.1	0.0	(96.7)	143.9	389.5	617.8	519.8
2008/2009	164,179.2	812.9	6.3	1,108.9	0.0	871.1	(1,702.9)	615.0	612.4	3,274.7
2009/2010	167,453.9	188.1	13.0	370.4	0.0	68.6	735.9	472.4	171.2	(739.4)
2010/2011	166,714.5	1,751.2	16.0	587.3	11,821.6	187.2	(427.0)	1,439.2	286.9	13,064.2
2011/2012	179,778.7	3,095.0	138.0	553.8	3,607.4	262.7	(1,374.5)	2,758.5	313.0	5,959.9
2012/2013	185,738.6	266.4	79.0	364.5	2,680.0	841.8	(17.3)	4,152.1	267.6	(170.7)
2013/2014	185,567.9	264.7	20.9	397.9	0.0	2,229.2	21.6	4,027.7	420.0	(1,556.6)
2014/2015	184,011.3	3,036.0	0.0	480.4	0.0	946.9	73.3	11,442.9	221.0	(7,273.9)
2015/2016	176,737.4									
Total		9,787.1	430.0	5,101.3	18,109.0	5,310.8	(2,547.0)	25,297.3	2,909.9	13,078.0

## Market Structure

### Supply

Table 5-4 shows generation capacity changes since the implementation of the Reliability Pricing Model through the 2014/2015 Delivery Year. The 13,078.0 MW increase was the result of new Generation Capacity Resources (9,787.1 MW), reactivated Generation Capacity Resources (430.0 MW), uprates (5,101.3 MW), integration of external zones (18,109.0 MW), a net increase in capacity imports (5,310.8 MW), a net decrease in capacity exports (2,547.0 MW), offset by deactivations (25,297.3 MW) and derates (2,909.9 MW). In the 2016/2017 RPM Third Incremental Auction, 1,465.3 MW cleared of the 5,164.0 MW of participant sell offers. Effective with the 2012/2013 Delivery Year, PJM sell offers are submitted in RPM Incremental Auctions as a result of changes in the RTO and LDA reliability requirements. In the 2016/2017 RPM Third Incremental Auction, 4,818.0 MW cleared of the 5,223.4 MW of PJM sell offers for the RTO.

### Demand

In the 2016/2017 RPM Third Incremental Auction, 6,021.3 MW cleared of the 12,240.5 MW of participant buy bids, and 262.0 MW cleared of the 262.0 MW of PJM buy bids for the RTO. Participant buy bids are submitted to cover commitment and compliance shortfalls or because participants wanted to

purchase additional capacity. PJM buy bids are submitted due to reliability requirement adjustments and, for RPM Auction for Delivery Years prior to 2018/2019, deferred short term resource procurement.

The MMU analyzed market sectors in the PJM Capacity Market to determine how they met their load obligations. The Capacity Market was divided into the following sectors:

- **PJM EDC.** EDCs with a franchise service territory within the PJM footprint. This sector includes traditional utilities, electric cooperatives, municipalities and power agencies.
- **PJM EDC Generating Affiliate.** Affiliate companies of PJM EDCs that own generating resources.
- **PJM EDC Marketing Affiliate.** Affiliate companies of PJM EDCs that sell power and have load obligations in PJM, but do not own generating resources.
- **Non-PJM EDC.** EDCs with franchise service territories outside the PJM footprint.
- **Non-PJM EDC Generating Affiliate.** Affiliate companies of non-PJM EDCs that own generating resources.

- **Non-PJM EDC Marketing Affiliate.** Affiliate companies of non-PJM EDCs that sell power and have load obligations in PJM, but do not own generating resources.
- **Non-EDC Generating Affiliate.** Affiliate companies of non-EDCs that own generating resources.
- **Non-EDC Marketing Affiliate.** Affiliate companies of non-EDCs that sell power and have load obligations in PJM, but do not own generating resources.

On June 1, 2015, PJM EDCs and their affiliates maintained a large market share of load obligations under RPM, together totaling 65.1 percent (Table 5-5), down from 71.1 percent on June 1, 2014. The combined market share of LSEs not affiliated with any EDC and of non-PJM EDC affiliates was 34.9 percent, up from 28.9 percent on June 1, 2014. The share of capacity market load obligation fulfilled by PJM EDCs and their affiliates, and LSEs not affiliated with any EDC and non PJM EDC affiliates from June 1, 2007 to June 1, 2015 is shown in Figure 5-2. PJM EDCs' and their affiliates' share of load obligation has decreased from 77.5 percent on June 1, 2007, to 65.1 percent on June 1, 2015. The share of load obligation held by LSEs not affiliated with any EDC and non PJM EDC affiliates increased from 22.5 percent on June 1, 2007, to 34.9 percent on June 1, 2015. Prior to the 2012/2013 Delivery Year, obligation was defined as cleared and make-whole MW in the Base Residual Auction and the Second Incremental Auction plus ILR forecast obligations. Effective with the 2012/2013 Delivery Year, obligation is defined as the sum of the unforced capacity obligations satisfied through all RPM Auctions for the Delivery Year.

Figure 5-2 Capacity market load obligation served: June 1, 2007 through June 1, 2015

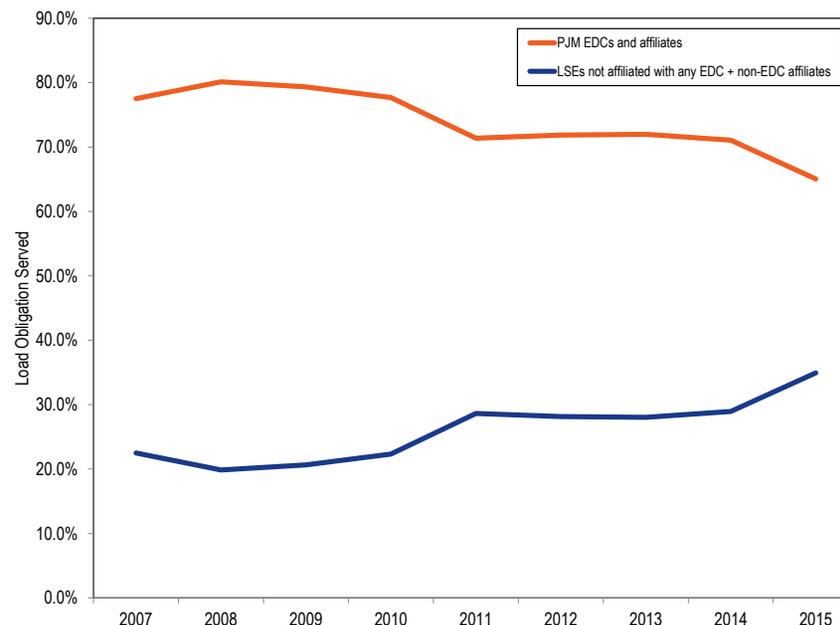


Table 5-5 Capacity market load obligations served: June 1, 2015

	Obligation (MW)								Total
	PJM EDCs	PJM EDC Generating Affiliates	PJM EDC Marketing Affiliates	Non-PJM EDC Generating Affiliates	Non-PJM EDC Marketing Affiliates	Non-EDC Generating Affiliates	Non-EDC Marketing Affiliates		
Obligation	45,896.8	25,878.6	14,327.3	4,630.2	16,352.3	1,265.5	23,994.8		132,345.5
Percent of total obligation	34.7%	19.6%	10.8%	3.5%	12.4%	1.0%	18.1%		100.0%

## Market Concentration

### Auction Market Structure

As shown in Table 5-6, all participants in the total PJM market as well as the LDA RPM markets failed the three pivotal supplier (TPS) test in the 2016/2017 RPM Third Incremental Auction.<sup>35</sup> Offer caps were applied to all sell offers for resources which were subject to mitigation when the capacity market seller did not pass the test, the submitted sell offer exceeded the defined offer cap, and the submitted sell offer, absent mitigation, increased the market clearing price.<sup>36 37 38</sup>

In applying the market structure test, the relevant supply for the RTO market includes all supply offered at less than or equal to 150 percent of the RTO cost-based clearing price. The relevant supply for the constrained LDA markets includes the incremental supply inside the constrained LDAs which was offered at a price higher than the unconstrained clearing price for the parent LDA market and less than or equal to 150 percent of the cost-based clearing price for the constrained LDA. The relevant demand consists of the MW needed inside the LDA to relieve the constraint.

Table 5-6 presents the results of the TPS test. A generation owner or owners are pivotal if the capacity of the owners' generation facilities is needed to meet the demand for capacity. The results of the TPS are measured by the residual supply index (RSIx). The RSIx is a general measure that can be used with any number of pivotal suppliers. The subscript denotes the number of pivotal suppliers included in the test. If the RSIx is less than or equal to 1.0, the supply owned by the specific generation owner, or owners, is needed to meet market demand and the generation owners are pivotal suppliers with a significant ability to influence market prices. If the RSIx is greater than 1.0, the supply of the specific generation owner or owners is not needed to meet market demand and those generation owners have a reduced ability to unilaterally influence market price.

<sup>35</sup> The market definition used for the TPS test includes all offers with costs less than or equal to 1.50 times the clearing price. See *MMU Technical Reference for PJM Markets*, at "Three Pivotal Supplier Test" for additional discussion.

<sup>36</sup> See PJM. OATT Attachment DD § 6.5.

<sup>37</sup> Prior to November 1, 2009, existing DR and EE resources were subject to market power mitigation in RPM Auctions. See 129 FERC ¶ 61,081 (2009) at P 30.

<sup>38</sup> Effective January 31, 2011, the RPM rules related to market power mitigation were changed, including revising the definition for Planned Generation Capacity Resource and creating a new definition for Existing Generation Capacity Resource for purposes of the must-offer requirement and market power mitigation, and treating a proposed increase in the capability of a Generation Capacity Resource the same in terms of mitigation as a Planned Generation Capacity Resource. See 134 FERC ¶ 61,065 (2011).

Table 5-6 RSI results: 2015/2016 through 2018/2019 RPM Auctions<sup>39</sup>

RPM Markets	RSI <sub>1, 1.05</sub>	RSI <sub>3</sub>	Total Participants	Failed RSI <sub>3</sub> Participants
<b>2015/2016 Base Residual Auction</b>				
RTO	0.75	0.57	99	99
MAAC	0.49	0.63	12	12
ATSI	0.01	0.00	3	3
<b>2015/2016 First Incremental Auction</b>				
RTO	0.70	0.61	43	43
MAAC	0.15	0.09	5	5
PSEG	0.00	0.00	1	1
ATSI	0.00	0.00	1	1
<b>2015/2016 Second Incremental Auction</b>				
RTO	0.40	0.21	26	26
MAAC	0.00	0.04	4	4
PSEG	0.00	0.00	0	0
ATSI	0.00	0.00	1	1
<b>2015/2016 Third Incremental Auction</b>				
RTO	0.38	0.28	55	55
MAAC	0.24	0.10	4	4
PSEG	0.00	0.00	0	0
<b>2016/2017 Base Residual Auction</b>				
RTO	0.78	0.59	110	110
MAAC	0.56	0.38	6	6
PSEG	0.00	0.00	1	1
ATSI	0.00	0.00	1	1
<b>2016/2017 First Incremental Auction</b>				
RTO	0.58	0.16	29	29
MAAC	0.26	0.00	3	3
PSEG	0.00	0.00	1	1
ATSI	0.00	0.00	1	1
<b>2016/2017 Second Incremental Auction</b>				
RTO	0.63	0.37	32	32
PSEG North	0.00	0.00	1	1
ATSI	0.00	0.00	1	1
<b>2016/2017 Third Incremental Auction</b>				
RTO	0.54	0.35	64	64
MAAC	0.00	0.00	0	0
PSEG	0.00	0.00	1	1
PSEG North	0.00	0.00	2	2
<b>2017/2018 Base Residual Auction</b>				
RTO	0.80	0.61	119	119
PSEG	0.00	0.00	1	1
<b>2017/2018 First Incremental Auction</b>				
RTO	0.47	0.40	38	38
PSEG	0.00	0.00	1	1
<b>2018/2019 Base Residual Auction</b>				
RTO	0.81	0.65	125	125
EMAAC	0.59	0.16	12	12
ComEd	1.11	0.02	4	4


<sup>39</sup> The RSI shown is the lowest RSI in the market.

### Locational Deliverability Areas (LDAs)

Under the PJM Tariff, PJM determines, in advance of each BRA, whether defined Locational Deliverability Areas (LDAs) will be modeled in the auction. Effective with the 2012/2013 Delivery Year, an LDA is modeled as a potentially constrained LDA for a Delivery Year if the Capacity Emergency Transfer Limit (CETL) is less than 1.15 times the Capacity Emergency Transfer Objective (CETO), such LDA had a locational price adder in one or more of the three immediately preceding BRAs, or such LDA is determined by PJM in a preliminary analysis to be likely to have a locational price adder based on historic offer price levels. The rules also provide that starting with the 2012/2013 Delivery Year, EMAAC, SWMAAC, and MAAC LDAs are modeled as potentially constrained LDAs regardless of the results of the above three tests.<sup>40</sup> In addition, PJM may establish a constrained LDA even if it does not qualify under the above tests if PJM finds that “such is required to achieve an acceptable level of reliability.”<sup>41</sup> A reliability requirement and a Variable Resource Requirement (VRR) curve are established for each modeled LDA. Effective for the 2014/2015 through 2016/2017 Delivery Years, a Minimum Annual and a Minimum Extended Summer Resource Requirement are established for each modeled LDA. Effective for the 2017/2018 Delivery Year, Sub-Annual and Limited Resource Constraints, replacing the Minimum Annual and a Minimum Extended Summer Resource Requirements, are established for each modeled LDA.<sup>42</sup> Effective for the 2018/2019 through the 2019/2020 Delivery Years, Base Capacity Demand Resource Constraint and a Base Capacity Resource Constraint, replacing the Sub-Annual and Limited Resource Constraints, are established for each modeled LDA.

Locational Deliverability Areas are shown in Figure 5-3, Figure 5-4 and Figure 5-5.

Figure 5-3 Map of PJM Locational Deliverability Areas

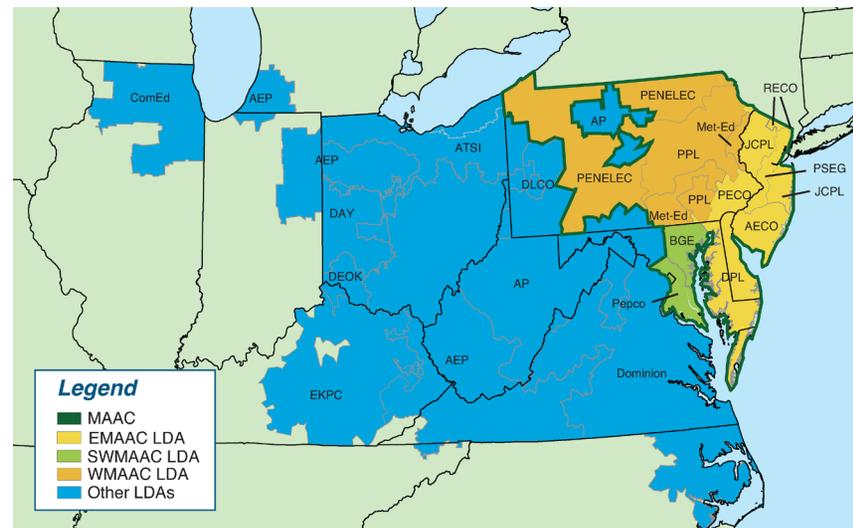

40 Prior to the 2012/2013 Delivery Year, an LDA with a CETL less than 1.05 times CETO was modeled as a constrained LDA in RPM. No additional criteria were used in determining modeled LDAs.

41 PJM. OATT Attachment DD § 5.10 (a) (ii).

42 146 FERC ¶ 61,052 (2014).

Figure 5-4 Map of PJM RPM EMAAC subzonal LDAs


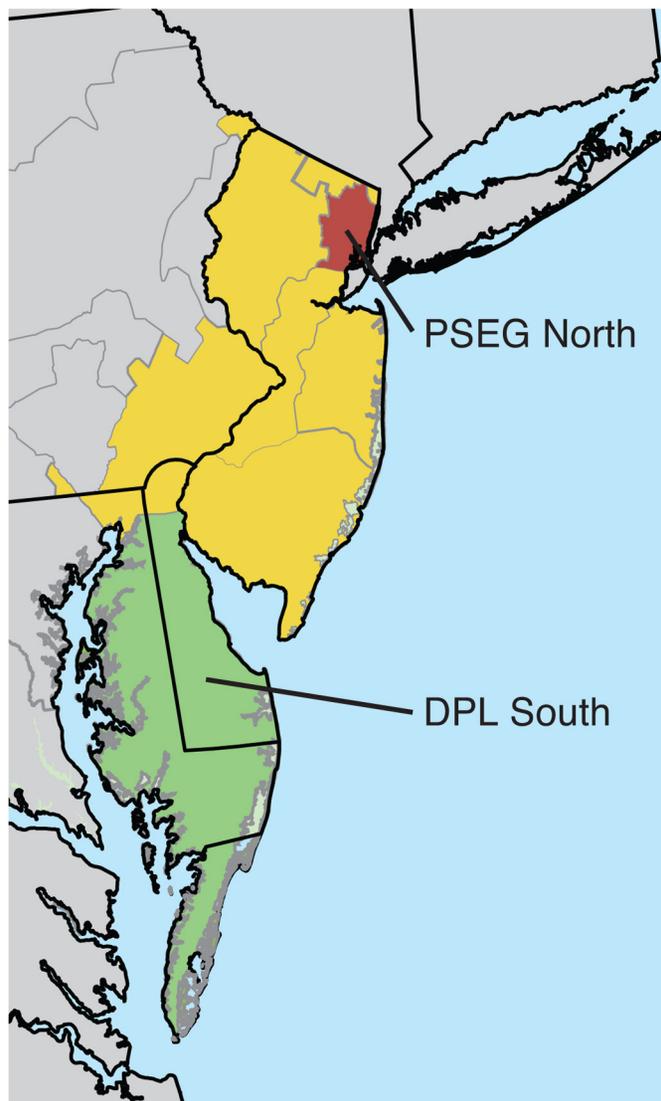


Figure 5-5 Map of PJM RPM ATSI subzonal LDA

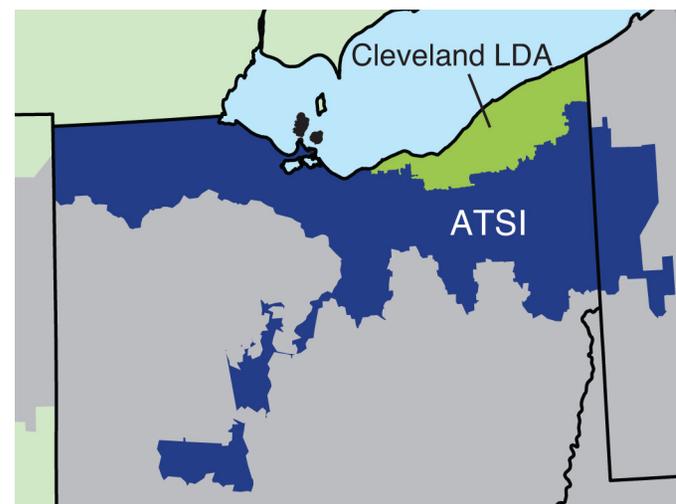

### Imports and Exports

Units external to the metered boundaries of PJM can qualify as PJM capacity resources if they meet the requirements to be capacity resources. Generators on the PJM system that do not have a commitment to serve PJM loads in the given Delivery Year as a result of RPM Auctions, FRR capacity plans, locational UCAP transactions, and/or are not designated as a replacement resource, are eligible to export their capacity from PJM.<sup>43</sup>

Of the 599.7 MW of imports in the 2016/2017 RPM Third Incremental Auction, 8.0 MW cleared. Of the cleared imports, 4.9 MW (61.3 percent) were from MISO.

The PJM market rules should not create inappropriate barriers to either the import or export of capacity. The market rules in other balancing authorities should also not create inappropriate barriers to the import or export of capacity. The PJM market rules should ensure that the definition of capacity

<sup>43</sup> PJM. OATT Attachment DD § 5.6.6(b).

is enforced including physical deliverability, recallability and the obligation to make competitive offers into the PJM Day-Ahead Energy Market. Physical deliverability can only be assured by requiring that all imports are deliverable to PJM load to ensure that they are full substitutes for internal capacity resources. While pseudo ties were a step toward this goal, pseudo ties alone are not adequate to ensure deliverability. Pseudo ties create potential issues in the exporting area and do not ensure deliverability into the importing area. Selling capacity into the PJM Capacity Market but making energy offers daily of \$999 per MWh would not fulfill the requirements of a capacity resource to make a competitive offer, but would constitute economic withholding. This is one of the reasons that the rules governing the obligation to make a competitive offer in the Day-Ahead Energy Market should be clarified for both internal and external resources.

Effective with the 2017/2018 Delivery Year, Capacity Import Limits (CILs) are established for each of the five external source zones and the overall PJM region to account for the risk that external generation resources may not be able to deliver energy during the relevant Delivery Year due to the curtailment of firm transmission by third parties.<sup>44</sup> Capacity Market Sellers may request an exception to the CIL for an external generation resource by committing that the resource will be pseudo tied prior to the start of the relevant Delivery Year, by demonstrating that it has long-term firm transmission service confirmed on the complete transmission path from the resource to PJM, and by agreeing to be subject to the same RPM must offer requirement as internal PJM generation resources.

Effective June 9, 2015, an external Generation Capacity Resource must obtain an exception to the CILs to be eligible to offer as a Capacity Performance Resource.<sup>45</sup>

<sup>44</sup> 147 FERC ¶ 61,060 (2014).

<sup>45</sup> 151 FERC ¶ 61,208 (2015).

## Importing Capacity

### Existing External Generation Capacity Resource

Generation external to the PJM region is eligible to be offered into an RPM Auction if it meets specific requirements.<sup>46 47</sup> Firm transmission service from the unit to the border of PJM and generation deliverability into PJM must be demonstrated prior to the start of the delivery year. In order to demonstrate generation deliverability into PJM, external generators must obtain firm point-to-point transmission service on the PJM OASIS from the PJM border into the PJM transmission system or by obtaining network external designated transmission service. In the event that transmission upgrades are required to establish deliverability, those upgrades must be completed by the start of the delivery year. The following are also required: the external generating unit must be in the resource portfolio of a PJM member; twelve months of NERC/GADs unit performance data must be provided to establish an EFORd; the net capability of each unit must be verified through winter and summer testing; a letter of non-recallability must be provided to assure PJM that the energy and capacity from the unit is not recallable to any other balancing authority.

All external generation resources that have an RPM commitment or FRR capacity plan commitment or that are designated as replacement capacity must be offered in the PJM Day-Ahead Energy Market.<sup>48</sup>

To avoid balancing market deviations, any offer accepted in the Day-Ahead Energy Market must be scheduled to physically flow in the Real-Time Energy Market. When submitting the real-time energy market transaction, a valid NERC Tag is required, with the appropriate transmission reservations associated. Additionally, external capacity transactions must designate the transaction as such when submitting the NERC Tag. This designation allows the PJM dispatch operators to identify capacity backed transactions in order to avoid curtailing them out of merit order. External capacity backed transactions are evaluated the same way as all other energy transactions and are subject to all scheduling timing requirements and PJM interchange ramp limits. If the offer is not accepted in the Day-Ahead Energy Market, but the

<sup>46</sup> See "Reliability Assurance Agreement Among Load Serving Entities in the PJM Region," Schedule 9 & 10.

<sup>47</sup> See PJM, "Manual 18: PJM Capacity Market," Revision 32 (April 1, 2016), pp. 51-52 & pp. 74-75.

<sup>48</sup> OATT, Schedule 1, Section 1.10.1A.

unit is requested during the operating day, the PJM dispatch operator will notify the participant. The market participant will then submit a tag to match the request. This tag will also be subject to all scheduling timing requirements and PJM interchange ramp limits.

### Planned External Generation Capacity Resource

Planned External Generation Capacity Resources are eligible to be offered into an RPM Auction if they meet specific requirements.<sup>49 50</sup> Planned External Generation Capacity Resources are proposed Generation Capacity Resources, or a proposed increase in the capability of an Existing Generation Capacity Resource, that is located outside the PJM region; participates in the generation interconnection process of a balancing authority external to PJM; is scheduled to be physically and electrically interconnected to the transmission facilities of such balancing authority on or before the first day of the delivery year for which the resource is to be committed to satisfy the reliability requirements of the PJM Region; and is in full commercial operation prior to the first day of the delivery year.<sup>51</sup> An External Generation Capacity Resource becomes an Existing Generation Capacity Resource as of the earlier of the date that interconnection service commences or the resource has cleared an RPM Auction.<sup>52</sup>

### Exporting Capacity

Non-firm transmission can be used to export capacity from the PJM region. A Generation Capacity Resource located in the PJM region not committed to service of PJM loads may be removed from PJM Capacity Resource status if the Capacity Market Seller shows that the resource has a financially and physically firm commitment to an external sale of its capacity.<sup>53</sup> The Capacity Market Seller must also identify the megawatt amount, export zone, and time period (in days) of the export.<sup>54</sup>

The MMU evaluates requests submitted by Capacity Market Sellers to export Generation Capacity Resources, makes a determination as to whether the resource meets the applicable criteria to export, and must inform both the Capacity Market Seller and PJM of such determination.<sup>55</sup>

When submitting a real-time market export capacity transaction, a valid NERC Tag is required, with the appropriate transmission reservations associated. Capacity transactions must designate the transaction as capacity when submitting the NERC Tag. This designation allows the PJM dispatch operators to identify capacity backed transactions in order to avoid curtailing them out of merit order. External capacity backed transactions are evaluated the same way as all other energy transactions and are subject to all scheduling timing requirements and PJM interchange ramp limits.

**Table 5-7 RPM imports: 2007/2008 through 2018/2019 RPM Base Residual Auctions**

Base Residual Auction	UCAP (MW)					
	MISO		Non-MISO		Total Imports	
	Offered	Cleared	Offered	Cleared	Offered	Cleared
2007/2008	1,073.0	1,072.9	547.9	547.9	1,620.9	1,620.8
2008/2009	1,149.4	1,109.0	517.6	516.8	1,667.0	1,625.8
2009/2010	1,189.2	1,151.0	518.8	518.1	1,708.0	1,669.1
2010/2011	1,194.2	1,186.6	539.8	539.5	1,734.0	1,726.1
2011/2012	1,862.7	1,198.6	3,560.0	3,557.5	5,422.7	4,756.1
2012/2013	1,415.9	1,298.8	1,036.7	1,036.7	2,452.6	2,335.5
2013/2014	1,895.1	1,895.1	1,358.9	1,358.9	3,254.0	3,254.0
2014/2015	1,067.7	1,067.7	1,948.8	1,948.8	3,016.5	3,016.5
2015/2016	1,538.7	1,538.7	2,396.6	2,396.6	3,935.3	3,935.3
2016/2017	4,723.1	4,723.1	2,770.6	2,759.6	7,493.7	7,482.7
2017/2018	2,624.3	2,624.3	2,320.4	1,901.2	4,944.7	4,525.5
2018/2019	2,879.1	2,509.1	2,256.7	2,178.8	5,135.8	4,687.9

<sup>49</sup> See "Reliability Assurance Agreement Among Load Serving Entities in the PJM Region," Section 1.69A.

<sup>50</sup> See PJM, "Manual 18: PJM Capacity Market," Revision 32 (April 1, 2016), pp. 53-54.

<sup>51</sup> Prior to January 31, 2011, capacity modifications to existing generation capacity resources were not considered planned generation capacity resources. See 134 FERC ¶ 61,065 (2011).

<sup>52</sup> Effective January 31, 2011, the RPM rules related to market power mitigation were changed, including revising the definition for Planned Generation Capacity Resource for purposes of the must-offer requirement and market power mitigation. See 134 FERC ¶ 61,065 (2011).

<sup>53</sup> OATT Attachment DD § 6.6(g).

<sup>54</sup> *Id.*

<sup>55</sup> OATT Attachment M-Appendix § ILC.2.

## Demand Resources

There are three basic demand products incorporated in the RPM market design:<sup>56</sup>

- **Demand Resources (DR).** Interruptible load resource that is offered into an RPM Auction as capacity and receives the relevant LDA or RTO resource clearing price.
- **Interruptible Load for Reliability (ILR).** Interruptible load resource that is not offered into the RPM Auction, but receives the final zonal ILR price determined after the second incremental auction. The ILR product was eliminated after the 2011/2012 Delivery Year.
- **Energy Efficiency (EE) Resources.** Load resources that are offered into an RPM Auction as capacity and receive the relevant LDA or RTO resource clearing price. The EE resource type was eligible to be offered in RPM Auctions starting with the 2012/2013 Delivery Year and in incremental auctions in the 2011/2012 Delivery Year.<sup>57</sup>

Effective for the 2014/2015 through the 2017/2018 Delivery Year, there are three types of Demand Resource products included in the RPM market design:<sup>58 59</sup>

- **Annual DR.** Demand Resource that is required to be available on any day in the relevant delivery year for an unlimited number of interruptions. Annual DR is required to be capable of maintaining each interruption for only ten hours only during the hours of 10:00 a.m. to 10:00 p.m. EPT for the period May through October and 6:00 a.m. to 9:00 p.m. EPT for the period November through April unless there is an Office of the Interconnection approved maintenance outage during October through April.

- **Extended Summer DR.** Demand Resource that is required to be available on any day from June through October and the following May in the relevant delivery year for an unlimited number of interruptions. Extended Summer DR is required to be capable of maintaining each interruption for only ten hours only during the hours of 10:00 a.m. to 10:00 p.m. EPT.
- **Limited DR.** Demand Resource that is required to be available on weekdays not including NERC holidays during the period of June through September in the relevant delivery year for up to 10 interruptions. Limited DR is required to be capable of maintaining each interruption for only six hours only during the hours of 12:00 p.m. to 8:00 p.m. EPT.

Effective for the 2018/2019 and the 2019/2020 Delivery Years, there are two types of Demand Resource and Energy Efficiency Resource products included in the RPM market design:<sup>60 61</sup>

- **Base Capacity Demand Resource.** Demand Resource that is required to be available on any day from June through September for an unlimited number of interruptions. Base Capacity DR is required to be capable of maintaining each interruption for at least ten hours only during the hours of 10:00 a.m. to 10:00 p.m. EPT.
- **Base Capacity Energy Efficiency Resource.** A project designed to achieve a continuous (during summer peak periods) reduction in electric energy consumption that is not reflected in the peak load forecast for the delivery year for which the Base Capacity Energy Efficiency Resource is proposed, and that is fully implemented at all times during the relevant delivery year, without any requirement of notice, dispatch, or operator intervention. The peak period definition for the Base Capacity Energy Efficiency Resource type includes the period from the hour ending 15:00 EPT and the hour ending 18:00 EPT from June through August, excluding weekends and federal holidays.

<sup>56</sup> Effective June 1, 2007, the PJM active load management (ALM) program was replaced by the PJM load management (LM) program. Under ALM, providers had received a MW credit which offset their capacity obligation. With the introduction of LM, qualifying load management resources can be offered into RPM Auctions as capacity resources and receive the clearing price.

<sup>57</sup> Letter Order in Docket No. ER10-366-000 (January 22, 2010).

<sup>58</sup> 134 FERC ¶ 61,066 (2011).

<sup>59</sup> "Reliability Assurance Agreement among Load-Serving Entities in the PJM Region," Article 1.

<sup>60</sup> 151 FERC ¶ 61,208.

<sup>61</sup> "Reliability Assurance Agreement Among Load Serving Entities in the PJM Region," Article 1.

- Capacity Performance Resource
  - **Annual Demand Resource.** Demand Resource that is required to be available on any day in the relevant delivery year for an unlimited number of interruptions. Annual DR is required to be capable of maintaining each interruption for only ten hours during the hours of 10:00 a.m. to 10:00 p.m. EPT for the period May through October and 6:00 a.m. to 9:00 p.m. EPT for the period November through April unless there is an Office of the Interconnection approved maintenance outage during October through April.
  - **Annual Energy Efficiency Resource.** A project designed to achieve a continuous (during summer and winter peak periods) reduction in

electric energy consumption during peak periods that is not reflected in the peak load forecast for the delivery year for which the Energy Efficiency Resource is proposed, and that is fully implemented at all times during the relevant delivery year, without any requirement of notice, dispatch, or operator intervention. The peak period definition for the Annual Energy Efficiency Resource type includes the period from the hour ending 15:00 EPT and the hour ending 18:00 EPT from June through August, and the period from the hour ending 8:00 EPT and the hour ending 9:00 EPT and the period from the hour ending 19:00 EPT and the hour ending 20:00 EPT from January through February, excluding weekends and federal holidays.

**Table 5-8 RPM load management statistics by LDA: June 1, 2014 to June 1, 2018**<sup>62 63 64</sup>

	UCAP (MW)												
	RTO	MAAC	EMAAC	SWMAAC	DPL South	PSEG	PSEG North	Pepco	ATSI	ATSI Cleveland	ComEd	BGE	PPL
DR cleared	14,943.0	7,452.4	2,976.9	2,268.4	220.9	999.5	468.4	920.0					
EE cleared	1,077.7	305.9	45.2	169.8	8.1	24.2	11.9	51.4					
DR net replacements	(6,731.8)	(3,778.7)	(1,651.1)	(1,010.7)	(156.0)	(550.4)	(231.1)	(428.9)					
EE net replacements	204.7	219.5	46.8	148.2	(6.8)	12.7	5.0	68.3					
RPM load management @ 01-Jun-14	9,493.6	4,199.1	1,417.8	1,575.7	66.2	486.0	254.2	610.8					
DR cleared	15,453.7	6,675.4	2,624.0	2,022.4	86.3	787.3	263.5	867.7	2,167.9				
EE cleared	1,189.6	279.0	73.1	164.8	3.1	26.4	11.5	59.3	142.0				
DR net replacements	(4,829.7)	(2,393.0)	(1,078.7)	(672.5)	(10.4)	(363.6)	(128.4)	(310.7)	(1,082.2)				
EE net replacements	335.9	230.4	48.5	149.2	0.0	12.4	2.7	61.1	15.2				
RPM load management @ 01-Jun-15	12,149.5	4,791.8	1,666.9	1,663.9	79.0	462.5	149.3	677.4	1,242.9				
DR cleared	13,277.1	5,409.8	2,029.3	1,622.6	105.7	634.4	230.3	683.9	1,841.4	470.8			
EE cleared	1,723.2	418.0	86.4	262.6	2.0	27.9	10.8	136.5	226.9	58.6			
DR net replacements	(2,163.6)	(1,096.3)	(479.2)	(148.6)	(29.4)	(132.6)	(25.5)	(90.3)	(322.6)	(153.0)			
EE net replacements	(92.1)	(4.1)	(1.7)	0.0	0.0	0.0	0.0	0.0	(82.9)	(15.9)			
RPM load management @ 01-Jun-16	12,744.6	4,727.4	1,634.8	1,736.6	78.3	529.7	215.6	730.1	1,662.8	360.5			
DR cleared	11,623.2	4,545.3	1,610.4	1,445.4	86.3	389.6	151.7	639.6	1,049.8	290.3	1,600.8	805.8	811.9
EE cleared	1,611.2	411.9	105.4	234.6	2.0	23.0	6.0	110.0	153.1	35.7	727.7	124.6	41.6
DR net replacements	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
EE net replacements	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RPM load management @ 01-Jun-17	13,234.4	4,957.2	1,715.8	1,680.0	88.3	412.6	157.7	749.6	1,202.9	326.0	2,328.5	930.4	853.5
DR cleared	11,084.4	4,286.0	1,674.6	1,183.1	86.8	382.2	132.6	523.1	877.0	267.6	1,876.7	660.0	716.2
EE cleared	1,246.5	258.6	54.3	162.3	0.0	14.1	1.8	66.4	38.8	5.6	744.4	95.9	25.0
DR net replacements	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
EE net replacements	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RPM load management @ 01-Jun-18	12,330.9	4,544.6	1,728.9	1,345.4	86.8	396.3	134.4	589.5	915.8	273.2	2,621.1	755.9	741.2

<sup>62</sup> See PJM. OATT Attachment DD § 8.4. The reported DR cleared MW may reflect reductions in the level of committed MW due to relief from Capacity Resource Deficiency Charges. For the 2012/2013 Delivery Year, relief from charges was granted by PJM for 11.7 MW.

<sup>63</sup> Pursuant to PJM Operating Agreement § 15.1.6(c), PJM Settlement shall attempt to close out and liquidate forward capacity commitments for PJM Members that are declared in collateral default. The replacement transactions reported for the 2014/2015 Delivery Year include transactions associated with RTP Controls, Inc. which was declared in collateral default on March 9, 2012.

<sup>64</sup> See PJM. OATT. Attachment DD § 5.14C. The reported DR cleared MW for the 2015/2016 and 2016/2017 Delivery Years reflect reductions in the level of committed MW due to the Demand Response Operational Resource Flexibility Transition Provision.

Effective with the 2020/2021 Delivery Year, the Capacity Performance product will be the only capacity product type.

As shown in Table 5-8 and Table 5-10, capacity in the RPM load management programs was 12,149.5 MW for June 1, 2015, as a result of cleared capacity for Demand Resources and Energy Efficiency Resources in RPM Auctions for the 2015/2016 Delivery Year (16,643.3 MW) less replacement capacity (4,493.8 MW). Table 5-9 shows RPM commitments for DR and EE resources as the result of RPM Auctions prior to adjustments for replacement capacity transactions and certified ILR.

**Table 5-9 RPM load management cleared capacity and ILR: 2007/2008 through 2018/2019**<sup>65 66 67</sup>

Delivery Year	DR Cleared		EE Cleared		ILR	
	ICAP (MW)	UCAP (MW)	ICAP (MW)	UCAP (MW)	ICAP (MW)	UCAP (MW)
2007/2008	123.5	127.6	0.0	0.0	1,584.6	1,636.3
2008/2009	540.9	559.4	0.0	0.0	3,488.5	3,608.1
2009/2010	864.5	892.9	0.0	0.0	6,273.8	6,481.5
2010/2011	930.9	962.9	0.0	0.0	7,961.3	8,236.4
2011/2012	1,766.0	1,826.6	74.0	76.4	8,730.7	9,032.6
2012/2013	8,429.7	8,740.9	643.4	666.1	0.0	0.0
2013/2014	10,345.6	10,779.6	871.0	904.2	0.0	0.0
2014/2015	14,337.6	14,943.0	1,035.4	1,077.7	0.0	0.0
2015/2016	14,891.6	15,453.7	1,147.7	1,189.6	0.0	0.0
2016/2017	12,748.8	13,277.1	1,656.9	1,723.2	0.0	0.0
2017/2018	11,202.1	11,623.2	1,554.4	1,611.2	0.0	0.0
2018/2019	10,229.3	11,084.4	1,150.5	1,246.5	0.0	0.0

65 For Delivery Years through 2011/2012, certified ILR data is shown, because the certified ILR data are now available. Effective the 2012/2013 Delivery Year, ILR was eliminated. Starting with the 2012/2013 Delivery Year and also for Incremental Auctions in the 2011/2012 Delivery Year, the Energy Efficiency (EE) resource type is eligible to be offered in RPM Auctions.

66 See PJM. OATT. Attachment DD § 8.4. The reported DR cleared MW may reflect reductions in the level of committed MW due to relief from Capacity Resource Deficiency Charges. For the 2012/2013 Delivery Year, relief from charges was granted by PJM for 11.7 MW.

67 See PJM. OATT. Attachment DD § 5.14C. The reported DR cleared MW for the 2015/2016 and 2016/2017 Delivery Years reflect reductions in the level of committed MW due to the Demand Response Operational Resource Flexibility Transition Provision.

**Table 5-10 RPM load management statistics: June 1, 2007 to June 1, 2018**<sup>68 69</sup>

	DR and EE Cleared Plus ILR		DR Net Replacements		EE Net Replacements		Total RPM LM	
	ICAP (MW)	UCAP (MW)	ICAP (MW)	UCAP (MW)	ICAP (MW)	UCAP (MW)	ICAP (MW)	UCAP (MW)
01-Jun-07	1,708.1	1,763.9	0.0	0.0	0.0	0.0	1,708.1	1,763.9
01-Jun-08	4,029.4	4,167.5	(38.7)	(40.0)	0.0	0.0	3,990.7	4,127.5
01-Jun-09	7,138.3	7,374.4	(459.5)	(474.7)	0.0	0.0	6,678.8	6,899.7
01-Jun-10	8,892.2	9,199.3	(499.1)	(516.3)	0.0	0.0	8,393.1	8,683.0
01-Jun-11	10,570.7	10,935.6	(1,017.3)	(1,052.4)	0.2	0.2	9,553.6	9,883.4
01-Jun-12	9,073.1	9,407.0	(2,173.4)	(2,253.6)	(33.7)	(34.9)	6,866.0	7,118.5
01-Jun-13	11,216.6	11,683.8	(3,184.8)	(3,318.8)	120.0	125.0	8,151.8	8,490.0
01-Jun-14	15,373.0	16,020.7	(6,458.4)	(6,731.8)	196.4	204.7	9,111.0	9,493.6
01-Jun-15	16,039.3	16,643.3	(4,653.7)	(4,829.7)	323.7	335.9	11,709.3	12,149.5
01-Jun-16	14,405.7	15,000.3	(2,077.3)	(2,163.6)	(88.4)	(92.1)	12,240.0	12,744.6
01-Jun-17	12,756.5	13,234.4	0.0	0.0	0.0	0.0	12,756.5	13,234.4
01-Jun-18	11,379.8	12,330.9	0.0	0.0	0.0	0.0	11,379.8	12,330.9

## Market Conduct

### Offer Caps and Offer Floors

Market power mitigation measures were applied to Capacity Resources such that the sell offer was set equal to the defined offer cap when the Capacity Market Seller failed the market structure test for the auction, the submitted sell offer exceeded the defined offer cap, and the submitted sell offer, absent mitigation, would have increased the market clearing price.<sup>70 71 72</sup>

Avoidable costs are the costs that a generation owner would not incur if the generating unit did not operate for one year, in particular the delivery year.<sup>73</sup> In the calculation of avoidable costs, there is no presumption that the unit would retire as the alternative to operating, although that possibility could

68 For Delivery Years through 2011/2012, certified ILR data were used in the calculation, because the certified ILR data are now available. Effective the 2012/2013 Delivery Year, ILR was eliminated. Starting with the 2012/2013 Delivery Year and also for Incremental Auctions in the 2011/2012 Delivery Year, the Energy Efficiency (EE) resource type is eligible to be offered in RPM Auctions.

69 Pursuant to PJM Operating Agreement § 15.1.6(c), PJM Settlement shall attempt to close out and liquidate forward capacity commitments for PJM members that are declared in collateral default. The replacement transactions reported for the 2014/2015 Delivery Year included transactions associated with RTP Controls, Inc. which was declared in collateral default on March 9, 2012.

70 See OATT Attachment DD § 6.5.

71 Prior to November 1, 2009, existing DR and EE resources were subject to market power mitigation in RPM Auctions. See 129 FERC ¶ 61,081 (2009) at P 30.

72 Effective January 31, 2011, the RPM rules related to market power mitigation were changed, including revising the definition for Planned Generation Capacity Resource and creating a new definition for Existing Generation Capacity Resource for purposes of the must-offer requirement and market power mitigation, and treating a proposed increase in the capability of a Generation Capacity Resource the same in terms of mitigation as a Planned Generation Capacity Resource. See 134 FERC ¶ 61,065 (2011).

73 OATT Attachment DD § 6.8 (b).

be reflected if the owner documented that retirement was the alternative. Avoidable costs may also include annual capital recovery associated with investments required to maintain a unit as a Generation Capacity Resource, termed Avoidable Project Investment Recovery (APIR). Avoidable cost-based offer caps are defined to be net of revenues from all other PJM markets and unit-specific bilateral contracts. Capacity resource owners could provide ACR data by providing their own unit-specific data or by selecting the default ACR values. The specific components of avoidable costs are defined in the PJM Tariff.<sup>74</sup>

The opportunity cost option allows Capacity Market Sellers to input a documented price available in a market external to PJM, subject to export limits. If the relevant RPM market clears above the opportunity cost, the Generation Capacity Resource is sold in the RPM market. If the opportunity cost is greater than the clearing price and the Generation Capacity Resource does not clear in the RPM market, it is available to sell in the external market.

Effective April 12, 2011, the RPM Minimum Offer Price Rule (MOPR) was changed.<sup>75</sup> The changes to the MOPR included updating the calculation of the net Cost of New Entry (CONE) for combined cycle (CC) and combustion turbine (CT) plants which is used as a benchmark value in assessing the competitiveness of a sell offer, increasing the percentage value used in the screen to 90 percent for CC and CT plants, eliminating the net-short requirement as a prerequisite for applying the MOPR, eliminating the impact screen, revising the process for reviewing proposed exceptions to the defined minimum sell offer price, and clarifying which resources are subject to the MOPR along with the duration of mitigation. Subsequent FERC Orders revised the MOPR, including clarification on the duration of mitigation, which resources are subject to MOPR, and the MOPR review process.<sup>76</sup>

Effective May 3, 2013, the RPM Minimum Offer Price Rule (MOPR) was changed again.<sup>77</sup> The changes to the MOPR included establishing Competitive Entry and Self Supply Exemptions while also retaining the unit specific exemption process for those that do not qualify for the Competitive Entry or Self Supply Exemptions; changing the applicability of MOPR to include only combustion turbine, combined cycle, integrated gasification combined cycle (IGCC) technologies while excluding units primarily fueled with landfill gas or cogeneration units which are certified or self-certified as Qualifying Facilities (QFs); changing the applicability to increases in installed capacity of 20.0 MW or more combined for all units at a single point of interconnection to the Transmission System; changing the applicability to include the full capability of repowering of plants based on combustion turbine, combined cycle, IGCC technology; increasing the screen from 90 percent to 100 percent of the applicable net CONE values; and broadening the region subject to MOPR to the entire RTO from constrained LDAs only.

### 2016/2017 RPM Third Incremental Auction

As shown in Table 5-11, 296 generation resources submitted offers in the 2016/2017 RPM Third Incremental Auction. The MMU calculated offer caps for 52 generation resources (17.6 percent), of which 35 were based on the technology specific default (proxy) ACR values and 17 were unit-specific offer caps (5.7 percent of all generation resources), of which 17 offer caps included an APIR component. Of the 296 generation resources, 244 did not request unit specific offer caps, of which 145 generation resources elected the offer cap option of 1.1 times the BRA clearing price, 11 Planned Generation Capacity Resources had uncapped offers (3.7 percent), and 88 generation resources were price takers (29.7 percent). Market power mitigation was applied to the sell offers of zero generation resources.

74 OATT Attachment DD § 6.8 (a).

75 135 FERC ¶ 61,022 (2011).

76 135 FERC ¶ 61,022 (2011), order on reh'g, 137 FERC ¶ 61,145 (2011).

77 143 FERC ¶ 61,090 (2013).

Table 5-11 ACR statistics: 2016/2017 RPM Auctions

Offer Cap/Mitigation Type	2016/2017 Base Residual Auction		2016/2017 First Incremental Auction		2016/2017 Second Incremental Auction		2016/2017 Third Incremental Auction	
	Number of Generation Resources	Percent of Generation Resources Offered	Number of Generation Resources	Percent of Generation Resources Offered	Number of Generation Resources	Percent of Generation Resources Offered	Number of Generation Resources	Percent of Generation Resources Offered
Default ACR	471	39.3%	24	20.9%	17	16.8%	35	11.8%
Unit specific ACR (APIR)	138	11.5%	32	27.8%	23	22.8%	17	5.7%
Unit specific ACR (APIR and CPQR)	NA	NA	NA	NA	NA	NA	NA	NA
Unit specific ACR (non-APIR)	1	0.1%	4	3.5%	0	0.0%	0	0.0%
Unit specific ACR (non-APIR and CPQR)	NA	NA	NA	NA	NA	NA	NA	NA
Opportunity cost input	8	0.7%	1	0.9%	1	1.0%	0	0.0%
Default ACR and opportunity cost	5	0.4%	0	0.0%	0	0.0%	0	0.0%
Net CONE times B	NA	NA	NA	NA	NA	NA	NA	NA
Offer cap of 1.1 times BRA clearing price elected	NA	NA	NA	NA	NA	NA	145	49.0%
Uncapped planned uprate and default ACR	15	1.3%	1	0.9%	4	4.0%	0	0.0%
Uncapped planned uprate and opportunity cost	0	0.0%	0	0.0%	0	0.0%	0	0.0%
Uncapped planned uprate and Net CONE times B	NA	NA	NA	NA	NA	NA	NA	NA
Uncapped planned uprate and price taker	11	0.9%	0	0.0%	3	3.0%	0	0.0%
Uncapped planned uprate and 1.1 times BRA clearing price elected	NA	NA	NA	NA	NA	NA	0	0.0%
Uncapped planned generation resources	31	2.6%	1	0.9%	1	1.0%	11	3.7%
Existing generation resources as price takers	519	43.3%	52	45.2%	52	51.5%	88	29.7%
Total Generation Capacity Resources offered	1,199	100.0%	115	100.0%	101	100.0%	296	100.0%

## Market Performance

Figure 5-6 shows cleared MW weighted average capacity market prices on a Delivery Year basis for the entire history of the PJM capacity markets. Table 5-12 shows RPM clearing prices for all RPM Auctions held through the first three months of 2016.

Figure 5-7 shows the RPM cleared MW weighted average prices for each LDA for the current Delivery Year and all results for auctions for future Delivery Years that have been held through the first three months of 2016. A summary of these weighted average prices is given in Table 5-13.

Table 5-14 shows RPM revenue by resource type for all RPM Auctions held through the first three months of 2016 with \$5.0 billion for new/repower/reactivated generation resources based on the unforced MW cleared and the resource clearing prices. A resource classified as “new/repower/reactivated” is a capacity resource addition since the implementation of RPM and is considered

“new/repower/reactivated” for its initial offer and all its subsequent offers in RPM Auctions.

Table 5-15 shows RPM revenue by calendar year for all RPM Auctions held through the first three months of 2016. In 2015, RPM revenue was \$9.0 billion. In 2016, RPM revenue will be \$8.9 billion.

Table 5-16 shows the RPM annual charges to load. For the 2015/2016 Delivery Year, RPM annual charges to load are \$9.6 billion. For the 2016/2017 Delivery Year, annual charges to load are \$7.7 billion.

Table 5-12 Capacity prices: 2007/2008 through 2018/2019 RPM Auctions

Product Type	RPM Clearing Price (\$ per MW-day)											
	RTO	MAAC	APS	PPL	EMAAC	SWMAAC	DPL South	PSEG	PSEG North	Pepco	ATSI	ComEd
2007/2008 BRA	\$40.80	\$40.80	\$40.80	\$40.80	\$197.67	\$188.54	\$197.67	\$197.67	\$197.67	\$188.54		\$40.80
2008/2009 BRA	\$111.92	\$111.92	\$111.92	\$111.92	\$148.80	\$210.11	\$148.80	\$148.80	\$148.80	\$210.11		\$111.92
2008/2009 Third Incremental Auction	\$10.00	\$10.00	\$10.00	\$10.00	\$10.00	\$223.85	\$10.00	\$10.00	\$10.00	\$223.85		\$10.00
2009/2010 BRA	\$102.04	\$191.32	\$191.32	\$191.32	\$191.32	\$237.33	\$191.32	\$191.32	\$191.32	\$237.33		\$102.04
2009/2010 Third Incremental Auction	\$40.00	\$86.00	\$86.00	\$86.00	\$86.00	\$86.00	\$86.00	\$86.00	\$86.00	\$86.00		\$40.00
2010/2011 BRA	\$174.29	\$174.29	\$174.29	\$174.29	\$174.29	\$174.29	\$186.12	\$174.29	\$174.29	\$174.29		\$174.29
2010/2011 Third Incremental Auction	\$50.00	\$50.00	\$50.00	\$50.00	\$50.00	\$50.00	\$50.00	\$50.00	\$50.00	\$50.00		\$50.00
2011/2012 BRA	\$110.00	\$110.00	\$110.00	\$110.00	\$110.00	\$110.00	\$110.00	\$110.00	\$110.00	\$110.00		\$110.00
2011/2012 First Incremental Auction	\$55.00	\$55.00	\$55.00	\$55.00	\$55.00	\$55.00	\$55.00	\$55.00	\$55.00	\$55.00		\$55.00
2011/2012 ATSI FRR Integration Auction	\$108.89	\$108.89	\$108.89	\$108.89	\$108.89	\$108.89	\$108.89	\$108.89	\$108.89	\$108.89	\$108.89	\$108.89
2011/2012 Third Incremental Auction	\$5.00	\$5.00	\$5.00	\$5.00	\$5.00	\$5.00	\$5.00	\$5.00	\$5.00	\$5.00	\$5.00	\$5.00
2012/2013 BRA	\$16.46	\$133.37	\$16.46	\$133.37	\$139.73	\$133.37	\$222.30	\$139.73	\$185.00	\$133.37		\$16.46
2012/2013 ATSI FRR Integration Auction	\$20.46	\$20.46	\$20.46	\$20.46	\$20.46	\$20.46	\$20.46	\$20.46	\$20.46	\$20.46	\$20.46	\$20.46
2012/2013 First Incremental Auction	\$16.46	\$16.46	\$16.46	\$16.46	\$153.67	\$16.46	\$153.67	\$153.67	\$153.67	\$16.46	\$16.46	\$16.46
2012/2013 Second Incremental Auction	\$13.01	\$13.01	\$13.01	\$13.01	\$48.91	\$13.01	\$48.91	\$48.91	\$48.91	\$13.01	\$13.01	\$13.01
2012/2013 Third Incremental Auction	\$2.51	\$2.51	\$2.51	\$2.51	\$2.51	\$2.51	\$2.51	\$2.51	\$2.51	\$2.51	\$2.51	\$2.51
2013/2014 BRA	\$27.73	\$226.15	\$27.73	\$226.15	\$245.00	\$226.15	\$245.00	\$245.00	\$245.00	\$247.14	\$27.73	\$27.73
2013/2014 First Incremental Auction	\$20.00	\$20.00	\$20.00	\$20.00	\$178.85	\$54.82	\$178.85	\$178.85	\$178.85	\$54.82	\$20.00	\$20.00
2013/2014 Second Incremental Auction	\$7.01	\$10.00	\$7.01	\$10.00	\$40.00	\$10.00	\$40.00	\$40.00	\$40.00	\$10.00	\$7.01	\$7.01
2013/2014 Third Incremental Auction	\$4.05	\$30.00	\$4.05	\$30.00	\$188.44	\$30.00	\$188.44	\$188.44	\$188.44	\$30.00	\$4.05	\$4.05
2014/2015 BRA	Limited	\$125.47	\$125.47	\$125.47	\$125.47	\$125.47	\$125.47	\$125.47	\$125.47	\$213.97	\$125.47	\$125.47
2014/2015 BRA	Extended Summer	\$125.99	\$136.50	\$125.99	\$136.50	\$136.50	\$136.50	\$136.50	\$136.50	\$225.00	\$136.50	\$125.99
2014/2015 BRA	Annual	\$125.99	\$136.50	\$125.99	\$136.50	\$136.50	\$136.50	\$136.50	\$136.50	\$225.00	\$136.50	\$125.99
2014/2015 First Incremental Auction	Limited	\$0.03	\$5.23	\$0.03	\$5.23	\$5.23	\$5.23	\$5.23	\$5.23	\$399.62	\$5.23	\$0.03
2014/2015 First Incremental Auction	Extended Summer	\$5.54	\$16.56	\$5.54	\$16.56	\$16.56	\$16.56	\$16.56	\$16.56	\$410.95	\$16.56	\$5.54
2014/2015 First Incremental Auction	Annual	\$5.54	\$16.56	\$5.54	\$16.56	\$16.56	\$16.56	\$16.56	\$16.56	\$410.95	\$16.56	\$5.54
2014/2015 Second Incremental Auction	Limited	\$25.00	\$56.94	\$25.00	\$56.94	\$56.94	\$56.94	\$56.94	\$56.94	\$310.00	\$56.94	\$25.00
2014/2015 Second Incremental Auction	Extended Summer	\$25.00	\$56.94	\$25.00	\$56.94	\$56.94	\$56.94	\$56.94	\$56.94	\$310.00	\$56.94	\$25.00
2014/2015 Second Incremental Auction	Annual	\$25.00	\$56.94	\$25.00	\$56.94	\$56.94	\$56.94	\$56.94	\$56.94	\$310.00	\$56.94	\$25.00
2014/2015 Third Incremental Auction	Limited	\$25.51	\$132.20	\$25.51	\$132.20	\$132.20	\$132.20	\$132.20	\$132.20	\$256.76	\$132.20	\$25.51
2014/2015 Third Incremental Auction	Extended Summer	\$25.51	\$132.20	\$25.51	\$132.20	\$132.20	\$132.20	\$132.20	\$132.20	\$256.76	\$132.20	\$25.51
2014/2015 Third Incremental Auction	Annual	\$25.51	\$132.20	\$25.51	\$132.20	\$132.20	\$132.20	\$132.20	\$132.20	\$256.76	\$132.20	\$25.51
2015/2016 BRA	Limited	\$118.54	\$150.00	\$118.54	\$150.00	\$150.00	\$150.00	\$150.00	\$150.00	\$150.00	\$304.62	\$118.54
2015/2016 BRA	Extended Summer	\$136.00	\$167.46	\$136.00	\$167.46	\$167.46	\$167.46	\$167.46	\$167.46	\$167.46	\$167.46	\$322.08
2015/2016 BRA	Annual	\$136.00	\$167.46	\$136.00	\$167.46	\$167.46	\$167.46	\$167.46	\$167.46	\$167.46	\$167.46	\$357.00
2015/2016 First Incremental Auction	Limited	\$43.00	\$111.00	\$43.00	\$111.00	\$111.00	\$111.00	\$111.00	\$122.95	\$122.95	\$111.00	\$168.37
2015/2016 First Incremental Auction	Extended Summer	\$43.00	\$111.00	\$43.00	\$111.00	\$111.00	\$111.00	\$111.00	\$122.95	\$122.95	\$111.00	\$168.37
2015/2016 First Incremental Auction	Annual	\$43.00	\$111.00	\$43.00	\$111.00	\$111.00	\$111.00	\$111.00	\$122.95	\$122.95	\$111.00	\$168.37
2015/2016 Second Incremental Auction	Limited	\$123.56	\$141.12	\$123.56	\$141.12	\$141.12	\$141.12	\$141.12	\$155.02	\$155.02	\$141.12	\$204.10
2015/2016 Second Incremental Auction	Extended Summer	\$136.00	\$153.56	\$136.00	\$153.56	\$153.56	\$153.56	\$153.56	\$167.46	\$167.46	\$153.56	\$216.54
2015/2016 Second Incremental Auction	Annual	\$136.00	\$153.56	\$136.00	\$153.56	\$153.56	\$153.56	\$153.56	\$167.46	\$167.46	\$153.56	\$216.54
2015/2016 Third Incremental Auction	Limited	\$100.76	\$122.33	\$100.76	\$122.33	\$122.33	\$122.33	\$122.33	\$122.56	\$122.56	\$122.33	\$100.76
2015/2016 Third Incremental Auction	Extended Summer	\$163.20	\$184.77	\$163.20	\$184.77	\$184.77	\$184.77	\$184.77	\$185.00	\$185.00	\$184.77	\$163.20
2015/2016 Third Incremental Auction	Annual	\$163.20	\$184.77	\$163.20	\$184.77	\$184.77	\$184.77	\$184.77	\$185.00	\$185.00	\$184.77	\$163.20
2016/2017 BRA	Limited	\$59.37	\$119.13	\$59.37	\$119.13	\$119.13	\$119.13	\$119.13	\$219.00	\$219.00	\$119.13	\$94.45

Table 5-12 Capacity prices: 2007/2008 through 2018/2019 RPM Auctions (continued)

	Product Type	RPM Clearing Price (\$ per MW-day)											
		RTO	MAAC	APS	PPL	EMAAC	SWMAAC	DPL South	PSEG	PSEG North	Pepco	ATSI	ComEd
2016/2017 BRA	Annual	\$59.37	\$119.13	\$59.37	\$119.13	\$119.13	\$119.13	\$119.13	\$219.00	\$219.00	\$119.13	\$114.23	\$59.37
2016/2017 First Incremental Auction	Limited	\$53.93	\$89.35	\$53.93	\$89.35	\$89.35	\$89.35	\$89.35	\$214.44	\$214.44	\$89.35	\$94.45	\$53.93
2016/2017 First Incremental Auction	Extended Summer	\$60.00	\$119.13	\$60.00	\$119.13	\$119.13	\$119.13	\$119.13	\$244.22	\$244.22	\$119.13	\$100.52	\$60.00
2016/2017 First Incremental Auction	Annual	\$60.00	\$119.13	\$60.00	\$119.13	\$119.13	\$119.13	\$119.13	\$244.22	\$244.22	\$119.13	\$100.52	\$60.00
2016/2017 Second Incremental Auction	Limited	\$31.00	\$71.00	\$31.00	\$71.00	\$71.00	\$71.00	\$71.00	\$99.01	\$212.53	\$71.00	\$101.50	\$31.00
2016/2017 Second Incremental Auction	Extended Summer	\$31.00	\$71.00	\$31.00	\$71.00	\$71.00	\$71.00	\$71.00	\$99.01	\$212.53	\$71.00	\$101.50	\$31.00
2016/2017 Second Incremental Auction	Annual	\$31.00	\$71.00	\$31.00	\$71.00	\$71.00	\$71.00	\$71.00	\$99.01	\$212.53	\$71.00	\$101.50	\$31.00
2016/2017 Capacity Performance Transition Auction	Capacity Performance	\$134.00	\$134.00	\$134.00	\$134.00	\$134.00	\$134.00	\$134.00	\$134.00	\$134.00	\$134.00	\$134.00	\$134.00
2016/2017 Third Incremental Auction	Limited	\$5.02	\$10.02	\$5.02	\$10.02	\$10.02	\$10.02	\$10.02	\$54.76	\$184.97	\$10.02	\$5.02	\$5.02
2016/2017 Third Incremental Auction	Extended Summer	\$5.02	\$10.02	\$5.02	\$10.02	\$10.02	\$10.02	\$10.02	\$54.76	\$184.97	\$10.02	\$5.02	\$5.02
2016/2017 Third Incremental Auction	Annual	\$5.02	\$10.02	\$5.02	\$10.02	\$10.02	\$10.02	\$10.02	\$54.76	\$184.97	\$10.02	\$5.02	\$5.02
2017/2018 BRA	Limited	\$106.02	\$106.02	\$106.02	\$40.00	\$106.02	\$106.02	\$106.02	\$201.02	\$201.02	\$106.02	\$106.02	\$106.02
2017/2018 BRA	Extended Summer	\$120.00	\$120.00	\$120.00	\$53.98	\$120.00	\$120.00	\$120.00	\$215.00	\$215.00	\$120.00	\$120.00	\$120.00
2017/2018 BRA	Annual	\$120.00	\$120.00	\$120.00	\$120.00	\$120.00	\$120.00	\$120.00	\$215.00	\$215.00	\$120.00	\$120.00	\$120.00
2017/2018 Capacity Performance Transition Auction	Capacity Performance	\$151.50	\$151.50	\$151.50	\$151.50	\$151.50	\$151.50	\$151.50	\$151.50	\$151.50	\$151.50	\$151.50	\$151.50
2017/2018 First Incremental Auction	Limited	\$84.00	\$84.00	\$84.00	\$84.00	\$84.00	\$84.00	\$84.00	\$143.08	\$143.08	\$84.00	\$84.00	\$84.00
2017/2018 First Incremental Auction	Extended Summer	\$84.00	\$84.00	\$84.00	\$84.00	\$84.00	\$84.00	\$84.00	\$143.08	\$143.08	\$84.00	\$84.00	\$84.00
2017/2018 First Incremental Auction	Annual	\$84.00	\$84.00	\$84.00	\$84.00	\$84.00	\$84.00	\$84.00	\$143.08	\$143.08	\$84.00	\$84.00	\$84.00
2018/2019 BRA	Base Capacity	\$149.98	\$149.98	\$149.98	\$75.00	\$210.63	\$149.98	\$210.63	\$210.63	\$210.63	\$149.98	\$149.98	\$200.21
2018/2019 BRA	Capacity Performance	\$164.77	\$164.77	\$164.77	\$164.77	\$225.42	\$164.77	\$225.42	\$225.42	\$225.42	\$164.77	\$164.77	\$215.00

Table 5-13 Weighted average clearing prices by zone: 2015/2016 through 2018/2019

LDA	Weighted Average Clearing Price (\$ per MW-day)			
	2015/2016	2016/2017	2017/2018	2018/2019
<b>RTO</b>				
AEP	\$134.00	\$115.27	\$142.03	\$162.73
AP	\$134.00	\$115.27	\$142.03	\$162.73
ATSI	\$327.79	\$122.15	\$140.83	\$162.28
Cleveland	\$327.79	\$112.13	\$140.08	\$163.10
ComEd	\$134.00	\$115.27	\$141.06	\$213.25
DAY	\$134.00	\$115.27	\$142.03	\$162.73
DEOK	\$134.00	\$115.27	\$142.03	\$162.73
DLCO	\$134.00	\$115.27	\$142.03	\$162.73
Dominion	\$134.00	\$115.27	\$142.03	\$162.73
EKPC	\$134.00	\$115.27	\$142.03	\$162.73
<b>MAAC</b>				
<b>EMAAC</b>				
AECO	\$166.51	\$123.01	\$138.50	\$221.00
DPL	\$166.51	\$123.01	\$138.50	\$221.00
DPL South	\$166.80	\$119.87	\$136.25	\$221.72
JCPL	\$166.51	\$123.01	\$138.50	\$221.00
PECO	\$166.51	\$123.01	\$138.50	\$221.00
PSEG	\$166.01	\$220.69	\$209.69	\$223.20
PSEG North	\$163.94	\$218.25	\$214.68	\$224.67
RECO	\$166.51	\$123.01	\$138.50	\$221.00
<b>SWMAAC</b>				
BGE	\$159.24	\$120.96	\$131.02	\$143.54
Pepco	\$166.03	\$118.60	\$135.86	\$153.20
<b>WMAAC</b>				
Met-Ed	\$164.83	\$122.13	\$140.70	\$163.12
PENELEC	\$164.83	\$122.13	\$140.70	\$163.12
PPL	\$164.83	\$122.13	\$136.50	\$154.01

Table 5-14 RPM revenue by type: 2007/2008 through 2018/2019<sup>78 79</sup>

	Demand Resources	Energy Efficiency Resources	Coal		Gas		Hydroelectric		Nuclear		Oil		Solar		Solid waste		Wind		Total revenue	
			Imports	Existing	New/repower/reactivated	Existing	New/repower/reactivated	Existing	New/repower/reactivated	Existing	New/repower/reactivated	Existing	New/repower/reactivated	Existing	New/repower/reactivated	Existing	New/repower/reactivated			
2007/2008	\$5,537,085	\$0	\$22,225,980	\$1,019,060,206	\$0	\$1,624,111,360	\$3,472,667	\$209,490,444	\$0	\$996,085,233	\$0	\$340,362,114	\$0	\$0	\$31,512,230	\$0	\$430,065	\$0	\$4,252,287,381	
2008/2009	\$35,349,116	\$0	\$60,918,903	\$1,835,059,769	\$0	\$2,112,913,366	\$9,751,112	\$287,850,403	\$0	\$1,322,601,837	\$0	\$378,756,365	\$4,837,523	\$0	\$0	\$35,011,991	\$0	\$1,180,153	\$2,917,048	\$6,087,147,586
2009/2010	\$65,762,003	\$0	\$56,517,793	\$2,409,315,953	\$1,854,781	\$2,548,801,710	\$30,168,831	\$364,742,517	\$0	\$1,517,723,628	\$0	\$450,523,876	\$5,676,582	\$0	\$0	\$42,758,762	\$523,739	\$2,011,156	\$6,836,827	\$7,503,218,157
2010/2011	\$60,235,796	\$0	\$106,046,871	\$2,648,278,766	\$3,168,069	\$2,823,632,390	\$58,065,964	\$442,429,815	\$0	\$1,799,258,125	\$0	\$446,000,462	\$4,339,539	\$0	\$0	\$40,731,606	\$413,503	\$1,819,413	\$15,232,177	\$8,449,652,496
2011/2012	\$55,795,785	\$139,812	\$185,421,273	\$1,586,775,249	\$28,330,047	\$1,717,850,463	\$98,448,693	\$278,529,660	\$0	\$1,079,386,338	\$0	\$266,483,502	\$967,887	\$0	\$66,978	\$25,636,836	\$261,690	\$1,072,929	\$9,919,881	\$5,335,087,023
2012/2013	\$264,387,897	\$11,408,552	\$13,260,822	\$1,014,858,378	\$7,568,127	\$1,256,096,304	\$76,633,409	\$179,117,975	\$11,397	\$762,719,550	\$0	\$248,611,128	\$2,772,987	\$0	\$1,246,337	\$26,840,670	\$316,420	\$812,644	\$5,052,036	\$3,871,714,635
2013/2014	\$558,715,114	\$21,598,174	\$31,804,645	\$1,741,613,525	\$12,950,135	\$2,153,560,721	\$167,844,235	\$308,853,673	\$25,708	\$1,346,223,419	\$0	\$386,561,718	\$5,670,399	\$0	\$3,523,555	\$43,943,130	\$1,977,705	\$1,373,205	\$13,538,988	\$6,799,778,047
2014/2015	\$681,315,139	\$42,308,549	\$135,573,409	\$1,935,468,356	\$57,078,818	\$2,172,570,169	\$205,555,569	\$333,941,614	\$6,649,774	\$1,464,950,862	\$0	\$323,630,668	\$4,106,697	\$0	\$3,836,582	\$34,281,137	\$1,709,533	\$1,524,551	\$32,766,219	\$7,437,267,646
2015/2016	\$903,496,003	\$66,652,986	\$260,806,674	\$2,902,870,267	\$63,682,708	\$2,672,530,801	\$535,039,154	\$389,540,948	\$15,478,144	\$1,850,033,226	\$0	\$401,718,239	\$5,947,275	\$0	\$7,064,983	\$35,862,368	\$6,179,607	\$1,829,269	\$42,994,253	\$10,161,726,902
2016/2017	\$467,895,589	\$68,709,670	\$244,091,507	\$2,137,545,515	\$72,217,195	\$2,212,974,257	\$667,094,476	\$283,613,426	\$13,927,638	\$1,483,759,630	\$0	\$265,547,984	\$4,034,480	\$0	\$7,057,256	\$32,648,789	\$6,380,604	\$1,144,873	\$26,189,042	\$7,994,831,928
2017/2018	\$511,689,437	\$81,758,057	\$214,757,642	\$2,447,236,561	\$62,426,717	\$2,537,120,329	\$979,308,450	\$346,315,522	\$15,183,161	\$1,692,199,258	\$0	\$279,434,857	\$3,888,126	\$0	\$8,393,952	\$34,319,981	\$8,936,300	\$1,298,232	\$39,405,929	\$9,263,672,509
2018/2019	\$634,336,942	\$87,432,139	\$262,415,658	\$2,620,553,513	\$76,339,006	\$2,964,180,164	\$1,434,073,826	\$414,477,423	\$15,344,022	\$1,970,393,801	\$0	\$342,155,243	\$4,047,493	\$0	\$12,998,289	\$37,115,004	\$9,521,591	\$1,164,910	\$52,670,208	\$10,939,219,232


78 A resource classified as "new/repower/reactivated" is a capacity resource addition since the implementation of RPM and is considered "new/repower/reactivated" for its initial offer and all its subsequent offers in RPM Auctions.

79 The results for the ATSI Integration Auctions are not included in this table.

Table 5-15 RPM revenue by calendar year: 2007 through 2019<sup>80</sup>

Year	Weighted Average RPM Price (\$ per MW-day)	Weighted Average Cleared UCAP (MW)	Effective Days	RPM Revenue
2007	\$89.78	129,409.2	214	\$2,486,310,108
2008	\$111.93	130,223.2	366	\$5,334,880,241
2009	\$142.74	132,772.0	365	\$6,917,391,702
2010	\$164.71	134,033.9	365	\$8,058,113,907
2011	\$135.14	134,105.2	365	\$6,615,032,130
2012	\$89.01	137,684.7	366	\$4,485,656,150
2013	\$99.39	154,044.3	365	\$5,588,442,225
2014	\$122.32	160,668.7	365	\$7,173,539,072
2015	\$146.10	169,112.0	365	\$9,018,343,604
2016	\$137.70	176,748.8	366	\$8,907,551,647
2017	\$134.15	178,468.4	365	\$8,738,754,899
2018	\$164.39	170,763.0	365	\$10,246,047,848
2019	\$179.60	166,875.5	151	\$4,525,540,011


Figure 5-6 History of PJM capacity prices: 1999/2000 through 2018/2019<sup>81</sup>

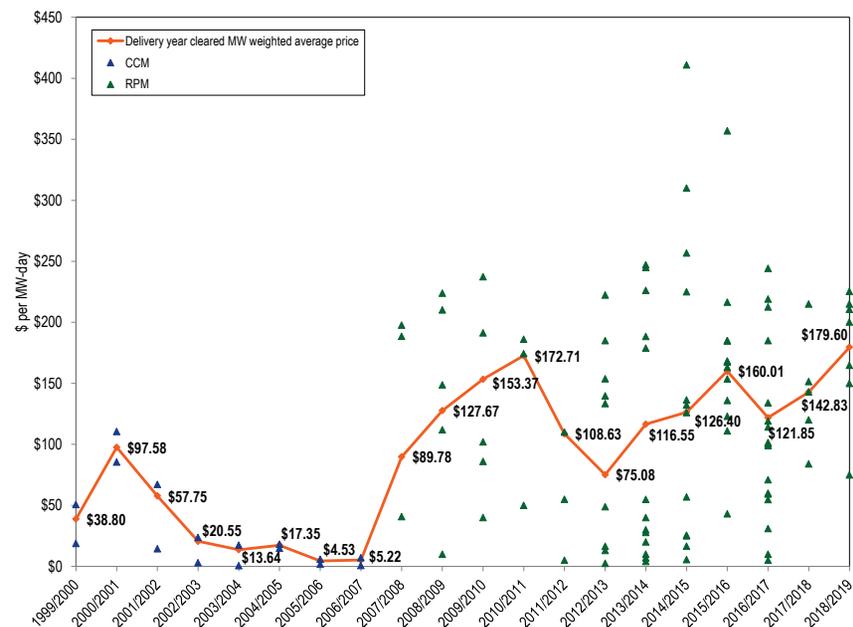

80 The results for the ATSI Integration Auctions are not included in this table.

81 The 1999/2000-2006/2007 capacity prices are CCM combined market, weighted average prices. The 2007/2008-2018/2019 capacity prices are RPM weighted average prices. The CCM data points plotted are cleared MW weighted average prices for the daily and monthly markets by Delivery Year. The RPM data points plotted are RPM resource clearing prices. For the 2014/2015 and subsequent Delivery Years, only the prices for Annual Resources or Capacity Performance Resources are plotted.

Figure 5-7 Map of RPM capacity prices: 2015/2016 through 2018/2019

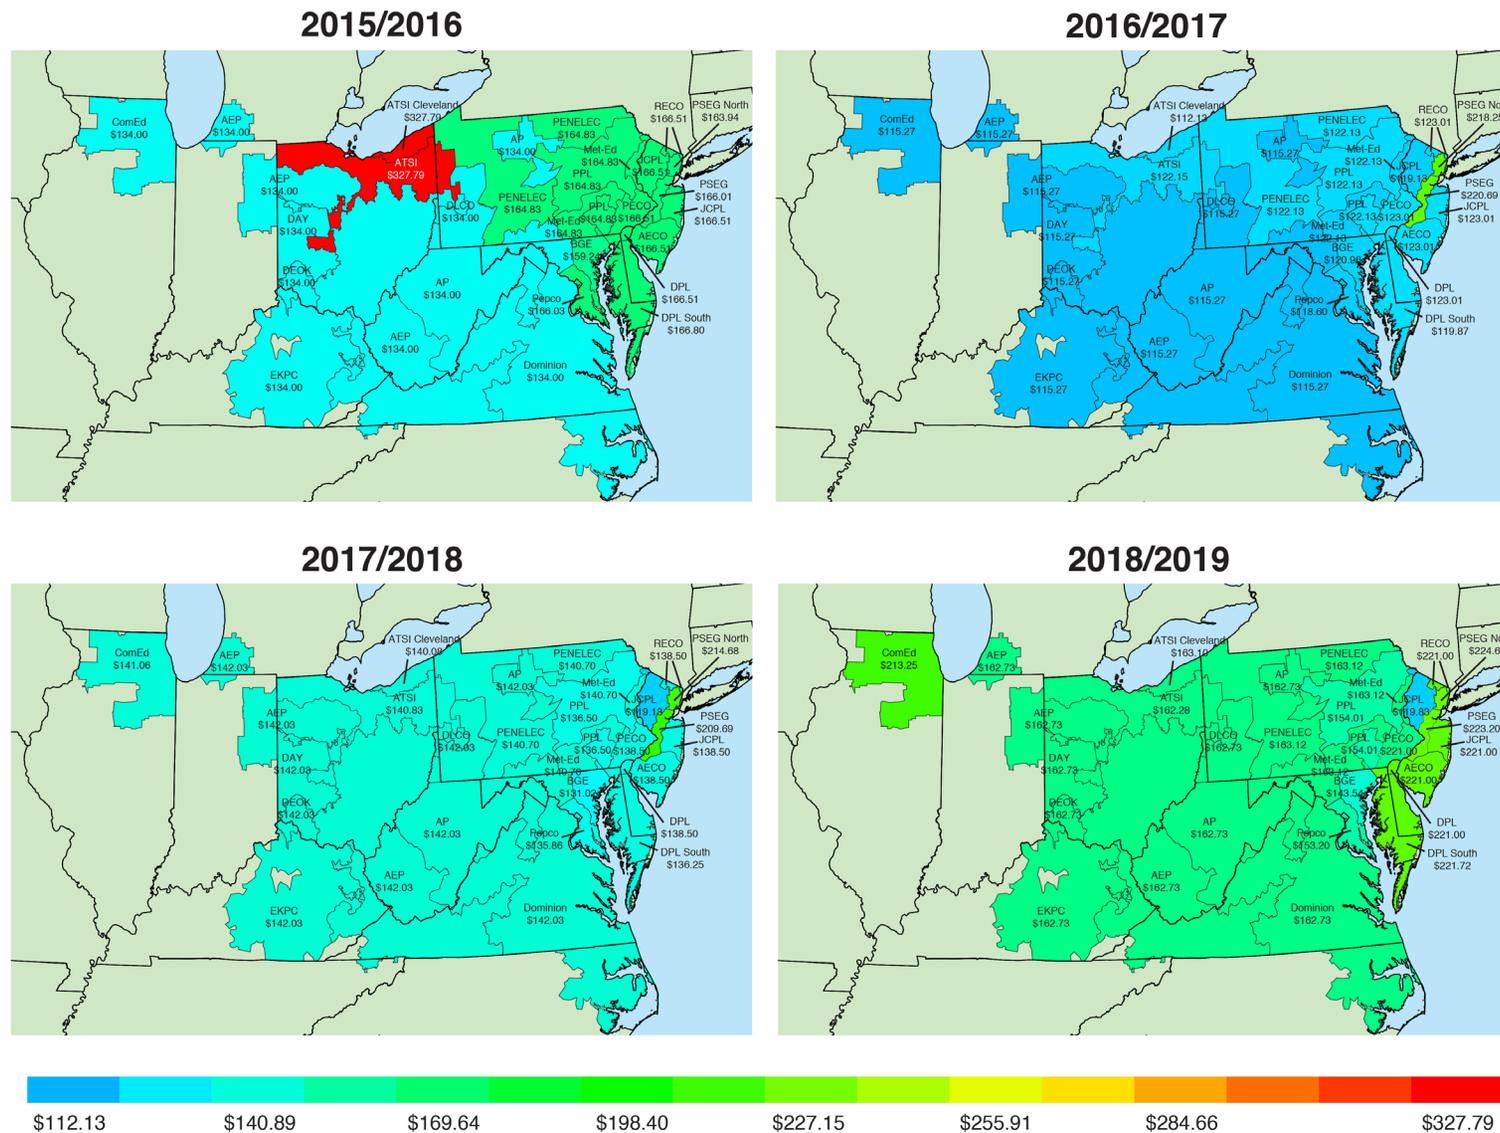

**Table 5-16 RPM cost to load: 2015/2016 through 2018/2019 RPM Auctions<sup>82 83 84</sup>**

	Net Load Price (\$ per MW-day)	UCAP Obligation (MW)	Annual Charges
<b>2015/2016</b>			
Rest of RTO	\$135.81	81,984.4	\$4,075,305,460
Rest of MAAC	\$166.53	53,819.9	\$3,280,332,235
PSEG	\$166.29	11,398.1	\$693,698,017
ATSI	\$293.00	14,631.7	\$1,569,095,567
Total		161,834.1	\$9,618,431,279
<b>2016/2017</b>			
Rest of RTO	\$101.55	81,169.7	\$3,008,733,089
Rest of MAAC	\$163.21	52,594.4	\$3,133,152,551
PSEG	\$224.64	11,042.7	\$905,411,924
ATSI	\$133.17	14,084.2	\$684,586,352
Total		158,891.0	\$7,731,883,915
<b>2017/2018</b>			
Rest of RTO	\$149.02	100,253.4	\$5,452,838,631
Rest of MAAC	\$149.13	46,762.9	\$2,545,461,395
PSEG	\$205.78	11,480.6	\$862,291,793
PPL	\$147.33	8,227.7	\$442,440,748
Total		166,724.5	\$9,303,032,568
<b>2018/2019</b>			
Rest of RTO	\$162.44	81,659.7	\$4,841,777,199
Rest of MAAC	\$215.97	36,256.5	\$2,858,052,995
BGE	\$156.03	7,948.5	\$452,674,129
ComEd	\$208.46	25,454.6	\$1,936,809,587
Pepco	\$154.74	7,315.9	\$413,207,985
PPL	\$152.74	8,201.7	\$457,240,705
Total		166,836.9	\$10,959,762,600

<sup>82</sup> The RPM annual charges are calculated using the rounded, net load prices as posted in the PJM RPM Auction results.

<sup>83</sup> There is no separate obligation for DPL South as the DPL South LDA is completely contained within the DPL Zone. There is no separate obligation for PSEG North as the PSEG North LDA is completely contained within the PSEG Zone.

<sup>84</sup> Prior to the 2009/2010 Delivery Year, the final UCAP obligation is determined after the clearing of the Second Incremental Auction. For the 2009/2010 through 2011/2012 Delivery Years, the final UCAP obligations are determined after the clearing of the Third Incremental Auction. Effective with the 2012/2013 Delivery Year, the final UCAP obligation is determined after the clearing of the final Incremental Auction. Prior to the 2012/2013 Delivery Year, the Final Zonal Capacity Prices are determined after certification of ILR. Effective with the 2012/2013 Delivery Year, the Final Zonal Capacity Prices are determined after the final Incremental Auction. The 2016/2017, 2017/2018, and 2018/2019 Net Load Prices are not finalized. The 2016/2017, 2017/2018, and 2018/2019 obligation MW are not finalized.

## Generator Performance

Generator performance results from the interaction between the physical characteristics of the units and the level of expenditures made to maintain the capability of the units, which in turn is a function of incentives from energy, ancillary services and capacity markets. Generator performance indices include those based on total hours in a period (generator performance factors) and those based on hours when units are needed to operate by the system operator (generator forced outage rates).

## Capacity Factor

Capacity factor measures the actual output of a power plant over a period of time compared to the potential output of the unit had it been running at full nameplate capacity during that period. In the first three months of 2016, nuclear units had a capacity factor of 97.2 percent, compared to 96.3 percent in the first three months of 2015; combined cycle units had a capacity factor of 64.0 percent in the first three months of 2016, compared to a capacity factor of 62.4 percent in the first three months of 2015; and steam units, which are primarily coal fired, had a capacity factor of 41.7 percent in the first three months of 2016, compared to 54.8 percent in the first three months of 2015.

**Table 5-17 PJM capacity factor (By unit type (GWh)): January through March, 2015 and 2016<sup>85</sup>**


Unit Type	2015 (Jan-Mar)		2016 (Jan-Mar)		Change in 2016 from 2015
	Generation (GWh)	Capacity Factor	Generation (GWh)	Capacity Factor	
Battery	1.2	0.4%	4.2	0.6%	0.2%
Combined Cycle	37,894.5	62.4%	45,011.7	64.0%	1.6%
Combustion Turbine	2,007.7	3.1%	2,061.3	3.3%	0.2%
Diesel	146.5	15.7%	130.8	13.5%	(2.2%)
Diesel (Landfill gas)	384.6	47.1%	355.5	43.2%	(3.9%)
Fuel Cell	56.4	87.1%	56.2	85.9%	(1.2%)
Nuclear	70,167.1	96.3%	71,578.3	97.2%	0.9%
Pumped Storage Hydro	1,137.0	9.6%	1,199.8	11.0%	1.5%
Run of River Hydro	1,732.5	29.4%	2,956.0	48.8%	19.4%
Solar	93.1	12.1%	174.4	14.4%	2.3%
Steam	94,614.1	54.8%	65,990.2	41.7%	(13.1%)
Wind	4,876.8	34.2%	5,802.6	38.2%	4.0%
Total	213,111.4	52.4%	195,321.1	48.8%	(3.6%)

<sup>85</sup> The capacity factors in this table are based on nameplate capacity values, and are calculated based on when the units come on line.

## Generator Performance Factors

Generator outages fall into three categories: planned, maintenance, and forced. The MW on outage varies throughout the year. For example, the MW on planned outage are generally highest in the spring and fall, as shown in Figure 5-8, due to restrictions on planned outages during the winter and summer. The effect of the seasonal variation in outages can be seen in the monthly generator performance metrics in Figure 5-12.

Figure 5-8 PJM outages (MW): 2012 through March 2016

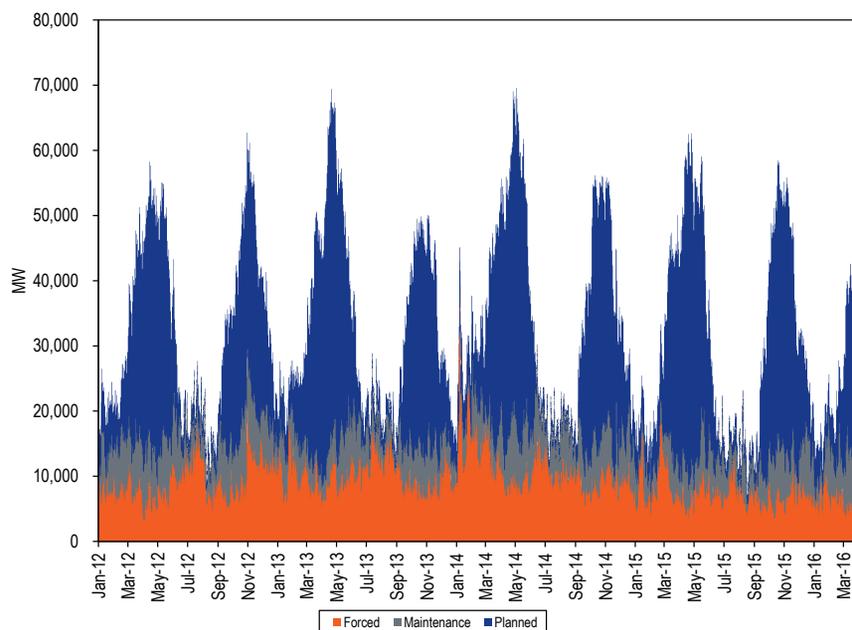

Performance factors include the equivalent availability factor (EAF), the equivalent maintenance outage factor (EMOF), the equivalent planned outage factor (EPOF) and the equivalent forced outage factor (EFOF). These four factors add to 100 percent for any generating unit. The EAF is the proportion of hours in a year when a unit is available to generate at full capacity while the three outage factors include all the hours when a unit is unavailable.

The EMOF is the proportion of hours in a year when a unit is unavailable because of maintenance outages and maintenance deratings. The EPOF is the proportion of hours in a year when a unit is unavailable because of planned outages and planned deratings. The EFOF is the proportion of hours in a year when a unit is unavailable because of forced outages and forced deratings.

The PJM aggregate EAF, EFOF, EPOF, and EMOF are shown in Figure 5-9. Metrics by unit type are shown in Table 5-18 through Table 5-21.

Figure 5-9 PJM equivalent outage and availability factors: January through March, 2007 to 2016

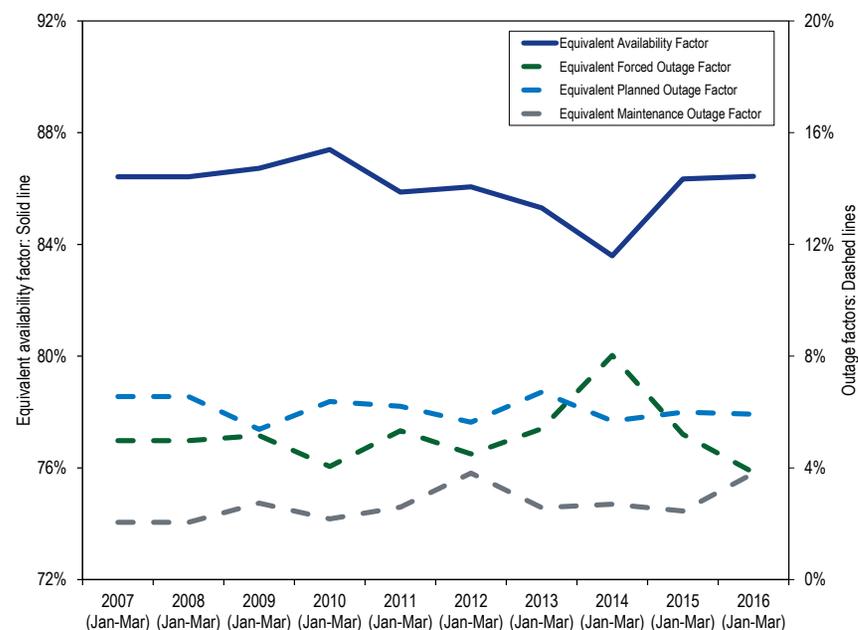


Table 5-18 EAF by unit type: January through March, 2007 through 2016

	2007 (Jan-Mar)	2008 (Jan-Mar)	2009 (Jan-Mar)	2010 (Jan-Mar)	2011 (Jan-Mar)	2012 (Jan-Mar)	2013 (Jan-Mar)	2014 (Jan-Mar)	2015 (Jan-Mar)	2016 (Jan-Mar)
Combined Cycle	90.4%	90.4%	87.5%	90.4%	86.1%	89.9%	82.8%	84.9%	88.1%	91.9%
Combustion Turbine	91.1%	91.1%	93.5%	94.7%	94.5%	95.0%	91.0%	82.7%	91.1%	93.6%
Diesel	88.7%	88.7%	91.5%	94.5%	93.9%	97.3%	95.1%	82.4%	87.9%	91.2%
Hydroelectric	88.8%	88.8%	87.2%	87.7%	88.0%	92.1%	93.7%	84.1%	87.1%	89.1%
Nuclear	92.3%	92.3%	92.0%	92.3%	93.8%	93.3%	95.6%	92.3%	92.9%	92.9%
Steam	81.6%	81.6%	82.4%	82.5%	79.8%	79.0%	79.4%	80.0%	81.3%	78.6%
Total	86.4%	86.4%	86.7%	87.4%	85.9%	86.1%	85.3%	83.6%	86.3%	86.4%

Table 5-19 EMOF by unit type: January through March, 2007 through 2016

	2007 (Jan-Mar)	2008 (Jan-Mar)	2009 (Jan-Mar)	2010 (Jan-Mar)	2011 (Jan-Mar)	2012 (Jan-Mar)	2013 (Jan-Mar)	2014 (Jan-Mar)	2015 (Jan-Mar)	2016 (Jan-Mar)
Combined Cycle	1.7%	1.7%	2.8%	2.5%	2.2%	1.8%	2.9%	1.5%	1.6%	1.4%
Combustion Turbine	2.2%	2.2%	1.8%	1.3%	1.6%	1.3%	0.9%	1.1%	1.1%	1.7%
Diesel	1.2%	1.2%	1.7%	0.7%	3.6%	0.8%	1.1%	2.7%	1.9%	2.5%
Hydroelectric	2.1%	2.1%	1.2%	1.5%	0.9%	1.4%	2.3%	5.6%	1.4%	3.6%
Nuclear	0.8%	0.8%	1.0%	0.4%	0.7%	0.5%	0.3%	0.3%	0.5%	1.3%
Steam	2.6%	2.6%	3.8%	3.1%	3.9%	6.5%	4.0%	4.3%	4.1%	6.6%
Total	2.1%	2.1%	2.7%	2.2%	2.6%	3.8%	2.6%	2.7%	2.5%	3.8%

Table 5-20 EPOF by unit type: January through March, 2007 through 2016

	2007 (Jan-Mar)	2008 (Jan-Mar)	2009 (Jan-Mar)	2010 (Jan-Mar)	2011 (Jan-Mar)	2012 (Jan-Mar)	2013 (Jan-Mar)	2014 (Jan-Mar)	2015 (Jan-Mar)	2016 (Jan-Mar)
Combined Cycle	5.9%	5.9%	6.4%	5.8%	9.0%	6.4%	9.6%	9.7%	7.6%	4.8%
Combustion Turbine	4.0%	4.0%	2.7%	1.8%	2.5%	2.1%	2.7%	2.8%	4.1%	2.6%
Diesel	1.0%	1.0%	0.2%	0.7%	0.0%	0.0%	0.1%	0.0%	0.3%	0.0%
Hydroelectric	7.8%	7.8%	10.0%	10.1%	9.4%	4.8%	3.5%	9.3%	9.7%	5.2%
Nuclear	5.1%	5.1%	3.2%	6.7%	4.0%	5.3%	3.7%	5.8%	5.1%	4.9%
Steam	8.0%	8.0%	6.5%	7.6%	7.3%	6.8%	8.8%	5.3%	6.3%	8.2%
Total	6.6%	6.6%	5.4%	6.4%	6.2%	5.6%	6.7%	5.7%	6.0%	5.9%

Table 5-21 EFOF by unit type: January through March, 2007 through 2016

	2007 (Jan-Mar)	2008 (Jan-Mar)	2009 (Jan-Mar)	2010 (Jan-Mar)	2011 (Jan-Mar)	2012 (Jan-Mar)	2013 (Jan-Mar)	2014 (Jan-Mar)	2015 (Jan-Mar)	2016 (Jan-Mar)
Combined Cycle	2.1%	2.1%	3.3%	1.3%	2.7%	1.9%	4.7%	3.9%	2.7%	1.9%
Combustion Turbine	2.7%	2.7%	2.0%	2.2%	1.4%	1.6%	5.4%	13.4%	3.7%	2.1%
Diesel	9.1%	9.1%	6.6%	4.1%	2.5%	1.9%	3.7%	14.8%	9.9%	6.3%
Hydroelectric	1.3%	1.3%	1.5%	0.7%	1.7%	1.6%	0.5%	1.1%	1.9%	2.1%
Nuclear	1.8%	1.8%	3.8%	0.7%	1.5%	0.9%	0.5%	1.6%	1.4%	0.9%
Steam	7.9%	7.9%	7.3%	6.8%	9.0%	7.6%	7.9%	10.4%	8.4%	6.7%
Total	5.0%	5.0%	5.2%	4.1%	5.3%	4.5%	5.4%	8.0%	5.2%	3.8%


## Generator Forced Outage Rates

There are three primary forced outage rate metrics. The most fundamental forced outage rate metric is EFORd. The other forced outage rate metrics will no longer be used under Capacity Performance market design and either exclude some outages, XEFORd, or exclude some outages and exclude some time periods, EFORp.

The unadjusted forced outage rate of a generating unit is measured as the equivalent demand forced outage rate (EFORd). EFORd is a measure of the probability that a generating unit will fail, either partially or totally, to perform when it is needed to operate. EFORd measures the forced outage rate during periods of demand, and does not include planned or maintenance outages. A period of demand is a period during which a generator is running or needed to run. EFORd calculations use historical performance data, including equivalent forced outage hours, service hours, average forced outage duration, average run time, average time between unit starts, available hours and period hours.<sup>86</sup> The EFORd metric includes all forced outages, regardless of the reason for those outages.

The average PJM EFORd for the first three months of 2016 was 6.0 percent, a decrease from 9.4 percent for the first three months of 2015. Figure 5-10 shows the average EFORd since 1999 for all units in PJM.<sup>87</sup>

Figure 5-10 Trends in the PJM equivalent demand forced outage rate (EFORd): 1999 through 2016

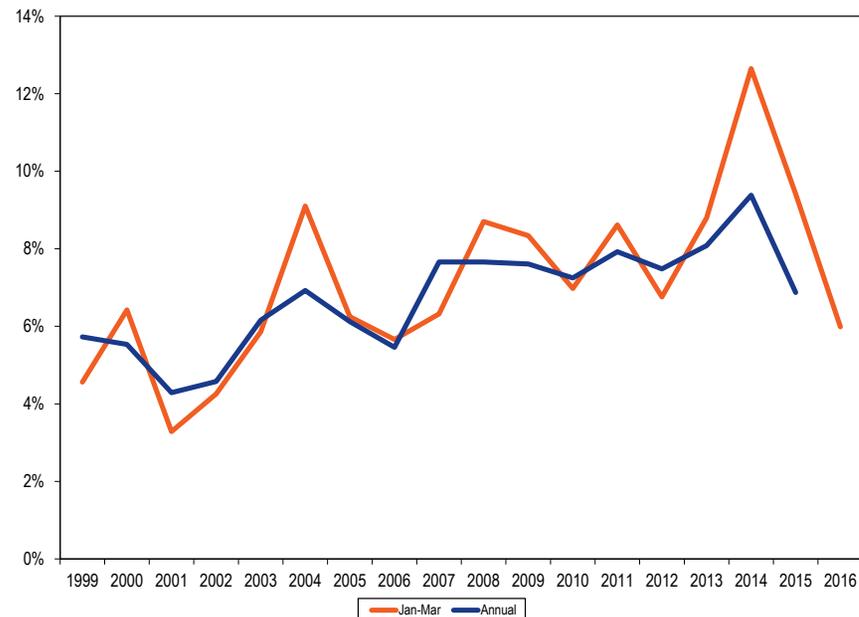

<sup>86</sup> Equivalent forced outage hours are the sum of all forced outage hours in which a generating unit is fully inoperable and all partial forced outage hours in which a generating unit is partially inoperable prorated to represent full hours.


<sup>87</sup> The universe of units in PJM changed as the PJM footprint expanded and as units retired from and entered PJM markets. See the 2015 State of the Market Report for PJM, Appendix A: "PJM Geography" for details.

Table 5-22 shows the class average EFORD by unit type.

**Table 5-22 PJM EFORD data for different unit types: January through March, 2007 through 2016**

	2007 (Jan-Mar)	2008 (Jan-Mar)	2009 (Jan-Mar)	2010 (Jan-Mar)	2011 (Jan-Mar)	2012 (Jan-Mar)	2013 (Jan-Mar)	2014 (Jan-Mar)	2015 (Jan-Mar)	2016 (Jan-Mar)
Combined Cycle	3.7%	3.7%	5.3%	3.5%	3.6%	2.4%	5.3%	6.5%	4.5%	2.6%
Combustion Turbine	11.1%	11.1%	13.9%	13.1%	11.2%	9.3%	19.8%	30.2%	19.7%	8.5%
Diesel	10.3%	10.3%	8.1%	6.2%	5.1%	2.7%	3.8%	15.5%	11.0%	8.0%
Hydroelectric	2.0%	2.0%	2.0%	1.0%	2.2%	2.7%	0.6%	1.5%	2.2%	3.1%
Nuclear	1.9%	1.9%	3.8%	0.7%	1.6%	0.9%	0.5%	1.7%	1.5%	1.0%
Steam	10.1%	10.1%	9.5%	8.6%	12.2%	9.5%	9.9%	13.5%	11.1%	8.8%
Total	7.7%	7.7%	8.3%	7.0%	8.6%	6.8%	8.8%	12.6%	9.4%	6.0%

**Figure 5-11 PJM distribution of EFORD data by unit type: January through March, 2016**

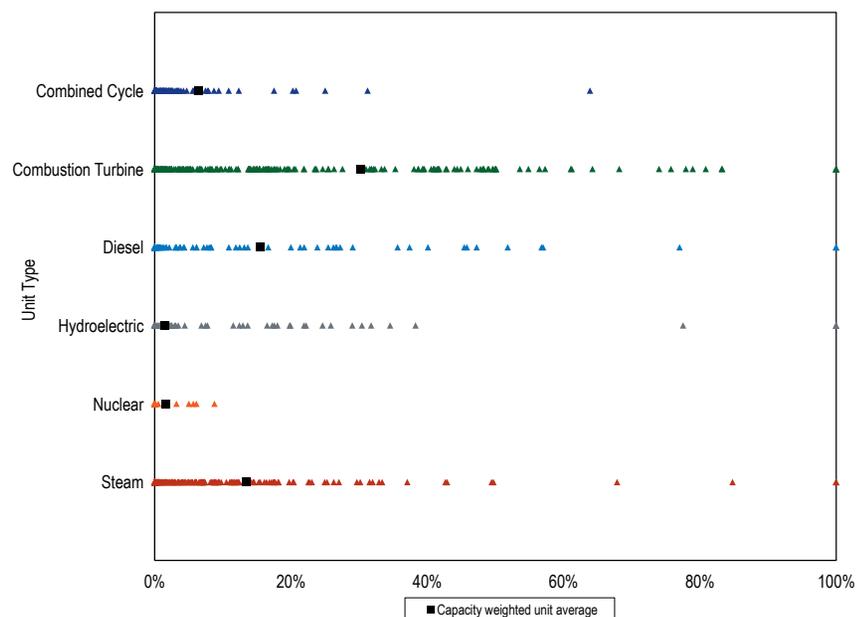

### Distribution of EFORD

The average EFORD results do not show the underlying pattern of EFORD rates within each unit type. The distribution of EFORD by unit type is shown in Figure 5-11. Each generating unit is represented by a single point, and the capacity weighted unit average is represented by a solid square. Diesel units had the greatest variance in EFORD, while nuclear units had the lowest variance in EFORD values in the first three months of 2016.

### Other Forced Outage Rate Metrics

There are a number of performance incentives in the current capacity market design, but they fall short of the incentives that a unit would face if it earned all its revenue in an energy market. These incentives will change when the Capacity Performance market design is implemented beginning with Delivery Year 2018/2019 but remain essential reasons why the incentive components of Capacity Performance design were necessary.

Currently, there are two additional forced outage rate metrics that play a significant role in PJM markets, XEFORD and EFORp. Under the Capacity Performance modifications to RPM, neither XEFORD nor EFORp will be relevant.

The XEFORD metric is the EFORD metric adjusted to remove outages that have been defined to be outside management control (OMC). Under the Capacity

Performance modifications to RPM, all outages will be included in the EFORD metric used to determine the level of unforced capacity for specific units that must be offered in PJM's Capacity Market, including the outages previously designated as OMC. OMC outages will no longer be excluded from the EFORD calculations.

The EFORp metric is the EFORD metric adjusted to remove OMC outages and to reflect unit availability only during the approximately 500 hours defined in the PJM RPM tariff to be the critical load hours. Under the Capacity Performance modifications to RPM, EFORp will no longer be used to calculate performance penalties.

Current PJM capacity market rules use XEFORD to determine the UCAP for generating units. Unforced capacity in the PJM Capacity Market for any individual generating unit is equal to one minus the XEFORD multiplied by the unit ICAP.

The current PJM Capacity Market rules create an incentive to minimize the forced outage rate excluding OMC outages, but not an incentive to minimize the forced outage rate accounting for all forced outages. In fact, because PJM uses XEFORD as the outage metric to define capacity available for sale, the current PJM Capacity Market includes an incentive to classify as many forced outages as possible as OMC. That incentive is removed in the Capacity Performance design.

## Outages Deemed Outside Management Control

OMC outages will continue to be excluded from outage rate calculations through the end of the 2017/2018 delivery year. Under the Capacity Performance modifications to RPM, effective with the 2018/2019 Delivery Year, OMC outages will no longer be excluded from the EFORD metric used to determine the level of unforced capacity for specific units that must be offered in PJM's Capacity Market. All forced outages will be included.<sup>88</sup>

<sup>88</sup> "Reliability Assurance Agreement Among Load Serving Entities in the PJM Region", Schedule 5.B.

In 2006, NERC created specifications for certain types of outages deemed to be Outside Management Control (OMC).<sup>89</sup> For NERC, an outage can be classified as an OMC outage only if the outage meets the requirements outlined in Appendix K of the "Generator Availability Data System Data Reporting Instructions." Appendix K of the "Generator Availability Data Systems Data Reporting Instructions" also lists specific cause codes (codes that are standardized for specific outage causes) that would be considered OMC outages.<sup>90</sup> Not all outages caused by the factors in these specific OMC cause codes are OMC outages. For example, according to the NERC specifications, fuel quality issues (codes 9200 to 9299) may be within the control of the owner or outside management control. Each outage must be considered separately per NERC.

Nothing in NERC's classification of outages requires that PJM exclude OMC outages from the forced outage rate metrics used in the capacity market.<sup>91</sup> That choice was made by PJM and can be modified without violating any NERC requirements.<sup>92</sup> It is possible to have an OMC outage under the NERC definition, which PJM does not define as an OMC outage for purposes of calculating XEFORD. That is the current PJM practice. The actual implementation of the OMC outages and their impact on XEFORD is and has been within the control of PJM. PJM chose to exclude only some of the OMC outages from the XEFORD metric.

<sup>89</sup> Generator Availability Data System Data Reporting Instructions states, "The electric industry in Europe and other parts of the world has made a change to examine losses of generation caused by problems with and outside plant management control... There are a number of outage causes that may prevent the energy coming from a power generating plant from reaching the customer. Some causes are due to the plant operation and equipment while others are outside plant management control. The standard sets a boundary on the generator side of the power station for the determination of equipment outside management control." The Generator Availability Data System Data Reporting Instructions can be found on the NERC website: <[http://www.nerc.com/pa/RAPA/gads/DataReportingInstructions/Appendix\\_K\\_Outside\\_Plant\\_Management\\_Control.pdf](http://www.nerc.com/pa/RAPA/gads/DataReportingInstructions/Appendix_K_Outside_Plant_Management_Control.pdf)>.

<sup>90</sup> For a list of these cause codes, see the Technical Reference for PJM Markets, at "Generator Performance: NERC OMC Outage Cause Codes," <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

<sup>91</sup> For example, the NYISO does not classify any fuel related outages or derates as OMC under its capacity market rules. See New York Independent System Operator, "Manual 4: Installed Capacity Manual," Version 6.20. (January, 24 2012) <[http://www.nyiso.com/public/webdocs/documents/manuals/operations/icap\\_mnl.pdf](http://www.nyiso.com/public/webdocs/documents/manuals/operations/icap_mnl.pdf)>. When a generator, energy/capacity limited resource, system resource, intermittent power resource or control area system resource is forced into an outage by an equipment failure that involves equipment located on the electric network beyond the step-up transformer, and including such step-up transformer, the NYISO shall not treat the outage as a forced outage for purposes of calculating the amount of unforced capacity such installed capacity suppliers are qualified to supply in the NYCA. This exception is limited to an equipment failure that involves equipment located on the electric network beyond the generator step-up transformer, and including such step-up transformer on the output side of the generator, energy/capacity limited resource, system resource, intermittent power resource or control area system resource. This exception does not apply to fuel related outages or derates or other cause codes that might be classified as outside management control in the NERC Data reporting Instructions. NYISO only accepts OMC outages for outages at or beyond the step-up transformer.

<sup>92</sup> It is unclear whether there were member votes taken on this issue prior to PJM's implementation of its approach to OMC outages. It does not appear that PJM has consulted with members for the subsequent changes to its application of OMC outages.

PJM does not have a clear, documented, public set of criteria for designating outages as OMC, although PJM's actual practice appears to be improving.

All outages, including OMC outages, are included in the EFORD that is used for PJM planning studies that determine the reserve requirement. However, OMC outages are excluded from the calculations used to determine the level of unforced capacity for specific units that must be offered in PJM's Capacity Market. This modified EFORD is termed the XEFORD.

Table 5-23 shows OMC forced outages by cause code, as classified by PJM. OMC forced outages accounted for 4.0 percent of all forced outages in the first three months of 2016. The largest contributor to OMC outages, flood, was the cause of 26.3 percent of OMC outages and 1.1 percent of all forced outages.

**Table 5-23 OMC outages: January through March, 2016**

OMC Cause Code	Percent of OMC Forced Outages	Percent of all Forced Outages
Flood	26.3%	1.1%
Transmission system problems other than catastrophes	22.2%	0.9%
Lack of fuel	21.7%	0.9%
Other switchyard equipment	16.8%	0.7%
Transmission line	4.4%	0.2%
Switchyard circuit breakers	2.8%	0.1%
Transmission equipment at the 1st substation	2.5%	0.1%
Transmission equipment beyond the 1st substation	0.7%	0.0%
Lack of water (hydro)	0.5%	0.0%
Lightning	0.5%	0.0%
Other catastrophe	0.4%	0.0%
Regulatory (environmental) proceedings and hearings	0.3%	0.0%
Switchyard transformers and associated cooling systems	0.3%	0.0%
Switchyard system protection devices	0.2%	0.0%
Storms (ice)	0.1%	0.0%
Other miscellaneous external problems	0.1%	0.0%
Other fuel quality problems	0.0%	0.0%
Total	100.0%	4.0%

An outage is an outage, regardless of the cause. It is inappropriate that units on outage do not have to reflect that outage in their outage statistics, which affect their performance incentives and the level of unforced capacity and therefore capacity sold. No outages should be treated as OMC because when a

unit is not available it is not available, regardless of the reason, and the data and payments to units should reflect that fact.<sup>93</sup>

Lack of fuel is an example of why, even if the OMC concept were accepted, many types of OMC outages are not actually outside the control of management. Virtually any issue with fuel supply can be addressed by additional expenditures. These are economic issues within the control of management and the resultant tradeoffs should be reflected in actual forced outage rates rather than ignored by designation as OMC. It is significant that some OMC outages are classified as economic. Firm gas contracts, including contracts with intermediaries, could be used in place of interruptible gas contracts. Alternative fuels could be used as a supplement to primary fuels. Improved fuel management practices including additional investment could eliminate wet coal as a reason. Better diversification in supplies could eliminate interruptions from individual suppliers. But regardless of the reason, an outage is an outage.

If a particular unit or set of units have outages for one of the OMC reasons, that is a real feature of the units that should be reflected in overall PJM system planning as well as in the economic fundamentals of the capacity market and the capacity market outcomes. Permitting OMC outages to be excluded from the forced outage metric skews the results of the capacity market towards less reliable units and away from more reliable units. This is exactly the wrong incentive. Paying for capacity from units using the EFORD, not the XEFORD, metric would provide a market incentive for unit owners to address all their outage issues in an efficient manner. Pretending that some outages simply do not exist distorts market outcomes. That is exactly the result of using OMC outages to reduce EFORD.

The MMU recommends that PJM eliminate all OMC outages from the calculation of forced outage rates used for any purpose in the PJM Capacity Market after appropriate notice. OMC outages should not be reflected in forced outage metrics which affect market payments to generating units. OMC outages will be eliminated under the Capacity Performance rules.

<sup>93</sup> For more on this issue, see the MMU's White Paper included in: Monitoring Analytics, LLC and PJM Interconnection, LLC, "Capacity in the PJM Market," <[http://www.monitoringanalytics.com/reports/Reports/2012/JMM\\_And\\_PJM\\_Capacity\\_White\\_Papers\\_On\\_OPSL\\_Issues\\_20120820.pdf](http://www.monitoringanalytics.com/reports/Reports/2012/JMM_And_PJM_Capacity_White_Papers_On_OPSL_Issues_20120820.pdf)> (August 20, 2012).

## Performance Incentives

There are a number of performance incentives in the current capacity market design, but they fall short of the incentives that a unit would face if it earned all its revenue in an energy market. These incentives will change when the Capacity Performance market design is implemented beginning with Delivery Year 2018/2019 but remain essential reasons why the incentive components of Capacity Performance design are necessary.

The most basic incentive is that associated with the reduction of payments for a failure to perform. In any market, sellers are not paid when they do not provide a product. That is only partly true in the PJM Capacity Market. Under the current RPM design, in place in 2015, in addition to the exclusion of OMC outages, which reduces forced outage rates resulting in payments to capacity resources not consistent with actual forced outage rates, other performance incentives were not designed to ensure that capacity resources are paid when they perform and not paid when they do not perform.

Until the Capacity Performance market design is fully implemented for the 2020/2021 Delivery Year, EFORp will continue be used in the calculation of non-performance charges for units that are not Capacity Performance capacity resources.

In concept, units do not receive RPM revenues to the extent that they do not perform during defined peak hours, but there are significant limitations on this incentive in the current rules.

The maximum level of RPM revenues at risk are based on the difference between a unit's actual Peak Period Capacity Available (PCAP) and the unit's expected Target Unforced Capacity (TCAP). PCAP is based on EFORp while TCAP is based on XEFORD-5. PCAP is the resource position, while TCAP is the resource commitment. In other words, if the forced outage rate during the peak hours (EFORp) is greater than the forced outage rate calculated over a five year period (XEFORD-5), the unit owner may have a capacity shortfall of up to 50 percent of the unit's capacity commitment in the first year.

$$(\text{PCAP}) \text{ Peak Period Capacity} = \text{ICAP} * (1 - \text{EFORp})$$

$$(\text{TCAP}) \text{ Target Unforced Capacity} = \text{ICAP} * (1 - \text{XEFORD-5})$$

$$\text{Peak Period Capacity Shortfall} = \text{TCAP} - \text{PCAP}$$

The peak-hour period availability charge is equal to the seller's weighted average resource clearing price for the delivery year for the LDA.<sup>94</sup>

The peak hour availability charge understates the appropriate revenues at risk for underperformance because it is based on EFORp and because it is compared to a five year XEFORD. Both outage measures exclude OMC outages. The use of a five year average XEFORD measure is questionable as the measure of expected performance during the delivery year because it covers a period which is so long that it is unlikely to be representative of the current outage performance of the unit. The UCAP sold during a delivery year is a function of ICAP and the final Effective EFORd, which is defined to be the XEFORD calculated for the 12 months ending in September in the year prior to the delivery year.<sup>95</sup>

This maximum level of RPM revenues at risk is reduced by several additional factors including the ability to net any shortfalls against over performance across all units owned by the same participant within an LDA and the ability to use performance by resources that were offered into RPM but did not clear as an offset.<sup>96</sup>

Excess available capacity (EAC) may also be used to offset peak hour availability shortfalls. EAC is capacity which was offered into RPM Auctions, did not clear but was offered into all PJM markets consistent with the obligations of a capacity resource. EAC must be part of a participant's total portfolio, but does not have to be in the same LDA as the shortfall being offset, unlike the netting provision.<sup>97</sup>

<sup>94</sup> PJM. OATT Attachment DD § 10 (j).

<sup>95</sup> PJM. "Manual 18: PJM Capacity Market," Revision 30 (December 17, 2015), Section 4.2.5

<sup>96</sup> PJM. "Manual 18: PJM Capacity Market," Revision 30 (December 17, 2015), Section 8.4.5.

<sup>97</sup> PJM. "Manual 18: PJM Capacity Market," Revision 30 (December 17, 2015), Section 8.4.5.1.

There is a separate exception to the performance related incentives related to lack of gas during the winter period. Single-fuel, natural gas-fired units do not face the peak-hour period availability charge during the winter if the capacity shortfall was due to nonavailability of gas to supply the unit.<sup>98</sup> The result is an exception, analogous to the lack of fuel exception, except much broader, which appears to have no logical basis.

There is a separate exception to the performance related incentives related to a unit that runs less than 50 hours during the RPM peak period. If a unit runs for less than 50 peak period service hours, then the EFORp used in the calculation of the peak hour availability charges is based on PCAP calculated using the lower of the delivery year XEFORd or the EFORp.<sup>99</sup>

There is a separate exception for wind and solar capacity resources which are exempt from this performance incentive.<sup>100</sup>

The peak hour availability charge does not apply if the unit unavailability resulted in another performance related charge or penalty.<sup>101</sup>

Under the peak hour availability charge, the maximum exposure to loss of capacity market revenues is 50 percent in the first year of higher than 50 percent EFORp. That percent increases to 75 percent in year two of sub 50 percent performance and to 100 percent in year three, but returns to a maximum of 50 percent after three years of better performance.

This limitation on maximum exposure is in addition to limitations that result from the way in which PJM applies the OMC rules in the calculation of EFORp and XEFORd, is in addition to the exclusion for gas availability in the winter, which is over and above the OMC exclusion, and is in addition to the case where a unit has less than 50 service hours in a delivery year and can use the lower of the delivery year XEFORd or EFORp.

<sup>98</sup> PJM. OATT Attachment DD § 7.10 (e).

<sup>99</sup> *Id.*

<sup>100</sup> *Id.*

<sup>101</sup> *Id.*

Not all unit types are subject to RPM performance incentives. In addition to the exceptions which apply to conventional generation as a result of EFORp and XEFORd calculations, wind, solar and hydro generation capacity resources are exempt from key performance incentives. Wind and solar generation capacity resources are not subject to peak hour availability incentives, to summer or winter capability testing or to peak season maintenance compliance rules. Hydro generation capacity resources are not subject to peak season maintenance compliance rules.<sup>102</sup>

## Forced Outage Analysis

The MMU analyzed the causes of forced outages for the entire PJM system. The metric used was lost generation, which is the product of the duration of the outage and the size of the outage reduction. Lost generation can be converted into lost system equivalent availability.<sup>103</sup> On a systemwide basis, the resultant lost equivalent availability from the forced outages is equal to the equivalent forced outage factor (EFOF).<sup>104</sup>

PJM EFOF was 3.8 percent in the first three months of 2016. This means there was 3.8 percent lost availability because of forced outages. Table 5-24 shows that forced outages for boiler tube leaks, at 21.3 percent of the systemwide EFOF, were the largest single contributor to EFOF.

<sup>102</sup> PJM. "Manual 18: PJM Capacity Market," Revision 30 (December 17, 2015)

<sup>103</sup> For any unit, lost generation can be converted to lost equivalent availability by dividing lost generation by the product of the generating units' capacity and period hours. This can also be done on a systemwide basis.

<sup>104</sup> EFOF incorporates all outages regardless of their designation as OMC.

**Table 5-24 Contribution to EFOF by unit type by cause: January through March, 2016**

	Combined		Combustion					System
	Cycle	Turbine	Diesel	Hydroelectric	Nuclear	Steam		
Boiler Tube Leaks	3.7%	0.0%	0.0%	0.0%	0.0%	27.8%	21.3%	
Miscellaneous (Balance of Plant)	0.2%	2.2%	0.0%	12.2%	0.0%	11.6%	9.3%	
Miscellaneous (Generator)	1.7%	3.2%	10.0%	7.5%	6.7%	8.1%	7.0%	
Feedwater System	1.2%	0.0%	0.0%	0.0%	0.0%	7.4%	5.7%	
Boiler Air and Gas Systems	0.1%	0.0%	0.0%	0.0%	0.0%	7.0%	5.3%	
Economic	1.5%	35.5%	3.8%	4.5%	0.0%	1.3%	4.3%	
Boiler Fuel Supply from Bunkers to Boiler	0.2%	0.0%	0.0%	0.0%	0.0%	4.5%	3.4%	
Valves	7.0%	0.0%	0.0%	0.0%	0.0%	3.1%	3.0%	
Electrical	0.7%	12.0%	3.6%	0.6%	0.0%	2.1%	2.7%	
Reactor Coolant System	0.0%	0.0%	0.0%	0.0%	61.2%	0.0%	2.7%	
Reserve Shutdown	2.0%	5.5%	8.4%	21.0%	0.0%	1.8%	2.5%	
Wet Scrubbers	0.0%	0.0%	0.0%	0.0%	0.0%	3.3%	2.5%	
Exciter	22.3%	0.8%	0.0%	0.0%	0.0%	0.6%	2.4%	
Auxiliary Systems	4.5%	6.4%	0.0%	2.1%	0.0%	1.9%	2.4%	
Fuel Quality	0.0%	0.0%	4.3%	0.0%	0.0%	2.5%	1.9%	
Controls	1.9%	0.7%	0.9%	0.9%	23.2%	0.5%	1.7%	
Condensate System	0.7%	0.0%	0.0%	0.0%	0.1%	1.9%	1.5%	
Condensing System	0.1%	0.0%	0.0%	0.0%	0.0%	1.9%	1.4%	
Boiler Piping System	2.2%	0.0%	0.0%	0.0%	0.0%	1.6%	1.4%	
All Other Causes	49.9%	33.6%	69.0%	51.1%	8.8%	11.2%	17.5%	
Total	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	

Table 5-25 shows the categories which are included in the economic category.<sup>105</sup> Lack of fuel that is considered outside management control accounted for 20.5 percent of all economic reasons.

OMC lack of fuel is described as “Lack of fuel where the operator is not in control of contracts, supply lines, or delivery of fuels.”<sup>106</sup> Only a handful of units use other economic problems to describe outages. Other economic problems are not defined by NERC GADS and are best described as economic problems that cannot be classified by the other NERC GADS economic problem cause codes. Lack of water events occur when a hydroelectric plant does not have sufficient fuel (water) to operate.

<sup>105</sup> The definitions of these outages are defined by NERC GADS.

<sup>106</sup> The definitions of these outages are defined by NERC GADS.

**Table 5-25 Contributions to Economic Outages: January through March, 2016**

Contribution to Economic Reasons	
Lack of fuel (Non-OMC)	73.1%
Lack of fuel (OMC)	20.5%
Fuel conservation	3.4%
Other economic problems	2.0%
Lack of water (hydro)	0.5%
Wet fuel (biomass)	0.5%
Ground water or other water supply problems	0.0%
Problems with primary fuel for units with secondary fuel operation	0.0%
Total	100.0%

## EFORd, XEFORd and EFORp

The equivalent forced outage rate during peak hours (EFORp) is a measure of the probability that a generating unit will fail, either partially or totally, to perform when it is needed to operate during the peak hours of the day in the peak months of January, February, June, July and August. EFORp is calculated using historical performance data and is designed to measure if a unit would have run had the unit not been forced out. Like XEFORd, EFORp excludes OMC outages. PJM systemwide EFORp is a capacity-weighted average of individual unit EFORp.

Until the Capacity Performance market design is fully implemented for the 2020/2021 Delivery Year, EFORp will be used in the calculation of non-performance charges for units that are not Capacity Performance capacity resources. Under Capacity Performance, EFORp will not be used.

EFORd, XEFORd and EFORp are designed to measure the rate of forced outages, which are defined as outages that cannot be postponed beyond the end of the next weekend.<sup>107</sup> It is reasonable to expect that units have some degree of control over when to take a forced outage, depending on the underlying cause of the forced outage. If units had no control over the timing of forced outages, outages during peak hours of the peak months would be expected to occur at roughly the same rate as outages during periods of demand throughout the rest of the year. With the exception of combustion turbines and nuclear units,

<sup>107</sup> See PJM, “Manual 22: Generator Resource Performance Indices,” Revision 16 (November 16, 2011), Definitions.

EFORp is lower than XEFORd, suggesting that units elect to take non-OMC forced outages during off-peak hours, as much as it is within their ability to do so. That is consistent with the incentives created by the PJM Capacity Market but it does not directly address the question of the incentive effect of omitting OMC outages from the EFORP metric.

Table 5-26 shows the capacity-weighted class average of EFORd, XEFORd and EFORp. The impact of OMC outages is especially noticeable in the difference between EFORd and XEFORd for combustion turbine units.


**Table 5-26 PJM EFORd, XEFORd and EFORp data by unit type: January through March, 2016<sup>108</sup>**

				Difference	Difference
	EFORd	XEFORd	EFORp	EFORd and XEFORd	EFORd and EFORp
Combined Cycle	2.6%	2.4%	1.6%	0.2%	1.0%
Combustion Turbine	8.5%	8.0%	2.9%	0.5%	5.6%
Diesel	8.0%	7.5%	4.1%	0.5%	3.9%
Hydroelectric	3.1%	2.3%	2.8%	0.8%	0.3%
Nuclear	1.0%	1.0%	1.2%	0.0%	(0.2%)
Steam	8.8%	8.4%	5.8%	0.4%	3.0%
Total	6.0%	5.7%	3.6%	0.3%	2.3%

## Performance By Month

On a monthly basis, EFORp values were significantly less than EFORd and XEFORd values as shown in Figure 5-12, demonstrating that units had fewer non-OMC outages during peak hours than would have been expected based on EFORd.


**Figure 5-12 PJM EFORd, XEFORd and EFORp: January through March, 2016**

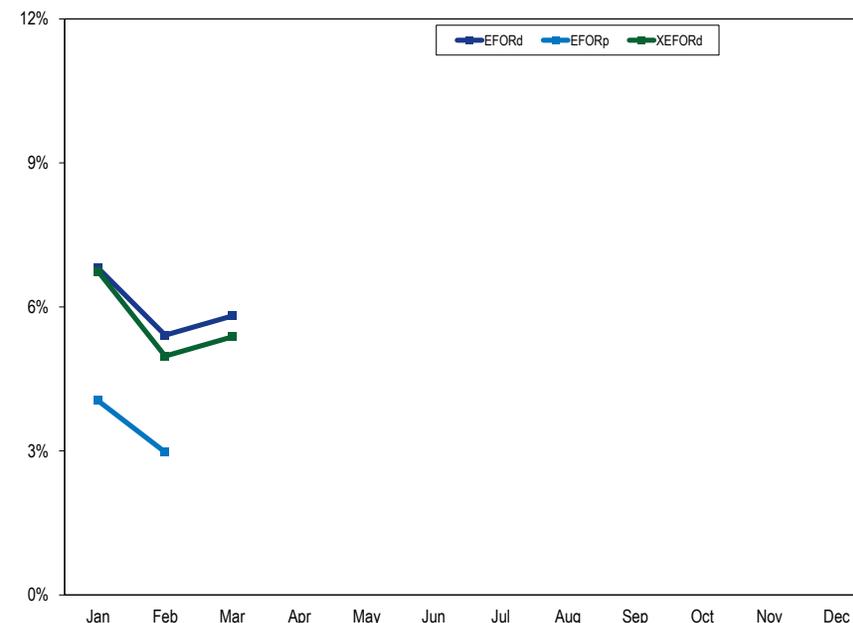

<sup>108</sup> EFORp is only calculated for the peak months of January, February, June, July and August.

On a monthly basis, unit availability as measured by the equivalent availability factor is shown in Figure 5-13.

**Figure 5-13 PJM monthly generator performance factors: January through March, 2016**

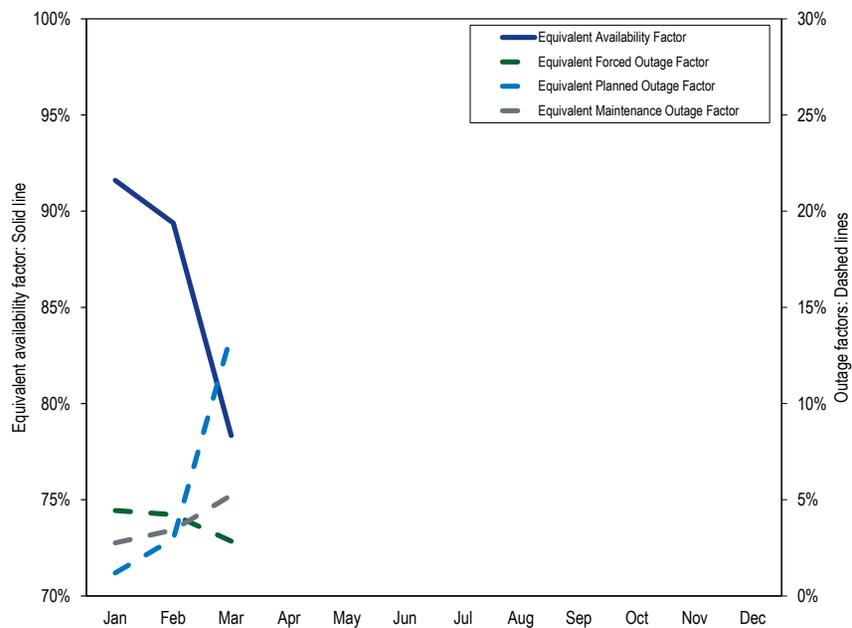



## Demand Response

Markets require both a supply side and a demand side to function effectively. The demand side of wholesale electricity markets is underdeveloped. Wholesale power markets will be more efficient when the demand side of the electricity market becomes fully functional without depending on special programs as a proxy for full participation.

### Overview

- **Demand Response Jurisdiction.** In a panel decision issued May 23, 2014, the U.S. Court of Appeals for the District of Columbia Circuit vacated Order No. 745, which provided for payment of demand-side resources at full LMP.<sup>1</sup> The court found that the FERC lacked jurisdiction to issue Order No. 745 because the “rule entails direct regulation of the retail market - a matter exclusively within state control.”<sup>2</sup> On January 25, 2016, the Supreme Court voted 6-2 to reverse the decision of the lower court.<sup>3</sup> The result is that FERC retains jurisdiction over demand-side programs.
- **Demand Response Activity.** Demand response includes the economic program and the emergency program. The economic program includes the response to energy prices in the energy market. The emergency and pre-emergency program is the capacity market program which includes both capacity payments and associated energy revenues when the capacity is called on to respond.<sup>4</sup> The emergency program accounted for 99.1 percent of all revenue received by demand response providers, the economic program for 0.5 percent and synchronized reserve for 0.3 percent. In the first three months of 2016, total emergency revenue increased by \$55.7 million, or 33.0 percent, from \$168.9 million in the first three months of 2015 to \$224.6 million in the first three months of 2016. Capacity market revenue increased by \$55.7 million, or 33.0 percent, from \$168.9 million in the first three months of 2015 to \$224.6 million the first three

months of 2016.<sup>5</sup> Economic program revenue decreased by \$3.0 million, from \$4.2 million in the first three months of 2015 to \$1.2 million in the first three months of 2016, a 71.3 percent decrease.<sup>6</sup> Synchronized reserve revenue decreased by \$0.9 million, a 55.5 percent decrease. Total demand response revenue in the first three months of 2016 increased by 29.7 percent from \$174.8 million the first three months of 2015 to \$226.6 million in the first three months of 2016. Not all DR activities in the first three months 2016 have been reported to PJM at the time of this report.

All demand response energy payments are uplift. LMP does not cover demand response energy payments although emergency demand response can and does set LMP. Emergency demand response energy costs are paid by PJM market participants in proportion to their net purchases in the real-time market. Economic demand response energy costs are paid by real-time exports from the PJM Region and real-time loads in each zone for which the load-weighted average real-time LMP for the hour during which the reduction occurred is greater than the single system price determined under the net benefits test for that month.<sup>7</sup>

- **Demand Response Market Concentration.** The ownership of economic demand response was highly concentrated in the first three months of 2015 and 2016. The HHI for economic demand response reductions increased from 7623 in the first three months of 2015 to 8055 in 2016. The ownership of emergency demand response was moderately concentrated in 2015. The HHI for emergency demand response registrations was 1760 for the 2014/2015 Delivery Year and 1497 for the 2015/2016 Delivery Year. In the first three months of 2016, the four largest companies contributed 65.3 percent of all registered emergency demand response resources.
- **Locational Dispatch of Demand Resources.** Beginning with the 2014/2015 Delivery Year, demand resources are dispatchable for mandatory reduction on a subzonal basis, defined by zip codes, only if the subzone is defined at least one day before it is dispatched. More locational dispatch of demand resources in a nodal market improves market efficiency. The goal should

<sup>1</sup> Electric Power Supply Association v. FERC, No. 11-1486, *petition for en banc review denied*; see *Demand Response Compensation in Organized Wholesale Energy Markets*, Order No. 745, FERC Stats. & Regs. ¶ 31,322 (2011); *order on reh'g*, Order No. 745-A, 137 FERC ¶ 61,215 (2011); *order on reh'g*, Order No. 745-B, 138 FERC 61,148 (2012).

<sup>2</sup> *Id.*

<sup>3</sup> FERC v. Electric Power Supply Association, Slip Op. No. 14-840.

<sup>4</sup> Throughout this document, emergency demand response refers to both emergency and pre-emergency demand response.

<sup>5</sup> The total credits and MWh numbers for demand resources were calculated as of April 18, 2016 and may change as a result of continued PJM billing updates.

<sup>6</sup> Economic credits are synonymous with revenue received for reductions under the economic load response program.

<sup>7</sup> PJM: “Manual 28: Operating Agreement Accounting,” Revision 64 (April 11, 2014), p. 70.

be nodal dispatch of demand resources with no advance notice required as is the case for generation resources.

## Recommendations

The MMU recognizes that PJM has incorporated some of these recommendations in the Capacity Performance filing. The status of each recommendation reflects the status at March 31, 2016.

- The MMU recommends, as a preferred alternative to having PJM demand side programs, that demand response be on the demand side of the markets and that customers be able to avoid capacity and energy charges by not using capacity and energy at their discretion and that customer payments be determined only by metered load. (Priority: High. First reported 2014. Status: Not adopted.)
- The MMU recommends that there be only one demand response product, with an obligation to respond when called for all hours of the year, and that the demand response be on the demand side of the capacity market. (Priority: High. First reported 2011. Status: Partially Adopted.<sup>8</sup>)
- The MMU recommends that the option to specify a minimum dispatch price under the Emergency and Pre-Emergency Program Full option be eliminated and that participating resources receive the hourly real-time LMP less any generation component of their retail rate. (Priority: Medium. First reported 2010. Status: Not adopted.)
- The MMU recommends that the emergency load response program be classified as an economic program, responding to economic price signals and not an emergency program responding only after an emergency is called and not triggering the definition of a PJM emergency. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends that the Emergency Program Energy Only option be eliminated because the opportunity to receive the appropriate energy market incentive is already provided in the Economic Program. (Priority: Low. First reported 2010. Status: Not adopted.)
- The MMU recommends that a daily energy market must offer requirement apply to demand resources, comparable to the rule applicable to generation capacity resources.<sup>9</sup> (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that the lead times for demand resources be shortened to 30 minutes with an hour minimum dispatch for all resources. (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends that demand resources be required to provide their nodal location, comparable to generation resources. (Priority: High. First reported 2011. Status: Not adopted.)
- The MMU recommends that PJM require nodal dispatch of demand resources with no advance notice required or, if nodal location is not required, subzonal dispatch of demand resources with no advance notice required. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM eliminate the measurement of compliance across zones within a compliance aggregation area (CAA). The multiple zone approach is less locational than the zonal and subzonal approach and creates larger mismatches between the locational need for the resources and the actual response. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends capping the baseline for measuring compliance under GLD, for the limited summer product, at the customers' PLC. (Priority: High. First reported 2010. Status: Adopted.)
- The MMU recommends capping the baseline for measuring capacity compliance under winter compliance at the customers' PLC, similar to GLD, to avoid double counting. (Priority: High. First reported 2010. Status: Partially adopted.)
- The MMU recommends that measurement and verification methods for demand resources be modified to reflect compliance more accurately. (Priority: Medium. First reported 2009. Status: Not adopted.)

<sup>8</sup> PJM's Capacity Performance proposal includes this change. See "Reforms to the Reliability Pricing Market ("RPM") and Related Rules in the PJM Open Access Transmission Tariff ("Tariff") and Reliability Assurance Agreement Among Load Serving Entities ("RAA)," Docket No. ER15-632-000 and "PJM Interconnection, L.L.C." Docket No. EL15-29-000.

<sup>9</sup> See "Complaint and Motion to Consolidate of the Independent Market Monitor for PJM," Docket No. EL14-20-000 (January 27, 2014) at 1.

- The MMU recommends that compliance rules be revised to include submittal of all necessary hourly load data, and that negative values be included when calculating event compliance across hours and registrations. (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM adopt the ISO-NE five-minute metering requirements in order to ensure that dispatchers have the necessary information for reliability and that market payments to demand resources be calculated based on interval meter data at the site of the demand reductions.<sup>10</sup> (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that demand response event compliance be calculated for each hour and the penalty structure reflect hourly compliance for the base and capacity performance products. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that demand resources whose load drop method is designated as “Other” explicitly record the method of load drop. (Priority: Low. First reported 2013. Status: Adopted, Q2, 2014.)
- The MMU recommends that load management testing be initiated by PJM with limited warning to CSPs in order to more accurately represent the conditions of an emergency event. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that shutdown cost be defined as the cost to curtail load for a given period that does not vary with the measured reduction or, for behind the meter generators, be the start cost defined in Manual 15 for generators. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that the Net Benefits Test be eliminated and that demand response resources be paid LMP less any generation component of the applicable retail rate. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that the tariff rules for demand response clarify that a resource and its CSP, if any, must notify PJM of material changes

affecting the capability of the resource to perform as registered and to terminate registrations that are no longer capable of responding to PJM dispatch directives because load has been reduced or eliminated, such as in the case of bankrupt and/or out of service facilities. (Priority: Medium. First reported 2015. Status: Not adopted.)

## Conclusion

A fully functional demand side of the electricity market means that end use customers or their designated intermediaries will have the ability to see real-time energy price signals in real time, will have the ability to react to real-time prices in real time and will have the ability to receive the direct benefits or costs of changes in real-time energy use. In addition, customers or their designated intermediaries will have the ability to see current capacity prices, will have the ability to react to capacity prices and will have the ability to receive the direct benefits or costs of changes in the demand for capacity in the same year in which demand for capacity changes. A functional demand side of these markets means that customers will have the ability to make decisions about levels of power consumption based both on the value of the uses of the power and on the actual cost of that power.

In the energy market, if there is to be a demand side program, demand resources should be paid the value of energy, which is LMP less any generation component of the applicable retail rate. There is no reason to have the net benefits test. The necessity for the net benefits test is an illustration of the illogical approach to demand side compensation embodied in paying full LMP to demand resources. The benefit of demand side resources is not that they suppress market prices, but that customers can choose not to consume at the current price of power, that individual customers benefit from their choices and that the choices of all customers are reflected in market prices. If customers face the market price, customers should have the ability to not purchase power and the market impact of that choice does not require a test for appropriateness.

If demand resources are to continue competing directly with generation capacity resources in the PJM Capacity Market, the product must be defined

<sup>10</sup> See ISO-NE Tariff, Section III, Market Rule 1, Appendix E1 and Appendix E2, “Demand Response,” <[http://www.iso-ne.com/regulatory/tariffsect\\_3/mr1\\_append-e.pdf](http://www.iso-ne.com/regulatory/tariffsect_3/mr1_append-e.pdf)>. (Accessed February 17, 2015) ISO-NE requires that DR have an interval meter with five minute data reported to the ISO and each behind the meter generator is required to have a separate interval meter. After June 1, 2017, demand response resources in ISO-NE must also be registered at a single node.

such that it can actually serve as a substitute for generation. This is a prerequisite to a functional market design.

In order to be a substitute for generation, demand resources should be defined in PJM rules as an economic resource, as generation is defined. Demand resources should be required to offer in the Day-Ahead Energy Market and should be called when the resources are required and prior to the declaration of an emergency. Demand resources should be available for every hour of the year and not be limited to a small number of hours.

In order to be a substitute for generation, demand resources should be subject to robust measurement and verification techniques to ensure that transitional DR programs incent the desired behavior. The methods used in PJM programs today are not adequate to determine and quantify deliberate actions taken to reduce consumption.

In order to be a substitute for generation, demand resources should provide a nodal location and should be dispatched nodally to enhance the effectiveness of demand resources and to permit the efficient functioning of the energy market. Both subzonal and multi-zone compliance should be eliminated because they are inconsistent with an efficient nodal market.

In order to be a substitute for generation, compliance by demand resources to PJM dispatch instructions should include both increases and decreases in load. The current method applied by PJM simply ignores increases in load and thus artificially overstates compliance.

In order to be a substitute for generation, reductions should be calculated hourly for dispatched DR. The current rules use the average reduction for the duration of an event. The average reduction across multiple hours does not provide an accurate metric for each hour of the event and is inconsistent with the measurement of generation resources. Measuring compliance hourly would provide accurate information to the PJM system. Under the new CP rules, the performance of demand response during Performance Assessment Hours will

be measured on an hourly basis. Overall demand response compliance is still measured by performance across the entire event.<sup>11</sup>

In order to be a substitute for generation, any demand resource and its Curtailment Service Provider (CSP), should be required to notify PJM of material changes affecting the capability of the resource to perform as registered and to terminate registrations that are no longer capable of responding to PJM dispatch directives, such as in the case of bankrupt and out of service facilities. Generation resources are required to inform PJM of any change in availability status, including outages and shutdown status.

As a preferred alternative, demand response should be on the demand side of the capacity market rather than on the supply side. Rather than complex demand response programs with their attendant complex and difficult to administer rules, customers would be able to avoid capacity and energy charges by not using capacity and energy at their discretion.

The long term appropriate end state for demand resources in the PJM markets should be comparable to the demand side of any market. Customers should use energy as they wish and that usage will determine the amount of capacity and energy for which each customer pays. There would be no counterfactual measurement and verification.

Under this approach, customers that wish to avoid capacity payments would reduce their load during expected high load hours. Capacity costs would be assigned to LSEs and by LSEs to customers, based on actual load on the system during these critical hours. Customers wishing to avoid high energy prices would reduce their load during high price hours. Customers would pay for what they actually use, as measured by meters, rather than relying on flawed measurement and verification methods. No M&V estimates are required. No promises of future reductions which can only be verified by M&V are required. To the extent that customers enter into contracts with CSPs or LSEs to manage their payments, M&V can be negotiated as part of a bilateral commercial contract between a customer and its CSP or LSE.

<sup>11</sup> PJM "Manual 18: Capacity Market," Revision 29 (October 16, 2015), p 148.

This approach provides more flexibility to customers to limit usage at their discretion. There is no requirement to be available year round or every hour of every day. There is no 30 minute notice requirement. There is no requirement to offer energy into the day-ahead market. All decisions about interrupting are up to the customers only and they may enter into bilateral commercial arrangements with CSPs at their sole discretion. Customers would pay for capacity and energy depending solely on metered load.

A transition to this end state should be defined in order to ensure that appropriate levels of demand side response are incorporated in PJM's load forecasts and thus in the demand curve in the capacity market for the next three years. That transition should be defined by the PRD rules, modified as proposed by the Market Monitor.

This approach would work under the current RPM design and this approach would work under the CP design. This approach is entirely consistent with the Supreme Court decision in *EPSA* as it does not depend on whether FERC has jurisdiction over the demand side. This approach will allow FERC to more fully realize its overriding policy objective to create competitive and efficient wholesale energy markets. The decision of the Supreme Court addressed jurisdictional issues and did not address the merits of FERC's approach. The Supreme Court's decision has removed the uncertainty surrounding the jurisdictional issues and created the opportunity for FERC to revisit its approach to demand side.

## PJM Demand Response Programs

All demand response programs in PJM can be grouped into economic, emergency and pre-emergency programs. Pre-emergency demand response is defined to be dispatchable before an emergency event is declared.<sup>12</sup> Table 6-1 provides an overview of the key features of PJM demand response programs. Demand response program is used here to refer to pre-emergency, emergency and economic programs. Demand Resources is used here to refer to emergency and pre-emergency load response, which participate in the capacity market, and Economic Resources refer to economic load response, which participates

solely in the energy market. All Demand Resources must register as pre-emergency unless the participant relies on behind the meter generation or the resource has environmental restrictions that limit the resource's ability to operate only in emergency conditions.<sup>13</sup> In all demand response programs, CSPs are companies that seek to sign up end-use customers, participants, that have the ability to reduce load. After a demand response event occurs, PJM compensates CSPs for their participants' load reductions and CSPs in turn compensate their participants. Only CSPs are eligible to participate in the PJM demand response program, but a participant can register as a PJM special member and become a CSP without any additional cost.

<sup>12</sup> 147 FERC ¶ 61,103 (2014).

<sup>13</sup> OATT Attachment K Appendix Section 8.5

Table 6-1 Overview of demand response programs

	Emergency and Pre-Emergency Load Response Program		Economic Load Response Program	
	Load Management (LM)			
Market	Capacity Only	Capacity and Energy	Energy Only	Energy Only
Capacity Market	DR cleared in RPM	DR cleared in RPM	Not included in RPM	Not included in RPM
Dispatch Requirement	Mandatory Curtailment	Mandatory Curtailment	Voluntary Curtailment	Dispatched Curtailment
Penalties	RPM event or test compliance penalties	RPM event or test compliance penalties	NA	NA
Capacity Payments	Capacity payments based on RPM clearing price	Capacity payments based on RPM clearing price	NA	NA
Energy Payments	No energy payment.	Energy payment based on submitted higher of "minimum dispatch price" and LMP. Energy payment during PJM declared Emergency Event mandatory curtailments.	Energy payment based on submitted higher of "minimum dispatch price" and LMP. Energy payment only for voluntary curtailments.	Energy payment based on full LMP. Energy payment for hours of dispatched curtailment.

In a panel decision issued May 23, 2014, the U.S. Court of Appeals for the District of Columbia Circuit vacated Order No. 745, which provided for payment of demand-side resources at full LMP.<sup>14</sup> The court found that the FERC lacked jurisdiction to issue Order No. 745 because the "rule entails direct regulation of the retail market - a matter exclusively within state control."<sup>15</sup> On January 25, 2016, the Supreme Court voted 6-2 to reverse the decision of the lower court.<sup>16</sup> The result is that FERC retains jurisdiction over demand-side programs.

## Participation in Demand Response Programs

On April 1, 2012, FERC Order No. 745 was implemented in the PJM economic program, requiring payment of full LMP for dispatched demand resources when a net benefit test (NBT) price threshold is exceeded. This approach replaced the payment of LMP minus the charges for wholesale power and transmission already included in customers' tariff rates.

Figure 6-1 shows all revenue from PJM demand response programs by market for each year for the period January through March 2008 through 2016. Since the implementation of the RPM Capacity Market on June 1, 2007, demand response that participated through the capacity market, which includes

<sup>14</sup> Electric Power Supply Association v. FERC, No. 11-1486, *petition for en banc review denied*; see *Demand Response Compensation in Organized Wholesale Energy Markets*, Order No. 745, FERC Stats. & Regs. ¶ 31,322 (2011); *order on reh'g*, Order No. 745-A, 137 FERC ¶ 61,215 (2011); *order on reh'g*, Order No. 745-B, 138 FERC ¶ 61,148 (2012).

<sup>15</sup> *Id.*

<sup>16</sup> FERC v. Electric Power Supply Association, Slip Op. No. 14-840.

emergency energy revenue, has been the primary source of revenue to demand response participants.<sup>17</sup>

In the first three months of 2016, emergency and pre-emergency revenue, which includes capacity and emergency energy revenue, accounted for 99.1 percent of all revenue received by demand response providers, credits from the economic program were 0.5 percent and revenue from synchronized reserve was 0.3 percent.


Total emergency and pre-emergency revenue increased by \$55.7 million, or 33.0 percent, from \$168.9 million in the first three months of 2015 to \$224.6 million in the first three months 2016. Of the total emergency revenue, capacity market revenue increased by \$55.7 million, or 33.0 percent, from \$168.9 million in the first three months of 2015 to \$224.6 million in the first three months of 2016, due to higher clearing prices and volumes in the Capacity Market for the 2014/2015 and 2015/2016 delivery years. The weighted average RPM price increased 26.6 percent from \$126.40 per MW-day in the 2014/2015 Delivery Year to \$160.01 per MW-day in the 2015/2016 Delivery Year.<sup>18</sup> Total demand response revenue in the first three months of 2016 increased by 29.7 percent from \$174.8 million in the first three months of 2015 to \$226.6 million in the first three months of 2016. Total demand response revenue includes economic, pre-emergency, emergency and synchronized reserve revenue.

<sup>17</sup> This includes both capacity market revenue and emergency energy revenue for capacity resources.

<sup>18</sup> 2015 State of the Market Report for PJM: January through September, Section 5: Capacity, Figure 5-6.

Total revenue under the economic program decreased by \$3.0 million from \$4.2 million in the first three months of 2015 to \$1.2 million in the first three months of 2016, a 71.3 percent decrease.

**Figure 6-1 Demand response revenue by market: January through March 2008 through 2016**

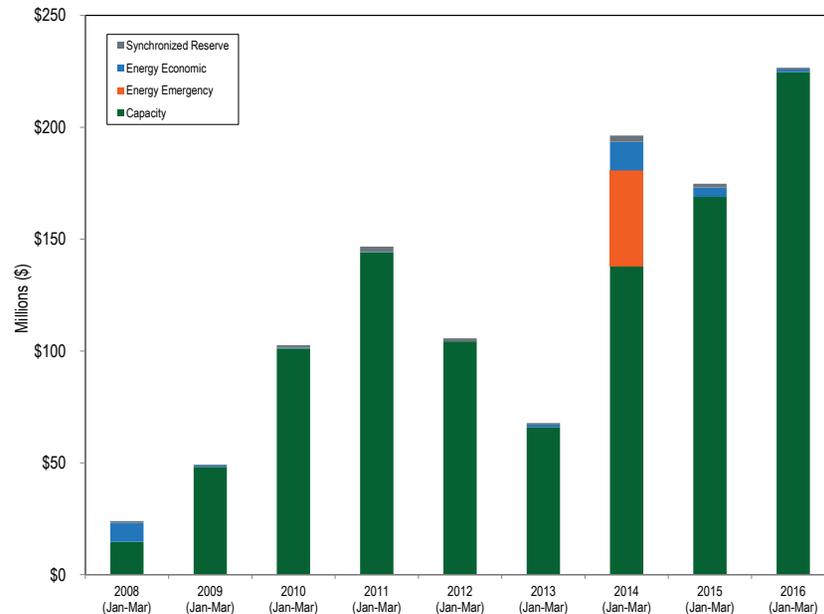

## Economic Program

Table 6-2 shows registered sites and MW for the last day of each month for the period of January 2010 through March 2016. Registration is a prerequisite for CSPs to participate in the economic program. Both the average number of registrations for economic demand response and the average registered MW decreased in the first three months of 2016 compared to the first three months of 2015. The average number of monthly registrations decreased by 241 from 1,076 in the first three months of 2015 to 836 in the first three months of 2016. The average monthly registered MW decreased by 298 MW, or 13.5 percent, from 2,955 MW in the first three months of 2015 to 2,557 MW in the first three months of 2016.

Several demand response resources are registered for both the economic and emergency demand response programs. There were 266 registrations and 1,363 nominated MW in the emergency program that were also registered in the economic program during the first three months of 2016.

**Table 6-2 Economic program registrations on the last day of the month: January 2010 through March 2016**

Month	2010		2011		2012		2013		2014		2015		2016	
	Registrations	Registered MW												
Jan	1,841	2,623	1,609	2,432	1,993	2,385	841	2,314	1,180	2,325	1,078	2,960	838	2,557
Feb	1,842	2,624	1,612	2,435	1,995	2,384	843	2,327	1,174	2,330	1,076	2,956	835	2,557
Mar	1,845	2,623	1,612	2,519	1,996	2,356	788	2,284	1,185	2,692	1,075	2,949	834	2,556
Apr	1,849	2,587	1,611	2,534	189	1,318	970	2,346	1,194	2,827	1,076	2,938		
May	1,875	2,819	1,687	3,166	371	1,669	1,375	2,414	745	2,511	980	2,846		
Jun	813	1,608	1,143	1,912	803	2,347	1,302	2,144	928	2,943	871	2,614		
Jul	1,192	2,159	1,228	2,062	942	2,323	1,315	2,443	1,036	3,006	870	2,609		
Aug	1,616	2,398	1,987	2,194	1,013	2,373	1,299	2,527	1,080	3,033	869	2,609		
Sep	1,609	2,447	1,962	2,183	1,052	2,421	1,280	2,475	1,077	2,919	867	2,608		
Oct	1,606	2,444	1,954	2,179	828	2,269	1,210	2,335	1,060	2,943	858	2,568		
Nov	1,605	2,444	1,988	2,255	824	2,267	1,192	2,307	1,063	2,995	851	2,566		
Dec	1,598	2,439	1,992	2,259	846	2,283	1,192	2,311	1,071	2,923	850	2,566		
Avg. (Jan-Mar)	1,843	2,623	1,611	2,462	1,995	2,375	824	2,308	1,180	2,449	1,076	2,955	836	2,557

The registered MW in the economic load response program are not a good measure of the MW available for dispatch in the energy market. Economic resources can dispatch more, less or the same amount of MW as registered in the program. Table 6-3 shows the sum of maximum economic MW dispatched by registration each month for the first three months of 2010 through 2016. The monthly maximum is the sum of each registration's monthly noncoincident peak dispatched MW and annual maximum is the sum of each registration's noncoincident peak dispatched MW during the year. This aggregated maximum dispatched MW for all economic demand response registered resources decreased by 223 MW, from 370 MW in the first three months of 2015 to 146 MW in the first three months of 2016.<sup>19</sup>

<sup>19</sup> As a result of the 60 day data lag from event date to settlement, not all settlements for December 2015 are incorporated in this report.

**Table 6-3 Sum of peak MW reductions for all registrations per month: January through March of 2010 through 2016**

Month	Sum of Peak MW Reductions for all Registrations per Month						
	2010	2011	2012	2013	2014	2015	2016
Jan	183	132	110	193	450	169	139
Feb	121	89	101	119	307	336	126
Mar	115	81	72	127	369	198	91
Annual (Jan - Mar)	200	147	112	233	520	370	146

All demand response energy payments are uplift rather than market payments. Economic demand response energy costs are assigned to real-time exports from the PJM Region and real-time loads in each zone for which the load-weighted average real-time LMP for the hour during which the reduction occurred is greater than the price determined under the net benefits test for that month.<sup>20</sup> The zonal allocation is shown in Table 6 13.

Table 6 4 shows the total MW reductions made by participants in the economic program and the total credits paid for these reductions in the first three months of every year from 2010 to 2016. The average credits per MWh paid decreased by \$26.85 per MWh, or 24.8 percent, from \$108.04 per MWh in the first

<sup>20</sup> PJM: "Manual 28: Operating Agreement Accounting," Revision 64 (April 11, 2014), p 70.

three months of 2015 to \$81.19 per MWh dispatched in the first three months of 2016. The average real-time load weighted PJM decreased by \$22.31 per MWh, or 43.8 percent, from \$50.91 per MWh in the first three months of 2015 to \$26.8 per MWh in the first three months of 2016. Curtailed energy for the economic program was 14,780 MWh in the first three months of 2016 and the total payments were \$1,200,069.<sup>21</sup> Total credits paid for economic DR in the first three months of 2016 decreased by \$2,975,047 million or 71.3 percent, compared to the first three months of 2015.

**Table 6-4 Credits paid to the PJM economic program participants: January through March of 2010 through 2016**

Year (Jan - Mar)	Total MWh	Total Credits	\$/MWh
2010	8,139	\$321,648	\$39.52
2011	3,272	\$240,304	\$73.45
2012	1,030	\$30,406	\$29.52
2013	21,048	\$1,083,755	\$51.49
2014	61,453	\$12,726,836	\$207.10
2015	38,644	\$4,175,116	\$108.04
2016	14,780	\$1,200,069	\$81.19

Economic demand response resources that are dispatched in both the economic and emergency programs at the same time are settled under emergency rules. For example, assume a demand resource has an economic strike price of \$100 per MWh and an emergency strike price of \$1,800 per MWh. If this resource were scheduled to reduce in the Day-Ahead Energy Market, the demand resource would receive \$100 per MWh, but if an emergency event were called during the economic dispatch, the demand resource would receive its emergency strike price of \$1,800 per MWh instead. The rationale for this rule is not clear. All other resources that clear in the day-ahead market are financially firm at that clearing price.

Figure 6-2 shows monthly economic demand response credits and MWh, from January 2010 through March 2016. Higher energy prices and FERC Order No. 745 increased incentives to participate starting in April 2012. The \$9.5 million decrease in credits paid to economic DR resources in 2015 compared

<sup>21</sup> The total MWh and Total Credits values in this table are the most up to date at the time of this report. Succeeding tables that report on charges paid for economic demand response may vary slightly from these numbers due to the timing of PJM settlement database updates.

to 2014 can largely be attributed to lower energy market prices in the first three months of 2015. Energy prices have continued to trend lower and this has resulted in lower credits paid to economic DR resources in the first three months of 2016 compared to the first three months of 2015.

**Figure 6-2 Economic program credits and MWh by month: January 2010 through March 2016**

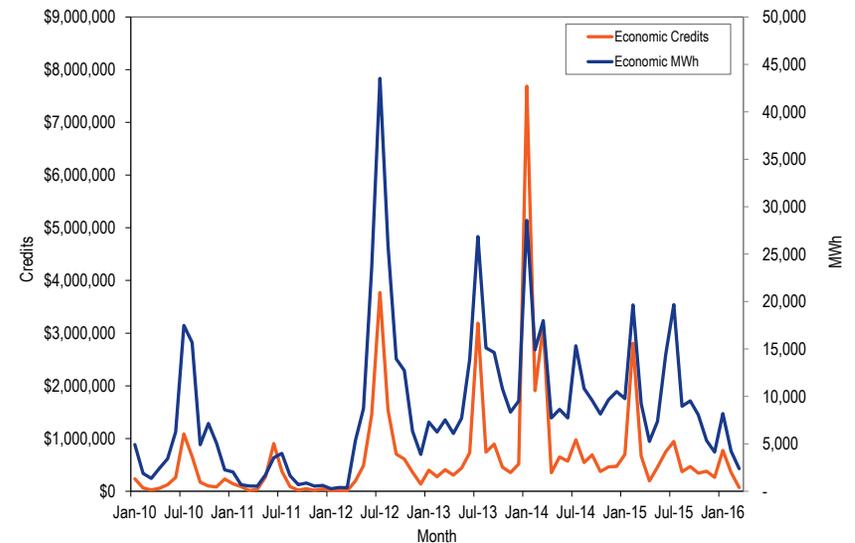


Table 6-5 shows performance for the first three months of 2015 and 2016 in the economic program by control zone and participation type. Total economic program reductions decreased 61.8 percent from 38,644 MW in the first three months of 2015 to 14,780 MW in the first three months of 2016. The economic credits decreased by 71.3 percent from \$4,175,116 in the first three months of 2015, to \$1,200,069 in the first three months of 2016.

**Table 6-5 PJM economic program participation by zone: January through March of 2015 and 2016<sup>22</sup>**

Zones	Credits			MWh Reductions			Credits per MWh Reduction		
	2015	2016	Percent Change	2015	2016	Percent Change	2015	2016	Percent Change
AECO, JCPL, PECO, Pepco, RECO	\$331,920	\$1,589	(99.5%)	1,559	16	(99.0%)	\$212.90	\$99.04	(53.5%)
AEP, AP	\$81,698	\$17,565	(78.5%)	747	252	(66.3%)	\$109.30	\$69.69	(36.2%)
ATSI, ComEd, DAY, DEOK, DLCO, EKPC	\$185,812	\$145,844	(21.5%)	3,260	2,519	(22.7%)	\$57.01	\$57.90	1.6%
BGE, DPL, Met-Ed, PENELEC	\$184,223	\$106,541	(42.2%)	2,409	1,592	(33.9%)	\$76.48	\$66.91	(12.5%)
Dominion	\$2,837,384	\$675,846	(76.2%)	24,703	7,415	(70.0%)	\$114.86	\$91.14	(20.7%)
PPL, PSEG	\$554,078	\$252,684	(54.4%)	5,966	2,985	(50.0%)	\$92.87	\$84.64	(8.9%)
Total	\$4,175,116	\$1,200,069	(71.3%)	38,644	14,780	(61.8%)	\$108.04	\$81.19	(24.8%)

Table 6-6 shows total settlements submitted for the first three months of 2010 through 2016. A settlement is counted for every day on which a registration is dispatched in the economic program.

**Table 6-6 Settlements submitted by year in the economic program: January through March of 2010 through 2016**

Year (Jan - March)	2010	2011	2012	2013	2014	2015	2016
Number of Settlements	701	693	91	21	293	1,100	197

Table 6-7 shows the number of CSPs, and the number of participants in their portfolios, submitting settlements by year from the first three months of 2010 through 2016. There were 30 fewer active participants in the first three months of 2016 than in the first three months of 2015. All participants must be included in a CSP.

**Table 6-7 Participants and CSPs submitting settlements in the economic program by year: January through March of 2010 through 2016**

	2010 (Jan - Mar)		2011 (Jan - Mar)		2012 (Jan - Mar)		2013 (Jan - Mar)		2014 (Jan - Mar)		2015 (Jan - Mar)		2016 (Jan - Mar)	
	Active CSPs	Active Participants												
Total Distinct Active	5	146	5	25	4	9	9	49	12	115	11	47	6	17

<sup>22</sup> PJM and the MMU cannot publish more detailed information about the Economic Program Zonal Settlements as a result of confidentiality requirements in the PJM Market Rules.

The ownership of economic demand response was highly concentrated in the first three months of both 2015 and 2016.<sup>23</sup> Table 6-8 shows the monthly HHI and the HHI for the first three months of 2015 and 2016. The table also lists the share of reductions provided by, and the share of credits claimed by the four largest parent companies in each year. In the first three months of 2016, 98.3 percent of all economic DR reductions and 98.6 percent of economic DR revenue were attributable to the four largest parent companies. The HHI for economic demand response increased 432 points, from 7623 in the first three months of 2015 to 8055 in the first three months of 2016.

<sup>23</sup> Parent companies may own one CSP or multiple CSPs. All HHI calculations in this section are at the parent company level.

**Table 6-8 HHI and market concentration in the economic program: January through March of 2015 and 2016**

Month	HHI			Top Four Companies Share of Reduction			Top Four Companies Share of Credit		
	2015	2016	Percent Change	2015	2016	Change Percent	2015	2016	Change Percent
	Jan	8081	7407	(8.3%)	96.8%	97.5%	0.7%	98.6%	98.0%
Feb	7358	7738	5.2%	91.4%	99.9%	8.5%	87.8%	99.8%	12.0%
Mar	7539	9737	29.1%	89.1%	100.0%	10.9%	84.4%	100.0%	15.6%
Total	7623	8055	5.7%	90.2%	98.3%	8.0%	89.1%	98.6%	9.6%

Table 6-9 shows average MWh reductions and credits by hour for the first three months of 2015 and 2016. In the first three months of 2015, 89.6 percent of reductions and 97.3 percent of credits occurred in hours ending 0700 to 2100, and in the first three months of 2016, 86.3 percent of reductions and 96.9 percent of credits occurred in hours ending 0700 to 2100.

**Table 6-9 Hourly frequency distribution of economic program MWh reductions and credits: January through March of 2015 and 2016**

Hour Ending (EPT)	MWh Reductions			Program Credits		
	2015 (Jan - Mar)	2016 (Jan - Mar)	Percent Change	2015 (Jan - Mar)	2016 (Jan - Mar)	Percent Change
1	263	5	(98%)	\$37,651	\$428	(99%)
2	253	5	(98%)	\$33,089	\$443	(99%)
3	276	5	(98%)	\$40,472	\$436	(99%)
4	344	5	(98%)	\$45,609	\$442	(99%)
5	333	5	(99%)	\$46,170	\$428	(99%)
6	657	174	(74%)	\$98,848	\$21,763	(78%)
7	3,093	1,340	(57%)	\$418,209	\$153,573	(63%)
8	4,337	2,009	(54%)	\$527,224	\$193,495	(63%)
9	4,521	2,210	(51%)	\$349,808	\$164,583	(53%)
10	3,245	1,321	(59%)	\$311,560	\$93,474	(70%)
11	2,175	813	(63%)	\$225,175	\$52,497	(77%)
12	1,826	691	(62%)	\$195,891	\$45,271	(77%)
13	1,671	567	(66%)	\$143,198	\$36,218	(75%)
14	1,337	538	(60%)	\$113,050	\$33,424	(70%)
15	1,347	529	(61%)	\$84,165	\$31,283	(63%)
16	1,399	499	(64%)	\$88,077	\$29,940	(66%)
17	1,502	514	(66%)	\$105,803	\$33,044	(69%)
18	1,881	652	(65%)	\$209,303	\$68,059	(67%)
19	2,231	935	(58%)	\$297,534	\$92,384	(69%)
20	2,126	976	(54%)	\$278,182	\$77,818	(72%)
21	1,915	795	(58%)	\$254,888	\$57,657	(77%)
22	960	138	(86%)	\$135,085	\$10,686	(92%)
23	497	38	(92%)	\$71,061	\$1,688	(98%)
24	456	19	(96%)	\$65,063	\$1,036	(98%)
Total	38,644	14,780	(62%)	\$4,175,116	\$1,200,069	(71%)

Table 6-10 shows the distribution of economic program MWh reductions and credits by ranges of real-time zonal, load-weighted, average LMP in the first three months of 2015 and 2016. In the first three months of 2016, 1.5 percent of MWh reductions and 7.0 percent of program credits occurred during hours when the applicable zonal LMP was higher than \$175 per MWh.

**Table 6-10 Frequency distribution of economic program zonal, load-weighted, average LMP (By hours): January through March of 2015 and 2016**

LMP	MWh Reductions			Program Credits		
	2015 (Jan - Mar)	2016 (Jan - Mar)	Percent Change	2015 (Jan - Mar)	2016 (Jan - Mar)	Percent Change
\$0 to \$25	241	2,382	887%	\$2,087	\$85,637	4,004%
\$25 to \$50	13,006	9,158	(30%)	\$496,855	\$601,639	21%
\$50 to \$75	6,036	1,867	(69%)	\$404,561	\$217,407	(46%)
\$75 to \$100	5,090	589	(88%)	\$469,067	\$98,023	(79%)
\$100 to \$125	3,334	317	(90%)	\$385,593	\$47,850	(88%)
\$125 to \$150	2,118	159	(93%)	\$296,281	\$39,345	(87%)
\$150 to \$175	1,534	90	(94%)	\$244,690	\$25,918	(89%)
> \$175	7,285	218	(97%)	\$1,875,983	\$84,251	(96%)
Total	38,644	14,780	(62%)	\$4,175,116	\$1,200,069	(71%)

Following FERC Order No. 745, all ISO/RTOs are required to calculate an NBT threshold price each month above which the net benefits of DR are deemed to exceed the cost to load. PJM calculates the NBT price threshold by first taking the generation offers from the same month of the previous year. For example, the NBT price calculation for February 2016 was calculated using generation offers from February 2015. PJM then adjusts these offers to account for changes in fuel prices and uses these adjusted offers to create an average monthly supply curve. PJM estimates a function that best fits this supply curve and then finds the point on this curve where the elasticity is equal to 1.<sup>24</sup> The price at this point is the NBT threshold price.

The NBT test is a crude tool that is not based in markets logic. The NBT threshold price is a monthly estimate calculated from a monthly supply curve that does not incorporate the real-time or day-ahead prices. In addition, it is a single price used to trigger payments to economic demand response resources throughout the entire RTO, regardless of their location.

The necessity for the NBT test is an illustration of the illogical approach to demand side compensation embodied in paying full LMP to demand resources. The benefit of demand side resources is not that they suppress market prices, but that customers can choose not to consume at the current price of power, that individual customers benefit from their choices and that the choices of

<sup>24</sup> PJM, "Manual 11: Energy & Ancillary Services Market Operations," Revision 79 (December 17, 2015), p. 125.

all customers are reflected in market prices. If customers face the market price, customers should have the ability to not purchase power and the market impact of that choice does not require a test for appropriateness.

When the LMP is above the NBT threshold price, economic demand response resources that reduce their power consumption are paid the full LMP. When the LMP is below the NBT threshold price, economic demand response resources are not paid for any load reductions. About 0.55 percent of DR dispatch occurred during hours with LMP lower than the NBT threshold price.

Table 6-11 shows the NBT threshold price from April 2012, when FERC Order No. 745 was implemented in PJM, through March of 2016. Significantly lower fuel prices in the first three months of 2016 led to lower NBT threshold prices.

**Table 6-11 Net benefits test threshold prices: April 2012 through March 2016**

Month	Net Benefits Test Threshold Price (\$/MWh)				
	2012	2013	2014	2015	2016
Jan		\$25.72	\$29.51	\$29.63	\$23.67
Feb		\$26.27	\$30.44	\$26.52	\$26.71
Mar		\$25.60	\$34.93	\$24.99	\$22.10
Apr	\$25.89	\$26.96	\$32.59	\$24.92	
May	\$23.46	\$27.73	\$32.08	\$23.79	
Jun	\$23.86	\$28.44	\$31.62	\$23.80	
Jul	\$22.99	\$29.42	\$31.62	\$23.03	
Aug	\$24.47	\$28.58	\$29.85	\$23.17	
Sep	\$24.93	\$28.80	\$29.83	\$21.69	
Oct	\$25.96	\$29.13	\$30.20	\$21.48	
Nov	\$25.63	\$31.63	\$29.17	\$22.28	
Dec	\$25.97	\$28.82	\$29.01	\$22.31	
Average	\$24.80	\$28.09	\$30.91	\$23.97	\$24.16

Table 6-12 shows the number of hours that at least one zone in PJM had day-ahead LMP or real-time LMP higher than the NBT threshold price. In the first three months of 2016, the highest zonal LMP in PJM was higher than the NBT threshold price 1,995 hours out of the entire 2,183 hours, or 91.4 percent of all hours. Reductions occurred in 1,307 hours, or 59.9 percent, of the 2,183 hours in the first three months of 2016. The last three columns illustrate how

often economic demand response activity occurred when LMPs exceeded NBT threshold prices in the first three months of 2015 and 2016.

**Table 6-12 Hours with price higher than NBT and DR occurrences in those hours: January through March of 2015 and 2016**

Month	Number of Hours		Number of Hours with LMP Higher than NBT		Percent Change	Percent of NBT Hours with DR		Change Percent
	2015	2016	2015	2016		2015	2016	
Jan	744	744	669	690	3.1%	83.0%	81.4%	(1.5%)
Feb	672	696	670	595	(11.2%)	93.1%	53.3%	(39.9%)
Mar	743	743	719	710	(1.3%)	90.8%	44.5%	(46.3%)
Total	2,159	2,183	2,058	1,995	(3.1%)	89.0%	59.9%	(29.1%)

Economic DR revenues are paid by real-time loads and real-time scheduled exports as an uplift charge. Table 6-13 shows the sum of real-time DR charges and day-ahead DR charges for each zone and for exports. Real-time loads in AEP, Dominion, and ComEd paid the highest DR charges in the first three months of 2016.

**Table 6-13 Zonal DR charge: January through March 2016**

Zone	January	February	March	Total
AECO	\$3,908	\$2,652	\$238	\$6,798
AEP	\$61,502	\$26,393	\$6,494	\$94,389
AP	\$25,404	\$12,376	\$2,509	\$40,289
ATSI	\$30,431	\$13,861	\$3,325	\$47,617
BGE	\$17,816	\$12,950	\$1,589	\$32,355
ComEd	\$35,941	\$9,008	\$4,122	\$49,071
DAY	\$8,577	\$3,441	\$856	\$12,873
DEOK	\$12,262	\$3,897	\$1,279	\$17,437
Dominion	\$52,603	\$27,066	\$4,871	\$84,540
DPL	\$9,109	\$4,365	\$714	\$14,187
DLCO	\$5,960	\$2,528	\$634	\$9,122
EKPC	\$6,939	\$2,058	\$608	\$9,605
JCPL	\$9,632	\$3,996	\$560	\$14,188
Met-Ed	\$6,844	\$2,911	\$409	\$10,164
PECO	\$17,023	\$6,630	\$993	\$24,646
PENELEC	\$7,961	\$3,984	\$827	\$12,772
Pepco	\$16,286	\$8,605	\$1,507	\$26,397
PPL	\$19,654	\$8,192	\$1,117	\$28,963
PSEG	\$18,644	\$7,700	\$1,187	\$27,530
RECO	\$665	\$214	\$44	\$923
Exports	\$18,533	\$14,959	\$965	\$34,457
Total	\$385,691	\$177,783	\$34,850	\$598,324

Table 6-14 shows the total zonal DR charge per MWh of real-time load and exports during the first three months of 2016. On a dollar per MWh basis, real-time load and exports in AECO paid the highest charges for economic demand response in the first three months of 2016. The highest average zonal monthly per MWh charges for economic demand response occurred in February, when real-time load and exports paid an average of \$0.013/MWh.

Table 6-14 Zonal DR charge per MWh of load and exports: January through March of 2016

Zone	January	February	March	Zonal Average
AECO	\$0.010	\$0.013	\$0.006	\$0.010
AEP	\$0.009	\$0.011	\$0.003	\$0.008
AP	\$0.009	\$0.010	\$0.003	\$0.008
ATSI	\$0.009	\$0.010	\$0.003	\$0.008
BGE	\$0.009	\$0.011	\$0.003	\$0.007
ComEd	\$0.011	\$0.008	\$0.003	\$0.007
DAY	\$0.009	\$0.011	\$0.003	\$0.008
DEOK	\$0.010	\$0.011	\$0.003	\$0.008
Dominion	\$0.009	\$0.010	\$0.003	\$0.007
DPL	\$0.010	\$0.009	\$0.004	\$0.008
DLCO	\$0.010	\$0.010	\$0.003	\$0.008
EKPC	\$0.010	\$0.010	\$0.003	\$0.008
JCPL	\$0.010	\$0.009	\$0.007	\$0.009
Met-Ed	\$0.011	\$0.009	\$0.007	\$0.009
PECO	\$0.010	\$0.008	\$0.008	\$0.009
PENELEC	\$0.010	\$0.011	\$0.005	\$0.008
Pepco	\$0.009	\$0.009	\$0.003	\$0.007
PPL	\$0.010	\$0.009	\$0.007	\$0.009
PSEG	\$0.010	\$0.009	\$0.008	\$0.009
RECO	\$0.011	\$0.008	\$0.007	\$0.009
Exports	\$0.010	\$0.017	\$0.002	\$0.010
Monthly Average	\$0.010	\$0.010	\$0.004	\$0.008

Table 6-15 shows the monthly day-ahead and real-time DR charges and the per MWh DR charges in the first three months of 2015 and 2016. The day-ahead DR charges decreased by \$0.80 million, or 81.3 percent, from \$0.99 million in the first three months of 2015 to \$0.19 million in the first three months of 2016. The real-time DR charges decreased \$2.77 million, or 87.0 percent, from \$3.19 million in the first three months of 2015 to \$0.41 million in the first three months of 2016. The per MWh charge paid by all real-time load and exports for economic DR decreased \$0.03/MWh, or 66.6 percent, from \$0.04/MWh in the first three months of 2015 to \$0.01/MWh in the first three months of 2016.

Table 6-15 Monthly day-ahead and real-time DR charge: January through March of 2015 and 2016

Month	Day-ahead DR Charge			Real-time DR Charge			Per MWh Charge (\$/MWh)		
	2015	2016	Percent Change	2015	2016	Percent Change	2015	2016	Percent Change
Jan	\$202,040	\$140,114	(31%)	\$496,193	\$245,578	(51%)	\$0.025	\$0.013	(47%)
Feb	\$647,566	\$45,388	(93%)	\$2,161,548	\$132,395	(94%)	\$0.059	\$0.014	(77%)
Mar	\$140,310	\$0	(100%)	\$527,458	\$34,850	(93%)	\$0.020	\$0.009	(56%)
Total	\$989,916	\$185,502	(81%)	\$3,185,199	\$412,822	(87%)	\$0.039	\$0.013	(67%)

## Emergency and Pre-Emergency Programs

The emergency and pre-emergency load response programs consist of the limited, extended summer and annual demand response product in the capacity market during the 2014/2015 and 2015/2016 Delivery Years. To participate as a limited demand resource, the provider must clear MW in an RPM auction. Emergency resources receive capacity revenue from the capacity market and also receive revenue at a predefined strike price from the energy market for reductions during a PJM initiated emergency event. The rules applied to demand resources in the current market design do not treat demand resources in a manner comparable to generation capacity resources, even though demand resources are sold in the same capacity market, are treated as a substitute for other capacity resources and displace other capacity resources in RPM auctions.

The MMU recommends that if demand resources remain on the supply side of the capacity market, a daily must offer requirement in the Day-Ahead Energy Market apply to demand resources, comparable to the rule applicable to generation capacity resources. This will help to ensure comparability and consistency for demand resources.

The MMU recommends that the option to specify a minimum dispatch price under the Emergency and Pre-Emergency Program Full option be eliminated and that participating resources receive the hourly real-time LMP less any generation component of their retail rate.<sup>25</sup>

<sup>25</sup> See "Complaint and Motion to Consolidate of the Independent Market Monitor for PJM," Docket No. EL14-20-000 (January 28, 2014); "Comments of the Independent Market Monitor for PJM," Docket No. ER15-852-000 (February 13, 2015).

The ownership of Demand Resources was moderately concentrated in the first three months of 2016. The HHI for Demand Resources was 1760 for the 2014/2015 Delivery Year and 1497 for the 2015/2016 Delivery Year. In the first three months of 2016, the four largest companies contributed 65.3 percent of all registered Demand Resources.

Table 6-16 shows the HHI value for LDAs by delivery year. The HHI values are calculated by the cleared UCAP MW in each delivery year for Demand Resources. The ownership of DR in two LDAs was moderately concentrated in the 2014/2015 Delivery Year and the ownership of DR in five LDAs was moderately concentrated in the 2015/2016 Delivery Year. The ownership of DR in six LDAs was highly concentrated in the 2014/2015 Delivery Year and the ownership of DR in four LDAs was highly concentrated in the 2015/2016 Delivery Year.

**Table 6-16 HHI value for LDAs by delivery year: 2014/2015 and 2015/2016 Delivery Year**

Delivery Year	LDA	UCAP MW	HHI Value	
2014/2015	DPL-SOUTH	220.9	2131	
	EMAAC	1,756.5	1879	
	MAAC	2,207.1	2355	
	PEPCO	920.0	2643	
	PS-NORTH	468.4	1558	
	PSEG	531.1	1548	
	RTO	7,490.6	2373	
	SWMAAC	1,348.4	3564	
	2015/2016	ATSI	2,167.9	2257
		DPL-SOUTH	86.3	2923
EMAAC		1,750.4	1355	
MAAC		2,029.0	1607	
PEPCO		867.7	2462	
PS-NORTH		263.5	1622	
PSEG		523.8	1381	
RTO		6,610.4	1734	
	SWMAAC	1,154.7	3541	

Table 6-17 shows zonal monthly capacity market revenue to demand resources for 2016. Capacity market revenue increased in the first three months of 2016 by \$55.7 million, or 33.0 percent, compared to the first three months of 2015,

from \$168.9 million to \$224.6 million, as a result of higher RPM prices and more cleared DR in RPM for the 2014/2015 and 2015/2016 delivery years.

**Table 6-17 Zonal monthly capacity revenue: January through March 2016**

Zone	January	February	March	Total
AECO	\$1,018,226	\$952,534	\$1,018,226	\$2,988,986
AEP, EKPC	\$6,881,145	\$6,437,200	\$6,881,145	\$20,199,491
AP	\$3,279,835	\$3,068,232	\$3,279,835	\$9,627,902
ATSI	\$19,097,783	\$17,865,668	\$19,097,783	\$56,061,235
BGE	\$5,546,155	\$5,188,338	\$5,546,155	\$16,280,648
ComEd	\$6,679,174	\$6,248,259	\$6,679,174	\$19,606,607
DAY	\$760,832	\$711,746	\$760,832	\$2,233,411
DEOK	\$1,319,812	\$1,234,663	\$1,319,812	\$3,874,287
DLCO	\$5,235,719	\$4,897,930	\$5,235,719	\$15,369,368
Dominion	\$2,201,083	\$2,059,077	\$2,201,083	\$6,461,243
DPL	\$878,296	\$821,632	\$878,296	\$2,578,225
JCPL	\$1,720,510	\$1,609,510	\$1,720,510	\$5,050,530
Met-Ed	\$1,667,231	\$1,559,668	\$1,667,231	\$4,894,129
PECO	\$3,824,221	\$3,577,497	\$3,824,221	\$11,225,938
PENELEC	\$2,625,490	\$2,456,104	\$2,625,490	\$7,707,085
Pepco	\$4,232,745	\$3,959,665	\$4,232,745	\$12,425,155
PPL	\$5,591,452	\$5,230,713	\$5,591,452	\$16,413,617
PSEG	\$3,862,880	\$3,613,662	\$3,862,880	\$11,339,423
RECO	\$103,031	\$96,384	\$103,031	\$302,445
Total	\$76,525,621	\$71,588,484	\$76,525,621	\$224,639,725

Table 6-18 shows the amount of energy efficiency (EE) resources in PJM for the 2012/2013 through 2015/2016 delivery years. Energy efficiency resources are offered in the PJM Capacity Market. The total MW of energy efficiency resources cleared in the capacity auction increased by 19.5 percent from 1,231.8 MW in the 2014/2015 delivery year to 1,471.4 MW in 2015/2016 Delivery Year.

**Table 6–18 Energy efficiency resources by MW: 2012/2013 through 2015/2016 Delivery Year**

	EE ICAP (MW)				EE UCAP (MW)			
	2012/ 2013	2013/ 2014	2014/ 2015	2015/ 2016	2012/ 2013	2013/ 2014	2014/ 2015	2015/ 2016
Total	609.7	991.0	1,231.8	1,471.4	631.2	1,029.2	1,282.4	1,525.5

FERC accepted PJM's proposed 30 minute lead time as a phased in approach on May 9, 2014, effective on June 1, 2015.<sup>26</sup> The quick lead time demand response was defined after Demand Resources cleared in the RPM base residual auctions for the 2014/2015, 2015/2016, 2016/2017 and 2017/2018 delivery years. PJM submitted a filing on October 20, 2014, to allow DR that is unable to respond within 30 minutes to exit the market without penalty before the mandatory 30 minute lead time with the 2015/2016 Delivery Year.<sup>27</sup>

Table 6-19 shows the number of customer locations and nominated MW by product type and lead time during the 2015/2016 Delivery Year. The quick lead time is the default lead time for the 2015/2016 Delivery Year, unless a CSP submits an exception request for 60 or 120 minute notification time due to a physical constraint.<sup>28</sup> There were 3,174 locations which have 4,334.6 MW of nominated MW capacity approved by PJM to respond in 60 or 120 minutes.

**Table 6–19 Lead time by product type: 2015/2016 Delivery Year**

Lead Type	Product Type	Locations	Nominated MW
Long Lead (120 Minutes)	Annual and Extended Summer	791	697
	Limited	1,957	3,058
Short Lead (60 Minutes)	Extended Summer and Limited	426	580
Quick Lead (30 Minutes)	Annual	191	174
	Extended Summer	3,723	2,043
	Limited	10,635	5,092
Total		17,723	11,643

There are three different ways to measure load reductions of Demand Resources. The Firm Service Level (FSL) method measures the difference between a

<sup>26</sup> See "Order Rejecting, in part, and Accepting, in part, Proposed Tariff Changes, Subject to Conditions," Docket No. ER14-822-001 (May 9, 2014).

<sup>27</sup> See "PJM Interconnection, LLC," Docket No. ER14-135-000 (October 20, 2014).

<sup>28</sup> See "Manual 18: Capacity Market," Revision 2 (August 3, 2015), p. 57.

customer's peak load contribution (PLC) and real time load multiplied by the loss factor. The Guaranteed Load Drop (GLD) method calculates the minimum of: the CBL minus real time load multiplied by the loss factor; or the PLC minus the real time load multiplied by the loss factor. The GLD method uses the minimum of the two to avoid the possibility of double counting reductions which could occur if the CBL were used and the CBL were greater than the PLC.<sup>29</sup> The Direct Load Control (DLC) method measures when the CSP turns on and turns off the direct load control switch to remotely control load reductions. DLC customers do not measure metered real time load for reductions.

Table 6-20 shows the MW registered by measurement and verification method and by load drop method for the 2015/2016 Delivery Year. For the 2015/2016 Delivery Year, 1.6 percent use the guaranteed load drop (GLD) measurement and verification method, 94.3 percent use the firm service level (FSL) method and 4.1 percent use direct load control (DLC). FSL registrations increased by 2,437.9 MW while GLD registrations decreased by 38.8 MW and DLC registrations decreased by 111.9 MW from the 2014/2015 delivery year to the 2015/2016 delivery year.

<sup>29</sup> 135 FERC ¶ 61,212.

**Table 6-20 Reduction MW by each demand response method: 2015/2016 Delivery Year**

Program Type	On-site Generation MW	HVAC MW	Refrigeration and Lighting MW	Manufacturing or Water Heating MW	Other, Batteries or Plug Load MW	Total MW	Percent by Type
Firm Service Level	2,636.7	2,541.3	1,162.8	4,575.0	58.8	10,974.6	94.3%
Guaranteed Load Drop	20.6	106.1	13.5	47.6	0.0	187.8	1.6%
DLC (Non hourly metered sites)	0.0	444.9	0.0	35.3	0.0	480.1	4.1%
Total	2,657.3	3,092.3	1,176.3	4,657.8	58.8	11,642.6	100.0%
Percent by method	22.8%	26.6%	10.1%	40.0%	0.5%	100.0%	

Table 6-21 shows the fuel type used in the on-site generators identified in Table 6-20 for the 2015/2016 Delivery Year. Of the 22.8 percent of emergency demand response identified as using on-site generation for the 2015/2016 Delivery Year, 84.7 percent of MW are diesel, 12.0 percent are natural gas and 3.3 percent is coal, gasoline, kerosene, oil, propane or waste products.

**Table 6-21 On-site generation fuel type by MW: 2015/2016 Delivery Year**

Fuel Type	2015/2016	
	MW	Percent
Coal, Gasoline, Kerosene, Oil, Propane, Waste Products	87.9	3.3%
Diesel	2,250.9	84.7%
Natural Gas	318.5	12.0%
Total	2,657.3	100.0%

### Emergency and Pre-Emergency Event Reported Compliance

Table 6-22 shows the demand response cleared UCAP MW for PJM by Delivery Year. Total demand response cleared in PJM increased by 3.4 percent from 14,943 MW in the 2014/2015 Delivery Year to 15,453.7 MW in the 2015/2016 Delivery Year. The DR Cleared MW UCAP increased by 510.7 MW, from 14,943.0 MW in the 2014/2015 Delivery Year to 15,453.7 MW in the 2015/2016 Delivery Year. The DR percent of capacity decreased by 3.4 percent, from 9.3 percent in the 2014/2015 Delivery Year to 8.9 percent in the 2015/2016 Delivery Year.

**Table 6–22 Demand response cleared MW UCAP for PJM: 2011/2012 through 2015/2016 Delivery Year**

	2011/2012 Delivery Year		2012/2013 Delivery Year		2013/2014 Delivery Year		2014/2015 Delivery Year		2015/2016 Delivery Year	
	DR Cleared MW UCAP	DR Percent of Capacity MW UCAP	DR Cleared MW UCAP	DR Percent of Capacity MW UCAP	DR Cleared MW UCAP	DR Percent of Capacity MW UCAP	DR Cleared MW UCAP	DR Percent of Capacity MW UCAP	DR Cleared MW UCAP	DR Percent of Capacity MW UCAP
Total	1,826.6	1.4%	8,740.9	6.2%	10,779.6	6.7%	14,943.0	9.3%	15,453.7	8.9%

Subzonal dispatch of emergency demand resources was mandatory for the 2014/2015 Delivery Year, but only if the subzone was defined by PJM no later than the day before the dispatch. There are ten dispatchable subzones in PJM effective August 11, 2015: AEP\_CANTON, ATSI\_CLE, DPL\_SOUTH, PS\_NORTH, ATSI\_NEWCASOE, PPL\_WESCO, ATSI\_BLKRIVER, PENELEC\_ERIC, APS\_EAST, DOM\_CHES.<sup>30</sup> Demand resources can be dispatched for voluntary compliance during any hour of any day, but dispatched resources are not measured for compliance outside of the mandatory compliance window for each demand product. A demand response event during a product's mandatory compliance window also may not result in a compliance score. When demand response events occur for partial hours under 30 minutes or for a subzone dispatch that was not defined one business day before dispatch, the events are not measured for compliance. The category of Minutes not Measured for Compliance is the amount of time during which compliance was not measured when demand resources were dispatched.

Demand Resources are paid based on the average performance by registration for the duration of a demand response event. Demand response should measure compliance no less than hourly to accurately report reductions during demand response events. The current rules use the average reduction for the duration of an event. The average duration across multiple hours does not provide an accurate metric for each hour of the event and is inconsistent with the measurement of generation resources. Measuring compliance hourly would provide accurate information to the PJM system. The MMU recommends demand response event compliance be calculated for each hour and the penalty structure reflect hourly compliance.<sup>31</sup>

<sup>30</sup> See "Load Management Subzones," <<http://www.pjm.com/~media/markets-ops/demand-response/subzone-definition-workbook.ashx>> (Accessed February 26, 2016).

<sup>31</sup> PJM "Manual 18: Capacity Market," Revision 29 (October 16, 2015), p. 148.

PJM allows compliance to be measured across zones within a compliance aggregation area (CAA).<sup>32</sup> This changes the way CSPs dispatch resources when multiple electrically contiguous areas with the same RPM clearing prices are dispatched. The compliance rules determine how CSPs are paid and thus create incentives that CSPs will incorporate in their decisions about how to respond to PJM dispatch.<sup>33</sup> The multiple zone approach is even less locational than the zonal and subzonal approaches and creates larger mismatches between the locational need for the resources and the actual response. If multiple zones within a CAA are called by PJM, a CSP will dispatch the least cost resources across the zones to cover the CSP's obligation. This can result in more MW dispatched in one zone that are locationally distant from the relief needed and no MW dispatched in another zone, yet the CSP could be considered 100 percent compliant and pay no penalties. More locational deployment of load management resources would improve efficiency. The MMU recommends that demand resources be required to provide their nodal location. Nodal dispatch of demand resources would be consistent with the nodal dispatch of generation.

Load increases are not netted against load decreases for dispatched demand resources across hours or across registrations within hours for compliance purposes, but are treated as zero. This skews the compliance results towards higher compliance since poorly performing demand resources are not used in the compliance calculation. When load is above the peak load contribution during a demand response event, the load reduction is negative; it is a load

<sup>32</sup> CAA is "a geographic area of Zones or sub-Zones that are electrically-contiguous and experience for the relevant Delivery Year, based on Resource Clear Prices of, for Delivery Years through May 31, 2018, Annual Resources and for the 2018/2019 Delivery Year and subsequent Delivery Years, Capacity Performance Resources, the same locational price separation in the Base Residual Auction, the same locational price separation in the First Incremental Auction, the same locational price separation in the Second Incremental Auction, or the same locational price separation in the Third Incremental Auction." OATT Attachment DD.2 Definitions 2.6A.

<sup>33</sup> See "Answer and Motion for Leave to Answer of the Independent Market Monitor for PJM," Docket No. ER14-822-002 (July 25, 2014). See "Manual 18: Capacity Market," Revision 28 (August, 3, 2015) p. 152.

increase rather than a decrease. PJM ignores such negative reduction values and instead replaces the negative values with a zero MW reduction value. The PJM Tariff and PJM Manuals do not limit the compliance calculation value to a zero MW reduction value.<sup>34</sup> The compliance values PJM reports for demand response events are different than the actual compliance values accounting for both increases and decreases in load from demand resources that are called on and paid under the program.

The MMU recommends that compliance rules be revised to include submittal of all necessary hourly load data, and that negative values be included when calculating event compliance across hours and registrations.

Demand Resources that are also registered as Economic Resources have a calculated CBL for the emergency event days. Demand Resources that are not registered as Economic Resources use the hour before a dispatched event as the CBL for measuring energy reductions. A 2011 KEMA report stated that the hour before method performs poorly during early winter hours. “The hour before the reduction event is typically prior to the morning peak, therefore this CBL severely underestimates the morning peak and the subsequent hours.”<sup>35</sup> The calculated CBL more accurately measures reductions for Demand Resources.

## Definition of Compliance

Currently, the calculation methods of event and test compliance do not provide reliable results. PJM’s interpretation of load management event rules allows over compliance to be reported when there is no actual over compliance. Settlement locations with a negative load reduction value (load increase) are not netted by PJM within registrations or within demand response portfolios. A resource that has load above their baseline during a demand response event has a negative performance value. PJM limits compliance shortfall values to zero MW. This is not explicitly stated in the Tariff or supporting Manuals

and the compliance formulas for FSL and GLD customers do allow negative values.<sup>36</sup>

Limiting compliance to positive values only incorrectly calculates compliance. For example, if a registration had two locations, one with a 50 MWh load increase when called, and another with a 75 MWh load reduction when called, PJM calculates compliance for that registration as a 75 MWh load reduction for that event hour. Negative settlement MWh are not netted across hours or across registrations for compliance purposes. A location with a load increase is set to a zero MW reduction. For example, in a two hour event, if a registration showed a 15 MWh load increase in hour one, but a 30 MWh reduction in hour two, the registration would have a calculated 0 MWh reduction in hour one and a 30 MWh reduction in hour two. This has compliance calculated at an average hourly 15 MWh load reduction for that two hour event, compared to a 7.5 MWh observed reduction. Reported compliance is greater than observed compliance, as locations with load increases, i.e. negative reductions, are treated as zero for compliance purposes.

Changing a demand resource compliance calculation from a negative value to 0 MW inaccurately values event performance and capacity performance. Inflated compliance numbers for an event overstates the true value and capacity of demand resources. A demand response capacity resource that performs negatively is also displacing another capacity resource that could supply capacity during a delivery year. By setting the negative compliance value to 0 MW, PJM is inaccurately calculating the value of demand resources.

An extreme example makes clear the fundamental problems with the use of measurement and verification methods to define the level of power that would have been used but for the DR actions, and the payments to DR customers that result from these methods. The current rules for measurement and verification for demand resources make a bankrupt company, a customer that no longer exists due to closing of a facility or a permanently shut down company, or a company with a permanent reduction in peak load due to a partial closing of a facility, an acceptable demand response customer under some interpretations of the tariff, although it is the view of the MMU that such customers should

<sup>34</sup> PJM. OATT Attachment K § PJM Emergency Load Response Program at Reporting and Compliance.

<sup>35</sup> See “PJM Empirical Analysis of Demand Response Baseline Methods,” KEMA, April 2011, <<https://www.pjm.com/~media/markets-ops/dsr/pjm-analysis-of-dr-baseline-methods-full-report.ashx>> (Accessed February 26, 2016).

<sup>36</sup> OATT Attachment K Section 8.9.

not be permitted to be included as registered demand resources. Companies that remain in business, but with a substantially reduced load, can maintain their pre-bankruptcy FSL (firm service level to which the customer agrees to reduce in an event) commitment, which can be greater than or equal to the post-bankruptcy peak load. The customer agrees to reduce to a level which is greater than or equal to its new peak load after bankruptcy. When demand response events occur the customer would receive credit for 100 percent reduction, even though the customer took no action and could take no action to reduce load. This problem exists regardless of whether the customer is still paying for capacity. To qualify and participate as a Demand Resource, the customer must have the ability to reduce load. “A participant that has the ability to reduce a measurable and verifiable portion of its load, as metered on an EDC account basis.”<sup>37</sup> Such a customer no longer has the ability to reduce load in response to price or a PJM demand response event. CSPs in PJM have and continue to register bankrupt customers as DR customers. PJM finds acceptable the practice of CSPs maintaining the registration of customers with a bankruptcy related reduction in demand that are unable, as a result, to respond to emergency events.

## Emergency Energy Payments

For any PJM declared load management event in the first three months of 2016, participants registered under the full option, which contains 99.6 percent of registrations, that were dispatched and reported a load reduction were eligible to receive emergency energy payments. The full program option includes an energy payment for load reductions during a pre-emergency or emergency event for demand response events and capacity payments.<sup>38</sup> The Demand Resource energy payments are equal to the higher of hourly zonal LMP or a strike price energy offer made by the participant, including a dollar per MWh minimum dispatch price and an associated shutdown cost. The new scarcity pricing rules increased the maximum DR energy price offer for the 2013/2014 Delivery Year to \$1,800 per MWh. The maximum offer decreased to \$1,599 per MWh for the 2014/2015 Delivery Year and increased to \$1,849

37 OATT Attachment K Appendix Section 8.2.

38 OATT Attachment K Appendix Section 8.2.

per MWh for the 2015/2016 Delivery Year. The maximum generator offer will remain at \$1,000 per MWh.<sup>39 40</sup>

Shutdown costs for demand response resources are not adequately defined in Manual 15. PJM's Cost Development Subcommittee (CDS) approved changes to Manual 15 to eliminate shutdown costs for demand response resources participating in the Synchronized Reserve Market, but not Demand Resources or Economic Resources.<sup>41</sup>

Table 6-23 shows the distribution of registrations and associated MW in the emergency full option across ranges of minimum dispatch prices for the 2015/2016 Delivery Year. The majority of participants, 77.0 percent, have a minimum dispatch price between \$1,550 and \$1,850 per MWh, which is the maximum price allowed for the 2015/2016 Delivery Year, and 3.4 percent of participants have a dispatch price between \$0 and \$1 per MWh. Energy offers are further increased by submitted shutdown costs, which, in the 2014/2015 Delivery Year, range from \$0 to more than \$10,000. Depending on the size of the registration, the shutdown costs can significantly increase the effective energy offer. The shutdown cost of resources with \$1,000 to \$1,100 per MWh strike prices had the highest average at \$183.69 per location and \$141.56 per MW.

**Table 6-23 Distribution of registrations and associated MW in the emergency full option across ranges of minimum dispatch prices: 2015/2016 Delivery Year<sup>42</sup>**

Ranges of Strike Prices (\$/MWh)	Locations	Percent of Total	Nominated MW (ICAP)	Percent of Total	Shutdown Cost per Location	Shutdown Cost Per Nominated MW (ICAP)
\$0-\$1	609	3.4%	562.9	4.8%	\$0.00	\$0.00
\$1-\$999	192	1.1%	217.0	1.9%	\$136.08	\$120.42
\$1,000-\$1,100	2,850	16.1%	3,698.1	31.8%	\$183.69	\$141.56
\$1,101-\$1,275	0	0.0%	0.0	0.0%	\$0.00	\$0.00
\$1,276-\$1,549	422	2.4%	514.0	4.4%	\$59.11	\$48.53
\$1,550-\$1,850	13,650	77.0%	6,651.3	57.1%	\$26.97	\$55.35
Total	17,723	100.0%	11,643.2	100.0%	\$53.19	\$80.97

39 139 FERC ¶ 61,057 (2012).

40 FERC accepted proposed changes to have the maximum strike price for 30 minute demand response to be \$1,000/MWh + 1\*Shortage penalty - \$1.00, for 60 minute demand response to be \$1,000/MWh + (Shortage Penalty/2) and for 120 minute demand response to be \$1,100/MWh from ER14-822-000.

41 PJM. "Manual 15: Cost Development Guidelines," Revision 26 (November 5, 2014), p. 54.

42 In this analysis nominated MW does not include capacity only resources, which do not receive energy market credits.

## Net Revenue

The Market Monitoring Unit (MMU) analyzed measures of PJM energy market structure, participant conduct and market performance. As part of the review of market performance, the MMU analyzed the net revenues earned by combustion turbine (CT), combined cycle (CC), coal plant (CP), diesel (DS), nuclear (NU), solar, and wind generating units.

## Overview

### Net Revenue

- Energy net revenues are significantly affected by fuel prices and energy prices. Coal and natural gas prices and energy prices were lower in the first three months of 2016 than in the first three months of 2015. Net revenues from the energy market for all plant types were affected by the lower prices.
- In the first three months of 2016, average energy market net revenues decreased from the first three months of 2015 by 62 percent for a new CT, 51 percent for a new CC, 82 percent for a new CP, 85 percent for a new DS, 56 percent for a new nuclear plant, 38 percent for a new wind installation, and 62 percent for a new solar installation.

## Conclusion

Wholesale electric power markets are affected by externally imposed reliability requirements. A regulatory authority external to the market makes a determination as to the acceptable level of reliability which is enforced through a requirement to maintain a target level of installed or unforced capacity. The requirement to maintain a target level of installed capacity can be enforced via a variety of mechanisms, including government construction of generation, full-requirement contracts with developers to construct and operate generation, state utility commission mandates to construct capacity, or capacity markets of various types. Regardless of the enforcement mechanism, the exogenous requirement to construct capacity in excess of what is constructed in response to energy market signals has an impact on energy markets. The reliability requirement results in maintaining a level of

capacity in excess of the level that would result from the operation of an energy market alone. The result of that additional capacity is to reduce the level and volatility of energy market prices and to reduce the duration of high energy market prices. This, in turn, reduces net revenue to generation owners which reduces the incentive to invest. The exact level of both aggregate and locational excess capacity is a function of the calculation methods used by RTOs and ISOs.

## Net Revenue


When compared to annualized fixed costs, net revenue is an indicator of generation investment profitability, and thus is a measure of overall market performance as well as a measure of the incentive to invest in new generation to serve PJM markets. Net revenue equals total revenue received by generators from PJM Energy, Capacity and Ancillary Service Markets and from the provision of black start and reactive services less the variable costs of energy production. In other words, net revenue is the amount that remains, after the short run marginal costs of energy production have been subtracted from gross revenue, to cover fixed costs, which include a return on investment, depreciation, taxes and fixed operation and maintenance expenses. Net revenue is the contribution to total fixed costs received by generators from all PJM markets.

In a perfectly competitive, energy-only market in long-run equilibrium, net revenue from the energy market would be expected to equal the total of all annualized fixed costs for the marginal unit, including a competitive return on investment. The PJM market design includes other markets intended to contribute to the payment of fixed costs. In PJM, the Energy, Capacity and Ancillary Service Markets are all significant sources of revenue to cover the fixed costs of generators, as are payments for the provision of black start and reactive services. Thus, in a perfectly competitive market in long-run equilibrium, with energy, capacity and ancillary service revenues, net revenue from all sources would be expected to equal the annualized fixed costs of generation for the marginal unit. Net revenue is a measure of whether generators are receiving competitive returns on invested capital and of

whether market prices are high enough to encourage entry of new capacity. In actual wholesale power markets, where equilibrium seldom occurs, net revenue is expected to fluctuate above and below the equilibrium level based on actual conditions in all relevant markets.

Net revenues are significantly affected by energy prices, fuel prices and capacity prices. The real-time load-weighted average LMP was 47.4 percent lower in the first three months of 2016 than in the first three months of 2015, \$26.80 per MWh versus \$50.91 per MWh. Coal and natural gas prices decreased in 2016. Comparing fuel prices in the first three months of 2016 to the first three months of 2015, the price of Northern Appalachian coal was 22.7 percent lower; the price of Central Appalachian coal was 15.5 percent lower; the price of Powder River Basin coal was 11.0 percent lower; the price of eastern natural gas was 67.2 percent lower; and the price of western natural gas was 32.1 percent lower (Figure 7-1).

Figure 7-1 Energy market net revenue factor trends: 2009 through March 2016

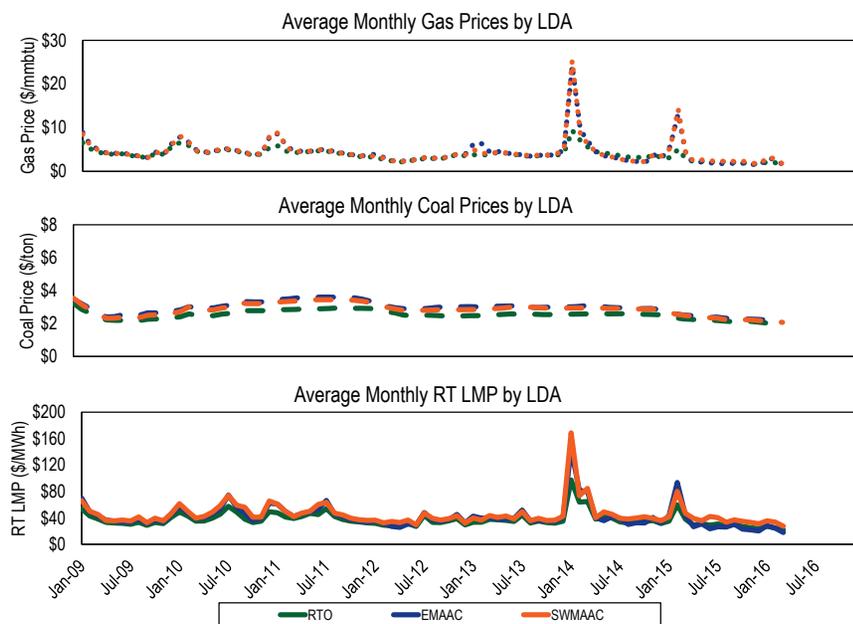

## Spark Spreads, Dark Spreads, and Quark Spreads

The spark, dark, or quark spread is defined as the difference between the LMP received for selling power and the cost of fuel used to generate power converted to a cost per MWh. The spark spread compares power prices to the cost of gas, the dark spread compares power prices to the cost of coal, and the quark spread compares power prices to the cost of uranium. The spread is a measure of the approximate difference between revenues and marginal costs and is an indicator of net revenue and profitability.


$$Spread \left( \frac{\$}{MWh} \right) = LMP \left( \frac{\$}{MWh} \right) - Fuel Price \left( \frac{\$}{mmBtu} \right) * Heat Rate \left( \frac{mmBtu}{MWh} \right)$$

Spread volatility is a result of fluctuations in LMP and the price of fuel. Spreads can be positive or negative.

Figure 7-2 shows the hourly spark spread for peak hours since January 2011 for BGE, ComEd, PSEG, and Western Hub.<sup>1</sup>


<sup>1</sup> Spark spreads use a combined cycle heat rate of 7,500 Btu/kWh, zonal hourly LMPs and daily gas prices; Chicago City Gate for ComEd, Zone 6 Non-NY for BGE, Zone 6 NY for PSEG, and Texas Eastern M3 for Western Hub.

Figure 7-2 Hourly spark spread (gas) for peak hours: 2011 through March 2016<sup>2</sup>

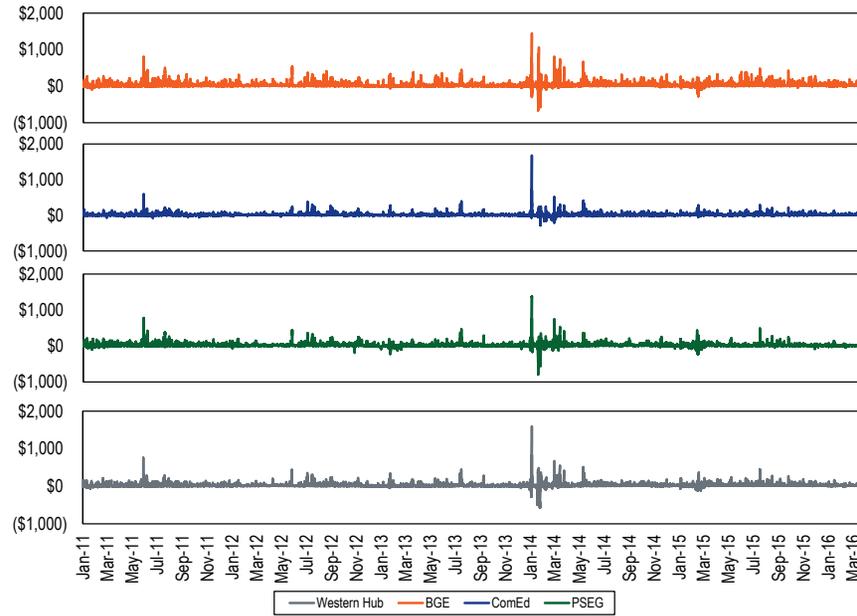


<sup>2</sup> The maximum peak hour spark spread for ComEd and Western Hub extends beyond the axis and was \$1,674.45 and \$1,590.66.

Figure 7-3 Hourly dark spread (coal) for peak hours: 2011 through March 2016<sup>3</sup>

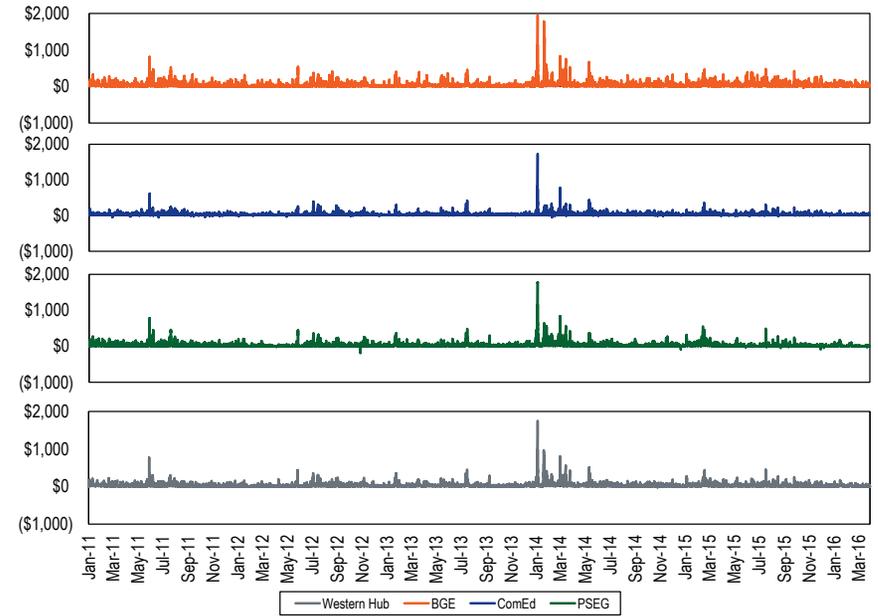

<sup>3</sup> Dark spreads use a heat rate of 10,000 Btu/kWh, zonal hourly LMPs and daily coal prices; Powder River Basin coal for ComEd, Northern Appalachian coal for BGE and Western Hub, and Central Appalachian coal for PSEG.

**Figure 7-4 Hourly quark spread (uranium) for selected zones: 2011 through March 2016<sup>4</sup>**

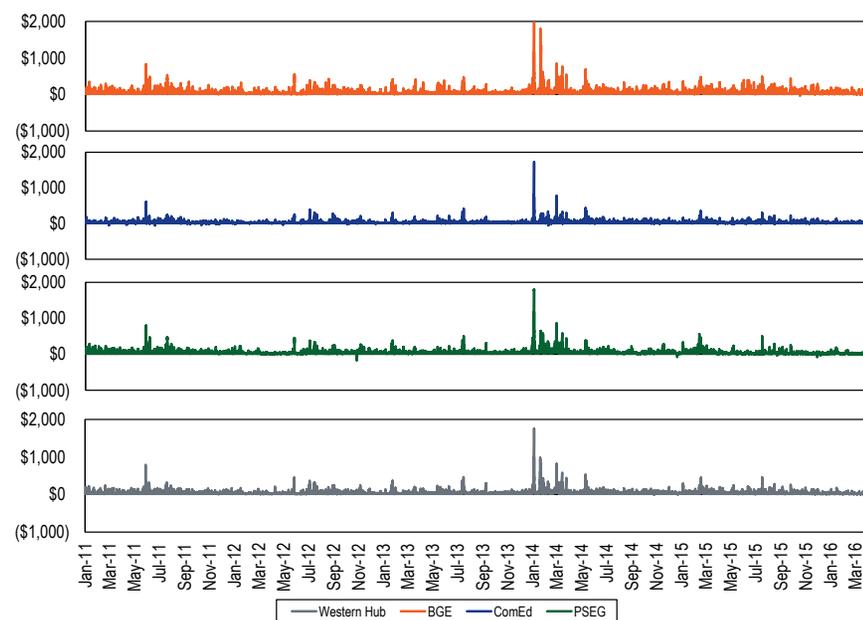

## Theoretical Energy Market Net Revenue

The net revenues presented in this section are theoretical as they are based on explicitly stated assumptions about how a new unit with specific characteristics would operate under economic dispatch. The economic dispatch uses technology specific operating constraints in the calculation of a new entrant's operations and potential net revenue in PJM markets. All technology specific, zonal net revenue calculations included in the new entrant net revenue analysis in this section are based on this economic dispatch scenario.

<sup>4</sup> Quark spreads use a heat rate of 10,000 Btu/kWh, zonal hourly LMPs, and daily uranium prices.

Analysis of energy market net revenues for a new entrant includes seven power plant configurations:

- The CT plant has an installed capacity of 641.2 MW and consists of two GE Frame 7HA.02 CTs, equipped with full inlet air mechanical refrigeration and selective catalytic reduction (SCR) for NO<sub>x</sub> reduction.
- The CC plant has an installed capacity of 971.4 MW and consists of two GE Frame 7HA.02 CTs equipped with evaporative cooling, duct burners, a heat recovery steam generator (HRSG) for each CT with steam reheat and SCR for NO<sub>x</sub> reduction with a single steam turbine generator.<sup>5</sup>
- The CP has an installed capacity of 600.0 MW and is a sub-critical steam unit, equipped with selective catalytic reduction system (SCR) for NO<sub>x</sub> control, a flue gas desulphurization (FGD) system with chemical injection for SO<sub>x</sub> and mercury control, and a bag-house for particulate control.
- The DS plant has an installed capacity of 2.0 MW and consists of one oil fired CAT 2 MW unit using New York Harbor ultra low sulfur diesel.
- The nuclear plant has an installed capacity of 2,200 MW and consists of two units and related facilities using the Westinghouse AP1000 technology.
- The wind installation consists of twenty two Siemens 2.3 MW wind turbines totaling 50.6 MW installed capacity.
- The solar installation consists of a 60 acre ground mounted solar farm totaling 10 MW of AC capacity.

Net revenue calculations for the CT, CC and CP include the hourly effect of actual local ambient air temperature on plant heat rates and generator output for each of the three plant configurations.<sup>6 7</sup> Plant heat rates account for the efficiency changes and corresponding cost changes resulting from ambient air temperatures.

<sup>5</sup> The duct burner firing dispatch rate is developed using the same methodology as for the unfired dispatch rate, with adjustments to the duct burner fired heat rate and output.

<sup>6</sup> Hourly ambient conditions supplied by Schneider Electric.

<sup>7</sup> Heat rates provided by Pasteris Energy, Inc. No-load costs are included in the dispatch price since each unit type is dispatched at full load for every economic hour resulting in a single offer point.

CO<sub>2</sub>, NO<sub>x</sub> and SO<sub>2</sub> emission allowance costs are included in the hourly plant dispatch cost, the short run marginal cost. CO<sub>2</sub>, NO<sub>x</sub> and SO<sub>2</sub> emission allowance costs were obtained from daily spot cash prices.<sup>8</sup>

A forced outage rate for each class of plant was calculated from PJM data and incorporated into all revenue calculations.<sup>9</sup> Each CT, CC, CP, and DS plant was assumed to take a continuous 14 day planned annual outage in the fall season.

Zonal net revenues reflect zonal fuel costs based on locational fuel indices and zone specific delivery charges.<sup>10</sup> The delivered fuel cost for natural gas reflects the zonal, daily delivered price of natural gas and is from published commodity daily cash prices, with a basis adjustment for transportation costs.<sup>11</sup> The delivered cost of coal reflects the zone specific, delivered price of coal and was developed from the published prompt-month price, adjusted for rail transportation cost.<sup>12</sup>

Short run marginal cost includes fuel costs, emissions costs, and VOM costs.<sup>13 14</sup> Average short run marginal costs are shown in Table 7-1.

**Table 7-1 Average short run marginal costs: 2016**

Unit Type	Short Run Marginal Costs (\$/MWh)	Heat Rate (Btu/kWh)	VOM (\$/MWh)
CT	\$26.79	9,437	\$0.25
CC	\$19.94	6,679	\$1.00
CP	\$24.34	9,250	\$4.00
DS	\$80.48	9,660	\$0.25
Nuclear	\$8.50	NA	\$3.00
Wind	\$0.00	NA	\$0.00
Solar	\$0.00	NA	\$0.00

<sup>8</sup> CO<sub>2</sub>, NO<sub>x</sub> and SO<sub>2</sub> emission daily prompt prices obtained from Evolution Markets, Inc.

<sup>9</sup> Outage figures obtained from the PJM eGADS database.

<sup>10</sup> Startup fuel burns and emission rates provided by Pasteris Energy, Inc. Startup station power consumption costs were obtained from the station service rates published quarterly by PJM and netted against the MW produced during startup at the preceding applicable hourly LMP. All starts associated with combined cycle units are assumed to be hot starts.

<sup>11</sup> Gas daily cash prices obtained from Platts.


<sup>12</sup> Coal prompt prices obtained from Platts.

<sup>13</sup> Fuel costs are calculated using the daily spot price and may not equal what participants actually paid.

<sup>14</sup> VOM rates provided by Pasteris Energy, Inc.

A comparison of the short run marginal cost of the theoretical CT, CC and CP plants since January 2009 shows that the CC plant has been competitive with the CP plant but that the costs of the CC plant have been more volatile than the costs of the CP plant as a result of the higher volatility of gas prices compared to coal prices (Figure 7-5). A significant increase in gas prices on cold days resulted in a corresponding increase in the average short run marginal cost of CTs and CCs in January 2014 and February 2015 (Figure 7-5).

**Figure 7-5 Average short run marginal costs: 2009 through March 2016**

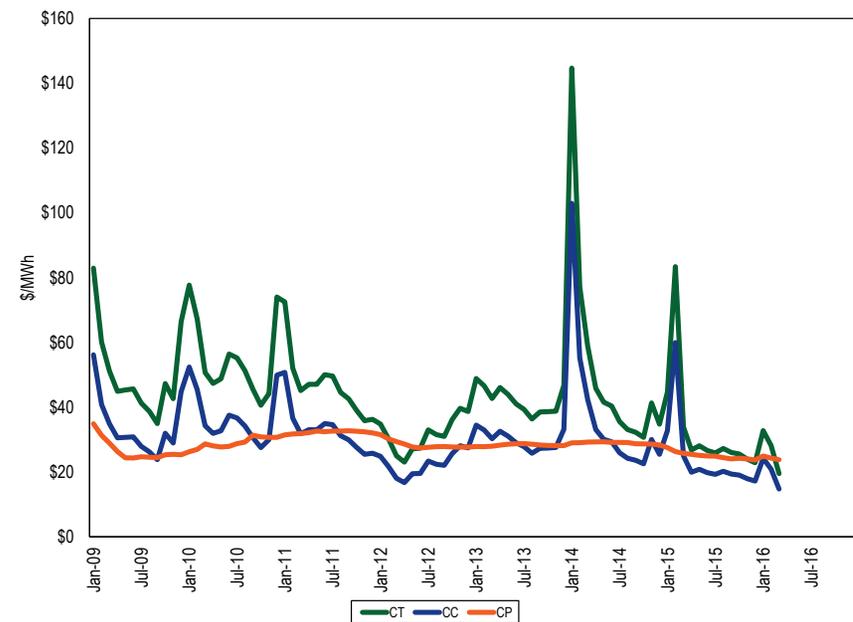

The net revenue measure does not include the potentially significant contribution from the explicit or implicit sale of the option value of physical units or from bilateral agreements to sell output at a price other than the PJM day-ahead or real-time energy market prices, e.g., a forward price.

## New Entrant Combustion Turbine

Energy market net revenue was calculated for a CT plant economically dispatched by PJM. It was assumed that the CT plant had a minimum run time of four hours. The unit was first committed day ahead in profitable blocks of at least four hours, including start costs. If the unit was not already committed day ahead, it was run in real time in standalone profitable blocks of at least four hours, or any profitable hours bordering the profitable day ahead or real time block.

New entrant CT plant energy market net revenues were lower in all zones except BGE and Pepco in the first three months of 2016 (Table 7-2). In BGE and Pepco the new entrant CT ran for more than twice as many hours in the first three months of 2016 than in the first three months of 2015 as a result of lower gas costs.

**Table 7-2 Energy net revenue for a new entrant gas fired CT under economic dispatch (Dollars per installed MW-year)<sup>15</sup>**

Zone	2009 (Jan-Mar)	2010 (Jan-Mar)	2011 (Jan-Mar)	2012 (Jan-Mar)	2013 (Jan-Mar)	2014 (Jan-Mar)	2015 (Jan-Mar)	2016 (Jan-Mar)	Change in 2016 from 2015
AECO	\$2,728	\$836	\$9,202	\$7,517	\$3,214	\$30,264	\$13,722	\$5,005	(64%)
AEP	\$1,901	\$621	\$3,123	\$8,528	\$3,199	\$48,084	\$19,634	\$5,771	(71%)
AP	\$6,017	\$2,409	\$12,201	\$11,591	\$4,730	\$65,810	\$36,706	\$8,092	(78%)
ATSI	NA	NA	\$0	\$8,891	\$3,653	\$54,456	\$19,993	\$5,756	(71%)
BGE	\$3,358	\$1,204	\$5,747	\$15,513	\$5,058	\$32,712	\$9,300	\$18,204	96%
ComEd	\$683	\$194	\$857	\$3,157	\$1,116	\$19,735	\$6,229	\$1,180	(81%)
DAY	\$1,047	\$331	\$3,039	\$9,388	\$3,194	\$47,524	\$17,257	\$5,136	(70%)
DEOK	NA	NA	NA	\$6,331	\$2,085	\$44,695	\$24,316	\$11,439	(53%)
DLCO	\$456	\$2,513	\$3,104	\$9,158	\$2,266	\$41,566	\$12,491	\$5,471	(56%)
Dominion	\$5,632	\$5,929	\$5,031	\$10,436	\$6,543	\$26,374	\$11,232	\$7,977	(29%)
DPL	\$3,661	\$779	\$5,614	\$12,059	\$2,838	\$32,143	\$13,114	\$9,476	(28%)
EKPC	NA	NA	NA	NA	\$0	\$45,421	\$23,459	\$10,693	(54%)
JCPL	\$2,577	\$1,719	\$10,060	\$7,622	\$5,970	\$34,426	\$15,452	\$2,566	(83%)
Met-Ed	\$2,371	\$710	\$7,093	\$6,542	\$3,058	\$28,211	\$13,333	\$2,958	(78%)
PECO	\$2,452	\$881	\$8,652	\$6,738	\$2,386	\$28,475	\$13,131	\$2,340	(82%)
PENELEC	\$3,650	\$1,326	\$10,947	\$10,488	\$7,549	\$79,708	\$59,869	\$12,109	(80%)
Pepco	\$3,268	\$2,062	\$5,965	\$13,821	\$5,302	\$32,626	\$7,748	\$12,071	56%
PPL	\$2,204	\$880	\$10,269	\$6,045	\$2,517	\$34,732	\$13,827	\$2,740	(80%)
PSEG	\$919	\$328	\$3,851	\$4,562	\$1,946	\$17,568	\$6,992	\$812	(88%)
RECO	\$461	\$298	\$2,296	\$3,872	\$3,442	\$18,173	\$9,147	\$1,129	(88%)
PJM	\$2,552	\$1,354	\$5,947	\$8,540	\$3,503	\$38,135	\$17,348	\$6,546	(62%)

<sup>15</sup> The energy net revenues presented for the PJM area in this section represent the zonal average energy net revenues.

## New Entrant Combined Cycle

Energy market net revenue was calculated for a CC plant economically dispatched by PJM. It was assumed that the CC plant had a minimum run time of eight hours. The unit was first committed day-ahead in profitable blocks of at least eight hours, including start costs.<sup>16</sup> If the unit was not already committed day ahead, it was run in real time in standalone profitable blocks of at least eight hours, or any profitable hours bordering the profitable day-ahead or real-time block.

New entrant CC plant energy market net revenues were lower in all zones except BGE and Pepco in the first three months of 2016 (Table 7-3). In BGE and Pepco the new entrant CC ran for more hours in the first three months of 2016 than in the first three months of 2015 as a result of lower gas costs.

**Table 7-3 Energy net revenue for a new entrant CC under economic dispatch (Dollars per installed MW-year)<sup>17</sup>**

Zone	2009 (Jan-Mar)	2010 (Jan-Mar)	2011 (Jan-Mar)	2012 (Jan-Mar)	2013 (Jan-Mar)	2014 (Jan-Mar)	2015 (Jan-Mar)	2016 (Jan-Mar)	Change in 2016 from 2015
AECO	\$12,504	\$7,650	\$23,944	\$20,898	\$13,647	\$56,633	\$29,158	\$11,317	(61%)
AEP	\$5,215	\$3,277	\$13,838	\$22,216	\$15,740	\$65,957	\$32,327	\$14,302	(56%)
AP	\$17,657	\$8,782	\$29,151	\$25,351	\$19,220	\$88,769	\$51,238	\$17,210	(66%)
ATSI	NA	NA	\$0	\$22,945	\$17,203	\$75,316	\$33,610	\$14,189	(58%)
BGE	\$13,494	\$9,004	\$17,981	\$29,349	\$19,030	\$61,497	\$18,447	\$29,746	61%
ComEd	\$2,565	\$456	\$3,135	\$13,158	\$5,354	\$24,423	\$11,231	\$6,171	(45%)
DAY	\$3,506	\$1,934	\$13,084	\$23,184	\$16,421	\$65,549	\$30,270	\$14,125	(53%)
DEOK	NA	NA	NA	\$19,654	\$12,964	\$62,412	\$37,950	\$21,571	(43%)
DLCO	\$2,172	\$4,036	\$11,553	\$22,591	\$12,417	\$55,522	\$22,933	\$13,448	(41%)
Dominion	\$19,787	\$15,018	\$18,479	\$24,097	\$18,064	\$47,378	\$20,917	\$16,657	(20%)
DPL	\$13,710	\$5,448	\$19,168	\$25,392	\$14,206	\$58,992	\$26,208	\$17,888	(32%)
EKPC	NA	NA	NA	NA	\$0	\$62,362	\$36,811	\$20,764	(44%)
JCPL	\$12,929	\$7,674	\$25,248	\$21,166	\$17,261	\$64,421	\$31,063	\$8,505	(73%)
Met-Ed	\$10,131	\$6,078	\$19,322	\$19,502	\$12,766	\$54,369	\$24,758	\$8,569	(65%)
PECO	\$10,974	\$6,713	\$23,065	\$19,889	\$11,677	\$54,796	\$28,134	\$7,544	(73%)
PENELEC	\$13,226	\$6,336	\$27,396	\$24,519	\$23,697	\$106,773	\$70,517	\$21,708	(69%)
Pepco	\$12,033	\$9,781	\$17,384	\$27,686	\$19,412	\$57,616	\$15,827	\$22,337	41%
PPL	\$9,837	\$5,769	\$21,396	\$18,699	\$11,602	\$55,366	\$26,697	\$8,872	(67%)
PSEG	\$8,516	\$5,996	\$13,942	\$14,952	\$9,112	\$38,580	\$14,493	\$3,070	(79%)
RECO	\$6,018	\$4,820	\$8,026	\$13,976	\$11,276	\$40,300	\$14,856	\$3,950	(73%)
PJM	\$10,251	\$6,398	\$17,006	\$21,538	\$14,053	\$59,852	\$28,872	\$14,097	(51%)

<sup>16</sup> All starts associated with combined cycle units are assumed to be warm starts.

<sup>17</sup> The energy net revenues presented for the PJM area in this section represent the zonal average energy net revenues.

## New Entrant Coal Plant

Energy market net revenue was calculated assuming that the CP plant had a 24-hour minimum run time and was dispatched day ahead by PJM for all available plant hours. The calculations include operating reserve credits based on PJM rules, when applicable, since the assumed operation is at the direction of PJM. The regulation clearing price was compared to the day ahead LMP. If the reference CP could provide regulation more profitably than energy, the unit was assumed to provide regulation during that hour.

New entrant CP plant energy market net revenues were lower in all zones in the first three months of 2016 (Table 7-4).

**Table 7-4 Energy net revenue for a new entrant CP (Dollars per installed MW-year)<sup>18</sup>**

Zone	2009 (Jan-Mar)	2010 (Jan-Mar)	2011 (Jan-Mar)	2012 (Jan-Mar)	2013 (Jan-Mar)	2014 (Jan-Mar)	2015 (Jan-Mar)	2016 (Jan-Mar)	Change in 2016 from 2015
AECO	\$43,215	\$41,590	\$36,063	\$2,675	\$13,783	\$143,988	\$58,708	\$6,896	(88%)
AEP	\$16,803	\$29,638	\$21,699	\$3,597	\$16,892	\$82,244	\$27,081	\$10,291	(62%)
AP	\$35,826	\$40,552	\$33,649	\$5,402	\$19,131	\$102,926	\$45,528	\$3,261	(93%)
ATSI	NA	NA	\$0	\$3,649	\$17,503	\$90,714	\$29,110	\$7,939	(73%)
BGE	\$46,577	\$51,492	\$40,197	\$9,897	\$23,506	\$156,913	\$62,899	\$15,396	(76%)
ComEd	\$36,166	\$40,706	\$34,460	\$25,552	\$31,957	\$87,058	\$35,291	\$18,715	(47%)
DAY	\$14,485	\$27,375	\$20,446	\$1,419	\$17,757	\$82,450	\$27,073	\$7,647	(72%)
DEOK	NA	NA	NA	\$619	\$14,454	\$76,026	\$23,975	\$6,783	(72%)
DLCO	\$9,716	\$23,675	\$10,308	\$1,926	\$9,653	\$66,530	\$17,819	\$7,638	(57%)
Dominion	\$41,068	\$50,166	\$36,153	\$5,034	\$20,582	\$127,290	\$58,725	\$18,205	(69%)
DPL	\$47,268	\$46,314	\$42,948	\$7,948	\$19,736	\$159,791	\$72,097	\$8,635	(88%)
EKPC	NA	NA	NA	NA	\$0	\$75,988	\$22,964	\$6,066	(74%)
JCPL	\$43,327	\$41,795	\$36,913	\$2,664	\$16,833	\$150,288	\$59,850	\$6,110	(90%)
Met-Ed	\$43,283	\$44,209	\$37,718	\$3,371	\$17,543	\$143,912	\$57,928	\$6,470	(89%)
PECO	\$41,572	\$40,698	\$35,350	\$2,336	\$12,341	\$141,628	\$57,588	\$5,821	(90%)
PENELEC	\$30,086	\$33,010	\$25,545	\$2,745	\$17,876	\$107,488	\$44,858	\$7,531	(83%)
Pepco	\$42,835	\$47,934	\$33,287	\$5,135	\$19,073	\$149,835	\$57,241	\$8,921	(84%)
PPL	\$39,552	\$39,126	\$33,557	\$1,684	\$12,376	\$140,691	\$56,463	\$6,000	(89%)
PSEG	\$46,936	\$43,883	\$37,602	\$3,241	\$24,438	\$163,942	\$69,545	\$7,539	(89%)
RECO	\$43,612	\$40,865	\$30,456	\$2,816	\$30,378	\$161,280	\$70,870	\$6,292	(91%)
PJM	\$36,607	\$40,178	\$30,353	\$4,827	\$17,791	\$120,549	\$47,781	\$8,608	(82%)

<sup>18</sup> The energy net revenues presented for the PJM area in this section represent the zonal average energy net revenues.

## New Entrant Diesel

Energy market net revenue was calculated for a DS plant economically dispatched by PJM in real time.

New entrant DS plant energy market net revenues were lower in all zones in the first three months of 2016 (Table 7-5).

**Table 7-5 Energy market net revenue for a new entrant DS (Dollars per installed MW-year)**

Zone	2009 (Jan-Mar)	2010 (Jan-Mar)	2011 (Jan-Mar)	2012 (Jan-Mar)	2013 (Jan-Mar)	2014 (Jan-Mar)	2015 (Jan-Mar)	2016 (Jan-Mar)	Change in 2016 from 2015
AECO	\$1,555	\$780	\$928	\$8	\$262	\$36,066	\$11,926	\$2,843	(76%)
AEP	\$100	\$94	\$9	\$0	\$99	\$15,382	\$3,059	\$603	(80%)
AP	\$808	\$224	\$13	\$0	\$127	\$20,072	\$6,840	\$860	(87%)
ATSI	NA	NA	\$0	\$0	\$97	\$15,092	\$2,727	\$484	(82%)
BGE	\$2,596	\$1,572	\$975	\$136	\$592	\$53,670	\$11,187	\$3,937	(65%)
ComEd	\$7	\$73	\$0	\$0	\$74	\$12,076	\$1,747	\$266	(85%)
DAY	\$174	\$92	\$97	\$0	\$87	\$15,130	\$2,559	\$440	(83%)
DEOK	NA	NA	NA	\$0	\$74	\$14,306	\$2,105	\$609	(71%)
DLCO	\$65	\$1,547	\$8	\$0	\$78	\$13,813	\$2,489	\$501	(80%)
Dominion	\$2,696	\$2,149	\$1,062	\$134	\$468	\$46,239	\$10,055	\$2,192	(78%)
DPL	\$2,442	\$1,175	\$898	\$19	\$290	\$40,857	\$14,788	\$3,104	(79%)
EKPC	NA	NA	NA	NA	\$0	\$15,363	\$2,304	\$871	(62%)
JCPL	\$1,348	\$732	\$1,192	\$22	\$453	\$36,332	\$12,736	\$799	(94%)
Met-Ed	\$1,424	\$758	\$782	\$4	\$251	\$35,247	\$11,621	\$746	(94%)
PECO	\$1,402	\$755	\$847	\$9	\$252	\$35,496	\$11,794	\$728	(94%)
PENELEC	\$203	\$109	\$11	\$0	\$123	\$17,773	\$5,626	\$542	(90%)
Pepco	\$2,925	\$1,882	\$1,215	\$137	\$667	\$55,675	\$10,096	\$2,212	(78%)
PPL	\$1,297	\$706	\$920	\$48	\$255	\$36,173	\$12,432	\$702	(94%)
PSEG	\$1,210	\$672	\$847	\$9	\$325	\$35,956	\$12,238	\$910	(93%)
RECO	\$940	\$530	\$524	\$0	\$1,466	\$33,335	\$13,957	\$887	(94%)
PJM	\$1,247	\$815	\$574	\$28	\$302	\$29,203	\$8,114	\$1,212	(85%)

## New Entrant Nuclear Plant

Energy market net revenue was calculated assuming that the nuclear plant was dispatched day ahead by PJM for all available plant hours. The unit runs for all hours of the year other than forced outage hours.<sup>19</sup>

New entrant nuclear plant energy market net revenues were lower in all zones in the first three months of 2016 (Table 7-6).

**Table 7-6 Energy net revenue for a new entrant nuclear plant (Dollars per installed MW-year)<sup>20</sup>**

Zone	2009 (Jan-Mar)	2010 (Jan-Mar)	2011 (Jan-Mar)	2012 (Jan-Mar)	2013 (Jan-Mar)	2014 (Jan-Mar)	2015 (Jan-Mar)	2016 (Jan-Mar)	Change in 2016 from 2015
AECO	\$101,789	\$91,719	\$95,005	\$49,465	\$62,135	\$209,062	\$105,885	\$34,600	(67%)
AEP	\$69,992	\$68,828	\$63,740	\$45,781	\$55,242	\$130,923	\$67,640	\$39,173	(42%)
AP	\$85,930	\$79,042	\$76,989	\$48,737	\$58,231	\$153,609	\$86,634	\$42,088	(51%)
ATSI	NA	NA	\$0	\$46,380	\$56,419	\$140,042	\$68,786	\$38,969	(43%)
BGE	\$102,425	\$98,153	\$92,808	\$57,792	\$68,082	\$219,233	\$107,545	\$60,976	(43%)
ComEd	\$57,229	\$58,837	\$54,172	\$40,561	\$48,679	\$112,295	\$54,074	\$33,044	(39%)
DAY	\$66,782	\$66,322	\$63,005	\$46,714	\$55,805	\$130,464	\$65,467	\$38,864	(41%)
DEOK	NA	NA	NA	\$43,474	\$52,104	\$123,359	\$62,074	\$37,723	(39%)
DLCO	\$60,313	\$67,382	\$59,001	\$46,158	\$52,319	\$118,934	\$57,909	\$38,182	(34%)
Dominion	\$96,423	\$96,719	\$88,445	\$51,477	\$64,809	\$186,500	\$103,011	\$49,495	(52%)
DPL	\$103,176	\$92,441	\$95,787	\$53,757	\$63,861	\$222,427	\$117,363	\$48,071	(59%)
EKPC	NA	NA	NA	NA	\$0	\$123,312	\$60,945	\$36,931	(39%)
JCPL	\$101,904	\$91,945	\$95,926	\$49,706	\$65,740	\$216,025	\$106,900	\$31,736	(70%)
Met-Ed	\$98,776	\$90,099	\$90,065	\$47,971	\$61,337	\$204,718	\$101,495	\$31,864	(69%)
PECO	\$99,985	\$90,734	\$94,229	\$48,462	\$60,336	\$206,442	\$104,527	\$30,713	(71%)
PENELEC	\$84,307	\$77,735	\$76,824	\$48,205	\$61,776	\$164,320	\$87,695	\$36,932	(58%)
Pepco	\$101,387	\$98,734	\$91,988	\$56,101	\$68,248	\$215,636	\$105,010	\$53,225	(49%)
PPL	\$97,737	\$88,977	\$92,223	\$47,319	\$60,379	\$205,302	\$103,167	\$32,157	(69%)
PSEG	\$103,610	\$94,408	\$98,713	\$50,323	\$77,497	\$232,843	\$114,967	\$34,266	(70%)
RECO	\$99,961	\$91,080	\$90,901	\$49,349	\$84,198	\$229,734	\$116,341	\$33,258	(71%)
PJM	\$90,102	\$84,891	\$78,879	\$48,828	\$58,860	\$177,259	\$89,872	\$39,113	(56%)

<sup>19</sup> The class average forced outage rate was applied to total energy market net revenues.

<sup>20</sup> The energy net revenues presented for the PJM area in this section represent the zonal average energy net revenues.

## New Entrant Wind Installation

Energy market net revenues for a wind installation located in the ComEd and PENELEC zones were calculated hourly assuming the unit was generating at the average capacity factor if 75 percent of existing wind units in the zone were generating power in that hour. Energy market net revenues for a wind installation include revenue from the Production Tax Credit (PTC) of \$23 per MWh and from Renewable Energy Certificates (RECs) of \$0.88/MWh in ComEd and \$16.42/MWh in PENELEC.<sup>21</sup>

Wind energy market net revenues were lower in the first three months of 2016 (Table 7-7).

**Table 7-7 Net revenue for a wind installation (Dollars per installed MW-year)**

Zone	2012 (Jan-Mar)			2013 (Jan-Mar)			2014 (Jan-Mar)			2015 (Jan-Mar)			2016 (Jan-Mar)			Percent Change in 2016 Total Revenue
	Energy	Credits	Total													
ComEd	23,623	-	23,623	25,851	-	25,851	43,854	24,996	68,851	28,135	22,067	50,203	21,040	24,674	45,714	(9%)
PENELEC	22,839	19,853	42,692	30,815	26,413	57,228	64,765	30,659	95,424	42,934	32,454	75,388	21,002	34,457	55,459	(26%)

## New Entrant Solar Installation

Energy market net revenues for a solar installation located in the PSEG Zone were calculated hourly assuming the unit was generating at the average hourly capacity factor if 75 percent of existing solar units in the zone were generating power in that hour. Energy market net revenues for a solar installation in New Jersey include revenue from Solar Renewable Energy Certificates (SRECs) of \$193.70/MWh.<sup>22</sup>

Solar energy market net revenues were slightly lower in the first three months of 2016 (Table 7-8).

**Table 7-8 PSEG Energy Market net revenue for a solar installation (Dollars per installed MW-year)**

Zone	2012 (Jan-Mar)			2013 (Jan-Mar)			2014 (Jan-Mar)			2015 (Jan-Mar)			2016 (Jan-Mar)			Percent Change in 2016 Total Revenue
	Energy	Credits	Total													
PSEG	6,525	55,616	62,141	14,810	54,369	69,179	38,446	55,267	93,713	22,335	63,337	85,672	8,396	75,965	84,361	(2%)

<sup>21</sup> REC prices provided by Evolution Markets.  
<sup>22</sup> SREC prices provided by Evolution Markets.



## Environmental and Renewable Energy Regulations

Environmental requirements and renewable energy mandates have a significant impact on PJM markets.

At the federal level, the Mercury and Air Toxics Standards Rule (MATS) requires significant investments for some fossil fuel fired power plants in the PJM footprint in order to reduce heavy metal emissions. The EPA has promulgated intrastate and interstate air quality standards and associated emissions limits for states. The Cross-State Air Pollution Rule (CSAPR) will require investments for some fossil fuel fired power plants in the PJM footprint in order to reduce SO<sub>2</sub> and NO<sub>x</sub> emissions.

State regulations and multi-state agreements have an impact on PJM markets. New Jersey's high electric demand day (HEDD) rule limits NO<sub>x</sub> emissions on peak energy demand days and requires investments for noncompliant units. CO<sub>2</sub> costs resulting from the Regional Greenhouse Gas Initiative (RGGI) affect some unit offers in the PJM energy market.

The investments required for environmental compliance have resulted in higher offers in the Capacity Market, and when units do not clear, in the retirement of units. Federal and state renewable energy mandates and associated incentives have resulted in the construction of substantial amounts of renewable capacity in the PJM footprint, especially wind and solar powered resources. Renewable energy credit (REC) markets created by state programs and federal tax credits have significant impacts on PJM wholesale markets.

### Overview

#### Federal Environmental Regulation

- **EPA Mercury and Air Toxics Standards Rule.** On December 16, 2011, the U.S. Environmental Protection Agency (EPA) issued its Mercury and Air Toxics Standards rule (MATS), which applies the Clean Air Act (CAA) maximum achievable control technology (MACT) requirement to new or

modified sources of emissions of mercury and arsenic, acid gas, nickel, selenium and cyanide.<sup>1</sup> The rule established a compliance deadline of April 16, 2015.

In a related EPA rule also issued on December 16, 2011, regarding utility New Source Performance Standards (NSPS), the EPA requires new coal and oil fired electric utility generating units constructed after May 3, 2011, to comply with amended emission standards for SO<sub>2</sub>, NO<sub>x</sub> and filterable particulate matter (PM).

On June 29, 2015, the U.S. Supreme Court remanded MATS to the D.C. Circuit Court and ordered the EPA to consider cost earlier in the process when making the decision whether to regulate power plants under MATS.<sup>2</sup> On April 14, 2016, the EPA issued the finding that “a consideration of cost does not cause us to change our determination that regulation of hazardous air pollutant (HAP) emissions from coal- and oil-fired EGUs is appropriate and necessary.”<sup>3</sup>

- **Air Quality Standards (NO<sub>x</sub> and SO<sub>2</sub> Emissions).** The CAA requires each state to attain and maintain compliance with fine PM and ozone national ambient air quality standards (NAAQS). Much recent regulatory activity concerning emissions has concerned the development and implementation of a transport rule to address the CAA's requirement that each state prohibit emissions that significantly interfere with the ability of another state to meet NAAQS.<sup>4</sup>

On April 29, 2014, the U.S. Supreme Court upheld the EPA's Cross-State Air Pollution Rule (CSAPR) and on October 23, 2014, the U.S. Court of Appeals for the District of Columbia Circuit lifted the stay imposed on CSAPR, clearing the way for the EPA to implement this rule and to replace the Clean Air Interstate Rule (CAIR).<sup>5 6</sup>

<sup>1</sup> *National Emission Standards for Hazardous Air Pollutants From Coal and Oil-Fired Electric Utility Steam Generating Units and Standards of Performance for Fossil Fuel Fired Electric Utility, Industrial-Commercial-Institutional, and Small Industrial-Commercial-Institutional Steam Generating Units*, EPA Docket No. EPA-HQ-OAR-2009-0234, 77 Fed. Reg. 9304 (February 16, 2012).

<sup>2</sup> *Michigan et al. v. EPA*, Slip Op. No. 14-46.

<sup>3</sup> *Supplemental Finding that it is Appropriate and Necessary to Regulate Hazardous Air Pollutants from Coal- and Oil-Fired Electric Utility Steam Generating Units*, EPA Docket No. EPA-HQ-OAR-2009-0234; see also *White Stallion Energy Center, LLC v. EPA*, Slip Op. No. 12-1100 (D.C. Cir. 2015) (per curiam).

<sup>4</sup> CAA § 110(a)(2)(D)(i)(I).

<sup>5</sup> See *EPA et al. v. EME Homer City Generation, L.P. et al.*, 134 S. Ct. 1584 (2014), reversing 696 F.3d 7 (D.C. Cir. 2012).

<sup>6</sup> See *EME Homer City Generation, L.P. v. EPA et al.*, No. 11-1302.

In the same decision, the U.S. Supreme Court remanded “particularized as-applied challenge[s]” to the EPA’s 2014 emissions budgets.<sup>7</sup> On July 28, 2015, on remand, the U.S. Court of Appeals for the District of Columbia Circuit invalidated the 2014 SO<sub>2</sub> budgets for a number of states, including PJM states Maryland, New Jersey, North Carolina, Ohio, Pennsylvania, Virginia and West Virginia.<sup>8</sup> The court directed the EPA to reconsider the 2015 emissions budgets for these states based on the actual amount of reduced emissions that states in upwind states needed to attain in order to bring each downwind state into attainment.<sup>9</sup> Under the invalidated approach, the EPA calculated how much pollution each upwind state could eliminate if all of its sources applied pollution control at particular cost thresholds.<sup>10</sup> A new approach likely will significantly reduce the emission budgets (lower emissions levels will be allowed) for the indicated states. The court did not vacate the currently assigned budgets which remain effective until replaced.<sup>11</sup>

On November 21, 2014, the EPA issued a rule tolling by three years CSAPR’s original deadlines. The rule means that compliance with CSAPR’s Phase 1 emissions budgets is now required in 2015 and 2016 and CSAPR’s Phase 2 emissions in 2017 and beyond.<sup>12</sup>

- **National Emission Standards for Reciprocating Internal Combustion Engines.** On May 1, 2015, the U.S. Court of Appeals for the District of Columbia Circuit reversed the portion of the final rule exempting 100 hours of run time for certain stationary reciprocating internal combustion engines (RICE) participating in emergency demand response programs.<sup>13</sup> As a result, the national emissions standards uniformly apply to all RICE.<sup>14</sup> The Court held that the “EPA acted arbitrarily and capriciously when it modified the National Emissions Standards and the Performance Standards to allow backup generators to operate without emissions

<sup>7</sup> 134 S. Ct. at 1609.

<sup>8</sup> *EME Homer City Generation, L.P. v EPA et al.*, Slip Op. No. 11-1302 (July 28, 2015).

<sup>9</sup> *Id.* at 11-12.

<sup>10</sup> *Id.* at 11.

<sup>11</sup> *Emissions Budget Decision* at 24-25.

<sup>12</sup> *Rulemaking to Amend Dates in Federal Implementation Plans Addressing Interstate Transport of Ozone and Fine Particulate Matter*, EPA-HQ-OAR-2009-0491 (Nov. 21, 2014).

<sup>13</sup> *Delaware Department of Natural Resources and Environmental Control (DENREC) v. EPA*, Slip Op. No. 13-1093; *National Emission Standards for Hazardous Air Pollutants for Reciprocating Internal Combustion Engines; New Source Performance Standards for Stationary Internal Combustion Engines*, Final Rule, EPA Docket No. EPA-HQ-OAR-2008-0708, 78 Fed. Reg. 9403 (January 30, 2013).

<sup>14</sup> *Id.*

controls for up to 100 hours per year as part of an emergency demand-response program.”<sup>15</sup> Specifically, the Court found that the EPA failed to consider arguments concerning the rule’s “impact on the efficiency and reliability of the energy grid,” including arguments raised by the MMU.<sup>16</sup> On May 3, 2016, the Court issued a mandate to implement the May 1, 2015, order.

- **Greenhouse Gas Emissions Rule.** On August 3, 2015, the EPA issued a final rule for regulating CO<sub>2</sub> from certain existing power generation facilities titled *Carbon Pollution Emission Guidelines for Existing Stationary Sources: Electric Utility Generating Units (the Clean Power Plan)*.<sup>17</sup> The rule requires that individual state plans be submitted by September 6, 2016. However, on February 9, 2016, the U.S. Supreme Court issued a stay on the rule that will prevent its taking effect until judicial review is completed.<sup>18</sup>
- **Cooling Water Intakes.** The EPA has promulgated a rule implementing Section 316(b) of the Clean Water Act (CWA), which requires that cooling water intake structures reflect the best technology available for minimizing adverse environmental impacts.<sup>19</sup> The rule is implemented as National Pollutant Discharge Elimination System (NPDES) permits are issued, with exceptions in certain cases for permits expiring prior to July 14, 2018.
- **Waste Disposal.** On December 19, 2014, the EPA issued its Coal Combustion Residuals rule (CCRR), effective October 19, 2015. The CCRR likely will raise the costs of disposal of CCRs to meet the EPA criteria.

## State Environmental Regulation

- **NJ High Electric Demand Day (HEDD) Rule.** New Jersey addressed the issue of NO<sub>x</sub> emissions on peak energy demand days with a rule that defines peak energy usage days, referred to as high electric demand days

<sup>15</sup> *DENREC v. EPA* at 3, 20-21.

<sup>16</sup> *Id.* at 22, citing Comments of the Independent Market Monitor for PJM, EPA Docket No. EPA-HQ-OAR-2008-0708 (August 9, 2012) at 2.

<sup>17</sup> *Carbon Pollution Emission Guidelines for Existing Stationary Sources: Electric Utility Generating Units*, EPA-HQ-OAR-2013-0602, Final Rule *mimeo* (August 3, 2015), also known as the “Clean Power Plan.”

<sup>18</sup> *North Dakota v. EPA*, et al., Order 15A793.

<sup>19</sup> See EPA, *National Pollutant Discharge Elimination System—Final Regulations to Establish Requirements for Cooling Water Intake Structures at Existing Facilities and Amend Requirements at Phase I Facilities*, EPA-HQ-DW-2008-0667, 79 Fed. Reg. 48300 (Aug. 15, 2014).

or HEDD, and imposes operational restrictions and emissions control requirements on units responsible for significant NO<sub>x</sub> emissions on such high energy demand days.<sup>20</sup> New Jersey's HEDD rule, which became effective May 19, 2009, applies to HEDD units, which include units that have a NO<sub>x</sub> emissions rate on HEDD equal to or exceeding 0.15 lbs/MMBtu and lack identified emission control technologies.<sup>21</sup>

- **Illinois Air Quality Standards (NO<sub>x</sub>, SO<sub>2</sub> and Hg).** The State of Illinois has promulgated its own standards for NO<sub>x</sub>, SO<sub>2</sub> and Hg (mercury) known as Multi-Pollutant Standards ("MPS") and Combined Pollutants Standards ("CPS").<sup>22</sup> MPS and CPS establish standards that are more stringent and take effect earlier than comparable Federal regulations, such as the EPA MATS rule.
- **Regional Greenhouse Gas Initiative (RGGI).** The Regional Greenhouse Gas Initiative (RGGI) is a cooperative effort by Connecticut, Delaware, Maine, Maryland, Massachusetts, New Hampshire, New York, Rhode Island, and Vermont to cap CO<sub>2</sub> emissions from power generation facilities and facilitate trading of emissions allowances. Auction prices in the first three months of 2016 for the 2015–2017 compliance period were \$5.25 per ton. The clearing price is equivalent to a price of \$5.79 per metric tonne, the unit used in other carbon markets.

## Emissions Controls in PJM Markets

Environmental regulations affect decisions about emission control investments in existing units, investment in new units and decisions to retire units lacking emission controls. As a result of environmental regulations and agreements to limit emissions, many PJM units burning fossil fuels have installed emission control technology. On December 31, 2015, 76.7 percent of coal steam MW had some type of FGD (flue-gas desulfurization) technology to reduce SO<sub>2</sub> emissions, while 99.5 percent of coal steam MW had some type of particulate control, and 92.8 percent of fossil fuel fired capacity in PJM had NO<sub>x</sub> emission control technology.

<sup>20</sup> N.J.A.C. § 7:27–19.

<sup>21</sup> CTS must have either water injection or selective catalytic reduction (SCR) controls; steam units must have either an SCR or selective non-catalytic reduction (SNCR).

<sup>22</sup> 35 Ill. Admin. Code §§ 225.233 (Multi-Pollutant Standard (MPS)), 224.295 (Combined Pollutant Standard: Emissions Standards for NO<sub>x</sub> and SO<sub>2</sub> (CPS)).

## State Renewable Portfolio Standards

Many PJM jurisdictions have enacted legislation to require that a defined percentage of retail suppliers' load be served by renewable resources, for which there are many standards and definitions. These are typically known as renewable portfolio standards, or RPS. As of March 31, 2016, Delaware, Illinois, Maryland, Michigan, New Jersey, North Carolina, Ohio, Pennsylvania, and Washington D.C. had renewable portfolio standards. Virginia and Indiana have enacted voluntary renewable portfolio standards. Kentucky and Tennessee have not enacted renewable portfolio standards. Ohio delayed a scheduled increase from 2.5 percent to 3.5 percent in its RPS standards from 2015 until 2017 and removed the 12.5 percent alternative energy requirement. Ohio currently has an ongoing Ohio Energy Mandates Study Committee that is discussing the costs and benefits of the RPS as outlined in Senate Bill 310.<sup>23</sup> West Virginia had a voluntary standard, but the state Legislature repealed the West Virginia renewable portfolio standard on January 22, 2015.

## Conclusion

Environmental requirements and renewable energy mandates at both the federal and state levels have a significant impact on the cost of energy and capacity in PJM markets. Attempts to extend the definition of renewable energy to include nuclear power in order to provide subsidies to nuclear power could increase this impact if successful. Renewable energy credit markets are markets related to the production and purchase of wholesale power, but FERC has determined that RECs are not regulated under the Federal Power Act unless the REC is sold as part of a transaction that also includes a wholesale sale of electric energy in a bundled transaction.<sup>24</sup>

Renewable energy credits (RECs), federal investment tax credits and federal production tax credits provide out of market payments to qualifying resources, primarily wind and solar, which create an incentive to generate MWh until the LMP is equal to the marginal cost of producing power minus the credit

<sup>23</sup> See Ohio Senate Bill 310.

<sup>24</sup> See 139 FERC ¶ 61,061 at PP 18, 22 (2012) ("[W]e conclude that unbundled REC transactions fall outside of the Commission's jurisdiction under sections 201, 205 and 206 of the FPA. We further conclude that bundled REC transactions fall within the Commission's jurisdiction under sections 201, 205 and 206 of the FPA... [A]lthough a transaction may not directly involve the transmission or sale of electric energy, the transaction could still fall under the Commission's jurisdiction because it is "in connection with" or "affects" jurisdictional rates or charges.")

received for each MWh. The credits provide an incentive to make negative energy offers and more generally provide an incentive to operate whenever possible. These subsidies affect the offer behavior and the operational behavior of these resources in PJM markets and thus the market prices and the mix of clearing resources.

RECs clearly affect prices in the PJM wholesale power market. Some resources are not economic except for the ability to purchase or sell RECs. REC markets are not transparent. Data on REC prices and markets are not publicly available for all PJM states. RECs markets are, as an economic fact, integrated with PJM markets including energy and Capacity markets, but are not formally recognized as part of PJM markets.

PJM markets provide a flexible mechanism for incorporating the costs of environmental controls and meeting environmental requirements in a cost effective manner. Costs for environmental controls are part of bids for capacity resources in the PJM Capacity Market. The costs of emissions credits are included in energy offers. PJM markets also provide a flexible mechanism that incorporates renewable resources and the impacts of renewable energy credit markets, and ensure that renewable resources have access to a broad market. PJM markets provide efficient price signals that permit valuation of resources with very different characteristics when they provide the same product.

PJM markets could also provide a flexible mechanism for states to comply with the EPA's Clean Power Plan, for example by incorporating a carbon price in unit offers which would be reflected in PJM's economic dispatch. The imposition of specific and prescriptive environmental dispatch rules would, in contrast, pose a threat to economic dispatch and create very difficult market power monitoring and mitigation issues.

## Federal Environmental Regulation

The U.S. Environmental Protection Agency (EPA) administers the Clean Air Act (CAA), which, among other things, comprehensively regulates air emissions by establishing acceptable levels of and regulating emissions of hazardous air pollutants. The EPA issues technology based standards for major sources

and certain area sources of emissions.<sup>25</sup> <sup>26</sup> The EPA's actions have and will continue to affect the cost to build and operate generating units in PJM, which in turn affects wholesale energy prices and capacity prices.

The EPA also regulates water pollution, and its regulation of cooling water intakes under section 316(b) of the Clean Water Act (CWA) affects generating plants that rely on water drawn from jurisdictional water bodies.<sup>27</sup>

## Control of Mercury and Other Hazardous Air Pollutants

Section 112 of the CAA requires the EPA to promulgate emissions control standards, known as the National Emission Standards for Hazardous Air Pollutants (NESHAP), from both new and existing area and major sources.

On December 21, 2011, the U.S. Environmental Protection Agency (EPA) issued its Mercury and Air Toxics Standards rule (MATS), which applies the Clean Air Act (CAA) maximum achievable control technology (MACT) requirement to new or modified sources of emissions of mercury and arsenic, acid gas, nickel, selenium and cyanide.<sup>28</sup> The rule establishes a compliance deadline of April 16, 2015.

In a related EPA rule also issued on December 16, 2011, regarding utility New Source Performance Standards (NSPS), the EPA requires new coal and oil fired electric utility generating units constructed after May 3, 2011, to comply with amended emission standards for SO<sub>2</sub>, NO<sub>x</sub> and filterable particulate matter (PM).<sup>29</sup>

<sup>25</sup> 42 U.S.C. § 7401 et seq. (2000).

<sup>26</sup> The EPA defines "major sources" as a stationary source or group of stationary sources that emit or have the potential to emit 10 tons per year or more of a hazardous air pollutant or 25 tons per year or more of a combination of hazardous air pollutants. An "area source" is any stationary source that is not a major source.

<sup>27</sup> The CWA applies to "navigable waters," which are, in turn, defined to include the "waters of the United States, including territorial seas." 33 U.S.C. § 1362(7). An interpretation of this rule has created some uncertainty on the scope of the waters subject to EPA jurisdiction, (see *Rapanos v. U.S.*, et al., 547 U.S. 715 (2006)), which the EPA continues to attempt to resolve.

<sup>28</sup> *National Emission Standards for Hazardous Air Pollutants From Coal and Oil-Fired Electric Utility Steam Generating Units and Standards of Performance for Fossil Fuel Fired Electric Utility, Industrial-Commercial-Institutional, and Small Industrial-Commercial-Institutional Steam Generating Units*, EPA Docket No. EPA-HQ-OAR-2009-0234, 77 Fed. Reg. 9304 (February 16, 2012); *aff'd*, *White Stallion Energy Center, LLC v EPA*, No. 12-1100 (D.C. Cir. April 15, 2014).

<sup>29</sup> NSPS are promulgated under CAA § 111.

On June 29, 2015, the U.S. Supreme Court remanded MATS to the D.C. Circuit Court and ordered the EPA to consider cost earlier in the process when making the decision whether to regulate power plants under MATS.<sup>30</sup> On April 14, 2016, the EPA issued the required finding that “a consideration of cost does not cause us to change our determination that regulation of hazardous air pollutant (HAP) emissions from coal- and oil-fired EGUs is appropriate and necessary.”<sup>31</sup> This action supplies the initial cost determination that the U.S. Supreme Court found lacking, and which was the sole basis for remand.

## Air Quality Standards: Control of NO<sub>x</sub>, SO<sub>2</sub> and O<sub>3</sub> Emissions Allowances

The CAA requires each state to attain and maintain compliance with fine particulate matter and ozone national ambient air quality standards (NAAQS). Under NAAQS, the EPA establishes emission standards for six air pollutants, including NO<sub>x</sub>, SO<sub>2</sub>, O<sub>3</sub> at ground level, PM, CO, and Pb, and approves state plans to implement these standards, known as State Implementation Plans (SIPs).<sup>32</sup> Standards for each pollutant are set and periodically revised, most recently for SO<sub>2</sub> in 2010, and SIPs are filed, approved and periodically revised accordingly.

Recent regulatory activity related to these emissions has concerned the development and implementation of a transport rule to address the CAA’s requirement that each state prohibit emissions that significantly interfere with the ability of another state to meet NAAQS.<sup>33</sup>

The EPA finalized the CSAPR on July 6, 2011. CSAPR requires specific states in the eastern and central United States to reduce power plant emissions of SO<sub>2</sub> and NO<sub>x</sub> that cross state lines and contribute to ozone and fine particle pollution in other states, to levels consistent with the 1997 ozone and fine particle and 2006 fine particle NAAQS.<sup>34</sup> The CSAPR covers 28 states,

including all of the PJM states except Delaware, and also excluding the District of Columbia.<sup>35</sup>

CSAPR establishes two groups of states with separate requirements standards. Group 1 includes a core region comprised of 21 states, including all of the PJM states except Delaware, and also excluding the District of Columbia.<sup>36</sup> Group 2 does not include any states in the PJM region.<sup>37</sup> Group 1 states must reduce both annual SO<sub>2</sub> and NO<sub>x</sub> emissions to help downwind areas attain the 24-Hour and/or Annual Fine Particulate Matter<sup>38</sup> NAAQS and to reduce ozone season NO<sub>x</sub> emissions to help downwind areas attain the 1997 8-Hour Ozone NAAQS.

Under the original timetable for implementation, Phase 1 emission reductions were expected to become effective starting January 1, 2012, for SO<sub>2</sub> and annual NO<sub>x</sub> reductions and May 1, 2012, for ozone season NO<sub>x</sub> reductions. CSAPR requires reductions of emissions for each state below certain assurance levels, established separately for each emission type. Assurance levels are the state budget for each type of emission, determined by the sum of unit-level allowances assigned to each unit located in such state, plus a variability limit, which is meant to account for the inherent variability in the state’s yearly baseline emissions. Because allowances are allocated only up to the state emissions budget, any level of emissions in a state above its budget must be covered by allowances obtained through trading for unused allowances allocated to units located in other states included in the same group.

The rule provides for implementation of a trading program for states in the CSAPR region. Sources in each state may achieve those limits as they prefer, including unlimited trading of emissions allowances among power plants within the same state and limited trading of emission allowances among power plants in different states in the same group. Thus, units in PJM states may only trade and use allowances originating in Group 1 states.

<sup>30</sup> Michigan et al. v. EPA, Slip Op. No. 14-46.

<sup>31</sup> *Supplemental Finding that it is Appropriate and Necessary to Regulate Hazardous Air Pollutants from Coal- and Oil-Fired Electric Utility Steam Generating Units*, EPA Docket No. EPA-HQ-OAR-2009-0234; see also *White Stallion Energy Center, LLC v EPA*, Slip Op. No. 12-1100 (D.C. Cir. 2015) (per curiam).

<sup>32</sup> Nitric Oxides (NO<sub>x</sub>), Sulfur Dioxide (SO<sub>2</sub>), Ozone (O<sub>3</sub>), Particulate Matter (PM), Carbon Monoxide (CO) and Lead (Pb).

<sup>33</sup> CAA § 110(a)(2)(D)(i)(I).

<sup>34</sup> *Federal Implementation Plans: Interstate Transport of Fine Particulate Matter and Ozone and Correction of SIP Approvals*, Final Rule, Docket No. EPA-HQ-OAR-2009-0491, 76 Fed. Reg. 48208 (August 8, 2011) (“CSAPR”); *Revisions to Federal Implementation Plans To Reduce Interstate Transport of Fine Particulate Matter and Ozone*, Final Rule, Docket No. EPA-HQ-2009-0491, 77 Fed. Reg. 10342 (February 21, 2012) (“CSAPR II”).

<sup>35</sup> *Id.*

<sup>36</sup> Group 1 states include: New York, Pennsylvania, New Jersey, Maryland, Virginia, West Virginia, North Carolina, Tennessee, Kentucky, Ohio, Indiana, Illinois, Missouri, Iowa, Wisconsin, and Michigan.

<sup>37</sup> Group 2 states include: Minnesota, Nebraska, Kansas, Texas, Alabama, Georgia and South Carolina.

<sup>38</sup> The EPA defines Particulate Matter (PM) as “[a] complex mixture of extremely small particles and liquid droplets. It is made up of a number of components, including acids (such as nitrates and sulfates), organic chemicals, metals, and soil or dust particles.” Fine PM (PM<sub>2.5</sub>) measures less than 2.5 microns across.

If state emissions exceed the applicable assurance level, including the variability limit, a penalty would be assessed that is allocated to resources within the state in proportion to their responsibility for the excess. The penalty would be a requirement to surrender two additional allowances for each allowance needed to cover the excess.

On April 29, 2014, the U.S. Supreme Court upheld the EPA's Cross-State Air Pollution Rule (CSAPR), clearing the way for the EPA to implement this rule and to replace the Clean Air Interstate Rule (CAIR).<sup>39</sup>

In the same decision, the U.S. Supreme Court remanded "particularized as-applied challenge[s]," to the EPA's 2014 emissions budgets.<sup>40</sup> On July 28, 2015, on remand, the U.S. Court of Appeals for the District of Columbia Circuit invalidated the 2014 SO<sub>2</sub> budgets for a number of states, including PJM states Maryland, New Jersey, North Carolina, Ohio, Pennsylvania, Virginia and West Virginia.<sup>41</sup> The court directed the EPA to reconsider the 2015 emissions budgets for these states based on the actual amount of reduced emissions that states in upwind states needed to attain in order to bring each downwind state into attainment.<sup>42</sup> Under the invalidated approach, the EPA calculated how much pollution each upwind state could eliminate if all of its sources applied pollution control at particular cost thresholds.<sup>43</sup> A new approach likely will significantly reduce the emission budgets (lower emissions levels will be allowed) for the indicated states. The court did not vacate the currently assigned emissions budgets, which remain effective until replaced.<sup>44</sup>

On November 16, 2015, the EPA proposed a rule updating the CSAPR ozone season NO<sub>x</sub> emissions program to reflect the decrease to the ozone season NAAQS that occurred in 2008 ("CSPAR Update NOPR").<sup>45</sup> The CSAPR had been finalized in 2011 based on the 1997 ozone season NAAQS. The 2008 ozone

season NO<sub>x</sub> emissions level was lowered to 0.075 ppm from 0.08 in 1997.<sup>46</sup> The CSAPR Update NOPR would increase the reductions required from upwind states to assist downwind states' ability to meet the lower 2008 standard.

Starting May 1, 2017, the CSPAR Update NOPR would reduce summertime NOX from power plants in certain PJM states: Illinois, Indiana, Kentucky, Maryland, Michigan, New Jersey, North Carolina, Ohio, Pennsylvania, Tennessee, Virginia and West Virginia. Table 8-1 shows the reduced NOX emissions budgets for each PJM affected state. Table 8-1 also shows the assurance level, which is a hard cap on emissions, meaning that emissions above the assurance cannot be covered by emissions allowances, even if available.

**Table 8-1 Current and Proposed CSPAR Ozone Season NO<sub>x</sub> Budgets for Electric Generating Units (before accounting for variability)<sup>47</sup>**

State	Current CSPAR Ozone Season NOX Budget for Electric Generating Units (before accounting for variability) (Tons)	Proposed Updated CSPAR Ozone Season NOX Budget for Electric Generating Units (before accounting for variability) (Tons)	Percent Change	Assurance Level (Tons)
Illinois	21,208	12,078	(43.0%)	14,614
Indiana	46,175	28,284	(38.7%)	34,224
Kentucky	32,674	21,519	(34.1%)	26,038
Maryland	7,179	4,026	(43.9%)	4,871
Michigan	24,727	19,115	(22.7%)	23,129
New Jersey	3,382	2,015	(40.4%)	2,438
North Carolina	18,455	12,275	(33.5%)	14,853
Ohio	37,792	16,660	(55.9%)	20,159
Pennsylvania	51,912	14,387	(72.3%)	17,408
Tennessee	8,016	5,481	(31.6%)	6,632
Virginia	14,452	6,818	(52.8%)	8,250
West Virginia	23,291	13,390	(42.5%)	16,202

During the delay of CSAPR implementation from 2012–2015, the EPA estimates that banked emissions allowances "could be in excess of 210,000 tons by the start of the 2017 ozone-season compliance period."<sup>48</sup> The EPA is concerned that "unrestricted use of the bank ... could allow emissions to exceed the state budgets, up to the assurance level [an annual cap on use of

39 See EPA et al. v. EME Homer City Generation, L.P. et al., 134 S. Ct. 1584 (2014). Some issues, involving what the EPA characterizes as EPA "technical and scientific judgments" continue to require resolution by the courts. See Respondents' Motion To Lift The Stay Entered On December 30, 2011, USCA for the Dist. of Columbia Circuit No. 11-1302, et al. (June 26, 2014) at 9–10 ("EPA Motion to Lift Stay"). On October 23, 2014, the U.S. Court of Appeals for the District of Columbia Circuit granted the EPA's motion.

40 134 S. Ct. at 1609.

41 EME Homer City Generation, L.P. v EPA et al., Slip Op. No. 11-1302 (July 28, 2015).

42 *Id.* at 11–12.

43 *Id.* at 11.

44 Emissions Budget Decision at 24–25.

45 Cross-State Air Pollution Rule Update for the 2008 Ozone NAAQS, NOPR, EPA-HQ-OAR-2015-0500, 80 Fed. Reg. 75706 (Dec. 3 2015) ("CSAPR Update"); Federal Implementation Plans for Iowa, Michigan, Missouri, Oklahoma, and Wisconsin and Determination for Kansas Regarding Interstate Transport of Ozone, EPA-HQ-OAR-2009-0491, 76 Fed. Reg. 40662 (July 11, 2011) ("CSAPR Supp.").

46 Federal Implementation Plans to Reduce Interstate Transport of Fine Particulate Matter and Ozone, NOPR, EPA-HQ-OAR-2009-0491, 75 Fed. Reg. 45210, 45220 (Aug. 2, 2010).

47 CSAPR at 48270; CSAPR Supp. at 40666; CSAPR Update NOPR at 75745.

48 CSAPR Update NOPR at 75746.

allowances], year after year.”<sup>49</sup> The EPA does not propose to address excess allowances by reducing state emissions budgets. Instead, the EPA proposes a greater than 1-to-1 surrender ratio for allowances.<sup>50</sup> The analysis in the CSPAR Update Rule assumes a 4-to-1 surrender ratio, but the ratio may differ in the final rule.<sup>51</sup>

On November 21, 2014, the EPA issued a rule tolling by three years CSAPR’s original deadlines. Compliance with CSAPR’s Phase 1 emissions budgets is now required in 2015 and 2016 and CSAPR’s Phase 2 emissions in 2017 and beyond.<sup>52</sup>

## Emission Standards for Reciprocating Internal Combustion Engines

On January 14, 2013, the EPA signed a final rule regulating emissions from a wide variety of stationary reciprocating internal combustion engines (RICE).<sup>53</sup> RICE include certain types of electrical generation facilities like diesel engines typically used for backup, emergency or supplemental power. RICE include facilities located behind the meter. These rules include: National Emission Standard for Hazardous Air Pollutants (NESHAP) for Reciprocating Internal Combustion Engines (RICE); New Source Performance Standards (NSPS) of Performance for Stationary Spark Ignition Internal Combustion Engines; and Standards of Performance for Stationary Compression Ignition Internal Combustion Engines (collectively “RICE Rules”).<sup>54</sup>

The RICE Rules apply to emissions such as formaldehyde, acrolein, acetaldehyde, methanol, CO, NO<sub>x</sub>, volatile organic compounds (VOCs) and PM. The regulatory regime for RICE is complicated, and the applicable requirements

turn on whether the engine is an “area source” or “major source,” and the starter mechanism for the engine (compression ignition or spark ignition).<sup>55</sup>

On May 22, 2012, the EPA proposed amendments to the RICE NESHAP Rule.<sup>56</sup> The proposed rule allowed owners and operators of emergency stationary internal combustion engines to operate them in emergency conditions, as defined in those regulations, as part of an emergency demand response program for 100 hours per year or the minimum hours required by an Independent System Operator’s tariff, whichever is less. The exempted emergency demand response programs included demand resources in RPM.<sup>57</sup>

On May 1, 2015, the U.S. Court of Appeals for the District of Columbia Circuit reversed the portion of the final rule exempting 100 hours of run time for certain stationary reciprocating internal combustion engines (RICE) participating in emergency demand response programs from the otherwise applicable emission standards.<sup>58</sup> As a result, the national emissions standards uniformly apply to all RICE.<sup>59</sup> The Court held that the “EPA acted arbitrarily and capriciously when it modified the National Emissions Standards and the Performance Standards to allow backup generators to operate without emissions controls for up to 100 hours per year as part of an emergency demand-response program.”<sup>60</sup> Specifically, the Court found that the EPA failed to consider arguments concerning the rule’s “impact on the efficiency and reliability of the energy grid,” including arguments raised by the MMU.<sup>61</sup>

On May 3, 2016, the Court issued a mandate to implement the May 1, 2015, order. The MMU is currently taking steps to ensure resource portfolios remain in compliance.

<sup>49</sup> *Id.*

<sup>50</sup> *Id.*

<sup>51</sup> *Id.* at 75747.

<sup>52</sup> *Rulemaking to Amend Dates in Federal Implementation Plans Addressing Interstate Transport of Ozone and Fine Particulate Matter*, EPA-HQ-OAR-2009-0491 (Nov. 21, 2014).

<sup>53</sup> *National Emission Standards for Hazardous Air Pollutants for Reciprocating Internal Combustion Engines; New Source Performance Standards for Stationary Internal Combustion Engines*, Final Rule, EPA Docket No. EPA-HQ-OAR-2008-0708, 78 Fed. Reg. 6674 (January 30, 2013) (“Final NESHAP RICE Rule”).

<sup>54</sup> EPA Docket No. EPA-H-OAR-2009-0234 & -2011-0044, codified at 40 CFR Part 63, Subpart ZZZZ; EPA Dockets Nos. EPA-HQ-OAR-2005-0030 & EPA-HQ-OAR-2005-0029, -2010-0295, codified at 40 CFR Part 60 Subpart JJJJ.

<sup>55</sup> CAA § 112(a) defines “major source” to mean “any stationary source or group of stationary sources located within a contiguous area and under common control that emits or has the potential to emit considering controls, in the aggregate, 10 tons per year or more of any hazardous air pollutant or 25 tons per year or more of any combination of hazardous air pollutants,” and “area source” to mean, “any stationary source of hazardous air pollutants that is not a major source.”

<sup>56</sup> *National Emission Standards for Hazardous Air Pollutants for Reciprocating Internal Combustion Engines; New Source Performance Standards for Stationary Internal Combustion Engines*, Proposed Rule, EPA Docket No. EPA-HQ-OAR-2008-0708.

<sup>57</sup> If FERC approves PJM’s proposal on this issue in Docket No. ER14-822-000, demand resources that use behind the meter generators will maintain emergency status and not have to curtail during pre-emergency events, unlike other demand resources. This matter remains pending.

<sup>58</sup> *Delaware Department of Natural Resources and Environmental Control (DENREC) v. EPA*, Slip Op. No. 13-1093; *National Emission Standards for Hazardous Air Pollutants for Reciprocating Internal Combustion Engines; New Source Performance Standards for Stationary Internal Combustion Engines*, Final Rule, EPA Docket No. EPA-HQ-OAR-2008-0708, 78 Fed. Reg. 9403 (January 30, 2013).

<sup>59</sup> *Id.*

<sup>60</sup> *DENREC v. EPA* at 3, 20–21.

<sup>61</sup> *Id.* at 22, citing Comments of the Independent Market Monitor for PJM, EPA Docket No. EPA-HQ-OAR-2008-0708 (August 9, 2012) at 2.

## Regulation of Greenhouse Gas Emissions

The EPA regulates CO<sub>2</sub> as a pollutant using CAA provisions that apply to pollutants not subject to NAAQS.<sup>62 63</sup>

On September 20, 2013, the EPA proposed national limits on the amount of CO<sub>2</sub> that new power plants would be allowed to emit.<sup>64 65</sup> The proposed rule includes two limits for fossil fuel fired utility boilers and integrated gasification combined cycle (IGCC) units based on the compliance period selected: 1,100 lb CO<sub>2</sub>/MWh gross over a 12 operating month period, or 1,000–1,050 lb CO<sub>2</sub>/MWh gross over an 84 operating month (seven year) period. The proposed rule also includes two standards for natural gas fired stationary combustion units based on the size: 1,000 lb CO<sub>2</sub>/MWh gross for larger units (> 850 mmBtu/hr), or 1,100 lb CO<sub>2</sub>/MWh gross for smaller units (≤ 850 mmBtu/hr).

On August 3, 2015, the EPA issued a final rule for regulating CO<sub>2</sub> from certain existing power generation facilities titled Carbon Pollution Emission Guidelines for Existing Stationary Sources: Electric Utility Generating Units (“CPE Guidelines” or Clean Power Plan).<sup>66</sup> On February 6, 2016, the U.S. Supreme Court issued a stay on the CPE Guidelines that will prevent them from taking effect until judicial review is completed.

States have flexibility to meet the EPA’s GHG goals, including through participation in multistate CO<sub>2</sub> credit trading programs. The CPE Guidelines provided that a state must submit an individual final compliance plan by September 6, 2016, or request a two-year extension, including for the purpose

<sup>62</sup> See CAA § 111.

<sup>63</sup> On April 2, 2007, the U.S. Supreme Court overruled the EPA’s determination that it was not authorized to regulate greenhouse gas emissions under the CAA and remanded the matter to the EPA to determine whether greenhouse gases endanger public health and welfare. *Massachusetts v. EPA*, 549 U.S. 497. On December 7, 2009, the EPA determined that greenhouse gases, including carbon dioxide, methane, nitrous oxide, hydrofluorocarbons, perfluorocarbons, and sulfur hexafluoride, endanger public health and welfare. See *Endangerment and Cause or Contribute Findings for Greenhouse Gases Under Section 202(a) of the Clean Air Act*, 74 Fed. Reg. 66496, 66497 (December 15, 2009). In a decision dated June 26, 2012, the U.S. Court of Appeals for the D.C. Circuit upheld the endangerment finding, rejecting challenges brought by industry groups and a number of states. *Coalition for Responsible Regulation, Inc., et al. v. EPA*, No 09-1322.

<sup>64</sup> *Standards of Performance for Greenhouse Gas Emissions from New Stationary Sources: Electric Utility Generating Units, Proposed Rule*, EPA-HQ-OAR-2013-0495, 79 Fed. Reg. 1430 (January 8, 2014); The President’s Climate Action Plan, Executive Office of the President (June 2013) [Climate Action Plan]; Presidential Memorandum—Power Sector Carbon Pollution Standards, Environmental Protection Agency (June 25, 2013); Presidential Memorandum—Power Sector Carbon Pollution Standards (June 25, 2013) (“June 25th Presidential Memorandum”). The Climate Action Plan can be accessed at: <<http://www.whitehouse.gov/sites/default/files/image/president27climateactionplan.pdf>>.

<sup>65</sup> 79 Fed. Reg. 1352 (January 8, 2014).

<sup>66</sup> *Carbon Pollution Emission Guidelines for Existing Stationary Sources: Electric Utility Generating Units*, EPA-HQ-OAR-2013-0602, Final Rule *mimeo* (August 3, 2015), also known as the “Clean Power Plan.”

of developing a multistate plan. The EPA has begun to develop a federal plan applicable in states that do not submit plans, which the EPA plans to finalize in the summer of 2016.

The CPE Guidelines set state by state rate and mass based CO<sub>2</sub> emissions targets.<sup>67</sup> States would be required to develop and obtain EPA approval of plans to achieve the interim goals effective 2022 and the final goals effective 2030.<sup>68</sup> The EPA anticipates that meeting these goals would reduce CO<sub>2</sub> emissions from Electric Generating Units (EGUs) by 2030 to a level 32 percent below the level of emissions in 2005.<sup>69</sup>

The EPA has calculated rate and mass-based goals based on EGU emissions rates for each state.<sup>70</sup> The EPA uses three building blocks to calculate state goals.<sup>71</sup> The EPA calculates emissions as of 2005 from EGUs in each state, and then assumes reduced emissions based on implementation of the building blocks.<sup>72</sup>

To calculate state interim and final goals, the EPA assumes the following building blocks: (i) heat rate improvement of 2.1–3.4 percent (depending upon the region) at affected EGUs; (ii) displacement of generation from lower emitting existing natural gas combined cycle units for reduced generation from higher-emitting affected steam generating units; and (iii) displacement of generation from new zero emitting generating capacity for reduced generation from affected fossil fuel-fired generating units.<sup>73</sup>

The interim and final targets for CO<sub>2</sub> emissions goals for PJM states, in order of highest to lowest, are included in Table 8-2.

<sup>67</sup> *Id.* at 1560.

<sup>68</sup> *Id.* at 1559.

<sup>69</sup> *Id.* at 34839.

<sup>70</sup> A mass-based goal is expressed as maximum number of tons of CO<sub>2</sub> that may be emitted over a time period, while a rate-based goal is expressed as a number of pounds of CO<sub>2</sub> per MWh.

<sup>71</sup> *Id.* at 1559.

<sup>72</sup> *Id.* at 1559–1560.

<sup>73</sup> *Id.* 1559.

**Table 8-2 Interim and final targets for CO<sub>2</sub> emissions goals for PJM states<sup>74</sup> (Short Tons of CO<sub>2</sub>)**

Jurisdiction	2020 Interim New Source Complements (Short Tons of CO <sub>2</sub> )	2030 Final New Source Complements (Short Tons of CO <sub>2</sub> )	2020 Interim Mass Goal (Short Tons CO <sub>2</sub> )	2030 Final Final Goal (Short Tons CO <sub>2</sub> )
Delaware	78,842	69,561	5,141,711	4,781,386
District of Columbia	NA	NA	NA	NA
Illinois	818,349	722,018	75,619,224	67,119,174
Indiana	939,343	828,769	86,556,407	76,942,604
Kentucky	752,454	663,880	72,065,256	63,790,001
Maryland	170,930	150,809	16,380,325	14,498,436
Michigan	623,651	550,239	53,680,801	48,094,302
New Jersey	313,526	276,619	17,739,906	16,876,364
North Carolina	692,091	610,623	57,678,116	51,876,856
Ohio	949,997	838,170	83,476,510	74,607,975
Pennsylvania	1,257,336	1,109,330	100,588,162	90,931,637
Tennessee	358,838	316,598	32,143,698	28,664,994
Virginia	450,039	397,063	30,030,110	27,830,174
West Virginia	602,940	531,966	58,686,029	51,857,307
Total	8,008,336	7,065,645	689,786,255	617,871,210

The difference in goals reflects different evaluation of state specific factors, referred to as building blocks, including heat rate improvements, dispatch among affected EGUs, expanded use of less carbon-intensive generating capacity and demand-side energy efficiency.<sup>75</sup> The essence of the approach is that the baseline is set by the current opportunity in a state to achieve additional CO<sub>2</sub> emissions reductions. No credit is given for prior steps that states have taken, some more than others, to achieve CO<sub>2</sub> emissions reductions.

Each state would be required to develop an EPA approved plan to meet its interim and final goals.<sup>76</sup> The CPE Guidelines would not require states to implement the building blocks in their plan, but would require states to meet the goals through an approach included in an EPA-approved plan.

States could implement a state measures approach, which involves a state “adopt[ing] a set of policies and programs, which would not be federally enforceable, except that any standards imposed on affected EGUs would

<sup>74</sup> The District of Columbia has no affected EGUs and is not subject to the CPE Guidelines (at 1560).  
<sup>75</sup> CPE Guidelines 1559–1560.  
<sup>76</sup> *Id.*

be federally enforceable.”<sup>77</sup> States could choose from market-based trading programs, emissions performance standards, renewable portfolio standards (RPS), energy efficiency resource standards (EERS), and other demand-side energy efficiency programs.<sup>78</sup>

The CPE Guidelines recognize that many states have already implemented programs to reduce CO<sub>2</sub> emissions from fossil fuel fired EGUs and specifically highlight the Regional Greenhouse Gas Initiative (RGGI) and California’s Global Warming Solutions Act of 2006.<sup>79</sup> Each of these programs would require significant changes in order to comply with the approach in the CPE Guidelines. The trading rules could remain, but new regional goals and compliance deadlines that equal or exceed the state goals and compliance deadlines set in the CPE Guidelines would be needed. The rules would also take into account that the CPE Guidelines rely on reduced emissions from EGUs to reach state goals and does not count non EGU offsets towards meeting those goals.<sup>80</sup>

The CPE Guidelines permit states to partner and submit multistate plans to reduce CO<sub>2</sub> emissions from EGUs.<sup>81</sup>

### Federal Regulation of Environmental Impacts on Water

Section 316(b) of the Clean Water Act (CWA) requires that cooling water intake structures reflect the best technology available (BTA) for minimizing adverse environmental impacts. The EPA’s rule implementing Section 316(b) requires an existing facility to use BTA to reduce impingement of aquatic organisms (pinned against intake structures) if the facility withdraws 25 percent or more of its cooling water from waters of the United States and has a design intake flow of greater than two million gallons per day (mgd).<sup>82</sup>

<sup>77</sup> *Id.* at 1560.  
<sup>78</sup> *Id.* at 898.  
<sup>79</sup> *Id.* at 1560.  
<sup>80</sup> *Id.* at 34910.  
<sup>81</sup> *Id.* at 1560.  
<sup>82</sup> See EPA, *National Pollutant Discharge Elimination System—Final Regulations to Establish Requirements for Cooling Water Intake Structures at Existing Facilities and Amend Requirements at Phase I Facilities*, EPA-HQ-DW-2008-0667, 79 Fed. Reg. 48300 (Aug. 15, 2014).

Existing facilities withdrawing 125 mgd must conduct studies that may result in a requirement to install site-specific controls for reducing entrainment of aquatic organisms (drawn into intake structures). If a new generating unit is added to an existing facility, the rule requires addition of BTA that either (i) reduces actual intake flow at the new unit to a level at least commensurate with what can be attained using a closed-cycle recirculating system or (ii) reduces entrainment mortality of all stages of aquatic organisms that pass through a sieve with a maximum opening dimension of 0.56 inches to a prescribed level.

Although the rule is now generally effective, it is implemented with respect to particular facilities as National Pollutant Discharge Elimination System (NPDES) permits are issued, with exceptions in certain cases for permits expiring prior to July 14, 2018.

## Federal Regulation of Waste Disposal

The EPA administers the Resource Conservation and Recovery Act (RCRA), which governs the disposal of solid and hazardous waste.<sup>83</sup> Solid waste is regulated under subtitle D, which encourages state management of nonhazardous industrial solid waste and sets non-binding criteria for solid waste disposal facilities. Subtitle D prohibits open dumping. Subtitle D criteria are not directly enforced by the EPA. However, the owners of solid waste disposal facilities are exposed under the act to civil suits, and criteria set by the EPA under subtitle D can be expected to influence the outcome of such litigation.

Subtitle C governs the disposal of hazardous waste. Hazardous waste is subject to direct regulatory control by the EPA from the time it is generated until its ultimate disposal.

On December 19, 2014, the EPA issued its Coal Combustion Residuals rule (CCRR) under RCRA, the more lenient subtitle D, effective October 19, 2015.<sup>84</sup> The CCRR sets criteria for the disposal of coal combustion residues (CCRs)

produced by electric utilities and independent power producers. CCRs include fly ash (trapped by air filters), bottom ash (scooped out of boilers) and scrubber sludge (filtered using wet limestone scrubbers). These residues are typically stored on site in ponds (surface impoundments) or sent to landfills. In 2012, beneficial use was made of approximately 40 percent of residues, such as in the manufacture of cement, concrete, wallboard and roadbed.<sup>85</sup>

The CCRR exempts: (i) beneficially used CCRs that are encapsulated (i.e. physically bound into a product); (ii) coal mine filling; (iii) municipal landfills; (iv) landfills receiving CCRs before the effective date; (v) surface impoundments closed by the effective date; and (vi) landfills and surface impoundments on the site of generation facilities that deactivate prior to the effective date. Less restrictive criteria may also apply to some surface impoundments deemed inactive under not yet clarified criteria.

<sup>83</sup> 42 U.S.C. §§ 6901 et seq.

<sup>84</sup> See *Hazardous and Solid Waste Management System; Disposal of Coal Combustion Residuals From Electric Utilities*, 80 Fed. Reg. 21302 (April 17, 2015).

<sup>85</sup> CCRR at 21303.

Table 8-3 describes the criteria and anticipated implementation dates.

**Table 8-3 Minimum Criteria for Existing CCR Ponds (Surface Impoundments) and Landfills and Date by which Implementation is Expected**

Requirement	Description of requirement to be completed	Implementation Date
Location Restrictions (§ 257.60–§ 257.64)	For Ponds: Complete demonstration for placement above the uppermost aquifer, for wetlands, fault areas, seismic impact zones and unstable areas.	October 17, 2018
	For Landfills: Complete demonstration for unstable areas.	October 17, 2018
Design Criteria (§ 257.71)	For Ponds: Document whether CCR unit is either a lined or unlined CCR surface impoundment.	October 17, 2016
Structural Integrity (§ 257.73)	For Ponds: Install permanent marker.	December 17, 2015
	For Ponds: Compile a history of construction, complete initial hazard potential classification assessment, initial structural stability assessment, and initial safety factor assessment.	October 17, 2016
	Prepare emergency action plan.	April 17, 2017
Air Criteria (§ 257.80)	Ponds and Landfills: Prepare fugitive dust control plan.	October 17, 2015
Run-On and Run-Off Controls (§ 257.81)	For Landfills: Prepare initial run-on and run-off control system plan.	October 17, 2016
Hydrologic and Hydraulic Capacity (§ 257.82)	Prepare initial inflow design flood control system plan.	October 17, 2016
Inspections (§ 257.83)	For Ponds and Landfills: Initiate weekly inspections of the CCR unit.	October 17, 2015
	For Ponds: Initiate monthly monitoring of CCR unit instrumentation.	October 17, 2015
	For Ponds and Landfills: Complete the initial annual inspection of the CCR unit.	January 17, 2016
Groundwater Monitoring and Corrective Action (§ 257.90–§ 257.98)	For Ponds and Landfills: Install the groundwater monitoring system; develop the groundwater sampling and analysis program; initiate the detection monitoring program; and begin evaluating the groundwater monitoring data for statistically significant increases over background levels.	October 17, 2017
Closure and Post-Closure Care (§ 257.103–§ 257.104)	For Ponds and Landfills: Prepare written closure and post-closure care plans.	October 17, 2016
Recordkeeping, Notification, and Internet Requirements (§ 257.105–§ 257.107)	For Ponds and landfills: Conduct required recordkeeping; provide required notifications; establish CCR website.	October 17, 2015

The CCRR likely will raise the costs of disposal of CCRs for the owners of surface impoundments and landfills to meet the EPA criteria.

## State Environmental Regulation

### New Jersey High Electric Demand Day (HEDD) Rules

The EPA's transport rules apply to total annual and seasonal emissions. Units that run only during peak demand periods have relatively low annual emissions, and have less reason to make such investments under the EPA transport rules.

New Jersey addressed the issue of NO<sub>x</sub> emissions on peak energy demand days with a rule that defines peak energy usage days, referred to as high electric demand days or HEDD, and imposes operational restrictions and emissions control requirements on units responsible for significant NO<sub>x</sub> emissions on such high energy demand days.<sup>86</sup> New Jersey's HEDD rule, which became effective May 19, 2009, applies to HEDD units, which include units that have a NO<sub>x</sub> emissions rate on HEDD equal to or exceeding 0.15 lbs/MMBtu and lack identified emission control technologies.<sup>87</sup> NO<sub>x</sub> emissions limits for coal units became effective December 15, 2012.<sup>88</sup> NO<sub>x</sub> emissions limits for other unit types became effective May 1, 2015.<sup>89</sup>

Table 8-4 shows the HEDD emissions limits applicable to each unit type.

**Table 8-4 HEDD maximum NO<sub>x</sub> emission rates<sup>90</sup>**

Fuel and Unit Type	NOx Emission Limit (lbs/MWh)
Coal Steam Unit	1.50
Heavier than No. 2 Fuel Oil Steam Unit	2.00
Simple Cycle Gas CT	1.00
Simple Cycle Oil CT	1.60
Combined Cycle Gas CT	0.75
Combined Cycle Oil CT	1.20
Regenerative Cycle Gas CT	0.75
Regenerative Cycle Oil CT	1.20

<sup>86</sup> N.J.A.C. § 7:27-19.

<sup>87</sup> CTs must have either water injection or selective catalytic reduction (SCR) controls; steam units must have either an SCR or selective non-catalytic reduction (SNCR).

<sup>88</sup> N.J.A.C. § 7:27-19.4.

<sup>89</sup> N.J.A.C. § 7:27-19.5.

<sup>90</sup> Regenerative cycle CTs are combustion turbines that recover heat from their exhaust gases and use that heat to preheat the inlet combustion air which is fed into the combustion turbine.

## Illinois Air Quality Standards (NO<sub>x</sub>, SO<sub>2</sub> and Hg)

The State of Illinois has promulgated its own standards for NO<sub>x</sub>, SO<sub>2</sub> and Hg (mercury) known as Multi-Pollutant Standards (“MPS”) and Combined Pollutants Standards (“CPS”).<sup>91</sup> MPS and CPS establish standards that are more stringent and take effect earlier than comparable Federal regulations, such as the EPA’s MATS.

The Illinois Pollution Control Board has granted variances with conditions for compliance with MPS/CPS for Illinois units included in or potentially included in PJM markets.<sup>92</sup> In order to obtain variances, companies in PJM agreed to terms with the Illinois Pollution Control Board that resulted in investments in the installation of environmental pollution control equipment at units and deactivation of Illinois units that differ from what would have occurred had only Federal regulations applied.<sup>93</sup>

91 35 Ill. Admin. Code §§ 225.233 (Multi-Pollutant Standard (MPS)), 224.295 (Combined Pollutant Standard: Emissions Standards for NO<sub>x</sub> and SO<sub>2</sub> (CPS)).

92 See, e.g., Midwest Generation, LLC, Opinion and Order of the Board, Docket No. PCB 13-24 (Variance-Air) (April 4, 2013); Midwest Generation, LLC, Opinion and Order of the Board, Docket No. PCB 12-121 (Variance-Air) (August 23, 2012).

93 See *Id.*

## State Regulation of Greenhouse Gas Emissions

### RGGI

The Regional Greenhouse Gas Initiative (RGGI) is a cooperative effort by Connecticut, Delaware, Maine, Maryland, Massachusetts, New Hampshire, New York, Rhode Island, and Vermont to cap CO<sub>2</sub> emissions from power generation facilities.<sup>94</sup> RGGI generates revenues for the participating states which have spent approximately 62 percent of revenues to date on energy efficiency, 8 percent on clean and renewable energy, 9 percent on greenhouse gas abatements and 15 percent on direct bill assistance.<sup>96</sup>

Table 8-5 shows the RGGI CO<sub>2</sub> auction clearing prices and quantities for the 2009-2011 compliance period auctions, the 2012-2014 compliance period auctions and 2015-2017 compliance period auctions held as of March 31, 2016, in short tons and metric tonnes. Prices for auctions held March 9, 2016, for the 2015-2017 compliance period were at \$5.25 per allowance (equal to one ton of CO<sub>2</sub>), above the current price floor of \$2.05 for RGGI auctions.<sup>97</sup> The RGGI base budget for CO<sub>2</sub> will be reduced by 2.5 percent per year each year from 2015 through 2020. The price decreased from the previous high of \$7.50 in December 2015. The September 3, 2015, auction included additional Cost Containment Reserves (CCRs) since the clearing price for allowances was above the CCR trigger price of \$6.00 per ton in 2015. The auctions on March 5, 2014, and September 3, 2015, were the only auction to use CRRs.

94 RGGI provides a link on its website to state statutes and regulations authorizing its activities, which can be accessed at: <<http://www.rggi.org/design/regulations>>.

95 For more details see the 2013 *State of the Market Report for PJM*, Volume 2: Section 8, “Environmental and Renewables.”

96 *Investment of RGGI Proceeds Through 2013*, The Regional Greenhouse Gas Initiative, April 2015 <<http://www.rggi.org/docs/ProceedsReport/Investment-RGGI-Proceeds-Through-2013.pdf>> (Accessed February 24, 2016).

97 RGGI measures carbon in short tons (short ton equals 2,000 pounds) while world carbon markets measure carbon in metric tonnes (metric tonne equals 1,000 kilograms or 2,204.6 pounds).

**Table 8-5 RGGI CO<sub>2</sub> allowance auction prices and quantities in short tons and metric tonnes: 2009-2011, 2012-2014 and 2015-2017 Compliance Periods<sup>98</sup>**

Auction Date	Short Tons			Metric Tonnes		
	Clearing Price	Quantity Offered	Quantity Sold	Clearing Price	Quantity Offered	Quantity Sold
September 25, 2008	\$3.07	12,565,387	12,565,387	\$3.38	11,399,131	11,399,131
December 17, 2008	\$3.38	31,505,898	31,505,898	\$3.73	28,581,678	28,581,678
March 18, 2009	\$3.51	31,513,765	31,513,765	\$3.87	28,588,815	28,588,815
June 17, 2009	\$3.23	30,887,620	30,887,620	\$3.56	28,020,786	28,020,786
September 9, 2009	\$2.19	28,408,945	28,408,945	\$2.41	25,772,169	25,772,169
December 2, 2009	\$2.05	28,591,698	28,591,698	\$2.26	25,937,960	25,937,960
March 10, 2010	\$2.07	40,612,408	40,612,408	\$2.28	36,842,967	36,842,967
June 9, 2010	\$1.88	40,685,585	40,685,585	\$2.07	36,909,352	36,909,352
September 10, 2010	\$1.86	45,595,968	34,407,000	\$2.05	41,363,978	31,213,514
December 1, 2010	\$1.86	43,173,648	24,755,000	\$2.05	39,166,486	22,457,365
March 9, 2011	\$1.89	41,995,813	41,995,813	\$2.08	38,097,972	38,097,972
June 8, 2011	\$1.89	42,034,184	12,537,000	\$2.08	38,132,781	11,373,378
September 7, 2011	\$1.89	42,189,685	7,847,000	\$2.08	38,273,849	7,118,681
December 7, 2011	\$1.89	42,983,482	27,293,000	\$2.08	38,993,970	24,759,800
March 14, 2012	\$1.93	34,843,858	21,559,000	\$2.13	31,609,825	19,558,001
June 6, 2012	\$1.93	36,426,008	20,941,000	\$2.13	33,045,128	18,997,361
September 5, 2012	\$1.93	37,949,558	24,589,000	\$2.13	34,427,270	22,306,772
December 5, 2012	\$1.93	37,563,083	19,774,000	\$2.13	34,076,665	17,938,676
March 13, 2013	\$2.80	37,835,405	37,835,405	\$3.09	34,323,712	34,323,712
June 5, 2013	\$3.21	38,782,076	38,782,076	\$3.54	35,182,518	35,182,518
September 4, 2013	\$2.67	38,409,043	38,409,043	\$2.94	34,844,108	34,844,108
December 4, 2013	\$3.00	38,329,378	38,329,378	\$3.31	34,771,837	34,771,837
March 5, 2014	\$4.00	23,491,350	23,491,350	\$4.41	21,311,000	21,311,000
June 4, 2014	\$5.02	18,062,384	18,062,384	\$5.53	16,385,924	16,385,924
September 3, 2014	\$4.88	17,998,687	17,998,687	\$5.38	16,328,139	16,328,139
December 3, 2014	\$5.21	18,198,685	18,198,685	\$5.74	16,509,574	16,509,574
March 11, 2015	\$5.41	15,272,670	15,272,670	\$5.96	13,855,137	13,855,137
June 3, 2015	\$5.50	15,507,571	15,507,571	\$6.06	14,068,236	14,068,236
September 3, 2015	\$6.02	25,374,294	25,374,294	\$6.64	23,019,179	23,019,179
December 2, 2015	\$7.50	15,374,274	15,374,274	\$8.27	13,947,311	13,947,311
March 9, 2016	\$5.25	14,838,732	14,838,732	\$5.79	13,461,475	13,461,475

<sup>98</sup> See Regional Greenhouse Gas Initiative, "Auction Results," <[http://www.rggi.org/market/co2\\_auctions/results](http://www.rggi.org/market/co2_auctions/results)> (Accessed January 28, 2016).

## CAIR and CSAPR

On April 29, 2014, the U.S. Supreme Court upheld the EPA's Cross-State Air Pollution Rule (CSAPR) and on October 23, 2014, the U.S. Court of Appeals for the District of Columbia Circuit lifted the stay imposed on CSAPR, clearing the way for the EPA to implement this rule and to replace the Clean Air Interstate Rule (CAIR) now in effect.<sup>99</sup> <sup>100</sup> On November 21, 2014, the EPA issued a rule requiring compliance with CSAPR's Phase 1 emissions budgets effective January 1, 2015, and 2016 and CSAPR's Phase 2 emissions effective January 1, 2017.<sup>101</sup> The ruling and the EPA rules eliminated CAIR and replaced it with CSAPR and had a corresponding impact on market prices for CAIR emissions allowances and CSAPR emissions allowances.

Figure 8-1 shows average, monthly settled prices for NO<sub>x</sub>, CO<sub>2</sub> and SO<sub>2</sub> emissions allowances including CSAPR related allowances for 2015 and the first three months of 2016.<sup>102</sup> Figure 8-1 Spot monthly average emission price comparison: 2015 through March 2016-1 also shows the average, monthly settled price for the Regional Greenhouse Gas Initiative (RGGI) CO<sub>2</sub> allowances.

In the first three months of 2016, CSAPR annual NO<sub>x</sub> prices were 43.1 percent higher than the CSAPR NO<sub>x</sub> prices in the first three months of 2015. The average price of CSAPR SO<sub>2</sub> in the first three months of 2016 was \$2.00 compared the average price of \$121.64 for CSAPR SO<sub>2</sub> in the first three months of 2015.<sup>103</sup>

<sup>99</sup> See EPA et al. v. EME Homer City Generation, L.P. et al., 134 S. Ct. 1584 (2014), reversing 696 F.3d 7 (D.C. Cir. 2012).


<sup>100</sup> Order, City Generation, LP. EPA et al. v. EME Homer et al., No. 11-1302.

<sup>101</sup> Rulemaking to Amend Dates in Federal Implementation Plans Addressing Interstate Transport of Ozone and Fine Particulate Matter, EPA-HQ-OAR-2009-0491 (Nov. 21, 2014).

<sup>102</sup> The NO<sub>x</sub> prices result from the Clean Air Interstate Rule (CAIR) established by the EPA covering 28 states. The SO<sub>2</sub> prices result from the Acid Rain cap and trade program established by the EPA. The CO<sub>2</sub> prices are from RGGI.

<sup>103</sup> There were not any reported cleared purchases for January or February 2016 for CSAPR SO<sub>2</sub> or CSAPR Annual NO<sub>x</sub>.

**Figure 8-1 Spot monthly average emission price comparison: 2015 through March 2016<sup>104</sup>**

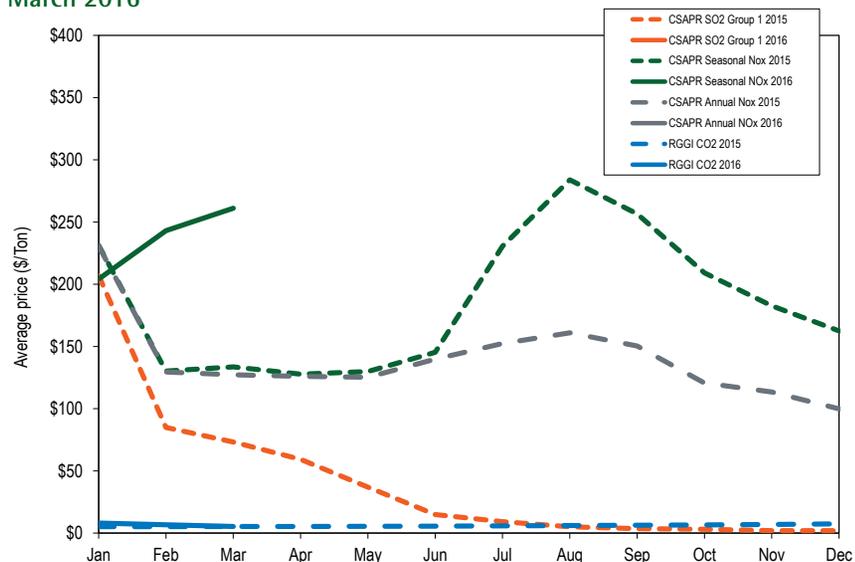

## Renewable Portfolio Standards

Many PJM jurisdictions have enacted legislation to require that a defined percentage of retail load be served by renewable resources, for which there are many standards and definitions. These are typically known as renewable portfolio standards, or RPS. As of March 31, 2016, Delaware, Illinois, Maryland, Michigan, New Jersey, North Carolina, Ohio, Pennsylvania, and Washington D.C. had renewable portfolio standards. Virginia and Indiana have enacted voluntary renewable portfolio standards. Kentucky and Tennessee have enacted no renewable portfolio standards. Ohio delayed a scheduled increase from 2.5 percent to 3.5 percent in its RPS standards from 2015 until 2017 and removed the 12.5 percent alternative energy requirement. Ohio currently has an ongoing Ohio Energy Mandates Study Committee that is discussing the costs and benefits of the RPS as outlined in Senate Bill 310.<sup>105</sup> West Virginia

<sup>104</sup> Spot monthly average emission price information obtained through Evomarkets, <<http://www.evomarkets.com>> (Accessed May 2, 2016).

<sup>105</sup> See Ohio Senate Bill 310.

had a voluntary standard, but the state legislature repealed their renewable portfolio standard on January 27, 2015, effective February 3, 2015.<sup>106</sup>

Under the existing renewable portfolio standards, approximately 7.4 percent of PJM load must be served by renewable resources in 2015 and 16.2 percent of PJM load by 2028 under defined RPS rules. As shown in Table 8-6 Renewable standards of PJM jurisdictions: 2016 to 2028-6, Delaware and Illinois will require 25.0 percent of load to be served by renewable resources in 2028, the highest standard of PJM jurisdictions. Renewable resources earn renewable energy credits (RECs) (also known as alternative energy credits) when they generate electricity. These RECs are bought by retail suppliers to fulfill the requirements for generation from renewable resources.

Renewable energy credit markets are markets related to the production and purchase of wholesale power, but are not subject to FERC regulation or any other market regulation or oversight. RECs markets are, as an economic fact, integrated with PJM markets including energy and capacity markets, but are not formally recognized as part of PJM markets. Revenues from RECs markets are revenues for PJM resources earned in addition to revenues earned from the sale of the same MWh in PJM markets. The FERC has found that such costs can be appropriately considered in the rates established through the operation of wholesale organized markets.<sup>107</sup>

<sup>106</sup> See Enr. Com. Sub. For H. B. No. 2001.

<sup>107</sup> See 146 FERC ¶ 61,084 at P 32 ("We disagree with Exelon's argument that the Production Tax Credit and Renewable Energy Credits should be considered [out-of-market (OOM)] revenues. The relevant, Commission-approved Tariff provision defines OOM revenues as any revenues that are (i) not tradable throughout the New England Control Area or that are restricted to resources within a particular state or other geographic sub-region; or (ii) not available to all resources of the same physical type within the New England Control Area, regardless of the resource owner; [footnote omitted] Neither Production Tax Credit nor Renewable Energy Credits revenues fall within this definition. We also find that ISO-NE's use of an inflation rate in determining the price of Renewable Energy Credits is a reasonable estimate of Renewable Energy Credits for the 2018-2019 Capacity Commitment Period.").

Table 8-6 Renewable standards of PJM jurisdictions: 2016 to 2028<sup>108</sup>

Jurisdiction	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028
Delaware	14.50%	16.00%	17.50%	19.00%	20.00%	21.00%	22.00%	23.00%	24.00%	25.00%	25.00%	25.00%	25.00%
Illinois	10.00%	11.50%	13.00%	14.50%	16.00%	17.50%	19.00%	20.50%	22.00%	23.50%	25.00%	25.00%	25.00%
Indiana	4.00%	4.00%	4.00%	7.00%	7.00%	7.00%	7.00%	7.00%	7.00%	10.00%	10.00%	10.00%	10.00%
Kentucky	No Standard												
Maryland	15.20%	15.60%	18.30%	17.40%	18.00%	18.70%	20.00%	20.00%	20.00%	20.00%	20.00%	20.00%	20.00%
Michigan	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%
New Jersey	14.90%	15.99%	18.03%	19.97%	21.91%	23.85%	23.94%	24.03%	24.12%	24.21%	24.30%	24.39%	24.48%
North Carolina	6.00%	6.00%	10.00%	10.00%	10.00%	12.50%	12.50%	12.50%	12.50%	12.50%	12.50%	12.50%	12.50%
Ohio	2.50%	3.50%	4.50%	5.50%	6.50%	7.50%	8.50%	9.50%	10.50%	11.50%	12.50%	12.50%	12.50%
Pennsylvania	13.70%	14.20%	14.70%	15.20%	15.70%	18.00%	18.00%	18.00%	18.00%	18.00%	18.00%	18.00%	18.00%
Tennessee	No Standard												
Virginia	7.00%	7.00%	7.00%	7.00%	7.00%	7.00%	12.00%	12.00%	12.00%	15.00%	15.00%	15.00%	15.00%
Washington, D.C.	14.33%	15.98%	17.65%	19.35%	21.58%	21.85%	22.18%	22.50%	22.50%	22.50%	22.50%	22.50%	22.50%
West Virginia	No Standard												

Delaware, North Carolina, Michigan and Virginia allow various types of renewable resources to earn multiple RECs per MWh, though typically one REC is equal to one MWh. For example, Delaware provided a three MWh REC for each MWh produced by in-state customer sited photovoltaic generation and fuel cells using renewable fuels that are installed on or before December 31, 2014.<sup>109</sup> This is equivalent to providing a REC price equal to three times its stated value per MWh. PJM Environmental Information Services (EIS), an unregulated subsidiary of PJM, operates the generation attribute tracking system (GATS), which is used by many jurisdictions to track these renewable energy credits.<sup>110</sup>

In addition to GATS, there are several other REC tracking systems used by states in the PJM footprint. Illinois, Indiana and Ohio use both GATS and M-RETS, the REC tracking system for resources located in the Midcontinent ISO, to track the sales of RECs used to fulfill their RPS requirements. Michigan and North Carolina have created their own state-wide tracking systems, MIRECS and NC-RETS, through which all RECs used to satisfy these states' RPS requirements must ultimately be traded. Table 8-7 shows the REC tracking systems used by each state within the PJM footprint.

<sup>108</sup> This shows the total standard of renewable resources in all PJM jurisdictions, including Tier I, Tier II and Tier III resources.

<sup>109</sup> See Delaware Renewable Portfolio Standard, <<http://programs.dsireusa.org/system/program/detail/1231>> (Accessed October 1, 2015).

<sup>110</sup> GATS publishes details on every renewable generator registered within the PJM footprint and aggregate emissions of renewable generation, but does not publish generation data by unit and does not make unit data available to the MMU.

Table 8-7 REC Tracking Systems in PJM States with Renewable Portfolio Standards

Jurisdiction with RPS	REC Tracking System Used
Delaware	PJM-GATS
Illinois	PJM-GATS M-RETS
Indiana	PJM-GATS M-RETS
Maryland	PJM-GATS
Michigan	MIRECS
New Jersey	PJM-GATS
North Carolina	NC-RETS
Ohio	PJM-GATS M-RETS
Pennsylvania	PJM-GATS
Virginia	PJM-GATS
Washington, D.C.	PJM-GATS

All PJM states with renewable portfolio standards have specified geographical restrictions governing the source of RECs to satisfy states' standards. Table 8-8 outlines these restrictions. Indiana, Illinois, Michigan, and Ohio all have provisions in their renewables standards that require all or a portion of RECs used to comply with states' standards to be generated by in-state resources. North Carolina has provisions that require RECs to be purchased from in-state resources but Dominion, the only utility located in both North Carolina and PJM, is exempt from these provisions.

Delaware, Pennsylvania and Virginia require that RECs largely come from within the PJM footprint though Delaware and Virginia have slightly more nuanced rules in their standards. The District of Columbia, Maryland and New Jersey allow RECs to be purchased from resources located within PJM in addition to large areas that adjoin PJM for compliance with their standards.

Some PJM jurisdictions have specific RPS requirements for the purchase of solar resources. These solar requirements are included in the total requirements shown in Table 8-9 but may be met by solar RECs (SRECs) only. Delaware, Illinois, Maryland, New Jersey, North Carolina, Ohio, Pennsylvania, and Washington, D.C. have requirements for the proportion of load served by solar. Pennsylvania and Delaware allow only solar photovoltaic resources to fulfill the solar requirement. Solar thermal units like solar hot water heaters that do not generate electricity are considered Tier II. Indiana, Kentucky, Michigan, Tennessee, Virginia, and West Virginia have no specific solar standards. In 2015, New Jersey had the most stringent solar standard in PJM, requiring that 2.45 percent of retail electricity sales within the state be served by solar resources. As Table 8-9 shows, by 2028, New Jersey will continue to have the most stringent standard, requiring that at least 4.10 percent of load be served by solar.

Some PJM jurisdictions have also added specific requirements to their renewable portfolio standards for other technologies. The standards shown in Table 8-10 are also included in the total RPS requirements. Illinois requires that a defined proportion of retail load be served by wind resources, increasing from 6.75 percent of load served in 2015 to 18.75 percent in 2026. Maryland, New Jersey, Pennsylvania, and Washington D.C. all have “Tier II” or “Class 2” standards, which allow specific technology types, such as waste coal units in Pennsylvania, to qualify for renewable energy credits. By 2020, North Carolina’s RPS requires that 0.2 percent of power be generated using swine waste and that 900 GWh of power be produced by poultry waste (Table 8-10).

**Table 8-8 Geographical restrictions on REC purchases for renewable portfolio standard compliance in PJM states**

State with RPS	RPS Contains In-State Provision	Geographical Requirements for RPS Compliance
Delaware	No	RECs must be purchased from resources located either within PJM or from resources outside of PJM that are directly deliverable into Delaware.
Illinois	Yes	All RECs must first be purchased from resources located within Illinois or resources located in a state directly adjoining Illinois. If there are insufficient RECs from Illinois and adjoining states to fulfill the RPS requirements, utilities may purchase RECs from anywhere.
Indiana	Yes	At least 50 percent of RECs must be purchased from resources located within Indiana.
Maryland	No	RECs must come from within PJM, 10-30 miles offshore the coast of Maryland or from a control area adjacent to PJM that is capable of delivering power into PJM.
Michigan	Yes	RECs must either come from resources located within Michigan or anywhere in the service territory of retail electric provider in Michigan that is not an alternative electric supplier. There are many exceptions to these requirements (see Michigan S.B. 213).
New Jersey	No	RECs must either be purchased from resources located within PJM or resources located in a control area synchronized with PJM.
North Carolina	Yes	Dominion, the only utility located in both the state of North Carolina and PJM, may purchase RECs from anywhere. Other utilities in North Carolina not located in PJM are subject to different REC requirements (see G.S. 62-113.8).
Ohio	Yes	All RECs must be generated from resources that are either located in the state of Ohio or have the capability to deliver power directly into Ohio. Any renewable facility located in state contiguous to Ohio has been deemed deliverable into the state of Ohio. If a renewable resource is located outside of this range, then it must demonstrate deliverability to the Public Utilities Commission of Ohio.
Pennsylvania	No	RECs must be purchased from resources located anywhere within PJM.
Virginia	No	RECs must be purchased from the RTO or control area in which the participating utility is a member.
Washington, D.C.	No	RECs must be purchased from either a PJM state or a state adjacent with PJM. A PJM state is defined as any state with a portion of their geographical boundary within the footprint of PJM. An adjacent state is any state next to a PJM state, i.e. SC, GA, AL, AR, IA, NY, MO, MS, and WI.

Table 8-9 Solar renewable standards by percent of electric load for PJM jurisdictions: 2016 to 2028

Jurisdiction	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028
Delaware	1.25%	1.50%	1.75%	2.00%	2.25%	2.50%	2.75%	3.00%	3.25%	3.50%	3.50%	3.50%	3.50%
Illinois	0.60%	0.69%	0.78%	0.87%	0.96%	1.05%	1.14%	1.23%	1.32%	1.41%	1.50%	1.50%	1.50%
Indiana	No Solar Standard												
Kentucky	No Standard												
Maryland	0.70%	0.95%	1.40%	1.75%	2.00%	2.00%	2.00%	2.00%	2.00%	2.00%	2.00%	2.00%	2.00%
Michigan	No Solar Standard												
New Jersey	2.75%	3.00%	3.20%	3.29%	3.38%	3.47%	3.56%	3.65%	3.74%	3.83%	3.92%	4.01%	4.10%
North Carolina	0.14%	0.14%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%
Ohio	0.12%	0.15%	0.18%	0.22%	0.26%	0.30%	0.34%	0.38%	0.42%	0.46%	0.50%	0.50%	0.50%
Pennsylvania	0.25%	0.29%	0.34%	0.39%	0.44%	0.50%	0.50%	0.50%	0.50%	0.50%	0.50%	0.50%	0.50%
Tennessee	No Standard												
Virginia	No Solar Standard												
Washington, D.C.	0.83%	0.98%	1.15%	1.35%	1.58%	1.85%	2.18%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%
West Virginia	No Standard												

Table 8-10 Additional renewable standards of PJM jurisdictions: 2016 to 2028

Jurisdiction		2016	2017	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028
Illinois	Wind Requirement	7.50%	8.63%	9.75%	10.88%	12.00%	13.13%	14.25%	15.38%	16.50%	17.63%	18.75%	18.75%	18.75%
Illinois	Distributed Generation	0.10%	0.12%	0.13%	0.15%	0.16%	0.18%	0.19%	0.21%	0.22%	0.24%	0.25%	0.25%	0.25%
Maryland	Tier II Standard	2.50%	2.50%	2.50%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%
New Jersey	Class II Standard	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%
North Carolina	Swine Waste	0.07%	0.14%	0.14%	0.14%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%
North Carolina	Poultry Waste (in GWh)	900	900	900	900	900	900	900	900	900	900	900	900	900
Pennsylvania	Tier II Standard	8.20%	8.20%	8.20%	8.20%	8.20%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%
Washington, D.C.	Tier II Standard	2.00%	1.50%	1.00%	0.50%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%

Within the PJM footprint there have been attempts to pass low carbon portfolio standards in addition to renewable portfolio standards. An example of this is Illinois House Bill 3293, which was introduced on February 26, 2015. This legislation proposes the creation of a low carbon portfolio standard under which a defined share of all retail electricity sales in Illinois must come from generation that “does not emit any air pollution, including sulfur dioxide, nitrogen oxide, or carbon dioxide, as reported in the [PJM] Generation Attribute Tracking System.”<sup>111</sup> Under this new legislation nuclear, certain clean coal resources, and all renewable resources would qualify as low carbon energy resources. This bill was referred again to the Rules Committee on March 27, 2015, and remains there as of March 31, 2016.

111 See Illinois House Bill 3293. <<http://www.ilga.gov/legislation/99/HB/PDF/09900HB3293lv.pdf>> (Accessed April 12, 2016).

REC prices are required to be publicly disclosed in Maryland, Pennsylvania and the District of Columbia, but in the other states REC prices are not publicly available. Figure 8-2 shows the average solar REC (SREC) price by jurisdiction for 2009 through March 2016. The average NJ SREC prices dropped from \$674 per SREC in 2010 to \$290 per SREC in 2016. The DC SREC prices are currently the highest at \$488 per SREC.<sup>112 113</sup>

112 Solar REC average price information obtained through Evomarkets, <<http://www.evomarkets.com>> (Accessed May 3, 2016).

113 There were not any reported purchases of MD Solar REC for the first three months of 2016.

Figure 8-2 Average solar REC price by jurisdiction: 2009 through March 2016


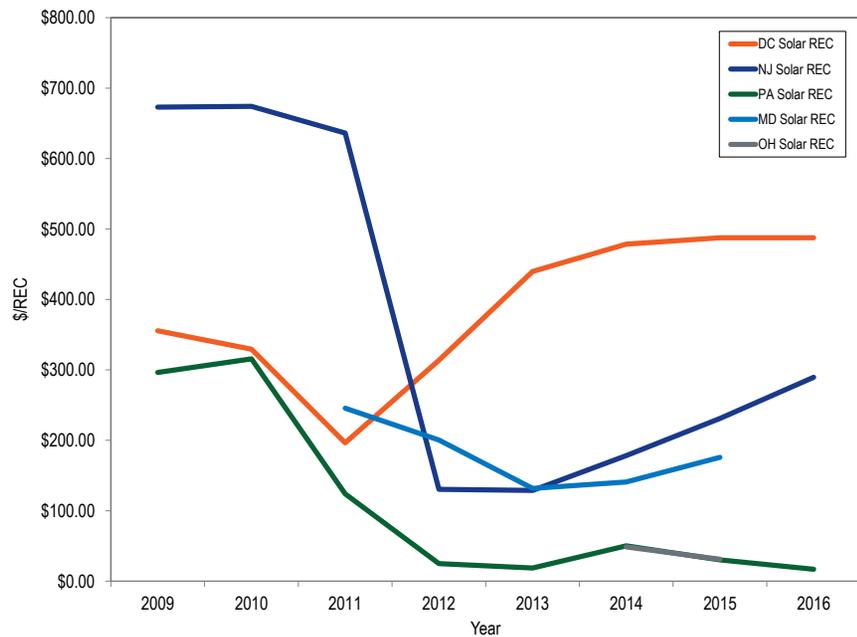


Figure 8-3 shows the average Tier I REC price by jurisdiction from 2009 through March 2016. Tier I REC prices are lower than SREC prices. Ohio and Pennsylvania had the lowest SREC prices at \$31 per SREC and \$17 per SREC while New Jersey and Maryland have the highest Tier I REC prices at \$15 per REC and \$16 per REC.<sup>114 115</sup>

Figure 8-3 Average Tier I REC price by jurisdiction: 2009 through March 2016

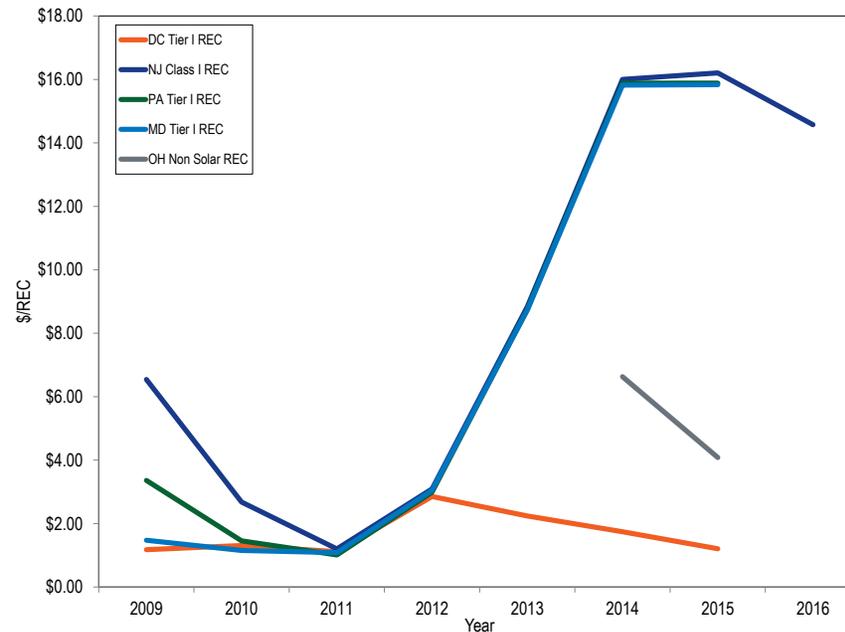


114 Tier I REC price information obtained through Evomarkets, <<http://www.evomarkets.com>> (Accessed May 3, 2016).

115 There were not any reported purchases of DC Tier I REC, MD Tier I REC, PA Tier I REC or OH Non Solar REC for the first three months of 2016.

Tier II prices are lower than SREC and Tier I REC prices. Figure 8-4 shows the average Tier II REC price by jurisdiction for 2009 through March 2016. DC had the lowest Tier II REC prices at \$1.17 per REC while New Jersey had the highest Tier II REC prices at \$6.00 per REC <sup>116 117</sup>

Figure 8-4 Average Tier II REC price by jurisdiction: 2009 through March 2016

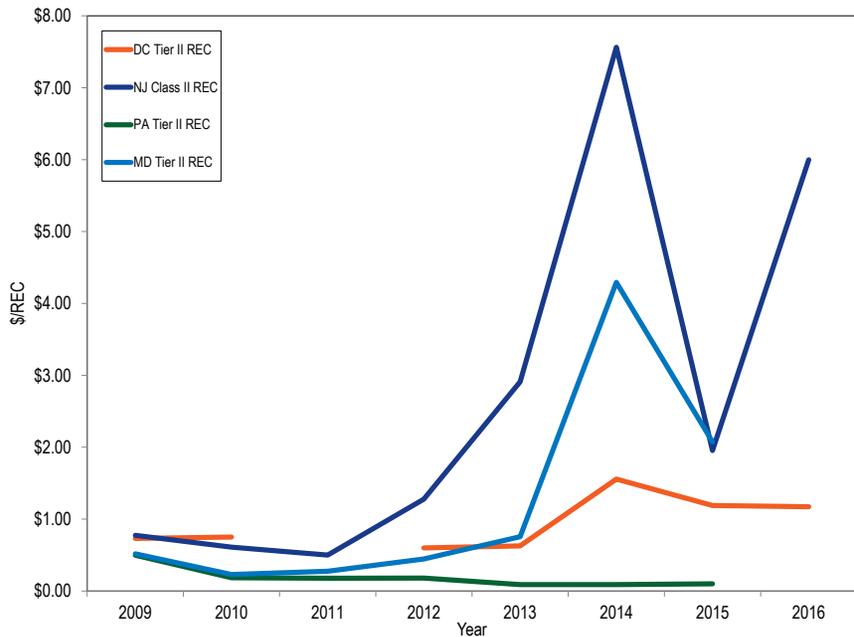

PJM jurisdictions include various methods for complying with required renewable portfolio standards. If a retail supplier is unable to comply with the renewable portfolio standards required by the jurisdiction, suppliers may make alternative compliance payments, with varying standards, to cover any shortfall between the RECs required by the state and those the retail supplier actually purchased. In New Jersey, solar alternative compliance payments are

116 Tier II REC price information obtained through Evomarkets <<http://www.evomarkets.com>> (Accessed May 3, 2016). There is no data reported by Evomarkets for DC in 2011.  
 117 There were not any reported purchases of PA Tier II REC or MD Tier II REC for the first three months of 2016.

\$323.00 per MWh.<sup>118</sup> Pennsylvania requires that the alternative compliance payment for solar credits be 200 percent of the average market value of solar RECs sold in the RTO. For all states with an alternative compliance payment, it is cheaper to buy the REC than pay the for the alternative compliance payment.

Compliance is defined in different ways by different jurisdictions. For example, Illinois requires that 50 percent of the state’s renewable portfolio standard be met through alternative compliance payments. Table 8-11 shows the alternative compliance standards in PJM jurisdictions, where such standards exist.

Table 8-11 Renewable alternative compliance payments in PJM jurisdictions: As of March 31, 2016<sup>119</sup>

Jurisdiction	Standard Alternative Compliance (\$/MWh)	Tier II Alternative Compliance (\$/MWh)	Solar Alternative Compliance (\$/MWh)
Delaware	\$25.00		\$400.00
Illinois	\$1.89		
Indiana	Voluntary standard		
Kentucky	No standard		
Maryland	\$40.00	\$15.00	\$350.00
Michigan	No specific penalties		
New Jersey	\$50.00		\$323.00
North Carolina	No specific penalties		
Ohio	\$45.00		\$300.00
Pennsylvania	\$45.00	\$45.00	200% market value
Tennessee	No standard		
Virginia	Voluntary standard		
Washington, D.C.	\$50.00	\$10.00	\$500.00
West Virginia	No standard		

Table 8-12 shows renewable resource generation by jurisdiction and resource type for the first three months of 2016. This includes only units that would qualify for REC credits by primary fuel type, including waste coal, battery, and pumped-storage hydroelectric, all of which can qualify for Pennsylvania Tier II credits if they are located in the PJM footprint. Wind output was 5,176.3 GWh of 8,590.7 Tier I GWh, or 60.3 percent, in the PJM footprint. As shown in

118 See Database of State Incentives for Renewables & Efficiency (DSIRE), New Jersey Incentives/ Policies for Renewables & Efficiency, "Solar Renewables Energy Certificates (SRECs)," <<http://programs.dsireusa.org/system/program/detail/5687>> (Accessed January 29, 2016).  
 119 See PJM – EIS (Environmental Management System). "Program Information," <<http://www.pjm-eis.com/>> (Accessed April 1, 2016).

Table 8-12 Renewable resource generation by jurisdiction and renewable resource type (GWh): January through March 2016

Jurisdiction	Landfill Gas	Pumped-Storage Hydro	Run-of-River Hydro	Solar	Solid Waste	Waste Coal	Wind	Tier 1 Credit Only	Total Credit GWh
Delaware	10.0	0.0	0.0	0.0	0.0	0.0	0.0	10.0	20.0
Illinois	25.0	0.0	0.0	2.3	0.0	0.0	2,263.2	2,290.5	2,290.5
Indiana	14.4	0.0	11.1	0.0	0.0	0.0	1,258.1	1,283.6	1,283.6
Kentucky	0.0	0.0	109.7	0.0	0.0	0.0	0.0	109.7	109.7
Maryland	23.1	0.0	656.3	13.9	133.3	0.0	145.5	838.8	972.1
Michigan	6.1	0.0	18.3	0.0	0.0	0.0	0.0	24.4	24.4
New Jersey	71.8	112.9	7.3	83.9	355.0	0.0	2.8	165.8	633.6
North Carolina	0.0	0.0	337.0	9.7	0.0	0.0	0.0	346.8	346.8
Ohio	81.7	0.0	76.1	0.3	0.0	0.0	402.6	560.7	560.7
Pennsylvania	317.6	348.9	918.5	5.6	411.6	2,950.7	1,104.0	2,345.7	6,056.8
Tennessee	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Virginia	129.4	738.1	178.1	0.0	271.8	969.4	0.0	307.4	2,286.7
Washington, D.C.	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
West Virginia	0.0	0.0	307.3	0.0	0.0	0.0	0.0	307.3	307.3
Total	679.1	1,199.8	2,619.7	115.6	1,171.6	3,920.1	5,176.3	8,590.7	14,882.2
Percent Total	4.6%	8.1%	17.6%	0.8%	7.9%	26.3%	34.8%	57.7%	100.0%

Table 8-13 PJM renewable capacity by jurisdiction (MW): April 1, 2016

Jurisdiction	Coal	Landfill Gas	Natural Gas	Oil	Pumped-Storage Hydro	Run-of-River Hydro	Solar	Solid Waste	Waste Coal	Wind	Total
Delaware	0.0	8.1	1,797.0	13.0	0.0	0.0	0.0	0.0	0.0	0.0	1,818.1
Illinois	0.0	43.1	0.0	0.0	0.0	0.0	9.0	0.0	0.0	2,362.4	2,414.5
Indiana	0.0	8.0	0.0	0.0	0.0	8.2	0.0	0.0	0.0	1,602.4	1,618.6
Iowa	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	185.0	185.0
Kentucky	0.0	0.0	0.0	0.0	0.0	166.0	0.0	0.0	0.0	0.0	166.0
Maryland	0.0	25.1	0.0	69.0	0.0	494.4	53.1	128.2	0.0	190.0	959.8
Michigan	0.0	8.0	0.0	0.0	0.0	13.9	0.0	0.0	0.0	0.0	21.9
New Jersey	0.0	79.7	0.0	0.0	453.0	11.5	314.5	162.0	0.0	4.5	1,025.2
North Carolina	0.0	0.0	0.0	0.0	0.0	352.5	207.1	0.0	0.0	0.0	559.6
Ohio	11,080.0	63.4	580.0	156.0	0.0	119.1	1.1	0.0	0.0	403.0	12,402.6
Pennsylvania	0.0	208.0	2,346.0	0.0	1,269.0	888.3	19.5	345.8	1,611.0	1,337.7	8,025.3
Tennessee	0.0	0.0	0.0	0.0	0.0	52.0	0.0	50.0	0.0	0.0	102.0
Virginia	0.0	224.1	0.0	17.0	5,166.2	350.5	0.0	444.9	585.0	0.0	6,787.7
West Virginia	8,772.0	2.2	519.0	0.0	0.0	257.9	0.0	0.0	165.0	583.3	10,299.4
PJM Total	19,852.0	669.6	5,242.0	255.0	6,888.2	2,714.2	604.4	1,130.9	2,361.0	6,668.2	46,385.5

Table 8-12, 14,882.2 GWh were generated by renewable resources, including both Tier II and Tier I renewable credits, of which, Tier I type resources accounted for 57.7 percent. Total renewable generation was 7.6 percent of total generation in PJM for the first three months of 2016. Landfill gas, solid waste and waste coal were 5,770.8 GWh of renewable resource generation or 38.8 percent of the total Tier I and Tier II.

Table 8-13 shows the capacity of renewable resources in PJM by jurisdiction, as defined by primary fuel type. This capacity includes coal and natural gas units that have a renewable fuel as an alternative fuel, and thus are able to earn renewable energy credits based on the fuel used to generate energy. New Jersey has the largest amount of solar capacity in PJM, 314.5 MW, or 52.0 percent of the total solar capacity. New Jersey's SREC prices were the highest

in 2010 at \$674 per REC, and in the first three months of 2016 are at \$290 per REC. Wind resources are located primarily in western PJM, in Illinois and Indiana, which include 3,964.7 MW, or 59.5 percent of the total wind capacity.

Table 8-14 shows renewable capacity registered in the PJM generation attribute tracking system (GATS). This includes solar capacity of 2,420.1 MW of which 1,247.1 MW is in New Jersey. These resources can also earn renewable energy credits, and can be used to fulfill the renewable portfolio standards in PJM jurisdictions. Some of this capacity is located in jurisdictions outside PJM, but may qualify for specific renewable energy credits in some PJM jurisdictions. This includes both solar generation located inside PJM but not PJM units, and generation connected to other RTOs outside PJM.

**Table 8-14 Renewable capacity by jurisdiction, non-PJM units registered in GATS (MW), on April 1, 2016<sup>120</sup>**

Jurisdiction	Coal	Hydroelectric	Landfill Gas	Natural Gas	Other Gas	Other Source	Solar	Solid Waste	Wind	Total
Alabama	0.0	0.0	0.0	0.0	0.0	0.0	0.0	87.5	0.0	87.5
Arkansas	0.0	135.0	0.0	0.0	18.0	0.0	0.0	0.0	0.0	153.0
Delaware	0.0	0.0	2.2	0.0	0.0	0.0	69.3	0.0	2.1	73.6
Georgia	0.0	0.0	0.0	0.0	0.0	0.0	38.7	258.9	0.0	297.6
Illinois	0.0	6.6	76.9	0.0	0.6	0.0	38.5	0.0	600.5	723.2
Indiana	0.0	0.0	43.2	0.0	6.2	234.6	4.3	0.0	180.0	468.3
Iowa	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	475.0	475.1
Kentucky	600.0	2.2	17.6	0.0	0.0	0.0	1.9	93.0	0.0	714.7
Louisiana	0.0	0.0	0.0	0.0	0.0	0.0	0.0	129.2	0.0	129.2
Maryland	65.0	0.0	11.7	129.0	0.0	0.0	393.1	15.0	0.3	614.1
Michigan	55.0	1.3	3.2	0.0	0.0	0.0	1.7	0.0	0.0	61.2
Missouri	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	446.0	446.0
New Jersey	0.0	0.0	55.0	0.0	8.3	0.0	1,247.1	0.0	5.0	1,315.4
New York	0.0	158.7	0.0	0.0	0.0	0.0	0.4	0.0	0.0	159.1
North Carolina	0.0	242.5	12.0	0.0	0.0	0.0	259.6	30.0	0.0	544.1
North Dakota	0.0	0.0	360.0	0.0	0.0	0.0	0.0	0.0	0.0	360.0
Ohio	0.0	1.0	33.6	92.6	16.4	32.4	119.7	109.3	26.2	431.2
Pennsylvania	109.7	37.0	44.7	91.0	12.6	5.0	210.6	68.6	3.3	582.3
Tennessee	0.0	52.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	52.0
Texas	0.0	0.0	0.0	0.0	0.0	0.0	0.0	57.7	0.0	57.7
Virginia	0.0	18.2	14.5	0.0	0.5	0.0	13.5	287.6	0.0	334.2
West Virginia	0.0	9.0	0.0	0.0	0.0	0.0	0.4	44.6	0.0	54.0
Wisconsin	0.0	42.0	0.0	0.0	0.0	0.0	2.7	0.0	0.0	44.7
District of Columbia	0.0	0.0	0.0	0.0	0.0	0.0	18.4	0.0	0.0	18.4
<b>Total</b>	<b>829.7</b>	<b>705.4</b>	<b>674.6</b>	<b>312.6</b>	<b>62.5</b>	<b>272.0</b>	<b>2,420.1</b>	<b>1,181.4</b>	<b>1,738.5</b>	<b>8,196.8</b>

<sup>120</sup> See PJM – EIS (Environmental Information Services), "Renewable Generators Registered in GATS," <<http://www.pjm-eis.com/reports-and-news/public-reports.aspx>> (Accessed April 1, 2016).

## Emissions Controlled Capacity and Renewables in PJM Markets

### Emission Controlled Capacity in the PJM Region

Environmental regulations affect decisions about emission control investments in existing units, investment in new units and decisions to retire units lacking emission controls.<sup>121</sup> Many PJM units burning fossil fuels have installed emission control technology.

Coal has the highest SO<sub>2</sub> emission rate, while natural gas and diesel oil have lower SO<sub>2</sub> emission rates.<sup>122</sup> Of the current 64,128.1 MW of coal capacity in PJM, 55,973.0 MW of capacity, 87.3 percent, has some form of FGD (flue-gas desulfurization) technology to reduce SO<sub>2</sub> emissions. Table 8-15 shows SO<sub>2</sub> emission controls by fossil fuel fired units in PJM.<sup>123 124</sup>

**Table 8-15 SO<sub>2</sub> emission controls by fuel type (MW): as of March 31, 2016<sup>125</sup>**

	SO2 Controlled	No SO2 Controls	Total	Percent Controlled
Coal	55,973.0	8,155.1	64,128.1	87.3%
Diesel Oil	0.0	6,000.6	6,000.6	0.0%
Natural Gas	0.0	51,490.3	51,490.3	0.0%
Other	325.0	4,920.7	5,245.7	6.2%
Total	56,298.0	70,566.7	126,864.7	44.4%

NO<sub>x</sub> emission control technology is used by all fossil fuel fired unit types. Of current fossil fuel fired units in PJM, 118,459.0 MW, 93.4 percent, of 126,864.7 MW of capacity in PJM, have emission controls for NO<sub>x</sub>. Table 8-16 shows NO<sub>x</sub> emission controls by unit type in PJM. While most units in PJM have NO<sub>x</sub> emission controls, many of these controls may need to be upgraded in order to meet each state's emission compliance standards based on whether a state is part of CSAPR, CAIR, Acid Rain Program (ARP) or a combination of the three. Future NO<sub>x</sub> compliance standards will require select catalytic converters

121 See EPA. "National Ambient Air Quality Standards (NAAQS)," <<https://www3.epa.gov/ttn/naaqs/criteria.html>> (Accessed May 4, 2016).

122 Diesel oil includes number 1, number 2, and ultra-low sulfur diesel. See EPA. "Electronic Code of Federal Regulations, Section 72.2" <<http://www.ecfr.gov/cgi-bin/retrieveECFR?gp=&SID=5584e589aef37add39257c1f0c1617e4&tr=PART&n=40y17.0.1.1.1#se40.17.72>> (Accessed February 24, 2016).

123 See EPA. "Air Market Programs Data," <<http://ampd.epa.gov/ampd/>> (Accessed May 4, 2016).

124 The total MW for each fuel type are less than the 177,682.8 MW reported in Section 5: Capacity, because EPA data on controls could not be matched to some PJM units. "Air Markets Program Data," <<http://ampd.epa.gov/ampd/QueryToolie.html>> (Accessed May 4, 2016).

125 The "other" category includes petroleum coke, wood, process gas, residual oil, other gas, and other oil.

(SCRs) or selective non-catalytic reduction (SCNRs) for coal steam units, as well as SCRs or water injection technology for peaking combustion turbine units.<sup>126</sup>

**Table 8-16 NO<sub>x</sub> emission controls by fuel type (MW), as of March 31, 2015**

	NOx Controlled	No NOx Controls	Total	Percent Controlled
Coal	63,188.8	939.3	64,128.1	98.5%
Diesel Oil	2,207.6	3,793.0	6,000.6	36.8%
Natural Gas	50,262.9	1,227.4	51,490.3	97.6%
Other	2,799.7	2,446.0	5,245.7	53.4%
Total	118,459.0	8,405.7	126,864.7	93.4%

Most coal units in PJM have particulate controls due to the NAAQS and CSAPR. Typically, technologies such as electrostatic precipitators (ESP) or fabric filters (baghouses) are used to reduce particulate matter from coal steam units.<sup>127</sup> Fabric filters work by allowing the flue gas to pass through a tightly woven fabric which filters out the particulates. Table 8-17 shows particulate emission controls by unit type in PJM. In PJM, 63,794.1 MW, 99.5 percent, of all coal steam unit MW, have some type of particulate emissions control technology, as of March 31, 2016. Most coal steam units in PJM have particulate emission controls in the form of ESPs, but many units have also installed baghouse technology, or a combination of an FGD and SCR to meet the state and federal emissions limits established by the MATS EPA regulations.<sup>128</sup> Currently, 141 of the 173 coal steam units have baghouse or FGD technology installed, representing 55,058 MW out of the 64,128.1 MW total coal capacity, or 85.9 percent.

**Table 8-17 Particulate emission controls by fuel type (MW), as of March 31, 2016**

	Particulate Controlled	No Particulate Controls	Total	Percent Controlled
Coal	63,794.1	334.0	64,128.1	99.5%
Diesel Oil	0.0	6,000.6	6,000.6	0.0%
Natural Gas	260.0	51,230.3	51,490.3	0.5%
Other	3,102.0	2,143.7	5,245.7	59.1%
Total	67,156.1	59,708.6	126,864.7	52.9%

126 See EPA. "Mercury and Air Toxics Standards," <<http://www.epa.gov/mats/index.html>> (Accessed January 29, 2016).


127 See EPA. "Air Pollution Control Technology Fact Sheet," <<http://www.epa.gov/ttnchie1/mkb/documents/ff-pulse.pdf>> (Accessed May 4, 2016).

128 These regulations became effective April 16, 2015. See EPA. "Mercury and Air Toxics Standards," <<http://www.epa.gov/mats/index.html>> (Accessed May 4, 2016).

Figure 8-5 shows the total CO<sub>2</sub> short ton emissions (in millions) and the CO<sub>2</sub> short ton emissions per MWh within PJM for the first three months of each year.<sup>129</sup> Since 1999 the amount of CO<sub>2</sub> produced per MWh was at a minimum of 0.81 short tons per MWh in the first three months of 2001, and a maximum of 0.94 short tons per MWh in the first three months of 2010. In the first three months of 2016, CO<sub>2</sub> short tons emissions were 0.84 per MWh.

Figure 8-6 shows the total SO<sub>2</sub> and NO<sub>x</sub> short ton emissions (in thousands) and the short ton emissions per MWh within PJM for the first three months of each year. Since 1999 the amount of SO<sub>2</sub> produced per MWh was at a minimum of 0.000807 short tons per MWh in the first three months of 2016, and a maximum of 0.006499 short tons per MWh in the first three months of 2004. Since 1999, the amount of NO<sub>x</sub> produced per MWh was at a minimum of 0.000636 short tons per MWh in the first three months of 2016, and a maximum of 0.002202 short tons per MWh in the first three months of 2005. In the first three months of 2016, SO<sub>2</sub> short ton emissions were 0.000807 per MWh and NO<sub>x</sub> short ton emissions were 0.000636 per MWh.


Figure 8-5 CO<sub>2</sub> emissions by year (millions of short tons), by PJM units: January 1999 through March 2016<sup>130</sup>

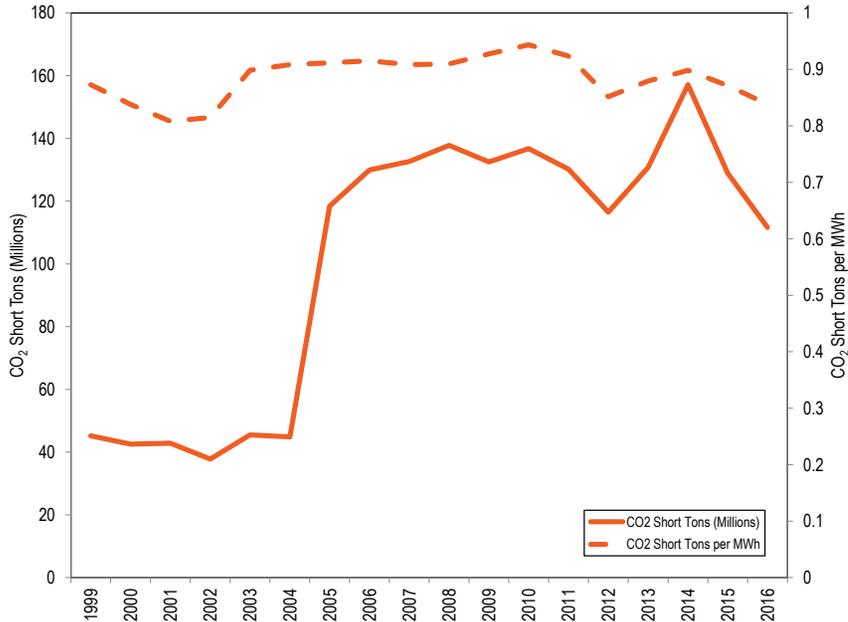

129 Unless otherwise noted, emissions are measured in short tons. A short ton is 2,000 pounds.

130 The emissions are calculated from the continuous emission monitoring system (CEMS) data from generators located within the PJM footprint.

Figure 8-6 SO<sub>2</sub> and NO<sub>x</sub> emissions by year (thousands of short tons), by PJM units: January 1999 through March 2016<sup>131</sup>

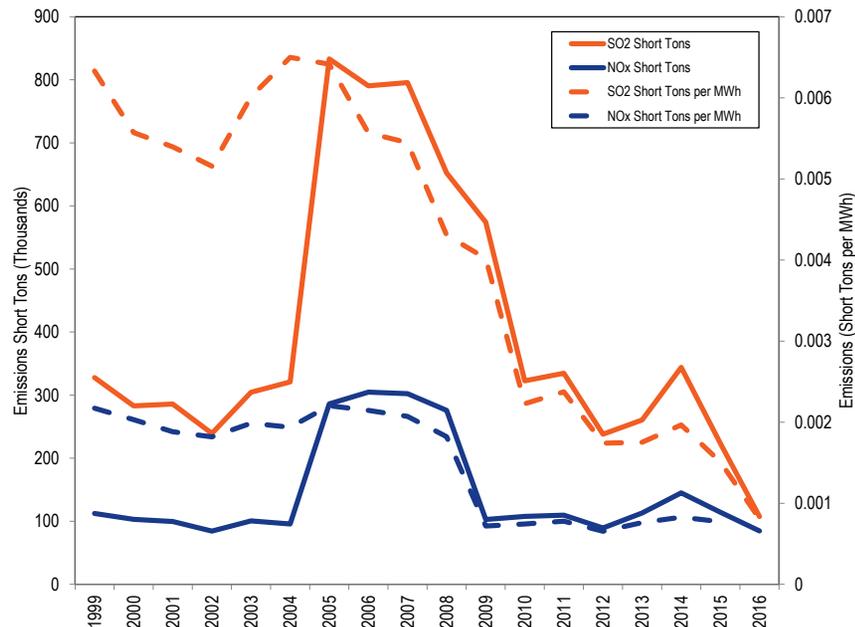

### Wind Units

Table 8-18 shows the capacity factor of wind units in PJM. In the first three months of 2016, the capacity factor of wind units in PJM was 38.2 percent. Wind units that were capacity resources had a capacity factor of 39.2 percent and an installed capacity of 6,368 MW. Wind units that were classified as energy only had a capacity factor of 28.0 percent and an installed capacity of 589 MW. Wind capacity in RPM is derated to 13 percent of nameplate capacity for the capacity market, and energy only resources are not included in the capacity market.<sup>132</sup>

<sup>131</sup> The emissions are calculated from the continuous emission monitoring system (CEMS) data from generators located within the PJM footprint.


<sup>132</sup> Wind resources are derated to 13 percent unless demonstrating higher availability during peak periods.

Table 8-18 Capacity factor of wind units in PJM: January through March 2016<sup>133</sup>

Type of Resource	Capacity Factor	Installed Capacity (MW)
Energy-Only Resource	28.0%	589
Capacity Resource	39.2%	6,368
All Units	38.2%	6,957

Figure 8-7 shows the average hourly real-time generation of wind units in PJM, by month. The highest average hour, 3,303.5 MW, occurred in January, and the lowest average hour, 2,176.2 MW, occurred in March. Wind output in PJM is generally higher in off-peak hours and lower in on-peak hours.

Figure 8-7 Average hourly real-time generation of wind units in PJM: January through March 2016

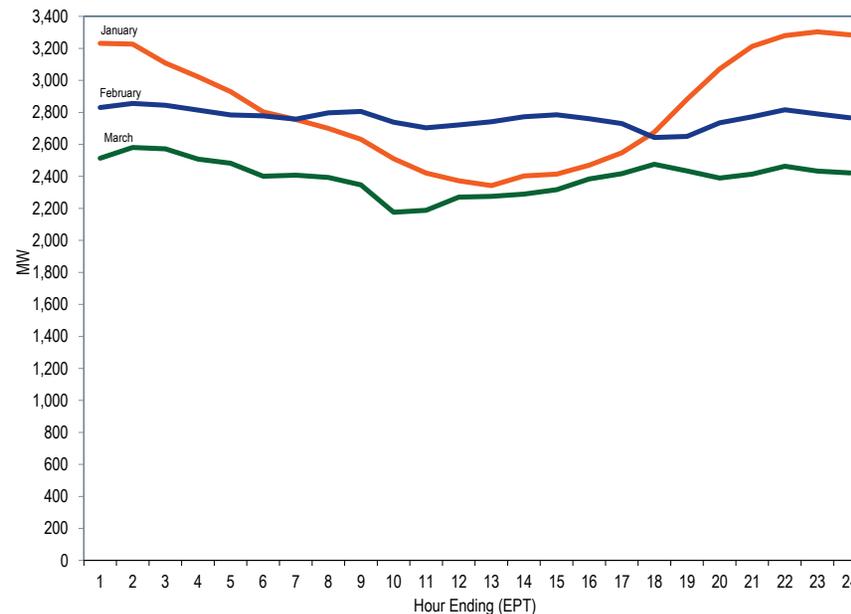

<sup>133</sup> Capacity factor is calculated based on online date of the resource.


Table 8-19 shows the generation and capacity factor of wind units in each month of 2015 through March 2016.

**Table 8-19 Capacity factor of wind units in PJM by month: 2015 through March 2016**

Month	2015		2016	
	Generation (MWh)	Capacity Factor	Generation (MWh)	Capacity Factor
January	1,664,426.8	33.9%	2,095,618.0	40.5%
February	1,511,093.1	34.1%	1,925,470.3	39.8%
March	1,701,249.6	34.7%	1,781,561.4	34.5%
April	1,641,965.0	34.5%		
May	1,209,088.5	24.6%		
June	955,156.7	20.1%		
July	639,381.7	13.0%		
August	623,873.6	12.4%		
September	846,505.6	17.3%		
October	1,756,221.4	34.8%		
November	2,023,340.0	41.3%		
December	2,037,436.4	39.8%		
Annual	16,609,738.2	28.3%	5,802,649.7	38.2%


Wind units that are capacity resources are required, like all capacity resources except Demand Resources, to offer the energy associated with their cleared capacity in the Day-Ahead Energy Market and in the Real-Time Energy Market. Wind units may offer non-capacity related wind energy at their discretion. Figure 8-8 shows the average hourly day-ahead generation offers of wind units in PJM, by month. The hourly day-ahead generation offers of wind units in PJM may vary.

**Figure 8-8 Average hourly day-ahead generation of wind units in PJM: January through March 2016**

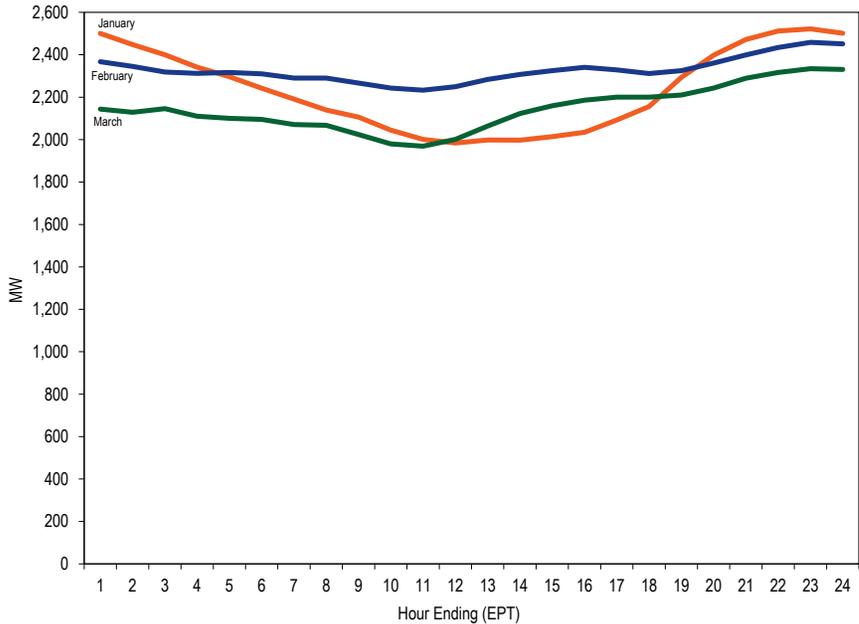

Output from wind turbines displaces output from other generation types. This displacement affects the output of marginal units in PJM. The magnitude and type of effect on marginal unit output depends on the level of the wind turbine output, its location, time and duration. One measure of this displacement is based on the mix of marginal units when wind is producing output. Figure 8-9 shows the hourly average proportion of marginal units by fuel type mapped to the hourly average MW of real-time wind generation in the first three months of 2016. This is not an exact measure of displacement because it is not based on a redispatch of the system without wind resources. When wind appears as the displaced fuel at times when wind resources were on the margin this means that there was no displacement for those hours.

Figure 8-9 Marginal fuel at time of wind generation in PJM: January through March 2016

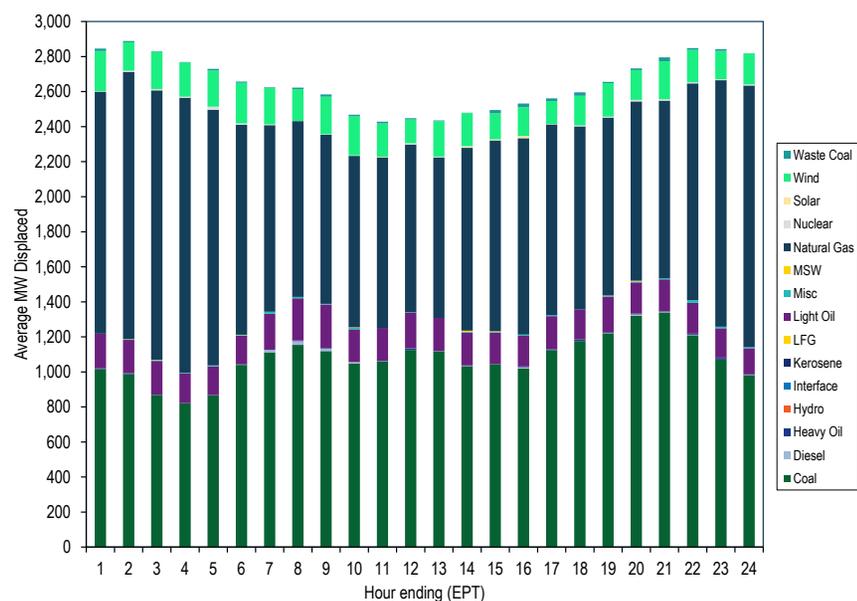

### Solar Units

Table 8-20 shows the capacity factor of solar units in PJM. In the first three months of 2016, the capacity factor of solar units in PJM was 14.4 percent. Solar units that were capacity resources had a capacity factor of 13.3 percent and an installed capacity of 323 MW. Solar units that were classified as energy only had a capacity factor of 15.8 percent and an installed capacity of 254 MW. Solar capacity in RPM is derated to 38 percent of nameplate capacity for the capacity market, and energy only resources are not included in the capacity market.<sup>134</sup>

<sup>134</sup> Solar resources are derated to 38 percent unless demonstrating higher availability during peak periods.

Table 8-20 Capacity factor of wind units in PJM: January through March 2016

Type of Resource	Capacity Factor	Installed Capacity (MW)
Energy-Only Resource	15.8%	254
Capacity Resource	13.3%	323
All Units	14.4%	577

Solar output differs from month to month, based on seasonal variation and daylight hours during the month. Figure 8-10 shows the average hourly real-time generation of solar units in PJM, by month. Solar generation was highest in March, the month with the highest average hour, 324.8 MW, compared to 577 MW of solar installed capacity in PJM. Solar generation in PJM is highest during the hours of 11:00 through 13:00 EPT.

Figure 8-10 Average hourly real-time generation of solar units in PJM: January through March 2016

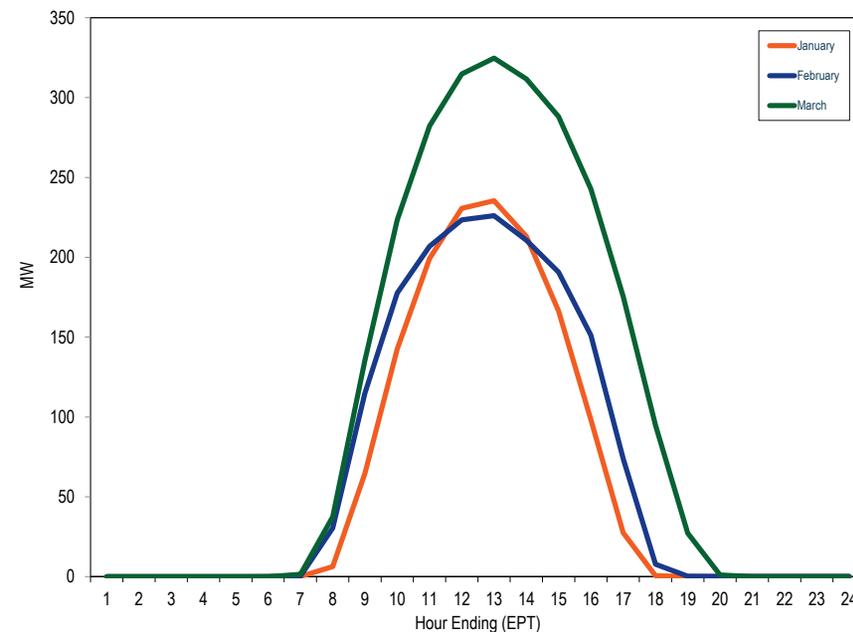



Table 8-21 shows the generation and capacity factor of wind units in each month of 2015 through March 2016.

**Table 8-21 Capacity factor of solar units in PJM by month: 2015 through March 2016**

Month	2015		2016	
	Generation (MWh)	Capacity Factor	Generation (MWh)	Capacity Factor
January	19,935.6	8.8%	25,967.1	10.8%
February	27,609.2	13.3%	26,416.5	11.8%
March	32,677.1	13.7%	41,467.3	17.3%
April	45,376.5	19.5%		
May	53,368.8	22.2%		
June	45,158.2	19.4%		
July	52,125.7	21.7%		
August	52,751.5	22.0%		
September	42,099.8	18.1%		
October	37,085.5	15.4%		
November	25,881.6	11.1%		
December	17,067.0	7.1%		
Annual	451,136.5	16.1%	93,850.9	13.3%

Solar units that are capacity resources are required, like all capacity resources except Demand Resources, to offer the energy associated with their cleared capacity in the Day-Ahead Energy Market and in the Real-Time Energy Market. Solar units may offer non-capacity related solar energy at their discretion. Figure 8-11 shows the average hourly day-ahead generation offers of solar units in PJM, by month.<sup>135</sup>

**Figure 8-11 Average hourly day-ahead generation of solar units in PJM: January through March 2016**

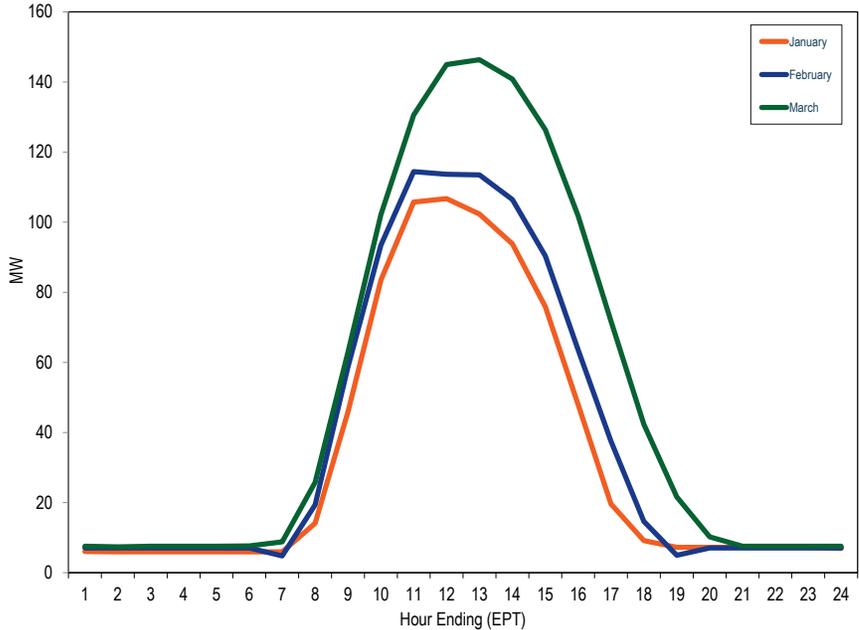

<sup>135</sup> The average day-ahead generation of solar units in PJM is greater than 0 for hours when the sun is down due to some solar units being paired with landfill units.



## Interchange Transactions

PJM market participants import energy from, and export energy to, external regions continuously. The transactions involved may fulfill long-term or short-term bilateral contracts or respond to price differentials. The external regions include both market and non-market balancing authorities.

### Overview

#### Interchange Transaction Activity

- Aggregate Imports and Exports in the Real-Time Energy Market.** In the first three months of 2016, PJM was a net importer of energy in the Real-Time Energy Market in all months.<sup>1</sup> In the first three months of 2016, the real-time net interchange of 5,689.8 GWh was higher than net interchange of 5,516.5 GWh in the first three months of 2015.
- Aggregate Imports and Exports in the Day-Ahead Energy Market.** In the first three months of 2016, PJM was a net importer of energy in the Day-Ahead Energy Market in all months. In the first three months of 2016, the total day-ahead net interchange of 1,369.2 GWh was higher than net interchange of 212.5 GWh in the first three months of 2015. The large difference in the day-ahead net interchange totals was a result of up to congestion transaction volumes.<sup>2</sup>
- Aggregate Imports and Exports in the Day-Ahead and the Real-Time Energy Market.** In the first three months of 2016, gross imports in the Day-Ahead Energy Market were 108.1 percent of gross imports in the Real-Time Energy Market (68.8 percent in the first three months of 2015). In the first three months of 2016, gross exports in the Day-Ahead Energy Market were 174.3 percent of the gross exports in the Real-Time Energy Market (103.9 percent in the first three months of 2015).
- Interface Imports and Exports in the Real-Time Energy Market.** In the first three months of 2016, there were net scheduled exports at seven of PJM's 20 interfaces in the Real-Time Energy Market.
- Interface Pricing Point Imports and Exports in the Real-Time Energy Market.** In the first three months of 2016, there were net scheduled exports at 10 of PJM's 18 interface pricing points eligible for real-time transactions in the Real-Time Energy Market.<sup>3</sup>
- Interface Imports and Exports in the Day-Ahead Energy Market.** In the first three months of 2016, there were net scheduled exports at eight of PJM's 20 interfaces in the Day-Ahead Energy Market.
- Interface Pricing Point Imports and Exports in the Day-Ahead Energy Market.** In the first three months of 2016, there were net scheduled exports at nine of PJM's 19 interface pricing points eligible for day-ahead transactions in the Day-Ahead Energy Market.
- Up to Congestion Interface Pricing Point Imports and Exports in the Day-Ahead Energy Market.** In the first three months of 2016, up to congestion transactions were net exports at three of PJM's 19 interface pricing points eligible for day-ahead transactions in the Day-Ahead Market.
- Inadvertent Interchange.** In the first three months of 2016, net scheduled interchange was 5,690 GWh and net actual interchange was 6,564 GWh, a difference of 874 GWh. In the first three months of 2015, the difference was 14 GWh. This difference is inadvertent interchange.
- Loop Flows.** In the first three months of 2016, the Wisconsin Energy Corporation (WEC) interface had the largest loop flows of any interface with -153 GWh of net scheduled interchange and 2,340 GWh of net actual interchange, a difference of 2,493 GWh. (Table 9-18.) In the first three months of 2016, the SouthIMP interface pricing point had the largest loop flows of any interface pricing point with 5,766 GWh of net scheduled interchange and 8,674 GWh of net actual interchange, a difference of 2,908 GWh.

<sup>1</sup> Calculated values shown in Section 9, "Interchange Transactions," are based on unrounded, underlying data and may differ from calculations based on the rounded values in the tables.

<sup>2</sup> On August 29, 2014, FERC issued an Order which created an obligation for UTCs to pay any uplift determined to be appropriate in the Commission review, effective September 8, 2014. 18 CFR § 385.213.

<sup>3</sup> There is one interface pricing point eligible for day-ahead transaction scheduling only (NIPSCO).

## Interactions with Bordering Areas

### PJM Interface Pricing with Organized Markets

- **PJM and MISO Interface Prices.** In the first three months of 2016, the direction of the hourly flow was consistent with the real-time hourly price differences between the PJM/MISO Interface and the MISO/PJM Interface in 57.4 percent of the hours.
- **PJM and New York ISO Interface Prices.** In the first three months of 2016, the direction of the hourly flow was consistent with the real-time hourly price differences between the PJM/NYIS Interface and the NYISO/PJM proxy bus in 57.0 percent of the hours.
- **Neptune Underwater Transmission Line to Long Island, New York.** In the first three months of 2016, the hourly flow (PJM to NYISO) was consistent with the real-time hourly price differences between the PJM Neptune Interface and the NYISO Neptune bus in 53.7 percent of the hours.
- **Linden Variable Frequency Transformer (VFT) Facility.** In the first three months of 2016, the hourly flow (PJM to NYISO) was consistent with the real-time hourly price differences between the PJM Linden Interface and the NYISO Linden bus in 56.0 percent of the hours.
- **Hudson DC Line.** In the first three months of 2016, the hourly flow (PJM to NYISO) was consistent with the real-time hourly price differences between the PJM Hudson Interface and the NYISO Hudson bus in 0.9 percent of the hours.

### Interchange Transaction Issues

- **PJM Transmission Loading Relief Procedures (TLRs).** PJM issued eight TLRs of level 3a or higher in the first three months of 2016, compared to 16 such TLRs issued in the first three months of 2015.
- **Up to congestion.** On August 29, 2014, FERC issued an Order which created an obligation for up to congestion transactions to pay any uplift determined to be appropriate after Commission review, effective

September 8, 2014.<sup>4</sup> As a result of the uncertainty about the level of the required uplift charges, market participants reduced up to congestion trading. There was an increase in up to congestion volume starting in December 2015, coincident with the expiration of the fifteen month limit on the payment of prior uplift charges.<sup>5</sup> The average number of up to congestion bids increased by 117.9 percent and the average cleared volume of up to congestion bids increased by 113.2 percent in the first three months of 2016, compared to the first three months of 2015.

- **45 Minute Schedule Duration Rule.** Effective May 19, 2014, PJM removed the 45 minute scheduling duration rule in response to FERC Order No. 764.<sup>6</sup> <sup>7</sup> PJM and the MMU issued a statement indicating ongoing concern about market participants' scheduling behavior, and a commitment to address any scheduling behavior that raises operational or market manipulation concerns.<sup>8</sup>

## Recommendations

- The MMU recommends that PJM eliminate the IMO interface pricing point, and assign the transactions that originate or sink in the IESO balancing authority to the MISO interface pricing point. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM monitor, and adjust as necessary, the weights applied to the components of the interfaces to ensure that the interface prices reflect ongoing changes in system conditions. The MMU also recommends that PJM review the mappings of external balancing authorities to individual interface pricing points to reflect changes to the impact of the external power source on PJM tie lines as a result of system topology changes. The MMU recommends that this review occur at least annually. (Priority: Low. First reported 2009. Status: Not adopted.)
- The MMU recommends that the submission deadline for real-time dispatchable transactions be modified from 1800 on the day prior, to

<sup>4</sup> 148 FERC ¶ 61,144 (2014). *Order Instituting Section 206 Proceeding and Establishing Procedures.*

<sup>5</sup> 16 U.S.C. § 824e.

<sup>6</sup> *Integration of Variable Energy Resources*, Order No. 764, 139 FERC ¶ 61,246 (2012), *order on reh'g*, Order No. 764-A, 141 FERC ¶ 61231 (2012).

<sup>7</sup> See Letter Order, Docket No. ER14-381-000 (June 30, 2014).

<sup>8</sup> See joint statement of PJM and the MMU re Interchange Scheduling issued July 29, 2014, which can be accessed at: <<http://www.pjm.com/~media/documents/reports/20140729-pjm-imm-joint-statement-on-interchange-scheduling.ashx>>.

three hours prior to the requested start time, and that the minimum duration be modified from one hour to 15 minutes. These changes would give PJM a more flexible product that could be used to meet load in the most economic manner. (Priority: Medium. First reported 2014. Status: Adopted partially, Q1 2015.)

- The MMU recommends that PJM explore an interchange optimization solution with its neighboring balancing authorities that would remove the need for market participants to schedule physical transactions across seams. Such a solution would include an optimized, but limited, joint dispatch approach that uses supply curves and treats seams between balancing authorities as constraints, similar to other constraints within an LMP market. (Priority: Medium. First reported 2014. Status: Not adopted.)
- The MMU recommends that PJM permit unlimited spot market imports as well as unlimited non-firm point-to-point willing to pay congestion imports and exports at all PJM interfaces in order to improve the efficiency of the market. (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM implement a validation method for submitted transactions that would prohibit market participants from breaking transactions into smaller segments to defeat the interface pricing rule by concealing the true source or sink of the transaction. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM implement a validation method for submitted transactions that would require market participants to submit transactions on market paths that reflect the expected actual power flow in order to reduce unscheduled loop flows. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM implement rules to prevent sham scheduling. The MMU's proposed validation rules would address sham scheduling. (Priority: High. First reported 2012. Status: Not adopted. Stakeholder process.)
- The MMU requests that, in order to permit a complete analysis of loop flow, FERC and NERC ensure that the identified data are made available to market monitors as well as other industry entities determined appropriate by FERC. (Priority: Medium. First reported 2003. Status: Not adopted.)
- The MMU recommends that PJM implement additional business rules to remove the incentive to engage in sham scheduling activities using the PJM/IMO interface price. (Priority: Medium. First reported 2014. Status: Not adopted. Stakeholder process.)
- The MMU recommends that PJM eliminate the NIPSCO, Southeast and Southwest interface pricing points from the Day-Ahead and Real-Time Energy Markets and, with VACAR, assign the transactions created under the reserve sharing agreement to the SouthIMP/EXP pricing point. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM immediately provide the required 12-month notice to Duke Energy Progress (DEP) to unilaterally terminate the Joint Operating Agreement. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM and MISO work together to align interface pricing definitions, using the same number of external buses and selecting buses in close proximity on either side of the border with comparable bus weights. (Priority: Medium. First reported 2012. Status: Adopted partially, Q4 2013.)
- The MMU recommends that PJMSettlement Inc. immediately request a credit evaluation from all companies that engaged in up to congestion transactions between September 8, 2014, and December 31, 2015. If PJM has the authority, PJM should ensure that the potential exposure to uplift for that period be included as a contingency in the companies' calculations for credit levels and/or collateral requirements. If PJM does not have the authority to take such steps, PJM should request guidance from FERC. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that the emergency interchange cap be replaced with a market based solution. (Priority: Low. First reported 2015. Status: Not adopted.)

## Conclusion

Transactions between PJM and multiple balancing authorities in the Eastern Interconnection are part of a single energy market. While some of these balancing authorities are termed market areas and some are termed non-market areas, all electricity transactions are part of a single energy market. Nonetheless, there are significant differences between market and non-market areas. Market areas, like PJM, include essential features such as locational marginal pricing, financial congestion offsets (FTRs and ARRs in PJM) and transparent, least cost, security constrained economic dispatch for all available generation. Non-market areas do not include these features. The market areas are extremely transparent and the non-market areas are not transparent.

The MMU's recommendations related to transactions with external balancing authorities all share the goal of improving the economic efficiency of interchange transactions. The standard of comparison is an LMP market. In an LMP market, redispatch based on LMP and competitive generator offers results in an efficient dispatch and efficient prices. The goal of designing interface transaction rules should be to match the outcome that would exist in an LMP market.

## Interchange Transaction Activity

### Aggregate Imports and Exports

In the first three months of 2016, PJM was a monthly net exporter of energy in the Real-Time Energy Market in all months (Figure 9-1).<sup>9</sup> In the first three months of 2016, the total real-time net interchange of 5,689.8 GWh was higher than the net interchange of 5,516.5 GWh in the first three months of 2015. In the first three months of 2016, the peak month for net importing interchange was January, 2,107.6 GWh; in the first three months of 2015 it was March, 2,197.2 GWh. Gross monthly export volumes in the first three months of 2016 averaged 2,406.2 GWh compared to 3,404.9 GWh in the first three months of 2015, while gross monthly imports in the first three months of 2016 averaged 4,302.8 GWh compared to 5,243.7 GWh in the first three months of 2015.

<sup>9</sup> Calculated values shown in Section 9, "Interchange Transactions," are based on unrounded, underlying data and may differ from calculations based on the rounded values in the tables.

In the first three months of 2016, PJM was a monthly net importer of energy in the Day-Ahead Energy Market in all months (Figure 9-1). In the first three months of 2016, the total day-ahead net interchange of 1,369.2 GWh was higher than the net interchange of 212.5 GWh in the first three months of 2015. The large difference in the day-ahead net interchange totals was a result of up to congestion transaction volumes.<sup>10</sup> In the first three months of 2016, the peak month for net importing interchange was January, 613.2 GWh; in the first three months of 2015 it was January, 224.1 GWh. Gross monthly export volumes in the first three months of 2016 averaged 4,193.4 GWh compared to 3,536.1 GWh in the first three months of 2015, while gross monthly imports in the first three months of 2016 averaged 4,649.8 GWh compared to 3,607.0 GWh in the first three months of 2015.

Figure 9-1 shows the impact of net import and export up to congestion transactions on the overall net day-ahead energy market interchange. The import, export and net interchange volumes include fixed, dispatchable and up to congestion transaction totals.

In the first three months of 2016, gross imports in the Day-Ahead Energy Market were 108.1 percent of gross imports in the Real-Time Energy Market (68.8 percent in the first three months of 2015). In the first three months of 2016, gross exports in the Day-Ahead Energy Market were 174.3 percent of gross exports in the Real-Time Energy Market (103.9 percent in the first three months of 2015). In the first three months of 2016, net interchange was 1,369.2 GWh in the Day-Ahead Energy Market and 5,689.8 GWh in the Real-Time Energy Market compared to 212.5 GWh in the Day-Ahead Energy Market and 5,516.5 GWh in the Real-Time Energy Market in the first three months of 2015.

Transactions in the Day-Ahead Energy Market create financial obligations to deliver in the Real-Time Energy Market and to pay operating reserve charges based on differences between the transaction MW and price differences in the Day-Ahead and Real-Time Energy Markets.<sup>11</sup> In the first three months of 2016,

<sup>10</sup> On August 29, 2014, FERC issued an Order which created an obligation for UTCs to pay any uplift determined to be appropriate in the Commission review, effective September 8, 2014. 18 CFR § 385.213.

<sup>11</sup> Up to congestion transactions create financial obligations to deliver in real time, but do not pay operating reserve charges.

the total day-ahead gross imports and exports were higher than the real-time gross imports and exports, the day-ahead imports net of up to congestion transactions were less than the real-time imports, and the day-ahead exports net of up to congestion transactions were less than real-time exports.

**Figure 9-1 PJM real-time and day-ahead scheduled imports and exports: January through March, 2016**


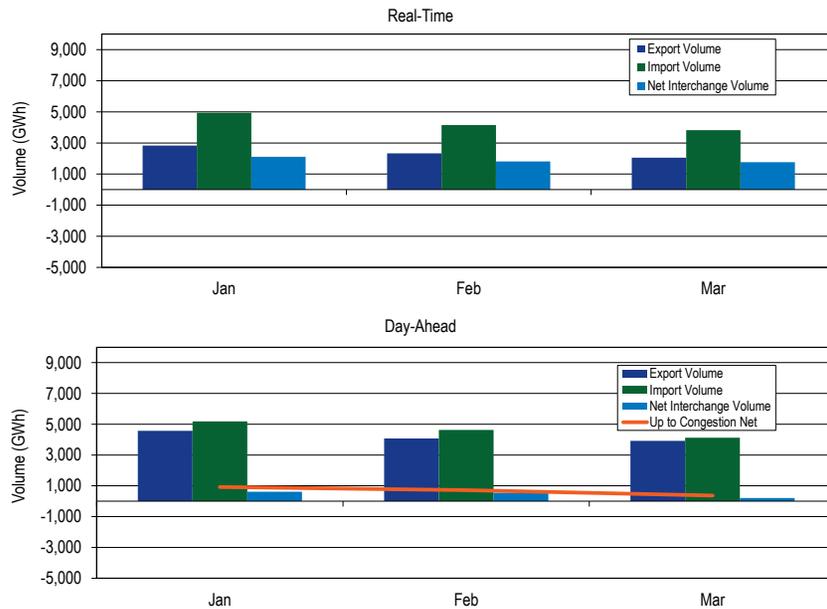


Figure 9-2 shows the real-time and day-ahead import and export volume for PJM from 1999 through March 2016. PJM shifted from a consistent net importer of energy to relatively consistent net exporter of energy in 2004 in both the Real-Time and Day-Ahead Energy Markets, coincident with the expansion of the PJM footprint that included the integrations of Commonwealth Edison, American Electric Power and Dayton Power and Light into PJM. The net direction of power flows is generally a function of price differences net of transactions costs. Since the modification of the up to congestion product in September 2010, up to congestion transactions have played a significant role

in power flows between PJM and external balancing authorities in the Day-Ahead Energy Market. On November 1, 2012, PJM eliminated the requirement that every up to congestion transaction include an interface pricing point as either the source or sink. As a result, the volume of import and export up to congestion transactions decreased, and the volume of internal up to congestion transactions increased. While the gross import and export volumes in the Day-Ahead Energy Market decreased, PJM has remained primarily a net exporter in the Day-Ahead Energy Market.

**Figure 9-2 PJM real-time and day-ahead scheduled import and export transaction volume history: January, 1999 through March, 2016**

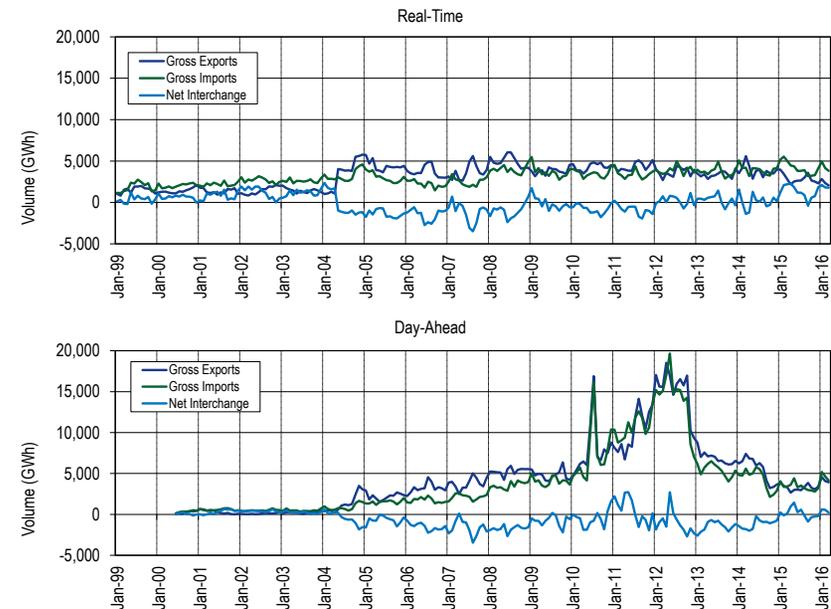

### Real-Time Interface Imports and Exports

In the Real-Time Energy Market, scheduled imports and exports are defined by the scheduled market path, which is the transmission path a market participant selects from the original source to the final sink. These scheduled flows are

measured at each of PJM's interfaces with neighboring balancing authorities. Table 9-16 includes a list of active interfaces in the first three months of 2016. Figure 9-3 shows the approximate geographic location of the interfaces. In the first three months of 2016, PJM had 20 interfaces with neighboring balancing authorities. While the Linden (LIND) Interface, the Hudson (HUDS) Interface and the Neptune (NEPT) Interface are separate from the NYIS Interface, all four are interfaces between PJM and the NYISO. Similarly, there are ten separate interfaces that make up the MISO Interface between PJM and MISO. Table 9-1 through Table 9-3 show the Real-Time Energy Market scheduled interchange totals at the individual NYISO interfaces, as well as with the NYISO as a whole. Similarly, the scheduled interchange totals at the individual interfaces between PJM and MISO are shown, as well as with MISO as a whole. Net scheduled interchange in the Real-Time Energy Market is shown by interface for the first three months of 2016 in Table 9-1, while gross scheduled imports and exports are shown in Table 9-2 and Table 9-3.

In the Real-Time Energy Market, in the first three months of 2016, there were net scheduled exports at seven of PJM's 20 interfaces. The top three net exporting interfaces in the Real-Time Energy Market accounted for 84.4 percent of the total net scheduled exports: PJM/Neptune (NEPT) with 35.5 percent, PJM/MidAmerican Energy Company (MEC) with 34.7 percent and PJM/New York Independent System Operator (NYIS) with 14.2 percent of the net scheduled export volume. The four separate interfaces that connect PJM to the NYISO (PJM/NYIS, PJM/NEPT, PJM/HUDS and PJM/Linden (LIND)) together represented 61.0 percent of the total net PJM scheduled exports in the Real-Time Energy Market. In the first three months of 2016, MISO had net scheduled imports; however, there were net scheduled exports in the Real-Time Energy Market at three of the ten separate interfaces that connect PJM to MISO. Those three exporting interfaces represented 39.0 percent of the total net PJM scheduled exports in the Real-Time Energy Market. Twelve PJM interfaces had net scheduled imports, with the top three importing interfaces accounting for 59.6 percent of the total net scheduled imports: PJM/Ameren-Illinois (AMIL) with 25.0 percent, PJM/DUK (DUK) with 18.2 percent and PJM/Ohio Valley Electric Corporation (OVEC) with 16.4 percent of the net

scheduled import volume.<sup>12</sup> The four separate interfaces that connect PJM to the NYISO (PJM/NYIS, PJM/NEPT, PJM/HUDS and PJM/Linden (LIND)) had net scheduled exports in the Real-Time Energy Market. In the first three months of 2016, there were net imports in the Real-Time Energy Market at six of the ten separate interfaces that connect PJM to MISO. Those six interfaces represented 43.9 percent of the total net PJM scheduled imports in the Real-Time Energy Market.

The Ohio Valley Electric Corporation (OVEC) consists of two coal fired generating stations. The Clifty Creek plant has a nameplate rating of 1,300 MW and is located in Madison, Indiana. The Kyger Creek plant has a nameplate rating of 1,000 MW and is located in Cheshire, Ohio. Thirteen investor-owned utilities and affiliates of generation and transmission rural electric cooperatives, the Sponsoring Companies, share OVEC's generation output. The Sponsoring Companies purchase power from OVEC according to the terms of the Inter-Company Power Agreement (ICPA), which has a current termination date of June 30, 2040.<sup>13</sup> Approximately 90 percent of OVEC is owned by load serving entities or their affiliates located in the PJM footprint.<sup>14</sup>

<sup>12</sup> In the Real-Time Energy Market, one PJM interface had a net interchange of zero (PJM/City Water Light & Power (CWLPP)).

<sup>13</sup> See OVEC, "Annual Report - 2014: Ohio Valley Electric Corporation and subsidiary Indiana-Kentucky Electric Corporation," <<http://www.ovec.com/FinancialStatements/AnnualReport-2014-Signed.pdf>>.

<sup>14</sup> See OVEC, "Ohio Valley Electric Corporation: Company Background," <<http://www.ovec.com/OVECHistory.pdf>>.

**Table 9-1 Real-time scheduled net interchange volume by interface (GWh):  
January through March, 2016**

	Jan	Feb	Mar	Total
CPL	(45.7)	(26.0)	121.5	49.9
CPLW	0.0	0.2	6.9	7.1
DUK	777.9	697.7	215.6	1,691.3
LGEE	232.1	170.3	129.1	531.5
MISO	1,071.4	642.9	960.2	2,674.5
ALTE	87.7	(164.2)	74.8	(1.7)
ALTW	37.2	36.8	30.0	103.9
AMIL	848.5	789.8	685.6	2,323.9
CIN	120.0	119.8	303.1	542.9
CWLP	0.0	0.0	0.0	0.0
IPL	53.0	18.6	33.1	104.6
MEC	(462.8)	(411.3)	(372.5)	(1,246.6)
MECS	430.1	284.1	259.0	973.3
NIPS	4.7	17.8	4.6	27.1
WEC	(46.9)	(48.5)	(57.6)	(153.0)
NYISO	(1,081.7)	(649.1)	(463.7)	(2,194.6)
HUDD	(0.2)	0.0	0.0	(0.2)
LIND	(189.6)	(160.8)	(56.0)	(406.4)
NEPT	(476.1)	(406.8)	(395.1)	(1,278.0)
NYIS	(415.9)	(81.5)	(12.6)	(510.0)
OVEC	607.4	528.6	387.0	1,522.9
TVA	546.2	449.2	411.8	1,407.3
Total	2,107.6	1,813.8	1,768.4	5,689.8

**Table 9-2 Real-time scheduled gross import volume by interface (GWh):  
January through March, 2016**

	Jan	Feb	Mar	Total
CPL	8.1	7.2	151.3	166.6
CPLW	0.0	0.2	6.9	7.1
DUK	810.3	713.6	231.0	1,754.9
LGEE	232.1	171.9	130.7	534.7
MISO	1,975.2	1,551.9	1,644.1	5,171.2
ALTE	288.9	79.1	184.4	552.4
ALTW	40.8	36.8	30.0	107.6
AMIL	849.0	790.5	686.1	2,325.6
CIN	202.7	222.5	362.1	787.3
CWLP	0.0	0.0	0.0	0.0
IPL	85.3	55.0	56.1	196.4
MEC	21.1	37.9	33.3	92.3
MECS	482.1	311.4	285.3	1,078.7
NIPS	4.7	17.8	4.6	27.1
WEC	0.6	0.9	2.3	3.8
NYISO	727.9	687.1	826.5	2,241.4
HUDD	0.0	0.0	0.0	0.0
LIND	1.2	0.5	7.0	8.7
NEPT	0.0	0.0	0.0	0.1
NYIS	726.7	686.5	819.4	2,232.7
OVEC	631.4	550.3	404.7	1,586.3
TVA	555.9	465.8	424.4	1,446.1
Total	4,940.8	4,147.9	3,819.6	12,908.3

**Table 9-3 Real-time scheduled gross export volume by interface (GWh): January through March, 2016**

	Jan	Feb	Mar	Total
CPLE	53.8	33.2	29.8	116.7
CPLW	0.0	0.0	0.0	0.0
DUK	32.3	15.9	15.3	63.6
LGEE	0.0	1.6	1.6	3.2
MISO	903.7	909.0	684.0	2,496.7
ALTE	201.2	243.3	109.5	554.1
ALTW	3.6	0.0	0.0	3.6
AMIL	0.5	0.7	0.5	1.7
CIN	82.7	102.6	59.0	244.4
CWLP	0.0	0.0	0.0	0.0
IPL	32.3	36.4	23.0	91.7
MEC	484.0	449.2	405.8	1,338.9
MECS	51.9	27.3	26.2	105.4
NIPS	0.0	0.0	0.0	0.0
WEC	47.5	49.4	59.9	156.8
NYISO	1,809.6	1,336.2	1,290.2	4,436.0
HUDES	0.2	0.0	0.0	0.2
LIND	190.7	161.4	63.0	415.1
NEPT	476.1	406.8	395.1	1,278.0
NYIS	1,142.6	768.0	832.1	2,742.7
OVEC	24.0	21.7	17.8	63.4
TVA	9.8	16.6	12.5	38.9
Total	2,833.2	2,334.1	2,051.2	7,218.5

## Real-Time Interface Pricing Point Imports and Exports

Interfaces differ from interface pricing points. An interface is a point of interconnection between PJM and a neighboring balancing authority which market participants may designate as a market path on which scheduled imports or exports will flow.<sup>15</sup> An interface pricing point defines the price at which transactions are priced, and is based on the path of the actual, physical transfer of energy. While a market participant designates a scheduled market path from a generation control area (GCA) to a load control area (LCA), this market path reflects the scheduled path as defined by the transmission reservations only, and may not reflect how the energy actually flows from the

<sup>15</sup> A market path is the scheduled path rather than the actual path on which power flows. A market path contains the generation balancing authority, all required transmission segments and the load balancing authority. There are multiple market paths between any generation and load balancing authority. Market participants select the market path based on transmission service availability and the transmission costs for moving energy from generation to load and interface prices.

GCA to LCA. For example, the import transmission path from LG&E Energy, L.L.C. (LGEE), through MISO and into PJM would show the transfer of power into PJM at the PJM/MISO Interface based on the scheduled market path of the transaction. However, the physical flow of energy does not enter the PJM footprint at the PJM/MISO Interface, but enters PJM at the southern boundary. For this reason, PJM prices an import with the GCA of LGEE at the SouthIMP interface pricing point rather than the MISO pricing point.

Interfaces differ from interface pricing points. The challenge is to create interface prices, composed of external pricing points, which accurately represent the locational price impact of flows between PJM and external sources of energy and that reflect the underlying economic fundamentals across balancing authority borders.<sup>16</sup>

Transactions can be scheduled to an interface based on a contract transmission path, but pricing points are developed and applied based on the estimated electrical impact of the external power source on PJM tie lines, regardless of contract transmission path.<sup>17</sup> PJM establishes prices for transactions with external balancing authorities by assigning interface pricing points to individual balancing authorities based on the generation control area and load control area as specified on the NERC Tag. Dynamic interface pricing calculations use actual system conditions to determine a set of weights for each external pricing point in an interface price definition. The weights are designed so that the interface price reflects actual system conditions. However, the weights are an approximation given the complexity of the transmission network outside PJM and the dynamic nature of power flows. Table 9-17 presents the interface pricing points used in the first three months of 2016. On September 16, 2014, PJM updated the mappings of external balancing authorities to individual pricing points. The MMU recommends that PJM review these mappings, at least annually, to reflect the fact that changes to the system topology can affect the impact of external power sources on PJM.

<sup>16</sup> See the *2007 State of the Market Report for PJM*, Volume II, Appendix D, "Interchange Transactions," for a more complete discussion of the development of pricing points.

<sup>17</sup> See "Interface Pricing Point Assignment Methodology," (August 28, 2014) <<http://www.pjm.com/~media/etools/exschedule/interface-pricing-point-assignment-methodology.ashx>>. PJM periodically updates these definitions on its website.

The interface pricing method implies that the weighting factors reflect the actual system flows in a dynamic manner. In fact, the weightings are static, and are modified by PJM only occasionally.<sup>18</sup> The MMU recommends that PJM monitor, and adjust as necessary, the weights applied to the components of the interfaces to ensure that the interface prices reflect ongoing changes in system conditions.

The contract transmission path only reflects the path of energy into or out of PJM to one neighboring balancing authority. The NERC Tag requires the complete path to be specified from the generation control area (GCA) to the load control area (LCA), but participants do not always do so. The NERC Tag path is used by PJM to determine the interface pricing point that PJM assigns to the transaction. This approach will correctly identify the interface pricing point only if the market participant provides the complete path in the Tag. This approach will not correctly identify the interface pricing point if the market participant breaks the transaction into portions, each with a separate Tag. The breaking of transactions into portions can be a way to manipulate markets and the result of such behavior can be incorrect and noncompetitive pricing of transactions.

There are several pricing points mapped to the region south of PJM. The SouthIMP and SouthEXP pricing points serve as the default pricing point for transactions at the southern border of PJM. The CPLEEXP, CPLEIMP, DUKEXP, DUKIMP, NCMPAEXP and NCMPAIMP were also established to account for various special agreements with neighboring balancing areas, and PJM continued to use the Southwest pricing point for certain grandfathered transactions which have since expired.<sup>19</sup>

In the Real-Time Energy Market, in the first three months of 2016, there were net scheduled exports at 10 of PJM's 18 interface pricing points eligible for real-time transactions.<sup>20</sup> The top three net exporting interface pricing points in the Real-Time Energy Market accounted for 82.9 percent of the total net scheduled exports: PJM/MISO with 34.7 percent, PJM/NEPTUNE with 34.4

percent and PJM/NYIS with 13.8 percent of the net scheduled export volume. The four separate interface pricing points that connect PJM to the NYISO (PJM/NYIS, PJM/NEPTUNE, PJM/HUDSONTP and PJM/LINDENVFT) together represented 59.2 percent of the total net PJM scheduled exports in the Real-Time Energy Market. Six PJM interface pricing points had net scheduled imports, with two importing interface pricing points accounting for 77.5 percent of the total net scheduled imports: PJM/SouthIMP with 61.3 percent and PJM/Ohio Valley Electric Corporation (OVEC) with 16.2 percent of the net scheduled import volume.<sup>21</sup>

**Table 9-4 Real-time scheduled net interchange volume by interface pricing point (GWh): January through March, 2016**

	Jan	Feb	Mar	Total
IMO	569.0	393.1	377.4	1,339.5
MISO	(432.6)	(510.3)	(344.4)	(1,287.3)
NORTHWEST	(1.2)	(3.3)	(0.6)	(5.1)
NYISO	(1,082.3)	(649.7)	(463.8)	(2,195.9)
HUDSONTP	(0.2)	0.0	0.0	(0.2)
LINDENVFT	(189.6)	(160.8)	(56.0)	(406.4)
NEPTUNE	(476.1)	(406.8)	(395.1)	(1,278.0)
NYIS	(416.5)	(82.1)	(12.7)	(511.3)
OVEC	607.4	528.6	387.0	1,522.9
Southern Imports	2,543.6	2,123.0	1,872.2	6,538.8
CPLEIMP	5.1	4.0	7.4	16.5
DUKIMP	162.2	105.7	69.2	337.1
NCMPAIMP	129.6	135.3	154.2	419.1
SOUTHEAST	0.0	0.0	0.0	0.0
SOUTHWEST	0.0	0.0	0.0	0.0
SOUTHIMP	2,246.8	1,878.0	1,641.4	5,766.2
Southern Exports	(96.3)	(67.6)	(59.3)	(223.2)
CPLEEXP	(53.8)	(32.6)	(28.1)	(114.5)
DUKEXP	(7.3)	(5.6)	(5.8)	(18.6)
NCMPAEXP	0.0	0.0	(0.0)	(0.0)
SOUTHEAST	0.0	0.0	0.0	0.0
SOUTHWEST	0.0	0.0	0.0	0.0
SOUTHEXP	(35.2)	(29.5)	(25.4)	(90.0)
Total	2,107.6	1,813.8	1,768.4	5,689.8

<sup>18</sup> On June 1, 2015, PJM began using a dynamic weighting factor in the calculation for the Ontario Interface Pricing Point.

<sup>19</sup> The MMU does not believe that it is appropriate to allow the use of the Southwest pricing point for grandfathered transactions, and recommends that no further such agreements be entered into.

<sup>20</sup> There is one interface pricing point eligible for day-ahead transaction scheduling only (NIPSCO).

<sup>21</sup> In the Real-Time Energy Market, two PJM interface pricing points had a net interchange of zero (Southeast and Southwest).

**Table 9-5 Real-time scheduled gross import volume by interface pricing point (GWh): January through March, 2016**

	Jan	Feb	Mar	Total
IMO	569.0	393.3	381.9	1,344.2
MISO	469.6	395.0	335.9	1,200.6
NORTHWEST	0.0	0.0	0.0	0.0
NYISO	727.2	686.3	824.9	2,238.5
HUDSONTP	0.0	0.0	0.0	0.0
LINDENVFT	1.2	0.5	7.0	8.7
NEPTUNE	0.0	0.0	0.0	0.1
NYIS	726.1	685.8	817.9	2,229.7
OVEC	631.4	550.3	404.7	1,586.3
Southern Imports	2,543.6	2,123.0	1,872.2	6,538.8
CPLEIMP	5.1	4.0	7.4	16.5
DUKIMP	162.2	105.7	69.2	337.1
NCMPAIMP	129.6	135.3	154.2	419.1
SOUTHEAST	0.0	0.0	0.0	0.0
SOUTHWEST	0.0	0.0	0.0	0.0
SOUTHIMP	2,246.8	1,878.0	1,641.4	5,766.2
Southern Exports	0.0	0.0	0.0	0.0
CPLEEXP	0.0	0.0	0.0	0.0
DUKEXP	0.0	0.0	0.0	0.0
NCMPAEXP	0.0	0.0	0.0	0.0
SOUTHEAST	0.0	0.0	0.0	0.0
SOUTHWEST	0.0	0.0	0.0	0.0
SOUTHEXP	0.0	0.0	0.0	0.0
Total	4,940.8	4,147.9	3,819.6	12,908.3

**Table 9-6 Real-time scheduled gross export volume by interface pricing point (GWh): January through March, 2016**

	Jan	Feb	Mar	Total
IMO	0.0	0.2	4.5	4.7
MISO	902.2	905.3	680.4	2,487.9
NORTHWEST	1.2	3.3	0.6	5.1
NYISO	1,809.6	1,336.1	1,288.7	4,434.3
HUDSONTP	0.2	0.0	0.0	0.2
LINDENVFT	190.7	161.4	63.0	415.1
NEPTUNE	476.1	406.8	395.1	1,278.0
NYIS	1,142.6	767.9	830.6	2,741.0
OVEC	24.0	21.7	17.8	63.4
Southern Imports	0.0	0.0	0.0	0.0
CPLEIMP	0.0	0.0	0.0	0.0
DUKIMP	0.0	0.0	0.0	0.0
NCMPAIMP	0.0	0.0	0.0	0.0
SOUTHEAST	0.0	0.0	0.0	0.0
SOUTHWEST	0.0	0.0	0.0	0.0
SOUTHIMP	0.0	0.0	0.0	0.0
Southern Exports	96.3	67.6	59.3	223.2
CPLEEXP	53.8	32.6	28.1	114.5
DUKEXP	7.3	5.6	5.8	18.6
NCMPAEXP	0.0	0.0	0.0	0.0
SOUTHEAST	0.0	0.0	0.0	0.0
SOUTHWEST	0.0	0.0	0.0	0.0
SOUTHEXP	35.2	29.5	25.4	90.0
Total	2,833.2	2,334.1	2,051.2	7,218.5

## Day-Ahead Interface Imports and Exports

In the Day-Ahead Energy Market, as in the Real-Time Energy Market, scheduled imports and exports are determined by the scheduled market path, which is the transmission path a market participant selects from the original source to the final sink. Entering external energy transactions in the Day-Ahead Energy Market requires fewer steps than in the Real-Time Energy Market. Market participants need to acquire a valid, willing to pay congestion (WPC) OASIS reservation to prove that their day-ahead schedule could be supported in the Real-Time Energy Market.<sup>22</sup> Day-ahead energy market schedules need to be cleared through the day-ahead energy market process in order to become an approved schedule. The day-ahead energy market transactions are financially

<sup>22</sup> Effective September 17, 2010, up to congestion transactions no longer required a willing to pay congestion transmission reservation.

binding, but will not physically flow unless they are also submitted in the Real-Time Energy Market. In the Day-Ahead Energy Market, a market participant is not required to acquire a ramp reservation, a NERC Tag, or to go through a neighboring balancing authority checkout process.

There are three types of day-ahead external energy transactions: fixed; up to congestion; and dispatchable.<sup>23</sup>

In the Day-Ahead Energy Market, transaction sources and sinks are determined solely by market participants. In Table 9-7, Table 9-8, and Table 9-9, the scheduled interface designation is determined by the transmission reservation that was acquired and associated with the day-ahead market transaction, and does not bear any necessary relationship to the pricing point designation selected at the time the transaction is submitted to PJM in real time. For example, if market participants want to import energy from the Southwest Power Pool (SPP) to PJM, they are likely to choose a scheduled path with the fewest transmission providers along the path and therefore the lowest transmission costs for the transaction, regardless of whether the resultant path is related to the physical flow of power. The lowest cost transmission path runs from SPP, through MISO, and into PJM, requiring only three transmission reservations, two of which are available at no cost (MISO transmission would be free based on the regional through and out rates, and the PJM transmission would be free, if using spot import transmission). Any other transmission path entering PJM, where the generating control area is to the south, would require the market participant to acquire transmission through non-market balancing authorities, and thus incur additional transmission costs. PJM's interface pricing method recognizes that transactions sourcing in SPP and sinking in PJM will create flows across the southern border and prices those transactions at the SouthIMP interface price. As a result, a market participant who plans to submit a transaction from SPP to PJM may have a transmission reservation with a point of receipt of MISO and a point of delivery of PJM but may select SouthIMP as the import pricing point when submitting the transaction in the Day-Ahead Energy Market. In the scheduled interface tables, the import transaction would appear as scheduled through the MISO Interface, and in

the scheduled interface pricing point tables, the import transaction would appear as scheduled through the SouthIMP/EXP interface pricing point, which reflects the expected power flow.

Table 9-7 through Table 9-9 show the day-ahead scheduled interchange totals at the individual interfaces. Net scheduled interchange in the Day-Ahead Energy Market is shown by interface for the first three months of 2016 in Table 9-7, while gross scheduled imports and exports are shown in Table 9-8 and Table 9-9.

In the Day-Ahead Energy Market, in the first three months of 2016, there were net scheduled exports at eight of PJM's 20 interfaces. The top three net exporting interfaces in the Day-Ahead Energy Market accounted for 86.3 percent of the total net scheduled exports: PJM/MidAmerican Energy Company (MEC) with 33.9 percent, PJM/Neptune (NEPT) with 32.7 percent, and PJM/New York Independent System Operator, Inc. (NYIS) with 19.7 percent of the net scheduled export volume. The four separate interfaces that connect PJM to the NYISO (PJM/NYIS, PJM/NEPT, PJM/HUDS and PJM/Linden (LIND)) together represented 53.1 percent of the total net PJM scheduled exports in the Day-Ahead Energy Market. In the first three months of 2016, there were net exports in the Day-Ahead Energy Market at four of the ten separate interfaces that connect PJM to MISO. Those four interfaces represented 46.9 percent of the total net PJM exports in the Day-Ahead Energy Market. Ten PJM interfaces had net scheduled imports, with the top two importing interfaces accounting for 64.3 percent of the total net imports: PJM/Ohio Valley Electric Corporation (OVEC) with 34.0 percent and PJM/DUK with 30.3 percent of the net import volume. The four separate interfaces that connect PJM to the NYISO (PJM/NYIS, PJM/NEPT, PJM/HUDS and PJM/Linden (LIND)) had net scheduled exports in the Day-Ahead Energy Market. In the first three months of 2016, there were net imports in the Day-Ahead Energy Market at five of the ten separate interfaces that connect PJM to MISO. Those five interfaces represented 29.9 percent of the total net PJM scheduled imports in the Day-Ahead Energy Market.<sup>24</sup>

<sup>23</sup> See the 2010 State of the Market Report for PJM, Volume II, Section 4, "Interchange Transactions," for details.

<sup>24</sup> In the Day-Ahead Energy Market, two PJM interfaces had a net interchange of zero (PJM/Duke Energy Progress West (CPLW) and PJM/City Water Light & Power (CWLP)).

**Table 9-7 Day-Ahead scheduled net interchange volume by interface (GWh):  
January through March, 2016**

	Jan	Feb	Mar	Total
CPLC	(38.7)	(25.1)	82.3	18.4
CPLW	0.0	0.0	0.0	0.0
DUK	499.6	409.2	95.2	1,004.0
LGEE	0.0	0.8	0.0	0.8
MISO	(330.7)	(344.3)	(188.5)	(863.6)
ALTE	(148.5)	(153.0)	(56.3)	(357.8)
ALTW	(2.8)	0.8	0.0	(2.0)
AMIL	7.9	15.5	102.6	126.1
CIN	44.2	22.3	37.9	104.3
CWLP	0.0	0.0	0.0	0.0
IPL	28.4	32.8	28.3	89.5
MEC	(482.9)	(443.5)	(411.3)	(1,337.6)
MECS	265.8	210.1	165.8	641.7
NIPS	4.7	18.6	4.5	27.8
WEC	(47.5)	(48.0)	(59.9)	(155.4)
NYISO	(955.7)	(626.3)	(515.6)	(2,097.5)
HUDS	(3.2)	0.0	0.0	(3.2)
LIND	(13.0)	(9.0)	0.8	(21.2)
NEPT	(478.8)	(412.8)	(401.8)	(1,293.3)
NYIS	(460.8)	(204.4)	(114.6)	(779.8)
OVEC	467.9	378.2	278.1	1,124.2
TVA	51.6	41.9	79.9	173.4
Total without Up-To Congestion	(306.0)	(165.6)	(168.6)	(640.2)
Up-To Congestion	919.2	717.8	372.5	2,009.4
Total	613.2	552.2	203.9	1,369.2

**Table 9-8 Day-Ahead scheduled gross import volume by interface (GWh):  
January through March, 2016**

	Jan	Feb	Mar	Total
CPLC	2.2	3.9	105.7	111.9
CPLW	0.0	0.0	0.0	0.0
DUK	499.8	409.2	95.2	1,004.2
LGEE	0.0	0.8	0.0	0.8
MISO	409.3	329.4	360.9	1,099.6
ALTE	7.4	0.8	0.0	8.2
ALTW	0.0	0.8	0.0	0.8
AMIL	7.9	15.5	102.6	126.1
CIN	55.2	26.4	38.3	119.8
CWLP	0.0	0.0	0.0	0.0
IPL	28.4	32.8	28.3	89.5
MEC	0.0	0.0	0.0	0.0
MECS	305.8	234.6	187.3	727.6
NIPS	4.7	18.6	4.5	27.8
WEC	0.0	0.0	0.0	0.0
NYISO	525.5	496.2	636.2	1,657.9
HUDS	0.0	0.0	0.0	0.0
LIND	0.0	0.1	2.0	2.1
NEPT	0.0	0.0	0.0	0.0
NYIS	525.5	496.2	634.2	1,655.8
OVEC	467.9	378.2	278.1	1,124.2
TVA	54.3	49.9	81.7	185.9
Total without Up-To Congestion	1,959.0	1,667.7	1,557.9	5,184.6
Up-To Congestion	3,229.4	2,963.8	2,571.5	8,764.7
Total	5,188.4	4,631.5	4,129.4	13,949.3

**Table 9-9 Day-Ahead scheduled gross export volume by interface (GWh):  
January through March, 2016**

	Jan	Feb	Mar	Total
CPLP	40.9	29.1	23.5	93.5
CPLW	0.0	0.0	0.0	0.0
DUK	0.2	0.0	0.0	0.2
LGEE	0.0	0.0	0.0	0.0
MISO	740.0	673.7	549.4	1,963.2
ALTE	155.9	153.7	56.3	365.9
ALTW	2.8	0.0	0.0	2.8
AMIL	0.0	0.0	0.0	0.0
CIN	11.0	4.1	0.5	15.5
CWLP	0.0	0.0	0.0	0.0
IPL	0.0	0.0	0.0	0.0
MEC	482.9	443.5	411.3	1,337.6
MECS	40.0	24.5	21.5	85.9
NIPS	0.0	0.0	0.0	0.0
WEC	47.5	48.0	59.9	155.4
NYISO	1,481.2	1,122.5	1,151.8	3,755.5
HUDD	3.2	0.0	0.0	3.2
LIND	13.0	9.1	1.2	23.3
NEPT	478.8	412.8	401.8	1,293.3
NYIS	986.2	700.6	748.8	2,435.6
OVEC	0.0	0.0	0.0	0.0
TVA	2.7	7.9	1.8	12.4
Total without Up-To Congestion	2,265.0	1,833.3	1,726.5	5,824.7
Up-To Congestion	2,310.2	2,246.1	2,199.0	6,755.3
Total	4,575.2	4,079.3	3,925.5	12,580.1

## Day-Ahead Interface Pricing Point Imports and Exports

Table 9-10 through Table 9-15 show the day-ahead scheduled interchange totals at the interface pricing points. In the first three months of 2016, up to congestion transactions accounted for 62.8 percent of all scheduled import MW transactions, 53.7 percent of all scheduled export MW transactions and 146.8 percent of the net scheduled interchange volume in the Day-Ahead Energy Market. The day-ahead net scheduled interchange in the first three months of 2016, including up to congestion transactions, is shown by interface pricing point in Table 9-10. Scheduled up to congestion transactions by interface pricing point in the first three months of 2016 are shown in

Table 9-11. Day-ahead gross scheduled imports and exports, including up to congestion transactions, are shown in Table 9-12 and Table 9-14, while gross scheduled import and export up to congestion transactions are shown in Table 9-13 and Table 9-15.

There is one interface pricing point eligible for day-ahead transaction scheduling only (NIPSCO). The NIPSCO interface pricing point was created when the individual balancing authorities that integrated to form MISO still operated independently. Transactions sourcing or sinking in the NIPSCO balancing authority were eligible to receive the real-time NIPSCO interface pricing point. After the formation of the MISO RTO, all real-time transactions sourcing or sinking in NIPSCO are represented on the NERC Tag as sourcing or sinking in MISO, and thus receive the MISO interface pricing point in the Real-Time Energy Market. For this reason, it was no longer possible to receive the NIPSCO interface pricing point in the Real-Time Energy Market after the integration of NIPSCO into MISO.

The NIPSCO interface pricing point remains an eligible interface pricing point in the PJM Day-Ahead Energy Market, and is available for all market participants to use as the pricing point for day-ahead imports, exports and wheels, as well as a source or sink for up to congestion transactions. The NIPSCO interface pricing point remains for the purpose of facilitating the long term day-ahead positions created at the NIPSCO Interface prior to the integration on May 1, 2004. In the first three months of 2016, the day-ahead net scheduled interchange at the NIPSCO interface pricing point was -1,980.1 GWh (Table 9-10) and the up to congestion net scheduled interchange at the NIPSCO interface pricing point was -1,980.1 GWh (See Table 9-11). While there is no corresponding interface pricing point available for real-time transaction scheduling, a real-time LMP is still calculated. This real-time price is used for balancing the deviations between the Day-Ahead and Real-Time Energy Markets.

PJM consolidated the Southeast and Southwest interface pricing points to a single interface pricing point with separate import and export prices (SouthIMP and SouthEXP) on October 31, 2006. At that time, the real-time

Southeast and Southwest interface pricing points remained only to support certain grandfathered agreements with specific generating units and to price energy under the reserve sharing agreement with VACAR. The reserve sharing agreement allows for the transfer of energy during emergencies. Interchange transactions created as part of the reserve sharing agreement are currently settled at the Southeast interface price. PJM also kept the day-ahead Southeast and Southwest interface pricing points to facilitate long-term day-ahead positions that were entered prior to the consolidation.

The MMU recommends that PJM eliminate the NIPSCO, Southeast and Southwest interface pricing points from the Day-Ahead and Real-Time Energy Markets and, with VACAR, assign the transactions created under the reserve sharing agreement to the SouthIMP/EXP pricing point.

In the Day-Ahead Energy Market, in the first three months of 2016, there were net scheduled exports at nine of PJM's 19 interface pricing points eligible for day-ahead transactions. The top three net exporting interface pricing points in the Day-Ahead Energy Market accounted for 75.9 percent of the total net scheduled exports: PJM/NIPSCO with 36.0 percent, PJM/NEPTUNE with 23.1 percent and PJM/SOUTHEXP with 16.8 percent of the net scheduled export volume. The four separate interface pricing points that connect PJM to the NYISO (PJM/NYIS, PJM/NEPTUNE, PJM/HUDSONTP and PJM/LINDENVFT) together represented 33.6 percent of the total net PJM scheduled exports in the Day-Ahead Energy Market (the PJM/HUDSONTP and PJM/LINDENVFT Interface Pricing Point had net scheduled imports). Ten PJM interface pricing points had net scheduled imports, with three importing interface pricing points accounting for 69.5 percent of the total net scheduled imports: PJM/Ohio Valley Electric Corporation (OVEC) with 37.5 percent, PJM/SouthImp with 18.2 percent and PJM/MISO with 13.8 percent of the net import volume. The four separate interface pricing points that connect PJM to the NYISO (PJM/NYIS, PJM/NEPTUNE, PJM/HUDSONTP and PJM/LINDENVFT) had net scheduled exports in the Day-Ahead Energy Market; however, the PJM/HUDSONTP and PJM/LINDENVFT interface pricing points had net scheduled imports that represented 3.8 percent of the total PJM net scheduled imports in the Day-Ahead Energy Market.

In the Day-Ahead Energy Market, in the first three months of 2016, up to congestion transactions had net scheduled exports at three of PJM's 19 interface pricing points eligible for day-ahead transactions. The top two net exporting interface pricing points eligible for up to congestion transactions accounted for 98.3 percent of the total net up to congestion scheduled exports: PJM/NIPSCO with 67.2 percent and PJM/SouthEXP with 31.0 percent of the net scheduled export up to congestion volume. The four separate interface pricing points that connect PJM to the NYISO (PJM/NYIS, PJM/NEPTUNE, PJM/HUDSONTP and PJM/LINDENVFT) had net scheduled import up to congestion transactions in the Day-Ahead Energy Market. 10 PJM interface pricing points had net scheduled up to congestion imports, with the top three importing interface pricing points accounting for 71.9 percent of the total net up to congestion imports: PJM/OVEC with 29.3 percent, PJM/MISO with 27.6 percent and PJM/Northwest with 14.9 percent of the net import up to congestion volume. The four separate interface pricing points that connect PJM to the NYISO (PJM/NYIS, PJM/NEPTUNE, PJM/HUDSONTP and PJM/LINDENVFT) together represented 10.2 percent of the total net scheduled up to congestion exports in the Day-Ahead Energy Market.<sup>25</sup>

<sup>25</sup> In the Day-Ahead Energy Market, six PJM interface pricing points (PJM/CPLIIMP, PJM/DUKIMP, PJM/NCMPAIMP, PJM/CPLIEXP, PJM/DUKEXP and PJM/NCMPAEXP) had up-to congestion net interchange of zero.

**Table 9-10 Day-ahead scheduled net interchange volume by interface pricing point (GWh): January through March, 2016**

	Jan	Feb	Mar	Total
IMO	436.0	266.7	41.0	743.8
MISO	339.9	400.1	207.7	947.7
NIPSCO	(449.8)	(694.3)	(836.0)	(1,980.1)
NORTHWEST	(46.8)	(240.9)	(309.1)	(596.9)
NYISO	(707.4)	(484.3)	(399.7)	(1,591.4)
HUDSONTP	143.3	48.7	28.1	220.1
LINDENVFT	14.3	(4.3)	28.6	38.6
NEPTUNE	(462.5)	(420.6)	(386.5)	(1,269.6)
NYIS	(402.5)	(108.2)	(69.8)	(580.5)
OVEC	975.9	767.8	833.9	2,577.6
Southern Imports	1,026.0	1,097.6	1,051.4	3,175.0
CPLEIMP	2.2	3.9	6.9	13.0
DUKIMP	133.2	54.1	24.5	211.8
NCMPAIMP	137.5	144.6	152.9	435.1
SOUTHEAST	123.3	187.8	196.4	507.6
SOUTHWEST	220.0	258.8	277.7	756.5
SOUTHIMP	409.7	448.3	392.9	1,251.0
Southern Exports	(960.6)	(560.6)	(385.3)	(1,906.4)
CPLEEXP	(38.7)	(27.4)	(22.0)	(88.1)
DUKEXP	(0.2)	0.0	0.0	(0.2)
NCMPAEXP	(2.2)	(1.7)	(1.5)	(5.4)
SOUTHEAST	(46.6)	(21.3)	(10.5)	(78.5)
SOUTHWEST	(335.8)	(235.9)	(236.3)	(807.9)
SOUTHEXP	(537.0)	(274.3)	(115.0)	(926.4)
Total	613.2	552.2	203.9	1,369.2

**Table 9-11 Up to congestion scheduled net interchange volume by interface pricing point (GWh): January through March, 2016**

	Jan	Feb	Mar	Total
IMO	127.6	32.2	(127.6)	32.2
MISO	511.3	567.9	287.0	1,366.2
NIPSCO	(449.8)	(694.3)	(836.0)	(1,980.1)
NORTHWEST	436.0	202.5	102.1	740.7
NYISO	248.3	141.9	115.9	506.1
HUDSONTP	146.5	48.7	28.1	223.3
LINDENVFT	27.3	4.7	27.8	59.8
NEPTUNE	16.2	(7.7)	15.2	23.7
NYIS	58.3	96.2	44.7	199.3
OVEC	508.0	389.6	555.7	1,453.3
Southern Imports	454.6	601.5	635.3	1,691.4
CPLEIMP	0.0	0.0	0.0	0.0
DUKIMP	0.0	0.0	0.0	0.0
NCMPAIMP	0.0	0.0	0.0	0.0
SOUTHEAST	123.3	187.8	196.4	507.6
SOUTHWEST	220.0	258.8	277.7	756.5
SOUTHIMP	111.3	154.9	161.2	427.3
Southern Exports	(916.8)	(523.6)	(360.0)	(1,800.3)
CPLEEXP	0.0	0.0	0.0	0.0
DUKEXP	0.0	0.0	0.0	0.0
NCMPAEXP	0.0	0.0	0.0	0.0
SOUTHEAST	(46.6)	(21.3)	(10.5)	(78.5)
SOUTHWEST	(335.8)	(235.9)	(236.3)	(807.9)
SOUTHEXP	(534.3)	(266.4)	(113.2)	(913.9)
Total Interfaces	919.2	717.8	372.5	2,009.4
INTERNAL	24,226.4	22,049.2	19,069.1	65,344.7
Total	25,145.5	22,767.0	19,441.6	67,354.2

Table 9-12 Day-ahead scheduled gross import volume by interface pricing point (GWh): January through March, 2016

	Jan	Feb	Mar	Total
IMO	552.8	451.6	246.1	1,250.5
MISO	800.0	781.2	484.9	2,066.1
NIPSCO	136.1	156.0	154.1	446.3
NORTHWEST	500.4	323.7	232.6	1,056.7
NYISO	1,018.7	888.2	917.5	2,824.4
HUDSONTP	186.5	93.2	55.8	335.6
LINDENVFT	53.5	51.4	58.5	163.4
NEPTUNE	103.7	101.1	89.3	294.0
NYIS	675.1	642.5	713.8	2,031.4
OVEC	1,154.4	933.2	1,042.7	3,130.3
Southern Imports	1,026.0	1,097.6	1,051.4	3,175.0
CPLEIMP	2.2	3.9	6.9	13.0
DUKIMP	133.2	54.1	24.5	211.8
NCMPAIMP	137.5	144.6	152.9	435.1
SOUTHEAST	123.3	187.8	196.4	507.6
SOUTHWEST	220.0	258.8	277.7	756.5
SOUTHIMP	409.7	448.3	392.9	1,251.0
Southern Exports	0.0	0.0	0.0	0.0
CPLEEXP	0.0	0.0	0.0	0.0
DUKEXP	0.0	0.0	0.0	0.0
NCMPAEXP	0.0	0.0	0.0	0.0
SOUTHEAST	0.0	0.0	0.0	0.0
SOUTHWEST	0.0	0.0	0.0	0.0
SOUTHEXP	0.0	0.0	0.0	0.0
Total	5,188.4	4,631.5	4,129.4	13,949.3

Table 9-13 Up to congestion scheduled gross import volume by interface pricing point (GWh): January through March, 2016

	Jan	Feb	Mar	Total
IMO	244.4	217.0	77.5	538.8
MISO	714.2	718.6	426.1	1,858.9
NIPSCO	136.1	156.0	154.1	446.3
NORTHWEST	500.4	323.7	232.6	1,056.7
NYISO	493.2	392.0	281.3	1,166.5
HUDSONTP	186.5	93.2	55.8	335.6
LINDENVFT	53.4	51.3	56.5	161.3
NEPTUNE	103.7	101.1	89.3	294.0
NYIS	149.6	146.4	79.6	375.6
OVEC	686.5	555.0	764.5	2,006.1
Southern Imports	454.6	601.5	635.3	1,691.4
CPLEIMP	0.0	0.0	0.0	0.0
DUKIMP	0.0	0.0	0.0	0.0
NCMPAIMP	0.0	0.0	0.0	0.0
SOUTHEAST	123.3	187.8	196.4	507.6
SOUTHWEST	220.0	258.8	277.7	756.5
SOUTHIMP	111.3	154.9	161.2	427.3
Southern Exports	0.0	0.0	0.0	0.0
CPLEEXP	0.0	0.0	0.0	0.0
DUKEXP	0.0	0.0	0.0	0.0
NCMPAEXP	0.0	0.0	0.0	0.0
SOUTHEAST	0.0	0.0	0.0	0.0
SOUTHWEST	0.0	0.0	0.0	0.0
SOUTHEXP	0.0	0.0	0.0	0.0
Total Interfaces	3,229.4	2,963.8	2,571.5	8,764.7

**Table 9-14 Day-ahead scheduled gross export volume by interface pricing point (GWh): January through March, 2016**

	Jan	Feb	Mar	Total
IMO	116.8	184.8	205.1	506.7
MISO	460.1	381.0	277.3	1,118.4
NIPSCO	586.0	850.3	990.1	2,426.4
NORTHWEST	547.2	564.7	541.7	1,653.6
NYISO	1,726.1	1,372.6	1,317.2	4,415.8
HUDSONTP	43.2	44.5	27.8	115.5
LINDENVFT	39.1	55.7	29.9	124.7
NEPTUNE	566.2	521.6	475.8	1,563.7
NYIS	1,077.5	750.7	783.7	2,611.9
OVEC	178.5	165.4	208.8	552.7
Southern Imports	0.0	0.0	0.0	0.0
CPLEIMP	0.0	0.0	0.0	0.0
DUKIMP	0.0	0.0	0.0	0.0
NCMPAIMP	0.0	0.0	0.0	0.0
SOUTHEAST	0.0	0.0	0.0	0.0
SOUTHWEST	0.0	0.0	0.0	0.0
SOUTHIMP	0.0	0.0	0.0	0.0
Southern Exports	960.6	560.6	385.3	1,906.4
CPLEEXP	38.7	27.4	22.0	88.1
DUKEXP	0.2	0.0	0.0	0.2
NCMPAEXP	2.2	1.7	1.5	5.4
SOUTHEAST	46.6	21.3	10.5	78.5
SOUTHWEST	335.8	235.9	236.3	807.9
SOUTHEXP	537.0	274.3	115.0	926.4
Total	4,575.2	4,079.3	3,925.5	12,580.1


**Table 9-15 Up to congestion scheduled gross export volume by interface pricing point (GWh): January through March, 2016**

	Jan	Feb	Mar	Total
IMO	116.8	184.8	205.1	506.7
MISO	202.9	150.8	139.1	492.8
NIPSCO	586.0	850.3	990.1	2,426.4
NORTHWEST	64.4	121.2	130.5	316.1
NYISO	244.9	250.0	165.4	660.4
HUDSONTP	40.1	44.5	27.8	112.3
LINDENVFT	26.1	46.6	28.7	101.4
NEPTUNE	87.5	108.8	74.0	270.3
NYIS	91.3	50.1	34.9	176.3
OVEC	178.5	165.4	208.8	552.7
Southern Imports	0.0	0.0	0.0	0.0
CPLEIMP	0.0	0.0	0.0	0.0
DUKIMP	0.0	0.0	0.0	0.0
NCMPAIMP	0.0	0.0	0.0	0.0
SOUTHEAST	0.0	0.0	0.0	0.0
SOUTHWEST	0.0	0.0	0.0	0.0
SOUTHIMP	0.0	0.0	0.0	0.0
Southern Exports	916.8	523.6	360.0	1,800.3
CPLEEXP	0.0	0.0	0.0	0.0
DUKEXP	0.0	0.0	0.0	0.0
NCMPAEXP	0.0	0.0	0.0	0.0
SOUTHEAST	46.6	21.3	10.5	78.5
SOUTHWEST	335.8	235.9	236.3	807.9
SOUTHEXP	534.3	266.4	113.2	913.9
Total Interfaces	2,310.2	2,246.1	2,199.0	6,755.3

**Table 9-16 Active real-time and day-ahead scheduling interfaces: January through March, 2016<sup>26</sup>**

	Jan	Feb	Mar
ALTE	Active	Active	Active
ALTW	Active	Active	Active
AMIL	Active	Active	Active
CIN	Active	Active	Active
CPLW	Active	Active	Active
CWLP	Active	Active	Active
DUK	Active	Active	Active
HUDS	Active	Active	Active
IPL	Active	Active	Active
LGEE	Active	Active	Active
LIND	Active	Active	Active
MEC	Active	Active	Active
MECS	Active	Active	Active
NEPT	Active	Active	Active
NIPS	Active	Active	Active
NYIS	Active	Active	Active
OVEC	Active	Active	Active
TVA	Active	Active	Active
WEC	Active	Active	Active

**Figure 9-3 PJM's footprint and its external day-ahead and real-time scheduling interfaces**

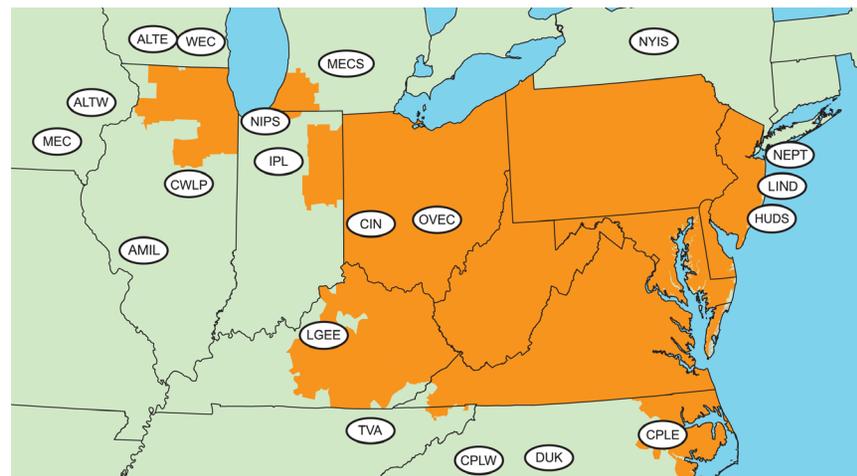

**Table 9-17 Active day-ahead and real-time scheduled interface pricing points: January through March, 2016<sup>27</sup>**

	Jan	Feb	Mar
CPLEEXP	Active	Active	Active
CPLEIMP	Active	Active	Active
DUKEXP	Active	Active	Active
DUKIMP	Active	Active	Active
HUDSONTP	Active	Active	Active
LINDENVFT	Active	Active	Active
MISO	Active	Active	Active
NCMPAEXP	Active	Active	Active
NCMPAIMP	Active	Active	Active
NEPTUNE	Active	Active	Active
NIPSCO	Active	Active	Active
Northwest	Active	Active	Active
NYIS	Active	Active	Active
Ontario IESO	Active	Active	Active
OVEC	Active	Active	Active
Southeast	Active	Active	Active
SOUTHEXP	Active	Active	Active
SOUTHIMP	Active	Active	Active
Southwest	Active	Active	Active

<sup>26</sup> On July 2, 2012, Duke Energy Corp. (DUK) completed a merger with Progress Energy Inc. (CPLW and CPLW). As of March 31, 2016, DUK, CPLW and CPLW continued to operate as separate balancing authorities, and are still defined as distinct interfaces in the PJM energy market.

<sup>27</sup> The NIPSCO interface pricing point is valid only in the Day-Ahead Energy Market.

## Loop Flows

Actual energy flows are the real-time metered power flows at an interface for a defined period. The comparable scheduled flows are the real-time power flows scheduled at an interface for a defined period. Inadvertent interchange is the difference between the total actual flows for the PJM system (net actual interchange) and the total scheduled flows for the PJM system (net scheduled interchange) for a defined period. Loop flows are the difference between actual and scheduled power flows at a specific interface. Loop flows can exist at the same time that inadvertent interchange is zero. For example, actual imports could exceed scheduled imports at one interface and actual exports could exceed scheduled exports at another interface by the same amount. The result is loop flow, despite the fact that system actual and scheduled power flow net to a zero difference.<sup>28</sup>

Loop flows result, in part, from a mismatch between incentives to use a particular scheduled transmission path and the market based price differentials at interface pricing points that result from the actual physical flows on the transmission system.

PJM's approach to interface pricing attempts to match prices with physical power flows and their impacts on the transmission system. For example, if market participants want to import energy from the Southwest Power Pool (SPP) to PJM, they are likely to choose a scheduled path with the fewest transmission providers along the path and therefore the lowest transmission costs for the transaction, regardless of whether the resultant path is related to the physical flow of power. The lowest cost transmission path runs from SPP, through MISO, and into PJM, requiring only three transmission reservations, two of which are available at no cost (MISO transmission would be free based on the regional through and out rates, and the PJM transmission would be free, if using spot import transmission). Any other transmission path entering PJM, where the generating control area is to the south, would require the market participant to acquire transmission through non-market balancing authorities, and thus incur additional transmission costs. PJM's interface pricing method recognizes that transactions sourcing in SPP and sinking in

PJM will create flows across the southern border and prices those transactions at the SouthIMP interface price. As a result, the transaction is priced appropriately, but a difference between scheduled and actual flows is created at PJM's borders. For example, if a 100 MW transaction were submitted, there would be 100 MW of scheduled flow at the PJM/MISO interface border, but there would be no actual flows on the interface. Correspondingly, there would be no scheduled flows at the PJM/Southern interface border, but there would be 100 MW of actual flows on the interface. In the first three months of 2016, there were net scheduled flows of 2,629 GWh through MISO that received an interface pricing point associated with the southern interface but there were no net scheduled flows across the southern interface that received the MISO interface pricing point.

In the first three months of 2016, net scheduled interchange was 5,690 GWh and net actual interchange was 6,564 GWh, a difference of 874 GWh. In the first three months of 2015, net scheduled interchange was 5,516 GWh and net actual interchange was 5,502 GWh, a difference of 14 GWh. This difference is inadvertent interchange. PJM attempts to minimize the amount of accumulated inadvertent interchange by continually monitoring and correcting for inadvertent interchange. PJM can reduce the accumulation of inadvertent interchange using unilateral or bilateral paybacks.<sup>29</sup>

Table 9-18 shows that in the first three months of 2016, the Wisconsin Energy Corporation (WEC) interface had the largest loop flows of any interface with -153 GWh of net scheduled interchange and 2,340 GWh of net actual interchange, a difference of 2,493 GWh.

<sup>28</sup> See the 2012 State of the Market Report for PJM, Volume II, Section 8, "Interchange Transactions," for a more detailed discussion.

<sup>29</sup> See PJM, "Manual 12: Balancing Operations," Revision 33 (December 1, 2015).

**Table 9-18 Net scheduled and actual PJM flows by interface (GWh): January through March, 2016**

	Actual	Net Scheduled	Difference (GWh)
CPLE	2,002	50	1,952
CPWL	(154)	7	(161)
DUK	926	1,691	(765)
LGEE	849	531	317
MISO	(333)	2,674	(3,007)
ALTE	(1,613)	(2)	(1,612)
ALTW	(733)	104	(837)
AMIL	3,212	2,324	888
CIN	(1,112)	543	(1,655)
CWLP	(170)	0	(170)
IPL	(67)	105	(172)
MEC	(937)	(1,247)	310
MECS	1,085	973	112
NIPS	(2,337)	27	(2,364)
WEC	2,340	(153)	2,493
NYISO	(2,046)	(2,195)	148
HUDES	(0)	(0)	0
LIND	(406)	(406)	0
NEPT	(1,278)	(1,278)	0
NYIS	(362)	(510)	148
OVEC	2,737	1,523	1,214
TVA	2,583	1,407	1,176
Total	6,564	5,690	874

Every external balancing authority is mapped to an import and export interface pricing point. The mapping is designed to reflect the physical flow of energy between PJM and each balancing authority. The net scheduled values for interface pricing points are defined as the MWh of scheduled transactions that will receive the interface pricing point based on the external balancing authority mapping.<sup>30</sup> For example, the MWh for a transaction whose transmission path is SPP through MISO and into PJM would be reflected in the SouthIMP interface pricing point net schedule totals because SPP is mapped to the SouthIMP interface pricing point. The actual flow on an

<sup>30</sup> The terms balancing authority and control area are used interchangeably in this section. The NERC Tag applications maintained the terminology of generation control area (GCA) and load control area (LCA) after the implementation of the NERC functional model. The NERC functional model classifies the balancing authority as a reliability service function, with, among other things, the responsibility for balancing generation, demand and interchange balance. See "Reliability Functional Model," <[http://www.nerc.com/files/Functional\\_Model\\_V4\\_CLEAN\\_2008Dec01.pdf](http://www.nerc.com/files/Functional_Model_V4_CLEAN_2008Dec01.pdf)>. (August 2008)

interface pricing point is defined as the metered flow across the transmission lines that are included in the interface pricing point.

The differences between the scheduled MWh mapped to a specific interface pricing point and actual power flows at the interface pricing points provide a better measure of loop flows than differences at the interfaces. The scheduled transactions are mapped to interface pricing points based on the expected flow from the generation balancing authority and load balancing authority, whereas scheduled transactions are assigned to interfaces based solely on the OASIS path that the market participants reflect the transmission path into or out of PJM to one neighboring balancing authority. Power flows at the interface pricing points provide a more accurate reflection of where scheduled power flows actually enter or leave the PJM footprint based on the complete transaction path.

Table 9-19 shows the net scheduled and actual PJM flows by interface pricing point. The CPLEEXP, CPLEIMP, DUKEXP, DUKIMP, NCMPAEXP, and NCMPAIMP interface pricing points were created as part of operating agreements with external balancing authorities, and reflect the same physical ties as the SouthIMP and SouthEXP interface pricing points.

Because the SouthIMP and SouthEXP interface pricing points are the same physical point, if there are net actual exports from the PJM footprint to the southern region, by definition, there cannot be net actual imports into the PJM footprint from the southern region and therefore there will not be actual flows at the SouthIMP interface pricing point. In the case of PJM's southern border, loop flows can be analyzed by comparing the net scheduled and net actual flows as a sum of the pricing points, rather than the individual pricing points. To accurately calculate the loop flows from the southern region, the net actual flows from the southern region are compared to the net scheduled flows from the southern region. The net actual flows from the southern region are determined by summing the total southern import actual flows (8,674 GWh) and the total southern export actual flows (-2,468 GWh) for 6,206 GWh of net imports. The net scheduled flows from the southern region are determined by summing the total southern import scheduled flows (6,539 GWh) and the total

southern export scheduled flows (-223 GWh) for 6,316 GWh of net imports. In the first three months of 2016, the loop flows at the southern region were the difference between the southern region net scheduled flows (6,316 GW) and the southern region net actual flows (6,206 GWh) for a total of 110 GWh of loop flows.

The IMO interface pricing point with the Ontario IESO was created to reflect the fact that transactions that originate or sink in the Ontario Independent Electricity System Operator (IMO) balancing authority create physical flows that are split between the MISO and NYISO interface pricing points depending on transmission system conditions, so a mapping to a single interface pricing point does not reflect the actual flows. PJM created the IMO interface pricing point to reflect the actual power flows across both the MISO/PJM and NYISO/PJM interfaces. The IMO does not have physical ties with PJM because it is not contiguous. Table 9-19 shows actual flows associated with the IMO interface pricing point as zero because there is no PJM/IMO Interface. The actual flows between IMO and PJM are included in the actual flows at the MISO and NYISO interface pricing points.

**Table 9-19 Net scheduled and actual PJM flows by interface pricing point (GWh): January through March, 2016**

	Actual	Net Scheduled	Difference (GWh)
IMO	0	1,339	(1,339)
MISO	(333)	(1,287)	954
NORTHWEST	0	(5)	5
NYISO	(2,046)	(2,196)	150
HUDSONTP	(0)	(0)	0
LINDENVFT	(406)	(406)	0
NEPTUNE	(1,278)	(1,278)	0
NYIS	(362)	(511)	150
OVEC	2,737	1,523	1,214
Southern Imports	8,674	6,539	2,135
CPLEIMP	0	16	(16)
DUKIMP	0	337	(337)
NCMPAIMP	0	419	(419)
SOUTHEAST	0	0	0
SOUTHWEST	0	0	0
SOUTHIMP	8,674	5,766	2,908
Southern Exports	(2,468)	(223)	(2,245)
CPLEEXP	0	(114)	114
DUKEXP	0	(19)	19
NCMPAEXP	0	(0)	0
SOUTHEAST	0	0	0
SOUTHWEST	0	0	0
SOUTHEXP	(2,468)	(90)	(2,378)
Total	6,564	5,690	874

Table 9-20 shows the net scheduled and actual PJM flows by interface pricing point, with adjustments made to the MISO and NYISO scheduled interface pricing points based on the quantities of scheduled interchange where transactions from the IMO entered the PJM energy market. For example, Table 9-22 shows that the 1,339 GW of gross scheduled transactions that were mapped to the IMO Interface Pricing Point, were comprised of 1 GWh of imports through the NYISO and 1,338 GWh of imports through MISO.

Table 9-20 shows that in the first three months of 2016, the SouthIMP interface pricing point had the largest loop flows of any interface pricing point with 5,766 GWh of net scheduled interchange and 8,674 GWh of net actual interchange, a difference of 2,908 GWh.

**Table 9-20 Net scheduled and actual PJM flows by interface pricing point (GWh) (Adjusted for IMO Scheduled Interfaces): January through March, 2016**

	Actual	Net Scheduled	Difference (GWh)
MISO	(333)	51	(384)
NORTHWEST	0	(5)	5
NYISO	(2,046)	(2,195)	148
HUDSONTP	(0)	(0)	0
LINDENVFT	(406)	(406)	0
NEPTUNE	(1,278)	(1,278)	0
NYIS	(362)	(510)	148
OVEC	2,737	1,523	1,214
Southern Imports	8,674	6,539	2,135
CPLEIMP	0	16	(16)
DUKIMP	0	337	(337)
NCMPAIMP	0	419	(419)
SOUTHEAST	0	0	0
SOUTHWEST	0	0	0
SOUTHIMP	8,674	5,766	2,908
Southern Exports	(2,468)	(223)	(2,245)
CPLEEXP	0	(114)	114
DUKEXP	0	(19)	19
NCMPAEXP	0	(0)	0
SOUTHEAST	0	0	0
SOUTHWEST	0	0	0
SOUTHEXP	(2,468)	(90)	(2,378)
Total	6,564	5,690	874

PJM attempts to ensure that external energy transactions are priced appropriately through the assignment of interface prices based on the expected actual flow from the generation balancing authority (source) and load balancing authority (sink) as specified on the NERC Tag. Assigning prices in this manner is a reasonable approach to ensuring that transactions receive or pay the PJM market value of the transaction based on expected flows, but this method does not address loop flow issues.

Loop flows remain a significant concern for the efficiency of the PJM market. Loop flows can have negative impacts on the efficiency of markets with explicit locational pricing, including impacts on locational prices, on FTR revenue adequacy and on system operations, and can be evidence of attempts to game the markets.

The MMU recommends that PJM implement a validation method for submitted transactions that would prohibit market participants from breaking transactions into smaller segments to defeat the interface pricing rule and receive higher prices (for imports) or lower prices (for exports) from PJM resulting from the inability to identify the true source or sink of the transaction. If all of the Northeast ISOs and RTOs implemented validation to prohibit the breaking of transactions into smaller segments, the level of Lake Erie loop flow would be reduced.

The MMU recommends that the validation also require market participants to submit transactions on market paths that reflect the expected actual flow in order to reduce unscheduled loop flows.

Table 9-21 shows the net scheduled and actual PJM flows by interface and interface pricing point. This table shows the interface pricing points that were assigned to energy transactions that had market paths at each of PJM's interfaces. For example, Table 9-21 shows that in the first three months of 2016, the majority of imports to the PJM energy market for which a market participant specified Cinergy as the interface with PJM based on the scheduled transmission path, had a generation control area mapped to the IMO Interface, and thus actual flows were assigned the IMO interface pricing point (371 GWh). The majority of exports from the PJM energy market for which a market participant specified Cinergy as the interface with PJM based on the scheduled transmission path had a load control area for which the actual flows would leave the PJM energy market at the MISO Interface, and were assigned the Northwest interface pricing point (-5 GWh).

Table 9-21 Net scheduled and actual PJM flows by interface and interface pricing point (GWh): January through March, 2016

Interface	Interface Pricing Point	Actual	Net Scheduled	Difference (GWh)	Interface	Interface Pricing Point	Actual	Net Scheduled	Difference (GWh)
ALTE		(1,613)	(2)	(1,612)	HUDS		(0)	(0)	0
	MISO	(1,613)	(497)	(1,116)		HUDSONTP	(0)	(0)	0
	SOUTHIMP	0	495	(495)	IPL		(67)	105	(172)
ALTW		(733)	104	(837)		IMO	0	55	(55)
	MISO	(733)	104	(837)		MISO	(67)	34	(101)
AMIL		3,212	2,324	888		SOUTHIMP	0	15	(15)
	MISO	3,212	535	2,677	LGEE		849	531	317
	SOUTHIMP	0	1,789	(1,789)		SOUTHEXP	(1,750)	(3)	(1,747)
CIN		(1,112)	543	(1,655)		SOUTHIMP	2,599	535	2,064
	IMO	0	371	(371)	LIND		(406)	(406)	0
	MISO	(1,112)	1	(1,113)		LINDENVFT	(406)	(406)	0
	NORTHWEST	0	(5)	5	MEC		(937)	(1,247)	310
	SOUTHEXP	0	(1)	1		IMO	0	2	(2)
	SOUTHIMP	0	177	(177)		MISO	(937)	(1,248)	311
CPLE		2,002	50	1,952	MECS		1,085	973	112
	CPLEEXP	0	(114)	114		IMO	0	910	(910)
	CPLEIMP	0	16	(16)		MISO	1,085	(85)	1,170
	DUKIMP	0	16	(16)		SOUTHIMP	0	149	(149)
	NCMPAIMP	0	99	(99)	NEPT		(1,278)	(1,278)	0
	SOUTHEXP	(348)	(2)	(345)		NEPTUNE	(1,278)	(1,278)	0
	SOUTHIMP	2,350	35	2,315	NIPS		(2,337)	27	(2,364)
CPLW		(154)	7	(161)		MISO	(2,337)	23	(2,359)
	DUKIMP	0	1	(1)		SOUTHIMP	0	5	(5)
	SOUTHEXP	(194)	0	(194)	NYIS		(362)	(510)	148
	SOUTHIMP	41	6	35		IMO	0	1	(1)
CWLP		(170)	0	(170)		NYIS	(362)	(511)	150
	MISO	(170)	0	(170)	OVEC		2,737	1,523	1,214
DUK		926	1,691	(765)		OVEC	2,737	1,523	1,214
	DUKEXP	0	(19)	19	TVA		2,583	1,407	1,176
	DUKIMP	0	320	(320)		SOUTHEXP	(161)	(39)	(123)
	NCMPAEXP	0	(0)	0		SOUTHIMP	2,745	1,446	1,298
	NCMPAIMP	0	320	(320)	WEC		2,340	(153)	2,493
	SOUTHEXP	(14)	(45)	31		MISO	2,340	(153)	2,493
	SOUTHIMP	940	1,115	(175)	Grand Total		6,564	5,690	874

Table 9-22 shows the net scheduled and actual PJM flows by interface pricing point and interface. The grouping is reversed from Table 9-21. Table 9-22 shows the interfaces where transactions were scheduled which received the individual interface pricing points. For example, Table 9-22 shows that in the first three months of 2016, the majority of imports to the PJM energy market for which a market participant specified a generation control area for which it was assigned the MISO interface pricing point, had a market path that entered the PJM energy market at the AMIL Interface (535 GWh). The majority of exports from the PJM

energy market for which a market participant specified a load control area for which it was assigned the MISO interface pricing point, had a market path that exited the PJM energy market at the MEC Interface (-1,248 GWh).

**Table 9-22 Net scheduled and actual PJM flows by interface pricing point and interface (GWh): January through March, 2016**

Interface Pricing Point	Interface	Actual	Net Scheduled	Difference (GWh)	Interface Pricing Point	Interface	Actual	Net Scheduled	Difference (GWh)
CPLEEXP		0	(114)	114	NCMPAIMP		0	419	(419)
	CPLE	0	(114)	114		CPLE	0	99	(99)
CPLEIMP		0	16	(16)		DUK	0	320	(320)
	CPLE	0	16	(16)	NEPTUNE		(1,278)	(1,278)	0
DUKEXP		0	(19)	19		NEPT	(1,278)	(1,278)	0
	DUK	0	(19)	19	NORTHWEST		0	(5)	5
DUKIMP		0	337	(337)		CIN	0	(5)	5
	CPLE	0	16	(16)	NYIS		(362)	(511)	150
	CPLW	0	1	(1)		NYIS	(362)	(511)	150
	DUK	0	320	(320)	OVEC		2,737	1,523	1,214
HUDSONTP		(0)	(0)	0		OVEC	2,737	1,523	1,214
	HUDS	(0)	(0)	0	SOUTHEXP		(2,468)	(90)	(2,378)
IMO		0	1,339	(1,339)		CIN	0	(1)	1
	CIN	0	371	(371)		CPLW	(194)	0	(194)
	IPL	0	55	(55)		DUK	(14)	(45)	31
	MEC	0	2	(2)		LGEE	(1,750)	(3)	(1,747)
	MECS	0	910	(910)		TVA	(161)	(39)	(123)
	NYIS	0	1	(1)					
LINDENVFT		(406)	(406)	0	SOUTHIMP		8,674	5,766	2,908
	LIND	(406)	(406)	0		ALTE	0	495	(495)
MISO		(333)	(1,287)	954		AMIL	0	1,789	(1,789)
	ALTE	(1,613)	(497)	(1,116)		CIN	0	177	(177)
	ALTW	(733)	104	(837)		CPLW	41	6	35
	AMIL	3,212	535	2,677		DUK	940	1,115	(175)
	CIN	(1,112)	1	(1,113)		IPL	0	15	(15)
	CWLP	(170)	0	(170)		LGEE	2,599	535	2,064
	IPL	(67)	34	(101)		MECS	0	149	(149)
	MEC	(937)	(1,248)	311		NIPS	0	5	(5)
	MECS	1,085	(85)	1,170		TVA	2,745	1,446	1,298
	NIPS	(2,337)	23	(2,359)					
	WEC	2,340	(153)	2,493	Grand Total		6,564	5,690	874
NCMPAEXP		0	(0)	0					
	DUK	0	(0)	0					

## Data Required for Full Loop Flow Analysis

Loop flows are defined as the difference between actual and scheduled power flows at one or more specific interfaces. The differences between actual and scheduled power flows can be the result of a number of underlying causes. To adequately investigate the causes of loop flows, complete data are required.

Loop flows exist because electricity flows on the path of least resistance regardless of the path specified by contractual agreement or regulatory prescription. Loop flows can arise from transactions scheduled into, out of or around a balancing authority on contract paths that do not correspond to the actual physical paths on which energy flows. Outside of LMP-based energy markets, energy is scheduled and paid for based on contract path, without regard to the path of the actual energy flows. Loop flows can also result from actions within balancing authorities.

Loop flows are a significant concern. Loop flows can have negative impacts on the efficiency of markets with explicit locational pricing, including impacts on locational prices, on FTR revenue adequacy and on system operations, and can be evidence of attempts to game such markets. Loop flows also have poorly understood impacts on non market areas. In general, the detailed sources

of the identified differences between scheduled and actual flows remain unclear as a result of incomplete or inadequate access to the required data.

A complete analysis of loop flow could provide additional insight that could lead to enhanced overall market efficiency and clarify the interactions among market and non market areas. A complete analysis of loop flow would improve the overall transparency of electricity transactions. There are areas with transparent markets, and there are areas with less transparent markets (non market areas), but these areas together comprise a market, and overall market efficiency would benefit from the increased transparency that would derive from a better understanding of loop flows.

For a complete loop flow analysis, several types of data are required from all balancing authorities in the Eastern Interconnection. The Commission recently required access to NERC Tag data. In addition to the Tag data, actual tie line data, dynamic schedule and pseudo-tie data are required in order to analyze the differences between actual and scheduled transactions. ACE data, market flow impact data and generation and load data are required in order to understand the sources, within each balancing authority, of loop flows that do not result from differences between actual and scheduled transactions.<sup>31</sup>

### NERC Tag Data

An analysis of loop flow requires knowledge of the scheduled path of energy transactions. NERC Tag data includes the scheduled path and energy profile of the transactions, including the Generation Control Area (GCA), the intermediate Control Areas, the Load Control Area (LCA) and the energy profile of all transactions. Additionally, complete tag data include the identity of the specific market participants. FERC Order No. 771 required access to NERC Tag data for the Commission, regional transmission organizations, independent system operators and market monitoring units.<sup>32</sup>

<sup>31</sup> It is requested that all data be made available in downloadable format in order to make analysis possible. A data viewing tool alone is not adequate.

<sup>32</sup> 141 FERC ¶ 61,235 (2012). *Availability of E-Tag Information to Commission Staff*.

### Actual Tie Line Flow Data

An analysis of loop flow requires knowledge of the actual path of energy transactions. Currently, a very limited set of tie line data is made available via the NERC IDC and the Central Repository for Curtailments (CRC) website. Additionally, the available tie line data, and the data within the IDC, are presented as information on a screen, which does not permit analysis of the underlying data.

### Dynamic Schedule and Pseudo-Tie Data

Dynamic schedule and pseudo ties represent another type of interchange transaction between balancing authorities. While dynamic schedules are required to be tagged, the tagged profile is only an estimate of what energy is expected to flow. Dynamic schedules are implemented within each balancing authority's Energy Management System (EMS), with the current values shared over Inter-Control Center Protocol (ICCP) links. By definition, the dynamic schedule scheduled and actual values will always be identical from a balancing authority standpoint, and the tagged profile should be removed from the calculation of loop flows to eliminate double counting of the energy profile. Dynamic schedule data from all balancing authorities are required in order to account for all scheduled and actual flows.

Pseudo-ties are similar to dynamic schedules in that they represent a transaction between balancing authorities and are handled within the EMS systems and data are shared over the ICCP. Pseudo-ties only differ from dynamic schedules in how the generating resource is modeled within the balancing authorities' ACE equations. Dynamic schedules are modeled as resources located in one area serving load in another, while pseudo-ties are modeled as resources in one area moved to another area. Unlike dynamic schedules, pseudo-tie transactions are not required to be tagged. Pseudo-tie data from all balancing authorities are required in order to account for all scheduled and actual flows.

### Area Control Error (ACE) Data

Area Control Error (ACE) data provides information about how well each balancing authority is matching their generation with their load. This

information, combined with the scheduled and actual interchange values will show whether an individual balancing authority is pushing on or leaning on the interconnection, contributing to loop flows.

NERC makes real-time ACE graphs available on their Reliability Coordinator Information System (RCIS) website. This information is presented only in graphical form, and the underlying data is not available for analysis.

### Market Flow Impact Data

In addition to interchange transactions, internal dispatch can also affect flows on balancing authorities' tie lines. The impact of internal dispatch on tie lines is called market flow. Market flow data are imported in the IDC, but there is only limited historical data, as only market flow data related to TLR levels 3 or higher are required to be made available via a Congestion Management Report (CMR). The remaining data are deleted.

There is currently a project in development through the NERC Operating Reliability Subcommittee (ORS) called the Market Flow Impact Tool. The purpose of this tool is to make visible the impacts of dispatch on loop flows. The MMU supports the development of this tool, and requests that FERC and NERC ensure that the underlying data are provided to market monitors and other approved entities.

### Generation and Load Data

Generation data (both real-time scheduled generation and actual output) and load data would permit analysis of the extent to which balancing authorities are meeting their commitments to serve load. If a balancing authority is not meeting its load commitment with adequate generation, the result is unscheduled flows across the interconnections to establish power balance.

Market areas are transparent in providing real-time load while non market areas are not. For example, PJM posts real-time load via its eDATA application. Most non market balancing authorities provide only the expected peak load on their individual web sites. Data on generation are not made publicly available, as this is considered market sensitive information.

The MMU requests, that in order to permit a complete analysis of loop flow, FERC and NERC ensure that the identified data are made available to market monitors as well as other industry entities determined appropriate by FERC.

### PJM and MISO Interface Prices

If interface prices were defined in a comparable manner by PJM and MISO, and if time lags were not built into the rules governing interchange transactions, then prices at the interfaces would be expected to be very close and the level of transactions would be expected to be related to any price differentials. The fact that these conditions do not exist is important in explaining the observed relationship between interface prices and inter-RTO power flows, and those price differentials.

Both the PJM/MISO and MISO/PJM interface pricing points represent the value of power at the relevant border, as determined in each market. In both cases, the interface price is the price at which transactions are settled. For example, a transaction into PJM from MISO would receive the PJM/MISO interface price upon entering PJM, while a transaction into MISO from PJM would receive the MISO/PJM interface price. PJM and MISO use network models to determine these prices and to attempt to ensure that the prices are consistent with the underlying electrical flows.

Under the PJM/MISO Joint Operating Agreement, the two RTOs mutually determine a set of transmission facilities on which both RTOs have an impact, and therefore jointly operate to those constraints. These jointly controlled facilities are M2M (Market to Market) flowgates. When a M2M constraint binds, PJM's LMP calculations at the buses that make up PJM's MISO interface pricing point, as well as for all buses in the PJM model, are based on the PJM model's distribution factors of the selected buses to the binding M2M constraint and PJM's shadow price of the binding M2M constraint. MISO's LMP calculations at the buses that make up MISO's PJM interface pricing point are based on the MISO model's distribution factors of the selected buses to the binding M2M constraint and MISO's shadow price of the binding M2M constraint.

The appropriate definition of interface prices is an ongoing topic of conversation at the PJM/MISO Joint and Common Market Meetings. Prior to June 1, 2014, the PJM interface definition for MISO consisted of nine buses located near the middle of the MISO system and not at the border between the RTOs. The MISO interface definition for PJM currently consists of all PJM generator buses which are spread across the entire PJM system. The interface definitions led to questions about the level of congestion included in interchange pricing.<sup>33 34</sup>

PJM modified the definition of the PJM/MISO interface price effective June 1, 2014, consistent with the PJM proposal. PJM's new MISO interface pricing point includes 10 equally weighted buses that are close to the PJM/MISO border. The 10 buses were selected based on PJM's analysis that showed that over 80 percent of the hourly tie line flows between PJM and MISO occurred on ten ties composed of MISO and PJM monitored facilities.


### Real-Time and Day-Ahead PJM/MISO Interface Prices

In the first three months of 2016, the direction of flow was consistent with price differentials in 57.4 percent of the hours. Table 9-23 shows the number of hours and average hourly price differences between the PJM/MISO Interface and the MISO/PJM Interface based on LMP differences and flow direction. Figure 9-4 shows the underlying hourly variability in prices.

**Table 9-23 PJM and MISO flow based hours and average hourly price differences: January through March, 2016**

LMP Difference	Flow Direction	Number of Hours	Average Hourly Price Difference
MISO/PJM LMP > PJM/MISO LMP	Any Flow	1,099	\$3.19
	Consistent Flow (PJM to MISO)	674	\$2.71
	Inconsistent Flow (MISO to PJM)	425	\$3.95
PJM/MISO LMP > MISO/PJM LMP	No Flow	0	\$0.00
	Any Flow	1,084	\$4.46
	Consistent Flow (MISO to PJM)	580	\$5.25
	Inconsistent Flow (PJM to MISO)	504	\$3.54
	No Flow	1	\$9.99

**Figure 9-4 Real-time and day-ahead daily hourly average price difference (MISO/PJM Interface minus PJM/MISO Interface): January through March, 2016**

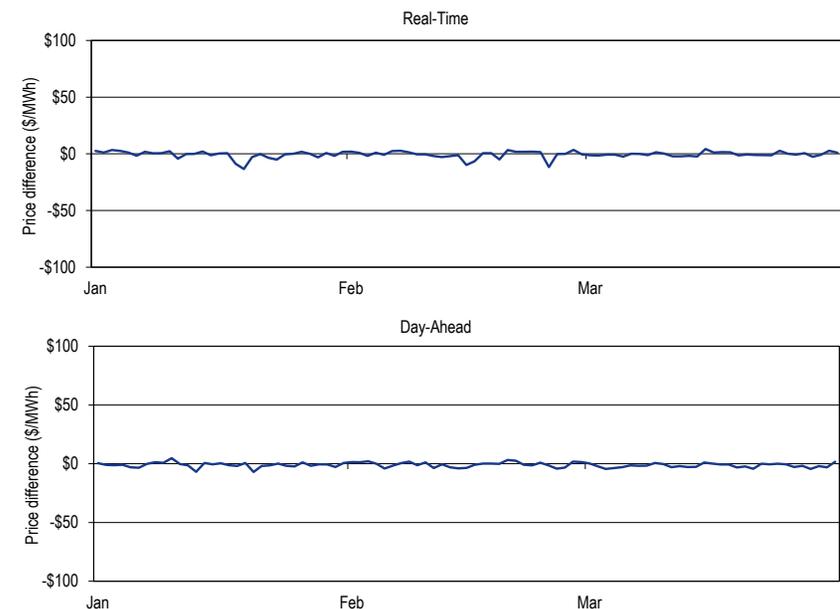

<sup>33</sup> See "LMP Aggregate Definitions," (December 8, 2015) <<http://www.pjm.com/~media/markets-ops/energy/lmp-model-info/lmp-aggregate-definitions.ashx>>. PJM periodically updates these definitions on its web site. See <<http://www.pjm.com>>.

<sup>34</sup> Based on information obtained from MISO's extranet <<http://extranet.midwestiso.org>> (Accessed January 28, 2016).

## Distribution and Prices of Hourly Flows at the PJM/MISO Interface

In the first three months of 2016, the direction of hourly energy flows was consistent with PJM and MISO interface price differentials in 1,254 hours (57.4 percent of all hours), and was inconsistent with price differentials in 929 hours (42.6 percent of all hours). Table 9-24 shows the distribution of hourly energy flows between PJM and MISO based on the price differences between the PJM/MISO and MISO/PJM prices. Of the 929 hours where flows were in a direction inconsistent with price differences, 654 of those hours (70.4 percent) had a price difference greater than or equal to \$1.00 and 167 of those hours (18.0 percent) had a price difference greater than or equal to \$5.00. The largest price difference with such flows was \$123.61. Of the 1,254 hours where flows were consistent with price differences, 931 of those hours (74.2 percent) had a price difference greater than or equal to \$1.00 and 213 of all such hours (17.0 percent) had a price difference greater than or equal to \$5.00. The largest price difference with such flows was \$113.58.

**Table 9-24 Distribution of hourly flows that are consistent and inconsistent with price differences between PJM and MISO: January through March, 2016**

Price Difference Range (Greater Than or Equal To)	Inconsistent Hours	Percent of Total Hours	Consistent Hours	Percent of Total Hours
\$0.00	929	100.0%	1,254	100.0%
\$1.00	654	70.4%	931	74.2%
\$5.00	167	18.0%	213	17.0%
\$10.00	65	7.0%	88	7.0%
\$15.00	29	3.1%	58	4.6%
\$20.00	16	1.7%	42	3.3%
\$25.00	15	1.6%	29	2.3%
\$50.00	3	0.3%	5	0.4%
\$75.00	2	0.2%	2	0.2%
\$100.00	2	0.2%	1	0.1%
\$200.00	0	0.0%	0	0.0%
\$300.00	0	0.0%	0	0.0%
\$400.00	0	0.0%	0	0.0%
\$500.00	0	0.0%	0	0.0%

## PJM and NYISO Interface Prices

If interface prices were defined in a comparable manner by PJM and the NYISO, if identical rules governed external transactions in PJM and the NYISO, if time lags were not built into the rules governing such transactions and if no risks were associated with such transactions, then prices at the interfaces would be expected to be very close and the level of transactions would be expected to be related to any price differentials. The fact that none of these conditions exists is important in explaining the observed relationship between interface prices and inter-RTO/ISO power flows, and those price differentials.<sup>35</sup>

## Real-Time and Day-Ahead PJM/NYISO Interface Prices

In the first three months of 2016, the relationship between prices at the PJM/NYIS Interface and at the NYISO/PJM proxy bus and the relationship between interface price differentials and power flows continued to be affected by differences in institutional and operating practices between PJM and the NYISO. The direction of flow was consistent with price differentials in 57.0 percent of the hours in the first three months of 2016. Table 9-25 shows the number of hours and average hourly price differences between the PJM/NYIS Interface and the NYIS/PJM proxy bus based on LMP differences and flow direction. Figure 9-5 shows the underlying hourly variability in prices.


**Table 9-25 PJM and NYISO flow based hours and average hourly price differences: January through March, 2016<sup>36</sup>**

LMP Difference	Flow Direction	Number of Hours	Average Hourly Price Difference
NYIS/PJM proxy bus LBMP > PJM/NYIS LMP	Any Flow	771	\$18.54
	Consistent Flow (PJM to NYIS)	502	\$19.21
	Inconsistent Flow (NYIS to PJM)	269	\$17.30
PJM/NYIS LMP > NYIS/PJM proxy bus LBMP	No Flow	0	\$0.00
	Any Flow	1,412	\$8.33
	Consistent Flow (NYIS to PJM)	742	\$7.27
	Inconsistent Flow (PJM to NYIS)	670	\$9.51
	No Flow	0	\$0.00

<sup>35</sup> See the 2012 *State of the Market Report for PJM*, Volume II, Section 8, "Interchange Transactions," for a more detailed discussion.

<sup>36</sup> The NYISO Locational Based Marginal Price (LBMP) is the equivalent term to PJM's Locational Marginal Price (LMP).

**Figure 9-5 Real-time and day-ahead daily hourly average price difference (NY/PJM proxy - PJM/NYIS Interface): January through March, 2016**

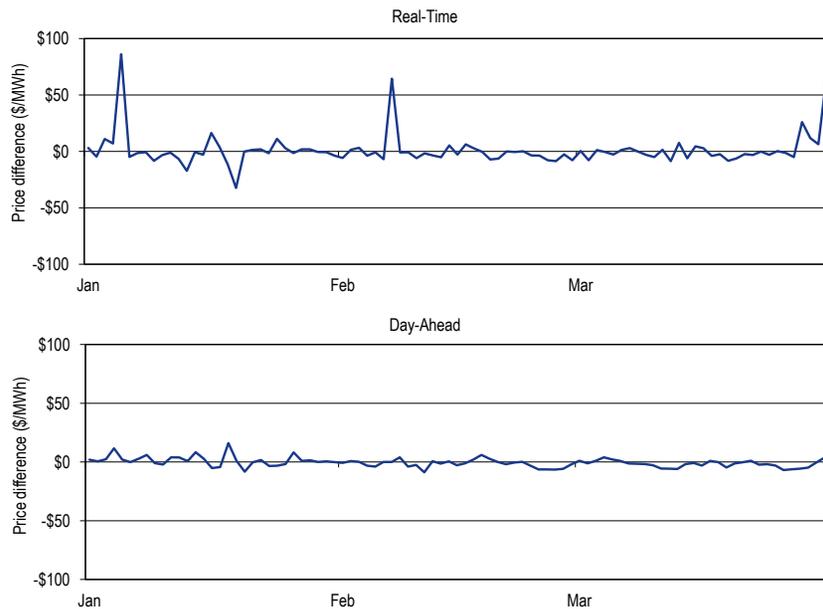

### Distribution and Prices of Hourly Flows at the PJM/NYISO Interface

In the first three months of 2016, the direction of hourly energy flows was consistent with PJM/NYISO and NYISO/PJM price differences in 1,244 hours (57.0 percent of all hours), and was inconsistent with price differences in 939 hours (43.0 percent of all hours). Table 9-26 shows the distribution of hourly energy flows between PJM and NYISO based on the price differences between the PJM/NYISO and NYISO/PJM prices. Of the 939 hours where flows were in a direction inconsistent with price differences, 826 of those hours (88.0 percent) had a price difference greater than or equal to \$1.00 and 474 of all those hours (50.5 percent) had a price difference greater than or equal to \$5.00. The largest price difference with such flows was \$984.25. Of the 1,244 hours where flows were consistent with price differences, 1,114 of

those hours (89.5 percent) had a price difference greater than or equal to \$1.00 and 692 of all such hours (55.6 percent) had a price difference greater than or equal to \$5.00. The largest price difference with such flows was \$977.45.

**Table 9-26 Distribution of hourly flows that are consistent and inconsistent with price differences between PJM and NYISO: January through March, 2016**

Price Difference Range (Greater Than or Equal To)	Inconsistent Hours	Percent of Total Hours	Consistent Hours	Percent of Total Hours
\$0.00	939	100.0%	1,244	100.0%
\$1.00	826	88.0%	1,114	89.5%
\$5.00	474	50.5%	692	55.6%
\$10.00	250	26.6%	311	25.0%
\$15.00	162	17.3%	132	10.6%
\$20.00	101	10.8%	92	7.4%
\$25.00	81	8.6%	73	5.9%
\$50.00	29	3.1%	26	2.1%
\$75.00	16	1.7%	14	1.1%
\$100.00	8	0.9%	12	1.0%
\$200.00	3	0.3%	6	0.5%
\$300.00	3	0.3%	6	0.5%
\$400.00	2	0.2%	5	0.4%
\$500.00	2	0.2%	5	0.4%

### Neptune Underwater Transmission Line to Long Island, New York

The Neptune Line is a 65 mile direct current (DC) merchant 230 kV transmission line, with a capacity of 660 MW, providing a direct connection between PJM (Sayreville, New Jersey), and NYISO (Nassau County on Long Island). Schedule 14 of the PJM Open Access Transmission Tariff provides that power flows will only be from PJM to New York. The flows were consistent with price differentials in 53.7 percent of the hours in the first three months of 2016. Table 9-27 shows the number of hours and average hourly price differences between the PJM/NEPT Interface and the NYIS/Neptune bus based on LMP differences and flow direction.

**Table 9-27 PJM and NYISO flow based hours and average hourly price differences (Neptune): January through March, 2016**

LMP Difference	Flow Direction	Number of Hours	Average Hourly Price Difference
NYIS/Neptune Bus LBMP > PJM/NEPT LMP	Any Flow	1,173	\$13.10
	Consistent Flow (PJM to NYIS)	1,173	\$13.10
	Inconsistent Flow (NYIS to PJM)	0	\$0.00
	No Flow	0	\$0.00
PJM/NEPT LMP > NYIS/Neptune Bus LBMP	Any Flow	1,010	\$8.22
	Consistent Flow (NYIS to PJM)	0	\$0.00
	Inconsistent Flow (PJM to NYIS)	1,010	\$8.22
	No Flow	0	\$0.00

To move power from PJM to NYISO using the Neptune Line, two PJM transmission service reservations are required. A transmission service reservation is required from the PJM Transmission System to the Neptune HVDC Line (“Out Service”) and another transmission service reservation is required on the Neptune HVDC line (“Neptune Service”).<sup>37</sup> The PJM Out Service is covered by normal PJM OASIS business operations.<sup>38</sup> The Neptune Service falls under the provisions for controllable merchant facilities, Schedule 14 of the PJM Tariff. The Neptune Service is also acquired on the PJM OASIS.

**Table 9-28 Percent of scheduled interchange across the Neptune line by primary rights holder: July, 2007 through March, 2016**


	2007	2008	2009	2010	2011	2012	2013	2014	2015	2016
January	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
February	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
March	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
April	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	99.99%
May	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	
June	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	
July	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	
August	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	
September	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	
October	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	
November	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	
December	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	

<sup>37</sup> See OASIS “PJM Business Practices for Neptune Transmission Service,” <<http://www.pjm.com/~media/etools/oasis/merch-trans-facilities/neptune-oasis-Business-practices-doc-clean.ashx>>.

<sup>38</sup> See OASIS “Regional Transmission and Energy Scheduling Practices,” <<http://www.pjm.com/~media/etools/oasis/regional-practices-clean-doc.ashx>>.

Neptune Service is owned by a primary rights holder, and any service that is not used (as defined by a schedule on a NERC tag) may be released either voluntarily by the primary rights holder or by default by PJM. The primary rights holder may elect to voluntarily release monthly, weekly, daily or hourly firm or non-firm service. Voluntarily releasing the service allows for the primary rights holder to specify a rate to be charged for the released service. If the primary rights holder does not elect to voluntarily release non-firm service, and does not use the service, the available transmission will be released by default at 12:00, one business day before the start of service. On March 31, 2016, the rate for the non-firm service released by default was \$10 per MWh. The primary rights holder remains obligated to pay for the released service unless a second transmission customer acquires the released service. Table 9-28 shows the percent of scheduled interchange across the Neptune Line by the primary rights holder since commercial operations began in July, 2007. Table 9-28 shows that in the first three months of 2016, the primary rights holder was responsible for 100 percent of the scheduled interchange across the Neptune Line in all months. Figure 9-6 shows the hourly average flow across the Neptune Line for the first three months of 2016.

Figure 9-6 Neptune hourly average flow: January through March, 2016

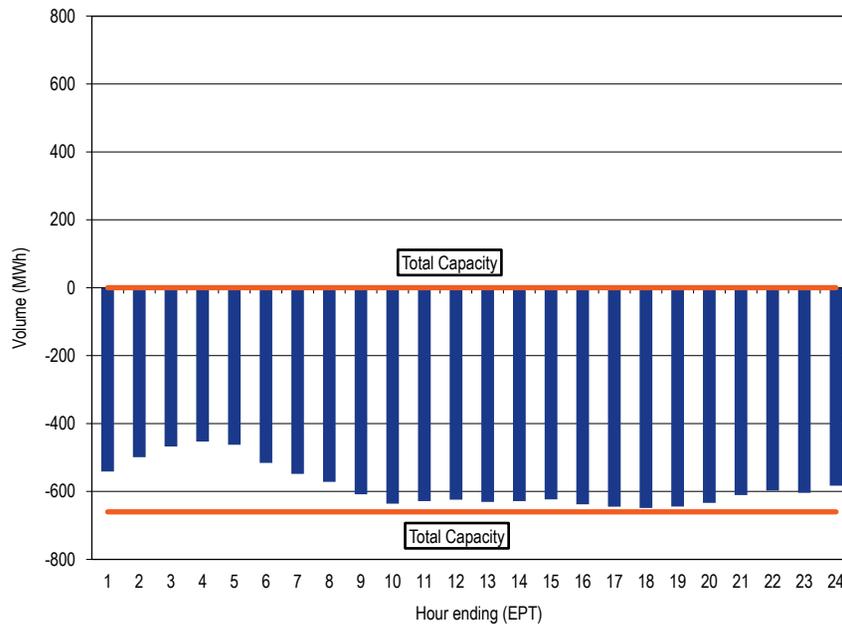

### Linden Variable Frequency Transformer (VFT) facility

The Linden VFT facility is a controllable AC merchant transmission facility, with a capacity of 300 MW, providing a direct connection between PJM (Linden, New Jersey) and NYISO (Staten Island, New York). The flows were consistent with price differentials in 56.0 percent of the hours in the first three months of 2016. Table 9-29 shows the number of hours and average hourly price differences between the PJM/LIND Interface and the NYIS/Linden bus based on LMP differences and flow direction.

Table 9-29 PJM and NYISO flow based hours and average hourly price differences (Linden): January through March, 2016

LMP Difference	Flow Direction	Number of Hours	Average Hourly Price Difference
NYIS/Linden Bus LBMP > PJM/LIND LMP	Any Flow	1,223	\$13.72
	Consistent Flow (PJM to NYIS)	1,222	\$13.73
	Inconsistent Flow (NYIS to PJM)	0	\$0.00
PJM/LIND LMP > NYIS/Linden Bus LBMP	No Flow	1	\$1.93
	Any Flow	960	\$7.54
	Consistent Flow (NYIS to PJM)	0	\$0.00
	Inconsistent Flow (PJM to NYIS)	960	\$7.54
	No Flow	0	\$0.00

To move power from PJM to NYISO on the Linden VFT Line, two PJM transmission service reservations are required. A transmission service reservation is required from the PJM Transmission System to the Linden VFT (“Out Service”) and another transmission service reservation is required on the Linden VFT (“Linden VFT Service”).<sup>39</sup> The PJM Out Service is covered by normal PJM OASIS business operations.<sup>40</sup> The Linden VFT Service falls under the provisions for controllable merchant facilities, Schedule 16 and Schedule 16-A of the PJM Tariff. The Linden VFT Service is also acquired on the PJM OASIS.

Linden VFT Service is owned by a primary rights holder, and any service that is not used (as defined by a schedule on a NERC tag) may be released either voluntarily by the primary rights holder or by default by PJM. The primary rights holder may elect to voluntarily release monthly, weekly, daily or hourly firm or non-firm service. Voluntarily releasing the service allows for the primary rights holder to specify a rate to be charged for the released service. If the primary rights holder elects to not voluntarily release non-firm service, and does not use the service, the available transmission will be released by default at 12:00, one business day before the start of service. On March 31, 2016, the rate for the non-firm service released by default was \$6 per MWh. The primary rights holder remains obligated to pay for the released service unless a second transmission customer acquires the released service. Table

<sup>39</sup> See OASIS “PJM Business Practices for Linden VFT Transmission Service,” <<http://www.pjm.com/~media/etools/oasis/merch-trans-facilities/linden-vft-oasis-Business-practices-doc-clean.ashx>>.


<sup>40</sup> See OASIS “Regional Transmission and Energy Scheduling Practices,” <<http://www.pjm.com/~media/etools/oasis/regional-practices-clean-doc.ashx>>.

9-30 shows the percent of scheduled interchange across the Linden VFT Line by the primary rights holder since commercial operations began in November, 2009. Table 9-30 shows that in the first three months of 2016, the primary rights holder was responsible for the majority of the scheduled interchange across the Linden VFT Line. Figure 9-7 shows the hourly average flow across the Linden VFT Line for the first three months of 2016.

**Table 9-30 Percent of scheduled interchange across the Linden VFT Line by primary rights holder: November, 2009 through March, 2016**

	2009	2010	2011	2012	2013	2014	2015	2016
January	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	70.53%
February	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	94.95%
March	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	96.46%
April	NA	99.97%	100.00%	100.00%	100.00%	99.98%	100.00%	
May	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	
June	NA	100.00%	100.00%	100.00%	100.00%	27.27%	100.00%	
July	NA	100.00%	100.00%	100.00%	100.00%	29.56%	100.00%	
August	NA	100.00%	100.00%	100.00%	100.00%	82.46%	100.00%	
September	NA	100.00%	100.00%	100.00%	100.00%	81.68%	100.00%	
October	NA	100.00%	100.00%	100.00%	100.00%	100.00%	35.05%	
November	100.00%	100.00%	100.00%	100.00%	99.86%	100.00%	61.45%	
December	100.00%	100.00%	100.00%	98.22%	100.00%	100.00%	84.57%	

**Figure 9-7 Linden hourly average flow: January through March, 2016<sup>41</sup>**

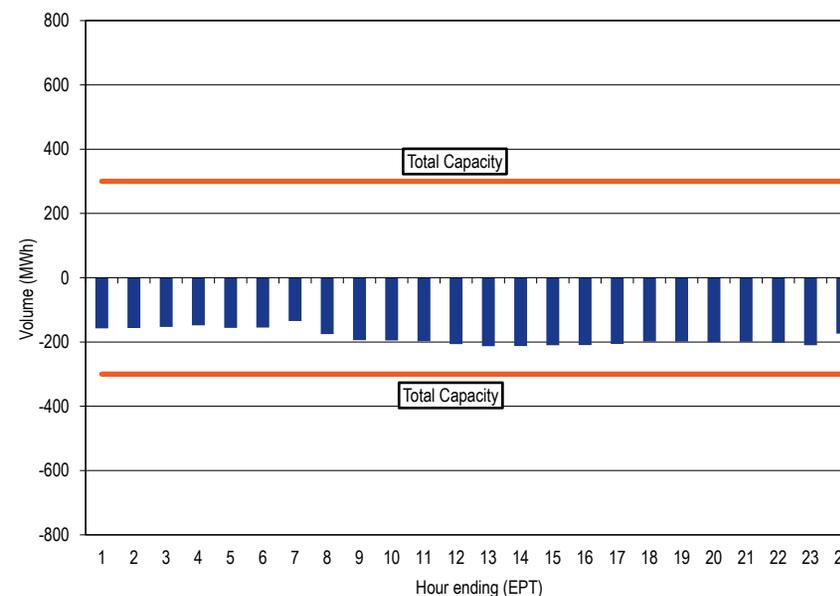

### Hudson Direct Current (DC) Merchant Transmission Line

The Hudson direct current (DC) Line is a bidirectional merchant 230 kV transmission line, with a capacity of 673 MW, providing a direct connection between PJM (Public Service Electric and Gas Company’s (PSE&G) Bergen 230 kV Switching Station located in Ridgefield, New Jersey) and NYISO (Consolidated Edison’s (ConEd) W. 49<sup>th</sup> Street 345 kV Substation in New York City). The connection is a submarine cable system. While the Hudson DC Line is a bidirectional line, power flows are only from PJM to New York because the Hudson Transmission Partners, LLC have only requested withdrawal rights (320 MW of firm withdrawal rights, and 353 MW of non-firm withdrawal rights). The flows were consistent with price differentials in 0.9 percent of the hours in the first three months of 2016. Table 9-31 shows the number of hours

<sup>41</sup> The Linden VFT Line is a bidirectional facility. The “Total Capacity” lines represent the maximum amount of interchange possible in either direction. These lines were included to maintain a consistent scale, for comparison purposes, with the Neptune DC Tie Line.

and average hourly price differences between the PJM/HUDS Interface and the NYIS/Hudson bus based on LMP differences and flow direction.

**Table 9-31 PJM and NYISO flow based hours and average hourly price differences (Hudson): January through March, 2016<sup>42</sup>**

LMP Difference	Flow Direction	Number of Hours	Average Hourly Price Difference
NYIS/Hudson Bus LBMP > PJM/HUDS LMP	Any Flow	1,186	\$14.12
	Consistent Flow (PJM to NYIS)	20	\$28.88
	Inconsistent Flow (NYIS to PJM)	0	\$0.00
	No Flow	1,166	\$13.87
PJM/HUDS LMP > NYIS/Hudson Bus LBMP	Any Flow	997	\$8.37
	Consistent Flow (NYIS to PJM)	0	\$0.00
	Inconsistent Flow (PJM to NYIS)	17	\$14.03
	No Flow	980	\$8.27

To move power from PJM to NYISO on the Hudson Line, two PJM transmission service reservations are required. A transmission service reservation is required from the PJM Transmission System to the Hudson Line (“Out Service”) and another transmission service reservation is required on the Hudson Line (“Hudson Service”).<sup>43</sup> The PJM Out Service is covered by normal PJM OASIS business operations.<sup>44</sup> The Hudson Service falls under the provisions for controllable merchant facilities, Schedule 17 of the PJM Tariff. The Hudson Service is also acquired on the PJM OASIS.

Hudson Service is owned by a primary rights holder, and any service that is not used (as defined by scheduled on a NERC tag) may be released either voluntarily by the primary rights holder or by default by PJM. The primary rights holder may elect to voluntarily release monthly, weekly, daily or hourly firm or non-firm service. Voluntarily releasing the service allows for the primary rights holder to specify a rate to be charged for the released service. If the primary rights holder elects to not voluntarily release non-firm service, and does not use the service, the available transmission will be released by default at 12:00, one business day before the start of service. On March 31,

<sup>42</sup> The Hudson line has been out of service for all but 37 hours in the first three months of 2016.

<sup>43</sup> See OASIS “PJM Business Practices for Hudson Transmission Service,” <<http://www.pjm.com/~media/etools/oasis/merch-trans-facilities/http-Business-practices.ashx>>.

<sup>44</sup> See OASIS “Regional Transmission and Energy Scheduling Practices,” <<http://www.pjm.com/~media/etools/oasis/regional-practices-clean-doc.ashx>>.


2016, the rate for the non-firm service released by default was \$10 per MWh. The primary rights holder remains obligated to pay for the released service unless a second transmission customer acquires the released service.

Table 9-32 shows the percent of scheduled interchange across the Hudson Line by the primary rights holder since commercial operations began in May, 2013. Table 9-32 shows that in the first three months of 2016, the primary rights holder was responsible for 100 percent of the scheduled interchange across the Hudson Line in all months. Figure 9-8 shows the hourly average flow across the Hudson Line for the first three months of 2016.

**Table 9-32 Percent of scheduled interchange across the Hudson Line by primary rights holder: May, 2013 through March, 2016**

	2013	2014	2015	2016
January	NA	51.22%	16.27%	100.00%
February	NA	49.00%	14.67%	100.00%
March	NA	40.40%	71.88%	100.00%
April	NA	100.00%	100.00%	
May	100.00%	26.87%	100.00%	
June	100.00%	5.89%	59.72%	
July	100.00%	18.51%	84.34%	
August	100.00%	75.17%	65.48%	
September	100.00%	75.31%	78.73%	
October	100.00%	99.71%	18.65%	
November	85.57%	99.60%	24.67%	
December	28.32%	1.68%	100.00%	

Figure 9-8 Hudson hourly average flow: January through March, 2016

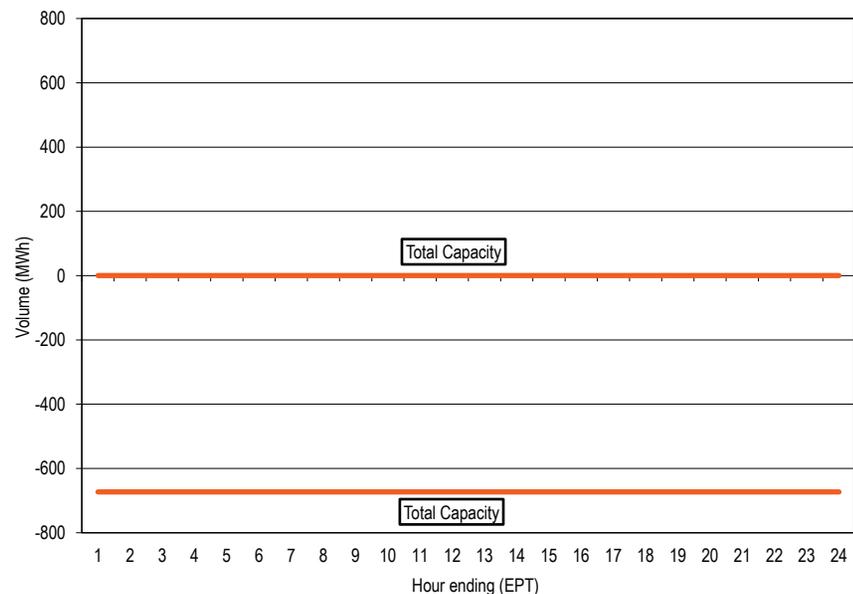

## Operating Agreements with Bordering Areas

To improve reliability and reduce potential competitive seams issues, PJM and its neighbors have developed operating agreements. These agreements include operating agreements with MISO and the NYISO, a reliability agreement with TVA, an operating agreement with Duke Energy Progress, Inc., a reliability coordination agreement with VACAR South, a balancing authority operations agreement with the Wisconsin Electric Power Company (WEC) and a Northeastern planning coordination protocol with NYISO and ISO New England.

Table 9-33 shows a summary of the elements included in each of the operating agreements PJM has with its bordering areas. These elements include: whether PJM and its neighbor include exchange data; near-term system coordination, long-term system coordination, congestion management and joint checkout procedures.

**Table 9-33 Summary of elements included in operating agreements with bordering areas**

Agreement:	PJM-MISO	PJM-NYISO	PJM-TVA	PJM-DEP	PJM-VACAR	PJM-WEP	Northeastern Protocol
Data Exchange							
Real-Time Data	YES	YES	YES	YES	YES	YES	NO
Projected Data	YES	YES	YES	YES	NO	NO	NO
SCADA Data	YES	YES	YES	YES	NO	NO	NO
EMS Models	YES	YES	YES	YES	NO	NO	YES
Operations Planning Data	YES	YES	YES	YES	NO	NO	YES
Available Flowgate Capability Data	YES	YES	YES	YES	NO	NO	YES
Near-Term System Coordination							
Operating Limit Violation Assistance	YES	YES	YES	YES	YES	NO	NO
Over/Under Voltage Assistance	YES	YES	YES	YES	YES	NO	NO
Emergency Energy Assistance	YES	YES	NO	YES	YES	NO	NO
Outage Coordination	YES	YES	YES	YES	YES	NO	NO
Long-Term System Coordination	YES	YES	YES	YES	NO	NO	YES
Congestion Management Process							
ATC Coordination	YES	YES	YES	YES	NO	NO	NO
Market Flow Calculations	YES	YES	YES	NO	NO	NO	NO
Firm Flow Entitlements	YES	YES	YES	NO	NO	NO	NO
Market to Market Redispatch	YES - Redispatch	YES - Redispatch	NO	YES - Dynamic Schedule	NO	NO	NO
Joint Checkout Procedures	YES	YES	YES	YES	NO	YES	NO

PJM-MISO = MISO/PJM Joint Operating Agreement

PJM-NYISO = New York ISO/PJM Joint Operating Agreement

PJM-TVA = Joint Reliability Coordination Agreement Between PJM - Tennessee Valley Authority (TVA)

PJM-DEP = Duke Energy Progress (DEP) - PJM Joint Operating Agreement

PJM-VACAR = PJM-VACAR South Reliability Coordination Agreement

PJM-WEP = Balancing Authority Operations Coordination Agreement Between Wisconsin Electric Power Company and PJM Interconnection, LLC

Northeastern Protocol = Northeastern ISO-Regional Transmission Organization Planning Coordination Protocol

## PJM and MISO Joint Operating Agreement<sup>45</sup>

The Joint Operating Agreement between MISO and PJM Interconnection, L.L.C. was executed on December 31, 2003. The PJM/MISO JOA includes provisions for market based congestion management that, for designated flowgates within MISO and PJM, allow for redispatch of units within the PJM and MISO regions to jointly manage congestion on these flowgates and to assign the costs of congestion management appropriately. In 2012, MISO and

<sup>45</sup> See "Joint Operating Agreement Between the Midwest Independent Transmission System Operator, Inc. and PJM Interconnection, L.L.C.," (December 11, 2008) <<http://www.pjm.com/media/documents/merged-tariffs/miso-joa.pdf>>.

PJM initiated a joint stakeholder process to address issues associated with the operation of the markets at the seam.<sup>46</sup>

Under the market to market rules, the organizations coordinate pricing at their borders. PJM and MISO each calculate an interface LMP using network models including distribution factor impacts. PJM uses 10 buses along the PJM/MISO border to calculate the PJM/MISO interface pricing point LMP while MISO uses all of the PJM generator buses in its model of the PJM system in its calculation of the MISO/PJM interface pricing point.<sup>47</sup>

Coordinated flowgates (CF) are flowgates that are monitored or controlled by either PJM or MISO, on which only one has a significant impact (defined as a greater than five percent impact based on transmission distribution factors and generation to load distribution factors). A reciprocal coordinated flowgate (RCF) is a CF that is monitored and controlled by either PJM or MISO, on which both have significant impacts. Only RCFs are subject to the market to market congestion management process.

As of January 1, 2016, PJM had 130 flowgates eligible for M2M (Market

<sup>46</sup> See "2012 PJM/MISO Joint and Common Market Initiative," <<http://www.pjm.com/media/documents/merged-tariffs/miso-joa.pdf>>.

<sup>47</sup> See the 2012 *State of the Market Report for PJM*, Volume II, Section 8, "Interchange Transactions," for a more detailed discussion.


to Market) coordination. In the first three months of 2016, PJM added six flowgates and deleted three flowgates, leaving 133 flowgates eligible for M2M coordination as of March 31, 2016. As of January 1, 2016, MISO had 207 flowgates eligible for M2M coordination. In the first three months of 2016, MISO added 62 and deleted 6 flowgates, leaving 263 flowgates eligible for M2M coordination as of March 31, 2016.

The timing of the addition of new M2M flowgates may contribute to FTR underfunding. MISO’s ability to add flowgates dynamically throughout the planning period, which were not modeled in any PJM FTR auction, may result in oversold FTRs in PJM, and as a direct consequence, contribute to FTR revenue adequacy issues. Effective June 1, 2014, PJM and MISO established a baseline set of flowgates to be modeled and procedures were developed to coordinate the exchange of FTR limits to be used in their annual FTR processes. A process was developed to ensure that temporary constraints represent known outages and other system conditions. Not allowing for M2M settlements on short-term outages that miss the monthly FTR model deadline could contribute to a solution to the FTR underfunding created by these short-term outages.

The firm flow entitlement (FFE) represents the amount of historic flow that each RTO had created on each RCF used in the market to market settlement process. The FFE establishes the amount of market flow that each RTO is permitted to create on the RCF before incurring redispatch costs during the market to market process. If the non-monitoring RTO’s real-time market flow is greater than their FFE plus the approved MW adjustment from day-ahead coordination, then the non-monitoring RTO will pay the monitoring RTO based on the difference between their market flow and their FFE. If the non-monitoring RTO’s real-time market flow is less than their FFE plus the approved MW adjustment from day-ahead coordination, then the monitoring RTO will pay the non-monitoring RTO for congestion relief provided by the non-monitoring RTO based on the difference between the non-monitoring RTO’s market flow and their FFE. In the first three months of 2016, market to market operations resulted in MISO and PJM redispatching units to control congestion on M2M flowgates and in the exchange of payments for this

redispatch. Figure 9-9 shows credits for coordinated congestion management between PJM and MISO.

Figure 9-9 Credits for coordinated congestion management: January, 2015 through March, 2016<sup>48</sup>

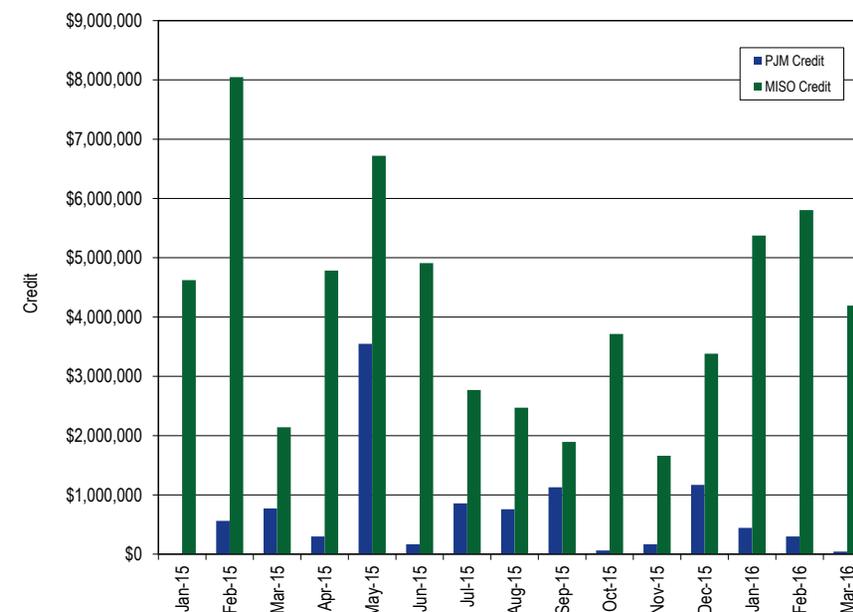

### PJM and New York Independent System Operator Joint Operating Agreement (JOA)<sup>49</sup>

The Joint Operating Agreement between NYISO and PJM Interconnection, L.L.C. became effective on January 15, 2013. Under the market to market rules, the organizations coordinate pricing at their borders. PJM and NYISO each calculate an interface LMP using network models including distribution factor impacts. PJM uses two buses within NYISO to calculate the PJM/NYISO interface pricing point LMP while NYISO calculates the PJM interface price

<sup>48</sup> The totals represented in this figure represent the settlements as of the time of this report and may not include adjustments or resettlements.  
<sup>49</sup> See "New York Independent System Operator, Inc., Joint Operating Agreement with PJM Interconnection, L.L.C.," (January 20, 2015) <<http://www.pjm.com/~media/documents/agreements/nyiso-joa.ashx>>.


(represented by the Keystone proxy bus) based on the assumption that 40 percent of the scheduled energy will flow across the PJM/NYISO border on the Branchburg to Ramapo PAR controlled tie, and the remaining 60 percent will enter the NYISO on their free flowing A/C tie lines.

Coordinated flowgates (CF) are flowgates that are monitored or controlled by either PJM or NYISO, on which only one has a significant impact (defined as a greater than five percent impact based on transmission distribution factors and generation to load distribution factors). A reciprocal coordinated flowgate (RCF) is a CF that is monitored and controlled by either PJM or NYISO, on which both have significant impacts. Only RCFs are subject to the market to market congestion management process.

The firm flow entitlement (FFE) represents the amount of historic flow that each RTO had created on each RCF used in the market to market settlement process. The FFE establishes the amount of market flow that each RTO is permitted to create on the RCF before incurring redispatch costs during the market to market process. If the non-monitoring RTO's real-time market flow is greater than their FFE plus the approved MW adjustment from day-ahead coordination, then the non-monitoring RTO will pay the monitoring RTO based on the difference between their market flow and their FFE. If the non-monitoring RTO's real-time market flow is less than their FFE plus the approved MW adjustment from day-ahead coordination, then the monitoring RTO will pay the non-monitoring RTO for congestion relief provided by the non-monitoring RTO based on the difference between the non-monitoring RTO's market flow and their FFE.

In the first three months of 2016, market to market operations resulted in NYISO and PJM redispatching units to control congestion on M2M flowgates and in the exchange of payments for this redispatch. Figure 9-10 shows credits for coordinated congestion management between PJM and NYISO.

**Figure 9-10 Credits for coordinated congestion management (flowgates): January, 2015 through March, 2016<sup>50</sup>**

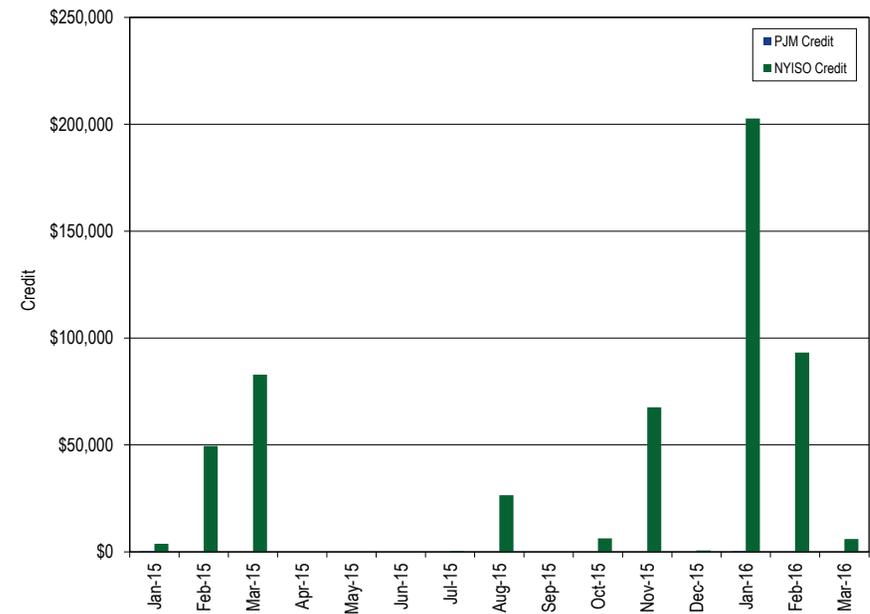


The M2M coordination process focuses on real-time market coordination to manage transmission limitations that occur on the M2M flowgates in a more cost effective manner. Coordination between NYISO and PJM includes not only joint redispatch, but also incorporates coordinated operation of the Ramapo PARs that are located at the PJM/NYIS border. This real-time coordination results in a more efficient economic dispatch solution across both markets to manage the real-time transmission constraints that impact both markets, focusing on the actual flows in real time to manage constraints.<sup>51</sup> For each M2M flowgate, a Ramapo PAR settlement will occur for each interval during coordinated operations. The Ramapo PAR settlements are determined based on whether the measured real-time flow on each of the Ramapo PARs is greater than or less than the calculated target value. If the actual flow is greater

<sup>50</sup> The totals represented in this figure represent the settlements as of the time of this report and may not include adjustments or resettlements.

<sup>51</sup> See "New York Independent System Operator, Inc., Joint Operating Agreement with PJM Interconnection, LLC," <<http://www.pjm.com/~media/documents/agreements/nyiso-joa.ashx>>. (November 4, 2014).

than the target flow, NYISO will make a payment to PJM. This payment is calculated as the product of the M2M flowgate shadow price, the PAR shift factor and the difference between the actual and target PAR flow. If the actual flow is less than the target flow, PJM will make a payment to NYISO. This payment is calculated as the product of the M2M flowgate shadow price, the PAR shift factor and the difference between the target and actual PAR flow. In the first three months of 2016, PAR settlements resulted in monthly payments from PJM to NYISO. Figure 9-11 shows the Ramapo PAR credits for coordinated congestion management between PJM and NYISO.

**Figure 9-11 Credits for coordinated congestion management (Ramapo PARs): January, 2015 through March, 2016<sup>52</sup>**

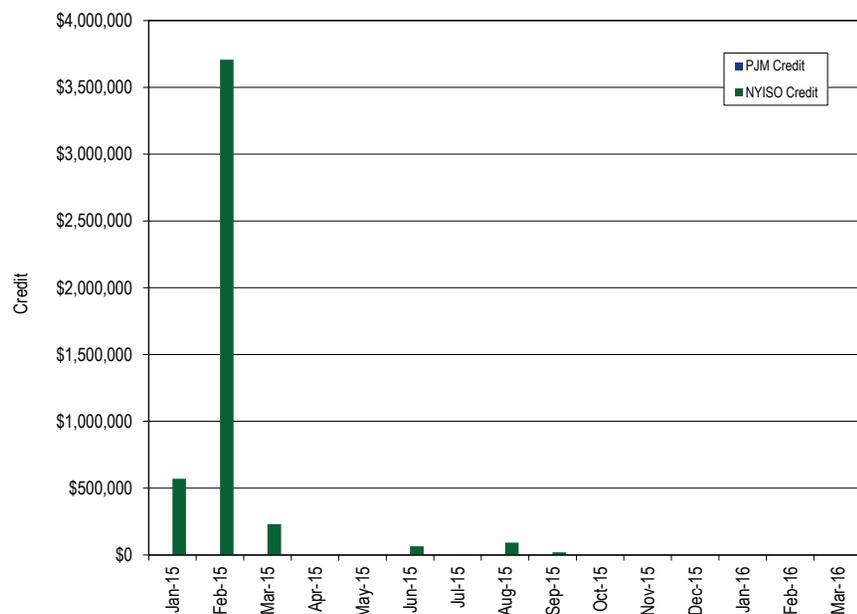

<sup>52</sup> The totals represented in this figure represent the settlements as of the time of this report and may not include adjustments or resettlements.

## PJM and TVA Joint Reliability Coordination Agreement (JRCA)<sup>53</sup>

The joint reliability coordination agreement (JRCA) executed on April 22, 2005, provides for the exchange of information and the implementation of reliability and efficiency protocols between TVA and PJM. The agreement also provides for the management of congestion and arrangements for both near-term and long-term system coordination. Under the JRCA, PJM and TVA honor constraints on the other’s flowgates in their Available Transmission Capability (ATC) calculations. Additionally, market flows are calculated on reciprocal flowgates. When a constraint occurs on a reciprocal flowgate within TVA, PJM has the option to redispatch generation to reduce market flow, and therefore alleviate the constraint. Unlike the M2M procedure between MISO and PJM, this redispatch does not result in M2M payments. However, electing to redispatch generation within PJM can avoid potential market disruption by curtailing a large number of transactions under the Transmission Line Loading Relief (TLR) procedure to achieve the same relief. The agreement remained in effect in the first three months of 2016.

## PJM and Duke Energy Progress, Inc. Joint Operating Agreement<sup>54</sup>

On September 9, 2005, the FERC approved a JOA between PJM and Progress Energy Carolinas, Inc. (PEC), with an effective date of July 30, 2005. As part of this agreement, both parties agreed to develop a formal congestion management protocol (CMP). On February 2, 2010, PJM and PEC filed a revision to the JOA to include a CMP.<sup>55</sup> On January 20, 2011, the Commission conditionally accepted the compliance filing. On July 2, 2012, Duke Energy and Progress Energy Inc. completed a merger. At that time, Progress Energy Carolinas Inc., now a subsidiary of Duke, changed its name to Duke Energy Progress (DEP).

<sup>53</sup> See "Joint Reliability Coordination Agreement Among and Between PJM Interconnection, LLC, and Tennessee Valley Authority," <<http://www.pjm.com/~media/documents/agreements/joint-reliability-coordination-agreement-miso-pjm-tva.ashx>>. (October 15, 2014).

<sup>54</sup> See "Amended and Restated Joint Operating Agreement Among and Between PJM Interconnection, LLC, and Duke Energy Progress Inc.," <<http://www.pjm.com/media/documents/merged-tariffs/progress-joa.pdf>>. (December 3, 2014).

<sup>55</sup> See *PJM Interconnection, LLC and Progress Energy Carolinas, Inc.* Docket No. ER10-713-000 (February 2, 2010).

The PJM/DEP JOA states that the Marginal Cost Proxy Method (MCPM) will be used in the determination of the CPLEIMP and CPLEEXP interface price. Section 2.6A (2) of the PJM Tariff describes the process of calculating the interface price under the MCPM. Under the MCPM, PJM compares the individual bus LMP (as calculated by PJM) for each DEP generator in the PJM model with a telemetered output greater than zero MW to the marginal cost for that generator.

For the CPLEIMP price (imports to PJM), PJM uses the lowest LMP of any generator bus in the DEP balancing authority area, with an output greater than zero MW that has an LMP less than its marginal cost for each five minute interval. If no generator with an output greater than zero MW has an LMP less than its marginal cost, then the import price is the average of the bus LMPs for the set of generators in the DEP area with an output greater than zero MW that PJM determines to be the marginal units in the DEP area for that five minute interval. PJM determines the marginal units in the DEP area by summing the output of the units serving load in the DEP area in ascending order by the units' marginal costs until the sum equals the real time load in the DEP area. Units in the DEP area with marginal costs at or above that of the last unit included in the sum are the marginal units for the DEP area for that interval.

PJM calculates the CPLEEXP price for exports from PJM to DEP as the highest LMP of any generator bus in the DEP area with an output greater than zero MW (excluding nuclear and hydro units) that has an LMP greater than its marginal cost in the 5 minute interval.<sup>56</sup> If no generator with an output greater than zero MW has an LMP greater than its marginal cost, then the export price will be the average of the bus LMPs for the set of generators with an output greater than zero MW that PJM determines to be the marginal units in the same manner as described for the CPLEIMP interface price. The hourly integrated import and export prices are the average of all of the 5 minute intervals in each hour.

<sup>56</sup> The MMU has objected to the omission of nuclear and hydro units from the calculation. This omission is not included in the definition of the MCPM interface pricing method in the PJM Tariff, but is included as a special condition in the PJM/DEP JOA. The MMU does not believe it is appropriate to exclude these units from the calculation as these units could be considered marginal and impact the prices.

The MCPM calculation is based on the DEP units modeled in the PJM market that have an output greater than zero, and only uses the units whose output exceeds the reported DEP real-time load. When new units are added to the DEP footprint, and existing units in the DEP footprint retire, PJM does not have complete data to calculate the interface price. These new units can impact the interface price in several ways. By not having the additional units modeled, these units cannot be considered to be marginal units, and therefore cannot set price. For the import price, if the PJM calculated LMP of one of the new units were to be lower than any currently modeled unit, then PJM's CPLEIMP pricing point would be lower, and PJM would pay less for imports. If the PJM calculated LMP of one of the new units were to be higher than any currently modeled unit, then PJM's CPLEEXP pricing point would be higher, and PJM would receive more for exports.

Not maintaining a current set of units in the DEP footprint in PJM's network model limits PJM's ability to recognize which units are marginal and it is often not possible to calculate the CPLEIMP and CPLEEXP interface prices using the MCPM. By not maintaining a complete set of units in the DEP footprint, the reported output of the modeled units are often insufficient to cover the reported real time load, and therefore no units are considered marginal. When this occurs, the MMU believes that the CPLEIMP and CPLEEXP pricing points should revert to the SOUTHIMP and SOUTHEXP interface prices, but this has not happened. When this occurs, PJM uses the high-low interface pricing method as described in Section 2.6A (1) of the PJM Tariff. The MMU does not believe that this is appropriate, and does not see the basis for this approach in either the PJM Tariff or the PJM/DEP JOA.

On July 2, 2012, Duke Energy and Progress Energy Inc. completed a merger. While the individual companies planned to operate separately for a period of time, they have a joint dispatch agreement, and a joint open access transmission tariff.<sup>57</sup> On October 3, 2014, Duke Energy Progress (DEP) and PJM submitted revisions to the JOA to include a new Appendix B, update references to DEP's current legal name, and incorporate other revisions.<sup>58</sup> The

<sup>57</sup> See "Duke Energy Carolinas, LLC, Carolina Power & Light tariff filing," Docket No. ER12-1338-000 (July 12, 2012) and "Duke Energy Carolinas, LLC, Carolina Power & Light Joint Dispatch Agreement filing," Docket No. ER12-1343-000 (July 11, 2012).

<sup>58</sup> See *Duke Energy Progress, Inc. and PJM Interconnection, LLC*, Docket No. ER15-29-000 (October 3, 2014).

MMU submitted a protest to this filing noting that the existing JOA depends on the specific characteristics of PEC as a standalone company, and the assumptions reflected in the current JOA no longer apply under the DEP joint dispatch agreement.<sup>59</sup> As noted in the 2010 filing, “the terms and conditions of the bilateral agreement among PEC and PJM are grounded in an appreciation of their systems as they exist at the time of the effective date of the JOA, but they fully expect that evolving circumstances, protocols and requirements will require that they negotiate, in good faith, a response to such changes.”<sup>60</sup> The joint dispatch agreement changed the unique operational relationship that existed when the congestion management protocol was established. However, the merged company has not engaged in discussions with PJM as to whether the congestion management protocol that was “tailored to their [PJM and PEC] unique operational relationship” is still appropriate, or whether the congestion management protocol needs to be revised. The existing JOA does not apply to the merged company and should be terminated. The MMU recommends that PJM immediately provide the required 12-month notice to DEP to unilaterally terminate the Joint Operating Agreement.

### PJM and VACAR South Reliability Coordination Agreement<sup>61</sup>

On May 23, 2007, PJM and VACAR South (comprised of Duke Energy Carolinas, LLC (DUK), PEC, South Carolina Public Service Authority (SCPSA), Southeast Power Administration (SEPA), South Carolina Energy and Gas Company (SCE&G) and Yadkin Inc. (a part of Alcoa)) entered into a reliability coordination agreement which provides for system and outage coordination, emergency procedures and the exchange of data. The parties meet on a yearly basis. The agreement remained in effect in the first three months of 2016.

<sup>59</sup> See Protest and Motion for Rehearing of the Independent Market Monitor for PJM in Docket No. ER15-29-000 (October 24, 2014).

<sup>60</sup> Joint Motion for Leave to Answer and Answer of PJM Interconnection, L.L.C. and Progress Energy Carolinas, Inc., Docket No. ER10-713-000 (March 10, 2010) at 2. Section 3.3 of the PJM-Progress JOA.

<sup>61</sup> See “PJM-VACAR South RC Agreement,” <<http://www.pjm.com/~media/documents/agreements/executed-pjm-vacar-rc-agreement.ashx>>. (November 7, 2014).

### Balancing Authority Operations Coordination Agreement between Wisconsin Electric Power Company (WEC) and PJM Interconnection, LLC<sup>62</sup>

The Balancing Authority Operations Coordination Agreement executed on July 20, 2013, provides for the exchange of information between WEC and PJM. The purpose of the data exchange is to allow for the coordination of balancing authority actions to ensure the reliable operation of the systems. The agreement remained in effect in the first three months of 2016.

### Northeastern ISO-Regional Transmission Organization Planning Coordination Protocol<sup>63</sup>

The Northeastern ISO-RTO Planning Coordination Protocol executed on December 8, 2004, provides for the exchange of information among PJM, NYISO and ISO New England. The purpose of the data exchange is to allow for the long-term planning coordination among and between the ISOs and RTOs in the Northeast. The agreement remained in effect in the first three months of 2016.

### Interface Pricing Agreements with Individual Balancing Authorities

PJM consolidated the Southeast and Southwest interface pricing points to a single interface with separate import and export prices (SouthIMP and SouthEXP) on October 31, 2006.

The PJM/DEP JOA allows for the PECIMP and PECEXP interface pricing points to be calculated using the Marginal Cost Proxy Pricing method.<sup>64</sup> The DUKIMP, DUKEXP, NCMPAIMP and NCMPAEXP interface pricing points are calculated based on the high-low pricing method as defined in Section 2.6A (1) of the PJM Tariff.

<sup>62</sup> See “Balancing Authority Operations Coordination Agreement between Wisconsin Electric Power Company and PJM Interconnection, LLC,” <<http://www.pjm.com/~media/documents/agreements/balancing-authority-operations-coordination-agreement.ashx>>. (July 20, 2013).

<sup>63</sup> See “Northeastern ISO/RTO Planning Coordination Protocol,” <<http://www.pjm.com/~media/documents/agreements/northeastern-iso-rt0-planning-coordination-protocol.ashx>>. (December 8, 2004).

<sup>64</sup> See *PJM Interconnection, L.L.C.*, Docket No. ER10-2710-000 (September 17, 2010).

Table 9-34 shows the real-time LMP calculated per the PJM/PEC JOA and the high/low pricing methodology used by Duke and NCMPA for the first three months of 2016. The difference between the LMP under these agreements and PJM's SouthIMP LMP ranged from -\$0.52 with PEC to \$0.52 with NCMPA.<sup>65</sup> This means that under the specific interface pricing agreements, NCMPA receives, on average, \$0.52 more for importing energy into PJM than they would have if they were to receive the SouthIMP pricing point; however, PEC received, on average, \$0.52 less for importing energy into PJM than they would have if they were to receive the SouthIMP pricing point. The difference between the LMP under these agreements and PJM's SouthEXP LMP ranged from \$0.64 with NCMPA to \$1.27 with PEC. This means that under the specific interface pricing agreements, Duke pays, on average, \$1.27 more for exporting energy from PJM than they would have if they were to pay the SouthEXP pricing point.

**Table 9-34 Real-time average hourly LMP comparison for Duke, PEC and NCMPA: January through March, 2016**

	Import LMP	Export LMP	SOUTHIMP	SOUTHEXP	Difference IMP LMP - SOUTHIMP	Difference EXP LMP - SOUTHEXP
Duke	\$23.75	\$24.66	\$23.67	\$23.67	\$0.08	\$0.98
PEC	\$23.15	\$24.95	\$23.67	\$23.67	(\$0.52)	\$1.27
NCMPA	\$24.20	\$24.31	\$23.67	\$23.67	\$0.52	\$0.64

Table 9-35 shows the day-ahead LMP calculated per the PJM/PEC JOA and the high/low pricing methodology used by Duke and NCMPA for the first three months of 2016. The difference between the LMP under these agreements and PJM's SouthIMP LMP ranged from -\$0.80 with PEC to \$0.62 with NCMPA. This means that under the specific interface pricing agreements, NCMPA receives, on average, \$0.62 more for importing energy into PJM than they would have if they were to receive the SouthIMP pricing point; however, PEC received, on average, \$0.80 less for importing energy into PJM than they would have if they were to receive the SouthIMP pricing point. The difference between the LMP under these agreements and PJM's SouthEXP LMP ranged from \$0.68 with NCMPA to \$1.12 with PEC. This means that under the specific interface pricing agreements, PEC pays, on average, \$1.12 more for exporting

<sup>65</sup> The Progress Energy Carolinas (PEC) LMP is defined as the Carolina Power and Light (East) (CPL) pricing point.

energy from PJM than they would have if they were to pay the SouthEXP pricing point.

**Table 9-35 Day-ahead average hourly LMP comparison for Duke, PEC and NCMPA: January through March, 2016**

	Import LMP	Export LMP	SOUTHIMP	SOUTHEXP	Difference IMP LMP - SOUTHIMP	Difference EXP LMP - SOUTHEXP
Duke	\$25.32	\$25.74	\$24.93	\$24.93	\$0.39	\$0.81
PEC	\$24.14	\$26.05	\$24.93	\$24.93	(\$0.80)	\$1.12
NCMPA	\$25.56	\$25.61	\$24.93	\$24.93	\$0.62	\$0.68

It is not clear that agreements between PJM and neighboring external entities, in which those entities receive some of the benefits of the PJM LMP market without either integrating into an LMP market or applying LMP internally, are in the best interest of PJM's market participants. In the case of the DEP JOA for example, the merger between Progress and Duke has resulted in a single, combined entity where one part of that entity is engaged in congestion management with PJM and thereby receiving special pricing from PJM for the dynamic energy schedule, while the other part of the entity is not.

## Other Agreements with Bordering Areas

### Consolidated Edison Company of New York, Inc. (Con Edison) Wheeling Contracts

To help meet the demand for power in New York City, Con Edison uses electricity generated in upstate New York and wheeled through New Jersey on lines controlled by PJM.<sup>66</sup> This wheeled power creates loop flow across the PJM system. The Con Edison contracts governing the New Jersey path evolved during the 1970s and were the subject of a Con Edison complaint to the FERC in 2001.<sup>67</sup>

After years of litigation concerning whether or on what terms Con Edison's protocol would be renewed, PJM filed a settlement on February 23, 2009, on behalf of the parties to resolve remaining issues with these contracts

<sup>66</sup> See the 2016 Quarterly State of the Market Report for PJM: January through March, Section 4 – "Energy Market Uplift" for the operating reserve credits paid to maintain the power flow established in the Con Edison wheeling contracts.

<sup>67</sup> See the 2012 State of the Market Report for PJM, Volume II, Section 8, "Interchange Transactions," for a more detailed discussion.

and their proposed rollover of the agreements under the PJM OATT.<sup>68</sup> By order issued September 16, 2010, the Commission approved this settlement, which extends Con Edison's special protocol indefinitely.<sup>69</sup> The Commission approved transmission service agreements that provide for Con Edison to take firm point-to-point service going forward under the PJM OATT. The Commission rejected objections raised first by NRG and FERC trial staff, and later by the MMU, that this arrangement is discriminatory and inconsistent with the Commission's open access transmission policy.<sup>70</sup> The settlement defined Con Edison's cost responsibility for upgrades included in the PJM Regional Transmission Expansion Plan. Con Edison is responsible for required transmission enhancements, and must pay the associated charges during the term of its service, and any subsequent roll over of the service.<sup>71</sup> Con Edison's rolled over service became effective on May 1, 2012. At that time, Con Edison became responsible for the entire 1,000 MW of transmission service and all associated charges and credits.

## Interchange Transaction Issues

### PJM Transmission Loading Relief Procedures (TLRs)

TLRs are called to control flows on electrical facilities when economic redispatch cannot solve overloads on those facilities. TLRs are called to control flows related to external balancing authorities, as redispatch within an LMP market can generally resolve overloads on internal transmission facilities.

PJM issued eight TLRs of level 3a or higher in the first three months of 2016, compared to 16 such TLRs issued in the first three months of 2015.<sup>72</sup> The number of different flowgates for which PJM declared a TLR 3a or higher decreased from five in the first three months of 2015 to one in the first three months of 2016. The total MWh of transaction curtailments increased by 80.4

percent from 59,219 MWh in the first three months of 2015 to 106,848 MWh in the first three months of 2016.

MISO issued 5 TLRs of level 3a or higher in the first three months of 2016, compared to 19 such TLRs issued in the first three months of 2015. The number of different flowgates for which MISO declared a TLR 3a or higher decreased from eight in the first three months of 2015 to four in the first three months of 2016. The total MWh of transaction curtailments decreased by 37.9 percent from 9,799 MWh in the first three months of 2015 to 6,556 MWh in the first three months of 2016.

NYISO issued zero TLRs of level 3a or higher in the first three months of 2016, compared to four such TLRs issued in the first three months of 2015. The number of different flowgates for which NYISO declared a TLR 3a or higher decreased from one in the first three months of 2015 to zero in the first three months of 2016. The total MWh of transaction curtailments decreased by 100.0 percent from 3,027 MWh in the first three months of 2015 to 0 MWh in the first three months of 2016.

68 See FERC Docket Nos. ER08-858-000, et al. The settling parties are the New York Independent System Operator, Inc. (NYISO), Con Ed, PSE&G, PSE&G Energy Resources & Trading LLC and the New Jersey Board of Public Utilities.

69 132 FERC ¶ 61,221 (2010).

70 See, e.g., Motion to Intervene Out-of-Time and Comments of the Independent Market Monitor for PJM in Docket No. ER08-858-000, et al. (May 11, 2010).

71 The terms of the settlement state that Con Edison shall have no liability for transmission enhancement charges prior to the commencement of, or after the termination of, the term of the rolled over service.

72 TLR Level 3a is the first level of TLR that results in the curtailment of transactions. See the 2015 *State of the Market Report for PJM*, Volume II, Appendix E, "Interchange Transactions," for a more complete discussion of TLR levels.

Table 9-36 PJM MISO, and NYISO TLR procedures: January, 2013 through March, 2016

Month	Number of TLRs Level 3 and Higher			Number of Unique Flowgates That Experienced TLRs			Curtailment Volume (MWh)		
	PJM	MISO	NYISO	PJM	MISO	NYISO	PJM	MISO	NYISO
Jan-13	4	42	2	3	17	1	13,453	103,463	1,045
Feb-13	4	26	0	3	10	0	14,609	66,086	0
Mar-13	0	39	0	0	13	0	0	53,122	0
Apr-13	1	45	0	1	20	0	84	64,938	0
May-13	10	29	0	7	14	0	879	20,778	0
Jun-13	4	25	1	1	11	1	5,036	76,240	4,102
Jul-13	12	28	0	2	9	0	88,623	80,328	0
Aug-13	4	19	0	4	8	0	3,469	38,608	0
Sep-13	6	33	0	5	14	0	7,716	90,188	0
Oct-13	2	42	0	1	20	0	534	72,121	0
Nov-13	2	27	0	2	8	0	11,561	52,508	0
Dec-13	0	16	0	0	5	0	0	20,257	0
Jan-14	3	19	0	3	10	0	1,852	11,683	0
Feb-14	0	29	1	0	10	1	0	33,189	991
Mar-14	0	11	0	0	7	0	0	14,842	0
Apr-14	0	6	0	0	3	0	0	1,233	0
May-14	0	9	0	0	4	0	0	53,153	0
Jun-14	0	19	0	0	7	0	0	24,614	0
Jul-14	1	13	1	1	6	1	317	26,616	0
Aug-14	0	7	0	0	3	0	0	6,319	0
Sep-14	1	11	0	1	4	0	935	87,296	0
Oct-14	1	5	0	1	5	0	1,386	20,581	0
Nov-14	0	10	0	0	6	0	0	23,736	0
Dec-14	2	2	0	2	2	0	1,792	1,264	0
Jan-15	2	8	1	1	4	1	7,293	626	2,261
Feb-15	6	11	2	2	6	1	37,222	9,173	331
Mar-15	8	0	1	3	0	1	14,704	0	435
Apr-15	2	6	0	2	3	0	1,033	23,518	0
May-15	1	8	0	1	2	0	961	12,048	0
Jun-15	1	20	0	1	4	0	205	42,063	0
Jul-15	2	10	0	2	4	0	1,360	9,796	0
Aug-15	0	9	0	0	3	0	0	7,041	0
Sep-15	0	6	0	0	4	0	0	5,789	0
Oct-15	0	4	0	0	4	0	0	4,212	0
Nov-15	0	2	0	0	2	0	0	1,797	0
Dec-15	0	4	0	0	1	0	0	875	0
Jan-16	6	0	0	1	0	0	83,752	0	0
Feb-16	2	0	0	1	0	0	23,096	0	0
Mar-16	0	5	0	0	3	0	0	6,556	0

Table 9-37 Number of TLRs by TLR level by reliability coordinator: January through March, 2016<sup>73</sup>

Year	Reliability Coordinator	3a	3b	4	5a	5b	6	Total
2016	MISO	1	3	0	0	1	0	5
	NYIS	0	0	0	0	0	0	0
	ONT	4	0	0	0	0	0	4
	PJM	3	3	0	1	1	0	8
	SOCO	0	0	0	0	0	0	0
	SWPP	11	8	0	11	4	0	34
	TVA	12	22	0	2	5	0	41
	VACS	1	1	0	0	0	0	2
Total		32	37	0	14	11	0	94

## Up to Congestion

The original purpose of up to congestion transactions (UTC) was to allow market participants to submit a maximum congestion charge, up to \$25 per MWh, they were willing to pay on an import, export or wheel through transaction in the Day-Ahead Energy Market. This product was offered as a tool for market participants to limit their congestion exposure on scheduled transactions in the Real-Time Energy Market.<sup>74</sup>

Following the elimination of the requirement to procure and pay for transmission for up to congestion transactions effective September 17, 2010, the volume of transactions increased significantly.

Up to congestion transactions impact the day-ahead dispatch and unit commitment. Despite that, up to congestion transactions do not pay operating reserves charges. Up to congestion transactions also negatively affect FTR funding.<sup>75</sup>

On August 29, 2014, FERC issued an Order which created an obligation for UTCs to pay any uplift determined to be appropriate in the Commission review, effective September 8, 2014.<sup>76</sup>

<sup>73</sup> Southern Company Services, Inc. (SOCO) is the reliability coordinator covering a portion of Mississippi, Alabama, Florida and Georgia. Southwest Power Pool (SWPP) is the reliability coordinator for SPP. VACAR-South (VACS) is the reliability coordinator covering a portion of North Carolina and South Carolina.

<sup>74</sup> See the 2012 State of the Market Report for PJM, Volume II, Section 8, "Interchange Transactions," for a more detailed discussion.


<sup>75</sup> See the 2016 Quarterly State of the Market Report for PJM: January through March, Section 13: FTRs and ARRs, "FTR Forfeitures" for more information on up-to congestion transaction impacts on FTRs.

<sup>76</sup> 148 FERC ¶ 61,144 (2014) Order Instituting Section 206 Proceeding and Establishing Procedures.

As a result of the requirement to pay uplift charges and the uncertainty about the level of the required uplift charges, market participants reduced up to congestion trading effective September 8, 2014. There was an increase in up to congestion volume starting in December 2015, coincident with the expiration of the fifteen month limit on the payment of prior uplift charges (Figure 9-12). Section 206(b) of the Federal Power Act states that “...the Commission may order refunds of any amounts paid, for the period subsequent to the refund effective date through a date fifteen months after such refund effective date...”<sup>77</sup>

The average number of up to congestion bids submitted in the Day-Ahead Energy Market increased by 117.9 percent, from 61,789 bids per day in the first three months of 2015 to 134,610 bids per day in the first three months of 2016. The average cleared volume of up to congestion bids submitted in the Day-Ahead Energy Market increased by 113.2 percent, from 412,263 MWh per day in the first three months of 2015, to 879,068 MWh per day in the first three months of 2016.

Figure 9-12 Monthly up to congestion cleared bids in MWh: January, 2005 through March, 2016

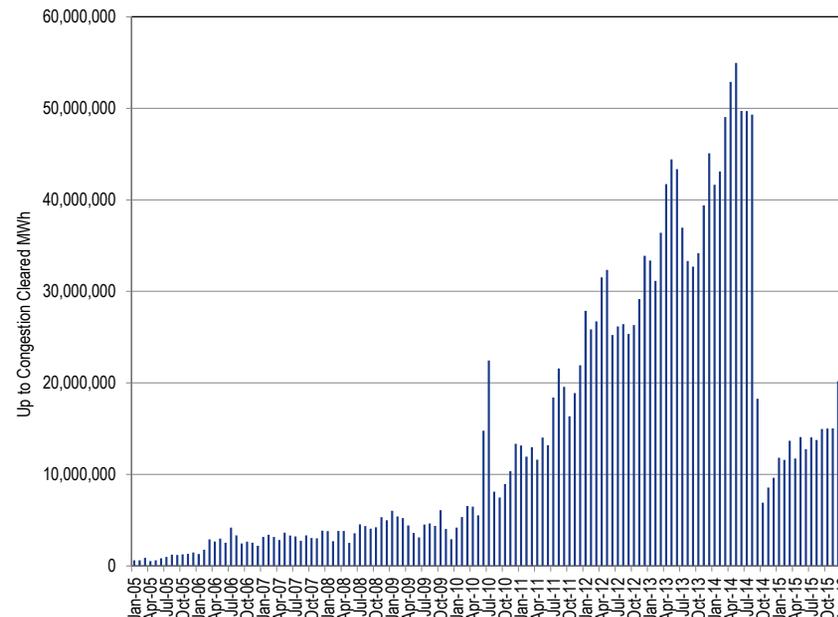

77 16 U.S.C. § 824e.

Table 9-38 Monthly volume of cleared and submitted up to congestion bids: January, 2011 through March, 2016

Month	Bid MW					Bid Volume					Cleared MW					Cleared Volume				
	Import	Export	Wheel	Internal	Total	Import	Export	Wheel	Internal	Total	Import	Export	Wheel	Internal	Total	Import	Export	Wheel	Internal	Total
Jan-11	20,275,932	11,807,379	921,120	-	33,004,431	351,193	210,703	17,632	-	579,528	7,917,986	4,925,310	315,936	-	13,159,232	151,753	91,557	8,417	-	251,727
Feb-11	18,418,511	13,071,483	800,630	-	32,290,624	345,227	226,292	17,634	-	589,153	6,806,039	4,879,207	248,573	-	11,933,818	151,003	99,302	8,851	-	259,156
Mar-11	17,330,353	12,919,960	749,276	-	30,999,589	408,628	274,709	15,714	-	699,051	7,104,642	5,603,583	275,682	-	12,983,906	178,620	124,990	7,760	-	311,370
Apr-11	17,215,352	9,321,117	954,283	-	27,490,752	513,881	265,334	17,459	-	796,674	7,452,366	3,797,819	351,984	-	11,602,168	229,707	113,610	8,118	-	351,435
May-11	21,058,071	11,204,038	2,937,898	-	35,200,007	562,819	304,589	24,834	-	892,242	8,294,422	4,701,077	1,031,519	-	14,027,018	261,355	143,956	11,116	-	416,427
Jun-11	20,455,508	12,125,806	395,833	-	32,977,147	524,072	285,031	12,273	-	821,376	7,632,235	5,361,825	198,482	-	13,192,543	226,747	132,744	6,363	-	365,854
Jul-11	24,273,892	16,837,875	409,863	-	41,521,630	603,519	338,810	13,781	-	956,110	9,585,027	8,617,284	205,599	-	18,407,910	283,287	186,866	7,008	-	477,161
Aug-11	23,790,091	21,014,941	229,895	-	45,034,927	591,170	403,269	8,278	-	1,002,717	10,594,771	10,875,384	103,141	-	21,573,297	274,398	208,593	3,648	-	486,639
Sep-11	21,740,208	18,135,378	232,626	-	40,108,212	526,945	377,158	7,886	-	911,989	10,219,806	9,270,121	82,200	-	19,572,127	270,088	185,585	3,444	-	459,117
Oct-11	20,240,161	19,476,556	333,077	-	40,049,794	540,877	451,507	8,609	-	1,000,993	8,376,208	7,853,947	126,718	-	16,356,873	255,206	198,778	4,236	-	458,220
Nov-11	27,007,141	28,994,789	507,788	-	56,509,718	594,397	603,029	13,379	-	1,210,805	9,064,570	9,692,312	131,670	-	18,888,552	254,851	256,270	5,686	-	516,807
Dec-11	34,990,790	34,648,433	531,616	-	70,170,839	697,524	655,222	14,187	-	1,366,933	11,738,910	10,049,685	137,689	-	21,926,284	281,304	248,008	6,309	-	535,621
Jan-12	38,906,228	36,928,145	620,448	-	76,454,821	745,424	689,174	16,053	-	1,450,651	13,610,725	14,120,791	145,773	-	27,877,288	289,524	304,072	5,078	-	598,674
Feb-12	37,231,115	36,736,507	323,958	-	74,291,580	739,200	724,477	8,572	-	1,472,249	12,883,355	12,905,553	54,724	-	25,843,632	299,055	276,563	2,175	-	577,793
Mar-12	38,824,528	39,163,001	297,895	-	78,285,424	802,983	842,857	8,971	-	1,654,811	13,328,968	13,306,689	89,262	-	26,724,918	320,210	320,252	3,031	-	643,493
Apr-12	42,085,326	44,565,341	436,632	-	87,087,299	884,004	917,430	12,354	-	1,813,788	15,050,798	16,297,303	171,252	-	31,519,354	369,273	355,669	4,655	-	729,597
May-12	44,436,245	43,888,405	489,938	-	88,814,588	994,735	885,319	10,294	-	1,890,348	17,416,386	14,733,838	189,667	-	32,339,891	434,919	343,872	4,114	-	782,905
Jun-12	38,962,548	32,828,393	975,776	-	72,766,718	872,764	684,382	21,781	-	1,578,927	12,675,852	12,311,609	250,242	-	25,237,485	355,731	295,911	6,891	-	658,533
Jul-12	45,565,682	41,589,191	855,676	-	88,010,549	1,077,721	911,300	27,173	-	2,016,194	13,001,225	12,823,361	348,946	-	26,173,532	399,135	321,062	9,958	-	730,155
Aug-12	44,972,628	45,204,886	931,161	-	91,108,675	1,054,472	987,293	31,580	-	2,073,345	12,768,023	13,354,850	300,038	-	26,422,911	377,146	343,717	12,738	-	733,601
Sep-12	40,796,522	39,411,713	957,800	-	81,166,035	1,037,179	949,941	29,246	-	2,016,366	12,089,136	12,961,955	292,095	-	25,343,186	341,925	329,217	9,620	-	680,762
Oct-12	35,567,607	42,489,970	1,415,992	-	79,473,570	908,200	1,048,029	46,802	-	2,003,031	11,969,576	13,949,871	392,286	-	26,311,733	345,788	376,513	14,089	-	736,390
Nov-12	24,795,325	25,498,103	1,258,755	52,022,007	103,574,190	542,992	614,349	43,829	1,631,255	2,832,425	6,517,798	7,872,496	286,535	14,482,701	29,159,529	186,492	245,943	15,042	509,436	956,913
Dec-12	22,597,985	22,560,837	1,727,510	84,548,868	131,435,199	489,208	515,873	55,376	2,767,292	3,827,749	5,116,607	6,350,080	454,289	21,958,089	33,879,065	180,592	224,830	24,459	820,991	1,250,872
Jan-13	16,718,393	21,312,321	2,010,317	76,937,535	116,978,566	422,501	527,037	63,227	2,115,649	3,128,414	4,115,418	5,820,177	522,459	22,906,008	33,364,063	149,282	199,123	23,926	657,602	1,029,933
Feb-13	12,567,004	15,509,978	1,477,275	67,258,116	96,812,373	352,963	400,563	43,133	1,798,434	2,595,093	3,019,380	4,356,113	461,615	23,311,066	31,148,173	110,397	158,085	15,892	669,364	953,738
Mar-13	14,510,721	17,019,755	1,601,487	88,109,152	121,241,114	372,402	402,711	48,112	1,959,294	2,782,519	3,868,303	4,743,283	358,180	27,439,606	36,409,373	131,506	166,295	17,884	774,020	1,089,705
Apr-13	14,538,907	17,419,505	1,337,680	105,927,107	139,223,200	358,245	364,008	47,048	2,275,846	3,045,147	4,413,407	4,834,302	315,867	32,152,243	41,715,459	145,860	157,031	16,315	892,562	1,211,768
May-13	16,565,868	17,640,682	1,640,097	115,572,648	151,419,296	431,892	389,254	54,873	2,660,793	3,536,812	4,556,277	4,747,887	333,677	34,778,962	44,416,803	144,444	144,482	16,317	944,116	1,249,359
Jun-13	16,698,203	18,904,971	1,337,373	128,595,957	165,530,504	452,145	433,010	48,007	3,384,811	4,317,973	3,823,166	4,280,538	312,158	34,935,141	43,351,002	143,223	151,603	17,518	1,116,318	1,428,662
Jul-13	15,436,914	16,428,662	1,473,144	116,673,912	150,102,631	430,120	387,969	49,712	3,075,624	3,943,425	3,250,706	3,502,990	320,374	29,883,430	36,957,500	131,535	127,032	17,948	957,260	1,233,775
Aug-13	12,332,984	14,354,140	1,370,624	89,306,595	117,364,344	328,835	326,637	40,325	2,223,269	2,919,066	2,862,764	3,232,565	309,069	26,900,995	33,305,393	111,715	122,061	16,299	848,490	1,098,565
Sep-13	10,767,257	11,322,974	729,332	75,686,010	98,505,573	264,095	262,486	21,968	1,976,741	2,525,290	2,962,619	3,467,611	221,329	26,044,742	32,696,300	102,984	107,604	10,233	792,766	1,013,587
Oct-13	9,081,257	11,106,943	853,397	86,857,535	107,899,131	280,821	338,374	31,031	2,524,127	3,174,353	2,201,219	3,532,253	186,113	28,243,584	34,163,168	108,189	145,667	11,551	1,002,832	1,268,239
Nov-13	9,219,216	15,052,563	1,307,989	98,027,480	123,607,248	267,704	394,031	39,095	3,167,638	3,868,468	2,640,001	3,986,788	332,814	32,437,908	39,397,511	112,850	154,379	13,958	1,238,589	1,519,776
Dec-13	9,934,234	16,089,101	1,696,981	118,916,149	146,636,465	286,295	404,788	42,367	3,691,770	4,425,220	3,189,261	3,234,196	503,666	38,150,077	45,077,200	119,954	122,683	14,318	1,382,736	1,639,691
Jan-14	10,359,891	16,047,391	2,326,490	119,848,848	148,582,620	350,248	469,176	47,801	4,382,482	5,249,707	2,594,374	3,172,914	460,495	35,413,440	41,641,223	116,316	143,021	15,323	1,537,418	1,812,078
Feb-14	11,351,094	14,846,332	1,854,617	126,008,272	154,060,316	382,148	480,055	47,526	5,151,647	6,061,376	2,764,565	3,247,481	362,670	36,715,916	43,090,631	132,870	147,766	14,045	1,897,337	2,192,014
Mar-14	14,669,735	17,135,117	1,949,978	147,142,336	180,897,166	515,877	516,871	54,575	7,026,221	8,113,544	3,442,624	3,293,865	341,620	41,962,312	49,040,421	165,663	148,671	15,214	2,290,716	2,620,264
Apr-14	12,056,167	15,453,126	1,744,523	132,691,464	161,945,280	408,540	404,498	48,279	5,179,680	6,040,997	3,037,393	3,483,465	347,165	46,018,100	52,886,123	136,314	129,838	12,743	2,036,904	2,315,799
May-14	14,145,892	17,305,057	2,132,591	153,504,853	187,088,393	456,708	452,600	54,954	5,628,483	6,592,205	3,077,932	4,477,545	319,825	47,071,415	54,946,717	136,627	162,321	14,724	1,960,618	2,274,290
Jun-14	13,404,498	13,716,736	1,499,317	141,004,417	169,624,968	407,769	372,275	44,035	5,095,316	5,919,395	3,598,712	3,000,215	349,700	42,767,010	49,715,637	137,256	115,610	16,994	1,732,262	2,002,122
Jul-14	11,820,001	11,811,311	1,278,719	133,179,154	158,089,185	396,433	388,463	38,402	5,021,819	5,845,117	3,541,889	3,118,746	336,003	42,702,334	49,698,971	143,527	131,968	13,699	1,834,684	2,123,878
Aug-14	10,808,911	12,150,513	874,609	135,912,394	159,746,426	375,703	385,705	32,368	5,108,340	5,902,116	3,054,727	3,315,313	140,171	42,796,063	49,306,273	146,179	139,431	11,706	1,937,025	2,234,341
Sep-14	5,105,355	5,291,842	467,670	51,226,017	62,090,885	174,241	156,046	18,095	1,796,453	2,144,835	1,500,083	1,232,520	103,304	15,430,477	18,266,384	73,100	56,651	5,915	735,658	871,324
Oct-14	2,556,049	2,633,382	202,516	17,301,235	22,693,183	91,922	83,113	8,743	775,152	958,930	778,085	527,692	73,370	5,538,329	6,917,477					

Table 9-38 Monthly volume of cleared and submitted up to congestion bids: January, 2011 through March, 2016 (continued)

Month	Bid MW					Bid Volume					Cleared MW					Cleared Volume				
	Import	Export	Wheel	Internal	Total	Import	Export	Wheel	Internal	Total	Import	Export	Wheel	Internal	Total	Import	Export	Wheel	Internal	Total
Sep-15	9,741,094	4,098,270	737,792	63,708,128	78,285,283	349,715	129,051	28,325	3,027,147	3,534,238	1,500,472	932,971	137,868	12,389,538	14,960,850	87,789	34,368	8,008	914,610	1,044,775
Oct-15	8,508,535	5,028,169	708,089	60,656,099	74,900,892	340,586	154,204	31,377	2,997,443	3,523,610	1,396,515	1,046,675	118,879	12,454,398	15,016,467	89,960	42,045	7,036	971,644	1,110,685
Nov-15	7,042,648	4,898,979	854,557	49,740,632	62,536,817	287,080	154,016	32,505	2,454,927	2,928,528	1,378,299	1,011,236	87,438	12,556,360	15,033,334	82,884	38,897	6,684	928,551	1,057,016
Dec-15	7,718,227	5,068,244	700,702	60,230,661	73,717,834	348,160	181,451	36,546	3,035,860	3,602,017	1,612,284	1,453,772	117,749	16,996,215	20,180,020	112,519	55,720	8,200	1,261,471	1,437,910
Jan-16	11,319,511	7,453,438	1,014,763	80,909,489	100,697,200	477,343	219,598	39,513	3,737,937	4,474,391	2,944,505	2,026,327	274,430	24,103,637	29,348,899	170,082	69,173	10,390	1,577,269	1,826,914
Feb-16	12,155,175	7,740,113	1,363,163	85,132,591	106,391,042	422,382	228,823	42,609	3,306,154	3,999,968	2,719,184	2,001,418	244,646	22,049,244	27,014,492	126,889	67,289	9,850	1,251,383	1,455,411
Mar-16	11,714,639	7,934,801	1,415,976	88,260,658	109,326,075	382,177	225,473	36,332	3,131,152	3,775,134	2,370,270	2,001,360	198,400	19,061,805	23,631,834	105,098	65,977	8,070	1,085,479	1,264,624
TOTAL	1,254,282,812	1,198,412,301	75,683,229	3,341,169,090	5,869,547,432	31,568,722	27,092,122	1,962,466	118,920,569	179,543,879	428,283,597	410,418,203	26,209,521	967,814,515	1,832,725,836	12,216,938	10,491,226	703,484	42,255,244	65,666,892

In the first three months of 2016, the cleared MW volume of up to congestion transactions was comprised of 10.0 percent imports, 7.5 percent exports, 0.9 percent wheeling transactions and 81.5 percent internal transactions. Less than 0.1 percent of the up to congestion transactions had matching real-time energy market transactions.

### Up to Congestion Credit Risk

On August 29, 2014, FERC issued an Order which created an obligation for up to congestion transactions (UTCs) to pay any uplift determined to be appropriate after Commission review, effective from September 8, 2014.<sup>78</sup> As of March 31, 2016, the Commission had not ruled on whether up to congestion transactions will be charged for uplift accrued during this time. During the 15 month refund period of September 8, 2014, through December 7, 2015, 185,303,891 MWh of up to congestion transactions cleared the Day-Ahead Market and are subject to potential uplift charges for that period. Based on the volume of cleared up to congestion transactions and the potential uplift obligation on a per MWh basis, the obligation to pay is estimated to be between \$18.5 million and \$370.6 million. As potential obligations, this exposure creates a credit risk for those UTC traders who engaged in UTC transactions during this period. Table 9-39 shows the levels of credit risk associated with the cleared up to congestion transactions, depending on the uplift charge that may be imposed on these transactions.

Table 9-39 Credit risk associated with varying levels of potential uplift: September 8, 2014 through December 7, 2015

Uplift (\$/MWh)	Credit risk if uplift is applied to both sides of UTC
\$0.05	\$18,530,389
\$0.10	\$37,060,778
\$0.15	\$55,591,167
\$0.20	\$74,121,556
\$0.25	\$92,651,945
\$0.30	\$111,182,334
\$0.35	\$129,712,724
\$0.40	\$148,243,113
\$0.45	\$166,773,502
\$0.50	\$185,303,891
\$0.55	\$203,834,280
\$0.60	\$222,364,669
\$0.65	\$240,895,058
\$0.70	\$259,425,447
\$0.75	\$277,955,836
\$0.80	\$296,486,225
\$0.85	\$315,016,614
\$0.90	\$333,547,003
\$0.95	\$352,077,393
\$1.00	\$370,607,782

PJM market participants that cleared UTCs during the specified refund period of September 8, 2014 through December 7, 2015, would be responsible to pay uplift based on their cleared up to congestion volume and the uplift charge if FERC orders that UTCs pay such uplift charges. Analysis of the cleared up to congestion transactions during the refund period of September 8, 2014, through December 7, 2015, showed that the top 10 market participants would be responsible for 53.7 percent of the uplift.

78 148 FERC ¶ 61,144 (2014) Order Instituting Section 206 Proceeding and Establishing Procedures.

The credit risk exposure to companies that traded UTCs during this period is substantial, including the possible bankruptcy of one or more companies if FERC orders that UTCs pay such uplift charges. The actual risk depends in significant part on how the companies have managed their potential exposure as they continued to trade UTCs with knowledge of the risks. These companies do not appear to have informed PJM of how or if they have managed this exposure.

The total uplift amount has already been paid by other PJM members. Thus, the risk to other PJM members has been realized. The risk that UTC traders will not be able to cover their credit exposure otherwise related to their trading activity is addressed by existing PJM credit policies. If a UTC trader went into bankruptcy as a result of the uplift risk, the exposure to other PJM members is that they will not be repaid the level of uplift that should have been paid by UTC transactions.

Absent further Commission action, the increase in UTC uplift payment risk appears to have ended as a result of the expiration of the fifteen month limit on the payment of prior uplift charges.<sup>79</sup>

Attachment Q: PJM Credit Policy of the PJM Open Access Transmission Tariff provides that:

Each Participant is also required to provide with its application information any known Material litigation, commitments or contingencies as well as any prior bankruptcy declarations or Material defalcations by the Participant or its predecessors, subsidiaries or Affiliates, if any. These disclosures shall be made upon application, upon initiation or change, and at least annually thereafter, or as requested by PJMSettlement.<sup>80</sup>

The MMU recommends that PJMSettlement Inc. immediately request a credit evaluation from all companies that engaged in up to congestion transactions during the refund period of September 8, 2014, through December 7, 2015. If PJM has the authority, PJM should ensure that the potential exposure to uplift

<sup>79</sup> 16 U.S.C. § 824e.

<sup>80</sup> See OATT Attachment Q § I.A.4.

for that period be included as a contingency in the companies' calculations for credit levels and/or collateral requirements. PJM should also calculate the UTC uplift charge contingency in a manner appropriate for the evaluation of any contingency. By definition, assessing a contingency requires a reasonable exercise of discretion. PJM should develop a reasonable assessment of the risk associated with the UTC uplift allocation and the appropriate approach to managing this risk. Zero risk is not within a reasonable range. The MMU recognizes that the exact amount of the exposure is not known. If PJM does not have the authority to take such steps, PJM should request guidance from FERC.

### Sham Scheduling

Sham scheduling refers to a scheduling method under which a market participant breaks a single transaction, from generation balancing authority (source) to load balancing authority (sink), into multiple segments. Sham scheduling hides the actual source of generation from the load balancing authority. When unable to identify the source of the energy, the load balancing authority lacks a complete picture of how the power will flow to the load which can create loop flows and result in inaccurate pricing for transactions.

For example, if the generation balancing authority (source) is NYISO, and the load balancing authority (sink) is PJM, the transaction would be priced, in the PJM energy market, at the PJM/NYIS Interface regardless of the submitted market path. However, if a market participant were to break the transaction into multiple segments, one on the NYIS-ONT market path, and a second segment on the ONT-MISO-PJM market path, the market participant would conceal the true source (NYISO) from PJM, and PJM would price the transaction as if its source is Ontario (the ONT Interface price).

The MMU recommends that PJM implement rules to prevent sham scheduling. The MMU's proposed validation rules that would prohibit breaking transactions into smaller segments to defeat the interface pricing rule and that would require market participants to submit transactions on market paths that reflect the expected actual power flow, would address sham scheduling.

## Elimination of Ontario Interface Pricing Point

The PJM/IMO interface pricing point (Ontario) was created to reflect the fact that transactions that originate or sink in the IESO balancing authority create actual energy flows that are split between the MISO and NYISO interface pricing points. PJM created the PJM/IMO interface pricing point to reflect the actual power flows across both the MISO/PJM and NYISO/PJM interfaces. The IMO does not have physical ties with PJM because it is not contiguous.

Prior to June 1, 2015, the PJM/IMO interface pricing point was defined as the LMP at the IESO Bruce bus. The LMP at the Bruce bus includes a congestion and loss component across the MISO and NYISO balancing authorities.

The non-contiguous nature of the PJM/IMO interface pricing point creates opportunities for market participants to engage in sham scheduling activities. For example, a market participant can use two separate transactions to create a flow from Ontario to MISO. In this example, the market participant uses the PJM energy market as a temporary generation and load point by first submitting a wheeling transaction from Ontario, through MISO and into PJM, then by submitting a second transaction from PJM to MISO. These two transactions, combined, create an actual flow along the Ontario/MISO Interface. Through sham scheduling, the market participant receives settlements from PJM when no changes in generation occur. This activity is similar to that observed when PJM had a Southwest and Southeast interface pricing point. During that time, market participants would use the PJM spot market as a temporary load and generation point to wheel transactions through the PJM energy market. This was done to take advantage of the price differences between the interfaces without providing the market benefits of congestion relief.

A new PJM/IMO interface price method was implemented on June 1, 2015. The new method uses a dynamic weighting of the PJM/MISO interface price and the PJM/NYIS interface price, based on the performance of the Michigan-Ontario PARs. When the absolute value of the actual flows on the PARs are greater than or equal to the absolute value of the scheduled flows on the PARs, and the scheduled and actual flows are in the same direction, the PJM/IMO interface price will be equal to the PJM/MISO interface price (i.e. 100

percent weighting on the PJM/MISO interface). When actual flows on the PARs are in the opposite direction of the scheduled flows on the PARs, the PJM/IMO interface price will be equal to the PJM/NYIS interface price (i.e. 100 percent weighting on the PJM/NYIS interface). When the absolute value of the actual flows on the PARs are less than or equal to the absolute value of the scheduled flows on the PARs, and the scheduled and actual flows are in the same direction, the PJM/IMO interface price will be a combination to the PJM/MISO interface price and the PJM/NYIS interface price. In this case the weightings of the PJM/MISO and PJM/NYIS interface prices are determined based on the scheduled and actual flows. For example, in a given interval, the scheduled flow on the Michigan-Ontario PARs is 1,000 MW, and the actual flow is 800 MW. If in that same interval, the PJM/MISO interface price is \$45.00 and the PJM/NYIS interface price \$30.00, the PJM/IMO interface price would be calculated with a weighting of 80 percent of the PJM/MISO interface price ( $\$45.00 * 0.8$ , or  $\$36.00$ ) and 20 percent of the PJM/NYIS interface price ( $\$30.00 * 0.2$ , or  $\$6.00$ ), for a PJM/IMO interface price of  $\$42.00$ .<sup>81</sup>

The MMU believes that the new PJM/IMO interface price method is a step in the right direction towards pricing energy that sources or sinks in Ontario based on the path of the actual, physical transfer of energy. The MMU remains concerned about the assumption of PAR operations, and will continue to evaluate the impact of PARs on the scheduled and actual flows and the impacts on the PJM/IMO interface price. The MMU remains concerned about the potential for market participants to continue to engage in sham scheduling activities after the new method is implemented.

The MMU recommends that if the PJM/IMO interface price remains and with PJM's new method in place, that PJM implement additional business rules to remove the incentive to engage in sham scheduling activities using the PJM/IMO interface price. Such rules would prohibit the same market participant from scheduling an export transaction from PJM to any balancing authority while at the same time an import transaction is scheduled to PJM that receives the PJM/IMO interface price. PJM should also prohibit the same market participant from scheduling an import transaction to PJM from any balancing

<sup>81</sup> See "IMO Interface Definition Methodology Report," presented to the MIC <<http://www.pjm.com/~media/committees-groups/committees/mic/20150211/20150211-item-08b-imo-interface-definition-methodology-report.ashx>>. [February 11, 2015].

authority while at the same time an export transaction is scheduled from PJM that receives the PJM/IMO interface price.

In the first three months of 2016, of the 1,339 GWh of the net scheduled transactions between PJM and IESO, 1,338 GWh wheeled through MISO (see Table 9-22). The MMU recommends that PJM eliminate the PJM/IMO interface pricing point, and assign the transactions that originate or sink in the IESO balancing authority to the PJM/MISO interface pricing point.<sup>82</sup>

### PJM and NYISO Coordinated Interchange Transactions

Coordinated transaction scheduling (CTS) provides the option for market participants to submit intra-hour transactions between the NYISO and PJM that include an interface spread bid on which transactions are evaluated.<sup>83</sup> The evaluation is based on the forward-looking prices as determined by PJM's intermediate term security constrained economic dispatch tool (ITSCED) and the NYISO's real-time commitment (RTC) tool. PJM shares its PJM/NYISO interface price ITSCED results with the NYISO. The NYISO compares the PJM/NYISO interface price with its RTC calculated NYISO/PJM interface price. If the PJM and NYISO interface price spread is greater than the market participant's CTS bid, the transaction is approved. If the PJM and NYISO interface price spread is less than the CTS bid, the transaction is denied.

The ITSCED application runs approximately every five minutes and each run produces forecast LMPs for the intervals approximately 30 minutes, 45 minutes, 90 minutes and 135 minutes ahead. Therefore, for each 15 minute interval, the various ITSCED solutions will produce 12 forecasted PJM/NYIS interface prices. To evaluate the accuracy of ITSCED forecasts, the forecasted PJM/NYIS interface price for each 15 minute interval from ITSCED was compared to the actual real-time interface LMP for the first three months of 2016. Table 9-40 shows that over all 12 forecast ranges, ITSCED predicted the real-time PJM/NYIS interface LMP within the range of \$0.00 to \$5.00 in 42.7 percent of the intervals. In those intervals, the average price difference between the ITSCED forecasted LMP and the actual real-time LMP was \$1.63

<sup>82</sup> On October 1, 2013, a sub-group of PJM's Market Implementation Committee started stakeholder discussions to address this inconsistency in market pricing.

<sup>83</sup> PJM and the NYISO implemented CTS on November 4, 2014. 146 FERC ¶ 61,096 (2014).

per MWh. In 4.7 percent of all intervals, the absolute value of the average price difference between the ITSCED forecasted LMP and the actual real-time interface LMP was greater than \$20.00. The average price differences were \$55.05 when the price difference was greater than \$20.00, and \$58.95 when the price difference was greater than -\$20.00.

**Table 9-40 Differences between forecast and actual PJM/NYIS interface prices: January through March, 2016**

Range of Price Differences	Percent of All Intervals	Average Price Difference
> \$20	1.8%	\$55.05
\$10 to \$20	2.6%	\$13.82
\$5 to \$10	5.6%	\$6.92
\$0 to \$5	42.7%	\$1.63
\$0 to -\$5	36.9%	\$1.60
-\$5 to -\$10	4.9%	\$6.88
-\$10 to -\$20	2.7%	\$14.05
< -\$20	2.9%	\$58.95

Table 9-41 shows how the accuracy of the ITSCED forecasted LMPs changes as the cases approach real-time. In the final ITSCED results prior to real time, in 80.1 percent of all intervals, the average price difference between the ITSCED forecasted LMP and the actual real-time interface LMP fell within +/- \$5.00 of the actual PJM/NYIS interface real-time LMP, compared to 78.0 percent in the 135 minute ahead ITSCED results.

**Table 9-41 Differences between forecast and actual PJM/NYIS interface prices: January through March, 2016**

Range of Price Differences	~ 135 Minutes Prior to Real-Time		~ 90 Minutes Prior to Real-Time		~ 45 Minutes Prior to Real-Time		~ 30 Minutes Prior to Real-Time	
	Percent of Intervals	Average Price Difference	Percent of Intervals	Average Price Difference	Percent of Intervals	Average Price Difference	Percent of Intervals	Average Price Difference
> \$20	1.6%	\$51.11	1.3%	\$52.43	1.6%	\$54.25	2.5%	\$60.34
\$10 to \$20	3.0%	\$13.78	1.7%	\$13.94	2.1%	\$13.71	2.9%	\$13.93
\$5 to \$10	6.4%	\$6.88	4.9%	\$6.94	4.6%	\$6.90	5.2%	\$6.84
\$0 to \$5	43.7%	\$1.80	39.3%	\$1.62	43.8%	\$1.52	44.5%	\$1.50
\$0 to -\$5	34.3%	\$1.74	40.9%	\$1.67	38.2%	\$1.52	35.6%	\$1.42
-\$5 to -\$10	4.9%	\$6.81	5.7%	\$6.91	4.3%	\$6.85	4.7%	\$7.02
-\$10 to -\$20	2.9%	\$13.98	2.9%	\$13.85	2.8%	\$14.26	2.2%	\$13.94
< -\$20	3.1%	\$59.49	3.1%	\$56.06	2.8%	\$57.01	2.4%	\$63.76

In 4.9 percent of the intervals in the thirty-minute ahead forecast, the absolute value of the average price difference between the ITSCED forecasted LMP and the actual real-time interface LMP was greater than \$20.00, the average price difference was \$60.34 when the price difference was greater than \$20.00, and \$63.76 when the price difference was greater than -\$20.00.

Table 9-42 and Table 9-43 show the monthly differences between forecasted and actual PJM/NYIS interface prices. Analysis of the data on a monthly basis shows that there is a decline in the accuracy of the ITSCED forecast ability during periods of cold weather. For example, Table 9-42 shows that in January, 2016, the absolute value of the average price difference between the ITSCED forecasted LMP and the actual real-time interface LMP in the thirty-minute ahead forecast, was greater than \$20.00 in 3.8 percent of the intervals, compared to 1.5 percent of the intervals in March, 2016.

**Table 9-42 Monthly Differences between forecast and actual PJM/NYIS interface prices (percent of intervals): January through March, 2016**

Interval	Range of Price Differences				
	Jan	Feb	Mar	YTD Avg	
~ 30 Minutes Prior to Real-Time	> \$20	3.8%	2.1%	1.5%	2.5%
	\$10 to \$20	4.7%	2.2%	1.9%	2.9%
	\$5 to \$10	5.7%	3.4%	6.4%	5.2%
	\$0 to \$5	42.2%	43.8%	47.5%	44.5%
	\$0 to -\$5	32.9%	38.9%	35.2%	35.6%
	-\$5 to -\$10	5.0%	5.1%	4.0%	4.7%
	-\$10 to -\$20	2.7%	2.5%	1.4%	2.2%
	< -\$20	3.0%	2.1%	2.1%	2.4%
~ 45 Minutes Prior to Real-Time	> \$20	2.8%	1.3%	0.7%	1.6%
	\$10 to \$20	3.4%	1.8%	1.1%	2.1%
	\$5 to \$10	5.3%	3.4%	4.9%	4.6%
	\$0 to \$5	40.2%	41.9%	49.0%	43.8%
	\$0 to -\$5	36.2%	41.7%	36.9%	38.2%
	-\$5 to -\$10	4.6%	4.6%	3.6%	4.3%
	-\$10 to -\$20	3.9%	2.7%	1.8%	2.8%
	< -\$20	3.6%	2.7%	2.0%	2.8%
~ 90 Minutes Prior to Real-Time	> \$20	2.5%	1.1%	0.4%	1.3%
	\$10 to \$20	3.1%	1.2%	0.8%	1.7%
	\$5 to \$10	4.8%	3.7%	6.2%	4.9%
	\$0 to \$5	35.6%	38.0%	44.3%	39.3%
	\$0 to -\$5	39.0%	44.4%	39.6%	40.9%
	-\$5 to -\$10	6.8%	5.8%	4.6%	5.7%
	-\$10 to -\$20	4.2%	2.9%	1.7%	2.9%
	< -\$20	4.0%	3.0%	2.3%	3.1%
~ 135 Minutes Prior to Real-Time	> \$20	2.6%	1.4%	0.9%	1.6%
	\$10 to \$20	4.5%	2.7%	1.9%	3.0%
	\$5 to \$10	6.4%	5.0%	7.8%	6.4%
	\$0 to \$5	39.1%	41.4%	50.4%	43.7%
	\$0 to -\$5	32.8%	39.1%	31.4%	34.3%
	-\$5 to -\$10	6.3%	4.6%	3.7%	4.9%
	-\$10 to -\$20	4.4%	2.8%	1.6%	2.9%
	< -\$20	4.0%	3.1%	2.3%	3.1%

**Table 9-43 Monthly differences between forecast and actual PJM/NYIS interface prices (average price difference): January through March, 2016**

Interval	Range of Price Differences				
	Jan	Feb	Mar	YTD Avg	
~ 30 Minutes Prior to Real-Time	> \$20	\$68.70	\$44.33	\$60.00	\$60.34
	\$10 to \$20	\$14.17	\$13.44	\$13.88	\$13.93
	\$5 to \$10	\$7.03	\$6.73	\$6.72	\$6.84
	\$0 to \$5	\$1.39	\$1.40	\$1.68	\$1.50
	\$0 to -\$5	\$1.35	\$1.43	\$1.48	\$1.42
	-\$5 to -\$10	\$7.28	\$6.84	\$6.90	\$7.02
	-\$10 to -\$20	\$14.09	\$13.89	\$13.76	\$13.94
	< -\$20	\$57.70	\$53.28	\$82.66	\$63.76
~ 45 Minutes Prior to Real-Time	> \$20	\$60.63	\$40.00	\$53.12	\$54.25
	\$10 to \$20	\$14.09	\$13.48	\$12.87	\$13.71
	\$5 to \$10	\$7.01	\$6.95	\$6.74	\$6.90
	\$0 to \$5	\$1.49	\$1.44	\$1.61	\$1.52
	\$0 to -\$5	\$1.50	\$1.47	\$1.59	\$1.52
	-\$5 to -\$10	\$7.00	\$6.81	\$6.70	\$6.85
	-\$10 to -\$20	\$14.19	\$14.74	\$13.74	\$14.26
	< -\$20	\$59.29	\$55.49	\$54.85	\$57.01
~ 90 Minutes Prior to Real-Time	> \$20	\$53.97	\$47.24	\$55.93	\$52.43
	\$10 to \$20	\$13.91	\$14.36	\$13.48	\$13.94
	\$5 to \$10	\$7.06	\$7.06	\$6.79	\$6.94
	\$0 to \$5	\$1.60	\$1.54	\$1.70	\$1.62
	\$0 to -\$5	\$1.67	\$1.67	\$1.68	\$1.67
	-\$5 to -\$10	\$7.10	\$6.80	\$6.77	\$6.91
	-\$10 to -\$20	\$13.86	\$14.05	\$13.49	\$13.85
	< -\$20	\$57.60	\$57.18	\$51.97	\$56.06
~ 135 Minutes Prior to Real-Time	> \$20	\$52.85	\$48.09	\$50.44	\$51.11
	\$10 to \$20	\$14.00	\$14.07	\$12.88	\$13.78
	\$5 to \$10	\$6.85	\$7.19	\$6.72	\$6.88
	\$0 to \$5	\$1.72	\$1.70	\$1.93	\$1.80
	\$0 to -\$5	\$1.81	\$1.74	\$1.66	\$1.74
	-\$5 to -\$10	\$6.88	\$6.80	\$6.69	\$6.81
	-\$10 to -\$20	\$13.97	\$14.03	\$13.91	\$13.98
	< -\$20	\$60.01	\$65.73	\$50.65	\$59.49


The NYISO uses PJM's ITSCED forecasted LMPs to compare against the NYISO Real-Time Commitment (RTC) results in its evaluation of CTS transactions. The NYISO approves CTS (spread bid) transactions when the offered spread is less than or equal to the spread between the ITSCED forecast PJM/NYIS interface LMP and the NYISO RTC forecast NYIS/PJM interface LMP. The large differences between forecast and actual LMPs in the intervals closest to real-time could cause CTS transactions to be approved that would contribute to transactions being scheduled counter to real-time economic signals, and contribute to inefficient scheduling across the PJM/NYIS border.

CTS transactions are evaluated based on the spread bid, which limits the amount of price convergence that can occur. As long as balancing operating reserve charges are applied and CTS transactions are optional, the CTS proposal represents a small incremental step toward better interface pricing. The 75 minute time lag associated with scheduling energy transactions in the NYISO should be shortened. Reducing this time lag could significantly improve pricing efficiency at the PJM/NYISO border for non-CTS transactions and for CTS transactions.

CTS transactions were evaluated for each 15 minute interval. From November 4, 2014, through March 31, 2016, 32,986 15 minute CTS schedules were approved through the CTS process based on the forecast LMPs. When the forecast LMPs for the approved intervals were compared to the hourly integrated real-time LMPs, the direction of the flow in 10,024 (30.4 percent) of the intervals was inconsistent with the differences in real-time PJM/NYISO and NYISO/PJM prices. For example, if a market participant submits a CTS transaction from NYISO to PJM with a spread bid of \$5.00, and NYISO's forecasted PJM interface price was at least \$5.00 lower than PJM's forecasted NYISO interface price, the transaction would be approved. For 30.4 percent of the approved transactions, the actual, real-time price differentials were in the opposite direction of the forecast differential. The actual, real-time price differentials meant that the transactions would have been economic in the opposite direction. For 69.6 percent of the intervals, the forecast price differentials were consistent with real-time PJM/NYISO and NYISO/PJM price differences. Figure 9-13 shows the monthly volume of cleared PJM/NYIS CTS

bids. Figure 9-13 also shows the percent of cleared bids that resulted in flows consistent and inconsistent with price differences.

**Figure 9-13 Monthly cleared PJM/NYIS CTS bid volume: November, 2014 through March, 2016**

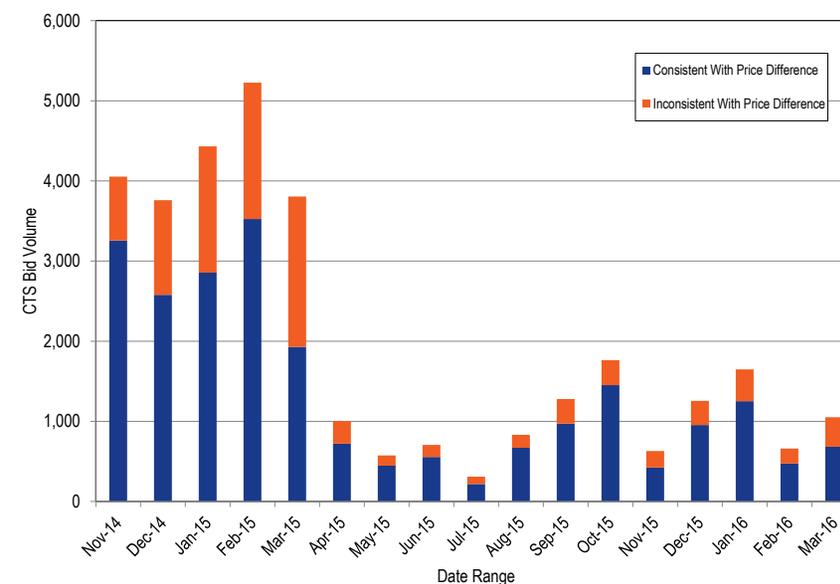

The data reviewed show that ITSCED is not a highly accurate predictor of the real-time PJM/NYIS interface prices. If this remains true, it will limit the effectiveness of CTS in improving interface pricing between PJM and NYISO.

### Reserving Ramp on the PJM/NYISO Interface

Prior to the implementation of CTS, PJM held ramp space for all transactions submitted between PJM and the NYISO as soon as the NERC Tag was approved. At that time, once transactions were evaluated by the NYISO through their real-time market clearing process, any adjustments made to the submitted transactions would be reflected on the NERC Tags and the PJM ramp was adjusted accordingly.

As part of this process, PJM was often required to make adjustments to transactions on its other interfaces in order to bring total system ramp back to within its limit. The default ramp limit in PJM is +/- 1,000 MW. For example, the ramp in a given interval is currently -1,000 MW, consisting of 2,000 MW of imports from the NYISO to PJM and 3,000 MW of exports from PJM on its other interfaces. If, through the NYISO real-time market clearing process, the NYISO only approves 1,000 MW of the imports, the other 1,000 MW of import transactions from the NYISO would be curtailed. The ramp in this interval would then be -2,000 MW, consisting of the 1,000 MW of cleared imports from the NYISO to PJM and 3,000 MW of exports from PJM on its other interfaces. PJM would then be required to curtail an additional 1,000 MW of exports at its other interface to bring the limit back to within +/- 1,000. These curtailments were made on a last in first out basis as determined by the timestamp on the NERC Tag.

With the implementation of the CTS product with the NYISO, PJM modified how ramp is handled at the PJM/NYISO Interface. Effective November 4, 2014, PJM no longer holds ramp room for any transactions submitted between PJM and the NYISO at the time of submission. Only after the NYISO completes its real-time market clearing process, and communicates the results to PJM, does PJM perform a ramp evaluation on transactions scheduled with the NYISO. If, in the event the NYISO market clearing process would violate ramp, PJM would make additional adjustments based on a last-in first-out basis as determined by the timestamp on the NERC Tag. This process prevents the transactions scheduled at the PJM/NYISO interface from holding (or creating) ramp until NYISO has completed its economic evaluation and the transactions are approved through the NYISO market clearing process.

## PJM and MISO Coordinated Interchange Transaction Proposal

PJM and MISO have proposed the implementation of coordinated interchange transactions, similar to the PJM/NYISO approach, through the Joint and Common Market Initiative. While the mechanics of transaction evaluation have yet to be determined, the coordinated transaction scheduling (CTS)

proposal would provide the option for market participants to submit intra-hour transactions between the MISO and PJM that include an interface spread bid on which transactions are evaluated. Similar to the PJM/NYISO approach, the evaluation would be based, in part, on the forward-looking prices as determined by PJM's intermediate term security constrained economic dispatch tool (ITSCED). Unlike the PJM/NYISO CTS process in which the NYISO performs the evaluation, the PJM/MISO CTS process will use a joint clearing process in which both RTOs will share forward looking prices. MISO does not currently have an application comparable to PJM's ITSCED to provide forward-looking prices but is developing a tool.

To evaluate the accuracy of ITSCED forecasts, the forecasted PJM/MISO interface price for each 15 minute interval from ITSCED was compared to the actual real-time interface LMP for the first three months of 2016. Table 9-44 shows that over all 12 forecast ranges, ITSCED predicted the real-time PJM/MISO interface LMP within the range of \$0.00 to \$5.00 in 48.0 percent of all intervals. In those intervals, the average price difference between the ITSCED forecasted LMP and the actual real-time LMP was \$1.62. In 2.5 percent of all intervals, the absolute value of the average price difference between the ITSCED forecasted LMP and the actual real-time interface LMP was greater than \$20.00. The average price differences were \$48.47 when the price difference was greater than \$20.00, and \$61.54 when the price difference was greater than -\$20.00.

**Table 9-44 Differences between forecast and actual PJM/MISO interface prices: January through March, 2016**

Range of Price Differences	Percent of All Intervals	Average Price Difference
> \$20	0.7%	\$48.47
\$10 to \$20	2.1%	\$13.56
\$5 to \$10	6.0%	\$6.85
\$0 to \$5	48.0%	\$1.62
\$0 to -\$5	35.5%	\$1.48
-\$5 to -\$10	4.2%	\$6.88
-\$10 to -\$20	1.7%	\$13.93
< -\$20	1.8%	\$61.54

Table 9-45 shows how the accuracy of the ITSCED forecasted LMPs change as the cases approach real-time. In the final ITSCED results prior to real time, in 84.0 percent of all intervals, the average price difference between the ITSCED forecasted LMP and the actual real-time interface LMP fell within +/- \$5.00 of the actual PJM/MISO interface real-time LMP, compared to 81.0 percent in the 135 minute ahead ITSCED results.

**Table 9-45 Differences between forecast and actual PJM/MISO interface prices: January through March, 2016**

Range of Price Differences	~ 135 Minutes Prior to Real-Time		~ 90 Minutes Prior to Real-Time		~ 45 Minutes Prior to Real-Time		~ 30 Minutes Prior to Real-Time	
	Percent of Intervals	Average Price Difference	Percent of Intervals	Average Price Difference	Percent of Intervals	Average Price Difference	Percent of Intervals	Average Price Difference
> \$20	0.9%	\$26.49	0.3%	\$32.29	0.2%	\$72.89	1.1%	\$65.21
\$10 to \$20	3.1%	\$13.49	1.3%	\$13.27	1.4%	\$13.12	2.4%	\$14.05
\$5 to \$10	8.1%	\$6.89	4.8%	\$6.58	4.6%	\$6.74	5.7%	\$6.91
\$0 to \$5	50.0%	\$1.81	46.3%	\$1.58	49.6%	\$1.51	49.7%	\$1.54
\$0 to -\$5	31.0%	\$1.56	39.1%	\$1.49	36.3%	\$1.38	34.3%	\$1.42
-\$5 to -\$10	3.7%	\$6.77	4.4%	\$6.89	4.1%	\$6.98	3.6%	\$6.92
-\$10 to -\$20	1.4%	\$13.94	2.0%	\$14.18	1.9%	\$13.90	1.6%	\$13.83
< -\$20	1.9%	\$58.75	1.9%	\$61.75	1.8%	\$63.15	1.6%	\$63.35

In 2.7 percent of the intervals in the thirty-minute ahead forecast, the absolute value of the average price difference between the ITSCED forecasted LMP and the actual real-time interface LMP was greater than \$20.00, the average price differences were \$65.21 when the price difference was greater than \$20.00, and \$63.35 when the price difference was greater than -\$20.00.

Table 9-46 and Table 9-47 show the monthly differences between forecasted and actual PJM/MISO interface prices. Analysis of the data on a monthly basis shows that there is a decline in the accuracy of the ITSCED forecast ability during periods of cold weather. For example, Table 9-46 shows that in January, 2016, the absolute value of the average price difference between the ITSCED forecasted LMP and the actual real-time interface LMP in the thirty-minute ahead forecast, was greater than \$20.00 in 3.4 percent of the intervals, compared to 2.3 percent of the intervals in March, 2016.

**Table 9-46 Monthly Differences between forecast and actual PJM/MISO interface prices (percent of intervals): January through March, 2016**

Interval	Range of Price Differences				
	Jan	Feb	Mar	YTD Avg	
~ 30 Minutes Prior to Real-Time	> \$20	1.3%	1.0%	0.8%	1.1%
	\$10 to \$20	3.8%	1.5%	1.9%	2.4%
	\$5 to \$10	5.9%	5.1%	6.2%	5.7%
	\$0 to \$5	49.5%	49.5%	50.1%	49.7%
	\$0 to -\$5	32.5%	37.2%	33.3%	34.3%
	-\$5 to -\$10	3.1%	3.2%	4.6%	3.6%
	-\$10 to -\$20	1.8%	1.3%	1.6%	1.6%
	< -\$20	2.1%	1.3%	1.5%	1.6%
~ 45 Minutes Prior to Real-Time	> \$20	0.4%	0.2%	0.0%	0.2%
	\$10 to \$20	2.1%	0.9%	1.2%	1.4%
	\$5 to \$10	5.0%	3.4%	5.4%	4.6%
	\$0 to \$5	48.8%	49.6%	50.5%	49.6%
	\$0 to -\$5	35.4%	39.3%	34.5%	36.3%
	-\$5 to -\$10	3.4%	3.6%	5.3%	4.1%
	-\$10 to -\$20	2.4%	1.5%	1.7%	1.9%
	< -\$20	2.5%	1.5%	1.5%	1.8%
~ 90 Minutes Prior to Real-Time	> \$20	0.4%	0.4%	0.0%	0.3%
	\$10 to \$20	2.1%	0.6%	1.2%	1.3%
	\$5 to \$10	4.0%	3.8%	6.3%	4.8%
	\$0 to \$5	44.9%	47.3%	46.7%	46.3%
	\$0 to -\$5	39.9%	40.8%	36.8%	39.1%
	-\$5 to -\$10	3.6%	4.1%	5.4%	4.4%
	-\$10 to -\$20	2.4%	1.5%	2.1%	2.0%
	< -\$20	2.7%	1.4%	1.5%	1.9%
~ 135 Minutes Prior to Real-Time	> \$20	1.2%	0.5%	0.9%	0.9%
	\$10 to \$20	3.7%	2.1%	3.4%	3.1%
	\$5 to \$10	6.2%	6.3%	11.6%	8.1%
	\$0 to \$5	47.6%	51.5%	50.9%	50.0%
	\$0 to -\$5	33.6%	33.0%	26.4%	31.0%
	-\$5 to -\$10	3.2%	3.8%	4.2%	3.7%
	-\$10 to -\$20	1.7%	1.3%	1.2%	1.4%
	< -\$20	2.8%	1.5%	1.3%	1.9%

**Table 9-47 Monthly differences between forecast and actual PJM/MISO interface prices (average price difference): January through March, 2016**

Interval	Range of Price Differences				
	Jan	Feb	Mar	YTD Avg	
~ 30 Minutes Prior to Real-Time	> \$20	\$85.38	\$37.24	\$65.07	\$65.21
	\$10 to \$20	\$14.45	\$12.98	\$14.05	\$14.05
	\$5 to \$10	\$6.87	\$6.97	\$6.91	\$6.91
	\$0 to \$5	\$1.39	\$1.47	\$1.75	\$1.54
	\$0 to -\$5	\$1.30	\$1.42	\$1.53	\$1.42
	-\$5 to -\$10	\$6.99	\$6.74	\$6.98	\$6.92
	-\$10 to -\$20	\$13.76	\$14.26	\$13.58	\$13.83
	< -\$20	\$57.03	\$63.48	\$72.35	\$63.35
~ 45 Minutes Prior to Real-Time	> \$20	\$98.60	\$28.62	\$30.01	\$72.89
	\$10 to \$20	\$13.74	\$12.76	\$12.35	\$13.12
	\$5 to \$10	\$6.96	\$6.64	\$6.58	\$6.74
	\$0 to \$5	\$1.36	\$1.47	\$1.69	\$1.51
	\$0 to -\$5	\$1.24	\$1.39	\$1.51	\$1.38
	-\$5 to -\$10	\$7.15	\$6.98	\$6.86	\$6.98
	-\$10 to -\$20	\$14.27	\$13.89	\$13.38	\$13.90
	< -\$20	\$56.70	\$62.62	\$74.91	\$63.15
~ 90 Minutes Prior to Real-Time	> \$20	\$39.11	\$25.93	\$20.37	\$32.29
	\$10 to \$20	\$13.35	\$13.35	\$13.10	\$13.27
	\$5 to \$10	\$6.89	\$6.60	\$6.38	\$6.58
	\$0 to \$5	\$1.45	\$1.50	\$1.78	\$1.58
	\$0 to -\$5	\$1.36	\$1.48	\$1.65	\$1.49
	-\$5 to -\$10	\$6.98	\$7.10	\$6.67	\$6.89
	-\$10 to -\$20	\$14.19	\$14.54	\$13.92	\$14.18
	< -\$20	\$53.40	\$64.69	\$74.26	\$61.75
~ 135 Minutes Prior to Real-Time	> \$20	\$25.59	\$26.55	\$27.64	\$26.49
	\$10 to \$20	\$13.74	\$13.90	\$12.96	\$13.49
	\$5 to \$10	\$7.12	\$6.76	\$6.84	\$6.89
	\$0 to \$5	\$1.62	\$1.71	\$2.09	\$1.81
	\$0 to -\$5	\$1.46	\$1.60	\$1.64	\$1.56
	-\$5 to -\$10	\$6.77	\$6.84	\$6.71	\$6.77
	-\$10 to -\$20	\$14.21	\$13.86	\$13.63	\$13.94
	< -\$20	\$50.87	\$60.13	\$73.80	\$58.75

The data reviewed show that ITSCED is not a highly accurate predictor of the real-time PJM/MISO interface prices. If this remains true, it will limit the effectiveness of CTS in improving interface pricing between PJM and MISO.

## Willing to Pay Congestion and Not Willing to Pay Congestion

When reserving non-firm transmission, market participants have the option to choose whether or not they are willing to pay congestion. When the market participant elects to pay congestion, PJM operators redispatch the system if necessary to allow the energy transaction to continue to flow. The system redispatch often creates price separation across buses on the PJM system. The difference in LMPs between two buses in PJM is the congestion cost (and losses) that the market participant pays in order for their transaction to continue to flow.

The MMU recommended that PJM modify the not willing to pay congestion product to address the issues of uncollected congestion charges. The MMU recommended charging market participants for any congestion incurred while the transaction is loaded, regardless of their election of transmission service, and restricting the use of not willing to pay congestion transactions (as well as all other real-time external energy transactions) to transactions at interfaces.

On April 12, 2011, the PJM Market Implementation Committee (MIC) endorsed the changes recommended by the MMU. The elimination of internal sources and sinks on transmission reservations addressed most of the MMU concerns, as there can no longer be uncollected congestion charges for imports to PJM or exports from PJM. There is still potential exposure to uncollected congestion charges in wheel through transactions, and the MMU will continue to evaluate if additional mitigation measures would be appropriate to address this exposure.

Table 9-48 shows that since the inception of the business rule change on April 12, 2013, there was uncollected congestion in only one month, January 2016. The negative congestion means that market participants who utilized the not willing to pay congestion transmission option for their wheel through

transactions had transactions that flowed in the direction opposite to congestion. When market participants utilize the not willing to pay congestion product, it also means that they are not willing to receive congestion credits, which was the case in January 2016.

**Table 9-48 Monthly uncollected congestion charges: January, 2010 through March, 2016**

Month	2010	2011	2012	2013	2014	2015	2016
Jan	\$148,764	\$3,102	\$0	\$5	\$0	\$0	(\$44)
Feb	\$542,575	\$1,567	(\$15)	\$249	\$0	\$0	\$0
Mar	\$287,417	\$0	\$0	\$0	\$0	\$0	\$0
Apr	\$31,255	\$4,767	(\$68)	(\$3,114)	\$0	\$0	\$0
May	\$41,025	\$0	(\$27)	\$0	\$0	\$0	\$0
Jun	\$169,197	\$1,354	\$78	\$0	\$0	\$0	\$0
Jul	\$827,617	\$1,115	\$0	\$0	\$0	\$0	\$0
Aug	\$731,539	\$37	\$0	\$0	\$0	\$0	\$0
Sep	\$119,162	\$0	\$0	\$0	\$0	\$0	\$0
Oct	\$257,448	(\$31,443)	(\$6,870)	\$0	\$0	\$0	\$0
Nov	\$30,843	(\$795)	(\$4,678)	\$0	\$0	\$0	\$0
Dec	\$127,176	(\$659)	(\$209)	\$0	\$0	\$0	\$0
Total	\$3,314,018	(\$20,955)	(\$11,789)	(\$2,860)	\$0	\$0	(\$44)

## Spot Imports

Prior to April 1, 2007, PJM did not limit non-firm service imports that were willing to pay congestion, including spot imports, secondary network service imports and bilateral imports using non-firm point-to-point service. Spot market imports, non-firm point-to-point and network services that are willing to pay congestion, all termed willing to pay congestion (WPC), were part of the PJM LMP energy market design implemented on April 1, 1998. Under this approach, market participants could offer energy into or bid to buy from the PJM spot market at the border/interface as price takers without restrictions based on estimated available transmission capability (ATC). Price and PJM system conditions, rather than ATC, were the only limits on interchange.

However, PJM has interpreted its JOA with MISO to require restrictions on spot imports and exports although MISO has not implemented a corresponding

restriction.<sup>84</sup> The result is that the availability of spot import service is limited by ATC and not all spot transactions are approved. Spot import service (a network service) is provided at no charge to the market participant offering into the PJM spot market.

The spot import rules provide incentives to hoard spot import capability. In response to market participant complaints regarding the inability to acquire spot import service after this rule change on April 1, 2007, changes were made to the spot import service effective May 1, 2008.<sup>85</sup> These changes limited spot imports to only hourly reservations and caused spot import service to expire if not associated with a valid NERC Tag within two hours when reserved the day prior to the scheduled flow or within 30 minutes when reserved on the day of the scheduled flow.

These changes did not fully resolve the issue. In the *2008 State of the Market Report for PJM*, the MMU recommended that PJM reconsider whether a new approach to limiting spot import service is required or whether a return to the prior policy with an explicit system of managing related congestion is preferable. PJM and the MMU jointly addressed this issue through the stakeholder process, recommending that all unused spot import service be retracted if not tagged within 30 minutes from the queue time of the reservations intraday, and two hours when queued the day prior. On June 23, 2009, PJM implemented the new business rules.


Figure 9-14 shows the spot import service use for the NYISO Interface, and for all other interfaces, from January 2013 through March 2016. The yellow line shows the total monthly MWh of spot import service reserved and the orange line shows the total monthly MWh of tagged spot import service. The gray shaded area between the yellow and orange lines represents the MWh of retracted spot import service and may represent potential hoarding volumes. This ATC was initially reserved, but not tagged (used). It is possible that in some instances the reserved transmission consisted of the only available ATC which could have been used by another market participant had it not been reserved

<sup>84</sup> See OASIS "Modifications to the Practices of Non-Firm and Spot Market Import Service," <<http://www.pjm.com/~media/etools/oasis/wpc-white-paper.ashx>>. (April 20, 2007).

<sup>85</sup> See OASIS "Regional Transmission and Energy Scheduling Practices," (May 1, 2008) <<http://www.pjm.com/markets-and-operations/etools/~media/etools/oasis/regional-practices-redline-doc.ashx>>.

and not used. The blue shaded area between the orange line and green shaded area represents the MWh of curtailed transactions using spot import service. This area may also represent hoarding opportunities, particularly at the NYISO Interface. In this instance, it is possible that while the market participant reserved and scheduled the transmission, they may have submitted purposely uneconomic bids in the NYISO market so that their transaction would be curtailed, yet their transmission would not be retracted. The NYISO allows for market participants to modify their bids on an hourly basis, so these market participants can hold their transmission service and evaluate their bids hourly, while withholding the transmission from other market participants that may wish to use it. The green shaded area represents the total settled MWh of spot import service. Figure 9-14 shows that while there are proportionally fewer retracted MWh on the NYISO Interface than on all other interfaces, the NYISO has proportionally more curtailed MWh. This is a result of the NYISO market clearing process.

Figure 9-14 Spot import service use: January, 2013 through March, 2016

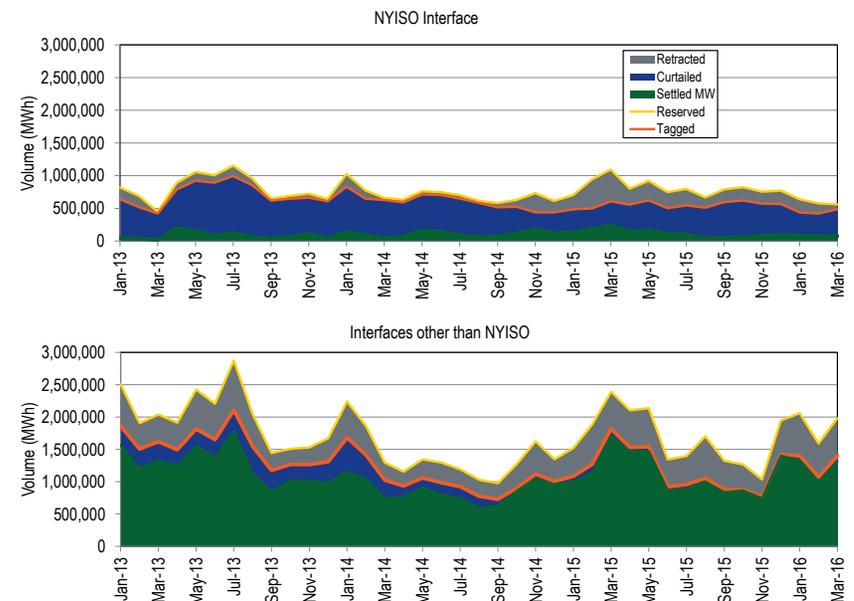

The MMU continues to recommend that PJM permit unlimited spot market imports (as well as all non-firm point-to-point willing to pay congestion imports and exports) at all PJM interfaces.

## Interchange Optimization

When PJM prices are higher than prices in surrounding balancing authorities, imports will flow into PJM until the prices are approximately equal. This is an appropriate market response to price differentials. Given the nature of interface pricing and the treatment of interface transactions, it is not possible for PJM system operators to reliably predict the quantity or sustainability of such imports. The inability to predict interchange volumes creates additional challenges for PJM dispatch in trying to meet loads, especially on high-load days. If all external transactions were submitted as real-time dispatchable transactions during emergency conditions, PJM would be able to include interchange transactions in its supply stack, and dispatch only enough interchange to meet the demand.

The MMU recommends that the submission deadline for real-time dispatchable transactions be modified from 1800 on the prior day to three hours prior to the requested start time, and that the minimum duration be modified from one hour to 15 minutes. These changes would give PJM a more flexible product that could be used to meet load based on economic dispatch rather than guessing the sensitivity of the transactions to price changes.

In addition to changing prices, transmission line loading relief procedures (TLRs), market participants' curtailments for economic reasons, and external balancing authority curtailments affect the duration of interchange transactions.

The MMU recommends that PJM explore an interchange optimization solution with its neighboring balancing authorities that would remove the need for market participants to schedule physical transactions across seams. Such a solution would include an optimized, but limited, joint dispatch approach that uses supply curves and treats seams between balancing authorities as constraints, similar to other constraints within an LMP market.

## Interchange Cap During Emergency Conditions

An interchange cap is a limit on the level of interchange permitted for nondispatchable energy using spot import or hourly point-to-point transmission. An interchange cap is a non-market intervention which should be a temporary solution and should be replaced with a market based solution as soon as possible. Since the approval of this process on October 30, 2014, PJM has not yet needed to implement an interchange cap.

The purpose of the interchange cap is to help ensure that actual interchange more closely meets operators' expectations of interchange levels when internal PJM resources, e.g. CTs or demand response, were dispatched to meet the peak load. Once these resources have been called on, PJM must honor their minimum operating constraints regardless of whether additional interchange then materializes; therefore any interchange received in excess of what was expected can have a suppressive effect on energy and reserve pricing and result in increased uplift.<sup>86</sup>

PJM will notify market participants of the possible use of the interchange cap the day before. The interchange cap will be implemented for the forecasted peak and surrounding hours during emergency conditions.

The interchange cap will limit the acceptance of spot import and hourly non-firm point to point interchange (imports and exports) not submitted as real-time with price transactions once net interchange has reached the interchange cap value. Spot imports and hourly non-firm point to point transactions submitted prior to the implementation of the interchange cap will not be limited. In addition, schedules with firm or network designated transmission service will not be limited either, regardless of whether net interchange is at or above the cap.

The calculation of the interchange cap is based on the operator expectation of interchange at the time the cap is calculated plus an additional margin. The margin is set at 700 MW, which is half of the largest contingency on the system. The additional margin also allows interchange to adjust to the loss of

<sup>86</sup> The material in this section is based in part on the *Energy and Reserve Pricing & Interchange Volatility Final Proposal Report*. See PJM. <<http://www.pjm.com/-/media/committees-groups/committees/mrc/20141030/20141030-item-04-erpiv-final-proposal-report.ashx>>.

a unit or deviation between actual load and forecasted load. The interchange cap is based on the maximum sustainable interchange from PJM reliability studies.

### 45 Minute Schedule Duration Rule

PJM limits the change in interchange volumes on 15 minute intervals. These changes are referred to as ramp. The purpose of imposing a ramp limit is to help ensure the reliable operation of the PJM system. The 1,000 MW ramp limit per 15 minute interval was based on the availability of ramping capability by generators in the PJM system. The limit is consistent with the view that the available generation in the PJM system can only move 1,000 MW over any 15 minute period. The PJM ramp limit is designed to limit the change in the amount of imports or exports in each 15 minute interval to account for the physical characteristics of the generation to respond to changes in the level of imports and exports. For example, if at 0800 the sum of all external transactions were -3,000 MW (negative sign indicates net exporting), the limit for 0815 would be -2,000 MW to -4,000 MW. In other words, the starting or ending of transactions would be limited so that the overall change from the previous 15 minute period would not exceed 1,000 MW in either direction.

In 2008, there was an increase in 15 minute external energy transactions that caused swings in imports and exports submitted in response to intra-hour LMP changes. This activity was due to market participants' ability to observe price differences between RTOs in the first third of the hour, and predict the direction of the price difference on an hourly integrated basis. Large quantities of MW would then be scheduled between the RTOs for the last 15 minute interval to capture those hourly integrated price differences with relatively little risk of prices changing. This increase in interchange on 15 minute intervals created operational control issues, and in some cases led to an increase in uplift charges due to calling on resources with minimum run times greater than 15 minutes needed to support the interchange transactions. As a result, a new business rule was proposed and approved that required all transactions to be at least 45 minutes in duration.

On June 22, 2012, FERC issued Order No. 764, which required transmission providers to give transmission customers the option to schedule transmission service at 15 minute intervals to reflect more accurate power production forecasts, load and system conditions.<sup>87 88</sup> On April 17, 2014, FERC issued its order which found that PJM's 45 minute duration rule was inconsistent with Order 764.<sup>89</sup>

PJM and the MMU issued a statement indicating ongoing concern about market participants' scheduling behavior, and a commitment to address any scheduling behavior that raises operational or market manipulation concerns.<sup>90</sup>

### Interchange Transaction Credit Screening Process

On November 3, 2014, to address potential default risk, PJM implemented a credit screening process for export interchange transactions submitted to PJM which requires participants to create reserves equal to the MWh of each transaction times a price for each transaction. The price is the higher of the export nodal reference price factor for the interface point where the export is scheduled, or the real-time price calculated by PJM's ITCED model. The export nodal reference price factor is updated every two months, and is based on nodal prices in the same two months the prior year. If the full amount of reserves is not created, the transaction is curtailed.

<sup>87</sup> *Integration of Variable Energy Resources*, Order No. 764, 139 FERC ¶ 61,246 (2012), *order on reh'g*, Order No. 764-A, 141 FERC ¶ 61231 (2012).

<sup>88</sup> Order No. 764 at P 51.

<sup>89</sup> See *Id.* at P 12.

<sup>90</sup> See joint statement of PJM and the MMU re Interchange Scheduling issued July 29, 2014, which can be accessed at: <<http://www.pjm.com/~media/documents/reports/20140729-pjm-imm-joint-statement-on-interchange-scheduling.ashx>>.



## Ancillary Service Markets

The United States Federal Energy Regulatory Commission (FERC) defined six ancillary services in Order No. 888: scheduling, system control and dispatch; reactive supply and voltage control from generation service; regulation and frequency response service; energy imbalance service; operating reserve – synchronized reserve service; and operating reserve – supplemental reserve service.<sup>1</sup> PJM provides scheduling, system control and dispatch and reactive on a cost basis. PJM provides regulation, energy imbalance, synchronized reserve, and supplemental reserve services through market mechanisms.<sup>2</sup> Although not defined by the FERC as an ancillary service, black start service plays a comparable role. Black start service is provided on the basis of formulaic rates or cost.

The Market Monitoring Unit (MMU) analyzed measures of market structure, conduct and performance for the PJM Regulation Market, the PJM Synchronized Reserve Market, and the PJM DASR Market for the first three months of 2016.

**Table 10-1 The Regulation Market results were competitive**

Market Element	Evaluation	Market Design
Market Structure	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Flawed

- The Regulation Market structure was evaluated as not competitive for the first three months of 2016 because the Regulation Market failed the three pivotal supplier (TPS) test in 90.9 percent of the hours in the first three months of 2016.
- Participant behavior in the Regulation Market was evaluated as competitive for the first three months of 2016 because market power mitigation requires competitive offers when the three pivotal supplier test is failed and there was no evidence of generation owners engaging in anti-competitive behavior.

<sup>1</sup> 75 FERC ¶ 61,080 (1996).

<sup>2</sup> Energy imbalance service refers to the Real-Time Energy Market.

- Market performance was evaluated as competitive, despite significant issues with the market design.
- Market design was evaluated as flawed. While the design of the Regulation Market was significantly improved with changes introduced October 1, 2012, a number of issues remain. The market design has failed to correctly incorporate a consistent implementation of the marginal benefit factor in optimization, pricing and settlement. The market results continue to include the incorrect definition of opportunity cost.

**Table 10-2 The Tier 2 Synchronized Reserve Market results were competitive**

Market Element	Evaluation	Market Design
Market Structure: Regional Markets	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Mixed

- The Tier 2 Synchronized Reserve Market structure was evaluated as not competitive because of high levels of supplier concentration.
- Participant behavior was evaluated as competitive because the market rules require competitive, cost based offers, although there is concern about failure to comply with the must offer requirement.
- Market performance was evaluated as competitive because the interaction of participant behavior with the market design results in competitive prices.
- Market design was evaluated as mixed. Market power mitigation rules result in competitive outcomes despite high levels of supplier concentration. However, tier 1 reserves are inappropriately compensated when the non-synchronized reserve market clears with a nonzero price.

**Table 10-3 The Day-Ahead Scheduling Reserve Market results were competitive**

Market Element	Evaluation	Market Design
Market Structure	Competitive	
Participant Behavior	Mixed	
Market Performance	Competitive	Mixed

- The Day-Ahead Scheduling Reserve Market structure was evaluated as competitive because market participants failed the three pivotal supplier test in only 0.9 percent of all cleared hours in the first three months of 2016.
- Participant behavior was evaluated as mixed because while most offers were equal to marginal costs, a significant proportion of offers reflected economic withholding.
- Market performance was evaluated as competitive because there were adequate offers in every hour to satisfy the requirement and the clearing prices reflected those offers, although there is concern about offers above the competitive level affecting prices. Offers above \$0.00 set the clearing price in 90 (4.1 percent) hours.
- Market design was evaluated as mixed because while the market is functioning effectively to provide DASR, the three pivotal supplier test and appropriate market power mitigation should be added to the market to ensure that market power cannot be exercised at times of system stress.

## Overview

### Primary Reserve

PJM's primary reserves are made up of resources, both synchronized and non-synchronized, that can provide energy within 10 minutes. Primary reserve is PJM's implementation of the NERC 15-minute contingency reserve requirement.<sup>3</sup>

<sup>3</sup> See PJM, "Manual 10: Pre-Scheduling Operations," Revision. 33 (December 22, 2015), p. 24.

## Market Structure

- **Supply.** Primary reserve is satisfied by both synchronized reserve (generation or demand response currently synchronized to the grid and available within 10 minutes), and non-synchronized reserve (generation currently off-line but available to start and provide energy within 10 minutes).
- **Demand.** The PJM primary reserve requirement is 150 percent of the largest contingency. The primary reserve requirement in the RTO Zone was raised on January 8, 2015, to 2,175 MW of which at least 1,700 MW must be available within the Mid-Atlantic Dominion (MAD) Subzone. Adjustments to the primary reserve requirement can occur when grid maintenance or outages change the largest contingency. The actual demand for primary reserve in the RTO Zone in the first three months of 2016 was 2,181.6 MW. The actual demand for primary reserve in the MAD Subzone was 1,700.0 MW.

### Tier 1 Synchronized Reserve

Synchronized reserve is energy or demand reduction synchronized to the grid and capable of increasing output or decreasing load within 10 minutes. Synchronized reserve is of two distinct types, tier 1 and tier 2.

Tier 1 synchronized reserve is part of primary reserve and is the capability of on-line resources following economic dispatch to ramp up in 10 minutes from their current output in response to a synchronized reserve event. There is no formal market for tier 1 synchronized reserve.

- **Supply.** No offers are made for tier 1 synchronized reserve. The market solution estimates tier 1 synchronized reserve as available 10-minute ramp from the energy dispatch. In the first three months of 2016, there was an average hourly supply of 1,434.4 MW of tier 1 for the RTO Synchronized Reserve Zone, and an average hourly supply of 1,160.6 MW of tier 1 in the Mid-Atlantic Dominion Subzone.
- **Demand.** The default hourly required synchronized reserve requirement is 1,450 MW in the RTO Reserve Zone and 1,450 MW for the Mid-Atlantic

Dominion Reserve Subzone. The requirement can be met with tier 1 or tier 2 synchronized reserves.

- **Tier 1 Synchronized Reserve Event Response.** Tier 1 synchronized reserve is paid when a synchronized reserve event occurs and it responds. When a synchronized reserve event is called, all tier 1 response is paid the average of five-minute LMPs during the event, rather than hourly integrated LMP, plus \$50/MW. This is the Synchronized Energy Premium Price. The synchronized reserve event response credits for tier 1 response are independent of the tier 2 synchronized reserve market clearing price and independent of the non-synchronized reserve market clearing price.

Of tier 1 synchronized reserve resources estimated at market clearing, 68.2 percent actually responded during the two distinct synchronized reserve events with duration of 10 minutes or longer in the first three months of 2016. PJM made changes to the way it calculated tier 1 MW for settlements beginning in July 2014. These changes improved the reported response rate by reducing the initial tier 1 estimate.

- **Issues.** The competitive offer for tier 1 synchronized reserves is zero, as there is no incremental cost associated with the ability to ramp up from the current economic dispatch point and the appropriate payment for responding to an event is the five-minute LMP plus \$50 per MWh. A tariff change included in the shortage pricing tariff changes (October 1, 2012) added the requirement to pay tier 1 synchronized reserve the tier 2 synchronized reserve market clearing price whenever the non-synchronized reserve market clearing price rises above zero.

The rationale for this change was and is unclear, but it has had a significant impact on the cost of tier 1 synchronized reserves, resulting in a windfall payment of \$10,406,363 to tier 1 resources in 2014, and \$34,135,671 in 2015. During the first three months of 2016, payments to tier 1 synchronized reserve resources when the NSRMCP is above \$0.00 were \$1,753,468. This is a significant reduction from the first three months of 2015 when payments to tier 1 synchronized reserve when the NSRMCP was above \$0.00 were \$17,877,658.

## Tier 2 Synchronized Reserve Market

Tier 2 synchronized reserve is part of primary reserve and is comprised of resources that are synchronized to the grid, that incur costs to be synchronized, that have an obligation to respond with corresponding penalties, and that must be dispatched in order to satisfy the synchronized reserve requirement.

When the synchronized reserve requirement cannot be met with tier 1 synchronized reserve, PJM conducts a market to satisfy the balance of the requirement with tier 2 synchronized reserve. The Tier 2 Synchronized Reserve Market includes the PJM RTO Reserve Zone and a subzone, the Mid-Atlantic Dominion Reserve Subzone (MAD).

### Market Structure

- **Supply.** In the first three months of 2016, the supply of offered and eligible synchronized reserve was 13,446.9 MW in the RTO Zone of which 5,340.6 MW (including DSR) was available to the MAD Subzone.
- **Demand.** The default hourly required synchronized reserve requirement was 1,450 MW in the RTO Reserve Zone and 1,450 MW for the Mid-Atlantic Dominion Reserve Subzone. The requirement can be met with tier 1 or tier 2 synchronized reserves. After subtracting the tier 1 synchronized reserve estimate from the default requirement, the hourly average required tier 2 synchronized reserve was 318.6 MW in the MAD subzone (including self-scheduled) and 557.1 MW in the RTO zone (including self-scheduled).
- **Market Concentration.** In the first three months of 2016, the weighted average HHI for cleared tier 2 synchronized reserve in the Mid-Atlantic Dominion Subzone was 5963 which is classified as highly concentrated. The MMU calculates that 47.3 percent of hours would have failed a three pivotal supplier test in the Mid-Atlantic Dominion Subzone.

In the first three months of 2016, the weighted average HHI for cleared tier 2 synchronized reserve in the RTO Synchronized Reserve Zone was 5161 which is classified as highly concentrated. The MMU calculates that 69.9 percent of hours would have failed a three pivotal supplier test in the RTO Synchronized Reserve Zone.

The MMU concludes from these results that both the Mid-Atlantic Dominion Subzone Tier 2 Synchronized Reserve Market and the RTO Synchronized Reserve Zone Market were characterized by structural market power in the first three months of 2016.

## Market Conduct

- **Offers.** There is a must offer requirement for tier 2 synchronized reserve. All non-emergency generation capacity resources are required to submit a daily offer for tier 2 synchronized reserve. Tier 2 synchronized reserve offers from generating units are subject to an offer cap of marginal cost plus \$7.50 per MW, plus opportunity cost, which is calculated by PJM.

## Market Performance

- **Price.** The weighted average price for tier 2 synchronized reserve for all cleared hours in the Mid-Atlantic Dominion (MAD) Subzone was \$4.99 per MW in the first three months of 2016, a decrease of \$7.97, 61.5 percent from the same time period of 2015.

The weighted average price for tier 2 synchronized reserve for all cleared hours in the RTO Synchronized Reserve Zone was \$4.96 per MW in the first three months of 2016, a decrease of \$6.18, 55.5 percent from the same time period in 2015.

## Non-Synchronized Reserve Market

Non-synchronized reserve is part of primary reserve and includes the RTO Reserve Zone and the Mid-Atlantic Dominion Reserve Subzone (MAD). Non-synchronized reserve is comprised of non-emergency energy resources not currently synchronized to the grid that can provide energy within 10 minutes. Non-synchronized reserve is available to fill the primary reserve requirement above the synchronized reserve requirement. There is no formal market for non-synchronized reserve.

## Market Structure

- **Supply.** In the first three months of 2016, the supply of eligible non-synchronized reserve was 2,288.0 MW in the RTO Zone and 1,768.7 MW in MAD Subzone.<sup>4</sup>
- **Demand.** Demand for non-synchronized reserve is the remaining primary reserve requirement after tier 1 synchronized reserve is estimated and tier 2 synchronized reserve is scheduled. In the RTO Zone, the market cleared an hourly average of 901.9 MW of non-synchronized reserve in the first three months of 2016. The MAD Subzone did not clear separately.
- **Market Concentration.** In the first three months of 2016, the weighted average HHI for cleared non-synchronized reserve in the MAD Subzone was 3760 which is classified as highly concentrated. In the RTO Zone the weighted average HHI was 5163, which is also highly concentrated. The MMU calculates that 21.7 percent of hours would have failed a three pivotal supplier test in the MAD Subzone and 0.0 hours would have failed a three pivotal supplier test in the RTO Zone.

## Market Conduct

- **Offers.** No offers are made for non-synchronized reserve. Non-emergency generation resources that are available to provide energy and can start in 10 minutes or less are considered available for non-synchronized reserves by the market solution software.

## Market Performance

- **Price.** The non-synchronized reserve price is determined by the opportunity cost of the marginal non-synchronized reserve unit. The non-synchronized reserve weighted average price for all cleared hours (124 hours) in the RTO Reserve Zone was \$0.82 per MW in the first three months of 2016 and in 94.6 percent of hours the market clearing price was \$0. The non-synchronized reserve weighted average price for the MAD Subzone was the RTO price because the MAD Subzone did not clear separately.

<sup>4</sup> See PJM, "Manual 11; Energy & Ancillary Services Markets," Revision 79 (December 17, 2015), p. 81. "Because Synchronized Reserve may be utilized to meet the Primary Reserve requirement, there is no explicit requirement for non-synchronized reserves."

## Secondary Reserve (Day-Ahead Scheduling Reserve)

PJM maintains a day-ahead, offer-based market for 30-minute secondary reserve, designed to provide price signals to encourage resources to provide 30-minute reserve.<sup>5</sup> The DASR Market has no performance obligations.

### Market Structure

- **Supply.** The DASR Market is a must offer market. Any resources that do not make an offer have their offer set to \$0.00 per MW. DASR is calculated by the day-ahead market solution as the lesser of the thirty minute energy ramp rate or the economic maximum MW minus the day-ahead dispatch point for all online units. In the first three months of 2016, the average available hourly DASR was 40,087.1 MW.
- **Demand.** The DASR requirement in 2016 is 5.70 percent of peak load forecast, down from 5.93 percent in 2015. The average DASR MW purchased was 4,543.0 MW per hour in the first three months of 2016.
- **Concentration.** In the first three months of 2016, the DASR Market would have failed a three pivotal supplier test in 0.9 percent of hours.

### Market Conduct

- **Withholding.** Economic withholding remains an issue in the DASR Market. The direct marginal cost of providing DASR is zero. All offers greater than zero constitute economic withholding. In the first three months of 2016 a daily average of 36.2 percent of units offered above \$0.00. In the first three months of 2016, a daily average of 13.6 percent of units offered above \$5.
- **DR.** Demand resources are eligible to participate in the DASR Market. Six demand resources have entered offers for DASR.

## Market Performance

- **Price.** The weighted average DASR market clearing price for all cleared hours in 2015 was \$0.20 per MW, a decrease from \$1.54 per MW in the first three months of 2016.

## Regulation Market

The PJM Regulation Market is a real-time market. Regulation is provided by generation resources and demand response resources that qualify to follow a regulation signal (RegA or RegD). PJM jointly optimizes regulation with synchronized reserve and energy to provide all three services at least cost. The PJM regulation market design includes three clearing price components: capability; performance; and lost opportunity cost. The marginal benefit factor and performance score translate a resource's capability in actual MW into effective MW.

### Market Structure

- **Supply.** In the first three months of 2016, the average hourly eligible supply of regulation was 1,206.4 actual MW (930.2 effective MW). This was an increase of 52.7 actual MW (an increase of 32.0 effective MW) from the same period of 2015, when the average hourly eligible supply of regulation was 1,153.7 actual MW (898.2 effective MW).
- **Demand.** The hourly regulation demand is set to 525.0 effective MW for off peak hours (00:00 to 04:59), and 700.0 effective MW for on peak hours (05:00 to 23:59). The average hourly cleared MW for off peak hours was 540.1 actual MW in the first three months of 2016. This is an increase of 39.8 actual MW from the same period of 2015, when the average hourly regulation cleared MW for off peak hours was 500.3 actual MW. The average hourly cleared MW for on peak hours was 653.6 actual MW in the first three months of 2016. This is a decrease of 33.0 actual MW from the same period of 2015, where the average hourly regulation cleared MW for on peak hours was 686.6 actual MW.
- **Supply and Demand.** The ratio of the average hourly eligible supply of regulation to average hourly regulation demand required was 1.91. This

<sup>5</sup> See PJM, "Manual 35: Definitions and Acronyms," Revision 23 (April 11, 2014), p. 22.

is an increase of 7.3 percent from the same period of 2015, when the ratio was 1.78.

- **Market Concentration.** In the first three months of 2016, the weighted average (HHI) was 1169 which is classified as moderately concentrated. In the first three months of 2016, the three pivotal supplier test was failed in 90.9 percent of hours.

## Market Conduct

- **Offers.** Daily regulation offer prices are submitted for each unit by the unit owner. Owners are required to submit a cost-based offer and may submit a price-based offer. Offers include both a capability offer and a performance offer. Owners must specify which signal type the unit will be following, RegA or RegD.<sup>6</sup> In the first three months of 2016, there were 168 resources following the RegA signal and 43 resources following the RegD signal.

## Market Performance

- **Price and Cost.** The weighted average clearing price for regulation was \$15.55 per effective MW of regulation in the first three months of 2016, a decrease of \$32.35 per MW, or 67.5 percent, from the same period of 2015. The cost of regulation in the first three months of 2016 was \$17.92 per effective MW of regulation, a decrease of \$40.31 per MW, or 69.2 percent, from the same period of 2015. The decreases in regulation price and regulation cost in the first three months of 2016 resulted primarily from reductions in the LOC component of the regulation clearing prices due to lower energy prices in the first three months of 2016 compared to the first three months of 2015.
- **RMCP Credits.** RegD resources continue to be incorrectly compensated relative to RegA resources due to an inconsistent application of the marginal benefit factor in the optimization, assignment, pricing, and settlement processes. If the Regulation Market were functioning efficiently, RegD and RegA resources would be paid the same price per effective MW.

<sup>6</sup> See the 2015 State of the Market Report for PJM, Volume II, Appendix F "Ancillary Services Markets."

- **Marginal Benefit Factor Function.** The marginal benefit factor (MBF) measures the substitutability of RegD resources for RegA resources. The marginal benefit factor function is incorrectly applied in the market clearing and incorrectly describes the operational relationship between RegA and RegD.
- **Interim changes to the MBF function.** On December 14, 2015, PJM changed the MBF curve. The modification to the marginal benefit curve did not correct the identified issues with the optimization engine.

## Black Start Service

Black start service is required for the reliable restoration of the grid following a blackout. Black start service is the ability of a generating unit to start without an outside electrical supply, or is the demonstrated ability of a generating unit to automatically remain operating at reduced levels when disconnected from the grid (automatic load rejection or ALR).<sup>7</sup>

In the first three months of 2016, total black start charges were \$12.9 million with \$12.8 million in revenue requirement charges and \$16.8 thousand in operating reserve charges. Black start revenue requirements for black start units consist of fixed black start service costs, variable black start service costs, training costs, fuel storage costs, and an incentive factor. Black start operating reserve charges are paid to units scheduled in the Day-Ahead Energy Market or committed in real time to provide black start service under the ALR option or for black start testing. Black start zonal charges for the first three months in 2016 ranged from \$0.02 per MW-day in the APS Zone (total charges were \$15,117) to \$3.31 per MW-day in the BGE Zone (total charges were \$2,024,438).

## Reactive

Reactive service, reactive supply and voltage control are provided by generation and other sources of reactive power (measured in VAR). Reactive power helps maintain appropriate voltages on the transmission system and is essential to the flow of real power (measured in MW).

<sup>7</sup> OATT Schedule 1 § 1.3BB.

In first three months of 2016, total reactive service charges were \$75.2 million, a 1.0 percent decrease from \$76.0 million in the first three months of 2015. Revenue requirement charges increased from \$69.7 million to \$75.0 million and operating reserve charges fell from \$6.3 million to \$250.5 thousand in the first three months of 2016. Total charges in 2016 ranged from \$0.00 in the DLCO and RECO Zone to \$9.3 million in the PSEG Zone. Reactive service revenue requirements are based on FERC approved filings. Reactive service operating reserve charges are paid for scheduling in the Day-Ahead Energy Market and committing in real time units that provide reactive service.

### Ancillary Services Costs per MWh of Load: 2004 through 2015

Table 10-4 shows PJM ancillary services costs for January through March of 2004 through 2016, per MWh of load. The rates are calculated as the total charges for the specified ancillary service divided by the total PJM real-time load in MWh. The scheduling, system control, and dispatch category of costs is comprised of PJM scheduling, PJM system control and PJM dispatch; owner scheduling, owner system control and owner dispatch; other supporting facilities; black start services; direct assignment facilities; and ReliabilityFirst Corporation charges. The cost per MWh of load in Table 10-4 is a different metric than the cost of each ancillary service per MW of that service. The cost per MWh of load includes the effects both of price changes per MW of the ancillary service and changes in total load.

**Table 10-4 History of ancillary services costs per MWh of Load: January through March, 2004 through 2016<sup>8</sup>**

Year (Jan-Mar)	Scheduling, Dispatch, and System Control			Synchronized		Total
	Regulation	Reactive	Reserve	Reserve	Reserve	
2004	\$0.53	\$0.63	\$0.26	\$0.17	\$1.59	
2005	\$0.46	\$0.51	\$0.25	\$0.07	\$1.29	
2006	\$0.48	\$0.46	\$0.28	\$0.09	\$1.31	
2007	\$0.58	\$0.46	\$0.30	\$0.11	\$1.45	
2008	\$0.59	\$0.47	\$0.29	\$0.07	\$1.42	
2009	\$0.37	\$0.37	\$0.34	\$0.16	\$1.24	
2010	\$0.34	\$0.38	\$0.35	\$0.05	\$1.12	
2011	\$0.27	\$0.33	\$0.39	\$0.12	\$1.11	
2012	\$0.18	\$0.41	\$0.49	\$0.03	\$1.11	
2013	\$0.28	\$0.41	\$0.63	\$0.04	\$1.36	
2014	\$0.63	\$0.38	\$0.37	\$0.56	\$1.94	
2015	\$0.32	\$0.41	\$0.36	\$0.20	\$1.28	
2016	\$0.11	\$0.42	\$0.39	\$0.04	\$0.96	

### Recommendations

- The MMU recommends that the Regulation Market be modified to incorporate a consistent application of the marginal benefit factor throughout the optimization, assignment and settlement process. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends a number of market design changes to improve the performance of the Regulation Market, including use of a single clearing price based on actual LMP, modifications to the LOC calculation methodology, a software change to save some data elements necessary for verifying market outcomes, and further documentation of the implementation of the market design through SPREGO. (Priority: Medium. First reported 2010. Status: Partially adopted in 2012.)
- The MMU recommends that the lost opportunity cost in the ancillary services markets be calculated using the schedule on which the unit was scheduled to run in the energy market. (Priority: High. First reported 2010. Status: Partially Adopted.)

<sup>8</sup> Table 10-4 no longer includes the heading for "Supplemental Operating Reserve" costs. This heading included day-ahead and balancing operating reserve charges. These charges are accounted for in the Energy Uplift (Operating Reserves) section.

- The MMU recommends that the single clearing price for synchronized reserves be determined based on the actual LMP and not the forecast LMP. (Priority: Low. First reported 2010. Status: Adopted.)
- The MMU recommends that the rule requiring the payment of tier 1 synchronized reserve resources when the non-synchronized reserve price is above zero be eliminated immediately. (Priority: High. First reported 2013. Status: Not adopted. Stakeholder process.)
- The MMU recommends that no payments be made to tier 1 resources if they are deselected in the PJM market solution. The MMU also recommends that documentation of the Tier 1 synchronized reserve deselection process be published. (Priority: High. First reported 2014. Status: Adopted July 2014.)
- The MMU recommends that the tier 2 synchronized reserve must offer requirement be enforced. The MMU recommends that PJM define a set of acceptable reasons why a unit can be made unavailable daily or hourly and require operators to select a reason in Markets Gateway whenever making a unit unavailable. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM be explicit about why tier 1 biasing is used in the Tier 2 Synchronized Reserve Market. The MMU recommends that PJM define explicit rules for the use of tier 1 biasing during any phase of the market solution and identify the relevant rule for each instance of biasing. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM replace the DASR Market with a real-time secondary reserve product that is available and dispatchable in real time. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM revise the current confidentiality rules in order to specifically allow a more transparent disclosure of information regarding black start resources and their associated payments in PJM. (Priority: Low. First reported 2013. Status: Partially adopted, 2014.)
- The MMU recommends that the three pivotal supplier test and market power mitigation be incorporated in the DASR Market. (Priority: Low. First reported 2009. Status: Not adopted.)

- The MMU recommends that a reason code be attached to every hour in which PJM market operations adds additional DASR MW. (Priority: Medium. First reported 2015. Status: not adopted.)

## Conclusion

While the design of the Regulation Market was significantly improved with changes introduced October 1, 2012, a number of issues remain. The market results continue to include the incorrect definition of opportunity cost. The market design has failed to correctly incorporate the marginal benefit factor in optimization, pricing and settlement. The market design uses the marginal benefit factor in the optimization and pricing, but a mileage ratio in settlement. This failure to correctly incorporate marginal benefit factor into the regulation market design has resulted in both underpayment and overpayment of RegD resources and in the over procurement of RegD resources in some hours. These issues have led to the MMU's conclusion that the regulation market design is flawed.

The structure of each Tier 2 Synchronized Reserve Market has been evaluated and the MMU has concluded that these markets are not structurally competitive as they are characterized by high levels of supplier concentration and inelastic demand. As a result, these markets are operated with market-clearing prices and with offers based on the marginal cost of producing the service plus a margin. As a result of these requirements, the conduct of market participants within these market structures has been consistent with competition, and the market performance results have been competitive. However, compliance with calls to respond to actual synchronized reserve events has been an issue. The must offer requirement for tier 2 synchronized reserve has not been enforced.

The rule that requires payment of the tier 2 synchronized reserve price to tier 1 synchronized reserve resources when the non-synchronized reserve price is greater than zero, is inefficient and results in a substantial windfall payment to the holders of tier 1 synchronized reserve resources. Such tier 1 resources have no obligation to perform and pay no penalties if they do not perform. Tier 1 resources are paid for their response if they do respond. Such resources are not tier 2 resources, although they have the option to offer as tier 2, to

take on tier 2 obligations and to be paid as tier 2. If tier 1 resources wish to be paid as tier 2 resources, that option is available. Application of this rule added \$10.4 million to the cost of primary reserve in 2014, \$34.1 million to the cost of primary reserve in 2015, and \$1.75 million to the cost of primary reserve in the first three months of 2016.

The benefits of markets are realized under these approaches to ancillary service markets. Even in the presence of structurally noncompetitive markets, there can be transparent, market clearing prices based on competitive offers that account explicitly and accurately for opportunity cost. This is consistent with the market design goal of ensuring competitive outcomes that provide appropriate incentives without reliance on the exercise of market power and with explicit mechanisms to prevent the exercise of market power.

The MMU concludes that the regulation market results were competitive. The MMU concludes that the synchronized reserve market results were competitive. The MMU concludes that the DASR market results were competitive, although there is concern about offers above the competitive level affecting prices.

## Primary Reserve

PJM has an obligation to maintain 10 minute reserves (primary reserve) to ensure reliability in the event of disturbances. PJM's primary reserves are made up of resources, both synchronized and non-synchronized, that can provide energy within 10 minutes. Primary reserve is PJM's implementation of the NERC 10-minute contingency reserve requirement.<sup>9</sup> The NERC requirement is to carry sufficient contingency reserves to meet load requirements reliably and economically and provide reasonable protection against instantaneous load variations due to load forecasting error or loss of system capability due to generation malfunction.<sup>10</sup>

<sup>9</sup> PJM, OATT (effective 2/5/2014), p.1740; § 1.3.29 F Primary Reserve.

<sup>10</sup> NERC, IGVTF Task 2.4 Report; Operating Practices, Procedures, and Tools, March 2011, p. 20.

## Market Structure

### Supply

In the first three months of 2016, PJM's primary reserve requirement was 2,175 MW for the RTO Zone, and 1,700 MW for the MAD Subzone. It is satisfied by tier 1 synchronized reserves, tier 2 synchronized reserves and non-synchronized reserves, subject to the requirement that synchronized reserves equal 100 percent of the largest contingency. The synchronized reserve requirement is 1,450 MW in both the Mid-Atlantic Dominion Subzone, and the RTO Zone. After the synchronized reserve requirement is satisfied, the remainder of primary reserves can come from the least expensive combination of synchronized and non-synchronized reserves.

Estimated tier 1 is credited against PJM's primary reserve requirement. In the MAD Subzone an average of 1,160.6 MW of tier 1 was identified by the ASO market solution as available hour ahead (Table 10-6). This tier 1 reduced the amount of tier 2 and non-synchronized reserve needed to fill the synchronized reserve and primary reserve requirements. Tier 1 synchronized reserve fully satisfied the MAD Subzone synchronized reserve requirement in only 5.2 percent of hours in the first three months of 2016. In the RTO Zone, an average of 1,434.4 MW of tier 1 was available (Table 10-6). Tier 1 synchronized reserve fully satisfied the RTO Zone synchronized reserve requirement in 45.5 percent of all hours.

Regardless of online/offline state, all non-emergency generation capacity resources must submit a daily offer for tier 2 synchronized reserve in Markets Gateway prior to the offer submission deadline (1800 the day prior to the operating day). Offer MW and other non-cost offer details can be changed during the operating day. Owners are permitted to make resources unavailable for synchronized reserve daily or hourly but only if they are physically unavailable. Certain unit types including nuclear, wind, solar, and batteries, are expected to have zero MW tier 2 synchronized reserve offer quantities.<sup>11</sup>

<sup>11</sup> See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Revision 80 (March 31, 2016), p. 69.

After tier 1 is estimated, the remainder of the synchronized reserve requirement is met by tier 2. In the MAD Subzone, there was an average of 5,363.1 MW of offered tier 2 synchronized reserve available (Figure 10-11) to meet the average tier 2 hourly demand of 320.4 MW (Table 10-5). In the RTO Zone, there was an average of 13,609.1 MW of offered Tier 2 supply, available to meet the average hourly demand of 537.7 MW (Table 10-6).

In the MAD Subzone, there was an average of 1,768.7 MW of eligible non-synchronized reserve supply available to meet the average hourly demand of 287.6 MW (Table 10-5). In the RTO Zone, an hourly average of 2,288.0 MW supply was available to meet the average hourly demand of 357.5 MW (Table 10-6).

## Demand


PJM requires that 150 percent of the largest contingency on the system be maintained as primary reserve. Adjustments to this value can occur when grid maintenance or outages change the largest contingency or in cases of hot weather alerts or cold weather alerts.

On February 22, 2016, the default primary reserve requirement in the RTO Reserve Zone was raised from 2,175 MW to 3,195 MW for 14 hours. This was the only adjustment to the RTO Zone primary reserve requirement in the first three months of 2016. The hourly average RTO primary reserve requirement was 2,181.6 MW in the first three months of 2016. In the MAD Subzone, the primary reserve requirement remained at 1,700 MW for all hours in the first three months of 2016.

Transmission constraints limit the deliverability of reserves within the RTO, requiring the definition of the Mid-Atlantic Dominion (MAD) Subzone.<sup>12</sup> Of the 2,175 MW RTO primary reserve requirement, 1,700 MW (Table 10-15) must be deliverable to the MAD Subzone (Figure 10-1).

<sup>12</sup> Additional subzones may be defined by PJM to meet system reliability needs. PJM will notify stakeholders in such an event. See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Revision 78 (December 1, 2015), p. 69.

Figure 10-1 PJM RTO Zone and MAD Subzone geography: 2016

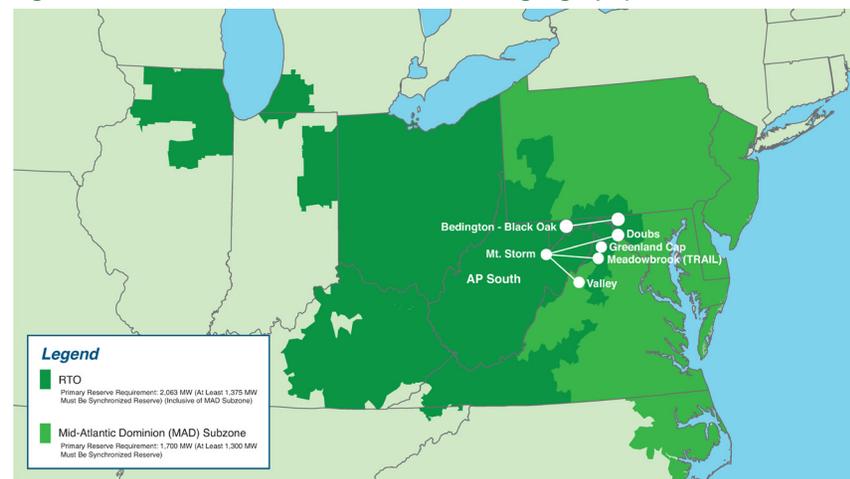

The Mid-Atlantic Dominion Reserve (MAD) Subzone is defined dynamically by the most limiting constraint separating MAD from the PJM RTO Reserve Zone. In 94.9 percent of hours in the first three months of 2016, that constraint was the Bedington – Black Oak Interface. The AP South transfer interface constraint was the limiting constraint in 5.1 percent of hours.

PJM requires that synchronized reserves equal at least 100 percent of the largest contingency. This means that 1,450 MW of the primary reserve requirement must be synchronized reserve for both RTO Reserve Zone and the Mid-Atlantic Dominion Reserve Subzone.

**Table 10-5 Average monthly tier 1 and tier 2 synchronized reserve, plus non-synchronized reserve used to satisfy the primary reserve requirement, MAD Subzone: January through March, 2016**

Year	Month	Tier 1 Total MW	Tier 2 Synchronized Reserve MW	Non-Synchronized Reserve MW
2016	Jan	1,263.5	228.5	295.9
2016	Feb	1,230.1	241.5	302.2
2016	Mar	993.3	485.7	265.7
2016	Average	1,162.3	318.6	287.9

**Table 10-6 Average monthly tier 1 and tier 2 synchronized reserve, and non-synchronized reserve used to satisfy the primary reserve requirement, RTO Zone: January through March, 2016**

Year	Month	Tier 1 Total MW	Tier 2 Synchronized Reserve MW	Non-Synchronized Reserve MW
2016	Jan	1,659.4	374.5	319.1
2016	Feb	1,564.1	411.4	329.4
2016	Mar	1,089.1	818.1	300.0
2016	Average	1,437.5	534.7	316.2

## Supply and Demand


The market solution software relevant to reserves consists of: the Ancillary Services Optimizer (ASO) solving hourly; the intermediate term security constrained economic dispatch market solution (IT-SCED) solving every 15 minutes; and the real-time (short term) security constrained economic dispatch market solution (RT-SCED) solving every five minutes.

The ASO jointly optimizes energy, synchronized reserves, and non-synchronized reserves based on forecast system conditions to determine the most economic set of reserve resources to commit for the upcoming operating hour (before the hour commitments). IT-SCED runs at 15 minute intervals and jointly optimizes energy and reserves given the ASO's inflexible unit commitments. IT-SCED estimates available tier 1 synchronized reserve and can commit additional reserves (flexibly or inflexibly) if its forecasts indicate a need. RT-SCED runs at five minute intervals and produces load forecasts up to 20 minutes ahead. The RT-SCED estimates the available tier 1 provides

a real-time ancillary services solution and can commit additional tier 2 resources (flexibly or inflexibly) if it forecasts a need.

Figure 10-2 illustrates how the ASO satisfies the primary reserve requirement (orange line) for the Mid-Atlantic Dominion Subzone. For the Mid-Atlantic Dominion Reserve Zone primary reserve solution the ASO must first satisfy the synchronized reserve requirement (yellow line) which is generally 1,450 MW in the MAD Subzone. Since the market solution considers tier 1 synchronized reserve to be zero cost, the ASO first estimates how much tier 1 synchronized reserve (green area) is available. If there is 1,450 MW of tier 1 available then ASO jointly optimizes synchronized reserve and non-synchronized reserve to assign the remaining primary reserve up to 1,700 MW. If there is not 1,450 MW of tier 1 then the remaining synchronized reserve requirement up to 1,450 MW is filled with tier 2 synchronized reserve (dark blue area). After 1,450 MW of synchronized reserve are assigned, the remaining 250 MW of the primary reserve requirement is filled by jointly optimizing synchronized reserve and non-synchronized reserve (light blue area). Since non-synchronized reserve is priced lower than or equal to synchronized reserve, almost all primary reserve between 1,450 MW and 1,700 MW is filled by non-synchronized reserve.

Figure 10-2 Mid-Atlantic Dominion Subzone primary reserve MW by source (Daily Averages): January through March, 2016

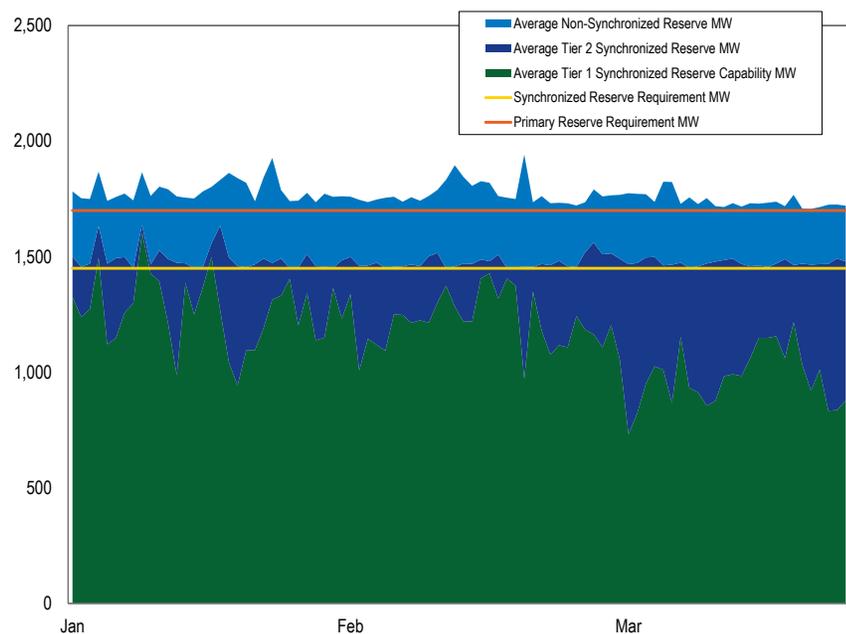

The solution methodology is similar for the RTO Reserve Zone (Figure 10-3) except that the required primary reserve MW is 2,175 MW.<sup>13</sup> Figure 10-3 shows how the hour ahead ASO satisfies the primary reserve requirement for the RTO Zone.

<sup>13</sup> Although tier 1 has a price of zero, changes made with shortage pricing on November 1, 2012, have given tier 1 a very high cost in some hours. This high cost raises questions about the economics of the solution methodology used by the ASO, IT-SCED, and RT-SCED market solutions which assume zero cost.

Figure 10-3 RTO Reserve Zone primary reserve MW by source (Daily Averages): January through March, 2016

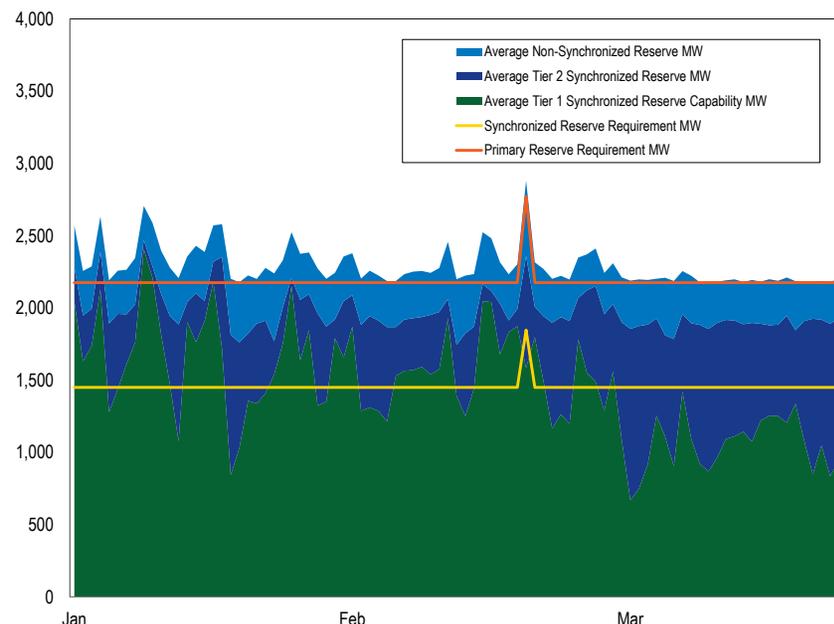


Figure 10-2 and Figure 10-3 show that tier 1 synchronized reserve remains the major contributor to satisfying the synchronized reserve requirements both in the RTO Zone and the Mid-Atlantic Dominion (MAD) Subzone.

### Price and Cost

There is a separate price and cost for each component of primary reserve. In the market solution, the cost of tier 1 synchronized reserves is zero except in defined circumstances, as there is no incremental cost associated with the ability to ramp up from the current economic dispatch point nor is there an obligation to ramp up during a synchronized reserve event. Tier 1 is credited when it responds to a synchronized reserve event. In addition, despite the absence of a performance obligation and an incremental cost to provide tier


1, PJM's current market rules require that tier 1 synchronized reserves be paid the tier 2 synchronized reserve market price in any hour that the non-synchronized reserve market clears with a price above \$0.

Under PJM's current market optimization approach, as available primary reserve approaches the primary reserve requirement the cost to serve the next MW of primary reserve is the non-synchronized reserve market clearing price (blue area in both Figure 10-2 and Figure 10-3).

In times of non-synchronized reserve shortage, the price of non-synchronized reserve will be capped at the currently effective penalty factor. The penalty factor is \$850 per MW. PJM will review the penalty factor annually.

Figure 10-4 shows daily average synchronized and non-synchronized market clearing prices in the first three months of 2016.

**Figure 10-4 Daily weighted average market clearing prices (\$/MW) for synchronized reserve and non-synchronized reserve: January through March, 2016**

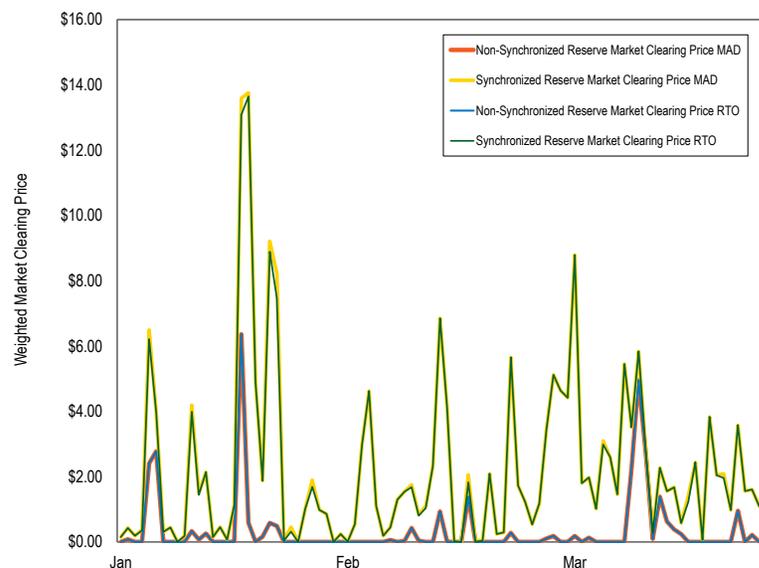

The cost of meeting PJM's primary reserve requirement (Figure 10-3) is shown in Table 10-7. Under most market conditions, most primary reserve identified by the hour ahead market solution is provided at no incremental cost by non-synchronized reserve and tier 1 synchronized reserve. The "Cost per MW" column is the total credits divided by the total MW of reserves. The "All-In Cost" column is the total credits paid divided by the load, or the total cost per MWh of energy to satisfy the primary reserve requirement.

**Table 10-7 MW credited, price, cost, and all-in price for primary reserve and its component products, RTO Reserve Zone: January through March 2016**

Product	Share of		Credits Paid	Price Per MW Reserve	Cost Per MW Reserve	All-In Cost
	Primary Reserve Requirement	MW Scheduled				
Tier 1 Synchronized Reserve Response	NA	1,410	\$110,952	NA	\$78.21	\$0.00
Tier 1 Synchronized Reserve	6.9%	182,588	\$1,753,468	\$0.00	\$9.60	\$0.01
Tier 2 Synchronized Reserve	17.5%	460,732	\$3,970,543	\$5.14	\$8.62	\$0.02
Non-synchronized Reserve	75.5%	1,984,238	\$477,002	\$0.24	\$1.22	\$0.00
Primary Reserve (total of above)	100.0%	\$2,628,968	\$6,311,965	\$0.46	\$2.40	\$0.03

## Tier 1 Synchronized Reserve

Tier 1 synchronized reserve is a component of primary reserve comprised of all on-line resources following economic dispatch and able to ramp up from their current output in response to a synchronized reserve event. The tier 1 synchronized reserve for a unit is measured as the lower of the available 10 minute ramp and the difference between the economic dispatch point and the economic maximum output. Tier 1 resources are identified by the market solution and the sum of their 10 minute availability equals available tier 1 synchronized reserve (green area of Figure 10-2 and Figure 10-3). Tier 1 synchronized reserve is the first element of primary reserve identified by the market software and is available at zero incremental cost unless called to respond to a synchronized reserve event or unless the non-synchronized reserve market clearing price is above \$0.

While PJM relies on tier 1 resources to respond to a synchronized reserve event, tier 1 resources are not financially obligated to respond during an event.

## Market Structure

### Supply

All generating resources operating on the PJM system with the exception of those assigned to tier 2 synchronized reserve are available for tier 1 synchronized reserve. Demand resources are not available for tier 1 synchronized reserve.

In the first three months of 2016, in the RTO Reserve Zone the average hourly estimated tier 1 synchronized reserve was 1,437.5 MW (Table 10-6). In 45.5 percent of hours, the estimated tier 1 synchronized reserve was greater than the primary reserve requirement, meaning that the primary reserve requirement was met entirely by tier 1 synchronized reserve.

In the first three months of 2016, in the MAD Reserve Subzone the average hour ahead estimated tier 1 synchronized reserve was 1,160.6 MW (Table 10-5). In 5.2 percent of hours, the estimated tier 1 synchronized reserve was greater than the subzone requirement for synchronized reserve and no Tier 2 Synchronized Reserve Market was needed.

**Table 10-8 Monthly average market solution Tier 1 Synchronized Reserve (MW) identified hourly, January through March, 2016**

Mid-Atlantic Dominion Reserve Subzone						
Year	Month	Average Hourly Tier 1 Local to MAD	Synchronized Reserve Available from RTO	Average Hourly Tier 1 Used	Minimum Hourly Tier 1 Used	Maximum Hourly Tier 1 Used
2016	Jan	709.2	554.3	1,263.5	498.2	2,749.8
2016	Feb	649.0	581.1	1,230.1	437.7	2,257.2
2016	Mar	418.3	574.9	993.3	260.1	2,854.3
2016	Average	592.2	570.1	1,162.3	398.7	2,620.4

RTO Reserve Zone						
Year	Month	Average Hourly Tier 1 Local to MAD	Synchronized Reserve Available from RTO	Average Hourly Tier 1 Used	Minimum Hourly Tier 1 Used	Maximum Hourly Tier 1 Used
2016	Jan	N/A	N/A	1,659.4	0.0	3,954.1
2016	Feb	N/A	N/A	1,564.1	295.9	3,417.4
2016	Mar	N/A	N/A	1,089.1	197.4	3,681.3
2016	Average	N/A	N/A	1,437.5	164.4	3,684.3

### Demand

There is no fixed required amount of tier 1 synchronized reserve. The tier 1 synchronized reserve for each on-line resource is estimated from its synchronized reserve ramp rate as part of each market solution and not assigned. Given estimated tier 1, the market software (ASO) completes the primary reserve assignments under the assumption that the estimated tier 1 will be available if needed. The ancillary services market solution treats the cost of estimated tier 1 synchronized reserve as \$0, even when the non-synchronized reserve market clearing price is above \$0.

Beginning January 2015, DGP (Degree of Generator Performance) was introduced as a metric to improve the accuracy of the tier 1 MW estimate used by the market solution. DGP is calculated for all on-line resources for each market solution. DGP measures how closely the unit has been following economic dispatch for the past thirty minutes and the available tier 1 MW for that resource is adjusted by the DGP. In May 2015, PJM began communicating to generation operators whose tier 1 MW are part of the market solution the latest estimate of units' tier 1 MW and units' current resource specific DGP.<sup>14</sup>

For the first three months of 2016, PJM estimated tier 1 MW for an average of 131 units as part of the solution each hour. The average DGP was 86.3 percent for those 131 units.

### Supply and Demand


When solving for the synchronized reserve requirement the market solution first subtracts the amount of self-scheduled synchronized reserve from the requirement and then estimates the amount of tier 1. To improve its tier 1 estimates, PJM deselects certain resources from the tier 1 estimate. Tier 1 deselection is based on unit type, location and daily grid conditions.

In the MAD Subzone, the market solution takes all tier 1 MW estimated to be available within the MAD Subzone (gray area of Figure 10-5). It then adds the tier 1 MW estimated to be available within the MAD Subzone from the RTO

<sup>14</sup> PJM. Ancillary Services, "Communication of Synchronized Reserve Quantities to Resource Owners," <<http://www.pjm.com/~media/markets-ops/ancillary/communication-of-synchronized-reserve-quantities-to-resource-owners.ashx>> (May 6, 2015).

Zone (green area of Figure 10-5) up to the synchronized reserve requirement. If the total tier 1 synchronized reserve is less than the synchronized reserve requirement, the remainder of the synchronized reserve requirement is filled with tier 2 synchronized reserve (white area below the synchronized reserve required line in Figure 10-5).

**Figure 10-5 Daily average tier 1 synchronized reserve supply (MW) in the MAD Subzone: January through March 2016**

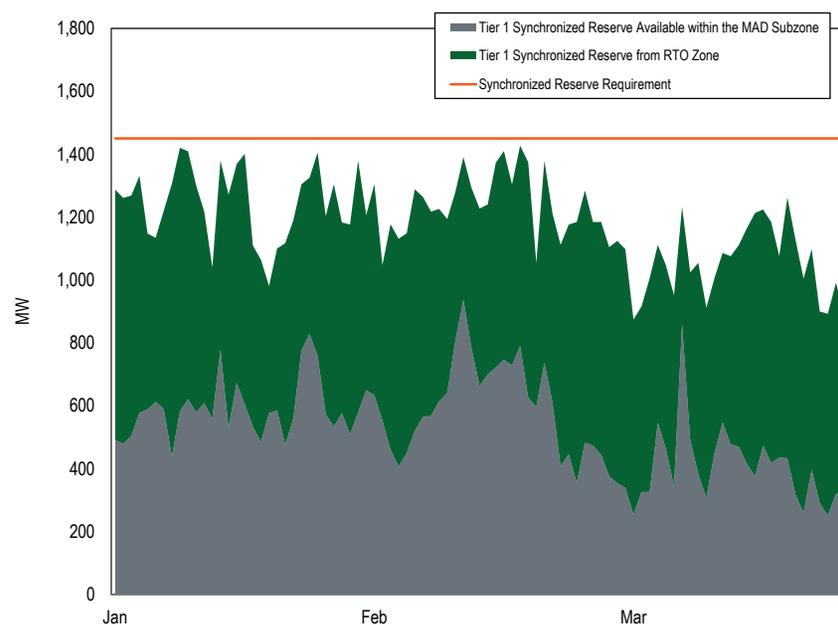

Demand for synchronized reserve in the RTO Zone January through March 2016, was 1,454.4 MW. There was a temporary increase in the hourly synchronized reserve requirement to 2,130 MW on February 22, 2016 because of an emergency outage.

## Tier 1 Synchronized Reserve Event Response

Tier 1 synchronized reserve is awarded credits when a synchronized reserve event occurs and it responds. These synchronized reserve event response credits for tier 1 response are independent of the tier 1 estimated, independent of the synchronized reserve market clearing price, and independent of the non-synchronized reserve market clearing price. Credits are awarded to tier 1 synchronized reserve resources equal to the increase in MW output (or decrease in MW consumption for demand resources) for each five minute interval times the five minute LMP plus \$50 per MW. During a synchronized reserve event, tier 1 credits are awarded to all units that increase their output during the event regardless of their estimated tier 1 MW, or tier 1 deselection status at market clearing time. Only units that have cleared the tier 2 market are not awarded tier 1 credits for increasing their output.

In the first three months of 2016, tier 1 synchronized reserve synchronized reserve event response credits of \$110,952 were paid for 1,405.8 MWh of tier 1 response at an average cost per MWh of \$78.92, for three spinning events (Table 10-9).

Table 10-9 Tier 1 synchronized reserve event response costs: January 2015 through March 2016

Year	Month	Total Tier 1		Tier 1 Synchronized		Average Tier 1 MW Response
		Synchronized Reserve Event Response Hours	Synchronized Reserve Event Response MW	Synchronized Reserve Event Response Credits	Reserve Event Response Cost	
2015	Jan	1	397.3	\$8,198	\$20.64	397.3
2015	Feb	2	218.3	\$9,634	\$44.13	109.2
2015	Mar	4	2,445.8	\$105,505	\$43.14	611.4
2015	Apr	5	1,398.9	\$69,399	\$49.61	279.8
2015	May	0	NA	NA	NA	NA
2015	Jun	0	NA	NA	NA	NA
2015	Jul	1	502.2	\$25,540	\$50.86	502.2
2015	Aug	2	648.3	\$7,730	\$11.92	324.1
2015	Sep	3	678.5	\$30,077	\$44.33	226.2
2015	Oct	0	NA	NA	NA	NA
2015	Nov	2	252.9	\$15,914	\$62.92	126.5
2015	Dec	2	602.9	\$79,215	\$131.39	301.4
2015	Total	22	7,145.0	\$351,212	\$50.99	319.8
2016	Jan	2	730.8	\$70,330	\$96.24	730.8
2016	Feb	2	675.1	\$40,622	\$60.17	337.5
2016	Mar	0	NA	NA	NA	NA
2016	Total	4	1405.9	\$110,952	\$78.21	\$534.15

### Paying Tier 1 the Tier 2 Price

The market solutions correctly treat tier 1 synchronized reserve as having zero marginal cost. The price for tier 1 synchronized reserves is zero as there is no incremental cost associated with providing the ability to ramp up from the current economic dispatch point. When called to respond to a spinning event tier 1 is compensated at the Synchronized Energy Premium Price (Table 10-12). However, the shortage pricing tariff changes (October 1, 2012) modified the pricing of tier 1 so that tier 1 synchronized reserve is paid the tier 2 synchronized reserve market clearing price whenever the non-synchronized reserve market clearing price rises above zero. The rationale for this change was and is unclear but it has had a significant impact on the cost of tier 1 synchronized reserves. The non-synchronized reserve market clearing price was above \$0.00 in 120 hours in the first three months of 2016. For those 120 hours, tier 1 synchronized reserve resources were paid a weighted average synchronized reserve market clearing price of \$9.60 per MW and earned \$1,753,468 in credits. In all of 2015, PJM paid \$34,135,671 in credits for tier 1 estimated during the 1,089 hours when the non-synchronized reserve market clearing price was above \$0.

**Table 10-10 Weighted price of tier 1 synchronized reserve attributable to a non-synchronized reserve price above zero: January 2015 to March 2016**

Year	Month	Total Hours When NSRMCP>\$0	Weighted Average SRMCP for Hours When NSRMCP>\$0	Total Tier 1 MW Credited for Hours When NSRMCP>\$0	Total Tier 1 Credits Paid When NSRMCP>\$0	Average Tier 1 MW Paid
2015	Jan	148	\$13.59	274,996	\$3,727,945	1,858.1
2015	Feb	194	\$24.83	369,111	\$9,164,267	1,902.6
2015	Mar	181	\$16.33	305,967	\$4,985,446	1,690.4
2015	Apr	66	\$25.56	102,117	\$2,587,076	1,547.2
2015	May	72	\$20.35	106,027	\$2,158,080	1,472.6
2015	Jun	95	\$17.64	185,148	\$3,183,436	1,948.9
2015	Jul	46	\$35.12	64,516	\$2,265,614	1,402.5
2015	Aug	38	\$22.40	48,479	\$1,078,199	1,275.8
2015	Sep	36	\$31.53	51,968	\$1,522,913	1,060.5
2015	Oct	113	\$17.10	126,879	\$2,169,670	1,122.8
2015	Nov	29	\$14.65	29,156	\$427,056	1,005.4
2015	Dec	51	\$16.07	53,898	\$865,969	1,005.4
Total	Total	1,069	\$21.26	1,718,263	\$34,135,671	1,441.0
2016	Jan	37	\$15.22	57,571	\$876,367	1,556.0
2016	Feb	14	\$9.42	24,752	\$233,208	1,768.0
2016	Mar	69	\$6.42	100,265	\$643,893	1,453.1
2016	Total	120	\$9.60	182,588	\$1,753,468	1,592.4

The additional payments to tier 1 synchronized reserves under the shortage pricing rule can be considered a windfall. The additional payment does not create an incentive to provide more tier 1 synchronized reserves. The additional payment is not a payment for performance as all estimated tier 1 receives the payment regardless of whether they provided any response during any spinning event. Tier 1 resources are not obligated to respond to synchronized reserve events. In the first three months of 2016, 68.2 percent of the market solution's estimated tier 1 resources MWh actually responded during synchronized reserve events of greater than 10 minutes. Total response however, including resources that were not part of the tier 1 estimate amounted to 127.0 percent of the original tier 1 estimate. Thus, 31.8 percent of tier 1 resource estimated MW do not respond during spinning events but are paid the Tier 2 price for their full estimated MW when the non-synchronized reserve price is greater than zero. Tier 2 synchronized reserve resources are paid the market clearing price for tier 2 because they stand ready to respond

and incur costs to do so, have an obligation to perform and pay penalties for nonperformance.

When the next MW of non-synchronized reserve (NSR) required to satisfy the primary reserve requirement increases in price from \$0.00 per MW to \$0.01 per MW, the cost of all tier 1 MW increases significantly.

In the first three months of 2016, tier 1 MW were paid \$110,952 for responding to synchronized reserve events. Tier 1 synchronized reserve was paid \$1.75 million simply because the NSRMCP was greater than \$0.00 (Table 10-11).

**Table 10-11 Dollar impact of paying tier 1 synchronized reserve the SRMCP when the NSRMCP goes above \$0: January 2015 through March 2016**

Synchronized Reserve Events					Hours When NSRMCP > \$0		
Year	Month	Total MWh	Total Credits	Average MWh Per Event	Total MW	Total Credits	Average MW Per Hour
2015	Jan	397	\$8,198	397	274,996	\$3,727,945	1,858
2015	Feb	218	\$9,634	109	369,111	\$9,164,267	1,903
2015	Mar	2,446	\$105,505	611	305,967	\$4,985,446	1,690
2015	Apr	1,399	\$69,399	280	102,117	\$2,587,076	1,547
2015	May	0	\$0	0	106,027	\$2,158,080	1,473
2015	Jun	0	\$0	0	182,417	\$3,183,436	1,961
2015	Jul	502	\$25,540	502	64,516	\$2,265,615	1,403
2015	Aug	648	\$7,730	324	48,479	\$1,078,199	1,276
2015	Sep	678	\$30,077	226	51,968	\$1,522,913	1,061
2015	Oct	0	\$0	0	126,879	\$2,169,670	1,123
2015	Nov	253	\$15,914	126	29,156	\$427,056	1,005
2015	Dec	603	\$79,215	301	53,898	\$865,969	1,054
2015	Total	7,145	\$351,212	320	1,715,532	\$34,135,671	1,446
2016	Jan	731	\$70,330	731	57,571	\$876,367	1,556
2016	Feb	675	\$40,622	338	24,752	\$233,208	1,768
2016	Mar	NA	NA	NA	100,265	\$643,893	1,453
2016	Total	1,406	\$110,952	534	182,588	\$1,753,468	1,592

The MMU recommends that the rule requiring the payment of tier 1 synchronized reserve resources when the non-synchronized reserve price is above zero be eliminated immediately.<sup>15</sup> Tier 1 should be compensated only for a response to synchronized reserve events, as it was before the shortage pricing changes. This compensation requires that when a synchronized reserve event is called, all tier 1 response is paid the average of five-minute LMPs during the event, rather than hourly integrated LMP, plus \$50/MW, termed the Synchronized Energy Premium Price.

PJM’s current tier 1 compensation rules are presented in Table 10-12.

<sup>15</sup> This recommendation was presented as a proposal, “Tier 1 Compensation,” to the Markets and Reliability Committee Meeting, October 22, 2015. The MMU proposal and a PJM counterproposal were both rejected.

**Table 10-12 Tier 1 compensation as currently implemented by PJM**

Tier 1 Compensation by Type of Hour as Currently Implemented by PJM		
Hourly Parameters	No Synchronized Reserve Event	Synchronized Reserve Event
NSRMCP=\$0	T1 credits = \$0	T1 credits = Synchronized Energy Premium Price * actual response MWh
NSRMCP>\$0	T1 credits = T2 SRMCP * estimated tier 1 MW	T1 credits = T2 SRMCP * min(calculated tier 1 MW, actual response MWh)

The MMU’s recommended compensation rules for tier 1 MW are in Table 10-13.

**Table 10-13 Tier 1 compensation as recommended by MMU**

Tier 1 Compensation by Type of Hour as Recommended by MMU		
Hourly Parameters	No Synchronized Reserve Event	Synchronized Reserve Event
NSRMCP=\$0	T1 credits = \$0	T1 credits = Synchronized Energy Premium Price * actual response MWh
NSRMCP>\$0	T1 credits = \$0	T1 credits = Synchronized Energy Premium Price * actual response MWh

### Tier 1 Estimate Bias

PJM’s market solution engines allow the dispatcher to bias the synchronized reserve solution by forcing the engine to assume a different tier 1 MW value than it estimates. PJM no longer allows dispatchers to use tier 1 biasing in the intermediate and real time SCED solutions but tier biasing can be used in the hour ahead solution, ASO. Biasing means manually modifying (increasing or decreasing) the tier 1 synchronized reserve estimate of the market solution. This forces the market clearing engine to clear more or less tier 2 synchronized reserve and non-synchronized reserve to satisfy the synchronized reserve and primary reserve requirements than the market solution.

PJM uses tier 1 estimate biasing in the MAD Subzone of the ASO market solution (Table 10-14). Tier 1 biasing is not used in any IT-SCED solutions.

Table 10–14 ASO tier 1 estimate biasing, January 2014 through March, 2016

Year	Month	Number of Hours Biased Negatively	Average Negative Bias (MW)	Number of Hours Biased Positively	Average Positive Bias (MW)
2014	Jan	13	(1,419.2)	2	250.0
2014	Feb	36	(1,036.1)	1	100.0
2014	Mar	37	(1,281.1)	4	500.0
2014	Apr	32	(1,387.5)	0	0.0
2014	May	23	(909.8)	0	0.0
2014	Jun	17	(1,179.4)	3	666.7
2014	Jul	36	(1,011.1)	0	0.0
2014	Aug	31	(891.9)	1	750.0
2014	Sep	15	(1,206.7)	0	0.0
2014	Oct	67	(1,285.8)	1	500.0
2014	Nov	190	(1,134.7)	6	475.0
2014	Dec	166	(1,226.2)	1	300.0
2014	Total	663	(1,164.1)	19	295.1
2015	Jan	51	(1,731.4)	6	500.0
2015	Feb	62	(1,641.1)	0	0.0
2015	Mar	25	(794.0)	3	1,000.0
2015	Apr	31	(430.7)	0	0.0
2015	May	46	(582.6)	8	812.5
2015	Jun	25	(694.0)	1	1,000.0
2015	Jul	9	(588.9)	0	0.0
2015	Aug	1	(750.0)	1	750.0
2015	Sep	4	(475.0)	1	2,000.0
2015	Oct	24	(979.2)	0	0.0
2015	Nov	0	0.0	62	515.3
2015	Dec	1	(500.0)	59	549.2
2015	Total	279	(763.9)	141	593.9
2016	Jan	21	(628.6)	64	1,104.7
2016	Feb	27	(617.6)	12	762.5
2016	Mar	1	(300.0)	28	732.1
2016	Total	49	(515.4)	104	866.4

Tier 1 biasing is not mentioned in the PJM manuals and does not appear to be defined in any public document. PJM dispatchers use tier 1 biasing to compensate for uncertainty in short-term load forecasting, generator performance, or uncertainty in the accuracy of the market solution's tier 1 estimate. Tier 1 estimate biasing directly affects the required amount of tier 2 and therefore the market results both for tier 2 synchronized reserve and for non-synchronized reserve.

The MMU recommends that PJM be more explicit about why tier 1 biasing is used in the optimized solution to the Tier 2 Synchronized Reserve Market. The MMU recommends that PJM define rules for estimating available tier 1 MW and for the use of biasing during any phase of the market solution and then identify the relevant rule for each instance of biasing.

## Tier 2 Synchronized Reserve Market

Synchronized reserve is energy or demand reduction synchronized to the grid and capable of increasing output or decreasing load within 10 minutes. Synchronized reserve is of two distinct types, tier 1 and tier 2. Tier 2 synchronized reserve is primary reserve (10 minute availability) that must be dispatched in order to satisfy the synchronized reserve requirement. When the synchronized reserve requirement cannot be filled with tier 1 synchronized reserve, PJM clears a market to satisfy the requirement with tier 2 synchronized reserve.

PJM operates a Tier 2 Synchronized Reserve Market in both the RTO Synchronized Reserve Zone and the Mid-Atlantic Dominion Reserve Subzone. Market solutions provided by the ASO, IT-SCED and RT-SCED first estimate the amount of tier 1 synchronized reserve available from the current economic dispatch and subtract that amount from the synchronized reserve requirement to determine how much tier 2 synchronized reserve is needed. Tier 2 synchronized reserve is provided by on-line resources, either synchronized to the grid but not producing energy, or dispatched to provide synchronized reserve at an operating point below their economic dispatch point. Tier 2 synchronized reserve is also provided by demand resources that have offered to reduce load in the event of a synchronized reserve event. Tier 2 synchronized reserves are committed to be available in the event of a synchronized reserve event.

Tier 2 synchronized reserve resources may be inflexible for two reasons, the nature of the resource or if they are committed in the hour ahead for the full operating hour. Some resource types can only be committed by the ASO prior to the operational hour and require an hourly commitment due to

physical limitations or market rules. Resources with hour ahead commitment requirements include synchronous condensers operating solely for the purpose of providing synchronized reserves and demand response that has qualified to act as synchronized reserves. Tier 2 resources are scheduled by the ASO sixty minutes before the operating hour, are committed to provide synchronized reserve for the entire hour, and are paid the higher of the SRMCP or their offer price plus lost opportunity cost (LOC). Demand response resources are paid SRMCP. Due to the hour long commitment that comes with the hour ahead ASO assignment, tier 2 synchronized reserve resources committed by the hour ahead market solution are flagged by the system software as inflexible resources, so they cannot be released for energy for the duration of the operational hour.

During the operating hour, the IT-SCED and the RT-SCED market solutions have the ability to dispatch additional resources flexibly depending on the current forecast need for synchronized reserve. A flexible commitment is one in which the IT-SCED or RT-SCED redispaches generating resources to meet the synchronized and primary reserve requirements within the operational hour.

## Market Structure

### Supply

All non-emergency generating resources are required to submit tier 2 synchronized reserve offers. All online, non-emergency generating resources are deemed available to provide both tier 1 and tier 2 synchronized reserve. If PJM issues a primary reserve warning, voltage reduction warning, or manual load dump warning, all off line non-emergency generation capacity resources available to provide energy must submit an offer for tier 2 synchronized reserve.<sup>16</sup>

In the first three months of 2016, the Mid Atlantic Dominion Reserve Subzone averaged 5,340.6 MW of synchronized reserve offers, and the RTO Reserve

Zone averaged 13,446.9 MW of synchronized reserve offers (Figure 10-11) of which 1,496.9 MW was demand response.

The supply of tier 2 synchronized reserve in January through March 2016 was sufficient to cover the requirement in both the RTO Reserve Zone and the Mid-Atlantic Dominion Reserve Subzone.

The largest portion of cleared tier 2 synchronized reserve in 2016 is from CTs (Figure 10-6) 49.1 percent of all tier 2 synchronized reserve MW. Demand Resources (DR) remain a significant part of market scheduled tier 2 synchronized reserve. Although demand resources are limited to 33 percent of the total synchronized reserve requirement, the amount of tier 2 synchronized reserve required in any hour is often much less than the full synchronized reserve requirement because so much of it is met with tier 1 synchronized reserve. The DR MW share of the total cleared Tier 2 Synchronized Reserve Market was 21.0 percent in the first three months of 2016.<sup>17</sup> This is an increase from the 15.3 percent share of the tier 2 market in the first three months of 2015.

<sup>16</sup> See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Revision 79 (December 17, 2015), p. 66.

<sup>17</sup> The cap on demand response participation is defined in MW terms. There is no cap on the proportion of cleared demand response consistent with the MW cap.

Figure 10-6 Cleared tier 2 synchronized reserve average hourly MW per hour by unit type, RTO Zone: January 2015 through March 2016


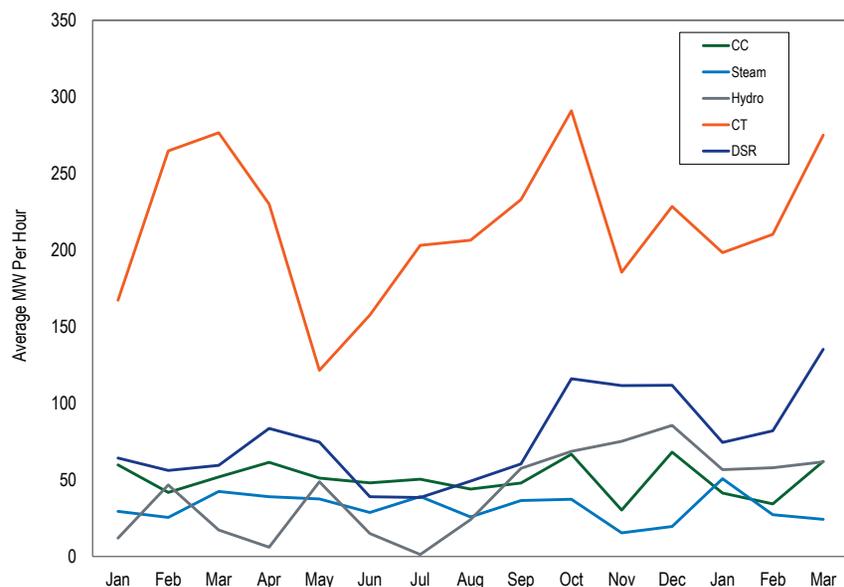


Figure 10-7 provides the average hourly cleared tier 2 MW by unit type by tier 2 clearing price range (SRMCP).

Figure 10-7 Average hourly tier 2 MW by unit type by SRMCP Range: January through March 2016

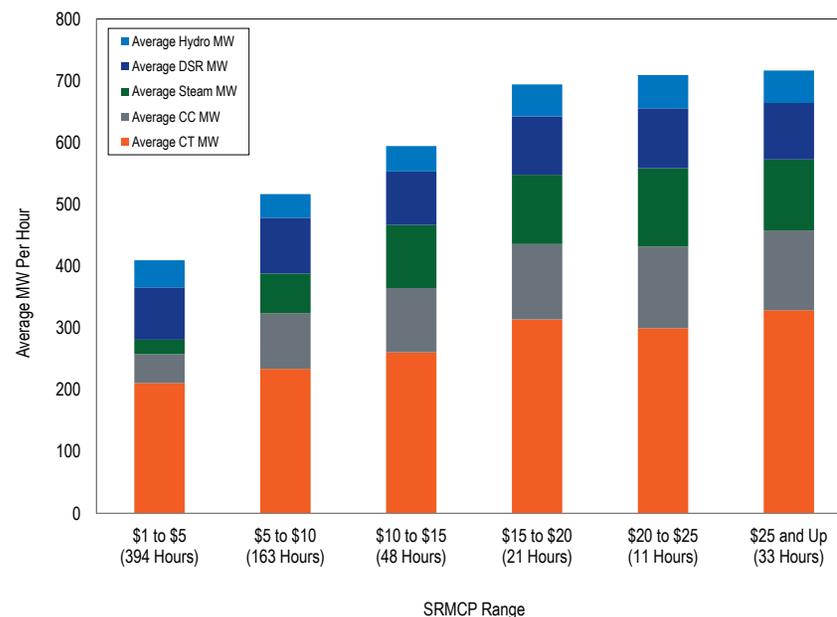

### Demand

Effective January 8, 2015, the default synchronized reserve requirement was set at 1,450 MW in both the Mid-Atlantic Dominion Subzone and the RTO Zone (Table 10-15). There are two circumstances in which PJM may alter the synchronized reserve requirement from its default value. When PJM operators anticipate periods of heavy load, they may bring on additional units to account for increased operational uncertainty in meeting load. When a Hot Weather Alert, Cold Weather Alert or an escalating emergency procedure (as defined in Manual 11 § 4.2.2 Synchronized Reserve Requirement Determination) has been issued for the operating day, operators may increase the synchronized reserve requirement up to the full amount of the additional MW brought online.<sup>18</sup> The synchronized reserve requirement was temporarily increased for the RTO Zone on February 22, 2016 for a 14 hour period to 2,130 MW.


<sup>18</sup> PJM. "Manual 11: Energy & Ancillary Services Market Operations," Revision 79 (December 17, 2015) pp. 70.

**Table 10–15 Default Tier 2 Synchronized Reserve Markets required MW, RTO Zone and Mid-Atlantic Dominion Subzone**

Mid-Atlantic Dominion Subzone			RTO Synchronized Reserve Zone		
From Date	To Date	Required MW	From Date	To Date	Required MW
May 10, 2008	May 8, 2010	1,150	May 10, 2008	Jan 1, 2009	1,305
May 8, 2010	Jul 13, 2010	1,200	Jan 1, 2009	Mar 15, 2010	1,320
July 13, 2010	Jan 1, 2015	1,300	Mar 15, 2010	Nov 12, 2012	1,350
Jan 1, 2015	Jan 8, 2015	1,342	Nov 12, 2012	Jan 8, 2015	1,375
Jan 8, 2015		1,450	Jan 8, 2015		1,450

PJM may also temporarily change the synchronized reserve requirement from its default value when grid maintenance or outages change the largest contingency. Figure 10–8 shows monthly average actual synchronized reserve requirements and the default synchronized reserve requirements. In the first three months of 2015, there were no increases in the synchronized reserve requirement as a result of a grid outage or maintenance contingency.

**Figure 10–8 Monthly average actual vs default synchronized reserve requirements, RTO Zone and MAD Subzone: January 2015 through March 2016**

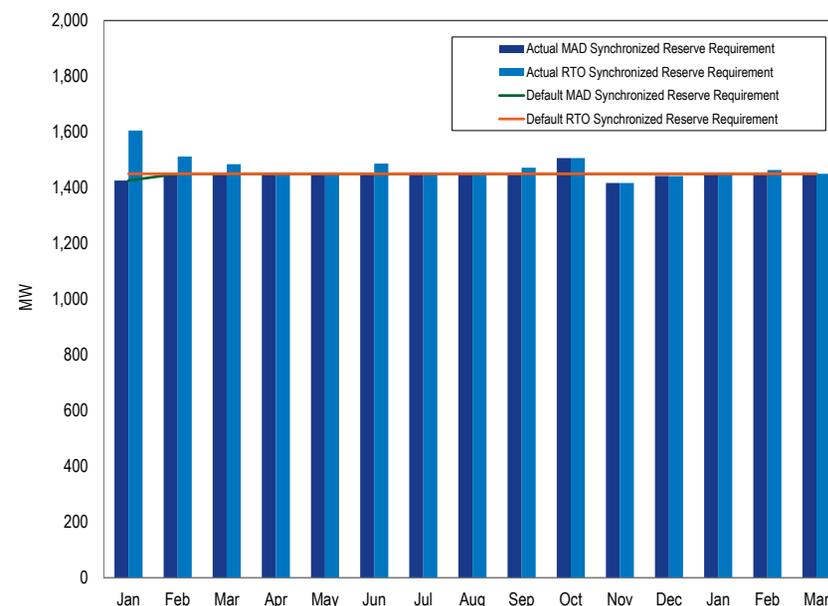


The market demand for tier 2 synchronized reserve in the Mid-Atlantic Dominion Subzone is determined by subtracting the amount of forecast tier 1 synchronized reserve available in the subzone from the subzone requirement each five-minute period. Market demand is also reduced by subtracting the amount of self-scheduled tier 2 resources.


In both the RTO Reserve Zone and the MAD Subzone, 99.1 percent of hours cleared a Tier 2 Synchronized Reserve Market in the first three months of 2016. The RTO averaged 557.1 MW total, of which 258.6 MW was in the MAD Subzone.

Figure 10-9 and Figure 10-10 show the average monthly synchronized reserve required and the average monthly tier 2 synchronized reserve MW scheduled in January 2015 through March 2016, for the RTO Reserve Zone and MAD Reserve Subzone.

**Figure 10-9 Mid-Atlantic Dominion reserve subzone monthly average synchronized reserve required vs. tier 2 synchronized reserve scheduled MW: January 2015 through March 2016**

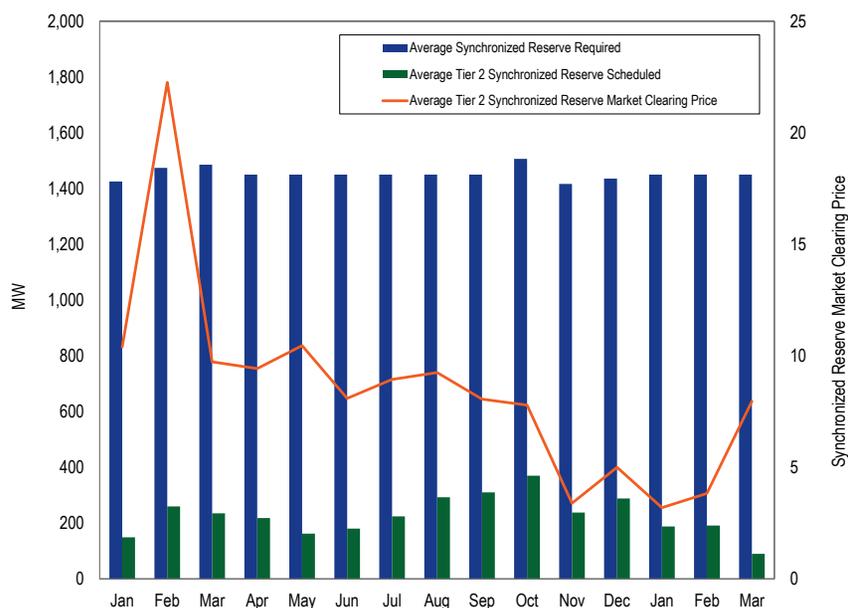

**Figure 10-10 RTO reserve zone monthly average synchronized reserve required vs. tier 2 synchronized reserve scheduled MW: January 2015 through March 2016**

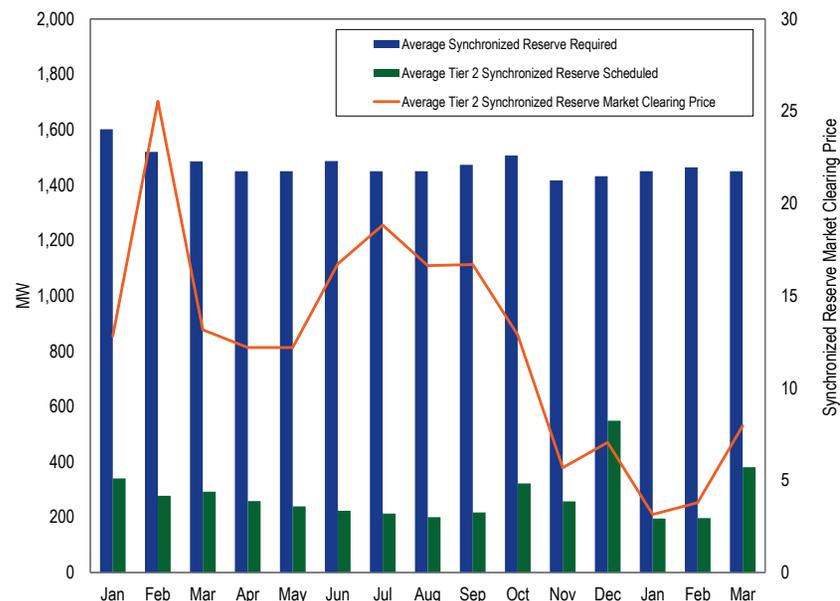

### Market Concentration

The HHI for settled tier 2 synchronized reserve during cleared hours of the Mid-Atlantic Dominion Subzone Tier 2 Synchronized Reserve Market for the first three months of 2016 is was 5963, which is defined as highly concentrated. This is an increase from the 5705 HHI during the same time period of 2015. The largest hourly market share was 100 percent and 90.8 percent of all cleared hours had a maximum market share greater than or equal to 40 percent.

The HHI for settled tier 2 synchronized reserve during cleared hours of the RTO Zone Tier 2 Synchronized Reserve Market for the first three months of 2016 was 5161, which is defined as highly concentrated. This is an increase from

the 4886 HHI during the same time period of 2015. The largest hourly market share was 100 percent and 69.1 percent of cleared hours had a maximum market share greater than or equal to 40 percent.

In the MAD Subzone, flexible synchronized reserve was 0.7 percent of all tier 2 synchronized reserve in the first three months of 2016. In the RTO Zone, flexible synchronized reserve assigned was 1.2 percent of all tier 2 synchronized reserve during the same period.

The MMU calculates that 69.9 percent of hours failed the three pivotal supplier test in the MAD Subzone in the first three months of 2016 for the inflexible Synchronized Reserve Market (excluding self-scheduled synchronized reserve) in the hour ahead market (Table 10-16) and 47.3 percent of hours failed a three pivotal supplier test in the RTO Zone during the same time period.

**Table 10-16 Three pivotal supplier test results for the RTO Zone and MAD Subzone: January 2015 through March 2016**

Year	Month	Mid Atlantic Dominion Reserve Subzone Pivotal Supplier Hours	RTO Reserve Zone Pivotal Supplier Hours
2015	Jan	46.0%	34.2%
2015	Feb	87.0%	29.9%
2015	Mar	42.0%	45.2%
2015	Apr	31.1%	48.4%
2015	May	61.2%	45.3%
2015	Jun	39.2%	26.5%
2015	Jul	32.0%	25.0%
2015	Aug	32.3%	24.9%
2015	Sep	56.1%	23.5%
2015	Oct	81.5%	57.9%
2015	Nov	73.2%	49.3%
2015	Dec	87.7%	73.2%
2015	Average	55.8%	40.3%
2016	Jan	52.8%	43.1%
2016	Feb	71.9%	39.6%
2016	Mar	84.9%	59.1%
2016	Average	69.9%	47.3%

The market structure results indicate that the RTO Zone and Mid-Atlantic Dominion Subzone Tier 2 Synchronized Reserve Markets are not structurally competitive.

## Market Behavior


### Offers

Daily cost based offer prices are submitted for each unit by the unit owner. For generators the offer price must include tier 1 synchronized reserve ramp rate, a tier 1 synchronized reserve maximum, self-scheduled status, synchronized reserve availability, synchronized reserve offer quantity (MW), tier 2 synchronized reserve offer price, energy use for tier 2 condensing resources (MW), condense to gen cost, shutdown costs, condense startup cost, condense hourly cost, condense notification time, and spin as a condenser status (a field to identify if a running CT can be dispatched for synchronized reserve). The synchronized reserve offer price made by the unit owner is subject to an offer cap of marginal cost plus \$7.50 per MW. All suppliers are paid the higher of the market clearing price or their offer plus their unit specific opportunity cost. The offer quantity is limited to the economic maximum or less if a spin maximum value is less than economic maximum is supplied (subject to prior authorization by PJM). PJM monitors this offer by checking to ensure that all offers are greater than or equal to 90 percent of the resource's ramp rate times 10 minutes. A resource that is unable to participate in the synchronized reserve market during a given hour may set its hourly offer to 0 MW. A resource that cannot reliably provide synchronized reserve may offer 0 MW, e.g. nuclear, wind, solar, and batteries.

Figure 10-11 shows the daily average of hourly offered tier 2 synchronized reserve MW for both the RTO Synchronized Reserve Zone and the Mid-Atlantic Dominion Synchronized Reserve Subzone. In the first three months of 2016, the ratio of online and eligible tier 2 synchronized reserve to synchronized reserve required in the Mid-Atlantic Dominion Subzone was 5.36 averaged over all hours. For the RTO Synchronized Reserve Zone the ratio was 6.98.

On October 1, 2012, PJM adopted a must offer requirement for tier 2 synchronized reserve for all generation that is online, non-emergency, and physically able to operate with an output less than dictated by economic dispatch. Tier 2 synchronized reserve offers are made on a daily basis with hourly updates permitted. Daily offers can be changed as a result of maintenance status or physical limitations only and are required regardless of online/offline state.<sup>19</sup> Daily offer levels are stable and consistent over time. The Tier 2 Synchronized Reserve Market is not solved from daily offers but based on hourly updates to the daily offers. As a result of hourly updates the actual amount of eligible tier 2 MW can change significantly every hour (Figure 10-11). Changes to hourly eligibility levels are the result of on-line status, minimum/maximum runtimes, minimum notification times, maintenance status and grid conditions including constraints. But changes to the hourly offer status are only permitted when resources are physically unable to provide tier 2. Resource operators can make their units unavailable for an hour or block of hours via the Markets Gateway unavailable option without having to provide a reason. This means that while compliance with the must offer requirement can be done daily it is not possible to verify compliance with the tier 2 must offer requirement on an hourly basis.

**Figure 10-11 Tier 2 synchronized reserve hourly offer and eligible volume (MW), averaged daily: January through March, 2016**

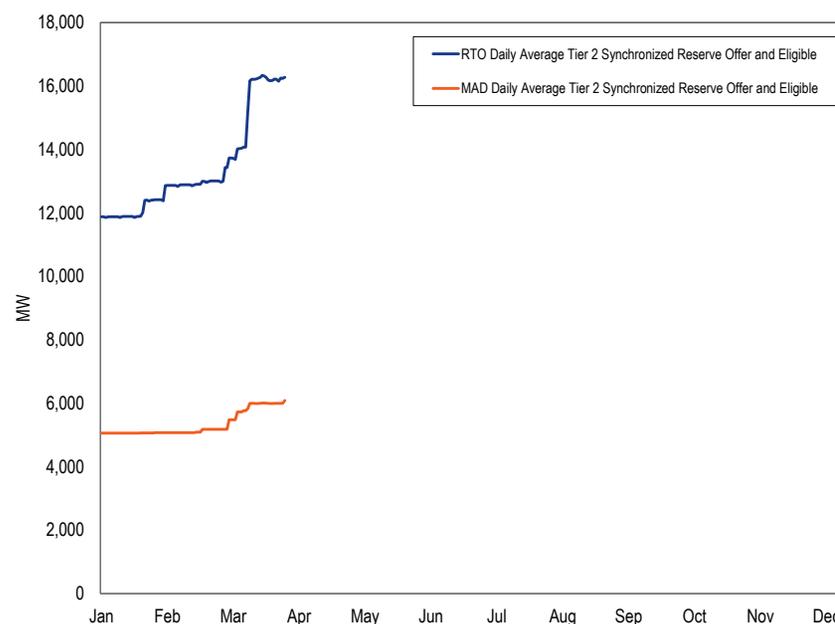

Compliance with the daily must offer requirement is unambiguously stated in Manual 11 “Regardless of online/offline state, all non-emergency generation capacity resources must submit a daily offer for tier 2 synchronized reserve in eMKT prior to the offer submission deadline (1800 the day prior to the operating day).”

Of all non-emergency resources capable of reliably producing synchronized reserve (e.g. excluding batteries, wind, and solar and CTs that have no ramp available), an average of 8.2 percent of units have not entered a tier 2 synchronized reserves offer for any of the days in the first three months of 2016. Despite not making an offer, when tier 1 credits are awarded (either for spinning event response or because the NSRMCP is greater than \$0) these units can be awarded tier 1 credits. In the first three months of 2016, 12


<sup>19</sup> See PJM. “Manual 11: Energy & Ancillary Services Market Operations,” Revision 79 (December 17, 2015) p. 66, “Regardless of online/offline state, all non-emergency generation capacity resources must submit a daily offer for Tier 2 Synchronized Reserve in eMKT...”

distinct units without a tier 2 offer were awarded a total \$22,677 in tier 1 credits for 2,340 MW of tier 1 during hours when the NSRMCP was above \$0.


Tier 2 synchronized reserve is subject to a must offer requirement. To help ensure compliance with this rule, the MMU recommends that PJM define a set of acceptable reasons why a unit can be made unavailable daily or hourly and require operators to select a reason in Markets Gateway whenever making a unit unavailable.

Figure 10-12 shows average offer MW volume by market and unit type for the MAD Subzone and Figure 10-13 shows average offer MW volume by market and unit type for the RTO Zone.

**Figure 10-12 Mid-Atlantic Dominion subzone average daily tier 2 synchronized reserve offer by unit type (MW): January through March, 2013 through 2016**

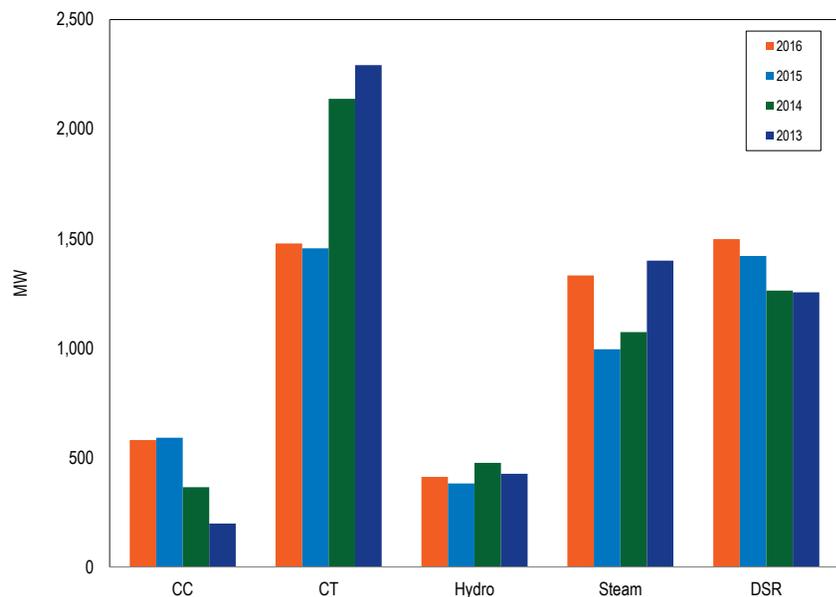

**Figure 10-13 RTO Zone average daily tier 2 synchronized reserve offer by unit type (MW): January through March, 2013 through 2016**

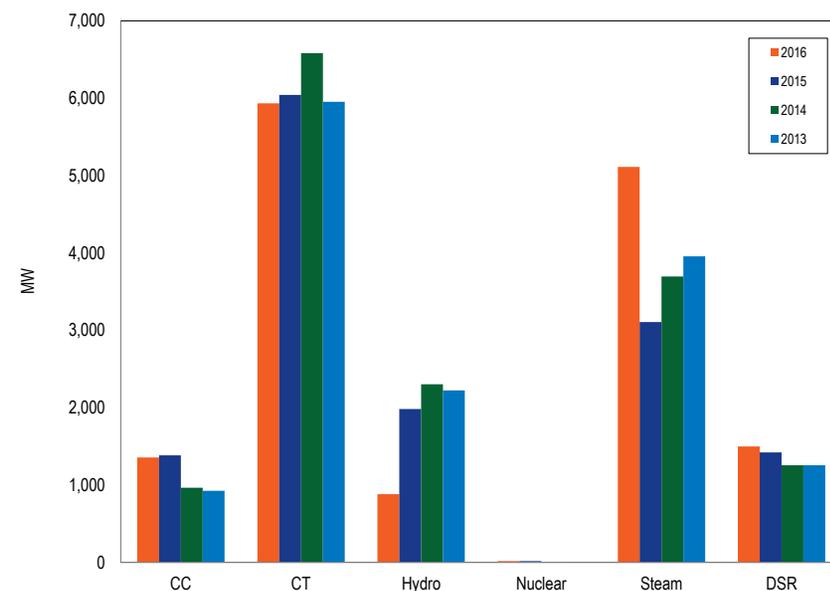

## Market Performance

### Price

The price of tier 2 synchronized reserve is calculated in real time every five minutes and averaged each hour for the RTO Reserve Zone and the MAD Subzone.

The MAD Subzone cleared a Tier 2 Synchronized Reserve Market averaging 258.6 MW (excluding self-scheduled) with a real-time price greater than \$0.00 in 47.1 percent of hours in the first three months of 2016, compared to 60.8 percent of hours in the first three months of 2015.

The RTO Zone cleared a Tier 2 Synchronized Reserve Market averaging 557.1 MW (excluding self-scheduled) with a real-time price greater than \$0.00 in 46.7 percent of the first three months of 2016.

In the first three months of 2016, the weighted average Tier 2 synchronized reserve market clearing price in the MAD Subzone for all cleared hours was \$4.99. In the first three months of 2015, the weighted average synchronized reserve market clearing price in the MAD Subzone was \$12.94.

In the first three months of 2016, the weighted average tier 2 synchronized reserve market clearing price in the RTO Zone for all cleared hours was \$4.96. In the first three months of 2015, the weighted average synchronized reserve market clearing price in the RTO Zone was \$11.14.

Supply, performance, and demand are reflected in the price of synchronized reserve (Figure 10-9 and Figure 10-10). Mild weather in January through March, 2016 resulted in lower prices for tier 2 synchronized reserve.

**Table 10-17 Mid-Atlantic Dominion subzone, weighted SRMCP and cleared MW (excludes self-scheduled): January 2015 through March 2016**

Year	Month	Weighted Average Tier 2 Synchronized Reserve Market Clearing Price	Average Hourly Tier 1 Synchronized Reserve Estimated Hour Ahead (MW)	Average Hourly Demand Response Cleared (MW)	Average Tier 2 Generation Synchronized Reserve Purchased (MW)
2015	Jan	\$11.29	1,218.9	63.7	142.8
2015	Feb	\$24.12	1,179.5	46.3	224.3
2015	Mar	\$11.81	1,196.2	60.8	228.7
2015	Apr	\$10.76	1,159.4	85.0	218.1
2015	May	\$10.16	1,174.4	76.0	162.9
2015	Jun	\$10.29	1,515.5	54.5	177.7
2015	Jul	\$12.87	1,195.6	41.1	215.7
2015	Aug	\$9.25	1,152.9	49.3	247.8
2015	Sep	\$10.66	1,106.9	54.2	288.9
2015	Oct	\$7.68	1,015.6	118.2	374.4
2015	Nov	\$3.30	1,011.6	113.6	290.6
2015	Dec	\$4.71	983.4	109.0	349.4
2015	Average	\$10.13	1,159.2	72.6	243.4
2016	Jan	\$3.19	1,263.5	72.8	188.1
2016	Feb	\$3.83	1,230.1	82.1	191.2
2016	Mar	\$7.96	993.3	129.7	89.5
2016	Average	\$4.99	1,162.3	94.9	156.3

**Table 10-18 RTO zone weighted SRMCP and cleared MW (excludes self-scheduled): January 2015 through March 2016**

Year	Month	Weighted Average Tier 2 Synchronized Reserve Market Clearing Price	Average Hourly Tier 1 Synchronized Reserve Estimated Hour Ahead (MW)	Average Hourly Demand Response Cleared (MW)	Average Tier 2 Generation Synchronized Reserve Purchased (MW)
2015	Jan	\$13.91	1,417.5	164.8	125.2
2015	Feb	\$26.51	1,618.3	46.3	35.4
2015	Mar	\$13.44	1,285.0	60.8	140.0
2015	Apr	\$13.39	1,228.6	85.0	136.4
2015	May	\$13.77	1,239.8	76.0	134.2
2015	Jun	\$19.43	1,366.4	54.5	83.6
2015	Jul	\$21.46	1,346.1	41.1	65.2
2015	Aug	\$18.63	1,353.1	49.3	58.9
2015	Sep	\$19.12	1,156.3	54.2	64.3
2015	Oct	\$15.87	1,156.3	118.2	233.3
2015	Nov	\$6.09	1,089.5	113.6	212.6
2015	Dec	\$7.05	784.4	109.0	548.4
2015	Average	\$14.98	1,253.4	81.1	153.1
2016	Jan	\$3.14	1,548.0	72.8	195.1
2016	Feb	\$3.79	1,510.2	82.1	196.4
2016	Mar	\$7.95	1,093.1	129.7	380.2
2016	Average	\$4.96	1,383.8	94.9	257.2

## Cost

As a result of changing grid conditions, load forecasts, and unexpected generator performance, prices do not always cover the full cost and final LOC for each resource. Because price formation occurs within the hour (on five minute basis integrated over the hour) but the synchronized reserve commitment occurs prior to the hour, the realized within hour price can be zero even when some tier 2 synchronized reserve is cleared. All resources cleared in the market are guaranteed to be made whole and are paid if the SRMCP does not compensate them for their offer plus LOC.

The full cost of tier 2 synchronized reserve including payments for the clearing price and out of market costs is calculated and compared to the price. The closer the price to cost ratio is to one hundred percent, the more the market price reflects the full cost of tier 2 synchronized reserve. A price to cost ratio

close to one hundred percent is an indicator of an efficient synchronized reserve market design.

In the first three months of 2016, the price to cost (including self-scheduled) ratio of the RTO Zone Tier 2 Synchronized Reserve Market averaged 59.6 percent (Table 10-19); and the price to cost ratio of the MAD Subzone averaged 55.7 percent.

**Table 10-19 RTO Zone, Mid-Atlantic Subzone tier 2 synchronized reserve MW, credits, weighted price, and cost (including self-scheduled): January through March, 2016**

Tier 2 Synchronized Reserve Market	Year	Month	Total MW	Total Credits	Weighted Synchronized Reserve Market		Price Cost/ Ratio
					Clearing Price	Cost	
RTO Zone	2016	Jan	186,828	\$1,885,180	\$7.13	\$10.09	70.6%
RTO Zone	2016	Feb	184,177	\$1,288,232	\$2.94	\$6.99	42.0%
RTO Zone	2016	Mar	89,726	\$797,131	\$5.53	\$8.88	62.2%
RTO Zone	2016	Total	460,732	\$3,970,543	\$5.14	\$8.62	59.6%
MAD Subzone	2016	Jan	139,940	\$1,096,952	\$5.15	\$7.84	65.6%
MAD Subzone	2016	Feb	132,915	\$764,882	\$2.17	\$5.75	37.7%
MAD Subzone	2016	Mar	66,236	\$474,154	\$4.43	\$7.16	61.9%
MAD Subzone	2016	Total	339,092	\$2,335,988	\$3.84	\$6.89	55.7%

## Compliance

The MMU has identified and quantified the failure of scheduled tier 2 synchronized reserve resources to deliver during synchronized reserve events since 2011.<sup>20</sup> When synchronized reserve resources self schedule or clear the Tier 2 Synchronized Reserve Market they are obligated to provide their full scheduled Tier 2 MW during a synchronized reserve event. Actual synchronized reserve event response is determined by final output minus initial output where final output is the largest output between 9 and 11 minutes after start of the event, and initial output is the lowest output between one minute before the event and one minute after the event.<sup>21</sup> Tier 2 resources are obligated

to sustain their final output for the shorter of the length of the event or 30 minutes.<sup>22</sup>

The MMU has reported the wide range of synchronized reserve event response levels and recommended that PJM take action to increase compliance rates. Penalties can be assessed for any synchronized reserve event 10 minutes or longer during which flexible or inflexible synchronized reserve was scheduled either by the resource owner or by PJM. In 2015, there were 21 spinning events of which seven were 10 minutes or longer. In the first three months of 2016, there were three spinning events of which two were 10 minutes or longer.

**Table 10-20 Synchronized reserve events 10 minutes or longer, tier 2 response compliance, RTO Reserve Zone: January through March, 2016**

2016 Qualifying Synchronized Reserve Event (DD-Mon-YYYY HR)	Event Duration (Minutes)	Total Scheduled Tier 2 MW	Tier 2 Response MW	Percent T2 Compliance
18-Jan-2016 22	12	616.7	508.8	82.5%
08-Feb-2016 15	10	228.4	200.1	87.6%

Tier 1 resource owners are credited for the amount of synchronized reserve they provide in response to a synchronized reserve event.<sup>23</sup> Tier 2 resources owner are not credited for synchronized reserve event response. Tier 2 resources owners are penalized in the amount of their shortfall at SRMCP for the lesser of the average number of days between events, or the number of days since the previous event in which the resource did respond. For synchronized reserve events of 10 minutes or longer that occurred in the first three months of 2016, 16.1 percent of all scheduled tier 2 synchronized reserve MW were not delivered and were penalized (Table 10-20). In addition, a tier 2 resource will be penalized for the amount of MW it falls short of its offer for the entire hour, not just for the portion of the hour covered by the synchronized reserve event.<sup>24</sup> Resource owners are permitted to aggregate the response of multiple units to offset an under response from one unit with an overresponse from a different unit for the purpose of reducing an underresponse penalty.

<sup>20</sup> See the 2011 State of the Market Report for PJM, Volume II, Section 9, "Ancillary Services" at pg. 250.

<sup>21</sup> See PJM. "Manual 11: Energy & Ancillary Services Market Operations," Revision 79 (December 17, 2015) § 4.2.10 Settlements, p. 77.

<sup>22</sup> See PJM. "Manual 11: Energy & Ancillary Services Market Operations," Revision 79 (December 17, 2015) § 4.2.11 Verification, p. 78.

<sup>23</sup> See PJM. "Manual 11: Energy & Ancillary Services Market Operations," Revision 79 (December 17, 2015) § 4.2.12 Non Performance, p. 78.

<sup>24</sup> See PJM. "Manual 28: Operating Agreement Accounting," Revision 71 (June 1, 2015) p. 45. See also "Manual 11: Energy & Ancillary Services Market Operations," Revision 75 (April 9, 2015) § 4.2.12 Non-Performance, p. 77.

The average number of days between events calculated by PJM Performance Compliance for 2016 is 13 days.<sup>25</sup>

## History of Synchronized Reserve Events

Synchronized reserve is designed to provide relief for disturbances.<sup>26 27</sup> A disturbance is defined as loss of generation and/or transmission resources. PJM also calls synchronized reserve events for non-disturbance events, which it characterizes as “low ACE.” In the absence of a disturbance, PJM dispatchers have used synchronized reserve as a source of energy to provide relief from low ACE. Such an event occurred on January 6, 2014. Five synchronized reserve events were declared during 2014 for low ACE. Five spinning events were declared for low ACE in 2015. There was one low ACE event in the first three months of 2016 on February 28, 2016. The risk of using synchronized reserves for energy or any other non-disturbance reason is that it reduces the amount of synchronized reserve available for a disturbance. Synchronized reserve has a requirement to sustain its output for up to thirty minutes. When the need is for reserve extending past thirty minutes secondary reserve is the appropriate source of the response. The use of synchronized reserve is an expensive solution during an hour when the hour ahead market solution and reserve dispatch indicated no shortage of primary reserve. PJM’s primary reserve levels have been sufficient to recover from disturbances and should remain available in the absence of disturbance.

From January 2010 through March 2016, PJM experienced 170 synchronized reserve events (Table 10-21), approximately three events per month. Synchronized reserve events had an average length of 12.7 minutes. Note that the number of synchronized reserve events with a duration less than 10 minutes was higher in 2015 than any prior year (Figure 10-14). This corresponds with the higher rate of compliance by tier 2 synchronized reserve resources, and the higher rate of response by tier 1 resources to spinning event all calls. The average duration of the three spinning events in the first three months of 2016 was 10 minutes.

<sup>25</sup> Report to PJM Operating Committee, “Synchronized Reserve Event Performance and Penalty Days,” December 3, 2014.

<sup>26</sup> 2013 State of the Market Report for PJM, Appendix F – PJM’s DCS Performance, pp 451–452.

<sup>27</sup> See PJM. “Manual 12: Balancing Operations,” Revision 33 (December 1, 2015) § 4.1.2 Loading Reserves pp. 36.


Table 10-21 Synchronized reserve events, January 2010 through March 2016

Effective Time	Region	Duration (Minutes)	Effective Time	Region	Duration (Minutes)	Effective Time	Region	Duration (Minutes)	Effective Time	Region	Duration (Minutes)
FEB-18-2010 13:27	Mid-Atlantic	19	JAN-11-2011 15:10	Mid-Atlantic	6	JAN-03-2012 16:51	RFC	9	JAN-22-2013 08:34	RTO	8
MAR-18-2010 11:02	RFC	27	FEB-02-2011 01:21	RFC	5	JAN-06-2012 23:25	RFC	8	JAN-25-2013 15:01	RTO	19
MAR-23-2010 20:14	RFC	13	FEB-08-2011 22:41	Mid-Atlantic	11	JAN-23-2012 15:02	Mid-Atlantic	8	FEB-09-2013 22:55	RTO	10
APR-11-2010 13:12	RFC	9	FEB-09-2011 11:40	Mid-Atlantic	16	MAR-02-2012 19:54	RFC	9	FEB-17-2013 23:10	RTO	13
APR-28-2010 15:09	Mid-Atlantic	8	FEB-13-2011 15:35	Mid-Atlantic	14	MAR-08-2012 17:04	RFC	6	APR-17-2013 01:11	RTO	11
MAY-11-2010 19:57	Mid-Atlantic	9	FEB-24-2011 11:35	Mid-Atlantic	14	MAR-19-2012 10:14	RFC	10	APR-17-2013 20:01	RTO	9
MAY-15-2010 03:03	RFC	6	FEB-25-2011 14:12	RFC	10	APR-16-2012 00:20	Mid-Atlantic	9	MAY-07-2013 17:33	RTO	8
MAY-28-2010 04:06	Mid-Atlantic	5	MAR-30-2011 19:13	RFC	12	APR-16-2012 11:18	RFC	8	JUN-05-2013 18:54	RTO	20
JUN-15-2010 00:46	RFC	34	APR-02-2011 13:13	Mid-Atlantic	11	APR-19-2012 11:54	RFC	16	JUN-08-2013 15:19	RTO	9
JUN-19-2010 23:49	Mid-Atlantic	9	APR-11-2011 00:28	RFC	6	APR-20-2012 11:08	Mid-Atlantic	7	JUN-12-2013 17:35	RTO	10
JUN-24-2010 00:56	RFC	15	APR-16-2011 22:51	RFC	9	JUN-20-2012 13:35	RFC	7	JUN-30-2013 01:22	RTO	10
JUN-27-2010 19:33	Mid-Atlantic	15	APR-21-2011 20:02	Mid-Atlantic	6	JUN-26-2012 17:51	RFC	7	JUL-03-2013 20:40	RTO	13
JUL-07-2010 15:20	RFC	8	APR-27-2011 01:22	RFC	8	JUL-23-2012 21:45	RFC	18	JUL-15-2013 18:43	RTO	29
JUL-16-2010 20:45	Mid-Atlantic	19	MAY-02-2011 00:05	Mid-Atlantic	21	AUG-03-2012 12:44	RFC	10	JUL-28-2013 14:20	RTO	10
AUG-11-2010 19:09	RFC	17	MAY-12-2011 19:39	RFC	9	SEP-08-2012 04:34	RFC	12	SEP-10-2013 19:48	RTO	68
AUG-13-2010 23:19	RFC	6	MAY-26-2011 17:17	Mid-Atlantic	20	SEP-27-2012 17:19	Mid-Atlantic	7	OCT-28-2013 10:44	RTO	33
AUG-16-2010 07:08	RFC	17	MAY-27-2011 12:51	RFC	6	OCT-17-2012 10:48	RTO	10	DEC-01-2013 11:17	RTO	9
AUG-16-2010 19:39	Mid-Atlantic	11	MAY-29-2011 09:04	RFC	7	OCT-23-2012 22:29	RTO	19	DEC-07-2013 19:44	RTO	7
SEP-15-2010 11:20	RFC	13	MAY-31-2011 16:36	RFC	27	OCT-30-2012 05:12	RTO	14			
SEP-22-2010 15:28	Mid-Atlantic	24	JUN-03-2011 14:23	RFC	7	NOV-25-2012 16:32	RTO	12			
OCT-05-2010 17:20	RFC	10	JUN-06-2011 22:02	Mid-Atlantic	9	DEC-16-2012 07:01	RTO	9			
OCT-16-2010 03:22	Mid-Atlantic	10	JUN-23-2011 23:26	RFC	8	DEC-21-2012 05:51	RTO	7			
OCT-16-2010 03:25	RFCNonMA	7	JUN-26-2011 22:03	Mid-Atlantic	10	DEC-21-2012 10:29	RTO	5			
OCT-27-2010 10:35	RFC	7	JUL-10-2011 11:20	RFC	10						
OCT-27-2010 12:50	Mid-Atlantic	10	JUL-28-2011 18:49	RFC	12						
NOV-26-2010 14:24	RFC	13	AUG-02-2011 01:08	RFC	6						
NOV-27-2010 11:34	RFC	8	AUG-18-2011 06:45	Mid-Atlantic	6						
DEC-08-2010 01:19	RFC	11	AUG-19-2011 14:49	RFC	5						
DEC-09-2010 20:07	RFC	5	AUG-23-2011 17:52	RFC	7						
DEC-14-2010 12:02	Mid-Atlantic	24	SEP-24-2011 15:48	RFC	8						
DEC-16-2010 18:40	Mid-Atlantic	20	SEP-27-2011 14:20	RFC	7						
DEC-17-2010 22:09	Mid-Atlantic	6	SEP-27-2011 16:47	RFC	9						
DEC-29-2010 19:01	Mid-Atlantic	15	OCT-30-2011 22:39	Mid-Atlantic	10						
			DEC-15-2011 14:35	Mid-Atlantic	8						
			DEC-21-2011 14:26	RFC	18						

Table 10-21 Synchronized reserve events, January 2010 through March 2016 (continued)

Effective Time	Region	Duration (Minutes)	Effective Time	Region	Duration (Minutes)	Effective Time	Region	Duration (Minutes)
JAN-06-2014 22:01	RTO	68	JAN-07-2015 22:36	RTO	8	JAN-18-2016 17:58	RTO	12
JAN-07-2014 02:20	RTO	25	FEB-24-2015 02:51	RTO	5	FEB-08-2016 15:05	RTO	10
JAN-07-2014 04:18	RTO	34	FEB-26-2015 15:20	RTO	6	FEB-28-2016 18:29	RTO	8
JAN-07-2014 11:27	RTO	11	MAR-03-2015 17:02	RTO	11			
JAN-07-2014 13:20	RTO	41	MAR-16-2015 10:25	RTO	24			
JAN-10-2014 16:46	RTO	12	MAR-17-2015 23:34	RTO	17			
JAN-21-2014 18:52	RTO	6	MAR-23-2015 23:44	RTO	15			
JAN-22-2014 02:26	RTO	7	APR-06-2015 14:23	RTO	8			
JAN-22-2014 22:54	RTO	8	APR-07-2015 17:11	RTO	31			
JAN-25-2014 05:22	RTO	10	APR-15-2015 08:14	RTO	8			
JAN-26-2014 17:11	RTO	6	APR-25-2015 03:21	RTO	9			
JAN-31-2014 15:05	RTO	13	JUL-30-2015 14:04	RTO	10			
FEB-02-2014 14:03	Dominion	8	AUG-05-2015 19:47	RTO	7			
FEB-08-2014 06:05	Dominion	18	AUG-19-2015 16:47	RTO	9			
FEB-22-2014 23:05	RTO	7	SEP-05-2015 01:16	RTO	7			
MAR-01-2014 05:18	RTO	26	SEP-10-2015 10:12	RTO	8			
MAR-05-2014 21:25	RTO	8	SEP-29-2015 00:58	Mid-Atlantic	11			
MAR-13-2014 20:39	RTO	8	NOV-12-2015 16:42	RTO	8			
MAR-27-2014 10:37	RTO	56	NOV-21-2015 17:17	RTO	8			
APR-14-2014 01:16	RTO	10	DEC-04-2015 22:41	RTO	7			
APR-25-2014 17:33	RTO	6	DEC-24-2015 17:42	RTO	8			
MAY-01-2014 14:18	RTO	13						
MAY-03-2014 17:11	RTO	13						
MAY-14-2014 01:36	RTO	5						
JUL-08-2014 03:07	RTO	9						
JUL-25-2014 19:19	RTO	7						
SEP-06-2014 13:32	RTO	18						
SEP-20-2014 23:42	RTO	14						
SEP-29-2014 10:08	RTO	15						
OCT-20-2014 06:35	RTO	15						
OCT-23-2014 11:03	RTO	27						
NOV-01-2014 06:50	RTO	9						
NOV-08-2014 02:08	RTO	8						
NOV-22-2014 05:27	RTO	21						
NOV-22-2014 08:19	RTO	10						
DEC-10-2014 18:58	RTO	8						
DEC-31-2014 21:42	RTO	12						

**Figure 10-14 Synchronized reserve events duration distribution curve: 2011 through 2016**

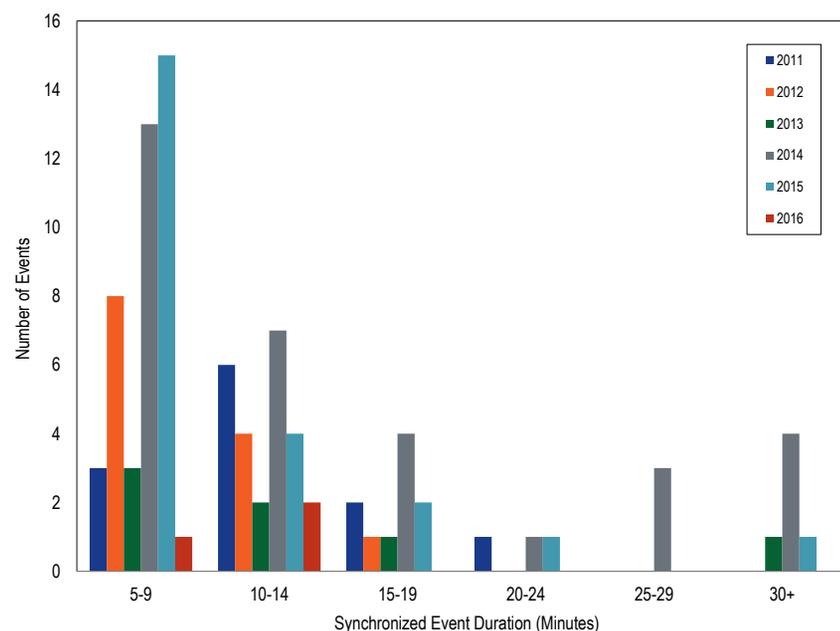

## Non-Synchronized Reserve Market

Non-synchronized reserve is reserve MW available within 10 minutes but not synchronized to the grid. There is no defined requirement for non-synchronized reserves. It is available to meet the primary reserve requirement. Generation resources that have designated their entire output as emergency are not eligible to provide non-synchronized reserves. Generation resources that are not available to provide energy are not eligible to provide non-synchronized reserves.

Startup time for non-synchronized reserve resources is not subject to testing. There is no non-synchronized reserve offer MW or offer price. The market solution software evaluates all eligible resources and schedules them

economically. Prices are determined solely by the lost opportunity cost created by any deviation from economic merit order required to maintain the non-synchronized reserve commitment. Since non-synchronized reserve is a lower quality product, its clearing price is always less than or equal to the synchronized reserve market clearing price. In most hours, the non-synchronized reserve clearing price is zero.

## Market Structure

### Demand

PJM specifies that 1,700 MW of ten minute primary reserve must be available in the Mid-Atlantic Dominion Reserve Subzone of which 1,450 MW must be synchronized reserve (Figure 10-2), and that 2,175 MW of 10 minute primary reserve must be available in the RTO Reserve Zone of which 1,450 MW must be synchronized reserve (Figure 10-3). The balance of primary reserve can be made up by the most economic combination of synchronized and non-synchronized reserve.

### Supply

Figure 10-2 shows that most of the primary reserve requirement (orange line) in excess of the synchronized reserve requirement (yellow line) is satisfied by non-synchronized reserve (light blue area).

There are no offers for non-synchronized reserve. Neither MW nor price is offered for non-synchronized reserve. The market solution (ASO) optimizes synchronized reserve, non-synchronized reserve, and energy to satisfy the primary reserve requirement at the lowest cost. Non-synchronized reserve resources are scheduled economically based on LOC until the Primary Reserve requirement is filled. The non-synchronized reserve market clearing price is determined at the end of the hour as the marginal unit's LOC. When a unit clears the non-synchronized reserve market and is scheduled, it is committed to remain offline for the hour and available to provide 10 minute reserves.

Equipment that generally qualifies as non-synchronized reserve include run of river hydro, pumped hydro, combustion turbines, combined cycles and diesels.<sup>28</sup> In the first three months of 2016, an average of 287.6 MW of non-synchronized reserve was scheduled hourly out of 1,768.7 eligible MW as part of the primary reserve requirement in the Mid-Atlantic Dominion Subzone. In the first three months of 2016, an average of 315.9 MW of non-synchronized reserve was scheduled hourly out of 2,288.0 MW eligible MW in the RTO Zone.

During the first three months of 2016, CTs provided 58.7 percent of scheduled non-synchronized reserve while and hydro provided 40.4 percent. The remaining 0.9 percent of cleared non-synchronized reserve was provided by diesel resources.

### Market Concentration

The supply of non-synchronized reserves in the Mid-Atlantic Dominion Subzone and the RTO Zone was highly concentrated in the first three months of 2016. PJM market operations increased the required amount of primary reserve from 2,175 MW to 3,195 MW for a 14 hour period on February 22, 2016.

**Table 10-22 Non-synchronized reserve market HHIs: January through March, 2016**

Year	Month	Mid Atlantic Dominion HHI	RTO HHI
2016	Jan	4002	5171
2016	Feb	4347	5369
2016	Mar	2932	4950
2016	Average	3760	5163

<sup>28</sup> See PJM. "Manual 11: Energy & Ancillary Services Market Operations," Revision 79 (December 17, 2015), p. 80.

**Table 10-23 Non-synchronized reserve market pivotal supply test: January through March, 2016**


Year	Month	Mid Atlantic Dominion Three Pivotal Supplier Hours	RTO Three Pivotal Supplier Hours
2016	Jan	35.6%	0.0%
2016	Feb	17.0%	0.0%
2016	Mar	12.6%	0.0%
2016	Average	21.7%	0.0%

### Price

The price of non-synchronized reserve is calculated in real time every five minutes and averaged each hour for the RTO Reserve Zone and the Mid Atlantic Dominion Reserve Subzone. Resources eligible for non-synchronized reserve make no price offer or MW offer.

Figure 10-15 shows the daily average hour ahead non-synchronized reserve market clearing price and average scheduled MW for the RTO Zone. In the first three months of 2016 the MAD Subzone did not clear separately. The maximum hourly clearing price was \$83.06 per MW on January 18, 2016. Figure 10-15 shows the daily average hour ahead non-synchronized reserve market clearing price and average scheduled MW for the RTO Zone including the MAD subzone. The RTO Zone Non-Synchronized Reserve Market had a clearing price greater than zero in 120 hours (5.5 percent). The weighted non-synchronized reserve market clearing price for all hours in the RTO Zone including cleared hours when the price was zero, was \$0.25 clearing an average of 901.9 MW.

Figure 10-15 Daily average RTO zone non-synchronized reserve market clearing price and MW purchased: January through March 2016

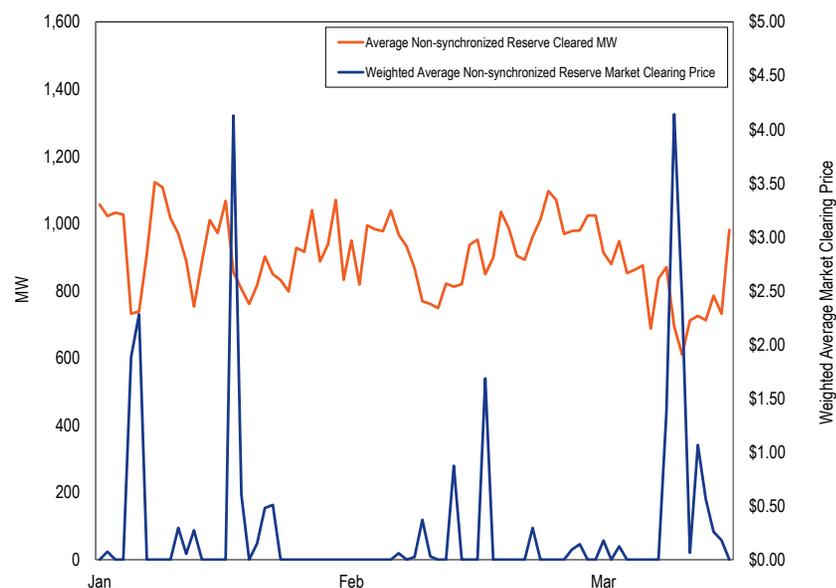

### Price and Cost

As a result of changing grid conditions, load forecasts, and unexpected generator performance, prices sometimes do not cover the full LOC of each resource. All resources cleared in the market are guaranteed to be made whole and are paid uplift credits if the NSRMCP does not fully compensate them.

The full cost of non-synchronized reserve including payments for the clearing price and uplift costs is calculated and compared to the price (Table 10-24). The closer the price to cost ratio comes to one, the more the market price reflects the full cost of non-synchronized reserve.

In the first three months of 2016, the price to cost ratio of the RTO Zone Non-Synchronized Reserve Market averaged 19.8 percent; and the price to cost ratio of the MAD Subzone averaged 9.4 percent.

Table 10-24 RTO zone, MAD subzone non-synchronized reserve MW, credits, price, and cost: January through March 2016

Market	Year	Month	Total Non-synchronized Reserve MW	Total Non-synchronized Reserve Charges	Weighted Non-synchronized Reserve Market Clearing Price	Non-synchronized Reserve Cost	Price/ Cost Ratio
RTO Zone	2016	Jan	688,475	\$208,363	\$0.30	\$1.94	15.6%
RTO Zone	2016	Feb	638,024	\$67,480	\$0.11	\$1.05	10.0%
RTO Zone	2016	Mar	657,739	\$201,160	\$0.31	\$0.62	49.6%
RTO Zone	2016	Total	1,984,238	\$477,002	\$0.24	\$1.22	19.8%
MAD Subzone	2016	Jan	268,148	\$84,204	\$0.31	\$4.30	7.3%
MAD Subzone	2016	Feb	250,609	\$28,083	\$0.11	\$2.48	4.5%
MAD Subzone	2016	Mar	252,702	\$79,573	\$0.31	\$1.04	30.4%
MAD Subzone	2016	Total	771,459	\$191,860	\$0.25	\$2.64	9.4%

## Secondary Reserve (DASR)

PJM maintains a day-ahead, offer based market for 30-minute day-ahead secondary reserve.<sup>29</sup> The Day-Ahead Scheduling Reserves Market (DASR) has no performance obligations.

## Market Structure

### Supply

DASR is provided by both generation and demand resources. DASR offers consist of price only. DASR MW are calculated by the market clearing engine. Available DASR MW are the lesser of the energy ramp rate for all online units times thirty minutes, or the economic maximum minus the day-ahead dispatch point. For offline resources capable of being online in thirty minutes, the DASR quantity is the economic maximum. In the first three months of 2016, the average available hourly DASR was 40,089 MW. This is a 9.7 percent increase from 38,121 MW from the same period in 2015. The DASR MW purchased averaged 4,253.1 MW per hour, a decrease from 6,304.6 MW per hour in the same period of 2015. Although there was no shortage of DASR in the market solution, the market has no requirements for or link to the availability of scheduled reserve during real-time hours. Spinning

<sup>29</sup> See PJM, "Manual 35: Definitions and Acronyms," Revision 23 (April 11, 2014), p. 89.

events longer than 30 minutes, while rare, do occur. The spinning events of September 10, 2013, March 27, 2014, and April 7, 2015, are examples of when secondary reserve was needed but not enough was available in real time.

The MMU has recommended since 2013 that PJM implement a real time secondary reserve market.

PJM has proposed to exclude resources that cannot reliably provide reserves in real time from participating in the DASR market. Such resources include nuclear, run-of-river hydro, self-scheduled pumped hydro, wind, solar, some dynamic transfer resources, and non-energy resources. The intent of this initiative is to limit cleared DASR resources to those resources actually capable of providing reserves in the real time market. In addition, PJM is going to implement changes to ensure that resources that clear DASR, but declare an outage in real time, will not be credited for DASR for that day. PJM is investigating how many resources have been credited for DASR over the past two years but were unavailable in real time. PJM will be requiring refunds from such resources.

All generation resources are required to offer a price for DASR.<sup>30</sup> Of the 5,645.4 MW hourly average DASR cleared in the first three months of 2016, 53.5 percent was from CTs, 15.5 percent was from steam, 19.7 percent was from hydro, and 9.1 percent was CCs. Load response resources which are registered in PJM's Economic Load Response and are dispatchable by PJM are eligible to provide DASR. In the first three months of 2016, six demand resources offered into the DASR Market.

## Demand

DASR 30-minute reserve requirements are determined by PJM for each reliability region. In the ReliabilityFirst (RFC) region, secondary reserve requirements are calculated based on historical under-forecasted load rates and generator forced outage rates.<sup>31</sup> The RFC and Dominion secondary reserve requirements are added together to form a single RTO DASR requirement

<sup>30</sup> See PJM "Manual 11: Energy & Ancillary Services Market Operations," Revision 79 (December 17, 2015), p. 144 §11.2.3 Day-Ahead Scheduling Reserve Market Rules.

<sup>31</sup> See PJM, "Manual 13: Emergency Operations," Revision 59 (January 1, 2016), p. 11.

defined as a percent of the daily peak load forecast. For 2016 the DASR requirement is set to 5.70 percent of daily peak load forecast. This is down from 5.93 percent of peak load forecast for 2015. The DASR requirement is applicable for all hours of the operating day. If the DASR Market does not procure adequate scheduling reserves, PJM is required to schedule additional operating reserves.<sup>32</sup>

Effective March 1, 2015, the DASR requirement can be increased by PJM dispatch under conditions of "hot weather or cold weather alert or max emergency generation alert or other escalating emergency."<sup>33</sup> The amount of additional DASR MW that may be required is the Adjusted Fixed Demand (AFD) determined by a Seasonal Conditional Demand (SCD) factor.<sup>34</sup> The SCD factor is calculated separately for the winter (November through March) and summer (April through October) seasons. The SCD factor is calculated every year based on the top 10 peak load days from the prior year. For November 2014 through October 2015, the values for additional percent of peak load was 3.87 percent for winter, 5.36 percent for summer. For November 2015 through October 2016, the SCD values are 3.45 percent for winter and 2.88 percent for summer. PJM Dispatch may also schedule additional Day-Ahead Scheduling Reserves as deemed necessary for conservative operations.<sup>35</sup> PJM has defined conservative operations to include, potential fuel delivery issues, forest/brush fires, extreme weather events, environmental alerts, solar disturbances, unknown grid operating state.<sup>36</sup> The net result is substantial discretion for PJM to increase the demand for DASR under a variety of circumstances.

PJM invoked adjusted fixed demand during 14 days in 2015. In the first three months of 2016, PJM invoked adjusted fixed demand on one day, February 14, 2016. A record of PJM's use of adjusted fixed demand is in Table 10-25. The use of adjusted fixed demand (and other conservative operations adjustments) impacts the DASR Market in several significant ways.

<sup>32</sup> PJM uses the terms "supplemental operating reserves" and "scheduling operating reserves" interchangeably.

<sup>33</sup> PJM, "Energy and Reserve Pricing & Interchange Volatility Final Proposal Report," <<http://www.pjm.com/~media/committees-groups/committees/mrc/20141030/20141030-item-04-erpv-final-proposal-report.ashx>>.

<sup>34</sup> See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Revision 79, (December 17, 2015) p. 144 at 11.2.1 Day-Ahead Scheduling Reserve Market Requirement.

<sup>35</sup> See PJM "Manual 11: Energy & Ancillary Services Market Operations," Revision 79, (December 17, 2015) p. 144 at 11.2.1 Day-Ahead Scheduling Reserve Market Requirement.

<sup>36</sup> See PJM, "Manual 13: Emergency Operations" Revision 58, (August 1, 2015), p. 45 at 3.2 Conservative Operations.

**Table 10-25 Adjusted Fixed Demand Days: 2016**

Start Date	End Date	Number of Hours	Average Additional MW
14-Feb	14-Feb	24	3,008

An alternative to adjusted fixed demand would be to schedule secondary reserve in the real time market. The MMU recommends that PJM replace the DASR Market with a real-time secondary reserve product that is available and dispatchable in real time.

## Market Concentration

Between January 2012 and April 2015, no hours would have failed a three pivotal supplier test in the DASR Market. Beginning in May 2015, when PJM began to invoke adjusted fixed demand for conservative operations, the DASR Market began to fail the three pivotal supplier test (Table 10-26).

**Table 10-26 DASR market three pivotal supplier test results and number of hours with DASRMCP above \$0: January 2015 through March 2016**

Year	Month	Number of Hours When DASRMCP > \$0	Percent of Hours Pivotal
2015	Jan	151	0.0%
2015	Feb	328	0.0%
2015	Mar	300	0.0%
2015	Apr	301	0.0%
2015	May	323	3.9%
2015	Jun	349	11.2%
2015	Jul	496	28.1%
2015	Aug	482	21.5%
2015	Sep	532	11.4%
2015	Oct	634	0.3%
2015	Nov	568	0.0%
2015	Dec	473	0.4%
2015	Average	411	6.4%
2016	Jan	326	0.3%
2016	Feb	235	0.4%
2016	Mar	369	1.9%
2016	Average	310	0.9%

## Market Conduct

PJM rules allow any unit with reserve capability that can be converted into energy within 30 minutes to offer into the DASR Market.<sup>37</sup> Units that do not offer have their offers set to \$0.00 per MW.

Economic withholding remains an issue in the DASR Market. The marginal cost of providing DASR is zero. All offers greater than zero constitute economic withholding. Throughout the first three months of 2016, 36.2 percent of generation units offered DASR at a daily price above \$0.00. This compares to 37.9 percent above \$0.00 for the same period in 2015. In the first three months of 2016, 13.6 percent of daily offers were above \$5.00 per MW.

## Market Performance

Between May and September 2015, the use of Adjusted Fixed Demand (AFD) by PJM Market Operations significantly increased the demand in 366 hours. For 43.6 percent of hours in 2015, DASR cleared at a price of \$0.00 per MWh (Figure 10-16). In the first three months of 2016, there was one AFD day, February 14. A total of 43.1 percent of hours cleared at a price above \$0.00. In 2015, the weighted average DASR price for all hours when the DASRMCP was above \$0.00 was \$2.99. In the first three months of 2016, the weighted average DASR price for all hours when the DASRMCP was above \$0.00 was \$0.20. The average cleared MW in all hours when the DASRMCP was above \$0.00 was 4,543 MW. The highest DASR price was \$9.99 on February 14, 2016.

The introduction of Adjusted Fixed Demand on March 1, 2015, created a bifurcated market (Table 10-27). There were 367 hours in 2015 when PJM Market Operations added an Adjusted Fixed Demand to the normal 5.93 percent of forecast load. On February 14, 2016 PJM Market Operations added AFD to the normal 5.70 percent of forecast load. The difference in market clearing price, MW cleared, obligation incurred, and charges to PJM load are substantial. On February 14, 2016 while AFD was in effect, the weighted average DASR price was \$3.10 compared to \$0.23 for hours when DASRMCP was greater than \$0.00 and PJM dispatch did not augment the requirement.

<sup>37</sup> See PJM, "Manual 11: Emergency and Ancillary Services Operations," Revision 79 (December 17, 2015), p. 147.

While the new rules allow PJM dispatch substantial discretion to add to DASR demand for a variety of reasons, the rationale for each specific increase is not always clear. The MMU recommends that PJM Market Operations attach a reason code to every hour in which PJM dispatch adds additional DASR MW above the default DASR hourly requirement. The addition of such a code would make the reason explicit, increase transparency and facilitate analysis of the use of PJM's ability to add DASR MW.

**Table 10–27 DASR Market, regular hours vs. adjusted fixed demand hours: January 2015 through March 2016**


Year	Month	Number of Hours DASRMCP>\$0		Weighted DASRMCP		Average PJM Load MW		Hourly Average Cleared DASR MW		Average Hourly DASR Credits	
		Normal Hour	AFD Hour	Normal Hour	AFD Hour	Normal Hour	AFD Hour	Normal Hour	AFD Hour	Normal Hour	AFD Hour
2015	Jan	151		\$0.19		112,373		4,902		\$937	
2015	Feb	328		\$4.03		113,797		4,868		\$19,610	
2015	Mar	300		\$0.59		96,315		4,116		\$2,429	
2015	Apr	301		\$0.04		80,798		4,085		\$155	
2015	May	279	44	\$3.66	\$12.34	92,863	96,726	4,574	9,042	\$16,750	\$111,598
2015	Jun	255	94	\$0.92	\$13.82	104,388	105,190	5,152	8,895	\$4,724	\$122,908
2015	Jul	410	86	\$1.36	\$18.56	106,605	114,868	5,553	9,599	\$7,565	\$178,164
2015	Aug	459	23	\$0.95	\$14.79	105,509	110,753	5,766	9,701	\$5,483	\$143,459
2015	Sep	412	120	\$0.31	\$14.63	91,491	109,028	5,003	11,337	\$1,550	\$165,870
2015	Oct	634		\$0.35		77,657		4,231		\$1,500	
2015	Nov	568		\$0.29		80,844		4,477		\$1,279	
2015	Dec	473		\$0.13		87,166		4,807		\$617	
2015	Average	381	73	\$1.07	\$14.83	95,817	107,313	4,794	9,715	\$5,217	\$144,400
2016	Jan	326		\$0.15		103,263		4,723		\$720	
2016	Feb	212	24	\$0.05	\$3.10	102,040	107,852	4,640	6,830	\$249	\$21,167
2016	Mar	369		\$0.04		83,994		4,175		\$175	
2016	Average	302	24	\$0.08	\$3.10	96,432	107,852	4,513	6,830	\$381	\$21,167

The implementation of the conservative operations adjustment to the DASR requirement in 367 hours during 2015 and 24 hours in the first three months of 2016 has significantly increased the cost of DASR as a result of increases in DASR MW cleared and corresponding increases in the DASR clearing prices (Table 10-28).

Table 10-28 DADR Market all hours of DADR market clearing price greater than \$0, January 2015 through March 2016


Year	Month	Number of Hours DASRMCP > \$0	Weighted DADR Market Clearing Price	Average Hourly RT Load MW	Total PJM Cleared DADR MW	Total PJM Cleared Additional DADR MW	Total Charges
2015	Jan	151	\$0.19	112,373	740,268	0	\$141,561
2015	Feb	328	\$4.03	113,797	1,596,639	0	\$6,431,987
2015	Mar	300	\$0.59	96,315	1,234,905	0	\$728,829
2015	Apr	301	\$0.04	80,798	1,229,513	0	\$46,584
2015	May	323	\$5.73	93,389	1,673,983	159,559	\$9,583,568
2015	Jun	349	\$5.93	104,604	2,150,052	294,881	\$12,757,966
2015	Jul	496	\$5.94	108,038	3,102,087	260,120	\$18,423,687
2015	Aug	482	\$2.03	105,759	2,869,630	59,414	\$5,816,401
2015	Sep	532	\$6.00	95,447	3,421,690	525,883	\$20,542,872
2015	Oct	634	\$0.35	77,657	2,682,429	0	\$951,264
2015	Nov	568	\$0.29	80,844	2,542,795	0	\$726,549
2015	Dec	473	\$0.13	87,166	2,273,497	0	\$291,725
2015	Average	411	\$2.60	96,349	2,126,457	108,321	\$6,370,250
2016	Jan	326	\$0.15	102,417	4,691	0	\$234,679
2016	Feb	212	\$0.49	102,631	4,557	72,197	\$560,607
2016	Mar	369	\$0.04	83,994	4,175	0	\$64,592
2016	Average	302	\$0.23	95,314	4,457	24,066	\$286,626

Figure 10-16 Daily average components of DADR clearing price (\$/MW), marginal unit offer and LOC: January through March 2016

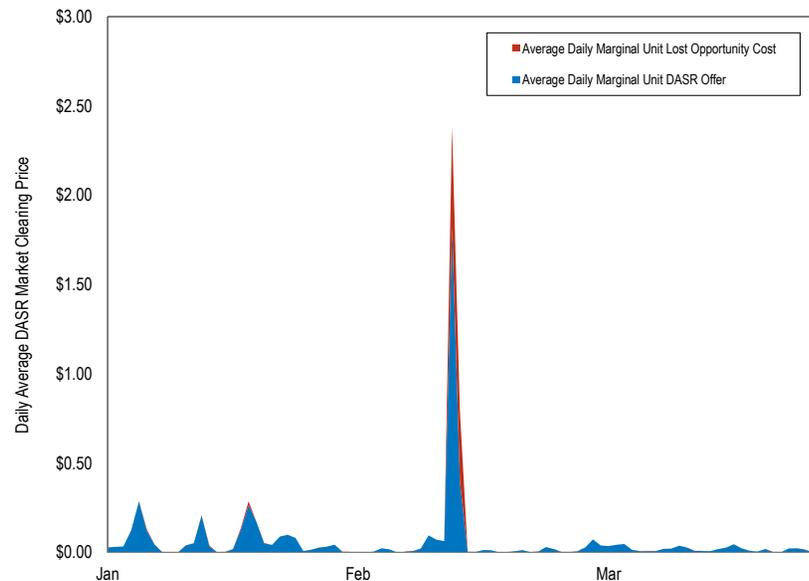

When the DASR requirement is increased by PJM dispatch, the reserve requirement frequently cannot be filled without redispatching online resources which significantly affects the price. Figure 10-16 shows the impact of LOC on price when online resources must be redispatched to satisfy the DASR requirement. DASR prices increase at peak loads as a result of high LOCs. For the first three months of 2016, with the exception of one day, DASR prices were low to moderate, and were the result of the DASR offer prices of the marginal unit(s) and did not include any LOC. February 14, 2016 was an AFD day. The red at the top of the price for that day in Figure 10-16 shows the degree to which prices were determined by the LOC of the marginal unit(s). Figure 10-17 shows that when total DASR MW required is at its peak, a higher share of MW come from on line steam and CT units. While CTs have a low DASR related cost, steam units typically incur an LOC when redispatched to provide DASR. The redispatch of steam units to provide DASR has a significant impact on DASR prices.

**Figure 10-17 Daily average DASR MW by Unit Type sorted from highest to lowest daily requirement: January through March 2016**

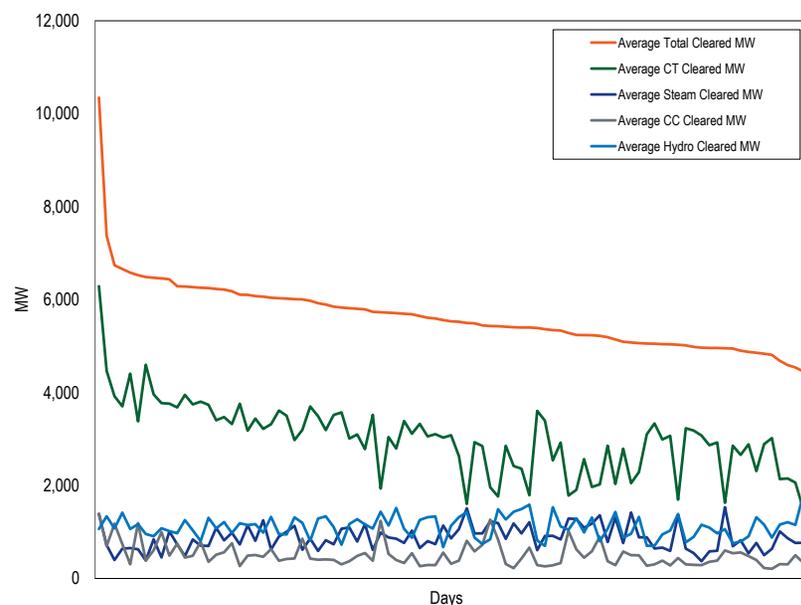

## Regulation Market

Regulation matches generation with very short term changes in load by moving the output of selected resources up and down via an automatic control signal. Regulation is provided by generators with a short-term response capability (less than five minutes) or by demand response (DR). The PJM Regulation Market is operated as a single real-time market. Significant technical and structural changes were made to the Regulation Market in 2012.<sup>38</sup>

## Market Design

The objective of PJM's regulation market design is to minimize the cost to provide regulation using two resource types, RegA and RegD, in a single market. To meet this objective, the marginal benefit factor (MBF) function describing the engineering substitutability between RegA and RegD must be correctly defined and consistently applied throughout the market design, from optimization to settlement. This is the only way to ensure that the engineering relationship is reflected in the relative value of RegA and RegD resources in the market price signals. That is not the case in PJM's current regulation market design. The MBF function is not correctly defined and it is not consistently applied throughout the market design, from optimization to settlement.

The result has been that the Regulation Market has over procured RegD relative to RegA in some hours and has provided a consistently inefficient market signal to participants regarding the value of RegD to the market in every hour. This over procurement began to degrade the ability of PJM to control ACE in some hours while at the same time increasing the cost of regulation. When the price paid for RegD is above the level defined by an accurate MBF function, there is an artificial incentive for inefficient entry of RegD resources. This inefficient market signal has contributed to a significant amount of storage capacity (Table 10-29) entering PJM's interconnection queue, despite operational evidence that the RegD market is saturated.

<sup>38</sup> See the 2012 State of the Market Report for PJM, Volume II, Section 9, "Ancillary Services," p. 271.

**Table 10-29 Active battery storage projects in the PJM queue system by submitted year from 2012 to 2016**

Year	Number of Storage Projects	Total Capacity (MW)
2012	3	9.1
2013	4	22.0
2014	12	171.0
2015	56	514.4
2016	2	5.0
Total	77	721.5

The MBF related issues with the Regulation Market have been raised in the PJM stakeholder process. In 2015, PJM stakeholders approved an interim, partial fix to the RegD over procurement problem which was implemented on December 14, 2015. The interim fix was designed to reduce the relative value of RegD MW in the optimization in all hours and to cap purchases of RegD MW during critical performance hours. But the interim fix does not address the fundamental issues in the optimization or the lack of consistency in the application of the MBF. The MMU and PJM are pursuing a comprehensive solution through the Regulation Market Issues Senior Task Force.

The Regulation Market includes resources following two signals: RegA and RegD. Resources responding to either signal help control ACE (area control error). RegA is PJM's slow-oscillation regulation signal and is designed for resources with the ability to sustain energy output for long periods of time, with slower ramp rates. RegD is PJM's fast-oscillation regulation signal and is designed for resources with limited ability to sustain energy output and with faster ramp rates. Resources must qualify to follow one or both of the RegA and RegD signals, but will be assigned by the market clearing engine to follow only one signal in a given market hour. The PJM regulation market design includes three clearing price components: capability (\$/MW, based on the MW being offered); performance (\$/mile, based on the total MW movement requested by the control signal, known as mileage); and lost opportunity cost (\$/MW of lost revenue from the energy market as a result of providing regulation). The Marginal Benefit Factor and performance score translate a resource's capability (actual) MW into effective MW.

Regulation in PJM is frequently provided by fleets of resources rather than by individual units. A fleet is a set of resources owned or operated by a common entity. The regulation signals (RegA or RegD) are sent every two seconds to the fleet local control centers or, at the option of fleet owners, to their individual resources. Fleet local control centers report to PJM every two seconds the fleet response to the RegA and RegD signals.

Prior to the operating hour, fleet owners are allowed to replace an assigned regulation resource in their fleet with another resource in their fleet as long as that resource is qualified to provide regulation for the originally assigned signal, has an historic performance score close to the originally assigned resource and has notified PJM of the change.

Regulation performance scores (0.0 to 1.0) measure the response of a regulating resource to its assigned regulation signal (RegA or RegD) every 10 seconds by measuring: delay, the time delay of the regulation response to a change in the regulation signal; correlation, the correlation between the regulating resource output and the regulation signal; and precision, the difference between the regulation response and the regulation requested.<sup>39</sup>

Figure 10-18 and Figure 10-19 show the average performance score by resource type and the signal followed for the first three months of 2016. In these figures, the MW used are unadjusted regulation capability MW (actual MW not adjusted by performance score or benefit factor) and the performance score is the hourly performance score of the regulation resource.<sup>40</sup> Each category (color bar) is based on the percentage of the full performance score distribution for each resource (or signal) type. As Figure 10-19 shows, 84.0 percent of RegD resources had average performance scores within the 0.91-1.00 range, and 32.2 percent of RegA resources had average performance scores within that range.

<sup>39</sup> PJM "Manual 12: Balancing Operations" Rev. 33 (December 1, 2015); 4.5.6, p 52.

<sup>40</sup> Except where explicitly referred to as effective MW or effective regulation MW, MW means regulation capability MW unadjusted for either Marginal Benefit Factor or performance factor.

Figure 10-18 Hourly average performance score by unit type: January through March, 2016


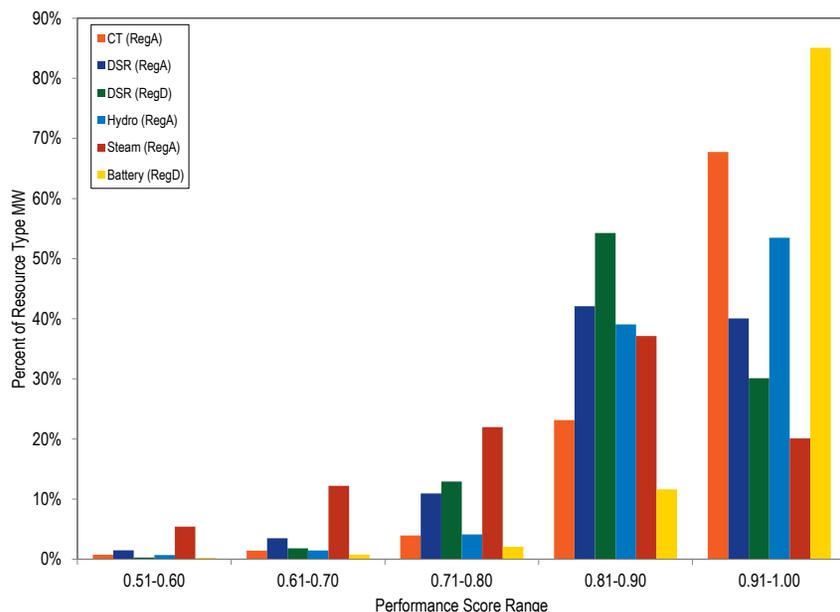


Figure 10-19 Hourly average performance score by regulation signal type: January through March, 2016

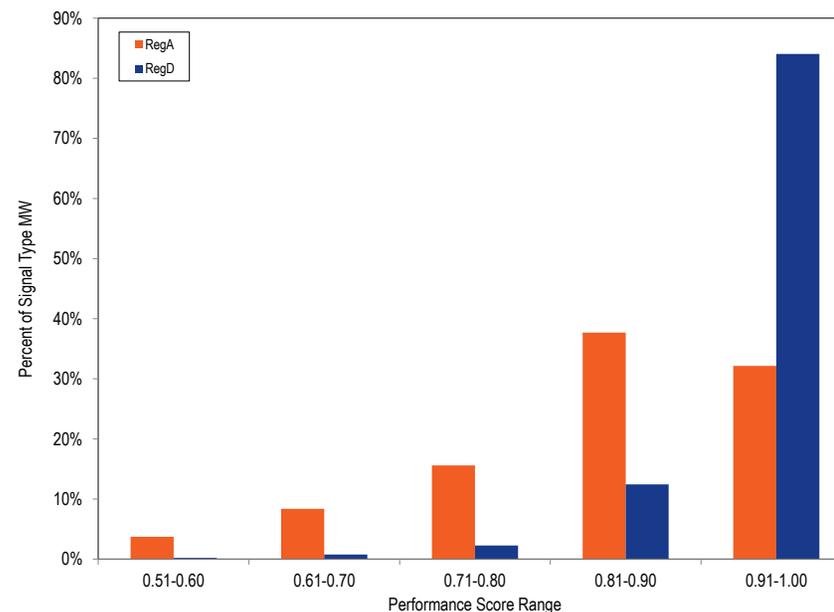

PJM creates an individual resource’s regulation signal proportionately by dividing the assigned regulation of the individual resource by the assigned regulation of the fleet. Then, PJM compares the individual resource’s regulation signal to the individual resource’s MW output (or, for DR, load) to calculate the performance score based on delay, correlation, and precision. Performance scores are calculated using data every 10 seconds, but are reported on an hourly basis for each individual regulating resource.

While resources following RegA and RegD can both provide regulation service in PJM’s Regulation Market, PJM’s joint optimization is intended to determine and assign the optimal mix of RegA and RegD MW to meet the hourly regulation requirement. The optimal mix is a function of the relative effectiveness and cost of available RegA and RegD resources. The optimization of RegA and RegD assignments is dependent on the conversion of RegA and

RegD MW into a single measure. The Marginal Benefit Factor (MBF) is the measure of substitutability of RegD resources for RegA resources in satisfying the regulation requirement.

The MBF, as the marginal rate of substitution between RegA and RegD resource MW for a given regulation requirement, defines specific combinations of RegA and RegD MW needed to meet specific regulation performance levels. The MBF should result in the selection of the least cost combination/ratio of RegA and RegD MW when the prices of RegA and RegD are known. PJM's optimization engine has not properly implemented the MBF so that the market clearing combination of RegA and RegD MW is consistent with the combinations defined by the MBF curve.

For purposes of comparing effective MW to the regulation requirement, expressed in terms of effective MW of RegA, cleared regulation MW are converted to effective MW by multiplying each resource's offered capability MW by the product of the resource specific Benefit Factor and performance score. This resource specific block assignment approach undercounts total effective MW, which are correctly calculated as the area under the MBF curve.

Total regulation offers (made up of a \$/MW capability offer and a \$/mile based performance offer) are converted to dollars per effective MW by dividing the offer by the effective MW.

For example, a 1.0 MW RegD resource with a total offer price of \$2/MW with a resource specific Benefit Factor of 0.5 and a performance score of 100 percent, would be calculated as offering 0.5 effective MW (0.5 Benefit Factor times 1.00 performance score times 1 MW). The total offer price would be \$4 per effective MW (\$2/MW offer divided by the 0.5 effective MW).

## Market Design Issues

### Marginal Benefit Factor Not Reflected in Market

The Marginal Benefit Factor defines the substitutability between RegA and RegD resources in meeting the regulation requirement. If the marginal benefit

factor function is incorrectly defined, the resulting combinations of RegA and RegD do not represent the least cost solution.

The Marginal Benefit Factor is not included in PJM's settlement process. This is a design flaw that results in incorrect payments for regulation. The issue results from two FERC orders. From October 1, 2012, through October 31, 2013, PJM adhered to a FERC order that required the Marginal Benefit Factor be fixed at 1.0 for settlement calculations only. On October 2, 2013, the FERC directed PJM to eliminate the use of the Marginal Benefit Factor entirely from settlement calculations of the capability and performance credits and replace it with the RegD to RegA mileage ratio in the performance credit paid to RegD resources, effective retroactively to October 1, 2012.<sup>41</sup>

The result of the FERC directive is that the marginal benefit factor is used in the optimization to determine the relative value of additional MW of RegD, but the marginal benefit factor is not used in the settlement for RegD.

Resources are paid Regulation Market Clearing Price (RMCP) credits and lost opportunity cost credits. If a resource's lost opportunity costs for an hour are greater than its RMCP credits, that resource receives lost opportunity cost credits equal to the difference.

Figure 10-20 compares the daily average marginal benefit factor and the mileage ratio for excursion and non-excursion hours. Excursion hours (hours ending 7:00, 8:00, 18:00-21:00) are hours in which PJM has decided that more RegA is needed and has therefore capped the benefit factor at a value of 1.0 (which occurs where the x-axis is equal to 26 percent).<sup>42</sup>

The very high mileage ratio on January 1, 2016, was a result of the mechanics of the mileage ratio calculation. The extreme mileage ratios result when the RegA signal is fixed to control ACE and the RegD signal is not. The result of a fixed RegA signal is that RegA mileage is very small and therefore the mileage ratio of RegD/RegA is very large.

<sup>41</sup> 145 FERC ¶ 61,011 (2013).

<sup>42</sup> See PJM. "Manual 11: Energy & Ancillary Services Market Operations," Revision 72, (January 16, 2015); para 3.2.7, pp 63.

This result demonstrates why it is not appropriate to use the mileage ratio, rather than the marginal benefit factor, to measure the relative value of RegA and RegD resources. In these events RegA resources are providing ACE control (regulation service) despite not changing MW output (no mileage), while the change in MW output from RegD resources (positive mileage) is alternating between helping and hurting ACE control.

Figure 10-20 Daily average marginal benefit factor and mileage ratio during excursion and non excursion hours: January through March, 2016


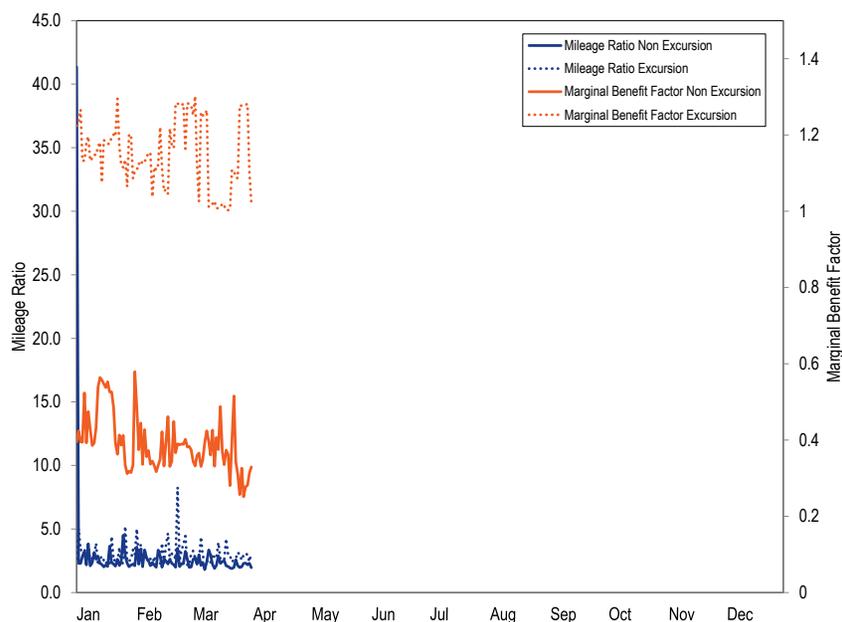


Figure 10-21 shows, by month, both an increasing amount and increasing proportion of cleared RegD MW with an effective price of \$0.00. The figure also shows a corresponding increase in the total RegD MW clearing the market in the period between January 1, 2015 and March 31, 2016. Figure 10-21 also shows that self-scheduling, bidding RegD MW at zero, has increased.<sup>43</sup>

Figure 10-21 Average cleared RegD MW and average cleared RegD with an effective price of \$0.00 by month: January 2015 through March 2016

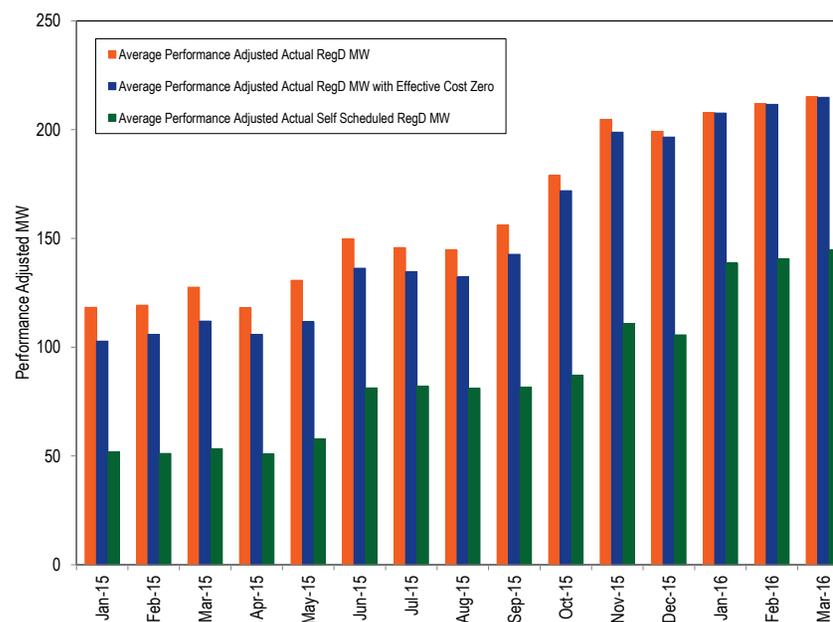

The current settlement process does not result in RegA and RegD resources being paid the same price per effective MW. RegA resources are paid on the basis of dollars per effective MW of RegA. RegD resources are not paid in terms of dollars per effective MW of RegA because the Marginal Benefit Factor is not used in settlements. When the marginal benefit factor is above one, RegD resources are generally (depending on the mileage ratio) underpaid on a per

<sup>43</sup> See the MMU's Regulation Market Review presentation from the May 5, 2015 Operating Committee, available at <<http://www.pjm.com/~media/committees-groups/committees/oc/20150505/20150505-item-17-regulation-market-review.ashx>>.

effective MW basis. When the Marginal Benefit Factor is less than one, RegD resources are generally overpaid on a per effective MW basis.

PJM posts clearing prices for the Regulation Market (RMCCP, RMPCP and RMCP) in dollars per effective regulation capability MW. The regulation market clearing price (RMCP) for the hour is the simple average of the twelve five-minute RMCPs within the hour. The RMCP is set in each five-minute interval based on the marginal offer in each interval. The performance clearing price (\$/effective MW) is based on the marginal performance offer (RMPCP) for the hour. The capability clearing price (\$/effective MW) is equal to the difference between the RMCP for the hour and the RMPCP for the hour.

While prices are set on the basis of dollars per effective MW, only RegA receive payments (credits) that are consistent with their effective MW provided.<sup>44</sup> The current market design does not send the correct price signal to the RegD resources as a result of the inconsistent application of the Marginal Benefit Factor.

Figure 10-22 shows, for the first three months of 2016, the maximum, minimum and average marginal benefit factor, based on PJM's incorrect marginal benefit factor curve, by month, for excursion and nonexcursion hours. The average MBF during excursion hours for the first three months of 2016 was 1.15, and the average MBF during nonexcursion hours for the first three months of 2016 was 0.38. The average MBF for all hours in the first three months of 2015 was 2.01. The Marginal Benefit Factor (MBF) levels were a result of changes in the marginal benefit factor curve made effective on December 14, 2015, which reduced the relative value of RegD MW in the optimization in all hours. The change in the curve was that the slope of the benefit factor curve was altered to intercept the x-axis, defined in terms of RegD MW as a percent of the regulation requirement, at 40 percent instead of 62 percent. PJM also capped the procurement of RegD MW during excursion hours at the point where the MBF on the curve is equal to 1.0.

<sup>44</sup> This is due to the fact that RegA resources performance adjusted MW are their effective MW.

Figure 10-22 Maximum, minimum, and average PJM calculated marginal benefit factor by month for excursion and nonexcursion hours: January through March, 2016


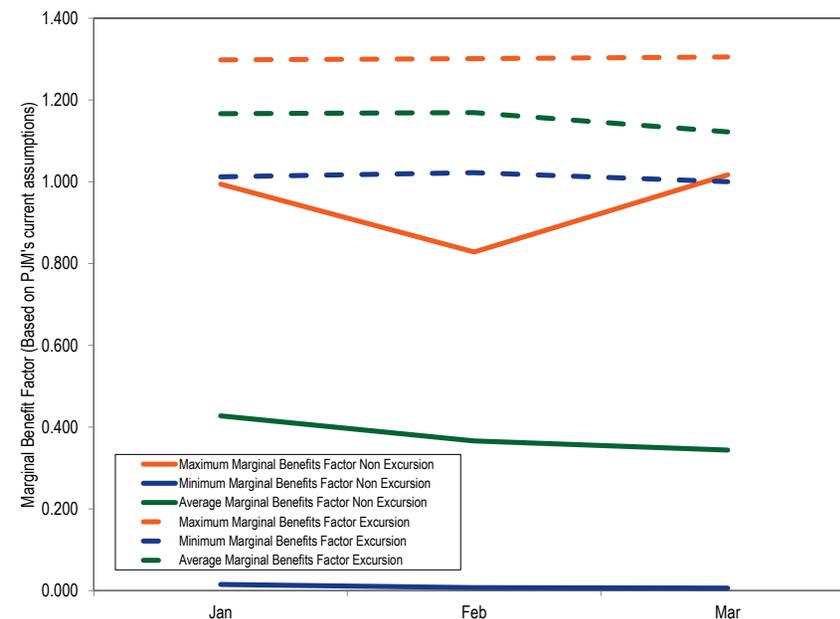


Figure 10-23 shows the marginal benefit factor curve (as incorrectly defined by PJM) before and after the December 14, 2015, modification. The modification to the marginal benefit factor curve reduced the amount of RegD procured, but did not correct for identified issues with the optimization engine.

Correcting the issues with the optimization engine would require correctly defining and using the marginal benefit factor curve, rather than continuing to incorrectly define the MBF as RegD MW cleared as a percentage of the effective MW target.

**Figure 10-23 Marginal benefit factor curve before and after December 14, 2015, revisions by PJM**

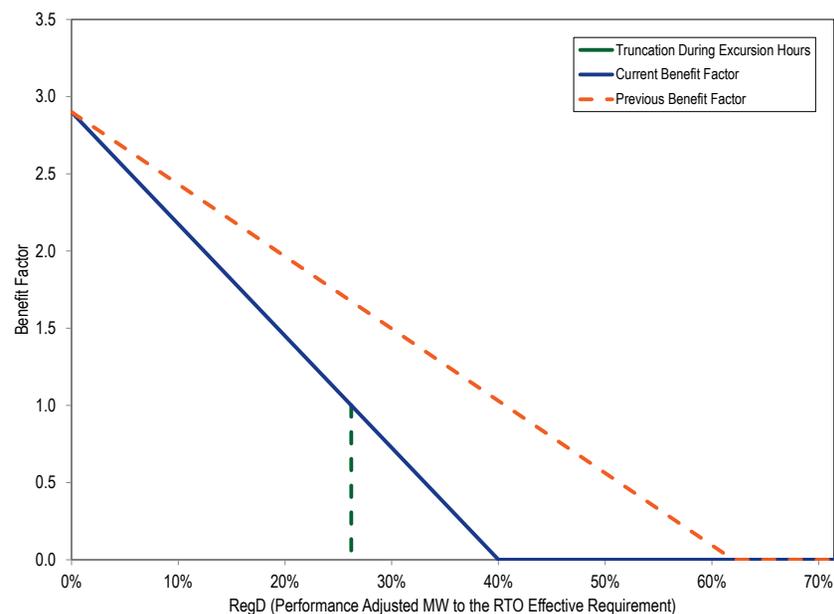

The MMU recommends that the Regulation Market be modified to incorporate a consistent and correct application of the Marginal Benefit Factor throughout the optimization, assignment and settlement process.<sup>45</sup>

### The Effective MW of Regulation Purchased Are Understated

In 2015, the MMU determined that the regulation market optimization/market solution was understating the amount of effective MW provided by RegD. Rather than correctly calculating the total effective MW contribution of RegD MW on the basis of the area under the marginal benefit function curve, the regulation market optimization assigns the MBF associated with the last MW of a cleared unit to every MW of that unit (“unit block”) for purposes of calculating effective MW. PJM then calculates the effective MW as the simple product of the MW and the MBF, rather than the area under the MBF curve

<sup>45</sup> See “Regulation Market Review,” presented at the May 5, 2015 Operating Committee meeting. <<http://www.pjm.com/~media/committees-groups/committees/oc/20150505/20150505-item-17-regulation-market-review.ashx>>.


for that number of MW. The result of this approach is that 100 MW of RegD (performance adjusted) provided by a single resource (one 100 MW unit) will appear to provide fewer effective MW than 100 MW (performance adjusted) provided by two separate 50 MW units although they provide exactly the same effective MW.

In addition, the MMU determined that the regulation market optimization/market solution treats all RegD resources with the same effective price as a single resource (“price block”) for purposes of assigning a benefit factor and calculating effective MW. This means that all of the MW associated with multiple units with the same effective price (for example a price of zero) were assigned the MBF of the last MW of the last unit of that block of resources with the same effective price. PJM then calculates the effective MW as the simple product of the MW and the MBF, rather than the area under the MBF curve for that number of MW. This resulted in an understating effective MW from RegD resources cleared at an effective price of zero or self-scheduled.

The identified effective MW measurement issue was only incompletely addressed by the modification that was put into effect on December 14, 2015. The modification rank orders self-scheduled units and assigns the MBF of the last MW of each of these units to all MW of that unit. The result is to break up the RegD MW in the zero price or self-scheduled block into unit specific blocks of MW that are each assigned a unit specific benefit factor. The resulting effective MW calculation better approximates the area under the marginal benefit factor curve for those price block MW. A full correction of the effective MW calculation requires the use of the area under the curve.

An example illustrates the issue. Figure 10-24 shows the marginal benefit curve, in terms of RegD percent (left diagram) and RegD MW (right diagram) in a scenario where 700 MW of effective MW are needed and the market clears 300 MW of RegD (actual MW), all priced at \$0.00, and 400 MW of RegA. Figure 10-24 shows that the 300 MW of cleared RegD are 42.9 percent of total cleared actual MW and that the Marginal Benefit Factor is 1.0.

Figure 10-24 Example marginal benefit line in percent RegD and RegD MW terms

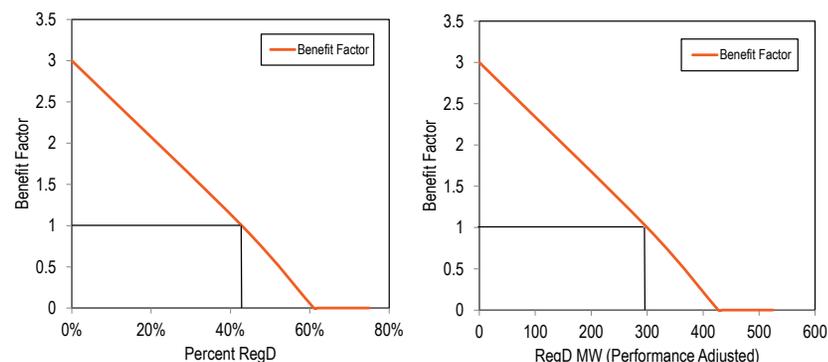

Using PJM’s price block/unit block method for the calculation of effective MW from RegD resources, all RegD resources are assigned the lowest Marginal Benefit Factor associated with the last RegD MW purchased. In this example, all 300 MW have an MBF of 1.0. PJM calculates total effective MW from RegD resources to be 300 (300MW x 1.0 = 300 effective MW).

In Figure 10-25, PJM’s price block/unit block calculation of total effective MW from RegD is represented by the area of the blue rectangle which is 400 effective MW.

PJM’s price block/unit block method is flawed. By assigning a single benefit value to every MW, the price block/unit block methodology undervalues the amount of effective MW provided by RegD MW. This is because the marginal benefit curve represents a marginal rate of substitution between RegD and RegA MW, and the area under the curve, at any RegD amount, represents the total effective MW supplied by RegD at that point. In fact, RegD is providing effective MW equal to area defined by the green triangle and the blue rectangle in Figure 10-25. This corresponds to 600 effective MW being supplied by RegD resources, not 300 effective MW. This means that the actual total effective MW cleared in the market solution is 300 more effective MW than needed to meet the regulation requirement.

Figure 10-25 Illustration of correct method for calculating effective MW

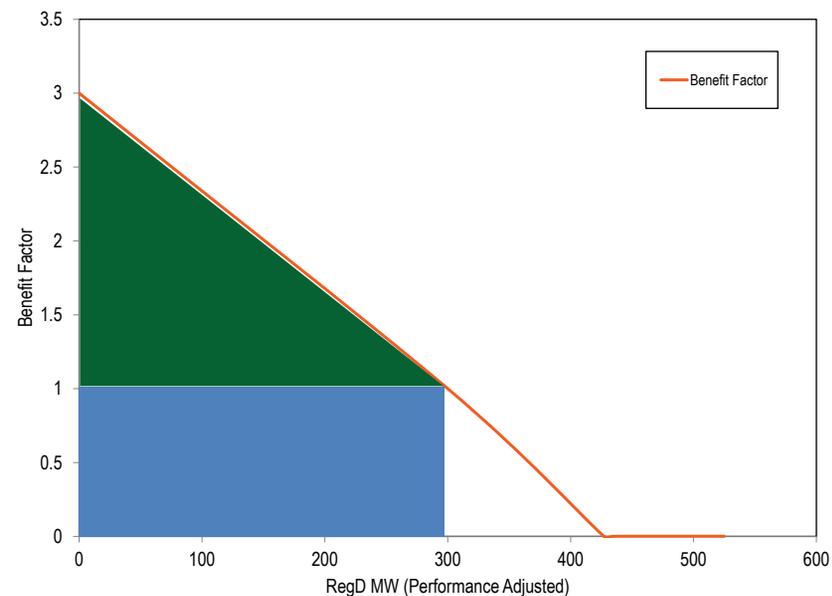


Figure 10-26 illustrates PJM’s December 14, 2015, incomplete correction of the price block/unit block calculation as it applies to RegD resources that clear with an effective price of zero (\$0.00 offer or self-scheduled). In this example, the PJM market clears two self-scheduled resources, one with 100 MW and one with 83 MW, for a total of 183 MW and a market MBF of 1.0. Prior to the fix put in place on December 14, 2015, all 183 MW of RegD would be assigned the MBF of 1.0.

After December 14, 2015, zero price offer and self scheduled resources are rank ordered by performance score and assigned unit specific MBF numbers based on the MBF associated with the last MW of each unit that cleared. Using this new approach, assuming the 83 MW resource was ranked higher than the 100 MW resource, the 83 MW resource would be assigned a unit specific benefit factor of 2.0 (see figure) and the 100 MW resource would be assigned a unit specific Marginal Benefit Factor of 1.0 (see figure).

PJM still calculates effective MW as the simple product of the MW and the MBF, rather than the area under the MBF curve for cleared MW, which results in an effective MW total of 269.9 MW, due to 169.9 effective MW being attributed to the 83 MW resource (83 MW times 2.0 BF) and 100 effective MW being attributed to the 100 MW resource (100 MW times 1.0 BF). This new method provides a closer approximation of the area under the curve, but this updated approach still under estimates the effective MW from cleared RegD resources. Using the area under the curve approach would correctly result in an effective MW total of 355.9 MW being attributed to the 183 MW cleared in the market, not the 266 effective MW of the post December 14, 2015 method or the 183 effective MW of the pre December 14, 2015 method.

**Figure 10-26 Example of Pre and Post December 14, 2015, Effective MW Calculations for RegD MW offered at \$0.00 or as Self Supply**


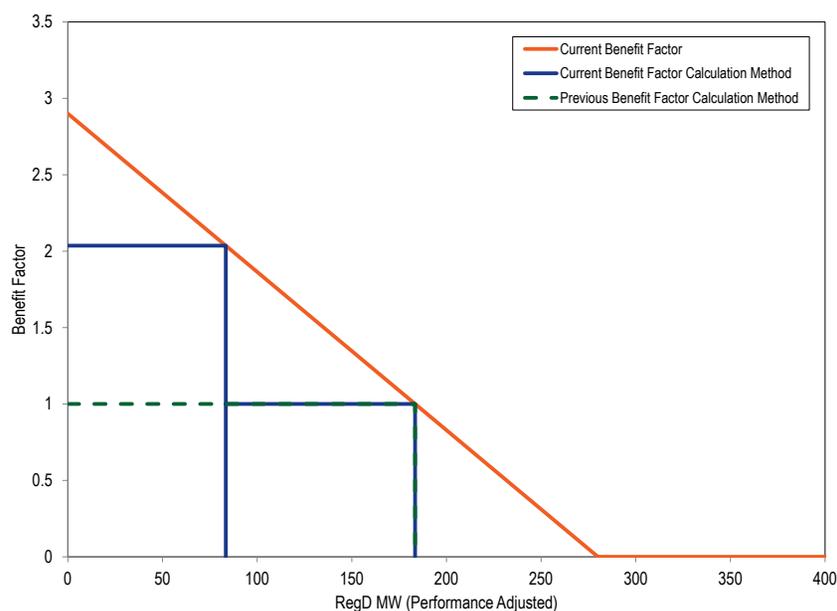


Figure 10-27 shows the average monthly peak total effective MW as calculated by PJM’s incorrect effective MW accounting method(s) and as calculated by a correctly applied marginal benefit factor for the January 2015 through March 2016 period. The figure also shows the monthly average performance adjusted RegA MW and RegD MW cleared in the Regulation Market for the period. Assuming that the current marginal benefit factor function is correct, the figure shows that PJM had been clearing an increasing surplus of effective MW prior to December of 2015.

**Figure 10-27 Average monthly peak effective MW: PJM market calculated versus benefit factor based: January 2015 through March 2016**

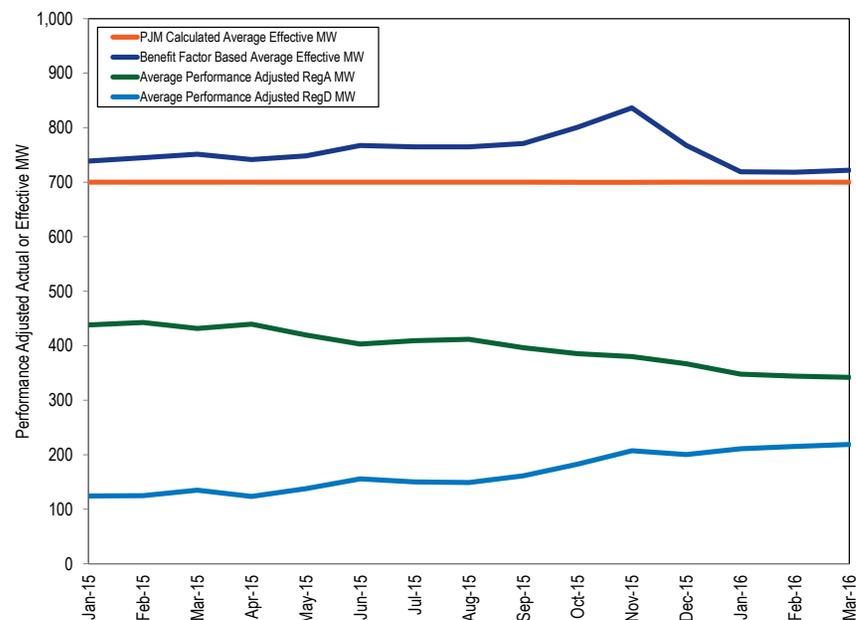


## The Cost of Purchasing Too Many Regulation MW Due to Incorrect Effective MW Calculation Approach

Figure 10-28 shows the cost of the excess effective MW cleared by month, peak and off peak, from January 1, 2015, through March 31, 2016, caused by PJM's incorrect approach(s) to calculating effective MW from RegD resources. To determine this excess cost, the total effective MW of RegD are correctly calculated using the full area under the marginal benefit factor curve, and the difference between that value and the one used by PJM is multiplied by the price in each hour. This excess cost calculation does not take into account the fact that, if calculated correctly, the change in effective MW from RegD would alter the clearing price. The excess cost calculation also does not correct for the PJM's flawed optimization engine which is currently clearing incorrect proportions of RegA and RegD due to an incorrect and inconsistent application of the assumed marginal benefit factor function.

In the first three months of 2016, the estimated total cost of excess effective RegD MW during on peak and off peak hours was \$0.53 million and \$0.47 million. In the first three months of 2015, the estimated total cost of excess RegD MW during on peak and off peak hours was \$4.25 million and \$0.50 million. The implementation of the partial fix to the effective MW calculation and the changes in the marginal benefit factor curve in December of 2015 reduced, but did not eliminate, the excess effective MW clearing in the Regulation Market (See Figure 10-28).

Figure 10-28 Cost of excess effective MW cleared by month, peak and off peak: January 2015 through March 2016

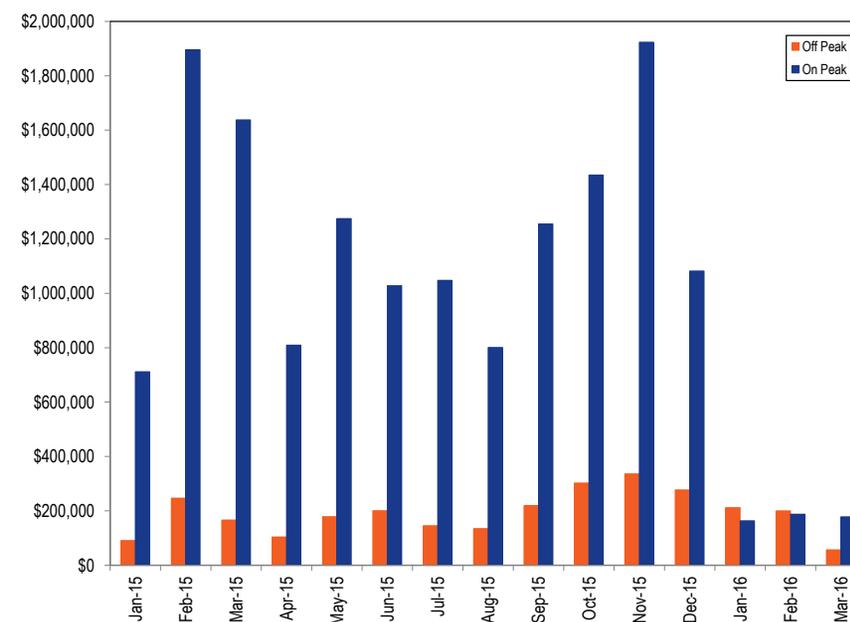

## Market Structure

### Supply

Table 10-30 shows capability MW (actual), average daily offer MW (actual), average hourly eligible MW (actual and effective), and average hourly cleared MW (actual and effective) for all hours in the first three months of 2016. Actual MW are unadjusted regulation capability MW and effective MW are adjusted by the historic 100-hour moving average performance score and resource-specific benefit factor.<sup>46</sup> A resource must be either generation or demand. A resource can choose to follow both signals. For that reason, the sum of each signal type's capability can exceed the full regulation capability. Offered MW are calculated based on the daily offers from units that are categorized as

<sup>46</sup> Unless otherwise noted, analysis provided in this section uses PJM market data based on PJM's internal calculations of effective MW values, based on PJM's currently incorrect MBF curve. The MMU is working with PJM to correct the MBF curve and future analysis will show the effect of this correction.

available for the day. Eligible MW are calculated from the hourly offers from both units with daily offers and units that are categorized as unavailable for the day, but still offer MW into some hours. Additionally, units with daily offers are permitted to offer above or below their daily offer from hour to hour. Because of these hourly MW adjustments to MW offers beyond what was offered on a daily basis, the average hourly Eligible MW can be higher than the Offered MW.

**Table 10-30 PJM regulation capability, daily offer and hourly eligible: January through March 2016<sup>47 48</sup>**

Metric	By Resource Type		By Signal Type		
	All Regulation	Generating Resources	Demand Resources	RegA Following Resources	RegD Following Resources
Capability MW	8,059.0	8,037.1	21.9	7,745.0	630.5
Offered MW	9,774.9	9,753.3	21.5	9,073.5	701.4
Actual eligible MW	1,206.4	1,198.8	7.6	812.4	394.0
Effective eligible MW	930.2	927.7	2.5	590.5	339.6
Actual cleared MW	630.0	626.1	4.0	389.4	240.7
Effective cleared MW	663.7	661.6	2.1	325.2	338.5

**Table 10-31 PJM regulation by source in January through March 2016<sup>49</sup>**

Source	2015 (Jan-Mar)				2016 (Jan-Mar)			
	Number of Units	Adjusted Settled Regulation (MW)	Percent of Scheduled Regulation	Total Regulation Credits	Number of Units	Adjusted Settled Regulation (MW)	Percent of Scheduled Regulation	Total Regulation Credits
Battery	30	248,152.7	20.6%	\$10,637,019	38	374,038.7	44.1%	\$5,966,120
Coal	236	175,808.9	14.6%	\$12,768,430	73	68,576.4	8.1%	\$1,541,151
Hydro	75	211,161.8	17.5%	\$14,773,634	65	165,459.6	19.5%	\$3,609,712
Natural Gas	227	561,944.1	46.6%	\$28,118,373	129	232,962.3	27.4%	\$4,026,244
DR	158	8,255.3	0.7%	\$372,598	75	7,661.2	0.9%	\$123,388
Total	726	1,205,322.9	100.0%	\$66,670,054	380	848,698.1	100.0%	\$15,266,616

Table 10-31 provides the scheduled regulation in MW by source, the total scheduled regulation in MW provided by all resources (including DR), and the percent of scheduled regulation provided by each fuel type. In Table 10-31 the MW have been adjusted by the actual within hour performance score since

<sup>47</sup> Average Daily Offer MW excludes units that have offers but are unavailable for the day.

<sup>48</sup> Total offer capability is defined as the sum of the maximum daily offer volume for each offering unit during the period, without regard to the actual availability of the resource or to the day on which the maximum was offered.

<sup>49</sup> Biomass data have been added to the natural gas category for confidentiality purposes.

this adjustment forms the basis of payment for units providing regulation. Total regulation capability MW decreased from 1,205,468.0 MW in the first three months of 2015 to 848,698.1 MW in the first three months of 2016. The average proportion of regulation provided by battery units had the largest increase, providing 20.6 percent of regulation in the first three months of 2015 and 44.1 percent of regulation in the first three months of 2016. Natural gas units had the largest decrease in average proportion of regulation provided, decreasing from 45.9 percent in the first three months of 2015, to 27.2 percent in the first three months of 2016. The total regulation credits in the first three months of 2016 were \$15,266,616, down from \$66,670,054 in the first three months of 2015.

The supply of regulation can be affected by regulating units retiring from service. If all units that are requesting retirement through the end of 2016 retire, the supply of regulation in PJM will be reduced by less than one percent.

Although the marginal benefit factor for RegA resources is 1.0, the effective MW of RegA resources was lower than the offered MW in the first three months of 2016, because the average performance score was less than 1.00. For the first three months of 2016, the MW weighted average RegA performance score was 0.83 and there were 168 resources following the RegA signal.

For RegD resources, the total effective MW vary from actual MW because the marginal benefit factor for RegD resources can range from 2.9 to 0.0. In the first three months of 2016, the marginal benefit factor, based on PJM's current assumed marginal benefit factor curve, for cleared RegD resources ranged from 0.005 to 1.401 with an average over all hours of 0.483. In the first three months of 2016, the MW weighted average RegD resource performance score was 0.94 and there were 43 resources following the RegD signal.

## Demand

The demand for regulation does not change with price. The regulation requirement is set by PJM to meet NERC control standards, based on reliability objectives, which means that a significant amount of judgment is exercised by PJM in determining the actual demand. Prior to October 1, 2012, the regulation requirement was 1.0 percent of the forecast peak load for on peak hours and 1.0 percent of the forecast valley load for off peak hours. Between October 1, 2012, and December 31, 2012, PJM changed the regulation requirement several times. It had been scheduled to be reduced from 1.0 percent of peak load forecast to 0.9 percent on October 1, 2012, but instead it was changed from 1.0 percent of peak load forecast to 0.78 percent of peak load forecast. It was further reduced to 0.74 percent of peak load forecast on November 22, 2012 and reduced again to 0.70 percent of peak load forecast on December 18, 2012. On December 14, 2013, it was reduced to 700 effective MW during peak hours and 525 effective MW during off peak hours. The regulation requirement remained 700 effective MW during peak hours and 525 effective MW during off peak hours in 2015.

**Table 10-32 PJM Regulation Market required MW and ratio of eligible supply to requirement for on and off peak hours: January through March 2015 and 2016**

Peak	Month	Average Required Regulation (MW), 2015	Average Required Regulation (MW), 2016	Average Required Regulation (Effective MW), 2015	Average Required Regulation (Effective MW), 2016	Ratio of Supply MW to MW Requirement, 2015	Ratio of Supply MW to MW Requirement, 2016	Ratio of Supply Effective MW to Effective MW Requirement, 2015	Ratio of Supply Effective MW to Effective MW Requirement, 2016
On	Jan	675.8	657.5	700.1	700.1	1.82	1.83	1.33	1.34
	Feb	695.3	663.6	699.9	700.1	1.69	1.84	1.34	1.38
	Mar	689.5	640.6	700.0	700.0	1.67	1.90	1.33	1.39
Off	Jan	495.8	553.8	525.5	525.0	2.07	2.15	1.46	1.56
	Feb	508.0	550.0	525.1	525.6	2.03	2.17	1.50	1.56
	Mar	497.7	517.0	525.3	525.0	2.06	2.25	1.43	1.57

Table 10-32 shows the average hourly required regulation by month and its relationship to the supply of regulation for both actual (unadjusted) and effective MW. The average hourly required regulation by month is an average across all of the hours in that month. The average hourly required effective

MW of regulation is a weighted average of the requirement of 700 effective MW during peak hours and the requirement of 525 effective MW during off peak hours.

## Market Concentration

In the first three months of 2016, the weighted average HHI of RegA resources was 2708 which is highly concentrated and the weighted average HHI of RegD resources was 1927 which is highly concentrated.<sup>50</sup> The weighted average HHI of all resources was 1169 which is moderately concentrated. The HHI of RegA resources and the HHI of RegD resources are higher than the HHI for all resources because different owners have large market shares in the RegA and RegD markets.

Table 10-33 includes a monthly summary of three pivotal supplier results. In the first three months of 2016, 90.9 percent of hours had three or fewer pivotal suppliers. The impact of offer capping in the regulation market is limited because of the role of LOC in price formation (Figure 10-30). The MMU concludes from these results, that the PJM Regulation Market in the first three months of 2016 was characterized by structural market power in 90.9 percent of hours.

<sup>50</sup> HHI results are based on market shares of effective MW, defined as regulation capability MW adjusted by performance score and resource-specific benefit factor, consistent with the way the regulation market is cleared.

**Table 10-33 Regulation market monthly three pivotal supplier results: 2014 through March 2016**

Month	Percent of Hours Pivotal		
	2014	2015	2016
Jan	96.9%	97.8%	93.9%
Feb	98.7%	96.3%	90.9%
Mar	94.9%	97.3%	87.8%
Apr	89.0%	98.1%	
May	95.7%	99.3%	
Jun	99.4%	98.6%	
Jul	100.0%	98.8%	
Aug	99.7%	97.7%	
Sep	99.4%	97.1%	
Oct	99.1%	96.1%	
Nov	98.9%	99.2%	
Dec	98.1%	97.2%	
Average	97.5%	97.8%	90.9%

## Market Conduct

### Offers

Resources seeking to regulate must qualify to follow a regulation signal by passing a test for that signal with at least a 75 percent performance score. The regulating resource must be able to supply at least 0.1 MW of regulation and must not allow the sum of its regulating ramp rate and energy ramp rate to exceed its economic ramp rate. When offering into the regulation market, regulating resources must submit a cost offer and, optionally, a price offer (capped at \$100/MW) by 6:00 pm the day before the operating day.

Offers in the Regulation Market consist of a capability component for the MW of regulation capability provided and a performance component for the miles ( $\Delta$ MW of regulation movement) provided. The capability component for cost offers is not to exceed the increased costs (specifically, increased fuel costs and lower efficiency) resulting from operating the regulating unit at a lower output level than its economically optimal output level plus a \$12.00/MW adder. The performance component for cost offers is not to exceed the increased costs (specifically, increased VOM and lower efficiency) resulting from operating the regulating unit in a nonsteady state. Batteries and flywheels have zero

cost for lower efficiency from providing regulation instead of energy, as they are not net energy producers. Instead batteries and flywheels are, due to losses, net consumers of energy when providing regulation service. On April 1, 2015, PJM added an Energy Storage Loss component for batteries and flywheels as a cost component of regulation performance offers to the eMkt Regulation Offers screen, to reflect the net energy consumed to provide regulation service.<sup>51</sup>

Up until one hour before the operating hour, the regulating resource must input or may change: status (available, unavailable, or self-scheduled); capability (movement up and down in MW); regulation maximum and regulation minimum (the highest and lowest levels of energy output while regulating in MW); and the regulation signal type (RegA or RegD). Resources may offer regulation for both the RegA and RegD signals, but will be assigned to follow only one signal for a given operating hour. Resources have the option to submit a minimum level of regulation they require to regulate.<sup>52</sup>

All LSEs are required to provide regulation in proportion to their load share. LSEs can purchase regulation in the regulation market, purchase regulation from other providers bilaterally, or self schedule regulation to satisfy their obligation (Table 10-35).<sup>53</sup> Figure 10-29 compares average hourly regulation and self scheduled regulation during on peak and off peak hours on an effective MW basis. The average hourly regulation is the amount of regulation that actually cleared and is not the same as the regulation requirement because PJM clears the market within a two percent band around the requirement.<sup>54</sup> Self scheduled regulation during on peak and off peak hours varies from hour to hour and comprises a large portion of total effective regulation per hour (average of 40.8 percent during on peak and 52.4 percent during off peak hours in the first three months of 2016).

<sup>51</sup> See PJM. "Manual 15: Cost Development Guidelines," Revision 26, (November 6, 2014); para 11.8, p. 60.

<sup>52</sup> See PJM. "Manual 11: Energy & Ancillary Services Market Operations," Revision 72, (January 16, 2015); para 3.2.2, pp 48.

<sup>53</sup> See PJM. "Manual 28: Operating Agreement Accounting," Revision 68, (January 16, 2015); para 4.1, p 15.

<sup>54</sup> See PJM. "Manual 11: Energy & Ancillary Services Market Operations," Revision 72, (January 16, 2015); para 3.2.9, p 59.

Figure 10-29 Off peak and on peak regulation levels: January 2015 through March 2016

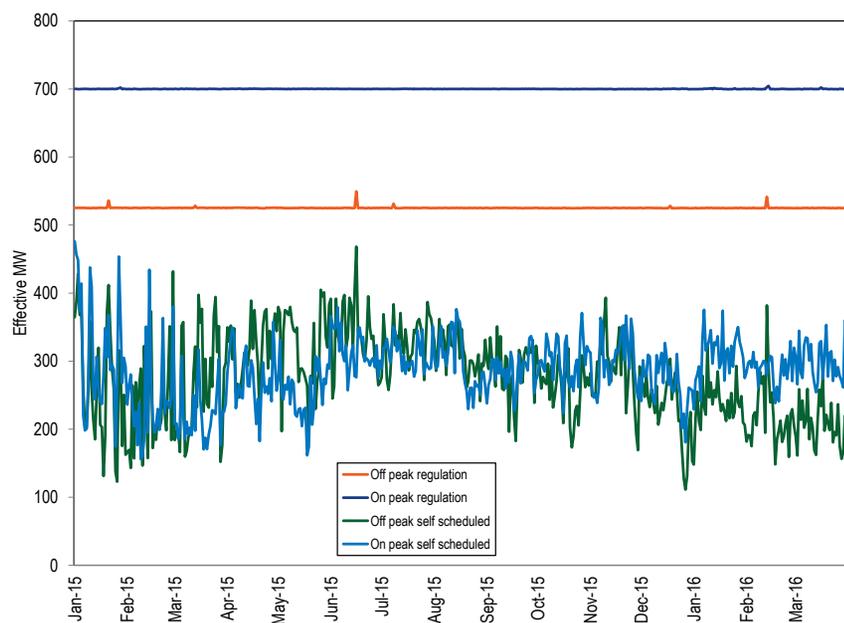


Table 10-34 shows the role of RegD resources in the regulation market. RegD resources are both a growing proportion of the market (10.9 percent of the total effective MW at the start of the performance based regulation market design in October 2012 and 51.3 percent in March 2016) and a growing proportion of resources that self schedule (10.1 percent in October 2012 and 27.5 percent in March 2016).

Table 10-34 RegD self-scheduled regulation by month, October 2012 through March 2016

Year	Month	RegD Self Scheduled Effective MW	RegD Effective MW	Total Self Scheduled Effective MW	Total Effective MW	Percent of Total Self Scheduled	RegD Percent of Total Self Scheduled	RegD Percent of Total Effective MW
2012	Oct	66.3	71.8	264.7	658.1	40.2%	10.1%	10.9%
2012	Nov	74.4	88.3	196.5	716.5	27.4%	10.4%	12.3%
2012	Dec	82.5	88.8	188.8	701.1	26.9%	11.8%	12.7%
2013	Jan	35.7	82.5	133.6	720.0	18.6%	5.0%	11.5%
2013	Feb	84.8	90.2	212.2	724.3	29.3%	11.7%	12.5%
2013	Mar	80.1	119.3	279.8	680.7	41.1%	11.8%	17.5%
2013	Apr	82.3	106.9	266.0	594.1	44.8%	13.8%	18.0%
2013	May	74.0	109.0	268.2	616.2	43.5%	12.0%	17.7%
2013	Jun	79.6	122.7	334.9	730.6	45.8%	10.9%	16.8%
2013	Jul	77.6	120.4	303.6	822.9	36.9%	9.4%	14.6%
2013	Aug	83.6	127.6	366.0	756.8	48.4%	11.0%	16.9%
2013	Sep	112.2	152.1	381.6	669.9	57.0%	16.7%	22.7%
2013	Oct	120.2	163.7	349.6	613.3	57.0%	19.6%	26.7%
2013	Nov	133.9	175.7	396.5	663.3	59.8%	20.2%	26.5%
2013	Dec	136.5	180.7	313.6	663.5	47.3%	20.6%	27.2%
2014	Jan	132.9	193.5	261.1	663.6	39.3%	20.0%	29.2%
2014	Feb	134.3	193.4	289.0	663.6	43.5%	20.2%	29.1%
2014	Mar	131.8	193.8	287.2	663.8	43.3%	19.9%	29.2%
2014	Apr	126.8	212.4	270.8	663.7	40.8%	19.1%	32.0%
2014	May	121.7	248.5	265.6	663.6	40.0%	18.3%	37.4%
2014	Jun	123.3	231.0	365.5	663.9	55.0%	18.6%	34.8%
2014	Jul	126.4	235.5	352.7	663.5	53.2%	19.0%	35.5%
2014	Aug	117.6	229.8	368.2	663.6	55.5%	17.7%	34.6%
2014	Sep	121.0	242.6	393.8	663.6	59.3%	18.2%	36.6%
2014	Oct	116.1	255.4	352.7	663.6	53.2%	17.5%	38.5%
2014	Nov	113.5	235.1	347.5	664.2	52.3%	17.1%	35.4%
2014	Dec	116.7	254.3	353.0	663.6	53.2%	17.6%	38.3%
2015	Jan	116.4	250.1	304.8	663.7	45.9%	17.5%	37.7%
2015	Feb	111.3	245.8	242.6	663.5	36.6%	16.8%	37.0%
2015	Mar	113.8	255.2	229.9	663.8	34.6%	17.1%	38.5%
2015	Apr	110.1	248.2	283.7	663.7	42.7%	16.6%	37.4%
2015	May	121.8	265.1	266.7	663.6	40.2%	18.4%	39.9%
2015	Jun	158.9	283.1	321.2	663.7	48.4%	23.9%	42.6%
2015	Jul	161.4	278.3	314.0	663.8	47.3%	24.3%	41.9%
2015	Aug	159.5	276.0	300.7	663.6	45.3%	24.0%	41.6%
2015	Sep	155.4	289.2	286.0	663.5	43.1%	23.4%	43.6%
2015	Oct	147.1	299.0	292.8	663.4	44.1%	22.2%	45.1%
2015	Nov	164.9	302.1	298.1	664.2	44.9%	24.8%	45.5%
2015	Dec	144.6	317.2	260.7	663.9	39.3%	21.8%	47.8%
2016	Jan	187.7	335.9	295.3	663.8	44.5%	28.3%	50.6%
2016	Feb	179.9	339.0	274.6	663.6	41.4%	27.1%	51.1%
2016	Mar	182.6	340.8	280.1	663.7	42.2%	27.5%	51.3%
Average		119.6	210.7	295.6	672.6	44.1%	17.9%	31.6%

Increased self-scheduled regulation lowers the requirement for cleared regulation, resulting in fewer MW cleared in the market and lower clearing prices. Of the LSEs' obligation to provide regulation in the first three months of 2016, 49.0 percent was purchased in the PJM market, 45.7 percent was self-scheduled, and 5.3 percent was purchased bilaterally (Table 10-35). Table 10-36 shows the total regulation by source including spot market regulation, self scheduled regulation, and bilateral regulation for the first three months of each year from 2011 to 2016. Table 10-35 and Table 10-36 are based on settled (purchased) unadjusted MW.

**Table 10-35 Regulation sources: spot market, self-scheduled, bilateral purchases: January 2014 through March 2016**

Year	Month	Spot Market Regulation (Unadjusted MW)	Spot Market Percent of Total	Self Scheduled Regulation (MW)	Self Scheduled Percent of Total	Bilateral Regulation (Unadjusted MW)	Bilateral Percent of Total	Total Regulation (Unadjusted MW)
2015	Jan	198,056.1	50.2%	173,319.4	44.0%	22,975.0	5.8%	394,350.5
2015	Feb	219,652.3	61.6%	116,607.5	32.7%	20,137.6	5.7%	356,397.3
2015	Mar	252,402.2	64.0%	122,001.9	30.9%	20,255.0	5.1%	394,659.0
2015	Apr	197,934.5	52.3%	159,511.3	42.1%	21,236.5	5.6%	378,682.3
2015	May	227,527.5	57.5%	148,998.3	37.7%	19,191.5	4.8%	395,717.3
2015	Jun	186,186.4	48.6%	174,157.4	45.5%	22,613.0	5.9%	382,956.8
2015	Jul	199,332.1	50.5%	172,743.7	43.7%	22,845.0	5.8%	394,920.8
2015	Aug	207,794.6	53.0%	162,197.5	41.3%	22,412.5	5.7%	392,404.7
2015	Sep	207,352.6	54.6%	150,467.7	39.6%	21,863.0	5.8%	379,683.3
2015	Oct	213,982.2	53.4%	169,283.3	42.2%	17,724.5	4.4%	400,990.0
2015	Nov	213,952.0	52.9%	172,561.3	42.7%	17,790.0	4.4%	404,303.3
2015	Dec	220,651.8	54.1%	166,189.2	40.7%	21,342.5	5.2%	408,183.5
Total		2,544,824.4	54.3%	1,888,038.5	40.3%	250,386.1	5.3%	4,683,248.9
2016	Jan	197,057.9	47.8%	193,581.9	47.0%	21,671.0	5.3%	412,310.8
2016	Feb	190,660.0	49.7%	173,440.5	45.2%	19,546.0	5.1%	383,646.6
2016	Mar	196,173.9	49.5%	178,413.1	45.0%	22,017.0	5.6%	396,604.0
Total		583,891.8	49.0%	545,435.6	45.7%	63,234.0	5.3%	1,192,561.4

**Table 10-36 Regulation sources by year: 2011 through 2016**

Year (Jan-Mar)	Spot Market Regulation (Unadjusted MW)	Spot Market Percent of Total	Self Scheduled Regulation (Unadjusted MW)	Self Scheduled Percent of Total	Bilateral Regulation (Unadjusted MW)	Bilateral Percent of Total	Total Regulation (Unadjusted MW)
2011	1,501,821.7	78.9%	338,780.0	17.8%	62,722.0	3.3%	1,903,323.8
2012	1,510,190.1	73.4%	485,672.8	23.6%	61,563.0	3.0%	2,057,425.9
2013	1,026,962.9	73.0%	342,003.1	24.3%	38,538.5	2.7%	1,407,504.5
2014	723,933.3	61.1%	404,831.9	34.1%	56,853.5	4.8%	1,185,618.6
2015	670,110.6	58.5%	411,928.8	36.0%	63,367.6	5.5%	1,145,406.9
2016	583,891.8	49.0%	545,435.6	45.7%	63,234.0	5.3%	1,192,561.4

In the first three months of 2016, DR provided an average of 4.0 MW of regulation per hour (3.7 MW of regulation per hour in the same period of 2015). Generating units supplied an average of 626.1 MW of regulation per hour (644.1 MW of regulation per hour in the same period of 2015).

## Market Performance

### Price

Since the implementation of regulation performance on October 1, 2012, both regulation price and regulation cost per MW are higher than they were prior to October 1, 2012, (Table 10-38). In the first three months of 2016, the price and cost of regulation have remained high relative to prior years with the exception of 2014. The weighted average RMCP for the first three months of 2016 was \$15.55 per effective MW. This is a 67.5 percent decrease from the weighted average RMCP of \$47.90 per MW in the first three months of 2015. The decrease in the regulation clearing price was the result of a reduction in energy prices and the related reduction in the LOC component of RMCP. The increase in self supply and \$0.00 offers from RegD resources in the first three months of 2016 also contributed to lower prices.

Figure 10-30 shows the daily weighted average regulation market clearing price and the opportunity cost component for the marginal units in the PJM Regulation Market on an unadjusted regulation capability MW basis. This data is based on actual five minute interval operational data. As Figure 10-30 illustrates, the LOC component (blue line) is the dominant component of the clearing price.

Figure 10-30 PJM regulation market daily weighted average market-clearing price, marginal unit opportunity cost and offer price (Dollars per MW): January through March 2016

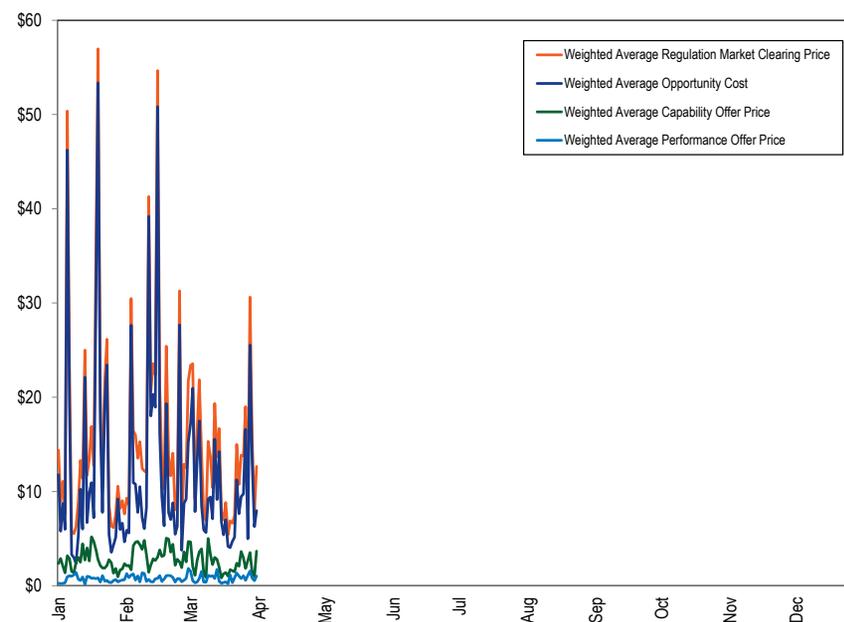


Table 10-37 shows monthly average regulation market clearing price, average marginal unit offer price, and average marginal unit LOC on an unadjusted capability MW basis. This data is based on actual five minute interval operational data.

**Table 10-37 PJM regulation market monthly weighted average market-clearing price, marginal unit opportunity cost and offer price from five minute market solution data (Dollars per MW): January through March 2016**

Month	Weighted Average Regulation Marginal Unit LOC	Weighted Average Regulation Marginal Unit Capability Offer	Weighted Average Regulation Marginal Unit Performance Offer	Weighted Average Regulation Market Clearing Price
Jan	\$12.27	\$2.55	\$0.67	\$15.49
Feb	\$13.76	\$3.33	\$0.85	\$17.94
Mar	\$10.04	\$2.36	\$0.82	\$13.21

Monthly and total annual scheduled regulation MW and regulation charges, as well as monthly and monthly average regulation price and regulation cost are shown in Table 10-38. Total scheduled regulation is based on settled (unadjusted capability) MW. The total of all regulation charges for the first three months of 2016 was \$21.4 million, compared to \$66.7 million for the first three months of 2015.

**Table 10-38 Total regulation charges: January 2015 through March 2016<sup>55</sup>**

Year	Month	Scheduled Regulation (MW)	Total Regulation Charges (\$)	Weighted Average Regulation Market Price (\$/MW)	Cost of Regulation (\$/MW)	Price as Percent of Cost
2015	Jan	394,350.5	\$13,054,006	\$27.13	\$33.10	81.9%
2015	Feb	356,397.3	\$31,757,444	\$73.24	\$89.11	82.2%
2015	Mar	394,659.0	\$21,887,989	\$45.79	\$55.46	82.6%
2015	Apr	378,682.3	\$14,876,920	\$32.77	\$39.29	83.4%
2015	May	395,717.3	\$21,030,737	\$43.12	\$53.15	81.1%
2015	Jun	382,956.8	\$11,544,657	\$25.94	\$30.15	86.0%
2015	Jul	394,920.8	\$11,484,271	\$24.40	\$29.08	83.9%
2015	Aug	392,404.7	\$9,913,785	\$20.85	\$25.26	82.5%
2015	Sep	379,683.3	\$13,639,604	\$29.71	\$35.92	82.7%
2015	Oct	400,990.0	\$10,904,138	\$23.12	\$27.19	85.0%
2015	Nov	404,303.3	\$10,221,684	\$21.92	\$25.28	86.7%
2015	Dec	408,183.5	\$9,323,436	\$19.58	\$22.84	85.7%
	2015 Annual	4,683,248.9	\$179,638,672	\$32.30	\$38.82	83.7%
2016	Jan	412,310.8	\$7,589,231	\$15.65	\$18.41	85.0%
2016	Feb	383,646.6	\$7,677,113	\$17.63	\$20.01	88.1%
2016	Mar	396,604.0	\$6,107,773	\$13.43	\$15.40	87.2%
	2016 YTD	1,192,561.4	\$21,374,117	\$15.57	\$17.94	86.8%

The capability, performance, and opportunity cost components of the cost of regulation are shown in Table 10-39. Total scheduled regulation is based on settled (unadjusted capability) MW.

<sup>55</sup> Weighted average market clearing prices presented here are taken from PJM settlements data, and differ from the values reported in Table 10-37, which are from five minute interval operational data. The MMU is investigating the cause of the discrepancies with PJM.

**Table 10-39 Components of regulation cost: January through March, 2016**

Month	Scheduled Regulation (MW)	Cost of Regulation Capability (\$/MW)	Cost of Regulation Performance (\$/MW)	Opportunity Cost (\$/MW)	Total Cost (\$/MW)
Jan	412,310.8	\$14.49	\$1.97	\$1.95	\$18.41
Feb	383,646.6	\$16.00	\$2.61	\$1.40	\$20.01
Mar	396,604.0	\$12.01	\$2.25	\$1.14	\$15.40

Table 10-40 provides a comparison of the average price and cost for PJM regulation. The ratio of regulation market price to the actual cost of regulation in the first three months of 2016 was 86.8 percent, a 4.5 percent increase from 82.3 percent in the first three months of 2015.

**Table 10-40 Comparison of average price and cost for PJM Regulation, January through March 2011 through 2016**

Year (Jan-Mar)	Weighted Regulation Market Price	Weighted Regulation Market Cost	Regulation Price as Percent Cost
2011	\$11.52	\$25.03	46.0%
2012	\$12.62	\$16.75	75.3%
2013	\$33.91	\$39.36	86.2%
2014	\$92.98	\$112.31	82.8%
2015	\$47.90	\$58.23	82.3%
2016	\$15.55	\$17.92	86.8%

### Performance Standards


PJM’s performance as measured by CPS1 and BAAL standards is shown in Figure 10-31 for every month from January 2011 through March 2016 with the dashed vertical line marking the date (October 1, 2012) of the implementation of the Performance Based Regulation Market design.<sup>56</sup> The horizontal dashed lines represent PJM internal goals for CPS1 and BAAL performance. While PJM did not meet its internal goal for BAAL performance in January 2014, PJM remained in compliance with the applicable NERC standards.

Very cold weather from January 6 through January 8 and from January 17 through January 29, 2014, caused extreme system conditions, including 12 synchronized reserve events, seven RTO-wide shortage pricing events and high forced outage rates. As a result, PJM experienced several frequency

<sup>56</sup> See the 2014 State of the Market Report for PJM, Appendix F: Ancillary Services.

excursions of between 10 and 20 minutes which caused PJM’s performance on the BAAL metric, a measure of a balancing authority’s ability to control ACE and frequency, to decline substantially.

**Figure 10-31 PJM monthly CPS1 and BAAL performance: January 2011 through March 2016**

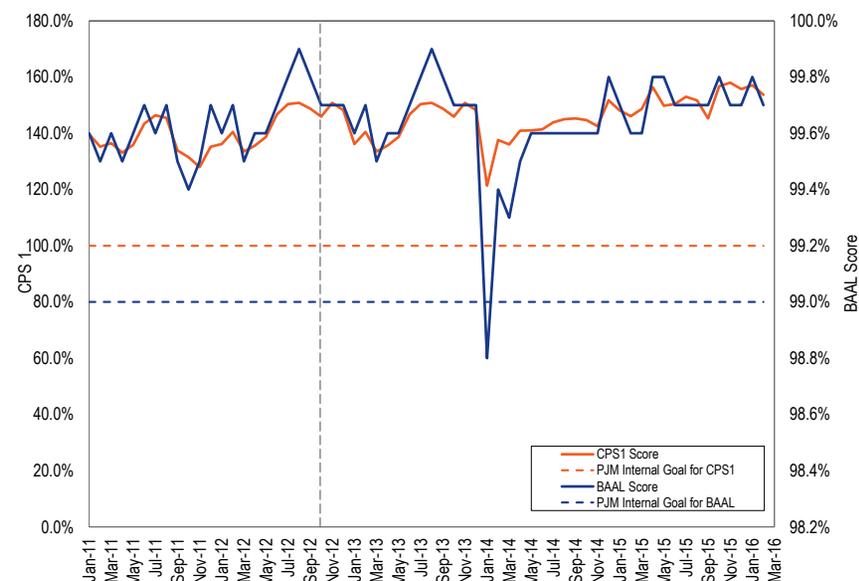

### Black Start Service

Black start service is necessary to ensure the reliable restoration of the grid following a blackout. Black start service is the ability of a generating unit to start without an outside electrical supply, or the demonstrated ability of a generating unit to automatically remain operating when disconnected from the grid.

PJM does not have a market to provide black start service, but compensates black start resource owners on the basis of an incentive rate or for the costs associated with providing this service.

PJM defines required black start capability zonally and ensures the availability of black start service by charging transmission customers according to their zonal load ratio share and compensating black start unit owners. Substantial rule changes to the black start restoration and procurement strategy were implemented on February 28, 2013, following a stakeholder process in the System Restoration Strategy Task Force (SRSTF) and the Markets and Reliability Committee (MRC) that approved the PJM and MMU joint proposal for system restoration. These changes give PJM substantial flexibility in procuring black start resources and make PJM responsible for black start resource selection.

On July 1, 2013, PJM initiated its first RTO-wide request for proposals (RFP) under the new rules.<sup>57 58</sup> PJM set a September 30, 2013, deadline for resources submitting proposals and requested that resources be able to provide black start by April 1, 2015. PJM identified zones with black start shortages, prioritized its selection process accordingly, and began awarding proposals on January 14, 2014. PJM and the MMU coordinated closely during the selection process.

PJM issued two incremental RFPs in 2014. On April 11, 2014, PJM sought additional black start in the AEP Zone and one proposal was selected. On November 24, 2014, PJM sought additional black start in northeastern Ohio and western Pennsylvania, but no proposals were selected because they did not meet the bid requirements. On July 28, 2015, PJM issued two Incremental Request for Proposals, one for northeastern Ohio and another for western Pennsylvania. The bids are currently under review.

Black start payments are non-transparent payments made to units by load to maintain adequate reliability to restart the system in case of a blackout. Current rules appear to prevent publishing detailed data regarding these black start resources, hindering transparency and competitive replacement RFPs. The MMU recommends that the current confidentiality rules be revised to

allow disclosure of information regarding black start resources and their associated payments.

Total black start charges are the sum of black start revenue requirement charges and black start operating reserve charges. Black start revenue requirements for black start units consist of fixed black start service costs, variable black start service costs, training costs, fuel storage costs, and an incentive factor. Section 18 of Schedule 6A of the OATT specifies how to calculate each component of the revenue requirement formula. Black start resources can choose to recover fixed costs under a formula rate based on zonal Net CONE and unit ICAP rating, a cost recovery rate based on incremental black start NERC-CIP compliance capital costs, or a cost recovery rate based on incremental black start equipment capital costs. Black start operating reserve charges are paid to units scheduled in the Day-Ahead Energy Market or committed in real time to provide black start service under the automatic load rejection (ALR) option or for black start testing. Total black start charges are allocated monthly to PJM customers proportionally to their zone and non-zone peak transmission use and point to point transmission reservations.

In the first three months of 2016, total black start charges were \$12.9 million, a -\$2.1 million (14.1 percent) decrease from the same period of 2015 level of \$15.0 million. Operating reserve charges for black start service declined from \$4.7 million in 2015 to \$16.9 thousand in 2016. Table 10-41 shows total revenue requirement charges from 2010 through 2016. (Prior to December 2012, PJM did not define a black start operating reserve category. Prior to December 2012, operating reserve charges resulting from units providing black start service were allocated as operating reserve charges for reliability in the western region.)

<sup>57</sup> See PJM, "RTO-Wide Five-Year Selection Process Request for Proposal for Black Start Service," (July 1, 2013).

<sup>58</sup> RFPs issued can be found on the PJM website. See PJM. <<http://www.pjm.com/markets-and-operations/ancillary-services.aspx>>.

**Table 10-41 Black start revenue requirement charges: 2010 through 2016**

Year	Revenue Requirement Charges	Operating Reserves Charges	Total
2010	\$2,673,689	\$0	\$2,673,689
2011	\$2,793,709	\$0	\$2,793,709
2012	\$3,864,301	\$0	\$3,864,301
2013	\$5,412,855	\$22,210,646	\$27,623,501
2014	\$5,104,104	\$7,559,180	\$12,663,284
2015	\$10,276,712	\$4,699,965	\$14,976,677
2016	\$12,842,329	\$16,882	\$12,859,210

**Table 10-42 Black start zonal charges for network transmission use: 2015 and 2016**

Zone	2015 (Jan - Mar)					2016 (Jan - Mar)				
	Revenue Requirement Charges	Operating Reserve Charges	Total Charges	Peak Load (MW-day)	Black Start Rate (\$/MW-day)	Revenue Requirement Charges	Operating Reserve Charges	Total Charges	Peak Load (MW-day)	Black Start Rate (\$/MW-day)
AECO	\$145,824	\$0	\$145,824	219,915	\$0.66	\$50,951	\$6,210	\$57,161	232,305	\$0.25
AEP	\$2,753,539	\$4,414,570	\$7,168,109	2,196,729	\$3.26	\$3,242,638	\$0	\$3,242,638	2,249,984	\$1.44
AP	\$72,613	\$0	\$72,613	841,437	\$0.09	\$15,117	\$0	\$15,117	873,017	\$0.02
ATSI	\$633,587	\$0	\$633,587	1,112,589	\$0.57	\$753,343	\$0	\$753,343	1,124,432	\$0.67
BGE	\$2,727,337	\$0	\$2,727,337	599,868	\$4.55	\$2,024,438	\$0	\$2,024,438	610,783	\$3.31
ComEd	\$1,080,851	\$11,666	\$1,092,517	1,774,908	\$0.62	\$1,216,614	\$0	\$1,216,614	1,834,769	\$0.66
DAY	\$58,587	\$7,929	\$66,517	288,342	\$0.23	\$59,439	\$4,519	\$63,958	298,553	\$0.21
DEOK	\$286,689	\$0	\$286,689	459,450	\$0.62	\$292,248	\$0	\$292,248	466,193	\$0.63
Dominion	\$249,919	\$0	\$249,919	1,780,560	\$0.14	\$256,317	\$4,361	\$260,679	1,970,232	\$0.13
DPL	\$145,352	\$0	\$145,352	348,750	\$0.42	\$260,192	\$1,206	\$261,398	374,374	\$0.70
DLCO	\$15,215	\$0	\$15,215	242,343	\$0.06	\$12,883	\$0	\$12,883	255,164	\$0.05
EKPC	\$92,420	\$0	\$92,420	308,250	\$0.30	\$71,452	\$0	\$71,452	317,617	\$0.22
JCPL	\$132,826	\$0	\$132,826	507,321	\$0.26	\$1,724,360	\$0	\$1,724,360	529,447	\$3.26
Met-Ed	\$183,108	\$0	\$183,108	253,512	\$0.72	\$145,886	\$0	\$145,886	254,654	\$0.57
PECO	\$388,580	\$6,345	\$394,924	743,175	\$0.53	\$407,647	\$0	\$407,647	736,590	\$0.55
PENELEC	\$136,878	\$0	\$136,878	274,644	\$0.50	\$135,089	\$0	\$135,089	275,211	\$0.49
Pepco	\$80,590	\$0	\$80,590	571,059	\$0.14	\$641,618	\$0	\$641,618	570,361	\$1.12
PPL	\$31,710	\$0	\$31,710	723,420	\$0.04	\$25,030	\$0	\$25,030	732,996	\$0.03
PSEG	\$488,392	\$4,592	\$492,984	856,368	\$0.58	\$1,065,246	\$0	\$1,065,246	873,136	\$1.22
RECO	\$0	\$0	\$0	NA	NA	\$0	\$0	\$0	NA	NA
(Imp/Exp/Wheels)	\$572,694	\$254,863	\$827,557	828,964	\$1.00	\$441,819	\$586	\$442,405	519,320	\$0.85
Total	\$10,276,712	\$4,699,965	\$14,976,677	14,931,604	\$1.00	\$12,842,329	\$16,882	\$12,859,210	15,099,139	\$0.85

Black start zonal charges in the first three months of 2016 ranged from \$0.02 per MW-day in the AP Zone (total charges were \$15,117) to \$3.31 per MW-day in the BGE Zone (total charges were \$2,024,438). For each zone, Table 10-42 shows black start charges, the sum of monthly zonal peak loads multiplied by the number of days of the month in which the peak load occurred, and black start rates (calculated as charges per MW-day). For black start service, point-to-point transmission customers paid on average \$0.033 per MW of reserve capacity during the first three months of 2016.

Table 10-43 provides a revenue requirement estimate by zone for the 2016/2017, 2017/2018 and 2018/2019 delivery years. Revenue requirement values are rounded up to the nearest \$50,000 to reflect uncertainty about future black start revenue requirement costs. These values are illustrative only. The estimates are based on the best available data including current black start unit revenue requirements, expected black start unit termination and in-service dates, and owner provided cost estimates of incoming black start units, at the time of publication and may change significantly.

**Table 10-43 Black start zonal revenue requirement estimate: 2016/2017 through 2018/2019 delivery years**

Zone	2016 / 2017 Revenue Requirement	2017 / 2018 Revenue Requirement	2018 / 2019 Revenue Requirement
AECO	\$2,850,000	\$2,850,000	\$2,800,000
AEP	\$19,150,000	\$19,200,000	\$18,950,000
AP	\$4,150,000	\$4,150,000	\$4,150,000
ATSI	\$3,100,000	\$3,100,000	\$3,100,000
BGE	\$8,400,000	\$8,450,000	\$8,400,000
ComEd	\$5,100,000	\$5,200,000	\$4,750,000
DAY	\$250,000	\$300,000	\$250,000
DEOK	\$1,250,000	\$1,250,000	\$1,200,000
DLCO	\$100,000	\$100,000	\$50,000
Dominion	\$5,400,000	\$5,400,000	\$5,400,000
DPL	\$2,600,000	\$2,600,000	\$2,500,000
EKPC	\$250,000	\$250,000	\$150,000
JCPL	\$7,200,000	\$7,200,000	\$7,150,000
Met-Ed	\$700,000	\$750,000	\$600,000
PECO	\$1,750,000	\$1,900,000	\$1,550,000
PENELEC	\$4,700,000	\$4,750,000	\$4,500,000
Pepco	\$2,700,000	\$2,700,000	\$2,650,000
PPL	\$800,000	\$800,000	\$750,000
PSEG	\$4,450,000	\$4,500,000	\$4,450,000
RECO	\$0	\$0	\$0
Total	\$74,900,000	\$75,450,000	\$73,350,000

## Reactive Service

Reactive Service, Reactive Supply and Voltage Control are provided by generation and other sources (such as static VAR compensators and capacitor banks) of reactive power (measured in VAR).<sup>59</sup> Reactive power helps maintain appropriate voltages on the transmission system and is essential to the flow of real power (measured in MW).

Total reactive service charges are the sum of reactive service revenue requirement charges and reactive service operating reserve charges. Reactive service revenue requirements are based on FERC-approved filings. Reactive service revenue requirement charges are allocated monthly to PJM customers in the zone or zones where the reactive service was provided proportionally to their zone and non-zone peak transmission use and point to point

<sup>59</sup> PJM OATT, Schedule 2 "Reactive Supply and Voltage Control from Generation Sources Service," (Effective Date: February 18, 2012).

transmission reservations. Reactive service operating reserve charges are paid for scheduling in the Day-Ahead Energy Market and committing in real time units that provide reactive service. These operating reserve charges are allocated daily to the zone or zones where the reactive service was provided.

In the first three months of 2016, total reactive service charges were \$75.2 million, a 1.0 percent decrease from 2015 level of \$76.0 million in the first three months.<sup>60</sup> Revenue requirement charges increased from \$69.7 million to \$75.0 million and operating reserve charges fell from \$6.3 million to \$250.5 thousand in the first three months of 2016. Total charges in 2015 ranged from \$0 in the RECO and DLCO Zone to \$9.3 million in the PSEG Zone.

For the first three months in each zone in 2015 and 2016, Table 10-44 shows reactive service operating reserve charges, revenue requirement charges and total charges (the sum of operating reserve and revenue requirement charges).

<sup>60</sup> See the 2014 State of the Market Report for PJM, Volume II, Section 4, "Energy Uplift."

Table 10-44 Reactive zonal charges for network transmission use: 2015 and 2016

Zone	2015 (Jan - Mar)			2016 (Jan - Mar)		
	Operating Reserve Charges	Revenue Requirement Charges	Total Charges	Operating Reserve Charges	Revenue Requirement Charges	Total Charges
AECO	\$13,309	\$1,752,552	\$1,765,861	\$0	\$1,360,729	\$1,360,729
AEP	\$395,554	\$10,052,766	\$10,448,319	\$14,106	\$9,193,927	\$9,208,033
AP	\$77,563	\$4,114,087	\$4,191,651	\$0	\$4,205,441	\$4,205,441
ATSI	\$2,212,061	\$3,690,235	\$5,902,295	\$0	\$6,376,259	\$6,376,259
BGE	\$51,599	\$1,931,572	\$1,983,171	\$0	\$1,974,463	\$1,974,463
ComEd	\$132,500	\$6,361,180	\$6,493,679	\$1,091	\$6,600,346	\$6,601,436
DAY	\$25,676	\$2,095,076	\$2,120,752	\$0	\$2,141,598	\$2,141,598
DEOK	\$40,372	\$1,271,988	\$1,312,360	\$0	\$1,441,550	\$1,441,550
Dominion	\$2,598,813	\$7,389,410	\$9,988,223	\$0	\$7,528,684	\$7,528,684
DPL	\$235,074	\$2,709,938	\$2,945,012	\$224,934	\$3,243,597	\$3,468,531
DLCO	\$19,374	\$0	\$19,374	\$0	\$0	\$0
EKPC	\$24,773	\$531,946	\$556,719	\$0	\$543,758	\$543,758
JCPL	\$30,381	\$1,771,227	\$1,801,608	\$0	\$2,531,844	\$2,531,844
Met-Ed	\$57,025	\$1,908,311	\$1,965,337	\$0	\$1,950,686	\$1,950,686
PECO	\$57,165	\$4,380,080	\$4,437,245	\$0	\$4,477,340	\$4,477,340
PENELEC	\$197,694	\$1,777,728	\$1,975,422	\$10,366	\$1,971,536	\$1,981,902
Pepco	\$47,128	\$1,306,768	\$1,353,896	\$0	\$1,342,675	\$1,342,675
PPL	\$63,701	\$4,682,408	\$4,746,109	\$0	\$4,786,381	\$4,786,381
PSEG	\$55,175	\$6,777,170	\$6,832,345	\$0	\$9,304,681	\$9,304,681
RECO	\$1,813	\$0	\$1,813	\$0	\$0	\$0
(Imp/Exp/Wheels)	\$0	\$5,164,205	\$5,164,205	\$0	\$4,016,522	\$4,016,522
Total	\$6,336,749	\$69,668,647	\$76,005,396	\$250,496	\$74,992,016	\$75,242,513

## Congestion and Marginal Losses

The locational marginal price (LMP) is the incremental price of energy at a bus. The LMP at a bus is the sum of three components: the system marginal price (SMP) or energy component, the congestion component of LMP (CLMP), and the marginal loss component of LMP (MLMP).<sup>1</sup> SMP, MLMP and CLMP are products of the least cost, security constrained dispatch of system resources to meet system load.

SMP is the incremental price of energy for the system, given the current dispatch, at the load weighted reference bus, or LMP net of losses and congestion. SMP is the LMP at the load weighted reference bus. The load weighted reference bus is not a fixed location but varies with the distribution of load at system load buses.

CLMP is the incremental price of congestion at each bus, based on the shadow prices associated with the relief of binding constraints in the security constrained optimization. CLMPs are positive or negative depending on location relative to binding constraints and relative to the load weighted reference bus. In an unconstrained system CLMPs will be zero.

MLMP is the incremental price of losses at a bus, based on marginal loss factors in the security constrained optimization. Losses refer to energy lost to physical resistance in the transmission network as power is moved from generation to load.

Total losses refer to the total system-wide transmission losses as a result of moving power from injections to withdrawals on the system. Marginal losses are the incremental change in system losses caused by changes in load and generation.<sup>2</sup>

Congestion is neither good nor bad, but is a direct measure of the extent to which there are multiple marginal generating units dispatched to serve load as a result of transmission constraints. Congestion occurs when available, least-

cost energy cannot be delivered to all load because transmission facilities are not adequate to deliver that energy to one or more areas, and higher cost units in the constrained area(s) must be dispatched to meet the load.<sup>3</sup> The result is that the price of energy in the constrained area(s) is higher than in the unconstrained area.

The energy, marginal losses and congestion metrics must be interpreted carefully. The term total congestion refers to what is actually net congestion, which is calculated as net implicit congestion costs plus net explicit congestion costs plus net inadvertent congestion charges. The net implicit congestion costs are the load congestion payments less generation congestion credits. This section refers to total energy costs and total marginal loss costs in the same way. As with congestion, total energy costs are more precisely termed net energy costs and total marginal loss costs are more precisely termed net marginal loss costs. Ignoring interchange, total generation MWh must be greater than total load MWh in any hour in order to provide for losses. Since the hourly integrated energy component of LMP is the same for every bus within every hour, the net energy bill is negative (ignoring net interchange), with more generation credits than load payments in every hour.

The components of LMP are the basis for calculating participant and location specific congestion costs and marginal loss costs.<sup>4</sup>

## Overview

### Congestion Cost

- **Total Congestion.** Total congestion costs decreased by \$339.5 million or 53.7 percent, from \$631.7 million in the first three months of 2015 to \$292.2 million in the first three months of 2016.

<sup>1</sup> On June 1, 2013, PJM integrated the East Kentucky Power Cooperative (EKPC) Control Zone. The metrics reported in this section treat EKPC as part of MISO for the first hour of June 2013 and as part of PJM for the second hour of June 2013 through 2014.

<sup>2</sup> See 2014 SOM Technical Appendices for a full discussion of the relationship between marginal, average and total losses.

<sup>3</sup> This is referred to as dispatching units out of economic merit order. Economic merit order is the order of all generator offers from lowest to highest cost. Congestion occurs when loadings on transmission facilities mean the next unit in merit order cannot be used and a higher cost unit must be used in its place. Dispatch within the constrained area follows merit order for the units available to relieve the constraint.

<sup>4</sup> The total congestion and marginal losses were calculated as of April 18, 2016, and are subject to change, based on continued PJM billing updates.

- **Day-Ahead Congestion.** Day-ahead congestion costs decreased by \$451.0 million or 58.3 percent, from \$773.9 million in the first three months of 2015 to \$322.9 million in the first three months of 2016.
- **Balancing Congestion.** Balancing congestion costs increased by \$111.5 million or 78.4 percent, from -\$142.2 million in the first three months of 2015 to -\$30.8 million in the first three months of 2016.
- **Real-Time Congestion.** Real-time congestion costs decreased by \$284.7 million or 49.2 percent, from \$579.0 million in the first three months of 2015 to \$294.3 million in the first three months of 2016.
- **Monthly Congestion.** In the first three months of 2016, 38.1 percent (\$111.3 million) of total congestion cost was incurred in February. Monthly total congestion costs in the first three months of 2016 ranged from \$73.3 million in March to \$111.3 million in February.
- **Geographic Differences in CLMP.** Differences in CLMP among eastern, southern and western control zones in PJM were primarily a result of congestion on the Graceton Transformer, the Bagley – Graceton Line, the Conastone – Northwest Line the Milford – Steele Line and the Person – Halifax Flowgate.
- **Congestion Frequency.** Congestion frequency continued to be significantly higher in the Day-Ahead Energy Market than in the Real-Time Energy Market in the first three months of 2016. The number of congestion event hours in the Day-Ahead Energy Market was about ten times higher than the number of congestion event hours in the Real-Time Energy Market. Day-ahead congestion frequency increased by 31.7 percent from 50,384 congestion event hours in the first three months of 2015 to 66,373 congestion event hours in the first three months of 2016. The day-ahead congestion event hours decreased significantly after September 8, 2014. The reduction was the result of the reduction in up to congestion (UTC) activity which was a result of FERC's UTC uplift refund notice, retroactive to September 8, 2014. Real-time congestion frequency decreased by 30.5 percent from 9,735 congestion event hours in the first three months of 2015 to 6,763 congestion event hours in the first three months of 2016.

- **Congested Facilities.** Day-ahead, congestion-event hours decreased on flowgates and interfaces and increased on lines and transformers. Real-time, congestion-event hours decreased on all types of facilities.

The Graceton Transformer was the largest contributor to congestion costs in the first three months of 2016. With \$29.8 million in total congestion costs, it accounted for 10.2 percent of the total PJM congestion costs in the first three months of 2016.

- **Zonal Congestion.** ComEd had the largest total congestion costs among all control zones in the first three months of 2016. ComEd had \$69.7 million in total congestion costs, comprised of -\$88.1 million in total load congestion payments, -\$163.4 million in total generation congestion credits and -\$5.7 million in explicit congestion costs. The Mercer IP – Galesburg Flowgate, the Cherry Valley Flowgate, the Cherry Valley Transformer, the Cherry Valley – Silver Lake Flowgate, and the Person – Halifax Flowgate contributed \$37.6 million, or 53.9 percent of the total ComEd control zone congestion costs.
- **Ownership.** In the first three months of 2016, financial entities as a group were net recipients of congestion credits and physical entities were net payers of congestion charges. Explicit costs are the primary source of congestion credits to financial entities. In the first three months of 2016, financial entities received \$16.7 million in congestion credits, a decrease of \$52.5 million or 75.9 percent compared to the first three months of 2015. In the first three months of 2016, physical entities paid \$308.8 million in congestion charges, a decrease of \$392.0 million or 55.9 percent compared to the first three months of 2015. UTCs are in the explicit congestion cost category and comprise most of that category. The total explicit cost is equal to day-ahead explicit cost plus balancing explicit cost. In the first three months of 2016, the total explicit cost is -\$8.5 million and 153.0 percent of the total explicit cost is comprised of congestion cost by UTCs, which is -\$13.0 million.

## Marginal Loss Cost

- **Total Marginal Loss Costs.** Total marginal loss costs decreased by \$255.0 million or 60.0 percent, from \$425.1 million in the first three months of 2015 to \$170.1 million in the first three months of 2016. The loss MWh in PJM decreased by 1,247.3 GWh or 24.3 percent, from 5,126.6 GWh in the first three months of 2015 to 3,879.2 GWh in the first three months of 2016. The loss component of LMP decreased from \$0.03 in the first three months of 2015 to \$0.01 in the first three months of 2016.
- **Monthly Total Marginal Loss Costs.** Monthly total marginal loss costs in the first three months of 2016 ranged from \$40.6 million in March to \$72.0 million in January.
- **Day-Ahead Marginal Loss Costs.** Day-ahead marginal loss costs decreased by \$248.7 million or 57.6 percent, from \$432.0 million in the first three months of 2015 to \$183.3 million in the first three months of 2016.
- **Balancing Marginal Loss Costs.** Balancing marginal loss costs decreased by \$6.3 million or 91.3 percent, from -\$6.9 million in the first three months of 2015 to -\$13.2 million in the first three months of 2016.
- **Total Marginal Loss Surplus.** The total marginal loss surplus decreased in the first three months of 2016 by \$94.3 million or 62.9 percent, from \$150.0 million in the first three months of 2015, to \$55.7 million in the first three months of 2016.

## Energy Cost

- **Total Energy Costs.** Total energy costs increased by \$158.0 million or 58.2 percent, from -\$271.7 million in the first three months of 2015 to -\$113.6 million in the first three months of 2016.
- **Day-Ahead Energy Costs.** Day-ahead energy costs increased by \$162.2 million or 51.9 percent, from -\$312.6 million in the first three months of 2015 to -\$150.4 million in the first three months of 2016.
- **Balancing Energy Costs.** Balancing energy costs decreased by \$2.6 million or 6.8 percent, from \$38.4 million in the first three months of 2015 to \$35.8 million in the first three months of 2016.

- **Monthly Total Energy Costs.** Monthly total energy costs in the first three months of 2016 ranged from -\$47.7 million in January to -\$27.4 million in March.

## Conclusion

Congestion, as defined, is the total congestion payments by load in excess of the total congestion credits received by generation. The level and distribution of congestion reflects the underlying characteristics of the power system, including the nature and capability of transmission facilities, the offers and geographic distribution of generation facilities, the level and geographic distribution of incremental bids and offers and the geographic and temporal distribution of load.

The current ARR/FTR design does not serve as an efficient way to ensure that load receives all the congestion revenues or has the ability to receive the auction revenues associated with all the potential congestion revenues. Total ARR and self scheduled FTR revenue offset only 63.8 percent of total congestion costs including congestion in the Day-Ahead Energy Market and the balancing energy market for the 2014 to 2015 planning period. For the first ten months of the 2015 to 2016 planning period ARRs and self scheduled FTRs offset 83.6 percent of total congestion costs.

## Locational Marginal Price (LMP)

### Components

On June 1, 2007, PJM changed from a single node reference bus to a distributed load reference bus. While the use of a single node reference bus or a distributed load reference bus has no effect on the total LMP, the use of a single node reference bus or a distributed load reference bus will affect the components of LMP. With a distributed load reference bus, the energy component is a load-weighted system price. There is no congestion or losses included in the load weighted reference bus price, unlike the case with a single node reference bus.

LMP at a bus reflects the incremental price of energy at that bus. LMP at any bus is the sum of three components: the system marginal price (SMP), marginal loss component of LMP (MLMP), and congestion component of LMP (CLMP).

SMP, MLMP and CLMP are a product of the least cost, security constrained dispatch of system resources to meet system load. SMP is the incremental cost of energy, given the current dispatch and given the choice of reference bus. SMP is LMP net of losses and congestion. Losses refer to energy lost to physical resistance in the transmission and distribution network as power is moved from generation to load. The greater the resistance of the system to flows of energy from generation to loads, the greater the losses of the system and the greater the proportion of energy needed to meet a given level of load. Marginal losses are the incremental change in system power losses caused by changes in the system load and generation patterns.<sup>5</sup> The first derivative of total losses with respect to the power flow equals marginal losses. Congestion cost reflects the incremental cost of relieving transmission constraints while maintaining system power balance. Congestion occurs when available, least-cost energy cannot be delivered to all loads because transmission facilities are not adequate to deliver that energy. When the least-cost available energy cannot be delivered to load in a transmission constrained area, higher cost units in the constrained area must be dispatched to meet that load.<sup>6</sup> The result is that the price of energy in the constrained area is higher than in the unconstrained area because of the combination of transmission limitations and the cost of local generation. Congestion is the difference between the total cost of energy paid by load in the transmission constrained area and the total revenue received by generation in the transmission constrained area.

<sup>5</sup> For additional information, see the MMU Technical Reference for PJM Markets, at "Marginal Losses," <[http://www.monitoringanalytics.com/reports/Technical\\_References/docs/2010-som-pjm-technical-reference.pdf](http://www.monitoringanalytics.com/reports/Technical_References/docs/2010-som-pjm-technical-reference.pdf)>.

<sup>6</sup> This is referred to as dispatching units out of economic merit order. Economic merit order is the order of all generator offers from lowest to highest cost. Congestion occurs when loadings on transmission facilities mean the next unit in merit order cannot be used and a higher cost unit must be used in its place.

Table 11-1 shows the PJM real-time, load-weighted average LMP components for January through March of 2009 through 2016.<sup>7</sup>

The load-weighted average real-time LMP decreased \$24.11 or 47.4 percent from \$50.91 in the first three months of 2015 to \$26.80 in the first three months of 2016. The load-weighted average congestion component increased \$0.03 from \$0.00 in the first three months of 2015 to \$0.03 in the first three months of 2016. The load-weighted average loss component decreased \$0.02 from \$0.03 in the first three months of 2015 to \$0.01 in the first three months of 2016. The load-weighted average energy component decreased \$24.13 or 47.4 percent from \$50.89 in the first three months of 2015 to \$26.75 in the first three months of 2016.

**Table 11-1 PJM real-time, load-weighted average LMP components (Dollars per MWh): January through March of 2009 through 2016<sup>8</sup>**

(Jan - Mar)	Real-Time LMP	Energy Component	Congestion Component	Loss Component
2009	\$49.60	\$49.51	\$0.05	\$0.04
2010	\$45.92	\$45.81	\$0.06	\$0.05
2011	\$46.35	\$46.30	\$0.03	\$0.03
2012	\$31.21	\$31.18	\$0.02	\$0.00
2013	\$37.41	\$37.37	\$0.02	\$0.02
2014	\$92.98	\$93.08	(\$0.13)	\$0.03
2015	\$50.91	\$50.89	(\$0.00)	\$0.03
2016	\$26.80	\$26.75	\$0.03	\$0.01

Table 11-2 shows the PJM day-ahead, load-weighted average LMP components for January through March of 2009 through 2016.<sup>9</sup>

<sup>7</sup> The PJM real-time, load-weighted price is weighted by accounting load, which differs from the state-estimated load used in determination of the energy component (SMP). In the Real-Time Energy Market, the distributed load reference bus is weighted by state-estimated load in real time. When the LMP is calculated in real time, the energy component equals the system load-weighted price. But real-time bus-specific loads are adjusted, after the fact, based on updated load information from meters. This meter adjusted load is accounting load that is used in settlements and is used to calculate reported PJM load weighted prices. This after the fact adjustment means that the Real-Time Energy Market energy component of LMP (SMP) and the PJM real-time load-weighted LMP are not equal. The difference between the real-time energy component of LMP and the PJM-wide real-time load-weighted LMP is a result of the difference between state-estimated and metered loads used to weight the load-weighted reference bus and the load-weighted LMP.

<sup>8</sup> Calculated values shown in Section 11, "Congestion and Marginal Losses," are based on unrounded, underlying data and may differ from calculations based on the rounded values in the tables.

<sup>9</sup> In the Real-Time Energy Market, the energy component (SMP) equals the system load-weighted price, with the caveat about state-estimated versus metered load. However, in the Day-Ahead Energy Market the day-ahead energy component of LMP (SMP) and the PJM day-ahead load-weighted LMP are not equal. The difference between the day-ahead energy component of LMP and the PJM day-ahead load-weighted LMP is a result of the difference in the types of load used to weight the load-weighted reference bus and the load-weighted LMP. In the Day-Ahead Energy Market, the distributed load reference bus is weighted by fixed-demand bids only and the day-ahead SMP is, therefore, a system fixed demand weighted price. The day-ahead load-weighted LMP calculation uses all types of demand, including fixed, price-sensitive and decrement bids.

The load-weighted average day-ahead LMP decreased \$24.08 or 46.3 percent from \$52.02 in the first three months of 2015 to \$27.94 in 2016. The load-weighted average congestion component decreased \$0.34 or 69.8 percent from \$0.48 in 2015 to \$0.15 in the first three months of 2016. The load-weighted average loss component increased \$0.02 or 83.2 percent from -\$0.02 in 2015 to -\$0.00 in the first three months of 2016. The load-weighted average energy component decreased \$23.76 or 46.1 percent from \$51.55 in the first three months of 2015 to \$27.80 in the first three months of 2016.

**Table 11-2 PJM day-ahead, load-weighted average LMP components (Dollars per MWh): January through March of 2009 through 2016**

(Jan - Mar)	Day-Ahead LMP	Energy Component	Congestion Component	Loss Component
2009	\$49.44	\$49.75	(\$0.18)	(\$0.13)
2010	\$47.77	\$47.74	\$0.01	\$0.02
2011	\$47.14	\$47.36	(\$0.11)	(\$0.11)
2012	\$31.51	\$31.45	\$0.08	(\$0.03)
2013	\$37.26	\$37.19	\$0.07	\$0.01
2014	\$94.96	\$94.52	\$0.43	\$0.00
2015	\$52.02	\$51.55	\$0.48	(\$0.02)
2016	\$27.94	\$27.80	\$0.15	(\$0.00)

## Zonal Components

The real-time components of LMP for each control zone are presented in Table 11-3 for the first three months of 2015 and the first three months of 2016. In the first three months of 2016, BGE had the highest real-time congestion component of all control zones and PECO had the lowest real-time congestion component.

**Table 11-3 Zonal and PJM real-time, load-weighted average LMP components (Dollars per MWh): January through March of 2015 and 2016**

	2015 (Jan - Mar)				2016 (Jan - Mar)			
	Real-Time LMP	Energy Component	Congestion Component	Loss Component	Real-Time LMP	Energy Component	Congestion Component	Loss Component
AECO	\$60.14	\$50.47	\$6.82	\$2.85	\$25.73	\$26.67	(\$1.34)	\$0.39
AEP	\$42.23	\$50.89	(\$6.72)	(\$1.94)	\$26.49	\$26.73	\$0.09	(\$0.32)
AP	\$53.65	\$51.12	\$2.12	\$0.41	\$27.63	\$26.85	\$0.60	\$0.17
ATSI	\$41.94	\$49.68	(\$7.61)	(\$0.13)	\$26.03	\$26.46	(\$0.87)	\$0.44
BGE	\$62.50	\$52.03	\$7.34	\$3.14	\$36.11	\$27.05	\$7.89	\$1.16
ComEd	\$36.14	\$49.43	(\$9.43)	(\$3.86)	\$23.45	\$26.33	(\$1.64)	(\$1.24)
DAY	\$41.35	\$50.46	(\$8.18)	(\$0.93)	\$26.08	\$26.69	(\$0.99)	\$0.38
DEOK	\$39.49	\$50.76	(\$7.97)	(\$3.30)	\$25.42	\$26.68	(\$0.61)	(\$0.65)
DLCO	\$36.84	\$50.04	(\$11.59)	(\$1.62)	\$25.68	\$26.52	(\$0.69)	(\$0.15)
Dominion	\$59.35	\$52.79	\$5.64	\$0.91	\$31.29	\$27.20	\$3.96	\$0.14
DPL	\$68.76	\$52.38	\$12.05	\$4.33	\$30.56	\$27.17	\$2.35	\$1.04
EKPC	\$40.63	\$53.27	(\$9.41)	(\$3.23)	\$25.78	\$27.28	(\$0.77)	(\$0.73)
JCPL	\$60.26	\$50.22	\$6.97	\$3.06	\$23.79	\$26.69	(\$3.33)	\$0.43
Met-Ed	\$59.58	\$50.65	\$6.94	\$1.99	\$23.63	\$26.76	(\$3.40)	\$0.27
PECO	\$59.70	\$50.61	\$6.72	\$2.36	\$23.29	\$26.73	(\$3.70)	\$0.26
PENELEC	\$53.46	\$50.04	\$2.27	\$1.15	\$25.29	\$26.56	(\$1.76)	\$0.49
Pepco	\$60.19	\$51.94	\$6.14	\$2.10	\$32.38	\$27.06	\$4.62	\$0.70
PPL	\$60.18	\$50.86	\$7.61	\$1.71	\$23.88	\$26.82	(\$3.15)	\$0.21
PSEG	\$66.47	\$49.71	\$13.75	\$3.01	\$23.95	\$26.50	(\$2.99)	\$0.44
RECO	\$68.51	\$49.49	\$16.06	\$2.95	\$23.79	\$26.55	(\$3.23)	\$0.47
PJM	\$50.91	\$50.89	(\$0.00)	\$0.03	\$26.80	\$26.75	\$0.03	\$0.01

The day-ahead components of LMP for each control zone are presented in Table 11-4 for the first three months of 2015 and the first three months of 2016. In the first three months of 2016, BGE had the highest day-ahead congestion component of all control zones and PECO had the lowest day-ahead congestion component.

**Table 11-4 Zonal and PJM day-ahead, load-weighted average LMP components (Dollars per MWh): January through March of 2015 and 2016**

	2015 (Jan - Mar)				2016 (Jan - Mar)			
	Day-Ahead LMP	Energy Component	Congestion Component	Loss Component	Day-Ahead LMP	Energy Component	Congestion Component	Loss Component
AECO	\$62.12	\$50.83	\$9.47	\$1.82	\$25.38	\$27.56	(\$2.37)	\$0.18
AEP	\$42.83	\$51.92	(\$7.70)	(\$1.38)	\$27.30	\$27.81	(\$0.27)	(\$0.24)
AP	\$52.75	\$51.66	\$1.10	(\$0.02)	\$28.84	\$27.84	\$0.95	\$0.06
ATSI	\$42.45	\$50.50	(\$8.11)	\$0.06	\$27.04	\$27.56	(\$0.89)	\$0.37
BGE	\$64.68	\$52.24	\$10.32	\$2.13	\$38.70	\$28.14	\$9.59	\$0.97
ComEd	\$35.21	\$50.54	(\$12.60)	(\$2.73)	\$24.21	\$27.42	(\$2.14)	(\$1.07)
DAY	\$41.43	\$51.47	(\$9.79)	(\$0.25)	\$27.02	\$27.67	(\$1.02)	\$0.37
DEOK	\$39.70	\$51.54	(\$9.39)	(\$2.44)	\$26.55	\$27.77	(\$0.66)	(\$0.56)
DLCO	\$36.93	\$50.73	(\$11.84)	(\$1.96)	\$26.71	\$27.63	(\$0.66)	(\$0.26)
Dominion	\$64.37	\$53.47	\$10.07	\$0.83	\$33.27	\$28.25	\$4.77	\$0.25
DPL	\$70.58	\$52.47	\$14.92	\$3.18	\$32.49	\$28.11	\$3.58	\$0.81
EKPC	\$41.02	\$54.54	(\$10.42)	(\$3.10)	\$26.41	\$28.26	(\$1.18)	(\$0.67)
JCPL	\$62.97	\$51.05	\$9.57	\$2.35	\$24.08	\$27.75	(\$3.97)	\$0.30
Met-Ed	\$59.99	\$50.97	\$8.13	\$0.88	\$23.96	\$27.64	(\$3.73)	\$0.05
PECO	\$61.73	\$51.05	\$9.33	\$1.36	\$23.56	\$27.72	(\$4.24)	\$0.08
PENELEC	\$52.10	\$50.60	\$0.78	\$0.72	\$26.45	\$27.85	(\$1.73)	\$0.33
Pepco	\$63.05	\$51.95	\$9.58	\$1.52	\$34.70	\$28.06	\$6.03	\$0.62
PPL	\$61.49	\$51.36	\$9.45	\$0.69	\$24.20	\$27.71	(\$3.54)	\$0.03
PSEG	\$65.62	\$50.26	\$12.95	\$2.42	\$25.19	\$27.61	(\$2.82)	\$0.40
RECO	\$66.21	\$50.11	\$13.59	\$2.51	\$24.56	\$27.56	(\$3.38)	\$0.38
PJM	\$52.02	\$51.55	\$0.48	(\$0.02)	\$27.94	\$27.80	\$0.15	(\$0.00)

## Hub Components

The real-time components of LMP for each hub are presented in Table 11-5 for the first three months of 2015 and the first three months of 2016.

**Table 11-5 Hub real-time, load-weighted average LMP components (Dollars per MWh): January through March of 2015 and 2016**

	2015 (Jan - Mar)				2016 (Jan - Mar)			
	Real-Time LMP	Energy Component	Congestion Component	Loss Component	Real-Time LMP	Energy Component	Congestion Component	Loss Component
AEP Gen Hub	\$37.40	\$51.28	(\$9.95)	(\$3.93)	\$25.34	\$27.86	(\$1.25)	(\$1.27)
AEP-DAY Hub	\$40.17	\$50.90	(\$8.42)	(\$2.32)	\$25.65	\$27.27	(\$1.16)	(\$0.46)
ATSI Gen Hub	\$41.58	\$51.96	(\$9.08)	(\$1.30)	\$25.96	\$27.39	(\$1.30)	(\$0.14)
Chicago Gen Hub	\$34.51	\$48.58	(\$9.64)	(\$4.43)	\$21.94	\$26.36	(\$2.81)	(\$1.60)
Chicago Hub	\$36.34	\$49.67	(\$9.52)	(\$3.81)	\$23.79	\$26.62	(\$1.61)	(\$1.22)
Dominion Hub	\$59.62	\$53.81	\$5.52	\$0.29	\$30.72	\$27.10	\$3.75	(\$0.13)
Eastern Hub	\$64.78	\$50.77	\$9.99	\$4.02	\$28.94	\$26.37	\$1.64	\$0.93
N Illinois Hub	\$35.53	\$48.66	(\$9.13)	(\$4.00)	\$23.49	\$26.48	(\$1.62)	(\$1.37)
New Jersey Hub	\$62.68	\$49.79	\$9.94	\$2.96	\$24.09	\$26.53	(\$2.85)	\$0.41
Ohio Hub	\$39.96	\$50.54	(\$8.32)	(\$2.26)	\$25.21	\$26.69	(\$1.08)	(\$0.40)
West Interface Hub	\$47.30	\$55.05	(\$6.28)	(\$1.47)	\$26.97	\$26.69	\$0.56	(\$0.28)
Western Hub	\$55.82	\$52.57	\$2.54	\$0.71	\$29.48	\$28.17	\$1.13	\$0.18

The day-ahead components of LMP for each hub are presented in Table 11-6 for the first three months of 2015 and 2016.

**Table 11-6 Hub day-ahead, load-weighted average LMP components (Dollars per MWh): January through March of 2015 and 2016**

	2015 (Jan - Mar)				2016 (Jan - Mar)			
	Day-Ahead LMP	Energy Component	Congestion Component	Loss Component	Day-Ahead LMP	Energy Component	Congestion Component	Loss Component
AEP Gen Hub	\$35.23	\$48.22	(\$9.97)	(\$3.01)	\$25.76	\$27.68	(\$0.86)	(\$1.06)
AEP-DAY Hub	\$39.65	\$50.98	(\$9.83)	(\$1.50)	\$26.31	\$27.62	(\$0.94)	(\$0.37)
ATSI Gen Hub	\$44.81	\$54.21	(\$8.89)	(\$0.51)	\$24.79	\$25.18	(\$0.48)	\$0.09
Chicago Gen Hub	\$32.98	\$47.98	(\$11.83)	(\$3.17)	\$22.68	\$27.66	(\$3.48)	(\$1.50)
Chicago Hub	\$35.07	\$49.58	(\$11.93)	(\$2.58)	\$24.07	\$27.35	(\$2.28)	(\$1.00)
Dominion Hub	\$63.64	\$53.23	\$10.04	\$0.38	\$32.89	\$28.28	\$4.57	\$0.04
Eastern Hub	\$68.04	\$51.87	\$13.10	\$3.07	\$31.62	\$27.86	\$2.94	\$0.82
N Illinois Hub	\$34.39	\$49.13	(\$11.86)	(\$2.88)	\$24.09	\$27.39	(\$2.09)	(\$1.20)
New Jersey Hub	\$63.00	\$50.09	\$10.68	\$2.23	\$24.77	\$27.56	(\$3.10)	\$0.31
Ohio Hub	\$39.70	\$50.81	(\$9.78)	(\$1.33)	\$26.10	\$27.56	(\$1.10)	(\$0.35)
West Interface Hub	\$45.34	\$50.63	(\$4.49)	(\$0.80)	\$28.36	\$27.91	\$0.69	(\$0.24)
Western Hub	\$53.18	\$50.59	\$2.50	\$0.09	\$29.67	\$28.00	\$1.65	\$0.03

## Component Costs

Table 11-7 shows the total energy, loss and congestion component costs and the total PJM billing for January through March of 2009 through 2016. These totals are actually net energy, loss and congestion costs. Total congestion and marginal loss costs decreased in the first three months of 2016 compared to the first three months of 2015.

**Table 11-7 Total PJM costs by component (Dollars (Millions)): January through March of 2009 through 2016<sup>10 11</sup>**

(Jan - Mar)	Component Costs (Millions)				Total PJM Billing	Total Costs Percent of PJM Billing
	Energy Costs	Loss Costs	Congestion Costs	Total Costs		
2009	(\$218)	\$454	\$307	\$543	\$7,515	7.2%
2010	(\$208)	\$417	\$345	\$554	\$8,415	6.6%
2011	(\$210)	\$410	\$360	\$560	\$9,584	5.8%
2012	(\$136)	\$234	\$122	\$220	\$6,938	3.2%
2013	(\$178)	\$278	\$186	\$286	\$7,762	3.7%
2014	(\$515)	\$776	\$1,236	\$1,497	\$21,070	7.1%
2015	(\$272)	\$425	\$632	\$785	\$14,040	5.6%
2016	(\$114)	\$170	\$292	\$349	\$9,500	3.7%

## Congestion

### Congestion Accounting

Congestion occurs in the Day-Ahead and Real-Time Energy Markets.<sup>12</sup> Total congestion costs are equal to the net implicit congestion bill plus net explicit congestion costs plus net inadvertent congestion charges, incurred in both the Day-Ahead Energy Market and the balancing energy market.

In the analysis of total congestion costs, load congestion payments are netted against generation congestion credits on an hourly basis, by billing organization, and then summed for the given period.<sup>13</sup>

<sup>10</sup> The energy costs, loss costs and congestion costs include net inadvertent charges.

<sup>11</sup> Total PJM billing is provided by PJM. The MMU is not able to verify the calculation.

<sup>12</sup> When the term *congestion charge* is used in documents by PJM's Market Settlement Operations, it has the same meaning as the term *congestion costs* as used here.

<sup>13</sup> This analysis does not treat affiliated billing organizations as a single organization. Thus, the generation congestion credits from one organization will not offset the load payments of its affiliate.

Load congestion payments and generation congestion credits are calculated for both the Day-Ahead and balancing energy markets.

- **Day-Ahead Load Congestion Payments.** Day-ahead load congestion payments are calculated for all cleared demand, decrement bids and day-ahead energy market sale transactions. Day-ahead load congestion payments are calculated using MW and the load bus CLMP, the decrement bid CLMP or the CLMP at the source of the sale transaction, as applicable.
- **Day-Ahead Generation Congestion Credits.** Day-ahead generation congestion credits are calculated for all cleared generation, increment offers and day-ahead energy market purchase transactions. Day-ahead generation congestion credits are calculated using MW and the generator bus CLMP, the increment offer's CLMP or the CLMP at the sink of the purchase transaction, as applicable.
- **Balancing Load Congestion Payments.** Balancing load congestion payments are calculated for all deviations between a PJM member's real-time load and energy sale transactions and their day-ahead cleared demand, decrement bids and energy sale transactions. Balancing load congestion payments are calculated using MW deviations and the real-time CLMP for each bus where a deviation exists.
- **Balancing Generation Congestion Credits.** Balancing generation congestion credits are calculated for all deviations between a PJM member's real-time generation and energy purchase transactions and the day-ahead cleared generation, increment offers and energy purchase transactions. Balancing generation congestion credits are calculated using MW deviations and the real-time CLMP for each bus where a deviation exists.
- **Explicit Congestion Costs.** Explicit congestion costs are the net congestion costs associated with point-to-point energy transactions. These costs equal the product of the transacted MW and CLMP differences between sources (origins) and sinks (destinations) in the Day-Ahead Energy Market. Balancing energy market explicit congestion costs equal the product of the deviations between the real-time and day-ahead transacted MW and the differences between the real-time CLMP at the transactions' sources and sinks.

- **Inadvertent Congestion Charges.** Inadvertent congestion charges are congestion charges resulting from the differences between the net actual energy flow and the net scheduled energy flow into or out of the PJM control area each hour. This inadvertent interchange of energy may be positive or negative, where positive interchange typically results in a charge while negative interchange typically results in a credit. Inadvertent congestion charges are common costs, not directly attributable to specific participants that are distributed on a load ratio basis.<sup>14</sup>

The congestion costs associated with specific constraints are the sum of the total day-ahead and balancing congestion costs associated with those constraints. The congestion costs in each zone are the sum of the congestion costs associated with each constraint that affects prices in the zone. The network nature of the transmission system means that congestion costs in a zone are frequently the result of constrained facilities located outside that zone.

Congestion costs can be both positive and negative and consequently load payments and generation credits can be both positive and negative. The CLMP is calculated with respect to the system reference bus LMP, also called the system marginal price (SMP). When a transmission constraint occurs, the resulting CLMP is positive on one side of the constraint and negative on the other side of the constraint and the corresponding congestion costs are positive or negative. For each transmission constraint, the CLMP reflects the cost of a constraint at a pricing node and is equal to the product of the constraint shadow price and the distribution factor at the respective pricing node. The total CLMP at a pricing node is the sum of all constraint contributions to LMP and is equal to the difference between the actual LMP that results from transmission constraints, excluding losses, and the SMP. If an area experiences lower prices because of a constraint, the CLMP in that area is negative.<sup>15</sup>

The congestion metric requires careful review when considering the significance of congestion. The net congestion bill is calculated by subtracting generating congestion credits from load congestion payments. The logic is that congestion payments by load are offset by congestion revenues to generation, for the area analyzed. The net congestion bill is the source of payments to FTR holders. When load pays more for congestion in an area than generation receives, the positive difference is the source of payments to FTR holders as it is a measure of the value of transmission in bringing lower cost generation into the area.

Total congestion costs in PJM in the first three months of 2016 were \$292.2 million, which was comprised of load congestion payments of \$119.1 million, generation credits of -\$181.6 million and explicit congestion of -\$8.5 million. Total congestion costs in PJM in the first three months of 2015 were \$631.7 million, which was comprised of load congestion payments of \$332.5 million, generation credits of -\$388.3 million and explicit congestion of -\$89.1 million. The decrease in total congestion cost from the first three months of 2015 to the first three months of 2016 is primarily a result of the decrease in congestion costs incurred by generation.

<sup>14</sup> OA. Schedule 1 (PJM Interchange Energy Market) §3.7.

<sup>15</sup> For an example of the congestion accounting methods used in this section, see MMU Technical Reference for PJM Markets, at "FTRs and ARRs" <[http://www.monitoringanalytics.com/reports/Technical\\_References/docs/2010-som-pjm-technical-reference.pdf](http://www.monitoringanalytics.com/reports/Technical_References/docs/2010-som-pjm-technical-reference.pdf)>.

## Total Congestion

Table 11-8 shows total congestion for January through March of 2008 through 2016. Total congestion costs in Table 11-8 include congestion costs associated with PJM facilities and those associated with reciprocal, coordinated flowgates in the MISO and in the NYISO.<sup>16 17</sup>

**Table 11-8 Total PJM congestion (Dollars (Millions)): January through March of 2008 through 2016**

(Jan - Mar)	Congestion Costs (Millions)			
	Congestion Cost	Percent Change	Total PJM Billing	Percent of PJM Billing
2008	\$486	NA	\$7,718	6.3%
2009	\$307	(36.8%)	\$7,515	4.1%
2010	\$345	12.4%	\$8,415	4.1%
2011	\$360	4.3%	\$9,584	3.8%
2012	\$122	(66.0%)	\$6,938	1.8%
2013	\$186	51.9%	\$7,762	2.4%
2014	\$1,236	564.8%	\$21,070	5.9%
2015	\$632	(48.9%)	\$14,040	4.5%
2016	\$292	(53.7%)	\$9,500	3.1%

Table 11-9 shows the congestion costs by accounting category by market for the first three months of 2016.

**Table 11-9 Total PJM congestion costs by accounting category by market (Dollars (Millions)): January through March of 2008 through 2016**

(Jan - Mar)	Congestion Costs (Millions)									
	Day Ahead				Balancing				Inadvertent Charges	Grand Total
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total		
2008	\$332.4	(\$220.0)	\$39.9	\$592.3	(\$46.0)	\$29.5	(\$31.2)	(\$106.7)	\$0.0	\$485.6
2009	\$120.2	(\$221.3)	\$47.9	\$389.5	(\$14.2)	(\$6.0)	(\$74.4)	(\$82.6)	(\$0.0)	\$306.9
2010	\$85.9	(\$293.1)	\$12.9	\$391.9	(\$5.7)	\$12.1	(\$29.1)	(\$47.0)	(\$0.0)	\$344.9
2011	\$176.5	(\$226.7)	\$4.1	\$407.3	\$21.6	\$27.8	(\$41.2)	(\$47.4)	\$0.0	\$359.9
2012	\$21.9	(\$131.4)	\$27.5	\$180.9	(\$5.1)	\$11.3	(\$42.0)	(\$58.4)	\$0.0	\$122.4
2013	\$85.0	(\$199.1)	\$47.8	\$331.9	(\$6.6)	\$73.3	(\$66.0)	(\$145.9)	\$0.0	\$185.9
2014	\$333.7	(\$1,193.9)	(\$94.3)	\$1,433.3	\$73.0	\$208.9	(\$61.3)	(\$197.2)	\$0.0	\$1,236.1
2015	\$327.0	(\$457.9)	(\$11.0)	\$773.9	\$5.4	\$69.6	(\$78.0)	(\$142.2)	(\$0.0)	\$631.7
2016	\$120.2	(\$193.5)	\$9.2	\$322.9	(\$1.1)	\$11.9	(\$17.7)	(\$30.8)	\$0.0	\$292.2

<sup>16</sup> See "Joint Operating Agreement Between the Midwest Independent Transmission System Operator, Inc. and PJM Interconnection, L.L.C.," (December 11, 2008) Section 6.1 <<http://www.pjm.com/documents/agreements.aspx>>.

<sup>17</sup> See "Joint Operating Agreement Among and Between the New York Independent System Operator Inc. and PJM Interconnection, L.L.C.," (January 17, 2013) Section 35.12.1 <<http://www.pjm.com/documents/agreements.aspx>>.

Table 11-10 and Table 11-11 show the total congestion costs for each transaction type in January through March of 2016 and 2015. Table 11-10 shows that in the first three months of 2016 DECs paid \$17.9 million in congestion cost in the day-ahead market were paid \$18.1 million in congestion credits in the balancing energy market, and received \$0.2 million in net payment for congestion. In the first three months of 2016, INCs were paid \$7.1 million in congestion credits in the day-ahead market, paid \$1.8 million in congestion cost in the balancing energy market and received \$5.4 million in net payment for congestion. In the first three months of 2016, up to congestion paid \$6.1 million in congestion cost in the day-ahead market, were paid \$19.1 million in congestion credits in balancing market and received \$13.0 million in net payment for congestion.

Table 11-10 Total PJM congestion costs by transaction type by market (Dollars (Millions)): January through March of 2016

Transaction Type	Congestion Costs (Millions)									
	Day-Ahead				Balancing				Inadvertent Charges	Grand Total
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total		
DEC	\$17.9	\$0.0	\$0.0	\$17.9	(\$18.1)	\$0.0	\$0.0	(\$18.1)	\$0.0	(\$0.2)
Demand	\$12.0	\$0.0	\$0.0	\$12.0	\$13.5	\$0.0	\$0.0	\$13.5	\$0.0	\$25.5
Demand Response	(\$0.0)	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$0.0	\$0.0	(\$0.0)	\$0.0	(\$0.0)
Export	\$0.0	\$0.0	\$1.1	\$1.1	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$0.0	\$1.1
Explicit Congestion Only	(\$19.2)	\$0.0	(\$0.6)	(\$19.7)	(\$2.2)	\$0.0	\$0.7	(\$1.5)	\$0.0	(\$21.3)
Generation	\$0.0	(\$303.0)	\$0.0	\$303.0	\$0.0	\$20.8	\$0.0	(\$20.8)	\$0.0	\$282.2
Grandfathered Overuse	\$0.0	\$0.0	\$0.1	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1
Import	\$0.0	(\$7.5)	\$0.1	\$7.6	\$0.0	(\$12.7)	\$0.6	\$13.4	\$0.0	\$21.0
INC	\$0.0	\$7.1	\$0.0	(\$7.1)	\$0.0	(\$1.8)	\$0.0	\$1.8	\$0.0	(\$5.4)
Internal Bilateral	\$113.4	\$113.7	\$0.3	(\$0.0)	\$5.7	\$5.7	\$0.0	(\$0.0)	\$0.0	(\$0.0)
Up to Congestion	\$0.0	\$0.0	\$6.1	\$6.1	\$0.0	\$0.0	(\$19.1)	(\$19.1)	\$0.0	(\$13.0)
Wheel In	\$0.0	(\$3.9)	\$2.1	\$6.0	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$6.0
Wheel Out	(\$3.9)	\$0.0	\$0.0	(\$3.9)	(\$0.0)	\$0.0	\$0.0	(\$0.0)	\$0.0	(\$3.9)
Total	\$120.2	(\$193.5)	\$9.2	\$322.9	(\$1.1)	\$11.9	(\$17.7)	(\$30.7)	\$0.0	\$292.2

Table 11-11 Total PJM congestion costs by transaction type by market (Dollars (Millions)): January through March of 2015

Transaction Type	Congestion Costs (Millions)									
	Day-Ahead				Balancing				Inadvertent Charges	Grand Total
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total		
DEC	\$28.1	\$0.0	\$0.0	\$28.1	(\$40.2)	\$0.0	\$0.0	(\$40.2)	\$0.0	(\$12.1)
Demand	\$78.2	\$0.0	\$0.0	\$78.2	\$32.1	\$0.0	\$0.0	\$32.1	\$0.0	\$110.3
Demand Response	(\$0.2)	\$0.0	\$0.0	(\$0.2)	\$0.1	\$0.0	\$0.0	\$0.1	\$0.0	(\$0.0)
Explicit Congestion Only	\$0.0	\$0.0	\$1.0	\$1.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$1.0
Export	\$7.6	\$0.0	\$0.2	\$7.8	\$2.7	\$0.0	\$0.4	\$3.1	\$0.0	\$10.9
Generation	\$0.0	(\$640.8)	\$0.0	\$640.8	\$0.0	\$112.5	\$0.0	(\$112.5)	\$0.0	\$528.3
Grandfathered Overuse	\$0.0	\$0.0	(\$2.2)	(\$2.2)	\$0.0	\$0.0	\$0.4	\$0.4	\$0.0	(\$1.8)
Import	\$0.0	(\$33.7)	\$0.7	\$34.4	\$0.0	(\$52.7)	\$1.1	\$53.8	\$0.0	\$88.2
INC	\$0.0	\$3.3	\$0.0	(\$3.3)	\$0.0	(\$1.0)	\$0.0	\$1.0	\$0.0	(\$2.3)
Internal Bilateral	\$171.6	\$171.6	\$0.0	(\$0.0)	\$11.3	\$11.3	\$0.0	(\$0.0)	\$0.0	(\$0.0)
Up to Congestion	\$0.0	\$0.0	(\$28.5)	(\$28.5)	\$0.0	\$0.0	(\$79.4)	(\$79.4)	\$0.0	(\$107.9)
Wheel In	\$0.0	\$41.6	\$17.8	(\$23.8)	\$0.0	(\$0.5)	(\$0.5)	(\$0.1)	\$0.0	(\$23.9)
Wheel Out	\$41.6	\$0.0	\$0.0	\$41.6	(\$0.5)	\$0.0	\$0.0	(\$0.5)	\$0.0	\$41.1
Total	\$327.0	(\$457.9)	(\$11.0)	\$773.9	\$5.4	\$69.6	(\$78.0)	(\$142.2)	\$0.0	\$631.7

Table 11-12 shows the total congestion cost incurred by transaction type.

**Table 11-12 Total PJM congestion costs by transaction type by market: January through March of 2015 to 2016 change (Dollars (Millions))**

Transaction Type	Congestion Costs (Millions)									
	Day-Ahead				Balancing				Inadvertent	
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total	Charges	Grand Total
DEC	(\$10.3)	\$0.0	\$0.0	(\$10.3)	\$22.2	\$0.0	\$0.0	\$22.2	\$0.0	\$11.9
Demand	(\$66.3)	\$0.0	\$0.0	(\$66.3)	(\$17.9)	\$0.0	\$0.0	(\$17.9)	\$0.0	(\$84.2)
Demand Response	\$0.2	\$0.0	\$0.0	\$0.2	(\$0.1)	\$0.0	\$0.0	(\$0.1)	\$0.0	\$0.0
Explicit Congestion Only	\$0.0	\$0.0	\$0.1	\$0.1	\$0.0	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.1
Export	(\$26.7)	\$0.0	(\$0.8)	(\$27.6)	(\$4.9)	\$0.0	\$0.3	(\$4.6)	\$0.0	(\$32.2)
Generation	\$0.0	\$337.8	\$0.0	(\$337.8)	\$0.0	(\$91.7)	\$0.0	\$91.7	\$0.0	(\$246.1)
Grandfathered Overuse	\$0.0	\$0.0	\$2.3	\$2.3	\$0.0	\$0.0	(\$0.3)	(\$0.3)	\$0.0	\$1.9
Import	\$0.0	\$26.2	(\$0.5)	(\$26.8)	\$0.0	\$39.9	(\$0.5)	(\$40.4)	\$0.0	(\$67.2)
INC	\$0.0	\$3.9	\$0.0	(\$3.9)	\$0.0	(\$0.8)	\$0.0	\$0.8	\$0.0	(\$3.1)
Internal Bilateral	(\$58.3)	(\$58.0)	\$0.3	(\$0.0)	(\$5.7)	(\$5.7)	\$0.0	(\$0.0)	\$0.0	(\$0.0)
Up to Congestion	\$0.0	\$0.0	\$34.6	\$34.6	\$0.0	\$0.0	\$60.4	\$60.4	\$0.0	\$95.0
Wheel In	\$0.0	(\$45.5)	(\$15.7)	\$29.8	\$0.0	\$0.5	\$0.5	\$0.1	\$0.0	\$29.9
Wheel Out	(\$45.5)	\$0.0	\$0.0	(\$45.5)	\$0.5	\$0.0	\$0.0	\$0.5	\$0.0	(\$45.0)
Total	(\$206.8)	\$264.5	\$20.3	(\$451.0)	(\$6.0)	(\$57.7)	\$60.3	\$112.1	\$0.0	(\$339.0)

## Monthly Congestion

Table 11-13 shows that monthly total congestion costs ranged from \$73.3 million to \$111.3 million in the first three months of 2016.

**Table 11-13 Monthly PJM congestion costs by market (Dollars (Millions)): January through March of 2015 and 2016**

	Congestion Costs (Millions)							
	2015				2016			
	Day-Ahead Total	Balancing Total	Inadvertent Charges	Grand Total	Day-Ahead Total	Balancing Total	Inadvertent Charges	Grand Total
Jan	\$156.7	(\$24.4)	\$0.0	\$132.3	\$123.5	(\$16.0)	\$0.0	\$107.6
Feb	\$476.3	(\$46.4)	(\$0.0)	\$429.8	\$123.8	(\$12.5)	\$0.0	\$111.3
Mar	\$140.9	(\$71.4)	\$0.0	\$69.5	\$75.6	(\$2.2)	(\$0.0)	\$73.3
Total	\$773.9	(\$142.2)	(\$0.0)	\$631.7	\$322.9	(\$30.8)	\$0.0	\$292.2

Figure 11-1 shows PJM monthly total congestion cost for 2009 through March of 2016.

**Figure 11-1 PJM monthly total congestion cost (Dollars (Millions)): 2009 through March of 2016**

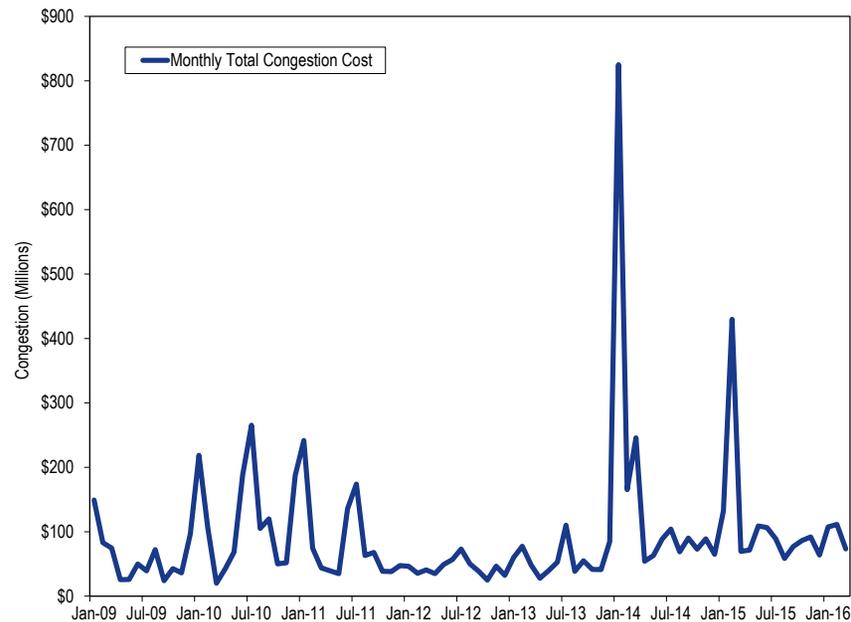


Table 11-14 shows the monthly total congestion costs for each virtual transaction type in the first three months of 2016 and Table 11-15 shows the monthly total congestion costs for each virtual transaction type in the first three months of 2015. Virtual transaction congestion costs, when positive, measure the total congestion cost to the virtual transaction and when negative, measure the total congestion credit to the virtual transaction. Table 11-14 and Table 11-15 shows that UTCs paid day-ahead congestion costs and were paid balancing congestion credits in the first three months of 2016 and in the first three months of 2015 UTCs were paid both day-ahead and balancing congestion credits. Total day-ahead congestion payments to UTCs decreased by \$34.6 million from the first three months of 2015 to the first three months of 2016, from -\$28.5 million in the first three months of 2015 to \$6.1 million in the first three months of 2016. Over the same period

balancing congestion payments to UTCs decreased from \$79.4 million in the first three months of 2015 to \$19.1 million in the first three months of 2016. Overall, total congestion payments to UTC decreased by 88.0 percent between January through March of 2015 and 2016. UTCs were paid \$107.9 million in congestion in the first three months of 2015 and \$13.0 million in the first three months of 2016. UTCs were paid \$132.9 million in January 2014 alone, due to emergency conditions in that month. The significant reduction in UTC activity that started September 8, 2014, is reflected in the changes in day-ahead and balancing congestion related revenues attributed to UTCs between the two periods. The reduction in UTC activity was a result of FERC's UTC uplift refund notice, effective September 8, 2014.<sup>18</sup>

**Table 11-14 Monthly PJM congestion costs by virtual transaction type and by market (Dollars (Millions)): January through March of 2016**

	Congestion Costs (Millions)								
	Day-Ahead				Balancing				Virtual Grand Total
	DEC	INC	Up to Congestion	Virtual Total	DEC	INC	Up to Congestion	Virtual Total	
Jan	\$6.8	(\$0.8)	\$4.2	\$10.1	(\$6.1)	(\$1.5)	(\$11.6)	(\$19.2)	(\$9.0)
Feb	\$6.0	(\$1.0)	\$1.2	\$6.1	(\$8.1)	(\$0.5)	(\$6.3)	(\$14.9)	(\$8.8)
Mar	\$5.1	(\$5.3)	\$0.8	\$0.5	(\$3.9)	\$3.8	(\$1.2)	(\$1.3)	(\$0.8)
Total	\$17.9	(\$7.1)	\$6.1	\$16.8	(\$18.1)	\$1.8	(\$19.1)	(\$35.4)	(\$18.6)

**Table 11-15 Monthly PJM congestion costs by virtual transaction type and by market (Dollars (Millions)): January through March of 2015**

	Congestion Costs (Millions)								
	Day-Ahead				Balancing				Virtual Grand Total
	DEC	INC	Up to Congestion	Virtual Total	DEC	INC	Up to Congestion	Virtual Total	
Jan	\$7.4	(\$3.2)	(\$3.4)	\$0.8	(\$7.1)	\$1.1	(\$11.3)	(\$17.4)	(\$16.6)
Feb	\$11.1	\$0.1	(\$37.6)	(\$26.4)	(\$15.4)	(\$0.6)	(\$13.0)	(\$29.0)	(\$55.4)
Mar	\$9.6	(\$0.1)	\$12.5	\$22.0	(\$17.7)	\$0.5	(\$55.1)	(\$72.3)	(\$50.3)
Total	\$28.1	(\$3.3)	(\$28.5)	(\$3.7)	(\$40.2)	\$1.0	(\$79.4)	(\$118.7)	(\$122.3)

<sup>18</sup> See 18 CFR § 385.213 (2014).

## Congested Facilities

A congestion event exists when a unit or units must be dispatched out of merit order to control for the potential impact of a contingency on a monitored facility or to control an actual overload. A congestion-event hour exists when a specific facility is constrained for one or more five-minute intervals within an hour. A congestion-event hour differs from a constrained hour, which is any hour during which one or more facilities are congested. Thus, if two facilities are constrained during an hour, the result is two congestion-event hours and one constrained hour. Constraints are often simultaneous, so the number of congestion-event hours usually exceeds the number of constrained hours and the number of congestion-event hours usually exceeds the number of hours in a year.

In order to have a consistent metric for real-time and day-ahead congestion frequency, real-time congestion frequency is measured using the convention that an hour is constrained if any of its component five-minute intervals is constrained. This is consistent with the way in which PJM reports real-time congestion. In the first three months of 2016, there were 66,373 day-ahead, congestion-event hours compared to 50,384 day-ahead congestion-event hours in the first three months of 2015. In the first three months of 2016, there were 6,763 real-time, congestion-event hours compared to 9,735 real-time, congestion-event hours in the first three months of 2015.

During the first three months of 2016, there were 3,985 congestion-event hours, 6.0 percent of day-ahead energy congestion-event hours, when the same facilities also constrained in the Real-Time Energy Market. During the first three months of 2016, there were 3,977 congestion-event hours, 58.8 percent of real-time congestion-event hours, when the same facilities were also constrained in the Day-Ahead Energy Market.

The Graceton Transformer was the largest contributor to total congestion costs in the first three months of 2016. With \$29.8 million in total congestion costs, it accounted for 10.2 percent of the total PJM congestion costs in the first three months of 2016. The top five constraints in terms of congestion costs contributed \$109.3 million, or 37.4 percent, of the total PJM congestion costs in the first three months of 2016. The top five constraints were the Graceton Transformer, the Bagley – Graceton Line, the Conastone – Northwest Line, the Milford – Steele Line and the Person – Halifax Flowgate.

## Congestion by Facility Type and Voltage

In the first three months of 2016, day-ahead, congestion-event hours decreased on flowgates and interfaces and increased on lines and transformers. Real-time, congestion-event hours decreased on all types of facilities.

Day-ahead congestion costs decreased on all types of facilities in the first three months of 2016 compared to the first three months of 2015. Balancing congestion costs decreased on flowgates and transformers and increased on interfaces and transmission lines in the first three months of 2016 compared to the first three months of 2015.

Table 11-16 provides congestion-event hour subtotals and congestion cost subtotals comparing the first three months of 2016 results by facility type: line, transformer, interface, flowgate and unclassified facilities.<sup>19</sup> <sup>20</sup> Table 11-17 presents this information for the first three months of 2015.

<sup>19</sup> Unclassified are congestion costs related to non-transmission facility constraints in the Day-Ahead Market and any unaccounted for difference between PJM billed congestion charges and calculated congestion costs including rounding errors. Non-transmission facility constraints include day-ahead market only constraints such as constraints on virtual transactions and constraints associated with phase-angle regulators.

<sup>20</sup> The term flowgate refers to MISO reciprocal coordinated flowgates and NYISO M2M flowgates.

Table 11-16 Congestion summary (By facility type): January through March of 2016

Type	Congestion Costs (Millions)										Event Hours	
	Day Ahead				Balancing				Grand Total	Day Ahead	Real Time	
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total				
Flowgate	\$17.6	(\$39.1)	(\$2.9)	\$53.8	(\$0.9)	\$3.9	(\$5.3)	(\$10.1)	\$43.7	5,182	1,832	
Interface	\$15.1	(\$11.4)	(\$1.4)	\$25.1	(\$0.1)	\$0.3	\$0.3	(\$0.0)	\$25.0	1,746	86	
Line	\$62.8	(\$85.8)	\$10.7	\$159.2	\$0.5	\$5.4	(\$11.1)	(\$16.1)	\$143.1	39,241	3,890	
Other	(\$0.2)	(\$0.6)	\$0.0	\$0.4	\$0.1	\$0.0	\$0.1	\$0.1	\$0.5	1,393	39	
Transformer	\$24.9	(\$56.6)	\$2.7	\$84.2	(\$1.8)	\$2.0	(\$2.1)	(\$6.0)	\$78.3	18,811	916	
Unclassified	\$0.0	(\$0.1)	\$0.1	\$0.2	\$1.2	\$0.3	\$0.5	\$1.4	\$1.6	NA	NA	
Total	\$120.2	(\$193.5)	\$9.2	\$322.9	(\$1.1)	\$11.9	(\$17.7)	(\$30.8)	\$292.2	66,373	6,763	

Table 11-17 Congestion summary (By facility type): January through March of 2015

Type	Congestion Costs (Millions)										Event Hours	
	Day Ahead				Balancing				Grand Total	Day Ahead	Real Time	
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total				
Flowgate	\$68.7	(\$35.8)	(\$21.9)	\$82.7	\$1.1	\$0.3	(\$5.7)	(\$5.0)	\$77.7	7,214	1,872	
Interface	\$44.1	(\$299.0)	(\$29.0)	\$314.1	\$10.7	\$28.3	\$4.4	(\$13.2)	\$300.9	4,487	1,267	
Line	\$123.6	(\$62.9)	\$45.5	\$232.0	(\$7.9)	\$36.0	(\$86.3)	(\$130.2)	\$101.8	27,404	5,533	
Other	\$0.2	(\$0.0)	\$0.2	\$0.4	\$0.0	\$0.1	\$0.1	\$0.0	\$0.4	568	26	
Transformer	\$90.5	(\$59.8)	(\$5.9)	\$144.4	\$2.2	\$4.0	\$3.0	\$1.1	\$145.5	10,711	1,037	
Unclassified	(\$0.2)	(\$0.5)	\$0.0	\$0.3	(\$0.6)	\$0.9	\$6.5	\$5.0	\$5.4	NA	NA	
Total	\$327.0	(\$457.9)	(\$11.0)	\$773.9	\$5.4	\$69.6	(\$78.0)	(\$142.2)	\$631.7	50,384	9,735	

Table 11-18 and Table 11-19 compare day-ahead and real-time congestion event hours. Among the hours for which a facility is constrained in the Day-Ahead Energy Market, the number of hours during which the facility is also constrained in the Real-Time Energy Market are presented in Table 11-18. In January through March of 2016, there were 66,373 congestion-event hours in the Day-Ahead Energy Market. Among those day-ahead congestion-event hours, only 3,985 (6.0 percent) were also constrained in the Real-Time Energy Market. In January through March of 2015, among the 50,384 day-ahead congestion-event hours, only 5,606 (11.1 percent) were binding in the Real-Time Energy Market.<sup>21</sup>

Among the hours for which a facility is constrained in the Real-Time Energy Market, the number of hours during which the facility is also constrained in the Day-Ahead Energy Market are presented in Table 11-19. In January through March of 2016, there were 6,763 congestion-event hours in the Real-Time Energy Market. Among these real-time congestion-event hours, 3,977 (58.8 percent) were also constrained in the Day-Ahead Energy Market. In January through March of 2015, among the 9,735 real-time congestion-event hours, 5,582 (57.3 percent) were also in the Day-Ahead Energy Market.

<sup>21</sup> Constraints are mapped to transmission facilities. In the Day-Ahead Energy Market, within a given hour, a single facility may be associated with multiple constraints. In such situations, the same facility accounts for more than one constraint-hour for a given hour in the Day-Ahead Energy Market. Similarly in the real-time market a facility may account for more than one constraint-hour within a given hour.

**Table 11-18 Congestion event hours (Day-Ahead against Real-Time): January through March of 2015 and 2016**

Type	Congestion Event Hours					
	2015 (Jan - Mar)			2016 (Jan - Mar)		
	Day Ahead Constrained	Corresponding Real Time Constrained	Percent	Day Ahead Constrained	Corresponding Real Time Constrained	Percent
Flowgate	7,214	1,112	15.4%	5,182	776	15.0%
Interface	4,487	958	21.4%	1,746	42	2.4%
Line	27,404	3,032	11.1%	39,241	2,600	6.6%
Other	568	0	0.0%	1,393	6	0.4%
Transformer	10,711	504	4.7%	18,811	561	3.0%
Total	50,384	5,606	11.1%	66,373	3,985	6.0%

**Table 11-19 Congestion event hours (Real-Time against Day-Ahead): January through March of 2015 and 2016**

Type	Congestion Event Hours					
	2015 (Jan - Mar)			2016 (Jan - Mar)		
	Real Time Constrained	Corresponding Day Ahead Constrained	Percent	Real Time Constrained	Corresponding Day Ahead Constrained	Percent
Flowgate	1,872	1,124	60.0%	1,832	778	42.5%
Interface	1,267	987	77.9%	86	44	51.2%
Line	5,533	3,014	54.5%	3,890	2,580	66.3%
Other	26	0	0.0%	39	6	15.4%
Transformer	1,037	457	44.1%	916	569	62.1%
Total	9,735	5,582	57.3%	6,763	3,977	58.8%

Table 11-20 shows congestion costs by facility voltage class for the first three months of 2016. Congestion costs in the first three months of 2016 decreased for facilities rated at 500 kV, 345 kV, 230 kV and 138 kV compared to the first three months of 2015 (Table 11-21).

**Table 11-20 Congestion summary (By facility voltage): January through March of 2016**

Voltage (kV)	Congestion Costs (Millions)										Event Hours	
	Day Ahead				Balancing				Grand Total	Day Ahead	Real Time	
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total				
765	\$0.2	(\$0.9)	\$0.7	\$1.8	\$0.0	\$0.0	\$0.0	\$0.0	\$1.8	695	0	
500	\$21.4	(\$23.6)	(\$1.8)	\$43.2	\$1.9	\$1.9	\$1.1	\$1.2	\$44.4	2,364	372	
345	(\$0.0)	(\$53.5)	\$5.5	\$58.9	\$0.1	\$6.6	(\$4.5)	(\$10.9)	\$48.0	13,132	884	
230	\$81.4	(\$42.2)	(\$3.1)	\$120.5	\$4.5	\$2.7	\$1.8	\$3.6	\$124.1	13,359	2,115	
161	(\$7.4)	(\$24.9)	(\$2.9)	\$14.6	(\$2.1)	\$2.6	(\$1.1)	(\$5.8)	\$8.8	2,040	580	
138	\$16.7	(\$46.8)	\$9.0	\$72.6	(\$3.7)	\$3.3	(\$13.9)	(\$20.9)	\$51.7	23,959	1,652	
115	\$2.2	(\$2.2)	\$0.5	\$4.9	(\$1.3)	\$0.6	(\$1.0)	(\$2.9)	\$2.0	4,762	404	
69	\$5.7	\$0.7	\$1.1	\$6.1	(\$1.7)	(\$6.0)	(\$0.7)	\$3.6	\$9.7	5,339	756	
34	\$0.0	\$0.0	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	719	0	
12	(\$0.0)	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	4	0	
Unclassified	\$0.0	(\$0.1)	\$0.1	\$0.2	\$1.2	\$0.3	\$0.5	\$1.4	\$1.6	NA	NA	
Total	\$120.2	(\$193.5)	\$9.2	\$322.9	(\$1.1)	\$11.9	(\$17.7)	(\$30.8)	\$292.2	66,373	6,763	

Table 11-21 Congestion summary (By facility voltage): January through March of 2015

Voltage (kV)	Congestion Costs (Millions)										
	Day Ahead				Balancing				Grand Total	Event Hours	
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total		Day Ahead	Real Time
765	\$19.8	(\$46.4)	(\$6.3)	\$59.8	\$1.0	(\$0.1)	\$1.8	\$2.9	\$62.7	1,298	133
500	\$54.9	(\$302.1)	(\$28.3)	\$328.7	\$11.4	\$28.3	\$0.3	(\$16.7)	\$312.0	4,504	827
460	(\$0.0)	(\$3.3)	\$0.2	\$3.6	\$0.0	\$0.0	\$0.0	\$0.0	\$3.6	1,117	0
345	\$3.6	(\$33.4)	\$2.5	\$39.5	\$2.5	\$1.7	(\$0.6)	\$0.2	\$39.7	4,958	659
230	\$120.9	\$8.7	\$11.7	\$123.9	(\$5.2)	\$16.3	(\$33.0)	(\$54.6)	\$69.3	10,587	2,273
161	(\$8.4)	(\$23.0)	(\$0.6)	\$13.9	\$0.3	\$0.5	(\$1.4)	(\$1.6)	\$12.3	1,789	747
138	\$107.4	(\$55.3)	\$8.1	\$170.9	(\$3.7)	\$20.4	(\$50.5)	(\$74.6)	\$96.3	20,169	4,649
115	\$1.5	(\$7.9)	\$2.5	\$11.8	\$0.7	\$1.3	(\$1.1)	(\$1.8)	\$10.1	2,824	324
69	\$27.6	\$5.3	(\$1.0)	\$21.4	(\$0.9)	\$0.3	\$0.0	(\$1.1)	\$20.2	2,801	123
34	\$0.0	(\$0.0)	\$0.1	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	333	0
13	(\$0.0)	(\$0.0)	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	3	0
12	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	1	0
Unclassified	(\$0.2)	(\$0.5)	\$0.0	\$0.3	(\$0.6)	\$0.9	\$6.5	\$5.0	\$5.4	NA	NA
Total	\$327.0	(\$457.9)	(\$11.0)	\$773.9	\$5.4	\$69.6	(\$78.0)	(\$142.2)	\$631.7	50,384	9,735

## Constraint Duration

Table 11-22 lists the constraints in January through March of 2015 and 2016 that were most frequently binding and Table 11-23 shows the constraints which experienced the largest change in congestion-event hours from January through March of 2015 to 2016.

**Table 11-22 Top 25 constraints with frequent occurrence: January through March of 2015 and 2016**

No.	Constraint	Type	Event Hours						Percent of Annual Hours					
			Day Ahead			Real Time			Day Ahead			Real Time		
			2015	2016	Change	2015	2016	Change	2015	2016	Change	2015	2016	Change
1	Mercer IP - Galesburg	Flowgate	0	1,713	1,713	0	549	549	0%	20%	20%	0%	6%	6%
2	Monroe - Vineland	Line	359	1,917	1,558	0	252	252	4%	22%	18%	0%	3%	3%
3	Milford - Steele	Line	0	1,481	1,481	9	265	256	0%	17%	17%	0%	3%	3%
4	Miami Fort	Transformer	81	1,671	1,590	0	2	2	1%	19%	18%	0%	0%	0%
5	Graceton	Transformer	2	1,114	1,112	0	427	427	0%	13%	13%	0%	5%	5%
6	Bagley - Graceton	Line	499	1,051	552	146	433	287	6%	12%	6%	2%	5%	3%
7	Braidwood	Transformer	433	1,346	913	0	0	0	5%	15%	10%	0%	0%	0%
8	Cherry Valley	Transformer	98	1,026	928	14	141	127	1%	12%	11%	0%	2%	1%
9	Mardela - Vienna	Line	35	773	738	0	380	380	0%	9%	8%	0%	4%	4%
10	Kewance - Hennepin Tap	Line	0	1,004	1,004	0	107	107	0%	11%	11%	0%	1%	1%
11	Tidd	Transformer	680	1,111	431	74	0	(74)	8%	13%	5%	1%	0%	(1%)
12	East Bend	Transformer	900	1,086	186	0	0	0	10%	12%	2%	0%	0%	0%
13	Conastone - Northwest	Line	0	607	607	0	432	432	0%	7%	7%	0%	5%	5%
14	Franklin - Vernon	Line	146	1,011	865	0	0	0	2%	12%	10%	0%	0%	0%
15	Clinch River	Transformer	231	1,003	772	0	0	0	3%	11%	9%	0%	0%	0%
16	East Danville - Banister	Line	1,577	1,001	(576)	126	0	(126)	18%	11%	(7%)	1%	0%	(1%)
17	Roxana - Praxair	Flowgate	0	662	662	0	335	335	0%	8%	8%	0%	4%	4%
18	Sayreville - Sayreville	Line	1,013	958	(55)	0	0	0	12%	11%	(1%)	0%	0%	0%
19	Everts Drive - South Troy	Line	70	864	794	0	49	49	1%	10%	9%	0%	1%	1%
20	Tanners Creek	Transformer	458	903	445	0	0	0	5%	10%	5%	0%	0%	0%
21	Cedar Grove - Roseland	Line	125	870	745	64	10	(54)	1%	10%	8%	1%	0%	(1%)
22	Bremo	Transformer	20	870	850	0	0	0	0%	10%	10%	0%	0%	0%
23	Cartanza	Transformer	10	824	814	0	0	0	0%	9%	9%	0%	0%	0%
24	E.K.P Hebron - Hebron	Line	0	817	817	0	0	0	0%	9%	9%	0%	0%	0%
25	La Salle - La Salle	Line	73	793	720	0	0	0	1%	9%	8%	0%	0%	0%

Table 11-23 Top 25 constraints with largest year-to-year change in occurrence: January through March of 2015 and 2016

No.	Constraint	Type	Event Hours						Percent of Annual Hours					
			Day Ahead			Real Time			Day Ahead			Real Time		
			2015	2016	Change	2015	2016	Change	2015	2016	Change	2015	2016	Change
1	Bergen - New Milford	Line	2,069	18	(2,051)	767	0	(767)	24%	0%	(23%)	9%	0%	(9%)
2	Oak Grove - Galesburg	Flowgate	1,789	0	(1,789)	747	3	(744)	20%	0%	(20%)	9%	0%	(8%)
3	Mercer IP - Galesburg	Flowgate	0	1,713	1,713	0	549	549	0%	20%	20%	0%	6%	6%
4	Maywood - Saddlebrook	Line	1,681	29	(1,652)	442	0	(442)	19%	0%	(19%)	5%	0%	(5%)
5	Easton	Transformer	2,005	91	(1,914)	0	0	0	23%	1%	(22%)	0%	0%	0%
6	Monroe - Vineland	Line	359	1,917	1,558	0	252	252	4%	22%	18%	0%	3%	3%
7	Milford - Steele	Line	0	1,481	1,481	9	265	256	0%	17%	17%	0%	3%	3%
8	Miami Fort	Transformer	81	1,671	1,590	0	2	2	1%	19%	18%	0%	0%	0%
9	Graceton	Transformer	2	1,114	1,112	0	427	427	0%	13%	13%	0%	5%	5%
10	Bunsonville - Eugene	Flowgate	1,148	0	(1,148)	272	0	(272)	13%	0%	(13%)	3%	0%	(3%)
11	Mahans Lane - Tidd	Line	978	0	(978)	394	0	(394)	11%	0%	(11%)	4%	0%	(4%)
12	Breed - Wheatland	Flowgate	1,235	0	(1,235)	90	0	(90)	14%	0%	(14%)	1%	0%	(1%)
13	Mardela - Vienna	Line	35	773	738	0	380	380	0%	9%	8%	0%	4%	4%
14	Brucea	Transformer	1,117	0	(1,117)	0	0	0	13%	0%	(13%)	0%	0%	0%
15	Kewanee - Hennepin Tap	Line	0	1,004	1,004	0	107	107	0%	11%	11%	0%	1%	1%
16	Cherry Valley	Transformer	98	1,026	928	14	141	127	1%	12%	11%	0%	2%	1%
17	Conastone - Northwest	Line	0	607	607	0	432	432	0%	7%	7%	0%	5%	5%
18	Roxana - Praxair	Flowgate	0	662	662	0	335	335	0%	8%	8%	0%	4%	4%
19	Bedington - Black Oak	Interface	1,320	542	(778)	255	52	(203)	15%	6%	(9%)	3%	1%	(2%)
20	SENECA	Interface	419	0	(419)	514	0	(514)	5%	0%	(5%)	6%	0%	(6%)
21	Braidwood	Transformer	433	1,346	913	0	0	0	5%	15%	10%	0%	0%	0%
22	Rising	Flowgate	611	0	(611)	295	3	(292)	7%	0%	(7%)	3%	0%	(3%)
23	Wolf Creek	Transformer	710	0	(710)	171	0	(171)	8%	0%	(8%)	2%	0%	(2%)
24	Franklin - Vernon	Line	146	1,011	865	0	0	0	2%	12%	10%	0%	0%	0%
25	Bremo	Transformer	20	870	850	0	0	0	0%	10%	10%	0%	0%	0%

## Constraint Costs

Table 11-24 and Table 11-25 present the top constraints affecting congestion costs by facility for the periods January through March of 2016 and 2015.

**Table 11-24 Top 25 constraints affecting PJM congestion costs (By facility): January through March of 2016**

No.	Constraint	Type	Location	Congestion Costs (Millions)								Percent of Total PJM Congestion Costs	
				Day Ahead				Balancing				Grand Total	2016 (Jan - Mar)
				Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total		
1	Graceton	Transformer	BGE	\$17.7	(\$11.5)	(\$1.8)	\$27.4	(\$0.5)	(\$0.9)	\$2.0	\$2.4	\$29.8	10.2%
2	Bagley - Graceton	Line	BGE	\$21.5	(\$1.8)	(\$1.4)	\$21.8	\$0.6	(\$1.2)	\$1.2	\$3.0	\$24.8	8.5%
3	Conastone - Northwest	Line	BGE	\$20.1	(\$4.4)	(\$2.0)	\$22.5	\$0.5	\$0.4	\$2.2	\$2.3	\$24.8	8.5%
4	Milford - Steele	Line	DPL	(\$8.3)	(\$25.7)	\$0.1	\$17.5	\$2.2	\$1.4	(\$1.7)	(\$0.9)	\$16.6	5.7%
5	Person - Halifax	Flowgate	MISO	\$29.9	\$16.1	(\$0.2)	\$13.5	\$0.0	\$0.0	(\$0.2)	(\$0.2)	\$13.3	4.5%
6	Kanawha River - Matt Funk	Line	AEP	\$2.7	(\$17.1)	(\$1.1)	\$18.8	(\$0.7)	\$2.5	(\$3.3)	(\$6.6)	\$12.2	4.2%
7	Loudoun	Transformer	500	\$1.1	(\$9.8)	(\$0.3)	\$10.6	\$0.8	\$0.7	\$0.5	\$0.6	\$11.1	3.8%
8	AP South	Interface	500	\$8.8	(\$3.2)	(\$1.2)	\$10.7	\$0.0	\$0.0	\$0.0	\$0.0	\$10.7	3.7%
9	Mercer IP - Galesburg	Flowgate	MISO	(\$7.3)	(\$23.2)	(\$2.8)	\$13.1	(\$0.0)	\$2.2	(\$0.8)	(\$3.0)	\$10.1	3.4%
10	Conastone - Peach Bottom	Line	500	\$5.8	(\$2.6)	(\$0.2)	\$8.2	\$0.7	\$1.0	\$0.4	\$0.1	\$8.3	2.8%
11	Cherry Valley	Transformer	ComEd	\$7.3	(\$8.2)	\$1.1	\$16.5	(\$2.6)	\$1.5	(\$4.2)	(\$8.3)	\$8.2	2.8%
12	Bedington - Black Oak	Interface	500	\$4.5	(\$4.2)	(\$0.7)	\$8.0	\$0.1	\$0.1	\$0.2	\$0.2	\$8.2	2.8%
13	Cherry Valley	Flowgate	MISO	(\$0.4)	(\$7.6)	\$0.4	\$7.7	\$0.0	\$0.0	\$0.0	\$0.0	\$7.7	2.6%
14	Cherry Valley - Silver Lake	Flowgate	MISO	(\$1.3)	(\$7.2)	\$0.7	\$6.6	\$0.0	\$0.0	\$0.0	\$0.0	\$6.6	2.3%
15	Kanawha	Transformer	AEP	\$0.1	(\$5.7)	\$0.3	\$6.1	\$0.0	\$0.0	\$0.0	\$0.0	\$6.1	2.1%
16	Mardela - Vienna	Line	DPL	(\$1.4)	(\$3.5)	(\$0.1)	\$2.0	(\$0.6)	(\$4.1)	\$0.5	\$4.0	\$6.0	2.1%
17	AEP - DOM	Interface	500	\$1.4	(\$2.6)	\$0.7	\$4.7	\$0.2	(\$0.0)	\$0.1	\$0.4	\$5.1	1.7%
18	Meadow Brook - Strasburg	Line	AP	\$8.0	\$4.1	(\$0.2)	\$3.6	(\$0.9)	(\$0.7)	\$0.9	\$0.6	\$4.2	1.5%
19	Bremo	Transformer	Dominion	(\$1.4)	(\$5.1)	\$0.3	\$4.0	\$0.0	\$0.0	\$0.0	\$0.0	\$4.0	1.4%
20	Braidwood - East Frankfurt	Flowgate	MISO	(\$0.0)	(\$3.2)	\$0.4	\$3.6	\$0.0	\$0.0	\$0.0	\$0.0	\$3.6	1.2%
21	Kammer	Transformer	AEP	(\$1.3)	(\$5.5)	(\$0.2)	\$4.0	\$0.3	\$0.6	(\$0.5)	(\$0.8)	\$3.2	1.1%
22	Batesville - Hubble	Flowgate	MISO	(\$1.2)	(\$4.5)	(\$0.3)	\$3.0	\$0.2	(\$0.2)	(\$0.5)	(\$0.2)	\$2.8	1.0%
23	Monroe - Vineland	Line	AECO	\$6.4	\$4.7	\$1.7	\$3.4	(\$1.0)	(\$1.6)	(\$1.3)	(\$0.6)	\$2.7	0.9%
24	Richmond - Waneeta	Line	PECO	\$0.5	(\$2.0)	\$0.0	\$2.5	\$0.1	\$0.6	\$0.7	\$0.2	\$2.7	0.9%
25	Braidwood - East Frankfort	Line	ComEd	(\$0.1)	(\$2.6)	\$0.1	\$2.6	\$0.0	\$0.0	\$0.0	\$0.0	\$2.6	0.9%

Table 11–25 Top 25 constraints affecting PJM congestion costs (By facility): January through March of 2015


No.	Constraint	Type	Location	Congestion Costs (Millions)								Percent of Total PJM Congestion Costs	
				Day Ahead				Balancing				Grand Total	2015 (Jan - Mar)
				Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total		
1	5004/5005 Interface	Interface	500	(\$22.8)	(\$132.5)	(\$9.1)	\$100.6	\$7.0	\$22.4	\$1.9	(\$13.5)	\$87.1	13.8%
2	Bedington - Black Oak	Interface	500	\$34.9	(\$40.2)	(\$7.4)	\$67.7	\$2.2	\$1.8	\$3.3	\$3.7	\$71.4	11.3%
3	AEP - DOM	Interface	500	\$25.3	(\$26.7)	(\$1.0)	\$51.0	\$0.9	\$1.6	(\$1.9)	(\$2.6)	\$48.4	7.7%
4	AP South	Interface	500	\$29.9	(\$20.8)	(\$4.5)	\$46.2	\$0.3	\$0.2	\$0.6	\$0.7	\$46.9	7.4%
5	Joshua Falls	Transformer	AEP	\$9.5	(\$35.5)	(\$4.9)	\$40.1	\$0.7	(\$0.1)	\$2.3	\$3.1	\$43.2	6.8%
6	Bergen - New Milford	Line	PSEG	\$23.1	\$17.1	\$15.4	\$21.4	(\$6.6)	\$8.5	(\$47.0)	(\$62.1)	(\$40.7)	(6.4%)
7	Person - Halifax	Flowgate	MISO	\$78.9	\$28.5	(\$10.6)	\$39.9	\$0.0	(\$0.0)	(\$0.1)	(\$0.1)	\$39.8	6.3%
8	Maywood - Saddlebrook	Line	PSEG	\$7.9	\$3.9	\$6.1	\$10.1	(\$4.8)	\$8.6	(\$20.7)	(\$34.1)	(\$24.0)	(3.8%)
9	Easton	Transformer	DPL	\$26.5	\$6.1	(\$0.9)	\$19.5	\$0.0	\$0.0	\$0.0	\$0.0	\$19.5	3.1%
10	East	Interface	500	(\$10.0)	(\$31.2)	(\$1.9)	\$19.2	(\$0.1)	\$0.3	\$0.5	\$0.1	\$19.4	3.1%
11	Mahans Lane - Tidd	Line	AEP	\$7.7	(\$13.0)	(\$1.5)	\$19.1	\$0.4	\$1.1	\$0.9	\$0.2	\$19.3	3.1%
12	49th Street - Hoboken	Line	PSEG	\$0.0	\$0.0	\$0.0	\$0.0	(\$2.8)	\$2.2	(\$13.1)	(\$18.1)	(\$18.1)	(2.9%)
13	East Danville - Banister	Line	AEP	\$7.5	(\$5.8)	\$1.3	\$14.5	\$0.5	(\$1.5)	(\$0.6)	\$1.4	\$15.9	2.5%
14	Breed - Wheatland	Flowgate	MISO	(\$1.6)	(\$14.5)	\$0.6	\$13.5	\$0.0	(\$0.7)	\$0.1	\$0.8	\$14.3	2.3%
15	Valley	Transformer	500	\$13.8	(\$0.5)	(\$0.5)	\$13.8	\$0.0	\$0.0	\$0.0	\$0.0	\$13.8	2.2%
16	Cloverdale	Transformer	AEP	\$5.9	(\$9.2)	(\$1.6)	\$13.6	\$0.0	\$0.0	\$0.0	\$0.0	\$13.6	2.1%
17	Central	Interface	500	(\$15.5)	(\$32.7)	(\$3.9)	\$13.3	\$0.1	\$1.0	\$0.3	(\$0.7)	\$12.6	2.0%
18	Oak Grove - Galesburg	Flowgate	MISO	(\$8.4)	(\$23.0)	(\$0.6)	\$13.9	\$0.3	\$0.5	(\$1.4)	(\$1.6)	\$12.3	2.0%
19	Bagley - Graceton	Line	BGE	\$8.2	(\$1.8)	\$0.0	\$10.1	(\$0.0)	(\$1.6)	\$0.2	\$1.8	\$11.9	1.9%
20	West	Interface	500	(\$1.6)	(\$14.3)	(\$0.9)	\$11.8	\$0.2	\$1.0	\$0.1	(\$0.6)	\$11.3	1.8%
21	Dravosburg - West Mifflin	Line	DLCO	\$15.9	\$3.4	(\$0.7)	\$11.8	\$0.4	\$2.7	(\$0.1)	(\$2.3)	\$9.5	1.5%
22	Rising	Flowgate	MISO	\$0.5	(\$11.3)	(\$6.4)	\$5.5	\$0.2	(\$0.1)	\$3.5	\$3.8	\$9.3	1.5%
23	49 Street - Hoboken	Line	PSEG	\$1.2	(\$0.9)	\$5.3	\$7.4	\$0.0	\$0.0	\$0.0	\$0.0	\$7.4	1.2%
24	Wescosville	Transformer	PPL	\$10.1	\$4.2	\$1.3	\$7.2	\$0.1	(\$0.2)	(\$0.4)	(\$0.0)	\$7.1	1.1%
25	Valley	Transformer	Dominion	\$6.7	(\$0.9)	(\$0.1)	\$7.4	\$0.1	\$0.5	(\$0.2)	(\$0.5)	\$6.9	1.1%

Figure 11-2 shows the locations of the top 10 constraints by PJM total congestion costs in the first three months of 2016. Figure 11-3 shows the locations of the top 10 constraints by PJM day-ahead congestion costs in the first three months of 2016. Figure 11-4 shows the locations of the top 10 constraints by PJM balancing congestion costs in the first three months of 2016.


**Figure 11-2 Location of the top 10 constraints by PJM total congestion costs: January through March of 2016**



**Figure 11-3 Location of the top 10 constraints by PJM day-ahead congestion costs: January through March of 2016**

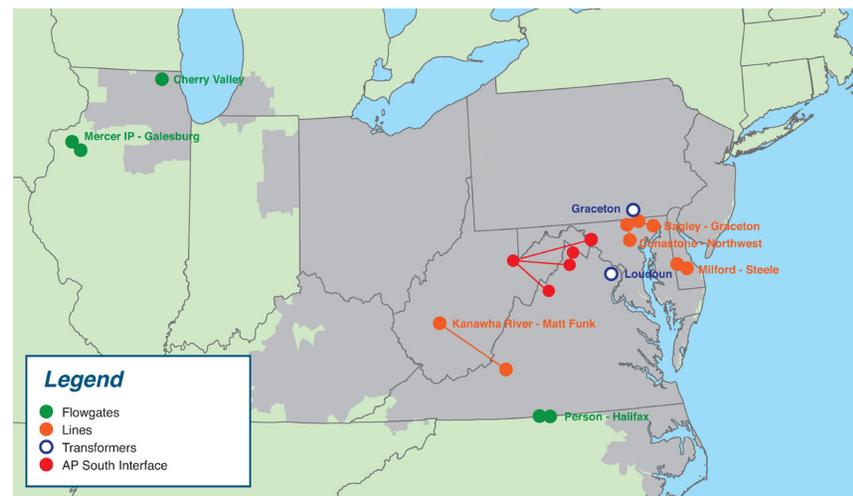

**Figure 11-4 Location of the top 10 constraints by PJM balancing congestion costs: January through March of 2016**

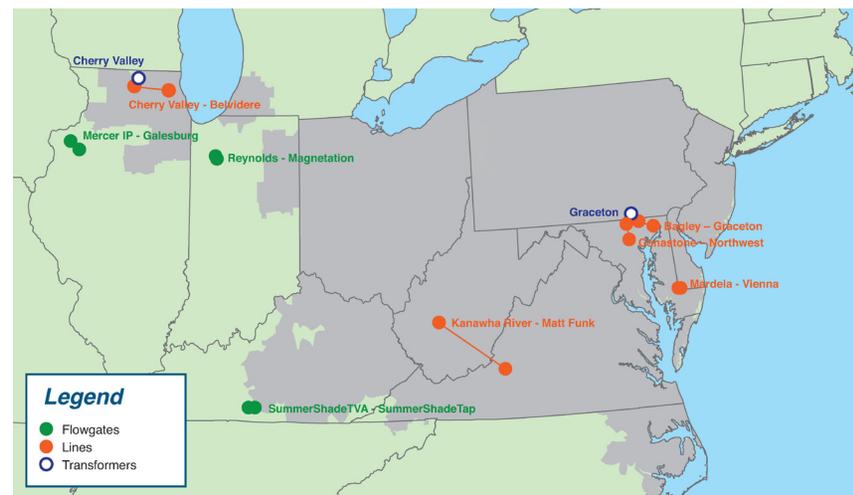

## Congestion-Event Summary for MISO Flowgates

PJM and MISO have a joint operating agreement (JOA) which defines a coordinated methodology for congestion management. This agreement establishes reciprocal, coordinated flowgates in the combined footprint whose operating limits are respected by the operators of both organizations.<sup>22</sup> A flowgate is a facility or group of facilities that may act as constraint points on the regional system.<sup>23</sup> PJM models these coordinated flowgates and controls for them in its security-constrained, economic dispatch.

As of March 31, 2016, PJM had 133 flowgates eligible for M2M (Market to Market) coordination and MISO had 263 flowgates eligible for M2M coordination.

Table 11-26 and Table 11-27 show the MISO flowgates which PJM and/or MISO took dispatch action to control during the first three months of 2016 and the first three months of 2015, and which had the greatest congestion cost impact on PJM. Total congestion costs associated with a given constraint may be positive or negative in value. The top congestion cost impacts for MISO flowgates affecting PJM and MISO dispatch are presented by constraint, in descending order of the absolute value of total congestion costs. Among MISO flowgates in the first three months of 2016, the Person - Halifax Flowgate made the most significant contribution to positive congestion while the Summer Shade TVA – Summer Shade Tap Flowgate made the most significant contribution to negative congestion.

**Table 11-26 Top 20 congestion cost impacts from MISO flowgates affecting PJM dispatch (By facility): January through March of 2016**

No.	Constraint	Congestion Costs (Millions)										Event Hours	
		Day Ahead				Balancing				Grand Total	Day Ahead	Real Time	
		Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total				
1	Person - Halifax	\$29.9	\$16.1	(\$0.2)	\$13.5	\$0.0	\$0.0	(\$0.2)	(\$0.2)	\$13.3	719	5	
2	Mercer IP - Galesburg	(\$7.3)	(\$23.2)	(\$2.8)	\$13.1	(\$0.0)	\$2.2	(\$0.8)	(\$3.0)	\$10.1	1,713	549	
3	Cherry Valley	(\$0.4)	(\$7.6)	\$0.4	\$7.7	\$0.0	\$0.0	\$0.0	\$0.0	\$7.7	293	0	
4	Cherry Valley - Silver Lake	(\$1.3)	(\$7.2)	\$0.7	\$6.6	\$0.0	\$0.0	\$0.0	\$0.0	\$6.6	365	0	
5	Braidwood - East Frankfurt	(\$0.0)	(\$3.2)	\$0.4	\$3.6	\$0.0	\$0.0	\$0.0	\$0.0	\$3.6	169	0	
6	Batesville - Hubble	(\$1.2)	(\$4.5)	(\$0.3)	\$3.0	\$0.2	(\$0.2)	(\$0.5)	(\$0.2)	\$2.8	284	58	
7	SummerShadeTVA - SummerShadeTap	(\$0.2)	(\$1.4)	(\$0.1)	\$1.1	(\$2.1)	\$0.4	(\$0.3)	(\$2.8)	(\$1.7)	209	26	
8	Roxana - Praxair	(\$0.9)	(\$2.3)	(\$1.0)	\$0.4	\$0.5	(\$0.3)	(\$2.4)	(\$1.6)	(\$1.2)	662	335	
9	Reynolds - Magnetation	(\$0.5)	(\$3.2)	\$0.3	\$3.1	\$0.0	\$0.7	(\$1.3)	(\$2.0)	\$1.1	334	205	
10	Monroe - Bayshore	(\$0.2)	(\$0.8)	(\$0.1)	\$0.5	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$0.4	23	18	
11	Rantoul - Rantoul Jct	(\$0.1)	(\$0.4)	(\$0.1)	\$0.2	\$0.0	\$0.0	\$0.0	\$0.0	\$0.2	61	0	
12	Pleasant Valley - Belvidere	(\$0.0)	(\$0.3)	(\$0.0)	\$0.2	\$0.0	\$0.0	\$0.0	\$0.0	\$0.2	12	0	
13	Dixon - McGirr Rd	(\$0.0)	(\$0.2)	\$0.0	\$0.2	\$0.0	\$0.0	\$0.0	\$0.0	\$0.2	48	0	
14	Burnham - Munster	(\$0.0)	(\$0.1)	\$0.1	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	44	0	
15	West DeKalb - Glidden	(\$0.0)	(\$0.1)	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	59	0	
16	Gary Ave	(\$0.1)	(\$0.3)	(\$0.1)	\$0.2	\$0.0	(\$0.0)	(\$0.1)	(\$0.1)	\$0.1	56	12	
17	North Champaign - Vermilion	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.1)	(\$0.1)	(\$0.1)	0	3	
18	Vermilion - Tilton	(\$0.0)	(\$0.1)	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	56	0	
19	Butler - Karns City	\$0.1	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	9	0	
20	Bunsonville	(\$0.0)	(\$0.1)	(\$0.0)	\$0.0	(\$0.0)	\$0.0	\$0.0	(\$0.0)	\$0.0	34	3	

<sup>22</sup> See "Joint Operating Agreement Between the Midwest Independent Transmission System Operator, Inc. and PJM Interconnection, L.L.C.," (December 11, 2008), Section 6.1 <<http://www.pjm.com/documents/agreements.aspx>>.

<sup>23</sup> See "Joint Operating Agreement Between the Midwest Independent Transmission System Operator, Inc. and PJM Interconnection, L.L.C.," (December 11, 2008), Section 2.2.24 <<http://www.pjm.com/documents/agreements.aspx>>.

Table 11-27 Top 20 congestion cost impacts from MISO flowgates affecting PJM dispatch (By facility): January through March of 2015

No.	Constraint	Congestion Costs (Millions)										Event Hours	
		Day Ahead				Balancing				Grand Total	Day Ahead	Real Time	
		Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total				
1	Person - Halifax	\$78.9	\$28.5	(\$10.6)	\$39.9	\$0.0	(\$0.0)	(\$0.1)	(\$0.1)	\$39.8	1,249	6	
2	Breed - Wheatland	(\$1.6)	(\$14.5)	\$0.6	\$13.5	\$0.0	(\$0.7)	\$0.1	\$0.8	\$14.3	1,235	90	
3	Oak Grove - Galesburg	(\$8.4)	(\$23.0)	(\$0.6)	\$13.9	\$0.3	\$0.5	(\$1.4)	(\$1.6)	\$12.3	1,789	747	
4	Rising	\$0.5	(\$11.3)	(\$6.4)	\$5.5	\$0.2	(\$0.1)	\$3.5	\$3.8	\$9.3	611	295	
5	Bunsonville - Eugene	(\$1.1)	(\$9.6)	(\$5.4)	\$3.1	\$0.0	(\$0.1)	\$0.6	\$0.8	\$3.8	1,148	272	
6	Klondcin - Purdue	\$0.0	(\$0.1)	\$0.0	\$0.1	(\$0.0)	\$0.4	(\$2.5)	(\$2.9)	(\$2.8)	40	48	
7	Volunteer - Phipps Bend	\$0.1	(\$1.3)	\$0.1	\$1.5	\$0.0	(\$0.3)	(\$4.5)	(\$4.1)	(\$2.6)	43	49	
8	Michigan City - Laporte	\$0.6	(\$1.5)	\$0.1	\$2.1	\$0.0	\$0.0	\$0.0	\$0.0	\$2.1	572	0	
9	Pierce - Foster	(\$0.2)	(\$1.0)	\$0.1	\$0.9	\$0.0	\$0.0	\$0.0	\$0.0	\$0.9	43	0	
10	Burnham - Munster	\$0.1	(\$0.5)	\$0.1	\$0.6	\$0.0	\$0.0	\$0.0	\$0.0	\$0.6	85	0	
11	Reynolds - Magnetation	\$0.0	(\$1.0)	(\$0.0)	\$1.0	\$0.0	\$0.2	(\$0.3)	(\$0.4)	\$0.5	156	28	
12	Reynold - Monticello	\$0.0	(\$0.0)	\$0.0	\$0.0	(\$0.0)	\$0.3	(\$0.2)	(\$0.5)	(\$0.5)	22	23	
13	Wake - Carso	\$0.0	\$0.0	\$0.0	\$0.0	\$0.4	\$0.1	(\$0.0)	\$0.2	\$0.2	0	7	
14	Monroe - Bayshore	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.0)	(\$0.4)	(\$0.1)	\$0.2	\$0.2	0	29	
15	Byron - Cherry Valley	\$0.0	(\$0.2)	\$0.0	\$0.2	\$0.0	\$0.0	\$0.0	\$0.0	\$0.2	27	0	
16	Casey - Breed	(\$0.0)	(\$0.1)	(\$0.0)	\$0.1	(\$0.0)	(\$0.0)	\$0.0	\$0.0	\$0.1	89	1	
17	Cherry Valley - Silver Lake	(\$0.0)	(\$0.1)	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	14	0	
18	Hennepin	(\$0.0)	(\$0.1)	\$0.0	\$0.1	\$0.0	(\$0.0)	(\$0.0)	(\$0.0)	\$0.1	54	38	
19	Powerton Jct - Lilly	(\$0.0)	(\$0.1)	\$0.0	\$0.1	(\$0.0)	(\$0.1)	(\$0.1)	(\$0.0)	\$0.1	10	13	
20	St John	\$0.0	(\$0.0)	\$0.0	\$0.0	(\$0.0)	(\$0.0)	(\$0.1)	(\$0.1)	(\$0.0)	8	4	

## Congestion-Event Summary for NYISO Flowgates

PJM and NYISO have a joint operating agreement (JOA) which defines a coordinated methodology for congestion management. This agreement establishes a structure and framework for the reliable operation of the interconnected PJM and NYISO transmission systems and efficient market operation through M2M coordination.<sup>24</sup> Only a subset of all transmission constraints that exist in either market are eligible for coordinated congestion management. This subset of transmission constraints is identified as M2M flowgates. Flowgates eligible for the M2M coordination process are called M2M flowgates.<sup>25</sup>

<sup>24</sup> See "Joint Operating Agreement Among and Between the New York Independent System Operator Inc. and PJM Interconnection, LLC," (January 17, 2013) Section 35.3.1 <<http://www.pjm.com/documents/agreements.aspx>>.

<sup>25</sup> See "Joint Operating Agreement Among and Between the New York Independent System Operator Inc. and PJM Interconnection, LLC," (January 17, 2013) Section 35.23 <<http://www.pjm.com/documents/agreements.aspx>>.

Table 11-28 shows the NYISO flowgates which PJM and/or NYISO took dispatch action to control during the first three months of 2016, and which had the greatest congestion cost impact on PJM.

## Congestion-Event Summary for the 500 kV System

Constraints on the 500 kV system generally have a regional impact. Table 11-30 and Table 11-31 show the 500 kV constraints affecting congestion costs in PJM for the first three months of 2016 and the first three months of 2015. Total congestion costs are the sum of the day-ahead and balancing congestion cost components. Total congestion costs associated with a given constraint may be positive or negative in value. The 500 kV constraints affecting congestion costs in PJM are presented by constraint, in descending order of the absolute value of total congestion costs.

Table 11-28 Top two congestion cost impacts from NYISO flowgates affecting PJM dispatch (By facility): January through March of 2016

No.	Constraint	Type	Location	Congestion Costs (Millions)										Event Hours	
				Day Ahead				Balancing				Grand Total	Day Ahead	Real Time	
				Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total				
1	Central East	Flowgate	NYISO	\$0.0	\$0.0	\$0.0	\$0.0	\$0.4	\$1.0	\$0.2	(\$0.3)	(\$0.3)	0	516	
2	Dysinger East	Flowgate	NYISO	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	0	2	

Table 11-29 Top two congestion cost impacts from NYISO flowgates affecting PJM dispatch (By facility): January through March of 2015

No.	Constraint	Type	Location	Congestion Costs (Millions)										Event Hours	
				Day Ahead				Balancing				Grand Total	Day Ahead	Real Time	
				Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total				
1	Central East	Flowgate	NYISO	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.4	(\$0.1)	(\$0.5)	(\$0.5)	0	149	
2	Dysinger East	Flowgate	NYISO	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.1)	\$0.1	\$0.2	\$0.2	0	25	

Table 11-30 Regional constraints summary (By facility): January through March of 2016

No.	Constraint	Type	Location	Congestion Costs (Millions)										Event Hours	
				Day Ahead				Balancing				Grand Total	Day Ahead	Real Time	
				Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total				
1	Loudoun	Transformer	500	\$1.1	(\$9.8)	(\$0.3)	\$10.6	\$0.8	\$0.7	\$0.5	\$0.6	\$11.1	212	45	
2	AP South	Interface	500	\$8.8	(\$3.2)	(\$1.2)	\$10.7	\$0.0	\$0.0	\$0.0	\$0.0	\$10.7	416	0	
3	Conastone - Peach Bottom	Line	500	\$5.8	(\$2.6)	(\$0.2)	\$8.2	\$0.7	\$1.0	\$0.4	\$0.1	\$8.3	502	254	
4	Bedington - Black Oak	Interface	500	\$4.5	(\$4.2)	(\$0.7)	\$8.0	\$0.1	\$0.1	\$0.2	\$0.2	\$8.2	542	52	
5	AEP - DOM	Interface	500	\$1.4	(\$2.6)	\$0.7	\$4.7	\$0.2	(\$0.0)	\$0.1	\$0.4	\$5.1	592	4	
6	West	Interface	500	(\$0.0)	(\$0.6)	(\$0.1)	\$0.5	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$0.5	38	2	
7	5004/5005 Interface	Interface	500	(\$0.1)	(\$0.6)	(\$0.0)	\$0.5	\$0.0	\$0.0	\$0.0	\$0.0	\$0.5	29	0	
8	Wylie Ridge	Transformer	500	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.0)	(\$0.1)	(\$0.1)	0	6	
9	East	Interface	500	(\$0.0)	(\$0.1)	(\$0.0)	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	27	0	

Table 11-31 Regional constraints summary (By facility): January through March of 2015

No.	Constraint	Type	Location	Congestion Costs (Millions)										Event Hours	
				Day Ahead				Balancing				Grand Total	Day Ahead	Real Time	
				Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total				
1	5004/5005 Interface	Interface	500	(\$22.8)	(\$132.5)	(\$9.1)	\$100.6	\$7.0	\$22.4	\$1.9	(\$13.5)	\$87.1	536	318	
2	Bedington - Black Oak	Interface	500	\$34.9	(\$40.2)	(\$7.4)	\$67.7	\$2.2	\$1.8	\$3.3	\$3.7	\$71.4	1,320	255	
3	AEP - DOM	Interface	500	\$25.3	(\$26.7)	(\$1.0)	\$51.0	\$0.9	\$1.6	(\$1.9)	(\$2.6)	\$48.4	579	41	
4	AP South	Interface	500	\$29.9	(\$20.8)	(\$4.5)	\$46.2	\$0.3	\$0.2	\$0.6	\$0.7	\$46.9	547	30	
5	East	Interface	500	(\$10.0)	(\$31.2)	(\$1.9)	\$19.2	(\$0.1)	\$0.3	\$0.5	\$0.1	\$19.4	362	16	
6	Valley	Transformer	500	\$13.8	(\$0.5)	(\$0.5)	\$13.8	\$0.0	\$0.0	\$0.0	\$0.0	\$13.8	305	0	
7	Central	Interface	500	(\$15.5)	(\$32.7)	(\$3.9)	\$13.3	\$0.1	\$1.0	\$0.3	(\$0.7)	\$12.6	279	41	
8	West	Interface	500	(\$1.6)	(\$14.3)	(\$0.9)	\$11.8	\$0.2	\$1.0	\$0.1	(\$0.6)	\$11.3	236	49	
9	Nagel - Phipps Bend	Line	500	(\$0.0)	(\$0.2)	\$0.6	\$0.9	\$0.0	\$0.0	\$0.0	\$0.0	\$0.9	134	0	

## Congestion Costs by Physical and Financial Participants

In order to evaluate the recipients and payers of congestion, the MMU categorized all participants in PJM as either physical or financial. Physical entities include utilities and customers which primarily take physical positions in PJM markets. Financial entities include banks and hedge funds which primarily take financial positions in PJM markets. International market participants that primarily take financial positions in PJM markets are generally considered to be financial entities even if they are utilities in their own countries.

In the first three months of 2016, financial entities as a group were net recipients of congestion credits, and physical entities were net payers of

congestion charges. Explicit costs are the primary source of congestion credits to financial entities. UTCs are in the explicit cost category and comprise most of that category. Total explicit cost is equal to day-ahead explicit cost plus balancing explicit cost. In the first three months of 2016, the total explicit cost was -\$8.5 million (indicating net credits to participants), of which -\$13.0 million (153.0 percent) was credited to UTCs. In the first three months of 2015, the total explicit cost was -\$89.1 million, of which -\$107.9 million (121.2 percent) was credited to UTCs. In the first three months of 2016, financial entities received \$16.7 million in net congestion credits, a decrease of \$52.5 million or 75.9 percent compared to the first three months of 2015. In the first three months of 2016, physical entities paid \$308.8 million in congestion charges, a decrease of \$392.0 million or 55.9 percent compared to the first three months of 2015.

**Table 11-32 Congestion cost by type of participant: January through March of 2016**

Participant Type	Congestion Costs (Millions)									
	Day Ahead				Balancing				Inadvertent Charges	Grand Total
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total		
Financial	\$2.4	(\$0.5)	(\$0.5)	\$2.4	(\$10.6)	(\$2.5)	(\$11.0)	(\$19.1)	\$0.0	(\$16.7)
Physical	\$117.8	(\$193.0)	\$9.7	\$320.5	\$9.5	\$14.4	(\$6.7)	(\$11.7)	\$0.0	\$308.8
Total	\$120.2	(\$193.5)	\$9.2	\$322.9	(\$1.1)	\$11.9	(\$17.7)	(\$30.8)	\$0.0	\$292.2


**Table 11-33 Congestion cost by type of participant: January through March of 2015**

Participant Type	Congestion Costs (Millions)									
	Day Ahead				Balancing				Inadvertent Charges	Grand Total
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total		
Financial	\$86.6	\$45.7	(\$25.3)	\$15.7	(\$20.5)	(\$2.6)	(\$66.8)	(\$84.8)	\$0.0	(\$69.1)
Physical	\$240.4	(\$503.6)	\$14.2	\$758.3	\$26.0	\$72.2	(\$11.2)	(\$57.4)	\$0.0	\$700.8
Total	\$327.0	(\$457.9)	(\$11.0)	\$773.9	\$5.4	\$69.6	(\$78.0)	(\$142.2)	\$0.0	\$631.7

## Congestion-Event Summary before and after September 8, 2014

The day-ahead congestion event hours decreased significantly after September 8, 2014, when UTC activity declined significantly. The reduction in UTC activity was a result of FERC's UTC uplift refund notice, effective September 8, 2014.<sup>26</sup> Figure 11-5 shows the daily day-ahead and real-time congestion event hours for 2014 through March of 2016.

Figure 11-5 Daily congestion event hours: 2014 through March of 2016

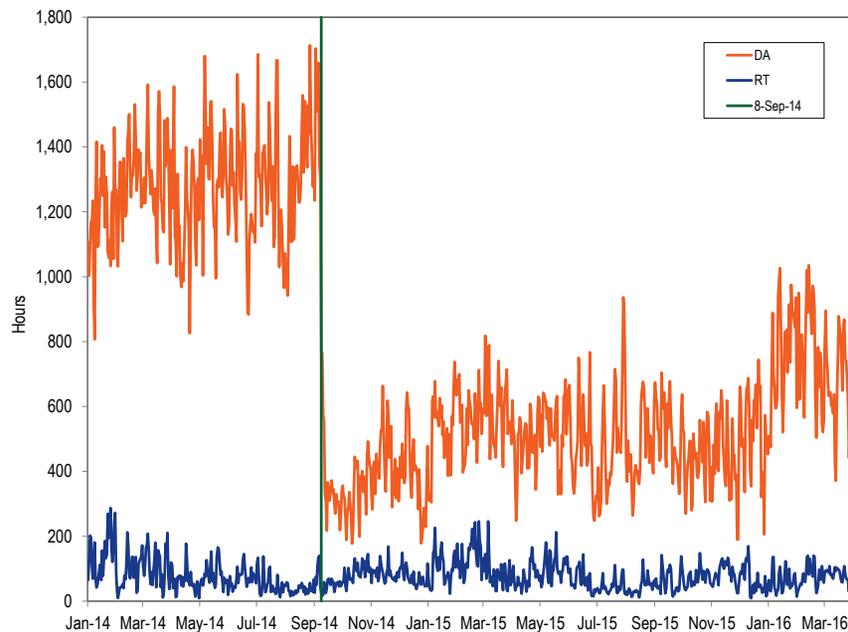

<sup>26</sup> See 18 CFR § 385.213 (2014).

## Marginal Losses

### Marginal Loss Accounting

Marginal losses occur in the Day-Ahead and Real-Time Energy Markets. The loss cost is based on the applicable day-ahead and real-time marginal loss component of LMP (MLMP). Total marginal loss costs, analogous to total congestion costs, are equal to the net of the load loss payments minus generation loss credits, plus explicit loss costs, incurred in both the Day-Ahead Energy Market and the balancing energy market.

Total marginal loss costs can be more accurately thought of as net marginal loss costs.

Total marginal loss costs equal net implicit marginal loss costs plus net explicit marginal loss costs plus net inadvertent loss charges. Net implicit marginal loss costs equal load loss payments minus generation loss credits. Net explicit marginal loss costs are the net marginal loss costs associated with point-to-point energy transactions. Net inadvertent loss charges are the losses associated with the hourly difference between the net actual energy flow and the net scheduled energy flow into or out of the PJM control area.<sup>27</sup> Unlike the other categories of marginal loss accounting, inadvertent loss charges are common costs not directly attributable to specific participants. Inadvertent loss charges are assigned to participants based on real-time load (excluding losses) ratio share.<sup>28</sup> Each of these categories of marginal loss costs is comprised of day-ahead and balancing marginal loss costs.

Marginal loss costs can be both positive and negative and consequently load payments and generation credits can also be both positive and negative. The loss component of LMP is calculated with respect to the system marginal price (SMP). An increase in generation at a bus that results in an increase in losses will cause the marginal loss component of that bus to be negative. If the increase in generation at the bus results in a decrease of system losses, then the marginal loss component is positive.

<sup>27</sup> O.A. Schedule 1 (PJM Interchange Energy Market) §3.7.

<sup>28</sup> *Id.*

Day-ahead marginal loss costs are based on day-ahead MWh priced at the marginal loss price component of LMP. Balancing marginal loss costs are based on the load or generation deviations between the Day-Ahead and Real-Time Energy Markets priced at the marginal loss price component of LMP in the Real-Time Energy Market. If a participant has real-time generation or load that is greater than its day-ahead generation or load then the deviation will be positive. If there is a positive load deviation at a bus where the real-time LMP has a positive marginal loss component, positive balancing marginal loss costs will result. Similarly, if there is a positive load deviation at a bus where real-time LMP has a negative marginal loss component, negative balancing marginal loss costs will result. If a participant has real-time generation or load that is less than its day-ahead generation or load then the deviation will be negative. If there is a negative load deviation at a bus where real-time LMP has a positive marginal loss component, negative balancing marginal loss costs will result. Similarly, if there is a negative load deviation at a bus where real-time LMP has a negative marginal loss component, positive balancing marginal loss costs will result.

The total loss surplus is the remaining loss amount from collection of marginal losses, after accounting for total energy costs and net residual market adjustments, that is allocated to PJM market participants based on real-time load plus export ratio share as marginal loss credits.<sup>29</sup>

## Marginal Loss Accounting

PJM calculates marginal loss costs for each PJM member. The loss cost is based on the applicable day-ahead and real-time marginal loss component of LMP (MLMP). Each PJM member is charged for the cost of losses on the transmission system.

Total marginal loss costs, analogous to total congestion costs, are equal to the net of the load loss payments minus generation loss credits, plus explicit loss costs, incurred in both the Day-Ahead Energy Market and the balancing energy market. Total marginal loss costs can be more accurately thought of as net marginal loss costs.

<sup>29</sup> See PJM, "Manual 28: Operating Agreement Accounting," Revision 72 (December 17, 2015), p.65.

Marginal loss costs can be both positive and negative and consequently load payments and generation credits can also be both positive and negative. The loss component of LMP is calculated with respect to the system marginal price (SMP). An increase in generation at a bus that results in an increase in losses will cause the marginal loss component of that bus to be negative. If the increase in generation at the bus results in a decrease of system losses, then the marginal loss component is positive.

- **Day-Ahead Load Loss Payments.** Day-ahead load loss payments are calculated for all cleared demand, decrement bids and day-ahead energy market sale transactions. Day-ahead, load loss payments are calculated using MW and the load bus loss MLMP, the decrement bid MLMP or the MLMP at the source of the sale transaction.
- **Day-Ahead Generation Loss Credits.** Day-ahead generation loss credits are calculated for all cleared generation and increment offers and day-ahead energy market purchase transactions. Day-ahead, generation loss credits are calculated using MW and the generator bus MLMP, the increment offer MLMP or the MLMP at the sink of the purchase transaction.
- **Balancing Load Loss Payments.** Balancing load loss payments are calculated for all deviations between a PJM member's real-time load and energy sale transactions and their day-ahead cleared demand, decrement bids and energy sale transactions. Balancing, load loss payments are calculated using MW deviations and the real-time MLMP for each bus where a deviation exists.
- **Balancing Generation Loss Credits.** Balancing generation loss credits are calculated for all deviations between a PJM member's real-time generation and energy purchase transactions and the day-ahead cleared generation, increment offers and energy purchase transactions. Balancing, generation loss credits are calculated using MW deviations and the real-time MLMP for each bus where a deviation exists.
- **Explicit Loss Costs.** Explicit loss costs are the net loss costs associated with point to point energy transactions. These costs equal the product of the transacted MW and MLMP differences between sources (origins) and sinks (destinations) in the Day-Ahead Energy Market. Balancing energy

market explicit loss costs equal the product of the differences between the real-time and day-ahead transacted MW and the differences between the real-time MLMP at the transactions' sources and sinks.

- **Inadvertent Loss Charges.** Inadvertent loss charges are the net loss charges resulting from the differences between the net actual energy flow and the net scheduled energy flow into or out of the PJM control area each hour. This inadvertent interchange of energy may be positive or negative, where positive interchange typically results in a charge while negative interchange typically results in a credit. Inadvertent loss charges are common costs, not directly attributable to specific participants, that are distributed on a load ratio basis.<sup>30</sup>

The total marginal loss cost in PJM for the first three months of 2016 was \$170.1 million, which was comprised of load loss payments of -\$8.0 million, generation loss credits of -\$184.4 million, explicit loss costs of -\$6.3 million and inadvertent loss charges of \$0.0 million. Monthly marginal loss costs in the first three months of 2016 ranged from \$40.6 million in March to \$72.0 million in January. Total marginal loss surplus decreased in the first three months of 2016 by \$94.3 million or 62.9 percent from the first three months of 2015, from \$150.0 million to \$55.7 million.

## Total Marginal Loss Costs

Table 11-34 shows the total marginal loss costs as a component of total energy related costs for the first three months of 2009 through 2016.

**Table 11-34 Total component costs (Dollars (Millions)): January through March of 2009 through 2016<sup>31</sup>**

(Jan - Mar)	Loss Costs	Percent Change	Total PJM Billing	Percent of PJM Billing
2009	\$454	NA	\$7,515	6.0%
2010	\$417	(8.2%)	\$8,415	5.0%
2011	\$410	(1.7%)	\$9,584	4.3%
2012	\$234	(42.8%)	\$6,938	3.4%
2013	\$278	18.5%	\$7,762	3.6%
2014	\$776	179.5%	\$21,070	3.7%
2015	\$425	(45.2%)	\$14,040	3.0%
2016	\$170	(60.0%)	\$9,500	1.8%

Table 11-35 shows PJM total marginal loss costs by accounting category for the first three months of 2009 through 2016. Table 11-36 shows PJM total marginal loss costs by accounting category by market for the first three months of 2009 through 2016.

**Table 11-35 Total PJM marginal loss costs by accounting category (Dollars (Millions)): January through March 2009 through 2016**

(Jan - Mar)	Marginal Loss Costs (Millions)				Total
	Load Payments	Generation Credits	Explicit Costs	Inadvertent Charges	
2009	(\$21.3)	(\$460.6)	\$14.7	\$0.0	\$454.0
2010	(\$3.8)	(\$414.1)	\$6.3	(\$0.0)	\$416.6
2011	(\$26.5)	(\$421.2)	\$14.9	\$0.0	\$409.6
2012	(\$11.2)	(\$252.1)	(\$6.6)	\$0.0	\$234.3
2013	\$8.0	(\$277.8)	(\$8.2)	(\$0.0)	\$277.6
2014	(\$15.1)	(\$813.7)	(\$22.8)	\$0.0	\$775.9
2015	(\$4.0)	(\$434.0)	(\$4.9)	\$0.0	\$425.1
2016	(\$8.0)	(\$184.4)	(\$6.3)	\$0.0	\$170.1

<sup>31</sup> The loss costs include net inadvertent charges.

<sup>30</sup> O.A. Schedule 1 (PJM Interchange Energy Market) §3.7.

Table 11-37 and Table 11-38 show the total loss costs for each transaction type in the first three months of 2016 and the first three months of 2015. In the first three months of 2016, generation paid 98.4 percent of total loss cost and the loss cost paid by generation was \$167.4 million. In the first three months of 2015, generation paid 93.0 percent of total loss cost and the loss cost paid by generation was \$395.4 million. Virtual transaction loss costs, when positive, measure the total loss cost to the virtual transaction and when negative, measure the total loss credit to the virtual transaction. In the first three months of 2016, DEC paid \$0.4 million in loss costs in the day-ahead

market, were paid \$0.7 million in congestion credits in the balancing energy market and received \$0.3 million in net payment for losses. In the first three months of 2016, INCs paid \$3.1 million in loss costs in the day-ahead market, were paid \$2.9 million in congestion credits in the balancing energy market and paid \$0.2 million in net payment for losses. In the first three months of 2016, up to congestion paid \$6.9 million in loss credits in the day-ahead market, were paid \$14.5 million in loss credits in the balancing energy market and received \$7.7 million in net payment for losses.

**Table 11-36 Total PJM marginal loss costs by accounting category by market (Dollars (Millions)): January through March 2009 through 2016**

(Jan - Mar)	Marginal Loss Costs (Millions)									
	Day-Ahead				Balancing				Inadvertent Charges	Grand Total
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total		
2009	(\$23.3)	(\$457.6)	\$30.9	\$465.2	\$2.1	(\$3.0)	(\$16.3)	(\$11.2)	\$0.0	\$454.0
2010	(\$8.5)	(\$413.5)	\$12.8	\$417.8	\$4.7	(\$0.6)	(\$6.5)	(\$1.2)	(\$0.0)	\$416.6
2011	(\$37.1)	(\$430.1)	\$26.0	\$419.1	\$10.6	\$8.9	(\$11.1)	(\$9.5)	\$0.0	\$409.6
2012	(\$16.7)	(\$256.8)	\$8.0	\$248.1	\$5.6	\$4.7	(\$14.6)	(\$13.8)	\$0.0	\$234.3
2013	(\$0.1)	(\$288.2)	\$8.1	\$296.2	\$8.1	\$10.4	(\$16.3)	(\$18.6)	(\$0.0)	\$277.6
2014	(\$48.6)	(\$847.4)	\$32.3	\$831.1	\$33.5	\$33.7	(\$55.1)	(\$55.3)	\$0.0	\$775.9
2015	(\$17.4)	(\$441.6)	\$7.8	\$432.0	\$13.5	\$7.6	(\$12.8)	(\$6.9)	\$0.0	\$425.1
2016	(\$10.7)	(\$186.3)	\$7.6	\$183.3	\$2.7	\$1.9	(\$14.0)	(\$13.2)	\$0.0	\$170.1

**Table 11-37 Total PJM loss costs by transaction type by market (Dollars (Millions)): January through March 2016**

Transaction Type	Loss Costs (Millions)									
	Day-Ahead				Balancing				Inadvertent Charges	Grand Total
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total		
DEC	\$0.4	\$0.0	\$0.0	\$0.4	(\$0.7)	\$0.0	\$0.0	(\$0.7)	\$0.0	(\$0.3)
Demand	(\$1.0)	\$0.0	\$0.0	(\$1.0)	\$2.6	\$0.0	\$0.0	\$2.6	\$0.0	\$1.6
Demand Response	(\$0.0)	\$0.0	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0
Export	(\$3.6)	\$0.0	\$0.1	(\$3.6)	(\$0.1)	\$0.0	\$0.3	\$0.2	\$0.0	(\$3.4)
Generation	\$0.0	(\$173.8)	\$0.0	\$173.8	\$0.0	\$6.5	\$0.0	(\$6.5)	\$0.0	\$167.4
Grandfathered Overuse	\$0.0	\$0.0	(\$0.2)	(\$0.2)	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$0.0	(\$0.2)
Import	\$0.0	(\$3.0)	\$0.5	\$3.6	\$0.0	(\$8.3)	\$0.3	\$8.6	\$0.0	\$12.2
INC	\$0.0	(\$3.1)	\$0.0	\$3.1	\$0.0	\$2.9	\$0.0	(\$2.9)	\$0.0	\$0.2
Internal Bilateral	(\$6.4)	(\$6.3)	\$0.0	(\$0.0)	\$0.8	\$0.8	\$0.0	(\$0.0)	\$0.0	(\$0.0)
Up to Congestion	\$0.0	\$0.0	\$6.9	\$6.9	\$0.0	\$0.0	(\$14.5)	(\$14.5)	\$0.0	(\$7.7)
Wheel In	\$0.0	\$0.0	\$0.3	\$0.3	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.4
Total	(\$10.7)	(\$186.3)	\$7.6	\$183.3	\$2.7	\$1.9	(\$14.0)	(\$13.2)	\$0.0	\$170.1

Table 11-38 Total PJM loss costs by transaction type by market (Dollars (Millions)): January through March 2015

Transaction Type	Day-Ahead				Loss Costs (Millions)				Inadvertent Charges	Grand Total
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total		
DEC	\$0.1	\$0.0	\$0.0	\$0.1	(\$3.0)	\$0.0	\$0.0	(\$3.0)	\$0.0	(\$3.0)
Demand	(\$3.9)	\$0.0	\$0.0	(\$3.9)	\$13.1	\$0.0	\$0.0	\$13.1	\$0.0	\$9.1
Demand Response	(\$0.0)	\$0.0	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0
Export	(\$4.5)	\$0.0	\$0.2	(\$4.4)	(\$0.3)	\$0.0	\$0.7	\$0.4	\$0.0	(\$3.9)
Generation	\$0.0	(\$421.1)	\$0.0	\$421.1	\$0.0	\$25.7	\$0.0	(\$25.7)	\$0.0	\$395.4
Grandfathered Overuse	\$0.0	\$0.0	(\$0.7)	(\$0.7)	\$0.0	\$0.0	\$0.1	\$0.1	\$0.0	(\$0.6)
Import	\$0.0	(\$7.7)	\$1.7	\$9.4	\$0.0	(\$26.7)	\$0.8	\$27.5	\$0.0	\$37.0
INC	\$0.0	(\$3.8)	\$0.0	\$3.8	\$0.0	\$5.0	\$0.0	(\$5.0)	\$0.0	(\$1.2)
Internal Bilateral	(\$9.0)	(\$9.0)	\$0.0	(\$0.0)	\$3.7	\$3.7	\$0.0	(\$0.0)	\$0.0	(\$0.0)
Up to Congestion	\$0.0	\$0.0	\$5.9	\$5.9	\$0.0	\$0.0	(\$14.3)	(\$14.3)	\$0.0	(\$8.4)
Wheel In	\$0.0	\$0.0	\$0.7	\$0.7	\$0.0	\$0.0	(\$0.1)	(\$0.1)	\$0.0	\$0.6
<b>Total</b>	<b>(\$17.4)</b>	<b>(\$441.6)</b>	<b>\$7.8</b>	<b>\$432.0</b>	<b>\$13.5</b>	<b>\$7.6</b>	<b>(\$12.8)</b>	<b>(\$6.9)</b>	<b>\$0.0</b>	<b>\$425.1</b>

### Monthly Marginal Loss Costs

Table 11-39 shows a monthly summary of marginal loss costs by market type for the first three months of 2015 and the first three months of 2016.

Table 11-39 Monthly marginal loss costs by market (Millions): January through March of 2015 and 2016

	Marginal Loss Costs (Millions)							
	2015				2016			
	Day-Ahead Total	Balancing Total	Inadvertent Charges	Grand Total	Day-Ahead Total	Balancing Total	Inadvertent Charges	Grand Total
Jan	\$115.9	(\$4.2)	\$0.0	\$111.7	\$78.2	(\$6.2)	\$0.0	\$72.0
Feb	\$218.2	\$2.0	\$0.0	\$220.3	\$61.3	(\$3.8)	\$0.0	\$57.5
Mar	\$97.9	(\$4.7)	(\$0.0)	\$93.2	\$43.8	(\$3.2)	(\$0.0)	\$40.6
<b>Total</b>	<b>\$432.0</b>	<b>(\$6.9)</b>	<b>\$0.0</b>	<b>\$425.1</b>	<b>\$183.3</b>	<b>(\$13.2)</b>	<b>\$0.0</b>	<b>\$170.1</b>

Figure 11-6 shows PJM monthly marginal loss costs for 2009 through March of 2016.

Figure 11-6 PJM monthly marginal loss costs (Dollars (Millions)): 2009 through March of 2016

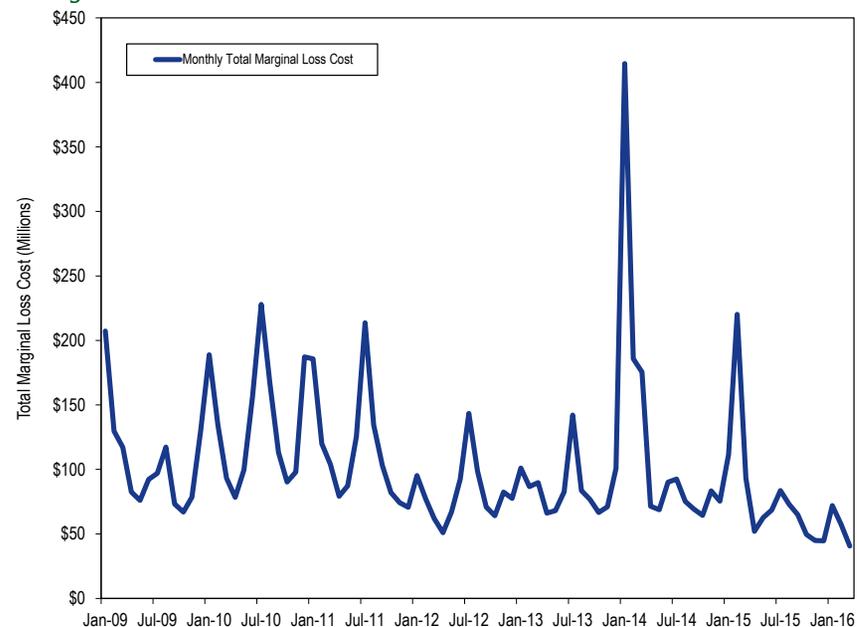


Table 11-40 and Table 11-41 show the monthly total loss costs for each virtual transaction type in the first three months of 2015 and the first three months of 2016. Virtual transaction loss costs, when positive, measure the total loss cost to the virtual transaction and when negative, measure the total loss credit to the virtual transaction. In the first three months of 2016, DECs paid \$0.4 million in loss costs in the day-ahead market, were paid \$0.7 million in congestion credits in the balancing energy market and received \$0.3 million in net payment for loss. In the first three months of 2016, INCs paid \$3.1 million in loss costs in the day-ahead market, were paid \$2.9 million in congestion credits in the balancing energy market and paid \$0.2 million in net payment for loss. In the first three months of 2016, up to congestion paid \$6.9 million in loss credits in the day-ahead market, were paid \$14.5 million in loss credits in the balancing energy market and received \$7.7 million in net payment for loss.

**Table 11-40 Monthly PJM loss costs by virtual transaction type and by market (Dollars (Millions)): January through March 2016**

	Loss Costs (Millions)								
	Day-Ahead				Balancing				Virtual Grand Total
	DEC	INC	Up to Congestion	Virtual Total	DEC	INC	Up to Congestion	Virtual Total	
Jan	\$0.3	\$1.2	\$3.7	\$5.1	(\$0.6)	(\$1.1)	(\$6.8)	(\$8.5)	(\$3.3)
Feb	\$0.1	\$0.8	\$1.9	\$2.8	(\$0.0)	(\$0.8)	(\$4.3)	(\$5.2)	(\$2.4)
Mar	\$0.0	\$1.1	\$1.3	\$2.4	(\$0.1)	(\$0.9)	(\$3.4)	(\$4.5)	(\$2.0)
Total	\$0.4	\$3.1	\$6.9	\$10.3	(\$0.7)	(\$2.9)	(\$14.5)	(\$18.1)	(\$7.8)

**Table 11-41 Monthly PJM loss costs by virtual transaction type and by market (Dollars (Millions)): January through March 2015**

	Loss Costs (Millions)								
	Day-Ahead				Balancing				Virtual Grand Total
	DEC	INC	Up to Congestion	Virtual Total	DEC	INC	Up to Congestion	Virtual Total	
Jan	\$0.2	\$0.8	\$2.9	\$3.8	(\$1.1)	(\$0.7)	(\$4.9)	(\$6.7)	(\$2.9)
Feb	(\$0.6)	\$1.8	(\$0.4)	\$0.7	(\$0.8)	(\$2.0)	(\$3.4)	(\$6.2)	(\$5.5)
Mar	\$0.5	\$1.3	\$3.5	\$5.2	(\$1.1)	(\$2.3)	(\$6.0)	(\$9.4)	(\$4.2)
Total	\$0.1	\$3.8	\$5.9	\$9.8	(\$3.0)	(\$5.0)	(\$14.3)	(\$22.3)	(\$12.5)

## Marginal Loss Costs and Loss Credits

Total loss surplus are calculated by adding the total energy costs, the total marginal loss costs and net residual market adjustments. The total energy costs are equal to the net implicit energy costs (load energy payments minus generation energy credits) plus net explicit energy costs plus net inadvertent energy charges. Total marginal loss costs are equal to the net implicit marginal loss costs (generation loss credits less load loss payments) plus net explicit loss costs plus net inadvertent loss charges.

Ignoring interchange, total generation MWh must be greater than total load MWh in any hour in order to provide for losses. Since the hourly integrated energy component of LMP is the same for every bus within every hour, the net energy bill is negative (ignoring net interchange), with more generation credits than load payments in every hour. Total energy costs plus total marginal loss costs plus net residual market adjustments equal marginal loss credits which are distributed to load and exports as marginal loss credits. The net residual market adjustment is calculated as known day-ahead error value minus day-ahead loss MW congestion value and minus balancing loss MW congestion value.

Table 11-42 shows the total energy costs, the total marginal loss costs collected, the net residual market adjustments and total marginal loss credits redistributed for the first three months of 2009 through 2016. The total marginal loss surplus decreased \$94.3 million in the first three months of 2016 from the first three months of 2015.

**Table 11-42 Marginal loss credits (Dollars (Millions)): January through March 2009 through 2016<sup>32</sup>**

Loss Credit Accounting (Millions)						
Net Residual Market Adjustment						
(Jan - Mar)	Total Energy Charges	Total Marginal Loss Charges	Known Day-ahead Error	Day-ahead Loss MW Congestion	Balancing Loss MW Congestion	Total Loss Surplus
2009	(\$218.3)	\$454.0	\$0.0	(\$0.9)	(\$0.0)	\$236.6
2010	(\$207.6)	\$416.6	\$0.0	\$0.0	(\$0.0)	\$208.9
2011	(\$209.9)	\$409.6	(\$0.0)	(\$0.5)	\$0.0	\$200.1
2012	(\$136.4)	\$234.3	\$0.1	\$0.3	\$0.0	\$97.7
2013	(\$177.9)	\$277.6	\$0.1	\$0.3	(\$0.0)	\$99.4
2014	(\$515.3)	\$775.9	\$0.0	\$3.1	\$0.2	\$257.2
2015	(\$271.7)	\$425.1	(\$0.5)	\$2.9	(\$0.0)	\$150.0
2016	(\$113.6)	\$170.1	\$0.0	\$0.8	(\$0.0)	\$55.7

## Energy Costs

### Energy Accounting

The energy component of LMP is the system reference bus LMP, also called the system marginal price (SMP). The energy cost is based on the day-ahead and real-time energy components of LMP. Total energy costs, analogous to total congestion costs or total loss costs, are equal to the load energy payments minus generation energy credits, plus explicit energy costs, incurred in both the Day-Ahead Energy Market and the balancing energy market, plus net inadvertent energy charges. Total energy costs can be more accurately thought of as net energy costs.

### Total Energy Costs

The total energy cost for the first three months of 2016 was -\$113.6 million, which was comprised of load energy payments of \$7,764.7 million, generation energy credits of \$7,879.3 million, explicit energy costs of \$0.0 million and inadvertent energy charges of \$1.0 million. The monthly energy costs for the first three months of 2016 ranged from -\$47.7 million in January to -\$27.4 million in March.

<sup>32</sup> The net residual market adjustments included in the table are comprised of the known day-ahead error value minus the sum of the day-ahead loss MW congestion value, balancing loss MW congestion value and measurement error caused by missing data.

Table 11-43 shows total energy component costs and total PJM billing, for the first three months of 2009 through 2016. The total energy component costs are net energy costs.

**Table 11-43 Total PJM costs by energy component (Dollars (Millions)): January through March 2009 through 2016<sup>33</sup>**

(Jan - Mar)	Energy Costs	Percent Change	Total PJM Billing	Percent of PJM Billing
2009	(\$218)	NA	\$7,515	(2.9%)
2010	(\$208)	(4.9%)	\$8,415	(2.5%)
2011	(\$210)	1.1%	\$9,584	(2.2%)
2012	(\$136)	(35.0%)	\$6,938	(2.0%)
2013	(\$178)	30.4%	\$7,762	(2.3%)
2014	(\$515)	189.7%	\$21,070	(2.4%)
2015	(\$272)	(47.3%)	\$14,040	(1.9%)
2016	(\$114)	(58.2%)	\$9,500	(1.2%)

Energy costs for the first three months of 2009 through 2016 are shown in Table 11-44 and Table 11-45. Table 11-44 shows PJM energy costs by accounting category for the first three months of 2009 through 2016 and Table 11-45 shows PJM energy costs by market category for the first three months of 2009 through 2016.

**Table 11-44 Total PJM energy costs by accounting category (Dollars (Millions)): January through March 2009 through 2016**

(Jan - Mar)	Energy Costs (Millions)				Total
	Load Payments	Generation Credits	Explicit Costs	Inadvertent Charges	
2009	\$14,058.4	\$14,277.4	\$0.0	\$0.7	(\$218.3)
2010	\$13,424.4	\$13,629.0	\$0.0	(\$3.0)	(\$207.6)
2011	\$11,943.9	\$12,160.7	\$0.0	\$6.9	(\$209.9)
2012	\$8,485.4	\$8,628.7	\$0.0	\$6.8	(\$136.4)
2013	\$10,357.2	\$10,535.1	\$0.0	(\$0.0)	(\$177.9)
2014	\$28,506.2	\$29,014.7	\$0.0	(\$6.9)	(\$515.3)
2015	\$15,702.1	\$15,976.4	\$0.0	\$2.6	(\$271.7)
2016	\$7,764.7	\$7,879.3	\$0.0	\$1.0	(\$113.6)

<sup>33</sup> The energy costs include net inadvertent charges.

Table 11-45 Total PJM energy costs by market category (Dollars (Millions)): January through March 2009 through 2016

(Jan - Mar)	Energy Costs (Millions)									
	Day-Ahead				Balancing				Inadvertent	
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total	Charges	Grand Total
2009	\$14,129.6	\$14,375.6	\$0.0	(\$246.0)	(\$71.2)	(\$98.2)	\$0.0	\$27.0	\$0.7	(\$218.3)
2010	\$13,408.9	\$13,619.2	\$0.0	(\$210.2)	\$15.5	\$9.8	\$0.0	\$5.6	(\$3.0)	(\$207.6)
2011	\$12,055.5	\$12,259.3	\$0.0	(\$203.9)	(\$111.6)	(\$98.6)	\$0.0	(\$12.9)	\$6.9	(\$209.9)
2012	\$8,534.4	\$8,649.0	\$0.0	(\$114.6)	(\$49.0)	(\$20.4)	\$0.0	(\$28.6)	\$6.8	(\$136.4)
2013	\$10,387.2	\$10,580.9	\$0.0	(\$193.7)	(\$29.9)	(\$45.8)	\$0.0	\$15.9	(\$0.0)	(\$177.9)
2014	\$28,412.1	\$29,082.9	\$0.0	(\$670.9)	\$94.2	(\$68.3)	\$0.0	\$162.4	(\$6.9)	(\$515.3)
2015	\$15,764.8	\$16,077.5	\$0.0	(\$312.6)	(\$62.7)	(\$101.1)	\$0.0	\$38.4	\$2.6	(\$271.7)
2016	\$7,847.5	\$7,997.9	\$0.0	(\$150.4)	(\$82.8)	(\$118.6)	\$0.0	\$35.8	\$1.0	(\$113.6)

Table 11-46 and Table 11-47 show the total energy costs for each virtual transaction type in the first three months of 2016 and the first three months of 2015. In the first three months of 2016, generation were paid \$5,383.3 million and demand paid \$5,441.3 million in net energy payment. In the first three months of 2015, generation were paid \$10,882.7 million and demand paid \$10,979.9 million in net energy payment.

Table 11-46 Total PJM energy costs by transaction type by market (Dollars (Millions)): January through March 2016

Transaction Type	Energy Costs (Millions)								
	Day-Ahead				Balancing				Grand Total
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total	
DEC	\$256.1	\$0.0	\$0.0	\$256.1	(\$246.1)	\$0.0	\$0.0	(\$246.1)	\$10.0
Demand	\$5,436.9	\$0.0	\$0.0	\$5,436.9	\$4.4	\$0.0	\$0.0	\$4.4	\$5,441.3
Demand Response	(\$0.2)	\$0.0	\$0.0	(\$0.2)	\$0.2	\$0.0	\$0.0	\$0.2	(\$0.0)
Export	\$114.9	\$0.0	\$0.0	\$114.9	\$31.6	\$0.0	\$0.0	\$31.6	\$146.4
Generation	\$0.0	\$5,559.1	\$0.0	(\$5,559.1)	\$0.0	(\$175.8)	\$0.0	\$175.8	(\$5,383.3)
Import	\$0.0	\$102.0	\$0.0	(\$102.0)	\$0.0	\$213.5	\$0.0	(\$213.5)	(\$315.5)
INC	\$0.0	\$296.9	\$0.0	(\$296.9)	\$0.0	(\$283.4)	\$0.0	\$283.4	(\$13.5)
Internal Bilateral	\$2,039.9	\$2,039.9	\$0.0	\$0.0	\$127.1	\$127.1	\$0.0	(\$0.0)	(\$0.0)
Total	\$7,847.5	\$7,997.9	\$0.0	(\$150.4)	(\$82.8)	(\$118.6)	\$0.0	\$35.8	(\$114.6)

**Table 11-47 Total PJM energy costs by transaction type by market (Dollars (Millions)): January through March 2015**

Transaction Type	Day-Ahead				Balancing				Grand Total
	Load Payments	Generation Credits	Explicit Costs	Total	Load Payments	Generation Credits	Explicit Costs	Total	
DEC	\$502.5	\$0.0	\$0.0	\$502.5	(\$506.0)	\$0.0	\$0.0	(\$506.0)	(\$3.4)
Demand	\$10,838.6	\$0.0	\$0.0	\$10,838.6	\$141.3	\$0.0	\$0.0	\$141.3	\$10,979.9
Demand Response	(\$0.8)	\$0.0	\$0.0	(\$0.8)	\$0.8	\$0.0	\$0.0	\$0.8	(\$0.0)
Export	\$322.5	\$0.0	\$0.0	\$322.5	\$65.9	\$0.0	\$0.0	\$65.9	\$388.4
Generation	\$0.0	\$11,284.8	\$0.0	(\$11,284.8)	\$0.0	(\$402.1)	\$0.0	\$402.1	(\$10,882.7)
Import	\$0.0	\$184.3	\$0.0	(\$184.3)	\$0.0	\$558.5	\$0.0	(\$558.5)	(\$742.8)
INC	\$0.0	\$506.4	\$0.0	(\$506.4)	\$0.0	(\$492.8)	\$0.0	\$492.8	(\$13.5)
Internal Bilateral	\$4,102.0	\$4,102.0	\$0.0	(\$0.0)	\$235.3	\$235.3	\$0.0	(\$0.0)	(\$0.0)
Total	\$15,764.8	\$16,077.5	\$0.0	(\$312.6)	(\$62.7)	(\$101.1)	\$0.0	\$38.4	(\$274.2)

## Monthly Energy Costs

Table 11-48 shows a monthly summary of energy costs by market type for the first three months of 2015 and the first three months of 2016. Marginal total energy costs in the first three months of 2016 decreased from the first three months of 2015. Monthly total energy costs in the first three months of 2016 ranged from -\$47.7 million in January to -\$27.4 million in March.

**Table 11-48 Monthly energy costs by market type (Dollars (Millions)): January through March 2015 and 2016**

	Energy Costs (Millions)							
	2015				2016			
	Day-Ahead Total	Balancing Total	Inadvertent Charges	Grand Total	Day-Ahead Total	Balancing Total	Inadvertent Charges	Grand Total
Jan	(\$84.6)	\$13.3	\$0.9	(\$70.5)	(\$63.8)	\$15.4	\$0.6	(\$47.7)
Feb	(\$150.5)	\$6.2	\$2.8	(\$141.5)	(\$50.0)	\$11.1	\$0.4	(\$38.5)
Mar	(\$77.6)	\$19.0	(\$1.0)	(\$59.6)	(\$36.6)	\$9.3	(\$0.1)	(\$27.4)
Total	(\$312.6)	\$38.4	\$2.6	(\$271.7)	(\$150.4)	\$35.8	\$1.0	(\$113.6)

Figure 11-7 shows PJM monthly energy costs for 2009 through March of 2016.

**Figure 11-7 PJM monthly energy costs (Millions): 2009 through March of 2016**

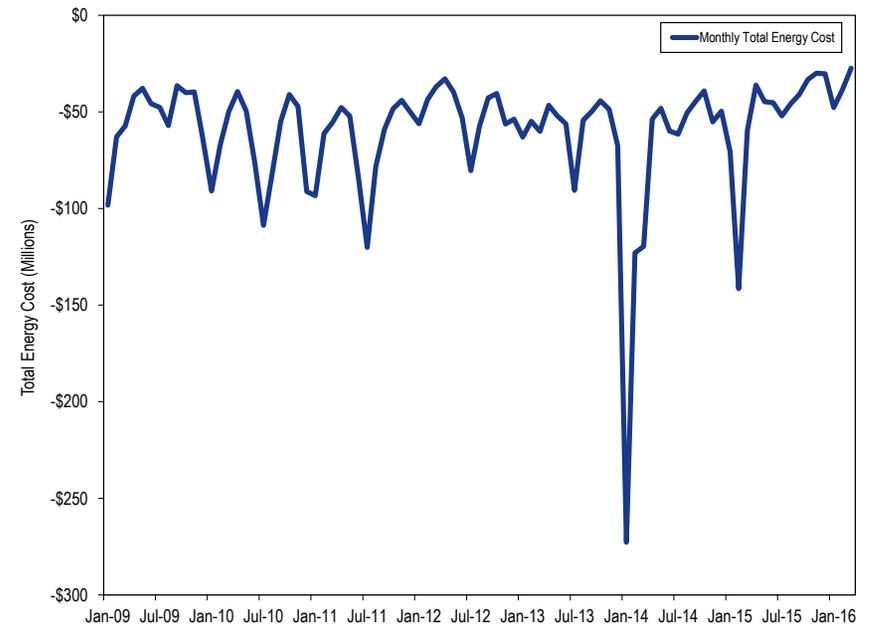


Table 11-49 and Table 11-50 show the monthly total energy costs for each virtual transaction type in the first three months of 2016 and the first three months of 2015. In the first three months of 2016, DECs paid \$256.1 million in energy costs in the day-ahead market, were paid \$246.1 million in energy credits in the balancing energy market and paid \$10.0 million in net payment for energy. In the first three months of 2016, INCs were paid \$296.9 million in energy credits in the day-ahead market, paid \$283.4 million in energy cost in the balancing market and received \$13.5 million in net payment for energy. In the first three months of 2015, DECs paid \$502.5 million in energy costs in the day-ahead market, were paid \$506.0 million in energy credits in the balancing energy market and were paid \$3.4 million in net payment for energy. In the first three months of 2015, INCs were paid \$506.4 million in energy credits in the day-ahead market, paid \$492.8 million in energy cost in the balancing energy market and received \$13.5 million in net payment for energy.

**Table 11-49 Monthly PJM energy costs by virtual transaction type and by market (Dollars (Millions)): January through March 2016**

	Energy Costs (Millions)						Virtual Grand Total
	Day-Ahead			Balancing			
	DEC	INC	Virtual Total	DEC	INC	Virtual Total	
Jan	\$102.0	(\$109.3)	(\$7.2)	(\$101.0)	\$106.1	\$5.1	(\$2.1)
Feb	\$85.5	(\$87.5)	(\$2.1)	(\$81.3)	\$84.3	\$3.0	\$1.0
Mar	\$68.6	(\$100.2)	(\$31.6)	(\$63.8)	\$93.0	\$29.2	(\$2.4)
Total	\$256.1	(\$296.9)	(\$40.9)	(\$246.1)	\$283.4	\$37.3	(\$3.6)

**Table 11-50 Monthly PJM energy costs by virtual transaction type and by market (Dollars (Millions)): January through March 2015**

	Energy Costs (Millions)						Virtual Grand Total
	Day-Ahead			Balancing			
	DEC	INC	Virtual Total	DEC	INC	Virtual Total	
Jan	\$152.0	(\$122.5)	\$29.5	(\$152.0)	\$120.6	(\$31.3)	(\$1.8)
Feb	\$224.2	(\$243.8)	(\$19.5)	(\$217.0)	\$223.6	\$6.6	(\$13.0)
Mar	\$126.3	(\$140.1)	(\$13.8)	(\$137.0)	\$148.6	\$11.6	(\$2.2)
Total	\$502.5	(\$506.4)	(\$3.8)	(\$506.0)	\$492.8	(\$13.1)	(\$17.0)

## Generation and Transmission Planning

### Overview

#### Planned Generation and Retirements

- **Planned Generation.** As of March 31, 2016, 81,936.3 MW of capacity were in generation request queues for construction through 2024, compared to an average installed capacity of 187,281.3 MW as of March 31, 2016. Of the capacity in queues, 5,999.7 MW, or 7.3 percent, are uprates and the rest are new generation. Wind projects account for 15,686.2 MW of nameplate capacity or 19.1 percent of the capacity in the queues. Combined cycle projects account for 53,202.8 MW of capacity or 64.9 percent of the capacity in the queues.
- **Generation Retirements.** As shown in Table 12-6, 26,486.5 MW have been, or are planned to be, retired between 2011 and 2020. Of that, 2,997.3 MW are planned to retire after 2016. In the first three months of 2016, 53 MW were retired. Of the 2,656.8 MW pending retirement, 1,263 MW are coal units. The coal unit retirements were a result of low gas prices, and the EPA's Mercury and Air Toxics Standards (MATS) for some units.
- **Generation Mix.** A significant shift in the distribution of unit types within the PJM footprint continues as natural gas fired units enter the queue and steam units retire. There are 1,957.0 MW of coal fired steam capacity and 56,645.1 MW of gas fired capacity in the queue. The replacement of coal steam units by units burning natural gas could significantly affect future congestion, the role of firm and interruptible gas supply, and natural gas supply infrastructure.

#### Generation and Transmission Interconnection Planning Process

- Any entity that requests interconnection of a new generating facility, including increases to the capacity of an existing generating unit, or that requests interconnection of a merchant transmission facility, must follow the process defined in the PJM tariff to obtain interconnection

service.<sup>1</sup> The process is complex and time consuming at least in part as a result of the required analyses. The cost, time and uncertainty associated with interconnecting to the grid may create barriers to entry for potential entrants.

- The queue contains a substantial number of projects that are not likely to be built. Excluding currently active projects and projects currently under construction, 2,329 projects, representing 334,777.6 MW, have completed the queue process since its inception. Of those, 621 projects, 43,797.8 MW, went into service. Of the projects that entered the queue process, 86.9 percent of the MW withdrew prior to completion. Such projects may create barriers to entry for projects that would otherwise be completed by taking up queue positions, increasing interconnection costs and creating uncertainty.
- Feasibility, impact and facilities studies may be delayed for reasons including disputes with developers, circuit and network issues and retooling as a result of projects being withdrawn. The Earlier Queue Submittal Task Force (EQSTF) was established in August 2015 to address delays.<sup>2</sup>
- As defined in the tariff, a transmission owner (TO) is an “entity that owns, leases or otherwise has a possessory interest in facilities used for the transmission of electric energy in interstate commerce under the tariff.”<sup>3</sup> Where the transmission owner is a vertically integrated company that also owns generation, there is a potential conflict of interest when the transmission owner evaluates the interconnection requirements of new generation which is a competitor to the generation of the parent company and when the transmission owner evaluates the interconnection requirements of new generation which is part of the same company as the transmission owner. There is also a potential conflict of interest when the transmission owner evaluates the interconnection requirements of a merchant transmission developer which is a competitor of the transmission owner.

<sup>1</sup> See PJM, OATT Parts IV & VI.

<sup>2</sup> See Earlier Queue Submittal Task Force at <<http://www.pjm.com/committees-and-groups/task-forces/eqstf.aspx>>

<sup>3</sup> See PJM, OATT, Part I, S 1 “Definitions.”

## Regional Transmission Expansion Plan (RTEP)

- Artificial Island is an area in southern New Jersey that includes nuclear units at Salem and at Hope Creek in the PSEG Zone. On April 29, 2013, PJM issued a request for proposal (RFP), seeking technical solutions to improve stability issues and operational performance under a range of anticipated system conditions, and the elimination of potential planning criteria violations in this area. On July 30, 2015, the PJM Board of Managers accepted PJM's recommendation to assign the project to LS Power, a merchant developer, PSEG, and PHI with a total cost estimate between \$263M and \$283M.<sup>4 5</sup>
- On October 25, 2012, Schedule 12 of the tariff and Schedule 6 of the OA were changed to address FERC Order No. 1000 reforms to the cost allocation requirements for local and regional transmission planning projects that were formerly defined in Order No. 890. The new approach was applied for the first time to the 2013 RTEP.

## Backbone Facilities

- PJM baseline transmission projects are implemented to resolve reliability criteria violations. PJM backbone transmission projects are a subset of significant baseline projects, which are intended to resolve multiple reliability criteria violations and congestion issues and which may have substantial impacts on energy and capacity markets. There is currently only one backbone project under development, Surry Skiffes Creek 500kV.

## Transmission Facility Outages

- PJM maintains a list of reportable transmission facilities. When the reportable transmission facilities need to be taken out of service, PJM transmission owners are required to report planned transmission facility outages as early as possible. PJM processes the transmission facility outage requests according to rules in PJM's Manual 3 to decide if the

outage is on time, late, or past its deadline and whether or not they will allow the outage.<sup>6</sup>

- There were 4,052 transmission outage requests submitted for the first three months of 2016. Of the requested outages, 85.6 percent were planned for five days or shorter and 1.6 percent were planned for longer than 30 days. Of the requested outages, 53.6 percent were late according to the rules in PJM's Manual 3.

## Recommendations

The MMU recommends improvements to the planning process.

- The MMU recommends that PJM continue to incorporate the principle that the goal of transmission planning should be the incorporation of transmission investment decisions into market driven processes as much as possible. (Priority: Low. First reported 2001. Status: Not adopted.)
- The MMU recommends the creation of a mechanism to permit a direct comparison, or competition, between transmission and generation alternatives, including which alternative is less costly and who bears the risks associated with each alternative. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that rules be implemented to permit competition to provide financing for transmission projects. This competition could reduce the cost of capital for transmission projects and significantly reduce total costs to customers. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that rules be implemented to require that project cost caps on new transmission projects be part of the evaluation of competing projects. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that barriers to entry be addressed in a timely manner in order to help ensure that the capacity market will result in the entry of new capacity to meet the needs of PJM market participants and reflect the uncertainty and resultant risks in the cost of new entry used to

<sup>4</sup> See "Artificial Island Recommendations," presented at the TEAC meeting on April 28, 2015 at <<http://www.pjm.com/~media/committees-groups/committees/teac/20150428-ai/20150428-artificial-island-recommendations.ashx>>.

<sup>5</sup> See letter from Terry Boston concerning the Artificial Island Project at <<http://www.pjm.com/~media/documents/reports/board-statement-on-artificial-island-project.ashx>>.

<sup>6</sup> PJM. "Manual 03: Transmission Operations," Revision 46 (December 1, 2014), Section 4.

establish the capacity market demand curve in RPM. (Priority: Low. First reported 2012. Status: Not adopted.)

- The MMU recommends that the question of whether Capacity Injection Rights (CIRs) should persist after the retirement of a unit be addressed. Even if the treatment of CIRs remains unchanged, the rules need to ensure that incumbents cannot exploit control of CIRs to block or postpone entry of competitors.<sup>7</sup> (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends outsourcing interconnection studies to an independent party to avoid potential conflicts of interest. Currently, these studies are performed by incumbent transmission owners under PJM's direction. This creates potential conflicts of interest, particularly when transmission owners are vertically integrated and the owner of transmission also owns generation. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends improvements in queue management including that PJM establish a review process to ensure that projects are removed from the queue if they are not viable, as well as a process to allow commercially viable projects to advance in the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming. (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends an analysis of the study phase of PJM's transmission planning to reduce the need for postponements of study results, to decrease study completion times, and to improve the likelihood that a project at a given phase in the study process will successfully go into service. (Priority: Medium. First reported 2014. Status: Partially adopted.)
- The MMU recommends that PJM establish fair terms of access to rights of way and property, such as at substations, in order to remove any barriers to entry and permit competition between incumbent transmission providers and merchant transmission providers in the RTEP. (Priority: Medium. First reported 2014. Status: Not adopted.)

- The MMU recommends that PJM enhance the transparency and queue management process for merchant transmission investment. Issues related to data access and complete explanations of cost impacts should be addressed. The goal should be to remove barriers to competition from merchant transmission. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends consideration of changing the minimum distribution factor in the method of allocating costs for baseline projects from .01 to .00 and adding a threshold minimum usage impact on the line. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM reevaluate all transmission outage tickets as on time or late as if they were new requests when an outage is rescheduled and apply the standard rules for late submissions to any such outages. (Priority: Low. First reported 2014. Status: Not adopted.)
- The MMU recommends that PJM draft a clear definition of the congestion analysis required for transmission outage requests to include in Manual 3 after appropriate review. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM modify the rules to reduce or eliminate the approval of late outage requests submitted or rescheduled after the FTR auction bidding opening date. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM not permit transmission owners to divide long duration outages into smaller segments to avoid complying with the requirements for long duration outages. (Priority: Low. First reported 2015. Status: Not adopted.)

## Conclusion

The goal of PJM market design should be to enhance competition and to ensure that competition is the driver for all the key elements of PJM markets. But transmission investments have not been fully incorporated into competitive markets. The construction of new transmission facilities has significant impacts on the energy and capacity markets. But when generating units retire

<sup>7</sup> See "Comments of the Independent Market Monitor for PJM," Docket No. ER12-1177-000, <[http://www.monitoringanalytics.com/reports/Reports/2012/IMM\\_Comments\\_ER12-1177-000\\_20120312.pdf](http://www.monitoringanalytics.com/reports/Reports/2012/IMM_Comments_ER12-1177-000_20120312.pdf)>.

or load increases, there is no market mechanism in place that would require direct competition between transmission and generation to meet loads in the affected area. In addition, despite FERC Order No. 1000, there is not yet a transparent, robust and clearly defined mechanism to permit competition to build transmission projects, to ensure that competitors provide a total project cost cap, or to obtain least cost financing through the capital markets.

The addition of a planned transmission project changes the parameters of the capacity auction for the area, changes the amount of capacity needed in the area, changes the capacity market supply and demand fundamentals in the area and may effectively forestall the ability of generation to compete. But there is no mechanism to permit a direct comparison, let alone competition, between transmission and generation alternatives. There is no mechanism to evaluate whether the generation or transmission alternative is less costly, whether there is more risk associated with the generation or transmission alternatives, or who bears the risks associated with each alternative. Creating such a mechanism should be an explicit goal of PJM market design.

The PJM queue evaluation process should be improved to ensure that barriers to competition for new generation investments are not created. Issues that need to be addressed include the ownership rights to CIRs, whether transmission owners should perform interconnection studies, and improvements in queue management.

The PJM rules for competitive transmission development through the RTEP should build upon FERC Order No. 1000 to create real competition between incumbent transmission providers and merchant transmission providers. PJM should enhance the transparency and queue management process for merchant transmission investment. Issues related to data access and complete explanations of cost impacts should be addressed. The goal should be to remove barriers to competition from merchant transmission. Another element of opening competition would be to consider transmission owners' ownership of property and rights of way at or around transmission substations. In many cases, the land acquired included property intended to support future expansion of the grid. Incumbents have included the costs of the property

in their rate base. Because PJM now has the responsibility for planning the development of the grid under its RTEP process, property bought to facilitate future expansion should be a part of the RTEP process and be made available to all providers on equal terms.

There are currently no market incentives for transmission owners to submit and complete transmission outages in a timely and efficient manner. Requiring transmission owners to pay does not create an effective incentive when those payments are passed through to transmission customers. The process for the submission of planned transmission outages needs to be carefully reviewed and redesigned to limit the ability of transmission owners to submit transmission outages that are late for FTR Auction bid submission dates and are late for the Day-Ahead Energy Market. The submission of late transmission outages can inappropriately affect market outcomes when market participants do not have the ability to modify market bids and offers.

## Planned Generation and Retirements

### Planned Generation Additions

Expected net revenues provide incentives to build new generation to serve PJM markets. The amount of planned new generation in PJM reflects investors' perception of the incentives provided by the combination of revenues from the PJM energy, capacity and ancillary service markets. On March 31, 2016, 81,936.3 MW of capacity were in generation request queues for construction through 2024, compared to an average installed capacity of 187,281.3 MW as of March 31, 2016. Although it is clear that not all generation in the queues will be built, PJM has added capacity annually since 2000 (Table 12-1). In the first three months of 2016, 2,763.0 MW of nameplate capacity went into service in PJM.

**Table 12-1 Year-to-year capacity additions from PJM generation queue: Calendar years 2000 through March 31, 2016**

Year	MW
2000	505.0
2001	872.0
2002	3,841.0
2003	3,524.0
2004	1,935.0
2005	819.0
2006	471.0
2007	1,265.0
2008	2,776.7
2009	2,515.9
2010	2,097.4
2011	5,007.8
2012	2,669.4
2013	1,126.8
2014	2,659.0
2015	3,808.4
2016	2,763.0

## PJM Generation Queues

Generation request queues are groups of proposed projects, including new units, reratings of existing units, capacity resources and energy only resources. Each queue is open for a fixed amount of time. Studies commence on all projects in a given queue when that queue closes. The duration of the queue period has varied. Queues A and B were open for a year. Queues C-T were open for six months. Starting in February 2008, Queues U-Y1 were open for three months. Starting in May 2012, the duration of the queue period was reset to six months, starting with Queue Y2. Queue AB2 is currently open.

All projects that have been entered in a queue have a status assigned. Projects listed as active are undergoing one of the studies (feasibility, system impact, facility) required to proceed. Other status options are under construction, suspended, and in service. Withdrawn projects are removed from the queue and listed separately. A project cannot be suspended until it has reached the status of under construction. Any project that entered the queue before February 1, 2011, can be suspended for up to three years. Projects that entered

the queue after February 1, 2011, face an additional restriction in that the suspension period is reduced to one year if they affect any project later in the queue.<sup>8</sup> When a project is suspended, PJM extends the scheduled milestones by the duration of the suspension. If, at any time, a milestone is not met, PJM will initiate the termination of the Interconnection Service Agreement (ISA) and the corresponding cancellation costs must be paid by the customer.<sup>9</sup>

Table 12-2 shows MW in queues by expected completion date and MW changes in the queues between December 31, 2015 and March 31, 2016, for ongoing projects, i.e. projects with the status active, under construction or suspended.<sup>10</sup> Projects that are already in service are not included here. The total MW in queues decreased by 3,386.8 MW, or 4.0 percent, from 85,323.1 MW at the end of 2015. The change was the result of 3,575.8 MW in new projects entering the queue, 4,076.7 MW in projects withdrawing, and 2,775.9 MW going into service. The remaining difference is the result of projects adjusting their expected MW.

**Table 12-2 Queue comparison by expected completion year (MW): December 31, 2015 vs. March 31, 2016<sup>11</sup>**

Year	As of 12/31/2015	As of 3/31/2016	Quarterly Change	
			MW	Percent
2015	9,641.9	0.0	NA	NA
2016	15,085.7	21,064.0	5,978.3	28.4%
2017	12,442.3	12,957.0	514.7	4.0%
2018	13,403.6	14,859.6	1,456.0	9.8%
2019	21,461.3	18,416.5	(3,044.8)	(16.5%)
2020	11,444.3	10,869.3	(575.0)	(5.3%)
2021	0.0	1,925.9	1,925.9	NA
2022	250.0	250.0	0.0	0.0%
2024	1,594.0	1,594.0	0.0	0.0%
Total	85,323.1	81,936.3	(3,386.8)	(4.0%)

Table 12-3 shows the yearly project status changes in more detail and how scheduled queue capacity has changed between December 31, 2015, and March

<sup>8</sup> See PJM. Manual 14C. "Generation and Transmission Interconnection Process," Revision 8 (December 20, 2012), Section 3.7, <<http://www.pjm.com/~media/documents/manuals/m14c.ashx>>.

<sup>9</sup> PJM does not track the duration of suspensions or PJM termination of projects.

<sup>10</sup> Expected completion dates are entered when the project enters the queue. Actual completion dates are generally different than expected completion dates.

<sup>11</sup> Wind and solar capacity in Table 12-2 through Table 12-5 have not been adjusted to reflect derating.

31, 2016. For example, 3,575.8 MW entered the queue in the first three months of 2016, 3,546.1 MW of which are currently active and 26.7 MW of which were withdrawn before the quarter ended. Of the total 52,350.1 MW marked as active at the beginning of the quarter, 3,788.0 MW were withdrawn, 19.9 MW were suspended, 2,540.5 MW started construction, and 298.0 MW went into service by the end of the quarter. The Under Construction column shows that 17.0 MW came out of suspension and 2,540.5 MW began construction in the first three months of 2016, in addition to the 24,625.2 MW of capacity that maintained the status under construction from the previous quarter.

**Table 12–3 Change in project status (MW): December 31, 2015 vs. March 31, 2016**

Status at 12/31/2015	Status at 3/31/2016					
	Total at 12/31/2015	Active	Suspended	Under Construction	In Service	Withdrawn
(Entered in Q1 2016)		3,546.1	0.0	0.0	3.0	26.7
Active	52,350.1	45,593.7	19.9	2,540.5	298.0	3,788.0
Suspended	4,698.9	0.0	4,681.9	17.0	0.0	0.0
Under Construction	28,274.1	70.0	842.0	24,625.2	2,474.9	262.0
In Service	41,021.9	0.0	0.0	0.0	41,021.9	0.0
Withdrawn	286,258.0	0.0	0.0	0.0	0.0	286,473.0
Total at 3/31/2016		49,209.8	5,543.8	27,182.6	43,797.8	290,549.8

Table 12–4 shows the amount of capacity active, in service, under construction, suspended, or withdrawn for each queue since the beginning of the RTEP process and the total amount of capacity that had been included in each queue. All items in queues A–M are either in service or have been withdrawn. As of March 31, 2016, there are 81,936.3 MW of capacity in queues that are not yet in service, of which 6.8 percent are suspended, 33.2 percent are under construction and 60.1 percent have not begun construction.

**Table 12–4 Capacity in PJM queues (MW): At March 31, 2016<sup>12</sup>**

Queue	Active	In-Service	Under Construction	Suspended	Withdrawn	Total
A Expired 31-Jan-98	0.0	8,103.0	0.0	0.0	17,252.0	25,355.0
B Expired 31-Jan-99	0.0	4,645.5	0.0	0.0	14,620.7	19,266.2
C Expired 31-Jul-99	0.0	531.0	0.0	0.0	3,470.3	4,001.3
D Expired 31-Jan-00	0.0	850.6	0.0	0.0	7,182.0	8,032.6
E Expired 31-Jul-00	0.0	795.2	0.0	0.0	8,021.8	8,817.0
F Expired 31-Jan-01	0.0	52.0	0.0	0.0	3,092.5	3,144.5
G Expired 31-Jul-01	0.0	1,189.6	0.0	0.0	17,961.8	19,151.4
H Expired 31-Jan-02	0.0	702.5	0.0	0.0	8,421.9	9,124.4
I Expired 31-Jul-02	0.0	103.0	0.0	0.0	3,728.4	3,831.4
J Expired 31-Jan-03	0.0	40.0	0.0	0.0	846.0	886.0
K Expired 31-Jul-03	0.0	98.9	0.0	0.0	485.2	584.1
L Expired 31-Jan-04	0.0	256.5	0.0	0.0	4,528.7	4,785.2
M Expired 31-Jul-04	0.0	504.8	0.0	0.0	3,705.6	4,210.4
N Expired 31-Jan-05	0.0	2,398.8	38.0	0.0	8,090.3	10,527.0
O Expired 31-Jul-05	0.0	1,668.2	437.0	0.0	5,466.8	7,572.0
P Expired 31-Jan-06	0.0	3,064.7	253.0	210.0	5,170.5	8,698.2
Q Expired 31-Jul-06	0.0	3,147.9	1,594.0	0.0	9,881.7	14,623.6
R Expired 31-Jan-07	0.0	1,886.4	648.3	800.0	19,420.6	22,755.3
S Expired 31-Jul-07	0.0	3,512.7	432.9	190.0	12,396.5	16,532.0
T Expired 31-Jan-08	200.0	1,779.0	2,443.0	300.0	22,813.3	27,535.3
U Expired 31-Jan-09	400.0	837.3	949.9	320.0	30,829.6	33,336.8
V Expired 31-Jan-10	1,369.2	1,936.1	916.6	555.0	12,036.4	16,813.3
W Expired 31-Jan-11	1,295.0	1,949.5	1,106.8	1,628.0	18,101.0	24,080.3
X Expired 31-Jan-12	2,944.0	2,847.9	6,551.7	366.8	17,634.0	30,344.5
Y Expired 30-Apr-13	1,312.5	548.8	4,340.2	1,117.5	18,446.7	25,765.5
Z Expired 30-Apr-14	2,899.4	294.7	5,236.5	42.3	5,860.8	14,333.7
AA1 Expired 31-Oct-14	7,400.3	53.4	2,201.1	14.3	2,333.3	12,002.4
AA2 Expired 30-Apr-15	9,420.6	0.0	27.5	0.0	6,629.8	16,077.9
AB1 Expired 31-Oct-15	17,952.0	0.0	6.3	0.0	2,522.6	20,480.9
AB2 Through 31-Mar-16	4,016.8	0.0	0.0	0.0	29.0	4,045.8
Total	49,209.8	43,797.8	27,182.6	5,543.8	290,979.8	416,713.9

<sup>12</sup> Projects listed as partially in service are counted as in service for the purposes of this analysis.

## Distribution of Units in the Queues

Table 12-5 shows the projects under construction, suspended, or active, by unit type, and control zone.<sup>13</sup> As of March 31, 2016, 81,936.3 MW of capacity were in generation request queues for construction through 2024, compared to 85,323.1 MW at December 31, 2015.<sup>14</sup> Table 12-5 also shows the planned retirements for each zone.

**Table 12-5 Queue capacity by LDA, control zone and fuel (MW): At March 31, 2016<sup>15</sup>**

LDA	Zone	BioMass	CC	CT	Diesel	Fuel Cell	Hydro	Nuclear	Solar	Steam	Storage	Wind	Total Queue Capacity	Planned Retirements
EMAAC	AECO	0.0	1,706.0	239.5	0.0	1.5	0.0	0.0	70.2	0.0	21.0	373.0	2,411.2	8.0
	DPL	0.0	742.0	7.0	2.0	0.0	0.0	0.0	796.8	0.0	24.0	749.6	2,321.4	34.0
	JCPL	0.0	3,376.2	0.0	0.6	0.0	0.0	0.0	436.7	0.0	181.0	0.0	3,994.5	616.0
	PECO	0.0	1,221.0	0.0	8.6	0.0	0.0	50.0	0.0	0.0	40.8	0.0	1,320.4	50.8
	PSEG	0.0	2,658.4	229.0	10.6	0.0	0.0	0.0	82.7	24.0	2.0	0.0	3,006.7	611.0
	RECO	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	EMAAC Total	0.0	9,703.6	475.5	21.8	1.5	0.0	50.0	1,386.4	24.0	268.8	1,122.6	13,054.2	1,319.8
SWMAAC	BGE	0.0	0.0	256.0	30.3	0.0	0.4	0.0	23.1	132.0	20.1	0.0	461.9	209.0
	Pepco	0.0	2,642.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2,642.6	0.0
	SWMAAC Total	0.0	2,642.6	256.0	30.3	0.0	0.4	0.0	23.1	132.0	20.1	0.0	3,104.5	209.0
WMAAC	Met-Ed	0.0	2,311.5	34.1	0.0	0.0	0.0	0.0	3.0	0.0	0.0	0.0	2,348.6	0.0
	PENELEC	0.0	2,814.5	1,420.8	180.7	0.0	40.0	0.0	13.5	0.0	40.0	418.3	4,927.8	0.0
	PPL	16.0	6,620.0	19.9	24.9	0.0	0.0	0.0	16.0	0.0	30.0	466.5	7,193.3	0.0
	WMAAC Total	16.0	11,746.0	1,474.8	205.6	0.0	40.0	0.0	32.5	0.0	70.0	884.8	14,469.7	0.0
Non-MAAC	AEP	0.0	7,234.0	97.0	13.0	0.0	134.0	102.0	119.2	251.0	114.0	6,926.2	14,990.4	0.0
	AP	0.0	4,335.4	0.0	133.3	0.0	0.0	0.0	343.8	1,726.5	73.0	940.0	7,552.0	0.0
	ATSI	0.0	5,947.0	0.0	65.3	0.0	0.0	0.0	0.0	0.0	12.5	518.0	6,542.8	94.0
	ComEd	0.0	4,949.3	590.0	58.7	0.0	22.7	80.0	0.0	27.0	111.1	3,522.5	9,361.3	510.0
	DAY	1.9	0.0	0.0	0.0	0.0	0.0	0.0	25.9	12.0	20.0	300.0	359.8	0.0
	DEOK	0.0	513.0	0.0	6.4	0.0	0.0	0.0	125.0	0.0	10.0	0.0	654.4	0.0
	DLCO	0.0	205.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	20.0	0.0	225.0	0.0
	Dominion	62.5	4,776.9	60.0	12.0	0.0	0.0	1,594.0	2,460.8	0.0	34.0	1,472.1	10,472.3	323.0
	EKPC	0.0	1,150.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,150.0	149.0
	Non-MAAC Total	64.4	29,110.6	747.0	288.7	0.0	156.7	1,776.0	3,074.7	2,016.5	394.6	13,678.8	51,308.0	1,076.0
<b>Total</b>		<b>80.4</b>	<b>53,202.8</b>	<b>2,953.3</b>	<b>546.4</b>	<b>1.5</b>	<b>197.1</b>	<b>1,826.0</b>	<b>4,516.7</b>	<b>2,172.5</b>	<b>753.5</b>	<b>15,686.2</b>	<b>81,936.3</b>	<b>2,604.8</b>

A significant shift in the distribution of unit types within the PJM footprint continues to develop as natural gas fired units enter the queue and steam units retire. While 56,560.08 MW of gas fired capacity are in the queue, there are only 1,957.0 MW of coal fired steam capacity in the queue. The only new coal project currently in the queue is the new Hatfield unit, with 1,710 MW of capacity. This project, which entered the queue in October 2014 and is already under

<sup>13</sup> Unit types designated as reciprocating engines are classified as diesel.

<sup>14</sup> Since wind resources cannot be dispatched on demand, PJM rules previously required that the unforced capacity of wind resources be derated to 20 percent of nameplate capacity until actual generation data are available. Beginning with Queue U, PJM derates wind resources to 13 percent of nameplate capacity until there is operational data to support a different conclusion. PJM derates solar resources to 38 percent of nameplate capacity. Based on the derating of 15,686.2 MW of wind resources and 4,516.7 MW of solar resources, the 81,936.3 MW currently active in the queue would be reduced to 65,489.0 MW.

<sup>15</sup> This data includes only projects with a status of active, under-construction, or suspended.

construction, is intended to replace three coal units retired in October 2013 at the same location. With respect to retirements, 1,263.0 MW of coal fired steam capacity and 282.8 MW of natural gas capacity are slated for deactivation between now and 2020. The replacement of coal steam units by units burning natural gas could significantly affect future congestion, the role of firm and interruptible gas supply, and natural gas supply infrastructure.

## Planned Retirements

As shown in Table 12-6, 26,486.5 MW have been, or are planned to be, retired between 2011 and 2020.<sup>16</sup> Of that, 2,007.3 MW are planned to retire after 2016. In the first three months of 2016, 53 MW were retired. Of the 2,656.8 MW pending retirement, 1,263 MW are coal units. The coal unit retirements were a result of low gas prices and the EPA's Mercury and Air Toxics Standards (MATS) for some units.


**Table 12-6 Summary of PJM unit retirements by fuel (MW): 2011 through 2020**

	Coal	Diesel	Heavy Oil	Kerosene	Landfill Gas	Light Oil	Natural Gas	Nuclear	Wind	Wood Waste	Total
Retirements 2011	543.0	0.0	0.0	0.0	0.0	63.7	522.5	0.0	0.0	0.0	1,129.2
Retirements 2012	5,907.9	0.0	0.0	0.0	0.0	788.0	250.0	0.0	0.0	16.0	6,961.9
Retirements 2013	2,589.9	2.9	166.0	0.0	3.8	85.0	0.0	0.0	0.0	8.0	2,855.6
Retirements 2014	2,427.0	50.0	0.0	184.0	15.3	0.0	294.0	0.0	0.0	0.0	2,970.3
Retirements 2015	7,661.8	10.3	0.0	644.2	2.0	212.0	1,319.0	0.0	10.4	0.0	9,859.7
Retirements 2016	0.0	51.0	0.0	0.0	2.0	0.0	0.0	0.0	0.0	0.0	53.0
Planned Retirements 2016	566.0	8.0	74.0	0.0	1.5	0.0	0.0	0.0	0.0	0.0	649.5
Planned Retirements Post-2016	697.0	0.0	34.0	0.0	0.0	0.0	661.8	614.5	0.0	0.0	2,007.3
<b>Total</b>	<b>20,392.6</b>	<b>122.2</b>	<b>274.0</b>	<b>828.2</b>	<b>24.6</b>	<b>1,148.7</b>	<b>3,047.3</b>	<b>614.5</b>	<b>10.4</b>	<b>24.0</b>	<b>26,486.5</b>

<sup>16</sup> See PJM "Generator Deactivation Summary Sheets," at <<http://www.pjm.com/planning/generation-deactivation/gd-summaries.aspx>> (April 4, 2016).

A map of the retirements between 2011 and 2020 is shown in Figure 12-1.

Figure 12-1 Map of PJM unit retirements: 2011 through 2020

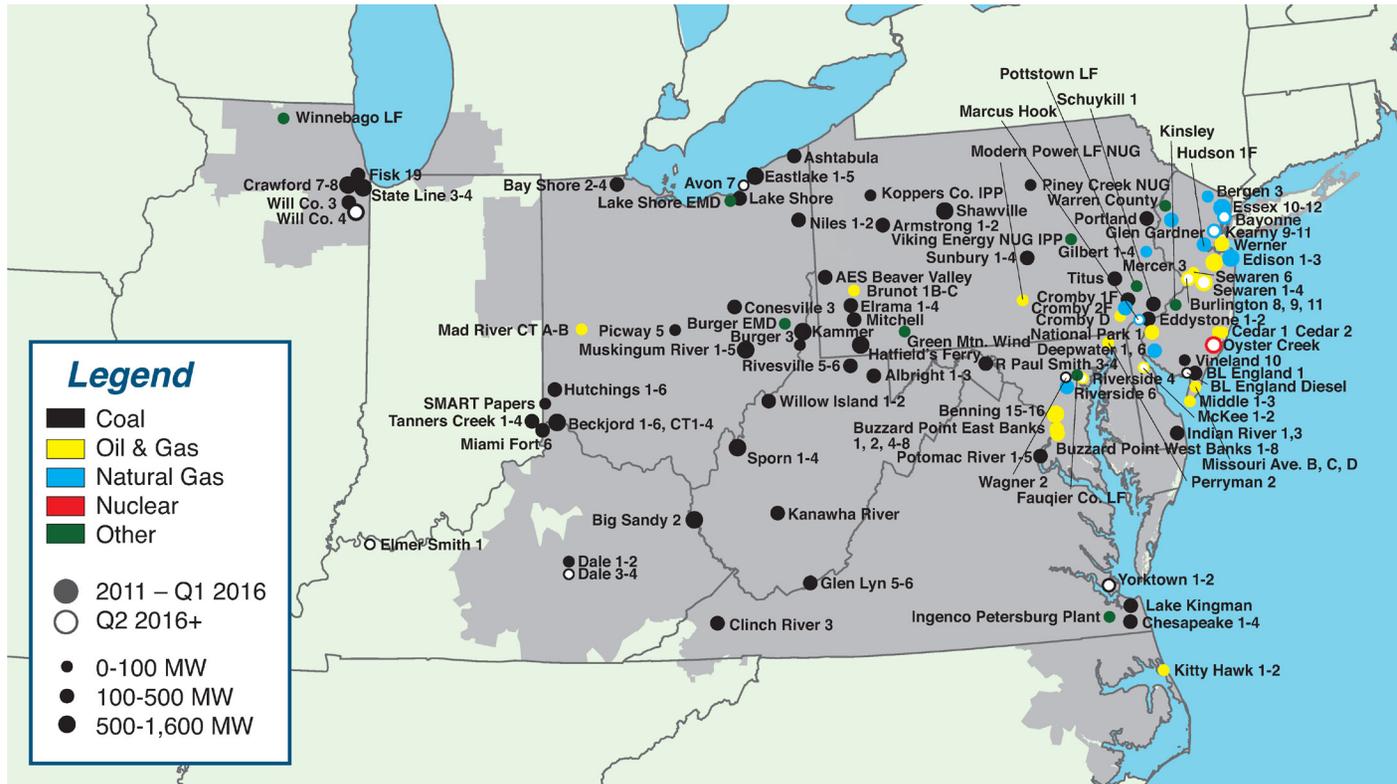

The list of pending retirements is shown in Table 12-7.

**Table 12-7 Planned retirement of PJM units: as of March 31, 2016**

Unit	Zone	ICAP (MW)	Fuel	Unit Type	Projected Deactivation Date
Yorktown 1-2	Dominion	323.0	Coal	Steam	31-Mar-16
Dale 3-4	EKPC	149.0	Coal	Steam	16-Apr-16
Avon Lake 7	ATSI	94.0	Coal	Steam	16-Apr-16
BL England Diesels	AECO	8.0	Diesel	Diesel	31-May-16
Riverside 4	BGE	74.0	Natural gas	Steam	01-Jun-16
Warren County Landfill	JCPL	1.5	Landfill Gas	Diesel	01-Jun-16
McKee 1-2	DPL	34.0	Heavy Oil	Combustion Turbine	31-May-17
Will County 4	ComEd	510.0	Coal	Steam	31-May-18
Sewaren 1-4	PSEG	453.0	Kerosene	Combustion Turbine	01-Jun-18
Bayonne Cogen Plant (CC)	PSEG	158.0	Natural gas	Steam	01-Nov-18
MH50 Marcus Hook Co-gen	PECO	50.8	Natural gas	Steam	13-May-19
Elmer Smith U1	External	52.0	Coal	Steam	01-Jun-19
Oyster Creek	JCPL	614.5	Nuclear	Nuclear	31-Dec-19
Wagner 2	BGE	135.0	Coal	Steam	01-Jun-20
<b>Total</b>		<b>2,656.8</b>			

Table 12-8 shows the capacity, average size, and average age of units retiring in PJM, from 2011 through 2020, while Table 12-9 shows these retirements by state. The majority, 77.0 percent, of all MW retiring during this period are coal steam units. These units have an average age of 56.0 years and an average size of 163.1 MW. Over half of them, 53.4 percent, are located in either Ohio or Pennsylvania. Retirements have generally consisted of smaller subcritical coal steam units and those without adequate environmental controls to remain viable beyond 2016.

**Table 12-8 Retirements by fuel type: 2011 through 2020**

	Number of Units	Avg. Size (MW)	Avg. Age at Retirement (Years)	Total MW	Percent
Coal	125	163.1	56.0	20,392.6	77.0%
Diesel	7	17.5	42.7	122.2	0.5%
Heavy Oil	4	68.5	57.5	274.0	1.0%
Kerosene	20	41.4	45.5	828.2	3.1%
Landfill Gas	7	3.5	15.0	24.6	0.1%
Light Oil	15	76.6	43.8	1,148.7	4.3%
Natural Gas	51	59.8	46.4	3,047.3	11.5%
Nuclear	1	614.5	50.0	614.5	2.3%
Wind	1	10.4	15.0	10.4	0.0%
Wood Waste	2	12.0	23.5	24.0	0.1%
<b>Total</b>	<b>233</b>	<b>113.7</b>	<b>50.1</b>	<b>26,486.5</b>	<b>100.0%</b>

**Table 12-9 Retirements (MW) by fuel type and state: 2011 through 2020**

State	Heavy		Landfill Gas	Light Oil	Natural Gas	Nuclear	Wind	Wood Waste	Total	
	Coal	Diesel								
DC	0.0	0.0	0.0	0.0	0.0	788.0	0.0	0.0	0.0	788.0
DE	254.0	0.0	34.0	0.0	0.0	0.0	0.0	0.0	0.0	288.0
IL	2,134.0	0.0	0.0	0.0	6.4	0.0	0.0	0.0	0.0	2,140.4
IN	982.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	982.0
KY	1,047.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,047.0
MD	250.0	51.0	74.0	0.0	0.0	0.0	115.0	0.0	0.0	490.0
NC	0.0	0.0	0.0	0.0	0.0	31.0	0.0	0.0	0.0	31.0
NJ	136.0	8.0	0.0	828.2	6.2	212.0	2,680.5	614.5	0.0	4,485.4
OH	5,752.6	60.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,812.9
PA	5,145.0	0.0	166.0	0.0	10.0	117.7	251.8	0.0	10.4	5,724.9
VA	2,051.0	2.9	0.0	0.0	2.0	0.0	0.0	0.0	0.0	2,055.9
WV	2,641.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2,641.0
<b>Total</b>	<b>20,392.6</b>	<b>122.2</b>	<b>274.0</b>	<b>828.2</b>	<b>24.6</b>	<b>1,148.7</b>	<b>3,047.3</b>	<b>614.5</b>	<b>10.4</b>	<b>26,486.5</b>

## Actual Generation Deactivations in 2016

Table 12-10 shows the units that were deactivated in 2016.

**Table 12-10 Unit deactivations in 2016**

Company	Unit Name	ICAP (MW)	Primary Fuel	Zone Name	Average Age (Years)	Retirement Date
Exelon Corporation	Fauquier County Landfill	2.0	Diesel	Dominion	12	31-Jan-16
Exelon Corporation	Perryman 2	51.0	Diesel	BGE	44	01-Feb-16
Total		53.0				

## Generation Mix

As of March 31, 2016, PJM had an installed capacity of 187,281.3 MW (Table 12-11). This measure differs from capacity market installed capacity because it includes energy-only units, excludes all external units, and uses nameplate values for solar and wind resources.

**Table 12-11 Existing PJM capacity: At March 31, 2016 (By zone and unit type (MW))<sup>17</sup>**

Zone	CC	CT	Diesel	Fuel Cell	Hydroelectric	Nuclear	Solar	Steam	Storage	Wind	Total
AECO	901.9	507.7	22.6	0.0	0.0	0.0	41.7	815.9	0.0	7.5	2,297.3
AEP	4,900.0	3,682.2	77.1	0.0	1,071.9	2,071.0	0.0	18,897.8	4.0	2,103.2	32,807.2
APS	1,129.0	1,214.9	47.9	0.0	129.2	0.0	36.1	5,409.0	27.4	1,088.5	9,082.0
ATSI	685.0	1,617.4	67.7	0.0	0.0	2,134.0	0.0	5,813.0	0.0	0.0	10,317.1
BGE	0.0	789.0	18.4	0.0	0.0	1,716.0	0.0	2,995.5	0.0	0.0	5,518.9
ComEd	3,146.1	7,244.0	93.8	0.0	0.0	10,473.5	9.0	5,166.1	76.0	2,431.9	28,640.4
DAY	0.0	1,368.5	47.5	0.0	0.0	0.0	1.1	2,908.0	40.0	0.0	4,365.1
DEOK	47.2	654.0	0.0	0.0	0.0	0.0	0.0	3,567.0	10.0	0.0	4,278.2
DLCO	244.0	15.0	0.0	0.0	6.3	1,777.0	0.0	660.0	0.0	0.0	2,702.3
Dominion	5,493.6	3,874.8	151.8	0.0	3,589.3	3,581.3	157.8	7,775.0	0.0	0.0	24,623.6
DPL	1,498.5	1,820.4	96.1	30.0	0.0	0.0	4.0	1,620.0	0.0	0.0	5,069.0
EKPC	0.0	774.0	0.0	0.0	70.0	0.0	0.0	1,836.0	0.0	0.0	2,680.0
JCPL	2,682.5	763.1	19.9	0.0	400.0	614.5	117.2	10.0	0.0	0.0	4,607.2
Met-Ed	2,111.0	406.5	41.4	0.0	19.0	805.0	0.0	200.0	0.0	0.0	3,582.9
PECO	3,209.0	834.0	2.9	0.0	1,642.0	4,546.8	3.0	979.1	1.0	0.0	11,217.8
PENELEC	0.0	407.5	52.2	0.0	512.8	0.0	0.0	6,793.5	10.4	930.9	8,707.3
Pepco	230.0	1,091.7	9.9	0.0	0.0	0.0	0.0	3,649.1	0.0	0.0	4,980.7
PPL	1,807.9	616.2	55.5	0.0	706.6	2,520.0	15.0	5,169.9	20.0	219.7	11,130.8
PSEG	3,846.3	1,132.0	11.1	0.0	5.0	3,493.0	134.0	2,050.1	2.0	0.0	10,673.5
RECO	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Total	31,932.0	28,812.9	815.8	30.0	8,152.1	33,732.1	518.9	76,315.0	190.8	6,781.7	187,281.3

<sup>17</sup> The capacity described in this section refers to all capacity in PJM at nameplate ratings, regardless of whether the capacity entered the RPM auction. This table previously included external units.

Figure 12-2 and Table 12-12 show the age of PJM generators by unit type. Units older than 40 years comprise 71,429.4 MW, or 38.1 percent, of the total capacity of 187,281.3 MW.

**Table 12-12 PJM capacity (MW) by age (years): At March 31, 2016**

Age (years)	CC	CT	Diesel	Fuel Cell	Hydroelectric	Nuclear	Solar	Steam	Storage	Wind	Total
Less than 20	26,635.5	21,053.4	551.4	30.0	232.8	0.0	518.9	3,905.5	190.8	6,781.7	59,900.0
20 to 40	4,854.5	3,315.5	98.8	0.0	3,557.2	22,893.9	0.0	21,232.0	0.0	0.0	55,951.9
40 to 60	442.0	4,444.0	163.6	0.0	2,915.0	10,838.2	0.0	49,337.5	0.0	0.0	68,140.3
More than 60	0.0	0.0	2.0	0.0	1,447.1	0.0	0.0	1,840.0	0.0	0.0	3,289.1
<b>Total</b>	<b>31,932.0</b>	<b>28,812.9</b>	<b>815.8</b>	<b>30.0</b>	<b>8,152.1</b>	<b>33,732.1</b>	<b>518.9</b>	<b>76,315.0</b>	<b>190.8</b>	<b>6,781.7</b>	<b>187,281.3</b>

**Figure 12-2 PJM capacity (MW) by age (years): At March 31, 2016**

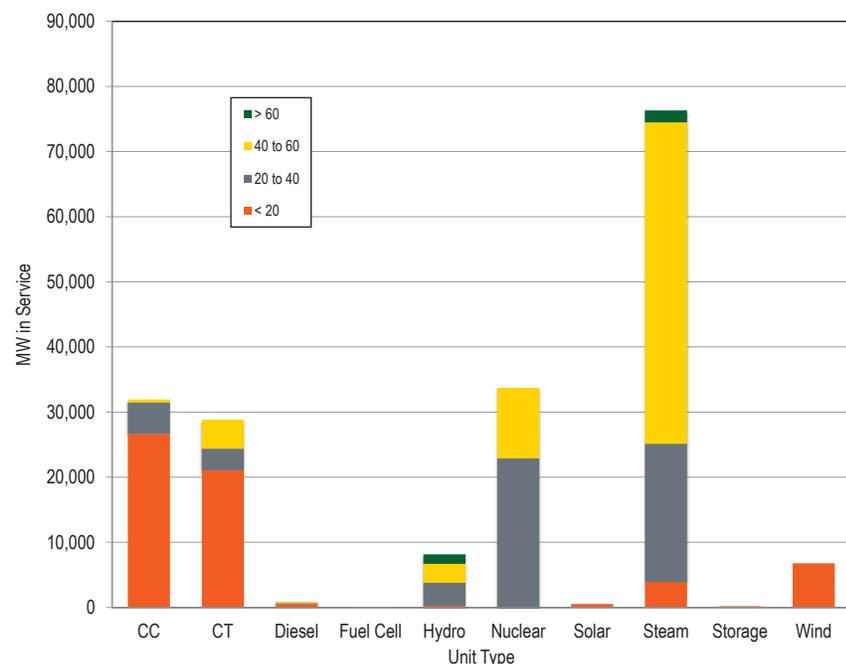


Table 12-13 shows the effect that expected retirements and new generation in the queues would have on the existing generation mix five years from now. The planned additions reflect the historical rates of completion, as shown in Table 12-16. While there are currently 81,936.3 MW in the queue, historical patterns indicate that we can expect 33,512.9 MW to go into service, based on current status in the queue process. Even though 71,429.4 MW of the total capacity are more than 40 years old, only 2,656.8 MW of these are planned to retire within the next five years. The expected role of gas-fired generation depends on projects in the queues and retirement of coal-fired generation. Existing capacity in SWMAAC is currently 63.3 percent steam, which will be reduced to 52.4 percent by 2020 as a result of the addition of an expected 2,046.3 MW of planned CC capacity. CC capacity would increase from 2.2 percent to 18.2 percent of capacity in SWMAAC in 2020. CC and CT generators would comprise 33.3 percent of SWMAAC capacity in 2020. In PJM, as a whole, the share of capacity from renewables increases from 8.4 percent to 11.5 percent by 2020.

Table 12-13 Expected capacity (MW) in five years: as of March 31, 2016<sup>18</sup>

LDA	Unit Type	Current Generator Capacity	Percent of Area Total	Planned Additions	Planned Retirements	Estimated Capacity in 5 Years	Percent of Area Total	
EMAAC	Combined Cycle	12,138.2	35.8%	3,537.9	0.0	15,676.1	41.8%	
	Combustion Turbine	5,057.2	14.9%	105.6	0.0	5,162.8	13.8%	
	Diesel	152.6	0.5%	12.0	9.5	155.1	0.4%	
	Fuel Cell	30.0	0.1%	0.2	0.0	30.2	0.1%	
	Hydroelectric	2,047.0	6.0%	0.0	0.0	2,047.0	5.5%	
	Nuclear	8,654.3	25.6%	31.0	614.5	8,070.8	21.5%	
	Solar	299.9	0.9%	642.6	0.0	942.5	2.5%	
	Steam	5,475.1	16.2%	0.0	695.8	4,779.3	12.7%	
	Storage	3.0	0.0%	71.0	0.0	74.0	0.2%	
	Wind	7.5	0.0%	565.9	0.0	573.4	1.5%	
	Total	33,864.8	100.0%	4,966.2	1,319.8	37,511.2	100.0%	
	SWMAAC	Combined Cycle	230.0	2.2%	2,046.3	0.0	2,276.3	18.2%
		Combustion Turbine	1,880.7	17.9%	0.0	0.0	1,880.7	15.1%
Diesel		28.3	0.3%	24.3	0.0	52.7	0.4%	
Hydroelectric		0.0	0.0%	0.3	0.0	0.3	0.0%	
Nuclear		1,716.0	16.3%	0.0	0.0	1,716.0	13.7%	
Solar		0.0	0.0%	18.5	0.0	18.5	0.1%	
Steam		6,644.6	63.3%	106.1	209.0	6,541.7	52.4%	
Storage		0.0	0.0%	2.7	0.0	2.7	0.0%	
Total		10,499.6	100.0%	2,198.1	209.0	12,488.7	100.0%	
WMAAC	Biomass	0.0	0.0%	12.9	0.0	12.9	0.0%	
	Combined Cycle	3,918.9	16.7%	4,794.2	0.0	8,713.1	30.0%	
	Combustion Turbine	1,430.2	6.1%	272.9	0.0	1,703.1	5.9%	
	Diesel	149.1	0.6%	46.5	0.0	195.5	0.7%	
	Hydroelectric	1,238.4	5.3%	28.2	0.0	1,266.6	4.4%	
	Nuclear	3,325.0	14.2%	0.0	0.0	3,325.0	11.4%	
	Solar	15.0	0.1%	26.1	0.0	41.1	0.1%	
	Steam	12,163.4	51.9%	0.0	0.0	12,163.4	41.9%	
	Storage	30.4	0.1%	18.0	0.0	48.4	0.2%	
	Wind	1,150.6	4.9%	442.4	0.0	1,593.0	5.5%	
	Total	23,421.0	100.0%	5,641.1	0.0	29,062.0	100.0%	
RTO	Biomass	0.0	0.0%	51.7	0.0	51.7	0.0%	
	Combined Cycle	15,644.9	13.1%	11,144.2	0.0	26,789.1	19.3%	
	Combustion Turbine	20,444.8	17.1%	251.2	0.0	20,696.0	14.9%	
	Diesel	485.8	0.4%	111.5	0.0	597.3	0.4%	
	Hydroelectric	4,866.7	4.1%	23.1	0.0	4,889.9	3.5%	
	Nuclear	20,036.8	16.8%	138.4	0.0	20,175.2	14.5%	
	Solar	204.1	0.0	852.2	0.0	1,056.3	0.8%	
	Steam	52,031.9	43.5%	1,540.7	1,128.0	52,444.6	37.7%	
	Storage	157.4	0.1%	132.6	0.0	290.0	0.2%	
	Wind	5,623.6	4.7%	6,462.0	0.0	12,085.6	8.7%	
	Total	119,496.0	100.0%	20,707.5	1,128.0	139,075.5	100.0%	
	Total		187,281.3		33,512.9	2,656.8	218,137.4	

<sup>18</sup> Percent results shown in Table 12-13 are based on unrounded, underlying data and may differ from calculations based on the rounded values in the tables.

## Generation and Transmission Interconnection Planning Process

PJM made changes to the queue process in May 2012.<sup>19</sup> These changes included reducing the length of the queues, creating an alternate queue for some small projects, and adjustments to the rules regarding suspension rights and Capacity Interconnection Rights (CIR). PJM staff reported on June 11, 2015, that due to these and other process improvements, the study backlog has been significantly reduced.<sup>20</sup> The Earlier Queue Submittal Task Force (EQSTF) was established in August 2015, to further address the issue.<sup>21</sup>

### Interconnection Study Phase

In the study phase of the interconnection planning process, a series of studies are performed to determine the feasibility, impact, and cost of projects in the queue. Table 12-14 is an overview of PJM's study process. System impact and facilities studies are often redone when a project is withdrawn in order to determine the impact on the projects remaining in the queue.

**Table 12-14 PJM generation planning process**

Process Step	Start on	Financial Obligation	Days for PJM to Complete	Days for Applicant to Decide Whether to Continue
Feasibility Study	Close of current queue	Cost of study (partially refundable deposit)	90	30
System Impact Study	Upon acceptance of the System Impact Study Agreement	Cost of study (partially refundable deposit)	120	30
Facilities Study	Upon acceptance of the Facilities Study Agreement	Cost of study (refundable deposit)	Varies	60
Schedule of Work	Upon acceptance of Interconnection Service Agreement (ISA)	Letter of credit for upgrade costs	Varies	37
Construction (only for new generation)	Upon acceptance of Interconnection Construction Service Agreement (ICSA)	None	Varies	NA

Manual 14B requires PJM to apply a commercial probability factor at the feasibility study stage to improve the accuracy of capacity and cost estimates. The commercial probability factor is based on the historical incidence of projects dropping out of the queue at the impact study stage.<sup>22</sup> The impact and facilities studies are performed using the full amount of planned generation in

the queues. The actual withdrawal rates are shown in Table 12-15 and Table 12-16.

Table 12-15 shows the milestone status when projects were withdrawn, for all withdrawn projects. Of the projects withdrawn, 47.6 percent were withdrawn before the system impact study was completed. Once an Interconnection Service Agreement (ISA) or a Wholesale Market Participation Agreement (WMPA) is executed, the financial obligation for any necessary transmission upgrades cannot be retracted.<sup>23</sup> <sup>24</sup> Withdrawing at or beyond this point is uncommon; only 235 projects, or 13.8 percent, of all projects withdrawn were withdrawn after reaching this milestone.

<sup>19</sup> See letter from PJM to Secretary Kimberly Bose, Docket No. ER12-1177-000, <<http://www.pjm.com/~media/documents/ferc/2012-filings/20120229-er12-1177-000.ashx>>.

<sup>20</sup> See presentation by Dave Egan to the PJM Planning Committee, at <<http://www.pjm.com/~media/committees-groups/committees/pc/20150611/20150611-item-09-queue-status-update.ashx>>

<sup>21</sup> See Earlier Queue Submittal Task Force at <<http://www.pjm.com/committees-and-groups/task-forces/eqstf.aspx>>.

<sup>22</sup> See PJM Manual 14B. "PJM Region Transmission Planning Process," Revision 30 (February 26, 2015), p.70.

<sup>23</sup> "Generators planning to connect to the local distribution systems at locations that are not under FERC jurisdiction and wish to participate in PJM's market need to execute a PJM Wholesale Market Participation Agreement (WMPA)..." instead of an ISA. See PJM Manual 14C. "Generation and Transmission Interconnection Facility Construction," Revision 08 (December 20, 2012), p.8.

<sup>24</sup> See PJM. "Manual 14C: Generation and Transmission Interconnection Facility Construction," Revision 08 (December 20, 2012), p.22.

**Table 12-15 Last milestone completed at time of withdrawal: January 1, 1997 through March 31, 2016**

Milestone Completed	Projects Withdrawn	Percent
Never Started	188	11.0%
Feasibility Study	625	36.6%
System Impact Study	551	32.3%
Facilities Study	109	6.4%
Interconnection Service Agreement (ISA)	40	2.3%
Wholesale Market Participation Agreement (WMPA)	133	7.8%
Construction Service Agreement (CSA) or beyond	62	3.6%
Total	1,708	100.0%

Table 12-16 shows, by MW, the rate at which projects drop out of the queue as they move through the process, as well as the rate at which projects eventually go into service. Out of 334,777.6 nameplate MW that entered the queue, 43,797.8, 13.1 percent, went into service, while the remaining 290,979.8 MW withdrew at some point. Of the withdrawals, 39.3 percent happened after the feasibility study was completed.

**Table 12-16 Completed (withdrawn or in service) queue MW: January 1, 1997 through March 31, 2016**

Milestone Completed	MW in Queue	Percent of Total in Queue	MW Withdrawn	Percent of Total Withdrawn	Percent that Go In Service
Enter Queue	334,777.6	100.0%	28,939.2	9.9%	13.1%
Feasibility Study	305,838.4	91.4%	147,733.4	50.8%	14.3%
System Impact Study	158,105.0	47.2%	95,043.6	32.7%	27.7%
Facilities Study	63,061.5	18.8%	954.1	0.3%	69.5%
ISA/WMPA	62,107.4	18.6%	7,593.1	2.6%	70.5%
Construction	54,514.2	16.3%	10,716.4	3.7%	80.3%
In-Service	43,797.8	13.1%	0.0	0.0%	100.0%

Table 12-17 and Table 12-18 show the time spent at various stages in the queue process and the completion time for the studies performed. For completed projects, there is an average time of 945 days, or 2.6 years, between entering a queue and going into service. Nuclear and wind projects tend to take longer to go into service averaging 1,468 and 1,459 days. The average time to go into service for all other fuel types is 713 days. For withdrawn projects, there is an average time of 676 days between entering a queue and withdrawing.

**Table 12-17 Average project queue times (days): At March 31, 2016**

Status	Average (Days)	Standard Deviation	Minimum	Maximum
Active	933	646	34	3,745
In-Service	945	691	1	4,024
Suspended	2,200	881	634	4,260
Under Construction	1,703	998	205	6,380
Withdrawn	676	688	5	4,249

Table 12-18 presents information on the time in the stages of the queue for those projects not yet in service. Of the 651 projects in the queue as of March 31, 2016, 90 had a completed feasibility study and 223 were under construction.

**Table 12-18 PJM generation planning summary: At March 31, 2016**

Milestone Completed	Number of Projects	Percent of Total Projects	Average Days	Maximum Days
Not Started	157	24.1%	727	1,902
Feasibility Study	90	13.8%	756	2,555
Impact Study	81	12.4%	1,339	3,745
Facilities Study	8	1.2%	1,871	2,655
Interconnection Service Agreement (ISA)	19	2.9%	1,393	2,551
Wholesale Market Participation Agreement (WMPA)	2	0.3%	562	704
Construction Service Agreement (CSA)	1	0.2%	815	815
Under Construction	233	35.8%	1,703	6,380
Suspended	60	9.2%	2,200	4,260
Total	651	100.0%		

The time it takes to complete a study depends on the backlog and the number of projects in the queue, but not on the size of the project. Table 12-19 shows the number of projects that entered the queue by year. The last two full years show an increase in queue entries, primarily by renewable projects (solar, hydro, storage, biomass, wind). Of the 496 projects entered in 2014 and 2015, 314, 63.3 percent, were renewable.

Table 12-19 Number of projects entered in the queue as of March 31, 2016

Year Entered	Fuel Group			Grand Total
	Nuclear	Renewable	Traditional	
1997	2	1	10	13
1998	0	0	18	18
1999	1	5	83	89
2000	2	3	75	80
2001	4	6	81	91
2002	3	14	32	49
2003	1	36	18	55
2004	4	17	32	53
2005	3	79	53	135
2006	9	79	72	160
2007	9	68	142	219
2008	3	114	99	216
2009	10	113	50	173
2010	5	381	55	441
2011	6	265	78	349
2012	2	73	80	155
2013	1	78	73	152
2014	0	122	68	190
2015	0	192	114	306
2016	0	32	4	36
Total	65	1,678	1,237	2,980

Even though renewable projects comprise the majority of projects entered in the queue, as well as what is currently active in the queue, renewable projects only account for 25.9 percent of the nameplate MW currently active in the queue (Table 12-20).

Table 12-20 Queue details by fuel group: At March 31, 2016

Fuel Group	Number of Projects	Percent of Projects	MW	Percent MW
Nuclear	10	1.5%	1,826.0	2.2%
Renewable	410	63.0%	21,233.8	25.9%
Traditional	231	35.5%	58,876.5	71.9%
Total	651	100.0%	81,936.3	100.0%

Table 12-21 shows the current status of all generation queue projects by fuel type and project classification from January 1, 1997, through March 31, 2016. For example, 128 upgrades at natural gas fired facilities completed the queue process and are in service.

Since 1997, there have been a total of 2,969 projects in PJM generation queues. A total of 2,419 projects have been classified as new generation and 550 projects have been classified as upgrades. Wind, solar and natural gas projects have accounted for 2,256 projects, or 76.0 percent, of all 2,969 generation queue projects.

Table 12-21 Status of all generation queue projects: January 1, 1997 through March 31, 2016

Project Status	Project Classification	Number of Projects												TOTAL
		Natural Gas	Wind	Coal	Solar	Nuclear	Hydro	Oil	Biomass	Storage	Other	LFG	Diesel	
In Service	New Generation	82	59	9	76	1	9	4	7	13	3	69	6	338
	Upgrade	128	14	45	5	37	16	14	4	3	4	10	2	282
Under Construction	New Generation	34	25	2	74	1	4	0	2	28	1	7	0	178
	Upgrade	28	0	4	12	1	0	0	2	3	0	4	1	55
Suspended	New Generation	13	18	0	24	0	0	0	0	0	0	2	0	57
	Upgrade	1	2	0	0	0	0	0	0	0	0	0	0	3
Withdrawn	New Generation	372	348	53	571	8	40	9	35	40	9	69	12	1566
	Upgrade	62	13	12	7	9	2	13	1	3	2	7	1	132
Active	New Generation	74	44	0	113	0	0	0	0	41	0	8	0	280
	Upgrade	47	6	3	4	8	2	0	0	6	0	1	1	78
Total Projects	New Generation	575	494	64	858	10	53	13	44	122	13	155	18	2419
	Upgrade	266	35	64	28	55	20	27	7	15	6	22	5	550

Table 12-22 shows the MW in Table 12-21 by share by classification as new generation or upgrade. Within a fuel type the shares of upgrades add to 100 percent and the shares of new generation add to 100 percent. For example, 80.0 percent of all hydro projects classified as upgrades are currently in service in PJM, 10.0 percent of hydro upgrades were withdrawn and 10.0 percent are active. From January 1, 1997, through March 31, 2016, solar projects have had the lowest project completion rates across all technology types in either project classification. Landfill gas projects have had the highest project completion rates.

Table 12-22 Status of all generation queue projects as percent of total projects by classification: January 1, 1997 through March 31, 2016

Project Status	Project Classification	Percent of Total Project MW by Classification											
		Natural Gas	Wind	Coal	Solar	Nuclear	Hydro	Oil	Biomass	Storage	Other	LFG	Diesel
In Service	New Generation	14.3%	11.9%	14.1%	8.9%	10.0%	17.0%	30.8%	15.9%	10.7%	23.1%	44.5%	33.3%
	Upgrade	48.1%	40.0%	70.3%	17.9%	67.3%	80.0%	51.9%	57.1%	20.0%	66.7%	45.5%	40.0%
Under Construction	New Generation	5.9%	5.1%	3.1%	8.6%	10.0%	7.5%	0.0%	4.5%	23.0%	7.7%	4.5%	0.0%
	Upgrade	10.5%	0.0%	6.3%	42.9%	1.8%	0.0%	0.0%	28.6%	20.0%	0.0%	18.2%	20.0%
Suspended	New Generation	2.3%	3.6%	0.0%	2.8%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	1.3%	0.0%
	Upgrade	0.4%	5.7%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Withdrawn	New Generation	64.7%	70.4%	82.8%	66.6%	80.0%	75.5%	69.2%	79.5%	32.8%	69.2%	44.5%	66.7%
	Upgrade	23.3%	37.1%	18.8%	25.0%	16.4%	10.0%	48.1%	14.3%	20.0%	33.3%	31.8%	20.0%
Active	New Generation	12.9%	8.9%	0.0%	13.2%	0.0%	0.0%	0.0%	0.0%	33.6%	0.0%	5.2%	0.0%
	Upgrade	17.7%	17.1%	4.7%	14.3%	14.5%	10.0%	0.0%	0.0%	40.0%	0.0%	4.5%	20.0%

Table 12-23 shows the nameplate capacity of projects in the PJM generation queue by technology type and project classification. For example, the 348 new generation wind projects that have been withdrawn from the queue as of March 31, 2016, listed in Table 12-21, include 54,435.5 MW of capacity. The 372 natural gas projects that have been withdrawn in the same time period include 174,261.4 MW of nameplate generating capacity.

**Table 12-23 Status of all generation capacity (MW) in the PJM generation queue: January 1, 1997 through March 31, 2016**

Project Status	Project Classification	Project MW												TOTAL
		Natural Gas	Wind	Coal	Solar	Nuclear	Hydro	Oil	Biomass	Storage	Other	LFG	Diesel	
In Service	New Generation	20,448.9	6,881.3	1,378.0	571.6	9.0	465.6	607.0	253.8	139.0	50.0	366.6	69.5	31,240.2
	Upgrade	5,966.9	33.7	755.5	8.9	3,730.8	605.6	125.8	28.8	36.4	547.5	37.5	25.3	11,902.6
Under Construction	New Generation	16,891.1	4,075.7	1,790.0	884.3	1,594.0	123.1	0.0	17.9	65.7	132.0	41.5	0.0	25,615.2
	Upgrade	1,205.1	0.0	84.0	5.0	102.0	0.0	0.0	62.5	72.0	0.0	11.8	25.0	1,567.2
Suspended	New Generation	1,988.3	3,231.6	0.0	242.5	0.0	0.0	0.0	0.0	0.0	0.0	4.9	0.0	5,467.2
	Upgrade	1.6	75.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	76.6
Withdrawn	New Generation	174,261.4	54,435.4	31,721.6	7,303.2	6,567.0	1,988.0	1,721.0	1,242.7	488.6	711.8	396.8	63.9	280,901.5
	Upgrade	7,786.9	289.0	815.0	47.8	916.0	56.0	589.0	12.1	32.0	24.0	39.4	4.0	10,611.2
Active	New Generation	32,998.5	8,109.7	0.0	3,191.0	0.0	0.0	0.0	0.0	505.8	0.0	49.1	0.0	44,854.1
	Upgrade	3,560.5	194.2	83.0	193.9	130.0	74.0	0.0	0.0	110.0	0.0	4.0	6.1	4,355.7
Total Projects	New Generation	246,588.2	76,733.8	34,889.6	12,192.5	8,170.0	2,576.7	2,328.0	1,514.4	1,199.1	893.8	858.8	133.4	388,078.3
	Upgrade	18,521.0	591.9	1,737.5	255.6	4,878.8	735.6	714.8	103.4	250.4	571.5	92.7	60.4	28,513.5

Table 12-24 shows the MW in Table 12-23 by share by classification as new generation or upgrade. Within a fuel type the shares of upgrades add to 100 percent and the shares of new generation add to 100 percent. For example, 43.5 percent of all coal projects classified as upgrades are currently in service in PJM, 4.8 percent are under construction, 46.9 percent were withdrawn and 4.8 percent are active.

**Table 12-24 Status of all generation queue projects as percent of total MW in project classification: January 1, 1997 through March 31, 2016**

Project Status	Project Classification	Percent of Total Project MW by Classification											
		Natural Gas	Wind	Coal	Solar	Nuclear	Hydro	Oil	Biomass	Storage	Other	LFG	Diesel
In Service	New Generation	8.3%	9.0%	3.9%	4.7%	0.1%	18.1%	26.1%	16.8%	11.6%	5.6%	42.7%	52.1%
	Upgrade	32.2%	5.7%	43.5%	3.5%	76.5%	82.3%	17.6%	27.9%	14.5%	95.8%	40.5%	41.9%
Under Construction	New Generation	6.8%	5.3%	5.1%	7.3%	19.5%	4.8%	0.0%	1.2%	5.5%	14.8%	4.8%	0.0%
	Upgrade	6.5%	0.0%	4.8%	2.0%	2.1%	0.0%	0.0%	60.4%	28.8%	0.0%	12.7%	41.4%
Suspended	New Generation	0.8%	4.2%	0.0%	2.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.6%	0.0%
	Upgrade	0.0%	12.7%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Withdrawn	New Generation	70.7%	70.9%	90.9%	59.9%	80.4%	77.2%	73.9%	82.1%	40.7%	79.6%	46.2%	47.9%
	Upgrade	42.0%	48.8%	46.9%	18.7%	18.8%	7.6%	82.4%	11.7%	12.8%	4.2%	42.5%	6.6%
Active	New Generation	13.4%	10.6%	0.0%	26.2%	0.0%	0.0%	0.0%	0.0%	42.2%	0.0%	5.7%	0.0%
	Upgrade	19.2%	32.8%	4.8%	75.9%	2.7%	10.1%	0.0%	0.0%	43.9%	0.0%	4.3%	10.1%

Table 12-25 shows the status of all gas projects by number of projects that entered PJM generation queues from January 1, 1997 through March 31, 2016, by zone.

**Table 12-25 Status of all natural gas generation queue projects: January 1, 1997 through March 31, 2016**

Project Status	Project Classification	Number of Projects																				
		AECO	AEP	AP	ATSI	BGE	ComEd	DAY	DEOK	Dominion	DPL	DLCO	EKPC	JCPL	Met-Ed	PECO	PENELEC	Pepco	PPL	PSEG	RECO	TOTAL
In Service	New Generation	7	1	7	0	5	2	0	1	4	7	0	0	8	3	6	5	6	8	12	0	82
	Upgrade	7	6	6	1	1	8	6	0	26	14	0	0	5	1	10	4	4	6	23	0	128
Under Construction	New Generation	0	3	1	2	2	0	0	1	3	0	1	0	1	0	2	5	4	6	3	0	34
	Upgrade	0	7	2	0	0	6	0	0	3	2	0	0	1	0	2	0	2	1	2	0	28
Suspended	New Generation	3	1	6	0	0	0	0	0	0	1	0	0	0	0	2	0	0	0	0	0	13
	Upgrade	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	1
Withdrawn	New Generation	20	11	32	10	8	6	0	1	16	15	2	2	20	24	42	40	33	37	51	2	372
	Upgrade	4	0	4	3	0	1	0	1	7	4	0	0	5	6	2	5	3	4	13	0	62
Active	New Generation	4	5	9	7	0	11	0	0	1	1	0	1	5	3	1	15	0	6	5	0	74
	Upgrade	3	9	4	2	0	4	0	0	5	0	0	0	1	1	3	2	2	5	6	0	47
Total Projects	New Generation	34	21	55	19	15	19	0	3	24	24	3	3	34	30	51	67	43	57	71	2	575
	Upgrade	14	22	16	6	1	19	6	1	41	20	0	0	12	8	17	12	11	16	44	0	266

Table 12-26 shows the status of all gas projects by MW that entered PJM generation queues from January 1, 1997 through March 31, 2016, by zone.

**Table 12-26 Status of all natural gas generation capacity (MW) in the PJM generation queue: January 1, 1997 through March 31, 2016**

Project Status	Project Classification	Project MW																				
		AECO	AEP	AP	ATSI	BGE	ComEd	DAY	DEOK	Dominion	DPL	DLCO	EKPC	JCPL	Met-Ed	PECO	PENELEC	Pepco	PPL	PSEG	RECO	TOTAL
In Service	New Generation	1,016.2	580.0	1,701.0	0.0	134.0	629.0	0.0	20.0	3,211.0	1,122.2	0.0	0.0	2,070.3	1,397.0	2,464.0	1,207.4	115.0	1,976.9	2,804.9	0.0	20,448.9
	Upgrade	265.7	107.0	796.7	40.0	2.5	784.0	60.0	0.0	1,363.7	193.0	0.0	0.0	224.0	10.0	800.5	29.5	61.1	327.3	901.9	0.0	5,966.9
Under Construction	New Generation	0.0	2,452.0	930.0	1,599.0	257.3	0.0	0.0	513.0	3,315.1	0.0	205.0	0.0	440.0	0.0	760.5	108.6	2,374.0	3,924.0	12.6	0.0	16,891.1
	Upgrade	0.0	178.0	16.0	0.0	0.0	112.6	0.0	0.0	225.0	7.0	0.0	0.0	200.0	0.0	132.0	0.0	124.5	0.0	210.0	0.0	1,205.1
Suspended	New Generation	1,058.0	525.0	76.1	0.0	0.0	0.0	0.0	0.0	0.0	291.0	0.0	0.0	0.0	0.0	0.0	38.2	0.0	0.0	0.0	0.0	1,988.3
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.6	0.0	0.0	0.0	0.0	1.6
Withdrawn	New Generation	6,916.9	5,535.0	14,361.7	5,361.0	3,122.1	3,621.0	0.0	134.5	10,421.0	4,545.4	665.0	377.8	9,816.4	11,439.5	23,120.0	14,484.9	20,414.2	17,081.7	22,836.5	6.9	174,261.4
	Upgrade	115.3	0.0	567.0	86.0	0.0	10.0	0.0	36.0	305.3	668.0	0.0	0.0	253.0	1,730.0	205.0	1,040.6	85.0	480.0	2,205.7	0.0	7,786.9
Active	New Generation	734.5	3,381.0	3,372.9	4,106.7	0.0	4,896.3	0.0	0.0	884.5	451.0	0.0	1,150.0	2,736.8	2,311.5	220.0	4,169.1	0.0	2,078.8	2,505.4	0.0	32,998.5
	Upgrade	154.5	835.0	75.0	301.0	0.0	570.0	0.0	0.0	412.3	0.0	0.0	0.0	0.0	34.1	109.0	98.5	144.1	657.0	170.0	0.0	3,560.5
Total Projects	New Generation	9,725.6	12,473.0	20,441.7	11,066.7	3,513.4	9,146.3	0.0	667.5	17,831.6	6,409.6	870.0	1,527.8	15,063.5	15,148.0	26,564.5	20,008.2	22,903.2	25,061.4	28,159.4	6.9	246,588.2
	Upgrade	535.5	1,120.0	1,454.7	427.0	2.5	1,476.6	60.0	36.0	2,306.3	868.0	0.0	0.0	677.0	1,774.1	1,246.5	1,170.2	414.7	1,464.3	3,487.6	0.0	18,521.0

Table 12-27 shows the status of all wind generation projects that entered PJM generation queues from January 1, 1997 through March 31, 2016, by zone. There were 319 wind projects in ComEd, AEP and PENELEC, 64.6 percent of all wind projects in PJM generation queues. Of the 73 wind projects to achieve in service status, 64 projects, 87.7 percent are located within ComEd, AEP, AP and PENELEC. Of the 50 wind projects currently active in the PJM generation queue, 38 projects, 76.0 percent are located within AEP, ComEd and AP.

**Table 12-27 Status of all wind generation queue projects: January 1, 1997 through March 31, 2016**

Project Status	Project Classification	Number of Projects																				
		AECO	AEP	AP	ATSI	BGE	ComEd	DAY	DEOK	Dominion	DPL	DLCO	EKPC	JCPL	Met-Ed	PECO	PENELEC	Pepco	PPL	PSEG	RECO	TOTAL
In Service	New Generation	1	8	11	0	0	16	0	0	0	0	0	0	0	0	0	19	0	4	0	0	59
	Upgrade	0	0	3	0	0	1	0	0	0	0	0	0	0	0	0	6	0	4	0	0	14
Under Construction	New Generation	0	10	3	1	0	4	0	0	4	2	0	0	0	0	0	1	0	0	0	0	25
	Upgrade	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Suspended	New Generation	2	6	0	0	0	2	2	0	2	0	0	0	0	0	0	3	0	1	0	0	18
	Upgrade	1	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2
Withdrawn	New Generation	14	72	36	6	0	88	13	0	13	6	0	1	0	0	0	60	0	38	1	0	348
	Upgrade	1	0	6	0	0	1	0	0	0	0	0	0	0	0	0	3	0	2	0	0	13
Active	New Generation	0	18	5	1	0	10	0	0	3	2	0	0	0	0	0	2	0	3	0	0	44
	Upgrade	0	0	3	0	0	2	0	0	0	0	0	0	0	0	0	1	0	0	0	0	6
Total Projects	New Generation	17	114	55	8	0	120	15	0	22	10	0	1	0	0	0	85	0	46	1	0	494
	Upgrade	2	0	13	0	0	4	0	0	0	0	0	0	0	0	0	10	0	6	0	0	35

Table 12-28 Status of all wind generation capacity (MW) in the PJM generation queue: January 1, 1997 through March 31, 2016 Table 12-28 shows the wind project capacity in MW of all wind generation projects that have entered the PJM generation queue from January 1, 1997 through March 31, 2016, by zone. Wind projects in ComEd, AEP and PENELEC accounted for 56,069 MW, or 72.5 of all nameplate wind generation capacity in the PJM generation queue. Of the 6,915 MW of wind generation capacity to complete the generation queue process and achieve in service status, 6,681 MW, or 96.6 percent of nameplate capacity is located within ComEd, AEP, AP and PENELEC. Of the 8,304 MW of wind generation capacity currently active in the PJM generation queue, 6,892 MW of generation capacity or 83.0 percent is located within AEP, ComEd and AP.

**Table 12-28 Status of all wind generation capacity (MW) in the PJM generation queue: January 1, 1997 through March 31, 2016**

Project Status	Project Classification	Project MW																				
		AECO	AEP	AP	ATSI	BGE	ComEd	DAY	DEOK	Dominion	DPL	DLCO	EKPC	JCPL	Met-Ed	PECO	PENELEC	Pepco	PPL	PSEG	RECO	TOTAL
In Service	New Generation	7.5	2,052.0	1,031.4	0.0	0.0	2,634.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	956.7	0.0	199.2	0.0	0.0	6,881.3
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6.4	0.0	27.3	0.0	0.0	33.7
Under Construction	New Generation	0.0	1,446.6	298.0	500.0	0.0	802.5	0.0	0.0	740.3	250.0	0.0	0.0	0.0	0.0	0.0	38.3	0.0	0.0	0.0	0.0	4,075.7
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Suspended	New Generation	368.0	1,170.0	0.0	0.0	0.0	710.0	300.0	0.0	373.6	0.0	0.0	0.0	0.0	0.0	0.0	210.0	0.0	100.0	0.0	0.0	3,231.6
	Upgrade	5.0	0.0	70.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	75.0
Withdrawn	New Generation	3,278.4	13,504.2	2,653.5	645.6	0.0	20,855.8	1,828.0	0.0	1,837.9	2,155.0	0.0	150.3	0.0	0.0	0.0	5,009.0	0.0	2,497.8	20.0	0.0	54,435.5
	Upgrade	0.0	0.0	100.0	0.0	0.0	4.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	179.0	0.0	6.0	0.0	0.0	289.0
Active	New Generation	0.0	4,309.6	547.8	18.0	0.0	1,860.0	0.0	0.0	358.2	499.6	0.0	0.0	0.0	0.0	0.0	150.0	0.0	366.5	0.0	0.0	8,109.7
	Upgrade	0.0	0.0	24.2	0.0	0.0	150.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	20.0	0.0	0.0	0.0	0.0	194.2
Total Projects	New Generation	3,653.9	22,482.4	4,530.7	1,163.6	0.0	26,862.8	2,128.0	0.0	3,310.0	2,904.6	0.0	150.3	0.0	0.0	0.0	6,364.0	0.0	3,163.5	20.0	0.0	76,733.8
	Upgrade	5.0	0.0	194.2	0.0	0.0	154.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	205.4	0.0	33.3	0.0	0.0	591.9

Table 12-29 shows the status of all solar generation projects that have entered the PJM generation queue from January 1, 1997 through March 31, 2016, by zone. Solar projects have been highly concentrated in several zones as of March 31, 2016. Out of a total 886 solar projects in the PJM generation queue, 573 projects or 66.7 percent are in JCPL, AECO, DPL and PSEG. Of these four zones, AECO has the lowest completion rates for new generation and upgrade solar projects. Excluding currently active projects, only 5.8 percent of solar projects classified as new generation or upgrades in AECO are either in service or under construction. Of these four zones, PSEG has the highest completion rates. Excluding currently active projects, 41.2 percent of solar projects classified as either new generation or upgrades in PSEG are either in service or under construction.

The number of currently active new generation solar projects is also highly concentrated in several zones. Out of 113 active new generation projects, 89 projects, or 78.8 percent of all currently active new generation solar projects, are located in Dominion, AP and DPL.

**Table 12-29 Status of all solar generation queue projects: January 1, 1997 through March 31, 2016**

Project Status	Project Classification	Number of Projects																				
		AECO	AEP	AP	ATSI	BGE	ComEd	DAY	DEOK	Dominion	DPL	DLCO	EKPC	JCPL	Met-Ed	PECO	PENELEC	Pepco	PPL	PSEG	RECO	TOTAL
In Service	New Generation	5	1	2	0	0	1	0	0	6	3	0	0	22	0	1	0	0	2	33	0	76
	Upgrade	0	0	0	0	0	0	0	0	2	0	0	0	3	0	0	0	0	0	0	0	5
Under Construction	New Generation	4	1	5	0	2	0	3	0	5	14	0	0	29	1	0	0	0	3	7	0	74
	Upgrade	0	0	0	0	0	0	0	0	1	9	0	0	2	0	0	0	0	0	0	0	12
Suspended	New Generation	0	4	2	0	0	0	0	0	1	0	0	0	14	0	0	1	0	0	2	0	24
	Upgrade	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Withdrawn	New Generation	145	14	34	6	3	7	4	4	34	71	0	0	136	11	6	10	7	24	55	0	571
	Upgrade	1	1	0	0	0	0	0	0	1	0	0	0	4	0	0	0	0	0	0	0	7
Active	New Generation	6	8	23	0	1	0	0	1	47	19	0	0	4	0	0	0	0	0	4	0	113
	Upgrade	0	0	0	0	0	0	0	0	4	0	0	0	0	0	0	0	0	0	0	0	4
Total Projects	New Generation	160	28	66	6	6	8	7	5	93	107	0	0	205	12	7	11	7	29	101	0	858
	Upgrade	1	1	0	0	0	0	0	0	8	9	0	0	9	0	0	0	0	0	0	0	28

Table 12-30 shows the MW for solar projects in the generation queue. Dominion, JCPL and DPL accounted for 657 MW of nameplate solar capacity, 74.3 percent of all new generation solar generation capacity currently under construction.

**Table 12-30 Current status of all solar generation capacity (MW) in the PJM generation queue: January 1, 1997 through March 31, 2016**

Project Status	Project Classification	Project MW																				
		AECO	AEP	AP	ATSI	BGE	ComEd	DAY	DEOK	Dominion	DPL	DLCO	EKPC	JCPL	Met-Ed	PECO	PENELEC	Pepco	PPL	PSEG	RECO	TOTAL
In Service	New Generation	38.5	2.5	34.0	0.0	0.0	9.0	0.0	0.0	157.0	22.4	0.0	0.0	140.3	0.0	3.3	0.0	0.0	15.0	149.6	0.0	571.6
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3.1	0.0	0.0	0.0	5.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	8.9
Under Construction	New Generation	28.7	20.0	54.5	0.0	22.0	0.0	25.9	0.0	243.5	177.5	0.0	0.0	236.0	3.0	0.0	0.0	0.0	16.0	57.2	0.0	884.3
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4.5	0.0	0.0	0.0	0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5.0
Suspended	New Generation	0.0	51.7	7.0	0.0	0.0	0.0	0.0	0.0	5.0	0.0	0.0	0.0	155.6	0.0	0.0	13.5	0.0	0.0	9.7	0.0	242.5
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Withdrawn	New Generation	1,600.9	309.2	652.3	60.1	4.2	84.8	51.5	63.0	1,170.2	998.5	0.0	0.0	1,135.4	367.0	51.4	34.3	62.1	267.7	390.6	0.0	7,303.2
	Upgrade	10.0	6.0	0.0	0.0	0.0	0.0	0.0	0.0	8.0	0.0	0.0	0.0	23.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	47.8
Active	New Generation	41.5	47.5	282.3	0.0	1.1	0.0	0.0	125.0	2,013.9	619.3	0.0	0.0	44.6	0.0	0.0	0.0	0.0	0.0	15.8	0.0	3,191.0
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	193.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	193.9
Total Projects	New Generation	1,709.6	430.9	1,030.1	60.1	27.3	93.8	77.4	188.0	3,589.6	1,817.7	0.0	0.0	1,711.9	370.0	54.7	47.8	62.1	298.7	623.0	0.0	12,192.5
	Upgrade	10.0	6.0	0.0	0.0	0.0	0.0	0.0	0.0	209.5	0.0	0.0	0.0	30.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	255.6

## Role of Transmission Owners in Transmission Planning Study Phase

According to PJM Manual 14A, PJM, in coordination with the TOs, conducts the feasibility, system impact and facilities studies for every interconnection queue project. It is clear that the TOs perform the studies.<sup>25</sup> The coordination begins with PJM identifying transmission issues resulting from the generation projects. The TOs perform the studies and provide the mitigation requirements. A facilities study is required only for new generation and significant generation additions. For a facilities study, the interconnected TO (ITO) and any other affected TOs are required to conduct their own facilities study and provide a summary and results to PJM. PJM compiles these results, along with inputs from the developer, into PJM's models to confirm that the TOs' defined upgrades will resolve the issue. PJM writes the final facilities report, which includes the inputs, a description of the issues to be resolved, and the findings of all contributing TOs.<sup>26</sup>

Of 651 active projects analyzed, the developer and TO are part of the same company for 48 of the projects, or 7,697.0 MW of a total 81,936.3 MW, or

9.4 percent. Where the TO is a vertically integrated company that also owns generation, there is a potential conflict of interest when the TO evaluates the interconnection requirements of new generation which is part of the same company. There is also a potential conflict of interest when the transmission owner evaluates the interconnection requirements of new generation which is a competitor to the generation of its parent company.

Table 12-31 is a summary of the number of projects and total MW, by transmission owner parent company, which identifies the number of projects for which the developer and transmission owner are part of the same company. The Dominion Zone has nine related projects which account for 4,370.9 MW, 46.2 percent of the total MW currently in the queue in the Dominion Zone. Of that, 2,745.1 MW (62.8 percent) are natural gas projects, 1,594.0 MW are nuclear, and 31.8 MW are renewable. Renewable projects comprise 4,009.6 MW, 65.7 percent, of unrelated projects in the queue in the Dominion Zone. In contrast, the AEP Zone has 12 related projects, but they account for only 2.5 percent of its total MW currently in the queue.

<sup>25</sup> See PJM, OATT, Part VI, § 210.

<sup>26</sup> See PJM, "Manual 14A: "Generation and Transmission Interconnection Process," Revision 17, (January 22, 2015), <<http://www.pjm.com/documents/manuals.aspx>>.

Table 12-31 Summary of project developer relationship to TO parent company

Parent Company	Number of Projects		Percent Related	Total MW		Percent Related
	Related	Unrelated		Related	Unrelated	
AEP	12	83	12.6%	370.2	14,620.2	2.5%
AES	3	5	37.5%	34.5	325.3	9.6%
DLCO	0	2	0.0%	0.0	225.0	0.0%
Dominion	9	76	10.6%	4,370.9	6,101.4	41.7%
Duke	0	5	0.0%	0.0	654.4	0.0%
Exelon	0	1	0.0%	0.0	1,150.0	0.0%
First Energy	12	94	11.3%	446.0	10,698.6	4.0%
Pepco	1	202	0.5%	1,710.0	23,654.6	6.7%
PPL	0	86	0.0%	0.0	7,375.2	0.0%
PSEG	0	29	0.0%	0.0	7,193.3	0.0%
EKPC	11	20	35.5%	765.4	2,241.3	25.5%
Total	48	603	7.4%	7,697.0	74,239.3	9.4%

These projects are shown by fuel type in Table 12-32. Natural gas generators comprise 50.4 percent of the total related MW in this table. Developers of coal and nuclear projects are almost entirely related to the TO, with 93.5 percent and 100.0 percent of MW. Developers are related to the TO for 6.8 percent of the natural gas project MW in the queue, 8.2 percent of the storage project MW, and 17.3 percent of the hydro project MW. All other fuel types projects have no more than 1.3 percent of MW in development related to the TO.

Table 12-32 Developer-transmission owner relationship by fuel type

Parent Company	Transmission Owner	Related to Developer	Number of Projects	MW by Fuel Type											Total MW
				Biomass	Coal	Diesel	Hydro	Landfill Gas	Natural Gas	Nuclear	Other	Solar	Storage	Wind	
AEP	AEP	Related	12	0.0	83.0	0.0	34.0	0.0	137.0	102.0	0.0	12.2	2.0	0.0	370.2
		Unrelated	83	0.0	128.0	0.0	100.0	13.0	7,234.0	0.0	0.0	107.0	112.0	6,926.2	14,620.2
AES	DAY	Related	3	0.0	12.0	0.0	0.0	0.0	0.0	0.0	0.0	2.5	20.0	0.0	34.5
		Unrelated	5	1.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	23.4	0.0	300.0	325.3
DLCO	DLCO	Unrelated	2	0.0	0.0	0.0	0.0	0.0	205.0	0.0	0.0	0.0	20.0	0.0	225.0
Dominion	Dominion	Related	9	0.0	0.0	0.0	0.0	0.0	2,745.1	1,594.0	0.0	19.8	0.0	12.0	4,370.9
		Unrelated	76	62.5	0.0	0.0	0.0	12.0	2,091.8	0.0	0.0	2,441.0	34.0	1,460.1	6,101.4
Duke	DEOK	Unrelated	5	0.0	0.0	0.0	0.0	6.4	513.0	0.0	0.0	125.0	10.0	0.0	654.4
EKPC	EKPC	Unrelated	1	0.0	0.0	0.0	0.0	0.0	1,150.0	0.0	0.0	0.0	0.0	0.0	1,150.0
Exelon	BGE	Related	3	0.0	0.0	0.0	0.0	0.0	256.0	0.0	0.0	20.0	20.0	0.0	296.0
		Unrelated	27	0.0	0.0	25.0	0.4	4.0	1.3	0.0	132.0	3.1	0.1	0.0	165.9
	ComEd	Related	4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	80.0	0.0	0.0	0.0	80.0
		Unrelated	54	0.0	0.0	0.0	22.7	46.1	5,578.9	0.0	0.0	0.0	111.1	3,522.5	9,281.3
	PECO	Related	5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	50.0	0.0	0.0	20.0	0.0
Unrelated		12	0.0	0.0	6.1	0.0	2.0	1,221.5	0.0	0.0	0.0	20.8	0.0	1,250.4	
First Energy	AP	Related	1	0.0	1,710.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,710.0
		Unrelated	72	0.0	0.0	0.0	0.0	15.2	4,470.0	0.0	0.0	343.8	73.0	940.0	5,842.0
	ATSI	Unrelated	18	0.0	0.0	0.0	0.0	5.6	6,006.7	0.0	0.0	0.0	12.5	518.0	6,542.8
	JCPL	Unrelated	72	0.0	0.0	0.0	0.0	0.0	3,376.8	0.0	0.0	436.7	181.0	0.0	3,994.5
	Met-Ed	Unrelated	5	0.0	0.0	0.0	0.0	0.0	2,345.6	0.0	0.0	3.0	0.0	0.0	2,348.6
	PENELEC	Unrelated	36	0.0	0.0	0.0	40.0	0.0	4,416.0	0.0	0.0	13.5	40.0	418.3	4,927.8
Pepco	AECO	Unrelated	25	0.0	0.0	0.0	0.0	0.0	1,947.0	0.0	0.0	70.2	21.0	373.0	2,411.2
	DPL	Unrelated	53	0.0	0.0	0.0	0.0	2.0	749.0	0.0	0.0	796.8	24.0	749.6	2,321.4
	Pepco	Unrelated	8	0.0	0.0	0.0	0.0	0.0	2,642.6	0.0	0.0	0.0	0.0	0.0	2,642.6
PPL	PPL	Unrelated	29	16.0	0.0	0.0	0.0	5.0	6,659.8	0.0	0.0	16.0	30.0	466.5	7,193.3
PSEG	PSEG	Related	11	0.0	24.0	0.0	0.0	0.0	738.0	0.0	0.0	3.4	0.0	0.0	765.4
		Unrelated	20	0.0	0.0	0.0	0.0	0.0	2,160.0	0.0	0.0	79.3	2.0	0.0	2,241.3
Total		Related	48	0.0	1,829.0	0.0	34.0	0.0	3,876.1	1,826.0	0.0	57.9	62.0	12.0	7,697.0
		Unrelated	603	80.4	128.0	31.1	163.1	111.3	52,769.0	0.0	132.0	4,458.8	691.5	15,674.2	74,239.3


## Regional Transmission Expansion Plan (RTEP)

PJM's Transmission Expansion Advisory Committee (TEAC), made up of PJM staff, is responsible for the Regional Transmission Expansion Plan (RTEP).<sup>27</sup> Transmission upgrades can be divided into three categories: network, supplemental, and baseline. Network upgrades are initiated by generation queue projects and are funded by the developers of the generation projects. Supplemental upgrades are initiated and funded by the TOs. Baseline upgrades are initiated by the TEAC to resolve market efficiency and reliability criteria violations not addressed in other ways. Per FERC Order 1000, the TEAC solicits proposals via fixed proposal windows to address these needs. The TEAC evaluates the proposals and recommends proposals to the PJM Board of Managers for approval. All approved baseline projects are added to the RTEP via amendments to the tariff. Retired generators are included in this analysis for one year after their retirement to reflect the ownership of CIRs.

### RTEP Cost Allocation

The costs of RTEP baseline projects are allocated to all transmission owners, based on the size of the project, the facility voltage, and whether the project addresses a reliability issue or market efficiency. In addition, the allocation methods attempt to distribute the costs proportionally with respect to who will benefit from the upgrade. The allocation rules are summarized in Figure 12-3.

Figure 12-3 RTEP cost allocation rules

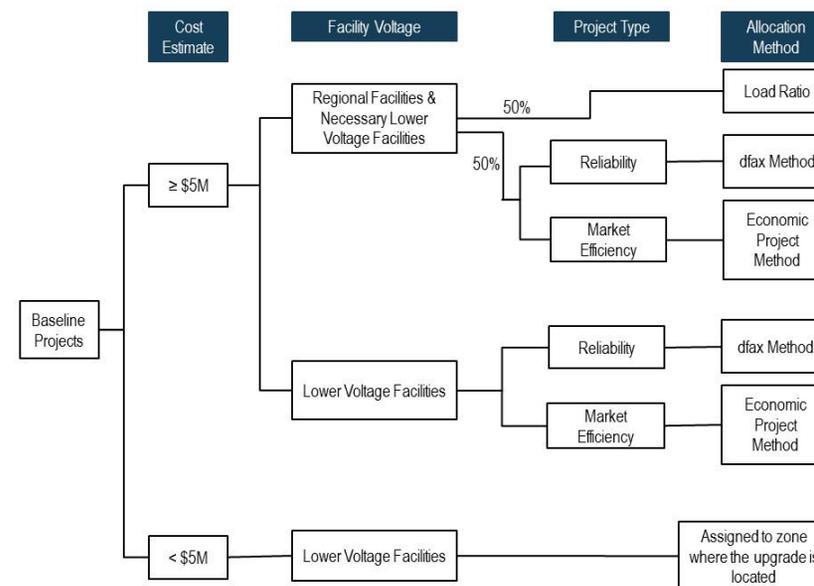

For reliability projects, upgrade costs are allocated based on distribution factors (dfax). The distribution factors used in the current allocation method are a measure of the use of the transmission upgrade by zonal loads and by merchant transmission facilities, based on power flow analysis. Under this allocation method (solutions based method), a zone with a distribution factor less than 0.01 is not allocated any costs regardless of its load on the line.<sup>28</sup> This approach to cost allocation replaced the earlier method which was based on distribution factors as a measure of contributions to the reasons for the transmission upgrade.<sup>29</sup>

<sup>27</sup> See PJM, "Manual 14B: PJM Region Transmission Planning Process," Revision 30 (February 26, 2015), Section 2, p.14.

<sup>28</sup> OATT, Schedule 12(b)(iii), (p.595)

<sup>29</sup> See *PJM Interconnection, LLC*, 142 FERC ¶ 61,214 (2013).

## Cost Allocation Issues

The RTEP Baseline Upgrade filings, ER14-972-000 on January 10, 2014, and ER14-1485-000 on March 13, 2014, represented the first time the new allocation rules were used. They resulted in approximately \$1.5 billion in additional baseline transmission enhancements and expansions. PJM approved additional RTEP upgrades (Docket Nos. ER15-2562 and ER15-2563) on July 29, 2015.

In response to complaints about the cost allocations in these filings, on November 24, 2015, FERC accepted, and immediately suspended for five months, both of the July 29, 2015 filings. FERC concluded that “the proposed Tariff amendments have not been shown to be just and reasonable.”<sup>30</sup>

FERC ordered a technical conference, which took place on January 12, 2016, to address the complaints in proceedings EL15-18-000 (ConEd), EL15-67-000 (Linden), and EL15-95-000 (Artificial Island). FERC identified two main discussion points: Whether there is “a definable category of reliability projects within PJM for which the solution-based dfax cost allocation method may not be just and reasonable” and whether there is “an alternative just and reasonable ex ante cost allocation method that could be established for any such category of projects.”<sup>31</sup>

The issues identified in the complaints and at the technical conference include: whether the solutions based allocation method is appropriate for upgrades not related to transmission overload issues; whether the solutions based allocation method correctly identifies all the beneficiaries of the upgrades; whether it is reasonable to allocate a level of costs to a merchant transmission project that could force bankruptcy; and whether the significant shifts in allocation that result from use of the .01 distribution factor cutoff are appropriate.

On April 22, 2016, FERC denied all of the complaints and requests for rehearings in these proceedings.<sup>32</sup> The Commission found that the cost allocations were just and reasonable and that the solutions based DFAX method is appropriate

<sup>30</sup> 153 FERC ¶ 61,245 (November 24, 2015).

<sup>31</sup> “Supplemental Notice of Technical Conference re PJM Interconnection, LLC et al under ER15-2562 et al,” Docket No. E15-95-000 (December 30, 2015).

<sup>32</sup> 155 FERC ¶ 61,088; 155 FERC ¶ 61,091.

for all RTEP projects, including the ones disputed in these complaints. Commissioner LaFleur dissented, stating that the arguments presented by the complainants did adequately identify a class of upgrades where the solution based DFAX method is not appropriate.<sup>33</sup> Commissioner LaFleur recommended that the Commission direct PJM to develop an alternative ex ante approach for this type of project.<sup>34</sup>

The MMU recognizes that the allocation issues are difficult. Nonetheless the allocation methods affect the efficiency of the markets and the incentives for merchant transmission owners to compete to build new transmission. It appears that use of the arbitrary .01 distribution factor cutoff can result in large shifts in cost allocation. It also appears that if the intent of the use of the .01 cutoff is to help eliminate small, arbitrary cost allocations to geographically distant areas, another approach would be to add a threshold for a minimum usage impact on the line. The MMU recommends consideration of changing the minimum distribution factor in the method of allocating costs for baseline projects from .01 to .00 and adding a threshold minimum usage impact on the line.

## TranSource

TranSource LLC filed a complaint against PJM on June 23, 2015, amended February 10, 2016, seeking work papers explaining how PJM performed System Impact Studies (SIS) for three TranSource transmission projects.<sup>35</sup> TranSource complains, in addition, that PJM “fail[ed] to provide TranSource with open access on a nondiscriminatory basis to the PJM transmission planning process and to Auction Revenue Rights (ARR) associated with transmission upgrades” and “violated its requirement to provide TranSource with a transparent, replicable process for evaluating transmission upgrade requests.”<sup>36</sup> PJM responded that it has provided all work papers relevant to the SIS and objects to the complaint on procedural grounds.<sup>37</sup> On September

<sup>33</sup> 155 FERC ¶ 61,088 (LaFleur dissent).

<sup>34</sup> *Id.* at 2.

<sup>35</sup> TranSource Complaint, Amended and Restated Complaint and Request for Fast Track Processing of TranSource, LLC, FERC Docket No. EL15-79-000.

<sup>36</sup> *Id.* at 1-2.

<sup>37</sup> See Motion to Dismiss Complaint and Answer to Complaint Submitted on Behalf of PJM Interconnection, L.L.C., Docket No. EL15-79-000 (July 10, 2015).

24, 2015, the Commission issued an order establishing hearing and settlement judge procedures.<sup>38</sup> The MMU is participating in this process.

## Backbone Facilities

PJM backbone projects are a subset of baseline upgrade projects that have been given the informal designation of backbone due to their relative significance. Backbone upgrades are on the extra high voltage (EHV) system and resolve a wide range of reliability criteria violations and market congestion issues. Designated backbone projects in 2015 included Mount Storm-Doubs, Jacks Mountain, Susquehanna-Roseland, and Surry Skiffes Creek 500kV. Figure 12-4 shows the location of these four projects. Surry Skiffes Creek 500kV is the only remaining active backbone project.

Figure 12-4 PJM Backbone Projects



Two of these projects, Mount Storm-Doubs and Susquehanna-Roseland, were completed in 2015 and are currently in service. The Jacks Mountain backbone project has been cancelled. It was initiated to resolve voltage problems for load deliverability starting June 1, 2017.

38 152 FERC ¶ 61,229.

The Surry Skiffes Creek 500kV was initiated in the fall of 2014 to relieve the overload of the James River Crossing Double Circuit Towerline anticipated to result from the retirement of Chesapeake units 1-4, which occurred in December 2014, and Yorktown 1, which is pending. The initial project includes a new 7.7 mile 500kV line between Surry and Skiffes, a new 20.25 mile 230kV line between Skiffes Creek and Wheelton, and a new Skiffes Creek 500/230kV switching station. PJM's required in service date for the 500kv portion was June 1, 2015. This project has been delayed by legal challenges. BASF Corporation raised environmental concerns with the siting and the design. James City County and James River Association (JCC) argued that the switching station is not part of the transmission line and therefore should be subject to local zoning ordinances. In an April 16, 2015, ruling, the Supreme Court of Virginia rejected BASF's claim but agreed with JCC.<sup>39</sup> On April 30, 2015, Dominion filed a petition for rehearing, which was rejected, and the case was remanded to the State Corporation Commission (SCC). The SCC issued an order on June 5, 2015, stressing the need for this project to be completed, extending the completion date to December 31, 2015.<sup>40</sup> The SCC issued another order on December 4, 2015, temporarily suspending this updated completion date, pending the Army Corps of Engineers' (ACE) issuance of a construction permit.<sup>41</sup> The ACE is currently studying the effects of the project as currently proposed, as well as an alternative approach. The JCC Board will vote on the final action in January, 2016 or later, at which point an energization date can be established.<sup>42</sup>

## Transmission Facility Outages

### Scheduling Transmission Facility Outage Requests

A transmission facility is designated as reportable by PJM if a change in its status can affect a transmission constraint on any Monitored Transmission Facility or could impede free flowing ties within the PJM RTO and/or adjacent

39 BASF Corporation v SCC, et al., Record No. 141009 et al.

40 See Commonwealth of Virginia State Corporation Commission Order in Case No. PUE-2012-00029, June 5, 2015 at <<https://www.dom.com/library/domcom/pdfs/electric-transmission/surry-skiffes-creek/scc-order-060515.pdf>>.

41 See Commonwealth of Virginia State Corporation Commission Order in Case No. PUE-2012-00029, December 4, 2015 at <<https://www.dom.com/library/domcom/pdfs/electric-transmission/surry-skiffes-creek/dec-date-order-120415.pdf?la=en>>.

42 See "Surry-Skiffes Creek 500kV and Skiffes Creek-Wheelton 230kV Projects," which can be accessed at: <<https://www.dom.com/corporate/what-we-do/electricity/transmission-lines-and-projects/surry-skiffes-creek-500kv-and-skiffes-creek-wheelton-230kv-projects>>.

areas.<sup>43</sup> When one of the reportable transmission facilities needs to be taken out of service, the TO is required to submit an outage request as early as possible.<sup>44</sup>

Transmission outages have significant impacts on PJM markets. There are impacts on FTR auctions, on congestion, and on expected market outcomes in the day-ahead and real-time markets. It is important for the efficient functioning of the markets that there be clear, enforceable rules governing transmission outages.

Transmission outages are categorized by duration: greater than 30 calendar days; less than or equal to 30 calendar days and greater than five calendar days; or less than or equal to five calendar days.<sup>45</sup> Table 12-33 shows that 85.6 percent of the requested outages were planned for less than or equal to five days and 1.6 percent of requested outages were planned for greater than 30 days in the first three months of 2016. All of the outage data in this section are for outages scheduled to occur in the first three months of 2015 and 2016, regardless of when they were initially submitted.<sup>46</sup>

**Table 12-33 Transmission facility outage request summary by planned duration: January through March of 2015 and 2016**

Planned Duration (Days)	2015 (Jan - Mar)		2016 (Jan - Mar)	
	Outage Requests	Percent	Outage Requests	Percent
<=5	3,199	74.8%	3,470	85.6%
>5 &lt;=30	746	17.4%	519	12.8%
>30	331	7.7%	63	1.6%
<b>Total</b>	<b>4,276</b>	<b>100.0%</b>	<b>4,052</b>	<b>100.0%</b>

After receiving a transmission facility outage request from a TO, PJM assigns a received status to the request based on its submission date, outage planned starting and ending date, and outage planned duration. The received status can be on time, late or past deadline, as defined in Table 12-34.<sup>47</sup>

<sup>43</sup> If a transmission facility is not modeled in the PJM EMS or the facility is not expected to significantly impact PJM system security or congestion management, it is not reportable. See PJM, "Manual 3A: Energy Management System (EMS) Model Updates and Quality Assurance (QA), Revision 10 (June 25, 2015).

<sup>44</sup> See PJM, "Manual 3: Transmission Operations," Revision 48 (December 1, 2015), p.57.

<sup>45</sup> See PJM, "Manual 3: Transmission Operations," Revision 48 (December 1, 2015), p.58.

<sup>46</sup> The hotline tickets, EMS tripping tickets or test outage tickets were excluded. We only included all the transmission outage tickets submitted by PJM internal companies which are currently active.

<sup>47</sup> See PJM, "Manual 3: Transmission Operations," Revision 48 (December 1, 2015), p.58 and p.59.

The purpose of the rules defined in Table 12-34 is to require the TOs to submit transmission facility outages prior to the Financial Transmission Right (FTR) auctions so that market participants have complete information about market conditions on which to base their FTR bids and so that PJM can accurately model market conditions.<sup>48</sup>

**Table 12-34 PJM transmission facility outage request received status definition**

Planned Duration (Days)	Ticket Submission Date	Received Status
<=5	Before the 1st of the month one month prior to the starting month of the outage	On Time
	After or on the 1st of the month one month prior to the starting month of the outage	Late
	After 8:00AM three days prior to the outage	Past Deadline
> 5 &lt;=30	Before the 1st of the month six months prior to the starting month of the outage	On Time
	After or on the 1st of the month six months prior to the starting month of the outage	Late
	After 8:00AM three days prior to the outage	Past Deadline
>30	The earlier of 1) February 1st, 2) the 1st of the month six months prior to the starting month of the outage	On Time
	After or on the earlier of 1) February 1st, 2) the 1st of the month six months prior to the starting month of the outage	Late
	After 8:00AM three days prior to the outage	Past Deadline

Table 12-35 shows a summary of requests by received status. In the first three months of 2016, 53.9 percent of outage requests received were late.

<sup>48</sup> See "Report of PJM Interconnection, LLC on Transmission Oversight Procedures," Docket No. EL01-122-000 (November 2, 2001).

**Table 12-35 Transmission facility outage request summary by received status: January through March of 2015 and 2016**

Planned Duration (Days)	2015 (Jan - Mar)				2016 (Jan - Mar)			
	On Time	Late	Total	Percent Late	On Time	Late	Total	Percent Late
<=5	1,631	1,568	3,199	49.0%	1,598	1,872	3,470	53.9%
>5 &lt;=30	401	345	746	46.2%	249	270	519	52.0%
>30	120	211	331	63.7%	33	30	63	47.6%
Total	2,152	2,124	4,276	49.7%	1,880	2,172	4,052	53.6%

Once received, PJM processes outage requests in priority order: emergency transmission outage request; transmission outage requests submitted on time; and transmission outage request submitted late. PJM retains the right to deny all transmission outage requests that are submitted past the relevant deadline unless the request is an emergency.<sup>49</sup>

Outages with emergency status will be approved even if submitted past the relevant deadline after PJM determines that the outage does not result in Emergency Procedures. PJM cancels or withholds approval of any outage that results in Emergency Procedures.<sup>50</sup> Table 12-36 is a summary of outage requests by emergency status. Of all outage requests scheduled to occur in the first three months of 2016, 16.2 percent were for emergency outages. Of all outage requests scheduled to occur in the first three months of 2015, 15.4 percent were for emergency outages.

**Table 12-36 Transmission facility outage request summary by emergency: January through March of 2015 and 2016**

Planned Duration (Days)	2015 (Jan - Mar)				2016 (Jan - Mar)			
	Emergency	Non Emergency	Total	Percent Emergency	Emergency	Non Emergency	Total	Percent Emergency
<=5	518	2,681	3,199	16.2%	565	2,905	3,470	16.3%
>5 &lt;=30	107	639	746	14.3%	85	434	519	16.4%
>30	34	297	331	10.3%	6	57	63	9.5%
Total	659	3,617	4,276	15.4%	656	3,396	4,052	16.2%

49 PJM. "Manual 3: Transmission Operations," Revision 48 (December 1, 2015), p. 69.

50 PJM. "Manual 3: Transmission Operations," Revision 48 (December 1, 2015), p. 67 and p.68.

PJM will approve all transmission outage requests that are submitted on time and do not jeopardize the reliability of the PJM system. PJM will approve all transmission outage requests that are submitted late and do not cause congestion on the PJM system and do not jeopardize the reliability of the PJM system.

After PJM determines that a late request may cause congestion, PJM informs the Transmission Owner of solutions available to eliminate the congestion. For example, if a generator planned or maintenance outage request is contributing to the congestion, PJM can request that the Generation Owner defer the outage. If no solutions are available, PJM may require the Transmission Owner to reschedule or cancel the outage. Table 12-37 is a summary of outage requests by congestion status. Of all outage requests submitted to occur in the first three months of 2016, 8.0 percent were expected to cause congestion. Of all the outage requests that were expected to cause congestion, 4.0 percent (13 out of 324) were denied by PJM in the first three months of 2016 (Table 12-39).

**Table 12-37 Transmission facility outage request summary by congestion: January through March of 2015 and 2016**

Planned Duration (Days)	2015 (Jan - Mar)				2016 (Jan - Mar)			
	Congestion Expected	No Congestion Expected	Total	Percent Congestion Expected	Congestion Expected	No Congestion Expected	Total	Percent Congestion Expected
<=5	309	2,890	3,199	9.7%	242	3,228	3,470	7.0%
>5 &lt;=30	84	662	746	11.3%	71	448	519	13.7%
>30	40	291	331	12.1%	11	52	63	17.5%
Total	433	3,843	4,276	10.1%	324	3,728	4,052	8.0%

Table 12-38 shows the outage requests summary by received status, congestion status and emergency status. In the first three months of 2016, 70.0 percent of late requests were non-emergency outages while 5.1 percent of late non-emergency outage requests were expected to cause congestion.

**Table 12-38 Transmission facility outage requests that by received status, congestion and emergency: January through March of 2015 and 2016**

		2015 (Jan - Mar)				2016 (Jan - Mar)			
Submission Status		No Congestion		Percent Congestion	No Congestion		Percent Congestion		
		Expected	Expected		Expected	Expected			
Late	Emergency	24	633	657	3.7%	18	634	652	2.8%
	Non Emergency	73	1,394	1,467	5.0%	78	1,442	1,520	5.1%
On Time	Emergency	0	2	2	0.0%	0	4	4	0.0%
	Non Emergency	336	1,814	2,150	15.6%	228	1,648	1,876	12.2%
Total		433	3,843	4,276	10.1%	324	3,728	4,052	8.0%

Once PJM processes an outage request, the outage request is labelled as submitted, received, denied, approved, cancelled by company, revised, active or complete according to the processed stage of a request.<sup>51</sup> Table 12-39 shows the detailed process status for outage requests only for the outage requests that are expected to cause congestion. All process status categories except cancelled, complete or denied are in the In Process category in Table 12-39. Table 12-39 shows that 71.8 (56 out of 78) percent of late, non-emergency, outage requests which were expected to cause congestion were approved and completed and 4.0 percent (13 out of 324) of the outage requests which were expected to cause congestion were denied in 2015.

**Table 12-39 Transmission facility outage requests that might cause congestion status summary: January through March of 2015 and 2016**

		2015 (Jan - Mar)						2016 (Jan - Mar)					
Submission Status		Cancelled	Complete	In Process	Denied	Congestion		Cancelled	Complete	In Process	Denied	Congestion	
						Expected	Percent Complete					Expected	Percent Complete
Late	Emergency	5	18	0	1	24	75.0%	0	18	0	0	18	100.0%
	Non Emergency	17	46	0	10	73	63.0%	14	56	0	8	78	71.8%
On Time	Emergency	107	211	1	17	336	62.8%	62	161	0	5	228	70.6%
	Non Emergency	0	0	0	0	0	0.0%	0	0	0	0	0	0.0%
Total		129	275	1	28	433	63.5%	76	235	0	13	324	72.5%

There are clear rules defined for assigning on time or late status for submitted outage requests in both the PJM Tariff and PJM Manuals.<sup>52</sup> However, the on

<sup>51</sup> See PJM, "Outage Information," <<http://www.pjm.com/markets-and-operations/etools/oasis/system-information/outage-info.aspx>> (November 1, 2015).

<sup>52</sup> OATT Attachment K Appendix § 1.9.2 (Outage Scheduling).

time or late status only affects the priority that PJM assigns for processing the outage request. Many (71.8 percent) non-emergency, expected to cause congestion, late transmission outages were approved and completed. The expected impact on congestion is the basis for PJM's treatment of late outage requests. But there is no rule or clear definition of this congestion analysis in the PJM Manuals. The MMU recommends that PJM draft a clear definition of the congestion analysis required for transmission outage requests to include in Manual 3 after appropriate review.

## Rescheduling Transmission Facility Outage Requests

A TO can reschedule or cancel an outage after initial submission. Table 12-40 is a summary of all the outage requests planned for the first three months of 2015 and 2016 which were approved and then cancelled or rescheduled by TOs at least once. If an outage request was submitted, approved and subsequently rescheduled at least once, the outage request will be counted as Approved and Rescheduled. If an outage request was submitted, approved and subsequently cancelled at least once, the outage request will be counted as Approved and Cancelled. In the first three months of 2016, 17.9 percent of transmission outage requests were approved by PJM and then rescheduled by

the TOs, and 8.8 percent of the transmission outages were approved by PJM and subsequently cancelled by the TOs.

**Table 12-40 Rescheduled and cancelled transmission outage request summary: January through March of 2015 and 2016**

Days	2015 (Jan - Mar)					2016 (Jan - Mar)				
	Outage Requests	Approved and Rescheduled	Percent Approved and Rescheduled	Approved and Cancelled	Percent Approved and Cancelled	Outage Requests	Approved and Rescheduled	Percent Approved and Rescheduled	Approved and Cancelled	Percent Approved and Cancelled
<=5	3,199	350	10.9%	453	14.2%	3,470	425	12.2%	333	9.6%
>5 Et <=30	746	343	46.0%	50	6.7%	519	263	50.7%	22	4.2%
>30	331	184	55.6%	32	9.7%	63	37	58.7%	3	4.8%
Total	4,276	877	20.5%	535	12.5%	4,052	725	17.9%	358	8.8%

If a requested outage is determined to be late and TO reschedules the outage, the outage will be reevaluated by PJM again as on time or late.

A transmission outage ticket with a duration of five days or less with an on time status can retain its on time status if the outage is rescheduled within the original scheduled month.<sup>53</sup> This rule allows a TO to reschedule within the same month with very little notice.

A transmission outage ticket with a duration exceeding five days with an on time status can retain its on time status if the outage is rescheduled to a future month, and the revision is submitted by the first of the month prior to the revised month in which the outage will occur.<sup>54</sup> This rescheduling rule is much less strict than the rule that applies to the first submission of outage requests with similar duration. When first submitted, the outage request with a duration exceeding five days needs to be submitted before the first of the month six months prior to the month in which the outage was expected to occur.

The MMU recommends that PJM reevaluate all transmission outage tickets as on time or late as if they were new requests when an outage is rescheduled and apply the standard rules for late submissions to any such outages.

## Long Duration Transmission Facility Outage Requests

PJM rules (Table 12-34) define a transmission outage request as on time or late based on the planned outage duration and the time of submission. The rule has stricter submission requirements for transmission outage requests planned for longer than 30 days. In order to avoid the stricter submission requirement, some transmission owners divided the duration of outage requests longer than 30 days into shorter segments for the same equipment and submitted one request for each segment. The MMU recommends that PJM not permit transmission owners to divide long duration outages into smaller segments to avoid complying with the requirements for long duration outages. Table 12-41 shows that there were 3,262 transmission equipment planned outages in the first three months of 2016, of which 76 were planned outages longer than 30 days, and of which 13 or 0.4 percent were scheduled longer than 30 days if the duration of the outages were combined for the same equipment. The duration of those outages could potentially be longer than 30 days, however were divided into shorter periods by transmission owners.

<sup>53</sup> PJM. "Manual 3: Transmission Operations," Revision 48 (December 1, 2015), p. 63.

<sup>54</sup> PJM. "Manual 3: Transmission Operations," Revision 48 (December 1, 2015), p. 64.

**Table 12-41 Transmission outage summary: January through March of 2015 and 2016**

Duration	Divided into Shorter Periods	2015 (Jan - Mar)		2016 (Jan - Mar)	
		Number of Outages	Percent	Number of Outages	Percent
> 30 Days	No	302	9.3%	63	1.9%
	Yes	15	0.5%	13	0.4%
<= 30 Days		2,947	90.3%	3,186	97.7%
Total		3,264	100.0%	3,262	100.0%

Table 12-42 shows the details of potentially long duration (> 30 days) outages when combining the duration of the outages for the same equipment. The actual duration of scheduled outages would be longer than 30 days if the duration of the outages were combined for the same equipment within a period of days. In the first three months of 2016, there would have been one outages with a combined duration longer than 30 days that were instead scheduled to occur as shorter outages within a period of less than or equal to 31 days. In the first three months of 2016, there would have been three outages with a combined duration longer than 30 days that were instead scheduled to occur as shorter outages within a period of more than 62 days and less than 93 days.

**Table 12-42 Summary of potentially long duration (> 30 days) outages: January through March of 2015 and 2016**

Days	2015 (Jan - Mar)		2016 (Jan - Mar)	
	Number of Outages	Percent	Number of Outages	Percent
<=31	5	33.3%	1	7.7%
>31 &lt;=62	5	33.3%	9	69.2%
>62 and <=93	5	33.3%	3	23.1%
>93	0	0.0%	0	0.0%
Total	15	100.0%	13	100.0%

## Transmission Facility Outage Analysis for the FTR Market

Transmission facility outages affect the price and quantity outcomes of FTR auctions. The purpose of the rules is to ensure that outages are known with enough lead time prior to FTR auctions both so that market participants can

understand market conditions and so that PJM can accurately model market conditions. Outage requests must be submitted according to rules based on planned outage duration (Table 12-34). The rules defining when an outage is late are based on the timing of FTR auctions. When an outage request is submitted late, the outage will be marked as late and may be denied if it is expected to cause congestion. Table 12-46 shows that 819 outage requests with a duration of two weeks or longer but shorter than two months were late, and only four of them were denied by PJM. Table 12-46 also shows that 209 outage requests with a duration of two months or longer were late and none of them were denied by PJM in the 2015 to 2016 planning year.

There are Long Term, Annual and Monthly Balance of Planning Period auctions in the FTR market. When modeling transmission outages in the annual ARR allocation and FTR auction, PJM does not consider outages with planned durations shorter than two weeks, does consider some outages with planned duration longer than two weeks but shorter than two months, and does consider all outages with planned duration longer than or equal to two months. PJM posts an FTR outage list to the FTR web page usually at least one week before the auction bidding opening day.<sup>55</sup>

Table 12-43 shows that 89.8 percent of the outage requests for outages expected to occur during the planning period 2015 to 2016 had a planned duration of less than two weeks and that 47.4 (8,880 out of 18,929) percent of all outage requests for the planning period were submitted late according to outage submission rules.

**Table 12-43 Transmission facility outage requests by received status: Planning periods 2014 to 2015 and 2015 to 2016**

Planned Duration	2014/2015				2015/2016			
	On Time	Late	Total	Percent	On Time	Late	Total	Percent
<2 weeks	9,306	8,382	17,688	88.7%	9,039	7,952	16,991	89.8%
>=2 weeks &lt; 2 months	844	896	1,740	8.7%	771	819	1,590	8.4%
>=2 months	201	317	518	2.6%	139	209	348	1.8%
Total	10,351	9,595	19,946	100.0%	9,949	8,980	18,929	100.0%

<sup>55</sup> PJM Financial Transmission Rights, "Annual ARR Allocation and FTR Auction Transmission outage Modeling," <<http://www.pjm.com/~media/markets-ops/ftr/annual-ftr-auction/2015-2016/2015-2016-annual-outage-modeling.ashx>> (April 1, 2015).

Table 12-44 shows outage requests summary by emergency status. Of all outage requests for outages expected to occur in the 2015 to 2016 planning year and submitted late, 74.0 percent were for non-emergency outages.

**Table 12-44 Transmission facility outage requests by received status and emergency: Planning periods 2014 to 2015 and 2015 to 2016**

Planned Duration	2014/2015				2015/2016			
	Emergency	Non Emergency	Total	Percent Non Emergency	Emergency	Non Emergency	Total	Percent Non Emergency
On Time <2 weeks	13	9,293	9,306	99.9%	16	9,023	9,039	99.8%
>=2 weeks & <2 months	0	844	844	100.0%	2	769	771	99.7%
>=2 months	0	201	201	100.0%	0	139	139	100.0%
Total	13	10,338	10,351	99.9%	18	9,931	9,949	99.8%
Late <2 weeks	2,370	6,012	8,382	71.7%	2,161	5,791	7,952	72.8%
>=2 weeks & <2 months	169	727	896	81.1%	138	681	819	83.2%
>=2 months	63	254	317	80.1%	34	175	209	83.7%
Total	2,602	6,993	9,595	72.9%	2,333	6,647	8,980	74.0%

PJM analyzes expected congestion for both on time and late outage requests. A late outage request may be denied or cancelled if it is expected to cause congestion. Table 12-45 shows a summary of requests by expected congestion and received status. Overall, 4.6 percent of all outage requests for outages expected to occur in the 2015 to 2016 planning year and submitted late were requests that were expected to cause congestion.

**Table 12-45 Transmission facility outage requests by submission status and congestion: Planning periods 2014 to 2015 and 2015 to 2016**

Planned Duration	2014/2015				2015/2016			
	Congestion Expected	No Congestion Expected	Total	Percent Congestion Expected	Congestion Expected	No Congestion Expected	Total	Percent Congestion Expected
On Time <2 weeks	1,339	7,967	9,306	14.4%	1,179	7,860	9,039	13.0%
>=2 weeks & <2 months	168	676	844	19.9%	164	607	771	21.3%
>=2 months	38	163	201	18.9%	32	107	139	23.0%
Total	1,545	8,806	10,351	14.9%	1,375	8,574	9,949	13.8%
Late <2 weeks	447	7,935	8,382	5.3%	355	7,597	7,952	4.5%
>=2 weeks & <2 months	45	851	896	5.0%	44	775	819	5.4%
>=2 months	9	308	317	2.8%	10	199	209	4.8%
Total	501	9,094	9,595	5.2%	409	8,571	8,980	4.6%

Table 12-46 shows that 70.5 percent of late outage requests with a duration of two weeks or longer but shorter than two months were completed, 0.5 percent were denied by PJM and 13.0 percent of late outage requests with a duration of two weeks or longer but shorter than two months were approved or active in the 2015 to 2016 planning year. The table also shows that 71.8 percent of late outage requests with duration of two months or longer were completed, none of them were denied, and 19.1 percent were approved and active in the 2015 to 2016 planning year.

Table 12-46 Transmission facility outage requests by received status and processed status: Planning periods 2014 to 2015 and 2015 to 2016

Planned Duration	Processed Status	2014/2015				2015/2016			
		On Time	Percent	Late	Percent	On Time	Percent	Late	Percent
<2 weeks	In Progress	21	0.2%	146	1.7%	1,415	15.7%	400	5.0%
	Denied	106	1.1%	100	1.2%	69	0.8%	51	0.6%
	Approved	0	0.0%	0	0.0%	51	0.6%	40	0.5%
	Cancelled by Company	2,761	29.7%	1,205	14.4%	2,277	25.2%	937	11.8%
	Revised	0	0.0%	0	0.0%	8	0.1%	2	0.0%
	Active	0	0.0%	0	0.0%	95	1.1%	69	0.9%
	Completed	6,418	69.0%	6,931	82.7%	5,124	56.7%	6,453	81.1%
Total Submission		9,306	100.0%	8,382	100.0%	9,039	100.0%	7,952	100.0%
>=2 weeks & <2 months	In Progress	1	0.1%	9	1.0%	50	6.5%	52	6.3%
	Denied	0	0.0%	4	0.4%	1	0.1%	4	0.5%
	Approved	0	0.0%	0	0.0%	3	0.4%	4	0.5%
	Cancelled by Company	199	23.6%	106	11.8%	208	27.0%	80	9.8%
	Revised	0	0.0%	0	0.0%	4	0.5%	0	0.0%
	Active	0	0.0%	0	0.0%	64	8.3%	102	12.5%
	Completed	644	76.3%	777	86.7%	441	57.2%	577	70.5%
Total Submission		844	100.0%	896	100.0%	771	100.0%	819	100.0%
>=2 months	In Progress	0	0.0%	7	2.2%	0	0.0%	4	1.9%
	Denied	0	0.0%	0	0.0%	0	0.0%	0	0.0%
	Approved	0	0.0%	0	0.0%	0	0.0%	0	0.0%
	Cancelled by Company	42	20.9%	31	9.8%	30	21.6%	15	7.2%
	Revised	0	0.0%	0	0.0%	0	0.0%	0	0.0%
	Active	0	0.0%	1	0.3%	24	17.3%	40	19.1%
	Completed	159	79.1%	278	87.7%	85	61.2%	150	71.8%
Total Submission		201	100.0%	317	100.0%	139	100.0%	209	100.0%

Table 12-47 shows that there were 819 outage requests with a duration of two weeks or longer but shorter than two months submitted late, of which 41 were non-emergency and expected to cause congestion in the 2015 to 2016 planning year. Of the 41 such requests, three were approved and active, and 31 were complete. For the outages planned for two months or longer, there were 348 total outages, of which 209 requests were late. Of the late requests, nine outages that were non-emergency and expected to cause congestion were all approved.

Table 12-47 Transmission facility outage requests by received status, processed status, emergency and congestion: Planning periods 2014 to 2015 and 2015 to 2016

Planned Duration	Processed Status	2014/2015						2015/2016					
		On Time			Late			On Time			Late		
		Non Emergency and Congestion Expected	Total	Percent	Non Emergency and Congestion Expected	Total	Percent	Non Emergency and Congestion Expected	Total	Percent	Non Emergency and Congestion Expected	Total	Percent
<2 weeks	In Progress	2	21	9.5%	3	146	2.1%	173	1,415	12.2%	16	400	4.0%
	Denied	70	106	66.0%	39	100	39.0%	32	69	46.4%	17	51	33.3%
	Approved	0	0	0.0%	0	0	0.0%	3	51	5.9%	1	40	2.5%
	Cancelled by Company	362	2,761	13.1%	75	1,205	6.2%	277	2,277	12.2%	50	937	5.3%
	Revised	0	0	0.0%	0	0	0.0%	2	8	25.0%	0	2	0.0%
	Active	0	0	0.0%	0	0	0.0%	14	95	14.7%	2	69	2.9%
	Completed	904	6,418	14.1%	224	6,931	3.2%	675	5,124	13.2%	187	6,453	2.9%
	Total Submission	1,338	9,306	14.4%	341	8,382	4.1%	1,176	9,039	13.0%	273	7,952	3.4%
>=2 weeks & <2 months	In Progress	1	1	100.0%	0	9	0.0%	21	50	42.0%	3	52	5.8%
	Denied	0	0	0.0%	2	4	50.0%	1	1	100.0%	0	4	0.0%
	Approved	0	0	0.0%	0	0	0.0%	0	3	0.0%	0	4	0.0%
	Cancelled by Company	31	199	15.6%	6	106	5.7%	22	208	10.6%	4	80	5.0%
	Revised	0	0	0.0%	0	0	0.0%	2	4	50.0%	0	0	0.0%
	Active	0	0	0.0%	0	0	0.0%	12	64	18.8%	3	102	2.9%
	Completed	136	644	21.1%	33	777	4.2%	106	441	24.0%	31	577	5.4%
	Total Submission	168	844	19.9%	41	896	4.6%	164	771	21.3%	41	819	5.0%
>=2 months	In Progress	0	0	0.0%	0	7	0.0%	0	0	0.0%	0	4	0.0%
	Denied	0	0	0.0%	0	0	0.0%	0	0	0.0%	0	0	0.0%
	Approved	0	0	0.0%	0	0	0.0%	0	0	0.0%	0	0	0.0%
	Cancelled by Company	3	42	7.1%	1	31	3.2%	2	30	6.7%	0	15	0.0%
	Revised	0	0	0.0%	0	0	0.0%	0	0	0.0%	0	0	0.0%
	Active	0	0	0.0%	0	1	0.0%	8	24	33.3%	3	40	7.5%
	Completed	35	159	22.0%	8	278	2.9%	22	85	25.9%	6	150	4.0%
	Total Submission	38	201	18.9%	9	317	2.8%	32	139	23.0%	9	209	4.3%

If an outage request were submitted after the Annual FTR Auction bidding opening date, the outage would not be considered in the FTR model. If an outage were submitted on time according to the transmission outage rules, it may not be modeled in the FTR model if it is submitted after the Annual FTR Auction bidding opening date. Table 12-48 shows that 91.2 percent of outage requests labelled on time according to rules were submitted or rescheduled after the annual FTR bidding opening date in the 2015 to 2016 planning year.

**Table 12-48 Transmission facility outage requests by received status and bidding opening date: Planning periods 2014 to 2015 and 2015 to 2016**

Planned Duration	2014/2015						2015/2016					
	On Time			Late			On Time			Late		
	Before Bidding Opening Date	After Bidding Opening Date	Percent After	Before Bidding Opening Date	After Bidding Opening Date	Percent After	Before Bidding Opening Date	After Bidding Opening Date	Percent After	Before Bidding Opening Date	After Bidding Opening Date	Percent After
<2 weeks	566	8,740	93.9%	13	8,369	99.8%	640	8,399	92.9%	10	7,942	99.9%
>=2 weeks & <2 months	173	671	79.5%	14	882	98.4%	195	576	74.7%	12	807	98.5%
>=2 months	45	156	77.6%	2	315	99.4%	36	103	74.1%	6	203	97.1%
Total	784	9,567	92.4%	29	9,566	99.7%	871	9,078	91.2%	28	8,952	98.3%

Table 12-49 shows that 80.0 percent of late outage requests which were submitted or rescheduled after the Annual FTR Auction bidding opening date were approved and complete in the 2015 to 2016 planning.

**Table 12-49 Late transmission facility outage requests that are submitted after annual bidding opening date: Planning periods 2014 to 2015 and 2015 to 2016**

Planned Duration	2014/2015			2015/2016		
	Completed Outages	Total	Percent	Completed Outages	Total	Percent
<2 weeks	6,926	8,369	82.8%	6,447	7,942	81.2%
>=2 weeks & <2 months	772	882	87.5%	570	807	70.6%
>=2 months	277	315	87.9%	149	203	73.4%
Total	7,975	9,566	83.4%	7,166	8,952	80.0%

Thus, although the definition of late outages was developed in order to prevent outages for the planning period being submitted after the Annual FTR Auction bidding opening date, the rules have not worked to prevent this since the rule has no direct connection to the annual FTR auction opening date. The MMU recommends that PJM modify the rules to reduce or eliminate the approval of late outage requests submitted or rescheduled after the FTR Auction bidding opening date.

## Transmission Facility Outage Analysis in the Day-Ahead Market

Transmission facility outages also affect the energy market. Just as with the FTR Market, it is critical that outages that affect the operating day are known prior to the submission of offers in the Day-Ahead Energy Market both, so that market participants can understand market conditions and so that PJM can accurately model market conditions.

PJM maintains the history of outage requests including all the processed status changes and all the starting or ending date changes. Any such status change is defined as an instance. For example, if an outage request were submitted, received, approved and completed, the four occurrences, termed instances, of the outage request will be stored in the database. If an outage request is revised, that is an instance. There may be more than one instance for each outage request due to the change of the processed status. In the day-ahead market transmission outage analysis, all instances of the outages when either the status of the request is changed planned to occur in the first three months of 2015 and 2016 are included. In the day-ahead market transmission analysis, all submissions or changes of outage requests at or after 12:00 pm on the day before the planned starting date until the hour beginning 23:00 pm on the planned starting date will be defined as late for day-ahead market.

Table 12-50 shows that in the first three months of 2016 8.5 percent of non-emergency outage request instances were submitted late for the day-ahead market and PJM expected them to cause congestion.

**Table 12-50 Transmission facility outage request instance summary by congestion and emergency: January through March of 2015 and 2016**

For Day-ahead Market	Submission Status	2015 (Jan - Mar)				2016 (Jan - Mar)			
		Congestion Expected	No Congestion Expected	Total	Percent Congestion	Congestion Expected	No Congestion Expected	Total	Percent Congestion
Late	Emergency	86	942	1,028	8.4%	34	926	960	3.5%
	Non Emergency	478	3,268	3,746	12.8%	287	3,081	3,368	8.5%
On Time	Emergency	174	3,425	3,599	4.8%	102	2,241	2,343	4.4%
	Non Emergency	3,874	20,730	24,604	15.7%	2,111	16,106	18,217	11.6%
Total		4,612	28,365	32,977	14.0%	2,534	22,354	24,888	10.2%

Table 12-51 shows that there were 4,328 late outage request instances which were submitted in the first three months of 2016, of which 605 (14.0 percent) had the status submitted, cancelled by company or revised and 23 (0.5 percent) non-emergency instances had the status submitted, cancelled by company or revised and were expected to cause congestion.

**Table 12-51 Late transmission facility outage request instance status summary by congestion and emergency: January through March of 2015 and 2016**

Processed Status	2015 (Jan - Mar)			2016 (Jan - Mar)		
	Non Emergency and Congestion Expected	Total	Percent	Non Emergency and Congestion Expected	Total	Percent
Submitted	12	428	2.8%	4	396	1.0%
Cancelled by Company	19	214	8.9%	10	109	9.2%
Revised	8	106	7.5%	9	100	9.0%
Other	439	4,026	10.9%	264	3,723	7.1%
Total	478	4,774	10.0%	287	4,328	6.6%

Table 52 shows that the top five zones accounted for 56.0 percent of all outages that were submitted, cancelled or revised late for the day-ahead market in the first three months of 2016. These zones were: AEP, ATSI, ComEd, GPU, and Dominion.

**Table 12-52 Transmission facility outage request instances submitted, cancelled or revised late for the Day-ahead Market summary by transmission owner/zone: January through March of 2015 and 2016**

Transmission Owner/Company	2015 (Jan - Mar)			2016 (Jan - Mar)		
	Late for Day Ahead Market	On Time for Day Ahead Market	Percent of Total Late	Late for Day Ahead Market	On Time for Day Ahead Market	Percent of Total Late
AECO	26	694	3.5%	32	504	5.3%
AEP	107	1,393	14.3%	108	709	17.9%
AP	64	468	8.6%	44	296	7.3%
ATSI	128	1,356	17.1%	69	891	11.4%
BGE	41	359	5.5%	32	342	5.3%
CPP	2	7	0.3%	3	43	0.5%
ComEd	49	1,179	6.6%	59	905	9.8%
DAY	1	36	0.1%	10	44	1.7%
DEOK	13	150	1.7%	14	102	2.3%
DLCO	14	386	1.9%	6	269	1.0%
DPL	39	627	5.2%	25	425	4.1%
Dominion	55	1,213	7.4%	46	905	7.6%
EKPC	15	99	2.0%	11	60	1.8%
GPU	73	862	9.8%	57	595	9.4%
Linden	3	5	0.4%	1	2	0.2%
Neptune	0	3	0.0%	2	5	0.3%
PECO	24	611	3.2%	23	365	3.8%
PPL	30	275	4.0%	23	156	3.8%
PSEG	38	1,796	5.1%	28	581	4.6%
Pepco	17	227	2.3%	10	228	1.7%
RECO	6	21	0.8%	2	19	0.3%
UGI	3	27	0.4%	0	16	0.0%
Total	748	11,794	100.0%	605	7,462	100.0%



## Financial Transmission and Auction Revenue Rights

In an LMP market, the lowest cost generation is dispatched to meet the load, subject to the ability of the transmission system to deliver that energy. When the lowest cost generation is remote from load centers, the physical transmission system permits that lowest cost generation to be delivered to load. This was true prior to the introduction of LMP markets and continues to be true in LMP markets. Prior to the introduction of LMP markets, contracts based on the physical rights associated with the transmission system were the mechanism used to provide for the delivery of low cost generation to load. Firm transmission customers who paid for the transmission system through rates were the beneficiaries of the system.

After the introduction of LMP markets, financial transmission rights (FTRs) were introduced to permit the loads which pay for the transmission system to continue to receive those benefits in the form of revenues which offset congestion to the extent permitted by the transmission system.<sup>1</sup> Financial transmission rights and the associated revenues were directly provided to loads in recognition of the facts that loads pay for the transmission system which permits low cost generation to be delivered to load. Another way of describing the result is that FTRs and the associated congestion revenues were directly provided to loads in recognition of the fact that load pays locational prices which result in load payments in excess of generation revenues which are the source of the funds available to offset congestion costs in an LMP market.<sup>2</sup> Congestion is defined to be load payments in excess of generation revenues. Congestion revenues are the source of the funds to pay FTRs. In an LMP system, the only way to ensure that load receives the benefits associated with the use of the transmission system to deliver low cost energy is to use FTRs, or an equivalent mechanism, to pay back to load the difference between the total load payments and the total generation revenues. The only way to ensure that load receives the benefits associated with the use of the transmission system to deliver low cost energy is to ensure that all congestion

revenues are returned to load. Congestion revenues are defined to be equal to the sum of day ahead and balancing congestion. FTRs are one way to do that.

Effective June 1, 2003, PJM replaced the direct allocation of FTRs to load with an allocation of Auction Revenue Rights (ARRs). The load still owns the rights to congestion collected under this system, but the ARR construct allows load to either claim the FTRs directly (through a process called self scheduling), or to sell the rights in the FTR auction in exchange for a revenue stream based on the prices of the FTRs. Under the ARR construct, all of the FTR auction revenues should belong to the load and all of the congestion revenues should belong to those that purchase or self schedule the FTRs.

The current ARR/FTR design does not serve as an efficient way to ensure that load receives all the congestion revenues or has the ability to receive the auction revenues associated with all the potential congestion revenues. Total ARR and self scheduled FTR revenue offset only 63.8 percent of total congestion costs including congestion in the Day-Ahead Energy Market and the balancing energy market for the 2014 to 2015 planning period. One of the reasons for this inefficiency is the link, established by PJM member companies in their initial FTR filings, between congestion revenues and specific generation to load transmission paths. The original filings, made before PJM members had any experience with LMP markets, retained the view of congestion rooted in physical transmission rights. In an effort to protect themselves, the PJM utilities linked the payment of FTRs to specific, physical contract paths from specific generating units to specific load zones. That linkage was inconsistent with the appropriate functioning of FTRs in an LMP system. The ARR allocation in 2015 continued to be based on those original physical generation to load paths, an illustration of the inadequacy of that approach and a source of the issues with the FTR model in 2015.

If the original PJM FTR design had simply been designed to return congestion revenues to load, many of the subsequent issues with the FTR design would have been avoided. Now is a good time to address the issues of the FTR design and to return the design to its original purpose. This would eliminate much

<sup>1</sup> See 81 FERC ¶ 61,257, at 62,241 (1997).

<sup>2</sup> See *Id.* at 62, 259–62,260 & n. 123.

of the complexity associated with ARRs and FTRs and eliminate unnecessary controversy about the appropriate recipients of congestion revenues.

The *2016 State of the Market Report for PJM: January through March* focuses on the Monthly Balance of Planning Period FTR Auctions for the 2014 to 2015 and 2015 to 2016 planning periods, covering January 1, 2016, through March 31, 2016.

**Table 13-1 The FTR Auction Markets results were competitive**

Market Element	Evaluation	Market Design
Market Structure	Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Flawed

- Market structure was evaluated as competitive because the FTR auction is voluntary and the ownership positions resulted from the distribution of ARRs and voluntary participation.
- Participant behavior was evaluated as competitive because there was no evidence of anti-competitive behavior.
- Market performance was evaluated as competitive because it reflected the interaction between participant demand behavior and FTR supply, limited by PJM's analysis of system feasibility.
- Market design was evaluated as flawed because there are significant flaws with the basic ARR/FTR design which need to be addressed. The market design is not an efficient way to ensure that congestion revenues are returned to load.

## Overview

### Auction Revenue Rights

#### Market Structure

- **Residual ARRs.** If ARR allocations are reduced as the result of a modeled transmission outage and the transmission outage ends during the relevant planning year, the result is that residual ARRs may be available. These

residual ARRs are automatically assigned to eligible participants the month before the effective date. Residual ARRs are only available on paths prorated in Stage 1 of the annual ARR allocation, are only effective for single, whole months and cannot be self scheduled. Residual ARR clearing prices are based on monthly FTR auction clearing prices.

In the 2015 to 2016 planning period, PJM allocated a total of 30,118.1 MW of residual ARRs, up from 19,928.0 MW in the first ten months of the 2014 to 2015 planning period, with a total target allocation of \$7.7 million for the 2015 to 2016 planning period, down from \$7.9 million for the first ten months of the 2014 to 2015 planning period. Total Residual ARR allocations for the 2013 to 2014 planning period were 15,417.5 MW for \$4.7 million. This large increase in residual ARR allocations over the 2013 to 2014 planning period was primarily a result of PJM's significant reductions in Annual ARR Stage 1B allocations. The outages were only assumed in order to reduce the initial allocation. As a result, there were more available ARRs during the year which were distributed as residual ARRs.

- **ARR Reassignment for Retail Load Switching.** There were 53,343 MW of ARRs associated with \$503,400 of revenue that were reassigned in the 2014 to 2015 planning period. There were 52,046 MW of ARRs associated with \$612,900 of revenue that were reassigned for the first ten months of the 2015 to 2016 planning period.

### Market Performance

- **Revenue Adequacy.** For the 2015 to 2016 planning period, the ARR target allocations, which are based on the nodal price differences from the Annual FTR Auction, were \$930.7 million, while PJM collected \$967.4 million from the combined Long Term, Annual and Monthly Balance of Planning Period FTR Auctions, making ARRs revenue adequate. For the 2014 to 2015 planning period, the ARR target allocations were \$735.3 million while PJM collected \$767.9 million from the combined Long Term, Annual and Monthly Balance of Planning Period FTR Auctions. The increase in ARR target allocations and auction revenue, despite

decreased volume, is a result of increased prices resulting from the reduced allocation of Stage 1B and Stage 2 ARRs. For the 2015 to 2016 planning period ARR dollars per MW increased 15.6 percent relative to the 2013 to 2014 planning period.

- **ARRs as an Offset to Congestion.** ARRs did not serve as an effective way to return congestion revenues to load. Total ARR and self scheduled FTR revenue offset only 63.8 percent of total congestion costs, which include congestion in the Day-Ahead Energy Market and the balancing energy market, for the 2014 to 2015 planning period. In the first ten months of the 2015 to 2016 planning period, total ARR and self scheduled FTR revenues offset 83.6 percent of total congestion costs.

## Financial Transmission Rights

### Market Structure

- **Supply.** In the Monthly Balance of Planning Period FTR Auctions for the 2015 to 2016 planning period, total participant FTR sell offers were 4,500,555 MW, up from 3,230,754 MW for the same period during the 2014 to 2015 planning period.
- **Demand.** The total FTR buy bids from the Monthly Balance of Planning Period FTR Auctions for the 2015 to 2016 planning period increased 0.6 percent from 23,099,689 MW for the same time period of the prior planning period, to 23,243,499 MW.
- **Patterns of Ownership.** For the Monthly Balance of Planning Period Auctions, financial entities purchased 81.7 percent of prevailing flow and 75.2 percent of counter flow FTRs for January through March of 2016. Financial entities owned 65.9 percent of all prevailing and counter flow FTRs, including 58.6 percent of all prevailing flow FTRs and 76.4 percent of all counter flow FTRs during the period from January through March 2016.

### Market Behavior

- **FTR Forfeitures.** Total forfeitures for the 2015 to 2016 planning period were \$0.2 million for Increment Offers, Decrement Bids and UTC Transactions.
- **Credit Issues.** There were no defaults in January through March 2016.

### Market Performance

- **Volume.** In the first ten months of the 2015 to 2016 planning period Monthly Balance of Planning Period FTR Auctions 2,154,584 MW (9.3 percent) of FTR buy bids and 1,098,875 MW (24.4 percent) of FTR sell offers cleared.
- **Price.** The weighted-average buy-bid cleared FTR price in the Monthly Balance of Planning Period FTR Auctions for the first ten months of the 2015 to 2016 planning period was \$0.21, up from \$0.18 per MW for the same period in the 2014 to 2015 planning period.
- **Revenue.** The Monthly Balance of Planning Period FTR Auctions generated \$31.1 million in net revenue for all FTRs for the 2015 to 2016 planning period, up from \$17.3 million for the same time period in the 2014 to 2015 planning period.
- **Revenue Adequacy.** FTRs were paid at 100 percent of the target allocation level for the 2015 to 2016 planning period. This high level of revenue adequacy was primarily a result of actions taken by PJM to reduce the level of available ARRs and FTRs. PJM's actions included PJM's decision to assume higher outage levels and PJM's decision to include additional constraints (closed loop interfaces) both of which reduced system capability in the FTR auction model. PJM's actions led to a significant reduction in the allocation of Stage 1B and Stage 2 ARRs.
- **Profitability.** FTR profitability is the difference between the revenue received for an FTR and the cost of the FTR. In 2016, FTRs were profitable overall, with \$68.8 million in profits for physical entities, of which \$61.2 million was from self-scheduled FTRs, and \$46.9 million for financial entities.

## Markets Timeline

Any PJM member can participate in the Long Term FTR Auction, the Annual FTR Auction and the Monthly Balance of Planning Period FTR Auctions.

Table 13-2 shows the date of first availability and final closing date for all annual ARR and FTR products.

**Table 13-2 Annual FTR product dates**

Auction	Initial Open Date	Final Close Date
2016/2019 Long Term	6/1/2015	12/3/2015
2015/2016 ARR	3/2/2015	3/31/2015
2015/2016 Annual	4/7/2015	4/30/2015

## Recommendations

- The MMU recommends that the ARR/FTR design be modified to ensure that all congestion revenues are returned to load. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that all FTR auction revenue be distributed to ARR holders. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that historical generation to load paths be eliminated as a basis for allocating ARRs. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that counter flow FTRs be eliminated. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that FTR auction revenues not be used to buy counter flow FTRs with the purpose of improving FTR payout ratios.<sup>3</sup> (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM report correct monthly payout ratios to reduce understatement of payout ratios on a monthly basis. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM eliminate portfolio netting to eliminate cross subsidies among FTR marketplace participants. (Priority: High. First reported 2012. Status: Not adopted. Pending before FERC.)
- The MMU recommends that PJM eliminate subsidies to counter flow FTRs by applying the payout ratio to counter flow FTRs in the same way the payout ratio is applied to prevailing flow FTRs. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM eliminate geographic cross subsidies. (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM improve transmission outage modeling in the FTR auction models. (Priority: Low. First reported 2013. Status: Adopted partially, 14/15 planning period.)
- The MMU recommends that PJM reduce FTR sales on paths with persistent overallocation of FTRs including clear rules for what defines persistent overallocation and how the reduction will be applied. (Priority: High. First reported 2013. Status: Adopted partially, 14/15 planning period.)
- The MMU recommends that PJM implement a seasonal ARR and FTR allocation system to better represent outages. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that the basis for the Stage 1A assignments be reviewed and made explicit, that the role of out of date generation to load paths be reviewed and that the building of the transmission capability required to provide all defined Stage 1A allocations be reviewed. (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM apply the FTR forfeiture rule to up to congestion transactions consistent with the application of the FTR forfeiture rule to increment offers and decrement bids. (Priority: High. First reported 2013. Status: Not adopted. Pending before FERC.)
- The MMU recommends that PJM examine the mechanism by which self scheduled FTRs are allocated when load switching among LSEs occurs throughout the planning period. (Priority: Low. First reported 2011. Status: Not adopted.)

<sup>3</sup> See PJM, "Manual 6: Financial Transmission Rights" Revision 16 (June 1, 2014), p. 56.

## Conclusion

The annual ARR allocation should be designed to return congestion revenues to firm transmission service customers, without requiring contract path physical transmission rights that are difficult or impossible to define and enforce in LMP markets. The fixed charges paid for firm transmission services result in the transmission system which provides physically firm transmission service which results in load paying congestion revenues.

After the introduction of LMP markets, financial transmission rights (FTRs) permitted the loads which pay for the transmission system to continue to receive those benefits in the form of revenues which offset congestion to the extent permitted by the transmission system. Financial transmission rights and the associated revenues were directly provided to loads in recognition of the fact that loads pay for the transmission system which permits low cost generation to be delivered to load. Another way of describing the result is that FTRs and the associated revenues were directly provided to loads in recognition of the fact that load pays locational prices which result in load payments in excess of generation revenues which are the source of congestion revenues in an LMP market. In other words, load payments in excess of generation revenues are the source of the funds to pay FTRs. In an LMP system, the only way to ensure that load receives the benefits associated with the use of the transmission system to deliver low cost energy is to use FTRs to pay back to load the difference between the total load payments and the total generation revenues, which equals total congestion revenues.

With the creation of ARRs, FTRs no longer serve their original function of providing firm transmission customers with the financial equivalent of physically firm transmission service. FTR holders, with the creation of ARRs, do not have the right to financially firm transmission service and FTR holders do not have the right to revenue adequacy.

As a result of the creation of ARRs and other changes to the design, the current ARR/FTR design does not serve as an efficient way to ensure that load receives all the congestion revenues or has the ability to receive the auction revenues associated with all the potential congestion revenues. Total ARR and

self scheduled FTR revenue offset only 63.8 percent of total congestion costs including congestion in the Day-Ahead Energy Market and the balancing energy market for the 2014 to 2015 planning period. For the first ten months of the 2015 to 2016 planning period ARRs and self scheduled FTRs offset 83.6 percent of total congestion costs.

For these reasons, load should never be required to subsidize payments to FTR holders, regardless of the reason. Such subsidies have been suggested repeatedly.<sup>4</sup> One form of recommended subsidies would ignore balancing congestion when calculating total congestion dollars available to fund FTRs. This approach would ignore the fact that loads must pay both day-ahead and balancing congestion and that congestion is defined, in an accounting sense, to equal the sum of day ahead and balancing congestion. To eliminate balancing congestion from the FTR revenue calculation would require load to pay twice for congestion. Load would have to continue paying for the physical transmission system, would have to continue paying in excess of generator revenues and not have balancing congestion included in the calculation of congestion in order to increase the payout to holders of FTRs who are not loads and who therefore did not receive an allocation of ARRs. In other words, load would have to continue providing all the funding of FTRs, while payments to FTR holders who did not receive ARRs exceed total congestion on their FTR paths and result in profits to FTR holders.

Revenue adequacy has received a lot of attention in the PJM FTR Market. There are several factors that can affect the reporting, distribution of and quantity of funding in the FTR Market. Revenue adequacy is misunderstood. FTR holders, with the creation of ARRs, do not have the right to financially firm transmission service and FTR holders do not have the right to revenue adequacy even when defined correctly. Load does have those rights based on load's payment for the transmission system and load's payment of total congestion.

Reported FTR revenue adequacy uses target allocations as the relevant benchmark. But target allocations are not the relevant benchmark. Target

<sup>4</sup> See "FirstEnergy Solutions Corp. Allegheny Energy Supply Company, LLC v PJM Interconnection, LLC," Docket No. EL13-47-000 (February 15, 2013).

allocations are based on day-ahead congestion only, ignoring balancing congestion which is the other part of total congestion. FTR holders appropriately receive revenues based on actual congestion in both day-ahead and balancing markets. When day-ahead congestion differs significantly from real-time congestion, as has occurred only in recent years, this is evidence that there are reporting issues, cross subsidization issues, issues with the level of FTRs sold, and issues with modeling differences between the day-ahead and real-time markets. Such differences are not an indication that FTR holders are under paid.

The difference between the congestion payout using total congestion and the congestion payout using only day-ahead congestion illustrates the issue. For January through March 2016, total day-ahead congestion was \$322.9 million while total day-ahead plus balancing congestion was \$292.2 million, compared to target allocations of \$285.9 million in the same time period.

PJM used a more conservative approach to modeling the transmission capability for the 2014 to 2015 planning period. PJM simply assumed higher outage levels and included additional constraints, both of which reduced system capability in the FTR auction model. The result was a significant reduction in Stage 1B and Stage 2 ARR allocations, and a corresponding reduction in the available quantity of FTRs, an increase in FTR prices and an increase in ARR target allocations. The market response to the reduced supply of FTRs was increased bid prices, increased clearing prices and reduced clearing quantities.

Clearing prices fell and cleared quantities increased from the 2010 to 2011 planning period through the 2013 to 2014 planning period. The market response to lower revenue adequacy was to reduce bid prices and to increase bid volumes and offer volumes. In the 2014 to 2015 and 2015 to 2016 planning periods, due to reduced ARR allocations, FTR volume decreased relative to the 2013 to 2014 planning period. The reduction in ARR allocations and resulting FTR volume caused, by definition, an improvement in revenue adequacy, and also resulted in an increase in the prices of FTRs. Increased FTR prices

resulted in increased ARR target allocations, because ARR target allocations are based on the Annual FTR Auction nodal prices.

FTR target allocations are currently netted within each organization in each hour. This means that within an hour, positive and negative target allocations within an organization's portfolio are offset prior to the application of the payout ratio to the positive target allocation FTRs. The payout ratios are also calculated based on these net FTR positions. The current method requires those participants with fewer negative target allocation FTRs to subsidize those with more negative target allocation FTRs. The current method treats a positive target allocation FTR differently depending on the portfolio of which it is a part. The correct method would treat all FTRs with positive target allocations exactly the same, which would eliminate this form of cross subsidy. This should also be extended to include the end of planning period FTR uplift calculation. The net of a participant's portfolio should not determine their FTR uplift liability, rather their portion of total positive target allocations should be used to determine a participant's uplift charge. The FTR market cannot work efficiently if FTR buyers do not receive payments consistent with the performance of their FTRs. Eliminating the portfolio subsidy would be a good first step in that direction.

If netting within portfolios were eliminated and the payout ratio were calculated correctly, the payout ratio in the 2013 to 2014 planning period would have been 87.5 percent instead of the reported 72.8 percent. The MMU recommends that netting of positive and negative target allocations within portfolios be eliminated.

The current rules create an asymmetry between the treatment of counter flow and prevailing flow FTRs. Counter flow FTR holders make payments over the planning period, in the form of negative target allocations. These negative target allocations are paid at 100 percent regardless of whether positive target allocation FTRs are paid at less than 100 percent.

There is no reason to treat counter flow FTRs more favorably than prevailing flow FTRs. Counter flow FTRs should also be affected when the payout ratio

is less than 100 percent. This would mean that counter flow FTRs would pay back an increased amount that mirrors the decreased payments to prevailing flow FTRs. The adjusted payout ratio would evenly divide the impact of lower payouts among counter flow FTR holders and prevailing flow FTR holders by increasing negative counter flow target allocations by the same amount it decreases positive target allocations. The FTR Market cannot work efficiently if FTR buyers do not receive payments consistent with the performance of their FTRs. Eliminating the counter flow subsidy would be another good step in that direction.

The result of removing portfolio netting and applying a payout ratio to counter flow FTRs would have increased the calculated payout ratio in the 2013 to 2014 planning period from the reported 72.8 percent to 91.0 percent. For the 2014 to 2015 and 2015 to 2016 planning period the payout ratio was 100 percent. The MMU recommends that counter flow and prevailing flow FTRs be treated symmetrically with respect to the application of a payout ratio.

The overallocation of Stage 1A ARRs results in FTR overallocations on the same facilities. Stage 1A ARR overallocation is a source of revenue inadequacy and cross subsidy. The origin and basis for the requirement to assign Stage 1A ARRs needs further investigation. The issues associated with over allocation appear to be based on the use of out of date generation to load ARR paths and on whether PJM has appropriately built transmission to meet the requirement.

The MMU recommends that the basis for the Stage 1A assignments be reviewed and made explicit, that the role of out of date generation to load paths be reviewed and that the building of the transmission capability required to provide all defined Stage 1A allocations be reviewed. The implementation of the MMU's recommendation to return all congestion revenues to load would also significantly affect this issue.

The result of removing portfolio netting, applying a payout ratio to counter flow FTRs and eliminating Stage 1A ARR overallocation in the 2013 to 2014 planning period would have increased the payout ratio to 94.6 percent without reducing ARR allocations in Stage 1B and Stage 2.

In addition to addressing these issues, the approach to the question of FTR funding should also look at the fundamental reasons that there has been a significant and persistent difference between day-ahead and balancing congestion. These reasons include the inadequate transmission outage modeling in the FTR auction model which ignores all but long term outages known in advance; the different approach to transmission line ratings in the day-ahead and real-time markets, including reactive interfaces, which directly results in differences in congestion between day-ahead and real-time markets; differences in day-ahead and real-time modeling including the treatment of loop flows, the treatment of outages, the modeling of PARs and the nodal location of load, which directly results in differences in congestion between day-ahead and real-time markets; the overallocation of ARRs which directly results in a difference between congestion revenue and the payment obligation; the appropriateness of seasonal ARR allocations to better match actual market conditions with the FTR auction model; geographic subsidies from the holders of positively valued FTRs in some locations to the holders of consistently negatively valued FTRs in other locations; the contribution of up to congestion transactions to the differences between day-ahead and balancing congestion and thus to FTR payout ratios; and the continued sale of FTR capability on pathways with a persistent difference between FTRs and total congestion revenue. The MMU recommends that these issues be reviewed and modifications implemented. Regardless of how these issues are addressed, funding issues that persist as a result of modeling differences and flaws in the design of the FTR Market should be borne by FTR holders operating in the voluntary FTR market and not imposed on load through the mechanism of balancing congestion.

For the 2014 to 2015 and 2015 to 2016 planning periods FTRs have been revenue adequate. This is not because the underlying problems have been fixed. Revenue adequacy has been accomplished by limiting the amount of available ARRs and FTRs by arbitrarily decreasing the ARR allocations for Stage 1B and Stage 2 which also results in a redistribution of ARRs based on differences in allocations between Stage 1A and Stage 1B ARRs.

## Auction Revenue Rights

ARRs are the financial instruments through which the proceeds from FTR Auctions are allocated to load based on load's payment for the transmission system and for load's payment of congestion. ARR values are based on nodal price differences between the ARR source and sink points.<sup>5</sup> These price differences are based on the bid prices of participants in the Annual FTR Auction. The auction clears the set of feasible FTR bids which produce the highest net revenue. ARR revenues are a function of FTR auction participants' expectations of locational congestion price differences and the associated level of revenue adequacy.

ARRs are available only as obligations (not options) and only as the 24-hour product. ARR values are available to the nearest 0.1 MW. The ARR target allocation is equal to the product of the ARR MW and the price difference between sink and source from the Annual FTR Auction. An ARR value can be positive or negative depending on the price difference between sink and source, with a negative difference resulting in a liability for the holder. The ARR target allocation represents the revenue that an ARR holder should receive. ARR credits can be positive or negative and can range from zero to the ARR target allocation. If the combined net revenues from the Long Term, Annual and Monthly Balance of Planning Period FTR Auctions are greater than the sum of all ARR target allocations, ARR values are fully funded. If these revenues are less than the sum of all ARR target allocations, available revenue is proportionally allocated among all ARR holders. If there are excess ARR revenues, the excess revenue is given pro rata to FTR holders.

The goal of the ARR/FTR design should be to provide an efficient mechanism to ensure that load receives all the congestion revenues, or has the ability to receive the auction revenues associated with all the potential congestion revenues, all auction proceeds should be allocated to the ARR holders. The MMU recommends that all FTR auction proceeds be allocated to ARR holders.

<sup>5</sup> These nodal prices are a function of the market participants' annual FTR bids and binding transmission constraints. An optimization algorithm selects the set of feasible FTR bids that produces the most net revenue.

When a new control zone is integrated into PJM, firm transmission customers in that control zone may choose to receive either an FTR allocation or an ARR allocation before the start of the Annual FTR Auction for two consecutive planning periods following their integration date. After the transition period, such participants receive ARR values from the annual allocation process and are not eligible for directly allocated FTRs. Network service users and firm transmission customers cannot choose to receive both an FTR allocation and an ARR allocation. This selection applies to the participant's entire portfolio of ARR values that sink into the new control zone. During this transitional period, the directly allocated FTRs are reallocated, as load shifts between LSEs within the transmission zone.

Incremental ARR values (IARRs) are allocated to customers that have been assigned cost responsibility for certain upgrades included in the PJM's Regional Transmission Expansion Plan (RTEP). These customers as defined in Schedule 12 of the Tariff are network service customers and/or merchant transmission facility owners that are assigned the cost responsibility for upgrades included in the PJM RTEP. PJM calculates IARRs for each regionally assigned facility and allocates the IARRs, if any are created by the upgrade, to eligible customers based on their percentage of cost responsibility. The customers may choose to decline the IARR allocation during the annual ARR allocation process.<sup>6</sup> Each network service customer within a zone is allocated a share of the IARRs in the zone based on their share of the network service peak load of the zone.

## Market Structure

ARR values have been available to network service and firm, point-to-point transmission service customers since June 1, 2003, when the annual ARR allocation was first implemented for the 2003 to 2004 planning period. The initial allocation covered the Mid-Atlantic Region and the AP Control Zone. For the 2006 to 2007 planning period, the choice of ARR values or direct allocation FTRs was available to eligible market participants in the AEP, DAY, DLCO and Dominion control zones. For the 2007 to 2008 and subsequent planning

<sup>6</sup> PJM. "Manual 6: Financial Transmission Rights," Revision 16 (June 1, 2014), pp. 31 and "IARRs for RTEP Upgrades Allocated for 2011/2012 Planning Period," <<http://www.pjm.com/~media/markets-ops/ftr/annual-arr-allocation/2011-2012/iarrs-rtep-upgrades-allocated-for-2011-12-planning-period.ashx>>.

periods through the present, all eligible market participants were allocated ARRs.

## Supply and Demand

ARR supply is limited by the capability of the transmission system to simultaneously accommodate the set of requested ARRs and the numerous combinations of ARRs that are feasible.

## ARR Allocation

For the 2007 to 2008 planning period, the annual ARR allocation process was revised to include Long Term ARRs that would be in effect for 10 consecutive planning periods.<sup>7</sup> Long Term ARRs can give LSEs the ability to offset their congestion costs on a long-term basis. Long Term ARR holders can self schedule their Long Term ARRs as FTRs for any planning period during the 10 planning period timeline.

Each March, PJM allocates ARRs to eligible customers in a three-stage process:

- **Stage 1A.** In the first stage of the allocation, network transmission service customers can obtain ARRs, up to their share of the zonal base load, after taking into account generation resources that historically have served load in each control zone and up to 50 percent of their historical nonzone network load. Nonzone network load is load that is located outside of the PJM footprint. Firm, point-to-point transmission service customers can obtain Long Term ARRs, based on up to 50 percent of the MW of long-term, firm, point-to-point transmission service provided between the receipt and delivery points for the historical reference year. Stage 1A ARRs cannot be prorated. If Stage 1A ARRs are found to be infeasible, transmission system upgrades must be undertaken to maintain feasibility.<sup>8</sup> While transmission upgrades are being implemented, Stage 1A ARRs, and therefore FTRs, are overallocated which can lead to revenue inadequacy
- **Stage 1B.** ARRs unallocated in Stage 1A are available in the Stage 1B allocation for the following planning period. Network transmission service

customers can obtain ARRs, up to their share of the zonal peak load, based on generation resources that historically have served load in each control zone and up to 100 percent of their transmission responsibility for nonzone network load. Firm, point-to-point transmission service customers can obtain ARRs based on the MW of long-term, firm, point-to-point service provided between the receipt and delivery points for the historical reference year. These long-term point-to-point service agreements must also remain in effect for the planning period covered by the allocation.

- **Stage 2.** Stage 2 of the annual ARR allocation is a three-step procedure, with one-third of the remaining system capability allocated in each step of the process. Network transmission service customers can obtain ARRs from any hub, control zone, generator bus or interface pricing point to any part of their aggregate load in the control zone or load aggregation zone for which an ARR was not allocated in Stage 1A or Stage 1B. Firm, point-to-point transmission service customers can obtain ARRs consistent with their transmission service as in Stage 1A and Stage 1B.

Prior to the start of the Stage 2 annual ARR allocation process, ARR holders can relinquish any portion of their ARRs resulting from the Stage 1A or Stage 1B allocation process, provided that all remaining outstanding ARRs are simultaneously feasible following the return of such ARRs.<sup>9</sup> Participants may seek additional ARRs in the Stage 2 allocation.

Effective for the 2015 to 2016 planning period, when residual zone pricing will be introduced, an ARR will default to sinking at the load settlement point, but the ARR holder may elect to sink their ARR at the physical zone instead.<sup>10</sup>

ARRs can also be traded between LSEs, but these trades must be made before the first round of the Annual FTR Auction. Traded ARRs are effective for the full 12-month planning period.

<sup>7</sup> See the *2006 State of the Market Report* (March 8, 2007) for the rules of the annual ARR allocation process for the 2006 to 2007 and prior planning periods.

<sup>8</sup> See PJM. "Manual 6: Financial Transmission Rights" Revision 16 (June 1, 2014), p. 22.

<sup>9</sup> See PJM. "Manual 6: Financial Transmission Rights," Revision 16 (June 1, 2014), pp. 21.

<sup>10</sup> See "Residual Zone Pricing," PJM Presentation to the Members Committee (February 23, 2012) <<http://www.pjm.com/~media/committees-groups/committees/mc/20120223/20120223-item-03-residual-zone-pricing-presentation.aspx>> The introduction of residual zone pricing, while approved by PJM members, depends on a FERC order.

When ARR are allocated, all ARRs must be simultaneously feasible to ensure that the physical transmission system can support the approved set of ARRs. In making simultaneous feasibility determinations, PJM utilizes a power flow model of security-constrained dispatch that takes into account generation and transmission facility outages and is based on assumptions about the configuration and availability of transmission capability during the planning period.<sup>11</sup> PJM may also adjust the outages modeled, adjust line limits and account for potential closed loop interfaces to address expected revenue inadequacies. The simultaneous feasibility requirement is necessary to ensure that there are adequate revenues from congestion charges to satisfy all resulting ARR obligations. If the requested set of ARRs is not simultaneously feasible, customers are allocated prorated shares in direct proportion to their requested MW and in inverse proportion to their impact on binding constraints, except Stage 1A ARRs:

#### Equation 13-1 Calculation of prorated ARRs

Individual prorated MW = (Constraint capability)  $\times$   
 (Individual requested MW / Total requested MW)  $\times$  (1 / MW effect on line).<sup>12</sup>

The effect of an ARR request on a binding constraint is measured using the ARR's power flow distribution factor. An ARR's distribution factor is the percent of each requested MW of ARR that would have a power flow on the binding constraint. The PJM methodology prorates ARR requests in proportion to their MW value and the impact on the binding constraint. PJM's method results in the prorating only of ARRs that cause the greatest flows on the binding constraint. Were all ARR requests prorated equally, regardless of their proportional impact on the binding constraints, the result would be a significant reduction in market participants' ARRs.

<sup>11</sup> PJM. "Manual 6: Financial Transmission Rights," Revision 16 (June 1, 2014), pp. 55-56.

<sup>12</sup> See the *MMU Technical Reference for PJM Markets*, at "Financial Transmission Rights and Auction Revenue Rights," for an illustration explaining this calculation in greater detail. <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

## FTR Revenue Adequacy and Stage 1B/Stage 2 ARR Allocations

For the entire 2014 to 2015 and 2015 to 2016 planning periods, FTR revenue adequacy was over 100 percent. Not every month was revenue adequate, but there was excess revenue from other months to make each month revenue adequate. The last time there were four months of consecutive funding of 100 percent or more was in the 2009 to 2010 planning period.

This high level of revenue adequacy was primarily due to actions taken by PJM to address prior low levels of revenue adequacy. PJM's actions included PJM's arbitrary assumption of higher outage levels and PJM's decision to include additional constraints (closed loop interfaces) both of which reduced system capability in the FTR auction model. PJM's actions led to a significant reduction in the allocation of Stage 1B and Stage 2 ARRs.

While PJM's approach to outages in the Annual FTR Auction reduces revenue inadequacy, which was caused in part by Stage 1A ARR overallocations, it does not address the Stage 1A ARR overallocation issue directly, and has resulted in decreased Stage 1B ARR allocations through proration, decreased Stage 2 ARR allocations through proration and decreased FTR capability. Stage 1A ARRs were not affected by PJM's assumption of increased outages because they may not be prorated.

Figure 13-1 shows the historic allocations for Stage 1B and Stage 2 ARRs from the 2011 to 2012 to 2015 to 2016 planning periods. There was an 84.9 percent decrease in Stage 1B ARRs allocated and an 88.1 percent decrease in total Stage 2 ARR allocations from the 2013 to 2014 planning period to the 2014 to 2015 planning period. Total Stage 1B and Stage 2 ARR allocations increased in the 2015 to 2016 planning year over the 2014-2015 planning year allocations, from 4,605.6 MW to 6,996.1 MW. But the ARR allocations for the 2015-2016 planning year were still 79.7 percent below 2013 to 2014 planning year volumes of 34,444.0 MW. The dollars per ARR MW for the first ten months of the 2014 to 2015 and 2015 to 2016 planning periods were up 68.7 percent and 65.6 percent relative to the 2013 to 2014 planning period

while congestion was down by 24.5 percent and 48.7 percent relative to the first ten months of the 2013 to 2014 planning period.

**Figure 13-1 Historic Stage 1B and Stage 2 ARR Allocations from the 2011 to 2012 through 2015 to 2016 planning periods**



Table 13-3 shows the ARR allocations for the 2011 to 2012 through 2015 to 2016 planning periods. Stage 1A allocations cannot be prorated and have been slowly increasing. Stage 1B and Stage 2 allocations can be prorated. Stage 1B and Stage 2 allocations were steadily declining over the 2011 to 2012 through 2013 to 2014 planning periods, but were very significantly reduced in the 2014 to 2015 planning period as a result of PJM's arbitrary increase in modeled outages designed to increase revenue adequacy. There was a small increase in Stage 1B and Stage 2 ARR volume from the 2014 to 2015 planning period to the 2015 to 2016 planning period.

**Table 13-3 Historic Stage 1B and Stage 2 ARR Allocations from the 2011 to 2012 through 2015 to 2016 planning periods**

Stage	2011/2012 ARR	2012/2013 ARR	2013/2014 ARR	2014/2015 ARR	2015/2016 ARR
Stage 1A	64,159.9	67,299.6	67,861.4	68,837.7	71,874.0
Stage 1B	22,208.3	18,431.7	15,782.0	2,389.6	3,643.1
Stage 2-1	3,072.5	2,700.6	3,519.2	360.9	643.8
Stage 2-2	6,652.6	3,334.3	3,200.0	455.9	511.2
Stage 2-3	6,382.6	6,218.7	2,611.8	291.2	521.5
Total Stage 2	16,107.7	12,253.6	9,331.0	1,108.0	1,676.5

### ARR Reassignment for Retail Load Switching

PJM rules provide that when load switches between LSEs during the planning period, a proportional share of associated ARRs that sink into a given control or load aggregation zone is automatically reassigned to follow that load.<sup>13</sup> ARR reassignment occurs daily only if the LSE losing load has ARRs with a net positive economic value to that control zone. An LSE gaining load in the same control zone is allocated a proportional share of positively valued ARRs within the control zone based on the shifted load. ARRs are reassigned to the nearest 0.001 MW and any MW of load may be reassigned multiple times over a planning period. Residual ARRs are also subject to the rules of ARR reassignment. This practice supports competition by ensuring that the offset to congestion follows load, thereby removing a barrier to competition among LSEs and, by ensuring that only ARRs with a positive value are reassigned, preventing an LSE from assigning poor ARR choices to other LSEs. However, when ARRs are self-scheduled as FTRs, these underlying self-scheduled FTRs do not follow load that shifts while the ARRs do follow load that shifts, and this may result in lower value of the ARRs for the receiving LSE compared to the total value held by the original ARR holder.

There were 53,343 MW of ARRs associated with \$503,400 of revenue that were reassigned in the 2014 to 2015 planning period. There were 52,046 MW of ARRs associated with \$612,900 of revenue that were reassigned for the 2015 to 2016 planning period.

<sup>13</sup> See PJM, "Manual 6: Financial Transmission Rights," Revision 16 (June 1, 2014), p. 28.

Table 13-4 summarizes ARR MW and associated revenue automatically reassigned for network load in each control zone where changes occurred between June 2014 and March 2016.

**Table 13-4 ARRs and ARR revenue automatically reassigned for network load changes by control zone: June 1, 2014, through March 31, 2016**

Control Zone	ARRs Reassigned (MW-day)		ARR Revenue Reassigned [Dollars (Thousands) per MW-day]	
	2014/2015 (12 months)	2015/2016 (10 months)*	2014/2015 (12 months)	2015/2016 (10 months)*
AECO	539	541	\$3.1	\$4.0
AEP	2,453	6,914	\$37.5	\$69.6
AP	2,351	2,069	\$50.9	\$49.4
ATSI	8,627	5,998	\$70.8	\$54.2
BGE	3,264	2,946	\$52.7	\$92.5
ComEd	6,720	5,004	\$94.9	\$122.6
DAY	794	555	\$1.1	\$1.2
DEOK	6,490	6,306	\$13.8	\$30.5
DLCO	5,891	5,905	\$10.9	\$12.5
DPL	1,853	1,514	\$30.5	\$52.2
Dominion	20	20	\$0.3	\$0.3
EKPC	0	0	\$0.0	\$0.0
JCPL	1,354	1,479	\$9.5	\$11.3
Met-Ed	1,018	1,024	\$11.2	\$8.9
PECO	2,949	4,043	\$27.1	\$22.8
PENELEC	1,019	1,224	\$15.4	\$20.9
PPL	3,953	3,139	\$20.6	\$17.4
PSEG	1,510	1,363	\$36.8	\$32.6
Pepco	2,486	1,956	\$16.3	\$9.8
RECO	49	49	\$0.0	\$0.0
Total	53,343	52,046	\$503.4	\$612.9

\* Through 31-March-2016

### Incremental ARRs (IARRs) for RTEP Upgrades

Table 13-5 lists the incremental ARR allocation volume for the planning periods from the 2008 to 2009 planning period through the 2015 to 2016 planning period.

**Table 13-5 Incremental ARR allocation volume: Planning periods 2008 to 2009 through 2015 to 2016**

Planning Period	Requested Count	Bid and Requested		Cleared Volume (MW)	Cleared Volume	Uncleared Volume (MW)	Uncleared Volume
		Volume (MW)	Volume (MW)				
2008/2009	15	890.5	890.5	890.5	100%	0	0%
2009/2010	14	530.5	530.5	530.5	100%	0	0%
2010/2011	14	531.0	531.0	531.0	100%	0	0%
2011/2012	15	595.0	595.0	595.0	100%	0	0%
2012/2013	15	687.4	687.4	687.4	100%	0	0%
2013/2014	17	1,087.4	1,087.4	1,087.4	100%	0	0%
2014/2015	18	1,447.4	1,447.4	1,447.4	100%	0	0%
2015/2016	18	1,290.5	1,290.5	1,290.5	100%	0	0%

Table 13-6 lists the three RTEP upgrade projects that were allocated a total of 678.2 MW of IARRs for the 2015 to 2016 planning period.

**Table 13-6 IARRs allocated for the 2015 to 2016 Annual ARR Allocation for RTEP upgrades**

Project #	Project Description	IARR Parameters			Total MW
		Source	Sink		
B0287	Install 600 MVAR Dynamic Reactive Device at Elroy 500kV	RTEP B0287 Source	DPL		190.6
B0328	TrAIL Project: 502 JCT - Loudoun 500kV	RTEP B0328 Source	Pepco		391.2
B0329	Cason-Suffolk 500 kV	RTEP B0329 Source	Dominion		96.4

### Residual ARRs

Only ARR holders that had their Stage 1 ARRs prorated are eligible to receive Residual ARRs. Residual ARRs are available if additional transmission system capability is added during the planning period after the annual ARR allocation. This additional transmission system capability would not have been accounted for in the initial annual ARR allocation, but it enables the creation of residual ARRs. Residual ARRs are effective on the first day of the month in which the additional transmission system capability is included in FTR auctions and exist until the end of the planning period. For the following planning period, any Residual ARRs are available as ARRs in the annual ARR allocation. Stage 1 ARR holders have a priority right to ARRs. Residual ARRs are a separate product from incremental ARRs.

Effective August 1, 2012, Residual ARRs are also available for eligible participants when a transmission outage was modeled in the Annual ARR Allocation, but the transmission facility becomes available during the modeled year. Residual ARRs awarded due to outages are effective for single, whole months and cannot be self scheduled. ARR target allocations are based on the clearing prices from FTR obligations in the effective monthly auction, may not exceed zonal network services peak load or firm transmission reservation levels and are only available up to the prorated ARR MW capacity as allocated in the Annual ARR Allocation.

Table 13-7 shows the Residual ARRs automatically allocated to eligible participants, along with the target allocations from the effective month. In the first ten months of the 2015 to 2016 planning period, PJM allocated a total of 30,118.1 MW of residual ARRs, up from 19,928.0 MW. Residual ARRs had a total target allocation of \$7.7 million for the first ten months of the 2015 to 2016 planning period, down from \$7.9 million for the first ten months of the 2014 to 2015 planning period consistent with a decrease in Monthly Balance of Planning Period Auction prices from the previous year. Some ARRs that were previously allocated in Stage 1B are now being allocated as Residual ARRs on a month to month basis without the option to self schedule.

**Table 13-7 Residual ARR allocation volume and target allocation: 2016**

Month	Bid and Requested		Cleared Volume	Target Allocation
	Volume (MW)	Cleared Volume (MW)		
Jan-16	6,710.0	2,992.7	44.6%	(\$669,918)
Feb-16	4,317.0	3,781.0	87.6%	\$1,732,883
Mar-16	6,422.8	3,935.0	61.3%	\$746,442
Total	17,449.8	10,708.7	61.4%	\$1,809,406

## Market Performance

### Stage 1A Infeasibility

Stage 1A ARRs are allocated for a 10 year period, with the ability for a participant to opt out of any planning period. PJM conducts a simultaneous feasibility analysis to determine the transmission upgrades required so that the long term ARRs can remain feasible. If a simultaneous feasibility test violation occurs in any year, PJM will identify or accelerate any transmission upgrades to resolve the violation and these upgrades will be recommended for inclusion in the PJM RTEP process.<sup>14</sup>

For the 2015 to 2016 planning period, Stage 1A of the Annual ARR Allocation was infeasible. As a result, modeled system capability, in excess of actual system capability, was provided to the Stage 1A ARRs and added to the FTR auction. According to Section 7.4.2 (i) of the PJM OATT, the capability limits of the binding constraints rendering these ARRs infeasible must be increased in the model and these increased limits must be used in subsequent ARR and FTR allocations and auctions for the entire planning period, except in the case of extraordinary circumstances.

The result of this required increased of capability in the models is an overallocation of both ARRs and FTRs for the entire planning period and an associated reduction in ARR and FTR funding.

In order to eliminate the infeasibilities for the requested Stage 1A ARR allocations, PJM was required to raise the modeled capacity limits on 84 facilities, 24 of which were internal to PJM, a total of 6,271 MW.<sup>15</sup>

### Revenue

ARRs are allocated to qualifying customers rather than sold, so there is no ARR revenue comparable to the revenue that results from the FTR auctions.

<sup>14</sup> PJM. "Manual 6: Financial Transmission Rights," Revision 16 (June 1, 2014), p22.

<sup>15</sup> PJM 2015/2016 Stage 1A Over allocation notice, PJM FTRs, <<http://www.pjm.com/~media/markets-ops/ft/annual-arr-allocation/2015-2016/2015-2016-stage-1a-over-allocation-notice.ashx>> (March 5, 2015).

## Revenue Adequacy

As with FTRs, revenue adequacy for ARR holders must be distinguished from the adequacy of ARRs as an offset to total congestion. Revenue adequacy is a narrower concept that compares the revenues available to ARR holders to the value of ARRs as determined in the Annual FTR Auction. ARRs have been revenue adequate for every auction to date. Customers that self schedule ARRs as FTRs have the same revenue adequacy characteristics as all other FTRs.

The adequacy of ARRs as an offset to total congestion compares ARR revenues to total congestion sinking in the participant's load zone as a measure of the extent to which ARRs offset market participants' actual, total congestion into their zone. Customers that self schedule ARRs as FTRs provide the same offset to congestion as all other FTRs.

ARR holders received a projected \$767.9 million in credits from the FTR auctions during the 2014 to 2015 planning period. The FTR auction revenue collected pays ARR holders' credits. During the 2014 to 2015 planning period, ARR holders received \$735.3 million in ARR credits.

Table 13-8 lists projected ARR target allocations from the Annual ARR Allocation and net revenue sources from the Annual and Monthly Balance of Planning Period FTR Auctions for the 2014 to 2015 planning period and the 2015 to 2016 planning periods. As seen here, due to decreased FTR volume leading to increased FTR nodal prices, auction revenue increased 26.0 percent while projected ARR target allocations increased 26.6 percent from the previous planning period.


**Table 13-8 Projected ARR revenue adequacy (Dollars (Millions)): Planning periods 2014 to 2015 and 2015 to 2016**

	2014/2015	2015/2016
Total FTR auction net revenue	\$767.9	\$967.4
Annual FTR Auction net revenue	\$748.6	\$936.3
Monthly Balance of Planning Period FTR Auction net revenue*	\$19.3	\$31.1
ARR target allocations	\$735.3	\$930.7
ARR credits	\$735.3	\$930.7
Surplus auction revenue	\$32.6	\$36.7
ARR payout ratio	100%	100%
FTR payout ratio*	100%	100%

\* Shows twelve months for 2014/2015 and ten months for 2015/2016.

Figure 13-2 shows the dollars per ARR MW held for each month of the 2010 to 2011 through 2015 to 2016 planning periods. The ARR MW held do not include self-scheduled FTRs and do include Residual ARRs starting in August 2012. FTR prices increased in the 2014 to 2015 Annual FTR Auction as a result of reduced supply caused by PJM's assumption of more outages in the model used to allocate Stage 1B and Stage 2 ARRs. The increased FTR prices resulted in an increase in dollars paid per ARR MW. For the 2014 to 2015 planning period, the total dollars per MW of ARR allocation was \$11,279, while the previous planning period resulted in a dollars per MW of \$6,692, a 68.5 percent increase in payment per allocated ARR MW. Some of the ARR MW lost from proration were provided in the Residual ARR process, but the residual allocations are not comparable to the ARRs awarded in the annual process because residual ARR allocations change each month and cannot be self scheduled as FTRs. For the first ten months of the 2015 to 2016 planning period, the dollars per MW of ARR allocation was \$9,609.79.

**Figure 13-2 Dollars per ARR MW paid to ARR holders: Planning periods 2010 to 2011 through 2015 to 2016**

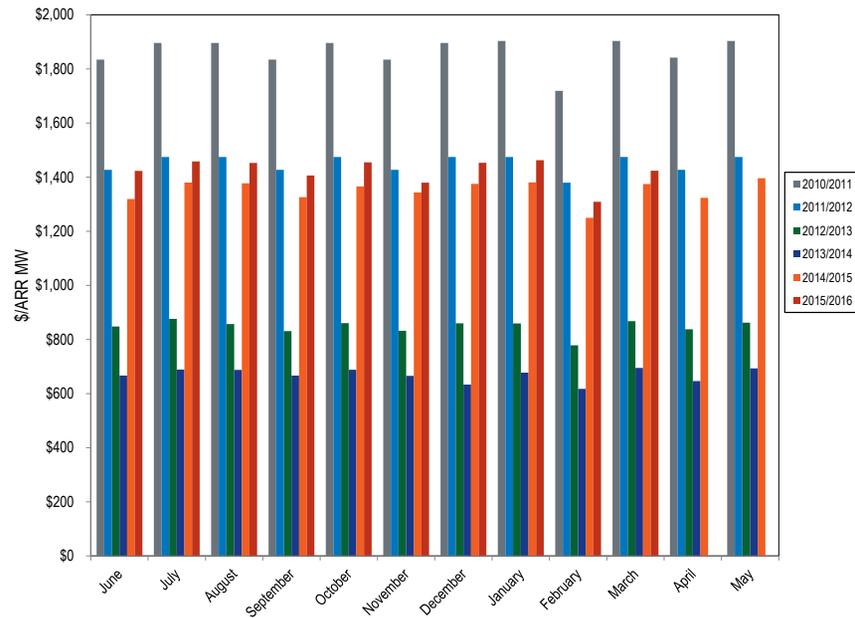


### Excess ARR Revenue

Figure 13-3 shows the monthly excess ARR revenue from the 2011 to 2012 through 2015 to 2016 planning periods. Excess ARR revenue is the revenue collected each month from FTR auctions in excess of ARR target allocations after PJM's implemented counter flow FTR clearing process. Stage 1A ARRs may be over allocated in the initial Stage 1A process, which requires that facility limits are increased above their actual capability. These increased facility limits must be carried over into the FTR auctions, which results in an over selling of FTR MW. Beginning with the 2014 to 2015 planning period, market rules allow PJM to decrease prevailing flow target allocations by clearing counter flow FTRs, without making the opposite prevailing flow FTR available, as long as ARRs remain revenue adequate. This allows PJM to use the excess ARR revenue to pay prevailing flow FTRs without increasing

prevailing flow obligations. This action removes money from the excess ARR revenue stream and caused the large decrease in excess ARR revenue beginning in June 2014. Currently, excess FTR auction revenue is allocated pro rata to FTR holders at the end of the planning period, instead of being distributed to ARR holders.

**Figure 13-3 Monthly excess ARR revenue: Planning periods 2011 to 2012 through 2015 to 2016**

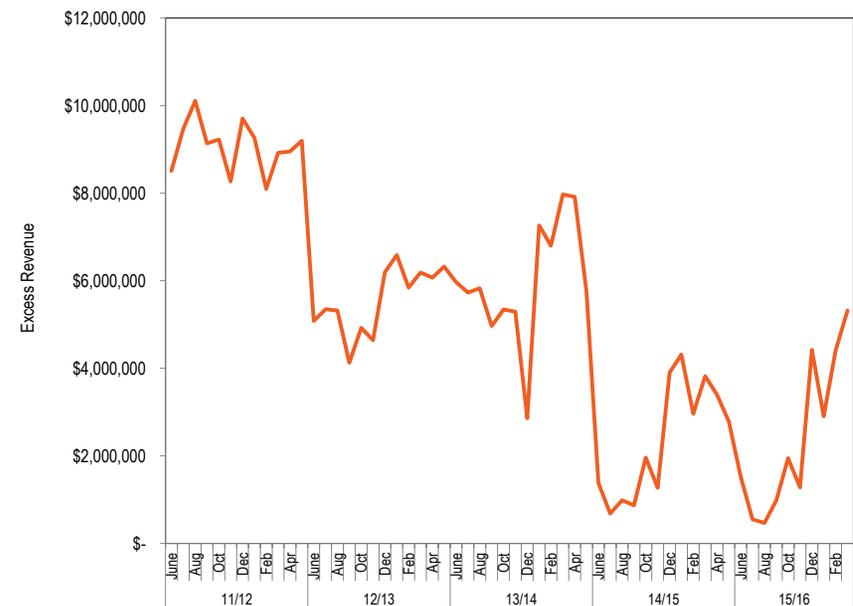

### Financial Transmission Rights

FTRs are financial instruments that entitle their holders to receive revenue or require them to pay charges based on locational congestion price differences in the Day-Ahead Energy Market across specific FTR transmission paths, subject to revenue availability. This value, termed the FTR target allocation, defines the maximum, but not guaranteed, payout for FTRs. The target allocation of

an FTR reflects the difference in congestion prices rather than the difference in LMPs, which includes both congestion and marginal losses.

Auction market participants are free to request FTRs between any eligible pricing nodes on the system. For the Long Term FTR Auction a list of available hubs, control zones, aggregates, generator buses and interface pricing points is available. For the Annual FTR Auction and FTRs bought for a quarterly period in the monthly auction the available FTR source and sink points include hubs, control zones, aggregates, generator buses, load buses and interface pricing points. An FTR bought in the Monthly FTR Auction for the single calendar month following the auction may include any bus for which an LMP is calculated in the FTR model used. As one of the measures to address FTR funding, effective August 5, 2011, PJM does not allow FTR buy bids to clear with a price of zero unless there is at least one constraint in the auction which affects the FTR path. FTRs are available to the nearest 0.1 MW. The FTR target allocation is calculated hourly and is equal to the product of the FTR MW and the congestion price difference between sink and source that occurs in the Day-Ahead Energy Market. The target allocation of an FTR can be positive or negative depending on the sink minus source congestion price difference, with a negative difference resulting in a liability for the holder. FTR holders with a negatively valued FTR are required to pay charges equal to their target allocations. The FTR target allocation is a cap on what FTR holders can receive. Revenues above that level on individual FTR paths are used to fund FTRs on paths which received less than their target allocations.

Available revenue to pay FTR holders is based on the amount of day-ahead and balancing congestion collected, payments by holders of negatively valued FTRs, Market to Market payments, excess ARR revenues available at the end of a month and any charges made to day-ahead operating reserves. Depending on the amount of revenues collected, FTR holders with a positively valued FTR may receive congestion credits between zero and their target allocations.

FTR funding is not on a path specific basis or on a time specific basis. There are widespread cross subsidies paid to equalize payments across paths and across time periods within a planning period. All paths receive the same

proportional level of target revenue at the end of the planning period. FTR auction revenues and excess revenues are carried forward from prior months and distributed back from later months. At the end of a planning period, if some months remain not fully funded, an uplift charge is collected from any FTR market participants that hold FTRs for the planning period based on their pro rata share of total net positive FTR target allocations, excluding any charge to FTR holders with a net negative FTR position for the planning year.

FTRs can be bought, sold and self scheduled. Buy bids are bids to buy FTRs in the auctions; sell offers are offers to sell existing FTRs in the auctions; and self-scheduled bids are FTRs that have been directly converted from ARRs in the Annual FTR Auction.

There are two types of FTR products: obligations and options. An obligation provides a credit, positive or negative, equal to the product of the FTR MW and the congestion price difference between FTR sink (destination) and source (origin) that occurs in the Day-Ahead Energy Market. An option provides only positive credits and options are available for only a subset of the possible FTR transmission paths.

There are three classes of FTR products: 24-hour, on peak and off peak. The 24-hour products are effective 24 hours a day, seven days a week, while the on peak products are effective during on peak periods defined as the hours ending 0800 through 2300, Eastern Prevailing Time (EPT) Mondays through Fridays, excluding North American Electric Reliability Council (NERC) holidays. The off peak products are effective during hours ending 2400 through 0700, EPT, Mondays through Fridays, and during all hours on Saturdays, Sundays and NERC holidays.

PJM operates an Annual FTR Auction for all participants. In addition, PJM conducts Monthly Balance of Planning Period FTR Auctions for the remaining months of the planning period, which allows participants to buy and sell residual transmission capability. PJM also runs a Long Term FTR Auction for the following three consecutive planning years. FTR options are not available in the Long Term FTR Auction. A secondary bilateral market is also

administered by PJM to allow participants to buy and sell existing FTRs. FTRs can also be exchanged bilaterally outside PJM markets.

The objective function of all FTR auctions is to maximize the bid-based value of FTRs awarded in each auction.

FTR buy bids and sell offers may be made as obligations or options and as any of the three classes. FTR self-scheduled bids are available only as obligations and 24-hour class, consistent with the associated ARRs, and only in the Annual FTR Auction.

## Supply and Demand

PJM oversees the process of selling and buying FTRs through ARR Allocations and FTR Auctions. Market participants purchase FTRs by participating in Long Term, Annual and Monthly Balance of Planning Period FTR Auctions.<sup>16</sup> FTRs can also be traded between market participants through bilateral transactions. ARRs may be self scheduled as FTRs for participation only in the Annual FTR Auction.

Total FTR supply is limited by the capability of the transmission system, as modeled in the Annual ARR Allocation. Stage 1A ARR requests must be granted, which artificially increases the capacity of the model on those facilities affected by the over allocated Stage 1A ARR requests. The capacity modeled in the Annual ARR Allocation is used as the capacity for the Annual FTR Auction to simultaneously accommodate the requested FTRs and the various combinations of requested FTRs. Depending on assumptions used in the auction transmission model, the total FTR supply can be greater than or less than system capability in aggregate and/or on an element by element basis. When FTR supply is greater than system capability, FTR target allocations will be greater than congestion revenues, contributing to FTR revenue inadequacy. Where FTR supply is less than system capability, FTR target allocations will be less than congestion revenues, contributing to FTR revenue surplus.

<sup>16</sup> See PJM. "Manual 6: Financial Transmission Rights," Revision 16 (June 1, 2014), p. 38.

PJM can also make further adjustments to the auction model to address expected revenue inadequacies. PJM can assume higher outage levels and PJM can decide to include additional constraints (closed loop interfaces) both of which reduce system capability in the auction model. These PJM actions reduce the supply of available Stage 1B and Stage 2 ARRs, which in turn reduce the number of FTRs available for purchase. PJM made such adjustments in the 2014 to 2015 and 2015 to 2016 planning year auction model.

For the Annual FTR Auction, known transmission outages that are expected to last for two months or more may be included in the model, while known outages of five days or more may be included in the model for the Monthly Balance of Planning Period FTR Auctions as well as any outages of a shorter duration that PJM determines would cause FTR revenue inadequacy if not modeled.<sup>17</sup> The full list of outages selected is publicly posted, but the process by which these outages are selected is not fully explained and PJM exercises significant discretion in selecting outages to accomplish FTR revenue adequacy.

But the auction process does not account for the fact that significant transmission outages, which have not been provided to PJM by transmission owners prior to the auction date, will occur during the periods covered by the auctions. Such transmission outages may or may not be planned in advance or may be emergency outages. In addition, it is difficult to model in an annual auction two outages of similar significance and similar duration in different areas which do not overlap in time. The choice of which to model may have significant distributional consequences. The fact that outages are modeled at significantly lower than historical levels results in selling too many FTRs which creates downward pressure on revenues paid to each FTR. To address this issue, the MMU has recommended that PJM use probabilistic outage modeling and seasonal ARR/FTR markets to better align the supply of ARRs and FTRs with actual system capabilities.

<sup>17</sup> See PJM. "Manual 6: Financial Transmission Rights," Revision 16 (June 1, 2014), p. 55.

## Monthly Balance of Planning Period FTR Auctions

The residual capability of the PJM transmission system, after the Long Term and Annual FTR Auctions are concluded, is offered in the Monthly Balance of Planning Period FTR Auctions. Existing FTRs are modeled as fixed injections and withdrawals. Outages expected to last five or more days are included in the determination of the simultaneous feasibility test for the Monthly Balance of Planning Period FTR Auction. These are single-round monthly auctions that allow any transmission service customer or PJM member to bid for any FTR or to offer for sale any FTR that they currently hold. Market participants can bid for or offer monthly FTRs for any of the next three months remaining in the planning period, or quarterly FTRs for any of the quarters remaining in the planning period. FTRs in the auctions include obligations and options and 24-hour, on peak and off peak products.<sup>18</sup>

## Secondary Bilateral Market

Market participants can buy and sell existing FTRs through the PJM administered, bilateral market, or market participants can trade FTRs among themselves without PJM involvement. Bilateral transactions that are not done through PJM can involve parties that are not PJM members. PJM has no knowledge of bilateral transactions that are done outside of PJM's bilateral market system.

For bilateral trades done through PJM, the FTR transmission path must remain the same, FTR obligations must remain obligations, and FTR options must remain options. However, an individual FTR may be split up into multiple, smaller FTRs, down to increments of 0.1 MW. FTRs can also be given different start and end times, but the start time cannot be earlier than the original FTR start time and the end time cannot be later than the original FTR end time.

## Buy Bids

The total FTR buy bids in the Monthly Balance of Planning Period FTR Auctions for the entire 2014 to 2015 planning period and the first ten months of the 2015 to 2016 planning period were 25,346,227 MW and 23,243,499 MW.

<sup>18</sup> See PJM, "Manual 6: Financial Transmission Rights," Revision 16 (June 1, 2014), p. 39.

## Patterns of Ownership

The overall ownership structure of FTRs and the ownership of prevailing flow and counter flow FTRs is descriptive and is not necessarily a measure of actual or potential FTR market structure issues, as the ownership positions result from competitive auctions.

In order to evaluate the ownership of prevailing flow and counter flow FTRs, the MMU categorized all participants owning FTRs in PJM as either physical or financial. Physical entities include utilities and customers which primarily take physical positions in PJM markets. Financial entities include banks and hedge funds which primarily take financial positions in PJM markets. International market participants that primarily take financial positions in PJM markets are generally considered to be financial entities even if they are utilities in their own countries.

Table 13-9 presents the Monthly Balance of Planning Period FTR Auction cleared FTRs for 2016 by trade type, organization type and FTR direction. Financial entities purchased 81.7 percent of prevailing flow FTRs, up 4.2 percent, and 75.2 percent of counter flow FTRs, down 10.0 percent, for the year, with the result that financial entities purchased 78.6 percent, down 3.0 percent, of all prevailing and counter flow FTR buy bids in the Monthly Balance of Planning Period FTR Auction cleared FTRs for 2016.

**Table 13-9 Monthly Balance of Planning Period FTR Auction patterns of ownership by FTR direction: 2016**

Trade Type	Organization Type	FTR Direction		All
		Prevailing Flow	Counter Flow	
Buy Bids	Physical	18.3%	24.8%	21.4%
	Financial	81.7%	75.2%	78.6%
	Total	100.0%	100.0%	100.0%
Sell Offers	Physical	32.5%	37.2%	34.2%
	Financial	67.5%	62.8%	65.8%
	Total	100.0%	100.0%	100.0%

Table 13-10 presents the average daily net position ownership for all FTRs for 2016, by FTR direction.

**Table 13-10 Daily FTR net position ownership by FTR direction: 2016**

Organization Type	FTR Direction		All
	Prevailing Flow	Counter Flow	
Physical	41.4%	23.6%	34.1%
Financial	58.6%	76.4%	65.9%
Total	100.0%	100.0%	100.0%

## Market Performance

### Volume

In an effort to address reduced FTR payout ratios, PJM may use normal transmission limits in the FTR auction model. These capability limits may be reduced if ARR funding is not impacted, all requested self-scheduled FTRs clear and net FTR Auction revenue is positive. If the normal capability limit cannot be reached due to infeasibilities then FTR Auction capability reductions are undertaken pro rata based on the MW of Stage 1A infeasibility and the availability of appropriate auction bids for counter flow FTRs.<sup>19</sup>

In another effort to reduce FTR funding issues, PJM implemented a new rule stating that PJM may model normal capability limits on facilities which are infeasible due to modeled transmission outages in Monthly Balance of Planning Period FTR Auctions. The capability of these facilities may be reduced if ARR target allocations are fully funded and net auction revenues are greater than zero. This reduction may only take place when there are counter flow auction bids available to reduce the infeasibilities.<sup>20</sup>

Table 13-11 provides the Monthly Balance of Planning Period FTR Auction market volume for the entire 2014 to 2015 planning period and the first ten months of the 2015 to 2016 planning period. There were 19,662,257 MW of FTR obligation buy bids and 4,048,894 MW of FTR obligation sell offers for all bidding periods in the first ten months of the 2015 to 2016 planning period.

<sup>19</sup> See PJM. "Manual 6: Financial Transmission Rights," Revision 16 (June 1, 2014) p. 56.

<sup>20</sup> See PJM. "Manual 6: Financial Transmission Rights," Revision 16 (June 1, 2014) p. 56.

The monthly balance of planning period auction cleared 2,154,584MW (8.9 percent) of FTR obligation buy bids and 1,098,875 MW (24.4 percent) of FTR obligation sell offers.

There were 3,581,242 MW of FTR option buy bids and 451,662 MW of FTR option sell offers for all bidding periods in the Monthly Balance of Planning Period FTR Auctions for the first ten months of the 2015 to 2016 planning period. The monthly auctions cleared 85,611 (2.4 percent) of FTR option buy bids, and 120,011 MW (26.6 percent) of FTR option sell offers.

**Table 13-11 Monthly Balance of Planning Period FTR Auction market volume: 2016**

Monthly Auction	Type	Trade Type	Bid and	Bid and	Cleared	Uncleared		
			Requested Count	Requested Volume (MW)	Volume (MW)	Cleared Volume (MW)	Uncleared Volume	
Jan-16	Obligations	Buy bids	341,467	2,106,004	235,561	11.2%	1,870,443	88.8%
		Sell offers	120,657	303,271	81,934	27.0%	221,338	73.0%
	Options	Buy bids	9,175	268,381	7,783	2.9%	260,598	97.1%
		Sell offers	8,075	37,712	10,212	27.1%	27,500	72.9%
Feb-16	Obligations	Buy bids	310,044	2,122,942	168,574	7.9%	1,954,368	92.1%
		Sell offers	99,043	267,534	79,992	29.9%	187,543	70.1%
	Options	Buy bids	24,657	487,736	9,869	2.0%	477,867	98.0%
		Sell offers	7,835	37,179	9,297	25.0%	27,881	75.0%
Mar-16	Obligations	Buy bids	328,233	2,040,401	256,731	12.6%	1,783,670	87.4%
		Sell offers	120,625	314,628	102,897	32.7%	211,731	67.3%
	Options	Buy bids	19,431	404,511	9,082	2.2%	395,429	97.8%
		Sell offers	9,806	44,757	11,080	24.8%	33,677	75.2%
2014/2015*	Obligations	Buy bids	3,360,128	21,777,160	2,201,036	10.1%	19,576,124	89.9%
		Sell offers	1,348,860	3,357,375	742,612	22.1%	2,614,762	77.9%
	Options	Buy bids	151,829	3,569,067	55,700	1.6%	3,513,367	98.4%
		Sell offers	35,890	225,710	71,258	31.6%	154,452	68.4%
2015/2016**	Obligations	Buy bids	3,679,996	19,662,257	2,068,973	10.5%	17,593,284	89.5%
		Sell offers	1,452,807	4,048,894	978,864	24.2%	3,070,030	75.8%
	Options	Buy bids	145,818	3,581,242	85,611	2.4%	3,495,631	97.6%
		Sell offers	101,921	451,662	120,011	26.6%	331,651	73.4%

\* Shows twelve months for 2014/2015; \*\* Shows ten months ended March 31 for 2015/2016

Table 13-12 presents the buy-bid, bid and cleared volume of the Monthly Balance of Planning Period FTR Auction, and the effective periods for the volume. The average monthly cleared volume for 2016 was 229,199.6 MW.

The average monthly cleared volume for the first three months of 2016 was 158,320.3 MW.

**Table 13-12 Monthly Balance of Planning Period FTR Auction buy-bid, bid and cleared volume (MW per period): 2016**

Monthly Auction	MW Type	Prompt Month	Second Month	Third Month	Q1	Q2	Q3	Q4	Total
Jan-16	Bid	1,330,456	389,271	264,547				390,110	2,374,385
	Cleared	126,983	33,997	17,849				64,514	243,344
Feb-16	Bid	1,612,886	305,237	352,140				340,415	2,610,677
	Cleared	114,428	24,775	21,204				18,035	178,442
Mar-16	Bid	1,476,838	381,466	372,548				214,060	2,444,912
	Cleared	155,020	44,575	37,508				28,710	265,813

Figure 13-4 shows cleared auction volumes as a percent of the total FTR cleared volume by calendar months for June 2004 through March 2016, by type of auction. FTR volumes are included in the calendar month they are effective, with Long Term and Annual FTR auction volume spread equally to each month in the relevant planning period. This figure shows the share of FTRs purchased in each auction type by month. Over the course of the planning period an increasing number of Monthly Balance of Planning Period FTRs are purchased, making them a greater portion of active FTRs. When the Annual FTR Auction occurs, FTRs purchased in any previous Monthly Balance of Planning Period Auction, other than the current June auction, are no longer in effect, so there is a reduction in their share of total FTRs with an accompanying rise in the share of Annual FTRs.

**Figure 13-4 Cleared auction volume (MW) as a percent of total FTR cleared volume by calendar month: June 2004 through March 2016**

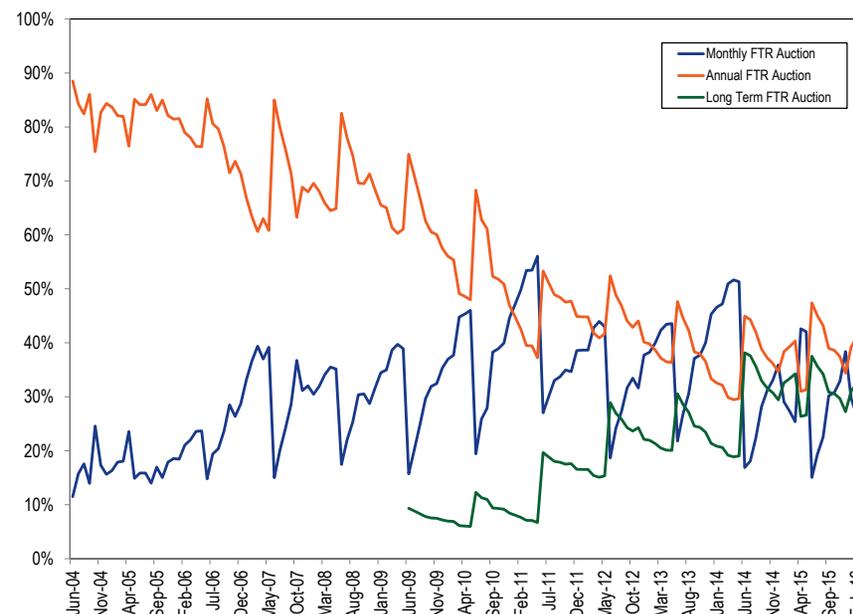


Table 13-13 provides the secondary bilateral FTR market volume for the entire 2014 to 2015 and 2015 to 2016 planning periods.

**Table 13-13 Secondary bilateral FTR market volume: Planning periods 2014 to 2015 and 2015 to 2016<sup>21</sup>**


Planning Period	Type	Class Type	Volume (MW)
2014/2015	Obligation	24-Hour	203
		On Peak	1,535
		Off Peak	1,141
		Total	2,879
		Option	24-Hour
2015/2016	Obligation	24-Hour	668
		On Peak	29,197
		Off Peak	24,671
		Total	54,536
		Option	24-Hour
2015/2016	Option	24-Hour	0
		On Peak	8,606
		Off Peak	6,140
		Total	14,746

Figure 13-5 shows the FTR bid, cleared and net bid volume from June 2003 through March 2016 for Long Term, Annual and Monthly Balance of Planning Period Auctions.<sup>22</sup> Cleared volume is the volume of FTR buy and sell offers that were accepted. The net bid volume includes the total buy, sell and self-scheduled offers, counting sell offers as a negative volume. The bid volume is the total of all bid and self-scheduled offers, excluding sell offers. Bid volumes and net bid volumes have increased since 2003. Cleared volume was relatively steady until 2010, with an increase in 2011 followed by a slight decrease in 2012. In 2013, cleared volume increased, and there was a larger increase in 2014. The demand for FTRs has increased.

<sup>21</sup> The 2014 to 2015 planning period covers bilateral FTRs that are effective for any time between June 1, 2014 through June 1, 2015, which originally had been purchased in a Long Term FTR Auction, Annual FTR Auction or Monthly Balance of Planning Period FTR Auction.

<sup>22</sup> The data for this figure are available in *2015 State of the Market Report for PJM*, Volume 2, Appendix H.

**Figure 13-5 Long Term, Annual and Monthly FTR Auction bid and cleared volume: June 2003 through March 2016**

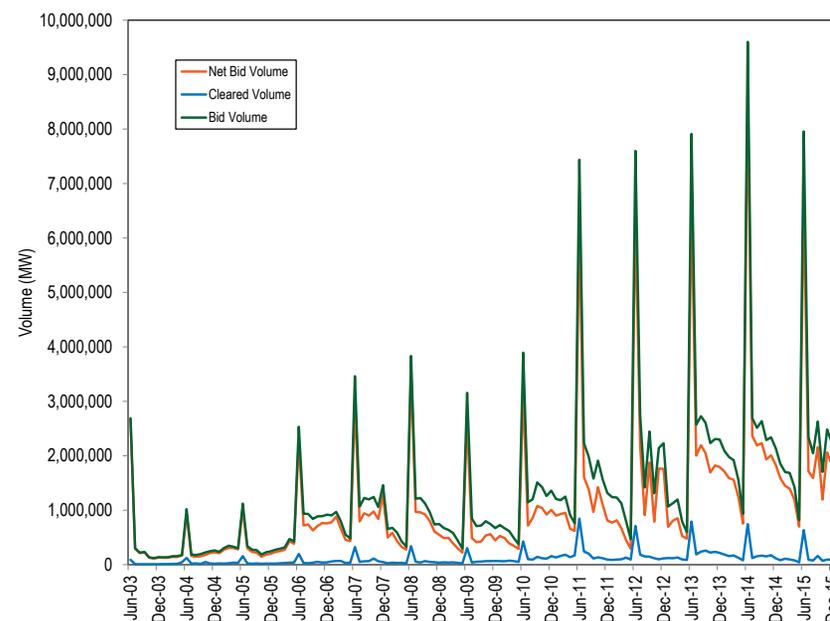

## Price

Table 13-14 shows the weighted-average cleared buy-bid price in the Monthly Balance of Planning Period FTR Auctions by bidding period for January 2016 through March 2016. For example, for the January 2016 Monthly Balance of Planning Period FTR Auction, the current month column is January, the second month column is February and the third month column is March. Quarters 1 through 4 are represented in the Q1, Q2, Q3 and Q4 columns. The total column represents all of the activity within the January 2016 Monthly Balance of Planning Period FTR Auction.

The cleared weighted-average price paid in the Monthly Balance of Planning Period FTR Auctions for January through March 2016 was \$0.13 per MW, down from \$0.25 per MW in the same time last year, a 48.0 percent decrease

in FTR prices. The cleared weighted-average price for the current planning period was \$0.21, up 16.7 percent from \$0.18 for the same time period during the previous planning period.

**Table 13-14 Monthly Balance of Planning Period FTR Auction cleared, weighted-average, buy-bid price per period (Dollars per MW): January through March 2016**

Monthly Auction	Prompt Month	Second Month	Third Month	Q1	Q2	Q3	Q4	Total
Jan-16	\$0.13	\$0.29	(\$0.00)				\$0.07	\$0.11
Feb-16	\$0.13	\$0.20	\$0.12				\$0.20	\$0.16
Mar-16	\$0.15	\$0.11	\$0.07				\$0.07	\$0.12

## Profitability

FTR profitability is the difference between the revenue received for an FTR and the cost of the FTR. For a prevailing flow FTR, the FTR credits are the actual revenue that an FTR holder receives and the auction price is the cost. For a counter flow FTR, the auction price is the revenue that an FTR holder is paid and the FTR credits are the cost to the FTR holder, which the FTR holder must pay. The cost of self-scheduled FTRs is zero. ARR holders that self schedule FTRs purchase the FTRs in the Annual FTR Auction, but the ARR holders receive offsetting ARR credits that equal the purchase price of the FTRs.

The fact that FTRs have been consistently profitable regardless of the payout ratio raises questions about the design of the process. If FTRs are profitable why do participants not bid FTR prices up to the point where profits approach zero?

Table 13-15 lists FTR profits by organization type and FTR direction for the period from January through March 2016. FTR profits are the sum of the daily FTR credits, including for self-scheduled FTRs, minus the daily FTR auction costs for each FTR held by an organization. The FTR target allocation is equal to the product of the FTR MW and congestion price differences between sink and source in the Day-Ahead Energy Market. The FTR credits do not include

after the fact adjustments which are very small and do not occur in every month. The daily FTR auction costs are the product of the FTR MW and the auction price divided by the time period of the FTR in days. Self-scheduled FTRs have zero cost. FTRs were profitable overall, with \$68.8 million in profits for physical entities, of which \$61.2 million was from self-scheduled FTRs, and \$46.9 million for financial entities.

**Table 13-15 FTR profits by organization type and FTR direction: 2016**

Organization Type	FTR Direction				All
	Prevailing Flow	Self Scheduled Prevailing Flow	Counter Flow	Self Scheduled Counter Flow	
Physical	(\$266,484)	\$61,394,621	\$7,787,443	(\$156,588)	\$68,758,992
Financial	(\$10,329,979)	NA	\$57,251,351	NA	\$46,921,372
Total	(\$10,596,463)	\$61,394,621	\$65,038,794	(\$156,588)	\$115,680,364

Table 13-16 lists the monthly FTR profits in 2016 by organization type.

**Table 13-16 Monthly FTR profits by organization type: 2016**

Month	Organization Type			Total
	Physical	Self Scheduled Physical FTRs	Financial	
Jan	(\$4,531,571)	\$23,079,268	\$25,805,666	\$44,353,362
Feb	\$5,541,933	\$24,807,245	\$19,982,800	\$50,331,977
Mar	\$6,510,598	\$13,351,520	\$1,132,906	\$20,995,025
Total	\$7,520,959	\$61,238,033	\$46,921,372	\$115,680,364

## Revenue

### Monthly Balance of Planning Period FTR Auction Revenue

Table 13-17 shows Monthly Balance of Planning Period FTR Auction revenue by trade type, type and class type for January through March 2016. The Monthly Balance of Planning Period FTR Auctions for the 2015 to 2016 planning period netted \$31.1 million in revenue, with buyers paying \$250.9 million and sellers receiving \$219.8 million for the first ten months of the 2015 to 2016 planning period. For the entire 2014 to 2015 planning period, the Monthly Balance of Planning Period FTR Auctions netted \$19.3 million

in revenue with buyers paying \$214.3 million and sellers receiving \$195.0 million.

**Table 13-17 Monthly Balance of Planning Period FTR Auction revenue: 2016**

Monthly Auction	Type	Trade Type	Class Type			
			24-Hour	On Peak	Off Peak	All
Jan-16	Obligations	Buy bids	\$2,767,129	\$6,642,066	\$5,322,646	\$14,731,841
		Sell offers	(\$1,527,329)	\$6,009,617	\$4,867,971	\$9,350,259
	Options	Buy bids	\$7,749	\$433,485	\$222,655	\$663,889
		Sell offers	\$4,548	\$2,013,776	\$1,952,220	\$3,970,544
Feb-16	Obligations	Buy bids	\$2,484,838	\$5,046,424	\$3,565,515	\$11,096,777
		Sell offers	(\$566,504)	\$4,516,965	\$3,621,103	\$7,571,565
	Options	Buy bids	\$4,254	\$586,461	\$407,158	\$997,873
		Sell offers	\$8,038	\$1,653,043	\$1,337,798	\$2,998,879
Mar-16	Obligations	Buy bids	\$3,613,801	\$5,764,687	\$3,975,010	\$13,353,498
		Sell offers	\$316,238	\$5,416,263	\$3,820,100	\$9,552,601
	Options	Buy bids	\$16,807	\$431,121	\$223,272	\$671,200
		Sell offers	\$5,536	\$1,528,874	\$1,167,147	\$2,701,557
2014/2015*	Obligations	Buy bids	\$14,690,243	\$114,510,024	\$74,009,738	\$203,210,005
		Sell offers	\$10,416,134	\$96,121,532	\$63,750,015	\$170,287,681
	Options	Buy bids	\$163,116	\$6,269,159	\$4,616,812	\$11,049,087
		Sell offers	\$39,972	\$13,570,524	\$11,100,778	\$24,711,274
Net Total			\$4,397,253	\$11,087,127	\$3,775,756	\$19,260,137
2015/2016**	Obligations	Buy bids	\$17,110,082	\$127,358,248	\$87,073,525	\$231,541,855
		Sell offers	(\$3,434,859)	\$100,942,999	\$73,520,042	\$171,028,183
	Options	Buy bids	\$33,960	\$11,801,049	\$7,563,488	\$19,398,497
		Sell offers	\$226,332	\$28,303,217	\$20,241,381	\$48,770,929
Net Total			\$28,058,950	\$209,406,714	\$139,925,374	\$377,391,038

\* Shows Twelve Months; \*\* Shows ten months

## FTR Target Allocations

FTR target allocations were examined separately by source and sink contribution. Hourly FTR target allocations were divided into those that were benefits and liabilities and summed by sink and by source for the 2015 to 2016 planning period. Figure 13-6 shows the ten largest positive and negative FTR target allocations, summed by sink, for the 2015 to 2016 planning period. The top 10 sinks that produced financial benefit accounted for 47.45 percent of total positive target allocations during the 2015 to 2016 planning period with the Northern Illinois Hub accounting for 11.5 percent of all positive target allocations. The top 10 sinks that created liability accounted for 23.7

percent of total negative target allocations with the Western Hub accounting for 4.6 percent of all negative target allocations.

**Figure 13-6 Ten largest positive and negative FTR target allocations summed by sink: 2015 to 2016 planning period**


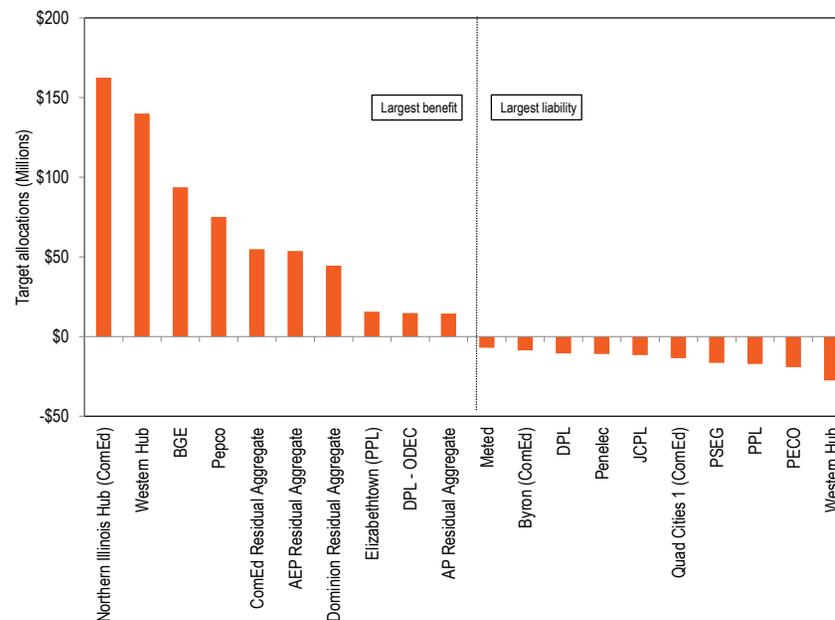


Figure 13-7 shows the ten largest positive and negative FTR target allocations, summed by source, for the 2015 to 2016 planning period. The top 10 sources with a positive target allocation accounted for 34.2 percent of total positive target allocations with the Western Hub accounting for 6.4 percent of total positive target allocations. The top 10 sources with a negative target allocation accounted for 30.2 percent of all negative target allocations, with the Western Hub accounting for 17.4 percent.

**Figure 13-7 Ten largest positive and negative FTR target allocations summed by source: 2015 to 2016 planning period**

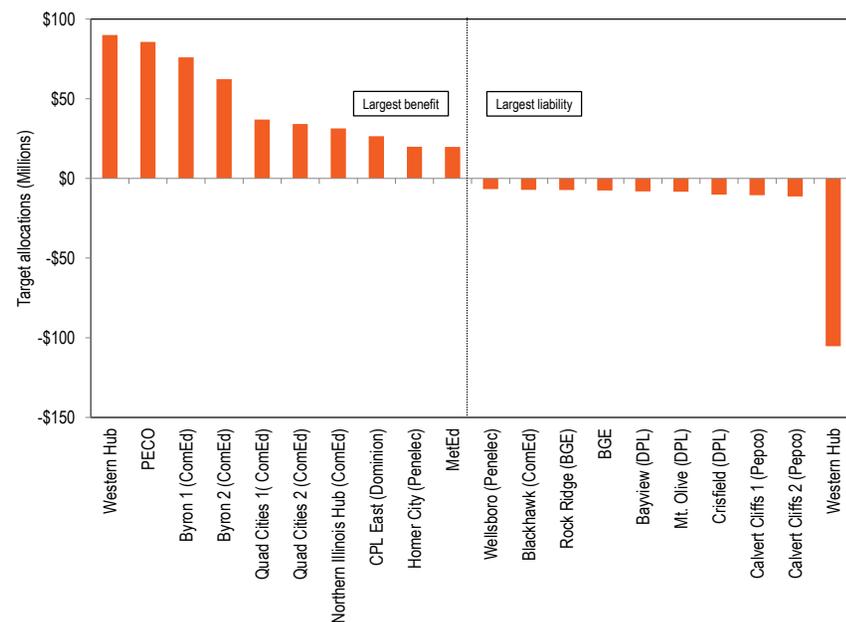

### Revenue Adequacy

Congestion revenue is created in an LMP system when all loads pay and all generators receive their respective LMPs. When load in a constrained area pays more than the amount that generators receive, excluding losses, positive congestion revenue exists and is available to cover the target allocations of FTR holders. The load MW exceed the generation MW in constrained areas because part of the load is served by imports using transmission capability into the constrained areas. That is why load, which pays for the transmission capability, receives ARR to offset congestion in the constrained areas. Generating units that are the source of such imports are paid the price at their own bus, which does not reflect congestion in constrained areas. Generation in constrained areas receives the congestion price and all load in constrained areas pays the congestion price. As a result, load congestion payments are

greater than the congestion-related payments to generation.<sup>23</sup> That is the source of the congestion revenue to pay holders of ARRs and FTRs. In general, FTR revenue adequacy exists when the sum of congestion credits is equal to or greater than the sum of congestion across the net positively valued FTRs. If PJM allocated FTRs equal to the transmission capability into constrained areas, FTR payouts would equal the sum of congestion.

Revenue adequacy must be distinguished from the adequacy of FTRs as an offset against total congestion. Revenue adequacy is a narrower concept that compares total congestion revenues to the total target allocations across the specific paths for which FTRs were available and purchased. A path specific target allocation is not a guarantee of payment. The adequacy of FTRs as an offset against congestion compares ARR and FTR revenues to total congestion on the system as a measure of the extent to which ARRs and FTRs offset the actual, total congestion across all paths paid by market participants, regardless of the availability of ARRs or the availability or purchase of FTRs.

FTRs are paid each month from congestion revenues, both day-ahead and balancing. FTR auction revenues and excess revenues are carried forward from prior months and distributed back from later months. For example, in June 2014, there was \$2.9 million in excess congestion revenue, to be used to fund months later in the planning period that may have a revenue shortfall. At the end of a planning period, if some months remain not fully funded, an uplift charge is collected from any FTR market participants that hold FTRs during the planning period based on their pro rata share of total net positive FTR target allocations, excluding any charge to FTR holders with a net negative FTR position for the planning year. For example, the 2013 to 2014 planning period was not revenue adequate, and thus this uplift charge was collected from FTR participants. There was excess congestion revenue at the end of the 2014 to 2015 planning period, which is distributed to FTR participants in the same manner that the FTR uplift is applied.

<sup>23</sup> For an illustration of how total congestion revenue is generated and how FTR target allocations and congestion receipts are determined, see Table G-1, "Congestion revenue, FTR target allocations and FTR congestion credits: Illustration," *MMU Technical Reference for PJM Markets*, at "Financial Transmission and Auction Revenue Rights."

FTR revenues are primarily comprised of hourly congestion revenue, from the day-ahead and balancing markets.<sup>24</sup> FTR revenues also include ARR excess, which is the difference between ARR target allocations and FTR auction revenues, and negative FTR target allocations, which is an income for the FTR market from FTRs with a negative target allocation. Competing use revenues are based on the Unscheduled Transmission Service Agreement between the New York Independent System Operator (NYISO) and PJM. This agreement sets forth the terms and conditions under which compensation is provided for transmission service in connection with transactions not scheduled directly or otherwise prearranged between NYISO and PJM. Congestion revenues appearing in Table 13-18 include both congestion charges associated with PJM facilities and those associated with reciprocal, coordinated flowgates (M2M flowgates) in MISO and NYISO whose operating limits are respected by PJM.<sup>25</sup>

Market to market operations resulted in NYISO, MISO and PJM redispatching units to control congestion on flowgates located in the other's area and in the exchange of payments for this redispatch. The Firm Flow Entitlement (FFE) represents the amount of historic flow that each RTO had created on each reciprocally coordinated flowgate (RCF) used in the market to market settlement process. The FFE establishes the amount of market flow that each RTO is permitted to create on the RCF before incurring redispatch costs during the market to market process. If the non-monitoring RTO's real-time market flow is greater than their FFE plus the approved MW adjustment from day-ahead coordination, then the non-monitoring RTO will pay the monitoring RTO based on the difference between their market flow and their FFE. If the non-monitoring RTO's real-time market flow is less than their FFE plus the approved MW adjustment from day-ahead coordination, then the monitoring RTO will pay the non-monitoring RTO for congestion relief provided by the non-monitoring RTO based on the difference between the non-monitoring RTO's market flow and their FFE.

<sup>24</sup> When hourly congestion revenues are negative, it is defined as a net negative congestion hour.

<sup>25</sup> See "Joint Operating Agreement between the Midwest Independent System Operator, Inc. and PJM Interconnection, LLC." (December 11, 2008), Section 6.1 <<http://pjm.com/media/documents/merged-tariffs/miso-joa.pdf>>. (Accessed February 23, 2016)

For the 2014 to 2015 planning period, PJM paid MISO and NYISO a combined \$33.2 million for redispatch on the designated M2M flowgates, and for the 2015 to 2016 planning period PJM paid MISO and NYISO a combined \$16.7 million. The timing of the addition of new M2M flowgates may reduce FTR funding levels. MISO's ability to add flowgates dynamically throughout the planning period, which were not modeled in any previous PJM FTR auction, may result in oversold FTRs in PJM, and as a direct consequence, reduce FTR funding.

FTRs were paid at 100 percent of the target allocation level for the 2014 to 2015 and 2015 to 2016 planning periods. Congestion revenues are allocated to FTR holders based on FTR target allocations. PJM collected \$1,457.1 million of FTR revenues during the 2014 to 2015 planning period, and \$869.2 million during the 2015 to 2016 planning period. Congestion in January 2014 was extremely high due to cold weather events, resulting in target allocations and congestion revenues that were unusually high for 2014. For the 2015 to 2016 planning period, the top sink and top source with the highest positive FTR target allocations were the Northern Illinois Hub and Western Hub. The top sink and top source with the largest negative FTR target allocation was the Western Hub.

This high level of revenue adequacy was primarily due to actions taken by PJM to address prior low levels of revenue adequacy. PJM's actions included PJM's assumption of higher outage levels and PJM's decision to include additional constraints (closed loop interfaces) both of which reduced system capability in the FTR auction model. PJM's actions led to a significant reduction in the allocation of Stage 1B and Stage 2 ARRs. For the 2014 to 2015 planning period, Stage 1B and Stage 2 ARR allocations were reduced 84.9 percent and 88.1 percent from the 2013 to 2014 planning period. For the 2015 to 2016 planning period, Stage 1B and Stage 2 ARR allocations were reduced 76.9 percent and 82.0 percent from the 2013 to 2014 planning period. The result of this change in modeling was also that available FTR capacity decreased for the planning period. This decrease resulted in an increase in FTR nodal prices for the Annual FTR Auction. The result was fewer available ARRs, but an increased dollar per MW value for those ARRs. The results are in the total

ARR target allocations in Table 13-18 and the dollars per MW increase in Figure 13-2.

Table 13-18 presents the PJM FTR revenue detail for the 2014 to 2015 planning period and the 2015 to 2016 planning period.

**Table 13-18 Total annual PJM FTR revenue detail (Dollars (Millions)): Planning periods 2014 to 2015 and 2015 to 2016**

Accounting Element	2014/2015	2015/2016
<b>ARR information</b>		
ARR target allocations	\$765.9	\$803.5
FTR auction revenue	\$794.9	\$827.3
ARR excess	\$29.0	\$23.8
<b>FTR targets</b>		
Positive target allocations	\$1,551.6	\$982.2
Negative target allocations	(\$293.7)	(\$176.6)
FTR target allocations	\$1,257.8	\$805.7
<b>Adjustments:</b>		
Adjustments to FTR target allocations	(\$3.5)	(\$0.3)
Total FTR targets	\$1,254.4	\$805.4
<b>FTR revenues</b>		
ARR excess	\$29.0	\$23.8
<b>Congestion</b>		
Net Negative Congestion (enter as negative)	(\$69.6)	(\$23.0)
Hourly congestion revenue	\$1,463.8	\$891.3
Midwest ISO M2M (credit to PJM minus credit to Midwest ISO)	(\$33.2)	(\$28.9)
<b>Adjustments:</b>		
Excess revenues carried forward into future months	\$63.7	\$8.3
Excess revenues distributed back to previous months	\$0.0	\$0.0
Other adjustments to FTR revenues	\$0.0	\$0.0
<b>Total FTR revenues</b>		
Excess revenues distributed to other months	\$115.1	\$55.5
Net Negative Congestion charged to DA Operating Reserves	\$0.0	\$0.0
Total FTR congestion credits	\$1,457.1	\$869.2
Total congestion credits on bill (includes CEP5W and end-of-year distribution)	\$1,457.1	\$869.2
Remaining deficiency	(\$115.1)	(\$55.5)

FTR target allocations are based on hourly prices in the Day-Ahead Energy Market for the respective FTR paths and are defined to be the revenue required to compensate FTR holders for congestion on those specific paths. FTR credits are paid to FTR holders and, depending on market conditions, can be less than the target allocations. Table 13-19 lists the FTR revenues, target allocations, credits, payout ratios, congestion credit deficiencies and excess congestion charges by month. At the end of the 12-month planning period, excess congestion charges are used to offset any monthly congestion credit deficiencies.

The total row in Table 13-19 is not the sum of each of the monthly rows because the monthly rows may include excess revenues carried forward from prior months and excess revenues distributed back from later months. November and December 2015 and March 2016, had a revenue shortfall totaling \$8.3 million, but were fully funded using excess revenue from previous months.

**Table 13–19 Monthly FTR accounting summary (Dollars (Millions)): Planning period 2014 to 2015 and 2015 to 2016**

Period	FTR Revenues (with adjustments)	FTR Target Allocations	FTR Payout Ratio (original)	FTR Credits (with adjustments)	FTR Payout Ratio (with adjustments)	Monthly Credits Excess/Deficiency (with adjustments)
Jun-14	\$89.0	\$86.1	100.0%	\$89.0	100.0%	\$2.9
Jul-14	\$104.0	\$84.4	100.0%	\$104.0	100.0%	\$20.2
Aug-14	\$69.5	\$49.2	100.0%	\$69.5	100.0%	\$20.3
Sep-14	\$88.7	\$75.0	100.0%	\$88.7	100.0%	\$13.7
Oct-14	\$80.5	\$80.5	91.9%	\$80.5	100.0%	(\$6.7)
Nov-14	\$106.4	\$106.4	83.3%	\$106.4	100.0%	(\$17.7)
Dec-14	\$65.4	\$58.2	100.0%	\$58.2	100.0%	\$8.7
Jan-15	\$132.0	\$123.5	100.0%	\$123.5	100.0%	\$8.5
Feb-15	\$425.8	\$316.8	100.0%	\$316.8	100.0%	\$109.1
Mar-15	\$112.3	\$112.3	64.6%	\$112.3	100.0%	(\$38.7)
Apr-15	\$70.3	\$60.8	100.0%	\$70.3	100.0%	\$9.5
May-15	\$108.4	\$98.6	100.0%	\$108.4	100.0%	\$9.8
Summary for Planning Period 2014 to 2015						
Total	\$1,452.3	\$1,251.6		\$1,327.5	100.0%	\$139.6
Jun-15	\$103.8	\$83.8	100.0%	\$103.8	100.0%	\$20.0
Jul-15	\$88.0	\$67.5	100.0%	\$88.0	100.0%	\$20.5
Aug-15	\$57.3	\$47.6	100.0%	\$57.3	100.0%	\$9.7
Sep-15	\$77.5	\$76.6	100.0%	\$77.5	100.0%	\$0.9
Oct-15	\$84.8	\$82.6	100.0%	\$82.6	100.0%	\$2.2
Nov-15	\$91.9	\$92.3	99.5%	\$92.3	100.0%	(\$0.4)
Dec-15	\$66.1	\$69.1	95.6%	\$69.1	100.0%	(\$3.0)
Jan-16	\$105.7	\$102.1	100.0%	\$102.1	100.0%	(\$3.7)
Feb-16	\$110.5	\$103.7	100.0%	\$103.7	100.0%	(\$6.8)
Mar-16	\$75.3	\$80.2	93.8%	\$80.2	100.0%	\$4.9
Summary for Planning Period 2015 to 2016						
Total	\$860.9	\$805.4		\$856.6	100.0%	\$44.3

Figure 13–8 shows the original PJM reported FTR payout ratio by month, excluding excess revenue distribution, for January 2004 through December 2015. The months with payout ratios above 100 percent have excess congestion revenue and the months with payout ratios under 100 percent are revenue inadequate. Figure 13–8 also shows the payout ratio after distributing excess revenue across months within the planning period. If there are excess revenues in a given month, the excess is distributed to other months within the planning period that were revenue deficient. The payout ratio for revenue inadequate months in the current planning period may change if excess revenue is collected in the remainder of the planning period. March 2015, had high levels of negative balancing congestion that resulted in a payout ratio of 64.6 percent. However, there was enough excess from previous months to bring the payout ratio to 100 percent.

Figure 13-8 FTR payout ratio by month, excluding and including excess revenue distribution: January 2004 through March 2016

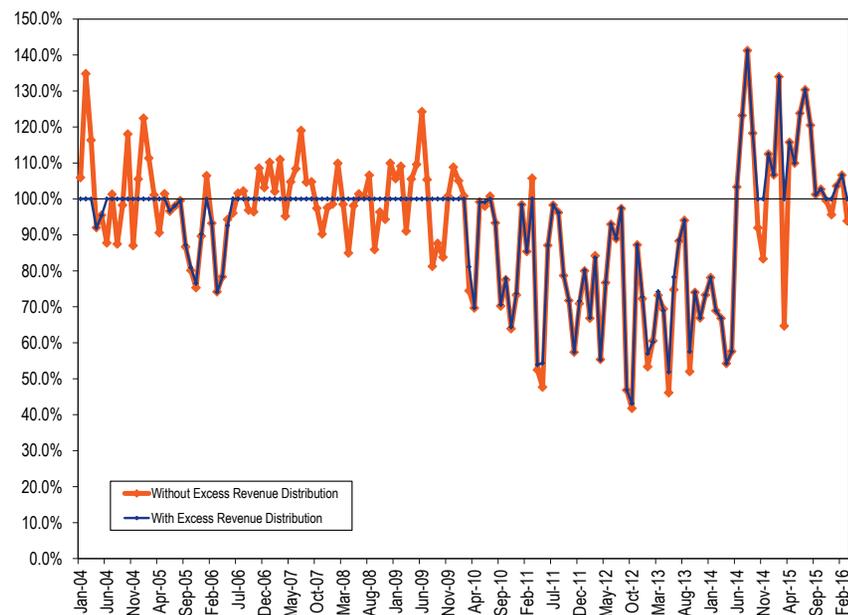


Table 13-20 shows the FTR payout ratio by planning period from the 2003 to 2004 planning period forward. Planning period 2013 to 2014 includes the additional revenue from unallocated congestion charges from Balancing Operating Reserves. For the 2014 to 2015 planning period, there was excess congestion revenue to pay target allocations resulting in a reported payout ratio of 116.2 percent for the planning period. This excess will be distributed to FTR participants pro rata based on their net positive target allocations.

Table 13-20 PJM reported FTR payout ratio by planning period

Planning Period	FTR Payout Ratio
2003/2004	97.7%
2004/2005	100.0%
2005/2006	90.7%
2006/2007	100.0%
2007/2008	100.0%
2008/2009	100.0%
2009/2010	96.9%
2010/2011	85.0%
2011/2012	80.6%
2012/2013	67.8%
2013/2014	72.8%
2014/2015	100.0%
2015/2016	100.0%

### FTR Uplift Charge

At the end of the planning period, an uplift charge is applied to FTR holders. This charge is to cover the net of the monthly deficiencies in the target allocations calculated for individual participants. An individual participant's uplift charge is a pro rata charge, to cover this deficiency, based on their net target allocation with respect to the total net target allocation of all participants with net positive target allocations for the planning period. Participants pay an uplift charge that is a ratio of their share of net positive target allocations to the total net positive target allocations.

The uplift charge is only applied to, and calculated from, members with a net positive target allocation at the end of the planning period. Members with a net negative target allocation have their year-end target allocation set to zero for all uplift calculations. Since participants in the FTR Market with net positive target allocations are paying the uplift charge to fully fund FTRs, their payout ratio cannot be 100 percent. The end of planning period payout ratio is calculated as the participant's target allocations minus the uplift charge applied to them divided by their target allocations. The calculations of uplift are structured so that, at the end of the planning period, every participant in the FTR Market with a positive net target allocation receives payments based on the same payout ratio. At the end of the planning period and the

end of a given month no payout ratio is actually applied to a participant's target allocations. The payout ratio is simply used as a reporting mechanism to demonstrate the amount of revenue available to pay target allocations and represent the percentage of target allocations a participant with a net positive portfolio has been paid for the planning period. However, this same calculation is not accurate when calculating a single month's payout ratio as currently reported, where the calculation of available revenue is not the same.

The total planning period target allocation deficiency is the sum of the monthly deficiencies throughout the planning period. The monthly deficiency is the difference in the net target allocation of all participants and the total revenue collected for that month. The total revenue paid to FTR holders is based on the hourly congestion revenue collected, which includes hourly M2M, wheel payments and unallocated congestion credits.

Table 13-21 provides a demonstration of how the FTR uplift charge is calculated. In this example it is important to note that the sum of the net positive target allocations is \$32 and the total monthly deficiency is \$10. The uplift charge is structured so that those with higher target allocations pay more of the deficit, which ultimately impacts their net payout. Also, in this example, and in the PJM settlement process, the monthly payout ratio varies for all participants, but the uplift charge is structured so that once the uplift charge is applied the end of planning period payout ratio is the same for all participants.

For the 2012 to 2013 planning period, the total deficiency was \$291.8 million. The top ten participants with the highest target allocations paid 53.6 percent of the total deficiency for the planning period. All of the uplift money is collected from individual participants, and distributed so that every participant experiences the same payout ratio. This means that some participants subsidize others and receive less payout from their FTRs after the uplift is applied, while others receive a subsidy and get a higher payout after the uplift is applied. In this example, participants 1 and 5 are paid less after the uplift charge is applied, while participants 3 and 4 are paid more.

**Table 13-21 End of planning period FTR uplift charge example**

Participant	Net Target Allocation	Total Monthly Payment	Monthly Deficiency	Uplift Charge	Net Payout	Payout Change	Monthly Payout Ratio	EOPP Payout Ratio
1	\$10.00	\$8.00	\$2.00	\$3.13	\$6.88	(\$1.13)	80.0%	68.8%
2	(\$4.00)	\$0.00	\$0.00	\$0.00	(\$4.00)	\$0.00	100.0%	100.0%
3	\$15.00	\$10.00	\$5.00	\$4.69	\$10.31	\$0.31	66.7%	68.8%
4	\$3.00	\$1.00	\$2.00	\$0.94	\$2.06	\$1.06	33.3%	68.8%
5	\$4.00	\$3.00	\$1.00	\$1.25	\$2.75	(\$0.25)	75.0%	68.8%
Total	\$28.00	\$22.00	\$10.00	\$10.00	\$18.00	\$0.00		

## Revenue Adequacy Issues and Solutions

### PJM Reported Payout Ratio

The payout ratios shown in Table 13-22 reflect the PJM reported payout ratios for each month of the planning period. These reported payout ratios equal congestion revenue divided by the sum of the net positive and net negative target allocations for each hour of the month. This does not correctly measure the payout ratio actually received by positive target allocation FTR holders in the month, but provides an estimate of the ratio based on the approach to end of planning period calculations, including cross subsidies.

The payout ratio is intended to measure the proportion of the target allocation received by the holders of FTRs with positive target allocations in a month. In fact, the actual monthly payout ratio includes the net negative target allocations as a source of funding for FTRs with net positive target allocations in an hour. Revenue from FTRs with net negative target allocations in an hour is included with congestion revenue when funding FTRs with net positive target allocations.<sup>26</sup> Also included in this revenue is any M2M charge or credit for the month and any excess ARR revenues for the month. The revenue and net target allocations are then summed over the month to calculate the monthly payout ratio. There is no payout ratio applied on a monthly basis, each participant receives a different share of the available revenue based on availability, it is simply used as a reporting mechanism. At the end of a given month, a participant's FTR payments are a proportion of the congestion credits collected, based on the participant's share of the total monthly target

<sup>26</sup> See PJM, "Manual 28: Operating Agreement Accounting," Revision 72 (December 17, 2015), p. 57-58.

allocation. The payout ratio is only used and calculated at the end of the planning period after uplift is applied to each participant. The actual monthly payout ratio received by FTR holders equals congestion revenue plus the net negative target allocations divided by the net positive target allocations for each hour. The actual payout ratio received by the holders of positive target allocation FTRs, reported on a monthly basis, is greater than reported by PJM.

Table 13-22 shows the PJM reported and actual monthly payout ratios for the first ten months of the 2015 to 2016 planning period. On a month to month basis, the payout ratio currently reported by PJM does not take into account all sources of revenue available to pay FTR holders. On a monthly basis, this provides a slightly understated payout ratio. In the first ten months of the 2015 to 2016 planning period, there was an excess of FTR revenues, so total funding was actually over 100 percent. Additional revenue was distributed to future months of the planning period to cover any shortfall or be distributed prorata at the end of the planning period.

**Table 13-22 PJM Reported and Actual Monthly Payout Ratios: Planning period 2015 to 2016**

	Reported Monthly Payout Ratio	Actual Monthly Payout Ratio
Jun-15	100.0%	100.0%
Jul-15	100.0%	100.0%
Aug-15	100.0%	100.0%
Sep-15	100.0%	100.0%
Oct-15	100.0%	100.0%
Nov-15	100.0%	100.0%
Dec-15	100.0%	100.0%
Jan-16	100.0%	100.0%
Feb-16	100.0%	100.0%
Mar-16	100.0%	100.0%

## Netting Target Allocations within Portfolios

Currently, FTR target allocations are netted within each organization in each hour. This means that within an hour, positive and negative target allocations within an organization's portfolio are offset prior to the application of the payout ratio to the positive target allocation FTRs. The payout ratios are also

calculated based on these net FTR positions. Elimination of portfolio netting would correctly account for negative target allocations as a source of revenue to pay positive target allocations. It would also apply the payout ratio directly to a participant's positive target allocations before subtracting negative target allocations, rather than applying the payout ratio to a participant's net portfolio. Applying the payout ratio to a participant's net portfolio results in unequal payout ratios depending on a participant's portfolio construction.

The current method requires those with fewer negative target allocation FTRs to subsidize those with more negative target allocation FTRs. The current method treats a positive target allocation FTR differently depending on the portfolio of which it is a part. But all FTRs with positive target allocations should be treated in exactly the same way, which would eliminate this form of cross subsidy.

For example, a participant has \$200 of positive target allocation FTRs and \$100 of negative target allocation FTRs and the payout ratio is 80 percent. Under the current method, the positive and negative positions are first netted to \$100 and then the payout ratio is applied. In this example, the holder of the portfolio would receive 80 percent of \$100, or \$80.

The correct method would first apply the payout ratio to FTRs with positive target allocations and then net FTRs with negative target allocations. In the example, the 80 percent payout ratio would first be applied to the positive target allocation FTRs, 80 percent of \$200 is \$160. Then the negative target allocation FTRs would be netted against the positive target allocation FTRs, \$160 minus \$100, so that the holder of the portfolio would receive \$60.

If done correctly, the payout ratio would also change, although the total net payments made to or from participants would not change. The sum of all positive and negative target allocations is the same in both methods. The net result of this change would be that holders of portfolios with smaller shares of negative target allocation FTRs would no longer subsidize holders of portfolios with larger shares of negative target allocation FTRs.

Under the current method all participants with a net positive target allocation in a month are paid a payout ratio based on each participant's net portfolio position. The correct approach would calculate payouts to FTRs with positive target allocations, without netting in an hour. This would treat all FTRs the same, regardless of a participant's portfolio. This approach would also eliminate the requirement that participants with larger shares of positive target allocation FTRs subsidize participants with larger shares of negative target allocation FTRs.

Elimination of portfolio netting should also be applied to the end of planning period FTR uplift calculation. With this approach, negative target allocations would not offset positive target allocations at the end of the planning period when allocating uplift. The FTR uplift charge would be based on participants' share of the total positive target allocations paid for the planning period.

Table 13-23 shows an example of the effects of calculating FTR payouts on a per FTR basis rather than the current method of portfolio netting for four hypothetical organizations for an example hour. In this example, there was \$45 in congestion revenue collected, which results in a payout ratio of 39.1 percent for positive target allocations when ignoring any contribution by negative or net negative target allocations. With portfolio netting, the total revenue available to pay positive target allocations is \$50, which is the \$45 in congestion collected plus the \$5 generated by the net negative target allocation of Participant 4, which results in a payout ratio of 41.7 percent for net positive target allocations. Without portfolio netting there is \$110 in total revenue available, which is the \$45 in congestion collected plus the \$65 in negative target allocations from all participants, which results in a payout ratio of 61.1 percent for positive target allocations.

The positive and negative TA columns show the total positive and negative target allocations, calculated separately, for each organization. The percent negative target allocations is the share of the portfolio which is negative target allocation FTRs. The net target allocation is the net of the positive and negative target allocations for the given hour. The FTR netting payout column shows what a participant would see on their bill, including payout ratio

adjustments, under the current method. The per FTR payout column shows what a participant would see on their bill, including payout ratio adjustments, if FTR target allocations were done correctly. In this example, the actual monthly payout ratio is 41.7 percent. If portfolio netting were eliminated, the actual monthly payout ratio would rise to 61.1 percent.

This table shows the effects of a per FTR target allocation calculation on individual participants. The total payout does not change, but the allocation across individual participants does.

The largest change in payout is for participants 1 and 2. Participant 1, who has a large proportion of FTRs with negative target allocations, receives less payment. Participant 2, who has no negative target allocations, receives more payment.

**Table 13-23 Example of FTR payouts from portfolio netting and without portfolio netting**

Participant	Positive Target Allocation	Negative Target Allocation	Percent Negative Target Allocation	Net TA	FTR Netting Payout (Current)	No Netting Payout (Proposed)	Percent Change
1	\$60.00	(\$40.00)	66.7%	\$20.00	\$8.33	(\$3.33)	(140.0%)
2	\$30.00	\$0.00	0.0%	\$30.00	\$12.50	\$18.33	46.7%
3	\$90.00	(\$20.00)	22.2%	\$70.00	\$29.17	\$35.00	20.0%
4	\$0.00	(\$5.00)	100.0%	(\$5.00)	(\$5.00)	(\$5.00)	0.0%
Total	\$180.00	(\$65.00)	-	\$115.00	\$45.00	\$45.00	-

Table 13-24 shows the total value for the 2014 to 2015 and 2015 to 2016 planning periods of FTRs with positive and negative target allocations. The Net Positive Target Allocation column shows the value of all portfolios with an hourly net positive value after negative target allocation FTRs are netted against positive target allocation FTRs. The Net Negative Target Allocation column shows the value of all portfolios with an hourly net negative value after negative target allocation FTRs are netted against positive target allocation FTRs. The Per FTR Positive Allocation column shows the total value of the hourly positive target allocation FTRs without netting. The Per Negative Allocation column shows the total value of the hourly negative target allocation FTRs without netting.

The Reported Payout Ratio column is the monthly payout ratio as currently reported by PJM, calculated as total revenue divided by the sum of the net positive and net negative target allocations. The No Netting FTR Payout Ratio column is the payout ratio that participants with positive target allocations would receive if FTR payouts were calculated without portfolio netting, calculated by dividing the total revenue minus the per FTR negative target allocation by the per FTR positive target allocations. The total revenue available to fund the holders of positive target allocation FTRs is calculated by adding any negative target allocations to the congestion credits for that month.

If netting within portfolios were eliminated and the payout ratio were calculated correctly, the payout ratio for the 2013 to 2014 planning period would have been 87.5 percent instead of the reported 72.8. For the 2014 to 2015 and 2015 to 2016 planning periods there was no revenue inadequacy, so eliminating portfolio netting would have no effect. November and December 2015 and March 2016 experienced revenue inadequacy, but excess revenue was distributed from previous months to ensure full funding. For months with no revenue inadequacies there is no change in payout ratio.

**Table 13-24 Monthly positive and negative target allocations and payout ratios with and without hourly netting: Planning period 2014 to 2015 and 2015 to 2016**

	Net Positive Target Allocations	Net Negative Target Allocations	Per FTR Positive Target Allocations	Per FTR Negative Target Allocations	Total Congestion Revenue	Reported Payout Ratio (Current)	No Netting Payout Ratio (Proposed)
Jun-15	\$101,492,683	(\$17,638,087)	\$222,590,294	(\$139,100,325)	\$103,801,957	100.0%	100.0%
Jul-15	\$84,827,111	(\$17,321,775)	\$200,161,717	(\$132,638,752)	\$87,968,263	100.0%	100.0%
Aug-15	\$58,681,563	(\$11,121,312)	\$137,089,167	(\$89,562,397)	\$57,290,482	100.0%	100.0%
Sep-15	\$92,594,711	(\$15,996,098)	\$231,109,085	(\$154,468,134)	\$77,511,284	100.0%	100.0%
Oct-15	\$98,581,703	(\$16,026,518)	\$243,208,767	(\$160,641,784)	\$84,759,219	100.0%	100.0%
Nov-15	\$109,318,449	(\$17,000,203)	\$263,233,848	(\$170,879,749)	\$92,318,246	100.0%	100.0%
Dec-15	\$90,426,000	(\$21,292,916)	\$247,346,193	(\$178,213,108)	\$69,082,410	100.0%	100.0%
Jan-16	\$123,228,284	(\$21,168,113)	\$321,877,316	(\$219,805,629)	\$105,716,486	100.0%	100.0%
Feb-16	\$120,295,629	(\$16,588,360)	\$315,314,260	(\$211,591,605)	\$110,529,258	100.0%	100.0%
Mar-16	\$102,686,720	(\$22,421,375)	\$309,689,295	(\$229,412,325)	\$85,219,438	100.0%	100.0%
2014/2015 Total	\$1,549,603,363	(\$294,939,767)	\$4,208,635,791	(\$2,947,744,437)	\$1,413,528,267	100.0%	100.0%
2015/2016 Total	\$982,132,853	(\$176,574,757)	\$2,491,619,942	(\$1,686,313,809)	\$869,242,951	100.0%	100.0%

### Portfolio Dependent Payout Ratio

Under the current portfolio netting rules, negative target allocations are first netted against positive, and then the payout ratio is applied. This results in two significant problems with the current method. First is that a participant can shield itself from both monthly revenue inadequacy and the end of planning period uplift charge by shrinking the size of their positive target allocations. This is advantageous because the participant can still be profiting from their negative target allocations if they are paid to take counter flow positions and pay back less than they received. Additionally, it results in positive target allocations receiving different payout ratios depending on the composition of the portfolio they are in. All positive target allocation FTR should be treated equally, regardless of the portfolio they are in, and this can only be accomplished by eliminating portfolio netting. Not treating all FTRs equally results in participants with more negative target allocations receiving a subsidy by reducing the effective payout ratio to participants with fewer negative target allocations. The reduced payouts to participants with fewer negative target allocations subsidize increased payout ratios to participants with larger negative target allocations, and is an unbalanced distribution of available congestion revenue collected.

Table 13-25 demonstrates the impact on the payout ratio to positive target allocation FTRs with and without portfolio netting. In the example the total congestion collected is \$4,750 and the total net target allocation is \$9,500, resulting in a reported payout ratio of 50.0 percent. With portfolio netting, the net target allocation is simply multiplied by the payout ratio to calculate the congestion revenue a participant receives. For Participant 1, this is \$250 multiplied by 0.5 for a total revenue received of \$125. The revenue to positive TA column is an indication of how much revenue the positive target allocations, which are the only part of a portfolio receiving available revenue, of a participant need to be paid in order to reach the congestion revenue received. For participant 1, they are effectively being paid \$875 of their \$1,000 so that the congestion revenue received can be \$125. Another way to state this is the participant is effectively paying themselves their negative target allocations first, and then receiving revenue based on their net target allocation. The result of this is that Participant 1's positive target allocations are effectively granted a payout ratio of 87.5 percent simply because they hold negative target allocations, while Participant 3, who holds no negative target allocations, is only paid at a 50.0 percent payout ratio.

**Table 13-25 Change in positive target allocation payout ratio given portfolio construction**

Participant	Congestion = \$4,750 Net TA = \$9,500		With Netting			Without Netting				
	Positive Target Allocations	Negative Target Allocations	Net Target Allocations	Reported Payout Ratio	Congestion Revenue Received	Revenue to Positive TA	Calculated Positive TA Payout Ratio	Congestion Revenue Received	Revenue to Positive TA	Calculated Positive TA Payout Ratio
1	\$1,000.00	(\$750.00)	\$250.00	50.0%	\$125.00	\$875.00	87.5%	(\$204.55)	\$545.45	54.5%
2	\$750.00	(\$200.00)	\$550.00	50.0%	\$275.00	\$475.00	63.3%	\$209.09	\$409.09	54.5%
3	\$8,700.00	\$0.00	\$8,700.00	50.0%	\$4,350.00	\$4,350.00	50.0%	\$4,745.45	\$4,745.45	54.5%
Total	\$10,450.00	(\$950.00)	\$9,500.00	-	\$4,750.00	\$5,700.00	-	\$4,750.00	\$5,700.00	-

Without portfolio netting all participants are paid at the same effective payout ratio for their positive target allocations. Counting negative target allocations as a source of revenue raises the payout ratio to 54.5 percent. Without portfolio netting, the payout ratio is first applied to positive target allocations, then the participant's negative target allocations are added. The result of this calculation is that each participant is paid an equal 54.5 percent regardless of

their portfolio's negative target allocations. In this example Participant 1 pays ends up paying \$204.55 into the congestion pot, in net, while Participant 3 is paid 54.5 percent of the positive target allocations, resulting in a payment of \$4,745.45. Eliminating portfolio netting is the only way to treat positive target allocations equally across all portfolios, and eliminates the subsidy positive target allocations holders are paying to negative target allocation holders.

### Mathematically Equivalent FTRs

A single FTR can be broken into multiple FTRs. The newly formed set of multiple FTRs can have the same net target allocation as long as the start and end points of the constituent end points are, in net, the same as the original. Opponents of the elimination of FTR netting have claimed that without netting this would no longer be true. However, this assertion does not account for revenues from negative target allocation FTR paths in the mathematically equivalent set of FTRs. Appropriately including these revenues results in mathematical equivalence between the single FTR and that same FTR broken into a constituent set of FTRs with the same start and end point.

Table 13-27 shows the effects on a participant with and without portfolio netting under three distinct scenarios. Table 13-26 provides the day-ahead CLMP values for each node used in the example. In this example, a participant can either buy an FTR position directly from A to B or can break it into individual pieces with the net effect of an FTR from A

to B with a net target allocation of \$5. In this example, there was \$3.60 in congestion collected, due to a payout ratio of 72.0 percent and a total payout in each of the three scenarios of \$3.60. This payout amount is simply the payout ratio of 72.0 percent multiplied by the net target allocations of \$5 in each scenario.

With the elimination of netting, if the additional revenue created by considering positive and negative target allocations separately is disregarded, it appears as if the payout for the same net FTR is drastically different depending on the composition of the FTR. The results of this mistake are payouts of \$3.60, -\$0.60 and -\$25.80 for the same net FTR in each distinct scenario. However, if the negative target allocations are properly accounted for as a source of revenue when considering congestion collected, the total revenue available increases thereby increasing the payout ratio for each scenario's positive target allocations. The total revenue available is the \$3.60 in congestion collected plus the negative target allocations, resulting in revenue available to pay positive target allocations of \$3.60, \$18.60 and \$108.60 with payout ratios to positive target allocations of 72.0 percent (unchanged due to no negative target allocations), 93.0 percent and 98.7 percent. Multiplying these correct payout ratios by the scenario's positive target allocations, and then adding the scenario's negative target allocations results in a net payout of \$3.60 for each scenario.

**Table 13-26 Nodal day-ahead CLMPs**

Node	DA CLMP
A	\$20
B	\$25
C	\$40
D	\$100
E	\$10

**Table 13-27 Mathematically equivalent FTR payments with and without portfolio netting**

FTR Path(s)	Positive Negative		Net TA	Available Revenue Netting	Netting Revenue Received	No Netting		Payout Ratio No Netting	Correct No Netting Revenue Received
	TA	TA				Revenue Received (Incorrect)	Revenue No Netting		
A-B	\$5.00	\$0.00	\$5.00	\$3.60	\$3.60	\$3.60	\$3.60	72.0%	\$3.60
A-C, C-B	\$20.00	(\$15.00)	\$5.00	\$3.60	\$3.60	(\$0.60)	\$18.60	93.0%	\$3.60
A-C, C-E, E-D, D-B	\$110.00	(\$105.00)	\$5.00	\$3.60	\$3.60	(\$25.80)	\$108.60	98.7%	\$3.60

The results of this example demonstrate the mathematical fact that no matter how an FTR path is constructed, as a single FTR or a mathematically equivalent set of FTRs, the total payment the FTR path will be the same. Attempts to disprove this ignore the revenues from the constituent FTR counter flow positions and the resulting change in payout ratio that is experienced by positive target allocations. A net FTR may be constructed in any manner and the resultant total payout will be equivalent with and without portfolio netting.

### Counter Flow FTRs and Revenues

The current rules create an asymmetry between the treatment of counter flow and prevailing flow FTRs. The payout to the holders of counter flow FTRs is not affected when the payout ratio is less than 100 percent. There is no reason for that asymmetric treatment.

For a prevailing flow FTR, the target allocation would be subject to a reduced payout ratio, while a counter flow FTR holder would not be subject to the reduced payout ratio. The profitability of the prevailing flow FTRs is affected by the payout ratio while the profitability of the counter flow FTRs is not affected by the payout ratio.

Counter flow FTR holders make payments over the planning period, in the form of negative target allocations. These negative target allocation FTRs are paid at 100 percent regardless of whether positive target allocation FTRs are paid at less than 100 percent.

A counter flow FTR is profitable if the hourly negative target allocation is smaller than the hourly auction payment they received. A prevailing flow FTR is profitable if the hourly positive target allocation is larger than the auction payment they made.

There is no reason to treat counter flow FTRs more favorably than prevailing flow FTRs. Counter flow FTRs should also be affected when the payout ratio is less

than 100 percent. This would mean that counter flow FTRs would pay back an increased amount, parallel to the decreased payments to prevailing flow FTRs. The adjusted payout ratio would evenly divide funding between counter flow FTR holders and prevailing flow FTR holders by increasing negative counter flow target allocations by the same amount it decreases positive target allocations.

Table 13-28 provides an example of how the counter flow adjustment method would impact a two FTR system. In this example, there is \$15 of total congestion revenue available, corresponding to a reported payout ratio of 75 percent and an actual payout ratio of 87.5 percent. In the example, the profit is shown with and without the counter flow adjustment. As the example shows, the profit of a counter flow FTR does not change when there is a payout ratio less than 100 percent, while the profit of a prevailing flow FTR is reduced. Applying the payout ratio to counter flow FTRs distributes the funding penalty evenly to both prevailing and counter flow FTR holders.

**Table 13-28 Example implementation of counter flow adjustment method**

	Prevailing A-B 10MW	Counter C-D 10MW
Auction Cost	\$50.00	(\$30.00)
Target Allocation	\$40.00	(\$20.00)
Payout	\$30.00	(\$20.00)
Profit without revenue inadequacy	(\$10.00)	\$10.00
Profit after revenue inadequacy	(\$20.00)	\$10.00
Payout for Positive TA	\$35.00	(\$20.00)
Profit for Positive TA	(\$15.00)	\$10.00
Payout after CF Adjustment	\$36.67	(\$21.67)
Profit after CF Adjustment	(\$13.33)	\$8.33
Profit Difference	\$1.67	(\$1.67)

Table 13-29 shows the monthly positive, negative and total target allocations.<sup>27</sup>

Table 13-29 also shows the total congestion revenue available to fund FTRs, as well as the total revenue available to fund positive target allocation FTR holders on a per FTR basis and on a per FTR basis with counter flow payout adjustments. Implementing this change to the payout ratio for counter flow FTRs would result in an additional \$188.4 million (27.8 percent of difference

<sup>27</sup> Reported payout ratio may differ between Table 13-38 and Table 13-43 due to rounding differences when netting target allocations and considering each FTR individually.

between revenues and total target allocations) in revenue available to fund positive target allocations for the 2013 to 2014 planning period. If this change were implemented after excess planning period revenue was distributed, it would not result in additional revenue for the 2014 to 2015 or 2015 to 2016 planning periods. However, if this change were implemented before excess planning period revenues were distributed, there would be an increase in the revenue available each month to pay prevailing flow FTRs, resulting in a decrease in the amount of excess from previous months that needs to be used to achieve revenue adequacy. This can be seen by a slight difference in the total revenue and adjusted counter flow total revenue columns for March during the 2014 to 2015 planning period and November, December and March for the 2015 to 2016 planning period that was not revenue adequate. The result of this would be \$2.8 million in additional revenue generated for the first ten months of the 2015 to 2016 planning period.

The result of removing portfolio netting and applying a payout ratio to counter flow FTRs would increase the calculated payout ratio for the 2013 to 2014 planning period from the reported 72.8 percent to 91.0 percent. For months with no revenue inadequacies there is no change in payout ratio.

**Table 13-29 Counter flow FTR payout ratio adjustment impacts: Planning period 2014 to 2015 and 2015 to 2016**

	Positive Target Allocations	Negative Target Allocations	Total Target Allocations	Total Congestion Revenue	Reported Payout Ratio*	Total Revenue Available	Adjusted Prevailing Flow Payout Ratio	Adjusted Counter Flow Payout Ratio	Adjusted Counter Flow Revenue Available	Additional Revenue Generated
Jan-16	321,877,316.40	(219,805,629.02)	\$102,071,687	\$111,640,380	100.0%	\$331,446,009	100.0%	100.0%	\$331,446,009	\$0
Feb-16	315,314,260.19	(211,591,605.21)	\$103,722,655	\$116,388,192	100.0%	\$327,979,798	100.0%	100.0%	\$327,979,798	\$0
Mar-16	309,689,294.59	(229,412,325.17)	\$80,276,969	\$75,303,718	93.8%	\$304,716,044	100.0%	100.0%	\$306,379,919	\$1,663,876
Total 2014/2015	\$4,218,482,305	(\$2,955,253,710)	\$1,263,228,595	\$1,452,257,998	100.0%	\$4,407,511,707	100.0%	100.0%	\$4,407,511,707	\$4,408,024,645
Total 2015/2016	2,491,619,941.98	(1,686,313,808.66)	805,306,133.32	\$872,624,995	100.0%	\$2,558,938,804	100.0%	100.0%	\$2,561,711,293	\$2,772,489

\* Reported payout ratios may vary due to rounding differences when netting

Figure 13-9 shows the FTR surplus, collected day-ahead, balancing and total congestion payments from January 2005 through March 2016. August and December 2014 had positive total balancing congestion of \$0.03 million and \$4.4 million. March 2015 had balancing congestion of \$70.0 million.

**Figure 13-9 FTR surplus and the collected Day-Ahead, Balancing and Total congestion: January 2005 through March 2016**


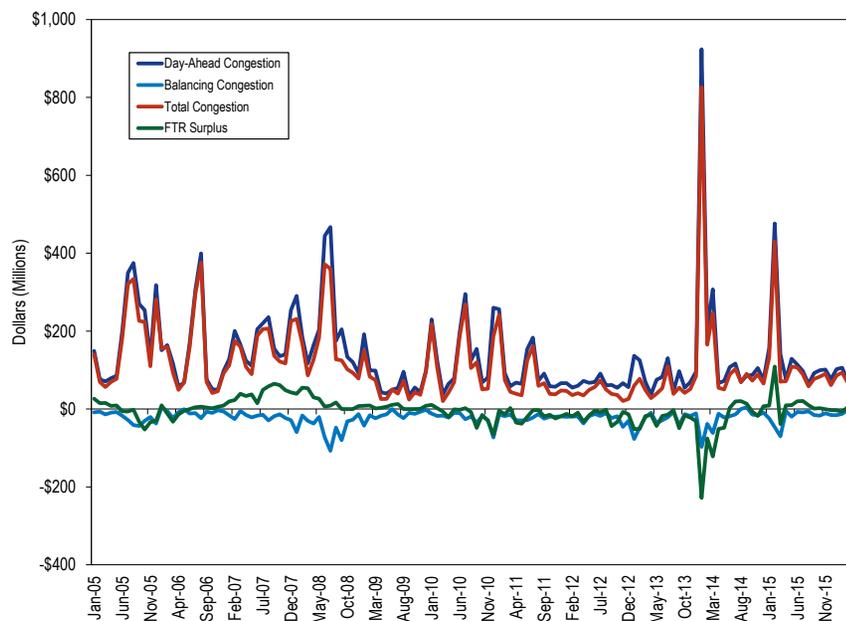


Figure 13-10 shows the relationship among monthly target allocations, balancing congestion, M2M payments and day-ahead congestion. The left column is the target allocations for all FTRs for the month. The total height of the right column is day-ahead congestion revenues and the stripes are reductions to total congestion revenues. When the total height of the solid segments in the right column exceeds the height of the left column, the month is revenue adequate. For example, February 2016 was revenue adequate by \$6.8 million. March was revenue inadequate by \$4.9 million, but there was enough excess revenue in other months in the planning period to fully fund the month.

**Figure 13-10 FTR target allocation compared to sources of positive and negative congestion revenue**

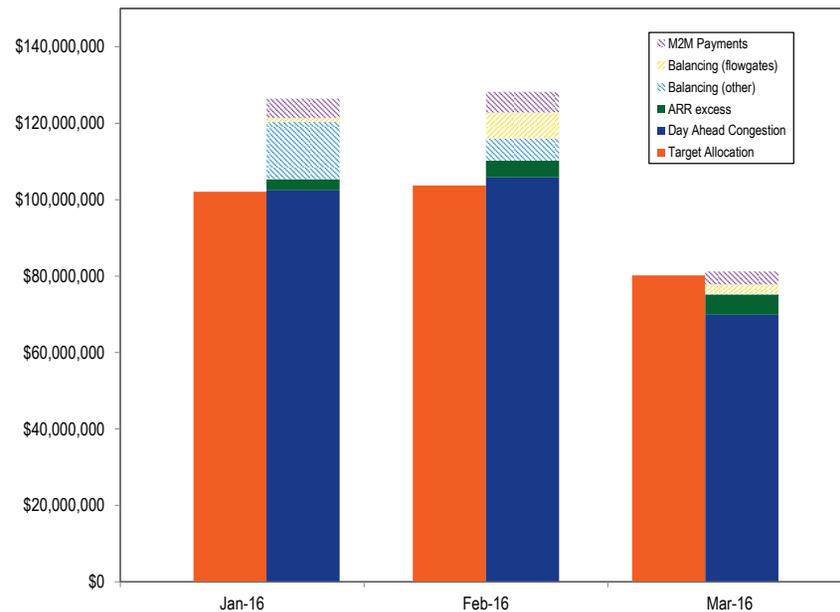

## ARRs as a Congestion Offset for Load

Load pays for the transmission system and contributes all congestion revenues. FTRs and later ARRs were intended to return congestion revenues to load. With the implementation of the current FTR/ARR design, other participants are allowed to receive a portion of the congestion revenues.

Table 13-30 compares the revenue received by ARR holders and total congestion for the 2011 to 2012 through the first ten months of the 2015 to 2016 planning period. This compares the total offset provided to all ARR holders including all ARRs converted to self scheduled FTRs to the total congestion revenues. ARR credits are calculated as the product of the ARR MW and the cleared price of the ARR path from the Annual FTR Auction. The FTR credits represent the total self scheduled FTR target allocations for FTRs

held by ARR holders, adjusted by the FTR payout ratio. ARR holders that elect to self schedule into FTRs are paid the daily ARR credits for the ARR, and then pay the daily auction price of the self scheduled FTRs, netting the cost of the FTRs to zero. This is accounted for in the ARR credits column by subtracting the cost of the FTR from the ARR credits.

The total ARR/FTR offset is the sum of the ARR and self scheduled FTR credits. The congestion column shows the total amount of congestion collected in the Day-Ahead Energy Market and the balancing energy market. The percent offset is the percent of total, system wide, congestion offset by ARR and self scheduled FTR credits that ARR holders receive.

Table 13-30 shows the offset provided by ARRs and self scheduled FTRs for the entire 2011 to 2012 through the first ten months of the 2015 to 2016 planning period. This offset reflects the share of congestion revenues returned to loads. ARR and FTR revenues offset 44.7 percent of total congestion for the 2013 to 2014 planning period and 63.8 percent for the 2014 to 2015 planning period. For the first ten months of the 2015 to 2016 planning period ARRs and self scheduled FTRs offset 83.6 percent of total congestion costs.

This demonstrates the inadequacies of the current ARR/FTR design. The goal of the design should be to return 100 percent of the congestion revenues to the load. But the actual results fall well short of that goal.

**Table 13-30 ARR and FTR total congestion offset (in millions) for ARR holders: Planning periods 2014 to 2015 and 2015 to 2016<sup>28</sup>**

Planning Period	ARR Credits	FTR Credits	Total Congestion	Total ARR/FTR	
				Offset	Percent Offset
2011/2012	\$512.2	\$249.8	\$770.6	\$762.0	98.9%
2012/2013	\$349.5	\$181.9	\$575.8	\$531.4	92.3%
2013/2014	\$337.7	\$456.4	\$1,777.1	\$794.0	44.7%
2014/2015	\$482.4	\$404.4	\$1,390.9	\$886.8	63.8%
2015/2016*	\$529.9	\$193.5	\$865.2	\$723.4	83.6%

\*Through March 31, 2016

<sup>28</sup> FTR Credits does not include any end of planning period excess or shortfall distribution.

## Credit Issues

There were no defaults in January through March 2016.

## FTR Forfeitures

An FTR holder may be subject to forfeiture of any profits from an FTR if it meets the criteria defined in Section 5.2.1 (b) of Schedule 1 of the PJM Operating Agreement. If a participant has a cleared increment offer or decrement bid for an applicable hour at or near the source or sink of any FTR they own and the day-ahead congestion LMP difference is greater than the real-time congestion LMP difference the profits from that FTR may be subject to forfeiture for that hour. An increment offer or decrement bid is considered near the source or sink point if 75 percent or more of the energy injected or withdrawn, and which is withdrawn or injected at any other bus, is reflected on the constrained path between the FTR source or sink. This rule only applies to increment offers and decrement bids that would increase the price separation between the FTR source and sink points.

Figure 13-11 demonstrates the FTR forfeiture rule for INCs and DEC. The INC or DEC distribution factor (dfax) is compared to the largest impact withdrawal or injection dfax. If the absolute difference between the virtual bid and its counterpart is greater than or equal to 75 percent, the virtual bid is considered for forfeiture. This is the metric in the rule which defines the impact of the virtual bid on the constraint.

In the first part of the example in Figure 13-11, the INC has a dfax of 0.25 and the maximum withdrawal dfax on the constraint is -0.5. The difference between the two dfax values is -0.75 (0.25 minus -0.5). The absolute value is 0.75. In the second part of the example in, the DEC has dfax of 0.5 and the maximum injection dfax on the constraint is -0.25. The difference between the two dfax values is -0.25 (-0.25 minus 0.5). The absolute value is also 0.75.

Figure 13-11 Illustration of INC/DEC FTR forfeiture rule

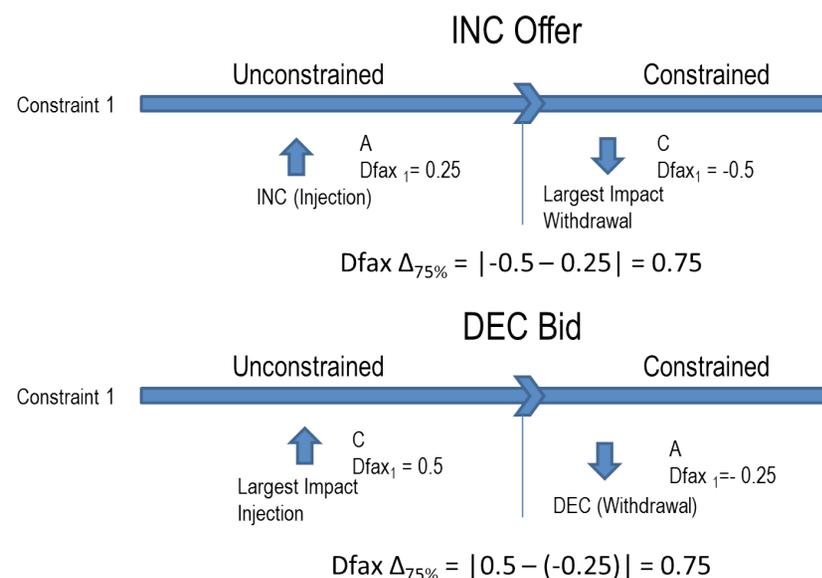


Figure 13-12 shows the FTR forfeiture values for both physical and financial participants for each month of June 2010 through March 2016. Currently, counter flow FTRs are not subject to forfeiture regardless of INC or DEC positions. Total forfeitures for the 2015 to 2016 planning period were \$0.2 million (0.02 percent of total FTR target allocations).

Figure 13-12 Monthly FTR forfeitures for physical and financial participants: June 2010 through March 2016


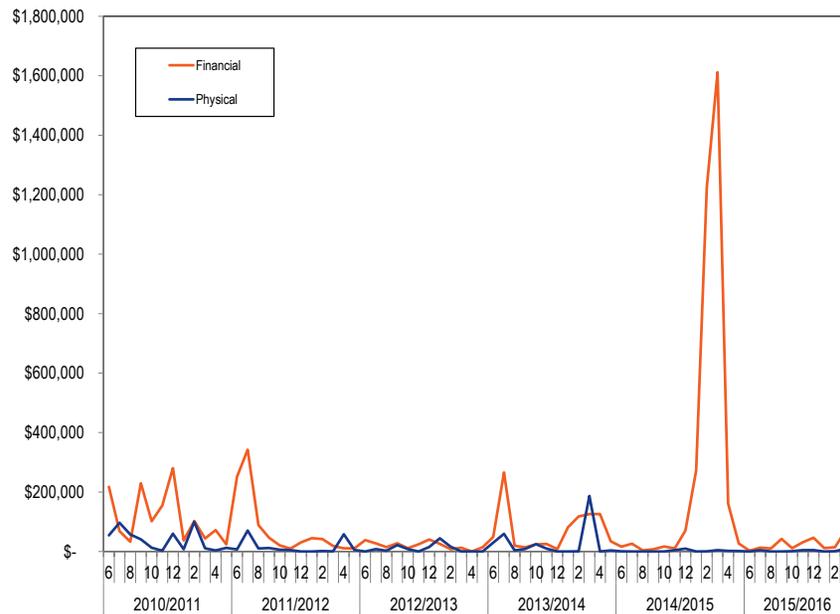


Figure 13-13 shows the FTR forfeitures on just INCs and DEC, FTR forfeitures on INCs, DEC and UTC using the method proposed by PJM and FTR forfeitures on INCs, DEC and UTC using the method proposed by the MMU from January 2013 through March 2016. The method proposed by PJM for calculating forfeitures associated with UTCs was implemented on September 1, 2013, and for each month thereafter. UTC forfeitures before September 2013 were not billed, but are included to illustrate the impact of the different methods of calculating forfeitures. The UTC curves include all forfeitures for the month associated with INCs, DEC and UTC. The dotted line indicates the percentage of forfeitures caused by UTC transactions using PJM's method, excluding INCs and DEC.

Figure 13-13 FTR forfeitures for INCs/DECs and INCs/DECs/UTCs for both the PJM and MMU methods: January 2013 through March 2016

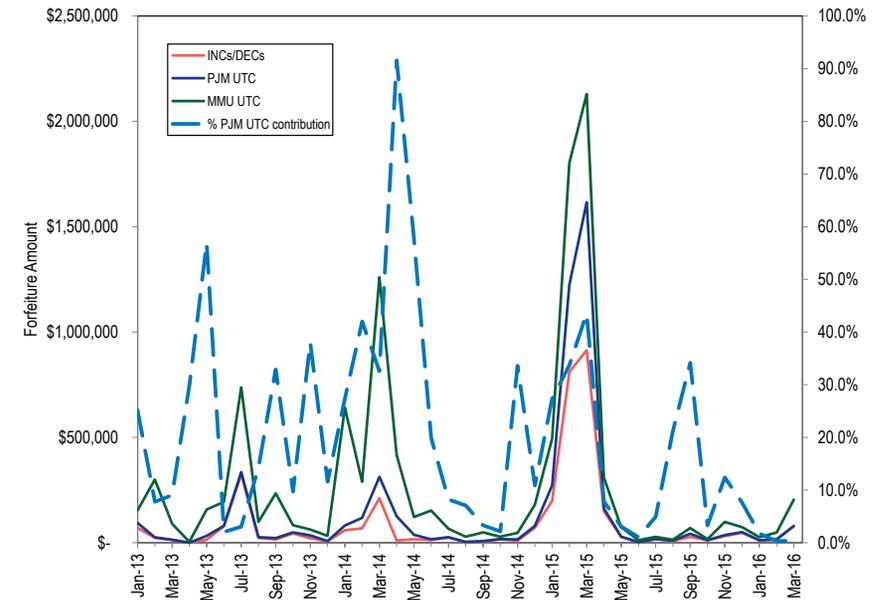

### Up-to-Congestion Transaction FTR Forfeitures

The current implementation of the FTR forfeiture rule submitted by PJM is not consistent with the application of the forfeiture rule for INCs and DEC. Under PJM's method the simple net dfax of the UTC transaction is the only consideration for forfeiture, representing the contract path of the UTC transaction. Under this method, the net dfax is the sink dfax of the UTC minus the source dfax of the UTC. The net dfax alone cannot be used as an indication of helping or hurting a constraint, rather, the direction of the constraint must also be considered. In addition, the PJM method only considers UTC transactions whose net dfax is positive. This logic not only passes transactions that should fail the forfeiture test, but fails transactions that should pass the forfeiture test.

PJM's logic also does not hold when one of the points of the UTC is far from the constraint. In this case, one side of the UTC would have a dfax of zero, indicating no connection to the constraint being considered. If a point of the UTC transaction has no connection to the constraint, there can be no power flow directly between the two UTC points, so the simple net dfax, cannot logically be used in this case to indicate whether a UTC is eligible for forfeiture. Under the MMU method this UTC would be treated as an INC or DEC and follow the same rules as the current INC/DEC FTR forfeiture rule.

Figure 13-14 shows an example of the two proposed FTR forfeiture rules for UTC transactions. In both cases, the net dfax of the UTC is taken. Under the PJM method the net dfax of the UTC is calculated by subtracting the dfax of the sink bus A (0.2) from the dfax of the source bus B (0.5) to get a net dfax of -0.3. If this net dfax value is greater than 0.75 the UTC is subject to forfeiture. Under the MMU method, the net dfax is calculated by subtracting the dfax of sink A (0.2) from the dfax of source bus B (0.5) to get a net dfax of 0.3. This net dfax is then compared to the withdrawal point with the largest impact on the constraint. The MMU method compares the net UTC dfax to a withdrawal because the UTC is a net injection on this constraint. In this example, the net dfax is 0.3 and it is compared to the largest withdrawal dfax at C (-0.5). The absolute value of the difference is calculated from these two points to determine if the UTC fails the FTR forfeiture rule. In this case, the absolute value of the difference is the dfax of bus C (-0.5) minus the net UTC dfax (0.3) for a total impact of 0.8, which is over the 0.75 threshold for the FTR forfeiture rule. The result is that this UTC fails the FTR forfeiture rule. The MMU proposes to apply the same rules to UTC transactions as is applied to INCs and DEC, treat the UTC as equivalent to an INC or a DEC depending on its net impact on a given constraint. A UTC transaction is essentially a paired INC/DEC, it has a net impact on the flow across a constraint, as an INC or DEC does. While total system power balance is maintained by a UTC, local flows may change based on the UTC's net impact on a constraint. The MMU method captures this impact.

Figure 13-14 Illustration of UTC FTR forfeiture rule


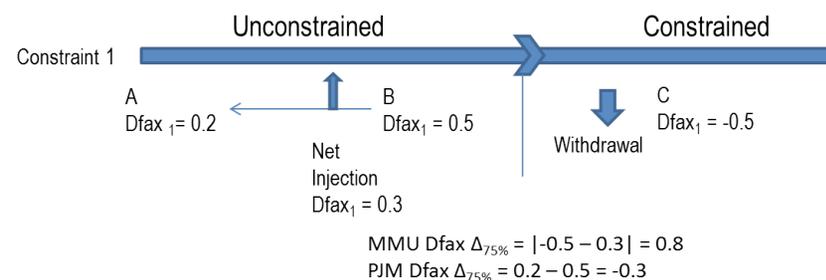


Figure 13-15 demonstrates where the assumption of contract path for UTCs in PJM's method does not hold with actual system conditions when either the source or sink of the UTC does not have any impact on the constraint being considered. In this case, the UTC is effectively an INC or a DEC relative to the constraint, as the other end of the UTC has no impact on the constraint. However, the PJM approach would not treat the UTC as an INC or DEC, despite the effective absence of the other end of the UTC. This is a flawed result.

As demonstrated in Figure 13-15, the UTC is no different than an INC on the constraint being considered. Using the PJM method this UTC would pass the FTR forfeiture rule. The net dfax would be calculated as the dfax of bus B (0) minus the dfax of bus A (0.25) for a net dfax of -0.25, with no comparison to any withdrawal bus. Since the dfax is negative, it would pass the PJM FTR forfeiture rule. Under the MMU's method, the net dfax is calculated as an injection with a dfax of 0.25, and then the absolute value of the difference is calculated between that injection and the dfax of the largest withdrawal on the constraint. In this example that is bus C, with a dfax of -0.5. The result is an absolute value of the dfax difference of 0.75, meaning that this UTC fails the FTR forfeiture test.

Figure 13-15 Illustration of UTC FTR Forfeiture rule with one point far from constraint

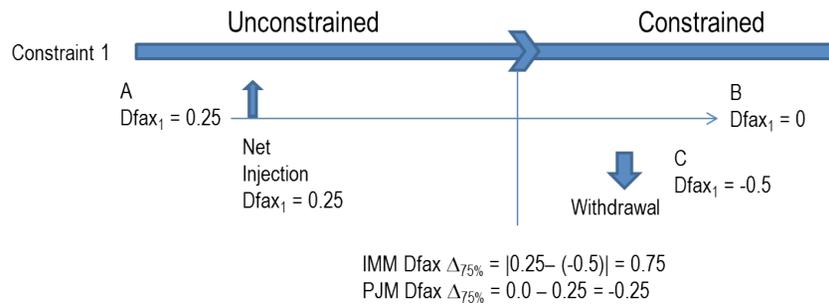

The MMU recommends that the FTR forfeiture rule be applied to UTCs in the same way it is applied to INCs and DECs.

