

A large, light green watermark of the PJM logo is centered in the background. It consists of a circle containing a stylized 'P' and 'J' that form a triangular shape.

# State of the Market Report for PJM

Volume 2:  
Detailed  
Analysis

Monitoring Analytics, LLC

Independent  
Market Monitor  
for PJM

2024

3.13.2025



## Preface

The PJM Market Monitoring Plan provides:

The Market Monitoring Unit shall prepare and submit contemporaneously to the Commission, the State Commissions, the PJM Board, PJM Management and to the PJM Members Committee, annual state-of-the-market reports on the state of competition within, and the efficiency of, the PJM Markets, and quarterly reports that update selected portions of the annual report and which may focus on certain topics of particular interest to the Market Monitoring Unit. The quarterly reports shall not be as extensive as the annual reports. In its annual, quarterly and other reports, the Market Monitoring Unit may make recommendations regarding any matter within its purview. The annual reports shall, and the quarterly reports may, address, among other things, the extent to which prices in the PJM Markets reflect competitive outcomes, the structural competitiveness of the PJM Markets, the effectiveness of bid mitigation rules, and the effectiveness of the PJM Markets in signaling infrastructure investment. These annual reports shall, and the quarterly reports may include recommendations as to whether changes to the Market Monitoring Unit or the Plan are required.<sup>1</sup>

Accordingly, Monitoring Analytics, LLC, which serves as the Market Monitoring Unit (MMU) for PJM Interconnection, L.L.C. (PJM), and is also known as the Independent Market Monitor for PJM (IMM), submits this *2024 Annual State of the Market Report for PJM*.<sup>2 3</sup>

<sup>1</sup> PJM Open Access Transmission Tariff (OATT) Attachment M (PJM Market Monitoring Plan) § VI.A. Capitalized terms used herein and not otherwise defined have the meaning provided in the OATT, PJM Operating Agreement, PJM Reliability Assurance Agreement (RAA), the Consolidated Transmission Owners Agreement (CTOA) or other tariffs that PJM has on file with the Federal Energy Regulatory Commission (FERC or Commission).

<sup>2</sup> OATT Attachment M.

<sup>3</sup> All references to this report should refer to the source as Monitoring Analytics, LLC, and should include the complete name of the report: *2024 Annual State of the Market Report for PJM*.





# Table of Contents

Preface	iii
<b>SECTION 1 Introduction</b>	<b>1</b>
2024 in Review	1
PJM Market Summary Statistics	6
PJM Market Background	7
Conclusions	8
Energy Market Conclusion	9
Capacity Market Conclusion	11
Synchronized Reserve Market Conclusion	12
Nonsynchronized Reserve Market Conclusion	12
Secondary Reserve Market Conclusion	12
Regulation Market Conclusion	13
FTR Auction Market Conclusion	13
Role of MMU	14
Reporting	14
Monitoring	14
Market Design	16
New Recommendations	16
New Recommendation from Section 3, Energy Market	16
New Recommendation from Section 5, Capacity Market	16
New Recommendation from Section 9, Interchange Transactions	16
New Recommendation from Section 10, Ancillary Services	16
New Recommendations from Section 12, Generation and Transmission Planning	17
Total Cost of Wholesale Power	17
Section Overviews	22
Overview: Section 3, Energy Market	22
Overview: Section 4, Energy Uplift	33
Overview: Section 5, Capacity Market	37
Overview: Section 6, Demand Response	46
Overview: Section 7, Net Revenue	52
Overview: Section 8, Environmental and Renewables	54
Overview: Section 9, Interchange Transactions	59
Overview: Section 10, Ancillary Services	62
Overview: Section 11, Congestion and Marginal Losses	71
Overview: Section 12, Generation and Transmission Planning	73
Overview: Section 13, FTRs and ARRs	85
<b>SECTION 2 Recommendations</b>	<b>93</b>
Recommendation Priority	93
Recommendation Status	93
New Recommendations	93
New Recommendation from Section 3, Energy Market	94
New Recommendation from Section 5, Capacity Market	94
New Recommendation from Section 9, Interchange Transactions	94
New Recommendation from Section 10, Ancillary Services	94

New Recommendations from Section 12, Generation and Transmission Planning	94
History of MMU Recommendations	94
Complete List of Current MMU Recommendations	95
Section 3, Energy Market	95
Section 4, Energy Uplift	100
Section 5, Capacity Market	101
Section 6, Demand Response	106
Section 7, Net Revenue	108
Section 8, Environmental and Renewables	108
Section 9, Interchange Transactions	109
Section 10, Ancillary Services	110
Section 11, Congestion and Marginal Losses	112
Section 12, Planning	112
Section 13, FTRs and ARRs	115
Adopted Recommendations	116
Adopted 2024	116
Adopted 2023	117
Adopted 2022	117
Adopted 2021	118
Adopted 2020	119
Adopted 2019	119
Adopted 2018	120
Adopted 2017	120
Adopted 2016	120
Adopted 2015	120
Adopted 2014	122
Adopted 2013	122
Adopted 2012	123
Adopted 2011	123
Adopted 2010	123
Adopted 2009	123
Adopted 2008	124
Adopted 2006	125
<b>SECTION 3 Energy Market</b>	<b>127</b>
Overview	129
Supply and Demand	129
Competitive Assessment	130
Recommendations	132
Conclusion	137
Supply and Demand	140
Market Structure	140
Market Behavior	154
Generator Offers	154
ICAP Must Offer Requirement	155
Emergency Maximum MW	156
Parameter Limited Schedules	157
Virtual Offers and Bids	163

Market Performance	171
LMP	171
Zonal LMP and Dispatch	191
Fuel Prices, LMP, and Dispatch	197
Components of LMP	203
Shortage	209
Emergency Procedures	209
Power Balance Constraint Violation	211
Shortage and Shortage Pricing	212
Competitive Assessment	221
Market Structure	221
Market Behavior	226
Market Performance	250
Market Structure, Participant Behavior, and Market Performance	256
<b>SECTION 4 Energy Uplift (Operating Reserves)</b>	<b>259</b>
Overview	260
Energy Uplift Credits	260
Energy Uplift Charges	260
Recommendations	260
Conclusion	262
Energy Uplift Credits	264
Categories of Credits and Charges	265
Types of Units	266
Day-Ahead Unit Commitment for Reliability	268
Balancing Operating Reserve Credits/Balancing Generator Credits	268
Lost Opportunity Cost Credits	269
Energy Uplift Charges	270
Energy Uplift Charges	270
Uplift Eligibility	272
Energy Uplift Issues	272
Uplift Resettlement	272
Uplift Forfeiture Rule	273
Regulation Market Offsets	273
Concentration of Energy Uplift Credits	274
Uplift Credits and Market Power Mitigation	276
Winter Storm Gerri (January 13 – 22, 2024)	277
<b>SECTION 5 Capacity Markets</b>	<b>279</b>
Overview	281
RPM Capacity Market	281
Part V Reliability Service (RMR)	282
Generator Performance	282
Recommendations	282
Conclusion	287
Market Design	291
Installed Capacity	293
Fuel Diversity	295

RPM Capacity Market	296
Market Structure	296
Market Conduct	310
Market Performance	315
FRR	319
CRF Issue	320
Timing of Unit Retirements	322
Part V Reliability Service (RMR)	324
Generator Performance	327
Capacity Factor	327
Generator Performance Factors	328
Generator Outage Rates	330
Generator Testing Issues	334
<b>SECTION 6 Demand Response</b>	<b>337</b>
Overview	337
Recommendations	338
Conclusion	340
PJM Demand Response Programs	343
Non-PJM Demand Response Programs	345
PJM Demand Response Programs	345
Emergency and Pre-Emergency Load Response Programs	347
Economic Load Response Program	363
Energy Efficiency	372
History	372
EE Details	373
Peak Shaving Adjustment	378
Distributed Energy Resources	379
EDC Role	380
Net Metering Resources	380
<b>SECTION 7 Net Revenue</b>	<b>381</b>
Overview	381
Net Revenue	381
Recommendations	382
Conclusion	382
Net Revenue	382
Spark Spreads and Dark Spreads	383
Theoretical Energy Market Net Revenue	385
Capacity Market Net Revenue	387
Net Revenue Adequacy	387
Levelized Total Costs	387
Levelized Cost of Energy	388
New Entrant Combustion Turbine	388
New Entrant Combined Cycle	390
New Entrant Coal Plant	392
New Entrant Nuclear Plant	393
New Entrant Diesel	395

New Entrant Onshore Wind Installation	396
New Entrant Offshore Wind Installation	397
New Entrant Solar Installation	398
Historical New Entrant CC Revenue Adequacy	399
Factors in Net Revenue Adequacy	400
<b>Actual Net Revenue</b>	<b>402</b>
Competitiveness of Wind and Solar	405
Nuclear Net Revenue Analysis	406
<b>SECTION 8 Environmental and Renewable Energy Regulations</b>	<b>417</b>
<b>Overview</b>	<b>417</b>
Federal Environmental Regulation	417
State Environmental Regulation	418
State Renewable Portfolio Standards	419
Emissions Controls in PJM Markets	419
Renewable Generation	419
Recommendations	419
Conclusion	420
<b>Federal Environmental Regulation</b>	<b>422</b>
CAA: NESHAP/MATS	422
CAA: NAAQS/CSAPR	423
CAA: NSR	424
CAA: RICE	425
CAA: Greenhouse Gas Emissions	425
CWA: WOTUS Definition	427
CWA: Effluents	427
RCRA: Coal Ash	428
<b>State Environmental Regulation</b>	<b>429</b>
State Coal Ash Regulations	429
State Emissions Regulations	430
State Renewable Portfolio Standards	439
Transco Regional Energy Access Expansion Project	458
Mountain Valley Pipeline	458
Transco Southeast Supply Enhancement	458
Transco Commonwealth Energy Connector Project	458
Columbia Gas Transmission Virginia Reliability Project	459
Texas Eastern Transmission Appalachia to Market II Project	459
<b>Emission Controlled Capacity and Emissions</b>	<b>459</b>
Emission Controlled Capacity	459
Emissions	460
<b>Renewable Energy Output</b>	<b>462</b>
Wind and Solar Peak Hour Output	462
Wind Units	463
Solar Units	465

<b>SECTION 9 Interchange Transactions</b>	<b>469</b>
Overview	469
Interchange Transaction Activity	469
Interactions with Bordering Areas	469
Recommendations	470
Conclusion	471
Interchange Transaction Activity	472
Charges and Credits Applied to Interchange Transactions	472
Aggregate Imports and Exports	472
Real-Time Interface Imports and Exports	474
Real-Time Interface Pricing Point Imports and Exports	476
Day-Ahead Interface Imports and Exports	479
Day-Ahead Interface Pricing Point Imports and Exports	481
Loop Flows	485
PJM and MISO Interface Prices	491
PJM and NYISO Interface Prices	492
Summary of Interface Prices between PJM and Organized Markets	494
Neptune Underwater Transmission Line to Long Island, New York	495
Linden Variable Frequency Transformer (VFT) facility	496
Hudson Direct Current (DC) Merchant Transmission Line	497
Interchange Activity During High Load Hours	499
Operating Agreements with Bordering Areas	499
PJM and MISO Joint Operating Agreement	500
PJM and New York Independent System Operator Joint Operating Agreement (JOA)	502
PJM and TVA/LG&E and KU Joint Reliability Coordination Agreement (JRCA)	503
PJM and Duke Energy Progress, Inc. Joint Operating Agreement	504
PJM and VACAR South Reliability Coordination Agreement	504
Balancing Authority Operations Coordination Agreement between Wisconsin Electric Power Company (WEC) and PJM Interconnection, LLC	504
Northeastern ISO-Regional Transmission Organization Planning Coordination Protocol	504
Interchange Transaction Issues	504
PJM Transmission Loading Relief Procedures (TLRs)	504
Up To Congestion Transactions	505
Sham Scheduling	507
Elimination of Ontario Interface Pricing Point	508
PJM and NYISO Coordinated Interchange Transactions	509
Reserving Ramp on the PJM/NYISO Interface	513
PJM and MISO Coordinated Interchange Transaction Proposal	513
Willing to Pay Congestion and Not Willing to Pay Congestion	517
Transmission Service Requests	518
Spot Imports	518
Interchange Optimization	519
Interchange Cap During Emergency Conditions	519
45 Minute Schedule Duration Rule	520
MISO Multi-Value Project Usage Rate (MUR)	521

<b>SECTION 10 Ancillary Service Markets</b>	<b>523</b>
Overview	524
Primary Reserve	524
Synchronized Reserve Market	525
Nonsynchronized Reserve	526
30-Minute Reserve Market	526
Secondary Reserve	527
Regulation Market	527
Black Start Service	529
Reactive	529
Frequency Response	529
Market Procurement of Real-Time Ancillary Services	530
Recommendations	530
Conclusion	532
PJM Reserve Markets	534
Implementation of PJM Reserve Markets	537
Reserve Subzones	540
Primary Reserve	541
Market Structure	541
Market Performance	542
Synchronized Reserve	543
Market Structure	543
Market Behavior	545
Market Performance	546
Synchronized Reserve Performance	550
Nonsynchronized Reserve	560
Market Structure	560
Market Behavior	561
Market Performance	561
30-Minute Reserve	565
Market Structure	565
Market Performance	566
Secondary Reserve	566
Market Structure	566
Market Behavior	567
Market Performance	567
Regulation Market	569
Market Design	569
Market Structure	584
Market Conduct	589
Market Performance	592
Black Start Service	596
CRF Issues	599
Reactive Service and Capability	601
Reactive Costs	601
Frequency Control Definition	603
Primary Frequency Response	603

<b>SECTION 11 Congestion and Marginal Losses</b>	<b>605</b>
Overview	607
Congestion Cost	607
Marginal Loss Cost	608
System Energy Cost	608
Conclusion	608
Issues	609
Artificial Constraints, Closed Loop Interfaces and CT Pricing Logic	609
Locational Marginal Price (LMP)	610
Components	610
Congestion	611
Congestion Accounting	611
Total Congestion	614
Charges and Credits versus Congestion: Virtual Transactions, Load and Generation	615
UTCs and Negative Balancing Explicit CLMP Charges	617
Zonal and Load Aggregate Congestion	620
Fast Start Pricing Effect on Zonal Congestion	624
Monthly Congestion	625
Congested Facilities	626
Congestion Event Hours	627
Congestion by Facility Type and Voltage	629
Constraint Frequency	630
Top Constraints	631
Congestion Event Summary: Impact of Changes in UTC Volumes	635
Marginal Losses	636
Marginal Loss Accounting	636
Total Marginal Loss Cost	638
System Energy Costs	642
Energy Accounting	642
Total System Energy Costs	642
<b>SECTION 12 Generation and Transmission Planning</b>	<b>649</b>
Overview	649
Generation Interconnection Planning	649
Regional Transmission Expansion Plan (RTEP)	651
Transmission Facility Outages	652
Recommendations	652
Conclusion	655
Generation Interconnection Planning	661
Existing Generation Mix	661
Generation Retirements	666
Generation Queue	671
Regional Transmission Expansion Plan (RTEP)	707
RTEP Process	707
Market Efficiency Process	707
PJM MISO Interregional Market Efficiency Process (IMEP)	713
PJM MISO Targeted Market Efficiency Process (TMEP)	713
Multi Driver Process	714



PJM MISO Interregional Transfer Capability Study (ITCS)	715
New Jersey State Agreement Approach for Offshore Wind	715
Long Term Regional Transmission Planning	716
Supplemental Transmission Projects	716
Competitive Planning Process Exclusions	720
Storage As A Transmission Asset (SATA)	721
Board Authorized Transmission Upgrades	722
Qualifying Transmission Upgrades (QTU)	722
Cost Allocation	722
<b>Transmission Line Ratings</b>	<b>723</b>
Dynamic Line Ratings (DLR) and Grid Enhancing Technology (GETs)	726
<b>Transmission Facility Outages</b>	<b>726</b>
Scheduling Transmission Facility Outage Requests	726
Rescheduling Transmission Facility Outage Requests	730
Long Duration Transmission Facility Outage Requests	730
Transmission Facility Outage Analysis for the FTR Market	731
Transmission Facility Outage Analysis in the Day-Ahead Energy Market	737
<b>SECTION 13 Financial Transmission and Auction Revenue Rights</b>	<b>739</b>
<b>Overview</b>	<b>743</b>
Auction Revenue Rights	743
Financial Transmission Rights	744
Recommendations	746
Conclusion	747
<b>Auction Revenue Rights</b>	<b>750</b>
Market Design	750
Market Structure	752
Market Performance	752
IARRs	758
<b>Financial Transmission Rights</b>	<b>759</b>
Market Performance	765
<b>Surplus Congestion Revenue</b>	<b>784</b>
<b>“Revenue Adequacy”</b>	<b>787</b>
Target Allocations and Congestion by Constraint Do Not Match	790
<b>ARRs as an Offset to Congestion for Load</b>	<b>796</b>
Zonal ARR Congestion Offset	797
Offset If All ARR's Are Held As ARR's	799
Offset If All ARR's Are Self Scheduled	799
ARR Allocation and Congestion In and Out of Zone	800
<b>Credit</b>	<b>801</b>
Treatment of Defaulted Portfolios	802
<b>FTR Forfeitures</b>	<b>802</b>



# Introduction

## 2024 in Review

Reliability is a core goal of PJM. Maintaining and improving competitive markets should also be a core goal of PJM. The goal of competition in PJM is to provide customers reliable wholesale power at the lowest possible price, but no lower. The PJM energy markets have done that. The PJM markets work, even if not perfectly. The results of PJM markets were reliable in 2024. The results of the energy market were competitive in 2024. The results of the 2025/2026 capacity market run in July were not competitive. The PJM markets bring customers the benefits of competition when the market rules allow competition to work and prevent the exercise of market power.

The capacity market is getting tighter. The result will be higher capacity market prices. In a well designed market, capacity market prices reflect the underlying supply and demand fundamentals. The results of the last capacity market auction (2025/2026) illustrate the amplified impact of not getting the details of the market design right when the market is tight. The MMU analysis shows that while a significant increase in capacity market payments was based on the fundamentals, market design and market power issues resulted in actual capacity market payments that were approximately twice as high as needed in the 2025/2026 auction.<sup>1</sup>

The market design details that resulted in prices above the competitive level in the 2025/2026 auction were: the shift from the EFORD availability metric to the ELCC availability metric; the impact of withholding by categorically exempt resources; the impact of using summer ratings rather than winter ratings for combined cycle (CC) and combustion turbine (CT) resources; the impact of the exclusion of the two reliability must run (RMR) plants from the capacity market supply curve; and the use of Gross CONE rather than 1.5 times Net CONE as the maximum price in the market.

Recent changes, or proposed changes, to the capacity market rules, consistent with MMU recommendations but some of them only temporary, will improve the

results of the 2026/2027 Base Residual Auction, while other recent changes, or proposed changes, will have the opposite effect. The must offer exemption for categorically exempt resources has been eliminated for all except demand side resources. The current RMR resources will be included in the capacity market supply curve. The maximum price on the VRR curve will be set to approximately 1.5 times Net CONE, stated as \$325/MW-day, but actually \$329.17 based on an updated lower ELCC value for the CT reference resource. The inclusion of a price floor is inconsistent with the fundamental capacity market design and risks substantial distortion to the capacity market results, including significant price suppression. PJM degraded the market power mitigation rules by permitting CPQR adders without a net revenue offset and segmented offer curves without adequate limits. The undervaluation of thermal resources in the winter will not be addressed. The underlying issues with PJM's ELCC model will not be addressed.

Capacity accreditation should recognize the winter capability of thermal resources rather than limiting such resources to summer ratings. Most of the risk recognized in the ELCC model is winter risk but the ELCC accreditation values for thermal resources are capped at the summer ratings. That inappropriately reduces capacity payments to these resources, and reduces the capacity value of these resources, which artificially reduces the supply of capacity. From the market perspective, that unnecessarily limits supply and changes the ELCC values for all other resources which reduces the system accredited unforced capacity, changes the maximum level of load that can be served by the existing resources and therefore changes the reliability requirement. There is no reason that excess winter CIRs cannot be assigned to these resources immediately.

An increase in demand will further tighten the market, and prices in the next capacity auction will reflect both that increase and the modified market design. The MMU analysis shows that with a 5.0 percent increase in the load forecast over the load forecast used in the 2025/2026 auction, with the RMR resources included in supply, with the end of the must offer exemption and with the maximum price equal to 1.5 times Net CONE, total payments would increase by about \$1.8 billion over the revenues in the 2025/2026 BRA, or 12.2 percent.<sup>2</sup>

<sup>1</sup> See MMU reports analyzing the 2025/2026 RPM Base Residual Auction, "Analysis of the 2025/2026 RPM Base Residual Auction - Part A," (Sep. 20, 2024), "Analysis of the 2025/2026 RPM Base Residual Auction - Part B," (Oct. 15, 2024), "Analysis of the 2025/2026 RPM Base Residual Auction - Part C," (Nov. 6, 2024), "Analysis of the 2025/2026 RPM Base Residual Auction - Part D," (Dec. 6, 2024), "Analysis of the 2025/2026 RPM Base Residual Auction - Part E," (Jan. 31, 2025), "Analysis of the 2025/2026 RPM Base Residual Auction - Part F," (Feb. 4, 2025). These reports can be found at <https://www.monitoringanalytics.com/reports/Reports/2024.shtml>.

<sup>2</sup> These calculations are based on the offers in the 2025/2026 auction. The results of the simulations are not forecasts. If the increase in the load forecast were 3.5 percent, the increase in total payments would be about \$0.9 billion, or 6.4 percent. Id.

A goal of market design should be to be consistent and predictable and transparent. A consistent, predictable and transparent design would provide a stable investment environment for generators and a stable price environment for customers who both consume and invest. New supply requires competitive incentives and a stable investment environment. The objective of the market design should be markets that work, markets that work for generators and markets that work for customers. The objective of the market design should also be markets that are transparent and understandable to market participants and to regulators. The capacity market design should be as simple as possible to meet its objectives. The current capacity market design does not meet these standards.

The PJM ELCC model does not meet these standards. As an example, PJM retracted its December 2024 ELCC posting which had included some significant changes in technology ELCC ratings. The December ELCC ratings that had been based on the preliminary 2025 load forecast were replaced with January ELCC ratings based on the outdated January 2024 load forecast. The result was much smaller changes in ELCC ratings. Logically, PJM should have used the current forecast as the basis for ELCC ratings. The result of such changes in ELCC ratings is that generators whose ELCC ratings decreased between the base residual auction and the incremental auction would have to buy more capacity to make up the shortfall. The failure to update the ELCC values based on the current forecast that will actually be used in the next auction means that the risk of ELCC changes is inappropriately shifted from generators to load. As another example, the impacts of the 2025 load forecast model on ELCC, which PJM avoided by using the 2024 load forecast model to finalize values for the 2025/2026 Delivery Year, are reflected in the recently released ELCC values for the 2026/2027 RPM Base Residual Auction.<sup>3</sup> The ELCC class rating for combined cycles is 74.0 percent, 4.0 percentage points lower than the final rating of 78.0 percent for 2025/2026. This change will significantly reduce available capacity in the 2026/2027 capacity auction.

It should not have been a surprise that PJM's ELCC values are volatile as both analysis and their short history demonstrate. In addition, the ELCC calculations are disproportionately affected by historical winter

availability and weather. PJM's ELCC values, based on a relatively small number of historical winter performance hours, fail to distinguish between the impact of PJM commitment and dispatch actions, and the performance of generators. As an example during Winter Storm Elliott, if PJM called on a gas-fired resource to operate in late afternoon but the unit could not get gas based on gas nomination cycle rules, the ELCC calculation shows that as a failure to perform rather than a failure of PJM to recognize the actual notification time for the unit. That asserted failure to perform then affects ELCC values for future auctions without an opportunity to correct any actual performance issues. ELCC values for thermal resources have been understated. The level of uncertainty created by PJM's ELCC design combined with the extreme PAI penalties has a negative impact on the risk and economic viability of units considering retirement and weakens the incentives to invest in PJM generation. Despite assertions about the efficacy of PAI penalties, there are effectively zero performance incentives when PJM addresses high load days through conservative operations, as PJM has appropriately done since Winter Storm Elliott. The ELCC should be unit specific. The ELCC should be based on unit specific hourly supply and demand matching. Capacity resources should be paid only when available to perform. Capacity resources should be paid based on actual hourly performance during the delivery year.

The results of capacity market auctions are a result of both demand and supply conditions. There are current issues with the addition of both demand and supply that must be addressed in a comprehensive, transparent and stable manner in order to help ensure that the market can manage to balance demand and supply. It is not enough to simply assert that the market will solve all these problems. Markets need rules. Some of the problems are based on rules that create unnecessary administrative barriers to entry to new supply or create uncertainty about the addition of new large demand. PJM needs a process for expediting and streamlining the entry of new generation without distorting the related PJM market principles. PJM needs a process for managing the addition of large loads to the system without distorting the capacity market design. FERC relies on competitive markets to be a more effective substitute for economic regulation. FERC's rules about market design and rules governing demand and supply are essential to creating the conditions under which markets can work.

<sup>3</sup> 2026-2027 BRA ELCC Class Ratings, PJM Interconnection LLC. (February 28, 2025) <<https://www.pjm.com/planning/resource-adequacy-planning/effective-load-carrying-capability>>.

These are public, regulatory decisions because they are about competitive outcomes that are in the interests of all market participants.

On the demand side, the tight capacity market conditions highlight the significance for future capacity market auctions of the ongoing efforts to place new data center loads behind nuclear power plants and potentially other thermal generators and thus remove that capacity from the capacity market. Removal of even a relatively small amount of capacity from the market would have a significant impact on reliability and capacity market prices. This highlights the point that there should be no artificial incentives or changes to fundamental capacity market rules in order to allow large loads to be given preferential treatment. Yet that is exactly what the proponents of the co-located load approach are proposing. The gains for the generators from the proposed co-location model would come at the expense of other customers in the PJM markets. The core feature of the co-located load approach is increasing the level and certainty of revenues to specific generating units, avoiding the transmission and distribution costs associated with both state and federal regulation and avoiding the PJM planning process. The proposed co-located load arrangements also create uncertainty about the application of state and federal jurisdiction.<sup>4</sup> Contrary to the proponents, the impacts of the proposed co-located load arrangements on reliability do matter and must be considered when defining the appropriate rules for large load additions.

New load must be served in wholesale power markets. New data center load must be served in PJM and elsewhere. Any national security issues are about serving data center load and not about the co-located model. Serving existing industrial, commercial and residential load is also a national security issue. The only question is how to serve the potentially very large increases in load in a way that does not threaten reliability or the ability of PJM markets to reliably serve all load at the lowest possible cost. The co-located load model is clearly not the answer. The primary proponents of the co-located load model are owners of existing generation. PJM's preference is to have new load explicitly connected to the grid as transmission customers. Statements to FERC indicate that some transmission owners with no generation agree and that some potential owners of data centers agree. Data centers need power and not the co-

located load model. NERC pointed out operational issues that arise from the co-located load model.<sup>5</sup>

The addition of large amounts of load is not a private decision that should be addressed via private negotiations about the terms of ISAs. The large impacts on PJM capacity and energy prices that would result from implementation of the co-located load model are evidence of that fact as are the potential impacts on reliability. PJM must have the authority to plan for meeting large load additions in the same way that PJM plans for generation additions. While not a requirement, the addition of large data centers would also be easier if the data centers brought new generation matching the parameters of their demand to the market in addition to new load. Some data center owners have proposed exactly that. If there is a policy decision that large data centers must be brought online more quickly, that timing issue can be handled through the PJM planning process without threatening reliability and without requiring subsidies from other customers. The timeline for bringing load online does not depend on avoiding regulatory and planning requirements via the co-located model.

Adding large amounts of data center load would have impacts on PJM markets regardless of whether the load is co-located or explicitly interconnected to the grid. If the load is interconnected to the grid it will go through the PJM planning process to ensure that the load can be met reliably through a combination of generation and transmission and that the load will pay an appropriate share of system costs, including a full share of transmission costs as a network customer. The correct market signals would be created for the location of data centers if that process were followed.

Power grids were built to permit all participants to take advantage of the diverse characteristics of loads and of generation. When a generator is on an outage, other generators are available on the grid to replace the output. The co-located model would directly remove significant capacity from the market but the co-located load would continue to rely on the grid for backup. The co-located proposals illustrate the basic fact that the co-located load cannot and will not be isolated from the grid. The co-located load model would rely on the grid for backup while asserting that it is isolated from the grid.

<sup>4</sup> See 190 FERC ¶ 61,115 at PP 66–73.

<sup>5</sup> See FERC Commissioner led Technical Conference on Large Loads Co-Located at Generating Facilities, Docket No. AD24–11 (Nov. 1, 2024).

PJM's planning on the load side should include complete transparency from beginning to end about the addition of new load in EDCs, unrestricted by secret agreements and associated NDAs and ensure that there is enough generation to meet the new and existing load. PJM's planning process should be modified to integrate transmission planning with markets planning in order to eliminate the significant gaps in the current process.

On the supply side, competition starts with open access to the transmission grid. The fundamental purpose of the queue process is to provide open access to the grid and to ensure that the energy from capacity resources is deliverable so that capacity resources can meet their must offer obligations in the energy market and provide reliable energy supply during all conditions.

The current PJM interconnection queue does not include adequate thermal capacity to replace the potentially retiring thermal capacity. The apparent level of MW in the interconnection queues substantially overstates the level of capacity MW that is likely to actually go into service in PJM markets for all resource types.

While there are legitimate differences of opinion about the exact level and timing of the need, PJM needs additional capacity resources and PJM needs to remove inefficient barriers to entry based on interconnection queue rules in order to facilitate that entry. PJM has taken essential steps to do exactly that, including the Interconnection Process Reform changes to the queue management process and the recent filing and approval of the RRI and SIS rules. More needs to be done.

PJM made an additional filing of a generator proposal that generation owners should be permitted to avoid the queue process and directly transfer the generation CIRs to an affiliate or directly sell the CIRs to an unaffiliated entity. That proposal should be rejected. That proposal is about creating a process to maximize the value of existing CIRs to incumbent generators and not about facilitating the efficient replacement of retiring capacity resources. In effect, this approach, if adopted by the large number of retiring units, would create a chaotic, bilateral private queue process, create market power and facilitate the exercise of market power in the sale of CIRs by incumbent generators, create the potential for delays of up to a year or more and inappropriately delegate the authority from PJM to the incumbent generator to choose the new resource based on the highest offer for

CIRs rather than based on PJM defined system reliability needs.

This additional PJM filing states that all capacity is good capacity and that therefore indiscriminating approval is appropriate for whatever capacity results from the bilateral sale of the CIRs by the existing generation owner. That is not correct. All capacity is not created equal when it comes to addressing specific reliability needs. The only purpose of creating an expedited process should be to permit the faster commercial operation of capacity resources that can address specific reliability issues. The PJM RRI process recognizes that fact and provides screening criteria (which should be improved) to help ensure that the expedited new capacity will actually address the identified need.

Generation owners should not be deemed to have monopoly property rights in CIRs. Generation owners should not be given the unilateral right to determine who the next market entrant will be or to extract monopoly rents from potential new entrants. The value of CIRs is a result of the entire transmission system which has been paid for by customers and other generators. The value of CIRs is a result of the existence of a network and is not a result solely or even primarily of the investment that may or may not have been required in order to get CIRs. The cost of CIRs is part of project costs included in generation owners' investment decisions like any other project cost and subject to the same risk and reward structure. Open access to the transmission system by new resources should not be limited by claims to own the access rights by retiring units.

PJM's expedited process for addressing reliability needs (RRI) is preferable to the private bilateral approach, should be made a permanent part of the PJM queue management process and should be considered as the preferred approach for addressing unit retirements and immediate reliability issues more generally. With the RRI approval, PJM has established an expedited PJM managed queue process to identify commercially viable projects that could address resource adequacy concerns, help eliminate or reduce the need for specific RMRs or that could address specific reliability needs and allow the identified projects to advance in the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming.



While the short term RRI process is a clear improvement, PJM should request the ongoing authority to advance projects at any time that can more effectively address immediate reliability issues including the issues that result from requests to retire existing resources regardless of whether they qualify for RMR status. While it is important to respect the existing, improved PJM queue process, it is essential to provide strong and clear incentives for projects to actually resolve reliability issues and to actually guarantee timely in service dates in order to help ensure that the queue is not a mirage as it has been in significant part for its recent history. Recognizing that improved queue rules are being implemented, the history of queue projects and whether they become actual in service capacity resources suggests strongly that such incentives have not been provided by the queue process.

One of the benefits of competitive power markets is that changes in input prices and changes in the balance of supply and demand are reflected immediately in energy prices for both price decreases and price increases. Energy prices increased in 2024 from 2023. The real-time load-weighted average LMP in 2024 increased \$2.66 per MWh, or 8.5 percent from 2023, from \$31.08 per MWh to \$33.74 per MWh. Of the \$2.66 per MWh increase, \$1.39 per MWh (52.4 percent) was in the transmission constraint penalty factor component of LMP, \$0.50 per MWh (18.9 percent) was in the fuel and consumables cost components of LMP, -\$0.05 per MWh (-1.9 percent) was in the emissions cost components of LMP, \$0.10 per MWh (3.7 percent) was in the scarcity component of LMP, and \$0.16 per MWh (6.2 percent) was in the market power components of LMP.

The total cost of wholesale power increased \$2.46 per MWh, or 4.6 percent, from \$53.08 per MWh in 2023 to \$55.54 per MWh in 2024. Energy (58.7 percent), capacity (6.6 percent) and transmission charges (31.9 percent) are the three largest components of the total cost of wholesale power, comprising 97.1 percent of the total cost per MWh in 2024. Starting in the third quarter of 2019, the cost of transmission per MWh of wholesale power has been higher than the cost of capacity.

In 2024, generation from coal units increased 1.4 percent, generation from natural gas units increased 3.5 percent, generation from oil units increased 53.1 percent, generation from wind units increased 8.5

percent, and generation from solar units increased 58.1 percent compared to 2023.

Energy market net revenues are significantly affected by energy prices and fuel prices. Energy prices and eastern gas prices increased and western gas and coal prices decreased in 2024 compared to 2023. The net effects were that in 2024, average energy market theoretical net revenues increased by 21 percent for a new combustion turbine (CT), increased by 9 percent for a new combined cycle (CC), increased by 67 percent for a new coal plant (CP), increased by 4 percent for a new nuclear plant, increased by 313 percent for a new diesel (DS), increased by 6 percent for a new onshore wind installation, increased by 12 percent for a new offshore wind installation and increased by 17 percent for a new solar installation.

The real-time hourly average load in 2024 increased by 3.6 percent from 2023, from 86,193 MWh to 89,274 MWh.

Changes in forward energy market prices significantly affect the expected profitability of nuclear plants in PJM. Based on forward prices as of December 31, 2024, for energy, and known forward prices for capacity including an assumed clearing price of \$325/MW-Day for the 2026/2027 delivery year, all the nuclear plants in PJM are expected to cover their avoidable costs from energy and capacity market revenues in 2025 and 2026, without subsidies.

While there are multiple centrifugal forces acting on PJM markets, there are still options available to maintain well functioning markets. Steps that can and should be taken immediately to offset those forces include: improve the capacity market design; identify the availability of firm gas supply; ensure transparent information from pipelines; identify the need for dual fuel capacity; modify the RMR process; add comprehensive expedited queue options under PJM control to replace retiring resources and address immediate reliability issues; ensure integrated PJM transmission and reliability planning; ensure that large new loads are not subsidized or given preferential treatment; ensure that market power mitigation measures are not eroded; and include direct comparisons between generation and transmission options to address reliability issues.

The evolution of wholesale power markets is far from complete. The PJM markets need rules in order to provide reliable energy through competition. The foundational principle of using markets, with rules to prevent the exercise of market power and provide competitive results, is essential. Private investors, regardless of technology or subsidies, will put capital at risk and earn compensatory returns in markets that are not skewed in favor of any specific technology and in markets that are stable and that do not add risk and volatility. The core elements of the PJM market design remain robust. The use of locational marginal prices (LMP) in the energy market and partially locational prices in the capacity market continue to be essential to getting the price signals right. Technological and policy changes do not require that the core elements change. But the market design can and must be improved and made more reliable and more efficient and more competitive. The current PJM ELCC capacity market design adds unnecessary risk and volatility that are not part of the market fundamentals. The ELCC approach needs to be applied on a unit specific basis, incorporate hourly supply and demand matching, and pay resources based on actual availability and performance rather than on assumed performance derived from a very limited data set of misinterpreted performance results based on unrepresentative extreme historical weather and specific PJM commitment and dispatch decisions. The capacity market also needs to eliminate artificial PAI risk that leads to uneconomic retirements and exits from PJM. The basic logic of market power mitigation in both energy and capacity markets needs to be restored. The queue process should allow for a comprehensive, expedited process to resolve identified reliability issues. The queue process should include large load additions. The markets will also need support from regulators whose decisions create and/or limit the options available to investors in PJM resources. Competition to build transmission and to add GETs should be expanded.

In the interests of all market participants, PJM, its actual and potential market participants and stakeholders, PJM state regulators, and the FERC will need to continue to work constructively to refine the competitive market design and to ensure the continued effectiveness of PJM markets in providing customers wholesale power at the lowest possible price, but no lower.

## PJM Market Summary Statistics

Table 1-1 shows selected summary statistics describing PJM markets.

**Table 1-1 PJM market summary statistics: 2023 and 2024<sup>6</sup>**

	2023	2024	Percent Change
Average Hourly Load Plus Exports (MWh)	92,455	94,787	2.5%
Average Hourly Generation Plus Imports (MWh)	94,165	96,605	2.6%
Peak Load Plus Export (MWh)	152,797	154,045	0.8%
Peak Load Excluding Export (MWh)	144,215	148,890	3.2%
Installed Capacity at December 31 (MW)	178,253	179,656	0.8%
Load Weighted Average Real Time LMP (\$/MWh)	\$31.08	\$33.74	8.5%
Total Congestion Costs (\$ Million)	\$1,068.60	\$1,754.40	64.2%
Total Uplift Credits (\$ Million)	\$156.9	\$269.9	72.0%
Total PJM Billing (\$ Billion)	\$48.50	\$51.74	6.7%

<sup>6</sup> In Table 1-1, the MMU used the total PJM billing values provided by PJM through 2018. Starting in 2019, the total PJM billing values in Table 1-1 are modified by the MMU, to more accurately reflect PJM total billing. The total PJM billing shown in Table 1-1 is different from the total cost shown in Table 1-9. The total PJM billing in Table 1-1 represents the total dollars that pass through the PJM settlement process, while the total cost shown in Table 1-9 represents the portion of the total billing associated with the cost to load and includes additional costs to load accounted for outside the PJM settlement process.




## PJM Market Background

The PJM Interconnection, L.L.C. (PJM) operates a centrally dispatched, competitive wholesale electric power market that, as of December 31, 2024, had installed generating capacity of 179,656 megawatts (MW) and 1,109 members including market buyers, sellers and traders of electricity in a region including more than 65 million people in all or parts of 13 states (Delaware, Illinois, Indiana, Kentucky, Maryland, Michigan, New Jersey, North Carolina, Ohio, Pennsylvania, Tennessee, Virginia, West Virginia) and the District of Columbia (Figure 1-1).<sup>7 8 9</sup>

As part of the market operator function, PJM coordinates and directs the operation of the transmission grid and plans transmission expansion improvements to maintain grid reliability in this region.

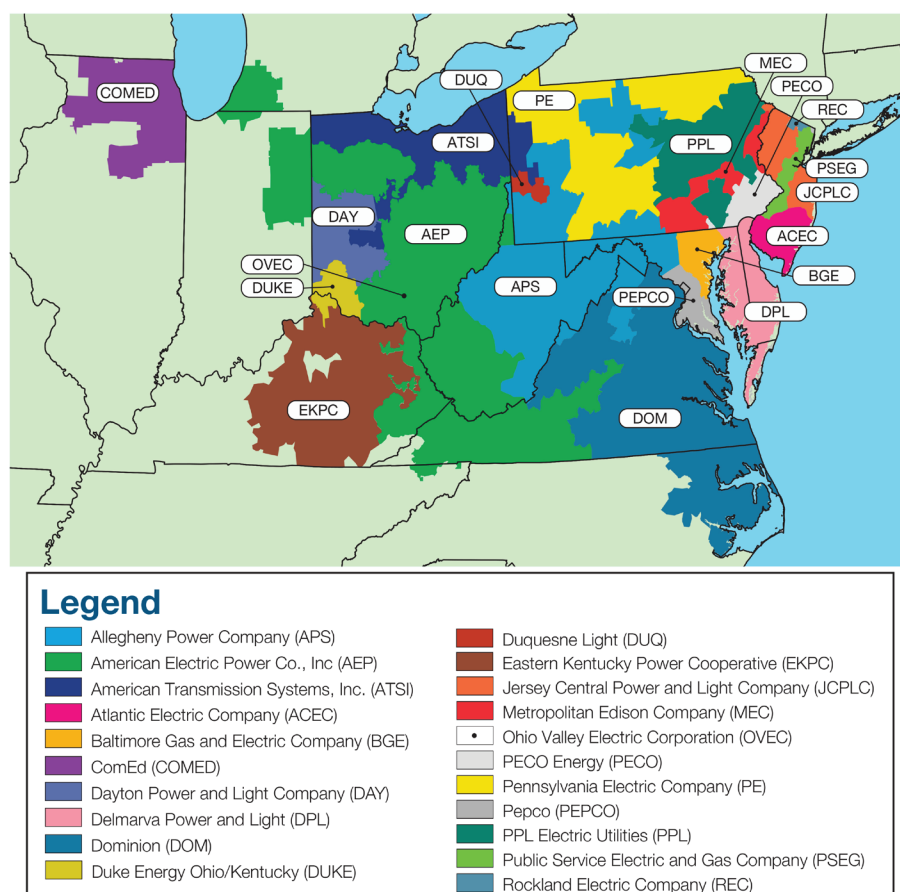**Figure 1-1 PJM's footprint and its 21 control zones**




<sup>7</sup> See PJM. "Member List," which can be accessed at: <http://pjm.com/about-pjm/member-services/member-list.aspx>.

<sup>8</sup> See PJM. "Who We Are," which can be accessed at: <http://pjm.com/about-pjm/who-we-are.aspx>.

<sup>9</sup> See the 2024 Annual State of the Market Report for PJM, Volume 2, Appendix A: "PJM Overview" for maps showing the PJM footprint and its evolution prior to 2024.

In 2024, PJM had gross billings of \$51.74 billion, an increase of 6.7 percent from \$48.50 billion in 2023. (Figure 1-2).

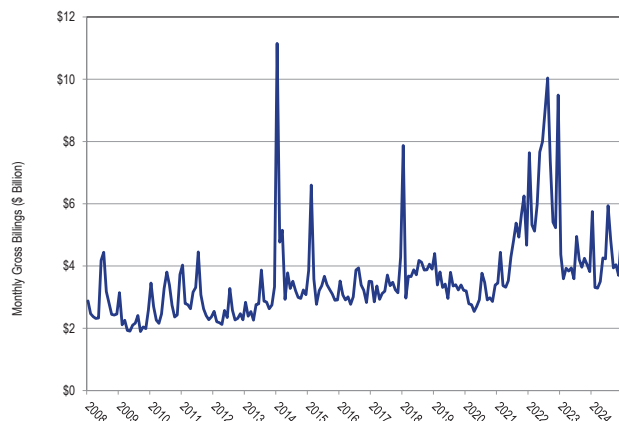**Figure 1-2 PJM reported monthly billings (\$ Billion): 2008 through 2024<sup>10</sup>**



PJM operates the day-ahead energy market, the real-time energy market, the capacity market, the regulation market, the synchronized reserve market, the secondary reserve market and the financial transmission rights (FTRs) markets.

PJM introduced energy pricing with cost-based offers and market-clearing nodal prices on April 1, 1998, and market-clearing nodal prices with market-based offers on April 1, 1999. PJM introduced the Daily Capacity Market on January 1, 1999, and the Monthly and Multimonthly Capacity Markets for the January through May 1999 period. PJM implemented FTRs on May 1, 1999. PJM implemented the day-ahead energy market and the regulation market on June 1, 2000. PJM modified the regulation market design and added a market in Synchronized Reserve on December 1, 2002. PJM introduced an Auction Revenue Rights (ARR) allocation process and an associated Annual FTR Auction effective June 1, 2003. PJM introduced the RPM capacity market effective June 1, 2007. PJM implemented the DASR market on June 1, 2008, and eliminated it on October 1, 2022. PJM introduced the Capacity Performance capacity market design effective

<sup>10</sup> In Figure 1-2, the MMU used the total PJM billing values provided by PJM through 2018. Starting in 2019, the total PJM billing values in Figure 1-2 are modified by the MMU, to more accurately reflect PJM total billing. The total PJM billing shown in Figure 1-2 is different from the total cost shown in Table 1-9. The total PJM billing in Figure 1-2 represents the total dollars that pass through the PJM settlement process, while the total cost shown in Table 1-9 represents the portion of the total billing associated with the cost to load and includes additional costs to load accounted for outside the PJM settlement process.

on August 10, 2015, with the Base Residual Auction for 2018/2019.<sup>11 12</sup>

## Conclusions

This report assesses the competitiveness of the markets managed by PJM in 2024, including market structure, participant behavior and market performance. This report was prepared by and represents the analysis of the Independent Market Monitor for PJM, also referred to as the Market Monitoring Unit or MMU.

For each PJM market, the market structure is evaluated as competitive or not competitive, and participant behavior is evaluated as competitive or not competitive. Most important, the outcome of each market, market performance, is evaluated as competitive or not competitive.

The MMU also evaluates the market design for each market. The market design serves as the vehicle for translating participant behavior within the market structure into market performance. This report evaluates the effectiveness of the market design of each PJM market in providing market performance consistent with competitive results.

Market structure refers to the cost, demand, and ownership structure of the market. The three pivotal supplier (TPS) test is the most relevant measure of market structure because it accounts for the ownership of assets and the relationship among the pattern of ownership, the resource costs, and the market demand using actual market conditions with both temporal and geographic granularity. Market shares and the related Herfindahl-Hirschman Index (HHI) are also measures of market structure.

Participant behavior refers to the actions of individual market participants, also sometimes referred to as participant conduct.

<sup>11</sup> See also the 2024 Annual State of the Market Report for PJM, Volume 2, Appendix A: "PJM Overview."

<sup>12</sup> Analysis of 2024 market results requires comparison to prior years. During calendar years 2004 and 2005, PJM conducted the phased integration of five control zones: COMED, American Electric Power (AEP), The Dayton Power & Light Company (DAY), Duquesne Light Company (DUQ) and Dominion (DOM). In June 2011, PJM integrated the American Transmission Systems, Inc. (ATSI) Control Zone. In January 2012, PJM integrated the Duke Energy Ohio/Kentucky (DUKE) Control Zone. In June 2013, PJM integrated the Eastern Kentucky Power Cooperative (EKPC). In December 2018, PJM integrated the Ohio Valley Electric Corporation (OVEC). By convention, control zones bear the name of a large utility service provider working within their boundaries. The nomenclature applies to the geographic area, not to any single company. For additional information on the integrations, their timing and their impact on the footprint of the PJM service territory prior to 2024, see 2023 Annual State of the Market Report for PJM, Volume 2, Appendix A: "PJM Overview."

Market performance refers to the outcomes of the market. Market performance results from the behavior of market participants within a market structure, mediated by market design.

Market design means the rules under which the entire relevant market operates, including the software that implements the market rules. Market rules include the definition of the product, the definition of short run marginal cost, rules governing offer behavior, market power mitigation rules, and the definition of demand. Market design is characterized as effective, mixed or flawed. An effective market design provides incentives for competitive behavior and permits competitive outcomes. A mixed market design has significant issues that constrain the potential for competitive behavior to result in competitive market outcomes, and does not have adequate rules to mitigate market power or incent competitive behavior. A flawed market design produces inefficient outcomes which cannot be corrected by competitive behavior.

## Energy Market Conclusion

The Market Monitoring Unit (MMU) analyzed measures of market structure, participant conduct and market performance, including market size, concentration, pivotal suppliers, offer behavior, markup, and price. The MMU concludes that the PJM energy market results were competitive in 2024.

**Table 1-2 The energy market results were competitive**

Market Element	Evaluation	Market Design
Market Structure: Aggregate Market	Partially Competitive	
Market Structure: Local Market	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Effective

- The aggregate market structure was evaluated as partially competitive because the aggregate market power test based on pivotal suppliers indicates that the aggregate day-ahead market structure was not competitive on 49.5 percent of the days in 2024. The hourly HHI (Herfindahl-Hirschman Index) results indicate that the PJM aggregate energy market in 2024 was, on average, unconcentrated by FERC HHI standards. The average HHI was 714 with a minimum of 553 and a maximum of 983. The baseload segment of the supply curve was unconcentrated. The intermediate segment of the supply curve was moderately concentrated on

average. The peaking segment of the supply curve was highly concentrated. The fact that the average HHI is in the unconcentrated range does not mean that the aggregate market was competitive in all hours. As demonstrated for the day-ahead market, it is possible to have pivotal suppliers in the aggregate market even when the HHI level is not in the highly concentrated range. It is possible to have an exercise of market power even when the HHI level is not in the highly concentrated range. The number of pivotal suppliers in the energy market is a more precise measure of structural market power than the HHI. The HHI is not a definitive measure of structural market power.

- The local market structure was evaluated as not competitive due to the highly concentrated ownership of supply in local markets created by transmission constraints and local reliability issues. The results of the three pivotal supplier (TPS) test, used to test local market structure, indicate the existence of market power in local markets created by transmission constraints. The local market performance is competitive as a result of the application of the TPS test. Transmission constraints create the potential for the exercise of local market power. The goal of PJM's application of the three pivotal supplier test is to identify local market power and offer cap to competitive offers, correcting for structural issues created by local transmission constraints. There are, however, identified issues with the definition of cost-based offers and the application of market power mitigation to resources whose owners fail the TPS test that need to be addressed because unit owners can exercise market power even when they fail the TPS test.
- Participant behavior was evaluated as competitive because the analysis of markup shows that marginal units generally make offers at, or close to, their marginal costs in both the day-ahead and real-time energy markets, although the behavior of some participants both routinely and during periods of high demand represents economic withholding. The ownership of marginal units is concentrated. The markups of pivotal suppliers in the aggregate market and of many pivotal suppliers in local markets remain unmitigated due to the lack of aggregate market power mitigation and the flawed implementation of offer caps for resources that fail

the TPS test. The markups of those participants affected LMP.

- Market performance was evaluated as competitive because market results in the energy market reflect the outcome of a competitive market, as PJM prices are set, on average, by marginal units operating at, or close to, their marginal costs in both day-ahead and real-time energy markets, although high markups for some marginal units did affect prices.
- Market design was evaluated as effective because the analysis shows that the PJM energy market resulted in competitive market outcomes. In general, PJM's energy market design provides incentives for competitive behavior and results in competitive outcomes. In local markets, where market power is an issue, the market design identifies market power and causes the market to provide competitive market outcomes in most cases although issues with the implementation of market power mitigation and development of cost-based offers remain. The role of UTCs in the day-ahead energy market continues to cause concerns. Market design implementation issues, including inaccuracies in modeling of the transmission system and of generator capabilities as well as inefficiencies in price formation, undermine market efficiency in the energy market. The implementation of fast start pricing on September 1, 2021, undermined market efficiency by setting inefficient prices that are inconsistent with the dispatch signals.
- PJM markets are designed to promote competitive outcomes derived from the interaction of supply and demand in each of the PJM markets. Market design itself is the primary means of achieving and promoting competitive outcomes in PJM markets. One of the MMU's core functions is to identify actual or potential market design flaws.<sup>13</sup> The approach to market power mitigation in PJM has focused on market designs that promote competition (a structural basis for competitive outcomes) and on mitigating market power in instances where the market structure is not competitive and thus where market design alone cannot mitigate market power. FERC relies on effective market power mitigation when it approves market sellers to participate in

the PJM market at market based rates.<sup>14</sup> In the PJM energy market, market power mitigation occurs primarily in the case of local market power. When a transmission constraint creates the potential for local market power, PJM applies a structural test to determine if the local market is competitive, applies a behavioral test to determine if generator offers exceed competitive levels and applies a market performance test to determine if such generator offers would affect the market price.<sup>15</sup> There are, however, identified issues with the application of market power mitigation to resources whose owners fail the TPS test that can result in the exercise of local market power even when market power mitigation rules are applied. These issues need to be addressed, but, so far, PJM and FERC have failed to address them.<sup>16 17 18</sup> Some units with market power have positive markups and some have inflexible parameters, which means that the cost-based offer was not used and that the process for offer capping units that fail the TPS test does not consistently result in competitive market outcomes in the presence of market power. There are issues related to the definition of gas costs includable in energy offers that need to be addressed. There are issues related to the level of maintenance expense includable in energy offers that need to be addressed. There are currently no market power mitigation rules in place that limit the ability to exercise market power when aggregate market conditions are tight and there are pivotal suppliers in the aggregate market. Aggregate market power needs to be addressed. Market design must reflect appropriate incentives for competitive behavior, the application of local market power mitigation needs to be fixed, the definition of a competitive offer needs to be fixed, and aggregate market power mitigation rules need to be developed. The importance of these issues is amplified by the rules permitting cost-based offers in excess of \$1,000 per MWh.

<sup>13</sup> OATT Attachment M (PJM Market Monitoring Plan).

<sup>14</sup> See *Refinements to Horizontal Market Power Analysis for Sellers in Certain Regional Transmission Organization and Independent System Operator Markets*, Order No. 861, 168 FERC ¶ 61,040 (2019); *order on reh'g*, Order No. 861-A; 170 FERC ¶ 61,106 (2020).

<sup>15</sup> The market performance test means that offer capping is not applied if the offer does not exceed the competitive level and therefore market power would not affect market performance.

<sup>16</sup> 175 FERC ¶ 61,231 (2021).

<sup>17</sup> 185 FERC ¶ 61,158 (2023).

<sup>18</sup> 189 FERC ¶ 61,060 (2024).

## Capacity Market Conclusion

The Market Monitoring Unit (MMU) analyzed market design, market structure, participant conduct and market performance in the PJM Capacity Market, including supply, demand, concentration ratios, pivotal suppliers, volumes, prices, outage rates and reliability.<sup>19</sup> The conclusions are a result of the MMU's evaluation of the 2025/2026 Base Residual Auction.<sup>20 21 22 23 24 25</sup>

**Table 1-3 The capacity market results were not competitive**

Market Element	Evaluation	Market Design
Market Structure: Aggregate Market	Not Competitive	
Market Structure: Local Market	Not Competitive	
Participant Behavior	Not Competitive	
Market Performance	Not Competitive	Mixed

- The aggregate market structure was evaluated as not competitive. For almost all auctions held from 2007 to the present, the PJM capacity market failed the three pivotal supplier test (TPS), which is conducted at the time of the auction.<sup>26</sup> Structural market power is endemic to the capacity market.
- The local market structure was evaluated as not competitive. For almost every auction held, all LDAs have failed the TPS test, which is conducted at the time of the auction.<sup>27</sup>
- Participant behavior was evaluated as not competitive in the 2025/2026 BRA. The offers of

most market sellers were competitive after the Commission order corrected the definition of the market seller offer cap.<sup>28</sup> Market power mitigation measures were applied when the capacity market seller failed the market power test for the auction, the submitted sell offer exceeded the defined offer cap, and the submitted sell offer, absent mitigation, would increase the market clearing price. However, a significant level of categorically exempt resources did not offer and the result was to increase the clearing prices above the competitive level.

- Market performance was evaluated as not competitive based on the 2025/2026 Base Residual Auction as a result of the failure to offer of categorically exempt resources, the flaws in the Effective Load Carrying Capability (ELCC) design including the failure to correctly define the reliability contribution of thermal resources in the winter and the failure to include reliability must run (RMR) capacity in the supply curve.
- Market design was evaluated as mixed because while there are many positive features of the capacity market design, there are several features of the RPM design which still threaten competitive outcomes. These include the details of PJM's ELCC implementation, the failure to apply the RPM must offer requirement consistently, the inclusion of performance assessment interval (PAI) penalties, the exclusion of RMR resources from supply, the use of gross CONE as the maximum price on the VRR curve, the definition of DR which permits inferior products to substitute for capacity, the replacement capacity issue, the definition of unit offer parameters, and the inclusion of imports which are not substitutes for internal capacity resources.

<sup>19</sup> The values stated in this report for the RTO and LDAs refer to the aggregate level including all nested LDAs unless otherwise specified. For example, RTO values include the entire PJM market and all LDAs. Rest of RTO values are RTO values net of nested LDA values.

<sup>20</sup> See "Analysis of the 2025/2026 RPM Base Residual Auction - Part A," (September 20, 2024) <[https://www.monitoringanalytics.com/reports/Reports/2024/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_A\\_20240920.pdf](https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_A_20240920.pdf)>.

<sup>21</sup> See "Analysis of the 2025/2026 RPM Base Residual Auction - Part B," (October 15, 2024) <[https://www.monitoringanalytics.com/reports/Reports/2024/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_B\\_20241015.pdf](https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_B_20241015.pdf)>.

<sup>22</sup> See "Analysis of the 2025/2026 RPM Base Residual Auction - Part C," (October 15, 2024) <[https://www.monitoringanalytics.com/reports/Reports/2024/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_C\\_20241106.pdf](https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_C_20241106.pdf)>.

<sup>23</sup> See "Analysis of the 2025/2026 RPM Base Residual Auction - Part D," (December 6, 2024) <[https://www.monitoringanalytics.com/reports/Reports/2024/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_D\\_20241206.pdf](https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_D_20241206.pdf)>.

<sup>24</sup> See "Analysis of the 2025/2026 RPM Base Residual Auction - Part E," (January 31, 2025) <[https://www.monitoringanalytics.com/reports/Reports/2025/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_E\\_20250131.pdf](https://www.monitoringanalytics.com/reports/Reports/2025/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_E_20250131.pdf)>.

<sup>25</sup> See "Analysis of the 2025/2026 RPM Base Residual Auction - Part F," (February 4, 2025) <[https://www.monitoringanalytics.com/reports/Reports/2025/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_F\\_20250204.pdf](https://www.monitoringanalytics.com/reports/Reports/2025/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_F_20250204.pdf)>.

<sup>26</sup> In the 2008/2009 RPM Third Incremental Auction, 18 participants in the RTO market passed the TPS test. In the 2018/2019 RPM Second Incremental Auction, 35 participants in the RTO market passed the test. In the 2023/2024 RPM Third Incremental Auction, 36 participants in the RTO passed the TPS test.

<sup>27</sup> In the 2012/2013 RPM Base Residual Auction, six participants included in the incremental supply of EMAAC passed the TPS test. In the 2014/2015 RPM Base Residual Auction, seven participants in the incremental supply in MAAC passed the TPS test. In the 2021/2022 RPM First Incremental Auction, two participants in the incremental supply in EMAAC passed the TPS test. In the 2021/2022 RPM Second Incremental Auction, two participants in the incremental supply in EMAAC passed the TPS test. In the 2023/2024 RPM Third Incremental Auction, eight participants in MAAC passed the TPS test.

<sup>28</sup> 176 FERC ¶ 61,137 (2021), *order denying reh'g*, 178 FERC ¶ 61,121 (2022), *appeal denied*, EPSA, et al. v. FERC, Case No. 21-1214, et al. (DC Cir. October 10, 2023). The Commission recognized the market power problem and issued an order correcting the PJM tariff, eliminating the prior offer cap and establishing a competitive market seller offer cap set at net ACR, effective September 2, 2021.



## Synchronized Reserve Market Conclusion

The MMU analyzed measures of market structure, conduct and performance for the PJM Synchronized Reserve Market for 2024.

**Table 1-4 The synchronized reserve market results were not competitive**

Market Element	Evaluation	Market Design
Market Structure: Regional Markets	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Not Competitive	Flawed

- The synchronized reserve market structure was evaluated as not competitive due to moderate levels of supplier concentration in the MAD Reserve Subzone.
- Participant behavior was evaluated as competitive because the market rules require all available reserves to offer at cost-based offers.
- Market performance was evaluated as not competitive because the interaction of participant behavior with the market design does not result in competitive prices as a result of PJM's changes to the ORDC. In an attempt to counter poor synchronized reserve performance, PJM unilaterally and inappropriately extended the first step of the operating reserve demand curve (ORDC) for synchronized reserve, known as the synchronized reserve reliability requirement, in May 2023, raising prices for synchronized reserves and energy.
- Market design was evaluated as flawed based on PJM's modifications to the ORDC. PJM previously adopted reforms, including several based on MMU recommendations, removing both physical and economic withholding from the market.
- Significant communications technology issues when calling resources during synchronized reserve events have resulted in slow response from resources. On December 17, 2024, PJM implemented an electronic deployment of reserves via an augmented dispatch signal, but PJM does not require that resources be able to receive this signal.

## Nonsynchronized Reserve Market Conclusion

The MMU analyzed measures of market structure, conduct and performance for the PJM Nonsynchronized Reserve Market for 2024.

**Table 1-5 The nonsynchronized reserve market results were competitive**

Market Element	Evaluation	Market Design
Market Structure: Regional Markets	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Effective

- The nonsynchronized reserve market structure was evaluated as not competitive due to moderate levels of supplier concentration for primary reserve in the MAD Reserve Subzone.
- Participant behavior was evaluated as competitive because all available reserves are included by the PJM markets software, so withholding is not possible.
- Market performance was evaluated as competitive because the interaction of participant behavior with the market design results in competitive prices.
- Market design was evaluated as effective.

## Secondary Reserve Market Conclusion

The MMU analyzed measures of market structure, conduct and performance for the PJM Secondary Reserve Market for 2024.

**Table 1-6 The secondary reserve market results were competitive**

Market Element	Evaluation	Market Design
Market Structure	Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Effective

- The secondary reserve market structure was evaluated as competitive, because the supply of 30-minute reserves was not concentrated in the real-time market. The secondary reserve market was moderately concentrated in the day-ahead market.
- Participant behavior was evaluated as competitive because all available reserves are included by the PJM software, so withholding is not possible.
- Market performance was evaluated as competitive because the combination of a competitive market

structure and competitive participation resulted in competitive market outcomes.

- The market design was evaluated as effective because the market rules ensure competitive market offers and require repayment of offline cleared secondary reserves that are not available when called on to provide energy in 30 minutes.

## Regulation Market Conclusion

The MMU analyzed measures of market structure, conduct and performance for the PJM Regulation Market for 2024.

**Table 1-7 The regulation market results were not competitive**

Market Element	Evaluation	Market Design
Market Structure	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Not Competitive	Flawed

- The regulation market structure was evaluated as not competitive because the PJM Regulation Market failed the three pivotal supplier (TPS) test in 94.7 percent of the hours in 2024.
- Participant behavior in the PJM Regulation Market was evaluated as competitive in 2024 because market power mitigation requires competitive offers when the three pivotal supplier test is failed, although the inclusion of a positive margin is not consistent with competitive offers.
- Market performance was evaluated as not competitive, because all units are not paid the same price on an equivalent MW basis.
- Market design was evaluated as flawed. The market design has failed to correctly incorporate a consistent implementation of the marginal benefit factor in optimization, pricing and settlement. The market results continue to include the incorrect definition of opportunity cost. The result is significantly flawed market signals to existing and prospective suppliers of regulation.

## FTR Auction Market Conclusion

The *2024 Annual State of the Market Report for PJM* focuses on the first seven months of the 2024/2025 planning period as well as the 2024/2025 Long Term and Annual FTR auctions and ARR allocation, specifically covering June 1, 2024, through December 31, 2024. The Market Monitoring Unit (MMU) analyzed measures of market structure, participant conduct and market performance, including market size, concentration, offer behavior, and price. The MMU concludes that the PJM FTR auction market results were partially competitive in 2024.

**Table 1-8 The FTR auction markets results were partially competitive**

Market Element	Evaluation	Market Design
Market Structure	Competitive	
Participant Behavior	Partially Competitive	
Market Performance	Partially Competitive	Flawed

- Market structure was evaluated as competitive. The ownership of FTR obligations is unconcentrated for the individual years of the 2024/2027 Long Term FTR Auction, the 2024/2025 Annual FTR Auction and each period of the Monthly Balance of Planning Period Auctions for prevailing flow FTRs. The ownership of FTR options is moderately or highly concentrated for every Monthly FTR Auction period and unconcentrated for the 2024/2025 Annual FTR Auction. Ownership of FTRs is disproportionately (75.7 percent) by financial participants. The ownership of ARRs is unconcentrated.
- Participant behavior was evaluated as partially competitive because ARR holders who are the sellers of FTRs have no option to set an acceptable sale price and are not permitted to participate in the market clearing in any way and are not assured they will receive 100 percent of auction revenues.
- Market performance was evaluated as partially competitive because of the significant and persistent flaws in the market design. Sellers, the ARR holders, cannot set a sale price. Buyers can reclaim some of their purchase price after the market clears if the product does not meet a profitability target. The market resulted in a substantial shortfall in congestion payments to load and significant and unsupportable disparities among zones in the share of congestion returned to load. FTR purchases by

financial entities remain persistently profitable in part as a result of the flaws in the market design.

- Market design was evaluated as flawed because there are significant, fundamental and persistent flaws in the basic ARR/FTR design. The FTR auction market is not actually a market because the sellers have no independent role in the process. ARR holders cannot determine the price at which they are willing to sell rights to congestion revenue. Buyers have the ability to reclaim some of the price paid for FTRs after the market clears and, as a result, sellers are not assured they will receive 100 percent of auction revenues. The market design is not an efficient or effective way to ensure that the rights to all congestion revenues are assigned to load. The product sold to FTR buyers is incorrectly defined as target allocations rather than a share of congestion revenue. ARR holders' rights to congestion revenues are not correctly defined because the contract path based assignment of congestion rights is inadequate and incorrect. The ongoing PJM subjective intervention in the FTR market that affects market fundamentals is also an issue and a symptom of the fundamental flaws in the design. The product, the quantity of the product and the price of the product are all incorrectly defined.
- The fact that load is not able to define its willingness to sell FTRs or to set the prices at which it is willing to sell FTRs and the fact that load is required to return some of the cleared auction revenue to FTR buyers when FTR profits are deemed to be not adequate, means that the FTR design does not actually function as a market and is evidence of basic flaws in the market design.

## Role of MMU

FERC assigns three core functions to MMUs: reporting, monitoring and market design.<sup>29</sup> These functions are interrelated and overlap. The PJM Market Monitoring Plan establishes these functions, providing that the MMU is responsible for monitoring: compliance with the PJM Market Rules; actual or potential design flaws in the PJM Market Rules; structural problems in the PJM Markets that may inhibit a robust and competitive market; the actual or potential exercise of market power or violation of the market rules by a Market Participant; PJM's implementation of the PJM Market Rules or operation of the PJM Markets; and such matters as are necessary to prepare reports.<sup>30</sup>

## Reporting

The MMU performs its reporting function primarily by issuing and filing annual and quarterly state of the market reports; regular reports on market issues, such as RPM auction reports; reports responding to requests from regulators and other authorities; and ad hoc reports on specific topics. The state of the market reports provide a comprehensive analysis of market structure, participant conduct and market performance for the PJM markets. State of the market reports and other reports are intended to inform PJM, the PJM Board, FERC, other regulators, other authorities, market participants, stakeholders and the general public about how well PJM markets achieve the competitive outcomes necessary to realize the goals of regulation through competition, and how the markets can be improved.

The MMU presents reports directly to PJM stakeholders, PJM staff, FERC staff, state commission staff, state commissions, other regulatory agencies and the general public. Report presentations provide an opportunity for interested parties to ask questions, discuss issues, and provide feedback to the MMU.

## Monitoring

To perform its monitoring function, the MMU screens and monitors the conduct of Market Participants under the MMU's broad purview to monitor, investigate, evaluate and report on the PJM Markets.<sup>31</sup> The MMU has

<sup>29</sup> 18 CFR § 35.28(g)(3)(ii); see also *Wholesale Competition in Regions with Organized Electric Markets*, Order No. 719, FERC Stats. & Regs. ¶31,281 (2008) ("Order No. 719"), order on reh'g, Order No. 719-A, FERC Stats. & Regs. ¶31,292 (2009), reh'g denied, Order No. 719-B, 129 FERC ¶ 61,252 (2009).

<sup>30</sup> OATT Attachment M § IV; 18 CFR § 1c.2.

<sup>31</sup> OATT Attachment M § IV.



direct, confidential access to FERC.<sup>32</sup> The MMU may also refer matters to the attention of state commissions.<sup>33</sup>

The MMU monitors market behavior for violations of FERC Market Rules and PJM Market Rules, including the actual or potential exercise of market power.<sup>34</sup> The MMU will investigate and refer “Market Violations,” which refer to any of “a tariff violation, violation of a Commission-approved order, rule or regulation, market manipulation, or inappropriate dispatch that creates substantial concerns regarding unnecessary market inefficiencies...”<sup>35 36 37</sup> The MMU also monitors PJM for compliance with the rules, in addition to market participants.<sup>38</sup>

An important component of the monitoring function is the review of inputs to mitigation. The actual or potential exercise of market power is addressed in part through *ex ante* mitigation rules incorporated in PJM’s market clearing software for the energy market, the capacity market and the regulation market. If a market participant fails the TPS test in any of these markets its offer is set to the lower of its price-based or cost-based offer. This prevents the exercise of market power and ensures competitive pricing, provided that the cost-based offer accurately reflects short run marginal cost.

If cost-based offers do not accurately reflect short run marginal cost, the market power mitigation process does not ensure competitive pricing in PJM markets. The MMU evaluates the fuel cost policy for every unit as well as the other inputs to cost-based offers. PJM Manual 15 does not clearly or accurately describe

the short run marginal cost of generation. Manual 15 should be replaced with a straightforward description of the components of cost offers based on short run marginal costs and the correct calculation of cost offers. The MMU evaluates every offer cap in each capacity market (RPM) auction using data submitted to the MMU through web-based data input systems developed by the MMU.<sup>39</sup>

The MMU also reviews operational parameter limits included with unit offers, evaluates compliance with the requirement to offer into the energy and capacity markets, evaluates the economic basis for unit retirement requests and evaluates and compares offers in the day-ahead and real-time energy markets.<sup>40 41 42 43</sup>

The MMU reviews offers and inputs in order to evaluate whether those offers raise market power concerns. Market participants, not the MMU, determine and take responsibility for offers that they submit and the market conduct that those offers represent. If the MMU has a concern about an offer, the MMU may raise that concern with FERC or other regulatory authorities. FERC and other regulators have enforcement and regulatory authority that they may exercise with respect to offers submitted by market participants. PJM also reviews offers, but it does so in order to determine whether offers comply with the PJM tariff and manuals. PJM, in its role as the market operator, may reject an offer that fails to comply with the market rules. The respective reviews performed by the MMU and PJM are separate and non-sequential.

The PJM markets monitored by the MMU include market related procurement processes conducted by PJM, such as for Black Start resources included in the PJM system restoration plan.<sup>44 45</sup>

The MMU also monitors transmission planning, interconnections and rules for vertical market power issues, and with the introduction of competitive transmission development policy in Order No. 1000, horizontal market power issues.<sup>46</sup>

32 OATT Attachment M § IV.K.3.

33 OATT Attachment M § IV.H.

34 OATT § I.1 (“FERC Market Rules” mean the market behavior rules and the prohibition against electric energy market manipulation codified by the Commission in its Rules and Regulations at 18 CFR §§ 1c.2 and 35.37, respectively; the Commission-approved PJM Market Rules and any related proscriptions or any successor rules that the Commission from time to time may issue, approve or otherwise establish... “PJM Market Rules” mean the rules, standards, procedures, and practices of the PJM Markets set forth in the PJM Tariff, the PJM Operating Agreement, the PJM Reliability Assurance Agreement, the PJM Consolidated Transmission Owners Agreement, the PJM Manuals, the PJM Regional Practices Document, the PJM-Midwest Independent Transmission System Operator Joint Operating Agreement or any other document setting forth market rules.”)

35 FERC defines engagement as engaging “in any act, practice, or course of business that operates or would operate as a fraud or deceit upon any entity.” 18 CFR § 1c.2(a)(3). Manipulation may involve behavior that is consistent with the letter of the rules, but violates their spirit. An example is market behavior that is economically meaningless, such as equal and opposite transactions, which may entitle the transacting party to a benefit associated with volume. Unlike market power or rule violations, manipulation must be intentional. The MMU must build its case, including an inference of intent, on the basis of market data.

36 OATT § I.1.

37 The MMU has no prosecutorial or enforcement authority. The MMU notifies FERC when it identifies a significant market problem or market violation. OATT Attachment M § IV.I.1. If the problem or violation involves a market participant, the MMU discusses the matter with the participant(s) involved and analyzes relevant market data. If that investigation produces sufficient credible evidence of a violation, the MMU prepares a formal referral and thereafter undertakes additional investigation of the specific matter only at the direction of FERC staff. *Id.* If the problem involves an existing or proposed law, rule or practice that exposes PJM markets to the risk that market power or market manipulation could compromise the integrity of the markets, the MMU explains the issue, as appropriate, to FERC, state regulators, stakeholders or other authorities. The MMU may also initiate, participate as a party or provide information or testimony in regulatory or other proceedings.

38 OATT Attachment M § IV.C.

39 OATT Attachment M–Appendix § II.E.

40 OATT Attachment M–Appendix § II.B.

41 OATT Attachment M–Appendix § II.C.

42 OATT Attachment M–Appendix § IV.

43 OATT Attachment M–Appendix § VII.

44 OATT Attachment M–Appendix § II(p).

45 OATT Attachment M–Appendix § III.

46 OA Schedule 6 § 1.5.

## Market Design

In order to perform its role in PJM market design, the MMU evaluates existing and proposed PJM Market Rules and the design of the PJM Markets.<sup>47</sup> The MMU initiates and proposes changes to the design of such markets or the PJM Market Rules in stakeholder or regulatory proceedings.<sup>48</sup> In support of this function, the MMU engages in discussions with stakeholders, State Commissions, PJM Management, and the PJM Board; participates in PJM stakeholder meetings or working groups regarding market design matters; publishes proposals, reports or studies on such market design issues; and makes filings with the Commission on market design, market rules and market rule implementation issues, including complaints or petitions.<sup>49</sup> The MMU also recommends changes to the PJM Market Rules to the staff of the Commission's Office of Energy Market Regulation, State Commissions, and the PJM Board.<sup>50</sup> The MMU may provide in its annual, quarterly and other reports "recommendations regarding any matter within its purview."<sup>51</sup>

## New Recommendations

Consistent with its core function to "[e]valuate existing and proposed market rules, tariff provisions and market design elements and recommend proposed rule and tariff changes," the MMU recommends specific enhancements to existing market rules and implementation of new rules that are required for competitive results in PJM markets and for continued improvements in the functioning of PJM markets.<sup>52</sup>

In this *2024 Annual State of the Market Report for PJM*, the MMU includes seven new recommendations made for 2024, one of which is new in this 2024 annual report.<sup>53</sup>

<sup>47</sup> OATT Attachment M § IV.D.

<sup>48</sup> *Id.*

<sup>49</sup> *Id.*; see also, e.g., 171 FERC ¶ 61,039; 167 FERC ¶ 61,084 at PP 70–76, *reh'g denied*, 168 FERC ¶ 61,141.

<sup>50</sup> *Id.*

<sup>51</sup> OATT Attachment M § VI.A.

<sup>52</sup> 18 CFR § 35.28(g)(3)(ii)(A); see also OATT Attachment M § IV.D.

<sup>53</sup> New recommendations include all MMU recommendations that were reported for the first time in the *2024 Annual State of the Market Report for PJM* or in any of the three quarterly state of the market reports that were published in 2024.

## New Recommendation from Section 3, Energy Market

- The MMU recommends, in order to ensure effective market power mitigation, that PJM commit all resources that fail the TPS test on their cost-based offers, that the Market Seller designate the cost-based offer if there is more than one, and that PJM implement this solution as soon as possible. (Priority: High. First reported Q3 2024. Status: Not adopted.)

## New Recommendation from Section 5, Capacity Market

- The MMU recommends that the reference resource be a CT rather than a CC. The MMU recommends that the ELCC value used to convert the gross CONE in ICAP terms for a CT to the gross CONE in UCAP terms be the ELCC based on winter ratings. (Priority: High. First reported Q3 2024. Status: Not adopted.)

## New Recommendation from Section 9, Interchange Transactions

- The MMU recommends eliminating the mechanism that defines FFE and M2M payments. These mechanisms are not consistent with markets and are not needed for efficient interface pricing. The MMU recommends that PJM file with the Commission to eliminate the FFE calculation and M2M payment of the PJM and MISO joint operating agreement. (Priority: Medium. First reported Q2 2024. Status: Not adopted.)

## New Recommendation from Section 10, Ancillary Services

- The MMU recommends that PJM remove the 30 percent increase to the synchronized reserve reliability requirement. (Priority: High. New recommendation. Status: Not adopted.)

## New Recommendations from Section 12, Generation and Transmission Planning

- The MMU recommends that PJM establish an expedited PJM managed queue process to identify commercially viable projects that could help eliminate or reduce the need for specific RMRs or that could address specific reliability needs and allow the identified projects to advance in the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming. (Priority: High. First reported Q2, 2024. Status: Not adopted.)
- The MMU recommends that all PJM transmission owners investigate the applicability and potential cost savings of Grid Enhancing Technology (GET) and that all PJM transmission owners implement cost effective GET, subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. (Priority: Medium. First reported Q2, 2024. Status: Not adopted.)
- The MMU recommends that the implementation of Grid Enhancing Technology (GET) be opened to competition from third parties, subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. (Priority: Medium. First reported Q3, 2024. Status: Not adopted.)

## Total Cost of Wholesale Power

The total cost of wholesale power is the average total cost per MWh of wholesale electricity in PJM markets.<sup>54</sup> The costs of each component and subcomponent may vary by location and time period. The total costs are the sum of the total charges for the individual billing line items in each category divided by real-time load, even when a specific category is not charged on that basis. The total cost of wholesale power and the components of that cost are presented for informational purposes and should not be used to calculate the costs of any specific market activity in PJM. The total cost includes the cost of energy, capacity, transmission service, ancillary services, and administrative fees billed through PJM systems. Table 1-9 shows the total cost, by component, for 2023 and 2024.

The total costs shown in Table 1-9 equal the total cost per MWh, by category, multiplied by the total real time load. The total costs are different from the total billing values that PJM reports as shown in Figure 1-2. PJM's reported total billing values represent the total dollars that pass through the PJM settlement process.

Each of the components in Table 1-9 is defined in PJM's Open Access Transmission Tariff (OATT) and PJM Operating Agreement and each is collected through PJM's billing system.<sup>55</sup>

Table 1-9 shows that energy, capacity and transmission charges are the three largest components of the total cost per MWh of wholesale power, comprising 97.1 percent of the total cost per MWh in 2024. The total cost of energy per MWh increased from \$30.40 in 2023 to \$32.58 in 2024, an increase of 7.2 percent. The total cost of capacity per MWh decreased from \$4.63 in 2023 to \$3.65 in 2024, a decrease of 21.1 percent. The total cost of transmission per MWh increased from \$16.54 in 2023 to \$17.71 in 2024, an increase of 7.1 percent. The total cost per MWh of wholesale power increased from \$53.08 in 2023 to \$55.54 in 2024, an increase of 4.6 percent.

<sup>54</sup> Accounting load is used in the calculation of total price because accounting load is the load customers pay for in PJM settlements. The use of accounting load with losses before June 1, 2007 and without losses after June 1, 2007, is consistent with PJM's calculation of LMP. Before June 1, 2007, transmission losses were included in accounting load. After June 1, 2007, transmission losses were excluded from accounting load and losses were addressed through the inclusion of marginal loss pricing in LMP.

<sup>55</sup> For more information on the calculation of the total cost of wholesale power, see Monitoring Analytics, "Total Cost of Wholesale Power Calculation Documentation," <[https://www.monitoringanalytics.com/data/docs/Total\\_Cost\\_of\\_Wholesale\\_Power\\_Calculation.pdf](https://www.monitoringanalytics.com/data/docs/Total_Cost_of_Wholesale_Power_Calculation.pdf)>.

Table 1-9 Total cost per MWh by category: 2023 and 2024<sup>56 57 58</sup>

Category	2023 \$/MWh	2023 (\$ Millions)	2023 Percent of Total	2024 \$/MWh	2024 (\$ Millions)	2024 Percent of Total	Percent Change
Energy	\$30.40	\$22,956	57.3%	\$32.58	\$25,549	58.7%	7.2%
Day Ahead Energy	\$31.58	\$23,847	59.5%	\$33.43	\$26,215	60.2%	5.8%
Balancing Energy	\$0.45	\$338	0.8%	\$0.57	\$444	1.0%	26.6%
ARR Credits	(\$1.46)	(\$1,103)	(2.8%)	(\$1.24)	(\$971)	(2.2%)	(15.2%)
Self Scheduled FTR Credits	(\$0.42)	(\$320)	(0.8%)	(\$0.53)	(\$414)	(0.9%)	24.5%
Balancing Congestion	\$0.39	\$296	0.7%	\$0.39	\$304	0.7%	(0.9%)
Emergency Energy	\$0.00	\$0	0.0%	\$0.00	\$0	0.0%	0.0%
Inadvertent Energy	\$0.01	\$4	0.0%	\$0.01	\$9	0.0%	104.8%
Load Response - Energy	\$0.01	\$6	0.0%	\$0.01	\$11	0.0%	74.0%
Emergency Load Response	\$0.08	\$61	0.2%	\$0.00	\$0	0.0%	(100.0%)
Energy Uplift (Operating Reserves)	\$0.21	\$156	0.4%	\$0.34	\$268	0.6%	65.2%
Marginal Loss Surplus Allocation	(\$0.51)	(\$385)	(1.0%)	(\$0.45)	(\$356)	(0.8%)	(10.9%)
Market to Market Payments	\$0.07	\$55	0.1%	\$0.05	\$38	0.1%	(33.3%)
Capacity	\$4.63	\$3,497	8.7%	\$3.65	\$2,864	6.6%	(21.1%)
Capacity (Capacity Market and FRR)	\$4.53	\$3,417	8.5%	\$3.56	\$2,791	6.4%	(21.3%)
Capacity Part V (RMR)	\$0.11	\$79	0.2%	\$0.08	\$65	0.1%	(21.3%)
Load Response - Capacity	\$0.00	\$0	0.0%	\$0.01	\$8	0.0%	3,010.6%
Transmission	\$16.54	\$12,488	31.2%	\$17.71	\$13,886	31.9%	7.1%
Transmission Service Charges	\$14.13	\$10,671	26.6%	\$15.04	\$11,796	27.1%	6.4%
Transmission Enhancement Cost Recovery	\$2.32	\$1,754	4.4%	\$2.57	\$2,019	4.6%	10.8%
Transmission Owner (Schedule 1A)	\$0.08	\$63	0.2%	\$0.09	\$72	0.2%	10.5%
Transmission Seams Elimination Cost Assignment (SECA)	\$0.00	\$0	0.0%	\$0.00	\$0	0.0%	0.0%
Transmission Facility Charges	\$0.00	\$0	0.0%	\$0.00	\$0	0.0%	0.0%
Ancillary	\$0.89	\$670	1.7%	\$0.92	\$725	1.7%	4.2%
Reactive	\$0.52	\$389	1.0%	\$0.49	\$381	0.9%	(5.8%)
Regulation	\$0.17	\$130	0.3%	\$0.23	\$183	0.4%	35.7%
Black Start	\$0.09	\$67	0.2%	\$0.09	\$74	0.2%	5.7%
Synchronized Reserves	\$0.10	\$73	0.2%	\$0.10	\$75	0.2%	(2.1%)
Secondary Reserves	\$0.00	\$1	0.0%	\$0.00	\$2	0.0%	76.7%
Non-Synchronized Reserves	\$0.01	\$9	0.0%	\$0.01	\$10	0.0%	8.6%
Day Ahead Scheduling Reserve (DASR)	\$0.00	\$0	0.0%	\$0.00	\$0	0.0%	0.0%
Administration	\$0.62	\$465	1.2%	\$0.67	\$529	1.2%	9.5%
PJM Administrative Fees	\$0.57	\$428	1.1%	\$0.62	\$489	1.1%	10.1%
NERC/RFC	\$0.04	\$31	0.1%	\$0.04	\$35	0.1%	5.9%
RTO Startup and Expansion	\$0.00	\$0	0.0%	\$0.00	\$0	0.0%	0.0%
Other	\$0.01	\$6	0.0%	\$0.01	\$5	0.0%	(11.6%)
Total Price	\$53.08	\$40,076	100.0%	\$55.54	\$43,554	100.0%	4.6%
Total Day Ahead Load	748,619			775,838			3.6%
Total Balancing Load	(6,433)			(8,345)			29.7%
Total Real Time Load	755,053			784,182			3.9%
Total Cost (\$ Billions)	\$40.08			\$43.55			8.7%

56 Note: The totals in this table include after the fact billing adjustments and may not match totals presented in past reports.

57 The total cost in this table does not match the PJM reported total billing due to differences in calculation methods. The total prices in this table are load-weighted average system prices per MWh by category, even if each category is not charged on a per MWh basis. PJM's reported total billing represents the total dollars that pass through the PJM settlement process.

58 The MMU publishes monthly detail of the total cost of wholesale power. See <[http://www.monitoringanalytics.com/data/pjm\\_price.shtml](http://www.monitoringanalytics.com/data/pjm_price.shtml)>.

Table 1-10 shows the inflation adjusted average cost, by component, for 2023 and 2024. To calculate the inflation adjusted average costs, the individual components' costs are deflated using the US Consumer Price Index for all items, Urban Consumers (with a base period of January 1998).<sup>59</sup>

**Table 1-10 Inflation adjusted total cost per MWh by category: 2023 and 2024<sup>60 61</sup>**

Category	2023 \$/MWh	2023 (\$ Millions)	2023 Percent of Total	2024 \$/MWh	2024 (\$ Millions)	2024 Percent of Total	Percent Change
Energy	\$16.12	\$12,175	57.1%	\$16.79	\$13,167	58.4%	4.1%
Day Ahead Energy	\$16.75	\$12,648	59.3%	\$17.23	\$13,510	60.0%	2.8%
Balancing Energy	\$0.24	\$179	0.8%	\$0.29	\$229	1.0%	23.1%
ARR Credits	(\$0.78)	(\$585)	(2.7%)	(\$0.64)	(\$500)	(2.2%)	(17.7%)
Self Scheduled FTR Credits	(\$0.22)	(\$169)	(0.8%)	(\$0.27)	(\$213)	(0.9%)	21.1%
Balancing Congestion	\$0.21	\$157	0.7%	\$0.20	\$157	0.7%	(3.6%)
Emergency Energy	\$0.00	\$0	0.0%	\$0.00	\$0	0.0%	0.0%
Inadvertent Energy	\$0.00	\$2	0.0%	\$0.01	\$5	0.0%	101.0%
Load Response - Energy	\$0.00	\$3	0.0%	\$0.01	\$6	0.0%	68.3%
Emergency Load Response	\$0.04	\$33	0.2%	\$0.00	\$0	0.0%	(100.0%)
Energy Uplift (Operating Reserves)	\$0.11	\$83	0.4%	\$0.18	\$138	0.6%	61.2%
Marginal Loss Surplus Allocation	(\$0.27)	(\$204)	(1.0%)	(\$0.23)	(\$183)	(0.8%)	(13.3%)
Market to Market Payments	\$0.04	\$29	0.1%	\$0.02	\$20	0.1%	(35.4%)
Capacity	\$2.54	\$1,918	9.0%	\$1.99	\$1,563	6.9%	(21.5%)
Capacity (Capacity Market and FRR)	\$2.48	\$1,876	8.8%	\$1.95	\$1,526	6.8%	(21.7%)
Capacity Part V (RMR)	\$0.06	\$42	0.2%	\$0.04	\$33	0.1%	(23.4%)
Load Response - Capacity	\$0.00	\$0	0.0%	\$0.01	\$4	0.0%	2,933.8%
Transmission	\$8.77	\$6,623	31.1%	\$9.12	\$7,154	31.8%	4.0%
Transmission Service Charges	\$7.49	\$5,659	26.5%	\$7.75	\$6,077	27.0%	3.4%
Transmission Enhancement Cost Recovery	\$1.23	\$930	4.4%	\$1.33	\$1,040	4.6%	7.6%
Transmission Owner (Schedule 1A)	\$0.04	\$33	0.2%	\$0.05	\$37	0.2%	7.3%
Transmission Seams Elimination Cost Assignment (SECA)	\$0.00	\$0	0.0%	\$0.00	\$0	0.0%	0.0%
Transmission Facility Charges	\$0.00	\$0	0.0%	\$0.00	\$0	0.0%	0.0%
Ancillary	\$0.47	\$355	1.7%	\$0.48	\$373	1.7%	1.2%
Reactive	\$0.27	\$206	1.0%	\$0.25	\$196	0.9%	(8.5%)
Regulation	\$0.09	\$69	0.3%	\$0.12	\$94	0.4%	31.9%
Black Start	\$0.05	\$36	0.2%	\$0.05	\$38	0.2%	2.6%
Synchronized Reserves	\$0.05	\$39	0.2%	\$0.05	\$38	0.2%	(4.5%)
Secondary Reserves	\$0.00	\$1	0.0%	\$0.00	\$1	0.0%	72.3%
Non-Synchronized Reserves	\$0.01	\$5	0.0%	\$0.01	\$5	0.0%	6.0%
Day Ahead Scheduling Reserve (DASR)	\$0.00	\$0	0.0%	\$0.00	\$0	0.0%	0.0%
Administration	\$0.33	\$247	1.2%	\$0.35	\$273	1.2%	6.4%
PJM Administrative Fees	\$0.30	\$227	1.1%	\$0.32	\$252	1.1%	6.9%
NERC/RFC	\$0.02	\$17	0.1%	\$0.02	\$18	0.1%	2.9%
RTO Startup and Expansion	\$0.00	\$0	0.0%	\$0.00	\$0	0.0%	0.0%
Other	\$0.00	\$3	0.0%	\$0.00	\$3	0.0%	(13.8%)
Total Price	\$28.23	\$21,318	100.0%	\$28.73	\$22,530	100.0%	1.8%
Total Day Ahead Load	748,619			775,838			3.6%
Total Balancing Load	(6,433)			(8,345)			29.7%
Total Real Time Load	755,053			784,182			3.9%
Total Cost (\$ Billions)	\$21.32			\$22.53			5.7%

<sup>59</sup> US Consumer Price Index for all items, Urban Consumers (base period: January 1998), published by Bureau of Labor Statistics. <<http://download.bls.gov/pub/time.series/cu/cu.data.1.AllItems>> (January 15, 2025).

<sup>60</sup> The totals in the Transmission section of this table include corrections to previously reported totals which did not include a full accounting of Transmission Enhancement Cost Recovery costs.

<sup>61</sup> Note: The totals in this table include after the fact billing adjustments and may not match totals presented in past reports.

Figure 1-3 shows the total cost of wholesale power in 2023 and 2024.

**Figure 1-3 Total cost per MWh by category: 2023 and 2024**


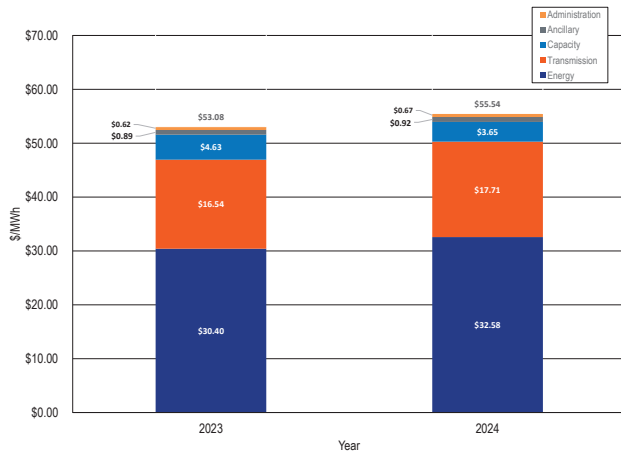


Figure 1-4 shows the contributions of the energy, capacity and transmission service components of the total cost of wholesale power for each quarter since 2001. Starting in the third quarter of 2019, the cost of transmission per MWh of wholesale power has been higher than the cost of capacity.

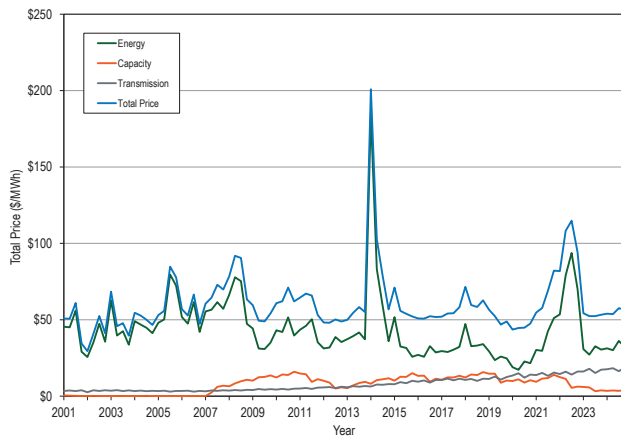**Figure 1-4 Top three components of quarterly total cost (\$/MWh): 2001 through 2024<sup>62</sup>**



<sup>62</sup> Note: The totals presented in this figure include after the fact billing adjustments and may not match totals presented in past reports.

Table 1-11 shows the total cost, by component of the total wholesale power cost per MWh, for calendar years 2001 through 2024.

**Table 1-11 Total cost per MWh by category: 2001 through 2024<sup>63</sup>**

Category	2001	2002	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh	\$/MWh
Energy	\$44.41	\$36.91	\$44.97	\$44.95	\$63.89	\$51.15	\$57.76	\$66.84	\$35.47	\$44.36	\$44.06	\$34.43	\$38.94	\$93.20	\$35.96	\$28.74	\$30.29	\$36.84	\$25.99	\$20.26	\$38.44	\$74.42	\$30.40	\$32.58
Day Ahead Energy	\$39.66	\$35.34	\$41.72	\$40.75	\$60.21	\$50.02	\$57.04	\$68.59	\$37.78	\$45.19	\$44.29	\$33.67	\$37.88	\$51.81	\$36.52	\$29.48	\$30.92	\$37.57	\$27.15	\$21.09	\$38.65	\$74.25	\$31.58	\$33.43
Balancing Energy	\$4.46	\$2.24	\$3.49	\$4.06	\$3.85	\$2.50	\$3.05	\$3.48	\$1.80	\$3.56	\$2.06	\$1.55	\$1.83	\$42.24	\$0.81	\$0.53	\$0.34	\$0.74	\$0.17	\$0.36	\$0.80	\$2.04	\$0.45	\$0.57
ARR Credits	\$0.00	\$0.00	\$0.27	\$0.40	\$0.39	\$0.59	\$0.62	\$0.72	\$0.89	\$0.52	\$0.64	\$0.55	\$0.45	\$0.54	\$0.73	\$0.82	\$0.68	\$0.70	\$0.87	\$0.69	\$0.56	\$1.15	\$1.46	\$1.24
Self Scheduled FIR Credits	\$0.93	\$1.35	\$0.83	\$0.32	\$0.80	\$1.21	\$1.58	\$2.18	\$0.69	\$1.26	\$0.57	\$0.22	\$0.23	\$0.63	\$0.46	\$0.29	\$0.20	\$0.34	\$0.14	\$0.19	\$0.33	\$1.11	\$0.42	\$0.53
Balancing Congestion	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.03	\$0.09	\$0.17	\$0.18	\$0.30	\$0.67	\$0.39	\$0.39
Emergency Energy	\$0.00	\$0.00	\$0.02	\$0.00	\$0.02	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.01	\$0.00	\$0.00
Inadvertent Energy	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.01	\$0.01
Load Response - Energy	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.03	\$0.06	\$0.05	\$0.00	\$0.00	\$0.00	\$0.00	\$0.01	\$0.01	\$0.02	\$0.01	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.01	\$0.01	\$0.01
Emergency Load Response	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.02	\$0.02	\$0.01	\$0.06	\$0.06	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Energy Uplift (Operating Reserves)	\$1.26	\$0.72	\$0.89	\$0.95	\$1.07	\$0.47	\$0.65	\$0.64	\$0.48	\$0.80	\$0.78	\$0.74	\$0.55	\$1.11	\$0.38	\$0.17	\$0.14	\$0.23	\$0.11	\$0.12	\$0.23	\$0.36	\$0.21	\$0.34
Marginal Loss Surplus Allocation	\$0.05	\$0.04	\$0.05	\$0.09	\$0.10	\$0.07	\$0.08	\$3.07	\$3.06	\$3.47	\$2.03	\$0.86	\$0.73	\$0.93	\$0.63	\$0.37	\$0.35	\$0.88	\$0.65	\$0.68	\$0.70	\$0.87	\$0.51	\$0.45
Market to Market Payments	\$0.00	\$0.00	\$0.00	\$0.00	\$0.03	\$0.00	\$0.02	\$0.06	\$0.05	\$0.05	\$0.10	\$0.06	\$0.03	\$0.06	\$0.05	\$0.05	\$0.07	\$0.12	\$0.05	\$0.06	\$0.04	\$0.23	\$0.07	\$0.05
Capacity	\$0.27	\$0.12	\$0.08	\$0.09	\$0.04	\$0.11	\$3.85	\$8.83	\$12.13	\$14.04	\$12.26	\$7.36	\$7.68	\$10.29	\$12.50	\$11.78	\$12.16	\$13.95	\$12.00	\$9.99	\$11.64	\$8.81	\$4.63	\$3.65
Capacity (Capacity Market and FRR)	\$0.27	\$0.12	\$0.08	\$0.09	\$0.03	\$0.03	\$3.80	\$8.79	\$12.12	\$14.01	\$12.12	\$7.27	\$7.52	\$10.25	\$12.50	\$11.78	\$12.12	\$13.90	\$11.98	\$9.99	\$11.64	\$8.74	\$4.53	\$3.56
Capacity Part V (RMR)	\$0.00	\$0.00	\$0.00	\$0.00	\$0.02	\$0.08	\$0.05	\$0.04	\$0.01	\$0.02	\$0.13	\$0.08	\$0.06	\$0.04	\$0.00	\$0.00	\$0.00	\$0.04	\$0.05	\$0.02	\$0.00	\$0.07	\$0.11	\$0.08
Load Response - Capacity	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.01	\$0.01	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.01
Transmission	\$3.56	\$3.46	\$3.64	\$3.43	\$3.30	\$3.34	\$3.55	\$3.84	\$4.36	\$4.54	\$5.15	\$5.77	\$6.29	\$7.30	\$8.81	\$9.75	\$10.92	\$10.83	\$11.79	\$13.58	\$14.37	\$15.12	\$16.54	\$17.71
Transmission Service Charges	\$3.48	\$3.39	\$3.57	\$3.28	\$2.71	\$3.18	\$3.45	\$3.68	\$4.03	\$4.04	\$4.49	\$4.90	\$5.21	\$5.96	\$7.09	\$7.81	\$8.83	\$8.81	\$9.80	\$11.33	\$12.00	\$12.77	\$14.13	\$15.04
Transmission Enhancement Cost Recovery	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.07	\$0.25	\$0.40	\$0.56	\$0.78	\$0.99	\$1.25	\$1.62	\$1.86	\$2.02	\$1.92	\$1.91	\$2.15	\$2.29	\$2.28	\$2.12	\$2.57
Transmission Owner (Schedule 1A)	\$0.08	\$0.07	\$0.07	\$0.10	\$0.09	\$0.09	\$0.09	\$0.09	\$0.09	\$0.09	\$0.09	\$0.08	\$0.08	\$0.09	\$0.09	\$0.09	\$0.09	\$0.10	\$0.09	\$0.09	\$0.09	\$0.08	\$0.08	\$0.09
Transmission Seams Elimination Cost Assignment (SECA)	\$0.00	\$0.00	\$0.00	\$0.05	\$0.50	\$0.07	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.03	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Transmission Facility Charges	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.01	\$0.01	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Ancillary	\$0.75	\$0.63	\$0.91	\$0.91	\$1.19	\$0.92	\$1.00	\$1.15	\$0.78	\$0.90	\$0.90	\$0.84	\$1.24	\$0.99	\$0.91	\$0.71	\$0.76	\$0.79	\$0.71	\$0.72	\$0.86	\$1.08	\$0.89	\$0.92
Reactive	\$0.22	\$0.20	\$0.24	\$0.26	\$0.26	\$0.29	\$0.29	\$0.34	\$0.36	\$0.45	\$0.41	\$0.46	\$0.76	\$0.40	\$0.37	\$0.38	\$0.42	\$0.40	\$0.43	\$0.47	\$0.48	\$0.50	\$0.52	\$0.49
Regulation	\$0.53	\$0.42	\$0.50	\$0.51	\$0.80	\$0.53	\$0.63	\$0.70	\$0.34	\$0.36	\$0.32	\$0.26	\$0.25	\$0.33	\$0.23	\$0.11	\$0.14	\$0.18	\$0.12	\$0.10	\$0.19	\$0.38	\$0.17	\$0.23
Black Start	\$0.00	\$0.00	\$0.02	\$0.02	\$0.02	\$0.02	\$0.02	\$0.02	\$0.02	\$0.02	\$0.02	\$0.04	\$0.14	\$0.08	\$0.08	\$0.09	\$0.09	\$0.08	\$0.08	\$0.09	\$0.09	\$0.09	\$0.09	\$0.09
Synchronized Reserves	\$0.00	\$0.01	\$0.15	\$0.13	\$0.11	\$0.08	\$0.06	\$0.08	\$0.05	\$0.07	\$0.09	\$0.04	\$0.04	\$0.12	\$0.11	\$0.05	\$0.06	\$0.06	\$0.04	\$0.03	\$0.07	\$0.11	\$0.10	\$0.10
Secondary Reserves	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Non-Synchronized Reserves	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Day Ahead Scheduling Reserve (DASR)	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.01	\$0.00	\$0.01	\$0.05	\$0.05	\$0.06	\$0.05	\$0.10	\$0.07	\$0.05	\$0.05	\$0.02	\$0.02	\$0.01	\$0.01	\$0.00	\$0.00
Administration	\$0.74	\$0.86	\$1.09	\$1.07	\$0.77	\$0.81	\$0.83	\$0.48	\$0.35	\$0.43	\$0.40	\$0.50	\$0.44	\$0.47	\$0.47	\$0.48	\$0.53	\$0.61	\$0.61	\$0.55	\$0.55	\$0.55	\$0.62	\$0.67
PJM Administrative Fees	\$0.73	\$0.86	\$1.05	\$0.93	\$0.72	\$0.74	\$0.76	\$0.43	\$0.31	\$0.36	\$0.37	\$0.46	\$0.40	\$0.43	\$0.43	\$0.44	\$0.49	\$0.57	\$0.57	\$0.50	\$0.50	\$0.50	\$0.57	\$0.62
NERC/RFC	\$0.01	\$0.01	\$0.04	\$0.07	\$0.04	\$0.05	\$0.06	\$0.04	\$0.02	\$0.02	\$0.02	\$0.02	\$0.02	\$0.03	\$0.03	\$0.03	\$0.03	\$0.03	\$0.04	\$0.04	\$0.04	\$0.04	\$0.04	\$0.04
RTO Startup and Expansion	\$0.00	\$0.00	\$0.00	\$0.06	\$0.00	\$0.01	\$0.01	\$0.01	\$0.01	\$0.01	\$0.01	\$0.01	\$0.01	\$0.01	\$0.01	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Other	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.01	\$0.03	\$0.00	\$0.00	\$0.00	\$0.01	\$0.01	\$0.01	\$0.01	\$0.01	\$0.01	\$0.01	\$0.01	\$0.01	\$0.01	\$0.01
Total Price	\$47.23	\$41.98	\$50.69	\$50.44	\$69.19	\$56.32	\$66.98	\$71.14	\$53.10	\$64.26	\$62.76	\$48.90	\$54.49	\$112.24	\$58.65	\$51.46	\$54.66	\$63.02	\$51.10	\$45.10	\$65.87	\$99.97	\$53.08	\$55.54
Total Day Ahead Load	292.71	344.235	324.653	413.294	654.505	672.501	691.547	680.030	644.485	656.928	704.581	745.165	753.865	749.927	773.842	774.730	760.624	784.553	771.055	734.641	755.824	765.499	748.619	775.838
Total Balancing Load	27.319	31.337	(2.879)	(25.580)	(30.087)	(23.664)	(23.977)	(22.429)	(21.584)	(40.463)	(18.519)	(19.136)	(19.925)	(30.578)	(2.251)	(3.538)	1.849	(6.542)	(8.74)	(6.346)	(11.602)	(13.126)	(6.433)	(6.345)
Total Real Time Load	265.398	321.899	327.533	438.874	684.592	696.165	715.524	698.459	666.069	697.391	723.101	764.300	773.790	780.505	776.093	778.269	758.775	791.094	771.929	742.987	767.425	778.624	755.053	784.182
Total Cost (\$ Billions)	\$13.20	\$13.14	\$16.60	\$22.14	\$47.37	\$39.21	\$47.93	\$56.67	\$35.37	\$44.81	\$45.38	\$37.37	\$42.17	\$87.60	\$45.52	\$40.05	\$41.47	\$49.86	\$39.45	\$33.51	\$50.55	\$77.84	\$40.08	\$43.55

Table 1-12 shows the percent of total cost, by component of the wholesale power cost per MWh, for calendar years 2001 through 2024.

**Table 1-12 Percent of total cost per MWh by category: 2001 through 2024<sup>64</sup>**

	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges	Percent of Total Charges
Category	2001	2002	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
Energy	89.3%	87.9%	88.7%	89.1%	92.3%	90.8%	86.2%	82.4%	66.8%	69.0%	70.2%	70.4%	71.5%	83.9%	61.3%	55.8%	55.4%	58.5%	50.8%	44.9%	58.4%	74.4%	57.3%	58.7%
Day Ahead Energy	79.8%	84.2%	82.3%	80.8%	87.0%	88.9%	85.2%	84.5%	71.1%	70.3%	70.6%	69.9%	69.5%	46.2%	62.3%	57.3%	56.6%	59.6%	53.1%	46.8%	58.7%	74.3%	59.5%	60.2%
Balancing Energy	9.0%	5.3%	6.9%	8.1%	5.6%	4.4%	4.6%	4.3%	3.4%	5.5%	3.3%	3.2%	3.4%	37.6%	1.4%	1.0%	0.6%	1.2%	0.3%	0.8%	1.2%	2.0%	0.8%	1.0%
ARR Credits	0.0%	0.0%	(0.5%)	(0.8%)	(0.6%)	(1.0%)	(0.9%)	(0.9%)	(1.7%)	(0.8%)	(1.0%)	(1.1%)	(0.8%)	(0.5%)	(1.3%)	(1.6%)	(1.2%)	(1.1%)	(1.7%)	(1.5%)	(0.8%)	(1.2%)	(2.8%)	(2.2%)
Self Scheduled FIR Credits	(1.9%)	(3.2%)	(1.6%)	(0.6%)	(1.2%)	(2.1%)	(2.4%)	(2.7%)	(1.3%)	(2.0%)	(0.9%)	(0.5%)	(0.4%)	(0.6%)	(0.8%)	(0.6%)	(0.4%)	(0.5%)	(0.3%)	(0.4%)	(0.5%)	(1.1%)	(0.8%)	(0.9%)
Balancing Congestion	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.1%	0.1%	0.3%	0.4%	0.5%	0.7%	0.7%	0.7%
Emergency Energy	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Indiscreet Energy	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	[0.0%]	[0.0%]	[0.0%]	[0.0%]	0.1%	0.0%	[0.0%]	[0.0%]	[0.0%]	[0.0%]	[0.0%]	[0.0%]	[0.0%]	[0.0%]	0.0%	[0.0%]	[0.0%]	0.0%
Load Response - Energy	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.1%	0.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Emergency Load Response	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.2%	0.0%
Energy Uplift (Operating Reserves)	2.5%	1.7%	1.8%	1.9%	1.5%	0.8%	1.0%	0.8%	0.9%	1.2%	1.2%	1.5%	1.0%	1.0%	0.7%	0.3%	0.3%	0.4%	0.2%	0.3%	0.3%	0.4%	0.4%	0.6%
Marginal Loss Surplus Allocation	(0.1%)	(0.1%)	(0.1%)	(0.2%)	(0.1%)	(0.1%)	(1.3%)	(3.8%)	(5.8%)	(5.4%)	(3.2%)	(1.7%)	(1.3%)	(0.8%)	(1.1%)	(0.7%)	(0.6%)	(1.4%)	(1.3%)	(1.5%)	(1.1%)	(0.9%)	(1.0%)	(0.8%)
Market to Market Payments	0.0%	0.0%	0.0%	0.0%	0.0%	[0.0%]	[0.0%]	0.0%	0.1%	0.1%	0.2%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.2%	0.1%	0.1%	0.1%	0.2%	0.1%	0.1%
Capacity	1.5%	0.3%	0.2%	0.1%	0.2%	0.8%	1.1%	0.2%	1.8%	22.8%	21.8%	13.3%	9.2%	13.2%	22.2%	22.2%	22.2%	22.2%	22.2%	22.2%	22.2%	17.7%	8.7%	8.5%
Capacity (Capacity Market and FRR)	0.5%	0.3%	0.2%	0.2%	0.0%	0.7%	10.8%	22.8%	21.8%	19.3%	14.9%	13.8%	9.1%	21.3%	22.2%	22.2%	22.2%	22.2%	22.2%	22.2%	17.7%	8.7%	8.5%	6.4%
Capacity Part V (RMR)	0.0%	0.0%	0.0%	0.0%	0.1%	0.1%	0.1%	0.0%	0.0%	0.2%	0.2%	0.1%	0.0%	-0.0%	-0.1%	0.1%	0.1%	0.0%	0.0%	0.0%	0.0%	0.1%	0.2%	0.1%
Load Response - Capacity	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Transmission	7.2%	8.2%	7.2%	6.8%	4.8%	5.9%	5.3%	4.7%	8.2%	7.1%	8.2%	11.8%	11.5%	6.5%	15.0%	18.9%	20.0%	17.2%	23.1%	30.1%	21.8%	15.1%	31.2%	31.9%
Transmission Service Charges	7.0%	8.1%	7.0%	6.5%	3.9%	5.7%	5.2%	4.5%	7.6%	6.3%	7.2%	10.0%	9.6%	5.3%	12.1%	15.2%	16.2%	14.0%	19.2%	25.1%	18.2%	12.8%	26.6%	27.1%
Transmission Enhancement Cost Recovery	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.1%	0.5%	0.6%	0.9%	1.6%	1.8%	1.1%	2.8%	3.6%	3.7%	3.1%	3.7%	4.8%	3.5%	2.3%	4.4%
Transmission Owner (Schedule 1A)	0.2%	0.2%	0.1%	0.2%	0.1%	0.2%	0.1%	0.2%	0.1%	0.2%	0.1%	0.2%	0.1%	0.2%	0.1%	0.2%	0.1%	0.2%	0.1%	0.2%	0.1%	0.2%	0.1%	0.2%
Transmission Scams Elimination Cost Assignment (SCCA)	0.0%	0.0%	0.0%	0.1%	0.7%	0.1%	0.0%	0.0%	0.0%	0.0%	[0.0%]	0.0%	0.0%	0.0%	0.0%	0.0%	[0.0%]	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Transmission Facility Charges	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	[0.0%]	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Ancillary	1.5%	1.5%	1.8%	1.8%	1.7%	1.6%	1.5%	1.4%	1.5%	1.4%	1.4%	1.7%	2.3%	0.9%	1.6%	1.4%	1.4%	1.3%	1.4%	1.6%	1.3%	1.1%	1.7%	1.7%
Reactive	0.4%	0.5%	0.5%	0.5%	0.4%	0.5%	0.4%	0.4%	0.7%	0.7%	0.7%	0.9%	1.4%	0.4%	0.6%	0.7%	0.8%	0.6%	0.8%	1.0%	0.7%	0.5%	1.0%	0.9%
Regulation	1.1%	1.0%	1.0%	1.1%	1.2%	0.9%	0.9%	0.9%	0.6%	0.6%	0.5%	0.5%	0.5%	0.3%	0.4%	0.2%	0.3%	0.3%	0.2%	0.2%	0.1%	0.4%	0.3%	0.4%
Black Start	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.1%	0.3%	0.1%	0.1%	0.2%	0.2%	0.1%	0.2%	0.1%	0.1%	0.1%	0.2%	0.2%
Synchronized Reserves	0.0%	0.0%	0.0%	0.2%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.2%	0.2%	0.2%
Secondary Reserves	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	[0.0%]	[0.0%]	0.0%	0.0%
Non-Synchronized Reserves	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	[0.0%]	0.0%	0.0%
Day Ahead Scheduling Reserve (DASR)	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.1%	0.1%	0.1%	0.0%	0.2%	0.1%	0.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Administration	1.5%	2.1%	2.1%	2.1%	1.1%	1.4%	1.2%	0.6%	0.7%	0.7%	0.6%	1.0%	0.8%	0.4%	0.8%	0.9%	1.0%	1.0%	1.2%	1.2%	0.8%	0.5%	1.2%	1.2%
PHM Administrative fees	1.5%	2.0%	2.1%	1.8%	1.0%	1.3%	1.1%	0.5%	0.6%	0.6%	0.6%	0.9%	0.7%	0.4%	0.7%	0.9%	0.9%	1.1%	1.1%	0.8%	0.5%	1.1%	1.1%	1.1%
NEURHC	0.0%	0.0%	0.1%	0.1%	0.1%	0.1%	0.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%	0.1%
RIO Start-up and Expansion	0.0%	0.0%	0.1%	0.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Other	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Total Price	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%



## Section Overviews

### Overview: Section 3, Energy Market

#### Supply and Demand

##### Market Structure

- **Supply.** In 2024, 3,206 MW of new resources were added in the energy market, and 527 MW of resources were retired.
- The real-time hourly on peak average offered supply in 2024 increased by 2.8 percent, from 2023, from 137,865 MWh to 141,742 MWh.
- The day-ahead hourly average offered supply in 2024 decreased by 0.2 percent, from 2023, from 149,346 MWh to 149,120 MWh.
- The real-time hourly average cleared generation in 2024 increased by 2.5 percent from 2023, from 92,457 MWh to 94,814 MWh.
- The day-ahead hourly average cleared supply in 2024, including INCs and UTCs, decreased by 5.3 percent from 2023 from 116,042 MWh to 109,932 MWh.
- **Demand.** The real-time hourly peak load plus exports in 2024 was 154,045 MWh (148,218 MWh of load plus 5,827 MWh of gross exports) in the HE 1700 (EPT) on July 15, 2024, which was 0.8 percent, 1,248 MWh, higher than the PJM peak load plus exports in 2023, which was 152,797 MWh in the HE 1800 (EPT) on July 27, 2023.
- The real-time hourly peak load without exports in 2024 was 148,890 MWh in the HE 1800 (EPT) on July 16, 2024, higher than the PJM peak load in 2023, which was 144,215 MWh in the HE 1800 (EPT) on July 27, 2023.
- The real-time hourly average load in 2024 increased by 3.6 percent from 2023, from 86,193 MWh to 89,274 MWh.
- The day-ahead hourly average cleared demand in 2024, including DECs and UTCs, decreased by 6.5 percent from 2023, from 113,807 MWh to 106,355 MWh.

##### Market Behavior

- **Virtual Offers and Bids.** Any market participant in the PJM Day-Ahead Energy Market can use increment offers, decrement bids, up to congestion

transactions, import transactions and export transactions as financial instruments that do not require physical generation or load. The hourly average submitted increment offer MW increased by 21.0 percent and the cleared increment MW increased by 12.8 percent in 2024 compared to 2023. The hourly average submitted decrement bid MW increased by 25.2 percent and the cleared decrement MW increased by 11.5 percent in 2024 compared to 2023. The hourly average submitted up to congestion bid MW decreased by 54.9 percent and the cleared up to congestion bid MW decreased by 46.0 percent in 2024 compared to 2023.

##### Market Performance

- **Generation Fuel Mix.** In 2024, generation from coal units increased 1.4 percent, generation from natural gas units increased 3.5 percent, generation from oil units increased 53.1 percent, generation from wind units increased 8.5 percent, and generation from solar units increased 58.1 percent compared to 2023.
- **Fuel Diversity.** The fuel diversity of energy generation in 2024, measured by the fuel diversity index for energy (FDI<sub>e</sub>), increased 0.8 percent compared to 2023.
- **Marginal Resources.** In the PJM Real-Time Energy Market in 2024, coal units were 13.5 percent and natural gas units were 73.7 percent of marginal resources. In 2023, coal units were 5.5 percent and natural gas units were 83.1 percent of marginal resources.
- **Prices.** The real-time load-weighted average LMP in 2024 increased \$2.66 per MWh, or 8.5 percent from 2023, from \$31.08 per MWh to \$33.74 per MWh.
- The day-ahead load-weighted average LMP for 2024 increased \$1.86 or 5.8 percent from 2023, from \$31.93 per MWh to \$33.79 per MWh.
- **Fast Start Pricing.** The real-time load-weighted average PLMP was \$33.74 per MWh in 2024, which is 7.7 percent, \$2.43 per MWh, higher than the real-time load-weighted average DLMP of \$31.31 per MWh.
- The day-ahead load-weighted average PLMP was \$33.79 per MWh in 2024, which is 0.2 percent, \$0.07 per MWh, higher than the day-ahead load-weighted average DLMP of \$33.72 per MWh.

- **Components of Real-Time LMP.** In the PJM Real-Time Energy Market in 2024, 12.1 percent of the real-time load-weighted LMP was the result of coal costs, 39.7 percent was the result of gas costs, 6.0 percent was the result of the cost of emission allowances, 8.9 percent was the result of transmission constraint violation penalty factors, and 1.7 percent was the result of the use of fast start pricing.
- **Changes in Real-Time LMP.** Of the \$2.66 per MWh increase in the real-time load-weighted average LMP, \$0.50 per MWh (18.9 percent) was the fuel and consumables cost components of LMP, -\$0.05 per MWh (-1.9 percent) was the emissions cost components of LMP, 0.16 per MWh (6.2 percent) was the sum of the markup, maintenance, and ten percent adder components of LMP, \$1.39 per MWh (52.4 percent) was the transmission constraint penalty factor component of LMP, and \$0.10 per MWh (3.7 percent) was the scarcity component of LMP.
- **Price Convergence.** Hourly and daily price differences between the day-ahead and real-time energy markets fluctuate continuously and substantially from positive to negative. The average difference between day-ahead and real-time average prices was -\$0.09 per MWh in 2024, and -\$0.69 per MWh in 2023. The difference between day-ahead and real-time average prices, by itself, is not a measure of the competitiveness or effectiveness of the day-ahead energy market.

### Scarcity

- **Shortage Intervals.** There were 39 intervals with five minute shortage pricing on 17 days in 2024. These shortages did not correspond with any emergency warning or action. Four of the 39 intervals of shortage did correspond with two synchronized reserve events. Nine of the 39 intervals of shortage did correspond with cold weather alerts. One of the 39 intervals of shortage did correspond with a hot weather alert.
- **SCED Shortage Intervals.** There were 6,811 five minute intervals, or 6.5 percent of all five minute intervals, in 2024 for which at least one RT SCED solution showed a shortage of reserves, and 1,905 five minute intervals, or 1.8 percent of all five minute intervals, in 2024 for which more than one RT SCED solution showed a shortage of reserves.

PJM triggered shortage pricing for 39 five minute intervals, or 0.6 percent of all five minute intervals.

## Competitive Assessment

### Market Structure

- **Aggregate Pivotal Suppliers.** The PJM energy market, at times, requires generation from pivotal suppliers to meet load, resulting in aggregate market power even when the HHI level indicates that the aggregate market is unconcentrated. Three suppliers were jointly pivotal in the day-ahead market on 181 days, 49.5 percent of the days, in 2024 and 179 days, 49.0 percent of the days, in 2023.
- **Local Market Power.** In 2024, in the real-time market, the 500 kV system, nine zones, and the PJM/MISO interface experienced congestion resulting from one or more constraints binding for 100 or more hours. For seven out of the top 10 congested facilities (by real-time binding hours) in 2024, the average number of suppliers providing constraint relief was three or fewer. There was a high level of concentration within the local markets for providing relief to the most congested facilities in the PJM Real-Time Energy Market. The local market structure was not competitive.

### Market Behavior

- **Offer Capping for Local Market Power.** PJM offer caps units when the local market structure is noncompetitive. Offer capping is an effective means of addressing local market power when the rules are designed and implemented properly. Offer capping levels have historically been low in PJM. In the day-ahead energy market, for units committed to provide energy for local constraint relief, offer-capped unit hours decreased from 1.7 percent in 2023 to 1.2 percent in 2024. In the real-time energy market, for units committed to provide energy for local constraint relief, offer-capped unit hours increased from 1.3 percent in 2023 to 1.5 percent in 2024. While overall offer capping levels have been low, there are a significant number of units with persistent structural local market power that would have had a significant impact on prices in the absence of local market power mitigation.

The analysis of the application of the TPS test to local markets demonstrates that it is working to

identify pivotal owners when the market structure is noncompetitive and to ensure that owners are not subject to offer capping when the market structure is competitive. There are, however, identified issues with the application of market power mitigation to resources whose owners fail the TPS test that can result in the exercise of local market power. These issues need to be addressed.

- **Offer Capping for Reliability.** PJM also offer caps units that are committed for reliability reasons, including for reactive support. In the day-ahead energy market, for units committed for reliability reasons, offer-capped unit hours increased from 0.13 percent 2023 to 0.21 percent in 2024. In the real-time energy market, for units committed for reliability reasons, offer-capped unit hours decreased from 0.14 percent in 2023 to 0.08 percent in 2024. The low offer cap percentages for reliability commitments, relative to offer capping for transmission constraints, do not mean that units committed for reliability reasons do not have market power. All units manually committed for reliability have market power and all are treated as if they have market power.
- **Parameter Mitigation.** In 2024, 27.7 percent of unit hours for units that failed the TPS test in the day-ahead market were committed on price-based schedules that were less flexible than their cost-based schedules. On days when cold weather alerts and hot weather alerts were declared, 34.4 percent of unit hours in the day-ahead energy market were committed on price-based schedules that were less flexible than their price PLS schedules.
- **Frequently Mitigated Units (FMU) and Associated Units (AU).** In 2024, no units qualified for an FMU adder. In 2023 and 2022, no units qualified for an FMU adder. In 2021, one unit qualified for an FMU adder.
- **Markup Index.** The markup index is a summary measure of participant offer behavior for individual marginal units. While the average markup index in the real-time market was -0.01 when using unadjusted cost-based offers in 2024, some marginal units did have substantial markups. The highest markup for any marginal unit in the real-time market in 2024 was more than \$900 per MWh, using unadjusted cost-based offers.

While the average markup index in the day-ahead market was \$0.08 per MWh in 2024, some marginal units did have substantial markups. The highest markup for any marginal unit in the day-ahead market in 2024 was more than \$200 per MWh and the highest markup in 2023 was more than \$250 per MWh.

- **Markup.** The markup frequency distributions show that a significant proportion of units make price-based offers less than the cost-based offers permitted under the PJM market rules. This behavior means that competitive price-based offers reveal actual unit marginal costs and that PJM market rules permit the inclusion of costs in cost-based offers that are not short run marginal costs.

The markup frequency distributions also show that a significant proportion of units were offered with high markups, consistent with the exercise of market power.

## Market Performance

- **Markup.** The markup conduct of individual owners and units has an identifiable impact on market prices. Markup is a key indicator of the competitiveness of the energy market.

In the PJM Real-Time Energy Market in 2024, the unadjusted markup component (net of positive and negative markup components) of LMP was -\$0.01 per MWh or -0.1 percent of the PJM load-weighted average LMP. July had the highest unadjusted peak markup component, \$6.10 per MWh, or 10.0 percent of the real-time peak hour load-weighted average LMP for July.

Participant behavior was evaluated as competitive because the analysis of markup shows that marginal units generally make offers at, or close to, their marginal costs in both the day-ahead and real-time energy markets, although the behavior of some participants represents economic withholding.

- **Markup and Local Market Power.** Comparison of the markup behavior of marginal units with TPS test results shows that for 3.4 percent of all real-time marginal unit intervals in 2024, the marginal unit had both local market power as determined by the TPS test and a positive markup. The fact that units with market power had a positive markup means that the cost-based offer was not used, that a higher

price-based offer was used, and that the process for offer capping units that fail the TPS test does not consistently result in competitive market outcomes in the presence of market power.

- **Markup and Aggregate Market Power.** In 2024, pivotal suppliers in the aggregate market, committed in the day-ahead market and identified as one of three day-ahead aggregate pivotal suppliers, set real-time market prices with markups over \$100 per MWh on 88 days. Some of the marginal units had local market power, but were not offer capped due to issues with the method that PJM uses to select offer schedules for units that fail the TPS test. Some of the marginal units had aggregate market power, for which there is no offer capping, and some had both local and aggregate market power.

## Section 3 Recommendations

### Market Power

- The MMU recommends that the market rules explicitly require that offers in the energy market be competitive, where competitive is defined to be the short run marginal cost of the units. The short run marginal cost should reflect opportunity cost when appropriate. The MMU recommends that the level of incremental costs includable in cost-based offers per the PJM Operating Agreement not exceed the short run marginal cost of the unit. (Priority: Medium. First reported 2009. Status: Not adopted.)

### Fuel Cost Policies

- The MMU recommends that PJM require that all fuel cost policies be algorithmic, verifiable, and systematic, and accurately reflect short run marginal costs. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends that the temporary cost method be removed and that all units that submit nonzero cost-based offers be required to have an approved fuel cost policy. (Priority: Low. First reported 2020. Status: Not adopted.)
- The MMU recommends that the penalty exemption provision be removed and that all units that submit nonzero cost-based offers be required to follow their approved fuel cost policy. (Priority: Medium. First reported 2020. Status: Not adopted.)

### Cost-Based Offers

- The MMU recommends that Manual 15 (Cost Development Guidelines) be replaced or updated with a straightforward description of the components of cost-based offers and the mathematically correct calculation of cost-based offers for thermal resources. (Priority: Medium. First reported 2016. Status: Adopted 2023.)
- The MMU recommends removal of all use of FERC System of Accounts in the Cost Development Guidelines. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends the removal of all use of cyclic starting and peaking factors from the Cost Development Guidelines. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends the removal of all labor costs from the Cost Development Guidelines. (Priority: Medium. First reported 2016. Status: Adopted 2022.)
- The MMU recommends the removal of all maintenance costs from the Cost Development Guidelines. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that market participants be required to document the amount and cost of consumables used when operating in order to verify that the total operating cost is consistent with the total quantity used and the unit characteristics. (Priority: Medium. First reported 2020. Status: Adopted 2023.)
- The MMU recommends, given that maintenance costs are currently allowed in cost-based offers, that market participants be permitted to include only variable maintenance costs, linked to verifiable operational events and that can be supported by clear and unambiguous documentation of the operational data (e.g. run hours, MWh, MMBtu) that support the maintenance cycle of the equipment being serviced/replaced. (Priority: Medium. First reported 2020. Status: Partially adopted 2023.)
- The MMU recommends explicitly accounting for soak costs and changing the definition of the start heat input for combined cycles to include only the amount of fuel used from first fire to the first breaker close in the Cost Development Guidelines.



(Priority: Medium. First reported 2016. Status: Partially adopted.)

- The MMU recommends that soak costs, soak time and the MWh produced during soaking be modeled separately. This will ensure that the time required for units to reach a dispatchable level is known and used in the unit commitment process instead of only being communicated verbally between dispatchers and generators. Separating soak costs from start costs and modeling the MWh produced during soaking allows for a better representation of the costs because it eliminates the need to simply assume the price paid for those MWh. (Priority: Medium. First reported 2022. Status: Not adopted.)
- The MMU recommends the removal of nuclear fuel and nonfuel operations and maintenance costs that are not short run marginal costs from the Cost Development Guidelines. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends revising the pumped hydro fuel cost calculation to include day-ahead and real-time power purchases. (Priority: Low. First reported 2016. Status: Not adopted.)

### Market Power: TPS Test and Offer Capping

- The MMU recommends that the rules governing the application of the TPS test be clarified and documented. The TPS test application in the day-ahead energy market is not documented. (Priority: High. First reported 2015. Status: Partially adopted.)<sup>65</sup>
- The MMU recommends that PJM modify the process of applying the TPS test in the day-ahead energy market to ensure that all local markets created by binding constraints are tested for market power and to ensure that market sellers with market power are appropriately mitigated to their competitive offers. (Priority: High. First reported 2022. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation when the TPS test is failed, that offer capping be applied to units that fail the TPS test in the real-time market that were not offer capped at the time of commitment in the day-ahead market or at a prior time in the real-time market.

(Priority: High. First reported 2020. Status: Not adopted.)

- The MMU recommends, in order to ensure effective market power mitigation and to ensure that capacity resources meet their obligations to be flexible, that capacity resources be required to use flexible parameters in all offers at all times. (Priority: High. First reported 2021. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation, PJM always use cost-based offers for units that fail the TPS test, and always use flexible parameters for all cost-based and all price-based offers during high load conditions such as cold and hot weather alerts and emergency conditions. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM require every market participant to make available at least one cost schedule based on the same hourly fuel type(s) and parameters at least as flexible as their offered price schedule. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation when the TPS test is failed, that markup be consistently positive or negative across the full MWh range of price and cost-based offers. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation, that PJM commit all resources that fail the TPS test on their cost-based offers, that the Market Seller designate the cost-based offer if there is more than one, and that PJM implement this solution as soon as possible. (Priority: High. First reported Q3 2024. Status: Not adopted.)
- The MMU recommends that PJM retain the \$1,000 per MWh offer cap in the PJM energy market except when cost-based offers exceed \$1,000 per MWh, and retain other existing rules that limit incentives to exercise market power. (Priority: High. First reported 1999. Status: Partially adopted, 1999, 2017.)
- The MMU recommends the elimination of FMU and AU adders. FMU and AU adders no longer serve the purpose for which they were created and interfere

<sup>65</sup> The real-time market formula for determining the lowest cost schedule is documented. The day-ahead market formula for determining the lowest cost schedule is not documented.

with the efficient operation of PJM markets. (Priority: Medium. First reported 2012. Status: Partially adopted, 2014.)<sup>66</sup>

### Offer Behavior

- The MMU recommends that resources not be allowed to violate the ICAP must offer requirement. The MMU recommends that PJM enforce the ICAP must offer requirement by assigning a forced outage to any unit that is derated in the energy market below its committed ICAP without an outage that reflects the derate. (Priority: Medium. First reported 2020. Status: Not adopted.)
- The MMU recommends that intermittent resources be subject to an enforceable ICAP must offer rule in the day-ahead and real-time energy markets that reflects the limitations of these resources. (Priority: Medium. First reported 2020. Status: Adopted 2023.)
- The MMU recommends that storage resources be subject to an enforceable ICAP must offer rule in the day-ahead and real-time energy markets that reflects the limitations of these resources. (Priority: Medium. First reported 2020. Status: Not adopted.)
- The MMU recommends that capacity resources not be allowed to offer any portion of their capacity market obligation as maximum emergency energy. (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM integrate all the outage reporting tools in order to enforce the ICAP must offer requirement, ensure that outages are reported correctly and eliminate reporting inconsistencies. Generators currently submit availability in three different tools that are not integrated, Markets Gateway, eDART and eGADS. (Priority: Medium. First reported 2022. Status: Not adopted.)
- The MMU recommends that gas generators be required to check with pipelines throughout the operating day to confirm that nominations are accepted beyond the NAESB deadlines, that gas generators be required to inform PJM about whether they have gas, and that gas generators be required to place their units on forced outage until the time that pipelines allow nominations to consume gas

at a unit. (Priority: Medium. First reported 2022. Status: Not adopted.)

### Capacity Resources

- The MMU recommends that capacity resources be held to the OEM operating parameters of the capacity market CONE reference resource for performance assessment and energy uplift payments and that this standard be applied to all technologies on a uniform basis. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that the parameters which determine nonperformance charges and the amounts of uplift payments should reflect the flexibility goals of the capacity market design. The operational parameters used by generation owners to indicate to PJM operators what a unit is capable of during the operating day should not determine capacity resource performance assessment or uplift payments. (Priority: Medium. First reported 2015. Status: Partially adopted.)<sup>67</sup>
- The MMU recommends that PJM clearly define the business rules that apply to the unit specific parameter adjustment process, including PJM's implementation of the tariff rules in the PJM manuals to ensure market sellers know the requirements for their resources. (Priority: Low. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM update the tariff to clarify that all generation resources are subject to unit specific parameter limits on their cost-based offers using the same standard and process as capacity resources. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that resources not be paid the daily capacity payment when unable to operate to their unit specific parameter limits. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM not approve temporary exceptions that are based on pipeline tariff terms that are not enforced at the time, or are based on inferior transportation service procured by the generator. (Priority: Medium. First reported 2019. Status: Not adopted.)

<sup>66</sup> The applicability of the FMU and AU adders is limited by the rule implemented in 2014 requiring that net revenues must fall below avoidable costs, but the possibility of FMU and AU adders is still part of the PJM Market Rules.

<sup>67</sup> Flexible parameter standards are in place for combined cycle and combustion turbine resources when operating on a parameter limited schedule, but not for other schedules or generating technologies.

- The MMU recommends that PJM require generators that violate their approved turn down ratio (by either using the fixed gen option or increasing their economic minimum) to use the temporary parameter exception process that requires market sellers to demonstrate that the request is based on a physical and actual constraint. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends: that gas generators be required to confirm, regularly during the operating day, that they can obtain gas if requested to operate at their economic maximum level; that gas generators provide that information to PJM during the operating day; and that gas generators be required to be on forced outage if they cannot obtain gas during the operating day to meet their must offer requirement as a result of pipeline restrictions, and they do not have backup fuel. As part of this, the MMU recommends that PJM collect data on each individual generator's fuel supply arrangements at least annually or when such arrangements change, and analyze the associated locational and regional risks to reliability. (Priority: Medium. First reported 2022. Status: Not adopted.)
- The MMU recommends, if the capacity market seller offer cap were to be calculated using the historical average balancing ratio, that PJM not include the balancing ratios calculated for localized Performance Assessment Intervals (PAIs), and only include those events that trigger emergencies at a defined zonal or higher level. (Priority: Medium. First reported 2018. Status: Adopted, 2023.<sup>68</sup>)

### Accurate System Modeling

- The MMU recommends that PJM explicitly state its policy on the use of transmission penalty factors including: the level of the penalty factors; the triggers for the use of the penalty factors; the appropriate line ratings to trigger the use of penalty factors; the allowed duration of the violation and when the transmission penalty factors will be used to set the shadow price. The MMU recommends that PJM end the practice of manual and automated discretionary reductions in the control limits on transmission constraint line ratings used in the market clearing software (SCED) and included in

LMP. (Priority: Medium. First reported 2015. Status: Partially adopted 2020.)<sup>69</sup>

- The MMU recommends that PJM routinely review all transmission facility ratings and any changes to those ratings to ensure that the normal, emergency and load dump ratings used in modeling the transmission system are accurate and reflect standard ratings practice. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM not use closed loop interface or surrogate constraints to artificially override nodal prices based on fundamental LMP logic in order to: accommodate rather than resolve the inadequacies of the demand side resource capacity product; address the inability of the power flow model to incorporate the need for reactive power; accommodate rather than resolve the flaws in PJM's approach to scarcity pricing; or for any other reason. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM update the outage impact studies, the reliability analyses used in RPM for capacity deliverability, and the reliability analyses used in RTEP for transmission upgrades to be consistent with the more conservative emergency operations (post contingency load dump limit exceedance analysis) in the energy market that were implemented in June 2013.<sup>70</sup> (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM include in the tariff or appropriate manual an explanation of the initial creation of hubs, the process for modifying hub definitions and a description of how hub definitions have changed.<sup>71 72</sup> (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that all buses with a net withdrawal be treated as load for purposes of calculating load and load-weighted LMP, even if the MW are settled to the generator. The MMU recommends that during hours when a load bus

<sup>69</sup> PJM created a more transparent process for transmission constraint penalty factors and added it to the tariff in 2020. Policies on reductions in control limits and the duration of violations remain discretionary and undocumented in the PJM Market Rules.

<sup>70</sup> This recommendation was the result of load shed events in September, 2013. For detailed discussion, please see *2013 Annual State of the Market Report for PJM*, Volume 2, Section 3 at 114 – 116.

<sup>71</sup> According to minutes from the first meeting of the Energy Market Committee (EMC) on January 28, 1998, the EMC unanimously agreed to be responsible for approving additions, deletions and changes to the hub definitions to be published and modeled by PJM. Since the EMC has become the Market Implementation Committee (MIC), the MIC now appears to be responsible for such changes.

<sup>72</sup> There is currently no PJM documentation in the tariff or manuals explaining how hubs are created and how their definitions are changed. The general definition of a hub can be found in the PJM. com Glossary <<http://www.pjm.com/Glossary.aspx>>.

<sup>68</sup> See 184 FERC ¶ 61,058 (2023).



shows a net injection, the energy injection be treated as generation, not negative load, for purposes of calculating generation and load-weighted LMP, even if the injection MW are settled to the load serving entity. (Priority: Low. First reported 2013. Status: Not adopted.)

- The MMU recommends that PJM identify and collect data on available behind the meter generation resources, including nodal location information and relevant operating parameters. (Priority: Low. First reported 2013. Status: Partially adopted.)
- The MMU recommends that PJM document how LMPs are calculated when demand response is marginal. (Priority: Low. First reported 2014. Status: Not adopted.)
- The MMU recommends that PJM not allow nuclear generators which do not respond to prices or which only respond to manual instructions from the operator to set the LMPs in the real-time market. (Priority: Low. First reported 2016. Status: Not adopted.)
- The MMU recommends that PJM increase the coordination of outage and operational restrictions data submitted by market participants via eDART/eGADs and offer data submitted via Markets Gateway. (Priority: Low. First reported 2017. Status: Not adopted.)
- The MMU recommends that PJM model generators' operating transitions, including soak time for units with a steam turbine, configuration transitions for combined cycles, and peak operating modes. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that PJM clarify, modify and document its process for dispatching reserves and energy when SCED indicates that supply is less than total demand including forecasted load and reserve requirements. The modifications should define: a SCED process to economically convert reserves to energy; a process for the recall of energy from capacity resources; and the minimum level of synchronized reserves that would trigger load shedding. (Priority: Medium. First reported 2020. Status: Not adopted.)
- The MMU recommends that PJM stop capping the system marginal price in RT SCED and LPC and

instead limit the sum of violated reserve constraint shadow prices that are included in the determination of LMP in LPC to \$1,700 per MWh. While PJM no longer caps prices in RT SCED, PJM continues to apply a cap to the system marginal price in the pricing run (LPC) under fast start pricing. (Priority: Medium. First reported 2021. Status: Not adopted.)

- The MMU recommends that PJM adjust the ORDCs during spin events to reduce the reserve requirement for synchronized and primary reserves by the amount of the reserves deployed. (Priority: Medium. First reported 2021. Status: Not adopted.)

## Transparency

- The MMU recommends that PJM clearly document the calculation of shortage prices and implementation of reserve price caps in the PJM manuals, including defining all the components of reserve prices, and all the constraints whose shadow prices are included in reserve prices. (Priority: High. First reported 2021. Status: Not adopted.)
- The MMU recommends that PJM allow generators to report fuel type on an hourly basis in their offer schedules and to designate schedule availability on an hourly basis. (Priority: Medium. First reported 2015. Status: Partially adopted.)<sup>73</sup>
- The MMU recommends that PJM define clear criteria for operator approval of RT SCED cases, including shortage cases, that are used to send dispatch signals to resources, and for pricing, to minimize discretion. (Priority: High. First reported 2018. Status: Partially adopted.)<sup>74</sup>

## Virtual Bids and Offers

- The MMU recommends eliminating up to congestion (UTC) bidding at pricing nodes that aggregate only small sections of transmission zones with few physical assets. (Priority: Medium. First reported 2020. Status: Not adopted.)
- The MMU recommends eliminating INC, DEC, and UTC bidding at pricing nodes that allow market participants to profit from modeling issues. (Priority: Medium. First reported 2020. Status: Not adopted.)

<sup>73</sup> Fuel type is reported by offer schedule, but it can be inaccurate on an hourly basis.

<sup>74</sup> The PJM Market Rules clarify that shortage case approval will be based on RT SCED, but does not address RT SCED case choice or load bias.

### Section 3 Conclusion

The MMU analyzed key elements of PJM energy market structure, participant conduct and market performance in 2024, including aggregate supply and demand, concentration ratios, aggregate pivotal supplier results, local three pivotal supplier test results, offer capping, markup, marginal units, participation in demand response programs, virtual bids and offers, loads and prices.

Prices are a key outcome of markets. Prices vary across hours, days and years for multiple reasons. Price is an indicator of the level of competition in a market. In a competitive market, prices are directly related to input prices, the marginal cost to serve load. In 2024, LMP increased by \$2.66 per MWh compared to 2023. The fuel cost components of LMP (the sum of gas, coal, oil, landfill gas, and consumables) increased \$0.50 per MWh, 18.9 percent of the increase in LMP. The emissions cost components of LMP, including opportunity costs for emissions limited resources, decreased by \$0.05 per MWh, -1.9 percent of the increase in LMP. The transmission constraint penalty factor component increased by \$1.39 per MWh, 52.4 percent of the increase in LMP, primarily as a result of PJM actions to reduce the line limits applied in SCED.

The pattern of prices within days and across months and years illustrates how prices are directly related to supply and demand conditions and illustrates the potential significance of the impact of the price elasticity of demand on prices. Energy market results in 2024 generally reflected supply-demand fundamentals, although the behavior of some participants both routinely and during high demand periods represents economic withholding. Economic withholding occurs when generator offers are greater than competitive levels. In 2024, the sum of the markup, ten percent adder, and maintenance cost (not short run marginal cost) components increased by \$0.16 per MWh or 6.2 percent of the increase in LMP.

The potential for prolonged and excessively high administrative pricing in the energy market due to reserve penalty factors and transmission constraint penalty factors remains an issue that needs to be addressed.<sup>75</sup> There also continue to be significant issues with PJM's scarcity pricing rules, including the absence of a clear trigger based on accurately estimated reserve levels. For

example, PJM approved 2.5 percent of solved shortage cases in January 2024, but only 0.6 percent for the year. Six other months had a higher percent of shortage cases solved, but fewer approved. The pattern of shortage case approvals indicates that PJM considers factors that are not documented in the tariff when deciding whether to approve shortage cases. As directed by FERC Order 825, PJM should approve shortage cases based on the market software results alone.<sup>76</sup>

With or without a capacity market, energy market design must permit scarcity pricing when such pricing is consistent with market conditions and constrained by reasonable rules to ensure that market power is not exercised and to ensure no scarcity pricing when such pricing is not consistent with market conditions. Scarcity pricing for revenue adequacy, as in PJM's 2019 ORDC proposal that would have created administrative scarcity pricing, is not consistent with a competitive market design. Scarcity pricing for price signals that reflect market conditions during periods of scarcity is consistent with a competitive market design. Scarcity pricing is part of an appropriate incentive structure facing both load and generation owners in a working wholesale electric power market design. Scarcity pricing must be designed to ensure that market prices reflect actual market conditions, that scarcity pricing occurs with transparent triggers based on measured reserve levels and transparent prices, that scarcity pricing only occurs when scarcity exists, that scarcity pricing not be excessive or punitive, and that there are strong incentives for competitive behavior and strong disincentives to exercise market power. Such administrative scarcity pricing is a key link between energy and capacity markets.

PJM defined inputs to the dispatch tools, particularly RT SCED, have substantial effects on energy market outcomes. Transmission line ratings, transmission penalty factors, load forecast bias, and hydro resource schedules change the dispatch of the system, affect prices, and can create significant price increases, particularly through transmission constraint penalty factors. PJM operator interventions to reduce the control limits on transmission constraint line ratings in RT SCED unnecessarily trigger transmission constraint penalty factors and significantly increase prices. Violations of the artificially reduced control limits on constraint line ratings were the largest single component of the

<sup>75</sup> 177 FERC ¶ 61,209 (2021).

<sup>76</sup> 155 FERC ¶ 61,276 (2016).

increase in LMP in 2024. In 2024, the control limit used in RT SCED for 94 percent of violated transmission constraint intervals was less than 100 percent, with an average reduction of 5.1 percent. If the control limits had not been artificially reduced for PJM transmission constraints and everything else remained unchanged, the transmission penalty factor's contribution to the load-weighted average LMP in 2024 would have decreased by 99.4 percent from \$3.01 to \$0.02 per MWh. PJM should evaluate its interventions in the market, including the unnecessary imposition of transmission constraint penalty factors, reconsider whether the interventions are appropriate, and provide greater transparency to enhance market efficiency.

Fast start pricing, implemented on September 1, 2021, has disconnected pricing from dispatch instructions and despite the stated goal of reducing overall uplift, created a greater reliance on uplift rather than price as an incentive to follow PJM's instructions. The objective of efficient short run price signals is to minimize system production costs, not to minimize uplift. Repricing the market to reflect commitment costs using fast start pricing prioritizes minimizing uplift over minimizing production costs.<sup>77</sup> The tradeoff exists because when commitment costs are included in prices, the price signal no longer equals the short run marginal cost and therefore no longer provides the correct signal for efficient behavior for market participants making decisions on the margin, whether resources, load, interchange transactions, or virtual traders. Units that start in one hour are not actually fast start units, and their commitment costs are not marginal in a five minute market. The differences between the actual LMP and the fast start LMP distort the incentive for market participants to behave competitively and to follow PJM's dispatch instructions. PJM is paying new forms of uplift in an attempt to counter the distorted incentives inherent in fast start pricing. PJM is also using the pricing run to implement administrative pricing rules that are not related to fast start pricing. Specifically, PJM uses lower transmission constraint penalty factors in the day-ahead pricing run than in the dispatch run and implements system marginal price capping in the pricing run. Every difference between the dispatch run and the pricing run introduces another inefficiency in the market. In the three years since fast start pricing was introduced, the market has not responded with new

entry of fast start units despite consistently higher LMPs when a fast start unit sets price.

PJM's arguments for changing energy market price formation asserted that fast start pricing and PJM's rejected extended ORDC would price flexibility in the market, but instead they benefit inflexible units. The fast start pricing and extended ORDC solutions undercut LMP logic rather than directly addressing the underlying issues. The solution is not to accept that the inflexible CT should be paid or set price based on its commitment costs rather than its short run marginal costs. The question of why units make inflexible offers should be addressed directly. Are units inflexible because they are old and inefficient, because owners have not invested in increased flexibility or because they serve as a mechanism for the exercise of market power? Are units inflexible because the PJM software does not model combined cycle transitions? The question of how to provide market incentives for investment in flexible units, for investment in increased flexibility of existing units, and for operating at the full extent of existing flexibility should be addressed directly. The question of whether inflexible units should be paid uplift at all should be addressed directly. Marginal cost pricing without paying excess uplift to inflexible units would create incentives for market participants to provide flexible solutions including replacing inefficient units with flexible, efficient units.

The relationship between supply and demand, regardless of the specific market, along with market concentration and the extent of pivotal suppliers, is referred to as the supply-demand fundamentals, or economic fundamentals, or market structure. The market structure of the PJM aggregate energy market is partially competitive because aggregate market power does exist for a significant number of hours. The HHI is not a definitive measure of structural market power. The number of pivotal suppliers in the energy market is a more precise measure of structural market power than the HHI. It is possible to have pivotal suppliers in the aggregate market even when the HHI level is not in the highly concentrated range. Even a low HHI may be consistent with the exercise of market power with a low price elasticity of demand. The current market power mitigation rules for the PJM energy market rely on the assumption that the ownership structure of the aggregate market ensures competitive outcomes. This assumption

<sup>77</sup> See 173 FERC ¶ 61,244 (2020).

requires that the total demand for energy can be met without the supply from any individual supplier or without the supply from a small group of suppliers. This assumption is not correct. There are pivotal suppliers in the aggregate energy market at times. High markups for some units demonstrate the potential to exercise market power both routinely and during high demand conditions. The existing market power mitigation measures do not address aggregate market power. The MMU is developing an aggregate market power test and will propose market power mitigation rules to address aggregate market power.

The three pivotal supplier test is applied by PJM on an ongoing basis for local energy markets in order to determine whether offer capping is required for transmission constraints.<sup>78</sup> However, there are issues with the application of market power mitigation in the day-ahead energy market and the real-time energy market when market sellers fail the TPS test. The Commission recognized some of these issues in its order issued on June 17, 2021, but failed to address them in its November 30, 2023 order.<sup>79</sup> <sup>80</sup> PJM continued to ignore the evidence cited by the Commission and denies the prevalence of these issues, instead of ensuring that market power mitigation works as intended and results in efficient market outcomes.<sup>81</sup> Many of these issues can be resolved by simple rule changes. The MMU proposed these rule changes in its response submitted on October 15, 2021, and in the stakeholder process.<sup>82</sup> <sup>83</sup> The MMU recommendations would shorten the solution time of the day-ahead market software, which would help facilitate enhanced combined cycle modelling. The proposal that PJM filed with FERC on March 1, 2024, would have weakened market power mitigation

as part of implementing the enhanced combined cycle modelling project, although PJM failed to explain why such weakening makes sense. PJM's proposal would have ensured that the identified issues with the implementation of market power mitigation in the energy market would never have been addressed and would have been exacerbated. On April 30, 2024, FERC rejected PJM's proposal because "PJM's proposal would create the ability for Market Sellers to exercise market power, which the Commission has found unjust and unreasonable."<sup>84</sup> PJM filed and, on October 25, 2024, FERC accepted a revised proposal that would require that sellers that fail the TPS test will be offer capped at their cost-based offers and that operating parameters will be mitigated. That order has no current effect because FERC approved the PJM filing that linked, for no logical reason, implementing the improved rules to PJM's adoption of an improved combined cycle model with no defined date. The flawed rules remain in place. PJM's proposal also uses the flawed formula rejected by FERC to select among cost-based offers. This will result in the illogical selection of cost-based offers in some circumstances, particularly if a dual fuel unit submits offers for both oil and gas on a day when the economics change between the two fuels midday. PJM should modify its implementation to address that issue. The result would allow market sellers to select the correct cost-based fuel schedule. There is no reason to delay implementation until PJM addresses combined cycle modelling. The changes would decrease the solution time for the day-ahead market and enhance market efficiency. The new approach, modified to correct the cost offer selection issue, should be implemented as soon as possible to help ensure effective market power mitigation.

The enforcement of market power mitigation rules is undermined if the definition of a competitive offer is not correct. A competitive offer is equal to short run marginal costs. The significance of competition metrics like markup is also undermined if the definition of a competitive offer is not correct. The definition of a competitive offer, under the PJM Market Rules, is not currently correct. The definition, that all costs that are related to electric production are short run marginal costs, is not clear or correct. All costs and investments for power generation are related to electric production. Under this definition, some unit owners include costs in

<sup>78</sup> The MMU reviews PJM's application of the TPS test and brings issues to the attention of PJM.

<sup>79</sup> See 175 FERC ¶ 61,231 (2021).

<sup>80</sup> 185 FERC ¶ 61,158 (2023).

<sup>81</sup> See Answer of PJM Interconnection LLC., Docket No. EL21-78-000 (September 15, 2021).

<sup>82</sup> See "Comments of the Independent Market Monitor for PJM," Docket No. EL21-78 (October 15, 2021).

<sup>83</sup> See "Schedule Selection Proposal," MMU presentation to the Markets and Reliability Committee (October 25, 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MRC\\_Schedule\\_Selection\\_20231025.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MRC_Schedule_Selection_20231025.pdf)>; "Schedule Selection: IMM Package," MMU Presentation to the Market Implementation Committee (September 6, 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MIC\\_Schedule\\_Selection\\_IMM\\_Package\\_20230906.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MIC_Schedule_Selection_IMM_Package_20230906.pdf)>; "Schedule Selection: IMM Proposal," MMU Presentation to the Market Implementation Committee (August 9, 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MIC\\_Schedule\\_Selection\\_IMM\\_Proposal\\_20230809.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MIC_Schedule_Selection_IMM_Proposal_20230809.pdf)>; "Least Cost Schedule Analysis," MMU Presentation at the MIC Special Session (July 17, 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MIC\\_Special\\_Session\\_Least\\_Cost\\_Schedule\\_Analysis\\_20230717.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MIC_Special_Session_Least_Cost_Schedule_Analysis_20230717.pdf)>; "Multischedule Model and Mitigation: IMM Package," MMU Presentation to the MIC Special Session (May 24, 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MIC\\_Multischedule\\_Model\\_and\\_Mitigation\\_IMM\\_Package\\_20230524.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MIC_Multischedule_Model_and_Mitigation_IMM_Package_20230524.pdf)>; "Education: Schedule Selection and Market Power Mitigation," MMU Presentation to the MIC Special Session (March 29, 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MIC\\_Special\\_Session\\_Education\\_Schedule\\_%20Selection\\_and\\_Market\\_Power\\_Mitigation\\_20230330.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MIC_Special_Session_Education_Schedule_%20Selection_and_Market_Power_Mitigation_20230330.pdf)>; "Offer Schedule Selection," MMU Presentation to the Market Implementation Committee (February 8 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MIC\\_Offer\\_Schedule\\_Selection\\_20230208.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MIC_Offer_Schedule_Selection_20230208.pdf)>.

<sup>84</sup> 187 FERC 61,051 at P 25 (2024).



cost-based energy offers that are not short run marginal costs in offers, especially maintenance costs. This issue can be resolved by simple rule changes to incorporate a clear and accurate definition of short run marginal costs. This rule also had unintended consequences for market seller offer caps in the capacity market. Maintenance costs includable in energy offers cannot be included in capacity market offer caps based on avoidable costs. As a result, capacity market offer caps based on net avoidable costs were lower than they would have been if maintenance costs had been correctly included in avoidable costs rather than incorrectly defined to be part of short marginal costs of producing energy and includable in energy offers.

A competitive power market will result in higher prices when fuel costs increase and lower prices when fuel costs decrease. A competitive market will not result in higher prices when markups increase based on market power, or when PJM selects a price-based offer including a markup rather than a cost-based offer in the presence of local market power, or when PJM artificially triggers transmission constraint penalty factors. The overall energy market results support the conclusion that energy prices in PJM are set, generally, by marginal units operating at, or close to, their marginal costs, although this was not always the case in 2024 or prior years. Given the structure of the energy market which can permit the exercise of aggregate and local market power, some participants' offer behavior is a source of concern in the energy market and provides a reason to use correctly defined short run marginal cost as the sole basis for cost-based offers and a reason for implementing an aggregate market power test and correcting the offer capping process for resources with local market power. The MMU concludes that the PJM energy market results were competitive in 2024.

## Overview: Section 4, Energy Uplift

### Energy Uplift Credits

- **Energy uplift credits.** Total energy uplift credits increased by \$113.0 million, or 72.0 percent, in 2024 compared to 2023, from \$156.9 million to \$269.9 million.
- **Types of energy uplift credits.** In 2024, total energy uplift credits included \$115.2 million in day-ahead generator credits, \$120.5 million in balancing generator credits, \$31.2 million in lost opportunity

cost credits Dispatch differential lost opportunity credits, which are a subset of balancing operating reserves, were implemented as part of fast start pricing on September 1, 2021, and were \$1.9 million in 2024.

- **Types of units.** In 2024, steam coal units received 45.2 percent of day-ahead generator credits, and combustion turbines received 76.1 percent of balancing generator credits and 82.2 percent of lost opportunity cost credits. Combined cycle units and combustion turbines received 27.8 percent of dispatch differential lost opportunity credits, and hydro units received 55.8 percent of dispatch differential lost opportunity credits
- **Concentration of energy uplift credits.** In 2024, the top 10 units receiving energy uplift credits received 43.2 percent of all credits and the top 10 organizations received 76.0 percent of all credits.
- **Lost opportunity cost credits.** Lost opportunity cost credits increased by \$8.7 million, or 38.5 percent, in 2024, compared to 2023, from \$22.5 million to \$31.2 million.

Some combustion turbines and diesels are scheduled day-ahead but not requested in real time, and receive day-ahead lost opportunity cost credits as a result. This was the source of 82.1 percent of the \$31.2 million of lost opportunity costs.

- **Following dispatch.** Some units are incorrectly paid uplift despite not meeting uplift eligibility requirements, including not following dispatch, not having the correct commitment status, or not operating with PLS offer parameters. Since 2018, the MMU has made cumulative resettlement requests for the most extreme overpaid units of \$17.9 million, of which PJM has resettled only \$3.9 million, or 22.0 percent.

### Energy Uplift Charges

- **Energy Uplift Charges.** In 2024, total energy uplift charges increased by \$112.2 million, or 72.1 percent, compared to 2023, from \$155.7 million to \$268.0 million.
- **Types of Energy Uplift Charges.** In 2024, total uplift charges included \$114.7 million in day-ahead operating reserve charges, \$152.1 million in balancing generator charges, \$0.9 million in

reactive charges, and \$0.3 million in black start services.

## Section 4 Recommendations

- The MMU recommends that uplift be paid only based on operating parameters that reflect the flexibility of the benchmark new entrant unit (CONE unit) in the PJM Capacity Market. (Priority: High. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM not pay uplift to units not following dispatch, including uplift related to fast start pricing, and require refunds where it has made such payments. This includes units whose offers are flagged for fixed generation in Markets Gateway because such units are not dispatchable. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM pay uplift based on the offer at the lower of the actual unit output or the dispatch signal MW. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends eliminating intraday segments from the calculation of uplift payments and returning to calculating the need for uplift based on the entire 24 hour operating day. (Priority: High. First reported 2018. Status: Not adopted.)
- The MMU recommends the elimination of day-ahead uplift to ensure that units receive an energy uplift payment based on their real-time output and not their day-ahead scheduled output. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that units not be paid lost opportunity cost uplift credits when PJM directs a unit to reduce output based on a transmission constraint or other reliability issue. There is no lost opportunity because the unit is required to reduce for the reliability of the unit and the system. (Priority: High. First reported 2021. Status: Not adopted.)
- The MMU recommends reincorporating the use of net regulation revenues as an offset in the calculation of balancing generator credits. (Priority: Medium. First reported 2009. Status: Not adopted.)
- The MMU recommends that self scheduled units not be paid energy uplift credits for their startup cost when the units are scheduled by PJM to start before the self scheduled hours. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends three modifications to the energy lost opportunity cost calculations:
  - The MMU recommends calculating LOC based on 24 hour daily periods for combustion turbines and diesels scheduled in the day-ahead energy market, but not committed in real time. (Priority: Medium. First reported 2014. Status: Not adopted.)
  - The MMU recommends that units scheduled in the day-ahead energy market and not committed in real time should be compensated for LOC based on their real-time desired and achievable output, not their scheduled day-ahead output. (Priority: Medium. First reported 2015. Status: Not adopted.)
  - The MMU recommends that only flexible fast start units (startup plus notification times of 10 minutes or less) and units with short minimum run times (one hour or less) be eligible by default for the LOC compensation to units scheduled in the day-ahead energy market and not committed in real time. Other units should be eligible for LOC compensation only if PJM explicitly cancels their day-ahead commitment. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that up to congestion (UTC) transactions be required to pay energy uplift charges for both the injection and the withdrawal sides of the UTC. (Priority: High. First reported 2011. Status: Partially adopted.)
- The MMU recommends allocating the energy uplift credits paid to units scheduled by PJM as must run in the day-ahead energy market for reasons other than voltage/reactive or black start services as a reliability charge to real-time load, real-time exports and real-time wheels. (Priority: Medium. First reported 2014. Status: Not adopted. Stakeholder process.)
- The MMU recommends that the total cost of providing reactive support be categorized and allocated as reactive services. Reactive services credits should be calculated consistent with the balancing generator credit calculation. (Priority: Medium. First reported 2012. Status: Not adopted. Stakeholder process.)

- The MMU recommends including real-time exports and real-time wheels in the allocation of the cost of providing reactive support to the 500 kV system or above, in addition to real-time load. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends modifications to the calculation of lost opportunity costs credits paid to wind units. The lost opportunity costs credits paid to wind units should be based on the lesser of the desired output, the estimated output based on actual wind conditions and the capacity interconnection rights (CIRs). The MMU recommends that PJM require wind units to request CIRs based on the maximum output used in the ELCC calculation for wind units. (Priority: Low. First reported 2012. Status: Partially adopted.)
- The MMU recommends that PJM clearly identify and classify all reasons for incurring uplift in the day-ahead and the real-time energy markets and the associated uplift charges in order to make all market participants aware of the reasons for these costs and to help ensure a long term solution to the issue of how to allocate the costs of uplift. (Priority: Medium. First reported 2011. Status: Partially adopted.)
- The MMU recommends that PJM revise the current uplift confidentiality rules in order to allow the disclosure of complete information about the level of uplift by unit and the detailed reasons for the level of uplift credits by unit in the PJM region. (Priority: High. First reported 2013. Status: Partially adopted.)<sup>85</sup>

## Section 4 Conclusion

Competitive market outcomes result from energy offers equal to short run marginal costs that incorporate flexible operating parameters. When PJM permits a unit to include inflexible operating parameters in its offer and pays uplift based on those inflexible parameters, there is an incentive for the unit to remain inflexible. The rules regarding operating parameters should be implemented in a way that creates incentives for flexible operations rather than inflexible operations. The standard for paying uplift should be the maximum achievable flexibility, based on OEM standards for the

benchmark new entrant unit (CONE unit) in the PJM Capacity Market demand (VRR) curve. Applying a weaker standard effectively subsidizes inflexible units by paying them based on inflexible parameters that result from lack of investment and that could be made more flexible. The result inflates uplift costs, suppresses energy prices, and is an incentive to inflexibility.

It is not appropriate to accept that inflexible units should be paid uplift based on inflexible offers. The question of why units make inflexible offers should be addressed directly. Are units inflexible because they are old and inefficient, because owners have not invested in increased flexibility or because they serve as a mechanism for the exercise of market power? The question of why the inflexible unit was built, whether it was built under cost of service regulation and whether it is efficient to retain the unit should be answered directly. The question of how to provide market incentives for investment in flexible units and for investment in increased flexibility of existing units should be addressed directly. The question of whether inflexible units should be paid uplift at all should be addressed directly. Marginal cost pricing without paying uplift to inflexible units would create incentives for market participants to provide flexible solutions including replacing inefficient units with flexible, efficient units.

Implementing combined cycle modeling, to permit the energy market model optimization to take advantage of the versatility and flexibility of combined cycle technology in commitment and dispatch, would provide significant flexibility without requiring a distortion of the market rules. Such modeling should not be used as an excuse to eliminate market power mitigation or an excuse to permit inflexible offers to be paid uplift. There are defined steps that could and should be taken immediately to improve the modeling of combined cycle plants that do not require investment in combined cycle modeling software, including modeling soak time, and accurately accounting for transition times to power augmentation offer segments.

The reduction of uplift payments should not be a goal to be achieved at the expense of the fundamental logic of the LMP system. For example, the use of closed loop interfaces to reduce uplift should be eliminated because it is not consistent with LMP fundamentals and constitutes a form of subjective price setting. The

<sup>85</sup> On September 7, 2018, PJM made a compliance filing for FERC Order No. 844 to publish unit specific uplift credits. The compliance filing was accepted by FERC on June 21, 2019. 166 FERC ¶ 61,210 (2019). PJM began posting unit specific uplift reports on May 1, 2019. 167 FERC ¶ 61,280 (2019).



same is true of fast start pricing. The same is true of PJM's proposals to modify the ORDC in order to increase energy prices and reduce uplift.

Accurate short run price signals, equal to the short run marginal cost of generating power, provide market incentives for cost minimizing production to all economically dispatched resources and provide market incentives to load based on the marginal cost of additional consumption. The objective of efficient short run price signals is to minimize system production costs, not to minimize uplift. Repricing the market to reflect commitment costs creates a tradeoff between minimizing production costs and reduction of uplift. The tradeoff exists because when commitment costs are included in prices, the price signal no longer equals the short run marginal cost and therefore no longer provides the correct signal for efficient behavior for market participants making decisions on the margin, whether resources, load, interchange transactions, or virtual traders. This tradeoff now exists based on PJM's recently implemented fast start pricing approach.<sup>86</sup> Fast start pricing affects uplift calculations by introducing a new category of uplift in the balancing market, and changing the calculation of uplift in the day-ahead market.

When units receive substantial revenues through energy uplift payments, these payments are not fully transparent to the market, in part because of the current confidentiality rules. As a result, other market participants, including generation and transmission developers, do not have the opportunity to compete to displace them. As a result, substantial energy uplift payments to a concentrated group of units and organizations have persisted. FERC Order No. 844 authorized the publication of unit specific uplift payments for credits incurred after July 1, 2019.<sup>87</sup> However, Order No. 844 failed to require the publication of unit specific uplift credits for the largest units receiving significant uplift payments, inflexible steam units committed for reliability by PJM in the day-ahead market.

Uplift payments could be significantly reduced by reversing many of the changes that have been made to the original basic uplift rules. The goal of uplift is

to ensure that competitive energy and ancillary service market outcomes do not require efficient resources operating for the PJM system, at the direction of PJM, to operate at a loss. In the original PJM design, uplift was calculated on a daily basis, including all costs and net revenues. But that rule was changed to use only segments of the day. The result is to overstate uplift payments because units may be paid uplift for a day in which their net revenues exceed their costs. In the original PJM design, all net revenues from energy and ancillary services were an offset to uplift payments. That rule was changed to eliminate net revenue from the regulation market. The result is to overstate uplift payments, for no logical reason.

Uplift payments could also be significantly reduced to a more efficient level by eliminating all day-ahead operating reserve credits. It is illogical and unnecessary to pay units day-ahead operating reserve credits because units do not incur any costs to run and any revenue shortfalls are addressed by balancing generator credits.

PJM needs to pay substantially more attention to the details of uplift payments including accurately tracking whether units are following dispatch, identifying the actual need for units to be dispatched out of merit and determining whether better definitions of constraints would be a more market based approach. PJM pays uplift to units even when they do not operate as requested by PJM, i.e. when units do not follow dispatch. PJM uses dispatcher logs as a primary screen to determine if units are eligible for uplift regardless of how they actually operate or if they followed the PJM dispatch signal. The reliance on dispatcher logs for this purpose is impractical, inefficient, and incorrect. PJM needs to define and implement systematic and verifiable rules for determining when units are following dispatch as a primary screen for eligibility for uplift payments. PJM should not pay uplift to units that do not follow dispatch. PJM continues to pay uplift to units that do not follow dispatch. PJM and the MMU are actively working together to revise the definition of following dispatch to address these issues.

The MMU notifies PJM and generators of instances in which, based on the PJM dispatch signal and the real-time output of the unit, it is clear that the unit did not operate as requested by PJM. The MMU sends requests for resettlements to PJM to make the units with the

<sup>86</sup> Fast start pricing was approved by FERC and implemented on September 1, 2021. See 173 FERC ¶ 61,244 (2020).

<sup>87</sup> On June 21, 2019, FERC accepted PJM's Order No. 844 compliance filing. 166 FERC ¶ 61,210 (2019). The filing stated that PJM would begin posting unit specific uplift reports on May 1, 2019. On April 8, 2019, PJM filed for an extension on the implementation date of the zonal uplift reports and unit specific uplift reports to July 1, 2019. On June 28, 2019, FERC accepted PJM's request for extension of effective dates. 167 FERC ¶ 61,280 (2019).

most extreme overpayments ineligible for uplift credits. Since 2018, the MMU has requested that PJM require the return of \$17.9 million of incorrect uplift credits of which PJM has agreed and resettled only \$3.9 million over the last two years, or 22.0 percent. In addition, PJM has refused to accept the return of incorrectly paid uplift credits by generators when the MMU has identified such cases and generators offer to repay the credits.

While energy uplift charges are an appropriate part of the cost of energy, market efficiency would be improved by ensuring that the level and variability of these charges are as low as possible consistent with the reliable operation of the system and consistent with pricing at short run marginal cost. The goal should be to minimize the total incurred energy uplift charges and to increase the transactions over which those charges are spread in order to reduce the impact of energy uplift charges on markets. The result would be to reduce the level of per MWh charges, to reduce the uncertainty associated with uplift charges and to reduce the impact of energy uplift charges on decisions about how and when to participate in PJM markets. The result would also be to increase incentives for flexible operation and to decrease incentives for the continued operation of inflexible and uneconomic resources. PJM does not need a new flexibility product. PJM needs to provide incentives to existing and new entrant resources to unlock the significant flexibility potential that already exists, to end incentives for inflexibility and to stop creating new incentives for inflexibility.

## Overview: Section 5, Capacity Market

### RPM Capacity Market

#### Market Design

The Reliability Pricing Model (RPM) Capacity Market is a forward looking, annual, locational market, with a must offer requirement for Existing Generation Capacity Resources and a must buy requirement for load, with performance incentives, that includes clear market power mitigation rules and that permits the direct participation of demand side resources.<sup>88</sup> PJM introduced the Capacity Performance design for the 2017/2018 BRA. PJM introduced a new ELCC method for defining capacity MW offered in the 2025/2026 BRA.<sup>89</sup>

Under RPM, capacity obligations are annual.<sup>90</sup> By design, Base Residual Auctions (BRA) are held for delivery years that are three years in the future despite recent auction delays. First, Second and Third Incremental Auctions (IA) are held for each delivery year.<sup>91</sup> First, Second, and Third Incremental Auctions are conducted 20, 10, and three months prior to the delivery year although some incremental auctions have not been held as a result of delays in holding BRAs.<sup>92</sup> A Conditional Incremental Auction may be held if there is a need to procure additional capacity resulting from a delay in a planned large transmission upgrade that was modeled in the BRA for the relevant delivery year.<sup>93</sup> A Reliability Backstop Auction may be conducted if tariff defined criteria are met to resolve reliability criteria violations caused by lack of sufficient capacity procured through RPM auctions.<sup>94</sup> If the installed reserve margin resulting from the total UCAP committed through self supply or BRAs for three consecutive years is more than one percent lower than the approved PJM installed reserve margin, PJM will make a filing with FERC to conduct a Reliability Backstop Auction. If the total UCAP committed for all base load generation resources in BRAs for three consecutive years is less than the forecasted minimum hourly load, PJM will make a filing with FERC to conduct a Reliability Backstop Auction.

The 2024/2025 RPM Third Incremental Auction and the 2025/2026 RPM Base Residual Auction were conducted in 2024. Based on the FERC Order in Docket No. ER23-729-002, PJM reran the 2024/2025 RPM Base Residual Auction with final results posted on May 6, 2024, and PJM reran the 2024/2025 Third Incremental Auction with final results posted on May 23, 2024.<sup>95</sup> <sup>96</sup> <sup>97</sup> The 2025/2026 RPM Base Residual Auction was conducted in July 2024.

<sup>88</sup> The terms *PJM Region*, *RTO Region* and *RTO* are synonymous in this report and include all capacity within the PJM footprint.

<sup>89</sup> See 186 FERC ¶ 61,080 (2024), *reh'g order*, 189 FERC ¶ 61,043 (2024).

<sup>90</sup> Effective for the 2020/2021 and subsequent delivery years, the RPM market design incorporated seasonal capacity resources. Summer period and winter period capacity must be matched either through commercial aggregation or through the optimization in equal MW amounts in the LDA or the lowest common parent LDA.

<sup>91</sup> See 126 FERC ¶ 61,275 at P 86 (2009).

<sup>92</sup> See Letter Order, FERC Docket No. ER10-366-000 (January 22, 2010).

<sup>93</sup> See 126 FERC ¶ 61,275 at P 88 (2009). There have been no Conditional Incremental Auctions.

<sup>94</sup> See OATT Attachment DD § 16.

<sup>95</sup> On December 23, 2022, PJM filed revisions to the PJM market rules in Docket No. ER23-729-000 and contemporaneously filed a complaint in Docket No. EL23-19-000 seeking the same revisions. By order issued February 21, 2023, PJM's revisions were accepted and the complaint was dismissed as moot. 182 FERC ¶ 61,109.

<sup>96</sup> See the "Analysis of the 2024/2025 RPM Base Residual Auction," <[https://www.monitoringanalytics.com/reports/Reports/2023/IMM\\_Analysis\\_of\\_the\\_20242025\\_RPM\\_Base\\_Residual\\_Auction\\_20231030.pdf](https://www.monitoringanalytics.com/reports/Reports/2023/IMM_Analysis_of_the_20242025_RPM_Base_Residual_Auction_20231030.pdf)> (October 30, 2023).

<sup>97</sup> 187 FERC ¶ 61,065 (2024).

## Market Structure

- **RPM Installed Capacity.** In 2024, RPM installed capacity increased 1,281.2 MW or 0.7 percent, from 178,375.0 MW on January 1, to 179,656.2 MW on December 31. Installed capacity includes net capacity imports and exports and can vary on a daily basis.
- **Reserves.** For the 2025/2026 RPM Base Residual Auction, the sum of cleared MW that were considered categorically exempt from the must offer requirement and the cleared MW of DR is 14,319.1 MW, or 71.1 percent of required reserves and 68.1 percent of total reserves. The fact that more than two thirds (68.1 percent) of the PJM reserves depend on resources that are not subject to the RPM must offer requirement, a core part of the capacity market design, means that reliability is significantly less certain than the stated reserve margins indicate.
- **RPM Installed Capacity by Fuel Type.** Of the total installed capacity on December 31, 2024, 49.4 percent was gas; 21.0 percent was coal; 17.9 percent was nuclear; 4.3 percent was hydroelectric; 2.2 percent was oil; 2.0 percent was wind; 0.3 percent was solid waste; and 2.8 percent was solar.
- **Market Concentration.** In the 2024/2025 RPM Third Incremental Auction and the 2025/2026 RPM Base Residual Auction, all participants in the total PJM market as well as the LDA RPM markets failed the three pivotal supplier (TPS) test.<sup>98</sup> Offer caps were applied to all sell offers for resources which were subject to mitigation when the capacity market seller did not pass the test, the submitted sell offer exceeded the defined offer cap, and the submitted sell offer, absent mitigation, increased the market clearing price.<sup>99 100 101</sup>
- **Imports and Exports.** Of the 1,268.5 MW of imports offered in the 2025/2026 RPM Base Residual Auction, 1,268.5 MW cleared. Of the cleared imports, 700.5 MW (55.2 percent) were from MISO.

<sup>98</sup> There are 27 Locational Deliverability Areas (LDAs) identified to recognize locational constraints as defined in "Reliability Assurance Agreement Among Load Serving Entities in the PJM Region," Schedule 10.1. PJM determines, in advance of each BRA, whether the defined LDAs will be modeled in the given delivery year using the rules defined in OATT Attachment DD § 5.10(a)(ii).

<sup>99</sup> See OATT Attachment DD § 6.5.

<sup>100</sup> Prior to November 1, 2009, existing DR and EE resources were subject to market power mitigation in RPM Auctions. See 129 FERC ¶ 61,081 at P 30 (2009).

<sup>101</sup> Effective January 31, 2011, the RPM rules related to market power mitigation were changed, including revising the definition for Planned Generation Capacity Resource and creating a new definition for Existing Generation Capacity Resource for purposes of the must offer requirement and market power mitigation, and treating a proposed increase in the capability of a generation capacity resource the same in terms of mitigation as a Planned Generation Capacity Resource. See 134 FERC ¶ 61,065 (2011).

- **Demand Resources.** Committed DR was 7,699.9 MW for June 1, 2024, as a result of cleared capacity for demand resources in RPM auctions for the 2024/2025 Delivery Year (8,064.7 MW) less replacement capacity (364.8 MW).
- **Energy Efficiency Resources.** EE is not a capacity resource but is paid the capacity market clearing price as a subsidy. Committed EE was 7,668.0 MW for June 1, 2024, as a result of MW offered at a price less than or equal to the RPM auction clearing price in RPM auctions for the 2024/2025 Delivery Year (7,716.0 MW) less replacement MW (48.0 MW).

## Market Conduct

- **2024/2025 RPM Third Incremental Auction.** Of the 320 generation resources that submitted Capacity Performance offers, the MMU calculated unit specific offer caps for seven generation resources (2.2 percent).
- **2025/2026 RPM Base Residual Auction.** Of the 1,119 generation resources that submitted Capacity Performance offers, the MMU calculated unit specific offer caps for 61 generation resources (5.5 percent).

## Market Performance

- The 2024/2025 RPM Third Incremental Auction and the 2025/2026 RPM Base Residual Auction were conducted in 2024. The weighted average capacity price for the 2023/2024 Delivery Year is \$42.01 per MW-day, including all RPM auctions for the 2023/2024 Delivery Year. The weighted average capacity price for the 2024/2025 Delivery Year is \$45.57 per MW-day, including all RPM auctions for the 2024/2025 Delivery Year.
- For the 2024/2025 Delivery Year, RPM annual charges to load are \$2.5 billion.
- In the 2025/2026 RPM Base Residual Auction, the market performance was determined to be not competitive.

## Part V Reliability Service (RMR)

- Of the nine companies (28 units) that have provided service following deactivation requests, two companies (seven units) filed to be paid under the deactivation avoidable cost rate (DACR), the formula

rate. The other seven companies (21 units) filed to be paid under the cost of service recovery rate.

## Generator Performance

- **Forced Outage Rates.** The average PJM EFORD in 2024 was 5.2 percent, a decrease from 5.5 percent in 2023.<sup>102</sup>
- **Generator Performance Factors.** The PJM aggregate equivalent availability factor in 2024 was 83.2 percent, an increase from 83.1 percent in 2023.

## Section 5 Recommendations<sup>103</sup>

### Definition of Capacity

- The MMU recommends elimination of the key remaining components of the CP model because they interfere with competitive outcomes in the capacity market and create unnecessary complexity and risk. (Priority: High. First reported 2022. Status: Not adopted.)
- The MMU recommends the enforcement of a consistent definition of capacity resources. The MMU recommends that the tariff requirement to be a physical resource be enforced and enhanced. The requirement to be a physical resource should apply at the time of auctions and should also constitute a commitment to be physical in the relevant delivery year. The requirement to be a physical resource should be applied to all resource types, including planned generation, demand resources, and imports.<sup>104</sup> <sup>105</sup> (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that DR providers be required to have a signed contract with specific customers for specific facilities for specific levels of DR at least six months prior to any capacity auction in which the DR is offered. (Priority: High. First reported 2016. Status: Not adopted.)
- The MMU recommends that Energy Efficiency Resources (EE) not be included in the capacity

market construct because PJM's load forecasts have accounted for EE since the 2016 load forecast for the 2019/2020 delivery year. EE is not a capacity resource as defined in the tariff, and there is no reason to continue to pay large subsidies to EE providers.<sup>106</sup> (Priority: Medium. First reported 2016. Status: Adopted 2024.)<sup>107</sup>

- The MMU recommends that intermittent resources, including storage, not be permitted to offer capacity MW based on energy deliveries that exceed their defined deliverability rights (CIRs). Only energy output for such resources at or below the designated CIR/deliverability level should be recognized in the definition of derated capacity (e.g. ELCC). Correctly defined ELCC derating factors are lower than the CIRs required to meet those derating factors. (Priority: High. First reported 2021. Status: Adopted 2023.)
- The MMU recommends that PJM require all market participants to meet their deliverability requirements under the same rules. PJM should end the practice of giving away winter CIRs to intermittent resources that appear to exist because other resources paid for the supporting network upgrades. (Priority: High. First reported 2017. Status: Not adopted.)<sup>108</sup>
- The MMU recommends that the must offer rule in the capacity market apply to all capacity resources. There is no reason to exempt intermittent and capacity storage resources, including hydro, and demand resources from the must offer requirement. The same rules should apply to all capacity resources in order to ensure open access to the transmission system and prevent the exercise of market power through withholding. (Priority: High. First reported 2021. Status: Not adopted.)
- The MMU recommends that PJM require all market sellers of proposed generation capacity resources, including thermal and intermittent, to submit a binding notice of intent to offer at least six months prior to the base residual auction. This is consistent with the overall MMU recommendation that all capacity resources have a must offer obligation in the capacity market auctions. (Priority: High. First reported 2023. Status: Partially adopted.)

<sup>102</sup> The generator performance analysis includes all PJM capacity resources for which there are data in the PJM generator availability data systems (GADS) database. Data was downloaded from the PJM GADS database on January 22, 2025. EFORD data presented in state of the market reports may be revised based on data submitted after the publication of the reports as generation owners may submit corrections at any time with permission from PJM GADS administrators.

<sup>103</sup> The MMU has identified serious market design issues with RPM and the MMU has made specific recommendations to address those issues. These recommendations have been made in public reports. See Table 5-2.

<sup>104</sup> See also Comments of the Independent Market Monitor for PJM, Docket No. ER14-503-000 (December 20, 2013).

<sup>105</sup> See "Analysis of Replacement Capacity for RPM Commitments: June 1, 2007 to June 1, 2019," <[http://www.monitoringanalytics.com/reports/Reports/2019/IMM\\_Analysis\\_of\\_Replacement\\_Capacity\\_for\\_RPM\\_Commitments\\_June\\_1\\_2007\\_to\\_June\\_1\\_2019\\_20190913.pdf](http://www.monitoringanalytics.com/reports/Reports/2019/IMM_Analysis_of_Replacement_Capacity_for_RPM_Commitments_June_1_2007_to_June_1_2019_20190913.pdf)> (September 13, 2019).

<sup>106</sup> "PJM Manual 19: Load Forecasting and Analysis," § 3.2 Development of the Forecast, Rev. 37 (Dec. 18, 2024).

<sup>107</sup> See 189 FERC ¶ 61,095 (2024).

<sup>108</sup> This recommendation was first made in the 2020/2021 BRA report in 2017. See the "Analysis of the 2020/2021 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2017/IMM\\_Analysis\\_of\\_the\\_20202021\\_RPM\\_BRA\\_20171117.pdf](http://www.monitoringanalytics.com/reports/Reports/2017/IMM_Analysis_of_the_20202021_RPM_BRA_20171117.pdf)> (November 11, 2017).



- The MMU recommends that the ELCC be significantly refined to include hourly data that would permit unit specific ELCC ratings, to weight summer and winter risk in a more balanced manner, to eliminate PAI risks, and to pay for actual hourly performance rather than based on relatively inflexible class capacity accreditation ratings derived from a small number of hours of poor performance. (Priority: High. First reported 2023. Status: Not adopted.)

## Market Design and Parameters

- The MMU recommends that PJM reevaluate the shape of the VRR curve. The shape of the VRR curve directly results in load paying substantially more for capacity than load would pay with a vertical demand curve. More specifically, the MMU recommended that the VRR curve be rotated half way towards the vertical demand curve at the reliability requirement in the 2022 Quadrennial Review. (Priority: High. First reported 2021. Status: Partially adopted.)
- The MMU recommends that the maximum price on the VRR curve be defined as 1.5 times Net CONE, capped at Gross CONE. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that the reference resource be a CT rather than a CC. The MMU recommends that the ELCC value used to convert the gross CONE in ICAP terms for a CT to the gross CONE in UCAP terms be the ELCC based on winter ratings. (Priority: High. First reported Q3 2024. Status: Not adopted.)
- The MMU recommends that the test for determining modeled Locational Deliverability Areas (LDAs) in RPM be redefined. A detailed reliability analysis of all at risk units should be included in the redefined model including transmission constraints inside LDAs. The market design should clear and pay units that are needed for reliability per PJM's transmission reliability analysis in order to forestall RMRs. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM clear the capacity market based on nodal capacity resource locations and the characteristics of the transmission system inside and outside LDAs consistent with the actual electrical facts of the grid. Absent a fully nodal capacity market clearing process, the MMU recommends that PJM use a non-nested model with all LDAs modeled including VRR curves for all LDAs. Each LDA requirement should be met with the capacity resources located within the LDA and exchanges from neighboring LDAs up to the transmission limit. LDAs should be allowed to price separate if that is the result of the LDA supply curves and the transmission constraints between LDAs. (Priority: Medium. First reported 2017. Status: Not adopted.)
- The MMU recommends that the net revenue offset calculation used by PJM to calculate the net Cost of New Entry (CONE) and net ACR be based on a forward looking calculation of expected energy and ancillary services net revenues using historical net revenues that are scaled based on forward prices for energy and fuel. (Priority: High. First reported 2014. Status: Not adopted.)<sup>109</sup>
- The MMU recommends that PJM reduce the number of incremental auctions to a single incremental auction held three months prior to the start of the delivery year and reevaluate the triggers for holding conditional incremental auctions. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM not sell back any capacity in any IA procured in a BRA. If PJM continues to sell back capacity, the MMU recommends that PJM offer to sell back capacity in incremental auctions only at the BRA clearing price for the relevant delivery year. (Priority: Medium. First reported 2017. Status: Not adopted.)
- The MMU recommends that PJM not buy any capacity in any IA if PJM has already procured excess reserves. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends changing the RPM solution method to explicitly incorporate the cost of uplift (make whole) payments in the objective function. (Priority: Medium. First reported 2014. Status: Not adopted.)
- The MMU recommends that the Fixed Resource Requirement (FRR) rules, including obligations and performance requirements, be revised and updated to ensure that the rules reflect current market realities and that FRR entities do not unfairly take

<sup>109</sup> This recommendation was first made during the Quadrennial Review in 2014, including the PJM Capacity Senior Task Force (CSTF), the MRC and the MC. <<https://www.pjm.com/committees-and-groups/closed-groups/cstf>>.

advantage of those customers paying for capacity in the PJM capacity market. (Priority: Medium. First reported 2019. Status: Not adopted.)

- The MMU recommends that the value of CTRs be defined by the total MW cleared in the capacity market, the internal MW cleared and the imported MW cleared, and not redefined later prior to the delivery year. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends that the market clearing results be used in settlements rather than the reallocation process currently used, or that the process of modifying the obligations to pay for capacity be reviewed. (Priority: Medium. First reported 2021. Status: Not adopted.)<sup>110</sup>
- The MMU recommends that PJM improve the clarity and transparency of its CETL calculations. The MMU also recommends that CETL for capacity imports into PJM be based on the ability to import capacity only where PJM capacity exists and where that capacity has a must offer requirement in the PJM Capacity Market. (Priority: Medium. First reported 2021. Status: Partially adopted 2022.)

### Offer Caps, Offer Floors, and Must Offer

- The MMU recommends using the lower of the cost or price-based energy market offer to calculate energy costs in the calculation of the historical net revenues which are an offset to gross ACR in the calculation of unit specific capacity resource offer caps based on net ACR. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends that modifications to existing resources, including relatively small proposed increases in the capability of a Generation Capacity Resource be treated as an existing resource and subject to the corresponding market power mitigation rules and no longer be treated as planned and exempt from offer capping. (Priority: Medium. First reported 2012. Status: Not adopted.)<sup>111</sup>
- The MMU recommends that the RPM market power mitigation rule be modified to apply offer caps in all cases when the three pivotal supplier test is

failed and the sell offer is greater than the offer cap. This will ensure that market power does not result in an increase in uplift (make whole) payments for seasonal products. (Priority: Medium. First reported 2017. Status: Not adopted.)

- The MMU recommends that any combined seasonal resources be required to be in the same LDA and at the same location, in order for the energy market and capacity market to remain synchronized and reliability metrics correctly calculated. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends that the definition of avoidable costs in the tariff be corrected to be consistent with the economic definition. Avoidable costs are costs that are neither short run marginal costs, like fuel or consumables, nor fixed costs like depreciation and rate of return. Avoidable costs are the marginal costs of capacity and therefore the competitive offer level for capacity resources and therefore the market seller offer cap. Avoidable costs are the marginal costs of capacity for both new resources and existing resources. (Priority: Medium. First reported 2017. Status: Not adopted.)<sup>112</sup>
- The MMU recommends that major maintenance costs be included in the definition of avoidable costs and removed from energy offers because such costs are avoidable costs and not short run marginal costs. (Priority: High. First reported 2019. Status: Not adopted.)
- The MMU recommends that capacity market sellers be required to explicitly request and support the use of minimum MW quantities (inflexible sell offer segments) and that the requests only be permitted for defined physical reasons. (Priority: Medium. First reported 2018. Status: Not adopted.)

<sup>110</sup> This recommendation was first made in the 2023/2024 BRA report in 2022. See "Analysis of the 2023/2024 RPM Base Residual Auction Revised," <[http://www.monitoringanalytics.com/reports/Reports/2022/IMM\\_Analysis\\_of\\_the\\_20232024\\_RPM\\_Base\\_Residual\\_Auction\\_20221028.pdf](http://www.monitoringanalytics.com/reports/Reports/2022/IMM_Analysis_of_the_20232024_RPM_Base_Residual_Auction_20221028.pdf)> (October 28, 2022).

<sup>111</sup> This recommendation was first made in the 2014/2015 BRA report in 2012. See "Analysis of the 2014/2015 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2012/Analysis\\_of\\_2014\\_2015\\_RPM\\_Base\\_Residual\\_Auction\\_20120409.pdf](http://www.monitoringanalytics.com/reports/Reports/2012/Analysis_of_2014_2015_RPM_Base_Residual_Auction_20120409.pdf)> (April 9, 2012).

<sup>112</sup> This recommendation was first made in the 2023/2024 BRA report in 2022. See "Analysis of the 2023/2024 RPM Base Residual Auction Revised," <[http://www.monitoringanalytics.com/reports/Reports/2022/IMM\\_Analysis\\_of\\_the\\_20232024\\_RPM\\_Base\\_Residual\\_Auction\\_20221028.pdf](http://www.monitoringanalytics.com/reports/Reports/2022/IMM_Analysis_of_the_20232024_RPM_Base_Residual_Auction_20221028.pdf)> (October 28, 2022).

- The MMU recommends that, as part of the MOPR unit specific standard of review, all projects be required to use the same basic modeling assumptions. That is the only way to ensure that projects compete on the basis of actual costs rather than on the basis of modeling assumptions.<sup>113</sup> (Priority: High. First reported 2013. Status: Not adopted.)

### Performance Incentive Requirements of RPM

- The MMU recommends that any unit not capable of supplying energy equal to its day-ahead must offer requirement (ICAP) be required to reflect an appropriate outage and associated performance penalty. (Priority: Medium. First reported 2009. Status: Not adopted.)
- The MMU recommends that retroactive replacement transactions associated with a failure to perform during a PAI not be allowed and that, more generally, retroactive replacement capacity transactions not be permitted. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends that there be an explicit requirement that capacity resource offers in the day-ahead energy market be competitive, where competitive is defined to be the short run marginal cost of the units, including flexible operating parameters. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that Capacity Performance resources be required to perform without excuses. Resources that do not perform should not be paid regardless of the reason for nonperformance. (Priority: High. First reported 2019. Status: Not adopted.)
- The MMU recommends that PJM require actual seasonal tests as part of the Summer/Winter Capability Testing rules, that the number of tests be limited, and that the ambient conditions under which the tests are performed be defined to reflect seasonal extreme conditions. (Priority: Medium. First reported 2022. Status: Not adopted.)

<sup>113</sup> See 143 FERC ¶ 61,090 (2013) ("We encourage PJM and its stakeholders to consider, for example, whether the unit-specific review process would be more effective if PJM requires the use of common modeling assumptions for establishing unit-specific offer floors while, at the same time, allowing sellers to provide support for objective, individual cost advantages. Moreover, we encourage PJM and its stakeholders to consider these modifications to the unit-specific review process together with possible enhancements to the calculation of Net CONE."); see also, Comments of the Independent Market Monitor for PJM, Docket No. ER13-535-001 (March 25, 2013); Complaint of the Independent Market Monitor for PJM v. Unnamed Participant, Docket No. EL12-63-000 (May 1, 2012); Motion for Clarification of the Independent Market Monitor for PJM, Docket No. ER11-2875-000, et al. (February 17, 2012); Protest of the Independent Market Monitor for PJM, Docket No. ER11-2875-002 (June 2, 2011); Comments of the Independent Market Monitor for PJM, Docket Nos. EL11-20 and ER11-2875 (March 4, 2011).

- The MMU recommends that PJM select the time and day that a unit undergoes Net Capability Verification Testing, not the unit owner, and that this information not be communicated in advance to the unit owner. (Priority: Medium. First reported 2022. Status: Not adopted.)

### Capacity Imports and Exports

- The MMU recommends that all capacity imports be required to be deliverable to PJM load in an identified LDA, zonal or subzonal, or defined combinations of specific zones, e.g. MAAC, prior to the relevant delivery year to ensure that they are full substitutes for internal, physical capacity resources. Pseudo ties alone are not adequate to ensure deliverability to PJM load. (Priority: High. First reported 2016. Status: Not adopted.)
- The MMU recommends that all costs incurred as a result of a pseudo tied unit be borne by the unit itself and included as appropriate in unit offers in the capacity market. (Priority: High. First reported 2016. Status: Not adopted.)

### Deactivations/Retirements

- The MMU recommends that the notification requirement for deactivations be extended from the current one quarter prior (See Table 5-29) to 12 months prior to an auction in which the unit will not be offered due to deactivation; and no less than 12 months prior to the date of deactivation (Priority: Low. First reported 2012. Status: Partially adopted.)
- The MMU recommends elimination of both the cost of service recovery rate option and the deactivation avoidable cost rate option for providing Part V reliability service (RMR), and their replacement with clear language that provides for the recovery of 100 percent of the actual incremental costs required to operate to provide the service plus a defined incentive. (Priority: High. First reported 2017. Status: Not adopted.)
- The MMU recommends that units recover all and only the incremental costs, including incremental investment costs without a cap, required to provide Part V reliability service (RMR service) that the unit owner would not have incurred if the unit owner had deactivated its unit as it proposed, plus a defined incentive payment. Customers should bear



no responsibility for paying previously incurred (sunk) costs, including a return on or of prior investments. (Priority: High. First reported 2010. Status: Not adopted.)

- The MMU recommends that the same reliability standard be used in capacity auctions as is used by PJM transmission planning. One result of the current design is that a unit may fail to clear in a BRA, decide to retire as a result, but then be found to be needed for reliability by PJM planning and paid under Part V of the OATT (RMR) to remain in service while transmission upgrades are made. (Priority: High. First reported 2023. Status: Not adopted.)
- The MMU recommends that if units that are paid under Part V of the OATT (RMR) are included in the calculation of CETO and/or reliability in the relevant LDA, the capacity of the RMR resources should also be included in capacity market supply at zero cost, but without all the obligations of a capacity resource, in order to ensure that the capacity market price signal reflects the appropriate supply and demand conditions. (Priority: High. First reported 2023. Status: Not adopted.)
- The MMU recommends that units that are paid under Part V of the OATT (RMR) not be included in the calculation of CETO or reliability in the relevant LDA, in order to ensure that the capacity market price signal reflects the appropriate supply and demand conditions. (Priority: High. First reported 2023. Status: Not adopted.)
- The MMU recommends that all CIRs be returned to the pool of available interconnection capability on the retirement date of generation resources in order to facilitate timely and competitive entry into the PJM markets, open access to the transmission system and maintain the priority order defined by the queue process. (Priority: High. First reported 2023. Status: Not adopted.)

## Section 5 Conclusion

The analysis of the PJM Capacity Market begins with market design and market structure, which provide the framework for the actual behavior or conduct of market participants. The analysis examines participant behavior within that market design and market structure. Regardless of the ownership structure of a market, the

market design can result in noncompetitive outcomes. In a good market design and a competitive market structure, market participants are constrained to behave competitively. In a market with endemic structural market power like the PJM Capacity Market, effective market power mitigation rules are required in order to constrain market participants to behave competitively. The analysis examines market performance, measured by price and the relationship between price and marginal cost, that results from the interaction of market structure and participant behavior. The analysis also examines the impact of market design choices on market performance.

The MMU concludes that the results of the 2025/2026 RPM Base Residual Auction were significantly affected by flawed market design decisions including by the CP design, by PJM's ELCC approach, by the definition of the maximum VRR price as Gross CONE, by the failure to extend the RPM must offer requirement to all resources, including, in some cases, the exercise of market power through the withholding of categorically exempt resources, by the product definition and lack of market power mitigation for demand resources, and by the exclusion from supply of the defined RMR resources. The BRA prices do not reflect supply and demand fundamentals but reflect, in significant part, PJM decisions about the definition of supply and demand. The auction results were not solely the result of the introduction of the ELCC market design and do also reflect, in part, the tightening of supply and demand conditions in the PJM Capacity Market.<sup>114</sup>

The capacity market is, by design, always tight in the sense that total supply is generally only slightly larger than demand. While the market may be long at times, that is not the equilibrium state. Market power is and will remain endemic to the structure of the PJM Capacity Market. Nonetheless, a competitive outcome can be assured by appropriate market power mitigation rules within an effective market design. Detailed market power mitigation rules are included in the PJM Open Access Transmission Tariff (OATT or Tariff). Reliance on the RPM design for competitive outcomes means reliance on the market power mitigation rules.

The demand for capacity includes expected peak load plus a reserve margin, and points on the demand curve, called the Variable Resource Requirement (VRR) curve,

<sup>114</sup> PJM's ELCC filing that created many of these issues was approved by FERC. 186 FERC ¶ 61,080 (January 30, 2024).

exceed peak load plus the reserve margin. The maximum price on the VRR curve has a significant impact on market prices particularly when the market is tight. The shape of the VRR curve results in the purchase of excess capacity and higher payments by customers. The VRR curves used in the 2025/2026 BRA included a maximum price equal to gross CONE for most LDAs that resulted in a significant increase in customer payments for load as a result of paying a price above the competitive level. Demand for capacity is almost entirely inelastic because the market rules require loads to purchase their share of the system capacity requirement. The VRR demand curve is everywhere inelastic. The result is that any supplier that owns more capacity than the typically small difference between total supply and the defined demand is individually pivotal and therefore has structural market power.

For the 2025/2026 RPM Base Residual Auction, the level of committed demand resources (6,085.6 MW UCAP) exceeds the entire level of excess capacity (870.9 MW). This is not consistent with the defined obligations of DR compared to other capacity resources. DR capacity resources do not have a must offer obligation in the energy market. DR capacity resources do not have a must offer obligation in the capacity market. The definition of performance for DR is not to provide a defined incremental level of MW when called but is only to be at a defined level of demand. DR capacity resources do not have a defined market seller offer cap. PJM markets for the first time in 2025/2026 will rely on demand response resources as part of the required reserve margin, rather than as excess above the required reserve margin. PJM markets for the first time in 2025/2026 will experience the implications of the definition of demand resources as a purely emergency capacity resource, when demand resources are a significant share of required reserves. Nonetheless, as another significant flaw in the market design, PJM does not include DR in its definition of primary or secondary reserves in the energy market. DR, for all these reasons, is an inferior resource in the capacity market.

There are currently two important gaps in the market power rules for the PJM Capacity Market. The RPM must offer requirement is not applied uniformly to all capacity resources. There are no market power mitigation rules that apply to demand resources.

All participants to which the three pivotal supplier (TPS) test was applied (in the RTO, BGE, and Dominion RPM markets) failed the three pivotal supplier test. The result was that offer caps were applied to all sell offers for Existing Generation Capacity Resources when the capacity market seller did not pass the test, the submitted sell offer exceeded the tariff defined offer cap, and the submitted sell offer, absent mitigation, would have resulted in a higher market clearing price.<sup>115 116</sup>

The correct definition of a competitive offer in the capacity market is the marginal cost of capacity, net ACR, where ACR includes an explicit accounting for the costs of mitigating risk, including the risk associated with mitigating rational capacity market nonperformance penalties, and the relevant costs of acquiring fuel, including natural gas.

The MMU recommends elimination of the key remaining components of the CP model because they interfere with competitive outcomes in the capacity market and create unnecessary complexity and risk. The use of Net CONE as the basis for the PAI penalty rate is unsupported by economic logic. The use of Net CONE to establish penalties is a form of arbitrary administrative pricing that creates arbitrarily high risk for generators, creates an artificial rationale for not having a must offer obligation for intermittent and storage resources, creates complexity in the calculation of CPQR and increases CPQR above rational levels, and ultimately raises the price of capacity above the competitive level.

Rather than penalizing capacity resources at extremely high levels for nonperformance only during PAI events, capacity resources should be paid the daily price of capacity only to the extent that they are available to produce energy or provide reserves, as required by PJM on a daily/hourly basis, based on their cleared capacity (ICAP). This is a positive performance incentive based on the market price of capacity rather than a penalty based on an arbitrary assumption. This would mean that capacity resources are paid to provide energy and reserves based on their full ICAP and are not paid a bonus for doing so. The reduced payments for capacity would directly reduce customers' bills for capacity. This

<sup>115</sup> Prior to November 1, 2009, existing DR and EE were subject to market power mitigation in RPM Auctions. See 129 FERC ¶ 61,081 (2009) at P 30.

<sup>116</sup> Effective January 31, 2011, the RPM rules related to market power mitigation were changed, including revising the definition for Planned Generation Capacity Resource and creating a new definition for Existing Generation Capacity Resource for purposes of the must-offer requirement and market power mitigation, and treating a proposed increase in the capability of a Generation Capacity Resource the same in terms of mitigation as a Planned Generation Capacity Resource. See 134 FERC ¶ 61,065 (2011).

would also end the pretense that there will be penalty payments to fund bonus payments. This would also end the need for complex CPQR calculations based on the penalty rate and assumptions about the number and timing of PAI events. CP has not worked as the theory suggested. PAI events are high impact low probability events. The failure of the PAI incentives to prevent a very high level of outages during Winter Storm Elliott illustrates the weakness of incentives based on this type of event. In addition, the actual performance standards were unacceptably weakened in the CP model. The standard of performance in the CP model is  $(B) * (\text{ELCC accredited UCAP factor for a unit})$ , where B is the balancing ratio and the ELCC accredited UCAP factor is the derating factor. For example, if B were 80 percent, the actual required performance for a unit with an 80 percent ELCC accredited UCAP factor would be only 64 percent of ICAP  $(.80 * .80)$ . For units with low ELCC accredited UCAP factors, the required performance is even lower. The obligation to perform should equal the full ICAP value of a unit, consistent with the associated must offer obligation in the energy market for capacity resources.

The MMU is required to identify market issues and to report them to the Commission and to market participants. The Commission decides on any action related to the MMU's findings.

The MMU has identified serious market design issues with RPM and the MMU has made specific recommendations

to address those issues.<sup>117 118 119 120 121 122 123 124 125 126 127</sup> In 2024, the MMU prepared a number of RPM related reports and testimony, shown in Table 5-2.

The PJM markets have worked to provide incentives to entry and to retain capacity. A majority of capacity investments in PJM were financed by market sources. Of the 55,064.5 MW of additional capacity that cleared in RPM auctions for the 2007/2008 through 2023/2024 Delivery Years, 42,444.9 MW (77.1 percent) were based on market funding. Of the 8,966.4 MW of additional capacity that cleared in RPM auctions for the 2024/2025 and 2025/2026 Delivery Year, 5,532.6 MW (61.7 percent) were based on market funding. Those investments were made based on the assumption that markets would be allowed to work and that inefficient units would exit.

It is essential that any approach to the PJM markets incorporate a consistent view of how the preferred market design is expected to provide competitive results in a sustainable market design over the long run. A sustainable market design means a market design that results in appropriate incentives to competitive market participants to retire units and to invest in new units over time such that reliability is ensured as a result of the functioning of the market.

In order to attract and retain adequate resources for the reliable operation of the energy market, revenues from PJM energy, ancillary services and capacity markets must be adequate for those resources. That adequacy

117 See "Analysis of the 2018/2019 RPM Base Residual Auction Revised," <[http://www.monitoringanalytics.com/reports/Reports/2016/IMM\\_Analysis\\_of\\_the\\_20182019\\_RPM\\_Base\\_Residual\\_Auction\\_20160706.pdf](http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Analysis_of_the_20182019_RPM_Base_Residual_Auction_20160706.pdf)> (July 6, 2016).  
 118 See "Analysis of the 2019/2020 RPM Base Residual Auction Revised," <[http://www.monitoringanalytics.com/reports/Reports/2016/IMM\\_Analysis\\_of\\_the\\_20192020\\_RPM\\_BRA\\_20160831-Revised.pdf](http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Analysis_of_the_20192020_RPM_BRA_20160831-Revised.pdf)> (August 31, 2016).  
 119 See "Analysis of the 2020/2021 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2017/IMM\\_Analysis\\_of\\_the\\_20202021\\_RPM\\_BRA\\_20171117.pdf](http://www.monitoringanalytics.com/reports/Reports/2017/IMM_Analysis_of_the_20202021_RPM_BRA_20171117.pdf)> (November 11, 2017).  
 120 See "Analysis of the 2021/2022 RPM Base Residual Auction - Revised," <[http://www.monitoringanalytics.com/reports/Reports/2018/IMM\\_Analysis\\_of\\_the\\_20212022\\_RPM\\_BRA\\_Revised\\_20180824.pdf](http://www.monitoringanalytics.com/reports/Reports/2018/IMM_Analysis_of_the_20212022_RPM_BRA_Revised_20180824.pdf)> (August 24, 2018).  
 121 See "Analysis of the 2022/2023 RPM Base Residual Auction," <[https://www.monitoringanalytics.com/reports/Reports/2022/IMM\\_Analysis\\_of\\_the\\_20222023\\_RPM\\_BRA\\_20220222.pdf](https://www.monitoringanalytics.com/reports/Reports/2022/IMM_Analysis_of_the_20222023_RPM_BRA_20220222.pdf)> (February 22, 2022).  
 122 See "Analysis of the 2023/2024 RPM Base Residual Auction," <[https://www.monitoringanalytics.com/reports/Reports/2022/IMM\\_Analysis\\_of\\_the\\_20232024\\_RPM\\_Base\\_Residual\\_Auction\\_20221028.pdf](https://www.monitoringanalytics.com/reports/Reports/2022/IMM_Analysis_of_the_20232024_RPM_Base_Residual_Auction_20221028.pdf)> (October 28, 2022).  
 123 See the "Analysis of the 2024/2025 RPM Base Residual Auction," <[https://www.monitoringanalytics.com/reports/Reports/2023/IMM\\_Analysis\\_of\\_the\\_20242025\\_RPM\\_Base\\_Residual\\_Auction\\_20231030.pdf](https://www.monitoringanalytics.com/reports/Reports/2023/IMM_Analysis_of_the_20242025_RPM_Base_Residual_Auction_20231030.pdf)> (October 30, 2023).  
 124 See "Analysis of Replacement Capacity for RPM Commitments: June 1, 2007 to June 1, 2017," <[http://www.monitoringanalytics.com/reports/Reports/2017/IMM\\_Report\\_on\\_Capacity\\_Replacement\\_Activity\\_4\\_20171214.pdf](http://www.monitoringanalytics.com/reports/Reports/2017/IMM_Report_on_Capacity_Replacement_Activity_4_20171214.pdf)> (December 14, 2017).  
 125 See "Analysis of Replacement Capacity for RPM Commitments: June 1, 2007 to June 1, 2019," <[http://www.monitoringanalytics.com/reports/Reports/2019/IMM\\_Analysis\\_of\\_Replacement\\_Capacity\\_for\\_RPM\\_Commitments\\_June\\_1\\_2007\\_to\\_June\\_1\\_2019\\_20190913.pdf](http://www.monitoringanalytics.com/reports/Reports/2019/IMM_Analysis_of_Replacement_Capacity_for_RPM_Commitments_June_1_2007_to_June_1_2019_20190913.pdf)> (September 13, 2019).  
 126 See "Analysis of the 2025/2026 RPM Base Residual Auction - Part A," <[https://www.monitoringanalytics.com/reports/Reports/2024/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_A\\_20240920.pdf](https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_A_20240920.pdf)> (September 20, 2024).  
 127 See "Analysis of the 2025/2026 RPM Base Residual Auction - Part B," <[https://www.monitoringanalytics.com/reports/Reports/2024/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_B\\_20241015.pdf](https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_B_20241015.pdf)> (October 15, 2024).

requires a capacity market. The capacity market plays the essential role of equilibrating the revenues necessary to incent competitive entry and exit of the resources needed for reliability, with the revenues from the energy market that are directly affected by nonmarket sources.

## Overview: Section 6, Demand Response

- **Demand Response Activity.** Demand response activity includes economic demand response (economic resources), emergency and pre-emergency demand response (demand resources), synchronized reserves and regulation. Economic demand response participates in the energy market. Emergency and pre-emergency demand response participates in the capacity market and energy market.<sup>128</sup> Demand response resources participate in the synchronized reserve market. Demand response resources participate in the regulation market.

Total demand response revenue decreased by \$18.1 million, 10.6 percent, from \$170.8 million in 2023 to \$152.7 million in 2024, primarily due to a decrease in capacity market prices and revenue. Emergency demand response revenue accounted for 76.4 percent of all demand response revenue, economic demand response for 7.2 percent, demand response in the synchronized reserve market for 7.2 percent and demand response in the regulation market for 9.1 percent.

Total emergency demand response revenue decreased by \$37.0 million, 24.1 percent, from \$153.7 million in 2023 to \$116.6 million in 2024.<sup>129</sup> This decrease consisted entirely of capacity market revenue.

Economic demand response revenue increased by \$7.5 million, 209.0 percent, from \$3.6 million in 2023 to \$11.0 million in 2024.<sup>130</sup> Demand response revenue in the synchronized reserve market increased by \$4.8 million, 76.7 percent, from \$6.2 million in 2023 to \$11.0 million in 2024. Demand response revenue in the regulation market increased

by \$6.7 million, 91.3 percent, from \$7.3 million in 2023 to \$14.0 million in 2024.

- **Demand Response Energy Payments are Uplift.** Energy payments to emergency and economic demand response resources are uplift. LMP does not cover energy payments although emergency and economic demand response can and does set LMP. Energy payments to emergency demand resources are paid by PJM market participants in proportion to their net purchases in the real-time market. Energy payments to economic demand resources are paid by real-time exports from PJM and real-time loads in each zone for which the load-weighted, average real-time LMP for the hour during which the reduction occurred is greater than or equal to the net benefits test price for that month.<sup>131</sup>
- **Demand Response Market Concentration.** The ownership of economic load response resources was highly concentrated in 2023 and 2024. The HHI for economic resource reductions decreased by 510 points from 9241 in 2023 to 8731 in 2024. The ownership of emergency load response resources is highly concentrated. The HHI for emergency load response committed MW was 2295 for the 2023/2024 Delivery Year. In the 2023/2024 Delivery Year, the four largest CSPs owned 85.6 percent of all committed demand response UCAP MW. The HHI for emergency demand response committed MW is 2387 for the 2024/2025 Delivery Year. In the 2024/2025 Delivery Year, the four largest CSPs own 88.5 percent of all committed demand response UCAP MW.
- **Limited Locational Dispatch of Demand Resources.** With full implementation of the Capacity Performance rules in the capacity market in the 2020/2021 Delivery Year, PJM should be able to individually dispatch any capacity performance resource, including demand resources. PJM cannot dispatch demand resources by node with the current rules because demand resources are not registered to a node. Aggregation rules allow a demand resource that incorporates many small End Use Customers to span an entire zone, which is inconsistent with nodal dispatch.
- **Energy Efficiency.** Energy efficiency resources are not capacity resources in PJM. The total MW of energy efficiency resources paid increased by 30.9 percent,

<sup>128</sup> Emergency demand response refers to both emergency and pre-emergency demand response. With the implementation of the Capacity Performance design, and prior to the July 30, 2023 FERC approved revisions to PJM's Tariff to eliminate the dispatch of demand response as a trigger for calling an emergency and for defining a Performance Assessment Interval (PAI), there is no functional difference between the emergency and pre-emergency demand response resource.

<sup>129</sup> The total credits and MWh numbers for demand resources were downloaded as of January 16, 2025, and may change as a result of continued PJM billing updates.

<sup>130</sup> Economic credits are synonymous with revenue received for reductions under the economic load response program.

<sup>131</sup> "PJM Manual 28: Operating Agreement Accounting," § 11.2.2, Rev. 98 (Dec. 17, 2024).



from 5,896.4 MW in the 2023/2024 Delivery Year to 7,716.0 MW in the 2024/2025 Delivery Year. In the 2024/2025 Delivery Year, although EE is not a capacity resource, the EE MW paid for the Delivery Year were equal to 5.0 percent of all actual cleared capacity MW.

- **Energy Efficiency Payments are a Subsidy and Uplift.** Payments from the buyers of capacity to energy efficiency providers are a subsidy and uplift. Energy efficiency is not a capacity resource and does not contribute to reliability.
- **Energy Efficiency Market Concentration.** The HHI for Energy Efficiency on an aggregate market basis shows that ownership is highly concentrated. The four largest companies typically own 90 percent or more of all paid Energy Efficiency MW. The HHI for Energy Efficiency resources also shows that ownership is highly concentrated for the 2024/2025 Delivery Year, with an HHI value of 5749. In the 2024/2025 Delivery Year, the four largest companies own 98.0 percent of all paid Energy Efficiency MW.

## Section 6 Recommendations

- The MMU recommends that PJM report the response of demand capacity resources to dispatch by PJM as the actual change in load rather than simply the difference between the amount of capacity purchased by the customer and the actual metered load. The current approach significantly overstates the response to PJM dispatch. (Priority: High. First reported 2023. Status: Not adopted.)
- The MMU recommends that demand resources offering as supply in the capacity market be required to offer a guaranteed load drop (GLD) below their PLC to ensure that demand resources provide an identifiable MW resource to PJM when called. (Priority: High. First reported 2023. Status: Not adopted.)
- The MMU recommends, as an alternative to including demand resources as supply in the capacity market, that demand resources have the option to be on the demand side of the markets, that customers be able to avoid capacity and energy charges by not using capacity and energy at their discretion, that customer payments be determined only by metered load, and that PJM forecasts immediately incorporate the impacts of demand side behavior. (Priority: High. First reported 2014. Status: Not adopted.)
- The MMU recommends that the option to specify a minimum dispatch price (strike price) for demand resources be eliminated and that participating resources receive the hourly real-time LMP less any generation component of their retail rate.<sup>132</sup> (Priority: Medium. First reported 2010. Status: Not adopted.)
- The MMU recommends that the maximum offer for demand resources be the same as the maximum offer for generation resources and that the same cost verification rules applied to generation resources apply to demand resources. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that the demand resources be treated as economic resources, responding to economic price signals like other capacity resources. The MMU recommends that demand resources not be treated as emergency resources, not trigger a PJM emergency and not trigger a Performance Assessment Interval. The MMU recommends that demand resources be available for every hour of the year. (Priority: High. First reported 2012. Status: Partially adopted.)
- The MMU recommends that the Emergency Program Energy Only option be eliminated because the opportunity to receive the appropriate energy market incentive is already provided in the economic program. (Priority: Low. First reported 2010. Status: Not adopted.)
- The MMU recommends that, if demand resources remain in the capacity market, a daily energy market must offer requirement apply to demand resources, comparable to the rule applicable to generation capacity resources.<sup>133</sup> (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that demand resources be required to provide their nodal location, comparable to generation resources. (Priority: High. First reported 2011. Status: Not adopted.)
- The MMU recommends that PJM require nodal dispatch of demand resources with no advance notice required or, if nodal location is not required,

<sup>132</sup> See "Complaint and Motion to Consolidate of the Independent Market Monitor for PJM," Docket No. EL14-20-000 (January 28, 2014), "Comments of the Independent Market Monitor for PJM," Docket No. ER15-852-000 (February 13, 2015).

<sup>133</sup> See "Complaint and Motion to Consolidate of the Independent Market Monitor for PJM," Docket No. EL14-20-000 (January 27, 2014) at 1.

subzonal dispatch of demand resources with no advance notice required. The MMU recommends that, if PJM continues to use subzones for any purpose, PJM clearly define the role of subzones in the dispatch of demand response. (Priority: High. First reported 2015. Status: Not adopted.)

- The MMU recommends that PJM not remove any defined subzones and maintain a public record of all created and removed subzones. (Priority: Low. First reported 2016. Status: Not adopted.)
- The MMU recommends that PJM eliminate the measurement of compliance across zones within a compliance aggregation area (CAA). The multiple zone approach is less locational than the zonal and subzonal approach and creates larger mismatches between the locational need for the resources and the actual response. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that measurement and verification methods for demand resources be modified to reflect compliance more accurately. (Priority: Medium. First reported 2009. Status: Not adopted.)
- The MMU recommends that compliance rules be revised to include submittal of all necessary hourly load data, and that negative values be included when calculating event compliance across hours and registrations. (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM adopt the ISO-NE five-minute metering requirements in order to ensure that operators have the necessary information for reliability and that market payments to demand resources be calculated based on interval meter data at the site of the demand reductions.<sup>134</sup> (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends demand response event compliance be calculated on a five minute basis for all capacity performance resources and that the penalty structure reflect five minute compliance. (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends that load management testing be initiated by PJM with advance notice to

<sup>134</sup> See ISO-NE Tariff, Section III, Market Rule 1, Appendix E1 and Appendix E2, "Demand Response," <[http://www.iso-ne.com/regulatory/tariff/sect\\_3/mr1\\_append-e.pdf](http://www.iso-ne.com/regulatory/tariff/sect_3/mr1_append-e.pdf)>. (Accessed October 17, 2017) ISO-NE requires that DR have an interval meter with five-minute data reported to the ISO and each behind the meter generator is required to have a separate interval meter. After June 1, 2017, demand response resources in ISO-NE must also be registered at a single node.

CSPs identical to the actual lead time required in an emergency in order to accurately represent the conditions of an emergency event. (Priority: Low. First reported 2012. Status: Partially adopted.)

- The MMU recommends that shutdown cost be defined as the cost to curtail load for a given period that does not vary with the measured reduction or, for behind the meter generators, be the start cost defined in Manual 15 for generators. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that the Net Benefits Test be eliminated and that demand response resources be paid LMP less any generation component of the applicable retail rate. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that the tariff rules for demand response clarify that a resource and its CSP, if any, must notify PJM of material changes affecting the capability of the resource to perform as registered and must terminate or modify registrations that are no longer capable of responding to PJM dispatch directives at defined levels because load has been reduced or eliminated, as in the case of bankrupt and/or out of service facilities. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that there be only one demand response product in the capacity market, with an obligation to respond when called for any hour of the delivery year. (Priority: High. First reported 2011. Status: Partially adopted.<sup>135</sup>)
- The MMU recommends that the lead times for demand resources be shortened to 30 minutes with a one hour minimum dispatch for all resources. (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends setting the baseline for measuring capacity compliance under winter compliance at the customers' PLC, similar to GLD, to avoid double counting. (Priority: High. First reported 2010. Status: Partially adopted.)
- The MMU recommends the Relative Root Mean Squared Test be required for all demand resources with a CBL. (Priority: Low. First reported 2017. Status: Partially adopted.)

<sup>135</sup> PJM's Capacity Performance design requires resources to respond when called for any hour of the delivery year, but demand resources still have a limited mandatory compliance window.

- The MMU recommends that the limits imposed on the pre-emergency and emergency demand response share of the synchronized reserve market be eliminated. (Priority: Medium. First reported 2018. Status: Adopted 2022.)
- The MMU recommends that 30 minute pre-emergency and emergency demand response be considered to be 30 minute reserves. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that energy efficiency resources (EE) not be included in the capacity market mechanism and that PJM should ensure that the impact of EE measures on the load forecast is incorporated immediately. (Priority: Medium. First reported 2018. Status: Adopted 2024.)<sup>136 137</sup>
- The MMU recommends that, if energy efficiency resources remain in the capacity market mechanism, PJM codify eligibility requirements to claim the property rights to energy efficiency installations in the tariff including a contract with the owner of every energy efficiency installation and that PJM institute a registration system to track claims to the property rights to energy efficiency installations and document installation periods of energy efficiency installations. (Priority: Medium. First reported 2022. Status: Not adopted.)
- The MMU recommends that demand reductions based entirely on behind the meter generation be capped at the lower of economic maximum or actual generation output. (Priority: High. First reported 2019. Status: Not adopted.)
- The MMU recommends that all demand resources register as Pre-Emergency Load Response and that the Emergency Load Response Program be eliminated. (Priority: High. First reported 2020. Status: Not adopted.)
- The MMU recommends that EDCs not be allowed to participate in markets as DER aggregators in addition to their EDC role. (Priority: High. First reported 2021. Status: Not adopted.)
- The MMU recommends that PJM include a 5.0 MW maximum size cap on DER aggregations. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends that PJM use a nodal approach for DER participation in PJM markets that excludes multinodal aggregation. (Priority: Medium. First reported 2022. Status: Partially adopted.)
- The MMU recommends that the Commission require PJM to include in OATT Attachment M the explicit statement that the Market Monitor's role includes the right to collect information from EDCs and DERA related to actions taken on the distribution system related to DERs. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends that PJM revise the requirements for reporting expected real time energy load reductions by CSPs to PJM to improve the accuracy and usefulness to PJM's system operators. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends that PJM define when operators can and should call on demand resources, given that a call on demand resources no longer triggers a PAI. The MMU recommends that PJM revise the performance requirements for demand resources to include an event specific measurement for dispatch occurring outside of Performance Assessment Events and penalties for nonperformance. (Priority: Medium. First reported 2023. Status: Not adopted.)

## Section 6 Conclusion

A fully functional demand side of the electricity market means that End Use Customers or their designated intermediaries will have the ability to see real-time energy price signals in real time, will have the ability to react to real-time prices in real time and will have the ability to receive the direct benefits or costs of changes in real-time energy use. In addition, customers or their designated intermediaries will have the ability to see current capacity prices, will have the ability to react to capacity prices and will have the ability to receive the direct benefits or costs of changes in the demand for capacity in the same year in which demand for capacity changes. A functional demand side of these markets means that customers will have the ability to make decisions about levels of power consumption based both on how customers value the power and on the actual cost of that power.

<sup>136</sup> 189 FERC ¶ 61,095 (2024).

<sup>137</sup> Originally incorporated with auctions conducted in 2016 for the 2016/2017 Delivery Year and forward. The mechanics of the EE addback mechanism were modified beginning with the 2023/2024 Delivery Year.



In the energy market, if there is to be a demand side program, demand resources should be paid the value of energy, which is LMP less any generation component of the applicable retail rate. There is no reason to have the net benefits test. The necessity for the net benefits test is an illustration of the illogical approach to demand side compensation embodied in paying full LMP to demand resources. The benefit of demand side resources is not that they suppress market prices, but that customers can choose not to consume at the current price of power, that individual customers benefit from their choices and that the choices of all customers are reflected in market prices. If customers face the market price, customers should have the ability to not purchase power and the market impact of that choice does not require a test for appropriateness.

If demand resources are to continue competing directly with generation capacity resources in the PJM Capacity Market, the product must be defined such that it can actually serve as a substitute for generation. This is a prerequisite to a functional market design. Demand resources do not have a must offer requirement into the day-ahead energy market, are able to offer above \$1,000 per MWh without providing a fuel cost policy, or any rationale for the offer. Demand resources do not have telemetry requirements similar to other Capacity Performance resources. Until July 30, 2023, including Winter Storm Elliott, PJM automatically, and inappropriately, triggered a PAI when demand resources were dispatched.

In order to be a substitute for generation, demand resources offering as supply in the capacity market should be required to offer a guaranteed load drop (GLD) below their PLC to ensure that demand resources provide an identifiable MW resource to PJM when called.

In order to be a substitute for generation, the ELCC for demand resources should be based on data about actual reductions in demand during high expected loss of load hours, like other capacity resources. The current DR ELCC is significantly overstated because the DR ELCC value is based on the unsupported assumption that the full amount of capacity sold will respond when called rather than on actual response data. In other words, the actual response is assumed to be perfect. The amount of capacity sold equals the PLC – the FSL for the resource. PJM has proposed to make this problem worse rather

than to correct it, by increasing the ELCC of demand resources based on assumptions rather than actual performance data.

In order to be a substitute for generation, demand resources should be defined in PJM rules as an economic resource, as generation is defined. Demand resources should be required to offer in the day-ahead energy market and should be called when the resources are required and prior to the declaration of an emergency. Demand resources should be available for every hour of the year. The fact that demand resources are only obligated to respond for defined time periods meant that PJM could not fully use demand resources during Winter Storm Elliott (Elliott). Demand resources should be treated as economic resources like any other capacity resource. Demand resources should be called whenever economic and paid the LMP rather than an inflated strike price up to \$1,849 per MWh that is set by the seller.

In order to be a substitute for generation, demand resources should be subject to robust measurement and verification techniques to ensure that transitional DR programs incent the desired behavior. The methods used in PJM programs today are not adequate to determine and quantify deliberate actions taken to reduce consumption.

In order to be a substitute for generation, demand resources should provide a nodal location and should be dispatched nodally to enhance the effectiveness of demand resources and to permit the efficient functioning of the energy market. Both subzonal and multi-zone compliance should be eliminated because they are inconsistent with an efficient nodal market.

In order to be a substitute for generation, compliance by demand resources with PJM dispatch instructions should include both increases and decreases in load. Compliance of demand resources for capacity purposes during a Performance Assessment Event is measured relative to either Peak Load Contribution or Winter Peak Load, which are static values. If a demand resource's metered load increases above these reference values during a PAI, the current method applied by PJM simply ignores increases in load and thus artificially overstates compliance.<sup>138</sup>

<sup>138</sup> See PJM MC Webinar, Market Monitor Report <<https://pjm.com/-/media/committees-groups/committees/mc/2023/20230620-webinar/item-04---imm-report.ashx>> (June 20, 2023).

In order to be a substitute for generation, Actual Performance of demand resources during a Performance Assessment Event should be determined consistent with that of generation and should not be netted across the Emergency Action Area (EAA). The Capacity Market Seller's Performance Shortfalls for Demand Resources in the EAA are netted to determine a net EAA Performance Shortfall for the Performance Assessment Interval. Any net positive EAA Performance Shortfall is allocated to the Capacity Market Seller's demand resources that under complied within the EAA on a prorata basis based on the under compliance MW, and such seller's demand resources will be assessed a Performance Shortfall for the Performance Assessment Interval. Any net negative EAA Performance Shortfall is allocated to the Market Seller's Demand Resources that over complied within the EAA on a prorata basis based on over compliance MW, and such Market Seller's Demand Resources will be assessed Bonus Performance. Netting of performance of Demand Resources across the EAA is inconsistent with the performance measurement of other Capacity Performance resources.

In order to be a substitute for generation, any demand resource and its Curtailment Service Provider (CSP), should be required to notify PJM of material changes affecting the capability of the resource to perform as registered and to terminate or modify registrations that are no longer capable of responding to PJM dispatch directives at the specified level, such as in the case of bankrupt and out of service facilities. Generation resources are required to inform PJM of any change in availability status, including outages and shutdown status.

As an alternative to being a substitute for generation in the capacity market, demand response resources should have the option to be on the demand side of the capacity market rather than on the supply side. Rather than detailed demand response programs with their attendant complex and difficult to administer rules, customers would be able to avoid capacity and energy charges by not using capacity and energy at their discretion and the level of usage paid for would be defined by metered usage rather than a complex and inaccurate measurement protocol, and PJM forecasts would immediately incorporate the impacts of demand side behavior.

The MMU peak shaving proposal at the Summer-Only Demand Response Senior Task Force (SODRSTF) is an example of how to create a demand side product that is on the demand side of the market and not on the supply side.<sup>139</sup> The MMU proposal was based on the BGE load forecasting program and the Pennsylvania Act 129 Utility Program.<sup>140 141</sup> Under the MMU proposal, participating load would inform PJM prior to an RPM auction of the MW participating, the months and hours of participation and the temperature humidity index (THI) threshold at which load would be reduced. PJM would reduce the load forecast used in the RPM auction based on the designated reductions. Load would agree to curtail demand to at or below a defined FSL, less than the customer PLC, when the THI exceeds a defined level or load exceeds a specified threshold. By relying on metered load and the PLC, load can reduce its demand for capacity and that reduction can be verified without complicated and inaccurate metrics to estimate load reductions. Under PJM's weakened version of the program, performance is measured under the current economic demand response CBL rules which means relying on load estimates rather than actual metered load.<sup>142</sup> PJM's proposal includes only a THI curtailment trigger and not an overall load curtailment trigger.

The long term appropriate end state for demand resources in the PJM markets should be comparable to the demand side of any market. Customers should use energy as they wish, accounting for market prices in any way they like, and that usage will determine the amount of capacity and energy for which each customer pays. There would be no counterfactual measurement and verification.

Under this approach, customers that wish to avoid capacity payments would reduce their load during expected high load hours, not limited to a small number of peak hours. Capacity costs would be assigned to LSEs and by LSEs to customers, based on actual load on the system during these hours. Customers wishing to avoid high energy prices would reduce their load during high price hours. Customers would pay for what they actually use, as measured by meters, rather than relying

<sup>139</sup> See the MMU package within the SODRSTF Matrix, <<http://www.pjm.com/-/media/committees-groups/task-forces/sodrستف/20180802/20180802-item-04-sodrستف-matrix.ashx>>.

<sup>140</sup> Advance signals that can be used to foresee demand response days, BGE, <<https://www.pjm.com/-/media/committees-groups/task-forces/sodrستف/20180309/20180309-item-05-bge-load-curtailment-programs.ashx>> (March 9, 2018).

<sup>141</sup> Pennsylvania ACT 129 Utility Program, CPower, <<https://www.pjm.com/-/media/committees-groups/task-forces/sodrستف/20180413/20180413-item-03-pa-act-129-program.ashx>> (April 13, 2018).

<sup>142</sup> The PJM proposal from the SODRSTF weakened the proposal but was approved at the October 25, 2018 Members Committee meeting and PJM filed Tariff changes on December 7, 2018. See "Peak Shaving Adjustment Proposal," Docket No. ER19-511-000 (December 7, 2018).

on flawed measurement and verification methods. No measurement and verification estimates are required. No promises of future reductions which can only be verified by inaccurate and biased measurement and verification methods are required. To the extent that customers enter into contracts with CSPs or LSEs to manage their payments, measurement and verification can be negotiated as part of a bilateral commercial contract between a customer and its CSP or LSE. But the system would be paid for actual, metered usage, regardless of which contractual party takes that obligation.

This approach provides more flexibility to customers to limit usage at their discretion. There is no requirement to be available year round or every hour of every day. There is no 30 minute notice requirement. There is no requirement to offer energy into the day-ahead market. All decisions about interrupting are up to the customers only and they may enter into bilateral commercial arrangements with CSPs at their sole discretion. Customers would pay for capacity and energy depending solely on metered load.

A transition to this end state should be defined in order to ensure that appropriate levels of demand side response are incorporated in PJM's load forecasts and thus in the demand curve in the capacity market. That transition should be defined by the PRD rules, modified as proposed by the MMU.

This approach would work under the CP design in the capacity market. This approach is entirely consistent with the Supreme Court decision in *EPSCA* as it does not depend on whether FERC has jurisdiction over the demand side.<sup>143</sup> This approach will allow FERC to more fully realize its overriding policy objective to create competitive and efficient wholesale energy markets. The decision of the Supreme Court addressed jurisdictional issues and did not address the merits of FERC's approach. The Supreme Court's decision has removed the uncertainty surrounding the jurisdictional issues and created the opportunity for FERC to revisit its approach to demand side.

Any discussion of demand resource performance during a PAI must recognize the significant problems with the definition of performance for demand resources. As defined by PJM rules, performance, contrary to intuition, does not mean actually reducing load in response to

a PJM request for demand resources. Performance means only that, on a net portfolio basis, the amount of capacity paid for in the capacity market (PLC) minus actual metered load is equal to the amount of demand side capacity sold in the capacity market (ICAP). If a demand resource location was already at a reduced load level when PJM called a PAI, the demand resource would be deemed to have performed if the PLC less the metered load level was equal to the ICAP sold in the capacity market. The standard reporting of demand side response is therefore misleading because it includes loads that were already lower for any reason as a response. That is exactly what happened during Elliott.

## Overview: Section 7, Net Revenue

### Net Revenue

- Energy market net revenues are significantly affected by energy prices and fuel prices. Energy prices and eastern gas prices increased and western gas and coal prices decreased in 2024 compared to 2023. The net effects were that in 2024, average energy market theoretical net revenues increased by 21 percent for a new combustion turbine (CT), increased by 9 percent for a new combined cycle (CC), increased by 67 percent for a new coal plant (CP), increased by 4 percent for a new nuclear plant, increased by 313 percent for a new diesel (DS), increased by 6 percent for a new onshore wind installation, increased by 12 percent for a new offshore wind installation and increased by 17 percent for a new solar installation.
- The price of eastern natural gas increased and the prices of western natural gas and coal decreased in 2024. The marginal costs of a new CC and CT were greater than the marginal cost of a new CP only in January 2024.
- In 2024, spark spreads and dark spreads and the volatility of spark spreads and dark spreads increased in BGE, COMED, PSEG and Western Hub compared to 2023.
- In 2024, capacity market revenue accounted for 21 percent of theoretical total net revenues for a new CT, 16 percent for a new CC, 37 percent for a new CP, 6 percent for a new nuclear plant, 62 percent for a new DS, 2 percent for a new onshore wind installation, 3 percent for a new offshore

<sup>143</sup> 577 U.S. 260 (2016).

wind installation and 3 percent for a new solar installation.

- In 2024, no new CT, CC, CP, nuclear, or DS units would have received sufficient total net revenue to cover levelized total costs in any zone.
- In 2024, a theoretical new entrant onshore wind installation would not have received sufficient net revenue to cover levelized total costs in any of the four zones analyzed. Renewable energy credits (RECs) were an average of 54 percent of the total net revenue of an onshore wind installation.
- In 2024, a theoretical new entrant offshore wind installation would not have received sufficient net revenue to cover levelized total costs in any of the three zones analyzed. Renewable energy credits were an average of 50 percent of the total net revenue of an offshore wind installation.
- In 2024, a theoretical new entrant solar installation would have received sufficient net revenue to cover more than 100 percent of levelized total costs in ACEC, JCPLC and PSEG and between 82 and 97 percent of levelized total costs in DPL and DOM. Renewable energy credits were an average of 74 percent of the total net revenue of a solar installation.
- In 2024, most units did not achieve full recovery of avoidable costs through net revenue from energy and ancillary services markets alone, illustrating the critical role of the capacity market in providing incentives for continued operation and investment. In 2024, capacity market revenue was sufficient to cover the shortfall between net energy revenue and avoidable costs for the majority of units and technology types in PJM, with the exception of coal and CT units.
- Of the 16 PJM nuclear plants analyzed, all are expected to cover their avoidable costs from energy and capacity market revenues in 2025 and 2026, without any subsidies.
- New entrant solar and wind resources are competitive with existing coal resources, including the effect of current federal tax subsidies and RECs revenues available to the intermittent resources.
- Between 30,633 and 34,733 MW of capacity are at risk of retirement by 2030, consisting of 4,684 MW currently announced retirements, 16,786

MW expected to retire for regulatory reasons, and between 9,163 and 13,264 MW expected to be uneconomic. This capacity consists primarily of coal plants and CT units. Replacing the capacity of the retiring non-gas resources with gas-fired capacity would require between 1.5 and 1.7 BCF/day of new firm gas supply depending on the MW at risk and the extent to which new gas fired capacity is dual fuel.

## Section 7 Recommendations

- The MMU recommends that the net revenue calculation used by PJM to calculate the net Cost of New Entry (CONE) and net ACR be based on a forward looking calculation of expected energy and ancillary services net revenues using historical revenues that are scaled based on forward prices for energy and fuel. (Priority: Medium. First reported 2019. Status: Not adopted.)

## Section 7 Conclusion

Wholesale electric power markets are affected by externally imposed reliability requirements. A regulatory authority external to the market makes a determination as to the acceptable level of reliability which is enforced through a requirement to maintain a target level of installed or unforced capacity. The requirement to maintain a target level of installed capacity can be enforced via a variety of mechanisms, including government construction of generation, full requirement contracts with developers to construct and operate generation, state utility commission mandates to construct capacity, or capacity markets of various types. Regardless of the enforcement mechanism, the exogenous requirement to construct capacity in excess of what is constructed in response to energy market signals alone has an impact on energy markets. The reliability requirement results in maintaining a level of capacity in excess of the level that would result from the operation of an energy market alone. The result of that additional capacity is to reduce the level and volatility of energy market prices and to reduce the duration of high energy market prices. This, in turn, reduces net revenue to generation owners which reduces the incentive to invest. The exact level of both aggregate and locational excess capacity is a function of the calculation methods used by RTOs and ISOs. A basic purpose of the capacity market is to allow all cleared capacity resources the



opportunity to cover their net avoidable costs on an annual basis to ensure the economic sustainability of the reliable energy market.

PJM's introduction of a form of ELCC for defining available capacity has made the definition of reliability less clear. The reduction of ELCC derated capacity is volatile and subject to changes for reasons that are not clear to generation owners or other market participants.

## Overview: Section 8, Environmental and Renewables

### Federal Environmental Regulation

- **MATS.** The U.S. Environmental Protection Agency's (EPA) Mercury and Air Toxics Standards rule (MATS) applies the Clean Air Act (CAA) maximum achievable control technology (MACT) requirement to new or modified sources of emissions of mercury and arsenic, acid gas, nickel, selenium and cyanide.<sup>144</sup> On April 24, 2024, the EPA finalized a strengthened and updated MATS rule reflecting recent developments in control technologies and the performance of coal fired plants.<sup>145</sup>
- **Air Quality Standards (NO<sub>x</sub> and SO<sub>2</sub> Emissions).** The CAA requires each state to attain and maintain compliance with fine particulate matter (PM) and ozone national ambient air quality standards (NAAQS). The CAA also requires that each state prohibit emissions that significantly interfere with the ability of another state to meet NAAQS.<sup>146</sup> (Transport Rule) On March 15, 2021, the EPA finalized decreases to allowable emissions under the Cross-State Air Pollution Rule (CSAPR) and the 2008 ozone NAAQS for 10 PJM states.<sup>147</sup> On February 28, 2022, the EPA issued a federal implementation plan for implementation of CSAPR (also known as the Good Neighbor Plan),<sup>148</sup> which applies when no state implementation plan has been approved. On June 27, 2024, the Supreme Court of the United States granted a stay of the federal implementation

plan pending judicial review.<sup>149</sup> The effect of the stay is to eliminate the ozone season NO<sub>x</sub> emissions budgets for electric generating units in the PJM states. Unless and until the stay is lifted, no federal implementation plan is effective in PJM states and the state emissions budgets are not effective. The EPA had previously rejected all proposed state implementation plans for PJM states.

- **NSR.** The CAA's NSR program is a preconstruction permitting program that requires certain stationary sources of air pollution to obtain permits prior to beginning construction. Parts C and D of Title I of the CAA provide for New Source Review (NSR) in order to prevent new projects and projects receiving major modifications from increasing emissions in areas currently meeting NAAQS or from inhibiting progress in areas that do not.<sup>150</sup> NSR requires permits before construction commences. NSR review applies a two part analysis to projects at facilities such as power plants, some of which involve multiple units and combinations of new and existing units.<sup>151</sup>
- **RICE.** Stationary reciprocating internal combustion engines (RICE) are electrical generation facilities like diesel engines typically used for backup, emergency or supplemental power. RICE must be tested annually.<sup>152</sup> RICE do not have to meet the same emissions standards if they are stationary emergency RICE. Environmental regulations allow stationary emergency RICE participating in demand response programs to operate for up to 100 hours per calendar year when providing emergency demand response when there is a PJM declared NERC Energy Emergency Alert Level 2 or there are five percent voltage/frequency deviations.

PJM does not prevent stationary emergency RICE that cannot meet its capacity market obligations as a result of EPA emissions standards from participating in PJM markets as DR. Some stationary emergency RICE that cannot meet its capacity market obligations as a result of emissions standards are now included in DR portfolios. Stationary emergency RICE should be prohibited from participation as DR either when registered individually or as part of a portfolio if it cannot meet its capacity market obligations as a result of emissions standards.

<sup>144</sup> See *National Emission Standards for Hazardous Air Pollutants From Coal and Oil-Fired Electric Utility Steam Generating Units and Standards of Performance for Fossil Fuel Fired Electric Utility, Industrial-Commercial-Institutional, and Small Industrial-Commercial-Institutional Steam Generating Units*, EPA Docket No. EPA-HQ-OAR-2009-0234, 77 Fed. Reg. 9304 (Feb. 16, 2012).

<sup>145</sup> See *National Emission Standards for Hazardous Air Pollutants: Coal- and Oil-Fired Electric Utility Steam Generating Units Review of the Residual Risk and Technology Review, Final Rule*, Docket No. EPA-HQ-OAR-2018-0794, 89 Fed. Reg. 38508 (May 7, 2024).

<sup>146</sup> CAA § 110(a)(2)(D)(i)(I).

<sup>147</sup> *Revised Cross-State Air Pollution Rule Update for the 2008 Ozone NAAQS*, Docket No. EPA-HQ-OAR-2020-0272; FRL-10013-42- OAR, 85 Fed. Reg. 23054 (Apr. 30, 2021).

<sup>148</sup> See *Federal Implementation Plan Addressing Regional Ozone Transport for the 2015 Ozone National Ambient Air Quality Standard*, Docket No. EPA-HQ-OAR-2021-0668; FRL 8670-01- OAR, 87 Fed. Reg. 20036 (April 6, 2022).

<sup>149</sup> *Ohio v. EPA*, Slip Op. No. 23A349. (S. Ct. June 27, 2024); *Utah v. EPA*, D.C. Cir. Case No. Case No. 23-1157, et al.

<sup>150</sup> 42 U.S.C § 7470 et seq.

<sup>151</sup> 40 CFR § 52.21.

<sup>152</sup> See 40 CFR § 63.6640(f).

- **Greenhouse Gas Emissions.** On April 25, 2024, the EPA issued a rule (called “Carbon Emissions Rule” in this report) taking four separate actions under CAA § 111(a)(1) addressing greenhouse gas (GHG) emissions from fossil fuel-fired electric generating units (EGUs):<sup>153</sup> the rule repeals the Affordable Clean Energy (ACE) Rule; the rule finalizes emission guidelines for GHG emissions from existing coal fired and oil/gas fired steam generating EGUs; the rule revises the New Source Performance Standards (NSPS) for GHG emissions from new and reconstructed fossil fuel-fired stationary combustion turbine EGUs; the rule revises the NSPS for GHG emissions from fossil fuel-fired steam generating units that undertake a large modification, based upon the 8-year review required by the CAA. The rule deferred action on emission guidelines for GHG emissions from existing fossil fuel-fired stationary combustion turbines.

The Carbon Emissions Rule reflects the application of the best system of emission reduction (BSER). The proposal includes emission guidelines for GHG emissions from existing fossil fuel-fired steam generating EGUs (including coal, oil or gas). For coal fired EGUs, compliance is required by January 1, 2030, with standards that vary based on whether the EGU commits to retire before 2032, 2035, 2040, or does not commit to retire before 2040.<sup>154</sup> The EPA proposes to repeal the Affordable Clean Energy Rule.<sup>155</sup>

- **Cooling Water Intakes.** An EPA rule implementing Section 316(b) of the Clean Water Act (CWA) requires that cooling water intake structures reflect the best technology available for minimizing adverse environmental impacts.<sup>156</sup>
- **Waters of the United States.** On August 29, 2023, the EPA issued a final rule defining adjacent wetlands consistent with the Supreme Court holding that an adjacent wetland is “... a relatively permanent body of water connected to traditional interstate navigable waters ... and ... that the wetland has a

continuous surface connection with that water.”<sup>157</sup> The rule became effective on September 8, 2023.<sup>158</sup>

- **Effluents.** Under the CWA, the EPA regulates (National Pollutant Discharge Elimination System (NPDES)) discharges from and intakes to power plants, including water cooling systems at steam electric power generating stations. Since 2015, the EPA has been strengthening certain discharge limits applicable to steam generating units, and some plant owners have already indicated an intent to close certain generating units as a result. In May 2024, the EPA finalized a rule strengthening regulation of effluent discharges.<sup>159</sup>
- **Coal Ash.** The EPA administers the Resource Conservation and Recovery Act (RCRA), which governs the disposal of solid and hazardous waste.<sup>160</sup> The EPA has adopted significant changes to the implementing regulations that will require closing noncompliant impoundments, and, as a result, the host power plant. The EPA is implementing a process for extensions to as late as October 17, 2028. The EPA is reviewing applications received from PJM plant owners for extensions of the deadline for compliance with the revised Coal Combustion Residuals Rule.

## State Environmental Regulation

- **Regional Greenhouse Gas Initiative (RGGI).** The Regional Greenhouse Gas Initiative (RGGI) is a CO<sub>2</sub> emissions cap and trade agreement among Connecticut, Delaware, Maine, Maryland, Massachusetts, New Hampshire, New Jersey, New York, Rhode Island, and Vermont that applies to power generation facilities. The RGGI auction price in the December 4, 2024, RGGI auction was \$20.05 per short ton, or \$22.10 per metric tonne.
- **Illinois Climate and Equitable Jobs Act (CEJA).** On September 16, 2021, the Climate and Equitable Jobs Act (CEJA) became effective. CEJA created an expanded nuclear subsidy program. CEJA mandated that all fossil fuel plants close by 2045. CEJA established emissions caps for investor owned, gas-fired units with three years of operating

<sup>153</sup> See *New Source Performance Standards for Greenhouse Gas Emissions From New, Modified, and Reconstructed Fossil Fuel-Fired Electric Generating Units; Emission Guidelines for Greenhouse Gas Emissions From Existing Fossil Fuel-Fired Electric Generating Units; and Repeal of the Affordable Clean Energy Rule*, Proposed Rule, Docket No. EPA-HQ-OAR-2023-0072, 89 Fed. Reg. 39798 (May 9, 2024) (“Carbon Emissions Rule”).

<sup>154</sup> Carbon Emissions Rule at 33371–33373.

<sup>155</sup> Carbon Emissions Rule at 33243.

<sup>156</sup> See EPA, *National Pollutant Discharge Elimination System—Final Regulations to Establish Requirements for Cooling Water Intake Structures at Existing Facilities and Amend Requirements at Phase I Facilities*, EPA-HQ-OW-2008-0667, 79 Fed. Reg. 48300 (August 15, 2014).

<sup>157</sup> See Revised Definition of “Waters of the United States,” EPA-HQ-OW-2023-0346, 88 Fed. Reg. 61964 (September 8, 2023).

<sup>158</sup> See *id.*

<sup>159</sup> See *Supplemental Effluent Limitations Guidelines and Standards for the Steam Electric Power Generating Point Source Category*, Final Rule, EPA Docket No. EPA-HQ-OW-2009-0819; FRL-8794-01–OW, 89 Fed. Reg. 40199 (May 9, 2024).

<sup>160</sup> 42 U.S.C. §§ 6901 *et seq.*



history, effective October 1, 2021, on a rolling 12 month basis. More than 10,000 MW of capacity are currently affected. The CEJA operating hour limits have resulted in significant opportunity cost adders to cost-based energy market offers for affected units.

- **Carbon Price.** If the price of carbon were \$50.00 per metric tonne, short run marginal costs would have increased by \$24.45 per MWh or 93.3 percent for a new combustion turbine (CT) unit, \$16.85 per MWh or 86.5 percent for a new combined cycle (CC) unit and \$43.12 per MWh or 116.6 percent for a new coal plant (CP) for 2024.

## State Renewable Portfolio Standards

- **RPS.** In PJM, ten of 14 jurisdictions have enacted legislation requiring that a defined percentage of retail suppliers' load be served by renewable resources, for which definitions vary. These are typically known as renewable portfolio standards, or RPS. As of December 31, 2024, Delaware, Illinois, Maryland, Michigan, New Jersey, North Carolina, Ohio, Pennsylvania, Virginia and Washington, DC have renewable portfolio standards. Indiana has a voluntary renewable portfolio standard. Kentucky, Tennessee and West Virginia do not have renewable portfolio standards.
- **RPS Cost.** The cost of complying with RPS, as reported by the states, is \$11.8 billion over the nine year period from 2014 through 2022, an average annual RPS compliance cost of \$1.3 billion. The compliance cost for 2022, the most recent year with almost complete data, was \$2.4 billion.<sup>161</sup>

## Emissions Controls in PJM Markets

- **Regulations.** Environmental regulations affect decisions about emission control investments in existing units, investment in new units and decisions to retire units. As a result of environmental regulations and agreements to limit emissions, many PJM units burning fossil fuels have installed emission control technology.
- **Emissions Controls.** In PJM, as of December 31, 2024, 97.4 percent of coal steam MW had some type of flue-gas desulfurization (FGD) technology to reduce

SO<sub>2</sub> emissions, 99.8 percent of coal steam MW had some type of particulate matter (PM) control, and 99.8 percent of coal steam MW had NO<sub>x</sub> emission control technology. All coal steam units in PJM are compliant with the state and federal emissions limits established by MATS.

## Renewable Generation

- **Renewable Generation.** Wind and solar generation was 5.8 percent of total generation in PJM for 2024. RPS Tier I generation was 7.0 percent of total generation in PJM and RPS Tier II generation was 1.7 percent of total generation in PJM for 2024. Only Tier I generation is defined to be renewable but Tier 1 includes some carbon emitting generation.
- PJM states with RPS rely heavily on imports and generation from behind the meter resources for RPS compliance. In 2024, Tier I generation from PJM generators met only 46.9 percent of the Tier I RPS requirements.

## Section 8 Recommendations

- The MMU recommends that renewable energy credit markets based on state renewable portfolio standards be brought into PJM markets as they are an increasingly important component of the wholesale energy market. The MMU recommends that there be a single PJM operated forward market for RECs, for a single product based on a common set of state definitions of renewable technologies, with a single clearing price, trued up to real-time delivery. (Priority: High. First reported 2010. Status: Not adopted.)
- The MMU recommends that jurisdictions with a renewable portfolio standard make the price and quantity data on supply and demand more transparent. (Priority: Low. First reported 2018. Status: Not adopted.)
- The MMU recommends that the Commission reconsider its disclaimer of jurisdiction over RECs markets because, given market changes since that decision, it is clear that RECs materially affect jurisdictional rates. (Priority: Low. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM provide a full analysis of the impact of carbon pricing on PJM generating units and carbon pricing revenues

<sup>161</sup> The 2022 compliance cost value for PJM states does not include Delaware, Michigan or North Carolina. Based on past data these states generally account for approximately 2.0 percent of the total RPS compliance cost of PJM states.

to the PJM states in order to permit the states to consider a potential agreement on the development of a multistate framework for carbon pricing and the distribution of carbon revenues. (Priority: High. First reported 2018. Status: Not adopted.)

- The MMU recommends that load and generation located at separate nodes be treated as separate resources in order to ensure that load and generation face consistent incentives throughout the markets. (Priority: High. First reported 2019. Status: Not adopted.)
- The MMU recommends that stationary emergency RICE be prohibited from participation as DR either when registered individually or as part of a portfolio if it cannot meet the capacity market requirements to be DR as a result of emissions standards that impose environmental run hour limitations. (Priority: Medium. First reported 2019. Status: Not adopted.)

## Section 8 Conclusion

Environmental requirements and renewable energy mandates at both the federal and state levels have a significant impact on the cost of energy and capacity in PJM markets.

Environmental requirements and initiatives at both the federal and state levels, and state renewable energy mandates and associated subsidies have resulted in the construction of substantial amounts of renewable capacity in the PJM footprint, especially wind and solar resources, and the retirement of emitting resources. Renewable energy credit (REC) markets created by state programs, federal subsidies, and federal tax credits have significant impacts on PJM wholesale markets. But state renewables programs in PJM are not coordinated with one another, are generally not consistent with the PJM market design or PJM prices, have widely differing objectives, including supporting some emitting resources, have widely differing implied prices of carbon and are not transparent on pricing and quantities. The effectiveness of state renewables programs would be enhanced if they were coordinated with one another and with PJM markets, and if they increased transparency. States could evaluate the impacts of a range of carbon prices if PJM would provide a full analysis of the impact of carbon pricing on PJM generating units and carbon pricing revenues to the PJM states in order to

permit the states to consider a potential agreement on the development of a multistate framework for carbon pricing and the distribution of carbon revenues. A single carbon price across PJM, established by the states, would be the most efficient way to reduce carbon output, if that is the goal.

In the absence of a PJM market carbon price, a single PJM market for RECs would contribute significantly to market efficiency and to the procurement of renewable resources in a least cost manner. Ideally, there would be a single PJM operated forward market for RECs, for a single product based on a common set of state definitions of renewable technologies, with a single clearing price, trued up to real-time delivery. States would continue to have the option to create separate RECs for additional products that did not fit the product definition, e.g. waste coal, trash incinerators, or black liquor.

RECs are an important mechanism used by PJM states to implement environmental policy. RECs clearly affect prices in the PJM wholesale power market. Some resources are not economic except for the ability to purchase or sell RECs. RECs provide out of market payments to qualifying renewable resources, primarily wind and solar. The credits provide an incentive to make negative energy offers and more generally provide an incentive to enter the market, to remain in the market and to operate whenever possible. These subsidies affect the offer behavior and the operational behavior of these resources in PJM markets and in some cases the existence of these resources and thus the market prices and the mix of clearing resources.

RECs markets are, as an economic fact, integrated with PJM markets including energy and capacity markets, but are not formally recognized as part of PJM markets. It would be preferable to have a single, transparent market for RECs operated by the PJM RTO on behalf of the states that would meet the standards and requirements of all states in the PJM footprint. This would provide better information for market participants about supply and demand and prices and contribute to a more efficient and competitive market and to better price formation. This could also facilitate entry by qualifying renewable resources by reducing the risks associated with lack of transparent market data.

Existing REC markets are not consistently or adequately transparent. Data on REC prices, clearing quantities and

markets are not publicly available for all PJM states. The economic logic of RPS programs and the associated REC and SREC prices is not always clear. The price of carbon implied by REC prices ranges from \$13.40 per tonne in Ohio to \$63.85 per tonne in Virginia. The price of carbon implied by SREC prices ranges from \$74.65 per tonne in Pennsylvania to \$783.72 per tonne in Washington, DC. The effective prices for carbon compare to the RGGI clearing price in December 2024 of \$22.10 per tonne and to the social cost of carbon which is estimated in the range of \$50 per tonne.<sup>162</sup> <sup>163</sup> The impact on the cost of generation from a new combined cycle unit of a \$50 per tonne carbon price would be \$16.85 per MWh.<sup>164</sup> The impact of an \$800 per tonne carbon price would be \$269.59 per MWh. This wide range of implied carbon prices is not consistent with an efficient, competitive, least cost approach to the reduction of carbon emissions.

In addition, even the explicit environmental goals of RPS programs are not clear. While RPS is frequently considered to target carbon emissions, Tier 1 resources include some carbon emitting generation and Tier 2 resources include additional carbon emitting generation.

PJM markets provide a flexible mechanism for incorporating the costs of environmental controls and meeting environmental requirements in a cost effective manner. Costs for environmental controls are part of offers for capacity resources in the PJM Capacity Market. The costs of emissions credits are included in energy offers. PJM markets also provide a flexible mechanism that incorporates renewable resources and the impacts of renewable energy credit markets, and ensures that renewable resources have access to a broad market. PJM markets provide efficient price signals that permit valuation of resources with very different characteristics when they provide the same product.

If the states chose this policy option, PJM markets could also provide a flexible mechanism to limit carbon output, for example by incorporating a consistent carbon price in unit offers which would be reflected in PJM's economic dispatch. If there is a social decision to

limit carbon output, a consistent carbon price would be the most efficient way to implement that decision. The states in PJM could agree, if they decided it was in their interests, with the appropriate information, on a carbon price and on how to allocate the revenues from a carbon price that would make all states better off. A mechanism like RGGI leaves all decision making with the states. The carbon price would not be FERC jurisdictional or subject to PJM decisions. The MMU continues to recommend that PJM provide a full analysis of the impact of carbon pricing on PJM generating units and carbon pricing revenues to the PJM states in order to permit the states to consider a potential agreement on the development of a multistate framework for carbon pricing and the distribution of carbon revenues. The results of the analysis would include the impact on the dispatch of every unit, the impact on energy prices and the carbon pricing revenues that would flow to each state.

For example, states receiving high levels of revenue could shift revenue to states disproportionately hurt by a carbon price if they believed that all states would be better off as a result. A carbon price would also be an alternative to specific subsidies to individual nuclear power plants and to the current wide range of implied carbon prices embedded in RPS programs and instead provide a market signal to which any resource could respond. The imposition of specific and prescriptive environmental dispatch rules would, in contrast, pose a threat to economic dispatch and efficient markets and create very difficult market power monitoring and mitigation issues. The provision of subsidies to individual units creates a discriminatory regime that is not consistent with competition. The use of inconsistent implied carbon prices by state is also inconsistent with an efficient market and inconsistent with the least cost approach to meeting state environmental goals.

The annual average cost of complying with RPS over the nine year period from 2014 through 2022 for the ten jurisdictions that had RPS was \$1.3 billion, or a total of \$11.8 billion over nine years. The RPS compliance cost for 2022, the most recent year for which there is almost complete data, was \$2.4 billion.<sup>165</sup> RPS costs are payments by customers to the sellers of qualifying resources. The revenues from carbon pricing flow to the states.

<sup>162</sup> "Technical Update of the Social Cost of Carbon for Regulatory Impact Analysis – Under Executive Order 12899," Interagency Working Group on the Social Cost of Greenhouse Gases, United States Government, (Aug. 2016), <[https://19january2017snapshot.epa.gov/sites/production/files/2016-12/documents/sc\\_co2\\_tsd\\_august\\_2016.pdf](https://19january2017snapshot.epa.gov/sites/production/files/2016-12/documents/sc_co2_tsd_august_2016.pdf)>.

<sup>163</sup> A recent update by the EPA estimates the social cost of carbon emissions for 2030 to be between \$140 and \$380 per metric ton (2020 dollars). See Table ES.1 in Report on the Social Cost of Greenhouse Gases, U.S. Environmental Protection Agency (November 2023) <<https://www.epa.gov/environmental-economics/scghg>>.

<sup>164</sup> The cost impact calculation assumes a heat rate of 6.296 MMBtu per MWh and a carbon emissions rate of 52.91 kg per MMBtu. The \$800 per tonne carbon price represents the approximate upper end of the carbon prices implied by the 2022 REC and SREC prices in the PJM jurisdictions with RPS. Additional cost impacts are provided in Table 8-7.

<sup>165</sup> The 2022 compliance cost value for PJM states does not include Delaware, Michigan or North Carolina. Based on past data these states generally account for approximately 2.0 percent of the total RPS compliance cost of PJM states.

If all the PJM states participated in a regional carbon market, the estimated revenue returned to the states/customers from selling carbon allowances would be approximately \$7.0 billion per year if the carbon price were \$20.05 per short ton and emissions levels were five percent below 2022 emission levels. If all the PJM states participated in a regional carbon market, the estimated revenue returned to the states/customers from selling carbon allowances would be approximately \$17.5 billion if the carbon price were \$50 per short ton and emission levels were five percent below 2022 levels. If only the current RPS states participated in a regional carbon market, the estimated revenue returned to the states/customers from selling carbon allowances at \$20.05 per short ton would be about \$4.6 billion. The costs of a carbon price are the impact on energy market prices, net of the revenue returned to states/customers.

## Overview: Section 9, Interchange Transactions

### Interchange Transaction Activity

- **Aggregate Imports and Exports in the Real-Time Energy Market.** In 2024, PJM was a monthly net exporter of energy in the real-time energy market in all months.<sup>166</sup> In 2024, the real-time net interchange was -32,692.0 GWh. The real-time net interchange in 2023 was -38,897.2 GWh.
- **Aggregate Imports and Exports in the Day-Ahead Energy Market.** In 2024, PJM was a monthly net exporter of energy in the day-ahead energy market in all months. In 2024, the total day-ahead net interchange was -29,489.4 GWh. The day-ahead net interchange in 2023 was -34,267.2 GWh.
- **Aggregate Imports and Exports in the Day-Ahead and the Real-Time Energy Market.** In 2024, gross imports in the day-ahead energy market were 75.6 percent of gross imports in the real-time energy market (107.3 percent in 2023). In 2024, gross exports in the day-ahead energy market were 85.5 percent of the gross exports in the real-time energy market (91.7 percent in 2023).
- **Interface Imports and Exports in the Real-Time Energy Market.** In 2024, there were net scheduled exports at 13 of PJM's 19 interfaces in the real-time energy market.
- **Interface Pricing Point Imports and Exports in the Real-Time Energy Market.** In 2024, there were net scheduled exports at five of PJM's seven interface pricing points eligible for real-time transactions in the real-time energy market.
- **Interface Imports and Exports in the Day-Ahead Energy Market.** In 2024, there were net scheduled exports at 14 of PJM's 19 interfaces in the day-ahead energy market.
- **Interface Pricing Point Imports and Exports in the Day-Ahead Energy Market.** In 2024, there were net scheduled exports at six of PJM's seven interface pricing points eligible for day-ahead transactions in the day-ahead energy market.
- **Up To Congestion Interface Pricing Point Imports and Exports in the Day-Ahead Energy Market.** In 2024, up to congestion transactions were net exports at four of PJM's seven interface pricing points eligible for day-ahead transactions in the day-ahead energy market.
- **Inadvertent Interchange.** In 2024, net scheduled interchange was -32,692.0 GWh and net actual interchange was -32,867.8 GWh, a difference of 175.8 GWh. In 2023, the difference was 106.5 GWh. This difference is inadvertent interchange.
- **Loop Flows.** In 2024, the Northern Indiana Public Service (NIPS) Interface had the largest loop flows of any interface with -480.1 GWh of net scheduled interchange and -12,826.2 GWh of net actual interchange, a difference of 12,346.1 GWh. In 2024, the SOUTH interface pricing point had the largest loop flows of any interface pricing point with 6,048.2 GWh of net scheduled interchange and 14,666.0 GWh of net actual interchange, a difference of 8,617.8 GWh.

### Interactions with Bordering Areas

#### PJM Interface Pricing with Organized Markets

- **PJM and MISO Interface Prices.** In 2024, the direction of the hourly flow was consistent with the real-time hourly price differences between the PJM/MISO Interface and the MISO/PJM Interface in 55.2 percent of the hours.
- **PJM and New York ISO Interface Prices.** In 2024, the direction of the hourly flow was consistent with the

<sup>166</sup> Calculated values shown in Section 9, "Interchange Transactions," are based on unrounded, underlying data and may differ from calculations based on the rounded values in the tables.



real-time hourly price differences between the PJM/ NYIS Interface and the NYISO/PJM proxy bus in 62.7 percent of the hours.

- **Neptune Underwater Transmission Line to Long Island, New York.** In 2024, the hourly flow (PJM to NYISO) was consistent with the real-time hourly price differences between the PJM Neptune Interface and the NYISO Neptune bus in 78.9 percent of the hours.
- **Linden Variable Frequency Transformer (VFT) Facility.** In 2024, the hourly flow (PJM to NYISO) was consistent with the real-time hourly price differences between the PJM Linden Interface and the NYISO Linden bus in 79.5 percent of the hours.
- **Hudson DC Line.** In 2024, the hourly flow (PJM to NYISO) was consistent with the real-time hourly price differences between the PJM Hudson Interface and the NYISO Hudson bus in 80.5 percent of the hours.

## Interchange Transaction Issues

- **PJM Transmission Loading Relief Procedures (TLRs).** PJM issued zero TLRs of level 3a or higher in 2024, and zero such TLRs in 2023.
- **Up To Congestion.** The average number of up to congestion bids submitted in the day-ahead energy market decreased by 39.3 percent, from 60,524 bids per day in 2023 to 36,760 bids per day in 2024. The average cleared volume of up to congestion bids submitted in the day-ahead energy market decreased by 46.0 percent, from 479,134 MWh per day in 2023, to 258,566 MWh per day in 2024.

## Section 9 Recommendations

- The MMU recommends that PJM implement rules to prevent sham scheduling. The MMU recommends that PJM apply after the fact market settlement adjustments to identified sham scheduling segments to ensure that market participants cannot benefit from sham scheduling. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM implement a validation method for submitted transactions that would prohibit market participants from breaking transactions into smaller segments to defeat the interface pricing rule by concealing the true source

or sink of the transaction. (Priority: Medium. First reported 2013. Status: Not adopted.)

- The MMU recommends that PJM implement a validation method for submitted transactions that would require market participants to submit transactions on paths that reflect the expected actual power flow in order to reduce unscheduled loop flows. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that transactions sourcing in the Western Interconnection be priced at either the MISO interface pricing point or the SOUTH interface pricing point based on the locational price impact of flows between the DC tie line point of connection with the Eastern Interconnection and PJM. (Priority: High. First reported 2020. Status: Not adopted.)
- The MMU recommends that PJM eliminate the IMO interface pricing point, and assign the transactions that originate or sink in the IESO balancing authority to the MISO interface pricing point. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM monitor, and adjust as necessary, the weights applied to the components of the interfaces to ensure that the interface prices reflect ongoing changes in system conditions. (Priority: Low. First reported 2009. Status: Adopted 2024.)
- The MMU recommends that PJM review the mappings of external balancing authorities to individual interface pricing points to reflect changes to the impact of the external power source on PJM tie lines as a result of system topology changes. The MMU recommends that this review occur at least annually. (Priority: Low. First reported 2009. Status: Not adopted.)
- The MMU recommends that, in order to permit a complete analysis of loop flow, FERC and NERC ensure that the identified data are made available to market monitors as well as other industry entities determined appropriate by FERC. (Priority: Medium. First reported 2003. Status: Not adopted.)
- The MMU recommends that PJM explore an interchange optimization solution with its neighboring balancing authorities that would

remove the need for market participants to schedule physical transactions across seams. Such a solution would include an optimized, but limited, joint dispatch approach that uses supply curves and treats seams between balancing authorities as constraints, similar to other constraints within an LMP market. (Priority: Medium. First reported 2014. Status: Not adopted.)

- The MMU recommends that PJM permit unlimited spot market imports as well as unlimited nonfirm point to point willing to pay congestion imports and exports at all PJM interfaces in order to improve the efficiency of the market. (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that the emergency interchange cap be replaced with a market based solution. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that the submission deadline for real-time dispatchable transactions be modified from 1800 on the day prior, to three hours prior to the requested start time, and that the minimum duration be modified from one hour to 15 minutes. These changes would give PJM a more flexible product that could be used to meet load in the most economic manner. (Priority: Medium. First reported 2014. Status: Partially adopted, 2015.)
- The MMU recommends eliminating the mechanism that defines FFE and M2M payments. These mechanisms are not consistent with markets and are not needed for efficient interface pricing. The MMU recommends that PJM file with the Commission to eliminate the FFE calculation and M2M payment of the PJM and MISO joint operating agreement. (Priority: Medium. First reported Q2 2024. Status: Not adopted.)
- The MMU recommends clear, explicit and detailed rules that define the conditions under which PJM will and will not recall energy from PJM capacity resources and prohibit new energy exports from PJM capacity resources. The MMU recommends that those rules define the conditions under which PJM will purchase emergency energy while at the same time not recalling energy exports from PJM capacity resources. The MMU recommends clear rules governing when PJM may recall capacity

backed exports. (Priority: Medium. First reported 2010. Status: Partially adopted.)

## Section 9 Conclusion

Transactions between PJM and multiple balancing authorities in the Eastern Interconnection are part of a single energy market. While some of these balancing authorities are termed market areas and some are termed nonmarket areas, all electricity transactions are part of a single energy market. Nonetheless, there are significant differences between market and nonmarket areas. Market areas, like PJM, include essential features of an energy market including locational marginal pricing, financial congestion offsets (FTRs and ARR in PJM) and transparent, least cost, security constrained economic dispatch for all available generation. Nonmarket areas do not include these features. Pricing in the market areas is transparent and pricing in the nonmarket areas is not transparent.

The MMU's recommendations related to transactions with external balancing authorities all share the goal of improving the economic efficiency of interchange transactions. The standard of comparison is an LMP market. In an LMP market, redispatch based on LMP and competitive generator offers results in an efficient dispatch and efficient prices. The goal of designing interface transaction rules should be to match the outcomes that would exist in an LMP market across the interfaces.

It is not appropriate to have special pricing agreements between PJM and any external entity. The same market pricing should apply to all transactions. External entities wishing to receive the benefits of the PJM LMP market should join PJM.

In 2020, PJM terminated a number of interface pricing points, consistent with longstanding MMU recommendations. Following the termination of the Northwest pricing point on October 1, 2020, PJM failed to correctly map the pricing points to transactions that had been mapped to the Northwest pricing point to pricing points that are consistent with electrical impacts on the PJM system. The MMU recommends that transactions sourcing in the Western Interconnection be priced at either the MISO interface pricing point or the SOUTH interface pricing point based on the electrical impact of flows between the DC tie line point of connection



with the Eastern Interconnection and PJM. The MMU continues to recommend the termination of the Ontario interface pricing point. The Ontario interface pricing point is noncontiguous to the PJM footprint that creates opportunities for market participants to engage in sham scheduling activities.

## Overview: Section 10, Ancillary Services

### Primary Reserve

Primary reserves consist of both synchronized and nonsynchronized reserves that can provide energy within 10 minutes and sustain that output for at least 30 minutes during a contingency event. PJM made several changes to the primary reserve market, effective October 1, 2022. These included a must offer requirement and correction of misspecified cost-based offers. By removing opportunities for physical and economic withholding, the changes resulted in clearing increased quantities of available synchronized reserves at competitive prices. Starting in May 2023, to compensate for poor resource performance, PJM increased the synchronized reserve reliability requirement, which in turn increased the primary reserve reliability requirement.

### Market Structure

- **Supply.** Primary reserve is provided by both synchronized reserve (generation or demand response currently synchronized to the grid and available within 10 minutes) and nonsynchronized reserve (generation currently offline but available to start and provide energy within 10 minutes).
- **Demand.** The primary reserve reliability requirement is equal to 150 percent of the synchronized reserve reliability requirement. The primary reserve requirement is equal to the primary reserve reliability requirement, with a shortage penalty price of \$850 per MWh, plus the extended reserve requirement (190 MW), with a shortage penalty price of \$300 per MWh. The synchronized reserve requirement is equal to the synchronized reserve reliability requirement plus the extended reserve requirement, with a default level of 190 MW. The synchronized reserve reliability requirement is normally equal to the most severe single contingency (MSSC). Starting in May 2023, PJM increased the size of the synchronized reserve reliability requirement in

the RTO Reserve Zone by 30 percentage points to 130 percent of the most severe single contingency (MSSC), in effect increasing the primary reserve reliability requirement to 195 percent of the MSSC. In 2024, the real-time average primary reserve requirement was 3,422.8 MW in the RTO Reserve Zone and 2,565.1 MW in the Mid-Atlantic Dominion Reserve Subzone.

- **Market Concentration.** Both the Mid-Atlantic Dominion (MAD) Reserve Subzone Market and the RTO Reserve Zone Market for primary reserve were characterized by structural market power in 2024. The average HHI for real-time primary reserve in the RTO Reserve Zone was 922, which is classified as unconcentrated. The average HHI for day-ahead primary reserve in the RTO Zone was 971, which is classified as unconcentrated. The average HHI for real-time primary reserve in the MAD Reserve Subzone was 1628, which is classified as moderately concentrated. The average HHI for day-ahead primary reserve in the MAD Reserve Subzone was 1563, which is classified as moderately concentrated.

### Synchronized Reserve Market

Synchronized reserves include all capacity synchronized to the grid and available to satisfy PJM's power balance requirements within 10 minutes. This includes online resources loaded below their full output, storage or condensing resources synchronized to the grid but consuming energy, and 10-minute demand response capability. As of October 1, 2022, all generation capacity resources must offer their full synchronized reserve capability to the PJM market at all times. PJM jointly optimizes energy, synchronized reserve, primary reserve, and 30-minute reserve needs in both the day-ahead and real-time markets. Synchronized reserve prices are based on opportunity costs calculated by PJM in the market optimization and the anticipated cost of a performance penalty. All real-time cleared synchronized reserves are obligated to perform when PJM initiates a synchronized reserve event based on a loss of supply.

### Market Structure

- **Supply.** In 2024, the real-time average supply of available synchronized reserve was 5,583.7 MW in the RTO Zone, of which 2,733.6 MW on average

was located in the Mid-Atlantic Dominion Reserve Subzone.

- **Demand.** The synchronized reserve requirement is equal to the synchronized reserve reliability requirement, with a shortage penalty price of \$850 per MWh, plus the extended reserve requirement, with a shortage penalty price of \$300 per MWh and a default value of 190 MW. The synchronized reserve reliability requirement is normally equal to the most severe single contingency (MSSC). Since May 19, 2023, PJM has inappropriately set the synchronized reserve reliability requirement to 130 percent of the MSSC for the RTO Reserve Zone. The real-time average synchronized reserve requirement in 2024 was 2,346.1 MW in the RTO Reserve Zone and 1,773.4 MW in the Mid-Atlantic Dominion Reserve Subzone. The day-ahead average synchronized reserve requirement in 2024 was 2,400.7 MW in the RTO Reserve Zone and 1,773.3 MW in the Mid-Atlantic Dominion Reserve Subzone.
- **Market Concentration.** The Mid-Atlantic Dominion (MAD) Reserve Subzone Market for synchronized reserve was characterized by structural market power in 2024. The average HHI for real-time synchronized reserve in the RTO Reserve Zone was 820, which is classified as unconcentrated. The average HHI for day-ahead synchronized reserve in the RTO Zone was 893, which is classified as unconcentrated. The average HHI for real-time synchronized reserve in the MAD Reserve Subzone was 1735, which is classified as moderately concentrated. The average HHI for day-ahead synchronized reserve in the MAD Reserve Subzone was 1589, which is classified as moderately concentrated.

## Market Conduct

- **Offers.** There is a must offer requirement for synchronized reserve. All nonemergency generation capacity resources are required to offer their full synchronized reserve capability. PJM calculates the available synchronized reserve for all conventional resources based on the energy offer ramp rate, energy dispatch point, and the lesser of the synchronized reserve maximum or economic maximum output. Hydro resources, energy storage resources, and demand response resources submit their available synchronized reserve MW. Wind, solar, and nuclear resources are by default considered incapable of

providing synchronized reserve, but may offer with an exception approved by PJM. Synchronized reserve offers are capped at cost plus the expected value of performance penalties. PJM calculates opportunity costs based on LMP.

Significant communications technology issues when calling resources during spinning events result in slow response.

## Market Performance

- **Price.** In 2024, for the Mid-Atlantic Dominion Reserve Subzone, the weighted average real-time price for synchronized reserve was \$3.20 per MWh and the weighted average day-ahead price was \$2.80 per MWh. In 2024, for the RTO Reserve Zone, the weighted average real-time price for synchronized reserve was \$3.41 per MWh and the weighted average day-ahead price was \$3.04 per MWh.

## Nonsynchronized Reserve

Nonsynchronized reserve is comprised of nonemergency energy resources not currently synchronized to the grid that can provide energy within 10 minutes. Nonsynchronized reserve is available to meet the portions of the primary reserve requirement and the 30-minute reserve requirement not already satisfied by reserve cleared for the synchronized reserve requirement.

## Market Structure

- **Supply.** In 2024, the average supply of eligible and available nonsynchronized reserve was 946.5 MW in the RTO Reserve Zone, of which 664.6 MW on average was available in the Mid-Atlantic Dominion Reserve Subzone.
- **Demand.** Demand for nonsynchronized reserve is the primary reserve requirement less the amount of synchronized reserves cleared by PJM.<sup>167</sup> Although nonsynchronized reserve can be used to meet the 30-minute reserve requirement, any 30-minute reserve beyond the primary reserve requirement is usually provided by secondary reserves due to its lower cost and greater availability.

## Market Conduct

- **Offers.** Generation owners do not submit supply offers for nonsynchronized reserve from non-hydroelectric units. Nonemergency generation

<sup>167</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.1 Overview of the PJM Reserve Markets, Rev. 133 (Dec. 17, 2024).

resources that are available to provide energy and can start in 10 minutes or less are defined to be available for nonsynchronized reserves. For non-hydroelectric units, PJM calculates the MW available from a unit based on the unit's energy offer. Hydroelectric units set their own offered reserve amount. For all units, the offer price of nonsynchronized reserve is \$0 per MWh.<sup>168</sup> Hybrid units and energy storage resources are not eligible to provide nonsynchronized reserves.

## Market Performance

- **Price.** The nonsynchronized reserve price is determined by the marginal primary reserve resource. In 2024, the nonsynchronized reserve weighted average real-time price for all intervals in the RTO Reserve Zone was \$1.54 per MWh and the weighted average day-ahead price was \$1.32 per MWh. In 2024, the nonsynchronized reserve weighted average real-time price for all intervals in the MAD Reserve Subzone was \$1.78 per MWh and the weighted average day-ahead price was \$1.50 per MWh.

## 30-Minute Reserve Market

The supply of 30-minute reserves consists of resources, online or offline, which can respond within 30 minutes. This includes primary reserves and secondary reserves.

## Market Structure

- **Supply.** The supply of 30-minute reserve is provided by both primary reserve (synchronized and nonsynchronized resources that can provide energy within 10 minutes) and secondary reserve (synchronized and nonsynchronized resources that can provide energy within 30 minutes but that take more than 10 minutes). In 2024, the real-time average supply of available 30-minute reserve was 27,901.4 MW in the RTO Zone.
- **Demand.** The 30-minute reserve requirement is equal to the 30-minute reserve reliability requirement, with a shortage penalty price of \$850 per MWh, plus the extended reserve requirement (190 MW), with a shortage penalty price of \$300 per MWh. The 30-minute reserve reliability requirement is equal to the maximum of: the primary reserve reliability requirement; the largest active gas contingency; and

3,000 MW. Since PJM increased the synchronized reserve reliability requirement, the 30-minute reserve reliability requirement is frequently equal to the primary reserve reliability requirement. In 2024, the average 30-minute reserve requirement was 3,532.5 MW in the real-time market and 3,582.5 MW in the day-ahead market.

- **Market Concentration.** The RTO Reserve Zone Market for 30-minute reserves was characterized by moderate structural market power in 2024. For 2024, the average HHI for real-time 30-minute reserves was 909, which is classified as unconcentrated. For 2024, the average HHI for day-ahead 30-minute reserves was 1020, which is classified as moderately concentrated.

## Secondary Reserve

Secondary reserves are reserves that take more than 10 minutes to convert to energy, but less than 30 minutes. This includes the unloaded capacity of online generation that can be achieved according to the resource ramp rates in 10 to 30 minutes, and offline resources with a start time of less than 30 minutes. Secondary reserves can only be used to satisfy the 30-minute reserve requirement.

## Market Structure

- **Supply.** In 2024, the real-time average supply of available secondary reserve was 21,371.2 MW in the RTO Reserve Zone. As with the 30-minute reserve service, there is no defined reserve subzone for secondary reserves.
- **Demand.** Demand for secondary reserve is the 30-minute reserve requirement less the amount of primary reserves cleared by PJM.<sup>169</sup>

## Market Conduct

- **Offers.** Energy storage resources, hydroelectric resources, hybrid resources, and demand-side response resources submit their available secondary reserve MW. For all other resource types, PJM calculates the MW available from a resource based on the resource's energy offer. For all resources, the offer price of secondary reserve is \$0 per MWh.<sup>170</sup> In both the day-ahead and real-time secondary reserves markets, PJM uses lost opportunity costs

<sup>168</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.2.3 Reserve Market Resource Offer Structure, Rev. 133 (Dec. 17, 2024).

<sup>169</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.1 Overview of the PJM Reserve Markets, Rev. 133 (Dec. 17, 2024).

<sup>170</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.2.3 Reserve Market Resource Offer Structure, Rev. 133 (Dec. 17, 2024).

as the offers and not offers submitted by market participants. For online secondary reserves, PJM calculates an opportunity cost based on LMP.

## Market Performance

- **Price.** The secondary reserve price is determined by the marginal 30-minute reserve resource. In 2024, the secondary reserve real-time price for all intervals was \$0.00 per MWh.

## Regulation Market

The PJM Regulation Market is a real-time market. Regulation is provided by generation resources and demand response resources that qualify to follow one of two regulation signals, RegA or RegD. PJM jointly optimizes regulation with synchronized reserve and energy to provide all three products at least cost. The PJM regulation market design includes three clearing price components: capability; performance; and opportunity cost. The RegA signal is designed for energy unlimited resources with physically constrained ramp rates. The RegD signal is designed for energy limited resources with fast ramp rates. In the regulation market RegD MW are converted to effective MW using a marginal rate of technical substitution (MRTS), called a marginal benefit factor (MBF). Correctly implemented, the MBF would be the marginal rate of technical substitution (MRTS) between RegA and RegD, holding the level of regulation service constant. The current market design is critically flawed as it has not properly implemented the MBF as an MRTS between RegA and RegD resource MW and the MBF has not been consistently applied in the optimization, clearing and settlement of the regulation market.

PJM filed significant changes to the regulation market design on April 16, 2024 that were accepted as filed by order of June 17, 2024.<sup>171</sup> PJM will implement the changes to the regulation market in two phases. Phase 1, scheduled to be implemented on October 1, 2025, will result in a single product, single signal market with one clearing price. Phase 2, to be implemented on October 1, 2026, will result in separate regulation up and regulation down markets. The proposed Phase 1 changes will eliminate many of the significant issues identified by the MMU that have resulted from a two product, two signal market design including the incorrect and inconsistent use and application of the MBF/MRTS.

<sup>171</sup> PJM, "Regulation Market Design Filing," Docket No. ER24-1772-000 (April 16, 2024).

This report analyzes the current regulation market design and results during 2024.

## Market Structure

- **Supply.** In 2024, the average hourly offered supply of regulation for nonramp hours was 723.3 performance adjusted MW (732.6 effective MW). This was a decrease of 29.6 performance adjusted MW (a decrease of 26.6 effective MW) from 2023. In 2024, the average hourly offered supply of regulation for ramp hours was 1,007.7 performance adjusted MW (1,059.7 effective MW). This was an increase of 3.1 performance adjusted MW (an increase of 14.7 effective MW) from 2023, when the average hourly offered supply of regulation was 1,004.6 performance adjusted MW (1,045.0 effective MW).
  - **Demand.** The hourly regulation demand is 525.0 effective MW for nonramp hours and 800.0 effective MW for ramp hours.
  - **Supply and Demand.** The nonramp regulation requirement of 525.0 effective MW was provided by a combination of cleared RegA and RegD resources equal to 477.6 hourly average performance adjusted actual MW in 2024. This is an increase of 0.8 performance adjusted actual MW from 2023, when the average hourly total regulation cleared performance adjusted actual MW for nonramp hours were 478.3 performance adjusted actual MW. The ramp regulation requirement of 800.0 effective MW was provided by a combination of cleared RegA and RegD resources equal to 696.0 hourly average performance adjusted actual MW in 2024. This is a decrease of 10.3 performance adjusted actual MW from 2023, where the average hourly regulation cleared MW for ramp hours were 706.3 performance adjusted actual MW.
- The ratio of the average hourly offered supply of regulation to average hourly regulation demand (performance adjusted cleared MW) for nonramp hours was 1.51 in 2024 (1.45 in 2023). The ratio of the average hourly offered supply of regulation to average hourly regulation demand (performance adjusted cleared MW) for ramp hours was 1.45 in 2024 (1.42 in 2023).
- **Market Concentration.** In 2024, the three pivotal supplier test was failed in 94.7 percent of hours.



In 2024, the effective MW weighted average HHI of RegA resources was 2517 which is highly concentrated and the effective MW weighted average HHI of RegD resources was 1594 which is moderately concentrated. The effective MW weighted average HHI of all resources was 1301, which is moderately concentrated.

## Market Conduct

- **Offers.** Daily regulation offer prices are submitted for each unit by the unit owner. Owners are required to submit a cost-based offer and may submit a price-based offer. Offers include both a capability offer and a performance offer. Owners must specify which signal type the unit will be following, RegA or RegD.<sup>172</sup> In 2024, there were 189 resources following the RegA signal and 58 resources following the RegD signal.

## Market Performance

- **Price and Cost.** The weighted average clearing price for regulation was \$31.86 per MW of regulation in 2024, an increase of \$9.17 per MW, or 40.4 percent, from the weighted average clearing price of \$22.69 per MW in 2023. The weighted average cost of regulation in 2024 was \$40.08 per MW of regulation, an increase of 36.7 percent, from the weighted average cost of \$29.32 per MW in 2023.
- **Prices.** RegD resources continue to be incorrectly compensated relative to RegA resources due to an inconsistent application of the marginal benefit factor in the optimization, assignment and settlement processes. If the regulation market were functioning efficiently and competitively, RegD and RegA resources would be paid the same price per effective MW.
- **Marginal Benefit Factor.** The marginal benefit factor (MBF) is intended to measure the operational substitutability of RegD resources for RegA resources. The marginal benefit factor is incorrectly defined and applied in the PJM market clearing. The current incorrect and inconsistent implementation of the MBF has resulted in the PJM Regulation Market over procuring RegD relative to RegA in most hours and in an inefficient market signal about the value of RegD in every hour.

<sup>172</sup> See the 2024 Annual State of the Market Report for PJM, Appendix F "Ancillary Services Markets."

## Black Start Service

Black start service is required for the reliable restoration of the grid following a blackout. Black start service is the ability of a generating unit to start without an outside electrical supply, or is the demonstrated ability of a generating unit to automatically remain operating at reduced levels when disconnected from the grid (automatic load rejection or ALR).<sup>173</sup>

In 2024, total black start charges were \$73.8 million, including \$73.5 million in revenue requirement charges and \$0.33 million in uplift charges. Black start revenue requirements consist of fixed black start service costs, variable black start service costs, training costs, fuel storage costs, and an incentive payment. Black start uplift charges are paid to units scheduled in the day-ahead energy market or committed in real time to provide black start service under the ALR option or for black start testing. Black start zonal charges in 2024 ranged from \$0 in the OVEC and REC Zones to \$18.0 million in the AEP Zone.

CRF values are a key determinant of total payments to black start units. The CRF values in PJM tariff tables should have been changed for both black start and the capacity market when the tax laws changed effective January 1, 2018. As a result of the failure to reduce the CRF values, black start units have been and continue to be significantly overcompensated since the changes to the tax code. In March 2023, FERC issued an order establishing hearing and settlement judge procedures.<sup>174</sup> Hearing procedures have been terminated while the Commission's consideration of settlement options is pending.

## Reactive

Reactive service, reactive supply and voltage control are provided by generation and other sources of reactive power (measured in MVar). Reactive power helps maintain appropriate voltage levels on the transmission system and is essential to the flow of real power (measured in MW). The same equipment provides both MVar and MW. Generation resources are required to meet defined reactive capability requirements as a condition to receive interconnection service in PJM.<sup>175</sup> RTOs and their customers are not required to separately compensate generation resources for such reactive

<sup>173</sup> OATT Schedule 1 § 1.3BB. There are no ALR units currently providing black start service.

<sup>174</sup> 182 FERC ¶ 61,194 (2023).

<sup>175</sup> OATT Attachment O.

capability.<sup>176</sup> In 2024, PJM customers paid \$379.2 million for reactive capability based on archaic, nonmarket and unsupported assertions about cost allocation and a regulatory review process of filings by individual units that results in unsupported black box settlements. The current rules have permitted over recovery of reactive costs through reactive capability charges. All costs of generators should be incorporated in the market.

The nonmarket approach to reactive capability payments will be eliminated based on FERC's Order No. 904.<sup>177</sup>

Reactive service charges based on opportunity costs are appropriately paid to units that operate in real time outside of their normal range at the direction of PJM for the purpose of providing real-time reactive power.

Total reactive charges decreased 2.16 percent from \$389.1 million in 2023 to \$380.7 million in 2024. Reactive capability charges decreased 2.39 percent from \$388.5 million in 2023 to \$379.2 million in 2024. Total zonal reactive service charges ranged from \$0 in the REC and OVEC Zones, to \$60.2 million in the AEP Zone in 2024.

## Frequency Response

The PJM Tariff requires that all new generator interconnection customers, both synchronous and nonsynchronous, have hardware and/or software that provides primary frequency responsive real power control with the ability to sense changes in system frequency and autonomously adjust real power output to correct for frequency deviations.<sup>178</sup> Primary frequency response begins within a few seconds and extends up to a minute. The purpose of primary frequency response is to arrest and stabilize the system until other measures (secondary and tertiary frequency response) become active. This includes a governor or equivalent controls capable of operating with a maximum five percent droop and a +/- 36 mHz deadband.<sup>179</sup> In addition to resource capability, resource owners must comply by setting control systems

to autonomously adjust real power output in a direction to correct for frequency deviations.

The response of generators within PJM to NERC identified frequency events remains under evaluation. A frequency event is declared whenever the system frequency goes outside of 60 Hz by +/- 40 mHz and stays there for 60 continuous seconds. The NERC BAL-003-2 requirement for balancing authorities (PJM is a balancing authority) uses a threshold value ( $L_{10}$ ) equal to -259.3 MW/0.1 Hz and has selected 12 frequency events between December 1, 2020, and November 30, 2021, to evaluate.

As a balancing authority, PJM requires all generators to be capable of providing primary frequency response and to operate with primary frequency response controls enabled.<sup>180</sup> PJM does monitor primary frequency response during NERC identified frequency events for all resources 50 MW or greater. Exclusions to PJM monitoring include nuclear plants, offline units, units with no available headroom, units assigned to regulation, and units with a current outage ticket in eDART.

## Market Procurement of Real-Time Ancillary Services

PJM uses market mechanisms to varying degrees in the procurement of ancillary services, including primary reserves, secondary reserves, and regulation. Ideally, all ancillary services would be procured taking full account of the interactions with the energy market. When a resource is used for an ancillary service instead of providing energy in real time, the cost of removing the resource, either fully or partially, from the energy market should be included in the offer for the ancillary service. The degree to which PJM markets account for these interactions depends on the timing of the product clearing, software limitations, and the accuracy of unit parameters and offers.

The synchronized reserve market clearing is more integrated with the energy market clearing than the other ancillary services. Synchronized reserves are jointly cleared with energy in every real-time market solution. Given the joint clearing of energy and flexible synchronized reserves, the synchronized reserve market clearing price should always cover the opportunity cost of providing flexible synchronized reserves. Inflexible

<sup>176</sup> See 182 FERC ¶ 61,033 at P 52 (January 27, 2023); see also *Standardization of Generator Interconnection Agreements & Procedures*, Order No. 2003, 104 FERC ¶ 61,103 at P 546 (2003), order on reh'g, Order No. 2003-A, 106 FERC ¶ 61,220 at P 28, order on reh'g, Order No. 2003-B, 109 FERC ¶ 61,287 (2004), order on reh'g, Order No. 2003-C, 111 FERC ¶ 61,401 (2005), *aff'd sub nom. National Association of Regulatory Utility Commissioners v. FERC*, 475 F.3d 1277 (D.C. Cir. 2007); *California ISO*, 160 FERC ¶ 61,035 at P 19 (2017); 119 FERC ¶ 61,199 at P 28 (2007), order on reh'g, 121 FERC ¶ 61,196 (2007); see also 178 FERC ¶ 61,088, at PP 29-31 (2022); 179 FERC ¶ 61,103, at PP 20-21 (2022).

<sup>177</sup> *Compensation for Reactive Power within the Standard Power Factor Range*, Order No. 904, 189 FERC ¶ 61,034 (2024); PJM compliance filing, Docket No. ER24-1073 (January 28, 2025).

<sup>178</sup> Nuclear Regulatory Commission (NRC) regulated facilities are exempt from this provision. Behind the meter generation that is sized to load is also exempt.

<sup>179</sup> OATT Attachment O § 4.7.2 (Primary Frequency Response).

<sup>180</sup> *Id.*; see also "PJM Manual 12: Balancing Operations," § 3.6 Primary Frequency Response, Rev. 54 (Dec. 17, 2024).



synchronized reserves, provided by resources that require hourly commitments due to run-time or staffing constraints, are not cleared with energy in the real-time market solution.<sup>181</sup> Instead, inflexible synchronized reserves are cleared hourly by the Ancillary Service Optimizer (ASO) or the day-ahead energy market. The ASO considers energy market price forecasts, availability of resources for flexible synchronized reserves, and regulation requirements to estimate the costs and benefits of using a resource for inflexible synchronized reserves. The ASO selected inflexible reserves are a fixed input to RT SCED, which clears the balance of the requirement with flexible synchronized reserves.

Nonsynchronized reserves and offline secondary reserves are cleared with every real-time energy market solution. The energy commitment decisions to keep the resources offline have already been made when the RT SCED clears the five-minute reserves markets. Therefore, offline reserves have no lost opportunity cost. They will not be called on for energy during the market interval for which they are assigned as offline resources.

Prices for the regulation and reserve markets are set by the pricing calculator (LPC), which uses the RT SCED solution as an input. The LPC includes fast start pricing logic and system marginal price caps, so the final prices can be inconsistent with the marginal cost of the resources that clear regulation and reserves.

## Section 10 Recommendations

### Reserve Markets

- The MMU recommends that to minimize lag and improve performance, PJM use an electronic synchronized reserve event notification process for all resources and that all resources be required to have the ability to receive and respond to the notifications. (Priority: Medium. First reported 2023. Status: Partially adopted December 17, 2024.)
- The MMU recommends that PJM replace the Mid-Atlantic Dominion Reserve Subzone with a reserve zone structure consistent with the actual deliverability of reserves based on current transmission constraints. (Priority: High. First reported 2019. Status: Partially adopted October 1, 2022.)

<sup>181</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.4.3 Reserve Market Clearing, Rev. 133 (Dec 17, 2024).

- The MMU recommends that the components of the cost-based offers for providing regulation and synchronous condensing be defined in Schedule 2 of the Operating Agreement. (Priority: Low. First reported 2019. Status: Not adopted.)
- The MMU recommends that, for calculating the penalty for a synchronized reserve resource failing to meet its scheduled obligation during a spinning event, the unit repay all credits back to the last time that the unit successfully responded to an event 10 minutes or longer. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that, for calculating the penalty for a synchronized reserve resource failing to meet its scheduled obligation during a spinning event, the synchronized reserve shortfall penalty should include LOC payments as well as SRMCP and MW of shortfall. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that aggregation not be permitted to offset unit specific penalties for failure to respond to a synchronized reserve event. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM remove the 30 percent increase to the synchronized reserve reliability requirement. (Priority: High. New recommendation. Status: Not adopted.)

### Regulation Market

- The MMU recommends that the two signal regulation market design be replaced with a one signal regulation market design. (Priority: Medium. First reported 2023. Status: Not adopted.)<sup>182</sup>
- The MMU recommends that the ability to make dual offers (to make offers as both a RegA and a RegD resource in the same market hour) be removed from the regulation market. (Priority: High. First reported 2019. Status: Not adopted.)<sup>183</sup>
- The MMU recommends that the regulation market be modified to incorporate a consistent application of the marginal benefit factor (MBF) throughout the

<sup>182</sup> PJM filed proposed changes to the regulation market with the FERC on April 16, 2024 (Regulation Market Design Filing, Docket No. ER24-1772-000). The Commission Order on June 17, 2024 accepted the PJM Proposal as filed. PJM will implement the changes to the regulation market in two phases. Phase 1, scheduled to be implemented on October 1, 2025, will result in a single signal, bidirectional market with one clearing price that eliminates the need for an MBF. Phase 1 will eliminate RegA and RegD dual offers. Phase 1 will reduce the regulation commitment period from a 60-minute commitment to a 30-minute commitment. In Phase 1 the lost opportunity cost calculation used in the regulation market will be based on the resource's dispatched energy offer schedule, not the lower of its price or cost offer schedule.

<sup>183</sup> Id.

optimization, assignment and settlement process. The MBF should be defined as the Marginal Rate of Technical Substitution (MRTS) between RegA and RegD. (Priority: High. First reported 2012. Status: Not adopted. FERC rejected.)<sup>184</sup><sup>185</sup>

- The MMU recommends that the current calculation of the performance score (based on precision, delay and correlation metrics) be replaced with the current calculation of the precision score. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends that the regulation market commitment period be reduced from a 60-minute commitment to a 30-minute commitment. (Priority: Medium. First reported 2023. Status: Not adopted.)<sup>186</sup>
- The MMU recommends that the lost opportunity cost in the ancillary services markets be calculated using the schedule on which the unit was scheduled to run in the energy market. (Priority: High. First reported 2010. Status: Not adopted. FERC rejected.)<sup>187</sup>
- The MMU recommends that the lost opportunity cost calculation used in the regulation market be based on the resource's dispatched energy offer schedule, not the lower of its price or cost offer schedule. (Priority: Medium. First reported 2010. Status: Not adopted. FERC rejected.)<sup>189</sup> <sup>190</sup>
- The MMU recommends that the \$12.00 margin adder be eliminated from the definition of the cost based regulation offer because it is a markup and not a cost. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends that the ramp rate limited desired MW output be used in the regulation uplift calculation, to reflect the physical limits of the unit's ability to ramp and to eliminate overpayment for opportunity costs when the payment uses an unachievable MW. (Priority: Medium. First reported 2022. Status: Not adopted.)<sup>191</sup>

<sup>184</sup> 162 FERC ¶ 61,295 (2018), *reh'g denied*, 170 FERC ¶ 61,259 (2020).

<sup>185</sup> *Id.*

<sup>186</sup> *Id.*

<sup>187</sup> This recommendation was adopted by PJM for the energy market. Lost opportunity costs in the energy market are calculated using the schedule on which the unit was scheduled to run. In the regulation market, this recommendation has not been adopted, as the LOC continues to be calculated based on the lower of price or cost in the energy market offer.

<sup>188</sup> 162 FERC ¶ 61,295 (2018), *reh'g denied*, 170 FERC ¶ 61,259 (2020).

<sup>189</sup> *Id.*

<sup>190</sup> *Id.*

<sup>191</sup> In Phase 1 the ramp rate limited desired MW output will be used in the regulation uplift calculation. The MMU does not agree with how this change will be implemented and will be reviewing the market results in Phase 1.

- The MMU recommends enhanced documentation of the implementation of the regulation market design. (Priority: Medium. First reported 2010. Status: Not adopted. FERC rejected.)<sup>192</sup>
- The MMU recommends that PJM be required to save data elements necessary for verifying the performance of the regulation market. (Priority: Medium. First reported 2010. Status: Not adopted.)
- The MMU recommends that all data necessary to perform the regulation market three pivotal supplier test be saved by PJM so that the test can be replicated. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends that all data necessary to perform the generator primary frequency response evaluation be saved by PJM so that the test can be replicated. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends that the total regulation (TReg) signal sent on a fleet wide basis be eliminated and replaced with individual regulation signals for each unit. (Priority: Low. First reported 2019. Status: Not adopted.)
- The MMU recommends that, to prevent gaming, there be a penalty enforced in the regulation market as a reduction in performance score and/or a forfeiture of revenues when resource owners elect to deassign assigned regulation resources within the hour. (Priority: Medium. First reported 2016. Status: Not adopted. FERC rejected.)<sup>193</sup>

## Frequency Response, Reactive, and Black Start

- The MMU recommends that all resources, new and existing, have a requirement to include and maintain equipment for primary frequency response capability as a condition of interconnection service. The PJM markets already compensate resources for frequency response capability and any marginal costs. (Priority: Medium. First reported 2018. Status: Partially adopted.)
- The MMU recommends that new CRF rates for black start units, incorporating current tax code changes, be implemented immediately. The new CRF rates should apply to all black start units. Black start units should be required to commit to providing

<sup>192</sup> *Id.*

<sup>193</sup> *Id.*

black start service for the life of the unit. (Priority: High. First reported 2020. Status: Not adopted.)

- The MMU recommends that black start planning and coordination be on a regional basis and not on a zonal basis and that the costs of black start service be shared on an equal per MWh basis across the region. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends that separate cost of service payments for reactive capability be eliminated and the cost of reactive capability be recovered in PJM markets. (Priority: Medium. First reported 2016. Status: Not adopted.)<sup>194</sup>
- The MMU recommends that payments for reactive capability, if continued, be based on the 0.95 power factor included in the voltage schedule in Interconnection Service Agreements. (Priority: Medium. First reported 2018. Status: Not adopted.)<sup>195</sup>
- The MMU recommends that, if payments for reactive are continued, fleet wide cost of service rates used to compensate resources for reactive capability be eliminated and replaced with compensation based on unit specific costs. (Priority: Low. First reported 2019. Status: Not adopted.)<sup>196</sup>
- The MMU recommends that, if payments for reactive are continued, Schedule 2 to OATT be revised to state explicitly that only generators that provide reactive capability to the transmission system that PJM operates and has responsibility for are eligible for reactive capability compensation. (Priority: Medium. First reported 2020. Status: Not adopted.)<sup>197</sup>

## Section 10 Conclusion

The October 1, 2022, changes to the reserve markets included a synchronized reserve must offer requirement applicable to all generation capacity resources. This resulted in an increase in available supply. Combined with the removal of the \$7.50 per MWh margin and the invalid variable operations and maintenance cost, supply and demand logic predicts lower prices, which occurred in 2022, except during Winter Storm Elliott. This is evidence of market efficiency. With the elimination of

tier 1 reserves, the total reserve market clearing price credits, while based on lower prices, are paid to a larger MW quantity. However, prices have been higher since PJM extended the ORDCs in May 2023.

The new reserve market design has been called into question by PJM based on a slow response during synchronized reserve events. In all cases, other than during Winter Storm Elliott, the ACE recovered within the required time frame and no reliability problems occurred. PJM responded to this poor performance by unilaterally and inappropriately increasing reserve requirements. This increase shifts the burden of poor resource performance from the resources themselves to customers, clearing more reserves instead of directly dealing with the causes of poor performance. These increases were the cause of higher reserve prices in 2023 and 2024, including 35 intervals of shortage pricing in May 2023 and several intervals of shortage pricing during spin events on January 29, 2024, June 3, 2024, and July 8, 2024, even while reserve markets cleared over 1,000 MW more than what was normally cleared in the months and years prior.

The data on synchronized reserve event recovery do not support the conclusion that there is an immediate need to change how reserves clear. If PJM insists on an immediate change, the focus should be on correcting the supply of reserves rather than increasing demand.

The immediate solution is to improve the deployment of reserves in synchronized reserve events by requiring the capability to use an electronic signal for all synchronized reserves. The archaic telephone communications technology has been a source of slow response times. Phone calls are not an effective or efficient method for deploying resources for immediate response. The MMU recommends that to minimize lag and improve performance, PJM use an electronic synchronized reserve event notification process for all resources and that all resources be required to have the ability to receive and respond to the notifications. On December 17, 2024, PJM partially adopted this recommendation by implementing an electronic deployment of reserves via an augmented dispatch signal, but PJM does not require that resources be able to receive this signal.

Along with changes to the deployment process, PJM and the MMU have worked with generators to identify circumstances where reserves were not accurately

<sup>194</sup> On October 17, 2024, the Commission issued a final rule, Order No. 904, eliminating separate payments for reactive in all jurisdictional markets, including PJM. On January 28, 2025, PJM submitted a compliance filing to implement Order No. 904 ("Compliance Filing") that proposed a transition mechanism lasting through May 31, 2026. See Docket No. ER25-1073.

<sup>195</sup> Id.

<sup>196</sup> Id.

<sup>197</sup> Id.

measured based on the energy and reserve offer parameters. More broadly, the MMU's proposal is to buy the correct amount of reserves. No increase in demand is required. There has been no change in the need/demand for reserves. PJM ignored the supply side. The issue is that resources have not provided the reserves that were offered and paid for. With the improved communications, instead of buying more MW of poorly performing reserves, PJM will be able to accurately recognize the actual supply of reserves and to more efficiently deploy them in synchronized reserve events. PJM should remove the 30 percent increase to the synchronized reserve reliability requirement in place from May 2023 through 2024.

The design of the current PJM Regulation Market is significantly flawed.<sup>198</sup> The market design does not correctly incorporate the marginal rate of technical substitution (MRTS) in market clearing and settlement. The market design uses the marginal benefit factor (MBF) to incorrectly represent the MRTS and uses a mileage ratio instead of the MBF in settlement. The current market design allows regulation units that have the capability to provide both RegA and RegD MW to submit an offer for both signal types in the same market hour. However, the method of clearing the regulation market for an hour in which one or more units has a dual offer incorrectly accounts for the amount of RegD and the effective MW of the RegD that it clears. The result of the flaw is that the MBF in the clearing phase is incorrectly low compared to the MBF in the solution phase and the actual amount of effective MW procured is higher than the regulation requirement. This failure to correctly and consistently incorporate the MRTS into the regulation market design has resulted in both underpayment and overpayment of RegD resources and in the over procurement of RegD resources in all hours. Under the current design, slower response RegA resources (generating units) must provide additional regulation to offset the negative impact of RegD resources (largely batteries) that are charging in the middle of a regulation hour. The ability of some resources to submit offers for both RegA and RegD (dual offers) results in inefficient high prices. The market results continue to include the incorrect definition of opportunity cost. These issues are the basis for the MMU's conclusion that the regulation market design is flawed.

<sup>198</sup> The current PJM regulation market design that incorporates two signals using two resource types was a result of FERC Order No. 755 and subsequent orders. Order No. 755, 137 FERC ¶ 61,064 at PP 197–200 (2011).

PJM filed proposed changes to the regulation market with the FERC on April 16, 2024.<sup>199</sup> The MMU filed a protest to the PJM filing on May 7, 2024, and answer to PJM's answer on June 7, 2024. The Commission Order on June 17, 2024 accepted the PJM Proposal as filed. PJM will implement the changes to the regulation market in two phases. Phase 1, scheduled to be implemented on October 1, 2025, will result in a single signal, bidirectional market with one clearing price. Phase 2, to be implemented on October 1, 2026, will result in separate regulation up and regulation down markets. The proposed changes to move to a single signal market, as approved by FERC, will eliminate the issues caused by the incorrect and inconsistent use and application of the MBF/MRTS in the regulation market.

The benefits of markets can be realized under the current approach to ancillary service markets. Even in the presence of structurally noncompetitive markets, there can be transparent, market clearing prices based on competitive offers that account explicitly and accurately for opportunity cost. This is consistent with the market design goal of ensuring competitive outcomes that provide appropriate incentives without reliance on the exercise of market power and with explicit mechanisms to prevent the exercise of market power. But there are significant issues with the PJM ancillary services markets.

The MMU concludes that the regulation market results were not competitive, and the market design is significantly flawed. The MMU concludes that the synchronized reserve market results were competitive. The MMU concludes that the nonsynchronized reserve market results were competitive. The MMU concludes that the secondary reserve market results were competitive.

## Overview: Section 11, Congestion and Marginal Losses

### Congestion Cost

- **Total Congestion.** Total congestion costs increased by \$685.8 million or 64.2 percent, from \$1,068.6 million in 2023 to \$1,754.4 million in 2024.
- **Day-Ahead Congestion.** Day-ahead congestion costs increased by \$694.1 million or 50.9 percent, from \$1,364.5 million in 2023 to \$2,058.6 million in 2024.

<sup>199</sup> PJM. "Regulation Market Design Filing," Docket No. ER24-1772-000 (April 16, 2024.)



- **Balancing Congestion.** Negative balancing congestion costs increased by \$8.3 million, from -\$295.9 million in 2023 to -\$304.2 million in 2024. Negative balancing explicit charges decreased by \$37.7 million, from -\$219.9 million in 2023 to -\$182.1 million in 2024.
- **Real-Time Congestion.** Real-time congestion costs increased by \$655.1 million, from \$1,411.7 million in 2023 to \$2,066.8 million in 2024.
- **Monthly Congestion.** Monthly total congestion costs in 2024 ranged from \$53.2 million in February to \$330.5 million in July.
- **Geographic Differences in CLMP.** Differences in CLMP between southern and eastern control zones in PJM were primarily a result of binding constraints on the Nottingham Series Reactor, the Lenox – North Meshoppen Line, the Yorkana Circuit Breaker, the Conastone – Northwest Line, and the AP South Interface.
- **Congestion Frequency.** Congestion frequency continued to be significantly higher in the day-ahead energy market than in the real-time energy market in 2024. The number of congestion event hours in the day-ahead energy market was about three times the number of congestion event hours in the real-time energy market.

Day-ahead congestion frequency increased by 6.5 percent from 73,522 congestion event hours in 2023 to 78,295 congestion event hours in 2024.

Real-time congestion frequency increased by 22.0 percent from 22,687 congestion event hours in 2023 to 27,680 congestion event hours in 2024.

- **Congested Facilities.** Day-ahead, congestion event hours decreased on transformers and increased on interfaces, lines and flowgates.

The Nottingham Series Reactor was the largest contributor to congestion costs in 2024. With \$222.8 million in total congestion costs, it accounted for 20.9 percent of the total PJM congestion costs in 2024.

- **CT Price Setting Logic and Closed Loop Interface Related Congestion.** PJM's use of CT pricing logic officially ended with the implementation of fast start pricing on September 1, 2021. While CT pricing logic was officially discontinued, PJM continues to use a related logic to force inflexible units and

demand response to be on the margin in both real time and day ahead. None of the PJM defined closed loop interfaces were binding in 2023 or 2024.

- **Zonal Congestion.** AEP had the highest zonal congestion costs among all control zones in 2024. AEP had \$286.6 million in zonal congestion costs, comprised of \$333.3 million in day-ahead congestion costs and -\$46.7 million in balancing congestion costs.

## Marginal Loss Cost

- **Total Marginal Loss Costs.** Total marginal loss costs increased by \$138.4 million or 17.8 percent, from \$777.2 million in 2023 to \$915.6 million in 2024. The loss MWh in PJM increased by 891.8 GWh or 5.9 percent, from 15,056.8 GWh in 2023 to 15,948.6 GWh in 2024. The loss component of real-time LMP in 2024 was \$0.03, compared to \$0.02 in 2023.
- **Day-Ahead Marginal Loss Costs.** Day-ahead marginal loss costs increased by \$128.0 million or 15.1 percent, from \$850.2 million in 2023 to \$978.2 million in 2024.
- **Balancing Marginal Loss Costs.** Negative balancing marginal loss costs decreased by \$10.4 million or 14.3 percent, from -\$73.0 million in 2023 to -\$62.6 million in 2024.
- **Total Marginal Loss Surplus.** The total marginal loss surplus increased by \$75.8 million or 28.7 percent, from \$264.0 million in 2023, to \$339.8 million in 2024.
- **Monthly Total Marginal Loss Costs.** Monthly total marginal loss costs in 2024 ranged from \$41.5 million in March to \$129.8 million in July.

## System Energy Cost

- **Total System Energy Costs.** Total system energy costs decreased by \$66.6 million or 13.1 percent, from -\$507.5 million in 2023 to -\$574.1 million in 2024.
- **Day-Ahead System Energy Costs.** Day-ahead system energy costs decreased by \$19.9 million or 3.0 percent, from -\$666.0 million in 2023 to -\$685.9 million in 2024.
- **Balancing System Energy Costs.** Balancing system energy costs decreased by \$51.6 million or 33.5 percent, from \$154.2 million in 2023 to \$102.6 million in 2024.



- **Monthly Total System Energy Costs.** Monthly total system energy costs in 2024 ranged from -\$86.3 million in January to -\$27.6 million in March.

## Section 11 Conclusion

Congestion is defined as the total payments by load in excess of the total payments to generation, excluding marginal losses. The level and distribution of congestion reflects the underlying characteristics of the power system, including the nature and defined capability of transmission facilities, the offers and geographic distribution of generation facilities, the level and geographic distribution of incremental bids and offers and the geographic and temporal distribution of load.

Total congestion costs increased by \$685.8 million or 64.2 percent, from \$1,068.6 million in 2023 to \$1,754.4 million in 2024.

Monthly total congestion costs ranged from \$53.2 million in February to \$330.5 million in July in 2024.

The current ARR/FTR design does not ensure that load receives the rights to all congestion revenues. The congestion offset provided by ARRs and self-scheduled FTRs in the first seven months of the 2024/2025 planning period was 55.9 percent. The cumulative offset of congestion by ARRs for the 2011/2012 planning period through the first seven months of the 2024/2025 planning period, using the rules effective for each planning period, was 69.6 percent. Load has received \$4.6 billion less than load should have received from the 2011/2012 planning period through the first seven months of the 2024/2025 planning period.

## Overview: Section 12, Generation and Transmission Planning

### Generation Interconnection Planning

#### Existing Generation Mix

- As of December 31, 2024, PJM had a total installed capacity of 198,841.1 MW, of which 38,776.4 MW (19.5 percent) are coal fired steam units, 56,124.2 MW (28.2 percent) are combined cycle units and 33,452.6 MW (16.8 percent) are nuclear units. This measure of installed capacity differs from capacity market installed capacity because it includes energy only units, excludes all external units, and uses nameplate values for solar and wind resources.
- Of the 198,841.1 MW of installed capacity, 69,023.7 MW (34.7 percent) are from units older than 40 years, of which 31,224.3 MW (45.2 percent) are coal fired steam units, 191.0 MW (0.3 percent) are combined cycle units and 22,100.6 MW (32.0 percent) are nuclear units.
- There are 60,030.1 MW of generation that have been, or are planned to be, retired between 2011 and 2028, of which 42,682.8 MW (71.1 percent) are coal fired steam units.
- In 2024, 527.4 MW of generation retired. The largest generator that retired in 2024 was the 180.0 MW Warrior Run coal fired steam unit located in the APS Zone. Of the 527.4 MW of generation that retired in 2024, 200.0 MW (37.9 percent) were located in the APS Zone.
- As of December 31, 2024, there are 5,284.8 MW of generation that have requested retirement after December 31, 2024, of which 2,168.8 MW (41.0 percent) are located in the BGE Zone. Of the generation requesting retirement in the BGE Zone, 1,273.0 MW (58.7 percent) are coal fired steam units.

### Generation Retirements<sup>200</sup>

### Generation Queue<sup>201</sup>

- On November 29, 2022, the Commission issued an order accepting PJM's tariff revisions to improve the queue process.<sup>202</sup> The new queue process includes modifications to implement a cluster/cycle based processing method to replace the first in/first out processing method.<sup>203</sup> This change will allow projects to move forward based on a first ready/first out analysis, where readiness is demonstrated through site control and financial milestones and there is an option to exit the study process early based on system impacts. The transition to the new queue process began on July 10, 2023.
- As of December 31, 2024, a total of 221,297.3 MW, on an energy basis, were in generation request queues in the status of active, under construction or

200 See PJM. Planning, "Generator Deactivations," (Accessed on December 31, 2024) <<https://www.pjm.com/planning/service-requests/gen-deactivations>>.

201 See PJM. Planning, "New Services Queue," (Accessed on December 31, 2024) <<https://www.pjm.com/planning/service-requests/serial-service-request-status>>.

202 181 FERC ¶ 61,162 (2022).

203 See "Interconnection Process Reform," presented at April 27, 2022 meeting of the Members Committee. <<https://www.pjm.com/-/media/committees-groups/committees/mc/2022/20220427/20220427-item-01a-1-interconnection-process-reform-presentation.ashx>>.

suspended.<sup>204</sup> Based on historical completion rates, 38,520.2 MW (17.4 percent), on an energy basis, of new generation in the queue are expected to go into service. As projects move through the queue process, projects can be removed from the queue due to incomplete or invalid data, withdrawn by the market participant or placed in service.

- Of the 7,688.8 MW, on an energy basis, of combined cycle projects in the queue, 4,193.0 MW (54.5 percent) are expected to go in service based on historical completion rates as of December 31, 2024.
- Of the 45,186.8 MW, on an energy basis, of battery projects in the queue, only 1,448.3 MW (3.2 percent) are expected to go in service based on historical completion rates as of December 31, 2024.
- Of the 166,339.7 MW, on an energy basis, of renewable projects in the queue, 31,649.1 MW (19.0 percent) are expected to go in service based on historical completion rates as of December 31, 2024.
- Of the 7,487.1 MW, on a capacity basis that requested CIRs, of combined cycle projects requested in the generation queues in the status of active, under construction or suspended, 3,982.0 MW (53.2 percent) are expected to go into service based on historical completion rates. Based on historical completion rates and the ELCC derate factors using the class ratings for the 2025/2026 Third Incremental Auction,<sup>205</sup> the 7,487.1 MW of capacity requests currently under construction, suspended or active in the queue would be reduced to 3,105.9 MW of capacity (41.5 percent of the total requested capacity).<sup>206</sup>
- Of the 40,343.3 MW, on a capacity basis that requested CIRs, of battery projects requested in the generation queues in the status of active, under construction or suspended, 192.8 MW (0.5 percent) are expected to go into service based on historical completion rates. Based on historical completion rates and the ELCC derate factors using the class ratings for the 2025/2026 Third Incremental Auction,<sup>207</sup> the 40,343.3 MW of capacity requests

currently under construction, suspended or active in the queue would be reduced to 106.0 MW of capacity (0.3 percent of the total requested capacity).<sup>208</sup>

- Of the 90,259.5 MW, on a capacity basis that requested CIRs, of renewable projects requested in the generation queues in the status of active, under construction or suspended, 15,402.8 MW (17.1 percent) are expected to go into service based on historical completion rates. Based on historical completion rates and the ELCC derate factors using the class ratings for the 2025/2026 Third Incremental Auction,<sup>209</sup> the 90,259.5 MW of capacity requests currently under construction, suspended or active in the queue would be reduced to 2,531.2 MW of capacity (2.8 percent of the total requested capacity).<sup>210</sup>
- As of December 31, 2024, 140,173.0 MW of capacity requests (requested CIRs) were in the generation queues in the status of active, under construction or suspended. Based on historical completion rates, 20,773.6 MW (14.8 percent) are expected to go into service. Based on historical completion rates and the ELCC derate factors using the class ratings for the 2025/2026 Third Incremental Auction, the 140,173.0 MW of capacity requests currently under construction, suspended or active in the queue would be reduced to 6,509.2 MW of capacity (4.6 percent of the total requested capacity).
- As of December 31, 2024, 8,190 projects, representing 827,897.9 MW, have entered the queue process since its inception in 1998. Of those, 1,219 projects, representing 91,789.6 MW (11.1 percent of the MW), went into service. Of the projects that entered the queue process, 4,401 projects, representing 514,811.0 MW (62.2 percent of the MW) withdrew prior to completion. Such projects may create barriers to entry for projects that would otherwise be completed, by taking up queue positions, increasing interconnection costs and creating uncertainty.
- In 2024, 4,431.3 MW from the queue went into service. Of the 4,431.3 MW that went in service,

<sup>204</sup> Unless otherwise noted, the queue totals in this report are the winter net MW energy for the interconnection requests ("MW Energy") as shown in the queue.

<sup>205</sup> ELCC Class Ratings for 2025/2026 Third Incremental Auction, PJM Interconnection LLC. (January 23, 2025) <<https://www.pjm.com/-/media/DotCom/planning/res-adeq/elcc/2025-26-3ia-elcc-class-ratings.pdf>>.

<sup>206</sup> The 2025/2026 Third Incremental Auction ELCC factors are used for the ELCC derate adjusted MW. The adjusted MW are calculated using the four hour storage ELCC derate for battery resources, tracking solar for solar resources and onshore wind for wind resources.

<sup>207</sup> ELCC Class Ratings for 2025/2026 Third Incremental Auction, PJM Interconnection LLC. (January 23, 2025) <<https://www.pjm.com/-/media/DotCom/planning/res-adeq/elcc/2025-26-3ia-elcc-class-ratings.pdf>>.

<sup>208</sup> The 2025/2026 Third Incremental Auction ELCC factors are used for the ELCC derate adjusted MW. The adjusted MW are calculated using the four hour storage ELCC derate for battery resources, tracking solar for solar resources and onshore wind for wind resources.

<sup>209</sup> ELCC Class Ratings for 2025/2026 Third Incremental Auction, PJM Interconnection LLC. (January 23, 2025) <<https://www.pjm.com/-/media/DotCom/planning/res-adeq/elcc/2025-26-3ia-elcc-class-ratings.pdf>>.

<sup>210</sup> The 2025/2026 Third Incremental Auction ELCC factors are used for the ELCC derate adjusted MW. The adjusted MW are calculated using the four hour storage ELCC derate for battery resources, tracking solar for solar resources and onshore wind for wind resources.

4,099.0 MW (92.5 percent) were solar units, 289.8 MW (6.5 percent) were wind units and 42.5 MW (1.0 percent) were battery units.

- The number of queue entries increased during the past several years, primarily renewable projects. Of the 5,538 projects that entered the queue from January 1, 2015, through December 31, 2024, 4,121 projects (74.4 percent) were renewable. Of the 467 projects that entered the queue in 2023, 414 projects (88.7 percent) were renewable. Renewable projects make up 77.2 percent of all projects in the queue and account for 75.2 percent of the nameplate MW currently active, suspended or under construction in the queue as of December 31, 2024.
- On December 31, 2024, 37,129.1 MW, on an energy basis, were in generation request queues that had reached the construction service agreement milestone or equivalent, in the status of active, suspended or under construction. Of the 37,129.1 MW, 18,148.1 MW (48.9 percent) had not begun construction, 12,137.9 MW (32.7 percent) had begun construction, but are now suspended, and 6,843.1 MW (18.4 percent) are currently under construction. Reaching the final milestone required prior to construction does not mean a project will immediately begin construction or even that it necessarily will ever begin construction.

## Regional Transmission Expansion Plan (RTEP)

### Market Efficiency Process

- There are significant issues with PJM's benefit/cost analysis that should be addressed prior to approval of additional projects. If done correctly and if FTRs/ARRs returned 100 percent of congestion to load, the benefit/cost analysis would include the total net change in production costs and would not include congestion. In addition, PJM's benefit/cost analysis includes only the decreases in costs to load and ignores the increases in costs to load associated with market efficiency projects.
- Through December 31, 2024, PJM has completed five market efficiency cycles under Order No. 1000.<sup>211</sup> PJM delayed the opening of the 2022/2023 Long-Term Window until the reliability violations

for the 2022 Window 3 are addressed. In January 2024, PJM completed updating the 2022/2023 market efficiency base case to include the solution selected from the 2022 Window 3. No flowgates experienced historical congestion that required an open window. PJM will continue to analyze the congestion patterns as part of the 2024/25 Market Efficiency cycle. In February 2024, PJM completed the 2024/2025 market efficiency base case. In May 2024, PJM posted the 2024/2025 Market Efficiency planning assumptions. PJM posted an updated 2024/2025 base case in July 2024, and requested stakeholder feedback by August 31, 2024. PJM is currently reviewing the feedback received from stakeholders. The long term market efficiency window is expected to open during the first quarter of 2025.

### PJM MISO Interregional Market Efficiency Process (IMEP)

- PJM and MISO developed a process to facilitate the construction of interregional projects in response to the Commission's concerns about interregional coordination along the PJM-MISO seam. This process, called the Interregional Market Efficiency Process (IMEP), operates on a two year study schedule and is designed to address forward looking congestion.

The simultaneous use for joint projects of an incorrectly defined benefit/cost method by PJM and the correct method by MISO results in an over allocation of the costs associated with joint PJM/MISO projects to PJM participants and in some cases approval of projects that do not pass a correctly defined benefit/cost test.

### PJM MISO Targeted Market Efficiency Process (TMEP)

- PJM and MISO developed the Targeted Market Efficiency Process (TMEP) to facilitate the resolution of historic congestion issues that could be addressed through small, quick implementation projects.

<sup>211</sup> See *Transmission Planning and Cost Allocation by Transmission Owning and Operating Public Utilities*, Order No. 1000, FERC Stats. & Regs. ¶ 31,323 (2011) (Order No. 1000), *order on reh'g*, Order No. 1000-A, 139 FERC ¶ 61,132 (2012).

## PJM MISO Interregional Transfer Capability Study (ITCS)

- PJM and MISO developed the Interregional Transfer Capability Study (ITCS) to help identify potential transmission projects that could incrementally improve the systems' ability to mitigate constraints, improve market efficiency, respond to extreme weather and increase interregional transfer capability.

## Supplemental Transmission Projects

- Supplemental projects are defined to be "transmission expansions or enhancements that are not required for compliance with PJM criteria and are not state public policy projects according to the PJM Operating Agreement. These projects are used as inputs to RTEP models, but are not required for reliability, economic efficiency or operational performance criteria, as determined by PJM."<sup>212</sup> Supplemental projects are exempt from competition.
- The average number of supplemental projects in each expected in service year increased by 1,025.0 percent, from 20 for years 1998 through 2007 (pre Order No. 890) to 225 for years 2008 through 2024 (post Order 890).<sup>213</sup>

## End of Life Transmission Projects

- An end of life transmission project is a project submitted for the purpose of replacing existing infrastructure that is at, or is approaching, the end of its useful life. End of life transmission projects should be included in the RTEP process and should be subject to a transparent, robust and clearly defined mechanism to require competition to build the project. Under the current approach, end of life projects are excluded from the RTEP process and exempt from competition.

## Board Authorized Transmission Upgrades

- The Transmission Expansion Advisory Committee (TEAC) reviews proposals to improve transmission reliability in PJM and between PJM and neighboring regions. These proposals, which include reliability baseline, network, market efficiency and targeted market efficiency projects, as well as scope changes

and project cancellations, but exclude supplemental and end of life projects, are periodically presented to the PJM Board of Managers for authorization.<sup>214</sup> In 2024, the PJM Board approved \$1.81 billion in upgrades. As of December 31, 2024, the PJM Board has approved \$50.1 billion in system enhancements since 1999.

## Transmission Competition

- The MMU makes several recommendations related to the competitive transmission planning process. The recommendations include improved process transparency, incorporation of competition between transmission and generation alternatives, and the removal of barriers to competition from nonincumbent transmission. These recommendations would help ensure that the process is an open and transparent process that results in the most competitive solutions.
- On May 24, 2018, the PJM Markets and Reliability Committee (MRC) approved a motion that required PJM, with input from the MMU, to develop a comparative framework to evaluate the quality and effectiveness of competitive transmission proposals with binding cost containment proposals compared to proposals from incumbent and nonincumbent transmission companies without cost containment provisions.

## Qualifying Transmission Upgrades (QTU)

- A Qualifying Transmission Upgrade (QTU) is an upgrade to the transmission system, financed and built by market participants, that increases the Capacity Emergency Transfer Limit (CETL) into an LDA and can be offered into capacity auctions as capacity. Once a QTU is in service, the upgrade is eligible to continue to offer the approved incremental import capability into future RPM Auctions. As of December 31, 2024, no QTUs have cleared a Base Residual Auction or an Incremental Auction.

## Transmission Facility Outages

- PJM maintains a list of reportable transmission facilities. When a reportable transmission facility needs to be taken out of service, PJM transmission owners are required to report planned transmission facility outages as early as possible. PJM processes

<sup>212</sup> See PJM, "Transmission Construction Status," (Accessed on December 31, 2024) <<https://www.pjm.com/planning/m/project-construction>>.

<sup>213</sup> See *Preventing Undue Discrimination and Preference in Transmission Service*, Order No. 890, 118 FERC ¶ 61,119, order on reh'g, Order No. 890-A, 121 FERC ¶ 61,297 (2007), order on reh'g, Order No. 890-B, 123 FERC ¶ 61,299 (2008), order on reh'g, Order No. 890-C, 126 FERC ¶ 61,228, order on clarification, Order No. 890-D, 129 FERC ¶ 61,126 (2009).

<sup>214</sup> Supplemental Projects, including the end of life subset of supplemental projects, do not require PJM Board of Managers authorization.



the transmission facility outage requests according to rules in PJM's Manual 3 to decide if the outage is on time or late and whether or not they will allow the outage.<sup>215</sup>

- There were 11,142 transmission outage requests submitted in the first seven months of the 2024/2025 planning period. Of the requested outages, 72.1 percent were planned for less than or equal to five days and 11.4 percent were planned for greater than 30 days. Of the requested outages, 41.1 percent were late according to the rules in PJM's Manual 3.

## Section 12 Recommendations

### Generation Retirements

- The MMU recommends that CIRs should end on the date of retirement in order to help ensure competitive markets and competitive access to the grid. The rules need to ensure that incumbents cannot exploit control of CIRs to block or postpone entry of competitors or to exercise market power by requiring high payments for CIRs.<sup>216</sup> (Priority: Medium. First reported 2013. Status: Partially adopted, 2012.)

### Generation Queue

- Given the significance of data to market participants and regulators, the MMU recommends that all queue data and supplemental, network and baseline project data, including projected in service dates and estimated and final costs, be regularly updated with accurate and verifiable data. PJM does not update this data. (Priority: High. First reported 2023. Not adopted.)
- The MMU recommends that barriers to entry be addressed in a timely manner in order to help ensure that the capacity market will result in the entry of new capacity to meet the needs of PJM market participants. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM establish an expedited PJM managed queue process to identify commercially viable projects that could help eliminate or reduce the need for specific RMRs or that could address specific reliability needs and allow the identified projects to advance in

the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming. (Priority: High. First reported Q2, 2024. Status: Not adopted.)

- The MMU recommends improvements in queue management including that PJM establish a review process to ensure that projects are removed from the queue if they are not viable, as well as an expedited process to allow commercially viable projects to advance in the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming.<sup>217</sup> (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends continuing analysis of the study phase of PJM's transmission planning to reduce the need for postponements of study results, to decrease study completion times, and to improve the likelihood that a project at a given phase in the study process will successfully go into service.<sup>218</sup> (Priority: Medium. First reported 2014. Status: Partially adopted.)
- The MMU recommends outsourcing interconnection studies to an independent party to avoid potential conflicts of interest. Currently, these studies are performed by incumbent transmission owners under PJM's direction. This creates potential conflicts of interest, particularly when transmission owners are vertically integrated and the owner of transmission also owns generation. (Priority: Low. First reported 2013. Status: Not adopted.)

### Market Efficiency Process

- The MMU recommends that the market efficiency process be eliminated because it is not consistent with a competitive market design. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that, if the market efficiency process is retained, PJM modify the rules governing benefit/cost analysis, the evaluation process for selecting among competing market efficiency projects and cost allocation for economic projects in order to ensure that all changes in production costs but not congestion costs, including increased costs to load and the risk of project cost increases, in all zones are included in order to ensure that the correct metrics are used for defining benefits. The

<sup>215</sup> See "PJM Manual 03: Transmission Operations," Rev. 67 (November 21, 2024).

<sup>216</sup> See Comments of the Independent Market Monitor for PJM, Docket No. ER12-1177-000 (March 12, 2012) <[http://www.monitoringanalytics.com/Filings/2012/IMM\\_Comments\\_ER12-1177-000\\_20120312.PDF](http://www.monitoringanalytics.com/Filings/2012/IMM_Comments_ER12-1177-000_20120312.PDF)>.

<sup>217</sup> PJM Filing, FERC Docket No. ER22-2110-000 (June 14, 2022); 181 FERC ¶ 61,162 (2022).  
<sup>218</sup> Ibid.



MMU also recommends that, if the market efficiency process is retained, market efficiency projects that fail to meet PJM benefit/cost criteria in a Schedule 6 annual reevaluation, prior to construction commencing or prior to state approval, be canceled and removed from further consideration. (Priority: Medium. First reported 2018. Status: Not adopted.)

## Comparative Cost Framework

- The MMU recommends that PJM modify the project proposal templates to include data necessary to perform a detailed project lifetime financial analysis. The required data includes, but is not limited to: capital expenditure; capital structure; return on equity; cost of debt; tax assumptions; ongoing capital expenditures; ongoing maintenance; and expected life. (Priority: Medium. First reported 2020. Status: Not adopted.)

## Transmission Competition

- The MMU recommends, to increase the role of competition, that the exemption of supplemental projects from the Order No. 1000 competitive process be terminated and that the basis for all such exemptions be reviewed and modified to ensure that the supplemental project designation is not used to exempt transmission projects from a transparent, robust and clearly defined mechanism to require competition to build such projects or to effectively replace the RTEP process. (Priority: Medium. First reported 2017. Status: Not adopted. Rejected by FERC.)<sup>219</sup>
- The MMU recommends, to increase the role of competition, that the exemption of end of life projects from the Order No. 1000 competitive process be terminated and that end of life transmission projects be included in the RTEP process and should be subject to a transparent, robust and clearly defined mechanism to require competition to build such projects. (Priority: Medium. First reported 2019. Status: Not adopted. Rejected by FERC.)<sup>220</sup>
- The MMU recommends that PJM enhance the transparency and queue management process for nonincumbent transmission investment. Issues

<sup>219</sup> The FERC accepted tariff provisions that exclude supplemental projects from competition in the RTEP. 162 FERC ¶ 61,129 (2018), *reh'g denied*, 164 FERC ¶ 61,217 (2018).

<sup>220</sup> In recent decisions addressing competing proposals on end of life projects, the Commission accepted a transmission owner proposal excluding end of life projects from competition in the RTEP process, 172 FERC ¶ 61,136 (2020), *reh'g denied*, 173 FERC ¶ 61,225 (2020), *affirmed*, American Municipal Power, Inc., et al. v. FERC, Case No. 20-1449 (D.C. Cir. November 17, 2023), and rejected a proposal from PJM stakeholders that would have included end of life projects in competition in the RTEP process, 173 FERC ¶ 61,242 (2020).

related to data access and complete explanations of cost impacts should be addressed. The goal should be to remove barriers to competition from nonincumbent transmission providers. (Priority: Medium. First reported 2015. Status: Not adopted.)

- The MMU recommends that PJM incorporate the principle that the goal of transmission planning should be the incorporation of transmission investment decisions into market driven processes as much as possible. (Priority: Low. First reported 2001. Status: Not adopted.)
- The MMU recommends the creation of a mechanism to permit a direct comparison, or competition, between transmission and generation alternatives, including which alternative is less costly and who bears the risks associated with each alternative. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM establish fair terms of access to rights of way and property, such as at substations, in order to remove any barriers to entry and require competition between incumbent transmission providers and nonincumbent transmission providers in the RTEP. (Priority: Medium. First reported 2014. Status: Not adopted.)
- The MMU recommends that rules be implemented to require competition to provide financing for transmission projects. This competition could reduce the cost of capital for transmission projects and significantly reduce total costs to customers. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that storage resources not be includable as transmission assets for any reason. (Priority: High. First reported 2020. Status: Not adopted.)

## Cost Allocation

- The MMU recommends a comprehensive review of the ways in which the solution based dfax allocation method is implemented. The goal for such a process would be to ensure that the most rational and efficient approach to implementing the solution based dfax method is used in PJM. Such an approach should allocate costs consistent with benefits and appropriately calibrate the incentives for investment in new transmission capability. No

replacement approach should be approved until all potential alternatives, including the status quo, are thoroughly reviewed. (Priority: Medium. First reported 2020. Status: Not adopted.)

- The MMU recommends changing the minimum distribution factor in the allocation from 0.01 to 0.00 and adding a threshold minimum usage impact on the transmission facilities.<sup>221</sup> (Priority: Medium. First reported 2015. Status: Not adopted.)

### Transmission Line Ratings

- The MMU recommends that all PJM transmission owners use the same methods to define line ratings and that all PJM transmission owners implement dynamic line ratings (DLR), subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. (Priority: Medium. First reported 2019. Status: Partially adopted.)
- The MMU recommends that all PJM transmission owners investigate the applicability and potential cost savings of Grid Enhancing Technology (GET) and that all PJM transmission owners implement cost effective GET, subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. (Priority: Medium. First reported Q2, 2024. Status: Not adopted.)
- The MMU recommends that the implementation of Grid Enhancing Technology (GET) be opened to competition from third parties, subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. (Priority: Medium. First reported Q3, 2024. Status: Not adopted.)

### Transmission Facility Outages

- The MMU recommends that PJM reevaluate all transmission outage tickets as on time or late as if they were new requests when an outage is rescheduled, create options for late requests based on the reasons, and apply the modified rules for late submissions to any such outages. The MMU recommends that PJM create options for treatment of late outages. The current rules apply more stringent rules, based on controlling actions, to late outages without distinguishing among reasons for

late outages. (Priority: Low. First reported 2014. Status: Not adopted.)

- The MMU recommends that PJM draft a definition of the economic and physical congestion analysis required for transmission outage requests and associated triggers, including both the extent of overloaded facilities and the level of economic congestion, to include in PJM manuals after appropriate review with appropriate rules for on time and late outage requests. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM create options for late requests based on the reasons, and modify the rules to reduce or eliminate the approval of late outage requests submitted or rescheduled after the FTR auction bidding opening date, based on those options. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM not permit transmission owners to divide long duration outages into smaller segments to avoid complying with the requirements for long duration outages. (Priority: Low. First reported 2015. Status: Not adopted.)

## Section 12 Conclusion

The goal of the PJM market design should be to enhance competition and to ensure that competition is the core element of all PJM markets. Transmission investments have not been fully incorporated into competitive markets. The construction of new transmission facilities has significant impacts on the energy and capacity markets. When generating units retire or load increases, there is no market mechanism in place that would require or even permit direct competition between transmission and generation to meet loads in the affected area. In addition, despite FERC Order No. 1000, there is not yet a transparent, robust and clearly defined mechanism to require competition to build transmission projects, to ensure that competitors provide a total project cost cap, or to obtain least cost financing through the capital markets.

The MMU recognizes that the Commission has issued orders that are inconsistent with the recommendations of the MMU and that PJM cannot unilaterally modify those directives. It remains the recommendation of the MMU that the PJM rules for competitive transmission development through the RTEP should build upon FERC

<sup>221</sup> See 2015 State of the Market Report for PJM, Volume 2, Section 12: Generation and Transmission Planning, at 463, Cost Allocation Issues.

Order No. 1000 to create real competition between incumbent transmission providers and nonincumbent transmission providers. The ability of transmission owners to block competition for supplemental projects and end of life projects and the reasons for that policy should be reevaluated. PJM should enhance the transparency and queue management process for nonincumbent transmission investment. Issues related to data access and complete explanations of cost impacts should be addressed. The goal should be to remove barriers to competition from nonincumbent transmission.

Order No. 1000 removed the right of first refusal (ROFR) for transmission projects for incumbent transmission owners except for the case of supplemental projects. This created an incentive for incumbent transmission owners to designate projects as supplemental projects to avoid the Order No. 1000 competitive provisions. Two PJM states, Indiana and Michigan, have passed laws that provide ROFR to incumbent utilities/transmission owners.<sup>222 223</sup>

Given the slow pace of adoption by Transmission Owners of Grid Enhancing Technologies (GETs), PJM and the Commission should introduce rules that would allow third parties to propose adding GETs to the transmission system, subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. The third parties would be compensated in the same way that TOs would be compensated for comparable investments.

Another element of opening competition would be to consider transmission owners' ownership of property and rights of way at or around transmission substations. In many cases, the land acquired included property intended to support future expansion of the grid. Incumbents have included the costs of the property in their rate base, paid for by customers. PJM now has the responsibility for planning the development of the grid under its RTEP process. Property bought to facilitate future expansion should be a part of the RTEP process and be made available to all providers on equal terms.

222 See IN Code 5 8-1-38-9, effective 7/1/2023. Applies to transmission facilities approved for construction through an RTO planning process. Incumbent Transmission Owner must exercise within 90 days.

223 See MCL §460.593, effective 12/17/2021. Applies to regionally cost shared transmission lines included in a plan adopted by a recognized planning authority. Must be exercised by the incumbent (s) within 90 days after plan is adopted/approved.

The process for determining the reasonableness or purpose of supplemental transmission projects that are asserted to be not needed for reliability, economic efficiency or operational performance as defined under the RTEP process needs additional oversight and transparency. If there is a need for a supplemental project, that need should be clearly defined and there should be a transparent, robust and clearly defined mechanism to require competition to build the project. If there is no defined need for a supplemental project for reliability, economic efficiency or operational performance then the project should not be included in rates.

Managing the generation queues is a complex process. The PJM queue evaluation process will be significantly improved, based on the proposal submitted by PJM on June 14, 2022, and approved by FERC on November 29, 2022.<sup>224 225</sup> The new rules include significant modifications to the interconnection process designed to address some of the key underlying issues and significantly improve the efficiency of the process. These modifications include process efficiency enhancements, recognition of project clusters affecting the same transmission facilities, incentives to reduce the entry of speculative projects in the queue, and incentives to remove projects that are not expected to reach commercial operation. The new process should help to reduce backlog and to remove projects that are not viable earlier to help improve the overall efficiency of the queue process.

While the changes in the queue process will clearly improve the process, the MMU's recommendations related to the queue process will remain until the new process is in place and it can be evaluated. The impact of the modifications to the queue process will need to be evaluated to determine if they successfully remove projects from the queue if they are not viable, and allow commercially viable projects to advance in the queue ahead of projects which have failed to make progress. The behavior of project developers also creates issues with queue management. When developers put multiple projects in the queue to maintain their own optionality while planning to build only one they also affect all the projects that follow them in the queue. Project developers may also enter speculative projects in the queue and then put the project in suspended status while they address financing. The impacts of such behavior and the incentives for such behavior are addressed in the

224 See *PJM*, Docket No. ER22-2110 (June 14, 2022).

225 181 FERC ¶ 61,162 (2022).

new process which includes nonrefundable fees, credit requirements, enhanced site control, elimination of the ability to suspend a project and milestone requirements. The impact of these aspects of the revised interconnection process should continue to be evaluated to ensure that they are having the desired effect on project developer behavior. The PJM queue evaluation process should continue to be improved to help ensure that barriers to competition for new generation investments are not created. Issues that need to be addressed include the ownership rights to CIRs and whether transmission owners should perform interconnection studies.

The roles and efficiency of PJM, TOs and developers in the queue process all need to be examined and enhanced in order to help ensure that the queue process can function effectively and efficiently as the gateway to competition in the energy and capacity markets and not as a barrier to competition.

The Commission should require PJM, for example, to enhance the transparency and queue management process for nonincumbent transmission investment. Issues related to data access and complete explanations of cost impacts should be addressed. The goal should be to remove barriers to competition from nonincumbent transmission.

The suggestion that generation owners should be permitted to avoid the queue process and directly transfer the generation CIRs to an affiliate or directly sell the CIRs to an unaffiliated entity should be rejected.<sup>226 227</sup> This proposed approach is about creating a process to maximize the value of existing CIRs to incumbent generators and not about facilitating the efficient replacement of retiring resources. In effect, this approach, if adopted by the large number of retiring units, would create a chaotic, bilateral private queue process that would create market power and facilitate the exercise of market power in the sale of CIRs by incumbent generators. In effect the proposed approach would replace a significant part of the recently redesigned PJM queue process. The proposed continuation of retention of CIRs by incumbent generators creates the potential for delays of up to a year and the proponents have proposed the option to request further delays. This

approach would inappropriately delegate the authority from PJM to the incumbent generator to choose the new resource based on highest offer for CIRs rather than based on PJM defined system reliability needs. There would be no requirement to even be a capacity resource and there would be no requirement to offer the capacity into the capacity market. After the entire process, the contribution to PJM reliability could be zero. PJM's recently proposed expedited process for addressing reliability needs (RRI) is preferable and should be considered as the preferred alternative to the proposed approach from the Planning Committee stakeholder process.

The PJM queue process should continue to define available and needed CIRs for all capacity queue projects. CIRs from retiring units should be made available to the next resource in the queue that can use them, on the retirement date of the retiring resource. Generation owners do not have property rights in CIRs. The value of CIRs is a result of the entire transmission system which has been paid for by customers and other generators. The value of CIRs is a result of the existence of a network and is not a result solely or even primarily of the investment that may or may not have been required in order to get CIRs. The cost of CIRs is part of project costs included in generation owners' investment decisions like any other project cost and subject to the same risk and reward structure. Open access to the transmission system by new resources should not be limited by claims to own the access rights by retiring units. In addition, the proposal to bypass the PJM interconnection process with a private, bilateral process ignores the fact that if the new resource is a renewable resource or a storage resource, the new resource does not have a capacity market must offer requirement. The PJM interconnection process could be bypassed, CIRs transferred and then the resource does not offer into the capacity market. In that case, scarce CIRs will be withheld by a generator who does not provide capacity and customers have to pay for an additional capacity resource instead.

The MMU recommends that PJM establish an expedited PJM managed queue process to identify commercially viable projects that could help eliminate or reduce the need for specific RMRs or that could address specific reliability needs and allow the identified projects to advance in the queue ahead of projects which have failed

<sup>226</sup> See PJM, "Enhancing Capacity Interconnection Rights (CIR) Transfer Efficiency: Problem / Opportunity Statement," <<https://www.pjm.com/-/media/committees-groups/subcommittees/ips/2023/20230731/20230731-item-08b---enhancing-capacity-interconnection-rights---cir---transfer-efficiency-problem-statement.ashx>>.

<sup>227</sup> On April 30, 2024, the CIR Transfer Efficiency issue was transferred from the Interconnection Process Subcommittee (IPS) to the Planning Committee (PC).



to make progress, subject to rules to prevent gaming. Rules should be developed to permit PJM to advance projects in the queue if they would resolve immediate reliability issues that result, for example, from unit retirements. The rules should be consistent with the flexibility included in the new queue process but add the option for PJM to expedite the interconnection and commercial operation of projects in the queue that would address identified reliability issues, consistent with the standing of the projects in the queue.

The fundamental purpose of the queue process is to provide open access to the grid for supply resources. More specifically, the fundamental purpose of the queue process for capacity resources is to provide open access to the grid and to ensure that the energy from capacity resources is deliverable so that capacity resources can meet their must offer obligations in the energy market and provide reliable energy supply during all conditions. In order to ensure that open access, all capacity resources should be required to have a must offer obligation in the capacity market. If they do not, such resources are effectively withholding access to the grid from capacity resources that would take on a must offer obligation in the capacity market. The result creates market power for the resources with no must offer obligation, noncompetitively limits access to the grid, increases capacity market prices above the competitive level, and creates uncertainty and unpredictable volatility in the capacity market.

The addition of a planned transmission project changes the parameters of the capacity auction for the area, changes the amount of capacity needed in the area, changes the capacity market supply and demand fundamentals in the area and may effectively forestall the ability of generation to compete. But there is no mechanism to permit a direct comparison, let alone competition, between transmission and generation alternatives. There is no mechanism to evaluate whether the generation or transmission alternative is less costly, whether there is more risk associated with the generation or transmission alternatives, or who bears the risks associated with each alternative. Creating such a mechanism should be an explicit goal of PJM market design.

The current market efficiency process does exactly the opposite by permitting transmission projects to

be approved without competition from generation. The broader issue is that the market efficiency project approach explicitly allows transmission projects to compete against future generation projects, but without allowing the generation projects to compete. Projecting speculative transmission related benefits for 15 years based on the existing generation fleet and existing patterns of congestion eliminates the potential for new generation to respond to market signals. The market efficiency process allows assets built under the cost of service regulatory paradigm to displace generation assets built under the competitive market paradigm. In addition, there are significant issues with PJM's current benefit/cost analysis which cause it to consistently overstate the potential benefits of market efficiency projects. The market efficiency process is misnamed. The MMU recommends that the market efficiency process be eliminated.

In addition, the use of an incorrectly defined cost-benefit method by PJM and the correct method by MISO results in an over allocation of the costs associated with joint PJM/MISO transmission projects to PJM participants and in some cases approval of projects that do not pass a correctly defined benefit/cost test.

If it is retained, there are significant issues with PJM's benefit/cost analysis that should be addressed prior to approval of additional projects. The current benefit/cost analysis explicitly and incorrectly ignores the increased costs to load in zones that results from an RTEP project when calculating the energy market benefits. All increases and decreases in costs should be included in all zones and LDAs. The definition of benefits should also be reevaluated.

The benefit/cost analysis should also account for the fact that the transmission project costs are not subject to cost caps and may exceed the estimated costs by a wide margin. When actual costs exceed estimated costs, the benefit/cost analysis is effectively meaningless and low estimated costs may result in inappropriately favoring transmission projects over market generation projects. The risk of cost increases for transmission projects should be incorporated in the benefit/cost analysis.

There are currently no market incentives for transmission owners to plan, submit and complete transmission outages in a timely and efficient manner. Requiring transmission owners to pay does not create



an effective incentive when those payments are passed through to transmission customers. The process for the submission of planned transmission outages needs to be carefully reviewed and redesigned to limit the ability of transmission owners to submit transmission outages that are late for FTR auction bid submission dates and are late for the day-ahead energy market and that have large and unnecessary impacts on the PJM energy market. The submission of late transmission outages can inappropriately affect market outcomes when market participants do not have the ability to modify market bids and offers. The PJM process for evaluating the congestion impact of transmission outages needs to be clearly defined and upgraded to provide for management of transmission outages to minimize market impacts. The MMU continues to recommend that PJM draft a clear and expanded definition of the congestion analysis required for transmission outage requests that is incorporated in the PJM Market Rules. PJM Manual 38 currently defines congestion resulting from a transmission outage as an overload on transmission facilities rather than using the general economic definition of congestion resulting from out of merit generation to control constraints. PJM does not currently evaluate the economic impact of congestion when reviewing proposed transmission outages.<sup>228</sup>

The treatment by PJM and Dominion Virginia Power of the outage for the Lanexa – Dunnsville Line illustrates some of the issues with the current process. The outage was submitted and delayed more than once. PJM's analysis of expected congestion did not highlight the magnitude of the issue. Dominion Virginia Power did not stage the outage so as to minimize market disruption and congestion until after there were significant disruptions and congestion.

As an example of the complexities of defining the benefits of transmission investments, the reduction in congestion is frequently and incorrectly cited as a metric of benefits. Congestion is frequently misunderstood. Congestion is not static. Congestion exhibits dynamic intertemporal variability and dynamic locational variability. More importantly, congestion is not the correct metric for evaluating the potential benefits of enhancing the transmission grid. The correct metric is the total net change in production costs.

There is not a secular trend towards increasing congestion in PJM. Congestion is volatile on a monthly basis. Congestion is also volatile on an hourly and daily basis. For example, higher congestion can result from changes in seasonal and daily/hourly fuel costs.

The level and distribution of congestion at a point in time is a function of the location and size of generating units, the relative costs of the fuels burned and the associated marginal costs of generating units, the location and size of load and the locational capability of the transmission grid. Each of these factors changes over time.

The geographic distribution of congestion is dynamic. The nature and location of congestion in the PJM system has changed significantly over the last 10 years and continues to change. The nature and location of congestion in PJM can also change from one day to the next as a result of changes in relative fuel costs. As a result, building transmission to address a specific pattern of congestion does not make sense, unless the technology can be easily moved to new locations as conditions change. The transmission system is only one of many reasons that congestion exists. The dynamic nature of congestion and the multiple, interactive causes of congestion make it virtually impossible to identify the standalone impacts of an individual transmission investment on future congestion. It is possible, for example, that congestion occurring during a period of a few days in the winter as a result of very high fuel prices, significantly increases the reported level of congestion for the entire year. This has occurred in PJM. It would be a mistake to consider that level of congestion to be a signal to build transmission.

At a more fundamental level, congestion is not the correct metric for evaluating the potential benefits of enhancing the transmission grid. When there are binding transmission constraints and locational price differences, load pays more for energy than generation is paid to produce that energy. The difference is congestion. Congestion is neither good nor bad, but is a direct measure of the extent to which there are multiple marginal generating units with different offers dispatched to serve load as a result of transmission constraints. Congestion occurs when available, least-cost energy cannot be delivered to all load because transmission facilities are not adequate to deliver that energy to one or more areas, and higher cost units in the

<sup>228</sup> PJM, "Manual 38: Operations Planning," Rev. 18 (February 22, 2024) at 19-20.

constrained area(s) must be dispatched to meet the load. The result is that the price of energy in the constrained area(s) is higher than in the unconstrained area. Load in the constrained area pays the higher price for all energy including energy from low cost generation and energy from high cost generation, while only high cost generators are paid the high price at their bus and low cost generators are paid only the low price at their bus.

If FTRs worked perfectly and were assigned directly to load, FTRs would return all congestion to the load that paid the congestion. Congestion is not a cost, it is an accounting result of a market based on locational energy prices in which all load in a constrained area pays the higher single market clearing locational price, resulting in excess payments by load that are not paid to generation, which should be returned to load.

Counterintuitively, congestion actually increases when the transmission capacity between areas with lower cost generation and areas with higher cost generation increases but does not fully eliminate the need for some higher cost local generation. The smaller the amount of higher cost local generation needed to meet load, the more of the local load is met via low cost generation delivered over the transmission system and therefore the higher is the difference between what load pays and generation receives, congestion.

For all these reasons, if done correctly and if FTRs/ARRs returned 100 percent of congestion to load, the benefit/cost analysis for transmission projects would include the total net change in production costs and would not include congestion. The change in production costs correctly measures the changes in cost to load that result from a project.

The PJM Regional Transmission Expansion Plan (RTEP) successfully addresses the need for transmission investment to reliably meet load. Together with the requirement that new generation pay interconnection costs, the RTEP process has resulted in the appropriate level of new transmission investment in PJM. There is no evidence that the PJM planning process is not adequate to meet the requirements of the PJM markets. Additional transmission investment is not a panacea. Transmission investment is expensive and long lived and it is essential that transmission investments be carefully planned for clearly identified needs in order to ensure that power

markets can continue to provide reliable service at a competitive price.

PJM must make out of market payments to units that want to retire (deactivate) but that PJM requires to remain in service, for limited operation, for a defined period because the unit is needed for reliability.<sup>229</sup> This provision has been known as Reliability Must Run (RMR) service but RMR is not defined in the PJM tariff. The correct term is Part V reliability service. The need to retain uneconomic units in service reflects a flawed market design and/or planning process problems. If a unit is needed for reliability, the market should reflect a locational value consistent with that need which would result in the unit remaining in service or being replaced by a competitor unit. The planning process should evaluate the impact of the loss of units at risk and determine in advance whether transmission upgrades are required in order to limit the duration of Part V service for individual units. It is essential that the deactivation provisions of the tariff be evaluated and modified. It is also essential that PJM look forward and attempt to plan for foreseeable unit retirements, whether for economic or regulatory reasons. PJM should consider an expedited queue process for projects that could replace the retiring capacity including the immediate transfer of the retiring unit's CIRs to units in the queue in order to permit generation to compete as an alternative to the current transmission only approach.

An area in northern Virginia in the Dominion Transmission Zone, known as Data Center Alley, has experienced significant load growth from data centers. Dominion has presented 44 supplemental project requests to serve the increase in load through the summer of 2025. As part of the supplemental planning process, PJM performs a do no harm analysis. PJM identified the need for additional baseline reinforcements to support the load growth. These baseline reinforcements were addressed in the 2022 RTEP Window 3, when the PJM board approved \$1.2 billion of necessary baseline upgrades specific to the Data Center Alley reinforcements.<sup>230</sup> These regional transmission costs were allocated according to Schedule 12 of PJM's Open Access Transmission Tariff (OATT), where costs are shared across all zones by a combination of load ratio share and distribution factor impacts. The transmission owners include these project costs in their

<sup>229</sup> OATT Part V §114.

<sup>230</sup> See "Transmission Expansion Advisory Committee (TEAC) Recommendations to the PJM Board," December 2023. <<https://www.pjm.com/-/media/committees-groups/committees/teac/2023/20231205/20231205-pjm-teac-board-whitepaper-december-2023.ashx>>.

base case, and all retail customers in the PJM footprint pay for those upgrade costs through increased energy bills. The cost allocation of the \$1.2 billion in baseline upgrades are assigned to all retail customers and not solely to the customers requesting interconnection.

The high level of customer requests in Data Center Alley resulted in the need for significant baseline reliability upgrades. These costs were allocated per Schedule 12 of the PJM OATT. Not all customer requests result in reliability upgrades. Transmission upgrades for customer requests that are submitted through the supplemental planning process are allocated 100 percent to the zone where they are interconnecting. The transmission owner of that zone then includes those project costs in their rate base, and all retail customers in that zone pay those costs.

The main focus of PJM's planning requirements has been to ensure adequate transmission to allow for generation to reliably serve load. Historically, PJM has had enough excess generation to serve the forecasted load in the RTEP process. In recent years, due in part to the significant increase in load resulting from large load interconnection requests and an increase in thermal unit deactivations, meeting forecasted loads and reserves with existing generation has become an issue. In order to solve the RTEP study cases, PJM must make assumptions about the existing and future generation to include in the RTEP model based on the need to serve load. The RTEP analysis first includes all existing generation that is expected to remain in service for the year being studied. When the forecasted load exceeds the expected in service generation, the RTEP analysis includes future generation. Planned generators with a signed interconnection service agreement (ISA) or generation interconnection agreement (GIA), or that cleared a BRA, are included. When the PJM load in the RTEP analysis exceeds the sum of existing generation and generation with an executed final agreement, the RTEP analysis adds speculative new generation that is in its Phase 3 system impact study status to meet the load. If needed, additional generation (pre-GIA stage or with a suspended status) may be modeled consistent with the procedures noted in Manual 14B.<sup>231 232</sup> The RTEP analysis

is not adequately coordinated with PJM markets analysis including the energy and capacity markets.

## Overview: Section 13, FTRs and ARR

### Auction Revenue Rights

#### Market Structure

- **ARR Ownership.** In the 2024/2025 planning period ARRs were allocated to 1,523 individual participants, held by 126 parent companies, up from 1,504 individual parents, held by 123 parent companies in the 2023/2024 planning period. ARR ownership for the 2024/2025 planning period was unconcentrated with an HHI of 610, down from 617 for the 2023/2024 planning period.

#### Market Behavior

- **Self Scheduled FTRs.** For the 2024/2025 planning period, 25.3 percent of eligible ARRs were self scheduled as FTRs, up from 24.1 percent for the 2023/2024 planning period.

#### Market Performance

- **ARRs as an Offset to Congestion.** ARRs have not served as an effective mechanism to return all congestion revenues to load. For the first seven months of the 2024/2025 planning period, ARRs and self scheduled FTRs offset 55.9 percent of total congestion. Congestion payments by load in some zones were more than offset and congestion payments in some zones were less than offset. Load has been underpaid congestion revenues by \$4.6 billion from the 2011/2012 planning period through the first seven months of the 2024/2025 planning period. The cumulative offset for that period was 69.6 percent of total congestion.
- **ARR Payments.** For the first seven months of the 2024/2025 planning period, the ARR target allocations, which are based on the nodal price differences from the Annual FTR Auction, were \$1,429.7 million, while PJM collected \$1,654.3 million from the combined Long Term, Annual and Monthly Balance of Planning Period FTR Auctions. For the 2023/2024 planning period, the ARR target allocations were \$1,592.2 million while PJM collected \$1,874.5 million from the combined Annual and Monthly Balance of Planning Period FTR Auctions.

<sup>231</sup> See "Review of 2025 RTEP Assumptions," presented at the January 7, 2025 meeting of the Transmission Expansion Advisory Committee. <<https://www.pjm.com/-/media/DotCom/committees-groups/committees/teac/2025/20250107/20250107-item-11---2025-rtep-assumption.pdf>>.

<sup>232</sup> See "PJM Manual 14B: PJM Region Transmission Planning Process," Rev. 56 (June 27, 2024).

- **ARR.** For the first seven months of the 2024/2025 planning period there was not enough day-ahead congestion revenue to pay FTR target allocations. As a result, \$77.1 million of FTR auction revenue was transferred from ARR holders to FTR holders. Although PJM refers to this as a surplus, there is no such thing as surplus FTR auction revenue based on market logic. FTR Auction revenue results from the market prices paid by willing FTR buyers, should be paid to ARR holders, and should not be returned to FTR buyers for any reason.

- **Residual ARRs.** Residual ARRs are only available on contract paths prorated in Stage 1 of the annual ARR allocation, are only effective for single, whole months and cannot be self scheduled. Residual ARR clearing prices are based on monthly FTR auction clearing prices. Residual ARRs with negative target allocations are not allocated to participants. Instead they are removed and the model is rerun.

In the first seven months of the 2024/2025 planning period, PJM allocated a total of 12,242.3 MW of residual ARRs with a total target allocation of \$7.1 million, down from 15,045.3 MW, with a total target allocation of \$5.0 million, in the same period of the 2023/2024 planning period.

- **ARR Reassignment for Retail Load Switching.** There were 26,290 MW of ARRs associated with \$0.5 million of revenue that were reassigned for the first seven months of the 2024/2025 planning period. There were 34,601 MW of ARRs associated with \$0.8 million of revenue that were reassigned in the 2023/2024 planning period.

## Financial Transmission Rights

### Market Design

- **Monthly Balance of Planning Period FTR Auctions.** The design of the Monthly Balance of Planning Period FTR Auctions includes auctions for each remaining month in the planning period.

### Market Structure

- **Patterns of Ownership.** For the Monthly Balance of Planning Period Auctions, financial entities purchased 80.4 of all prevailing and counter flow FTRs, including 75.2 percent of prevailing flow and 86.8 percent of counter flow FTRs for the first seven months of the 2024/2025 planning period. Financial

entities owned 75.3 percent of all prevailing and counter flow FTRs, including 69.0 percent of all prevailing flow FTRs and 83.4 percent of all counter flow FTRs during the first seven months of the 2024/2025 planning period. Self scheduled FTRs account for 4.4 percent of all FTRs held.

- **Market Concentration.** In the Monthly Balance of Planning Period Auctions for the first seven months of the 2024/2025 planning period, ownership of cleared prevailing flow bids was unconcentrated in all periods. Ownership of cleared counter flow bids was unconcentrated in 88.9 percent of periods and moderately concentrated in 11.1 percent of periods.

## Market Behavior

- **Sell Offers.** In a given auction, market participants can sell FTRs acquired in preceding auctions or preceding rounds of auctions. In the 2024/2027 Long Term FTR Auction, total participant FTR sell offers were 1,293,978 MW. In the 2024/2025 Annual FTR Auction, total participant FTR sell offers were 1,172,749 MW. In the Monthly Balance of Planning Period FTR Auctions for the first seven months of the 2024/2025 planning period, total participant FTR sell offers were 36,232,818 MW.
- **Buy Bids.** In the 2024/2027 Long Term FTR auction, total FTR buy bids were 5,729,618 MW, up 312.7 percent from 1,388,159 MW the previous long term auction. There were 4,770,381 MW of buy and self scheduled bids in the 2024/2025 Annual FTR Auction, up 26.4 percent from 3,773,919 MW the previous planning period. The total FTR buy bids from the Monthly Balance of Planning Period FTR Auctions for the first seven months of the 2024/2025 planning period were 48,161,694 MW.
- **FTR Forfeitures.** Total FTR forfeitures were \$1.96 million for the first seven months of the 2024/2025 planning period, up 20.2 percent from \$1.63 million for the first seven months of the 2023/2024 planning period.
- **Credit.** There were no collateral defaults and one payment default in 2024.

## Market Performance

- **Quantity.** In the 2024/2027 Long Term FTR Auction 638,671 MW (11.1 percent) of buy bids cleared and 139,507 MW (10.8 percent) of sell offers cleared. In the Annual FTR Auction for the 2024/2025 planning



period 1,028,420 MW (21.6 percent) of buy and self scheduled bids cleared, up 17.1 percent from 878,232 (23.3 percent) for the previous planning period. In the first seven months of the 2024/2025 planning period, Monthly Balance of Planning Period FTR Auctions cleared 8,102,377 MW (16.8 percent) of FTR buy bids and 5,237,013 MW (14.5 percent) of FTR sell offers. For the 2023/2024 planning period, Monthly Balance of Planning Period FTR Auctions cleared 9,710,278 MW (14.5 percent) of FTR buy bids and 5,894,197 MW (16.2 percent) of FTR sell offers.

- **Price.** The weighted average buy bid FTR price in the 2024/2027 Long Term FTR Auction was \$0.07 per MW, down from \$0.13 from the 2023/2026 Long Term FTR Auction. The weighted average buy bid FTR price in the Annual FTR Auction for the 2024/2025 planning period was \$0.30 per MW, down from \$0.33 per MW in the 2023/2024 planning period. The weighted average buy bid cleared FTR price in the Monthly Balance of Planning Period FTR Auctions for all periods in the first seven months of the 2024/2025 planning period was \$0.44 per MWh, up from \$0.48 in the 2023/2024 planning period.
- **Revenue.** The 2024/2027 Long Term FTR Auction generated \$102.6 million of net revenue for all FTRs, down 44.4 percent from \$184.5 million from the 2023/2026 Long Term FTR Auction. The 2024/2025 Annual FTR Auction generated \$1,475.2 million in net revenue, down 12.9 percent from \$1,694.3 million for the 2023/2024 Annual FTR Auction. The Monthly Balance of Planning Period FTR Auctions resulted in net revenue of \$69.0 million in the first seven months of the 2024/2025 planning period, up 1.2 percent from \$68.1 million in the first seven months of the 2023/2024 planning period.
- **"Revenue Adequacy."** For the first seven months of the 2024/2025 planning period there was not enough day-ahead congestion revenue to pay FTR target allocations. As a result, \$77.1 million of FTR auction revenue was transferred from ARR holders (load) to FTR holders, and FTRs were paid 100.0 percent of the target allocations for the first seven months of the 2024/2025 planning period. Based on market logic, there is no such thing as surplus FTR auction revenue and there is no such thing as revenue inadequacy.

- **Profitability.** FTR profitability is the difference between the revenue received directly from holding an FTR plus any revenue from the sale of an FTR, and the cost of buying the FTR. In the first seven months of the 2024/2025 planning period, profits for all participants were \$518.2 million, up from \$167.8 million in profits in the same time period in the 2023/2024 planning period. In the first seven months of the 2024/2025 planning period, physical entities received \$134.6 million in profits on FTRs purchased directly (not self scheduled), up from \$54.3 million profits in the same time period in the 2023/2024 planning period. Financial entities received \$383.5 million in profits, up from \$113.4 million profits in the same time period in the 2023/2024 planning period.

## Section 13 Recommendations

### Market Design

- The MMU recommends that the current ARR/FTR design be replaced with defined congestion revenue rights (CRRs). A CRR is the right to actual congestion revenue that is paid by physical load at a specific bus, zone or aggregate. (Priority: High. First reported 2015. Status: Not adopted.)

### ARR

- The MMU recommends that the ARR/FTR design be modified to ensure that the rights to all congestion revenues are assigned to load. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that all historical generation to load paths be eliminated as a basis for assigning ARRs. The MMU recommends that the current design be replaced with a design in which the rights to actual congestion paid are assigned directly to the load that paid that congestion by node. (Priority: High. First reported 2015. Status: Partially adopted.)
- The MMU recommends that, under the current FTR design, the rights to all congestion revenue be allocated as ARRs prior to sale as FTRs. Reductions in allocated revenue as a contingency for outages and increased system capability should be reserved for ARRs rather than sold in the Long Term FTR Auction. (Priority: High. First reported 2017. Status: Not adopted.)



- The MMU recommends that IARRs be eliminated from PJM's tariff, but that if IARRs are not eliminated, IARRs should be subject to the same proration rules that apply to all other ARR rights. (Priority: Low. First reported 2018. Status: Not adopted.)

## FTR

- The MMU recommends that FTR funding be based on total congestion, including both day-ahead and balancing congestion. (Priority: High. First reported 2017. Status: Not adopted.)
- The MMU recommends that bilateral transactions be eliminated and that all FTR transactions occur in the PJM market. (Priority: High. First reported 2022. Status: Not adopted.)<sup>233</sup>
- The MMU recommends a requirement that the details of all bilateral FTR transactions be reported to PJM. (Priority: High. First reported 2020. Status: Not adopted.)
- The MMU recommends that PJM continue to evaluate the bilateral indemnification rules and any asymmetries they may create. (Priority: Low. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM reduce FTR sales on paths with persistent overallocation of FTRs, including a clear definition of persistent overallocation and how the reduction will be applied. (Priority: High. First reported 2013. Status: Partially adopted, 2014/2015 planning period.)
- The MMU recommends that PJM eliminate generation to generation paths and all other paths that do not represent the delivery of power to load. (Priority: High. First reported 2018. Status: Not adopted.)
- The MMU recommends that the Long Term FTR product be eliminated. If the Long Term FTR product is not eliminated, the Long Term FTR Market should be modified so that the supply of prevailing flow FTRs in the Long Term FTR Market is based solely on counter flow offers in the Long Term FTR Market. (Priority: High. First reported 2017. Status: Not adopted.)
- The MMU recommends that PJM improve transmission outage modeling in the FTR auction models, including the use of probabilistic outage

modeling. (Priority: Low. First reported 2013. Status: Not adopted.)

## “Surplus”

- The MMU recommends that all FTR auction revenue be distributed to ARR holders monthly, regardless of FTR funding levels. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that, under the current FTR design, all congestion revenue in excess of FTR target allocations be distributed to ARR holders on a monthly basis. (Priority: High. First reported 2018. Status: Not adopted.)
- The MMU recommends that FTR auction revenues not be used by PJM to buy counter flow FTRs for the purpose of improving FTR payout ratios.<sup>234</sup> (Priority: High. First reported 2015. Status: Not adopted.)

## FTR Subsidies

- The MMU recommends that PJM eliminate portfolio netting to eliminate cross subsidies among FTR market participants. (Priority: High. First reported 2012. Status: Not adopted. Rejected by FERC.)
- The MMU recommends that PJM eliminate subsidies to counter flow FTRs by applying the payout ratio to counter flow FTRs in the same way the payout ratio is applied to prevailing flow FTRs. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM eliminate geographic cross subsidies. (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM examine the mechanism by which self scheduled FTRs are allocated when load switching among LSEs occurs throughout the planning period. (Priority: Low. First reported 2011. Status: Not adopted.)

## FTR Liquidation

- The MMU recommends that the FTR portfolio of a defaulted member be canceled rather than liquidated or allowed to settle as a default cost to the membership. (Priority: High. First reported 2018. Status: Not adopted.)

<sup>233</sup> If adopted, this recommendation would replace the next two recommendations.

<sup>234</sup> See “PJM Manual 6: Financial Transmission Rights,” Rev. 33 (Sep. 25, 2024).

## Credit

- The MMU recommends the use of at least a 99 percent confidence interval when calculating initial margin requirements for FTR market participants, in order to assign the cost of managing risk to the FTR holders who benefit or lose from their FTR positions. (Priority: High. First reported 2021. Status: Adopted 2023.)

## Section 13 Conclusion

### Solutions

The annual ARR allocation should be designed to ensure that the rights to all congestion revenues are assigned to load, without requiring contract path or point to point physical or financial transmission rights that are inconsistent with the network based delivery of power and the actual way congestion is generated in PJM's security constrained LMP market. When there are binding transmission constraints and locational price differences, load pays more for energy than generation is paid to produce that energy. The difference is congestion. As a result, congestion belongs to load and should be returned to load.

The current contract path based design should be replaced with a design in which the rights to actual congestion paid are assigned directly to the load that paid that congestion by node. The assigned right should be to the actual difference between load payments, both day-ahead and balancing, and revenues paid to the generation used to serve that load. The load can retain the right to the congestion revenues or sell the rights through auctions. The correct assignment of congestion revenues to load is fully consistent with retaining FTR auctions for the voluntary sale by load of their congestion revenue rights at terms defined by load, recognizing that load has property rights to congestion.

### Issues

If the original PJM FTR approach had been designed to return congestion revenues to load without the use of generation to load contract paths, and if the distortions subsequently introduced into the FTR design had not been added, many of the subsequent issues with the FTR design and complex redesigns would have been avoided. PJM would not have had to repeatedly intervene in the functioning of the FTR system in an effort to meet

the artificial and incorrectly defined goal of revenue adequacy.

PJM has persistently and subjectively intervened in the FTR market in order to affect the payments to FTR holders. These interventions are not appropriate. For example, in the 2014/2015, 2015/2016 and 2016/2017 planning periods, PJM significantly reduced the allocation of ARR capacity, and FTRs, in order to guarantee full FTR funding. PJM reduced system capability in the FTR auction model by including more outages, reducing line limits and including additional constraints. PJM's modeling changes resulted in significant reductions in Stage 1B and Stage 2 ARR allocations, a corresponding reduction in the available quantity of FTRs, a reduction in congestion revenues assigned to ARRs, and an associated surplus of congestion revenue relative to FTR target allocations. This also resulted in a significant redistribution of ARRs among ARR holders based on differences in allocations between Stage 1A and Stage 1B ARRs. Starting in the 2017/2018 planning period, with the allocation of balancing congestion and M2M payments to load rather than FTRs, PJM increased system capability allocated to Stage 1B and Stage 2 ARRs, but continued to conservatively select outages to manage FTR funding levels.

PJM has intervened aggressively in the FTR market since its inception in order to meet various subjective objectives including so called revenue adequacy. PJM should not intervene in the FTR market to subjectively manage FTR funding. PJM should fix the FTR/ARR design and then should let the market work to return congestion to load and to let FTR values reflect actual congestion.

Load should never be required to subsidize payments to FTR holders, regardless of the reason.<sup>235</sup> The FERC order of September 15, 2016, introduced a subsidy to FTR holders at the expense of ARR holders.<sup>236</sup> The order requires PJM to ignore balancing congestion when calculating total congestion dollars available to fund FTRs. As a result, balancing congestion and M2M payments are assigned to load, rather than to FTR holders, as of the 2017/2018 planning period. When combined with the direct assignment of both surplus day-ahead congestion and surplus FTR auction revenues to FTR holders, the Commission's order shifted substantial

<sup>235</sup> Such subsidies have been suggested repeatedly. See FERC Dockets Nos. EL13-47-000 and EL12-19-000.

<sup>236</sup> See 156 FERC ¶ 61,180 (2016), *reh'g denied*, 158 FERC ¶ 61,093 (2017).

revenue from load to the holders of FTRs and further reduced the offset to congestion payments by load. This approach ignores the fact that load pays both day-ahead and balancing congestion, and that actual congestion is the sum of day-ahead and balancing congestion. Eliminating balancing congestion from the FTR revenue calculation requires load to pay twice for congestion. Load pays total congestion and pays negative balancing congestion again. The fundamental reasons that there has been a significant and persistent difference between day-ahead and balancing congestion include inadequate transmission modeling in the FTR auction and the role of UTCs in taking advantage of these modeling differences and creating negative balancing congestion. There is no reason to impose these costs on load.

These changes were made in order to increase the payout to holders of FTRs who are not loads. Increasing the payout to FTR holders at the expense of the load is not a supportable market objective. PJM should implement an FTR design that calculates and assigns congestion rights to load rather than continuing to modify the current, fundamentally flawed, design.

Load was made significantly worse off as a result of the changes made to the FTR/ARR process by PJM based on the FERC order of September 15, 2016. ARR revenues were significantly reduced for the 2017/2018 FTR Auction, the first auction under the new rules. ARRs and self scheduled FTRs offset only 49.5 percent of total congestion costs for the 2017/2018 planning period rather than the 58.0 percent offset that would have occurred under the prior rules, a difference of \$101.4 million.

A subsequent rule change was implemented that modified the allocation of what is termed surplus auction revenue to load. Beginning with the 2018/2019 planning period, surplus day-ahead congestion and surplus FTR auction revenue are assigned to FTR holders only up total target allocations, and then distributed to ARR holders.<sup>237</sup> ARR holders will only be allocated this surplus after FTRs are paid 100 percent of their target allocations. While this rule change increased the level of congestion revenues returned to load under some conditions, the rules do not recognize ARR holders' rights to all congestion revenue, and only improves congestion payouts to load when there is a surplus. There was no surplus for the 2020/2021 or 2021/2022 planning years. With this rule in effect for

<sup>237</sup> 163 FERC ¶ 61,165 (2018).

the 2021/2022 planning period, ARRs and self scheduled FTRs offset 31.6 percent of total congestion. There was surplus for the 2022/2023 and the 2023/2024 planning periods. However, FTR auction surplus revenues were taken from load and given to FTR holders because day-ahead congestion revenues were less than target allocations in the 2023/2024 planning period. Based on market logic, there is no such thing as surplus FTR auction revenue. FTR Auction revenue results from the market prices paid by willing FTR buyers, should be paid to ARR holders, and should not be returned to FTR buyers for any reason. ARRs and self scheduled FTRs offset only 55.9 percent of total congestion paid by ARR holders in the first seven months of the 2024/2025 planning period. Load has been underpaid congestion revenues by \$4.6 billion from the 2011/2012 planning period through the first seven months of the 2024/2025 planning period. The cumulative offset for that period was 69.6 percent of total congestion.

The complex process related to what is termed the overallocation of Stage 1A ARRs is entirely an artificial result of reliance on the contract path model in the assignment of FTRs. For example, there is a reason that transmission is not actually built to address the Stage 1A overallocation issue. The Stage 1A overallocation issue is a fiction based on the use of outdated and irrelevant generation to load contract paths to assign Stage 1A rights that have nothing to do with actual power flows.

PJM proposed, and on March 11, 2022, FERC accepted, an increase to Stage 1A ARR allocations from 50 percent of Network Service Base Load (NSBL) to 60 percent of Network Service Peak Load (NSPL).<sup>238</sup> NSBL is a network service customer's contribution to the lowest daily zonal peak load in the prior twelve month period, and NSPL is a network service customer's contribution to the highest daily zonal peak load in the prior 12 month period. PJM's new ARR allocation rules have increased Stage 1A rights at the cost of Stage 1B and Stage 2 ARR allocations. More importantly, PJM's new ARR allocation rules have exacerbated the current misalignment between congestion property rights and the congestion paid by load.

## Proposed Design

To address the issues with the current contract path based ARR/FTR market design, the MMU recommends that the current design be replaced with a design in

<sup>238</sup> See 178 FERC ¶ 61,170.

which the rights to actual congestion paid are assigned directly to the load that paid that congestion by node. The assigned right would be the actual difference between load payments, both day-ahead and balancing, and revenues paid to the generation used to serve that load. The load could retain the right to the congestion or sell the right through auctions. The correct assignment of congestion revenues to load is fully consistent with retaining FTR auctions for the voluntary sale by load of their congestion revenue rights at terms defined by load.

With a network assignment of actual congestion, there would be no cross subsidies among rights holders and no over or under allocation of rights relative to actual network market solutions. There would be no revenue shortfalls as congestion payments equal congestion collected. The risk of default would be isolated to the buyer and seller of the right, and any default would not be socialized to other rights holders. In the case of a defaulting buyer, the rights to the congestion revenues would revert to the load. There would be no risk of a network right flipping in value from positive to negative, because congestion is always the positive difference between what load pays for energy and what generation is paid for energy as a result of transmission constraints.

The MMU proposal requires the calculation of constraint specific congestion and the calculation of that specific constraint's congestion related charges to each physical load bus downstream of that constraint. Under the MMU proposal, the constraint specific congestion calculated by hour, from both the day-ahead and balancing market would be paid directly to the physical load as a credit against the associated load serving entity's (LSE) energy bill. This right to the congestion is defined as the congestion revenue right (CRR) that belongs to the physical load at a defined bus, zone or aggregate. The LSE could choose to sell all or a portion of the CRR through auctions.

A CRR is the right to actual, realized network related congestion that is paid by physical load at a specific bus, zone or aggregate. Under the MMU proposal a bus, zone or aggregate specific CRR could be sold as a defined share of the actual congestion. For example, an LSE could sell 50 percent of its congestion revenue right for the planning period to a third party. The third party buyer would then be entitled to 50 percent of the congestion that is credited to that specific bus, zone or

aggregate for the planning period. The remaining 50 percent of the congestion credit for the specified bus, zone or aggregate would be paid to the LSE along with the auction clearing price for the 50 percent of the CRR that was sold to the third party. Depending on actual congestion and the price paid for a CRR, an LSE selling its congestion revenue rights could be better or worse off than if it retained its rights.

Under the MMU proposal, the LSE would be able to set reservation prices in the auction for the sale of portions or all of its CRR. Third parties would have an opportunity to bid for the offered portions of the CRR, and the market for the congestion revenue associated with the specified bus, zone or aggregate would clear at a price. If the reservation price of an identified portion of the offered CRR was not met at the clearing price, that portion of the offered CRR would remain with the load. Auctions could be annual and/or monthly and/or more frequent.

Under the MMU proposal, point to point rights (FTRs) could exist as a separate, self-funded hedging product based on simultaneously feasible prevailing and counter flows in a PJM managed network based auction. The only supply and the only source of revenues in the point to point market for prevailing flow FTRs would be counter flow offers and direct payments for specific rights.





## Recommendations

In order to perform its role in PJM market design, the MMU evaluates existing and proposed PJM Market Rules and the design of the PJM Markets.<sup>1</sup> The MMU initiates and proposes changes to the design of the markets and the PJM Market Rules in stakeholder and regulatory proceedings.<sup>2</sup> In support of this function, the MMU engages in discussions with stakeholders, State Commissions, PJM management, and the PJM Board; participates in PJM stakeholder meetings and working groups regarding market design matters; publishes proposals, reports and studies on market design issues; and makes filings with the Commission on market design issues.<sup>3</sup> The MMU also recommends changes to the PJM Market Rules to the staff of the Commission's Office of Energy Market Regulation, State Commissions, and the PJM Board.<sup>4</sup> The MMU may provide in its annual, quarterly and other reports "recommendations regarding any matter within its purview."<sup>5</sup>

## Recommendation Priority

Priority rankings are relative. The creation of rankings recognizes that there are limited resources available to address market issues and that problems must be ranked in order to determine the order in which to address them. It does not mean that all the problems should not be addressed. Priority rankings are dynamic and as new issues are identified, priority rankings will change. The rankings reflect a number of factors including the significance of the issue for efficient markets, the difficulty of completion and the degree to which items are already in progress. A low ranking does not necessarily mean that an issue is not important, but could mean that the issue would be easy to resolve.

There are three priority rankings: High, Medium and Low. High priority indicates that the recommendation requires action because it addresses a market design issue that creates significant market inefficiencies and/or long lasting negative market effects. Medium priority indicates that the recommendation addresses a market design issue that creates intermediate market inefficiencies and/or near term negative market effects. Low priority indicates that the recommendation addresses a market design issue that creates smaller

market inefficiencies and/or more limited market effects or that it could be easily resolved.

## Recommendation Status

The MMU also tracks PJM's progress in addressing these recommendations. The MMU recognizes that part of the process of addressing recommendations may include discussions in the stakeholder process, FERC decisions and court decisions and those elements are included in the tracking. The MMU recognizes that PJM does not have the unilateral authority to implement changes to the tariff but PJM has a significant role in the issues PJM focuses on, in proposed changes to the PJM manuals, and in the recommendations PJM makes to the stakeholders and to FERC. Each recommendation includes a status. The status categories are:

- **Adopted:** PJM has implemented the recommendation made by the MMU.
- **Partially adopted:** PJM has implemented part of the recommendation made by the MMU.
- **Not adopted:** PJM does not plan to implement the recommendation made by the MMU, or has not yet implemented any part of the recommendation made by the MMU. Where the subject of the recommendation is pending stakeholder, FERC, or court action, that status is noted.
- **Withdrawn:** The MMU no longer makes the recommendation because it has become irrelevant or because it has been replaced by another recommendation.

## New Recommendations

Consistent with its core function to "[e]valuate existing and proposed market rules, tariff provisions and market design elements and recommend proposed rule and tariff changes," the MMU recommends specific enhancements to existing market rules and implementation of new rules that are required for competitive results in PJM markets and for continued improvements in the functioning of PJM markets.<sup>6</sup>

In this *2024 Annual State of the Market Report for PJM*, the MMU includes seven new recommendations made for 2024, one of which is new in this 2024 annual report.<sup>7</sup>

<sup>1</sup> OATT Attachment M § IV.D.

<sup>2</sup> *Id.*

<sup>3</sup> *Id.*

<sup>4</sup> *Id.*

<sup>5</sup> OATT Attachment M § VI.A.

<sup>6</sup> 18 CFR § 35.28(g)(3)(iii)(A); see also OATT Attachment M § IV.D.

<sup>7</sup> New recommendations include all MMU recommendations that were reported for the first time in the *2024 Annual State of the Market Report for PJM* or in any of the three quarterly state of the market reports that were published in 2024.

## New Recommendation from Section 3, Energy Market

- The MMU recommends, in order to ensure effective market power mitigation, that PJM commit all resources that fail the TPS test on their cost-based offers, that the Market Seller designate the cost-based offer if there is more than one, and that PJM implement this solution as soon as possible. (Priority: High. First reported Q3 2024. Status: Not adopted.)

## New Recommendation from Section 5, Capacity Market

- The MMU recommends that the reference resource be a CT rather than a CC. The MMU recommends that the ELCC value used to convert the gross CONE in ICAP terms for a CT to the gross CONE in UCAP terms be the ELCC based on winter ratings. (Priority: High. First reported Q3 2024. Status: Not adopted.)

## New Recommendation from Section 9, Interchange Transactions

- The MMU recommends eliminating the mechanism that defines FFE and M2M payments. These mechanisms are not consistent with markets and are not needed for efficient interface pricing. The MMU recommends that PJM file with the Commission to eliminate the FFE calculation and M2M payment of the PJM and MISO joint operating agreement. (Priority: Medium. First reported Q2 2024. Status: Not adopted.)

## New Recommendation from Section 10, Ancillary Services

- The MMU recommends that PJM remove the 30 percent increase to the synchronized reserve reliability requirement. (Priority: High. New recommendation. Status: Not adopted.)

## New Recommendations from Section 12, Generation and Transmission Planning

- The MMU recommends that PJM establish an expedited PJM managed queue process to identify commercially viable projects that could help eliminate or reduce the need for specific RMRs or that could address specific reliability needs and allow the identified projects to advance in the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming. (Priority: High. First reported Q2, 2024. Status: Not adopted.)
- The MMU recommends that all PJM transmission owners investigate the applicability and potential cost savings of Grid Enhancing Technology (GET) and that all PJM transmission owners implement cost effective GET, subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. (Priority: Medium. First reported Q2, 2024. Status: Not adopted.)
- The MMU recommends that the implementation of Grid Enhancing Technology (GET) be opened to competition from third parties, subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. (Priority: Medium. First reported Q3, 2024. Status: Not adopted.)

## History of MMU Recommendations

The MMU began making recommendations to PJM in the 1999 State of the Market Report. Since that time, the MMU has made 392 recommendations in the State of the Market Reports. In 2014, the MMU began including a priority and status with each recommendation. The MMU has reviewed all past recommendations, assigned priority and determined their current status.

For the review of past recommendations, the MMU has refined the status assigned to each recommendation. The MMU uses additional definitions:

- **Partially Adopted (Continued Recommendation):** PJM has implemented part of the recommendation made by the MMU, and the MMU continues to recommend total adoption of the recommendation. These recommendations continue to be included in the main sections of this report;

- **Partially Adopted (Recommendation Closed):** PJM has implemented part of the recommendation made by the MMU, and the MMU has chosen to discontinue making the recommendation going forward. These recommendations are no longer included in the main sections of this report;
- **Not Adopted (Pending before FERC):** PJM has not yet implemented any part of the recommendation made by the MMU, but the subject of the recommendation is pending FERC action;
- **Not Adopted (Stakeholder Process):** PJM has not yet implemented any part of the recommendation made by the MMU, but the subject of the recommendation is pending stakeholder action;
- **Replaced by Newer Recommendation:** a recommendation that was discontinued when the MMU modified the recommendation;
- **Withdrawn (no longer relevant):** The MMU no longer makes the recommendation because it is no longer relevant; and
- **Withdrawn:** The MMU no longer makes the recommendation.

Table 2-1 shows the status of all recommendations reported by the MMU from 1999 through 2024. Over that time, 26 percent of all MMU recommendations have been adopted, 12 percent have been partially adopted, and 54 percent are not adopted. Of the 122 high priority recommendations, 35 (29 percent) have been adopted. Table 2-1 includes past recommendations that are no longer included in this report.

**Table 2-1 Status of MMU reported recommendations: 1999 through 2024**

Status	Priority High	Priority Medium	Priority Low	Total	Percent of Total
Adopted	35	39	28	102	26%
Partially Adopted - Stakeholder Process	0	0	0	0	0%
Partially Adopted - FERC	1	0	0	1	0%
Partially Adopted (Continued Recommendation)	13	18	5	36	9%
Partially Adopted (Recommendation Closed)	1	4	4	9	2%
Partially Adopted (Total)	15	22	9	46	12%
Not Adopted	63	100	37	200	51%
Not Adopted (Pending before FERC)	3	5	0	8	2%
Not Adopted (Stakeholder Process)	0	3	0	3	1%
Not Adopted (Total)	66	108	37	211	54%
Replaced by Newer Recommendation	2	11	3	16	4%
Withdrawn, No Longer Relevant	3	6	3	12	3%
Withdrawn	1	3	1	5	1%
Total	122	189	81	392	100%

## Complete List of Current MMU Recommendations

The recommendations are explained in each section of the report.

### Section 3, Energy Market

#### Market Power

- The MMU recommends that the market rules explicitly require that offers in the energy market be competitive, where competitive is defined to be the short run marginal cost of the units. The short run marginal cost should reflect opportunity cost when appropriate. The MMU recommends that the level of incremental costs includable in cost-based offers per the PJM Operating Agreement not exceed the short run marginal cost of the unit. (Priority: Medium. First reported 2009. Status: Not adopted.)

#### Fuel Cost Policies

- The MMU recommends that PJM require that all fuel cost policies be algorithmic, verifiable, and systematic, and accurately reflect short run marginal costs. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends that the temporary cost method be removed and that all units that submit nonzero cost-based offers be required to have an approved fuel cost policy. (Priority: Low. First reported 2020. Status: Not adopted.)
- The MMU recommends that the penalty exemption provision be removed and that all units that submit nonzero cost-based offers be required to follow their approved fuel cost policy. (Priority: Medium. First reported 2020. Status: Not adopted.)

## Cost-Based Offers

- The MMU recommends that Manual 15 (Cost Development Guidelines) be replaced or updated with a straightforward description of the components of cost-based offers and the mathematically correct calculation of cost-based offers for thermal resources. (Priority: Medium. First reported 2016. Status: Adopted 2023.)
- The MMU recommends removal of all use of FERC System of Accounts in the Cost Development Guidelines. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends the removal of all use of cyclic starting and peaking factors from the Cost Development Guidelines. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends the removal of all labor costs from the Cost Development Guidelines. (Priority: Medium. First reported 2016. Status: Adopted 2022.)
- The MMU recommends the removal of all maintenance costs from the Cost Development Guidelines. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that market participants be required to document the amount and cost of consumables used when operating in order to verify that the total operating cost is consistent with the total quantity used and the unit characteristics. (Priority: Medium. First reported 2020. Status: Adopted 2023.)
- The MMU recommends, given that maintenance costs are currently allowed in cost-based offers, that market participants be permitted to include only variable maintenance costs, linked to verifiable operational events and that can be supported by clear and unambiguous documentation of the operational data (e.g. run hours, MWh, MMBtu) that support the maintenance cycle of the equipment being serviced/replaced. (Priority: Medium. First reported 2020. Status: Partially adopted 2023.)
- The MMU recommends explicitly accounting for soak costs and changing the definition of the start heat input for combined cycles to include only the amount of fuel used from first fire to the first breaker close in the Cost Development Guidelines.

(Priority: Medium. First reported 2016. Status: Partially adopted.)

- The MMU recommends that soak costs, soak time and the MWh produced during soaking be modeled separately. This will ensure that the time required for units to reach a dispatchable level is known and used in the unit commitment process instead of only being communicated verbally between dispatchers and generators. Separating soak costs from start costs and modeling the MWh produced during soaking allows for a better representation of the costs because it eliminates the need to simply assume the price paid for those MWh. (Priority: Medium. First reported 2022. Status: Not adopted.)
- The MMU recommends the removal of nuclear fuel and nonfuel operations and maintenance costs that are not short run marginal costs from the Cost Development Guidelines. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends revising the pumped hydro fuel cost calculation to include day-ahead and real-time power purchases. (Priority: Low. First reported 2016. Status: Not adopted.)

## Market Power: TPS Test and Offer Capping

- The MMU recommends that the rules governing the application of the TPS test be clarified and documented. The TPS test application in the day-ahead energy market is not documented. (Priority: High. First reported 2015. Status: Partially adopted.)<sup>8</sup>
- The MMU recommends that PJM modify the process of applying the TPS test in the day-ahead energy market to ensure that all local markets created by binding constraints are tested for market power and to ensure that market sellers with market power are appropriately mitigated to their competitive offers. (Priority: High. First reported 2022. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation when the TPS test is failed, that offer capping be applied to units that fail the TPS test in the real-time market that were not offer capped at the time of commitment in the day-ahead market or at a prior time in the real-time market. (Priority: High. First reported 2020. Status: Not adopted.)

<sup>8</sup> The real-time market formula for determining the lowest cost schedule is documented. The day-ahead market formula for determining the lowest cost schedule is not documented.

- The MMU recommends, in order to ensure effective market power mitigation and to ensure that capacity resources meet their obligations to be flexible, that capacity resources be required to use flexible parameters in all offers at all times. (Priority: High. First reported 2021. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation, PJM always use cost-based offers for units that fail the TPS test, and always use flexible parameters for all cost-based and all price-based offers during high load conditions such as cold and hot weather alerts and emergency conditions. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM require every market participant to make available at least one cost schedule based on the same hourly fuel type(s) and parameters at least as flexible as their offered price schedule. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation when the TPS test is failed, that markup be consistently positive or negative across the full MWh range of price and cost-based offers. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation, that PJM commit all resources that fail the TPS test on their cost-based offers, that the Market Seller designate the cost-based offer if there is more than one, and that PJM implement this solution as soon as possible. (Priority: High. First reported Q3 2024. Status: Not adopted.)
- The MMU recommends that PJM retain the \$1,000 per MWh offer cap in the PJM energy market except when cost-based offers exceed \$1,000 per MWh, and retain other existing rules that limit incentives to exercise market power. (Priority: High. First reported 1999. Status: Partially adopted, 1999, 2017.)
- The MMU recommends the elimination of FMU and AU adders. FMU and AU adders no longer serve the purpose for which they were created and interfere with the efficient operation of PJM markets.

(Priority: Medium. First reported 2012. Status: Partially adopted, 2014.)<sup>9</sup>

### Offer Behavior

- The MMU recommends that resources not be allowed to violate the ICAP must offer requirement. The MMU recommends that PJM enforce the ICAP must offer requirement by assigning a forced outage to any unit that is derated in the energy market below its committed ICAP without an outage that reflects the derate. (Priority: Medium. First reported 2020. Status: Not adopted.)
- The MMU recommends that intermittent resources be subject to an enforceable ICAP must offer rule in the day-ahead and real-time energy markets that reflects the limitations of these resources. (Priority: Medium. First reported 2020. Status: Adopted 2023.)
- The MMU recommends that storage resources be subject to an enforceable ICAP must offer rule in the day-ahead and real-time energy markets that reflects the limitations of these resources. (Priority: Medium. First reported 2020. Status: Not adopted.)
- The MMU recommends that capacity resources not be allowed to offer any portion of their capacity market obligation as maximum emergency energy. (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM integrate all the outage reporting tools in order to enforce the ICAP must offer requirement, ensure that outages are reported correctly and eliminate reporting inconsistencies. Generators currently submit availability in three different tools that are not integrated, Markets Gateway, eDART and eGADS. (Priority: Medium. First reported 2022. Status: Not adopted.)
- The MMU recommends that gas generators be required to check with pipelines throughout the operating day to confirm that nominations are accepted beyond the NAESB deadlines, that gas generators be required to inform PJM about whether they have gas, and that gas generators be required to place their units on forced outage until the time that pipelines allow nominations to consume gas at a unit. (Priority: Medium. First reported 2022. Status: Not adopted.)

<sup>9</sup> The applicability of the FMU and AU adders is limited by the rule implemented in 2014 requiring that net revenues must fall below avoidable costs, but the possibility of FMU and AU adders is still part of the PJM Market Rules.



## Capacity Resources

- The MMU recommends that capacity resources be held to the OEM operating parameters of the capacity market CONE reference resource for performance assessment and energy uplift payments and that this standard be applied to all technologies on a uniform basis. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that the parameters which determine nonperformance charges and the amounts of uplift payments should reflect the flexibility goals of the capacity market design. The operational parameters used by generation owners to indicate to PJM operators what a unit is capable of during the operating day should not determine capacity resource performance assessment or uplift payments. (Priority: Medium. First reported 2015. Status: Partially adopted.)<sup>10</sup>
- The MMU recommends that PJM clearly define the business rules that apply to the unit specific parameter adjustment process, including PJM's implementation of the tariff rules in the PJM manuals to ensure market sellers know the requirements for their resources. (Priority: Low. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM update the tariff to clarify that all generation resources are subject to unit specific parameter limits on their cost-based offers using the same standard and process as capacity resources. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that resources not be paid the daily capacity payment when unable to operate to their unit specific parameter limits. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM not approve temporary exceptions that are based on pipeline tariff terms that are not enforced at the time, or are based on inferior transportation service procured by the generator. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that PJM require generators that violate their approved turn down ratio (by either using the fixed gen option or increasing their economic minimum) to use the temporary

<sup>10</sup> Flexible parameter standards are in place for combined cycle and combustion turbine resources when operating on a parameter limited schedule, but not for other schedules or generating technologies.

parameter exception process that requires market sellers to demonstrate that the request is based on a physical and actual constraint. (Priority: Medium. First reported 2021. Status: Not adopted.)

- The MMU recommends: that gas generators be required to confirm, regularly during the operating day, that they can obtain gas if requested to operate at their economic maximum level; that gas generators provide that information to PJM during the operating day; and that gas generators be required to be on forced outage if they cannot obtain gas during the operating day to meet their must offer requirement as a result of pipeline restrictions, and they do not have backup fuel. As part of this, the MMU recommends that PJM collect data on each individual generator's fuel supply arrangements at least annually or when such arrangements change, and analyze the associated locational and regional risks to reliability. (Priority: Medium. First reported 2022. Status: Not adopted.)
- The MMU recommends, if the capacity market seller offer cap were to be calculated using the historical average balancing ratio, that PJM not include the balancing ratios calculated for localized Performance Assessment Intervals (PAIs), and only include those events that trigger emergencies at a defined zonal or higher level. (Priority: Medium. First reported 2018. Status: Adopted, 2023.)<sup>11</sup>

## Accurate System Modeling

- The MMU recommends that PJM explicitly state its policy on the use of transmission penalty factors including: the level of the penalty factors; the triggers for the use of the penalty factors; the appropriate line ratings to trigger the use of penalty factors; the allowed duration of the violation and when the transmission penalty factors will be used to set the shadow price. The MMU recommends that PJM end the practice of manual and automated discretionary reductions in the control limits on transmission constraint line ratings used in the market clearing software (SCED) and included in LMP. (Priority: Medium. First reported 2015. Status: Partially adopted 2020.)<sup>12</sup>

<sup>11</sup> See 184 FERC ¶ 61,058 (2023).

<sup>12</sup> PJM created a more transparent process for transmission constraint penalty factors and added it to the tariff in 2020. Policies on reductions in control limits and the duration of violations remain discretionary and undocumented in the PJM Market Rules.

- The MMU recommends that PJM routinely review all transmission facility ratings and any changes to those ratings to ensure that the normal, emergency and load dump ratings used in modeling the transmission system are accurate and reflect standard ratings practice. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM not use closed loop interface or surrogate constraints to artificially override nodal prices based on fundamental LMP logic in order to: accommodate rather than resolve the inadequacies of the demand side resource capacity product; address the inability of the power flow model to incorporate the need for reactive power; accommodate rather than resolve the flaws in PJM's approach to scarcity pricing; or for any other reason. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM update the outage impact studies, the reliability analyses used in RPM for capacity deliverability, and the reliability analyses used in RTEP for transmission upgrades to be consistent with the more conservative emergency operations (post contingency load dump limit exceedance analysis) in the energy market that were implemented in June 2013.<sup>13</sup> (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM include in the tariff or appropriate manual an explanation of the initial creation of hubs, the process for modifying hub definitions and a description of how hub definitions have changed.<sup>14</sup> <sup>15</sup> (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that all buses with a net withdrawal be treated as load for purposes of calculating load and load-weighted LMP, even if the MW are settled to the generator. The MMU recommends that during hours when a load bus shows a net injection, the energy injection be treated as generation, not negative load, for purposes of calculating generation and load-weighted LMP, even if the injection MW are settled to the load serving entity. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM identify and collect data on available behind the meter generation resources, including nodal location information and relevant operating parameters. (Priority: Low. First reported 2013. Status: Partially adopted.)
- The MMU recommends that PJM document how LMPs are calculated when demand response is marginal. (Priority: Low. First reported 2014. Status: Not adopted.)
- The MMU recommends that PJM not allow nuclear generators which do not respond to prices or which only respond to manual instructions from the operator to set the LMPs in the real-time market. (Priority: Low. First reported 2016. Status: Not adopted.)
- The MMU recommends that PJM increase the coordination of outage and operational restrictions data submitted by market participants via eDART/eGADs and offer data submitted via Markets Gateway. (Priority: Low. First reported 2017. Status: Not adopted.)
- The MMU recommends that PJM model generators' operating transitions, including soak time for units with a steam turbine, configuration transitions for combined cycles, and peak operating modes. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that PJM clarify, modify and document its process for dispatching reserves and energy when SCED indicates that supply is less than total demand including forecasted load and reserve requirements. The modifications should define: a SCED process to economically convert reserves to energy; a process for the recall of energy from capacity resources; and the minimum level of synchronized reserves that would trigger load shedding. (Priority: Medium. First reported 2020. Status: Not adopted.)
- The MMU recommends that PJM stop capping the system marginal price in RT SCED and LPC and instead limit the sum of violated reserve constraint shadow prices that are included in the determination of LMP in LPC to \$1,700 per MWh. While PJM no

<sup>13</sup> This recommendation was the result of load shed events in September, 2013. For detailed discussion, please see *2013 Annual State of the Market Report for PJM*, Volume 2, Section 3 at 114 – 116.

<sup>14</sup> According to minutes from the first meeting of the Energy Market Committee (EMC) on January 28, 1998, the EMC unanimously agreed to be responsible for approving additions, deletions and changes to the hub definitions to be published and modeled by PJM. Since the EMC has become the Market Implementation Committee (MIC), the MIC now appears to be responsible for such changes.

<sup>15</sup> There is currently no PJM documentation in the tariff or manuals explaining how hubs are created and how their definitions are changed. The general definition of a hub can be found in the PJM.com Glossary <<http://www.pjm.com/Glossary.aspx>>.

longer caps prices in RT SCED, PJM continues to apply a cap to the system marginal price in the pricing run (LPC) under fast start pricing. (Priority: Medium. First reported 2021. Status: Not adopted.)

- The MMU recommends that PJM adjust the ORDCs during spin events to reduce the reserve requirement for synchronized and primary reserves by the amount of the reserves deployed. (Priority: Medium. First reported 2021. Status: Not adopted.)

## Transparency

- The MMU recommends that PJM clearly document the calculation of shortage prices and implementation of reserve price caps in the PJM manuals, including defining all the components of reserve prices, and all the constraints whose shadow prices are included in reserve prices. (Priority: High. First reported 2021. Status: Not adopted.)
- The MMU recommends that PJM allow generators to report fuel type on an hourly basis in their offer schedules and to designate schedule availability on an hourly basis. (Priority: Medium. First reported 2015. Status: Partially adopted.)<sup>16</sup>
- The MMU recommends that PJM define clear criteria for operator approval of RT SCED cases, including shortage cases, that are used to send dispatch signals to resources, and for pricing, to minimize discretion. (Priority: High. First reported 2018. Status: Partially adopted.)<sup>17</sup>

## Virtual Bids and Offers

- The MMU recommends eliminating up to congestion (UTC) bidding at pricing nodes that aggregate only small sections of transmission zones with few physical assets. (Priority: Medium. First reported 2020. Status: Not adopted.)
- The MMU recommends eliminating INC, DEC, and UTC bidding at pricing nodes that allow market participants to profit from modeling issues. (Priority: Medium. First reported 2020. Status: Not adopted.)

## Section 4, Energy Uplift

- The MMU recommends that uplift be paid only based on operating parameters that reflect the flexibility of the benchmark new entrant unit (CONE unit) in the PJM Capacity Market. (Priority: High. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM not pay uplift to units not following dispatch, including uplift related to fast start pricing, and require refunds where it has made such payments. This includes units whose offers are flagged for fixed generation in Markets Gateway because such units are not dispatchable. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM pay uplift based on the offer at the lower of the actual unit output or the dispatch signal MW. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends eliminating intraday segments from the calculation of uplift payments and returning to calculating the need for uplift based on the entire 24 hour operating day. (Priority: High. First reported 2018. Status: Not adopted.)
- The MMU recommends the elimination of day-ahead uplift to ensure that units receive an energy uplift payment based on their real-time output and not their day-ahead scheduled output. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that units not be paid lost opportunity cost uplift credits when PJM directs a unit to reduce output based on a transmission constraint or other reliability issue. There is no lost opportunity because the unit is required to reduce for the reliability of the unit and the system. (Priority: High. First reported 2021. Status: Not adopted.)
- The MMU recommends reincorporating the use of net regulation revenues as an offset in the calculation of balancing generator credits. (Priority: Medium. First reported 2009. Status: Not adopted.)
- The MMU recommends that self scheduled units not be paid energy uplift credits for their startup cost when the units are scheduled by PJM to start before the self scheduled hours. (Priority: Low. First reported 2013. Status: Not adopted.)

<sup>16</sup> Fuel type is reported by offer schedule, but it can be inaccurate on an hourly basis.

<sup>17</sup> The PJM Market Rules clarify that shortage case approval will be based on RT SCED, but does not address RT SCED case choice or load bias.

- The MMU recommends three modifications to the energy lost opportunity cost calculations:
  - The MMU recommends calculating LOC based on 24 hour daily periods for combustion turbines and diesels scheduled in the day-ahead energy market, but not committed in real time. (Priority: Medium. First reported 2014. Status: Not adopted.)
  - The MMU recommends that units scheduled in the day-ahead energy market and not committed in real time should be compensated for LOC based on their real-time desired and achievable output, not their scheduled day-ahead output. (Priority: Medium. First reported 2015. Status: Not adopted.)
  - The MMU recommends that only flexible fast start units (startup plus notification times of 10 minutes or less) and units with short minimum run times (one hour or less) be eligible by default for the LOC compensation to units scheduled in the day-ahead energy market and not committed in real time. Other units should be eligible for LOC compensation only if PJM explicitly cancels their day-ahead commitment. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that up to congestion (UTC) transactions be required to pay energy uplift charges for both the injection and the withdrawal sides of the UTC. (Priority: High. First reported 2011. Status: Partially adopted.)
- The MMU recommends allocating the energy uplift credits paid to units scheduled by PJM as must run in the day-ahead energy market for reasons other than voltage/reactive or black start services as a reliability charge to real-time load, real-time exports and real-time wheels. (Priority: Medium. First reported 2014. Status: Not adopted. Stakeholder process.)
- The MMU recommends that the total cost of providing reactive support be categorized and allocated as reactive services. Reactive services credits should be calculated consistent with the balancing generator credit calculation. (Priority: Medium. First reported 2012. Status: Not adopted. Stakeholder process.)
- The MMU recommends including real-time exports and real-time wheels in the allocation of the cost of providing reactive support to the 500 kV system or above, in addition to real-time load. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends modifications to the calculation of lost opportunity costs credits paid to wind units. The lost opportunity costs credits paid to wind units should be based on the lesser of the desired output, the estimated output based on actual wind conditions and the capacity interconnection rights (CIRs). The MMU recommends that PJM require wind units to request CIRs based on the maximum output used in the ELCC calculation for wind units. (Priority: Low. First reported 2012. Status: Partially adopted.)
- The MMU recommends that PJM clearly identify and classify all reasons for incurring uplift in the day-ahead and the real-time energy markets and the associated uplift charges in order to make all market participants aware of the reasons for these costs and to help ensure a long term solution to the issue of how to allocate the costs of uplift. (Priority: Medium. First reported 2011. Status: Partially adopted.)
- The MMU recommends that PJM revise the current uplift confidentiality rules in order to allow the disclosure of complete information about the level of uplift by unit and the detailed reasons for the level of uplift credits by unit in the PJM region. (Priority: High. First reported 2013. Status: Partially adopted.)<sup>18</sup>

## Section 5, Capacity Market

### Definition of Capacity

- The MMU recommends elimination of the key remaining components of the CP model because they interfere with competitive outcomes in the capacity market and create unnecessary complexity and risk. (Priority: High. First reported 2022. Status: Not adopted.)
- The MMU recommends the enforcement of a consistent definition of capacity resources. The MMU recommends that the tariff requirement to be a physical resource be enforced and enhanced. The requirement to be a physical resource should apply

<sup>18</sup> On September 7, 2018, PJM made a compliance filing for FERC Order No. 844 to publish unit specific uplift credits. The compliance filing was accepted by FERC on June 21, 2019. 166 FERC ¶ 61,210 (2019). PJM began posting unit specific uplift reports on May 1, 2019. 167 FERC ¶ 61,280 (2019).



at the time of auctions and should also constitute a commitment to be physical in the relevant delivery year. The requirement to be a physical resource should be applied to all resource types, including planned generation, demand resources, and imports.<sup>19 20</sup> (Priority: High. First reported 2013. Status: Not adopted.)

- The MMU recommends that DR providers be required to have a signed contract with specific customers for specific facilities for specific levels of DR at least six months prior to any capacity auction in which the DR is offered. (Priority: High. First reported 2016. Status: Not adopted.)
- The MMU recommends that Energy Efficiency Resources (EE) not be included in the capacity market construct because PJM's load forecasts have accounted for EE since the 2016 load forecast for the 2019/2020 Delivery Year. EE is not a capacity resource as defined in the tariff, and there is no reason to continue to pay large subsidies to EE providers.<sup>21</sup> (Priority: Medium. First reported 2016. Status: Adopted 2024.)<sup>22</sup>
- The MMU recommends that intermittent resources, including storage, not be permitted to offer capacity MW based on energy deliveries that exceed their defined deliverability rights (CIRs). Only energy output for such resources at or below the designated CIR/deliverability level should be recognized in the definition of derated capacity (e.g. ELCC). Correctly defined ELCC derating factors are lower than the CIRs required to meet those derating factors. (Priority: High. First reported 2021. Status: Adopted 2023.)
- The MMU recommends that PJM require all market participants to meet their deliverability requirements under the same rules. PJM should end the practice of giving away winter CIRs to intermittent resources that appear to exist because other resources paid for the supporting network upgrades. (Priority: High. First reported 2017. Status: Not adopted.)<sup>23</sup>

<sup>19</sup> See also Comments of the Independent Market Monitor for PJM, Docket No. ER14-503-000 (December 20, 2013).

<sup>20</sup> See "Analysis of Replacement Capacity for RPM Commitments: June 1, 2007 to June 1, 2019," <[http://www.monitoringanalytics.com/reports/Reports/2019/IMM\\_Analysis\\_of\\_Replacement\\_Capacity\\_for\\_RPM\\_Commitments\\_June\\_1\\_2007\\_to\\_June\\_1\\_2019\\_20190913.pdf](http://www.monitoringanalytics.com/reports/Reports/2019/IMM_Analysis_of_Replacement_Capacity_for_RPM_Commitments_June_1_2007_to_June_1_2019_20190913.pdf)> (September 13, 2019).

<sup>21</sup> "PJM Manual 19: Load Forecasting and Analysis," § 3.2 Development of the Forecast, Rev. 37 (Dec. 18, 2024).

<sup>22</sup> See 189 FERC ¶ 61,095 (2024).

<sup>23</sup> This recommendation was first made in the 2020/2021 BRA report in 2017. See the "Analysis of the 2020/2021 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2017/IMM\\_Analysis\\_of\\_the\\_20202021\\_RPM\\_BRA\\_20171117.pdf](http://www.monitoringanalytics.com/reports/Reports/2017/IMM_Analysis_of_the_20202021_RPM_BRA_20171117.pdf)> (November 11, 2017).

- The MMU recommends that the must offer rule in the capacity market apply to all capacity resources. There is no reason to exempt intermittent and capacity storage resources, including hydro, and demand resources from the must offer requirement. The same rules should apply to all capacity resources in order to ensure open access to the transmission system and prevent the exercise of market power through withholding. (Priority: High. First reported 2021. Status: Not adopted.)
- The MMU recommends that PJM require all market sellers of proposed generation capacity resources, including thermal and intermittent, to submit a binding notice of intent to offer at least six months prior to the base residual auction. This is consistent with the overall MMU recommendation that all capacity resources have a must offer obligation in the capacity market auctions. (Priority: High. First reported 2023. Status: Partially adopted.)
- The MMU recommends that the ELCC be significantly refined to include hourly data that would permit unit specific ELCC ratings, to weight summer and winter risk in a more balanced manner, to eliminate PAI risks, and to pay for actual hourly performance rather than based on relatively inflexible class capacity accreditation ratings derived from a small number of hours of poor performance. (Priority: High. First reported 2023. Status: Not adopted.)

## Market Design and Parameters

- The MMU recommends that PJM reevaluate the shape of the VRR curve. The shape of the VRR curve directly results in load paying substantially more for capacity than load would pay with a vertical demand curve. More specifically, the MMU recommended that the VRR curve be rotated half way towards the vertical demand curve at the reliability requirement in the 2022 Quadrennial Review. (Priority: High. First reported 2021. Status: Partially adopted.)
- The MMU recommends that the maximum price on the VRR curve be defined as 1.5 times Net CONE, capped at Gross CONE. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that the reference resource be a CT rather than a CC. The MMU recommends that the ELCC value used to convert the gross CONE



in ICAP terms for a CT to the gross CONE in UCAP terms be the ELCC based on winter ratings. (Priority: High. First reported Q3 2024. Status: Not adopted.)

- The MMU recommends that the test for determining modeled Locational Deliverability Areas (LDAs) in RPM be redefined. A detailed reliability analysis of all at risk units should be included in the redefined model including transmission constraints inside LDAs. The market design should clear and pay units that are needed for reliability per PJM's transmission reliability analysis in order to forestall RMRs. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM clear the capacity market based on nodal capacity resource locations and the characteristics of the transmission system inside and outside LDAs consistent with the actual electrical facts of the grid. Absent a fully nodal capacity market clearing process, the MMU recommends that PJM use a non-nested model with all LDAs modeled including VRR curves for all LDAs. Each LDA requirement should be met with the capacity resources located within the LDA and exchanges from neighboring LDAs up to the transmission limit. LDAs should be allowed to price separate if that is the result of the LDA supply curves and the transmission constraints between LDAs. (Priority: Medium. First reported 2017. Status: Not adopted.)
- The MMU recommends that the net revenue offset calculation used by PJM to calculate the net Cost of New Entry (CONE) and net ACR be based on a forward looking calculation of expected energy and ancillary services net revenues using historical net revenues that are scaled based on forward prices for energy and fuel. (Priority: High. First reported 2014. Status: Not adopted.)<sup>24</sup>
- The MMU recommends that PJM reduce the number of incremental auctions to a single incremental auction held three months prior to the start of the delivery year and reevaluate the triggers for holding conditional incremental auctions. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM not sell back any capacity in any IA procured in a BRA. If

PJM continues to sell back capacity, the MMU recommends that PJM offer to sell back capacity in incremental auctions only at the BRA clearing price for the relevant delivery year. (Priority: Medium. First reported 2017. Status: Not adopted.)

- The MMU recommends that PJM not buy any capacity in any IA if PJM has already procured excess reserves. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends changing the RPM solution method to explicitly incorporate the cost of uplift (make whole) payments in the objective function. (Priority: Medium. First reported 2014. Status: Not adopted.)
- The MMU recommends that the Fixed Resource Requirement (FRR) rules, including obligations and performance requirements, be revised and updated to ensure that the rules reflect current market realities and that FRR entities do not unfairly take advantage of those customers paying for capacity in the PJM capacity market. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that the value of CTRs be defined by the total MW cleared in the capacity market, the internal MW cleared and the imported MW cleared, and not redefined later prior to the delivery year. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends that the market clearing results be used in settlements rather than the reallocation process currently used, or that the process of modifying the obligations to pay for capacity be reviewed. (Priority: Medium. First reported 2021. Status: Not adopted.)<sup>25</sup>
- The MMU recommends that PJM improve the clarity and transparency of its CETL calculations. The MMU also recommends that CETL for capacity imports into PJM be based on the ability to import capacity only where PJM capacity exists and where that capacity has a must offer requirement in the PJM Capacity Market. (Priority: Medium. First reported 2021. Status: Partially adopted 2022.)

<sup>24</sup> This recommendation was first made during the Quadrennial Review in 2014, including the PJM Capacity Senior Task Force (CSTF), the MRC and the MC. <<https://www.pjm.com/committees-and-groups/closed-groups/cstf>>.

<sup>25</sup> This recommendation was first made in the 2023/2024 BRA report in 2022. See "Analysis of the 2023/2024 RPM Base Residual Auction Revised," <[http://www.monitoringanalytics.com/reports/Reports/2022/IMM\\_Analysis\\_of\\_the\\_20232024\\_RPM\\_Base\\_Residual\\_Auction\\_20221028.pdf](http://www.monitoringanalytics.com/reports/Reports/2022/IMM_Analysis_of_the_20232024_RPM_Base_Residual_Auction_20221028.pdf)> (October 28, 2022).

## Offer Caps, Offer Floors, and Must Offer

- The MMU recommends using the lower of the cost or price-based energy market offer to calculate energy costs in the calculation of the historical net revenues which are an offset to gross ACR in the calculation of unit specific capacity resource offer caps based on net ACR. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends that modifications to existing resources, including relatively small proposed increases in the capability of a Generation Capacity Resource be treated as an existing resource and subject to the corresponding market power mitigation rules and no longer be treated as planned and exempt from offer capping. (Priority: Medium. First reported 2012. Status: Not adopted.)<sup>26</sup>
- The MMU recommends that the RPM market power mitigation rule be modified to apply offer caps in all cases when the three pivotal supplier test is failed and the sell offer is greater than the offer cap. This will ensure that market power does not result in an increase in uplift (make whole) payments for seasonal products. (Priority: Medium. First reported 2017. Status: Not adopted.)
- The MMU recommends that any combined seasonal resources be required to be in the same LDA and at the same location, in order for the energy market and capacity market to remain synchronized and reliability metrics correctly calculated. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends that the definition of avoidable costs in the tariff be corrected to be consistent with the economic definition. Avoidable costs are costs that are neither short run marginal costs, like fuel or consumables, nor fixed costs like depreciation and rate of return. Avoidable costs are the marginal costs of capacity and therefore the competitive offer level for capacity resources and therefore the market seller offer cap. Avoidable costs are the marginal costs of capacity for both new resources and existing resources. (Priority: Medium. First reported 2017. Status: Not adopted.)<sup>27</sup>

<sup>26</sup> This recommendation was first made in the 2014/2015 BRA report in 2012. See "Analysis of the 2014/2015 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2012/Analysis\\_of\\_2014\\_2015\\_RPM\\_Base\\_Residual\\_Auction\\_20120409.pdf](http://www.monitoringanalytics.com/reports/Reports/2012/Analysis_of_2014_2015_RPM_Base_Residual_Auction_20120409.pdf)> (April 9, 2012).

<sup>27</sup> This recommendation was first made in the 2023/2024 BRA report in 2022. See "Analysis of the 2023/2024 RPM Base Residual Auction Revised," <[http://www.monitoringanalytics.com/reports/Reports/2022/IMM\\_Analysis\\_of\\_the\\_20232024\\_RPM\\_Base\\_Residual\\_Auction\\_20221028.pdf](http://www.monitoringanalytics.com/reports/Reports/2022/IMM_Analysis_of_the_20232024_RPM_Base_Residual_Auction_20221028.pdf)> (October 28, 2022).

- The MMU recommends that major maintenance costs be included in the definition of avoidable costs and removed from energy offers because such costs are avoidable costs and not short run marginal costs. (Priority: High. First reported 2019. Status: Not adopted.)
- The MMU recommends that capacity market sellers be required to explicitly request and support the use of minimum MW quantities (inflexible sell offer segments) and that the requests only be permitted for defined physical reasons. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that, as part of the MOPR unit specific standard of review, all projects be required to use the same basic modeling assumptions. That is the only way to ensure that projects compete on the basis of actual costs rather than on the basis of modeling assumptions.<sup>28</sup> (Priority: High. First reported 2013. Status: Not adopted.)

## Performance Incentive Requirements of RPM

- The MMU recommends that any unit not capable of supplying energy equal to its day-ahead must offer requirement (ICAP) be required to reflect an appropriate outage and associated performance penalty. (Priority: Medium. First reported 2009. Status: Not adopted.)
- The MMU recommends that retroactive replacement transactions associated with a failure to perform during a PAI not be allowed and that, more generally, retroactive replacement capacity transactions not be permitted. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends that there be an explicit requirement that capacity resource offers in the day-ahead energy market be competitive, where competitive is defined to be the short run marginal cost of the units, including flexible operating

<sup>28</sup> See 143 FERC ¶ 61,090 (2013) ("We encourage PJM and its stakeholders to consider, for example, whether the unit-specific review process would be more effective if PJM requires the use of common modeling assumptions for establishing unit-specific offer floors while, at the same time, allowing sellers to provide support for objective, individual cost advantages. Moreover, we encourage PJM and its stakeholders to consider these modifications to the unit-specific review process together with possible enhancements to the calculation of Net CONE."); see also, Comments of the Independent Market Monitor for PJM, Docket No. ER13-535-001 (March 25, 2013); Complaint of the Independent Market Monitor for PJM v. Unnamed Participant, Docket No. EL12-63-000 (May 1, 2012); Motion for Clarification of the Independent Market Monitor for PJM, Docket No. ER11-2875-000, et al. (February 17, 2012); Protest of the Independent Market Monitor for PJM, Docket No. ER11-2875-002 (June 2, 2011); Comments of the Independent Market Monitor for PJM, Docket Nos. EL11-20 and ER11-2875 (March 4, 2011).

parameters. (Priority: Low. First reported 2013. Status: Not adopted.)

- The MMU recommends that Capacity Performance resources be required to perform without excuses. Resources that do not perform should not be paid regardless of the reason for nonperformance. (Priority: High. First reported 2019. Status: Not adopted.)
- The MMU recommends that PJM require actual seasonal tests as part of the Summer/Winter Capability Testing rules, that the number of tests be limited, and that the ambient conditions under which the tests are performed be defined to reflect seasonal extreme conditions. (Priority: Medium. First reported 2022. Status: Not adopted.)
- The MMU recommends that PJM select the time and day that a unit undergoes Net Capability Verification Testing, not the unit owner, and that this information not be communicated in advance to the unit owner. (Priority: Medium. First reported 2022. Status: Not adopted.)

## Capacity Imports and Exports

- The MMU recommends that all capacity imports be required to be deliverable to PJM load in an identified LDA, zonal or subzonal, or defined combinations of specific zones, e.g. MAAC, prior to the relevant delivery year to ensure that they are full substitutes for internal, physical capacity resources. Pseudo ties alone are not adequate to ensure deliverability to PJM load. (Priority: High. First reported 2016. Status: Not adopted.)
- The MMU recommends that all costs incurred as a result of a pseudo tied unit be borne by the unit itself and included as appropriate in unit offers in the capacity market. (Priority: High. First reported 2016. Status: Not adopted.)

## Deactivations/Retirements

- The MMU recommends that the notification requirement for deactivations be extended from the current one quarter prior to 12 months prior to an auction in which the unit will not be offered due to deactivation; and no less than 12 months prior to the date of deactivation (Priority: Low. First reported 2012. Status: Partially adopted.)

- The MMU recommends elimination of both the cost of service recovery rate option and the deactivation avoidable cost rate option for providing Part V reliability service (RMR), and their replacement with clear language that provides for the recovery of 100 percent of the actual incremental costs required to operate to provide the service plus a defined incentive. (Priority: High. First reported 2017. Status: Not adopted.)
- The MMU recommends that units recover all and only the incremental costs, including incremental investment costs without a cap, required to provide Part V reliability service (RMR service) that the unit owner would not have incurred if the unit owner had deactivated its unit as it proposed, plus a defined incentive payment. Customers should bear no responsibility for paying previously incurred (sunk) costs, including a return on or of prior investments. (Priority: High. First reported 2010. Status: Not adopted.)
- The MMU recommends that the same reliability standard be used in capacity auctions as is used by PJM transmission planning. One result of the current design is that a unit may fail to clear in a BRA, decide to retire as a result, but then be found to be needed for reliability by PJM planning and paid under Part V of the OATT (RMR) to remain in service while transmission upgrades are made. (Priority: High. First reported 2023. Status: Not adopted.)
- The MMU recommends that if units that are paid under Part V of the OATT (RMR) are included in the calculation of CETO and/or reliability in the relevant LDA, the capacity of the RMR resources should also be included in capacity market supply at zero cost, but without all the obligations of a capacity resource, in order to ensure that the capacity market price signal reflects the appropriate supply and demand conditions. (Priority: High. First reported 2023. Status: Not adopted.)
- The MMU recommends that units that are paid under Part V of the OATT (RMR) not be included in the calculation of CETO or reliability in the relevant LDA, in order to ensure that the capacity market price signal reflects the appropriate supply and demand conditions. (Priority: High. First reported 2023. Status: Not adopted.)

- The MMU recommends that all CIRs be returned to the pool of available interconnection capability on the retirement date of generation resources in order to facilitate timely and competitive entry into the PJM markets, open access to the transmission system and maintain the priority order defined by the queue process. (Priority: High. First reported 2023. Status: Not adopted.)

## Section 6, Demand Response

- The MMU recommends that PJM report the response of demand capacity resources to dispatch by PJM as the actual change in load rather than simply the difference between the amount of capacity purchased by the customer and the actual metered load. The current approach significantly overstates the response to PJM dispatch. (Priority: High. First reported 2023. Status: Not adopted.)
- The MMU recommends that demand resources offering as supply in the capacity market be required to offer a guaranteed load drop (GLD) below their PLC to ensure that demand resources provide an identifiable MW resource to PJM when called. (Priority: High. First reported 2023. Status: Not adopted.)
- The MMU recommends, as an alternative to including demand resources as supply in the capacity market, that demand resources have the option to be on the demand side of the markets, that customers be able to avoid capacity and energy charges by not using capacity and energy at their discretion, that customer payments be determined only by metered load, and that PJM forecasts immediately incorporate the impacts of demand side behavior. (Priority: High. First reported 2014. Status: Not adopted.)
- The MMU recommends that the option to specify a minimum dispatch price (strike price) for demand resources be eliminated and that participating resources receive the hourly real-time LMP less any generation component of their retail rate.<sup>29</sup> (Priority: Medium. First reported 2010. Status: Not adopted.)
- The MMU recommends that the maximum offer for demand resources be the same as the maximum offer for generation resources and that the same cost verification rules applied to generation resources apply to demand resources. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that the demand resources be treated as economic resources, responding to economic price signals like other capacity resources. The MMU recommends that demand resources not be treated as emergency resources, not trigger a PJM emergency and not trigger a Performance Assessment Interval. The MMU recommends that demand resources be available for every hour of the year. (Priority: High. First reported 2012. Status: Partially adopted.)
- The MMU recommends that the Emergency Program Energy Only option be eliminated because the opportunity to receive the appropriate energy market incentive is already provided in the economic program. (Priority: Low. First reported 2010. Status: Not adopted.)
- The MMU recommends that, if demand resources remain in the capacity market, a daily energy market must offer requirement apply to demand resources, comparable to the rule applicable to generation capacity resources.<sup>30</sup> (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that demand resources be required to provide their nodal location, comparable to generation resources. (Priority: High. First reported 2011. Status: Not adopted.)
- The MMU recommends that PJM require nodal dispatch of demand resources with no advance notice required or, if nodal location is not required, subzonal dispatch of demand resources with no advance notice required. The MMU recommends that, if PJM continues to use subzones for any purpose, PJM clearly define the role of subzones in the dispatch of demand response. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM not remove any defined subzones and maintain a public record of all created and removed subzones. (Priority: Low. First reported 2016. Status: Not adopted.)
- The MMU recommends that PJM eliminate the measurement of compliance across zones within a compliance aggregation area (CAA). The multiple zone approach is less locational than the zonal and

<sup>29</sup> See "Complaint and Motion to Consolidate of the Independent Market Monitor for PJM," Docket No. EL14-20-000 (January 28, 2014), "Comments of the Independent Market Monitor for PJM," Docket No. ER15-852-000 (February 13, 2015).

<sup>30</sup> See "Complaint and Motion to Consolidate of the Independent Market Monitor for PJM," Docket No. EL14-20-000 (January 27, 2014) at 1.



subzonal approach and creates larger mismatches between the locational need for the resources and the actual response. (Priority: High. First reported 2015. Status: Not adopted.)

- The MMU recommends that measurement and verification methods for demand resources be modified to reflect compliance more accurately. (Priority: Medium. First reported 2009. Status: Not adopted.)
- The MMU recommends that compliance rules be revised to include submittal of all necessary hourly load data, and that negative values be included when calculating event compliance across hours and registrations. (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM adopt the ISO-NE five-minute metering requirements in order to ensure that operators have the necessary information for reliability and that market payments to demand resources be calculated based on interval meter data at the site of the demand reductions.<sup>31</sup> (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends demand response event compliance be calculated on a five minute basis for all capacity performance resources and that the penalty structure reflect five minute compliance. (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends that load management testing be initiated by PJM with advance notice to CSPs identical to the actual lead time required in an emergency in order to accurately represent the conditions of an emergency event. (Priority: Low. First reported 2012. Status: Partially adopted.)
- The MMU recommends that shutdown cost be defined as the cost to curtail load for a given period that does not vary with the measured reduction or, for behind the meter generators, be the start cost defined in Manual 15 for generators. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that the Net Benefits Test be eliminated and that demand response resources be paid LMP less any generation component of the

applicable retail rate. (Priority: Low. First reported 2015. Status: Not adopted.)

- The MMU recommends that the tariff rules for demand response clarify that a resource and its CSP, if any, must notify PJM of material changes affecting the capability of the resource to perform as registered and must terminate or modify registrations that are no longer capable of responding to PJM dispatch directives at defined levels because load has been reduced or eliminated, as in the case of bankrupt and/or out of service facilities. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that there be only one demand response product in the capacity market, with an obligation to respond when called for any hour of the delivery year. (Priority: High. First reported 2011. Status: Partially adopted.<sup>32</sup>)
- The MMU recommends that the lead times for demand resources be shortened to 30 minutes with a one hour minimum dispatch for all resources. (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends setting the baseline for measuring capacity compliance under winter compliance at the customers' PLC, similar to GLD, to avoid double counting. (Priority: High. First reported 2010. Status: Partially adopted.)
- The MMU recommends the Relative Root Mean Squared Test be required for all demand resources with a CBL. (Priority: Low. First reported 2017. Status: Partially adopted.)
- The MMU recommends that the limits imposed on the pre-emergency and emergency demand response share of the synchronized reserve market be eliminated. (Priority: Medium. First reported 2018. Status: Adopted 2022.)
- The MMU recommends that 30 minute pre-emergency and emergency demand response be considered to be 30 minute reserves. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that energy efficiency resources (EE) not be included in the capacity market mechanism and that PJM should ensure that the impact of EE measures on the load forecast is

<sup>31</sup> See ISO-NE Tariff, Section III, Market Rule 1, Appendix E1 and Appendix E2, "Demand Response," <[http://www.iso-ne.com/regulatory/tariff/sect\\_3/mr1\\_append-e.pdf](http://www.iso-ne.com/regulatory/tariff/sect_3/mr1_append-e.pdf)>. (Accessed October 17, 2017) ISO-NE requires that DR have an interval meter with five-minute data reported to the ISO and each behind the meter generator is required to have a separate interval meter. After June 1, 2017, demand response resources in ISO-NE must also be registered at a single node.

<sup>32</sup> PJM's Capacity Performance design requires resources to respond when called for any hour of the delivery year, but demand resources still have a limited mandatory compliance window.



incorporated immediately. (Priority: Medium. First reported 2018. Status: Adopted 2024.)<sup>33 34</sup>

- The MMU recommends that, if energy efficiency resources remain in the capacity market mechanism, PJM codify eligibility requirements to claim the property rights to energy efficiency installations in the tariff including a contract with the owner of every energy efficiency installation and that PJM institute a registration system to track claims to the property rights to energy efficiency installations and document installation periods of energy efficiency installations. (Priority: Medium. First reported 2022. Status: Not adopted.)
- The MMU recommends that demand reductions based entirely on behind the meter generation be capped at the lower of economic maximum or actual generation output. (Priority: High. First reported 2019. Status: Not adopted.)
- The MMU recommends that all demand resources register as Pre-Emergency Load Response and that the Emergency Load Response Program be eliminated. (Priority: High. First reported 2020. Status: Not adopted.)
- The MMU recommends that EDCs not be allowed to participate in markets as DER aggregators in addition to their EDC role. (Priority: High. First reported 2021. Status: Not adopted.)
- The MMU recommends that PJM include a 5.0 MW maximum size cap on DER aggregations. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends that PJM use a nodal approach for DER participation in PJM markets that excludes multinodal aggregation. (Priority: Medium. First reported 2022. Status: Partially adopted.)
- The MMU recommends that the Commission require PJM to include in OATT Attachment M the explicit statement that the Market Monitor's role includes the right to collect information from EDCs and DERA related to actions taken on the distribution system related to DERs. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends that PJM revise the requirements for reporting expected real time energy load reductions by CSPs to PJM to improve the

accuracy and usefulness to PJM's system operators. (Priority: Medium. First reported 2023. Status: Not adopted.)

- The MMU recommends that PJM define when operators can and should call on demand resources, given that a call on demand resources no longer triggers a PAI. The MMU recommends that PJM revise the performance requirements for demand resources to include an event specific measurement for dispatch occurring outside of Performance Assessment Events and penalties for nonperformance. (Priority: Medium. First reported 2023. Status: Not adopted.)

## Section 7, Net Revenue

- The MMU recommends that the net revenue calculation used by PJM to calculate the net Cost of New Entry (CONE) and net ACR be based on a forward looking calculation of expected energy and ancillary services net revenues using historical revenues that are scaled based on forward prices for energy and fuel. (Priority: Medium. First reported 2019. Status: Not adopted.)

## Section 8, Environmental and Renewables

- The MMU recommends that renewable energy credit markets based on state renewable portfolio standards be brought into PJM markets as they are an increasingly important component of the wholesale energy market. The MMU recommends that there be a single PJM operated forward market for RECs, for a single product based on a common set of state definitions of renewable technologies, with a single clearing price, trued up to real-time delivery. (Priority: High. First reported 2010. Status: Not adopted.)
- The MMU recommends that jurisdictions with a renewable portfolio standard make the price and quantity data on supply and demand more transparent. (Priority: Low. First reported 2018. Status: Not adopted.)
- The MMU recommends that the Commission reconsider its disclaimer of jurisdiction over RECs markets because, given market changes since that decision, it is clear that RECs materially affect

<sup>33</sup> 189 FERC ¶ 61,095 (2024).

<sup>34</sup> Originally incorporated with auctions conducted in 2016 for the 2016/2017 Delivery Year and forward. The mechanics of the EE addback mechanism were modified beginning with the 2023/2024 Delivery Year.

jurisdictional rates. (Priority: Low. First reported 2018. Status: Not adopted.)

- The MMU recommends that PJM provide a full analysis of the impact of carbon pricing on PJM generating units and carbon pricing revenues to the PJM states in order to permit the states to consider a potential agreement on the development of a multistate framework for carbon pricing and the distribution of carbon revenues. (Priority: High. First reported 2018. Status: Not adopted.)
- The MMU recommends that load and generation located at separate nodes be treated as separate resources in order to ensure that load and generation face consistent incentives throughout the markets. (Priority: High. First reported 2019. Status: Not adopted.)
- The MMU recommends that stationary emergency RICE be prohibited from participation as DR either when registered individually or as part of a portfolio if it cannot meet the capacity market requirements to be DR as a result of emissions standards that impose environmental run hour limitations. (Priority: Medium. First reported 2019. Status: Not adopted.)

## Section 9, Interchange Transactions

- The MMU recommends that PJM implement rules to prevent sham scheduling. The MMU recommends that PJM apply after the fact market settlement adjustments to identified sham scheduling segments to ensure that market participants cannot benefit from sham scheduling. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM implement a validation method for submitted transactions that would prohibit market participants from breaking transactions into smaller segments to defeat the interface pricing rule by concealing the true source or sink of the transaction. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM implement a validation method for submitted transactions that would require market participants to submit transactions on paths that reflect the expected actual power flow in order to reduce unscheduled loop flows. (Priority: Medium. First reported 2013. Status: Not adopted.)

- The MMU recommends that transactions sourcing in the Western Interconnection be priced at either the MISO interface pricing point or the SOUTH interface pricing point based on the locational price impact of flows between the DC tie line point of connection with the Eastern Interconnection and PJM. (Priority: High. First reported 2020. Status: Not adopted.)
- The MMU recommends that PJM eliminate the IMO interface pricing point, and assign the transactions that originate or sink in the IESO balancing authority to the MISO interface pricing point. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM monitor, and adjust as necessary, the weights applied to the components of the interfaces to ensure that the interface prices reflect ongoing changes in system conditions. (Priority: Low. First reported 2009. Status: Adopted 2024.)
- The MMU recommends that PJM review the mappings of external balancing authorities to individual interface pricing points to reflect changes to the impact of the external power source on PJM tie lines as a result of system topology changes. The MMU recommends that this review occur at least annually. (Priority: Low. First reported 2009. Status: Not adopted.)
- The MMU recommends that, in order to permit a complete analysis of loop flow, FERC and NERC ensure that the identified data are made available to market monitors as well as other industry entities determined appropriate by FERC. (Priority: Medium. First reported 2003. Status: Not adopted.)
- The MMU recommends that PJM explore an interchange optimization solution with its neighboring balancing authorities that would remove the need for market participants to schedule physical transactions across seams. Such a solution would include an optimized, but limited, joint dispatch approach that uses supply curves and treats seams between balancing authorities as constraints, similar to other constraints within an LMP market. (Priority: Medium. First reported 2014. Status: Not adopted.)

- The MMU recommends that PJM permit unlimited spot market imports as well as unlimited nonfirm point to point willing to pay congestion imports and exports at all PJM interfaces in order to improve the efficiency of the market. (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that the emergency interchange cap be replaced with a market based solution. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that the submission deadline for real-time dispatchable transactions be modified from 1800 on the day prior, to three hours prior to the requested start time, and that the minimum duration be modified from one hour to 15 minutes. These changes would give PJM a more flexible product that could be used to meet load in the most economic manner. (Priority: Medium. First reported 2014. Status: Partially adopted, 2015.)
- The MMU recommends eliminating the mechanism that defines FFE and M2M payments. These mechanisms are not consistent with markets and are not needed for efficient interface pricing. The MMU recommends that PJM file with the Commission to eliminate the FFE calculation and M2M payment of the PJM and MISO joint operating agreement. (Priority: Medium. First reported Q2 2024. Status: Not adopted.)
- The MMU recommends clear, explicit and detailed rules that define the conditions under which PJM will and will not recall energy from PJM capacity resources and prohibit new energy exports from PJM capacity resources. The MMU recommends that those rules define the conditions under which PJM will purchase emergency energy while at the same time not recalling energy exports from PJM capacity resources. The MMU recommends clear rules governing when PJM may recall capacity backed exports. (Priority: Medium. First reported 2010. Status: Partially adopted.)

## Section 10, Ancillary Services

### Reserve Markets

- The MMU recommends that to minimize lag and improve performance, PJM use an electronic synchronized reserve event notification process for all resources and that all resources be required to have the ability to receive and respond to the notifications. (Priority: Medium. First reported 2023. Status: Partially adopted December 17, 2024.)
- The MMU recommends that PJM replace the Mid-Atlantic Dominion Reserve Subzone with a reserve zone structure consistent with the actual deliverability of reserves based on current transmission constraints. (Priority: High. First reported 2019. Status: Partially adopted October 1, 2022.)
- The MMU recommends that the components of the cost-based offers for providing regulation and synchronous condensing be defined in Schedule 2 of the Operating Agreement. (Priority: Low. First reported 2019. Status: Not adopted.)
- The MMU recommends that, for calculating the penalty for a synchronized reserve resource failing to meet its scheduled obligation during a spinning event, the unit repay all credits back to the last time that the unit successfully responded to an event 10 minutes or longer. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that, for calculating the penalty for a synchronized reserve resource failing to meet its scheduled obligation during a spinning event, the synchronized reserve shortfall penalty should include LOC payments as well as SRMCP and MW of shortfall. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that aggregation not be permitted to offset unit specific penalties for failure to respond to a synchronized reserve event. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM remove the 30 percent increase to the synchronized reserve reliability requirement. (Priority: High. New recommendation. Status: Not adopted.)

## Regulation Market

- The MMU recommends that the two signal regulation market design be replaced with a one signal regulation market design. (Priority: Medium. First reported 2023. Status: Not adopted.)<sup>35</sup>
- The MMU recommends that the ability to make dual offers (to make offers as both a RegA and a RegD resource in the same market hour) be removed from the regulation market. (Priority: High. First reported 2019. Status: Not adopted.)<sup>36</sup>
- The MMU recommends that the regulation market be modified to incorporate a consistent application of the marginal benefit factor (MBF) throughout the optimization, assignment and settlement process. The MBF should be defined as the Marginal Rate of Technical Substitution (MRTS) between RegA and RegD. (Priority: High. First reported 2012. Status: Not adopted. FERC rejected.)<sup>37</sup><sup>38</sup>
- The MMU recommends that the current calculation of the performance score (based on precision, delay and correlation metrics) be replaced with the current calculation of the precision score. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends that the regulation market commitment period be reduced from a 60-minute commitment to a 30-minute commitment. (Priority: Medium. First reported 2023. Status: Not adopted.)<sup>39</sup>
- The MMU recommends that the lost opportunity cost in the ancillary services markets be calculated using the schedule on which the unit was scheduled to run in the energy market. (Priority: High. First reported 2010. Status: Not adopted.<sup>40</sup> FERC rejected.)<sup>41</sup>
- The MMU recommends that the lost opportunity cost calculation used in the regulation market be based on the resource's dispatched energy offer schedule, not the lower of its price or cost offer schedule. (Priority: Medium. First reported 2010. Status: Not adopted.)<sup>42</sup> <sup>43</sup>
- The MMU recommends that the \$12.00 margin adder be eliminated from the definition of the cost based regulation offer because it is a markup and not a cost. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends that the ramp rate limited desired MW output be used in the regulation uplift calculation, to reflect the physical limits of the unit's ability to ramp and to eliminate overpayment for opportunity costs when the payment uses an unachievable MW. (Priority: Medium. First reported 2022. Status: Not adopted.)<sup>44</sup>
- The MMU recommends enhanced documentation of the implementation of the regulation market design. (Priority: Medium. First reported 2010. Status: Not adopted. FERC rejected.)<sup>45</sup>
- The MMU recommends that PJM be required to save data elements necessary for verifying the performance of the regulation market. (Priority: Medium. First reported 2010. Status: Not adopted.)
- The MMU recommends that all data necessary to perform the regulation market three pivotal supplier test be saved by PJM so that the test can be replicated. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends that all data necessary to perform the generator primary frequency response evaluation be saved by PJM so that the test can be replicated. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends that the total regulation (TReg) signal sent on a fleet wide basis be eliminated and replaced with individual regulation signals for each unit. (Priority: Low. First reported 2019. Status: Not adopted.)
- The MMU recommends that, to prevent gaming, there be a penalty enforced in the regulation market as a reduction in performance score and/or a forfeiture of revenues when resource owners elect to deassign assigned regulation resources within the

35 PJM filed proposed changes to the regulation market with the FERC on April 16, 2024 (Regulation Market Design Filing," Docket No. ER24-1772-000). The Commission Order on June 17, 2024 accepted the PJM Proposal as filed. PJM will implement the changes to the regulation market in two phases. Phase 1, scheduled to be implemented on October 1, 2025, will result in a single signal, bidirectional market with one clearing price that eliminates the need for an MBF. Phase 1 will eliminate RegA and RegD dual offers. Phase 1 will reduce the regulation commitment period from a 60-minute commitment to a 30-minute commitment. In Phase 1 the lost opportunity cost calculation used in the regulation market will be based on the resource's dispatched energy offer schedule, not the lower of its price or cost offer schedule.

36 *Id.*

37 162 FERC ¶ 61,295 (2018), *reh'g denied*, 170 FERC ¶ 61,259 (2020).

38 *Id.*

39 *Id.*

40 This recommendation was adopted by PJM for the energy market. Lost opportunity costs in the energy market are calculated using the schedule on which the unit was scheduled to run. In the regulation market, this recommendation has not been adopted, as the LOC continues to be calculated based on the lower of price or cost in the energy market offer.

41 162 FERC ¶ 61,295 (2018), *reh'g denied*, 170 FERC ¶ 61,259 (2020).

42 *Id.*

43 *Id.*

44 In Phase 1 the ramp rate limited desired MW output will be used in the regulation uplift calculation. The MMU does not agree with how this change will be implemented and will be reviewing the market results in Phase 1.

45 *Id.*

hour. (Priority: Medium. First reported 2016. Status: Not adopted. FERC rejected.)<sup>46</sup>

## Frequency Response, Reactive, and Black Start

- The MMU recommends that all resources, new and existing, have a requirement to include and maintain equipment for primary frequency response capability as a condition of interconnection service. The PJM markets already compensate resources for frequency response capability and any marginal costs. (Priority: Medium. First reported 2018. Status: Partially adopted.)
- The MMU recommends that new CRF rates for black start units, incorporating current tax code changes, be implemented immediately. The new CRF rates should apply to all black start units. Black start units should be required to commit to providing black start service for the life of the unit. (Priority: High. First reported 2020. Status: Not adopted.)
- The MMU recommends that black start planning and coordination be on a regional basis and not on a zonal basis and that the costs of black start service be shared on an equal per MWh basis across the region. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends that separate cost of service payments for reactive capability be eliminated and the cost of reactive capability be recovered in PJM markets. (Priority: Medium. First reported 2016. Status: Not adopted.)<sup>47</sup>
- The MMU recommends that payments for reactive capability, if continued, be based on the 0.95 power factor included in the voltage schedule in Interconnection Service Agreements. (Priority: Medium. First reported 2018. Status: Not adopted.)<sup>48</sup>
- The MMU recommends that, if payments for reactive are continued, fleet wide cost of service rates used to compensate resources for reactive capability be eliminated and replaced with compensation based on unit specific costs. (Priority: Low. First reported 2019. Status: Not adopted.)<sup>49</sup>

<sup>46</sup> Id.

<sup>47</sup> On October 17, 2024, the Commission issued a final rule, Order No. 904, eliminating separate payments for reactive in all jurisdictional markets, including PJM. On January 28, 2025, PJM submitted a compliance filing to implement Order No. 904 ("Compliance Filing") that proposed a transition mechanism lasting through May 31, 2026. See Docket No. ER25-1073.

<sup>48</sup> Id.

<sup>49</sup> Id.

- The MMU recommends that, if payments for reactive are continued, Schedule 2 to OATT be revised to state explicitly that only generators that provide reactive capability to the transmission system that PJM operates and has responsibility for are eligible for reactive capability compensation. (Priority: Medium. First reported 2020. Status: Not adopted.)<sup>50</sup>

## Section 11, Congestion and Marginal Losses

There are no recommendations in this section.

## Section 12, Planning

### Generation Retirements

- The MMU recommends that CIRs should end on the date of retirement in order to help ensure competitive markets and competitive access to the grid. The rules need to ensure that incumbents cannot exploit control of CIRs to block or postpone entry of competitors or to exercise market power by requiring high payments for CIRs.<sup>51</sup> (Priority: Medium. First reported 2013. Status: Partially adopted, 2012.)

### Generation Queue

- Given the significance of data to market participants and regulators, the MMU recommends that all queue data and supplemental, network and baseline project data, including projected in service dates and estimated and final costs, be regularly updated with accurate and verifiable data. PJM does not update this data. (Priority: High. First reported 2023. Not adopted.)
- The MMU recommends that barriers to entry be addressed in a timely manner in order to help ensure that the capacity market will result in the entry of new capacity to meet the needs of PJM market participants. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM establish an expedited PJM managed queue process to identify commercially viable projects that could help eliminate or reduce the need for specific RMRs or that could address specific reliability needs

<sup>50</sup> Id.

<sup>51</sup> See Comments of the Independent Market Monitor for PJM, Docket No. ER12-1177-000 (March 12, 2012) <[http://www.monitoringanalytics.com/Filings/2012/IMM\\_Comments\\_ER12-1177-000\\_20120312.PDF](http://www.monitoringanalytics.com/Filings/2012/IMM_Comments_ER12-1177-000_20120312.PDF)>.



and allow the identified projects to advance in the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming. (Priority: High. First reported Q2, 2024. Status: Not adopted.)

- The MMU recommends improvements in queue management including that PJM establish a review process to ensure that projects are removed from the queue if they are not viable, as well as an expedited process to allow commercially viable projects to advance in the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming.<sup>52</sup> (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends continuing analysis of the study phase of PJM's transmission planning to reduce the need for postponements of study results, to decrease study completion times, and to improve the likelihood that a project at a given phase in the study process will successfully go into service.<sup>53</sup> (Priority: Medium. First reported 2014. Status: Partially adopted.)
- The MMU recommends outsourcing interconnection studies to an independent party to avoid potential conflicts of interest. Currently, these studies are performed by incumbent transmission owners under PJM's direction. This creates potential conflicts of interest, particularly when transmission owners are vertically integrated and the owner of transmission also owns generation. (Priority: Low. First reported 2013. Status: Not adopted.)

## Market Efficiency Process

- The MMU recommends that the market efficiency process be eliminated because it is not consistent with a competitive market design. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that, if the market efficiency process is retained, PJM modify the rules governing benefit/cost analysis, the evaluation process for selecting among competing market efficiency projects and cost allocation for economic projects in order to ensure that all changes in production costs but not congestion costs, including increased costs to load and the risk of project cost increases, in all zones are included in order to ensure that the

correct metrics are used for defining benefits. The MMU also recommends that, if the market efficiency process is retained, market efficiency projects that fail to meet PJM benefit/cost criteria in a Schedule 6 annual reevaluation, prior to construction commencing or prior to state approval, be canceled and removed from further consideration. (Priority: Medium. First reported 2018. Status: Not adopted.)

## Comparative Cost Framework

- The MMU recommends that PJM modify the project proposal templates to include data necessary to perform a detailed project lifetime financial analysis. The required data includes, but is not limited to: capital expenditure; capital structure; return on equity; cost of debt; tax assumptions; ongoing capital expenditures; ongoing maintenance; and expected life. (Priority: Medium. First reported 2020. Status: Not adopted.)

## Transmission Competition

- The MMU recommends, to increase the role of competition, that the exemption of supplemental projects from the Order No. 1000 competitive process be terminated and that the basis for all such exemptions be reviewed and modified to ensure that the supplemental project designation is not used to exempt transmission projects from a transparent, robust and clearly defined mechanism to require competition to build such projects or to effectively replace the RTEP process. (Priority: Medium. First reported 2017. Status: Not adopted. Rejected by FERC.)<sup>54</sup>
- The MMU recommends, to increase the role of competition, that the exemption of end of life projects from the Order No. 1000 competitive process be terminated and that end of life transmission projects be included in the RTEP process and should be subject to a transparent, robust and clearly defined mechanism to require competition to build such projects. (Priority: Medium. First reported 2019. Status: Not adopted. Rejected by FERC.)<sup>55</sup>

<sup>54</sup> The FERC accepted tariff provisions that exclude supplemental projects from competition in the RTEP. 162 FERC ¶ 61,129 (2018), *reh'g denied*, 164 FERC ¶ 61,217 (2018).

<sup>55</sup> In recent decisions addressing competing proposals on end of life projects, the Commission accepted a transmission owner proposal excluding end of life projects from competition in the RTEP process, 172 FERC ¶ 61,136 (2020), *reh'g denied*, 173 FERC ¶ 61,225 (2020), *affirmed*, American Municipal Power, Inc., et al. v. FERC, Case No. 20-1449 (D.C. Cir. November 17, 2023), and rejected a proposal from PJM stakeholders that would have included end of life projects in competition in the RTEP process, 173 FERC ¶ 61,242 (2020).

<sup>52</sup> PJM Filing, FERC Docket No. ER22-2110-000 (June 14, 2022); 181 FERC ¶ 61,162 (2022).

<sup>53</sup> *Ibid*.

- The MMU recommends that PJM enhance the transparency and queue management process for nonincumbent transmission investment. Issues related to data access and complete explanations of cost impacts should be addressed. The goal should be to remove barriers to competition from nonincumbent transmission providers. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM incorporate the principle that the goal of transmission planning should be the incorporation of transmission investment decisions into market driven processes as much as possible. (Priority: Low. First reported 2001. Status: Not adopted.)
- The MMU recommends the creation of a mechanism to permit a direct comparison, or competition, between transmission and generation alternatives, including which alternative is less costly and who bears the risks associated with each alternative. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM establish fair terms of access to rights of way and property, such as at substations, in order to remove any barriers to entry and require competition between incumbent transmission providers and nonincumbent transmission providers in the RTEP. (Priority: Medium. First reported 2014. Status: Not adopted.)
- The MMU recommends that rules be implemented to require competition to provide financing for transmission projects. This competition could reduce the cost of capital for transmission projects and significantly reduce total costs to customers. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that storage resources not be includable as transmission assets for any reason. (Priority: High. First reported 2020. Status: Not adopted.)

## Cost Allocation

- The MMU recommends a comprehensive review of the ways in which the solution based dfax allocation method is implemented. The goal for such a process would be to ensure that the most rational and efficient approach to implementing the solution based dfax method is used in PJM. Such

an approach should allocate costs consistent with benefits and appropriately calibrate the incentives for investment in new transmission capability. No replacement approach should be approved until all potential alternatives, including the status quo, are thoroughly reviewed. (Priority: Medium. First reported 2020. Status: Not adopted.)

- The MMU recommends changing the minimum distribution factor in the allocation from 0.01 to 0.00 and adding a threshold minimum usage impact on the transmission facilities.<sup>56</sup> (Priority: Medium. First reported 2015. Status: Not adopted.)

## Transmission Line Ratings

- The MMU recommends that all PJM transmission owners use the same methods to define line ratings and that all PJM transmission owners implement dynamic line ratings (DLR), subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. (Priority: Medium. First reported 2019. Status: Partially adopted.)
- The MMU recommends that all PJM transmission owners investigate the applicability and potential cost savings of Grid Enhancing Technology (GET) and that all PJM transmission owners implement cost effective GET, subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. (Priority: Medium. First reported Q2, 2024. Status: Not adopted.)
- The MMU recommends that the implementation of Grid Enhancing Technology (GET) be opened to competition from third parties, subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. (Priority: Medium. First reported Q3, 2024. Status: Not adopted.)

## Transmission Facility Outages

- The MMU recommends that PJM reevaluate all transmission outage tickets as on time or late as if they were new requests when an outage is rescheduled, create options for late requests based on the reasons, and apply the modified rules for late submissions to any such outages. The MMU recommends that PJM create options for treatment

<sup>56</sup> See 2015 State of the Market Report for PJM, Volume II, Section 12: Generation and Transmission Planning, at 463, Cost Allocation Issues.

of late outages. The current rules apply more stringent rules, based on controlling actions, to late outages without distinguishing among reasons for late outages. (Priority: Low. First reported 2014. Status: Not adopted.)

- The MMU recommends that PJM draft a definition of the economic and physical congestion analysis required for transmission outage requests and associated triggers, including both the extent of overloaded facilities and the level of economic congestion, to include in PJM manuals after appropriate review with appropriate rules for on time and late outage requests. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM create options for late requests based on the reasons, and modify the rules to reduce or eliminate the approval of late outage requests submitted or rescheduled after the FTR auction bidding opening date, based on those options. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM not permit transmission owners to divide long duration outages into smaller segments to avoid complying with the requirements for long duration outages. (Priority: Low. First reported 2015. Status: Not adopted.)

## Section 13, FTRs and ARRs

### Market Design

- The MMU recommends that the current ARR/FTR design be replaced with defined congestion revenue rights (CRRs). A CRR is the right to actual congestion revenue that is paid by physical load at a specific bus, zone or aggregate. (Priority: High. First reported 2015. Status: Not adopted.)

### ARR

- The MMU recommends that the ARR/FTR design be modified to ensure that the rights to all congestion revenues are assigned to load. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that all historical generation to load paths be eliminated as a basis for assigning ARRs. The MMU recommends that the current design be replaced with a design in which the rights to actual congestion paid are assigned directly to

the load that paid that congestion by node. (Priority: High. First reported 2015. Status: Partially adopted.)

- The MMU recommends that, under the current FTR design, the rights to all congestion revenue be allocated as ARRs prior to sale as FTRs. Reductions in allocated revenue as a contingency for outages and increased system capability should be reserved for ARRs rather than sold in the Long Term FTR Auction. (Priority: High. First reported 2017. Status: Not adopted.)
- The MMU recommends that IARRs be eliminated from PJM's tariff, but that if IARRs are not eliminated, IARRs should be subject to the same proration rules that apply to all other ARR rights. (Priority: Low. First reported 2018. Status: Not adopted.)

### FTR

- The MMU recommends that FTR funding be based on total congestion, including both day-ahead and balancing congestion. (Priority: High. First reported 2017. Status: Not adopted.)
- The MMU recommends that bilateral transactions be eliminated and that all FTR transactions occur in the PJM market. (Priority: High. First reported 2022. Status: Not adopted.)<sup>57</sup>
- The MMU recommends a requirement that the details of all bilateral FTR transactions be reported to PJM. (Priority: High. First reported 2020. Status: Not adopted.)
- The MMU recommends that PJM continue to evaluate the bilateral indemnification rules and any asymmetries they may create. (Priority: Low. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM reduce FTR sales on paths with persistent overallocation of FTRs, including a clear definition of persistent overallocation and how the reduction will be applied. (Priority: High. First reported 2013. Status: Partially adopted, 2014/2015 planning period.)
- The MMU recommends that PJM eliminate generation to generation paths and all other paths that do not represent the delivery of power to load. (Priority: High. First reported 2018. Status: Not adopted.)

<sup>57</sup> If adopted, this recommendation would replace the next two recommendations.

- The MMU recommends that the Long Term FTR product be eliminated. If the Long Term FTR product is not eliminated, the Long Term FTR Market should be modified so that the supply of prevailing flow FTRs in the Long Term FTR Market is based solely on counter flow offers in the Long Term FTR Market. (Priority: High. First reported 2017. Status: Not adopted.)
- The MMU recommends that PJM improve transmission outage modeling in the FTR auction models, including the use of probabilistic outage modeling. (Priority: Low. First reported 2013. Status: Not adopted.)

### “Surplus”

- The MMU recommends that all FTR auction revenue be distributed to ARR holders monthly, regardless of FTR funding levels. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that, under the current FTR design, all congestion revenue in excess of FTR target allocations be distributed to ARR holders on a monthly basis. (Priority: High. First reported 2018. Status: Not adopted.)
- The MMU recommends that FTR auction revenues not be used by PJM to buy counter flow FTRs for the purpose of improving FTR payout ratios.<sup>58</sup> (Priority: High. First reported 2015. Status: Not adopted.)

### FTR Subsidies

- The MMU recommends that PJM eliminate portfolio netting to eliminate cross subsidies among FTR market participants. (Priority: High. First reported 2012. Status: Not adopted. Rejected by FERC.)
- The MMU recommends that PJM eliminate subsidies to counter flow FTRs by applying the payout ratio to counter flow FTRs in the same way the payout ratio is applied to prevailing flow FTRs. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM eliminate geographic cross subsidies. (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM examine the mechanism by which self scheduled FTRs are allocated when load switching among LSEs occurs

throughout the planning period. (Priority: Low. First reported 2011. Status: Not adopted.)

### FTR Liquidation

- The MMU recommends that the FTR portfolio of a defaulted member be canceled rather than liquidated or allowed to settle as a default cost to the membership. (Priority: High. First reported 2018. Status: Not adopted.)

### Credit

- The MMU recommends the use of at least a 99 percent confidence interval when calculating initial margin requirements for FTR market participants, in order to assign the cost of managing risk to the FTR holders who benefit or lose from their FTR positions. (Priority: High. First reported 2021. Status: Adopted 2023.)

## Adopted Recommendations

The following is the complete list of all MMU recommendations that have been adopted by PJM, including the priority, date of first report, date of last report, and the section in the State of the Market Report in which the recommendation was made.

### Adopted 2024

- The MMU recommends that Energy Efficiency Resources (EE) not be included in the capacity market construct because PJM’s load forecasts have accounted for EE since the 2016 load forecast for the 2019/2020 Delivery Year. EE is not a capacity resource as defined in the tariff, and there is no reason to continue to pay large subsidies to EE providers.<sup>59</sup> (Priority: Medium. First reported 2016. Last reported 2024. Section 5, Capacity Market.)<sup>60</sup>
- The MMU recommends that energy efficiency resources (EE) not be included in the capacity market mechanism and that PJM should ensure that the impact of EE measures on the load forecast is incorporated immediately. (Priority: Medium. First reported 2018. Last reported 2024. Section 6, Demand Response.)<sup>61 62</sup>

59 “PJM Manual 19: Load Forecasting and Analysis,” § 3.2 Development of the Forecast, Rev. 37 (Dec. 18, 2024).

60 See 189 FERC ¶ 61,095 (2024).

61 189 FERC ¶ 61,095 (2024).

62 Originally incorporated with auctions conducted in 2016 for the 2016/2017 Delivery Year and forward. The mechanics of the EE addback mechanism were modified beginning with the 2023/2024 Delivery Year.

58 See “PJM Manual 6: Financial Transmission Rights,” Rev. 33 (Sep. 25, 2024).

- The MMU recommends that PJM monitor, and adjust as necessary, the weights applied to the components of the interfaces to ensure that the interface prices reflect ongoing changes in system conditions. (Priority: Low. First reported 2009. Last reported 2024. Section 9, Interchange Transactions.)

## Adopted 2023

- The MMU recommends that Manual 15 (Cost Development Guidelines) be replaced or updated with a straightforward description of the components of cost-based offers and the mathematically correct calculation of cost-based offers for thermal resources. (Priority: Medium. First reported 2016. Last reported 2024. Section 3, Energy Market.)
- The MMU recommends that market participants be required to document the amount and cost of consumables used when operating in order to verify that the total operating cost is consistent with the total quantity used and the unit characteristics. (Priority: Medium. First reported 2020. Last reported 2024. Section 3, Energy Market.)
- The MMU recommends that intermittent resources be subject to an enforceable ICAP must offer rule in the day-ahead and real-time energy markets that reflects the limitations of these resources. (Priority: Medium. First reported 2020. Last reported 2024. Section 3, Energy Market.)
- The MMU recommends that intermittent resources, including storage, not be permitted to offer capacity MW based on energy deliveries that exceed their defined deliverability rights (CIRs). Only energy output for such resources at or below the designated CIR/deliverability level should be recognized in the definition of derated capacity (e.g. ELCC). Correctly defined ELCC derating factors are lower than the CIRs required to meet those derating factors. (Priority: High. First reported 2021. Last reported 2024. Section 5, Capacity Market.)
- The MMU recommends the use of at least a 99 percent confidence interval when calculating initial margin requirements for FTR market participants, in order to assign the cost of managing risk to the FTR holders who benefit or lose from their FTR positions. (Priority: High. First reported 2021. Last reported 2024. Section 13, FTRs.)

## Adopted 2022

- The MMU recommends that the limits imposed on the pre-emergency and emergency demand response share of the synchronized reserve market be eliminated. (Priority: Medium. First reported 2018. Last reported 2024. Section 6, Demand Response.)
- The MMU recommends that the implementation of the EE addback mechanism be modified to ensure that market clearing prices are not affected. (Priority: Medium. First reported 2016. Last reported 2022. Section 5, Capacity Market.)<sup>63</sup>
- The MMU recommends that PRD be required to respond during a PAI, regardless of whether the real-time LMP at the applicable location meet or exceeds the PRD strike price, to be consistent with all CP resources. (Priority: High. First reported 2017. Last reported 2022. Section 6, Demand Response.)
- The MMU recommends that PJM end the practice of maintaining outdated definitions of interface pricing points, eliminate the NIPSCO, Southeast and Southwest interface pricing points from the day-ahead and real-time energy markets and, with VACAR, assign the transactions created under the reserve sharing agreement to the SOUTH interface pricing point. (Priority: High. First reported 2013. Last reported 2022. Section 9, Interchange Transactions.)
- The MMU recommends that the \$7.50 margin be eliminated from the definition of the cost of tier 2 synchronized reserve because it is a markup and not a cost. (Priority: Medium. First reported 2018. Last reported 2023. Section 10, Ancillary Services.)
- The MMU recommends that the variable operating and maintenance cost be eliminated from the definition of the cost of tier 2 synchronized reserve and that the calculation of synchronized reserve variable operations and maintenance costs be removed from Manual 15. (Priority: Medium. First reported 2019. Last reported 2023. Section 10, Ancillary Services.)
- The MMU recommends that the rule requiring that tier 1 synchronized reserve resources be paid the tier 2 price when the nonsynchronized reserve price is above zero be eliminated immediately and that,

<sup>63</sup> This recommendation was first made in the 2019/2020 BRA report in 2016. See "Analysis of the 2019/2020 RPM Base Residual Auction Revised," <[http://www.monitoringanalytics.com/reports/Reports/2016/IMM\\_Analysis\\_of\\_the\\_20192020\\_RPM\\_BRA\\_20160831-Revised.pdf](http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Analysis_of_the_20192020_RPM_BRA_20160831-Revised.pdf)>. (August 31, 2016).



under the current rule, tier 1 synchronized reserve resources not be paid the tier 2 price when they do not respond. (Priority: High. First reported 2013. Last reported 2023. Section 10, Ancillary Services.)

- The MMU recommends that the tier 2 synchronized reserve must offer requirement be enforced on a daily and hourly basis. The MMU recommends that PJM define a set of acceptable reasons why a unit can be made unavailable daily or hourly and require unit owners to select a reason in Markets Gateway whenever making a unit unavailable either daily or hourly or setting the offer MW to 0 MW. (Priority: Medium. First reported 2013. Last reported 2023. Section 10, Ancillary Services.)
- The MMU recommends that the VRSA be terminated and, if necessary, replaced by a reserve sharing agreement between PJM and VACAR South, similar to agreements between PJM and other bordering areas. (Priority: Medium. First reported 2020. Last reported 2023. Section 10, Ancillary Services.)
- The MMU recommends that a reason code be attached to every hour in which PJM market operations adds additional DASR MW. (Priority: Medium. First reported 2015. Last reported 2023. Section 10, Ancillary Services.)
- The MMU recommends that PJM modify the DASR market to ensure that all resources cleared incur a real-time performance obligation. (Priority: Low. First reported 2013. Last reported 2023. Section 10, Ancillary Services.)
- The MMU recommends that, in order to mitigate market power, offers in the DASR market be based on opportunity cost only. (Priority: Low. First reported 2009. Modified, 2018. Last reported 2023. Section 10, Ancillary Services.)
- The MMU recommends the removal of all labor costs from the Cost Development Guidelines. (Priority: Medium. First reported 2016. Last reported 2024. Section 3, Energy Market.)
- The MMU recommends that PJM eliminate the exemption for CTs and diesels from the requirement to follow dispatch in order to receive uplift. The performance of these resources should be evaluated in a manner consistent with all other resources (Priority: Medium. First reported 2018. Last reported 2023. Section 4, Energy Uplift.)

- The MMU recommends that PJM eliminate the use of Degree of Generator Performance (DGP) in the synchronized reserve market solution and improve the actual tier 1 estimate. If PJM continues to use DGP, DGP should be documented in PJM's manuals. (Priority: Medium. First reported 2018. Last reported 2023. Section 10, Ancillary Services.)

## Adopted 2021

- The MMU recommends that PJM approve one RT SCED case for each five minute interval to dispatch resources during that interval using a five minute ramp time, and that PJM calculate prices using LPC for that five minute interval using the same approved RT SCED case. (Priority: High. First reported 2019. Last reported 2022. Section 3, Energy Market.)
- The MMU recommends that the offer cap for capacity resources be defined as the net avoidable cost rate (ACR) of each unit so that the clearing prices are a result of such net ACR offers, consistent with the fundamental economic logic for a competitive offer of a CP resource. (Priority: High. First reported 2017. Last reported 2022. Section 5, Capacity Market.)
- The MMU recommends that PJM update the values in the CRF table in the tariff when the components change. (Priority: High. First reported 2020. Last reported 2021. Section 5, Capacity Market.)
- The MMU recommends that the net revenue calculation used by PJM to calculate the net Cost of New Entry (CONE) VRR parameter reflect the actual flexibility of units in responding to price signals rather than using assumed fixed operating blocks that are not a result of actual unit limitations.<sup>64</sup>  
<sup>65</sup> The result of reflecting the actual flexibility is higher net revenues, which affect the parameters of the RPM demand curve and market outcomes. (Priority: High. First reported 2013. Last reported 2022. Section 5, Capacity Market.)
- The MMU recommends for oil tanks shared with other resources that only a proportionate share of the minimum tank suction level (MTSL) be allocated to black start service. The MMU further recommends that the PJM tariff be updated to clearly state how the MTSL will be calculated for black start units sharing oil tanks. (Priority: Medium. First reported

<sup>64</sup> See PJM Interconnection, LLC, Docket No. ER12-513-000 (December 1, 2011) ("Triennial Review").

<sup>65</sup> See the 2019 State of the Market Report for PJM, Volume 2, Section 7: Net Revenue.

2017. Last reported 2022. Section 10, Ancillary Services.)

- The MMU recommends that PJM enforce the FTR auction bid limits at the parent company level starting immediately. (Priority: High. First reported Q3, 2020. Last reported 2021. Section 13, Financial Transmission and Auction Revenue Rights.)
- The MMU recommends that PJM not use CT price setting logic to modify transmission line limits to artificially override the nodal prices that are based on fundamental LMP logic in order to reduce uplift. (Priority: Medium. First reported 2015. Last reported 2022. Section 3, Energy Market.)

## Adopted 2020

- The MMU recommends incorporating startup and notification times as additional parameters subject to limits in order to ensure the reliability of the grid, as well as to deter market manipulation by offering artificially lengthy startup and notification time parameters to withhold generation from the market. (Priority: Medium. First reported 2010. Last reported 2010. Section 3, Energy Market.)
- The MMU recommends revisions to the calculation of energy market opportunity costs to incorporate all time based offer parameters and all limitations that impact the opportunity cost of generating unit output. (Priority: Medium. First reported 2016. Last reported 2018. Section 3, Energy Market.)
- The MMU recommends that the tariff be changed to allow units to have fuel cost policies that do not include fuel procurement practices, including fuel contracts. Fuel procurement practices, including fuel contracts, may be used as the basis for fuel cost policies but should not be required. (Priority: Low. First reported 2018. Last reported 2020. Section 3, Energy Market.)
- The MMU recommends that PJM change the fuel cost policy requirement to apply only to units that will be offered with non-zero cost-based offers. The PJM market rules should require that the cost-based offers of units without an approved fuel cost policy be set to zero. (Priority: Low. First reported 2018. Last reported 2020. Section 3, Energy Market.)
- The MMU recommends changing the assignment of the Saskatchewan Power Company and Manitoba Hydro balancing authorities from the Northwest

interface pricing point to the MISO interface pricing point and eliminating the Northwest interface pricing point from the day-ahead and real-time energy markets. (Priority: High. First reported Q1, 2020. Last reported 2020. Section 9, Interchange Transactions.)

- The MMU recommends that PJM eliminate the NCMPAIMP and NCMPAEXP interface pricing points. It is not appropriate to have special pricing agreements between PJM and any external entity. The same market pricing should apply to all transactions. (Priority: High. First reported Q2, 2020. Last reported 2020. Section 9, Interchange Transactions.)
- The MMU recommends that rules be implemented to require that project cost caps on new transmission projects be part of the evaluation of competing projects. (Priority: Medium. First reported 2015. Last reported 2020. Section 12, Generation and Transmission Planning.)

## Adopted 2019

- The MMU recommends that PJM market rules require the fuel type be identified for every price and cost schedule and PJM market rules remove nonspecific fuel types such as other or co-fire other from the list of fuel types available for market participants to identify the fuel type associated with their price and cost schedules. (Priority: Medium. First reported 2015. Last reported Q3, 2021, Section 3, Energy Market.)
- The MMU recommends that dispatchers classify the reasons for unit deselection and document all unit deselections. (Priority: Low. First reported 2009. Last reported 2009, Section 6, Ancillary Service Markets.)
- The MMU recommends that PJM immediately provide the required 12-month notice to Duke Energy Progress (DEP) to unilaterally terminate the Joint Operating Agreement. (Priority: Low. First reported 2013. Last reported 2019, Section 9, Interchange Transactions.)
- The MMU recommends that rules be implemented to ensure that CIRs are terminated within one year if units cannot qualify to be capacity resources and, if requested, after one CP must offer exception to permit the issue of CP status to be addressed.

(Priority: Low. First reported 2018. Last reported 2020, Section 12, Generation and Transmission Planning.)

- The MMU recommends that the forfeiture amount from the FTR forfeiture rule be based on the correct hourly cost of an FTR, rather than a simple daily price divided by 24. (Priority: High. First reported 2018. Last reported 2020, Section 13, FTRs and ARRs. Pending at FERC.)
- The MMU recommends that PJM perform a comprehensive evaluation of the up-to congestion product in coordination with the MMU and provide a joint report to PJM stakeholders to ensure that all market participants are aware of how these transactions impact the charges and credits to market participants in all other areas of the PJM Energy Market. (Priority: High. First reported 2009. Last reported 2012, Section 3, Operating Reserve.)
- The MMU recommends that PJM be more explicit and transparent about why tier 1 biasing is used in defining demand in the Tier 2 Synchronized Reserve Market. The MMU recommends that PJM define rules for estimating tier 1 MW, define rules for the use and amount of tier 1 biasing and identify the rule based reasons for each instance of biasing. (Priority: Medium. First reported 2012. Last reported 2020, Section 10 Ancillary Service Markets.)

## Adopted 2018

- The MMU recommends that units scheduled in the Day-Ahead Energy Market and not committed in real time be compensated for LOC incurred within an hour. (Priority: Medium. First reported 2013. Last reported Q3, 2018, Section 4, Energy Uplift.)
- The MMU recommends eliminating the use of internal bilateral transactions (IBTs) in the calculation of deviations used to allocate balancing operating reserve charges. (Priority: High. First reported 2013. Last reported Q3, 2021, Section 4, Energy Uplift.)
- The MMU recommends that PJM revise Manual 11 attachment C consistent with the tariff to limit uplift compensation to offered costs. The Manual 11 attachment C procedure should describe the steps market participants must take to change the availability of cost-based energy offers that have been submitted day ahead. The MMU recommends

that PJM eliminate the Manual 11 attachment C procedure with the implementation of hourly offers (ER16-372-000). (Priority: Medium. First reported 2016. Last reported 2018, Section 4, Energy Uplift.<sup>66</sup>)

## Adopted 2017

- The MMU recommends that PJM and MISO work together to align interface pricing definitions, using the same number of external buses and selecting buses in close proximity on either side of the border with comparable bus weights. (Priority: Medium. First reported 2012. Last reported 2018 Q3, Section 9, Interchange Transactions.)
- The MMU recommends that PJM apply the FTR forfeiture rule to up to congestion transactions consistent with the application of the FTR forfeiture rule to increment offers and decrement bids. (Priority: High. First reported 2013. Last reported 2018 Q3, Section 13, Financial Transmission and Auction Revenue Rights.)

## Adopted 2016

- The MMU recommends that PJM report correct monthly payout ratios to reduce understatement of payout ratios on a monthly basis. (Priority: Low. First reported 2012. Last reported: 2018 Q3, Section 13, Financial Transmission and Auction Revenue Rights.)
- The MMU recommends that the single clearing price for synchronized reserves be determined based on the actual five minute LMP and actual LOC and not the forecast LMP. (Priority: Low. First reported 2010. Last reported: 2018 Q3, Section 10, Ancillary Service Markets)

## Adopted 2015

- The MMU recommends that the lost opportunity cost in the energy market be calculated using the schedule on which the unit was scheduled to run in the energy market. (Priority: High. First reported 2009. Last reported: 2018 Q3 Section 4, Energy Uplift.)
- The MMU recommends including no load and startup costs as part of the total avoided costs in the calculation of lost opportunity cost credits paid to combustion turbines and diesels scheduled in

<sup>66</sup> Although this recommendation has not been adopted exactly as recommended by the MMU, the implementation of hourly offers by PJM has effectively adopted this recommendation.

the Day-Ahead Energy Market but not committed in real time. (Priority: Medium. First reported 2012. Last reported: 2018 Q3 Section 4, Energy Uplift.)

- The MMU recommends using the entire offer curve and not a single point on the offer curve to calculate energy lost opportunity cost. (Priority: Medium. First reported 2012. Last reported: 2018 Q3 Section 4, Energy Uplift.)
- The MMU recommends that all generation types face the same performance incentives. (Priority: High. First reported 2009. Last reported: 2012 Section 4, Capacity Market.)
- The existence of a capacity market that links payments for capacity to the level of unforced capacity and therefore to the forced outage rate creates an incentive to improve forced outage rates. The performance incentives in the RPM Capacity Market design need to be strengthened. (Priority: High. First reported 2009. Last reported: 2009 Section 5, Capacity Market.)
- The MMU recommends that the obligations of capacity resources be more clearly defined in the market rules. (Priority: High. First reported 2010. Last reported: 2011 Section 4, Capacity Market.)
- The MMU recommends that PJM eliminate all OMC outages from the calculation of forced outage rates used for any purpose in the PJM Capacity Market. (Priority: Medium. First reported 2013. Last reported: 2018 Q3 Section 5, Capacity Market.)
- The MMU recommends immediate elimination of lack of fuel as an acceptable basis for an OMC outage. (Priority: Medium. First reported 2012. Last reported: 2012 Section 4, Capacity Market.)
- PJM should scrutinize OMC outages for low Btu coal carefully. (Priority: Medium. First reported 2003. Last reported: 2009 Section 4, Capacity Market.)
- The MMU recommends that PJM eliminate the broad exception related to lack of gas during the winter period for single-fuel, natural gas-fired units. (Priority: Medium. First reported 2013. Last reported: 2018 Q3 Section 5, Capacity Market.)
- The MMU recommends that Generation Capacity Resources be paid on the basis of whether they produce energy when called upon during any of the hours defined as critical. One hundred percent of capacity market revenue should be at risk rather

than only fifty percent. (Priority: High. First reported 2012. Last reported: 2018 Q3 Section 5, Capacity Market.)

- The MMU recommends elimination of the exception related to a unit that runs less than 50 hours during the RPM peak period. (Priority: Low. First reported 2012. Last reported: 2012 Section 4 Capacity Market.)
- The MMU recommends that the use of the 2.5 percent demand adjustment (Short Term Resource Procurement Target) be terminated immediately. The 2.5 percent should be added back to the overall market demand curve. (Priority: Medium. First reported 2012. Last reported: 2018 Q3 Section 5 Capacity Market.)
- The MMU recommends that the definition of demand side resources be modified to ensure that such resources be fully substitutable for other generation capacity resources. Both the Limited and the Extended Summer DR products should be eliminated in order to ensure that the DR product has the same unlimited obligation to provide capacity year round as generation capacity resources. (Priority: High. First reported 2012. Last reported: 2018 Q3 Section 5 Capacity Market.)
- The MMU recommends that PJM increase the Capacity Resource Deficiency Charge, which is a penalty charge. (Priority: High. First reported 2013. Last reported: 2013 Section 5 Capacity Market.)
- The MMU recommends that all capacity imports have firm transmission to the PJM border prior to offering in an RPM auction. (Priority: High. First reported 2014. Last reported: 2018 Q3 Section 5, Capacity Market.)
- The MMU recommends that all capacity imports be required to be pseudo tied prior to the relevant Delivery Year in order to ensure that imports are as close to full substitutes for internal, physical capacity resources as possible. (Priority: High. First reported 2014. Last reported: 2017 Section 5, Capacity Market.)
- The MMU recommends that all resources importing capacity into PJM accept a must offer requirement. (Priority: High. First reported 2014. Last reported: 2018 Q3 Section 5, Capacity Market.)



- The MMU recommends capping the baseline for measuring compliance under GLD, for the limited summer product, at the customers' PLC. (Priority: High. First reported 2010. Last reported: 2018 Q3 Section 6, Demand Response.)
- Continued development of appropriate credit protections for transactions in PJM markets that are consistent with those available to participants in bilateral transactions. (Priority: Low. First reported 2002. Last reported: 2002 Section: Recommendations.)

### Adopted 2014

- The MMU recommends that PJM require all generating units to identify the fuel type associated with each of their offered schedules. (Priority: Low. First reported 2014. Last reported: 2018 Q1 Section 3, Energy Market.)
- Pending elimination of these DR products, the MMU recommends that PJM procure the maximum amount of Annual and Extended Summer capacity resources available during an RPM auction, without impacting the clearing price. Currently, PJM procures a minimum level of Extended Summer and Annual Resources, but could procure additional MW of these superior products without a change in the clearing price. (Priority: Medium. First reported 2012. Last reported: 2012 Section 4, Capacity Market.)
- The MMU recommends that demand resources whose technology type (load drop method) is designated as "Other" explicitly record the technology type. (Priority: Low. First reported 2013. Last reported: 2018 Q3 Section 6, Demand Response.)
- The MMU recommends that the Enhanced energy Scheduler (EES) application be modified to require that transactions be scheduled for a constant MW level over the entire 45 minutes as soon as possible. This business rule is currently in the PJM Manuals, but is not being enforced. (Priority: Low. First reported 2009. Last reported: 2011 Section 8, Interchange Transactions.)
- The MMU recommends that the rules for compliance with calls to respond to actual spinning events be reevaluated. (Priority: Low. First reported 2011. Last reported: 2012 Section 9, Ancillary Service Markets.)
- The MMU recommends that no payments be made to tier 1 synchronized reserve resources if they are deselected in the PJM market solution. The MMU also recommends that documentation of the tier 1 synchronized reserve deselection process be published. (Priority: High. First reported 2014. Status: Adopted, 2014. Last reported: 2018 Q3 Section 10, Ancillary Service Markets.)

### Adopted 2013

- The PJM Tariff defines offer capped units as those units capped to maintain system reliability as a result of limits on transmission capability. Offer capping for providing black start service does not meet this criterion. The MMU recommends that black start units not be given FMU status under the current rules. (Priority: Low. First reported 2013. Last reported: 2014 Q1, Section 3, Energy Market.)
- The MMU recommends that the notification requirement for deactivations be modified to include required notification of six to twelve months prior to an auction in which the unit will not be offered due to deactivation. The purpose of this deadline is to allow adequate time for potential Capacity Market Sellers to offer new capacity in the auction. (Priority: Low. First reported 2012. Last reported: 2012 Section 4, Capacity Market.)
- The MMU recommends modifying the evaluation criteria via a change to PJM's market software, to ensure that not willing to pay congestion transactions are not permitted to flow in the presence of congestion. (Priority: Low. First reported 2009. Last reported: 2009 Section 4, Interchange Transactions.)
- The MMU recommends that PJM modify the not willing to pay congestion product to address the issues of uncollected congestion charges. The MMU recommends charging market participants for any congestion incurred while such transactions are loaded, regardless of their election of transmission service, and restricting the use of not willing to pay congestion transactions to transactions at interfaces (wheeling transactions). (Priority: Low. First reported 2010. Last reported: 2011 Section 8, Interchange Transactions.)
- The MMU recommends that PJM, FERC, reliability authorities and state regulators reevaluate the way



in which black start service is procured in order to ensure that procurement is done in a least cost manner for the entire PJM market. PJM should have responsibility to prepare the black start restoration plan for the region, with Members playing an advisory role. PJM should have the responsibility to procure required black start service on a least cost basis through a transparent process. (Priority: Low. First reported 2009. Last reported: 2011 Section 9, Ancillary Service Markets.)

- The MMU recommends that PJM document the reasons each time it changes the Tier 1 synchronized reserve transfer capability into the Mid-Atlantic subzone market because of the potential impacts on the market. (Priority: Low. First reported 2011. Last reported: 2011 Section 9, Ancillary Service Markets.)

## Adopted 2012

- The MMU recommends that PJM should, on an expedited basis, request that the tariff be modified to permit allocation of day-ahead operating reserve charges consistent with the prior allocation of these charges in real time. This would be a short term solution to the issue created by shifting operating reserve charges to the Day-Ahead Energy Market and therefore changing the allocation of those charges. In addition, PJM should start a stakeholder process to consider the market design and cost allocation issues in detail and propose a permanent tariff change that results from the process. (Priority: High. First reported 2012. Last reported: 2012-Q3 Section 3, Operating Reserve.)
- The MMU recommends that PJM conduct a detailed review of the Day-Ahead Market software in order to address the issue of occasional anomalous loss factors and their effect on the day-ahead market results. (Priority: Low. First reported 2011. Last reported: 2011 Section 10, Congestion and Marginal Losses.)
- The MMU recommends that the roles of PJM and the transmission owners in the decision making process to control for local contingencies be clarified, that PJM's role be strengthened and that the process be made transparent. (Priority: Low. First reported 2013. Last reported 2018 Q3, Section 3, Energy Market.)

- The MMU recommends the use of a single five minute clearing price based on actual five minute LMP and lost opportunity cost to improve the performance of the Regulation Market. (Priority: Medium. First reported 2010. Status: Adopted in 2012. Last reported 2018 Q3, Section 10, Ancillary Service Markets.)

## Adopted 2011

- The MMU recommends eliminating internal source and sink bus designations for external energy transactions in the Day-Ahead and Real-Time Energy Markets. (Priority: Low. First reported 2010. Last reported: 2011 Section 8, Interchange Transactions.)
- The MMU continues to recommend the complete elimination of unsecured credit, over an appropriate transition period, based on the MMU's view of PJM's role in evaluating the credit worthiness of complex corporate entities and due to a concern about inappropriate shifts of risks and costs among PJM members. (Priority: Low. First reported 2009. Last reported: 2010 Section 8, Financial Transmission and Auction Revenue Rights.)

## Adopted 2010

- Implementation of rules governing the definition of final prices to ensure certainty for market participants. (Priority: High. First reported 2008. Last reported: 2009 Section 1, Introduction.)
- The MMU recommends the implementation of improved cost-based data submission to permit better monitoring and better analysis of markets. (Priority: Medium. First reported 2002. Last reported: 2009 Section 1, Introduction.)

## Adopted 2009

- Retention and application of enhancements to rules governing the payment of operating reserve credits to generators and the allocation of operating reserves charges among market participants that were implemented on December 1, 2008. The new operating reserve rules represent positive steps towards the goals of removing the ability to exercise market power and refining the allocation of operating reserves charges to better reflect causal factors. (Priority: High. First reported 2006. Last reported: 2007 Section 1, Introduction.)

- The MMU recommends that the RPM market structure, definitions and rules be modified to improve the efficiency of market prices and to ensure that market prices reflect the forward locational marginal value of capacity. (Priority: High. First reported 2006. Last reported: 2011 Section 4, Capacity.)
- Retention and application of the improved market power mitigation rules in the Regulation Market to prevent the exercise of market power in the Regulation Market while ensuring appropriate economic signals when investment is required and an efficient market mechanism. The PJM Regulation Market continues to be characterized by structural market power. PJM's application of targeted, flexible real-time, market power mitigation in the Regulation Market addresses only the hours in which structural market power exists and therefore provides an incentive for the continued development of competition. (Priority: High. First reported 2006. Last reported: 2009 Section 1, Introduction.)
- While it is reasonable to limit the authority of LSE/EDCs in the review of demand side settlements as the LSE/EDCs have economic incentives to deny settlements, LSE/EDCs should be able to initiate PJM settlement reviews. (Priority: Low. First reported 2009. Last reported: 2009 Section 2, Energy Market, Part 1.)
- The MMU recommends ways to further improve the Economic program by increasing the probability that payments are made only for economic and deliberate load reducing activities in response to price. (Priority: Low. First reported 2009. Last reported: 2009 Section 2, Energy Market, Part 1.)
- The four steps in the normal operations review should be routinely applied to all registrations from the beginning of participation. This would include the ongoing evaluation of whether CBL accurately represents customer load for each customer; analysis of settlements to determine responsiveness to price and; required submission of detailed description of load reduction activities on specific days.
- The definition of CBL should continue to be refined to ensure that it reflects the actual normal use of individual customers including normal daily and hourly fluctuations in usage and usage that is a function of measurable weather conditions. When

used to determine compliance in Load Management testing for GLD customers, the CBL calculation should include adjustments for ambient conditions.

- It is the MMU's recommendation that any settlement submitted with a consecutive 24 hour period of CBL greater than metered load should initiate a CBL review by PJM and that a customer should be required to provide documentation of load reduction actions taken prior to acceptance of such settlements. Further, in order for PJM or the MMU to assess the accuracy of the CBL for a particular customer or for the Program in general, more hourly load data is required than is currently captured by PJM.
- If, for any settlement, the number of consecutive hours showing load reduction is beyond a reasonable window for load reducing actions in response to price, it should initiate a CBL review and warrant further substantiation from the customer and CSP.
- Load reduction in response to price must be clearly defined in the business rules and verified in a transparent daily settlement screen.

## Adopted 2008

- Consistent application of local market power rules to all constraints. (Priority: High. First reported 2006. Last reported: 2007 Section 1, Introduction.)
- Retention and application of the improved local market power mitigation rules to prevent the exercise of local market power in the Energy Market while ensuring appropriate economic signals when investment is required. (Priority: Medium. First reported 2003. Last reported: 2009 Section 1, Introduction.)
- Consistent application of local market power rules to all units, including those currently exempt from offer capping. (Priority: High. First reported 2006. Last reported: 2007 Section 1, Introduction.)

## Adopted 2006

- Modification of incentives in the capacity market to require all Load Serving Entities (LSEs) to meet their obligations to serve load on a longer-term basis and to require all capacity resources to be offered on a comparable longer term basis. (Priority: Medium. First reported 1999. Last reported: 2000 Section Summary.)
- Reevaluation of the criteria used to determine whether generating units qualify for capacity resource status. (Priority: Medium. First reported 1999. Last reported: 1999 Section Summary.)



## Energy Market

The PJM energy market comprises all types of energy transactions, including the sale or purchase of energy in PJM's Day-Ahead and Real-Time Energy Markets, bilateral and forward markets and self supply. Energy transactions analyzed in this report include those in the PJM Day-Ahead and Real-Time Energy Markets. These markets provide key benchmarks against which market participants may measure results of transactions in other markets.

The Market Monitoring Unit (MMU) analyzed measures of market structure, participant conduct and market performance, including market size, concentration, pivotal suppliers, offer behavior, markup, and price. The MMU concludes that the PJM energy market results were competitive in 2024.

**Table 3-1 The energy market results were competitive**

Market Element	Evaluation	Market Design
Market Structure: Aggregate Market	Partially Competitive	
Market Structure: Local Market	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Effective

- The aggregate market structure was evaluated as partially competitive because the aggregate market power test based on pivotal suppliers indicates that the aggregate day-ahead market structure was not competitive on 49.5 percent of the days in 2024. The hourly HHI (Herfindahl-Hirschman Index) results indicate that the PJM aggregate energy market in 2024 was, on average, unconcentrated by FERC HHI standards. The average HHI was 714 with a minimum of 553 and a maximum of 983. The baseload segment of the supply curve was unconcentrated. The intermediate segment of the supply curve was moderately concentrated on average. The peaking segment of the supply curve was highly concentrated. The fact that the average HHI is in the unconcentrated range does not mean that the aggregate market was competitive in all hours. As demonstrated for the day-ahead market, it is possible to have pivotal suppliers in the aggregate market even when the HHI level is not in the highly concentrated range. It is possible to have an exercise of market power even when the HHI level is not in the highly concentrated range. The number of pivotal suppliers in the energy market is a more precise measure of structural market power than the HHI. The HHI is not a definitive measure of structural market power.
- The local market structure was evaluated as not competitive due to the highly concentrated ownership of supply in local markets created by transmission constraints and local reliability issues. The results of the three pivotal supplier (TPS) test, used to test local market structure, indicate the existence of market power in local markets created by transmission constraints. The local market performance is competitive as a result of the application of the TPS test. Transmission constraints create the potential for the exercise of local market power. The goal of PJM's application of the three pivotal supplier test is to identify local market power and offer cap to competitive offers, correcting for structural issues created by local transmission constraints. There are, however, identified issues with the definition of cost-based offers and the application of market power mitigation to resources whose owners fail the TPS test that need to be addressed because unit owners can exercise market power even when they fail the TPS test.
- Participant behavior was evaluated as competitive because the analysis of markup shows that marginal units generally make offers at, or close to, their marginal costs in both the day-ahead and real-time energy markets, although the behavior of some participants both routinely and during periods of high demand represents economic withholding. The ownership of marginal units is concentrated. The markups of pivotal suppliers in the aggregate market and of many pivotal suppliers in local markets remain unmitigated due to the lack of aggregate market power mitigation and the flawed implementation of offer caps for resources that fail the TPS test. The markups of those participants affected LMP.
- Market performance was evaluated as competitive because market results in the energy market reflect the outcome of a competitive market, as PJM prices are set, on average, by marginal units operating at, or close to, their marginal costs in both day-ahead and real-time energy markets, although high markups for some marginal units did affect prices.



- Market design was evaluated as effective because the analysis shows that the PJM energy market resulted in competitive market outcomes. In general, PJM's energy market design provides incentives for competitive behavior and results in competitive outcomes. In local markets, where market power is an issue, the market design identifies market power and causes the market to provide competitive market outcomes in most cases although issues with the implementation of market power mitigation and development of cost-based offers remain. The role of UTCs in the day-ahead energy market continues to cause concerns. Market design implementation issues, including inaccuracies in modeling of the transmission system and of generator capabilities as well as inefficiencies in price formation, undermine market efficiency in the energy market. The implementation of fast start pricing on September 1, 2021, undermined market efficiency by setting inefficient prices that are inconsistent with the dispatch signals.
- PJM markets are designed to promote competitive outcomes derived from the interaction of supply and demand in each of the PJM markets. Market design itself is the primary means of achieving and promoting competitive outcomes in PJM markets. One of the MMU's core functions is to identify actual or potential market design flaws.<sup>1</sup> The approach to market power mitigation in PJM has focused on market designs that promote competition (a structural basis for competitive outcomes) and on mitigating market power in instances where the market structure is not competitive and thus where market design alone cannot mitigate market power. FERC relies on effective market power mitigation when it approves market sellers to participate in the PJM market at market based rates.<sup>2</sup> In the PJM energy market, market power mitigation occurs primarily in the case of local market power. When a transmission constraint creates the potential for local market power, PJM applies a structural test to determine if the local market is competitive, applies a behavioral test to determine if generator offers exceed competitive levels and applies a market performance test to determine if such generator

offers would affect the market price.<sup>3</sup> There are, however, identified issues with the application of market power mitigation to resources whose owners fail the TPS test that can result in the exercise of local market power even when market power mitigation rules are applied. These issues need to be addressed, but, so far, PJM and FERC have failed to address them.<sup>4 5 6</sup> Some units with market power have positive markups and some have inflexible parameters, which means that the cost-based offer was not used and that the process for offer capping units that fail the TPS test does not consistently result in competitive market outcomes in the presence of market power. There are issues related to the definition of gas costs includable in energy offers that need to be addressed. There are issues related to the level of maintenance expense includable in energy offers that need to be addressed. There are currently no market power mitigation rules in place that limit the ability to exercise market power when aggregate market conditions are tight and there are pivotal suppliers in the aggregate market. Aggregate market power needs to be addressed. Market design must reflect appropriate incentives for competitive behavior, the application of local market power mitigation needs to be fixed, the definition of a competitive offer needs to be fixed, and aggregate market power mitigation rules need to be developed. The importance of these issues is amplified by the rules permitting cost-based offers in excess of \$1,000 per MWh.

<sup>1</sup> OATT Attachment M (PJM Market Monitoring Plan).

<sup>2</sup> See *Refinements to Horizontal Market Power Analysis for Sellers in Certain Regional Transmission Organization and Independent System Operator Markets*, Order No. 861, 168 FERC ¶ 61,040 (2019); *order on reh'g*, Order No. 861-A; 170 FERC ¶ 61,106 (2020).

<sup>3</sup> The market performance test means that offer capping is not applied if the offer does not exceed the competitive level and therefore market power would not affect market performance.

<sup>4</sup> 175 FERC ¶ 61,231 (2021).

<sup>5</sup> 185 FERC ¶ 61,158 (2023).

<sup>6</sup> 189 FERC ¶ 61,060 (2024).

## Overview

### Supply and Demand

#### Market Structure

- **Supply.** In 2024, 3,206 MW of new resources were added in the energy market, and 527 MW of resources were retired.
- The real-time hourly on peak average offered supply in 2024 increased by 2.8 percent, from 2023, from 137,865 MWh to 141,742 MWh.
- The day-ahead hourly average offered supply in 2024 decreased by 0.2 percent, from 2023, from 149,346 MWh to 149,120 MWh.
- The real-time hourly average cleared generation in 2024 increased by 2.5 percent from 2023, from 92,457 MWh to 94,814 MWh.
- The day-ahead hourly average cleared supply in 2024, including INCs and UTCs, decreased by 5.3 percent from 2023 from 116,042 MWh to 109,932 MWh.
- **Demand.** The real-time hourly peak load plus exports in 2024 was 154,045 MWh (148,218 MWh of load plus 5,827 MWh of gross exports) in the HE 1700 (EPT) on July 15, 2024, which was 0.8 percent, 1,248 MWh, higher than the PJM peak load plus exports in 2023, which was 152,797 MWh in the HE 1800 (EPT) on July 27, 2023.
- The real-time hourly peak load without exports in 2024 was 148,890 MWh in the HE 1800 (EPT) on July 16, 2024, higher than the PJM peak load in 2023, which was 144,215 MWh in the HE 1800 (EPT) on July 27, 2023.
- The real-time hourly average load in 2024 increased by 3.6 percent from 2023, from 86,193 MWh to 89,274 MWh.
- The day-ahead hourly average cleared demand in 2024, including DEC and UTCs, decreased by 6.5 percent from 2023, from 113,807 MWh to 106,355 MWh.

#### Market Behavior

- **Virtual Offers and Bids.** Any market participant in the PJM Day-Ahead Energy Market can use increment offers, decrement bids, up to congestion transactions, import transactions and export

transactions as financial instruments that do not require physical generation or load. The hourly average submitted increment offer MW increased by 21.0 percent and the cleared increment MW increased by 12.8 percent in 2024 compared to 2023. The hourly average submitted decrement bid MW increased by 25.2 percent and the cleared decrement MW increased by 11.5 percent in 2024 compared to 2023. The hourly average submitted up to congestion bid MW decreased by 54.9 percent and the cleared up to congestion bid MW decreased by 46.0 percent in 2024 compared to 2023.

#### Market Performance

- **Generation Fuel Mix.** In 2024, generation from coal units increased 1.4 percent, generation from natural gas units increased 3.5 percent, generation from oil units increased 53.1 percent, generation from wind units increased 8.5 percent, and generation from solar units increased 58.1 percent compared to 2023.
- **Fuel Diversity.** The fuel diversity of energy generation in 2024, measured by the fuel diversity index for energy (FDI<sub>e</sub>), increased 0.8 percent compared to 2023.
- **Marginal Resources.** In the PJM Real-Time Energy Market in 2024, coal units were 13.5 percent and natural gas units were 73.7 percent of marginal resources. In 2023, coal units were 5.5 percent and natural gas units were 83.1 percent of marginal resources.
- **Prices.** The real-time load-weighted average LMP in 2024 increased \$2.66 per MWh, or 8.5 percent from 2023, from \$31.08 per MWh to \$33.74 per MWh.
- The day-ahead load-weighted average LMP for 2024 increased \$1.86 or 5.8 percent from 2023, from \$31.93 per MWh to \$33.79 per MWh.
- **Fast Start Pricing.** The real-time load-weighted average PLMP was \$33.74 per MWh in 2024, which is 7.7 percent, \$2.43 per MWh, higher than the real-time load-weighted average DLMP of \$31.31 per MWh.
- The day-ahead load-weighted average PLMP was \$33.79 per MWh in 2024, which is 0.2 percent, \$0.07 per MWh, higher than the day-ahead load-weighted average DLMP of \$33.72 per MWh.

- **Components of Real-Time LMP.** In the PJM Real-Time Energy Market in 2024, 12.1 percent of the real-time load-weighted LMP was the result of coal costs, 39.7 percent was the result of gas costs, 6.0 percent was the result of the cost of emission allowances, 8.9 percent was the result of transmission constraint violation penalty factors, and 1.7 percent was the result of the use of fast start pricing.
- **Changes in Real-Time LMP.** Of the \$2.66 per MWh increase in the real-time load-weighted average LMP, \$0.50 per MWh (18.9 percent) was the fuel and consumables cost components of LMP, -\$0.05 per MWh (-1.9 percent) was the emissions cost components of LMP, 0.16 per MWh (6.2 percent) was the sum of the markup, maintenance, and ten percent adder components of LMP, \$1.39 per MWh (52.4 percent) was the transmission constraint penalty factor component of LMP, and \$0.10 per MWh (3.7 percent) was the scarcity component of LMP.
- **Price Convergence.** Hourly and daily price differences between the day-ahead and real-time energy markets fluctuate continuously and substantially from positive to negative. The average difference between day-ahead and real-time average prices was -\$0.09 per MWh in 2024, and -\$0.69 per MWh in 2023. The difference between day-ahead and real-time average prices, by itself, is not a measure of the competitiveness or effectiveness of the day-ahead energy market.

## Scarcity

- **Shortage Intervals.** There were 39 intervals with five minute shortage pricing on 17 days in 2024. These shortages did not correspond with any emergency warning or action. Four of the 39 intervals of shortage did correspond with two synchronized reserve events. Nine of the 39 intervals of shortage did correspond with cold weather alerts. One of the 39 intervals of shortage did correspond with a hot weather alert.
- **SCED Shortage Intervals.** There were 6,811 five minute intervals, or 6.5 percent of all five minute intervals, in 2024 for which at least one RT SCED solution showed a shortage of reserves, and 1,905 five minute intervals, or 1.8 percent of all five minute intervals, in 2024 for which more than one

RT SCED solution showed a shortage of reserves. PJM triggered shortage pricing for 39 five minute intervals, or 0.6 percent of all five minute intervals.

## Competitive Assessment

### Market Structure

- **Aggregate Pivotal Suppliers.** The PJM energy market, at times, requires generation from pivotal suppliers to meet load, resulting in aggregate market power even when the HHI level indicates that the aggregate market is unconcentrated. Three suppliers were jointly pivotal in the day-ahead market on 181 days, 49.5 percent of the days, in 2024 and 179 days, 49.0 percent of the days, in 2023.
- **Local Market Power.** In 2024, in the real-time market, the 500 kV system, nine zones, and the PJM/MISO interface experienced congestion resulting from one or more constraints binding for 100 or more hours. For seven out of the top 10 congested facilities (by real-time binding hours) in 2024, the average number of suppliers providing constraint relief was three or fewer. There was a high level of concentration within the local markets for providing relief to the most congested facilities in the PJM Real-Time Energy Market. The local market structure was not competitive.

### Market Behavior

- **Offer Capping for Local Market Power.** PJM offer caps units when the local market structure is noncompetitive. Offer capping is an effective means of addressing local market power when the rules are designed and implemented properly. Offer capping levels have historically been low in PJM. In the day-ahead energy market, for units committed to provide energy for local constraint relief, offer-capped unit hours decreased from 1.7 percent in 2023 to 1.2 percent in 2024. In the real-time energy market, for units committed to provide energy for local constraint relief, offer-capped unit hours increased from 1.3 percent in 2023 to 1.5 percent in 2024. While overall offer capping levels have been low, there are a significant number of units with persistent structural local market power that would have had a significant impact on prices in the absence of local market power mitigation.

The analysis of the application of the TPS test to local markets demonstrates that it is working to identify pivotal owners when the market structure is noncompetitive and to ensure that owners are not subject to offer capping when the market structure is competitive. There are, however, identified issues with the application of market power mitigation to resources whose owners fail the TPS test that can result in the exercise of local market power. These issues need to be addressed.

- **Offer Capping for Reliability.** PJM also offer caps units that are committed for reliability reasons, including for reactive support. In the day-ahead energy market, for units committed for reliability reasons, offer-capped unit hours increased from 0.13 percent 2023 to 0.21 percent in 2024. In the real-time energy market, for units committed for reliability reasons, offer-capped unit hours decreased from 0.14 percent in 2023 to 0.08 percent in 2024. The low offer cap percentages for reliability commitments, relative to offer capping for transmission constraints, do not mean that units committed for reliability reasons do not have market power. All units manually committed for reliability have market power and all are treated as if they have market power.
- **Parameter Mitigation.** In 2024, 27.7 percent of unit hours for units that failed the TPS test in the day-ahead market were committed on price-based schedules that were less flexible than their cost-based schedules. On days when cold weather alerts and hot weather alerts were declared, 34.4 percent of unit hours in the day-ahead energy market were committed on price-based schedules that were less flexible than their price PLS schedules.
- **Frequently Mitigated Units (FMU) and Associated Units (AU).** In 2024, no units qualified for an FMU adder. In 2023 and 2022, no units qualified for an FMU adder. In 2021, one unit qualified for an FMU adder.
- **Markup Index.** The markup index is a summary measure of participant offer behavior for individual marginal units. While the average markup index in the real-time market was -0.01 when using unadjusted cost-based offers in 2024, some marginal units did have substantial markups. The highest markup for any marginal unit in the real-

time market in 2024 was more than \$900 per MWh, using unadjusted cost-based offers.

While the average markup index in the day-ahead market was \$0.08 per MWh in 2024, some marginal units did have substantial markups. The highest markup for any marginal unit in the day-ahead market in 2024 was more than \$200 per MWh and the highest markup in 2023 was more than \$250 per MWh.

- **Markup.** The markup frequency distributions show that a significant proportion of units make price-based offers less than the cost-based offers permitted under the PJM market rules. This behavior means that competitive price-based offers reveal actual unit marginal costs and that PJM market rules permit the inclusion of costs in cost-based offers that are not short run marginal costs.

The markup frequency distributions also show that a significant proportion of units were offered with high markups, consistent with the exercise of market power.

## Market Performance

- **Markup.** The markup conduct of individual owners and units has an identifiable impact on market prices. Markup is a key indicator of the competitiveness of the energy market.

In the PJM Real-Time Energy Market in 2024, the unadjusted markup component (net of positive and negative markup components) of LMP was -\$0.01 per MWh or -0.1 percent of the PJM load-weighted average LMP. July had the highest unadjusted peak markup component, \$6.10 per MWh, or 10.0 percent of the real-time peak hour load-weighted average LMP for July.

Participant behavior was evaluated as competitive because the analysis of markup shows that marginal units generally make offers at, or close to, their marginal costs in both the day-ahead and real-time energy markets, although the behavior of some participants represents economic withholding.

- **Markup and Local Market Power.** Comparison of the markup behavior of marginal units with TPS test results shows that for 3.4 percent of all real-time marginal unit intervals in 2024, the marginal unit had both local market power as determined by the



TPS test and a positive markup. The fact that units with market power had a positive markup means that the cost-based offer was not used, that a higher price-based offer was used, and that the process for offer capping units that fail the TPS test does not consistently result in competitive market outcomes in the presence of market power.

- **Markup and Aggregate Market Power.** In 2024, pivotal suppliers in the aggregate market, committed in the day-ahead market and identified as one of three day-ahead aggregate pivotal suppliers, set real-time market prices with markups over \$100 per MWh on 88 days. Some of the marginal units had local market power, but were not offer capped due to issues with the method that PJM uses to select offer schedules for units that fail the TPS test. Some of the marginal units had aggregate market power, for which there is no offer capping, and some had both local and aggregate market power.

## Recommendations

### Market Power

- The MMU recommends that the market rules explicitly require that offers in the energy market be competitive, where competitive is defined to be the short run marginal cost of the units. The short run marginal cost should reflect opportunity cost when appropriate. The MMU recommends that the level of incremental costs includable in cost-based offers per the PJM Operating Agreement not exceed the short run marginal cost of the unit. (Priority: Medium. First reported 2009. Status: Not adopted.)

### Fuel Cost Policies

- The MMU recommends that PJM require that all fuel cost policies be algorithmic, verifiable, and systematic, and accurately reflect short run marginal costs. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends that the temporary cost method be removed and that all units that submit nonzero cost-based offers be required to have an approved fuel cost policy. (Priority: Low. First reported 2020. Status: Not adopted.)
- The MMU recommends that the penalty exemption provision be removed and that all units that submit nonzero cost-based offers be required to follow

their approved fuel cost policy. (Priority: Medium. First reported 2020. Status: Not adopted.)

### Cost-Based Offers

- The MMU recommends that Manual 15 (Cost Development Guidelines) be replaced or updated with a straightforward description of the components of cost-based offers and the mathematically correct calculation of cost-based offers for thermal resources. (Priority: Medium. First reported 2016. Status: Adopted 2023.)
- The MMU recommends removal of all use of FERC System of Accounts in the Cost Development Guidelines. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends the removal of all use of cyclic starting and peaking factors from the Cost Development Guidelines. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends the removal of all labor costs from the Cost Development Guidelines. (Priority: Medium. First reported 2016. Status: Adopted 2022.)
- The MMU recommends the removal of all maintenance costs from the Cost Development Guidelines. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that market participants be required to document the amount and cost of consumables used when operating in order to verify that the total operating cost is consistent with the total quantity used and the unit characteristics. (Priority: Medium. First reported 2020. Status: Adopted 2023.)
- The MMU recommends, given that maintenance costs are currently allowed in cost-based offers, that market participants be permitted to include only variable maintenance costs, linked to verifiable operational events and that can be supported by clear and unambiguous documentation of the operational data (e.g. run hours, MWh, MMBtu) that support the maintenance cycle of the equipment being serviced/replaced. (Priority: Medium. First reported 2020. Status: Partially adopted 2023.)
- The MMU recommends explicitly accounting for soak costs and changing the definition of the start heat input for combined cycles to include only the amount of fuel used from first fire to the first



breaker close in the Cost Development Guidelines. (Priority: Medium. First reported 2016. Status: Partially adopted.)

- The MMU recommends that soak costs, soak time and the MWh produced during soaking be modeled separately. This will ensure that the time required for units to reach a dispatchable level is known and used in the unit commitment process instead of only being communicated verbally between dispatchers and generators. Separating soak costs from start costs and modeling the MWh produced during soaking allows for a better representation of the costs because it eliminates the need to simply assume the price paid for those MWh. (Priority: Medium. First reported 2022. Status: Not adopted.)
- The MMU recommends the removal of nuclear fuel and nonfuel operations and maintenance costs that are not short run marginal costs from the Cost Development Guidelines. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends revising the pumped hydro fuel cost calculation to include day-ahead and real-time power purchases. (Priority: Low. First reported 2016. Status: Not adopted.)

### Market Power: TPS Test and Offer Capping

- The MMU recommends that the rules governing the application of the TPS test be clarified and documented. The TPS test application in the day-ahead energy market is not documented. (Priority: High. First reported 2015. Status: Partially adopted.)<sup>7</sup>
- The MMU recommends that PJM modify the process of applying the TPS test in the day-ahead energy market to ensure that all local markets created by binding constraints are tested for market power and to ensure that market sellers with market power are appropriately mitigated to their competitive offers. (Priority: High. First reported 2022. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation when the TPS test is failed, that offer capping be applied to units that fail the TPS test in the real-time market that were not offer capped at the time of commitment in the day-ahead market or at a prior time in the real-time market.

(Priority: High. First reported 2020. Status: Not adopted.)

- The MMU recommends, in order to ensure effective market power mitigation and to ensure that capacity resources meet their obligations to be flexible, that capacity resources be required to use flexible parameters in all offers at all times. (Priority: High. First reported 2021. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation, PJM always use cost-based offers for units that fail the TPS test, and always use flexible parameters for all cost-based and all price-based offers during high load conditions such as cold and hot weather alerts and emergency conditions. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM require every market participant to make available at least one cost schedule based on the same hourly fuel type(s) and parameters at least as flexible as their offered price schedule. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation when the TPS test is failed, that markup be consistently positive or negative across the full MWh range of price and cost-based offers. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends, in order to ensure effective market power mitigation, that PJM commit all resources that fail the TPS test on their cost-based offers, that the Market Seller designate the cost-based offer if there is more than one, and that PJM implement this solution as soon as possible. (Priority: High. First reported Q3 2024. Status: Not adopted.)
- The MMU recommends that PJM retain the \$1,000 per MWh offer cap in the PJM energy market except when cost-based offers exceed \$1,000 per MWh, and retain other existing rules that limit incentives to exercise market power. (Priority: High. First reported 1999. Status: Partially adopted, 1999, 2017.)
- The MMU recommends the elimination of FMU and AU adders. FMU and AU adders no longer serve the purpose for which they were created and interfere

<sup>7</sup> The real-time market formula for determining the lowest cost schedule is documented. The day-ahead market formula for determining the lowest cost schedule is not documented.

with the efficient operation of PJM markets. (Priority: Medium. First reported 2012. Status: Partially adopted, 2014.)<sup>8</sup>

## Offer Behavior

- The MMU recommends that resources not be allowed to violate the ICAP must offer requirement. The MMU recommends that PJM enforce the ICAP must offer requirement by assigning a forced outage to any unit that is derated in the energy market below its committed ICAP without an outage that reflects the derate. (Priority: Medium. First reported 2020. Status: Not adopted.)
- The MMU recommends that intermittent resources be subject to an enforceable ICAP must offer rule in the day-ahead and real-time energy markets that reflects the limitations of these resources. (Priority: Medium. First reported 2020. Status: Adopted 2023.)
- The MMU recommends that storage resources be subject to an enforceable ICAP must offer rule in the day-ahead and real-time energy markets that reflects the limitations of these resources. (Priority: Medium. First reported 2020. Status: Not adopted.)
- The MMU recommends that capacity resources not be allowed to offer any portion of their capacity market obligation as maximum emergency energy. (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM integrate all the outage reporting tools in order to enforce the ICAP must offer requirement, ensure that outages are reported correctly and eliminate reporting inconsistencies. Generators currently submit availability in three different tools that are not integrated, Markets Gateway, eDART and eGADS. (Priority: Medium. First reported 2022. Status: Not adopted.)
- The MMU recommends that gas generators be required to check with pipelines throughout the operating day to confirm that nominations are accepted beyond the NAESB deadlines, that gas generators be required to inform PJM about whether they have gas, and that gas generators be required to place their units on forced outage until the time that pipelines allow nominations to consume gas

at a unit. (Priority: Medium. First reported 2022. Status: Not adopted.)

## Capacity Resources

- The MMU recommends that capacity resources be held to the OEM operating parameters of the capacity market CONE reference resource for performance assessment and energy uplift payments and that this standard be applied to all technologies on a uniform basis. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that the parameters which determine nonperformance charges and the amounts of uplift payments should reflect the flexibility goals of the capacity market design. The operational parameters used by generation owners to indicate to PJM operators what a unit is capable of during the operating day should not determine capacity resource performance assessment or uplift payments. (Priority: Medium. First reported 2015. Status: Partially adopted.)<sup>9</sup>
- The MMU recommends that PJM clearly define the business rules that apply to the unit specific parameter adjustment process, including PJM's implementation of the tariff rules in the PJM manuals to ensure market sellers know the requirements for their resources. (Priority: Low. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM update the tariff to clarify that all generation resources are subject to unit specific parameter limits on their cost-based offers using the same standard and process as capacity resources. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that resources not be paid the daily capacity payment when unable to operate to their unit specific parameter limits. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM not approve temporary exceptions that are based on pipeline tariff terms that are not enforced at the time, or are based on inferior transportation service procured by the generator. (Priority: Medium. First reported 2019. Status: Not adopted.)

<sup>8</sup> The applicability of the FMU and AU adders is limited by the rule implemented in 2014 requiring that net revenues must fall below avoidable costs, but the possibility of FMU and AU adders is still part of the PJM Market Rules.

<sup>9</sup> Flexible parameter standards are in place for combined cycle and combustion turbine resources when operating on a parameter limited schedule, but not for other schedules or generating technologies.

- The MMU recommends that PJM require generators that violate their approved turn down ratio (by either using the fixed gen option or increasing their economic minimum) to use the temporary parameter exception process that requires market sellers to demonstrate that the request is based on a physical and actual constraint. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends: that gas generators be required to confirm, regularly during the operating day, that they can obtain gas if requested to operate at their economic maximum level; that gas generators provide that information to PJM during the operating day; and that gas generators be required to be on forced outage if they cannot obtain gas during the operating day to meet their must offer requirement as a result of pipeline restrictions, and they do not have backup fuel. As part of this, the MMU recommends that PJM collect data on each individual generator's fuel supply arrangements at least annually or when such arrangements change, and analyze the associated locational and regional risks to reliability. (Priority: Medium. First reported 2022. Status: Not adopted.)
- The MMU recommends, if the capacity market seller offer cap were to be calculated using the historical average balancing ratio, that PJM not include the balancing ratios calculated for localized Performance Assessment Intervals (PAIs), and only include those events that trigger emergencies at a defined zonal or higher level. (Priority: Medium. First reported 2018. Status: Adopted, 2023.<sup>10</sup>)
- LMP. (Priority: Medium. First reported 2015. Status: Partially adopted 2020.)<sup>11</sup>
- The MMU recommends that PJM routinely review all transmission facility ratings and any changes to those ratings to ensure that the normal, emergency and load dump ratings used in modeling the transmission system are accurate and reflect standard ratings practice. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM not use closed loop interface or surrogate constraints to artificially override nodal prices based on fundamental LMP logic in order to: accommodate rather than resolve the inadequacies of the demand side resource capacity product; address the inability of the power flow model to incorporate the need for reactive power; accommodate rather than resolve the flaws in PJM's approach to scarcity pricing; or for any other reason. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM update the outage impact studies, the reliability analyses used in RPM for capacity deliverability, and the reliability analyses used in RTEP for transmission upgrades to be consistent with the more conservative emergency operations (post contingency load dump limit exceedance analysis) in the energy market that were implemented in June 2013.<sup>12</sup> (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM include in the tariff or appropriate manual an explanation of the initial creation of hubs, the process for modifying hub definitions and a description of how hub definitions have changed.<sup>13 14</sup> (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that all buses with a net withdrawal be treated as load for purposes of calculating load and load-weighted LMP, even if the MW are settled to the generator. The MMU recommends that during hours when a load bus

### Accurate System Modeling

- The MMU recommends that PJM explicitly state its policy on the use of transmission penalty factors including: the level of the penalty factors; the triggers for the use of the penalty factors; the appropriate line ratings to trigger the use of penalty factors; the allowed duration of the violation and when the transmission penalty factors will be used to set the shadow price. The MMU recommends that PJM end the practice of manual and automated discretionary reductions in the control limits on transmission constraint line ratings used in the market clearing software (SCED) and included in

<sup>10</sup> See 184 FERC ¶ 61,058 (2023).

<sup>11</sup> PJM created a more transparent process for transmission constraint penalty factors and added it to the tariff in 2020. Policies on reductions in control limits and the duration of violations remain discretionary and undocumented in the PJM Market Rules.

<sup>12</sup> This recommendation was the result of load shed events in September, 2013. For detailed discussion, please see *2013 Annual State of the Market Report for PJM*, Volume 2, Section 3 at 114 – 116.

<sup>13</sup> According to minutes from the first meeting of the Energy Market Committee (EMC) on January 28, 1998, the EMC unanimously agreed to be responsible for approving additions, deletions and changes to the hub definitions to be published and modeled by PJM. Since the EMC has become the Market Implementation Committee (MIC), the MIC now appears to be responsible for such changes.

<sup>14</sup> There is currently no PJM documentation in the tariff or manuals explaining how hubs are created and how their definitions are changed. The general definition of a hub can be found in the PJM. com Glossary <<http://www.pjm.com/Glossary.aspx>>.

shows a net injection, the energy injection be treated as generation, not negative load, for purposes of calculating generation and load-weighted LMP, even if the injection MW are settled to the load serving entity. (Priority: Low. First reported 2013. Status: Not adopted.)

- The MMU recommends that PJM identify and collect data on available behind the meter generation resources, including nodal location information and relevant operating parameters. (Priority: Low. First reported 2013. Status: Partially adopted.)
- The MMU recommends that PJM document how LMPs are calculated when demand response is marginal. (Priority: Low. First reported 2014. Status: Not adopted.)
- The MMU recommends that PJM not allow nuclear generators which do not respond to prices or which only respond to manual instructions from the operator to set the LMPs in the real-time market. (Priority: Low. First reported 2016. Status: Not adopted.)
- The MMU recommends that PJM increase the coordination of outage and operational restrictions data submitted by market participants via eDART/eGADs and offer data submitted via Markets Gateway. (Priority: Low. First reported 2017. Status: Not adopted.)
- The MMU recommends that PJM model generators' operating transitions, including soak time for units with a steam turbine, configuration transitions for combined cycles, and peak operating modes. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that PJM clarify, modify and document its process for dispatching reserves and energy when SCED indicates that supply is less than total demand including forecasted load and reserve requirements. The modifications should define: a SCED process to economically convert reserves to energy; a process for the recall of energy from capacity resources; and the minimum level of synchronized reserves that would trigger load shedding. (Priority: Medium. First reported 2020. Status: Not adopted.)
- The MMU recommends that PJM stop capping the system marginal price in RT SCED and LPC and

instead limit the sum of violated reserve constraint shadow prices that are included in the determination of LMP in LPC to \$1,700 per MWh. While PJM no longer caps prices in RT SCED, PJM continues to apply a cap to the system marginal price in the pricing run (LPC) under fast start pricing. (Priority: Medium. First reported 2021. Status: Not adopted.)

- The MMU recommends that PJM adjust the ORDCs during spin events to reduce the reserve requirement for synchronized and primary reserves by the amount of the reserves deployed. (Priority: Medium. First reported 2021. Status: Not adopted.)

## Transparency

- The MMU recommends that PJM clearly document the calculation of shortage prices and implementation of reserve price caps in the PJM manuals, including defining all the components of reserve prices, and all the constraints whose shadow prices are included in reserve prices. (Priority: High. First reported 2021. Status: Not adopted.)
- The MMU recommends that PJM allow generators to report fuel type on an hourly basis in their offer schedules and to designate schedule availability on an hourly basis. (Priority: Medium. First reported 2015. Status: Partially adopted.)<sup>15</sup>
- The MMU recommends that PJM define clear criteria for operator approval of RT SCED cases, including shortage cases, that are used to send dispatch signals to resources, and for pricing, to minimize discretion. (Priority: High. First reported 2018. Status: Partially adopted.)<sup>16</sup>

## Virtual Bids and Offers

- The MMU recommends eliminating up to congestion (UTC) bidding at pricing nodes that aggregate only small sections of transmission zones with few physical assets. (Priority: Medium. First reported 2020. Status: Not adopted.)
- The MMU recommends eliminating INC, DEC, and UTC bidding at pricing nodes that allow market participants to profit from modeling issues. (Priority: Medium. First reported 2020. Status: Not adopted.)

<sup>15</sup> Fuel type is reported by offer schedule, but it can be inaccurate on an hourly basis.

<sup>16</sup> The PJM Market Rules clarify that shortage case approval will be based on RT SCED, but does not address RT SCED case choice or load bias.



## Conclusion

The MMU analyzed key elements of PJM energy market structure, participant conduct and market performance in 2024, including aggregate supply and demand, concentration ratios, aggregate pivotal supplier results, local three pivotal supplier test results, offer capping, markup, marginal units, participation in demand response programs, virtual bids and offers, loads and prices.

Prices are a key outcome of markets. Prices vary across hours, days and years for multiple reasons. Price is an indicator of the level of competition in a market. In a competitive market, prices are directly related to input prices, the marginal cost to serve load. In 2024, LMP increased by \$2.66 per MWh compared to 2023. The fuel cost components of LMP (the sum of gas, coal, oil, landfill gas, and consumables) increased \$0.50 per MWh, 18.9 percent of the increase in LMP. The emissions cost components of LMP, including opportunity costs for emissions limited resources, decreased by \$0.05 per MWh, -1.9 percent of the increase in LMP. The transmission constraint penalty factor component increased by \$1.39 per MWh, 52.4 percent of the increase in LMP, primarily as a result of PJM actions to reduce the line limits applied in SCED.

The pattern of prices within days and across months and years illustrates how prices are directly related to supply and demand conditions and illustrates the potential significance of the impact of the price elasticity of demand on prices. Energy market results in 2024 generally reflected supply-demand fundamentals, although the behavior of some participants both routinely and during high demand periods represents economic withholding. Economic withholding occurs when generator offers are greater than competitive levels. In 2024, the sum of the markup, ten percent adder, and maintenance cost (not short run marginal cost) components increased by \$0.16 per MWh or 6.2 percent of the increase in LMP.

The potential for prolonged and excessively high administrative pricing in the energy market due to reserve penalty factors and transmission constraint penalty factors remains an issue that needs to be addressed.<sup>17</sup> There also continue to be significant issues with PJM's scarcity pricing rules, including the absence of a clear trigger based on accurately estimated reserve levels. For example, PJM approved 2.5 percent of solved shortage

cases in January 2024, but only 0.6 percent for the year. Six other months had a higher percent of shortage cases solved, but fewer approved. The pattern of shortage case approvals indicates that PJM considers factors that are not documented in the tariff when deciding whether to approve shortage cases. As directed by FERC Order 825, PJM should approve shortage cases based on the market software results alone.<sup>18</sup>

With or without a capacity market, energy market design must permit scarcity pricing when such pricing is consistent with market conditions and constrained by reasonable rules to ensure that market power is not exercised and to ensure no scarcity pricing when such pricing is not consistent with market conditions. Scarcity pricing for revenue adequacy, as in PJM's 2019 ORDC proposal that would have created administrative scarcity pricing, is not consistent with a competitive market design. Scarcity pricing for price signals that reflect market conditions during periods of scarcity is consistent with a competitive market design. Scarcity pricing is part of an appropriate incentive structure facing both load and generation owners in a working wholesale electric power market design. Scarcity pricing must be designed to ensure that market prices reflect actual market conditions, that scarcity pricing occurs with transparent triggers based on measured reserve levels and transparent prices, that scarcity pricing only occurs when scarcity exists, that scarcity pricing not be excessive or punitive, and that there are strong incentives for competitive behavior and strong disincentives to exercise market power. Such administrative scarcity pricing is a key link between energy and capacity markets.

PJM defined inputs to the dispatch tools, particularly RT SCED, have substantial effects on energy market outcomes. Transmission line ratings, transmission penalty factors, load forecast bias, and hydro resource schedules change the dispatch of the system, affect prices, and can create significant price increases, particularly through transmission constraint penalty factors. PJM operator interventions to reduce the control limits on transmission constraint line ratings in RT SCED unnecessarily trigger transmission constraint penalty factors and significantly increase prices. Violations of the artificially reduced control limits on constraint line ratings were the largest single component of the increase in LMP in 2024. In 2024, the control limit used

<sup>17</sup> 177 FERC ¶ 61,209 (2021).

<sup>18</sup> 155 FERC ¶ 61,276 (2016).



in RT SCED for 94 percent of violated transmission constraint intervals was less than 100 percent, with an average reduction of 5.1 percent. If the control limits had not been artificially reduced for PJM transmission constraints and everything else remained unchanged, the transmission penalty factor's contribution to the load-weighted average LMP in 2024 would have decreased by 99.4 percent from \$3.01 to \$0.02 per MWh. PJM should evaluate its interventions in the market, including the unnecessary imposition of transmission constraint penalty factors, reconsider whether the interventions are appropriate, and provide greater transparency to enhance market efficiency.

Fast start pricing, implemented on September 1, 2021, has disconnected pricing from dispatch instructions and despite the stated goal of reducing overall uplift, created a greater reliance on uplift rather than price as an incentive to follow PJM's instructions. The objective of efficient short run price signals is to minimize system production costs, not to minimize uplift. Repricing the market to reflect commitment costs using fast start pricing prioritizes minimizing uplift over minimizing production costs.<sup>19</sup> The tradeoff exists because when commitment costs are included in prices, the price signal no longer equals the short run marginal cost and therefore no longer provides the correct signal for efficient behavior for market participants making decisions on the margin, whether resources, load, interchange transactions, or virtual traders. Units that start in one hour are not actually fast start units, and their commitment costs are not marginal in a five minute market. The differences between the actual LMP and the fast start LMP distort the incentive for market participants to behave competitively and to follow PJM's dispatch instructions. PJM is paying new forms of uplift in an attempt to counter the distorted incentives inherent in fast start pricing. PJM is also using the pricing run to implement administrative pricing rules that are not related to fast start pricing. Specifically, PJM uses lower transmission constraint penalty factors in the day-ahead pricing run than in the dispatch run and implements system marginal price capping in the pricing run. Every difference between the dispatch run and the pricing run introduces another inefficiency in the market. In the three years since fast start pricing was introduced, the market has not responded with new

entry of fast start units despite consistently higher LMPs when a fast start unit sets price.

PJM's arguments for changing energy market price formation asserted that fast start pricing and PJM's rejected extended ORDC would price flexibility in the market, but instead they benefit inflexible units. The fast start pricing and extended ORDC solutions undercut LMP logic rather than directly addressing the underlying issues. The solution is not to accept that the inflexible CT should be paid or set price based on its commitment costs rather than its short run marginal costs. The question of why units make inflexible offers should be addressed directly. Are units inflexible because they are old and inefficient, because owners have not invested in increased flexibility or because they serve as a mechanism for the exercise of market power? Are units inflexible because the PJM software does not model combined cycle transitions? The question of how to provide market incentives for investment in flexible units, for investment in increased flexibility of existing units, and for operating at the full extent of existing flexibility should be addressed directly. The question of whether inflexible units should be paid uplift at all should be addressed directly. Marginal cost pricing without paying excess uplift to inflexible units would create incentives for market participants to provide flexible solutions including replacing inefficient units with flexible, efficient units.

The relationship between supply and demand, regardless of the specific market, along with market concentration and the extent of pivotal suppliers, is referred to as the supply-demand fundamentals, or economic fundamentals, or market structure. The market structure of the PJM aggregate energy market is partially competitive because aggregate market power does exist for a significant number of hours. The HHI is not a definitive measure of structural market power. The number of pivotal suppliers in the energy market is a more precise measure of structural market power than the HHI. It is possible to have pivotal suppliers in the aggregate market even when the HHI level is not in the highly concentrated range. Even a low HHI may be consistent with the exercise of market power with a low price elasticity of demand. The current market power mitigation rules for the PJM energy market rely on the assumption that the ownership structure of the aggregate market ensures competitive outcomes. This assumption

<sup>19</sup> See 173 FERC ¶ 61,244 (2020).

requires that the total demand for energy can be met without the supply from any individual supplier or without the supply from a small group of suppliers. This assumption is not correct. There are pivotal suppliers in the aggregate energy market at times. High markups for some units demonstrate the potential to exercise market power both routinely and during high demand conditions. The existing market power mitigation measures do not address aggregate market power. The MMU is developing an aggregate market power test and will propose market power mitigation rules to address aggregate market power.

The three pivotal supplier test is applied by PJM on an ongoing basis for local energy markets in order to determine whether offer capping is required for transmission constraints.<sup>20</sup> However, there are issues with the application of market power mitigation in the day-ahead energy market and the real-time energy market when market sellers fail the TPS test. The Commission recognized some of these issues in its order issued on June 17, 2021, but failed to address them in its November 30, 2023 order.<sup>21 22</sup> PJM continued to ignore the evidence cited by the Commission and denies the prevalence of these issues, instead of ensuring that market power mitigation works as intended and results in efficient market outcomes.<sup>23</sup> Many of these issues can be resolved by simple rule changes. The MMU proposed these rule changes in its response submitted on October 15, 2021, and in the stakeholder process.<sup>24 25</sup> The MMU recommendations would shorten the solution time of the day-ahead market software, which would help facilitate enhanced combined cycle modelling. The proposal that PJM filed with FERC on March 1, 2024, would have weakened market power mitigation

as part of implementing the enhanced combined cycle modelling project, although PJM failed to explain why such weakening makes sense. PJM's proposal would have ensured that the identified issues with the implementation of market power mitigation in the energy market would never have been addressed and would have been exacerbated. On April 30, 2024, FERC rejected PJM's proposal because "PJM's proposal would create the ability for Market Sellers to exercise market power, which the Commission has found unjust and unreasonable."<sup>26</sup> PJM filed and, on October 25, 2024, FERC accepted a revised proposal that would require that sellers that fail the TPS test will be offer capped at their cost-based offers and that operating parameters will be mitigated. That order has no current effect because FERC approved the PJM filing that linked, for no logical reason, implementing the improved rules to PJM's adoption of an improved combined cycle model with no defined date. The flawed rules remain in place. PJM's proposal also uses the flawed formula rejected by FERC to select among cost-based offers. This will result in the illogical selection of cost-based offers in some circumstances, particularly if a dual fuel unit submits offers for both oil and gas on a day when the economics change between the two fuels midday. PJM should modify its implementation to address that issue. The result would allow market sellers to select the correct cost-based fuel schedule. There is no reason to delay implementation until PJM addresses combined cycle modelling. The changes would decrease the solution time for the day-ahead market and enhance market efficiency. The new approach, modified to correct the cost offer selection issue, should be implemented as soon as possible to help ensure effective market power mitigation.

The enforcement of market power mitigation rules is undermined if the definition of a competitive offer is not correct. A competitive offer is equal to short run marginal costs. The significance of competition metrics like markup is also undermined if the definition of a competitive offer is not correct. The definition of a competitive offer, under the PJM Market Rules, is not currently correct. The definition, that all costs that are related to electric production are short run marginal costs, is not clear or correct. All costs and investments for power generation are related to electric production. Under this definition, some unit owners include costs in

20 The MMU reviews PJM's application of the TPS test and brings issues to the attention of PJM.

21 See 175 FERC ¶ 61,231 (2021).

22 185 FERC ¶ 61,158 (2023).

23 See Answer of PJM Interconnection LLC., Docket No. EL21-78-000 (September 15, 2021).

24 See "Comments of the Independent Market Monitor for PJM," Docket No. EL21-78 (October 15, 2021).

25 See "Schedule Selection Proposal," MMU presentation to the Markets and Reliability Committee (October 25, 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MRC\\_Schedule\\_Selection\\_20231025.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MRC_Schedule_Selection_20231025.pdf)>; "Schedule Selection: IMM Package," MMU Presentation to the Market Implementation Committee (September 6, 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MIC\\_Schedule\\_Selection\\_IMM\\_Package\\_20230906.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MIC_Schedule_Selection_IMM_Package_20230906.pdf)>; "Schedule Selection: IMM Proposal," MMU Presentation to the Market Implementation Committee (August 9, 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MIC\\_Schedule\\_Selection\\_IMM\\_Proposal\\_20230809.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MIC_Schedule_Selection_IMM_Proposal_20230809.pdf)>; "Least Cost Schedule Analysis," MMU Presentation at the MIC Special Session (July 17, 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MIC\\_Special\\_Session\\_Least\\_Cost\\_Schedule\\_Analysis\\_20230717.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MIC_Special_Session_Least_Cost_Schedule_Analysis_20230717.pdf)>; "Multischedule Model and Mitigation: IMM Package," MMU Presentation to the MIC Special Session (May 24, 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MIC\\_Multischedule\\_Model\\_and\\_Mitigation\\_IMM\\_Package\\_20230524.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MIC_Multischedule_Model_and_Mitigation_IMM_Package_20230524.pdf)>; "Education: Schedule Selection and Market Power Mitigation," MMU Presentation to the MIC Special Session (March 29, 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MIC\\_Special\\_Session\\_Education\\_Schedule\\_%20Selection\\_and\\_Market\\_Power\\_Mitigation\\_20230330.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MIC_Special_Session_Education_Schedule_%20Selection_and_Market_Power_Mitigation_20230330.pdf)>; "Offer Schedule Selection," MMU Presentation to the Market Implementation Committee (February 8 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MIC\\_Offer\\_Schedule\\_Selection\\_20230208.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MIC_Offer_Schedule_Selection_20230208.pdf)>.

26 187 FERC 61,051 at P 25 (2024).

cost-based energy offers that are not short run marginal costs in offers, especially maintenance costs. This issue can be resolved by simple rule changes to incorporate a clear and accurate definition of short run marginal costs. This rule also had unintended consequences for market seller offer caps in the capacity market. Maintenance costs includable in energy offers cannot be included in capacity market offer caps based on avoidable costs. As a result, capacity market offer caps based on net avoidable costs were lower than they would have been if maintenance costs had been correctly included in avoidable costs rather than incorrectly defined to be part of short marginal costs of producing energy and includable in energy offers.

A competitive power market will result in higher prices when fuel costs increase and lower prices when fuel costs decrease. A competitive market will not result in higher prices when markups increase based on market power, or when PJM selects a price-based offer including a markup rather than a cost-based offer in the presence of local market power, or when PJM artificially triggers transmission constraint penalty factors. The overall energy market results support the conclusion that energy prices in PJM are set, generally, by marginal units operating at, or close to, their marginal costs, although this was not always the case in 2024 or prior years. Given the structure of the energy market which can permit the exercise of aggregate and local market power, some participants' offer behavior is a source of concern in the energy market and provides a reason to use correctly defined short run marginal cost as the sole basis for cost-based offers and a reason for implementing an aggregate market power test and correcting the offer capping process for resources with local market power. The MMU concludes that the PJM energy market results were competitive in 2024.

## Supply and Demand Market Structure

### Supply


Supply includes physical generation, imports and virtual transactions.

In 2024, 3,206 MW of new resources were added in the energy market, and 527 MW of resources were retired.

Figure 3-1 shows real-time and day-ahead hourly supply curves for 2023 and 2024.<sup>27</sup> The real-time supply curve includes hourly on peak average offers. The real-time supply curve only includes available MW from units that are online or have a notification plus start time that is no more than one hour. The day-ahead supply curve shows all available hourly on peak average offers.

The real-time hourly on peak average offered supply for 2024 increased 2.8 percent from 2023, from 137,865 MWh to 141,742 MWh. The day-ahead hourly average offered supply for 2024 decreased 0.2 percent from 2023, from 149,346 MWh to 149,120 MWh.

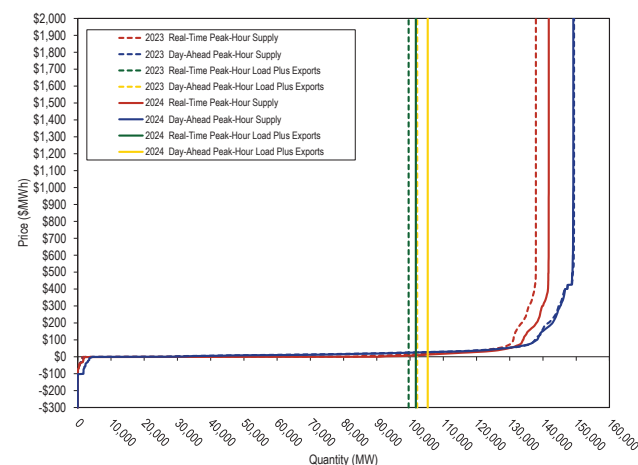**Figure 3-1 Real-time and day-ahead hourly supply curves: 2023 and 2024**



<sup>27</sup> Real-time supply includes real-time generation offers and import MWh.

Figure 3-2 shows the typical dispatch range.

Figure 3-2 Typical dispatch range of supply curves

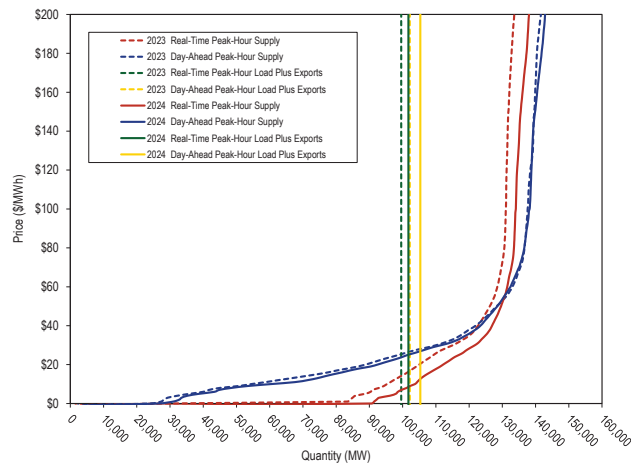


Table 3-2 shows the price elasticity of the real-time supply curve for the peak hours for 2023 and 2024 by load level.

The supply curve in 2024 was most elastic in the 95 to 115 GW range at 0.087, which was less elastic than the supply curve in the 95 to 115 GW range in 2023, with an elasticity of 0.129.

The price elasticity of the supply curve measures the responsiveness of the quantity supplied (GW) to a change in price:

$$\text{Elasticity of Supply} = \frac{\text{Percent change in quantity supplied}}{\text{Percent change in price}}$$

The supply curve is defined to be elastic when elasticity is greater than 1.0. The quantity supplied is more sensitive to changes in price the higher the elasticity. Although the aggregate supply curve may appear flat as a result of the wide range in prices and quantities, the calculated elasticity is inelastic throughout.

Table 3-2 Price elasticity of the supply curve

	GW				
	Min - 75	75 - 95	95 - 115	115 - 135	135 - Max
2020	0.015	0.174	0.327	0.021	0.001
2021	-	0.015	0.258	0.030	0.004
2022	-	0.008	0.172	0.043	0.010
2023	-	0.015	0.129	0.005	-
2024	-	0.015	0.087	0.016	0.002

## Real-Time Supply

The real-time hourly average cleared generation in 2024 increased by 2.5 percent from 2023, from 92,457 MWh to 94,814 MWh.<sup>28</sup>

The real-time hourly average cleared supply including imports in 2024 increased by 2.6 percent from 2023, from 94,165 MWh to 96,605 MWh.


In the PJM Real-Time Energy Market, there are three types of supply offers:

- **Self Scheduled Generation Offer.** Offer to supply a fixed block of MW, as a price taker, from a unit that may also have a dispatchable component above the fixed MW.
- **Dispatchable Generation Offer.** Offer to supply a schedule of MW and corresponding offer prices from a specific unit.
- **Import.** An import is an external energy transaction scheduled to PJM from another balancing authority. A real-time import must have a valid OASIS reservation when offered, must have available ramp room to support the import, must be accompanied by a NERC Tag, and must pass the neighboring balancing authority checkout process.

## PJM Real-Time Supply Frequency

Figure 3-3 shows the hourly distribution of the real-time generation plus imports for 2023 and 2024.

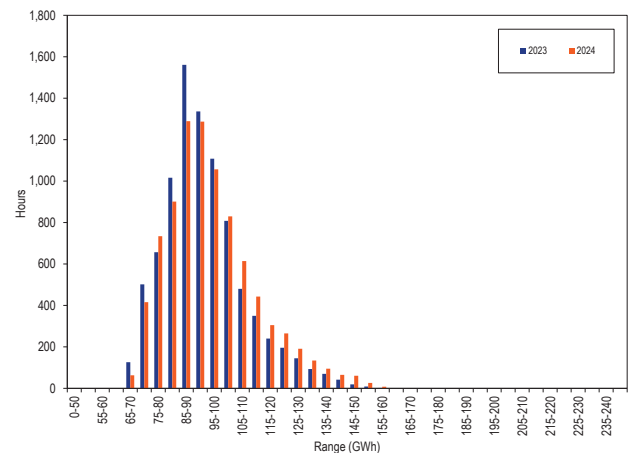Figure 3-3 Distribution of real-time generation plus imports: 2023 and 2024<sup>29</sup>



28 Generation data are the net MWh injections and withdrawals MWh at every generation bus in PJM.

29 Each range on the horizontal axis excludes the start value and includes the end value.

### PJM Real-Time Average Cleared Supply

Table 3-3 shows the real-time hourly average cleared supply and its standard deviation for 2001 through 2024.

The real-time hourly average cleared generation in 2024 increased by 2.5 percent from 2023, from 92,457 MWh to 94,814 MWh. It was the highest annual real-time hourly average cleared generation since the start of PJM markets.


**Table 3-3 Real-time hourly average generation and generation plus imports: 2001 through 2024**

PJM Real-Time Supply (MWh)					Year-to-Year Change			
Generation		Generation Plus Imports			Generation		Generation Plus Imports	
Generation	Standard Deviation	Supply	Standard Deviation		Generation	Standard Deviation	Supply	Standard Deviation
2001	29,553	4,937	32,552	5,285	NA	NA	NA	NA
2002	34,928	7,535	38,535	7,751	18.2%	52.6%	18.4%	46.7%
2003	36,628	6,165	40,205	6,162	4.9%	(18.2%)	4.3%	(20.5%)
2004	51,068	13,790	55,781	14,652	39.4%	123.7%	38.7%	137.8%
2005	81,127	15,452	86,353	15,981	58.9%	12.0%	54.8%	9.1%
2006	82,780	13,709	86,978	14,402	2.0%	(11.3%)	0.7%	(9.9%)
2007	85,860	14,018	90,351	14,763	3.7%	2.3%	3.9%	2.5%
2008	83,476	13,787	88,899	14,256	(2.8%)	(1.7%)	(1.6%)	(3.4%)
2009	78,026	13,647	83,058	14,140	(6.5%)	(1.0%)	(6.6%)	(0.8%)
2010	82,585	15,556	87,386	16,227	5.8%	14.0%	5.2%	14.8%
2011	85,775	15,932	90,511	16,759	3.9%	2.4%	3.6%	3.3%
2012	88,708	15,701	94,083	16,505	3.4%	(1.4%)	3.9%	(1.5%)
2013	89,769	15,012	94,833	15,878	1.2%	(4.4%)	0.8%	(3.8%)
2014	90,894	15,151	96,295	16,199	1.3%	0.9%	1.5%	2.0%
2015	88,628	16,118	94,330	17,313	(2.5%)	6.4%	(2.0%)	6.9%
2016	91,304	17,731	95,054	17,980	3.0%	10.0%	0.8%	3.9%
2017	90,945	15,194	92,721	15,493	(0.4%)	(14.3%)	(2.5%)	(13.8%)
2018	94,236	16,326	96,109	16,595	3.6%	7.5%	3.7%	7.1%
2019	93,434	16,357	94,618	16,515	(0.9%)	0.2%	(1.6%)	(0.5%)
2020	90,938	16,527	91,674	16,627	(2.7%)	1.0%	(3.1%)	0.7%
2021	93,644	16,786	94,501	16,884	3.0%	1.6%	3.1%	1.5%
2022	94,368	16,258	96,147	16,487	0.8%	(3.1%)	1.7%	(2.4%)
2023	92,457	14,683	94,165	14,668	(2.0%)	(9.7%)	(2.1%)	(11.0%)
2024	94,814	15,971	96,605	16,186	2.5%	8.8%	2.6%	10.3%

### PJM Real-Time Monthly Average Generation

Figure 3-4 compares the real-time monthly average generation in 2023 and 2024 with the historic five-year range. The real-time monthly average generation in April, May, June and December 2024 was higher than the maximum monthly average generation for the past five years.

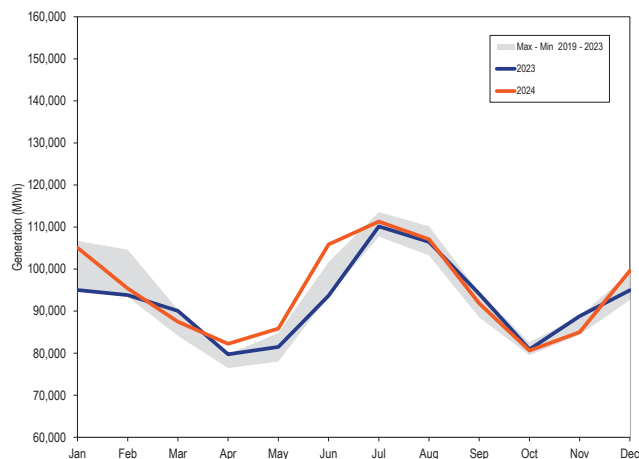**Figure 3-4 Real-time monthly average generation: 2023 through 2024**





### Day-Ahead Cleared Supply

The day-ahead hourly average cleared supply in 2024, including INCs and UTCs, decreased by 5.3 percent from 2023 from 116,042 MWh to 109,932 MWh.

The day-ahead hourly average cleared supply in 2024, including INCs, UTCs and imports, decreased by 5.3 percent from 2023, from 116,411 MWh to 110,289 MWh.


In the PJM Day-Ahead Energy Market, there are five types of financially binding supply offers:

- **Self Scheduled Generation Offer.** Offer to supply a fixed block of MW, as a price taker, from a unit that may also have a dispatchable component above the minimum.
- **Dispatchable Generation Offer.** Offer to supply a schedule of MW and corresponding offer prices from a unit.
- **Increment Offer (INC).** Financial offer to supply MW and corresponding offer prices. INCs can be submitted by any market participant.
- **Up to Congestion Transaction (UTC).** Conditional transaction that permits a market participant to specify a maximum price spread for a specific amount of MW between the transaction source and sink. An up to congestion transaction is a matched pair of an injection and a withdrawal.
- **Import.** An import is an external energy transaction for a specific MW amount scheduled to PJM from another balancing authority. An import must have a valid willing to pay congestion (WPC) OASIS reservation when offered. An import energy transaction that clears the day-ahead energy market is financially binding. There is no link between transactions submitted in the PJM Day-Ahead Energy Market and the PJM Real-Time Energy Market, so an import energy transaction approved in the day-ahead energy market will not physically flow in real time unless it is also submitted through the real-time energy market scheduling process.

### PJM Day-Ahead Supply Duration

Figure 3-5 shows the distribution of the day-ahead hourly cleared supply, including increment offers, up to congestion transactions, and imports for 2023 and 2024.

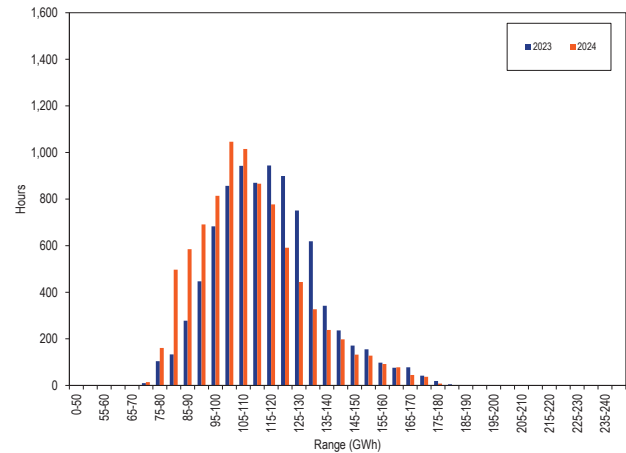**Figure 3-5 Distribution of day-ahead cleared supply plus imports: 2023 and 2024<sup>30</sup>**



<sup>30</sup> Each range on the horizontal axis excludes the start value and includes the end value.

## PJM Day-Ahead Average Supply

Table 3-4 presents day-ahead hourly cleared supply summary statistics for each year for 2001 through 2024.

The day-ahead hourly average cleared supply in 2024, including INCs and UTCs, decreased by 5.3 percent from 2023 from 116,042 MWh to 109,932 MWh. The decrease was primarily a result of decreased UTC volumes.


**Table 3-4 Day-ahead hourly average cleared supply and cleared supply plus imports: 2001 through 2024**

	PJM Day-Ahead Supply (MWh)				Year-to-Year Change			
	Supply		Supply Plus Imports		Supply		Supply Plus Imports	
	Standard Supply	Standard Deviation	Standard Supply	Standard Deviation	Standard Supply	Standard Deviation	Standard Supply	Standard Deviation
2001	26,762	4,595	27,497	4,664	NA	NA	NA	NA
2002	31,434	10,007	31,982	10,015	17.5%	117.8%	16.3%	114.7%
2003	40,642	8,292	41,183	8,287	29.3%	(17.1%)	28.8%	(17.3%)
2004	62,755	17,141	63,654	17,362	54.4%	106.7%	54.6%	109.5%
2005	94,438	17,204	96,449	17,462	50.5%	0.4%	51.5%	0.6%
2006	100,056	16,543	102,164	16,559	5.9%	(3.8%)	5.9%	(5.2%)
2007	108,707	16,549	111,023	16,729	8.6%	0.0%	8.7%	1.0%
2008	105,485	15,994	107,885	16,136	(3.0%)	(3.4%)	(2.8%)	(3.5%)
2009	97,388	16,364	100,022	16,397	(7.7%)	2.3%	(7.3%)	1.6%
2010	107,307	21,655	110,026	21,837	10.2%	32.3%	10.0%	33.2%
2011	117,130	20,977	119,501	21,259	9.2%	(3.1%)	8.6%	(2.6%)
2012	134,479	17,905	136,903	18,080	14.8%	(14.6%)	14.6%	(15.0%)
2013	148,323	18,783	150,595	18,978	10.3%	4.9%	10.0%	5.0%
2014	146,672	33,145	148,906	33,346	(1.1%)	76.5%	(1.1%)	75.7%
2015	114,890	19,165	117,147	19,406	(21.7%)	(42.2%)	(21.3%)	(41.8%)
2016	131,618	22,329	133,246	22,368	14.6%	16.5%	13.7%	15.3%
2017	130,603	20,035	131,142	20,153	(0.8%)	(10.3%)	(1.6%)	(9.9%)
2018	114,556	20,239	114,967	20,224	(12.3%)	1.0%	(12.3%)	0.4%
2019	117,250	18,909	117,622	18,881	2.4%	(6.6%)	2.3%	(6.6%)
2020	111,470	19,749	111,636	19,729	(4.9%)	4.4%	(5.1%)	4.5%
2021	102,431	18,823	102,599	18,850	(8.1%)	(4.7%)	(8.1%)	(4.5%)
2022	111,044	18,810	111,353	18,901	8.4%	(0.1%)	8.5%	0.3%
2023	116,015	18,561	116,384	18,574	4.5%	(1.3%)	4.5%	(1.7%)
2024	109,932	19,167	110,289	19,209	(5.2%)	3.3%	(5.2%)	3.4%

## PJM Day-Ahead Monthly Average Cleared Supply

Figure 3-6 compares the day-ahead monthly average cleared supply including increment offers and up to congestion transactions in 2023 and 2024 with the historic five-year range. The monthly average day-ahead cleared supply from February of 2024 was lower than the minimum of the past five years, primarily as a result of decreased UTC volumes.

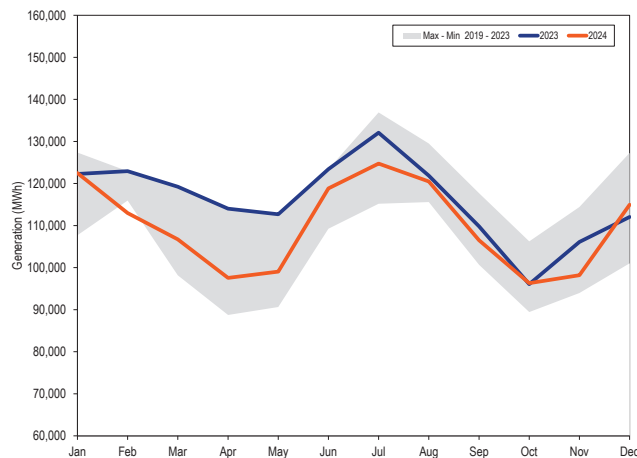**Figure 3-6 Day-ahead monthly average cleared supply: 2023 through 2024**



## Real-Time and Day-Ahead Supply

Table 3-5 presents summary statistics for day-ahead and real-time cleared supply in 2023 and 2024. The last two columns of Table 3-5 are the day-ahead cleared supply minus the real-time cleared supply. The first column is the total physical day-ahead generation less the total physical real-time generation and the second column is the total day-ahead cleared supply less the total real-time cleared supply. The total real-time cleared supply includes real-time generation and real-time imports. The total day-ahead cleared supply includes physical day-ahead generation, INCs, UTCs, and day-ahead imports.

The total physical day-ahead average generation less the total physical real-time average generation in 2024 increased 161 MWh from 2023, from -798 MWh to -637 MWh. The total day-ahead average supply less the total real-time average supply in 2024 decreased 8,563 MWh from 2023, from 22,247 MWh to 13,684 MWh.

**Table 3-5 Day-ahead and real-time hourly cleared supply (MWh): 2023 and 2024**

		Day Ahead					Real Time		Day Ahead Less Real Time	
		Generation	INC Offers	Up to Congestion	Imports	Total Supply	Generation	Total Supply	Generation	Supply
Average	2023	91,659	4,419	19,964	369	116,411	92,457	94,165	(798)	22,247
	2024	94,177	4,982	10,774	357	110,289	94,814	96,605	(637)	13,684
Median	2023	89,077	4,277	19,578	300	115,235	90,322	91,934	(1,245)	23,301
	2024	91,078	4,881	10,435	303	107,847	92,175	93,768	(1,097)	14,079
Standard Deviation	2023	15,678	1,553	8,463	322	18,565	14,683	14,668	995	3,897
	2024	16,973	1,654	4,138	312	19,209	15,971	16,186	1,002	3,023
Peak Average	2023	99,136	5,193	21,991	418	126,739	99,536	101,427	(400)	25,312
	2024	101,612	5,715	12,602	427	120,355	101,649	103,696	(36)	16,659
Peak Median	2023	95,994	5,124	21,543	356	124,973	96,607	98,541	(613)	26,432
	2024	97,677	5,688	12,250	360	116,977	98,052	99,819	(375)	17,157
Peak Standard Deviation	2023	15,159	1,507	8,279	351	16,258	14,099	13,952	1,060	2,306
	2024	16,432	1,528	3,864	346	16,942	15,504	15,669	928	1,273
Off-Peak Average	2023	85,189	3,748	18,209	327	107,473	86,331	87,879	(1,143)	19,594
	2024	87,680	4,341	9,176	295	101,493	88,842	90,410	(1,162)	11,084
Off-Peak Median	2023	83,634	3,616	17,440	254	105,738	84,994	86,486	(1,360)	19,252
	2024	85,051	4,223	8,568	250	98,597	86,597	88,123	(1,546)	10,474
Off-Peak Standard Deviation	2023	13,017	1,250	8,226	288	15,558	12,217	12,156	800	3,402
	2024	14,608	1,485	3,684	265	16,574	13,838	13,931	770	2,643

Figure 3-7 shows the average cleared volumes of day-ahead and real-time supply by hour of the day for 2024. The day-ahead cleared supply consists of cleared MW of physical generation, imports, increment offers and up to congestion transactions. The real-time cleared supply consists of cleared MW of physical generation and imports.

**Figure 3-7 Day-ahead and real-time cleared supply (Average volumes by hour of the day): 2024**


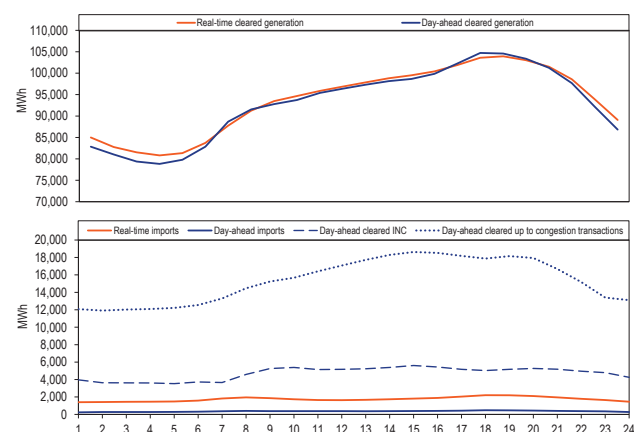


Figure 3-8 shows the difference between day-ahead and real-time daily average cleared supply in 2023 and 2024. The blue line is the total physical day-ahead generation less the total physical real-time generation, and the green line is the total day-ahead cleared supply less the total real-time cleared supply. The total real-time cleared supply includes real-time generation and real-time imports. The total day-ahead cleared supply includes physical day-ahead generation, INCs, UTCs, and day-ahead imports.

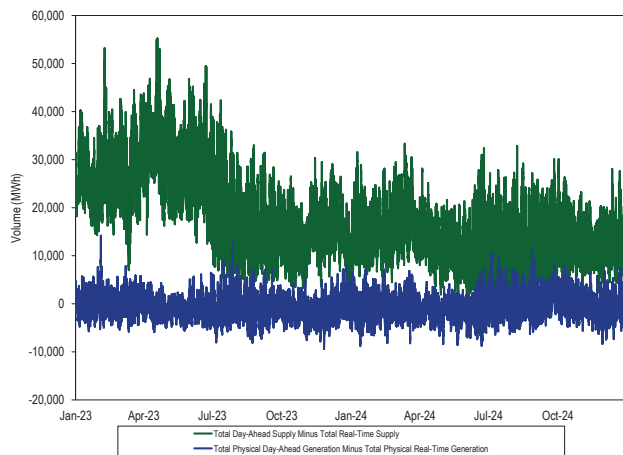**Figure 3-8 Difference between day-ahead and real-time daily average cleared supply: 2023 through 2024**



## Demand

Demand includes physical load and exports and virtual demand transactions.

### Peak Demand

In the real-time energy market, demand refers to physical accounting load and exports, and in the day-ahead energy market, demand also includes virtual demand transactions.<sup>31</sup>

Table 3-6 shows the peak load without exports for 2009 through 2024.

The real-time hourly peak load without exports in 2024 was 148,890 MWh in the HE 1800 (EPT) on July 16, 2024, higher than the PJM peak load in 2023, which was 144,215 MWh in the HE 1800 (EPT) on July 27, 2023.

<sup>31</sup> PJM reports peak load including accounting load plus an addback equal to PJM's estimated load drop from demand side resources. This will generally result in PJM reporting peak load values greater than accounting load values. PJM's load drop estimate is based on PJM Manual 19: Load Forecasting and Analysis, Attachment A: Load Drop Estimate Guidelines.

**Table 3-6 Actual PJM peak load without exports: 2009 through 2024<sup>32 33</sup>**

	Date	Hour Ending (EPT)	PJM Load (MWh)	Annual Change (MWh)	Annual Change (%)
2009	Mon, August 10	17	123,900	NA	NA
2010	Tue, July 06	17	133,297	9,397	7.6%
2011	Thu, July 21	17	154,095	20,798	15.6%
2012	Tue, July 17	17	150,879	(3,216)	(2.1%)
2013	Thu, July 18	17	153,790	2,911	1.9%
2014	Tue, June 17	18	138,448	(15,341)	(10.0%)
2015	Tue, July 28	17	140,266	1,818	1.3%
2016	Thu, August 11	16	148,577	8,311	5.9%
2017	Wed, July 19	18	142,387	(6,190)	(4.2%)
2018	Tue, August 28	17	147,042	4,656	3.3%
2019	Fri, July 19	18	148,228	1,185	0.8%
2020	Mon, July 20	17	141,449	(6,778)	(4.6%)
2021	Tue, August 24	17	145,563	4,114	2.9%
2022	Wed, July 20	18	144,356	(1,208)	(0.8%)
2023	Thu, July 27	18	144,215	(141)	(0.1%)
2024	Tue, July 16	18	148,890	4,675	3.2%

Table 3-7 shows the peak load plus exports from 2009 through 2024.

The real-time hourly peak load plus exports in 2024 was 154,045 MWh (148,218 MWh of load plus 5,827 MWh of gross exports) in the HE 1700 (EPT) on July 15, 2024, which was 0.8 percent, 1,248 MWh, higher than the PJM peak load plus exports in 2023, which was 152,797 MWh in the HE 1800 (EPT) on July 27, 2023.

**Table 3-7 Actual PJM peak load plus export: 2009 through 2024<sup>34 35</sup>**

	Date	Hour Ending (EPT)	PJM Load Plus Export (MWh)	Annual Change (MWh)	Annual Change (%)
2009	Mon, August 10	16	135,923	NA	NA
2010	Wed, July 07	17	149,376	13,453	9.9%
2011	Thu, July 21	17	169,290	19,915	13.3%
2012	Tue, July 17	18	166,081	(3,210)	(1.9%)
2013	Thu, July 18	17	157,277	(8,804)	(5.3%)
2014	Tue, June 17	18	142,428	(14,850)	(9.4%)
2015	Fri, February 20	8	144,850	2,422	1.7%
2016	Thu, August 11	17	154,743	9,893	6.8%
2017	Thu, July 20	16	148,343	(6,400)	(4.1%)
2018	Tue, August 28	17	152,509	4,166	2.8%
2019	Fri, July 19	18	153,589	1,080	0.7%
2020	Mon, July 20	18	148,996	(4,593)	(3.0%)
2021	Tue, August 24	18	151,680	2,684	1.8%
2022	Wed, July 20	18	149,531	(2,150)	(1.4%)
2023	Thu, July 27	18	152,797	3,267	2.2%
2024	Mon, July 15	17	154,045	1,248	0.8%

<sup>32</sup> Peak loads shown are accounting load. See the *MMU Technical Reference for the PJM Markets*, at "Load Definitions," for detailed definitions of load. <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.


<sup>33</sup> Peak loads shown have been corrected to reflect the accounting load value excluding PJM loss adjustment. The values presented in this table do not include settlement adjustments made prior to January 1, 2017.

<sup>34</sup> Peak loads shown are Power accounting load. See the *MMU Technical Reference for the PJM Markets*, at "Load Definitions," for detailed definitions of load. <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

<sup>35</sup> Peak loads shown have been corrected to reflect the accounting load value excluding PJM loss adjustment. The values presented in this table do not include settlement adjustments made prior to January 1, 2017.

Figure 3-9 compares prices and demand on the peak load days in 2023 and 2024. The real-time average LMP for July 27, 2023, peak load hour was \$110.52 per MWh, and for July 15, 2024, peak load hour it was \$112.22 per MWh.

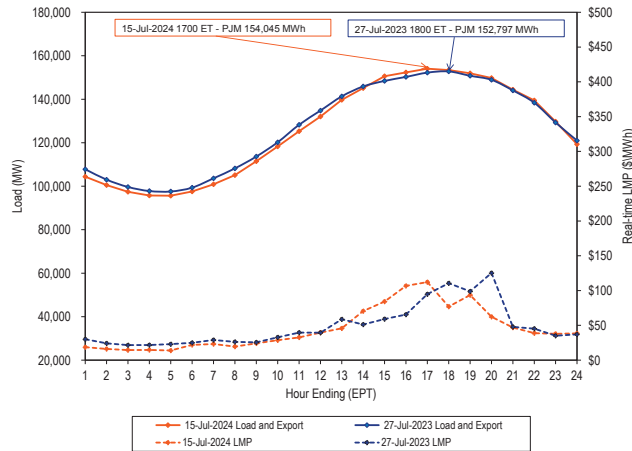**Figure 3-9 Peak load and export day comparison**



## Real-Time Demand

The real-time hourly average load in 2024 increased by 3.6 percent from 2023, from 86,193 MWh to 89,274 MWh.<sup>36</sup>

The real-time hourly average demand including exports in 2024 increased by 2.5 percent from 2023, from 92,455 MWh to 94,787 MWh.


In the PJM Real-Time Energy Market, there are two types of demand:

- **Load.** The actual MWh level of energy used by load within PJM.
- **Export.** An export is an external energy transaction scheduled from PJM to another balancing authority. A real-time export must have a valid OASIS reservation when offered, must have available ramp room to support the export, must be accompanied by a NERC Tag, and must pass the neighboring balancing authority's checkout process.

## PJM Real-Time Demand Duration

Figure 3-10 shows the distribution of the real-time hourly load plus exports in 2023 and 2024.<sup>37</sup>

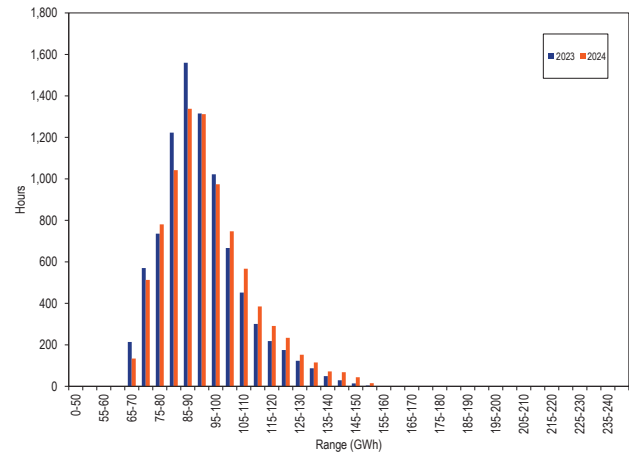**Figure 3-10 Distribution of real-time load plus exports: 2023 and 2024<sup>38</sup>**



## PJM Real-Time Average Load

Table 3-8 presents real-time hourly demand summary statistics for 2001 through 2024.<sup>39</sup>

The real-time hourly average load in 2024 increased by 3.6 percent from 2023, from 86,193 MWh to 89,274 MWh. It was the second highest annual real-time hourly average load since the start of PJM markets. Including exports, it was the highest annual real-time hourly average demand since the start of PJM markets.

<sup>37</sup> All real-time load data in Section 3, "Energy Market," "Market Performance: Load and LMP," are based on PJM accounting load. See the *Technical Reference for PJM Markets*, "Load Definitions," for detailed definitions of accounting load. <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

<sup>38</sup> Each range on the horizontal axis excludes the start value and includes the end value.

<sup>39</sup> Accounting load is used because accounting load is the load customers pay for in PJM settlements. The use of accounting load with losses before June 1, and without losses after June 1, 2007, is consistent with PJM's calculation of LMP. Before June 1, 2007, transmission losses were included in accounting load. After June 1, 2007, transmission losses were excluded from accounting load and losses were addressed through the incorporation of marginal loss pricing in LMP.

<sup>36</sup> Load data are the net MWh injections and withdrawals MWh at every load bus in PJM.



Table 3-8 Real-time hourly average load and load plus exports: 2001 through 2024

	PJM Real-Time Demand (MWh)				Year to Year Change			
	Load		Load Plus Exports		Load		Load Plus Exports	
	Standard Load	Deviation	Standard Demand	Deviation	Standard Load	Deviation	Standard Demand	Deviation
2001	30,297	5,873	32,165	5,564	NA	NA	NA	NA
2002	35,776	7,976	37,676	8,145	18.1%	35.8%	17.1%	46.4%
2003	37,395	6,834	39,380	6,716	4.5%	(14.3%)	4.5%	(17.5%)
2004	49,963	13,004	54,953	14,947	33.6%	90.3%	39.5%	122.6%
2005	78,150	16,296	85,301	16,546	56.4%	25.3%	55.2%	10.7%
2006	79,471	14,534	85,696	15,133	1.7%	(10.8%)	0.5%	(8.5%)
2007	81,681	14,618	87,897	15,199	2.8%	0.6%	2.6%	0.4%
2008	79,515	13,758	86,306	14,322	(2.7%)	(5.9%)	(1.8%)	(5.8%)
2009	76,034	13,260	81,227	13,792	(4.4%)	(3.6%)	(5.9%)	(3.7%)
2010	79,611	15,504	85,518	15,904	4.7%	16.9%	5.3%	15.3%
2011	82,541	16,156	88,466	16,313	3.7%	4.2%	3.4%	2.6%
2012	87,011	16,212	92,135	16,052	5.4%	0.3%	4.1%	(1.6%)
2013	88,332	15,489	92,879	15,418	1.5%	(4.5%)	0.8%	(3.9%)
2014	89,099	15,763	94,471	15,677	0.9%	1.8%	1.7%	1.7%
2015	88,594	16,663	92,665	16,784	(0.6%)	5.7%	(1.9%)	7.1%
2016	88,601	17,229	93,551	17,498	0.0%	3.4%	1.0%	4.3%
2017	86,618	15,170	91,015	15,083	(2.2%)	(11.9%)	(2.7%)	(13.8%)
2018	90,308	15,982	94,351	16,142	4.3%	5.4%	3.7%	7.0%
2019	88,120	15,867	92,920	16,085	(2.4%)	(0.7%)	(1.5%)	(0.4%)
2020	84,584	16,016	90,059	16,233	(4.0%)	0.9%	(3.1%)	0.9%
2021	87,606	15,725	92,774	16,485	3.6%	(1.8%)	3.0%	1.6%
2022	88,884	15,689	94,301	16,047	1.5%	(0.2%)	1.6%	(2.7%)
2023	86,193	13,926	92,455	14,324	(3.0%)	(11.2%)	(2.0%)	(10.7%)
2024	89,274	15,630	94,787	15,766	3.6%	12.2%	2.5%	10.1%

### PJM Real-Time Monthly Average Load

Figure 3-11 compares the real-time monthly average load plus exports of 2023 and 2024, with the historic five-year range. The real-time monthly average load plus exports in April, May, June, October and December 2024 was higher than the maximum monthly average load plus exports for the past five years.

Figure 3-11 Real-time monthly average hourly load plus exports: 2023 through 2024


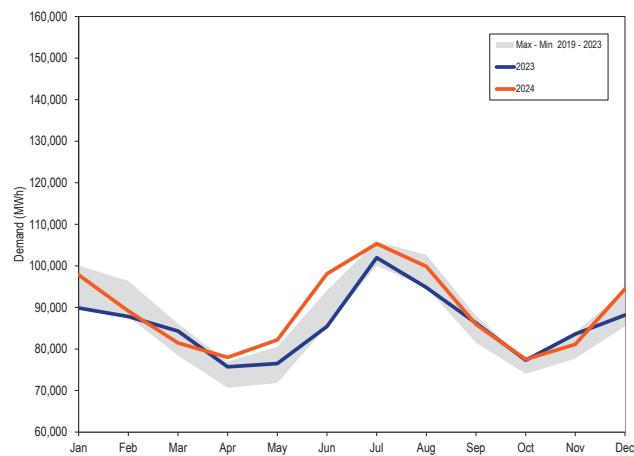


Figure 3-12 compares the real-time daily average load in 2023 and 2024, with the historic five year range. The daily average load was higher than the historic five year range in January, June, July, August and December.

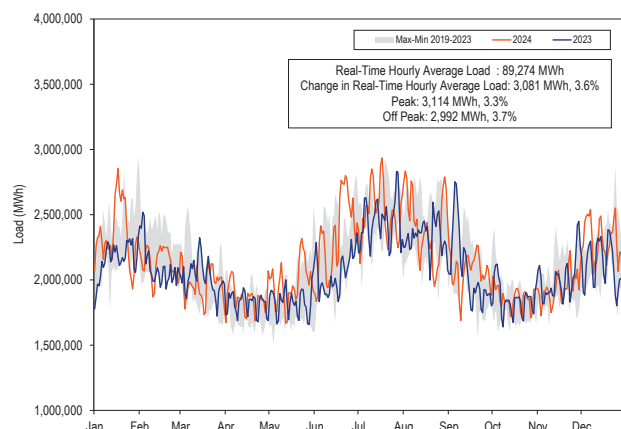**Figure 3-12 Real-time daily load: 2023 through 2024**



The real-time load is significantly affected by weather conditions. Table 3-9 compares the monthly heating and cooling degree days in 2023 and 2024.<sup>40</sup>

Heating degree days increased 1.9 percent compared to 2023. Cooling degree days increased 24.0 percent compared to 2023.

**Table 3-9 Heating and cooling degree days: 2023 through 2024**

	2023		2024		Percent Change	
	Heating Degree Days	Cooling Degree Days	Heating Degree Days	Cooling Degree Days	Heating Degree Days	Cooling Degree Days
Jan	623.0	0.0	799.5	0.0	28.3%	0.0%
Feb	521.2	0.0	562.2	0.0	7.9%	0.0%
Mar	509.9	0.0	381.1	0.0	(25.3%)	0.0%
Apr	163.9	17.2	157.2	18.0	(4.1%)	4.5%
May	47.0	31.0	8.7	98.1	(81.5%)	216.9%
Jun	0.0	162.2	0.0	326.4	0.0%	101.3%
Jul	0.0	387.8	0.0	408.0	0.0%	5.2%
Aug	0.0	310.0	0.0	326.2	0.0%	5.2%
Sep	0.0	144.0	0.0	152.2	0.0%	5.7%
Oct	110.7	29.8	94.3	10.8	(14.8%)	(63.8%)
Nov	439.5	0.0	310.1	2.2	(29.4%)	0.0%
Dec	539.9	0.0	698.8	0.0	29.4%	0.0%
Total	2,955.1	1,081.8	3,011.9	1,341.9	1.9%	24.0%

### Day-Ahead Demand

The day-ahead hourly average cleared demand in 2024, including DECs and UTCs, decreased by 5.2 percent from 2023, from 110,172 MWh to 104,393 MWh.

The day-ahead hourly average cleared demand in 2024, including DECs, UTCs and exports, decreased by 5.3 percent from 2023, from 114,044 MWh to 108,047 MWh.

In the PJM Day-Ahead Energy Market, there are five types of financially binding demand bids:

- **Fixed-Demand Bid.** Bid to purchase a defined MWh level of energy, regardless of LMP.
- **Price-Sensitive Bid.** Bid to purchase a defined MWh level of energy only up to a specified LMP, above which the load bid is zero.
- **Decrement Bid (DEC).** Financial bid to purchase a defined MWh level of energy up to a specified LMP, above which the bid is zero.
- **Up to Congestion Transaction (UTC).** A conditional transaction that permits a market participant to specify a maximum price spread between the transaction source and sink. An up to congestion transaction is evaluated as a matched pair of an injection and a withdrawal.
- **Export.** An external energy transaction scheduled from PJM to another balancing authority. An export must have a valid willing to pay congestion (WPC) OASIS reservation when offered. There is no link between transactions submitted in the PJM Day-Ahead Energy Market and the PJM Real-Time Energy Market, so an export energy transaction

<sup>40</sup> A heating degree day is defined as the number of degrees that a day's average temperature is below 65 degrees F (the temperature below which buildings need to be heated). A cooling degree day is the number of degrees that a day's average temperature is above 65 degrees F (the temperature when people will start to use air conditioning to cool buildings). Reference: <<https://www.eia.gov/energyexplained/units-and-calculators/degree-days.php>>. This calculation was modified starting in 2024 Q3 from the method used in prior State of the Market Reports which was the PJM calculation method based on 60 degrees for heating degree days and 65 degrees for cooling degree days. Heating and cooling degree days are calculated by weighting the temperature at each weather station in the individual transmission zones using weights provided by PJM in Manual 19. Then the temperature is weighted by the real-time zonal accounting load for each transmission zone. After calculating an average hourly temperature across PJM, the heating and cooling degree formulas are used to calculate the daily heating and cooling degree days, which are summed for monthly reporting. The weather stations that provided the basis for the analysis are ABE, ACY, AVP, BWI, CAK, CLE, CMH, CRW, CVG, DAY, DCA, ERI, EWR, FWA, IAD, ILG, IPT, LEX, ORD, ORF, PHL, PIT, RIC, ROA, TOL and WAL.


approved in the day-ahead energy market will not physically flow in real-time unless it is also submitted through the real-time energy market scheduling process.

PJM day-ahead demand is the total of the five types of cleared demand bids.

### PJM Day-Ahead Demand Duration

Figure 3-13 shows the hourly distribution of the day-ahead cleared demand in 2023 and 2024.

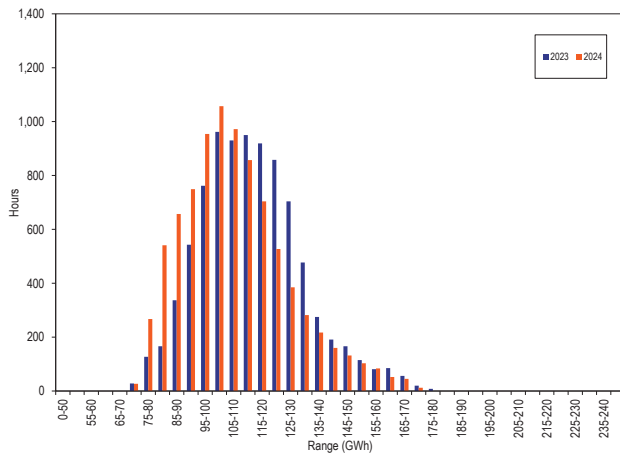**Figure 3-13 Distribution of day-ahead cleared demand plus exports: 2023 and 2024<sup>41</sup>**



### PJM Day-Ahead Average Demand

Table 3-10 shows day-ahead hourly average cleared demand for 2001 through 2024.

**Table 3-10 Day-ahead hourly average cleared demand and demand plus exports: 2001 through 2024**


	PJM Day-Ahead Demand (MWh)				Year to Year Change			
	Demand		Demand Plus Exports		Demand		Demand Plus Exports	
	Demand	Standard Deviation	Demand	Standard Deviation	Demand	Standard Deviation	Demand	Standard Deviation
2001	33,370	6,562	33,757	6,431	NA	NA	NA	NA
2002	42,305	10,161	42,413	10,208	26.8%	54.8%	25.6%	58.7%
2003	44,674	7,841	44,807	7,811	5.6%	(22.8%)	5.6%	(23.5%)
2004	62,101	16,654	63,455	17,730	39.0%	112.4%	41.6%	127.0%
2005	93,534	17,643	96,447	17,952	50.6%	5.9%	52.0%	1.3%
2006	98,527	16,723	101,592	17,197	5.3%	(5.2%)	5.3%	(4.2%)
2007	105,503	16,686	108,932	17,030	7.1%	(0.2%)	7.2%	(1.0%)
2008	101,903	15,871	105,368	16,119	(3.4%)	(4.9%)	(3.3%)	(5.3%)
2009	94,941	15,869	98,094	15,999	(6.8%)	(0.0%)	(6.9%)	(0.7%)
2010	103,937	21,358	108,069	21,640	9.5%	34.6%	10.2%	35.3%
2011	113,866	20,708	117,681	20,929	9.6%	(3.0%)	8.9%	(3.3%)
2012	131,612	17,421	134,947	17,527	15.6%	(15.9%)	14.7%	(16.3%)
2013	144,858	18,489	148,132	18,570	10.1%	6.1%	9.8%	6.0%
2014	142,251	32,664	146,120	32,671	(1.8%)	76.7%	(1.4%)	75.9%
2015	111,644	18,716	114,827	18,872	(21.5%)	(42.7%)	(21.4%)	(42.2%)
2016	127,374	21,513	130,808	21,803	14.1%	14.9%	13.9%	15.5%
2017	125,794	19,402	128,757	19,625	(1.2%)	(9.8%)	(1.6%)	(10.0%)
2018	110,091	19,521	112,885	19,724	(12.5%)	0.6%	(12.3%)	0.5%
2019	112,588	18,163	115,444	18,386	2.3%	(7.0%)	2.3%	(6.8%)
2020	106,209	18,972	109,506	19,270	(5.7%)	4.5%	(5.1%)	4.8%
2021	97,537	17,869	100,642	18,359	(8.2%)	(5.8%)	(8.1%)	(4.7%)
2022	105,715	18,078	109,119	18,393	8.4%	1.2%	8.4%	0.2%
2023	110,172	17,919	114,044	18,111	4.2%	(0.9%)	4.5%	(1.5%)
2024	104,393	18,501	108,047	18,716	(5.2%)	3.2%	(5.3%)	3.3%

<sup>41</sup> Each range on the horizontal axis excludes the start value and includes the end value.

### PJM Day-Ahead Monthly Average Demand

Figure 3-14 compares the day-ahead monthly average cleared demand including decrement bids and up to congestion transactions for 2023 and 2024, with the historic five-year range. In February 2024, the day-ahead monthly average cleared demand plus exports was lower than the minimum of the past five years, primarily as a result of the decrease in UTCs.

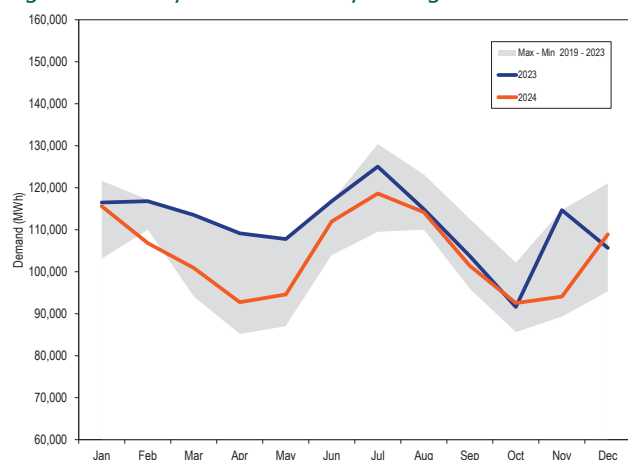Figure 3-14 Day-ahead monthly average cleared demand plus exports: 2023 through 2024



### Real-Time and Day-Ahead Demand

Table 3-11 presents summary statistics for day-ahead and real-time cleared demand for 2023 and 2024. The last two columns of Table 3-11 are day-ahead cleared demand minus real-time cleared demand. The first column is the total physical day-ahead load (fixed demand plus cleared price-sensitive demand) less the physical real-time load. The second column is the total cleared day-ahead demand less the total cleared real-time demand.

The difference in the total physical day-ahead average load less the total physical real-time average load in 2024 decreased 216 MWh from 2023, from -734 MWh to -950 MWh. The total day-ahead average demand less the total real-time average demand in 2024 decreased 8,329 MWh from 2023, from 21,589 MWh to 13,260 MWh.

Table 3-11 Day ahead and real time demand (MWh): 2023 and 2024

										Day Ahead Less Real Time	
Day Ahead								Real Time		Time	
	Year	Fixed Demand	Price Sensitive	DEC Bids	Up to Congestion	Exports	Total Demand	Load	Total Demand	Load	Demand
Average	2023	85,016	443	4,749	19,964	3,873	114,044	86,193	92,455	(734)	21,589
	2024	87,954	370	5,295	10,774	3,655	108,047	89,274	94,787	(950)	13,260
Median	2023	83,260	418	4,339	19,578	3,861	112,905	84,179	90,300	(500)	22,606
	2024	85,301	369	5,077	10,435	3,607	105,630	86,686	92,055	(1,017)	13,575
Standard Deviation	2023	13,708	153	1,892	8,463	1,031	18,111	13,926	14,324	(65)	3,787
	2024	15,336	64	1,852	4,138	1,051	18,716	15,630	15,766	(229)	2,950
Peak Average	2023	92,400	470	5,406	21,991	3,881	124,148	93,341	99,573	(471)	24,574
	2024	95,407	382	5,908	12,602	3,622	117,920	96,455	101,743	(667)	16,177
Peak Median	2023	89,273	423	5,112	21,543	3,864	122,396	90,149	96,777	(453)	25,620
	2024	91,492	380	5,794	12,250	3,566	114,597	92,372	97,999	(500)	16,598
Peak Standard Deviation	2023	12,449	174	1,947	8,279	1,086	15,860	12,842	13,609	(220)	2,251
	2024	14,327	60	1,767	3,864	1,073	16,493	14,847	15,247	(460)	1,246
Off-Peak Average	2023	78,625	420	4,181	18,209	3,865	105,301	80,007	86,295	(962)	19,006
	2024	81,442	360	4,759	9,176	3,684	99,421	83,000	88,709	(1,198)	10,712
Off-Peak Median	2023	77,039	411	3,834	17,440	3,858	103,655	78,282	84,925	(833)	18,729
	2024	78,868	354	4,455	8,568	3,634	96,628	80,530	86,512	(1,308)	10,115
Off-Peak Standard Deviation	2023	11,332	128	1,643	8,226	981	15,147	11,687	11,861	(227)	3,286
	2024	13,055	66	1,756	3,684	1,030	16,099	13,444	13,546	(323)	2,553

Figure 3-15 shows the average cleared volumes of day-ahead and real-time demand in 2024. The day-ahead demand includes day-ahead load, decrement bids, up to congestion transactions, and day-ahead exports. The real-time demand includes real-time load and real-time exports.

**Figure 3-15 Day-ahead and real-time demand (Average hourly volumes): 2024**

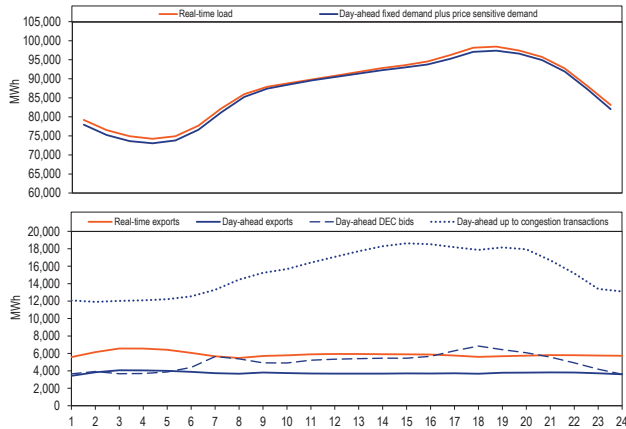


Figure 3-16 shows the difference between the physical day-ahead load and the physical real-time load, and the difference between the day-ahead demand including DEC, UTCs, and exports, and the real-time demand including exports, for 2023 and 2024.

**Figure 3-16 Day-ahead minus real-time daily demand: 2023 through 2024**

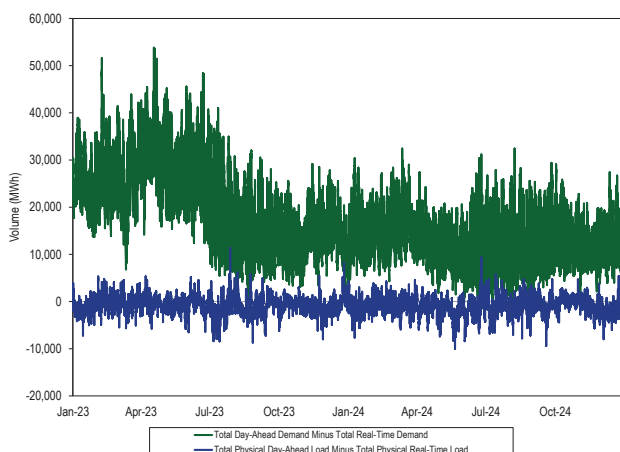


Figure 3-17 shows the difference between the day-ahead and real-time hourly average load by hour of the day. DEC, UTCs and exports are not included. The largest difference generally occurs during off peak

hours, especially at hours beginning 1 and 2. The smallest difference generally occurs during peak hours, especially at hours beginning 9 and 10.

**Figure 3-17 Difference between day-ahead and real-time hourly average physical load by hour of the day (Average hourly volumes): 2020 through 2024**

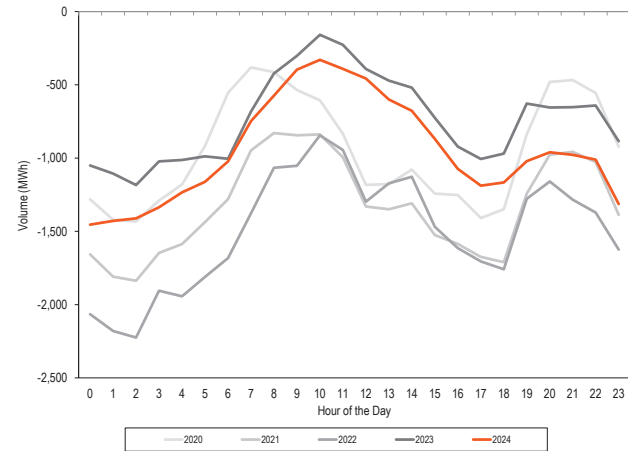


Figure 3-18 shows the difference between the day-ahead and real-time on peak and off peak hourly average load by month. DEC, UTCs and exports are not included.

**Figure 3-18 Difference between day-ahead and real-time on peak and off peak hourly average load by month: 2020 through 2024**

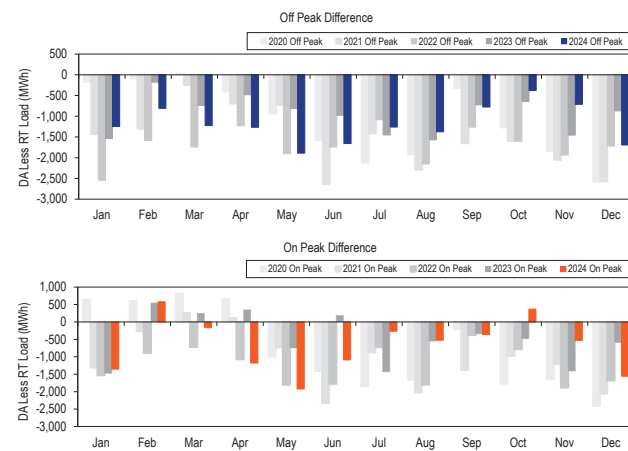


Table 3-12 shows the difference between the day-ahead and real-time on peak and off peak load by zone. DEC, UTCs and exports are not included. Some zones showed larger difference than other zones, such as DOM, BGE and APS. Some zones did not show a big difference



between on peak or off peak, such as DOM and AEP. Some zones showed a significant difference between on peak or off peak, such as AECN, JCPL, and PENELEC.

**Table 3-12 Difference between day-ahead and real-time on peak and off peak load by zone**

Zone	2023				2024			
	Off Peak		On Peak		Off Peak		On Peak	
	Average DA-RT Difference	Average Percent of RT Load	Average DA-RT Difference	Average Percent of RT Load	Average DA-RT Difference	Average Percent of RT Load	Average DA-RT Difference	Average Percent of RT Load
AECO	1.53	0.4%	18.60	2.4%	16.48	1.8%	40.46	4.1%
AEP	(81.81)	(0.5%)	(59.74)	(0.3%)	(86.39)	(0.6%)	(82.93)	(0.5%)
APS	(122.57)	(2.3%)	(64.50)	(1.0%)	(89.55)	(1.6%)	(11.08)	(0.1%)
ATSI	(60.99)	(0.7%)	39.75	0.7%	(82.89)	(1.0%)	69.13	1.1%
BGE	(94.48)	(3.0%)	(85.23)	(2.2%)	(119.45)	(3.6%)	(133.80)	(3.4%)
COMED	135.30	1.6%	157.99	1.6%	17.53	0.4%	34.54	0.5%
DAY	11.96	0.9%	19.48	1.1%	(9.21)	(0.2%)	(4.99)	0.0%
DOM	(594.70)	(4.9%)	(591.08)	(4.3%)	(428.76)	(3.3%)	(449.73)	(3.1%)
DPL	(25.94)	(1.3%)	(16.82)	(0.6%)	(36.32)	(1.8%)	(32.42)	(1.3%)
DUQ	19.20	1.5%	23.62	1.6%	4.78	0.3%	24.08	1.5%
EKPC/DEOK	(52.29)	(1.1%)	(42.03)	(0.8%)	(44.46)	(0.9%)	(25.43)	(0.4%)
JCPL	(22.80)	(0.8%)	52.71	3.0%	(45.19)	(1.7%)	48.47	3.0%
METED	10.22	0.9%	32.39	2.0%	11.12	1.0%	26.76	1.7%
PECO	26.81	1.0%	32.24	1.0%	(33.94)	(0.6%)	(26.07)	(0.3%)
PENELEC	19.70	1.3%	52.39	2.7%	(9.76)	(0.5%)	10.12	0.6%
PEPCO	(56.41)	(1.8%)	(46.09)	(1.2%)	(98.33)	(3.3%)	(107.10)	(3.0%)
PPL	32.24	1.0%	50.46	1.2%	17.69	0.6%	66.02	1.5%
PSEG	(91.48)	(2.0%)	(31.00)	(0.3%)	(163.83)	(3.5%)	(95.03)	(1.4%)
RECO	(2.17)	(1.2%)	(1.09)	0.1%	(4.04)	(2.8%)	(4.24)	(2.0%)

Table 3-13 shows the difference between the day ahead and real time load by zone for the last five years. DECs, UTCs and exports are not included. Some zones showed a change from year to year, such as AECO, PEPCO. Some zones were under bidding by large such as DOM, AEP and BGE.

**Table 3-13 Difference between day ahead and real time load by zone: 2020 through 2024**

Zone	2020		2021		2022		2023		2024	
	Average DA-RT Difference	Average Percent of RT Load	Average DA-RT Difference	Average Percent of RT Load	Average DA-RT Difference	Average Percent of RT Load	Average DA-RT Difference	Average Percent of RT Load	Average DA-RT Difference	Average Percent of RT Load
AECO	(12.51)	(0.4%)	(35.99)	(2.2%)	(40.50)	(2.6%)	9.45	1.3%	27.66	2.9%
AEP	(205.68)	(1.5%)	(184.88)	(1.3%)	(175.12)	(1.3%)	(71.57)	(0.4%)	(84.78)	(0.6%)
APS	(73.55)	(1.2%)	(55.71)	(0.9%)	(125.11)	(2.2%)	(95.63)	(1.7%)	(52.96)	(0.9%)
ATSI	(9.02)	0.1%	(25.97)	(0.1%)	(106.72)	(1.4%)	(14.26)	(0.1%)	(12.00)	(0.0%)
BGE	(134.57)	(3.8%)	(137.84)	(3.8%)	(87.14)	(2.5%)	(90.19)	(2.6%)	(126.14)	(3.5%)
COMED	83.92	1.0%	(46.06)	(0.2%)	13.77	0.3%	145.83	1.6%	25.46	0.5%
DAY	0.44	0.3%	(8.69)	(0.3%)	(28.16)	(1.2%)	15.45	1.0%	(7.24)	(0.1%)
DOM	(290.24)	(2.6%)	(522.40)	(4.4%)	(599.31)	(4.8%)	(593.02)	(4.6%)	(438.53)	(3.2%)
DPL	(32.28)	(1.4%)	(43.78)	(1.9%)	(71.08)	(3.4%)	(21.71)	(1.0%)	(34.50)	(1.6%)
DUQ	16.25	1.4%	(2.38)	(0.0%)	(78.42)	(5.0%)	21.25	1.6%	13.78	0.9%
EKPC/DEOK	(45.76)	(1.0%)	(53.31)	(1.0%)	(84.23)	(1.8%)	(47.53)	(1.0%)	(35.58)	(0.6%)
JCPL	(18.65)	0.0%	(34.69)	(0.7%)	(47.31)	(1.2%)	12.23	0.9%	(1.51)	0.5%
METED	(29.83)	(1.4%)	(22.84)	(1.0%)	(64.01)	(3.4%)	20.50	1.4%	18.41	1.3%
PECO	(37.17)	(0.5%)	(47.27)	(0.7%)	81.81	2.1%	29.33	1.0%	(30.27)	(0.5%)
PENELEC	(5.04)	(0.2%)	9.77	0.5%	10.06	0.5%	34.87	2.0%	(0.49)	0.1%
PEPCO	(14.51)	(0.1%)	(20.55)	(0.4%)	(12.70)	(0.3%)	(51.62)	(1.5%)	(102.42)	(3.2%)
PPL	(39.34)	(0.7%)	(48.06)	(0.8%)	20.25	0.7%	40.69	1.1%	40.23	1.0%
PSEG	(95.22)	(1.7%)	(33.23)	(0.5%)	(91.37)	(1.7%)	(63.42)	(1.2%)	(131.75)	(2.5%)
RECO	5.38	4.1%	2.60	1.6%	0.23	0.4%	(1.67)	(0.6%)	(4.14)	(2.4%)

## Market Behavior

### Generator Offers

Generators indicate their availability for commitment and dispatch in the day-ahead market through their offers. Commitment availability status is economic, must run, or unavailable. Dispatch availability status is defined by the difference between the economic minimum and maximum output levels. PJM will clear units that select must run status in the offer in the day-ahead market up to their economic minimum MW regardless of economics. Units may set their economic minimum MW equal to their economic maximum MW, also called block loading, or they may raise the economic minimum MW to a point between the actual economic minimum and the economic maximum. Must run units may commit at economic minimum and permit the balance to be dispatchable or block load the full output of the unit. If units select economic commitment status, the day-ahead market will commit them based on their offers.

The Must Run column in Table 3-14 is the submitted offer MW of units offering with must run commitment status. The Eco Min column in Table 3-14 is the economic minimum MW of units offering with economic commitment status. The dispatchable range in Table 3-14 is the percent of MW offered by price range, between the economic minimum MW and economic maximum MW for all available units. Some units, like wind and solar, offer a dispatchable range in the day-ahead market although their availability in real time is determined by the presence of sun and wind rather than economics.

Units may designate all or a portion of their capacity as emergency MW. Table 3-14 shows that 0.2 percent of offered MW are emergency MW. In some cases, higher shares of emergency MW result from offer behavior that does not accurately represent the availability of the emergency MW in real time.

In the day-ahead market for 2024, 23.2 percent of MW were offered as must run, 32.1 percent of MW were offered as the economic minimum MW for dispatchable units, 44.6 percent of MW were offered as dispatchable, and 0.2 percent of MW were offered as emergency maximum MW.

**Table 3-14 Dispatchable status of day-ahead energy offers: 2024**

Unit Type	Must Run	Eco Min	Dispatchable Range										Emergency MW	Dispatchable Percent
			(\$300 - \$0	\$0 - \$25	\$25 - \$50	\$50 - \$75	\$75 - \$100	\$100 - \$200	\$200 - \$400	\$400 - \$600	\$600 - \$800	\$800 - \$1000		
CC	8.6%	35.4%	(0.1%)	35.8%	11.8%	2.0%	1.1%	3.0%	2.0%	0.1%	0.0%	0.0%	0.1%	55.9%
CT	0.4%	58.7%	0.1%	3.2%	14.8%	6.4%	2.2%	5.7%	7.4%	0.5%	0.0%	0.1%	0.3%	40.6%
Diesel	7.8%	82.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	10.1%	0.0%	0.0%	0.0%	0.0%	10.1%
Hydro	81.6%	0.4%	18.0%	(0.0%)	0.0%	0.0%	(0.0%)	(0.0%)	0.0%	(0.0%)	0.0%	0.0%	0.0%	18.0%
Nuclear	87.9%	9.5%	2.0%	0.6%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	2.6%
Solar	16.4%	0.3%	66.4%	7.0%	5.5%	2.2%	0.7%	0.8%	0.6%	0.1%	0.0%	0.1%	0.0%	83.3%
Steam - Coal	29.6%	24.1%	0.1%	11.1%	25.1%	4.6%	0.6%	1.0%	1.0%	2.4%	0.0%	(0.0%)	0.3%	46.0%
Steam - Other	4.9%	21.5%	1.8%	14.5%	18.2%	6.8%	1.5%	7.6%	22.9%	0.3%	0.0%	0.0%	0.1%	73.5%
Wind	3.1%	0.4%	72.9%	9.4%	7.3%	1.7%	2.7%	0.4%	0.3%	1.3%	0.1%	0.3%	0.0%	96.4%
Other	13.4%	50.8%	5.5%	7.7%	3.9%	0.0%	0.0%	0.5%	15.9%	0.5%	0.0%	0.0%	1.7%	34.2%
All Units	23.2%	32.1%	2.5%	16.9%	12.7%	3.3%	1.1%	3.1%	4.4%	0.6%	0.0%	0.0%	0.2%	44.6%

### Hourly Offers and Intraday Offer Updates

All participants may make specific hourly offers. Hourly offers mean that participants can specify different MW and price pairs for each hour of the day. Hourly offers can be submitted in the day-ahead market and offers may be updated in the real-time market. Participants must opt in on a monthly basis to make intraday offer updates in real time. Participants that have opted in can make updates only based on the process defined in their fuel cost policies. Units typically use hourly offers to reflect the two gas days in a power day. A gas day is from 10:00 AM EPT to 10:00 AM EPT the next day. Therefore, gas fired units may face two different gas prices. Typically, gas units have one offer from 00:00 EPT until 10:00 EPT and a different offer from 10:00 EPT until 24:00 EPT. Units typically use intraday updates to reflect changes in gas costs that occur in real time.

Table 3-15 shows the daily average number of units that make hourly offers in the day-ahead market, that opted in to intraday offer updates and that make intraday offer updates. In 2024, an average of 365 units per day made hourly offers, an increase of 17 units from 2023. In 2024, 591 units opted in for intraday offer updates, an increase of 42 units from 2023. In 2024, an average of 147 units made intraday offer updates each day, an increase of 12 units from 2023.

**Table 3-15 Daily average number of units making hourly offers, opted in for intraday offers and making intraday offer updates: 2023 and 2024**

	Fuel Type	2023	2024	Difference
Hourly Offers	Natural Gas	315	319	4
	Other Fuels	33	46	13
	Total	348	365	17
Opt In	Natural Gas	422	434	12
	Other Fuels	127	157	30
	Total	549	591	42
Intraday Offer Updates	Natural Gas	131	143	12
	Other Fuels	4	4	0
	Total	135	147	12
Total Units with nonzero offers		827	836	9

## ICAP Must Offer Requirement

Generation capacity resources are required to offer their full ICAP MW into the day-ahead and real-time energy market, or report an outage for the difference.<sup>42</sup> The full installed capacity (ICAP) is the ICAP of the resources that cleared in the capacity market. This is known as the ICAP must offer requirement.

Unlike all other generation capacity resources, Intermittent Resources, Capacity Storage Resources, and Hybrid Resources consisting exclusively of components that in isolation would be Intermittent Resources or Capacity Storage Resources, are categorically exempt from the RPM must offer requirement. Capacity Storage Resources include pumped storage hydroelectric, impoundment hydroelectric, flywheel, and battery. Intermittent Resources include wind, solar, landfill gas, run of river hydroelectric, and other renewable resources. As a result, a significant level of such resources withhold their capacity. The result is to increase the clearing prices above the competitive level. This can benefit the owners of capacity portfolios that include such resources as well as resources with an RPM must offer requirement. The MMU recommends that all capacity resources have a must offer obligation. The MMU also recommends that performance penalties not be applied to solar and wind

resources when they are not capable of performing based on ambient conditions. For example, solar resources should be subject to performance penalties if they fail to perform when the sun is shining but should not be subject to performance penalties in the middle of the night. This would be a rational application of the PAI penalties that recognizes the physical capabilities of resources and is therefore not discriminatory.

The current enforcement of the ICAP must offer requirement is inadequate.<sup>43</sup> The problem is a complex combination of generator behavior, and inadequate and inconsistent reporting tools that are not synchronized. Compliance is subject to mistakes and susceptible to manipulation.

Resources are required to submit their available capacity in three different systems. Resources are required to make offers in the energy market via Markets Gateway. Resources are required to report outages in the Dispatch Application Reporting Tool (eDART) in advance or in real time. Resources are required to report outages in the Generator Availability Data System (eGADS) after the fact. The three applications are not linked and there is no formal process to ensure consistency.

For example, ambient ratings are an issue. When the weather is hotter than test conditions, the capacity of some units is reduced below the ICAP levels. While this fact may be reported by unit owners in eDART and reflected in lower offered MW in the energy market, the derates are not reported as outages in eGADS and are therefore not included as outages for purposes of defining capacity using EFORD. For planning purposes, PJM acknowledges this discrepancy, but instead of reflecting the derates in the supply offers from the units that are actually derated, PJM increases the demand for capacity to account for the loss of supply due to ambient derates.<sup>44</sup>

The MMU recommends that PJM enforce the ICAP must offer requirement by assigning a forced outage to any unit that is derated in the energy market below

<sup>43</sup> PJM compares the data submitted in eDART to the data submitted in Markets Gateway using the eDART Gen Checkout. Generators are supposed to acknowledge their Gen Checkout reports. Manual 10 and the eDART User Guide do not specify what acknowledging the Gen Checkout report means, any requirements to acknowledge the Gen Checkout report or any consequences for not doing so. Gen Checkout is also only triggered if generators fail by more than defined thresholds.

<sup>44</sup> See "Capacity Value Accreditation Concepts in the Reliability Pricing Model (RPM)," slide 13, PJM presentation to the Resource Adequacy Senior Task Force. (August 8, 2022) <<https://www.pjm.com/-/media/committees-groups/task-forces/rastf/2022/20220808/item-05---capacity-value-accreditation-concepts-in-the-reliability-pricing-model.ashx>>.

<sup>42</sup> OA Schedule 1 § 1.10.1A(d).

its committed ICAP without an outage that reflects the derate.

The MMU recommended that intermittent resources be subject to an enforceable ICAP must offer rule that reflects the limitations of these resources. In 2023, the MMU and PJM proposed to require intermittent resources to offer their median forecast on an hourly basis. This proposal was implemented on November 15, 2023.<sup>45</sup>

The MMU recommends that storage resources also be subject to an enforceable ICAP must offer requirement that that reflects the limitations of these resources.

Table 3-16 shows average hourly MW, for each month, that violated the ICAP must offer requirement in 2024. On average for all hours, 2,290 MW did not meet the ICAP must offer requirement, but for 10 percent of the hours, 3,336 MW did not meet the must offer requirement. These MW levels are larger than the reserve shortages that trigger scarcity pricing and larger than most supply contingencies that lead to synchronized reserve events.

**Table 3-16 Average hourly estimated capacity (MW) failing the ICAP must offer requirement: 2024**

Month	90th Percentile	Average	10th Percentile
Jan-24	2,434	1,785	1,228
Feb-24	2,099	1,659	1,307
Mar-24	3,396	2,815	2,409
Apr-24	2,251	1,700	1,188
May-24	3,323	2,513	1,803
Jun-24	3,314	2,238	1,343
Jul-24	3,394	2,325	1,357
Aug-24	2,885	1,865	806
Sep-24	3,272	2,322	985
Oct-24	3,476	2,726	2,034
Nov-24	3,950	2,498	920
Dec-24	3,910	2,983	2,054
2024	3,336	2,290	1,292

The outage data reported in eGADS do not exactly match the energy market data submitted in Markets Gateway. For example, economic maximum MW levels submitted in Markets Gateway that reflect expected ambient conditions (including ambient derates) can be inconsistent with the maximum capability submitted in eGADS. Another example is the start and end times of planned outages in the shoulder months. In many situations units are derated in Markets Gateway to reflect an upcoming planned outage for which the unit

must ramp down over an extended period but in eGADS the outage start time is not reported until the unit is completely unavailable. These differences can result in units not meeting their ICAP must offer requirement.

The MMU recommends that PJM integrate all the outage reporting tools in order to enforce the ICAP must offer requirement, ensure that outages are reported correctly and eliminate reporting inconsistencies. Generators currently submit availability in three different tools that are not integrated, Markets Gateway, eDART and eGADS.

## Emergency Maximum MW

Generation resources are offered with economic maximum MW and emergency maximum MW. The economic maximum MW is the output level the resource can achieve following economic dispatch. The emergency maximum MW is the output level the resource can achieve when emergency conditions are declared by PJM. The MW difference between the two ratings equals emergency maximum MW. The PJM market rules allow generators to include emergency maximum MW as part of ICAP offered in the capacity market.<sup>46</sup>

Generation resources have to meet one of four conditions to offer any MW as emergency in the energy market: environmental limits imposed by a federal, state or other governmental agency that significantly limit availability; fuel limits beyond the control of the generation owner; temporary emergency conditions that significantly limit availability; or temporary MW additions not ordinarily available.<sup>47</sup>

The MMU recommends that capacity resources not be allowed to offer any portion of their capacity market obligation as maximum emergency energy.<sup>48</sup> Capacity resources should offer their full output in the energy market and be subject to economic dispatch. The result will be incentives for correct reporting of ICAP, more efficient energy market pricing, and a reduction in the need for manual overrides by PJM dispatchers during emergency conditions. Resources that do have capacity that can only be achieved with extraordinary measures could offer such capacity in the energy market but should not take on a capacity market obligation.

<sup>46</sup> See 151 FERC ¶ 61,208 at P 476 (2015).

<sup>47</sup> OA Schedule 1 § 1.10.1A(d).

<sup>48</sup> This recommendation was accepted by PJM and filed with FERC in 2014 as part of the capacity performance updates to the RPM. See PJM Filing, Attachment A (Redlines of OA Schedule 1 § 1.10.1A(d), EL15-29-000 (December 12, 2014). FERC rejected the proposed change. See 151 FERC ¶ 61,208 at P 476 (2015).

<sup>45</sup> See "Renewable Dispatch Markets Manual Changes," PJM presentation to the Markets and Reliability Committee. (November 15, 2023) <<https://www.pjm.com/-/media/committees-groups/committees/mrc/2023/20231115/20231115-consent-agenda-f---1-manual-11-revisions---renewable-dispatch---presentation.ashx>>.


Table 3-17 shows average hourly maximum emergency MW, for each month. The levels of maximum emergency MW change hourly, daily and seasonally. For example, in January 2024, 10 percent of hours had maximum emergency MW greater than or equal to 1,850 MW while 10 percent of hours had maximum emergency MW less than 363. The hourly average, in 2024, was 662 MW offered as maximum emergency, 58.6 percent lower than in 2023.

**Table 3-17 Maximum emergency MW by month: 2024**

Month	90th Percentile	Average	10th Percentile
Jan-24	1,850	1,025	363
Feb-24	1,480	880	239
Mar-24	1,538	888	227
Apr-24	936	530	205
May-24	603	333	120
Jun-24	586	315	133
Jul-24	553	384	174
Aug-24	459	285	132
Sep-24	708	407	120
Oct-24	485	253	97
Nov-24	473	254	101
Dec-24	657	320	107
2024	1,129	662	122

Figure 3-19 shows maximum emergency MW by hour in 2023 and 2024. The continued reduction of the use of emergency maximum in 2024 is mainly a result of improved compliance with the maximum emergency rules.

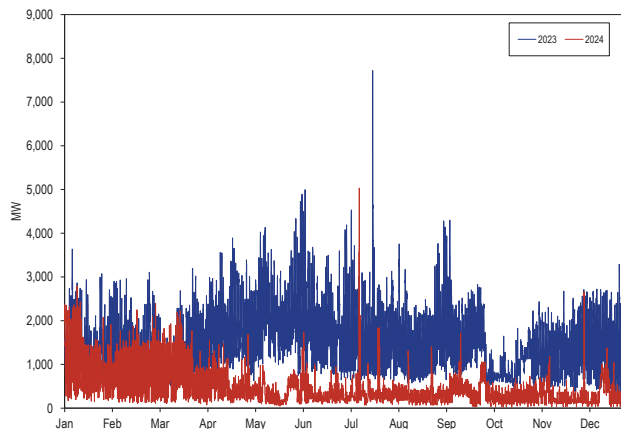**Figure 3-19 Maximum Emergency MW by hour: 2023 and 2024**



## Parameter Limited Schedules

### Cost-Based Offers

All resources in PJM are required to submit at least one cost-based offer. Cost-based offers, submitted by capacity resources for a defined set of technologies, are parameter limited based on unit specific parameter limits. Nuclear, wind, solar and hydro units are not subject to parameter limits.

### Price-Based Offers

All capacity resources that choose to make price-based offers are required to make available at least one price-based parameter limited offer (referred to as price-based PLS). The prices in a price-based PLS offer are at the discretion of the seller but the parameters are the same parameters used in the cost-based offers. For capacity resources, the price-based parameter limited schedule is used by PJM for committing generation resources when hot weather alerts and cold weather alerts are declared.

### Offer Schedule Selection

PJM's current process for selecting unit offers (schedules) does not prevent the exercise of market power through the use of markups or through the use of inflexible parameters. The goal of having parameter limited offers is to prevent the use of inflexible operating parameters to exercise market power. Instead of ensuring that parameter limits apply, PJM chooses the lower of the price-based schedule and the price-based parameter limited schedule during hot and cold weather alerts. The goal of having cost-based offers is to prevent the use of markups to exercise market power. Instead of ensuring the least cost solution, PJM frequently chooses the higher price-based schedule that includes no parameter limits rather than the cost-based schedule that includes parameter limits when a resource fails the TPS test. The result is that PJM does not select the lowest cost schedule and allows market power to be exercised. The Commission recognized this flaw in the implementation of market power mitigation in its order to show cause, issued June 17, 2021, but did not take corrective action in its November 30, 2023 order.<sup>49 50</sup>

PJM raised the schedule selection issues in the stakeholder process to address computational time in the day-ahead market. PJM's original proposal would

<sup>49</sup> See 175 FERC ¶ 61,231 (2021).

<sup>50</sup> See 185 FERC ¶ 61,158 (2023).



have weakened market power mitigation. FERC rejected PJM's proposal because PJM's proposal would create the ability for market sellers to exercise market power.<sup>51</sup> PJM filed and, on October 25, 2024, FERC accepted a revised proposal that would require that sellers that fail the TPS test be offer capped at their cost-based offers and that operating parameters be mitigated.<sup>52</sup> FERC accepted PJM's proposal that has no specific plans to implement the improved rules and instead links implementation to PJM's long awaited improvements to its combined cycle modelling. PJM's revised proposal also continues to use the flawed formula, which was the basis for the first proposal rejected by FERC, to select among cost-based offers. This will result in the illogical selection of cost-based offers in some circumstances, for example if a dual fuel unit submits offers for both oil and gas on a day when the economics change between the two fuels midday. PJM should modify its implementation to address that issue. The result would allow market sellers to select the correct cost-based fuel schedule. There is no reason to delay implementation until PJM addresses combined cycle modelling. The changes would decrease the solution time for the day-ahead market and enhance market efficiency. The new approach should be implemented as soon as possible.

The MMU analyzed the extent of parameter mitigation in the day-ahead energy market when units are committed after failing the TPS test for transmission constraints in 2024. The analysis includes units with technologies that are subject to parameter limits and offer both price-based and cost-based schedules.<sup>53</sup> Table 3-18 shows the number and percentage of day-ahead unit run hours that failed the TPS test but were committed on price schedules. Table 3-18 shows that 27.7 percent of unit hours for units that failed the day-ahead TPS test were committed on price-based schedules that were less flexible than their cost-based schedules. For effective market power mitigation there would be zero units that fail the TPS test committed with parameters less flexible than their cost-based schedules.

**Table 3-18 Parameter mitigation for units failing the day-ahead TPS test: 2024**

Day-ahead Commitment For Units That Failed TPS Test	Day-ahead Unit Hours	Percent Day-ahead Unit Hours
Committed on price schedule less flexible than cost	27,425	27.7%
Committed on price schedule as flexible as cost	7,164	7.2%
Committed on cost (cost capped)	60,806	61.4%
Committed on price PLS	3,565	3.6%
Total committed on schedule as flexible as cost	71,535	72.3%
Total failed TPS test commitments	98,960	100.0%

The MMU analyzed the extent of parameter mitigation in the day-ahead energy market for units in zones with a cold weather alert, a hot weather alert, or a maximum generation emergency declaration in 2024. PJM declared cold weather alerts on 10 days and hot weather alerts on 28 days in 2024. The analysis includes units with technologies that are subject to parameter limits, with a capacity commitment, in the zones where the cold or hot weather alerts were declared. Table 3-19 shows that 34.4 percent of unit hours during weather alerts in the day-ahead energy market were committed on price-based schedules that were less flexible than their price PLS schedules. Effective market power mitigation would result in zero units committed during cold and hot weather alerts with parameters less flexible than their price PLS schedules.

**Table 3-19 Parameter mitigation during weather alerts: 2024**

Day-ahead Commitment During Hot And Cold Weather Alerts	Day-ahead Unit Hours	Percent Day-ahead Unit Hours
Committed on price schedule less flexible than PLS	59,593	34.4%
Committed on price schedule as flexible as PLS	11,133	6.4%
Committed on cost (cost capped)	7,358	4.3%
Committed on price PLS	94,929	54.9%
Total committed on schedule as flexible as PLS	113,420	65.6%
Total weather alert commitments	173,013	100.0%

Currently, there are no rules in the PJM tariff or manuals that limit the markup attributes of price-based PLS offers. The intent of the price-based PLS offer is to prevent the exercise of market power during high demand conditions by preventing units from offering inflexible operating parameters in order to extract higher market revenues or higher uplift payments. However, a generator can include a higher markup in the price-based PLS offer than in the price-based non-PLS schedule. The result is that the offer is higher and market prices are higher as a result of the exercise of market power using the PLS

<sup>51</sup> 187 FERC 61,051 at P 25 (2024).

<sup>52</sup> See 189 FERC ¶ 61,060 (2024).

<sup>53</sup> Nuclear, wind, solar and hydro units are not subject to parameter limits.

offer. This defeats the purpose of requiring price-based PLS offers.

The best solution to the use of inflexible parameters is to require the use of flexible parameters in all offers at all times for capacity resources. Capacity resources are paid to be flexible but that payment will not result in flexible offers in the energy market, the only place it matters, unless there are explicit requirements that energy offers from capacity resources incorporate that flexibility.

The MMU recommends, in order to ensure effective market power mitigation and to ensure that capacity resources meet their obligations to be flexible, that capacity resources be required to use flexible parameters in all offers at all times.

If flexible parameters are not required at all times, the use of flexible parameters should be required whenever a unit fails the TPS test and whenever the system is facing weather alerts or emergency conditions. This would require that PJM apply the full set of approved unit specific flexible parameters to a resource that makes any price-based offer under these conditions. The selection of a cost offer, based on the financial parameters, would include the PLS parameters for all schedules.

Currently, PJM commits units on either a cost-based or a price-based schedule. PJM should always use cost-based offers for units that fail the TPS test, and always use flexible parameters in all price-based offers during weather alerts and emergencies. This approach would allow PJM to effectively mitigate inflexible operating parameters consistent with PJM's asserted processing time constraints. PJM's revised schedule selection proposal adopts this approach, but PJM has failed to propose an implementation date and the flawed rules remain in place as a result.

The MMU recommends that in order to ensure effective market power mitigation, PJM always use cost-based offers for units that fail the TPS test, and always use flexible parameters for all cost-based and all price-based offers during cold and hot weather alerts and emergency conditions.<sup>54 55</sup>

## Parameter Limits

The unit specific parameter limits for capacity resources are based on default minimum operating parameter limits posted by PJM by technology type, and any adjustments based on a unit specific review process. These default parameters were based on analysis by the MMU.

The PJM tariff specifies that all generation capacity resources, regardless of the current commitment status, are subject to parameter limits on their cost-based offers. The MMU recommends that PJM update the tariff to clarify that all generation resources are subject to unit specific parameter limits on their cost-based offers using the same standard and process as capacity resources.

## Unit Specific Adjustment Process

Market participants can request an adjustment to the default values of parameter limits for capacity resources by submitting supporting documentation which is reviewed by PJM and the MMU. The default minimum operating parameter limits or approved adjusted values are used by capacity resources for their parameter limited schedules.

PJM has the authority to approve adjusted parameters with input from the MMU. PJM has inappropriately applied different review standards to coal units than to CTs and CCs despite the objections of the MMU. PJM has approved parameter limits for boiler based steam units based on historical performance and existing equipment while holding CTs and CCs to higher standards based on OEM documentation and a best practices equipment configuration.

The PJM process for the review of unit specific parameter limit adjustments is generally described in Manual 11: Energy and Ancillary Services Market Operations. The standards used by PJM to review the requests are currently not described in the tariff or PJM manuals. The MMU recommends that PJM clearly define the business rules that apply to the unit specific parameter adjustment process, including PJM's implementation of the tariff rules in the PJM manuals to ensure market sellers know the requirements for their resources.

Only certain technology types are subject to limits on operating parameters in their parameter limited

<sup>54</sup> See "Comments of the Independent Market Monitor for PJM," Docket No. EL21-78 (October 15, 2021) at 18 - 19.

<sup>55</sup> See "Schedule Selection: IMM Package," IMM Presentation to the Markets Implementation Committee (September 6, 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MIC\\_Schedule\\_Selection\\_IMM\\_Package\\_20230906.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MIC_Schedule_Selection_IMM_Package_20230906.pdf)>.

schedules.<sup>56</sup> Solar units, wind units, run of river hydro units, and nuclear units are currently not subject to parameter limits. The MMU analyzed, for the units that are subject to parameter limits, the proportion of units that use the default limits published by PJM and the proportion of units that have unit specific adjustments for some of the parameters. Table 3-20 shows, for the delivery year beginning June 1, 2024, the number of units with approved unit specific parameter limits, and the number of units that used the default parameter limits published by PJM.

**Table 3-20 Adjusted unit specific parameter limit statistics: 2024/2025 Delivery Year**

Technology Classification	Units Using Default Parameter Limits	Units with One or More Adjusted Parameter Limits	Percent of Units with One or More Adjusted Parameter Limits
Aero CT	118	37	23.9%
Frame CT	156	106	40.5%
Combined Cycle	93	27	22.5%
Reciprocating Internal Combustion Engines	57	3	5.0%
Solid Fuel NUG	33	6	15.4%
Oil and Gas Steam	10	23	69.7%
Subcritical and Supercritical Coal Steam	7	65	90.3%
Total	474	267	36.0%

## Parameter Limited Schedule Exceptions

There are three different types of exceptions to the parameter limited schedule default values: temporary exceptions, period exceptions, and persistent exceptions, each differentiated by the length of time it applies. Market sellers must submit requests for exceptions to PJM and the MMU for approval, along with data and documentation. Valid exceptions must be based on physical operational or contractual limits.<sup>57</sup>

There are no defined consequences for real-time exceptions for units that change their parameters but do not meet the requirements in the tariff. Units that override their turn down ratio (economic maximum divided by economic minimum) either use PJM's fixed gen flag or simply increase their hourly economic minimum.<sup>58</sup> The turn down ratio has a defined parameter limit, but the limit can be evaded by the use of the fixed gen flag. These resources override their output limit parameters with no consequence.

<sup>56</sup> For the default parameter limits by technology type, see PJM, "Unit-Specific Minimum Operating Parameters for Capacity Performance and Base Capacity Resources," which can be accessed at <https://www.pjm.com/-/media/committees-groups/committees/elc/postings/20150612-june-2015-capacity-performance-parameter-limitations-informational-posting.ashx>.

<sup>57</sup> See OA Schedule 1 § 6.6(j) and PJM Manual 11, Section 2.3.4.3.

<sup>58</sup> PJM Markets Gateway User Guide, Section 5.8: Self-schedule a Generating Unit and Ignore PJM Dispatch Instruction at 54, Section 14.3 Submit Revised MW Operating Limits at 138 and Section 14.4 Revise the Status of a Generating Unit at 139 <<https://www.pjm.com/-/media/etools/markets-gateway/markets-gateway-user-guide.ashx>>.

The MMU has proposed that such a unit should not be paid a portion of its capacity market revenues, the daily value for each day, if it fails to include its defined parameter values in its offer (by either using the fixed gen option or increasing their economic minimum). The MMU recommends that PJM require generators to request temporary parameter exceptions for the use of the fixed gen flag. The request process requires generators to demonstrate that the request is based on a physical and actual constraint.

Consistent with the no excuses approach of the capacity performance paradigm and consistent with long term incentives for flexibility, resources that operate with a denied temporary parameter limit exception should not be paid the corresponding portion of the daily capacity value of the resource for days when it is not fully available consistent with its parameter limited schedule. If flexibility is valued as a generator attribute, the market design should not provide incentives to be inflexible. An effective market design should reward flexible operation, and

ensure that capacity resources are paid for their capacity only when they meet their required level of flexibility. Without clearly defined consequences, market sellers will continue to submit inflexible parameters. The MMU recommends that resources not be paid the daily capacity payment when unable to operate to their unit specific parameter limits.<sup>59</sup>

## Generator Flexibility Incentives in the Capacity Market

In its June 9, 2015, order on capacity performance, the Commission determined that capacity performance resources should be able to submit operating parameters to the market based not just on the resource physical constraints, but also based on other constraints, such as contractual limits.<sup>60</sup> The order primarily addressed limits imposed by natural gas pipelines. The Commission directed PJM to submit tariff language to establish a process through which capacity performance resources that operate outside the defined unit specific parameter

<sup>59</sup> See Monitoring Analytics LLC, "Real-Time Values," presented at the Markets Implementation Committee Special Session (October 7, 2020) at 12, which can be accessed at <<https://www.pjm.com/-/media/committees-groups/committees/mic/2020/20201007/20201007-item-06b-real-time-values-imm.ashx>>.

<sup>60</sup> 151 FERC ¶ 61,208 at P 437 (2015).

limits can justify such operation and therefore remain eligible for make whole payments.<sup>61</sup>

A primary goal of the capacity performance market design is to assign performance risk to generation owners and to ensure that capacity prices reflect underlying supply and demand conditions, including the cost of mitigating the performance risk. The June 9<sup>th</sup> Order's determination on parameters is not consistent with that goal. By permitting generation owners to establish unit parameters based on nonphysical limits, the June 9<sup>th</sup> Order weakened the incentives for units to be flexible and weakened the assignment of performance risk to generation owners. Contractual limits and the option to choose from a range of gas pipeline tariff provisions, unlike generating unit operational limits, are a function of the interests and incentives of the generators making the choices. If a generation owner expects to be compensated through uplift payments for running for 24 hours regardless of whether the energy is economic or needed, that generation owner has no incentive to pay more to purchase the flexible gas service that would permit the unit to be flexible in response to dispatch.

The fact that a contract may be entered into by two willing parties, or that a generator chooses a specific type of service under the pipeline tariff does not mean that is the only possible arrangement between the two parties or that it is consistent with an efficient market outcome or that a contract or pipeline tariff term can reasonably impose costs on customers who were not party to the contract. The actual contractual or tariff terms are a function of the incentives and interests of the parties, who may be affiliates or have market power. The fact that a just and reasonable contract exists between a generation owner and a gas supplier does not mean that it is appropriate or efficient to impose the resultant costs on electric customers or that it incorporates an efficient allocation of performance risk between the generation owner and other market participants.

The approach to parameters defined in the June 9<sup>th</sup> Order will increase energy market uplift payments substantially. While some uplift is necessary and efficient in an LMP market, this uplift is not. Electric customers are not in a position to determine the terms of the contracts that resources enter into. Customers rely on the market rules to create incentives that protect

them by assigning operational risk to generators, who are in the best position to efficiently manage those risks.

The MMU recommends that capacity performance resources be held to the OEM operating parameters of the capacity market reference resource used for the Cost of New Entry (CONE) calculation for performance assessment and energy uplift payments and that this standard be applied to all technologies on a uniform basis. This solution creates the incentives for flexibility and preserves, to the extent possible, the incentives to follow PJM's dispatch instructions during high demand conditions. The proposed operating parameters should be based on the physical capability of the Reference Resource used in the Cost of New Entry, currently two GE Frame 7FA turbines with dual fuel capability. All resources that are less flexible than the reference resource are expected to be scheduled and running during high demand conditions anyway, while the flexible CTs that are used as peaking plants would still have the incentive to follow LMP and dispatch instructions. CCs would also have the capability to be as flexible as the reference resource. These units will be exempt from nonperformance charges and made whole as long as they perform in accordance with their parameters. This ensures that all the peaking units that are needed by PJM for flexible operation do not self schedule at their maximum output, and follow PJM dispatch instructions during high demand conditions. If any of the less flexible resources need to be dispatched down by PJM for reliability reasons, they would be exempt from nonperformance charges.

Such an approach is consistent with the Commission's no excuses policy for nonperformance because the flexibility target is set based on the optimal OEM-defined capability for the marginal resource that is expected to meet peak demand, which is consistent with the level of performance that customers are paying for in the capacity market. Any resource that is less flexible is not excused for nonperformance and any resource that meets the flexibility target is performing according to the commitments made in the capacity market.

The June 9<sup>th</sup> Order pointed out that the way to ensure that a resource's parameters are exposed to market consequences is to not allow any parameter limitations as an excuse for nonperformance. The same logic should apply to energy market uplift rules. A resource's

<sup>61</sup> *Id.* at P 440.



parameters should be exposed to market consequences and the resource should not be made whole if it is operating less flexibly than the reference resource. Paying energy market uplift on the basis of parameters consistent with the flexibility goals of the capacity performance construct would ensure that performance incentives are consistent across the capacity and energy markets and ensure that performance risk is appropriately assigned to generation owners.

### Parameter Impacts of Gas Pipeline Conditions

During extreme cold weather conditions, and more recently, also during hot weather conditions, a number of gas fired generators request temporary exceptions to parameter limits for their parameter limited schedules due to restrictions imposed by natural gas pipelines. The parameters affected include notification time, minimum run time (MRT) and turn down ratio (TDR, the ratio of economic maximum MW to economic minimum MW). When pipelines issue critical notices and enforce ratable take requirements, generators may, depending on the nature of the transportation service purchased, be forced to nominate an equal amount of gas for each hour in a 24 hour period, with penalties for deviating from the nominated quantity. This leads to requests for 24 hour minimum run times and turn down ratios close to 1.0, to avoid deviations from the hourly nominated quantity. The frequency of 24 hour minimum run time requests increased after Winter Storm Elliott in December 2022. Table 3-21 shows the number of units, and the installed capacity MW that submitted parameter exception requests for a 24 hour minimum run time due to gas pipeline restrictions. In 2024, there were 79 units in PJM with a total installed capacity of 10,476 MW that requested a 24 hour minimum run time on their parameter limited schedules based on pipeline restrictions.

**Table 3-21 Units with 24 hour minimum run times due to gas pipeline restrictions: 2018 through 2024**

Year	Number of Units With 24 Hour Minimum Run Time Exceptions	Installed Capacity (MW) With 24 Hour Minimum Run Time Exceptions
2018	25	3,627
2019	37	5,616
2020	13	3,873
2021	61	7,514
2022	81	10,019
2023	75	9,824
2024	79	10,476

The increase in units requesting 24 hour minimum run times is a result of pipelines enforcing the pipeline tariff ratable take provisions. Pipelines have the authority to require ratable takes under their tariffs at any time although pipelines do not enforce ratable takes on a routine basis. Some generators have also requested extremely long notification times based on pipeline nomination deadlines. (See Table 3-68.) When pipelines enforce these deadlines, generators cannot obtain gas to flow for a given market hour once the deadline has passed for that hour and therefore they cannot start according to their normal notification plus start times (normally less than 30 minutes). For example, at 1700 EPT, the next nomination cycle is intraday 3 (ID3). The ID3 deadline is 2000 EPT for gas to flow starting at 2300 EPT. When these nomination deadlines are enforced, at 1700 EPT, a gas unit can only start at 2300 EPT (or in 6 hours). This effectively increases the time to start (notification time plus start time) from 30 minutes to 6 hours. The long notification times make the units unavailable for commitment in ITSCED and the units can only be committed manually in real time. Generators may request temporary exceptions based on pipeline restrictions in order to provide PJM with offers that accurately reflect their capabilities. Units operating inflexibly due to pipeline restrictions are eligible for uplift. Temporary exceptions should be limited to the duration of restrictions imposed by pipelines.

In 2024, PJM paid \$30.2 million in Day-Ahead uplift to gas fired units with a 24 hour minimum run time, primarily during Winter Storm Gerri in the PEPCO Zone.

After observing the misuse of and the failure to use temporary exceptions during Winter Storm Elliott, on September 8, PJM and the MMU posted guidelines for the correct use of temporary exceptions for pipeline related restrictions. The guidelines detail exactly how units should use temporary exceptions to reflect pipeline restrictions in units' minimum run time, notification time and turn down ratio parameters.<sup>62</sup> During Winter Storm Elliott (December 22-24, 2022), 71 units on average (totaling 8,791 MW) requested temporary exceptions due to pipeline restrictions. During Winter Storm Gerri (January 16-18, 2024), 96 units on average (totaling 13,462 MW) requested temporary exceptions due to pipeline restrictions.

<sup>62</sup> See "Temporary Operating Parameter Limit (PLS) Exceptions due to Pipeline Restrictions" PJM and MMU memorandum to PJM Market Participants (September 8, 2023) <[https://www.monitoringanalytics.com/reports/Market\\_Messages/Messages/IMM\\_Temporary\\_Operating\\_Parameter\\_Limit\\_\(PLS\)\\_Exceptions\\_due\\_to\\_Pipeline\\_Restrictions\\_20230908.pdf](https://www.monitoringanalytics.com/reports/Market_Messages/Messages/IMM_Temporary_Operating_Parameter_Limit_(PLS)_Exceptions_due_to_Pipeline_Restrictions_20230908.pdf)>.



The MMU recognizes that pipeline restrictions must be reflected in units' operating parameters in order for PJM to properly schedule and manage the system but it is important to prevent abuse through the submission of inflexible parameters not based on actual constraints. The MMU recommends that PJM only approve temporary exceptions that are based on pipeline tariff terms and/or pipeline notices when actually enforced by the pipelines.

## Virtual Offers and Bids

Market participants may make virtual offers and bids in the PJM Day-Ahead Energy Market, and such offers and bids may be marginal.

Any market participant in the PJM Day-Ahead Energy Market can use increment offers, decrement bids, up to congestion transactions, import transactions and export transactions as financial instruments that do not require physical generation or load. Because virtual positions do not require physical generation or load, participants must buy or sell out of their virtual positions at real-time energy market prices. On February 20, 2018, FERC issued an order limiting the eligible bidding points for up to congestion transactions to hubs, interfaces and residual aggregate metered load nodes, and limiting the eligible bidding points for INCs and DEC to the same nodes plus active generation and load nodes.<sup>63</sup> Up to congestion transactions may be submitted between any two aggregates on a list of 46 aggregates eligible for up to congestion transaction bidding.<sup>64</sup> Import and export transactions may be submitted at any interface pricing point, where an import is equivalent to a virtual offer that is injected into PJM and an export is equivalent to a virtual bid that is withdrawn from PJM.

Figure 3-20 shows the PJM day-ahead daily aggregate supply curve of increment offers, the system aggregate supply curve of imports, the system aggregate supply curve without increment offers and imports, the system aggregate supply curve with increment offers, and the system aggregate supply curve with increment offers and imports for an example day in 2024.

**Figure 3-20 Day-ahead aggregate supply curves: 2024 example day**

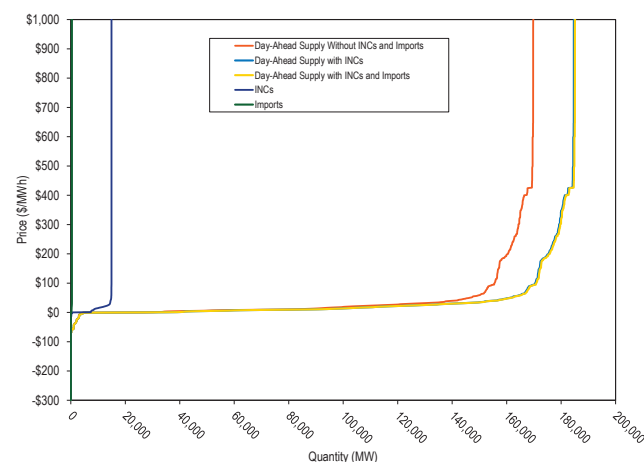


Table 3-22 shows the hourly average number of cleared and submitted increment offers and decrement bids by month in 2023 and 2024.<sup>65</sup> The hourly average submitted increment offer MW increased by 23.6 percent and cleared increment MW increased by 18.0 percent in 2024 compared to 2023. The hourly average submitted decrement bid MW increased by 22.2 percent and cleared decrement MW increased by 7.9 percent in 2024 compared to 2023.

<sup>63</sup> 162 FERC ¶ 61,139 (2018), *reh'g denied*, 164 FERC ¶ 61,170 (2018).

<sup>64</sup> Prior to November 1, 2012, market participants were required to specify an interface pricing point as the source for imports, an interface pricing point as the sink for exports or an interface pricing point as both the source and sink for transactions wheeling through PJM. For the list of eligible sources and sinks for up to congestion transactions, see [www.pjm.com/~media/etools/oasis/references/oasis-source-sink-link.xls](http://www.pjm.com/~media/etools/oasis/references/oasis-source-sink-link.xls).

<sup>65</sup> Table 3-22 uses cleared day-ahead market data while final settlements data is used elsewhere in this report.

**Table 3-22 Average hourly number of cleared and submitted INCs and DEC's by month: January 2023 through December 2024**

		Increment Offers				Decrement Bids			
Year		Average Cleared MW	Average Submitted MW	Average Cleared Volume	Average Submitted Volume	Average Cleared MW	Average Submitted MW	Average Cleared Volume	Average Submitted Volume
2023	Jan	3,870	7,847	319	949	4,421	9,941	307	1,076
2023	Feb	4,994	9,786	426	1,190	4,583	9,732	258	933
2023	Mar	4,578	9,008	415	1,068	4,613	11,030	316	1,113
2023	Apr	4,960	10,697	374	1,036	3,515	9,803	275	1,091
2023	May	4,648	9,200	393	1,050	4,126	10,193	284	984
2023	Jun	4,171	8,328	374	1,008	5,515	11,400	426	1,272
2023	Jul	3,421	8,403	278	952	5,725	11,608	593	1,590
2023	Aug	3,177	8,604	283	953	6,267	11,679	337	1,013
2023	Sep	3,939	9,612	366	1,060	5,472	11,539	291	961
2023	Oct	5,832	11,275	463	1,270	4,072	10,237	281	1,010
2023	Nov	4,874	9,017	429	1,375	3,867	8,637	238	884
2023	Dec	4,620	9,610	404	1,382	4,771	9,689	273	958
2023	Annual	4,418	9,277	376	1,107	4,748	10,464	324	1,075
2024	Jan	4,660	10,515	402	1,499	5,161	11,668	287	1,113
2024	Feb	5,716	12,429	487	1,789	5,063	10,952	275	1,039
2024	Mar	6,040	12,378	426	1,422	5,802	12,563	334	1,202
2024	Apr	5,848	11,972	480	1,248	5,055	11,940	385	1,204
2024	May	5,634	11,961	452	1,241	5,213	13,453	397	1,445
2024	Jun	4,627	10,503	420	1,176	5,468	13,163	362	1,290
2024	Jul	4,042	10,177	392	1,177	5,360	13,376	421	1,416
2024	Aug	3,802	9,767	373	1,107	6,269	13,946	496	1,432
2024	Sep	3,640	9,507	396	1,225	5,588	13,517	467	1,646
2024	Oct	5,091	11,262	509	1,530	4,351	13,985	424	1,946
2024	Nov	5,136	11,621	437	1,461	4,491	13,307	414	1,731
2024	Dec	5,570	12,681	479	1,705	5,686	15,190	493	2,037
2024	Annual	4,982	11,228	438	1,381	5,295	13,101	397	1,461

Table 3-23 shows the average hourly number of up to congestion transactions and the average hourly MW by month in 2023 and 2024. The hourly average submitted up to congestion bid MW decreased by 54.9 percent and cleared up to congestion bid MW decreased by 46.0 percent in 2024 compared to 2023.

**Table 3-23 Average hourly cleared and submitted up to congestion bids by month: January 2023 through December 2024**

		Up to Congestion			
Year		Average Cleared MW	Average Submitted MW	Average Cleared Volume	Average Submitted Volume
2023	Jan	23,708	69,113	952	2,522
2023	Feb	24,242	87,218	1,003	3,156
2023	Mar	24,834	115,463	961	3,942
2023	Apr	30,027	129,360	1,043	3,719
2023	May	27,910	110,474	1,053	3,251
2023	Jun	26,248	90,763	1,106	3,242
2023	Jul	18,777	59,561	1,011	2,715
2023	Aug	12,567	36,486	830	2,035
2023	Sep	12,574	34,771	686	1,539
2023	Oct	10,810	34,122	580	1,402
2023	Nov	14,929	38,277	685	1,460
2023	Dec	13,494	31,414	638	1,339
2023	Annual	19,964	69,561	878	2,522
2024	Jan	13,905	35,217	787	1,667
2024	Feb	12,773	30,008	563	1,307
2024	Mar	14,401	37,663	600	1,432
2024	Apr	10,922	35,180	535	1,443
2024	May	9,073	29,896	627	1,567
2024	Jun	9,810	26,251	638	1,365
2024	Jul	8,721	27,022	757	1,532
2024	Aug	9,016	27,970	841	1,575
2024	Sep	10,489	31,088	782	1,631
2024	Oct	10,684	33,321	670	1,611
2024	Nov	9,093	30,131	533	1,438
2024	Dec	10,442	32,473	748	1,790
2024	Annual	10,774	31,366	675	1,532


Table 3-24 shows the average hourly number of day-ahead import and export transactions and the average hourly MW in 2023 and 2024.<sup>66</sup> In 2024, the average hourly submitted import transaction MW decreased by 1.4 percent and the average hourly cleared import transaction MW decreased by 4.3 percent compared to 2023. In 2024, the average hourly submitted export transaction MW decreased by 5.4 percent and the average hourly cleared export transaction MW decreased by 6.1 percent compared to 2023.

**Table 3-24 Hourly average day-ahead number of cleared and submitted import and export transactions by month: January 2023 through December 2024**

Year	Month	Imports				Exports			
		Average Cleared MW	Average Submitted MW	Average Cleared Volume	Average Submitted Volume	Average Cleared MW	Average Submitted MW	Average Cleared Volume	Average Submitted Volume
2023	Jan	740	843	7	8	3,879	3,944	28	28
2023	Feb	646	696	6	6	4,065	4,087	29	29
2023	Mar	371	403	3	4	3,740	3,780	28	29
2023	Apr	368	377	4	4	3,041	3,055	25	26
2023	May	355	373	4	4	2,902	2,904	21	21
2023	Jun	319	333	4	4	4,488	4,497	32	32
2023	Jul	154	165	3	3	4,610	4,637	34	35
2023	Aug	124	134	2	2	4,666	4,675	34	34
2023	Sep	205	247	3	4	4,040	4,068	29	30
2023	Oct	647	750	7	8	3,171	3,199	22	23
2023	Nov	540	647	6	7	3,559	3,597	30	31
2023	Dec	241	321	3	4	4,571	4,585	34	35
2023	Annual	392	440	4	5	3,894	3,919	29	29
2024	Jan	322	394	4	5	4,561	4,590	33	34
2024	Feb	353	411	4	4	4,132	4,146	31	31
2024	Mar	345	375	5	5	3,912	3,917	34	35
2024	Apr	250	277	4	4	3,200	3,235	23	23
2024	May	400	422	5	5	2,812	2,828	21	21
2024	Jun	179	196	3	3	4,585	4,599	35	36
2024	Jul	304	344	4	5	3,820	3,850	27	28
2024	Aug	295	335	4	5	4,112	4,160	28	29
2024	Sep	258	275	4	5	3,387	3,474	25	26
2024	Oct	731	783	9	9	2,662	2,723	23	24
2024	Nov	477	650	6	8	2,695	2,716	26	26
2024	Dec	504	680	5	6	3,987	4,257	36	37
2024	Annual	375	434	5	5	3,655	3,708	29	29

Figure 3-21 shows the monthly volume of bid and cleared INC, DEC and up to congestion bids by month from 2005 through December 2024. Cleared volumes were greater in 2023 than any year since 2020, when uplift charges for up to congestion transactions took effect on November 1, 2020. The monthly MW volume of UTC bids in April 2023 was at its highest level since 2017, but decreased significantly beginning May 2023 and has remained stable beginning August 2023 through December 2024.

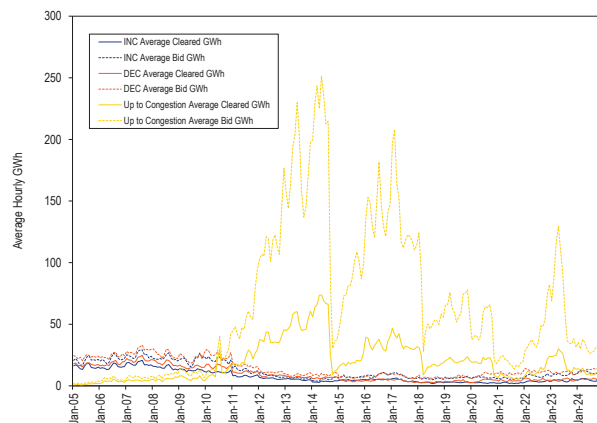
**Figure 3-21 Monthly bid and cleared INCs, DEC and UTCs (GWh): January 2005 through December 2024**



<sup>66</sup> Table 3-24 uses cleared day-ahead market data, while final settlements data is used elsewhere in this report.

Figure 3-22 shows the daily volume of bid and cleared INC, DEC and up to congestion bids from January 2023 through December 2024.

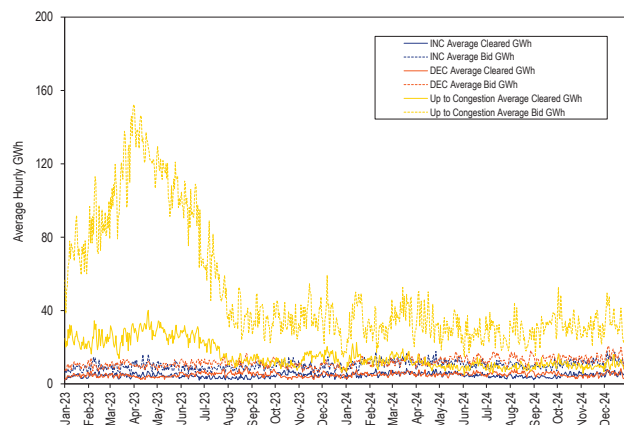**Figure 3-22 Daily bid and cleared INCs, DEC, and UTCs (GWh): January 2023 through December 2024**



In order to evaluate the ownership of virtual bids, the MMU categorizes all participants making virtual bids in PJM as either physical or financial. Physical entities include utilities and customers that primarily take physical positions in PJM markets. Financial entities include banks and hedge funds that primarily take financial positions in PJM markets. International market participants that primarily take financial positions in PJM markets are considered to be financial entities even if they are utilities in their own countries. Financial entities' share of cleared MWh of INCs and DEC in 2024 increased 1.4 percent compared to 2023, and continued to make up the majority of all INCs and DEC.

Table 3-25 shows, in 2023 and 2024, the total increment offers and decrement bids and cleared MW by type of parent organization.

**Table 3-25 INC and DEC bids and cleared MWh by type of parent organization (MWh): January through December, 2023 and 2024**

Category	2023				2024			
	Total Virtual Bid MWh	Percent	Total Virtual Cleared MWh	Percent	Total Virtual Bid MWh	Percent	Total Virtual Cleared MWh	Percent
Financial	156,697,905	90.6%	67,323,444	83.8%	197,265,322	92.3%	76,977,531	85.3%
Physical	16,234,228	9.4%	12,976,658	16.2%	16,443,681	7.7%	13,292,731	14.7%
Total	172,932,133	100.0%	80,300,102	100.0%	213,709,003	100.0%	90,270,262	100.0%

Table 3-26 shows the total up to congestion bid and cleared MWh by type of parent organization in 2023 and 2024 by month. Up to congestion bids submitted by financial entities decreased significantly in 2024 compared to 2023, from 606.1 million MWh to 269.4 million MWh, while up to congestion bids submitted by physical entities increased by 2.8 million MWh. Financial entities submitted 97.8 percent of all up to congestion bids, down from 99.5 percent, and cleared 97.8 percent of all up to congestion bids, down from 98.8 percent. In 2024, almost all up to congestion trading activity was by financial participants.

**Table 3-26 Up to congestion transactions by type of parent organization (MWh): 2023 and 2024**

Category	2023				2024			
	Total Up to Congestion Bid MWh	Percent	Total Up to Congestion Cleared MWh	Percent	Total Up to Congestion Bid MWh	Percent	Total Up to Congestion Cleared MWh	Percent
Financial	606,126,895	99.5%	172,797,198	98.8%	269,446,396	97.8%	91,282,692	96.5%
Physical	3,223,571	0.5%	2,086,789	1.2%	6,069,544	2.2%	3,352,487	3.5%
Total	609,350,466	100.0%	174,883,987	100.0%	275,515,940	100.0%	94,635,178	100.0%

Table 3-27 shows the total import and export transactions by type of parent organization in 2023 and 2024. The majority of import and export transactions in both day ahead and real time were submitted by physical entities in 2024.

**Table 3-27 Import and export transactions by type of parent organization (MWh): 2023 and 2024**

		2023		2024	
Category		Total Import and Export MWh		Total Import and Export MWh	
		Percent		Percent	
Day-Ahead	Financial	11,900,657	32.0%	9,563,003	27.1%
	Physical	25,259,700	68.0%	25,673,098	72.9%
	Total	37,160,357	100.0%	35,236,101	100.0%
Real-Time	Financial	17,974,299	25.7%	15,996,783	24.9%
	Physical	51,841,862	74.3%	48,175,482	75.1%
	Total	69,816,160	100.0%	64,172,265	100.0%

Table 3-28 shows the top 10 locations by total cleared INC and DEC MWh in 2023 and 2024. The top 10 locations included four hubs, four interface pricing points, and two residual metered load aggregates.

**Table 3-28 Virtual offers and bids by top 10 locations (MWh): January through December, 2023 and 2024**

2023					2024				
Aggregate/Bus Name	Aggregate/Bus Type	INC MWh	DEC MWh	Total MWh	Aggregate/Bus Name	Aggregate/Bus Type	INC MWh	DEC MWh	Total MWh
MISO	INTERFACE	232,220	8,159,891	8,392,111	WESTERN HUB	HUB	3,306,443	2,150,025	5,456,468
WESTERN HUB	HUB	4,013,716	2,394,533	6,408,248	MISO	INTERFACE	200,925	4,212,875	4,413,800
SOUTH	INTERFACE	3,466,344	471,858	3,938,202	SOUTH	INTERFACE	3,630,636	472,798	4,103,434
N ILLINOIS HUB	HUB	1,839,079	687,459	2,526,539	N ILLINOIS HUB	HUB	2,692,615	779,736	3,472,351
DOM_RESID_AGG	RESIDUAL METERED EDC	231,323	2,268,107	2,499,430	NYIS	INTERFACE	677,691	1,972,771	2,650,461
NYIS	INTERFACE	651,564	1,437,517	2,089,081	AEP-DAYTON HUB	HUB	914,264	1,415,935	2,330,200
LINDENVFT	INTERFACE	32,069	1,773,299	1,805,367	DOM_RESID_AGG	RESIDUAL METERED EDC	310,119	1,508,116	1,818,235
AEP-DAYTON HUB	HUB	870,158	891,838	1,761,996	LINDENVFT	INTERFACE	35,443	1,625,458	1,660,900
BGE_RESID_AGG	RESIDUAL METERED EDC	466,859	997,169	1,464,028	BGE_RESID_AGG	RESIDUAL METERED EDC	507,130	1,083,765	1,590,894
EASTERN HUB	HUB	266,830	777,894	1,044,724	EASTERN HUB	HUB	377,483	929,838	1,307,321
Top ten total		12,070,161	19,859,564	31,929,725			12,652,749	16,151,317	28,804,065
PJM total		38,704,078	41,596,024	80,300,102			43,759,047	46,511,215	90,270,262
Top ten total as percent of PJM total		31.2%	47.7%	39.8%			28.9%	34.7%	31.9%



Table 3-29 shows up to congestion transactions for the top 10 source and sink pairs and associated source, sink and overall profits on each path in 2023 and 2024. Total profits for up to congestion transactions in 2024 were \$0.2 million, a decrease of 99.4 percent compared to profits of \$41.2 million in 2023.<sup>67</sup> The UTCs from DOMINION HUB to DOM\_RESID\_AGG constituted 10.3 percent of all UTC volume in 2024, despite losing \$5.7 million.

**Table 3-29 Cleared up to congestion bids by top 10 source and sink pairs (MWh): 2023 and 2024<sup>68</sup>**

2023							
Top 10 Paths by Cleared MWh							
Source	Source Type	Sink	Sink Type	Cleared MW	Source Revenue	Sink Revenue	UTC Profit
DOMINION HUB	HUB	DOM_RESID_AGG	AGGREGATE	37,091,596	\$29,331,269	\$1,374,633	\$22,748,666
AEP GEN HUB	HUB	EKPC_RESID_AGG	AGGREGATE	5,691,101	\$3,414,773	(\$775,593)	\$1,523,495
CHICAGO GEN HUB	HUB	AEPI_M_RESID_AGG	AGGREGATE	4,882,193	\$4,910,522	(\$2,005,043)	\$1,957,894
CHICAGO GEN HUB	HUB	MISO	INTERFACE	3,616,885	\$2,294,702	(\$1,803,739)	(\$175,370)
CHICAGO GEN HUB	HUB	CHICAGO HUB	HUB	3,008,529	\$3,551,163	(\$3,008,130)	\$4,598
CHICAGO GEN HUB	HUB	EKPC_RESID_AGG	AGGREGATE	2,691,535	\$2,265,240	(\$202,247)	\$1,459,537
COMED_RESID_AGG	AGGREGATE	AEPI_M_RESID_AGG	AGGREGATE	2,298,131	\$1,888,629	(\$1,032,468)	\$499,896
APS_RESID_AGG	AGGREGATE	DOM_RESID_AGG	AGGREGATE	2,169,528	\$3,110,470	(\$90,455)	\$2,506,878
AEP GEN HUB	HUB	DOM_RESID_AGG	AGGREGATE	1,927,663	\$2,248,276	\$70,000	\$1,809,806
CHICAGO GEN HUB	HUB	OHIO HUB	HUB	1,854,636	\$1,565,236	(\$1,382,464)	(\$201,919)
Top ten total				65,231,797	\$54,580,281	(\$8,855,506)	\$32,133,479
PJM total				174,883,987	\$183,734,980	(\$106,355,194)	\$41,200,757
Top ten total as percent of PJM total				37.3%	29.7%	8.3%	78.0%
2024							
Top 10 Paths by Cleared MWh							
Source	Source Type	Sink	Sink Type	Cleared MWh	Source Revenue	Sink Revenue	UTC Profit
DOMINION HUB	HUB	DOM_RESID_AGG	AGGREGATE	9,756,243	\$9,264,445	(\$11,147,212)	(\$5,746,334)
CHICAGO GEN HUB	HUB	CHICAGO HUB	HUB	4,654,340	(\$1,341,325)	\$5,041,029	\$1,887,727
CHICAGO GEN HUB	HUB	AEPI_M_RESID_AGG	AGGREGATE	4,605,852	\$2,657,880	\$2,469,216	\$3,722,900
AEP GEN HUB	HUB	EKPC_RESID_AGG	AGGREGATE	2,190,684	\$7,928	\$984,868	\$273,766
CHICAGO GEN HUB	HUB	OHIO HUB	HUB	2,020,702	\$2,149,155	\$106,743	\$1,530,013
CHICAGO GEN HUB	HUB	EKPC_RESID_AGG	AGGREGATE	1,847,495	\$3,257,362	(\$851,697)	\$1,594,699
CHICAGO GEN HUB	HUB	MISO	INTERFACE	1,735,806	(\$277,141)	\$305,641	(\$510,402)
CHICAGO GEN HUB	HUB	DEOK_RESID_AGG	AGGREGATE	1,309,861	\$1,551,688	(\$566,589)	\$429,895
CHICAGO GEN HUB	HUB	N ILLINOIS HUB	HUB	1,299,384	(\$2,671,649)	\$4,027,767	\$835,085
UGI_RESID_AGG	AGGREGATE	NYIS	INTERFACE	1,164,041	(\$834,046)	\$1,169,731	(\$114,519)
Top ten total				30,584,407	\$13,764,297	\$1,539,497	\$3,902,829
PJM total				94,635,178	\$63,022,670	(\$24,820,745)	\$236,398
Top ten total as percent of PJM total				32.3%	21.8%	(6.2%)	1,651.0%

Table 3-30 shows the average daily number of distinct source-sink pairs that were offered and cleared each month from January 2023 through December 2024. The average number of submitted source-sink pairs per day decreased from 1,624 source-sink pairs submitted in 2023 to 1,250 in 2024. The average number of cleared source-sink pairs per day decreased from 1,257 in 2023 to 1,008 per day in 2024.

<sup>67</sup> The source and sink aggregates in these tables refer to the name and location of a bus and do not include information about the behavior of any individual market participant.

<sup>68</sup> The columns "Source Revenue" and "Sink Revenue" are totals before uplift charges are subtracted. The column "UTC Profit" includes uplift charges, in addition to the source and sink revenue, and so is less than the sum of the revenue from each side of the transaction.

**Table 3-30 Number of offered and cleared UTC source and sink pairs: January 2023 through December 2024**

Daily Number of Source-Sink Pairs					
Year	Month	Average Offered	Max Offered	Average Cleared	Max Cleared
2023	Jan	1,558	1,723	1,239	1,480
2023	Feb	1,705	1,812	1,326	1,522
2023	Mar	1,803	1,922	1,318	1,561
2023	Apr	1,756	1,909	1,327	1,550
2023	May	1,729	1,930	1,321	1,646
2023	Jun	1,820	1,886	1,416	1,607
2023	Jul	1,857	1,959	1,475	1,643
2023	Aug	1,748	1,907	1,372	1,657
2023	Sep	1,607	1,853	1,251	1,605
2023	Oct	1,465	1,752	1,121	1,392
2023	Nov	1,223	1,660	997	1,406
2023	Dec	1,212	1,474	921	1,266
2023	Annual	1,624	1,816	1,257	1,528
2024	Jan	1,298	1,521	1,047	1,347
2024	Feb	1,166	1,364	810	991
2024	Mar	1,062	1,333	745	1,014
2024	Apr	1,095	1,414	788	1,021
2024	May	1,241	1,560	934	1,325
2024	Jun	1,194	1,528	969	1,377
2024	Jul	1,308	1,520	1,165	1,317
2024	Aug	1,265	1,572	1,129	1,486
2024	Sep	1,271	1,462	1,130	1,319
2024	Oct	1,363	1,563	1,176	1,363
2024	Nov	1,323	1,485	1,039	1,294
2024	Dec	1,418	1,729	1,167	1,486
2024	Annual	1,250	1,504	1,008	1,278

Table 3-31 and Figure 3-23 show total cleared up to congestion transactions and the share of the top 10 up to congestion paths by transaction type (import, export, wheel, or internal) in 2023 and 2024. Total cleared up to congestion transactions decreased by 45.9 percent from 174.9 million MWh in 2023 to 94.6 million MWh in 2024. Internal up to congestion transactions in 2024 were 83.1 percent of all up to congestion transactions, a decrease from 84.9 percent in 2023.

**Table 3-31 Cleared up to congestion transactions and share of top 10 paths by type (MW):2023 and 2024**

2023					
Cleared Up to Congestion Bids					
	Import	Export	Wheel	Internal	Total
Top ten total (MW)	5,890,651	8,097,070	2,489,740	63,282,170	79,759,631
PJM total (MW)	10,071,049	13,650,354	2,743,377	148,419,207	174,883,987
Top ten total as percent of PJM total	58.5%	59.3%	90.8%	42.6%	45.6%
PJM total as percent of all up to congestion transactions	5.8%	7.8%	1.6%	84.9%	100.0%
2024					
Cleared Up to Congestion Bids					
	Import	Export	Wheel	Internal	Total
Top ten total (MW)	3,417,382	4,450,811	1,899,273	29,694,125	39,461,590
PJM total (MW)	6,716,121	7,235,170	2,052,939	78,630,949	94,635,178
Top ten total as percent of PJM total	50.9%	61.5%	92.5%	37.8%	41.7%
PJM total as percent of all up to congestion transactions	7.1%	7.6%	2.2%	83.1%	100.0%

Figure 3-23 shows the total volume of import, export, wheel, and internal up to congestion transactions by month from January 2005 through December 2024. An initial increase and continued increase in internal up to congestion transactions by month followed the November 1, 2012, rule change permitting such transactions, until September 8, 2014. The reduction in up to congestion transactions (UTC) that followed a FERC order setting September 8, 2014, as the effective date for any uplift charges subsequently assigned to UTCs, was reversed.<sup>69</sup> There was an increase in up to congestion volume as a result of the expiration of the 15 month refund period for the proceeding related to uplift charges for UTC transactions. In 2018, total UTC activity and the percent of marginal up to congestion transactions again decreased significantly as the result of a FERC order issued on February 20, 2018, and implemented on February 22, 2018.<sup>70</sup> The order limited UTC trading to hubs, residual metered load, and interfaces. UTC activity increased following that reduction.

UTC activity decreased again beginning November 1, 2020, after a FERC order requiring UTCs to pay day-ahead and balancing operating reserve charges equivalent to a DEC at the UTC sink point became effective on that date.<sup>71</sup> In 2022 and the first six months of 2023, the volume of cleared UTCs increased significantly, primarily internal transactions. The volume of cleared UTCs decreased consistently July 2023 through December 2024.

69 See 162 FERC ¶ 61,139 (2018), *reh'g denied*, 164 FERC ¶ 61,170 (2018).

70 *Id.*

71 See 172 FERC ¶ 61,046 (2020).

**Figure 3-23 Monthly cleared up to congestion transactions by type (GWh): January 2005 through December 2024**


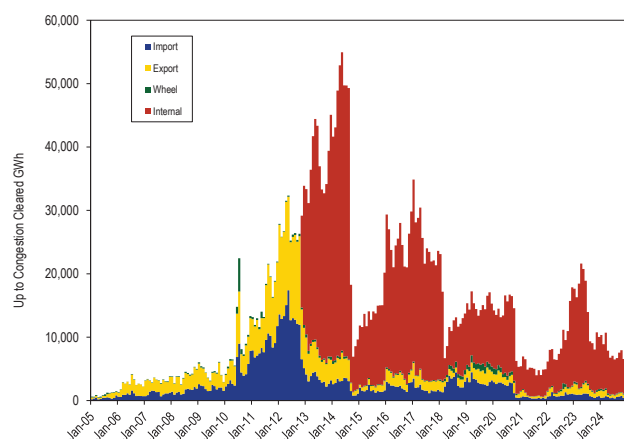


Figure 3-24 shows the daily cleared up to congestion GWh by transaction type from January 1, 2023, through December 31, 2024. In 2024, the total cleared GWh of import and export transactions remained relatively unchanged, while internal up to congestion transactions decreased significantly compared to 2023.

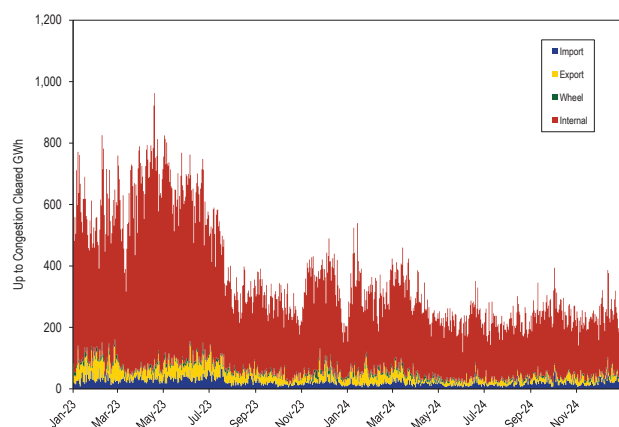**Figure 3-24 Daily cleared up to congestion transaction by type (GWh): January 2023 through December 2024**



One of the goals of the February 2018 FERC order accepting PJM's proposal limiting UTC bidding to hubs, interfaces and residual aggregate metered load nodes, and limiting INC and DEC bidding to the same nodes plus active generation nodes, was to limit the opportunities for traders to profit from opportunities for false arbitrage in which price spreads between the day-ahead and real-time energy markets result from

differences in the models used to operate each market that cannot be corrected through virtual bidding.<sup>72</sup>

A key assumption underlying the February 2018 order was that the limited set of nodes available for virtual trading is sufficiently protected from false arbitrage trades because price spreads resulting from modeling differences between the day-ahead and real-time markets are mitigated by the averaging of prices over a large number of buses at aggregate nodes.<sup>73</sup> This assumption is not correct, given the large share of INC, DEC, and UTC profits still attributable to modeling or operational differences between day-ahead and real-time models since the February 2018 order.

The assumption that modeling differences are averaged out over the multiple individual nodes included in aggregate nodes does not hold for multiple aggregate nodes in the current list of available up to congestion bidding nodes. The MMU recommends eliminating up to congestion (UTC) bidding at pricing nodes that aggregate only small sections of transmission zones with few physical assets. For example, the MMU recommends eliminating UTC bidding at the following pricing points: DPLEASTON\_RESID\_AGG, PENNPOWER\_RESID\_AGG, UGI\_RESID\_AGG, SMECO\_RESID\_AGG, AEPKY\_RESID\_AGG, and VINELAND\_RESID\_AGG.

Prices at larger aggregate nodes can also be affected by transmission constraints, especially when constraints are violated and transmission penalty factors are applied in the real-time energy market. Even when the same constraints are modeled in day ahead and real time, constraint violations in real time may result from differences in the day-ahead and real-time operational environments such as intra hourly ramping limitations, changes to constraint limits, and unit commitments and decommitments. Price spreads due to modeling or operational differences can be significant, even when averaged over an aggregate node, and may persist for days or weeks. Virtual traders can often identify and profit from price spreads resulting from systematic modeling and operational differences between day-

<sup>72</sup> PJM Interconnection, LLC, "Proposed Revisions To Reduce Bidding Points for Virtual Transactions," Docket No. ER18-88, October 17, 2017 at 9-10: "Discrepancies between the models can occur for various reasons despite PJM's best attempts to minimize them...Because individual nodes are more highly impacted by modeling discrepancies than aggregated locations due to averaging, they are often locations where Virtual Transactions can profit. Profits collected by Virtual Transactions in these cases lead to additional costs for PJM members without any benefits."

<sup>73</sup> 162 FERC ¶ 61,139 at PP 35-36 ("We accept PJM's proposal to limit eligible bidding points for UTCs to hubs, residual metered load, and interfaces. First, we agree with the IMM's statement that PJM's proposal to limit the UTC bid locations to interfaces, zones, and hubs will minimize false arbitrage opportunities for UTCs currently being pursued through penny bids, as the effect of modeling differences between the day-ahead and real-time markets are minimized at these aggregates").

ahead and real-time affecting specific generators or aggregate nodes. The MMU recommends eliminating INC, DEC, and UTC bidding at pricing nodes that allow market participants to profit from modeling issues.

## Market Performance

PJM locational marginal prices (LMPs) are a direct measure of market performance. The market performs optimally when the market structure provides incentives for market participants to behave competitively. In a competitive market, prices equal the short run marginal cost of the marginal unit of output and reflect the most efficient and least cost allocation of resources to meet demand.

### LMP

The behavior of individual market entities within a market structure is reflected in market prices. PJM locational marginal prices (LMPs) are a direct measure of market performance. Price level is a good, general indicator of market performance, although overall price results must be interpreted carefully because of the multiple factors that affect them. Among other things, overall average prices reflect changes in supply and demand, generation fuel mix, the cost of fuel, emission related expenses, markup and local price differences caused by congestion. PJM also may administratively set prices with shortage pricing, the creation of closed loop interfaces related to demand side resources, surrogate constraints for reactive power and generator stability, or influence prices through manual interventions such as load biasing, changing constraint limits and transmission constraint penalty factors, and committing reserves beyond the requirement, or change price formation through fast start pricing.

The real-time average LMP in 2024 increased \$1.63 per MWh, or 5.5 percent from 2023, from \$29.69 per MWh to \$31.32 per MWh. The real-time load-weighted average LMP in 2024 increased \$2.66 per MWh, or 8.5 percent from 2023, from \$31.08 per MWh to \$33.74 per MWh.

The costs of fuel, emissions, and consumables, fundamental components of the real-time load-weighted average LMP, increased \$0.50 per MWh from \$19.56 per MWh in 2023 to \$20.06 per MWh in 2024, or 18.9 percent of the increase in real-time load-weighted average LMP.

The day-ahead average LMP for 2024 increased \$1.03 per MWh, or 3.4 percent from 2023, from \$30.38 per MWh to \$31.41 per MWh. The day-ahead load-weighted average LMP for 2024 increased \$1.86 or 5.8 percent from 2023, from \$31.93 per MWh to \$33.79 per MWh.

Occasionally, in a constrained market, the LMPs at some pricing nodes can exceed the offer price of the highest cleared generator in the supply curve.<sup>74</sup> In the nodal pricing system, the LMP at a pricing node is the total cost of meeting incremental demand at that node. When there are binding transmission constraints, satisfying the marginal increase in demand at a node may require increasing the output of some generators while simultaneously decreasing the output of other generators, such that the transmission constraints are not violated. The total cost of redispatching multiple generators can at times exceed the cost of marginally increasing the output of the most expensive generator offered. Thus, the LMPs at some pricing nodes exceed \$1,000 per MWh, the cap on the generators' offer price in the PJM market.<sup>75</sup>

LMP may, at times, be set by administratively defined transmission constraint penalty factors, which equal a default level of \$30,000 per MWh in the day-ahead market dispatch run and \$2,000 per MWh in the real-time market and in the day-ahead market pricing run. When a transmission constraint is binding and there are no generation alternatives to resolve the constraint, the transmission limits may be violated in the market dispatch solution. When this occurs, the shadow price of the constraint is set by transmission constraint penalty factors. The shadow price directly affects the LMP. Transmission constraint penalty factors are administratively determined and can be thought of as a form of locational scarcity pricing. But PJM operator interventions to reduce the control limits on transmission constraint line ratings used in the market clearing unnecessarily trigger transmission constraint penalty factors and significantly increase prices. A competitive market does not require that prices increase when PJM artificially triggers transmission constraint penalty factors.

<sup>74</sup> See O'Neill R. P., Mead D. and Malvadkar P. "On Market Clearing Prices Higher than the Highest Bid and Other Almost Paranormal Phenomena." *The Electricity Journal* 2005; 18(2) at 19–27.

<sup>75</sup> The offer cap in PJM was temporarily increased to \$1,800 per MWh prior to the winter of 2014/2015. A new cap of \$2,000 per MWh, only for offers with costs exceeding \$1,000 per MWh, went into effect on December 14, 2015. See 153 FERC ¶ 61,289 (2015).

## Fast Start Pricing: DLMP and PLMP

PJM implemented fast start pricing in both the day-ahead and real-time markets on September 1, 2021. Fast start pricing is based on a new and incorrect LMP calculation called the pricing run. The pricing run LMP (PLMP) is now the official settlement LMP in PJM, replacing the dispatch run LMP (DLMP). Unless otherwise specified, the LMP tables and figures show the PLMP for September 1, 2021, and after.

The pricing run calculates LMP using the same optimal power flow algorithm as the dispatch run while simultaneously ignoring (relaxing) the economic minimum and maximum output MW constraints for all eligible fast start units. Fast start units must have notification time plus start time less than or equal to one hour; minimum run time less than or equal to one hour; and can set price only when online and running for PJM, not self scheduled.

The goal of fast start pricing is to allow inflexible resources to set prices based on the sum of their commitment costs per MWh and their marginal costs. The price signal no longer equals the short run marginal cost and therefore no longer provides the correct signal for efficient behavior for market participants making decisions on the margin, whether resources, load, interchange transactions, or virtual traders. Units that start in one hour are not actually fast start units, and their commitment costs are not marginal in a five minute market. The differences between the actual LMP and the fast start LMP distort the incentive for market participants to behave competitively and to follow PJM's dispatch instructions. PJM is paying new forms of uplift in an attempt to counter the distorted incentives inherent in fast start pricing.

PJM has also introduced other differences between the dispatch run and pricing run that are not related to fast start pricing. For example, in the day-ahead market, PJM uses a default \$30,000 per

MWh transmission constraint penalty factor in the dispatch run and a \$2,000 per MWh transmission constraint penalty factor in the pricing run. Starting on October 1, 2022, PJM uses capping of the system marginal price only in the pricing run, which affected real-time market prices during Winter Storm Elliott in December 2022. This price calculation has not been reviewed by FERC or included in the PJM Operating Agreement. Every difference between the dispatch run and the pricing run introduces inefficiency in the market.

## DLMP and PLMP

Table 3-32 shows the day-ahead and real-time monthly load-weighted average PLMP and DLMP in 2023 and 2024.

The real-time load-weighted average PLMP was \$33.74 per MWh in 2024, which is 7.7 percent, \$2.43 per MWh, higher than the real-time load-weighted average DLMP of \$31.31 per MWh.

The day-ahead load-weighted average PLMP was \$33.79 per MWh in 2024, which is 0.2 percent, \$0.07 per MWh, higher than the day-ahead load-weighted average DLMP of \$33.72 per MWh.


**Table 3-32 Day-ahead and real-time load-weighted average DLMP and PLMP: 2023 through 2024**

		Day-Ahead Load-Weighted Average				Real-Time Load-Weighted Average			
				Percent				Percent	
Year	Month	DLMP	PLMP	Difference	Difference	DLMP	PLMP	Difference	Difference
2023	Jan	\$36.53	\$36.58	\$0.05	0.1%	\$34.66	\$35.75	\$1.09	3.1%
2023	Feb	\$31.16	\$31.22	\$0.06	0.2%	\$25.47	\$26.04	\$0.57	2.2%
2023	Mar	\$28.39	\$28.41	\$0.02	0.1%	\$27.58	\$28.42	\$0.85	3.1%
2023	Apr	\$29.81	\$29.81	(\$0.00)	(0.0%)	\$27.09	\$29.32	\$2.22	8.2%
2023	May	\$28.86	\$28.80	(\$0.05)	(0.2%)	\$25.91	\$28.44	\$2.53	9.7%
2023	Jun	\$27.82	\$27.82	(\$0.00)	(0.0%)	\$25.69	\$27.29	\$1.60	6.2%
2023	Jul	\$40.46	\$40.56	\$0.10	0.3%	\$34.34	\$37.21	\$2.87	8.4%
2023	Aug	\$30.49	\$30.54	\$0.05	0.2%	\$29.77	\$31.33	\$1.55	5.2%
2023	Sep	\$30.82	\$30.91	\$0.09	0.3%	\$29.33	\$31.55	\$2.22	7.6%
2023	Oct	\$35.15	\$35.17	\$0.02	0.1%	\$30.61	\$34.77	\$4.16	13.6%
2023	Nov	\$33.32	\$33.40	\$0.08	0.2%	\$30.40	\$32.94	\$2.54	8.3%
2023	Dec	\$27.97	\$28.00	\$0.03	0.1%	\$26.37	\$27.97	\$1.59	6.0%
2023		\$31.89	\$31.93	\$0.04	0.1%	\$29.11	\$31.08	\$1.97	6.8%
2024	Jan	\$48.45	\$48.65	\$0.20	0.4%	\$40.82	\$42.78	\$1.95	4.8%
2024	Feb	\$23.67	\$23.70	\$0.03	0.1%	\$23.20	\$24.86	\$1.66	7.2%
2024	Mar	\$21.89	\$21.93	\$0.04	0.2%	\$20.30	\$23.15	\$2.85	14.0%
2024	Apr	\$26.73	\$26.75	\$0.02	0.1%	\$23.29	\$27.17	\$3.87	16.6%
2024	May	\$32.92	\$32.90	(\$0.02)	(0.1%)	\$31.70	\$36.16	\$4.46	14.1%
2024	Jun	\$32.59	\$32.62	\$0.03	0.1%	\$31.95	\$33.35	\$1.40	4.4%
2024	Jul	\$44.51	\$44.69	\$0.18	0.4%	\$44.12	\$47.17	\$3.04	6.9%
2024	Aug	\$36.34	\$36.31	(\$0.03)	(0.1%)	\$34.37	\$36.29	\$1.92	5.6%
2024	Sep	\$30.63	\$30.77	\$0.14	0.4%	\$29.32	\$31.81	\$2.48	8.5%
2024	Oct	\$33.18	\$33.26	\$0.08	0.2%	\$29.85	\$31.87	\$2.02	6.8%
2024	Nov	\$29.78	\$29.82	\$0.04	0.1%	\$25.70	\$28.26	\$2.55	9.9%
2024	Dec	\$36.98	\$37.05	\$0.06	0.2%	\$33.62	\$34.98	\$1.36	4.0%
2024		\$33.72	\$33.79	\$0.07	0.2%	\$31.31	\$33.74	\$2.43	7.7%



Figure 3-25 shows the real-time daily average DLMP and PLMP in 2023 through 2024.

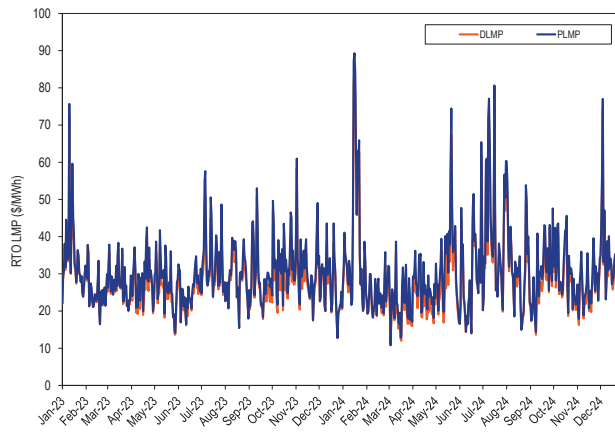**Figure 3-25 Real-time daily average DLMP and PLMP: 2023 through 2024**



Fast start pricing created a larger difference between DLMP and PLMP in real time than in day ahead. Figure 3-26 shows the hourly difference between DLMP and PLMP in day-ahead and real-time for 2024. The big differences between DA DLMP and PLMP on January 13, 2024, and August 27, 2024, were caused by the larger transmission constraint penalty factors in the day-ahead dispatch run. In the dispatch run, the penalty factor was set at \$30,000, while in the pricing run the penalty factor was set at \$2,000.

**Figure 3-26 Hourly difference between DLMP and PLMP for day-ahead and real-time: 2024**

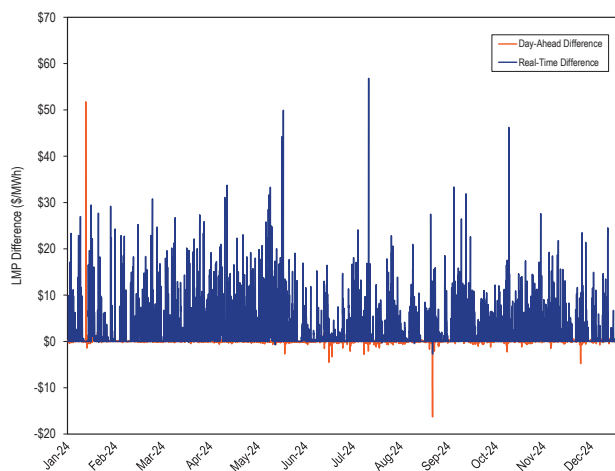


Figure 3-27 shows the hourly average load and LMP difference by hour of the day for 2024. The PLMP minus DLMP difference is largest at the times of the morning and evening peak loads.

**Figure 3-27 Hourly average load and LMP difference: 2024**

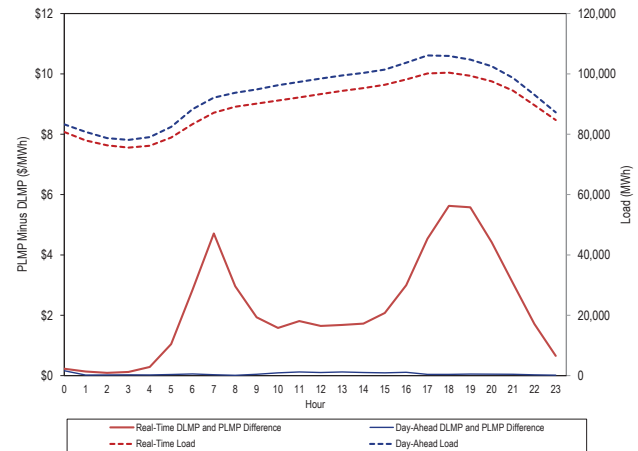


Table 3-33 shows the percent of total marginal units that are fast start units by unit type in 2023 and 2024. While wind units are defined as fast start units, a wind unit on the margin does not result in a higher PLMP than DLMP when the unit has no commitment costs.

Table 3-33 Fast start units as a percent of real-time marginal units: 2023 through 2024

		Dispatch Run				Pricing Run			
Year	Month	CT	Diesel	Wind	All Fast Start Units	CT	Diesel	Wind	All Fast Start Units
2023	Jan	1.6%	0.5%	0.1%	2.1%	6.2%	2.8%	0.0%	9.0%
2023	Feb	0.9%	0.2%	0.0%	1.1%	3.1%	0.6%	0.0%	3.7%
2023	Mar	0.8%	0.4%	0.1%	1.2%	3.0%	0.7%	0.1%	3.8%
2023	Apr	2.5%	0.4%	0.2%	3.2%	8.1%	0.8%	0.2%	9.1%
2023	May	1.0%	0.3%	0.1%	1.3%	4.8%	0.7%	0.1%	5.6%
2023	Jun	0.5%	0.2%	0.0%	0.7%	2.5%	0.5%	0.0%	3.0%
2023	Jul	1.4%	0.9%	0.0%	2.4%	8.6%	1.6%	0.0%	10.3%
2023	Aug	0.9%	1.5%	0.0%	2.4%	5.1%	2.3%	0.0%	7.4%
2023	Sep	0.4%	0.8%	0.1%	1.3%	5.1%	1.4%	0.1%	6.6%
2023	Oct	1.4%	0.3%	0.0%	1.7%	6.9%	0.8%	0.0%	7.7%
2023	Nov	4.0%	0.6%	0.0%	4.5%	11.4%	1.4%	0.0%	12.8%
2023	Dec	1.4%	0.7%	0.0%	2.2%	7.2%	2.0%	0.0%	9.3%
2023		1.4%	0.6%	0.0%	2.0%	6.0%	1.3%	0.0%	7.4%
2024	Jan	0.7%	0.6%	0.0%	1.3%	3.5%	1.1%	0.0%	4.7%
2024	Feb	0.4%	0.1%	0.1%	0.5%	2.2%	0.1%	0.1%	2.4%
2024	Mar	0.7%	0.2%	1.2%	2.1%	4.1%	0.8%	1.3%	6.2%
2024	Apr	1.5%	0.2%	0.2%	1.9%	6.5%	0.7%	0.1%	7.3%
2024	May	0.6%	0.2%	0.1%	1.0%	5.1%	0.6%	0.1%	5.8%
2024	Jun	0.5%	0.3%	0.1%	0.8%	3.5%	0.4%	0.1%	4.0%
2024	Jul	0.8%	0.5%	0.0%	1.4%	7.4%	1.0%	0.0%	8.5%
2024	Aug	0.6%	0.5%	0.0%	1.1%	5.0%	1.0%	0.0%	6.0%
2024	Sep	1.0%	0.1%	0.0%	1.1%	7.1%	0.4%	0.0%	7.6%
2024	Oct	1.2%	0.1%	0.0%	1.3%	6.4%	1.3%	0.0%	7.7%
2024	Nov	1.0%	0.2%	0.0%	1.4%	6.2%	0.6%	0.0%	7.0%
2024	Dec	0.5%	0.2%	0.0%	0.7%	2.2%	0.6%	0.0%	2.9%
2024		0.8%	0.3%	0.2%	1.2%	4.9%	0.7%	0.2%	5.8%

Table 3-34 shows the difference between day-ahead and real-time zonal average DLMP and PLMP for 2024.

Fast start pricing affects some zones more than others. The average difference in real-time prices in BGE was \$2.93 per MWh, while the average difference in real-time prices in PECO was \$1.56 per MWh.

Table 3-34 Day-ahead and real-time zonal average DLMP and PLMP (Dollars per MWh): 2024

2024								
Zone	Day-Ahead				Real-Time			
	Average DLMP	Average PLMP	Difference	Percent Difference	Average DLMP	Average PLMP	Difference	Percent Difference
ACEC	\$27.49	\$27.54	\$0.05	0.2%	\$25.90	\$27.52	\$1.62	6.3%
AEP	\$31.12	\$31.18	\$0.06	0.2%	\$29.05	\$31.35	\$2.31	7.9%
APS	\$32.27	\$32.33	\$0.06	0.2%	\$29.80	\$32.18	\$2.38	8.0%
ATSI	\$31.46	\$31.47	\$0.01	0.0%	\$29.08	\$31.32	\$2.24	7.7%
BGE	\$40.03	\$40.11	\$0.08	0.2%	\$36.60	\$39.53	\$2.93	8.0%
COMED	\$25.48	\$25.55	\$0.07	0.3%	\$23.28	\$25.22	\$1.94	8.3%
DAY	\$32.62	\$32.69	\$0.06	0.2%	\$30.30	\$32.75	\$2.46	8.1%
DUKE	\$31.22	\$31.28	\$0.06	0.2%	\$28.90	\$31.21	\$2.31	8.0%
DOM	\$36.96	\$37.02	\$0.06	0.2%	\$33.54	\$36.15	\$2.61	7.8%
DPL	\$31.27	\$31.36	\$0.09	0.3%	\$28.44	\$30.94	\$2.50	8.8%
DUQ	\$30.93	\$30.97	\$0.04	0.1%	\$29.02	\$31.23	\$2.21	7.6%
EKPC	\$30.58	\$30.64	\$0.06	0.2%	\$28.57	\$30.84	\$2.27	8.0%
JCPCLC	\$27.52	\$27.57	\$0.06	0.2%	\$26.00	\$27.67	\$1.67	6.4%
MEC	\$28.66	\$28.71	\$0.06	0.2%	\$26.28	\$28.15	\$1.87	7.1%
OVEC	\$29.88	\$29.93	\$0.06	0.2%	\$27.73	\$29.94	\$2.20	7.9%
PECO	\$27.11	\$27.17	\$0.05	0.2%	\$25.56	\$27.12	\$1.56	6.1%
PE	\$32.06	\$32.10	\$0.04	0.1%	\$29.46	\$31.61	\$2.15	7.3%
PEPCO	\$38.11	\$38.18	\$0.07	0.2%	\$34.85	\$37.61	\$2.76	7.9%
PPL	\$26.76	\$26.82	\$0.06	0.2%	\$24.86	\$26.58	\$1.72	6.9%
PSEG	\$27.78	\$27.83	\$0.06	0.2%	\$26.33	\$28.02	\$1.69	6.4%
REC	\$30.13	\$30.18	\$0.05	0.2%	\$28.14	\$29.93	\$1.79	6.4%

Table 3-35 shows the difference between day-ahead and real-time average DLMP and PLMP for PJM hubs for 2024.

The average difference in real-time prices for the DOMINION HUB was \$2.50 per MWh, while the average difference in real-time prices for the NEW JERSEY HUB was \$1.67 per MWh.

**Table 3-35 Day-ahead and real-time average DLMP and PLMP for PJM hubs (Dollars per MWh): 2024**

Hub	2024							
	Day-Ahead				Real-Time			
	Average DLMP	Average PLMP	Difference	Percent Difference	Average DLMP	Average PLMP	Difference	Percent Difference
AEP GEN HUB	\$29.76	\$29.79	\$0.04	0.1%	\$27.69	\$29.92	\$2.23	8.1%
AEP-DAYTON HUB	\$30.70	\$30.73	\$0.03	0.1%	\$28.42	\$30.69	\$2.27	8.0%
ATSI GEN HUB	\$30.99	\$31.01	\$0.02	0.1%	\$28.32	\$30.50	\$2.18	7.7%
CHICAGO GEN HUB	\$24.78	\$24.88	\$0.09	0.4%	\$22.31	\$24.29	\$1.98	8.9%
CHICAGO HUB	\$25.75	\$25.77	\$0.02	0.1%	\$23.49	\$25.44	\$1.95	8.3%
DOMINION HUB	\$34.03	\$34.07	\$0.04	0.1%	\$31.26	\$33.76	\$2.50	8.0%
EASTERN HUB	\$31.23	\$31.28	\$0.05	0.2%	\$28.30	\$30.79	\$2.48	8.8%
N ILLINOIS HUB	\$25.36	\$25.46	\$0.11	0.4%	\$23.30	\$25.23	\$1.94	8.3%
NEW JERSEY HUB	\$27.65	\$27.68	\$0.03	0.1%	\$26.11	\$27.79	\$1.67	6.4%
OHIO HUB	\$30.66	\$30.69	\$0.03	0.1%	\$28.36	\$30.62	\$2.26	8.0%
WEST INT HUB	\$32.17	\$32.19	\$0.02	0.1%	\$29.80	\$32.15	\$2.35	7.9%
WESTERN HUB	\$33.80	\$33.83	\$0.03	0.1%	\$30.84	\$33.24	\$2.40	7.8%

Table 3-36 shows the frequency of the real-time pricing interval differences in DLMP and PLMP by price range for PJM zones for 2024.

**Table 3-36 Frequency of real-time interval difference (dollars per MWh) between zonal DLMP and PLMP: 2024**

Zone	2024									
	< (\$50)	(\$50) to (\$10)	(\$10) to \$0	\$0	\$0 to \$10	\$10 to \$20	\$20 to \$50	\$50 to \$100	\$100 to \$200	>= \$200
PJM-RTO	0.0%	0.0%	0.7%	52.2%	40.3%	4.7%	1.9%	0.1%	0.0%	0.0%
ACEC	0.0%	0.0%	4.4%	52.4%	38.5%	3.2%	1.4%	0.1%	0.0%	0.0%
AEP	0.0%	0.0%	1.4%	52.4%	39.1%	4.9%	2.1%	0.1%	0.0%	0.0%
APS	0.0%	0.0%	1.1%	52.3%	39.2%	4.9%	2.3%	0.1%	0.0%	0.0%
ATSI	0.0%	0.1%	1.8%	52.3%	39.0%	4.7%	2.1%	0.1%	0.0%	0.0%
BGE	0.0%	0.1%	2.4%	52.2%	36.0%	5.5%	3.3%	0.4%	0.1%	0.0%
COMED	0.0%	0.1%	3.6%	53.3%	37.1%	4.1%	1.7%	0.1%	0.0%	0.0%
DAY	0.0%	0.0%	1.4%	52.4%	38.4%	5.1%	2.5%	0.1%	0.0%	0.0%
DUKE	0.0%	0.0%	1.5%	52.4%	38.9%	4.9%	2.1%	0.1%	0.0%	0.0%
DOM	0.0%	0.1%	1.7%	52.3%	37.7%	5.2%	2.7%	0.2%	0.0%	0.0%
DPL	0.0%	0.1%	6.3%	52.4%	34.9%	3.1%	2.5%	0.4%	0.3%	0.0%
DUQ	0.0%	0.0%	1.5%	52.3%	39.3%	4.6%	2.0%	0.1%	0.0%	0.0%
EKPC	0.0%	0.0%	1.4%	52.4%	39.3%	4.8%	2.0%	0.1%	0.0%	0.0%
JCPLC	0.0%	0.0%	2.3%	52.5%	40.6%	3.2%	1.4%	0.1%	0.0%	0.0%
MEC	0.0%	0.1%	3.7%	52.3%	38.3%	3.8%	1.6%	0.1%	0.0%	0.0%
OVEC	0.0%	0.1%	1.6%	52.4%	39.0%	4.7%	2.0%	0.1%	0.0%	0.0%
PECO	0.0%	0.1%	5.9%	52.4%	37.1%	3.1%	1.4%	0.1%	0.0%	0.0%
PE	0.0%	0.0%	1.5%	52.1%	39.9%	4.5%	1.9%	0.1%	0.0%	0.0%
PEPCO	0.0%	0.1%	2.1%	52.3%	36.8%	5.4%	3.0%	0.3%	0.0%	0.0%
PPL	0.0%	0.1%	3.1%	52.3%	39.7%	3.4%	1.4%	0.1%	0.0%	0.0%
PSEG	0.0%	0.0%	2.2%	52.4%	40.7%	3.2%	1.4%	0.1%	0.0%	0.0%
REC	0.0%	0.1%	2.1%	52.2%	40.7%	3.3%	1.5%	0.1%	0.0%	0.0%

## Real-Time Average LMP

Real-time average LMP is the hourly average LMP for the PJM Real-Time Energy Market.<sup>76</sup>

### PJM Real-Time Average LMP

Table 3-37 shows the real-time average LMP for 1998 through 2024.<sup>77</sup> The real-time average LMP in 2024 increased \$1.63 per MWh, or 5.5 percent from 2023, from \$29.69 per MWh to \$31.32 per MWh.


**Table 3-37 Real-time average LMP (Dollars per MWh): 1998 through 2024**

	Real-Time LMP			Year to Year Change			
	Average	Median	Standard Deviation	Average	Percent	Median	Standard Deviation
1998	\$21.72	\$16.60	\$31.45	NA	NA	NA	NA
1999	\$28.32	\$17.88	\$72.42	\$6.60	30.4%	7.7%	130.3%
2000	\$28.14	\$19.11	\$25.69	(\$0.18)	(0.6%)	6.9%	(64.5%)
2001	\$32.38	\$22.98	\$45.03	\$4.24	15.1%	20.3%	75.3%
2002	\$28.30	\$21.08	\$22.41	(\$4.08)	(12.6%)	(8.3%)	(50.2%)
2003	\$38.28	\$30.79	\$24.71	\$9.98	35.2%	46.1%	10.3%
2004	\$42.40	\$38.30	\$21.12	\$4.12	10.8%	24.4%	(14.5%)
2005	\$58.08	\$47.18	\$35.91	\$15.68	37.0%	23.2%	70.0%
2006	\$49.27	\$41.45	\$32.71	(\$8.81)	(15.2%)	(12.1%)	(8.9%)
2007	\$57.58	\$49.92	\$34.60	\$8.30	16.9%	20.4%	5.8%
2008	\$66.40	\$55.53	\$38.62	\$8.82	15.3%	11.2%	11.6%
2009	\$37.08	\$32.71	\$17.12	(\$29.31)	(44.1%)	(41.1%)	(55.7%)
2010	\$44.83	\$36.88	\$26.20	\$7.75	20.9%	12.7%	53.1%
2011	\$42.84	\$35.38	\$29.03	(\$1.99)	(4.4%)	(4.1%)	10.8%
2012	\$33.11	\$29.53	\$20.67	(\$9.73)	(22.7%)	(16.5%)	(28.8%)
2013	\$36.55	\$32.25	\$20.57	\$3.44	10.4%	9.2%	(0.5%)
2014	\$48.22	\$34.46	\$65.08	\$11.67	31.9%	6.8%	216.4%
2015	\$33.39	\$26.61	\$27.80	(\$14.82)	(30.7%)	(22.8%)	(57.3%)
2016	\$27.57	\$24.10	\$14.76	(\$5.82)	(17.4%)	(9.4%)	(46.9%)
2017	\$29.42	\$25.44	\$17.40	\$1.85	6.7%	5.6%	17.9%
2018	\$35.75	\$28.28	\$29.52	\$6.33	21.5%	11.2%	69.7%
2019	\$26.02	\$22.89	\$21.19	(\$9.73)	(27.2%)	(19.1%)	(28.2%)
2020	\$20.66	\$18.35	\$11.77	(\$5.36)	(20.6%)	(19.8%)	(44.4%)
2021	\$38.18	\$30.59	\$26.37	\$17.52	84.8%	66.7%	124.0%
2022	\$73.53	\$57.13	\$115.77	\$35.35	92.6%	86.8%	339.1%
2023	\$29.69	\$25.80	\$18.42	(\$43.84)	(59.6%)	(54.8%)	(84.1%)
2024	\$31.32	\$25.37	\$24.84	\$1.63	5.5%	(1.7%)	34.9%

## PJM Real-Time Average LMP Duration

Figure 3-28 shows the hourly distribution of the real-time average LMP in 2023 and 2024. In 2023, the most common price range was \$20 to \$30 per MWh. In 2024, the most common price range was also \$20 to \$30 per MWh.

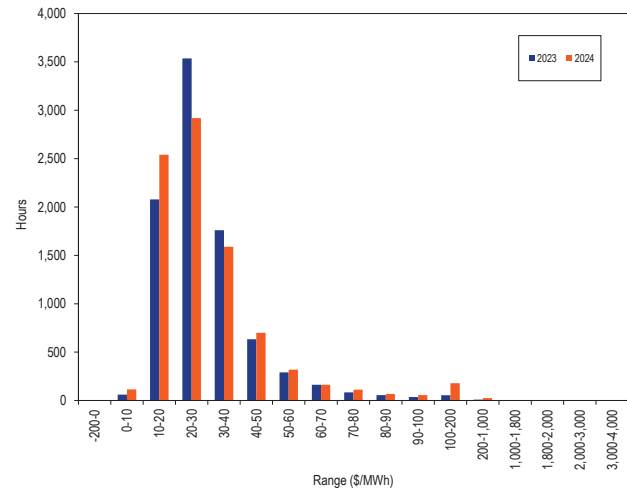**Figure 3-28 Distribution of real-time LMP: 2023 and 2024**



## Real-Time Load-Weighted Average LMP

Higher demand generally results in higher prices, all else constant. As a result, load-weighted, average prices are generally higher than average prices. Load-weighted average LMP reflects the average real-time LMP paid for actual MWh consumed during a year. Load-weighted average LMP is the average of PJM hourly LMP, with each hourly LMP weighted by the PJM total hourly load.

### PJM Real-Time Load-Weighted Average LMP

Table 3-38 shows the real-time load-weighted average LMP for 1998 through 2024. The real-time load-weighted average LMP in 2024 increased \$2.66 per MWh, or 8.5 percent from 2023, from \$31.08 per MWh to \$33.74 per MWh.

<sup>76</sup> See the *Technical Reference for PJM Markets*, at "Calculating Locational Marginal Price," p 16-18 for detailed definition of Real-Time LMP. <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

<sup>77</sup> The system average LMP is the average of the hourly LMP without any weighting. The only exception is that market-clearing prices (MCPs) are included for January to April 1998. MCP was the single market-clearing price calculated by PJM prior to implementation of LMP.

**Table 3-38 Real-time load-weighted average LMP (Dollars per MWh): 1998 through 2024**

	Real-Time Load-Weighted Average LMP			Year to Year Change			
	Average	Median	Standard Deviation	Average	Average Percent	Median	Standard Deviation
1998	\$24.16	\$17.60	\$39.29	NA	NA	NA	NA
1999	\$34.07	\$19.02	\$91.49	\$9.91	41.0%	8.1%	132.8%
2000	\$30.72	\$20.51	\$28.38	(\$3.34)	(9.8%)	7.9%	(69.0%)
2001	\$36.65	\$25.08	\$57.26	\$5.93	19.3%	22.3%	101.8%
2002	\$31.60	\$23.40	\$26.75	(\$5.06)	(13.8%)	(6.7%)	(53.3%)
2003	\$41.23	\$34.96	\$25.40	\$9.64	30.5%	49.4%	(5.0%)
2004	\$44.34	\$40.16	\$21.25	\$3.10	7.5%	14.9%	(16.3%)
2005	\$63.46	\$52.93	\$38.10	\$19.12	43.1%	31.8%	79.3%
2006	\$53.35	\$44.40	\$37.81	(\$10.11)	(15.9%)	(16.1%)	(0.7%)
2007	\$61.66	\$54.66	\$36.94	\$8.31	15.6%	23.1%	(2.3%)
2008	\$71.13	\$59.54	\$40.97	\$9.47	15.4%	8.9%	10.9%
2009	\$39.05	\$34.23	\$18.21	(\$32.09)	(45.1%)	(42.5%)	(55.6%)
2010	\$48.35	\$39.13	\$28.90	\$9.30	23.8%	14.3%	58.7%
2011	\$45.94	\$36.54	\$33.47	(\$2.41)	(5.0%)	(6.6%)	15.8%
2012	\$35.23	\$30.43	\$23.66	(\$10.71)	(23.3%)	(16.7%)	(29.3%)
2013	\$38.66	\$33.25	\$23.78	\$3.43	9.7%	9.3%	0.5%
2014	\$53.14	\$36.20	\$76.20	\$14.47	37.4%	8.9%	220.4%
2015	\$36.16	\$27.66	\$31.06	(\$16.98)	(31.9%)	(23.6%)	(59.2%)
2016	\$29.23	\$25.01	\$16.12	(\$6.93)	(19.2%)	(9.6%)	(48.1%)
2017	\$30.99	\$26.35	\$19.32	\$1.76	6.0%	5.4%	19.9%
2018	\$38.24	\$29.55	\$32.89	\$7.25	23.4%	12.1%	70.2%
2019	\$27.32	\$23.63	\$23.12	(\$10.92)	(28.6%)	(20.0%)	(29.7%)
2020	\$21.77	\$19.07	\$12.50	(\$5.55)	(20.3%)	(19.3%)	(45.9%)
2021	\$39.78	\$32.11	\$27.72	\$18.02	82.8%	68.4%	121.8%
2022	\$80.14	\$60.09	\$135.55	\$40.36	101.4%	87.2%	389.1%
2023	\$31.08	\$26.83	\$19.77	(\$49.06)	(61.2%)	(55.3%)	(85.4%)
2024	\$33.74	\$26.85	\$27.54	\$2.66	8.5%	0.1%	39.3%

**PJM Real-Time Monthly Load-Weighted Average LMP**

Figure 3-29 shows the real-time monthly and yearly load-weighted average LMP for 1999 through 2024.

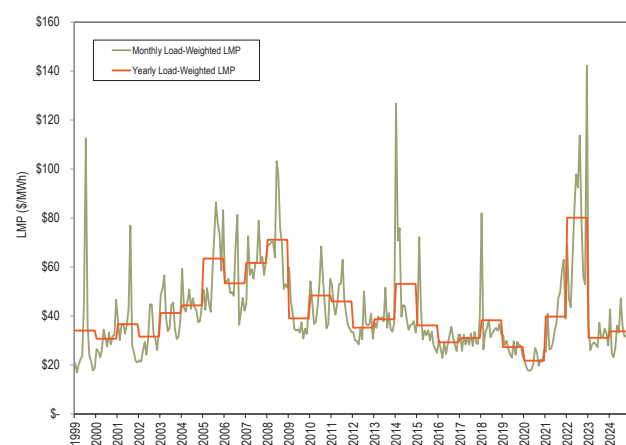
**Figure 3-29 Real-time monthly and yearly load-weighted average LMP: 1999 through 2024**



Table 3-39 shows the real-time monthly on peak and off peak load-weighted average LMP for 2023 through 2024.


**Table 3-39 Real-time monthly on peak and off peak load-weighted average LMP (Dollars per MWh): 2023 through 2024**

	2023				2024			
	Off Peak	On Peak	Difference	Percent Difference	Off Peak	On Peak	Difference	Percent Difference
Jan	\$33.20	\$38.53	\$5.32	16.0%	\$38.50	\$47.10	\$8.60	22.3%
Feb	\$23.45	\$28.67	\$5.22	22.3%	\$24.49	\$25.23	\$0.74	3.0%
Mar	\$26.96	\$29.78	\$2.82	10.5%	\$21.64	\$24.79	\$3.15	14.6%
Apr	\$24.08	\$35.00	\$10.92	45.4%	\$23.99	\$30.03	\$6.04	25.2%
May	\$22.65	\$33.84	\$11.19	49.4%	\$28.99	\$42.74	\$13.75	47.4%
Jun	\$21.64	\$32.16	\$10.52	48.6%	\$26.66	\$40.04	\$13.38	50.2%
Jul	\$26.86	\$48.04	\$21.18	78.9%	\$32.20	\$60.78	\$28.58	88.7%
Aug	\$26.68	\$35.31	\$8.63	32.3%	\$26.71	\$44.99	\$18.28	68.5%
Sep	\$24.76	\$38.65	\$13.88	56.1%	\$24.53	\$39.42	\$14.89	60.7%
Oct	\$26.41	\$42.58	\$16.17	61.2%	\$26.60	\$36.49	\$9.89	37.2%
Nov	\$29.72	\$37.01	\$7.29	24.5%	\$23.80	\$33.18	\$9.38	39.4%
Dec	\$23.70	\$32.88	\$9.18	38.7%	\$31.60	\$38.70	\$7.10	22.5%

### PJM Real-Time Daily Load-Weighted Average LMP

Figure 3-30 shows the real-time daily load-weighted average LMP for 2023 through 2024.

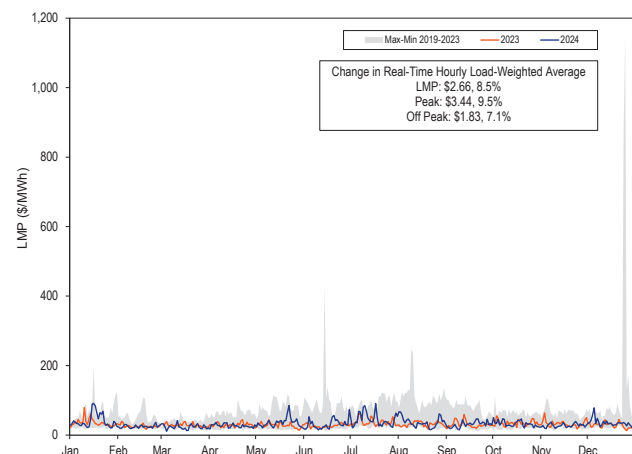
**Figure 3-30 Real-time daily load-weighted average LMP: 2023 through 2024**



### PJM Real-Time Monthly Inflation Adjusted Load-Weighted Average LMP

Figure 3-31 shows the PJM real-time monthly load-weighted average LMP and inflation adjusted monthly load-weighted average LMP from January 1998 through December 2024.<sup>78</sup> Table 3-40 shows the PJM real-time load-weighted average LMP and inflation adjusted load-weighted average LMP for every year from 1998 through 2024.

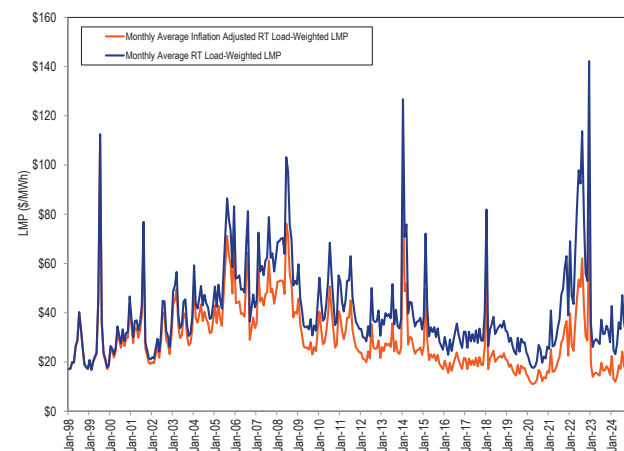**Figure 3-31 Real-time monthly load-weighted average LMP unadjusted and adjusted for inflation: 1998 through 2024**



<sup>78</sup> To obtain the inflation adjusted, monthly, load-weighted, average LMP, the PJM system-wide load-weighted average LMP is deflated using the US Consumer Price Index for all items, Urban Consumers (base period: January 1998), published by Bureau of Labor Statistics. <<http://download.bls.gov/pub/time.series/cu/cu.data.1.AllItems>> (Accessed January 15, 2025)

**Table 3-40 Real-time load-weighted and inflation adjusted load-weighted average LMP: 1998 through 2024**

	Load-Weighted Average LMP	Inflation Adjusted Load-Weighted Average LMP
1998	\$24.16	\$23.94
1999	\$34.07	\$33.04
2000	\$30.72	\$28.80
2001	\$36.65	\$33.45
2002	\$31.60	\$28.35
2003	\$41.23	\$36.24
2004	\$44.34	\$37.91
2005	\$63.46	\$52.37
2006	\$53.35	\$42.73
2007	\$61.66	\$48.06
2008	\$71.13	\$53.27
2009	\$39.05	\$29.46
2010	\$48.35	\$35.83
2011	\$45.94	\$33.01
2012	\$35.23	\$24.80
2013	\$38.66	\$26.82
2014	\$53.14	\$36.37
2015	\$36.16	\$24.69
2016	\$29.23	\$19.68
2017	\$30.99	\$20.43
2018	\$38.24	\$24.65
2019	\$27.32	\$17.28
2020	\$21.77	\$13.58
2021	\$39.78	\$23.63
2022	\$80.14	\$44.12
2023	\$31.08	\$16.48
2024	\$33.74	\$17.38

### Real-Time Dispatch and Pricing

On November 1, 2021, PJM implemented a new real-time dispatch process that aligned the timing of dispatch and pricing in the real-time energy market. The PJM Real-Time Energy Market is based on applications that produce the generator dispatch for energy and reserves, and five minute locational marginal prices (LMPs). These applications include the real-time security constrained economic dispatch (RT SCED), the locational pricing calculator (LPC), and the ancillary services optimizer (ASO).<sup>79</sup> The final real-time LMPs and ancillary service clearing prices are determined for every five minute interval by LPC.

### Real-Time SCED and LPC

The LPC uses data from an approved RT SCED solution that was used to dispatch the resources in the system. RT SCED solves to meet load and reserve requirements forecast for a future point in time, called the target time. Prior to 2021, on average, PJM operators approved more than one RT SCED solution per five minute target time to send dispatch signals to resources. In 2021, 2022, 2023,

and 2024, on average, PJM operators approved one RT SCED solution per five minute target time to send dispatch signals to resources. PJM uses a subset of these approved RT SCED solutions in LPC to calculate real-time LMPs every five minutes. Prior to October 15, 2020, LPC used the latest available approved RT SCED solution to calculate prices, regardless of the target dispatch time of the RT SCED solution, but LPC assigned the prices to a five minute interval that did not contain the target time of the RT SCED case it used. On October 15, 2020, PJM updated its pricing process to use an approved RT SCED solution that solves for the same target time as the end of each five minute pricing interval to calculate LMPs applicable for that five minute interval, although the SCED cases were still for 10 minutes ahead while the LPC cases were for each five minute interval. As a result, under the default timing of case approvals, resources followed the dispatch signal in the first five minutes after the RT SCED case approval and the corresponding pricing occurred five minutes after the same case approval, when resources were following a new dispatch signal. On November 1, 2021, PJM implemented changes to RT SCED that solved the energy dispatch case using a five-minute dispatch period, and ramped resources for five minutes to meet the load and reserve requirements at the end of each five minute period. The approved RT SCED solution that dispatched units for each five minute period was also used to calculate prices for the same five minute interval, aligning the prices with the dispatch signals.

Table 3-41 shows the number of RT SCED case solutions, the number of solutions that were approved, and the number and percent of approved solutions used in LPC. The RT SCED execution frequency is once every five minutes. PJM operators have the ability to execute additional RT SCED cases. Each execution of RT SCED produces five solutions, using five different levels of load bias. Since prices are calculated every five minutes while five SCED solutions are produced every five minutes, there is, by definition, a larger number of SCED solutions than there are five minute intervals in any given period.

Table 3-41 shows that in 2024, 97.2 percent of approved RT SCED solutions that were used to send dispatch signals to generators were used in calculating real-time energy market prices, compared to 97.6 percent in all of 2023.

<sup>79</sup> See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 133 (Dec. 17, 2024).

**Table 3–41 RT SCED cases solved, approved and used in pricing: 2023 through 2024**

Month	2023				2024			
	Number of RT SCED Solutions	Number of Approved RT SCED Solutions	Number of Approved RT SCED Solutions Used in LPC	RT SCED Solutions Used in LPC as Percent of Approved RT SCED Solutions	Number of RT SCED Solutions	Number of Approved RT SCED Solutions	Number of Approved RT SCED Solutions Used in LPC	RT SCED Solutions Used in LPC as Percent of Approved RT SCED Solutions
Jan	45,175	9,075	8,900	98.1%	45,594	9,161	8,891	97.1%
Feb	40,924	8,225	7,987	97.1%	43,066	8,659	8,288	95.7%
Mar	44,876	9,016	8,861	98.3%	45,340	8,972	8,845	98.6%
Apr	43,823	8,761	8,563	97.7%	44,365	8,767	8,606	98.2%
May	46,378	8,994	8,808	97.9%	46,149	9,177	8,853	96.5%
Jun	44,228	8,800	8,598	97.7%	44,464	8,841	8,598	97.3%
Jul	45,809	9,202	8,916	96.9%	45,629	9,138	8,881	97.2%
Aug	45,498	9,047	8,779	97.0%	45,616	9,192	8,894	96.8%
Sep	44,325	8,794	8,607	97.9%	44,275	8,752	8,550	97.7%
Oct	45,804	9,065	8,850	97.6%	45,806	9,144	8,879	97.1%
Nov	44,284	8,842	8,607	97.3%	44,055	8,850	8,607	97.3%
Dec	45,359	9,059	8,885	98.1%	45,460	9,120	8,899	97.6%
Total	536,483	106,880	104,361	97.6%	539,819	107,773	104,791	97.2%

Until November 1, 2021, PJM did not link dispatch and settlement intervals. RT SCED moved from automatically executing a case every three minutes to every five minutes in 2020, while settlements are linked to five minute intervals. Until November 1, 2021, RT SCED solved the dispatch problem for a target time that was generally 14 minutes in the future. An RT SCED case was approved and sent dispatch signals to generators based on a 10 minute ramp time. The look ahead time for the load forecast and the look ahead time for the resource dispatch target did not match, and a new RT SCED case would override the previously approved case before resources had time to achieve the previous target dispatch. Prior to October 15, 2020, the interval that was priced in LPC was consistently before the target time from the RT SCED case used for the dispatch signal. LPC took the most recently approved RT SCED case to calculate LMPs for the present five minute interval. For example, the LPC case that calculated prices for the interval ending 10:05 EPT used an approved RT SCED case that sent MW dispatch signals for the target time of 10:10 EPT. This discrepancy created a mismatch between the MW dispatch and real-time LMPs and undermined generators' incentive to follow dispatch. Under new RT SCED changes that were implemented on October 15, 2020, PJM resolved the mismatch between LPC and the RT SCED target time, but prices no longer applied at the time when resources received and followed that dispatch signal.<sup>80</sup> For example, the LPC case that calculated prices for the interval ending 10:05 EPT used an approved RT SCED case that sent MW dispatch signals at 9:55 EPT which were no longer effective from 10:00 to 10:05 EPT.

<sup>80</sup> See Docket No. ER19-2573-000.

In the first 10 months of 2021, there was a mismatch between the MW dispatch and real-time LMPs that undermined generators' incentive to follow dispatch. The timing remained incorrect until all three (the pricing interval, the dispatch interval, and the RT SCED target time) all corresponded to one another, which PJM implemented on November 1, 2021.

The extent to which dispatch instructions from approved SCED solutions are reflected in concurrent prices in the PJM Real-Time Energy Market can be measured by comparing the start and end times when the dispatch instructions from the RT SCED solution were effective with the start and end times when the corresponding prices applied. The start time for a dispatch instruction is the time at which PJM approves the RT SCED solution, which triggers sending the resulting dispatch instructions to resources. The end time for a dispatch instruction is the time when the next RT SCED solution is approved. Dispatch and pricing are perfectly aligned when the start and end times of the dispatch instructions from an approved RT SCED solution match with the start and end times of the LPC pricing interval that uses the same RT SCED solution. In a perfectly aligned five minute market, these times would both be five minutes in duration. In the first 10 months of 2021, RT SCED used a 10 minute ramp time to dispatch resources, while LPC applied prices to five minute intervals. Beginning November 1, 2021, both RT SCED and LPC used the same five minute period to dispatch resources and calculate prices, which aligned the dispatch signals and prices in the real-time energy market.

Table 3-42 shows the average duration of the period when dispatch instructions corresponded to the prevailing prices. Prior to October 15, 2020, PJM used the latest approved RT SCED solution available at the time of LPC execution, regardless of the SCED target time, to calculate prices for the current five minute pricing interval. The average duration of correspondence ranged from 3 minutes 11 seconds to 3 minutes 37 seconds from January through October 15, 2020, varying with changes to the frequency of automatic RT SCED execution. The percent of time that prices were consistent with the dispatch instructions was 67.2 to 69.9 percent, on average. This was far from the goal of 100 percent correspondence between five minute dispatch instructions and prices. With the short term changes to RT SCED that were implemented on October 15, 2020, the prices no longer corresponded to the dispatch instructions. Table 3-42 shows that during the first 10 months of 2021, the dispatch instructions were consistent with prevailing prices for only 33 seconds. During this period, the percent of time that prices were consistent with the dispatch instructions was 9.0 percent. In the period beginning November 1, 2021, PJM aligned the dispatch and pricing intervals such that the prices that were effective for each five minute interval were generally based on the RT SCED case that sent dispatch signals with the target time at the end of the five minute interval. As a result of these changes, in 2022, the dispatch instructions were consistent with the prices on average for 4 minutes and 45 seconds out of each five minute interval, or 95.7 percent of each five minute interval. In 2023, the dispatch instructions were consistent with prices on average for 4 minutes and 47 seconds out of each five minute interval, or 95.9 percent of each five minute interval. In 2024, the dispatch instructions were consistent with prices on average for 4 minutes and 46 seconds out of each five minute interval, or 96.0 percent of each five minute interval.

**Table 3-42 Dispatch instructions reflected in prices: 2020 through 2024**

Period	RT SCED Automatic Execution Frequency	Dispatch Duration Reflected in Prices (Minutes:Seconds)	Percent Dispatch Duration Reflected in Prices
Jan 1, 2020 - Feb 23, 2020	Every 3 minutes	03:11	67.9%
Feb 24, 2020 - Jun 22, 2020	Every 4 minutes	03:27	67.2%
Jun 23, 2020 - Oct 14, 2020	Every 5 minutes	03:37	69.9%
Oct 15, 2020 - Dec 31, 2020	Every 5 minutes	00:39	9.9%
Jan 1, 2021 - Oct 31, 2021	Every 5 minutes	00:33	9.0%
Nov 1, 2021 - Dec 31, 2021	Every 5 minutes	04:46	95.4%
Jan 1, 2022 - Dec 31, 2022	Every 5 minutes	04:45	95.6%
Jan 1, 2023 - Dec 31, 2023	Every 5 minutes	04:47	95.9%
Jan 1, 2024 - Dec 31, 2024	Every 5 minutes	04:46	96.0%

## Recalculation of Five Minute Real-Time Prices

PJM's five minute interval LMPs are obtained from solved LPC cases. PJM recalculates five minute interval real-time LMPs as it believes necessary to correct errors. To do so, PJM reruns LPC cases with modified inputs. The PJM OATT allows for posting of recalculated real-time prices no later than 1700 (EPT) of the tenth calendar day following the operating day. The OATT also requires PJM to notify market participants of the underlying error no later than 1700 (EPT) of the second business day following the operating day.<sup>81</sup> Table 3-43 shows the number of five minute intervals in each month and number of five minute intervals in each month for which PJM recalculated real-time prices in 2023 and 2024. In 2024, PJM recalculated LMPs for 2,359 five minute intervals or 2.24 percent of the total 105,408 five minute intervals.

**Table 3-43 Number of five minute interval real-time prices recalculated: January 2023 through December 2024**

Month	2023		2024	
	Number of Five Minute Intervals	Number of Five Minute Intervals for Which LMPs Were Recalculated	Number of Five Minute Intervals	Number of Five Minute Intervals for Which LMPs Were Recalculated
January	8,928	161	8,928	164
February	8,064	166	8,352	285
March	8,916	123	8,916	304
April	8,640	234	8,640	154
May	8,928	337	8,928	193
June	8,640	165	8,640	167
July	8,928	229	8,928	274
August	8,928	615	8,928	171
September	8,640	175	8,640	167
October	8,928	332	8,928	155
November	8,652	143	8,652	160
December	8,928	118	8,928	165
Total	105,120	2,798	105,408	2,359

<sup>81</sup> OA Attachment K Section 1 § 1.10.8(e).

## Day-Ahead Average LMP

Day-ahead average LMP is the hourly average LMP for the PJM Day-Ahead Energy Market.<sup>82</sup>

### PJM Day-Ahead Average LMP

Table 3-44 shows the day-ahead average LMP for 2001 through 2024. The day-ahead average LMP for 2024 increased \$1.03 per MWh, or 3.4 percent from 2023, from \$30.38 per MWh to \$31.41 per MWh.


**Table 3-44 Day-ahead average LMP (Dollars per MWh): 2001 to 2024**

	Day-Ahead LMP			Year to Year Change			
	Average	Median	Standard Deviation	Average	Percent	Median	Standard Deviation
2001	\$32.75	\$27.05	\$30.42	NA	NA	NA	NA
2002	\$28.46	\$23.28	\$17.68	(\$4.29)	(13.1%)	(14.0%)	(41.9%)
2003	\$38.73	\$35.22	\$20.84	\$10.27	36.1%	51.3%	17.8%
2004	\$41.43	\$40.36	\$16.60	\$2.70	7.0%	14.6%	(20.4%)
2005	\$57.89	\$50.08	\$30.04	\$16.47	39.7%	24.1%	81.0%
2006	\$48.10	\$44.21	\$23.42	(\$9.80)	(16.9%)	(11.7%)	(22.0%)
2007	\$54.67	\$52.34	\$23.99	\$6.58	13.7%	18.4%	2.4%
2008	\$66.12	\$58.93	\$30.87	\$11.44	20.9%	12.6%	28.7%
2009	\$37.00	\$35.16	\$13.39	(\$29.12)	(44.0%)	(40.3%)	(56.6%)
2010	\$44.57	\$39.97	\$18.83	\$7.57	20.5%	13.7%	40.6%
2011	\$42.52	\$38.13	\$20.48	(\$2.05)	(4.6%)	(4.6%)	8.8%
2012	\$32.79	\$30.89	\$13.27	(\$9.73)	(22.9%)	(19.0%)	(35.2%)
2013	\$37.15	\$34.63	\$15.46	\$4.35	13.3%	12.1%	16.5%
2014	\$49.15	\$38.10	\$51.88	\$12.00	32.3%	10.0%	235.6%
2015	\$34.12	\$29.09	\$22.59	(\$15.03)	(30.6%)	(23.7%)	(56.5%)
2016	\$28.10	\$25.76	\$10.68	(\$6.02)	(17.7%)	(11.4%)	(52.7%)
2017	\$29.48	\$26.94	\$11.69	\$1.38	4.9%	4.6%	9.5%
2018	\$35.69	\$30.96	\$22.32	\$6.21	21.1%	14.9%	91.0%
2019	\$26.03	\$24.36	\$9.35	(\$9.66)	(27.1%)	(21.3%)	(58.1%)
2020	\$20.33	\$18.99	\$7.00	(\$5.70)	(21.9%)	(22.0%)	(25.2%)
2021	\$37.76	\$32.15	\$18.49	\$17.43	85.8%	69.3%	164.3%
2022	\$70.77	\$61.13	\$37.79	\$33.01	87.4%	90.1%	104.4%
2023	\$30.38	\$27.98	\$14.60	(\$40.39)	(57.1%)	(54.2%)	(61.4%)
2024	\$31.41	\$26.76	\$19.40	\$1.03	3.4%	(4.4%)	32.8%

## PJM Day-Ahead Average LMP Duration

Figure 3-32 shows the hourly distribution of the day-ahead average LMP for 2023 and 2024.

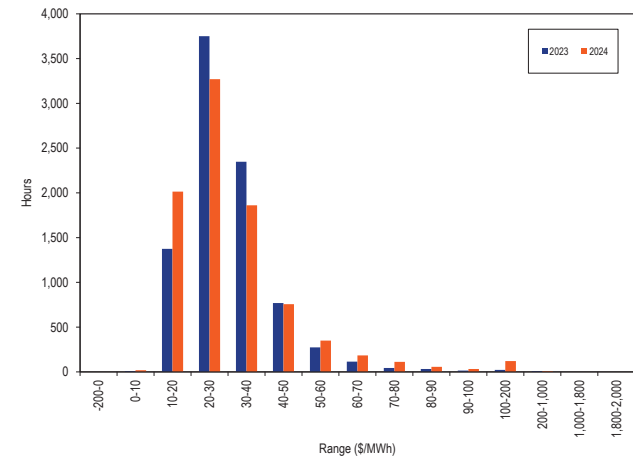**Figure 3-32 Distribution of day-ahead LMP: 2023 and 2024**



## Day-Ahead Load-Weighted Average LMP

Day-ahead load-weighted LMP reflects the average LMP paid for day-ahead MWh. Day-ahead load-weighted LMP is the average of PJM day-ahead hourly LMP, each hourly LMP weighted by the PJM total cleared day-ahead, hourly load, including day-ahead fixed load, price-sensitive load, decrement bids and up to congestion.

<sup>82</sup> See the *MMU Technical Reference for the PJM Markets*, at "Calculating Locational Marginal Price," for a detailed definition of day-ahead LMP. <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.



### PJM Day-Ahead Load-Weighted Average LMP

Table 3-45 shows the day-ahead load-weighted average LMP for 2001 through 2024. The day-ahead load-weighted average LMP for 2024 increased \$1.86 or 5.8 percent from 2023, from \$31.93 per MWh to \$33.79 per MWh.

**Table 3-45 Day-ahead load-weighted average LMP (Dollars per MWh): 2001 to 2024**

	Day-Ahead Load-Weighted Average LMP			Year to Year Change			
	Average	Median	Standard Deviation	Average	Average Percent	Median	Standard Deviation
2001	\$36.01	\$29.02	\$37.48	NA	NA	NA	NA
2002	\$31.80	\$26.00	\$20.68	(\$4.21)	(11.7%)	(10.4%)	(44.8%)
2003	\$41.43	\$38.29	\$21.32	\$9.63	30.3%	47.3%	3.1%
2004	\$42.87	\$41.96	\$16.32	\$1.44	3.5%	9.6%	(23.4%)
2005	\$62.50	\$54.74	\$31.72	\$19.62	45.8%	30.4%	94.3%
2006	\$51.33	\$46.72	\$26.45	(\$11.16)	(17.9%)	(14.6%)	(16.6%)
2007	\$57.88	\$55.91	\$25.02	\$6.55	12.8%	19.7%	(5.4%)
2008	\$70.25	\$62.91	\$33.14	\$12.37	21.4%	12.5%	32.4%
2009	\$38.82	\$36.67	\$14.03	(\$31.43)	(44.7%)	(41.7%)	(57.7%)
2010	\$47.65	\$42.06	\$20.59	\$8.83	22.7%	14.7%	46.8%
2011	\$45.19	\$39.66	\$24.05	(\$2.46)	(5.2%)	(5.7%)	16.8%
2012	\$34.55	\$31.84	\$15.48	(\$10.64)	(23.5%)	(19.7%)	(35.6%)
2013	\$38.93	\$35.77	\$18.05	\$4.37	12.7%	12.3%	16.6%
2014	\$53.62	\$39.84	\$59.62	\$14.70	37.8%	11.4%	230.4%
2015	\$36.73	\$30.60	\$25.46	(\$16.89)	(31.5%)	(23.2%)	(57.3%)
2016	\$29.68	\$27.00	\$11.64	(\$7.05)	(19.2%)	(11.8%)	(54.3%)
2017	\$30.85	\$28.21	\$12.64	\$1.17	3.9%	4.5%	8.6%
2018	\$37.97	\$32.49	\$24.76	\$7.13	23.1%	15.2%	95.9%
2019	\$27.23	\$25.28	\$10.18	(\$10.74)	(28.3%)	(22.2%)	(58.9%)
2020	\$21.40	\$19.78	\$7.59	(\$5.83)	(21.4%)	(21.7%)	(25.5%)
2021	\$39.37	\$33.72	\$19.30	\$17.97	84.0%	70.5%	154.3%
2022	\$75.44	\$64.13	\$41.25	\$36.07	91.6%	90.2%	113.8%
2023	\$31.93	\$29.04	\$16.64	(\$43.51)	(57.7%)	(54.7%)	(59.7%)
2024	\$33.79	\$28.37	\$21.75	\$1.86	5.8%	(2.3%)	30.7%

### PJM Day-Ahead Monthly Load-Weighted Average LMP

Figure 3-33 shows the day-ahead monthly and yearly load-weighted average LMP in 2001 through 2024.

**Figure 3-33 Day-ahead monthly and yearly load-weighted average LMP: 2001 through 2024**


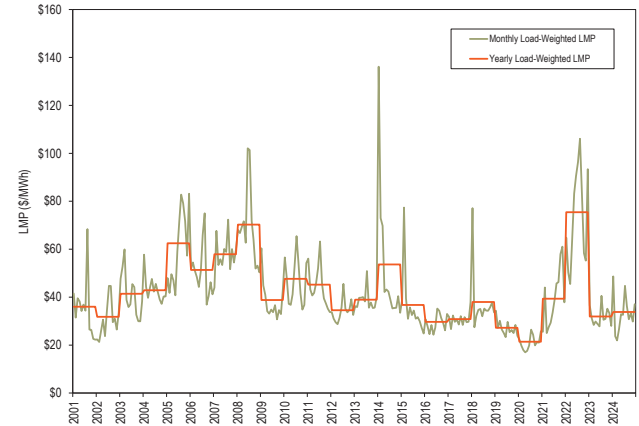


Figure 3-34 shows the day-ahead daily load-weighted average LMP in 2023 through 2024 compared to the historic five year price range.

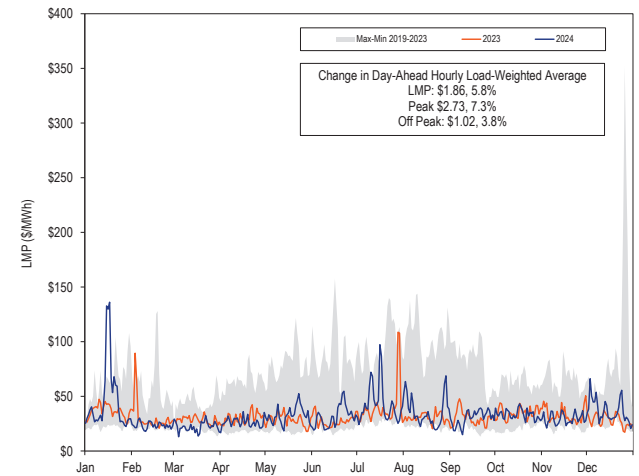
**Figure 3-34 Day-ahead daily load-weighted average LMP: 2023 through 2024**



### PJM Day-Ahead Monthly Inflation Adjusted Load-Weighted Average LMP

Figure 3-35 shows the PJM day-ahead monthly load-weighted average LMP and inflation adjusted monthly day-ahead load-weighted average LMP for June 2000 through December 2024.<sup>83</sup> Table 3-46 shows the PJM day-ahead load-weighted average LMP and inflation adjusted load-weighted average LMP for every year from 2000 through 2024.

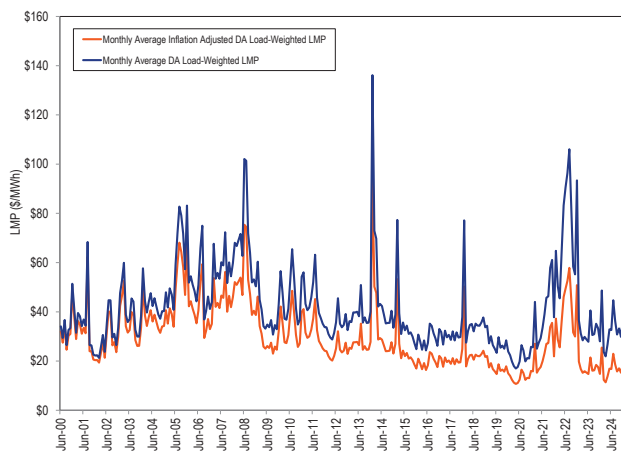**Figure 3-35 Day-ahead monthly load-weighted and inflation adjusted load-weighted average LMP: June 2000 through December 2024**



<sup>83</sup> To obtain the inflation adjusted monthly load-weighted average LMP, the PJM system-wide load-weighted average LMP is deflated using US Consumer Price Index for all items, Urban Consumers (base period: January 1998), published by Bureau of Labor Statistics. <<http://download.bls.gov/pub/time.series/cu/cu.data.1.AllItems>> (Accessed October 10, 2024).

**Table 3-46 Day-ahead yearly load-weighted and inflation adjusted load-weighted average LMP: 2000 through 2024**

	Load-Weighted Average LMP	Inflation Adjusted Load-Weighted Average LMP
2000	\$35.13	\$32.74
2001	\$36.01	\$32.87
2002	\$31.80	\$28.53
2003	\$41.43	\$36.42
2004	\$42.87	\$36.65
2005	\$62.50	\$51.58
2006	\$51.33	\$41.12
2007	\$57.88	\$45.11
2008	\$70.25	\$52.61
2009	\$38.82	\$29.29
2010	\$47.65	\$35.32
2011	\$45.19	\$32.48
2012	\$34.55	\$24.33
2013	\$38.93	\$27.00
2014	\$53.62	\$36.71
2015	\$36.73	\$25.08
2016	\$29.68	\$19.98
2017	\$30.85	\$20.34
2018	\$37.97	\$24.47
2019	\$27.23	\$17.23
2020	\$21.40	\$13.35
2021	\$39.37	\$23.40
2022	\$75.44	\$41.56
2023	\$31.93	\$16.93
2024	\$33.79	\$17.41

### Price Convergence

The introduction of the PJM Day-Ahead Energy Market with virtuals as part of the design created the possibility that competition, exercised through the use of virtual offers and bids, could tend to cause prices in the day-ahead and real-time energy markets to converge more than would be the case without virtuals. Convergence is not the goal of virtual trading, but it is a possible outcome.

In practice, virtuals can receive a positive profit whenever there is a difference in prices at any location in any hour between the day-ahead and real-time energy markets that is greater than uplift and administrative charges.

Virtual trading can only result in price convergence at a given location and market hour if the factors affecting prices at that location and hour, such as modeled contingencies, transmission constraint limits and sources of flows, are the same in both the day-ahead and real-time models.

Where arbitrage incentives are created by systematic modeling differences, such as differences between the day-ahead and real-time modeled transmission

contingencies and marginal loss calculations, virtual bids and offers cannot result in more efficient market outcomes. Such offers may result in positive profits for the virtual but cannot change the underlying reason for the price difference. The virtual transactions will continue to profit from the activity for that reason regardless of the volume of those transactions and without improving the efficiency of the energy market. This is termed false arbitrage.

The degree of convergence, by itself, is not a measure of the competitiveness or effectiveness of the day-ahead energy market. Price convergence does not necessarily mean a zero or even a very small difference in prices between day-ahead and real-time energy markets. There may be factors, from uplift charges to differences in risk that result in a competitive, market-based differential. In addition, convergence in the sense that day-ahead and real-time prices are equal at individual buses or aggregates on a day to day basis is not a realistic expectation as a result of uncertainty, lags in response time and modeling differences.

INCs, DEC and UTCs allow participants to benefit from price differences between the day-ahead and real-time energy market. In theory, virtual transactions receive positive profits, after uplift and administrative charges, when they contribute to price convergence, but with false arbitrage, profits result with little or no price convergence. The seller of an INC must buy energy in the real-time energy market to fulfill the financial obligation to provide energy. If the day-ahead price for energy is higher than the real-time price for energy, after uplift and administrative charges, the INC is profitable. The buyer of a DEC must sell energy in the real-time energy market to fulfill the financial obligation to buy energy. If the day-ahead price for energy is lower than the real-time price for energy, after uplift and administrative charges, the DEC is profitable.

The profit of a UTC transaction is the net of the separate revenues of the component INC and DEC, after uplift and administrative charges. A UTC can be profitable if the profits on one side of the UTC transaction exceed the losses on the other side.

Virtual transactions, including UTCs since November 1, 2020, are required to pay uplift charges. Cleared INCs and DEC pay deviation charges based on the daily RTO and applicable regional operating reserve charge

rates. DEC pay day-ahead operating reserve charges in addition to deviation charges. Cleared UTCs are treated, for uplift purposes, like DEC at the UTC sink point, and pay the regional and RTO deviation rates in addition to the day-ahead rate. Uplift charges for deviations may not apply if the virtual transaction is partially or fully offset by a corresponding real-time physical transaction at the same location.

In the day-ahead market, load bids are submitted by market buyers at aggregate pnodes, and PJM uses historic bus level load data to distribute the aggregate bids among the bus level pnodes that comprise the aggregate pnode. Effective December 14, 2023, PJM modified the method used to assign load bids to nodes from a single snapshot at 8:00 AM the week prior to the hourly demand data from one week prior to the Operating Day for each hour.<sup>84</sup>

### Profitability of Virtual Transactions

The profit of a virtual transaction equals its net day-ahead and real-time energy market revenues minus uplift and administrative charges.

Table 3-47 shows, for cleared UTCs, the number of UTCs, the number of profitable UTCs, and the number of UTCs profitable at their source point, at their sink point, and at both source and sink points in 2023 and 2024. In 2024, 40.2 percent of all cleared UTC transactions were profitable. Of cleared UTC transactions, 62.6 percent were profitable on the source side and 35.7 percent were profitable on the sink side, but only 7.7 percent were profitable on both the source and sink side.

<sup>84</sup> PJM Interconnection, LLC, Tariff Revisions to Improve the Determination of Day-Ahead Zonal Load Factors, Docket No. ER23-1529 (March 31, 2023).

**Table 3-47 Cleared UTCs with positive profits at source and sink points: 2023 and 2024<sup>85</sup>**

	Number of Cleared UTCs	Number of Profitable UTCs	Profitable at Source	Profitable at Sink	Profitable at Source and Sink	Share Profitable Overall	Share Profitable Source	Share Profitable Sink	Share Profitable Source and Sink
2023	7,691,139	3,212,091	5,059,265	2,587,293	541,139	41.8%	65.8%	33.6%	7.0%
2024	5,925,275	2,379,177	3,710,809	2,115,830	453,990	40.2%	62.6%	35.7%	7.7%

Table 3-48 shows the number of cleared INC and DEC transactions and the number of profitable transactions in 2023 and 2024. Of cleared INC and DEC transactions in 2024, 52.6 percent of INCs were profitable and 31.4 percent of DEC were profitable.

**Table 3-48 Cleared INC and DEC transactions with positive profits: 2023 and 2024**

	Cleared INC	Profitable INC	Profitable INC Share	Cleared DEC	Profitable DEC	Profitable DEC Share
2023	3,297,664	2,103,051	63.8%	2,838,502	994,688	35.0%
2024	3,844,228	2,022,904	52.6%	3,485,597	1,093,099	31.4%

Figure 3-36 shows the positive, negative, and net daily profits for UTCs in 2024.

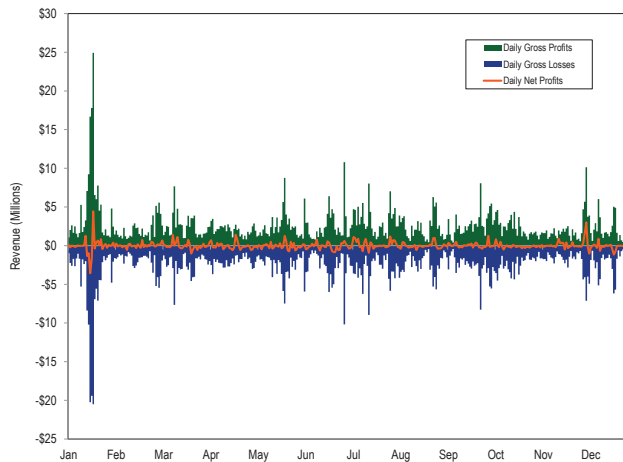
**Figure 3-36 Positive, negative, and net daily UTC profits: 2024**

Figure 3-37 shows the cumulative UTC daily total net profits for each year from 2013 through December 2024.<sup>86</sup> Administrative charges are included for all dates, and uplift charges are included starting from November 1, 2020, when uplift was first charged to UTCs.

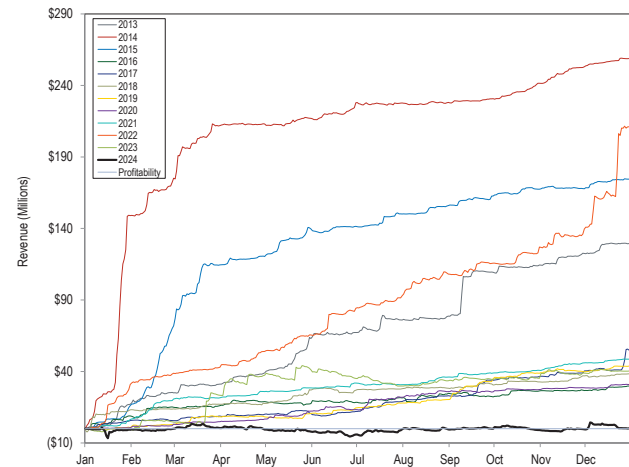
**Figure 3-37 Cumulative daily UTC profits: January 2013 through December 2024**

Table 3-49 shows UTC monthly total net profits for January 2013 through December 2024. Administrative charges are included for all months and uplift charges are included starting from November 1, 2020, when uplift was first charged to UTCs. UTC profits were \$211 million in 2022, higher than any year since 2014, with the largest monthly total in December 2022 at \$75 million. In 2023, the most profitable UTC transactions were concentrated in the Dominion Zone and on dates with high real-time congestion in the Dominion Zone, which occurred primarily in January through May, 2023. The year 2024 was the least profitable year ever for UTC transactions, with very large profitable days occurring with less frequency than prior years. DOMINION HUB to DOM\_RESID\_AGG UTC remains the path with the highest cleared volume in 2024, but the cleared volume decreased by 27.3 million MWh compared to 2023.


<sup>85</sup> Calculations exclude PJM administrative charges.

<sup>86</sup> UTCs paid uplift only after October 31, 2020.

Table 3-49 UTC profits by month: January 2013 through December 2024

	January	February	March	April	May	June	July	August	September	October	November	December	Total
2013	\$17,048,654	\$8,304,767	\$5,629,392	\$7,560,773	\$25,219,947	\$3,484,372	\$8,781,526	\$2,327,168	\$31,160,618	\$4,393,583	\$8,730,701	\$6,793,990	\$129,435,490
2014	\$148,973,434	\$23,235,621	\$39,448,716	\$1,581,786	\$3,851,636	\$7,353,460	\$3,179,356	\$287,824	\$2,727,763	\$10,889,817	\$11,042,443	\$6,191,101	\$258,762,955
2015	\$16,132,319	\$53,830,098	\$44,309,656	\$6,392,939	\$19,793,475	\$824,817	\$8,879,275	\$5,507,608	\$6,957,012	\$4,852,454	\$392,876	\$6,620,581	\$174,493,110
2016	\$8,874,363	\$6,118,477	\$1,119,457	\$2,768,591	(\$1,333,563)	\$841,706	\$3,128,346	\$3,200,573	(\$2,518,408)	\$4,216,717	\$254,684	\$3,271,368	\$29,942,312
2017	\$5,716,757	(\$17,860)	\$3,083,167	\$944,939	\$1,245,988	\$868,400	\$7,053,390	\$4,002,063	\$10,960,012	\$2,360,177	\$2,716,950	\$15,936,217	\$54,870,839
2018	\$13,184,346	\$506,509	\$3,410,577	\$688,796	\$9,499,735	(\$768,614)	\$1,163,380	\$692,736	\$2,845,649	\$1,452,515	\$4,339,363	\$1,358,446	\$38,373,436
2019	\$574,901	\$2,407,307	\$5,287,985	\$332,036	\$1,833,879	\$3,382,009	\$4,066,461	\$2,442,971	\$12,599,278	\$5,914,042	\$1,171,145	\$3,722,403	\$43,734,418
2020	\$664,972	\$2,497,856	\$1,720,037	\$1,865,139	\$5,508,276	\$1,123,429	\$8,573,276	\$3,957,296	(\$141,240)	\$1,628,186	\$1,170,367	\$2,319,727	\$30,887,320
2021	\$6,421,567	\$13,241,294	\$1,788,961	\$4,529,921	\$2,542,898	\$3,384,291	(\$1,199,849)	\$5,330,600	\$2,649,331	\$2,148,861	\$5,091,590	\$2,665,873	\$48,595,339
2022	\$30,954,077	\$7,236,325	\$4,411,627	\$11,317,095	\$11,658,586	\$16,398,181	\$9,481,970	\$17,376,381	\$6,783,480	\$7,325,933	\$13,116,641	\$75,067,601	\$211,127,897
2023	(\$374,877)	\$5,180,921	\$18,722,180	\$13,543,116	\$5,121,917	(\$6,820,656)	(\$5,587,077)	\$3,667,565	\$1,041,650	\$787,185	\$3,734,966	\$1,259,381	\$40,276,272
2024	(\$798,085)	\$741,801	\$505,530	(\$1,048,989)	(\$1,481,223)	(\$1,997,609)	\$3,605,145	(\$28,816)	\$440,898	(\$852,701)	\$472,000	\$677,521	\$235,473

Figure 3-38 shows the positive, negative, and net daily profits for INCs and DECs in 2024. Differences in the modeling of transmission constraints between day ahead and real time, including the use of different constraint limits or a constraint being modeled in one market but not the other, remain a principal source of false arbitrage profits and a major reason for the overall profitability of virtual transactions.

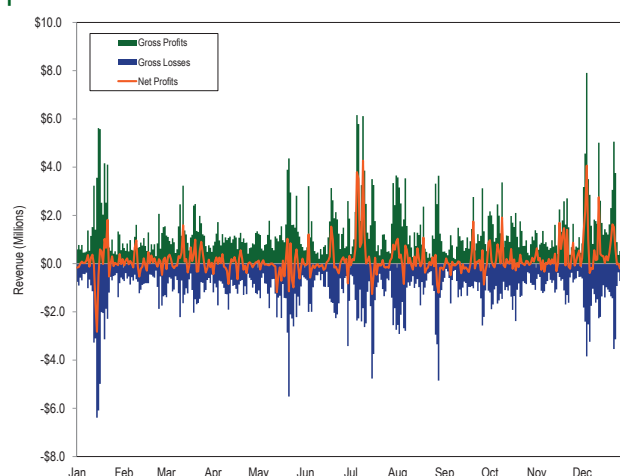Figure 3-38 Daily gross profits, gross losses, and net profits of all INC and DEC transactions: 2024<sup>87</sup>

<sup>87</sup> Calculations exclude PJM administrative charges.

Figure 3-39 shows the positive, negative, and net daily profits for INCs in 2024.


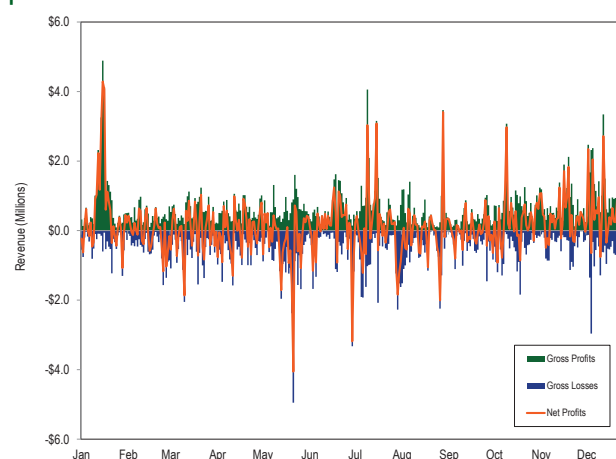
Figure 3-39 Daily gross profits, gross losses, and net profits for INC transactions: 2024<sup>88</sup>

Figure 3-40 shows the positive, negative, and net daily profits for DECs in 2024.

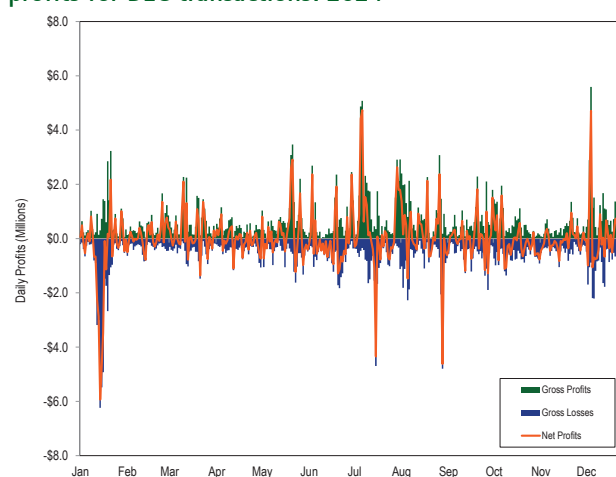Figure 3-40 Daily gross profits, gross losses, and net profits for DEC transactions: 2024



<sup>88</sup> Calculations exclude PJM administrative charges.



Figure 3-41 shows the cumulative INC and DEC daily profits in 2024. Virtual trading can be profitable without contributing to price convergence because the addition of virtual supply or demand in the day-ahead market does not and cannot correct for factors not included in the day-ahead model, such as the use of different transmission constraint limits in day ahead versus real time.

**Figure 3-41 Cumulative daily INC and DEC profit: 2024**

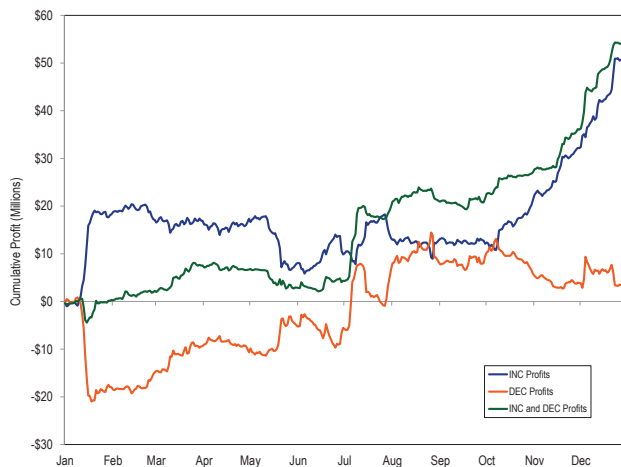


Table 3-50 shows INC and DEC profits by month in 2024.

**Table 3-50 INC and DEC profits by month: 2024**

Month	January	February	March	April	May	June	July	August	September	October	November	December	Total
INCs	\$18,076,775	(\$971,675)	(\$189,054)	\$441,271	(\$9,365,934)	\$1,864,894	\$3,393,030	(\$411,746)	(\$735,095)	\$9,211,431	\$10,850,228	\$20,212,254	\$52,376,378
DECs	(\$17,947,177)	\$3,060,794	\$5,532,446	(\$1,301,610)	\$5,567,967	(\$415,049)	\$12,150,649	\$1,536,024	\$1,362,084	(\$3,752,540)	(\$1,914,206)	(\$1,444,852)	\$2,434,530
INCs and DECs	\$129,597	\$2,089,120	\$5,343,392	(\$860,339)	(\$3,797,967)	\$1,449,844	\$15,543,679	\$1,124,277	\$626,989	\$5,458,891	\$8,936,022	\$18,767,402	\$54,810,908

All virtual transactions are subject to uplift charges. Each cleared MWh of a virtual transaction pays uplift at the daily operating reserve charge rates, but UTCs pay uplift only at the transaction sink. Cleared increment offers pay the regional and RTO deviation rates, and cleared decrement bids pay the day-ahead rate in addition. Cleared up to congestion transactions pay the same rate as a decrement bid but only at the transaction's sink point, the day-ahead rate and RTO and regional deviation rates.

In 2024, INCs paid a total of \$11.3 million, DECs paid a total of \$15.4 million, and UTCs paid a total of \$38.0 million in uplift. This compares to total INC profits of \$52.4 million, total DEC profits of \$2.4 million, and total UTC profit of \$0.3 million.


## Effect of Fast Start Pricing on Virtuals

The implementation of fast start pricing on September 1, 2021, has resulted in changes to the settlement of virtual transactions. Prior to fast start pricing, virtual products were cleared and settled based on a single set of prices. The dispatch and pricing run prices were the same. With fast start pricing, all virtual products are cleared using day-ahead dispatch run prices, but pay and receive the day-ahead and real-time pricing run prices. The use of fast start pricing has a direct effect on virtual settlements through the use of prices different from those used to dispatch virtuals. This means that a DEC may clear in the day-ahead market, based on the dispatch run, even though its offer is lower than the final, pricing run price. This means that an INC may clear even though its offer is higher than the day-ahead market price. The use of fast start pricing also results in divergence between day-ahead and real-time prices, which can be targeted by virtual traders. The fact that fast start pricing increases prices more in the real-time market, all else held equal, increases the profitability of DECs and decreases the profitability of INCs.

Figure 3-42 shows the total monthly profits received by INCs, DECs, and UTCs, compared to the profits they would have received if dispatch run prices had been used in settlement for each month since the initial

implementation of fast start pricing in September 2021. Since its implementation, fast start pricing has consistently increased profits for DECs and decreased profits for INCs but has not significantly affected profits for UTCs. Fast start pricing creates a difference between day-ahead and real-time prices. Virtual traders can benefit from this difference without contributing to price convergence.

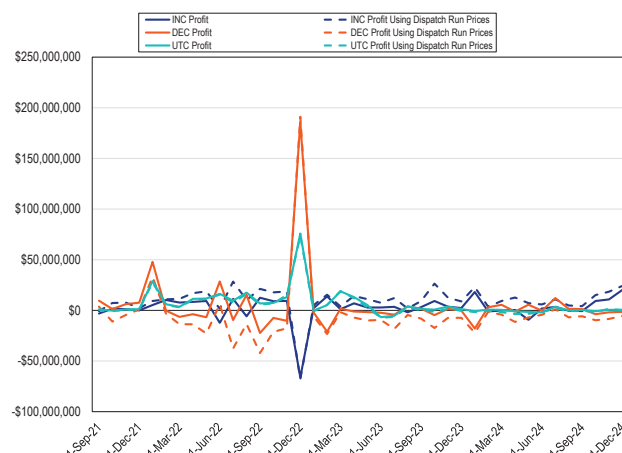**Figure 3-42 Monthly profits for virtuals using pricing run versus dispatch run prices: September 1, 2021 through December 31, 2024**



From the implementation of fast start pricing on September 1, 2021, through December 31, 2024, the cumulative difference in profit between the pricing run and the dispatch run for INCs was -\$280.2 million, the cumulative difference in profit for DECs was \$381.6 million, and the cumulative difference in profit for UTCs was \$36.7 million. Fast start pricing led to a net increase of \$138.0 million in cumulative profits for virtual transactions since September 1, 2021.

There are incentives to use virtual transactions to profit from price differences between the day-ahead and real-time energy markets, but there is no reason to believe that such activity will result in price convergence and no data to support that claim. As a general matter, virtual offers and bids are based on expectations about both day-ahead and real-time energy market conditions and reflect the uncertainty about conditions in both markets, about modeling differences and the fact that these conditions change hourly and daily. PJM markets do not provide a mechanism that could result in immediate convergence after a change in system conditions as there is at least a one day lag after any change in system conditions before offers could reflect such changes. PJM markets do not provide a mechanism that could ever result in convergence in the presence of modeling differences.

Substantial virtual trading activity does not guarantee that market power cannot be exercised in the day-ahead energy market. Hourly and daily price differences between the day-ahead and real-time energy markets fluctuate continuously and substantially from positive to negative. There may be substantial, persistent differences between day-ahead and real-time prices even on a monthly basis.

## Day-ahead and Real-time Prices

Table 3-51 shows the difference between the day-ahead and the real-time average LMP in 2023 and 2024.

**Table 3-51 Day-ahead and real-time average LMP (Dollars per MWh): 2023 and 2024<sup>89</sup>**

	2023				2024			
	Day-Ahead	Real-Time	Difference	Percent of Real-Time	Day-Ahead	Real-Time	Difference	Percent of Real-Time
Average	\$30.38	\$29.69	(\$0.69)	(2.3%)	\$31.41	\$31.32	(\$0.09)	(0.3%)
Median	\$27.98	\$25.80	(\$2.19)	(8.5%)	\$26.76	\$25.37	(\$1.39)	(5.5%)
Standard deviation	\$14.60	\$18.42	\$3.82	20.7%	\$19.40	\$24.84	\$5.44	21.9%
Peak average	\$36.01	\$35.13	(\$0.88)	(2.5%)	\$37.77	\$37.32	(\$0.45)	(1.2%)
Peak median	\$32.49	\$30.22	(\$2.28)	(7.5%)	\$32.26	\$30.17	(\$2.09)	(6.9%)
Peak standard deviation	\$17.12	\$21.87	\$4.75	21.7%	\$22.38	\$27.86	\$5.48	19.7%
Off peak average	\$25.51	\$24.97	(\$0.53)	(2.1%)	\$25.86	\$26.08	\$0.22	0.8%
Off peak median	\$23.68	\$21.85	(\$1.83)	(8.4%)	\$22.37	\$21.30	(\$1.07)	(5.0%)
Off peak standard deviation	\$9.64	\$13.08	\$3.44	26.3%	\$14.20	\$20.49	\$6.29	30.7%

<sup>89</sup> The averages used are the annual average of the hourly average PJM prices for day-ahead and real-time.

Table 3-52 shows the difference between the day-ahead and the real-time load-weighted LMP in the first nine months of 2001 through 2024.

**Table 3-52 Day-ahead and real-time load-weighted average LMP (Dollars per MWh): 2001 through 2024**

Load-Weighted Average LMP				
	Day-Ahead	Real-Time	Difference	Percent of Real-Time
2001	\$36.01	\$36.65	\$0.64	1.8%
2002	\$31.80	\$31.60	(\$0.20)	(0.6%)
2003	\$41.43	\$41.23	(\$0.20)	(0.5%)
2004	\$42.87	\$44.34	\$1.47	3.3%
2005	\$62.50	\$63.46	\$0.96	1.5%
2006	\$51.33	\$53.35	\$2.02	3.8%
2007	\$57.88	\$61.66	\$3.78	6.1%
2008	\$70.25	\$71.13	\$0.88	1.2%
2009	\$38.82	\$39.05	\$0.23	0.6%
2010	\$47.65	\$48.35	\$0.70	1.4%
2011	\$45.19	\$45.94	\$0.75	1.6%
2012	\$34.55	\$35.23	\$0.68	1.9%
2013	\$38.93	\$38.66	(\$0.26)	(0.7%)
2014	\$53.62	\$53.14	(\$0.49)	(0.9%)
2015	\$36.73	\$36.16	(\$0.57)	(1.6%)
2016	\$29.68	\$29.23	(\$0.45)	(1.5%)
2017	\$30.85	\$30.99	\$0.14	0.5%
2018	\$37.97	\$38.24	\$0.27	0.7%
2019	\$27.23	\$27.32	\$0.08	0.3%
2020	\$21.40	\$21.77	\$0.36	1.7%
2021	\$39.37	\$39.78	\$0.42	1.0%
2022	\$75.44	\$80.14	\$4.71	5.9%
2023	\$31.93	\$31.08	(\$0.84)	(2.7%)
2024	\$33.79	\$33.74	(\$0.05)	(0.2%)

Table 3-53 includes frequency distributions of the differences between the day-ahead and the real-time load-weighted LMP in 2023 and 2024.

**Table 3-53 Frequency distribution by hours of real-time load-weighted LMP minus day-ahead load-weighted LMP (Dollars per MWh): 2023 and 2024**

LMP	2023		2024	
	Frequency	Cumulative Percent	Frequency	Cumulative Percent
< (\$200)	3	0.0%	0	0.0%
(\$200) to (\$100)	10	0.1%	5	0.1%
(\$100) to (\$50)	20	0.4%	49	0.6%
(\$50) to \$0	5,774	66.3%	5,557	63.9%
\$0 to \$50	2,876	99.1%	3,030	98.4%
\$50 to \$100	63	99.8%	105	99.6%
\$100 to \$200	11	100.0%	30	99.9%
\$200 to \$400	2	100.0%	7	100.0%
\$400 to \$800	1	100.0%	1	100.0%
>= \$800	0	100.0%	0	100.0%

Figure 3-43 shows the differences between day-ahead and real-time hourly average LMP in 2024.

The largest difference was \$410.31 per MWh on March 10, 2024.

**Figure 3-43 Real-time hourly average LMP minus day-ahead hourly average LMP: 2024**


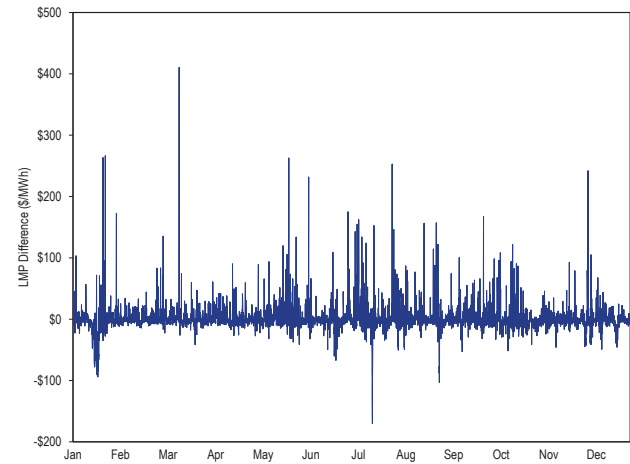


Figure 3-44 shows day-ahead and real-time load-weighted average LMP by hour of the day in 2023 and 2024.

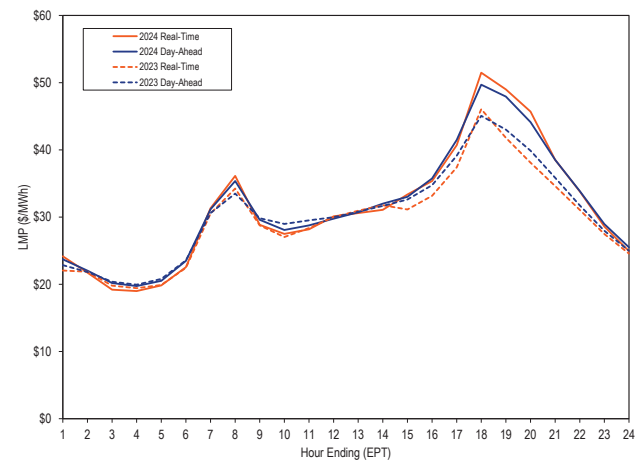**Figure 3-44 System hourly average LMP: 2023 and 2024**



## Zonal LMP and Dispatch

Table 3-54 shows real-time zonal average and load-weighted average LMP for 2023 and 2024.

**Table 3-54 Real-time zonal average and load-weighted average LMP (Dollars per MWh): 2023 and 2024**

Zone	Real-Time Average LMP			Real-Time Load-Weighted Average LMP		
	2023	2024	Percent Change	2023	2024	Percent Change
ACEC	\$23.30	\$27.52	18.1%	\$24.94	\$30.60	22.7%
AEP	\$30.05	\$31.35	4.3%	\$31.19	\$33.22	6.5%
APS	\$31.07	\$32.18	3.6%	\$32.49	\$34.49	6.2%
ATSI	\$29.88	\$31.32	4.8%	\$31.05	\$33.32	7.3%
BGE	\$36.40	\$39.53	8.6%	\$38.80	\$44.87	15.7%
COMED	\$25.82	\$25.22	(2.4%)	\$27.47	\$27.69	0.8%
DAY	\$31.28	\$32.75	4.7%	\$32.70	\$35.23	7.7%
DUKE	\$30.69	\$31.21	1.7%	\$32.10	\$33.49	4.3%
DOM	\$35.75	\$36.15	1.1%	\$37.50	\$39.07	4.2%
DPL	\$27.03	\$30.94	14.5%	\$31.06	\$35.67	14.9%
DUQ	\$30.14	\$31.23	3.6%	\$31.31	\$33.42	6.8%
EKPC	\$30.41	\$30.84	1.4%	\$31.93	\$33.49	4.9%
JCPLC	\$24.15	\$27.67	14.6%	\$25.89	\$30.79	18.9%
MEC	\$26.59	\$28.15	5.9%	\$27.93	\$30.46	9.1%
OVEC	\$29.67	\$29.94	0.9%	\$29.80	\$30.14	1.1%
PECO	\$22.34	\$27.12	21.4%	\$23.63	\$29.87	26.4%
PE	\$29.81	\$31.61	6.0%	\$31.01	\$33.24	7.2%
PEPCO	\$34.36	\$37.61	9.4%	\$36.59	\$42.06	15.0%
PPL	\$24.60	\$26.58	8.0%	\$25.73	\$28.53	10.9%
PSEG	\$24.32	\$28.02	15.2%	\$25.66	\$30.35	18.3%
REC	\$26.04	\$29.93	14.9%	\$27.90	\$32.65	17.0%
PJM	\$29.69	\$31.32	5.5%	\$31.08	\$33.74	8.5%

Table 3-55 shows day-ahead zonal average and load-weighted average LMP for 2023 and 2024.

**Table 3-55 Day-ahead zonal average and load-weighted average LMP (Dollars per MWh): 2023 and 2024**

Zone	Day-Ahead Average LMP			Day-Ahead Load-Weighted Average LMP		
	2023	2024	Percent Change	2023	2024	Percent Change
ACEC	\$23.98	\$27.54	14.8%	\$25.61	\$30.37	18.6%
AEP	\$31.04	\$31.18	0.4%	\$32.29	\$33.09	2.5%
APS	\$32.24	\$32.33	0.3%	\$33.70	\$34.52	2.4%
ATSI	\$30.79	\$31.47	2.2%	\$32.02	\$33.36	4.2%
BGE	\$38.17	\$40.11	5.1%	\$40.95	\$45.08	10.1%
COMED	\$26.68	\$25.55	(4.2%)	\$28.36	\$27.62	(2.6%)
DAY	\$32.36	\$32.69	1.0%	\$33.95	\$35.12	3.4%
DUKE	\$31.76	\$31.28	(1.5%)	\$33.40	\$33.55	0.4%
DOM	\$35.78	\$37.02	3.5%	\$37.82	\$40.12	6.1%
DPL	\$26.91	\$31.36	16.5%	\$31.03	\$36.58	17.9%
DUQ	\$31.05	\$30.97	(0.2%)	\$32.43	\$33.20	2.4%
EKPC	\$31.01	\$30.64	(1.2%)	\$32.81	\$33.41	1.9%
JCPLC	\$24.77	\$27.57	11.3%	\$26.41	\$30.14	14.1%
MEC	\$27.43	\$28.71	4.7%	\$29.07	\$31.00	6.6%
OVEC	\$30.50	\$29.93	(1.9%)	\$30.40	\$29.69	(2.3%)
PECO	\$22.92	\$27.17	18.5%	\$24.28	\$29.71	22.4%
PE	\$30.52	\$32.10	5.2%	\$32.28	\$34.01	5.4%
PEPCO	\$36.13	\$38.18	5.7%	\$38.83	\$43.03	10.8%
PPL	\$25.28	\$26.82	6.1%	\$26.51	\$28.70	8.3%
PSEG	\$24.95	\$27.83	11.6%	\$26.35	\$29.99	13.8%
REC	\$26.72	\$30.18	13.0%	\$28.92	\$32.67	13.0%
PJM	\$30.38	\$31.41	3.4%	\$31.93	\$33.79	5.8%

Figure 3-45 is a map of the real-time load-weighted average LMP in 2024. In the legend, green represents the system marginal price (SMP) and each increment to the right represents five percent of the pricing nodes above SMP and each increment to the left represents 25 percent of the pricing nodes below the SMP.

Figure 3-45 Real-time load-weighted average LMP: 2024


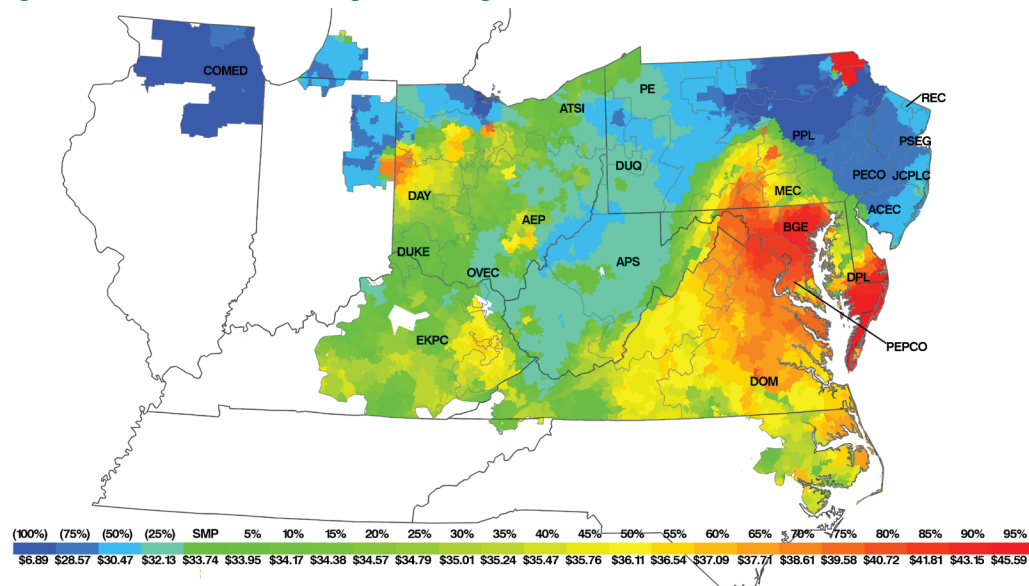


Figure 3-46 includes maps of the real-time load-weighted average LMP in 2021 through 2024. In the legend, green represents the four year average price and each block to the right represents five percent of the pricing nodes above the average price and each block to the left represents 25 percent of the pricing nodes below the average price.

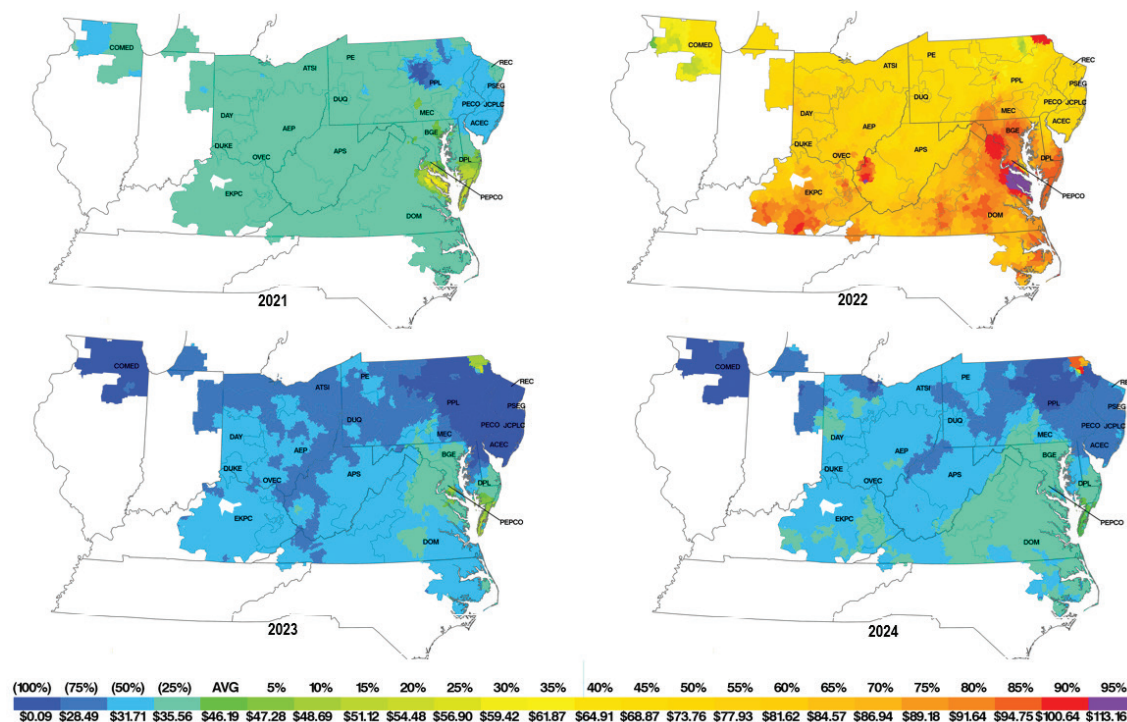Figure 3-46 Real-time load-weighted average LMP map: 2021 through 2024





## Transmission Constraint Penalty Factors (TCPF)

LMP may, at times, be set by transmission constraint penalty factors. When a transmission constraint is binding and there are no generation alternatives to resolve the constraint, system operators may allow the transmission limit to be violated. When this occurs, the shadow price of the constraint is set by transmission constraint penalty factors. The shadow price directly affects the LMP. Transmission constraint penalty factors are administratively determined and can be thought of as a form of locational scarcity pricing but only when properly applied. The TCPFs are applied incorrectly about 94 percent of the time.

PJM operators routinely reduce the control limits on transmission constraint line ratings used in the market clearing software (SCED) by setting the control limits to 95 percent of the actual line ratings.<sup>90</sup> The result is that transmission constraint penalty factors set price much more frequently than needed or appropriate. PJM reduces the control limits both to control for actual flows and for flows that would only result from a contingency (N-1).

Since the implementation of fast start pricing on September 1, 2021, PJM set the default level of the transmission constraint penalty factor in the pricing run of the day-ahead market at \$2,000 per MWh. The default level of the transmission constraint penalty factor in the dispatch run of the day-ahead market was left unchanged at \$30,000 per MWh.

Table 3-56 shows the frequency and average shadow price of transmission constraints in the PJM real-time market. In 2024, there were 200,988 transmission constraint five minute intervals in the real-time market with a nonzero shadow price. For about six percent of these transmission constraint intervals, the control limit was violated, meaning that the flow exceeded the facility limit used in SCED.<sup>91</sup> For about 94 percent of those violations, PJM had reduced the control limit on the line rating. In those cases, the actual line limit was not violated. In 2024, the average shadow price of transmission constraints (\$1,891.3)

when the line limit used in SCED was violated was 8.3 times higher than when the transmission constraint was binding (\$227.7) at its limit used in SCED.

Market to Market Transmission Constraints are categorized separately because of the unique rules governing the congestion management of these constraints by PJM and MISO. In the real-time market, PJM and MISO initiate a joint congestion management process commonly referred as “market to market” if they recognize substantial flows originating from the other RTO on their constraints. The identified constraints are then modeled in the dispatch optimizations of the both RTOs. After every approved solution, the shadow prices are exchanged between the RTOs.

**Table 3-56 Frequency and average shadow price of transmission constraints in the real-time market: 2023 and 2024**

Description	Frequency (Constraint Intervals)		Average Shadow Price	
	2023	2024	2023	2024
Violated Transmission Constraints	10,252	12,560	\$1,493.68	\$1,891.28
Binding Transmission Constraints	105,392	131,160	\$186.37	\$227.74
Market to Market Transmission Constraints	52,204	57,268	\$266.37	\$266.13
All Transmission Constraints	167,848	200,988	\$291.10	\$342.64

Table 3-57 shows the frequency and average shadow price of transmission constraints in the PJM day-ahead market. In 2024, there were 78,305 transmission constraint hours in the day-ahead market with a nonzero shadow price. For less than one percent of these transmission constraint hours, the line limit was violated, meaning that the flow exceeded the facility limit used in the day-ahead pricing run solution.

**Table 3-57 Frequency and average shadow price of transmission constraints in the day-ahead market: 2023 and 2024**

Description	Frequency (Constraint Intervals)		Average Shadow Price	
	2023	2024	2023	2024
Violated Transmission Constraints	15	34	\$2,000.00	\$2,000.00
Binding Transmission Constraints	66,024	69,856	\$44.27	\$66.91
Market to Market Transmission Constraints	7,495	8,415	\$113.62	\$102.44
All Transmission Constraints	73,534	78,305	\$51.74	\$71.57

<sup>90</sup> Actual transmission line limits are set by the transmission owner. PJM chooses the control limits.

At present the actual line rating methods are not reviewed by FERC, or PJM, or the MMU.

<sup>91</sup> The line limit of a facility associated with a transmission constraint is not necessarily the rated line limit. In PJM, the dispatcher has the discretion to lower the rated line limit.

Table 3-58 shows the frequency of violated transmission constraints by voltage level in the real-time market. In 2024, 83.9 percent of the violated transmission constraint intervals had a voltage level at or below 230 kV.

**Table 3-58 Frequency of PJM violated transmission constraints in the real-time market by voltage: 2023 and 2024**

Voltage	2023		2024	
	Frequency (Constraint Intervals)	Percent	Frequency (Constraint Intervals)	Percent
1 kV	113	1.1%	79	0.6%
69 kV	395	3.9%	931	7.4%
115 kV	1,968	19.2%	3,004	23.9%
138 kV	3,125	30.5%	3,769	30.0%
161 kV	-	0.0%	16	0.1%
230 kV	3,660	35.7%	2,743	21.8%
345 kV	676	6.6%	788	6.3%
500 kV	306	3.0%	1,005	8.0%
765 kV	9	0.1%	225	1.8%
Total	10,252	100.0%	12,560	100.0%

Transmission constraint penalty factors should be applied without discretion, but not without additional rules that prevent unintended consequences. PJM adopted the MMU's recommendation to remove the constraint relaxation logic and allow transmission penalty factors to set prices in the day-ahead and real-time markets for all internal transmission constraints. But the potential for prolonged and excessively high administrative pricing in the energy market due to transmission constraint penalty factors remains an issue that needs to be addressed. There can be situations in which the application of transmission penalty factors in real time for significant periods creates manipulation opportunities for virtuals and creates inefficient wealth transfers when market participants do not have the ability to react to the high prices either on the supply or demand side.<sup>92</sup> This could be the result of a lengthy planned transmission outage, for example.<sup>93</sup> It can also result from PJM reducing the control limit on the line rating in RT SCED below 100 percent of the actual line limit and triggering the transmission constraint penalty factor, while operating the system below the actual line limit for a prolonged period. PJM should not reduce the control limit on the transmission line ratings in SCED to trigger the inclusion of transmission constraint penalty factors in price.

<sup>92</sup> See Comments of the Independent Market Monitor for PJM, Docket No. EL22-26-000 et al. (February 1, 2022); 178 FERC ¶ 61,104 (2022).

<sup>93</sup> See *id.*

PJM also revised the tariff to list the conditions under which transmission constraint penalty factors would be changed from their default value of \$2,000 per MWh. The new rules went into effect on February 1, 2019. The Commission approved the PJM and MISO joint filing to remove the constraint relaxation logic for market to market constraints on March 6, 2020. PJM and MISO implemented the changes to their dispatch software in the second half of 2020. On March 21, 2023, FERC approved new rules proposed by PJM to allow for changes to the transmission constraint penalty factors for constraints that are violated due to a transmission outage for which limited generation resources are available to provide relief.<sup>94</sup>

PJM routinely, based on discretion, reduces the control limits on the transmission constraint line ratings modeled in SCED to below 100 percent, generally to 95 percent of the actual limit, triggering the use of transmission constraint penalty factors.<sup>95</sup> The control limits set the limit of the constraint modeled in SCED. For example, in SCED, a transmission facility with a 100 MW line rating set at a 90 percent control limit would be modeled as a constraint with a limit of 90 MW. Table 3-59 shows the frequency of changes to the control limits for transmission constraints for binding and violated transmission constraints in the PJM real-time market. In 2024, there were 11,744 or 94 percent of 12,560 violated transmission constraint intervals in the real-time market with a control limit less than 100 percent. In 2024, among the constraints with a reduced control limit, the constraint limit was reduced on average by 5.1 percent.

<sup>94</sup> See 182 FERC ¶ 61,183 (March 21, 2023).

<sup>95</sup> Actual transmission line limits are set by the transmission owner. PJM chooses the control limits. At present the actual line rating methods are not reviewed by FERC, or PJM, or the MMU.

**Table 3-59 Frequency of reduction in control limit of line ratings (constraint intervals) in the real-time market: 2023 and 2024**

Description	Frequency (Constraint Intervals)		Constraints with Reduced Control Percent (Constraint Intervals)		Average Reduction (Percent)	
	2023	2024	2023	2024	2023	2024
Violated Transmission Constraints	10,252	12,560	7,213	11,744	5.5%	5.1%
Binding Transmission Constraints	105,392	131,160	103,491	130,108	6.3%	5.3%
Market to Market Transmission Constraints	52,204	57,268	14,355	20,069	5.7%	6.0%
All Transmission Constraints	167,848	200,988	125,059	161,921	6.2%	5.4%

Table 3-60 shows the reasons provided by the PJM operators for changing the control limit on the line rating for violated transmission constraints. In 2024, of the 11,744 violated transmission constraint intervals with reduced control limits, 978 or 9.1 percent were reduced because the relief calculated by the SCED optimization was less than the operator's desired relief for the transmission constraint. No reason was provided for 10,007 instances, or 85 percent of all the instances. The MMU recommends that PJM end the practice of manual and automated discretionary reductions in the control limits on transmission constraint line ratings used in the market clearing software (SCED) and included in LMP. This practice has significant market effects by limiting economic power flows and increasing prices above the level that would exist if 100 percent of the actual line rating were used in clearing the market and setting energy market prices.

**Table 3-60 PJM's reasons for reduction in control limits of line ratings (constraint intervals) in the real-time market: 2023 and 2024**

Reason	Constraint Intervals		Average Reduction (Percent)	
	2023	2024	2023	2024
No reason provided	5,221	10,007	4.5%	4.6%
Prepositioning of generation resources to support an operational requirement	104	77	11.3%	8.5%
Inadequate relief calculated by the SCED optimization	978	1,071	7.2%	6.8%
Transmission owner identified the flow on their constraint to be greater than PJM's calculated flow on the same constraint.	203	101	8.1%	8.5%
Modeled constraint is a thermal surrogate	30	107	67.1%	22.5%
Power flow on the constraint is volatile due to various system conditions	677	381	6.8%	7.4%
All violated constraints	7,213	11,744	5.5%	5.1%

Table 3-61 shows the impact on LMP of PJM dispatchers reducing the control limit of line ratings of transmission constraints and causing artificial line limit violations.<sup>96</sup> The transmission penalty factor contribution to the load-weighted average LMP in 2024 was \$3.00 per MWh. If 100 percent of the line limits had been used for the PJM transmission constraints and everything else remained unchanged, fewer constraints would have been violated and the transmission penalty factor's contribution to the load-weighted average LMP would have decreased to \$0.02 per MWh or 99.4 percent lower.

**Table 3-61 Real-time LMP effect of reduced control limits on transmission constraint line ratings (Dollars per MWh): 2023 and 2024**

Line Limit Scenario for Violated Constraints	Contribution to LMP	
	2023	2024
Line Limits Reduced by PJM (Actual)	\$1.62	\$3.00
Hypothetical Use of Full Line Limits	\$0.01	\$0.02
Change in Contribution to LMP	(\$1.61)	(\$2.98)
Percent Change in Contribution to LMP	(99.3%)	(99.4%)

Table 3-62 shows the frequency of changes to the magnitude of transmission penalty factors for binding and violated transmission constraints in the PJM Real-Time Energy Market. In 2024, there were 11,769 or 94 percent of violated transmission constraint intervals in the real-time market with a transmission penalty factor equal to the default \$2,000 per MWh.

<sup>96</sup> The MMU calculates the impact on system prices based on analysis using sensitivity factors. The transmission penalty factor contribution with actual line limits is not based on a counterfactual redispatch of the system. See Technical Reference for PJM Markets, "Calculation and Use of Generator Sensitivity/Unit Participation Factors," <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

**Table 3-62 Frequency of changes to the magnitude of transmission penalty factor (constraint intervals) in the real-time market: 2023 and 2024**

Description	2023			2024		
	\$2,000 per MWh (Default)	Above \$2,000 per MWh	Below \$2,000 per MWh	\$2,000 per MWh (Default)	Above \$2,000 per MWh	Below \$2,000 per MWh
Violated Transmission Constraints	7,503	-	2,749	11,769	-	791
Binding Transmission Constraints	103,853	-	1,539	130,783	-	377
Market to Market Transmission Constraints	2,657	-	49,547	7,526	17	49,725
All Transmission Constraints	114,013	-	53,835	150,078	17	50,893

Prior to September 1, 2022, transmission constraint penalty factors frequently set prices when PJM modeled a surrogate constraint to limit the dispatch of a generator that would experience voltage instability at its full output due to a transmission outage. Since September 1, 2022, PJM is using a generator output limit constraint to manage generator voltage instability issues. In 2024, there were 25,634 constraint intervals during which PJM reduced the output of generators to manage instability. Changes to the surrogate constraint limit that exceed the unit's ability to reduce output cause constraint violations. Constraint violations also occur when the unit follows the regulation signal or increases its minimum operating parameters above the surrogate constraint limit. Prices set at the \$2,000 per MWh penalty factor are not useful signals to the market under these conditions and create false arbitrage opportunities for virtuals.

PJM used CT pricing logic until the implementation of fast start pricing on September 1, 2021, to force otherwise uneconomic resources to be marginal and set price in the day-ahead and real-time market solutions. In the event PJM committed a resource that was uneconomic and/or offered with inflexible parameters, PJM used CT pricing logic to model a constraint with a variable flow limit, paired with an artificial override of the inflexible resource's economic minimum, to force the resource to be marginal in the PJM market solution.<sup>97</sup> Frequently, PJM operators also manually overrode the transmission violation penalty factor of the constraint to match the offer price of the resource to artificially control the shadow price of the constraint.


PJM's use of CT pricing logic was inconsistent with the efficient market dispatch and pricing. For that reason, in 2019, FERC declared CT pricing logic to be unjust and unreasonable.<sup>98</sup> PJM continues to use similar methods

to artificially change the prices, like using thermal surrogates and forcing units to be marginal. These practices can lead to inefficient market outcomes.

### Net Generation by Zone

Figure 3-47 shows the difference between the PJM real-time generation and real-time load by zone in 2024. Figure 3-47 is color coded using a scale on which red shades represent zones that have less generation than load and green shades represent zones that have more generation than load, with darker shades meaning greater amounts of net generation or load. Table 3-63 shows the difference between the real-time generation and real-time load by zone in 2023 and 2024.

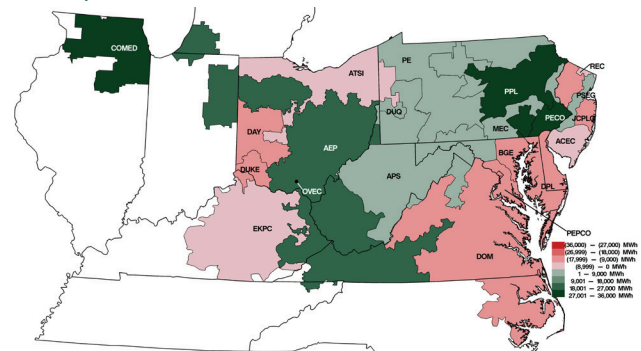**Figure 3-47 Map of real-time generation less real-time load by zone: 2024<sup>99</sup>**



<sup>97</sup> PJM dispatchers generally log the resources paired with a constraint in the CT pricing logic. The data presented is based on PJM dispatcher logs.

<sup>98</sup> 167 FERC ¶ 61,058 at P 69 (2019).

<sup>99</sup> Real-time zonal generation data for the map and corresponding table is based on the zonal designation for every bus listed in the most current PJM LMP bus model, which can be found at <http://www.pjm.com/markets-and-operations/energy/lmp-model-info.aspx>.

**Table 3-63 Real-time generation less real-time load by zone (GWh): 2023 and 2024**

Zonal Generation and Load (GWh)						
Zone	2023			2024		
	Generation	Load	Net	Generation	Load	Net
ACEC	2,577	9,482	(6,904)	1,575	9,720	(8,145)
AEP	151,688	122,300	29,388	153,289	127,875	25,414
APS	52,690	46,549	6,141	49,815	47,856	1,959
ATSI	52,450	63,747	(11,297)	54,539	65,702	(11,163)
BGE	16,602	28,951	(12,349)	17,420	29,969	(12,550)
COMED	134,459	89,033	45,426	138,165	90,905	47,260
DAY	1,427	16,491	(15,063)	2,051	17,059	(15,008)
DUKE	9,840	25,172	(15,331)	13,109	26,026	(12,917)
DOM	92,891	113,612	(20,721)	105,303	121,532	(16,229)
DPL	4,955	17,528	(12,572)	5,076	18,168	(13,093)
DUQ	16,229	12,809	3,419	15,502	13,319	2,183
EKPC	8,824	13,129	(4,305)	9,300	13,776	(4,477)
JCPLC	9,056	20,993	(11,937)	8,246	21,650	(13,404)
MEC	17,516	14,708	2,809	18,198	14,964	3,234
OVEC	9,582	117	9,464	9,988	116	9,872
PECO	75,805	36,689	39,116	75,063	38,004	37,059
PE	27,629	16,037	11,592	27,976	16,530	11,446
PEPCO	10,340	26,747	(16,407)	10,580	27,616	(17,036)
PPL	70,288	38,849	31,439	74,792	39,806	34,986
PSEG	45,075	40,744	4,332	42,861	42,180	681
REC	0	1,366	(1,366)	0	1,411	(1,411)

## Net Generation and Load

PJM sums all negative (injections) and positive (withdrawals) at each designated load bus when calculating net load (accounting load). PJM sums all of the negative (withdrawals) and positive (injections) at each generation bus when calculating net generation. Netting withdrawals and injections by bus type (generation or load) affects the measurement of total load and total generation. Energy withdrawn at a generation bus to provide, for example, auxiliary/parasitic power or station power, power to synchronous condenser motors, power to onsite customers, or power to run pumped storage pumps, is actually load, not negative generation. Energy injected at load buses by behind the meter generation is actually generation, not negative load.

The zonal load-weighted LMP is calculated by weighting the zone's load bus LMPs by the zone's load bus accounting load. The definition of injections and withdrawals of energy as generation or load affects PJM's calculation of zonal load-weighted LMP.

The MMU recommends that during intervals when a generation bus shows a net withdrawal, the energy withdrawal be treated as load, not negative generation, for purposes of calculating load and load-weighted LMP. The MMU also recommends that during intervals when

a load bus shows a net injection, the energy injection be treated as generation, not negative load, for purposes of calculating generation and load-weighted LMP.

## Fuel Prices, LMP, and Dispatch

### Energy Production by Fuel Source

Table 3-64 shows PJM generation by fuel source in GWh for 2023 and 2024.

In 2024, generation from coal units increased 1.4 percent, generation from natural gas units increased 3.5 percent, generation from oil units increased 53.1 percent, generation from wind units increased 8.5 percent, and generation from solar units increased 58.1 percent compared to 2023.

**Table 3-64 Generation (By fuel source (GWh)): 2023 and 2024<sup>100 101</sup>**

	2023		2024		Change in Output
	GWh	Percent	GWh	Percent	
Coal	120,876.1	14.7%	122,583.3	14.5%	1.4%
Bituminous	108,651.3	13.2%	107,270.7	12.7%	(1.3%)
Sub Bituminous	6,428.1	0.8%	9,548.2	1.1%	48.5%
Other Coal	5,796.7	0.7%	5,764.4	0.7%	(0.6%)
Nuclear	273,488.6	33.3%	272,744.4	32.2%	(0.3%)
Gas	363,659.7	44.3%	376,249.8	44.5%	3.5%
Natural Gas CC	331,767.3	40.4%	340,951.1	40.3%	2.8%
Natural Gas CT	21,077.7	2.6%	20,916.2	2.5%	(0.8%)
Natural Gas Other Units	9,570.7	1.2%	13,250.0	1.6%	38.4%
Other Gas	1,244.0	0.2%	1,132.6	0.1%	(9.0%)
Hydroelectric	15,488.8	1.9%	16,001.4	1.9%	3.3%
Pumped Storage	6,096.5	0.7%	6,430.5	0.8%	5.5%
Run of River	7,644.6	0.9%	7,624.6	0.9%	(0.3%)
Other Hydro	1,747.6	0.2%	1,946.3	0.2%	11.4%
Wind	28,937.2	3.5%	31,384.5	3.7%	8.5%
Waste	3,992.6	0.5%	3,912.1	0.5%	(2.0%)
Oil	2,676.7	0.3%	4,098.6	0.5%	53.1%
Heavy Oil	38.2	0.0%	156.8	0.0%	310.4%
Light Oil	918.5	0.1%	2,188.2	0.3%	138.2%
Diesel	40.4	0.0%	32.4	0.0%	(19.8%)
Other Oil	1,679.6	0.2%	1,721.2	0.2%	2.5%
Solar	11,097.7	1.4%	17,547.7	2.1%	58.1%
Battery	28.7	0.0%	51.7	0.0%	80.4%
Biofuel	1,265.0	0.2%	1,249.4	0.1%	(1.2%)
Total	821,511.0	100.0%	845,823.0	100.0%	3.0%

<sup>100</sup> All generation is total gross generation output and does not net out the MWh withdrawn at a generation bus to provide auxiliary/parasitic power or station power, power to synchronous condenser motors, power to run pumped hydro pumps or power to charge batteries.

<sup>101</sup> Other Gas includes: Landfill, Propane, Butane, Hydrogen, Gasified Coal, and Refinery Gas. Other Coal includes: Lignite, Liquefied Coal, Gasified Coal, and Waste Coal. Other oil includes: Gasoline, Jet Oil, Kerosene, and Petroleum-Other.



Table 3-65 Monthly generation (By fuel source (GWh)): 2024

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
Coal	15,756.3	8,438.5	6,794.2	7,545.8	9,134.6	13,401.5	14,413.2	13,168.5	7,342.9	6,934.1	7,166.0	12,487.7	122,583.3
Bituminous	13,683.1	7,179.2	6,137.1	6,860.5	8,463.1	11,375.1	11,900.0	11,317.8	6,691.4	6,459.6	6,275.8	10,928.1	107,270.7
Sub Bituminous	1,504.1	679.7	0.5	72.0	275.1	1,450.0	1,828.9	1,478.8	379.6	169.5	629.3	1,080.5	9,548.2
Other Coal	569.1	579.5	656.5	613.3	396.4	576.4	684.3	371.9	271.9	305.1	261.0	479.0	5,764.4
Nuclear	24,729.8	22,462.5	21,926.5	19,070.3	22,113.0	23,205.6	23,661.2	24,076.1	22,570.4	21,998.0	21,945.5	24,985.6	272,744.4
Gas	32,516.5	30,491.6	29,868.6	26,303.4	27,432.1	34,274.7	40,391.9	38,035.2	32,595.4	25,958.9	27,210.2	31,171.2	376,249.8
Natural Gas CC	30,212.2	29,364.4	28,351.4	23,260.0	24,193.0	30,702.7	34,585.9	33,645.0	29,670.2	22,766.1	24,715.8	29,484.2	340,951.1
Natural Gas CT	1,644.7	718.0	1,026.3	2,077.4	2,132.6	1,833.4	2,896.7	2,362.8	1,844.4	1,912.4	1,387.4	1,080.1	20,916.2
Natural Gas Other Units	554.4	312.7	392.5	875.5	1,013.2	1,647.9	2,812.8	1,929.9	987.0	1,188.0	1,020.2	516.0	13,250.0
Other Gas	105.1	96.4	98.4	90.4	93.3	90.7	96.6	97.5	93.9	92.5	86.9	90.9	1,132.6
Hydroelectric	1,751.3	1,467.0	1,512.3	1,376.4	1,589.3	1,359.4	1,387.5	1,624.1	1,024.9	750.7	828.9	1,329.6	16,001.4
Pumped Storage	536.0	525.0	403.2	366.7	567.3	688.9	774.7	745.9	580.9	331.0	423.3	487.5	6,430.5
Run of River	1,065.8	798.3	1,015.2	915.7	845.3	405.4	319.4	612.2	287.4	346.9	304.0	708.9	7,624.6
Other Hydro	149.5	143.7	93.9	94.0	176.6	265.1	293.4	266.0	156.6	72.7	101.5	133.2	1,946.3
Wind	3,127.6	2,975.8	3,890.8	3,569.3	2,136.5	2,233.5	1,151.4	1,233.7	1,496.2	2,670.5	3,402.6	3,496.7	31,384.5
Waste	329.6	321.3	329.6	308.9	357.2	337.4	329.1	335.8	287.2	314.0	315.0	346.9	3,912.1
Oil	290.3	134.0	178.1	222.2	460.5	411.5	784.9	489.0	316.9	306.6	230.3	274.3	4,098.6
Heavy Oil	12.0	0.0	0.0	31.3	13.8	2.3	42.6	17.8	0.0	0.0	0.4	36.6	156.8
Light Oil	101.0	17.5	27.3	40.8	286.4	274.8	575.4	305.5	211.5	183.8	78.3	85.8	2,188.2
Diesel	13.5	0.1	0.3	0.4	0.8	1.8	4.9	2.3	0.5	2.0	1.1	4.7	32.4
Other Oil	163.7	116.3	150.5	149.8	159.5	132.6	162.1	163.4	104.9	120.9	150.5	147.1	1,721.2
Solar	583.0	1,047.7	1,269.1	1,487.2	1,680.7	2,189.0	2,100.4	2,016.8	1,539.6	1,732.7	995.9	905.7	17,547.7
Battery	4.6	4.6	5.7	4.4	5.0	3.3	3.1	3.5	3.6	4.4	4.4	4.9	51.7
Biofuel	135.3	118.7	87.7	104.6	92.2	136.6	116.3	129.8	76.8	42.1	76.3	133.1	1,249.4
Total	79,224.4	67,461.7	65,862.6	59,992.5	65,000.9	77,552.3	84,339.0	81,112.5	67,254.0	60,712.1	62,175.0	75,135.7	845,823.0

Table 3-66 shows the difference between the day-ahead and the real-time average generation by fuel source.

Table 3-66 Day-ahead and real-time average generation (By fuel source (GWh)): 2024

2024						
	Day-Ahead		Real-Time		RT - DA	Percent Difference
	GWh	Percent	GWh	Percent		
Coal	123,678.9	15.1%	122,583.3	14.5%	(1,095.6)	(0.9%)
Bituminous	107,861.6	13.1%	107,270.7	12.7%	(590.8)	(0.5%)
Sub Bituminous	10,241.6	1.2%	9,548.2	1.1%	(693.4)	(6.8%)
Other Coal	5,575.8	0.7%	5,764.4	0.7%	188.7	3.4%
Nuclear	268,212.4	32.7%	272,744.4	32.2%	4,532.0	1.7%
Gas	369,346.4	45.0%	376,249.8	44.5%	6,903.4	1.9%
Natural Gas CC	336,373.8	41.0%	340,951.1	40.3%	4,577.2	1.4%
Natural Gas CT	18,484.2	2.3%	20,916.2	2.5%	2,432.0	13.2%
Natural Gas Other Units	13,420.9	1.6%	13,250.0	1.6%	(170.9)	(1.3%)
Other Gas	1,067.5	0.1%	1,132.6	0.1%	65.1	6.1%
Hydroelectric	15,347.7	1.9%	16,001.4	1.9%	653.7	4.3%
Pumped Storage	7,503.9	0.9%	6,430.5	0.8%	(1,073.4)	(14.3%)
Run of River	7,843.8	1.0%	7,624.6	0.9%	(219.2)	(2.8%)
Other Hydro	0.0	0.0%	1,946.3	0.2%	1,946.3	NA
Wind	21,563.7	2.6%	31,384.5	3.7%	9,820.9	45.5%
Waste	3,889.7	0.5%	3,912.1	0.5%	22.4	0.6%
Oil	3,904.7	0.5%	4,098.6	0.5%	193.9	5.0%
Heavy Oil	119.0	0.0%	156.8	0.0%	37.7	31.7%
Light Oil	2,170.4	0.3%	2,188.2	0.3%	17.8	0.8%
Diesel	13.0	0.0%	32.4	0.0%	19.4	149.7%
Other Oil	1,602.3	0.2%	1,721.2	0.2%	119.0	7.4%
Solar	13,419.2	1.6%	17,547.7	2.1%	4,128.5	30.8%
Battery	23.2	0.0%	51.7	0.0%	28.5	123.0%
Biofuel	1,219.2	0.1%	1,249.4	0.1%	30.2	2.5%
Total	820,605.1	100.0%	845,823.0	100.0%	25,217.8	3.1%

Table 3-67 shows the share of generation by natural gas, coal, nuclear and other fuel types in the real-time energy market since 2008. Generation from natural gas was 44.3 percent, the highest level for the same period since the start of PJM markets, and coal was 14.5 percent, the lowest level for the same period since the start of PJM markets.

**Table 3-67 Share of generation by fuel source: 2008 through 2024**

	Natural Gas	Coal	Nuclear	Other Fuel Type
2008	7.4%	54.9%	34.7%	3.0%
2009	10.0%	50.3%	35.9%	3.7%
2010	11.7%	49.3%	34.6%	4.4%
2011	14.1%	47.1%	34.5%	4.3%
2012	18.8%	42.1%	34.6%	4.5%
2013	16.7%	44.2%	34.8%	4.3%
2014	17.8%	43.3%	34.4%	4.5%
2015	23.0%	36.2%	35.5%	5.3%
2016	26.5%	33.9%	34.4%	5.3%
2017	26.8%	31.8%	35.6%	5.9%
2018	30.6%	28.6%	34.2%	6.6%
2019	36.2%	23.8%	33.6%	6.4%
2020	39.6%	19.3%	34.2%	6.9%
2021	37.7%	22.2%	32.8%	7.4%
2022	39.8%	20.0%	32.3%	7.9%
2023	44.1%	14.7%	33.3%	7.9%
2024	44.3%	14.5%	32.2%	8.9%

## Fuel Diversity

Figure 3-48 shows the fuel diversity index (FDI<sub>c</sub>) for PJM energy generation.<sup>102</sup> The FDI<sub>c</sub> is defined as  $1 - \sum_{i=1}^N s_i^2$ , where  $s_i$  is the share of fuel type  $i$ . The minimum possible value for the FDI<sub>c</sub> is zero, corresponding to all generation from a single fuel type. The maximum possible value for the FDI<sub>c</sub> results when each fuel type has an equal share of total generation. For a generation fleet composed of 10 fuel types, the maximum achievable index is 0.9. The fuel type categories used in the calculation of the FDI<sub>c</sub> are the 10 primary fuel sources in Table 3-64 with nonzero generation values. As fuel diversity has increased, seasonality in the FDI<sub>c</sub> has decreased and the FDI<sub>c</sub> has exhibited less volatility. Since 2012, the monthly FDI<sub>c</sub> has been less volatile as a result of the decline in the share of coal from 51.3 percent prior to 2012 to 28.6 percent from 2012 through December 2024. A significant drop in the FDI<sub>c</sub> occurred in the fall of 2004 as a result of the expansion of the PJM market footprint into ComEd, AEP, and Dayton Power & Light Zones and

the increased shares of coal and nuclear that resulted.<sup>103</sup> The increasing trend that began in 2008 is a result of decreasing coal generation, increasing gas generation and increasing renewable generation. Coal generation as a share of total generation was 54.9 percent for 2008 and 14.5 percent for 2024. Gas generation as a share of total generation was 7.4 percent for 2008 and 44.4 percent for 2024. Wind and solar generation as a share of total generation was 0.5 percent for 2008 and 5.8 percent for 2024.

The FDI<sub>c</sub> increased 0.8 percent in 2024 compared to 2023.

The FDI<sub>c</sub> was also used to measure the impact on fuel diversity of potential retirements in 2025 through 2030. A total of 34,733 MW of capacity are at risk of retirement, consisting of 4,684 MW currently planning to retire, 16,786 MW expected to retire for regulatory reasons and 13,264 MW expected to be uneconomic.<sup>104</sup> This capacity consists primarily of coal steam plants and CTs. The units expected to retire by the end of 2025 generated 37,033.8 GWh in 2024. The dashed line (green) in Figure 3-48 shows a counterfactual result for FDI<sub>c</sub> assuming the 37,033.8 GWh of generation from uneconomic units and expected 2025 retirements were replaced by gas, wind and solar generation.<sup>105</sup> The FDI<sub>c</sub> for 2024 under this counterfactual assumption would have been 1.4 percent lower than the actual FDI<sub>c</sub>. The units expected to retire by the end of 2030 generated 68,146.1 GWh in 2024. Replacing this generation with gas, wind and solar generation results in a counterfactual FDI<sub>c</sub> that is 1.4 percent higher than the actual FDI<sub>c</sub>.<sup>106</sup> The dashed line (blue) in Figure 3-48 shows a counterfactual result for FDI<sub>c</sub> assuming that this generation is replaced with gas, wind and solar generation.

<sup>102</sup> The MMU developed the FDI to provide an objective metric of fuel diversity. The FDI metric is similar to the HHI used to measure market concentration. The FDI is calculated separately for energy output and for installed capacity.


<sup>103</sup> See the 2019 Annual State of the Market Report for PJM, Volume 2, Appendix A, "PJM Geography" for an explanation of the expansion of the PJM footprint. The integration of the ComEd Control Area occurred in May 2004 and the integration of the AEP and Dayton Zones occurred in October 2004.

<sup>104</sup> See Units At Risk of Retirement in the 2024 Annual State of the Market Report for PJM, Volume 2, Section 7: Net Revenue.

<sup>105</sup> It is assumed that 11,907.4 GWh of the replacement energy will be from new wind and solar units. This value represents the increase over 2024 levels in renewable generation that is required by RPS in 2025. The split between solar (59.7 percent) and wind (40.3 percent) is based on queue data and 2024 capacity factors in Table 8-33 and Table 8-37.

<sup>106</sup> It is assumed that 55,110.7 GWh of the replacement energy will be from new wind and solar units. This value represents the increase over 2024 levels in renewable generation that is required by RPS in 2030. The split between solar (59.7 percent) and wind (40.3 percent) is based on queue data and 2024 capacity factors in Table 8-33 and Table 8-37.

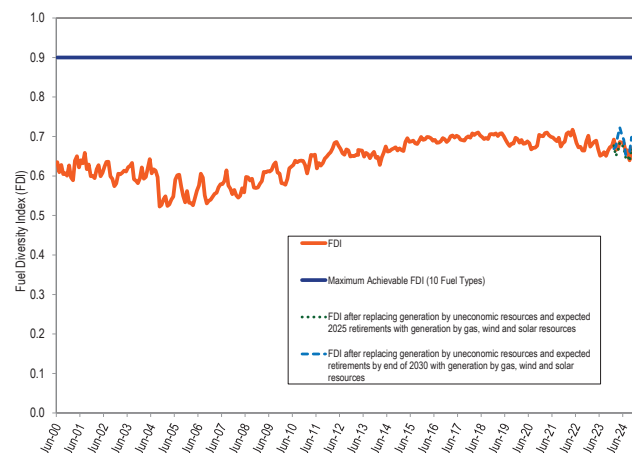**Figure 3-48 Fuel diversity index for monthly generation: June 2000 through December 2024**



## Natural Gas Supply Issues

Both pipeline transportation and commodity natural gas are needed to deliver natural gas to power plants. Generators have a number of options which vary by pipeline and market area. A generator could purchase a delivered service in which the seller bundles the transportation and commodity, on a term contract or a spot basis. A generator could purchase pipeline transportation and commodity natural gas separately with a term supply contract or through daily purchases in the spot market. Generators could purchase storage service. Storage services can be bundled with pipeline transportation, or storage and transportation purchased separately to move gas to or from a storage facility. The storage service will determine the total storage capacity and the injection and withdrawal rights. Storage offers the owner the ability to have on demand supplies, or the ability to redirect unused supplies to storage. Predetermined allocation (PDA) nominations can be used to direct the pipeline as to how to treat an excess or a deficiency of gas at a delivery point. Combinations of these options are also available.

Pipelines build transportation capacity and sell firm capacity to customers. Most of the transportation capacity is sold at tariff rates but in some cases negotiated rates are agreed to. A majority of firm capacity is contracted with gas utilities, gas marketers, industrial customers and generators. The purchasers of firm transportation capacity have the right to resell their capacity. Any such release must be done on the pipeline's electronic bulletin board. Bidders must be approved by the pipeline. When

firm capacity on the pipelines is not being used, the pipeline tariffs provide for interruptible service.

In order to be able to actually use the purchased pipeline transportation service, pipelines may enforce nomination deadlines to require generation owners to nominate the flow of gas by defined deadlines. Some pipelines may also impose site specific restrictions that limit the ability of generators to nominate and schedule gas beyond the nomination deadlines. Table 3-68 shows the approved nomination deadlines and corresponding start time of gas flow.<sup>107</sup> Pipelines provide that firm service requests may replace, or bump, interruptible nominations on the pipeline under defined conditions.

**Table 3-68 Approved nomination deadlines**

	Nomination Cycle	Nom Deadline (EPT)	Time of Flow (EPT)	Bumping	Hours left in gas day for supply to flow
Day Before Flow	Timely	1400	1000		24
Day Before Flow	Evening	1900	1000	Yes	24
Day of Flow	Intraday 1	1100	1500	Yes	19
Day of Flow	Intraday 2	1530	1900	Yes	15
Day of Flow	Intraday 3	2000	2300	No	11

In 2024 and 2025, some interstate gas pipelines that provide service in the PJM service territory issued notices limiting the flexibility of firm and nonfirm transportation services. These notices include alerts, constraints, warnings of operational flow orders (OFO) and actual OFOs. These notices generally permit the pipelines to enforce nomination deadlines and to restrict the provision of gas to 24 hour ratable takes, meaning that nominations must be the same for each hour in the gas day. Pipelines may also enforce strict balancing constraints which limit the ability of gas users to deviate from the 24 hour ratable take and which may limit the ability of users to have access to unused gas. The pipelines providing service in the PJM service territory that issued notices were: ANR Pipeline, Columbia Gas Transmission, Cove Point, East Tennessee Natural Gas, Eastern Gas Transmission & Storage, Eastern Shore, Equitrans Transmission, Horizon Pipeline, Natural Gas Pipeline, Northern Border Pipeline, Texas Eastern, Tennessee Gas Pipeline and Transcontinental Gas Pipeline.

Pipeline operators use restrictive and inflexible rules to manage the balance of supply and demand during constrained operating conditions determined by the pipeline. The independent operations of geographically

<sup>107</sup> Nomination deadlines approved in FERC Order No. 809, implemented April 1, 2016.

overlapping pipelines during extreme conditions highlight the shortcomings of a gas pipeline network that relies on individual pipelines to manage the balancing of total supply and demand across a broad geographical area that includes multiple pipelines. The independent operational restrictions imposed by pipelines and the impact on electric generators during extreme conditions demonstrate the potential benefits to creating a separate gas ISO/RTO structure to coordinate the supply of gas across pipelines and with the electric RTOs and to facilitate the interoperability of the pipelines in an explicit network.

The increase in natural gas fired capacity in PJM, and the expected further increase, has highlighted issues with the dependence of PJM system reliability on the fuel transportation arrangements entered into by generators. The risks to the fuel supply for gas generators, including the risk of interruptible supply on cold days and the ability to get gas on short notice during times of critical pipeline operations, create risks for the bulk power system.

In general, the availability status of gas generators in the PJM energy market does not accurately reflect their ability to procure and nominate gas on the pipelines based on the rules defined by the pipelines. If the result of the pipeline rules is that some gas generators cannot reliably procure gas during the operating day in order to respond to PJM directions to generate, the result could be an inflated estimate of reserves on the PJM system, if the generator does not have back up fuel. Gas units should be required to be on forced outage if they cannot obtain gas during the operating day to meet their must offer requirement.

PJM requires real-time situational awareness of the availability of all generators, including gas-fired generators, during the operating day, in order to operate the system effectively including knowledge of the level of available reserves. The MMU recommends: that gas generators be required to confirm, regularly during the operating day, that they can obtain gas if requested to operate at their economic maximum level; that gas generators provide that information to PJM during the operating day; and that gas generators

be required to be on forced outage if they cannot obtain gas during the operating day to meet their must offer requirement as a result of pipeline restrictions, and they do not have backup fuel. As part of this, the MMU recommends that PJM collect data on each individual generator's fuel supply arrangements at least annually or when such arrangements change, and analyze the associated locational and regional risks to reliability.

Notification time is the period between PJM's notification and the beginning of the start sequence for a generating resource. Combustion turbines normally have notification times between six and 30 minutes. When pipelines require generators to nominate gas per the NAESB deadlines, generators must nominate gas well in advance and cannot start in six or 30 minutes. Instead, generators need significantly more time to nominate gas. This increase in the time needed should be requested and reflected in the units' notification time.

For example, the last nomination cycle available per NAESB is intraday 3 (ID3), see Table 3-68. The ID3 deadline is 20:00 EPT for gas that starts flowing at 23:00 (in three hours). The previous cycle, intraday 2 (ID2) deadline is at 15:30 EPT for gas that starts flowing at 19:00. A generator that has not nominated gas by ID2 cannot start until 23:00. Therefore, at 19:00, the unit has an implied time to start of four hours. Four hours is equal to 23:00 (the earliest the unit can start) minus 19:00. Table 3-69 shows the notification time gas fired generators should be requesting and submitting when pipelines require nominating per the NAESB cycle deadlines.

**Table 3-69 Generator notification times when pipeline NAESB cycle deadlines are imposed**

Hour	HE1	HE2	HE3	HE4	HE5	HE6	HE7	HE8	HE9	HE10	HE11	HE12
Notification Time	15	14	13	12	11	10	9	8	7	6	9	8
Time On (If Called)	15:00	15:00	15:00	15:00	15:00	15:00	15:00	15:00	15:00	15:00	19:00	19:00
Nearest Cycle	ID1	ID1	ID1	ID1	ID1	ID1	ID1	ID1	ID1	ID1	ID2	ID2

Hour	HE13	HE14	HE15	HE16	HE17	HE18	HE19	HE20	HE21	HE22	HE23	HE24
Notification Time	7	6	9	8	7	6	5	20	19	18	17	16
Time On (If Called)	19:00	19:00	23:00	23:00	23:00	23:00	23:00	15:00	15:00	15:00	15:00	15:00
Nearest Cycle	ID2	ID2	ID3	ID3	ID3	ID3	ID3	ID1	ID1	ID1	ID1	ID1

The MMU proposed enhancements for situational awareness and transparency to improve the scheduling problem that PJM and gas fired units face, addressing how to reflect pipeline constraints in generator operating parameters, including how generators should submit notification times, and minimum run times

and request temporary parameter exceptions.<sup>108</sup> The resultant guidelines were posted by the MMU and PJM on September 8, 2023.<sup>109</sup>

## Types of Marginal Resources

LMPs result from the operation of a market based on security-constrained, least-cost dispatch in which marginal resources determine system LMPs, based on their offers. Marginal resource designation is not limited to physical resources in the day-ahead energy market. INC offers, DEC bids and up to congestion transactions are dispatchable injections and withdrawals in the day-ahead energy market that can set price via their offers and bids.

Table 3-70 shows the type of fuel used and technology by marginal resources in the real-time energy market. There can be more than one marginal resource in any given interval as a result of transmission constraints. In 2024, coal units were 10.3 percent and natural gas units were 73.7 percent of marginal resources. In 2024, natural gas combined cycle units were 60.8 percent of marginal resources. In 2023, coal units were 9.1 percent and natural gas units were 83.1 percent of the total marginal resources. In 2023, natural gas combined cycle units were 69.2 percent of the total marginal resources. In 2024, 58.5 percent of the wind marginal units had negative offer prices, 34.9 percent had zero offer prices and 6.6 percent of the wind marginal units had positive offer prices. In 2023, 54.7 percent of the wind marginal units had negative offer prices, 44.2 percent had zero offer prices and 1.0 percent had positive offer prices.

The proportion of marginal nuclear units decreased from 0.62 percent in 2023 to 0.40 percent in 2024. Most nuclear units are offered as fixed generation in the PJM market. A small number of nuclear units have been offered with a dispatchable range since 2015. The dispatchable nuclear units do not always respond to dispatch instructions.

PJM implemented fast start pricing on September 1, 2021. The marginal resources shown in Table 3-70 are from the pricing run, which may not be the same as marginal resources from the dispatch run.

<sup>108</sup> "Gas Nomination Cycles and Units Operating Parameters," Electric Gas Coordination Senior Task Force (EGCSTF), August 15, 2023.

<sup>109</sup> See Guidelines posted by the MMU and PJM: Temporary Operating Parameter Limit (PLS) Exceptions due to Pipeline Restrictions. <[http://www.monitoringanalytics.com/reports/Market\\_Messages/Messages/IMM\\_Temporary\\_Operating\\_Parameter\\_Limit\\_\(PLS\)\\_Exceptions\\_due\\_to\\_Pipeline\\_Restrictions\\_20230908.pdf](http://www.monitoringanalytics.com/reports/Market_Messages/Messages/IMM_Temporary_Operating_Parameter_Limit_(PLS)_Exceptions_due_to_Pipeline_Restrictions_20230908.pdf)>.

**Table 3-70 Type of fuel used and technology (By real-time marginal units): 2020 through 2024<sup>110</sup>**

Fuel	Technology	2020	2021	2022	2023	2024
Gas	CC	64.33%	59.75%	61.66%	69.20%	60.79%
Wind	Wind	6.75%	11.04%	11.12%	5.53%	13.55%
Coal	Steam	17.53%	14.15%	10.02%	9.14%	10.27%
Gas	CT	5.89%	10.06%	11.26%	11.01%	9.68%
Gas	Steam	2.12%	1.17%	1.42%	1.83%	2.61%
Oil	CT	1.25%	1.13%	2.25%	0.91%	1.21%
Gas	RICE	0.29%	0.67%	0.86%	1.09%	0.58%
Uranium	Steam	1.35%	1.00%	0.39%	0.62%	0.40%
Other	Solar	0.33%	0.76%	0.74%	0.02%	0.38%
Oil	RICE	0.04%	0.06%	0.11%	0.18%	0.15%
Oil	Steam	0.06%	0.06%	0.03%	0.06%	0.15%
Municipal Waste	RICE	0.00%	0.00%	0.00%	0.06%	0.08%
Municipal Waste	Steam	0.02%	0.02%	0.04%	0.12%	0.06%
Other	Steam	0.03%	0.08%	0.05%	0.04%	0.05%
Oil	CC	0.00%	0.02%	0.06%	0.19%	0.02%
Other	Battery	0.00%	0.00%	0.00%	0.00%	0.00%
Landfill Gas	CT	0.01%	0.01%	0.00%	0.00%	0.00%
Municipal Waste	CT	0.00%	0.00%	0.00%	0.00%	0.00%
Landfill Gas	Steam	0.00%	0.00%	0.00%	0.00%	0.00%
Gas	Fuel Cell	0.00%	0.00%	0.00%	0.00%	0.00%
Landfill Gas	RICE	0.00%	0.00%	0.00%	0.00%	0.00%

Figure 3-49 shows the type of fuel used by marginal resources in the real-time energy market for every year since 2004. The role of coal as a marginal resource has declined while the role of gas as a marginal resource has increased.

**Figure 3-49 Type of fuel used (By real-time marginal units): 2004 through 2024**

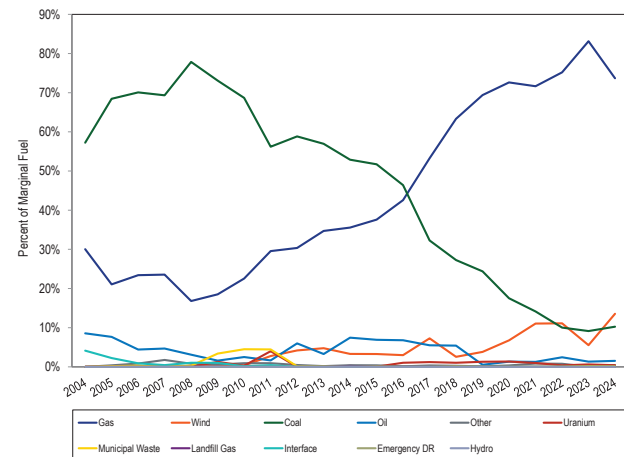


Table 3-71 shows the type of fuel and technology by fast start marginal resources and other marginal resources in the real-time energy market in 2024. In 2024, marginal fast start resources accounted for 5.79 percent of all marginal resources in the pricing run.

<sup>110</sup> The unit type RICE refers to Reciprocating Internal Combustion Engines.



**Table 3-71 Fuel type and technology (Real-time marginal units and fast start marginal units): 2024**


Fuel	Technology	2024		
		Fast Start	Other	Both
Coal	Steam	0.00%	10.27%	10.27%
Gas	CC	0.00%	60.79%	60.79%
Gas	CT	4.33%	5.35%	9.68%
Gas	RICE	0.58%	0.01%	0.58%
Gas	Steam	0.00%	2.61%	2.61%
Landfill Gas	CT	0.00%	0.00%	0.00%
Municipal Waste	RICE	0.02%	0.06%	0.08%
Municipal Waste	Steam	0.00%	0.06%	0.06%
Oil	CC	0.00%	0.02%	0.02%
Oil	CT	0.56%	0.65%	1.21%
Oil	RICE	0.13%	0.02%	0.15%
Oil	Steam	0.00%	0.15%	0.15%
Other	Battery	0.00%	0.00%	0.00%
Other	Solar	0.02%	0.36%	0.38%
Other	Steam	0.00%	0.05%	0.05%
Uranium	Steam	0.00%	0.40%	0.40%
Wind	Wind	0.16%	13.39%	13.55%
All Marginal Units		5.79%	94.21%	100.00%

## Fuel Price Trends and LMP

In a competitive market, changes in LMP follow changes in the marginal costs of marginal units, the units setting LMP. In general, fuel costs make up between 80 percent and 90 percent of short run marginal cost depending on generating technology, unit efficiency, unit age and other factors. The impact of fuel cost on marginal cost and on LMP depends on the fuel burned by marginal units and changes in fuel costs. Changes in emission allowance costs also contribute to changes in the marginal cost of marginal units.

Figure 3-50 shows fuel prices in PJM for 2012 through 2024. Natural gas prices were mixed, while coal prices and oil prices decreased in 2024 compared to 2023. In 2024, the price of eastern natural gas was 6.0 percent higher and the price of western natural gas was 3.4 percent lower than in 2023. The price of Northern Appalachian coal was 16.1 percent lower; the price of Central Appalachian coal was 9.9 percent lower; and the price of Powder River Basin coal was 3.9 percent lower.<sup>111</sup> The price of ULSD NY Harbor Barge was 22.2 percent lower in 2024 than in 2023.

<sup>111</sup> Eastern natural gas consists of the average of Texas M3, Transco Zone 6 non-NY, Transco Zone 6 NY and Transco Zone 5 daily indices. Western natural gas prices are the average of Columbia Appalachia and Chicago Citygate daily indices. Production gas prices are the average of Dominion South Point, Tennessee Zone 4, and Transco Leidy Line receipts daily indices. Coal prices are the average of daily fuel prices for Central Appalachian coal, Northern Appalachian coal, and Powder River Basin coal. All fuel prices are from Platts.

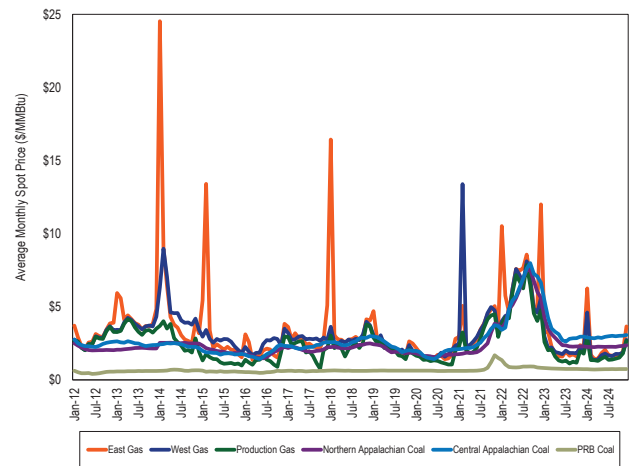**Figure 3-50 Spot average fuel price comparison: 2012 through 2024 (\$/MMBtu)**

## Components of LMP

### Components of Real-Time Load-Weighted LMP

LMPs result from the operation of a market based on security-constrained, economic (least cost) dispatch (SCED) in which marginal units determine system LMPs, based on their offers and up to fourteen minute ahead forecasts of system conditions. Those offers can be decomposed into components including fuel costs, emission costs, variable operation and maintenance (VOM) costs, markup, FMU adder and the 10 percent cost adder. As a result, it is possible to decompose LMP by the components of unit offers.

Cost offers of marginal units are separated into their component parts. The fuel related component is based on unit specific heat rates and spot fuel prices. Emission costs are calculated using spot prices for NO<sub>x</sub>, SO<sub>2</sub> and CO<sub>2</sub> emission credits, emission rates for NO<sub>x</sub>, emission rates for SO<sub>2</sub> and emission rates for CO<sub>2</sub>. The CO<sub>2</sub> emission costs are applicable to PJM units in the PJM states that participate in RGGI: Delaware, Maryland, and New Jersey.<sup>112</sup> The FMU adder is the calculated contribution of the FMU and AU adders to LMP that results when units with FMU or AU adders are marginal.

Since the implementation of scarcity pricing on October 1, 2012, PJM jointly optimizes the commitment and

<sup>112</sup> New Jersey withdrew from RGGI, effective January 1, 2012, and rejoined RGGI effective January 1, 2020. Virginia joined RGGI effective January 1, 2021, and left RGGI on December 31, 2023. A challenge to Virginia's leaving RGGI is pending. See Floyd County Circuit Court, Virginia, Case No. CL23000173-00.

dispatch of energy and reserves. When generators providing energy have to be dispatched down from their economic operating level to meet reserve requirements, the joint optimization of energy and reserves takes into account the opportunity cost of the reduced generation and the associated incremental cost to maintain reserves. If a unit incurring such opportunity costs is a marginal resource in the energy market, this opportunity cost will contribute to LMP. The component, ancillary service redispatch cost, shows the contribution of this cost to the PJM's load-weighted LMP. In addition, in periods when the pricing run solution does not meet the reserve requirements, PJM invokes shortage pricing, based on the operating reserve demand curve. During shortage conditions, the LMPs of marginal generators reflect the cost of not meeting the reserve requirements, the scarcity component, which is defined by the operating reserve demand curve.<sup>113</sup>

Starting on September 1, 2021, the components shown in Table 3-72 and Table 3-74 are from the pricing run which includes the impact of amortized start cost and amortized no load cost of the fast start marginal units. The components of LMP are shown in Table 3-72, including markup using unadjusted cost-based offers.<sup>114</sup> Table 3-72 shows that in 2024, 12.1 percent of the load-weighted LMP was the result of coal costs, 39.7 percent was the result of gas costs and 5.8 percent was the result of the cost of carbon emission allowances. Using unadjusted cost-based offers, negative markup was -10.6 percent of the load-weighted LMP. Using unadjusted cost-based offers, positive markup was 10.6 percent of the load-weighted LMP. The fuel-related components of LMP reflect the degree to which the cost of the identified fuel affects LMP and does not reflect the other components of the offers of units burning that fuel. LMP may, at times, be set by transmission constraint penalty factors. In 2024, 8.9 percent of the load-weighted LMP was the result of

transmission penalty factors. More than 99 percent of this impact occurred as a result of PJM's reduction to line ratings in SCED. The percent contribution of transmission penalty factors has increased substantially since PJM removed the constraint relaxation logic and allowed penalty factors to affect LMPs starting in February 2019. The component NA is the unexplained portion of load-weighted LMP. For several intervals, PJM failed to provide all the data needed to accurately calculate generator sensitivity factors. As a result, the LMP for those intervals cannot be decomposed into component costs. The NA component is the cumulative effect of excluding those five minute intervals. The percent column is the difference (in percentage points) in the proportion of LMP represented by each component in 2023 and 2024.

**Table 3-72 Components of real-time (Unadjusted) load-weighted average LMP: 2023 and 2024**

Element	2023		2024		Change in Percent
	Contribution to LMP	Percent	Contribution to LMP	Percent	
Gas	\$13.60	43.7%	\$13.41	39.7%	(4.0%)
Coal	\$4.49	14.4%	\$4.09	12.1%	(2.3%)
Positive Markup	\$3.29	10.6%	\$3.56	10.6%	(0.0%)
Variable Maintenance	\$2.31	7.4%	\$3.18	9.4%	2.0%
Transmission Constraint Penalty Factor	\$1.62	5.2%	\$3.01	8.9%	3.7%
Ten Percent Adder	\$1.95	6.3%	\$2.00	5.9%	(0.3%)
CO <sub>2</sub> Cost	\$1.93	6.2%	\$1.94	5.8%	(0.5%)
Variable Operations	\$1.10	3.5%	\$1.43	4.2%	0.7%
Ancillary Service Redispatch Cost	\$0.50	1.6%	\$1.33	3.9%	2.3%
Opportunity Cost Adder	\$0.87	2.8%	\$1.24	3.7%	0.9%
Oil	\$0.31	1.0%	\$1.08	3.2%	2.2%
Market-to-Market	\$0.41	1.3%	\$0.34	1.0%	(0.3%)
Increase Generation Differential	\$0.13	0.4%	\$0.24	0.7%	0.3%
LPA Rounding Difference	\$0.40	1.3%	\$0.18	0.5%	(0.8%)
Scarcity	\$0.07	0.2%	\$0.17	0.5%	0.3%
NA	\$0.15	0.5%	\$0.09	0.3%	(0.2%)
NO <sub>x</sub> Cost	\$0.51	1.6%	\$0.09	0.3%	(1.4%)
Landfill Gas	\$0.06	0.2%	\$0.05	0.2%	(0.0%)
Other	\$0.02	0.1%	\$0.02	0.0%	(0.0%)
SO <sub>2</sub> Cost	\$0.00	0.0%	\$0.00	0.0%	(0.0%)
LPA-SCED Differential	(\$0.00)	(0.0%)	(\$0.00)	(0.0%)	0.0%
Decrease Generation Differential	(\$0.01)	(0.0%)	(\$0.04)	(0.1%)	(0.1%)
Renewable Energy Credits	(\$0.07)	(0.2%)	(\$0.07)	(0.2%)	0.0%
Negative Markup	(\$2.56)	(8.2%)	(\$3.58)	(10.6%)	(2.4%)
Total	\$31.08	100.0%	\$33.74	100.0%	0.0%

### Components of Change in LMP

Table 3-73 shows the components of the increase in real-time load-weighted average LMP from 2023 to 2024. In 2024, the real-time load-weighted average LMP increased by \$2.66 per MWh, 8.5 percent. Fuel and consumables cost components of LMP (the sum of gas, coal, oil, landfill gas, variable operations) increased the LMP by \$0.50 per MWh, 18.9 percent of increase

<sup>113</sup> Scarcity component includes ancillary service redispatch cost component during periods of scarcity.

<sup>114</sup> These components are explained in the *Technical Reference for PJM Markets*, at p 27 "Calculation and Use of Generator Sensitivity/Unit Participation Factors," <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

in LMP. The emissions cost components of LMP (the sum of NO<sub>x</sub>, CO<sub>2</sub>, opportunity cost adder, SO<sub>2</sub>, and renewable energy credits) decreased the LMP by \$0.05 per MWh, -1.9 percent of the increase in LMP. The sum of the positive and negative markups, ten percent adder, and maintenance cost components, all of which reflect market power, increased the LMP \$0.16 per MWh, 6.2 percent of the increase in LMP. The scarcity component increased the LMP by \$0.10 per MWh, 3.7 percent of the increase in the LMP. The transmission constraint penalty factor increased the LMP by \$1.39 per MWh, 52.4 percent, primarily as a result of PJM's reduction of line ratings in SCED. The ancillary service redispatch cost, the opportunity cost of reduced marginal generation to meet reserve requirements, increased the LMP by \$0.83 per MWh, 31.2 percent.

**Table 3-73 Components of Change in real-time load-weighted average LMP: 2023 and 2024**

Component	2023	2024	Change in LMP	Percent of Total Change
Fuel and Consumables	\$19.56	\$20.06	\$0.50	18.9%
Emission Related	\$3.24	\$3.19	(\$0.05)	(1.9%)
Market Power Related	\$4.99	\$5.16	\$0.16	6.2%
Scarcity	\$0.07	\$0.17	\$0.10	3.7%
Transmission Constraint Penalty Factor	\$1.62	\$3.01	\$1.39	52.4%
Ancillary Service Redispatch Cost	\$0.50	\$1.33	\$0.83	31.2%
Emergency Demand Response	\$0.00	\$0.00	\$0.00	0.0%
PJM Administrative Cap	\$0.00	\$0.00	\$0.00	0.0%
All Other	\$1.10	\$0.82	(\$0.28)	(10.6%)
Total Change	\$31.08	\$33.74	\$2.66	100.0%

In order to understand the markup behavior of market participants, real-time and day-ahead LMPs are decomposed using two different approaches. In the first approach (Table 3-72 and Table 3-73) markup is the difference between the price offer and the cost-based offer (unadjusted markup). In the second approach (Table 3-74), the 10 percent markup is removed from the cost-based offers of coal, gas, and oil units (adjusted markup).

The components of LMP are shown in Table 3-74, including markup using adjusted cost-based offers.

**Table 3-74 Components of real-time (Adjusted) load-weighted average LMP: 2023 and 2024**

Element	2023		2024		Change in Percent
	Contribution to LMP	Percent	Contribution to LMP	Percent	
Gas	\$13.60	43.7%	\$13.41	39.7%	(4.0%)
Positive Markup	\$4.28	13.8%	\$4.52	13.4%	(0.4%)
Coal	\$4.49	14.4%	\$4.09	12.1%	(2.3%)
Variable Maintenance	\$2.31	7.4%	\$3.18	9.4%	2.0%
Transmission Constraint Penalty Factor	\$1.62	5.2%	\$3.01	8.9%	3.7%
CO <sub>2</sub> Cost	\$1.93	6.2%	\$1.94	5.8%	(0.5%)
Variable Operations	\$1.10	3.5%	\$1.43	4.2%	0.7%
Ancillary Service Redispatch Cost	\$0.50	1.6%	\$1.33	3.9%	2.3%
Opportunity Cost Adder	\$0.87	2.8%	\$1.24	3.7%	0.9%
Oil	\$0.31	1.0%	\$1.08	3.2%	2.2%
Market-to-Market	\$0.41	1.3%	\$0.34	1.0%	(0.3%)
Increase Generation Differential	\$0.13	0.4%	\$0.24	0.7%	0.3%
LPA Rounding Difference	\$0.40	1.3%	\$0.18	0.5%	(0.8%)
Scarcity	\$0.07	0.2%	\$0.17	0.5%	0.3%
NA	\$0.15	0.5%	\$0.09	0.3%	(0.2%)
NO <sub>x</sub> Cost	\$0.51	1.6%	\$0.09	0.3%	(1.4%)
Landfill Gas	\$0.06	0.2%	\$0.05	0.2%	(0.0%)
Other	\$0.02	0.1%	\$0.02	0.0%	(0.0%)
Ten Percent Adder	\$0.01	0.0%	\$0.01	0.0%	(0.0%)
SO <sub>2</sub> Cost	\$0.00	0.0%	\$0.00	0.0%	(0.0%)
LPA-SCED Differential	(\$0.00)	(0.0%)	(\$0.00)	(0.0%)	0.0%
Decrease Generation Differential	(\$0.01)	(0.0%)	(\$0.04)	(0.1%)	(0.1%)
Renewable Energy Credits	(\$0.07)	(0.2%)	(\$0.07)	(0.2%)	0.0%
Negative Markup	(\$1.61)	(5.2%)	(\$2.54)	(7.5%)	(2.4%)
Total	\$31.08	100.0%	\$33.74	100.0%	0.0%

PJM implemented fast start pricing on September 1, 2021. The commitment cost related components of LMP are shown in Table 3-75 including markup using unadjusted cost-based offers for 2024. In 2024, 1.7 percent of the load-weighted average LMP was the result of commitment costs as a result of the fast start pricing rules that create prices inconsistent with fundamental LMP logic. The majority of the commitment costs in LMP were fuel costs in the no load component of offers for gas fired fast start units. The second largest component was maintenance costs.

**Table 3-75 Commitment cost related components of real-time (Unadjusted) load-weighted average LMP: 2024**

Element	Start Cost Components		No Load Components		Other Components		Total	
	Contribution to LMP	Percent	Contribution to LMP	Percent	Contribution to LMP	Percent	Contribution to LMP	Percent
Gas	\$0.00	0.0%	\$0.35	1.0%	\$13.06	38.7%	\$13.41	39.7%
Coal	\$0.00	0.0%	\$0.00	0.0%	\$4.09	12.1%	\$4.09	12.1%
Postive Markup	\$0.02	0.1%	\$0.00	0.0%	\$3.55	10.5%	\$3.56	10.6%
Variable Maintenance	\$0.13	0.4%	\$0.01	0.0%	\$3.03	9.0%	\$3.18	9.4%
Transmission Constraint Penalty Factor	\$0.00	0.0%	\$0.00	0.0%	\$3.01	8.9%	\$3.01	8.9%
Ten Percent Adder	\$0.01	0.0%	\$0.03	0.1%	\$1.96	5.8%	\$2.00	5.9%
CO <sub>2</sub> Cost	\$0.00	0.0%	\$0.02	0.1%	\$1.92	5.7%	\$1.94	5.8%
Variable Operations	\$0.00	0.0%	\$0.00	0.0%	\$1.43	4.2%	\$1.43	4.2%
Ancillary Service Redispatch Cost	\$0.00	0.0%	\$0.00	0.0%	\$1.33	3.9%	\$1.33	3.9%
Opportunity Cost Adder	\$0.00	0.0%	\$0.00	0.0%	\$1.24	3.7%	\$1.24	3.7%
Oil	\$0.00	0.0%	\$0.02	0.1%	\$1.05	3.1%	\$1.08	3.2%
Market-to-Market	\$0.00	0.0%	\$0.00	0.0%	\$0.34	1.0%	\$0.34	1.0%
Increase Generation Differential	\$0.00	0.0%	\$0.00	0.0%	\$0.24	0.7%	\$0.24	0.7%
LPA Rounding Difference	\$0.00	0.0%	\$0.00	0.0%	\$0.18	0.5%	\$0.18	0.5%
Scarcity	\$0.00	0.0%	\$0.00	0.0%	\$0.17	0.5%	\$0.17	0.5%
NA	\$0.00	0.0%	\$0.00	0.0%	\$0.09	0.3%	\$0.09	0.3%
NO <sub>x</sub> Cost	\$0.00	0.0%	\$0.00	0.0%	\$0.08	0.2%	\$0.09	0.3%
Landfill Gas	\$0.00	0.0%	\$0.00	0.0%	\$0.05	0.2%	\$0.05	0.2%
Other	\$0.00	0.0%	\$0.00	0.0%	\$0.02	0.0%	\$0.02	0.0%
SO <sub>2</sub> Cost	\$0.00	0.0%	\$0.00	0.0%	\$0.00	0.0%	\$0.00	0.0%
LPA-SCED Differential	\$0.00	0.0%	\$0.00	0.0%	(\$0.00)	(0.0%)	(\$0.00)	(0.0%)
Decrease Generation Differential	\$0.00	0.0%	\$0.00	0.0%	(\$0.04)	(0.1%)	(\$0.04)	(0.1%)
Renewable Energy Credits	\$0.00	0.0%	\$0.00	0.0%	(\$0.07)	(0.2%)	(\$0.07)	(0.2%)
Negative Markup	(\$0.00)	(0.0%)	(\$0.03)	(0.1%)	(\$3.55)	(10.5%)	(\$3.58)	(10.6%)
Total	\$0.16	0.5%	\$0.40	1.2%	\$33.17	98.3%	\$33.74	100.0%

The components of LMP for the dispatch run and the pricing run are shown in Table 3-76, including markup using unadjusted cost-based offers for 2024. The variable maintenance cost component is the component with the largest change in the share of total LMP from the dispatch run to the pricing run is, constituting 7.2 percent of the dispatch run LMP and 9.4 percent of the pricing run LMP.

**Table 3-76 Comparison of components of real-time (Unadjusted) load-weighted average LMP in the dispatch run and pricing run: 2024**

Element	Dispatch		Pricing		Change in Percent
	Contribution to LMP	Percent	Contribution to LMP	Percent	
Gas	\$12.57	40.1%	\$13.41	39.7%	(0.4%)
Coal	\$4.36	13.9%	\$4.09	12.1%	(1.8%)
Positive Markup	\$3.08	9.8%	\$3.56	10.6%	0.7%
Variable Maintenance	\$2.26	7.2%	\$3.18	9.4%	2.2%
Transmission Constraint Penalty Factor	\$2.90	9.3%	\$3.01	8.9%	(0.3%)
Ten Percent Adder	\$1.86	6.0%	\$2.00	5.9%	(0.0%)
CO <sub>2</sub> Cost	\$1.99	6.4%	\$1.94	5.8%	(0.6%)
Variable Operations	\$1.39	4.4%	\$1.43	4.2%	(0.2%)
Ancillary Service Redispatch Cost	\$0.93	3.0%	\$1.33	3.9%	1.0%
Opportunity Cost Adder	\$1.09	3.5%	\$1.24	3.7%	0.2%
Oil	\$0.97	3.1%	\$1.08	3.2%	0.1%
Market-to-Market	\$0.47	1.5%	\$0.34	1.0%	(0.5%)
Increase Generation Differential	\$0.18	0.6%	\$0.24	0.7%	0.1%
LPA Rounding Difference	\$0.26	0.8%	\$0.18	0.5%	(0.3%)
Scarcity	\$0.20	0.6%	\$0.17	0.5%	(0.1%)
NA	\$0.10	0.3%	\$0.09	0.3%	(0.0%)
NO <sub>x</sub> Cost	\$0.08	0.2%	\$0.09	0.3%	0.0%
Landfill Gas	\$0.06	0.2%	\$0.05	0.2%	(0.0%)
Other	\$0.02	0.1%	\$0.02	0.0%	(0.0%)
SO <sub>2</sub> Cost	\$0.00	0.0%	\$0.00	0.0%	(0.0%)
LPA-SCED Differential	\$0.00	0.0%	(\$0.00)	(0.0%)	(0.0%)
Decrease Generation Differential	(\$0.02)	(0.1%)	(\$0.04)	(0.1%)	(0.1%)
Renewable Energy Credits	(\$0.08)	(0.2%)	(\$0.07)	(0.2%)	0.0%
Negative Markup	(\$3.36)	(10.7%)	(\$3.58)	(10.6%)	0.1%
Total	\$31.31	100.0%	\$33.74	100.0%	0.0%

The components of the total cost of real-time load (\$ million) are shown in Table 3-77, including markup using unadjusted cost-based offers. The components of the total cost of real-time load are shown in Table 3-78, including markup using adjusted cost-based offers. In 2024, the cost of real-time load increased by \$2,988.1 million or 12.7 percent. Of the \$26,455.7 million in the total cost of real-time load in 2024, \$10,515.7 million is due to the cost of gas. Of the \$23,467.7 million attributable to the cost of real-time load in 2023, \$10,265.3 million is due to the cost of gas.

Table 3-79 shows the components of the increase in the cost of real-time load from 2023 to 2024. In 2024, the cost of real-time load increased \$2,988.1 million. Fuel and consumables cost components of LMP (the sum of gas, coal, oil, landfill gas, variable operations) increased the cost of real-time load by \$964.1, 32.3 percent of the increase in the cost of real-time load. The emissions cost components (the sum of NO<sub>x</sub>, CO<sub>2</sub>, opportunity cost adder, SO<sub>2</sub>, and renewable energy credits) increased the real-time cost of load by \$54.3 million, 1.8 percent of the increase in the cost of real-time load. The sum of the positive and negative markups, ten percent adder, and maintenance cost components, all of which reflect market power, increased the cost of real-time load by \$274.2 million, 9.2 percent of the increase in the cost of real time load. The scarcity component increased the cost of real-time load by \$79.9 million, 2.7 percent of the increase in the cost of real-time load. The transmission constraint penalty factor increased the cost of real-time load by \$1,139.1 million, 38.1 percent. The ancillary service redispatch cost, the opportunity cost of reduced marginal generation to meet reserve requirements, increased the cost of real-time load by \$665.16, 22.3 percent of the cost of real time load.



**Table 3-77 Components of the cost of real-time (Unadjusted) load: 2023 and 2024**

Contribution to Real Time Cost of Load (\$Million)				
Element	2023	2024	Change	Percent
Gas	\$10,265.3	\$10,515.7	\$250.5	8.4%
Coal	\$3,389.7	\$3,205.4	(\$184.3)	(6.2%)
Positive Markup	\$2,485.4	\$2,795.2	\$309.7	10.4%
Variable Maintenance	\$1,744.8	\$2,489.9	\$745.2	24.9%
Transmission Constraint Penalty Factor	\$1,221.9	\$2,361.0	\$1,139.1	38.1%
Ten Percent Adder	\$1,473.8	\$1,568.9	\$95.1	3.2%
CO <sub>2</sub> Cost	\$1,458.5	\$1,521.8	\$63.3	2.1%
Variable Operations	\$829.0	\$1,122.9	\$293.9	9.8%
Ancillary Service Redispatch Cost	\$376.1	\$1,041.3	\$665.2	22.3%
Opportunity Cost Adder	\$656.4	\$970.8	\$314.4	10.5%
Oil	\$235.6	\$843.8	\$608.3	20.4%
Market-to-Market	\$307.4	\$266.3	(\$41.1)	(1.4%)
Increase Generation Differential	\$98.0	\$185.7	\$87.7	2.9%
LPA Rounding Difference	\$305.2	\$141.5	(\$163.7)	(5.5%)
Scarcity	\$51.1	\$131.0	\$79.9	2.7%
NA	\$115.3	\$71.2	(\$44.1)	(1.5%)
NO <sub>x</sub> Cost	\$384.8	\$67.1	(\$317.7)	(10.6%)
Landfill Gas	\$46.4	\$42.2	(\$4.2)	(0.1%)
Other	\$16.5	\$13.2	(\$3.4)	(0.1%)
SO <sub>2</sub> Cost	\$0.3	\$0.2	(\$0.0)	(0.0%)
LPA-SCED Differential	(\$0.0)	(\$0.0)	\$0.0	0.0%
Decrease Generation Differential	(\$8.9)	(\$33.1)	(\$24.1)	(0.8%)
Renewable Energy Credits	(\$50.4)	(\$56.1)	(\$5.7)	(0.2%)
Negative Markup	(\$1,934.6)	(\$2,810.4)	(\$875.7)	(29.3%)
Total	\$23,467.7	\$26,455.7	\$2,988.1	100.0%

**Table 3-78 Components of the (Adjusted) cost of real-time load: 2023 and 2024**

Contribution to Real Time Cost of Load (\$Million)				
Element	2023	2024	Change	Percent
Gas	\$10,265.3	\$10,515.7	\$250.5	8.4%
Positive Markup	\$3,230.3	\$3,541.1	\$310.8	10.4%
Coal	\$3,389.7	\$3,205.4	(\$184.3)	(6.2%)
Variable Maintenance	\$1,744.8	\$2,489.9	\$745.2	24.9%
Transmission Constraint Penalty Factor	\$1,221.9	\$2,361.0	\$1,139.1	38.1%
CO <sub>2</sub> Cost	\$1,458.5	\$1,521.8	\$63.3	2.1%
Variable Operations	\$829.0	\$1,122.9	\$293.9	9.8%
Ancillary Service Redispatch Cost	\$376.1	\$1,041.3	\$665.2	22.3%
Opportunity Cost Adder	\$656.4	\$970.8	\$314.4	10.5%
Oil	\$235.6	\$843.8	\$608.3	20.4%
Market-to-Market	\$307.4	\$266.3	(\$41.1)	(1.4%)
Increase Generation Differential	\$98.0	\$185.7	\$87.7	2.9%
LPA Rounding Difference	\$305.2	\$141.5	(\$163.7)	(5.5%)
Scarcity	\$51.1	\$131.0	\$79.9	2.7%
NA	\$115.2	\$71.1	(\$44.1)	(1.5%)
NO <sub>x</sub> Cost	\$384.8	\$67.1	(\$317.7)	(10.6%)
Landfill Gas	\$46.4	\$42.2	(\$4.2)	(0.1%)
Other	\$16.5	\$13.2	(\$3.4)	(0.1%)
Ten Percent Adder	\$7.0	\$6.6	(\$0.4)	(0.0%)
SO <sub>2</sub> Cost	\$0.3	\$0.2	(\$0.0)	(0.0%)
LPA-SCED Differential	(\$0.0)	(\$0.0)	\$0.0	0.0%
Decrease Generation Differential	(\$8.9)	(\$33.1)	(\$24.1)	(0.8%)
Renewable Energy Credits	(\$50.4)	(\$56.1)	(\$5.7)	(0.2%)
Negative Markup	(\$1,212.7)	(\$1,994.0)	(\$781.3)	(26.1%)
Total	\$23,467.7	\$26,455.7	\$2,988.1	100.0%

**Table 3-79 Components of Change in the cost of real-time load: 2023 and 2024**

(\$ Million)				Percent of Total Change
Component	2023	2024	Change	
Fuel and Consumables	\$14,765.9	\$15,730.1	\$964.1	32.3%
Emission Related	\$2,449.7	\$2,503.9	\$54.3	1.8%
Market Power Related	\$3,769.4	\$4,043.6	\$274.2	9.2%
Scarcity	\$51.1	\$131.0	\$79.9	2.7%
Transmission Constraint Penalty Factor	\$1,221.9	\$2,361.0	\$1,139.1	38.1%
Ancillary Service Redispatch Cost	\$376.1	\$1,041.3	\$665.2	22.3%
Emergency Demand Response	\$0.0	\$0.0	\$0.0	0.0%
PJM Administrative Cap	\$0.0	\$0.0	\$0.0	0.0%
All Other	\$833.6	\$644.8	(\$188.7)	(6.3%)
Total Change	\$23,467.7	\$26,455.7	\$2,988.1	100.0%

## Shortage

PJM's real-time energy market experienced five-minute shortage pricing for one or more reserve products for 39 unique five-minute intervals across 17 days in 2024. PJM implemented fast start pricing on September 1, 2021, creating the possibility that the pricing run and the dispatch run could classify different intervals as short. In 2024, there were 39 unique five-minute intervals with real-time shortage pricing in the pricing run for one or more reserve products, and 35 unique intervals with real-time shortage pricing in the dispatch run for one or more reserve products.

## Emergency Procedures

PJM declares alerts at least a day prior to the operating day to notify members of possible emergency actions that could be taken during the operating day. In real time, on the operating day, PJM issues warnings notifying members of system conditions that could result in emergency actions during the operating day.

Table 3-80 provides a description of PJM declared emergency procedures.<sup>115 116 117 118</sup>

**Table 3-80 Description of emergency procedures**

Emergency Procedure	Purpose
Cold Weather Alert	To prepare personnel and facilities for extreme cold weather conditions, generally when forecast weather conditions approach minimum or temperatures fall below ten degrees Fahrenheit.
Hot Weather Alert	To prepare personnel and facilities for extreme hot and/or humid weather conditions, generally when forecast temperatures exceed 90 degrees with high humidity.
Maximum Emergency Generation Alert	To provide an early alert at least one day prior to the operating day that system conditions may require the use of the PJM emergency procedures and resources must be able to increase generation above the maximum economic level of their offers.
Primary Reserve Alert	To alert members of a projected shortage of primary reserve for a future period. It is implemented when estimated primary reserve is less than the forecast requirement.
Voltage Reduction Alert	To alert members that a voltage reduction may be required during a future critical period. It is implemented when estimated reserve capacity is less than forecasted synchronized reserve requirement.
Pre-Emergency Load Management Reduction Action	To request load reductions from customers registered in the PJM Demand Response program that need 30, 60, or 120 minute lead time before declaring emergency load management reductions
Emergency Mandatory Load Management Reduction Action	To request load reductions from customers registered in the PJM Demand Response program that need 30, 60, or 120 minute lead time to provide additional load relief, generally declared simultaneously with NERC Energy Emergency Alert Level 2 (EEA2)
Primary Reserve Warning	To warn members that available primary reserve is less than required and present operations are becoming critical. It is implemented when available primary reserve is less than the primary reserve requirement but greater than the synchronized reserve requirement.
Maximum Emergency Generation Action	To provide real time notice to increase generation above the maximum economic level. It is implemented whenever generation is needed that is greater than the maximum economic level.
Voltage Reduction Warning & Reduction of Non-Critical Plant Load	To warn members that actual synchronized reserves are less than the synchronized reserve requirement and that voltage reduction may be required.
Deploy All Resources Action	For emergency events that do not evolve over time, but rather develop rapidly and without prior warning, PJM issues this action to instruct all generation resources to be online immediately and to all load management resources to reduce load immediately.
Manual Load Dump Warning	To warn members of the critical condition of present operations that may require manually dumping load. Issued when available primary reserve capacity is less than the largest operating generator or the loss of a transmission facility jeopardizes reliable operations after all other possible measures are taken to increase reserve.
Voltage Reduction Action	To reduce load to provide sufficient reserve capacity to maintain tie flow schedules and preserve limited energy sources. It is implemented when load relief is needed to maintain tie schedules.
Manual Load Dump Action	To provide load relief when all other possible means of supplying internal PJM RTO load have been used to prevent a catastrophe within the PJM RTO or to maintain tie schedules so as not to jeopardize the reliability of the other interconnected regions.
Post Contingency Local Load Relief Warning	To warn transmission owners of the possibility of load shed in their area.
Non-Market Post Contingency Local Load Relief Warning	To warn transmission owners of the possibility of load shed in their area for non-market facilities.

<sup>115</sup> See PJM, "PJM Manual 13: Emergency Operations," § 3.3 Cold Weather Advisory / Alert, Rev. 94 (Dec. 18, 2024).

<sup>116</sup> See PJM, "PJM Manual 13: Emergency Operations," § 3.4 Hot Weather Alert, Rev. 94 (Dec. 18, 2024).

<sup>117</sup> See PJM, "PJM Manual 13: Emergency Operations," § 2.3.1 Advanced Notice Emergency Procedures: Alerts, Rev. 94 (Dec. 18, 2024).

<sup>118</sup> See PJM, "PJM Manual 13: Emergency Operations," § 2.3.2 Real-Time Emergency Procedures (Warnings and Actions), Rev. 94 (Dec. 18, 2024).

Table 3-81 shows the dates when emergency alerts and warnings were declared and when emergency actions were implemented in 2024. Events in Table 3-81 can span multiple days, but only the first day is shown.

**Table 3-81 Starting days of declared emergency alerts, warnings and actions: January through December, 2024**

Date	Cold Weather Alert	Hot Weather Alert	Maximum Emergency Generation Alert	Primary Reserve Alert	Voltage Reduction Alert	Primary Reserve Warning	Voltage Reduction Warning and Critical Plant Load	Maximum Emergency Generation Action	Pre-Emergency Mandatory Load Management Reduction	Emergency Mandatory Load Management Reduction	Voltage Reduction	Manual Load Dump Warning	Manual Load Dump Action	Load Shed Directive
14-Jan-2024	Western													
19-Jan-2024	Western													
22-May-2024		Mid-Atlantic												
13-Jun-2024		PJM RTO												
14-Jun-2024		Mid-Atlantic, Southern												
16-Jun-2024		Western												
17-Jun-2024		PJM RTO												
24-Jun-2024		Mid-Atlantic, Southern												
25-Jun-2024		PJM RTO												
26-Jun-2024		Mid-Atlantic, Southern												
08-Jul-2024		PJM RTO												
09-Jul-2024		Mid-Atlantic, Southern												
10-Jul-2024		Mid-Atlantic, Southern												
14-Jul-2024		PJM RTO												
15-Jul-2024		PJM RTO												
16-Jul-2024		PJM RTO												
17-Jul-2024		Mid-Atlantic, Southern												
31-Jul-2024		Mid-Atlantic, Southern												
02-Aug-2024		Mid-Atlantic, Southern												
05-Aug-2024		Mid-Atlantic, Southern												
26-Aug-2024		Western												
27-Aug-2024		PJM RTO												
28-Aug-2024		PJM RTO												
12-Dec-2024	COMED													
13-Dec-2024	COMED													

Table 3-82 shows the number of days for which emergency alerts, warnings, and actions were declared by PJM in 2023 and 2024. In 2024, there were zero days with emergency actions and shortages that triggered Performance Assessment Intervals (PAI).<sup>119</sup>

**Table 3-82 Number of days for which PJM declared events: 2023 and 2024**

Event Type	Number of days for which events declared	
	2023	2024
Cold Weather Alert	3	10
Hot Weather Alert	21	28
Maximum Emergency Generation Alert	3	2
Primary Reserve Alert	0	0
Voltage Reduction Alert	0	0
Primary Reserve Warning	0	0
Voltage Reduction Warning	0	0
Pre Emergency Mandatory Load Management Reduction Action	0	0
Emergency Mandatory Load Management Reduction Action (30, 60 or 120 minute lead time)	0	0
Maximum Emergency Action	0	0
Emergency Energy Bids Requested	0	0
Voltage Reduction Action	0	0
Shortage Pricing	46	17
Energy export recalls from PJM capacity resources	0	0

<sup>119</sup> A PAI is triggered when PJM takes an emergency action and there is a shortage of primary reserves. See 184 FERC ¶ 61,058 (2023).

Figure 3-51 shows the number of days for which weather and capacity emergency alerts were issued in PJM in 2020 through 2024.

**Figure 3-51 Number of days for which emergency alerts declared: 2020 through 2024**


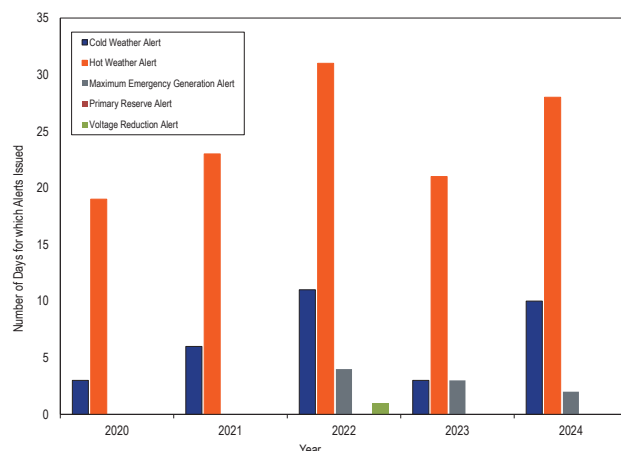


Figure 3-52 shows the number of days for which emergency warnings and actions were declared in PJM in 2020 through 2024.

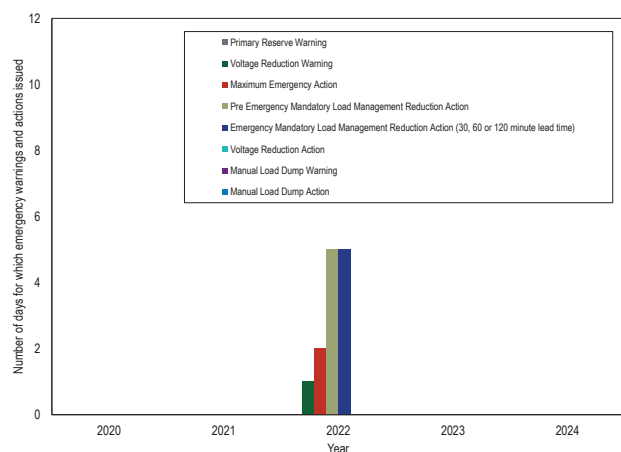**Figure 3-52 Declared emergency warnings and actions: 2020 through 2024**



In 2024, PJM issued 32 Non-Market Post Contingency Local Load Relief warnings and 314 Post Contingency Local Load Relief warnings. These warnings notify transmission owners of the possibility of disconnecting load in their area, either via manual load dumping by non-market load or via load shed.

## Power Balance Constraint Violation

The purpose of the real-time energy market is to dispatch sufficient supply to meet demand. In the RT SCED optimization, the power balance constraint enforces the requirement that total dispatched generation (supply) equals the sum total of forecasted load, losses and net interchange (demand). The power balance constraint is violated when supply is less than demand. In some cases, the power balance constraint is violated while the reserve requirements are satisfied.

The current process for meeting energy and reserve requirements in real time, and pricing the system conditions when RT SCED forecasts that energy supply is less than the demand for energy and reserves, is opaque and not defined in the PJM governing documents. It is unclear whether and how PJM converts reserves to energy before violating the power balance constraint. It is unclear whether and when PJM uses its authority under the tariff to curtail exports from PJM capacity resources to meet the power balance constraint. It is unclear why PJM does not include demand side capacity resources in the definition of reserves. It is unclear whether PJM would maintain a minimum level of synchronized reserves even if that would result in a controlled load shed. The current RT SCED does not have a mechanism to convert inflexible reserves procured by the ASO to energy to satisfy the power balance constraint.<sup>120</sup> SCED solutions from October 1, 2019, February 16, 2020, and April 21, 2020, indicate that the defined logic met transmission constraint limits and reserve requirements but violated the power balance constraint, and did not reflect this constraint violation in prices. The definitions and implementation of reserves, combined with operator discretion to bias load, make it difficult to define when there is an actual power balance constraint violation. Effective August 8, 2024, PJM updated SCED and LPC to convert reserves to energy before violating the power balance constraint.

During Winter Storm Elliott, on December 23, and December 24, 2022, PJM created what PJM termed virtual generation in real time to satisfy the power balance constraint. PJM did not convert any inflexible reserves to energy. In summary, the power balance constraint was violated solely as a result of load bias added by PJM and that violation was corrected by PJM adding generation that does not actually exist to the

<sup>120</sup> Inflexible reserves are those reserves that clear in the hour ahead Ancillary Service Optimizer (ASO) but cannot be dispatched in the real time dispatch tool, RT SCED.

supply (virtual generation). To the extent that there was not an actual violation of the power balance constraint, it was appropriate that PJM did not take actions to address the nonexistent violation.

The MMU recommends that PJM clarify, modify and document its process for dispatching reserves and energy when SCED indicates that supply is less than total demand including forecasted load and reserve requirements. The modifications should include: the exact definition of the power balance constraint including the role of PJM load bias; a SCED process to economically convert reserves to energy; a process for the recall of energy from capacity resources to address any actual or potential power balance issue; a process to call on demand side capacity resources, and the minimum level of synchronized reserves that would trigger load shedding. Table 3-83 shows the number of five minute intervals for which the RT SCED solutions did not balance demand and supply. Prior to August 8, 2024, PJM reran the RT SCED with artificially increased supply to satisfy the power balance constraint. In 2024, there were 6 five minute intervals using an RT SCED solution with an apparently violated power balance constraint. PJM ignored (relaxed) the power balance constraints in 2024.

**Table 3-83 Number of five minute intervals using RT SCED solutions with apparently violated power balance constraint by year**

Year	Number of five minute intervals	Average Energy Component of LMP in SCED (\$/MWh)	Average Energy Component of LMP in Pricing Run (\$/MWh)
2013	-	\$0.00	\$0.00
2014	655	\$36.29	\$36.29
2015	71	(\$0.76)	(\$0.76)
2016	42	\$93.06	\$93.06
2017	31	\$279.86	\$279.86
2018	16	\$268.21	\$268.21
2019	36	\$845.48	\$845.48
2020	5	\$351.56	\$351.56
2021	10	\$976.06	\$976.06
2022	121	\$2,347.33	\$2,066.21
2023	23	\$357.34	\$361.14
2024	6	\$907.95	\$907.95

## Shortage and Shortage Pricing

In electricity markets, shortage means that demand, including reserve requirements, is nearing the limits of the currently available capacity of the system. Shortage pricing is a mechanism for signaling scarcity conditions through higher energy prices. Under the PJM rules that were in place through September 30, 2012, shortage

pricing resulted from the exercise of aggregate market power by individual generation owners for specific units when the system was close to its available capacity. But that was not an efficient way to manage shortage pricing and made it difficult to distinguish between market power and shortage pricing. Shortage pricing is an administrative pricing mechanism that sets a defined higher price when the system operates with lower real-time reserves than the target level.

In 2024, there were 39 five-minute intervals with real-time shortage pricing for one or more reserve products that occurred on 17 days in PJM.

In Order No. 825, the Commission required each RTO/ISO to trigger shortage pricing for any dispatch and pricing interval in which a shortage of energy or operating reserves is indicated by the RTO/ISO's software.<sup>121</sup> Prior to May 11, 2017, if the dispatch tools (Intermediate-Term SCED and Real-Time SCED) reflected a shortage of reserves (primary or synchronized) for a time period shorter than a defined threshold (30 minutes), it was considered a transient shortage, a shortage event was not declared, and shortage pricing was not implemented. As of May 11, 2017, the rule requires PJM to trigger shortage pricing for any five minute interval for which the Real-Time SCED (Security Constrained Economic Dispatch) indicates a shortage of synchronized reserves or primary reserves. In January 2019, PJM updated its business rules in Manual 11 to describe PJM's implementation of the five minute shortage pricing process. PJM Manual 11 states that shortage pricing is triggered when an approved RT SCED case that was used in the Locational Pricing Calculator (LPC) indicates a shortage of reserves. The implementation is not fully algorithmic or well defined because RT SCED can indicate a shortage that PJM does not use in pricing and because the load bias added to SCED may artificially create or suppress shortages. On June 22, 2020, PJM reduced the frequency of automatic RT SCED executions to match the frequency of pricing at five minutes, which reduced the frequency of unpriced shortage solutions.

Prior to September 1, 2021, the reserves calculated in the LPC solution, and the reserves calculated in the reference RT SCED case used by the LPC solution were the same. With the implementation of fast start pricing on September 1, 2021, shortage pricing is now

<sup>121</sup> Settlement Intervals and Shortage Pricing in Markets Operated by Regional Transmission Organizations and Independent System Operators, Order No. 825, 155 FERC ¶ 61,276 at P 162 (2016).



triggered by the pricing run in LPC.<sup>122</sup> This can lead to differences between the dispatched reserves in RT SCED and the reserves calculated in the pricing run in LPC. In the pricing run in LPC, shortage pricing could be triggered even when there is no actual shortage in dispatched reserves as determined by the reference RT SCED solution. This occurred once in 2024.

Voltage reduction actions and manual load dump actions are also triggers for shortage pricing, reflecting the fact that when operators need to take these emergency actions to maintain reliability, the system is short reserves and prices should reflect that condition, even if the power balance constraint is met and there is no defined shortage of reserves.<sup>123</sup>

## Operating Reserve Demand Curves


Shortage pricing in the PJM Energy Market can occur in either the day-ahead or the real-time market for any of five reserves requirements: RTO Synchronized Reserves, Subzone Synchronized Reserves, RTO Primary Reserves, Subzone Primary Reserves, and 30-Minute Reserves. Each requirement is modelled in the market clearing engines as a demand curve priced at \$850 per MWh up to the minimum reserve requirement (MRR) and at \$300 per MWh for additional reserves of at least 190 MW.<sup>124</sup> <sup>125</sup> When a reserve constraint is not satisfied, the area under the demand curve for the unmet MW of the reserve requirement is added to the market clearing cost-minimization objective function, which causes the administrative price on the ORDC to determine the marginal cost of the reserve shortage. Because an additional MW of energy on the margin would require another MW of reserves shortage, the administrative marginal cost of reserves is added to LMP.

## Shortage Pricing and Energy Price Formation

The current operating reserve demand curves (ORDC) in PJM define an administrative price for estimated reserves (synchronized, primary, and 30-minute reserves) up to the extended reserve requirement quantities, which for each reserve service is the sum of that service's minimum reserve requirement (MRR) and an extended

requirement of at least 190 MW. The price is \$850 per MWh for reserve quantities less than the MRR. The price is \$300 per MWh for reserve quantities between the MRR and the sum of the MRR and the extended requirement. The example demand curve shown in Figure 3-53 drops to a zero price for quantities above the extended reserve requirement.

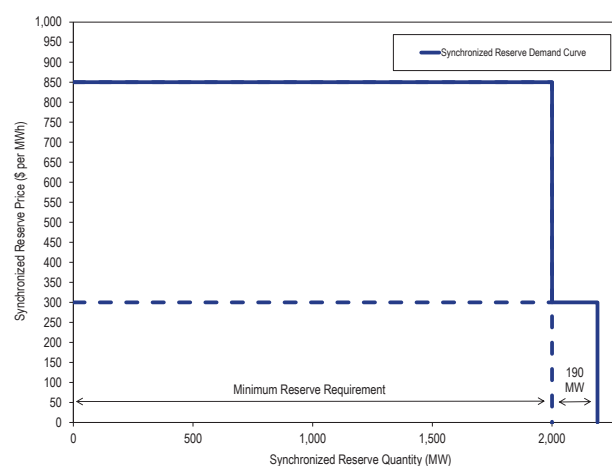**Figure 3-53 Example real-time extended synchronized reserve demand curve showing the permanent second step**



Historically, the minimum reserve requirement for each operating interval has equaled the size of the largest single source of supply on the PJM system during that operating interval, known as the most severe single contingency. Beginning May 12, 2023, PJM unilaterally increased the minimum reserve requirement based on what appeared to be low response rates from reserves but not based on any evidence about reliability issues. The changes to the reserve requirements are discussed in more detail in Section 10: Ancillary Service Markets.

## Nesting

The reserve requirements are nested such that the reserves with shorter allowed response times and stricter synchronization requirements count toward the requirements for reserves with longer allowed response times and less strict synchronization requirements, and such that the reserves in the subzone count toward the total RTO requirement. For example, synchronized reserves count toward the primary reserve requirement, and Mid-Atlantic Dominion reserves count toward the PJM RTO reserve requirement. This nesting means

<sup>122</sup> See PJM Operating Agreement, Schedule 1, Section 2.5.1(a).

<sup>123</sup> See, e.g., Scarcity and Shortage Pricing, Offer Mitigation and Offer Caps Workshop, Docket No. AD14-14-000, Transcript 29:21-30:14 (Oct. 28, 2014).

<sup>124</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.3.3 Reserve Demand Curves and Penalty Factors, Rev. 133 (Dec. 17, 2024).

<sup>125</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.3 Reserve Requirement Determination, Rev. 133 (Dec. 17, 2024).

that the effect of reserve constraints on prices can be additive.

The effect of the reserve constraints on pricing depends on the constraint shadow price. In general, the shadow price of a constraint is the change in the total production cost (the objective function of the market dispatch software) if that constraint limit were increased at the margin. A reserve constraint violation (a shortage) means that the constraint cannot be satisfied at a marginal cost less than the value on the ORDC. For the RTO synchronized reserve constraint, the shadow price during a shortage is defined to equal the ORDC value. For the MAD synchronized reserve constraint, when reserves from both the RTO and MAD can be used, the shadow price equals the sum of the ORDC value for each constraint when both are violated. The same occurs for the primary and secondary reserve constraints. The total shadow price of reserve violations can reach five times the highest ORDC value of \$850 per MWh, which is \$4,250 per MWh. This value exceeds the PJM \$1,700 per MWh price caps on reserve prices and the \$3,700 per MWh price cap applied to the energy component of LMP, also called the system marginal price.

### Energy and Reserve Price Caps

Table 3-84 shows six example scenarios, under the current ORDCs, with combinations of energy offers, reserve shortage penalty factors and transmission constraint penalty factors that can add up to produce high LMPs at sample pnodes in the MAD Reserve Subzone and outside the MAD Reserve Subzone.

Scenario A shows a simple shortage in the RTO Reserve Zone. In scenario B, there is a reserve shortage for both primary and synchronized reserves in both MAD and RTO Reserve Zones that results in a \$1,700 per MWh reserve shortage penalty in the RTO Zone LMP and a \$3,400 per MWh reserve shortage penalty in the MAD Zone LMP. The marginal resource for energy is in the RTO Zone. The RTO to MAD reserve transfer constraint is binding, so the higher MAD reserve penalty does not affect the rest of RTO LMP.

In scenario C, there is a reserve shortage for both primary and synchronized reserves in both MAD and RTO Reserve Zones and a violated transmission constraint that affects the marginal congestion costs in the system marginal price. In scenario C, the sum of the marginal unit cost, reserve and transmission constraint

penalty factors equals \$5,450 per MWh, which exceeds \$3,700 per MWh, so SMP capping is triggered whether the marginal unit for energy can provide reserves for the MAD Zone or only the RTO Zone.

In scenario D, with a \$1,000 per MWh offer price for the marginal unit for energy, violation of four reserve penalty factors does not trigger SMP capping, because the marginal unit for energy cannot serve the MAD reserve requirement. Scenario E and F show that LMPs can exceed \$3,700 per MWh if there is a violated transmission constraint that is not exacerbated by an increase in load at the load weighted reference pricing node, which determines the SMP.<sup>126</sup>

In Scenario F, the energy component of LMP is at its highest level, \$2,000 per MWh and there is a reserve shortage for primary and synchronized reserves in both MAD and RTO Reserve Zones and a shortage of 30 minute reserves, resulting in a capped \$1,700 per MWh scarcity adder, and a violated transmission constraint with a \$2,000 per MWh penalty factor that results in a \$5,700 per MWh LMP. The LMPs in Scenario F are not the highest possible LMPs in the PJM energy market under the current rules. If there are multiple violated transmission constraints, the congestion costs contributing to the LMP at a pnode can exceed \$2,000 per MWh resulting in LMPs higher than \$5,700 per MWh.

Scenarios G and H are similar to conditions during the highest priced hours of Winter Storm Elliott on December 23 and 24, 2022. In G, the marginal unit offer price is \$500 per MWh. The synchronized and primary reserve requirements are violated for the RTO and MAD zones. Transmission constraints affect both the system marginal price and other locations. The SMP in G is capped at \$3,700 per MWh. In H, the marginal unit offer price is lower, at \$40 per MWh, and the 30 minute reserve constraint is also violated. With the offer caps, the SMP is also at \$3,700 per MWh.

The extent to which each violated transmission penalty factor affects the LMP at a pnode is directly proportional to the pnode's distribution factor (dfax) with respect to that constraint. In addition, the LMP at a pnode includes a loss component calculated as the product of the

<sup>126</sup> The impact of the transmission constraint penalty factor at a pnode depends on its distribution factor (dfax) with respect to the constraint. The scenarios here assume a single violated transmission constraint with dfax of 1.0. If there are multiple violated transmission constraints, the total impact at a pnode is the sum of the product of transmission constraint penalty factors and distribution factors.

marginal loss factor and the uncapped system marginal price.

**Table 3-84 Real-time additive penalty factors under reserve shortage and transmission constraint violations: Status Quo**

Scenario	Marginal Unit Offer Price	Synchronized Reserve Penalty Factor		Primary Reserve Penalty Factor		30 Minute Reserve Penalty Factor	Transmission Constraint Penalty Factor in SMP	System Marginal Price		Transmission Constraint Penalty Factor in CLMP	Total LMP	
		RTO	MAD	RTO	MAD	RTO		RTO Marginal	MAD Marginal		RTO Marginal	MAD Marginal
A	\$50	\$850	\$0	\$0	\$0	\$0	\$0	\$900	\$900	\$0	\$900	\$900
B	\$50	\$850	\$850	\$850	\$850	\$0	\$0	\$1,750	\$3,450	\$0	\$1,750	\$3,450
C	\$50	\$850	\$850	\$850	\$850	\$0	\$2,000	\$3,700	\$3,700	\$0	\$3,700	\$3,700
D	\$1,000	\$850	\$850	\$850	\$850	\$0	\$0	\$2,700	\$3,700	\$0	\$2,700	\$3,700
E	\$1,000	\$850	\$850	\$850	\$850	\$850	\$2,000	\$3,700	\$3,700	\$2,000	\$5,700	\$5,700
F	\$2,000	\$850	\$850	\$850	\$850	\$850	\$2,000	\$3,700	\$3,700	\$2,000	\$5,700	\$5,700
G	\$500	\$850	\$850	\$850	\$850	\$0	\$2,000	\$3,700	\$3,700	\$2,000	\$5,700	\$5,700
H	\$40	\$850	\$850	\$850	\$850	\$850	\$2,000	\$3,700	\$3,700	\$2,000	\$5,700	\$5,700

## Shortage Pricing During Synchronized Reserve Events

Synchronized reserves are deployed when PJM declares a synchronized reserve event, also known as a spinning event. PJM's method of communication in 2024 failed to result in reliably timely responses, defined to be within 10 minutes. For units that could receive an electronic signal, PJM's instruction to reserves was to ignore the dispatch signals sent by RT SCED and to instead continue to ramp their units up until the spin event ends. A significant number of resources did not have the capability to receive the electronic signals that PJM offered. The ALL-CALL system only calls a limited number of contacts at the same time. Although PJM's stated goal was an immediate response, in practice it took minutes for a generator's designated contact to respond to the ALL-CALL, who could then take minutes more to call personnel at the plant. If a unit was following automatic generation control, then additional minutes could also be lost switching to manual control. The end result was that resources started responding minutes into an event, even when everything went well.<sup>127</sup> In December 2024, PJM added an automated communication method that would add the reserve deployment instruction to the dispatch signal, which will allow generators following automatic generation control to automatically follow the signal. The new method did not affect any synchronized reserve events in 2024. The new method did resolve the communications issues for all resources. Significant communications issue remain to be resolved.

Although PJM signals resources to increase their output, the approved SCED cases are solved with the reserve requirement intact, which dispatches the system to meet the load and reserve requirements 8 to 10 minutes into

the future. This results in a discrepancy between the operational need during a spinning event, and the RT SCED solutions.

While PJM recovers from a disturbance during a spinning event, PJM should adjust the operating reserve demand curve (ORDC) for synchronized reserves to ensure that RT SCED does not have a competing objective of immediately replacing reserves that have been paid for, and are being used for their intended purpose. Currently, RT SCED has the ability to back down units during events to create available reserves, which counteracts PJM's recovery effort. Without such an adjustment, the prices will be artificially inflated, potentially triggering shortage pricing, during the times when reserves are used for their intended purpose. For example, shortage pricing was triggered during the spin events on January 29, 2024, June 3, 2024, and July 8, 2024. The MMU recommends that PJM adjust the ORDCs during spin events to reduce the reserve requirements by the amount of the reserves deployed.

## Reserve Shortages in 2024

### Reserve Shortage in Real-Time SCED

The MMU analyzed the RT SCED solutions to determine how many of the five minute target time RT SCED solutions indicated a shortage of any of the reserve products in the RTO Reserve Zone and the MAD Reserve Subzone (synchronized reserve and primary reserve in both areas and 30 minute reserve in the RTO), when multiple solutions indicated shortage of reserves, and how many of these resulted in shortage prices in LPC.

<sup>127</sup> See the 2024 Annual State of the Market Report for PJM, Volume 2, Section 10: Ancillary Service Markets for a more detailed discussion of these issues.

For reliability reasons, and to maintain reserves to comply with NERC standards, reserves are considered short if the quantity (MW) of reserves dispatched by RT SCED for a five minute interval is less than the minimum reserve requirement (MRR). To trigger shortage pricing, reserves are considered short if the quantity (MW) of reserves dispatched by RT SCED for a five minute interval is less than the extended reserve requirement.

Until June 2, 2021, PJM generally solved one RT SCED case with three solutions per case, for each five minute target time.<sup>128 129</sup> On June 3, 2021, PJM updated RT SCED to solve two additional scenarios, or a total of five solutions per case. In 2021, the frequency with which RT SCED solutions were approved increased to one solution per five minute interval. This approval frequency increased the proportion of approved SCED solutions that are reflected in LMPs. However, the process of selecting the SCED solution to approve, among the solutions available to PJM operators, is subjective and is not based on clearly defined criteria. The criteria are especially important when only some of the SCED solutions reflect shortage pricing, and the rest of the solutions do not.

The MMU analyzed the target times for which one or more RT SCED case solutions indicated a shortage of one or more reserve products. Table 3-85 shows, in 2023 and 2024, the total number of target times, the number of target times for which at least one RT SCED solution showed a shortage of reserves, the number of target times for which more than one RT SCED solution showed a shortage of reserves, and the number of five-minute pricing intervals for which the LPC solution showed a shortage of reserves. Each execution of RT SCED produces five solutions, using five different levels of load bias. Table 3-85 shows that, in 2024, 6,811 target times, or 6.5 percent of all five-minute target times, had at least one RT SCED solution showing a shortage of reserves, and 1,905 target times, or 1.8 percent of all five-minute target times, had more than one RT SCED solution showing a shortage of reserves. In 2023, there were 4,307 target times, or 4.1 percent of all five-minute target times, that had at least one RT SCED solution showing a shortage of reserves, and 1,452 target times, or 1.4 percent of all five-minute target times, that had more than one RT SCED solution showing a shortage of reserves.

**Table 3-85 Real-time monthly five minute SCED target times and pricing intervals with shortage: 2023 through 2024**

Year	Month	Number of Five Minute Intervals	Number of Target Times With At Least One SCED Solution Short of Reserves	Percent Target Times With At Least One SCED Solution Short of Reserves	Number of Target Times With Multiple SCED Solutions Short of Reserves	Percent Target Times With Multiple SCED Solutions Short of Reserves	Number of Five Minute Intervals With Shortage Prices in LPC	Percent RT SCED Target Times With Reserve Shortage With Shortage Prices in LPC
2023	Jan	8,928	187	2.1%	63	0.7%	3	1.6%
2023	Feb	8,064	89	1.1%	16	0.2%	0	0.0%
2023	Mar	8,916	75	0.8%	22	0.2%	0	0.0%
2023	Apr	8,640	444	5.1%	146	1.7%	0	0.0%
2023	May	8,928	948	10.6%	396	4.4%	35	3.7%
2023	Jun	8,640	268	3.1%	84	1.0%	0	0.0%
2023	Jul	8,928	219	2.5%	60	0.7%	1	0.5%
2023	Aug	8,928	115	1.3%	24	0.3%	0	0.0%
2023	Sep	8,640	130	1.5%	34	0.4%	2	1.5%
2023	Oct	8,928	862	9.7%	303	3.4%	3	0.3%
2023	Nov	8,652	466	5.4%	157	1.8%	0	0.0%
2023	Dec	8,928	504	5.6%	147	1.6%	2	0.4%
2023	Total	105,120	4,307	4.1%	1,452	1.4%	46	1.1%
2024	Jan	8,928	398	4.5%	119	1.3%	10	2.5%
2024	Feb	8,352	606	7.3%	156	1.9%	0	0.0%
2024	Mar	8,916	876	9.8%	259	2.9%	9	1.0%
2024	Apr	8,640	434	5.0%	103	1.2%	2	0.5%
2024	May	8,928	792	8.9%	249	2.8%	1	0.1%
2024	Jun	8,640	404	4.7%	115	1.3%	2	0.5%
2024	Jul	8,928	390	4.4%	118	1.3%	3	0.8%
2024	Aug	8,928	532	6.0%	119	1.3%	0	0.0%
2024	Sep	8,640	687	8.0%	223	2.6%	2	0.3%
2024	Oct	8,928	654	7.3%	205	2.3%	6	0.9%
2024	Nov	8,652	645	7.5%	157	1.8%	1	0.2%
2024	Dec	8,928	393	4.4%	82	0.9%	3	0.8%
2024	Total	105,408	6,811	6.5%	1,905	1.8%	39	0.6%

<sup>128</sup> A case is executed when it begins to solve. Most but not all cases are solved. RT SCED cases take about one to two minutes to solve.

<sup>129</sup> PJM updated the RT SCED execution frequency to solve one case for each five minute target time beginning June 22, 2020. PJM dispatchers may solve additional cases at their discretion.

As shown in Table 3-85, in 2024, there were 1,905 unique five-minute target times for which multiple RT SCED solutions showed a shortage of reserves for one or more reserve services, while there were 39 unique five-minute intervals with real-time shortage pricing for one or more reserve products. In 2023, there were 1,452 unique five-minute target times for which multiple RT SCED solutions showed a shortage of reserves for one or more reserve services, while there were 46 unique five minute intervals with real-time shortage pricing for one or more reserve products. Clear criteria for approval of shortage cases are needed.

The PJM Real-Time Energy Market produces an efficient outcome only when prices are allowed to reflect the fundamental supply and demand conditions in the market in real time. While it is appropriate for operators to ensure that cases use data that reflect the actual state of the system, it is essential that operator discretion not extend beyond what is necessary and that operator discretion not prevent shortage pricing when there are shortage conditions or implement shortage pricing when there are no shortage conditions. This is a critical issue now that PJM settles all real-time energy transactions on a five minute basis using the prices calculated by LPC. The MMU recommends that PJM define clear criteria for operator approval of RT SCED cases, including shortage cases that are used to send dispatch signals to resources, and for pricing, to minimize discretion. A rule based approach is essential for defining how LMPs are determined so that all market participants can be confident that energy market pricing is efficient.

### Shortage Pricing Intervals in LPC

Beginning October 1, 2022, shortage pricing can occur in both the PJM Day-Ahead and Real-Time Energy Markets for Synchronized Reserves, Primary Reserves, and 30-Minute Reserves. In 2024, there was no shortage pricing in the day-ahead energy market.

In May 2023, PJM increased reserve requirements in response to poor reserve performance. While the intervals listed in this section were short of their target requirements, it is important to note that many of these intervals still cleared above the average values of the requirements from before the increase. The average primary reserve requirement from January 2023 through April 2023 was 2,511.4 MW and the average synchronized reserve requirement was 1,741.7 MW.

There were 39 unique real-time five minute intervals with shortage pricing for one or more reserve products in 2024, compared to 46 intervals in 2023. As of the end of 2024, there has never been shortage pricing in the day-ahead market. PJM implemented fast start pricing on September 1, 2021. Fast start pricing can result in differences in reserve shortages between the dispatch run and the pricing run. In 2024, there were 39 five minute intervals with shortage pricing in the pricing run for one or more reserve products, and 35 intervals with shortage in the dispatch run for one or more reserve products. The following tables show intervals with shortage pricing in the pricing run for each reserve service for the RTO Reserve Zone and the MAD Reserve Subzone.

Table 3-86 shows the extended synchronized reserve requirement, the total synchronized reserves, the synchronized reserve shortage, and the synchronized reserve clearing prices for the RTO Reserve Zone during the two intervals with shortage pricing in the pricing run due to synchronized reserve shortage in 2024. Table 3-86 shows that two intervals were short of synchronized reserves in both the pricing run and the dispatch run. Both intervals were also short primary reserves in the pricing run and the dispatch run.

In the MAD Reserve Subzone, there were zero intervals with shortage pricing in the pricing run due to a synchronized reserve shortage in 2024.

Table 3-87 shows the extended primary reserve requirement, the total primary reserves, the primary reserve shortage, and the primary reserve clearing prices for the RTO Reserve Zone during the 36 intervals with shortage pricing in the pricing run due to primary reserve shortage in 2024. Table 3-87 shows that 32 of the 36 intervals were short of primary reserves in both the pricing run and the dispatch run. The intervals on May 21, October 16, and December 6 were not short in the dispatch run. The intervals on January 29, June 3, and July 8 occurred during synchronized reserve events.

Table 3-88 shows the extended primary reserve requirement, the total primary reserves, the primary reserve shortage, and the primary reserve clearing prices for the MAD Reserve Subzone during the nine intervals with shortage pricing in the pricing run due to primary reserve shortage in 2024. Table 3-88 shows that all nine of the intervals were short of primary reserves in both



the dispatch run and the pricing run, and that one of the intervals had different capped prices in the dispatch and pricing runs. The one interval on June 3 occurred during a synchronized reserve event.

In the RTO Reserve Zone, there were zero intervals with shortage pricing in the pricing run due to a 30-minute reserve shortage in 2024.

PJM enforces an RTO wide reserve requirement and a reserve requirement for the MAD region. The MAD Reserve Subzone is inside the RTO Reserve Zone. Resources located in the MAD Reserve Subzone can simultaneously satisfy the synchronized reserve requirement of the RTO Reserve Zone and the synchronized reserve requirement of the MAD Reserve Subzone. Resources located outside the MAD Reserve Subzone can satisfy the synchronized reserve requirement of the RTO Reserve Zone, and subject to transfer limits defined by transmission constraints, satisfy the reserve requirement of the MAD Subzone. The synchronized reserve clearing price of the RTO Reserve Zone is set by the shadow price of the binding reserve requirement constraint of the RTO Reserve Zone.<sup>130</sup> The synchronized reserve clearing price of the MAD Reserve Subzone is set by the sum of the shadow prices of the binding reserve requirement constraint of the RTO Reserve Zone and the shadow price of the binding reserve requirement constraint of the MAD Reserve Subzone.

The process of calculating reserve constraint shadow prices and implementing reserve price caps in PJM is not transparent. The MMU recommends that PJM clearly document the calculation of shortage prices and implementation of reserve price caps in the PJM manuals, including definitions of all the components of reserve prices, and all the constraints whose shadow prices are included in reserve prices.

The PJM tariff caps the MCP for primary reserves at one and a half times the nonsynchronized reserve penalty factor for each zone or subzone, and caps the MCP for synchronized reserves at the sum of the penalty factor for synchronized reserve and the penalty factor for nonsynchronized reserve, but the PJM tariff does not explicitly specify a cap on the system marginal price.<sup>131</sup> The system marginal price cap should be included in the PJM tariff and Operating Agreement.

**Table 3-86 Real-time RTO synchronized reserve shortage intervals: 2024**

Interval (EPT)	Pricing Run						Dispatch Run				
			Uncapped						Uncapped		
	RTO		RTO	RTO	Capped RTO	RTO			RTO	Capped RTO	
	Extended		Synchronized	Synchronized	Synchronized	Extended			Synchronized	Synchronized	
	Synchronized	Total RTO	Synchronized	Reserve	Reserve	Synchronized	Total RTO	Synchronized	Reserve	Reserve	
	Reserve	Synchronized	Reserve	Clearing	Clearing	Reserve	Synchronized	Reserve	Clearing	Clearing	
	Requirement (MW)	Reserves (MW)	Shortage (MW)	Price (\$/MWh)	Price (\$/MWh)	Requirement (MW)	Reserves (MW)	Shortage (MW)	Price (\$/MWh)	Price (\$/MWh)	
03-Jun-24 19:00	2,524.3	2,222.8	301.5	\$1,700.00	\$1,700.00	2,524.3	2,222.8	301.5	\$1,700.00	\$1,700.00	
28-Jul-24 17:30	2,515.1	2,325.1	190.0	\$1,552.06	\$1,552.06	2,515.1	2,325.1	190.0	\$1,552.06	\$1,552.06	

<sup>130</sup> If the reserve requirement cannot be met by the resources located within the reserve zone, the shadow price of the reserve requirement is set by the applicable operating reserve demand curve.

<sup>131</sup> OA Schedule 1, Section 3.2.3A(d) and Section 3.2.3A.001(c).

Table 3-87 Real-time RTO primary reserve shortage intervals: 2024

Interval (EPT)	Pricing Run					Dispatch Run				
	RTO Extended Primary Reserve Requirement (MW)	Total RTO Primary Reserves (MW)	RTO Primary Reserve Shortage (MW)	Uncapped RTO Primary Reserve Clearing Price (\$/MWh)	Capped RTO Primary Reserve Clearing Price (\$/MWh)	RTO Extended Primary Reserve Requirement (MW)	Total RTO Primary Reserves (MW)	RTO Primary Reserve Shortage (MW)	Uncapped RTO Primary Reserve Clearing Price (\$/MWh)	Capped RTO Primary Reserve Clearing Price (\$/MWh)
20-Jan-24 17:40	3,530.3	3,483.9	46.4	\$300.00	\$300.00	3,530.3	3,483.9	46.4	\$300.00	\$300.00
20-Jan-24 17:50	3,530.3	3,340.4	190.0	\$544.78	\$544.78	3,530.3	3,340.4	190.0	\$544.78	\$544.78
20-Jan-24 17:55	3,530.3	3,340.4	190.0	\$544.78	\$544.78	3,530.3	3,340.4	190.0	\$544.78	\$544.78
22-Jan-24 06:45	3,536.2	3,261.3	274.9	\$850.00	\$850.00	3,536.2	3,261.3	274.9	\$850.00	\$850.00
22-Jan-24 06:50	3,536.2	3,346.2	190.0	\$647.02	\$647.02	3,536.2	3,346.2	190.0	\$647.02	\$647.02
29-Jan-24 12:05	3,507.9	3,226.8	281.1	\$850.00	\$850.00	3,507.9	3,226.8	281.1	\$850.00	\$850.00
29-Jan-24 12:10	3,475.2	3,207.1	268.1	\$850.00	\$850.00	3,475.2	3,207.1	268.1	\$850.00	\$850.00
10-Mar-24 19:20	3,664.9	3,495.7	169.2	\$300.00	\$300.00	3,664.9	3,495.7	169.2	\$300.00	\$300.00
10-Mar-24 19:25	3,664.9	2,912.5	752.4	\$850.00	\$850.00	3,664.9	2,912.5	752.4	\$850.00	\$850.00
10-Mar-24 19:30	3,664.9	3,297.6	367.3	\$850.00	\$850.00	3,664.9	3,297.6	367.3	\$850.00	\$850.00
10-Mar-24 19:35	3,664.9	2,730.1	934.8	\$850.00	\$850.00	3,664.9	2,730.1	934.8	\$850.00	\$850.00
10-Mar-24 19:40	3,664.9	3,103.9	561.0	\$850.00	\$850.00	3,664.9	3,103.9	561.0	\$850.00	\$850.00
10-Mar-24 19:45	3,664.9	2,836.3	828.6	\$850.00	\$850.00	3,664.9	2,836.3	828.6	\$850.00	\$850.00
10-Mar-24 19:50	3,664.9	3,205.6	459.3	\$850.00	\$850.00	3,664.9	3,213.6	451.3	\$850.00	\$850.00
10-Mar-24 19:55	3,664.9	3,343.9	321.0	\$850.00	\$850.00	3,664.9	3,351.9	313.0	\$850.00	\$850.00
18-Mar-24 20:00	3,664.9	3,554.0	110.9	\$300.00	\$300.00	3,664.9	3,554.0	110.9	\$300.00	\$300.00
14-Apr-24 20:00	2,822.5	2,790.1	32.4	\$300.00	\$300.00	2,822.5	2,790.1	32.4	\$300.00	\$300.00
14-Apr-24 20:20	2,822.5	2,785.3	37.2	\$300.00	\$300.00	2,822.5	2,785.3	37.2	\$300.00	\$300.00
21-May-24 18:10	3,664.9	3,635.7	29.2	\$300.00	\$300.00	3,664.9	3,664.9	0.0	\$236.45	\$236.45
03-Jun-24 18:55	3,695.7	3,249.7	446.0	\$850.00	\$850.00	3,695.7	3,249.7	446.0	\$850.00	\$850.00
03-Jun-24 19:00	3,691.4	2,566.8	1,124.6	\$850.00	\$850.00	3,691.4	2,566.8	1,124.6	\$850.00	\$850.00
08-Jul-24 18:00	3,677.6	3,576.3	101.2	\$300.00	\$300.00	3,677.6	3,576.3	101.2	\$300.00	\$300.00
28-Jul-24 17:25	3,677.6	3,164.0	513.6	\$850.00	\$850.00	3,677.6	3,164.0	513.6	\$850.00	\$850.00
28-Jul-24 17:30	3,677.6	2,802.9	874.7	\$850.00	\$850.00	3,677.6	2,802.9	874.7	\$850.00	\$850.00
04-Sep-24 06:30	3,677.6	3,593.5	84.1	\$300.00	\$300.00	3,677.6	3,593.5	84.1	\$300.00	\$300.00
04-Sep-24 06:35	3,677.6	3,602.0	75.5	\$300.00	\$300.00	3,677.6	3,602.0	75.5	\$300.00	\$300.00
14-Oct-24 19:00	3,896.4	3,826.3	70.0	\$300.00	\$300.00	3,896.4	3,826.3	70.0	\$300.00	\$300.00
15-Oct-24 18:45	3,887.5	3,887.5	0.0	\$300.00	\$300.00	3,887.5	3,887.5	0.0	\$300.00	\$300.00
15-Oct-24 18:50	3,889.5	3,889.5	0.0	\$300.00	\$300.00	3,889.5	3,889.5	0.0	\$300.00	\$300.00
15-Oct-24 18:55	3,889.5	3,889.5	0.0	\$300.00	\$300.00	3,889.5	3,889.5	0.0	\$300.00	\$300.00
16-Oct-24 19:05	2,668.4	2,644.6	23.8	\$300.00	\$300.00	2,668.4	2,668.5	0.0	\$170.75	\$170.75
16-Oct-24 19:10	2,668.4	2,644.6	23.8	\$300.00	\$300.00	2,668.4	2,668.5	0.0	\$170.75	\$170.75
22-Nov-24 01:05	3,677.6	3,465.6	212.0	\$850.00	\$850.00	3,677.6	3,465.6	212.0	\$850.00	\$850.00
06-Dec-24 07:25	3,716.8	3,676.9	39.9	\$300.00	\$300.00	3,716.8	3,716.8	0.0	\$294.45	\$294.45
06-Dec-24 17:35	3,677.6	3,602.6	75.0	\$300.00	\$300.00	3,677.6	3,602.6	75.0	\$300.00	\$300.00
06-Dec-24 17:40	3,677.6	3,602.6	75.0	\$300.00	\$300.00	3,677.6	3,602.6	75.0	\$300.00	\$300.00

Table 3-88 Real-time MAD primary reserve shortage intervals: 2024

Interval (EPT)	Pricing Run					Dispatch Run				
	MAD Extended Primary Reserve Requirement (MW)	Total MAD Primary Reserves (MW)	MAD Primary Reserve Shortage (MW)	Uncapped MAD Primary Reserve Clearing Price (\$/MWh)	Capped MAD Primary Reserve Clearing Price (\$/MWh)	MAD Extended Primary Reserve Requirement (MW)	Total MAD Primary Reserves (MW)	MAD Primary Reserve Shortage (MW)	Uncapped MAD Primary Reserve Clearing Price (\$/MWh)	Capped MAD Primary Reserve Clearing Price (\$/MWh)
20-Jan-24 17:35	2,740.0	2,550.0	190.0	\$307.50	\$307.50	2,740.0	2,550.0	190.0	\$307.50	\$307.50
20-Jan-24 17:50	2,740.0	2,550.0	190.0	\$865.68	\$865.68	2,740.0	2,550.0	190.0	\$865.68	\$865.68
20-Jan-24 17:55	2,740.0	2,550.0	190.0	\$865.68	\$865.68	2,740.0	2,550.0	190.0	\$865.68	\$865.68
21-Jan-24 17:45	2,710.0	2,657.1	52.9	\$306.26	\$306.26	2,710.0	2,644.5	65.6	\$300.38	\$300.38
22-Jan-24 06:45	2,764.0	2,574.0	190.0	\$1,161.19	\$1,161.19	2,764.0	2,574.0	190.0	\$1,161.19	\$1,161.19
22-Jan-24 06:50	2,764.0	2,574.0	190.0	\$957.95	\$957.95	2,764.0	2,574.0	190.0	\$957.95	\$957.95
22-Jan-24 06:55	2,764.0	2,574.0	190.0	\$526.19	\$526.19	2,764.0	2,574.0	190.0	\$526.19	\$526.19
03-Jun-24 19:00	2,579.5	2,566.8	12.7	\$1,150.00	\$1,150.00	2,579.5	2,566.8	12.7	\$1,150.00	\$1,150.00
14-Oct-24 19:00	3,896.3	3,826.4	70.0	\$600.00	\$600.00	3,896.3	3,826.4	70.0	\$600.00	\$600.00

## System Marginal Price Cap

Prior to PJM's implementation of the modified reserve markets on October 1, 2022, in the PJM real-time market, the SMP was capped at \$3,750 per MWh. This cap was the sum of the Energy Offer Cap (\$2,000 per MWh under defined conditions), the Synchronous Reserve Penalty Factor from the first step on the demand curve (\$850 per MWh), the Primary Reserve Penalty Factor from the first step on the demand curve (\$850 per MWh) and a threshold (\$50 per MWh). The Operating Agreement stated that only two, of the four, reserve penalty factors may be applied.

In that prior implementation, if the SMP would otherwise exceed \$3,750 per MWh, PJM solved the SCED optimization by progressively relaxing reserve requirement constraints until the SMP fell below the cap. For instance, if the original SMP was above \$3,750, PJM would solve the SCED optimization by disabling the subzone (MAD) primary reserve requirement constraint. If the SMP from the relaxed SCED optimization was still above \$3,750, PJM would solve the SCED optimization by disabling subzone (MAD) primary and synchronized reserve requirement constraints. If the relaxed SCED optimization was still above \$3,750, PJM would solve the SCED optimization by disabling subzone (MAD) primary and synchronized reserve requirement constraints and the RTO primary reserve constraint.

Starting with PJM's implementation of the new Reserve Price Formation rules on October 1, 2022, in the PJM real-time market, the SMP is capped at \$3,700 per MWh. Unlike the prior implementation, PJM's new cap does not include a \$50 per MWh threshold and is not enforced by progressively relaxing reserve requirement constraints. PJM's new cap is an administrative override of the SMP calculated in the pricing run (LPC). The SMP is not capped in the dispatch run (SCED). The congestion component of the LMP and the loss component of the LMP are not subject to this cap. The LMP at a pricing node could still exceed \$3,700 per MWh.

Table 3-89 shows the number of five minute intervals in the real-time market where the SMP was capped for each year since 2019. In 2024, there were zero five minute intervals in the real-time market where the SMP was capped.

**Table 3-89 Number of five minute intervals with capped SMP: 2018 through 2024**

Year	Number of Five Minute Intervals with capped SMP
2018	0
2019	1
2020	1
2021	2
2022	51
2023	1
2024	0

The MMU recommends that PJM stop capping the system marginal price and instead limit the sum of violated reserve constraint shadow prices used in LPC to \$1,700 per MWh.

## Accuracy of Reserve Measurement

The definition of a shortage of synchronized and primary reserves is based on the measured and estimated levels of load, generation, interchange, demand response, and reserves from the real-time SCED software. The definition of such shortage also includes discretionary operator inputs to the ASO (Ancillary Service Optimizer) or RT SCED software, such as operator load bias. For shortage pricing to be accurate, there must be accurate measurement of real-time reserves. That does not appear to be the case at present in PJM, but there does not appear to be any reason that PJM cannot accurately measure reserves. Without accurate measurement of reserves on a minute by minute basis, system operators cannot know with certainty that there is a shortage condition and a reliable trigger for five minute shortage pricing does not exist. The benefits of five minute shortage pricing are based on the assumption that a shortage can be precisely and transparently defined.<sup>132</sup> PJM cannot accurately measure or price reserves due to the inaccuracy of its generator models. PJM's commitment and dispatch models rely on generator data to properly commit and dispatch generators. Generator data includes offers and parameters. When the models do not properly account for the different generator characteristics, both PJM dispatchers and generators have to make simplifications and assumptions using the tools available. Most of these actions taken by generators and by PJM dispatchers are not transparent. PJM manuals do not provide clarity regarding what actions generators can take when the PJM models and tools do not reflect their operational characteristics and PJM manuals do not provide sufficient clarity regarding

<sup>132</sup> See Comments of the Independent Market Monitor for PJM, Docket No. RM15-24-000 (December 1, 2015) at 9.

the actions PJM dispatchers can take when generators do not follow dispatch.

In the energy and reserve markets, the actions that both generators and PJM dispatchers take have a direct impact on the amount of supply available for energy and reserves and the prices for energy and reserves. These flaws in PJM's models do not allow PJM to accurately calculate the amount of reserves available. PJM does not accurately model discontinuities in generator ramp rates, such as duct burners on combined cycle plants. PJM's generator models do not account for the complexities that may result in generators underperforming their submitted ramp rates. PJM should address these complexities through generator modeling improvements. PJM also fails to accurately model unit starts. The market software does not account for the energy output a resource produces prior to reaching its economic minimum output level, during its soak time.

PJM deselects specific units from providing reserves, and overrides the dispatch signal to certain units to set the dispatch signal equal to actual resource output. These manual interventions are, at best, rough approximations of the capability of generators and result in an inaccurate measurement of reserves.

## Competitive Assessment

### Market Structure

#### Market Concentration

The Herfindahl-Hirschman Index (HHI) concentration ratio is the sum of the squares of the market shares of all firms in a market. Hourly PJM energy market HHIs are based on the shares of the real-time energy output of generators adjusted with scheduled imports. Hourly HHIs for the baseload, intermediate and peaking segments of generation supply are based on hourly energy market shares, unadjusted for imports.

The HHI is not a definitive measure of structural market power. It is possible to have pivotal suppliers even when the HHI level is not in the highly concentrated range. It is possible to have an exercise of market power even when the HHI level is not in the highly concentrated range. The number of pivotal suppliers in the energy market is a more precise measure of structural market power than the HHI.

The HHI may not accurately capture market power issues in situations where, for example, there is moderate concentration in all on line resources but there is a high level of concentration in resources needed to meet increases in load. A pivotal supplier test is required to accurately measure the ability of incremental resources to exercise market power.

FERC's Merger Policy Statement defines levels of concentration by HHI level. The market is unconcentrated if the market HHI is below 1000, the HHI if there were 10 firms with equal market shares. The market is moderately concentrated if the market HHI is from 1000 to 1800. The market is highly concentrated if the market HHI is greater than 1800, the HHI if there were between five and six firms with equal market shares.<sup>133</sup>

When transmission constraints exist, local markets are created in which ownership is typically significantly more concentrated than the overall energy market. PJM offer capping rules that limit the exercise of local market power were generally effective in preventing the exercise of market power in 2024, although there are issues with the application of market power mitigation for resources whose owners fail the TPS test that permit local market power to be exercised even when mitigation rules are

<sup>133</sup> See *Inquiry Concerning the Commission's Merger Policy under the Federal Power Act: Policy Statement*, 77 FERC ¶ 61,263 mimeo at 80 (1996).

applied. These issues include the lack of a method for consistently determining the cheaper of the cost and price schedules and the lack of rules requiring that cost-based offers equal short run marginal costs.

### PJM HHI Results

Hourly HHIs indicate that by FERC standards, the PJM energy market in 2024 was unconcentrated on average (Table 3-90).<sup>134</sup> The fact that the average HHI and the maximum hourly HHI are in the unconcentrated range does not mean that the aggregate market was competitive in all hours. It is possible to have pivotal suppliers in the aggregate market even when the HHI level does not indicate a highly concentrated market structure. Given the low responsiveness of consumers to prices (inelastic demand), it is possible to have high markup even when HHI is low. It is possible to have an exercise of market power even when the HHI level does not indicate a highly concentrated market structure.

**Table 3-90 Real-time hourly aggregate energy market HHI: 2023 and 2024**

HHI Statistic	Hourly Market HHI (2023)	Hourly Market HHI (2024)
Average	690	714
Minimum	528	553
Maximum	949	983
Highest market share (One hour)	26%	26%
Average of the highest hourly market share	18%	18%
# Hours	8,760	8,784
# Hours HHI > 1800	0	0
% Hours HHI > 1800	0%	0%

Table 3-91 includes HHI values by supply curve segment, including base, intermediate and peaking plants in 2023 and 2024. On average, ownership in the baseload segment was unconcentrated, in the intermediate segment was moderately concentrated, and in the peaking segment was highly concentrated.<sup>135</sup> High concentration levels increase the probability that a generation owner will be pivotal in the aggregate market.

**Table 3-91 Real-time hourly energy market HHI by generation segment: 2023 and 2024**

	2023			2024		
	Minimum	Average	Maximum	Minimum	Average	Maximum
Base	577	706	971	573	727	1015
Intermediate	679	1481	7085	438	1586	5992
Peak	812	6240	10000	829	6293	10000

Figure 3-54 shows the total installed capacity (ICAP) MW of units in the baseload, intermediate and peaking segments by fuel source in 2024.<sup>136</sup>

**Figure 3-54 Real-time ICAP distribution by fuel and segment: 2024<sup>137</sup>**

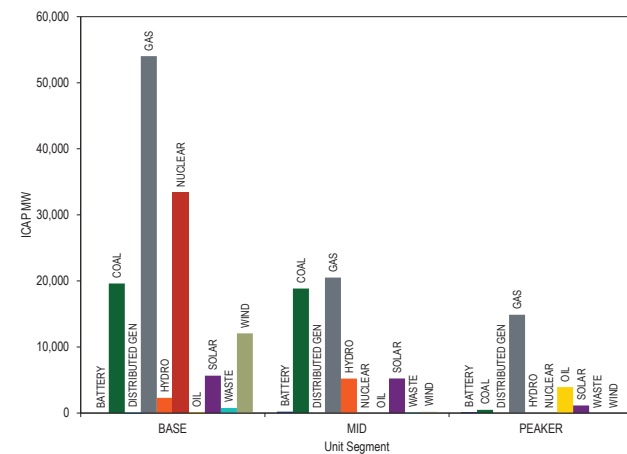


Figure 3-55 shows the ICAP of coal fired and gas fired units in PJM that are classified as baseload, intermediate and peaking from 2014 through 2024. Figure 3-55 shows that the total ICAP of coal fired units in PJM classified as baseload generally decreased from 2014 through 2024, while the total ICAP of gas fired units in PJM classified as baseload generally increased. In 2019, the ICAP of gas fired units classified as baseload exceeded the ICAP of coal fired units classified as baseload for the first time.

<sup>134</sup> The HHI calculations use actual real time settled generation data for each unit in PJM. Each unit's output is assigned to the owner that is responsible for offering the unit in the energy market.

<sup>135</sup> A unit is classified as base load if it runs for 50 percent of hours or more, as intermediate if it runs for less than 50 percent but greater than or equal to 10 percent of hours, and as peak if it runs for less than 10 percent of hours.

<sup>136</sup> The installed capacity (ICAP) used for wind and solar units here is their nameplate capacity in MW. In PJM's Capacity Market, the ICAP value of wind and solar units is derated from the nameplate capacity to reflect their intermittent output characteristics.

<sup>137</sup> The units classified as Distributed Gen are buses within Electric Distribution Companies (EDCs) that are modeled as generation buses to accurately reflect net energy injections from distribution level load buses. The modeling change was the outcome of the Net Energy Metering Task Force stakeholder group in July, 2012. See PJM, "Net Energy Metering Senior Task Force (NEMSTF) 1st Read - Final Report and Proposed Manual Revisions," (June 28, 2012).



**Figure 3-55 Real-time annual gas and coal unit segment classification: 2014 through 2024**


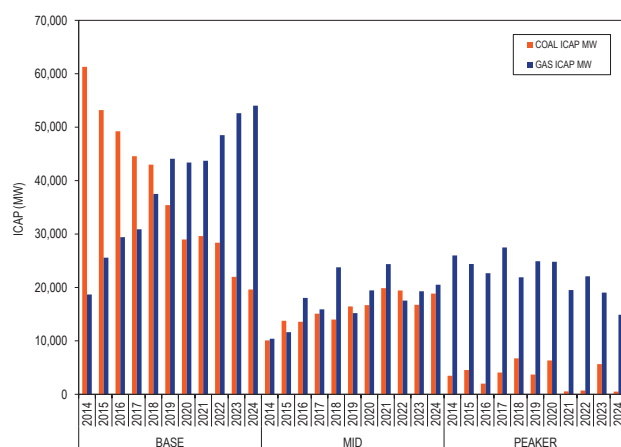


Figure 3-56 presents the hourly HHI values in chronological order and an HHI duration curve for 2024.

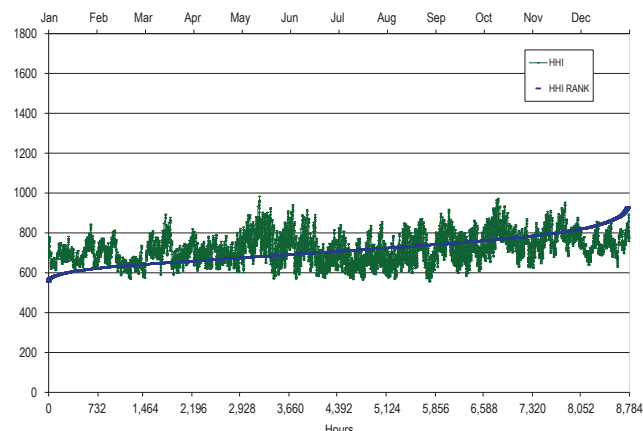**Figure 3-56 Real-time hourly aggregate energy market HHI: 2024**



## Market Based Rates

Participation in the PJM market using offers that exceed costs requires market based rate authority approved by FERC.<sup>138</sup> FERC reviews the market based rate authority of PJM market sellers on a triennial schedule to ensure that market sellers do not have market power or that market power is appropriately mitigated. The entire PJM region is included in the Northeast Region for purposes of the triennial review schedule. Triennial filings by utilities with market based rates authorizations must include a

market power analysis or a statement that market power has been adequately mitigated under the PJM market rules. Based on Order No. 861, sellers may, in lieu of filing a market power analysis, rely on a rebuttable presumption that market monitoring and market power mitigation are sufficient to ensure competitive market outcomes.<sup>139</sup>

The rules specify a separate filing schedule for transmission owning utilities and nontransmission owning utilities. The rules define a study period for market power analyses including four complete seasons. A study runs from December of one year through November of the following year (i.e., the period includes one complete winter season rather than splitting winter as a calendar year approach would). The study period is not relevant for companies that choose the rebuttable presumption option.

The most recent triennial review filings for nontransmission owning utilities in PJM were filed in June 2023. The applicable study period for the June 2023 filings, ran from December 1, 2020, to November 30, 2021. Triennial review filings for transmission owners in PJM were filed in December 2022. The applicable study period for the December 2022 filings ran from December 1, 2020, to November 30, 2021.

The MMU has recommended since 2015 that changes to the offer capping process for the energy market are needed to ensure effective market power mitigation of units that fail the TPS test. With these results and the supporting evidence, the MMU challenged the rebuttable presumption of sufficient market power mitigation for the June 2020, December 2022, and June 2023 triennial review filings by generating unit owners in PJM. The MMU recommended that generators not be allowed to rely on PJM's implementation of market power mitigation rules to ensure competitive market outcomes until improvements are made to the offer capping processes in the energy and capacity markets so that suppliers cannot exercise market power.<sup>140</sup> In 2021, FERC issued orders requiring review of the adequacy of the market power mitigation rules and their implementation in the

<sup>138</sup> See *Market-Based Rates for Wholesale Sales of Electric Energy, Capacity and Ancillary Services by Public Utilities*, Order No. 697, FERC Stats. & Regs. ¶ 31,252 (2007), clarified, 121 FERC ¶ 61,260 (2007), order on reh'g, Order No. 697-A, 123 FERC ¶ 61,055, clarified, 124 FERC ¶ 61,055, order on reh'g, Order No. 697-B, 125 FERC ¶ 61,326 (2008), order on reh'g, Order No. 697-C, 127 FERC ¶ 61,284 (2009), order on reh'g, Order No. 697-D, 130 FERC ¶ 61,206 (2010), *aff'd sub nom.* Mont. Consumer Counsel v. FERC, 659 F.3d 910 (9th Cir. 2011).

<sup>139</sup> *Refinements to Horizontal Market Power Analysis for Sellers in Certain Regional Transmission Organization and Independent System Operator Markets*, Order No. 861, 168 FERC ¶ 61,040 (2019) ("Order No. 861").

<sup>140</sup> See *Protest of the Independent Market Monitor for PJM*, Docket No. ER10-1556 et al. (August 28, 2020); *Comments of the Independent Market Monitor for PJM*, Docket No. ER10-1618-018 et al. (February 13, 2023); *Comments of the Independent Market Monitor for PJM*, Docket No. ER23-9-000 et al. (August 28, 2023).

capacity and energy markets.<sup>141 142</sup> FERC addressed the capacity market Market Seller Offer Cap later in 2021.<sup>143</sup>

## Merger Reviews

FERC reviews proposed dispositions, consolidations, acquisitions, and changes in control of jurisdictional generating units and transmission facilities under section 203 of the Federal Power Act to determine whether such transactions are “consistent with the public interest.”<sup>144 145</sup>

FERC applies tests set forth in the 1996 Merger Policy Statement.<sup>146 147</sup> The 1996 Merger Policy Statement provides for review of jurisdictional transactions based on “(1) the effect on competition; (2) the effect on rates; and (3) the effect on regulation.” FERC adopted the 1992 Department of Justice Guidelines and the Federal Trade Commission Horizontal Merger Guideline (1992 Guidelines) to evaluate the effect on competition. FERC continues to use the 1992 Guidelines even after the Department of Justice modified its guidelines in 2010.<sup>148</sup> Following the 1992 Guidelines, FERC applies a five step framework, which includes: defining the market; analyzing market concentration; analyzing mitigative effects of new entry; assessing efficiency gains; and assessing viability of the parties without a merger. FERC also evaluates a Competitive Analysis Screen.

The MMU reviews proposed mergers and acquisitions based on analysis of the impact of the merger or acquisition on market power given actual PJM market conditions. The analysis includes use of the three pivotal supplier test results in the real-time energy market. The MMU’s review ensures that mergers are evaluated based on their impact on local market power in the PJM energy market using actual observed market conditions, actual binding constraints and actual congestion results. This is in contrast to the typical merger filing that uses predefined local markets based on historical conditions that no longer exist rather than the actual local markets based on current and potential market conditions.

The MMU files comments with FERC including such analyses.<sup>149</sup> The MMU has proposed that FERC adopt this approach when evaluating mergers in PJM.<sup>150</sup> FERC has considered the MMU’s analysis in reviewing mergers but continues to apply a definition of markets based on an outdated and static definition of relevant markets in PJM.<sup>151</sup>

Neither the MMU’s analysis nor the FERC defined analysis is an adequate replacement for effective market power mitigation, because system conditions are dynamic and any owner can become pivotal at any time. FERC routinely approves mergers and acquisitions and grants Market Based Rates authority to PJM market sellers despite known issues in the market power mitigation process that allow market sellers to exercise their market power. For this reason, the MMU recommends that FERC approve mergers and acquisitions conditioned on behavioral commitments by the market sellers that prevent the exercise of market power.

The MMU has also reached agreements to mitigate market power in cases where market power concerns have been identified.<sup>152</sup> Such mitigation is designed to mitigate behavior over the long term, in addition to or instead of structural mitigation in the form of asset divestiture requirements.

The MMU also reviews transactions that involve ownership changes of PJM generation resources that are submitted to the Commission pursuant to section 203 of the Federal Power Act. Table 3-92 shows ownership changes in the PJM market that involved entire resources that were completed in 2024, as reported to the Commission. Table 3-93 shows transactions that involved transfers of partial unit ownership that were completed in 2024, as reported to the Commission.<sup>153</sup>

<sup>141</sup> See 175 FERC ¶ 61,231 (2021).

<sup>142</sup> See 174 FERC ¶ 61,212 (2021).

<sup>143</sup> See 176 FERC ¶ 61,137 (2021), *reh’g denied*, 178 FERC ¶ 61,121 (2022), *appeal denied*, *Vistra Corp. v. FERC*, 80 F.4th 302 (2023).

<sup>144</sup> 18 U.S.C. § 824b.

<sup>145</sup> In February 2019, in response to 2017 amendments to Section 203 of the Federal Power Act, the Commission issued Order No. 855, implementing a \$10,000,000 minimum value for transactions requiring the Commission’s review. See 166 FERC ¶ 61,120 (2019).

<sup>146</sup> See Order No. 592, FERC Stats. & Regs. ¶ 31,044 (1996) (1996 Merger Policy Statement), *reconsideration denied*, Order No. 592-A, 79 FERC ¶ 61,321 (1997). See also FPA Section 203 Supplemental Policy Statement, FERC Stats. & Regs. ¶ 31,253 (2007), *order on clarification and reconsideration*, 122 FERC ¶ 61,157 (2008).

<sup>147</sup> FERC has an open but inactive docket where the guidelines are under review. See 156 FERC ¶ 61,214 (2016); FERC Docket No. RM16-21-000.

<sup>148</sup> See 138 FERC ¶ 61,109 (2012).

<sup>149</sup> See, e.g., Comments of the Independent Market Monitor for PJM, FERC Docket No. EC14-141-000 (Nov. 10, 2014); Comments of the Independent Market Monitor for PJM, FERC Docket No. EC14-96-000 (July 21, 2014); Comments of the Independent Market Monitor for PJM, FERC Docket No. EC11-83-000 (July 21, 2011); Comments of the Independent Market Monitor for PJM, FERC Docket No. EC14-14 (Dec. 9, 2013); Comments of the Independent Market Monitor for PJM, FERC Docket No. EC14-112-000 (Sept. 15, 2014); Comments of the Independent Market Monitor for PJM, FERC Docket No. EC20-49 (June 1, 2020).

<sup>150</sup> See Comments of the Independent Market Monitor for PJM, Docket No. RM16-21 (Dec. 12, 2016).

<sup>151</sup> See *Dynegy Inc., et al.*, 150 FERC ¶ 61, 231 (2015); *Exelon Corporation, Constellation Energy Group, Inc.*, 138 FERC ¶ 61,167 (2012); *NRG Energy Holdings, Inc., Edison Mission Energy*, 146 FERC ¶ 61,196 (2014); see also *Analysis of Horizontal Market Power under the Federal Power Act*, 138 FERC ¶ 61,109 (2012).

<sup>152</sup> See 138 FERC ¶ 61,167 at P 19 (2012). The Maryland PSC accepted without condition or modification the settlement between Constellation and the MMU at the February 1, 2022, hearing in Case No. 9271. See *In the Matter of the Merger of Exelon Corporation and Constellation Energy Group, Inc.*, Order No. 90084, Order Approving 2021 Settlement Agreement and Denying Request to Require Exelon to Remain In PJM, Case No. 9271 (February 22, 2022). By its terms, the settlement became effective on February 1, 2022.

<sup>153</sup> The transaction completion date is based on the notices of consummation submitted to the Commission.

Table 3-92 Completed transfers of entire resources: 2024

Generator or Generation Owner Name	From	To	Transaction Completion Date	Docket
Pittsburgh Airport Generating Facility	Peoples Natural Gas Company LLC	Cordia Holdings, LLC	January 30, 2024	EC24-10
Foxhound Solar, LLC	Longroad Energy Holdings, LLC	Dominion Energy, Inc	February 5, 2024	EC23-67
Richland-Stryker Generation LLC	Vistra Corp.	Rockland Capital, LP	March 4, 2024	EC24-35
Energy Harbor Nuclear Generation LLC (Beaver Valley, Davis Besse, Perry Nuclear Power Stations)	Energy Harbor Corp.	Vistra Corp.	March 1, 2024	EC23-74
Cambria Wind, LLC	Oppidum Green Energy USA, LLC	Partners Group Holding AG	March 21, 2024	EC24-39
Horus West Virginia 1, LLC	Opdenergy Holding, S.A.	Antin Infrastructure Partners S.A.S	March 26, 2024	EC23-107
Nestlewood Solar I, LLC	Vesper Energy Development LLC	Octopus Energy Group Limited	June 7, 2024	EC24-38
Kestrel Acquisition, LLC (Hunterstown Power Plant)	Platinum Equity, LLC	LS Power Development, LLC	July 16, 2024	EC24-42
Clean Energy Future - Lordstown, LLC	Macquarie Infrastructure Partners	Arclight Capital Partners, LLC	August 30, 2024	EC24-57
UGI Development Company (Hunlock Energy, LLC)	UGI Energy Services, LLC	Castelton Commodities International, LLC	September 30, 2024	EC24-98
Lanyard Power, LLC (Dickerson Power, LLC and Chalk Point Power, LLC)	Olympus Power, LLC	Rockland Capital, LP	October 17, 2024	EC24-79
Bluegrass Solar, Ripley Solar, MD Solar, and Ben Moreell Solar	Vitol Inc.	MN8 Energy, LLC	December 13, 2024	EC24-113
Big Sky Wind, LLC	Vitol Inc	Power Corporation of Canada	December 30, 2024	EC24-121

Table 3-93 Completed transfers of partial ownership of resources: 2024

Generator or Generation Owner Name	Percent	From	To	Transaction Completion Date	Docket
Blue Harvest Solar Park LLC and Timber Road Solar Park LLC	80.0%	EDP Renewables North America LLC	Eni S.p.A	February 14, 2024	EC24-31
Homer City Holding LLC	20.0%	TCW Group, Inc	Knighththead Capital Management, LLC	August 14, 2024	EC24-94
ECP ControlCo, LLC (Calpine Corporation, Convergent Energy and Power, Pivot Energy Holdings)	19.9%	ECP ControlCo, LLC	Bridgepoint, OP LLC	August 20, 2024	EC24-69
CPV Renewable Power LLC (Backbone Solar, Maple Hill Solar, Saddleback Ridge Wind, Stagecoach Solar)	33.3%	OPC Power Ventures LP	HS Renewable Co-Investment I, L.P.	November 13, 2024	EC24-115

## Aggregate Market Pivotal Supplier Results

Notwithstanding the HHI level, a supplier may have the ability to raise energy market prices. If reliably meeting the PJM system load requires energy from a single supplier, that supplier is singly pivotal and has monopoly power in the aggregate energy market. If a small number of suppliers are jointly required to meet load, those suppliers are jointly pivotal and have oligopoly power. The number of pivotal suppliers in the energy market is a more precise measure of structural market power than the HHI. The HHI is not a definitive measure of structural market power. The identification of jointly pivotal suppliers as a source of market power does not require an assumption that the suppliers collude. There are multiple mechanisms that would permit the exercise of market power when there are limited suppliers providing relief to a constraint. FERC Order No. 697 also recognizes this explicitly in the discussion of HHI and pivotal suppliers.<sup>154</sup> FERC's definition of highly concentrated markets, based on an HHI greater than 1800, includes between five and six owners with equal market shares.

The current market power mitigation rules for the PJM energy market rely on the assumption that the aggregate market includes sufficient competing sellers to ensure competitive market outcomes. With sufficient competition, any attempt to economically or physically withhold generation would not result in higher market prices, because another supplier would replace the generation at a similar price. This assumption requires that the total demand for energy can be met without the supply from any individual supplier or without the supply from a small group of suppliers. This assumption is not always correct, as demonstrated by these results. There are pivotal suppliers in the aggregate energy market.

The existing market power mitigation measures do not address aggregate market power.<sup>155</sup> Aggregate market power should be mitigated in the PJM Day-Ahead and Real-Time Markets when the three pivotal supplier test is failed.

<sup>154</sup> Order No. 697, FERC Stats. & Regs. ¶ 31,252 at PP 104–117.

<sup>155</sup> One supplier, Exelon Generating Company, LLC, is partially mitigated for aggregate market power through a settlement agreement with the MMU filed December 30, 2021 and approved by the Maryland Public Service Commission as a condition of its merger. *In the Matter of the Merger of Exelon Corporation and Constellation Energy Group, Inc.*, Order No. 90084, Maryland PSC Case No. 9271 (February 22, 2022). Order No. 90084 replaces the original 10 year settlement in this case included as a condition in Order No. 84698, issued February 17, 2012, which approved the merger between Exelon and Constellation Energy Group.

## Day-Ahead Energy Market Aggregate Pivotal Suppliers

To assess the number of aggregate pivotal suppliers in the day-ahead energy market, the MMU determined, for each supplier, the MW available for economic commitment that were already running or were available to start between the close of the day-ahead energy market and the peak load hour of the operating day. The available supply is defined as MW offered at a price less than 150 percent of the applicable LMP because supply available at higher prices is not competing to meet the demand for energy. Generating units, import transactions, economic demand response, and INCs, are included for each supplier. Demand is the total MW required by PJM to meet physical load, cleared load bids, export transactions, and DECs. A supplier is pivotal if PJM would require some portion of the supplier's available economic capacity in the peak hour of the operating day in order to meet demand. Suppliers are jointly pivotal if PJM would require some portion of the joint suppliers' available economic capacity in the peak hour of the operating day in order to meet demand.

Figure 3-57 shows the number of days in 2024 with one aggregate pivotal supplier, two aggregate jointly pivotal suppliers, and three aggregate jointly pivotal suppliers in the day-ahead energy market by peak load level. It shows that the frequency of pivotal suppliers increases with load. The average number of suppliers that were one of three pivotal suppliers (yellow line) was 0.7 on the 34 days with a peak load less than 90 GW (gray bar) and was 39.7 suppliers on the 39 days with a peak load between 120 and 130 GW. The number of pivotal suppliers increases with load. The two days with singly pivotal suppliers (teal line) were January 15 and July 15, 2024.

**Figure 3-57 Average number of pivotal suppliers in the day-ahead energy market by load level**

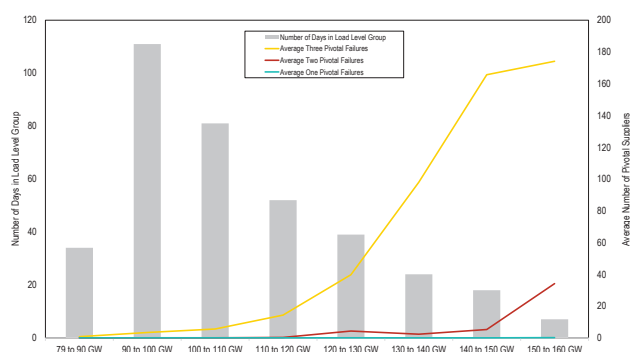


Table 3-94 provides the frequency with which each of the top 10 pivotal suppliers was singly or jointly pivotal for the day-ahead energy market in 2024. All of the top 10 suppliers were one of three pivotal suppliers on at least 79 days in 2024 (21.6 percent of the days).

**Table 3-94 Day-ahead market pivotal supplier frequency: 2024**

Pivotal Supplier Rank	Days Singly Pivotal		Days Jointly Pivotal with One Other Supplier		Days Jointly Pivotal with Two Other Suppliers	
	Percent of Days	Percent of Days	Percent of Days	Percent of Days		
1	2	0.5%	49	13.4%	175	47.8%
2	1	0.3%	43	11.7%	166	45.4%
3	0	0.0%	44	12.0%	177	48.4%
4	0	0.0%	38	10.4%	145	39.6%
5	0	0.0%	34	9.3%	169	46.2%
6	0	0.0%	19	5.2%	90	24.6%
7	0	0.0%	10	2.7%	87	23.8%
8	0	0.0%	8	2.2%	113	30.9%
9	0	0.0%	5	1.4%	81	22.1%
10	0	0.0%	5	1.4%	79	21.6%

## Market Behavior

### Local Market Power

In the PJM energy market, market power mitigation rules currently apply only for local market power. Local market power exists when transmission constraints or reliability issues create local markets that are structurally noncompetitive. If the owners of the units required to solve the constraint or reliability issue are pivotal or jointly pivotal, they have the ability to set the price. Absent market power mitigation, unit owners that submit noncompetitive offers, or offers with inflexible operating parameters, could exercise market power. This could result in LMPs being set at higher than competitive levels, or could result in noncompetitive uplift payments.

The three pivotal supplier (TPS) test is the test for local market power in the energy market.<sup>156</sup> If the TPS test is failed, market power mitigation is applied by offer capping the resources of the owners who have been identified as having local market power. Offer capping is designed to set offers at competitive levels. Competitive offers are defined to be cost-based energy offers. In the PJM energy market, units are required to submit cost-based energy offers, defined by fuel cost policies, and have the option to submit market-based, also called price-based, offers. Units are committed and dispatched on price-based offers, if offered, as the default offer.

<sup>156</sup> See the MMU Technical Reference for PJM Markets, at "Three Pivotal Supplier Test" for a more detailed explanation of the three pivotal supplier test. <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

When a unit that submits both cost-based and price-based offers is mitigated to its cost-based offer by PJM, it is considered offer capped. A unit that submits only cost-based offers, or that requests PJM to dispatch it on its cost-based offer, is not considered offer capped.

Local market power mitigation is implemented in both the day-ahead and real-time energy markets. However, the implementation of the TPS test and offer capping differ in the day-ahead and real-time energy markets.

### TPS Test Statistics for Local Market Power

The TPS test in the energy market defines whether three suppliers are jointly pivotal in a defined local market. The TPS test is applied when the system solution indicates that a transmission constraint is binding or requires the commitment of additional resources. The TPS test result for a constraint for a specific interval indicates whether a supplier failed or passed the test for that constraint for that interval. A failed test indicates that the resource owner has structural market power.

A metric to describe the number of local markets created by transmission constraints and the applicability of the TPS test is the number of hours that each transmission constraint was binding in the real-time energy market over a period, by zone.

In 2024, in the day-ahead energy market, the 500 kV system, 20 zones, and PJM/MISO experienced congestion resulting from one or more constraints binding for 100 or more hours, or resulting from a binding interface constraint (Table 3-95).<sup>157</sup> Table 3-95 shows that the 500 kV system, 13 zones and PJM/MISO experienced congestion resulting from one or more constraints binding for 100 or more hours or resulting from a binding interface constraint in every year from 2015 through 2024. Two zones did not experience congestion resulting from one or more constraints binding for 100 or more hours or resulting from any binding interface constraint in any year from 2015 through 2024.<sup>158</sup>

**Table 3-95 Day-ahead congestion hours resulting from one or more constraints binding for 100 or more hours: 2015 through 2024**

	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
500 kV System	8,797	7,350	7,937	4,360	7,507	5,248	2,662	2,983	1,225	1,772
ACEC	3,746	5,955	2,203	4,009	6,039	2,467	961	778	1,187	850
AEP	29,772	57,482	54,076	16,367	14,436	10,988	4,797	6,032	6,833	7,035
APS	5,104	11,445	11,513	3,884	3,129	3,592	3,094	1,904	2,243	2,262
ATSI	3,445	4,264	4,305	3,453	1,631	105	0	341	689	1,689
BGE	9,199	15,664	8,589	5,087	3,819	6,154	3,401	1,276	4,427	2,021
COMED	20,165	49,911	59,455	11,334	5,154	3,574	2,409	3,366	4,676	8,728
DAY	437	825	382	129	193	988	358	0	208	0
DEOK	8,478	9,577	8,112	2,598	1,444	218	348	620	318	246
DLCO	1,025	590	106	208	0	150	0	101	221	165
DOM	6,549	4,920	9,927	2,592	1,103	3,338	1,955	4,188	3,396	4,249
DPL	11,112	14,930	13,059	12,949	8,303	6,000	4,054	3,994	5,069	6,017
DUKE	0	0	0	0	0	0	0	0	0	0
DUQ	0	0	0	0	0	0	0	0	0	0
EKPC	215	3,833	1,313	521	0	0	0	0	163	104
EXT	1,360	0	440	177	0	0	0	0	0	0
JCPLC	3,883	4,179	2,089	1,521	317	1,706	0	814	2,238	1,746
MEC	2,148	5,586	6,111	4,337	3,958	2,092	2,138	3,018	2,312	3,416
NYISO	0	0	515	0	0	0	0	0	0	0
OVEC	0	0	0	0	1,853	2,560	0	1,021	1,737	630
PE	6,368	10,476	22,930	8,837	3,855	3,947	1,833	4,302	4,983	9,795
PECO	3,627	6,131	10,065	3,378	1,892	1,045	2,331	4,811	6,616	4,094
PEPCO	896	410	660	126	0	0	0	304	283	265
PJM/MISO	25,773	22,497	28,097	17,855	9,774	5,916	7,096	10,569	6,019	6,967
PPL	336	3,378	8,182	5,265	8,953	5,291	4,454	6,049	2,972	3,499
PSEG	16,458	16,816	21,390	6,696	2,733	2,446	3,544	5,125	2,288	1,137
REC	0	0	0	511	1,075	335	1,249	1,126	1,105	287
TVA	0	223	0	0	206	0	0	0	0	0

<sup>157</sup> A constraint is mapped to the 500 kV system if its voltage is 500 kV and it is located in one of the zones including ACEC, BGE, DPL, JCPLC, MEC, PECO, PENELEC, PEPCO, PPL and PSEG. All PJM/MISO

reciprocally coordinated flowgates (RCF) are mapped to MISO regardless of the location of the flowgates. All PJM/NYISO RCF are mapped to NYISO as location regardless of the location of the flowgates.

<sup>158</sup> In this report, the MMU used the dispatch run marginal resource and sensitivity factor data, rather than the pricing run data, in the analysis of constraints since 2021 because the PJM pricing run sensitivity factor data for day-ahead LMP was not correct for a small number of hours. The PJM pricing run LMPs are the final settlement LMPs.



In 2024, in the real-time energy market, the 500 kV system, 10 zones, and PJM/MISO experienced congestion resulting from one or more constraints binding for 100 or more hours, or resulting from a binding interface constraint (Table 3-96).<sup>159</sup> Table 3-96 shows that the 500 kV system, six zones, and PJM/MISO experienced congestion resulting from one or more constraints binding for 100 or more hours or resulting from a binding interface constraint in every year from 2015 through 2024. Six zones (Duke, DUQ, JCPLC, OVEC, PEPCO and REC) did not experience congestion resulting from one or more constraints binding for 100 or more hours or resulting from any binding interface constraint in any year from 2015 through 2024.<sup>160</sup>

**Table 3-96 Real-time congestion hours resulting from one or more constraints binding for 100 or more hours: 2015 through 2024**

	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
500 kV System	665	804	944	1,112	4,470	2,217	1,060	1,021	375	782
ACEC	197	439	0	500	108	0	0	0	0	0
AEP	1,385	400	469	1,301	535	1,133	1,271	500	1,276	1,151
APS	167	0	265	246	191	322	1,474	0	313	182
ATSI	117	0	164	932	0	0	150	237	100	1,256
BGE	4,262	5,501	1,506	2,496	690	2,929	1,539	462	2,255	1,110
COMED	2,516	3,587	1,359	724	343	761	952	1,307	876	4,213
DAY	0	0	0	0	0	0	181	0	0	0
DEOK	112	0	0	0	0	0	0	139	0	0
DLCO	368	0	0	0	0	0	0	0	0	0
DOM	837	459	441	136	197	896	389	2,029	343	550
DPL	1,539	1,976	675	1,049	0	106	163	0	0	114
DUKE	0	0	0	0	0	0	0	0	0	0
DUQ	0	0	0	0	0	0	0	0	0	0
EKPC	0	0	0	200	0	0	0	0	0	0
EXT	0	0	788	0	0	0	0	0	0	0
JCPLC	0	0	0	0	0	0	0	0	0	0
MEC	111	0	116	755	465	1,042	412	1,232	502	590
NYISO	419	1,074	332	0	0	0	0	0	0	0
OVEC	0	0	0	0	0	0	0	0	0	0
PE	1,553	141	1,952	1,308	1,972	2,302	1,274	1,520	2,716	5,226
PECO	690	751	1,374	719	468	306	1,279	3,072	4,080	1,536
PEPCO	0	0	0	0	0	0	0	0	0	0
PJM/MISO	3,988	3,946	4,450	4,106	4,837	3,731	5,127	7,561	4,321	4,478
PPL	135	470	1,168	295	1,044	575	820	2,072	0	0
PSEG	1,698	407	240	113	0	0	898	296	0	0
REC	0	0	0	0	0	0	0	0	0	0

In the PJM Day-Ahead Energy Market, the TPS test is performed in PROBE, as part of the unit commitment process. Table 3-97 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owners passing and failing the TPS test for the interface constraints in the PJM Day-Ahead Energy Market.

<sup>159</sup> A constraint is mapped to the 500 kV system if its voltage is 500 kV and it is located in one of the zones including AECO, BGE, DPL, JCPLC, MEC, PECO, PENELEC, PEPCO, PPL and PSEG. All PJM/MISO reciprocally coordinated flowgates (RCF) are mapped to MISO regardless of the location of the flowgates. All PJM/NYISO RCF are mapped to NYISO as location regardless of the location of the flowgates.

<sup>160</sup> In this report, the MMU used the dispatch run marginal resource and sensitivity factor data, rather than the pricing run data, in the analysis of constraints since 2021 because the PJM pricing run sensitivity factor data for day-ahead LMP was not correct for a small number of hours. The PJM pricing run LMPs are the final settlement LMPs.

**Table 3-97 Day-ahead three pivotal supplier test details for internal interface constraints: 2024**

Constraint	Period	Number of Tests	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
AEP - DOM	Peak	8	573	317	21	2	18
	Off Peak	47	401	618	25	10	15
AP South	Peak	119	671	1,129	32	13	18
	Off Peak	55	830	1,955	35	19	16
BCPEP	Peak	9	649	369	12	2	9
	Off Peak	1	201	387	12	0	12
Bedington - Black Oak	Peak	28	322	547	35	20	15
	Off Peak	117	353	892	33	22	11
Central	Peak	14	652	993	29	14	15
	Off Peak	0	0	0	0	0	0
East	Peak	5	314	788	21	5	16
	Off Peak	4	426	1,449	22	14	8
West	Peak	17	588	2,509	43	40	2
	Off Peak	8	663	1,494	27	8	19

Table 3-98 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market, whether the TPS test was applied, and the average number of owners passing and failing the TPS test for the 10 constraints that were binding for the most hours in the day-ahead energy market. In the day-ahead energy market, the TPS test evaluates each constraint that was binding for each hour during the operating day after the initial unit commitment run. The set of constraints that are binding in the unit commitment run, for which the TPS test is applied, is not necessarily the same as the set of constraints that bind in the final day-ahead energy market solution. This is because PJM's day-ahead market is solved in three stages, and the initial set of constraints is from the Resource Scheduling and Commitment (RSC) (unit commitment) stage while the final set of binding constraints is from the Scheduling Pricing and Dispatch (SPD) (unit dispatch) stage.<sup>161</sup> The PJM approach fails to apply the TPS test to market sellers that provide relief to constraints in the final dispatch solution, and therefore fails to mitigate such sellers for market power.

The MMU recommends that PJM modify the process for applying the TPS test in the day-ahead energy market to ensure that all local markets created by binding constraints are tested for market power and to ensure that market sellers with market power are appropriately mitigated to their competitive offers.

**Table 3-98 Day-ahead three pivotal supplier test details for top 10 congested constraints: 2024**

Constraint	Period	Number of Tests	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
East Towanda - Hillside	Peak	769	138	115	8	1	7
	Off Peak	717	130	176	8	0	8
Easton - Emuni	Peak	37	49	13	2	0	2
	Off Peak	6	26	5	1	0	1
Gardners - Texas Eastern	Peak	936	93	17	4	0	3
	Off Peak	474	91	15	4	0	4
Haumesser Road - Steward	Peak	561	250	235	11	1	10
	Off Peak	580	275	219	10	0	9
Kewanee	Peak	676	164	163	7	0	7
	Off Peak	849	170	143	6	0	6
Lenox - North Meshoppen	Peak	570	64	36	7	1	6
	Off Peak	779	56	41	8	1	8
Nottingham	Peak	1,413	183	429	31	23	8
	Off Peak	745	149	371	25	19	7
Prest - Tibb	Peak	18	55	32	4	0	4
	Off Peak	6	11	7	4	1	3
Sayreville - Sayreville	Peak	6	30	2	1	0	1
	Off Peak	14	20	3	1	0	1
East Lima - Haviland	Peak	430	115	141	15	2	13
	Off Peak	469	98	116	13	1	11

<sup>161</sup> See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Section 5.2.6, Rev. 133 (Dec. 17, 2024).

The local market structure in the real-time energy market associated with each of the frequently binding constraints was analyzed using the three pivotal supplier results in 2024.<sup>162</sup> While the real-time constraint hours include constraints that were binding in the five minute real-time dispatch solution (RT SCED), IT SCED, the software that performs the TPS test, may contain different binding constraints because IT SCED looks ahead to target times that are in the near future to solve for constraints that could be binding, using the load forecast for those times.<sup>163</sup> IT SCED solves for target times that occur at 15 minute time increments, unlike RT SCED that solves for every five minute time increment. The TPS statistics shown in this section present the data from the IT SCED TPS solution. Some IT SCED TPS solutions are used to commit units, while others are not. PJM operators have discretion in choosing which units to commit and which IT SCED results to use as the basis for the commitment and therefore which units are tested for market power using the TPS test. The results of the TPS test are shown for tests that could have resulted in offer capping and tests that resulted in offer capping.

Table 3-99 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owners passing and failing for the interface constraints in the PJM Real-Time Energy Market. Table 3-100 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owners passing and failing for the 10 constraints that were binding for the most hours in the PJM Real-Time Energy Market. Table 3-99 and Table 3-100 include analysis of all the tests for every target time where IT SCED determined that constraint relief was needed for each of the constraints shown. The same target time can be evaluated by multiple IT SCED cases at different look ahead times. Each 15 minute target time is solved by 12 different IT SCED cases at different look ahead times. The set of binding constraints for a target time may be different in 12 look ahead IT SCED solutions.

**Table 3-99 Real-time three pivotal supplier test details for internal interface constraints: 2024**

Constraint	Period	Number of Tests	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
AP South	Peak	1,871	390	622	13	2	11
	Off Peak	3,269	573	820	17	6	11
Bedington - Black Oak	Peak	1,754	126	164	12	3	9
	Off Peak	1,834	134	197	13	5	8
AEP - DOM	Peak	459	353	319	10	0	9
	Off Peak	1,242	466	403	9	1	8

<sup>162</sup> See the *MMU Technical Reference for PJM Markets*, p. 38 "Three Pivotal Supplier Test" for a more detailed explanation of the three pivotal supplier test. <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

<sup>163</sup> Prior to September 1, 2021, the real-time binding constraints were identical in the dispatch (RT SCED) and pricing (LPC) solutions. Beginning September 1, 2021, with implementation of fast start pricing, the set of binding constraints can differ between RT SCED and LPC pricing solutions. The set of constraints reported here are based on the binding constraints in RT SCED. This is because PJM commits and mitigates units based on a dispatch solution in IT SCED without fast start pricing.

**Table 3-100 Real-time three pivotal supplier test details for top 10 congested constraints: 2024**

Constraint	Period	Number of Tests	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Lenox - North Meshoppen	Peak	58,156	22	26	3	0	2
	Off Peak	79,955	20	27	2	0	2
Kewanee	Peak	13,174	22	76	1	0	1
	Off Peak	12,410	21	70	1	0	1
Nottingham	Peak	38,670	117	148	12	3	9
	Off Peak	18,639	98	142	11	3	8
Prest - Tibb	Peak	6,773	22	10	3	0	3
	Off Peak	14,028	22	10	3	0	3
Haumesser Road - Steward	Peak	16,967	44	108	2	0	2
	Off Peak	15,859	40	93	2	0	2
East Towanda - Hillside	Peak	16,236	79	104	2	0	2
	Off Peak	19,777	69	122	2	0	2
Rising - Bondville	Peak	5,300	31	12	3	0	3
	Off Peak	10,040	31	15	3	0	3
Graceton - Safe Harbor	Peak	9,593	133	151	12	1	11
	Off Peak	9,449	98	125	11	2	9
Dune Acres - Michigan City	Peak	4,152	40	46	5	0	4
	Off Peak	10,035	39	49	5	0	4
Highland - Commerce	Peak	10,750	32	71	2	0	2
	Off Peak	6,848	17	48	2	0	2

The three pivotal supplier test is applied every time the IT SCED solution indicates that incremental relief is needed to relieve a transmission constraint. While every system solution that requires incremental relief to transmission constraints will result in a test, not all tested providers of effective supply are eligible for offer capping. Steam unit offers that are offer capped in the day-ahead energy market continue to be offer capped in the real-time energy market regardless of their inclusion in the TPS test in real time or the outcome of the TPS test in real time. Steam unit offers that are not offer capped in the day-ahead energy market continue to not be offer capped in the real-time energy market regardless of their inclusion in the TPS test in real time or the outcome of the TPS test in real time.<sup>164</sup> Offline units that are committed to provide relief for a transmission constraint, whose owners fail the TPS test, are committed on the cheaper of their cost or price-based offers. Beginning November 1, 2017, with the introduction of hourly offers and intraday offer updates, online units whose commitment is extended beyond the day-ahead or real-time commitment, and whose owners fail the TPS test, are also switched to the cost-based offer if it is cheaper than the price-based offer.

Units committed in the day-ahead market often fail the TPS test in the real-time market when they are

<sup>164</sup> If a steam unit were to lower its cost-based offer in real time, it would become eligible for offer capping based on the online TPS test.

redispatched to provide relief to transmission constraints, even though they did not fail the TPS test in the day-ahead market. Day-ahead committed units are not evaluated for offer capping in real-time unless they update their cost-based offer. These units are able to set prices with a positive markup in the real-time market. Units that cleared the day-ahead market on their price based schedule were evaluated to identify the units whose offers were mitigated in real-time and the units that cleared on price offers in real-time despite failing the real-time TPS test. Table 3-101 shows that, in 2024, 3.9 percent of unit hours that cleared the day-ahead market on their

price based offer were switched to cost in real-time. Table 3-101 shows that 8.4 percent of unit hours that cleared the day-ahead market on their price based offer cleared on their price based offer in real-time despite failing the real-time TPS test.

**Table 3-101 Day-ahead units committed on price-based offers that cleared real-time: 2023 and 2024**

Year	Day Ahead Price Based Unit Hours That Cleared Real-Time			Percent Day Ahead Price Based Unit Hours That Cleared Real-Time	
	On Cost	On Price	On Price and Failed TPS Test	On Cost	On Price and Failed TPS Test
2023	85,417	2,502,803	278,944	3.0%	9.7%
2024	117,994	2,627,768	253,035	3.9%	8.4%

The MMU recommends, in order to ensure effective market power mitigation when the TPS test is failed, that offer capping be applied to units that fail the TPS test in the real-time market that were not offer capped at the time of commitment in the day-ahead market or at a prior time in the real-time market.

Table 3-102 and Table 3-103 provide, for the identified constraints, information on total tests applied, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping in the real-time energy market. Tests where there was at least one offline unit or an

online unit eligible for offer capping are considered tests that could have resulted in offer capping. PJM operators also manually commit units for reliability reasons other than providing relief to a binding constraint. Manual commitments are offer capped along with resources that fail the TPS test.

**Table 3-102 Summary of real-time three pivotal supplier tests applied for internal interface constraints: 2024**

Constraint	Period	Total Tests that Could Have Resulted in Offer Capping		Percent Total Tests that Could Have Resulted in Offer Capping		Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping	
		Total Tests Applied	Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping
AP South	Peak	1,871	1,862	100%	40	2%	2%
	Off Peak	3,269	3,269	100%	61	2%	2%
Bedington - Black Oak	Peak	1,754	1,754	100%	19	1%	1%
	Off Peak	1,834	1,834	100%	61	3%	3%
AEP - DOM	Peak	459	459	0%	29	0%	0%
	Off Peak	1,242	1,242	100%	73	6%	6%

**Table 3-103 Summary of real-time three pivotal supplier tests applied for top 10 congested constraints: 2024**

Constraint	Period	Total Tests that Could Have Resulted in Offer Capping		Percent Total Tests that Could Have Resulted in Offer Capping		Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping	
		Total Tests Applied	Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping
Lenox - North Meshoppen	Peak	58,156	28,453	49%	5	0%	0%
	Off Peak	79,955	20,817	26%	5	0%	0%
Kewanee	Peak	13,174	319	2%	0	0%	0%
	Off Peak	12,410	406	3%	0	0%	0%
Nottingham	Peak	38,670	38,580	100%	457	1%	1%
	Off Peak	18,639	18,573	100%	233	1%	1%
Prest - Tibb	Peak	6,773	627	9%	0	0%	0%
	Off Peak	14,028	1,105	8%	0	0%	0%
Haumesser Road - Steward	Peak	16,967	2,860	17%	0	0%	0%
	Off Peak	15,859	2,205	14%	0	0%	0%
East Towanda - Hillside	Peak	16,236	8,996	55%	0	0%	0%
	Off Peak	19,777	6,386	32%	0	0%	0%
Rising - Bondville	Peak	5,300	965	18%	0	0%	0%
	Off Peak	10,040	1,498	15%	2	0%	0%
Graceton - Safe Harbor	Peak	9,593	9,545	99%	91	1%	1%
	Off Peak	9,449	9,441	100%	91	1%	1%
Dune Acres - Michigan City	Peak	4,152	1,981	48%	0	0%	0%
	Off Peak	10,035	5,105	51%	0	0%	0%
Highland - Commerce	Peak	10,750	747	7%	0	0%	0%
	Off Peak	6,848	536	8%	0	0%	0%

## Offer Capping for Local Market Power

In the PJM energy market, offer capping occurs as a result of structurally noncompetitive local markets and noncompetitive offers in the day-ahead and real-time energy markets. PJM also uses offer capping for units that are committed for reliability reasons, like voltage support and N-2 contingencies, for providing black start and for providing reactive service as well as for conservative operations. There are no explicit rules governing market structure or the exercise of market power in the aggregate energy market.

There are some issues with the application of mitigation in the day-ahead energy market and the real-time energy market when market sellers fail the TPS test. There are also issues with the absence of a TPS test under some conditions. There is no tariff or manual language that defines in detail the application of the TPS test and offer capping in the day-ahead energy market and the real-time energy market. There is no tariff or manual language that defines the PJM process for evaluating units for multi-day commitments in the day-ahead energy market.

In both the day-ahead and real-time energy markets, generators with market power have the ability to evade mitigation by using varying markups in their price-based offers, offering different operating parameters in their



price-based and cost-based offers, and using different fuels in their price-based and cost-based offers. These issues can be resolved by simple rule changes.

When an owner fails the TPS test, the units offered by the owner that are committed to provide relief are committed on the cheaper of cost-based or price-based offers. In the day-ahead energy market, PJM commits a unit on the schedule that results in the lower overall system production cost. The day-ahead energy market selects which schedule to use for a resource that failed the TPS test based on its objective of clearing resources to meet the total demand at the lowest bid production cost for the system over the 24 hour period.

In the real-time energy market, PJM uses a dispatch cost formula to compare price-based offers and cost-based offers to select the cheaper offer.<sup>165</sup>


$$\text{Total Dispatch Cost} = \text{Startup Cost} + \sum_{\text{Min Run}} \text{Hourly Dispatch Cost}$$

where the hourly dispatch cost is calculated for each hour using the offers applicable for that hour as:

$$\text{Hourly Dispatch Cost} = (\text{Incremental Energy Offer@EcoMin} \times \text{EcoMin MW}) + \text{NoLoad Cost}$$

The hourly dispatch cost is calculated only at the economic minimum level and not at higher output levels. Given the ability to submit offer curves with different markups at different output levels in the price-based offer, unit owners with market power can evade mitigation by using a low markup at low output levels and a high markup at higher output levels. This strategy is called crossing curves, or markup switching. Figure 3-58 shows an example of offers from a unit that has a negative markup at the economic minimum MW level and a positive markup at the economic maximum MW level. The result would be that a unit that failed the TPS test would be committed on its price-based offer that has a lower dispatch cost, even though the price-based offer is higher than cost-based offer at higher output levels and includes positive markups, inconsistent with the explicit goal of local market power mitigation.

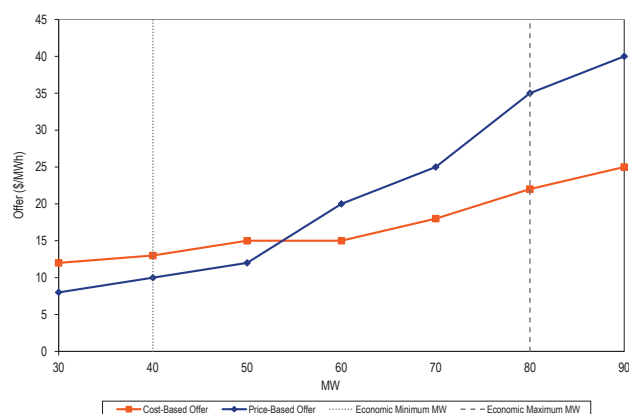**Figure 3-58 Offers with varying markups at different MW output levels**



<sup>165</sup> See OA Schedule 1 § 6.4.1(g).

Table 3-104 shows the number and percent of unit schedule hours, by month, when unit offers included crossing curves (markup switch) in the PJM Day-Ahead and Real-Time Energy Markets in 2024. The analysis only includes units that offer both price-based and cost-based offers. Units in PJM are only required to submit cost-based offers, but they may elect to offer price-based offers.

**Table 3-104 Units offered with crossing curves (markup switch): 2024**

	Day-Ahead			Real-Time		
	Number of Schedule Hours with Crossing Curves	Total Number of Cost Schedule Hours Offered by Price Based Units	Percent of Schedule Hours with Crossing Curves	Number of Schedule Hours with Crossing Curves	Total Number of Cost Schedule Hours Offered by Price Based Units	Percent of Schedule Hours with Crossing Curves
2024						
Jan	86,890	839,400	10.4%	73,782	775,515	9.5%
Feb	79,862	792,552	10.1%	63,141	736,063	8.6%
Mar	69,121	844,500	8.2%	53,785	696,611	7.6%
Apr	76,590	826,728	9.3%	61,495	677,110	9.1%
May	87,098	869,976	10.0%	72,655	736,427	9.9%
Jun	88,455	839,472	10.5%	83,877	786,417	10.7%
Jul	95,303	870,960	10.9%	90,379	821,874	11.0%
Aug	98,747	869,808	11.4%	90,266	823,331	11.0%
Sep	89,362	847,152	10.5%	76,991	763,796	10.1%
Oct	88,633	887,760	10.0%	62,853	693,099	9.1%
Nov	79,813	864,613	9.2%	59,349	710,932	8.3%
Dec	81,498	899,256	9.1%	69,946	812,552	8.6%
Total	1,021,372	10,252,177	10.0%	858,519	9,033,727	9.5%

Offering a different economic minimum MW level, different minimum run times, or different start up and notification times in the cost-based and price-based offers can also be used to evade mitigation. For example, a unit may have a price-based offer with a positive markup, but have a shorter minimum run time (MRT) in the price-based offer resulting in a lower dispatch cost for the price-based offer but setting prices at a level that includes a positive markup. Table 3-105 shows the number and percent of unit schedule hours when units offered lower minimum run times in price-based offers than in cost-based offers while having a positive markup in the price-based offer.


**Table 3-105 Units offered with lower minimum run time on price compared to cost and with positive markup: 2024**

	Day-Ahead			Real-Time		
	Number of Schedule Hours with Lower Min Run Time in Price Compared to Cost	Total Number of Cost Schedule Hours Offered by Price Based Units	Percent of Schedule Hours with Lower Min Run Time in Price Compared to Cost	Number of Schedule Hours with Lower Min Run Time in Price Compared to Cost	Total Number of Cost Schedule Hours Offered by Price Based Units	Percent of Schedule Hours with Lower Min Run Time in Price Compared to Cost
2024						
Jan	4,051	839,400	0.5%	3,649	775,515	0.5%
Feb	5,095	792,552	0.6%	4,470	736,063	0.6%
Mar	3,795	844,500	0.4%	3,035	725,824	0.4%
Apr	3,585	826,728	0.4%	2,730	677,110	0.4%
May	3,852	869,976	0.4%	3,114	736,427	0.4%
Jun	2,664	839,472	0.3%	1,657	786,417	0.2%
Jul	2,688	870,960	0.3%	1,749	821,874	0.2%
Aug	2,808	869,808	0.3%	1,777	823,331	0.2%
Sep	2,664	847,152	0.3%	1,440	763,796	0.2%
Oct	3,384	887,760	0.4%	2,020	693,099	0.3%
Nov	3,716	864,613	0.4%	2,462	710,932	0.3%
Dec	2,921	899,256	0.3%	2,073	812,552	0.3%
Total	41,223	10,252,177	0.4%	30,176	9,062,940	0.3%

A unit may offer a lower economic minimum MW level on the price-based offer than the cost-based offer. Such a unit may appear to be cheaper to commit on the price-based offer even with a positive markup. A unit with a positive markup can have lower dispatch cost with the price-based offer with a lower economic minimum level compared to the cost-based offer. Figure 3-59 shows an example of offers from a unit that has a positive markup and a price-based offer with a lower economic minimum MW than the cost-based offer. Keeping the startup cost, Minimum Run Time and no load cost constant between the price-based offer and cost-based offer, the dispatch cost for this unit is lower on the price-based offer than on the cost-based offer solely as a result of the lower economic minimum

MW. However, the price-based offer includes a positive markup and could result in setting the market price at a noncompetitive level even after the resource owner fails the TPS test.

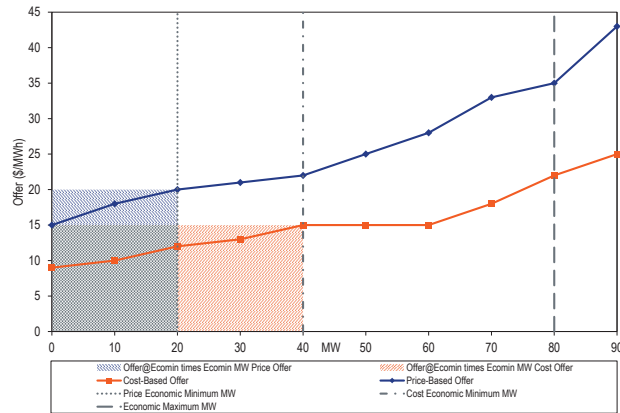
**Figure 3-59 Offers with a positive markup but different economic minimum MW**



The behavior in which units offered lower economic minimum MW in price-based offers than in cost-based offers while having a positive markup in the price-based offer is limited to a number of units that does not permit data to be provided under the PJM confidentiality rules in both the day-ahead and real-time energy markets.

In the case of dual fuel units, if the price-based offer uses a cheaper fuel and the cost-based offer uses a more expensive fuel, the price-based offer will appear to be cheaper even when it includes a markup. Figure 3-60 shows an example of offers by a dual fuel unit, where the active cost-based offer uses a more expensive fuel and the price-based offer uses a cheaper fuel and includes a markup. Table 3-106 shows the number and percent of dual fuel unit hours where the price-based offer does not have a comparable cost-based offer with a matching fuel, and the cost-based offer exceeds the price-based offer. The analysis includes only those units that offered multiple offers (cost or price) with different fuels in 2024.

**Figure 3-60 Dual fuel unit offers**

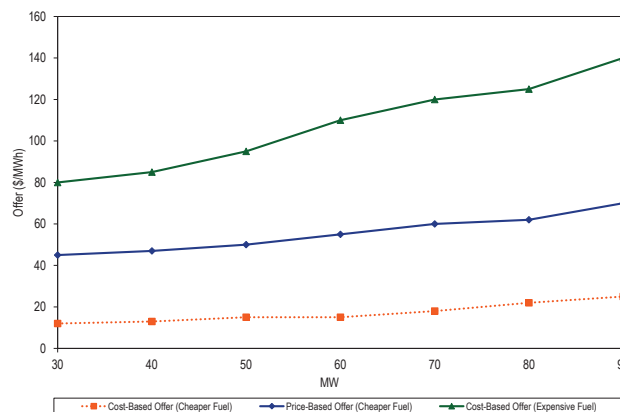

**Table 3-106 Dual fuel unit offers with cost-based offers exceeding price-based offers (negative markup) but different fuel: 2024**

	Day-Ahead			Real-Time		
	Number of Unit Hours With Negative Markup And No Matching Fuel	Total Number of Unit Hours By Units With Multiple Fuels	Percent Unit Hours With Negative Markup And No Matching Fuel on Cost	Number of Unit Hours With Negative Markup And No Matching Fuel on Cost	Total Number of Unit Hours By Units With Multiple Fuels	Percent Unit Hours With Negative Markup And No Matching Fuel on Cost
2024						
Jan	9,601	184,152	5.2%	9,601	181,606	5.3%
Feb	7,583	172,968	4.4%	7,583	168,544	4.5%
Mar	8,682	184,331	4.7%	8,682	156,824	5.5%
Apr	16,313	183,000	8.9%	16,313	157,157	10.4%
May	15,955	204,792	7.8%	15,955	184,139	8.7%
Jun	14,085	201,744	7.0%	14,085	198,272	7.1%
Jul	13,581	211,224	6.4%	13,581	206,114	6.6%
Aug	13,761	209,064	6.6%	13,761	201,932	6.8%
Sep	15,311	198,432	7.7%	15,311	187,967	8.1%
Oct	13,856	204,552	6.8%	13,856	158,729	8.7%
Nov	11,825	201,191	5.9%	11,825	163,310	7.2%
Dec	7,706	212,568	3.6%	7,706	202,760	3.8%
Total	148,259	2,368,018	6.3%	148,259	2,167,354	6.8%

These issues can be solved by simple rule changes.<sup>166</sup> The MMU recommends, in order to ensure effective market power mitigation when the TPS test is failed, that markup be consistently positive or negative across the full MWh range of price and cost-based offers. This means that the cost-based and price-based offer curves never cross.<sup>167</sup>

PJM filed and, on October 25, 2024, FERC accepted a revised proposal that would require that sellers that fail the TPS test will be offer capped at their cost-based offers and that operating parameters will be mitigated. However, PJM has no plans to implement the improved rules, so the flawed rules remain in place. PJM's proposal also uses the flawed formula rejected by FERC to select among cost-based offers. This will result in the illogical selection of cost-based offers in some circumstances, particularly if a dual fuel unit submits offers for both oil and gas on a day when the economics change between the two fuels midday. PJM should modify its implementation to address that issue. The result would allow market sellers to select the correct cost-based fuel schedule. There is no reason to delay implementation until PJM addresses combined cycle modelling. The changes would decrease the solution time for the day-ahead market and enhance market efficiency. The new approach should be implemented as soon as possible to help ensure effective market power mitigation.

The issues with offer capping will continue to allow the exercise of market power to affect prices until PJM implements the new approach. Currently, there is no implementation date. The simplified schedule selection process would shorten the time required to reach the day-ahead market solution, which is a market efficiency gain regardless of whether PJM implements combined cycle modelling. The MMU recommends that PJM commit all resources that fail the TPS test on their cost-based offers and that PJM implement that solution as soon as possible.<sup>168</sup>

Levels of offer capping have historically been low in PJM, as shown in Table 3-108. But offer capping remains a critical element of PJM market rules because it is designed to prevent the exercise of local market power. While overall offer capping levels have been low, there are a significant number of units with persistent structural local market power that would have a significant impact on prices in the absence of local market power mitigation. Until November 1, 2017, only uncommitted resources, started to relieve a transmission constraint, were subject to offer capping. Beginning November 1, 2017, under certain circumstances, online resources that are committed beyond their original commitment (day-ahead or real-time) can be offer capped if the owner fails the TPS test, and the latest available cost-based offer is determined to be lower than the price-based offer.<sup>169</sup> Units running in real time as part of their original commitment on the price-based

<sup>166</sup> The MMU proposed these offer rule changes as part of a broader reform to address generator offer flexibility and associated impact on market power mitigation rules in the Generator Offer Flexibility Senior Task Force (GOFSTF) and subsequently in the MMU's protest in the hourly offers proceeding in Docket No. ER16-372-000, filed December 14, 2015.

<sup>167</sup> See related recommendations about mitigation of operating parameters and financial offer parameters.

<sup>168</sup> See "Schedule Selection: IMM Package," MMU Presentation to the Market Implementation Committee (September 6, 2023), <[https://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_MIC\\_Schedule\\_Selection\\_IMM\\_Package\\_20230906.pdf](https://www.monitoringanalytics.com/reports/Presentations/2023/IMM_MIC_Schedule_Selection_IMM_Package_20230906.pdf)>.

<sup>169</sup> See OA Schedule 1 § 6.4.1.

offer on economics, and that can provide incremental relief to a constraint, cannot be switched to their cost-based offer.

The offer capping percentages shown in Table 3-107 include units that are committed to provide constraint relief whose owners failed the TPS test in the energy market, but excluding units that were committed for reliability reasons, providing black start or providing reactive support. Offer capped unit run hours and offer capped generation (in MWh) are shown as a percentage of the total run hours and the total generation (MWh) from all the units in the PJM energy market.<sup>170</sup> Beginning November 1, 2017, with the introduction of hourly offers, certain online units, whose owners fail the TPS test in the real-time energy market for providing constraint relief, can be offer capped and dispatched on their cost-based offer subsequent to a real-time hourly offer update.

**Table 3-107 Offer capping statistics – energy only: 2018 to 2024**

Year	Real-Time		Day-Ahead	
	Unit Hours Capped	MWh Capped	Unit Hours Capped	MWh Capped
2018	0.9%	0.5%	0.1%	0.1%
2019	1.7%	1.3%	1.3%	0.9%
2020	1.0%	1.1%	1.6%	1.3%
2021	1.6%	1.3%	1.6%	1.0%
2022	1.4%	1.2%	1.2%	1.4%
2023	1.3%	1.0%	1.7%	0.8%
2024	1.5%	1.1%	1.2%	0.9%

Table 3-108 shows the offer capping percentages including both units committed to provide constraint relief and units committed for reliability reasons, black start or reactive support. Reliability reasons include reactive support or local voltage support. PJM creates closed loop interfaces to, in some cases, model reactive constraints. The closed loop interface creates demand for the output of the resource needed to provide reactive power. The resulting higher LMPs in the closed loop interfaces increased economic dispatch, which contributed to the reduction in units offer capped for reactive support over time in Table 3-109. In instances where units are committed and offer capped for the modeled closed loop interface constraints, they are considered offer capped for providing constraint relief, and not for reliability. They are included in the offer

capping percentages in Table 3-107. Prior to closed loop interfaces, these units were considered as committed for reactive support, and were included in the offer capping statistics for reliability in Table 3-109.

**Table 3-108 Offer capping statistics for energy and reliability: 2018 to 2024**

Year	Real-Time		Day-Ahead	
	Unit Hours Capped	MWh Capped	Unit Hours Capped	MWh Capped
2018	1.0%	0.8%	0.2%	0.3%
2019	1.7%	1.3%	1.3%	0.9%
2020	1.0%	1.1%	1.6%	1.3%
2021	1.6%	1.3%	1.6%	1.0%
2022	1.4%	1.3%	1.7%	1.4%
2023	1.4%	1.2%	1.8%	1.0%
2024	1.5%	1.3%	2.1%	1.3%

Table 3-109 shows the offer capping percentages only for units committed for reliability reasons, black start or reactive support. The low offer capping percentages do not mean that units manually committed for reliability reasons do not have market power. All units manually committed for reliability have market power, and all are treated as if they had market power.

**Table 3-109 Offer capping statistics for reliability: 2018 to 2024**

Year	Real-Time		Day-Ahead	
	Unit Hours Capped	MWh Capped	Unit Hours Capped	MWh Capped
2018	0.13%	0.29%	0.10%	0.21%
2019	0.01%	0.02%	0.00%	0.01%
2020	0.00%	0.01%	0.00%	0.00%
2021	0.03%	0.04%	0.02%	0.03%
2022	0.05%	0.09%	0.04%	0.05%
2023	0.14%	0.23%	0.13%	0.23%
2024	0.08%	0.15%	0.21%	0.37%

Table 3-110 presents data on the frequency with which units were offer capped in 2023 and 2024 as a result of failing the TPS test to provide energy for constraint relief in the real-time energy market, or for reliability reasons. Table 3-110 shows that six units were offer capped for 90 percent or more of their run hours in 2024, compared to four units with 90 percent or more offer capped run hours in 2023.

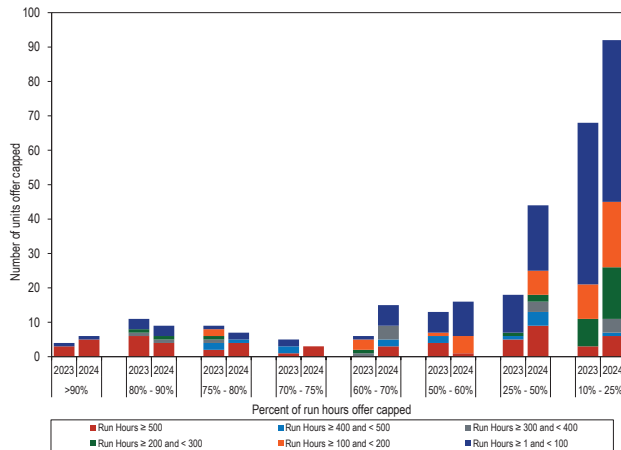
<sup>170</sup> Prior to the 2018 Quarterly State of the Market Report for PJM: January through June, these tables presented the offer cap percentages based on total bid unit hours and total load MWh. Beginning with the quarterly report for January through June, 2018, the statistics have been updated with percentages based on run hours and total generation MWh from units modeled in the energy market.



**Table 3-110 Real-time offer capped unit statistics: 2023 and 2024**

Run Hours Offer-Capped, Percent Greater Than Or Equal To:		Offer-Capped Hours					
		Hours ≥ 500	Hours ≥ 400 and < 500	Hours ≥ 300 and < 400	Hours ≥ 200 and < 300	Hours ≥ 100 and < 200	Hours ≥ 1 and < 100
90%	2023	3	0	0	0	0	1
	2024	5	0	0	0	0	1
80% and < 90%	2023	6	0	1	1	0	3
	2024	4	0	1	1	0	3
75% and < 80%	2023	2	2	1	1	2	1
	2024	4	1	0	0	0	2
70% and < 75%	2023	1	2	0	0	0	2
	2024	3	0	0	0	0	0
60% and < 70%	2023	0	0	1	1	3	1
	2024	3	2	4	0	0	6
50% and < 60%	2023	4	2	0	0	1	6
	2024	1	0	0	0	5	10
25% and < 50%	2023	5	1	0	1	0	11
	2024	9	4	3	2	7	19
10% and < 25%	2023	3	0	0	8	10	47
	2024	6	1	4	15	19	47

Figure 3-61 shows the frequency with which units were offer capped in 2023 and 2024 for failing the TPS test to provide energy for constraint relief in the real-time energy market or for reliability reasons.

**Figure 3-61 Real-time offer capped unit statistics: 2023 and 2024**

In response to FERC's request for Common Metrics for 2019 through 2022, which were published in FERC's 2023 Common Metrics Staff report, PJM filed a report stating that between 2019 and 2022 the percent of unit hours in the day-ahead energy market with active market power mitigation was between 78.8 and 100 percent, while the actual results were between 1.4 and 1.6 percent.<sup>171 172</sup>

<sup>171</sup> See Common Performance Metrics, Docket No. AD19-16-000, PJM Compliance Filing, PJM Metrics Spreadsheet 2023 (April 17, 2023).

<sup>172</sup> See 2023 Common Metrics: Performance Metrics for ISOs, RTOs, and Regions Outside ISOs and RTOs for the Reporting Period 2019 to 2022, FERC Staff Report (January 31, 2024), <[https://elibrary.ferc.gov/elibrary/filelist?accession\\_num=20240131-4000](https://elibrary.ferc.gov/elibrary/filelist?accession_num=20240131-4000)>.

PJM also reported that between 2019 and 2022, the percent of unit intervals in the real-time energy market with active market power mitigation was between 43.3 and 53.3 percent, while the actual results were between 1.0 and 1.7 percent. PJM's reported results were incorrect because PJM provided hours of mitigation instead of unit hours or unit intervals mitigated. In the day-ahead market, a mitigated unit hour is one unit mitigated for one hour. The denominator is all cleared units cleared for all hours. In the real-time market, a mitigated unit interval is one unit mitigated for one interval. The denominator is all cleared units for all intervals. For example, if there were 10 units running in a given hour in the day-ahead market, if one unit was mitigated for that hour, then the percent of unit hours mitigated would be 10 percent, but PJM defined the percent mitigated as 100 percent of the hour. The PJM filed report dramatically overstated the frequency of market power mitigation in the PJM energy market. The MMU has correctly reported this metric in the State of the Market Reports for 2002 and subsequent years. The MMU also reports the MWh subject to market power mitigation, which reflects the relative size of the units subject to market power mitigation.

## Markup Index

Markup is a summary measure of the degree to which a participant's offer behavior or conduct for individual units is competitive. When a seller makes a competitive offer, markup is zero. When a seller exercises market power in its offer, markup is positive. The degree of markup increases with the degree of market power. The markup index for each marginal unit is calculated as  $(\text{Price} - \text{Cost})/\text{Price}$ .<sup>173</sup> The markup index is normalized and can vary from -1.00 when the offer price is less than the cost-based offer price, to 1.00 when the offer price is higher than the cost-based offer price. The markup index does not measure the impact of unit markup on total LMP. The dollar markup for a unit is the difference between price and cost.

<sup>173</sup> In order to normalize the index results (i.e., bound the results between +1.00 and -1.00) for comparison across both low and high cost units, the index is calculated as  $(\text{Price} - \text{Cost})/\text{Price}$  when price is greater than cost, and  $(\text{Price} - \text{Cost})/\text{Cost}$  when price is less than cost.

### Real-Time Markup Index

Table 3-111 shows the average markup index of marginal units in the real-time energy market, by offer price category using unadjusted cost-based offers.

Table 3-112 shows the average markup index of marginal units in the real-time energy market, by offer price category using adjusted cost-based offers. The unadjusted markup is the difference between the price-based offer and the cost-based offer including the 10 percent adder in the cost-based offer at the dispatch point on the offer curves. The adjusted markup is the difference between the price-based offer and the cost-based offer excluding the 10 percent adder from the cost-based offer. The adjusted markup is calculated for coal, gas and oil units because these units have consistently had price-based offers less than cost-based offers.<sup>174</sup> The markup is negative if the cost-based offer of the marginal unit is greater than its price-based offer at its operating point.

All generating units are allowed to add an additional 10 percent to their cost-based offer. The 10 percent adder was included prior to the implementation of PJM markets in 1999, based on the uncertainty of calculating the hourly operating costs of CTs under changing ambient conditions. The owners of coal units, facing competition, typically exclude the additional 10 percent from their actual offers. The owners of many gas fired and oil fired units have also begun to exclude the 10 percent adder. The introduction of hourly offers and intraday offer updates in November 2017 allows gas and oil generators to directly incorporate the impact of ambient temperature changes in fuel consumption in offers.

PJM implemented Fast Start Pricing on September 1, 2021. For all the fast start marginal units beginning on September 1, 2021, the markup includes markup in the incremental offer, markup in the amortized start up offer, and markup in the amortized no load offer.

Even the adjusted markup overestimates the negative markup because units facing increased competitive pressure have excluded both the 10 percent and components of operating and maintenance costs that are not short run marginal costs. The PJM Market rules permit the 10 percent adder and maintenance costs,

which are not short run marginal costs, under the definition of cost-based offers. Actual market behavior reflects the fact that neither is part of a competitive offer and neither is a short run marginal cost.<sup>175</sup>

In 2024, the average dollar markup of units with offer prices less than \$10 was negative (-\$1.67 per MWh) when using unadjusted cost-based offers. The average dollar markup of units with offer prices between \$10 and \$15 was negative (-\$1.90 per MWh) when using unadjusted cost-based offers. Negative markup means the unit is offering to run at a price less than its cost-based offer, revealing a short run marginal cost that is less than the maximum allowable cost-based offer under the PJM Market Rules.

Some marginal units did have substantial markups. Among the units that were marginal in 2024, 1.4 percent had offer prices above \$150 per MWh. Among the units that were marginal in 2023, 1.5 percent had offer prices greater than \$150 per MWh. Using the unadjusted cost-based offers, the highest markup for any marginal unit in 2024 was more than \$900, and the highest markup in 2023 was more than \$400.

**Table 3-111 Real-time average marginal unit markup index (By offer price category unadjusted): 2023 and 2024**

Offer Price Category	2023			2024		
	Average Markup Index	Average Dollar Markup	Frequency	Average Markup Index	Average Dollar Markup	Frequency
< \$10	(0.15)	(\$2.21)	17.3%	(0.14)	(\$1.67)	28.8%
\$10 to \$15	(0.07)	(\$1.38)	15.3%	(0.11)	(\$1.90)	15.7%
\$15 to \$20	(0.05)	(\$1.24)	20.4%	(0.10)	(\$2.71)	16.6%
\$20 to \$25	(0.02)	(\$1.27)	15.9%	(0.06)	(\$2.77)	12.6%
\$25 to \$50	0.02	(\$0.28)	25.9%	0.02	(\$1.48)	20.3%
\$50 to \$75	0.18	\$9.94	2.7%	0.13	\$6.31	3.3%
\$75 to \$100	0.26	\$21.17	0.6%	0.21	\$15.33	0.8%
\$100 to \$125	0.48	\$52.71	0.2%	0.32	\$33.98	0.4%
\$125 to \$150	0.33	\$43.81	0.1%	0.26	\$36.03	0.2%
>= \$150	0.07	\$14.03	1.5%	0.11	\$22.43	1.4%
All Offers	(0.03)	(\$0.35)	100.0%	(0.06)	(\$1.04)	100.0%

<sup>174</sup> The MMU will calculate adjusted markup for gas units also in future reports because gas units also more consistently have price-based offers less than cost-based offers.

<sup>175</sup> See PJM, "Manual 15: Cost Development Guidelines," Rev. 45 (Sep. 1, 2023).

Table 3-113 shows the percentage of marginal units that had markups, calculated using unadjusted cost-based offers, below, above and equal to zero for coal, gas and oil fuel types.<sup>176</sup>

**Table 3-112 Real-time average marginal unit markup index (By offer price category adjusted): 2023 and 2024**

Offer Price Category	2023			2024		
	Average Markup Index	Average Dollar Markup	Frequency	Average Markup Index	Average Dollar Markup	Frequency
< \$10	(0.11)	(\$1.77)	17.3%	(0.11)	(\$1.26)	28.8%
\$10 to \$15	(0.01)	(\$0.35)	15.3%	(0.03)	(\$0.81)	15.7%
\$15 to \$20	0.02	\$0.07	20.4%	(0.03)	(\$1.33)	16.6%
\$20 to \$25	0.04	\$0.32	15.9%	0.00	(\$1.07)	12.6%
\$25 to \$50	0.08	\$2.05	25.9%	0.08	\$0.90	20.3%
\$50 to \$75	0.24	\$13.17	2.7%	0.18	\$9.72	3.3%
\$75 to \$100	0.30	\$24.89	0.6%	0.25	\$19.54	0.8%
\$100 to \$125	0.50	\$55.60	0.2%	0.35	\$37.17	0.4%
\$125 to \$150	0.37	\$48.54	0.1%	0.29	\$39.89	0.2%
>= \$150	0.13	\$32.87	1.5%	0.16	\$36.77	1.4%
All Offers	0.03	\$1.41	100.0%	(0.01)	\$0.54	100.0%

Table 3-114 shows the percentage of marginal units that had markups, calculated using adjusted cost-based offers, below, above and equal to zero for coal, gas and oil fuel types. In 2024, using unadjusted cost-based offers for coal units, 57.7 percent of marginal coal units had negative markups. The share of marginal gas units with negative markups at the dispatch point on their offer curve increased from 51.2 percent in 2023 to 64.2 percent in 2024 when using unadjusted cost based offers.

**Table 3-113 Percent of marginal units with markup below, above and equal to zero (By fuel type with unadjusted offers): 2023 and 2024**

Type/Fuel	2023			2024		
	Negative	Zero	Positive	Negative	Zero	Positive
Coal	49.98%	30.14%	19.89%	57.69%	28.55%	13.77%
Gas	51.26%	14.49%	34.25%	64.20%	15.83%	19.98%
Oil	3.05%	96.83%	0.12%	11.55%	82.31%	6.15%

In 2024, using adjusted cost-based offers for coal units, 48.1 percent of marginal coal units had negative markups.

**Table 3-114 Percent of marginal units with markup below, above and equal to zero (By fuel type with adjusted offers): 2023 and 2024**

Type/Fuel	2023			2024		
	Negative	Zero	Positive	Negative	Zero	Positive
Coal	36.99%	6.54%	56.46%	48.11%	8.03%	43.87%
Gas	36.46%	9.56%	53.98%	43.83%	9.23%	46.94%
Oil	1.92%	96.83%	1.24%	10.90%	81.56%	7.54%

<sup>176</sup> Other fuel types were excluded based on data confidentiality rules.

Figure 3-62 shows the frequency distribution of hourly markups for all gas units offered in 2023 and 2024 using unadjusted cost-based offers. The highest markup within the economic operating range of the unit's offer curve was used in the frequency distributions.<sup>177</sup> Of the gas units offered in the PJM market in 2024, 20.9 percent of gas unit hours had a maximum markup that was negative and 21.2 percent of gas fired unit hours had a maximum markup above \$100 per MWh. The share of offered gas units with maximum markup that was negative decreased in 2024 compared to 2023, while the share of marginal gas units with negative markups at the dispatch point increased.

**Figure 3-62 Frequency distribution of highest markup of gas units offered using unadjusted cost offers: 2023 and 2024**

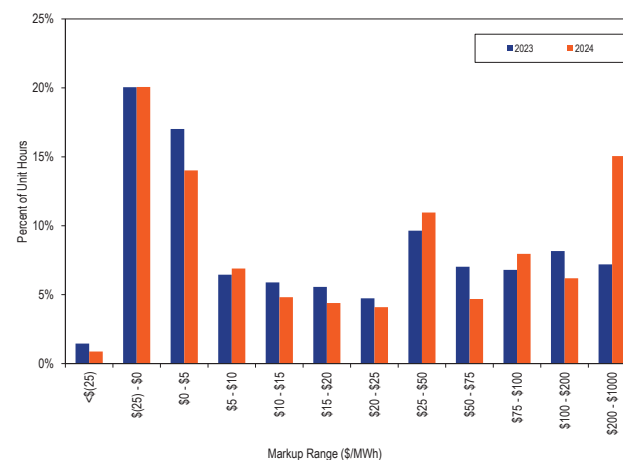


Figure 3-63 shows the frequency distribution of hourly markups for all coal units offered in 2023 and 2024 using unadjusted cost-based offers. Of the coal units offered in the PJM market in 2023, 33.1 percent of coal unit hours had a maximum markup that was negative or equal to zero, decreasing from 35.3 percent in 2023. The share of offered coal units with maximum markup that was negative decreased in 2024, while the share of marginal coal units with negative markups at the dispatch point increased in 2024 compared to 2023.

<sup>177</sup> The categories in the frequency distribution were chosen so as to maintain data confidentiality.

**Figure 3-63 Frequency distribution of highest markup of coal units offered using unadjusted cost offers: 2023 and 2024**


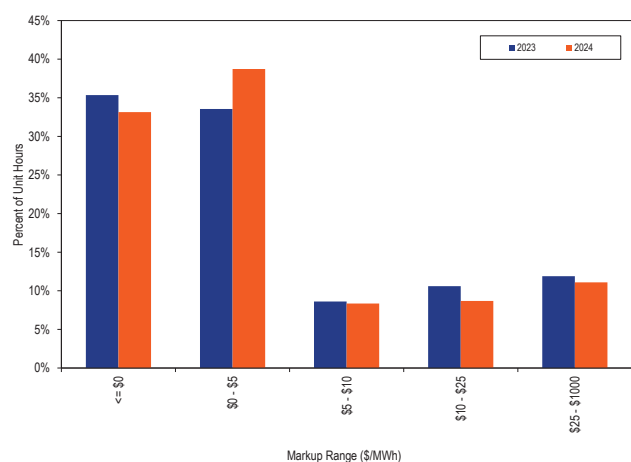


Figure 3-64 shows the frequency distribution of hourly markups for all offered oil units in 2023 and 2024 using unadjusted cost-based offers. Of the oil units offered in the PJM market in 2024, 38.5 percent of oil unit hours had a maximum markup that was negative or equal to zero. More than 3.6 percent of oil fired unit hours had a maximum markup above \$100 per MWh.

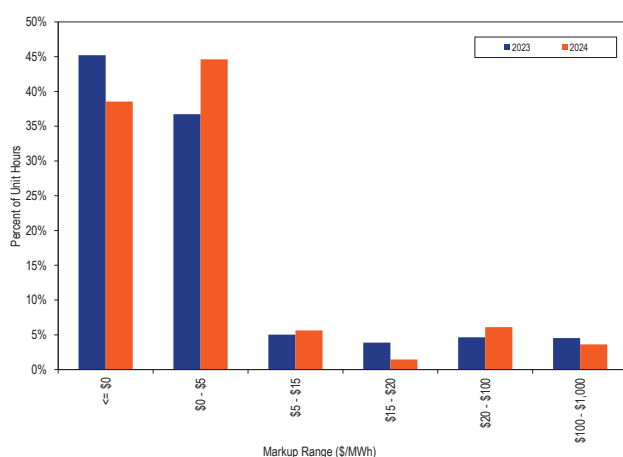**Figure 3-64 Frequency distribution of highest markup of oil units offered using unadjusted cost offers: 2023 and 2024**




The markup frequency distributions show that a significant proportion of units make price-based offers less than the cost-based offers permitted under the PJM market rules. This behavior means that competitive price-based offers reveal actual unit marginal costs and

that PJM market rules permit the inclusion of costs in cost-based offers that are not short run marginal costs.

The markup behavior shown in the markup frequency distributions also shows that a substantial number of units were offered with high markups, consistent with the exercise of market power.

Figure 3-65 shows the number of marginal unit intervals in 2024 and 2023 with markup above \$150 per MWh.

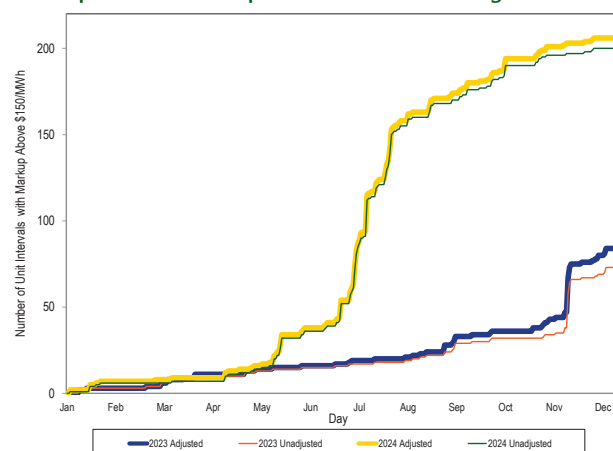**Figure 3-65 Cumulative number of unit intervals with markups above \$150 per MWh: 2023 through 2024**



## Day-Ahead Markup Index

Table 3-115 shows the average markup index of marginal generating units in the day-ahead energy market, by offer price category using unadjusted cost-based offers.

The majority of marginal units in the day-ahead market are virtual transactions, which do not have markup. The average dollar markups of units with offer prices less than \$10 was \$9.52 per MWh when using unadjusted cost-based offers in 2024.

Some marginal units did have substantial markups. Using the unadjusted cost-based offers, the highest markup for any marginal unit in the day-ahead market in 2024 was more than \$200 per MWh and the highest markup in 2023 was more than \$250 per MWh.

**Table 3-115 Average day-ahead marginal unit markup index (By offer price category, unadjusted): 2023 and 2024**

Offer Price Category	2023			2024		
	Average Markup Index	Average Dollar Markup	Frequency	Average Markup Index	Average Dollar Markup	Frequency
< \$10	0.08	(\$0.84)	16.6%	(0.53)	\$9.52	20.0%
\$10 to \$15	0.09	\$0.82	16.9%	0.43	\$4.80	20.9%
\$15 to \$20	0.17	\$2.72	31.1%	0.13	\$1.72	31.8%
\$20 to \$25	0.11	\$1.26	39.9%	0.08	\$1.49	36.2%
\$25 to \$50	0.06	\$1.47	73.6%	0.10	\$3.08	71.2%
\$50 to \$75	0.08	\$3.31	42.8%	0.09	\$4.17	44.8%
\$75 to \$100	0.06	\$5.71	8.3%	0.08	\$3.42	15.8%
\$100 to \$125	0.18	\$19.29	3.3%	0.13	\$14.40	7.7%
\$125 to \$150	0.00	\$0.00	1.2%	0.14	\$17.62	3.2%
>= \$150	0.04	\$9.62	6.9%	0.03	\$6.75	7.0%
All Offers	0.09	\$1.70	100.0%	0.08	\$3.83	100.0%

Table 3-116 shows the average markup index of marginal generating units in the day-ahead energy market, by offer price category using adjusted cost-based offers.

In 2024, 71.2 percent of day-ahead marginal generation units had offers between \$25 and \$50 per MWh. For units that have an offer price less than \$10, the average markup index decreased from 0.17 in 2023 to -0.52 in 2024.

**Table 3-116 Average day-ahead marginal unit markup index (By offer price category, adjusted): 2023 and 2024**

Offer Price Category	2023			2024		
	Average Markup Index	Average Dollar Markup	Frequency	Average Markup Index	Average Dollar Markup	Frequency
< \$10	0.17	(\$0.84)	16.6%	(0.52)	\$9.52	20.0%
\$10 to \$15	0.15	\$0.82	16.9%	0.50	\$4.80	20.9%
\$15 to \$20	0.22	\$2.72	31.1%	0.19	\$1.72	31.8%
\$20 to \$25	0.16	\$1.26	39.9%	0.14	\$1.49	36.2%
\$25 to \$50	0.12	\$1.47	73.6%	0.16	\$3.08	71.2%
\$50 to \$75	0.13	\$3.31	42.8%	0.15	\$4.17	44.8%
\$75 to \$100	0.12	\$5.71	8.3%	0.12	\$3.42	15.8%
\$100 to \$125	0.27	\$19.29	3.3%	0.18	\$14.40	7.7%
\$125 to \$150	0.04	\$0.00	1.2%	0.21	\$17.62	3.2%
>= \$150	0.11	\$9.62	6.9%	0.12	\$6.75	7.0%
All Offers	0.15	\$1.70	100.0%	0.13	\$3.83	100.0%

## No Load and Start Cost Markup

Generator energy offers in PJM are comprised of three parts, an incremental energy offer curve, no load cost and start cost. In cost-based offers, all three parts are capped at the level allowed by Schedule 2 of the Operating Agreement, the Cost Development Guidelines (Manual 15) and fuel cost policies approved by PJM. In price-based offers, the incremental energy offer curve is capped at \$1,000 per MWh (unless the verified cost-based offer exceeds \$1,000 per MWh, but cannot exceed \$2,000 per MWh). Generators are allowed to choose whether to use price-based or cost-based no load cost and start costs twice a year. If price-based is selected, the no load and start costs do not have a cap, but the offers cannot be changed for six months (April through September and October through March). If cost-based is selected, the cap is the same as the cap of the no load and start costs in the cost-based offers, and the offers can be updated daily or hourly based on changes in costs. Table 3-117 shows the caps on the three parts of cost-based and price-based offers.

**Table 3-117 Cost-based and price-based offer caps**

Offer Type	No Load and Start			
	Cost Option	Incremental Offer Curve Cap	No Load Cost Cap	Start Cost Cap
Cost-Based	Cost-Based	Based on OA Schedule 2, Cost Development Guidelines (Manual 15) and Fuel Cost Policies	Based on OA Schedule 2, Cost Development Guidelines (Manual 15) and Fuel Cost Policies	Based on OA Schedule 2, Cost Development Guidelines (Manual 15) and Fuel Cost Policies
Price-Based	Cost-Based	\$1,000/MWh or based on OA Schedule 2, Cost Development Guidelines (Manual 15) and Fuel Cost Policies if verified cost-based offer exceeds \$1,000/MWh but no more than \$2,000/MWh.	Based on OA Schedule 2, Cost Development Guidelines (Manual 15) and Fuel Cost Policies	Based on OA Schedule 2, Cost Development Guidelines (Manual 15) and Fuel Cost Policies
	Price-Based		No cap but can only be changed twice a year.	No cap but can only be changed twice a year.



Table 3-118 shows the number of units that chose the cost-based option and the price-based option. In 2024, 90 percent of all generators that submitted no load or start costs chose to have cost-based no load and start costs in their price-based offers, two percentage points higher than in 2023.

**Table 3-118 Number of units selecting cost-based and price-based no load and start costs: 2023 and 2024**

No Load and Start Cost Option	2023		2024	
	Number of units	Percent	Number of units	Percent
Cost-Based	472	88%	466	90%
Price-Based	62	12%	51	10%
Total	534	100%	517	100%

Generators can have positive or negative markups in their no load and start costs under the price-based option. Generators cannot have positive markups in no load and start costs when they select the cost-based option. Table 3-119 shows the average markup in the no load and start costs in 2023 and 2024. Generators that selected the cost-based start and no load option offered on average with a negative markup on the no load cost and a negative markup on the start costs. The price-based offers were lower than the cost-based offers. In 2024, generators that selected the price-based start and no load option offered on average with a positive markup on the no load cost and with very large positive markups on the start costs.

**Table 3-119 No load and start cost markup: 2023 and 2024**

Period	No Load and Start Cost Option	No Load Cost	Cold Start Cost	Intermediate Start Cost	Hot Start Cost
2023	Cost-Based	(8%)	(6%)	(6%)	(7%)
	Price-Based	10%	197%	183%	186%
2024	Cost-Based	(14%)	(5%)	(6%)	(7%)
	Price-Based	25%	140%	125%	125%

## Energy Market Cost-Based Offers

The application of market power mitigation rules in the day-ahead energy market and the real-time energy market helps ensure competitive market outcomes even in the presence of structural market power.

Cost-based offers in PJM affect all aspects of the PJM energy market. Cost-based offers affect prices when units are committed and dispatched on their cost-based offers. In 2024, 7.8 percent of the marginal units set

prices based on cost-based offers, 1.7 percentage points higher than in 2023.

The efficacy of market power mitigation rules depends on the definition of a competitive offer. A competitive offer is equal to short run marginal costs. The enforcement of market power mitigation rules is undermined if the definition of a competitive offer is not correct. The significance of competition metrics like markup is also undermined if the definition of a competitive offer is not correct. The definition of a competitive offer in the PJM market rules is not correct. Some unit owners include costs that are not short run marginal costs in offers, including maintenance costs. The market rules allow these overstated cost-based offers. This issue can be resolved by simple changes to the PJM market rules to incorporate a clear and accurate definition of short run marginal costs.

The efficacy of market power mitigation rules also depends on the accuracy of cost-based offers. Some unit owners use fuel cost policies that are not algorithmic, verifiable, and systematic. These inadequate fuel cost policies permit overstated fuel costs in cost-based offers.

When market power mitigation is not effective due to inaccurate cost-based offers that exceed short run marginal costs, market power causes increases in market prices above the competitive level.

## Short Run Marginal Costs

Short run marginal costs are the only costs relevant to competitive offers in the energy market. Specifically, the competitive energy offer level is the short run marginal cost of production. The current PJM market rules distinguish costs includable in cost-based energy offers from costs includable in cost-based capacity market offers based on whether costs are “directly related to energy production.” The rules do not provide a clear standard. Energy production is the sole purpose of a power plant. Therefore, all costs, including the sunk costs, are directly related to energy production. This current ambiguous criterion is incorrect and allows for multiple interpretations, which could lead to tariff violations. The incorrect rules lead to higher energy market prices and higher uplift.

There are three types of costs identified in PJM rules as of April 15, 2019: variable costs, avoidable costs, and fixed costs. The criterion for whether a generator may

include a cost in an energy market cost-based offer, a variable cost, is that the cost is “directly related to electric production.”<sup>178</sup>

Variable costs, as defined in the PJM rules, are comprised of short run marginal costs and avoidable costs that are directly related to electric production. Short run marginal costs are the cost of inputs consumed or converted to produce energy, and the costs associated with byproducts that result from consuming or converting materials to produce energy, net of any revenues from the sale of those byproducts. The categories of short run marginal costs are fuel costs, emission allowance costs, operating costs, and energy market opportunity costs.<sup>179</sup>

Avoidable costs are annual costs that would be avoided if energy were not produced over an annual period. The PJM rules divide avoidable costs into those that are directly related to electric production and those not directly related to electric production. The distinction is ambiguous at best. PJM includes overhaul and maintenance costs, replacement of obsolete equipment, and overtime staffing costs in costs related to electric production. PJM includes taxes, preventative maintenance to auxiliary equipment, improvement of working equipment, maintenance expenses triggered by a time milestone (e.g. annual, weekly) and pipeline reservation charges in costs not related to electric production.

Fixed costs are costs associated with an investment in a facility including the return on and of capital.

The MMU recommends that PJM require that the level of costs includable in cost-based offers in the energy market not exceed the unit’s short run marginal cost.

## Fuel Cost Policies

Fuel cost policies (FCP) document the process by which market sellers calculate the fuel cost component of their cost-based offers. Short run marginal fuel costs include commodity costs, transportation costs, fees, and taxes for the purchase of fuel.

## Fuel Cost Policy Review

Table 3-120 shows the status of all fuel cost policies (FCP). As of December 31, 2024, 696 units (90 percent) had an FCP passed by the MMU and 73 units (10 percent) had an FCP failed by the MMU. The units with fuel cost

policies failed by the MMU represented 18,891 MW. All units’ FCPs were approved by PJM. As of December 31, 2024, 607 units did not have FCPs. Units without FCPs cannot submit nonzero cost based offers, unless they use the temporary cost method.<sup>180</sup>

**Table 3-120 FCP Status for PJM generating units: December 31, 2024**

PJM Status	MMU Status			Total
	Pass	Submitted	Fail	
Submitted	0	0	0	0
Under Review	0	0	0	0
Customer Input Required	0	0	0	0
Approved	696	0	73	769
Total	696	0	73	769

The MMU performed a detailed review of every FCP. PJM approved the FCPs that the MMU passed. PJM approved every FCP failed by the MMU.

The standards for the MMU’s market power evaluation are that FCPs be algorithmic, verifiable and systematic, accurately reflecting the short run marginal cost of producing energy. In its filings with FERC, PJM agreed with the MMU that FCPs should be verifiable and systematic.<sup>181</sup> Verifiable means that the FCP requires a market seller to provide a fuel price that can be calculated by the MMU after the fact with the same data available to the market seller at the time the decision was made, and documentation for that data from a public or a private source. Systematic means that the FCP must document a clearly defined quantitative method or methods for calculating fuel costs, including objective triggers for each method.<sup>182</sup> PJM and FERC did not agree that fuel cost policies should be algorithmic, although PJM’s standard effectively requires algorithmic fuel cost policies by describing the requirements.<sup>183</sup> Algorithmic means that the FCP must use a set of defined, logical steps, analogous to a recipe, to calculate the fuel costs. These steps may be as simple as a single number from a contract, a simple average of broker quotes, a simple average of bilateral offers, or the weighted average index price posted on the Intercontinental Exchange trading platform (‘ICE’).<sup>184</sup>

<sup>178</sup> See 167 FERC ¶ 61,030 (2019).

<sup>179</sup> See OA Schedule 2 § 1.1(a).

<sup>180</sup> See OA Schedule 2 § 2.1.

<sup>181</sup> Answer of PJM Interconnection, LLC, to Protests and Comments, Docket No. ER16-372-002 (October 7, 2016) at P 11 (“October 7<sup>th</sup> Filing”).

<sup>182</sup> Protest of the Independent Market Monitor for PJM, Docket No. ER16-372-002 (September 16, 2016) at P 8 (“September 16<sup>th</sup> Filing”).

<sup>183</sup> October 7<sup>th</sup> Filing at P12; 158 FERC ¶ 61,133 at P 57 (2017).

<sup>184</sup> September 16<sup>th</sup> Filing at P 8.

FCPs are not verifiable and systematic if they are not algorithmic. The natural gas FCPs failed by the MMU and approved by PJM are not verifiable and systematic.

Not all FCPs approved by PJM met the standard of the PJM tariff. The tariff standards that some fuel cost policies did not meet are: accuracy (reflect applicable costs accurately); and fuel contracts (reflect the market seller's applicable commodity and/or transportation contracts where it holds such contracts).<sup>185</sup>

The MMU failed FCPs not related to natural gas submitted by some market sellers because they do not accurately describe the short run marginal cost of fuel. Some policies include contractual terms (in dollars per MWh or in dollars per MMBtu) that do not reflect the actual cost of fuel. The MMU determined that the terms used in these policies do not reflect the cost of fuel based on the information provided by the market sellers and information gathered by the MMU for similar units.

The MMU failed the remaining FCPs because they do not accurately reflect the cost of natural gas. The main issues identified by the MMU in the natural gas policies were the use of available market information that results in inaccurate and overstated expected costs. Overstated costs permit the exercise of market power.

Some of the failed fuel cost policies include the use of available market information that results in inaccurate expected costs because the information does not represent a cleared market price. Some market sellers include the use of offers to sell natural gas on ICE as the sole basis for the cost of natural gas. An offer to sell is not a market clearing price and is not an accurate indication of the expected fuel cost. The price of uncleared offers on the exchange generally exceeds the price of cleared transactions, often by a wide margin. Use of sell offers alone is equivalent to using the supply curve alone to determine the market price of a good without considering the demand curve. It is clearly incorrect.

The FCPs that failed the MMU's evaluation also fail to meet the standards defined in the PJM tariff. PJM should not have approved noncompliant fuel cost policies. The MMU recommends that PJM require that all fuel cost policies be algorithmic, verifiable, and systematic.

<sup>185</sup> See PJM Operating Agreement Schedule 2 § 2.3 (a).

Units are required to have an approved fuel cost policy before they can submit nonzero cost-based offers or request from PJM the use of a temporary cost method. The temporary cost offer method allows units to submit nonzero cost-based offers without an approved fuel cost policy if they follow the temporary cost offer method. The use of the method results in cost-based offers that do not follow the fuel cost policy rules. The approach significantly weakens market power mitigation by allowing market sellers to make offers without an approved fuel cost policy, allowing the use of an inaccurate and unsupported fuel cost calculation in place of an accurate fuel cost policy.

The MMU recommends that the temporary cost method be removed and that all units that submit nonzero cost-based offers be required to have an approved fuel cost policy.

### Cost-Based Offer Penalties

Market sellers are assessed penalties when they submit cost-based offers that do not comply with Schedule 2 of the PJM Operating Agreement and PJM Manual 15.<sup>186</sup> Penalties are assessed when both PJM and the MMU are in agreement.

In 2024, of the 77 penalty cases, 70 have been assessed cost-based offer penalties and seven remain pending. These cases were for 67 units owned by 21 different companies. Table 3-121 shows the penalties by the year in which participants were notified.

**Table 3-121 Cost-based offer penalty cases by year notified: May 2017 through December 2024**

Year notified	Assessed Cases	Self Identified	MMU and PJM Disagreement	Pending cases	Number of units impacted	Number of companies impacted
2017	57	56	0	1	0	55
2018	187	161	0	26	0	138
2019	57	57	0	0	0	57
2020	142	137	24	5	0	124
2021	129	124	42	5	0	124
2022	116	116	51	0	0	110
2023	65	65	13	0	0	61
2024	77	70	38	0	7	67
Total	830	786	168	37	7	505

Since 2017, of the 830 penalty cases, 786 resulted in assessed cost-based offer penalties, 37 resulted in disagreement between the MMU and PJM, and seven remain pending. A total of 168 were self identified by market sellers. The 786 cases were from 505 units owned

<sup>186</sup> See OA Schedule 2 § 6.

by 77 different companies. The total penalties were \$5.8 million, charged to units that totaled 159,614 available MW. The average penalty was \$1.60 per available MW. This means that a 100 MW unit would have paid a penalty of \$3,846.<sup>187</sup> There is no link between the increased costs to the market that result from a penalized fuel cost policy and the amount of the penalty. The increased costs to the market can exceed the penalty payment and the reverse can also be true. Table 3-122 shows the total cost-based offer penalties since 2017 by year.

**Table 3-122 Cost-based offer penalties by year: May 2017 through December 2024**

Year	Number of units	Number of companies	Penalties	Average Available Capacity Charged (MW)	Average Penalty (\$/MW)
2017	92	21	\$556,826	16,930	\$1.56
2018	127	34	\$1,242,102	25,743	\$2.28
2019	73	23	\$378,245	15,073	\$1.14
2020	140	27	\$407,283	21,908	\$0.85
2021	125	25	\$753,463	24,808	\$1.31
2022	123	21	\$1,613,621	24,385	\$2.76
2023	61	16	\$339,879	10,564	\$1.33
2024	72	21	\$499,897	20,203	\$1.03
Total	813	72	\$5,791,316	159,614	\$1.60

The incorrect cost-based offers resulted from incorrect application of fuel cost policies, lack of approved fuel cost policies, fuel cost policy violations, miscalculation of no load costs, inclusion of prohibited maintenance costs, use of incorrect incremental heat rates, use of incorrect start cost, and use of incorrect emission costs.

Penalties do not apply when PJM determines that an unforeseen event hindered the market seller's ability to submit a compliant cost-based offer. This allows market sellers to not follow their fuel cost policy, submit cost-based offers that are not verifiable or systematic and not face any penalties for doing so.

The MMU recommends that the penalty exemption provision be removed and that all units that submit nonzero cost-based offers be required to follow their approved fuel cost policy.

### Cost Development Guidelines

The Cost Development Guidelines contained in PJM Manual 15 do not clearly or accurately describe the short run marginal cost of generation. The MMU recommends that PJM Manual 15 be replaced or updated with a straightforward description of the components of cost-based offers based on short run marginal costs and

<sup>187</sup> Cost-based offer penalties are assessed by hour. Therefore, a \$1 per available MW penalty results in a total of \$24 for a 1 MW unit if the violation is for the entire day.

the correct calculation of cost-based offers for thermal resources. In 2022, PJM made updates recommended by the MMU to Manual 15 to add straightforward descriptions for some of the most essential cost offer calculations.<sup>188</sup>

### Variable Operating and Maintenance Costs

PJM Manual 15 and the PJM Operating Agreement Schedule 2 include rules related to VOM costs. On October 29, 2018, PJM filed tariff revisions changing the rules related to VOM costs.<sup>189</sup> The changes proposed by PJM attempted but failed to clarify the rules. The proposed rules defined all costs directly related to electricity production as includable in cost-based offers. This also included the long term maintenance costs of combined cycles and combustion turbines, which had been explicitly excluded in PJM Manual 15.

On April 15, 2019, FERC accepted PJM's filing, subject to revisions requested by FERC.<sup>190</sup> On October 28, 2019, FERC issued a final order accepting PJM's compliance filing.<sup>191</sup> Regardless of the changes, the rules remain unclear and are now inconsistent with economic theory and effective market power mitigation and competitive market results.

Maintenance costs are not short run marginal costs. Generators perform maintenance during outages. Generators do not perform maintenance in the short run, while operating the generating unit. Generators do not perform maintenance in real time to increase the output of a unit. Some maintenance costs are correlated with the historic operation of a generator. Correlation between operating hours or starts and maintenance expenditures over a long run, multiyear time frame does not indicate the necessity of any specific maintenance expenditure to produce power in the short run.

A generating unit does not consume a defined amount of maintenance parts and labor in order to start. A generating unit does not consume a defined amount of maintenance parts and labor in order to produce an additional MWh. Maintenance events do not occur in the short run. The company cannot optimize its maintenance costs in the short run.

<sup>188</sup> See PJM Manual 15: Cost Development Guidelines, Revision 45 (Sep. 1, 2024).

<sup>189</sup> See PJM Interconnection Maintenance Adder Revisions to the Amended and Restated Operating Agreement, LLC, Docket No. EL19-8-000.

<sup>190</sup> 167 FERC ¶ 61,030 (2019).

<sup>191</sup> 168 FERC ¶ 61,134 (2019).



PJM allows for the calculation of VOM costs in dollars per MWh, dollars per MMBtu, dollars per run hour, dollars per equivalent operating hour (EOH) and dollars per start. The MMU converted all VOM costs into dollars per MWh using the units' heat rates, the average economic maximum and average minimum run time of the units in 2024.

Table 3-123 shows the average VOM by unit type. The VOM equals the sum of variable operating cost, major maintenance adder and minor maintenance adder as submitted by market participants.

**Table 3-123 Effective VOM costs in dollars per MWh: 2024**

Unit Type	VOM (\$/MWh)
Combined Cycles	\$3.00
Combustion Turbines and RICE	\$22.62
Gas/Oil Steam Turbines	\$12.19
Coal	\$6.01

The level of costs accepted by PJM for inclusion in VOM depends on PJM's interpretation of the maintenance activities or expenses directly related to electricity production and the level of detailed support provided by market sellers to PJM.

PJM's VOM review is not adequate to determine whether all costs included in VOM are compliant. PJM's VOM review focuses only on the expenses submitted for the last year of up to 20 years of data. For example, a market seller can provide data from ten years ago without any supporting documentation as long as the data from the current year has documentation. PJM's review is dependent on the level of detail provided by the market seller. As a result of questions raised by the MMU, PJM now requires more details from market sellers, which has led to the appropriate exclusion of expenses that were previously included.<sup>192</sup>

The flaws in PJM's review process for VOM are compounded by the ambiguity in the criteria used to determine if costs are includable. PJM's definition of allowable costs for cost-based offers, "costs resulting from electric production," is so broad as to be meaningless. Most costs incurred at a generating station result from electric production in one way or another. The generator itself would not exist but for the need for electric production. PJM's broad definition cannot

identify which costs associated with electric production are includable in cost-based offers. The definition is not verifiable or systematic and permits wide discretion by PJM and generators.

On February 17, 2023, PJM filed tariff revisions changing the rules related to VOM costs. The changes included separating maintenance expenses into major and minor maintenance, allowing the use of default adders for minor maintenance and operating costs and eliminating the annual review requirement for units that choose to use default adders. The proposal, that included the tariff changes, also included Manual 15 changes that introduced additional documentation requirements. Regarding maintenance expenses, market participants will be required to provide all supporting documentation for all expenses submitted, regardless of year. Regarding operating expenses, market participants will be required to provide the amount of consumables used during operation and the cost per unit of each consumable. On April 18, 2023, FERC accepted PJM's filing. Table 3-124 shows the default adders for operating cost and minor maintenance.

**Table 3-124 Default operating cost and minor maintenance adder: 2024**

Unit Type	Operating Cost (\$/MWh)	Minor Maintenance Cost (\$/MWh)
Combined Cycle	0.46	1.13
Combustion Turbine	0.86	4.14
Reciprocating Engine	1.87	4.64
Steam Turbine	3.31	1.97

The MMU recommended that market participants be required to document the amount and cost of consumables used when operating in order to verify that the total operating cost is consistent with the total quantity used and the unit characteristics. The revisions to Manual 15 based on the February 17, 2023, filing included this requirement.

The MMU recommends, given that maintenance costs are currently allowed in cost-based offers, that market participants be permitted to include only variable maintenance costs, linked to verifiable operational events and that can be supported by clear and unambiguous documentation of operational data (e.g. run hours, MWh, MMBtu) that support the maintenance cycle of the equipment being serviced/replaced. The revisions to Manual 15 based on the February 17, 2023, filing partially included this requirement. Even though

<sup>192</sup> See "Maintenance Adder & Operating Cost Submission Process," 55-57 PJM presentation to the Tech Change Forum. (April 21, 2020) <<https://pjm.com/-/media/committees-groups/forums/tech-change/2020/20200421-special/20200421-item-01-maintenance-adder-and-operating-cost-submission-process.ashx>>.



Manual 15 requires maintenance expenses to be the result of operating hours, starts or a combination of the two, the expenses are not tied to a maintenance cycle. Therefore, it is not possible to distinguish between maintenance that resulted from operating the resource versus maintenance from normal wear and tear.

The MMU understands that companies have different document retention policies but in order to be allowed to include maintenance costs, such costs must be verified, and they cannot be verified without documentation. Supporting documentation includes internal financial records, maintenance project documents, invoices, and contracts. Market participants should be required to provide the operational data (e.g. run hours, MWh, MMBtu) that supports the maintenance cycle of the equipment being serviced/replaced. For example, if equipment is serviced every 5,000 run hours, the market participant must include at least 5,000 run hours of historical operation in its maintenance cost history.

### FERC System of Accounts

PJM Manual 15 relies on the FERC System of Accounts, which predates markets and does not define costs consistent with market economics. Market sellers should not rely solely on the FERC System of Accounts for the calculation of their variable operating and maintenance costs. The FERC System of Accounts does not differentiate between short run marginal costs and avoidable costs. The FERC System of Accounts does not differentiate between costs directly related to energy production and costs not directly related to energy production. Reliance on the FERC System of Accounts for the calculation of variable operating and maintenance costs is likely to lead to incorrect, overstated costs.

The MMU recommends removal of all references to and reliance on the FERC System of Accounts in PJM Manual 15.

### Cyclic Starting and Peaking Factors

The use of cyclic starting and peaking factors for calculating VOM costs for combined cycles and combustion turbines is designed to allocate a greater proportion of long term maintenance costs to starts and the tail block of the incremental offer curve. The use of such factors is not appropriate given that long term maintenance costs are not short run marginal costs and should not be included in cost offers. PJM Manual 15 allows for a peaking cyclic factor of three, which means

that a unit with a \$300 per hour (EOH) VOM cost can add \$180 per MWh to a 5 MW peak segment.<sup>193</sup>

The MMU recommends the removal of all cyclic starting and peaking factors from PJM Manual 15.

### Labor Costs

PJM Manual 15 allows for the inclusion of plant staffing costs in energy market cost offers. This is inappropriate given that labor costs are not short run marginal costs.

The MMU recommends the removal of all labor costs from the PJM Manual 15. On December 2, 2022, PJM filed tariff changes removing labor costs from cost-based offers. The changes were approved by the Commission on January 10, 2023 and became effective on June 1, 2023.<sup>194</sup>

### Combined Cycle Start Heat Input Definition

PJM Manual 15 defines the start heat input of combined cycles as the amount of fuel used from the firing of the first combustion turbine to the close of the steam turbine breaker plus any fuel used by other combustion turbines in the combined cycle from firing to the point at which the HRSG steam pressure matches the steam turbine steam pressure. This definition is inappropriate given that after each combustion turbine is synchronized, some of the fuel is used to produce energy for which the unit is compensated in the energy market. To account for this, PJM Manual 15 requires reducing the station service MWh used during the start sequence by the output in MWh produced by each combustion turbine after synchronization and before the HRSG steam pressure matches the steam turbine steam pressure. The formula and the language in this definition are not appropriate and are unclear.

The MMU recommended changing the definition of the start heat input for combined cycles to include only the amount of fuel used from firing each combustion turbine in the combined cycle to the breaker close of each combustion turbine. This change will make the treatment of combined cycles consistent with steam turbines. Exceptions to this definition should be granted when the amount of fuel used from synchronization to steam turbine breaker close is greater than the no load heat plus the output during this period times the incremental heat rate.

<sup>193</sup> The peak adder is equal to \$300 times three divided by 5 MW.

<sup>194</sup> See Federal Energy Regulatory Commission, Docket No. ER23-557-000 (January 10, 2023) at 1.

In 2022, the MMU and PJM proposed changing the start cost definition of units with a steam process to include the costs from the beginning of the start sequence to dispatchable.<sup>195</sup> The new definition included what is commonly considered soak costs in the start cost. The new definition was combined with the elimination of make whole payments to units with a steam process for MWh produced before the unit becomes dispatchable. The proposal was approved by the Commission on January 10, 2023 and became effective on June 1, 2023.<sup>196</sup>

Even though the MMU developed and supported the new definition, it is important to recognize that this approach should be temporary until PJM implements an approach that reflects soak time, soak costs and soak energy output. The main shortcoming of the new definition is that PJM models do not properly value the energy produced during the soak process (soak energy output). Instead, the proposal simply assumes that such MWh are valued at PJM's station service rate. The ideal solution is to model start costs and soak costs separately since there are revenues associated with the MWh produced during soaking, while during the start process there are no MWh being injected into the grid.

The MMU recommends that soak costs, soak time and the MWh produced during soaking be modeled separately. This will ensure that the time required for units to reach a dispatchable level is known and used in the unit commitment process instead of only being communicated verbally between dispatchers and generators. Separating soak costs from start costs and modeling the MWh produced during soaking allows for a better representation of the costs because it eliminates the need to simply assume the price paid for those MWh.

### Nuclear Costs

The fuel costs for nuclear plants are fixed in the short run and amortized over the period between refueling outages. The short run marginal cost of fuel for nuclear plants is zero. Operations and maintenance costs for nuclear power plants consist primarily of labor and maintenance costs incurred during outages, which are also fixed in the short run.

The MMU recommends the removal of nuclear fuel and nonfuel operations and maintenance costs that are not short run marginal costs from the PJM Manual 15.

<sup>195</sup> See "Start Cost Alternate Proposal," MMU presentation to the Cost Development Subcommittee. (December 2, 2021) <[20211202-item-06-start-cost-alternate-proposal.ashx](#)>.

<sup>196</sup> See Federal Energy Regulatory Commission, Docket No. ER23-557-000 (January 10, 2023) at 1.

### Pumped Hydro Costs

The calculation of pumped hydro costs for energy storage in Section 7.3 of PJM Manual 15 is inaccurate. The mathematical formulation does not take into account the purchase of power for pumping in the day-ahead market.

The MMU recommends revising the pumped hydro fuel cost calculation to include day-ahead and real-time power purchases.

### Gas Pipeline Penalties

Section 2.2.2 of PJM Manual 15 states that gas pipeline penalties are not includable in cost-based offers. Penalties can be incurred by units for many reasons, for example, withdrawing gas not nominated and deviating from an imposed threshold during an operational flow order. Any unit with cost-based offers that include gas pipeline penalties will be subject to penalties per Schedule 2 of the PJM Operating Agreement.

Many Market Sellers rely on independent third party quotes to estimate or determine the gas spot price. The quotes received from these third parties should not be based on incurring gas pipeline penalties. It is recommended that Market Sellers confirm with their third parties that gas is available to them without the need to incur gas pipeline penalties. If that is not possible, the units should be unavailable until the third party can confirm that gas is available without incurring penalties.

### Frequently Mitigated Units (FMU) and Associated Units (AU)

The rules for determining the qualification of a unit as an FMU or AU became effective November 1, 2014. The number of units that were eligible for an FMU or AU adder declined from an average of 70 units during the first 11 months of 2014, to zero units eligible for an FMU or AU adder for the period between December 2014 and August 2019.<sup>197</sup> One unit qualified for an FMU adder for the months of September and October, 2019. In 2020, five units qualified for an FMU adder in at least one month. In 2021, one unit qualified for an FMU adder in January. In 2022, 2023, and 2024, no units qualified for an FMU adder.

<sup>197</sup> For a definition of FMUs and AUs, and for historical FMU/AU results, see the *2018 Annual State of the Market Report for PJM*, Volume 2, Section 3, Energy Market, at Frequently Mitigated Units (FMU) and Associated Units (AU).

Table 3-125 shows, by month, the number of FMUs and AUs from January 2021 through December 2024. For example, in January 2021, there were zero units that qualified as an FMU or AU in Tier 1, one unit qualified as an FMU or AU in Tier 2, and zero units qualified as an FMU or AU in Tier 3.

**Table 3-125 Number of frequently mitigated units and associated units (By month): January 2021 through December 2024**

	2021				2022				2023				2024			
	Tier 1	Tier 2	Tier 3	Total Eligible for Any Adder	Tier 1	Tier 2	Tier 3	Total Eligible for Any Adder	Tier 1	Tier 2	Tier 3	Total Eligible for Any Adder	Tier 1	Tier 2	Tier 3	Total Eligible for Any Adder
January	0	1	0	1	0	0	0	0	0	0	0	0	0	0	0	0
February	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
March	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
April	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
May	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
June	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
July	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
August	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
September	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
October	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
November	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
December	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0

For the 2020/2021 through 2022/2023 planning years, default Avoidable Cost Rates were not defined in the tariff. During this period, if a generating unit's Projected PJM Market Revenues plus the unit's PJM capacity market revenues on a rolling 12-month basis (in \$/MW-year) were greater than zero, and if the generating unit did not have an approved unit specific Avoidable Cost Rate, the generating unit would not qualify as an FMU as the Avoidable Cost Rate will be assumed to be zero for FMU qualification purposes.

The MMU recommends the elimination of FMU and AU adders. FMU and AU adders no longer serve the purpose for which they were created and interfere with the efficient operation of PJM markets.

## Market Performance

### Ownership of Marginal Resources

Table 3-126 shows the contribution to real-time, load-weighted LMP by individual marginal resource owners.<sup>198</sup> The contribution of each marginal resource to price at each load bus is calculated for each five-minute interval of 2024, and summed by the parent company that offers the marginal resource into the real-time energy market. In 2024, the offers of one company resulted in 16.4 percent of the real-time load-weighted PJM system LMP and the offers of the top four companies resulted in 43.4 percent of the real-time load-weighted average PJM system LMP. In 2024, the offers of one company resulted in 17.4 percent of the peak hour real-time load-weighted PJM system LMP.


**Table 3-126 Marginal unit contribution to real-time load-weighted LMP (By parent company): 2023 and 2024**

2023						2024					
All Hours			Peak Hours			All Hours			Peak Hours		
Company	Percent of Price	Cumulative Percent	Company	Percent of Price	Cumulative Percent	Company	Percent of Price	Cumulative Percent	Company	Percent of Price	Cumulative Percent
1	15.5%	15.5%	1	15.7%	15.7%	1	16.4%	16.4%	1	17.4%	17.4%
2	8.9%	24.5%	2	9.9%	25.6%	2	9.9%	26.4%	2	11.9%	29.3%
3	8.3%	32.7%	3	8.8%	34.4%	3	9.6%	35.9%	3	8.2%	37.5%
4	8.1%	40.9%	4	7.2%	41.6%	4	7.4%	43.4%	4	7.5%	44.9%
5	7.3%	48.2%	5	7.1%	48.6%	5	5.8%	49.2%	5	4.8%	49.7%
6	6.9%	55.1%	6	6.4%	55.1%	6	4.0%	53.2%	6	4.5%	54.2%
7	3.7%	58.8%	7	3.3%	58.4%	7	4.0%	57.2%	7	3.7%	58.0%
8	2.8%	61.5%	8	3.0%	61.4%	8	3.8%	61.0%	8	3.5%	61.5%
9	2.6%	64.2%	9	2.6%	64.0%	9	3.1%	64.0%	9	2.9%	64.4%
Other (85 companies)	35.8%	100.0%	Other (82 companies)	36.0%	100.0%	Other (94 companies)	36.0%	100.0%	Other (92 companies)	35.6%	100.0%

<sup>198</sup> See the MMU Technical Reference for PJM Markets, at "Calculation and Use of Generator Sensitivity/Unit Participation Factors."

Figure 3-66 shows the marginal unit contribution to the real-time load-weighted PJM system LMP summed by parent companies for every year since 2012.

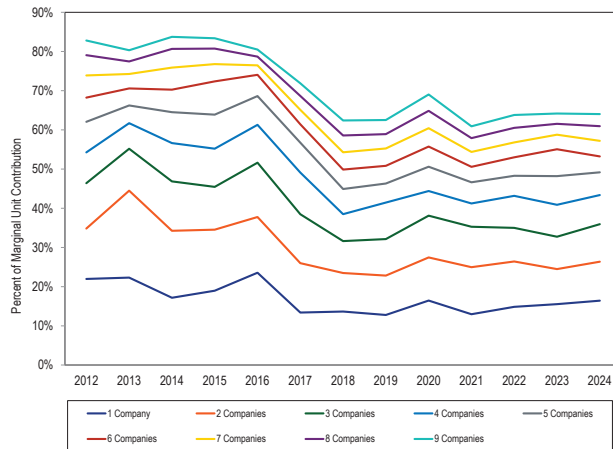**Figure 3-66 Marginal unit contribution to real-time load-weighted LMP (By parent company): 2012 through 2024**



## Markup

The markup index is a measure of the competitiveness of participant behavior for individual units. The markup in dollars is a measure of the impact of participant behavior on the generator bus market price when a unit is marginal. As an example, if unit A has a \$90 cost and a \$100 price, while unit B has a \$9 cost and a \$10 price, both would show a markup index of 10 percent, but the price impact of unit A's markup at the generator bus would be \$10 while the price impact of unit B's markup at the generator bus would be \$1. Depending on each unit's location on the transmission system, those bus level impacts could also have different impacts on total system price. Markup can also affect prices when units with markups are not marginal by altering the economic dispatch order of supply.

The MMU calculates an explicit measure of the impact of marginal unit incremental energy offer markups on LMP using the mathematical relationships among LMPs in the market solution.<sup>199</sup> The markup impact calculation sums, over all marginal units, the product of the dollar markup of the unit and the marginal impact of the unit's

offer on the system load-weighted LMP. The markup impact includes the impact of the identified markup behavior of all marginal units. Positive and negative markup impacts may offset one another. The markup analysis is a direct measure of market performance. It does not take into account whether or not marginal units have either locational or aggregate structural market power.

The markup calculation is not based on a counterfactual redispatch of the system to determine the marginal units and their marginal costs that would have occurred if all units had made all offers at short run marginal cost. A full redispatch analysis is practically impossible and a limited redispatch analysis would not be dispositive. Nonetheless, such a hypothetical counterfactual analysis would reveal the extent to which the actual system dispatch is less than competitive if it showed a difference between dispatch based on short run marginal cost and actual dispatch. It is possible that the unit specific markup, based on a redispatch analysis, would be lower than the markup component of price if the reference point were an inframarginal unit with a lower price and a higher cost than the actual marginal unit. If the actual marginal unit has short run marginal costs that would cause it to be inframarginal, a new unit would be marginal. If the offer of that new unit were greater than the cost of the original marginal unit, the markup impact would be lower than the MMU measure. If the newly marginal unit is on a price-based schedule, the analysis would have to capture the markup impact of that unit as well.

## Real-Time Markup

### Markup Component of Real-Time Price by Fuel, Unit Type

The markup component of price is the difference between the system price, when the system price is determined by the active offers of the marginal units, whether price or cost-based, and the system price, based on the cost-based offers of those marginal units.

PJM implemented fast start pricing on September 1, 2021. Under the fast start pricing rules, the LMPs are calculated in the pricing run, where the offer price of a marginal fast start unit includes amortized commitment costs. For all the fast start marginal units starting from September 1, 2021, the markup includes markup in the incremental offer, markup in the amortized start up offer and markup in the amortized no load offer.

<sup>199</sup> The MMU calculates the impact on system prices of marginal unit price-cost markup, based on analysis using sensitivity factors. The calculation shows the markup component of LMP based on a comparison between the price-based incremental energy offer and the cost-based incremental energy offer of each actual marginal unit on the system. This is the same method used to calculate the fuel cost adjusted LMP and the components of LMP. See Calculation and Use of Generator Sensitivity/Unit Participation Factors, 2010 State of the Market Report for PJM: Technical Reference for PJM Markets.

Table 3-127 shows the impact (markup component of LMP) of the marginal unit markup behavior by fuel type and unit type on the real-time load-weighted average system LMP using unadjusted and adjusted offers. The adjusted markup component of LMP decreased from \$2.67 per MWh in 2023 to \$1.98 per MWh in 2024. The adjusted markup contribution of coal units in 2024 was \$0.26 per MWh, an increase of \$0.16 per MWh from 2023. The adjusted markup component of gas fired units in 2024 was \$2.18 per MWh, a decrease of \$0.51 per MWh from 2023. The markup component of wind units was \$0.02 per MWh. If a price-based offer is negative, but less negative than a cost-based offer, the markup is positive. In 2024, among the wind units that were marginal, 58.5 percent had negative offer prices.

**Table 3-127 Markup component of real-time load-weighted average LMP by primary fuel type and unit type: 2023 and 2024<sup>200</sup>**

Fuel	Technology	2023		2024	
		Markup Component of LMP (Unadjusted)	Markup Component of LMP (Adjusted)	Markup Component of LMP (Unadjusted)	Markup Component of LMP (Adjusted)
Coal	Steam	(\$0.40)	\$0.10	(\$0.21)	\$0.26
Gas	CC	\$1.03	\$1.91	\$0.72	\$1.60
Gas	CT	\$0.36	\$0.80	\$0.12	\$0.56
Gas	RICE	(\$0.01)	\$0.01	(\$0.01)	\$0.01
Gas	Steam	(\$0.10)	(\$0.03)	(\$0.06)	\$0.01
Municipal Waste	RICE	\$0.02	\$0.02	\$0.02	\$0.02
Oil	CC	(\$0.03)	(\$0.02)	(\$0.00)	(\$0.00)
Oil	CT	(\$0.10)	(\$0.09)	(\$0.55)	(\$0.46)
Oil	RICE	\$0.00	\$0.00	(\$0.00)	\$0.00
Oil	Steam	(\$0.07)	(\$0.06)	(\$0.14)	(\$0.12)
Other	Battery	\$0.00	\$0.00	\$0.00	\$0.00
Other	Solar	\$0.01	\$0.01	\$0.07	\$0.07
Other		\$0.00	\$0.00	\$0.01	\$0.01
Wind		\$0.01	\$0.01	\$0.02	\$0.02
Total		\$0.73	\$2.67	(\$0.01)	\$1.98

### Markup Component of Real-Time Price

Table 3-128 shows the markup component, calculated using unadjusted offers, of average prices and of average monthly on peak and off peak prices. Table 3-129 shows the markup component, calculated using adjusted offers, of average prices and of average monthly on peak and off peak prices. In 2024, when using unadjusted cost-based offers, -\$0.01 per MWh of the PJM real-time load-weighted average LMP was attributable to markup. Using adjusted cost-based offers, \$1.98 per MWh of the PJM real-time load-weighted average LMP was attributable to markup. In 2024, the peak markup component was highest in July, \$6.10 per MWh using unadjusted cost-based offers and \$8.87 per MWh using adjusted cost-based offers. This corresponds to 10.0 percent and 14.6 percent of the real-time peak load weighted average LMP in July.

**Table 3-128 Monthly markup components of real-time load-weighted LMP (Unadjusted): 2023 through 2024**

	2023			2024		
	Markup Component (All Hours)	Peak Markup Component	Off Peak Markup Component	Markup Component (All Hours)	Peak Markup Component	Off Peak Markup Component
Jan	\$0.45	\$0.45	\$0.44	(\$3.81)	(\$2.55)	(\$5.05)
Feb	(\$0.82)	(\$0.39)	(\$1.25)	\$0.12	\$0.60	(\$0.36)
Mar	\$0.51	\$0.66	\$0.34	(\$0.14)	(\$0.68)	\$0.34
Apr	\$0.08	\$0.50	(\$0.31)	\$1.49	\$2.00	\$0.92
May	\$0.69	\$1.41	(\$0.07)	(\$0.57)	(\$0.17)	(\$1.00)
Jun	\$1.08	\$1.72	\$0.33	(\$0.45)	(\$1.01)	\$0.11
Jul	\$1.82	\$3.41	\$0.31	\$3.72	\$6.10	\$1.11
Aug	\$2.09	\$2.41	\$1.72	\$2.31	\$4.47	(\$0.07)
Sep	\$0.92	\$1.08	\$0.76	(\$0.33)	(\$0.28)	(\$0.37)
Oct	\$1.37	\$2.24	\$0.43	(\$1.60)	(\$1.64)	(\$1.56)
Nov	\$0.05	\$0.36	(\$0.25)	(\$0.06)	\$0.76	(\$0.81)
Dec	(\$0.02)	\$0.32	(\$0.31)	(\$1.38)	(\$1.43)	(\$1.32)
Total	\$0.73	\$1.26	\$0.20	(\$0.01)	\$0.67	(\$0.70)

<sup>200</sup> The unit type RICE refers to Reciprocating Internal Combustion Engines.



Table 3-129 Monthly markup components of real-time load-weighted LMP (Adjusted): 2023 through 2024

	2023			2024		
	Markup Component (All Hours)	Peak Markup Component	Off Peak Markup Component	Markup Component (All Hours)	Peak Markup Component	Off Peak Markup Component
Jan	\$2.56	\$2.70	\$2.43	(\$0.78)	\$0.62	(\$2.16)
Feb	\$0.86	\$1.42	\$0.30	\$1.77	\$2.26	\$1.28
Mar	\$2.32	\$2.56	\$2.06	\$1.29	\$0.88	\$1.66
Apr	\$1.79	\$2.45	\$1.19	\$3.03	\$3.65	\$2.35
May	\$2.42	\$3.35	\$1.42	\$1.38	\$2.00	\$0.72
Jun	\$2.85	\$3.69	\$1.87	\$1.50	\$1.28	\$1.72
Jul	\$4.13	\$6.12	\$2.23	\$6.03	\$8.87	\$2.91
Aug	\$4.18	\$4.72	\$3.53	\$4.15	\$6.54	\$1.51
Sep	\$2.90	\$3.37	\$2.45	\$1.48	\$1.72	\$1.25
Oct	\$3.28	\$4.33	\$2.17	\$0.24	\$0.38	\$0.08
Nov	\$2.15	\$2.61	\$1.70	\$1.79	\$2.79	\$0.88
Dec	\$1.93	\$2.45	\$1.48	\$0.98	\$1.06	\$0.90
Total	\$2.67	\$3.41	\$1.93	\$1.98	\$2.86	\$1.08

### Hourly Markup Component of Real-Time Prices

Figure 3-67 shows the markup contribution to the hourly load-weighted LMP using unadjusted cost offers in 2024 and 2023. Figure 3-68 shows the markup contribution to the hourly load-weighted LMP using adjusted cost-based offers in 2024 and 2023.

Figure 3-67 Markup contribution to real-time hourly load-weighted LMP (Unadjusted): January 2023 through December 2024


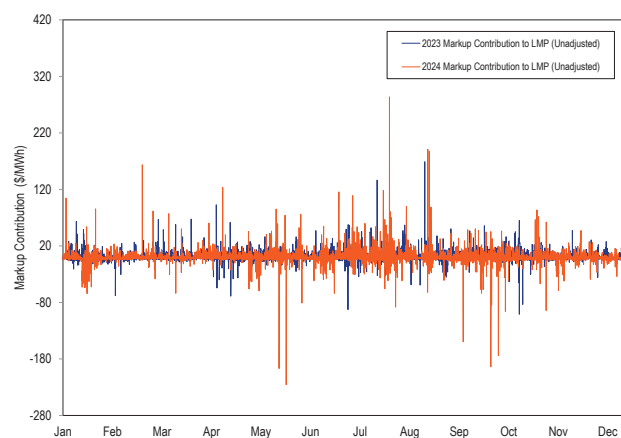


Figure 3-68 Markup contribution to real-time hourly load-weighted LMP (Adjusted): January 2023 through December 2024

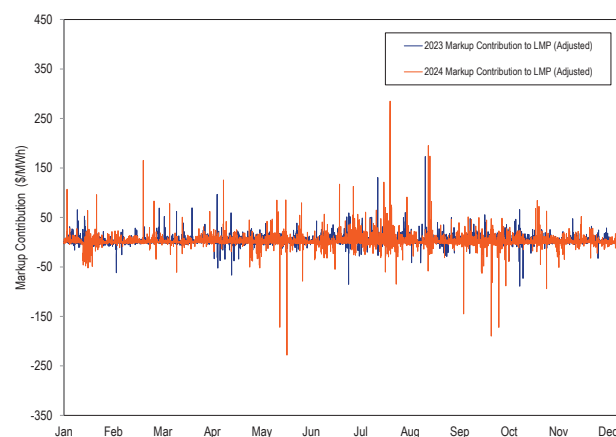

### Markup Component of Real-Time Zonal Prices

The unit markup component of average real-time price using unadjusted offers is shown for each zone in 2023 and 2024 in Table 3-130 and for adjusted offers in Table 3-131.<sup>201</sup> The smallest zonal all hours average markup component using unadjusted offers in 2024, was in the PPL Zone, -\$0.80 per MWh, while the highest was in the BGE Zone, \$1.10 per MWh. The smallest zonal on peak average markup component using unadjusted offers in 2024, was in the PPL Zone, -\$0.20 per MWh, while the highest was in the BGE Zone, \$1.78 per MWh.

**Table 3-130 Real-time average zonal markup component (Unadjusted): 2023 and 2024**

	2023			2024		
	Markup Component (All Hours)	Peak Markup Component	Off Peak Markup Component	Markup Component (All Hours)	Peak Markup Component	Off Peak Markup Component
ACEC	(\$0.18)	(\$0.14)	(\$0.23)	(\$0.41)	\$0.29	(\$1.13)
AEP	\$0.89	\$1.47	\$0.31	\$0.17	\$0.92	(\$0.60)
APS	\$0.96	\$1.62	\$0.29	(\$0.11)	\$0.57	(\$0.79)
ATSI	\$0.88	\$1.49	\$0.27	\$0.04	\$0.83	(\$0.75)
BGE	\$1.79	\$2.79	\$0.78	\$1.10	\$1.78	\$0.41
COMED	\$0.54	\$1.02	\$0.06	(\$0.16)	\$0.46	(\$0.79)
DAY	\$0.97	\$1.50	\$0.44	(\$0.10)	\$0.57	(\$0.78)
DOM	\$1.37	\$2.25	\$0.50	\$0.31	\$0.94	(\$0.32)
DPL	(\$0.44)	(\$0.61)	(\$0.26)	(\$0.36)	\$0.25	(\$0.99)
DUKE	\$0.97	\$1.55	\$0.38	(\$0.41)	\$0.31	(\$1.15)
DUQ	\$0.92	\$1.52	\$0.31	(\$0.22)	\$0.41	(\$0.86)
EKPC	\$0.96	\$1.60	\$0.31	(\$0.42)	\$0.13	(\$0.99)
JCPLC	(\$0.17)	(\$0.08)	(\$0.26)	(\$0.52)	\$0.20	(\$1.25)
MEC	\$0.05	\$0.48	(\$0.37)	(\$0.66)	\$0.10	(\$1.43)
OVEC	\$0.92	\$1.50	\$0.33	(\$0.45)	\$0.01	(\$0.91)
PE	\$0.65	\$1.10	\$0.19	(\$0.28)	\$0.33	(\$0.91)
PECO	(\$0.32)	(\$0.42)	(\$0.23)	(\$0.44)	\$0.16	(\$1.05)
PEPCO	\$1.51	\$2.47	\$0.54	\$0.62	\$1.15	\$0.09
PPL	(\$0.13)	\$0.09	(\$0.34)	(\$0.80)	(\$0.20)	(\$1.41)
PSEG	(\$0.18)	(\$0.09)	(\$0.27)	(\$0.43)	\$0.37	(\$1.24)
REC	(\$0.02)	\$0.17	(\$0.20)	(\$0.27)	\$0.39	(\$0.94)

**Table 3-131 Real-time average zonal markup component (Adjusted): 2023 and 2024**

	2023			2024		
	Markup Component (All Hours)	Peak Markup Component	Off Peak Markup Component	Markup Component (All Hours)	Peak Markup Component	Off Peak Markup Component
ACEC	\$1.27	\$1.43	\$1.11	\$1.35	\$2.18	\$0.51
AEP	\$2.90	\$3.69	\$2.11	\$2.16	\$3.12	\$1.20
APS	\$3.00	\$3.86	\$2.12	\$1.97	\$2.87	\$1.05
ATSI	\$2.86	\$3.69	\$2.03	\$2.06	\$3.09	\$1.03
BGE	\$4.20	\$5.45	\$2.94	\$3.47	\$4.44	\$2.49
COMED	\$2.43	\$3.17	\$1.69	\$1.62	\$2.45	\$0.78
DAY	\$3.06	\$3.80	\$2.30	\$1.95	\$2.83	\$1.06
DOM	\$3.63	\$4.76	\$2.50	\$2.53	\$3.39	\$1.66
DPL	\$1.10	\$1.07	\$1.13	\$1.51	\$2.26	\$0.74
DUKE	\$3.00	\$3.79	\$2.20	\$1.56	\$2.48	\$0.62
DUQ	\$2.89	\$3.71	\$2.06	\$1.80	\$2.69	\$0.91
EKPC	\$2.98	\$3.82	\$2.12	\$1.55	\$2.31	\$0.78
JCPLC	\$1.35	\$1.57	\$1.13	\$1.26	\$2.10	\$0.41
MEC	\$1.76	\$2.38	\$1.14	\$1.20	\$2.15	\$0.24
OVEC	\$2.90	\$3.69	\$2.12	\$1.48	\$2.13	\$0.83
PE	\$2.52	\$3.17	\$1.87	\$1.73	\$2.57	\$0.89
PECO	\$1.06	\$1.06	\$1.05	\$1.28	\$2.00	\$0.55
PEPCO	\$3.78	\$4.97	\$2.58	\$2.92	\$3.70	\$2.12
PPL	\$1.45	\$1.84	\$1.05	\$0.98	\$1.75	\$0.20
PSEG	\$1.35	\$1.57	\$1.13	\$1.36	\$2.26	\$0.44
REC	\$1.62	\$1.94	\$1.29	\$1.59	\$2.35	\$0.81

<sup>201</sup> A marginal unit's offer price affects LMPs in the entire PJM market. The markup component of average zonal real-time price is based on offers of units located within the zone and units located outside the transmission zone.

### Markup by Real-Time Price Levels

Table 3-132 shows the markup contribution to the LMP, based on the unadjusted cost-based offers and adjusted cost-based offers of the marginal units, when the PJM system wide load-weighted average LMP was in the identified price range.

**Table 3-132 Real-time markup contribution (By load-weighted LMP category, unadjusted): 2023 and 2024**

LMP Category	2023		2024	
	Markup Component	Frequency	Markup Component	Frequency
< \$10	(\$3.14)	0.7%	(\$1.92)	1.4%
\$10 to \$15	(\$1.31)	6.2%	(\$1.93)	11.4%
\$15 to \$20	(\$1.29)	17.7%	(\$2.37)	17.6%
\$20 to \$25	(\$1.25)	22.2%	(\$2.05)	18.4%
\$25 to \$50	\$0.66	45.3%	(\$0.17)	40.8%
\$50 to \$75	\$7.92	5.7%	\$4.85	6.3%
\$75 to \$100	\$15.62	1.4%	\$6.96	1.8%
\$100 to \$125	\$19.62	0.4%	\$6.15	1.1%
\$125 to \$150	\$28.94	0.2%	\$16.63	0.5%
>= \$150	\$9.70	0.2%	\$28.62	0.8%

**Table 3-133 Real-time markup contribution (By load-weighted LMP category, adjusted): 2023 and 2024**

LMP Category	2023		2024	
	Markup Component	Frequency	Markup Component	Frequency
< \$10	(\$2.24)	0.7%	(\$1.15)	1.4%
\$10 to \$15	(\$0.20)	6.2%	(\$0.87)	11.4%
\$15 to \$20	\$0.10	17.7%	(\$1.02)	17.6%
\$20 to \$25	\$0.43	22.2%	(\$0.40)	18.4%
\$25 to \$50	\$2.85	45.3%	\$2.09	40.8%
\$50 to \$75	\$10.65	5.7%	\$7.80	6.3%
\$75 to \$100	\$18.22	1.4%	\$10.08	1.8%
\$100 to \$125	\$21.94	0.4%	\$9.88	1.1%
\$125 to \$150	\$33.23	0.2%	\$20.76	0.5%
>= \$150	\$11.56	0.2%	\$31.50	0.8%

### Markup by Company

Table 3-134 shows the markup contribution based on the unadjusted cost-based offers and adjusted cost-based offers to real-time load-weighted average LMP by individual marginal resource owners. The markup contribution of each marginal resource to price at each load bus is calculated for each five-minute interval, and summed by the parent company that offers the marginal resource into the real-time energy market. In 2024, when using unadjusted cost-based offers, the markup of one company accounted for 2.1 percent of the load-weighted average LMP, the markup of the top five companies accounted for 4.7 percent of the load-weighted average LMP and the markup of all companies accounted for less than one percent of the load-weighted average LMP. The share of top five companies' markup contribution to the load-weighted average LMP increased and the dollar values of their markup increased in 2024. The markup contribution to the load-weighted average LMP decreased and share of the markup contribution to the load-weighted average LMP decreased 2024. The markup contribution of a unit to the real-time load-weighted average LMP can be positive or negative.

**Table 3-134 Markup component of real-time load-weighted average LMP by Company: 2023 and 2024**

	2023				2024			
	Markup Component of LMP (Unadjusted)		Markup Component of LMP (Adjusted)		Markup Component of LMP (Unadjusted)		Markup Component of LMP (Adjusted)	
	\$/MWh	Percent of Load Weighted LMP	\$/MWh	Percent of Load Weighted LMP	\$/MWh	Percent of Load Weighted LMP	\$/MWh	Percent of Load Weighted LMP
Top 1 Company	\$0.94	3.0%	\$1.15	3.7%	\$0.71	2.1%	\$0.90	2.7%
Top 2 Companies	\$1.10	3.5%	\$1.46	4.7%	\$1.06	3.1%	\$1.41	4.2%
Top 3 Companies	\$1.24	4.0%	\$1.66	5.3%	\$1.24	3.7%	\$1.78	5.3%
Top 4 Companies	\$1.35	4.3%	\$1.83	5.9%	\$1.42	4.2%	\$1.98	5.9%
Top 5 Companies	\$1.44	4.6%	\$1.97	6.3%	\$1.58	4.7%	\$2.16	6.4%
All Companies	\$0.73	2.3%	\$2.67	8.6%	(\$0.01)	(0.0%)	\$1.98	5.9%

## Market Structure, Participant Behavior, and Market Performance

The goal of regulation through competition is to achieve competitive market outcomes even in the presence of market power. Market structure in the PJM energy market is not competitive in local markets created by transmission constraints. At times, market structure is not competitive in the aggregate energy market. Market sellers pursuing their financial interests may choose behavior that benefits from structural market power in the absence of an effective market power mitigation program. The overall competitive assessment evaluates the extent to which participant behavior results in competitive or above competitive pricing. The competitive assessment brings together the structural measures of market power, HHI and pivotal suppliers, with participant behavior, specifically markup, and pricing outcomes.

### HHI and Markup

In theory, the HHI provides insight into the relationship between market structure, behavior, and performance. In the case where participants compete by producing output at constant, but potentially different, marginal costs, the HHI is directly proportional to the expected average price cost markup in the market:<sup>202</sup>

$$\frac{HHI}{\varepsilon} = \frac{P - MC}{P}$$

where  $\varepsilon$  is the absolute value of the price elasticity of demand,  $P$  is the market price, and  $MC$  is the average marginal cost of production. This is called the Lerner Index. The left side of the equation quantifies market structure, and the right side of the equation measures market performance. The assumed participant behavior is profit maximization. As HHI decreases, implying a more competitive market, prices converge to marginal cost, the competitive market outcome. But even a low HHI may result in substantial markup with a low price elasticity of demand. If HHI is very high, meaning competition is lacking, prices can reach the monopoly level. Price elasticity of demand ( $\varepsilon$ ) determines the degree to which suppliers with market power can impose higher prices on customers. The Lerner Index is a measure of market power that connects market structure (HHI and demand elasticity) to market performance (markup).

<sup>202</sup> See Tirole, Jean. *The Theory of Industrial Organization*, MIT (1988), Chapter 5: Short-Run Price Competition.

The PJM energy market HHIs and application of the FERC concentration categories understate the degree of market power because, in the absence of aggregate market power mitigation, even the unconcentrated HHI level implies substantial markups due to the low short run price elasticity of demand. For example, research estimates find short run electricity demand elasticity ranging from -0.2 to -0.4.<sup>203</sup> Using the Lerner Index, the elasticity of -0.2 implies, for example, an average markup ranging from 25 to 50 percent at the low end of the moderately concentrated threshold HHI of 1000:<sup>204</sup>

$$\frac{HHI}{\varepsilon} = \frac{0.1}{0.2} = \frac{P - MC}{P} = 0.5$$

With knowledge of HHI, elasticity, and marginal cost, one can solve for the price level theoretically indicated by the Lerner Index, based on profit maximizing behavior including the exercise of market power. With marginal costs of \$33.74 per MWh and an average HHI of 714 in 2024, average PJM prices would theoretically range from \$41 to \$53 per MWh, an implied markup of 17.9 to 35.7 percent, using the elasticity range of -0.2 to -0.4. Given the elasticity estimates, the theoretical prices exceed marginal costs because the exercise of market power is profit maximizing in the absence of market power mitigation. Actual prices, averaging \$33.74 per MWh with markups at -0.1 percent, are lower than the theoretical range, supporting the MMU's competitive assessment of the market. However, markup is not zero. In some market intervals, markup and prices reach levels that reflect the exercise of market power.

### Market Power Mitigation and Markup

Fully effective market power mitigation would not allow a seller that fails the structural market power test (the TPS test) to set prices with a positive markup. With the flaws in PJM's implementation of the TPS test, resources can and do set prices with a positive markup while failing the TPS test.

<sup>203</sup> See Patrick, Robert H. and Frank A. Wolak (1997), "Estimating the Customer-Level Demand for Electricity Under Real-Time Market Prices," <[https://web.stanford.edu/group/fwolak/cgi-bin/sites/default/files/files/Estimating%20the%20Customer-Level%20Demand%20for%20Electricity%20Under%20Real-Time%20Market%20Prices\\_Aug%201997\\_Patrick,%20Wolak.pdf](https://web.stanford.edu/group/fwolak/cgi-bin/sites/default/files/files/Estimating%20the%20Customer-Level%20Demand%20for%20Electricity%20Under%20Real-Time%20Market%20Prices_Aug%201997_Patrick,%20Wolak.pdf)>, last accessed August 3, 2018 and Fan, Shu and Rob Hyndman (2010), "The price elasticity of electricity demand in South Australia," <<https://robjhyndman.com/papers/Elasticity2010.pdf>>.

<sup>204</sup> The HHI used in the equation is based on market shares. For the FERC HHI thresholds and standard HHI reporting, market shares are multiplied by 100 prior to squaring the market shares.

Table 3-135 categorizes day-ahead and real-time marginal unit intervals by markup level and TPS test status. In 2024, 3.4 percent of real-time marginal unit intervals and 4.3 percent of day-ahead marginal unit hours included a positive markup even though the resource failed the TPS test for local market power. Unmitigated local market power affects PJM market prices. Zero markup with a TPS test failure indicates the mitigation of a marginal unit.

**Table 3-135 Percent of real-time marginal unit intervals with markup and local market power: 2024**

Markup Category	Day-ahead Market			Real-time Market		
	Not Failing TPS Test	Failing TPS Test	Percent in Category	Not Failing TPS Test	Failing TPS Test	Percent in Category
Negative Markup	34.1%	4.5%	38.6%	48.7%	7.5%	56.2%
Zero Markup	19.7%	6.1%	25.8%	18.8%	5.8%	24.6%
\$0 to \$5	12.3%	1.4%	13.7%	8.9%	1.7%	10.6%
\$5 to \$10	7.8%	1.4%	9.2%	3.3%	0.6%	4.0%
\$10 to \$15	2.0%	0.5%	2.4%	1.1%	0.3%	1.4%
\$15 to \$20	1.4%	0.3%	1.6%	0.5%	0.2%	0.7%
\$20 to \$25	0.7%	0.2%	0.9%	0.3%	0.1%	0.3%
\$25 to \$50	3.9%	0.5%	4.3%	1.3%	0.3%	1.6%
\$50 to \$75	2.0%	0.1%	2.1%	0.1%	0.1%	0.2%
\$75 to \$100	1.0%	0.0%	1.0%	0.1%	0.1%	0.1%
Above \$100	0.3%	0.0%	0.3%	0.1%	0.1%	0.2%
Total Positive Markup	31.3%	4.3%	35.6%	15.8%	3.4%	19.2%
Total	85.1%	14.9%	100.0%	83.4%	16.6%	100.0%

The markup of marginal units was zero or negative in 80.8 percent of real-time marginal unit intervals and 64.4 percent of day-ahead marginal unit intervals in 2024. Zero and negative markup are the expected results in a competitive market. Pivotal suppliers in the aggregate market also set prices with high markups in 2024. The 31.3 percent of day-ahead marginal units and 15.8 percent of real-time marginal units setting price with a markup without failing the TPS test could represent units with aggregate market power or units that maintain markup in their offer for times when they have local market power. Allowing positive markups to affect prices in the presence of market power permits the exercise of market power and has a negative impact on the competitiveness of the PJM energy market. This problem can and should be addressed.





## Energy Uplift (Operating Reserves)

In a well designed wholesale power market, energy uplift is paid as credits to market participants under specified conditions in order to ensure that competitive energy and ancillary service market outcomes do not require efficient resources operating at the direction of PJM, to operate at a loss.<sup>1</sup> Referred to in PJM as operating reserve credits, lost opportunity cost credits, dispatch differential lost opportunity credits, reactive services credits, synchronous condensing credits or black start services credits, these uplift payments are intended to be one of the incentives to generation owners to offer their energy to the PJM energy market for dispatch based on short run marginal costs and to operate their units as directed by PJM. These uplift credits are paid by PJM market participants as operating reserve charges, reactive services charges, synchronous condensing charges or black start services charges. Fast start pricing, implemented on September 1, 2021, required a new uplift credit to pay the lost opportunity costs of units that are backed down in real time to accommodate the less flexible fast start units for which fast start pricing assumes flexibility. The result of fast start pricing is to create a greater reliance on uplift rather than price signals as an incentive to follow PJM's instructions.

Uplift is an inherent part of the PJM market design. Part of uplift is the result of the nonconvexity of power production costs. Uplift payments cannot be eliminated, but uplift payments should be limited to the efficient level. In wholesale power market design, a choice must be made between efficient prices and prices that fully compensate costs. Economists recognize that no single price achieves both goals in markets with nonconvex production costs, like the costs of producing electric power.<sup>2 3</sup> In wholesale power markets like PJM, efficient prices equal the short run marginal cost of production by location. The dispatch of generators based on these efficient price signals minimizes the total market cost of production. For generators with nonconvex costs,

marginal cost prices may not cover the total cost of starting the generator and running at the efficient output level. Uplift payments cover the difference. The PJM market design concept incorporates efficient prices with minimal uplift payments.

But PJM's practice does not minimize uplift payments. In some cases, PJM pays uplift that is not consistent with the rules. In some cases, the rules permit the payment of uplift that is not consistent with the goal of PJM market design. Regulation revenues should be included as an offset to uplift, but are not currently included. The need for uplift should be calculated on a daily basis, as incorporated in the initial PJM market design, rather than on an hourly segment basis. The goal of uplift should be to ensure that units are not required to run at a loss on a daily basis. The goal should not be to lock in profits in some hourly segments and require uplift in other hourly segments. There are identified improvements to PJM's application of the rules, and to the market design and uplift rules that could reduce uplift payments to the efficient level.

PJM's day-ahead generator credits and balancing generator credits are calculated by operating day and by hourly segments. Segments for day-ahead generator credits equal the hours in which the unit cleared in the day-ahead market. Segments for balancing generator credits are defined as the greater of the day-ahead schedule and the unit's minimum run time. Intervals in excess of the minimum run time or in excess of the hours cleared in the day-ahead market become new segments. The net revenues in those new segments are not counted as contributing to covering costs in the initial segment. The reverse is also true. Uplift is paid even when total net revenues cover or more than cover costs when the entire day is included.

In PJM, all energy payments to demand response resources are uplift payments. The energy payments to these resources are not part of the supply and demand balance, they are not paid by LMP revenues and therefore the energy payments to demand response resources have to be paid as out of market uplift. The energy payments to economic DR are funded by real-time load and real-time exports. The energy payments to emergency DR are funded by participants with net energy purchases in the real-time energy market. The current payment structure for DR is an inefficient element of the PJM market design.<sup>4</sup>

<sup>1</sup> Losses occur when gross energy and ancillary services market revenues are less than short run marginal costs, including all elements of the energy offer, which are startup, no load and incremental offers, and the unit is following PJM instructions including both commitment and dispatch instructions. There is no corresponding assurance required when units are self scheduled or not following PJM dispatch instructions.

<sup>2</sup> See Stoft, *Power System Economics: Designing Markets for Electricity*, New York: Wiley (2002) at 272; Mas-Colell, Whinston, and Green, *Microeconomic Theory*, New York: Oxford University Press (1995) at 570; and Quinzii, *Increasing Returns and Efficiency*, New York: Oxford University Press (1992).

<sup>3</sup> The production of output is convex if the production function has constant or decreasing returns to scale, which result in constant or rising average costs with increases in output. Production is nonconvex with increasing returns to scale, which is the case when generating units have start or no load costs that are large relative to marginal costs. See Mas-Colell, Whinston, and Green at 132.

<sup>4</sup> Demand response payments are addressed in Section 6: Demand Response.

## Overview

### Energy Uplift Credits

- **Energy uplift credits.** Total energy uplift credits increased by \$113.0 million, or 72.0 percent, in 2024 compared to 2023, from \$156.9 million to \$269.9 million.
- **Types of energy uplift credits.** In 2024, total energy uplift credits included \$115.2 million in day-ahead generator credits, \$120.5 million in balancing generator credits, \$31.2 million in lost opportunity cost credits. Dispatch differential lost opportunity credits, which are a subset of balancing operating reserves, were implemented as part of fast start pricing on September 1, 2021, and were \$1.9 million in 2024.
- **Types of units.** In 2024, steam coal units received 45.2 percent of day-ahead generator credits, and combustion turbines received 76.1 percent of balancing generator credits and 82.2 percent of lost opportunity cost credits. Combined cycle units and combustion turbines received 27.8 percent of dispatch differential lost opportunity credits, and hydro units received 55.8 percent of dispatch differential lost opportunity credits
- **Concentration of energy uplift credits.** In 2024, the top 10 units receiving energy uplift credits received 43.2 percent of all credits and the top 10 organizations received 76.0 percent of all credits.
- **Lost opportunity cost credits.** Lost opportunity cost credits increased by \$8.7 million, or 38.5 percent, in 2024, compared to 2023, from \$22.5 million to \$31.2 million.

Some combustion turbines and diesels are scheduled day-ahead but not requested in real time, and receive day-ahead lost opportunity cost credits as a result. This was the source of 82.1 percent of the \$31.2 million of lost opportunity costs.

- **Following dispatch.** Some units are incorrectly paid uplift despite not meeting uplift eligibility requirements, including not following dispatch, not having the correct commitment status, or not operating with PLS offer parameters. Since 2018, the MMU has made cumulative resettlement requests for the most extreme overpaid units of \$17.9 million, of which PJM has resettled only \$3.9 million, or 22.0 percent.

### Energy Uplift Charges

- **Energy Uplift Charges.** In 2024, total energy uplift charges increased by \$112.2 million, or 72.1 percent, compared to 2023, from \$155.7 million to \$268.0 million.
- **Types of Energy Uplift Charges.** In 2024, total uplift charges included \$114.7 million in day-ahead operating reserve charges, \$152.1 million in balancing generator charges, \$0.9 million in reactive charges, and \$0.3 million in black start services.

### Recommendations

- The MMU recommends that uplift be paid only based on operating parameters that reflect the flexibility of the benchmark new entrant unit (CONE unit) in the PJM Capacity Market. (Priority: High. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM not pay uplift to units not following dispatch, including uplift related to fast start pricing, and require refunds where it has made such payments. This includes units whose offers are flagged for fixed generation in Markets Gateway because such units are not dispatchable. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM pay uplift based on the offer at the lower of the actual unit output or the dispatch signal MW. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends eliminating intraday segments from the calculation of uplift payments and returning to calculating the need for uplift based on the entire 24 hour operating day. (Priority: High. First reported 2018. Status: Not adopted.)
- The MMU recommends the elimination of day-ahead uplift to ensure that units receive an energy uplift payment based on their real-time output and not their day-ahead scheduled output. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that units not be paid lost opportunity cost uplift credits when PJM directs a unit to reduce output based on a transmission constraint or other reliability issue. There is no lost opportunity because the unit is required to reduce for

the reliability of the unit and the system. (Priority: High. First reported 2021. Status: Not adopted.)

- The MMU recommends reincorporating the use of net regulation revenues as an offset in the calculation of balancing generator credits. (Priority: Medium. First reported 2009. Status: Not adopted.)
- The MMU recommends that self scheduled units not be paid energy uplift credits for their startup cost when the units are scheduled by PJM to start before the self scheduled hours. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends three modifications to the energy lost opportunity cost calculations:
  - The MMU recommends calculating LOC based on 24 hour daily periods for combustion turbines and diesels scheduled in the day-ahead energy market, but not committed in real time. (Priority: Medium. First reported 2014. Status: Not adopted.)
  - The MMU recommends that units scheduled in the day-ahead energy market and not committed in real time should be compensated for LOC based on their real-time desired and achievable output, not their scheduled day-ahead output. (Priority: Medium. First reported 2015. Status: Not adopted.)
  - The MMU recommends that only flexible fast start units (startup plus notification times of 10 minutes or less) and units with short minimum run times (one hour or less) be eligible by default for the LOC compensation to units scheduled in the day-ahead energy market and not committed in real time. Other units should be eligible for LOC compensation only if PJM explicitly cancels their day-ahead commitment. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that up to congestion (UTC) transactions be required to pay energy uplift charges for both the injection and the withdrawal sides of the UTC. (Priority: High. First reported 2011. Status: Partially adopted.)
- The MMU recommends allocating the energy uplift credits paid to units scheduled by PJM as must run in the day-ahead energy market for reasons other than voltage/reactive or black start services as a reliability charge to real-time load, real-time exports and real-time wheels. (Priority: Medium.

First reported 2014. Status: Not adopted. Stakeholder process.)

- The MMU recommends that the total cost of providing reactive support be categorized and allocated as reactive services. Reactive services credits should be calculated consistent with the balancing generator credit calculation. (Priority: Medium. First reported 2012. Status: Not adopted. Stakeholder process.)
- The MMU recommends including real-time exports and real-time wheels in the allocation of the cost of providing reactive support to the 500 kV system or above, in addition to real-time load. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends modifications to the calculation of lost opportunity costs credits paid to wind units. The lost opportunity costs credits paid to wind units should be based on the lesser of the desired output, the estimated output based on actual wind conditions and the capacity interconnection rights (CIRs). The MMU recommends that PJM require wind units to request CIRs based on the maximum output used in the ELCC calculation for wind units. (Priority: Low. First reported 2012. Status: Partially adopted.)
- The MMU recommends that PJM clearly identify and classify all reasons for incurring uplift in the day-ahead and the real-time energy markets and the associated uplift charges in order to make all market participants aware of the reasons for these costs and to help ensure a long term solution to the issue of how to allocate the costs of uplift. (Priority: Medium. First reported 2011. Status: Partially adopted.)
- The MMU recommends that PJM revise the current uplift confidentiality rules in order to allow the disclosure of complete information about the level of uplift by unit and the detailed reasons for the level of uplift credits by unit in the PJM region. (Priority: High. First reported 2013. Status: Partially adopted.)<sup>5</sup>

<sup>5</sup> On September 7, 2018, PJM made a compliance filing for FERC Order No. 844 to publish unit specific uplift credits. The compliance filing was accepted by FERC on June 21, 2019. 166 FERC ¶ 61,210 (2019). PJM began posting unit specific uplift reports on May 1, 2019. 167 FERC ¶ 61,280 (2019).

## Conclusion

Competitive market outcomes result from energy offers equal to short run marginal costs that incorporate flexible operating parameters. When PJM permits a unit to include inflexible operating parameters in its offer and pays uplift based on those inflexible parameters, there is an incentive for the unit to remain inflexible. The rules regarding operating parameters should be implemented in a way that creates incentives for flexible operations rather than inflexible operations. The standard for paying uplift should be the maximum achievable flexibility, based on OEM standards for the benchmark new entrant unit (CONE unit) in the PJM Capacity Market demand (VRR) curve. Applying a weaker standard effectively subsidizes inflexible units by paying them based on inflexible parameters that result from lack of investment and that could be made more flexible. The result inflates uplift costs, suppresses energy prices, and is an incentive to inflexibility.

It is not appropriate to accept that inflexible units should be paid uplift based on inflexible offers. The question of why units make inflexible offers should be addressed directly. Are units inflexible because they are old and inefficient, because owners have not invested in increased flexibility or because they serve as a mechanism for the exercise of market power? The question of why the inflexible unit was built, whether it was built under cost of service regulation and whether it is efficient to retain the unit should be answered directly. The question of how to provide market incentives for investment in flexible units and for investment in increased flexibility of existing units should be addressed directly. The question of whether inflexible units should be paid uplift at all should be addressed directly. Marginal cost pricing without paying uplift to inflexible units would create incentives for market participants to provide flexible solutions including replacing inefficient units with flexible, efficient units.

Implementing combined cycle modeling, to permit the energy market model optimization to take advantage of the versatility and flexibility of combined cycle technology in commitment and dispatch, would provide significant flexibility without requiring a distortion of the market rules. Such modeling should not be used as an excuse to eliminate market power mitigation or an excuse to permit inflexible offers to be paid uplift. There are defined steps that could and should be taken

immediately to improve the modeling of combined cycle plants that do not require investment in combined cycle modeling software, including modeling soak time, and accurately accounting for transition times to power augmentation offer segments.

The reduction of uplift payments should not be a goal to be achieved at the expense of the fundamental logic of the LMP system. For example, the use of closed loop interfaces to reduce uplift should be eliminated because it is not consistent with LMP fundamentals and constitutes a form of subjective price setting. The same is true of fast start pricing. The same is true of PJM's proposals to modify the ORDC in order to increase energy prices and reduce uplift.

Accurate short run price signals, equal to the short run marginal cost of generating power, provide market incentives for cost minimizing production to all economically dispatched resources and provide market incentives to load based on the marginal cost of additional consumption. The objective of efficient short run price signals is to minimize system production costs, not to minimize uplift. Repricing the market to reflect commitment costs creates a tradeoff between minimizing production costs and reduction of uplift. The tradeoff exists because when commitment costs are included in prices, the price signal no longer equals the short run marginal cost and therefore no longer provides the correct signal for efficient behavior for market participants making decisions on the margin, whether resources, load, interchange transactions, or virtual traders. This tradeoff now exists based on PJM's recently implemented fast start pricing approach.<sup>6</sup> Fast start pricing affects uplift calculations by introducing a new category of uplift in the balancing market, and changing the calculation of uplift in the day-ahead market.

When units receive substantial revenues through energy uplift payments, these payments are not fully transparent to the market, in part because of the current confidentiality rules. As a result, other market participants, including generation and transmission developers, do not have the opportunity to compete to displace them. As a result, substantial energy uplift payments to a concentrated group of units and organizations have persisted. FERC Order No. 844 authorized the publication of unit specific

<sup>6</sup> Fast start pricing was approved by FERC and implemented on September 1, 2021. See 173 FERC ¶ 61,244 (2020).



uplift payments for credits incurred after July 1, 2019.<sup>7</sup> However, Order No. 844 failed to require the publication of unit specific uplift credits for the largest units receiving significant uplift payments, inflexible steam units committed for reliability by PJM in the day-ahead market.

Uplift payments could be significantly reduced by reversing many of the changes that have been made to the original basic uplift rules. The goal of uplift is to ensure that competitive energy and ancillary service market outcomes do not require efficient resources operating for the PJM system, at the direction of PJM, to operate at a loss. In the original PJM design, uplift was calculated on a daily basis, including all costs and net revenues. But that rule was changed to use only segments of the day. The result is to overstate uplift payments because units may be paid uplift for a day in which their net revenues exceed their costs. In the original PJM design, all net revenues from energy and ancillary services were an offset to uplift payments. That rule was changed to eliminate net revenue from the regulation market. The result is to overstate uplift payments, for no logical reason.

Uplift payments could also be significantly reduced to a more efficient level by eliminating all day-ahead operating reserve credits. It is illogical and unnecessary to pay units day-ahead operating reserve credits because units do not incur any costs to run and any revenue shortfalls are addressed by balancing generator credits.

PJM needs to pay substantially more attention to the details of uplift payments including accurately tracking whether units are following dispatch, identifying the actual need for units to be dispatched out of merit and determining whether better definitions of constraints would be a more market based approach. PJM pays uplift to units even when they do not operate as requested by PJM, i.e. when units do not follow dispatch. PJM uses dispatcher logs as a primary screen to determine if units are eligible for uplift regardless of how they actually operate or if they followed the PJM dispatch signal. The reliance on dispatcher logs for this purpose is impractical, inefficient, and incorrect. PJM needs to define and implement systematic and verifiable rules for determining when units are following dispatch as

a primary screen for eligibility for uplift payments. PJM should not pay uplift to units that do not follow dispatch. PJM continues to pay uplift to units that do not follow dispatch. PJM and the MMU are actively working together to revise the definition of following dispatch to address these issues.

The MMU notifies PJM and generators of instances in which, based on the PJM dispatch signal and the real-time output of the unit, it is clear that the unit did not operate as requested by PJM. The MMU sends requests for resettlements to PJM to make the units with the most extreme overpayments ineligible for uplift credits. Since 2018, the MMU has requested that PJM require the return of \$17.9 million of incorrect uplift credits of which PJM has agreed and resettled only \$3.9 million over the last two years, or 22.0 percent. In addition, PJM has refused to accept the return of incorrectly paid uplift credits by generators when the MMU has identified such cases and generators offer to repay the credits.

While energy uplift charges are an appropriate part of the cost of energy, market efficiency would be improved by ensuring that the level and variability of these charges are as low as possible consistent with the reliable operation of the system and consistent with pricing at short run marginal cost. The goal should be to minimize the total incurred energy uplift charges and to increase the transactions over which those charges are spread in order to reduce the impact of energy uplift charges on markets. The result would be to reduce the level of per MWh charges, to reduce the uncertainty associated with uplift charges and to reduce the impact of energy uplift charges on decisions about how and when to participate in PJM markets. The result would also be to increase incentives for flexible operation and to decrease incentives for the continued operation of inflexible and uneconomic resources. PJM does not need a new flexibility product. PJM needs to provide incentives to existing and new entrant resources to unlock the significant flexibility potential that already exists, to end incentives for inflexibility and to stop creating new incentives for inflexibility.

<sup>7</sup> On June 21, 2019, FERC accepted PJM's Order No. 844 compliance filing. 166 FERC ¶ 61,210 (2019). The filing stated that PJM would begin posting unit specific uplift reports on May 1, 2019. On April 8, 2019, PJM filed for an extension on the implementation date of the zonal uplift reports and unit specific uplift reports to July 1, 2019. On June 28, 2019, FERC accepted PJM's request for extension of effective dates. 167 FERC ¶ 61,280 (2019).

## Energy Uplift Credits

The level of energy uplift credits paid to specific units depends on the level of the resource's energy offer, the LMP, the resource's operating parameters and the decisions of PJM operators. Energy uplift credits result in part from decisions by PJM operators, who follow reliability requirements and market rules, to start resources or to keep resources operating even when LMP is less than the offer price including incremental, no load and startup costs. Energy uplift payments also result from units' operational parameters that require PJM to schedule or commit resources when they are not economic. Energy uplift payments currently also result, incorrectly, from decisions by units to maintain an output level not consistent with PJM dispatch instructions. The resulting costs not covered by energy revenues are collected as energy uplift credits.

The day-ahead operating reserves category includes multiple credit types that are paid to resources cleared uneconomically in the day-ahead market. These resources include generators, imports, and load response.

The balancing operating reserves category includes multiple credit types based on the service provided by the resources. These credit types, paid to compensate for uneconomic generation in the balancing market, include generator credits, lost opportunity cost credits, dispatch differential lost opportunity cost credits, local constraint control credits, load response credits, import credits, and canceled resource credits. The largest credit type in the balancing operating reserves category is balancing generator credits. The reactive services category includes multiple credit types. Black start services credits exist to compensate resources for black start services in the day-ahead and balancing markets, as well as testing. Starting with this report, black start credits and local constraint credits are not broken out individually and are included in the category of balancing generator credits, matching PJM's Market Settlements Reporting System.

Table 4-1 shows the uplift totals for each credit category during 2023 and 2024.<sup>8</sup> In 2024, energy uplift credits increased by \$113.0 million or 72.0 percent compared to 2023. PJM commitment and dispatch decisions associated with Winter Storm Gerri caused significant increases in day-ahead generator credits, balancing generator credits, and lost opportunity cost credits.

The dispatch differential lost opportunity cost is a credit that exists only as a result of fast start pricing. This credit is paid to flexible resources that are artificially dispatched down below the level that is economic at fast start prices, in order to accommodate inflexible fast start resources. Fast start pricing was introduced on September 1, 2021.

**Table 4-1 Energy uplift credits by category: 2023 and 2024<sup>9</sup>**

Category	Type	2023 Credits (Millions)	2024 Credits (Millions)	Change	Percent Change	2023 Share	2024 Share
Day-Ahead	Generators	\$50.3	\$115.2	\$64.9	129.0%	32.1%	42.7%
Balancing	Generators	\$83.0	\$120.5	\$37.5	45.2%	52.9%	44.6%
	Canceled Resources	\$0.1	\$0.1	\$0.0	41.5%	0.0%	0.0%
	Lost Opportunity Cost	\$22.5	\$31.2	\$8.7	38.5%	14.4%	11.6%
	Dispatch Differential Lost Opportunity Cost	\$1.0	\$1.9	\$1.0	104.8%	0.6%	0.7%
Synchronous Condensing	Synchronous Condensing	\$0.0	\$0.0	\$0.0	NA	0.0%	0.0%
	Synchronous Condensing Lost Opportunity Cost	\$0.0	\$0.0	\$0.0	NA	0.0%	0.0%
Reactive Services	Generators	\$0.0	\$0.9	\$0.9	3,500.9%	0.0%	0.3%
	Lost Opportunity Cost	\$0.0	\$0.0	\$0.0	229,551.7%	0.0%	0.0%
	Condensing	\$0.0	\$0.0	(\$0.0)	(100.0%)	0.0%	0.0%
	Condensing Lost Opportunity Cost	\$0.0	\$0.0	(\$0.0)	(100.0%)	0.0%	0.0%
<b>Total</b>		<b>\$156.9</b>	<b>\$269.9</b>	<b>\$113.0</b>	<b>72.0%</b>	<b>100.0%</b>	<b>100.0%</b>

<sup>8</sup> Billing data can be modified by PJM Settlements at any time to reflect changes in the evaluation of energy uplift. The billing data reflected in this report were current on January 28, 2025.

<sup>9</sup> Year to year change is rounded to one tenth of a million, and includes values less than \$0.05 million.

## Categories of Credits and Charges

Energy uplift charges include day-ahead and balancing operating reserves, reactive services, synchronous condensing and black start services categories. Uplift credits paid to individual participants are paid for by charges to the groups of PJM market participants. The groups of participants charged varies depending on the type of uplift credit. For this reason, operating reserve charges do not always have the same value as operating reserve credits, since not all categories of uplift credits are paid for by the same PJM participants. For example, in the case of local constraint credits, credits are paid to generators in the form of balancing operating reserve credits but charges are allocated as local constraint charges. The same applies in the case of units scheduled day ahead for reactive support, for which the credits are paid in the form of day-ahead operating reserve credits but charges are allocated as reactive services charges. Table 4-2 and Table 4-3 show the categories of credits and charges and their relationships.

For example, in Table 4-2, day-ahead operating reserve credits for generators are paid for by day-ahead operating reserve charges. Those charges are paid for by market participants in proportion to their day-ahead load, day-ahead exports, and virtual transactions (DECs and UTCs). The charges are aggregated over the entire RTO region. Balancing generator reserve credits are paid for by two different types of charges: balancing operating reserve charges for reliability and balancing operating reserve charges for deviations. Charges for reliability are paid for by PJM members in proportion to their real-time load and real-time export transactions. Reliability charges are aggregated regionally over the entire RTO region, within the Western region, or within the Eastern region. Balancing operating reserve charges for deviations are paid for by PJM members in proportion to their deviations, which includes virtuals (INCs and DECs), UTCs, load, and interchange. The deviation charges are aggregated regionally over the entire RTO region, within the Western region, and within the Eastern region. Lost opportunity cost credits are paid for by balancing operating reserve charges for deviations. The charges for deviations are paid for by PJM members in proportion to their deviations, which includes virtuals (INCs and DECs), UTCs, load, and interchange. The deviation charges are aggregated regionally over the entire RTO region.

Starting with this report, black start credits and local constraint credits are not broken out individually and are included in the category of balancing generator credits. Similarly, cancellation charges, lost opportunity charges, and dispatch differential lost opportunity cost charges are not broken out individually and are included in the category of balancing generator charges.

Table 4-3 shows the relationship between credits and charges for resources providing reactive, synchronous condensing, and black start services. For example, the five sub-categories of reactive services credits (day-ahead operating reserves, generator, LOC, condensing, and synchronous condensing LOC) are paid by two different charge categories: reactive service charges and local constraint reactive services. The reactive service charges are paid by PJM members in proportion to their zonal real-time load, while the local constraint reactive service charges are paid for by transmission owners.

Table 4-2 Day-ahead and balancing operating reserve credits and charges

DAY-AHEAD	Credit Category	Charges Category	Charge Responsibility	Geographic Charge Aggregation
	Day-Ahead Operating Reserve Transaction	Day-Ahead Operating Reserves for Transactions	Day-Ahead Load, Day-Ahead Exports, DECs & UTCs	RTO Region
	Day-Ahead Operating Reserve Generator	Day-Ahead Operating Reserve for Generators		
	Day-Ahead Operating Reserves for Load Response	Day-Ahead Operating Reserve for Load Response		
	Unallocated Negative Load Congestion Charges	Unallocated Congestion		
	Unallocated Positive Generation Congestion Credits			
BALANCING	Balancing Generator Reserves	Balancing Operating Reserve for Reliability	Real-Time Load plus Real-Time Export Transactions	RTO, Eastern, and Western Region
		Balancing Operating Reserve for Deviations	Deviations (includes virtual bids, UTCs, load, and interchange)	
	Dispatch Differential Lost Opportunity Cost (DDLOC)	Balancing Operating Reserve for Deviations	Real-Time Load plus Real-Time Export Transactions	RTO Region
	Canceled Resources	Balancing Operating Reserve for Deviations	Deviations (includes virtual bids, UTCs, load, and interchange)	
	Lost Opportunity Cost (LOC)			
	Real-Time Import Transactions			
	Balancing Operating Reserves for Load Response	Balancing Operating Reserve for Load Response	Deviations (includes virtual bids, UTCs, load, and interchange)	
	Local Constraints Control	NA	Transmission Owner	NA

Table 4-3 Reactive services, synchronous condensing and black start services credits and charges

	Credits Category	Charges Category	Charge Responsibility
Reactive	Day-Ahead Operating Reserve	Reactive Services Charge	Zonal Real-Time Load
	Generator Reactive Services		
	LOC Reactive Services		
	Condensing Reactive Services	Local Constraint Reactive Services	Transmission owner
	Synchronous Condensing LOC Reactive Services		
Synchronous Condensing	Synchronous Condensing	Synchronous Condensing	Real-Time Load
	Synchronous Condensing LOC		Real-Time Export Transactions
Black Start	Day-Ahead Operating Reserve	Black Start Service Charge	Zone/Non-zone Peak Transmission Use and Point to Point Transmission Reservations
	Balancing Operating Reserve		
	Black Start Testing		
	Black Start LOC		

## Types of Units

Table 4-4 shows the distribution of total energy uplift credits by unit type in 2024 and 2023. A combination of factors led to overall increased uplift payments.

The longstanding rule which inexplicably exempted CTs from the otherwise generally applicable rules governing the payment of uplift credits was terminated effective November 1, 2022. Prior to November 1, CTs were paid uplift regardless of their output and regardless of whether they followed dispatch and as a result, CTs had no incentive to follow PJM dispatch signals.

Uplift credits paid to combustion turbines increased by \$27.7 million or 30.0 percent during 2024 compared to 2023. In 2024, CTs received 82.2 percent of lost opportunity cost credits. Lost opportunity cost credits increased by \$8.7 million or 38.5 percent compared to 2023.

Uplift credits paid to steam coal units increased by \$27.1 million or 80.0 percent in 2024 compared to 2023. In 2024, day-ahead credits in the PEPCO and BGE Zones made up 85.2 percent of total day-ahead credits and account for 80.0 percent of the increase in day-ahead operating reserves over the course of 2024.

Uplift credits paid to non-coal (gas or oil fired) steam units increased by \$49.4 million or 226.7 percent in 2024 compared to 2023. In 2024, gas or oil fired steam units received \$71.1 million, 26.4 percent of total credits, compared

to \$21.8 million and 13.9 percent during 2023. In 2024, the day-ahead operating reserves paid to gas or oil fired steam units was 238.6 percent higher than in 2023, and account for 64.0 percent of the total increase in day-ahead operating reserves. The increase in balancing generator credits paid to gas or oil fired steam units in the BGE and AEP Zones accounts for 42.7 percent of the overall increase in balancing generator credits in 2024.

Uplift credits paid to combined cycle units increased by \$6.6 million or 127.2 percent in 2024 compared to 2023. This increase occurred primarily in January 2024 because Winter Storm Gerri led PJM to increase day-ahead commitments. Winter Storm Gerri accounts for 52.7 percent of the uplift credits paid to combined cycle units.

In 2024, uplift credits to wind units were \$2.6 million, up by 62.2 percent compared to 2023.

**Table 4-4 Total energy uplift credits by unit type: 2023 and 2024<sup>10 11</sup>**

Unit Type	2023 Credits (Millions)	2024 Credits (Millions)	Change	Percent Change	2023 Share	2024 Share
Combined Cycle	\$5.2	\$11.8	\$6.6	127.2%	3.3%	4.4%
Combustion Turbine	\$92.2	\$119.9	\$27.7	30.0%	58.8%	44.4%
Diesel	\$1.7	\$2.0	\$0.3	19.7%	1.1%	0.7%
Hydro	\$0.2	\$1.1	\$0.9	410.6%	0.1%	0.4%
Nuclear	\$0.0	\$0.0	\$0.0	10,476.0%	0.0%	0.0%
Solar	\$0.3	\$0.3	\$0.0	0.6%	0.2%	0.1%
Steam – Coal	\$33.9	\$61.1	\$27.1	80.0%	21.6%	22.6%
Steam – Other	\$21.8	\$71.1	\$49.4	226.7%	13.9%	26.4%
Wind	\$1.6	\$2.6	\$1.0	62.2%	1.0%	1.0%
Total	\$156.9	\$269.9	\$113.0	72.0%	100.0%	100.0%

Table 4-5 shows the distribution of energy uplift credits by category and by unit type in 2024. The largest share of day-ahead credits, 45.2 percent, went to steam units. Steam units tend to be longer lead time units that are committed before the operating day. If a steam unit is needed for reliability and it is uneconomic, it will be committed in the day-ahead energy market and receive day-ahead uplift credits. The PJM market rules permit combustion turbines (CT), unlike other unit types, to be committed and decommitted in the real-time market. As a result of the rules and the characteristics of CT offers, CTs received 76.1 percent of balancing credits and 82.2 percent of lost opportunity cost credits. Combustion turbines committed in the real-time market may be paid balancing credits due to inflexible operating parameters, volatile real-time LMPs, and intraday segment settlements. Combustion turbines committed in the day-ahead market but not committed in real time receive lost opportunity credits to cover the profits they would have made had they operated in real time.

**Table 4-5 Energy uplift credits by unit type: 2024**

Unit Type	Day-Ahead Generator	Balancing Generator	Canceled Resources	Lost Opportunity Cost	Reactive Services	Synchronous Condensing	Dispatch Differential Lost Opportunity Cost
Combined Cycle	2.4%	5.6%	0.0%	5.7%	0.4%	NA	22.1%
Combustion Turbine	1.1%	76.1%	0.0%	82.2%	94.0%	NA	15.7%
Diesel	0.0%	1.0%	0.0%	2.2%	0.9%	NA	0.7%
Hydro	0.0%	0.0%	0.0%	0.0%	0.0%	NA	55.8%
Nuclear	0.0%	0.0%	0.0%	0.0%	0.0%	NA	0.0%
Solar	0.0%	0.0%	0.0%	0.8%	0.0%	NA	0.7%
Steam – Coal	45.2%	7.1%	100.0%	0.6%	4.8%	NA	4.9%
Steam – Other	51.2%	10.0%	0.0%	0.4%	0.0%	NA	0.4%
Wind	0.0%	0.1%	0.0%	8.1%	0.0%	NA	1.5%
Battery	0.0%	0.0%	0.0%	0.0%	0.0%	NA	0.0%
Total (Millions)	\$115.2	\$120.5	\$0.1	\$31.2	\$1.0	\$0.0	\$1.9

<sup>10</sup> Table 4-4 does not include balancing imports credits and load response credits in the total amounts.

<sup>11</sup> Solar units should be ineligible for all uplift payments because they do not follow PJM's dispatch instructions. The MMU notified PJM of the discrepancy.



## Day-Ahead Unit Commitment for Reliability

PJM can schedule units as must run in the day-ahead energy market that would otherwise not have been committed in the day-ahead market, when needed in real time to address reliability issues. Such reliability issues include thermal constraints, reactive transfer interface constraints, and reactive service.<sup>12</sup> Units committed for reliability by PJM are eligible for day-ahead operating reserve credits and may set LMP if raised above economic minimum and follow the dispatch signal. Participants can submit units as self scheduled (must run), meaning that the unit must be committed, but a unit submitted as self scheduled by a participant is not eligible for day-ahead operating reserve credits.<sup>13</sup>

Pool scheduled units are units that submit offers to sell energy in the day-ahead market. Units committed for reliability by PJM are units that are committed to satisfy reliability needs, regardless of whether the offers are economic. Self scheduled units are self committed by the generation owner and are not eligible for uplift. Pool scheduled units and units committed for reliability are made whole in the day-ahead energy market if their total cost-based offer (including no load and startup costs) is greater than the revenues from the day-ahead energy market. Such units are paid day-ahead uplift (operating reserve credits).

It is illogical and unnecessary to pay units day-ahead operating reserves because units do not incur any costs to run in the day-ahead market and any revenue shortfalls are addressed by balancing operating reserve payments.

## Balancing Operating Reserve Credits/ Balancing Generator Credits

Balancing operating reserve (BOR) credits are paid to resources that operate as requested by PJM that do not recover all of their operating costs from market revenues. Balancing operating reserves include multiple credit types that are paid to units in the balancing market, such as generator credits, lost opportunity cost credits, dispatch differential lost opportunity cost credits, local constraints control credits, load response credits, import credits, and canceled resource credits. Balancing generator credits are the largest category of balancing operating reserves. Balancing generator credits are calculated by hourly

segments as the difference between a resource's revenues (day-ahead market, balancing market, reserve markets, reactive service credits, and day-ahead operating reserve credits but excluding regulation revenues) and its real-time offer (startup, no load, and incremental energy offer). Segments for balancing generator credits are defined as the greater of the day-ahead schedule and the unit's minimum run time. Intervals in excess of the minimum run time are treated as new segments. Table 4-5 shows that combustion turbines (CTs) received 76.1 percent of all balancing generator credits in 2024, or \$91.73 million.

Uplift is higher than necessary because settlement rules do not include all revenues and costs for the entire day. Uplift is also higher than necessary because settlement rules do not disqualify units from receiving uplift when they do not follow PJM's dispatch instructions. PJM apparently considers units that start when requested and turn off when requested to be operating as requested by PJM regardless of how well the units follow the dispatch signal.<sup>14</sup> Units should be disqualified from receiving uplift when the units do not follow dispatch instructions, block load or self schedule.

PJM's position on the payment of uplift is illogical and PJM's definition of units not operating as requested is illogical. The logical definition of operating as requested includes both start and shutdown when requested and that units follow their dispatch signal. Both should be required in order to receive uplift. Paying uplift to units not following dispatch does not provide an incentive for flexibility. The MMU recommends that PJM develop and implement an accurate metric to define when a unit is following dispatch, instead of relying on PJM dispatchers' manual determinations, to evaluate eligibility for receiving balancing generator credits and for assessing generator deviations. As part of the metric, the MMU recommends that PJM designate units whose offers are flagged for fixed generation in Markets Gateway as not eligible for uplift. Units that are flagged for fixed generation are not dispatchable. Following dispatch is an eligibility requirement for uplift compensation.

Table 4-1 shows that balancing generator credits increased by 37.5 percent in 2024 compared to 2023.

<sup>12</sup> See OA Schedule 1 § 3.2.3(b).

<sup>13</sup> See OA Schedule 1 § 3.2.3(a).

<sup>14</sup> See "Operating Reserve Make Whole Credit Education," slide 13, PJM presentation to the Resource Adequacy Senior Task Force. (April 13, 2022) <<https://pjm.com/-/media/committees-groups/committees/mic/2022/20220413/item-11a---operating-reserve-make-whole-credits-education.ashx>>.

CTs that operate on a day-ahead schedule tend to receive lower balancing generator credits because it is more likely that the day-ahead LMPs will support (prices above offer) committing the units. Day-ahead LMPs support committing the units because the day-ahead model optimizes the system for all 24 hours, unlike in real time when PJM uses ITSCEd to optimize CT commitments with an approximately two hour look ahead. In addition, uplift rules continue to define all day-ahead scheduled hours as one segment for the uplift calculation (in which profits and losses during all hours offset each other). The shorter segments in real-time are defined by the minimum run time and allow for fewer offsets, resulting in greater amounts of uplift. Losses during the minimum run time segment are not offset by profits made in other segments on that day.

There are multiple reasons why the commitment of CTs is different in the day-ahead and real-time markets, including differences in the hourly pattern of load, and differences in interchange transactions. Modeling differences between the day-ahead and real-time markets also affect CT commitment, including: the modeling of different transmission constraints in the day-ahead and real-time market models; the exclusion of soak time for generators in the day-ahead market model; and the different optimization time periods used in the day-ahead and real-time markets.

## Lost Opportunity Cost Credits

Balancing operating reserve lost opportunity cost (LOC) credits are intended to provide an incentive for units to follow PJM's dispatch instructions when PJM's dispatch instructions deviate from a unit's desired or scheduled output. LOC credits are paid under two scenarios.<sup>15</sup> The first scenario occurs if a unit of any type generating in real time with an offer price lower than the real-time LMP at the unit's bus is manually reduced or suspended by PJM due to a transmission constraint or other reliability issue. In this scenario the unit will receive a credit for LOC based on its desired output. Such units are not actually forgoing an option to increase output because the reliability

of the system and in some cases the generator depend on reducing output. This LOC is referred to as real-time LOC. The second scenario occurs if a combustion turbine or diesel engine clears the day-ahead energy market, but is not committed in real time. In this scenario the unit will receive a credit which covers any lost profit in the day-ahead financial position of the unit plus the balancing energy market position. This LOC is referred to as day-ahead LOC.

Table 4-6 shows monthly day-ahead and real-time LOC credits in 2023 and 2024. In 2024, LOC credits increased by \$8.8 million or 38.3 percent compared to 2023. The increase was comprised of a \$6.1 million increase in day-ahead LOC and \$2.6 million increase in real-time LOC.

In 2024, wind units received \$2.6 million of uplift, up by \$1.0 million compared to 2023. Wind units that are capacity resources are now required to procure Capacity Interconnection Rights (CIRs) equal to the maximum facility output included in the calculation of their ELCC value. Wind units that are not capacity resources are not required to procure CIRs equal to the maximum facility output, but are paid uplift when PJM requests that the units reduce output below the maximum facility output but above the CIR level. Units do not have a right to inject power at levels greater than the CIR level that they pay for and therefore should not be paid uplift when system conditions do not permit output at a level greater than the CIR. The real-time lost opportunity costs credits paid to wind units should be based on the lowest of the desired output, the estimated output based on actual wind conditions, or the capacity interconnection rights (CIRs).

**Table 4-6 Monthly lost opportunity cost credits<sup>16</sup> (Millions): 2023 and 2024**

	2023			2024		
	Day-Ahead Lost Opportunity Cost	Real-Time Lost Opportunity Cost	Total	Day-Ahead Lost Opportunity Cost	Real-Time Lost Opportunity Cost	Total
Jan	\$1.9	\$0.0	\$1.9	\$0.8	\$0.3	\$1.1
Feb	\$0.6	\$0.4	\$1.0	\$0.8	\$0.1	\$0.9
Mar	\$0.7	\$0.0	\$0.7	\$1.6	\$0.2	\$1.8
Apr	\$1.3	\$1.1	\$2.5	\$1.4	\$0.7	\$2.2
May	\$1.5	\$0.0	\$1.5	\$1.4	\$0.5	\$2.0
Jun	\$1.1	\$0.3	\$1.5	\$3.4	\$0.5	\$3.9
Jul	\$4.2	\$0.2	\$4.4	\$6.4	\$0.2	\$6.6
Aug	\$2.2	\$0.0	\$2.3	\$4.7	\$0.8	\$5.5
Sep	\$2.0	\$0.5	\$2.5	\$1.8	\$0.2	\$2.0
Oct	\$1.3	\$0.4	\$1.6	\$1.9	\$0.3	\$2.2
Nov	\$1.1	\$0.1	\$1.1	\$0.6	\$0.3	\$0.9
Dec	\$1.9	\$0.0	\$2.0	\$0.9	\$1.7	\$2.6
Total	\$19.8	\$3.1	\$22.9	\$26.0	\$5.7	\$31.6
Share	86.7%	13.3%	100.0%	82.1%	17.9%	100.0%

<sup>15</sup> Desired output is defined as the MW on the generator's offer curve consistent with the LMP at the generator's bus.

<sup>16</sup> Table 4-6 does not include pumped hydro lost opportunity cost credits in Real-Time Lost Opportunity Cost Credits.

## Energy Uplift Charges

### Energy Uplift Charges

Table 4-7 shows that energy uplift charges for 2024 were \$269.3 million, or 0.5 percent of total PJM billing. Table 4-7 shows annual total energy uplift charges increased by 72.3 percent compared to 2023.

**Table 4-7 Total energy uplift charges: 2001 through 2024**

	Total Energy Uplift Charges (Millions)	Change (Millions)	Percent Change	Energy Uplift as a Percent of Total PJM Billing
2001	\$284.0	\$67.0	30.9%	8.5%
2002	\$273.7	(\$10.3)	(3.6%)	5.8%
2003	\$376.5	\$102.8	37.6%	5.4%
2004	\$537.6	\$161.1	42.8%	6.1%
2005	\$712.6	\$175.0	32.6%	3.1%
2006	\$365.6	(\$347.0)	(48.7%)	1.7%
2007	\$503.3	\$137.7	37.7%	1.6%
2008	\$474.3	(\$29.0)	(5.8%)	1.4%
2009	\$322.7	(\$151.6)	(32.0%)	1.2%
2010	\$623.2	\$300.5	93.1%	1.8%
2011	\$603.4	(\$19.8)	(3.2%)	1.7%
2012	\$649.8	\$46.4	7.7%	2.2%
2013	\$843.0	\$193.2	29.7%	2.5%
2014	\$961.2	\$118.2	14.0%	1.9%
2015	\$312.0	(\$649.2)	(67.5%)	0.7%
2016	\$136.7	(\$175.3)	(56.2%)	0.4%
2017	\$127.3	(\$9.4)	(6.9%)	0.3%
2018	\$198.2	\$70.9	55.7%	0.4%
2019	\$88.5	(\$109.7)	(55.3%)	0.2%
2020	\$90.9	\$2.4	2.7%	0.3%
2021	\$178.4	\$87.5	96.3%	0.3%
2022	\$284.5	\$106.1	59.5%	0.3%
2023	\$156.3	(\$128.2)	(45.1%)	0.3%
2024	\$269.3	\$113.0	72.3%	0.5%

Table 4-8 shows total energy uplift charges by category for 2023 and 2024. The increase of \$113.0 million is comprised of a \$65.0 million increase in day-ahead operating reserve charges, a \$46.5 million increase in balancing generator charges, a \$0.8 million increase in reactive service charges, a \$0.7 million increase in local congestion charges, and a decrease of less than \$0.1 million in synchronous condensing charges. Starting with this report, cancellation charges, lost opportunity charges, and dispatch differential lost opportunity cost charges are not broken out individually and will be included in the category of balancing generator charges, matching PJM's Market Settlements Reporting System.

**Table 4-8 Total energy uplift charges by category: 2023 and 2024<sup>17</sup>**

Category	2023 Charges (Millions)	2024 Charges (Millions)	Change (Millions)	Percent Change
Day-Ahead Operating Reserves	\$49.7	\$114.7	\$65.0	130.7%
Balancing Operating Reserves	\$105.6	\$152.1	\$46.5	44.0%
Reactive Services	\$0.1	\$0.9	\$0.8	1,024.9%
Black Start Services	\$0.3	\$0.3	\$0.0	1.3%
Local Congestion Charges	\$0.6	\$1.3	\$0.7	121.7%
Total	\$156.3	\$269.3	\$113.0	72.3%
Energy Uplift as a Percent of Total PJM Billing	0.3%	0.5%	0.2%	61.5%

<sup>17</sup> The total PJM billing shown in Table 4-8 is different from the total cost shown in Table 1-9. The total PJM billing in Table 4-8 represents the total dollars that pass through the PJM settlement process, while the total cost shown in Table 1-9 represents the portion of the total billing associated with the cost to load and includes additional costs to load accounted for outside the PJM settlement process.

Table 4-9 compares monthly energy uplift charges by category for 2023 and 2024.

**Table 4-9 Monthly energy uplift charges: 2023 through 2024**

	2023 Charges (Millions)						2024 Charges (Millions)					
	Day-Ahead	Balancing	Reactive Services	Local Congestion	Black Start Services	Total	Day-Ahead	Balancing	Reactive Services	Local Congestion	Black Start Services	Total
Jan	\$1.7	\$5.5	\$0.0	\$0.0	\$0.0	\$7.2	\$32.7	\$23.9	\$0.9	\$0.2	\$0.0	\$57.6
Feb	\$1.0	\$3.5	\$0.0	\$0.1	\$0.1	\$4.7	\$1.2	\$5.44	\$0.0	\$0.0	\$0.1	\$6.8
Mar	\$1.3	\$4.7	\$0.0	\$0.0	\$0.1	\$6.2	\$1.1	\$10.75	\$0.0	\$0.0	\$0.0	\$12.0
Apr	\$2.0	\$13.0	\$0.0	\$0.0	\$0.1	\$15.1	\$12.1	\$19.34	\$0.0	\$0.1	\$0.0	\$31.6
May	\$0.4	\$10.9	\$0.0	\$0.0	\$0.0	\$11.3	\$12.5	\$20.94	\$0.0	\$0.0	\$0.0	\$33.5
Jun	\$1.8	\$6.6	\$0.0	\$0.4	\$0.0	\$8.8	\$14.4	\$12.65	\$0.0	\$1.0	\$0.0	\$28.1
Jul	\$10.6	\$12.5	\$0.0	\$0.0	\$0.0	\$23.1	\$8.4	\$11.50	\$0.0	\$0.0	\$0.0	\$19.9
Aug	\$12.0	\$6.4	\$0.0	\$0.0	\$0.0	\$18.5	\$6.9	\$10.90	\$0.0	\$0.0	\$0.0	\$17.8
Sep	\$11.9	\$8.9	\$0.0	\$0.0	\$0.0	\$20.9	\$4.4	\$6.88	\$0.0	\$0.0	\$0.0	\$11.3
Oct	\$2.8	\$13.7	\$0.1	\$0.0	\$0.0	\$16.7	\$6.4	\$9.0	\$0.0	\$0.0	\$0.0	\$15.4
Nov	\$3.7	\$12.4	\$0.0	\$0.0	\$0.0	\$16.1	\$3.2	\$8.8	\$0.0	\$0.0	\$0.0	\$12.0
Dec	\$0.4	\$7.4	\$0.0	\$0.0	\$0.0	\$7.9	\$11.3	\$12.1	\$0.0	\$0.0	\$0.0	\$23.4
Total	\$49.7	\$105.61	\$0.1	\$0.6	\$0.3	\$156.3	\$114.7	\$152.1	\$0.9	\$1.3	\$0.3	\$269.3
Share	31.8%	67.6%	0.1%	0.4%	0.2%	100.0%	42.6%	56.5%	0.3%	0.5%	0.1%	100.0%

Table 4-10 shows the composition of the balancing operating reserve charges. Balancing operating reserve charges consist of balancing operating reserve reliability charges (credits to generators), balancing operating reserve deviation charges (credits to generators and import transactions), balancing operating reserve charges for economic load response and balancing local constraint charges. Balancing operating reserve charges increased by \$46.1 million or 43.8 percent in 2024 compared to 2023.

**Table 4-10 Balancing operating reserve charges: 2023 and 2024**

Category	2023 Charges (Millions)	2024 Charges (Millions)	Change	Percent Change	2023 Share	2024 Share
Balancing Operating Reserve Reliability Charges	\$41.0	\$62.0	\$21.0	51.1%	39.0%	41.0%
Balancing Operating Reserve Deviation Charges	\$63.6	\$88.0	\$24.4	38.4%	60.4%	58.1%
Balancing Operating Reserve Charges for Load Response	\$0.0	\$0.0	\$0.0	NA	0.0%	0.0%
Balancing Local constraint Charges	\$0.6	\$1.3	\$0.7	121.7%	0.6%	0.9%
TOTAL	\$105.3	\$151.4	\$46.1	43.8%	100.0%	100.0%

## Uplift Eligibility

In PJM, units have either a pool scheduled or self scheduled commitment status. Pool scheduled units are committed by PJM while self scheduled units are committed by generation owners. Table 4-11 provides a description of commitment and dispatch status, uplift eligibility and the ability to set price.<sup>18</sup> In the day-ahead energy market only pool scheduled resources are eligible for day-ahead operating reserve credits. A unit may be self scheduled in the day-ahead market and then be pool scheduled and dispatched in subsequent days to remain online, in which case they would be eligible for uplift for the subsequent days. In the real-time energy market only pool scheduled resources that follow PJM's dispatch are defined in the tariff as eligible for balancing operating reserve credits. However, in practice, units receive uplift credits when not following PJM's dispatch signal. Units are paid day-ahead operating reserve credits based on their scheduled operation for the entire day. Balancing operating reserve credits are paid on a segmented basis for each period defined by the greater of the day-ahead schedule and minimum run time. Resources receive day-ahead and balancing operating reserve credits only when they are eligible and unable to recover their operating cost for the day or segment.<sup>19</sup>

**Table 4-11 Dispatch status, commitment status and uplift eligibility<sup>20</sup>**

		Commitment Status	
Dispatch Status	Dispatch Description	Self Scheduled (units committed by the generation owner)	Pool Scheduled and following PJM's dispatch signal (units committed by PJM)
Block Loaded	MWh offered to PJM as a single MWh block which is not dispatchable	Not eligible to receive uplift Not eligible to set LMP	Eligible to receive uplift Not eligible to set LMP unless fast start eligible
Economic Minimum	MWh from the nondispatchable economic minimum component for units that offer a dispatchable range to PJM	Not eligible to receive uplift Not eligible to set LMP	Eligible to receive uplift Not eligible to set LMP unless fast start eligible
Dispatchable	MWh above the economic minimum level for units that offer a dispatchable range to PJM.	Only eligible to receive LOC credits if dispatched down by PJM Eligible to set LMP	Eligible to receive uplift Eligible to set LMP

## Energy Uplift Issues

### Uplift Resettlement

Some units have been incorrectly paid uplift despite not meeting uplift eligibility requirements, including not following dispatch, not having the correct commitment status, or not operating with PLS offer parameters. The MMU has requested that PJM correctly resettle the uplift payments in these cases.<sup>21</sup> Since 2018, the cumulative resettlement requests total \$17.9 million, of which PJM has agreed and resettled only \$3.9 million over the last two years, 22.0 percent, and 1.3 percent are waiting for a PJM response. The remaining 75.8 percent occurred prior to January 2023 and is subject to the OATT's limitation on claims. That limit does not apply and would not have applied if PJM informed the market participant within two years of the occurrence of the issue.<sup>22</sup> PJM should inform market participants of a potential issue when the MMU raises the issue with PJM and the market participant in order to ensure that the issues can be addressed. PJM has refused to accept the voluntary return of incorrectly paid uplift credits by generators when the MMU has identified such cases. The MMU continues to bring new cases to the attention of PJM.

The MMU identifies units that are not following dispatch and that are therefore not eligible to receive uplift payments. These findings are communicated to unit owners and to PJM. The units are identified by comparing their actual generation to the dispatch level that they should have achieved based on the real-time LMP, unit operating parameters (e.g. economic minimum, maximum and ramp rate) and energy offer.

<sup>18</sup> PJM has modified the basic rules of eligibility to set price using its CT price setting logic.

<sup>19</sup> Resources do not recover their operating cost when market revenues for the day are less than the short run marginal cost defined by the startup, no load, and incremental offer curve.

<sup>20</sup> PJM allows block loaded CTs to set LMP by relaxing the economic minimum by 10 to 20 percent using CT price setting logic.

<sup>21</sup> To date, the MMU has only requested resettlement of the most egregious cases.

<sup>22</sup> OATT § 10.4.



## Uplift Forfeiture Rule

The uplift forfeiture rule was introduced in 2000 after PJM observed that in the summer of 1999 units could circumvent the \$1,000/MWh offer cap by submitting high offers associated with a long minimum run time (e.g. 24 hours). The rule states that units will not be paid operating reserve credits when they are scheduled on their price-based offers during maximum generation conditions and their effective energy offer price exceeds \$1,000 per MWh.<sup>23</sup> Maximum generation conditions include maximum generation emergencies, maximum generation emergency alerts, and when PJM schedules units based on the anticipation of a maximum generation emergency or maximum generation emergency alert.

In 2022 and 2023, PJM declared maximum generation conditions on five separate days. During these days, some units received uplift payments in violation of the uplift forfeiture rule. The five days in question are December 23 through 25 of 2022 (Winter Storm Elliott) and July 27 and 28 of 2023. The MMU has determined that balancing operating reserves paid on December 23 and 24 of 2022 should be forfeited. PJM resettled the operating reserve credits paid to units that exceeded an effective offer price of \$1,000 per MWh on December 23 and 24, 2022. The total balancing operating reserve credits returned totaled \$1.7 million. In 2024, PJM declared maximum generation conditions on August 27, however the uplift forfeiture rule was not triggered because no unit was paid uplift with an effective energy price-based offer that exceeded \$1,000 per MWh.

## Regulation Market Offsets

PJM does not include regulation market payments as an offset like other market revenues in the operating reserve calculations. Including regulation market revenues would result in lower uplift calculations. Table 4-12 shows that the regulation market revenues in 2024 were \$107.3 million and that the balancing generator credits for those units receiving regulation revenues was \$10.8 million. The table shows that if the regulation market revenues had been incorporated in the operating reserve calculation as an offset, the adjusted balancing generator payment for those units would have been \$9.3 million instead of \$10.8 million, 11.5 percent lower.

**Table 4-12 Adjusted operating reserve credits: 2024**

Month	Regulation Market Revenues (Millions)	Balancing Generator Credits (Millions)	Adjusted Balancing Generator Credits (Millions)	Difference
Jan	\$12.1	\$3.3	\$3.1	(\$0.2)
Feb	\$5.7	\$0.5	\$0.5	(\$0.0)
Mar	\$6.9	\$0.9	\$0.9	(\$0.1)
Apr	\$6.5	\$1.9	\$1.7	(\$0.2)
May	\$10.3	\$0.9	\$0.8	(\$0.2)
Jun	\$8.6	\$0.5	\$0.4	(\$0.1)
Jul	\$13.0	\$0.4	\$0.2	(\$0.1)
Aug	\$9.3	\$0.4	\$0.3	(\$0.1)
Sep	\$8.0	\$0.4	\$0.3	(\$0.1)
Oct	\$9.0	\$0.5	\$0.3	(\$0.1)
Nov	\$7.5	\$0.5	\$0.4	(\$0.2)
Dec	\$10.4	\$0.7	\$0.6	(\$0.1)
Total	\$107.3	\$10.8	\$9.3	(\$1.5)

<sup>23</sup> See OA Schedule 1 Section 3.2.3 (m) Operating Reserves

## Concentration of Energy Uplift Credits

The recipients of uplift payments are highly concentrated by unit and by company. This concentration results from a combination of unit operating parameters, PJM's persistent need to commit specific units out of merit in particular locations and the fact that a lack of full transparency has made it more difficult for competition to affect these payments.<sup>24</sup>

Table 4-13 shows the concentration of energy uplift credits. The top 10 units received 43.2 percent of total energy uplift credits in 2024. The top 10 companies received 76.0 percent of total energy uplift credits in the first nine months of 2024.

**Table 4-13 Top 10 units and organizations energy uplift credits: 2024**

Category	Type	Top 10 Units		Top 10 Organizations	
		Credits (Millions)	Credits Share	Credits (Millions)	Credits Share
Day-Ahead	Generators	\$103.8	90.2%	\$12.0	10.4%
	Canceled Resources	\$0.1	100.0%	\$0.1	100.0%
Balancing	Generators	\$17.9	14.9%	\$86.1	71.4%
	Lost Opportunity Cost	\$5.8	18.7%	\$20.7	66.2%
	Dispatch Differential Lost Opportunity Cost	\$1.2	59.2%	\$1.7	85.5%
	Total Balancing	\$25.0	16.2%	\$108.5	70.5%
Reactive Services		\$0.9	95.1%	\$0.0	0.0%
Total		\$116.6	43.2%	\$205.2	76.0%

## Unit Specific Uplift Payments

FERC Order No. 844 allows PJM and the MMU to publish unit specific uplift payments by category by month. Table 4-14 through Table 4-18 show the top 10 recipients of total uplift, day-ahead operating reserve credits and lost opportunity cost credits.

Brandon Shores 1 and Brandon Shores 2 and Wagner 3 and Wagner 4 submitted retirement notifications to PJM and the MMU in April<sup>25</sup> and October<sup>26</sup> of 2023. Brandon Shores 1 and 2 are coal units in BGE with an ICAP of 635 MW and 638 MW. Wagner 3 and 4 are oil units in BGE with an ICAP of 305 MW and 397 MW. PJM determined that these resources were needed for reliability until transmission upgrades can be completed. In 2024, the Brandon Shores 1 and 2 units received \$53.5 million in uplift, 19.8 percent of all uplift payments and the Wagner units received \$18.5 million in uplift, 6.9 percent of all uplift payments. In 2023, the Brandon Shores 1 and 2 units received \$31.1 million in uplift, 19.8 percent of all uplift payments and the Wagner 3 and 4 units received \$6.1 in uplift, 3.9 percent of all uplift payments.

**Table 4-14 Top 10 recipients of total uplift: 2024**

Rank	Unit Name	Zone	Total Uplift Credit	Share of Total Uplift Credits
1	BC BRANDON SHORES 2 F	BGE	\$31,118,688	11.5%
2	BC BRANDON SHORES 1 F	BGE	\$22,184,006	8.2%
3	PEP CHALKPOINT 3 F	PEPCO	\$20,530,544	7.6%
4	PEP CHALKPOINT 4 F	PEPCO	\$13,474,563	5.0%
5	BC WAGNER 3 F	BGE	\$10,637,591	3.9%
6	BC WAGNER 4 F	BGE	\$7,883,568	2.9%
7	PL BRUNNER ISLAND 3 F	PPL	\$3,926,768	1.5%
8	BC WAGNER 1 F	BGE	\$2,429,167	0.9%
9	PL MARTINS CREEK 4 F	PPL	\$2,294,786	0.9%
10	DPL INDIAN RIVER 4 F	DPL	\$2,151,960	0.8%
Total of Top 10			\$116,631,640	43.2%
Total Uplift Credits			\$269,850,402	100.0%

<sup>24</sup> As a result of FERC Order No. 844, PJM began publishing total uplift credits by unit by month for credits paid on and after July 1, 2019, on September 10, 2019.

<sup>25</sup> Lebsack, Dale, President Brandon Shores LLC, Talen Energy, November 11, 2024, <<https://www.pjm.com/-/media/planning/gen-retire/deactivation-notices/brandon-shores-deactivation.ashx>>

<sup>26</sup> Lebsack, Dale, President H.A. Wagner LLC, Talen Energy, November 11, 2024, <<https://www.pjm.com/-/media/planning/gen-retire/deactivation-notices/wagner-deactivation-notice.ashx>>

Table 4-15 Top 10 recipients of day-ahead generation credits: 2024

Rank	Unit Name	Zone	Day-Ahead Operating Reserve Credit	Share of Day-Ahead Operating Reserve Credits
1	BC BRANDON SHORES 2 F	BGE	\$28,788,893	25.0%
2	BC BRANDON SHORES 1 F	BGE	\$20,838,396	18.1%
3	PEP CHALKPOINT 3 F	PEPCO	\$19,124,583	16.6%
4	PEP CHALKPOINT 4 F	PEPCO	\$12,921,378	11.2%
5	BC WAGNER 3 F	BGE	\$8,821,749	7.7%
6	BC WAGNER 4 F	BGE	\$5,587,916	4.9%
7	PL BRUNNER ISLAND 3 F	PPL	\$3,133,526	2.7%
8	BC WAGNER 1 F	BGE	\$1,770,914	1.5%
9	PL MARTINS CREEK 4 F	PPL	\$1,423,855	1.2%
10	PL MARTINS CREEK 3 F	PPL	\$1,413,194	1.2%
Total of Top 10			\$103,824,405	90.2%
Total day-ahead operating reserve credits			\$115,153,646	100.0%

Table 4-16 Top 10 recipients of balancing generator credits: 2024

Rank	Unit Name	Zone	Balancing Generator Credits	Share of Balancing Generator Credits
1	BC BRANDON SHORES 2 F	BGE	\$2,328,766	2.0%
2	BC WAGNER 4 F	BGE	\$2,295,652	2.0%
3	DPL INDIAN RIVER 4 F	DPL	\$2,105,787	1.8%
4	AEP ROBERT P MONE 1 CT	AEP	\$1,821,171	1.6%
5	BC WAGNER 3 F	BGE	\$1,815,820	1.6%
6	AEP ROBERT P MONE 3 CT	AEP	\$1,601,057	1.4%
7	EKPC JK SMITH 2 CT	EKPC	\$1,516,635	1.3%
8	EKPC JK SMITH 1 CT	EKPC	\$1,491,609	1.3%
9	AEP ROBERT P MONE 2 CT	AEP	\$1,489,111	1.3%
10	EKPC JK SMITH 3 CT	EKPC	\$1,432,485	1.2%
Total of Top 10			\$17,898,092	15.5%
Total balancing operating reserve credits			\$120,478,033	100.0%

Table 4-17 Top 10 recipients of lost opportunity cost credits: 2024

Rank	Unit Name	Zone	Lost Opportunity Cost Credits	Share of Lost Opportunity Cost Credits
1	VP LADYSMYTH 1 CT	DOM	\$847,753	2.7%
2	FE RICHLAND 4 CT	ATSI	\$798,150	2.6%
3	FE RICHLAND 5 CT	ATSI	\$721,495	2.3%
4	PEP DICKERSON H 2 CT	PEPCO	\$708,778	2.3%
5	COM LEE DEKALB 1 WF	COMED	\$589,759	1.9%
6	VP LOUISA 5 CT	DOM	\$482,514	1.5%
7	VP LADYSMYTH 4 CT	DOM	\$442,375	1.4%
8	VP LADYSMYTH 3 CT	DOM	\$433,618	1.4%
9	DPL ROCK SPRINGS 1 CT	DPL	\$408,080	1.3%
10	VP REMINGTON 4 CT	DOM	\$402,562	1.3%
Total of Top 10			\$5,835,083	18.7%
Total lost opportunity cost credits			\$31,227,929	100.0%

Table 4-18 Top 10 recipients of dispatch differential lost opportunity cost credits: 2024

Rank	Unit Name	Zone	Dispatch Differential Lost Opportunity Cost Credits	Share of Dispatch Differential Lost Opportunity Cost Credits
1	AEP SMITH MOUNT 1-5 H	AEP	\$266,464	13.7%
2	AP BATH COUNTY 1-6 H	DOM	\$192,970	9.9%
3	VP GASTON 1-4 H	DOM	\$191,548	9.8%
4	VP BATH COUNTY 1-6 H	DOM	\$159,824	8.2%
5	VP KERR DAM 1-7 H	DOM	\$156,896	8.0%
6	JC YARDS CREEK 1-3 H	JCPL	\$58,012	3.0%
7	PL HUMMEL STATION 1 CC	PPL	\$32,568	1.7%
8	VP FOUR RIVERS 1 CT	DOM	\$32,130	1.6%
9	PS NEWARK ENERGY CENTER 10 CC	PSEG	\$31,737	1.6%
10	VP PANDA STONEWALL 1 CC	DOM	\$31,565	1.6%
Total of Top 10			\$1,153,714	59.2%
Total dispatch differential lost opportunity cost credits			\$1,949,783	6.2%

## Uplift Credits and Market Power Mitigation

Absent effectively implemented market power mitigation, unit owners that submit noncompetitive offers or offers with inflexible operating parameters, can exercise market power, resulting in noncompetitive and excessive uplift payments.

The three pivotal supplier (TPS) test is the test for local structural market power in the energy market.<sup>27</sup> If the TPS test is failed, market power mitigation is applied by offer capping the resources of the owners identified as having local market power to their cost-based offer. Offer capping is designed to set offers at competitive levels.

Table 4-19 shows day-ahead operating reserve credits paid to units called on days with hot and cold weather alerts, classified by commitment schedule type. On weather alert days, PJM can use parameter limited schedules (PLS) to prevent exercises of market power through the use of inflexible parameters. Of all the day-ahead credits received during days with weather alerts, 78.6 percent went to units that were committed on cost schedules, which are parameter limited, 4.2 percent went to units that were committed on price PLS schedules and 17.2 percent went to units committed on price schedules less flexible than PLS. The 17.2 percent that went to units committed on a price schedule less flexible than PLS indicates an issue with the process that PJM uses to apply parameter mitigation on weather alert days. Resources should not receive uplift based on inflexible parameters during emergencies and alerts.

**Table 4-19 Day-ahead operating reserve credits during weather alerts by commitment schedule: 2024**

Commitment Type During Hot and Cold Weather Alerts	Day Ahead Operating Reserve Credits	Share of DAOR during emergency alerts
Committed on cost (cost capped)	\$10,602,139	78.6%
Committed on price schedule as flexible as PLS	\$2,097	0.0%
Committed on price schedule less flexible than PLS	\$2,312,726	17.2%
Committed on price PLS	\$567,451	4.2%
Total	\$13,484,413	100.0%

Gas fired generators may request temporary exceptions to parameter limits such as minimum run time based on restrictions imposed by natural gas pipelines, including ratable takes.<sup>28</sup> Table 4-20 shows the day-ahead operating reserve uplift credits received from 2018 through 2024 by units that submitted parameter exception requests for a 24 hour minimum run time based on gas pipeline restrictions. In 2024, 79 units requested an exception for a 24 hour minimum run time and 41 units received uplift payments amounting to \$30.2 million of day ahead operating reserves, or 26.2 percent of total day-ahead operating reserves and 11.2 percent of total uplift.

**Table 4-20 Uplift credits for units with 24 hour minimum run times due to gas pipeline restrictions: 2018 through 2024**

Year	Day-Ahead Operating Reserve Credits (Millions)	Number of Units with 24 Hour Min Run Time Exceptions	Number of Units with 24 Hour Min Run Time Exceptions that Received Uplift
2018	\$4.9	25	2
2019	\$0.2	37	12
2020	\$0.2	13	2
2021	\$0.7	61	42
2022	\$14.4	81	38
2023	\$10.7	75	23
2024	\$30.2	79	41

<sup>27</sup> See the MMU Technical Reference for PJM Markets, at "Three Pivotal Supplier Test" for a more detailed explanation of the three pivotal supplier test. <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

<sup>28</sup> See OA Schedule 1 Section 6.6 (C) Minimum Generator Operating Parameters – Parameter Limited Schedules.

## Winter Storm Gerri (January 13 – 22, 2024)

The commitment and dispatch of units by PJM during Winter Storm Gerri, which lasted from January 13 through 21, 2024, had a significant impact on uplift, especially day-ahead operating reserves. Table 4-21 summarizes the uplift payments by category during Winter Storm Gerri. During the period of the storm, units received \$32.6 million in day-ahead operating reserve credits, equivalent to 28.3 percent of total day-ahead operating reserves during 2024. Units received \$19.5 million in balancing generator credits during the storm, equivalent to 16.1 percent of total balancing generator credits during 2024. Overall, total uplift payments during the storm totaled \$53.9 million, or 20.0 percent of total uplift during 2024. This outcome is not surprising and is not evidence of a problem.

Uplift during Winter Storm Gerri increased as a result of out of market commitments made by PJM in anticipation of the cold weather. The out of market commitments resulted primarily from conservative operations but also included unit commitments for transmission constraints. Conservative operations are triggered by weather, environmental, physical or cyber security events, among other types of events.<sup>29</sup>

PJM provided multiple reasons for the out of market commitments. PJM stated that units with extended start times were committed early, before the cold weather started. Units that did not operate in the previous eight weeks, prior to the storm, were considered for additional start time. Units with extensive minimum down time were kept online if they were expected to be needed for the peak load. Weekend gas package purchases were also considered when making out of market commitments to gas units to address generators' risk related to gas purchases for the expected peak days.<sup>30</sup>

**Table 4-21 Energy uplift credits by category during Winter Storm Gerri**

Category	Type	Winter Storm Gerri Credits (Millions)	2024 Credits (Millions)	Share 2024
Day-Ahead	Generators	\$32.6	\$115.2	28.3%
	Generators	\$19.5	\$120.5	16.1%
Balancing	Canceled Resources	\$0.0	\$0.1	0.0%
	Lost Opportunity Cost	\$0.9	\$31.2	3.0%
	Dispatch Differential Lost Opportunity Cost	\$0.1	\$1.9	4.5%
Synchronous Condensing	Synchronous Condensing	\$0.0	\$0.0	NA
	Synchronous Condensing Lost Opportunity Cost	\$0.0	\$0.0	NA
Reactive Services	Generators	\$0.0	\$0.0	NA
	Lost Opportunity Cost	\$0.8	\$0.9	84.9%
	Condensing	\$0.0	\$0.0	84.1%
	Condensing Lost Opportunity Cost	\$0.0	\$0.0	NA
Total		\$53.9	\$269.9	20.0%

Table 4-22 summarizes the total energy uplift credits by unit type during Winter Storm Gerri. In 2024, non-coal steam units were particularly affected by the storm, and received 35.7 million in uplift payments during the period of the storm, accounting for 50.1 percent of the total \$71.1 million in uplift paid to non-coal steam units during 2024. Similarly, combined cycle units were also strongly impacted by Winter Storm Gerri, and received \$6.2 million during the period of the storm, which was 52.7 percent of the \$11.8 million in uplift received by combined cycle units in 2024. The commitment of combustion turbines was less affected by the storm, and uplift payments to CTs during the storm were 8.7 percent of uplift payments to CTs in 2024.

<sup>29</sup> See PJM "Manual 13: Emergency Operations," Section 3.2 Conservative Operations Rev92 (Dec. 20, 2023).

<sup>30</sup> See "Winter Storm Gerri Review January 13–22, 2024," PJM presentation to the Operating Committee. (February 8, 2024) <<https://www.pjm.com/-/media/committees-groups/committees/oc/2024/20240208/20240208-item-11---cold-weather-update.ashx>>.



**Table 4-22 Total energy uplift credits by unit type during Winter Storm Gerri**

Unit Type	Winter Storm Gerri Credits (Millions)	2024 Credits (Millions)	Share 2024
Combined Cycle	\$6.2	\$11.8	52.7%
Combustion Turbine	\$10.5	\$119.9	8.7%
Diesel	\$0.2	\$2.0	7.5%
Hydro	\$0.1	\$1.1	5.0%
Nuclear	\$0.0	\$0.0	0.0%
Solar	\$0.0	\$0.3	0.8%
Steam – Coal	\$1.4	\$61.1	2.2%
Steam – Other	\$35.7	\$71.1	50.1%
Wind	\$0.1	\$2.6	1.9%
Total	\$53.9	\$269.9	20.0%

Table 4-23 summarizes the energy uplift credits by unit type during Winter Storm Gerri

**Table 4-23 Energy uplift credits by unit type during Winter Storm Gerri**

Unit Type	Day-Ahead Generator	Balancing Generator	Canceled Resources	Local Constraints Control	Lost Opportunity Cost	Reactive Services	Synchronous Condensing	Black Start Services	Dispatch Differential Lost Opportunity Cost
Combined Cycle	7.1%	19.9%	0.0%	0.0%	0.2%	0.0%	0.0%	0.0%	14.0%
Combustion Turbine	0.3%	45.3%	0.0%	0.0%	83.5%	93.8%	0.0%	0.0%	9.0%
Diesel	0.0%	0.5%	0.0%	0.0%	4.7%	0.9%	0.0%	0.0%	0.9%
Hydro	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	60.5%
Nuclear	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Solar	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	2.0%
Steam – Coal	1.4%	3.7%	0.0%	100.0%	5.8%	5.3%	0.0%	0.0%	10.3%
Steam – Other	91.1%	30.6%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	1.0%
Wind	0.0%	0.0%	0.0%	0.0%	5.7%	0.0%	0.0%	0.0%	2.3%
Total (Millions)	\$32.6	\$19.5	\$0.0	\$0.1	\$0.9	\$0.9	\$0.0	\$0.0	\$0.1

## Capacity Markets

In PJM, the capacity market exists to make the energy market work. Energy powers lights and computers and air conditioners. Capacity does not power anything. The capacity market needs to define the total MWh of energy that are needed to reliably serve load. The capacity market needs to provide the missing money. A primary reason to have a capacity market is that the energy market does not provide adequate net revenues to provide incentives for entry and for maintaining existing units. The obligation of load serving entities (LSEs) to own capacity equal to the peak demand plus a reserve margin was a longstanding feature of the PJM Operating Agreement before the creation of the PJM markets. The initial impetus to a capacity market in PJM, a request by the Pennsylvania PUC, was to support retail competition by ensuring that small new entrant competitive LSEs would have access to capacity at a competitive price without having to build capacity or purchase capacity bilaterally from incumbent generation owners at monopoly prices. The first, the daily capacity market, created in 1999, was replaced in 2007 by the current design based on the recognition that the energy market resulted in a shortfall in net revenues compared to that necessary to attract and retain adequate resources for the reliable operation of the energy market. The exogenous reliability requirement to have a level of capacity in excess of the level that would result from the operation of an energy market alone reduces the level and volatility of energy market prices and reduces the duration of high energy market prices. This reduces net revenue to generation owners which reduces the incentive to invest. In order for the PJM markets to be self sustaining, the net revenues from PJM energy, ancillary services and capacity markets must be adequate for those resources. That adequacy requires a capacity market. The capacity market plays the essential role of equilibrating the revenues necessary to incent competitive entry and exit of the resources needed for reliability, with the revenues from the energy and ancillary services markets.

The only goal of the detailed design of the capacity market is to ensure that the opportunity for that revenue equilibration exists through a competitive process.

The Capacity Performance (CP) design was a radical change to the capacity market paradigm. The CP design

is a failed experiment. The fundamental mistake of the CP design was to attempt to recreate energy market incentives in the capacity market. The CP model was an explicit attempt to bring energy market shortage pricing into the capacity market design. The CP model was designed on the assumption that shortage prices in the energy market were not high enough and needed to be increased via the capacity market.

PJM's introduction of its significantly modified ELCC method in the 2025/2026 BRA was another radical change to the capacity market design. While it is a good idea to evaluate unit specific performance and a good idea to recognize that risk occurs in the winter as well as the summer and that risks are correlated, ELCC was implemented before it could be fully tested and unintended consequences evaluated. The results of the 2025/2026 BRA illustrate the extreme sensitivity of the market outcomes to a range of assumptions and decisions about market design details that were not adequately tested or reviewed with stakeholders.<sup>1</sup>

The challenge is to create a straightforward capacity market design that meets the simple objectives of a capacity market and that does not become a vehicle for energy market incentives or rent seeking or attempts to limit the ways in which specific types of generation participate in PJM markets. Energy market incentives should remain in the energy market.

The PJM market design is based on the must offer and must buy obligations of capacity resources. All capacity resources are required to offer into the capacity auctions. The current exception of intermittent and storage capacity from the must offer requirement is inconsistent with the PJM market design and the significance of this exception is growing.<sup>2</sup> All LSEs must buy capacity equal to their peak load plus a reserve margin.

Each organization serving PJM load must meet its capacity obligations through the PJM Capacity Market, where load serving entities (LSEs) must pay the locational capacity price for their zone. LSEs can also construct generation and offer it into the capacity market, enter into bilateral contracts, develop demand resources and offer them into the capacity market, or

<sup>1</sup> The MMU prepared a series of reports on the 2025/2026 BRA results which can be found here: <https://www.monitoringanalytics.com/reports/Reports/2024.shtml> and here <https://www.monitoringanalytics.com/reports/Reports/2025.shtml>

<sup>2</sup> FERC approved extending the must offer requirement to intermittent resources but not to demand response resources on February 20, 2025. 190 FERC ¶ 61,117.

construct transmission upgrades and offer them into the capacity market.

There are significant market design issues in the PJM Capacity Market that currently prevent the market from achieving competitive results.

The Market Monitoring Unit (MMU) analyzed market design, market structure, participant conduct and market performance in the PJM Capacity Market, including supply, demand, concentration ratios, pivotal suppliers, volumes, prices, outage rates and reliability.<sup>3</sup> The conclusions are a result of the MMU's evaluation of the 2025/2026 Base Residual Auction.<sup>4 5 6 7 8 9</sup>

**Table 5-1 The capacity market results were not competitive**

Market Element	Evaluation	Market Design
Market Structure: Aggregate Market	Not Competitive	
Market Structure: Local Market	Not Competitive	
Participant Behavior	Not Competitive	
Market Performance	Not Competitive	Mixed

- The aggregate market structure was evaluated as not competitive. For almost all auctions held from 2007 to the present, the PJM capacity market failed the three pivotal supplier test (TPS), which is conducted at the time of the auction.<sup>10</sup> Structural market power is endemic to the capacity market.
- The local market structure was evaluated as not competitive. For almost every auction held, all LDAs have failed the TPS test, which is conducted at the time of the auction.<sup>11</sup>

3 The values stated in this report for the RTO and LDAs refer to the aggregate level including all nested LDAs unless otherwise specified. For example, RTO values include the entire PJM market and all LDAs. Rest of RTO values are RTO values net of nested LDA values.

4 See "Analysis of the 2025/2026 RPM Base Residual Auction - Part A," (September 20, 2024) <[https://www.monitoringanalytics.com/reports/Reports/2024/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_A\\_20240920.pdf](https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_A_20240920.pdf)>.

5 See "Analysis of the 2025/2026 RPM Base Residual Auction - Part B," (October 15, 2024) <[https://www.monitoringanalytics.com/reports/Reports/2024/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_B\\_20241015.pdf](https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_B_20241015.pdf)>.

6 See "Analysis of the 2025/2026 RPM Base Residual Auction - Part C," (November 6, 2025) <[https://www.monitoringanalytics.com/reports/Reports/2024/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_C\\_20241106.pdf](https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_C_20241106.pdf)>.

7 See "Analysis of the 2025/2026 RPM Base Residual Auction - Part D," (December 6, 2024) <[https://www.monitoringanalytics.com/reports/Reports/2024/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_D\\_20241206.pdf](https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_D_20241206.pdf)>.

8 See "Analysis of the 2025/2026 RPM Base Residual Auction - Part E," (January 31, 2025). <[https://www.monitoringanalytics.com/reports/Reports/2025/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_E\\_20250131.pdf](https://www.monitoringanalytics.com/reports/Reports/2025/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_E_20250131.pdf)>.

9 See "Analysis of the 2025/2026 RPM Base Residual Auction - Part F," (February 4, 2025) <[https://www.monitoringanalytics.com/reports/Reports/2025/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_F\\_20250204.pdf](https://www.monitoringanalytics.com/reports/Reports/2025/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_F_20250204.pdf)>.

10 In the 2008/2009 RPM Third Incremental Auction, 18 participants in the RTO market passed the TPS test. In the 2018/2019 RPM Second Incremental Auction, 35 participants in the RTO market passed the test. In the 2023/2024 RPM Third Incremental Auction, 36 participants in the RTO passed the TPS test.

11 In the 2012/2013 RPM Base Residual Auction, six participants included in the incremental supply of EMAAC passed the TPS test. In the 2014/2015 RPM Base Residual Auction, seven participants in the incremental supply in MAAC passed the TPS test. In the 2021/2022 RPM First Incremental Auction, two participants in the incremental supply in EMAAC passed the TPS test. In the 2021/2022 RPM Second Incremental Auction, two participants in the incremental supply in EMAAC passed the TPS test. In the 2023/2024 RPM Third Incremental Auction, eight participants in MAAC passed the TPS test.

- Participant behavior was evaluated as not competitive in the 2025/2026 BRA. The offers of most market sellers were competitive after the Commission order corrected the definition of the market seller offer cap.<sup>12</sup> Market power mitigation measures were applied when the capacity market seller failed the market power test for the auction, the submitted sell offer exceeded the defined offer cap, and the submitted sell offer, absent mitigation, would increase the market clearing price. However, a significant level of categorically exempt resources did not offer and the result was to increase the clearing prices above the competitive level.
- Market performance was evaluated as not competitive based on the 2025/2026 Base Residual Auction as a result of the failure to offer of categorically exempt resources, the flaws in the Effective Load Carrying Capability (ELCC) design including the failure to correctly define the reliability contribution of thermal resources in the winter and the failure to include reliability must run (RMR) capacity in the supply curve.
- Market design was evaluated as mixed because while there are many positive features of the capacity market design, there are several features of the RPM design which still threaten competitive outcomes. These include the details of PJM's ELCC implementation, the failure to apply the RPM must offer requirement consistently, the inclusion of performance assessment interval (PAI) penalties, the exclusion of RMR resources from supply, the use of gross CONE as the maximum price on the VRR curve, the definition of DR which permits inferior products to substitute for capacity, the replacement capacity issue, the definition of unit offer parameters, and the inclusion of imports which are not substitutes for internal capacity resources.

12 176 FERC ¶ 61,137 (2021), *order denying reh'g*, 178 FERC ¶ 61,121 (2022), *appeal denied*, EPSA, et al. v. FERC, Case No. 21-1214, et al. (DC Cir. October 10, 2023). The Commission recognized the market power problem and issued an order correcting the PJM tariff, eliminating the prior offer cap and establishing a competitive market seller offer cap set at net ACR, effective September 2, 2021.

## Overview

### RPM Capacity Market

#### Market Design

The Reliability Pricing Model (RPM) Capacity Market is a forward looking, annual, locational market, with a must offer requirement for Existing Generation Capacity Resources and a must buy requirement for load, with performance incentives, that includes clear market power mitigation rules and that permits the direct participation of demand side resources.<sup>13</sup> PJM introduced the Capacity Performance design for the 2017/2018 BRA. PJM introduced a new ELCC method for defining capacity MW offered in the 2025/2026 BRA.<sup>14</sup>

Under RPM, capacity obligations are annual.<sup>15</sup> By design, Base Residual Auctions (BRA) are held for delivery years that are three years in the future despite recent auction delays. First, Second and Third Incremental Auctions (IA) are held for each delivery year.<sup>16</sup> First, Second, and Third Incremental Auctions are conducted 20, 10, and three months prior to the delivery year although some incremental auctions have not been held as a result of delays in holding BRAs.<sup>17</sup> A Conditional Incremental Auction may be held if there is a need to procure additional capacity resulting from a delay in a planned large transmission upgrade that was modeled in the BRA for the relevant delivery year.<sup>18</sup> A Reliability Backstop Auction may be conducted if tariff defined criteria are met to resolve reliability criteria violations caused by lack of sufficient capacity procured through RPM auctions.<sup>19</sup> If the installed reserve margin resulting from the total UCAP committed through self supply or BRAs for three consecutive years is more than one percent lower than the approved PJM installed reserve margin, PJM will make a filing with FERC to conduct a Reliability Backstop Auction. If the total UCAP committed for all base load generation resources in BRAs for three consecutive years is less than the forecasted minimum hourly load, PJM will make a filing with FERC to conduct a Reliability Backstop Auction.

The 2024/2025 RPM Third Incremental Auction and the 2025/2026 RPM Base Residual Auction were conducted in 2024. Based on the FERC Order in Docket No. ER23-729-002, PJM reran the 2024/2025 RPM Base Residual Auction with final results posted on May 6, 2024, and PJM reran the 2024/2025 Third Incremental Auction with final results posted on May 23, 2024.<sup>20 21 22</sup> The 2025/2026 RPM Base Residual Auction was conducted in July 2024.

#### Market Structure

- **RPM Installed Capacity.** In 2024, RPM installed capacity increased 1,281.2 MW or 0.7 percent, from 178,375.0 MW on January 1, to 179,656.2 MW on December 31. Installed capacity includes net capacity imports and exports and can vary on a daily basis.
- **Reserves.** For the 2025/2026 RPM Base Residual Auction, the sum of cleared MW that were considered categorically exempt from the must offer requirement and the cleared MW of DR is 14,319.1 MW, or 71.1 percent of required reserves and 68.1 percent of total reserves. The fact that more than two thirds (68.1 percent) of the PJM reserves depend on resources that are not subject to the RPM must offer requirement, a core part of the capacity market design, means that reliability is significantly less certain than the stated reserve margins indicate.
- **RPM Installed Capacity by Fuel Type.** Of the total installed capacity on December 31, 2024, 49.4 percent was gas; 21.0 percent was coal; 17.9 percent was nuclear; 4.3 percent was hydroelectric; 2.2 percent was oil; 2.0 percent was wind; 0.3 percent was solid waste; and 2.8 percent was solar.
- **Market Concentration.** In the 2024/2025 RPM Third Incremental Auction and the 2025/2026 RPM Base Residual Auction, all participants in the total PJM market as well as the LDA RPM markets failed the three pivotal supplier (TPS) test.<sup>23</sup> Offer caps were applied to all sell offers for resources which were subject to mitigation when the capacity market

13 The terms *PJM Region*, *RTO Region* and *RTO* are synonymous in this report and include all capacity within the PJM footprint.

14 See 186 FERC ¶ 61,080 (2024), *reh'g order*, 189 FERC ¶ 61,043 (2024).

15 Effective for the 2020/2021 and subsequent delivery years, the RPM market design incorporated seasonal capacity resources. Summer period and winter period capacity must be matched either through commercial aggregation or through the optimization in equal MW amounts in the LDA or the lowest common parent LDA.

16 See 126 FERC ¶ 61,275 at P 86 (2009).

17 See Letter Order, FERC Docket No. ER10-366-000 (January 22, 2010).

18 See 126 FERC ¶ 61,275 at P 88 (2009). There have been no Conditional Incremental Auctions.

19 See OATT Attachment DD § 16.

20 On December 23, 2022, PJM filed revisions to the PJM market rules in Docket No. ER23-729-000 and contemporaneously filed a complaint in Docket No. EL23-19-000 seeking the same revisions. By order issued February 21, 2023, PJM's revisions were accepted and the complaint was dismissed as moot. 182 FERC ¶ 61,109.

21 See the "Analysis of the 2024/2025 RPM Base Residual Auction," <[https://www.monitoringanalytics.com/reports/Reports/2023/IMM\\_Analysis\\_of\\_the\\_20242025\\_RPM\\_Base\\_Residual\\_Auction\\_20231030.pdf](https://www.monitoringanalytics.com/reports/Reports/2023/IMM_Analysis_of_the_20242025_RPM_Base_Residual_Auction_20231030.pdf)> (October 30, 2023).

22 187 FERC ¶ 61,065 (2024).

23 There are 27 Locational Deliverability Areas (LDAs) identified to recognize locational constraints as defined in "Reliability Assurance Agreement Among Load Serving Entities in the PJM Region," Schedule 10.1. PJM determines, in advance of each BRA, whether the defined LDAs will be modeled in the given delivery year using the rules defined in OATT Attachment DD § 5.10(a)(ii).

seller did not pass the test, the submitted sell offer exceeded the defined offer cap, and the submitted sell offer, absent mitigation, increased the market clearing price.<sup>24 25 26</sup>

- **Imports and Exports.** Of the 1,268.5 MW of imports offered in the 2025/2026 RPM Base Residual Auction, 1,268.5 MW cleared. Of the cleared imports, 700.5 MW (55.2 percent) were from MISO.
- **Demand Resources.** Committed DR was 7,699.9 MW for June 1, 2024, as a result of cleared capacity for demand resources in RPM auctions for the 2024/2025 Delivery Year (8,064.7 MW) less replacement capacity (364.8 MW).
- **Energy Efficiency Resources.** EE is not a capacity resource but is paid the capacity market clearing price as a subsidy. Committed EE was 7,668.0 MW for June 1, 2024, as a result of MW offered at a price less than or equal to the RPM auction clearing price in RPM auctions for the 2024/2025 Delivery Year (7,716.0 MW) less replacement MW (48.0 MW).

## Market Conduct

- **2024/2025 RPM Third Incremental Auction.** Of the 320 generation resources that submitted Capacity Performance offers, the MMU calculated unit specific offer caps for seven generation resources (2.2 percent).
- **2025/2026 RPM Base Residual Auction.** Of the 1,119 generation resources that submitted Capacity Performance offers, the MMU calculated unit specific offer caps for 61 generation resources (5.5 percent).

## Market Performance

- The 2024/2025 RPM Third Incremental Auction and the 2025/2026 RPM Base Residual Auction were conducted in 2024. The weighted average capacity price for the 2023/2024 Delivery Year is \$42.01 per MW-day, including all RPM auctions for the 2023/2024 Delivery Year. The weighted average capacity price for the 2024/2025 Delivery Year is

\$45.57 per MW-day, including all RPM auctions for the 2024/2025 Delivery Year.

- For the 2024/2025 Delivery Year, RPM annual charges to load are \$2.5 billion.
- In the 2025/2026 RPM Base Residual Auction, the market performance was determined to be not competitive.

## Part V Reliability Service (RMR)

- Of the nine companies (28 units) that have provided service following deactivation requests, two companies (seven units) filed to be paid under the deactivation avoidable cost rate (DACR), the formula rate. The other seven companies (21 units) filed to be paid under the cost of service recovery rate.

## Generator Performance

- **Forced Outage Rates.** The average PJM EFORd in 2024 was 5.2 percent, a decrease from 5.5 percent in 2023.<sup>27</sup>
- **Generator Performance Factors.** The PJM aggregate equivalent availability factor in 2024 was 83.2 percent, an increase from 83.1 percent in 2023.

## Recommendations<sup>28</sup>

### Definition of Capacity

- The MMU recommends elimination of the key remaining components of the CP model because they interfere with competitive outcomes in the capacity market and create unnecessary complexity and risk. (Priority: High. First reported 2022. Status: Not adopted.)
- The MMU recommends the enforcement of a consistent definition of capacity resources. The MMU recommends that the tariff requirement to be a physical resource be enforced and enhanced. The requirement to be a physical resource should apply at the time of auctions and should also constitute a commitment to be physical in the relevant delivery year. The requirement to be a physical resource should be applied to all resource types, including planned generation, demand resources,

<sup>24</sup> See OATT Attachment DD § 6.5.

<sup>25</sup> Prior to November 1, 2009, existing DR and EE resources were subject to market power mitigation in RPM Auctions. See 129 FERC ¶ 61,081 at P 30 (2009).

<sup>26</sup> Effective January 31, 2011, the RPM rules related to market power mitigation were changed, including revising the definition for Planned Generation Capacity Resource and creating a new definition for Existing Generation Capacity Resource for purposes of the must offer requirement and market power mitigation, and treating a proposed increase in the capability of a generation capacity resource the same in terms of mitigation as a Planned Generation Capacity Resource. See 134 FERC ¶ 61,065 (2011).

<sup>27</sup> The generator performance analysis includes all PJM capacity resources for which there are data in the PJM generator availability data systems (GADS) database. Data was downloaded from the PJM GADS database on January 22, 2025. EFORd data presented in state of the market reports may be revised based on data submitted after the publication of the reports as generation owners may submit corrections at any time with permission from PJM GADS administrators.

<sup>28</sup> The MMU has identified serious market design issues with RPM and the MMU has made specific recommendations to address those issues. These recommendations have been made in public reports. See Table 5-2.



and imports.<sup>29 30</sup> (Priority: High. First reported 2013. Status: Not adopted.)

- The MMU recommends that DR providers be required to have a signed contract with specific customers for specific facilities for specific levels of DR at least six months prior to any capacity auction in which the DR is offered. (Priority: High. First reported 2016. Status: Not adopted.)
- The MMU recommends that Energy Efficiency Resources (EE) not be included in the capacity market construct because PJM's load forecasts have accounted for EE since the 2016 load forecast for the 2019/2020 delivery year. EE is not a capacity resource as defined in the tariff, and there is no reason to continue to pay large subsidies to EE providers.<sup>31</sup> (Priority: Medium. First reported 2016. Status: Adopted 2024.)<sup>32</sup>
- The MMU recommends that intermittent resources, including storage, not be permitted to offer capacity MW based on energy deliveries that exceed their defined deliverability rights (CIRs). Only energy output for such resources at or below the designated CIR/deliverability level should be recognized in the definition of derated capacity (e.g. ELCC). Correctly defined ELCC derating factors are lower than the CIRs required to meet those derating factors. (Priority: High. First reported 2021. Status: Adopted 2023.)
- The MMU recommends that PJM require all market participants to meet their deliverability requirements under the same rules. PJM should end the practice of giving away winter CIRs to intermittent resources that appear to exist because other resources paid for the supporting network upgrades. (Priority: High. First reported 2017. Status: Not adopted.)<sup>33</sup>
- The MMU recommends that the must offer rule in the capacity market apply to all capacity resources. There is no reason to exempt intermittent and capacity storage resources, including hydro, and demand resources from the must offer requirement. The same rules should apply to all capacity resources

in order to ensure open access to the transmission system and prevent the exercise of market power through withholding. (Priority: High. First reported 2021. Status: Not adopted.)

- The MMU recommends that PJM require all market sellers of proposed generation capacity resources, including thermal and intermittent, to submit a binding notice of intent to offer at least six months prior to the base residual auction. This is consistent with the overall MMU recommendation that all capacity resources have a must offer obligation in the capacity market auctions. (Priority: High. First reported 2023. Status: Partially adopted.)
- The MMU recommends that the ELCC be significantly refined to include hourly data that would permit unit specific ELCC ratings, to weight summer and winter risk in a more balanced manner, to eliminate PAI risks, and to pay for actual hourly performance rather than based on relatively inflexible class capacity accreditation ratings derived from a small number of hours of poor performance. (Priority: High. First reported 2023. Status: Not adopted.)

## Market Design and Parameters

- The MMU recommends that PJM reevaluate the shape of the VRR curve. The shape of the VRR curve directly results in load paying substantially more for capacity than load would pay with a vertical demand curve. More specifically, the MMU recommended that the VRR curve be rotated half way towards the vertical demand curve at the reliability requirement in the 2022 Quadrennial Review. (Priority: High. First reported 2021. Status: Partially adopted.)
- The MMU recommends that the maximum price on the VRR curve be defined as 1.5 times Net CONE, capped at Gross CONE. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that the reference resource be a CT rather than a CC. The MMU recommends that the ELCC value used to convert the gross CONE in ICAP terms for a CT to the gross CONE in UCAP terms be the ELCC based on winter ratings. (Priority: High. First reported Q3 2024. Status: Not adopted.)
- The MMU recommends that the test for determining modeled Locational Deliverability Areas (LDAs) in RPM be redefined. A detailed reliability analysis of

<sup>29</sup> See also Comments of the Independent Market Monitor for PJM, Docket No. ER14-503-000 (December 20, 2013).

<sup>30</sup> See "Analysis of Replacement Capacity for RPM Commitments: June 1, 2007 to June 1, 2019," <[http://www.monitoringanalytics.com/reports/Reports/2019/IMM\\_Analysis\\_of\\_Replacement\\_Capacity\\_for\\_RPM\\_Commitments\\_June\\_1\\_2007\\_to\\_June\\_1\\_2019\\_20190913.pdf](http://www.monitoringanalytics.com/reports/Reports/2019/IMM_Analysis_of_Replacement_Capacity_for_RPM_Commitments_June_1_2007_to_June_1_2019_20190913.pdf)> (September 13, 2019).

<sup>31</sup> "PJM Manual 19: Load Forecasting and Analysis," § 3.2 Development of the Forecast, Rev. 37 (Dec. 18, 2024).

<sup>32</sup> See 189 FERC ¶ 61,095 (2024).

<sup>33</sup> This recommendation was first made in the 2020/2021 BRA report in 2017. See the "Analysis of the 2020/2021 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2017/IMM\\_Analysis\\_of\\_the\\_20202021\\_RPM\\_BRA\\_20171117.pdf](http://www.monitoringanalytics.com/reports/Reports/2017/IMM_Analysis_of_the_20202021_RPM_BRA_20171117.pdf)> (November 11, 2017).

all at risk units should be included in the redefined model including transmission constraints inside LDAs. The market design should clear and pay units that are needed for reliability per PJM's transmission reliability analysis in order to forestall RMRs. (Priority: Medium. First reported 2013. Status: Not adopted.)

- The MMU recommends that PJM clear the capacity market based on nodal capacity resource locations and the characteristics of the transmission system inside and outside LDAs consistent with the actual electrical facts of the grid. Absent a fully nodal capacity market clearing process, the MMU recommends that PJM use a non-nested model with all LDAs modeled including VRR curves for all LDAs. Each LDA requirement should be met with the capacity resources located within the LDA and exchanges from neighboring LDAs up to the transmission limit. LDAs should be allowed to price separate if that is the result of the LDA supply curves and the transmission constraints between LDAs. (Priority: Medium. First reported 2017. Status: Not adopted.)
- The MMU recommends that the net revenue offset calculation used by PJM to calculate the net Cost of New Entry (CONE) and net ACR be based on a forward looking calculation of expected energy and ancillary services net revenues using historical net revenues that are scaled based on forward prices for energy and fuel. (Priority: High. First reported 2014. Status: Not adopted.)<sup>34</sup>
- The MMU recommends that PJM reduce the number of incremental auctions to a single incremental auction held three months prior to the start of the delivery year and reevaluate the triggers for holding conditional incremental auctions. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM not sell back any capacity in any IA procured in a BRA. If PJM continues to sell back capacity, the MMU recommends that PJM offer to sell back capacity in incremental auctions only at the BRA clearing price for the relevant delivery year. (Priority: Medium. First reported 2017. Status: Not adopted.)
- The MMU recommends that PJM not buy any capacity in any IA if PJM has already procured excess reserves. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends changing the RPM solution method to explicitly incorporate the cost of uplift (make whole) payments in the objective function. (Priority: Medium. First reported 2014. Status: Not adopted.)
- The MMU recommends that the Fixed Resource Requirement (FRR) rules, including obligations and performance requirements, be revised and updated to ensure that the rules reflect current market realities and that FRR entities do not unfairly take advantage of those customers paying for capacity in the PJM capacity market. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that the value of CTRs be defined by the total MW cleared in the capacity market, the internal MW cleared and the imported MW cleared, and not redefined later prior to the delivery year. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends that the market clearing results be used in settlements rather than the reallocation process currently used, or that the process of modifying the obligations to pay for capacity be reviewed. (Priority: Medium. First reported 2021. Status: Not adopted.)<sup>35</sup>
- The MMU recommends that PJM improve the clarity and transparency of its CETL calculations. The MMU also recommends that CETL for capacity imports into PJM be based on the ability to import capacity only where PJM capacity exists and where that capacity has a must offer requirement in the PJM Capacity Market. (Priority: Medium. First reported 2021. Status: Partially adopted 2022.)

## Offer Caps, Offer Floors, and Must Offer

- The MMU recommends using the lower of the cost or price-based energy market offer to calculate energy costs in the calculation of the historical net revenues which are an offset to gross ACR in the calculation of unit specific capacity resource offer

<sup>34</sup> This recommendation was first made during the Quadrennial Review in 2014, including the PJM Capacity Senior Task Force (CSTF), the MRC and the MC. <<https://www.pjm.com/committees-and-groups/closed-groups/cstf>>.

<sup>35</sup> This recommendation was first made in the 2023/2024 BRA report in 2022. See "Analysis of the 2023/2024 RPM Base Residual Auction Revised," <[http://www.monitoringanalytics.com/reports/Reports/2022/IMM\\_Analysis\\_of\\_the\\_20232024\\_RPM\\_Base\\_Residual\\_Auction\\_20221028.pdf](http://www.monitoringanalytics.com/reports/Reports/2022/IMM_Analysis_of_the_20232024_RPM_Base_Residual_Auction_20221028.pdf)> (October 28, 2022).

caps based on net ACR. (Priority: Medium. First reported 2021. Status: Not adopted.)

- The MMU recommends that modifications to existing resources, including relatively small proposed increases in the capability of a Generation Capacity Resource be treated as an existing resource and subject to the corresponding market power mitigation rules and no longer be treated as planned and exempt from offer capping. (Priority: Medium. First reported 2012. Status: Not adopted.)<sup>36</sup>
- The MMU recommends that the RPM market power mitigation rule be modified to apply offer caps in all cases when the three pivotal supplier test is failed and the sell offer is greater than the offer cap. This will ensure that market power does not result in an increase in uplift (make whole) payments for seasonal products. (Priority: Medium. First reported 2017. Status: Not adopted.)
- The MMU recommends that any combined seasonal resources be required to be in the same LDA and at the same location, in order for the energy market and capacity market to remain synchronized and reliability metrics correctly calculated. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends that the definition of avoidable costs in the tariff be corrected to be consistent with the economic definition. Avoidable costs are costs that are neither short run marginal costs, like fuel or consumables, nor fixed costs like depreciation and rate of return. Avoidable costs are the marginal costs of capacity and therefore the competitive offer level for capacity resources and therefore the market seller offer cap. Avoidable costs are the marginal costs of capacity for both new resources and existing resources. (Priority: Medium. First reported 2017. Status: Not adopted.)<sup>37</sup>
- The MMU recommends that major maintenance costs be included in the definition of avoidable costs and removed from energy offers because such costs are avoidable costs and not short run marginal costs. (Priority: High. First reported 2019. Status: Not adopted.)

<sup>36</sup> This recommendation was first made in the 2014/2015 BRA report in 2012. See "Analysis of the 2014/2015 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2012/Analysis\\_of\\_2014\\_2015\\_RPM\\_Base\\_Residual\\_Auction\\_20120409.pdf](http://www.monitoringanalytics.com/reports/Reports/2012/Analysis_of_2014_2015_RPM_Base_Residual_Auction_20120409.pdf)> (April 9, 2012).

<sup>37</sup> This recommendation was first made in the 2023/2024 BRA report in 2022. See "Analysis of the 2023/2024 RPM Base Residual Auction Revised," <[http://www.monitoringanalytics.com/reports/Reports/2022/IMM\\_Analysis\\_of\\_the\\_20232024\\_RPM\\_Base\\_Residual\\_Auction\\_20221028.pdf](http://www.monitoringanalytics.com/reports/Reports/2022/IMM_Analysis_of_the_20232024_RPM_Base_Residual_Auction_20221028.pdf)> (October 28, 2022).

- The MMU recommends that capacity market sellers be required to explicitly request and support the use of minimum MW quantities (inflexible sell offer segments) and that the requests only be permitted for defined physical reasons. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that, as part of the MOPR unit specific standard of review, all projects be required to use the same basic modeling assumptions. That is the only way to ensure that projects compete on the basis of actual costs rather than on the basis of modeling assumptions.<sup>38</sup> (Priority: High. First reported 2013. Status: Not adopted.)

## Performance Incentive Requirements of RPM

- The MMU recommends that any unit not capable of supplying energy equal to its day-ahead must offer requirement (ICAP) be required to reflect an appropriate outage and associated performance penalty. (Priority: Medium. First reported 2009. Status: Not adopted.)
- The MMU recommends that retroactive replacement transactions associated with a failure to perform during a PAI not be allowed and that, more generally, retroactive replacement capacity transactions not be permitted. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends that there be an explicit requirement that capacity resource offers in the day-ahead energy market be competitive, where competitive is defined to be the short run marginal cost of the units, including flexible operating parameters. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that Capacity Performance resources be required to perform without excuses. Resources that do not perform should not be paid regardless of the reason for nonperformance.

<sup>38</sup> See 143 FERC ¶ 61,090 (2013) ("We encourage PJM and its stakeholders to consider, for example, whether the unit-specific review process would be more effective if PJM requires the use of common modeling assumptions for establishing unit-specific offer floors while, at the same time, allowing sellers to provide support for objective, individual cost advantages. Moreover, we encourage PJM and its stakeholders to consider these modifications to the unit-specific review process together with possible enhancements to the calculation of Net CONE."); see also, Comments of the Independent Market Monitor for PJM, Docket No. ER13-535-001 (March 25, 2013); Complaint of the Independent Market Monitor for PJM v. Unnamed Participant, Docket No. EL12-63-000 (May 1, 2012); Motion for Clarification of the Independent Market Monitor for PJM, Docket No. ER11-2875-000, et al. (February 17, 2012); Protest of the Independent Market Monitor for PJM, Docket No. ER11-2875-002 (June 2, 2011); Comments of the Independent Market Monitor for PJM, Docket Nos. EL11-20 and ER11-2875 (March 4, 2011).

(Priority: High. First reported 2019. Status: Not adopted.)

- The MMU recommends that PJM require actual seasonal tests as part of the Summer/Winter Capability Testing rules, that the number of tests be limited, and that the ambient conditions under which the tests are performed be defined to reflect seasonal extreme conditions. (Priority: Medium. First reported 2022. Status: Not adopted.)
- The MMU recommends that PJM select the time and day that a unit undergoes Net Capability Verification Testing, not the unit owner, and that this information not be communicated in advance to the unit owner. (Priority: Medium. First reported 2022. Status: Not adopted.)

## Capacity Imports and Exports

- The MMU recommends that all capacity imports be required to be deliverable to PJM load in an identified LDA, zonal or subzonal, or defined combinations of specific zones, e.g. MAAC, prior to the relevant delivery year to ensure that they are full substitutes for internal, physical capacity resources. Pseudo ties alone are not adequate to ensure deliverability to PJM load. (Priority: High. First reported 2016. Status: Not adopted.)
- The MMU recommends that all costs incurred as a result of a pseudo tied unit be borne by the unit itself and included as appropriate in unit offers in the capacity market. (Priority: High. First reported 2016. Status: Not adopted.)

## Deactivations/Retirements

- The MMU recommends that the notification requirement for deactivations be extended from the current one quarter prior (See Table 5-29) to 12 months prior to an auction in which the unit will not be offered due to deactivation; and no less than 12 months prior to the date of deactivation (Priority: Low. First reported 2012. Status: Partially adopted.)
- The MMU recommends elimination of both the cost of service recovery rate option and the deactivation avoidable cost rate option for providing Part V reliability service (RMR), and their replacement with clear language that provides for the recovery of 100 percent of the actual incremental costs required

to operate to provide the service plus a defined incentive. (Priority: High. First reported 2017. Status: Not adopted.)

- The MMU recommends that units recover all and only the incremental costs, including incremental investment costs without a cap, required to provide Part V reliability service (RMR service) that the unit owner would not have incurred if the unit owner had deactivated its unit as it proposed, plus a defined incentive payment. Customers should bear no responsibility for paying previously incurred (sunk) costs, including a return on or of prior investments. (Priority: High. First reported 2010. Status: Not adopted.)
- The MMU recommends that the same reliability standard be used in capacity auctions as is used by PJM transmission planning. One result of the current design is that a unit may fail to clear in a BRA, decide to retire as a result, but then be found to be needed for reliability by PJM planning and paid under Part V of the OATT (RMR) to remain in service while transmission upgrades are made. (Priority: High. First reported 2023. Status: Not adopted.)
- The MMU recommends that if units that are paid under Part V of the OATT (RMR) are included in the calculation of CETO and/or reliability in the relevant LDA, the capacity of the RMR resources should also be included in capacity market supply at zero cost, but without all the obligations of a capacity resource, in order to ensure that the capacity market price signal reflects the appropriate supply and demand conditions. (Priority: High. First reported 2023. Status: Not adopted.)
- The MMU recommends that units that are paid under Part V of the OATT (RMR) not be included in the calculation of CETO or reliability in the relevant LDA, in order to ensure that the capacity market price signal reflects the appropriate supply and demand conditions. (Priority: High. First reported 2023. Status: Not adopted.)
- The MMU recommends that all CIRs be returned to the pool of available interconnection capability on the retirement date of generation resources in order to facilitate timely and competitive entry into the PJM markets, open access to the transmission system and maintain the priority order defined by



the queue process. (Priority: High. First reported 2023. Status: Not adopted.)

## Conclusion

The analysis of the PJM Capacity Market begins with market design and market structure, which provide the framework for the actual behavior or conduct of market participants. The analysis examines participant behavior within that market design and market structure. Regardless of the ownership structure of a market, the market design can result in noncompetitive outcomes. In a good market design and a competitive market structure, market participants are constrained to behave competitively. In a market with endemic structural market power like the PJM Capacity Market, effective market power mitigation rules are required in order to constrain market participants to behave competitively. The analysis examines market performance, measured by price and the relationship between price and marginal cost, that results from the interaction of market structure and participant behavior. The analysis also examines the impact of market design choices on market performance.

The MMU concludes that the results of the 2025/2026 RPM Base Residual Auction were significantly affected by flawed market design decisions including by the CP design, by PJM's ELCC approach, by the definition of the maximum VRR price as gross CONE, by the failure to extend the RPM must offer requirement to all resources, including, in some cases, the exercise of market power through the withholding of categorically exempt resources, by the product definition and lack of market power mitigation for demand resources, and by the exclusion from supply of the defined RMR resources. The BRA prices do not reflect supply and demand fundamentals but reflect, in significant part, PJM decisions about the definition of supply and demand. The auction results were not solely the result of the introduction of the ELCC market design and do also reflect, in part, the tightening of supply and demand conditions in the PJM Capacity Market.<sup>39</sup>

The capacity market is, by design, always tight in the sense that total supply is generally only slightly larger than demand. While the market may be long at times, that is not the equilibrium state. Market power is and will remain endemic to the structure of the PJM Capacity Market. Nonetheless, a competitive outcome

can be assured by appropriate market power mitigation rules within an effective market design. Detailed market power mitigation rules are included in the PJM Open Access Transmission Tariff (OATT or Tariff). Reliance on the RPM design for competitive outcomes means reliance on the market power mitigation rules.

The demand for capacity includes expected peak load plus a reserve margin, and points on the demand curve, called the Variable Resource Requirement (VRR) curve, exceed peak load plus the reserve margin. The maximum price on the VRR curve has a significant impact on market prices particularly when the market is tight. The shape of the VRR curve results in the purchase of excess capacity and higher payments by customers. The VRR curves used in the 2025/2026 BRA included a maximum price equal to gross CONE for most LDAs that resulted in a significant increase in customer payments for load as a result of paying a price above the competitive level. Demand for capacity is almost entirely inelastic because the market rules require loads to purchase their share of the system capacity requirement. The VRR demand curve is everywhere inelastic. The result is that any supplier that owns more capacity than the typically small difference between total supply and the defined demand is individually pivotal and therefore has structural market power.

For the 2025/2026 RPM Base Residual Auction, the level of committed demand resources (6,085.6 MW UCAP) exceeds the entire level of excess capacity (870.9 MW). This is not consistent with the defined obligations of DR compared to other capacity resources. DR capacity resources do not have a must offer obligation in the energy market. DR capacity resources do not have a must offer obligation in the capacity market. The definition of performance for DR is not to provide a defined incremental level of MW when called but is only to be at a defined level of demand. DR capacity resources do not have a defined market seller offer cap. PJM markets for the first time in 2025/2026 will rely on demand response resources as part of the required reserve margin, rather than as excess above the required reserve margin. PJM markets for the first time in 2025/2026 will experience the implications of the definition of demand resources as a purely emergency capacity resource, when demand resources are a significant share of required reserves. Nonetheless, as another significant flaw in the market design, PJM does not include DR in its definition of

<sup>39</sup> PJM's ELCC filing that created many of these issues was approved by FERC. 186 FERC ¶ 61,080 (January 30, 2024).



primary or secondary reserves in the energy market. DR, for all these reasons, is an inferior resource in the capacity market.

There are currently two important gaps in the market power rules for the PJM Capacity Market. The RPM must offer requirement is not applied uniformly to all capacity resources. There are no market power mitigation rules that apply to demand resources.

All participants to which the three pivotal supplier (TPS) test was applied (in the RTO, BGE, and Dominion RPM markets) failed the three pivotal supplier test. The result was that offer caps were applied to all sell offers for Existing Generation Capacity Resources when the capacity market seller did not pass the test, the submitted sell offer exceeded the tariff defined offer cap, and the submitted sell offer, absent mitigation, would have resulted in a higher market clearing price.<sup>40 41</sup>

The correct definition of a competitive offer in the capacity market is the marginal cost of capacity, net ACR, where ACR includes an explicit accounting for the costs of mitigating risk, including the risk associated with mitigating rational capacity market nonperformance penalties, and the relevant costs of acquiring fuel, including natural gas.

The MMU recommends elimination of the key remaining components of the CP model because they interfere with competitive outcomes in the capacity market and create unnecessary complexity and risk. The use of Net CONE as the basis for the PAI penalty rate is unsupported by economic logic. The use of Net CONE to establish penalties is a form of arbitrary administrative pricing that creates arbitrarily high risk for generators, creates an artificial rationale for not having a must offer obligation for intermittent and storage resources, creates complexity in the calculation of CPQR and increases CPQR above rational levels, and ultimately raises the price of capacity above the competitive level.

Rather than penalizing capacity resources at extremely high levels for nonperformance only during PAI events, capacity resources should be paid the daily price of capacity only to the extent that they are available to

produce energy or provide reserves, as required by PJM on a daily/hourly basis, based on their cleared capacity (ICAP). This is a positive performance incentive based on the market price of capacity rather than a penalty based on an arbitrary assumption. This would mean that capacity resources are paid to provide energy and reserves based on their full ICAP and are not paid a bonus for doing so. The reduced payments for capacity would directly reduce customers' bills for capacity. This would also end the pretense that there will be penalty payments to fund bonus payments. This would also end the need for complex CPQR calculations based on the penalty rate and assumptions about the number and timing of PAI events. CP has not worked as the theory suggested. PAI events are high impact low probability events. The failure of the PAI incentives to prevent a very high level of outages during Winter Storm Elliott illustrates the weakness of incentives based on this type of event. In addition, the actual performance standards were unacceptably weakened in the CP model. The standard of performance in the CP model is  $(B) * (\text{ELCC accredited UCAP factor for a unit})$ , where B is the balancing ratio and the ELCC accredited UCAP factor is the derating factor. For example, if B were 80 percent, the actual required performance for a unit with an 80 percent ELCC accredited UCAP factor would be only 64 percent of ICAP  $(.80 * .80)$ . For units with low ELCC accredited UCAP factors, the required performance is even lower. The obligation to perform should equal the full ICAP value of a unit, consistent with the associated must offer obligation in the energy market for capacity resources.

The MMU is required to identify market issues and to report them to the Commission and to market participants. The Commission decides on any action related to the MMU's findings.

<sup>40</sup> Prior to November 1, 2009, existing DR and EE were subject to market power mitigation in RPM Auctions. See 129 FERC ¶ 61,081 (2009) at P 30.

<sup>41</sup> Effective January 31, 2011, the RPM rules related to market power mitigation were changed, including revising the definition for Planned Generation Capacity Resource and creating a new definition for Existing Generation Capacity Resource for purposes of the must-offer requirement and market power mitigation, and treating a proposed increase in the capability of a Generation Capacity Resource the same in terms of mitigation as a Planned Generation Capacity Resource. See 134 FERC ¶ 61,065 (2011).

The MMU has identified serious market design issues with RPM and the MMU has made specific recommendations to address those issues.<sup>42 43 44 45 46 47 48 49 50 51 52</sup> In 2024, the MMU prepared a number of RPM related reports and testimony, shown in Table 5-2.

The PJM markets have worked to provide incentives to entry and to retain capacity. A majority of capacity investments in PJM were financed by market sources. Of the 55,064.5 MW of additional capacity that cleared in RPM auctions for the 2007/2008 through 2023/2024 Delivery Years, 42,444.9 MW (77.1 percent) were based on market funding. Of the 8,966.4 MW of additional capacity that cleared in RPM auctions for the 2024/2025 and 2025/2026 Delivery Year, 5,532.6 MW (61.7 percent) were based on market funding. Those investments were made based on the assumption that markets would be allowed to work and that inefficient units would exit.

It is essential that any approach to the PJM markets incorporate a consistent view of how the preferred market design is expected to provide competitive results in a sustainable market design over the long run. A sustainable market design means a market design that results in appropriate incentives to competitive market participants to retire units and to invest in new units over time such that reliability is ensured as a result of the functioning of the market.

In order to attract and retain adequate resources for the reliable operation of the energy market, revenues from

PJM energy, ancillary services and capacity markets must be adequate for those resources. That adequacy requires a capacity market. The capacity market plays the essential role of equilibrating the revenues necessary to incent competitive entry and exit of the resources needed for reliability, with the revenues from the energy market that are directly affected by nonmarket sources.

42 See "Analysis of the 2018/2019 RPM Base Residual Auction Revised," <[http://www.monitoringanalytics.com/reports/Reports/2016/IMM\\_Analysis\\_of\\_the\\_20182019\\_RPM\\_Base\\_Residual\\_Auction\\_20160706.pdf](http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Analysis_of_the_20182019_RPM_Base_Residual_Auction_20160706.pdf)> (July 6, 2016).

43 See "Analysis of the 2019/2020 RPM Base Residual Auction Revised," <[http://www.monitoringanalytics.com/reports/Reports/2016/IMM\\_Analysis\\_of\\_the\\_20192020\\_RPM\\_BRA\\_20160831-Revised.pdf](http://www.monitoringanalytics.com/reports/Reports/2016/IMM_Analysis_of_the_20192020_RPM_BRA_20160831-Revised.pdf)> (August 31, 2016).

44 See "Analysis of the 2020/2021 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2017/IMM\\_Analysis\\_of\\_the\\_20202021\\_RPM\\_BRA\\_20171117.pdf](http://www.monitoringanalytics.com/reports/Reports/2017/IMM_Analysis_of_the_20202021_RPM_BRA_20171117.pdf)> (November 11, 2017).

45 See "Analysis of the 2021/2022 RPM Base Residual Auction - Revised," <[http://www.monitoringanalytics.com/reports/Reports/2018/IMM\\_Analysis\\_of\\_the\\_20212022\\_RPM\\_BRA\\_Revised\\_20180824.pdf](http://www.monitoringanalytics.com/reports/Reports/2018/IMM_Analysis_of_the_20212022_RPM_BRA_Revised_20180824.pdf)> (August 24, 2018).

46 See "Analysis of the 2022/2023 RPM Base Residual Auction," <[https://www.monitoringanalytics.com/reports/Reports/2022/IMM\\_Analysis\\_of\\_the\\_20222023\\_RPM\\_BRA\\_20220222.pdf](https://www.monitoringanalytics.com/reports/Reports/2022/IMM_Analysis_of_the_20222023_RPM_BRA_20220222.pdf)> (February 22, 2022).

47 See "Analysis of the 2023/2024 RPM Base Residual Auction," <[https://www.monitoringanalytics.com/reports/Reports/2022/IMM\\_Analysis\\_of\\_the\\_20232024\\_RPM\\_Base\\_Residual\\_Auction\\_20221028.pdf](https://www.monitoringanalytics.com/reports/Reports/2022/IMM_Analysis_of_the_20232024_RPM_Base_Residual_Auction_20221028.pdf)> (October 28, 2022).

48 See the "Analysis of the 2024/2025 RPM Base Residual Auction," <[https://www.monitoringanalytics.com/reports/Reports/2023/IMM\\_Analysis\\_of\\_the\\_20242025\\_RPM\\_Base\\_Residual\\_Auction\\_20231030.pdf](https://www.monitoringanalytics.com/reports/Reports/2023/IMM_Analysis_of_the_20242025_RPM_Base_Residual_Auction_20231030.pdf)> (October 30, 2023).

49 See "Analysis of Replacement Capacity for RPM Commitments: June 1, 2007 to June 1, 2017," <[http://www.monitoringanalytics.com/reports/Reports/2017/IMM\\_Report\\_on\\_Capacity\\_Replacement\\_Activity\\_4\\_20171214.pdf](http://www.monitoringanalytics.com/reports/Reports/2017/IMM_Report_on_Capacity_Replacement_Activity_4_20171214.pdf)> (December 14, 2017).

50 See "Analysis of Replacement Capacity for RPM Commitments: June 1, 2007 to June 1, 2019," <[http://www.monitoringanalytics.com/reports/Reports/2019/IMM\\_Analysis\\_of\\_Replacement\\_Capacity\\_for\\_RPM\\_Commitments\\_June\\_1\\_2007\\_to\\_June\\_1\\_2019\\_20190913.pdf](http://www.monitoringanalytics.com/reports/Reports/2019/IMM_Analysis_of_Replacement_Capacity_for_RPM_Commitments_June_1_2007_to_June_1_2019_20190913.pdf)> (September 13, 2019).

51 See "Analysis of the 2025/2026 RPM Base Residual Auction - Part A," <[https://www.monitoringanalytics.com/reports/Reports/2024/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_A\\_20240920.pdf](https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_A_20240920.pdf)> (September 20, 2024).

52 See "Analysis of the 2025/2026 RPM Base Residual Auction - Part B," <[https://www.monitoringanalytics.com/reports/Reports/2024/IMM\\_Analysis\\_of\\_the\\_20252026\\_RPM\\_Base\\_Residual\\_Auction\\_Part\\_B\\_20241015.pdf](https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_B_20241015.pdf)> (October 15, 2024).

Table 5-2 RPM related MMU reports: 2024

Date	Name
January 12, 2024	IMM Answer to PJM Answer re PJM CIPF Docket No. ER24-99 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_PJM_Answer_Docket_No_ER24-99_20240112.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_PJM_Answer_Docket_No_ER24-99_20240112.pdf</a>
January 14, 2024	Data Submission Window Opening for the 2025/2026 RPM Base Residual Auction <a href="https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Data_Submission_Window_Opening_-_2025-2026_Base_Residual_Auction_20240114.pdf">https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Data_Submission_Window_Opening_-_2025-2026_Base_Residual_Auction_20240114.pdf</a>
January 16, 2024	IMM Answer and Motion for Leave to Answer re PJM MSOC Docket No. ER24-98 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_PJM_Answer_Docket_No_ER24-98_20240116.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_PJM_Answer_Docket_No_ER24-98_20240116.pdf</a>
January 24, 2024	IMM Answer to PJM Def Answer re PJM CIPF Docket No. ER24-99 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_PJM_Def_Answer_Docket_No_ER24-99_20240124.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_PJM_Def_Answer_Docket_No_ER24-99_20240124.pdf</a>
January 25, 2024	IMM Answer and Motion for Leave to Answer re PJM MSOC Docket No. ER24-98 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_PJM_Def_Answer_Docket_No_ER24-98_20240125.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_PJM_Def_Answer_Docket_No_ER24-98_20240125.pdf</a>
February 26, 2024	Generation Capacity Resources in PJM Region Subject to RPM Must Offer Obligation for 2024/2025 and 2025/2026 Delivery Years <a href="https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Notice_re_RPM_Must_Offer_Obligations_20240226.pdf">https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Notice_re_RPM_Must_Offer_Obligations_20240226.pdf</a>
February 29, 2024	IMM Request for Rehearing re PJM CIPF Docket No. ER24-99-000, -001 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Request_for_Rehearing_Docket_No_ER24-99_20240229.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Request_for_Rehearing_Docket_No_ER24-99_20240229.pdf</a>
February 29, 2024	Data Submission Window Opening for the 2025/2026 RPM Base Residual Auction <a href="https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Data_Submission_Window_Opening_2025-2026_RPM_Base_Residual_Auction_Revised_20240229.pdf">https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Data_Submission_Window_Opening_2025-2026_RPM_Base_Residual_Auction_Revised_20240229.pdf</a>
April 3, 2024	EE Addback Education <a href="https://www.monitoringanalytics.com/reports/Presentations/2024/IMM_MIC_EE_Addback_Education_20240403.pdf">https://www.monitoringanalytics.com/reports/Presentations/2024/IMM_MIC_EE_Addback_Education_20240403.pdf</a>
April 18, 2024	IMM Determinations Posted for the PJM 2025/2026 RPM Base Residual Auction <a href="https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Determinations_Posted_for_the_PJM_2025-2026_Base_Residual_Auction-Revised_20240418.pdf">https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Determinations_Posted_for_the_PJM_2025-2026_Base_Residual_Auction-Revised_20240418.pdf</a>
May 31, 2024	IMM Complaint re Indicated EE Sellers Docket No. EL24-113 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Complaint_Docket_No_EL24-113_20240530.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Complaint_Docket_No_EL24-113_20240530.pdf</a>
June 14, 2024	IMM Answer re IMM Complaint EE Suppliers Docket No. EL24-113 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_Motion_Docket_No_EL24-113_20240614.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_Motion_Docket_No_EL24-113_20240614.pdf</a>
June 25, 2024	IMM Answer re Elwood Waiver Request Docket No. ER24-2176 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Answer_Opposing_Elwood_Waiver_Request_Docket_No_ER24-2176_20240625.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Answer_Opposing_Elwood_Waiver_Request_Docket_No_ER24-2176_20240625.pdf</a>
June 25, 2024	IMM Answer re Elgin Waiver Request Docket No. ER24-2173 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Answer_Opposing_Elgin_Waiver_Request_ER24-2173_20240625.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Answer_Opposing_Elgin_Waiver_Request_ER24-2173_20240625.pdf</a>
June 28, 2024	Generation Capacity Resources in PJM Region Subject to RPM Must Offer Obligation for 2025/2026 Delivery Year (PDF) <a href="https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Notice_re_RPM_Must_Offer_Obligations_20240628.pdf">https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Notice_re_RPM_Must_Offer_Obligations_20240628.pdf</a>
July 3, 2024	MMU Calculated Net Revenues for the 2026/2027 RPM Base Residual Auction <a href="https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Calculated_Net_Revenues_2026-2027_Base_Residual_Auction_20240703.pdf">https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Calculated_Net_Revenues_2026-2027_Base_Residual_Auction_20240703.pdf</a>
July 8, 2024	Data Submission Window Opening for the 2026/2027 RPM Base Residual Auction <a href="https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Data_Submission_Window_Opening_2026-2027_Base_Residual_Auction_20240708.pdf">https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Data_Submission_Window_Opening_2026-2027_Base_Residual_Auction_20240708.pdf</a>
July 10, 2024	IMM Complaint re EE Payment Docket No. EL24-126 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Complaint_Docket_No_EL24-xxx_20240710.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Complaint_Docket_No_EL24-xxx_20240710.pdf</a>
July 10, 2024	IMM Comments re JCA EE Complaint Docket No. EL24-118 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Comments_Docket_No_EL24-118_20240710.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Comments_Docket_No_EL24-118_20240710.pdf</a>
July 10, 2024	IMM EE Package Proposal <a href="https://www.monitoringanalytics.com/reports/Presentations/2024/IMM_MIC_EE_Package_Proposal_20240710.pdf">https://www.monitoringanalytics.com/reports/Presentations/2024/IMM_MIC_EE_Package_Proposal_20240710.pdf</a>
July 16, 2024	Generation Capacity Resources in PJM Region Subject to RPM Must Offer Obligation for 2025/2026 Delivery Year (PDF) <a href="https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Notice_re_RPM_Must_Offer_Obligations_20240716.pdf">https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Notice_re_RPM_Must_Offer_Obligations_20240716.pdf</a>
July 24, 2024	IMM EE Package Proposal <a href="https://www.monitoringanalytics.com/reports/Presentations/2024/IMM_MRC_EE_Package_20240724.pdf">https://www.monitoringanalytics.com/reports/Presentations/2024/IMM_MRC_EE_Package_20240724.pdf</a>
August 6, 2024	IMM Answer and Motion for Leave to Answer re IMM Complaint EE Suppliers Docket No. EL24-113 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_Answer_Docket_No_EL24-113_20240806.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_Answer_Docket_No_EL24-113_20240806.pdf</a>
August 15, 2024	IMM Answer and Motion for Leave to Answer and Motion for Summary Disposition re EE Docket No. EL24-126 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_Answer_Docket_No_EL24-126_20240815.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_Answer_Docket_No_EL24-126_20240815.pdf</a>
August 20, 2024	IMM Answer and Motion for Leave to Answer re CPower EE Complaint Docket No. EL24-128 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_PJM_Answer_Docket_No_EL24-128_20240820.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_PJM_Answer_Docket_No_EL24-128_20240820.pdf</a>
September 5, 2024	IMM Determinations Posted for the PJM 2026/2027 RPM Base Residual Auction <a href="https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Determinations_Posted_for_the_PJM_2026-2027_Base_Residual_Auction_20240905.pdf">https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Determinations_Posted_for_the_PJM_2026-2027_Base_Residual_Auction_20240905.pdf</a>
September 20, 2024	Analysis of the 2025/2026 RPM Base Residual Auction - Part A <a href="https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_A_20240920.pdf">https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_A_20240920.pdf</a>
September 27, 2024	Data Submission Window Opening for the 2025/2026 RPM Third Incremental Auction <a href="https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Data_Submission_Window_Opening_2025-2026_Third_Incremental_Auction_20240927.pdf">https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Data_Submission_Window_Opening_2025-2026_Third_Incremental_Auction_20240927.pdf</a>
September 27, 2024	IMM Comments re EE Resources in the Capacity Market Docket No. ER24-2995 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Comments_re_PJM_EE_Filing_Docket_No_ER24-2995_20240927.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Comments_re_PJM_EE_Filing_Docket_No_ER24-2995_20240927.pdf</a>
September 30, 2024	IMM Partial Offer of Settlement re EE Payments Complaint Docket No. EL24-113 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Offer_of_Settlement_Docket_No_EL24-113_20240930.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Offer_of_Settlement_Docket_No_EL24-113_20240930.pdf</a>
October 10, 2024	IMM Comments re Sierra Club Complaint Docket No. EL24-148 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Comments_Docket_No_EL24-148_20241010.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Comments_Docket_No_EL24-148_20241010.pdf</a>
October 14, 2024	IMM Answer and Motion for Leave to Answer re EE Resources in the Capacity Market Docket No. ER24-2995 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_Comments_Docket_No_ER24-2995_20241014.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Answer_to_Comments_Docket_No_ER24-2995_20241014.pdf</a>
October 15, 2024	Analysis of the 2025/2026 RPM Base Residual Auction - Part B <a href="https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_B_20241015.pdf">https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_B_20241015.pdf</a>
October 18, 2024	IMM Comments re JCA EE Complaint Docket No. EL24-118 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Comments_Docket_No_EL24-118_20241018.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Comments_Docket_No_EL24-118_20241018.pdf</a>
October 31, 2024	IMM Answer to Comments re Sierra Club Complaint Docket No. EL24-148 <a href="https://www.monitoringanalytics.com/filings/2024/IMM_Answer_Docket_No_EL24-148_20241031.pdf">https://www.monitoringanalytics.com/filings/2024/IMM_Answer_Docket_No_EL24-148_20241031.pdf</a>
November 6, 2024	Analysis of the 2025/2026 RPM Base Residual Auction - Part C <a href="https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_C_20241106.pdf">https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_C_20241106.pdf</a>
November 27, 2024	IMM Determinations Posted for the PJM 2025/2026 Third Incremental Auction <a href="https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Determinations_on_RPM_Requests_2025-2026_Third_Incremental_Auction_20241127.pdf">https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Determinations_on_RPM_Requests_2025-2026_Third_Incremental_Auction_20241127.pdf</a>
December 6, 2024	Analysis of the 2025/2026 RPM Base Residual Auction- Part D <a href="https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_D_20241206.pdf">https://www.monitoringanalytics.com/reports/Reports/2024/IMM_Analysis_of_the_20252026_RPM_Base_Residual_Auction_Part_D_20241206.pdf</a>
December 30, 2024	Generation Capacity Resources in PJM Region Subject to RPM Must Offer Obligation for 2025/2026 Delivery Year <a href="https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Notice_re_RPM_Must_Offer_Obligations_20241230.pdf">https://www.monitoringanalytics.com/reports/Market_Messages/RPM_Material/IMM_Notice_re_RPM_Must_Offer_Obligations_20241230.pdf</a>
January 6, 2025	IMM Comments re Capacity Market Rules Docket No. ER25-682 <a href="https://www.monitoringanalytics.com/filings/2025/IMM_Comments_Docket_No_ER25-682_20250106.pdf">https://www.monitoringanalytics.com/filings/2025/IMM_Comments_Docket_No_ER25-682_20250106.pdf</a>
January 10, 2025	IMM Comments re Must Offer Exemption for Capacity Resources Docket No. ER25-785 <a href="https://www.monitoringanalytics.com/filings/2025/IMM_Comments_Docket_No_ER25-785_20250110.pdf">https://www.monitoringanalytics.com/filings/2025/IMM_Comments_Docket_No_ER25-785_20250110.pdf</a>
January 14, 2025	IMM Answer to Motion to Extend re PA BRA Complaint Docket No. EL25-46 <a href="https://www.monitoringanalytics.com/filings/2025/IMM_Answer_to_Motion_to_Extend_Docket_No_EL25-46_20250114.pdf">https://www.monitoringanalytics.com/filings/2025/IMM_Answer_to_Motion_to_Extend_Docket_No_EL25-46_20250114.pdf</a>
January 23, 2025	IMM Comments re JCA Capacity Complaint Docket No. EL25-18 <a href="https://www.monitoringanalytics.com/filings/2025/IMM_Comments_Docket_No_EL25-18_20250123.pdf">https://www.monitoringanalytics.com/filings/2025/IMM_Comments_Docket_No_EL25-18_20250123.pdf</a>

## Market Design

With the earlier introduction of the Capacity Performance model and the recent introduction of the ELCC model, combined with a tightening of the capacity supply and demand balance in ICAP terms, it is clear that PJM's choices about the details of market design have a potentially dominant impact on capacity market outcomes in PJM.

RPM prices are locational and may vary depending on transmission constraints into LDAs and local supply and demand conditions.<sup>53</sup> The capacity market is not fully locational. The capacity market locational differences exist only across LDAs. The capacity market design assumes that there are no transmission or operational constraints within LDAs and treats all capacity resources within an LDA as perfect substitutes even when they are not. The lack of a fully locational design is a market design flaw that has resulted in the designation of units as RMRs based on internal constraints that were not recognized in the market clearing process. Existing generation that qualifies as a capacity resource must be offered into RPM auctions, except for categorically exempt intermittent and capacity storage resources including hydro, except for demand resources, and except for resources in a fixed resource requirement (FRR) plan. All load is required to pay for capacity. Participation by LSEs is mandatory, except for those entities that elect the FRR option. There is an administratively determined demand curve that defines scarcity pricing levels and that, with the supply curve derived from capacity offers, determines market prices in each BRA. There are explicit market power mitigation rules that define structural market power, that define offer caps based on the marginal cost of capacity, and that have flexible criteria for competitive offers by new entrants. Demand resources may be offered directly into RPM auctions but do not have a must offer obligation and do not have market seller offer caps and receive the clearing price.

The results of the 2025/2026 RPM Base Residual Auction were significantly affected by flawed market design decisions including by the CP design, by PJM's ELCC approach, by the definition of the maximum VRR price as gross CONE, by the failure to extend the RPM must offer requirement to all resources, including, in

some cases, the exercise of market power through the withholding of categorically exempt resources, by the product definition and lack of market power mitigation for demand resources, and by the exclusion from supply of the defined RMR resources. The BRA prices do not reflect supply and demand fundamentals but reflect, in significant part, PJM decisions about the definition of supply and demand. The auction results were not solely the result of the introduction of the ELCC market design and do also reflect, in part, the tightening of supply and demand conditions in the PJM Capacity Market.<sup>54</sup>

The fundamental mistake of the CP design was to attempt to recreate energy market incentives in the capacity market. The CP model was an explicit attempt to bring energy market shortage pricing into the capacity market design. The CP model was designed on the unsupported assumption that shortage prices in the energy market were not high enough and needed to be increased via the capacity market. The CP design focused on a small number of critical hours (performance assessment hours or PAH, translated into five minute intervals as PAI) and imposed large penalties on generators that failed to produce energy only during those hours. But the use of capacity market penalties rather than energy market incentives created a new risk. While there are differences of opinion about how to value the risk, this CP risk is not risk that is fundamental to the operation of a wholesale power market. This is risk created by the CP design in order to provide an incentive to produce energy during high demand hours that is even higher than the energy market incentive, amplified by an operating reserve demand curves (ORDC). The risk created by CP is not limited to risk for individual generators, but extends to the viability of the market. If penalties create bankruptcies that threaten the viability of required energy output from the affected units, there is a risk to the market.

The CP PAI incentives are not effective market incentives. PAI incentives are administrative and nonmarket incentives that are not compatible with an effective market design. The energy market clearing, in contrast, is transparent and efficient and timely. While there are issues with the details of energy market pricing that must be addressed, including shortage pricing, the energy market does not include or create the significant and long lasting uncertainty created by the PAI rules

<sup>53</sup> Transmission constraints are local capacity import capability limitations (low capacity emergency transfer limit (CETL) margin over capacity emergency transfer objective (CETO)) caused by transmission facility limitations, voltage limitations or stability limitations.

<sup>54</sup> PJM's ELCC filing that created many of these issues was approved by FERC. 186 FERC ¶ 61,080 (January 30, 2024).



as exhibited most dramatically by the results of Winter Storm Elliott. The PAI design creates an administrative process that adds unacceptable uncertainty to the process and that can never approach the effectiveness of the energy market in providing price signals and timely settlement. In addition, the imposition of PAI penalties on intermittent resources when those resources cannot perform is a key reason cited by PJM for the failure to apply the RPM must offer requirement uniformly.

In order to more accurately reflect resources' reliability contributions, ELCC should be significantly refined to include hourly data that would permit integrated unit specific ELCC ratings, to weight summer and winter risk in a more balanced manner, and CP should be modified to eliminate PAI risks, and to pay for actual hourly performance rather than based on relatively inflexible class capacity accreditation ratings derived from a small number of hours of poor performance. In the short run capacity accreditation should recognize the winter capability of thermal resources rather than limiting such resources to summer ratings. Most of the risk recognized in the ELCC model is winter risk but the ELCC accreditation values for thermal resources are capped at the summer ratings. That unnecessarily limits supply and changes the ELCC values for all other resources and changes the system accredited unforced capacity and therefore AUCAP, the maximum level of load that can be served by the existing resources and therefore the reliability requirement. The CIRs of such resources are currently limited by the summer ratings but those rules can and should be changed given the use of the ELCC approach. There is no reason that excess winter CIRs cannot be assigned to these resources immediately.

The initial VRR curve, introduced in 2007, had a maximum price equal to 1.5 times the Net Cost of New Entry (Net CONE), determined annually based on the fixed cost of new generating capacity, or Gross Cost of New Entry (Gross CONE), net of the three year average energy and ancillary service revenues. That VRR curve was structured to yield auction clearing prices equal to the 1.5 times Net CONE when the amount of capacity cleared was less than 99 percent of the target reserve margin, and below 1.5 times Net CONE when the amount of capacity cleared was greater than 99 percent of the target reserve margin. The use of Net CONE was based on the logic of the capacity market, to ensure that

the cost of entry was covered between the energy and capacity markets. Net CONE was the missing money that needed to be recoverable in the capacity market. Net CONE was the equilibrating factor between the capacity market and energy market. The use of Gross CONE is inconsistent with that basic capacity market logic. Gross CONE was introduced as the maximum price based on concerns that Net CONE would be too low. The maximum point on the VRR curve for the 2025/2026 BRA was the higher of Gross CONE or 1.5 times Net CONE and Gross CONE was used. However, if the logic of the markets implies a low Net CONE, that is the right answer. There is nothing inherently wrong with a low Net CONE that requires abandoning the basic capacity market logic. Gross CONE was an intervention designed to increase capacity market prices despite the fact that the basic economic logic did not support that increase. If there is an issue with the calculation of Net CONE, it should be addressed directly rather than by ignoring its central role in the design of the capacity market. As Gross CONE numbers are reasonably well defined, much more focus on getting the net revenues used in the forward auctions is required in order to ensure that market participants have confidence in the Net CONE values used in the auctions.

Currently, intermittent and storage capacity resources are exempt from the RPM must offer requirement. In the 2025/2026 BRA, the sum of cleared MW that were considered categorically exempt from the must offer requirement is 8,233.5 MW, or 40.9 percent of the required reserves and 39.2 percent of total reserves. Demand resources are also exempt from the RPM must offer requirement. Yet such resources combined make up more than two thirds (68.1 percent) of PJM's reserves. Given the growth of such resources and the expected growth based on the interconnection queue, that exemption should be eliminated immediately. The fact that more than two thirds of the PJM reserves depend on resources that are not subject to the RPM must offer requirement means that reliability is significantly less certain than the stated reserve margins indicate. Prior to the implementation of the capacity performance design, all existing capacity resources, except DR, were subject to the RPM must offer requirement. There is no reason to exempt intermittent and capacity storage resources, including hydro, from the RPM must offer requirement. The same rules should apply to all capacity resources. The purpose of the RPM must offer rule, which has



been in place since the beginning of the capacity market in 1999, is to ensure that the capacity market works, and therefore that the energy market works, based on the inclusion of all demand and all supply, to ensure competitive entry, to ensure open access to the transmission system, and to prevent the exercise of market power via withholding of capacity supply. The purpose of the RPM must offer requirement is also to ensure equal access to the transmission system through CIRs (capacity interconnection rights).

If some capacity resources hold CIRs that provide the access to the transmission system required for the deliverability of energy, but do not offer, those resources are exercising market power by blocking access to the transmission system that could be used by a resource willing to offer into the capacity market. That conclusion does not depend on whether withholding directly benefits those resources through a portfolio effect. The result of the failure to offer can be a significant increase in the market price of capacity above the competitive level when that supply is pivotal. The result of the failure to offer was a significant increase in the market price of capacity above the competitive level in the 2025/2026 BRA.

For these reasons, existing resources are required to return CIRs to the market within one year after retirement. The MMU recommends that resources return CIRs to the market on the day of retirement. The same logic should be applied to intermittent and storage capacity resources. The failure to apply the RPM must offer requirement will create increasingly significant market design issues, issues of open access to the transmission system, and market power issues in the capacity market as the level of capacity from intermittent and storage capacity resources increases. The failure to apply the RPM must offer requirement consistently could also result in very significant changes in supply from auction to auction which would create price volatility and uncertainty in the capacity market and put PJM's reliability margin at risk. The capacity market was designed on the basis of a must buy requirement for load and a corresponding must offer requirement for capacity resources. The capacity market can work only if both are enforced.

Consistent with the must offer obligation, performance penalties should not be applied to solar and wind resources when they are not capable of performing

based on ambient conditions. For example, solar resources should be subject to performance penalties if they fail to perform when the sun is shining but should not be subject to performance penalties in the middle of the night. If PAI is retained, this would be a rational application of the PAI penalties that recognizes the physical capabilities of resources and is therefore not discriminatory.

Demand resources (DR) have always been treated more favorably than generation capacity resources. Demand resources do not have an RPM must offer requirement. Demand resources, unlike all other capacity resources, are not subject to market seller offer caps to protect against the exercise of market power. When demand resources are pivotal, as they were for the 2025/2026 BRA, they have structural market power and can and do exercise market power. That conclusion does not depend on whether withholding directly benefits those resources through a portfolio effect. The result of the failure to offer can be a significant increase in the market price of capacity above the competitive level when that supply is pivotal. If the resources clear, it benefits the resources directly. Even if the resources do not clear, higher prices can benefit the owners of capacity portfolios that include such resources as well as resources with an RPM must offer requirement. The MMU recommends that demand resources have defined and enforced market seller offer caps, like all other capacity resources.

## Installed Capacity

On January 1, 2024, RPM installed capacity was 178,375.0 MW (Table 5-3).<sup>55</sup> Over the next 12 months, new generation, unit deactivations, facility reratings, plus import and export shifts resulted in RPM installed capacity of 179,656.2 MW on December 31, 2024, an increase of 1,281.2 MW or 0.7 percent from the January 1 level.<sup>56 57</sup> The 1,281.2 MW increase was the net result of

<sup>55</sup> Percent values shown in Table 5-3 are based on unrounded, underlying data and may differ from calculations based on the rounded values in the tables.

<sup>56</sup> Unless otherwise specified, the capacity described in this section is the summer installed capacity rating of all PJM generation capacity resources, as entered into the Capacity Exchange system, regardless of whether the capacity cleared in the RPM auctions.

<sup>57</sup> Wind resources accounted for 3,321.4 MW, and solar resources accounted for 3,603.3 MW of installed capacity in PJM on January 1, 2024. Prior to the 2023/2024 Delivery Year, PJM administratively reduced the capabilities of all wind generators to 14.7 percent for wind farms in mountainous terrain and 17.6 percent for wind farms in open terrain, and solar generators to 42.0 percent for ground mounted fixed panel, 60.0 percent for ground mounted tracking panel, and 38.0 percent for other than ground mounted solar arrays, of nameplate capacity when determining the installed capacity because wind and solar resources cannot be assumed to be available on peak and cannot respond to dispatch requests. As data became available, unforced capability of wind and solar resources was to be calculated using actual data. There are additional wind and solar resources not reflected in total capacity because they are energy only resources and do not participate in the PJM Capacity Market. See "PJM Manual 21: Rules and Procedures for Determination of Generating Capability," Appendix B.3 Calculation Procedure, Rev. 19 (June 27, 2024). The derating approach has been replaced with ELCC starting in the 2023/2024 Delivery Year.

new or reactivated generation (1,789.5 MW), net capacity modifications (1,048.8 MW), decreases in exports (109.0 MW), and increases in imports (17.1 MW) partially offset by derates (1,003.3 MW) and deactivations or changes in capacity resource status (679.9 MW).


At the beginning of the new delivery year on June 1, 2024, RPM installed capacity was 176,985.3 MW, an increase of 365.6 MW or 0.0 percent from the May 31, 2023, level of 176,619.7 MW. This change occurs as a result of deactivations, derates, capacity modifications, and import/export contracts beginning and/or ending at the start of the new delivery year.

**Table 5-3 Installed capacity (By fuel source): January 1, May 31, June 1, and December 31, 2024<sup>58</sup>**

	01-Jan-24		31-May-24		01-Jun-24		31-Dec-24	
	MW	Percent	MW	Percent	MW	Percent	MW	Percent
Battery	21.9	0.0%	21.9	0.0%	21.5	0.0%	21.5	0.0%
Coal	37,936.3	21.3%	38,013.1	21.5%	37,751.4	21.3%	37,793.7	21.0%
Gas	88,868.7	49.8%	88,815.5	50.3%	88,860.7	50.2%	88,760.5	49.4%
Hybrid	10.2	0.0%	10.2	0.0%	9.3	0.0%	9.3	0.0%
Hydroelectric	7,507.2	4.2%	7,507.2	4.3%	7,673.1	4.3%	7,674.7	4.3%
Nuclear	32,183.0	18.0%	32,180.5	18.2%	32,180.5	18.2%	32,179.9	17.9%
Oil	4,295.6	2.4%	4,184.4	2.4%	3,865.1	2.2%	3,965.9	2.2%
Solar	3,603.3	2.0%	3,780.6	2.1%	4,279.2	2.4%	5,046.5	2.8%
Solid waste	627.4	0.4%	627.4	0.4%	627.4	0.4%	609.4	0.3%
Wind	3,321.4	1.9%	1,478.9	0.8%	1,717.1	1.0%	3,594.8	2.0%
Total	178,375.0	100.0%	176,619.7	100.0%	176,985.3	100.0%	179,656.2	100.0%

Figure 5-1 shows the share of installed capacity by fuel source for the first day of each delivery year, from June 1, 2007, to June 1, 2024, as well as the expected installed capacity for the 2025/2026 Delivery Year, based on the results of all auctions held through December 31, 2024.<sup>59</sup> On June 1, 2007, coal comprised 40.7 percent of the installed capacity, reached a maximum of 42.9 percent in 2012, decreased to 21.3 percent on June 1, 2024, and is expected to decrease to 17.6 percent on June 1, 2025. The share of gas increased from 29.1 percent on June 1, 2007, to 50.2 percent on June 1, 2024, and is expected to increase to 53.0 percent on June 1, 2025.

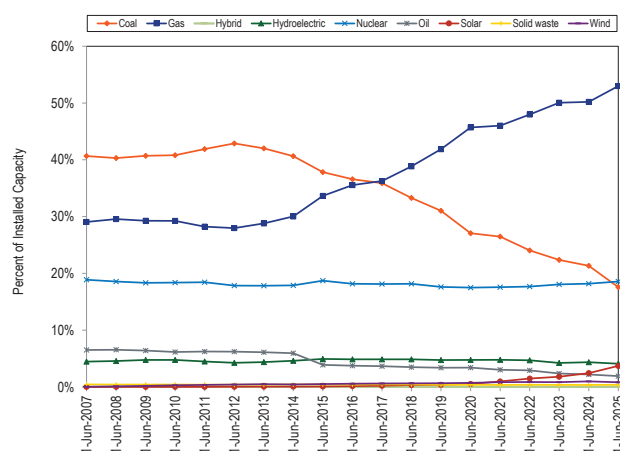**Figure 5-1 Percent of installed capacity (By fuel source): June 1, 2007 through June 1, 2025**



<sup>58</sup> The data for hybrid solar/battery resources are included in the solar data for confidentiality reasons.

<sup>59</sup> Due to ELCC values not being finalized for future delivery years, the expected installed capacity is based on cleared unforced capacity (UCAP) MW using the ELCC submitted with the offer.

Table 5-4 shows the RPM installed capacity on January 1, 2024, through December 31, 2024, for the top five generation capacity resource owners, excluding FRR committed MW.

**Table 5-4 Installed capacity by parent company:  
January 1, May 31, June 1, and December 31, 2024**

Parent Company	01-Jan-24			31-May-24			01-Jun-24			31-Dec-24		
	ICAP (MW)	Percent of Total ICAP	Rank	ICAP (MW)	Percent of Total ICAP	Rank	ICAP (MW)	Percent of Total ICAP	Rank	ICAP (MW)	Percent of Total ICAP	Rank
Constellation Energy Generation, LLC	20,288.1	13.9%	1	20,175.1	14.0%	1	20,137.0	14.1%	1	20,193.6	13.9%	1
ArcLight Capital Partners, LLC	12,115.2	8.3%	2	10,770.9	7.5%	3	10,521.1	7.4%	3	11,406.1	7.9%	4
LS Power Group	11,486.7	7.9%	3	11,485.7	8.0%	2	11,873.4	8.3%	2	12,691.6	8.7%	2
Talen Energy Corporation	10,167.9	7.0%	4	10,167.9	7.1%	4	10,169.2	7.1%	4	10,169.2	7.0%	5
Vistra Energy Corp.	8,669.4	6.0%	5	8,289.3	5.8%	5	8,177.1	5.7%	5	11,748.5	8.1%	3

The sources of funding for generation owners can be categorized as one of two types: market and nonmarket. Market funding is from private investors bearing the investment risk without guarantees or support from any public sources, subsidies or guaranteed payment by ratepayers. Providers of market funding rely entirely on market revenues. Nonmarket funding is from guaranteed revenues, including cost of service rates for a regulated utility and subsidies. Table 5-5 shows the RPM installed capacity on January 1, 2024, to December 31, 2024, by funding type.

**Table 5-5 Installed capacity by funding type: January 1, May 31, June 1, and December 31, 2024**

Funding Type	01-Jan-24		31-May-24		01-Jun-24		31-Dec-24	
	ICAP (MW)	Percent of Total ICAP	ICAP (MW)	Percent of Total ICAP	ICAP (MW)	Percent of Total ICAP	ICAP (MW)	Percent of Total ICAP
Market	131,830.6	73.9%	130,416.4	73.9%	129,209.8	73.0%	131,485.2	73.2%
Nonmarket	46,447.1	26.1%	46,106.0	26.1%	47,723.1	27.0%	48,171.0	26.8%
Total	178,277.7	100.0%	176,522.4	100.0%	176,932.9	100.0%	179,656.2	100.0%

## Fuel Diversity

Figure 5-2 shows the fuel diversity index (FDI<sub>c</sub>) for RPM installed capacity.<sup>60</sup> The FDI<sub>c</sub> is defined as  $1 - \sum_{i=1}^N s_i^2$ , where  $s_i$  is the percent share of fuel type  $i$ . The minimum possible value for the FDI<sub>c</sub> is zero, corresponding to all capacity from a single fuel type. The maximum possible value for the FDI<sub>c</sub> is achieved when each fuel type has an equal share of capacity. For a capacity mix of eight fuel types, the maximum achievable index is 0.875. The fuel type categories used in the calculation of the FDI<sub>c</sub> are in Table 5-3. FDI<sub>c</sub> calculations prior to June 1, 2023 included eight fuel types. Batteries were added to the resource mix on June 1, 2023, and hybrid solar resources were added on January 1, 2024. The maximum achievable index with nine fuel types is 0.889. The maximum achievable index with ten fuel types is 0.900. The FDI<sub>c</sub> is stable and does not exhibit any long-term trends. The only significant deviation occurred with the expansion of the PJM footprint. On April 1, 2002, PJM expanded with the addition of Allegheny Power System, which added about 12,000 MW of generation.<sup>61</sup> The reduction in the FDI<sub>c</sub> resulted from an increase in coal capacity resources. A similar but more significant reduction occurred in 2004 with the expansion into the COMED, AEP, and DAY Control Zones.<sup>62</sup> The average FDI<sub>c</sub> for 2024 decreased 0.5 percent compared to 2023. Figure 5-2 also includes the expected FDI<sub>c</sub> through December 2025. The expected FDI<sub>c</sub> is indicated in Figure 5-2 by the dotted orange line.

The FDI<sub>c</sub> was used to measure the impact on fuel diversity of potential retirements in 2025 through 2030. A total of 34,733 MW of capacity are at risk of retirement, consisting of 4,684 MW currently planning to retire, 16,786 MW expected to retire for regulatory reasons and 13,264 MW expected to be uneconomic.<sup>63</sup> The dotted green line in Figure 5-2 shows the FDI<sub>c</sub> assuming that the capacity from the expected 2025 retirements were replaced by

<sup>60</sup> The MMU developed the FDI to provide an objective metric of fuel diversity. The FDI metric is similar to the HHI used to measure market concentration. The FDI is calculated separately for energy output and for installed capacity. The FDI includes derated capacity values for intermittent capacity subject to derating.


<sup>61</sup> On April 1, 2002, the PJM Region expanded with the addition of Allegheny Power System under a set of agreements known as "PJM-West." See page 4 in the 2002 *Annual State of the Market Report for PJM* for additional details.

<sup>62</sup> See the 2019 *Annual State of the Market Report for PJM*, Volume 2, Appendix A, "PJM Geography" for an explanation of the expansion of the PJM footprint. The integration of the COMED Control Area occurred in May 2004 and the integration of the AEP and DAY Control Zones occurred in October 2004.

<sup>63</sup> See the 2024 *Annual State of the Market Report for PJM*, Volume 2, Section 7: Net Revenue.

gas, wind and solar capacity.<sup>64</sup> The  $FDI_c$  under these assumptions would have been 4.7 percent lower than the actual  $FDI_c$ . The dotted blue line in Figure 5-2 shows the  $FDI_c$  assuming that the capacity from the expected retirements through 2030 were replaced by gas, wind and solar capacity.<sup>65</sup> The counterfactual  $FDI_c$  in this scenario is 8.1 percent lower than the actual  $FDI_c$ .

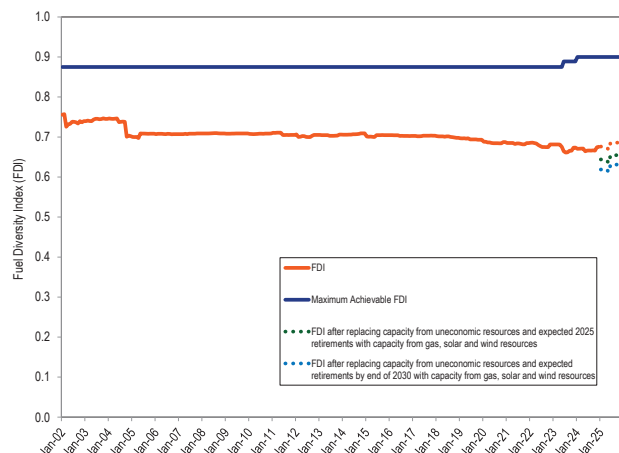**Figure 5-2 Fuel Diversity Index for installed capacity: January 1, 2002 through December 1, 2025**



<sup>64</sup> It is assumed that 620.6 MW of replacement capacity is from solar units and 718.4 MW from wind units, with the remaining replacement capacity coming from gas units. This is the amount of derated wind and solar capacity needed to produce 11,907.4 GWh of generation in 2025 assuming the applicable PJM ELCC capacity derate factors and the average capacity factors for wind and solar capacity resources in Table 8-33 and Table 8-37. This level of GWh represents the increase in renewable generation required by RPS in 2025 over the level of renewable generation that was required by RPS in 2024. The split between solar and wind is based on queue data.

<sup>65</sup> It is assumed that 2,871.8 MW of replacement capacity is from solar units and 3,324.8 MW from wind units, with the remaining replacement capacity coming from gas units. This is the amount of derated wind and solar capacity needed to produce 55,110.7 GWh of generation in 2030 assuming the applicable PJM ELCC capacity derate factors and the average capacity factors for wind and solar capacity resources in Table 8-33 and Table 8-37. This level of GWh represents the increase in renewable generation required by RPS in 2030 over the level of renewable generation that was required by RPS in 2024. The split between solar and wind is based on queue data.

## RPM Capacity Market

The RPM Capacity Market, implemented June 1, 2007, is a forward looking, annual, locational market, with a must offer requirement for existing generation capacity resources, except for intermittent and storage resources including hydro, and except for resources owned by entities that elect the fixed resource requirement (FRR) option, and mandatory participation by load, with performance incentives, that includes clear market power mitigation rules and that permits the direct participation of demand side resources.

Annual base auctions are held in May for delivery years that are three years in the future. Effective January 31, 2010, First, Second, and Third Incremental Auctions are conducted 20, 10, and three months prior to the delivery year.<sup>66</sup> In 2024, the 2024/2025 RPM Third Incremental Auction and the 2025/2026 RPM Base Residual Auction were conducted. The 2024/2025 RPM Base Residual Auction was initially conducted in 2022, but the results were not posted until February 27, 2023, due to an issue with the DPL South reliability requirement. Based on the FERC Order in Docket No. ER23-729-002, PJM reran the 2024/2025 RPM Base Residual Auction with final results posted on May 6, 2024, and PJM reran the 2024/2025 Third Incremental Auction with final results posted on May 23, 2024.<sup>67</sup> The 2025/2026 RPM Base Residual Auction was conducted in July 2024.

## Market Structure

### Supply

Table 5-6 shows generation capacity changes since the implementation of the Reliability Pricing Model through the 2023/2024 Delivery Year. The 12,863.0 MW increase was the result of new generation capacity resources (44,766.8 MW), reactivated generation capacity resources (1,380.4 MW), uprates (8,827.3 MW), integration of external zones (21,967.5 MW), a net decrease in capacity exports (750.9 MW), offset by a net decrease in capacity imports (1,530.2 MW), deactivations (57,779.3 MW) and derates (5,520.4 MW).

Table 5-7 shows the calculated RPM reserve margin and reserve in excess of the defined installed reserve margin (IRM) for June 1, 2021, through June 1, 2025, and accounts for cleared capacity, replacement capacity, and deficiency MW for all auctions held and the most recent

<sup>66</sup> See Letter Order, Docket No. ER10-366-000 (January 22, 2010).

<sup>67</sup> 187 FERC ¶ 61,065 (2024).

peak load forecast for each delivery year. The completion of the replacement process using cleared buy bids from RPM incremental auctions includes two transactions. The first step is for the entity to submit and clear a buy bid in an RPM incremental auction. The next step is for the entity to complete a separate replacement transaction using the cleared buy bid capacity. Prior to the 2025/2026 Delivery Year, replacement capacity transactions can be completed only after the EFORDs for the delivery year are finalized, on November 30 in the year prior to the delivery year, but before the start of the delivery day. Effective with the 2025/2026 Delivery Year, replacement capacity transactions can be completed only after the accredited UCAP factors for the delivery year are finalized, but before the start of the delivery day. Early replacement transactions can be approved for defined physical replacements.

### Future Changes in Generation Capacity<sup>68</sup>

As shown in Table 5-6, for the period from the introduction of the RPM capacity market design in the 2007/2008 Delivery Year through the 2023/2024 Delivery Year, internal installed capacity decreased by 8,325.2 MW after accounting for new capacity resources, reactivations, and uprates (54,974.5 MW) and capacity deactivations and derates (63,299.7 MW).

For the current and future delivery years (2024/2025 through 2025/2026), new generation capacity is defined as capacity that cleared an RPM auction for the first time for the specified delivery year. Based on expected completion rates of cleared new generation capacity (3,272.9 MW) and pending deactivations (2,534.6 MW), PJM capacity is expected to increase by 738.3 MW through the 2025/2026 Delivery Year.

**Table 5-6 Generation capacity changes: 2007/2008 through 2023/2024<sup>69 70</sup>**

	ICAP (MW)								
	New	Reactivations	Uprates	Integration	Net Change in Capacity Imports	Net Change in Capacity Exports	Deactivations	Derates	Net Change
2007/2008	45.0	0.0	691.5	0.0	70.0	15.3	380.0	417.0	(5.8)
2008/2009	815.4	238.3	987.0	0.0	473.0	(9.9)	609.5	421.0	1,493.1
2009/2010	406.5	0.0	789.0	0.0	229.0	(1,402.2)	108.4	464.3	2,254.0
2010/2011	153.4	13.0	339.6	0.0	137.0	367.7	840.6	223.5	(788.8)
2011/2012	3,096.4	354.5	507.9	16,889.5	(1,183.3)	(1,690.3)	2,542.0	176.2	18,637.1
2012/2013	1,784.6	34.0	528.1	47.0	342.4	84.0	5,536.0	317.8	(3,201.7)
2013/2014	198.4	58.0	372.8	2,746.0	934.3	28.9	2,786.9	288.3	1,205.4
2014/2015	2,276.8	20.7	530.2	0.0	2,335.7	177.3	4,915.6	360.3	(289.8)
2015/2016	4,291.8	90.0	449.0	0.0	511.4	(117.8)	8,338.2	215.8	(3,094.0)
2016/2017	3,679.3	532.0	419.2	0.0	575.6	722.9	659.4	206.7	3,617.1
2017/2018	4,127.3	5.0	562.1	0.0	(1,025.1)	(695.1)	2,657.4	148.5	1,558.5
2018/2019	8,127.5	4.0	330.9	2,120.0	(3,217.0)	212.7	6,730.0	89.2	333.5
2019/2020	4,612.0	13.3	494.9	165.0	(1,196.6)	401.3	3,296.0	116.8	274.5
2020/2021	403.1	11.6	575.4	0.0	(37.9)	(111.6)	3,572.0	206.4	(2,714.6)
2021/2022	3,309.3	6.0	412.2	0.0	38.5	1,066.1	2,197.6	125.5	376.8
2022/2023	4,743.2	0.0	417.0	0.0	(469.3)	(868.0)	7,460.5	302.0	(2,203.6)
2023/2024	2,696.8	0.0	420.5	0.0	(47.9)	1,067.8	5,149.2	1,441.1	(4,588.7)
Total	44,766.8	1,380.4	8,827.3	21,967.5	(1,530.2)	(750.9)	57,779.3	5,520.4	12,863.0

As shown in Table 5-7, based on current positions, total reserves on June 1, 2025, will be 21,015.2 MW, of which 870.9 MW (UCAP) are in excess of the required level of reserves, which is 20,144.3 MW (UCAP). In the 2025/2026 BRA, 13,143.2 MW were considered categorically exempt from the must offer requirement based on intermittent and capacity storage classification. Some of these resources were offered as capacity in the BRA and as part of FRR plans. The result was that 3,745.8 MW of intermittent and storage resources (28.5 percent of the categorically exempt MW and 2.8 percent of total cleared MW) were not offered in the 2025/2026 BRA.

In the 2025/2026 BRA, the sum of cleared MW that were considered categorically exempt from the must offer requirement is 8,233.5 MW, or 40.9 percent of the required reserves and 39.2 percent of total reserves. The cleared

<sup>68</sup> For more details on future changes in generation capacity, see "2020 PJM Generation Capacity and Funding Sources 2007/2008 through 2021/2022 Delivery Years," <[http://www.monitoringanalytics.com/reports/Reports/2020/IMM\\_2020\\_PJM\\_Generation\\_Capacity\\_and\\_Funding\\_Sources\\_20072008\\_through\\_20212022\\_DY\\_20200915.pdf](http://www.monitoringanalytics.com/reports/Reports/2020/IMM_2020_PJM_Generation_Capacity_and_Funding_Sources_20072008_through_20212022_DY_20200915.pdf)> (September 15, 2020).

<sup>69</sup> The capacity changes in this report are calculated based on June 1 through May 31.

<sup>70</sup> The uprate values for 2023/2024 and the derate values for 2022/2023 were revised from the 2024 Quarterly State of the Market Report for PJM: January through September.



MW of DR is 6,085.6 MW, or 30.2 percent of required reserves and 29.0 percent of total reserves. The sum of cleared MW that were categorically exempt from the must offer requirement and the cleared MW of DR is 14,319.1 MW, or 71.1 percent of required reserves and 68.1 percent of total reserves.

The fact that more than two thirds (68.1 percent) of the PJM reserves depend on resources that are not subject to the RPM must offer requirement, a core part of the capacity market design, means that reliability is significantly less certain than the stated reserve margins indicate.

**Table 5-7 RPM reserve margin: June 1, 2021, to June 1, 2025<sup>71 72 73</sup>**

	01-Jun-21	01-Jun-22	01-Jun-23	01-Jun-24	01-Jun-25	
Forecast peak load ICAP (MW)	149,482.9	149,263.6	149,382.2	151,631.1	153,883.0	A
FRR peak load ICAP (MW)	11,717.7	28,292.8	29,554.6	30,431.0	11,597.3	B
PRD ICAP (MW)	510.0	230.0	235.0	305.0	224.0	C
Installed reserve margin (IRM)	14.7%	14.9%	14.9%	17.7%	17.8%	D
Pool wide average EFORD	5.22%	5.08%	4.87%	5.10%		E
Pool wide accredited UCAP factor					79.69%	F
Forecast pool requirement (FPR)	1.087	1.091	1.093	1.117	0.939	$G=(1+D)*(1-E)$ or $G=(1+D)*F$
RPM committed less deficiency UCAP (MW) (generation and DR)	156,633.6	137,944.8	136,401.8	138,318.6	134,224.2	H
RPM committed less deficiency ICAP (MW) (generation and DR)	165,260.2	145,327.4	143,384.6	145,751.9	168,432.9	$J=H/(1-E)$ or $J=H/F$
RPM peak load ICAP (MW)	137,255.2	120,740.8	119,592.6	120,895.1	142,061.7	$K=A-B-C$
Reserve margin ICAP (MW)	28,005.0	24,586.6	23,792.0	24,856.9	26,371.2	$L=J-K$
Reserve margin (%)	20.4%	20.4%	19.9%	20.6%	18.6%	$M=L/K$
Reserve margin in excess of IRM ICAP (MW)	7,828.5	6,596.3	5,972.7	3,458.4	1,084.2	$N=L-D*K$
Reserve margin in excess of IRM (%)	5.7%	5.5%	5.0%	2.9%	0.8%	$P=N/K$
RPM peak load UCAP (MW)	130,090.5	114,607.2	113,768.4	114,729.4	113,209.0	$Q=K*(1-E)$ or $Q=K*F$
RPM reliability requirement UCAP (MW)	149,210.1	131,679.9	130,714.7	135,039.8	133,353.3	$R=K*G$
Reserve margin UCAP (MW)	26,543.1	23,337.6	22,633.4	23,589.2	21,015.2	$S=H-Q$
Reserve cleared in excess of IRM UCAP (MW)	7,423.5	6,264.9	5,687.1	3,278.8	870.9	$T=H-R$
Projected replacement capacity UCAP (MW)	0.0	0.0	0.0	0.0	0.0	U
Projected reserve margin	20.4%	20.4%	19.9%	20.6%	18.6%	$V=(J-U)/((1-E)/K-1)$ or $V=(J-U/F)/K-1$

## Sources of Funding<sup>74</sup>

Developers use a variety of sources to fund their projects, including Power Purchase Agreements (PPA), cost of service rates, and private funds (from internal sources or private lenders and investors). PPAs can be used for a variety of purposes and the use of a PPA does not imply a specific source of funding.

New and reactivated generation capacity from the 2007/2008 Delivery Year through the 2023/2024 Delivery Year totaled 46,147.2 MW (83.8 percent of all additions), with 36,021.6 MW from market funding and 10,135.6 MW from nonmarket funding. Uprates to existing generation capacity from the 2007/2008 Delivery Year through the 2023/2024 Delivery Year totaled 8,917.3 MW (16.2 percent of all additions), with 2,494.0 MW from market funding and 2,494.0 MW from nonmarket funding. In summary, of the 55,064.5 MW of additional capacity from new, reactivated, and uprated generation that cleared in RPM auctions for the 2007/2008 through 2023/2024 Delivery Years, 42,444.9 MW (77.1 percent) were based on market funding.

Of the 8,966.4 MW of the additional generation capacity (new resources, reactivated resources, and uprates) that cleared in RPM auctions for the 2024/2025 and 2025/2026 Delivery Years, 2,084.6 MW are not yet in service. Of those 2,084.6 MW that have not yet gone into service, 1,666.0 MW have market funding and 418.6 MW have nonmarket funding. Applying the historical completion rates, 65.0 percent of all the projects in development are expected to go into service (1,078.9 MW of the 1,666.0 MW of in development market funded projects; 277.1 MW of the 418.6 MW in development nonmarket funded projects).<sup>75</sup>

<sup>71</sup> The calculated reserve margins in this table do not include EE on the supply side or the EE addback on the demand side. The EE excluded from the supply side for this calculation includes annual EE and summer EE. This is how PJM calculates the reserve margin.

<sup>72</sup> These reserve margin calculations do not consider Fixed Resource Requirement (FRR) load.

<sup>73</sup> The RPM committed less deficiency MW values (rows H and J) and resultant reserve margin calculations for June 1, 2023, and June 1, 2024, were revised from the 2024 Quarterly State of the Market Report for PJM: January through September.

<sup>74</sup> For more details on sources of funding for generation capacity, see "2020 PJM Generation Capacity and Funding Sources 2007/2008 through 2021/2022 Delivery Years," <[http://www.monitoringanalytics.com/reports/Reports/2020/JMM\\_2020\\_PJM\\_Generation\\_Capacity\\_and\\_Funding\\_Sources\\_20072008\\_through\\_20212022\\_DY\\_20200915.pdf](http://www.monitoringanalytics.com/reports/Reports/2020/JMM_2020_PJM_Generation_Capacity_and_Funding_Sources_20072008_through_20212022_DY_20200915.pdf)> (September 15, 2020).

<sup>75</sup> See the 2023 Annual State of the Market Report for PJM, Volume 2, Section 12: Generation and Transmission Planning.

Of the 6,881.8 MW of the additional generation capacity that cleared in RPM auctions for the 2024/2025 and 2025/2026 Delivery Years and are already in service, 3,866.6 MW (56.2 percent) are based on market funding and 3,015.2 MW (43.8 percent) are based on nonmarket funding.

In summary, 5,532.6 MW (61.7 percent) of the additional generation capacity (1,666.0 MW not yet in service and 3,866.6 MW in service) that cleared in RPM auctions for the 2024/2025 and 2025/2026 Delivery Years are based on market funding. Capacity additions based on nonmarket funding are 3,433.8 MW (43.8 percent) of proposed generation that cleared the RPM auctions for the 2024/2025 and 2025/2026 Delivery Years.

## Demand

The MMU analyzed market sectors in the PJM Capacity Market to determine how they met their load obligations. The PJM Capacity Market was divided into the following sectors:

- **PJM EDC.** EDCs with a franchise service territory within the PJM footprint. This sector includes traditional utilities, electric cooperatives, municipalities and power agencies.
- **PJM EDC Generating Affiliate.** Affiliate companies of PJM EDCs that own generating resources.
- **PJM EDC Marketing Affiliate.** Affiliate companies of PJM EDCs that sell power and have load obligations in PJM, but do not own generating resources.
- **Non-PJM EDC.** EDCs with franchise service territories outside the PJM footprint.
- **Non-PJM EDC Generating Affiliate.** Affiliate companies of non-PJM EDCs that own generating resources.
- **Non-PJM EDC Marketing Affiliate.** Affiliate companies of non-PJM EDCs that sell power and have load obligations in PJM, but do not own generating resources.
- **Non-EDC Generating Affiliate.** Affiliate companies of non-EDCs that own generating resources.
- **Non-EDC Marketing Affiliate.** Affiliate companies of non-EDCs that sell power and have load obligations in PJM, but do not own generating resources.


On June 1, 2024, PJM EDCs and their affiliates maintained a majority market share of load obligations under RPM, together totaling 56.4 percent (Table 5-8), down from 57.3 percent on June 1, 2023. The combined market share of LSEs not affiliated with any EDC and of non-PJM EDC affiliates was 43.6 percent, up from 42.7 percent on June 1, 2023. The share of capacity market load obligation fulfilled by PJM EDCs and their affiliates, and LSEs not affiliated with any EDC and non-PJM EDC affiliates from June 1, 2007, to June 1, 2024, is shown in Figure 5-3. PJM EDCs' and their affiliates' share of load obligation has decreased from 77.5 percent on June 1, 2007, to 56.4 percent on June 1, 2024. The share of load obligation held by LSEs not affiliated with any EDC and non-PJM EDC affiliates increased from 22.5 percent on June 1, 2007, to 43.6 percent on June 1, 2024.<sup>76</sup>

**Table 5-8 Capacity market load obligation served: June 1, 2023 and June 1, 2024**

	01-Jun-23		01-Jun-24		Change	
	Obligation (MW)	Percent of total obligation	Obligation (MW)	Percent of total obligation	Obligation (MW)	Percent of total obligation
PJM EDCs and Affiliates	101,469.1	57.3%	106,462.1	56.4%	4,993.0	(0.9%)
LSEs not affiliated with any EDC + non EDC Affiliates	75,548.7	42.7%	82,180.1	43.6%	6,631.5	0.9%
Total	177,017.7	100.0%	188,642.2	100.0%	11,624.5	0.0%

<sup>76</sup> Prior to the 2012/2013 Delivery Year, obligation was defined as cleared and make whole MW in the Base Residual Auction and the Second Incremental Auction plus ILR forecast obligations. Effective with the 2012/2013 Delivery Year, obligation is defined as the sum of the unforced capacity obligations satisfied through all RPM auctions for the delivery year.

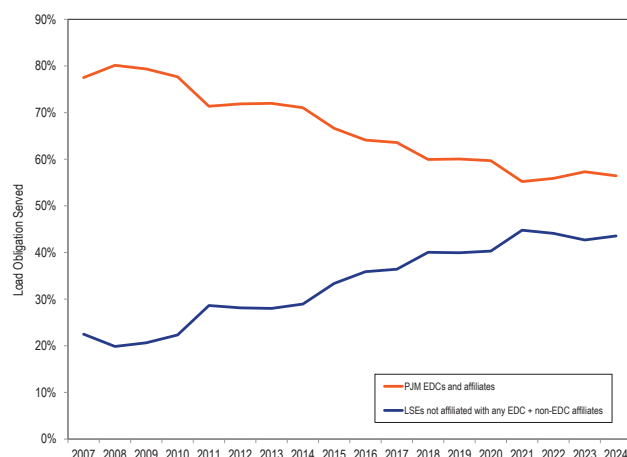**Figure 5-3 Capacity market load obligation served: June 1, 2007 through June 1, 2024**



### Capacity Transfer Rights (CTRs)

Capacity Transfer Rights (CTRs) are used to return capacity market congestion revenues to load. Load pays congestion. Capacity market congestion revenues are the difference between the total dollars paid by load for capacity and the total dollars received by capacity market sellers. The MW of CTRs available for allocation to LSEs in an LDA are equal to the Unforced Capacity imported into the LDA, less any MW of CETL paid for directly by market participants in the form of Qualifying Transmission Upgrades (QTUs) cleared in an RPM Auction, and Incremental Capacity Transfer Rights (ICTRs). There are two types of ICTRs, those allocated to a New Service Customer obligated to fund a transmission facility or upgrade and those associated with Incremental Rights-Eligible Required Transmission Enhancements.

The total required capacity in an LDA is provided by a mix of internal capacity and imported capacity. The imported capacity equals the total required capacity minus the internal capacity. The value of CTRs is based on the fact that load in an LDA pays the clearing price for all cleared capacity but that generators who provide imported capacity are paid a lower price based on the LDA in which they are located. The value of CTRs equals the imported MW times the price difference. This excess is paid by load and is returned to load using CTRs. CTRs are intended to permit customers to receive the benefit of importing cheaper capacity using transmission capability.

But PJM does not use the actual MW cleared in the BRA and three incremental auctions, the actual internal MW and the actual imported MW, when defining what customers pay and when defining the value of CTRs. Under the current rules, PJM defines the total MW needed for reliability in an LDA when clearing the BRA based on forecast demand at the time of the BRA. But PJM actually charges customers for the total MW needed for reliability based on forecast demand three years later, prior to the actual delivery year, and applies a zonal allocation. PJM also defines the internal capacity as the internal capacity after the final incremental auction conducted three years after the BRA, when auctions follow the traditional schedule. The difference between the updated MW needed for reliability and the updated internal capacity is the updated imported MW, adjusted for the final zonal allocation. In cases where the updated imported MW are smaller than the imported MW from the actual auction clearing, the total value of CTRs is lower than it would be if the actual auction clearing MW were used.

The actual load charges are allocated to each zone based on the ratio of the zonal forecast peak load to the RTO forecast peak load used for the third incremental auction conducted three months prior to the delivery year.

The CTR issue implies a broader issue with capacity market clearing and settlements. The capacity market is cleared based on a three year ahead forecast of load and offers of capacity. Payments to capacity resources in the delivery year are based on the capacity market clearing prices and quantities. But payments by customers in the delivery year are not based on market clearing prices and quantities. Payments by customers in each zone are based on the ratio of zonal forecast peak load to the RTO forecast peak load used for the Third Incremental Auction, run three months prior to the delivery year when auctions follow the traditional schedule.<sup>77</sup> The allocation sometimes creates significant differences between the capacity cleared to meet the reliability requirement and the capacity obligation allocated to the customers in a zone. For example, ComEd Zone, which is identical to ComEd LDA, cleared 27,932.1 MW including 5,574.0 MW of imports in the 2021/2022 RPM BRA. The ComEd Zone's capacity obligation, immediately after the clearing of the Base Residual Auction was 24,983.0 MW. The final ComEd Zone's capacity obligation for the

<sup>77</sup> See "PJM Manual 18: PJM Capacity Market," § 7.2.3 Final Zonal Unforced Capacity Obligations, Rev. 59 (June 27, 2024).

2021/2022 Delivery Year after the Third Incremental Auction was 22,721.2 MW.

As with CTRs, the underlying reasons for not using the market clearing results are not clear. Although not stated explicitly, the goal appears to be to reflect the fact that actual loads change between the auction and the delivery year. But the simple reallocation of capacity obligations based on changes in the load forecast does not reflect the BRA market results. The MMU recommends that the market clearing results be used in settlements rather than the reallocation process currently used or that the process of modifying the obligations to pay for capacity be reviewed.

For LDAs in which the RPM auctions for a delivery year resulted in a positive average weighted Locational Price Adder, an LSE with CTRs corresponding to the LDA is entitled to a payment or charge equal to the Locational Price Adder multiplied by the MW of the LSEs' CTRs. The definition of the MW does not reflect auction clearing MW.

In the 2025/2026 RPM Base Residual Auction, BGE had 4,990.0 MW of CTRs with a total value of \$357.8 million and DOM had 1,903.3 MW of CTRs with a total value of 121.1 million.

BGE had 65.7 MW of customer funded ICTRs with a total value of \$4.7 million.

BGE had 306.0 MW of ICTRs due to Incremental Rights-Eligible Required Transmission Enhancements with a value of 21.9 million.

## Demand Curve


A central feature of PJM's Reliability Pricing Model (RPM) design is that the demand curve, or Variable Resource Requirement (VRR) curve, has a downward sloping segment. In the RPM market design, the supply of three year forward capacity is cleared against this VRR curve. A VRR curve is defined for each Locational Deliverability Area (LDA). This shape replaced the vertical demand curve at the reliability requirement. The downward sloping segment begins at the MW level that is approximately 1.0 percent less than the reliability requirement.<sup>78</sup> Figure 5-4 shows the shape of the VRR curve for the 2025/2026 RPM Base Residual Auction.

The initial VRR curve, introduced in 2007, had a maximum price equal to 1.5 times the Net Cost of New Entry (Net CONE), determined annually based on fixed cost of new generating capacity, which is the Gross Cost of New Entry (Gross CONE), net of the three year average energy and ancillary service revenues. That VRR curve was structured to yield auction clearing prices equal to 1.5 times Net CONE when the amount of capacity cleared was less than 99 percent of the target reserve margin and below 1.5 times Net CONE when the amount of capacity cleared was greater than 99 percent of the target reserve margin.

Effective for the 2018/2019 and subsequent delivery years, PJM revised the VRR curve.<sup>79</sup> PJM defines the reliability requirement as the capacity needed to satisfy the one event in ten years loss of load expectation (LOLE) for the RTO and capacity needed to satisfy the one event in 25 years loss of load expectation for the each LDA. The maximum price on the VRR curve is the greater of Gross CONE or 1.5 times Net CONE for all unforced capacity MW between 0 and 99 percent of the reliability requirement. The first downward sloping segment is from 99 percent and 101.7 percent of the reliability requirement. The second downward sloping segment is from 101.7 percent and 106.8 percent of the reliability requirement (Figure 5-4).

Figure 5-4 shows the RTO VRR curve and RTO reliability requirement for the 2025/2026 RPM BRA.

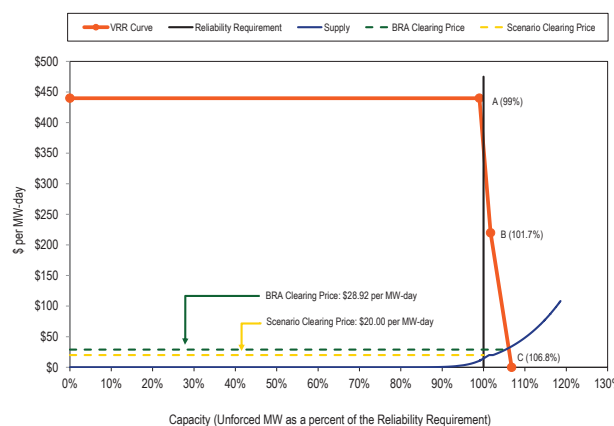**Figure 5-4 Shape of the VRR curve relative to the reliability requirement: 2025/2026 Delivery Year**



<sup>78</sup> The formula for the MW level where the VRR curve begins the downward slope is given by  $(\text{Reliability Requirement}) \times [1 - 1.2\% / (\text{Installed Reserve Margin})]$ .

<sup>79</sup> "Third Triennial Review of PJM's Variable Resource Requirement Curve," The Brattle Group, May 15, 2014, <<http://www.pjm.com/media/library/reports-notices/reliability-pricing-model/20140515-brattle-2014-pjm-vrr-curve-report.ashx?la=en>>.

## Market Concentration

### Auction Market Structure

As shown in Table 5-9, in the 2024/2025 RPM Third Incremental Auction and the 2025/2026 RPM Base Residual Auction all participants in the total PJM market as well as the LDA RPM markets failed the three pivotal supplier (TPS) test.<sup>80</sup> Offer caps were applied to all sell offers for resources which were subject to mitigation when the capacity market seller did not pass the test, the submitted sell offer exceeded the defined offer cap, and the submitted sell offer, absent mitigation, increased the market clearing price.<sup>81 82 83</sup>

In applying the market structure test, the relevant supply for the RTO market includes all supply offered at less than or equal to 150 percent of the RTO cost-based clearing price. The relevant supply for the constrained LDA markets includes the incremental supply inside the constrained LDAs which was offered at a price higher than the unconstrained clearing price for the parent LDA market and less than or equal to 150 percent of the cost-based clearing price for the constrained LDA. The relevant demand consists of the MW needed inside the LDA to relieve the constraint.

Table 5-9 presents the results of the TPS test. A generation owner or owners are pivotal if the capacity of the owners' generation facilities is needed to meet the demand for capacity. The results of the TPS are measured by the residual supply index ( $RSI_x$ ). The  $RSI_x$  is a general measure that can be used with any number of pivotal suppliers. The subscript denotes the number of pivotal suppliers included in the test. If the  $RSI_x$  is less than or equal to 1.0, the supply owned by the specific generation owner, or owners, is needed to meet market demand and the generation owners are pivotal suppliers with a significant ability to influence market prices. If the  $RSI_x$  is greater than 1.0, the supply of the specific generation owner or owners is not needed to meet market demand and those generation owners have a reduced ability to unilaterally influence market price.

<sup>80</sup> The market definition used for the TPS test includes all offers with costs less than or equal to 1.50 times the clearing price. See *MMU Technical Reference for PJM Markets*, at "Three Pivotal Supplier Test" for additional discussion.

<sup>81</sup> See OATT Attachment DD § 6.5.

<sup>82</sup> Prior to November 1, 2009, existing DR and EE resources were subject to market power mitigation in RPM Auctions. See 129 FERC ¶ 61,081 at P 30 (2009).

<sup>83</sup> Effective January 31, 2011, the RPM rules related to market power mitigation were changed, including revising the definition for planned generation capacity resource and creating a new definition for existing generation capacity resource for purposes of the must offer requirement and market power mitigation, and treating a proposed increase in the capability of a generation capacity resource the same in terms of mitigation as a planned generation capacity resource. See 134 FERC ¶ 61,065 (2011).

**Table 5-9 RSI results: 2022/2023 through 2025/2026 RPM Auctions<sup>84</sup>**

RPM Markets	$RSI_{1,105}$	$RSI_3$	Total Participants	Failed $RSI_3$ Participants
2022/2023 Base Residual Auction				
RTO	0.81	0.73	130	130
MAAC	0.69	0.37	25	25
EMAAC	1.25	0.64	7	7
ComEd	0.43	0.36	14	14
BGE	0.00	0.00	1	1
DEOK	0.00	0.00	1	1
2022/2023 Third Incremental Auction				
RTO	0.68	0.50	43	43
MAAC	0.40	0.05	9	9
2023/2024 Base Residual Auction				
RTO	0.78	0.68	134	134
MAAC	0.78	0.40	11	11
DPL South	0.00	0.00	1	1
BGE	0.00	0.00	1	1
2023/2024 Third Incremental Auction				
RTO	0.77	0.76	51	15
MAAC	0.41	0.76	17	9
EMAAC	0.45	0.18	10	10
BGE	0.00	0.00	1	1
2024/2025 Base Residual Auction				
RTO	0.77	0.64	133	133
MAAC	0.59	0.11	9	9
EMAAC	0.48	0.00	2	2
DPL South	0.00	0.00	1	1
BGE	0.00	0.00	1	1
DEOK	0.00	0.00	1	1
2024/2025 Third Incremental Auction				
RTO	0.88	0.59	64	64
MAAC	0.60	0.17	10	10
EMAAC	0.00	0.00	1	1
BGE	0.00	0.00	1	1
2025/2026 Base Residual Auction				
RTO	0.82	0.62	128	128
BGE	0.00	0.00	0	0
Dominion	0.00	0.00	0	0

### Locational Deliverability Areas (LDAs)

Under the PJM Tariff, PJM determines, in advance of each BRA, whether defined Locational Deliverability Areas (LDAs) will be modeled in the auction. Effective with the 2012/2013 Delivery Year, an LDA is modeled as a potentially constrained LDA for a delivery year if the Capacity Emergency Transfer Limit (CETL) is less than 1.15 times the Capacity Emergency Transfer Objective (CETO), such LDA had a locational price adder in one or more of the three immediately preceding BRAs, or such LDA is determined by PJM in a preliminary analysis to be likely to have a locational price adder based on historic offer price levels. The rules also provide that starting

<sup>84</sup> The RSI shown is the lowest RSI in the market.



with the 2012/2013 Delivery Year, EMAAC, SWMAAC, and MAAC LDAs are modeled as potentially constrained LDAs regardless of the results of the above three tests.<sup>85</sup> In addition, PJM may establish a constrained LDA even if it does not qualify under the above tests if PJM finds that “such is required to achieve an acceptable level of reliability.”<sup>86</sup> A reliability requirement and a Variable Resource Requirement (VRR) curve are established for each modeled LDA. Effective for the 2014/2015 through 2016/2017 Delivery Years, a Minimum Annual and a Minimum Extended Summer Resource Requirement were established for each modeled LDA. Effective for the 2017/2018 Delivery Year, Sub-Annual and Limited Resource Constraints, replacing the Minimum Annual and a Minimum Extended Summer Resource Requirements, were established for each modeled LDA.<sup>87</sup> <sup>88</sup> Effective for the 2018/2019 and the 2019/2020 Delivery Years, a Base Capacity Demand Resource Constraint and a Base Capacity Resource Constraint, replacing the Sub-Annual and Limited Resource Constraints, were established for each modeled LDA.

## Imports and Exports

Units external to the metered boundaries of PJM can qualify as PJM capacity resources if they meet the requirements to be capacity resources. Generators on the PJM system that do not have a commitment to serve PJM loads in the given delivery year as a result of RPM auctions, FRR capacity plans, locational UCAP transactions, and/or are not designated as a replacement resource, are eligible to export their capacity from PJM.<sup>89</sup>

The market rules in other balancing authorities should also not create inappropriate barriers to the import or export of capacity. The PJM market rules should ensure that the definition of capacity is enforced including physical deliverability, recallability and the obligation to make competitive offers into the PJM Day-Ahead Energy Market equal to ICAP MW. Physical deliverability can only be assured by requiring that all imports are deliverable to PJM load to ensure that they are full substitutes for internal capacity resources. Selling capacity into the PJM Capacity Market but making energy offers daily of \$999 per MWh would not fulfill the requirements of a capacity resource to make

a competitive offer, but would constitute economic withholding. This is one of the reasons that the rules governing the obligation to make a competitive offer in the day-ahead energy market should be clarified for both internal and external resources. The PJM market rules should also not create inappropriate barriers to either the import or export of capacity.

The calculation of CETL should only include capacity imports into PJM where the capacity has an explicit must offer requirement in the PJM Capacity Market. These could include pseudo tied units or resources with a grandfathered obligation. The external capacity that does not have a must offer requirement in the PJM Capacity Market is not obligated to serve PJM load under all conditions and therefore should not be assumed to be a source of capacity. This capacity should not be included in PJM’s power flow calculations used to derive CETL values between PJM’s LDAs. PJM has modified its CETL calculations to exclude such capacity.

The establishment of a pseudo tie is one requirement for an external resource to be eligible to participate in the PJM Capacity Market. Pseudo tied external resources, regardless of their location, are treated as only meeting the reliability requirements of the rest of RTO and not the reliability requirements of any specific locational deliverability area (LDA). All imports offered in the auction from areas external to PJM are modeled as supply in the rest of RTO and not in any specific zonal or subzonal LDA. The fact that pseudo tied external resources cannot be identified as equivalent to resources internal to specific LDAs illustrates a fundamental issue with capacity imports. Capacity imports are not equivalent to, nor substitutes for, internal resources. All internal resources are internal to a specific LDA.<sup>90</sup>

Effective May 9, 2017, significantly improved pseudo tie requirements for external generation capacity resources were implemented.<sup>91</sup> The rule changes include: defining coordination with other Balancing Authorities when conducting pseudo tie studies; establishing an electrical distance requirement; establishing a market to market flowgate test to establish limits on the number of coordinated flowgates PJM must add in order to accommodate a new pseudo tie; a model consistency requirement; the requirement for the capacity market

<sup>85</sup> Prior to the 2012/2013 Delivery Year, an LDA with a CETL less than 1.05 times CETO was modeled as a constrained LDA in RPM. No additional criteria were used in determining modeled LDAs.

<sup>86</sup> OATT Attachment DD § 5.10 (a) (ii).

<sup>87</sup> 146 FERC ¶ 61,052 (2014).

<sup>88</sup> Locational Deliverability Areas are shown in maps in the *2021 Annual State of the Market Report for PJM*, Volume 2, Section 5, “Capacity Market” at “Locational Deliverability Areas (LDAs)”.

<sup>89</sup> OATT Attachment DD § 5.6.6(b).

<sup>90</sup> External resources are not assigned to any of the five global LDAs or 22 zonal and subzonal LDAs. PJM’s current practice is to model external resources in the rest of RTO. The practice is not currently documented by PJM. It was previously documented in “PJM Manual 18: PJM Capacity Market,” § 2.3.4 Capacity Import Limits, Rev. 39 (Dec. 21, 2017).

<sup>91</sup> 161 FERC ¶ 61,197 (2017).

seller to provide written acknowledgement from the external Balancing Authority Areas that such pseudo tie does not require tagging and that firm allocations associated with any coordinated flowgates applicable to the external Generation Capacity Resource under any agreed congestion management process then in effect between PJM and such Balancing Authority Area will be allocated to PJM; the requirement for the capacity market seller to obtain long-term firm point to point transmission service for transmission outside PJM with rollover rights and to obtain network external designated transmission service for transmission within PJM; establishing an operationally deliverable standard; and modifying the nonperformance penalty definition for external generation capacity resources to assess performance at subregional transmission organization granularity.

Generation external to the PJM region is eligible to be offered into an RPM auction if it meets specific requirements.<sup>92 93 94</sup> Firm transmission service must be acquired from all external transmission providers between the unit and border of PJM and generation deliverability into PJM must be demonstrated prior to the start of the delivery year. In order to demonstrate generation deliverability into PJM, external generators must obtain firm point to point transmission service on the PJM OASIS from the PJM border into the PJM transmission system or by obtaining network external designated transmission service. In the event that transmission upgrades are required to establish deliverability, those upgrades must be completed by the start of the delivery year. The following are also required: the external generating unit must be in the resource portfolio of a PJM member; 12 months of NERC/GADs unit performance data must be provided to establish an EFORD; the net capability of each unit must be verified through winter and summer testing; and a letter of non-recallability must be provided to assure PJM that the energy and capacity from the unit is not recallable to any other balancing authority.

All external generation resources that have an RPM commitment or FRR capacity plan commitment or that

are designated as replacement capacity must be offered in the PJM day-ahead energy market.<sup>95</sup>

Planned External Generation Capacity Resources are eligible to be offered into an RPM Auction if they meet specific requirements.<sup>96 97</sup> Planned External Generation Capacity Resources are proposed Generation Capacity Resources, or a proposed increase in the capability of an Existing Generation Capacity Resource, that is located outside the PJM region; participates in the generation interconnection process of a balancing authority external to PJM; is scheduled to be physically and electrically interconnected to the transmission facilities of such balancing authority on or before the first day of the delivery year for which the resource is to be committed to satisfy the reliability requirements of the PJM region; and is in full commercial operation prior to the first day of the delivery year.<sup>98</sup> An External Generation Capacity Resource becomes an Existing Generation Capacity Resource as of the earlier of the date that interconnection service commences or the resource has cleared an RPM Auction for a prior delivery year.<sup>99</sup>

As shown in Table 5-10, of the 1,268.5 MW of imports offered in the 2025/2026 RPM Base Residual Auction, 1,268.5 MW cleared. Of the cleared imports, 700.5 MW (55.2 percent) were from MISO.

92 See "Reliability Assurance Agreement Among Load Serving Entities in the PJM Region," Schedule 9 Et 10.

93 "PJM Manual 18: PJM Capacity Market," § 4.2.2 Existing Generation Capacity Resources – External, Rev. 59 (June 27, 2024).

94 "PJM Manual 18: PJM Capacity Market," § 4.6.4 Importing an External Generation Resource, Rev. 59 (June 27, 2024).

95 OATT Schedule 1 § 1.10.1A.

96 See "Reliability Assurance Agreement among Load Serving Entities in the PJM Region," Section 1.69A.

97 "PJM Manual 18: PJM Capacity Market," § 4.2.4 Planned Generation Capacity Resources – External, Rev. 59 (June 27, 2024).

98 Prior to January 31, 2011, capacity modifications to existing generation capacity resources were not considered planned generation capacity resources. See 134 FERC ¶ 61,065 (2011).

99 Effective January 31, 2011, the RPM rules related to market power mitigation were changed, including revising the definition for Planned Generation Capacity Resource for purposes of the must-offer requirement and market power mitigation. See 134 FERC ¶ 61,065 (2011).

**Table 5-10 RPM imports: 2007/2008 through 2025/2026 RPM Base Residual Auctions**

Base Residual Auction	UCAP (MW)					
	MISO		Non-MISO		Total Imports	
	Offered	Cleared	Offered	Cleared	Offered	Cleared
2007/2008	1,073.0	1,072.9	547.9	547.9	1,620.9	1,620.8
2008/2009	1,149.4	1,109.0	517.6	516.8	1,667.0	1,625.8
2009/2010	1,189.2	1,151.0	518.8	518.1	1,708.0	1,669.1
2010/2011	1,194.2	1,186.6	539.8	539.5	1,734.0	1,726.1
2011/2012	1,862.7	1,198.6	3,560.0	3,557.5	5,422.7	4,756.1
2012/2013	1,415.9	1,298.8	1,036.7	1,036.7	2,452.6	2,335.5
2013/2014	1,895.1	1,895.1	1,358.9	1,358.9	3,254.0	3,254.0
2014/2015	1,067.7	1,067.7	1,948.8	1,948.8	3,016.5	3,016.5
2015/2016	1,538.7	1,538.7	2,396.6	2,396.6	3,935.3	3,935.3
2016/2017	4,723.1	4,723.1	2,770.6	2,759.6	7,493.7	7,482.7
2017/2018	2,624.3	2,624.3	2,320.4	1,901.2	4,944.7	4,525.5
2018/2019	2,879.1	2,509.1	2,256.7	2,178.8	5,135.8	4,687.9
2019/2020	2,067.3	1,828.6	2,276.1	2,047.3	4,343.4	3,875.9
2020/2021	2,511.8	1,671.2	2,450.0	2,326.0	4,961.8	3,997.2
2021/2022	2,308.4	1,909.9	2,162.0	2,141.9	4,470.4	4,051.8
2022/2023	954.9	954.9	603.1	603.1	1,558.0	1,558.0
2023/2024	967.9	836.5	560.1	560.1	1,528.0	1,396.6
2024/2025	949.9	820.4	577.2	577.2	1,527.1	1,397.6
2025/2026	700.5	700.5	568.0	568.0	1,268.5	1,268.5

## Demand Resources

The level of DR products that buy out of their positions after the BRA means that the treatment of DR has a negative impact on generation investment incentives and that the rules governing the requirement to be a physical resource should be more clearly stated and enforced.<sup>100</sup> If DR displaces new generation resources in BRAs, but then buys out of the position prior to the delivery year, this means potentially replacing new entry generation resources at the high end of the supply curve with other existing but uncleared capacity resources available in Incremental Auctions at reduced offer prices. This suppresses the price of capacity in the BRA compared to the competitive result because it permits the shifting of demand from the BRA to the Incremental Auctions, which is inconsistent with the must offer, must buy rules, and the requirement to be an actual, physical resource, governing the BRA. PJM's sell back of capacity in Incremental Auctions exacerbates the incentive for DR to buy out of its BRA positions in IAs.

Effective with the 2020/2021 Delivery Year, DR includes annual and summer products. Annual Demand Resources are required to be available on any day during the delivery year for an unlimited number of interruptions between the hours of 10:00 a.m. and 10:00 p.m. EPT for

the months of June through October and the following May and between the hours of 6:00 a.m. and 9:00 p.m. EPT for the months of November through April unless there is a PJM approved maintenance outage during the October through April period.

Summer-Period Demand Resources are required to be available on any day from June through October and the following May of the delivery year for an unlimited number of interruptions between the hours of 10:00 a.m. to 10:00 p.m. EPT.

As shown in Table 5-11, and Table 5-12, committed DR was 7,699.9 MW for June 1, 2024, as a result of cleared capacity for demand resources in RPM auctions for the 2024/2025 Delivery Year (8,064.7 MW) less replacement capacity (364.8 MW).

<sup>100</sup> See "Analysis of Replacement Capacity for RPM Commitments: June 1, 2007 to June 1, 2019," <[http://www.monitoringanalytics.com/reports/Reports/2019/IMM\\_Analysis\\_of\\_Replacement\\_Capacity\\_for\\_RPM\\_Commitments\\_June\\_1\\_2007\\_to\\_June\\_1\\_2019\\_20190913.pdf](http://www.monitoringanalytics.com/reports/Reports/2019/IMM_Analysis_of_Replacement_Capacity_for_RPM_Commitments_June_1_2007_to_June_1_2019_20190913.pdf)> (September 13, 2019).

Table 5-11 RPM load management statistics by LDA: June 1, 2021 to June 1, 2025<sup>101 102 103 104</sup>

		UCAP (MW)													
		DPL				PSEG				ATSI					
		RTO	MAAC	EMAAC	SWMAAC	South	PSEG	North	Pepco	ATSI	Cleveland	ComEd	BGE	PPL	DAY
															DEOK
															Dominion
01-Jun-21	DR cleared	11,427.7	3,454.1	1,381.5	624.9	66.3	410.5	188.6	345.9	1,196.8	272.8	2,073.7	279.0	697.7	227.7
	EE cleared	4,806.2	1,810.5	979.1	501.1	42.0	353.1	136.0	275.9	420.5	95.7	982.7	225.2	186.7	111.0
	DR net replacements	(4,111.0)	(1,302.8)	(568.4)	(160.8)	(28.1)	(195.8)	(100.2)	(106.5)	(483.2)	(137.4)	(609.5)	(54.3)	(235.1)	(50.9)
	EE net replacements	(7.0)	0.0	0.0	(1.1)	0.1	0.0	34.9	(2.6)	80.0	7.0	10.6	1.5	(1.7)	8.0
	RPM load management	12,115.9	3,961.8	1,792.2	964.1	80.3	567.8	259.3	512.7	1,214.1	238.1	2,457.5	451.4	647.6	295.8
01-Jun-22	DR cleared	8,866.2	2,821.3	1,139.9	489.2	48.4	294.6	93.8	325.3	949.4	191.8	1,521.9	163.9	661.7	210.5
	EE cleared	5,734.8	2,303.6	1,265.3	499.4	53.5	431.0	201.6	287.5	485.0	55.9	792.6	211.9	312.4	129.4
	DR net replacements	(570.0)	(395.4)	(138.0)	(12.6)	1.7	(49.4)	(12.6)	(21.5)	(99.6)	(28.2)	127.5	8.9	(165.2)	(24.1)
	EE net replacements	(4.0)	11.8	7.0	14.9	0.0	(2.1)	15.4	8.7	(22.2)	(0.5)	0.0	6.2	(9.8)	(13.0)
	RPM load management	14,027.0	4,741.3	2,274.2	990.9	103.6	674.1	298.2	600.0	1,312.6	219.0	2,442.0	390.9	799.1	302.8
01-Jun-23	DR cleared	8,174.1	2,411.4	975.9	343.6	52.2	272.7	126.1	175.2	916.2	189.4	1,253.2	168.4	583.4	209.3
	EE cleared	5,896.4	2,438.6	1,341.4	569.5	59.3	443.4	210.4	298.6	451.8	46.3	961.2	270.9	306.1	102.4
	DR net replacements	(466.2)	(229.5)	(3.8)	(4.9)	22.8	3.4	2.6	(25.0)	47.2	(63.4)	160.7	20.1	(123.3)	(24.0)
	EE net replacements	(5.3)	(2.2)	(1.0)	7.6	9.0	11.6	13.7	7.6	(15.3)	(0.5)	(20.9)	0.0	(6.2)	(7.9)
	RPM load management	13,599.0	4,618.3	2,312.5	915.8	143.3	731.1	352.8	456.4	1,399.9	171.8	2,354.2	459.4	760.0	279.8
01-Jun-24	DR cleared	8,064.7	2,497.6	1,004.0	358.5	46.0	285.7	98.2	160.4	682.6	141.6	1,554.0	198.1	603.4	192.9
	EE cleared	7,716.0	3,543.5	2,064.9	787.4	99.9	802.9	392.0	398.9	587.6	54.9	1,063.4	388.5	391.4	128.3
	DR net replacements	(364.8)	(197.4)	9.1	43.0	35.2	(7.3)	(14.9)	19.3	50.9	(58.3)	(56.0)	23.7	(138.9)	(6.2)
	EE net replacements	(48.0)	(43.6)	(15.4)	21.3	14.1	(6.5)	(0.1)	9.1	(30.6)	0.0	1.2	12.2	(38.4)	(5.6)
	RPM load management	15,367.9	5,800.1	3,062.6	1,210.2	195.2	1,074.8	475.2	587.7	1,290.5	138.2	2,562.6	622.5	817.5	309.4
01-Jun-25	DR cleared	6,064.7	1,844.9	782.7	295.5	65.0	228.9	65.8	132.5	546.1	67.3	1,086.9	163.0	422.5	140.1
	EE cleared	1,459.8	647.1	410.1	151.8	24.0	167.2	88.4	80.0	68.5	6.6	337.6	71.8	45.7	18.5
	DR net replacements	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	EE net replacements	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	RPM load management	7,524.5	2,492.0	1,192.8	447.3	89.0	396.1	154.2	212.5	614.6	73.9	1,424.5	234.8	468.2	158.6

Table 5-12 RPM commitments, replacements, and registrations for demand resources: June 1, 2007 to June 1, 2025<sup>105 106 107</sup>

		UCAP (MW)				Registered DR			
		RPM	Adjustments	Net	RPM	RPM Commitments	UCAP	Factor	UCAP (MW)
		Cleared	to Cleared	Replacements	Commitments	Shortage	Conversion		
01-Jun-07		127.6	0.0	0.0	127.6	0.0	127.6	0.0	1.033
01-Jun-08		559.4	0.0	(40.0)	519.4	(58.4)	461.0	488.0	1.034
01-Jun-09		892.9	0.0	(474.7)	418.2	(14.3)	403.9	570.3	1.033
01-Jun-10		962.9	0.0	(516.3)	446.6	(7.7)	438.9	572.8	1.035
01-Jun-11		1,826.6	0.0	(1,052.4)	774.2	0.0	774.2	1,117.9	1.035
01-Jun-12		8,752.6	(11.7)	(2,253.6)	6,487.3	(34.9)	6,452.4	7,443.7	1.037
01-Jun-13		10,779.6	0.0	(3,314.4)	7,465.2	(30.5)	7,434.7	8,240.1	1.042
01-Jun-14		14,943.0	0.0	(6,731.8)	8,211.2	(219.4)	7,991.8	8,923.4	1.042
01-Jun-15		15,774.8	(321.1)	(4,829.7)	10,624.0	(61.8)	10,562.2	10,946.0	1.038
01-Jun-16		13,284.7	(19.4)	(4,800.7)	8,464.6	(455.4)	8,009.2	8,961.2	1.042
01-Jun-17		11,870.7	0.0	(3,870.8)	7,999.9	(30.3)	7,969.6	8,681.4	1.039
01-Jun-18		11,435.4	0.0	(3,182.4)	8,253.0	(1.0)	8,252.0	8,512.0	1.091
01-Jun-19		10,703.1	0.0	(2,138.8)	8,564.3	(0.4)	8,563.9	9,229.9	1.090
01-Jun-20		9,445.7	0.0	(2,399.5)	7,046.2	(0.1)	7,046.1	7,867.6	1.088
01-Jun-21		11,427.7	0.0	(4,111.0)	7,316.7	0.0	7,316.7	7,754.2	1.087
01-Jun-22		8,866.2	0.0	(570.0)	8,296.2	(52.1)	8,244.1	8,518.5	1.091
01-Jun-23		8,174.1	0.0	(466.2)	7,707.9	(161.5)	7,546.4	7,383.0	1.093
01-Jun-24		8,064.7	0.0	(364.8)	7,699.9	(507.4)	7,192.5	6,758.7	1.117
01-Jun-25		6,064.7	0.0	0.0	6,064.7	0.0	6,064.7	0.0	0.760

<sup>101</sup> See OATT Attachment DD § 8.4. The reported DR cleared MW may reflect reductions in the level of committed MW due to relief from Capacity Resource Deficiency Charges.

<sup>102</sup> Pursuant to OA § 15.1.6(c), PJM Settlement shall attempt to close out and liquidate forward capacity commitments for PJM Members that are declared in collateral default. The reported replacement transactions may include transactions associated with PJM members that were declared in collateral default.

<sup>103</sup> EE resources are fully reflected in PJM load forecasts starting with the 2016 load forecast for the 2019/2020 delivery year, and EE resources are not defined to be capacity resources in any way as a result. EE resources do not clear in the capacity auctions.

<sup>104</sup> See OATT Attachment DD § 5.14E. The reported DR cleared MW for the 2016/2017, 2017/2018, and 2018/2019 Delivery Years reflect reductions in the level of committed MW due to the Demand Response Legacy Direct Load Control Transition Provision.

<sup>105</sup> See OATT Attachment DD § 8.4. The reported DR adjustments to cleared MW include reductions in the level of committed MW due to relief from Capacity Resource Deficiency Charges.

<sup>106</sup> See OATT Attachment DD § 5.14C. The reported DR adjustments to cleared MW for the 2015/2016 and 2016/2017 Delivery Years include reductions in the level of committed MW due to the Demand Response Operational Resource Flexibility Transition Provision.

<sup>107</sup> See OATT Attachment DD § 5.14E. The reported DR adjustments to cleared MW for the 2016/2017, 2017/2018, and 2018/2019 Delivery Years include reductions in the level of committed MW due to the Demand Response Legacy Direct Load Control Transition Provision.

## Capacity Value of Intermittent Resources

Given that states have increasingly aggressive renewable energy targets, a core goal of a competitive market design should be to ensure that the resources required to provide reliability receive appropriate competitive market incentives for entry and for ongoing investment and for exit when uneconomic. A significant level of renewable resources, operating with zero or near zero marginal costs, will result in very low energy prices at times of high intermittent output. Since renewable resources are intermittent, the contribution of renewables to meeting reliability targets must be analyzed carefully to ensure that the capacity value of renewables is calculated correctly.

The contribution of intermittent and storage resources to reliability has been addressed in the PJM capacity market using derating factors in order to help ensure that MW of capacity are comparable, regardless of the source. Derating factors based on average generation during summer peak hours were used prior to the 2023/2024 Delivery Year to determine capacity values for wind and solar generators.<sup>108</sup> On July 30, 2021, FERC approved new rules in PJM for determining the capacity value of intermittent generators based on the effective load carrying capability (ELCC) method.<sup>109</sup> The MMU opposed PJM's ELCC rules because they relied on significant counterfactual behavioral assumptions for storage and demand response resources, did not apply to all resource types, used invented (putative) data, used average technology values, were not locational, and provided for a long term guarantee of high average ELCC values for existing resources, among other issues.<sup>110</sup> PJM's ELCC approach is an ex ante, administrative determination by PJM based on a black box model, of the capacity value of resources. The ELCC values are on a class average technology class basis with no recognition of locational differences and no opportunity to recognize actual performance in the delivery year. PJM does not check the actual cleared capacity in capacity market auctions to verify if the cleared capacity is expected to provide the target reliability. Capacity values determined by the PJM average ELCC approach are being used for the 2023/2024 and 2024/2025 Delivery Years. On January 30, 2024, FERC accepted PJM's modified marginal ELCC approach and it was used to determine capacity

values for the 2025/2026 Base Residual Auction held in July 2024.<sup>111</sup> PJM's modified marginal ELCC approach was used to determine the capacity values for thermal resources and demand resources in addition to the intermittent resources.

The ELCC approach is not an appropriate way to define the MW capacity value for intermittent and storage resources, or for thermal resources, in a market. ELCC was developed as, and remains, a utility planning tool rather than a market design tool. ELCC was attractive as a possible analytical basis for the derating of intermittent and storage resources to a MW level consistent with their actual availability and consistent with a perfect resource, or at least a thermal resource. The impetus made sense but the actual application of the ELCC planning tool cannot work in markets that include intermittent or thermal resources. The underlying logic makes sense but PJM's implementation does not. Neither intermittent nor thermal resources are the perfect resource. There are thermal resources, currently credited with full capacity value, that are much less available than some intermittent resources that are derated.

PJM's approach to ELCC is based on correct insights about the need to calculate the availability of different resource types but the actual implementation results in a set of illogical implications. For example, PJM assigned penalties to solar resources during winter storm Elliott in December 2022 when solar resources did not generate power after dark.

Under the PJM ELCC approach a solar resource is assigned a derating factor, the derated MW are equivalent to a perfect resource accredited at that MW level. PJM assigned penalties to solar resources during Elliott when they did not generate power after dark. This is clearly not correct and illustrates one of the flaws in the ELCC logic. The solar resource is available for sunny hours and not for unsunny hours. A solar resource is not expected to generate at night and should not face penalties for failing to do what it obviously cannot. ELCC does not convert intermittent resources, or any resource, into a perfect resource, or even the equivalent of a perfect resource. This illogical implication of PJM's ELCC means that there is a significant flaw in the ELCC approach. The penalties were assessed because the ELCC method determined that 1 MW of solar nameplate capacity was equivalent to 0.54 MW of perfect capacity,

<sup>108</sup> *Class Average Capacity Factors – Wind and Solar Resources*, PJM Interconnection LLC. (June 1, 2017).

<sup>109</sup> See 176 FERC ¶ 61,056 (2021). There are multiple ways to apply the ELCC method. There is not a single ELCC method.

<sup>110</sup> 182 FERC ¶ 61,109 (2023).

<sup>111</sup> 186 FERC ¶ 61,080 (2024).



meaning capacity that is always available at the derated level, even in the middle of the night.<sup>112</sup> As a result of all these issues, the MMU has concluded that ELCC is not a viable method for determining the reliability contributions of intermittent and storage resources, or for thermal resources. The MMU has proposed a replacement for the PJM ELCC approach that is based on the actual hourly availability of all individual generators.<sup>113</sup>

PJM's current approach to ELCC is a marginal approach in which the ELCC class rating should represent the carrying capability of an additional MW of ICAP for the resource class. In addition to intermittent and storage resources, the approach is used to determine the capacity values for thermal resources and demand resources. Most of the issues with the prior average ELCC approach also apply to the new marginal approach. The new marginal approach relies on significant counterfactual behavioral assumptions for storage and demand resources, uses invented (putative) data, is not unit specific, is not hourly, is not locational, and is an ex ante approach that must assume a capacity resource fleet for determining the ELCC marginal class ratings.

The ELCC ratings produced by the marginal approach in general, and by PJM's specific marginal approach specifically, are inherently volatile. PJM has calculated the marginal ELCC class ratings for the 2025/2026 delivery year on five separate occasions. Table 5-13 shows the results of each calculation. Each calculation is dependent upon the load forecast model, the combination of actual historical performance and changes in experienced weather, and the assumed forward looking resource mix. The PJM 2024 load forecast model was used to produce the February 2024, March 2024 and January 2025 ELCC ratings. The ELCC ratings posted on December 31, 2024, used an interim 2025 load forecast model. In early January, PJM removed the posted ELCC ratings from December 31, 2024, and posted recalculated ratings using the 2024 load forecast model. The modified ELCC ratings were posted on January 23, 2025. The January 23, 2025, ratings are the final ELCC ratings for 2025/2026 Delivery Year.<sup>114</sup> The ELCC rating changes have significant impacts on the amount of cleared capacity. Table 5-14 shows the difference between capacity that cleared the 2025/2026 Base Residual Auction and the updated capacity MW value based on the final ELCC ratings for 2025/2026 posted on January 23, 2025. In total, the capacity values decreased by 928.5 MW (UCAP) or 0.7 percent. Capacity market sellers are obligated to obtain additional capacity prior to the delivery year if they are short as a result of a reduction in ELCC rating between the BRA and the final ELCC rating from PJM's ELCC rating changes. Had PJM used the ELCC ratings posted on December 31, 2024, the capacity values would have decreased by 3,793.3 or 2.8 percent.

**Table 5-13 Marginal ELCC ratings for the 2025/2026 Delivery Year**

ELCC Class	2025/2026 Delivery Year				
	December 2023	February 2024	Ratings for Base Residual Auction		Ratings for Third Incremental Auction
			March 2024	Dec 31, 2024	Jan 23, 2025
Onshore Wind	21%	35%	35%	42%	38%
Offshore Wind	39%	60%	60%	71%	62%
Solar Fixed	15%	9%	9%	8%	10%
Solar Tracking	25%	14%	14%	11%	14%
Landfill Intermittent	56%	55%	54%	51%	51%
Hydro Intermittent	41%	36%	37%	37%	37%
4-hr Storage	76%	59%	59%	44%	55%
6-hr Storage	85%	67%	67%	53%	65%
8-hr Storage	89%	69%	68%	58%	68%
10-hr Storage	92%	78%	78%	67%	77%
Demand Response	95%	77%	76%	68%	77%
Nuclear	96%	96%	95%	95%	95%
Coal	86%	85%	84%	83%	83%
Gas Combined Cycle	87%	80%	79%	77%	78%
Gas Combustion Turbine	74%	62%	62%	59%	63%
Gas Combustion Turbine Dual Fuel	90%	78%	79%	78%	79%
Diesel Utility	91%	90%	92%	92%	92%
Steam	78%	70%	75%	73%	74%

<sup>112</sup> "ELCC Class Ratings for 2024-2025 BRA," PJM Interconnection LLC. (December 28, 2021) <<https://www.pjm.com/planning/resource-adequacy-planning/effective-load-carrying-capability>>.

<sup>113</sup> For additional details on the MMU proposal see "Executive Summary of the IMM Capacity Market Design Proposal: Sustainable Capacity Market (SCM)", Independent Market Monitor for PJM (August 16, 2023) <[http://www.monitoringanalytics.com/reports/Presentations/2023/IMM\\_RASTF-CIFP\\_SCM\\_Executive\\_Summary\\_20230816.pdf](http://www.monitoringanalytics.com/reports/Presentations/2023/IMM_RASTF-CIFP_SCM_Executive_Summary_20230816.pdf)>.

<sup>114</sup> See Item 5 in Markets and Reliability Committee Meeting Materials, *Installed Reserve Margin (IRM), Forecast Pool Requirement (FPR), and Effective Load Carrying Capability (ELCC) for 2025/2026 3IA at 2*, PJM Interconnection LLC. (January 23, 2025) <<https://www.pjm.com/committees-and-groups/committees/mrc>>.

**Table 5-14 Impact of ratings changes on cleared capacity<sup>115</sup>**

	MW (UCAP)	Reduction in capacity value compared to Base Residual Auction	Percent change in capacity value compared to Base Residual Auction
2025/2026 Base Residual Auction Cleared Capacity	135,684.0		
Updated Cleared Capacity based on Jan 23, 2025 ELCC Ratings	134,755.5	(928.5)	(0.7%)
Updated Cleared Capacity based on Dec 31, 2024 ELCC Ratings	131,890.7	(3,793.3)	(2.8%)

The December 31, 2024, ELCC ratings are based on an interim PJM 2025 load forecast model. PJM never explained why the December 31, 2024, ratings are not a better indicator of the expected capacity values than the values based on the PJM 2024 load forecast model and posted by PJM on January 23, 2025. If the more current forecast is a better indicator of expected capacity values, the capacity cleared for the 2025/2026 BRA actually has a capacity value of 131,890.7 MW (UCAP), or 2,864.8 MW (UCAP) less than the capacity value obtained using the ratings based on the outdated PJM 2024 load forecast and posted by PJM on January 23, 2025.

The ELCC volatility also affects the reliability requirement calculation. Table 5-15 shows the reliability requirement calculation for the 2025/2026 RPM Base Residual Auction and the recently posted update for the Third Incremental Auction for 2025/2026.<sup>116</sup> The pool wide accredited UCAP factor for the Third IA is based on the January 23, 2025, ELCC ratings which use the PJM 2024 load forecast model. These updated ELCC ratings reduced the pool wide accredited UCAP factor from 0.7969 to 0.7963. The reliability requirement and the FRR obligation both increase, resulting in an increase of 395.7 MW (UCAP) to the reliability requirement adjusted for FRR. PJM needs to procure an additional 395.7 MW (UCAP) of capacity in the Third Incremental Auction. PJM procures the capacity by submitting buy bids in the Third Incremental Auction.<sup>117</sup>

**Table 5-15 PJM Reliability Requirement**

	2025/2026 Base Residual Auction	2025/2026 Third Incremental Auction	Change
ICAP	191,693.0	188,920.0	
Solved Load	160,624.0	158,357.0	(2,267.0)
Installed Reserve Margin	17.800%	17.800%	0.0%
Accredited UCAP	152,765.0	150,438.0	(2,327.0)
Pool Wide Accredited UCAP Factor	0.797	0.796	(0.001)
Forecast Pool Requirement	0.939	0.938	(0.001)
Preliminary Forecast Peak Load	153,883.0	154,534.1	651.0
Reliability Requirement	144,450.0	144,953.0	503.0
Fixed Resource Requirement (FRR)	10,886.4	10,993.7	107.3
Reliability Requirement Adjusted for FRR	133,563.6	133,959.3	395.7

The calculated impact of the PJM 2025 load forecast model on the reliability requirement was not provided by PJM.

The capacity derating factors applied to intermittent nameplate capacity for the 2022/2023 Delivery Year and the ELCC calculations used for the 2023/2024 and the 2024/2025 Delivery Years were based on the assumption that intermittent resources provide reliable output in excess of their CIRs. However, that output is not deliverable when needed for reliability because it is in excess of the defined deliverability rights (CIRs) and therefore should not be included in the definition of intermittent capacity. The preferable solution is to require intermittent resources to purchase CIRs equal to the maximum energy output assumed in the ELCC derating calculation. That is the solution reached in the PJM stakeholder process.<sup>118</sup> The corresponding performance obligation of an intermittent resource is to produce at its corresponding maximum energy output level when it is possible, based on wind and solar conditions. After a lengthy stakeholder process, on April 7, 2023, FERC approved updates to PJM's ELCC method that cap the level of an intermittent generator's output used to calculate the generator's reliability contribution (ELCC derated MW) at the generator's CIR level.<sup>119</sup>

<sup>115</sup> PJM stated that the 2024 load forecast model was used because it is the "most recently finalized PJM load forecast." The January 23, 2025, ELCC Ratings are based on the PJM 2024 load forecast model. The December 31, 2024, ELCC Ratings are based on an interim PJM 2025 load forecast model.

<sup>116</sup> 2025/2026 RPM 3rd Incremental Auction Planning Parameters, PJM Interconnection LLC. (January 31, 2025) <<https://www.pjm.com/markets-and-operations/rpm>>.

<sup>117</sup> Id.

<sup>118</sup> ELCC/CIR discussions were held throughout 2022 during the PC Special Session – CIRs for ELCC Resources as well as the MC and the MRC <<https://www.pjm.com/committees-and-groups/issue-tracking/issue-tracking-details.aspx?Issue=83aadda8-b6c1-4630-9483-025b6b93fc28>>.

<sup>119</sup> 183 FERC ¶61,009.

The definition of intermittent capacity is thus not consistent with the way that capacity is defined. This results in an overstatement of the supply of capacity and reduces the clearing price in the capacity market. The MMU recommends that intermittent resources, including storage, not be permitted to offer capacity MW based on energy delivery that exceeds their defined deliverability rights (CIRs). Only energy output for such resources below the designated CIR/deliverability level should be recognized in the definition of capacity. There is the related issue of ensuring that intermittent resources, like all other resources, are required to pay their own interconnection costs in order to meet their attributed capacity value, consistent with the longstanding PJM market design, or reduce their capacity value.

Generation owners of intermittent resources and environmentally limited resources can request winter capacity interconnection rights (CIRs).<sup>120</sup> If the intermittent resource or environmentally limited resource is deemed deliverable by PJM based on the additional CIRs, the generation owner is granted the additional CIRs for the winter period of the relevant delivery year. Winter seasonal products have the ability to inject more MW in the winter because the lower peak loads in the winter allow higher injections from certain resources without needing any additional network upgrades. But this system capacity in the winter is already paid for by resources that applied for needed network upgrades to inject in the summer to meet the annual peak loads that are expected to occur in the summer.

PJM's practice of giving away winter CIRs, that appear to be available because other resources paid for the supporting network upgrades, requires annual capacity resources to subsidize the interconnection costs of intermittent resources and artificially increases the capacity value of the winter resources. Those CIRs are not available to be sold to or provided to intermittent resources because they have been paid for by annual resources. The MMU recommends that PJM require all market participants to meet their deliverability requirements under the same rules.

<sup>120</sup> OATT Part VII, Subpart E § 332.

## Market Conduct

### Offer Caps

Market power mitigation measures were applied to capacity resources such that the sell offer was set equal to the defined offer cap when the capacity market seller failed the market structure test for the auction, the submitted sell offer exceeded the defined offer cap, and the submitted sell offer, absent mitigation, would have increased the market clearing price.<sup>121 122 123</sup> For Capacity Performance Resources, for RPM auctions prior to September 2, 2021, offer caps were defined in the PJM Tariff as the applicable zonal Net Cost of New Entry (CONE) times (B) where B is the average of the Balancing Ratios (B) during the Performance Assessment Hours in the three consecutive calendar years that precede the base residual auction for such delivery year, unless net avoidable costs exceed this level, or opportunity costs based on the potential sale of capacity in an external market exceed this level. The Commission issued an order eliminating the prior offer cap and establishing a competitive market seller offer cap set at Net ACR, effective September 2, 2021.<sup>124</sup> The Commission rejected a more recent attempt to undermine the Market Seller Offer Cap rules by order issued February 6, 2024.<sup>125</sup>

For RPM Third Incremental Auctions prior to September 2, 2021, capacity market sellers may elect an offer cap equal to the greater of the Net CONE for the relevant LDA and delivery year or 1.1 times the BRA clearing price for the relevant LDA and delivery year. For RPM Third Incremental Auctions after September 2, 2021, capacity market sellers may elect an offer cap of 1.1 times the BRA clearing price for the relevant LDA and delivery year.

Avoidable costs are costs that are neither short run marginal costs, like fuel or consumables, nor fixed costs like depreciation and rate of return. Avoidable costs are the costs that a generation owner incurs as a result of operating a generating unit for one year, in particular the delivery year.<sup>126</sup> As a result, the tariff

<sup>121</sup> See OATT Attachment DD § 6.5.

<sup>122</sup> Prior to November 1, 2009, existing DR and EE resources were subject to market power mitigation in RPM Auctions. See 129 FERC ¶ 61,081 at P 30 (2009).

<sup>123</sup> Effective January 31, 2011, the RPM rules related to market power mitigation were changed, including revising the definition for Planned Generation Capacity Resource and creating a new definition for Existing Generation Capacity Resource for purposes of the must offer requirement and market power mitigation, and treating a proposed increase in the capability of a Generation Capacity Resource the same in terms of mitigation as a Planned Generation Capacity Resource. See 134 FERC ¶ 61,065 (2011).

<sup>124</sup> 176 FERC ¶ 61,137 (2021), *order denying reh'g*, 178 FERC ¶ 61,121 (2022), *appeal denied*, EPSA, et al. v. FERC, Case No. 21-1214, et al. (DC Cir. October 10, 2023), *cert. denied*.

<sup>125</sup> 186 FERC ¶ 61,097, *reh'g denied*, 187 FERC ¶ 62,016 (2024).

<sup>126</sup> OATT Attachment DD § 6.8(b).

defines avoidable costs as the costs that a generation owner would not incur if the generating unit did not offer for one year. Although the term mothball is used in the tariff to modify the term ACR, the term mothball is not defined in the tariff. Mothball is an informal term better understood as a metaphor for the cost to operate for one year. Avoidable costs are the costs to operate the unit for one year, regardless of whether the unit plans to retire. Although the tariff includes different mothball and retirement values, the distinction is based on a misunderstanding of the meaning of avoidable costs and should be eliminated. PJM never explained exactly how it calculated mothball and retirement avoidable cost levels. The MMU recommends that major maintenance costs be included in the definition of avoidable costs and removed from energy offers because such costs are avoidable costs and not short run marginal costs.<sup>127</sup> The tariff states that avoidable costs may also include annual capital recovery associated with investments required to maintain a unit as a Generation Capacity Resource, termed Avoidable Project Investment Recovery (APIR), despite the fact that these are not actually avoidable costs, particularly after the first year.

Avoidable cost based offer caps are defined to be net of revenues from all other PJM markets and unit-specific bilateral contracts, including RECs, and expected bonus performance payments/nonperformance charges.<sup>128</sup> Capacity resource owners could provide ACR data by providing their own unit-specific data or, for auctions for delivery years prior to 2020/2021 and auctions held after September 2, 2021, by selecting the default ACR values. The specific components of avoidable costs are defined in the PJM tariff.<sup>129</sup>

Effective for the 2018/2019 and subsequent delivery years, the ACR definition includes two additional components, Avoidable Fuel Availability Expenses (AFAE) and Capacity Performance Quantifiable Risk (CPQR).<sup>130</sup> AFAE is available for Capacity Performance Resources. AFAE is defined to include expenses related to fuel availability and delivery. CPQR is available for Capacity Performance Resources and, for the 2018/2019 and 2019/2020 Delivery Years, Base Capacity Resources. CPQR is defined to be the quantifiable and reasonably

supported cost of mitigating the risks of nonperformance associated with submission of an offer.

The opportunity cost option allows capacity market sellers to offer based on a documented price available in a market external to PJM, subject to export limits. If the relevant RPM market clears above the opportunity cost, the generation capacity resource is sold in the RPM market. If the opportunity cost is greater than the clearing price and the generation capacity resource does not clear in the RPM market, it is available to sell in the external market.

### Competitive Offers

The competitive offer of a capacity resource is based, regardless of tariff requirements, on a market seller's expectations of a number of variables, some of which are resource specific: the resource's net going forward costs (net ACR), the resource's gross ACR, and the resource's forward looking net revenues. The gross ACR includes the cost to mitigate the resource's risk of incurring performance assessment penalties.

The competitive offer is based on a forward looking energy and ancillary services (E&AS) net revenue offset rather than the backward looking E&AS net revenue offset currently in the tariff. Forward prices for energy prices and fuel prices are a better guide to market expectations than historical energy and fuel prices. This is particularly important in years, like 2022, when there is a significant change from the historical level of energy market prices. The forward curves reflect this change, but the historical prices do not. However the PJM method for calculating forward looking net revenues is significantly flawed and overestimates net revenues.

PJM had a forward looking net revenue calculation in the tariff that applied to RPM Auctions for the 2022/2023 Delivery Year.<sup>131</sup> FERC subsequently reversed its approval of that method as part of rejecting PJM's ORDC filing.<sup>132</sup> PJM's method for calculating forward looking E&AS net revenues was flawed for several reasons. PJM's method included an adjustment based on the prices of long term FTRs for the planning period closest in time to the delivery year which requires an

<sup>127</sup> PJM Interconnection LLC, Docket Nos. ER19-210-000 and EL19-8-000, Responses to Deficiency Letter re: Major Maintenance and Operating Costs Recovery (February 14, 2019).

<sup>128</sup> For details on the competitive offer of a capacity performance resource, see "Analysis of the 2023/2024 RPM Base Residual Auction," <[https://www.monitoringanalytics.com/reports/Reports/2022/IMM\\_Analysis\\_of\\_the\\_20232024\\_RPM\\_Base\\_Residual\\_Auction\\_20221028.pdf](https://www.monitoringanalytics.com/reports/Reports/2022/IMM_Analysis_of_the_20232024_RPM_Base_Residual_Auction_20221028.pdf)> (October 28, 2022).

<sup>129</sup> OATT Attachment DD § 6.8(a).

<sup>130</sup> 151 FERC ¶ 61,208 (2015).

<sup>131</sup> 171 FERC ¶ 61,153 (May 21, 2020) and 173 FERC ¶ 61,134 (November 12, 2020).

<sup>132</sup> Forward energy and ancillary services (E&AS) revenue offsets were applicable from November 12, 2020, as approved in the FERC Order on compliance in Docket Nos. EL19-58-002 and EL19-58-003 until December 22, 2021, when the Commission issued an Order on Voluntary Remand in Docket Nos. EL19-58-006 and ER19-1486-003 reversing its prior determination that PJM should use a forward looking energy E&AS revenue offset and directing PJM to submit a compliance filing restoring the tariff provisions defining the historical E&AS revenue offset.



adjustment for monthly average day-ahead congestion price differentials and an adjustment for loss component differentials of historical LMPs. Use of the adjustment based on the prices of long term FTRs adds unnecessary complexity, fails to make the result more accurate, makes the results less transparent, and in some cases make the results less accurate. PJM's use of long term FTRs in the forward energy market price calculation does not use the FTR auction for the desired delivery year as a result of the timing of capacity auctions and FTR auctions when PJM is on its defined three year capacity market auction schedule. It would be simpler, more accurate and more transparent to use forward LMPs calculated using real-time monthly on and off peak forward prices for the delivery year at the PJM Western Hub, adjusted to the zone and hour using the historical zonal, nodal and hourly real-time price differentials for each of the last three years. The MMU and PJM have been implementing this method for years in the calculation of the opportunity costs associated with environmental limits on the operation of generating units.<sup>133</sup>

More fundamentally, PJM's forward looking net revenue calculation tends to overestimate forward net revenues. The PJM method is based on a theoretical, unit by unit perfect dispatch based on unit parameters and forward fuel costs and LMPs. The PJM method fails to account for the realities of committing and dispatching units. Nonetheless, it remains correct that generation owners look forward and not backwards when calculating net revenues. The goal is an approach that retains the reality of historical commitment and dispatch while recognizing that future conditions will be different. A better approach would calculate unit forward looking expected energy and ancillary services net revenues using historical revenues that are scaled based on a comparison of forward prices for energy and fuel to the historical prices for energy and fuel.

The competitive offer of a capacity resource is based on a market seller's expectations of market variables during the delivery year, the impact of these variables on the resource's risk, and the cost to mitigate that risk. These market variables are: the number of performance assessment intervals (PAI) in a delivery year where the resource is located; the level of performance required to meet its capacity obligation during those performance assessment intervals, measured as the average Balancing

Ratio (B); and the level of the bonus performance payment rate (CPBR) compared to the nonperformance charge rate (PPR). The total capacity revenues earned by a resource are the sum of revenues earned in the forward capacity auctions and additional bonus revenues earned (or penalties paid) during the delivery year, which are a function of unit performance during PAI (A). The level of the bonus performance payment rate depends on the level of underperforming MW net of the underperforming MW excused by PJM during performance assessment intervals for reasons defined in the PJM OATT.<sup>134</sup>

The September 2, 2021, Commission order addressed the definition of the market seller offer cap by eliminating the Net CONE times B offer cap and establishing a competitive market seller offer cap of net ACR.<sup>135</sup> The Commission rejected a more recent attempt by PJM to undermine the Market Seller Offer Cap rules by order issued February 6, 2024.<sup>136</sup>

### 2024/2025 RPM Third Incremental Auction

As shown in Table 5-16, 320 generation resources submitted Capacity Performance offers in the 2024/2025 RPM Third Incremental Auction. Unit specific offer caps were calculated for seven generation resources (2.2 percent). Of the 320 generation resources, 223 generation resources elected the offer cap option of 1.1 times the BRA clearing price (69.7 percent), 62 generation resources had default ACR based offer caps (19.4 percent), five generation resources had unit specific ACR based offer caps (1.5 percent), two generation resource had a unit specific opportunity cost based offer cap (0.6 percent), two Planned Generation Capacity Resources had uncapped offers (0.6 percent), and the remaining 26 generation resources were price takers (8.1 percent). Market power mitigation was applied to seven Capacity Performance sell offers. Based on the FERC Order in Docket No. ER23-729-002, PJM reran the 2024/2025 Third Incremental Auction with final results posted on May 23, 2024.<sup>137</sup>

### 2025/2026 RPM Base Residual Auction

As shown in Table 5-16, 1,119 generation resources submitted Capacity Performance offers in the 2025/2026 RPM Base Residual Auction. Unit specific offer caps

<sup>133</sup> See "PJM Manual 15: Cost Development Guidelines," § 12.7 IMM Opportunity Cost Calculator, Rev. 45 (Sep. 1, 2024).

<sup>134</sup> OATT Attachment DD § 10A (d).

<sup>135</sup> 176 FERC ¶ 61,137 (2021), *order denying reh'g*, 178 FERC ¶ 61,121 (2022), *appeal denied*, EPSA, et al. v. FERC, Case No. 21-1214, et al. (DC Cir. October 10, 2023).

<sup>136</sup> 186 FERC ¶ 61,097, *reh'g denied*, 187 FERC ¶ 62,016 (2024).

<sup>137</sup> 187 FERC ¶ 61,065 (2024).



were calculated for 61 generation resources (5.5 percent). Of the 1,119 generation resources, 729 generation resources had default ACR based offer caps (65.1 percent), 46 generation resources had unit specific ACR based offer caps (4.1 percent), 15 generation resource had a unit specific opportunity cost-based offer cap (1.3 percent), 25 Planned Generation Capacity Resources had uncapped offers (2.2 percent), one generation resource had an uncapped planned uprate and default ACR based offer cap for the existing portion (0.1 percent), and the remaining 303 generation resources were price takers (27.1 percent). Market power mitigation was applied to sell offers of 16 generation resources.

**Table 5-16 ACR statistics: RPM auctions held in 2024**

Offer Cap/Mitigation Type	2024/2025 Third Incremental Auction		2025/2026 Base Residual Auction	
	Number of Generation Resources	Percent of Generation Resources Offered	Number of Generation Resources	Percent of Generation Resources Offered
Default ACR	62	19.4%	729	65.1%
Unit specific ACR (APIR)	3	0.9%	1	0.1%
Unit specific ACR (APIR and CPQR)	0	0.0%	11	1.0%
Unit specific ACR (non-APIR)	2	0.6%	5	0.4%
Unit specific ACR (non-APIR and CPQR)	0	0.0%	29	2.6%
Opportunity cost input	2	0.6%	15	1.3%
Default ACR and opportunity cost	0	0.0%	0	0.0%
Net CONE times B	NA	NA	NA	NA
Offer cap of 1.1 times BRA clearing price elected	223	69.7%	NA	NA
Uncapped planned uprate and default ACR	0	0.0%	1	0.1%
Uncapped planned uprate and opportunity cost	0	0.0%	0	0.0%
Uncapped planned uprate and Net CONE times B	NA	NA	NA	NA
Uncapped planned uprate and price taker	0	0.0%	0	0.0%
Uncapped planned uprate and 1.1 times BRA clearing price elected	0	0.0%	NA	NA
Uncapped planned generation resources	2	0.6%	25	2.2%
Existing generation resources as price takers	26	8.1%	303	27.1%
Total Generation Capacity Resources offered	320	100.0%	1,119	100.0%

## MOPR

By order issued December 19, 2019, the RPM Minimum Offer Price Rule (MOPR) was modified.<sup>138</sup> The rules applying to natural gas fired capacity resources without state subsidies were retained. The changes included expanding the MOPR to new or existing state subsidized capacity resources; establishing a competitive exemption for new and existing resources other than natural gas fired resources while also allowing a resource specific exception process for those that do not qualify for the competitive exemption; defining limited categorical exemptions for renewable resources participating in renewable portfolio standards (RPS) programs, self supply, DR, EE, and capacity storage; defining the region subject to MOPR for capacity resources with state subsidy as the entire RTO; and defining the default offer price floor for capacity resources with state subsidies as 100 percent of the applicable Net CONE or net ACR values.

The Commission convened a Technical Conference on March 23, 2021, in order to consider whether MOPR should be retained and to consider possible alternative approaches.<sup>139</sup> The MMU testified at the Technical Conference and provided comments and responses to the Commission's questions following the conference.<sup>140</sup>

On September 29, 2021, PJM's FPA section 205 filing in Docket No. ER21-2582-000 revising the Minimum Offer Price Rule (MOPR) was made effective by operation of law.<sup>141</sup> The revised MOPR in OATT Attachment DD § 5.14(h-2) is effective for RPM auctions for the 2023/2024 and subsequent delivery years. Under the revised MOPR, a generation resource would be subject to an offer floor if the capacity is deemed to meet the definition of Conditioned State Support or if the capacity market seller plans to use the resource to exercise Buyer-Side Market Power as the term is

<sup>138</sup> 169 FERC ¶ 61,239 (2019), *order denying reh'g*, 171 FERC ¶ 61,035 (2020), *aff'd* PJM Power Providers Group, et al. v. FERC, Case No. 21-3068 (3<sup>rd</sup> Cir. December 1, 2023), *cert denied*.

<sup>139</sup> Technical Conference regarding Resource Adequacy in the Evolving Electricity Sector, Docket No. AD21-10 (March 23, 2021).

<sup>140</sup> *Modernizing Electricity Market Design*, Comments of the Independent Market Monitor for PJM, Docket No. AD21-10 (April 26, 2021).

<sup>141</sup> *PJM Interconnection, LLC*, Notice of Filing Taking Effect by Operation of Law, Docket No. ER21-2582 (September 29, 2021).

defined in the tariff through either self certification or a fact specific review initiated by the MMU or PJM. Whether a state program or policy qualifies for Conditioned State Support would be the result of a Commission determination.

The MMU's filing in response to PJM's proposal was clear. The PJM markets would be better off, more competitive, and more efficient with no MOPR than with PJM's proposed approach. PJM's proposal would effectively eliminate the MOPR while creating a confusing and inefficient administrative process that effectively makes it both unnecessary and impossible to prove buyer side market power as PJM has defined it.<sup>142</sup>

The Commission approved PJM's proposed revisions to the PJM market rules to implement a forward looking E&AS offset to include forward looking energy and ancillary services revenues rather than historical.<sup>143</sup> The change in the offset affected MOPR floor prices and the results of unit specific reviews under MOPR in the 2023/2024 BRA. This decision was reversed in the Commission's order related to the ORDC matter.<sup>144</sup>

## MOPR Statistics

Under the applicable MOPR rules, market power mitigation measures were applied to MOPR Screened Generation Resources such that the sell offer is set equal to the MOPR Floor Offer Price when the submitted sell offer is less than the MOPR Floor Offer Price and an exemption or exception was not granted, or the sell offer is set equal to the agreed upon minimum level of sell offer when the sell offer is less than the agreed upon minimum level of sell offer based on a Unit-Specific Exception or Resource-Specific Exception.

As shown in Table 5-17, there were no unit specific exception requests for MOPR under OATT Attachment DD § 5.14(h-2) for the 2024/2025 RPM Third Incremental Auction or the 2025/2026 RPM Base Residual Auction. Of the 734.0 MW offered in the 2024/2025 RPM Third Incremental Auction that were subject to MOPR, 673.3 MW cleared and 60.7 MW did not clear. Of the 212.6 MW offered in the 2025/2026 RPM Base Residual Auction that were subject to MOPR, 212.0 MW cleared and 0.6 MW did not clear.

**Table 5-17 MOPR statistics: RPM auctions held in 2024**

	MOPR Type	Calculation Type	Number of Requests	ICAP (MW)		UCAP (MW)	
				Requested	MMU Agreed	Offered	Cleared
2024/2025 Third Incremental Auction	OATT Attachment DD § 5.14(h-2)	Unit Specific Exception	0	0.0	0.0	0.0	0.0
	OATT Attachment DD § 5.14(h-2)	Default	NA	NA	NA	734.0	673.3
	Total		0	0.0	0.0	734.0	673.3
2025/2026 Base Residual Auction	OATT Attachment DD § 5.14(h-2)	Unit Specific Exception	0	0.0	0.0	0.0	0.0
	OATT Attachment DD § 5.14(h-2)	Default	NA	NA	NA	212.6	212.0
	Total		0	0.0	0.0	212.6	212.0

## Replacement Capacity<sup>145</sup>

When a capacity resource is not available for a delivery year, the owner of the capacity resource may purchase replacement capacity. Replacement capacity is the vehicle used to offset any reduction in capacity from a resource which is not available for a delivery year. But the replacement capacity mechanism may also be used to manipulate the market.

Table 5-18 shows the committed and replacement capacity for all capacity resources for June 1 of each year from 2007 through 2025.

Sellers of demand resources in RPM auctions disproportionately replace those commitments on a consistent basis compared to sellers of other resource types. External generation and internal generation not in service had high

<sup>142</sup> See Protest of the Independent Market Monitor for PJM, Docket No. ER21-2582-000 (August 20, 2021); Answer and Motion for Leave to Answer of the Independent Market Monitor for PJM, Docket No. ER21-2582-000 (September 22, 2021).

<sup>143</sup> 173 FERC ¶ 61,134 (2020).

<sup>144</sup> 177 FERC ¶ 61,209 (2021).

<sup>145</sup> For more details on replacement capacity, see "Analysis of Replacement Capacity for RPM Commitments: June 1, 2007 to June 1, 2019," <[http://www.monitoringanalytics.com/reports/Reports/2019/IMM\\_Analysis\\_of\\_Replacement\\_Capacity\\_for\\_RPM\\_Commitments\\_June\\_1\\_2007\\_to\\_June\\_1\\_2019\\_20190913.pdf](http://www.monitoringanalytics.com/reports/Reports/2019/IMM_Analysis_of_Replacement_Capacity_for_RPM_Commitments_June_1_2007_to_June_1_2019_20190913.pdf)> (September 13, 2019).

rates of replacement in some years and those are also of concern.

The dynamic that can result is that the speculative DR suppresses prices in the BRA and displaces physical generation assets. Those generation assets then have an incentive to offer at a low price, including offers at zero and below cost, in IAs in order to ensure some capacity market revenue for long lived physical resources which the owners expect to maintain for multiple years. The result is lower IA prices which permit the buyback of the speculative DR at prices below the BRA prices which encourages the greater use of speculative DR.

PJM's sale of capacity in IAs at very low prices, given that PJM announces the MW quantity and the sell offer price in advance of the auctions, further reduces IA prices and increases the incentive of DR sellers to speculate in the BRAs. The MMU recommends that if PJM sells capacity in incremental auctions, PJM should offer the capacity for sale at the BRA clearing price in order to avoid suppressing the IA price below the competitive level. If the PJM sell offer price is not the BRA clearing price, PJM should not reveal its proposed sell offer price or the MW quantity to be sold prior to the auction.

It has been asserted that selling at a high price in the BRA and buying back at a low price in the IA is just a market transaction and therefore does not constitute a problem. But permitting DR to be an option in the BRA rather than requiring DR to be a commitment to provide a physical asset gives DR an unfair advantage and creates a self fulfilling dynamic that incents more of the same behavior. Only DR is permitted to be an option in the BRA. Generation resources must have met physical milestones in order to offer in the BRA. It is not reasonable to permit DR capacity resources to have a different product definition than generation capacity resources. Even if DR is treated as an annual product, this unique treatment

as an option makes DR an inferior resource and not a complete substitute for generation resources. The current approach to DR is also inconsistent with the history of the definition of capacity in PJM, which has always been that capacity is physical and unit specific. The current approach to DR effectively makes DR a virtual participant in the PJM Capacity Market. That option should be eliminated.

The definition of demand side resources in PJM capacity markets is flawed in a variety of ways. The current demand side definition should be replaced with a definition that includes demand on the demand side of the market. There are ways to ensure and enhance the vibrancy of demand side without negatively affecting markets for generation.

**Table 5-18 RPM commitments and replacements for all Capacity Resources: June 1, 2007 to June 1, 2025<sup>146</sup>**

	UCAP (MW)					RPM Commitment Shortage	RPM Commitments Less Commitment Shortage
	RPM Cleared	Adjustments to Cleared	Net Replacements	RPM Commitments			
01-Jun-07	129,409.2	0.0	0.0	129,409.2	(8.1)		129,401.1
01-Jun-08	130,629.8	0.0	(766.5)	129,863.3	(246.3)		129,617.0
01-Jun-09	134,030.2	0.0	(2,068.2)	131,962.0	(14.7)		131,947.3
01-Jun-10	134,036.2	0.0	(4,179.0)	129,857.2	(8.8)		129,848.4
01-Jun-11	134,182.6	0.0	(6,717.6)	127,465.0	(79.3)		127,385.7
01-Jun-12	141,295.6	(11.7)	(9,400.6)	131,883.3	(157.2)		131,726.1
01-Jun-13	159,844.5	0.0	(12,235.3)	147,609.2	(65.4)		147,543.8
01-Jun-14	161,214.4	(9.4)	(13,615.9)	147,589.1	(1,208.9)		146,380.2
01-Jun-15	173,845.5	(326.1)	(11,849.4)	161,670.0	(1,822.0)		159,848.0
01-Jun-16	179,773.6	(24.6)	(16,157.5)	163,591.5	(924.4)		162,667.1
01-Jun-17	180,590.5	0.0	(13,982.7)	166,607.8	(625.3)		165,982.5
01-Jun-18	175,996.0	0.0	(12,057.8)	163,938.2	(150.5)		163,787.7
01-Jun-19	177,064.2	0.0	(12,300.3)	164,763.9	(9.3)		164,754.6
01-Jun-20	174,023.8	(335.3)	(10,582.7)	163,105.8	(5.7)		163,100.1
01-Jun-21	174,713.0	0.0	(12,963.3)	161,749.7	(316.9)		161,432.8
01-Jun-22	150,465.2	0.0	(5,576.9)	144,888.3	(1,212.7)		143,675.6
01-Jun-23	150,143.9	0.0	(5,517.6)	144,626.3	(2,363.5)		142,262.8
01-Jun-24	154,362.5	0.0	(4,046.2)	150,316.3	(4,377.2)		145,939.1
01-Jun-25	135,684.0	0.0	0.0	135,684.0	0.0		135,684.0

## Market Performance

Figure 5-5 shows cleared MW weighted average capacity market prices on a delivery year basis including base and incremental auctions for each delivery year, and the weighted average clearing prices by LDA in each Base Residual Auction for the entire history of the PJM capacity markets.

Table 5-19 shows RPM clearing prices for the 2021/2022 through 2025/2026 Delivery Years for all RPM auctions

<sup>146</sup> The RPM Commitment Shortage MW for June 1, 2023, and June 1, 2024, were revised from the 2024 Quarterly State of the Market Report for PJM: January through September.

held through 2024, and Table 5-20 shows the RPM cleared MW for the 2021/2022 through 2025/2026 Delivery Years for all RPM auctions held through 2024.

Figure 5-6 shows the RPM cleared MW weighted average prices for each LDA from the 2022/2023 Delivery Year to the current delivery year, and all results for auctions for future delivery years that have been held through 2024. A summary of these weighted average prices is given in Table 5-21.

Table 5-22 shows RPM revenue by delivery year for all RPM auctions held through 2024 based on the unforced MW cleared and the resource clearing prices. For the 2024/2025 Delivery Year, RPM revenue is \$2.6 billion. For the 2025/2026 Delivery Year, RPM revenue is \$14.7 billion.

Table 5-23 shows RPM revenue by calendar year for all RPM auctions held through 2024. In 2024, RPM revenue is \$2.5 billion. In 2025, RPM revenue is \$9.7 billion.

Table 5-24 shows the RPM annual charges to load. For the 2023/2024 Delivery Year, annual charges to load were \$2.2 billion. For the 2024/2025 Delivery Year, annual charges to load are \$2.5 billion.

**Table 5-19 Capacity market clearing prices: 2021/2022 through 2025/2026 RPM Auctions**

		RPM Clearing Price (\$ per MW-day)														
									DPL		PSEG					
	Product Type	RTO	MAAC	APS	PPL	EMAAC	SWMAAC	South	North	PEPCO	ATSI	COMED	BGE	DUKE	DOM	
2021/2022 BRA	Capacity Performance	\$140.00	\$140.00	\$140.00	\$140.00	\$165.73	\$140.00	\$165.73	\$204.29	\$204.29	\$140.00	\$171.33	\$195.55	\$200.30	\$140.00	\$140.00
2021/2022 First Incremental Auction	Capacity Performance	\$23.00	\$23.00	\$23.00	\$23.00	\$25.00	\$23.00	\$25.00	\$45.00	\$219.00	\$23.00	\$23.00	\$23.00	\$60.00	\$23.00	\$23.00
2021/2022 Second Incremental Auction	Capacity Performance	\$10.26	\$10.26	\$10.26	\$10.26	\$15.37	\$10.26	\$15.37	\$125.00	\$125.00	\$10.26	\$10.26	\$10.26	\$70.00	\$10.26	\$10.26
2021/2022 Third Incremental Auction	Capacity Performance	\$20.55	\$20.55	\$20.55	\$20.55	\$26.36	\$20.55	\$26.36	\$31.00	\$31.00	\$20.55	\$20.55	\$20.55	\$39.00	\$20.55	\$20.55
2022/2023 BRA	Capacity Performance	\$50.00	\$95.79	\$50.00	\$95.79	\$97.86	\$95.97	\$97.86	\$97.86	\$97.86	\$95.79	\$50.00	\$68.96	\$126.50	\$71.69	\$50.00
2022/2023 Third Incremental Auction	Capacity Performance	\$19.00	\$35.00	\$19.00	\$35.00	\$35.00	\$96.15	\$35.00	\$35.00	\$35.00	\$35.00	\$19.00	\$19.00	\$35.00	\$19.00	\$19.00
2023/2024 BRA	Capacity Performance	\$34.13	\$49.49	\$34.13	\$49.49	\$49.49	\$49.49	\$69.95	\$49.49	\$49.49	\$49.49	\$34.13	\$34.13	\$69.95	\$34.13	\$34.13
2023/2024 Third Incremental Auction	Capacity Performance	\$37.53	\$49.49	\$37.53	\$49.49	\$146.03	\$49.49	\$146.03	\$146.03	\$146.03	\$49.49	\$37.53	\$37.53	\$79.03	\$37.53	\$37.53
2024/2025 BRA	Capacity Performance	\$28.92	\$49.49	\$28.92	\$49.49	\$53.60	\$49.49	\$426.17	\$53.60	\$53.60	\$49.49	\$28.92	\$28.92	\$73.00	\$96.24	\$28.92
2024/2025 Third Incremental Auction	Capacity Performance	\$58.00	\$80.00	\$58.00	\$80.00	\$175.81	\$80.00	\$175.81	\$175.81	\$175.81	\$80.00	\$58.00	\$58.00	\$155.29	\$58.00	\$58.00
2025/2026 BRA	Capacity Performance	\$269.92	\$269.92	\$269.92	\$269.92	\$269.92	\$269.92	\$269.92	\$269.92	\$269.92	\$269.92	\$269.92	\$269.92	\$466.35	\$269.92	\$444.26

**Table 5-20 Capacity market cleared MW: 2021/2022 through 2025/2026 RPM Auctions<sup>147</sup>**

		UCAP (MW)														
		DPL PSEG														
Delivery Year	Auction	RTO	MAAC	APS	PPL	EMAAC	South	PSEG	North	PEPCO	ATSI	COMED	BGE	DUKE	DOM	TOTAL
2021/2022	BASE	26,552.8	12,565.1	10,136.1	15,368.6	22,286.8	1,673.8	2,237.7	3,134.1	6,013.2	8,010.5	22,358.1	4,200.7	2,746.1	26,343.7	163,627.3
2021/2022	FIRST	118.7	200.4	45.9	27.2	119.0	15.3	18.3	79.1	207.9	739.3	360.4	48.7	87.6	75.4	2,143.2
2021/2022	SECOND	1,082.0	335.8	30.3	55.4	129.9	39.3	97.0	98.1	75.7	1,216.8	205.9	115.5	65.3	160.5	3,707.5
2021/2022	THIRD	1,243.7	168.7	231.6	127.8	911.0	18.3	227.7	244.8	67.2	942.7	221.7	275.9	159.2	394.7	5,235.0
2022/2023	BASE	29,596.0	12,804.7	10,147.4	14,118.7	23,651.2	1,312.9	1,914.3	2,531.1	3,621.8	10,550.7	19,223.7	4,750.9	2,117.7	8,136.3	144,477.3
2022/2023	THIRD	703.3	338.9	84.2	105.7	572.2	9.4	244.3	402.0	27.4	358.0	2,292.3	409.7	44.8	395.7	5,987.9
2023/2024	BASE	28,642.1	10,098.5	8,145.5	14,352.7	22,912.6	1,412.8	2,497.1	3,344.9	3,521.8	9,535.9	25,368.9	5,001.0	1,966.4	8,266.7	145,066.9
2023/2024	THIRD	255.9	1,786.4	395.0	79.3	671.0	24.2	32.4	43.8	15.3	355.8	1,050.0	240.0	68.4	59.8	5,077.0
2024/2025	BASE	28,760.7	10,854.4	8,874.0	14,178.1	23,135.1	1,448.6	2,665.3	3,494.3	3,429.7	9,720.6	25,156.1	5,056.5	2,062.1	8,646.1	147,481.5
2024/2025	THIRD	365.3	744.8	815.6	665.2	963.0	33.2	48.7	60.2	78.7	245.6	2,370.0	222.5	90.2	177.9	6,881.0
2025/2026	BRA	24,573.1	9,490.1	8,481.3	12,368.8	19,043.0	958.7	1,894.3	2,520.1	2,274.4	7,778.5	21,814.2	2,800.6	1,636.7	20,050.2	135,684.0

<sup>147</sup> The MW values in this table refer to rest of LDA or RTO values, which are net of nested LDA values.

**Table 5-21 Weighted average clearing prices by zone: 2021/2022 through 2025/2026**

LDA	Weighted Average Clearing Price (\$ per MW-day)			
	2022/2023	2023/2024	2024/2025	2025/2026
RTO				
AEP	\$49.35	\$34.21	\$29.80	\$269.92
APS	\$49.35	\$34.21	\$29.80	\$269.92
ATSI	\$48.89	\$34.26	\$29.80	\$269.92
Cleveland	\$49.41	\$34.21	\$28.92	\$269.92
COMED	\$63.70	\$34.27	\$31.42	\$269.92
DAY	\$49.16	\$34.17	\$29.13	\$269.92
DUKE	\$70.57	\$34.24	\$94.57	\$269.92
DUQ	\$49.35	\$34.21	\$29.80	\$269.92
DOM	\$49.35	\$34.21	\$29.80	\$444.25
EKPC	\$49.35	\$34.21	\$29.80	\$269.92
MAAC				
EMAAC				
ACEC	\$96.31	\$52.21	\$58.47	\$269.92
DPL	\$96.31	\$52.21	\$58.47	\$269.92
DPL South	\$97.41	\$71.26	\$420.55	\$269.92
JCPLC	\$96.31	\$52.21	\$58.47	\$269.92
PECO	\$96.31	\$52.21	\$58.47	\$269.92
PSEG	\$90.67	\$50.71	\$55.54	\$269.92
PSEG North	\$89.21	\$50.73	\$55.48	\$269.92
REC	\$96.31	\$52.21	\$58.47	\$269.92
SWMAAC				
BGE	\$119.73	\$70.65	\$77.88	\$465.38
PEPCO	\$94.75	\$49.46	\$50.12	\$269.92
WMAAC				
MEC	\$94.49	\$49.49	\$51.07	\$269.92
PE	\$94.49	\$49.49	\$51.07	\$269.92
PPL	\$95.29	\$49.49	\$51.18	\$269.92

**Table 5-22 RPM revenue by delivery year: 2007/2008 through 2025/2026<sup>148</sup>**


Delivery Year	Weighted Average RPM Price (\$ per MW-day)	Weighted Average Cleared UCAP (MW)	Days	RPM Revenue
2007/2008	\$89.78	129,409.2	366	\$4,252,287,381
2008/2009	\$127.67	130,629.8	365	\$6,087,147,586
2009/2010	\$153.37	134,030.2	365	\$7,503,218,157
2010/2011	\$172.71	134,036.2	365	\$8,449,652,496
2011/2012	\$108.63	134,182.6	366	\$5,335,087,023
2012/2013	\$75.08	141,283.9	365	\$3,871,714,635
2013/2014	\$116.55	159,844.5	365	\$6,799,778,047
2014/2015	\$126.40	161,205.0	365	\$7,437,267,646
2015/2016	\$160.01	173,519.4	366	\$10,161,726,902
2016/2017	\$121.84	179,749.0	365	\$7,993,888,695
2017/2018	\$141.19	180,590.5	365	\$9,306,676,719
2018/2019	\$172.09	175,996.0	365	\$11,054,943,851
2019/2020	\$109.82	177,064.2	366	\$7,116,815,360
2020/2021	\$111.07	173,688.5	365	\$7,041,524,517
2021/2022	\$147.33	174,713.0	365	\$9,395,567,946
2022/2023	\$72.33	150,465.2	365	\$3,972,428,671
2023/2024	\$42.01	150,143.9	366	\$2,308,670,914
2024/2025	\$45.57	154,362.5	365	\$2,567,491,013
2025/2026	\$296.56	135,684.0	365	\$14,687,047,370

<sup>148</sup> The results for the ATSI Integration Auctions are not included in this table.

**Table 5-23 RPM revenue by calendar year: 2007 through 2026<sup>149</sup>**

Year	Weighted Average RPM Price (\$ per MW-day)	Weighted Average Cleared UCAP (MW)	Effective Days	RPM Revenue
2007	\$89.78	75,665.5	214	\$2,486,310,108
2008	\$111.93	130,332.1	366	\$5,334,880,241
2009	\$142.74	132,623.5	365	\$6,917,391,702
2010	\$164.71	134,033.7	365	\$8,058,113,907
2011	\$135.14	133,907.1	365	\$6,615,032,130
2012	\$89.01	138,561.1	366	\$4,485,656,150
2013	\$99.39	152,166.0	365	\$5,588,442,225
2014	\$122.32	160,642.2	365	\$7,173,539,072
2015	\$146.10	168,147.0	365	\$9,018,343,604
2016	\$137.69	177,449.8	366	\$8,906,998,628
2017	\$133.19	180,242.4	365	\$8,763,578,112
2018	\$159.31	177,896.7	365	\$10,331,688,133
2019	\$135.58	176,338.6	365	\$8,734,613,179
2020	\$110.55	175,368.7	366	\$7,084,072,778
2021	\$132.33	174,289.2	365	\$8,421,703,404
2022	\$103.36	160,496.5	365	\$6,215,973,960
2023	\$54.56	150,036.3	365	\$2,993,266,921
2024	\$44.09	152,857.8	366	\$2,464,115,790
2025	\$192.73	143,411.3	365	\$9,673,203,507
2026	\$296.56	56,132.3	151	\$6,076,011,378

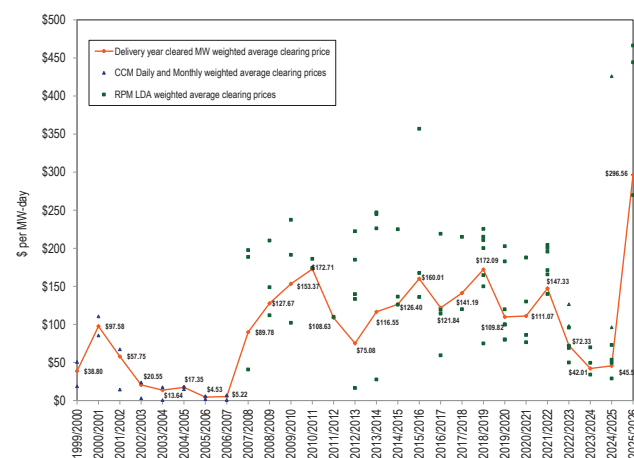**Figure 5-5 History of capacity prices: 1999/2000 through 2025/2026<sup>150</sup>**




<sup>149</sup> The results for the ATSI Integration Auctions are not included in this table.

<sup>150</sup> The 1999/2000 through 2006/2007 capacity prices are CCM combined market, weighted average prices. The 2007/2008 through 2025/2026 capacity prices are RPM weighted average prices. The CCM data points plotted are cleared MW weighted average prices for the daily and monthly markets by delivery year. The RPM data points plotted are RPM LDA clearing prices. For the 2014/2015 and subsequent delivery years, only the prices for Annual Resources or Capacity Performance Resources are plotted.



Figure 5-6 Map of RPM capacity prices: 2022/2023 through 2025/2026

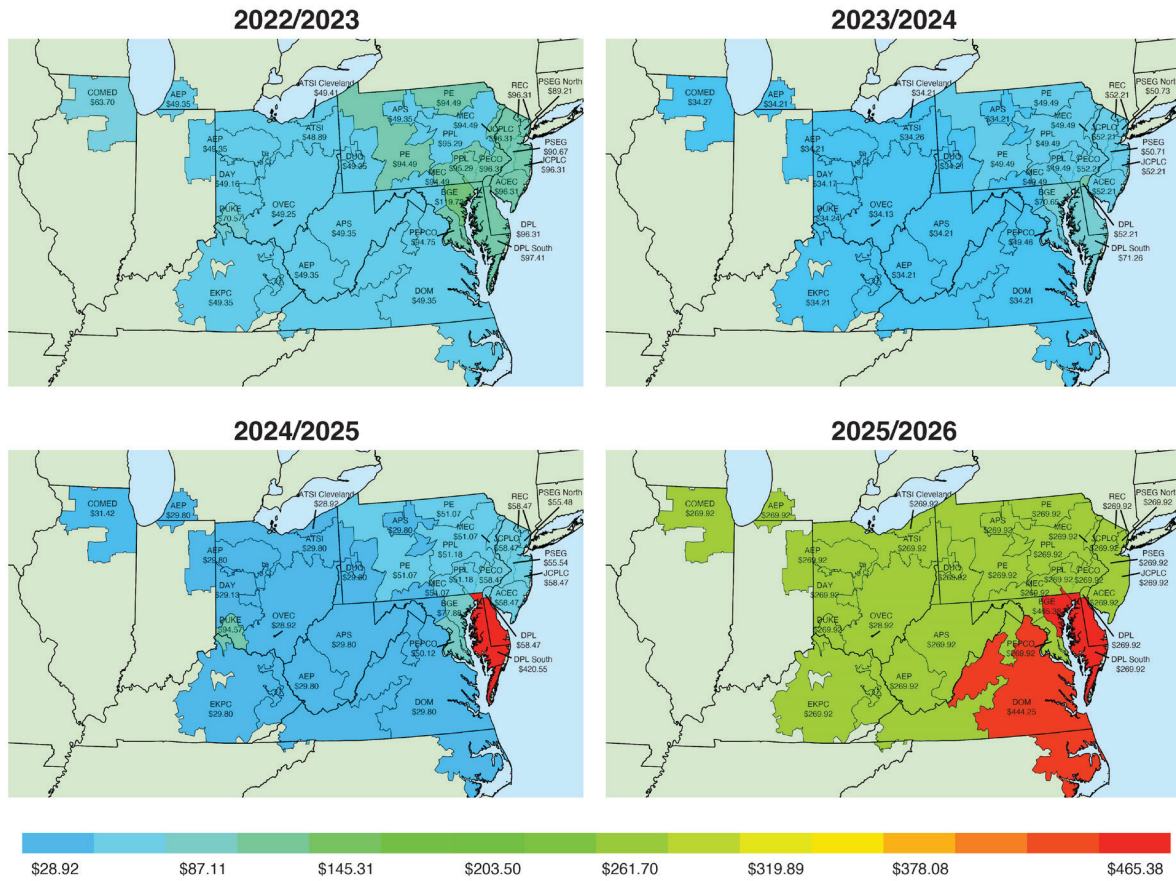

**Table 5-24 RPM cost to load: 2022/2023 through 2025/2026 RPM Auctions<sup>151 152 153</sup>**

	Net Load Price (\$ per MW-day)	UCAP Obligation (MW)	Annual Charges
<b>2022/2023</b>			
Rest of RTO	\$50.05	50,750.7	\$927,101,691
EMAAC	\$97.93	35,388.1	\$1,264,867,389
WMAAC	\$96.61	15,072.2	\$531,498,382
BGE	\$108.22	7,457.7	\$294,575,131
COMED	\$66.23	24,064.5	\$581,774,443
DEOK	\$59.75	5,090.6	\$111,011,442
PEPCO	\$96.15	6,870.5	\$241,111,291
<b>Total</b>		<b>144,694.3</b>	<b>\$3,951,939,768</b>
<b>2023/2024</b>			
Rest of RTO	\$34.18	78,896.5	\$986,982,057
EMAAC	\$50.96	30,972.7	\$577,657,195
WMAAC	\$49.58	22,401.9	\$406,535,572
Rest of EMAAC	\$57.19	4,375.0	\$91,582,753
BGE	\$59.38	7,496.6	\$162,936,916
<b>Total</b>		<b>144,142.8</b>	<b>\$2,225,694,492</b>
<b>2024/2025</b>			
Rest of RTO	\$29.50	77,398.7	\$833,520,097
EMAAC	\$56.56	32,270.3	\$666,184,144
WMAAC	\$50.22	22,872.2	\$419,263,035
Rest of EMAAC	\$175.22	4,590.0	\$293,561,344
BGE	\$61.53	7,726.0	\$173,527,700
DEOK	\$57.93	5,254.4	\$111,105,639
<b>Total</b>		<b>150,111.7</b>	<b>\$2,497,161,960</b>
<b>2025/2026</b>			
Rest of RTO	\$270.35	107,762.5	\$10,633,606,312
BGE	\$306.98	5,968.6	\$668,769,284
DOM	\$429.57	21,952.9	\$3,442,062,633
		<b>135,684.0</b>	<b>\$14,744,438,229</b>

## FRR

The states have authority over their generation resources and can choose to remain in PJM capacity markets or to create FRR entities. The existing FRR approach remains an option for utilities with regulated revenues based on cost of service rates, including both privately and publicly owned (including public power entities and electric cooperatives) utilities. Such regulated utilities have had and continue to have the ability to opt out of the capacity market and provide their own capacity. The existing FRR rules were created in 2007 primarily for the specific circumstances of AEP as part of the original RPM capacity market design settlement. The MMU recommends that the FRR rules be revised and updated to ensure that the rules reflect current market realities and that FRR entities do not unfairly take advantage of those customers paying for capacity in the PJM Capacity Market.

The MMU has prepared reports with analysis of the potential impacts on states pursuing the FRR option. In separate reports for Illinois, Maryland, New Jersey, Ohio, Virginia, and the District of Columbia, the cost impacts of the state choosing the FRR option are computed under different FRR capacity price assumptions and different assumptions regarding the composition of the FRR service area.<sup>154 155 156 157 158 159</sup> The reports showed that the FRR approach is likely to lead to significant increases in payments by customers if it were to replace participation in the PJM markets. The impact on the remaining PJM capacity market footprint is also computed for each scenario. In all but a few scenarios the MMU finds that the FRR leads to higher costs for load included in the FRR service area. In all scenarios the MMU finds that prices in what remains of the PJM Capacity Market would be significantly lower.

<sup>154</sup> See Monitoring Analytics, LLC, "Potential Impacts of the Creation of a ComEd FRR," <[http://www.monitoringanalytics.com/reports/Reports/2019/IMM\\_Potential\\_Impacts\\_of\\_the\\_Creation\\_of\\_a\\_ComEd\\_FRR\\_20191218.pdf](http://www.monitoringanalytics.com/reports/Reports/2019/IMM_Potential_Impacts_of_the_Creation_of_a_ComEd_FRR_20191218.pdf)> (December 18, 2020).

<sup>155</sup> See Monitoring Analytics, LLC, "Potential Impacts of the Creation of Maryland FRRs," <[http://www.monitoringanalytics.com/reports/Reports/2020/IMM\\_Potential\\_Impacts\\_of\\_the\\_Creation\\_of\\_Maryland\\_FRRs\\_20200416.pdf](http://www.monitoringanalytics.com/reports/Reports/2020/IMM_Potential_Impacts_of_the_Creation_of_Maryland_FRRs_20200416.pdf)> (April 16, 2020).

<sup>156</sup> See Monitoring Analytics, LLC, "Potential Impacts of the Creation of New Jersey FRRs," <[http://www.monitoringanalytics.com/reports/Reports/2020/IMM\\_Potential\\_Impacts\\_of\\_the\\_Creation\\_of\\_New\\_Jersey\\_FRRs\\_20200513.pdf](http://www.monitoringanalytics.com/reports/Reports/2020/IMM_Potential_Impacts_of_the_Creation_of_New_Jersey_FRRs_20200513.pdf)> (May 13, 2020).

<sup>157</sup> In the Matter of the Investigation of Resource Adequacy Alternatives, New Jersey Board of Public Utilities, Docket No. E020030203. Monitoring Analytics, LLC Comments, <[http://www.monitoringanalytics.com/filings/2020/IMM\\_Comments\\_Docket\\_No\\_E020030203\\_20200520.pdf](http://www.monitoringanalytics.com/filings/2020/IMM_Comments_Docket_No_E020030203_20200520.pdf)> (May 20, 2020). Monitoring Analytics, LLC, Reply Comments <[http://www.monitoringanalytics.com/filings/2020/IMM\\_Reply\\_Comments\\_Docket\\_No\\_E020030203\\_20200624.pdf](http://www.monitoringanalytics.com/filings/2020/IMM_Reply_Comments_Docket_No_E020030203_20200624.pdf)>. (June 24, 2020). Monitoring Analytics, Answer to Exelon and PSEG, <[http://www.monitoringanalytics.com/filings/2020/IMM\\_Answer\\_to\\_Exelon\\_PSEG\\_Docket\\_No\\_E020030203\\_20200715.pdf](http://www.monitoringanalytics.com/filings/2020/IMM_Answer_to_Exelon_PSEG_Docket_No_E020030203_20200715.pdf)> (July 15, 2020).

<sup>158</sup> See Monitoring Analytics, LLC, "Potential Impacts of the Creation of Ohio FRRs," <[http://www.monitoringanalytics.com/reports/Reports/2020/IMM\\_Potential\\_Impacts\\_of\\_the\\_Creation\\_of\\_Ohio\\_FRRs\\_20200717.pdf](http://www.monitoringanalytics.com/reports/Reports/2020/IMM_Potential_Impacts_of_the_Creation_of_Ohio_FRRs_20200717.pdf)> (July 17, 2020).

<sup>159</sup> See Monitoring Analytics, LLC, "Potential Impacts of the Creation of Virginia FRRs," <[https://www.monitoringanalytics.com/reports/Reports/2021/IMM\\_VA\\_FRR\\_Report\\_20210518.pdf](https://www.monitoringanalytics.com/reports/Reports/2021/IMM_VA_FRR_Report_20210518.pdf)> (May 18, 2021).

<sup>151</sup> The RPM annual charges are calculated using the rounded, net load prices as posted in the PJM RPM auction results.

<sup>152</sup> There is no separate obligation for DPL South as the DPL South LDA is completely contained within the DPL Zone. There is no separate obligation for PSEG North as the PSEG North LDA is completely contained within the PSEG Zone. There is no separate obligation for ATSI Cleveland as the ATSI Cleveland LDA is completely contained within the ATSI Zone.

<sup>153</sup> The net load prices and obligation MW for 2025/2026 are not final.

Both FERC and the states have significant and overlapping authority affecting wholesale power markets. While the FERC MOPR approach was designed to ensure that subsidies did not affect the wholesale power markets, the states have ultimate authority over the generation choices made in the states. The FRR explorations by multiple states illustrated a possible path forward. Under that path, the FERC regulated markets would be unaffected by subsidies but many states would withdraw from the FERC regulated markets and create higher cost nonmarket solutions rather than be limited by MOPR. That would not be an efficient outcome and would not serve the interests of customers or generators.

With the elimination of the prior MOPR rules, the capacity market design must accommodate the choices made by states to subsidize renewable resources in a way that maximizes the role of competition to ensure that customers pay the lowest amount possible, consistent with state goals and the costs of providing the desired resources. Such an approach can take several forms, but none require the dismantling of the PJM capacity market design. The PJM capacity market design can adapt to a wide range of state supported resources and state programs. As a simple starting point, states can continue to support selected resources using a range of payment structures and those resources could participate in the capacity auctions. As a broader and more comprehensive option, PJM could create a central PJM RECs market to facilitate the competitive sale and purchase of RECs.

Dominion Energy Virginia elected the FRR option for the 2022/2023 through 2024/2025 delivery years but returned to the capacity market for the 2025/2026 BRA.

## CRF Issue<sup>160</sup>

As a result of the significant changes to the federal tax code in December 2017, the capital recovery factor (CRF) tables in PJM OATT Attachment DD § 6.8(a) and Schedule 6A were not correct. These tables should have been updated in 2018. Correct CRFs ensure that offer caps and offer floors in the capacity market are correct. On May 4, 2021, PJM filed updates to the OATT under FPA Section 205.<sup>161</sup> In the filing, PJM proposed new CRFs based on the new tax law and new financial assumptions. The new financial assumptions are identical to the assumptions used in the PJM quadrennial review for the calculation of the cost of new entry (CONE) for the PJM reference resource. The MMU, in comments to the Commission, asked that the following formula be included in the tariff as an efficient alternative to use of tables which require updates whenever tax laws or financial assumptions change.<sup>162 163</sup>

$$CRF = \frac{r(1+r)^N \left[ 1 - \frac{sB}{\sqrt{1+r}} - s(1-B)\sqrt{1+r} \sum_{j=1}^L \frac{m_j}{(1+r)^j} \right]}{(1-s)\sqrt{1+r} [(1+r)^N - 1]}$$

The MMU also proposed that PJM discontinue the practice of using an average state tax rate in the CRF calculation. The CRF formula allows for the quick and efficient calculation of a unit's CRF using the state tax rate that is applicable to a specific unit.

FERC accepted PJM's filing but also required that the CRF formula be included in the tariff.<sup>164</sup> FERC rejected the MMU's unit specific state tax recommendation. Going forward, PJM will post the CRFs on their website. Table 5-26 shows the CRFs that are currently posted. The values in Table 5-26 were calculated using the formula above and the financial assumptions in Table 5-27. Bonus depreciation assumptions vary by delivery year with 100 percent bonus depreciation assumed in the 2022/2023 Delivery Year. The bonus depreciation in each subsequent delivery year is reduced by 20 percent.

<sup>160</sup> See related filing on CRF issue in black start: Comments of the Independent Market Monitor for PJM, Docket No. ER21-1635 (April 28, 2021).

<sup>161</sup> "Revisions to Capital Recovery Factor for Avoidable Project Investment Cost Determinations and Request for Waiver of Sixty-Day Notice Requirement," PJM Interconnection LLC, Docket No. ER21-1844-000 (May 4, 2021).

<sup>162</sup> See "Comments of the Independent Market Monitor for PJM," Docket No. ER21-1844-000 (May 25, 2021).

<sup>163</sup> The formula was first introduced in a related Section 205 filing regarding CRFs for black start service. See "Comments of the Independent Market Monitor for PJM" (April 28, 2021) and "Answer and Motion to Answer of the Independent Market Monitor for PJM" (May 19, 2021) in Docket No. ER21-1635-000.

<sup>164</sup> 176 FERC ¶61,003 (2021).

**Table 5-25 Variable descriptions for the CRF formula**

Formula Symbol	Description
r	After tax weighted average cost of capital (ATWACC)
s	Effective tax rate
B	Bonus depreciation percent
N	Cost Recovery Period (years)
L	Lesser of N or 16 (years)
mj	Modified Accelerated Cost Recovery System (MACRS) depreciation factor for year $j = 1, \dots, 16$

The MMU supports the changes to the tariff to correct the application of CRF to the capacity market but there are still unresolved issues. The tariff revisions lack clarity about how CRF values will be determined in the future and to which projects they apply, and lack clarity about how CRF values would be applied to APIR for project costs that are currently being recovered. For example, Table 5-26, which is identical to the table posted by PJM, includes CRF values for projects that go into service for four identified delivery years but fails to note that these CRF values for a later delivery year would not apply for investments made in prior delivery years that will still be in service in the later delivery year.<sup>165</sup> For example, a project that can use the depreciation provisions relevant for the 2023/2024 Delivery Year uses the depreciation provisions once and those provisions affect the project's CRF for its entire life, regardless of the CRF values in the table for subsequent delivery years. However, changes in the tax rate apply each year and if the tax rate changes the applicable CRF values would change for all projects, regardless of vintage. As a result, the CRF values in Table 5-26 for delivery years after 2023/2024 would not apply to the calculation of APIR values for projects that go into service for the 2023/2024 Delivery Year. A similar issue exist for projects that were assigned a CRF under the previous tariff rules. The change in the tax rate should be reflected in the CRF going forward. PJM does not plan to do this and the Commission stated that the issue is beyond the scope of the PJM filing.<sup>166</sup>

**Table 5-26 Levelized CRF values: Delivery Year 2023/2024 through Delivery Year 2026/2027**

Age of Unit (Years)	Cost Recovery Period	2023/2024	2024/2025	2025/2026	2026/2027
		Bonus Depreciation Percent			
		80%	60%	40%	20%
1 to 5	30	0.091	0.094	0.096	0.105
6 to 10	25	0.096	0.098	0.101	0.110
11 to 15	20	0.104	0.107	0.110	0.118
16 to 20	15	0.119	0.122	0.126	0.134
21 to 25	10	0.152	0.158	0.164	0.174
25 Plus	5	0.258	0.271	0.283	0.301
Mandatory CapEx	4	0.312	0.328	0.345	0.367
40 Plus Alternative	1	1.100	1.100	1.100	1.100

**Table 5-27 Financial parameter and tax rate assumptions for CRF calculations**

Parameter	Parameter Values	
	Prior to 2026/2027	2026/2027
Equity Funding Percent	45.000%	45.000%
Debt Funding Percent	55.000%	55.000%
Equity Rate	13.000%	14.100%
Debt Interest Rate	6.000%	6.300%
Federal Income Tax Rate	21.000%	21.000%
State Income Tax Rate	9.300%	9.933%
Effective Income Tax Rate	28.347%	28.847%
After Tax Weighted Average Cost of Capital	8.215%	8.810%

The 2021 update to the CRF values was calculated using the weighted average cost of capital (WACC) model. The original CRF values, prior to 2021, were calculated using a flow to equity (FTE) model. The WACC model assumes a constant debt to equity ratio during the capital recovery period and therefore assumes that debt holders are paid more quickly than is required. The FTE model recognizes that the debt is repaid according to a predetermined payment schedule with all revenue in excess of taxes and debt payments going to the equity investor. The FTE model accurately reflects the cash flows that occur during capital recovery. Table 5-28 compares CRFs calculated under the two approaches using the assumptions in Table 5-27. The difference between the WACC CRF and FTE CRF is dependent upon the capital recovery term and the level of bonus depreciation. The WACC CRF exceeds the FTE CRF by 16.4 percent under 100 percent bonus depreciation with a 30 year cost recovery term. The FTE model is the correct approach because it accurately captures the cash flows during capital recovery over the defined financial life of the asset.

<sup>165</sup> See "Capital Recovery Factors ("CRF") for Avoidable Project Investment Cost ("APIR") Determinations," <<https://pjm.com/-/media/markets-ops/rpm/rpm-auction-info/crf-values-for-apir-determination.ashx>>.

<sup>166</sup> 176 FERC ¶61,003 at P 28 (2021).

Table 5-28 Comparison of FTE and WACC CRFs

Capital Recovery Term (years)	WACC CRF						FTE CRF					
	Bonus Percent						Bonus Percent					
	100%	80%	60%	40%	20%	0%	100%	80%	60%	40%	20%	0%
4	0.296	0.312	0.328	0.345	0.361	0.377	0.289	0.307	0.324	0.342	0.360	0.377
5	0.246	0.258	0.271	0.283	0.296	0.308	0.238	0.252	0.266	0.280	0.294	0.308
10	0.147	0.152	0.158	0.164	0.169	0.175	0.138	0.145	0.153	0.160	0.168	0.175
15	0.116	0.119	0.122	0.126	0.129	0.132	0.105	0.111	0.116	0.122	0.127	0.133
20	0.101	0.104	0.107	0.110	0.113	0.115	0.090	0.095	0.100	0.105	0.110	0.115
25	0.093	0.096	0.098	0.101	0.104	0.106	0.081	0.086	0.091	0.096	0.100	0.105
30	0.088	0.091	0.094	0.096	0.099	0.101	0.076	0.081	0.085	0.090	0.095	0.099
Capital Recovery Term (years)	Absolute Change (WACC CRF less FTE CRF)						Relative Change					
	Bonus Percent						Bonus Percent					
	100%	80%	60%	40%	20%	0%	100%	80%	60%	40%	20%	0%
4	0.007	0.005	0.004	0.003	0.001	-0.000	2.3%	1.8%	1.2%	0.8%	0.3%	(0.1%)
5	0.007	0.006	0.004	0.003	0.001	-0.000	3.1%	2.3%	1.6%	1.0%	0.4%	(0.1%)
10	0.009	0.007	0.005	0.003	0.002	-0.000	6.5%	4.9%	3.4%	2.1%	0.9%	(0.2%)
15	0.010	0.008	0.006	0.004	0.002	-0.000	9.5%	7.2%	5.0%	3.1%	1.3%	(0.3%)
20	0.011	0.009	0.007	0.005	0.003	0.000	12.2%	9.3%	6.7%	4.4%	2.3%	0.4%
25	0.012	0.010	0.007	0.005	0.003	0.001	14.4%	11.2%	8.2%	5.6%	3.2%	1.1%
30	0.012	0.010	0.008	0.006	0.004	0.002	16.4%	12.8%	9.6%	6.7%	4.1%	1.7%

## Timing of Unit Retirements

Generation owners that want to deactivate a unit, either to mothball or permanently retire, must provide notice to PJM and the MMU prior to the proposed deactivation date. Prior to September 2022, generation owners were required to provide deactivation notices at least 90 days before the proposed deactivation date. Beginning in September 2022, PJM and the MMU began reviewing deactivation requests quarterly, and the desired deactivation date is now based on the quarter the request was submitted (Table 5-29). The result is no change to the effective period between the notice and the retirement if notice is provided on the last day of the submittal period, and an increase to six months notice if notice is given on the first day of the submittal period. The MMU recommends that participants be required to provide a notice of deactivation 12 months prior to an auction in which the unit will not be offered due to the deactivation; and no less than 12 months prior to the date of deactivation.

Table 5-29 Earliest deactivation dates allowed based on quarterly submission

Date Request Submitted	Earliest Deactivation Date Permitted
January 1 to March 31	July 1
April 1 to June 30	October 1
July 1 to September 30	January 1 (following calendar year)
October 1 to December 31	April 1 (following calendar year)

Generation owners seeking a capacity market must offer exemption for a delivery year must submit their deactivation request no later than the December 1

preceding the Base Residual Auction or 120 days before the start of an Incremental Auction for that delivery year.<sup>167</sup> If no reliability issues are found during PJM's analysis of the retirement's impact on the transmission system, and the MMU finds no market power issues associated with the proposed deactivation, the unit may deactivate at any time thereafter.<sup>168</sup>

Table 5-30 shows the timing of actual deactivation dates and the initially requested deactivation date, for all deactivation requests submitted from January 2018 through December 2024. Of the 199 deactivation requests submitted, 31 units (15.6 percent) deactivated an average of 157 days earlier than their initially requested date; 30 units (15.1 percent) deactivated an average of 103 days later than the originally requested deactivation date; and 79 units (39.7 percent) deactivated on their initially requested date. Twenty four (12.1 percent) of the unit deactivations were cancelled an average of 256 days (approximately 37 weeks) before their scheduled deactivation date, and 35 (17.6 percent) of the unit deactivations have not yet reached their target retirement date. Table 5-31 shows this information broken out by fuel types.

Due to the significant increase in the capacity price for the 2025/2026 Delivery Year, several units that were scheduled to deactivate rescinded their deactivation request. In 2024, Middle River Power, LLC, rescinded the deactivation of 483 MW from the Elgin CT 1-4 units.

<sup>167</sup> OATT Attachment DD § 6.6(g).

<sup>168</sup> OATT Part V §113.



At least nine other units that were slated to deactivate, accounting for 454.4 MW, have said they will rescind their deactivation requests as a result of the 2025/2026 BRA clearing prices.

**Table 5-30 Timing of actual unit deactivations compared to requested deactivation date: Requests submitted January 2018 through December 2024<sup>169</sup>**

Status	Number of Units	Percent	Average Days Deviation from Originally Requested Date
Early	31	15.6%	(157)
Late	30	15.1%	103
On time	79	39.7%	0
Cancelled	24	12.1%	(256)
Pending	35	17.6%	-
Total	199	100.0%	-

**Table 5-31 Timing of actual unit deactivations compared to requested deactivation date by fuel type: Requests submitted January 2018 through December 2024**

Fuel Type	Status	Number of Units	Percent	Average Days Deviation from Originally Requested Date
Biomass	Early	2	66.7%	(4)
	Late	1	33.3%	-
	On time	0	0.0%	-
	Cancelled	0	0.0%	-
	Pending	0	0.0%	-
Total		3	100.0%	-
Coal	Early	15	31.3%	(169)
	Late	9	18.8%	78
	On time	16	33.3%	0
	Cancelled	4	8.3%	(371)
	Pending	4	8.3%	-
Total		48	100.0%	-
Diesel	Early	0	0.0%	-
	Late	0	0.0%	-
	On time	5	83.3%	-
	Cancelled	0	0.0%	-
	Pending	1	16.7%	-
Total		6	100.0%	-
Methane	Early	4	15.4%	(107)
	Late	7	26.9%	71
	On time	11	42.3%	0
	Cancelled	2	7.7%	(190)
	Pending	2	7.7%	-
Total		26	100.0%	-
Natural Gas	Early	4	9.3%	(197)
	Late	6	14.0%	94
	On time	16	37.2%	0
	Cancelled	5	11.6%	-
	Pending	12	27.9%	-
Total		43	100.0%	-
Nuclear	Early	0	0.0%	-
	Late	0	0.0%	-
	On time	0	0.0%	-
	Cancelled	10	100.0%	(312)
	Pending	0	0.0%	-
Total		10	100.0%	-
Oil	Early	3	5.8%	(218)
	Late	7	13.5%	188
	On time	24	46.2%	0
	Cancelled	3	5.8%	(36)
	Pending	15	28.8%	-
Total		52	100.0%	-
Solar	Early	0	0.0%	-
	Late	0	0.0%	-
	On time	0	0.0%	-
	Cancelled	0	0.0%	-
	Pending	1	1.9%	-
Total		1	1.9%	-
Solid Waste	Early	0	0.0%	-
	Late	0	0.0%	-
	On time	1	100.0%	0
	Cancelled	0	0.0%	-
	Pending	0	0.0%	-
Total		1	100.0%	-
Storage	Early	3	33.3%	-
	Late	0	0.0%	-
	On time	6	66.7%	0
	Cancelled	0	0.0%	-
	Pending	0	0.0%	-
Total		9	100.0%	-

<sup>169</sup> Negative values indicate the average number of days the action is taken prior to the requested date.

## Part V Reliability Service (RMR)

PJM must make out of market payments to units that want to retire (deactivate) but that PJM requires to remain in service, for limited operation, for a defined period because the unit is needed for reliability.<sup>170</sup> This provision has been known as Reliability Must Run (RMR) service but RMR is not defined in the PJM tariff, and the PJM market design has important distinguishing features relative to other regions where arrangements referred to as RMR are used. Here the term Part V reliability service is used. The need to retain uneconomic units in service reflects a flawed market design and/or planning process problems. The current capacity market design fails to include transmission constraints inside LDAs with the result that units needed for reliability do not clear in capacity auctions and that prices are suppressed and an RMR is then required. The current approach does not adequately look forward and attempt to address foreseeable unit retirements, whether for economic or regulatory reasons. The result is the wrong price signal for either investing in the existing resource or investing in new resources to provide locational reliability. The answer is not to artificially increase prices during the RMR while the transmission alternative is under construction but to provide an actionable price signal in advance of retirement as a signal to new generation to enter and compete with the transmission solution. It is essential that the deactivation provisions of the tariff be evaluated and modified, both to provide rules that better anticipate deactivations in the markets and rules that reasonably compensate Part V reliability service if it is still needed. Recent changes to the rules fail to address these issues.<sup>171</sup> It is also essential that queue processes that effectively prevent competition from new generation to replace the old generation be modified.

To improve coordination of deactivations and PJM transmission system planning, the MMU recommends that the same reliability standard be used in capacity auctions as is used by PJM transmission planning which means recognizing transmission constraints inside LDAs when they create reliability issues. One result of the current design is that a unit may fail to clear in a BRA, decide to retire as a result, but then be found to be needed for reliability by PJM planning and paid under Part V of the OATT (RMR) to remain in service while

transmission upgrades are made. This result indicates a significant market design flaw.

The MMU recommends that PJM treat the inclusion of RMR resources in the capacity market consistently. PJM currently includes RMR units in the reliability analysis for RPM auctions but does not include the RMR units in the supply curves. This approach is internally inconsistent. It would be internally consistent to leave the RMR units out of the CETO/CETL analysis. It would also be internally consistent to include the RMR units in the supply of capacity and in the CETO/CETL analysis. Including RMR resources in the capacity supply curve does not mean forcing unit owners to offer or to take on PAI risk, for example. It simply means that PJM would recognize the fact that PJM treats RMR resources as a source of reliability. The goal is to ensure that the underlying supply and demand fundamentals are included in the capacity market prices. These two options have very different implications for capacity market prices. There are times early in the process when a price signal for the entry of generation is appropriate, e.g. when the goal is to allow generation to compete to replace the transmission option, in whole or in part, and there is enough time to permit such new entry. There are times later in the process when a price signal for the entry of generation is not needed or appropriate, e.g. when PJM has committed to the construction of new transmission that will eliminate the price signal when complete or when there is not enough time to permit such new entry. The relevant rules can and should be changed.

The planning process should, to the extent possible, evaluate the impact of the loss of units at risk and determine in advance whether transmission upgrades are required.<sup>172</sup> It is essential that PJM look forward and attempt to plan for foreseeable unit retirements, whether for economic or regulatory reasons. While not all retirements are completely foreseeable, improvement is needed in the process for ensuring that planning is looking at the probability of retirements, especially of resources that are critical to locational reliability in order to minimize the duration of any RMR requirement.

<sup>170</sup> OATT Part V §114.

<sup>171</sup> See Deactivation Enhancements Senior Task Force (DESTF), which can be accessed at: <https://www.pjm.com/committees-and-groups/task-forces/destf>.

<sup>172</sup> See, e.g., 140 FERC ¶ 61,237 at P 36 (2012) ("The evaluation of alternatives to an SSR designation is an important step that deserves the full consideration of MISO and its stakeholders to ensure that SSR Agreements are used only as a 'limited, last-resort measure'"); 118 FERC ¶ 61,243 at P 41 (2007) ("the market participants that pay for the agreements pay out-of-market prices for the service provided under the RMR agreements, which broadly hinders market development and performance.[footnote omitted] As a result of these factors, we have concluded that RMR agreements should be used as a last resort."); 110 FERC ¶ 61,315 at P 40 (2005) ("The Commission has stated on several occasions that it shares the concerns . . . that RMR agreements not proliferate as an alternative pricing option for generators, and that they are used strictly as a last resort so that units needed for reliability receive reasonable compensation.").

The actual implementation of Part V of the tariff has resulted in overpayment of the RMR resources. It is essential that the compensation provisions of Part V of the tariff be modified to ensure payment of all but only the actual costs incurred by the generation owner to provide the service, plus an incentive. Generators operating in competitive markets should be required, as an obligation of receiving interconnection service and having the ability to participate in competitive markets, to provide service under Part V on an incremental cost plus incentive basis when they are needed for reliability.

When notified of an intended deactivation, the MMU performs a market power study to ensure that the deactivation is economic, not an exercise of market power through withholding, and consistent with competition.<sup>173</sup> If the MMU determines that expected revenues exceed avoidable costs and therefore that the deactivation is not economic, the MMU will inform the unit owner that there is a market power issue. The MMU has no authority to prevent the retirement. The MMU can pursue the matter at FERC. Part V status by itself creates market power for the retiring resource. The owners of Part V resources have threatened to shut down the resources and put the grid at risk if they do not receive their requested level of Part V payments. Such exercises of market power have been effective in increasing payments to Part V units during the settlement proceedings that have resolved all Part V filings, generally on a black box basis.

PJM performs a system study to determine whether the system can accommodate the deactivation on the desired date, and if not, when it could.<sup>174</sup> If PJM determines that it needs a unit for a period beyond the intended deactivation date, PJM will request a unit to remain in service for a defined period.<sup>175</sup> The PJM market rules do not require an owner to remain in service, but owners must provide advance notice of a proposed deactivation although the advance notice can be too short to permit new generation to enter (See Table 5-29).<sup>176</sup> The owner of a generation capacity resource must provide notice of a proposed deactivation in order to avoid a requirement to offer in RPM auctions.<sup>177</sup> In order to avoid submitting an offer for a unit in the next three-year forward RPM base residual auction, an owner must show “a documented

plan in place to retire the resource,” including a notice of deactivation filed with PJM, 120 days prior to such auction.<sup>178</sup>

Under the current rules, a unit remaining in service at PJM’s request can recover its costs of continuing to operate under either the deactivation avoidable cost rate (DACR), which is a formula rate, or the cost of service recovery rate. The deactivation avoidable cost rate is designed to permit the recovery of the costs of the unit’s “continued operation,” termed “avoidable costs,” plus an incentive adder.<sup>179</sup> Avoidable costs are defined to mean “incremental expenses directly required for the operation of a generating unit.”<sup>180</sup> The incentives escalate for each year of service (first year, 10 percent; second year, 20 percent; third year, 35 percent; fourth year, 50 percent).<sup>181</sup> The rules provide terms for the repayment of project investment by owners of units that choose to keep units in service after the defined period ends.<sup>182</sup> Project investment is capped at \$2 million, above which FERC approval is required.<sup>183</sup> The cost of service rate is designed to permit the recovery of the unit’s “cost of service rate to recover the entire cost of operating the generating unit” if the generation owner files a separate rate schedule at FERC.<sup>184</sup>

The DACR is unnecessarily prescriptive about the nature of the incremental costs needed to provide service, includes unsupported escalation to extremely high incentive rates, and unnecessarily caps incremental investment at an arbitrary level.

Table 5-32 shows units that have provided Part V reliability service to PJM, including the Indian River 4 unit, which began providing RMR service on June 1, 2022, and is expected to end on February 24, 2025.<sup>185</sup> Only two of nine owners have used the deactivation avoidable cost rate approach. The other seven owners used the cost of service recovery rate. For units using the cost of service recovery rate option, revenues have averaged about 3.8 times the corresponding market

<sup>173</sup> OATT § 113.2; OATT Attachment M § IV.1.

<sup>174</sup> OATT § 113.2.

<sup>175</sup> *Id.*

<sup>176</sup> OATT § 113.1.

<sup>177</sup> OATT Attachment DD § 6.6(g).

<sup>178</sup> *Id.*

<sup>179</sup> OATT § 114 (Deactivation Avoidable Credit = [(Deactivation Avoidable Cost Rate + Applicable Adder) \* MW capability of the unit \* Number of days in the month] – Actual Net Revenues).

<sup>180</sup> OATT § 115.

<sup>181</sup> *Id.*

<sup>182</sup> OATT § 118.

<sup>183</sup> OATT §§ 115, 117.

<sup>184</sup> OATT § 119.

<sup>185</sup> See PJM, “Informational Filing Regarding Formal Notice of Termination of Reliability Must-Run Service,” Docket Nos. ER22-2539-000 and ER23-2688-000 (December 23, 2024).

price of capacity while for units using the deactivation avoidable cost rate, revenues have averaged about 1.6 times the corresponding market price of capacity.<sup>186</sup>

**Table 5-32 Part V reliability service summary**

Unit Names	Owner	Fuel Type	ICAP (MW)	Cost Recovery Method	Docket Numbers	Start of Term	End of Term
Brandon Shores 1	Talen Energy Corporation	Coal	635.0	Cost of Service Recovery Rate	ER24-1790	01-Jun-25	31-Dec-28
Brandon Shores 2	Talen Energy Corporation	Coal	638.0	Cost of Service Recovery Rate	ER24-1790	01-Jun-25	31-Dec-28
Wagner 3	Talen Energy Corporation	Coal	305.0	Cost of Service Recovery Rate	ER24-1787	01-Jun-25	31-Dec-28
Wagner 4	Talen Energy Corporation	Oil	397.0	Cost of Service Recovery Rate	ER24-1787	01-Jun-25	31-Dec-28
Indian River 4	NRG Power Marketing LLC	Coal	410.0	Cost of Service Recovery Rate	ER22-1539	01-Jun-22	24-Feb-25
B.L. England 2	RC Cape May Holdings, LLC	Coal	150.0	Cost of Service Recovery Rate	ER17-1083	01-May-17	01-May-19
Yorktown 1	Dominion Virginia Power	Coal	159.0	Deactivation Avoidable Cost Rate	ER17-750	06-Jan-17	13-Mar-18
Yorktown 2	Dominion Virginia Power	Coal	164.0	Deactivation Avoidable Cost Rate	ER17-750	06-Jan-17	13-Mar-18
B.L. England 3	RC Cape May Holdings, LLC	Oil	148.0	Cost of Service Recovery Rate	ER17-1083	01-May-17	24-Jan-18
Ashtabula	FirstEnergy Service Company	Coal	210.0	Deactivation Avoidable Cost Rate	ER12-2710	01-Sep-12	11-Apr-15
Eastlake 1	FirstEnergy Service Company	Coal	109.0	Deactivation Avoidable Cost Rate	ER12-2710	01-Sep-12	15-Sep-14
Eastlake 2	FirstEnergy Service Company	Coal	109.0	Deactivation Avoidable Cost Rate	ER12-2710	01-Sep-12	15-Sep-14
Eastlake 3	FirstEnergy Service Company	Coal	109.0	Deactivation Avoidable Cost Rate	ER12-2710	01-Sep-12	15-Sep-14
Lakeshore	FirstEnergy Service Company	Coal	190.0	Deactivation Avoidable Cost Rate	ER12-2710	01-Sep-12	15-Sep-14
Elrama 4	GenOn Power Midwest, LP	Coal	171.0	Cost of Service Recovery Rate	ER12-1901	01-Jun-12	01-Oct-12
Niles 1	GenOn Power Midwest, LP	Coal	109.0	Cost of Service Recovery Rate	ER12-1901	01-Jun-12	01-Oct-12
Cromby 2 and Diesel	Exelon Generation Company, LLC	Natural gas/oil, Diesel	203.7	Cost of Service Recovery Rate	ER10-1418	01-Jun-11	01-Jan-12
Eddystone 2	Exelon Generation Company, LLC	Coal	309.0	Cost of Service Recovery Rate	ER10-1418	01-Jun-11	01-Jan-12
Brunot Island CT2A, CT2B, CT3 and CC4	Orion Power MidWest, L.P.	Natural gas	244.0	Cost of Service Recovery Rate	ER06-993	16-May-06	05-Jul-07
Hudson 1	PSEG Energy Resources & Trade LLC and PSEG Fossil LLC	Natural gas	355.0	Cost of Service Recovery Rate	ER05-644, ER11-2688	25-Feb-05	08-Dec-11
Sewaren 1-4	PSEG Energy Resources & Trade LLC and PSEG Fossil LLC	Natural gas	453.0	Cost of Service Recovery Rate	ER05-644	25-Feb-05	01-Sep-08

**Table 5-33 Part V reliability service cost summary<sup>187 188</sup>**

Unit Names	Owner	Initial Filing		Actual		Weighted Average RPM Clearing Price (\$ per MW-day)
		Total Cost	Cost per MW-day	Total Cost	Cost per MW-day	
Brandon Shores 1	Talen Energy Corporation	\$327,039,342	\$393.45	NA	NA	\$296.56
Brandon Shores 2	Talen Energy Corporation	\$328,584,409	\$393.45	NA	NA	\$296.56
Wagner 3	Talen Energy Corporation	\$64,791,528	\$162.29	NA	NA	\$296.56
Wagner 4	Talen Energy Corporation	\$84,335,202	\$162.29	NA	NA	\$296.56
Indian River 4	NRG Power Marketing LLC	\$357,065,662	\$871.76	\$167,337,698	\$431.89	\$54.04
B.L. England 2	RC Cape May Holdings, LLC	\$35,953,561	\$328.34	\$51,779,892	\$472.88	\$154.51
Yorktown 1	Dominion Virginia Power	\$9,739,434	\$142.12	\$8,427,011	\$122.97	\$134.64
Yorktown 2	Dominion Virginia Power	\$10,045,705	\$142.12	\$9,529,149	\$134.81	\$134.64
B.L. England 3	RC Cape May Holdings, LLC	\$28,710,481	\$723.84	\$10,058,665	\$253.60	\$138.95
Ashtabula	FirstEnergy Service Company	\$35,236,541	\$176.25	\$25,177,042	\$125.94	\$107.91
Eastlake 1	FirstEnergy Service Company	\$20,842,416	\$257.01	\$18,484,399	\$227.93	\$102.73
Eastlake 2	FirstEnergy Service Company	\$20,182,025	\$248.87	\$17,683,994	\$218.06	\$102.73
Eastlake 3	FirstEnergy Service Company	\$20,192,938	\$249.00	\$17,391,797	\$214.46	\$102.73
Lakeshore	FirstEnergy Service Company	\$33,993,468	\$240.47	\$20,532,969	\$145.25	\$102.73
Elrama 4	GenOn Power Midwest, LP	\$15,435,472	\$739.88	\$7,576,435	\$363.17	\$75.08
Niles 1	GenOn Power Midwest, LP	\$9,510,580	\$715.19	\$4,829,423	\$363.17	\$75.08
Cromby 2 and Diesel	Exelon Generation Company, LLC	\$20,213,406	\$463.70	\$17,776,658	\$407.80	\$108.63
Eddystone 2	Exelon Generation Company, LLC	\$165,993,135	\$1,467.74	\$85,364,570	\$754.81	\$108.63
Brunot Island CT2A, CT2B, CT3 and CC4	Orion Power MidWest, L.P.	\$60,933,986	\$601.76	\$23,507,795	\$232.15	\$89.78
Hudson 1	PSEG Energy Resources & Trade LLC and PSEG Fossil LLC	\$28,934,341	\$32.90	\$62,364,359	\$70.92	\$132.72
Sewaren 1-4	PSEG Energy Resources & Trade LLC and PSEG Fossil LLC	\$47,633,115	\$81.89	\$79,580,435	\$136.82	\$97.39

In each of the cost of service recovery rate filings for Part V reliability service, the scope of recovery permitted under the cost of service approach defined in Section 119 has been a significant issue. Owners have sought to recover fixed costs, incurred prior to the noticed deactivation date, in addition to the cost of operating the generating unit. Owners have cited the cost of service reference to mean that the unit is entitled to file to recover sunk costs that it was unable to recover in the competitive markets, in addition to recovery of costs of actually providing the Part V reliability service.

The cost of service recovery rate approach has been interpreted by the companies using that approach to allow the company to develop the type of rate case filing used by regulated utilities, using a test year with adjustments, to establish a rate base including investment in the existing plant and new investment necessary to remain in

<sup>186</sup> The final rate for the Indian River 4 has not been established. The final rate could be lower or higher. The rate in the table is the actual cost to date of the RMR service. The final rates for Brandon Shores and Wagner have not been established. RMR service for these plants has not started.

<sup>187</sup> Actual cost data includes RMR charges through December 31, 2024.

<sup>188</sup> The actual cost data for Indian River 4 include a refund of the difference between the filed rate that was collected pending resolution and the RMR draft settlement amount.

service and to earn a return on that rate base and receive depreciation of that rate base, plus guarantee recovery of estimated operation and maintenance expenses without verification of actual expenses. Despite the asserted reliance on traditional cost of service ratemaking principles, in practice generators seek approval of high rates that have weak or non-existent support in law and fact relative to what has been traditionally required to justify cost of service rates. Companies developing the cost of service recovery rate have ignored the tariff's limitation to the costs of operating the unit during the Part V reliability service period and have included costs incurred prior to the decision to deactivate and costs associated with closing the unit that would have been incurred regardless of the Part V reliability service period.<sup>189</sup> In some cases, the filing included costs that already had been written off, or impaired, on the company's public books.<sup>190 191</sup> In another case, the filing ignored evidence of actual book value based on market purchase of the asset.<sup>192</sup> The requested cost of service recovery rates substantially exceed the actual costs of operating to provide the reliability required by PJM. The requested costs are generally not subject to review, audit and verification.

Because such units are needed by PJM for reliability reasons, and the provision of the service is voluntary in PJM, owners of units that PJM needs to remain in service after the desired retirement date have significant market power in establishing the terms of this reliability service which have generally been set through settlements.

This reliability service should be provided to PJM customers at reasonable rates, which reflect the relatively low risk nature of providing such service to owners, the reliability need for such service and the opportunity for owners to be guaranteed recovery of 100 percent of the actual incremental costs required to operate to provide the service plus an incentive.

The MMU recommends elimination of both the cost of service recovery rate in OATT Section 119 and the deactivation avoidable cost rate in Part V, and their replacement with clear language that provides for the recovery of 100 percent of the actual incremental

costs required to operate to provide the service plus an incentive.

The MMU recommends that units recover all and only the incremental costs, including incremental investment costs without a cap, required to provide Part V reliability service (RMR service) that the unit owner would not have incurred if the unit owner had deactivated its unit as it proposed, plus a defined incentive payment. Customers should bear no responsibility for paying previously incurred (sunk) costs, including a return on or of prior investments.

## Generator Performance

Generator performance results from the interaction between the physical characteristics of the units and the level of expenditures made to maintain the capability of the units, which in turn is a function of incentives from energy, ancillary services and capacity markets. Generator performance indices include those based on total hours in a period (generator performance factors) and those based on hours when units are needed to operate by the system operator (generator forced outage rates).

## Capacity Factor

Capacity factor measures the actual output of a power plant over a period of time compared to the potential output of the unit had it been running at full nameplate capacity for every hour during that period. Table 5-34 shows the capacity factors by unit type for 2023 and 2024. In 2024, nuclear units had a capacity factor of 95.1 percent, compared to 95.7 percent in 2023; combined cycle units had a capacity factor of 66.0 percent in 2024, compared to a capacity factor of 63.7 percent in 2023; coal units had a capacity factor of 36.1 percent in 2024, compared to a capacity factor of 30.3 percent in 2023.

<sup>189</sup> See, e.g., FERC Dockets Nos. ER10-1418-000, ER12-1901-000 and ER17-1083-000.

<sup>190</sup> See GenOn Filing, Docket No. ER12-1901-000 (May 31, 2012) at Exh. No. GPM-1 at 9:16-21.

<sup>191</sup> See NRG Filing, Docket No. ER22-1539-000 (April 1, 2022).

<sup>192</sup> See Brandon Shores, H.A. Wagner, Docket No. ER24-1787-000, et al. (April 18, 2024); Comments of the Independent Market Monitor for PJM in Opposition to Settlement, Docket No. ER24-1787-000, et al. (February 18, 2025).



**Table 5-34 Capacity factor (By unit type (GWh)): 2023 and 2024<sup>193 194 195</sup>**

Unit Type	2023		2024		Change in Capacity Factor
	Generation (GWh)	Capacity Factor	Generation (GWh)	Capacity Factor	
Battery	28.3	1.1%	51.8	1.8%	0.7%
Combined Cycle	326,709.1	63.7%	334,577.3	66.0%	2.2%
Single Fuel	282,435.2	68.7%	287,727.8	70.8%	2.1%
Dual Fuel	44,273.9	43.6%	46,849.5	46.4%	2.8%
Combustion Turbine	21,483.0	8.2%	22,750.9	9.0%	0.8%
Single Fuel	15,294.4	8.8%	14,301.1	8.2%	(0.6%)
Dual Fuel	6,188.6	7.1%	8,449.9	10.9%	3.8%
Diesel	459.7	14.3%	324.6	12.5%	(1.9%)
Single Fuel	442.1	15.5%	298.4	12.9%	(2.6%)
Dual Fuel	17.6	4.8%	26.2	8.7%	3.8%
Diesel (Landfill gas)	1,028.6	51.6%	901.9	49.6%	(2.1%)
Fuel Cell	197.9	82.5%	215.2	89.5%	7.0%
Nuclear	273,488.6	95.7%	272,744.4	95.1%	(0.5%)
Pumped Storage Hydro	7,644.4	16.1%	8,143.8	17.1%	1.0%
Run of River Hydro	7,844.3	43.6%	7,857.6	43.5%	(0.0%)
Solar	10,965.7	19.3%	17,261.3	19.1%	(0.2%)
Steam	131,327.8	6.1%	137,407.9	8.6%	2.5%
Biomass	5,281.9	66.4%	4,993.7	64.8%	(1.6%)
Coal	115,772.9	30.3%	119,918.0	36.1%	5.8%
Single Fuel	115,725.6	33.7%	119,918.0	36.7%	3.0%
Dual Fuel	47.3	14.3%	0.0	0.0%	(14.3%)
Natural Gas	9,293.0	43.2%	11,341.0	46.0%	2.8%
Single Fuel	479.3	52.9%	519.9	54.0%	1.1%
Dual Fuel	8,813.6	22.3%	10,821.1	27.3%	5.0%
Oil	980.1	2.5%	1,155.2	4.1%	1.6%
Wind	28,787.6	7.4%	31,383.8	16.1%	8.7%
Total	809,965.1	45.6%	833,620.5	48.3%	2.6%

## Generator Performance Factors

Generator outages fall into three categories: planned, maintenance, and forced. The scheduling of planned and maintenance outages must be approved by PJM. The approval may be withdrawn in order to maintain system reliability.<sup>196</sup> The PJM Market Rules do not specify any consequences if the planned outage continues after PJM withdraws approval. If PJM withdraws approval for a maintenance outage during the outage and the unit cannot operate, the outage is defined to be a forced outage.<sup>197</sup> Outages that are approved by PJM may be extended. An extension to a planned outage that enters the peak period is treated as a forced outage. A maintenance outage that is extended to more than nine days during the peak period is treated as a forced outage.

The MW on outage vary during the year. For example, the MW on planned outage are generally highest in the spring and fall, as shown in Figure 5-7, as a result of restrictions on planned outages during the winter and summer. The Peak Period Maintenance Season, shown in Figure 5-7, runs from the weeks containing the twenty-fourth through thirty-sixth Wednesdays of the year. Planned outages cannot start in nor extend into this period. In 2024, the period runs from Monday, June 10 until Friday, September 6. The effect of the seasonal variation in outages can be seen in the monthly generator performance metrics in Figure 5-10.

<sup>193</sup> The capacity factors in this table are based on nameplate capacity values, and are calculated based on when the units come on line.


<sup>194</sup> The subcategories of steam units are consolidated consistent with confidentiality rules. Coal is comprised of coal and waste coal. Natural gas is comprised of natural gas and propane. Oil is comprised of both heavy and light oil. Biomass is comprised of biomass, landfill gas, and municipal solid waste.

<sup>195</sup> Hours in which batteries have net negative generation do not count toward their runtime.

<sup>196</sup> "PJM Manual 10: Pre-Scheduling Operations," § 2.3.2 Maintenance Outage Rules, Rev. 45 (Nov. 21, 2024).

<sup>197</sup> OATT, Attachment K (Appendix) § 1.9.3 (b).

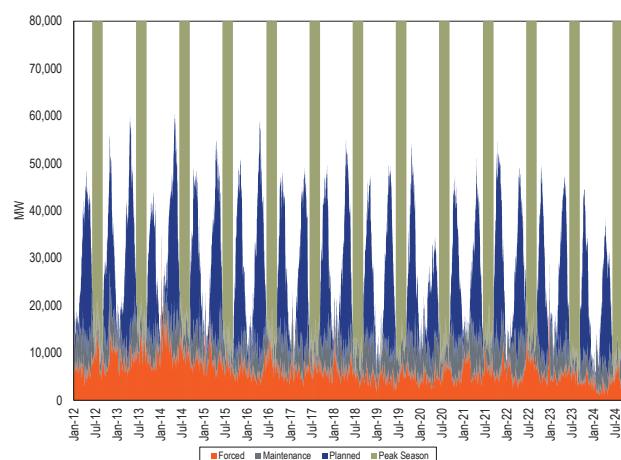Figure 5-7 Outages (MW): 2012 through 2024



In 2024, forced outages were 13.0 percent lower, planned outages were 2.9 percent lower, and maintenance outages were 9.1 percent lower than in 2023.

Performance factors include the equivalent availability factor (EAF), the equivalent maintenance outage factor (EMOF), the equivalent planned outage factor (EPOF) and the equivalent forced outage factor (EFOF). These four factors add to 100 percent for any generating unit. The EAF is the proportion of hours in a year when a unit is available to generate at full capacity while the three outage factors include all the hours when a unit is unavailable. The EMOF is the proportion of hours in a year when a unit is unavailable because of maintenance outages and maintenance deratings. The EPOF is the proportion of hours in a year when a unit is unavailable because of planned outages and planned deratings. The EFOF is the proportion of hours in a year when a unit is unavailable because of forced outages and forced deratings.

The PJM aggregate EAF, EFOF, EPOF, and EMOF are shown in Figure 5-8. Metrics by unit type are shown in Table 5-35.

Figure 5-8 Equivalent outage and availability factors: 2007 to 2024

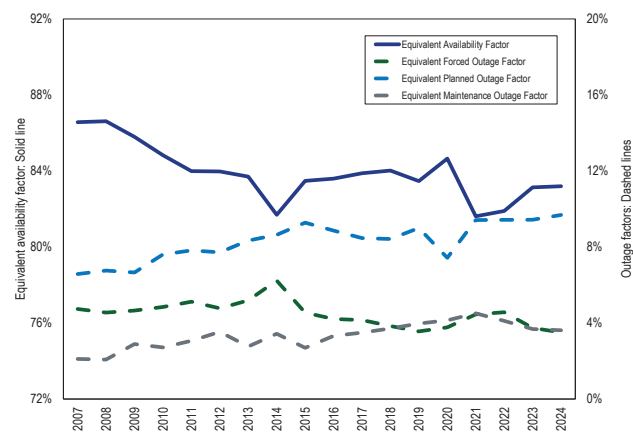


Table 5-35 EFOF, EPOF, EMOF and EAF by unit type: 2007 to 2024

	Coal				Combined Cycle				Combustion Turbine				Diesel			
	EFOF	EPOF	EMOF	EAF	EFOF	EPOF	EMOF	EAF	EFOF	EPOF	EMOF	EAF	EFOF	EPOF	EMOF	EAF
2007	7%	8%	3%	81%	2%	6%	2%	90%	5%	3%	3%	90%	10%	1%	2%	87%
2008	7%	7%	2%	83%	2%	6%	2%	90%	3%	5%	2%	90%	9%	1%	1%	88%
2009	7%	8%	4%	81%	3%	7%	3%	87%	2%	3%	3%	93%	7%	1%	1%	92%
2010	8%	9%	4%	78%	3%	9%	2%	86%	2%	3%	2%	93%	5%	0%	1%	94%
2011	8%	9%	5%	78%	3%	9%	2%	86%	2%	4%	2%	92%	3%	0%	2%	95%
2012	8%	9%	6%	77%	3%	8%	2%	87%	3%	3%	2%	92%	4%	1%	2%	93%
2013	9%	11%	5%	76%	2%	9%	2%	87%	5%	5%	1%	89%	6%	0%	1%	92%
2014	10%	10%	5%	75%	2%	10%	3%	85%	7%	4%	2%	87%	14%	0%	2%	83%
2015	8%	11%	4%	78%	2%	11%	2%	85%	3%	5%	2%	90%	8%	0%	3%	89%
2016	8%	10%	6%	77%	3%	10%	2%	85%	2%	6%	2%	90%	5%	0%	3%	92%
2017	9%	11%	7%	73%	2%	10%	2%	86%	1%	6%	2%	91%	6%	0%	2%	92%
2018	9%	12%	7%	73%	1%	9%	1%	88%	2%	5%	2%	91%	6%	1%	3%	89%
2019	8%	11%	8%	74%	2%	11%	2%	85%	2%	7%	2%	90%	7%	1%	3%	89%
2020	5%	10%	9%	76%	4%	8%	2%	87%	2%	6%	2%	90%	7%	0%	3%	90%
2021	8%	15%	9%	67%	3%	10%	2%	85%	3%	6%	3%	88%	9%	0%	4%	86%
2022	9%	14%	9%	68%	3%	10%	2%	85%	3%	7%	2%	88%	11%	0%	4%	84%
2023	8%	14%	7%	72%	3%	12%	2%	83%	2%	7%	2%	89%	12%	0%	4%	84%
2024	7%	14%	8%	71%	3%	11%	1%	84%	3%	6%	2%	89%	9%	1%	2%	88%

	Hydroelectric				Nuclear				Other				Total			
	EFOF	EPOF	EMOF	EAF	EFOF	EPOF	EMOF	EAF	EFOF	EPOF	EMOF	EAF	EFOF	EPOF	EMOF	EAF
2007	1%	7%	1%	90%	1%	5%	0%	93%	5%	7%	3%	84%	5%	7%	2%	87%
2008	1%	8%	2%	88%	2%	5%	1%	92%	4%	11%	3%	81%	5%	7%	2%	87%
2009	2%	9%	2%	87%	4%	5%	1%	90%	3%	8%	5%	84%	5%	7%	3%	86%
2010	1%	8%	2%	89%	2%	6%	0%	92%	4%	11%	4%	82%	5%	8%	3%	85%
2011	2%	12%	2%	84%	3%	5%	1%	91%	5%	11%	3%	81%	5%	8%	3%	84%
2012	3%	6%	2%	89%	2%	6%	1%	91%	5%	13%	4%	79%	5%	8%	4%	84%
2013	2%	8%	2%	87%	1%	6%	1%	93%	6%	11%	3%	79%	5%	8%	3%	84%
2014	3%	10%	3%	85%	2%	5%	1%	92%	7%	17%	5%	72%	6%	9%	3%	82%
2015	4%	10%	2%	85%	1%	5%	1%	92%	6%	18%	4%	72%	5%	9%	3%	83%
2016	3%	8%	3%	86%	2%	5%	1%	92%	5%	17%	5%	74%	4%	9%	3%	84%
2017	2%	6%	3%	89%	0%	5%	1%	94%	5%	10%	6%	79%	4%	8%	3%	84%
2018	2%	8%	3%	87%	1%	5%	1%	94%	4%	9%	9%	78%	4%	8%	4%	84%
2019	1%	7%	4%	88%	1%	5%	1%	93%	4%	14%	7%	75%	4%	9%	4%	83%
2020	4%	7%	3%	86%	1%	5%	1%	93%	9%	8%	5%	77%	4%	7%	4%	85%
2021	8%	8%	3%	81%	1%	5%	1%	93%	7%	9%	6%	78%	4%	9%	5%	82%
2022	2%	9%	3%	86%	1%	5%	1%	93%	6%	10%	6%	78%	5%	9%	4%	82%
2023	3%	15%	4%	78%	1%	4%	2%	93%	5%	9%	7%	79%	4%	9%	4%	83%
2024	3%	16%	4%	76%	1%	5%	2%	92%	5%	11%	3%	81%	4%	10%	4%	83%

## Generator Outage Rates

The most fundamental forced outage rate metric is the equivalent demand forced outage rate (EFORD). EFORD is a measure of the probability that a generating unit will fail, either partially or totally, to perform when it is needed to operate. EFORD measures the forced outage rate during periods of demand, and does not include planned or maintenance outages. A period of demand is a period during which a generator is running or needed to run. EFORD calculations use historical performance data, including equivalent forced outage hours, service hours, average forced outage duration, average run time, average time between unit starts, available hours and period hours.<sup>198</sup> The EFORD metric includes all forced outages, regardless of the reason for those outages.

The average PJM EFORD in 2024 was 5.2 percent, a decrease from 5.5 percent in 2023. Figure 5-9 shows the average EFORD since 1999 for all units in PJM.<sup>199</sup>

<sup>198</sup> Equivalent forced outage hours are the sum of all forced outage hours in which a generating unit is fully inoperable and all partial forced outage hours in which a generating unit is partially inoperable, prorated to full hours.

<sup>199</sup> The universe of units in PJM changed as the PJM footprint expanded and as units retired from and entered PJM markets. See the 2024 State of the Market Report for PJM, Appendix A: "PJM Overview" for details.

Figure 5-9 Equivalent demand forced outage rates (EFORd): 1999 to 2024

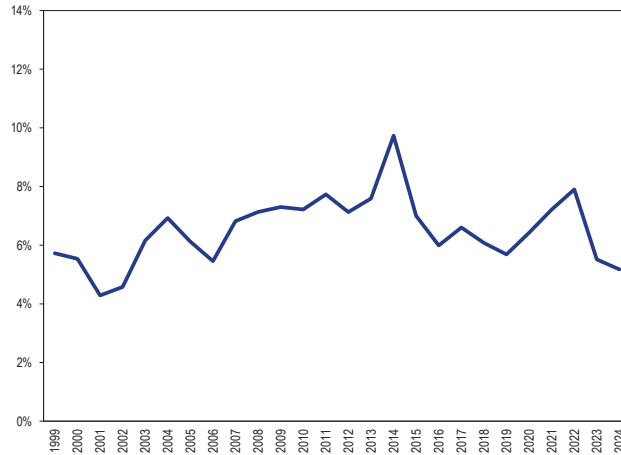


Table 5-36 shows the class average EFORd by unit type.

Table 5-36 EFORd by unit type: 2007 to 2024

	2007	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
Coal	8.3%	8.6%	8.5%	9.8%	10.9%	10.5%	11.1%	12.9%	9.7%	9.7%	11.8%	11.4%	10.7%	8.7%	11.8%	12.9%	11.5%	9.4%
Combined Cycle	4.1%	4.3%	5.2%	4.3%	3.5%	3.5%	2.1%	4.0%	2.3%	3.4%	2.8%	1.9%	2.7%	4.2%	3.5%	4.6%	3.5%	3.5%
Combustion Turbine	12.1%	12.1%	10.0%	10.1%	8.7%	7.9%	10.9%	16.7%	9.0%	5.5%	5.3%	6.3%	5.5%	4.5%	5.5%	8.9%	4.9%	6.1%
Diesel	12.0%	10.5%	9.5%	6.4%	9.3%	4.9%	6.7%	15.3%	9.1%	6.9%	6.9%	6.8%	7.7%	7.8%	11.9%	14.5%	14.0%	12.1%
Hydroelectric	2.0%	2.0%	3.3%	1.2%	2.8%	4.5%	3.7%	4.0%	5.5%	3.8%	3.1%	3.2%	1.9%	5.4%	10.6%	3.3%	4.6%	4.5%
Nuclear	1.4%	2.0%	4.3%	2.6%	2.9%	1.8%	1.0%	1.8%	1.5%	1.8%	0.5%	0.8%	0.6%	1.4%	1.1%	1.2%	0.9%	0.9%
Other	9.4%	9.8%	8.4%	7.4%	9.7%	8.7%	10.9%	13.3%	13.0%	9.2%	14.0%	9.5%	9.7%	20.4%	18.3%	17.4%	6.3%	7.9%
Total	6.8%	7.1%	7.3%	7.2%	7.7%	7.1%	7.6%	9.7%	7.0%	6.0%	6.6%	6.1%	5.7%	6.4%	7.2%	7.9%	5.5%	5.2%

## EFORd vs EAF

EFORd is not an adequate measure of unit availability because EFORd measures only forced outages and does not account for planned or maintenance outages. Forced outage rates can be managed under the existing outage rules. A unit with significant planned and/or maintenance outages is considered to have identical reliability properties in capacity planning, transmission planning and in the sale of capacity in the capacity market.<sup>200</sup> The EAF (Equivalent Availability Factor), which reflects all forced, planned, and maintenance outages, is a more accurate measure of the capacity actually available to meet load.

200 OATT, Attachment DD (Reliability Pricing Model) § 10A (d).

Table 5-37 shows the differences between EFORD and EAF by unit type.

**Table 5-37 EFORD and EAF by unit type: 2012 to 2024**

	Unit Types															
	Coal		Combined Cycle		Combustion Turbine		Diesel		Hydroelectric		Nuclear		Other		All	
	EFORD	1-EAF	EFORD	1-EAF	EFORD	1-EAF	EFORD	1-EAF	EFORD	1-EAF	EFORD	1-EAF	EFORD	1-EAF	EFORD	1-EAF
2012	10.5%	22.9%	3.5%	13.2%	7.9%	7.9%	4.9%	7.1%	4.5%	10.9%	1.8%	8.9%	8.7%	21.2%	7.1%	16.0%
2013	11.1%	23.6%	2.1%	13.1%	10.9%	11.4%	6.7%	7.8%	3.7%	12.6%	1.0%	7.2%	10.9%	20.5%	7.6%	16.3%
2014	12.9%	25.4%	4.0%	15.0%	16.7%	12.7%	15.3%	16.7%	4.0%	15.4%	1.8%	8.0%	13.3%	28.4%	9.7%	18.3%
2015	9.7%	22.5%	2.3%	14.5%	9.0%	9.7%	9.1%	10.9%	5.5%	15.4%	1.5%	7.9%	13.0%	28.4%	7.0%	16.5%
2016	9.7%	23.2%	3.4%	14.7%	5.5%	10.4%	6.9%	8.2%	3.8%	13.8%	1.8%	8.2%	9.2%	25.8%	6.0%	16.4%
2017	11.8%	26.8%	2.8%	13.8%	5.3%	9.3%	6.9%	8.4%	3.1%	11.2%	0.5%	6.3%	14.0%	20.8%	6.6%	16.1%
2018	11.4%	27.3%	1.9%	12.1%	6.3%	9.1%	6.8%	10.6%	3.2%	13.4%	0.8%	6.0%	9.5%	21.5%	6.1%	16.0%
2019	10.7%	26.2%	2.7%	14.7%	5.5%	10.4%	7.7%	11.1%	1.9%	12.4%	0.6%	6.8%	9.7%	24.9%	5.7%	16.5%
2020	8.7%	24.1%	4.2%	13.3%	4.5%	10.1%	7.8%	9.8%	5.4%	13.8%	1.4%	6.8%	20.4%	23.0%	6.4%	15.3%
2021	11.8%	32.5%	3.5%	14.6%	5.5%	12.0%	11.9%	13.7%	10.6%	19.1%	1.1%	6.7%	18.3%	22.3%	7.2%	18.4%
2022	12.9%	31.9%	4.6%	15.4%	8.9%	12.2%	14.5%	15.5%	3.3%	13.6%	1.2%	7.4%	17.4%	22.2%	7.9%	18.1%
2023	11.5%	28.4%	3.5%	16.7%	4.9%	11.0%	14.0%	16.0%	4.6%	21.6%	0.9%	6.5%	6.3%	20.8%	5.5%	16.9%
2024	9.4%	28.9%	3.5%	15.5%	6.1%	11.1%	12.1%	12.3%	4.5%	23.8%	0.9%	7.6%	7.9%	19.1%	5.2%	16.8%
Average	10.9%	26.4%	3.2%	14.4%	7.5%	10.6%	9.6%	11.4%	4.5%	15.2%	1.2%	7.3%	12.2%	23.0%	6.8%	16.7%

## Outage Analysis

The MMU analyzed the causes of outages for the PJM system. The metric used was lost generation, which is the product of the duration of the outage and the size of the outage reduction. Lost generation can be converted into lost system equivalent availability.<sup>201</sup> On a system wide basis, the resultant lost equivalent availability from forced outages is equal to the equivalent forced outage factor (EFOF), the resultant lost equivalent availability from maintenance outages is equal to the equivalent maintenance outage factor (EMOF), and the resultant lost equivalent availability from planned outages is equal to the equivalent planned outage factor (EPOF).

The PJM EFOF was 3.5 percent in 2024. Table 5-38 shows the causes of EFOF by unit type. Forced outages for boiler tube leaks, 14.1 percent of the system EFOF, were the largest single contributor to average system EFOF across all unit types.

**Table 5-38 Contribution to PJM EFOF by unit type by cause: 2024**

	Combined		Combustion		Hydroelectric	Nuclear	Other	System
	Coal	Cycle	Turbine	Diesel				
Boiler Tube Leaks	26.1%	4.1%	0.0%	0.0%	0.0%	0.0%	10.2%	14.1%
Unit Testing	3.9%	5.9%	14.5%	26.9%	59.4%	19.9%	20.8%	12.0%
Generator	6.0%	23.2%	1.8%	1.7%	4.3%	0.0%	0.0%	6.8%
Boiler Air and Gas Systems	11.4%	0.8%	0.0%	0.0%	0.0%	0.0%	5.7%	6.1%
Electrical	4.5%	4.4%	15.0%	24.4%	0.1%	0.9%	1.3%	5.4%
Turbine	0.0%	6.8%	19.1%	0.0%	5.7%	0.0%	0.0%	4.2%
Miscellaneous (Generator)	4.5%	4.8%	1.4%	11.9%	0.8%	3.7%	1.3%	3.6%
Controls	2.2%	4.0%	0.3%	5.5%	0.1%	1.7%	9.4%	2.8%
Boiler Tube Fireside Slagging or Fouling	5.3%	0.0%	0.0%	0.0%	0.0%	0.0%	0.7%	2.6%
Miscellaneous (Steam Turbine)	2.3%	1.4%	0.0%	0.0%	0.0%	6.2%	8.9%	2.5%
Miscellaneous (Gas Turbine)	0.0%	4.0%	13.3%	0.0%	0.0%	0.0%	0.0%	2.5%
Feedwater System	3.5%	0.8%	0.0%	0.0%	0.0%	9.4%	0.6%	2.4%
Boiler Piping System	3.5%	3.4%	0.0%	0.0%	0.0%	0.0%	0.3%	2.2%
Auxiliary Systems	1.6%	2.1%	4.7%	0.0%	0.1%	0.0%	3.0%	2.1%
Condensing System	1.1%	0.3%	0.0%	0.0%	0.0%	6.5%	10.3%	2.0%
Circulating Water Systems	2.7%	3.3%	0.0%	0.0%	0.0%	2.7%	0.6%	2.0%
Boiler Fuel Supply from Bunkers to Boiler	3.3%	0.4%	0.0%	0.0%	0.0%	0.0%	1.7%	1.8%
Fuel Quality	0.8%	0.0%	7.5%	2.4%	0.0%	0.0%	1.7%	1.7%
Condensate System	1.7%	1.7%	0.0%	0.0%	0.0%	0.4%	3.4%	1.4%
All Other Causes	15.6%	28.5%	22.5%	27.1%	29.5%	48.8%	20.1%	21.8%
Total	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

<sup>201</sup> For any unit, lost generation can be converted to lost equivalent availability by dividing lost generation by the product of the generating units' capacity and period hours. This can also be done on a system basis.



The PJM EMOF was 3.6 percent in 2024. Table 5-39 shows the causes of EMOF by unit type. Maintenance outages for boiler air and gas systems, 8.1 percent of the system EMOF, were the largest single contributor to average system EMOF across all unit types, although electrical issues were the largest contributors to EMOF for combustion turbines.

**Table 5-39 Contribution to EMOF by unit type by cause: 2024**

	Combined		Combustion		Hydroelectric	Nuclear	Other	System
	Coal	Cycle	Turbine	Diesel				
Boiler Air and Gas Systems	12.9%	0.0%	0.0%	0.0%	0.0%	0.0%	4.6%	8.1%
Miscellaneous (Reactor)	0.0%	0.0%	0.0%	0.0%	0.0%	66.2%	0.0%	8.0%
Intermediate Pressure Turbine	12.9%	1.2%	0.0%	0.0%	0.0%	0.0%	0.0%	7.9%
Boiler Tube Leaks	6.3%	9.0%	0.0%	0.0%	0.0%	0.0%	33.7%	6.4%
Electrical	5.9%	2.4%	11.4%	2.3%	23.8%	1.4%	0.1%	6.2%
Miscellaneous (Balance of Plant)	6.4%	7.0%	8.2%	0.2%	0.3%	0.0%	7.0%	5.5%
Boiler Piping System	7.3%	13.5%	0.0%	0.0%	0.0%	0.0%	0.0%	5.4%
Miscellaneous (Gas Turbine)	0.0%	10.2%	29.7%	0.0%	0.0%	0.0%	0.0%	3.4%
Boiler Overhaul and Inspections	5.0%	0.0%	0.0%	0.0%	0.0%	0.0%	5.1%	3.3%
Turbine	0.0%	2.9%	2.6%	0.0%	42.2%	0.0%	0.0%	2.8%
Circulating Water Systems	4.1%	0.0%	0.0%	0.0%	0.0%	1.2%	0.7%	2.7%
Auxiliary Systems	2.5%	1.5%	11.0%	0.2%	0.0%	0.0%	1.7%	2.7%
Cooling System	3.5%	6.0%	0.0%	0.3%	0.1%	0.0%	0.0%	2.6%
Wet Scrubbers	3.9%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	2.4%
Miscellaneous (Steam Turbine)	3.3%	2.8%	0.0%	0.0%	0.0%	0.4%	2.1%	2.4%
Boiler Internals and Structures	3.3%	2.7%	0.0%	0.0%	0.0%	0.0%	2.6%	2.4%
Boiler Fuel Supply from Bunkers to Boiler	3.2%	0.1%	0.0%	0.0%	0.0%	0.0%	0.1%	2.0%
Valves	1.8%	7.6%	0.0%	0.0%	0.0%	1.5%	0.4%	1.9%
Boiler Tube Fireside Slagging or Fouling	2.6%	0.0%	0.0%	0.0%	0.0%	0.0%	0.7%	1.6%
All Other Causes	15.1%	33.2%	37.0%	96.9%	33.5%	29.3%	41.1%	22.7%
Total	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

PJM EPOF was 9.7 percent in 2024. Table 5-40 shows the causes of EPOF by unit type. Planned outages for miscellaneous balance of plant issues, 23.2 percent of the system EPOF, were the largest single contributor to average system EPOF across all unit types, although miscellaneous gas turbine issues were the largest contributors to EPOF for combustion turbines.


**Table 5-40 Contribution to EPOF by unit type and cause: 2024**

	Combined		Combustion		Hydroelectric	Nuclear	Other	System
	Coal	Cycle	Turbine	Diesel				
Miscellaneous (Balance of Plant)	37.8%	26.3%	13.2%	2.2%	0.0%	0.0%	28.0%	23.2%
Miscellaneous (Gas Turbine)	0.0%	48.6%	56.4%	0.0%	0.0%	0.0%	0.0%	17.5%
Core/Fuel	0.0%	0.0%	0.0%	0.0%	0.0%	98.3%	0.0%	12.8%
Boiler Overhaul and Inspections	15.1%	4.8%	0.0%	0.0%	0.0%	0.0%	32.2%	8.8%
Miscellaneous (Steam Turbine)	5.3%	11.3%	0.0%	0.0%	0.0%	0.0%	0.5%	4.4%
Miscellaneous	0.0%	0.0%	0.0%	0.0%	45.3%	0.3%	0.0%	4.2%
Low Pressure Turbine	8.0%	0.9%	0.0%	0.0%	0.0%	0.0%	0.0%	3.1%
Miscellaneous (Generator)	3.9%	0.1%	3.4%	4.7%	10.2%	0.0%	0.0%	2.8%
Generator	0.0%	0.8%	2.1%	0.3%	18.8%	0.0%	1.4%	2.3%
Wet Scrubbers	6.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	2.2%
Valves	4.2%	0.3%	0.0%	0.0%	0.0%	0.0%	3.9%	1.9%
Turbine	0.0%	2.0%	0.4%	0.0%	12.6%	0.0%	0.0%	1.7%
Miscellaneous (Boiler)	0.1%	0.0%	0.0%	0.0%	0.0%	0.0%	19.9%	1.4%
Boiler Air and Gas Systems	2.5%	0.0%	0.0%	0.0%	0.0%	0.0%	4.9%	1.2%
NOx Reduction Systems	3.3%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	1.2%
Stack Emission	3.3%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	1.2%
Boiler Internals and Structures	2.5%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.9%
Boiler Control Systems	2.3%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.8%
Boiler Piping System	1.2%	0.6%	0.0%	0.0%	0.0%	0.0%	3.4%	0.8%
All Other Causes	4.5%	4.1%	24.5%	92.8%	13.1%	1.4%	5.8%	7.4%
Total	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

## Performance by Month

Monthly values for EAF, EFOF, EMOF and EPOF are shown in Figure 5-10.

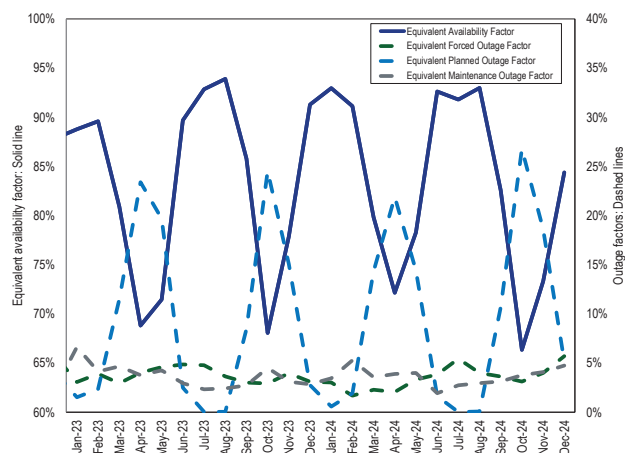**Figure 5-10 Monthly generator performance factors: 2023 through 2024**



## Generator Testing Issues

PJM Manual 21: Rules and Procedures for Determination of Generating Capability describes how generators are to be tested. PJM's testing requirements are not well designed, permit excessive generator discretion, and do not require adequate winter testing.

Net Capability Verification Testing data, meant to demonstrate that a unit has the ICAP claimed, are submitted for the summer and winter testing periods.<sup>202</sup> These periods run from the start of June until September and the start of December until March. If a unit is on a planned or maintenance outage for the entire testing period, it is expected to perform an out of period test once the outage ends. Out of period tests can be performed from the start of September until December for summer tests and from the start of March until June for winter tests. Hydroelectric generators only perform summer tests.<sup>203</sup> Wind and solar resources do not perform verification tests to prove capability.<sup>204</sup>

While data must be submitted for the winter testing period, PJM permits the use of summer test data adjusted for ambient winter conditions in lieu of actual winter test data. The MMU recommends that PJM require actual

seasonal tests as part of the Summer/Winter Capability Testing rules and that the ambient conditions under which the tests are performed be defined.

Results, including failed test results, must be submitted to PJM via eGADS. Failing to submit data before the deadline can result in a Data Submission Charge of \$500 per day late.<sup>205</sup>

Failure to demonstrate the claimed net capability results in a forced outage or derating effective from the beginning of the testing period and lasting until either a reduced claimed ICAP is in effect, the beginning of the next testing period, or, except for failures due to environmental constraints or a lack of resources, a successful out of period test.

Failed test results must be accompanied by a derating or outage in eGADS and in eDART. Failure to report failed tests and to derate the unit can result in a Generation Resource Rating Test Failure Charge, equal to the Daily Deficiency Rate multiplied by: the daily ICAP shortfall multiplied by one minus the effective EFORD for unlimited resources; the UCAP for the daily ICAP shortfall, for limited duration resources and combination resources.<sup>206</sup> Nine resources were assessed for generation resource rating test failure charges in 2024.

The Daily Deficiency Rate in dollars per MW-day is equal to the weighted average capacity resource clearing price from the RPM auction that resulted in the resource's commitment plus the greater of 20 percent of that clearing price or 20 dollars per MW-day.<sup>207</sup>

While generation owners are required to report failed tests and to derate their unit in eGADS, owners can perform an unlimited number of tests before submitting a successful result. The MMU recommends that PJM limit the number of tests that can be made before submitting final results and that the data be collected by power meter instead of being submitted in eGADS. The MMU recommends that PJM select the time and day for testing a unit, not the unit owner, and that this testing not be communicated in advance. Instead, a unit would be tested by how well it follows its dispatch signal. Under the current testing rules, generation owners have

<sup>202</sup> PJM. "PJM Manual 18: PJM Capacity Market," § 8.5 Summer/Winter Capability Testing, Rev. 59 (June 27, 2024).

<sup>203</sup> PJM. "PJM Manual 18: PJM Capacity Market," § 8.5 Summer/Winter Capability Testing, Rev. 59 (June 27, 2024).

<sup>204</sup> PJM. "PJM Manual 18: PJM Capacity Market," Appendix B: Calculating Capacity Values for Wind and Solar Capacity Resources, Rev. 59 (June 27, 2024).

<sup>205</sup> "Reliability Assurance Agreement Among Load Serving Entities in the PJM Region," Schedule 12, Section A.

<sup>206</sup> PJM. "PJM Manual 18: PJM Capacity Market," § 9.1.5 Generation Resource Rating Test Failure Charge, Rev. 59 (June 27, 2024).

<sup>207</sup> OATT, Attachment DD (Reliability Pricing Model) § 7.

the opportunity to perform tests during more favorable conditions to achieve better performance.

Generator output is also assessed during Performance Assessment Intervals (PAIs), which occur when PJM declares an emergency action as listed in Manual 18, Section 8.4A. If a unit fails to perform as expected, generators may incur a Non-Performance Charge, which is equal to the performance shortfall multiplied by the Non-Performance Charge Rate.<sup>208</sup> In 2022, PAIs occurred on June 13, June 14, June 15, December 23, and December 24. For the December 23 and 24 PAIs, PJM total nonperformance charges were approximately \$1.796 billion, reduced to \$1.226 billion in a settlement agreement.<sup>209</sup> There were no such charges assessed in 2023 or 2024.

For each day of a delivery year, generators are required to meet their daily unforced capacity commitments. Generation owners have the option to buy replacement capacity that satisfies the same locational requirements.<sup>210</sup>

<sup>211</sup> Failure to meet this commitment can result in a Daily Capacity Resource Deficiency Charge.<sup>212 213</sup> This charge is equal to the Daily Deficiency Rate multiplied by the difference between a resource's daily commitments and daily position. Thirty resources were assessed for deficiency charges in 2021, 64 resources were assessed for deficiency charges in 2022, 175 resources were assessed for deficiency charges in 2023, and 434 resources were assessed for deficiency charges in 2024.

## Changing Outage Types

Capacity resource owners have an incentive to minimize their forced outages to maximize capacity revenue and minimize penalties. Generation owners have had the ability to change the designation of the outage type after the initial submission to the eGADS database since 2014. Table 5-41 shows that from 2014 through 2024, of all the changes in outage status, 96.2 percent of the outages and 86.6 percent of the outage MWh were changed from either planned or maintenance to forced outage status. Of those changes to forced outage status, 41.4 percent of the outages and 84.1 percent of the MWh were for coal and hydro plants.

<sup>208</sup> OATT, Attachment DD (Reliability Pricing Model) § 10A.

<sup>209</sup> See Settlement Agreement, Docket No. ER23-2975-000 (September 29, 2023), which can be accessed at: <<https://pjm.com/-/media/documents/ferc/filings/2023/20230929-er23-2975-000.ashx>>.

<sup>210</sup> "PJM Manual 21: Rules and Procedures for Determination of Generating Capability," § 1.3.6 Impacts of Test Results, Rev. 19 (June 27, 2024).

<sup>211</sup> OATT, Attachment DD (Reliability Pricing Model) § 7 (a).

<sup>212</sup> PJM, "PJM Manual 18: PJM Capacity Market," § 8.2 RPM Commitment Compliance, Rev. 59 (June 27, 2024).

<sup>213</sup> OATT, Attachment DD (Reliability Pricing Model) § 8.

Table 5-41 Changed outages by unit type: 2014 through 2024<sup>214</sup>

Unit Type	Year	Forced to Maintenance		Forced to Planned		Maintenance or Planned to Forced	
		No.	MWh	No.	MWh	No.	MWh
		Outages		Outages		Outages	
Coal	2014	5	270,049	0	NA	1	2,794
	2015	0	NA	0	NA	25	876,920
	2016	1	271,304	0	NA	74	1,983,852
	2017	2	151,085	0	NA	48	1,246,484
	2018	1	1,520	0	NA	30	837,286
	2019	2	71,234	0	NA	43	618,382
	2020	1	8,587	0	NA	12	170,807
	2021	0	NA	0	NA	0	NA
	2022	0	NA	0	NA	0	NA
	2023	1	13,211	0	NA	0	NA
	2024	1	18,908	0	NA	0	NA
	Total	14	805,898	0	NA	233	5,736,526
Combined Cycle	2014	1	3,803	2	1,105	1	28,067
	2015	2	24,685	0	NA	3	3,330
	2016	0	NA	1	65,664	24	145,432
	2017	3	5,786	0	NA	19	400,606
	2018	1	416	0	NA	16	52,214
	2019	0	NA	0	NA	11	94,756
	2020	0	NA	0	NA	13	19,037
	2021	0	NA	7	303,061	0	NA
	2022	0	NA	1	3,817	2	208
	2023	0	NA	0	NA	0	NA
	2024	3	2,625	0	NA	0	NA
	Total	10	37,315	11	373,648	89	743,650
Combustion Turbine	2014	9	26,990	3	15,027	22	25,865
	2015	0	NA	0	NA	13	27,567
	2016	0	NA	0	NA	48	55,233
	2017	0	NA	0	NA	19	29,586
	2018	0	NA	2	41,737	25	24,433
	2019	0	NA	1	340	28	37,483
	2020	0	NA	0	NA	27	41,312
	2021	0	NA	0	NA	5	25,094
	2022	0	NA	0	NA	5	25,497
	2023	0	NA	0	NA	4	270,336
	2024	0	NA	0	NA	3	174,191
	Total	9	26,990	6	57,104	199	736,597
Diesel	2014	0	NA	0	NA	77	4,550
	2015	15	47	0	NA	182	5,439
	2016	0	NA	0	NA	217	5,579
	2017	2	145	0	NA	175	5,883
	2018	2	15	0	NA	235	4,414
	2019	0	NA	0	NA	238	23,066
	2020	2	311	0	NA	163	6,113
	2021	3	137	0	NA	3	27,059
	2022	4	5,492	0	NA	10	305
	2023	0	NA	0	NA	0	NA
	2024	0	NA	0	NA	0	NA
	Total	28	6,147	0	NA	1,300	82,408
Hydroelectric	2014	1	3	0	NA	124	1,383,319
	2015	1	162	0	NA	152	952,608
	2016	4	780	0	NA	315	1,433,851
	2017	2	52,080	0	NA	123	598,766
	2018	4	82,395	0	NA	72	405,549
	2019	0	NA	0	NA	34	148,629
	2020	0	NA	0	NA	59	281,976
	2021	0	NA	0	NA	33	263,525
	2022	0	NA	0	NA	1	4,887
	2023	0	NA	0	NA	9	196,512
	2024	0	NA	0	NA	0	NA
	Total	12	135,420	0	NA	922	5,669,622
Nuclear	2014	0	NA	1	177,618	0	NA
	2015	0	NA	1	573	0	NA
	2016	0	NA	0	NA	0	NA
	2017	0	NA	0	NA	0	NA
	2018	0	NA	0	NA	0	NA
	2019	0	NA	0	NA	0	NA
	2020	0	NA	0	NA	2	22,903
	2021	0	NA	0	NA	0	NA
	2022	0	NA	0	NA	0	NA
	2023	0	NA	0	NA	0	NA
	2024	0	NA	2	168,615	0	NA
	Total	0	NA	4	346,807	2	22,903

Unit Type	Year	Forced to Maintenance		Forced to Planned		Maintenance or Planned to Forced	
		No.	MWh	No.	MWh	No.	MWh
		Outages		Outages		Outages	
Other	2014	5	103,981	0	NA	1	866
	2015	0	NA	0	NA	2	176,599
	2016	1	11,680	0	NA	18	159,781
	2017	2	231	1	28,636	12	85,071
	2018	3	7,555	0	NA	1	268
	2019	1	128,664	1	8,658	9	61,297
	2020	0	NA	0	NA	4	82,250
	2021	0	NA	0	NA	0	NA
	2022	0	NA	0	NA	0	NA
	2023	2	17,023	0	NA	0	NA
	2024	0	NA	0	NA	0	NA
	Total	14	269,134	2	37,294	47	566,132
All Units	2014	21	404,826	6	193,750	226	1,445,461
	2015	18	24,894	1	573	377	2,042,463
	2016	6	283,764	1	65,664	696	3,783,728
	2017	11	209,328	1	28,636	396	2,366,397
	2018	11	91,901	2	41,737	379	1,324,165
	2019	3	199,897	2	8,998	363	983,612
	2020	3	8,898	0	NA	280	624,398
	2021	3	137	7	303,061	41	315,679
	2022	4	5,492	1	3,817	18	30,896
	2023	3	30,234	0	NA	13	466,848
	2024	4	21,533	2	168,615	3	174,191
	Total	87	1,280,903	23	814,853	2792	13,557,838

<sup>214</sup> Year describes the year in which the outage started and not the year in which the outage designation was changed.

## Demand Response

Markets require both a supply side and a demand side to function effectively. The demand side of wholesale electricity markets is underdeveloped. Wholesale power markets will be more efficient when the demand side of the electricity market becomes fully functional without depending on special programs as a proxy for full participation.

### Overview

- **Demand Response Activity.** Demand response activity includes economic demand response (economic resources), emergency and pre-emergency demand response (demand resources), synchronized reserves and regulation. Economic demand response participates in the energy market. Emergency and pre-emergency demand response participates in the capacity market and energy market.<sup>1</sup> Demand response resources participate in the synchronized reserve market. Demand response resources participate in the regulation market.

Total demand response revenue decreased by \$18.1 million, 10.6 percent, from \$170.8 million in 2023 to \$152.7 million in 2024, primarily due to a decrease in capacity market prices and revenue. Emergency demand response revenue accounted for 76.4 percent of all demand response revenue, economic demand response for 7.2 percent, demand response in the synchronized reserve market for 7.2 percent and demand response in the regulation market for 9.1 percent.

Total emergency demand response revenue decreased by \$37.0 million, 24.1 percent, from \$153.7 million in 2023 to \$116.6 million in 2024.<sup>2</sup> This decrease consisted entirely of capacity market revenue.

Economic demand response revenue increased by \$7.5 million, 209.0 percent, from \$3.6 million in 2023 to \$11.0 million in 2024.<sup>3</sup> Demand response revenue in the synchronized reserve market increased by \$4.8 million, 76.7 percent, from \$6.2 million in 2023 to \$11.0 million in 2024. Demand

response revenue in the regulation market increased by \$6.7 million, 91.3 percent, from \$7.3 million in 2023 to \$14.0 million in 2024.

- **Demand Response Energy Payments are Uplift.** Energy payments to emergency and economic demand response resources are uplift. LMP does not cover energy payments although emergency and economic demand response can and does set LMP. Energy payments to emergency demand resources are paid by PJM market participants in proportion to their net purchases in the real-time market. Energy payments to economic demand resources are paid by real-time exports from PJM and real-time loads in each zone for which the load-weighted, average real-time LMP for the hour during which the reduction occurred is greater than or equal to the net benefits test price for that month.<sup>4</sup>
- **Demand Response Market Concentration.** The ownership of economic load response resources was highly concentrated in 2023 and 2024. The HHI for economic resource reductions decreased by 510 points from 9241 in 2023 to 8731 in 2024. The ownership of emergency load response resources is highly concentrated. The HHI for emergency load response committed MW was 2295 for the 2023/2024 Delivery Year. In the 2023/2024 Delivery Year, the four largest CSPs owned 85.6 percent of all committed demand response UCAP MW. The HHI for emergency demand response committed MW is 2387 for the 2024/2025 Delivery Year. In the 2024/2025 Delivery Year, the four largest CSPs own 88.5 percent of all committed demand response UCAP MW.
- **Limited Locational Dispatch of Demand Resources.** With full implementation of the Capacity Performance rules in the capacity market in the 2020/2021 Delivery Year, PJM should be able to individually dispatch any capacity performance resource, including demand resources. PJM cannot dispatch demand resources by node with the current rules because demand resources are not registered to a node. Aggregation rules allow a demand resource that incorporates many small End Use Customers to span an entire zone, which is inconsistent with nodal dispatch.

<sup>1</sup> Emergency demand response refers to both emergency and pre-emergency demand response. With the implementation of the Capacity Performance design, and prior to the July 30, 2023 FERC approved revisions to PJM's Tariff to eliminate the dispatch of demand response as a trigger for calling an emergency and for defining a Performance Assessment Interval (PAI), there is no functional difference between the emergency and pre-emergency demand response resource.

<sup>2</sup> The total credits and MWh numbers for demand resources were downloaded as of January 16, 2025, and may change as a result of continued PJM billing updates.

<sup>3</sup> Economic credits are synonymous with revenue received for reductions under the economic load response program.

<sup>4</sup> "PJM Manual 28: Operating Agreement Accounting," § 11.2.2, Rev. 98 (Dec. 17, 2024).



- **Energy Efficiency.** Energy efficiency resources are not capacity resources in PJM. The total MW of energy efficiency resources paid increased by 30.9 percent, from 5,896.4 MW in the 2023/2024 Delivery Year to 7,716.0 MW in the 2024/2025 Delivery Year. In the 2024/2025 Delivery Year, although EE is not a capacity resource, the EE MW paid for the Delivery Year were equal to 5.0 percent of all actual cleared capacity MW.
- **Energy Efficiency Payments are a Subsidy and Uplift.** Payments from the buyers of capacity to energy efficiency providers are a subsidy and uplift. Energy efficiency is not a capacity resource and does not contribute to reliability.
- **Energy Efficiency Market Concentration.** The HHI for Energy Efficiency on an aggregate market basis shows that ownership is highly concentrated. The four largest companies typically own 90 percent or more of all paid Energy Efficiency MW. The HHI for Energy Efficiency resources also shows that ownership is highly concentrated for the 2024/2025 Delivery Year, with an HHI value of 5749. In the 2024/2025 Delivery Year, the four largest companies own 98.0 percent of all paid Energy Efficiency MW.

## Recommendations

- The MMU recommends that PJM report the response of demand capacity resources to dispatch by PJM as the actual change in load rather than simply the difference between the amount of capacity purchased by the customer and the actual metered load. The current approach significantly overstates the response to PJM dispatch. (Priority: High. First reported 2023. Status: Not adopted.)
- The MMU recommends that demand resources offering as supply in the capacity market be required to offer a guaranteed load drop (GLD) below their PLC to ensure that demand resources provide an identifiable MW resource to PJM when called. (Priority: High. First reported 2023. Status: Not adopted.)
- The MMU recommends, as an alternative to including demand resources as supply in the capacity market, that demand resources have the option to be on the demand side of the markets, that customers be able to avoid capacity and energy charges by not using capacity and energy at their discretion, that customer payments be determined only by metered load, and that PJM forecasts immediately incorporate the impacts of demand side behavior. (Priority: High. First reported 2014. Status: Not adopted.)
- The MMU recommends that the option to specify a minimum dispatch price (strike price) for demand resources be eliminated and that participating resources receive the hourly real-time LMP less any generation component of their retail rate.<sup>5</sup> (Priority: Medium. First reported 2010. Status: Not adopted.)
- The MMU recommends that the maximum offer for demand resources be the same as the maximum offer for generation resources and that the same cost verification rules applied to generation resources apply to demand resources. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that the demand resources be treated as economic resources, responding to economic price signals like other capacity resources. The MMU recommends that demand resources not be treated as emergency resources, not trigger a PJM emergency and not trigger a Performance Assessment Interval. The MMU recommends that demand resources be available for every hour of the year. (Priority: High. First reported 2012. Status: Partially adopted.)
- The MMU recommends that the Emergency Program Energy Only option be eliminated because the opportunity to receive the appropriate energy market incentive is already provided in the economic program. (Priority: Low. First reported 2010. Status: Not adopted.)
- The MMU recommends that, if demand resources remain in the capacity market, a daily energy market must offer requirement apply to demand resources, comparable to the rule applicable to generation capacity resources.<sup>6</sup> (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that demand resources be required to provide their nodal location, comparable to generation resources. (Priority: High. First reported 2011. Status: Not adopted.)

<sup>5</sup> See "Complaint and Motion to Consolidate of the Independent Market Monitor for PJM," Docket No. EL14-20-000 (January 28, 2014), "Comments of the Independent Market Monitor for PJM," Docket No. ER15-852-000 (February 13, 2015).

<sup>6</sup> See "Complaint and Motion to Consolidate of the Independent Market Monitor for PJM," Docket No. EL14-20-000 (January 27, 2014) at 1.

- The MMU recommends that PJM require nodal dispatch of demand resources with no advance notice required or, if nodal location is not required, subzonal dispatch of demand resources with no advance notice required. The MMU recommends that, if PJM continues to use subzones for any purpose, PJM clearly define the role of subzones in the dispatch of demand response. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM not remove any defined subzones and maintain a public record of all created and removed subzones. (Priority: Low. First reported 2016. Status: Not adopted.)
- The MMU recommends that PJM eliminate the measurement of compliance across zones within a compliance aggregation area (CAA). The multiple zone approach is less locational than the zonal and subzonal approach and creates larger mismatches between the locational need for the resources and the actual response. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that measurement and verification methods for demand resources be modified to reflect compliance more accurately. (Priority: Medium. First reported 2009. Status: Not adopted.)
- The MMU recommends that compliance rules be revised to include submittal of all necessary hourly load data, and that negative values be included when calculating event compliance across hours and registrations. (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM adopt the ISO-NE five-minute metering requirements in order to ensure that operators have the necessary information for reliability and that market payments to demand resources be calculated based on interval meter data at the site of the demand reductions.<sup>7</sup> (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends demand response event compliance be calculated on a five minute basis for all capacity performance resources and that the penalty structure reflect five minute compliance. (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends that load management testing be initiated by PJM with advance notice to CSPs identical to the actual lead time required in an emergency in order to accurately represent the conditions of an emergency event. (Priority: Low. First reported 2012. Status: Partially adopted.)
- The MMU recommends that shutdown cost be defined as the cost to curtail load for a given period that does not vary with the measured reduction or, for behind the meter generators, be the start cost defined in Manual 15 for generators. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that the Net Benefits Test be eliminated and that demand response resources be paid LMP less any generation component of the applicable retail rate. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that the tariff rules for demand response clarify that a resource and its CSP, if any, must notify PJM of material changes affecting the capability of the resource to perform as registered and must terminate or modify registrations that are no longer capable of responding to PJM dispatch directives at defined levels because load has been reduced or eliminated, as in the case of bankrupt and/or out of service facilities. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that there be only one demand response product in the capacity market, with an obligation to respond when called for any hour of the delivery year. (Priority: High. First reported 2011. Status: Partially adopted.<sup>8</sup>)
- The MMU recommends that the lead times for demand resources be shortened to 30 minutes with a one hour minimum dispatch for all resources. (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends setting the baseline for measuring capacity compliance under winter compliance at the customers' PLC, similar to GLD, to avoid double counting. (Priority: High. First reported 2010. Status: Partially adopted.)

<sup>7</sup> See ISO-NE Tariff, Section III, Market Rule 1, Appendix E1 and Appendix E2, "Demand Response," <[http://www.iso-ne.com/regulatory/tariff/sect\\_3/mr1\\_append-e.pdf](http://www.iso-ne.com/regulatory/tariff/sect_3/mr1_append-e.pdf)>. (Accessed October 17, 2017) ISO-NE requires that DR have an interval meter with five-minute data reported to the ISO and each behind the meter generator is required to have a separate interval meter. After June 1, 2017, demand response resources in ISO-NE must also be registered at a single node.

<sup>8</sup> PJM's Capacity Performance design requires resources to respond when called for any hour of the delivery year, but demand resources still have a limited mandatory compliance window.

- The MMU recommends the Relative Root Mean Squared Test be required for all demand resources with a CBL. (Priority: Low. First reported 2017. Status: Partially adopted.)
- The MMU recommends that the limits imposed on the pre-emergency and emergency demand response share of the synchronized reserve market be eliminated. (Priority: Medium. First reported 2018. Status: Adopted 2022.)
- The MMU recommends that 30 minute pre-emergency and emergency demand response be considered to be 30 minute reserves. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that energy efficiency resources (EE) not be included in the capacity market mechanism and that PJM should ensure that the impact of EE measures on the load forecast is incorporated immediately. (Priority: Medium. First reported 2018. Status: Adopted 2024.)<sup>9 10</sup>
- The MMU recommends that, if energy efficiency resources remain in the capacity market mechanism, PJM codify eligibility requirements to claim the property rights to energy efficiency installations in the tariff including a contract with the owner of every energy efficiency installation and that PJM institute a registration system to track claims to the property rights to energy efficiency installations and document installation periods of energy efficiency installations. (Priority: Medium. First reported 2022. Status: Not adopted.)
- The MMU recommends that demand reductions based entirely on behind the meter generation be capped at the lower of economic maximum or actual generation output. (Priority: High. First reported 2019. Status: Not adopted.)
- The MMU recommends that all demand resources register as Pre-Emergency Load Response and that the Emergency Load Response Program be eliminated. (Priority: High. First reported 2020. Status: Not adopted.)
- The MMU recommends that EDCs not be allowed to participate in markets as DER aggregators in addition to their EDC role. (Priority: High. First reported 2021. Status: Not adopted.)
- The MMU recommends that PJM include a 5.0 MW maximum size cap on DER aggregations. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends that PJM use a nodal approach for DER participation in PJM markets that excludes multinodal aggregation. (Priority: Medium. First reported 2022. Status: Partially adopted.)
- The MMU recommends that the Commission require PJM to include in OATT Attachment M the explicit statement that the Market Monitor's role includes the right to collect information from EDCs and DERA related to actions taken on the distribution system related to DERs. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends that PJM revise the requirements for reporting expected real time energy load reductions by CSPs to PJM to improve the accuracy and usefulness to PJM's system operators. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends that PJM define when operators can and should call on demand resources, given that a call on demand resources no longer triggers a PAI. The MMU recommends that PJM revise the performance requirements for demand resources to include an event specific measurement for dispatch occurring outside of Performance Assessment Events and penalties for nonperformance. (Priority: Medium. First reported 2023. Status: Not adopted.)

## Conclusion

A fully functional demand side of the electricity market means that End Use Customers or their designated intermediaries will have the ability to see real-time energy price signals in real time, will have the ability to react to real-time prices in real time and will have the ability to receive the direct benefits or costs of changes in real-time energy use. In addition, customers or their designated intermediaries will have the ability to see current capacity prices, will have the ability to react to capacity prices and will have the ability to receive the direct benefits or costs of changes in the demand for capacity in the same year in which demand for capacity changes. A functional demand side of these markets means that customers will have the ability to make decisions about levels of power consumption based both

<sup>9</sup> 189 FERC ¶ 61,095 (2024).

<sup>10</sup> Originally incorporated with auctions conducted in 2016 for the 2016/2017 Delivery Year and forward. The mechanics of the EE addback mechanism were modified beginning with the 2023/2024 Delivery Year.

on how customers value the power and on the actual cost of that power.

In the energy market, if there is to be a demand side program, demand resources should be paid the value of energy, which is LMP less any generation component of the applicable retail rate. There is no reason to have the net benefits test. The necessity for the net benefits test is an illustration of the illogical approach to demand side compensation embodied in paying full LMP to demand resources. The benefit of demand side resources is not that they suppress market prices, but that customers can choose not to consume at the current price of power, that individual customers benefit from their choices and that the choices of all customers are reflected in market prices. If customers face the market price, customers should have the ability to not purchase power and the market impact of that choice does not require a test for appropriateness.

If demand resources are to continue competing directly with generation capacity resources in the PJM Capacity Market, the product must be defined such that it can actually serve as a substitute for generation. This is a prerequisite to a functional market design. Demand resources do not have a must offer requirement into the day-ahead energy market, are able to offer above \$1,000 per MWh without providing a fuel cost policy, or any rationale for the offer. Demand resources do not have telemetry requirements similar to other Capacity Performance resources. Until July 30, 2023, including Winter Storm Elliott, PJM automatically, and inappropriately, triggered a PAI when demand resources were dispatched.

In order to be a substitute for generation, demand resources offering as supply in the capacity market should be required to offer a guaranteed load drop (GLD) below their PLC to ensure that demand resources provide an identifiable MW resource to PJM when called.

In order to be a substitute for generation, the ELCC for demand resources should be based on data about actual reductions in demand during high expected loss of load hours, like other capacity resources. The current DR ELCC is significantly overstated because the DR ELCC value is based on the unsupported assumption that the full amount of capacity sold will respond when called rather than on actual response data. In other words, the actual response is assumed to be perfect. The amount of

capacity sold equals the PLC – the FSL for the resource. PJM has proposed to make this problem worse rather than to correct it, by increasing the ELCC of demand resources based on assumptions rather than actual performance data.

In order to be a substitute for generation, demand resources should be defined in PJM rules as an economic resource, as generation is defined. Demand resources should be required to offer in the day-ahead energy market and should be called when the resources are required and prior to the declaration of an emergency. Demand resources should be available for every hour of the year. The fact that demand resources are only obligated to respond for defined time periods meant that PJM could not fully use demand resources during Winter Storm Elliott (Elliott). Demand resources should be treated as economic resources like any other capacity resource. Demand resources should be called whenever economic and paid the LMP rather than an inflated strike price up to \$1,849 per MWh that is set by the seller.

In order to be a substitute for generation, demand resources should be subject to robust measurement and verification techniques to ensure that transitional DR programs incent the desired behavior. The methods used in PJM programs today are not adequate to determine and quantify deliberate actions taken to reduce consumption.

In order to be a substitute for generation, demand resources should provide a nodal location and should be dispatched nodally to enhance the effectiveness of demand resources and to permit the efficient functioning of the energy market. Both subzonal and multi-zone compliance should be eliminated because they are inconsistent with an efficient nodal market.

In order to be a substitute for generation, compliance by demand resources with PJM dispatch instructions should include both increases and decreases in load. Compliance of demand resources for capacity purposes during a Performance Assessment Event is measured relative to either Peak Load Contribution or Winter Peak Load, which are static values. If a demand resource's metered load increases above these reference values during a PAI, the current method applied by PJM simply ignores increases in load and thus artificially overstates compliance.<sup>11</sup>

<sup>11</sup> See PJM. MC Webinar, Market Monitor Report <<https://pjm.com/-/media/committees-groups/committees/mc/2023/20230620-webinar/item-04---imm-report.ashx>> (June 20, 2023).



In order to be a substitute for generation, Actual Performance of demand resources during a Performance Assessment Event should be determined consistent with that of generation and should not be netted across the Emergency Action Area (EAA). The Capacity Market Seller's Performance Shortfalls for Demand Resources in the EAA are netted to determine a net EAA Performance Shortfall for the Performance Assessment Interval. Any net positive EAA Performance Shortfall is allocated to the Capacity Market Seller's demand resources that under complied within the EAA on a prorata basis based on the under compliance MW, and such seller's demand resources will be assessed a Performance Shortfall for the Performance Assessment Interval. Any net negative EAA Performance Shortfall is allocated to the Market Seller's Demand Resources that over complied within the EAA on a prorata basis based on over compliance MW, and such Market Seller's Demand Resources will be assessed Bonus Performance. Netting of performance of Demand Resources across the EAA is inconsistent with the performance measurement of other Capacity Performance resources.

In order to be a substitute for generation, any demand resource and its Curtailment Service Provider (CSP), should be required to notify PJM of material changes affecting the capability of the resource to perform as registered and to terminate or modify registrations that are no longer capable of responding to PJM dispatch directives at the specified level, such as in the case of bankrupt and out of service facilities. Generation resources are required to inform PJM of any change in availability status, including outages and shutdown status.

As an alternative to being a substitute for generation in the capacity market, demand response resources should have the option to be on the demand side of the capacity market rather than on the supply side. Rather than detailed demand response programs with their attendant complex and difficult to administer rules, customers would be able to avoid capacity and energy charges by not using capacity and energy at their discretion and the level of usage paid for would be defined by metered usage rather than a complex and inaccurate measurement protocol, and PJM forecasts would immediately incorporate the impacts of demand side behavior.

The MMU peak shaving proposal at the Summer-Only Demand Response Senior Task Force (SODRSTF) is an example of how to create a demand side product that is on the demand side of the market and not on the supply side.<sup>12</sup> The MMU proposal was based on the BGE load forecasting program and the Pennsylvania Act 129 Utility Program.<sup>13 14</sup> Under the MMU proposal, participating load would inform PJM prior to an RPM auction of the MW participating, the months and hours of participation and the temperature humidity index (THI) threshold at which load would be reduced. PJM would reduce the load forecast used in the RPM auction based on the designated reductions. Load would agree to curtail demand to at or below a defined FSL, less than the customer PLC, when the THI exceeds a defined level or load exceeds a specified threshold. By relying on metered load and the PLC, load can reduce its demand for capacity and that reduction can be verified without complicated and inaccurate metrics to estimate load reductions. Under PJM's weakened version of the program, performance is measured under the current economic demand response CBL rules which means relying on load estimates rather than actual metered load.<sup>15</sup> PJM's proposal includes only a THI curtailment trigger and not an overall load curtailment trigger.

The long term appropriate end state for demand resources in the PJM markets should be comparable to the demand side of any market. Customers should use energy as they wish, accounting for market prices in any way they like, and that usage will determine the amount of capacity and energy for which each customer pays. There would be no counterfactual measurement and verification.

Under this approach, customers that wish to avoid capacity payments would reduce their load during expected high load hours, not limited to a small number of peak hours. Capacity costs would be assigned to LSEs and by LSEs to customers, based on actual load on the system during these hours. Customers wishing to avoid high energy prices would reduce their load during high price hours. Customers would pay for what they actually use, as measured by meters, rather than relying

<sup>12</sup> See the MMU package within the *SODRSTF Matrix*, <<http://www.pjm.com/-/media/committees-groups/task-forces/sodrstrf/20180802/20180802-item-04-sodrstrf-matrix.ashx>>.

<sup>13</sup> *Advance signals that can be used to foresee demand response days*, BGE, <<https://www.pjm.com/-/media/committees-groups/task-forces/sodrstrf/20180309/20180309-item-05-bge-load-curtailment-programs.ashx>> (March 9, 2018).

<sup>14</sup> *Pennsylvania ACT 129 Utility Program*, CPower, <<https://www.pjm.com/-/media/committees-groups/task-forces/sodrstrf/20180413/20180413-item-03-pa-act-129-program.ashx>> (April 13, 2018).

<sup>15</sup> The PJM proposal from the SODRSTF weakened the proposal but was approved at the October 25, 2018 Members Committee meeting and PJM filed Tariff changes on December 7, 2018. See "Peak Shaving Adjustment Proposal," Docket No. ER19-511-000 (December 7, 2018).



on flawed measurement and verification methods. No measurement and verification estimates are required. No promises of future reductions which can only be verified by inaccurate and biased measurement and verification methods are required. To the extent that customers enter into contracts with CSPs or LSEs to manage their payments, measurement and verification can be negotiated as part of a bilateral commercial contract between a customer and its CSP or LSE. But the system would be paid for actual, metered usage, regardless of which contractual party takes that obligation.

This approach provides more flexibility to customers to limit usage at their discretion. There is no requirement to be available year round or every hour of every day. There is no 30 minute notice requirement. There is no requirement to offer energy into the day-ahead market. All decisions about interrupting are up to the customers only and they may enter into bilateral commercial arrangements with CSPs at their sole discretion. Customers would pay for capacity and energy depending solely on metered load.

A transition to this end state should be defined in order to ensure that appropriate levels of demand side response are incorporated in PJM's load forecasts and thus in the demand curve in the capacity market. That transition should be defined by the PRD rules, modified as proposed by the MMU.

This approach would work under the CP design in the capacity market. This approach is entirely consistent with the Supreme Court decision in *EPSC* as it does not depend on whether FERC has jurisdiction over the demand side.<sup>16</sup> This approach will allow FERC to more fully realize its overriding policy objective to create competitive and efficient wholesale energy markets. The decision of the Supreme Court addressed jurisdictional issues and did not address the merits of FERC's approach. The Supreme Court's decision has removed the uncertainty surrounding the jurisdictional issues and created the opportunity for FERC to revisit its approach to demand side.

Any discussion of demand resource performance during a PAI must recognize the significant problems with the definition of performance for demand resources. As defined by PJM rules, performance, contrary to intuition, does not mean actually reducing load in response to

a PJM request for demand resources. Performance means only that, on a net portfolio basis, the amount of capacity paid for in the capacity market (PLC) minus actual metered load is equal to the amount of demand side capacity sold in the capacity market (ICAP). If a demand resource location was already at a reduced load level when PJM called a PAI, the demand resource would be deemed to have performed if the PLC less the metered load level was equal to the ICAP sold in the capacity market. The standard reporting of demand side response is therefore misleading because it includes loads that were already lower for any reason as a response. That is exactly what happened during Elliott.

## PJM Demand Response Programs

All PJM demand response programs can be grouped into economic, emergency and pre-emergency programs, or Price Responsive Demand (PRD). Table 6-1 provides an overview of the key features of PJM demand response programs.

Demand response activity includes economic demand response (economic resources), emergency and pre-emergency demand response (demand resources), synchronized reserves and regulation. Economic demand response participates in the energy market. Emergency and pre-emergency demand response participate in the capacity market and energy market.<sup>17</sup> Demand response resources participate in the synchronized reserve market. Demand response resources participate in the regulation market.

FERC Order No. 719 required PJM and other RTOs to amend their market rules to accept bids from aggregators of retail customers of utilities unless the laws or regulations of the relevant electric retail regulatory authority ("RERRA") do not permit the customers aggregated in the bid to participate.<sup>18</sup> PJM implemented rules that require PJM to verify with EDCs that no law or regulation of a RERRA prohibits End Use Customers' participation.<sup>19</sup> EDCs and their End Use Customers are categorized as small and large based on whether the

<sup>17</sup> Emergency demand response refers to both emergency and pre-emergency demand response. With the implementation of the Capacity Performance design, and prior to the July 30, 2023 FERC approved revisions to PJM's Tariff to eliminate the dispatch of demand response as a trigger for calling an emergency and for defining a Performance Assessment Interval (PAI), there is no functional difference between the emergency and pre-emergency demand response resource.

<sup>18</sup> *Wholesale Competition in Regions with Organized Electric Markets*, Order No. 719, FERC Stats. & Regs. ¶ 31,281 at P 154 (2008), *order on reh'g*, Order No. 719-A, FERC Stats. & Regs. ¶ 31,292, *order on reh'g*, Order No. 719-B, 129 FERC ¶ 61,252 (2009).

<sup>19</sup> The evidence supplied by LDCs must take the form of an order, resolution or ordinance of the RERRA, an opinion of the RERRA's legal counsel attesting to existence of an order, resolution, or ordinance, or an opinion of the state attorney general on behalf of the RERRA attesting to existence of an order, resolution or ordinance.

<sup>16</sup> 577 U.S. 260 (2016).

EDC distributed more or less than 4 million MWh in the previous fiscal year. End Use Customers within a large EDC must provide verification of any other contractual obligations or laws or regulations that prohibit participation, but End Use Customers within a small EDC do not need to provide additional verification.<sup>20</sup> RERRAs have permitted EDCs, in a number of cases, to participate in the PJM Economic Load Response Program.

**Table 6-1 Overview of demand response programs**

	Emergency and Pre-Emergency Load Response Program			Economic Load Response Program	
	Load Management (LM)			Economic Demand Response	Price Responsive Demand
Product Types	Capacity Performance, Summer-Period Capacity Performance OATT Attachment DD § 5.5A	Capacity Performance, Summer-Period Capacity Performance OATT Attachment DD § 5.5A		OATT Attachment K § 1.5A	
Market	Capacity Only OATT Attachment K § 8.1	Full Program Option (Capacity and Energy) OATT Attachment K § 8.1	Energy Only OATT Attachment K § 8.1	Energy Only	Capacity Only
Capacity Market	DR cleared in RPM	DR cleared in RPM	Not included in RPM	Not included in RPM	PRD cleared in RPM
Dispatch Requirement	Mandatory Curtailment	Mandatory Curtailment	Voluntary Curtailment	Dispatched Curtailment	Price Threshold
Capacity Payments	Capacity payments based on RPM clearing price	Capacity payments based on RPM clearing price	NA	NA	LSE PRD Credit RAA Schedule 6.1.G
Capacity Measurement and Verification	Firm Service Level Guaranteed Load Drop	Firm Service Level Guaranteed Load Drop	NA	NA	Firm Service Level
CBL	NA	Yes, as described OATT Attachment K § 3.3A	Yes, as described OATT Attachment K § 3.3A	Yes, as described OATT Attachment K § 3.3A	NA
Energy Payments	No energy payment	Energy payment based on submitted higher of "minimum dispatch price" and LMP. Energy payment during PJM declared Emergency Event mandatory curtailments.	Energy payment based on submitted higher of "minimum dispatch price" and LMP. Energy payment only for voluntary curtailments.	Energy payment based on full LMP. Energy payment for hours of dispatched curtailment. OATT Attachment K § 3.3A	NA
Penalties	RPM event OATT Attachment DD § 10A RAA Schedule 6.K Test compliance penalties OATT Attachment DD § 11A	RPM event OATT Attachment DD § 10A RAA Schedule 6.K Test compliance penalties OATT Attachment DD § 11A	NA	NA	RPM event RAA Schedule 6.1.G Test compliance penalties RAA Schedule 6.1.L
Associate Manuals	Manual 18	Manual 11 Manual 18	Manual 11 Manual 18	Manual 11	Manual 18

<sup>20</sup> PJM Operating Agreement Schedule 1 § 1.5A.3.1.

## Non-PJM Demand Response Programs

Within the PJM footprint, states may have additional demand response programs as part of a Renewable Portfolio Standard (RPS) or a separate program. Indiana, Ohio, Pennsylvania (e.g. Pennsylvania ACT 129 Utility Program) and North Carolina include demand response in their RPS. If demand response is dispatched by a state run program, the demand response resources are ineligible to receive payments from PJM during the state dispatch.<sup>21</sup>

## PJM Demand Response Programs


Figure 6-1 shows all revenue from PJM demand response programs by market for each year, 2008 through 2024. Since the implementation of the RPM Capacity Market on June 1, 2007, the capacity market (demand resources) has been the primary source of demand response revenue.<sup>22</sup> In 2024, total demand response revenue decreased by \$18.1 million, 10.6 percent, from \$170.8 million in 2023 to \$152.7 million in 2024, primarily due to a decrease in capacity market prices and revenue. Total emergency demand response revenue decreased by \$37.0 million, 24.1 percent, from \$153.7 million in 2023 to \$116.6 million in 2024. This decrease consisted entirely of capacity market revenue.<sup>23</sup> In 2024, emergency demand response revenue, which includes capacity and emergency energy revenue, accounted for 76.4 percent of all revenue received by demand response providers, the economic program for 7.2 percent, synchronized reserve for 7.2 percent and the regulation market for 9.1 percent.

Economic demand response revenue increased by \$7.5 million, 209.0 percent, from \$3.6 million in 2023 to \$11.0 million in 2024.<sup>24</sup> Demand response revenue in the synchronized reserve market increased by \$4.8 million, 76.7 percent, from \$6.2 million in 2023 to \$11.0 million in 2024. Demand response revenue in the regulation market increased by \$6.7 million, 91.3 percent, from \$7.3 million in 2023 to \$14.0 million in 2024.

Lower demand resource revenues in 2024, compared to 2023, are primarily due to capacity market prices and revenues. The RTO clearing price for the RPM Base

Residual Auction for the 2022/2023 Delivery Year was \$50.00 per MW-day. The RTO clearing price for the RPM Base Residual Auction for the 2023/2024 Delivery Year was \$34.13 per MW-day, 31.2 percent lower than the clearing price for the RTO Base Residual Auction for the 2022/2023 Delivery Year. The RTO clearing price for the RPM Base Residual Auction for the 2024/2025 Delivery Year was \$28.92 per MW-day, 15.2 percent lower than the clearing price for the RTO Base Residual Auction for the 2023/2024 Delivery Year. The capacity revenue amounts for five months of 2023 are from the 2022/2023 Delivery Year and the capacity revenue amounts for five months of 2024 are from the 2023/2024 Delivery Year. The capacity revenue amounts for seven months of 2023 are from the 2023/2024 Delivery Year and the capacity revenue amounts for seven months of 2024 are from the 2024/2025 Delivery Year.

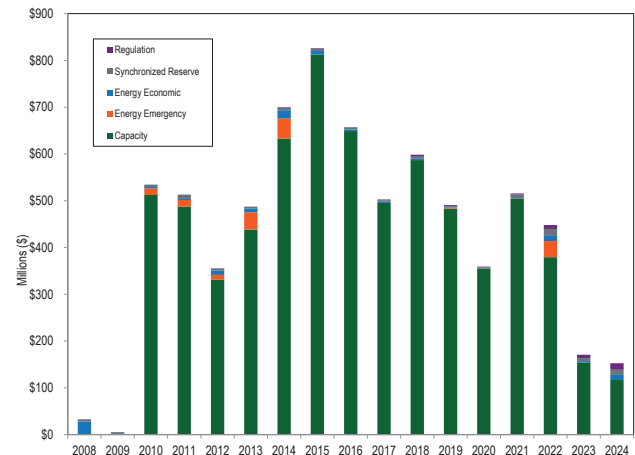**Figure 6-1 Demand response revenue by market: 2008 to 2024**



<sup>21</sup> "PJM Manual 11: Energy & Ancillary Services Market Operations," § 10.1, Rev. 133 (Dec. 17, 2024).

<sup>22</sup> This includes both capacity market revenue and emergency energy revenue for capacity resources.

<sup>23</sup> The total credits and MWh for demand resources were downloaded as of January 16, 2025, and may change as a result of continued PJM billing updates.

<sup>24</sup> Economic credits are synonymous with revenue received for reductions under the economic load response program.

Table 6-2 shows the monthly demand response cleared volumes and revenues in the synchronized reserve market.

**Table 6-2 Demand response synchronized reserve market MWh and revenue: 2023 and 2024**

Month	MWh			Revenue		
	2023	2024	Percent Change	2023	2024	Percent Change
Jan	103,847	299,469	188.4%	\$151,599.84	\$719,294.50	374.5%
Feb	99,889	312,394	212.7%	\$70,116.43	\$544,082.82	676.0%
Mar	107,236	340,047	217.1%	\$52,979.07	\$1,370,683.73	2487.2%
Apr	129,813	213,888	64.8%	\$209,952.32	\$877,390.11	317.9%
May	190,816	344,696	80.6%	\$1,042,914.44	\$1,577,366.27	51.2%
Jun	137,212	210,675	53.5%	\$158,991.76	\$606,492.40	281.5%
Jul	144,622	218,111	50.8%	\$323,655.24	\$811,495.66	150.7%
Aug	133,087	277,126	108.2%	\$136,660.38	\$776,668.66	468.3%
Sept	208,698	302,202	44.8%	\$304,921.03	\$1,059,614.05	247.5%
Oct	315,016	287,022	(8.9%)	\$2,164,742.79	\$1,345,131.42	(37.9%)
Nov	233,916	326,015	39.4%	\$1,054,306.56	\$803,292.28	(23.8%)
Dec	346,038	302,315	(12.6%)	\$561,197.40	\$522,407.37	(6.9%)
Total	2,150,191	3,433,960	59.7%	\$6,232,037.26	\$11,013,919.27	76.7%

Table 6-3 shows the monthly demand response cleared volumes and revenues in the regulation market.

**Table 6-3 Demand response regulation market MWh and revenue: 2023 and 2024**

Month	MWh			Revenue		
	2023	2024	Percent Change	2023	2024	Percent Change
Jan	14,017	35,779	155.3%	\$294,337.47	\$1,423,346.65	383.6%
Feb	14,784	35,638	141.1%	\$291,580.79	\$793,854.86	172.3%
Mar	17,884	36,480	104.0%	\$351,671.65	\$955,548.18	171.7%
Apr	19,533	34,964	79.0%	\$488,013.23	\$829,068.59	69.9%
May	18,338	35,437	93.2%	\$521,342.36	\$1,386,406.04	165.9%
Jun	26,007	32,568	25.2%	\$686,316.94	\$909,381.10	32.5%
Jul	27,802	35,252	26.8%	\$682,855.93	\$1,458,331.13	113.6%
Aug	31,407	35,647	13.5%	\$791,218.26	\$1,076,920.47	36.1%
Sept	27,949	35,178	25.9%	\$746,558.02	\$1,261,594.39	69.0%
Oct	31,093	34,748	11.8%	\$1,118,073.66	\$1,312,029.32	17.3%
Nov	28,181	36,400	29.2%	\$605,928.68	\$1,113,489.47	83.8%
Dec	32,085	38,657	20.5%	\$715,250.14	\$1,433,963.82	100.5%
Total	289,079	426,748	47.6%	\$7,293,147.13	\$13,953,934.02	91.3%

CSPs provide for each registered location the load reduction method and the associated load reduction capability. Load reduction methods indicate the type of electrical equipment that is controlled to provide the demand response activity and include: heating, ventilation and air conditioning (HVAC), lighting, refrigeration, manufacturing, water heaters, batteries, plug load and generation. A plug load represents an electronic device that is plugged into a socket, which is not already represented by the methods described above. Examples of plug load include IT peripherals such as large computers, monitors, printers, routers, copiers and scanners or appliances such as washers, dryers or dishwashers.<sup>25</sup>

<sup>25</sup> "PJM Manual 11: Energy & Ancillary Services Market Operations," § 10.2.2, Rev. 133 (Dec. 17, 2024).

Table 6-4 shows the demand response capability registered to provide synchronized reserves by load reduction method.

**Table 6-4 Demand response synchronized reserve load reduction methods: 2024**

Method	MW	Percent
Generator	116.2	5.6%
HVAC	104.7	5.1%
Lighting	176.4	8.5%
Refrigeration	19.1	0.9%
Manufacturing	1,144.6	55.3%
Water Heaters	0.0	0.0%
Batteries	12.6	0.6%
Plug Load	494.9	23.9%
Total	2,068.5	100.0%

Table 6-5 shows the demand response capability registered to provide regulation by load reduction method.

**Table 6-5 Demand response regulation load reduction methods: 2024**

Method	MW	Percent
Water Heaters	142.5	67.8%
Batteries	67.8	32.2%
Total	210.2	100.0%

## Emergency and Pre-Emergency Load Response Programs

Demand resources participate in the capacity market under the Emergency and Pre-Emergency Load Response Programs. The Pre-Emergency Load Response Program is the default for demand resources. The Emergency Load Response Program is only for resources that use behind the meter generation and that generation has environmental restrictions that limit the resource's ability to operate only in emergency conditions.<sup>26</sup> All demand resources must register as pre-emergency unless the participant qualifies for emergency.

For the first seven months of 2023, PJM declared an emergency if pre-emergency or emergency demand response was dispatched. But in an order issued July 28, 2023, effective July 30, 2023, FERC approved proposed revisions to PJM's Tariff to eliminate the dispatch of demand response as a trigger for calling an emergency and for defining a Performance Assessment Interval (PAI).<sup>27</sup> Under the prior rules, PJM would declare an

emergency if pre-emergency or emergency demand response was dispatched. The new rules mean that demand resources may be dispatched both as part of, and absent, a PAI. While demand resources dispatched during a PAI continue to be subject to Non-Performance Assessment charges, demand resources dispatched outside of a PAI are not subject to any event specific penalties.<sup>28</sup> If a demand resource is dispatched only outside of Performance Assessment Events for the delivery year, its performance for the delivery year is determined based solely on a Load Management Test.<sup>29</sup> There are no penalties or consequences for demand response nonperformance.

For example, if a demand resource is called upon five times during the delivery year only outside of Performance Assessment events and fails to perform each time, its delivery year performance will be based only on a Load Management Test. If the Load Management Test is passed, no penalties would be levied even though the resource failed to perform each time it was needed.

The MMU recommends that PJM define when operators can and should call on demand resources, given that a call on demand resources no longer triggers a PAI. The MMU recommends that PJM revise the performance requirements for demand resources to include an event specific measurement for dispatch occurring outside of Performance Assessment Events and penalties for nonperformance.

In all demand response programs, CSPs are companies that sign up End Use Customers that are PJM Members and have the ability to reduce load. CSPs satisfy cleared RPM commitments by registering End Use Customers as Nominated MW.<sup>30</sup> After a demand response event occurs, PJM compensates CSPs for their participants' load reductions and CSPs in turn compensate their participants. Only CSPs are eligible to participate in the PJM demand response programs, but a participant can register as a PJM special member and become a CSP without any additional cost.

<sup>26</sup> "PJM Manual 18: PJM Capacity Market," § 8.6, Rev. 59 (June 27, 2024).

<sup>29</sup> "PJM Manual 18: PJM Capacity Market," § 8.7, Rev. 59 (June 27, 2024).

<sup>30</sup> See RAA Schedule 6. Since 2010, the PJM tariff definition of "End User Customer" limits the scope of the term to mean only PJM Members. Letter Order, Docket No. ER11-1909-000 (December 20, 2010). Recently, PJM has asserted that the reference in RAA Schedule 6 § L.1 and OATT Attachment DD-1 § L.1 to the defined term, "End Use Customer," was a mistake, and proposed to discontinue use of the defined term in the February 8, 2024, meeting of the PJM Governing Document Enhancement and Clarification Subcommittee (GDECS). The proposed change would remove the current requirement in the filed tariff that End Use Customers be PJM Members. The proposed change is substantive and not a correction of a typographical error.

<sup>26</sup> OA Schedule 1 § 8.5.

<sup>27</sup> See "Order Accepting Tariff Revisions Subject to Condition," Docket No. ER23-1996-000 (July 28, 2023).



All emergency or pre-emergency demand resources must be registered as annual capacity resources. Summer period demand response resources are allowed to aggregate with winter period capacity resources to fulfill the annual requirement.<sup>31</sup>

The rules applied to demand resources in the current market design do not treat demand resources in a manner comparable to generation capacity resources, even though demand resources are sold in the same capacity market, are treated as a substitute for other capacity resources and displace other capacity resources in RPM auctions. PJM will not measure compliance for DR, and the resources will not face penalties, in a PAI unless the product type and lead time type are dispatched by PJM. PJM does not dispatch DR nodally like other capacity resources. DR can only be dispatched on a zonal or subzonal basis. PJM will not measure compliance for DR, and the resources will not face penalties, in a PAI if the area dispatched is not a defined subzone or control zone. With the dispatch of DR no longer triggering a PAI, demand resources dispatched outside of a PAI are no longer subject to any event specific penalties or consequences for nonperformance.

Demand resources are not subject to the same rules as other capacity resources related to the definition of response. Increases in load are ignored when calculating the response of DR to a PJM dispatch.

Demand resources are not required to meet the same must offer requirements as other capacity resources. All other capacity resources must offer in the capacity market and all other capacity resources must offer their ICAP MW daily in the day-ahead energy market.

The MMU has made recommendations that would provide a capacity market supply side and a demand side option and that would result in treating demand resources in a manner comparable to other capacity and energy resources and in a way that would ensure that the demand side contribution to reliability is accurately measured.

## Market Structure

The HHI for demand resources shows that ownership is highly concentrated for the 2023/2024 Delivery Year, with an HHI value of 2295. In the 2023/2024 Delivery

Year, the four largest companies contributed 85.6 percent of all committed demand response UCAP MW. The HHI for demand resources shows that ownership is highly concentrated for the 2024/2025 Delivery Year, with an HHI value of 2387. In the 2024/2025 Delivery Year, the four largest companies own 88.5 percent of all committed demand response UCAP MW.

Table 6-6 shows the HHI value for committed Demand Response UCAP MW and the market share of the four largest suppliers by delivery year.

**Table 6-6 Demand Response HHI: 2019/2020 through 2024/2025 Delivery Year**

Delivery Year	HHI	Structure	Top 4 Market Share
2019/2020	1840	Highly Concentrated	79.1%
2020/2021	2523	Highly Concentrated	88.4%
2021/2022	2070	Highly Concentrated	85.3%
2022/2023	2051	Highly Concentrated	82.8%
2023/2024	2295	Highly Concentrated	85.6%
2024/2025	2387	Highly Concentrated	88.5%

Table 6-7 shows the HHI value for committed UCAP MW by LDA by delivery year. The HHI values are calculated by the committed UCAP MW in each delivery year for demand resources.

**Table 6-7 HHI value for committed UCAP MW by LDA by delivery year: 2023/2024 and 2024/2025 Delivery Years<sup>32</sup>**

Delivery Year	LDA	Committed UCAP MW	HHI Value	HHI Concentration
2023/2024	ATSI	726.8	2269	High
	ATSI-CLEVELAND	189.4	2919	High
	BGE	168.4	3119	High
	COMED	1,253.2	3363	High
	DAY	209.3	3148	High
	DEOK	175.4	2822	High
	DPL-SOUTH	52.2	4212	High
	EMAAC	651.0	3136	High
	MAAC	508.5	2218	High
	PEPCO	175.2	2154	High
	PPL	583.4	2419	High
	PS-NORTH	126.1	2030	High
	PSEG	146.6	1938	High
	RTO	3,208.6	2342	High
	ATSI	541.0	2839	High
	ATSI-CLEVELAND	141.6	3081	High
2024/2025	BGE	198.1	3006	High
	COMED	1,554.0	2993	High
	DAY	192.9	3696	High
	DEOK	221.9	3157	High
	DPL-SOUTH	46.0	3515	High
	EMAAC	672.3	2802	High
	MAAC	531.7	2154	High
	PEPCO	160.4	2545	High
	PPL	603.4	2355	High
	PS-NORTH	98.2	2336	High
	PSEG	187.5	2289	High
	RTO	2,915.7	2258	High

<sup>31</sup> Summer period demand response must be available for June through October and the following May between 10:00AM and 10:00PM EPT. See PJM OATT RAA Article 1.

<sup>32</sup> The RTO LDA refers to the rest of RTO.

## Market Performance

Table 6-8 shows the cleared Demand Resource UCAP MW by delivery year. Total cleared demand response UCAP MW in PJM decreased by 109.4 MW, or 1.3 percent, from 8,174.1 MW in the 2023/2024 Delivery Year to 8,064.7 MW in the 2024/2025 Delivery Year. The DR percent of capacity decreased by 0.2 percentage points, from 5.4 percent in the 2023/2024 Delivery Year to 5.2 percent in the 2024/2025 Delivery Year.

**Table 6-8 Cleared Demand Resource UCAP MW: 2007/2008 through 2024/2025 Delivery Year**

UCAP (MW)		
DR RPM Cleared	Total RPM Cleared	DR Percent Cleared
2007/2008	127.6	0.1%
2008/2009	559.4	0.4%
2009/2010	892.9	0.7%
2010/2011	962.9	0.7%
2011/2012	1,826.6	1.4%
2012/2013	8,740.9	6.2%
2013/2014	10,779.6	6.7%
2014/2015	14,943.0	9.3%
2015/2016	15,453.7	8.9%
2016/2017	13,265.3	7.4%
2017/2018	11,870.5	6.6%
2018/2019	11,435.4	6.5%
2019/2020	10,703.1	6.0%
2020/2021	9,445.7	5.4%
2021/2022	11,427.7	6.5%
2022/2023	8,866.2	5.9%
2023/2024	8,174.1	5.4%
2024/2025	8,064.7	5.2%

Table 6-9 shows zonal monthly capacity market revenue to demand resources for 2024. Capacity market revenue decreased in 2024 by \$37.0 million, 24.1 percent, from \$153.7 million in 2023 to \$116.6 million in 2024.

**Table 6-9 Zonal monthly demand resource capacity revenue: 2024**

Zone	January	February	March	April	May	June	July	August	September	October	November	December	Total
ACEC	\$84,687	\$79,224	\$84,687	\$81,956	\$84,687	\$107,414	\$110,995	\$110,995	\$107,414	\$110,995	\$107,414	\$110,995	\$1,181,464
AEP, EKPC	\$1,637,302	\$1,531,670	\$1,637,302	\$1,584,486	\$1,637,302	\$1,200,612	\$1,240,632	\$1,240,632	\$1,200,612	\$1,240,632	\$1,200,612	\$1,240,632	\$16,592,424
APS	\$757,761	\$708,873	\$757,761	\$733,317	\$757,761	\$554,841	\$573,335	\$573,335	\$554,841	\$573,335	\$554,841	\$573,335	\$7,673,338
ATSI	\$976,187	\$913,207	\$976,187	\$944,697	\$976,187	\$599,203	\$619,177	\$619,177	\$599,203	\$619,177	\$599,203	\$619,177	\$9,060,779
BGE	\$365,167	\$341,608	\$365,167	\$353,388	\$365,167	\$433,839	\$448,300	\$448,300	\$433,839	\$448,300	\$433,839	\$448,300	\$4,885,216
COMED	\$1,169,652	\$1,094,191	\$1,169,652	\$1,131,922	\$1,169,652	\$1,224,155	\$1,264,960	\$1,264,960	\$1,224,155	\$1,264,960	\$1,224,155	\$1,264,960	\$14,467,372
DAY	\$221,445	\$207,159	\$221,445	\$214,302	\$221,445	\$168,930	\$174,561	\$174,561	\$168,930	\$174,561	\$168,930	\$174,561	\$2,290,833
DOM	\$845,472	\$790,925	\$845,472	\$818,198	\$845,472	\$703,256	\$726,698	\$726,698	\$703,256	\$726,698	\$703,256	\$726,698	\$9,162,097
DPL	\$258,481	\$241,805	\$258,481	\$250,143	\$258,481	\$757,919	\$783,183	\$783,183	\$757,919	\$783,183	\$757,919	\$783,183	\$6,673,884
DUKE	\$185,579	\$173,606	\$185,579	\$179,592	\$185,579	\$640,670	\$662,025	\$662,025	\$640,670	\$662,025	\$640,670	\$662,025	\$5,480,046
DUQ	\$125,059	\$116,991	\$125,059	\$121,025	\$125,059	\$104,632	\$108,120	\$108,120	\$104,632	\$108,120	\$104,632	\$108,120	\$1,359,570
JCPLC	\$184,870	\$172,943	\$184,870	\$178,907	\$184,870	\$211,934	\$218,999	\$218,999	\$211,934	\$218,999	\$211,934	\$218,999	\$2,418,260
MEC	\$331,692	\$310,293	\$331,692	\$320,993	\$331,692	\$323,368	\$334,147	\$334,147	\$323,368	\$334,147	\$323,368	\$334,147	\$3,933,053
PE	\$448,444	\$419,512	\$448,444	\$433,978	\$448,444	\$466,048	\$481,583	\$481,583	\$466,048	\$481,583	\$466,048	\$481,583	\$5,523,296
PECO	\$580,538	\$543,084	\$580,538	\$561,811	\$580,538	\$587,563	\$607,149	\$607,149	\$587,563	\$607,149	\$587,563	\$607,149	\$7,037,794
PEPCO	\$245,777	\$229,921	\$245,777	\$237,849	\$245,777	\$217,212	\$224,452	\$224,452	\$217,212	\$224,452	\$217,212	\$224,452	\$2,754,545
PPL	\$895,046	\$837,301	\$895,046	\$866,174	\$895,046	\$895,868	\$925,730	\$925,730	\$895,868	\$925,730	\$895,868	\$925,730	\$10,779,138
PSEG	\$418,374	\$391,382	\$418,374	\$404,878	\$418,374	\$459,406	\$474,719	\$474,719	\$459,406	\$474,719	\$459,406	\$474,719	\$5,328,476
REC	\$3,375	\$3,158	\$3,375	\$3,266	\$3,375	\$4,342	\$4,486	\$4,486	\$4,342	\$4,486	\$4,342	\$4,486	\$47,520
TOTAL	\$9,734,911	\$9,106,852	\$9,734,911	\$9,420,882	\$9,734,911	\$9,661,211	\$9,983,251	\$9,983,251	\$9,661,211	\$9,983,251	\$9,661,211	\$9,983,251	\$116,649,104

## Product Definition

Pre-Emergency and Emergency Load Response resources must register all resources with a specific response time. The options are to respond within 30, 60 or 120 minutes of a PJM dispatched event. The 30 minute prior notification is the default and applies unless a CSP obtains an exception from PJM due to physical operational limitations that prevent the Demand Resource Registration from reducing load within that timeframe.

Table 6-10 shows the amount of nominated MW and locations by product type and lead time for the 2023/2024 Delivery Year. Nominated MW are Pre-Emergency or Emergency Load Response registrations used to satisfy a CSP's committed MW position for a delivery year. PJM approved 2,804 locations, or 16.0 percent of all locations, which have 3,662.5 nominated MW, or 47.0 percent of all nominated MW, for exceptions to the 30 minute lead time rule for the 2023/2024 Delivery Year.

**Table 6-10 Nominated MW and locations by product type and lead time: 2023/2024 Delivery Year**

Lead Type	Pre-Emergency		Emergency		Total
	MW	Percent	MW	Percent	
30 Minutes	3,977.6	96.2%	155.8	3.8%	4,133
60 Minutes	374.3	93.0%	28.3	7.0%	403
120 Minutes	3,123.4	95.8%	136.5	4.2%	3,260
Total	7,475.3	95.9%	320.6	4.1%	7,796

Lead Type	Pre-Emergency		Emergency		Total
	Locations	Percent	Locations	Percent	
30 Minutes	14,486	98.7%	194	1.3%	14,680
60 Minutes	315	97.2%	9	2.8%	324
120 Minutes	2,426	97.8%	54	2.2%	2,480
Total	17,227	98.5%	257	1.5%	17,484

Table 6-11 shows the amount of nominated MW and locations by product type and lead time for the 2024/2025 Delivery Year. PJM approved 2,681 locations, or 16.1 percent of all locations, which have 3,287.6 nominated MW, or 45.6 percent of all nominated MW, for exceptions to the 30 minute lead time rule for the 2023/2024 Delivery Year.

**Table 6-11 Nominated MW and locations by product type and lead time: 2024/2025 Delivery Year**

Lead Type	Pre-Emergency		Emergency		Total
	MW	Percent	MW	Percent	
30 Minutes	3,797.5	96.7%	130.4	3.3%	3,928
60 Minutes	264.3	89.4%	31.2	10.6%	296
120 Minutes	2,908.9	97.2%	83.2	2.8%	2,992
Total	6,970.7	96.6%	244.8	3.4%	7,215

Lead Type	Pre-Emergency		Emergency		Total
	Locations	Percent	Locations	Percent	
30 Minutes	13,775	98.8%	165	1.2%	13,940
60 Minutes	330	96.5%	12	3.5%	342
120 Minutes	2,293	98.0%	46	2.0%	2,339
Total	16,398	98.7%	223	1.3%	16,621

The alternative notification times are 60 minutes and 120 minutes. The CSP must request an exception in writing, including the reason(s) for the requested exception. Once a location is granted a longer lead time, the resource does not need to resubmit for a longer lead time each delivery year.

The request for an exception must demonstrate one of four defined reasons:<sup>33</sup>

- The manufacturing processes for the Demand Resource Registration require gradual reduction to avoid damaging major industrial equipment used in the manufacturing process, or damage to the product generated or feedstock used in the manufacturing process;
- Transfer of load to backup generation requires time intensive manual process taking more than 30 minutes;
- Onsite safety concerns prevent location from implementing reduction plan in less than 30 minutes; or,
- The Demand Resource Registration is comprised of mass market residential customers or Small Commercial Customers which collectively cannot be notified of a Load Management Event within 30 minutes due to unavoidable communications latency, in which case the requested notification time shall be no longer than 120 minutes.

Table 6-12 shows the nominated MW and locations by product type and lead time of granted lead time exceptions for the 2024/2025 Delivery Year.<sup>34</sup>

<sup>33</sup> OATT Attachment DD-1, Section A.2(a).

<sup>34</sup> Data for generation start time and mass market communication categories were combined based on confidentiality rules.

**Table 6-12 Nominated MW and locations of granted lead time exceptions: 2024/2025 Delivery Year**

Reason	60 Minutes		120 Minutes		Total
	MW	Percent	MW	Percent	
Generation Start Time	54.2	1.6%	446.9	13.6%	501.1
Manufacturing Damage	186.4	5.7%	1,737.7	52.9%	1,924.2
Safety Problem	54.9	1.7%	807.4	24.6%	862.3
Total	295.5		2,992.0		3,287.6

Reason	60 Minutes		120 Minutes		Total
	Locations		Locations		
Generation Start Time	31	1.2%	132	4.9%	163
Manufacturing Damage	215	8.0%	734	27.4%	949
Safety Problem	96	3.6%	1,473	54.9%	1,569
Total	342		2,339		2,681

Prior to participating in the PJM Markets, CSPs must complete a registration in DR Hub which identifies the specific location(s) based on the unique EDC account number that will participate and their associated load reduction capability. CSPs must maintain the accuracy of the registration information provided to PJM for each demand resource and each time the CSP registers the location or extends the registration, the CSP must review all information to ensure it is accurate and update as necessary. In order to register demand resources, the CSPs must classify locations according to the location's primary purpose or business use. CSPs first determine if the location's business use falls under one of the following primary categories: Hospitals, Industrial / Manufacturing, Multiple Dwelling Unit, Office Building, Residential, Retail Service, Correctional Facilities or Schools. In cases where the location does not fit into one of the primary categories, the CSP selects from one of the following categories: Agriculture, Forestry and Fishing, Mining, Transportation, Communications, Electric, Gas and Sanitary Services or Services. A description of each category is included in the DR Hub user guide.<sup>35</sup>

Table 6-13 shows the nominated MW and locations by business segment for the 2024/2025 Delivery Year.

**Table 6-13 Nominated MW and locations by business segment: 2024/2025 Delivery Year**

Business Segment	Nominated MW (ICAP)	Percent of Total	Locations	Percent of Total
Industrial/Manufacturing	3,632.5	50.3%	3,097	18.6%
Schools	813.9	11.3%	3,539	21.3%
Transportation, Communications, Electric, Gas and Sanitary Services	470.9	6.5%	480	2.9%
Office Building	382.8	5.3%	955	5.7%
Retail Service	367.5	5.1%	6,821	41.0%
Hospitals	348.4	4.8%	338	2.0%
Mining	282.1	3.9%	174	1.0%
Data Center	233.7	3.2%	44	0.3%
Services	227.2	3.1%	480	2.9%
Residential	197.4	2.7%	205	1.2%
Agriculture, Forestry and Fishing	95.7	1.3%	238	1.4%
Data Center with Crypto Mining	90.5	1.3%	23	0.1%
Correctional Facilities	28.5	0.4%	31	0.2%
Multiple Dwelling Unit	24.6	0.3%	154	0.9%
Undefined	19.8	0.3%	42	0.3%
Total	7,215.5	100.0%	16,621	100.0%

There are two ways to measure the load reductions of demand resources. The Firm Service Level (FSL) method, applied to the summer, measures the difference between a customer's peak load contribution (PLC) and its real-time load, multiplied by the loss factor (LF).<sup>36</sup> The Guaranteed Load Drop (GLD) method measures the minimum of: the comparison load minus real-time load multiplied by the loss factor; or the PLC minus the real-time load multiplied by the loss factor. The comparison load estimates what the load would have been if PJM did not declare a Load Management Event, similar to a CBL, by using a comparable day, same day, customer baseline, regression analysis or backup generation method. Limiting the GLD method to the minimum of the two calculations ensures reductions

<sup>35</sup> "PJM Manual 11: Energy & Ancillary Services Market Operations," § 10.2.2, Rev. 133 (Dec. 17, 2024).

<sup>36</sup> Real-time load is hourly metered load.

occur below the PLC, thus avoiding double counting of load reductions.<sup>37</sup> With the introduction of the Winter Peak Load (WPL) concept, effective for the 2017/2018 Delivery Year, both the FSL and GLD methods are modified for the non-summer period. The FSL method measures compliance during the non-summer period as the difference between a customer's WPL multiplied by the Zonal Winter Weather Adjustment Factor (ZWWAF) and the LF, rather than the PLC, and real-time load, multiplied by the LF. PJM calculates and posts on the PJM website the ZWWAF as the zonal winter weather normalized peak divided by the zonal average of the five coincident peak loads in December through February.<sup>38</sup> The Winter Peak Load is determined based on the average of the Demand Resource customer's specific peak hourly load between hours ending 7:00 EPT through 21:00 EPT on the PJM defined five coincident peak days from December through February two delivery years prior to the delivery year for which the registration is submitted. The Winter Peak Load is adjusted up for transmission and distribution line loss factors because one MW of load would be served by more than one MW of generation to account for transmission losses. The Winter Peak Load is normalized based on the winter conditions during the five coincident peak loads in winter using the ZWWAF to account for an extreme temperatures or a mild winter. The GLD method measures compliance during the non-summer period as the minimum of: the comparison load minus real-time load multiplied by the loss factor; or the WPL multiplied by the ZWWAF and the LF, rather than the PLC, minus the real-time load multiplied by the LF.<sup>39</sup>

The capacity market is an annual market. A Capacity Performance resource has an annual commitment. Effective with the 2020/2021 Delivery Year, the capacity market design includes the ability to offer Seasonal Capacity Performance Resources directly into the RPM Auction as an alternative to entering into a commercial arrangement to establish and offer an Aggregate Resource. Capacity Market Sellers may submit sell offers of either Summer Period Capacity Performance Resources or Winter Period Capacity Performance Resources and the auction clearing optimization algorithm is designed to clear equal quantities of offsetting seasonal capacity sell offers thereby creating an annual capacity commitment by matching a Summer Period Capacity Performance Resource with a Winter Period Capacity Performance Resource. Load is allocated capacity obligations based on the annual peak load which is a summer load. The amount of capacity MW allocated to load does not vary based on winter demand. The principle is that a customer's actual use of capacity should be compared to the level of capacity that a customer is required to pay for. Capacity costs are allocated to LSEs by PJM based on the single coincident peak load method. In PJM, the single coincident peak occurs in the summer.<sup>40</sup> LSEs generally allocate capacity costs to customers based on the five coincident peak method.<sup>41</sup> The allocation of capacity costs to customers uses each customer's PLC. Customers pay for capacity based on the PLC, not the WPL. If an end customer has 3 MW of load during the coincident peak load hour, but only 1 MW during the coincident winter peak load hour, the End Use Customer must pay for 3 MW of capacity for the entire delivery year, but can only participate as a 1 MW demand response resource. Using PLC to measure compliance for the entire delivery year would allow the customer to fully participate as a 3 MW demand response resource. FERC allowed the use of the WPL for calculating compliance for non-summer months effective June 1, 2017.<sup>42</sup> The MMU recommends setting the baseline for measuring capacity compliance under summer and winter compliance at the customer's PLC, similar to GLD, to avoid double counting, to avoid under counting and to ensure that a customer's purchase of capacity is calculated correctly. The FSL and GLD equations for calculating load reductions are:

$$FSL\ Compliance_{Summer} = PLC - (Load \cdot LF)$$

$$FSL\ Compliance_{Non-Summer} = (WPL \cdot ZWWAF \cdot LF) - (Load \cdot LF)$$

$$GLD\ Compliance_{Summer} = \text{Minimum}\{(comparison\ load - Load) \cdot LF; PLC - (Load \cdot LF)\}$$

$$GLD\ Compliance_{Non-Summer} = \text{Minimum}\{(comparison\ load - Load) \cdot LF; (WPL \cdot ZWWAF \cdot LF) - (Load \cdot LF)\}$$

<sup>37</sup> 135 FERC ¶ 61,212 (2011).

<sup>38</sup> "PJM Manual 18: PJM Capacity Market," § 4.3.7, Rev. 59 (June 27, 2024).

<sup>39</sup> "PJM Manual 18: PJM Capacity Market," § 8.7A, Rev. 59 (June 27, 2024).

<sup>40</sup> OATT Attachment DD.5.11.

<sup>41</sup> OATT Attachment M-2.

<sup>42</sup> 162 FERC ¶ 61,159 (2018).



For Demand Resources, PJM calculates UCAP as the product of the FPR and the Demand Resource's Nominated Value, which depends on the peak load contribution of customers on the Demand Resource registration and their committed Firm Service Level or Guaranteed Load Drop.<sup>43</sup> Similarly, the UCAP of an Energy Efficiency Resource is the product of the FPR and the resource's Nominated Energy Efficiency Value, which is the resource's expected average load reduction during the EE Performance Hours defined in the RAA.<sup>44</sup> The current accreditation practice for Demand Resources and Energy Efficiency Resources assumes they provide 100 percent performance at any time they are required to perform. Beginning with the 2025/2026 Delivery Year, PJM will institute a marginal ELCC approach that accredits all Generation Capacity Resources and Demand Resources based on their marginal Expected Unserved Energy (EUE) benefit. This accreditation change will not apply to Energy Efficiency Resources whose UCAP value will continue to be determined using FPR, with the substitution of pool wide accredited UCAP factor for pool wide forced outage rate. ELCC accreditation for Demand Resources differs from the previous method by aligning the expected performance of Demand Resources with their accredited capacity levels during periods of resource adequacy risk. For Demand Resources, PJM will calculate Accredited UCAP as the product of the resource's Nominated Value and its ELCC Class Rating. Unlike generation, PJM will not apply a resource specific performance adjustment for Demand Resources. Notably, the Demand Resource availability window, defined in the RAA for Annual Demand Resources and Summer-Period Demand Resources, does not align with the projected hours with a loss of load risk in the winter period.<sup>45</sup> The ELCC class rating for Demand Resources for the 2025/2026 BRA is 76 percent.<sup>46</sup>

PJM noted that it did not propose to apply marginal ELCC accreditation to Energy Efficiency Resources because the impact of energy efficiency is largely already included in PJM's load forecast models. Therefore, PJM argued that it would be inappropriate to include these resources again in the ELCC analysis, which considers the PJM load forecast to accredit capacity. PJM stated that including Energy Efficiency Resources in the ELCC model would double count their energy efficiency

impact, improperly affect modeled system risk patterns, mislead PJM's assessment of risk patterns, and distort the assessed capacity accreditation of all other modeled resources.<sup>47</sup>

PJM's response misses the critical point that EE should not be assumed to always be available during EUE hours. The actual availability requirement of EE is only 4.7 percent of all hours. PJM should assign an ELCC derating factor to EE to correctly represent the coincidence between the EE required hours and EUE hours. In fact, EE is not a capacity resource and its capacity payment should be zero. The implication of PJM's logic is that the ELCC should be zero. Instead PJM uses an ELCC for EE of 100 percent.

PJM makes several unsupported assumptions when calculating ELCC for demand response resources. The PJM ELCC calculations do not account for the actual historical performance of DR in same way as thermal resources. PJM analysis showed that the ELCC reduction capability is overstated compared to the metered DR reduction capability.<sup>48</sup> This over statement of performance is consistent with the observed performance of DR during Winter Storm Elliott. There was a significant disparity between the reported expected reduction capability provided by the CSPs and the actual observed energy reduction during Winter Storm Elliott. As a general matter, these resources are rarely used.

Since May 2024, the MIC has been working on a problem statement and issue charge regarding the alignment of demand response capacity availability hours with periods of reliability risk.<sup>49</sup> PJM proposed to expand the window to all hours. PJM also proposed to use coincident peak demand rather than the sum of noncoincident peak demands to measure the level of demand resources. The MMU supports the extension of availability to all hours, consistent with all other capacity resources. The MMU supports the proposal to measure all DR for the same coincident peak demand hour as a more accurate measure of the level of actual DR potential rather than the overstatement that has resulted from adding together all the DR from individual non coincident peak hours.

47 See "Capacity Market Reforms to Accommodate the Energy Transition While Maintaining Resource Adequacy," ER24-99-000. (October 13, 2023), at pp 26-27.

48 See PJM, DR Availability Window: Additional DR ELCC Information, <<https://pjm.com/-/media/committees-groups/committees/mic/2024/20240807/20240807-item-08b---pjm-dr-education.ashx>> (August 7, 2024).

49 See *Approved Minutes from the Markets & Reliability Committee*, <<https://pjm.com/-/media/committees-groups/committees/mrc/2024/20240627/20240627-consent-agenda-a---draft-mrc-minutes---05222024.ashx>>.

43 See PJM, Intra-PJM Tariffs, RAA, Schedule 6 (18.0.0), § 6.I.

44 See PJM, Intra-PJM Tariffs, RAA, Schedule 6 (18.0.0), § 6.L.2.

45 See "Responses to Deficiency Letter – Capacity Market Reforms to Accommodate the Energy Transition," ER24-99-001. (December 1, 2023), at p 28.

46 See "2025-2026 BRA ELCC Class Ratings," <<https://pjm.com/-/media/planning/res-adeq/elcc/2025-26-bra-elcc-class-ratings.ashx>> (March 13, 2024).

PJM also proposed to increase the ELCC derating factor from 76 percent to 94 percent, an increase of 24 percent in the value of demand resource MW. PJM's proposed ELCC value for DR is not consistent with the method PJM uses for generation resources. PJM's proposed ELCC for DR is based on assumed behavior and not based on the actual performance of demand resources during the same high EUE (expected unserved energy) hours used for other capacity resources. The current ELCC value for demand response is already overstated. As currently demand resources are inferior resources in the capacity market and the ELCC values, both existing and proposed, significantly overstate their contribution to reliability. The demand resources are rarely used. While PJM may call on demand resources as part of its emergency actions, there are no PJM rules governing the overall commitment and dispatch of demand resources as there are for all other capacity resources.<sup>50</sup> PJM rules do not indicate when and how demand resources should be called on for nonemergency events. PJM rules do not require that demand resources be called on during emergency events but leave all emergency actions to the discretion of PJM dispatchers. The proposed changes would increase the value of demand resources by almost a billion dollars (\$880.7M) without any actual change in the physical reality and without the type of detailed analysis applied to other capacity resources.<sup>51</sup> The proposed changes would simply pay demand response more for capacity without any increase in use and without any rules governing when demand response can or will be used for economic reasons and without a must offer obligation in the energy or capacity markets, and without any market power mitigation rules, without resource specific performance adjustments, and without addressing the fact that demand side performance metrics simply ignore increases in load above the WPL when called. PJM does not propose consistent changes to the treatment of demand resources in the summer. PJM proposes to make these changes to the ELCC value of demand response resources while ignoring significant issues with the treatment of other resource technologies. The result of this administrative change would also be to affect the ELCC of other classes and to make it appear that PJM is more reliable than it is. Table 6-14 shows the MW registered by measurement and verification method and by technology type for the 2024/2025 Delivery Year. For the 2024/2025 Delivery Year, 99.99 percent use the FSL method and 0.01 percent use the GLD measurement and verification method.

**Table 6-14 Nominated MW by each demand response method: 2024/2025 Delivery Year**

Measurement and Verification Method	Technology Type							Total	Percent by type
	On-site Generation	Refrigeration	Lighting	Manufacturing	Water Heating	Other, Batteries or Plug Load	MW		
Firm Service Level	1,057.6	1,736.8	194.8	661.0	3,446.7	22.7	95.1	7,214.7	99.99%
Guaranteed Load Drop	0.0	0.7	0.0	0.0	0.1	0.0	0.0	0.8	0.01%
Total	1,057.6	1,737.5	194.8	661.0	3,446.7	22.7	95.1	7,215.5	100.0%
Percent by method	14.7%	24.1%	2.7%	9.2%	47.8%	0.3%	1.3%	100.0%	

Table 6-15 shows the fuel type used in the onsite generators for the 2024/2025 Delivery Year in the emergency and pre-emergency programs. For the 2024/2025 Delivery Year, 1,057.6 MW of the 7,215.5 nominated MW, 14.7 percent, used onsite generation. Of the 1,057.6 MW, 84.1 percent used diesel and 15.9 percent used natural gas, gasoline, oil, propane or waste products. Some DR registrations reflect a participant's reliance on behind the meter generation having environmental restrictions that limit the resource's ability to operate only in emergency conditions. Demand resources relying on behind the meter generation having environmental restrictions limiting the resource's ability to operate only in emergency conditions must register as emergency DR. EPA regulations require that Reciprocating Internal Combustion Engines (RICE) that do not meet EPA emissions standards (stationary emergency RICE) may operate for only 100 hours per year and only to provide emergency DR during an Energy Emergency Alert 2 (EEA2), or if there are five percent voltage/frequency deviations. PJM does not prevent emergency stationary RICE that does not meet emissions standards from participating in PJM markets as DR. Some emergency stationary RICE that does not meet emissions standards are now included in DR portfolios. PJM's DR Hub does not explicitly identify Reciprocating Internal Combustion Engines (RICE) generators, only whether it is an internal combustion engine. For the 2024/2025 Delivery Year, of the 244.8 MW registered as generation backed emergency DR, 242.2 MW are backed

<sup>50</sup> See PJM Manual 13, Emergency Operations, section 2.3.2.

<sup>51</sup> See PJM, DR Availability Window – IMM Proposal, <<https://pjm.com/-/media/committees-groups/committees/mrc/2024/20240522/20240522-item-02---1-demand-response-availability-window---presentation.ashx>> (May 5, 2025).

by internal combustion engines. Stationary emergency RICE should be prohibited from participation as DR either when registered individually or as part of a portfolio if it cannot meet its capacity market obligations as a result of emissions standards.

**Table 6-15 Onsite generation fuel type (MW): 2024/2025 Delivery Year**

Fuel Type	2024/2025	
	MW	Percent
Diesel	889.2	84.1%
Natural Gas, Gasoline, Oil, Propane, Waste Products	168.4	15.9%
Total	1,057.6	100.0%

Table 6-16 shows the MW registered by measurement and verification method and by technology type for the 2023/2024 Delivery Year. For the 2023/2024 Delivery Year, 99.99 percent use the FSL method and 0.01 percent use the GLD measurement and verification method.

**Table 6-16 Nominated MW by each demand response method: 2023/2024 Delivery Year**

	Technology Type								
Measurement and Verification Method	On-site Generation		Refrigeration	Lighting	Manufacturing	Water Heating	Batteries and Plug Load	Total	Percent by type
	MW	HVAC MW	MW	MW	MW	MW	MW		
Firm Service Level	1,225.8	1,722.3	188.8	709.8	3,854.7	35.3	58.4	7,795.0	99.99%
Guaranteed Load Drop	0.3	0.5	0.0	0.0	0.1	0.0	0.0	0.9	0.01%
Total	1,226.0	1,722.8	188.8	709.8	3,854.7	35.3	58.4	7,795.9	100.0%
Percent by method	15.7%	22.1%	2.4%	9.1%	49.4%	0.5%	0.7%	100.0%	

Table 6-17 shows the fuel type used in the onsite generators for the 2023/2024 Delivery Year in the emergency and pre-emergency programs. For the 2023/2024 Delivery Year, 1,226.0 MW of the 7,795.9 nominated MW, 15.7 percent, use onsite generation. Of the 1,226.0 MW, 84.0 percent use diesel and 16.0 percent use natural gas, gasoline, oil, propane or waste products.

**Table 6-17 Onsite generation fuel type (MW): 2023/2024 Delivery Year**

Fuel Type	2023/2024	
	MW	Percent
Diesel	1,029.5	84.0%
Natural Gas, Gasoline, Oil, Propane, Waste Products	196.5	16.0%
Total	1,226.0	100.0%

## Emergency and Pre-Emergency Event Reported Compliance

Capacity resources measure performance nodally, except for demand resources. PJM cannot dispatch demand resources by node with the current rules because demand resources are not registered to a node.

Demand resources can be dispatched by subzone only if the subzone is defined before dispatch. Aggregation rules allow a demand resource that incorporates many small End Use Customers to span an entire zone, which is inconsistent with nodal dispatch.

Subzonal dispatch became mandatory for emergency demand resources in the 2014/2015 Delivery Year.<sup>52</sup> A subzone is defined by zip code, not by nodal location. If a registration has any location in the dispatched subzone, as defined by the zip code of the enrolled End Use Customer's address, the entire registration must respond. There are currently seven defined dispatchable subzones in PJM: APS\_EAST, DOM\_CHES, DOM\_YORKTOWN, AECO\_ENGLAND, JCPL\_REDBANK, DOM\_ASHBURN and AEP\_MARION.<sup>53</sup> The AEP\_MARION subzone was added as a result of the June 14-16, 2022, performance assessment event in the Columbus, Ohio area of the AEP Zone.

PJM can remove a defined subzone, and make changes to the subzone, at their discretion. Subzones should not be removed once defined, as the subzone may need to be dispatched again in the future. The METED\_EAST, PENELEC\_EAST, PPL\_EAST and DOM\_NORFOLK Subzones were removed by PJM. More subzones may have been removed by PJM but PJM does not keep a record of created and removed subzones. The MMU recommends that PJM not remove any defined subzones and maintain a public record of all created and removed subzones. The MMU recommends that, if PJM continues to use subzones for any purpose, PJM clearly define the role of subzones in the dispatch of demand response.

The subzone design and closed loop interfaces are related. PJM implemented closed loop interfaces with the stated purpose of improving the incorporation of reactive constraints into energy prices and to allow

<sup>52</sup> OATT Attachment DD, Section 11.

<sup>53</sup> See "Load Management Subzones," <<https://www.pjm.com/-/media/markets-ops/demand-response/subzone-definition-workbook.ashx>> (Accessed January 13, 2023).

emergency DR to set price.<sup>54</sup> PJM applies closed loop interfaces so that it can use units needed for reactive support to set the energy price when they would not otherwise set price under the LMP algorithm. PJM also applies closed loop interfaces so that it can use emergency DR resources to set the real-time LMP when DR would not otherwise set price under the fundamental LMP logic. Of the 20 closed loop interface definitions, 11 (55 percent) were created for the purpose of allowing emergency DR to set price.<sup>55</sup> The closed loop interfaces created for the purpose of allowing emergency DR to set price are located in the Rest of RTO, MAAC, EMAAC, SWMAAC, DPL-SOUTH, ATSI, ATSI-CLEVELAND and BGE LDAs. These interfaces correspond to LDAs as defined in RPM.<sup>56</sup>

Demand resources can be dispatched for voluntary compliance during any hour of any day, but dispatched resources are not measured for compliance outside of the mandatory compliance window for each demand product. A demand response event during a product's mandatory compliance window also may not result in a compliance score. When demand response events occur for partial hours under 30 minutes, the event is not measured for compliance.

Demand resources currently estimate five minute compliance with an hourly interval meter during PAIs. To accurately measure compliance on a five minute basis, a five minute interval meter is required. All other capacity resources require five minute interval meters, and demand resources should be no different. Demand resources are paid based on the average performance by registration for the duration of a demand response event. Demand response should measure compliance on a five minute basis to accurately report reductions during demand response events. Measuring compliance on a five minute basis would provide accurate information to the PJM system. The MMU recommends demand response event compliance be calculated on a

five minute basis for all capacity resources and that the penalty structure reflect five minute compliance.<sup>57</sup>

Under the capacity performance design of the capacity market, compliance for potential penalties is measured for DR only during performance assessment intervals (PAI).<sup>58</sup>

The MMU recommended that demand response resources be treated as economic resources like all other capacity resources and therefore that the dispatch of demand response resources not automatically trigger a performance assessment interval (PAI) for CP compliance. Emergencies should be triggered only when PJM has exhausted all economic resources including demand response resources. For the first seven months of 2023, PJM declared an emergency if pre-emergency or emergency demand response were dispatched. But in an order issued July 28, 2023, effective July 30, 2023, FERC approved proposed revisions to PJM's Tariff to eliminate the dispatch of demand response as a trigger for calling an emergency and for defining a Performance Assessment Interval (PAI).<sup>59</sup> Table 6-18 shows the amount of nominated demand response MW, the required reserve margin and actual reserve margin for the 2023/2024 and 2024/2025 Delivery Years. There are 7,220.0 nominated MW of demand response for the 2024/2025 Delivery Year, 33.7 percent of the required reserve margin and 29.0 percent of the actual reserve margin for the 2024/2025 Delivery Year.<sup>60</sup>

**Table 6-18 Demand response nominated MW compared to reserve margin: 2023/2024 and 2024/2025 Delivery Years<sup>61</sup>**

Delivery Year	Demand Response Nominated MW	Required Reserve Margin	Demand Response Percent of Required Reserve Margin	Actual Reserve Margin	Demand Response Percent of Actual Reserve Margin
2023/2024	7,478.6	17,819.3	42.0%	23,792.0	31.4%
2024/2025	7,220.0	21,398.4	33.7%	24,856.8	29.0%

PJM will dispatch demand resources by zone or subzone, or within a PAI area. When PJM dispatches all demand resources in multiple connecting zones, PJM further degrades the nodal design of electricity markets. In that case, PJM allows compliance to be measured across zones within a compliance aggregation area (CAA) or an

54 See PJM/Alstom, "Approaches to Reduce Energy Uplift and PJM Experiences," presented at the FERC Technical Conference: Increasing Real-Time and Day-Ahead Market Efficiency Through Improved Software, Docket No. AD10-12-006 (June 23, 2015) <<http://www.ferc.gov/june-tech-conf/2015/presentations/m2-3.pdf>>.

55 See the 2018 Annual State of the Market Report for PJM, Volume 2: Section 4, Energy Uplift, for additional information regarding all closed loop interfaces and the impacts to the PJM markets.

56 "PJM Manual 18: PJM Capacity Market," § 2.3.1, Rev. 59 (June 27, 2024).

57 "PJM Manual 18: PJM Capacity Market," § 8.7A, Rev. 59 (June 27, 2024).

58 OATT § 1 (Performance Assessment Hour).

59 See "Order Accepting Tariff Revisions Subject to Condition," Docket No. ER23-1996-000 (July 28, 2023).

60 2024 Annual State of the Market Report for PJM, Volume 2, Section 5: Capacity Market, Table 5-7.

61 Nominated MW totals are Demand Response ICAP corresponding to Demand Response UCAP cleared in RPM auctions for each delivery year. The total nominated MW values do not reflect replacement transactions.



Emergency Action Area (EAA).<sup>62</sup> <sup>63</sup> A CAA, or EAA, is an electrically connected area that has the same capacity market price. This changes the way CSPs dispatch resources when multiple electrically contiguous areas with the same RPM clearing prices are dispatched. The compliance rules determine how CSPs are paid and thus create incentives that CSPs will incorporate in their decisions about how to respond to PJM dispatch. The multiple zone approach is even less locational than the zonal and subzonal approaches and creates larger mismatches between the locational need for the resources and the actual response. If multiple zones within a CAA are called by PJM, a CSP will dispatch the least cost resources across the zones to cover the CSP's obligation. This can result in more MW dispatched in one zone that are locationally distant from the relief needed and no MW dispatched in another zone, yet the CSP could be considered 100 percent compliant and pay no penalties. More locational deployment of load management resources would improve efficiency. With full implementation of capacity performance, demand response will be dispatched by registrations within an area for which an Emergency Action is declared by PJM. PJM does not have the nodal location of each registration, meaning PJM will need to guess as to the useful demand response registration by registered location. The MMU recommends that demand resources be required to provide their nodal location. Nodal dispatch of demand resources would be consistent with the nodal dispatch of generation.

## Definition of Compliance

PJM's reporting of load management events overstates the performance of demand side capacity resources. Limiting reported compliance to only positive values incorrectly reports compliance. Settlement locations with a negative load reduction value (load increase) are not included in compliance reporting by PJM within registrations or within demand response portfolios. A resource that has load above their PLC during a demand response event has a negative performance value. But PJM does not include the negative performance values in the net performance calculation. PJM limits reported compliance shortfall values to zero MW.

<sup>62</sup> CAA is "a geographic area of Zones or sub-Zones that are electrically contiguous and experience for the relevant Delivery Year, based on Resource Clearing Prices of, for Delivery Years through May 31, 2018, Annual Resources and for the 2018/2019 Delivery Year and subsequent Delivery Years, Capacity Performance Resources, the same locational price separation in the Base Residual Auction, the same locational price separation in the First Incremental Auction, the same locational price separation in the Second Incremental Auction, or the same locational price separation in the Third Incremental Auction." OATT § 1.

<sup>63</sup> PJM. "Manual 18: Capacity Market," § 8.7.2, Rev. 59 (June 27, 2024).

The MMU recommends that PJM correctly report compliance for demand side capacity resources to include negative values above PLC when calculating event compliance across hours and registrations.<sup>64</sup>

Demand resources that are also registered as economic resources have a calculated CBL for the emergency event days. Demand resources that are not registered as Economic Resources use the three day CBL type with the symmetrical additive adjustment for measuring energy reductions without the requirements of a Relative Root Mean Squared Error (RRMSE) Test required for all economic resources.<sup>65</sup> The CBL must use the RRMSE test to verify that it is a good approximation for real-time load usage.

The MMU recommends that PJM Manual 11 be revised to require, rather than recommend, that the RRMSE test be applied to all demand resources with a CBL.<sup>66</sup>

The CBL for a customer is an estimate of what load would have been if the customer had not responded to LMP and reduced load. The difference between the CBL and real-time load is the energy reduction. When load responds to LMP by using a behind the meter generator, the energy reduction should be capped at the generation output. Any additional energy reduction is a result of inaccuracy in the CBL estimate rather than an actual reduction. The MMU recommends capping demand reductions based entirely on behind the meter generation at the lower of economic maximum or actual generation output.

An extreme example makes clear the fundamental problems with the use of measurement and verification methods to define the level of power that would have been used but for the DR actions, and the payments to DR customers that result from these methods. The current rules for measurement and verification for demand resources make a bankrupt company, a customer that no longer exists due to closing of a facility or a permanently shut down company, or a company with a permanent reduction in peak load due to a partial closing of a facility, an acceptable demand response customer under some interpretations of the tariff, although it is the view of the MMU that such customers should not be permitted to be included as

<sup>64</sup> See "Market Monitor Report," MC Webinar <<https://pjm.com/-/media/committees-groups/committees/mc/2023/20230620-webinar/item-04---imm-report.ashx>> (Accessed July 6, 2023).

<sup>65</sup> 157 FERC ¶ 61,067 (2016).

<sup>66</sup> PJM. "Manual 11: Energy & Ancillary Services Market Operations," § 10.2.5, Rev. 133 (Dec. 17, 2024).



registered demand resources. Companies that remain in business, but with a substantially reduced load, can maintain their pre-bankruptcy FSL (firm service level to which the customer agrees to reduce in an event) commitment, which can be greater than or equal to the post-bankruptcy peak load. The customer agrees to reduce to a level which is greater than or equal to its new peak load after bankruptcy. When demand response events occur the customer would receive credit for 100 percent reduction, even though the customer took no action and could take no action to reduce load. This problem exists regardless of whether the customer is still paying for capacity. To qualify and participate as a demand resource, the customer must have the ability to reduce load. “A participant that has the ability to reduce a measurable and verifiable portion of its load, as metered on an EDC account basis.”<sup>67</sup> Such a customer no longer has the ability to reduce load in response to price or a PJM demand response event. CSPs in PJM have and continue to register bankrupt customers as emergency or pre-emergency load response customers. PJM finds acceptable the practice of CSPs maintaining the registration of customers with a bankruptcy related reduction in demand that are unable, as a result, to respond to emergency events. Three proposals that included language to remove bankrupt customers from a CSP’s portfolio failed at the June 7, 2017, Market Implementation Committee.<sup>68</sup> The registered customers that are bankrupt and the amount of registered MW cannot be released for reasons of confidentiality.

The metering requirement for demand resources is outdated, and has not kept up with the changes to PJM’s market design. PJM moved to five minute settlements, but the metering requirement for demand resources remained at an hourly interval meter. It is impossible to measure energy usage on a five minute basis using an hourly interval meter. PJM will estimate real-time usage by prorating the hourly interval meter and assume if load is less than the CBL, that the reduction occurred during the required dispatch window. The meter reading is not telemetered to PJM in real time. The resource is allowed up to 60 days to report the data to PJM. The MMU recommends that PJM adopt the ISO-NE five-minute metering requirements in order to ensure that dispatchers have the necessary information for reliability and that market payments to demand resources be

<sup>67</sup> OA Schedule 1 § 8.2.

<sup>68</sup> There was one proposal from PJM, one proposal from a market participant and one proposal from the MMU. See *Approved Minutes from the Market Implementation Committee*, <<http://www.pjm.com/-/media/committees-groups/committees/mic/20170607/20170607-minutes.ashx>>.

calculated based on interval meter data at the site of the demand reductions so that they can accurately measure compliance.<sup>69</sup>

On September 19, 2024, the Commission issued an order denying the complaint by Enerwise Global Technologies seeking to use statistical sampling for measuring demand response performance when interval metering is available.<sup>70</sup> Commissioner Chang concurred with the Commission’s determination and agreed that using actual metered interval data is the ideal method to measure and verify performance for demand-side resources. Commissioner Chang further noted that it is essential that resources that are procured and compensated in the markets actually deliver on their reliability and economic commitments.<sup>71</sup>

When demand resources are not dispatched during a mandatory response window, each CSP must test their portfolio to the levels of capacity commitment, but the testing requirements have been inadequate.<sup>72</sup> Prior to the 2023/2024 Delivery Year, the CSP must notify PJM of the intent to test 48 hours in advance of the test. A notification of intent to test was submitted in the DR Hub system. If a CSP failed to provide the required load reduction in a zone by less than 25 percent of their Summer Average RPM Commitment in the zone, the CSP was able to conduct a retest of the subset of registrations in the zone that failed. If the CSP elected to not retest a subset of registrations that failed the test, such registrations maintained the compliance result achieved in the initial test. Retesting had to be performed at the same time of day and under approximately the same weather conditions. Multiple tests could be conducted; however, one test result was submitted for each End Use Customer site in the DR Hub System for compliance evaluation. Test data needed to be submitted on or after June 1<sup>st</sup> and no later than July 14<sup>th</sup> after the start of the delivery year.

The ability of CSPs to pick the test time did not simulate emergency conditions. As a result, test compliance is not an accurate representation of the capability of the resource to respond to an actual PJM dispatch of the

<sup>69</sup> See ISO-NE Tariff, Section III, Market Rule 1, Appendix E1 and Appendix E2, “Demand Response,” <[http://www.iso-ne.com/regulatory/tariff/sect\\_3/mr1\\_append-e.pdf](http://www.iso-ne.com/regulatory/tariff/sect_3/mr1_append-e.pdf)>. (Accessed October 17, 2017) ISO-NE requires that DR have an interval meter with five-minute data reported to the ISO and each behind the meter generator is required to have a separate interval meter. After June 1, 2017, demand response resources in ISO-NE must also be registered at a single node.

<sup>70</sup> See “Order Denying Complaint re Enerwise Global Technologies, LLC v. PJM Interconnection,” EL23-104-000 (July 28, 2023).

<sup>71</sup> *Id.*, Commissioner Chang Statement Concurring at 1.

<sup>72</sup> The mandatory response time for Capacity Performance DR is June through October and the following May between 10:00AM to 10:00PM EPT and November through April between 6:00AM through 9:00PM EPT. See PJM, “Manual 18: PJM Capacity Market,” Rev. 59 (June 27, 2024).

resource. Given that demand resources are now an annual product, multiple tests are required to ensure reduction capability year round. For the 2023/2024 Delivery Year and subsequent delivery years, if a Demand Resource registration is not dispatched by PJM for a Load Management event in a delivery year, then the registration must be tested for a two-hour period between the hours of 11:00 EPT and 18:00 EPT of a non-NERC holiday weekday during June through October or November through March of the relevant delivery year, where the date and time are selected by PJM.<sup>73</sup> All registrations in a zone are tested simultaneously for two hours for each product type. Registration performance is calculated as the two hour average reduction. If less than 25 percent (by megawatts) of a CSP's total Demand Resources in a zone fail the test, the CSP may conduct re-tests limited to all registrations that failed to meet their seasonal nominated ICAP in the prior test, provided that such re-test(s) must be during the same season, at the same time of day and under approximately the same weather conditions as the prior test. If 25 percent or more (by megawatts) of a CSP's Demand Resources fail the test, the CSP may request PJM to schedule a one-time retest limited to all registrations that failed to meet their seasonal nominated ICAP in the prior test. The request must be made before the 46th day after the test. PJM will select the date and time of the retest during the same season. For the initial PJM scheduled test, PJM schedules, on an alternating basis, one test during June through October or November through March for each delivery year that a test is required. On the first business day of a week, PJM provides notice of all zones to be tested during the following two week test window. The test window opens the first business day of the week following the notice. By 10:00 EPT the day before the test, PJM posts on its website, and notifies the CSPs directly, the test date and zones.<sup>74</sup> On the test date, CSPs are notified of the start time of the test through the same notification protocol used for an actual event. For any scheduled retest by PJM, by 10:00 EPT the day before the retest, PJM will posts on its website, and notifies the CSPs directly, the retest date. On the retest date, CSPs are notified of the start time of the retest through the same notification protocol used for an event.

While the testing revisions implemented with the 2023/2024 Delivery Year are an improvement, the MMU

recommends that load management testing be initiated by PJM with advance notice to CSPs identical to the actual lead time required in an emergency in order to accurately represent the conditions of an emergency event.

Beginning in the 2024/2025 Delivery Year and subsequent delivery years, CSPs may elect to use performance data from a Load Management event that was not subject to a Non-Performance Assessment (a non-PAI LM event) as performance data for a PJM zonal test event.<sup>75</sup> Elections are made on or after June 1 and no later than July 14 after the delivery year in the DR Hub system. Data required for compliance evaluation must be submitted no later than July 14 after the delivery year. Only one event result (either test event or non-PAI LM event) for each end-use customer site will be used in the zonal test evaluation. The duration of the non-PAI LM event must be at least 30 minutes of a clock hour. The election of non-PAI LM events to be used as zonal test performance will be done at registration lead time level. The non-PAI LM event must have occurred in the same season as the PJM scheduled test. For purposes of this election, the calculated reduction value for a registration in the non-PAI LM event is the average of the registration's hourly reductions within the product period hourly window.

Table 6-19 shows the test penalties by delivery year by product type for the 2019/2020 Delivery Year through the 2023/2024 Delivery Year.<sup>76</sup> The shortfall MW are calculated for each CSP by zone. The weighted rate per MW is the average penalty rate paid per MW. The total penalty column is the sum of the daily test penalties by delivery year and type. Total Load Management Test Compliance penalties were 7.04 percent of total DR capacity revenues in the 2023/2024 Delivery Year.

<sup>73</sup> "PJM Manual 18: PJM Capacity Market," § 8.7, Rev. 59 (June 27, 2024).

<sup>74</sup> See "Demand Response Test Schedule," <<https://pjm.com/markets-and-operations/demand-response/demand-response-test-schedule>> [Accessed July 18, 2023].

<sup>75</sup> "PJM Manual 18: PJM Capacity Market," § 8.7, Rev. 59 (June 27, 2024).

<sup>76</sup> Not all products received penalties or existed in every delivery year. For example, the Base and Capacity Performance products were not an option for the 2020/2021 Delivery Year.

**Table 6-19 Test penalties by delivery year by product type: 2019/2020 through 2023/2024 Delivery Years**

Product Type	2019/2020			2020/2021			2021/2022			2022/2023			2023/2024		
	Shortfall	Rate per	Total	Shortfall	Rate per	Total	Shortfall	Rate per	Total	Shortfall	Rate per	Total	Shortfall	Rate per	Total
	MW	MW	Penalty	MW	MW	Penalty	MW	MW	Penalty	MW	MW	Penalty	MW	MW	Penalty
Limited															
Extended Summer															
Annual															
Base DR and EE	30.2	\$154.69	\$1,712,177												
Capacity Performance				0.9	\$125.30	\$39,422	23.1	\$176.79	\$1,487,430	7.1	\$97.07	\$250,346	391.4	\$56.45	\$8,087,631
Total	30.2	\$154.69	\$1,712,177	0.9	\$125.30	\$39,422	23.1	\$176.79	\$1,487,430	7.1	\$97.07	\$250,346	391.4	\$56.45	\$8,087,631

## Emergency and Pre-Emergency Load Response Energy Payments

Emergency and pre-emergency demand response dispatched during a load management event by PJM are eligible to receive emergency energy payments if registered under the full program option. The full program option includes an energy payment for load reductions during a pre-emergency or emergency event for demand response events and capacity payments.<sup>77</sup> There are 98.6 percent of nominated MW for the 2024/2025 Delivery Year registered under the full program option. There are 1.4 percent of nominated MW for the 2024/2025 Delivery Year registered as capacity only option. Demand resources clear the capacity market like all other capacity resources and the dispatch of demand resources should not trigger a scarcity event. The strike price is set by the CSP before the delivery year starts and cannot be changed during the delivery year. The demand resource energy payments are equal to the higher of hourly zonal LMP or a strike price energy offer made by the participant, including a dollar per MWh minimum dispatch price and an associated shutdown cost. Demand resources should not be permitted to offer above \$1,000 per MWh without cost justification or to include a shortage penalty in the offer. FERC has stated clearly that demand resources in the capacity market must verify costs above \$1,000 per MWh, unless they are capacity only: “We clarify, however, that reforms adopted in this Final Rule, which provide that resources are eligible to submit cost-based incremental energy offers in excess of \$1,000/MWh and require that those offers be verified, do not apply to capacity-only demand response resources that do not submit incremental energy offers in energy markets.”<sup>78</sup> PJM interprets the scarcity pricing rules to allow a maximum DR energy price of \$1,849 per MWh for the 2021/2022 Delivery

Year.<sup>79</sup> <sup>80</sup> Demand resources registered with the full option should be required to verify energy offers in excess of \$1,000 per MWh. PJM does not require such verification.<sup>81</sup> The MMU recommends that the maximum offer for demand resources be the same as the maximum offer for generation resources and that the same cost verification rules applied to generation resources apply to demand resources.

Shutdown costs for demand response resources are not adequately defined in Manual 15. PJM's Cost Development Subcommittee (CDS) approved changes to Manual 15 to eliminate shutdown costs for demand response resources participating in the synchronized reserve market, but not demand resources or economic resources.<sup>82</sup>

Table 6-20 shows the distribution of registrations and associated MW in the emergency full option across ranges of minimum dispatch prices for the 2023/2024 Delivery Year. The majority of participants, 83.0 percent of locations and 52.3 percent of nominated MW, had a minimum dispatch price between \$1,550 and \$1,849 per MWh, the maximum price allowed for the 2023/2024 Delivery Year. Almost all registrations, 99.7 percent of locations and 98.4 percent of nominated MW have a dispatch price above \$1,000 per MWh. The shutdown cost of resources with \$1,000 to \$1,275 per MWh strike prices had the highest average at \$123.20 per location and \$98.07 per nominated MW.

<sup>79</sup> 139 FERC ¶ 61,057 (2012).

<sup>80</sup> FERC accepted proposed changes to have the maximum strike price for 30 minute demand response to be \$1,000/MWh + 1\*Shortage penalty - \$1.00, for 60 minute demand response to be \$1,000/MWh + (Shortage Penalty/2) and for 120 minute demand response to be \$1,100/MWh from ER14-822-000.

<sup>81</sup> OATT Attachment K Appendix Section 1.10.1A Day-Ahead Energy Market Scheduling [d] (x).

<sup>82</sup> “PJM Manual 15: Cost Development Guidelines,” § 8.1, Rev. 45 (September 1, 2024).

<sup>77</sup> *Id.*

<sup>78</sup> 161 FERC ¶ 61,153 at P 8 (2017).

**Table 6-20 Distribution of registrations and associated MW in the full option across ranges of minimum dispatch: 2023/2024 Delivery Year**

Ranges of Strike Prices (\$/MWh)	Locations	Percent of Total	Nominated MW (ICAP)	Percent of Total	Shutdown Cost per Location	Shutdown Cost Per Nominated MW (ICAP)
\$0-\$1,000	48	0.3%	120.6	1.6%	\$4.17	\$1.66
\$1,000-\$1,275	2,458	14.3%	3,087.8	40.9%	\$123.20	\$98.07
\$1,275-\$1,550	320	1.9%	395.6	5.2%	\$4.83	\$3.91
\$1,550-\$1,849	14,385	83.6%	3,951.3	52.3%	\$15.14	\$55.11
Total	17,211	100.0%	7,555.2	100.0%	\$30.35	\$69.14

Table 6-21 shows the distribution of registrations and associated MW in the emergency full option across ranges of minimum dispatch prices for the 2024/2025 Delivery Year. The majority of participants, 83.3 percent of locations and 52.8 percent of nominated MW, have a minimum dispatch price between \$1,550 and \$1,849 per MWh, the maximum price allowed for the 2024/2025 Delivery Year. Almost all registrations, 99.7 percent of locations and 98.1 percent of nominated MW have a dispatch price above \$1,000 per MWh. The shutdown cost of resources with \$1,000 to \$1,275 per MWh strike prices have the highest average at \$137.68 per location and \$109.04 per nominated MW.

**Table 6-21 Distribution of registrations and associated MW in the full option across ranges of minimum dispatch: 2024/2025 Delivery Year**

Ranges of Strike Prices (\$/MWh)	Locations	Percent of Total	Nominated MW (ICAP)	Percent of Total	Shutdown Cost per Location	Shutdown Cost Per Nominated MW (ICAP)
\$0-\$1,000	49	0.3%	132.6	1.9%	\$7.14	\$2.64
\$1,000-\$1,275	2,324	14.3%	2,934.2	41.2%	\$137.68	\$109.04
\$1,275-\$1,550	340	2.1%	293.6	4.1%	\$0.31	\$0.36
\$1,550-\$1,849	13,534	83.3%	3,755.3	52.8%	\$15.37	\$55.40
Total	16,247	100.0%	7,115.8	100.0%	\$32.53	\$74.27

## PRD

Price Responsive Demand, or PRD, in the capacity market is capacity based on a firm commitment to reduce load in response to a defined level of real-time energy prices. A PRD offer is a commitment to reduce energy usage by a defined amount in response to real time energy prices during the delivery year. A PRD offer includes MW quantities that the seller will reduce at defined capacity market reservation prices (\$/MW-day). PRD offers change the shape of the VRR Curves used in the capacity market auctions.

PRD is provided by a PJM member that represents retail customers that have the ability to reduce load

in response to price. In order to be eligible as PRD, the End Use Customer load must be served under a dynamic retail rate or contractual arrangement linked to, or based upon, a PJM real-time LMP trigger at a substation as electrically close as practical to the applicable load. End Use Customer loads identified may not sell any other form of demand side management in PJM markets.

PRD must also be curtailed once PJM has declared a Performance Assessment Interval but only if the real-time LMP at the applicable location meets or exceeds the price on the submitted PRD curve at which the load has committed to curtail. The high PRD strike prices mean that PRD could avoid a performance requirement even during a PAI.

In order to commit PRD for a delivery year, a PRD Provider must submit a PRD Plan in advance of the Base Residual Auction which indicates the Nominal PRD Value in MW that the PRD Provider is willing to commit at different reservation prices expressed in (\$/MW-day). Additional PRD may participate in the Third Incremental

Auction only if the LDA final peak load forecast for the delivery year increases relative to the LDA preliminary peak load forecast used for the Base Residual Auction.

Unlike other capacity resources, once committed, PRD may not be uncommitted or replaced by available capacity resources or Excess Commitment Credits. A PRD Provider may transfer the PRD obligation to another PRD Provider bilaterally. The PRD Provider will receive a Daily PRD Credit (\$/MW-day) during the delivery year. A PRD Provider under the FRR Alternative will not be eligible to receive a Daily PRD Credit (\$/MW-day) during the delivery year. PRD first cleared the capacity market in the BRA for the 2020/2021 Delivery Year.<sup>83</sup> Table 6-22 shows the Nominated MW of Price Responsive Demand for the 2020/2021 through 2024/2025 Delivery Years.

<sup>83</sup> There were a total of 558 MW of cleared PRD in the 2020/2021 Delivery Year. See PJM Auction Results, <<https://www.pjm.com/-/media/markets-ops/rpm/rpm-auction-info/2020-2021-base-residual-auction-results.ashx?la=en>>.

**Table 6-22 Nominated MW of price responsive demand: 2020/2021 through 2024/2025 Delivery Years**

Delivery Year	RTO	MAAC	EMAAC	SWMAAC	DPL		
					SOUTH	PEPCO	BGE
2020/2021	558.0	558.0	58.0	500.0	27.0	170.0	330.0
2021/2022	510.0	510.0	75.0	435.0	35.7	195.0	240.0
2022/2023	230.0	230.0	40.0	190.0	19.6	110.0	80.0
2023/2024	235.0	235.0	38.0	197.0	15.4	110.0	87.0
2024/2025	305.0	305.0	35.0	270.0	13.0	110.0	160.0

PRD is included on the supply side of RPM auctions. The cleared PRD is credited the adjusted zonal clearing price of the LDA in which they cleared. The PRD credits are charged to the load of those LDAs by inclusion in the RPM net load price. A PRD Provider receives a PRD Credit for each approved Price Responsive Demand registration on a given day. PRD Credits are determined as:<sup>84</sup>

*PRD Credit = [(Share of Zonal Nominal PRD Value committed in Base Residual Auction \* (Zonal Weather-Normalized Peak Load for the summer concluding prior to the commencement of the Delivery Year / Final Zonal Peak Load Forecast for the Delivery Year) \* Final Zonal RPM Scaling Factor \* FPR \* Final Zonal Capacity Price)*

*plus*

*(Share of Zonal Nominal PRD Value committed in Third Incremental Auction \* (Zonal Weather-Normalized Peak Load for the summer concluding prior to the commencement of the Delivery Year / Final Zonal Peak Load Forecast for the Delivery Year) \* Final Zonal RPM Scaling Factor \* FPR \* Final Zonal Capacity Price \* Third Incremental Auction Component of Final Zonal Capacity Price stated as a Percentage)]*

Effective with the 2022/2023 Delivery Year, the factor equal to (Zonal Weather-Normalized Peak Load for the summer concluding prior to the commencement of the Delivery Year / Final Zonal Peak Load Forecast for the delivery year) is eliminated in the calculation of the PRD Credit.

Table 6-23 shows the PRD Credits for the 2020/2021 through 2024/2025 Delivery Years.<sup>85</sup>

**Table 6-23 PRD Credits: 2020/2021 through 2024/2025 Delivery Years**

Delivery Year	PRD Credit
2020/2021	\$23,649,865.05
2021/2022	\$38,282,769.14
2022/2023	\$10,702,158.12
2023/2024	\$6,169,725.27
2024/2025	\$6,617,255.24

A PRD Provider with a daily commitment compliance shortfall in a subzone/zone for RPM or FRR is assessed a Daily PRD Commitment Compliance Penalty. The Daily PRD Commitment Compliance Penalty is determined as:

$$\begin{aligned}
 &\text{PRD Commitment Compliance Penalty} \\
 &= \text{MW shortfall in the Sub - zone / Zone} \\
 &\quad * \text{Delivery Year Forecast Pool Requirement} \\
 &\quad * \text{PRD Commitment Compliance Penalty Rate}
 \end{aligned}$$

The revenue collected from assessment of the PRD Commitment Compliance Penalty is distributed to all entities that committed Capacity Resources in the RPM Auctions for the relevant delivery year, based on each entity's prorata share of daily revenues from Capacity Market Clearing Prices in such auctions, net of any daily compliance charges incurred by such entity.

PRD committed in RPM for the current delivery year bids in the PJM Energy Market. PRD Curves may be submitted by PRD Providers in the PJM Energy Market by 1100 at the closing of the day-ahead bid period. PRD Curves submitted

<sup>84</sup> PJM, "Manual 18: Capacity Market," § 9.4.4, Rev. 59 (June 27, 2024).

<sup>85</sup> The total credits for PRD were downloaded as of January 16, 2025, and may change as a result of continued PJM billing updates.



by PRD Providers are identified in the day-ahead market software and user interface. PRD bids are modeled in the real-time energy market only, and are modeled in the real-time dispatch algorithms. PRD curves are not modeled in the day-ahead market clearing process. PRD Curves in the energy market are modeled in the real-time dispatch algorithms and can set real-time LMP. PRD Providers with committed PRD are required to have automation of PRD that is needed to respond to real-time LMPs for the PRD Curves that are submitted. The maximum bid price of the PRD Curve is the applicable energy market offer cap. When PRD sellers offer at the cap, they limit the number of times that PRD is called on to respond.

On February 7, 2019, PJM filed revisions to its Open Access Transmission Tariff and the Reliability Assurance Agreement to update the rules and requirements for PRD to conform to those for Capacity Performance Resources.<sup>86</sup> PJM's filing sought to change the calculation of the Nominal PRD Value used for determining the PRD Credit from the reduction in load during PJM's annual peak to the lesser of summer and winter load reductions. The proposed changes were intended to ensure that PRD will be available to curtail the same quantity of MW in either the summer or the winter consistent with the requirements of Capacity Performance Resources. In an order issued June 27, 2019, the Commission rejected PJM's proposal finding that it was unjust and unreasonable to calculate the Nominal PRD Value in a manner inconsistent with how an LSE's capacity obligation is determined, and therefore saw no need for consistency between the PRD requirements and the requirements for capacity resources.<sup>87</sup> While treated as an annual product, PRD resources are largely comprised of utility retail programs designed to reduce electric load during periods of high load and/or high wholesale energy prices during the summer season. PRD resources consequently performed poorly when called upon during Winter Storm Elliott.<sup>88</sup>

The PRD rules fall short of defining an effective and efficient product that is aligned with the definition of a capacity resource.<sup>89</sup> PJM's initial filing was rejected by the Commission based on the MMU's comments and

PJM's modified filing was accepted.<sup>90</sup> PJM's final filing adopted the MMU's recommendation to exclude the use of Winter Peak Load (WPL) when calculating the nominated MW for PRD resources used to satisfy RPM commitments. Load is allocated capacity obligations based on the annual peak load within PJM. The amount of capacity allocated to load is a function solely of summer coincident peak demand and is unaffected by winter demand. Use of the WPL to calculate the nominated MW for PRD resources to satisfy RPM commitments, would incorrectly restrict PRD to less than the total capacity the customer is required to buy. PJM's adoption of the MMU recommendation correctly values PRD nominated MW. FERC required and PJM's filing also adopted the MMU's recommendation that PRD should be eligible for bonus performance payments during Performance Assessment Intervals (PAI) only when PRD resources respond above their nominated MW value. Allowing PRD resources to collect bonus payments at times when they are not even required to meet their basic obligation would be inconsistent with the basic CP construct as it applies to all other CP resources.<sup>91</sup>

PJM's filing still fell short of completely aligning PRD with the definition of capacity. PRD resources do not have to respond during a PAI if the PRD's trigger price is above LMP during the PAI. All other CP resources have the obligation to perform during a PAI, regardless of the real-time LMP, subject to instructions from PJM. PRD should be held to the same standard during a PAI event. The MMU recommends that PRD be required to respond during a PAI, regardless of whether the real-time LMP at the applicable location meet or exceeds the PRD strike price, to be consistent with all CP resources.

## Economic Load Response Program

The Economic Load Response Program is for demand response customers that offer into the day-ahead or real-time energy market. The estimated load reduction is paid the zonal LMP, as long as the zonal LMP is greater than the monthly Net Benefits Test threshold.

## Market Structure

Table 6-24 shows the average hourly HHI for each month and the average hourly HHI for January 1, 2023, through December 31, 2024. The ownership of economic demand response resources was highly concentrated in

<sup>86</sup> See "Proposed Amendments to Price Response Demand Rules", Docket No. ER19-1012-000 (Feb. 7, 2019).

<sup>87</sup> 167 FERC ¶ 61,268

<sup>88</sup> See the 2023 Quarterly State of the Market Report for PJM: January through June, Section 6: Demand Response, Table 6-49.

<sup>89</sup> See "Compliance Filing Regarding Price Responsive Demand Rules," Docket No. ER20-271-001 (February 28, 2020).

<sup>90</sup> See "Order Rejecting Tariff Revisions," Docket No. ER19-1012-000 (June 27, 2019).

<sup>91</sup> October 31 Filing, Attachment B, Proposed Revised OATT § 10A (c).

2023 and 2024.<sup>92</sup> Table 6-24 lists the share of reported reductions provided by, and the share of credits claimed by the four largest CSPs in each year. The HHI for economic demand response was highly concentrated in 2024. The HHI for economic demand response in 2024 decreased by 510, 5.5 percent, from 9241 in 2023 to 8731 in 2024.

**Table 6-24 Average hourly MWh HHI and market concentration in the economic program: 2023 and 2024<sup>93</sup>**

Month	Average Hourly MWh HHI			Top Four CSPs Share of Reduction			Top Four CSPs Share of Credit		
	2023	2024	Percent Change	2023	2024	Change in Percent	2023	2024	Change in Percent
Jan	9953	9043	(9.1%)		100.0%			100.0%	
Feb	8425	8806	4.5%	100.0%			100.0%		
Mar	9987	9856	(1.3%)	100.0%			100.0%		
Apr	9868	9566	(3.1%)	99.7%	100.0%	0.3%	99.9%	100.0%	0.1%
May	9778	9722	(0.6%)	100.0%	100.0%	0.0%	100.0%	100.0%	0.0%
Jun	9703	8405	(13.4%)	100.0%	99.8%	(0.2%)	100.0%	99.7%	(0.3%)
Jul	8715	8249	(5.3%)	99.7%	99.6%	(0.1%)	99.8%	99.4%	(0.4%)
Aug	8716	7913	(9.2%)	96.9%	99.9%	3.0%	97.9%	99.8%	1.8%
Sep	8788	8052	(8.4%)	92.7%			95.2%		
Oct	9400	8568	(8.9%)	100.0%			100.0%		
Nov	8121	9084	11.9%	100.0%			100.0%		
Dec	7745	9999	29.1%	100.0%			100.0%		
Total	9241	8731	(5.5%)	98.0%	99.9%	1.9%	97.5%	99.8%	2.2%

## Market Performance

Table 6-25 shows the total MW reported reductions made by participants in the economic program and the total credits paid for these reported reductions in 2010 through 2024. The average credits per MWh paid decreased by \$13.35 per MWh, 21.0 percent, from \$63.46 per MWh in 2023 to \$50.12 per MWh in 2024. The average LMP during load response decreased by \$4.01 per MWh, 8.0 percent, from \$50.32 per MWh in 2023 to \$46.31 per MWh in 2024. Curtailed energy for the economic program was 220,288 MWh in 2024, an increase of 163,984 MWh, 291.3 percent, as compared to curtailed energy for the economic program in 2023. Total credits paid for the economic load response program in 2024 were \$11,040,359, an increase of \$7,467,161, 209.0 percent, compared to the total credits paid for the economic load response program in 2023.

**Table 6-25 Credits paid to economic program participants: 2010 through 2024**

	Total MWh	Total Credits	\$/MWh
2010	72,757	\$3,088,049	\$42.44
2011	17,398	\$2,052,996	\$118.00
2012	144,285	\$9,278,942	\$64.31
2013	133,963	\$8,711,873	\$65.03
2014	146,301	\$17,820,063	\$121.80
2015	121,129	\$7,983,488	\$65.91
2016	81,908	\$3,550,535	\$43.35
2017	62,622	\$2,709,335	\$43.27
2018	49,441	\$2,548,575	\$51.55
2019	24,595	\$979,266	\$39.82
2020	9,425	\$329,119	\$34.92
2021	18,851	\$1,163,113	\$61.70
2022	103,645	\$10,893,489	\$105.10
2023	56,303	\$3,573,199	\$63.46
2024	220,288	\$11,040,359	\$50.12

Economic demand response resources that are dispatched by PJM in both the economic and emergency programs are paid the higher price defined in the emergency rules.<sup>94</sup> For example, assume a demand resource has an economic offer price of \$100 per MWh and an emergency strike price of \$1,800 per MWh. If this resource were scheduled to reduce in the day-ahead energy market, the demand resource would receive \$100 per MWh, but if an emergency event were called during the economic dispatch, the demand resource would receive its emergency strike price of \$1,800 per

<sup>92</sup> All HHI calculations in this section are at the parent company level.

<sup>93</sup> January 2023, February 2024, March 2024 and June 2024 reduction and credit share values are not reported based on confidentiality rules.

<sup>94</sup> "PJM. Manual 11: Energy & Ancillary Services Market Operations," § 10.4.5, Rev. 133 (Dec. 17, 2024).

MWh instead. The rationale for this rule is not clear.<sup>95</sup> All other resources that clear in the day-ahead market are financially firm at the clearing price. Payment at a guaranteed strike price and the ability to set energy market prices at the strike price effectively grant the seller the right to exercise market power.

Figure 6-2 shows monthly economic demand response credits and MWh, from January 1, 2010, through December 31, 2024.

**Figure 6-2 Economic program credits and MWh by month: 2010 through 2024**

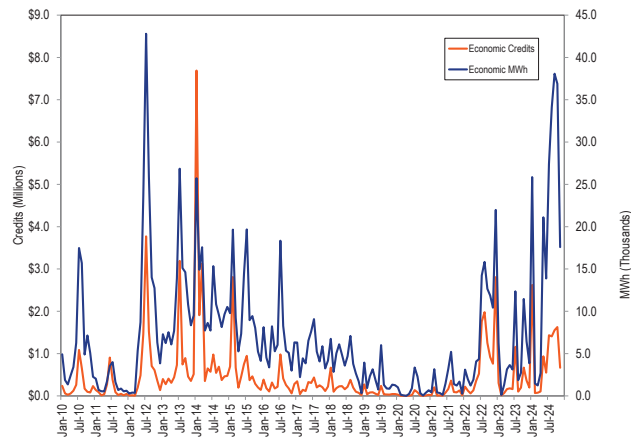


Table 6-26 shows performance for 2023 and 2024 in the economic program by control zone. Total reported reductions under the economic program increased by 163,984 MWh, 291.3 percent, from 56,303 MWh in 2023 to 220,288 MWh in 2024. Total revenue under the economic program increased by \$7.5 million, 209.0 percent, from \$3.6 million in 2023 to \$11.0 million in 2024.<sup>96</sup>

Emergency and economic demand response energy payments are uplift and not compensated by LMP revenues. Economic demand response energy costs are assigned to real-time exports from the PJM Region and real-time loads in each zone for which the load-weighted average real-time LMP for the hour during which the reduction occurred is greater than the price determined under the net benefits test for that month.<sup>97</sup> The zonal allocation is shown in Table 6-26.

<sup>95</sup> *Offer Caps in Markets Operated by Regional Transmission Organizations and Independent System Operators*, Order No. 831, 157 FERC ¶ 61,115 (2016) ("Order No. 831").

<sup>96</sup> Economic demand response reductions that are submitted to PJM for payment but have not received payment are not included in Table 6-26. Payments for Economic demand response reductions are settled monthly.

<sup>97</sup> "PJM Manual 28: Operating Agreement Accounting," § 11.2.2, Rev. 98 (Dec. 17, 2024).

Table 6-26 Economic program participation by zone: 2023 and 2024

		Credits			MWh Reductions			Credits per MWh Reduction		
Zones	Zones	2023	2024	Percent Change	2023	2024	Percent Change	2023	2024	Percent Change
AECO	ACEC	\$0.00	\$0.00	NA	0	0	NA	NA	NA	NA
AEP	AEP	\$224,557.66	\$4,273,259.26	1,803.0%	3,179	101,162	3,081.7%	\$70.63	\$42.24	(40.2%)
APS	APS	\$145,448.57	\$438,922.33	201.8%	1,842	11,276	512.0%	\$78.94	\$38.92	(50.7%)
ATSI	ATSI	\$304,116.50	\$1,416,127.36	365.7%	1,617	11,930	637.9%	\$188.09	\$118.70	(36.9%)
BGE	BGE	\$68,182.13	\$0.00	NA	892	0	NA	\$76.40	NA	NA
COMED	COMED	\$23,778.94	\$22,490.51	(5.4%)	758	691	(8.8%)	\$31.38	\$32.55	3.7%
DAY	DAY	\$0.00	\$0.00	NA	0	0	NA	NA	NA	NA
DEOK	DUKE	\$0.00	\$0.00	NA	0	0	NA	NA	NA	NA
DUQ	DUQ	\$2,684,988.22	\$4,620,879.65	72.1%	46,734	93,062	99.1%	\$57.45	\$49.65	(13.6%)
DOM	DOM	\$0.00	\$6,587.42	NA	0	71	NA	NA	\$92.76	NA
DPL	DPL	\$49,516.88	\$50,485.49	2.0%	271	149	(45.1%)	\$182.49	\$339.04	85.8%
JCPL	JCPLC	\$0.00	\$0.00	NA	0	0	NA	NA	NA	NA
METED	MEC	\$12,718.05	\$23,149.54	82.0%	159	275	72.4%	\$79.80	\$84.24	5.6%
OVEC	OVEC	\$0.00	\$0.00	NA	0	0	NA	NA	NA	NA
PECO	PECO	\$13,547.97	\$29,407.74	117.1%	226	467	106.2%	\$59.83	\$63.00	5.3%
PENELEC	PE	\$0.00	\$15,295.92	NA	0	119	NA	NA	\$128.04	NA
PEPCO	PEPCO	\$0.00	\$0.00	NA	0	0	NA	NA	NA	NA
PPL	PPL	\$30,875.02	\$135,400.42	338.5%	394	938	137.9%	\$78.29	\$144.30	84.3%
PSEG	PSEG	\$15,468.71	\$8,353.59	(46.0%)	229	147	(36.0%)	\$67.48	\$56.97	(15.6%)
REC	REC	\$0.00	\$0.00	NA	0	0	NA	NA	NA	NA
Total	Total	\$3,573,198.66	\$11,040,359.24	209.0%	56,303	220,288	291.3%	\$63.46	\$50.12	(21.0%)

Table 6-27 shows average reported MWh reductions and credits by hour for 2023 and 2024. The average LMP during Load Response is the reduction weighted average hourly DA or RT load weighted LMP during the economic load response hour. In 2023, 81.6 percent of the reported reductions and 83.9 percent of credits occurred in hours ending 0900 EPT to 2100 EPT, and in 2024, 70.1 percent of the reported reductions and 72.3 percent of credits occurred in hours ending 0900 EPT to 2100 EPT. The average LMP during load response decreased by \$4.01 per MWh, 8.0 percent, from \$50.32 per MWh in 2023 to \$46.31 per MWh in 2024.

Table 6-27 Hourly frequency distribution of economic program reported MWh reductions and credits: 2023 and 2024

Hour Ending (EPT)	MWh Reductions			Program Credits			Average LMP during Load Response		
	2023	2024	Percent Change	2023	2024	Percent Change	2023	2024	Percent Change
1 through 6	1,272	16,694	1,212%	\$61,595	\$800,315	1,199%	\$68.27	\$38.79	(43%)
7	3,237	8,750	170%	\$182,735	\$425,880	133%	\$64.79	\$42.67	(34%)
8	3,808	10,918	187%	\$243,494	\$642,832	164%	\$63.75	\$49.56	(22%)
9	2,074	7,843	278%	\$111,608	\$354,107	217%	\$44.99	\$38.53	(14%)
10	1,228	8,061	556%	\$55,917	\$339,568	507%	\$35.39	\$36.21	2%
11	1,323	8,760	562%	\$56,882	\$368,058	547%	\$36.25	\$36.66	1%
12	1,374	9,593	598%	\$59,590	\$404,499	579%	\$38.93	\$38.44	(1%)
13	1,213	10,383	756%	\$59,429	\$451,036	659%	\$40.08	\$39.64	(1%)
14	1,764	10,761	510%	\$110,954	\$493,129	344%	\$44.90	\$41.94	(7%)
15	2,741	10,825	295%	\$191,738	\$521,424	172%	\$50.56	\$44.75	(11%)
16	3,961	11,298	185%	\$287,980	\$559,090	94%	\$55.88	\$46.43	(17%)
17	6,079	13,651	125%	\$442,713	\$771,468	74%	\$62.65	\$52.84	(16%)
18	8,174	16,652	104%	\$616,211	\$1,077,820	75%	\$67.11	\$62.27	(7%)
19	7,220	16,669	131%	\$501,145	\$1,044,477	108%	\$60.10	\$58.24	(3%)
20	5,263	16,182	207%	\$325,108	\$941,238	190%	\$50.61	\$52.75	4%
21	3,542	13,727	288%	\$178,883	\$659,574	269%	\$43.77	\$44.47	2%
22	1,338	12,250	816%	\$59,763	\$537,122	799%	\$37.89	\$40.49	7%
23 through 24	691	17,269	2,399%	\$27,455	\$648,722	2,263%	\$39.79	\$68.93	73%
Total	56,303	220,288	291%	\$3,573,199	\$11,040,359	209%	\$50.32	\$46.31	(5%)

Table 6-28 shows the distribution of economic program reported MWh reductions and credits by ranges of real-time zonal load-weighted average LMP in 2023 and 2024. In 2024, 0.7 percent of reported MWh reductions and 3.2 percent of program credits occurred during hours when the applicable zonal LMP was higher than \$175 per MWh.

**Table 6-28 Frequency distribution of economic program zonal load-weighted average LMP (By hours): 2023 and 2024**

LMP	MWh Reductions			Program Credits		
	2023	2024	Percent Change	2023	2024	Percent Change
\$0 to \$25	2,151	16,662	675%	\$85,373	\$365,792	328%
\$25 to \$50	33,143	133,446	303%	\$1,887,970	\$4,869,999	158%
\$50 to \$75	12,732	40,904	221%	\$916,379	\$2,444,416	167%
\$75 to \$100	3,377	10,955	224%	\$292,945	\$922,799	215%
\$100 to \$125	1,962	6,999	257%	\$172,415	\$755,637	338%
\$125 to \$150	560	7,109	1,170%	\$38,584	\$930,005	2,310%
\$150 to \$175	123	2,604	2,014%	\$11,223	\$393,060	3,402%
> \$175	1,462	1,610	10%	\$168,311	\$358,650	113%
Total	55,509	220,288	297%	\$3,573,199	\$11,040,359	209%

Economic Load Response revenues are paid by real-time loads and real-time scheduled exports as an uplift charge. Table 6-29 shows the sum of real-time and day-ahead Economic Load Response charges paid in each zone and paid by exports. In 2024, AEP Zone has paid the highest Economic Load Response charges.

**Table 6-29 Zonal Economic Load Response charge: 2024<sup>98</sup>**

Zone	January	February	March	April	May	June	July	August	September	October	November	Total
AECO	\$26,203	\$609	\$787	\$1,048	\$8,670	\$7,231	\$20,905	\$19,126	\$17,404	\$19,224	\$7,488	\$128,698
AEP	\$407,534	\$11,330	\$12,683	\$16,289	\$158,280	\$82,379	\$202,031	\$207,599	\$247,617	\$264,437	\$103,352	\$1,713,531
APS	\$160,379	\$4,559	\$5,025	\$6,511	\$56,795	\$30,614	\$79,846	\$76,594	\$87,774	\$96,543	\$39,596	\$644,236
ATSI	\$192,666	\$5,509	\$6,330	\$8,457	\$82,343	\$43,730	\$109,011	\$110,913	\$132,351	\$128,490	\$53,838	\$873,637
BGE	\$97,936	\$2,777	\$2,973	\$4,207	\$35,707	\$21,379	\$59,052	\$52,329	\$56,653	\$58,645	\$24,287	\$415,946
COMED	\$277,936	\$6,271	\$5,932	\$7,668	\$98,419	\$58,101	\$145,788	\$157,067	\$181,248	\$159,870	\$54,953	\$1,153,253
DAY	\$55,190	\$1,481	\$1,694	\$2,284	\$22,162	\$11,790	\$28,153	\$30,219	\$35,442	\$35,696	\$14,062	\$238,174
DUKE	\$84,228	\$2,151	\$2,469	\$3,530	\$34,307	\$18,412	\$43,646	\$46,687	\$54,401	\$52,421	\$19,843	\$362,094
DUQ	\$36,233	\$1,028	\$1,197	\$1,731	\$17,150	\$9,347	\$24,090	\$23,451	\$26,646	\$25,924	\$10,622	\$177,420
DOM	\$364,869	\$11,008	\$11,583	\$16,954	\$147,079	\$81,035	\$211,069	\$200,618	\$232,698	\$251,083	\$100,590	\$1,628,587
DPL	\$55,071	\$1,004	\$1,683	\$1,843	\$14,175	\$12,571	\$34,832	\$31,308	\$28,755	\$34,964	\$14,016	\$230,222
EKPC	\$60,738	\$1,424	\$1,564	\$1,796	\$15,847	\$8,920	\$21,649	\$22,612	\$24,497	\$27,086	\$10,783	\$196,916
JCPLC	\$60,806	\$1,502	\$1,810	\$2,276	\$22,433	\$16,622	\$48,388	\$41,525	\$39,166	\$41,710	\$17,132	\$293,371
MEC	\$46,031	\$1,359	\$1,388	\$1,533	\$16,229	\$8,470	\$24,960	\$24,095	\$25,915	\$29,667	\$11,852	\$191,499
OVEC	\$352	\$11	\$13	\$13	\$112	\$50	\$123	\$146	\$192	\$239	\$97	\$1,348
PECO	\$104,280	\$1,819	\$3,234	\$4,072	\$32,836	\$26,170	\$72,505	\$63,811	\$59,238	\$73,412	\$29,282	\$470,660
PE	\$49,966	\$1,510	\$1,709	\$2,083	\$20,226	\$10,256	\$26,651	\$25,952	\$30,937	\$34,615	\$14,070	\$217,975
PEPCO	\$88,680	\$2,522	\$2,691	\$3,911	\$33,970	\$19,813	\$54,090	\$48,328	\$53,531	\$55,078	\$22,324	\$384,940
PPL	\$128,000	\$3,611	\$4,131	\$3,865	\$40,168	\$20,995	\$65,553	\$60,742	\$63,981	\$80,243	\$32,758	\$504,046
PSEG	\$115,228	\$2,839	\$3,454	\$4,540	\$43,551	\$29,837	\$85,103	\$75,231	\$77,488	\$84,359	\$33,609	\$555,240
REC	\$3,508	\$98	\$117	\$158	\$1,740	\$1,158	\$3,299	\$2,733	\$2,717	\$2,756	\$1,105	\$19,390
Exports	\$205,800	\$3,132	\$3,138	\$8,960	\$33,993	\$31,640	\$73,016	\$84,892	\$75,144	\$69,704	\$49,754	\$639,174
Total	\$2,621,636	\$67,555	\$75,606	\$103,731	\$936,194	\$550,521	\$1,433,761	\$1,405,979	\$1,553,796	\$1,626,169	\$665,413	\$11,040,359

<sup>98</sup> Load response charges were downloaded as of January 16, 2025, and may change as a result of continued PJM billing updates.



Table 6-30 shows the total zonal Economic Load Response charge per GWh of real-time load and exports in 2024.

**Table 6-30 Zonal economic load response charge per GWh of load and exports: 2024**

Zone	January	February	March	April	May	June	July	August	September	October	November	Zonal Average
ACEC	\$0.032	\$0.001	\$0.001	\$0.002	\$0.012	\$0.007	\$0.018	\$0.018	\$0.022	\$0.029	\$0.011	\$0.014
AEP	\$0.034	\$0.001	\$0.001	\$0.002	\$0.016	\$0.007	\$0.017	\$0.018	\$0.025	\$0.027	\$0.010	\$0.014
APS	\$0.034	\$0.001	\$0.001	\$0.002	\$0.016	\$0.008	\$0.018	\$0.018	\$0.025	\$0.028	\$0.011	\$0.015
ATSI	\$0.032	\$0.001	\$0.001	\$0.002	\$0.016	\$0.007	\$0.017	\$0.018	\$0.025	\$0.026	\$0.011	\$0.014
BGE	\$0.034	\$0.001	\$0.001	\$0.002	\$0.016	\$0.008	\$0.018	\$0.018	\$0.025	\$0.028	\$0.011	\$0.015
COMED	\$0.034	\$0.001	\$0.001	\$0.001	\$0.014	\$0.007	\$0.016	\$0.017	\$0.024	\$0.024	\$0.008	\$0.013
DAY	\$0.034	\$0.001	\$0.001	\$0.002	\$0.016	\$0.008	\$0.017	\$0.019	\$0.025	\$0.028	\$0.011	\$0.015
DUKE	\$0.035	\$0.001	\$0.001	\$0.002	\$0.016	\$0.008	\$0.017	\$0.018	\$0.025	\$0.028	\$0.011	\$0.015
DUQ	\$0.031	\$0.001	\$0.001	\$0.002	\$0.016	\$0.008	\$0.017	\$0.018	\$0.025	\$0.027	\$0.011	\$0.014
DOM	\$0.033	\$0.001	\$0.001	\$0.002	\$0.015	\$0.007	\$0.018	\$0.018	\$0.024	\$0.027	\$0.011	\$0.014
DPL	\$0.032	\$0.001	\$0.001	\$0.002	\$0.011	\$0.008	\$0.018	\$0.018	\$0.021	\$0.028	\$0.011	\$0.013
EKPC	\$0.039	\$0.001	\$0.001	\$0.002	\$0.016	\$0.008	\$0.017	\$0.018	\$0.025	\$0.028	\$0.010	\$0.015
JCPLC	\$0.032	\$0.001	\$0.001	\$0.002	\$0.014	\$0.008	\$0.019	\$0.018	\$0.024	\$0.028	\$0.011	\$0.014
MEC	\$0.000	\$0.000	\$0.000	\$0.000	\$0.000	\$0.000	\$0.000	\$0.000	\$0.000	\$0.000	\$0.000	\$0.000
OVEC	\$0.028	\$0.001	\$0.001	\$0.002	\$0.014	\$0.006	\$0.014	\$0.016	\$0.022	\$0.026	\$0.010	\$0.013
PECO	\$0.030	\$0.001	\$0.001	\$0.002	\$0.011	\$0.007	\$0.018	\$0.017	\$0.020	\$0.027	\$0.011	\$0.013
PE	\$0.033	\$0.001	\$0.001	\$0.002	\$0.015	\$0.007	\$0.017	\$0.018	\$0.024	\$0.027	\$0.011	\$0.014
PEPCO	\$0.034	\$0.001	\$0.001	\$0.002	\$0.016	\$0.008	\$0.018	\$0.018	\$0.025	\$0.028	\$0.011	\$0.015
PPL	\$0.033	\$0.001	\$0.001	\$0.001	\$0.013	\$0.006	\$0.017	\$0.017	\$0.022	\$0.028	\$0.011	\$0.014
PSEG	\$0.032	\$0.001	\$0.001	\$0.002	\$0.013	\$0.007	\$0.018	\$0.018	\$0.023	\$0.028	\$0.011	\$0.014
REC	\$0.031	\$0.001	\$0.001	\$0.002	\$0.015	\$0.008	\$0.019	\$0.019	\$0.025	\$0.028	\$0.011	\$0.014
Exports	\$0.039	\$0.001	\$0.001	\$0.003	\$0.011	\$0.006	\$0.018	\$0.018	\$0.019	\$0.024	\$0.016	\$0.014
Monthly Average	\$0.032	\$0.001	\$0.001	\$0.002	\$0.014	\$0.007	\$0.017	\$0.017	\$0.022	\$0.026	\$0.011	\$0.014

Table 6-31 shows the monthly day-ahead and real-time Economic Load Response charges for 2023 and 2024. The day-ahead Economic Load Response charges increased by \$7.4 million, 220.6 percent, from \$3.4 million in 2023 to \$10.8 million in 2024. The real-time Economic Load Response charges increased \$44,170, 18.9 percent, from \$208,980 in 2023 to \$253,150 in 2024.<sup>99</sup>

**Table 6-31 Monthly day-ahead and real-time economic load response charge: 2023 and 2024**

Month	Day-ahead Economic Load Response Charge			Real-time Economic Load Response Charge		
	2023	2024	Percent Change	2023	2024	Percent Change
Jan	\$304,465	\$2,598,194	753.4%	\$507	\$23,442	4,524.3%
Feb	\$10,085	\$63,832	532.9%	\$718	\$3,723	418.2%
Mar	\$66,366	\$75,020	13.0%	\$1,176	\$586	(50.2%)
Apr	\$156,789	\$101,710	(35.1%)	\$2,166	\$2,021	(6.7%)
May	\$175,331	\$933,721	432.5%	\$4,325	\$2,473	(42.8%)
Jun	\$159,063	\$522,354	228.4%	\$1,342	\$28,167	1,998.3%
Jul	\$1,090,818	\$1,285,277	17.8%	\$71,063	\$148,484	108.9%
Aug	\$90,356	\$1,373,099	1,419.7%	\$12,717	\$32,880	158.5%
Sep	\$94,311	\$1,547,072	1,540.4%	\$101,196	\$6,724	(93.4%)
Oct	\$660,200	\$1,622,373	145.7%	\$9,472	\$3,796	(59.9%)
Nov	\$361,340	\$664,558	83.9%	\$2,071	\$855	(58.7%)
Dec	\$195,095	\$0	(100.0%)	\$2,228	\$0	(100.0%)
Total (Jan-Dec)	\$3,364,219	\$10,787,209	220.6%	\$208,980	\$253,150	21.1%

Table 6-32 shows registered sites and MW for the last day of each month for the period January 1, 2020, through December 31, 2024. Registration is a prerequisite for CSPs to participate in the economic program. Average monthly registrations increased by 102, 25.0 percent, from 409 in 2023 to 511 in 2024. Average monthly registered MW decreased by 18 MW, 0.6 percent, from 3,124 MW in 2023 to 3,106 MW in 2024.

<sup>99</sup> Load response charges were downloaded as of January 16, 2025, and may change as a result of continued PJM billing updates. Economic demand response reductions that are submitted to PJM for payment but have not received payment are not included. Payments for Economic demand response reductions are settled monthly.

Most economic demand response resources are registered in the emergency demand response program. Resources registered in both programs do not need to register for the same amount of MW. There are 157 economic registrations and 186 capacity registrations in the emergency program that share the same location IDs in both programs. There are 1,380.3 nominated economic MW, 44.4 percent of all economic MW and 1,109.7 nominated capacity MW, 15.4 percent of all nominated capacity MW in the emergency program that share the same location IDs in both programs.

**Table 6-32 Economic program registrations on the last day of the month: 2020 through 2024<sup>100</sup>**

	2020		2021		2022		2023		2024	
Month	Registrations	Registered MW	Registrations	Registered MW	Registrations	Registered MW	Registrations	Registered MW	Registrations	Registered MW
Jan	377	2,909	277	1,495	323	2,233	347	2,874	462	3,176
Feb	382	2,912	275	1,503	323	2,256	354	2,870	472	3,299
Mar	380	2,941	284	1,514	330	2,377	361	2,930	476	3,244
Apr	350	2,917	293	1,538	330	2,382	373	2,932	481	3,207
May	308	2,824	319	1,658	326	2,377	378	3,006	487	3,230
Jun	285	1,418	313	2,136	315	2,323	396	2,929	501	2,942
Jul	283	1,453	312	2,105	310	2,412	412	3,096	524	3,266
Aug	292	1,482	322	2,122	318	2,451	428	3,163	528	3,027
Sep	297	1,566	322	2,256	329	2,565	440	3,335	531	3,017
Oct	275	1,361	332	2,267	333	2,575	453	3,362	543	2,922
Nov	280	1,375	333	2,270	338	2,593	478	3,499	560	2,948
Dec	282	1,327	320	2,256	359	2,640	487	3,493	570	2,989
Avg	316	2,040	309	1,927	328	2,432	409	3,124	511	3,106

The registered MW in the economic load response program are not a good measure of the MW available for dispatch in the energy market. Economic resources can dispatch up to the amount of MW registered in the program, but are not required to offer any MW. Table 6-33 shows the sum of maximum economic MW dispatched by registration each month from January 1, 2012, through December 31, 2024. The monthly maximum is the sum of each registration's monthly noncoincident maximum dispatched MW and annual maximum is the sum of each registration's annual noncoincident maximum dispatched MW. The monthly maximum dispatched MW increased 95.1 MW, 73.0 percent, in 2024 compared to 2023.<sup>101</sup>

**Table 6-33 Sum of maximum MW reported reductions for all registrations per month: 2012 through 2024**

	Sum of Peak MW Reductions for all Registrations per Month												
Month	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
Jan	110	193	446	169	139	123	142	88	28	21	34	50	281
Feb	101	119	307	336	128	83	70	58	11	86	34	18	102
Mar	72	127	369	198	120	111	71	38	12	20	30	53	102
Apr	108	133	146	143	118	54	71	41	3	22	43	70	84
May	143	192	151	161	131	169	70	22	12	9	53	141	247
Jun	954	433	483	833	121	240	105	26	38	125	110	96	213
Jul	1,631	1,088	665	1,362	1,316	936	518	770	135	134	150	309	469
Aug	952	497	358	272	249	141	581	33	99	827	162	191	376
Sep	451	530	795	816	263	140	112	76	31	35	88	392	223
Oct	242	168	214	136	150	88	69	29	9	31	67	80	344
Nov	165	155	166	127	116	81	54	35	12	31	58	88	138
Dec	98	168	155	122	147	83	11	31	14	19	116	77	127
Annual	1,942	1,486	1,739	1,858	1,451	1,217	758	830	196	921	263	735	610

<sup>100</sup> Data for years 2010 through 2017 are available in the 2017 Annual State of the Market Report for PJM.

<sup>101</sup> Maximum MW reductions were downloaded as of January 16, 2025, and may change as a result of continued PJM billing updates.

Table 6-34 shows total settlements submitted for 2012 through 2024. A settlement is counted for every day on which a registration is dispatched in the economic program.

**Table 6-34 Settlements submitted in the economic program: 2012 through 2024**

	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
Number of Settlements	5,835	2,846	3,014	2,173	1,958	1,884	1,524	1,066	520	931	1,793	870	2,016

Table 6-35 shows the number of CSPs, and the number of participants in their portfolios, submitting settlements for 2012 through 2024. The number of active participants increased by 12, 37.5 percent, from 32 in 2023 to 44 in 2024. All participants must be registered through a CSP.

**Table 6-35 Participants and CSPs submitting settlements in the economic program by year: 2012 through 2024**

	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
Active CSPs	22	20	18	18	12	13	14	13	11	11	9	8	6
Active Participants	428	276	165	116	58	72	59	53	29	37	31	32	44

## Issues

FERC Order No. 831 requires that each RTO/ISO market monitoring unit verify all energy offers above \$1,000 per MWh.<sup>102</sup> Economic resources offer into the energy market and must provide supporting documentation to offer above \$1,000 per MWh. FERC stated, “[t]he offer cap reforms, however, do not apply to capacity-only demand response resources that do not submit incremental energy offers into energy markets.”<sup>103</sup> Demand resources participate in both the capacity and energy markets and are not capacity only resources. It is not clear whether FERC intended to exclude demand resources with high strike prices from the requirements of FERC Order No. 831. Demand resources should not be permitted to make offers above \$1,000 per MWh without the same verification requirements applied to economic resources or generation resources. The MMU recommends that the rules for maximum offer for the emergency and pre-emergency program match the maximum offer for generation resources.

On April 1, 2012, FERC Order No. 745 was implemented in the PJM economic program, requiring payment of full LMP for dispatched demand resources when a net benefits test (NBT) price threshold is exceeded. This approach replaced the payment of LMP minus the charges for wholesale power and transmission included in customers’ tariff rates. Following FERC Order No. 745, all ISO/RTOs are required to calculate an NBT threshold price each month above which the net benefits of DR are deemed to exceed the cost to load.

PJM calculates the NBT price threshold by first retrieving generation offers from the same month of the prior calendar year for which the calculation is being performed. PJM then adjusts a portion of each prior year offer, representing the typical share of fuel costs in energy offers in the PJM Region, for changes in fuel prices based on the ratio of the reference month spot fuel price to the study month forward fuel price. To accomplish this adjustment, the ratio of forward prices for the study month to the spot fuel prices for the reference month is used as a scaling factor. If the forward price for the study month was \$7.08 and the spot fuel price from the reference month was \$6.75, then the ratio is 1.05. The offers of generation units are then adjusted by this scaling factor. The price of fuel typically represents 80 to 90 percent of a generator’s offer with the remainder being variable operations and maintenance costs. Where generators offer multiple points on a curve, each point on the curve is adjusted in this manner. The offers are then combined to create daily supply curves for each day in the period. The daily curves are then averaged to form an average supply curve for the study month. PJM then uses a non-linear least squares estimation technique to determine an equation that approximates and smooths this average supply curve. The NBT threshold price is the price at the point where the price elasticity of supply is equal to 1.0 for this estimated supply curve equation.<sup>104</sup> PJM publishes the details of the equation and parameters each month along with the NBT results.

<sup>102</sup> 157 FERC ¶ 61,115 at P 139 (2016).

<sup>103</sup> *Id.* at 8.

<sup>104</sup> “PJM Manual 11: Energy & Ancillary Services Market Operations,” §10.3.1, Rev. 133 (Dec. 17, 2024)

The NBT test is a crude tool that is not based in market logic. The NBT threshold price is a monthly estimate calculated from a monthly supply curve that does not incorporate real-time or day-ahead prices. In addition, it is a single threshold price used to trigger payments to economic demand response resources throughout the entire RTO, regardless of their location and regardless of locational prices.

The necessity for the NBT test is an illustration of the illogical approach to demand side compensation embodied in paying full LMP to demand resources. The benefit of demand side resources is not that they suppress market prices, but that customers can choose not to consume at the current price of power, that individual customers benefit from their choices and that the choices of all customers are reflected in market prices. If customers face the market price, customers should have the ability to not purchase power and the market impact of that choice does not require a test for appropriateness.

When the zonal LMP is above the NBT threshold price, economic demand response resources that reduce their power consumption are paid the full zonal LMP. When the zonal LMP is below the NBT threshold price, economic demand response resources are not paid for any load reductions.<sup>105</sup>

Table 6-36 shows the NBT threshold price for the historical test from August 2010 through July 2011, and April 2012, when FERC Order No. 745 was implemented in PJM, through December 2024. The historical test was used as justification for the method of calculating the NBT for future months. From 2012 through 2021, the NBT threshold price exceeded the lowest historical test result of \$34.07 per MWh one time, in March 2014 when the NBT threshold price was \$34.93. The NBT threshold price exceeded the lowest historical test result of \$34.07 per MWh in 10 of 12 months of 2022. In 2024, the NBT threshold price did not exceed the lowest historical test result of \$34.07 per MWh.

**Table 6-36 Net benefits test threshold prices: August 2010 through December 2024**

Historical Test (\$/MWh)															
	Net Benefits Test Threshold Price (\$/MWh)														
Month	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
Jan	\$44.37	\$39.99		\$25.72	\$29.54	\$29.63	\$23.67	\$32.60	\$25.12	\$29.44	\$19.95	\$18.11	\$26.93	\$40.25	\$20.53
Feb		\$38.52		\$26.27		\$26.52	\$26.71	\$31.57	\$24.44	\$23.49	\$19.29	\$18.70	\$34.59	\$29.79	\$22.28
Mar	\$37.97	\$35.67	\$28.51		\$34.93	\$24.99	\$22.10	\$30.56	\$25.50	\$22.15	\$17.44	\$20.58	\$30.00	\$23.75	\$18.70
Apr	\$37.93		\$26.31	\$26.96	\$32.59	\$24.92	\$19.93	\$30.45	\$25.50	\$22.36	\$15.91	\$23.47	\$18.78	\$23.68	\$17.17
May	\$37.36	\$35.82	\$23.81	\$27.58	\$32.08	\$20.03	\$20.69	\$29.77	\$25.52	\$21.01	\$14.69	\$21.40	\$42.94	\$23.43	\$16.82
Jun	\$36.89	\$36.12	\$23.86	\$28.44	\$31.62	\$23.80	\$20.56	\$27.14	\$23.59	\$20.20	\$15.56	\$22.35	\$44.29	\$22.33	\$18.41
Jul	\$37.68	\$36.76	\$22.99	\$29.84	\$31.62	\$23.03	\$20.73	\$24.42	\$23.57	\$20.28	\$14.66	\$21.59	\$48.67	\$22.66	\$21.15
Aug	\$31.12	\$33.86	\$24.47	\$28.58	\$22.61	\$21.82	\$23.24	\$22.75	\$23.53	\$19.57	\$14.58	\$20.52	\$44.08	\$24.89	\$17.48
Sep	\$35.39	\$31.07	\$24.93	\$28.80	\$29.83	\$21.69	\$24.70	\$21.51	\$22.23	\$18.19	\$14.06	\$23.06	\$45.56	\$25.04	\$14.71
Oct	\$35.67		\$25.96	\$29.13	\$30.20	\$21.48	\$24.25	\$24.80	\$23.84	\$20.20	\$17.25	\$24.24	\$55.97	\$21.73	\$14.22
Nov	\$36.49		\$25.63	\$31.63	\$29.17	\$22.28	\$29.27	\$26.41	\$23.89	\$21.11	\$18.35	\$29.20	\$49.57	\$23.12	\$19.81
Dec	\$39.50		\$25.97	\$28.82	\$29.01	\$22.31	\$29.71	\$29.16	\$26.35	\$22.24	\$19.47	\$32.85	\$42.75	\$24.43	\$20.13
Average	\$37.31	\$35.98	\$25.24	\$28.34	\$30.29	\$23.54	\$23.80	\$27.60	\$24.42	\$21.69	\$16.77	\$23.01	\$40.35	\$25.42	\$18.45

Table 6-37 shows the number of hours that at least one zone in PJM had day-ahead LMP or real-time LMP higher than the NBT threshold price.<sup>106</sup> In 2024, the highest zonal LMP in PJM was higher than the NBT threshold price 8,092 hours out of 8,784 hours, or 92.1 percent of all hours. Reductions occurred in 5,008 hours, 61.9 percent, of those 8,092 hours in 2024. The last three columns illustrate how often economic demand response activity occurred when LMPs exceeded NBT threshold prices for January 1, 2022, through December 31, 2024. There are no economic payments when demand response occurs and zonal LMP is below the NBT threshold. Demand response reported reductions occurred in none of the hours in which LMP was below the NBT threshold price in 2023, and none of the hours in which LMP was below the NBT threshold price in 2024.

<sup>105</sup> "PJM Manual 11: Energy & Ancillary Services Market Operations," §10.3.4, Rev. 133 (Dec. 17, 2024)

<sup>106</sup> The MWh for demand resources were downloaded as of January 16, 2025, and may change as a result of continued PJM billing updates.

**Table 6-37 Hours with price higher than NBT and economic load response occurrences in those hours: 2023 and 2024**

Month	Number of Hours		Number of Hours with LMP Higher than NBT			Percent of NBT Hours with Economic Load Response		
	2023	2024	2023	2024	Percent Change	2023	2024	Percentage Change
Jan	744	744	458	732	59.8%	36.9%	51.6%	14.7%
Feb	672	696	412	568	37.9%	19.7%	31.5%	11.9%
Mar	743	743	678	618	(8.8%)	25.7%	27.7%	2.0%
Apr	720	720	664	700	5.4%	32.1%	37.0%	4.9%
May	744	744	631	723	14.6%	37.4%	64.3%	26.9%
Jun	720	720	515	610	18.4%	51.8%	65.9%	14.1%
Jul	744	744	639	636	(0.5%)	51.2%	87.6%	36.4%
Aug	744	744	600	670	11.7%	59.3%	85.4%	26.0%
Sep	720	720	588	694	18.0%	48.5%	81.7%	33.2%
Oct	744	744	717	744	3.8%	47.4%	96.8%	49.4%
Nov	721	721	709	669	(5.6%)	37.8%	92.5%	54.7%
Dec	744	744	631	728	15.4%	32.0%	16.3%	(15.7%)
Total	8,760	8,784	7,242	8,092	11.7%	40.3%	61.9%	21.6%

## Energy Efficiency

Energy Efficiency Resources (EE) are not capacity resources and do not contribute to reliability. FERC ruled on November 5, 2024, that EE should no longer be paid the capacity market clearing price effective with the 2026/2027 Delivery Year.<sup>107</sup> Payments from PJM customers to energy efficiency providers are a subsidy and uplift. The rules described here remain in effect until June 1, 2026.

The MMU had long recommended that Energy Efficiency Resources (EE) be removed from the capacity market mechanism because PJM's load forecasts now account for EE, unlike the situation when EE was first added to the capacity market.<sup>108</sup> EE should not be part of the capacity market mechanism. EE is appropriately and automatically compensated through the markets because to the extent that it actually reduces energy and capacity use, it reduces customer payments for energy and capacity. EE is appropriately incorporated in PJM forecasts, so the original logic for the inclusion of EE in the capacity market is no longer correct.

## History

EE is not a capacity resource and is not treated as a capacity resource in the capacity market. EE does not contribute to meeting the RPM Reliability Requirement. EE resources may not serve as a replacement for the commitment of any other RPM Capacity Resource type.

On March 26, 2009, FERC approved Tariff and RAA changes to allow EE Resources to participate in PJM Capacity Markets beginning with the Base Residual Auction conducted in May 2009 which committed capacity for the 2012/2013 Delivery Year.<sup>109</sup> FERC approved PJM's request to allow EE Resource participation beginning June 1, 2011, in the remaining 2011/2012 Incremental Auctions by letter order dated January 22, 2010 in Docket No. ER10-366-000. The only reason that EE was included in the capacity market in the first place was that EE was asserted to not be included in the PJM load forecast used in the capacity market. PJM stated that EE was not fully reflected in the load forecast for four years

based on the method in place at the time.

Revisions to the PJM load forecast to incorporate energy efficiency were endorsed at the November 19, 2015, MRC.<sup>110</sup> These revisions included improvements to comprehensively capture energy efficiency impacts through incorporation of projections from the U.S. Energy Information Administration (EIA) Annual Energy Outlook (AEO). The AEO forecast is based on a set of end use models for the residential, commercial, and industrial sectors. EIA accounts for state and utility efficiency programs by mapping regional EE program expenditures to end uses and tracks the number of units sold and associated efficiency information on an ongoing basis.<sup>111</sup>

As soon as PJM explicitly included EE in the load forecast used in the capacity market, PJM should have followed its tariff language and logic and eliminated EE from the capacity market construct entirely. Instead of eliminating EE from the capacity market construct consistent with the tariff and logic, PJM removed EE from capacity resource status and implemented a calculation method (misleadingly termed the addback method) that would pay EE the capacity market clearing price while having no impact, either price or quantity, on the capacity market. Beginning with capacity auctions conducted in 2016 for the 2016/2017 through

<sup>109</sup> 126 FERC ¶ 61,275 (2009)

<sup>110</sup> See *Approved Minutes from the Markets and Reliability Committee*, <<https://www.pjm.com/-/media/committees-groups/committees/mrc/20151217/20151217-item-01-draft-minutes-20151119.ashx>> (December 17, 2015).

<sup>111</sup> See EIA, *Analysis of Energy Efficiency Program Impacts Based on Program Spending* <<https://www.eia.gov/analysis/studies/buildings/efficiencyimpacts/pdf/programspending.pdf>> (Accessed January 18, 2024).

<sup>107</sup> See 189 FERC ¶ 61,095, *reh'g denied*, 190 FERC ¶ 62,005 (2025).

<sup>108</sup> "PJM Manual 19: Load Forecasting and Analysis," § 3.2 Development of the Forecast, Rev. 37 (Dec. 18, 2024).



2025/2026 Delivery Years, PJM paid EE the capacity market clearing price while completely excluding EE from the actual capacity market. Use of this approach to EE addback did inappropriately require that customers pay for all EE offered at less than the market clearing price as an uplift payment or subsidy to EE sellers.

After the MMU filed a complaint in Docket No. EL24-126 requesting that the Commission require PJM to stop paying EE the uplift/subsidy, PJM filed to confirm removal of the EE from the capacity market construct, including the subsidy. On November 5, 2024, the Commission approved the complete removal of EE effective with the 2026/2027 capacity auction.<sup>112</sup> The MMU subsequently noticed withdrawal of the MMU complaint.<sup>113</sup>

Prior to the MMU complaint filed in Docket No. EL24-126, the MMU filed a complaint in Docket No. EL24-113 against indicated EE sellers for failure to submit post-installation M&V reports sufficient to support payments for EE from PJM for the 2024/2025 Delivery Year.<sup>114</sup> The complaint remains pending.

PJM stakeholders initiated a holistic review of Energy Efficiency Resources participation in PJM markets in November of 2023. A sector-weighted super majority of PJM's stakeholders supported elimination of EE from the capacity construct at the MRC and the MC meetings on August 21, 2024.<sup>115</sup> PJM filed the proposal under Section 205 on September 6, 2024.<sup>116</sup> On November 5, 2024, the Commission issued an order approving the proposed Tariff and RAA revisions to remove Energy Efficiency Resource participation from the PJM capacity construct effective with the 2026/2027 Delivery Year.<sup>117</sup> On December 5, 2024, Affirmed Energy LLC filed a motion of a stay and a request for rehearing. An order denying rehearing by operation of law was issued January 6, 2025.<sup>118</sup> On February 7, 2025, the Commission issued an order denying the motion for stay and affirming its earlier denial of rehearing.<sup>119</sup>

On December 16, 2024, the Commission issued an Order to Show Cause and Notice of Proposed Penalty recommending civil penalties against American Efficient, LLC, a large seller of EE, and its affiliates in connection with an alleged scheme to manipulate the capacity markets operated by PJM and MISO.<sup>120</sup> The Order directs American Efficient to show cause as to why it should not be required to pay a civil penalty of \$722 million and disgorge \$253 million in unjust profits. On January 29, 2025, American Efficient, et al. filed for review of the show cause order in the United States District Court for the Middle District of North Carolina.<sup>121</sup> The court case is pending.

## EE Details

In addition to the fact that EE resources are not capacity resources, the measurement of EE that was required as a condition to receive subsidy payments from PJM were largely unsupported by factual evidence or actual measurements.

An EE Resource is required to be a project that involves the installation of more efficient devices or equipment, or the implementation of more efficient processes or systems, exceeding then current building codes, appliance standards, or other relevant standards, at the time of installation, as known at the time of commitment, and meets the requirements of Schedule 6 (section L) of the Reliability Assurance Agreement. The EE Resource must achieve a permanent, continuous reduction in electric energy consumption at the End Use Customer's retail site during the defined EE Performance Hours that is not reflected in the peak load forecast used for the auction delivery year for which the EE Resource is proposed.<sup>122</sup>

Despite the fact that the EE Resource must be fully implemented at all times during the delivery year, without any requirement of notice, dispatch, or operator intervention, EE accreditation is based only on extremely limited periods. EE is required to demonstrate

<sup>112</sup> See 189 FERC ¶ 61,095, *reh'g denied*, 190 FERC ¶ 62,005 (2025).

<sup>113</sup> See Complaint of the Independent Market Monitor for PJM, Docket No. EL24-126-000 (July 10, 2024), Notice of Withdrawal of Complaint, Docket No. EL24-126-000 (November 19, 2024); RAA Schedule 6 § L.1, OATT Attachment DD-1 § L.1.

<sup>114</sup> See Complaint of the Independent Market Monitor for PJM, Docket No. EL24-113-000 (May 31, 2024).

<sup>115</sup> PJM Transmittal Letter, Docket No. ER24-2995 at 41 (Sept. 6, 2024).

<sup>116</sup> PJM Interconnection, LLC, Docket No. ER24-2995-000, Proposal to Enable Energy Efficiency to Benefit Loads Through Demand-Side Reduction to the Peak Load Forecast and Savings from Energy Market Charges (Sept. 6, 2024).

<sup>117</sup> See 189 FERC ¶ 61,095.

<sup>118</sup> See 190 FERC ¶ 62,005.

<sup>119</sup> 190 FERC ¶ 61,081.

<sup>120</sup> 189 FERC ¶ 61,196 (2024).

<sup>121</sup> See American Efficient, LLC, et al. v. FERC, Case No. 1:25-cv-68.

<sup>122</sup> See RAA Schedule 6 § L. Since 2010, the PJM tariff definition of "End User Customer" limits the scope of the term to mean only PJM Members. Letter Order, Docket No. ER11-1909-000 (December 20, 2010). Recently, PJM asserted that the reference in RAA Schedule 6 § L.1 and OATT Attachment DD-1 § L.1 to the defined term, "End Use Customer," was a mistake, and proposed to discontinue use of the defined term in the February 8, 2024, meeting of the PJM Governing Document Enhancement and Clarification Subcommittee (GDECS). The defined term was in place for more than 13 years and subject to many reviews. The proposed change removes the current requirement in the filed tariff that EE loads be End Use Customers and therefore be PJM Members. The proposed change is substantive and not a correction of a typographical error. PJM has been operating in violation of that tariff provision since 2010. The proposed change was filed and approved. *PJM Interconnection, LLC*, Letter Order, Docket No. ER24-1987-000 (May 23, 2024).

savings only during three summer months and two winter months and only for extremely limited hours during those months. The EE Performance Hours in the summer are defined as the four hours from the hour ending 15:00 Eastern Prevailing Time (EPT) through the hour ending 18:00 EPT during all days for the three month period from June 1 through August 31, inclusive, of such delivery year, that is not a weekend or federal holiday. For the 2023/2024 Delivery Year, the summer EE Performance hours comprise 256 hours across 64 days. The EE Performance Hours in the winter are defined as the four hours from the hour ending 8:00 EPT and hour ending 9:00 EPT, and from the hour ending 19:00 EPT and hour ending 20:00 EPT during all days for the two month period from January 1 through February 28, inclusive, of such delivery year that is not a weekend or federal holiday. For the 2023/2024 Delivery Year, the winter EE Performance hours comprise 160 hours across 40 days. For the 2023/2024 Delivery Year, the total annual EE Performance hours comprised 416 hours across 104 days, or 4.7 percent of all hours in the year.

Calculating the Nominated MW value for Energy Efficiency (EE) resources is different than calculating the Nominated MW value for actual capacity resources. The maximum amount of Nominated MW a generator can offer into the capacity market is based on the maximum output of a generator that is metered and tested. The Nominated MW for EE resources are not metered or measured or tested, although they could be, but are based on calculations of estimated savings based on a set of largely unverified and unverifiable assumptions. The Nominated Value of an EE Resource is the expected average demand reduction during the summer EE Performance Hours. Qualifying EE Resources must also have an expected average load reduction during the winter EE performance hours that is not less than the Nominated EE Value determine during the summer EE Performance Hours. If the Nominated EE Value determined during the summer EE Performance Hours is greater than the expected average demand during the winter performance hours, the expected demand during the winter performance hours will be the value of the EE Resource. The Nominated EE Value of a Summer-Period Energy Efficiency Resource is the expected average demand reduction during the summer EE Performance Hours.

Prescriptive energy efficiency MW are based on and paid on assumed savings calculated based on an assumed installation rate and on the difference between the assumed electricity usage of what is being replaced and the assumed electricity usage of the new product. All lighting EE is prescriptive. The majority of EE MW offered into the PJM Capacity Market are prescriptive energy efficiency MW. The measurement and verification method for prescriptive energy efficiency projects relies on neither measurement nor verification but instead relies on unverified assumptions and is too imprecise to rely on for the payment of more than \$100 million per year. The nonprescriptive measurement and verification methods are also inadequate and rely on samples and assumptions for limited periods that are frequently significantly outdated.<sup>123</sup>

Most EE MW are not directly measured. Savings are calculated based on an assumed installation rate and assumed usage level, compared to the assumed electricity usage of the default. For example, the calculation of the summer period lighting savings for a residential lighting retrofit is generally:

$$\Delta kW = ((WattsBase - WattsEE) / 1000) * ISR * WHFd * CF$$

Where:

*ISR = In Service Rate approximating percent of bulbs installed in calculation year*

*WHFd = Waste Heat Factor for Demand to account for cooling savings from efficient lighting*

*CF = Summer Peak Coincidence Factor approximating percent of EE Performance Hours device is in use*

The inputs to these calculations are based on assumptions and observations over very limited periods and generally rely on data that is significantly out of date. Many EE Providers rely on usage assumptions from industry publications rather than from primary data collected from measurements of their own customers. A commonly referenced document in supporting Measurement & Verification reports is the Maryland/Mid-Atlantic Technical Reference Manual (TRM) facilitated and managed by Northeast Energy Efficiency Partnerships, a 501 (c)(3) non-profit organization funded by various advocacy groups and the federal government.<sup>124</sup> <sup>125</sup>

While this manual focuses on a geographic region

<sup>123</sup> PJM. "Manual 18B: Energy Efficiency Measurement & Verification," § 2.2 Rev. 05 (Sep. 21, 2022).

<sup>124</sup> See *Maryland/Mid-Atlantic Technical Reference Manual Version 10* <<https://neep.org/mid-atlantic-technical-reference-manual-trm-v10>> (May 27, 2020).

<sup>125</sup> See *Northeast Energy Efficiency Partnership* <<https://neep.org/>> (March 4, 2024)

included in PJM's service territory, EE Providers can and do use assumptions based on installations in locations outside of PJM's service territory. The technical reference manuals (TRM) referenced by EE Providers are generally significantly outdated and therefore cannot reasonably be used to define the actual current baseline conditions that should be used for valuation of projects. Given the development cycle, the data underlying the TRM lags the publishing date by several years. Of TRMs frequently referenced by EE Providers, the Maryland/Mid-Atlantic TRM was published in 2020, the Pennsylvania TRM in 2021 and the Ohio TRM in 2019. The Pennsylvania PUC updates and approves its TRM on a 5-year cycle.<sup>126</sup> As a result, for the normal three year capacity market timing, a three year old TRM, relying on data from as much as five years prior to publication, is used to estimate savings for at least four years into the future. As a result, in the fourth year of the EE resource, its purported savings will be based on data from 15 years earlier. That is not a reasonable basis for calculating savings. Table 6-38 shows the current publishing dates of TRMs frequently referenced in M&V reporting submitted to PJM. In addition to Technical Reference Manuals, other studies and references are cited in EE M&V Plans and Reports. These citations are likewise used to justify the claimed benefits and savings attributed to Energy Efficiency projects. These materials, as with the TRMs, are often several years out of date and commonly 10 years old and in some cases older.

**Table 6-38 Publishing Dates (M-Y) of Technical Resource Manuals**

State/Region	Current Version
Delaware	Jul-16
Illinois	Sep-23
Maryland	May-20
New Jersey	May-23
Ohio	Sep-19
Pennsylvania	May-24
Tennessee	Oct-15
Mid-Atlantic	May-20

Another weakness of the methods used to evaluate EE is the failure to recognize that the incremental benefits of EE measures decline over time as improved energy saving technology is adopted by customers. This improvement in technology reduces the baseline energy usage against which incremental savings should be measured. An example of a decreasing baseline in energy usage is in residential lighting. The assumed

baseline condition was originally an incandescent bulb but should have evolved to more and more efficient LEDs, which eliminates the incremental savings when replaced by another LED lightbulb.

The mix of EE project types offered should have more quickly reflected the actual technology adopted in the markets. In the 2019/2020 BRA, lighting projects comprised 77 percent of all EE measures. Table 6-39 shows the composition of project types submitted in M&V Plans for the 2019/2020 RPM Base Residual Auction.

**Table 6-39 EE Project Types: 2019/2020 Delivery Year**

Project Type	2019/2020
Residential Lighting	23%
Residential HVAC	1%
Residential New Construction	<1%
Appliances	<1%
Commercial Lighting	54%
Commercial Prescriptive	8%
Commercial HVAC	<1%
Small Business	4%
Commercial Construction	2%
Other	7%

In the 2024/2025 BRA, lighting dropped to 45 percent of all EE measures. Building envelope measures, which include thermal performance improvements to exterior walls, windows, doors, and roofing to reduce building energy consumption were a growing project type encompassing 33 percent of all EE measures in the 2024/2025 BRA. Table 6-40 shows the composition of project types submitted in EE M&V Plans for the 2024/2025 RPM Base Residual Auction.

**Table 6-40 EE Project Types: 2024/2025 Delivery Year**

Project Type	2024/2025
Lighting	45%
Building Envelope	33%
Variable Frequency Drives	8%
Appliances	<1%
Other	14%

There is no evidence that the EE programs result in changed behavior or increases in savings. EE Providers may repackage the independent actions of customers that have already occurred. There is no evidence that EE participation in PJM markets causes End Use Customers to reduce their energy consumption beyond what they would have otherwise.

While EE does not affect the capacity market clearing price or quantity, customers do pay for EE at capacity

<sup>126</sup> 66 PA 5 2806.1(c)(3)

market clearing prices. These direct payments to EE are a subsidy and uplift and an overpayment by customers. Table 6-41 shows the RPM revenues paid, by delivery year, to energy efficiency (EE) resources in PJM.

PJM does not codify eligibility requirements to claim the property rights to energy efficiency installations in the tariff. PJM does not have a registration system to track claims to property rights to energy efficiency installations and document installation periods of energy efficiency installations. The purpose of the registration system is to prevent duplicative claims to property rights and to document installation periods of energy efficiency to verify eligibility for continued participation measures. Energy Efficiency projects should be clearly identified by retail customer account, year of project installation and a description of the Energy Efficiency project.

A registration system would also serve the benefit of preventing multiple Energy Efficiency Providers from claiming property rights to the same project. The Energy Efficiency Resource Provider offering an Energy Efficiency Resource for payment must demonstrate to PJM that it has the legal authority to claim the demand associated with such Energy Efficiency Resource.<sup>127</sup> This demonstration is generally a prepackaged statement, provided by PJM, that is never fully verified. PJM should have codified eligibility requirements to claim the property rights to Energy Efficiency installations in the Tariff. These eligibility requirements should specifically define the conditions under which an Energy Efficiency Resource Provider may claim the property rights to Energy Efficiency installations as well as evidentiary requirements such as signed contracts with their customers conferring such rights. PJM does not require contracts between the seller of EE to PJM and the actual owner of the EE. It is not always clear who the owner of the EE property rights actually is.

Table 6-41 shows the amount of energy efficiency (EE) resources paid as of June 1 for the 2011/2012 through 2024/2025 Delivery Years. EE resources may participate in PJM without restrictions imposed by a state unless the Commission authorizes a state to impose restrictions.<sup>128</sup> Only Kentucky has been so authorized by the Commission.<sup>129</sup> The total MW of energy efficiency

resources paid increased by 30.9 percent, from 5,896.4 MW in the 2023/2024 Delivery Year to 7,716.0 MW in the 2024/2025 Delivery Year.<sup>130</sup>

**Table 6-41 Energy efficiency resources (MW): 2011/2012 through 2025/2026 Delivery Years**

Delivery Year	EE Paid (MW)	Total RPM Cleared (UCAP MW)	EE MW/ Capacity MW	EE Revenue
2011/2012	76.4	134,182.6	0.1%	\$139,812
2012/2013	666.1	141,295.6	0.5%	\$11,408,552
2013/2014	904.2	159,844.5	0.6%	\$21,598,174
2014/2015	1,077.7	161,214.4	0.7%	\$42,308,549
2015/2016	1,189.6	173,845.5	0.7%	\$66,652,986
2016/2017	1,723.2	179,773.6	1.0%	\$68,709,670
2017/2018	1,922.3	180,590.5	1.1%	\$86,147,605
2018/2019	2,296.3	175,996.0	1.3%	\$103,105,796
2019/2020	2,528.5	177,064.2	1.4%	\$92,569,666
2020/2021	3,569.5	174,023.8	2.1%	\$101,348,169
2021/2022	4,806.2	174,713.0	2.8%	\$185,755,803
2022/2023	5,734.8	150,465.2	3.8%	\$135,265,303
2023/2024	5,896.4	150,143.9	3.9%	\$93,603,058
2024/2025	7,716.0	154,362.5	5.0%	\$130,780,274
2025/2026	1,459.8	135,684.0	1.1%	\$144,180,260

Table 6-42 shows the total revenues to energy efficiency based on the zone in which they are located, as of June 1 for the 2023/2024 and 2024/2025 Delivery Years.

**Table 6-42 Energy efficiency resource revenue by zone: 2023/2024 and 2024/2025 Delivery Years**

Zone	Revenue		Percent of EE Revenue	
	2023/2024	2024/2025	2023/2024	2024/2025
AECO	\$2,099,556	\$2,900,594	2.2%	2.2%
AEP	\$8,220,965	\$8,311,932	8.8%	6.4%
APS	\$3,495,717	\$4,019,526	3.7%	3.1%
ATSI	\$5,621,390	\$6,165,467	6.0%	4.7%
BGE	\$6,954,765	\$10,563,637	7.4%	8.1%
COMED	\$11,102,489	\$10,328,888	11.9%	7.9%
DAY	\$1,280,027	\$1,347,504	1.4%	1.0%
DEOK	\$2,036,790	\$6,482,315	2.2%	5.0%
DOM	\$8,823,920	\$9,388,297	9.4%	7.2%
DPL	\$3,352,769	\$17,479,123	3.6%	13.4%
DUQ	\$1,543,017	\$1,385,670	1.6%	1.1%
JCPL	\$4,289,937	\$6,373,282	4.6%	4.9%
METED	\$2,127,988	\$2,834,056	2.3%	2.2%
PECO	\$9,970,022	\$11,209,242	10.7%	8.6%
PENELEC	\$1,847,587	\$2,556,322	2.0%	2.0%
PEPCO	\$5,287,930	\$7,075,048	5.6%	5.4%
PPL	\$5,447,923	\$6,910,670	5.8%	5.3%
PSEG	\$10,073,096	\$15,386,096	10.8%	11.8%
RECO	\$27,170	\$62,605	0.0%	0.0%
Total	\$93,603,058	\$130,780,274	100.0%	100.0%

As defined in the RAA, each LSE incurs a Locational Reliability Charge, subject to certain offsets and other adjustments as described in Attachment DD, Sections

<sup>127</sup> EE Post-Installation Measurement & Verification Report Template, <<https://www.pjm.com/-/media/markets-ops/rpm/rpm-auction-info/post-installation-measurement-and-verification.ashx>> (Accessed Aug. 5, 2022).

<sup>128</sup> See 161 FERC ¶ 61,245 at P 57 (2017); 107 FERC ¶ 61,272 at P 8 (2008).

<sup>129</sup> FERC made an exception for Kentucky when it determined that RERRAs must obtain FERC approval prior to excluding EE. FERC explained that "the Commission accepted such condition at

the time the Kentucky Commission approved the integration of Kentucky Power into PJM." 161 FERC ¶ 61,245 at P 66 (2017).

<sup>130</sup> See the 2021 Annual State of the Market Report for PJM, Vol. 2, Section 5: Capacity Market, Table 5-13.



5.14B through 5.14E and Section 5.15.<sup>131</sup> Locational Reliability Charges are equal to the LSE's Daily Unforced Capacity Obligation in a zone during the Delivery Year multiplied by the applicable Final Zonal Capacity Price in the zone. The Tariff does not define the allocation of EE revenue requirements to load in RPM. In practice, PJM allocates total EE revenue requirements to load prorata based on final zonal UCAP obligations. As a result, the allocation of EE costs to zones is not equal to the revenue requirement of EE resources located in that zone. Zones in which no EE resources are located are allocated a share of total EE revenue requirements based on their share of the total PJM UCAP obligation. Table 6-43 and Table 6-44 shows the zonal revenue requirement of EE resources compared to the zonal allocation of total EE revenue requirements to load. Where a zone's load charge is greater than the revenue requirement of EE resources located in that zone, the zone's customers are subsidizing the revenue requirement of EE resources located in other zones. Where a zone's load charge is less than the revenue requirement of EE resources located in that zone, the zone's customers are receiving a subsidy from customers located in other zones.

**Table 6-43 Energy efficiency zonal load charges and revenues: 2023/2024 Delivery Year**

2023/2024				
Zone	LDA	EE Load Charge	EE Revenue	EE Load Charge minus Revenue
AE	EMAAC	\$1,793,515	\$2,099,556	(\$306,041)
AEP	RTO	\$8,702,767	\$8,220,965	\$481,802
APS	RTO	\$6,663,971	\$3,495,717	\$3,168,254
ATSI	ATSI	\$9,054,283	\$5,621,390	\$3,432,894
BGE	BGE	\$4,868,113	\$6,954,765	(\$2,086,652)
COMED	COMED	\$14,737,133	\$11,102,489	\$3,634,644
DAYTON	DAY	\$2,424,683	\$1,280,027	\$1,144,656
DEOK	DEOK	\$3,296,287	\$2,036,790	\$1,259,497
DLCO	RTO	\$2,058,324	\$1,543,017	\$515,307
DOM	RTO	\$2,512,484	\$8,823,920	(\$6,311,436)
DPL	EMAAC	\$2,841,034	\$3,352,769	(\$511,735)
EKPC	RTO	\$1,736,804	\$0	\$1,736,804
JCPL	EMAAC	\$4,446,293	\$4,289,937	\$156,356
METED	MAAC	\$2,279,389	\$2,127,988	\$151,401
OVEC	RTO	\$46,869	\$0	\$46,869
PECO	EMAAC	\$6,278,084	\$9,970,022	(\$3,691,938)
PENLC	MAAC	\$2,144,251	\$1,847,587	\$296,663
PEPCO	PEPCO	\$4,604,866	\$5,287,930	(\$683,064)
PL	PPL	\$5,518,809	\$5,447,923	\$70,886
PS	PSEG	\$7,292,014	\$10,073,096	(\$2,781,082)
RECO	EMAAC	\$303,085	\$27,170	\$275,915
Total		\$93,603,058	\$93,603,058	(\$0)

**Table 6-44 Energy efficiency zonal load charges and revenues: 2024/2025 Delivery Year**

2024/2025				
Zone	LDA	EE Load Charge	EE Revenue	EE Load Charge minus Revenue
AE	EMAAC	\$2,535,754	\$2,900,594	(\$364,840)
AEP	RTO	\$12,137,414	\$8,311,932	\$3,825,482
APS	RTO	\$9,366,104	\$4,019,526	\$5,346,578
ATSI	ATSI	\$12,926,950	\$6,165,467	\$6,761,484
BGE	BGE	\$6,731,078	\$10,563,637	(\$3,832,559)
COMED	COMED	\$20,323,799	\$10,328,888	\$9,994,911
DAYTON	DAY	\$3,380,646	\$1,347,504	\$2,033,141
DEOK	DEOK	\$4,577,737	\$6,482,315	(\$1,904,578)
DLCO	RTO	\$2,826,017	\$1,385,670	\$1,440,347
DOM	RTO	\$3,898,695	\$9,388,297	(\$5,489,602)
DPL	EMAAC	\$3,998,938	\$17,479,123	(\$13,480,185)
EKPC	RTO	\$2,506,944	\$0	\$2,506,944
JCPL	EMAAC	\$6,142,999	\$6,373,282	(\$230,283)
METED	MAAC	\$3,147,572	\$2,834,056	\$313,516
OVEC	RTO	\$64,743	\$0	\$64,743
PECO	EMAAC	\$8,743,496	\$11,209,242	(\$2,465,746)
PENLC	MAAC	\$2,958,739	\$2,556,322	\$402,417
PEPCO	PEPCO	\$6,244,429	\$7,075,048	(\$830,619)
PL	PPL	\$7,575,970	\$6,910,670	\$665,299
PS	PSEG	\$10,273,581	\$15,386,096	(\$5,112,515)
RECO	EMAAC	\$418,669	\$62,605	\$356,064
Total		\$130,780,274	\$130,780,274	(\$0)

The ownership of Energy Efficiency is highly concentrated. The combined market share of the four largest companies ranges from 90 to 99 percent of all paid Energy Efficiency MW. The HHI for Energy Efficiency resources shows that ownership of EE for the entire market is highly concentrated for each of the last six delivery years. Table 6-45 shows the HHI value for paid Energy Efficiency MW and the market share of the four largest suppliers by delivery year for the entire market.

**Table 6-45 Energy Efficiency HHI: 2019/2020 through 2024/2025 Delivery Years**

Delivery Year	HHI	Structure	Top 4 Market Share
2019/2020	3574	Highly Concentrated	90.6%
2020/2021	3005	Highly Concentrated	89.8%
2021/2022	3409	Highly Concentrated	91.6%
2022/2023	5803	Highly Concentrated	99.1%
2023/2024	6029	Highly Concentrated	99.9%
2024/2025	5749	Highly Concentrated	98.0%

The ownership of Energy Efficiency is also highly concentrated on an LDA basis as shown by the HHI levels. The individual LDA HHI values cannot be made public based on PJM's confidentiality rules. Table 6-46 shows the HHI value for paid MW by LDA for the 2023/2024 and 2024/2025 Delivery Years.

<sup>131</sup> See PJM, Intra-PJM Tariffs, RAA, Article 7, §2.



Table 6-46 Energy Efficiency HHI by LDA

LDA	Structure	
	2023/2024	2024/2025
ATSI	Highly Concentrated	Highly Concentrated
ATSI-CLEVELAND	Highly Concentrated	Highly Concentrated
BGE	Highly Concentrated	Highly Concentrated
COMED	Highly Concentrated	Highly Concentrated
DAY	Highly Concentrated	Highly Concentrated
DEOK	Highly Concentrated	Highly Concentrated
DPL-SOUTH	Highly Concentrated	Highly Concentrated
EMAAC	Highly Concentrated	Highly Concentrated
MAAC	Highly Concentrated	Highly Concentrated
PEPCO	Highly Concentrated	Highly Concentrated
PPL	Highly Concentrated	Highly Concentrated
PS-NORTH	Highly Concentrated	Highly Concentrated
PSEG	Highly Concentrated	Highly Concentrated
RTO	Highly Concentrated	Highly Concentrated

Table 6-47 shows how EE MW are distributed across LDAs. For example, 15.1 percent of all EE MW were in EMAAC in the 2024/2025 Delivery Year.

Table 6-47 Energy Efficiency Share by LDA

LDA	Percent of EE	
	2023/2024	2024/2025
ATSI	6.9%	6.9%
ATSI-CLEVELAND	0.8%	0.7%
BGE	4.6%	5.0%
COMED	16.3%	13.8%
DAY	1.7%	1.7%
DEOK	2.8%	2.4%
DPL-SOUTH	1.0%	1.3%
EMAAC	14.2%	15.1%
MAAC	3.8%	3.9%
PEPCO	5.1%	5.2%
PPL	5.2%	5.1%
PS-NORTH	3.6%	5.1%
PSEG	4.0%	5.3%
RTO	30.2%	28.6%

## Peak Shaving Adjustment

Peak Shaving Adjustment (PSA) provides an alternative means for demand response to participate in the Reliability Pricing Model (RPM). Rather than being on the supply side of the capacity market, a PSA participates on the demand side through a modified peak load forecast for the zone in which the Peak Shaving Adjustment resources are located. The peak shaving adjusted load forecast is included in the VRR curve. An important issue is that the resultant reduction in capacity obligation is socialized across all loads in the zone rather than directly benefitting the resources providing the Peak Shaving Adjustment.<sup>132</sup> This eliminates the incentive for individual customers to participate in peak shaving. The solution is a retail rate design that directly assigns the benefits of peak shaving to individual customers. The retail rate design is within the authority of state regulators and not the authority of FERC which has jurisdiction over the wholesale markets. Not surprisingly, although PSA was first available for inclusion in the revised March 2016 PJM Load Forecast Report, PJM has not yet approved any PSA for use in a load forecast.

A PSA plan must include: the basis for the planned reductions; a THI trigger for interruption; the duration of the interruption in hours; the MW value of the curtailment; the months of the offer; all historical addbacks for the nominated programs.<sup>133</sup> Any resource selling a PSA must reduce load on any day in which its trigger is met or exceeded. The trigger is based on the actual maximum daily temperature humidity index (THI) for the relevant PJM zone. When the trigger is met, the PSA must comply with its defined offer parameters including number of hours of interruption. Failure to operate to these parameters will lead to a reduction in the peak shaving adjustment value in future delivery years. Performance is measured based on the aggregated Customer Baseline (CBL). PJM applies a three year rolling average of the annual peak shaving performance ratings to the program's total participating MW in order to determine its peak shaving adjustment.

<sup>132</sup> See "Peak Shaving Adjustment Proposal," Docket No. ER19-511-000 (December 7, 2018).

<sup>133</sup> "PJM Manual 19: Load Forecasting and Analysis," Attachment D, Rev. 37 (Dec. 18, 2024).

## Distributed Energy Resources

Distributed Energy Resources (DER) include generation connected to distribution level facilities, behind the meter generation, and energy storage facilities connected to the distribution grid or to load. FERC issued Order No. 2222 on September 17, 2020, with the goal of removing barriers for small distributed resources to enter the wholesale market by allowing them to aggregate in order to encourage competition, but larger resources, up to 5 MW, can participate.<sup>134</sup>

On July 25, 2024, FERC issued an order on PJM DER proposal.<sup>135 136</sup> The July 25<sup>th</sup> Order accepted the majority of PJM's proposals, including single node aggregation with a limited multinodal aggregation option, rules to prevent double payment to net energy metering resources, a two-step EDC and PJM registration process, a tariff definition of Electric Distribution Company ("EDC"), and settlement rules for DR with injections, a new resource type allowed for DER.

The July 25<sup>th</sup> Order directs PJM to submit a further compliance filing on issues including meter data submission deadlines, specification of information and data requirements, and clarification regarding EDC communication of overrides to PJM dispatch instructions. PJM submitted a compliance filing on October 23, 2024 ("October 23<sup>rd</sup> Filing"), proposing to keep a one business day deadline for meter data submission and to delay the effective date for the DER Aggregation Participation Model from February 2, 2026, to February 2, 2028. The October 23<sup>rd</sup> Filing also clarified that EDCs should communicate override decisions directly with the DER Aggregator and lists information requirements for Component DERs.

The DER Aggregation Participation Model allows net metering resources to participate in the ancillary services markets if they do not provide the same service as part of a retail program. It also allows multinodal aggregation for small resources but fails to clarify rules for DER with the ability to both curtail load and inject power, and does not include specific provisions for market monitoring of component DER and host EDCs.

The July 25<sup>th</sup> Order clarifies that if an EDC's override actions are discriminatory or involve the exercise of market power such behavior would violate the terms

of PJM's tariff and that such actions can be monitored and addressed through existing mechanisms such as Attachment M.<sup>137</sup> However, the proposed tariff language does not explicitly define the MMU's role in monitoring or mitigating the potential exercise of market power by EDCs. To enable efficient and effective market monitoring, EDCs and DERAs should be explicitly required to provide information requested by the MMU. The MMU recommends that the Commission require PJM to include in OATT Attachment M a statement explicitly affirming that the Market Monitor's role includes the right to collect information from EDCs and DERA related to actions taken on the distribution system related to DER Aggregation Resources.

Other design components require further implementation details. For example, while the July 25<sup>th</sup> Order accepted PJM's single node aggregation proposal, it remains unclear how the impact of Component DER on a single point of interconnection will be calculated. This will affect settlement prices and dispatch instructions, but PJM has considered it out of scope for the compliance filing and plans to address this in PJM Manuals as part of the implementation process. In addition, for the limited multinodal aggregation option, although the total capacity of all multinodal aggregations across PJM will not exceed 167 MW, it is still unknown whether and how PJM will apply market power mitigation to injections from the multinodal aggregations.

The accepted DER Aggregation Participation Model does not propose a maximum size requirement for DER Aggregation Resources. This loophole would allow larger DERs to divide one larger resource into multiple DERs less than 5 MW and register them as one DER Aggregation Resource. To avoid this loophole, there should be a maximum size requirement on DER Aggregation Resources. The MMU recommends that PJM include a 5.0 MW maximum size cap on DER aggregations.

Capacity market rules for DR with injection resources should also be established. Especially for the cases when there is one behind the meter generator that is used for both load reduction and energy injection, the capacity value of the resource should be limited at the maximum output of that behind the meter generator, not the sum of PLC and the capacity of the generator.

<sup>134</sup> 172 FERC ¶ 61,247 at PP 6–7 (2020).

<sup>135</sup> 188 FERC ¶ 61,076 ("July 25<sup>th</sup> Order").

<sup>136</sup> FERC Docket No. ER22-962-005 ("September 1<sup>st</sup> Filing").

<sup>137</sup> 188 FERC ¶ 61,076 at P169.

Getting the rules right at the beginning of DER development is essential to the active and effective participation of DER in the wholesale power markets in a manner that enhances rather than undermines the efficiency and competitiveness of the power markets. In addition, getting the implementation details right is critical in keeping the original intention of Order No. 2222 to enhance competition in wholesale markets while removing barriers for small distributed resources.

## EDC Role

The EDCs' dual role as the distribution system operator and as a DER aggregator is a threat to PJM's competitive market. When an EDC, acting in its proposed role as a market participant, controls its competitors' access to the market, the result is not structurally competitive. The result would be to create barriers to competition, exactly the opposite of FERC's intent. EDCs have a very significant role to play as designers, builders and managers of the local grids, without competing with DER providers. The accepted DER Aggregation Participation Model does not prevent EDCs from serving as DER aggregators or address the market power issues, based on a reference to the provision of Order No. 2222 that prohibits RTOs/ISOs from limiting the business models under which DER aggregators can operate. FERC, however, stated that it could revisit the EDCs' role in the PJM markets, if "evidence of undue discrimination regarding the participation of DER aggregations in RTO/ISO markets" is discovered.<sup>138</sup> The MMU continues to recommend that EDCs not be allowed to participate in markets as DER aggregators in addition to their EDC role.

Cases where EDCs override PJM dispatch instructions should be communicated to PJM and recorded in the PJM market systems for operations and market monitoring purposes. When DER Aggregation Resources update bidding parameters due to override instructions from the EDC, the MMU should be able to check whether the update is due to an override or other operational or economic reasons. When the EDC itself is the DER Aggregator and it overrides its PJM dispatch instruction, it should also be communicated to PJM and recorded.

## Net Metering Resources

According to PJM, no net metering resources in the PJM footprint provide ancillary services as part of a retail program. From PJM's perspective, this means all net metering resources in its territory are eligible to participate in its ancillary services market.<sup>139</sup> PJM argues that even if a resource is compensated for the same service, it should not be considered double counting. Under this proposal, a net metered resource that receives credits through its retail rate for reducing its ancillary services purchase can also receive payment from PJM for providing the same ancillary services. That is clearly double counting. The September 1<sup>st</sup> Filing states that EDCs may raise concerns about double counting but neither PJM nor EDC may preclude a Component DER from providing ancillary services based on the resources being compensated for ancillary services at the retail level. No resource should be paid more than once for its services. If the net energy metering resources receive credits at a rate that includes compensation for ancillary services, that means they are providing the service and being compensated for it.

<sup>138</sup> 182 FERC ¶ 61,143 at P 334.

<sup>139</sup> FERC Docket No. ER22-962-005 at 15.

## Net Revenue

The Market Monitoring Unit (MMU) analyzed measures of PJM energy market structure, participant conduct and market performance. As part of the review of market performance, the analysis includes the theoretical new entrant net revenues for combustion turbine (CT), combined cycle (CC), coal plant (CP), diesel (DS), nuclear, solar, and wind generating units. The analysis also includes actual net revenues and net revenue adequacy for all technology types, net revenue adequacy for nuclear plants, and an assessment of the units at risk of retirement.

### Overview

#### Net Revenue

- Energy market net revenues are significantly affected by energy prices and fuel prices. Energy prices and eastern gas prices increased and western gas and coal prices decreased in 2024 compared to 2023. The net effects were that in 2024, average energy market theoretical net revenues increased by 21 percent for a new combustion turbine (CT), increased by 9 percent for a new combined cycle (CC), increased by 67 percent for a new coal plant (CP), increased by 4 percent for a new nuclear plant, increased by 313 percent for a new diesel (DS), increased by 6 percent for a new onshore wind installation, increased by 12 percent for a new offshore wind installation and increased by 17 percent for a new solar installation.
- The price of eastern natural gas increased and the prices of western natural gas and coal decreased in 2024. The marginal costs of a new CC and CT were greater than the marginal cost of a new CP only in January 2024.
- In 2024, spark spreads and dark spreads and the volatility of spark spreads and dark spreads increased in BGE, COMED, PSEG and Western Hub compared to 2023.
- In 2024, capacity market revenue accounted for 21 percent of theoretical total net revenues for a new CT, 16 percent for a new CC, 37 percent for a new CP, 6 percent for a new nuclear plant, 62 percent for a new DS, 2 percent for a new onshore wind installation, 3 percent for a new offshore wind installation and 3 percent for a new solar installation.
- In 2024, no new CT, CC, CP, nuclear, or DS units would have received sufficient total net revenue to cover levelized total costs in any zone.
- In 2024, a theoretical new entrant onshore wind installation would not have received sufficient net revenue to cover levelized total costs in any of the four zones analyzed. Renewable energy credits (RECs) were an average of 54 percent of the total net revenue of an onshore wind installation.
- In 2024, a theoretical new entrant offshore wind installation would not have received sufficient net revenue to cover levelized total costs in any of the three zones analyzed. Renewable energy credits were an average of 50 percent of the total net revenue of an offshore wind installation.
- In 2024, a theoretical new entrant solar installation would have received sufficient net revenue to cover more than 100 percent of levelized total costs in ACEC, JCPLC and PSEG and between 82 and 97 percent of levelized total costs in DPL and DOM. Renewable energy credits were an average of 74 percent of the total net revenue of a solar installation.
- In 2024, most units did not achieve full recovery of avoidable costs through net revenue from energy and ancillary services markets alone, illustrating the critical role of the capacity market in providing incentives for continued operation and investment. In 2024, capacity market revenue was sufficient to cover the shortfall between net energy revenue and avoidable costs for the majority of units and technology types in PJM, with the exception of coal and CT units.
- Of the 16 PJM nuclear plants analyzed, all are expected to cover their avoidable costs from energy and capacity market revenues in 2025 and 2026, without any subsidies.
- New entrant solar and wind resources are competitive with existing coal resources, including the effect of current federal tax subsidies and RECs revenues available to the intermittent resources.
- Between 30,633 and 34,733 MW of capacity are at risk of retirement by 2030, consisting of 4,684 MW currently announced retirements, 16,786 MW

expected to retire for regulatory reasons, and between 9,163 and 13,264 MW expected to be uneconomic. This capacity consists primarily of coal plants and CT units. Replacing the capacity of the retiring non-gas resources with gas-fired capacity would require between 1.5 and 1.7 BCF/day of new firm gas supply depending on the MW at risk and the extent to which new gas fired capacity is dual fuel.

## Recommendations

- The MMU recommends that the net revenue calculation used by PJM to calculate the net Cost of New Entry (CONE) and net ACR be based on a forward looking calculation of expected energy and ancillary services net revenues using historical revenues that are scaled based on forward prices for energy and fuel. (Priority: Medium. First reported 2019. Status: Not adopted.)

## Conclusion

Wholesale electric power markets are affected by externally imposed reliability requirements. A regulatory authority external to the market makes a determination as to the acceptable level of reliability which is enforced through a requirement to maintain a target level of installed or unforced capacity. The requirement to maintain a target level of installed capacity can be enforced via a variety of mechanisms, including government construction of generation, full requirement contracts with developers to construct and operate generation, state utility commission mandates to construct capacity, or capacity markets of various types. Regardless of the enforcement mechanism, the exogenous requirement to construct capacity in excess of what is constructed in response to energy market signals alone has an impact on energy markets. The reliability requirement results in maintaining a level of capacity in excess of the level that would result from the operation of an energy market alone. The result of that additional capacity is to reduce the level and volatility of energy market prices and to reduce the duration of high energy market prices. This, in turn, reduces net revenue to generation owners which reduces the incentive to invest. The exact level of both aggregate and locational excess capacity is a function of the calculation methods used by RTOs and ISOs. A basic purpose of the capacity market is to allow all cleared capacity resources the

opportunity to cover their net avoidable costs on an annual basis to ensure the economic sustainability of the reliable energy market.

PJM's introduction of a form of ELCC for defining available capacity has made the definition of reliability less clear. The reduction of ELCC derated capacity is volatile and subject to changes for reasons that are not clear to generation owners or other market participants.

## Net Revenue

When compared to annualized fixed costs and avoidable costs, net revenue is an indicator of generation investment profitability, and thus is a measure of overall market performance as well as a measure of the incentive to invest in new generation and to maintain existing generation in PJM markets. Net revenue equals total revenue received by generators from PJM energy, capacity and ancillary service markets, including uplift payments, and from the provision of black start and reactive services and capability, and from subsidies like RECs, less the short run marginal costs of energy production. In other words, net revenue is the amount that remains, after the short run marginal costs of energy production have been subtracted from gross revenue. Net revenue is the contribution to fixed costs, which include a return on investment, depreciation and income taxes, and to avoidable costs, which include long term and intermediate term operation and maintenance expenses.<sup>1</sup> Net revenue is the contribution to total fixed and avoidable costs received by generators from all PJM markets.

In a perfectly competitive, energy only market in long run equilibrium, net revenue from the energy market would be expected to equal the annualized fixed and avoidable costs for the marginal unit, including a competitive return on investment. The PJM market design includes other markets that contribute to the payment of fixed and avoidable costs. In PJM, the energy, capacity and ancillary service markets are all significant sources of revenue to cover the fixed and avoidable costs of generators, as are payments for the provision of black start and reactive services. Thus, in a perfectly competitive market in long run equilibrium, with energy, capacity and ancillary service markets, net revenue from all sources would be expected to equal the annualized fixed and avoidable costs of generation for


<sup>1</sup> Avoidable costs are sometimes referred to as going forward costs.



the marginal unit. Net revenue is a measure of whether generators are receiving competitive returns on invested capital and of whether market prices are high enough to encourage entry of new capacity and to encourage maintaining existing capacity. In actual wholesale power markets, where equilibrium seldom occurs, net revenue is expected to fluctuate above and below the equilibrium level based on actual conditions in all relevant markets. The current definition of net revenue is not fully accurate as the FERC ordered definition uses price-based offers at times and does not include revenue from opportunity cost adders for environmentally constrained resources.

Net revenues are significantly affected by energy prices, fuel prices and capacity prices. The real-time load-weighted average LMP in 2024 increased 8.5 percent from 2023, from \$31.08 per MWh to \$33.74 per MWh. Eastern gas prices increased and western gas and coal prices decreased in 2024 compared to 2023. The price of eastern natural gas was 6.0 percent higher, the price of western natural gas was 3.4 percent lower; the price of Northern Appalachian coal was 16.1 percent lower; the price of Central Appalachian coal was 9.9 percent lower; and the price of Powder River Basin coal was 3.9 percent lower (Figure 7-1).

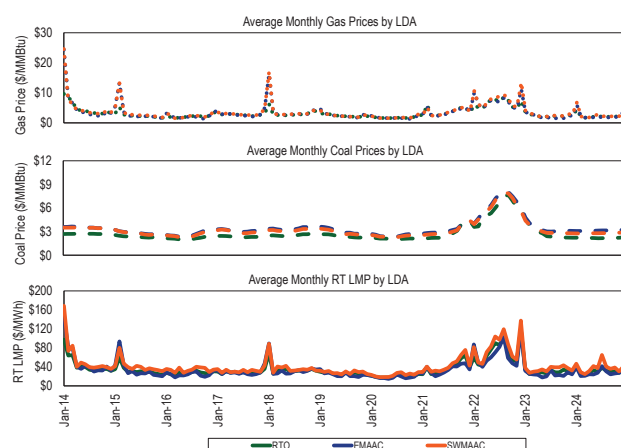**Figure 7-1 Energy market net revenue factor trends: 2014 through 2024**



## Spark Spreads and Dark Spreads

The spark or dark spread is defined as the difference between the LMP received for selling power and the cost of fuel used to generate power, converted to a cost per MWh. The spark spread compares power prices to the cost of gas and the dark spread compares power prices to the cost of coal. The spread is a measure of the approximate difference between revenues and marginal costs and is an indicator of net revenue and profitability.

$$\text{Spread} \left( \frac{\$}{\text{MWh}} \right) = \text{LMP} \left( \frac{\$}{\text{MWh}} \right) - \text{Fuel Price} \left( \frac{\$}{\text{MMBtu}} \right) * \text{Heat Rate} \left( \frac{\text{MMBtu}}{\text{MWh}} \right)$$

Spread volatility is a result of fluctuations in LMP and the price of fuel. Spreads can be positive or negative.

In 2024, spark spreads and dark spreads and the volatility of spark spreads and dark spreads increased in BGE, COMED, PSEG and Western Hub compared to 2023.

Table 7-1 shows average peak hour spreads by year and Table 7-2 shows the associated standard deviations.

**Table 7-1 Peak hour spark and dark spreads (\$/MWh)**


	BGE		COMED		PSEG		Western Hub	
	Spark	Dark	Spark	Dark	Spark	Dark	Spark	Dark
2023	\$29.72	\$12.18	\$15.42	\$8.21	\$13.92	(\$7.25)	\$23.60	\$6.48
2024	\$34.09	\$22.43	\$17.36	\$12.51	\$17.48	\$0.50	\$25.18	\$13.98
Percent change	15%	84%	13%	52%	26%	NA	7%	116%

**Table 7-2 Peak hour spark and dark spread standard deviation (\$/MWh)**


	BGE		COMED		PSEG		Western Hub	
	Spark	Dark	Spark	Dark	Spark	Dark	Spark	Dark
2023	\$35.7	\$36.1	\$19.0	\$19.3	\$21.0	\$19.7	\$30.1	\$27.9
2024	\$53.3	\$53.3	\$26.1	\$25.7	\$26.3	\$26.5	\$32.6	\$32.0
Percent change	49%	48%	37%	34%	25%	35%	8%	15%

Figure 7-2 shows the hourly spark spread for peak hours for BGE, COMED, PSEG, and Western Hub.

**Figure 7-2 Hourly spark spread (gas) for peak hours (\$/MWh): 2021 through 2024<sup>2</sup>**

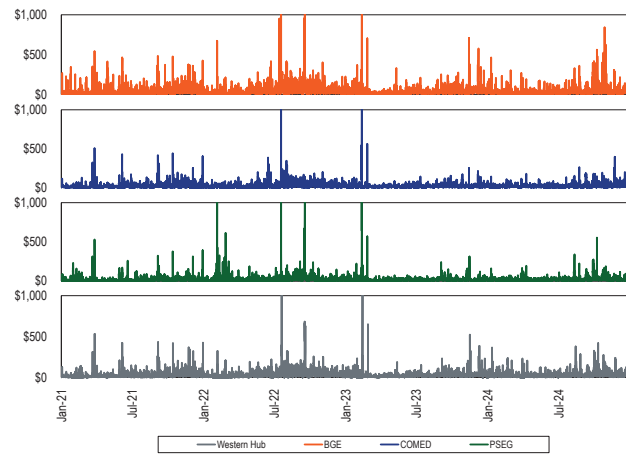

**Figure 7-3 Hourly dark spread (coal) for peak hours (\$/MWh): 2021 through 2024<sup>3</sup>**

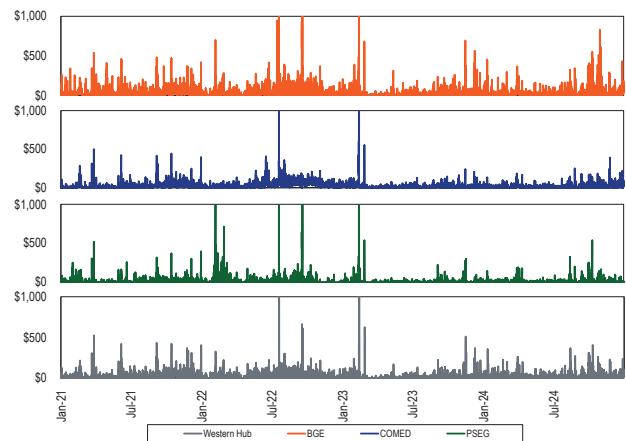

<sup>2</sup> Spark spreads use a combined cycle heat rate of 7,000 Btu/kWh, zonal hourly LMPs and daily gas prices; Chicago City Gate for COMED, Zone 6 non-NY for BGE, Zone 6 NY for PSEG, and Texas Eastern M3 for Western Hub.

<sup>3</sup> Dark spreads use a heat rate of 10,000 Btu/kWh, zonal hourly LMPs, daily coal prices, and average transportation costs by coal type; Powder River Basin coal for COMED, Northern Appalachian coal for BGE and Western Hub, and Central Appalachian coal for PSEG.

## Theoretical Energy Market Net Revenue

The net revenues presented in this section are theoretical as they are based on explicitly stated assumptions about how a new unit with specific characteristics would operate under economic dispatch. The economic dispatch uses technology specific operating constraints in the calculation of a new unit's operations and potential net revenue in PJM markets.

Analysis of energy market net revenues for a new unit includes eight power plant configurations:

- The CT plant is a single GE Frame 7HA.03 CT with an installed capacity of 409.3 MW, equipped with evaporative coolers, and selective catalytic reduction (SCR) for NO<sub>x</sub> reduction, and dual fuel capability.
- The CC plant includes two single shaft 1x1 GE Frame 7HA.02 CTs, each with a single combustion turbine, heat recovery steam generator, and steam turbine with a total installed capacity of 1,362 MW, equipped with SCR for NO<sub>x</sub> reduction, dry cooling, duct burners, and dual fuel capability.
- The CP is a subcritical steam unit with an installed capacity of 600.0 MW, equipped with selective catalytic reduction system (SCR) for NO<sub>x</sub> control, a flue gas desulphurization (FGD) system with chemical injection for SO<sub>x</sub> and mercury control, and a baghouse for particulate control.
- The DS plant is a single oil fired CAT 2 MW unit with an installed capacity of 2.0 MW using New York Harbor ultra low sulfur diesel.
- The nuclear plant includes two units and related facilities using the Westinghouse AP 1000 technology with an installed capacity of 2,200 MW.
- The onshore wind installation includes 104 Siemens 2.9 MW wind turbines with an installed capacity of 301.6 MW.
- The offshore wind installation includes of 40 Siemens 10.0 MW wind turbines with an installed capacity of 400.0 MW.
- The solar installation is a 472 acre ground mounted tracking solar farm with an installed AC capacity of 200 MW.

- The battery storage unit is a 2.5 MW, 10 hour battery capable of providing 2.5 MWh for 10 hours, or 25 MWh.

Net revenue calculations for the CT, CC and CP include the hourly effect of actual local ambient air temperature on plant heat rates and generator output for each of the three plant configurations.<sup>4,5</sup> Plant heat rates account for the efficiency changes and corresponding cost changes resulting from ambient air temperatures.

CO<sub>2</sub>, NO<sub>x</sub> and SO<sub>2</sub> emission allowance costs are included in the hourly plant dispatch cost, the short run marginal cost.<sup>6</sup> CO<sub>2</sub>, NO<sub>x</sub> and SO<sub>2</sub> emission allowance costs were obtained from daily spot cash prices.<sup>7</sup>

The class average equivalent availability factor for each type of plant was calculated from PJM data and incorporated into all revenue calculations.<sup>8</sup>

Revenues for the provision of reactive services include both real-time reactive service revenues and reactive capability revenues. Reactive service revenues for CT, CC, CP, and DS units are based on the average reactive service revenue per MW-year received by all generators of that unit type. Table 7-3 includes the class average reactive service revenues received plus reactive capability revenue by unit type.<sup>9</sup>

**Table 7-3 New entrant reactive revenue (Dollars per MW-year)**

	Reactive					
	CT	CC	CP	Diesel	Nuclear	Solar
2021	\$3,734	\$2,648	\$1,366	\$6,366	\$1,640	\$6,167
2022	\$2,917	\$2,504	\$1,771	\$7,042	\$1,762	\$8,040
2023	\$2,601	\$2,399	\$1,800	\$6,992	\$1,670	\$8,040
2024	\$2,403	\$2,592	\$3,390	\$5,989	\$2,096	\$3,896

Zonal net revenues reflect average zonal LMP and fuel costs based on locational fuel indices and zone specific delivery charges.<sup>10</sup> The delivered fuel cost for natural gas reflects the zonal, daily delivered price of natural gas from a specific pipeline and is from published commodity daily cash prices, with a basis adjustment

<sup>4</sup> Hourly ambient conditions supplied by DTN.

<sup>5</sup> Heat rates provided by Pasteris Energy, Inc. No load costs are included in the dispatch price since each unit type is dispatched at full load for every economic hour resulting in a single offer point.

<sup>6</sup> CO<sub>2</sub> emission allowance costs only included for states participating in RGGI.

<sup>7</sup> CO<sub>2</sub>, NO<sub>x</sub> and SO<sub>2</sub> emission daily prompt prices obtained from Evolution Markets, Inc.

<sup>8</sup> Outage figures obtained from the PJM eGADS database.

<sup>9</sup> Reactive capability revenue by unit type is located in the 2022 *Annual State of the Market Report for PJM*, Volume 2: Section 10, Ancillary Services Markets.

<sup>10</sup> Startup fuel burns and emission rates provided by Pasteris Energy, Inc. Startup station power consumption costs were obtained from the station service rates published quarterly by PJM and netted against the MW produced during startup at the preceding applicable hourly LMP. All starts associated with combined cycle units are assumed to be warm starts.

for transportation costs.<sup>11</sup> The delivered cost of coal reflects the zone specific, delivered price of coal and was developed from the published prompt month prices, adjusted for rail transportation costs.<sup>12</sup> Net revenues are calculated for all zones except OVEC.<sup>13</sup>


Short run marginal cost includes fuel costs, emissions costs, and the short run marginal component of VOM costs.<sup>14 15</sup> Average short run marginal costs are shown, including all components, in Table 7-4 and the short run marginal component of VOM is also shown separately.

**Table 7-4 Average short run marginal costs: 2024**

Unit Type	Short Run Marginal Costs (\$/MWh)	Heat Rate (Btu/kWh)	VOM (\$/MWh)
CT	\$26.19	9,241	\$0.54
CC	\$19.49	6,369	\$0.88
CP	\$36.98	9,250	\$5.64
DS	\$186.56	9,660	\$0.25
Nuclear	\$0.00	NA	\$0.00
Wind	\$0.00	NA	\$0.00
Wind (off shore)	\$0.00	NA	\$0.00
Solar	\$0.00	NA	\$0.00

A comparison of the monthly average short run marginal cost of the theoretical CT, CC and CP plants since 2014 shows that, on average, the short run marginal costs of the CC plant have been less than those of the CP plant but the costs of the CC plant have been more volatile than the costs of the CP plant as a result of the higher volatility of gas prices compared to coal prices (Figure 7-4). The marginal costs of a new CC and CT were greater than the marginal cost of a new CP only in January 2024. The marginal costs are based on spot fuel costs. Individual generation plants may have contracts for coal that differ significantly from spot prices.

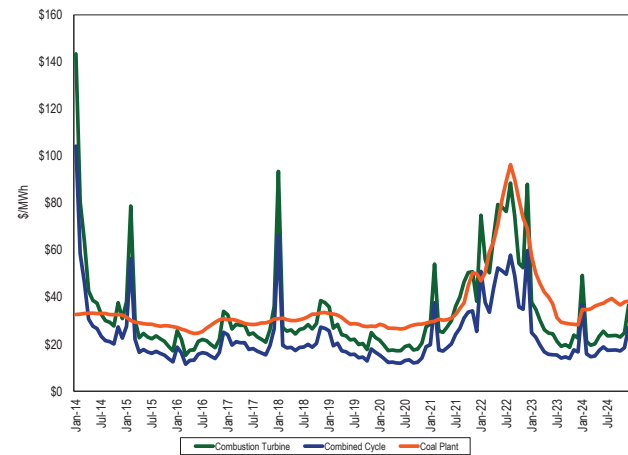**Figure 7-4 Average short run marginal costs: 2014 through 2024**



The net revenue measure does not include the potentially significant contribution from the explicit or implicit sale of the option value of physical units or from bilateral agreements to sell output at a price other than the PJM day-ahead or real-time energy market prices, e.g., a forward price.

Gas prices, coal prices, and energy prices are reflected in new unit capacity factors. Table 7-5 shows the average capacity factor for new units. The capacity factors for a new CC increased slightly in 2024 compared to 2023.

**Table 7-5 Average capacity factor: 2014 through 2024**

	On Shore						
	CT	CC	CP	DS	Nuclear	Wind	Solar
2014	48%	73%	58%	3%	92%	25%	15%
2015	64%	74%	52%	3%	92%	25%	17%
2016	65%	75%	46%	1%	92%	22%	16%
2017	53%	70%	40%	1%	94%	26%	17%
2018	52%	79%	42%	2%	94%	27%	16%
2019	52%	77%	24%	1%	93%	26%	15%
2020	48%	76%	13%	1%	93%	26%	16%
2021	42%	76%	37%	1%	93%	24%	17%
2022	40%	75%	30%	1%	93%	26%	16%
2023	60%	78%	25%	0%	94%	24%	16%
2024	60%	79%	33%	1%	92%	24%	19%

<sup>11</sup> Gas daily cash prices obtained from Platts.

<sup>12</sup> Coal prompt month prices obtained from Platts.

<sup>13</sup> The Ohio Valley Electric Corporation (OVEC) includes a generating plant in Ohio and a generating plant in Indiana, and high voltage transmission lines, but does not occupy a single geographic footprint like the other control zones.

<sup>14</sup> Fuel costs are calculated using the daily spot price and may not equal what individual participants actually paid.

<sup>15</sup> VOM rates provided by Pasteris Energy, Inc.

## Capacity Market Net Revenue

Generators receive revenue from the capacity market in addition to revenue from the energy and ancillary service markets. In the PJM market design, the capacity market provides an important source of revenue that contributes to covering generator avoidable costs and fixed costs. Capacity market revenue for 2024 includes five months of the 2023/2024 RPM capacity market clearing price and seven months of the 2024/2025 RPM capacity market clearing price.<sup>16</sup>

**Table 7-6 Capacity market revenue by zone (Dollars per MW-year): 2014 through 2024<sup>17</sup>**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
ACEC	\$66,206	\$56,448	\$50,948	\$43,669	\$65,655	\$58,103	\$57,650	\$63,835	\$45,967	\$25,368	\$19,282
AEP	\$31,149	\$48,128	\$33,377	\$34,645	\$53,235	\$45,873	\$31,371	\$41,525	\$31,842	\$14,854	\$11,377
APS	\$31,149	\$48,128	\$33,377	\$34,645	\$53,216	\$45,948	\$31,425	\$41,647	\$31,932	\$14,854	\$11,377
ATSI	\$31,149	\$95,422	\$78,709	\$42,929	\$53,124	\$45,781	\$31,351	\$48,221	\$36,571	\$14,854	\$11,377
BGE	\$63,360	\$56,448	\$50,948	\$43,669	\$52,953	\$45,651	\$33,380	\$49,311	\$49,777	\$30,062	\$22,618
COMED	\$31,149	\$48,128	\$33,377	\$34,645	\$63,994	\$75,508	\$70,901	\$70,256	\$44,273	\$17,708	\$11,377
DAY	\$31,149	\$48,128	\$33,377	\$34,645	\$52,760	\$44,969	\$30,957	\$41,516	\$31,840	\$14,854	\$11,377
DOM	\$31,149	\$48,128	\$33,377	\$34,645	\$53,219	\$45,665	\$31,221	\$41,516	\$31,840	\$14,854	\$11,377
DPL	\$66,206	\$56,448	\$50,948	\$43,669	\$65,106	\$57,607	\$57,573	\$63,835	\$45,967	\$26,669	\$22,399
DUKE	\$31,149	\$48,128	\$33,377	\$34,645	\$52,338	\$44,515	\$42,289	\$49,590	\$36,482	\$18,129	\$25,783
DUQ	\$31,149	\$48,128	\$33,377	\$34,645	\$53,045	\$45,567	\$31,239	\$41,516	\$31,840	\$14,854	\$11,377
EKPC	\$31,149	\$48,128	\$33,377	\$34,645	\$52,400	\$44,611	\$30,883	\$41,516	\$31,840	\$14,854	\$11,377
JCPLC	\$66,206	\$56,448	\$50,948	\$43,669	\$64,763	\$56,462	\$56,932	\$63,832	\$45,965	\$25,367	\$19,282
MEC	\$63,360	\$56,448	\$50,948	\$43,669	\$53,353	\$46,138	\$33,526	\$42,952	\$41,639	\$25,055	\$18,113
PE	\$63,360	\$56,448	\$50,945	\$43,667	\$53,154	\$45,760	\$33,376	\$42,966	\$41,639	\$25,055	\$18,113
PECO	\$66,206	\$56,448	\$50,948	\$43,669	\$65,707	\$58,548	\$57,940	\$63,835	\$45,967	\$25,368	\$19,282
PEPCO	\$66,529	\$56,448	\$50,948	\$43,669	\$53,323	\$46,207	\$33,590	\$42,952	\$41,639	\$25,055	\$18,113
PPL	\$63,360	\$56,448	\$50,948	\$43,669	\$52,218	\$45,398	\$33,569	\$42,980	\$41,659	\$25,055	\$18,113
PSEG	\$72,567	\$60,936	\$67,224	\$73,401	\$79,190	\$59,582	\$58,370	\$69,285	\$49,813	\$25,368	\$19,282
REC	\$72,567	\$60,936	\$67,224	\$73,401	\$79,190	\$59,582	\$58,370	\$69,285	\$49,813	\$25,368	\$19,282
PJM	\$46,247	\$54,646	\$48,568	\$44,809	\$58,432	\$52,009	\$42,222	\$50,695	\$39,442	\$20,155	\$15,030

## Net Revenue Adequacy

When total net revenues exceed the annual, nominal levelized total costs for the technology, that technology is covering all its costs including a return on and of capital and all the expenses of operating the facility.

The extent to which net revenues cover the levelized total costs of investment is significantly dependent on technology type and location, which affect both energy and capacity revenue.

Table 7-7 includes new entrant levelized total costs for selected technologies.

Net revenues include net revenues from the PJM Energy Market, from the PJM Capacity Market and from any applicable ancillary services plus RECs for wind installations and SRECs for solar installations.

## Levelized Total Costs

Levelized total costs are the nominal 20 year levelized revenue requirements for the capital costs of each technology. Levelized total costs include return on and of capital and fixed O&M expenses. Variable operating expenses including fuel and variable operations and maintenance expenses are not included.

<sup>16</sup> The RPM revenue values for PJM are load-weighted average clearing prices across the relevant base residual auctions. Differences in capacity market revenue reflect differences in clearing prices across LDAs.

<sup>17</sup> See the 2024 Annual State of the Market Report for PJM, Appendix A: "PJM Geography," for details on the expansion of the PJM footprint.



**Table 7-7 New entrant 20-year levelized total costs (By plant type (Dollars per installed MW-year))<sup>18 19 20 21</sup>**

	20-Year Levelized Total Cost										
	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
Combustion Turbine	\$122,604	\$120,675	\$119,346	\$114,557	\$118,116	\$121,612	\$120,720	\$134,297	\$149,470	\$163,333	\$185,198
Combined Cycle	\$146,443	\$146,300	\$148,327	\$129,731	\$113,641	\$116,781	\$119,180	\$132,378	\$172,009	\$183,473	\$184,198
Coal Plant	\$504,050	\$517,017	\$523,540	\$528,701	\$562,747	\$581,567	\$599,912	\$635,027	\$678,134	\$725,839	\$742,650
Diesel Plant	\$161,746	\$170,500	\$173,182	\$158,817	\$154,683	\$169,859	\$177,843	\$206,097	\$231,006	\$264,310	\$289,802
Nuclear Plant	\$880,770	\$935,659	\$963,107	\$1,349,850	\$1,178,607	\$1,383,428	\$1,383,428	\$1,706,638	\$1,706,638	\$1,768,834	\$2,048,086
On Shore Wind Installation (with 30% ITC)	\$198,033	\$202,874	\$231,310	\$188,747	\$214,780	\$214,618	\$208,167	\$245,031	\$238,038	\$256,990	\$253,435
Off Shore Wind Installation (with 30% ITC)	-	-	-	-	\$683,771	\$710,472	\$707,739	\$783,374	\$678,226	\$779,762	\$799,229
Solar Installation (with 30% ITC)	\$236,289	\$234,151	\$218,937	\$200,931	\$232,230	\$243,936	\$189,391	\$153,261	\$206,778	\$211,057	\$215,060
Battery Storage	-	-	-	-	-	-	-	\$865,686	\$691,548	\$771,901	\$739,510

## Levelized Cost of Energy

The levelized cost of energy (LCOE) is a measure of the total cost per MWh of energy from a technology, including all fixed and variable costs. The LCOE includes the levelized total costs plus short run marginal costs in \$/MWh, based on an identified capacity factor. If a unit's revenues cover its levelized cost of energy, it is covering all its costs and earning the target rate of return. The LCOE is the standalone energy price needed for the unit type to be competitive. Revenues from the capacity market, ancillary services markets and subsidies reduce the LCOE required from the energy market.

Table 7-8 shows the levelized cost of energy for a new entrant unit by technology type operating at the capacity factor for the new entrant unit type.

The levelized cost of all units is sensitive to the capacity factor used. The LCOE of a solar installation is shown using a capacity factor of 19 percent. The LCOE of a solar installation would be \$82/MWh if a capacity factor of 30 percent were used because the costs are distributed over a greater number of MWh.<sup>22</sup>

**Table 7-8 Levelized cost of energy: 2024**

	CT	CC	CP	DS	Nuclear	Wind (On Shore)	Wind (Off Shore)	Solar
Levelized cost (\$/MW-year)	\$185,198	\$184,198	\$742,650	\$289,802	\$2,048,086	\$253,435	\$799,229	\$215,060
Short run marginal costs (\$/MWh)	\$26.19	\$19.49	\$36.98	\$186.56	\$0.00	\$0.00	\$0.00	\$0.00
Capacity factor (%)	60%	78%	25%	0%	96%	16%	40%	19%
Levelized cost of energy (\$/MWh)	\$61	\$46	\$378	\$19,788	\$244	\$180	\$228	\$129

## New Entrant Combustion Turbine

Energy market net revenue was calculated for a new CT plant economically dispatched by PJM. It was assumed that the CT plant had a minimum run time of two hours. The unit was first committed day ahead in profitable blocks of at least two hours, including start costs. If the unit was not already committed day ahead, it was run in real time in standalone profitable blocks of at least two hours, or any additional profitable hours bordering the profitable day-ahead or real-time block.

The new entrant CT is larger and more efficient than most CTs currently operating in PJM. The new entrant CT energy market net revenue results must therefore be interpreted carefully when comparing to existing CTs which are generally smaller and less efficient than the newest CT technology used by the new entrant CT.

<sup>18</sup> Levelized total costs provided by Pasteris Energy, Inc. The annual costs were based on a 20-year project life, 50/50 debt to equity capital structure with a target IRR of 12 percent and a debt rate of 7 percent. For depreciation, the analysis assumed 80 percent bonus depreciation and a 15-year modified accelerated cost-recovery schedule (MACRS) for the CT plant and 20-year MACRS for the CC plant. An annual rate of cost inflation of 2.5 percent was used in all calculations.

<sup>19</sup> Bonus depreciation is 100 percent for capital investments placed in service after September 27, 2017 and before January 1, 2023. Bonus depreciation is 80 percent for capital investments placed in service after December 31, 2022, and before January 1, 2024, and the bonus depreciation level is reduced by 20 percent for each subsequent year through 2026. Capital investments placed in service after December 31, 2026, are not eligible for bonus depreciation. See 26 U.S. Code §168(k)(6)(A).

<sup>20</sup> Under the Inflation Reduction Act solar and wind energy properties are eligible for an Investment Tax Credit of 30 percent of the total eligible capital cost of the project if they meet prevailing wage requirements. Solar and wind technologies may qualify for an additional 10 percent if they satisfy domestic content requirements. Solar and energy storage projects may qualify for an additional 10 percent tax credits for projects built within an energy community, as defined by the IRA. This analysis assumes eligibility only for the 30 percent ITC.

<sup>21</sup> The battery is a 25 MWh battery capable of producing 2.5 MW for 10 hours. The 20-year levelized total cost for the battery is calculated using a 2.5 MW installed capacity.

<sup>22</sup> Nuclear, solar, and onshore wind capacity factor from the 2024 Annual State of the Market Report for PJM, Volume 2, Section 5: "Capacity Market." CT, CC, CP and DS capacity factors are based on the dispatch of the new entrant units.

New entrant CT plant energy market net revenues were lower in five of the 20 zones in 2024 as a result of the relative changes in energy and gas prices in those zones (Table 7-9).

**Table 7-9 Energy net revenue for a new entrant gas fired CT under economic dispatch: 2014 through 2024 (Dollars per installed MW-year)<sup>23</sup>**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	Change in 2024 from 2023
ACEC	\$84,836	\$50,794	\$52,699	\$28,997	\$34,625	\$24,051	\$9,052	\$13,214	\$65,244	\$29,686	\$26,775	(10%)
AEP	\$74,978	\$69,424	\$55,360	\$36,440	\$72,928	\$44,651	\$33,410	\$57,279	\$119,007	\$65,003	\$84,154	29%
APS	\$101,376	\$97,467	\$61,544	\$48,564	\$71,758	\$24,930	\$19,200	\$38,134	\$87,361	\$79,288	\$97,528	23%
ATSI	\$55,573	\$59,263	\$53,052	\$38,949	\$86,415	\$45,733	\$33,690	\$56,512	\$113,667	\$60,876	\$97,212	60%
BGE	\$99,953	\$79,092	\$92,965	\$40,064	\$52,362	\$33,157	\$31,522	\$55,829	\$148,692	\$108,608	\$101,593	(6%)
COMED	\$34,672	\$32,378	\$34,109	\$22,162	\$32,571	\$23,501	\$18,530	\$32,811	\$76,274	\$43,956	\$60,183	37%
DAY	\$49,905	\$57,180	\$51,652	\$37,682	\$81,172	\$51,092	\$40,100	\$72,267	\$132,357	\$70,302	\$106,360	51%
DOM	\$67,601	\$68,742	\$64,140	\$37,075	\$57,676	\$35,826	\$28,998	\$62,761	\$159,441	\$72,730	\$102,681	41%
DPL	\$65,984	\$33,315	\$26,615	\$19,853	\$28,229	\$14,604	\$14,297	\$30,640	\$94,804	\$55,281	\$56,552	2%
DUKE	\$44,998	\$54,542	\$48,954	\$36,051	\$88,626	\$46,495	\$36,049	\$67,055	\$125,035	\$66,440	\$95,826	44%
DUQ	\$52,029	\$81,445	\$72,284	\$46,308	\$57,854	\$30,516	\$31,432	\$48,663	\$120,066	\$89,952	\$90,572	1%
EKPC	\$65,277	\$56,514	\$48,036	\$30,024	\$55,351	\$37,022	\$29,760	\$55,345	\$108,260	\$52,910	\$70,620	33%
JCPLC	\$85,599	\$48,957	\$48,143	\$32,391	\$32,118	\$23,755	\$9,133	\$12,844	\$64,221	\$31,489	\$24,944	(21%)
MEC	\$87,153	\$87,946	\$71,178	\$55,484	\$44,929	\$29,492	\$36,074	\$61,924	\$148,217	\$61,810	\$69,273	12%
PE	\$139,617	\$140,467	\$89,309	\$63,620	\$83,911	\$41,273	\$44,218	\$65,558	\$131,818	\$97,206	\$114,360	18%
PECO	\$89,208	\$86,138	\$66,527	\$46,494	\$38,961	\$22,037	\$26,723	\$27,052	\$85,868	\$34,706	\$59,258	71%
PEPCO	\$70,396	\$50,496	\$46,753	\$25,829	\$42,134	\$21,041	\$14,094	\$37,521	\$90,124	\$53,264	\$70,137	32%
PPL	\$212,119	\$155,947	\$72,532	\$59,248	\$81,558	\$28,443	\$30,634	\$53,261	\$130,167	\$62,110	\$76,966	24%
PSEG	\$108,432	\$99,278	\$71,988	\$54,477	\$44,574	\$24,808	\$9,575	\$16,699	\$67,739	\$31,611	\$24,991	(21%)
REC	\$80,365	\$55,796	\$53,746	\$34,467	\$35,019	\$25,217	\$11,413	\$26,286	\$67,914	\$38,582	\$30,998	(20%)
PJM	\$58,381	\$73,259	\$59,079	\$39,709	\$56,138	\$31,382	\$25,395	\$44,583	\$106,814	\$60,290	\$73,049	21%

In 2024, a new CT would not have received sufficient net revenue to cover levelized total costs in any zone (Table 7-10).


**Table 7-10 Percent of 20-year levelized total costs recovered by CT energy and capacity net revenue: 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
ACEC	126%	92%	90%	67%	88%	70%	59%	60%	76%	35%	26%
AEP	90%	100%	77%	65%	110%	77%	57%	76%	103%	50%	53%
APS	111%	124%	82%	76%	109%	61%	45%	62%	82%	59%	60%
ATSI	74%	131%	113%	75%	122%	78%	57%	81%	102%	48%	60%
BGE	136%	115%	123%	76%	93%	68%	57%	81%	135%	86%	68%
COMED	57%	70%	59%	53%	85%	84%	77%	80%	83%	39%	40%
DAY	69%	90%	74%	67%	117%	82%	62%	88%	112%	54%	65%
DOM	84%	100%	85%	66%	97%	70%	53%	80%	130%	55%	63%
DPL	111%	77%	68%	59%	83%	62%	63%	73%	96%	52%	44%
DUKE	65%	88%	72%	65%	123%	78%	68%	90%	110%	53%	67%
DUQ	71%	110%	91%	74%	97%	65%	55%	70%	104%	66%	56%
EKPC	82%	90%	71%	60%	95%	70%	54%	75%	96%	43%	46%
JCPLC	127%	90%	86%	70%	86%	69%	58%	60%	76%	36%	25%
MEC	126%	123%	105%	90%	87%	65%	61%	81%	129%	55%	48%
PE	169%	166%	120%	97%	120%	74%	68%	84%	118%	76%	73%
PECO	130%	121%	101%	82%	92%	69%	73%	70%	90%	38%	44%
PEPCO	115%	92%	85%	64%	84%	58%	43%	63%	90%	50%	49%
PPL	228%	179%	106%	93%	117%	64%	57%	74%	117%	55%	53%
PSEG	151%	136%	120%	115%	108%	72%	60%	67%	81%	36%	25%
REC	128%	100%	104%	98%	100%	73%	61%	74%	81%	41%	28%
PJM	88%	109%	93%	77%	101%	71%	59%	74%	100%	51%	49%

<sup>23</sup> The energy net revenues presented for the PJM area in this section are calculated using the zonal average LMP.

Figure 7-5 shows zonal net revenue and the annual levelized total cost for the new entrant CT by LDA.

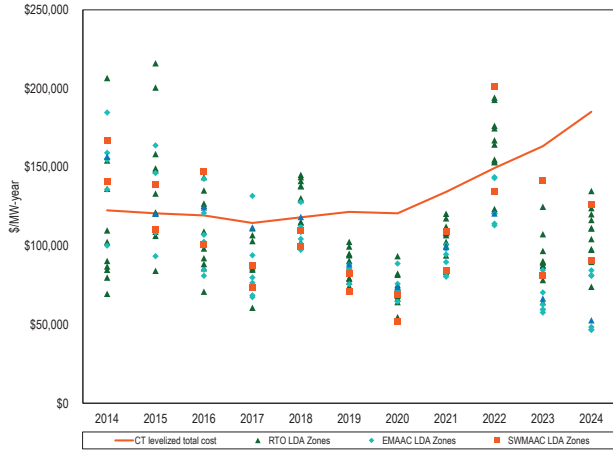**Figure 7-5 New entrant CT net revenue and 20-year levelized total cost by LDA (Dollars per installed MW-year): 2014 through 2024**



## New Entrant Combined Cycle

Energy market net revenue was calculated for a new CC plant economically dispatched by PJM. It was assumed that the CC plant had a minimum run time of four hours. The unit was first committed day ahead in profitable blocks of at least four hours, including start costs.<sup>24</sup> The unit was allowed to extend its run in real time if it was profitable to do so.

New entrant CC plant energy market net revenues were lower in seven of the 20 zones in 2024 as a result of the relative changes in energy and gas prices in those zones (Table 7-11).

**Table 7-11 Energy net revenue for a new entrant CC under economic dispatch: 2014 through 2024 (Dollars per installed MW-year)<sup>25</sup>**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	Change in 2024 from 2023
ACEC	\$126,626	\$74,716	\$68,004	\$50,259	\$67,427	\$51,397	\$29,870	\$42,582	\$71,123	\$46,443	\$39,879	(14%)
AEP	\$109,036	\$96,826	\$76,488	\$59,550	\$109,104	\$74,927	\$55,042	\$96,601	\$208,879	\$103,715	\$114,720	11%
APS	\$154,231	\$140,352	\$98,353	\$76,282	\$117,114	\$64,383	\$54,111	\$94,052	\$168,877	\$108,047	\$132,994	23%
ATSI	\$82,670	\$87,902	\$74,459	\$60,987	\$120,740	\$75,846	\$55,328	\$97,104	\$201,560	\$98,934	\$127,245	29%
BGE	\$155,871	\$125,088	\$129,148	\$71,490	\$98,258	\$74,567	\$67,515	\$115,493	\$194,608	\$140,781	\$130,192	(8%)
COMED	\$47,229	\$54,134	\$53,187	\$38,278	\$56,006	\$45,150	\$34,101	\$60,244	\$139,223	\$71,893	\$80,736	12%
DAY	\$76,213	\$86,691	\$73,887	\$61,188	\$117,206	\$81,573	\$62,751	\$114,111	\$224,321	\$110,397	\$136,433	24%
DOM	\$106,993	\$98,562	\$86,903	\$60,969	\$92,066	\$67,760	\$50,597	\$103,129	\$240,238	\$112,152	\$131,680	17%
DPL	\$109,317	\$50,497	\$43,345	\$27,674	\$47,707	\$21,528	\$17,501	\$46,552	\$102,931	\$70,755	\$69,828	(1%)
DUKE	\$66,685	\$82,518	\$70,201	\$57,922	\$122,183	\$76,621	\$57,948	\$107,384	\$214,631	\$105,819	\$125,560	19%
DUQ	\$82,827	\$95,948	\$86,877	\$64,871	\$91,162	\$57,652	\$52,762	\$87,864	\$199,392	\$123,233	\$118,576	(4%)
EKPC	\$94,596	\$84,530	\$68,479	\$52,705	\$91,178	\$67,152	\$51,066	\$94,868	\$193,114	\$90,816	\$101,210	11%
JCPLC	\$129,943	\$73,929	\$63,904	\$53,388	\$64,877	\$51,790	\$30,243	\$45,452	\$72,004	\$49,682	\$38,976	(22%)
MEC	\$125,883	\$104,606	\$82,491	\$71,970	\$78,513	\$57,663	\$53,852	\$100,142	\$193,262	\$94,324	\$98,089	4%
PE	\$177,443	\$147,403	\$99,614	\$78,602	\$118,315	\$70,370	\$62,647	\$106,350	\$220,157	\$128,847	\$142,049	10%
PECO	\$130,760	\$105,080	\$77,959	\$64,772	\$74,100	\$48,733	\$44,819	\$62,746	\$112,684	\$60,505	\$86,510	43%
PEPCO	\$116,066	\$96,499	\$85,838	\$54,535	\$84,100	\$58,426	\$39,143	\$83,010	\$150,361	\$84,324	\$93,356	11%
PPL	\$232,421	\$155,117	\$83,707	\$73,720	\$108,706	\$54,358	\$48,885	\$91,085	\$215,043	\$92,517	\$103,002	11%
PSEG	\$157,117	\$118,918	\$83,897	\$72,328	\$81,207	\$53,768	\$32,989	\$50,230	\$74,914	\$49,667	\$39,859	(20%)
REC	\$125,098	\$79,151	\$68,279	\$55,405	\$66,816	\$53,845	\$33,766	\$60,666	\$110,722	\$58,253	\$50,980	(12%)
PJM	\$100,026	\$97,923	\$78,751	\$60,345	\$90,339	\$60,375	\$46,747	\$82,983	\$165,402	\$90,055	\$98,094	9%

<sup>24</sup> All starts associated with combined cycle units are assumed to be warm starts.

<sup>25</sup> The energy net revenues presented for the PJM area in this section represent the zonal average energy net revenues.

In 2024, a new CC would not have received sufficient net revenue to cover levelized total costs in any zone (Table 7-12).

**Table 7-12 Percent of 20-year levelized total costs recovered by CC energy and capacity net revenue: 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
ACEC	134%	93%	83%	75%	120%	97%	76%	82%	70%	40%	34%
AEP	98%	102%	77%	75%	146%	106%	75%	106%	141%	66%	70%
APS	129%	132%	92%	88%	153%	97%	75%	105%	118%	68%	80%
ATSI	80%	129%	106%	83%	156%	107%	76%	112%	140%	63%	77%
BGE	152%	127%	125%	92%	136%	106%	88%	126%	144%	94%	84%
COMED	56%	73%	61%	59%	109%	106%	91%	101%	108%	50%	51%
DAY	76%	96%	75%	77%	153%	111%	82%	120%	150%	70%	82%
DOM	97%	104%	84%	76%	131%	100%	72%	111%	160%	71%	79%
DPL	123%	76%	67%	58%	102%	71%	66%	85%	88%	54%	51%
DUKE	70%	93%	73%	74%	157%	107%	87%	121%	147%	69%	84%
DUQ	81%	102%	84%	79%	130%	91%	73%	100%	136%	77%	72%
EKPC	89%	94%	72%	70%	129%	99%	72%	105%	132%	59%	63%
JCPLC	137%	92%	81%	78%	117%	96%	76%	85%	70%	42%	33%
MEC	132%	113%	93%	92%	119%	92%	76%	110%	138%	66%	64%
PE	167%	143%	105%	97%	154%	102%	84%	115%	154%	85%	88%
PECO	137%	114%	90%	86%	126%	95%	89%	98%	94%	48%	59%
PEPCO	127%	108%	95%	78%	124%	92%	64%	97%	113%	61%	62%
PPL	205%	148%	94%	93%	145%	88%	72%	103%	151%	65%	67%
PSEG	160%	126%	105%	115%	144%	100%	80%	92%	74%	42%	34%
REC	138%	99%	94%	102%	131%	100%	80%	100%	95%	47%	40%
PJM	103%	108%	89%	84%	134%	99%	78%	103%	121%	61%	63%

Figure 7-6 shows zonal net revenue and the annual levelized total cost for the new entrant CC by LDA.

**Figure 7-6 New entrant CC net revenue and 20-year levelized total cost by LDA (Dollars per installed MW-year): 2014 through 2024**



## New Entrant Coal Plant

Energy market net revenue was calculated for a new CP plant economically dispatched by PJM. It was assumed that the CP plant had a minimum run time of eight hours. The unit was first committed day ahead in profitable blocks of at least eight hours, including start costs. The unit was allowed to extend its run in real time if it was profitable to do so.

New entrant CP plant energy market net revenues were higher in all but three zones in 2024 as a result of higher dark spreads in most zones (Table 7-13).

**Table 7-13 Energy net revenue for a new entrant CP: 2014 through 2024 (Dollars per installed MW-year)<sup>26</sup>**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	Change in 2024 from 2023
ACEC	\$115,697	\$48,138	\$10,643	\$8,999	\$31,658	\$4,279	\$1,176	\$6,008	\$25,421	\$4,384	\$6,730	54%
AEP	\$113,144	\$52,219	\$40,332	\$38,197	\$66,584	\$19,004	\$7,807	\$53,319	\$46,705	\$18,227	\$48,662	167%
APS	\$105,457	\$42,154	\$15,210	\$19,486	\$44,638	\$5,688	\$2,413	\$19,025	\$29,088	\$25,212	\$23,620	(6%)
ATSI	\$124,565	\$52,704	\$35,451	\$38,199	\$68,869	\$14,847	\$4,630	\$47,849	\$55,405	\$19,203	\$43,489	126%
BGE	\$167,855	\$86,208	\$50,522	\$21,120	\$52,340	\$9,970	\$6,209	\$31,297	\$68,083	\$45,658	\$32,499	(29%)
COMED	\$112,699	\$40,858	\$30,660	\$27,836	\$38,710	\$12,822	\$2,983	\$53,710	\$216,121	\$59,959	\$66,149	10%
DAY	\$117,447	\$50,977	\$32,927	\$37,029	\$65,266	\$18,807	\$9,763	\$60,484	\$45,789	\$20,248	\$54,855	171%
DOM	\$156,315	\$91,939	\$46,734	\$30,562	\$68,684	\$17,805	\$9,438	\$58,809	\$140,531	\$40,344	\$74,959	86%
DPL	\$167,509	\$72,083	\$21,952	\$18,615	\$52,130	\$10,285	\$6,805	\$22,329	\$54,269	\$26,191	\$23,144	(12%)
DUKE	\$106,048	\$46,757	\$29,597	\$33,810	\$69,969	\$16,583	\$8,587	\$54,856	\$42,685	\$18,507	\$47,661	158%
DUQ	\$98,952	\$41,312	\$30,713	\$34,644	\$68,317	\$13,181	\$5,229	\$45,942	\$49,483	\$22,169	\$41,304	86%
EKPC	\$102,305	\$38,740	\$25,523	\$27,221	\$45,357	\$12,475	\$6,577	\$49,103	\$40,731	\$16,323	\$44,444	172%
JCPLC	\$119,656	\$46,725	\$7,933	\$9,818	\$30,805	\$4,074	\$1,386	\$6,107	\$26,217	\$4,258	\$6,115	44%
MEC	\$153,809	\$65,100	\$19,709	\$22,951	\$50,243	\$9,800	\$6,897	\$41,405	\$90,124	\$14,567	\$30,914	112%
PE	\$129,578	\$60,613	\$23,206	\$18,518	\$47,150	\$9,533	\$5,186	\$36,910	\$61,695	\$20,454	\$45,150	121%
PECO	\$111,207	\$44,763	\$8,709	\$9,112	\$29,402	\$4,053	\$871	\$14,715	\$37,742	\$4,485	\$14,638	226%
PEPCO	\$114,167	\$41,190	\$10,634	\$7,522	\$29,682	\$4,342	\$1,347	\$24,629	\$37,332	\$16,211	\$20,812	28%
PPL	\$110,250	\$43,645	\$7,050	\$9,171	\$29,146	\$3,234	\$1,069	\$24,886	\$42,694	\$4,651	\$12,380	166%
PSEG	\$174,390	\$72,864	\$13,651	\$14,719	\$36,384	\$6,201	\$489	\$6,048	\$34,409	\$4,931	\$6,098	24%
REC	\$170,401	\$73,116	\$13,238	\$13,921	\$36,301	\$7,234	\$1,279	\$11,829	\$37,707	\$4,568	\$7,339	61%
PJM	\$128,573	\$55,605	\$23,720	\$22,072	\$48,082	\$10,211	\$4,507	\$33,463	\$59,112	\$19,527	\$32,548	67%

In 2024, a new CP would not have received sufficient net revenue to cover levelized total costs in any zone (Table 7-14). This has been the consistent result for a new CP for the entire period of the analysis.

**Table 7-14 Percent of 20-year levelized total costs recovered by CP energy and capacity net revenue: 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
ACEC	37%	21%	12%	11%	18%	11%	10%	11%	11%	4%	4%
AEP	29%	20%	15%	14%	22%	12%	7%	15%	12%	5%	9%
APS	28%	18%	10%	11%	18%	10%	6%	10%	9%	6%	5%
ATSI	32%	29%	22%	16%	23%	11%	7%	15%	14%	5%	8%
BGE	47%	28%	20%	13%	20%	10%	7%	13%	18%	11%	8%
COMED	29%	18%	13%	12%	19%	16%	13%	20%	39%	11%	11%
DAY	30%	20%	13%	14%	22%	12%	7%	16%	12%	5%	9%
DOM	38%	28%	16%	13%	23%	12%	7%	16%	26%	8%	12%
DPL	47%	26%	15%	12%	22%	12%	11%	14%	15%	8%	7%
DUKE	28%	19%	13%	14%	23%	11%	9%	17%	12%	5%	10%
DUQ	27%	18%	13%	14%	22%	11%	7%	14%	12%	5%	8%
EKPC	27%	17%	12%	12%	18%	10%	7%	14%	11%	5%	8%
JCPLC	38%	21%	12%	11%	18%	11%	10%	11%	11%	4%	4%
MEC	44%	24%	14%	13%	19%	10%	7%	13%	20%	6%	7%
PE	39%	23%	15%	12%	19%	10%	7%	13%	15%	7%	9%
PECO	36%	20%	12%	11%	18%	11%	10%	13%	13%	4%	5%
PEPCO	37%	20%	12%	10%	16%	9%	6%	11%	12%	6%	6%
PPL	35%	20%	12%	11%	15%	9%	6%	11%	13%	4%	5%
PSEG	50%	27%	16%	17%	21%	12%	10%	12%	13%	4%	4%
REC	49%	27%	16%	17%	21%	12%	11%	13%	13%	4%	4%
PJM	35%	22%	14%	13%	20%	11%	8%	13%	15%	6%	7%

<sup>26</sup> The energy net revenues presented for the PJM area in this section represent the zonal average energy net revenues.



Figure 7-7 shows zonal net revenue and the annual levelized total cost for the new entrant CP by LDA.

**Figure 7-7 New entrant CP net revenue and 20-year levelized total cost by LDA (Dollars per installed MW-year): 2014 through 2024**



## New Entrant Nuclear Plant

Energy market net revenue was calculated assuming that the nuclear plant was dispatched day ahead by PJM for all available plant hours. The unit runs for all hours and output reflects the class average equivalent availability factor.<sup>27</sup>

New entrant nuclear plant energy market net revenues were slightly lower in six zones and higher in 14 zones in 2024 as a result of changes in day-ahead energy prices by zone (Table 7-15).

**Table 7-15 Energy net revenue for a new entrant nuclear plant: 2014 through 2024 (Dollars per installed MW-year)<sup>28</sup>**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	Change in 2024 from 2023
ACEC	\$430,088	\$273,691	\$200,584	\$226,845	\$285,185	\$192,221	\$147,168	\$260,754	\$510,487	\$196,597	\$223,604	14%
AEP	\$358,889	\$259,420	\$226,969	\$241,589	\$291,370	\$217,407	\$170,937	\$314,652	\$568,246	\$254,454	\$253,088	(1%)
APS	\$383,546	\$282,041	\$231,832	\$245,633	\$302,994	\$216,401	\$170,914	\$316,672	\$577,110	\$264,252	\$262,499	(1%)
ATSI	\$371,823	\$262,859	\$228,329	\$246,859	\$305,160	\$219,369	\$170,965	\$312,693	\$562,963	\$252,392	\$255,507	1%
BGE	\$482,796	\$352,161	\$296,138	\$268,966	\$332,101	\$237,019	\$194,052	\$354,544	\$663,414	\$312,889	\$325,619	4%
COMED	\$322,257	\$225,655	\$213,368	\$221,193	\$235,676	\$191,318	\$154,963	\$284,104	\$489,572	\$218,674	\$207,427	(5%)
DAY	\$361,855	\$261,380	\$228,084	\$246,977	\$301,482	\$226,472	\$179,830	\$332,994	\$588,506	\$265,232	\$265,369	0%
DOM	\$430,421	\$311,499	\$250,271	\$260,185	\$323,948	\$225,667	\$176,991	\$339,702	\$677,389	\$293,362	\$300,549	2%
DPL	\$467,506	\$301,832	\$224,906	\$245,767	\$314,185	\$203,224	\$159,794	\$300,139	\$546,648	\$220,644	\$254,572	15%
DUKE	\$347,738	\$256,348	\$223,698	\$242,729	\$307,041	\$220,799	\$174,520	\$324,772	\$577,793	\$260,372	\$253,912	(2%)
DUQ	\$340,525	\$249,258	\$222,416	\$242,278	\$304,190	\$216,018	\$171,585	\$308,427	\$552,782	\$254,468	\$251,474	(1%)
EKPC	\$343,061	\$246,594	\$218,753	\$234,319	\$274,749	\$214,080	\$170,356	\$316,730	\$571,101	\$254,242	\$248,745	(2%)
JCPLC	\$434,325	\$272,261	\$195,704	\$231,523	\$282,490	\$192,909	\$147,714	\$267,340	\$520,340	\$203,055	\$223,863	10%
MEC	\$417,516	\$265,313	\$198,714	\$236,723	\$282,769	\$199,556	\$155,273	\$307,271	\$593,991	\$224,840	\$233,114	4%
PE	\$394,697	\$271,023	\$215,556	\$236,980	\$291,292	\$207,398	\$162,672	\$303,466	\$556,824	\$250,153	\$260,652	4%
PECO	\$421,701	\$266,837	\$193,380	\$226,787	\$277,512	\$188,645	\$145,298	\$259,904	\$500,962	\$187,932	\$220,583	17%
PEPCO	\$467,154	\$328,709	\$266,428	\$263,124	\$323,833	\$230,232	\$180,809	\$341,826	\$641,058	\$296,184	\$309,920	5%
PPL	\$418,032	\$265,864	\$195,230	\$228,451	\$273,036	\$188,993	\$146,492	\$282,094	\$548,480	\$207,263	\$217,754	5%
PSEG	\$456,679	\$283,287	\$200,257	\$237,187	\$286,834	\$194,920	\$149,103	\$272,398	\$526,856	\$204,542	\$225,972	10%
REC	\$451,926	\$284,922	\$201,343	\$237,924	\$289,049	\$199,553	\$153,187	\$289,459	\$545,519	\$219,025	\$245,034	12%
PJM	\$405,127	\$276,048	\$221,598	\$241,102	\$294,245	\$209,110	\$164,131	\$304,497	\$566,002	\$242,029	\$251,963	4%

<sup>27</sup> The annual class average equivalent availability factor was used in the calculation of energy market net revenues.

<sup>28</sup> The energy net revenues presented for the PJM area in this section represent the zonal average energy net revenues because fuel costs for nuclear units are included in the NEI nuclear costs.

In 2024, a new nuclear plant would not have received sufficient net revenue to cover levelized total costs in any zone (Table 7-16). This has been the consistent result for a new nuclear plant for the entire period of the analysis.

**Table 7-16 Percent of 20-year levelized total costs recovered by nuclear energy and capacity net revenue: 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
ACEC	57%	36%	26%	20%	30%	18%	15%	19%	33%	13%	12%
AEP	45%	33%	27%	21%	30%	19%	15%	21%	35%	15%	13%
APS	47%	36%	28%	21%	31%	19%	15%	21%	36%	16%	13%
ATSI	46%	39%	32%	22%	31%	19%	15%	21%	35%	15%	13%
BGE	62%	44%	36%	23%	33%	21%	17%	24%	42%	19%	17%
COMED	41%	30%	26%	19%	26%	20%	17%	21%	31%	13%	11%
DAY	45%	33%	27%	21%	30%	20%	15%	22%	36%	16%	14%
DOM	53%	39%	30%	22%	32%	20%	15%	22%	42%	18%	15%
DPL	61%	39%	29%	22%	32%	19%	16%	21%	35%	14%	14%
DUKE	43%	33%	27%	21%	31%	19%	16%	22%	36%	16%	14%
DUQ	43%	32%	27%	21%	31%	19%	15%	21%	34%	15%	13%
EKPC	43%	32%	27%	20%	28%	19%	15%	21%	35%	15%	13%
JCPCL	57%	35%	26%	21%	30%	18%	15%	20%	33%	13%	12%
MEC	55%	35%	26%	21%	29%	18%	14%	21%	37%	14%	12%
PE	52%	35%	28%	21%	30%	19%	14%	20%	35%	16%	14%
PECO	56%	35%	26%	20%	29%	18%	15%	19%	32%	12%	12%
PEPCO	61%	42%	33%	23%	32%	20%	16%	23%	40%	18%	16%
PPL	55%	35%	26%	20%	28%	17%	13%	19%	35%	13%	12%
PSEG	60%	37%	28%	23%	31%	19%	15%	20%	34%	13%	12%
REC	60%	37%	28%	23%	32%	19%	16%	21%	35%	14%	13%
PJM	52%	36%	28%	21%	30%	19%	15%	21%	36%	15%	13%

**Figure 7-8 New entrant nuclear plant net revenue and 20-year levelized total cost by LDA (Dollars per installed MW-year): 2014 through 2024**



## New Entrant Diesel

Energy market net revenue was calculated for a DS plant economically dispatched by PJM in real time.

New entrant DS plant energy market net revenues were higher in all zones in 2024 as a result of higher and more volatile energy prices (Table 7-17).

**Table 7-17 Energy market net revenue for a new entrant DS: 2014 through 2024, (Dollars per installed MW-year)**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	Change in 2024 from 2023
ACEC	\$33,114	\$13,159	\$2,416	\$2,554	\$10,312	\$2,029	\$835	\$1,512	\$31,382	\$311	\$2,436	684%
AEP	\$14,469	\$3,968	\$987	\$1,420	\$4,154	\$5,138	\$1,182	\$3,654	\$30,455	\$549	\$1,936	253%
APS	\$18,020	\$7,423	\$1,051	\$1,343	\$6,675	\$4,662	\$2,092	\$3,676	\$30,858	\$751	\$2,702	260%
ATSI	\$14,114	\$3,675	\$2,090	\$1,773	\$7,209	\$4,537	\$2,548	\$3,301	\$28,724	\$584	\$3,068	425%
BGE	\$50,096	\$18,305	\$8,329	\$3,202	\$12,785	\$6,899	\$4,980	\$8,366	\$42,586	\$2,218	\$15,800	612%
COMED	\$11,320	\$2,327	\$748	\$1,333	\$730	\$3,476	\$821	\$3,172	\$18,752	\$217	\$1,253	479%
DAY	\$14,288	\$3,772	\$1,044	\$1,670	\$3,946	\$5,570	\$1,146	\$5,121	\$30,781	\$570	\$2,686	371%
DOM	\$42,609	\$12,064	\$2,596	\$2,765	\$15,094	\$5,841	\$1,863	\$9,114	\$42,683	\$3,399	\$9,103	168%
DPL	\$38,453	\$19,925	\$3,691	\$5,637	\$14,261	\$6,375	\$8,788	\$16,633	\$37,252	\$5,946	\$11,713	97%
DUKE	\$13,467	\$3,288	\$1,415	\$3,069	\$6,675	\$5,441	\$1,013	\$4,691	\$30,350	\$558	\$1,870	235%
DUQ	\$13,132	\$3,179	\$2,416	\$1,517	\$9,248	\$4,493	\$3,973	\$3,522	\$28,758	\$1,274	\$5,383	322%
EKPC	\$14,483	\$2,970	\$1,054	\$972	\$1,922	\$4,868	\$1,003	\$4,500	\$33,159	\$539	\$1,824	238%
JCPLC	\$33,066	\$13,042	\$923	\$2,848	\$11,134	\$2,085	\$1,614	\$1,430	\$31,247	\$314	\$2,519	702%
MEC	\$31,992	\$13,020	\$908	\$3,794	\$10,974	\$2,670	\$3,020	\$7,291	\$37,264	\$495	\$2,752	456%
PE	\$15,964	\$6,436	\$904	\$1,699	\$5,539	\$2,906	\$1,355	\$3,652	\$25,993	\$529	\$1,853	250%
PECO	\$32,360	\$12,429	\$875	\$2,839	\$9,838	\$2,077	\$1,421	\$1,693	\$31,158	\$292	\$3,681	1,161%
PEPCO	\$51,396	\$12,842	\$3,551	\$2,497	\$12,363	\$6,314	\$1,884	\$6,302	\$40,652	\$1,657	\$11,143	572%
PPL	\$32,931	\$13,062	\$796	\$2,988	\$8,799	\$1,650	\$1,194	\$3,052	\$32,064	\$355	\$2,376	569%
PSEG	\$32,550	\$12,650	\$1,064	\$3,284	\$10,325	\$2,437	\$730	\$1,956	\$31,090	\$308	\$1,796	483%
REC	\$30,724	\$13,740	\$1,247	\$3,031	\$9,703	\$2,627	\$1,785	\$6,473	\$29,798	\$331	\$1,585	379%
PJM	\$29,787	\$9,564	\$1,905	\$2,512	\$8,584	\$4,105	\$2,162	\$4,955	\$32,250	\$1,060	\$4,374	313%

In 2024, the new entrant DS would not have received sufficient net revenue to cover levelized total costs in any zone. This has been the consistent result for a new DS for the entire period of the analysis.

**Table 7-18 Percent of 20-year levelized total costs recovered by DS energy and capacity net revenue: 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
ACEC	63%	43%	33%	31%	51%	37%	35%	35%	37%	12%	10%
AEP	30%	33%	22%	25%	39%	32%	20%	25%	30%	8%	7%
APS	32%	35%	22%	25%	41%	32%	21%	25%	30%	9%	7%
ATSI	30%	60%	49%	30%	41%	32%	21%	28%	31%	8%	7%
BGE	72%	46%	36%	32%	45%	33%	23%	31%	43%	15%	15%
COMED	28%	32%	22%	25%	44%	48%	42%	39%	30%	9%	6%
DAY	30%	32%	22%	25%	39%	32%	20%	26%	30%	8%	7%
DOM	48%	37%	23%	26%	46%	32%	20%	28%	35%	10%	9%
DPL	67%	47%	33%	33%	53%	40%	39%	42%	39%	15%	14%
DUKE	30%	32%	22%	26%	40%	31%	26%	29%	32%	10%	12%
DUQ	29%	32%	23%	25%	42%	31%	22%	25%	29%	9%	8%
EKPC	30%	32%	22%	25%	37%	31%	20%	25%	31%	8%	7%
JCPLC	63%	43%	32%	31%	51%	36%	35%	35%	36%	12%	10%
MEC	61%	43%	32%	32%	44%	31%	22%	27%	37%	12%	9%
PE	51%	39%	32%	31%	40%	31%	21%	26%	32%	12%	9%
PECO	63%	42%	32%	31%	51%	38%	35%	35%	36%	12%	10%
PEPCO	75%	43%	33%	31%	45%	33%	22%	27%	39%	13%	12%
PPL	62%	43%	32%	31%	42%	30%	21%	25%	35%	12%	9%
PSEG	67%	45%	41%	50%	60%	38%	35%	38%	38%	12%	9%
REC	66%	46%	41%	50%	60%	39%	36%	40%	38%	12%	9%
PJM	49%	40%	31%	32%	45%	35%	27%	30%	34%	11%	9%

## New Entrant Onshore Wind Installation

Energy market net revenues for an onshore wind installation were calculated hourly assuming the unit generated at the average hourly capacity factor of all operating wind units in the zone with an installed capacity greater than 3 MW.<sup>29</sup>

Onshore wind energy market net revenues in 2024 were higher as a result of changes in energy prices.

**Table 7-19 Energy market net revenue for an onshore wind installation (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	Change in 2024 from 2023
AEP	\$106,499	\$78,929	\$67,826	\$71,312	\$93,621	\$70,434	\$47,589	\$78,259	\$178,329	\$65,591	\$71,065	8%
APS	\$108,148	\$72,504	\$62,352	\$71,867	\$95,329	\$58,628	\$47,685	\$74,369	\$138,891	\$65,061	\$67,988	4%
COMED	\$95,745	\$67,842	\$58,915	\$68,278	\$65,111	\$59,836	\$39,899	\$74,104	\$153,856	\$52,834	\$56,632	7%
PE	\$129,612	\$85,543	\$65,204	\$73,843	\$95,776	\$55,603	\$42,652	\$69,386	\$135,622	\$54,096	\$56,226	4%

The new entrant onshore wind installation analysis is based on a 21 percent ELCC derating factor for defining the MW offered in the capacity market.<sup>30</sup>

**Table 7-20 Capacity market net revenue for an onshore wind installation (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
AEP	\$5,482	\$8,471	\$5,874	\$6,097	\$9,369	\$8,074	\$5,521	\$7,308	\$4,776	\$5,199	\$2,389
APS	\$5,482	\$8,471	\$5,874	\$6,097	\$9,366	\$8,087	\$5,531	\$7,330	\$4,790	\$5,199	\$2,389
COMED	\$5,482	\$8,471	\$5,874	\$6,097	\$11,263	\$13,289	\$12,479	\$12,365	\$6,641	\$6,198	\$2,389
PE	\$11,151	\$9,935	\$8,966	\$7,685	\$9,355	\$8,054	\$5,874	\$7,562	\$6,246	\$8,769	\$3,804

Wind units were assumed to receive class average reactive capability payments.

**Table 7-21 Reactive capability revenue for an onshore wind installation (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
PJM	\$4,185	\$4,185	\$4,185	\$4,185	\$4,185	\$4,185	\$4,185	\$4,185	\$3,712	\$3,769	\$3,748

Wind units in the four zones were assumed to receive the higher of the MD or PA Tier I REC for the purposes of calculating RECs revenue.<sup>31</sup> Renewable energy credits were an average of 53 percent of the total net revenue of an onshore wind installation.

**Table 7-22 RECs revenue for an onshore wind installation (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
AEP	\$37,956	\$41,971	\$30,518	\$12,681	\$15,679	\$18,030	\$23,127	\$34,136	\$59,750	\$72,092	\$83,243
APS	\$36,437	\$33,539	\$26,854	\$12,202	\$15,350	\$14,957	\$22,491	\$31,896	\$50,576	\$68,899	\$77,555
COMED	\$40,539	\$41,676	\$28,828	\$13,526	\$15,102	\$18,602	\$23,227	\$38,802	\$66,679	\$76,693	\$95,442
PE	\$41,808	\$39,913	\$30,101	\$12,811	\$15,746	\$14,956	\$21,621	\$32,326	\$49,404	\$59,274	\$64,712

In 2024, a new entrant onshore wind installation would not have received sufficient net revenue to cover levelized total costs in any of the four zones analyzed. Net revenues would have covered between 50 and 62 percent of levelized total costs of a new entrant onshore wind installation in AEP, APS, COMED and PE.

Wind projects that are currently operating or under construction may have a different financing structure, require a lower rate of return, or have other factors that are not captured in the new entrant analysis presented in this section.

<sup>29</sup> Net revenues are calculated for zones in which there are sufficient operating units to determine capacity factor for a new entrant unit.

<sup>30</sup> PJM Planning. ELCC Class Ratings for 2024–2025. December 29, 2023. <<https://www.pjm.com/-/media/DotCom/planning/res-adeq/elcc/elcc-class-ratings-for-2024-2025.pdf>>.

<sup>31</sup> RECs prices obtained from Evolution Markets, Inc.

**Table 7-23 Percent of 20-year levelized total costs recovered by onshore wind net revenue (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
AEP	78%	66%	47%	50%	57%	47%	39%	51%	104%	57%	63%
APS	78%	59%	43%	50%	58%	40%	38%	48%	83%	56%	60%
COMED	74%	60%	42%	49%	45%	45%	38%	53%	97%	54%	62%
PE	94%	69%	47%	52%	58%	39%	36%	46%	82%	49%	51%

## New Entrant Offshore Wind Installation

Energy market net revenues for an offshore wind installation were calculated hourly assuming the unit generated at a 40 percent capacity factor.

Offshore wind energy market net revenues were higher in 2024 as a result of higher energy prices.

**Table 7-24 Energy market net revenue for an offshore wind installation (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	Change in 2024 from 2023
ACEC	\$179,272	\$115,153	\$85,800	\$97,466	\$121,958	\$83,127	\$64,796	\$112,040	\$230,428	\$81,647	\$96,671	18%
DOM	\$190,967	\$130,472	\$106,330	\$110,168	\$136,889	\$96,665	\$76,767	\$149,609	\$313,145	\$125,237	\$127,016	1%
DPL	\$195,582	\$128,928	\$93,634	\$107,415	\$136,339	\$88,160	\$72,655	\$132,600	\$250,728	\$94,706	\$108,712	15%

The new entrant offshore wind installation analysis is based on a 47 percent ELCC derating factor for defining the MW offered in the capacity market.<sup>32</sup>

**Table 7-25 Capacity market net revenue for an offshore wind installation (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
ACEC	\$26,482	\$22,579	\$20,379	\$17,467	\$26,262	\$23,241	\$23,060	\$25,534	\$18,387	\$11,923	\$9,062
DOM	\$12,460	\$19,251	\$13,351	\$13,858	\$21,287	\$18,266	\$12,489	\$16,606	\$12,736	\$6,981	\$5,347
DPL	\$26,482	\$22,579	\$20,379	\$17,467	\$26,043	\$23,043	\$23,029	\$25,534	\$18,387	\$12,534	\$10,528

Offshore wind units were assumed to receive the same class average reactive capability payments as onshore wind.

**Table 7-26 Reactive capability revenue for an offshore wind installation (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
PJM	\$4,185	\$4,185	\$4,185	\$4,185	\$4,185	\$4,185	\$4,185	\$4,185	\$3,712	\$3,769	\$3,748

The offshore wind unit in ACEC was assumed to receive NJ wind RECs. The offshore wind unit in DOM and DPL was assumed to receive the higher of the MD or PA Tier I REC for the purposes of calculating RECs revenue.<sup>33</sup> Renewable energy credits accounted for 50 percent of the total net revenue of an offshore wind installation.

**Table 7-27 RECs revenue for an offshore wind installation (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
ACEC	\$56,071	\$56,792	\$42,053	\$17,934	\$22,075	\$23,331	\$33,912	\$54,454	\$82,223	\$112,495	\$126,678
DOM	\$55,658	\$55,651	\$40,962	\$17,089	\$21,272	\$23,188	\$33,701	\$54,447	\$82,529	\$110,744	\$121,905
DPL	\$55,658	\$55,651	\$40,962	\$17,089	\$21,272	\$23,188	\$33,701	\$54,447	\$82,529	\$110,744	\$121,905

32 PJM Planning. ELCC Class Ratings for 2024–2025. December 29, 2023. <<https://www.pjm.com/-/media/DotCom/planning/res-adeq/elcc/elcc-class-ratings-for-2024-2025.pdf>>.

33 RECs prices obtained from Evolution Markets, Inc.



In 2024, a new offshore wind installation would not have received sufficient net revenue to cover levelized total costs in any of the three zones analyzed.

**Table 7-28 Percent of 20-year levelized total costs recovered by offshore wind net revenue (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
ACEC	39%	29%	22%	20%	26%	19%	18%	25%	49%	27%	30%
DOM	39%	31%	24%	21%	27%	20%	18%	29%	61%	32%	32%
DPL	41%	31%	23%	21%	27%	20%	19%	28%	52%	28%	31%

## New Entrant Solar Installation

Energy market net revenues for a solar installation were calculated hourly assuming the unit was generating at the average hourly capacity factor of operating solar units in the zone with an installed capacity greater than 3 MW.<sup>34</sup>

Solar energy market net revenues in 2024 were higher in all zones analyzed except DOM as a result of higher energy prices.

**Table 7-29 Energy market net revenue for a solar installation (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	Change in 2024 from 2023
ACEC	\$67,446	\$48,285	\$38,762	\$38,022	\$41,772	\$32,636	\$23,716	\$41,917	\$95,800	\$30,966	\$39,829	29%
DOM	-	-	\$70,026	\$68,150	\$78,189	\$59,472	\$45,177	\$90,539	\$222,533	\$78,683	\$77,591	(1%)
DPL	-	-	\$45,546	\$50,740	\$61,773	\$44,687	\$33,323	\$51,578	\$110,931	\$47,380	\$59,091	25%
JCPLC	\$61,850	\$41,551	\$33,986	\$36,414	\$39,433	\$30,189	\$23,599	\$41,144	\$88,119	\$29,171	\$33,977	16%
PSEG	\$61,548	\$47,830	\$39,380	\$40,979	\$43,469	\$34,047	\$25,767	\$45,977	\$97,932	\$31,385	\$36,077	15%

The new entrant solar installation analysis is based on a 50 percent ELCC derating factor for defining the MW offered in the capacity market.<sup>35</sup>

**Table 7-30 Capacity market net revenue for a solar installation (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
ACEC	\$27,807	\$23,708	\$21,398	\$18,341	\$27,575	\$24,403	\$24,213	\$26,811	\$17,468	\$3,551	\$9,641
DOM	-	-	\$14,018	\$14,551	\$22,352	\$19,179	\$13,113	\$17,437	\$12,099	\$2,080	\$5,688
DPL	-	-	\$21,398	\$18,341	\$27,345	\$24,195	\$24,181	\$26,811	\$17,468	\$3,734	\$11,200
JCPLC	\$27,807	\$23,708	\$21,398	\$18,341	\$27,200	\$23,714	\$23,911	\$26,809	\$17,467	\$3,551	\$9,641
PSEG	\$30,478	\$25,593	\$28,234	\$30,828	\$33,260	\$25,025	\$24,515	\$29,100	\$18,929	\$3,551	\$9,641

The solar installation was assumed to receive the highest of the DC, MD or NJ Solar REC, based on locational eligibility, for the purposes of calculating RECs revenue.<sup>36</sup>

Solar units were assumed to receive class average reactive capability payments.

**Table 7-31 Reactive capability revenue for a solar installation (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
PJM	\$6,167	\$6,167	\$6,167	\$6,167	\$6,167	\$6,167	\$6,167	\$6,167	\$8,040	\$8,040	\$3,896

<sup>34</sup> Net revenues are calculated for zones in which there are sufficient operating units to determine capacity factor for a new entrant unit.

<sup>35</sup> PJM Planning. ELCC Class Ratings for 2024–2025. December 29, 2023. <<https://www.pjm.com/-/media/DotCom/planning/res-adeq/elcc/elcc-class-ratings-for-2024-2025.pdf>>.

<sup>36</sup> RECs prices obtained from Evolution Markets, Inc.

Renewable energy credits ranged from 58 percent of the total net revenue of a solar installation in DOM and DPL to 85 percent of the total net revenue of a solar installation in ACEC, JCPLC and PSEG.

**Table 7-32 RECs revenue for a solar installation (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
ACEC	\$240,050	\$325,643	\$373,683	\$285,895	\$273,161	\$313,056	\$292,165	\$305,389	\$329,699	\$304,609	\$297,972
DOM	-	-	\$101,679	\$20,760	\$18,364	\$99,084	\$150,493	\$154,772	\$128,570	\$117,371	\$122,046
DPL	-	-	\$74,619	\$17,514	\$15,804	\$85,624	\$121,982	\$117,907	\$92,284	\$106,338	\$101,497
JCPLC	\$222,593	\$280,457	\$332,265	\$267,345	\$258,291	\$286,300	\$281,980	\$294,745	\$301,281	\$275,546	\$261,357
PSEG	\$213,746	\$303,612	\$379,054	\$294,273	\$279,286	\$319,285	\$312,318	\$317,419	\$328,535	\$292,912	\$276,439

In 2024, a new entrant solar installation would have received sufficient net revenue to cover more than 100 percent of levelized total costs in ACEC, JCPLC and PSEG and between 82 and 97 percent of levelized total costs in DPL and DOM.

Solar projects that are currently operating or under construction may have a different financing structure, require a lower rate of return, or have other factors that are not captured in the new entrant analysis presented in this section.

**Table 7-33 Percent of 20-year levelized total costs recovered by solar net revenue (Dollars per installed MW-year): 2014 through 2024**

Zone	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
ACEC	145%	172%	201%	173%	150%	154%	183%	248%	218%	164%	163%
DOM	-	-	88%	55%	54%	75%	113%	175%	180%	98%	97%
DPL	-	-	67%	46%	48%	66%	98%	132%	111%	78%	82%
JCPLC	135%	150%	180%	163%	143%	142%	177%	241%	201%	150%	144%
PSEG	132%	164%	207%	185%	156%	158%	195%	260%	219%	159%	152%

## Historical New Entrant CC Revenue Adequacy

Total unit net revenues include energy and capacity market revenues. Analysis of the total unit revenues of theoretical new entrant CCs for three representative locations shows that CC units that entered the PJM markets in 2007 have covered 90 percent of their total costs in the BGE Zone and 82 percent of total costs in the PSEG Zone, and 49 percent of total costs in the COMED Zone, including the return on and of capital, on a cumulative basis. The analysis also shows that theoretical new entrant CCs that entered the PJM markets in 2012 have covered over 100 percent of their total costs on a cumulative basis in the BGE Zone, 93 percent of their total costs in PSEG Zone, and 61 percent of total costs in the COMED Zone. Energy market revenues alone were not sufficient to cover total costs in any scenario, which demonstrates the critical role of the capacity market revenue in covering total costs. Covering 100 percent of total costs in this analysis includes earning the assumed rate of return. Units earned a positive rate of return even when earning less than the assumed rate of return.

Under cost of service regulation, units are guaranteed that they will cover their total costs, assuming that the costs were determined to be reasonable. To the extent that units built in the PJM markets did not cover their total costs, investors were worse off and customers were better off than under cost of service regulation, ignoring the benefits of competition on increasing efficiency, reducing costs and improving technology and ignoring the possibility of over earning under cost of service regulation.

Figure 7-9 compares cumulative energy market net revenues and energy market net revenues plus capacity market revenues to cumulative levelized costs for a new entrant CC that began operation on January 1, 2007, and a new entrant CC that began operation on January 1, 2012. The solid black line shows the total net revenue required to cover total costs. The solid colored lines show net energy revenue by zone. The dashed colored lines show the sum of net energy and capacity revenue by zone.

**Figure 7-9 Historical new entrant CC revenue adequacy: 2007 through 2024 and 2012 through 2024<sup>37</sup>**

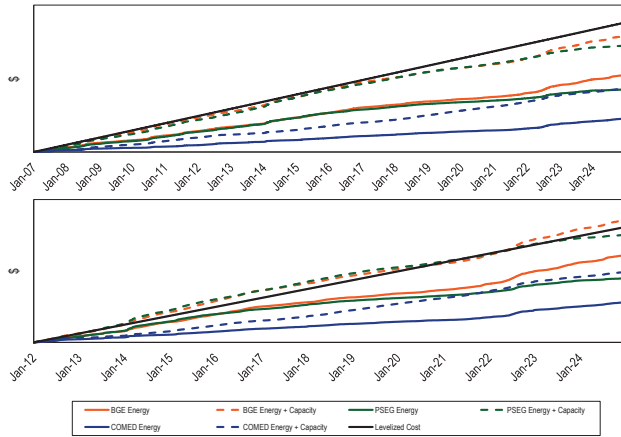


Table 7-34 shows the percent of levelized total costs recovered from the start date through 2023. Table 7-34 also shows the return (IRR) earned from the start date through June 2024. For example, for a CC built in BGE in 2012, the resource would have earned a 14 percent IRR compared to the required 12 percent. In contrast, for a CC built in ComEd in 2012, the resource would have earned a 2 percent IRR compared to the required 12 percent.

**Table 7-34 Percent of levelized total costs recovered**

	2007 CC	2012 CC
Percent of levelized costs covered at 12% IRR		
BGE	90%	106%
COMED	49%	61%
PSEG	82%	93%
IRR at which levelized costs are covered		
BGE	9%	14%
COMED	0%	2%
PSEG	7%	11%

<sup>37</sup> The gas pipeline pricing points used in this analysis are Zone 6 non-NY for BGE, Chicago City Gate for COMED, and Texas Eastern M3 for PSEG.

The assumptions used for this analysis are shown in Table 7-35.

**Table 7-35 Assumptions for analysis of new entry: 2007 and 2012**

	2007 CC	2012 CC
Project Cost	\$658,598,000	\$665,995,000
Fixed O&M (\$/MW-Year)	\$20,016	\$20,126
End of Life Value	\$0	\$0
Loan Term	20 years	20 years
Percent Equity (%)	50%	50%
Percent Debt (%)	50%	50%
Loan Interest Rate (%)	7%	7%
Cost of Equity (%)	12.0%	12.0%
Federal Income Tax Rate (%)	35%	35%
State Income Tax Rate (%)	9%	9%
General Escalation (%)	2.5%	2.5%
Technology	GE Frame 7FA.04	GE Frame 7FA.05
ICAP (MW)	601	655
Depreciation MACRS 150% declining balance	20 years	20 years
IRR (%)	12.0%	12.0%

## Factors in Net Revenue Adequacy

Although it can be expected that in the long run, in a competitive market, net revenue from all sources will cover the fixed and variable costs of investing in new generating resources, including a competitive return on investment, actual results are expected to vary from year to year. Wholesale energy markets, like other markets, are cyclical and may be volatile when affected by exogenous forces. When the markets are long, prices will be lower and when the markets are short, prices will be higher.

The net revenue for a new generation resource varied significantly with the input fuel type and the efficiency of the reference technology.

The net revenue results illustrate some fundamentals of the PJM wholesale power market. Higher demand, higher energy prices, and higher spreads against fuel costs meant that units ran with higher margins and for more hours in 2021 than in 2020. High demand hours result in less efficient units setting prices, which results in higher net revenues for more efficient units. Scarcity revenues in the energy market also contribute to covering fixed costs, when they occur, but scarcity revenues are not a predictable and systematic source of net revenue in the PJM design. In the PJM design, the balance of the net revenue required to cover the fixed costs of peaking units comes from the capacity market.

However, there may be a lag in capacity market prices which either offsets the reduction in energy market

revenues or exacerbates the reduction in energy market revenues. Capacity market prices are a function of a three year historical average net revenue offset which is generally an inaccurate estimate of actual net revenues in the current operating year and an inaccurate estimate of expected net revenues for the forward capacity market. A forward looking estimate of expected energy and ancillary services net revenues is a preferred method for defining the offset in the capacity market, although a simple unit by unit forward modeling of optimal dispatch is not an accurate way to calculate forward net revenues because it assumes optimal dispatch and ignores interactive effects with other units on the system. A better approach would calculate forward looking expected energy and ancillary services net revenues using historical revenues that are scaled based on a comparison of forward prices for energy and fuel to the historical prices for energy and fuel. Capacity market prices and revenues have a substantial impact on the profitability of investing in new and existing units.

The returns earned by investors in generating units are a direct function of net revenues and the costs associated with the generating unit. Positive returns may be earned at less than the annualized fixed costs, although the returns are less than the target. A sensitivity analysis was performed to determine the impact of changes in net revenue on the return on investment for a new generating unit. The internal rate of return (IRR) was calculated for a range of 20-year levelized net revenue streams, using 20-year levelized total costs from Table 7-7. Levelized total costs are the nominal 20 year levelized revenue requirements for the capital costs of each technology. Levelized total costs include return on and of capital and fixed O&M expenses. Variable operating expenses including fuel and variable operations and maintenance expenses are not included. The results are shown in Table 7-36.<sup>38</sup>

**Table 7-36 Internal rate of return sensitivity for CT and CC generators (Dollars per installed MW-year)**

20-Year Levelized Net Revenue (\$/MW-Yr)			
	20-Year After Tax IRR	CT	CC
Sensitivity 1	14.0%	\$195,975	\$198,223
Base Case	12.0%	\$185,198	\$184,198
Sensitivity 2	10.0%	\$174,890	\$170,891
Sensitivity 3	8.0%	\$165,065	\$158,307
Sensitivity 4	6.0%	\$155,736	\$146,449
Sensitivity 5	4.0%	\$146,914	\$135,316
Sensitivity 6	2.0%	\$138,609	\$124,908

Additional sensitivity analyses were performed for the CT and the CC technologies for the debt to equity ratio; the term of the debt financing; and the costs of interconnection. Table 7-37 shows the levelized annual revenue requirements associated with a range of debt to equity ratios holding the 12 percent IRR constant. The base case assumes 50/50 debt to equity ratio. As the percent of equity financing decreases, the levelized annual revenue required to earn a 12 percent IRR falls.

**Table 7-37 Debt to equity ratio sensitivity for CT and CC assuming 20-year debt term and 12 percent internal rate of return (Dollars per installed MW-year)**

	Equity as a percent of total financing	Levelized Annual Revenue Requirement (\$/MW-Yr)	
		CT	CC
Sensitivity 1	60%	\$192,659	\$194,365
Sensitivity 2	55%	\$188,900	\$189,234
Base Case	50%	\$185,198	\$184,198
Sensitivity 3	45%	\$181,553	\$179,257
Sensitivity 4	40%	\$177,965	\$174,411
Sensitivity 5	35%	\$174,436	\$169,660
Sensitivity 6	30%	\$170,965	\$165,004

Table 7-38 shows the impact of a range of capital costs on the levelized annual revenue requirement for the CT and the CC technologies. Capital costs can vary significantly by location across PJM and even within PJM zones.

<sup>38</sup> This analysis was performed for the MMU by Pasteris Energy, Inc. The annual costs were based on a 20-year project life, 50/50 debt to equity capital structure with a target IRR of 12 percent and a debt rate of 7 percent. For depreciation, the analysis assumed 80 percent bonus depreciation and a 15-year modified accelerated cost-recovery schedule (MACRS) for the CT plant and 20-year MACRS for the CC plant. An annual rate of cost inflation of 2.5 percent was used in all calculations.

Table 7-38 Capital cost sensitivity for CT and CC

	CT			CC		
	Capital cost (\$000)	Percent of base case capital cost	Annualized revenue requirement (\$/MW-Yr)	Capital cost (\$000)	Percent of base case capital cost	Annualized revenue requirement (\$/MW-Yr)
Sensitivity 1	\$416,806	90%	\$172,368	\$1,547,374	90%	\$169,395
Sensitivity 2	\$439,962	95%	\$178,783	\$1,633,339	95%	\$176,796
Base Case	\$463,118	100%	\$185,198	\$1,719,304	100%	\$184,198
Sensitivity 3	\$486,274	105%	\$191,613	\$1,805,269	105%	\$191,600
Sensitivity 4	\$509,430	110%	\$198,028	\$1,891,234	110%	\$199,002
Sensitivity 5	\$532,586	115%	\$204,443	\$1,977,200	115%	\$206,404
Sensitivity 6	\$555,741	120%	\$210,858	\$2,063,165	120%	\$213,806

## Actual Net Revenue

This analysis of net revenues is based on actual net revenues for actual units operating in PJM. Net revenues from energy, ancillary service, RECs and capacity markets are compared to avoidable costs to determine the extent to which the revenues from PJM markets provide sufficient incentive for continued operations in PJM markets. Avoidable costs are the costs that must be paid each year in order to keep a unit operating. Avoidable costs are less than total costs, which include the return on and of capital, and more than marginal costs, which are the purely short run incremental costs of producing energy. It is rational to operate a unit on an hour to hour basis whenever the price is greater than the unit's short run marginal costs. It is rational for an owner to continue to operate a unit on an annual basis rather than retire the unit if the unit is covering or is expected to cover its avoidable costs and therefore contributing to covering fixed costs. It is not rational for an owner to continue to operate a unit rather than retire the unit if the unit is not covering and is not expected to cover its avoidable costs. As a general matter, under those conditions, retirement of the unit is the logical option. Thus, this comparison of actual net revenues to avoidable costs is a measure of the extent to which units in PJM may be at risk of retirement.

The definition of avoidable costs includes both avoidable costs and the annualized fixed costs of incremental investments required to maintain a unit as a capacity resource (APIR). When actual net revenues are compared to actual avoidable costs in this analysis, the actual avoidable costs are adjusted to exclude APIR. Existing APIR is a sunk cost and a rational decision about retirement would ignore such sunk costs. For example, APIR may reflect investments in environmental technology which were made in prior years to keep units in service. These costs are sunk costs.

The MMU estimates avoidable costs for existing units for a range of technologies by estimating the total cost that must be paid each year in order to keep a unit operating. The avoidable costs in Table 7-39 include operations and maintenance, parts and labor, insurance, property taxes, major maintenance, and a portion of LTSA fixed fees and general and administrative expenses. The MMU ACR values are greater than the ACR values used by PJM because the MMU includes major maintenance costs and defines a larger share of plant expenses as avoidable. The MMU ACR values are also significantly greater than prior MMU ACR values based on a reevaluation of the definition of avoidable costs.

Table 7-39 Avoidable costs by technology<sup>39</sup>

Technology	ACR (\$/MW-Day)
Coal	\$305.01
Combined Cycle	\$125.46
Combustion Turbine	\$279.28
Diesel	\$121.30
Solar	\$79.82
Wind	\$139.22

The MMU calculated actual unit specific energy and ancillary service net revenues for a range of technology classes. These net revenues were compared to avoidable costs by technology class to determine the extent to which PJM energy and ancillary service markets alone provide sufficient incentive for continued operation in PJM markets. Actual capacity revenues were then added to energy and ancillary service revenues and compared to actual avoidable costs to determine the extent to which the capacity market revenues covered any shortfall between energy and ancillary net revenues and avoidable costs. The comparison of the two results is an indicator of the significance of the role of the capacity market in maintaining the viability of existing generating units.

<sup>39</sup> Avoidable costs provided by Pasteris Energy, Inc.



Actual energy net revenues include day-ahead and balancing market energy revenues, less short run marginal costs, plus any applicable day-ahead or balancing operating reserve credits (uplift). Ancillary service revenues include actual unit credits for regulation services, synchronized reserves, black start service, and reactive revenues.

The PJM capacity market design provides supplemental signals to the market based on the locational and forward looking need for generation resources to maintain system reliability. For analyzing actual net revenues, unit specific capacity revenues associated with the 2023/2024 and 2024/2025 Delivery Years, reflecting commitments made in base residual auctions (BRA) and subsequent incremental auctions, net of any performance penalties, were added to unit specific energy and ancillary net revenues to determine total revenue from PJM markets in 2024. Any unit with a significant portion of installed capacity designated as FRR committed was excluded from the analysis.<sup>40</sup> For units exporting capacity, the applicable BRA clearing price was applied.

Net revenues were analyzed for most technologies for which avoidable costs are developed in the capacity market. The analysis is on a unit specific basis, using individual unit actual net revenues and individual unit avoidable costs, if available. Unit net revenues are compared to avoidable costs.<sup>41</sup> Net revenues for units other than nuclear are calculated using the lower of units' available price-based or cost-based offers.<sup>42</sup> <sup>43</sup> For nuclear units, public data on revenues and costs are used.

The unit specific energy and ancillary net revenues, avoidable costs and capacity revenues, on which the class averages shown in Table 7-40 are based, include a wide range of results. In order to illustrate this underlying variability while preserving confidentiality

of unit specific information, the data are aggregated and summarized by quartile.

Table 7-40 shows energy and ancillary service net revenues by quartile for select technology classes.<sup>44</sup> Differences in energy net revenue within technology classes reflect differences in incremental costs which are a function of plant efficiencies, input fuels, variable operating and maintenance (VOM) expenses and emission rates, as well as differences in location which affect both the LMP and delivered costs for input fuels. Unlike the other technologies, nuclear cost data is from public sources in order to avoid revealing confidential information. Nuclear unit revenue is based on day-ahead LMP from the relevant node as shown in Table 7-44, adjusted by the class average equivalent availability factor. Nuclear unit capacity revenue assumes that the unit cleared its full installed capacity at the BRA locational clearing price as shown in Table 7-45.

Table 7-40 also includes new entrant theoretical energy market net revenue from Table 7-9 through Table 7-30 for comparison purposes.<sup>45</sup> As an example, for the CC plants, the predominant form of new entry in PJM, some existing resources in the top quartile of net revenue, earn net revenues that are comparable to the theoretical new entrant net revenues. This supports the conclusion that the theoretical new entrant results are a good representation of the performance of actual new entrants and existing plants with comparable technologies. The results for existing units vary based on location, technology and actual performance.

<sup>40</sup> The MMU cannot assess the risk of FRR designated units because the incentives associated with continued operations for these units are not transparent and are not aligned with PJM market incentives. For the same reasons, units with significant FRR commitments are excluded from the analysis of units potentially facing significant capital expenditures associated with environmental controls.

<sup>41</sup> Avoidable costs including major maintenance are used for units that do not include major maintenance in their energy offers. Avoidable costs excluding major maintenance are used for units that do include major maintenance in their energy offers.

<sup>42</sup> This is a change from recent MMU reports that used the FERC mandated definition of net revenue that was based primarily on price-based offers with some exceptions. 154 FERC ¶ 61,151 at P 59 (2019) The MMU continues to use the FERC mandated definition in all tariff related calculations including the calculation of market seller offer caps.

<sup>43</sup> Net revenues for units other than nuclear units incorrectly include opportunity cost adders as unit costs in the case when units include an opportunity cost adder in their cost offer and have a cost offer lower than their price based offer. This potentially affects 124 units by an average of \$2,566/MW-Yr.

<sup>44</sup> The quartile numbers in the table are the dividing lines between the quartiles. The first quartile result means that 25 percent of units have lower net revenues, the median result means that 50 percent of units have lower net revenues and the third quartile result means that 75 percent of units have lower net revenues.

<sup>45</sup> Wind new entrant energy and ancillary services net revenue includes RECs revenue to help ensure comparability between theoretical new entrant net revenues and actual net revenues for wind resources in this table. Actual net revenues for wind resources implicitly include RECs revenues because wind offers in the energy market generally include the RECs revenues as an offset to costs. Solar new entrant energy and ancillary services net revenue do not include RECs revenue because actual net revenues for solar resources do not include RECs revenues either implicitly or explicitly in this table.

Table 7-40 Net revenue by quartile for select technologies: 2024

Technology	Total Installed Capacity (ICAP)	(\$/MW-Yr)										
		Energy and ancillary service net revenue				Capacity revenue			Energy, ancillary, and capacity revenue			
		New entrant	First quartile	Median	Third quartile	First quartile	Median	Third quartile	New entrant	First quartile	Median	Third quartile
Combined Cycle	48,097	\$100,686	\$13,740	\$72,691	\$120,923	\$10,070	\$17,318	\$23,635	\$115,715	\$37,944	\$90,252	\$140,222
Combustion Turbine	25,291	\$75,452	\$2,838	\$8,157	\$20,141	\$11,365	\$12,677	\$17,363	\$90,482	\$16,565	\$22,071	\$35,667
Coal Fired	25,760	\$35,938	\$368	\$11,257	\$52,082	\$9,194	\$11,313	\$16,739	\$50,967	\$14,326	\$25,599	\$63,176
Diesel	676	\$10,362	(\$618)	\$6,721	\$42,896	\$17,623	\$25,431	\$78,048	\$25,392	\$16,873	\$35,214	\$124,685
Hydro	2,222		\$66,782	\$103,278	\$134,292	\$0	\$9,604	\$184,372		\$91,331	\$140,601	\$276,177
Nuclear	26,111	\$254,059	\$196,235	\$213,144	\$250,128	\$16,869	\$17,580	\$25,171	\$269,088	\$221,407	\$230,723	\$264,867
Oil or Gas Steam	2,869		(\$588)	\$280	\$17,725	\$12,456	\$18,064	\$20,323		\$11,632	\$21,119	\$38,672
Pumped Storage	2,308		\$13,667	\$23,158	\$97,161	\$9,438	\$14,851	\$27,632		\$25,299	\$32,230	\$135,828
Solar	6,917	\$53,209	\$29,915	\$36,972	\$49,162	\$0	\$0	\$3,500	\$62,371	\$30,613	\$38,299	\$51,640
Wind	11,092	\$146,964	\$70,495	\$105,339	\$200,481	\$0	\$1,169	\$2,850	\$149,707	\$70,664	\$107,749	\$201,374

Table 7-41 shows the percent of avoidable costs covered by net revenue from PJM energy and ancillary services markets by quartiles. In 2024, a substantial portion of units did not achieve full recovery of avoidable costs through energy markets alone. After including capacity revenues, net revenues from all markets cover avoidable costs for even the first quartile of most technology types, although this is not the case for every individual unit and it is not the case for coal or CT units.

The analysis of nuclear plants includes publicly available data on energy market prices, capacity prices, and an estimate of annual avoidable costs and incremental capital expenditures from the Nuclear Energy Institute (NEI) based on NEI's average across all U.S. nuclear plants.<sup>46 47 48</sup> The NEI annual avoidable costs used in the analysis are for 2023, the most recent data available.

Table 7-41 Avoidable cost recovery by quartile: 2024

Technology	Total Installed Capacity (ICAP)	Recovery of avoidable costs from energy and ancillary net revenue			Recovery of avoidable costs from all markets		
		First quartile	Median	Third quartile	First quartile	Median	Third quartile
Combined Cycle	48,097	51%	280%	430%	147%	340%	519%
Combustion Turbine	25,291	9%	27%	65%	52%	71%	115%
Coal Fired	25,760	0%	11%	48%	14%	25%	59%
Diesel	676	(3%)	30%	194%	76%	159%	563%
Hydro	2,222	100%	100%	100%	100%	100%	100%
Nuclear	26,111	79%	83%	91%	137%	140%	142%
Oil or Gas Steam	2,869	(2%)	1%	80%	40%	93%	175%
Pumped Storage	2,308	100%	100%	100%	100%	100%	100%
Solar	6,917	103%	127%	169%	105%	131%	177%
Wind	11,092	139%	207%	395%	139%	212%	396%

46 Operating costs from: Nuclear Energy Institute (February 2025). "Nuclear Costs in Context," <<https://www.nei.org/resources/reports-briefs/nuclear-costs-in-context>>. Individual plants may vary from the average due to factors such as geographic location, local labor costs, the timing of refueling outages and other unit specific factors. This is the most current NEI data available.

47 The NEI costs for Hope Creek and Salem plants were both treated as those associated with a two unit configuration because all three units are located in the same area.

48 The nuclear analysis here excludes Cook, North Anna, and Surry. These units do not participate in the PJM Capacity Market in 2024.

Table 7-42 shows the proportion of units recovering avoidable costs from energy and ancillary services markets and from all markets from 2011 through 2024.<sup>49 50</sup> In 2024, capacity revenues were sufficient to cover the shortfall between energy revenues and avoidable costs for most CCs, DS, hydro, solar, and wind units in PJM.

**Table 7-42 Proportion of units recovering avoidable costs: 2011 through 2024**

	Units with full recovery from all markets													
Technology	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
Combined Cycle	85%	79%	79%	95%	88%	93%	89%	98%	90%	93%	83%	80%	87%	81%
CT - Aero Derivative	100%	96%	76%	98%	100%	99%	100%	99%	96%	96%	89%	33%	-	-
CT - Industrial Frame	99%	98%	83%	100%	100%	100%	100%	96%	92%	86%	84%	27%	-	-
Combustion Turbine	-	-	-	-	-	-	-	-	-	-	-	-	21%	29%
Coal Fired	82%	36%	54%	83%	64%	40%	36%	63%	31%	5%	66%	33%	2%	10%
Diesel	100%	100%	77%	100%	100%	100%	100%	97%	91%	89%	83%	83%	72%	59%
Hydro	81%	77%	97%	98%	100%	100%	97%	98%	100%	74%	95%	100%	100%	100%
Nuclear	-	-	61%	100%	56%	17%	50%	88%	81%	0%	100%	100%	14%	14%
Oil or Gas Steam	92%	78%	86%	85%	91%	88%	81%	76%	66%	34%	67%	10%	40%	46%
Pumped Storage	100%	100%	100%	100%	100%	100%	100%	100%	100%	100%	100%	100%	100%	100%
Solar	-	95%	97%	99%	97%	95%	95%	98%	96%	95%	100%	97%	91%	79%
Wind	88%	85%	96%	93%	92%	89%	93%	91%	89%	79%	95%	99%	83%	85%

## Competitiveness of Wind and Solar

The role of intermittent resources will in part be a function of whether the resources are competitive in wholesale power markets. There are a number of ways to define the competitiveness metric. Given the current dynamics of the PJM markets, new wind and solar units compete with new combined cycles and with existing coal plants. Table 7-43 shows the LMP needed to cover both levelized total costs and avoidable costs (ACR) and for each unit type for a range of capacity factors and ELCC derating factors.<sup>51</sup> The table includes capacity market revenues based on the results of the 2025/2026 Base Residual Auction. The table includes the impact on costs of current tax subsidies and the impact on revenues of RECs subsidies. The results show that a new solar unit operating at a 20 percent capacity factor would need an LMP of \$49 per MWh for all hours that the unit runs to cover levelized total costs, accounting for the significant RECS revenue. Existing coal units would need between \$43 and \$48 per MWh to cover their short run marginal costs and avoidable costs. Each individual coal plant will have an ACR and fuel costs that may be higher or lower than the default values used in this analysis. The conclusion is that, including the effects of the 30 percent ITC from the Inflation Reduction Act and current RECs levels, new combined cycle, solar and wind resources are cost competitive with existing coal units in PJM.<sup>52</sup> Existing coal units only need to expect to cover avoidable costs in order to remain economic while new entry solar needs to expect to cover levelized total costs in order to enter.<sup>53</sup>

49 Beginning in 2023, CTs are combined into a single category, corresponding to PJM's default Gross ACR CT category.

50 Nuclear unit results for 2019-2023 have been updated to include subsidy revenue.

51 The Capacity Market Clearing Price is the 2025/2026 BRA clearing price for Rest of RTO. <<https://www.pjm.com/-/media/DotCom/markets-ops/rpm/rpm-auction-info/2025-2026/2025-2026-base-residual-auction-report.pdf>>. The solar RECs price is the 2024 MD Solar REC price. The wind RECS price is the 2024 CRS National Wind REC price. RECs prices obtained from Evolution Markets, Inc.

52 See Inflation Reduction Act of 2022, Public Law 117-169 (August 16, 2022).

53 The calculations are a function of values for key variables including REC prices, capacity factors, ELCC derating factors, coal prices, and ACR values.

Table 7-43 Comparison of generation technologies

Costs			Assumptions						Revenue		
		Short Run	Levelized Cost	Capacity					Capacity +	LMP Needed	
	ACR	Marginal	of a New	Market	Ancillary	Capacity	ELCC	RECS Price	Ancillary	to Cover	LMP Needed
Technology	(\$/MW-Day)	Costs	Unit	Clearing Price	Services	Factor	Rating	(\$/MWh)	+ RECS	Levelized	to Cover ACR
		(\$/MWh)	(\$/MW-Yr)	(\$/MW-Day)	(\$/MW-Yr)	(%)			(\$/MW-Yr)	Costs	(\$/MWh)
Coal	\$305.01	\$36.98	-	\$270	\$1,800	30%	83%	-	\$83,572	-	\$48
			-	-	-	40%	-	-	\$83,572	-	\$45
			-	-	-	50%	-	-	\$83,572	-	\$43
Combined Cycle	\$125.46	\$19.49	\$183,473	\$270	\$2,399	45%	78%	-	\$79,246	\$46	\$11
			-	-	-	60%	-	-	\$79,246	\$39	\$13
			-	-	-	75%	-	-	\$79,246	\$35	\$14
Solar	\$79.82	\$0.00	\$211,057	\$270	\$8,040	15%	14%	\$59	\$99,359	\$85	\$0
			-	-	-	20%	-	-	\$125,201	\$49	\$0
			-	-	-	25%	-	-	\$151,043	\$27	\$0
Wind	\$139.22	\$0.00	\$256,990	\$270	\$3,769	35%	38%	\$2	\$48,336	\$68	\$1
			-	-	-	40%	-	-	\$49,354	\$59	\$0
			-	-	-	45%	-	-	\$50,372	\$52	\$0

## Nuclear Net Revenue Analysis

The analysis of nuclear plants includes annual avoidable costs and incremental capital expenditures from the Nuclear Energy Institute (NEI) based on NEI's calculations of average costs for all U.S. nuclear plants.<sup>54</sup> <sup>55</sup> The analysis includes the most recent operating cost data and incremental capital expenditure data for single unit plants and multi unit plants published by NEI, which is for 2023.<sup>56</sup> NEI average operating costs have decreased since their peak in 2012 (a 7.5 percent decrease from 2012 through 2023 for all plants including single and multiple unit plants in nominal dollars; a 33.0 percent decrease in real 2023 dollars).<sup>57</sup> NEI average incremental capital expenditures have decreased since their peak in 2012 (a 32.8 percent decrease from 2012 through 2023 for all plants including single and multiple unit plants in nominal dollars; a 51.1 percent decrease in real 2023 dollars).<sup>58</sup> NEI's incremental capital expenditures peaked in 2012 as a result of regulatory requirements following the 2011 accident at the Fukushima nuclear plant in Japan.

The results for nuclear plants are sensitive to small changes in PJM energy and capacity prices, both actual and forward prices.<sup>59</sup> When gas prices are high and LMPs are high as a result, net revenues to nuclear plants increase. In 2014, the polar vortex resulted in a significant increase in net revenues to nuclear plants. When gas prices are low and LMPs are low as a result, net revenues to nuclear plants decrease. In 2016, PJM energy prices were then at the lowest level since the introduction of competitive markets on April 1, 1999, and remained low in 2017. As a result, in 2016 and 2017, a significant proportion of nuclear plants did not cover annual avoidable costs based on current year prices.<sup>60</sup> In 2018, high gas prices and high LMPs resulted in a significant increase in net revenues for nuclear plants in PJM. Energy prices in 2018 were significantly higher than in 2017. Although energy prices in 2019 were lower than in 2016, higher capacity market revenues more than offset the difference. In 2020, PJM energy prices were at the lowest level since the introduction of competitive markets, even lower than in 2016. Average energy prices in 2022 were higher than energy prices in any year since the inception of PJM markets in 1999. Based on forward prices as of December 31, 2024, expected nuclear plant energy revenues for 2025 and 2026 are higher than actual revenues

54 Operating costs from: Nuclear Energy Institute (February 2025). "Nuclear Costs in Context," <[https://www.nei.org/CorporateSite/media/filefolder/resources/reports-and-briefs/2024-Costs-in-Context\\_final.pdf](https://www.nei.org/CorporateSite/media/filefolder/resources/reports-and-briefs/2024-Costs-in-Context_final.pdf)> Individual plants may vary from the average due to factors such as geographic location, local labor costs, the timing of refueling outages and other unit specific factors. This is the most current NEI data available.

55 The NEI costs for Hope Creek were treated as that of a two unit configuration because the unit is located in the same area as Salem 1 & 2. The net surplus of Hope Creek is sensitive to the accuracy of this assumption.

56 NEI also provides average costs by plant run by operators with one plant or multiple plants, by market, and by type of nuclear reactor. Plants run by operators with multiple plants have lower average costs than plants run by operators with a single plant. Plants participating in wholesale markets have lower average costs than plants in regulated markets. PWR reactors have lower average generating costs than BWR reactors.

57 Operating costs in this paragraph are operating costs as specified by NEI and do not include fuel costs or capital expenditures. Operating costs for single unit plants decreased by 2.6 percent from 2022 to 2023 in nominal dollars. Operating costs for multiple unit plants increased by 6.0 percent from 2022 to 2023 in nominal dollars.

58 Capital expenditures have decreased 20.6 percent since 2012 for single unit plants and 35.0 percent for multiple unit plants in nominal dollars.

59 A change in the capacity market price of \$24 per MW-day translates into a change in capacity revenue of \$1.00 per MWh for a nuclear power plant operating at a capacity factor of 100 percent. A change in the capacity market price of \$24 per MW-day translates into a change in capacity revenue of \$1.05 per MWh for a nuclear power plant operating at a capacity factor of 0.951 percent.

60 The MMU submitted testimony in New Jersey on the same issues of nuclear economics. *Establishing Nuclear Diversity Certificate Program*. Bill No. S-877 New Jersey Senate Environment and Energy Committee. (2018). *Revised Statement of Joseph Bowring*.

in all years since 2014, with the exception of 2022. The actual net revenue results for individual nuclear plants are a function of the degree to which actual unit costs are less than or greater than the benchmark NEI data.

Table 7-44 shows energy market prices, Table 7-45 and Table 7-46 show capacity market prices and Table 7-47 shows nuclear cost data for the 16 nuclear plants in PJM in addition to Oyster Creek, which retired September 17, 2018, and Three Mile Island, which retired September 20, 2019.<sup>61</sup> The analysis excludes the Catawba 1 nuclear unit. Partial data is provided for the Cook, North Anna, and Surry nuclear units. The AEP Cook nuclear units are designated FRR. North Anna 1 and 2 and Surry 1 and 2 are part of the Dominion FRR for the 2022/2023 and 2023/2024 and 2024/2025 Delivery Years.<sup>62 63 64</sup> FRR units receive cost of service revenues and are not subject to PJM market revenues. Duke's Catawba 1 is not in PJM but is pseudo tied to PJM.

For nuclear plants, all calculations are based on publicly available data in order to avoid revealing confidential information. Historical nuclear unit revenue is based on day-ahead LMP at the relevant node. Nuclear unit capacity revenue assumes that the unit cleared its full unforced capacity at the BRA locational clearing price. Unforced capacity is determined using the annual class average EFORD rate.

**Table 7-44 Nuclear unit day-ahead LMP: 2008 through 2024**

	ICAP (MW)	Average DA LMP (\$/MWh)																
		2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
Beaver Valley	1,808	\$49.46	\$31.51	\$35.59	\$37.43	\$30.34	\$34.24	\$41.86	\$30.35	\$27.07	\$29.11	\$36.35	\$26.22	\$20.33	\$37.07	\$67.02	\$29.63	\$30.28
Braidwood	2,337	\$48.10	\$27.76	\$31.48	\$32.02	\$27.51	\$30.26	\$37.34	\$25.97	\$24.30	\$24.99	\$27.11	\$22.88	\$18.23	\$33.74	\$58.20	\$25.78	\$23.31
Byron	2,300	\$47.61	\$23.98	\$28.49	\$28.09	\$24.25	\$29.22	\$35.05	\$21.00	\$17.94	\$23.79	\$26.96	\$22.19	\$17.66	\$32.81	\$57.70	\$25.36	\$23.74
Calvert Cliffs	1,726	\$78.63	\$41.05	\$51.27	\$46.53	\$35.19	\$40.27	\$57.88	\$40.30	\$32.64	\$31.57	\$38.79	\$28.00	\$21.88	\$41.24	\$78.11	\$35.45	\$37.05
Cook	2,177	\$52.26	\$32.20	\$36.52	\$37.41	\$30.09	\$34.14	\$40.49	\$29.94	\$26.93	\$28.03	\$31.44	\$25.07	\$19.59	\$34.81	\$63.46	\$28.88	\$28.28
Davis Besse	894	-	-	-	\$39.68	\$31.68	\$36.10	\$47.21	\$31.94	\$27.80	\$28.85	\$34.44	\$26.33	\$20.54	\$37.34	\$68.07	\$29.63	\$30.46
Dresden	1,797	\$48.76	\$28.27	\$32.73	\$33.07	\$28.42	\$31.82	\$39.22	\$27.45	\$25.89	\$26.35	\$28.25	\$23.41	\$18.73	\$34.32	\$59.35	\$25.11	\$24.36
Hope Creek	1,172	\$73.34	\$39.43	\$48.03	\$45.52	\$33.07	\$37.43	\$51.99	\$32.41	\$23.20	\$26.78	\$32.93	\$22.45	\$17.32	\$30.16	\$60.64	\$22.97	\$26.42
LaSalle	2,265	\$47.96	\$27.71	\$31.53	\$31.93	\$27.56	\$30.94	\$37.88	\$26.28	\$23.95	\$24.71	\$27.19	\$22.75	\$18.14	\$33.54	\$57.90	\$25.55	\$23.05
Limerick	2,242	\$73.49	\$39.49	\$48.23	\$45.27	\$33.09	\$37.28	\$51.71	\$32.65	\$23.37	\$26.99	\$33.08	\$22.68	\$17.31	\$31.05	\$61.25	\$23.16	\$26.06
North Anna	1,892	\$75.14	\$39.89	\$50.59	\$45.47	\$33.87	\$38.55	\$53.37	\$38.05	\$30.50	\$31.27	\$38.44	\$27.39	\$21.06	\$39.99	\$76.51	\$33.75	\$35.11
Oyster Creek	608	\$75.49	\$40.43	\$49.29	\$46.74	\$33.69	\$38.62	\$52.85	\$33.10	\$23.79	\$27.52	NA	NA	NA	NA	NA	NA	NA
Peach Bottom	2,550	\$73.09	\$39.32	\$47.70	\$44.73	\$32.81	\$37.37	\$51.52	\$31.98	\$23.07	\$26.76	\$32.63	\$21.58	\$16.93	\$30.77	\$61.29	\$23.01	\$26.08
Perry	1,240	-	-	\$36.99	\$38.76	\$31.68	\$36.69	\$46.14	\$32.77	\$27.84	\$29.91	\$37.24	\$26.76	\$20.49	\$37.76	\$68.56	\$30.39	\$31.23
Quad Cities	1,819	\$47.28	\$24.81	\$27.53	\$26.79	\$20.43	\$25.94	\$30.71	\$19.47	\$18.04	\$23.09	\$25.54	\$21.13	\$15.95	\$31.39	\$57.82	\$25.01	\$23.42
Salem	2,285	\$73.41	\$39.51	\$48.02	\$45.50	\$33.06	\$37.40	\$51.96	\$32.37	\$23.18	\$26.76	\$32.90	\$22.43	\$17.32	\$30.12	\$60.59	\$22.95	\$26.40
Surry	1,676	\$71.96	\$39.02	\$49.30	\$45.01	\$33.62	\$37.98	\$51.75	\$37.91	\$30.08	\$31.08	\$38.50	\$26.65	\$20.41	\$39.30	\$74.21	\$32.74	\$33.65
Susquehanna	2,494	\$69.96	\$38.24	\$45.95	\$44.78	\$32.10	\$36.76	\$50.93	\$32.47	\$23.66	\$27.14	\$32.42	\$21.08	\$16.03	\$30.36	\$59.60	\$23.77	\$24.13
Three Mile Island	803	\$72.46	\$39.11	\$46.72	\$44.15	\$32.43	\$36.83	\$50.47	\$30.94	\$22.96	\$27.12	\$31.76	NA	NA	NA	NA	NA	NA

61 Installed capacity is from NEI, "Map of U.S. Nuclear Plants," <<https://www.nei.org/resources/map-of-us-nuclear-plants>>.

62 See "Resources Designated in 2022/2023 FRR Capacity Plans as of April 23, 2021," <<https://www.pjm.com/-/media/markets-ops/rpm/rpm-auction-info/2022-2023/2022-2023-resources-designated-in-frr-plans.ashx>>

63 See "Resources Designated in 2023/2024 FRR Capacity Plans as of May 19, 2021," <<https://www.pjm.com/-/media/DocCom/markets-ops/rpm/rpm-auction-info/2023-2024/2023-2024-resources-designated-in-frr-plans.pdf>>

64 See "Resources Designated in 2024/2025 FRR Capacity Plans as of November 8, 2022," <<https://www.pjm.com/-/media/DocCom/markets-ops/rpm/rpm-auction-info/2024-2025/2024-2025-resources-designated-in-frr-plans.pdf>>



Table 7-45 BRA capacity market clearing prices (\$/MW-Day): 2007/2008 through 2025/2026<sup>65 66</sup>

	ICAP (MW)	BRA Capacity Price (\$/MW-Day)																			
		07/08	08/09	09/10	10/11	11/12	12/13	13/14	14/15	15/16	16/17	17/18	18/19	19/20	20/21	21/22	22/23	23/24	24/25	25/26	
Beaver Valley	1,808	\$41	\$112	\$102	\$174	\$110	\$16	\$28	\$126	\$136	\$59	\$120	\$165	\$100	\$77	\$140	\$50	\$34	\$29	\$270	
Braidwood	2,337	\$41	\$112	\$102	\$174	\$110	\$16	\$28	\$126	\$136	\$59	\$120	\$215	\$203	\$188	\$196	\$69	\$34	\$29	\$270	
Byron	2,300	\$41	\$112	\$102	\$174	\$110	\$16	\$28	\$126	\$136	\$59	\$120	\$215	\$203	\$188	\$196	\$69	\$34	\$29	\$270	
Calvert Cliffs	1,726	\$189	\$210	\$237	\$174	\$110	\$133	\$226	\$137	\$167	\$119	\$120	\$165	\$100	\$86	\$140	\$96	\$49	\$49	\$270	
Cook	2,177	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Davis Besse	894	-	-	-	-	\$109	\$20	\$28	\$126	\$357	\$114	\$120	\$165	\$100	\$77	\$171	\$50	\$34	\$29	\$270	
Dresden	1,797	\$41	\$112	\$102	\$174	\$110	\$16	\$28	\$126	\$136	\$59	\$120	\$215	\$203	\$188	\$196	\$69	\$34	\$29	\$270	
Hope Creek	1,172	\$198	\$149	\$191	\$174	\$110	\$140	\$245	\$137	\$167	\$119	\$120	\$225	\$120	\$188	\$166	\$98	\$49	\$54	\$270	
LaSalle	2,265	\$41	\$112	\$102	\$174	\$110	\$16	\$28	\$126	\$136	\$59	\$120	\$215	\$203	\$188	\$196	\$69	\$34	\$29	\$270	
Limerick	2,242	\$198	\$149	\$191	\$174	\$110	\$140	\$245	\$137	\$167	\$119	\$120	\$225	\$120	\$188	\$166	\$98	\$49	\$54	\$270	
North Anna	1,892	\$41	\$112	\$102	\$174	\$110	\$16	\$28	\$126	\$136	\$59	\$120	\$165	\$100	\$77	\$140	NA	NA	NA	\$444	
Oyster Creek	608	\$198	\$149	\$191	\$174	\$110	\$140	\$245	\$137	\$167	\$119	\$120	\$225	\$120	\$188	-	-	-	-	-	
Peach Bottom	2,550	\$198	\$149	\$191	\$174	\$110	\$140	\$245	\$137	\$167	\$119	\$120	\$225	\$120	\$188	\$166	\$98	\$49	\$54	\$270	
Perry	1,240	-	-	-	-	\$109	\$20	\$28	\$126	\$357	\$114	\$120	\$165	\$100	\$77	\$171	\$50	\$34	\$29	\$270	
Quad Cities	1,819	\$41	\$112	\$102	\$174	\$110	\$16	\$28	\$126	\$136	\$59	\$120	\$215	\$203	\$188	\$196	\$69	\$34	\$29	\$270	
Salem	2,285	\$198	\$149	\$191	\$174	\$110	\$140	\$245	\$137	\$167	\$119	\$120	\$225	\$120	\$188	\$166	\$98	\$49	\$54	\$270	
Surry	1,676	\$41	\$112	\$102	\$174	\$110	\$16	\$28	\$126	\$136	\$59	\$120	\$165	\$100	\$77	\$140	NA	NA	NA	\$444	
Susquehanna	2,494	\$41	\$112	\$191	\$174	\$110	\$133	\$226	\$137	\$167	\$119	\$120	\$165	\$100	\$86	\$140	\$96	\$49	\$49	\$270	
Three Mile Island	803	\$41	\$112	\$191	\$174	\$110	\$133	\$226	\$137	\$167	\$119	\$120	\$165	\$100	\$86	\$140	-	-	-	-	

Table 7-46 Nuclear unit capacity market revenue (\$/MWh): 2008 through 2025<sup>67 68</sup>

	ICAP	Capacity Revenue (\$/MWh)																	
	(MW)	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	2025
Beaver Valley	1,808	\$3.57	\$4.50	\$6.23	\$5.87	\$2.41	\$1.01	\$3.70	\$5.75	\$3.96	\$4.17	\$6.42	\$5.61	\$3.81	\$4.93	\$3.80	\$1.76	\$1.35	\$7.40
Braidwood	2,337	\$3.57	\$4.50	\$6.23	\$5.87	\$2.41	\$1.01	\$3.70	\$5.75	\$3.96	\$4.17	\$7.71	\$9.20	\$8.58	\$8.35	\$5.28	\$2.10	\$1.35	\$7.40
Byron	2,300	\$3.57	\$4.50	\$6.23	\$5.87	\$2.41	\$1.01	\$3.70	\$5.75	\$3.96	\$4.17	\$7.71	\$9.20	\$8.58	\$8.35	\$5.28	\$2.10	\$1.35	\$7.40
Calvert Cliffs	1,726	\$8.73	\$9.59	\$8.64	\$5.87	\$5.38	\$8.21	\$7.53	\$6.74	\$6.04	\$5.26	\$6.42	\$5.62	\$4.07	\$5.10	\$4.97	\$2.97	\$2.15	\$7.77
Cook	2,177	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
Davis Besse	894	NA	NA	NA	NA	\$2.49	\$1.08	\$3.70	\$11.40	\$9.33	\$5.17	\$6.42	\$5.61	\$3.81	\$5.73	\$4.36	\$1.76	\$1.35	\$7.40
Dresden	1,797	\$3.57	\$4.50	\$6.23	\$5.87	\$2.41	\$1.01	\$3.70	\$5.75	\$3.96	\$4.17	\$7.71	\$9.20	\$8.58	\$8.35	\$5.28	\$2.10	\$1.35	\$7.40
Hope Creek	1,172	\$7.33	\$7.37	\$7.82	\$5.87	\$5.54	\$8.81	\$7.87	\$6.74	\$6.04	\$5.26	\$7.98	\$7.24	\$7.05	\$7.59	\$5.48	\$3.00	\$2.26	\$7.84
LaSalle	2,265	\$3.57	\$4.50	\$6.23	\$5.87	\$2.41	\$1.01	\$3.70	\$5.75	\$3.96	\$4.17	\$7.71	\$9.20	\$8.58	\$8.35	\$5.28	\$2.10	\$1.35	\$7.40
Limerick	2,242	\$7.33	\$7.37	\$7.82	\$5.87	\$5.54	\$8.81	\$7.87	\$6.74	\$6.04	\$5.26	\$7.98	\$7.24	\$7.05	\$7.59	\$5.48	\$3.00	\$2.26	\$7.84
North Anna	1,892	\$3.57	\$4.50	\$6.23	\$5.87	\$2.41	\$1.01	\$3.70	\$5.75	\$3.96	\$4.17	\$6.42	\$5.61	\$3.81	\$4.93	NA	NA	NA	\$11.32
Oyster Creek	608	\$7.33	\$7.37	\$7.82	\$5.87	\$5.54	\$8.81	\$7.87	\$6.74	\$6.04	\$5.26	-	-	-	-	-	-	-	-
Peach Bottom	2,550	\$7.33	\$7.37	\$7.82	\$5.87	\$5.54	\$8.81	\$7.87	\$6.74	\$6.04	\$5.26	\$7.98	\$7.24	\$7.05	\$7.59	\$5.48	\$3.00	\$2.26	\$7.84
Perry	1,240	NA	NA	NA	NA	\$2.49	\$1.08	\$3.70	\$11.40	\$9.33	\$5.17	\$6.42	\$5.61	\$3.81	\$5.73	\$4.36	\$1.76	\$1.35	\$7.40
Quad Cities	1,819	\$3.57	\$4.50	\$6.23	\$5.87	\$2.41	\$1.01	\$3.70	\$5.75	\$3.96	\$4.17	\$7.71	\$9.20	\$8.58	\$8.35	\$5.28	\$2.10	\$1.35	\$7.40
Salem	2,285	\$7.33	\$7.37	\$7.82	\$5.87	\$5.54	\$8.81	\$7.87	\$6.74	\$6.04	\$5.26	\$7.98	\$7.24	\$7.05	\$7.59	\$5.48	\$3.00	\$2.26	\$7.84
Surry	1,676	\$3.57	\$4.50	\$6.23	\$5.87	\$2.41	\$1.01	\$3.70	\$5.75	\$3.96	\$4.17	\$6.42	\$5.61	\$3.81	\$4.93	NA	NA	NA	\$11.32
Susquehanna	2,494	\$3.57	\$6.72	\$7.82	\$5.87	\$5.38	\$8.21	\$7.53	\$6.74	\$6.04	\$5.26	\$6.42	\$5.61	\$4.06	\$5.10	\$4.97	\$2.97	\$2.15	\$7.77
Three Mile Island	803	\$3.57	\$6.72	\$7.82	\$5.87	\$5.38	\$8.21	\$7.53	\$6.74	\$6.04	\$5.26	\$6.42	-	-	-	-	-	-	-

65 Oyster Creek retired September 17, 2018. Exelon. "Oyster Creek Generating Station Retires from Service," (September 17, 2018) <<http://www.exeloncorp.com/newsroom/oyster-creek-retires>>. Three Mile Island retired September 20, 2019. Exelon. "Three Mile Island Generating Station Unit 1 Retires from Service After 45 Years," (September 20, 2019) <<https://www.exeloncorp.com/newsroom/three-mile-island-generating-station-unit-1-retires>>. For the 2022/2023 Delivery Year, Surry is part of Dominion FRR.

66 Cook is designated FRR. North Anna and Surry are in Dominion FRR beginning with the 2022/2023 Delivery Year. North Anna and Surry are in the PJM Capacity Market beginning with the 2025/2026 Delivery Year.

67 Capacity revenue calculated by adjusting the BRA Capacity Price for calendar year, by the class average EFORD, and by the annual class average capacity factor. Class average EFORD and capacity factor is from 2024 Annual State of the Market Report for PJM, Volume 2, Section 5: Capacity Market.

68 Oyster Creek retired September 17, 2018. Exelon. "Oyster Creek Generating Station Retires from Service," (September 17, 2018) <<http://www.exeloncorp.com/newsroom/oyster-creek-retires>>. Three Mile Island retired September 20, 2019. Exelon. "Three Mile Island Generating Station Unit 1 Retires from Service After 45 Years," (September 20, 2019) <<https://www.exeloncorp.com/newsroom/three-mile-island-generating-station-unit-1-retires>>. Constellation is planning to restart Three Mile Island Unit 1. Constellation. "Constellation to Launch Crane Clean Energy Center, Restoring Jobs and Carbon-Free Power to The Grid," (September 20, 2024) <<https://www.constellationenergy.com/newsroom/2024/Constellation-to-Launch-Crane-Clean-Energy-Center-Restoring-Jobs-and-Carbon-Free-Power-to-The-Grid.html>>.

Table 7-47 Nuclear unit costs: 2008 through 2023<sup>69 70</sup>

	ICAP (MW)	NEI Costs (\$/MWh)															
		2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023
Beaver Valley	1,808	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
Braidwood	2,337	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
Byron	2,300	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
Calvert Cliffs	1,726	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
Cook	2,177	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
Davis Besse	894	\$35.31	\$39.36	\$41.23	\$45.45	\$47.41	\$44.16	\$44.32	\$44.51	\$41.39	\$42.66	\$42.00	\$38.40	\$39.64	\$37.42	\$41.08	\$41.62
Dresden	1,797	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
Hope Creek	1,172	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
LaSalle	2,265	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
Limerick	2,242	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
North Anna	1,892	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
Oyster Creek	608	\$35.31	\$39.36	\$41.23	\$45.45	\$47.41	\$44.16	\$44.32	\$44.51	\$41.39	\$42.66	-	-	-	-	-	-
Peach Bottom	2,550	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
Perry	1,240	\$35.31	\$39.36	\$41.23	\$45.45	\$47.41	\$44.16	\$44.32	\$44.51	\$41.39	\$42.66	\$42.00	\$38.40	\$39.64	\$37.42	\$41.08	\$41.62
Quad Cities	1,819	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
Salem	2,285	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
Surry	1,676	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
Susquehanna	2,494	\$26.73	\$29.76	\$31.34	\$34.51	\$36.06	\$33.84	\$33.84	\$32.90	\$31.63	\$30.89	\$29.07	\$28.38	\$27.03	\$27.18	\$28.63	\$29.53
Three Mile Island	803	\$35.31	\$39.36	\$41.23	\$45.45	\$47.41	\$44.16	\$44.32	\$44.51	\$41.39	\$42.66	\$42.00	-	-	-	-	-

Hope Creek, Quad Cities, and Salem have all received state subsidies since 2019.<sup>71 72</sup> The NJ Board of Public Utilities, having received no applications as of December 1, 2023, closed the third eligibility period of the ZEC program for the period beginning June 1, 2025.<sup>73</sup> This was a result of the introduction of a new federal nuclear subsidy under the Inflation Reduction Act. Braidwood, Byron, Dresden, and LaSalle will receive a state subsidy if necessary to meet a target net revenue value, in dollars per MWh, from the energy and capacity markets.<sup>74</sup> All existing nuclear plants will receive a federal subsidy if necessary to meet a target revenue value, in dollars per MWh, from the energy market.<sup>75</sup>

The Inflation Reduction Act added a significant new federal subsidy for existing nuclear power plants.<sup>76</sup> All existing nuclear plants will receive the Zero Emission Nuclear Power Production Credit (Nuclear PTC) if revenues from energy, ancillary, capacity markets,

and any state subsidies are between \$25.00/MWh and \$43.75/MWh, adjusted for inflation. The Nuclear PTC of \$3.00/MWh is increased by a factor of five to \$15.00/MWh if certain prevailing wage requirements are met. The Nuclear PTC creates a revenue floor of \$40.00/MWh and does not create a revenue ceiling. If nuclear revenues are greater than \$43.75/MWh, the Nuclear PTC subsidy does not apply and units keep all profits.

Table 7-48 shows the subsidy received by nuclear units in PJM in \$/MWh since 2019.

Table 7-48 Nuclear unit subsidies in \$/MWh: 2019 through 2024

	Subsidy (\$/MWh)					
	2019	2020	2021	2022	2023	2024
Beaver Valley	-	-	-	-	-	\$9.69
Braidwood	-	-	-	-	-	\$15.00
Byron	-	-	-	-	-	\$14.93
Calvert Cliffs	-	-	-	-	-	\$3.64
Cook	-	-	-	-	-	-
Davis Besse	-	-	-	-	-	\$9.55
Dresden	-	-	-	-	-	\$14.43
Hope Creek	\$7.04	\$10.00	\$10.00	\$10.00	\$10.00	\$12.06
LaSalle	-	-	-	-	-	\$15.00
Limerick	-	-	-	-	-	\$12.35
North Anna	-	-	-	-	-	\$6.91
Oyster Creek	-	-	-	-	-	-
Peach Bottom	-	-	-	-	-	\$12.33
Perry	-	-	-	-	-	\$8.94
Quad Cities	\$16.50	\$16.50	\$16.50	\$16.50	\$16.50	\$16.50
Salem	\$7.04	\$10.00	\$10.00	\$10.00	\$10.00	\$12.08
Surry	-	-	-	-	-	\$8.08
Susquehanna	-	-	-	-	-	\$13.98
Three Mile Island	-	-	-	-	-	-

<sup>69</sup> Operating costs from: Nuclear Energy Institute (February 2025). "Nuclear Costs in Context," <<https://www.nei.org/resources/reports-briefs/nuclear-costs-in-context>>.

<sup>70</sup> Oyster Creek retired on September 17, 2018. Exelon. "Oyster Creek Generating Station Retires from Service," (September 17, 2018) <<http://www.exeloncorp.com/newsroom/oyster-creek-retires>>. Three Mile Island retired September 20, 2019. Exelon. "Three Mile Island Generating Station Unit 1 Retires from Service After 45 Years," (September 20, 2019) <<https://www.exeloncorp.com/newsroom/three-mile-island-generating-station-unit-1-retires>>.

<sup>71</sup> Illinois Commerce Commission, Report to the General Assembly in Compliance with Section 1-75(d-5) of the [CEJA, Public Act 102-0662,] 20 ILCS 3855/1-75(d-5)(F)(2) (August 2019). The report finds that while total ZECs payments are limited by rate impact caps and volume caps, the law's limitation does not unduly constrain the procurement of ZECs.

<sup>72</sup> Application of PSEG Nuclear, LLC for the Zero Emission Certificate Program – Hope Creek, Order Determining the Eligibility of Hope Creek Nuclear Generator to Receive ZECs, BPU Docket No. ER20080559 (April 27, 2021). Application of PSEG Nuclear, LLC for the Zero Emission Certificate Program – Salem 1, Order Determining the Eligibility of Salem Unit 1 Nuclear Generator to Receive ZECs, BPU Docket No. ER20080557 (April 27, 2021). Application of PSEG Nuclear, LLC for the Zero Emission Certificate Program – Salem 2, Order Determining the Eligibility of Salem Unit 2 Nuclear Generator to Receive ZECs, BPU Docket No. ER20080557 (April 27, 2021).

<sup>73</sup> See New Jersey BPU, In the Matter of the Third Eligibility Period for the Zero Emission Certificate Program Pursuant to N.J.S.A. 48:3-87.3 TO 87.7, Order Closing the Third Eligibility Period of the Zero Emission Certificate Program, Docket No. E023080548 (February 14, 2024).

<sup>74</sup> CEJA, Public Act 102-0662, 20 ILCS 3855/1-75.

<sup>75</sup> See Inflation Reduction Act of 2022, Public Law 117-169 (August 16, 2022).

<sup>76</sup> See Inflation Reduction Act of 2022, Public Law 117-169 (August 16, 2022).

Table 7-49 shows the surplus or shortfall in \$/MWh for the 16 nuclear plants in PJM, and Oyster Creek and Three Mile Island, calculated using historic LMP and cost data. In 2020, no nuclear plants covered their fuel costs, operating costs, and incremental capital expenditures as a result of lower energy prices. In 2021 and 2022, all nuclear plants more than covered their fuel costs, operating costs, and capital expenditures as a result of higher energy prices. In 2023, only two nuclear plants covered their fuel costs, operating costs, and incremental capital expenditures as a result of lower energy and capacity prices. In 2024, all nuclear plants with the exception of Davis Besse covered their fuel costs, operating costs, and incremental capital expenditures. The surplus or shortfall assumes that the unit receives the DA LMP, reactive capability revenue, cleared its full unforced capacity at the BRA locational clearing price, receives a subsidy if qualified, and has costs equal to the NEI average costs.<sup>77</sup> Unforced capacity is determined using the annual class average EFORD rate.

The market revenues are based in part on the sale of capacity. Some nuclear plants did not clear the capacity market in some years as a result of decisions by plant owners about how to offer the plants in the capacity market auctions. When nuclear plants do not clear in the capacity market, it is a result of the offer behavior of the plants and does not accurately reflect the economic viability of the plants. This analysis is intended to define whether the plants are receiving a retirement signal from the PJM markets. If the plants are viable including both energy and capacity market revenues based on actual clearing prices, then the PJM markets indicate that the plant is economically viable. If plant owners decide to offer so as to not clear in the capacity market, that does not change the market signals to the plants. Such decisions may reflect a variety of considerations. Quad Cities and a portion of Byron's capacity did not clear in the 2019/2020 Auction.<sup>78</sup> Quad Cities did not clear in the 2020/2021 Auction.<sup>79</sup> Dresden and most of Byron did not clear in the 2021/2022 Auction.<sup>80</sup> Beaver Valley, Davis Besse, and Perry did not clear in the 2021/2022

Auction.<sup>81</sup> Byron, Dresden, and Quad Cities did not clear in the 2022/2023 Auction.<sup>82</sup>

Nuclear unit revenue is a combination of energy market revenue, ancillary services market revenue and capacity market revenue. Negative energy market prices do not have a significant impact on nuclear unit revenue. Since 2014, negative energy market prices have affected nuclear plants' annual total revenues by an average of 0.1 percent. Negative LMPs reduced nuclear plant total revenues by an average of 0.0 percent and a maximum of 0.6 percent in 2014, an average of 0.2 percent and a maximum of 1.2 percent in 2015, an average of 0.1 percent and a maximum of 0.7 percent in 2016, an average of 0.0 percent and a maximum of 0.6 percent in 2017, an average of 0.0 percent and a maximum of 0.0 percent in 2018, an average of 0.0 percent and a maximum of 0.2 percent in 2019, an average of 0.1 percent and a maximum of 1.7 percent in 2020, an average of 0.0 percent and a maximum of 0.3 percent in 2021, an average of 0.0 percent and a maximum of 0.0 percent in 2022, an average of 0.0 percent and a maximum of 0.1 percent in 2023, and an average of 0.6 percent and a maximum of 4.9 percent in 2024.<sup>83</sup>

77 Installed capacity is from NEI. "Maps of U.S. Nuclear Plants," <<https://www.nei.org/resources/map-of-us-nuclear-plants>>.

78 Exelon, "Exelon Announces Outcome of 2019-2020 PJM Capacity Auction," (May 25, 2016) <<http://www.exeloncorp.com/newsroom/pjm-auction-results-2016>>.

79 Exelon, "Exelon Announces Outcome of 2020-2021 PJM Capacity Auction," (May 24, 2017) <<http://www.exeloncorp.com/newsroom/pjm-auction-results-release-2017>>.

80 Exelon, "Exelon Announces Outcome of 2021-2022 PJM Capacity Auction," (May 24, 2018) <<http://www.exeloncorp.com/newsroom/exelon-announces-outcome-of-2021-2022-pjm-capacity-auction>>.

81 PRNewswire, "FirstEnergy Solutions Comments on Results of PJM Capacity Auction," (May 24, 2018) <<https://www.prnewswire.com/news-releases/firstenergy-solutions-comments-on-results-of-pjm-capacity-auction-300654549.html>>.

82 NuclearNewswire, "Byron, Dresden, Quad Cities Fail to Clear in PJM Capacity Auction," (June 8, 2021) <<https://www.ans.org/news/article-2967/byron-dresden-quad-cities-fail-to-clear-in-pjm-capacity-auction/>>.

83 Analysis is based on actual unit generation and received energy market and capacity market revenues. Negative prices in the DA and RT market were set to zero for comparison. Results round to 0.0 percent.

Table 7-49 shows the surplus or shortfall for the 16 nuclear plants in PJM in \$/MWh, including subsidies.

**Table 7-49 Nuclear unit surplus (shortfall) based on public data in \$/MWh: 2008 through 2024**

	ICAP (MW)	Surplus (Shortfall) (\$/MWh)																
		2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
Beaver Valley	1,808	\$26.3	\$6.3	\$10.5	\$8.8	(\$3.3)	\$1.4	\$11.7	\$3.2	(\$0.4)	\$2.6	\$13.9	\$3.7	(\$2.7)	\$15.0	\$42.4	\$2.1	\$12.0
Braidwood	2,337	\$24.9	\$2.5	\$6.4	\$3.4	(\$6.1)	(\$2.6)	\$7.2	(\$1.2)	(\$3.2)	(\$1.6)	\$5.9	\$3.9	(\$0.0)	\$15.1	\$35.0	(\$1.5)	\$10.3
Byron	2,300	\$24.5	(\$1.3)	\$3.4	(\$0.6)	(\$9.4)	(\$3.6)	\$4.9	(\$6.1)	(\$9.6)	(\$2.8)	\$5.8	\$3.2	(\$0.6)	\$14.1	\$34.5	(\$1.9)	\$10.6
Calvert Cliffs	1,726	\$60.6	\$20.9	\$28.6	\$17.9	\$4.5	\$14.6	\$31.6	\$14.1	\$7.2	\$6.1	\$16.3	\$5.4	(\$0.9)	\$19.4	\$54.6	\$9.1	\$13.5
Cook	2,177	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
Davis Besse	894	NA	NA	NA	NA	(\$13.2)	(\$7.0)	\$6.6	(\$1.2)	(\$4.0)	(\$8.4)	(\$0.9)	(\$6.3)	(\$15.1)	\$5.9	\$31.6	(\$10.0)	(\$0.0)
Dresden	1,797	\$25.6	\$3.0	\$7.6	\$4.4	(\$5.2)	(\$1.0)	\$9.1	\$0.3	(\$1.6)	(\$0.1)	\$7.1	\$4.5	\$0.5	\$15.7	\$36.2	(\$2.1)	\$10.8
Hope Creek	1,172	\$54.0	\$17.0	\$24.5	\$16.9	\$2.6	\$12.4	\$26.0	\$6.3	(\$1.9)	\$1.6	\$12.3	\$8.8	\$7.8	\$20.0	\$48.0	\$6.9	\$11.7
LaSalle	2,265	\$24.8	\$2.5	\$6.4	\$3.3	(\$6.1)	(\$1.9)	\$7.7	(\$0.9)	(\$3.6)	(\$1.9)	\$6.0	\$3.7	(\$0.2)	\$14.8	\$34.7	(\$1.8)	\$10.0
Limerick	2,242	\$54.1	\$17.1	\$24.7	\$16.6	\$2.6	\$12.2	\$25.7	\$6.5	(\$2.1)	\$1.5	\$12.1	\$1.6	(\$2.6)	\$11.6	\$38.2	(\$3.3)	\$11.2
North Anna	1,892	\$52.0	\$14.6	\$25.5	\$16.8	\$0.2	\$5.7	\$23.2	\$10.9	\$3.0	\$4.7	\$16.0	\$4.8	(\$2.0)	\$17.9	NA	NA	NA
Oyster Creek	608	\$47.5	\$8.4	\$15.9	\$7.2	(\$8.2)	\$3.3	\$16.4	(\$4.7)	(\$11.6)	(\$9.9)	NA	NA	NA	NA	NA	NA	NA
Peach Bottom	2,550	\$53.7	\$16.9	\$24.2	\$16.1	\$2.3	\$12.3	\$25.5	\$5.8	(\$2.2)	\$1.4	\$11.9	\$0.6	(\$2.8)	\$11.4	\$38.3	(\$3.3)	\$11.3
Perry	1,240	NA	NA	NA	NA	(\$13.2)	(\$6.4)	\$5.5	(\$0.3)	(\$4.0)	(\$7.4)	\$1.9	(\$5.9)	(\$15.2)	\$6.2	\$32.0	(\$9.3)	\$0.0
Quad Cities	1,819	\$24.1	(\$0.4)	\$2.4	(\$1.8)	(\$13.2)	(\$6.9)	\$0.6	(\$7.7)	(\$9.5)	(\$3.5)	\$4.3	\$18.8	\$14.4	\$29.4	\$51.3	\$14.4	\$12.1
Salem	2,285	\$54.0	\$17.1	\$24.5	\$16.9	\$2.6	\$12.4	\$26.0	\$6.2	(\$2.1)	\$1.5	\$12.2	\$8.5	\$7.8	\$20.0	\$47.6	\$6.6	\$11.4
Surry	1,676	\$48.8	\$13.8	\$24.2	\$16.4	(\$0.0)	\$5.1	\$21.6	\$10.8	\$2.6	\$4.5	\$16.0	\$4.2	(\$2.5)	\$17.4	NA	NA	NA
Susquehanna	2,494	\$46.8	\$15.2	\$22.4	\$16.1	\$1.4	\$11.1	\$24.6	\$6.3	(\$1.6)	\$1.8	\$10.1	(\$1.7)	(\$6.9)	\$8.3	\$35.9	(\$2.8)	\$10.7
Three Mile Island	803	\$40.7	\$6.5	\$13.3	\$4.6	(\$9.6)	\$0.9	\$13.7	(\$6.8)	(\$12.4)	(\$10.3)	(\$3.8)	NA	NA	NA	NA	NA	NA

Table 7-50 shows the surplus or shortfall for the 16 nuclear plants in PJM in dollars, including subsidies.

**Table 7-50 Nuclear unit surplus (shortfall) based on public data (\$M): 2008 through 2024**

	ICAP (MW)	Surplus (Shortfall) (\$ in millions)																
		2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
Beaver Valley	1,808	\$393.5	\$93.3	\$156.3	\$131.1	(\$49.4)	\$21.0	\$174.8	\$47.7	(\$8.9)	\$35.7	\$204.3	\$51.0	(\$42.5)	\$223.0	\$632.2	\$28.2	\$178.2
Braidwood	2,337	\$482.3	\$48.3	\$122.8	\$65.2	(\$118.7)	(\$49.6)	\$138.9	(\$22.7)	(\$65.2)	(\$33.3)	\$110.8	\$70.7	(\$4.2)	\$290.0	\$674.9	(\$32.4)	\$197.7
Byron	2,300	\$465.5	(\$24.2)	\$64.1	(\$10.5)	(\$178.9)	(\$68.6)	\$93.2	(\$116.7)	(\$185.2)	(\$55.5)	\$106.4	\$56.6	(\$14.8)	\$267.5	\$654.7	(\$40.0)	\$201.5
Calvert Cliffs	1,726	\$865.9	\$297.3	\$406.9	\$254.8	\$64.5	\$208.4	\$449.6	\$201.4	\$100.7	\$84.7	\$229.8	\$74.0	(\$15.3)	\$275.3	\$778.7	\$128.6	\$191.9
Cook	2,177	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA
Davis Besse	894	NA	NA	NA	NA	(\$98.0)	(\$51.4)	\$48.6	(\$8.6)	(\$31.5)	(\$63.7)	(\$8.4)	(\$47.2)	(\$111.5)	\$42.1	\$232.3	(\$76.7)	(\$1.9)
Dresden	1,797	\$380.7	\$44.6	\$112.9	\$65.7	(\$77.7)	(\$15.0)	\$134.6	\$4.4	(\$26.5)	(\$5.5)	\$102.2	\$62.2	\$4.1	\$231.7	\$536.2	(\$34.9)	\$159.3
Hope Creek	1,172	\$523.2	\$164.8	\$237.0	\$163.2	\$24.8	\$119.9	\$251.6	\$60.5	(\$23.2)	\$11.2	\$114.5	\$79.9	\$70.3	\$200.6	\$461.3	\$63.3	\$109.7
LaSalle	2,265	\$464.9	\$45.9	\$119.9	\$61.5	(\$114.1)	(\$35.3)	\$144.7	(\$16.3)	(\$69.8)	(\$37.5)	\$109.0	\$66.1	(\$5.6)	\$277.3	\$648.5	(\$35.8)	\$186.8
Limerick	2,242	\$1,003.7	\$316.3	\$457.2	\$307.6	\$47.8	\$226.5	\$476.3	\$120.1	(\$41.1)	\$25.3	\$221.7	\$28.2	(\$48.7)	\$213.8	\$707.9	(\$63.4)	\$208.5
North Anna	1,892	\$813.9	\$228.5	\$397.7	\$262.7	\$3.5	\$89.3	\$362.6	\$170.2	\$44.3	\$71.2	\$246.5	\$71.4	(\$33.3)	\$279.3	NA	NA	NA
Oyster Creek	608	\$239.0	\$42.4	\$79.7	\$35.9	(\$41.1)	\$16.4	\$82.3	(\$23.4)	(\$58.2)	(\$49.6)	NA	NA	NA	NA	NA	NA	NA
Peach Bottom	2,550	\$1,133.0	\$356.3	\$508.8	\$338.5	\$48.4	\$259.6	\$537.6	\$122.6	(\$53.0)	\$23.7	\$242.9	\$9.1	(\$63.3)	\$237.2	\$805.9	(\$75.2)	\$237.3
Perry	1,240	NA	NA	NA	NA	(\$135.8)	(\$65.3)	\$56.6	(\$3.5)	(\$43.2)	(\$77.5)	\$16.9	(\$61.1)	(\$155.2)	\$62.6	\$327.2	(\$98.4)	\$17.1
Quad Cities	1,819	\$363.1	(\$6.7)	\$36.3	(\$27.7)	(\$199.0)	(\$103.5)	\$8.6	(\$115.3)	(\$145.0)	(\$54.5)	\$62.7	\$274.3	\$207.9	\$439.8	\$768.4	\$214.6	\$118.4
Salem	2,285	\$1,021.3	\$322.8	\$461.9	\$317.9	\$48.2	\$233.1	\$490.0	\$117.1	(\$45.5)	\$21.3	\$222.5	\$155.5	\$136.9	\$390.3	\$898.3	\$123.0	\$213.8
Surry	1,676	\$676.9	\$190.3	\$334.4	\$226.4	(\$0.4)	\$71.2	\$298.9	\$148.8	\$33.5	\$60.4	\$219.1	\$53.2	(\$38.4)	\$237.8	NA	NA	NA
Susquehanna	2,494	\$965.9	\$312.8	\$461.6	\$332.2	\$29.4	\$229.0	\$506.6	\$129.9	(\$39.7)	\$31.2	\$201.0	(\$34.4)	(\$141.3)	\$172.0	\$742.6	(\$58.4)	\$223.5
Three Mile Island	803	\$270.5	\$42.9	\$88.2	\$30.2	(\$63.7)	\$5.9	\$90.7	(\$45.2)	(\$82.3)	(\$68.1)	(\$25.3)	NA	NA	NA	NA	NA	NA

In order to evaluate the expected viability of nuclear plants, analysis was performed based on forward energy market prices for 2025, 2026, and 2027 and known capacity market prices for 2024 and 2025. The purpose of the forward analysis is to evaluate whether current forward prices are consistent with nuclear plants covering their annual avoidable costs over the next three years. While the forward capacity market prices are known through the 2025/2026 Delivery Year, actual energy prices will vary from forward values. Nuclear plants may choose to sell their output at a range of forward prices and for a range of future years.

Table 7-51 shows PJM energy prices (LMP), annual fuel, and operating and capital expenditures used for the analysis of the period 2025 through 2027. Capacity revenues for calendar year 2026 include five months of capacity revenue from the 2025/2026 Delivery Year and seven months of capacity revenue assuming a clearing price of \$325/MW-Day for the 2026/2027 Delivery Year.<sup>84</sup> The 2026/2027 BRA and 2027/2028 BRA have not yet been run. The LMPs are

<sup>84</sup> On February 20, 2025, PJM filed with FERC to establish a maximum price of approximately \$325/MW-day in unforced capacity and a minimum price of approximately \$175/MW-day, both in unforced capacity (UCAP) terms for all capacity auctions for the 2026/2027 and 2027/2028 Delivery Years. See Docket No. ER25-1357.

based on forward prices with a basis adjustment for the specific plant locations.<sup>85</sup> Forward prices are as of December 31, 2024. The capacity prices are known through 2025 based on PJM capacity auction results.

**Table 7-51 Forward prices in PJM energy markets, capacity revenue, and annual costs**

	ICAP (MW)	Average Forward LMP (\$/MWh)			Ancillary Revenue (\$/MWh)	Capacity Revenue (\$/MWh)		2023 NEI Costs (\$/MWh)		
		2025	2026	2027		2025	2026	Fuel	Operating	Capital
Beaver Valley	1,808	\$43.11	\$48.10	\$51.27	\$0.21	\$7.40	\$13.14	\$5.27	\$18.03	\$6.23
Braidwood	2,337	\$34.04	\$36.20	\$38.79	\$0.17	\$7.40	\$13.14	\$5.27	\$18.03	\$6.23
Byron	2,300	\$32.20	\$36.97	\$39.44	\$0.15	\$7.40	\$13.14	\$5.27	\$18.03	\$6.23
Calvert Cliffs	1,726	\$48.04	\$53.78	\$57.27	\$0.19	\$7.77	\$13.14	\$5.27	\$18.03	\$6.23
Cook	2,177	\$40.37	\$45.16	\$48.14	\$0.13	NA	NA	\$5.27	\$18.03	\$6.23
Davis Besse	894	\$40.72	\$46.03	\$49.16	\$0.21	\$7.40	\$13.14	\$5.50	\$25.40	\$10.72
Dresden	1,797	\$33.57	\$38.53	\$41.13	\$0.23	\$7.40	\$13.14	\$5.27	\$18.03	\$6.23
Hope Creek	1,172	\$38.50	\$43.58	\$46.45	\$0.47	\$7.84	\$13.14	\$5.27	\$18.03	\$6.23
LaSalle	2,265	\$33.98	\$36.13	\$38.72	\$0.13	\$7.40	\$13.14	\$5.27	\$18.03	\$6.23
Limerick	2,242	\$37.99	\$43.02	\$45.87	\$0.10	\$7.84	\$13.14	\$5.27	\$18.03	\$6.23
North Anna	1,892	\$46.68	\$52.41	\$55.84	\$0.18	\$11.32	\$8.28	\$5.27	\$18.03	\$6.23
Peach Bottom	2,550	\$37.97	\$43.06	\$45.93	\$0.31	\$7.84	\$13.14	\$5.27	\$18.03	\$6.23
Perry	1,240	\$44.13	\$49.30	\$52.56	\$0.21	\$7.40	\$13.14	\$5.50	\$25.40	\$10.72
Quad Cities	1,819	\$30.16	\$34.98	\$37.41	\$0.13	\$7.40	\$13.14	\$5.27	\$18.03	\$6.23
Salem	2,285	\$38.48	\$43.55	\$46.43	\$0.35	\$7.84	\$13.14	\$5.27	\$18.03	\$6.23
Surry	1,676	\$44.90	\$50.49	\$53.79	\$0.16	\$11.32	\$8.28	\$5.27	\$18.03	\$6.23
Susquehanna	2,494	\$35.72	\$40.27	\$42.94	\$0.32	\$7.77	\$13.14	\$5.27	\$18.03	\$6.23

The MMU also calculates the capacity price that would be required to cover the net avoidable costs for each nuclear plant.

Based on the FERC order allowing the inclusion of major maintenance in energy offers, major maintenance costs can no longer be included in gross ACR values offered in the capacity market.<sup>86</sup> The MMU calculates the capacity price that would be required to cover the net avoidable costs for each nuclear plant with major maintenance included in avoidable costs and with major maintenance excluded from avoidable costs. For the case including major maintenance, gross ACR is NEI total cost including fuel, operating cost, and incremental capital expenditures. For the case excluding major maintenance, gross ACR is NEI total cost including fuel and operating cost, excluding capital expenditures as a proxy for fixed VOM, given that NEI does not provide a breakout of major maintenance. NEI incremental capital expenditures are likely to be a conservatively low estimate of major maintenance expense.

All generating plants including nuclear plants must cover their gross avoidable costs, including major maintenance, to remain economically viable. All of the MMU analysis of nuclear plant economics includes gross avoidable costs as reported by NEI unless explicitly stated otherwise.

In Table 7-52, the capacity price required to cover avoidable costs in \$/MWh is calculated by taking the total NEI costs in \$/MWh and subtracting the total expected energy and ancillary services revenues in \$/MWh. Total expected energy revenue is the unit's ICAP multiplied by the average forward LMP multiplied by the class average capacity factor. Total expected ancillary services revenue is unit specific reactive capability revenue.<sup>87</sup> The capacity price required to cover avoidable costs in \$/MW-day is calculated by multiplying the required price in \$/MWh by 24. Plants may have actual operating costs higher or lower than the NEI average.

In Table 7-52, the capacity price required to cover avoidable costs is \$0/MW-day for all units in 2024, 2025 and 2026 using NEI data as reported including capital expenditures except for Davis Besse in 2024, and is \$0/MW-day for all plants, excluding capital expenditures as a proxy for major maintenance, in 2025, 2026, and 2027.<sup>88</sup> Net revenues based on forward energy prices alone are greater than or equal to avoidable costs in 2025 and 2026 without any contribution from capacity market revenues for all plants. The result is that net ACR values for 2025, 2026 and 2027 in Table 7-52 are zero except for Davis Besse in 2024, a single unit plant.

<sup>85</sup> Forward prices on December 31, 2024. Forward prices are reported for PJM trading hubs which are adjusted to reflect the historical differences between prices at the trading hub and prices at the relevant plant locations. The basis adjustment is based on 2024 data.

<sup>86</sup> See 167 FERC ¶ 61,030 at P. 41 (2019).

<sup>87</sup> Reactive Supply & Voltage Control Revenue Requirements available from PJM <<https://www.pjm.com/markets-and-operations/billing-settlements-and-credit.aspx>>.

<sup>88</sup> PJM's tariff definition of avoidable costs excludes major maintenance. PJM includes major maintenance costs in the definition of short run marginal costs in energy offers.



Table 7-52 Net ACR

	ICAP (MW)	Net ACR (\$/MWh)			Net ACR (\$/MW-Day)			Net ACR Excluding Capital (\$/MW-Day)		
		2025	2026	2027	2025	2026	2027	2025	2026	2027
Beaver Valley	1,808	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Braidwood	2,337	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Byron	2,300	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Calvert Cliffs	1,726	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Cook	2,177	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Davis Besse	894	\$0.69	\$0.00	\$0.00	\$15.71	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Dresden	1,797	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Hope Creek	1,172	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
LaSalle	2,265	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Limerick	2,242	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
North Anna	1,892	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Peach Bottom	2,550	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Perry	1,240	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Quad Cities	1,819	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Salem	2,285	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Surry	1,676	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Susquehanna	2,494	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00

Table 7-53 shows the surplus or shortfall that would be received net of avoidable costs and incremental capital expenditures by year, based on forward prices, on a per MWh basis. The fuel and operating costs are the 2023 NEI fuel, operating, and capital costs. Plants may have operating costs higher or lower than the NEI average. Table 7-53 shows the total dollar surplus or shortfall and adjusts energy revenues and operating costs using the annual class average capacity factor.

The 2025 nuclear unit surplus values are shown in Table 7-53 based on forward prices as of December 31, 2024, NEI average costs, and expected subsidy values.<sup>89</sup> The current analysis, based on forward prices for energy, known forward prices for capacity, and an assumed clearing price of \$325/MW-Day for the 2026/2027 Delivery Year, shows that all PJM nuclear plants analyzed are expected to have a surplus without any subsidy amount in 2025 and 2026.<sup>90</sup>

Table 7-53 Nuclear unit forward annual surplus (shortfall) for 2025 and 2026<sup>91 92 93</sup>

	Surplus (Shortfall) (\$/MWh)		Subsidy (\$/MWh)		Surplus (Shortfall) Excluding Subsidy (\$ in millions)		Surplus (Shortfall) Including Subsidy (\$ in millions)	
	2025	2026	2025	2026	2025	2026	2025	2026
Beaver Valley	\$21.18	\$31.80	\$0.00	\$8.30	\$319.1	\$479.0	\$319.1	\$604.0
Braidwood	\$12.08	\$19.88	\$1.70	\$12.30	\$235.2	\$387.1	\$268.3	\$626.5
Byron	\$10.22	\$20.64	\$3.20	\$12.05	\$195.8	\$395.5	\$257.1	\$626.4
Calvert Cliffs	\$26.47	\$37.47	\$0.00	\$6.40	\$380.6	\$538.8	\$380.6	\$630.8
Cook	NA	NA	\$2.60	\$0.00	NA	NA	NA	NA
Davis Besse	\$6.71	\$17.63	\$0.00	\$9.00	\$50.0	\$131.3	\$50.0	\$198.3
Dresden	\$11.67	\$22.24	\$2.05	\$11.45	\$174.7	\$332.9	\$205.4	\$504.3
Hope Creek	\$17.29	\$27.38	\$4.17	\$1.60	\$168.8	\$267.3	\$209.5	\$282.9
LaSalle	\$11.98	\$19.79	\$1.80	\$12.35	\$226.1	\$373.5	\$260.0	\$606.5
Limerick	\$16.40	\$26.68	\$0.00	\$10.05	\$306.4	\$498.2	\$306.4	\$685.9
North Anna	NA	\$31.23	\$0.00	\$10.75	NA	\$618.2	NA	\$787.7
Peach Bottom	\$16.59	\$26.80	\$0.00	\$9.90	\$352.5	\$569.4	\$352.5	\$779.7
Perry	\$10.12	\$20.91	\$0.00	\$7.90	\$104.5	\$216.0	\$104.5	\$297.6
Quad Cities	\$8.16	\$18.65	\$16.50	\$16.50	\$123.6	\$282.6	\$373.7	\$532.6
Salem	\$17.15	\$27.31	\$4.17	\$1.70	\$326.4	\$519.8	\$405.7	\$552.2
Surry	NA	\$29.31	\$0.00	\$11.40	NA	\$520.8	NA	\$679.9
Susquehanna	\$14.28	\$24.01	\$0.00	\$10.80	\$296.7	\$498.9	\$296.7	\$723.3

<sup>89</sup> Gross receipts used to calculate the unit subsidy include energy revenue, ancillary services revenue, capacity revenue, and state ZECs subsidies, and assumes the unit meets prevailing wage requirements and receives the Zero Emission Nuclear Power Production Credit 5 times multiplier. Effectively, nuclear power plants will receive the higher of the state or federal subsidy amount.

<sup>90</sup> On February 20, 2025, PJM filed with FERC to establish a maximum price of approximately \$325/MW-day in unforced capacity and a minimum price of approximately \$175/MW-day, both in unforced capacity (UCAP) terms for all capacity auctions for the 2026/2027 and 2027/2028 Delivery Years. See Docket No. ER25-1357.

<sup>91</sup> The state subsidy value for Braidwood, Byron, Dresden, and LaSalle is calculated by taking the applicable Baseline Cost less forward energy prices and known capacity prices.

<sup>92</sup> The federal subsidy value for nuclear plants is defined in the Inflation Reduction Act of 2022, Public Law 117-169 (August 16, 2022).

<sup>93</sup> North Anna and Surry are in Dominion FRR beginning with the 2022/2023 Delivery Year. North Anna and Surry rejoined the PJM Capacity Market beginning with the 2025/2026 Delivery Year.

## Units at Risk of Retirement

PJM is facing significant unit retirements through 2030 as a result of federal policies, state policies, and competitive market conditions. Federal environmental policies with a significant impact on retirements include the Cross-State Air Pollution Rule, regulations on the disposal of coal combustion residuals, and the Effluent Guidelines Program Plan.<sup>94 95 96</sup> State policies with a significant impact on retirements include the Illinois Climate and Equitable Jobs Act, the Virginia Clean Economy Act, New Jersey's rule on CO<sub>2</sub> emissions, and Maryland's Climate Solutions Now Act.<sup>97 98 99 100</sup>

Unit revenues are a combination of energy and ancillary service revenues and capacity market revenues. Units that fail to recover avoidable costs and are expected to continue to fail to recover avoidable costs from total market revenues, including capacity market revenues, are at risk of retirement because they are uneconomic.<sup>101</sup> <sup>102</sup> The economic analysis scales 2022, 2023, and 2024 energy and ancillary net revenues by the ratio of forward annual PJM LMPs to historical annual PJM LMPs for 2025, 2026, and 2027.<sup>103</sup> These expected energy revenues are added to capacity market revenues based on cleared forward capacity prices and compared to avoidable costs (ACR) over the period 2025-2027. Forward LMPs are based on forward prices as of December 31, 2024. Forward capacity revenues for the 2026/2027 and 2027/2028 auction are set to \$325/MW-Day UCAP and assume the unit clears the same amount of UCAP as in the 2025/2026 BRA because the 2026/2027 auction and the 2027/2028 auction have not been run.<sup>104</sup> Additional

analysis shows capacity at risk of retirement if ACR is half of the values shown in Table 7-39.

A number of units have made formal deactivation requests and are planning to retire on identified dates.<sup>105</sup> Unit owners reverse their deactivation decisions with little notice prior to auctions. These deactivation data were effective at February 10, 2025. Other units are expected to be affected by environmental regulations at the federal or state level and are expected to retire by 2030. The forward economic analysis shows additional units that are expected to be uneconomic and that are not included in the categories of requested deactivation or regulatory at risk.

A total of 34,733 MW of capacity are at risk of retirement, consisting of 4,684 MW currently planning to retire, 16,786 MW expected to retire for regulatory reasons, and 13,264 MW expected to be uneconomic. The MW of capacity expected to be uneconomic decreased from 2023 as a result of higher forward spreads and higher capacity market prices. This capacity at risk of retirement consists primarily of coal steam plants and CTs.<sup>106</sup> The profile of these units is shown in Table 7-54.<sup>107 108 109</sup>

94 EPA Revised Cross-State Air Pollution Rule Update for the 2008 Ozone NAAQS (CSAPR), Docket No. EPA-HQ-OAR-2020-0272; FRL-10013-42- OAR, 85 Fed. Reg. 23054 (April 30, 2021); <<https://www.epa.gov/coalash/coal-ash-rule>>.

95 See Hazardous and Solid Waste Management System; Disposal of Coal Combustion Residuals from Electric Utilities, 80 Fed. Reg. 21302 (April 17, 2015) <<https://www.epa.gov/coalash/coal-ash-rule>>.

96 See Effluent Limitations Guidelines and Standards for the Steam Electric Power Generating Point Source Category, EPA Docket No. FRL 8794-04-OW, 86 Fed. Reg. 41801 (August 3, 2021); Steam Electric Reconsideration Rule, Docket No. EPA-HQ-OW-2009-0819; FRL-10014-41-OW, 85 Fed. Reg. 64650 (October 13, 2020); Effluent Limitations Guidelines and Standards for the Steam Electric Power Generating Point Source Category, EPA Docket No. EPA-HQ-OW-2009-0819; FRL-9930-48-OW, 80 Fed. Reg. 67838 (November 3, 2015) (collectively "Effluent Guidelines").

97 See Illinois Climate and Equitable Jobs Act (CEJA), Public Act 102-0662 (Sep. 15, 2015) <<https://www2.illinois.gov/epa/topics/ceja>>.

98 See Virginia House Bill No. 1526 (March 18, 2020) <<https://lis.virginia.gov/cgi-bin/legp604.exe?201+sum+HB1526>>.

99 See Control and Prohibition of Carbon Dioxide Emissions, N.J.A.C. 7:27F (December 2, 2022).

100 See Maryland Climate Solutions Now Act, SB 528 (Enacted April 8, 2022).

101 FRR units, units that have already requested deactivation, and units that are expected to retire for regulatory reasons by 2030 are excluded from the economic at risk analysis.

102 Units at risk of retirement for economic reasons analysis is based on the default unit type ACR provided by Pasteris Energy, Inc.

103 The method for calculating forward revenues used in defining units at risk because they are uneconomic has changed from the forward hourly dispatch method used in 2022 and prior years.

104 On February 20, 2025, PJM filed with FERC to establish a maximum price of approximately \$325/MW-day in unforced capacity and a minimum price of approximately \$175/MW-day, both in unforced capacity (UCAP) terms for all capacity auctions for the 2026/2027 and 2027/2028 Delivery Years. See Docket No. ER25-1357.

105 PJM. Generator Deactivations. February 10, 2025. <<https://www.pjm.com/planning/services-requests/gen-deactivations>>.

106 Category Other consists of units with a primary fuel of diesel, landfill gas, light oil, propane, kerosene, heavy oil, municipal solid waste or waste coal.

107 Units expected to continue operations for reasons not directly related to market prices are not considered at risk of retirement.

108 No units are in multiple categories. MW expected to retire for regulatory reasons 2025 through 2030 are additional MW beyond the units that have requested deactivation. MW at risk for economic reasons are units that are expected to be uneconomic and have neither requested deactivation nor are expected to retire for regulatory reasons by 2030.

109 Includes FRR units that have requested deactivation. Includes FRR units that are expected to retire for regulatory reasons. Economic at risk analysis excludes FRR units.

**Table 7-54 Profile of units expected to retire and at risk of retirement**

	MW expected to retire						Total MW 2025-2030
	2025	2026	2027	2028	2029	2030	
MW requested deactivation							
Coal	0	410	0	1,273	0	0	1,683
Natural Gas	2,236	0	169	0	0	0	2,405
Other	471	124	0	0	0	0	595
Total MW requested deactivation	2,707	534	169	1,273	0	0	4,684
MW expected to retire for regulatory reasons							
Coal	1,493	333	1,760	5,523	0	1,107	10,216
Natural Gas	0	0	2,441	0	0	3,870	6,311
Other	0	33	0	0	0	226	259
Total MW expected to retire for regulatory reasons	1,493	366	4,201	5,523	0	5,203	16,786
Additional MW uneconomic 2025-2027							
Coal							8,977
Natural Gas							3,614
Other							673
Total MW uneconomic							13,264
Total							
Coal	1,493	743	1,760	6,796	0	1,107	20,876
Natural Gas	2,236	0	2,610	0	0	3,870	12,330
Other	471	157	0	0	0	226	1,527
Total MW At Risk of Retirement	4,200	900	4,370	6,796	0	5,203	34,733

In order to provide historical context, Table 7-55 shows PJM retirements for the period from 2011 through 2024.<sup>110</sup> The total retirements over that 14 year period is comparable to the retirements expected over the next six years.

**Table 7-55 Retirements and expected retirements**

	MW Retired															MW at Risk
	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024	2011-2024	2025-2030
Coal	543	5,908	2,590	2,239	7,065	243	2,038	3,167	4,111	2,132	1,020	5,385	4,380	180	41,000	20,876
Natural Gas	523	250	82	294	1,319	74	34	1,441	447	233	220	340	1,493	149	6,897	12,330
Other	131	804	187	437	879	83	41	935	899	891	70	439	855	198	6,849	1,527
Total MW	1,197	6,962	2,859	2,970	9,263	400	2,113	5,543	5,456	3,255	1,310	6,163	6,728	527	54,746	34,733

As a sensitivity, if total forward energy and capacity revenues are doubled, the units at risk of retirement would decrease from 34,733 MW to 30,633 MW as a result of a decrease from 13,264 MW to 9,163 MW expected to be uneconomic.

**Table 7-56 Profile of units expected to retire and at risk of retirement if total forward energy and capacity revenues are doubled**

<b>MW expected to retire 2025-2030</b>	
MW requested deactivation	4,684
MW expected to retire for regulatory reasons	16,786
<b>MW uneconomic 2025-2027 if revenues are doubled</b>	
Coal	6,032
Natural Gas	2,658
Other	473
<b>Total MW uneconomic</b>	<b>9,163</b>
<b>Total MW At Risk of Retirement</b>	
	<b>30,633</b>

<sup>110</sup> Details on unit retirements are in the 2024 Annual State of the Market Report for PJM, Volume 2: Section 12, Generation and Transmission Planning, Generation Retirements.

All of the units at risk may not retire. The probability of retirement is highest (although such units do change decisions) for the units that explicitly plan to retire (requested deactivation), next highest for units expected to retire for regulatory reasons, and significantly lower for units identified as uneconomic. If all or most of the retirements related to explicit plans, and related to regulatory reasons do retire, that will, holding other things constant, tend to increase both energy and capacity prices. Higher prices would make uneconomic units more economic and reduce the MW identified as uneconomic. Risk created by the level of uncertainty about PJM's new capacity market design could also have an impact on the economic viability of these units. As a result, the actual level of MW that are expected to retire for economic reasons is uncertain.

If all of the coal units identified as at risk (20,876 MW) are replaced by new gas-fired CCs, those new units would require a significant amount of firm gas pipeline capacity if the units are single fuel.<sup>111</sup> In aggregate, ignoring locational issues, the installed capacity of the coal units at risk of retirement could be replaced by eight new two 1x1 combined cycle units. The new CC plants would require 1.7 BCF/day of firm pipeline capacity based on the maximum output level of the CCs to replace that coal capacity. (Table 7-57). The level of firm pipeline capacity required to replace the capacity and reliability value of the retiring coal units could also be reduced if the new CCs invested in dual fuel capability.

Table 7-57 shows the installed capacity of the units at risk by fuel type and the corresponding number of new CCs needed to replace the identified coal capacity.

**Table 7-57 Gas pipeline capacity need to replace units at risk of retirement**

	MW At Risk	
Gas pipeline capacity need to replace units at risk of retirement	34,733	30,633
ICAP		
Coal	20,876	17,931
Natural Gas	12,330	11,374
Other	1,527	1,328
Total	34,733	30,633
New CC unit ICAP (MW)	1,362	1,362
New CC unit heat rate (mmbtu/MWh)	6.543	6.543
Number of new CC units needed to replace coal at risk	16	14
Dth needed to replace all coal at risk (Dth/day)	3,422,041	2,994,286
Bcf needed to replace all coal at risk (Bcf/day)	3.4	3.0
Dth needed to replace half of coal at risk (Dth/day)	1,711,021	1,497,143
Bcf needed to replace half of coal at risk (Bcf/day)	1.7	1.5

<sup>111</sup> This analysis assumes that retiring gas plants have pipeline capacity.

## Environmental and Renewable Energy Regulations

Environmental requirements and renewable energy mandates have a significant impact on PJM markets. State and federal environmental regulatory requirements affect the economic viability of resources and will result in the retirement of a significant level of capacity resources by 2030. State and federal environmental policies also affect the viability of new resources and the cost of entry. State and federal subsidies for renewable generation have made new solar resources cost competitive with existing coal resources and contributed to the significant level of wind and solar resources entering the market.

### Overview

#### Federal Environmental Regulation

- **MATS.** The U.S. Environmental Protection Agency's (EPA) Mercury and Air Toxics Standards rule (MATS) applies the Clean Air Act (CAA) maximum achievable control technology (MACT) requirement to new or modified sources of emissions of mercury and arsenic, acid gas, nickel, selenium and cyanide.<sup>1</sup> On April 24, 2024, the EPA finalized a strengthened and updated MATS rule reflecting recent developments in control technologies and the performance of coal fired plants.<sup>2</sup>
- **Air Quality Standards (NO<sub>x</sub> and SO<sub>2</sub> Emissions).** The CAA requires each state to attain and maintain compliance with fine particulate matter (PM) and ozone national ambient air quality standards (NAAQS). The CAA also requires that each state prohibit emissions that significantly interfere with the ability of another state to meet NAAQS.<sup>3</sup> (Transport Rule) On March 15, 2021, the EPA finalized decreases to allowable emissions under the Cross-State Air Pollution Rule (CSAPR) and the 2008 ozone NAAQS for 10 PJM states.<sup>4</sup> On February 28, 2022, the EPA issued a federal implementation plan for implementation of CSAPR (also known as

the Good Neighbor Plan),<sup>5</sup> which applies when no state implementation plan has been approved. On June 27, 2024, the Supreme Court of the United States granted a stay of the federal implementation plan pending judicial review.<sup>6</sup> The effect of the stay is to eliminate the ozone season NO<sub>x</sub> emissions budgets for electric generating units in the PJM states. Unless and until the stay is lifted, no federal implementation plan is effective in PJM states and the state emissions budgets are not effective. The EPA had previously rejected all proposed state implementation plans for PJM states.

- **NSR.** The CAA's NSR program is a preconstruction permitting program that requires certain stationary sources of air pollution to obtain permits prior to beginning construction. Parts C and D of Title I of the CAA provide for New Source Review (NSR) in order to prevent new projects and projects receiving major modifications from increasing emissions in areas currently meeting NAAQS or from inhibiting progress in areas that do not.<sup>7</sup> NSR requires permits before construction commences. NSR review applies a two part analysis to projects at facilities such as power plants, some of which involve multiple units and combinations of new and existing units.<sup>8</sup>
- **RICE.** Stationary reciprocating internal combustion engines (RICE) are electrical generation facilities like diesel engines typically used for backup, emergency or supplemental power. RICE must be tested annually.<sup>9</sup> RICE do not have to meet the same emissions standards if they are stationary emergency RICE. Environmental regulations allow stationary emergency RICE participating in demand response programs to operate for up to 100 hours per calendar year when providing emergency demand response when there is a PJM declared NERC Energy Emergency Alert Level 2 or there are five percent voltage/frequency deviations.

PJM does not prevent stationary emergency RICE that cannot meet its capacity market obligations as a result of EPA emissions standards from participating in PJM markets as DR. Some stationary emergency RICE that cannot meet its capacity market obligations

<sup>1</sup> See *National Emission Standards for Hazardous Air Pollutants From Coal and Oil-Fired Electric Utility Steam Generating Units and Standards of Performance for Fossil Fuel Fired Electric Utility, Industrial-Commercial-Institutional, and Small Industrial-Commercial-Institutional Steam Generating Units*, EPA Docket No. EPA-HQ-OAR-2009-0234, 77 Fed. Reg. 9304 (Feb. 16, 2012).

<sup>2</sup> See *National Emission Standards for Hazardous Air Pollutants: Coal- and Oil-Fired Electric Utility Steam Generating Units Review of the Residual Risk and Technology Review, Final Rule*, Docket No. EPA-HQ-OAR-2018-0794, 89 Fed. Reg. 38508 (May 7, 2024).

<sup>3</sup> CAA § 110(a)(2)(D)(i)(I).

<sup>4</sup> *Revised Cross-State Air Pollution Rule Update for the 2008 Ozone NAAQS*, Docket No. EPA-HQ-OAR-2020-0272; FRL-10013-42- OAR, 85 Fed. Reg. 23054 (Apr. 30, 2021).

<sup>5</sup> See *Federal Implementation Plan Addressing Regional Ozone Transport for the 2015 Ozone National Ambient Air Quality Standard*, Docket No. EPA-HQ-OAR-2021-0668; FRL 8670-01-OAR, 87 Fed. Reg. 20036 (April 6, 2022).

<sup>6</sup> *Ohio v. EPA*, Slip Op. No. 23A349. (S. Ct. June 27, 2024); *Utah v. EPA*, D.C. Cir. Case No. Case No. 23-1157, et al.

<sup>7</sup> 42 U.S.C § 7470 et seq.

<sup>8</sup> 40 CFR § 52.21.

<sup>9</sup> See 40 CFR § 63.6640(f).



as a result of emissions standards are now included in DR portfolios. Stationary emergency RICE should be prohibited from participation as DR either when registered individually or as part of a portfolio if it cannot meet its capacity market obligations as a result of emissions standards.

- **Greenhouse Gas Emissions.** On April 25, 2024, the EPA issued a rule (called “Carbon Emissions Rule” in this report) taking four separate actions under CAA § 111(a)(1) addressing greenhouse gas (GHG) emissions from fossil fuel-fired electric generating units (EGUs):<sup>10</sup> the rule repeals the Affordable Clean Energy (ACE) Rule; the rule finalizes emission guidelines for GHG emissions from existing coal fired and oil/gas fired steam generating EGUs; the rule revises the New Source Performance Standards (NSPS) for GHG emissions from new and reconstructed fossil fuel-fired stationary combustion turbine EGUs; the rule revises the NSPS for GHG emissions from fossil fuel-fired steam generating units that undertake a large modification, based upon the 8-year review required by the CAA. The rule deferred action on emission guidelines for GHG emissions from existing fossil fuel-fired stationary combustion turbines.
- The Carbon Emissions Rule reflects the application of the best system of emission reduction (BSER). The proposal includes emission guidelines for GHG emissions from existing fossil fuel-fired steam generating EGUs (including coal, oil or gas). For coal fired EGUs, compliance is required by January 1, 2030, with standards that vary based on whether the EGU commits to retire before 2032, 2035, 2040, or does not commit to retire before 2040.<sup>11</sup> The EPA proposes to repeal the Affordable Clean Energy Rule.<sup>12</sup>
- **Cooling Water Intakes.** An EPA rule implementing Section 316(b) of the Clean Water Act (CWA) requires that cooling water intake structures reflect the best technology available for minimizing adverse environmental impacts.<sup>13</sup>

<sup>10</sup> See *New Source Performance Standards for Greenhouse Gas Emissions From New, Modified, and Reconstructed Fossil Fuel-Fired Electric Generating Units; Emission Guidelines for Greenhouse Gas Emissions From Existing Fossil Fuel-Fired Electric Generating Units; and Repeal of the Affordable Clean Energy Rule*, Proposed Rule, Docket No. EPA-HQ-OAR-2023-0072, 89 Fed. Reg. 39798 (May 9, 2024) (“Carbon Emissions Rule”).

<sup>11</sup> Carbon Emissions Rule at 33371–33373.

<sup>12</sup> Carbon Emissions Rule at 33243.

<sup>13</sup> See EPA, *National Pollutant Discharge Elimination System—Final Regulations to Establish Requirements for Cooling Water Intake Structures at Existing Facilities and Amend Requirements at Phase I Facilities*, EPA-HQ-OW-2008-0667, 79 Fed. Reg. 48300 (August 15, 2014).

- **Waters of the United States.** On August 29, 2023, the EPA issued a final rule defining adjacent wetlands consistent with the Supreme Court holding that an adjacent wetland is “... a relatively permanent body of water connected to traditional interstate navigable waters ... and ... that the wetland has a continuous surface connection with that water.”<sup>14</sup> The rule became effective on September 8, 2023.<sup>15</sup>
- **Effluents.** Under the CWA, the EPA regulates (National Pollutant Discharge Elimination System (NPDES)) discharges from and intakes to power plants, including water cooling systems at steam electric power generating stations. Since 2015, the EPA has been strengthening certain discharge limits applicable to steam generating units, and some plant owners have already indicated an intent to close certain generating units as a result. In May 2024, the EPA finalized a rule strengthening regulation of effluent discharges.<sup>16</sup>
- **Coal Ash.** The EPA administers the Resource Conservation and Recovery Act (RCRA), which governs the disposal of solid and hazardous waste.<sup>17</sup> The EPA has adopted significant changes to the implementing regulations that will require closing noncompliant impoundments, and, as a result, the host power plant. The EPA is implementing a process for extensions to as late as October 17, 2028. The EPA is reviewing applications received from PJM plant owners for extensions of the deadline for compliance with the revised Coal Combustion Residuals Rule.

## State Environmental Regulation

- **Regional Greenhouse Gas Initiative (RGGI).** The Regional Greenhouse Gas Initiative (RGGI) is a CO<sub>2</sub> emissions cap and trade agreement among Connecticut, Delaware, Maine, Maryland, Massachusetts, New Hampshire, New Jersey, New York, Rhode Island, and Vermont that applies to power generation facilities. The RGGI auction price in the December 4, 2024, RGGI auction was \$20.05 per short ton, or \$22.10 per metric tonne.
- **Illinois Climate and Equitable Jobs Act (CEJA).** On September 16, 2021, the Climate and Equitable

<sup>14</sup> See Revised Definition of “Waters of the United States,” EPA-HQ-OW-2023-0346, 88 Fed. Reg. 61964 (September 8, 2023).

<sup>15</sup> See *id.*

<sup>16</sup> See *Supplemental Effluent Limitations Guidelines and Standards for the Steam Electric Power Generating Point Source Category*, Final Rule, EPA Docket No. EPA-HQ-OW-2009-0819; FRL-8794-01-OW, 89 Fed. Reg. 40199 (May 9, 2024).

<sup>17</sup> 42 U.S.C. §§ 6901 *et seq.*

Jobs Act (CEJA) became effective. CEJA created an expanded nuclear subsidy program. CEJA mandated that all fossil fuel plants close by 2045. CEJA established emissions caps for investor owned, gas-fired units with three years of operating history, effective October 1, 2021, on a rolling 12 month basis. More than 10,000 MW of capacity are currently affected. The CEJA operating hour limits have resulted in significant opportunity cost adders to cost-based energy market offers for affected units.

- **Carbon Price.** If the price of carbon were \$50.00 per metric tonne, short run marginal costs would have increased by \$24.45 per MWh or 93.3 percent for a new combustion turbine (CT) unit, \$16.85 per MWh or 86.5 percent for a new combined cycle (CC) unit and \$43.12 per MWh or 116.6 percent for a new coal plant (CP) for 2024.

## State Renewable Portfolio Standards

- **RPS.** In PJM, ten of 14 jurisdictions have enacted legislation requiring that a defined percentage of retail suppliers' load be served by renewable resources, for which definitions vary. These are typically known as renewable portfolio standards, or RPS. As of December 31, 2024, Delaware, Illinois, Maryland, Michigan, New Jersey, North Carolina, Ohio, Pennsylvania, Virginia and Washington, DC have renewable portfolio standards. Indiana has a voluntary renewable portfolio standard. Kentucky, Tennessee and West Virginia do not have renewable portfolio standards.
- **RPS Cost.** The cost of complying with RPS, as reported by the states, is \$11.8 billion over the nine year period from 2014 through 2022, an average annual RPS compliance cost of \$1.3 billion. The compliance cost for 2022, the most recent year with almost complete data, was \$2.4 billion.<sup>18</sup>

## Emissions Controls in PJM Markets

- **Regulations.** Environmental regulations affect decisions about emission control investments in existing units, investment in new units and decisions to retire units. As a result of environmental regulations and agreements to limit emissions,

many PJM units burning fossil fuels have installed emission control technology.

- **Emissions Controls.** In PJM, as of December 31, 2024, 97.4 percent of coal steam MW had some type of flue-gas desulfurization (FGD) technology to reduce SO<sub>2</sub> emissions, 99.8 percent of coal steam MW had some type of particulate matter (PM) control, and 99.8 percent of coal steam MW had NO<sub>x</sub> emission control technology. All coal steam units in PJM are compliant with the state and federal emissions limits established by MATS.

## Renewable Generation

- **Renewable Generation.** Wind and solar generation was 5.8 percent of total generation in PJM for 2024. RPS Tier I generation was 7.0 percent of total generation in PJM and RPS Tier II generation was 1.7 percent of total generation in PJM for 2024. Only Tier I generation is defined to be renewable but Tier 1 includes some carbon emitting generation.
- PJM states with RPS rely heavily on imports and generation from behind the meter resources for RPS compliance. In 2024, Tier I generation from PJM generators met only 46.9 percent of the Tier I RPS requirements.

## Recommendations

- The MMU recommends that renewable energy credit markets based on state renewable portfolio standards be brought into PJM markets as they are an increasingly important component of the wholesale energy market. The MMU recommends that there be a single PJM operated forward market for RECs, for a single product based on a common set of state definitions of renewable technologies, with a single clearing price, trued up to real-time delivery. (Priority: High. First reported 2010. Status: Not adopted.)
- The MMU recommends that jurisdictions with a renewable portfolio standard make the price and quantity data on supply and demand more transparent. (Priority: Low. First reported 2018. Status: Not adopted.)
- The MMU recommends that the Commission reconsider its disclaimer of jurisdiction over RECs markets because, given market changes since that decision, it is clear that RECs materially affect

<sup>18</sup> The 2022 compliance cost value for PJM states does not include Delaware, Michigan or North Carolina. Based on past data these states generally account for approximately 2.0 percent of the total RPS compliance cost of PJM states.

jurisdictional rates. (Priority: Low. First reported 2018. Status: Not adopted.)

- The MMU recommends that PJM provide a full analysis of the impact of carbon pricing on PJM generating units and carbon pricing revenues to the PJM states in order to permit the states to consider a potential agreement on the development of a multistate framework for carbon pricing and the distribution of carbon revenues. (Priority: High. First reported 2018. Status: Not adopted.)
- The MMU recommends that load and generation located at separate nodes be treated as separate resources in order to ensure that load and generation face consistent incentives throughout the markets. (Priority: High. First reported 2019. Status: Not adopted.)
- The MMU recommends that stationary emergency RICE be prohibited from participation as DR either when registered individually or as part of a portfolio if it cannot meet the capacity market requirements to be DR as a result of emissions standards that impose environmental run hour limitations. (Priority: Medium. First reported 2019. Status: Not adopted.)

## Conclusion

Environmental requirements and renewable energy mandates at both the federal and state levels have a significant impact on the cost of energy and capacity in PJM markets.

Environmental requirements and initiatives at both the federal and state levels, and state renewable energy mandates and associated subsidies have resulted in the construction of substantial amounts of renewable capacity in the PJM footprint, especially wind and solar resources, and the retirement of emitting resources. Renewable energy credit (REC) markets created by state programs, federal subsidies, and federal tax credits have significant impacts on PJM wholesale markets. But state renewables programs in PJM are not coordinated with one another, are generally not consistent with the PJM market design or PJM prices, have widely differing objectives, including supporting some emitting resources, have widely differing implied prices of carbon and are not transparent on pricing and quantities. The effectiveness of state renewables programs would be enhanced if they were coordinated with one another and

with PJM markets, and if they increased transparency. States could evaluate the impacts of a range of carbon prices if PJM would provide a full analysis of the impact of carbon pricing on PJM generating units and carbon pricing revenues to the PJM states in order to permit the states to consider a potential agreement on the development of a multistate framework for carbon pricing and the distribution of carbon revenues. A single carbon price across PJM, established by the states, would be the most efficient way to reduce carbon output, if that is the goal.

In the absence of a PJM market carbon price, a single PJM market for RECs would contribute significantly to market efficiency and to the procurement of renewable resources in a least cost manner. Ideally, there would be a single PJM operated forward market for RECs, for a single product based on a common set of state definitions of renewable technologies, with a single clearing price, trued up to real-time delivery. States would continue to have the option to create separate RECs for additional products that did not fit the product definition, e.g. waste coal, trash incinerators, or black liquor.

RECs are an important mechanism used by PJM states to implement environmental policy. RECs clearly affect prices in the PJM wholesale power market. Some resources are not economic except for the ability to purchase or sell RECs. RECs provide out of market payments to qualifying renewable resources, primarily wind and solar. The credits provide an incentive to make negative energy offers and more generally provide an incentive to enter the market, to remain in the market and to operate whenever possible. These subsidies affect the offer behavior and the operational behavior of these resources in PJM markets and in some cases the existence of these resources and thus the market prices and the mix of clearing resources.

RECs markets are, as an economic fact, integrated with PJM markets including energy and capacity markets, but are not formally recognized as part of PJM markets. It would be preferable to have a single, transparent market for RECs operated by the PJM RTO on behalf of the states that would meet the standards and requirements of all states in the PJM footprint. This would provide better information for market participants about supply and demand and prices and contribute to a more efficient and competitive market and to better price formation.

This could also facilitate entry by qualifying renewable resources by reducing the risks associated with lack of transparent market data.

Existing REC markets are not consistently or adequately transparent. Data on REC prices, clearing quantities and markets are not publicly available for all PJM states. The economic logic of RPS programs and the associated REC and SREC prices is not always clear. The price of carbon implied by REC prices ranges from \$13.40 per tonne in Ohio to \$63.85 per tonne in Virginia. The price of carbon implied by SREC prices ranges from \$74.65 per tonne in Pennsylvania to \$783.72 per tonne in Washington, DC. The effective prices for carbon compare to the RGGI clearing price in December 2024 of \$22.10 per tonne and to the social cost of carbon which is estimated in the range of \$50 per tonne.<sup>19 20</sup> The impact on the cost of generation from a new combined cycle unit of a \$50 per tonne carbon price would be \$16.85 per MWh.<sup>21</sup> The impact of an \$800 per tonne carbon price would be \$269.59 per MWh. This wide range of implied carbon prices is not consistent with an efficient, competitive, least cost approach to the reduction of carbon emissions.

In addition, even the explicit environmental goals of RPS programs are not clear. While RPS is frequently considered to target carbon emissions, Tier 1 resources include some carbon emitting generation and Tier 2 resources include additional carbon emitting generation.

PJM markets provide a flexible mechanism for incorporating the costs of environmental controls and meeting environmental requirements in a cost effective manner. Costs for environmental controls are part of offers for capacity resources in the PJM Capacity Market. The costs of emissions credits are included in energy offers. PJM markets also provide a flexible mechanism that incorporates renewable resources and the impacts of renewable energy credit markets, and ensures that renewable resources have access to a broad market. PJM markets provide efficient price signals that permit valuation of resources with very different characteristics when they provide the same product.

<sup>19</sup> "Technical Update of the Social Cost of Carbon for Regulatory Impact Analysis – Under Executive Order 12899," Interagency Working Group on the Social Cost of Greenhouse Gases, United States Government, (Aug. 2016), <[https://19january2017snapshot.epa.gov/sites/production/files/2016-12/documents/sc\\_co2\\_tsd\\_august\\_2016.pdf](https://19january2017snapshot.epa.gov/sites/production/files/2016-12/documents/sc_co2_tsd_august_2016.pdf)>.

<sup>20</sup> A recent update by the EPA estimates the social cost of carbon emissions for 2030 to be between \$140 and \$380 per metric ton (2020 dollars). See Table ES.1 in Report on the Social Cost of Greenhouse Gases, U.S. Environmental Protection Agency (November 2023) <<https://www.epa.gov/environmental-economics/scghg>>.

<sup>21</sup> The cost impact calculation assumes a heat rate of 6.296 MMBtu per MWh and a carbon emissions rate of 52.91 kg per MMBtu. The \$800 per tonne carbon price represents the approximate upper end of the carbon prices implied by the 2022 REC and SREC prices in the PJM jurisdictions with RPS. Additional cost impacts are provided in Table 8-7.

If the states chose this policy option, PJM markets could also provide a flexible mechanism to limit carbon output, for example by incorporating a consistent carbon price in unit offers which would be reflected in PJM's economic dispatch. If there is a social decision to limit carbon output, a consistent carbon price would be the most efficient way to implement that decision. The states in PJM could agree, if they decided it was in their interests, with the appropriate information, on a carbon price and on how to allocate the revenues from a carbon price that would make all states better off. A mechanism like RGGI leaves all decision making with the states. The carbon price would not be FERC jurisdictional or subject to PJM decisions. The MMU continues to recommend that PJM provide a full analysis of the impact of carbon pricing on PJM generating units and carbon pricing revenues to the PJM states in order to permit the states to consider a potential agreement on the development of a multistate framework for carbon pricing and the distribution of carbon revenues. The results of the analysis would include the impact on the dispatch of every unit, the impact on energy prices and the carbon pricing revenues that would flow to each state.

For example, states receiving high levels of revenue could shift revenue to states disproportionately hurt by a carbon price if they believed that all states would be better off as a result. A carbon price would also be an alternative to specific subsidies to individual nuclear power plants and to the current wide range of implied carbon prices embedded in RPS programs and instead provide a market signal to which any resource could respond. The imposition of specific and prescriptive environmental dispatch rules would, in contrast, pose a threat to economic dispatch and efficient markets and create very difficult market power monitoring and mitigation issues. The provision of subsidies to individual units creates a discriminatory regime that is not consistent with competition. The use of inconsistent implied carbon prices by state is also inconsistent with an efficient market and inconsistent with the least cost approach to meeting state environmental goals.

The annual average cost of complying with RPS over the nine year period from 2014 through 2022 for the ten jurisdictions that had RPS was \$1.3 billion, or a total of \$11.8 billion over nine years. The RPS compliance cost for 2022, the most recent year for which there is



almost complete data, was \$2.4 billion.<sup>22</sup> RPS costs are payments by customers to the sellers of qualifying resources. The revenues from carbon pricing flow to the states.

If all the PJM states participated in a regional carbon market, the estimated revenue returned to the states/customers from selling carbon allowances would be approximately \$7.0 billion per year if the carbon price were \$20.05 per short ton and emissions levels were five percent below 2022 emission levels. If all the PJM states participated in a regional carbon market, the estimated revenue returned to the states/customers from selling carbon allowances would be approximately \$17.5 billion if the carbon price were \$50 per short ton and emission levels were five percent below 2022 levels. If only the current RPS states participated in a regional carbon market, the estimated revenue returned to the states/customers from selling carbon allowances at \$20.05 per short ton would be about \$4.6 billion. The costs of a carbon price are the impact on energy market prices, net of the revenue returned to states/customers.

## Federal Environmental Regulation

The U.S. Environmental Protection Agency (EPA) administers the Clean Air Act (CAA), the Clean Water Act (CWA) and the Resource Conservation and Recovery Act (RCRA), all of which address pollution created by electric power production. The administration of these statutes is relevant to the operation of PJM markets.<sup>23</sup>

The CAA regulates air emissions by providing for the establishment of acceptable levels of emissions of hazardous air pollutants. The EPA issues technology based standards for major sources and area sources of emissions.<sup>24 25</sup>

The CWA regulates discharges from point sources that affect water quality and temperature.

The Resource Conservation and Recovery Act (RCRA) regulates the disposal of solid and hazardous waste.<sup>26</sup>

Regulation of coal ash or coal combustion residuals affects coal fired power plants.

The EPA's actions have affected and will continue to affect the cost to build and operate generating units in PJM, which in turn affects wholesale energy prices and capacity prices.

## CAA: NESHAP/MATS

Section 112 of the CAA requires the EPA to promulgate emissions control standards, known as the National Emission Standards for Hazardous Air Pollutants (NESHAP), from both new and existing area and major sources. On December 21, 2011, the EPA issued its Mercury and Air Toxics Standards rule (MATS), which applies the CAA maximum achievable control technology (MACT) requirement to new or modified sources of emissions of mercury and antimony, arsenic, beryllium, cadmium, chromium, cobalt, lead, manganese, acid gas, nickel, selenium and cyanide.

The U.S. Environmental Protection Agency's (EPA) Mercury and Air Toxics Standards rule (MATS) applies the Clean Air Act (CAA) maximum achievable control technology (MACT) requirement to new or modified sources of emissions of mercury and arsenic, acid gas, nickel, selenium and cyanide.<sup>27</sup> On February 13, 2023, the EPA issued a final rule reaffirming that it remains appropriate and necessary to regulate hazardous air pollutants (HAP), including mercury, from power plants after considering cost.<sup>28</sup> This action revokes a 2020 finding that it was not appropriate and necessary to regulate coal and oil fired power plants under CAA § 112, and would restore the basis for the MATS rule.

On April 24, 2024, the EPA finalized a strengthened and updated MATS rule reflecting recent developments in control technologies and the performance of coal fired plants.<sup>29</sup> EPA allows plants to meet emissions requirements for non-HAP metals under an alternative fPM emission standard as a surrogate, and most use that approach.<sup>30</sup> The core proposal would revise the (non Hg) fPM emission standard, from 0.030 to 0.010 lbs/

22 The 2022 compliance cost value for PJM states does not include Delaware, Michigan or North Carolina. Based on past data these states generally account for approximately 2.0 percent of the total RPS compliance cost of PJM states.

23 For more details, see the 2024 Annual State of the Market Report for PJM, Appendix H: "Environmental and Renewable Energy Regulations."

24 42 U.S.C. § 7401 et seq. (2000).

25 The EPA defines a "major source" as a stationary source or group of stationary sources that emit or have the potential to emit 10 tons per year or more of a hazardous air pollutant or 25 tons per year or more of a combination of hazardous air pollutants. An "area source" is any stationary source that is not a major source.

26 42 U.S.C. §§ 6901 et seq.

27 See *National Emission Standards for Hazardous Air Pollutants From Coal and Oil-Fired Electric Utility Steam Generating Units and Standards of Performance for Fossil Fuel Fired Electric Utility, Industrial-Commercial-Institutional, and Small Industrial-Commercial-Institutional Steam Generating Units*, EPA Docket No. EPA-HQ-OAR-2009-0234, 77 Fed. Reg. 9304 (Feb. 16, 2012).

28 See *National Emission Standards for Hazardous Air Pollutants: Coal- and Oil-Fired Electric Utility Steam Generating Units—Revocation of the 2020 Reconsideration, and Affirmation of the Appropriate and Necessary Supplemental Finding*, Final Action, EPA-HQ-OAR-2018-0794, 88 Fed. Reg. 13959 (March 6, 2023).

29 See *National Emission Standards for Hazardous Air Pollutants: Coal- and Oil-Fired Electric Utility Steam Generating Units Review of the Residual Risk and Technology Review*, Final Rule, Docket No. EPA-HQ-OAR-2018-0794, 89 Fed. Reg. 38508 (May 7, 2024).

30 *Id.* at 38510.



MMBtu.<sup>31</sup> The EPA “does not project that any EGUs will retire in response to the standards promulgated in this final rule.”<sup>32</sup>

On February 15, 2023, the EPA issued a final action reaffirming that it remains appropriate and necessary to regulate hazardous air pollutants (HAP), including mercury, from power plants after considering cost.<sup>33</sup> This action revokes a 2020 finding that it was not appropriate and necessary to regulate coal and oil fired power plants under CAA § 112, and restores the basis for the MATS rule.<sup>34</sup> Restoration of the appropriate and necessary finding removes the possibility of a challenge to the MATS rule if applied to the proposed construction or upgrade of a power plant.

### CAA: NAAQS/CSAPR

The CAA requires each state to attain and maintain compliance with particulate matter (PM) and ozone national ambient air quality standards (NAAQS).<sup>35</sup> Under NAAQS, the EPA establishes emission standards for six air pollutants, including NO<sub>x</sub>, SO<sub>2</sub>, O<sub>3</sub> at ground level, PM, CO, and Pb, and approves state plans to implement these standards, known as State Implementation Plans (SIPs).

In January 2015, the EPA began implementation of the Cross-State Air Pollution Rule (CSAPR) to address the CAA’s requirement that each state prohibit emissions that significantly interfere with the ability of another state to meet NAAQS. CSAPR requires specific states in the eastern and central United States to reduce power plant emissions of SO<sub>2</sub> and NO<sub>x</sub> that cross state lines and contribute to ozone and fine particle pollution in other states. CSAPR requires reductions to levels consistent with the 1997 ozone and fine particle emissions and 2006 fine particle emission NAAQS. CSAPR covers 28 states, including all of the PJM states except Delaware, and also excluding the District of Columbia.

On March 15, 2021, in response to a court holding in *Wisconsin v. EPA*,<sup>36</sup> the EPA finalized decreases to

allowable emissions under the Cross-State Air Pollution Rule (CSAPR) and the 2008 ozone NAAQS for 10 PJM states.<sup>37</sup> On February 28, 2022, the EPA proposed a Federal Implementation Plan (FIP) (at that time termed the Transport Rule) for 26 states that addresses the contribution of those states to problems in other states in attaining and maintaining the 2015 Ozone NAAQS.<sup>38</sup> The proposed FIP requirements would establish ozone season NO<sub>x</sub> emissions budgets for electric generating units in the PJM states, excluding North Carolina and the District of Columbia.

On March 15, 2023, the EPA finalized Federal Implementation Plan (FIP) requirements for 23 states that addresses the contribution of those states to problems in other states in attaining and maintaining the 2015 Ozone NAAQS.<sup>39</sup> The FIP, also known as the Good Neighbor Plan, resolves the CAA good neighbor obligations of the affected states and applies when no state implementation plan has been approved. The FIP requirements establish ozone season NO<sub>x</sub> emissions budgets for electric generating units in the following PJM states: Illinois, Indiana, Kentucky, Maryland, Michigan, New Jersey, Ohio, Pennsylvania, Virginia and West Virginia. The list of PJM jurisdictions excludes North Carolina, the District of Columbia, Tennessee and Delaware. Electric generating units in the indicated states would be required to participate in a revised version of the CSAPR NO<sub>x</sub> Ozone Season Group 3 Trading Program that was previously established in the 2021 CSAPR Update.

The EPA’s emissions budgets for each PJM state for each ozone season for 2023 through 2029, and beyond are shown in Table 8-1.

31 *Id.* at 38518.

32 *Id.* at 38526.

33 See *National Emission Standards for Hazardous Air Pollutants: Coal- and Oil-Fired Electric Utility Steam Generating Units—Revocation of the 2020 Reconsideration, and Affirmation of the Appropriate and Necessary Supplemental Finding*, Final Action, EPA-HQ-OAR-2018-0794, 88 Fed. Reg. 13956 (March 6, 2023).

34 See *National Emission Standards for Hazardous Air Pollutants: Coal- and Oil-Fired Electric Utility Steam Generating Units—Reconsideration of Supplemental Finding and Residual Risk and Technology Review*, Docket No. EPA-HQ-OAR-2018-0794, 85 Fed. Reg. 31286 (May 22, 2020).

35 The particulate matter (PM) regulated under the CAA is classified as either PM<sub>10</sub>, which refers to PM less than 10 microns, and PM<sub>2.5</sub>, which refers PM less than 2.5 microns. PM<sub>2.5</sub> is referred to as fine particulate matter and poses the greatest risk to health. Examples of PM<sub>2.5</sub> include combustion particles, metals, and organic compounds.

36 *Wisconsin v. EPA*, 938 F.3d 303, 318–20 (D.C. Cir. 2019).

37 *Revised Cross-State Air Pollution Rule Update for the 2008 Ozone NAAQS*, Docket No. EPA-HQ-OAR-2020-0272; FRL-10013-42–OAR, 85 Fed. Reg. 23054 (Apr. 30, 2021).

38 See *Federal Implementation Plan Addressing Regional Ozone Transport for the 2015 Ozone National Ambient Air Quality Standard*, Docket No. EPA-HQ-OAR-2021-0668; FRL 8670-01–OAR, 87 Fed. Reg. 20036 (April 6, 2022).

39 See *Federal “Good Neighbor Plan” for the 2015 Ozone National Ambient Air Quality*, Final Rule, EPA-HQ-OAR-2021-0668.

**Table 8-1 CSAPR NO<sub>x</sub> ozone season group 3 state budgets: 2023 through 2029<sup>40</sup>**

PJM State	Emissions Budget (Tons)						
	2023	2024	2025	2026	2027	2028	2029
Illinois	7,474	7,325	7,325	5,889*	5,363*	4,555*	4,050*
Indiana	12,440	11,413	11,413	8,410*	8,135*	7,280*	5,808*
Kentucky	13,601	12,999	12,472	10,190*	7,908*	7,837*	7,392*
Maryland	1,206	1,206	1,206	842*	842*	842*	842*
Michigan	10,727	10,275	10,275	6,743*	5,691*	5,691*	4,656*
New Jersey	773	773	773	773*	773*	773*	773*
Ohio	9,110	7,929	7,929	7,929*	7,929*	6,911*	6,409*
Pennsylvania	8,138	8,138	8,138	7,512*	7,158*	7,158*	4,828*
Virginia	3,143	2,756	2,756	2,565*	2,373*	2,373*	1,951*
West Virginia	13,791	11,958	11,958	10,818*	9,678*	9,678*	9,678*

\*The budget for these years will be subsequently determined and equal the greater of the value above or that derived from the dynamic budget methodology.


On February 7, 2024, the EPA issued a final rule reducing the primary annual PM<sub>2.5</sub> standard to 9.0 µg/m<sup>3</sup> from 12.0 µg/m<sup>3</sup>.<sup>41</sup> The rule does not change other PM<sub>2.5</sub> standards. The proposal responds to the directive in Executive Order 13990 for review of a 2020 Particulate Matter NAAQS Decision that left PM<sub>2.5</sub> standards unchanged.

On June 27, 2024, the Supreme Court of the United States granted a stay of the FIP and therefore the EPA's enforcement of CSAPR pending judicial review.<sup>42</sup> The effect of the stay is to eliminate the ozone season NO<sub>x</sub> emissions budgets for electric generating units in the PJM states. Unless and until the stay is lifted, no federal implementation plan is effective in PJM states and the emissions budgets described in Table 8-1 are not effective. The EPA had previously rejected all proposed state implementation plans for PJM states.

Figure 8-1 shows average, monthly settled prices for NO<sub>x</sub> and SO<sub>2</sub> emissions allowances including CSAPR related allowances for 2020 through 2024. Figure 8-1 also shows the average, monthly settled price for the Regional Greenhouse Gas Initiative (RGGI) CO<sub>2</sub> allowances.

The RGGI CO<sub>2</sub> allowance price averaged \$20.96 in 2024, a 54.2 percent increase in comparison with the average price for 2023. The CSAPR annual NO<sub>x</sub> allowance price averaged \$3.39 in 2024, a 69.3 percent increase in comparison with the average price for 2023. The group 2 CSAPR Seasonal NO<sub>x</sub> allowance price averaged \$875.44 in 2024, a 33.4 percent decrease in comparison with the

average price for 2023.<sup>43</sup> The group 3 CSAPR Seasonal NO<sub>x</sub> allowance price averaged \$949.56 in 2024, an 87.9 percent decrease in comparison to the average price for 2023.<sup>44</sup> The components of real-time LMP analysis shows that NO<sub>x</sub> cost contributed \$0.09 to the load-weighted average real-time LMP in 2024, compared to \$0.51 in 2023.<sup>45</sup> CO<sub>2</sub> cost (RGGI) contributed \$1.94 to the load-weighted average real-time LMP in 2024, compared to \$1.93 in 2023.<sup>46</sup>

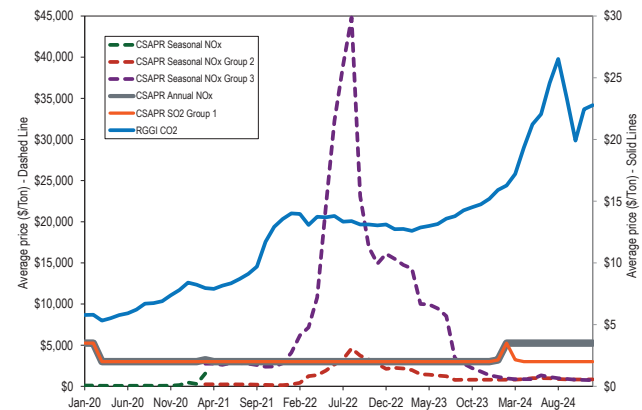**Figure 8-1 Spot monthly average emission price comparison: 2024**

## CAA: NSR

The CAA's NSR program is a preconstruction permitting program that requires certain stationary sources of air pollution to obtain permits prior to beginning construction. Parts C and D of Title I of the CAA provide for New Source Review (NSR) in order to prevent new projects and projects receiving major modifications from increasing emissions in areas currently meeting NAAQS or from inhibiting progress in areas that do not.<sup>47</sup> NSR requires permits before construction commences. In PJM, permits are issued by state environmental regulators, or in a process involving state and regional EPA regulators.<sup>48</sup>

NSR review applies a two part analysis to projects at facilities such as power plants, some of which involve

<sup>40</sup> Id. at 35 (Table I.B-1).

<sup>41</sup> See *Reconsideration of the National Ambient Air Quality Standards for Particulate Matter*, Proposed Rule, Docket No. EPA-HQ-OAR-2015-0072; FRL-8635-01- OAR, 89 Fed. Reg. 16202 (March 6, 2024).

<sup>42</sup> Ohio v. EPA, Slip Op. No. 23A349. (S. Ct. June 27, 2024).

<sup>43</sup> Tennessee is the only PJM state that remains in the CSAPR NO<sub>x</sub> Ozone Season Group 2 Trading Program.

<sup>44</sup> Illinois, Indiana, Kentucky, Maryland, Michigan, New Jersey, Ohio, Pennsylvania, Virginia, and West Virginia participate in the CSAPR NO<sub>x</sub> Ozone Season Group 3 Trading Program.

<sup>45</sup> See Components of LMP in 2024 *Annual State of the Market Report for PJM*, Volume 2, Section 3: Energy Market.

<sup>46</sup> Id.

<sup>47</sup> 42 U.S.C. § 7470 et seq.

<sup>48</sup> CAA permitting in EPA Region 2 (New Jersey) is the responsibility of the state's environmental regulatory authority; CAA permitting in Region 3 (Delaware, District of Columbia, Maryland, Pennsylvania, Virginia, West Virginia) is the shared responsibility of each state's environmental regulatory authority and EPA Region 3; CAA permitting in Region 4 (Kentucky and North Carolina) is the shared responsibility of each state's environmental regulatory authority and EPA Region 4; CAA permitting in EPA Region 5 (Illinois, Indiana, Michigan and Ohio) is the responsibility of each state's environmental regulatory authority.

multiple units and combinations of new and existing units.<sup>49</sup> The first part considers whether a modification would cause a significant emission increase of a regulated NSR pollutant. The second part considers whether any identified increase is also a significant net emission increase.<sup>50</sup>

## CAA: RICE

On January 14, 2013, the EPA signed a final rule amending its rules regulating emissions from a wide variety of stationary reciprocating internal combustion engines (RICE). RICE include certain types of electrical generation facilities like diesel engines typically used for backup, emergency or supplemental power, including facilities located behind the meter. These rules include: National Emission Standard for Hazardous Air Pollutants (NESHAP) for Reciprocating Internal Combustion Engines (RICE); New Source Performance Standards (NSPS) of Performance for Stationary Spark Ignition Internal Combustion Engines; and Standards of Performance for Stationary Compression Ignition Internal Combustion Engines (collectively RICE Rules). The RICE Rules apply to emissions such as formaldehyde, acrolein, acetaldehyde, methanol, CO, NO<sub>x</sub>, volatile organic compounds (VOCs) and PM.

EPA regulations require that RICE that do not meet the EPA emissions standards (stationary emergency RICE) may operate for only 100 hours per year and only to provide emergency DR during an Energy Emergency Alert 2 (EEA2), or if there are five percent voltage/frequency deviations.<sup>51</sup> Under PJM rules, an EEA2 is automatically triggered when PJM initiates an emergency load response event. Demand resources that rely on RICE to provide load reductions are constrained to a maximum of 100 hours.

PJM does not prevent emergency stationary RICE that does not meet emissions standards from participating in PJM markets as DR. Some emergency stationary RICE that does not meet emissions standards are now included in DR portfolios. Some DR registrations reflect a participant's reliance on behind the meter generation having environmental restrictions that limit the resource's ability to operate only in emergency conditions. PJM's DRHUB does not explicitly identify RICE generators, only whether it is an internal

combustion engine. Emergency stationary RICE should be prohibited from participation as DR either when registered individually or as part of a portfolio if it does not meet emissions standards. Emergency RICE with a limit of 100 hours per year cannot comply with the requirement to be available during the entire delivery year to be a capacity resource. PJM should not allow locations that rely upon emergency stationary RICE to register individually or in portfolios. Registration of DR should be based on a finding that registered locations are capable of providing load reductions without an hourly limit. Reliance on the prospect of penalties to deter registration of ineligible resources as DR in lieu of a substantive ex ante review is not appropriate. The MMU recommends that emergency stationary RICE be prohibited from participation as DR either when registered individually or as part of a portfolio if it cannot meet the capacity market requirements to be DR as a result of emissions standards that impose environmental run hour limitations.

## CAA: Greenhouse Gas Emissions

The EPA regulates CO<sub>2</sub> as a pollutant using CAA provisions that apply to pollutants not subject to NAAQS.<sup>52 53</sup>

Executive Order 14057 requires the federal government to achieve "100 percent carbon pollution-free electricity on a net annual basis by 2030, including 50 percent 24/7 carbon pollution-free electricity by 2030."<sup>54</sup>

On April 25, 2024, the EPA finalized a rule taking four actions under CAA § 111(a)(1) addressing greenhouse gas (GHG) emissions from fossil fuel-fired electric generating units (EGUs) ("Carbon Emissions Rule").<sup>55</sup> The Carbon Emissions Rule repeals the Affordable Clean Energy (ACE) Rule; finalizes emission guidelines for GHG emissions from existing coal fired and oil/gas

<sup>52</sup> See CAA § 111.

<sup>53</sup> On April 2, 2007, the U.S. Supreme Court overruled the EPA's determination that it was not authorized to regulate greenhouse gas emissions under the CAA and remanded the matter to the EPA to determine whether greenhouse gases endanger public health and welfare. *Massachusetts v. EPA*, 549 U.S. 497. On December 7, 2009, the EPA determined that greenhouse gases, including carbon dioxide, methane, nitrous oxide, hydrofluorocarbons, perfluorocarbons, and sulfur hexafluoride, endanger public health and welfare. See *Endangerment and Cause or Contribute Findings for Greenhouse Gases Under Section 202(a) of the Clean Air Act*, 74 Fed. Reg. 66496, 66497 (Dec. 15, 2009). In a decision dated June 26, 2012, the U.S. Court of Appeals for the D.C. Circuit upheld the endangerment finding, rejecting challenges brought by industry groups and a number of states. *Coalition for Responsible Regulation, Inc., et al. v. EPA*, No 09-1322.

<sup>54</sup> See Executive Order on Catalyzing Clean Energy Industries and Jobs Through Federal Sustainability, Section 102(a)(i), Executive Order 14057 (December 8, 2021), <[https://www.whitehouse.gov/briefing-room/presidential-actions/2021/12/08/executive-order-on-catalyzing-clean-energy-industries-and-jobs-through-federal-sustainability/?utm\\_medium=email&utm\\_source=govDelivery](https://www.whitehouse.gov/briefing-room/presidential-actions/2021/12/08/executive-order-on-catalyzing-clean-energy-industries-and-jobs-through-federal-sustainability/?utm_medium=email&utm_source=govDelivery)>.

<sup>55</sup> See *New Source Performance Standards for Greenhouse Gas Emissions From New, Modified, and Reconstructed Fossil Fuel-Fired Electric Generating Units; Emission Guidelines for Greenhouse Gas Emissions From Existing Fossil Fuel-Fired Electric Generating Units; and Repeal of the Affordable Clean Energy Rule*, Proposed Rule, Docket No. EPA-HQ-OAR-2023-0072, 89 Fed. Reg. 39798 (May 9, 2024) ("Carbon Emissions Rule").

<sup>49</sup> 40 CFR § 52.21.

<sup>50</sup> *Id.*

<sup>51</sup> Emergency Operations, EOP-011-1, North American Electric Reliability Corporation, <<https://www.nerc.com/pa/Stand/Reliability%20Standards/EOP-011-1.pdf>> (Accessed March 2, 2020).

fired steam generating EGUs; revises the New Source Performance Standards (NSPS) for GHG emissions from new and reconstructed fossil fuel-fired stationary combustion turbine EGUs; and revises the NSPS for GHG emissions from fossil fuel-fired steam generating units that undertake a large modification, based upon the 8-year review required by the CAA. The rule deferred action on emission guidelines for GHG emissions from existing fossil fuel-fired stationary combustion turbines.

The Carbon Emissions Rule creates subcategories of combustion turbines by capacity factor. For new combustion turbines, the final rule establishes three subcategories based on capacity factor. New base load turbines (greater than 40 percent capacity factor) are subject to an initial phase one standard based on efficient design and operation of combined cycle turbines; and a phase two standard based on 90 percent capture of CO<sub>2</sub> with a compliance deadline of January 1, 2032. New intermediate load turbines (20–40 percent capacity factor) are subject to a standard based on efficient design and operation of simple cycle turbines. New low load turbines (less than 20 percent capacity factor) are subject to a standard based on low-emitting fuel.<sup>56</sup>

For existing coal-fired units, the Carbon Emissions Rule establishes subcategories based on continued operation past defined dates. Units that intend to operate on or after January 1, 2039, will have an emission rate limit based on application of carbon capture and sequestration/storage (CCS) with 90 percent capture, which they must meet on January 1, 2032. Units that have committed to cease operations by January 1, 2039, will have an emission rate limit based on 40 percent natural gas co-firing that they must meet on January 1, 2030. Units that demonstrate that they plan to permanently cease operation prior to January 1, 2032, will have no emission reduction obligations under the rule. The rule provides states the ability to provide a variance for individual existing units based on consideration of remaining useful life and other factors. The rule defines a required process, under which states have two years to submit plans to the EPA for review and approval. States may incorporate certain reliability related mechanisms into their plans: a short term reliability mechanism for units responding to declared grid emergencies, and a

reliability assurance mechanism for units needed operate after the desired deactivation date.

On May 9, 2024, a coalition of PJM states including West Virginia, Indiana, Kentucky, Tennessee, Virginia, and 20 other states, filed a petition for review of the Carbon Emissions Rule by the United States Court of Appeals for the D.C. Circuit.<sup>57</sup> PJM joined other RTOs to file an amicus brief in support of petitioners, arguing that the result would result in premature retirements of fossil generation and threaten reliability.<sup>58</sup> The states also sought to stay implementation of the rule, but the motion for stay was denied by the U.S. Supreme Court by order issued October 4, 2024.<sup>59</sup> The petition remains pending at the D.C. Circuit.

On August 8, 2016, the U.S. Court of Appeals for the Seventh Circuit determined that a government agency can reasonably consider the global benefits of carbon emissions reduction against costs imposed in the U.S. by regulations in analyses known as the “Social Costs of Carbon.”<sup>60</sup> The Court rejected claims raised by petitioners that raised concerns that the Social Cost of Carbon estimates were arbitrary, were not developed through transparent processes, and were based on inputs that were not peer reviewed.<sup>61</sup> Although the decision applies only to the Department of Energy’s regulations of manufacturers, it bolsters the ability of the EPA and state regulators to rely on Social Cost of Carbon analyses.

Executive Order 13990, Section 6, established an Interagency Working Group (IWG) on the Social Cost of Greenhouse Gases. The group developed estimates for the social cost of carbon (SCC), the social cost of nitrous oxide (SCN), and the social cost of methane (SCM). The cost estimates will be used by the EPA and other agencies to determine the social benefits of reducing greenhouse gas emissions when conducting cost-benefit analyses of regulatory and other actions. On July 27, 2022, the U.S. District Court for the Western District of Louisiana enjoined reliance on the IWG’s SCC estimates.<sup>62</sup> On April 3, 2023, the U.S. Court of Appeals for the Fifth Circuit dismissed the challenge for lack of standing and vacated the injunction, explaining that agencies’ use of

<sup>56</sup> Carbon Emissions Rule states (at 435 Et n.733): “For owners/operators of combustion turbines the lower emitting fuels requirement is defined to include fuels with an emissions rate of 160 lb CO<sub>2</sub>/MMBtu or less. For owners/operators of steam generating units or IGCC facilities the EPA is requiring the use of the maximum amount of non-coal fuels available to the affected facility.”

<sup>57</sup> See *West Virginia, et al. v. EPA*, No. 24–1120, et al. (D.C. Circuit) at 1.

<sup>58</sup> See Motion for Leave to File Brief of Midcontinent Independent System Operator, Inc., PJM Interconnection LLC, Southwest Power Pool, Inc., and Electric Reliability Council of Texas, Inc., as Amicus Curiae in Support of Petitioners, No. 24–1120, et al. (D.C. Circuit September 13, 2024).

<sup>59</sup> See *West Virginia, et al. v. EPA*, No. 24A95, et al.

<sup>60</sup> See *Zero Zone, Inc., et al., v. U.S. Dept. of Energy, et al.*, Case Nos. 14–2147, et al., Slip Op.

<sup>61</sup> *Id.*

<sup>62</sup> See *Louisiana v. Biden*, Order, Civ. No. 2:21-CV-1074-JDC-KK (July 27, 2022).



the estimates is discretionary and the alleged harms are conjectural.<sup>63</sup>

In a final rule issued in December 2023, EPA set the value for the SCC at \$190 per ton.<sup>64</sup>

## CWA: WOTUS Definition

The Clean Water Act (CWA) applies to navigable waters, which are defined as waters of the United States (WOTUS).<sup>65</sup> <sup>66</sup> The definition of WOTUS is a threshold issue that determines the hydrological scope of the CWA's applicability. Over the past decade, attempts to define WOTUS have been repeatedly addressed by the Courts, and no durable definition has resulted.<sup>67</sup> Establishing a durable definition is important to the electric industry, which needs to plan for compliance with the CWA and related regulations.

The scope of the CWA expanded as a result of an April 23, 2020, decision of the U.S. Supreme Court in *County of Maui v. Hawaii Wildlife Fund*, which held that the discharge of pollutants via groundwater requires a CWA permit.<sup>68</sup> Groundwater is not itself WOTUS. However, if pollutants pass through groundwater from a point source to WOTUS, a permit may be required.<sup>69</sup> The Court held that discharge into groundwater "is the functional equivalent of a direct discharge."<sup>70</sup> The existence of a functional discharge will depend on an analysis including time and distance, and other factors.<sup>71</sup> Additional litigation or administrative action may clarify the functional discharge analysis.<sup>72</sup> *County of Maui* reduces the importance of the precise definition of WOTUS because WOTUS is generally part of the watershed.<sup>73</sup>

63 See *Louisiana v. Biden*, Case No. 2:21-CV-1074, slip. op. (5<sup>th</sup> Cir. April 3, 2023) at 8–15.

64 See *Standards of Performance for New, Reconstructed, and Modified Sources and Emissions Guidelines for Existing Sources: Oil and Natural Gas Sector Climate Review*, EPA Docket No. EPA-HQ-OAR-2021-0317, 89 Fed. Reg. 16820 (March 8, 2024).

65 33 U.S.C. 1251 et seq.; 33 U.S.C. § 1362(7) ("The term 'navigable waters' means the waters of the United States, including the territorial seas.").

66 For more details, see the *2019 Annual State of the Market Report for PJM*, Volume 2, Appendix H: "Environmental and Renewable Energy Regulations."

67 See, e.g., *Rapanos v. U.S.*, 547 U.S. 715 (2006); *Solid Waste Agency of Northern Cook County v. U.S. Army Corps of Engineers*, 531 U.S. 159 (2001); *U.S. v. Riverside Bayview Homes, Inc.*, 474 U.S. 121 (1985).

68 590 U.S. 165 (April 23, 2020).

69 *Id.*

70 *Id.* at 1.

71 *Id.* at 16 ("The difficulty with this approach, we recognize, is that it does not, on its own, clearly explain how to deal with middle instances. But there are too many potentially relevant factors applicable to factually different cases for this Court now to use more specific language. Consider, for example, just some of the factors that may prove relevant (depending upon the circumstances of a particular case): (1) transit time, (2) distance traveled, (3) the nature of the material through which the pollutant travels, (4) the extent to which the pollutant is diluted or chemically changed as it travels, (5) the amount of pollutant entering the navigable waters relative to the amount of the pollutant that leaves the point source, (6) the manner by or area in which the pollutant enters the navigable waters, (7) the degree to which the pollution (at that point) has maintained its specific identity. Time and distance will be the most important factors in most cases, but not necessarily every case.").

72 *Id.*

73 See *id.* at 5 ("Virtually all water, polluted or not, eventually makes its way to navigable water. This is just as true for groundwater.").

On December 30, 2022, the EPA and the Army Corps of Engineers announced a final rule revising the definition of WOTUS.<sup>74</sup> The Rule defines WOTUS to include: (i) traditional navigable waters, the territorial seas, and interstate waters; (ii) impoundments of WOTUS; (iii) tributaries to traditional navigable waters, the territorial seas, interstate waters, impoundments when the tributaries meet either the relatively permanent standard or the significant nexus standard; (iv) wetlands, including jurisdictional adjacent wetlands; and (v) intrastate lakes and ponds, streams, or wetlands that meet either the relatively permanent standard or the significant nexus standard.<sup>75</sup> The rule became effective on March 20, 2023, except that, due to preliminary injunctions issued in court proceedings challenging the rule, the rule did not become effective in 26 states, including PJM states Indiana, Ohio, Tennessee, Virginia, West Virginia, and Kentucky.

On May 25, 2023, a decision of U.S. Supreme Court held that "jurisdiction over an adjacent wetland under the CWA" requires "first, ... a relatively permanent body of water connected to traditional interstate navigable waters ... and second, that the wetland has a continuous surface connection with that water, making it difficult to determine where the 'water' ends and the 'wetland' begins."<sup>76</sup> The Court's definition of adjacent wetlands significantly reduced the range of waters meeting that definition compared to the range covered in the December 30, 2022 rule.

On August 29, 2023, the EPA issued a final rule modifying its 2022 rule to define adjacent wetlands consistent with the Supreme Court holding, and it became effective on September 8, 2023.<sup>77</sup>

## CWA: Effluents

The EPA regulates under its National Pollutant Discharge Elimination System (NPDES) permitting authority discharges from and intakes to power plants, including water cooling systems at steam electric power generating stations, under the CWA.<sup>78</sup> The regulations, Effluent Limitations Guidelines and Standards (ELGs), are national industry-specific wastewater regulations

74 See *Revised Definition of "Waters of the United States,"* Final Rule, Docket No. EPA-HQ-OW-2021-0602; FRL-6027.4-01-OW, 88 Fed. Reg. 3004 (January 18, 2023).

75 See *id.* at 3005–6.

76 See *Sackett v. EPA*, Slip Op. 21–454.

77 See *Revised Definition of "Waters of the United States [Conforming],"* Final Rule, Docket No. EPA-HQ-OW-2023-0346; FRL-11132-01-OW, 88 Fed. Reg. 61964 (September 8, 2023).

78 See 40 CFR Part 423. For more details, see the *2019 Annual State of the Market Report for PJM*, Volume 2, Appendix H: "Environmental and Renewable Energy Regulations."



based on the performance of demonstrated wastewater treatment technologies.

On June 9, 2022, the EPA proposed the Water Quality Certification Improvement Rule (WQCIR), which would expand the grounds on which states may condition or block, projects in federal permit proceedings.<sup>79</sup> The WQCIR would provide each state certifying agency a role in determining the “reasonable period of time” to review the request and encourage their adoption of an “activity as a whole” analytical approach that would consider the impacts of the entire project rather than just the specific discharge needing certification.<sup>80</sup>

The EPA has been implementing ELGs established in its 2015 and 2020 rules.<sup>81 82</sup> The 2015 Rule established limitations and standards applicable to discharges from steam electric generating units from bottom ash (BA) transport water, flue gas desulfurization (FGD) wastewater, fly ash (FA) transport water, flue gas mercury control wastewater, gasification wastewater, combustion residual leachate, and non chemical metal cleaning wastes. The 2020 Rule revised the limitations and standards for BA transport water and FGD wastewater, leaving the other limitations and standards in place. The 2020 Rule applied less stringent effluent limits to three new subcategories of units: High FGD flow plants, low utilization generating units, and generating units that will permanently cease the combustion of coal by 2028.

Units subject to the generally applicable limits had to comply with the 2020 Rule as soon as possible on or after October 13, 2021, but no later than December 31, 2025.<sup>83</sup>

Plants are required to inform regulators of their plans to comply with the new rule by upgrading their plants with pollution control equipment or committing to retiring their units by 2028.<sup>84</sup>

Executive Order 13990 called for review and improvement of the 2020 Rule.

On April 25, 2024, pursuant to CWA, the EPA issued a rule strengthening the 2015 and 2020 ELGs for coal-

fired power plants (“2024 Effluents Rule”).<sup>85</sup> The 2024 Effluents Rule would reduce discharges by an estimated 660–672 million pounds per year, including toxic and bioaccumulative pollutants, such as arsenic, lead, mercury, selenium, chromium, and cadmium.<sup>86</sup>

This 2024 Effluents Rule establishes a zero discharge of pollutants limitation for three wastewaters generated at coal-fired power plants: flue gas desulfurization wastewater, bottom ash transport water, and combustion residual leachate.<sup>87</sup> The regulation also establishes numeric discharge limitations for mercury and arsenic for combustion residual leachate (CRL) that is discharged through groundwater and for a fourth wastestream, called legacy wastewater, that is discharged from certain surface impoundments.<sup>88</sup> The regulation also eliminates less stringent requirements for two subcategories of facilities (high flow facilities and low utilization energy generating units) that were contained in the 2020 regulation.<sup>89</sup>

The 2024 Effluents Rule allows additional time for compliance for some plants that have installed, or are in the process of installing, additional treatment technologies to meet the 2015 and 2020 ELGs.<sup>90</sup> The rule allows some plants to continue to meet the 2015 and 2020 ELGs while they are in the process of closing and converting to use other fuels such as natural gas.<sup>91</sup>

## RCRA: Coal Ash

The EPA administers the Resource Conservation and Recovery Act (RCRA), which governs the disposal of solid and hazardous waste.<sup>92</sup> Solid waste is regulated under subtitle D. Subtitle D criteria are not directly enforced by the EPA. Subtitle C governs the disposal of hazardous waste. Hazardous waste is subject to direct regulatory control by the EPA from the time it is generated until its ultimate disposal.

On April 17 2015, the EPA published a rule under Subtitle D of RCRA, the Coal Combustion Residuals rule (2015 CCRR), which sets criteria for the disposal of coal combustion residues (CCRs), or coal ash, produced by

<sup>79</sup> See *Clean Water Act Section 401 Water Quality Certification Improvement Rule*, Proposed Rule, 87 Fed. Reg. 35318 (June 9, 2022).

<sup>80</sup> *Id.* at 35343–35349.

<sup>81</sup> See *Effluent Limitations Guidelines and Standards for the Steam Electric Power Generating Point Source Category*, Docket No. EPA–HQ–OW–2009–0819; FRL–9930–48–OW, 80 Fed. Reg. 67838 (November 3, 2015).

<sup>82</sup> See *Steam Electric Reconsideration Rule*, Docket No. EPA–HQ–OW–2009–0819; FRL–10014–41–OW, 85 Fed. Reg. 64650 (October 13, 2020).

<sup>83</sup> *Id.* at 64652.

<sup>84</sup> 85 Fed. Reg. 64650, 64679–82; 88 Fed. Reg. 18440 (March 29, 2023); 40 CFR § 423.19(f)(1).

<sup>85</sup> See *Supplemental Effluent Limitations Guidelines and Standards for the Steam Electric Power Generating Point Source Category*, EPA Docket No. EPA–HQ–OW–2009–0819; FRL–8794–01–OW, Final Rule, 89 Fed. Reg. 40198 (May 9, 2024) (“2024 Effluents Rule”); CWA §§ 301, 304, 306, 307, 308, 402 & 501.

<sup>86</sup> *Id.* at 40198, 40203.

<sup>87</sup> *Id.* at 40198.

<sup>88</sup> *Id.* at 40252.

<sup>89</sup> *Id.* at 40200.

<sup>90</sup> *Id.*

<sup>91</sup> *Id.* at 40246.

<sup>92</sup> 42 U.S.C. §§ 6901 *et seq.*

electric utilities and independent power producers.<sup>93</sup> CCRs include fly ash (trapped by air filters), bottom ash (scooped out of boilers) and scrubber sludge (filtered using wet limestone scrubbers). These residues are typically stored on site in ponds (surface impoundments) or sent to landfills.

In 2016, RCRA was amended to establish a permitting scheme allowing states to apply to the EPA for approval to operate a permit program that implements the CCR rule. Such state programs could include alternative state standards, provided that the EPA determines that they are “at least as protective as” the EPA CCR regulations.<sup>94</sup>

Effective August 9, 2018, the EPA approved certain revisions to the 2015 CCRR (“2018 CCRR Revisions”) partly in response to the 2016 amendments.<sup>95</sup>

The 2018 CCRR Revisions provide for two types of alternative performance standards. The first type of standards allows a state director (if a state has an EPA approved CCR permit program) or the EPA (if no state program) to suspend groundwater monitoring requirements if there is evidence that there is no potential for migration of hazardous constituents to the uppermost aquifer during the active life of the unit and during post closure care. The second type allows issuance of technical certifications by a state director in lieu of a professional engineer.

The 2018 CCRR Revisions revised the groundwater protection standards for health-based levels for four contaminants: cobalt at 6 mg/L; lithium at 40 mg/L; molybdenum at 100 mg/L and lead at 15 mg/L. Standards for other monitored contaminants follow the Maximum Contaminant Level (MCL) established under the Safe Water Drinking Act.

The 2018 CCRR Revisions extended the deadline for closing coal ash units in two situations: (i) detection of a statistically significant increase above a groundwater protection standard from an unlined surface impoundment; or (ii) inability to comply with the location restriction regarding placement above the uppermost aquifer. The exceptions in the 2018 CCRR to the standards in the 2015 CCRR and relaxation of the deadlines create a less stringent federal rule.

93 See *Hazardous and Solid Waste Management System: Disposal of Coal Combustion Residuals from Electric Utilities*, 80 Fed. Reg. 21302 (April 17, 2015).

94 The Water Infrastructure Improvements for the Nation Act (WIIN Act).

95 See *Hazardous and Solid Waste Management System: Disposal of Coal Combustion Residuals from Electric Utilities; Amendments to the National Minimum Criteria (Phase One, Part One)*, EPA Docket No. EPA-HQ-OLEM-2017-0286, 83 Fed. Reg. 36435 (July 30, 2018).

The U.S. Court of Appeals for the D.C. Circuit invalidated certain provisions of the 2015 CCRR and remanded it to the EPA.<sup>96</sup>

On July 29, 2020, the EPA finalized revisions to the CCR rule in compliance with the court orders (“Revised CCRR”).<sup>97</sup> The Revised CCRR requires (i) unlined surface impoundments (ponds) and ponds failing restrictions on the minimum depth to or interaction with an aquifer to cease receiving waste as soon as technically feasible and no later than April 11, 2021; and (ii) removal of compacted soil lined and clay lined ponds from classification as lined and exempt from CCRR.<sup>98</sup>

In response to the RCRA amendments, the EPA proposed a new rule to implement a federal CCR permit program in nonparticipating states, noticed February 20, 2020.<sup>99</sup> This proposal includes requirements for federal CCR permit applications, content and modification, as well as procedural requirements. The EPA would implement this permit program at CCR units located in states that have not submitted their own CCR permit program for approval. No PJM state has yet applied for EPA approval of its own CCR permit program.

## State Environmental Regulation

### State Coal Ash Regulations

In Virginia, the Waste Management Board amended the Virginia Solid Waste Management Regulations in December 2015, to incorporate the EPA’s 2015 CCRR, and did not adopt the less stringent 2018 CCRR Revisions. On July 1, 2019, Virginia enacted legislation directing the closure of coal ash ponds located in the Chesapeake Bay Watershed and owned by Dominion Energy.<sup>100</sup> Dominion is developing plans to remove coal ash ponds at power stations in the Chesapeake Bay Watershed. The removed coal ash must be recycled (at least 6.8 million cubic yards) or disposed of in a modern, lined landfill. The Virginia DEQ is addressing closing ash ponds under two types of environmental permits: wastewater discharge permits covering the removal of treated water from the ponds; or solid waste permits covering the permanent closure of the ponds.

96 *Utility Solid Waste Activities Group, et al. v. EPA*, 901 F.3d 414 (D.C. Cir. August 21, 2018); *Waterkeeper Alliance Inc. et al. v. EPA*, No. 18–1289 (D.C. Cir. March 13, 2019).

97 See *Hazardous and Solid Waste Management System: Disposal of Coal Combustion Residuals from Electric Utilities; A Holistic Approach to Closure Part A: Deadline To Initiate Closure*, EPA–HQ–OLEM–2019–0172; FRL–10002–02–OLEM, 85 Fed. Reg. 53516 (August 28, 2020).

98 *Id.* at 53516–53517, 53536.

99 See *Hazardous and Solid Waste Management System: Disposal of Coal Combustion Residuals from Electric Utilities; Federal CCR Permit Program*, EPA–HQ–OLEM–2019–0361, 85 Fed. Reg. 9940 (February 20, 2020).

100 Va. Code § 10.1-1402.03.

Table 8-2 shows the compliance status of affected units with Virginia Solid Waste Management Regulations:<sup>101</sup>

**Table 8-2 Compliance status of affected units with Virginia Solid Waste Management Regulations**

Plant	CCR Compliance Status
Bremo Bluff Power Station	As of April 2020, ash has been removed from the East and West Ponds. Plans for closure by removal of ash from the remaining North Pond impoundment are under development and will be addressed by the Virginia DEQ in a separate future permitting action.
Chesapeake Energy Center	The facility is currently developing plans for closure by removal of ash from the landfill, historical area, and impoundment.
Chesterfield Power Station	Dominion Energy Virginia submitted the required solid waste permit application for closure by removal and groundwater monitoring of the Upper and Lower Ash Ponds in February 2020, and it is currently under review. The application outlines the removal of ash to either an offsite permitted landfill or offsite beneficial reuse. The application estimates that it will take approximately 13 years to complete closure by removal activities.
Clinch River Power Station	The ash pond was closed and capped prior to January 1, 2019. Clinch River Plant ceased burning coal in 2015 and no longer produces CCR material. The Plant now uses natural gas as fuel. All units are currently being monitored and maintained in post-closure care.
Clover Power Station	The station also has had a permitted CCR landfill since 1993. The permit is currently under revision to incorporate EPA CCR Rule requirements applicable to existing landfills.
Possum Point	As of June 2019, ash has been removed from Ponds A, B, C, and E. Plans for closure by removal of ash from the remaining impoundment (Pond D) are under development. Closure by removal of Pond D will be addressed in a future and separate DEQ permitting action. DEQ issued a conditional approval of the Part A application in May 2024. Dominion will also need to submit Part B of the permit application. It is anticipated that they will submit by February 2025. In addition to a solid waste permit, Dominion will need an updated VPDES permit to address industrial stormwater discharges from the power plant, Pond D dewatering, and CCR impacted stormwater from the planned landfill construction activities. Additionally, a Virginia Water Protection (VWP) permit for wetland impacts due to the proposed landfill, and erosion and sediment (E&S) and stormwater construction general permit (SWCGP) from Prince William County will be required. DEQ is reviewing additional information related to a revised VPDES application for the reissuance of the existing discharge (water) permit. A draft permit and initiation of the public participation process will begin in 2025.

Effective April 21, 2021, in response to a statutory mandate,<sup>102</sup> the Illinois Environmental Protection Agency (Illinois EPA) promulgated rules for coal combustion residual surface impoundments with the Illinois Pollution Control Board.<sup>103</sup> The proposed rules contain standards for the storage and disposal of coal combustion residuals in surface impoundments. The rules include a permitting program intended to meet federal standards.<sup>104</sup> The Illinois EPA identified 73 coal combustion residuals surface impoundments at power stations, some lined with impermeable materials and some not.<sup>105</sup> The Illinois EPA believes that as many as six lined surface impoundments may comply with the federal liner standards.<sup>106</sup>

The North Carolina Department of Environmental Quality (NCDEQ) has initiated a rule making on rules for the disposal or recycling of coal combustion residuals. None of the affected power stations or power station impoundments are located in the PJM Dominion Zone (which includes a portion of northeast coastal North Carolina).

## State Emissions Regulations

States have in some cases enacted emissions regulations more stringent or potentially more stringent than federal requirements:<sup>107</sup>

- Illinois Climate and Equitable Jobs Act (CEJA). On September 16, 2021, the Climate and Equitable Jobs Act (CEJA) became law. CEJA created an expanded nuclear subsidy program. CEJA mandates that all fossil fuel plants close by 2045. CEJA established emissions caps for investor owned, gas-fired units with three years of operating history, effective October 1, 2021, on a rolling 12 month basis. The emissions caps are based on average emissions over a three year period from 2018 through 2020. The capped emissions are CO<sub>2</sub>e and co-pollutants.<sup>108</sup> New investor owned, gas fired units will have emissions caps after three years of operation. The resultant emissions caps are very low for some units and higher for others. More than 10,000 MW of capacity are currently affected, most of which have requested that the MMU calculate a unit specific opportunity cost. The MMU calculates opportunity costs for units that make requests and provide required data.

<sup>101</sup> Virginia Department of Environmental Quality website: <<https://www.deq.virginia.gov/permits/waste/coal-ash>>.

<sup>102</sup> Ill. Public Act 101-171 (a.k.a. SB 09).

<sup>103</sup> The proposed rule amends the Illinois Administrative Code to create a new Part 845 in Title 35.

<sup>104</sup> See *In the Matter of Standards for the Disposal of Coal Combustion Residuals in Surface Impoundments*, No. R 2020-019 (March 30, 2020) at 1 (Proposed New 35 Ill. Adm. Code 845).

<sup>105</sup> In the Matter of Standards for the Disposal of Coal Combustion Residuals in Surface Impoundments, No. R 2020-019 (March 30, 2020) at 3 (Proposed New 35 Ill. Adm. Code 845z0).

<sup>106</sup> *Id.*

<sup>107</sup> For more details, see the 2019 Annual State of the Market Report for PJM, Volume 2, Appendix H: "Environmental and Renewable Energy Regulations."

<sup>108</sup> Carbon dioxide equivalent (CO<sub>2</sub>e) emissions means the total emissions of six greenhouse gases (carbon dioxide, nitrous oxide, methane, hydrofluorocarbons, perfluorocarbons and sulfur hexafluoride). Co-pollutants mean the six criteria pollutants identified by the US EPA pursuant to the Clean Air Act: Carbon Monoxide, Lead, Nitrogen Dioxide, Ozone, Particle Pollution, and Sulfur Dioxide.

<sup>109</sup> See Energy Transition Act, Public Act 102-0662, Section 90-55, which amends section 9.15 (k-5) FOR the Illinois Environmental Protection Act.

CEJA includes provisions promoting the development of batteries and utility scale solar at the sites of up to five closed coal plants, two of which may be located in PJM. CEJA grants a subsidy of \$110,000/MW for battery projects with at least 37 MW of capacity, capped at \$28 million per year. A solar resource at a defined site may elect to receive either the battery subsidies or to sell premium RECs for \$30 each.

- **New Jersey HEDD.** Units that run only during peak demand periods have relatively low annual emissions, and have less reason to make investments in emissions reductions under the EPA transport rules. New Jersey addressed the issue of NO<sub>x</sub> emissions on peak energy demand days with a rule that defines peak energy usage days, referred to as high electric demand days or HEDD, and imposes operational restrictions and emissions control requirements on units responsible for significant NO<sub>x</sub> emissions on such high energy demand days. New Jersey's HEDD rule, which became effective May 19, 2009, applies to HEDD units, which include units that have a NO<sub>x</sub> emissions rate on HEDD equal to or exceeding 0.15 lbs/MMBtu and lack identified emission control technologies.
- **New Jersey Control and Prohibition of Carbon Dioxide Emissions.** On December 2, 2022, New Jersey implemented rules restricting new power plants to CO<sub>2</sub> emissions less 860 pounds per megawatt hour, and banning sales of No. 4 and No. 6 fuel oil.<sup>110</sup> The rule limits existing electric generating units to no more than 1,700 lbs of CO<sub>2</sub> per megawatt hour of the gross energy input, by January 1, 2024, to no more than 1,300 pounds per megawatt hour by 2027, and to no more than 1,000 pounds per megawatt hour by 2035.
- **Climate Solutions Now Act of 2022.** On April 8, 2022, Maryland enacted a requirement for reduction of statewide greenhouse gas emissions by 60 percent from 2006 levels by 2031 and net-zero emissions by 2045.<sup>111</sup>
- **Illinois Air Quality Standards (NO<sub>x</sub>, SO<sub>2</sub> and Hg).** The State of Illinois has promulgated its own standards for NO<sub>x</sub>, SO<sub>2</sub> and Hg (mercury) known as Multi-Pollutant Standards (MPS) and Combined Pollutants Standards (CPS). MPS and CPS establish standards that are more stringent and take effect earlier than comparable Federal regulations, such as the EPA's MATS.

Some states proposed legislation in 2024 designed to reduce or eliminate greenhouse gas and other emissions. The proposed legislation is summarized in Table 8-3.

**Table 8-3 Summary of proposed environmental regulatory activity affecting PJM resources by jurisdiction**

Jurisdiction	Bill/Docket No.	Environmental Regulatory Activity
Delaware		No current activity.
Illinois		No current activity.
Indiana		No current activity.
Kentucky		No current activity.
Maryland		No current activity.
Michigan		No current activity.
New Jersey	SB 222	2024-2025 Reg. Sess.: Bill would authorize regulation of greenhouse gas emissions under "Air Pollution Control Act (1954)" and "Global Warming Response Act."
	SB 220	2024-2025 Reg. Sess.: Bill would establish Nuclear Power Advisory Commission.
	SB 2816	2024-2025 Reg. Sess.: Requires electric public utilities to submit to BPU and to implement electric infrastructure improvement plans.
	SB 3308/AB 4513	2024-2025 Reg. Sess.: Requires electric public utilities to implement certain improvements to the interconnection process for certain grid supply solar facilities.
North Carolina		No current activity.
Ohio		No current activity.
Pennsylvania		No current activity.
Tennessee		No current activity.
Virginia	SB 557	2025 Reg. Sess.: Bill would provide that, for the purposes of the renewable energy portfolio standard, eligible sources include (i) hydrogen resources that are produced from zero-carbon generating facilities and (ii) zero-carbon nuclear generating facilities that were placed into service after July 1, 2024.
	HB 109	2025 Reg. Sess.: Requires each incumbent electric utility that is a member that is in an RTO to submit an annual report recording all votes cast by the utility or its affiliates and a brief description explaining how each such vote is in the public interest.
Washington, D.C.		No current activity.
West Virginia		No current activity.

<sup>110</sup> See N.J.A.C. 7:27F.

<sup>111</sup> See Maryland SB 528.

## Clean Energy Standards

- In April 2020, Virginia enacted the Virginia Clean Economy Act, which orders the closure of most coal generation in state by 2024, most fossil fuel generation by 2045, and adopts a 100 percent clean energy standard by 2045.<sup>112</sup> The legislation mandates Chesterfield Power Station Units 5 & 6 and Yorktown Power Station Unit 3 to be retired by the end of 2024, Altavista, Southampton and Hopewell to be retired by the end of 2028 and Virginia Power's remaining fossil fuel units to be retired by the end of 2045, unless the retirement of such generating units will compromise grid reliability or security.<sup>113</sup> The legislation also imposes a temporary moratorium on Certificates of Public Convenience and Necessity for fossil fuel generation, unless the resources are needed for grid reliability.<sup>114</sup>

## Opportunity Cost

PJM generators are subject to environmental constraints that limit generation. These constraints are specified in the operating permits issued by the jurisdictional environmental authority. Schedule 2 of the PJM Operating Agreement provides that the opportunity cost associated with the environmental constraints may be included in a generator's cost-based offer.<sup>115</sup> Opportunity cost associated with a physical equipment limitation or a fuel supply limitation, under certain circumstances, may also qualify for inclusion in the cost-based offer.<sup>116</sup>

More than 10,000 MW of capacity are currently affected by CEJA, most of which have requested that the MMU calculate a unit specific opportunity cost. The CEJA operating limits have resulted in significant opportunity cost adders to cost-based energy market offers for affected units. The CEJA opportunity cost adders are approximately four times, on average, the opportunity cost adders associated with the operating permit constraints.

The MMU calculates opportunity costs for units that make requests and provide required data. The MMU calculated opportunity cost adders for 175 generators in 2024. The calculations are generally done one time per week and the resulting opportunity cost is effective for a seven day period. More frequent calculations are

done in cases where the constraints are tight and the opportunity cost is expected to vary significantly from day to day.

## RGGI

The Regional Greenhouse Gas Initiative (RGGI) is a cooperative effort by Connecticut, Delaware, Maine, Maryland, Massachusetts, New Hampshire, New Jersey (as of January 1, 2020), New York, Rhode Island, Vermont and Virginia (as of January 1, 2021) to cap CO<sub>2</sub> emissions from power generation facilities.<sup>117</sup> Virginia withdrew from RGGI effective January 1, 2024.

Delaware, Maryland and New Jersey are members of RGGI, and Virginia was a member from January 1, 2021 through 2023. New Jersey, a founding member of RGGI, opted out in 2011 but rejoined RGGI in 2020.<sup>118</sup> Virginia joined RGGI on January 1, 2021, and left RGGI on December 31, 2023. A decision issued November 18, 2024, by the Floyd County Circuit Court of Virginia determined that the Governor lacked the authority to remove Virginia from RGGI.<sup>119</sup> An appeal of the decision is pending. Pennsylvania took action to join RGGI on April 23, 2022, but such action has been enjoined by court order on appeal.<sup>120 121</sup> A decision on the merits of the appeal is pending at the Supreme Court of Pennsylvania.

Table 8-4 shows the RGGI CO<sub>2</sub> auction clearing prices and quantities, in short tons and metric tonnes, for the 3<sup>rd</sup> control period through the 5<sup>th</sup> control period, and the first year of the 6<sup>th</sup> control period.<sup>122</sup> The clearing price for the auction held December 4, 2024, was \$20.05 per allowance (equal to one short ton of CO<sub>2</sub>).<sup>123</sup> The Cost Containment Reserve (CCR) for 2024 was exhausted in the first auction of the year and the December auction cleared well above the CCR trigger price of \$15.92 per

<sup>117</sup> RGGI provides a link on its website to state statutes and regulations authorizing its activities, which can be accessed at: <<http://www.rggi.org/design/regulations>>.

<sup>118</sup> "Statement on New Jersey Greenhouse Gas Rule," RGGI Inc. (June 17, 2019) <[https://www.rggi.org/sites/default/files/Uploads/Press-Releases/2019\\_06\\_17\\_NJ\\_Announcement\\_Release.pdf](https://www.rggi.org/sites/default/files/Uploads/Press-Releases/2019_06_17_NJ_Announcement_Release.pdf)>.

<sup>119</sup> See Association of Energy Conservation Professionals v. Virginia State Air Pollution Control Board, Case No. CL23000173-00.

<sup>120</sup> CO2 Budget Trading Program, 52 Pa.B. 2471 (April 23, 2022), codified 25 Pa. Code Ch. 145; see also Executive Order-2019-07. Commonwealth Leadership in Addressing Climate Change through Electric Sector Emissions Reductions, Tom Wolf, Governor, October 3, 2019, <<https://www.governor.pa.gov/newsroom/executive-order-2019-07-commonwealth-leadership-in-addressing-climate-change-through-electric-sector-emissions-reductions/>>.

<sup>121</sup> See *Ramez Ziadeh, et al. v. Pennsylvania Legislative Reference Bureau*, Memorandum Opinion, Commonwealth Court of Pennsylvania Case No. 41 M.D. 2022 (July 8, 2022); *Ramez Ziadeh, et al. v. Pennsylvania Legislative Reference Bureau*, Order Granting Application to Vacate, Commonwealth Court of Pennsylvania Case No. 41 M.D. 2022 (July 25, 2022).

<sup>122</sup> Each control period is three years in duration. The 3<sup>rd</sup> control period covers 2015 through 2017. The 4<sup>th</sup> control period covers 2018 through 2020. The 5<sup>th</sup> control period covers 2021 through 2023. The 6<sup>th</sup> control period covers 2024 through 2026.

<sup>123</sup> RGGI measures carbon in short tons (short ton equals 2,000 pounds) while world carbon markets measure carbon in metric tonnes (metric tonne equals 1,000 kilograms or 2,204.6 pounds).

<sup>112</sup> Va. HB 1526/SB 851.

<sup>113</sup> See Dominion Energy, Inc., et al., SEC Form 10-Q (Quarter ending June 30, 2020).

<sup>114</sup> *Id.*

<sup>115</sup> PJM Operating Agreement, Schedule 2,

<sup>116</sup> *Id.* at 5(b).



allowance.<sup>124</sup> All RGGI auctions in 2024 cleared above the CCR trigger price. The December auction clearing price decreased 22.1 percent from the last auction clearing price of \$25.75 in September 2024. The average RGGI auction price in 2024 was \$20.17 per allowance, a 48.5 percent increase over the average RGGI auction price in 2023.

**Table 8-4 RGGI CO<sub>2</sub> allowance auction prices and quantities in short tons and metric tonnes: 3<sup>rd</sup>, 4<sup>th</sup>, 5<sup>th</sup> and 6<sup>th</sup> Control Periods<sup>125</sup>**

Auction Date	Short Tons				Metric Tonnes			
	Clearing Price	Quantity Offered	Cost Containment Reserve	Quantity Sold	Clearing Price	Quantity Offered	Cost Containment Reserve	Quantity Sold
March 11, 2015	\$5.41	15,272,670		15,272,670	\$5.96	13,855,137		13,855,137
June 3, 2015	\$5.50	15,507,571		15,507,571	\$6.06	14,068,236		14,068,236
September 9, 2015	\$6.02	15,374,294	10,000,000	25,374,294	\$6.64	13,947,329	9,071,850	23,019,179
December 2, 2015	\$7.50	15,374,274		15,374,274	\$8.27	13,947,311		13,947,311
March 9, 2016	\$5.25	14,838,732		14,838,732	\$5.79	13,461,475		13,461,475
June 1, 2016	\$4.53	15,089,652		15,089,652	\$4.99	13,689,106		13,689,106
September 7, 2016	\$4.54	14,911,315		14,911,315	\$5.00	13,527,321		13,527,321
December 7, 2016	\$3.55	14,791,315		14,791,315	\$3.91	13,418,459		13,418,459
March 8, 2017	\$3.00	14,371,300		14,371,300	\$3.31	13,037,428		13,037,428
June 7, 2017	\$2.53	14,597,470		14,597,470	\$2.79	13,242,606		13,242,606
September 8, 2017	\$4.35	14,371,585		14,371,585	\$4.80	13,037,686		13,037,686
December 8, 2017	\$3.80	14,687,989		14,687,989	\$4.19	13,324,723		13,324,723
March 14, 2018	\$3.79	13,553,767		13,553,767	\$4.18	12,295,774		12,295,774
June 13, 2018	\$4.02	13,771,025		13,771,025	\$4.43	12,492,867		12,492,867
September 9, 2018	\$4.50	13,590,107		13,590,107	\$4.96	12,328,741		12,328,741
December 5, 2018	\$5.35	13,360,649		13,360,649	\$5.90	12,120,580		12,120,580
March 13, 2019	\$5.27	12,883,436		12,883,436	\$5.81	11,687,660		11,687,660
June 5, 2019	\$5.62	13,221,453		13,221,453	\$6.19	11,994,304		11,994,304
September 4, 2019	\$5.20	13,116,447		13,116,447	\$5.73	11,899,044		11,899,044
December 4, 2019	\$5.61	13,116,444		13,116,444	\$6.18	11,899,041		11,899,041
March 11, 2020	\$5.65	16,208,347		16,208,347	\$6.23	14,703,969		14,703,969
June 3, 2020	\$5.75	16,336,298		16,336,298	\$6.34	14,820,045		14,820,045
September 2, 2020	\$6.82	16,192,785		16,192,785	\$7.52	14,689,852		14,689,852
December 2, 2020	\$7.41	16,237,495		16,237,495	\$8.17	14,730,412		14,730,412
March 3, 2021	\$7.60	23,467,261		23,467,261	\$8.38	21,289,147		21,289,147
June 2, 2021	\$7.97	22,987,719		22,987,719	\$8.79	20,854,114		20,854,114
September 8, 2021	\$9.30	22,911,423		22,911,423	\$10.25	20,784,899		20,784,899
December 1, 2021	\$13.00	23,121,518	3,919,482	27,041,000	\$14.33	20,975,494	3,555,695	24,531,190
March 9, 2022	\$13.50	21,761,269		21,761,269	\$14.88	19,741,497		19,741,497
June 1, 2022	\$13.90	22,280,473		22,280,473	\$15.32	20,212,511		20,212,511
September 7, 2022	\$13.45	22,404,023		22,404,023	\$14.83	20,324,594		20,324,594
December 7, 2022	\$12.99	22,233,203		22,233,203	\$14.32	20,169,628		20,169,628
March 8, 2023	\$12.50	21,522,877		21,522,877	\$13.78	19,525,231		19,525,231
June 7, 2023	\$12.73	22,026,639		22,026,639	\$14.03	19,982,237		19,982,237
September 6, 2023	\$13.85	21,948,358		21,948,358	\$15.27	19,911,221		19,911,221
December 6, 2023	\$14.88	22,090,709	5,565,291	27,656,000	\$16.40	20,040,360	5,048,749	25,089,108
March 13, 2024	\$16.00	15,855,879	8,416,278	24,272,157	\$17.64	14,384,216	7,635,121	22,019,337
June 5, 2024	\$21.03	16,053,188		16,053,188	\$23.18	14,563,211		14,563,211
September 4, 2024	\$25.75	15,943,608		15,943,608	\$28.38	14,463,802		14,463,802
December 4, 2024	\$20.05	15,943,608		15,943,608	\$22.10	14,463,802		14,463,802

The RGGI auction held on December 4, 2024, generated \$319.7 million in auction revenue. RGGI auctions have generated \$8.6 billion in auction revenue since 2008.<sup>126</sup> RGGI auction revenue is returned to the states. RGGI reported that the RGGI states, cumulative through the 2022 reporting year, have invested \$4.0 billion, 68.3 percent of auction revenues.<sup>127</sup> RGGI reports that 61 percent of the \$4.0 billion was invested in energy efficiency, six percent on clean and renewable energy, eight percent on greenhouse gas abatement, 15 percent on direct bill assistance, four percent on beneficial electrification, six percent on administration and one percent on RGGI, Inc.<sup>128</sup>

<sup>124</sup> RGGI auctions employ a price cap called the Cost Containment Reserve (CCR) trigger price. When demand for allowances exceeds the supply at the CCR trigger price, the auction is cleared by setting the price equal to the CCR trigger price and drawing on allowances that are held in reserve. In the March 2024 auction, the reserve allowances were not sufficient to meet the demand at the CCR trigger price and the auction cleared above the CCR trigger price. The December 2023 auction cleared at the CCR trigger price (\$14.88 per ton). The auctions on March 5, 2014, September 3, 2015, December 1, 2021 and December 6, 2023, are the only auctions that have cleared at the CCR trigger price. All four auctions in 2024 cleared above the CCR trigger price.

<sup>125</sup> See Regional Greenhouse Gas Initiative, "Auction Results," <<https://www.rggi.org/auctions/auction-results>>.

<sup>126</sup> See Auction Results at <<https://www.rggi.org/>>.

<sup>127</sup> *The Investment of RGGI Proceeds in 2022*, The Regional Greenhouse Gas Initiative (RGGI) at 16, July 2024, <<https://www.rggi.org/investments/proceeds-investments>>.

<sup>128</sup> *Id.* at 15.

If all PJM states joined RGGI, the total RGGI revenue to the PJM states would be significant. The estimated allowance revenue for PJM states based on 2022 CO<sub>2</sub> emission levels and the RGGI clearing price for the December 2024 auction ranges from \$3.7 billion per year to \$7.0 billion per year depending on associated reductions in carbon emission levels (Table 8-5).<sup>129</sup> Table 8-5 shows the estimated carbon allowance revenue for each PJM state based on the latest RGGI auction price and reductions below 2022 CO<sub>2</sub> emission levels ranging from five to 50 percent. A power plant owner must acquire an allowance for each ton of CO<sub>2</sub> emissions and the revenue values in Table 8-5 are computed by multiplying the carbon price by the emission cap level which is expressed as a reduction below the 2022 actual emissions level. States that participate in RGGI choose their emission cap. For example, New Jersey chose an emission cap of 18,000,000 short tons for reentry into RGGI in 2020, 5.3 percent below New Jersey's 2018 CO<sub>2</sub> emissions level; the New Jersey emission cap will be reduced by 540,000 short tons each year through 2030.<sup>130</sup>

**Table 8-5 Estimated CO<sub>2</sub> allowance revenue at December 2024 RGGI price level<sup>131 132</sup>**

Jurisdiction	Estimated CO <sub>2</sub> allowance revenue (\$ millions), carbon price \$20.05 per short ton						
	2022 power generation CO <sub>2</sub> emissions (million short tons)	5 percent reduction below 2022 emission levels	10 percent reduction below 2022 emission levels	15 percent reduction below 2022 emission levels	20 percent reduction below 2022 emission levels	25 percent reduction below 2022 emission levels	50 percent reduction below 2022 emission levels
Delaware	2.3	\$43.2	\$41.0	\$38.7	\$36.4	\$34.1	\$22.8
Illinois	25.0	\$475.9	\$450.9	\$425.8	\$400.8	\$375.7	\$250.5
Indiana	36.0	\$685.9	\$649.8	\$613.7	\$577.6	\$541.5	\$361.0
Kentucky	33.5	\$638.1	\$604.5	\$570.9	\$537.4	\$503.8	\$335.8
Maryland	11.7	\$222.1	\$210.4	\$198.7	\$187.0	\$175.4	\$116.9
Michigan	1.3	\$24.1	\$22.8	\$21.6	\$20.3	\$19.0	\$12.7
New Jersey	12.0	\$228.7	\$216.7	\$204.7	\$192.6	\$180.6	\$120.4
North Carolina	0.1	\$2.3	\$2.2	\$2.1	\$1.9	\$1.8	\$1.2
Ohio	83.6	\$1,592.6	\$1,508.7	\$1,424.9	\$1,341.1	\$1,257.3	\$838.2
Pennsylvania	80.3	\$1,528.9	\$1,448.5	\$1,368.0	\$1,287.5	\$1,207.0	\$804.7
Tennessee	0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0
Virginia	27.3	\$519.5	\$492.2	\$464.8	\$437.5	\$410.1	\$273.4
Washington, D.C.	0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0
West Virginia	55.3	\$1,053.0	\$997.5	\$942.1	\$886.7	\$831.3	\$554.2
Total	368.3	\$7,014.3	\$6,645.2	\$6,276.0	\$5,906.8	\$5,537.6	\$3,691.8

The RGGI emissions cap (carbon budget) is the sum of CO<sub>2</sub> allowances issued by each state. Table 8-6 shows the RGGI emission cap history. Compliance with the RGGI allowance obligation is evaluated at the end of each three year period which is called the control period. The first control period began in 2009. The 2024 compliance year is the first year of the sixth control period.

In 2021, RGGI announced a third adjustment to the RGGI emissions cap to account for banked allowances from previous control periods.<sup>133 134</sup> The first adjustment removed 57.4 million allowances that were banked or unused from the first control period. The reduction to the RGGI emissions cap was spread over a seven year period beginning in 2014 and ending with 2020.<sup>135</sup> A second cap adjustment, corresponding to banked allowances for 2012 and 2013, began in 2015 with an adjustment of 13.7 million allowances per year and was in place through 2020.<sup>136</sup> The third adjustment of 95.5 million allowances will be spread over a five year period beginning in 2021.<sup>137</sup> The base emissions cap for each of the next five years will be reduced by 19.1 million allowances. The percent change columns in Table 8-6 show the year to year percent changes in the base RGGI cap and the adjusted RGGI cap.<sup>138</sup> The adjusted emissions

<sup>129</sup> This assumes that the PJM states would implement their RGGI rules consistent with the current RGGI states where owners of fossil fuel generators are required to purchase emission allowances in a regional centralized auction or purchase allowances in a secondary market.

<sup>130</sup> "Governor Murphy Announces Adoption of Rules Returning New Jersey to Regional Greenhouse Gas Initiative," State of New Jersey, Governor Phil Murphy Press Release, June 17, 2019 <<https://nj.gov/governor/news/news/562019/approved/20190617a.shtml>>.

<sup>131</sup> The 2022 CO<sub>2</sub> emissions data is from the EPA Continuous Emission Monitoring System (CEMS) from PJM generators.

<sup>132</sup> Power generation companies subject to a RGGI emission cap can offset up to 3.3 percent of their allowance obligation by undertaking certain greenhouse gas emission reduction projects. The allowance revenue values in Table 8-5 do not reflect offset allowances.

<sup>133</sup> "Third Adjustment for Banked Allowances Announcement," Regional Greenhouse Gas Initiative (March 15, 2021) <<https://www.rggi.org/news-releases/rggi-releases>>.

<sup>134</sup> A banked allowance is an allowance acquired during a previous control period that was not used to fulfill a RGGI allowance obligation.

<sup>135</sup> "Second Control Period Interim Adjustment for Banked Allowances Announcement," Regional Greenhouse Gas Initiative (March 17, 2014) at 2. Due to rounding, the adjustment is 8,207,664 allowances for years 2014 through 2018, and 8,207,663 allowances for the remaining two years <[https://www.rggi.org/sites/default/files/Uploads/Design-Archive/2012-Review/Adjustments/2014\\_03\\_17\\_SCP\\_Adjustment.pdf](https://www.rggi.org/sites/default/files/Uploads/Design-Archive/2012-Review/Adjustments/2014_03_17_SCP_Adjustment.pdf)>.

<sup>136</sup> Id.

<sup>137</sup> "Third Adjustment for Banked Allowances Announcement," Regional Greenhouse Gas Initiative (March 15, 2021) <<https://www.rggi.org/news-releases/rggi-releases>>.


<sup>138</sup> Percent changes for years with membership changes do not reflect the impacts of the change in membership. For example, the RGGI cap for 2020 reflects the impact of New Jersey rejoining RGGI in 2020 but the percent change from 2019 to 2020 does not include New Jersey's allowance budget. Virginia's adoption of RGGI in 2021 and Virginia's withdrawal at the end of 2023 are treated analogously.

cap for 2021 is the only year for which the adjusted carbon emissions cap increased.<sup>139</sup> Figure 8-2 shows the adjusted carbon budgets (CO<sub>2</sub> emissions caps) for the RGGI states.

**Table 8-6 RGGI emissions cap history<sup>140 141</sup>**

	Control Period	RGGI Average Clearing Price (\$ per short ton)	RGGI Cap (short tons)	Percent Change in RGGI Cap	RGGI Adjusted Cap (short tons)	Percent Change in Adjusted Cap
2009		\$2.77	188,076,976		188,076,976	
2010	1st	\$1.93	188,076,976	0.0%	188,076,976	0.0%
2011		\$1.89	188,076,976	0.0%	188,076,976	0.0%
2012		\$1.93	165,184,246	0.0%	165,184,246	0.0%
2013	2nd	\$2.92	165,184,246	0.0%	165,184,246	0.0%
2014		\$4.72	91,000,000	(44.9%)	82,792,336	(49.9%)
2015		\$6.10	88,725,000	(2.5%)	66,833,592	(19.3%)
2016	3rd	\$4.47	86,506,875	(2.5%)	64,615,467	(3.3%)
2017		\$3.42	84,344,203	(2.5%)	62,452,795	(3.3%)
2018		\$4.41	82,235,598	(2.5%)	60,344,190	(3.4%)
2019	4th	\$5.43	80,363,945	(2.3%)	58,472,538	(3.1%)
2020		\$6.41	96,354,847	(2.5%)	74,463,439	(3.4%)
2021		\$9.61	119,767,784	(3.9%)	100,677,454	4.5%
2022	5th	\$13.46	116,112,784	(3.1%)	97,022,454	(3.6%)
2023		\$13.58	112,457,784	(3.1%)	93,367,454	(3.8%)
2024	6th	\$20.17	84,162,784	(3.2%)	69,401,609	(3.9%)

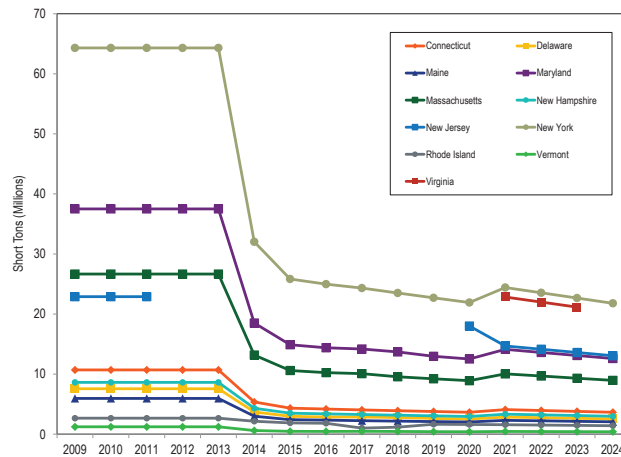**Figure 8-2 RGGI adjusted carbon budgets by state<sup>142</sup>**



<sup>139</sup> The increase of 4.5 percent does not reflect the addition of Virginia as a RGGI state.

<sup>140</sup> See Regional Greenhouse Gas Initiative, "Allowance Distribution" <<https://www.rggi.org/allowance-tracking/allowance-distribution>> (Accessed April 30, 2024).

<sup>141</sup> The increase in the RGGI Cap and the RGGI Adjusted Cap in 2020 is due to the reentry of New Jersey. The new cap is 18 million short tons higher than the previously published 2020 caps.

<sup>142</sup> Data for the figure was collected from allowance distribution reports available on the RGGI website <<https://www.rggi.org/allowance-tracking/allowance-distribution>>

## Carbon Pricing, State Revenues and Energy Market Prices

Table 8-7 shows the estimated allowance revenue for PJM states for carbon prices ranging from \$20 per short ton to \$50 per short ton and for emissions reductions ranging from five percent to 50 percent. Allowance revenues to states would be \$17.5 billion if the carbon price were \$50 per short ton and emission levels were five percent below 2022 levels. Allowance revenues to states would be \$3.7 billion if the carbon price were \$20 per short ton and emission levels were 50 percent below 2022.

**Table 8-7 Estimated CO<sub>2</sub> allowance revenue at various carbon prices**

Jurisdiction	Estimated CO <sub>2</sub> allowance revenue (\$ millions)					
	5 percent	10 percent	15 percent	20 percent	25 percent	50 percent
	reduction below 2022 emission levels	reduction below 2022 emission levels	reduction below 2022 emission levels	reduction below 2022 emission levels	reduction below 2022 emission levels	reduction below 2022 emission levels
	Carbon Price (\$ per short ton)			\$20.00		
Delaware	\$43.1	\$40.9	\$38.6	\$36.3	\$34.0	\$22.7
Illinois	\$474.7	\$449.7	\$424.8	\$399.8	\$374.8	\$249.9
Indiana	\$684.2	\$648.2	\$612.1	\$576.1	\$540.1	\$360.1
Kentucky	\$636.5	\$603.0	\$569.5	\$536.0	\$502.5	\$335.0
Maryland	\$221.6	\$209.9	\$198.2	\$186.6	\$174.9	\$116.6
Michigan	\$24.0	\$22.8	\$21.5	\$20.2	\$19.0	\$12.7
New Jersey	\$228.2	\$216.2	\$204.2	\$192.1	\$180.1	\$120.1
North Carolina	\$2.3	\$2.2	\$2.1	\$1.9	\$1.8	\$1.2
Ohio	\$1,588.6	\$1,505.0	\$1,421.4	\$1,337.8	\$1,254.1	\$836.1
Pennsylvania	\$1,525.1	\$1,444.8	\$1,364.6	\$1,284.3	\$1,204.0	\$802.7
Tennessee	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0
Virginia	\$518.2	\$490.9	\$463.7	\$436.4	\$409.1	\$272.7
Washington, D.C.	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0
West Virginia	\$1,050.3	\$995.0	\$939.8	\$884.5	\$829.2	\$552.8
Total	\$6,996.9	\$6,628.6	\$6,260.3	\$5,892.1	\$5,523.8	\$3,682.6
	Carbon Price (\$ per short ton)			\$25.00		
Delaware	\$53.9	\$51.1	\$48.2	\$45.4	\$42.6	\$28.4
Illinois	\$593.4	\$562.2	\$530.9	\$499.7	\$468.5	\$312.3
Indiana	\$855.2	\$810.2	\$765.2	\$720.2	\$675.2	\$450.1
Kentucky	\$795.6	\$753.8	\$711.9	\$670.0	\$628.1	\$418.8
Maryland	\$277.0	\$262.4	\$247.8	\$233.2	\$218.6	\$145.8
Michigan	\$30.1	\$28.5	\$26.9	\$25.3	\$23.7	\$15.8
New Jersey	\$285.2	\$270.2	\$255.2	\$240.2	\$225.2	\$150.1
North Carolina	\$2.9	\$2.7	\$2.6	\$2.4	\$2.3	\$1.5
Ohio	\$1,985.7	\$1,881.2	\$1,776.7	\$1,672.2	\$1,567.7	\$1,045.1
Pennsylvania	\$1,906.4	\$1,806.1	\$1,705.7	\$1,605.4	\$1,505.0	\$1,003.4
Tennessee	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0
Virginia	\$647.8	\$613.7	\$579.6	\$545.5	\$511.4	\$340.9
Washington, D.C.	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0
West Virginia	\$1,312.9	\$1,243.8	\$1,174.7	\$1,105.6	\$1,036.5	\$691.0
Total	\$8,746.1	\$8,285.7	\$7,825.4	\$7,365.1	\$6,904.8	\$4,603.2
	Carbon Price (\$ per short ton)			\$50.00		
Delaware	\$107.8	\$102.1	\$96.5	\$90.8	\$85.1	\$56.7
Illinois	\$1,186.8	\$1,124.3	\$1,061.9	\$999.4	\$937.0	\$624.6
Indiana	\$1,710.4	\$1,620.4	\$1,530.4	\$1,440.3	\$1,350.3	\$900.2
Kentucky	\$1,591.3	\$1,507.5	\$1,423.8	\$1,340.0	\$1,256.3	\$837.5
Maryland	\$553.9	\$524.8	\$495.6	\$466.5	\$437.3	\$291.5
Michigan	\$60.1	\$56.9	\$53.8	\$50.6	\$47.4	\$31.6
New Jersey	\$570.4	\$540.4	\$510.4	\$480.4	\$450.4	\$300.2
North Carolina	\$5.8	\$5.5	\$5.2	\$4.9	\$4.6	\$3.0
Ohio	\$3,971.5	\$3,762.4	\$3,553.4	\$3,344.4	\$3,135.4	\$2,090.2
Pennsylvania	\$3,812.8	\$3,612.1	\$3,411.4	\$3,210.8	\$3,010.1	\$2,006.7
Tennessee	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0
Virginia	\$1,295.5	\$1,227.4	\$1,159.2	\$1,091.0	\$1,022.8	\$681.9
Washington, D.C.	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0
West Virginia	\$2,625.8	\$2,487.6	\$2,349.4	\$2,211.2	\$2,073.0	\$1,382.0
Total	\$17,492.1	\$16,571.5	\$15,650.9	\$14,730.2	\$13,809.6	\$9,206.4

Table 8-8 shows the estimated impact of five different carbon prices on PJM load-weighted LMP. For example, if the carbon price were \$25.00 per tonne, the PJM load-weighted average LMP in 2024 would have increased by 1.0 percent.<sup>143</sup>

**Table 8-8 Estimated impact of carbon price on LMP: 2023 and 2024**

Scenario	2023				2024		
	Carbon Price (\$/Metric Ton)	Actual LMP (\$/MWh)	Estimated LMP (\$/MWh)	Percent Change	Actual LMP (\$/MWh)	Estimated LMP (\$/MWh)	Percent Change
Scenario 1	\$5.00	\$31.08	\$28.45	(8.5%)	\$33.74	\$32.26	(4.4%)
Scenario 2	\$10.00	\$31.08	\$29.97	(3.6%)	\$33.74	\$32.71	(3.0%)
Scenario 3	\$15.00	\$31.08	\$31.49	1.3%	\$33.74	\$33.17	(1.7%)
Scenario 4	\$25.00	\$31.08	\$34.53	11.1%	\$33.74	\$34.09	1.0%
Scenario 5	\$50.00	\$31.08	\$42.13	35.6%	\$33.74	\$36.39	7.9%

Table 8-9 shows the impact of a range of carbon prices on the cost per MWh of producing energy from three basic unit types.<sup>144 145</sup> For example, if the price of carbon were \$50.00 per tonne, the short run marginal costs would increase by \$24.52 per MWh for a new combustion turbine (CT) unit, \$16.71 per MWh for a new combined cycle (CC) unit and \$43.15 per MWh for a new coal plant (CP). Table 8-11 and Table 8-12 show the carbon price impact (\$ per MWh) for a range of heat rates and carbon prices for natural gas and coal fired generation.

**Table 8-9 Carbon price per MWh by unit type**

Unit Type	Carbon Price per MWh						
	Carbon \$5/tonne	Carbon \$10/tonne	Carbon \$15/tonne	Carbon \$50/tonne	Carbon \$100/tonne	Carbon \$200/tonne	Carbon \$400/tonne
CT	\$2.44	\$4.89	\$7.33	\$24.45	\$48.89	\$97.79	\$195.58
CC	\$1.68	\$3.37	\$5.05	\$16.85	\$33.70	\$67.40	\$134.79
CP	\$4.31	\$8.62	\$12.94	\$43.12	\$86.25	\$172.49	\$344.99

Table 8-9 also illustrates the effective cost of carbon included in the price of a REC or SREC. For example, the average price of an SREC in New Jersey was \$192.82 per credit in 2024. The SREC price is paid in addition to the energy price paid at the time the solar energy is produced. The carbon price implied by the SREC price is slightly less than \$400 per tonne. Table 8-9 shows that if the MWh produced by the solar resource resulted in avoiding the production of one MWh from a CT, the value of carbon reduction implied by an SREC price of \$195.58 is a carbon price of \$400 per tonne. This result also assumes that the entire value of the SREC was based on reduced carbon emissions. The SREC price consistent with a carbon price of \$50.00 per tonne, assuming that a MWh from a CT is avoided, is \$24.45 per MWh.

Applying this method to Tier I and Class I REC, and SREC price histories yields the implied carbon prices in Table 8-10. The carbon price implied by the average REC price for 2024 in Ohio is \$13.40 per tonne which is \$8.83 per tonne lower than the average RGGI auction price of \$22.23 per tonne in 2024. The implied carbon prices for Maryland, New Jersey, Pennsylvania and Washington, DC RECs range from \$45.29 per tonne to \$63.85 per ton. The implied carbon price for Virginia RECs is \$63.85, approximately three times the average RGGI auction clearing price. The social cost of carbon which is estimated to be in the range of \$50 per tonne.<sup>146 147</sup> The carbon prices implied by SREC prices have no apparent relationship to carbon prices implied by the REC clearing prices. The carbon prices implied by the SREC prices all exceed the carbon prices implied by the corresponding REC prices.

<sup>143</sup> LMPs are recalculated to account for the defined cost of carbon emissions on marginal units' offer prices. The LMP calculation is not based on a counterfactual redispatch of the system to determine the marginal units and the marginal costs that would have occurred if all units had made all offers at short run marginal cost. See Technical Reference for PJM Markets, "Calculation and Use of Generator Sensitivity/Unit Participation Factors," <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

<sup>144</sup> Heat rates from: 2024 Annual State of the Market Report for PJM, Volume 2, Section 7: Net Revenue, Table 7-3.

<sup>145</sup> Prices reflect carbon emissions rates from Table A.3. Carbon Dioxide Uncontrolled Emission Factors, EIA, <[https://www.eia.gov/electricity/annual/html/epa\\_a\\_03.html](https://www.eia.gov/electricity/annual/html/epa_a_03.html)> (Accessed May 7, 2024).

<sup>146</sup> "Technical Update of the Social Cost of Carbon for Regulatory Impact Analysis – Under Executive Order 12899," Interagency Working Group on the Social Cost of Greenhouse Gases, United States Government, (Aug. 2016), <[https://19january2017snapshot.epa.gov/sites/production/files/2016-12/documents/sc\\_co2\\_tsd\\_august\\_2016.pdf](https://19january2017snapshot.epa.gov/sites/production/files/2016-12/documents/sc_co2_tsd_august_2016.pdf)>.

<sup>147</sup> A recent update by the EPA estimates the social cost of carbon emissions for 2030 to be between \$140 and \$380 per metric ton (2020 dollars). See Table ES.1 in Report on the Social Cost of Greenhouse Gases, U.S. Environmental Protection Agency (November 2023) <<https://www.epa.gov/environmental-economics/scghg>>.



Table 8-10 Implied carbon price based on REC and SREC prices: 2015 through 2024

	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
<b>Jurisdiction with Tier I or Class I REC</b>										
Delaware	\$32.01	\$33.01	\$10.29	\$11.60	\$16.10	\$19.94				
Maryland	\$29.27	\$26.17	\$23.19	\$21.35	\$17.81	\$19.98	\$34.29	\$37.82	\$46.80	\$48.31
New Jersey	\$25.37	\$27.01	\$24.08	\$22.08	\$19.25	\$20.54	\$31.62	\$36.23	\$48.37	\$52.42
Ohio	\$8.54	\$5.30	\$6.29	\$11.21	\$14.04	\$16.33	\$14.93	\$14.98	\$14.07	\$13.40
Pennsylvania	\$28.96	\$26.43	\$23.42	\$21.53	\$17.96	\$20.06	\$33.58	\$37.76	\$46.68	\$50.77
Virginia							\$35.53	\$36.02	\$51.93	\$63.85
Washington, D.C.	\$3.20	\$4.05	\$4.90	\$4.69	\$5.52	\$20.25	\$24.28	\$27.49	\$33.95	\$45.29
<b>Jurisdiction with Solar REC</b>										
Delaware	\$85.66	\$86.75	\$35.80	\$17.38						
Maryland	\$251.99	\$183.64	\$128.05	\$87.27	\$84.19	\$101.68	\$121.11	\$111.74	\$104.44	\$107.41
New Jersey	\$389.91	\$425.49	\$460.60	\$446.35	\$410.31	\$394.18	\$413.80	\$424.70	\$399.25	\$394.37
Ohio	\$45.25	\$36.26	\$31.92	\$21.73	\$26.65					
Pennsylvania	\$67.09	\$55.22	\$43.97	\$28.16	\$51.65	\$63.80	\$74.20	\$83.02	\$78.95	\$74.65
Washington, D.C.	\$997.05	\$996.49	\$868.78	\$842.89	\$851.39	\$869.41	\$851.78	\$856.50	\$867.74	\$783.72
<b>Regional Greenhouse Gas Initiative</b>										
RGGI clearing price	\$6.72	\$4.93	\$3.77	\$4.86	\$5.98	\$7.06	\$10.59	\$14.84	\$14.97	\$22.23

Table 8-11 Carbon price for natural gas fired generators<sup>148</sup>

Carbon Price (\$ per MWh)											
Carbon (\$ per tonne)											
Heat Rate (Btu per kWh)	\$10.00	\$15.00	\$20.00	\$25.00	\$30.00	\$35.00	\$40.00	\$45.00	\$50.00	\$55.00	\$60.00
6,000	\$3.17	\$4.76	\$6.35	\$7.94	\$9.52	\$11.11	\$12.70	\$14.29	\$15.87	\$17.46	\$19.05
6,500	\$3.44	\$5.16	\$6.88	\$8.60	\$10.32	\$12.04	\$13.76	\$15.48	\$17.20	\$18.92	\$20.63
7,000	\$3.70	\$5.56	\$7.41	\$9.26	\$11.11	\$12.96	\$14.81	\$16.67	\$18.52	\$20.37	\$22.22
7,500	\$3.97	\$5.95	\$7.94	\$9.92	\$11.90	\$13.89	\$15.87	\$17.86	\$19.84	\$21.83	\$23.81
8,000	\$4.23	\$6.35	\$8.47	\$10.58	\$12.70	\$14.81	\$16.93	\$19.05	\$21.16	\$23.28	\$25.40
8,500	\$4.50	\$6.75	\$8.99	\$11.24	\$13.49	\$15.74	\$17.99	\$20.24	\$22.49	\$24.74	\$26.98
9,000	\$4.76	\$7.14	\$9.52	\$11.90	\$14.29	\$16.67	\$19.05	\$21.43	\$23.81	\$26.19	\$28.57
9,500	\$5.03	\$7.54	\$10.05	\$12.57	\$15.08	\$17.59	\$20.11	\$22.62	\$25.13	\$27.65	\$30.16
10,000	\$5.29	\$7.94	\$10.58	\$13.23	\$15.87	\$18.52	\$21.16	\$23.81	\$26.45	\$29.10	\$31.75
10,500	\$5.56	\$8.33	\$11.11	\$13.89	\$16.67	\$19.44	\$22.22	\$25.00	\$27.78	\$30.56	\$33.33
11,000	\$5.82	\$8.73	\$11.64	\$14.55	\$17.46	\$20.37	\$23.28	\$26.19	\$29.10	\$32.01	\$34.92
11,500	\$6.08	\$9.13	\$12.17	\$15.21	\$18.25	\$21.30	\$24.34	\$27.38	\$30.42	\$33.47	\$36.51
12,000	\$6.35	\$9.52	\$12.70	\$15.87	\$19.05	\$22.22	\$25.40	\$28.57	\$31.75	\$34.92	\$38.10
12,500	\$6.61	\$9.92	\$13.23	\$16.53	\$19.84	\$23.15	\$26.45	\$29.76	\$33.07	\$36.38	\$39.68
13,000	\$6.88	\$10.32	\$13.76	\$17.20	\$20.63	\$24.07	\$27.51	\$30.95	\$34.39	\$37.83	\$41.27
13,500	\$7.14	\$10.71	\$14.29	\$17.86	\$21.43	\$25.00	\$28.57	\$32.14	\$35.71	\$39.29	\$42.86
14,000	\$7.41	\$11.11	\$14.81	\$18.52	\$22.22	\$25.93	\$29.63	\$33.33	\$37.04	\$40.74	\$44.44
14,500	\$7.67	\$11.51	\$15.34	\$19.18	\$23.02	\$26.85	\$30.69	\$34.52	\$38.36	\$42.20	\$46.03
15,000	\$7.94	\$11.90	\$15.87	\$19.84	\$23.81	\$27.78	\$31.75	\$35.71	\$39.68	\$43.65	\$47.62

148 Prices reflect uncontrolled carbon emission rates from Table A.3 in *Electric Power Annual*, EIA (October 19, 2023) <<https://www.eia.gov/electricity/annual/>>.

Table 8-12 Carbon price for coal fired generators<sup>149</sup>

Heat Rate (Btu per kWh)	Carbon Price (\$ per MWh)										
	Carbon (\$ per tonne)										
	\$10.00	\$15.00	\$20.00	\$25.00	\$30.00	\$35.00	\$40.00	\$45.00	\$50.00	\$55.00	\$60.00
9,000	\$8.39	\$12.59	\$16.78	\$20.98	\$25.17	\$29.37	\$33.57	\$37.76	\$41.96	\$46.15	\$50.35
9,500	\$8.86	\$13.29	\$17.72	\$22.14	\$26.57	\$31.00	\$35.43	\$39.86	\$44.29	\$48.72	\$53.15
10,000	\$9.32	\$13.99	\$18.65	\$23.31	\$27.97	\$32.63	\$37.30	\$41.96	\$46.62	\$51.28	\$55.94
10,500	\$9.79	\$14.69	\$19.58	\$24.48	\$29.37	\$34.27	\$39.16	\$44.06	\$48.95	\$53.85	\$58.74
11,000	\$10.26	\$15.38	\$20.51	\$25.64	\$30.77	\$35.90	\$41.03	\$46.15	\$51.28	\$56.41	\$61.54
11,500	\$10.72	\$16.08	\$21.45	\$26.81	\$32.17	\$37.53	\$42.89	\$48.25	\$53.61	\$58.97	\$64.34
12,000	\$11.19	\$16.78	\$22.38	\$27.97	\$33.57	\$39.16	\$44.76	\$50.35	\$55.94	\$61.54	\$67.13
12,500	\$11.65	\$17.48	\$23.31	\$29.14	\$34.96	\$40.79	\$46.62	\$52.45	\$58.27	\$64.10	\$69.93
13,000	\$12.12	\$18.18	\$24.24	\$30.30	\$36.36	\$42.42	\$48.48	\$54.55	\$60.61	\$66.67	\$72.73
13,500	\$12.59	\$18.88	\$25.17	\$31.47	\$37.76	\$44.06	\$50.35	\$56.64	\$62.94	\$69.23	\$75.52
14,000	\$13.05	\$19.58	\$26.11	\$32.63	\$39.16	\$45.69	\$52.21	\$58.74	\$65.27	\$71.79	\$78.32
14,500	\$13.52	\$20.28	\$27.04	\$33.80	\$40.56	\$47.32	\$54.08	\$60.84	\$67.60	\$74.36	\$81.12
15,000	\$13.99	\$20.98	\$27.97	\$34.96	\$41.96	\$48.95	\$55.94	\$62.94	\$69.93	\$76.92	\$83.92
15,500	\$14.45	\$21.68	\$28.90	\$36.13	\$43.36	\$50.58	\$57.81	\$65.03	\$72.26	\$79.49	\$86.71
16,000	\$14.92	\$22.38	\$29.84	\$37.30	\$44.76	\$52.21	\$59.67	\$67.13	\$74.59	\$82.05	\$89.51
16,500	\$15.38	\$23.08	\$30.77	\$38.46	\$46.15	\$53.85	\$61.54	\$69.23	\$76.92	\$84.62	\$92.31
17,000	\$15.85	\$23.78	\$31.70	\$39.63	\$47.55	\$55.48	\$63.40	\$71.33	\$79.25	\$87.18	\$95.10
17,500	\$16.32	\$24.48	\$32.63	\$40.79	\$48.95	\$57.11	\$65.27	\$73.43	\$81.58	\$89.74	\$97.90
18,000	\$16.78	\$25.17	\$33.57	\$41.96	\$50.35	\$58.74	\$67.13	\$75.52	\$83.92	\$92.31	\$100.70

## State Renewable Portfolio Standards

Ten of 14 PJM jurisdictions have enacted legislation that requires that a defined percentage of retail load be served by renewable resources, for which there are many standards and definitions. These requirements are known as renewable portfolio standards, or RPS. In PJM jurisdictions that have adopted an RPS, load serving entities are required by law to meet defined shares of load using specific renewable and/or alternative energy sources commonly called eligible technologies. Load serving entities may generally fulfill these obligations in one of two ways: they may use their own generation resources classified as eligible technologies to produce power or they may purchase renewable energy credits (RECs) that represent a known quantity of power produced with eligible technologies by other market participants or in other geographical locations. Load serving entities that fail to meet the percent goals set in their jurisdiction's RPS must pay penalties (alternative compliance payments).

Renewable energy sources replenish naturally in a short period of time but are flow limited and include solar, geothermal, wind, biomass and hydropower from flowing water. Renewable energy sources are virtually inexhaustible in duration but limited in the amount of energy that is available per unit of time. Nonrenewable energy sources do not replenish in a short period of time and include crude oil, natural gas, coal and uranium (nuclear energy).<sup>150</sup> Some state rules allow nonrenewable energy sources as part of their Renewable Portfolio Standard.

As of December 31, 2024, Delaware, Illinois, Maryland, Michigan, New Jersey, North Carolina, Ohio, Pennsylvania, Virginia and Washington, DC had mandatory renewable portfolio standards that include penalties.

As of December 31, 2024, Indiana had voluntary renewable portfolio standards that do not require participation and do not include noncompliance penalties. Incentives are offered to load serving entities to develop renewable generation or, to a more limited extent, purchase RECs. The voluntary standard was enacted by the Indiana legislature in 2011, but no load serving entities have volunteered to participate in the program.<sup>151</sup>

As of December 31, 2024, Kentucky, Tennessee and West Virginia had no renewable portfolio standards.

How each state satisfies its renewable portfolio standard requirements should be more transparent. While some jurisdictions publish transparent information regarding total REC generation, how the standard is fulfilled and

<sup>149</sup> Prices reflect carbon emission rates for refined coal in Table A.3. Carbon Dioxide Uncontrolled Emission Factors, EIA, <[https://www.eia.gov/electricity/annual/html/epa\\_a\\_03.html](https://www.eia.gov/electricity/annual/html/epa_a_03.html)> (Accessed May 7, 2024).

<sup>150</sup> Renewable Energy Explained, U.S. Energy Information Administration, <[https://www.eia.gov/energyexplained/index.php?page=renewable\\_home](https://www.eia.gov/energyexplained/index.php?page=renewable_home)> (Accessed May 7, 2024).

<sup>151</sup> See the Indiana Utility Regulatory Commission's "2021 Annual Report," at 37 (Oct. 2021) <<https://www.in.gov/iurc/2981.htm>>.

the total cost to the state, some jurisdictions do not provide the same level of detail and there can be a significant lag from the end of the compliance year to the publication of the information. Some states provide adequate information with respect to the total cost for the RPS, where the RECs originated that fulfill the RPS requirements, and if the state fulfilled the RPS goals. Pennsylvania and Maryland both provide more information than other states and serve as a model for other states. The MMU recommends that jurisdictions with a renewable portfolio standard make the compliance data and cost data available in a more complete and transparent manner.

Since a REC may be applied in years other than the year in which it was generated, each vintage of RECs for each state has a different price. For example, the Pennsylvania Alternative Energy Portfolio Standard allows an electric distribution company or generation supplier to retain RECs from the current reporting year for use toward satisfying their REC obligation in either of the two subsequent reporting years.<sup>152</sup>

Beginning in March 2023, RECs for GATS generators will be hourly time stamped certificates.<sup>153</sup> Prior to March 2023, PJM EIS issued RECs based on how much a generator produced in a month.

Table 8-13 shows the percent of retail electric load that must be served by renewable and/or alternative energy resources under each PJM jurisdictions' RPS by year.

**Table 8-13 Renewable and alternative energy standards of PJM jurisdictions: 2023 to 2033**<sup>154 155 156</sup>

Jurisdiction with RPS	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033
Delaware	23.00%	24.00%	25.00%	25.50%	26.00%	26.50%	27.00%	28.00%	30.00%	32.00%	34.00%
Illinois	22.00%	23.50%	25.00%	28.00%	31.00%	34.00%	37.00%	40.00%	40.00%	40.00%	40.00%
Maryland	32.37%	36.20%	38.00%	40.50%	44.00%	45.50%	52.00%	52.50%	52.50%	52.50%	52.50%
Michigan	15.00%	15.00%	15.00%	15.00%	15.00%	15.00%	15.00%	15.00%	15.00%	15.00%	15.00%
New Jersey	29.50%	37.50%	40.50%	43.50%	46.50%	49.50%	52.50%	52.50%	52.50%	52.50%	
North Carolina	12.50%	12.50%	12.50%	12.50%	12.50%	12.50%	12.50%	12.50%	12.50%	12.50%	12.50%
Ohio	7.00%	7.50%	8.00%	8.50%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%
Pennsylvania	18.00%	18.00%	18.00%	18.00%	18.00%	18.00%	18.00%	18.00%	18.00%	18.00%	18.00%
Virginia (Phase I utilities)	8.00%	10.00%	14.00%	17.00%	20.00%	24.00%	27.00%	30.00%	33.00%	36.00%	39.00%
Virginia (Phase II utilities)	20.00%	23.00%	26.00%	29.00%	32.00%	35.00%	38.00%	41.00%	45.00%	49.00%	52.00%
Washington, DC	38.75%	45.00%	52.00%	59.00%	66.00%	73.00%	80.00%	87.00%	94.00%	100.00%	100.00%

<sup>152</sup> Pennsylvania General Assembly, "Alternative Energy Portfolio Standards Act – Enactment Act of Nov. 30, 2004, P.L. 1672, No. 213," Section (e)(6).

<sup>153</sup> "PJM EIS to Produce Energy Certificates Hourly", PJM Environmental Information Services (February 13, 2023) <<https://www.pjm-eis.com/-/media/about-pjm/newsroom/2023-releases/20230213-pjm-eis-to-produce-energy-certificates-hourly.ashx>>.

<sup>154</sup> This shows the total standard of alternative resources in all PJM jurisdictions, including Tier I and Tier II.

<sup>155</sup> The table reflects calendar year standards for Maryland, Washington, DC, Ohio, and North Carolina. The standards for the remaining jurisdictions are for compliance years that begin on June 1, CCYY and end on May 31 of the following year.

<sup>156</sup> New Jersey Administrative Code, Section 14:8-2.3 does not specify standards beyond compliance year 2032/2033.

The Climate and Equitable Jobs Act (CEJA), which became effective on September 15, 2021 in Illinois, increased the RPS target percent from 25 percent by 2025 to 40 percent by 2030. CEJA also increased the quotas for RECs sourced from new wind and new photovoltaic resources, and made changes to eligible technologies and geographic restrictions. See Table 8-14 for details.

Updates to the Maryland RPS became effective on June 1, 2021. Maryland Senate Bill 65 changed the intermediate RPS target levels while maintaining the target of 50.0 percent renewable by 2030.<sup>157</sup> Part of the legislation was to eliminate resources fueled by black liquor as a Tier 1 eligible technology. Senate Bill 65 reduced the penalty for solar non compliance from \$100 per credit to \$80 per credit, and extended the Tier 2 standard which was scheduled to expire with the 2020 compliance year.

The Delaware General Assembly passed new RPS legislation on February 10, 2021. The new law updates the Delaware RPS targets from 25 percent in 2025 to 40 percent in 2035.<sup>158</sup> Additional details are provided in Table 8-14.

<sup>157</sup> Senate Bill 65 Electricity – Renewable Energy Portfolio Standard – Tier 2 Renewable Sources, Qualifying Biomass, and Compliance Fees, Maryland General Assembly (2021) <<https://mgaleg.maryland.gov/mgaweb/legislation/details/sb00657s=2021RS>>.

<sup>158</sup> See Senate Bill 33, Delaware General Assembly (February 10, 2021) <<https://legis.delaware.gov/Bi/Detail?legislationId=48278>>.

On April 11, 2020, the Virginia legislature passed a new law that replaced Virginia's current voluntary RPS with a mandatory RPS.<sup>159</sup> The new law requires by 2050 that 100 percent of energy sold by phase I utilities must come from RPS eligible resources; and 100 percent of energy sold by phase II utilities must come from RPS eligible resources by 2045.<sup>160</sup> <sup>161</sup> Intermediate RPS targets begin in 2021 with a 6.0 percent standard for phase I utilities and a 14.0 percent standard for phase II utilities. Eligible RPS resources include wind, solar, hydroelectric, landfill gas and biomass resources.

In 2018, New Jersey passed legislation that included provisions promoting the development of solar power in the state.<sup>162</sup> The Board of Public Utilities is directed to develop and provide an orderly transition to a new or modified program to support distributed solar. The Board must also design a Community Solar Energy Pilot Program that would "permit customers of an electric public utility to participate in a solar energy project that is remotely located from their properties but is within their electric public utility service territory to allow for a credit to the customer's utility bill equal to the electricity generated that is attributed to the customer's participation in the solar energy project." The pilot program would convert into a permanent program within three years. The statute targets the development of 600 MW of electric storage by 2021 and 2,000 MW by 2030.

On May 18, 2021, Maryland enacted legislation doubling the limit on net metered capacity from 1,500 to 3,000 MW.<sup>163</sup> The legislation is expected to boost the installation of distribution level solar power.

On July 9, 2021, New Jersey enacted legislation establishing a new program for SRECs under the BPU.<sup>164</sup> Through the SREC-II program, the BPU distribute solar renewable certificates to qualifying solar power facilities. The legislation includes incentives for at least 1,500 MW of behind the meter solar facilities and 750 MW of community solar by 2026. It also includes a new competitive solicitation process to incentivize at least 1,500 MW of large-scale solar power facilities by 2026, and develops siting criteria for large-scale solar projects.

Table 8-14 summarizes recent rules changes in Ohio, Maryland, New Jersey, and Washington, DC.

<sup>159</sup> See "Virginia Clean Economy Act," (April 12, 2020) <<https://www.governor.virginia.gov/newsroom/all-releases/2020/april/headline-856056-en.html>>.

<sup>160</sup> A phase I utility is an investor-owned incumbent electric utility that was, as of July 1, 1999, not bound by a rate case settlement adopted by the Commission that extended in its application beyond January 1, 2002, and a phase II utility is an investor-owned incumbent electric utility that was bound by such a settlement (§ 56-585.1 of the Virginia Code).

<sup>161</sup> APCO (AEP) is a phase I utility and Dominion Energy Virginia is a phase II utility. Cooperatives are not subject to the RPS

<sup>162</sup> N.J. S. 2314/A. 3723.

<sup>163</sup> Md. Code Ann § 7-306(d) & 7-306.2(g) (HB 569).

<sup>164</sup> N.J. P.L.2021 (S. 2605/A 4554).

**Table 8-14 Recent changes in RPS rules**<sup>165 166 167 168 169 170 171</sup>

Jurisdiction	Legislation	Effective Date	Summary of changes
Illinois	Climate and Equitable Jobs Act (Public Act 102-0662)	September 15, 2021	Updated the RPS target to 40.0 percent by 2030. The previous target of 25.0 percent by 2025 is still required. Updated the requirement for RECs from new wind generation from 2,000 GWH annually to 4,500 GWH beginning in the 2021/2022 delivery year; increasing to 20,250 GWH in 2030/2031. Updated the requirement for RECs from new photovoltaic generation from 2,000 GWH annually to 5,500 GWH beginning in the 2021/2022 delivery year; increasing to 24,750 GWH in 2030/2031. Removed tree waste as an energy source for eligible resources and added waste heat to power systems and qualified combined heat and power systems as eligible resources. Updated the geographic restrictions to allow RECs from utility scale wind or photovoltaic resources that are deliverable via high voltage direct current transmission.
Maryland	Senate Bill 65	June 1, 2021	Maintains the Tier 1 target of 50.0 percent in 2030 with 14.5 percent solar carve out, but changes the intermediary target levels beginning in 2022. The alternative compliance payment for solar was reduced and the definition of Tier 1 resource now excludes generators fueled by black liquor. Extends indefinitely the Tier 2 target of 2.5 percent which was set to expire in 2020. Tier 2 resources are defined as hydroelectric power other than pumped storage.
Delaware	151st General Assembly Senate Bill 33	February 1, 2021	Increases the RPS target from 25.0 percent in 2025 to 40.0 percent in 2035. Sets the solar carve out requirement to 10.0 percent in 2035. Establishes intermediary target levels for total RPS and the solar carve out for compliance years 2026 through 2034. Lowered the solar alternative compliance payment (SACP) from \$400 per credit to \$150 per credit.
Virginia	Virginia Clean Economy Act	April 11, 2020	Replaces the voluntary RPS with a mandatory RPS beginning in January 2021. The legislation requires 100 percent clean energy by 2050 for phase I utilities and 100 percent clean energy by 2045 for phase II utilities. Intermediate target levels begin in 2021 with 6 percent for phase I utilities and 14 percent for phase II utilities.
Ohio	House Bill 6	October 22, 2019	Reduced the RPS percent for each year beginning in 2020. The 2020 standard was reduced from 6.5 percent to 5.5 percent; the 2026 standard was reduced from 12.5 percent to 8.5 percent. The legislation also removed language that had previously indicated that the standard would remain at the 2026 level for each year after 2026. The solar carve out was removed for compliance year 2020 and beyond. Prior to the recent legislation, the solar carve out was 0.26 percent for 2020, increased to 0.50 percent for 2026, and remained at 0.50 percent for subsequent years.
Maryland	Clean Energy Jobs Act	May 25, 2019	Established a new Tier I target of 50.0 percent in 2030; previously the 2030 Tier I standard was 25.0 percent. The 2019 Tier I standard increased from 20.4 percent to 20.7. The solar carve out percent for 2019 increased from 1.95 percent to 5.50 percent. The solar carve out percent for 2030 increased from 2.5 percent to 14.5 percent. The 2.5 percent Tier II standard, scheduled to end in 2018, was extended through 2020.
Washington, D.C.	CleanEnergy DC Omnibus Amendment Act of 2018	March 22, 2019	Established a 100 percent Tier I renewable standard by 2032. Previously, the 2032 target was 50.0 percent. Tier I increases start in 2020, going from 20.0 percent to 26.25 percent. The 2020 solar carve out will increase from 1.58 percent to 2.175 percent. The 2041 target for the solar carve out is 10.0 percent.

New Jersey and Maryland have taken significant steps to promote offshore wind. Both states enacted legislation for offshore wind renewable energy credits (ORECs) in 2010.<sup>172</sup>

On May 24, 2018, New Jersey enacted a statute directing the Board of Public Utilities (NJPU) to create an OREC program targeting installation of at least 3,500 MW of offshore wind capacity by 2030 (plus 2,000 MW of energy storage capacity).<sup>173</sup> The New Jersey statute also reinstates certain tax incentives for offshore wind manufacturing activities. Governor Murphy has issued Executive Order No. 8, which calls for full implementation of the statute. The offshore wind target 3,500 MW by 2030 has since been replaced by a target of 7,500 MW by 2035.<sup>174</sup> The BPU opened a 100 day application window for qualified offshore wind projects on September 20, 2018, and on June 21, 2019, the first award for a 1,100 MW offshore wind project was granted to Danish wind power developer Ørsted.<sup>175 176</sup> Two more projects were approved on June 30, 2021. Ørsted was awarded a second project for offshore wind capacity

<sup>165</sup> Illinois Climate and Equitable Jobs Act (Public Act 102-0662), Section 90-30 (September 15, 2021).

<sup>166</sup> See "Virginia Clean Economy Act," (April 12, 2020) <<https://www.governor.virginia.gov/newsroom/all-releases/2020/april/headline-856056-en.html>>.

<sup>167</sup> See Ohio Legislature House, 133<sup>rd</sup> Assembly, Bill No. 6, "Ohio Clean Air Program," effective Date October 22, 2019, <<https://www.legislature.ohio.gov/legislation/legislation-summary?id=GA133-HB-6>>.

<sup>168</sup> See Maryland State Legislature, Senate Bill No. 516, "Clean Energy Jobs," Passed May 25, 2019, <<https://legiscan.com/md/text/sb516/2019>>.

<sup>169</sup> D.C. Law 22-257 "CleanEnergy DC Omnibus Amendment Act of 2018," Effective March 22, 2019, <<https://code.dccouncil.us/dc/council/laws/22-257.html>>.

<sup>170</sup> See Senate Bill 33, Delaware General Assembly (February 10, 2021) <<https://legis.delaware.gov/BillDetail?legislationId=48278>>.

<sup>171</sup> Senate Bill 65 Electricity – Renewable Energy Portfolio Standard – Tier 2 Renewable Sources, Qualifying Biomass, and Compliance Fees, Maryland General Assembly (2021) <<https://mgaleg.maryland.gov/mgaweb/legislation/Details/sb0065?ys=2021RS>>.

<sup>172</sup> See Offshore Wind Economic Development Act of 2010, P.L. 2010, c. 57, as amended, N.J.S.A. 48:3-87 to -87.2.

<sup>173</sup> N.J.S. 2314A: 3723.

<sup>174</sup> Executive Order 92, Philip D. Murphy, Governor of New Jersey (November 19, 2019) <[https://nj.gov/infobank/eo/056murphy/approved/eo\\_archive.html](https://nj.gov/infobank/eo/056murphy/approved/eo_archive.html)>.

<sup>175</sup> BPU Docket No. Q018080851.

<sup>176</sup> "New Jersey Board of Public Utilities Awards Historic 1,100 MW Offshore Wind Solicitation to Ørsted's Ocean Wind Project," New Jersey BPU Press Release (June 21, 2019) <<https://nj.gov/bpu/newsroom/2019/approved/20190621.html>>.



of 1,148 MW and Atlantic Shores Offshore Wind was awarded a project for 1,510 MW.<sup>177</sup> On October 31, 2023, Ørsted announced that it was canceling two major offshore wind projects, Ocean Wind 1 (1,100 MW) and Ocean Wind 2 (1,148 MW), that were planned off the coast of New Jersey.<sup>178</sup> The Associated Press reported in May 2024 that the New Jersey and Ørsted reached a settlement that required Ørsted to pay New Jersey \$125 million.<sup>179</sup>

On January 24, 2024, the NJBPU awarded 2,400 MW of offshore wind capacity to the Leading Light Wind project and 1,342 to Attentive Energy LLC.<sup>180</sup> The Leading Light Wind project is a partnership between Invenergy and energyRE.

On December 17, 2021, the Maryland Public Service Commission awarded ORECs in its Round 2 solicitation to the 846 MW Skipjack Wind 2 offshore project, owned by Skipjack Offshore Energy LLC, an Ørsted subsidiary, and to the 808.5 MW Momentum Wind offshore project, owned by US Wind Inc.<sup>181</sup> ORECs for Skipjack Wind 2 have a levelized price of \$71.61; ORECs for Momentum Wind have a levelized price of \$54.17.<sup>182</sup> Both projects are expected to become operational before the end of 2026.<sup>183</sup> In 2017, Round 1 ORECs were awarded to Deepwater Wind's 120-MW Skipjack Wind Farm, later acquired by Ørsted, and U.S. Wind's 248 MW project.<sup>184</sup> On January 25, 2024, Ørsted announced it "has withdrawn from the Maryland Public Service Commission Orders approving the Skipjack 1 and 2 projects," noting that the OREC prices in the orders "are no longer commercially viable."<sup>185</sup>

On July 1, 2019, Dominion Energy announced the beginning of construction on an offshore wind demonstration project. The project consists of two 6 MW

offshore wind turbines.<sup>186</sup> In September 2019, Dominion filed an interconnection agreement with PJM associated with its proposal to develop a 2,600 MW offshore wind farm.<sup>187</sup>

Each PJM jurisdiction with an RPS identifies the type of generation resources that may be used for compliance. These resources are often called eligible technologies. Some PJM jurisdictions with RPS group different eligible technologies into tiers based on the magnitude of their environmental impact. Of the ten PJM jurisdictions with mandatory RPS, Maryland, New Jersey, Pennsylvania, and Washington, DC group the eligible technologies that must be used to comply with their RPS programs into Tier I and Tier II resources.<sup>188</sup> Although there are minor differences across these four jurisdictions' definitions of Tier I resources, technologies that use solar photovoltaic, solar thermal, wind, ocean, tidal, biomass, low-impact hydro, and geothermal sources to produce electricity are classified as Tier I resources. Table 8-15 shows the Tier I standards for PJM states.<sup>189</sup> All eligible technologies for the RPS standards in Table 8-15 satisfy the EIA definition of renewable energy.<sup>190</sup>

177 "NJBPU Approves Nation's Largest Combined Offshore Wind Award to Atlantic Shores and Ocean Wind II", New Jersey BPU Press Release (June 30, 2021) <<https://www.nj.gov/bpu/newsroom/2021/approved/20210630.html>>.

178 Ørsted, Ørsted ceases development of its US offshore wind projects Ocean Wind 1 and 2, takes final investment decision on Revolution Wind, and recognizes DKK 28.4 billion impairments (October 31, 2023) <<https://orsted.com/en/company-announcement-list/2023/10/orsted-ceases-development-of-its-us-offshore-wind-73751>>.

179 "New Jersey and wind farm developer Ørsted settle claims for \$125M over scrapped offshore projects", Associated Press (May 28, 2024).

180 "NJBPU Approves Over 3,700 MW of Offshore Wind Capacity in Combined Award", New Jersey BPU Press Release (January 24, 2024) <<https://www.nj.gov/bpu/newsroom/2024/approved/20240124.html>>.

181 "Ørsted, US Wind Triumph with 1.6 GW in Maryland Offshore Tender," Renewables Now (December 20, 2021) <<https://renewablesnow.com/news/orsted-us-wind-triumph-with-16-gw-in-maryland-offshore-tender-766237/>>.

182 *Id.*

183 *Id.*

184 "Ørsted Acquires Deepwater Wind and creates leading US Offshore Wind Platform," ØRSTED Press Release (August 10, 2018).

185 Skipjack Wind to be Repositioned for Future Offtake Opportunities, Ørsted (January 25, 2024) <<https://orsted.com/en/media/news/2024/01/skipjack-wind-to-be-repositioned-for-future-offtake-815811>>.

186 "Construction Begins on Dominion Energy Offshore Wind Project," Dominion Energy News Release (July 1, 2019) <<https://news.dominionenergy.com/2019-07-01-Construction-Begins-on-Dominion-Energy-Offshore-Wind-Project>>.

187 "Dominion Energy Announces Largest Offshore Wind Project in US," Dominion Energy News Release (September 19, 2019) <<https://news.dominionenergy.com/2019-09-19-Dominion-Energy-Announces-Largest-Offshore-Wind-Project-in-US>>.

188 New Jersey separates technologies into Class I/Class II resources in a manner that is consistent with the other jurisdictions' Tier I/Tier II categorizations.

189 This includes New Jersey's Class I renewable standard.

190 *Renewable Energy Explained*, U.S. Energy Information Administration, <[https://www.eia.gov/energyexplained/index.php?page=renewable\\_home](https://www.eia.gov/energyexplained/index.php?page=renewable_home)> (Accessed May 7, 2024).

**Table 8-15 Tier I / Class I renewable standards of PJM jurisdictions: 2023 to 2033<sup>191</sup>**

Jurisdiction with RPS	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033
Maryland	29.87%	33.70%	35.50%	38.00%	41.50%	43.00%	49.50%	50.00%	50.00%	50.00%	50.00%
New Jersey	27.00%	35.00%	38.00%	41.00%	44.00%	47.00%	50.00%	50.00%	50.00%	50.00%	
Pennsylvania	8.00%	8.00%	8.00%	8.00%	8.00%	8.00%	8.00%	8.00%	8.00%	8.00%	8.00%
Washington, DC	38.75%	45.00%	52.00%	59.00%	66.00%	73.00%	80.00%	87.00%	94.00%	100.00%	100.00%

Delaware, Illinois, Michigan, North Carolina, Virginia and Ohio do not classify the resources eligible for their RPS standards by tiers. In these states eligible technologies are largely but not completely renewable resources.<sup>192</sup>


RECs do not need to be used during the year in which they are generated. The result is that there may be multiple prices for a REC based on the year in which it was generated. RECs typically have a shelf life of five years during which they can be used to satisfy a state's RPS requirement. For example if a load serving entity (LSE) owns renewable generation and the renewable generation exceeds the LSE's RECs purchase obligation for the current year, the LSE can either sell the REC to another LSE or hold the REC for use in a subsequent year.

PJM GATS makes data available for the amount of eligible RECs by jurisdiction. Eligible RECs are not the amount of actual RECs generated for that timeframe. A REC that is created may be eligible in multiple jurisdictions resulting in an over representation of generated RECs. This means if one REC is retired in Pennsylvania, the total amount of eligible RECs will reduce by more than one REC.

The REC prices are the average price for each vintage of REC, defined by the year in which the associated power was generated, regardless of when the REC is consumed. REC prices are required to be publicly disclosed in Maryland, Pennsylvania and Washington, DC, but in the other states REC prices are not publicly available.

Figure 8-3 shows the annual average Tier I REC price by jurisdiction from 2009 through 2024. Tier I REC prices are lower than SREC prices. Several states have more stringent geographical restrictions for SRECs and higher alternative compliance payments (ACP) for SRECs than for RECs. For example, the average SREC price for 2024

in Washington, DC was \$383.19 and the average Tier I REC price for 2024 in Washington, DC was \$22.14. The DC RPS requires SRECs to be sourced from within DC while Tier I RECs may be sourced from anywhere within the PJM footprint. The DC solar ACP is \$400 per SREC compared to \$50 per REC for Tier I compliance.

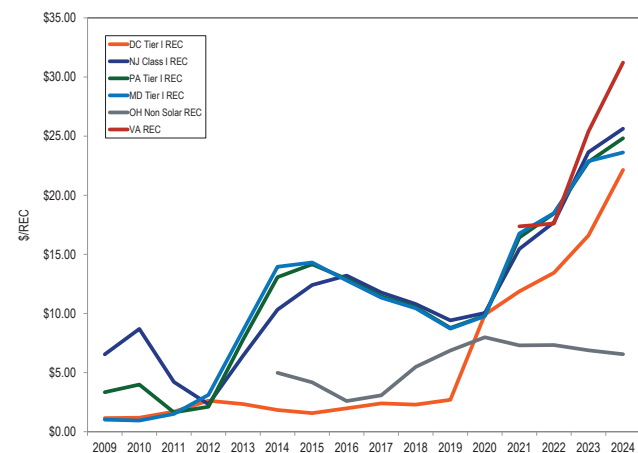
**Figure 8-3 Average Tier I REC price by jurisdiction: 2009 through 2024**

<sup>191</sup> New Jersey Administrative Code, Section 14:8-2.3 does not specify standards beyond compliance year 2032/2033.

<sup>192</sup> Michigan's Public Act 342, effective April 20, 2017, removed nonrenewable technologies (e.g. coal gasification, industrial cogeneration, and coal with carbon capture) from the list of RPS eligible technologies.

Figure 8-4 and Table 8-16 shows the fulfillment of Tier I equivalent RPS requirement for 2019 through 2023 by state and by carbon producing and noncarbon producing RECs.<sup>193</sup> Depending on the state, the RPS requirement can be fulfilled by wind, solar, hydro (“Noncarbon REC”) or with landfill gas, captured methane, wood, black liquor, and other fuels. (“Carbon Producing REC”). States’ Tier I requirements are not all carbon free. The Illinois RPS, beginning in 2019, is fulfilled by noncarbon RECs, but all other state Tier I equivalent RPS requirements allow carbon producing RECs to fulfill the RPS requirements. Figure 8-4 shows the use of in state, other PJM state and out of state carbon producing RECs and in state, other PJM state and out of state noncarbon RECs by state to meet the RPS requirements. In Table 8-16 the retired RECs are summarized by in state, other PJM state and non PJM state, and carbon producing RECs and noncarbon RECs. For example, Virginia met its 2023 RPS target using 5.1 percent carbon free RECs from Virginia, 88.6 percent carbon free RECs from other PJM states and 6.3 percent carbon producing RECs from other PJM states. Ohio met its 2023 RPS target using 1.4 percent carbon free RECs from Ohio, 37.5 percent carbon free RECs from other PJM states, 6.8 percent carbon free RECs from non PJM states, 20.8 percent carbon producing RECs from Ohio and 33.5 percent carbon producing RECs from other PJM states. Illinois met its 2023 RPS target using 81.6 percent carbon free RECs from Illinois and 18.4 percent carbon free RECs from other PJM states. Illinois met its RPS target using 100.0 percent carbon free RECs for the 2019 through 2023 compliance years.

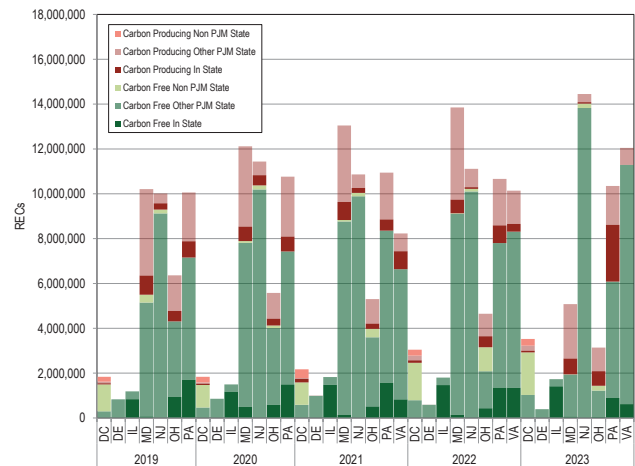**Figure 8-4 State fulfillment of Tier I equivalent RPS: 2019 through 2023**



<sup>193</sup> Retired REC information obtained through PJM GATS <<https://gats.pjm-eis.com/gats2/PublicReports/RPSRetiredCertificatesReportingYear>>. The timing of the REC retirement reports varies by state and the 2023 reporting year data is incomplete for some states.

Table 8-16 State fulfillment of Tier I equivalent RPS: 2019 through 2023

Year	REC Type	Carbon Free REC				Carbon Producing REC			
		In State	Other PJM	Non PJM	State Total	In State	Other PJM	Non PJM	State Total
2019	DE New Eligible	0.3%	99.7%	0.0%	100.0%	0.0%	0.0%	0.0%	0.0%
	DC Tier I	0.0%	16.2%	65.3%	81.5%	2.8%	4.2%	11.5%	18.5%
	OH Renewable Energy Source	14.7%	53.0%	0.0%	67.7%	7.3%	25.0%	0.0%	32.3%
	IL Renewable	70.5%	29.5%	0.0%	100.0%	0.0%	0.0%	0.0%	0.0%
	MD Tier I	0.7%	49.8%	3.4%	53.8%	8.4%	37.8%	0.0%	46.2%
	NJ Class I	0.1%	91.0%	1.7%	92.8%	2.8%	4.4%	0.0%	7.2%
	PA Tier I	17.0%	54.2%	0.0%	71.1%	7.2%	21.7%	0.0%	28.9%
2020	DE New Eligible	0.9%	99.1%	0.0%	100.0%	0.0%	0.0%	0.0%	0.0%
	DC Tier I	0.0%	25.5%	54.6%	80.1%	3.3%	2.8%	13.8%	19.9%
	OH Renewable Energy Source	10.5%	61.4%	2.0%	74.0%	5.5%	20.6%	0.0%	26.0%
	IL Renewable	78.3%	21.7%	0.0%	100.0%	0.0%	0.0%	0.0%	0.0%
	MD Tier I	4.1%	60.4%	0.7%	65.1%	5.3%	29.6%	0.0%	34.9%
	NJ Class I	0.1%	89.1%	1.6%	90.7%	4.0%	5.3%	0.0%	9.3%
	PA Tier I	13.9%	55.1%	0.0%	69.0%	6.2%	24.8%	0.0%	31.0%
2021	DE New Eligible	0.3%	99.0%	0.0%	99.3%	0.7%	0.0%	0.0%	0.7%
	DC Tier I	0.0%	27.0%	45.9%	72.9%	7.4%	1.7%	17.9%	27.1%
	OH Renewable Energy Source	9.6%	58.3%	7.0%	74.9%	4.4%	20.7%	0.0%	25.1%
	IL Renewable	81.0%	19.0%	0.0%	100.0%	0.0%	0.0%	0.0%	0.0%
	MD Tier I	1.0%	66.2%	0.5%	67.7%	6.1%	26.1%	0.0%	32.3%
	NJ Class I	0.1%	91.0%	1.4%	92.4%	2.0%	5.5%	0.0%	7.6%
	PA Tier I	14.4%	62.0%	0.0%	76.4%	4.6%	19.1%	0.0%	23.6%
2022	DE New Eligible	0.9%	99.1%	0.0%	100.0%	0.0%	0.0%	0.0%	0.0%
	DC Tier I	0.0%	26.0%	54.8%	80.8%	3.7%	6.8%	8.7%	19.2%
	OH Renewable Energy Source	9.3%	35.6%	23.0%	67.9%	10.5%	21.6%	0.0%	32.1%
	IL Renewable	81.3%	18.7%	0.0%	100.0%	0.0%	0.0%	0.0%	0.0%
	MD Tier I	1.0%	64.7%	0.2%	65.9%	4.4%	29.7%	0.0%	34.1%
	NJ Class I	0.2%	90.7%	1.0%	92.0%	0.7%	7.4%	0.0%	8.0%
	PA Tier I	12.7%	60.4%	0.0%	73.1%	7.4%	19.4%	0.0%	26.9%
2023	DE New Eligible	0.0%	100.0%	0.0%	100.0%	0.0%	0.0%	0.0%	0.0%
	DC Tier I	0.0%	29.1%	53.9%	83.0%	2.2%	6.4%	8.5%	17.0%
	OH Renewable Energy Source	1.4%	37.5%	6.8%	45.7%	20.8%	33.5%	0.0%	54.3%
	IL Renewable	81.6%	18.4%	0.0%	100.0%	0.0%	0.0%	0.0%	0.0%
	MD Tier I	1.2%	36.9%	0.2%	38.3%	13.9%	47.8%	0.0%	61.7%
	NJ Class I	0.1%	95.5%	1.4%	97.0%	0.5%	2.5%	0.0%	3.0%
	PA Tier I	8.6%	50.2%	0.0%	58.8%	24.5%	16.8%	0.0%	41.2%
2023	VA Renewable	5.1%	88.6%	0.0%	93.7%	0.0%	6.3%	0.0%	6.3%

Table 8-17 shows the percent of retail electric load that must be served by Tier II or a specific type of resource under each PJM jurisdiction's RPS by year. Tier II resources are generally not renewable resources. Table 8-17 also shows specific technology requirements that PJM jurisdictions have added to their renewable portfolio standards. The standards shown in Table 8-17 are included in the total RPS requirements presented in Table 8-13. Maryland, New Jersey and Pennsylvania have Tier II or Class II standards, which allow specific nonrenewable technology types, such as waste coal units located in Pennsylvania, to qualify for renewable energy credits. Washington, DC previously had Tier II standards. The Washington, DC tier II standard was discontinued at the end of the 2019 compliance year. By 2024, North Carolina's RPS requires that 0.2 percent of power be generated using swine waste and that 900 GWh of power be produced by poultry waste in 2020. Maryland established a minimum standard for offshore wind in 2017 that took effect in 2021 with an original requirement that 1.37 percent of load be served by offshore wind.<sup>194</sup> The standard has been revised to 0.14 percent for 2024.<sup>195</sup> The offshore wind requirement is only applicable if the Maryland offshore wind projects are producing RECs.<sup>196</sup>

<sup>194</sup> Public Service Commission of Maryland, Offshore Wind Projects, Order No. 88192 (May 11, 2017) at 8, Table 2 <<https://www.psc.state.md.us/wp-content/uploads/Order-No.-88192-Case-No.-9431-Offshore-Wind.pdf>>.

<sup>195</sup> See *Renewable Energy Portfolio Standard Report* at 5, Maryland Public Service Commissions (November 2023) <[https://www.psc.state.md.us/wp-content/uploads/CY22-RPS-Annual-Report\\_Final-w-Corrected-Appdx-A.pdf](https://www.psc.state.md.us/wp-content/uploads/CY22-RPS-Annual-Report_Final-w-Corrected-Appdx-A.pdf)>.


<sup>196</sup> Id. at footnote 13.

**Table 8-17 Additional renewable standards of PJM jurisdictions: 2023 to 2033<sup>197</sup>**

Jurisdiction	Type of Standard	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033
Maryland	Off Shore Wind	0.00%	0.14%	1.66%	2.61%	13.02%	13.02%	13.02%	13.02%	13.02%	13.02%	13.02%
Maryland	Geothermal	0.05%	0.15%	0.25%	0.50%	0.75%	1.00%	1.00%	1.00%	1.00%	1.00%	1.00%
Maryland	Tier 2	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%
New Jersey	Class II	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	
North Carolina	Swine Waste	0.14%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%
North Carolina	Poultry Waste (GWh)	900	900	900	900	900	900	900	900	900	900	900
Pennsylvania	Tier II	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%

Figure 8-5 shows the annual average Tier II REC price by jurisdiction for 2009 through September 2024. Tier II prices have been lower than Tier I REC prices in the past, but Pennsylvania and New Jersey Tier II REC prices are higher than their corresponding Tier I REC prices over the first nine months of 2024. Maryland, New Jersey and Pennsylvania are the only states with a Tier II standard in 2024.<sup>198</sup> The average Pennsylvania Tier II REC price for 2024 was \$27.22, 11.3 percent higher than the average price for 2023. The average New Jersey Class II REC price for 2024 was \$27.03, 30.3 percent higher than the average price for 2023. The average Maryland Tier II REC price for 2024 was \$12.00, 1.8 percent higher than the average price for the first 2023.<sup>199</sup>

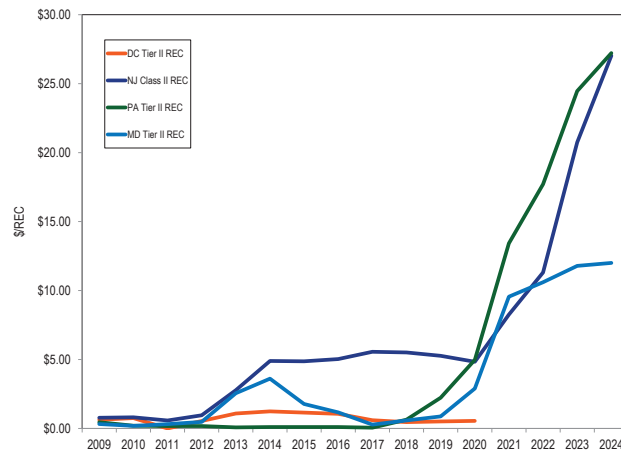**Figure 8-5 Average Tier II REC price by jurisdiction: 2009 through 2024**



Some PJM jurisdictions have specific solar resource RPS requirements. These solar requirements are included in the total requirements shown in Table 8-13 and Table 8-15 but must be met by solar RECs (SRECs). Table 8-18 shows the percent of retail electric load that must be served by solar energy resources under each PJM jurisdiction's

RPS by year. Delaware, Illinois, Maryland, New Jersey, North Carolina, Pennsylvania, and Washington, DC have requirements for the proportion of load to be served by solar. The Illinois RPS specifies the number of RECs that must be sourced from photovoltaic resources energized after June 1, 2017. Recent legislation increased the SREC requirement from 2,000,000 RECs to 5,500,000 RECs beginning with the 2021/2022 Delivery Year.<sup>200</sup> New Jersey closed registration for new SRECs on April 30, 2020, having met its milestone that solar power equal or exceed 5.1 percent of New Jersey electricity sales.<sup>201</sup> On December 6, 2019, the New Jersey Board of Public Utilities announced a transitional program for solar generators not eligible for New Jersey SRECs.<sup>202</sup> The new program establishes a 15 year fixed priced Transition REC (TREC). On July 28, 2021, New Jersey Board of Public Utilities approved the Successor Solar Incentive (SuSI) Program which will provide incentives for 3,750 MW of new solar generation by 2026.<sup>203</sup> Pennsylvania allows only solar photovoltaic resources to fulfill their solar requirements. Solar thermal units like solar hot water heaters that do not generate electricity are Tier I resources in Pennsylvania. Ohio, Michigan and Virginia have no specific solar standards. The New Jersey legislature in May 2018 increased the solar standard from 3.2 percent to 4.3 percent for 2018, 5.1 percent for 2020 through 2022 and the solar standard decreases to 1.1 percent for 2032.<sup>204</sup> Maryland legislation in 2019 increased the solar carve out percentages from 2.5 percent to 14.5 percent in 2030. Ohio HB 6 removed the solar carve out from the Ohio RPS.<sup>205</sup> The Delaware General Assembly passed

<sup>200</sup> See amendments to Sec. 1-75(c)(1)(C) of the Illinois Power Agency Act contained in Section 90-30 of Public Act 102-0662.

<sup>201</sup> See Clean Energy Act of 2019 (NJ AB-2723); N.J.A.C. 14:82.4(b)6; BPU, Monthly Report on Status toward Attainment of the 5.1 percent Milestone for Closure of the SREC Program (March 31, 2020).

<sup>202</sup> "New Jersey Board of Public Utilities Approves Solar Transition Program, Initiates a Cost Cap Proceeding," New Jersey Board of Public Utilities Press Release (December 6, 2019) <<https://www.bpu.state.nj.us/bpu/newsroom/2019/approved/20191206.html>>.

<sup>203</sup> "NJBPB Approves 3,750 MW Successor Solar Incentive Program," New Jersey Board of Public Utilities Press Release (July 28, 2021) <<https://www.nj.gov/bpu/newsroom/2021/approved/20210728.html>>.

<sup>204</sup> "Assembly, No. 3723," State of New Jersey, 218<sup>th</sup> Legislature (March 22, 2018), <[http://www.njleg.state.nj.us/2018/Bills/A4000/3723\\_11.PDF](http://www.njleg.state.nj.us/2018/Bills/A4000/3723_11.PDF)>.

<sup>205</sup> Ohio Legislature House, 133<sup>rd</sup> Assembly, Bill No. 6, "Ohio Clean Air Program," effective Date October 22, 2019, <<https://www.legislature.ohio.gov/legislation/legislation-summary?id=GA133-HB-6>>.

<sup>197</sup> New Jersey Administrative Code, Section 14:8-2.3 does not specify standards beyond compliance year 2032/2033.

<sup>198</sup> The District of Columbia dropped Tier II RECs from their RPS in 2021.

<sup>199</sup> Tier II REC price information obtained through Evolution Markets, Inc.




new RPS legislation on February 10, 2021 that increased the solar carve out target from 3.5 percent in 2025 to 10.0 percent in 2035.<sup>206</sup>

**Table 8-18 Solar renewable standards by percent of electric load for PJM jurisdictions: 2023 to 2033<sup>207 208</sup>**

Jurisdiction with RPS	2023	2024	2025	2026	2027	2028	2029	2030	2031	2032	2033
Delaware	3.00%	3.25%	3.50%	3.75%	4.00%	4.25%	4.50%	5.00%	5.80%	6.60%	7.40%
Illinois (GWh)	5,500	5,500	5,500	5,500	5,500	5,500	5,500	24,750	24,750	24,750	24,750
Maryland	6.00%	6.50%	7.00%	8.00%	9.50%	11.00%	12.50%	14.50%	14.50%	14.50%	14.50%
New Jersey	4.90%	4.80%	4.50%	4.35%	3.74%	3.07%	2.21%	1.58%	1.40%	1.10%	
North Carolina	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%
Pennsylvania	0.50%	0.50%	0.50%	0.50%	0.50%	0.50%	0.50%	0.50%	0.50%	0.50%	0.50%
Washington, DC	2.85%	3.15%	3.45%	3.75%	4.10%	4.50%	4.75%	5.00%	5.25%	5.50%	6.00%

Figure 8-6 shows the annual average solar REC (SREC) price by jurisdiction for 2009 through 2024. The average NJ SREC price was \$192.82 for 2024. The limited supply of solar facilities in Washington, DC compared to the RPS requirement results in higher SREC prices. The average Washington, DC SREC price was \$383.19 for 2024, an 9.7 percent decrease compared to the DC SREC price for 2023.<sup>209</sup> The solar alternative compliance payment (SACP) level dropped from \$500 to \$400 for the 2024 compliance year.

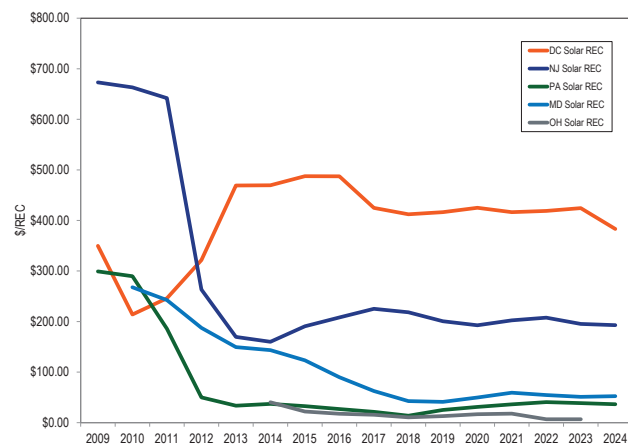**Figure 8-6 Average SREC price by jurisdiction: 2009 through 2024**



<sup>206</sup> See Senate Bill 33, Delaware General Assembly (February 10, 2021) <<https://legis.delaware.gov/BillDetail?legislationId=48278>>.


<sup>207</sup> The Illinois solar standard currently requires 5.5 million RECs from solar photovoltaic projects energized after June 1, 2017. Illinois Public Act 102-0662, September 15, 2021.

<sup>208</sup> New Jersey Administrative Code, Section 14:8-2.3 does not specify standards beyond compliance year 2032/2033.

<sup>209</sup> Solar REC average price information obtained through Evolution Markets, Inc. <<http://www.evomarkets.com>>.

Figure 8-7 and Table 8-19 show where the SRECs originated that are used to satisfy the states' solar requirement for 2018 through 2023.<sup>210</sup> Depending on the state, the solar RPS requirement can be fulfilled by in state or out of state SRECs. The SRECs purchased in some states are imported from other PJM states and from non PJM states. Table 8-19 shows the percent of local SRECs, SRECs from other PJM states and SRECs from non PJM states used to meet the RPS requirements. Since 2020, all SRECs used for RPS compliance in Illinois, Maryland, Pennsylvania and New Jersey have been sourced from in state solar generators.

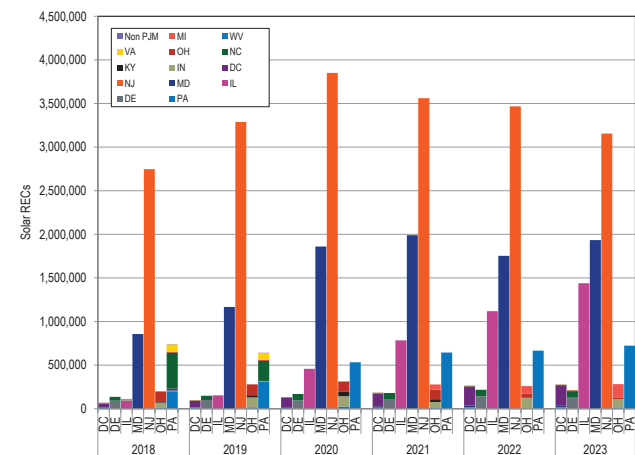**Figure 8-7 State fulfillment of Solar RPS: 2017 through 2023**



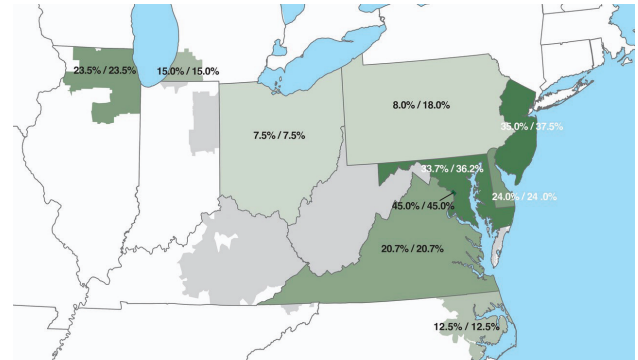
<sup>210</sup> Retired REC information obtained through PJM GATS <<https://gats.pjm-eis.com/gats2/PublicReports/RPSRetiredCertificatesReportingYear>> (Accessed July 15, 2024). The timing of the REC retirement reports varies by state and the 2023 reporting year data is incomplete for some states.

**Table 8-19 State fulfillment of Solar RPS: 2018 through 2023**

		In State	Other PJM State	Non PJM State
2018	DC Solar	67.4%	31.7%	0.9%
	DE Solar Eligible	67.7%	32.3%	0.0%
	IL Solar Renewable	82.9%	17.0%	0.1%
	MD Solar	100.0%	0.0%	0.0%
	NJ Solar	100.0%	0.0%	0.0%
	OH Solar Renewable Energy Source	59.5%	40.5%	0.0%
	PA Solar	27.1%	72.9%	0.0%
2019	DC Solar	72.4%	26.9%	0.7%
	DE Solar Eligible	67.8%	32.2%	0.0%
	IL Solar Renewable	100.0%	0.0%	0.0%
	MD Solar	100.0%	0.0%	0.0%
	NJ Solar	100.0%	0.0%	0.0%
	OH Solar Renewable Energy Source	43.6%	56.4%	0.0%
	PA Solar	48.8%	51.2%	0.0%
2020	DC Solar	81.5%	18.1%	0.4%
	DE Solar Eligible	56.7%	43.3%	0.0%
	IL Solar Renewable	100.0%	0.0%	0.0%
	MD Solar	100.0%	0.0%	0.0%
	NJ Solar	100.0%	0.0%	0.0%
	OH Solar Renewable Energy Source	36.8%	63.2%	0.0%
	PA Solar	100.0%	0.0%	0.0%
2021	DC Solar	78.0%	21.6%	0.3%
	DE Solar Eligible	62.3%	37.7%	0.0%
	IL Solar Renewable	100.0%	0.0%	0.0%
	MD Solar	100.0%	0.0%	0.0%
	NJ Solar	100.0%	0.0%	0.0%
	OH Solar Renewable Energy Source	40.2%	59.8%	0.0%
	PA Solar	100.0%	0.0%	0.0%
2022	DC Solar	81.9%	17.9%	0.2%
	DE Solar Eligible	65.8%	34.2%	0.0%
	IL Solar Renewable	100.0%	0.0%	0.0%
	MD Solar	100.0%	0.0%	0.0%
	NJ Solar	100.0%	0.0%	0.0%
	OH Solar Renewable Energy Source	17.3%	82.7%	0.0%
	PA Solar	100.0%	0.0%	0.0%
2023	DC Solar	82.2%	17.6%	0.3%
	DE Solar Eligible	63.7%	36.3%	0.0%
	IL Solar Renewable	100.0%	0.0%	0.0%
	MD Solar	100.0%	0.0%	0.0%
	NJ Solar	100.0%	0.0%	0.0%
	OH Solar Renewable Energy Source	6.2%	93.8%	0.0%
	PA Solar	100.0%	0.0%	0.0%

Figure 8-8 shows the percent of retail electric load that must be served by Tier I resources and Tier 2 resources in each PJM jurisdiction with a mandatory RPS. For each state in Figure 8-8, the first number represents the RPS percent for Tier I where defined, or renewable energy resources where tiers are not defined; the second number represents the RPS percent for all eligible technologies which includes both renewable and alternative energy resources. States with higher percent requirements for renewable energy resources are shaded darker.

Jurisdictions with no standards or with only voluntary RPS are shaded gray. Pennsylvania's RPS illustrates the need to differentiate between percent requirements for renewable and alternative energy resources. The Pennsylvania RPS identifies solar photovoltaic, solar thermal, wind, geothermal, biomass, and low-impact hydropower as Tier I resources. The Pennsylvania RPS identifies waste coal, demand side management, large-scale hydropower, integrated gasification combined cycle, clean coal and municipal solid waste as eligible Tier II resources. As a result, the 18.0 percent number in Figure 8-8 overstates the percent of retail electric load in Pennsylvania that must be served by renewable energy resources. The 8.0 percent number in Figure 8-8 is a more accurate measure of the percent of retail electric load in Pennsylvania that must be served by renewable energy resources.

**Figure 8-8 Map of retail electric load shares under RPS – Renewable / Alternative Energy resources: 2024<sup>211</sup>**

Under the existing state renewable portfolio standards, 18.4 percent of PJM load should have been served by Tier I and Tier II renewable and alternative energy resources in 2024. Tier I resources include landfill gas, run of river hydro, wind and solar resources. Tier II resources include pumped storage, large scale hydro, solid waste and waste coal resources. In 2024, only 8.7 percent of PJM generation was produced by renewable and alternative energy resources, including carbon producing and noncarbon producing Tier I and Tier II generation as shown in Table 8-20. If the proportion of load among states remains constant, 25.4 percent of PJM load must be served by Tier I and Tier II renewable and alternative energy resources in 2030 under currently defined RPS rules. Approximately 16.1 percent of PJM

<sup>211</sup> The standards in this chart include the Tier I standards used by some states in the PJM footprint, as well as the total alternative energy standard for states that do not classify eligible technologies into tiers.

load should have been served by Tier I or renewable energy resources in 2024. In 2024, only 7.0 percent of PJM generation was Tier I or renewable energy. The current REC production from PJM generation resources was not enough to meet the state renewable requirements for 2024, and LSEs purchased RECs from non PJM resources (e.g. behind the meter rooftop solar) and RECs from resources outside the PJM footprint (Table 8-21). LSEs that are unable to meet the RPS with RECs may use alternative compliance payments for unmet goals based on each state's requirements. If the proportion of load among states remains constant, 23.1 percent of PJM load must be served by Tier I or renewable energy resources in 2030 under defined RPS rules.

In jurisdictions with an RPS, load serving entities must either generate power from eligible technologies identified in each jurisdiction's RPS or purchase RECs from resources classified as eligible technologies. Table 8-20 shows generation by jurisdiction and resource type for 2024. Wind generation accounted for 31,392.5 GWh of the 59,095.9 Tier I GWh, or 53.1 percent. As shown in Table 8-20, 73,690.1 GWh were generated by Tier I and Tier II resources, of which Tier I resources accounted for 80.2 percent. Wind and solar generation (noncarbon producing) was 5.8 percent of total generation in PJM in 2024. Tier I generation was 7.0 percent of total generation in PJM and Tier II was 1.7 percent of total generation in PJM in 2024. Biofuel, landfill gas, pumped storage hydro, solid waste and waste coal (carbon producing) accounted for 15,227.4 GWh, or 20.7 percent of the total Tier I and Tier II generation.

PJM states with RPS rely heavily on imports and generation from behind the meter resources for RPS compliance. In 2024, Tier I generation in PJM met only 46.9 percent of the Tier I RPS requirements. Table 8-21 compares each state's RPS requirement for 2024 with generation by RPS eligible PJM generators. Illinois had sufficient in state generation to cover 76.1 percent of the RPS requirement and Pennsylvania generation was sufficient to cover 75.7 percent of the Tier I RPS requirement and 54.1 percent of the Tier II RPS requirement. North Carolina generation is 6.5 times higher than the RPS requirement in; but a relatively small portion of the North Carolina load is in PJM. Overall there was sufficient generation by PJM generators to meet 46.9 percent of the Tier I RPS requirement and 80.1 percent of the Tier II RPS requirement for 2024. RPS compliance reports indicate that almost all of the RPS requirement is met with the purchase or acquisition of RECs, with only a very small amount of the requirement fulfilled through alternative compliance payments. A large portion of the Tier I RPS requirement is satisfied by behind the meter generation in the PJM states and to a lesser extent, through the purchase of RECs from non PJM states.

**Table 8-20 Tier I and Tier II generation by jurisdiction and renewable resource type (GWh): 2024**

Jurisdiction	Tier I						Tier II					Total Tier II Credit	Total Credit GWh
	Biofuel	Landfill Gas	Run of River	Other Hydro	Solar	Wind	Total Tier I Credit	Pumped-Storage Hydro	Other Hydro	Solid Waste	Waste Coal		
Delaware	0.0	12.4	0.0	0.0	97.6	0.0	110.0	0.0	0.0	0.0	0.0	0.0	110.0
Illinois	0.0	63.8	0.0	0.0	190.3	15,602.8	15,856.9	0.0	0.0	0.0	0.0	0.0	15,856.9
Indiana	0.0	19.3	0.0	35.9	1,121.0	6,545.8	7,722.1	0.0	0.0	0.0	0.0	0.0	7,722.1
Kentucky	0.0	0.0	261.3	60.0	206.3	0.0	527.6	0.0	0.0	0.0	0.0	0.0	527.6
Maryland	0.0	27.3	0.0	0.0	859.2	754.6	1,641.1	0.0	0.0	1,096.3	0.0	1,096.3	2,737.4
Michigan	0.0	54.1	0.0	58.6	6.6	0.0	119.3	0.0	0.0	0.0	0.0	0.0	119.3
New Jersey	0.0	107.5	3.6	0.0	924.9	9.7	1,045.7	609.0	0.0	0.0	0.0	609.0	1,654.7
North Carolina	0.0	0.0	607.0	0.0	2,352.2	556.2	3,515.4	0.0	0.0	0.0	0.0	0.0	3,515.4
Ohio	0.0	81.3	839.3	0.0	4,332.2	2,748.8	8,001.5	0.0	0.0	0.0	0.0	0.0	8,001.5
Pennsylvania	0.0	271.4	4,389.6	20.4	1,002.1	3,293.7	8,977.1	2,821.4	0.0	40.6	5,154.3	8,016.3	16,993.4
Tennessee	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Virginia	1,249.4	430.2	841.0	58.1	6,212.6	50.4	8,841.7	2,534.2	1,713.3	16.4	0.0	4,263.9	13,105.6
Washington, D.C.	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
West Virginia	0.0	29.7	682.8	0.0	194.5	1,830.4	2,737.4	0.0	0.0	608.8	0.0	608.8	3,346.2
Total	1,249.4	1,097.0	7,624.6	233.0	17,499.3	31,392.5	59,095.9	5,964.5	1,713.3	1,153.3	5,763.1	14,594.3	73,690.1

**Table 8-21 RPS Requirements and Generation by RPS Eligible Resources: 2024**

Jurisdiction	Tier I			Tier II		
	PJM Generation (GWh)	RPS Requirement (GWh)	Generation as Percent of RPS Requirement	PJM Generation (GWh)	RPS Requirement (GWh)	Generation as Percent of RPS Requirement
Delaware	110.0	2,853.1	3.9%	0.0	0.0	
Illinois	15,856.9	20,832.1	76.1%	0.0	0.0	
Indiana	7,722.1	0.0		0.0	0.0	
Kentucky	527.6	0.0		0.0	0.0	
Maryland	1,641.1	20,538.3	8.0%	1,096.3	1,523.6	72.0%
Michigan	119.3	661.2	18.0%	0.0	0.0	
New Jersey	1,045.7	23,966.4	4.4%	609.0	1,874.0	32.5%
North Carolina	3,515.4	542.8	647.6%	0.0	0.0	
Ohio	8,001.5	11,830.8	67.6%	0.0	0.0	
Pennsylvania	8,977.1	11,858.1	75.7%	8,016.3	14,822.6	54.1%
Tennessee	0.0	0.0		0.0	0.0	
Virginia	8,841.7	28,561.6	31.0%	4,263.9	0.0	
Washington, D.C.	0.0	4,419.5	0.0%	0.0	0.0	
West Virginia	2,737.4	0.0		608.8	0.0	
Total	59,095.9	126,064.0	46.9%	14,594.3	18,220.2	80.1%

Table 8-22 shows the summer installed capacity rating of Tier I and Tier II wholesale capacity resources in PJM by jurisdiction, as defined by primary fuel type. This capacity includes coal, natural gas and oil units that qualify as Tier II because they have a secondary fuel capability that satisfies the alternative energy standards of a PJM state or jurisdiction. For example, a coal generator that can also burn waste coal to generate power could list the alternative fuel as waste coal. A REC is only generated when the unit is operating using the fuel listed as Tier I or Tier II. Virginia has the largest amount of solar capacity in PJM, 4,000.7 MW, or 32.3 percent of the total solar capacity. Wind resources located in western PJM, Illinois, Indiana and Ohio, account for 8,531.8 MW, or 74.2 percent of the total wind capacity.

Under the pre ELCC rules that were in effect up to the start of the 2023/2024 Delivery Year, a generator's capacity value was derated from the installed capacity level by multiplying the generator's net maximum capability by a derating factor. The derating factor was either based on the generator's historical performance during summer peak hours or a class average value calculated by PJM. The intent of the pre ELCC method was to obtain a MW value the generator can reliably produce during the summer peak hours.<sup>212</sup> An average ELCC method was used to determine the capacity values for intermittent and storage resources for the 2023/2024 Delivery Year and the 2024/2025 Delivery Year.<sup>213</sup> As of December 31,

<sup>212</sup> See Appendix B in "PJM Manual 21: Rules and Procedures for Determination of Generating Capability," <<https://pjm.com/-/media/documents/manuals/m21.ashx>>.

<sup>213</sup> See Capacity Value of Intermittent Resources (ELCC) in *2024 Quarterly State of the Market Report for PJM: January through March*, Section 5: Capacity Market.

2024, the derated capacity for PJM capacity resources includes 3,594.8 MW of wind resources and 5,046.5 MW of solar resources. This compares to installed wind capacity of 11,628.4 MW in Table 8-33 and installed solar capacity of 10,109.6 MW in Table 8-37. Wind generators have higher derating factors during the winter months (November through April) because PJM rules make winter capacity interconnection rights (CIRs) available. The derated

ICAP corresponding to wind capacity resources on July 1, 2024 was 1,717.1 MW. The 1,877.7 MW difference between the winter derated wind capacity of 3,594.8 MW and summer derated wind capacity of 1,717.1 MW is a result of winter CIRs that are provided to wind without charge. PJM's practice of giving away winter CIRs, that appear to be available because other resources paid for the supporting network upgrades, requires annual capacity resources to subsidize the interconnection costs of intermittent resources and artificially increases the capacity value of the winter resources. PJM should ensure that the winter capacity value of thermal resources is not inefficiently constrained by the failure to assign winter CIRs to thermal resources.

There were two pre ELCC classes of wind based on location with class average capacity factors of 14.7 percent and 17.6 percent.

Table 8-22 Renewable capacity by jurisdiction (MW): December 31, 2024<sup>214</sup>

Jurisdiction	Biofuel	Coal / Biofuel	Hydro	Landfill Gas	Natural Gas /		Other Gas	Oil / Biofuel	Landfill Gas	Pumped-Storage Hydro	Solar	Solid Waste	Waste Coal	Waste Heat	Wind	Total
					Gas / CMG	Gas / Landfill Gas										
Delaware	0.0	0.0	0.0	8.1	0.0	1,797.0	0.0	0.0	13.0	0.0	50.0	0.0	0.0	0.0	0.0	1,868.1
Illinois	0.0	0.0	0.0	15.0	0.0	0.0	0.0	0.0	0.0	0.0	136.3	0.0	0.0	0.0	5,135.7	5,287.0
Indiana	0.0	0.0	8.2	3.2	0.0	0.0	0.0	0.0	0.0	0.0	1,421.2	0.0	0.0	0.0	2,350.5	3,783.0
Kentucky	0.0	0.0	132.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	289.0	0.0	0.0	0.0	0.0	421.7
Maryland	0.0	0.0	0.0	19.9	0.0	0.0	0.0	69.0	0.0	0.0	615.3	191.2	0.0	0.0	243.7	1,139.1
Michigan	0.0	0.0	13.9	12.0	0.0	0.0	0.0	0.0	0.0	0.0	4.6	0.0	0.0	0.0	0.0	30.5
Missouri	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	146.0	146.0
New Jersey	0.0	0.0	11.0	33.9	0.0	0.0	0.0	0.0	0.0	453.0	748.9	204.6	0.0	0.0	4.5	1,455.7
North Carolina	0.0	0.0	325.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,658.6	0.0	0.0	0.0	208.0	2,191.6
Ohio	0.0	1,020.0	194.4	14.4	0.0	0.0	1.0	136.0	0.0	0.0	3,999.0	0.0	0.0	134.0	1,045.6	6,544.4
Pennsylvania	54.0	0.0	1,387.3	111.0	1,105.0	1,300.0	0.0	0.0	0.0	1,269.0	949.6	209.3	1,347.0	0.0	1,545.2	9,277.4
Tennessee	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Virginia	241.9	585.0	436.4	127.7	0.0	0.0	88.0	10.0	0.0	5,386.0	4,386.3	60.0	0.0	0.0	12.0	11,333.2
Washington, D.C.	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
West Virginia	0.0	0.0	209.9	8.0	0.0	0.0	0.0	0.0	0.0	0.0	129.0	0.0	96.0	0.0	802.3	1,245.2
PJM Total	295.9	1,605.0	2,718.7	353.1	1,105.0	3,097.0	89.0	215.0	13.0	7,108.0	14,387.7	665.0	1,443.0	134.0	11,493.5	44,722.9

There were three pre ELCC classes of solar generators with capacity factors ranging from 38.0 percent to 60.0 percent.<sup>215</sup> For the 2023/2024 Delivery Year, the ELCC rating for solar generators with fixed panels was 50.0 percent, the ELCC rating for solar generators with tracking panels was 61.0 percent, and the ELCC rating for onshore wind generators was 15.0 percent.<sup>216</sup> For the 2024/2025 Delivery Year, the ELCC rating for solar generators with fixed panels is 33.0 percent, the ELCC rating for solar generators with tracking panels is 50.0 percent, and the ELCC rating for onshore wind generators is 21.0 percent.

Table 8-23 shows renewable capacity registered in the PJM generation attribute tracking system (GATS).<sup>217</sup> These resources are not PJM wholesale market resources even though most are located in PJM states. For example, roof top solar panels within the PJM footprint generate SRECs but are not PJM wholesale market units. These nonwholesale resources include solar capacity of 12,613.1 MW of which 3,970.7 MW are in New Jersey. These nonwholesale resources can earn renewable energy credits, and can be used to fulfill the renewable portfolio standards in PJM jurisdictions. There are also 1,933.5 MW of GATS capacity located in jurisdictions outside PJM that are eligible to sell RECs in at least one PJM jurisdiction.

<sup>214</sup> "Renewable Generators Registered in GATS", PJM EIS <<https://www.pjm-eis.com/reports-and-events/public-reports>>. Capacity in ICAP.

<sup>215</sup> Id.

<sup>216</sup> ELCC Class Ratings for 2023/2024 3IA, 2024/2026 BRA and 2026/2027 BRA, PJM Interconnection, LLC. (January 6, 2023) <<https://www.pjm.com/planning/resource-adequacy-planning/effective-load-carrying-capability>>.

<sup>217</sup> PJM Environmental Information Services (EIS), an unregulated subsidiary of PJM, operates the generation attribute tracking system (GATS), which is used by many jurisdictions to track these renewable energy credits. GATS publishes details on every renewable generator registered within the PJM footprint and aggregate emissions of renewable generation, but does not publish generation data by unit and does not make unit data available to the MMU.



Table 8-23 Renewable capacity by jurisdiction, non-PJM units registered in GATS (MW): December 31, 2024<sup>218</sup>

Jurisdiction	Biofuel	Coal / Biofuel	Fuel Cell	Geothermal	Hydro	Landfill Gas	Natural Gas / CMG	Natural Gas / Distributed Generation	Other Gas	Solar	Solid Waste	Waste Coal	Waste Heat	Wind	Total
Alabama	54.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	54.0
Delaware	0.0	0.0	0.0	0.0	0.0	4.2	0.0	0.0	0.0	178.6	0.0	0.0	0.0	2.0	184.8
Georgia	0.0	0.0	0.0	0.0	0.0	27.1	0.0	0.0	0.0	152.2	0.0	0.0	0.0	0.0	179.3
Illinois	0.0	0.0	0.0	0.2	20.0	43.8	0.0	0.0	2.2	1,967.2	0.0	0.0	0.0	548.8	2,582.1
Indiana	0.0	0.0	0.0	0.0	53.7	47.2	0.0	0.0	0.0	195.2	0.0	0.0	94.6	180.0	570.8
Iowa	0.0	0.0	0.0	0.0	0.0	1.6	0.0	0.0	0.0	2.1	0.0	0.0	0.0	495.6	499.3
Kentucky	93.0	600.0	0.0	0.0	164.8	20.2	0.0	0.0	0.0	44.1	0.0	0.0	0.0	0.0	922.2
Maryland	18.5	0.0	0.6	76.5	0.4	4.0	0.0	0.0	0.0	1,723.6	10.0	0.0	0.0	0.3	1,833.8
Michigan	31.0	0.0	0.0	0.0	17.2	5.6	0.0	0.0	0.0	107.3	0.0	0.0	0.0	6.8	167.9
Minnesota	0.0	0.0	0.0	0.0	36.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	36.0
Missouri	0.0	0.0	0.0	0.0	0.0	5.6	0.0	0.0	0.0	61.2	0.0	0.0	0.0	693.0	759.8
New Jersey	0.0	0.0	0.8	0.0	0.0	9.5	0.0	0.0	15.4	3,970.7	0.0	0.0	0.0	3.1	3,999.5
New York	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.4	0.0	0.0	0.0	0.0	0.4
North Carolina	151.5	0.0	0.0	0.0	430.4	0.0	0.0	0.0	0.0	1,309.3	0.0	0.0	0.0	0.0	1,891.2
North Dakota	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	360.0	360.0
Ohio	92.8	0.0	0.0	0.0	3.0	19.7	0.0	0.0	47.2	340.6	0.0	0.0	34.0	56.6	593.9
Pennsylvania	62.2	109.7	10.1	0.0	56.5	46.2	0.0	36.6	99.8	1,066.3	0.2	510.2	57.6	3.2	2,058.6
South Carolina	0.0	0.0	0.0	0.0	63.0	26.6	0.0	0.0	0.0	91.3	0.0	0.0	0.0	0.0	180.9
Tennessee	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Virginia	287.6	0.0	0.0	0.0	30.8	4.8	0.0	0.0	3.5	1,094.6	20.0	0.0	42.0	0.0	1,483.3
Washington, D.C.	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	49.4	254.8	0.0	0.0	27.7	0.0	331.9
West Virginia	0.0	0.0	0.0	0.0	102.0	0.0	0.0	0.0	0.0	53.5	0.0	0.0	0.0	0.0	155.5
Wisconsin	44.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	44.7
Total	835.1	709.7	11.5	76.8	977.7	266.0	0.0	36.6	217.4	12,613.1	30.2	510.2	255.9	2,349.4	18,889.8

Renewable energy credits are related to the production and purchase of wholesale power, but are not, when they constitute a transaction separate from a wholesale sale of power, subject to FERC regulation.<sup>219</sup> REC markets are, as an economic fact, integrated with PJM markets including energy and capacity markets, but are not formally recognized as part of PJM markets. Revenues from REC markets are revenues for PJM resources earned in addition to revenues earned from the sale of the same MWh in PJM markets. REC revenues are included in net revenues in unit offers in the capacity market and the treatment of RECs in unit cost-based offers is included in unit fuel cost policies.

Delaware, North Carolina, Michigan and Virginia allow various types of resources to earn multiple RECs per MWh, though typically one REC is equal to one MWh. For example, Delaware provided a three MWh REC for each MWh produced by in state customer sited photovoltaic generation and fuel cells using renewable fuels that are installed on or before December 31, 2014.<sup>220</sup> This is equivalent to providing a REC price equal to three times its stated value per MWh.

In addition to GATS, there are several other REC tracking systems used by states in the PJM footprint. Illinois, Indiana and Ohio use both GATS and M-RETS, the REC tracking system for resources located in the Midcontinent ISO, to track the sales of RECs used to fulfill their RPS requirements. Michigan and North Carolina have created their own state tracking systems, MIRECS and NC-RETS, through which all RECs used to satisfy these states' RPS requirements must ultimately be traded. Table 8-24 shows the REC tracking systems used by each state within the PJM footprint. To ensure a REC is only used one time, REC tracking systems must keep an account of a REC from its creation until its retirement. A REC is considered to be retired when it has been used to satisfy an obligation associated with an RPS.

218 See PJM-EIS (Environmental Information Services), Generation Attribute Tracking System, "Renewable Generators Registered in GATS," <<https://gats.pjm-eis.com/gats2/PublicReports/RenewableGeneratorsRegisteredinGATS>>.

219 See *WSP, Inc.*, 139 FERC ¶ 61,051 at P 18 (2012) ("we conclude that unbundled REC transactions fall outside of the Commission's jurisdiction under sections 201, 205 and 206 of the FPA. We further conclude that bundled REC transactions fall within the Commission's jurisdiction under sections 201, 205 and 206 of the FPA"); citing *American Ref-Fuel Company, et al.*, 105 FERC ¶ 61,004 at PP 23-24 (2003) ("American Ref-Fuel, 105 FERC ¶ 61,004 at PP 23-24 ("RECs are created by the States. They exist outside the confines of PURPA... And the contracts for sales of QF capacity and energy, entered into pursuant to PURPA, ... do not control the ownership of RECs."); see also *Williams Solar LLC and Allico Finance Limited*, 156 FERC ¶ 61,042 (2016).

220 Delaware Code, Title 26, Chapter 1, Subchapter III-A, Section 356(a).

**Table 8-24 REC tracking systems in PJM states with renewable portfolio standards**

Jurisdiction with RPS	REC Tracking System Used	
Delaware	PJM-GATS	
Illinois	PJM-GATS	M-RETS
Maryland	PJM-GATS	
Michigan		MIRECS
New Jersey	PJM-GATS	
North Carolina		NC-RETS
Ohio	PJM-GATS	M-RETS
Pennsylvania	PJM-GATS	
Virginia	PJM-GATS	
Washington, D.C.	PJM-GATS	
<b>Jurisdiction with Voluntary Standard</b>		
Indiana	PJM-GATS	M-RETS

All PJM states with renewable portfolio standards have established geographical restrictions governing the source of RECs to satisfy states' standards. Table 8-25 describes these restrictions. Indiana, Illinois, Michigan, and Ohio all have provisions in their renewables standards that require all or a portion of RECs used to comply with each state's standards to be generated by in state resources. Illinois recently relaxed the geographic restrictions to allow RECs sourced from wind or photovoltaic resources that are deliverable to Illinois or an adjacent state via high voltage direct current transmission. North Carolina has provisions that require RECs to be purchased from in state resources but Dominion, the only utility located in both North Carolina and PJM, is exempt from these provisions. Pennsylvania added a provision in 2017 that requires SRECs used to comply with Pennsylvania's solar photovoltaics carve out standard to be sourced from resources located in Pennsylvania.

In addition, Pennsylvania and Virginia require that RECs used for RPS compliance be produced from resources located within the PJM footprint. Delaware requires that RECs used for compliance with its RPS are produced from resources located within the PJM footprint or resources located elsewhere if these resources can demonstrate that the power they produce is directly deliverable to Delaware. The District of Columbia, Maryland and New Jersey allow RECs to be purchased from resources located within PJM in addition to large areas that adjoin PJM for compliance with their standards.

**Table 8-25 Geographic restrictions on REC purchases for renewable portfolio standard compliance in PJM states**

State with RPS	RPS Contains In-state Provision	Geographical Requirements for RPS Compliance
Delaware	No	RECs must be purchased from resources located either within PJM or from resources outside of PJM that are directly deliverable into Delaware.
Illinois	Yes	All RECs must be purchased from resources located within Illinois or from resources located in adjacent states that meet certain public interest criteria or from utility scale wind or photovoltaic resources that are deliverable to Illinois or an adjacent state via high voltage direct current transmission.
Maryland	No	RECs must come from within PJM, 10-30 miles offshore the coast of Maryland or from a control area adjacent to PJM that is capable of delivering power into PJM.
Michigan	Yes	RECs must either come from resources located within Michigan or anywhere in the service territory of retail electric provider in Michigan that is not an alternative electric supplier. There are many exceptions to these requirements (see Michigan S.B. 213).
New Jersey	No	RECs must either be purchased from resources located within PJM or from resources located outside of PJM for which the energy associated with the REC is delivered to PJM via dynamic scheduling.
North Carolina	Yes	Dominion, the only utility located in both the state of North Carolina and PJM, may purchase RECs from anywhere. Other utilities in North Carolina not located in PJM are subject to different REC requirements (see G.S. 62-113.8).
Ohio	Yes	All RECs must be generated from resources that are located in the state of Ohio or have the capability to deliver power directly into Ohio. Any renewable facility located in a state contiguous to Ohio has been deemed deliverable into the state of Ohio. For renewable resources in noncontiguous states, deliverability must be demonstrated to the Public Utilities Commission of Ohio.
Pennsylvania	Yes	RECs must be purchased from resources located within PJM. All SRECs used for compliance with the Solar PV standard must source from solar PV resources within the state of Pennsylvania.
Virginia	No	RECs must be purchased from resources located within PJM
Washington, D.C.	No	RECs must be purchased from either a PJM state or a state adjacent with PJM. A PJM state is defined as any state with a portion of their geographical boundary within the footprint of PJM. An adjacent state is defined as a state that lies next to a PJM state, i.e. SC, GA, AL, AR, IA, NY, MO, MS, and WI.

## Alternative Compliance Payments

PJM jurisdictions have various methods for enforcing compliance with required renewable portfolio standards. If a retail supplier is unable to comply with the renewable portfolio standards required by the jurisdiction, suppliers may make alternative compliance payments (ACPs), with varying standards, to cover any shortfall between the RECs required by the state and those the retail supplier actually purchased. The ACPs, which are penalties, generally function as a cap on the market value of RECs, although in Pennsylvania the solar ACP is dependent upon the price of solar RECs retired during the year. In New Jersey, solar ACPs are currently \$208 per MWh.<sup>221</sup> In Pennsylvania, the ACP for tier I and tier II RECs is \$45 per MWh and the solar ACPs is 200 percent of the average credit price of Pennsylvania solar RECs sold during the reporting year plus the value of any solar rebates in other PJM states. The most recent ACP for Pennsylvania solar is \$84.96.<sup>222</sup> Delaware recently reduced the solar ACP from \$400 per credit to \$150 per credit.<sup>223</sup> Maryland reduced the solar ACP from \$100 per credit to \$60 per credit effective June 1, 2021.<sup>224</sup> The Washington DC solar ACP was reduced from \$500 per credit to \$400 per credit for 2024.<sup>225</sup>

Figure 8-9 shows the historical relationship between SREC prices and ACP levels. The SREC price is represented by a solid line in the figure and the corresponding ACP level is represented by a dashed line. For each jurisdiction, the ACP is an upper bound for the price level. In Michigan and North Carolina, there are no defined values for ACPs. The public utility commissions in Michigan and North Carolina have discretionary power to assess what a load serving entity must pay for any RPS shortfalls.

Table 8-26 shows the alternative compliance standards for RPS in PJM jurisdictions.

**Table 8-26 Tier I, Tier II, and Solar alternative compliance payments in PJM jurisdictions for 2024<sup>226 227</sup>**

Jurisdiction with RPS	Standard Alternative Compliance (\$/MWh)	Tier II Alternative Compliance (\$/MWh)	Solar Alternative Compliance (\$/MWh)
Delaware	\$25.00		\$150.00
Illinois	\$0.35		
Maryland	\$27.50	\$15.00	\$60.00
Michigan	No specific penalties		
New Jersey	\$50.00	\$50.00	\$208.00
North Carolina	No specific penalties: At the discretion of the NC Utility Commission		
Ohio	\$61.81		
Pennsylvania	\$45.00	\$45.00	\$74.06
Washington, D.C.	\$50.00	\$10.00	\$400.00
Jurisdiction with Voluntary Standard			
Indiana	Voluntary standard - No Penalties		
Jurisdiction with No Standard			
Kentucky	No standard		
Tennessee	No standard		
West Virginia	No standard		

Load serving entities participating in mandatory RPS programs in PJM jurisdictions must submit compliance reports to the relevant jurisdiction's public utility commission.

<sup>221</sup> N.J. S. 2314/A. 3723.

<sup>222</sup> See AEPS History Pricing report at the AEPS website <<https://pennaeps.com/reports/>> (Accessed May 2, 2024).


<sup>223</sup> See Senate Bill 33, Delaware General Assembly (February 10, 2021) <<https://legis.delaware.gov/BillDetail?legislationId=48278>>.

<sup>224</sup> Renewable Energy Portfolio Standard Report with Data for Calendar Year 2022 at 6, Maryland Public Service Commission (November 30, 2023) <<https://www.psc.state.md.us/commission-reports/>>.

<sup>225</sup> Renewable Energy Portfolio Standards A Report for Compliance Year 2023 at 26, Public Service Commission District of Columbia (May 1, 2024) <<https://dcpsc.org/Orders-and-Regulations/PSC-Reports-to-the-DC-Council/Renewable-Energy-Portfolio-Standard.aspx>>.

<sup>226</sup> The Ohio standard alternative compliance payment (ACP) is updated annually <<https://www.puco.ohio.gov/industry-information/industry-topics/acp-non-solar-alternative-compliance-payment-under-orc-492864/>>. The Illinois Commerce Commission periodically publishes updates to the effective ACP amount <<https://www.icc.illinois.gov/electricity/RPSCompliancePaymentNotices.aspx>>. For updated Maryland ACPs, see Table 3 of the 2018 Renewable Energy Portfolio Standard Report <<https://www.psc.state.md.us/commission-reports/>>.

<sup>227</sup> The entry for Pennsylvania reflects the solar ACP for 2023. See "Pricing," <<https://www.pennaeps.com/reports/>> (Accessed May 2, 2024).

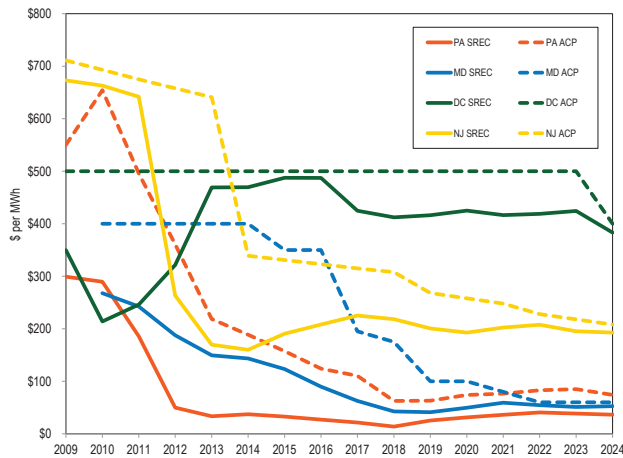**Figure 8-9 Comparison of SREC price and solar ACP: 2009 through 2024**

In their submitted compliance reports, load serving entities must indicate the quantity of MWh that they have generated using eligible renewable or alternative energy resources. They must also identify the quantity of RECs they may have purchased to make up for renewable energy generation shortfalls or to comply with RPS provisions requiring that they purchase RECs. The public utility commissions then release RPS compliance reports to the public.

The Pennsylvania Public Utility Commission issued the 2022/2023 compliance report for the Pennsylvania Alternative Energy Standards Act of 2004 in May 2024.<sup>228</sup> Pennsylvania reported that the 679,794 SRECs, 10,651,534 Tier I RECs and 13,595,818 Tier II RECs were retired during the 2022/2023 reporting year (June 1, 2022 through May 31, 2023). Supplier obligations for 38 SRECs, 760 Tier I RECs and 952 Tier II RECs required ACPs.

The Public Service Commission of the District of Columbia reported that 278,200 SRECs and 3,525,332 Tier I RECs were retired during the 2023 compliance year. The average price for solar RECs was \$415.35. ACPs increased from \$72,250 for 2022 to \$1.8 million for 2023.<sup>229</sup>

The Public Service Commission of Maryland reported that Tier 1 RECs retired for 2023 compliance decreased by 8.7 million RECs, or 63.4 percent, compared with

2022.<sup>230</sup> The report notes that the “ACP prices were in many instances less expensive than REC prices, and as a result suppliers chose to pay the ACP.”<sup>231</sup> The total cost of compliance for 2023 was \$564.2 million, a 28.6 percent increase over 2022.

The Public Utilities Commission of Ohio reported that 7,532,762 RECs were retired in the 2023 compliance year, which is 4.6 percent higher than the number of RECs retired in 2022.<sup>232</sup> Compliance cost for 2023 were \$79.8 million, 17.9 percent higher than 2022.

Delmarva Power is the only retail electric supplier that must file a compliance report with the Delaware Public Service Commission. The Delmarva report provides limited public information on RPS compliance cost.<sup>233</sup> Delmarva reports \$13.0 million in ACPs but no other compliance cost information is available.

The Illinois Power Agency (IPA) reported delivery of ComEd RECs totaling 3,797,777 at an average price of \$16.27.<sup>234</sup>

The North Carolina Utilities Commission reported that Dominion North Carolina Power submitted its 2020 compliance report on August 10, 2021. The compliance report stated that Dominion met its general RPS requirement by purchasing 427,657 credits that consisted of wind and biomass RECs and energy efficiency credits (EECs).<sup>235</sup> Dominion met its solar requirement of 8,562 RECs, poultry waste requirement of 22,311 RECs, and swine waste requirement of 2,997 RECs through REC purchases. Dominion North Carolina’s total REC requirements for 2020 increased 4.9 percent over 2019.

The Michigan Public Service Commission reported that Indiana Michigan Power Company met the 2020 standard by generating or acquiring 315,384 RECs.<sup>236</sup>

New Jersey’s Office of Clean Energy posted a summary of RPS compliance through the energy year ending May

<sup>228</sup> “Renewable Energy Portfolio Standard Report with Data for Calendar Year 2023,” Public Service Commission of Maryland (December 2, 2024) at 9, <<https://www.psc.state.md.us/commission-reports/>>.

<sup>229</sup> Id. at 7.

<sup>230</sup> “Renewable Portfolio Standard Report to the General Assembly for Compliance Year 2023,” Public Utilities Commission of Ohio (January 22, 2025), <<https://puco.ohio.gov/utilities/electricity/resources/ohio-renewable-energy-portfolio-standard/annual-rps-reports>>.

<sup>231</sup> “Retail Electricity Supplier’s RPS Compliance Report, Compliance Period: June 1, 2022–May 31, 2023,” Delmarva Power, (Sept. 29, 2023), <<https://depdc.delaware.gov/rps-and-green-power-product-compliance/>>.

<sup>232</sup> “Annual Report Fiscal Year 2023,” Illinois Power Agency (Feb. 15, 2024), <<https://ipa.illinois.gov/about-ipa/ipa-publications.html>>.

<sup>233</sup> “Annual Report Regarding Renewable Energy and Energy Efficiency Portfolio Standard in North Carolina,” North Carolina Utilities Commission (Oct. 1, 2021) at 41, <<https://www.ncuc.gov/newsroom.html>>.

<sup>234</sup> “Report on the Implementation and Cost-Effectiveness of the P.A. 295 Renewable Energy Standard,” Michigan Public Service Commission (Feb. 15, 2022), <<https://www.michigan.gov/mpsc/regulatory/reports/prior-renewable-reports>>.

<sup>228</sup> “Alternative Energy Portfolio Standards Act of 2004 Compliance for Reporting Year 2022-23,” (May 2024), <<https://www.puc.pa.gov/filing-resources/reports/alternative-energy-portfolio-standards-acps-reports/>>.

<sup>229</sup> “Renewable Energy Portfolio Standard, A Report for Compliance Year 2023,” Public Service Commission of the District of Columbia (May 1, 2024), <<https://dcpsc.org/Orders-and-Regulations/PSC-Reports-to-the-DC-Council/Renewable-Energy-Portfolio-Standard.aspx>>.

31, 2022.<sup>237</sup> Electric power suppliers retired 10,863,600 class I RECs and 1,828,092 class II RECs. Suppliers submitted 247 class I ACPs and 50 class II ACPs at a cost of \$50 per MWh. Electric power suppliers retired 3,560,641 solar RECs and 458,388 SACP were submitted at a cost of \$238 per MWh. Additionally, 469,621 transition RECs were retired and 2,910 SREC II were retired.<sup>238 239</sup>

Table 8-27 shows the RPS compliance cost incurred by PJM jurisdictions as reported by the jurisdictions.<sup>240</sup> The compliance costs are the cost of acquiring RECs plus the cost of any alternative compliance payments. The cost of complying with RPS, as reported by the states, was \$11.8 billion over the nine year period from 2014 through 2022 for the ten jurisdictions that had RPS and reported compliance costs.<sup>241</sup> The average RPS compliance cost per year based on the reported compliance cost for the nine year period from 2014 through 2022 was \$1.3 billion. The compliance cost for 2022, the most recent year with almost complete data, was \$2.4 billion.

**Table 8-27 RPS Compliance Cost<sup>242 243 244 245 246 247 248 249 250 251 252</sup>**

Jurisdiction with RPS		2014	2015	2016	2017	2018	2019	2020	2021	2022
Delaware	Total RPS		\$16,013,421	\$18,409,631	\$18,772,855	\$18,341,916	\$19,401,476	\$21,133,971	\$25,550,239	
	Solar		\$7,070,254	\$7,748,073	\$7,105,726	\$6,565,240	\$8,121,914	\$9,096,298	\$9,567,891	
	Non-Solar		\$8,943,167	\$10,661,557	\$11,667,129	\$11,776,676	\$11,279,562	\$12,037,673	\$15,982,348	
Illinois	Total RPS	\$21,701,688	\$24,817,068	\$25,718,863	\$25,919,372	\$25,775,523	\$26,971,638	\$34,726,109	\$52,555,157	\$73,185,068
Maryland	Total RPS	\$104,056,879	\$126,752,147	\$135,232,457	\$12,064,102	\$84,874,724	\$142,275,744	\$223,218,944	\$409,846,140	\$438,832,999
	Solar	\$29,388,337	\$39,062,714	\$45,556,987	\$21,276,834	\$27,352,183	\$57,824,616	\$122,973,787	\$221,296,225	\$187,244,056
	Tier I	\$70,677,220	\$85,070,001	\$88,234,024	\$50,099,228	\$56,473,113	\$84,333,097	\$99,836,397	\$187,579,231	\$247,158,373
	Tier II	\$3,991,322	\$2,619,432	\$1,441,446	\$688,040	\$1,049,428	\$118,031	\$408,760	\$970,684	\$4,430,570
Michigan	Total RPS	\$476,535	\$0	\$3,264,504	\$3,961,262	\$3,264,504	\$3,376,773	\$5,379,970		
New Jersey	Total RPS	\$395,782,297	\$524,761,382	\$593,441,037	\$606,312,461	\$653,810,457	\$763,108,366	\$970,177,803	\$1,140,654,336	\$1,236,035,486
	Solar	\$322,504,920	\$417,359,783	\$481,540,738	\$503,797,182	\$560,509,712	\$667,975,153	\$822,247,072	\$946,434,884	\$959,987,769
	Class I	\$66,071,749	\$98,185,431	\$100,910,465	\$91,872,615	\$83,474,335	\$85,522,028	\$130,272,633	\$171,818,089	\$241,810,299
	Class II	\$7,205,628	\$9,216,167	\$10,989,834	\$10,642,664	\$9,826,410	\$9,611,185	\$17,658,099	\$22,401,364	\$34,237,418
North Carolina	Total RPS	\$297,513	\$358,436	\$317,644	\$234,264	\$442,579				
Ohio	Total RPS	\$42,581,477	\$42,584,233	\$37,631,481	\$39,943,836	\$50,214,523	\$69,799,170	\$81,752,397	\$82,677,088	\$67,708,887
	Solar	\$17,666,730	\$14,843,052	\$11,564,584	\$9,435,730	\$9,419,092	\$9,578,048	\$0	\$0	\$0
	Non-Solar	\$24,914,747	\$27,741,181	\$26,066,897	\$30,508,106	\$40,795,431	\$60,221,121	\$81,752,397	\$82,677,088	\$67,708,887
Pennsylvania	Total RPS	\$86,184,477	\$114,586,932	\$125,041,911	\$115,585,212	\$99,681,713	\$112,691,066	\$182,995,718	\$307,751,404	\$461,430,587
	Solar	\$14,163,543	\$19,227,690	\$21,876,876	\$17,987,722	\$16,565,924	\$20,608,103	\$24,764,538	\$27,673,083	\$28,464,498
	Tier I	\$70,922,431	\$94,339,032	\$101,700,328	\$95,370,456	\$77,899,586	\$74,780,310	\$100,528,434	\$159,457,100	\$224,782,412
	Tier II	\$1,098,503	\$1,020,210	\$1,464,707	\$2,227,034	\$5,216,203	\$17,302,653	\$57,702,746	\$120,621,222	\$208,183,678
Washington D.C.	Total RPS	\$27,373,000	\$38,541,000	\$47,163,000	\$42,700,000	\$50,600,000	\$57,300,000	\$65,000,000	\$99,100,000	\$129,200,000
	Solar	\$25,145,000	\$36,523,000	\$44,898,000	\$31,800,000	\$42,800,000	\$50,560,000	\$59,200,000	\$84,000,000	\$106,600,000
	Tier I	\$2,141,000	\$1,901,000	\$2,131,500	\$10,500,000	\$7,600,000	\$6,670,000	\$5,800,000	\$15,100,000	\$22,600,000
	Tier II	\$87,000	\$117,000	\$133,500	\$400,000	\$200,000	\$70,000	\$0	\$0	\$0
PJM	Total RPS	\$678,453,866	\$888,414,620	\$986,220,529	\$925,493,363	\$987,005,938	\$1,194,924,232	\$1,584,384,913	\$2,118,134,365	\$2,406,393,026

237 See EY22 RPS Compliance Results (2004 to 2022), New Jersey's Clean Energy Program (2023), <<http://www.njcleanenergy.com/renewable-energy/program-updates/rps-compliance-reports>>.

238 "New Jersey Board of Public Utilities Approves Solar Transition Program, Initiates a Cost Cap Proceeding," New Jersey Board of Public Utilities Press Release (December 6, 2019) <<https://www.bpu.state.nj.us/bpu/newsroom/2019/approved/20191206.html>>.

239 "NJBP Approves 3,750 MW Successor Solar Incentive Program", New Jersey Board of Public Utilities Press Release (July 28, 2021) <<https://www.nj.gov/bpu/newsroom/2021/approved/20210728.html>>.

240 RPS compliance cost totals for Illinois, Michigan, and North Carolina reflect the RPS compliance cost attributable to PJM load in each of the states.

241 The actual PJM RPS compliance cost exceeds the reported \$9.4 billion due to incomplete data. The compliance cost value for 2020 and 2021 does not include Michigan or North Carolina. Based on past data these states generally account for less than 0.5 percent of the total RPS compliance cost of PJM states. The \$9.4 billion cost also does not fully reflect the overhead and administrative costs associated with RPS programs.

242 Several states have not released compliance reports for 2023.

243 "Retail Electricity Supplier's RPS Compliance Report," Delmarva Power (Sept. 28, 2022), <<https://dep.sc.delaware.gov/rps-and-green-power-product-compliance/>>

244 "Fiscal Year 2023 Annual Report," February 15, 2024, Illinois Power Agency (IPA), <<https://ipa.illinois.gov/about-ipa/ipa-publications.html>>.

245 "Renewable Energy Portfolio Standard Report," Public Service Commission of Maryland (December 2, 2024) at 9, <<https://www.psc.state.md.us/commission-reports/>>.

246 Appendix C in "Report on the Implementation and Cost-Effectiveness of the P.A. 295 Renewable Energy Standard," Michigan Public Service Commission, February 15, 2022, <<https://www.michigan.gov/mpsc/regulatory/reports/prior-renewable-reports>> The compliance cost entry reflects the compliance cost of the Indiana Michigan Power Company, which is the only investor owned utilities whose service area is in the PJM footprint.

247 "RPS Report Summary 2005-2022," New Jersey's Clean Energy Program, 2023, <<http://njcleanenergy.com/renewable-energy/program-updates/rps-compliance-reports>>.

248 "Renewable Portfolio Standard Report to the General Assembly for Compliance Year 2021," Public Utilities Commission of Ohio, January 22, 2025, <<https://puco.ohio.gov/wps/portal/gov/puco/utilities/electricity/resources/ohio-renewable-energy-portfolio-standard/puco-annual-rps-reports>>.

249 "Alternative Energy Portfolio Standards Act of 2004 Compliance for Reporting Year 2023," Pennsylvania Public Utility Commission, March 2023 <<https://www.puc.pa.gov/filing-resources/reports/alternative-energy-portfolio-standards-aeps-reports/>>

250 "Report on the Renewable Energy Portfolio Standard for Compliance Year 2023," Public Service Commission of the District of Columbia, Executive Summary, May 1, 2024, <<https://dcpsc.org/Orders-and-Regulations/PSC-Reports-to-the-DC-Council/Renewable-Energy-Portfolio-Standard.aspx>>.

251 "Application of Dominion Energy North Carolina for Approval of Cost Recovery for Renewable Energy and Energy Efficiency Portfolio Standard Compliance and Related Costs," Docket No. E-22, Sub 557, Sub 558, August 30, 2018 <<https://www.ncuc.net/>>. The North Carolina compliance cost entries reflects the compliance cost of Dominion Energy North Carolina.

252 The reporting period for RPS compliance in Delaware, Illinois, New Jersey, and Pennsylvania corresponds to PJM capacity market delivery years, June 1 through May 31. The compliance cost amounts reported by these states were converted to calendar year by assuming the compliance cost was evenly spread across the months in the compliance year.



## Transco Regional Energy Access Expansion Project

By order issued January 11, 2023, FERC authorized a request filed by Transco to modify its gas pipeline system to increase its capacity by 829,400 Dth/day (.8 BCF/day) from the north east on its Leidy line to points in Pennsylvania, New Jersey and Maryland. Transco planned to have service available at the end of the fourth quarter of 2023.<sup>253</sup> In order to increase the capacity on the pipeline for this project Transco installed about 36 miles of new pipe, a new electric compressor station and modified five existing compressor stations. By letter dated July 26, 2024, FERC authorized Transco to commence service with facilities associated with the Regional Energy Expansion Project.<sup>254</sup> The 829,400 Dth/Day would be enough to supply about five combined cycle power plants.<sup>255</sup> On March 13, 2023, the New Jersey Division of Rate Counsel and New Jersey Conservation Foundation, et al., sought review in the United States Court of Appeals for the District of Columbia Circuit.<sup>256</sup> The appeal primarily argues that FERC ignored evidence that “clearly demonstrated that the state of New Jersey does not need and will not benefit from the Project’s capacity.”<sup>257</sup> On July 30, 2024, the United States Court of Appeals for the District of Columbia Circuit vacated and remanded the Certificate Orders.<sup>258</sup> On September 6, 2024 Transco filed an Application for Temporary Emergency Certificate so they could continue to provide service while this matter is resolved on remand.<sup>259</sup> Both PJM and the MMU submitted comments supporting the application.<sup>260</sup> On January 24, 2025, FERC issued an order reinstating authorization for Transco’s Regional Energy Access Expansion Project.<sup>261</sup>

<sup>253</sup> See 182 FERC ¶ 61,006 (2023), *order on reh’g*, 182 FERC ¶ 61,148 (2023), *order on reh’g*, 183 FERC ¶ 61,071 (2023).

<sup>254</sup> See Letter: Authorization to Commence Service, FERC Docket No. CP21-94-000.

<sup>255</sup> See 2023 *Annual State of the Market Report for PJM*, Volume 2: Section 7, Net Revenue, “Table 7-55 Gas pipeline capacity need to replace units at risk of retirement.” New combined cycle unit ICAP 1,100 MW and fuel rate of 6.543 MMBtu/MWh.

<sup>256</sup> Case No. 23-1064, et al.

<sup>257</sup> New Jersey Conservation Foundation, et al. v. FERC, Proof Opening Brief of Petitioners, Case No. 23-1064 (D.C. Cir July 26, 2023).

<sup>258</sup> N.J. Conservation Foundation, et al. v. FERC, No. 23-1064 (July 30, 2024).

<sup>259</sup> See FERC Docket No. CP21-94-004.

<sup>260</sup> See PJM Interconnection, LLC’s Comments in Support of the Application of Transcontinental Gas Pipe Line Company, LLC for a Temporary Emergency Certificate, FERC Docket No. CP21-94-004 (October 7, 2024); Comments of the Independent Market Monitor for PJM, FERC Docket No. CP21-94-004 (October 8, 2024).

<sup>261</sup> See FERC Docket No. CP21-94-004.

## Mountain Valley Pipeline

“On October 23, 2015, Mountain Valley Pipeline (MVP) filed an application with FERC for approval to construct own and operate MVP.”<sup>262</sup> On October 13, 2017, MVP received a certificate of convenience and necessity from FERC. The pipeline is approximately 303 miles long stretching from the Equitrans Transmission system in Wentzel County West Virginia to Transco Zone 5 station 165 in Pittsylvania County Virginia. The capacity of the pipeline is approximately 2 BCF per day. On June 14, 2024, MVP entered service.<sup>263</sup> The 2,000,000 Dth/Day would be enough to supply about eleven combined cycle power plants.<sup>264</sup>

## Transco Southeast Supply Enhancement

On May 24, 2024, Transcontinental Gas Pipe Line Company, LLC (Transco) filed a general project description draft of the proposed Southeast Supply Enhancement Project. This project is an expansion of the Transco system in southern Virginia, North Carolina, South Carolina, Georgia and Alabama. The total capacity will be 1,591,900 Dth/Day from Transco Station 165 Zone 5 and the interconnection with Mountain Valley and points south to North Carolina, South Carolina, Georgia and Alabama. The proposal includes about 55 miles of new pipe and the addition of seven new compressors at existing compressor stations. The expected completion of the project is June 2028.<sup>265</sup> The 1,591,900 Dth/Day would be enough to supply about eight combined cycle power plants.<sup>266</sup>

## Transco Commonwealth Energy Connector Project

On August 24, 2022, Transcontinental Gas Pipe Line Company, LLC (Transco) filed a certificate of public convenience and necessity to construct the Commonwealth Energy Connector Project.<sup>267</sup> The new capacity will be 105,000 Dth/d which Virginia Natural Gas, Inc. (VNG) has contracted for. This project is an expansion of the Transco system from Zone 5 Pooling point through Transco’s South Virginia Lateral which

<sup>262</sup> Mountain Valley Pipeline <<https://www.mountainvalleypipeline.info/>> (Accessed July 26, 2024).

<sup>263</sup> Mountain Valley Pipeline <<https://www.mountainvalleypipeline.info/>> (Accessed July 26, 2024).

<sup>264</sup> See 2023 *Annual State of the Market Report for PJM*, Volume 2: Section 7, Net Revenue, “Table 7-55 Gas pipeline capacity need to replace units at risk of retirement.” New combined cycle unit ICAP 1,100 MW and fuel rate of 6.543 MMBtu/MWh.

<sup>265</sup> See Transcontinental Gas Pipe Line Company, LLC Southeast Supply Enhancement Project, Docket No. PF24-2-000, Draft Resource Reports 1-12 (May 24, 2024).

<sup>266</sup> See 2023 *Annual State of the Market Report for PJM*, Volume 2: Section 7, Net Revenue: Table 7-55” New combined cycle unit ICAP 1,100 MW and fuel rate of 6.543 MMBtu/MWh.

<sup>267</sup> See FERC Docket No. CP22-502.

interconnects between Transco and Columbia Gas Transmission, LLC. Additional compression, about 3.6 miles of additional pipe and modifications and installation of new facilities at the Emporia M&R station will be completed to increase the capacity. The project is expected to be completed by September 25, 2025. The 105,000 Dth per day would not be enough supply to run one combined cycle power plant.<sup>268</sup>

## Columbia Gas Transmission Virginia Reliability Project

On August 24, 2022, Columbia Gas Transmission LLC (Columbia) filed an abbreviated application for the authority necessary to construct and operated its Virginia Reliability project. The new capacity will be 100,000 Dth/d which Virginia Natural Gas, Inc. (VNG) has contracted for. This project will replace 49 miles of existing pipe, modifications at two compressor stations, modifications to one receipt point and delivery point increasing service to Market Area 34. This will allow VNG to receive gas at the Transco Columbia interconnection and deliver to VNG. This capacity if projected to be available by November 1, 2025.<sup>269</sup> The 100,000 Dth per day would not be enough supply to run one combined cycle power plant.<sup>270</sup>

## Texas Eastern Transmission Appalachia to Market II Project

On July 7, 2022, Texas Eastern Transmission, LP (Texas Eastern) filed an abbreviated Application for a Certificate of Public Convenience and Necessity to develop the Appalachia to Market II Project. Prior to the filing, Texas Eastern conducted a binding open season for 55,000 Dth/d that will be made available based on improvements to the Texas Eastern system. The additional capacity will run from Appalachia supply basin in southwest Pennsylvania to New Jersey. Two compressor stations (reducing air emissions with upgraded compression equipment) will be replaced and two miles of looping of pipe will be added. PSEG Power LLC and Elizabethtown Gas signed up for the 55,000 Dth/d. The project is expected to be completed by November 1, 2025.<sup>271</sup> The 55,000 Dth per day would

not be enough supply to run one combined cycle power plant.<sup>272</sup>

## Emission Controlled Capacity and Emissions

### Emission Controlled Capacity

Environmental regulations affect decisions about emission control investments in existing units, investment in new units and decisions to retire units lacking emission controls.<sup>273</sup> Most PJM units burning fossil fuels have installed emission control technology. All coal steam units in PJM are compliant with the state and federal emissions limits established by MATS.<sup>274 275</sup>

Table 8-28 shows SO<sub>2</sub> emission controls by fossil fuel fired units in PJM.<sup>276 277 278</sup> Coal has the highest SO<sub>2</sub> emission rate, while natural gas and diesel oil have lower SO<sub>2</sub> emission rates.<sup>279</sup> Of the current 41,597.9 MW of coal capacity in PJM, 40,523.9 MW of capacity, 97.4 percent, has some form of FGD (flue-gas desulfurization) technology to reduce SO<sub>2</sub> emissions.

**Table 8-28 SO<sub>2</sub> emission controls by fuel type (MW): December 31, 2024<sup>280</sup>**

	SO <sub>2</sub> Controlled	No SO <sub>2</sub> Controls	Total	Percent Controlled
Coal	40,523.9	1,074.0	41,597.9	97.4%
Diesel Oil	0.0	3,340.4	3,340.4	0.0%
Natural Gas	0.0	77,271.3	77,271.3	0.0%
Other	325.0	1,850.0	2,175.0	14.9%
Total	40,848.9	83,535.7	124,384.6	32.8%

272 See 2023 Annual State of the Market Report for PJM, Volume 2: Section 7, Net Revenue, Table 7-55. New combined cycle unit ICAP 1,100 MW and fuel rate of 6.543 MMBtu/MWh.

273 See EPA, "National Ambient Air Quality Standards (NAAQS)," <<https://www.epa.gov/criteria-air-pollutants/naaqs-table>> (Accessed March 4, 2022).

274 On April 16, 2020, the EPA issued a revised final finding regarding the Mercury and Air Toxics Standards. See EPA, "Regulatory Actions," <<https://www.epa.gov/mats/regulatory-actions-final-mercury-and-air-toxics-standards-mats-power-plants>> (Accessed May 7, 2020).

275 On April 9, 2020, the EPA created a new subcategory of six coal refuse power plants in Pennsylvania and West Virginia with reduced limits of HCl and SO<sub>2</sub> emissions under MATS. These units were all compliant with the previous MATS rules. "Mercury and Air Toxics Standards," <[https://www.epa.gov/sites/production/files/2020-04/documents/frn\\_mats\\_coal\\_refuse\\_2060-au48\\_final\\_rule.pdf](https://www.epa.gov/sites/production/files/2020-04/documents/frn_mats_coal_refuse_2060-au48_final_rule.pdf)> (Accessed May 7, 2020).

276 See EPA, "Air Market Programs Data," <<http://ampd.epa.gov/ampd/>> (Accessed March 4, 2022).

277 Air Markets Programs Data is submitted quarterly. Generators have 30 days after the end of the quarter to submit data, and all data is considered preliminary and subject to change until it is finalized in June of the following year. The most recent complete set of emissions data is from 2022.

278 The total MW are less than the 179,656.2 reported in Section 5: Capacity Market, because EPA data on controls could not be matched to some PJM units. "Air Markets Program Data," <<http://ampd.epa.gov/ampd/QueryToolie.html>> (Accessed January 1, 2025).

279 Diesel oil includes number 1, number 2, and ultra-low sulfur diesel. See EPA, "Electronic Code of Federal Regulations, Title 40, Chapter 1, Subchapter C, Part 72, Subpart A, Section 72.2," <[http://www.ecfr.gov/cgi-bin/text-idx?SID=4f18612541a393473efb13ac879d470&mc=true&nnode=se40.18.72\\_12&rgn=div8](http://www.ecfr.gov/cgi-bin/text-idx?SID=4f18612541a393473efb13ac879d470&mc=true&nnode=se40.18.72_12&rgn=div8)> (Accessed May 7, 2020).

280 The "other" category includes petroleum coke, wood, process gas, residual oil, other gas, and other oil. The EPA's "other" category does not have strict definitions for inclusion.

268 See 2023 Annual State of the Market Report for PJM, Volume 2: Section 7, Net Revenue, Table 7-55. New combined cycle unit ICAP 1,100 MW and fuel rate of 6.543 MMBtu/MWh.

269 See FERC Docket No. CP22-503.

270 See 2023 Annual State of the Market Report for PJM, Volume 2: Section 7, Net Revenue, Table 7-55. New combined cycle unit ICAP 1,100 MW and fuel rate of 6.543 MMBtu/MWh.

271 See FERC Docket No. CP22-486-000.

Table 8-29 shows NO<sub>x</sub> emission controls by fossil fuel fired units in PJM. Coal has the highest NO<sub>x</sub> emission rate, while natural gas and diesel oil have lower NO<sub>x</sub> emission rates. Of the current 41,597.9 MW of coal capacity in PJM, 41,511.9 MW of capacity, 99.8 percent, has some form of emissions controls to reduce NO<sub>x</sub> emissions. Most units in PJM have NO<sub>x</sub> emission controls in order to meet each state's emission compliance standards, based on whether a state is part of CSAPR, Acid Rain Program (ARP) or a combination of the three. The NO<sub>x</sub> compliance standards of MATS require the use of selective catalytic reduction (SCRs) or selective non-catalytic reduction (SCNRs) for coal steam units, as well as SCRs or water injection technology for peaking combustion turbine units.<sup>281</sup>

**Table 8-29 NO<sub>x</sub> emission controls by fuel type (MW): As of December 31, 2024**

	NO <sub>x</sub> Controlled	No NO <sub>x</sub> Controls	Total	Percent Controlled
Coal	41,511.9	86.0	41,597.9	99.8%
Diesel Oil	1,020.3	2,320.1	3,340.4	30.5%
Natural Gas	76,178.3	1,093.0	77,271.3	98.6%
Other	775.0	1,400.0	2,175.0	35.6%
Total	119,485.5	4,899.1	124,384.6	96.1%

Table 8-30 shows particulate emission controls by fossil fuel units in PJM. Almost all coal units (99.8 percent) in PJM have particulate controls, as well as a few natural gas units (2.1 percent) and units with other fuel sources (53.9 percent). Typically, technologies such as electrostatic precipitators (ESP) or fabric filters (baghouses) are used to reduce particulate matter from coal steam units.<sup>282</sup> Fabric filters work by allowing the flue gas to pass through a tightly woven fabric which filters out the particulates. Of the current 41,597.9 MW of coal capacity in PJM, 41,512.9 MW of capacity, 99.8 percent, have some type of particulate emissions control technology.

**Table 8-30 Particulate emission controls by fuel type (MW): As of December 31, 2024**

	Particulate Controlled	No Particulate Controls	Total	Percent Controlled
Coal	41,512.9	85.0	41,597.9	99.8%
Diesel Oil	0.0	3,340.4	3,340.4	0.0%
Natural Gas	1,586.0	75,685.3	77,271.3	2.1%
Other	1,172.0	1,003.0	2,175.0	53.9%
Total	44,270.9	80,113.7	124,384.6	35.6%

<sup>281</sup> See EPA, "Mercury and Air Toxics Standards, Cleaner Power Plants," <<https://www.epa.gov/mats/cleaner-power-plants#controls>> (Accessed May 7, 2020).

<sup>282</sup> See EPA, "Air Pollution Control Technology Fact Sheet," <<https://www3.epa.gov/ttn/catc/dir1/ff-pulse.pdf>> (Accessed May 4, 2022).

In order to achieve compliance with MATS, most coal steam units in PJM have particulate emission controls in the form of ESPs, but many units have also installed baghouse technology, or a combination of an FGD and SCR. Currently, all of the 100 coal steam units have some combination of ESP, baghouse, or FGD and SCR technology installed to achieve MATS compliance for either SO<sub>2</sub> or particulate emissions control, representing all of the 41,597.9 MW total coal capacity.

## Emissions

Figure 8-10 shows the total CO<sub>2</sub> emissions in short tons, the CO<sub>2</sub> emission rate in short tons per MWh within PJM for all CO<sub>2</sub> emitting units, for each quarter from 1999 to the fourth quarter of 2024, and the CO<sub>2</sub> emission rate in short tons per MWh of total generation within PJM for each quarter from the third quarter of 2000 to the fourth quarter of 2024.<sup>283</sup>

Figure 8-11 shows the total CO<sub>2</sub> emission in short tons on peak and off peak and the CO<sub>2</sub> emission rate in short tons per MWh for all CO<sub>2</sub> emitting units.


Table 8-31 shows the minimum and maximum CO<sub>2</sub> emission rates in short tons per MWh for all CO<sub>2</sub> emitting units, for all hours, as well as on and off peak hours, from the first quarter of 1999 through the fourth quarter of 2024.

Total PJM generation increased from 197,502.9 GWh in the fourth quarter of 2023 to 198,022.9 GWh in the fourth quarter of 2024, while CO<sub>2</sub> produced decreased from 79.1 million short tons in the fourth quarter of 2023 to 75.7 million short tons in the fourth quarter of 2024.<sup>284</sup> The CO<sub>2</sub> emission rate averaged 0.70 short tons per MWh for all CO<sub>2</sub> emitting units in 2021, 0.69 short tons per MWh for all CO<sub>2</sub> emitting units in 2022, 0.64 short tons per MWh for all CO<sub>2</sub> emitting units in 2023, and 0.63 short tons per MWh for all CO<sub>2</sub>.

<sup>283</sup> Unless otherwise noted, emissions are measured in short tons. A short ton is 2,000 pounds.


<sup>284</sup> See the 2024 Annual State of the Market Report for PJM: Volume 2, Section 3: Energy Market, Table 3-51.

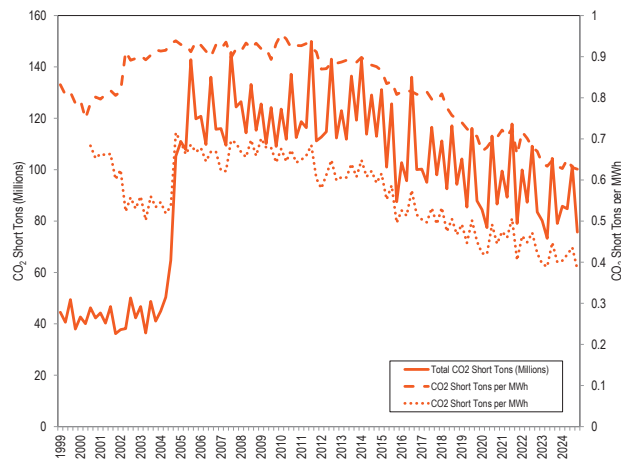**Figure 8-10 CO<sub>2</sub> emissions by quarter (millions of short tons), by PJM units: 1999 through 2024<sup>285 286</sup>**



In the fourth quarter of 2024, CO<sub>2</sub> emission rates were 0.63 short tons per MWh for all CO<sub>2</sub> emitting units for off peak hours, and 0.63 for on peak hours. Of the top 10 largest CO<sub>2</sub> emitting units in the United States, three (Gavin, Prairie State, and Amos) are located in the PJM footprint.<sup>287</sup>

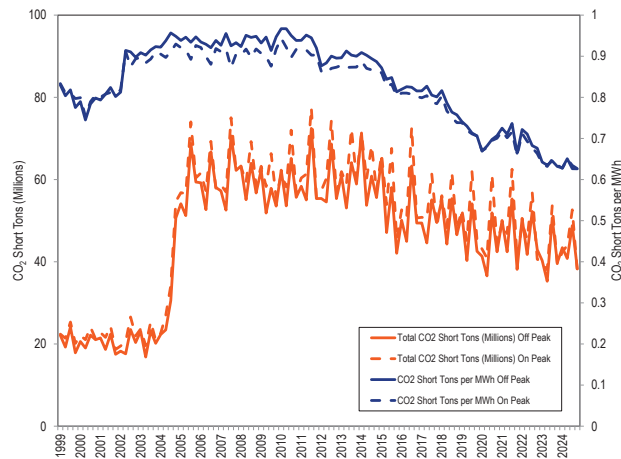**Figure 8-11 Total CO<sub>2</sub> emissions during on and off peak hours by quarter (millions of short tons), by PJM units: 1999 through 2024<sup>288</sup>**



<sup>285</sup> The emissions are calculated from the continuous emission monitoring system (CEMS) data from generators located within the PJM footprint.

<sup>286</sup> In 2004 and 2005, PJM integrated the American Electric Power (AEP), ComEd, Dayton Power & Light Company (DAY), Dominion, and Duquesne Light Company (DLCO) Control Zones. The large increase in total emissions from 2004 to 2005 was a result of these integrations. In June 2011, PJM integrated the American Transmission Systems, Inc. (ATSI) Control Zone. In January 2012, PJM integrated the Duke Energy Ohio/Kentucky (DEOK) Control Zone. In June 2013, PJM integrated the Eastern Kentucky Power Cooperative (EKPC). In December 2018, PJM integrated the Ohio Valley Electric Corporation (OVEC).

<sup>287</sup> "The top 10 emitting power plants in America," <<https://www.eenews.net/articles/the-top-10-emitting-power-plants-in-america/>> (Accessed November 4, 2022).

<sup>288</sup> The emissions are calculated from the continuous emission monitoring system (CEMS) data from generators located within the PJM footprint.

**Table 8-31 Minimum and maximum CO<sub>2</sub> emissions per MWh: 1999 through 2024.**

		Short Tons per MWh	Year	Quarter
Minimum	All hours	0.63	2024	4
	On Peak	0.63	2024	4
	Off Peak	0.63	2024	4
Maximum	All hours	0.96	2010	1
	On Peak	0.94	2010	1
	Off Peak	0.97	2010	2

Figure 8-12 shows the total SO<sub>2</sub> and NO<sub>x</sub> emissions and the emission rate in short tons per MWh for all SO<sub>2</sub> and NO<sub>x</sub> emitting units, and the SO<sub>2</sub> and NO<sub>x</sub> emission rate in short tons per MWh of total PJM generation. In the fourth quarter of 2024, the SO<sub>2</sub> emission rate was 0.000264 short tons per MWh for all SO<sub>2</sub> emitting units, and the NO<sub>x</sub> emission rate was 0.000247 short tons per MWh for all NO<sub>x</sub> emitting units.

Figure 8-13 shows the total on peak hour and off peak hour SO<sub>2</sub> and NO<sub>x</sub> emissions and the emission rate in short tons per MWh for all SO<sub>2</sub> and NO<sub>x</sub> emitting units. In the fourth quarter of 2024, SO<sub>2</sub> emission rates were 0.000264 short tons per MWh and 0.000264 short tons per MWh for all SO<sub>2</sub> units, for off and on peak hours. In the fourth quarter of 2024, NO<sub>x</sub> emission rates were 0.000252 short tons per MWh and 0.000242 short tons per MWh for all NO<sub>x</sub> emitting units, for off and on peak hours.

Table 8-32 shows the minimum and maximum SO<sub>2</sub> and NO<sub>x</sub> emission rate in short tons per MWh for all SO<sub>2</sub> and NO<sub>x</sub> emitting units, for all hours, as well as on and off peak hours, from the first quarter of 1999 through the fourth quarter of 2024.

The consistent decline in SO<sub>2</sub> and NO<sub>x</sub> emissions starting in 2006 is the result of a decline in the use of coal, an increase in the use of natural gas, and the installation of environmental controls from 2006 to 2024.<sup>289 290</sup>

<sup>289</sup> See EIA, "Changes in coal sector led to less SO<sub>2</sub> and NO<sub>x</sub> emissions from electric power industry," <<https://www.eia.gov/todayinenergy/detail.php?id=37752>> (Accessed October 25, 2019).

<sup>290</sup> See EIA, "Sulfur dioxide emissions from U.S. power plants have fallen faster than coal generation," <<https://www.eia.gov/todayinenergy/detail.php?id=29812>> (Accessed October 25, 2019).



Figure 8-12 SO<sub>2</sub> and NO<sub>x</sub> emissions by quarter (thousands of short tons), by PJM units: 1999 through 2024<sup>291</sup>

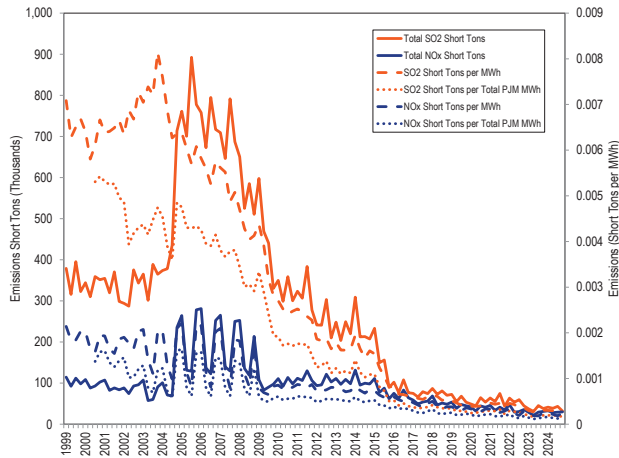


Figure 8-13 SO<sub>2</sub> and NO<sub>x</sub> emissions during on and off peak hours by quarter (thousands of short tons), by PJM units: 1999 through 2024<sup>292</sup>

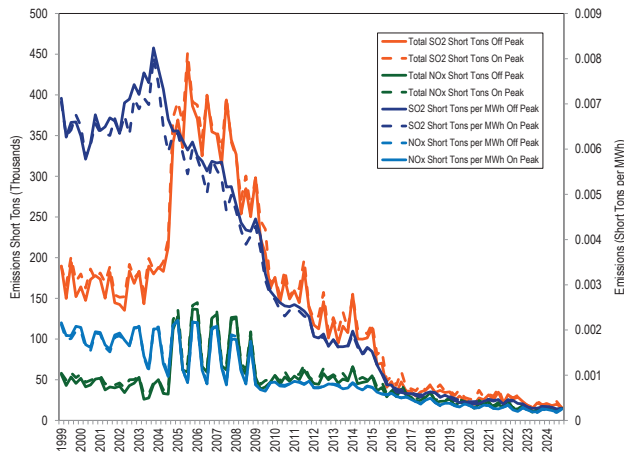


Table 8-32 Minimum and maximum SO<sub>2</sub> and NO<sub>x</sub> emissions per MWh: 1999 through 2024

Emission Type		Short Tons per MWh	Year	Quarter	
SO <sub>2</sub>	Minimum	All hours	0.000	2024	4
		On Peak	0.000	2024	4
		Off Peak	0.000	2024	3
	Maximum	All hours	0.008	2003	4
		On Peak	0.008	2003	4
		Off Peak	0.008	2003	4
NO <sub>x</sub>	Minimum	All hours	0.000	2024	3
		On Peak	0.000	2023	2
		Off Peak	0.000	2023	3
	Maximum	All hours	0.002	2005	1
		On Peak	0.002	2005	1
		Off Peak	0.002	2005	1

<sup>291</sup> The emissions are calculated from the continuous emission monitoring system (CEMS) data from generators located within the PJM footprint.

<sup>292</sup> The emissions are calculated from the continuous emission monitoring system (CEMS) data from generators located within the PJM footprint.

## Renewable Energy Output

### Wind and Solar Peak Hour Output

The capacity of solar and wind resources are derated from the nameplate or installed capacity value based on expected performance during hours with high risk of loss of load (unserved energy). Until June 1, 2023, PJM used average unit performance over 360 summer peak hours to determine the derating factors. For the 2023/2024 Delivery Year, which began on June 1, 2023, PJM used an average ELCC approach to determine the capacity derating factor.<sup>293</sup> The average ELCC approach was also used for the 2024/2025 Delivery Year. Beginning with the 2025/2026 Delivery Year PJM will use a marginal ELCC approach.<sup>294 295</sup>

To illustrate the relationship between actual output and derating factors, Figure 8-14 shows wind and solar output during the top 100 load hours in PJM of 2024. Figure 8-15 shows wind and solar output for all hours of 2024. In 2024, 95 of the top 100 load hours in PJM are PJM defined peak load hours. The hours in Figure 8-14 are in descending order by load and the hours in Figure 8-15 are in chronological order. The solid lines represent the total ICAP and output of the wind or solar PJM resources. The dashed lines are the total capacity committed for each capacity resource, or the ICAP of wind and solar PJM resources derated by the applicable ELCC class rating if the unit is not a capacity resource.

The actual output of the wind and solar resources during the top 100 load hours varied both above and below the derated capacity values. Wind output was above the derated ICAP for 38 hours and below the derated ICAP for 62 hours of the top 100 load hours of 2024. The wind capacity factor for the top 100 load hours of 2024 was 15.8 percent. Wind output was above the derated ICAP for 4,893 hours and below the derated ICAP for 3,891 hours in 2024. The wind capacity factor in 2024 was 28.6 percent.

Solar output was above the derated ICAP for 74 hours and below the derated ICAP for 26 hours of the top 100 load hours of 2024. The solar capacity factor for the top 100 load hours of 2024 was 49.2 percent. Solar output was above the derated ICAP for 1,707 hours and below

<sup>293</sup> See Capacity Value of Intermittent Resources (ELCC) in *2024 Quarterly State of the Market Report for PJM: January through March*, Section 5: Capacity Market.


<sup>294</sup> *Protest of the Independent Market Monitor for PJM*, ER24-99-000 (November 9, 2023).

<sup>295</sup> Order 186 FERC ¶ 61,080 accepting PJM's marginal ELCC approach (January 30, 2024).



the derated ICAP for 7,077 hours in 2024. The solar capacity factor in 2024 was 18.2 percent.

**Figure 8-14 Wind and solar output during the top 100 load hours: 2024**

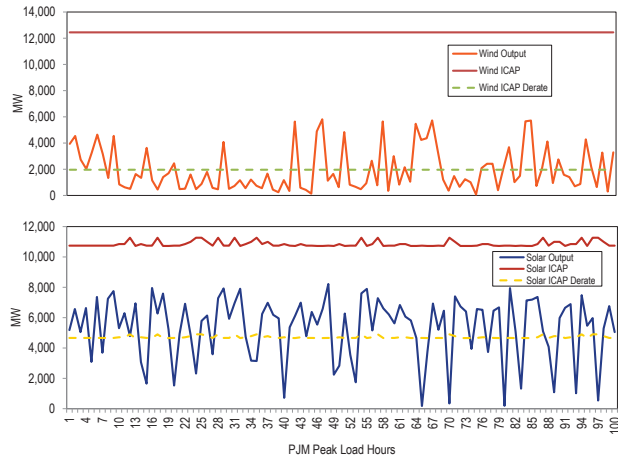

**Figure 8-15 Wind and solar output: 2024**

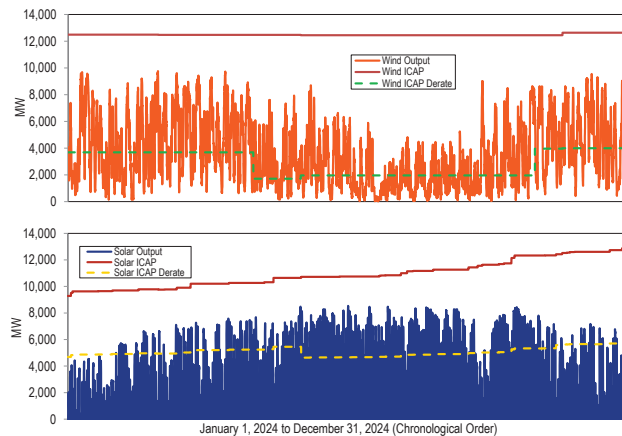


Figure 8-15 also shows the impacts of the ELCC rules and winter CIR rules on the derated capacity values. The wind figure shows a significant decrease in the derated capacity (dashed green line) on May 1 due to the winter CIRs reverting to the normal summer ratings. A small increase in the wind derated capacity occurs on June 1 due to the change in the onshore wind ELCC class rating from 15 percent to 21 percent.<sup>296</sup> The switch back to winter CIRs in November is reflected in the large increase in the derated wind capacity late in the year. The solar figure shows a decrease in derated capacity on June 1 due to the change in the solar ELCC class rating from 50 percent to 33 percent for fixed panel solar, and

from 61 percent to 50 percent for tracking panel solar.<sup>297</sup> The increases in the solar ICAP line and the wind ICAP line reflect new generators coming online.

## Wind Units

Table 8-33 shows the capacity factors of wind units in PJM. In 2024, the capacity factor of wind units in PJM was 28.6 percent. Wind units that were capacity resources had a capacity factor of 29.0 percent and an installed capacity of 11,628.4 MW. Wind units that were energy only had a capacity factor of 23.2 percent and an installed capacity of 854.9 MW. Wind capacity resources were derated to 14.7 or 17.6 percent of installed capacity for the capacity market prior to June 1, 2023, based on the wind farm terrain. Beginning June 1, 2023, wind capacity is derated to the ELCC accredited UCAP value.<sup>298</sup>

**Table 8-33 Capacity factor of wind units: 2024**

Type of Resource	Capacity Factor	Installed Capacity (MW)
Energy-Only Resource	23.2%	854.9
Capacity Resource	29.0%	11,628.4
All Units	28.6%	12,483.3

Wind units that are capacity resources are required, like all capacity resources except demand resources, to offer the energy associated with their cleared capacity in the day-ahead energy market and in the real-time energy market. Figure 8-16 shows the average hourly real-time generation and day-ahead commitment of wind units in PJM, by month and hour of the day for 2024. The hour with the highest average output in 2024 was hour 23 in March with an average of 5,662.9 MWh. The hour with the lowest average output in 2024 was hour 11 in August with an average of 1,048.7 MWh. Wind output in PJM is generally higher during off peak hours and lower during on peak hours. Wind output is generally highest during the months from November through March and lowest during the months from May through September.

Wind resources' day ahead commitments are lower than real-time generation for most hours. Table 8-34 provides a summary of the deviations between wind resources' real-time generation and day ahead commitments. In April 2024, hourly real-time generation exceeded day ahead commitments by 1,527.0 MWh on average, the highest average monthly deviation. The lowest monthly average deviation occurred in July with hourly real-time generation exceeding day ahead commitments by


<sup>297</sup> Id.

<sup>298</sup> ELCC rates and data are available on the PJM website <<https://www.pjm.com/planning/resource-adequacy-planning/effective-load-carrying-capability>>.

<sup>296</sup> ELCC Class Ratings for 2024-2025, PJM Interconnection, L.L.C. (December 29, 2023) <<https://www.pjm.com/planning/resource-adequacy-planning/effective-load-carrying-capability>>.

392.3 MWh on average. Wind generation exceeded day ahead commitments in 87.1 percent of hours in 2024. July had the highest number of hours, 30.2 percent, with day ahead commitments exceeding real time generation.

**Figure 8-16 Average hourly real-time generation and day ahead commitments of wind units: 2024**

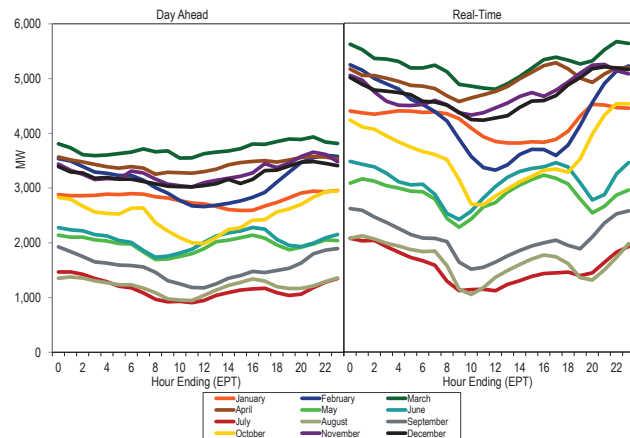

**Table 8-34 Deviations between real-time wind generation and day-ahead commitments by month: 2024<sup>299</sup>**

Month	Average Hourly Deviation	Minimum Hourly Deviation	Maximum Hourly Deviation	Hours with Negative Deviation
January	1,399.1	(636.0)	5,175.1	7.1%
February	1,145.0	(1,240.4)	4,166.9	13.1%
March	1,515.7	(859.4)	4,074.3	7.5%
April	1,527.0	(952.0)	4,516.5	7.4%
May	901.4	(1,158.8)	3,784.0	12.9%
June	1,045.9	(946.6)	3,670.4	8.9%
July	392.3	(2,113.9)	3,243.7	30.2%
August	451.3	(895.9)	2,676.4	24.6%
September	533.4	(838.8)	3,440.1	24.0%
October	1,093.3	(808.1)	3,731.2	11.7%
November	1,442.2	(288.6)	3,688.3	1.9%
December	1,477.7	(483.8)	3,664.7	5.6%

<sup>299</sup> Hourly deviations are equal to the real-time generation less day ahead commitments.

Table 8-35 shows the generation and capacity factor of wind units by month for 2023 and 2024.

**Table 8-35 Capacity factor of wind units in PJM by month: 2023 and 2024**

Month	2023		2024	
	Generation (MWh)	Capacity Factor	Generation (MWh)	Capacity Factor
January	2,913,720.6	34.3%	3,127,593.9	33.7%
February	3,440,914.0	44.8%	2,975,796.8	34.2%
March	3,573,934.8	42.1%	3,890,789.9	42.0%
April	2,798,644.4	33.6%	3,569,213.5	39.7%
May	2,063,557.4	23.8%	2,136,402.5	23.0%
June	1,661,899.5	18.8%	2,233,411.9	24.9%
July	1,001,020.4	10.9%	1,151,359.4	12.4%
August	1,470,474.4	15.9%	1,233,617.7	13.3%
September	1,318,984.9	14.7%	1,496,109.6	16.7%
October	2,685,058.3	28.8%	2,670,448.6	28.8%
November	3,146,489.1	34.3%	3,410,527.3	37.8%
December	2,917,283.9	30.8%	3,496,708.7	37.2%

Output from wind turbines displaces output from other generation types because, in general, wind turbines generate power when the wind is blowing, regardless of the price. This displacement affects the output of marginal units in PJM. The magnitude and type of effect on marginal unit output depends on the level of wind turbine output, its location, time and duration. One measure of this displacement is based on the mix of marginal units when wind is producing output.<sup>300</sup> Figure 8-17 and Table 8-36 show the hourly average proportion of marginal units by fuel type mapped to the hourly average MW of real-time wind generation in 2024. This is not an exact measure of displacement because it is not based on a redispatch of the system without wind resources. In 2024, the SCED dispatch instruction for marginal wind resources was to reduce output for 72.3 percent of the marginal wind unit intervals. When wind appears as the displaced fuel at times when wind resources were on the margin this means that there was no displacement for those hours, if the dispatch instruction was to lower the generation. The level of wind displaced by wind is thus overstated by this metric.

<sup>300</sup> The measure is based on the principle that any incremental change in the wind output is balanced by the change in the output of marginal generators, while holding everything else equal.

Figure 8-17 Marginal fuel at time of wind generation: 2024

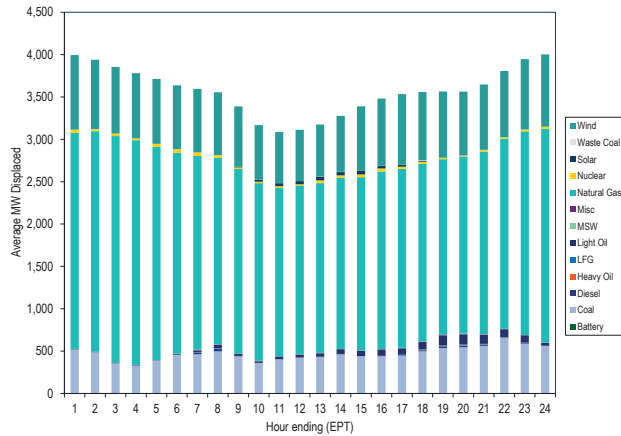


Table 8-36 Marginal fuel MW at time of wind generation: 2024

Hour	Battery	Coal	Diesel	Heavy Oil	LFG	Light Oil	MSW	Misc	Natural Gas	Nuclear	Solar	Waste Coal	Wind	Total
0	0.6	516.2	0.6	0.6	1.6	3.8	1.4	1.6	2,550.4	36.6	0.7	1.9	878.2	3,994.2
1	1.9	483.4	3.2	1.3	2.3	2.9	1.3	1.4	2,597.6	22.1	0.0	2.2	820.0	3,939.6
2	1.1	355.1	4.3	0.0	1.3	4.6	0.0	0.9	2,671.5	29.5	0.0	0.0	785.1	3,853.4
3	0.7	323.7	2.8	1.2	1.8	3.8	1.7	1.4	2,652.1	23.2	0.0	0.4	768.3	3,781.2
4	0.0	387.9	1.2	0.8	1.2	2.1	0.0	0.9	2,516.5	34.8	0.0	0.7	765.7	3,711.7
5	0.8	454.8	0.8	0.0	1.8	8.9	1.6	0.7	2,373.6	40.4	0.0	0.9	752.5	3,636.7
6	0.0	462.3	15.3	2.9	6.8	23.4	8.1	3.5	2,281.8	39.8	0.7	2.4	749.3	3,596.3
7	0.0	497.6	30.5	1.3	5.3	41.3	6.0	2.7	2,196.3	30.2	1.1	2.5	740.1	3,554.9
8	0.0	436.9	4.1	1.6	0.9	23.8	0.5	1.8	2,181.9	16.0	11.2	0.0	709.6	3,388.2
9	0.0	359.3	0.0	1.5	0.4	19.9	1.9	2.8	2,097.2	17.0	23.8	0.6	643.8	3,168.3
10	0.0	404.4	1.1	0.0	0.2	31.1	0.5	1.6	1,987.9	19.8	35.8	0.7	603.3	3,086.2
11	0.0	420.9	0.0	2.1	1.7	32.1	0.0	4.7	1,993.5	14.5	37.3	2.0	604.1	3,113.0
12	0.0	429.6	0.1	1.3	3.1	40.6	0.1	4.7	2,002.8	32.5	44.0	1.9	613.5	3,174.2
13	0.0	459.4	0.2	2.4	3.9	57.9	2.2	0.7	2,021.3	26.9	38.1	3.7	660.6	3,277.2
14	0.1	437.7	0.7	1.8	0.8	62.8	1.0	3.4	2,044.2	32.7	47.8	0.9	756.0	3,390.0
15	0.1	437.0	1.8	2.5	3.0	76.1	2.2	1.7	2,097.0	35.5	30.4	1.7	792.9	3,481.8
16	0.0	442.2	4.8	1.4	9.0	76.6	2.7	2.8	2,112.0	26.0	22.1	0.9	832.5	3,533.0
17	0.2	496.7	13.6	3.8	7.1	89.5	5.4	1.6	2,092.0	24.8	13.9	6.1	804.8	3,559.5
18	0.0	536.8	18.9	2.4	9.8	120.1	5.4	4.8	2,067.2	16.2	2.7	0.9	779.2	3,564.4
19	0.0	544.9	19.1	3.8	11.1	120.2	6.4	3.2	2,088.6	11.0	2.7	0.9	750.8	3,562.9
20	0.0	562.9	12.0	3.5	7.5	106.8	6.2	3.1	2,153.5	18.2	0.2	2.7	770.9	3,647.6
21	0.0	652.9	3.5	2.6	3.7	96.1	3.1	2.6	2,243.2	17.1	0.0	0.0	782.6	3,807.4
22	0.0	588.0	9.9	0.0	1.5	86.7	1.7	3.2	2,402.7	21.7	0.0	0.5	831.2	3,947.2
23	0.0	561.2	3.3	0.0	0.9	30.8	1.1	3.5	2,523.9	24.3	0.0	0.0	853.7	4,002.8
Average	0.2	468.8	6.3	1.6	3.6	48.4	2.5	2.5	2,247.9	25.5	13.0	1.4	752.0	3,573.8

## Solar Units

Solar units in PJM may be in front of or behind the meter. The data reported include all and only PJM solar units that are in front of the meter. As shown in Table 8-22, there are 14,387.7 MW of solar capacity registered in GATS that are PJM units. As shown in Table 8-23, there are 12,613.1 MW capacity of solar registered in GATS that are not PJM units. Some behind the meter generation exists in clusters, such as community solar farms. The customers of these clusters may or may not be located at the same node on the transmission system as the solar farm. When behind the meter generation and its associated load are at separate nodes, loads should pay for the appropriate level of transmission service, and should not be permitted to avoid paying appropriate costs as a result of badly designed rules, such as rules for netting. The MMU recommends that load and generation located at separate nodes be treated as separate resources.

Table 8-37 shows the capacity factor of solar units in PJM. The capacity factor of solar units in PJM was 18.2 percent for 2024. Solar units that were capacity resources had a capacity factor of 18.3 percent and an installed capacity of 10,109.6 MW. Solar units that were energy only had a capacity factor of 17.5 percent and an installed capacity of 826.6 MW. Solar capacity resources were derated to 38.0, 42.0 or 60.0 percent of installed capacity for the capacity market, prior to June 1, 2023, based on the installation type. Beginning June 1, 2023, solar capacity is derated to the ELCC accredited UCAP value.

**Table 8-37 Capacity factor of solar units: 2024**


Type of Resource	Capacity Factor	Installed Capacity (MW)
Energy-Only Resource	17.5%	826.6
Capacity Resource	18.3%	10,109.6
All Units	18.2%	10,936.2

Solar units that are capacity resources are required, like all capacity resources except demand resources, to offer the energy associated with their cleared capacity in the day-ahead energy market and in the real-time energy market. Figure 8-18 shows the average real-time generation and day-ahead commitments of solar units in PJM, by month and hour of day.<sup>301</sup> The hour with the highest average output in 2024, was hour 13 in June with an average of 7,020.4 MW. January has the lowest solar output. The hour in January with the highest average output was hour 13 with an average of 2,716.6 MW. Solar output in PJM is generally higher during peak hours and lower during off peak hours. Solar output is generally highest during the months from May through August and lowest during the months from November through February.

Solar unit day ahead commitments are lower than real-time generation for most hours. Table 8-38 provides a summary of the deviations between solar unit real-time generation and day ahead commitments. In June 2024, hourly real-time solar unit generation exceeded day ahead solar unit commitments by 652.1 MWh on average, the highest average monthly deviation. The lowest monthly average deviation occurred in January with hourly real-time solar unit generation exceeding day-ahead commitments by 152.7 MWh on average. Solar generation exceeded day-ahead commitments in 80.0 percent of hours in 2024. December had the highest number of hours, 63.7 percent, with day-ahead commitments exceeding real-time generation.

<sup>301</sup> The average day-ahead generation of solar units in PJM is greater than 0 for hours when the sun is down due to some solar units being paired with landfill units.

**Figure 8-18 Average hourly real-time generation and day ahead commitments of solar units: 2024**

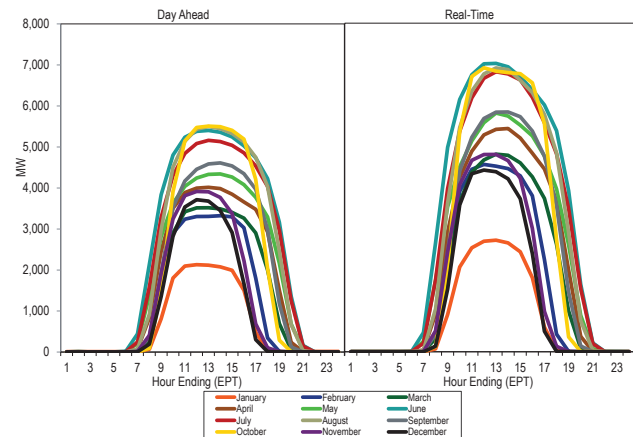

**Table 8-38 Deviations between real-time solar generation and day-ahead commitments by month: 2024<sup>302</sup>**

Month	Average Hourly Deviation	Minimum Hourly Deviation	Maximum Hourly Deviation	Hours with Negative Deviation
January	152.7	(550.9)	1,525.4	40.3%
February	366.1	(964.9)	2,298.2	11.9%
March	407.7	(1,184.1)	2,660.7	19.8%
April	469.7	(1,226.9)	2,675.1	12.4%
May	502.0	(571.4)	2,755.7	11.4%
June	652.1	(386.0)	3,077.7	11.1%
July	575.7	(1,168.6)	2,775.6	14.0%
August	495.5	(990.5)	2,377.7	10.9%
September	419.0	(1,083.7)	3,212.2	19.0%
October	520.8	(901.2)	2,560.4	7.8%
November	287.0	(864.7)	2,681.7	16.0%
December	230.0	(830.4)	2,490.9	63.7%

Table 8-39 shows the generation and capacity factor of solar units by month for 2023 and 2024.


**Table 8-39 Capacity factor of solar units by month: 2023 and 2024**

Month	2023		2024	
	Generation (MWh)	Capacity Factor	Generation (MWh)	Capacity Factor
January	417,821.3	9.9%	573,863.5	8.0%
February	598,407.5	15.2%	1,024,321.1	15.1%
March	927,131.9	21.1%	1,264,115.0	17.1%
April	1,062,635.2	24.9%	1,490,595.4	20.2%
May	1,244,370.9	28.1%	1,716,141.0	22.0%
June	1,172,402.9	25.0%	2,166,385.1	28.0%
July	1,332,825.0	26.2%	2,050,807.0	25.6%
August	1,203,177.8	23.1%	1,993,138.9	24.1%
September	970,013.7	18.1%	1,526,641.4	18.6%
October	894,877.5	15.8%	1,759,610.5	19.7%
November	763,314.1	12.3%	1,028,502.6	11.5%
December	544,172.5	7.9%	905,724.9	9.6%

<sup>302</sup> Hourly deviations are equal to the real-time generation less day ahead commitments.

Output from solar generators displaces output from other generation types because, in general, solar photovoltaic cells generate power when the sun is shining, regardless of the price. This displacement affects the output of marginal units in PJM. The magnitude and type of effect on marginal unit output depends on the level of solar photovoltaic cell output, its location, time and duration. One measure of this displacement is based on the mix of marginal units when a solar unit is producing output.<sup>303</sup> Figure 8-19 and Table 8-40 show the hourly average proportion of marginal units by fuel type mapped to the hourly average MW of real-time solar generation in 2024. This is not an exact measure of displacement because it is not based on a redispatch of the system without solar resources. In 2024, the SCED dispatch instruction for marginal solar resources was to reduce output for 97.8 percent of the marginal solar unit intervals. When solar appears as the displaced fuel at times when solar resources were on the margin this means that there was no displacement for those hours, if the dispatch instruction was to lower the generation. The level of solar displaced by solar is thus overstated by this metric.

**Figure 8-19 Marginal fuel at time of solar generation: 2024**

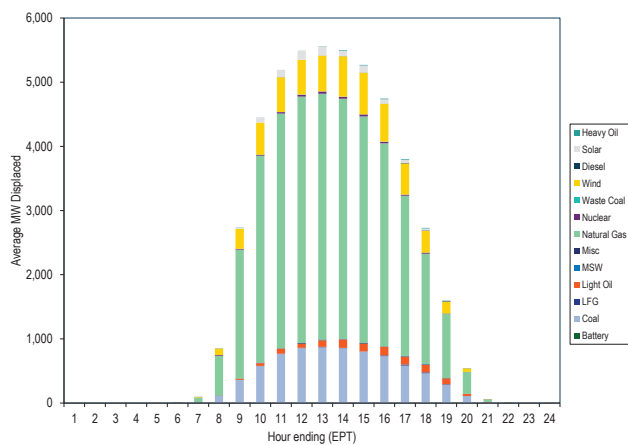

**Table 8-40 Marginal fuel MW at time of solar generation: 2024**

Hour	Battery	Coal	LFG	Light Oil	MSW	Misc	Natural Gas	Nuclear	Waste Coal	Wind	Diesel	Solar	Heavy Oil	Total
0	0.0	0.1	0.0	0.0	0.0	0.0	0.5	0.0	0.0	0.1	0.0	0.0	0.0	0.7
1	0.0	0.1	0.0	0.0	0.0	0.0	0.4	0.0	0.0	0.1	0.0	0.0	0.0	0.7
2	0.0	0.1	0.0	0.0	0.0	0.0	0.5	0.0	0.0	0.1	0.0	0.0	0.0	0.7
3	0.0	0.1	0.0	0.0	0.0	0.0	0.5	0.0	0.0	0.1	0.0	0.0	0.0	0.7
4	0.0	0.1	0.0	0.0	0.0	0.0	0.6	0.0	0.0	0.1	0.0	0.0	0.0	0.9
5	0.0	0.2	0.0	0.0	0.0	0.0	1.0	0.0	0.0	0.2	0.0	0.0	0.0	1.4
6	0.0	14.3	0.0	0.4	0.2	0.0	69.0	1.9	0.0	11.5	0.0	0.0	0.0	97.4
7	0.0	114.5	0.6	3.5	0.5	0.5	617.0	11.5	0.2	101.0	1.1	1.1	0.1	851.5
8	0.0	360.2	0.7	20.0	0.6	1.8	2,008.5	12.0	0.0	308.1	2.7	27.0	0.4	2,742.0
9	0.0	577.5	1.6	42.6	3.2	5.9	3,222.7	15.8	1.4	499.4	0.0	77.3	0.7	4,448.2
10	0.0	767.9	1.0	80.5	1.2	3.6	3,656.8	22.9	2.1	541.2	0.3	116.8	0.0	5,194.2
11	0.0	857.6	2.7	64.8	0.4	10.3	3,840.4	25.0	6.9	540.6	0.0	139.4	1.1	5,489.1
12	0.0	868.4	7.5	102.1	0.8	11.2	3,830.1	34.1	2.8	557.7	0.8	142.6	3.5	5,561.6
13	0.0	854.2	5.7	132.7	9.0	0.7	3,739.7	28.4	4.5	628.6	2.4	86.8	7.8	5,500.5
14	0.4	800.9	3.1	122.4	1.3	8.2	3,529.5	31.6	0.9	648.0	4.5	110.6	8.6	5,270.0
15	0.4	730.6	11.1	134.6	2.4	6.2	3,162.1	22.3	4.7	589.7	1.7	68.0	9.6	4,743.4
16	0.0	584.1	16.9	123.0	4.6	8.2	2,493.7	16.0	1.7	487.2	6.4	48.0	11.6	3,801.2
17	0.8	464.2	14.2	118.5	7.3	4.5	1,717.2	17.0	0.9	339.2	7.0	30.8	7.4	2,729.1
18	0.0	284.8	9.2	90.5	3.0	3.3	997.2	8.0	0.4	184.0	9.0	2.3	3.7	1,595.6
19	0.0	109.7	1.1	33.0	1.2	0.8	337.4	2.3	0.1	54.1	2.2	1.6	2.9	546.4
20	0.0	12.5	0.2	3.9	0.0	0.1	34.9	0.1	0.0	5.5	0.3	0.0	0.2	57.7
21	0.0	0.3	0.0	0.1	0.0	0.0	1.0	0.0	0.0	0.2	0.0	0.0	0.0	1.5
22	0.0	0.2	0.0	0.0	0.0	0.0	0.9	0.0	0.0	0.2	0.0	0.0	0.0	1.4
23	0.0	0.1	0.0	0.0	0.0	0.0	0.5	0.0	0.0	0.1	0.0	0.0	0.0	0.7
Average	0.1	308.4	3.1	44.7	1.5	2.7	1,385.9	10.4	1.1	229.1	1.6	35.5	2.4	2,026.5

<sup>303</sup> The measure is based on the principle that any incremental change in the solar output is balanced by the change in the output of marginal generators, while holding everything else equal.





# Interchange Transactions

PJM market participants import energy from, and export energy to, external regions continuously. The transactions involved may fulfill long-term or short-term bilateral contracts or respond to price differentials. The external regions include both market and nonmarket balancing authorities.

## Overview

### Interchange Transaction Activity

- **Aggregate Imports and Exports in the Real-Time Energy Market.** In 2024, PJM was a monthly net exporter of energy in the real-time energy market in all months.<sup>1</sup> In 2024, the real-time net interchange was -32,692.0 GWh. The real-time net interchange in 2023 was -38,897.2 GWh.
- **Aggregate Imports and Exports in the Day-Ahead Energy Market.** In 2024, PJM was a monthly net exporter of energy in the day-ahead energy market in all months. In 2024, the total day-ahead net interchange was -29,489.4 GWh. The day-ahead net interchange in 2023 was -34,267.2 GWh.
- **Aggregate Imports and Exports in the Day-Ahead and the Real-Time Energy Market.** In 2024, gross imports in the day-ahead energy market were 75.6 percent of gross imports in the real-time energy market (107.3 percent in 2023). In 2024, gross exports in the day-ahead energy market were 85.5 percent of the gross exports in the real-time energy market (91.7 percent in 2023).
- **Interface Imports and Exports in the Real-Time Energy Market.** In 2024, there were net scheduled exports at 13 of PJM's 19 interfaces in the real-time energy market.
- **Interface Pricing Point Imports and Exports in the Real-Time Energy Market.** In 2024, there were net scheduled exports at five of PJM's seven interface pricing points eligible for real-time transactions in the real-time energy market.
- **Interface Imports and Exports in the Day-Ahead Energy Market.** In 2024, there were net scheduled exports at 14 of PJM's 19 interfaces in the day-ahead energy market.

- **Interface Pricing Point Imports and Exports in the Day-Ahead Energy Market.** In 2024, there were net scheduled exports at six of PJM's seven interface pricing points eligible for day-ahead transactions in the day-ahead energy market.
- **Up To Congestion Interface Pricing Point Imports and Exports in the Day-Ahead Energy Market.** In 2024, up to congestion transactions were net exports at four of PJM's seven interface pricing points eligible for day-ahead transactions in the day-ahead energy market.
- **Inadvertent Interchange.** In 2024, net scheduled interchange was -32,692.0 GWh and net actual interchange was -32,867.8 GWh, a difference of 175.8 GWh. In 2023, the difference was 106.5 GWh. This difference is inadvertent interchange.
- **Loop Flows.** In 2024, the Northern Indiana Public Service (NIPS) Interface had the largest loop flows of any interface with -480.1 GWh of net scheduled interchange and -12,826.2 GWh of net actual interchange, a difference of 12,346.1 GWh. In 2024, the SOUTH interface pricing point had the largest loop flows of any interface pricing point with 6,048.2 GWh of net scheduled interchange and 14,666.0 GWh of net actual interchange, a difference of 8,617.8 GWh.

## Interactions with Bordering Areas

### PJM Interface Pricing with Organized Markets

- **PJM and MISO Interface Prices.** In 2024, the direction of the hourly flow was consistent with the real-time hourly price differences between the PJM/MISO Interface and the MISO/PJM Interface in 55.2 percent of the hours.
- **PJM and New York ISO Interface Prices.** In 2024, the direction of the hourly flow was consistent with the real-time hourly price differences between the PJM/NYIS Interface and the NYISO/PJM proxy bus in 62.7 percent of the hours.
- **Neptune Underwater Transmission Line to Long Island, New York.** In 2024, the hourly flow (PJM to NYISO) was consistent with the real-time hourly price differences between the PJM Neptune Interface and the NYISO Neptune bus in 78.9 percent of the hours.

<sup>1</sup> Calculated values shown in Section 9, "Interchange Transactions," are based on unrounded, underlying data and may differ from calculations based on the rounded values in the tables.

- **Linden Variable Frequency Transformer (VFT) Facility.** In 2024, the hourly flow (PJM to NYISO) was consistent with the real-time hourly price differences between the PJM Linden Interface and the NYISO Linden bus in 79.5 percent of the hours.
- **Hudson DC Line.** In 2024, the hourly flow (PJM to NYISO) was consistent with the real-time hourly price differences between the PJM Hudson Interface and the NYISO Hudson bus in 80.5 percent of the hours.

## Interchange Transaction Issues

- **PJM Transmission Loading Relief Procedures (TLRs).** PJM issued zero TLRs of level 3a or higher in 2024, and zero such TLRs in 2023.
- **Up To Congestion.** The average number of up to congestion bids submitted in the day-ahead energy market decreased by 39.3 percent, from 60,524 bids per day in 2023 to 36,760 bids per day in 2024. The average cleared volume of up to congestion bids submitted in the day-ahead energy market decreased by 46.0 percent, from 479,134 MWh per day in 2023, to 258,566 MWh per day in 2024.

## Recommendations

- The MMU recommends that PJM implement rules to prevent sham scheduling. The MMU recommends that PJM apply after the fact market settlement adjustments to identified sham scheduling segments to ensure that market participants cannot benefit from sham scheduling. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM implement a validation method for submitted transactions that would prohibit market participants from breaking transactions into smaller segments to defeat the interface pricing rule by concealing the true source or sink of the transaction. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM implement a validation method for submitted transactions that would require market participants to submit transactions on paths that reflect the expected actual power flow in order to reduce unscheduled loop flows. (Priority: Medium. First reported 2013. Status: Not adopted.)

- The MMU recommends that transactions sourcing in the Western Interconnection be priced at either the MISO interface pricing point or the SOUTH interface pricing point based on the locational price impact of flows between the DC tie line point of connection with the Eastern Interconnection and PJM. (Priority: High. First reported 2020. Status: Not adopted.)
- The MMU recommends that PJM eliminate the IMO interface pricing point, and assign the transactions that originate or sink in the IESO balancing authority to the MISO interface pricing point. (Priority: Medium. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM monitor, and adjust as necessary, the weights applied to the components of the interfaces to ensure that the interface prices reflect ongoing changes in system conditions. (Priority: Low. First reported 2009. Status: Adopted 2024.)
- The MMU recommends that PJM review the mappings of external balancing authorities to individual interface pricing points to reflect changes to the impact of the external power source on PJM tie lines as a result of system topology changes. The MMU recommends that this review occur at least annually. (Priority: Low. First reported 2009. Status: Not adopted.)
- The MMU recommends that, in order to permit a complete analysis of loop flow, FERC and NERC ensure that the identified data are made available to market monitors as well as other industry entities determined appropriate by FERC. (Priority: Medium. First reported 2003. Status: Not adopted.)
- The MMU recommends that PJM explore an interchange optimization solution with its neighboring balancing authorities that would remove the need for market participants to schedule physical transactions across seams. Such a solution would include an optimized, but limited, joint dispatch approach that uses supply curves and treats seams between balancing authorities as constraints, similar to other constraints within an LMP market. (Priority: Medium. First reported 2014. Status: Not adopted.)
- The MMU recommends that PJM permit unlimited spot market imports as well as unlimited nonfirm

point to point willing to pay congestion imports and exports at all PJM interfaces in order to improve the efficiency of the market. (Priority: Medium. First reported 2012. Status: Not adopted.)

- The MMU recommends that the emergency interchange cap be replaced with a market based solution. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that the submission deadline for real-time dispatchable transactions be modified from 1800 on the day prior, to three hours prior to the requested start time, and that the minimum duration be modified from one hour to 15 minutes. These changes would give PJM a more flexible product that could be used to meet load in the most economic manner. (Priority: Medium. First reported 2014. Status: Partially adopted, 2015.)
- The MMU recommends eliminating the mechanism that defines FFE and M2M payments. These mechanisms are not consistent with markets and are not needed for efficient interface pricing. The MMU recommends that PJM file with the Commission to eliminate the FFE calculation and M2M payment of the PJM and MISO joint operating agreement. (Priority: Medium. First reported Q2 2024. Status: Not adopted.)
- The MMU recommends clear, explicit and detailed rules that define the conditions under which PJM will and will not recall energy from PJM capacity resources and prohibit new energy exports from PJM capacity resources. The MMU recommends that those rules define the conditions under which PJM will purchase emergency energy while at the same time not recalling energy exports from PJM capacity resources. The MMU recommends clear rules governing when PJM may recall capacity backed exports. (Priority: Medium. First reported 2010. Status: Partially adopted.)

## Conclusion

Transactions between PJM and multiple balancing authorities in the Eastern Interconnection are part of a single energy market. While some of these balancing authorities are termed market areas and some are termed nonmarket areas, all electricity transactions are part of a single energy market. Nonetheless, there are significant differences between market and nonmarket areas.

Market areas, like PJM, include essential features of an energy market including locational marginal pricing, financial congestion offsets (FTRs and ARRs in PJM) and transparent, least cost, security constrained economic dispatch for all available generation. Nonmarket areas do not include these features. Pricing in the market areas is transparent and pricing in the nonmarket areas is not transparent.

The MMU's recommendations related to transactions with external balancing authorities all share the goal of improving the economic efficiency of interchange transactions. The standard of comparison is an LMP market. In an LMP market, redispatch based on LMP and competitive generator offers results in an efficient dispatch and efficient prices. The goal of designing interface transaction rules should be to match the outcomes that would exist in an LMP market across the interfaces.

It is not appropriate to have special pricing agreements between PJM and any external entity. The same market pricing should apply to all transactions. External entities wishing to receive the benefits of the PJM LMP market should join PJM.

In 2020, PJM terminated a number of interface pricing points, consistent with longstanding MMU recommendations. Following the termination of the Northwest pricing point on October 1, 2020, PJM failed to correctly map the pricing points to transactions that had been mapped to the Northwest pricing point to pricing points that are consistent with electrical impacts on the PJM system. The MMU recommends that transactions sourcing in the Western Interconnection be priced at either the MISO interface pricing point or the SOUTH interface pricing point based on the electrical impact of flows between the DC tie line point of connection with the Eastern Interconnection and PJM. The MMU continues to recommend the termination of the Ontario interface pricing point. The Ontario interface pricing point is noncontiguous to the PJM footprint that creates opportunities for market participants to engage in sham scheduling activities.

## Interchange Transaction Activity

### Charges and Credits Applied to Interchange Transactions

Interchange transactions are subject to various charges and credits. These charges and credits are dependent on whether the interchange transaction is submitted in the real-time or day-ahead energy market, the type of transaction, the transmission service used and whether the transaction is an import, export or wheel. Table 9-1 shows the billing line items that represent the charges and credits applied to real-time and day-ahead interchange transactions.<sup>2</sup>

**Table 9-1 Charges and credits applied to interchange transactions**

Billing Item	Real-Time Transactions				Day-Ahead Transactions				Up to Congestion
	Import (Firm or Non Firm)	Import (Spot in)	Export	Wheel	Import (Firm or Non Firm)	Import (Spot in)	Export	Wheel	
Firm or Non-Firm Point-to-Point Transmission Service	X		X <sup>1</sup>	X <sup>1</sup>	X		X <sup>1</sup>	X <sup>1</sup>	
Spot Import Service		X <sup>2</sup>				X <sup>2</sup>			
Day-ahead Spot Market Energy					X	X	X		
Balancing Spot Market Energy	X	X	X						
Day-ahead Transmission Congestion					X	X	X	X	X
Balancing Transmission Congestion	X	X	X	X					X
Day-ahead Transmission Losses					X	X	X	X	X
Balancing Transmission Losses	X	X	X	X					X
PJM Scheduling, System Control and Dispatch Service - Control Area Administration	X		X	X	X		X	X	
PJM Scheduling, System Control and Dispatch Service - Market Support	X	X	X		X	X	X		X
PJM Scheduling, System Control and Dispatch Service - Advanced Second Control Center	X	X	X	X	X	X	X	X	X
PJM Scheduling, System Control and Dispatch Service - Market Support Offset	X	X	X		X	X	X		X
PJM Settlement, Inc.	X	X	X		X	X	X		X
Market Monitoring Unit (MMU) Funding	X	X	X		X	X	X		X
FERC Annual Recovery	X		X	X	X		X	X	
Organization of PJM States, Inc. (OPSI) Funding	X		X	X	X		X	X	
Synchronous Condensing			X				X		
Transmission Owner Scheduling, System Control and Dispatch Service	X		X	X	X		X	X	
Reactive Supply and Voltage Control from Generation and Other Sources Service	X		X	X	X		X	X	
Day-ahead Operating Reserve					X	X	X		X
Balancing Operating Reserve	X	X	X						X
Black Start Service	X		X	X	X		X	X	
Marginal Loss Surplus Allocation (for those paying for transmission service only)			X				X		

<sup>1</sup> No charge if Point of Delivery is MISO

<sup>2</sup> No charge for spot in transmission

<sup>2</sup> For an explanation and current rate for each billing line item, see "Quick Reference Guide to Market Settlements By Type of Business" (February 1, 2023) <<https://www.pjm.com/-/media/DotCom/training/core-curriculum/ip-ms-301/ms-301-quick-reference-guide-to-market-settlements-by-type-of-business.pdf>>.

## Aggregate Imports and Exports

Table 9-2 shows the real-time and day-ahead scheduled interchange totals for 2023 and 2024. In 2024, gross imports in the day-ahead energy market were 75.6 percent of gross imports in the real-time energy market (107.3 percent in 2023). In 2024, gross exports in the day-ahead energy market were 85.5 percent of gross exports in the real-time energy market (71.7 percent in 2023).




**Table 9-2 Real-time and day-ahead scheduled interchange volumes (GWh): 2023 and 2024**

Category	2023	2024	Percent Change
Real-Time Gross Imports	14,955.9	15,735.5	5.2%
Real-Time Gross Exports	54,853.1	48,427.5	(11.7%)
Real-Time Net Interchange	(39,897.2)	(32,692.0)	(18.1%)
Day-Ahead Gross Imports	16,050.6	11,901.9	(25.8%)
Day-Ahead Gross Exports	50,317.9	41,391.3	(17.7%)
Day-Ahead Net Interchange	(34,267.2)	(29,489.4)	(13.9%)
Monthly Average Real-Time Gross Exports	4,571.1	4,035.6	(11.7%)
Monthly Average Real-Time Gross Imports	1,246.3	1,311.3	5.2%
Monthly Average Day-Ahead Gross Exports	4,193.2	3,449.3	(17.7%)
Monthly Average Day-Ahead Gross Imports	1,337.6	991.8	(25.9%)

In 2024, PJM was a monthly net exporter of energy in the real-time energy market in all months. In 2024, PJM was a monthly net exporter of energy in the day-ahead energy market in all months (Figure 9-1).<sup>3</sup>

Figure 9-1 shows real-time and day-ahead import, export and net interchange volumes. The day-ahead totals include fixed, dispatchable and up to congestion transaction totals. The net interchange of up to congestion transactions are represented by the orange line.

Transactions in the day-ahead energy market create financial obligations to deliver in the real-time energy market and to pay operating reserve charges based on differences between the transaction MWh in the day-ahead and real-time energy markets times the applicable operating reserve rates. Up to congestion transactions also create financial obligations to deliver in real time, but did not pay operating reserve charges until November 1, 2020.

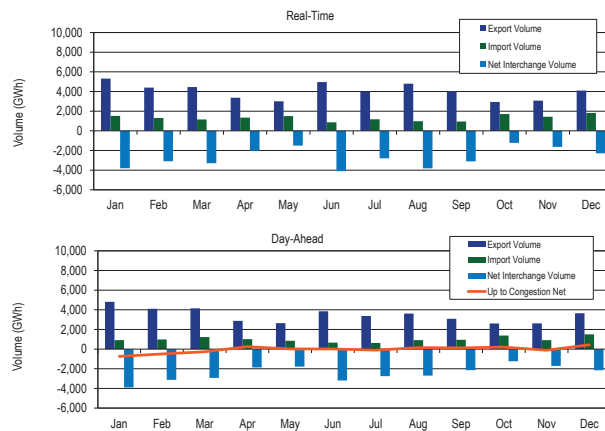**Figure 9-1 Scheduled imports and exports: 2024**

<sup>3</sup> Calculated values shown in Section 9, "Interchange Transactions," are based on unrounded, underlying data and may differ from calculations based on the rounded values in the tables.

Figure 9-2 shows the real-time and day-ahead import and export volume for PJM from January 1999 through December 2024. PJM shifted from a consistent net importer of energy to relatively consistent net exporter of energy in 2004 in both the real-time and day-ahead energy markets, coincident with the expansion of the PJM footprint that included the integrations of Commonwealth Edison, American Electric Power and Dayton Power and Light into PJM. The net direction of power flows is generally a function of price differences net of transactions costs. Since the modification of the up to congestion product in September 2010, up to congestion transactions have played a significant role in power flows between PJM and external balancing authorities in the day-ahead energy market. On November 1, 2012, PJM eliminated the requirement that every up to congestion transaction include an interface pricing point as either the source or sink. As a result, the volume of import and export up to congestion transactions decreased, and the volume of internal up to congestion transactions increased. While the gross import and export volumes in the day-ahead energy market decreased, PJM has remained primarily a net exporter in the day-ahead energy market. The requirement for external capacity resources to be pseudo tied into PJM has affected the real-time and day-ahead import volumes. Prior to June 1, 2016, these units were dynamically scheduled into PJM or were block scheduled into PJM and were part of scheduled interchange as imports. Pseudo tied units are treated as internal generation and therefore do not affect interchange volume. The reduction of the import volume based on the switch to pseudo tie status contributed to PJM remaining a net exporter in the real-time and day-ahead energy markets. On February 20, 2018, FERC issued an order limiting the eligible bidding points for up to congestion transactions to hubs, residual metered load and interfaces.<sup>4</sup> As a result, the volume of import and export up to congestion transactions increased, contributing to PJM becoming a net importer in the day-ahead energy market starting in March 2018. On July 16, 2020, FERC issued an order directing PJM to revise uplift allocation rules to allocate uplift to up to congestion transactions.<sup>5</sup> The Order requires PJM to treat an up to congestion transaction, for uplift allocation purposes, as if the up to congestion transaction were equivalent to a DEC at its sink point. On November 1, 2020, PJM began allocating uplift to


<sup>4</sup> 162 FERC ¶ 61,139.

<sup>5</sup> 172 FERC ¶ 61,046.

up to congestion transactions. As a result, the volume of up to congestion transactions decreased. In February 2021, winter storms caused significant generation outages in Texas and resulted in power outages across the Electric Reliability Council of Texas (ERCOT) region. These outages occurred between February 10, 2021, and February 27, 2021. During this time, ERCOT imported generation from neighboring regions. While PJM did not have any scheduled exports directly to the ERCOT region, PJM exports during this time increased from an average hourly export of 4,772 MW per hour between February 1 and February 10, 2021, to 7,003 MW per hour between February 10 and February 27, 2021.

On June 13, 2022, PJM experienced several intervals of shortage pricing that resulted in high LMPs during the period from 1450 (EPT) through 1800 (EPT). PJM remained a net exporter of energy throughout the period despite the fact that PJM prices were much higher than MISO prices. PJM net exports averaged 4,431 MW during hours ending 1500 (EPT) through 1800 (EPT), a slight decrease from average net exports of 5,560 MW during the hours ending 1100 (EPT) through 1400 (EPT). Market participant response to the pricing signals in this period was affected by TLRs issued by MISO, SWPP and PJM, although the curtailments of scheduled imports to PJM were relatively small compared to the net exports. Export transactions to MISO continued to flow during this period primarily on firm and grandfathered transmission service. The lack of response to relative prices on the PJM/MISO interface was consistent with the ongoing pattern that there are net exports from PJM to MISO in almost every hour, regardless of relative prices. In 2024, flows were in the uneconomic direction on the PJM/MISO interface in 44.8 percent of all hours.

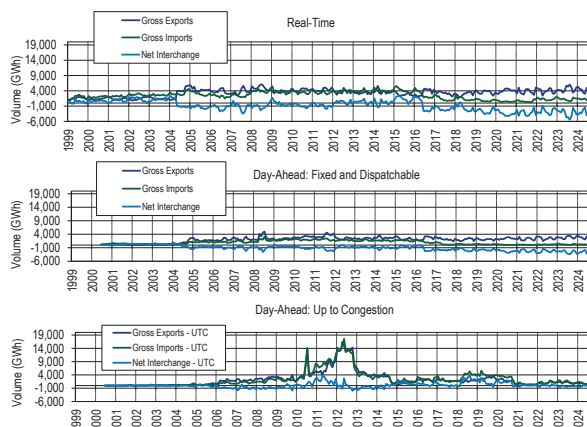**Figure 9-2 Scheduled import and export transaction volume history: January 1, 1999 through December 31, 2024**



## Real-Time Interface Imports and Exports

In the real-time energy market, scheduled imports and exports are defined by the scheduled path, which is the transmission path a market participant selects from the original source to the final sink. These scheduled flows are measured at each of PJM's interfaces with neighboring balancing authorities. Table 9-19 includes a list of active interfaces in 2024. Figure 9-3 shows the approximate geographic location of the interfaces. In 2024, PJM had 19 interfaces with neighboring balancing authorities. While the Linden (LIND) Interface, the Hudson (HUDS) Interface and the Neptune (NEPT) Interface are separate from the NYIS Interface, all four are interfaces between PJM and the NYISO. There are 10 separate interfaces that make up the MISO Interface between PJM and MISO. Table 9-3 through Table 9-5 show the real-time energy market scheduled interchange totals at the individual NYISO interfaces, as well as with the NYISO as a whole. Similarly, the scheduled interchange totals at the individual interfaces between PJM and MISO are shown, as well as with MISO as a whole. Net scheduled interchange in the real-time energy market is shown by interface for 2024 in Table 9-3, while gross scheduled imports and exports are shown in Table 9-4 and Table 9-5.

In the real-time energy market, in 2024, there were net scheduled exports at 13 of PJM's 19 interfaces. The top three net exporting interfaces in the real-time energy market accounted for 51.3 percent of the total net

scheduled exports: PJM/NYISO (NYIS) with 22.5 percent, PJM/MidAmerican Energy Company (MEC) with 14.7 percent and PJM/Neptune (NEPT) with 14.1 percent of the net scheduled export volume. The four separate interfaces that connect PJM to the NYISO (PJM/NYIS, PJM/NEPT, PJM/HUDS and PJM/Linden (LIND)) together represented 51.9 percent of the total net PJM scheduled exports in the real-time energy market. There were net scheduled exports in the real-time energy market at eight of the 10 separate interfaces that connect PJM to MISO. Those eight exporting interfaces represented 45.8 percent of the total net PJM scheduled exports in the real-time energy market.

In the real-time energy market, in 2024, there were net scheduled imports at five of PJM's 19 interfaces. The top two importing interfaces in the real-time energy market accounted for 87.7 percent of the total net scheduled imports: PJM/Duke (DUK) with 58.9 percent and PJM/Ameren-Illinois (AMIL) with 28.8 percent of the total net scheduled import volume. The four separate interfaces that connect PJM to the NYISO (PJM/NYIS, PJM/NEPT, PJM/HUDS and PJM/Linden (LIND)) had net scheduled exports in the real-time energy market. There were net scheduled imports in the real-time energy market at one of the 10 separate interfaces that connect PJM to MISO (Ameren-Illinois (AMIL)). This importing interface represented 28.8 percent of the total net PJM scheduled imports in the real-time energy market.<sup>6</sup>

**Table 9-3 Real-time scheduled net interchange volume by interface (GWh): 2024**

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	(60.5)	(11.3)	34.9	12.7	144.4	3.2	(7.7)	(19.0)	(2.9)	(11.5)	28.4	20.8	131.7
CPLW	0.0	0.0	0.0	0.1	1.0	0.4	0.9	0.4	0.0	(0.1)	0.0	0.0	2.8
DUK	349.4	651.4	465.2	427.9	436.6	(215.9)	254.7	180.6	114.6	462.1	362.9	366.5	3,855.9
LGEE	(89.3)	(91.1)	(101.0)	(50.7)	(55.7)	(66.5)	(67.4)	(68.2)	(58.7)	(66.5)	(90.6)	(101.8)	(907.6)
MISO	(1,798.4)	(2,048.3)	(2,097.1)	(1,367.9)	(995.1)	(2,004.9)	(1,100.9)	(1,873.0)	(1,458.0)	(307.9)	(403.6)	(622.5)	(16,077.7)
ALTE	(495.5)	(508.9)	(613.7)	(409.0)	(221.7)	(435.2)	(230.4)	(335.9)	(123.7)	(38.9)	(45.7)	(80.0)	(3,538.6)
ALTW	(19.3)	(28.7)	(46.7)	(45.4)	(36.7)	(83.9)	(4.3)	(29.6)	1.4	11.7	9.6	(6.6)	(278.6)
AMIL	204.0	51.9	117.3	257.5	104.7	(16.8)	138.0	44.0	84.3	238.7	308.2	349.4	1,881.1
CIN	(696.8)	(699.5)	(626.0)	(485.4)	(235.5)	(573.7)	(370.2)	(625.0)	(451.1)	(13.0)	(160.6)	(347.9)	(5,284.6)
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	3.4	(3.6)	(5.4)	(16.5)	(11.7)	(27.0)	(7.3)	(11.5)	(22.9)	(7.2)	(25.7)	19.0	(116.5)
MEC	(464.9)	(492.9)	(467.6)	(487.3)	(500.1)	(490.9)	(446.5)	(542.0)	(532.1)	(396.0)	(426.8)	(517.6)	(5,764.6)
MECS	(228.7)	(263.7)	(329.7)	(107.8)	(55.0)	(227.0)	(68.8)	(237.4)	(217.1)	9.8	22.8	140.9	(1,561.6)
NIPS	(0.5)	(1.2)	(0.5)	(0.4)	(0.8)	(17.5)	(40.5)	(52.6)	(100.2)	(77.1)	(88.7)	(100.1)	(480.1)
WEC	(100.1)	(101.6)	(125.0)	(73.6)	(38.2)	(132.9)	(71.0)	(82.9)	(96.6)	(35.8)	3.2	(79.5)	(934.2)
NYISO	(2,222.8)	(1,824.3)	(1,748.7)	(1,131.4)	(1,127.8)	(1,695.8)	(1,693.2)	(1,841.0)	(1,620.1)	(1,628.7)	(1,657.4)	(2,177.3)	(20,368.4)
HUDS	(416.4)	(375.4)	(369.0)	(213.4)	(173.4)	(284.1)	(334.1)	(387.4)	(277.0)	(224.3)	(209.3)	(171.7)	(3,435.4)
LIND	(235.4)	(221.1)	(235.1)	(145.9)	(213.2)	(210.3)	(210.3)	(222.7)	(225.2)	(237.4)	(175.1)	(237.8)	(2,569.5)
NEPT	(491.9)	(465.7)	(499.0)	(471.8)	(391.9)	(470.2)	(494.9)	(497.6)	(337.0)	(496.6)	(425.1)	(493.5)	(5,535.2)
NYIS	(1,079.1)	(762.0)	(645.7)	(300.3)	(349.3)	(731.1)	(653.8)	(733.3)	(780.9)	(670.4)	(848.0)	(1,274.3)	(8,828.3)
TVA	17.1	229.3	153.7	79.2	92.8	(118.4)	(187.0)	(196.5)	(76.1)	326.4	120.5	230.3	671.3
Total	(3,804.4)	(3,094.3)	(3,293.1)	(2,030.1)	(1,503.8)	(4,097.8)	(2,800.5)	(3,816.7)	(3,101.2)	(1,226.2)	(1,639.8)	(2,284.0)	(32,692.0)

<sup>6</sup> In the real-time energy market, one PJM interface had a net interchange of zero (PJM/City Water Light & Power (CWLP)). CWLP is a balancing authority on the western side of MISO.

Table 9-4 Real-time scheduled gross import volume by interface (GWh): 2024

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPLE	13.1	12.1	86.9	46.6	170.8	36.6	24.3	24.6	66.3	40.7	48.1	53.2	623.0
CPLW	0.0	0.0	0.0	0.3	1.0	0.4	0.9	0.4	0.0	0.0	0.0	0.0	3.0
DUK	481.5	668.5	475.1	473.3	460.0	168.7	365.1	269.5	271.0	510.7	424.7	414.1	4,982.2
LGEE	29.4	4.4	2.2	1.6	0.7	10.5	25.1	13.7	8.9	18.1	1.0	7.2	122.8
MISO	568.6	216.2	237.0	410.8	476.4	311.6	405.9	301.4	244.9	614.0	617.9	774.6	5,179.3
ALTE	47.9	6.7	18.1	11.7	23.6	8.9	14.3	13.4	17.3	41.8	27.2	8.7	239.7
ALTW	0.0	0.0	7.3	1.5	1.8	2.8	2.4	3.8	6.7	20.4	14.9	9.8	71.3
AMIL	224.8	67.5	126.7	257.9	112.1	133.6	143.3	132.4	108.9	245.5	309.3	351.7	2,213.7
CIN	67.9	16.6	7.9	16.9	150.8	52.9	54.4	42.1	43.2	162.8	84.2	75.7	775.5
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	23.1	0.4	0.0	1.8	1.9	1.2	4.1	2.1	0.2	7.2	1.6	38.0	81.7
MEC	16.8	20.8	19.5	16.8	18.4	28.1	25.1	25.9	16.7	21.2	25.5	38.7	273.6
MECS	174.0	86.4	36.2	60.7	126.1	54.3	111.2	60.2	41.8	93.1	101.3	235.7	1,181.0
NIPS	(0.5)	(0.4)	(0.4)	(0.4)	(0.5)	(0.6)	(0.6)	(0.6)	(0.6)	(0.5)	(0.6)	(0.6)	(6.4)
WEC	14.5	18.2	21.7	43.9	42.3	30.4	51.7	22.1	10.6	22.3	54.6	17.0	349.3
NYISO	134.2	121.9	122.7	121.3	141.8	149.0	151.3	138.7	116.7	127.0	114.3	132.7	1,571.4
HUDS	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
LIND	0.0	0.0	0.0	0.0	0.0	0.0	2.3	0.3	0.0	0.0	0.0	0.0	2.6
NEPT	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.4
NYIS	134.1	121.9	122.6	121.2	141.7	148.9	148.9	138.4	116.6	127.0	114.3	132.6	1,568.2
TVA	288.2	283.1	234.8	287.3	243.6	189.9	208.5	226.4	236.4	395.4	227.6	432.5	3,253.8
Total	1,514.9	1,306.2	1,158.5	1,341.2	1,494.2	866.7	1,181.0	974.6	944.1	1,705.9	1,433.7	1,814.2	15,735.5

Table 9-5 Real-time scheduled gross export volume by interface (GWh): 2024

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPLE	73.6	23.3	52.0	33.8	26.4	33.3	31.9	43.6	69.3	52.1	19.7	32.4	491.3
CPLW	0.0	0.0	0.0	0.2	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.3
DUK	132.1	17.1	9.9	45.3	23.4	384.7	110.4	88.9	156.4	48.7	61.8	47.6	1,126.2
LGEE	118.7	95.6	103.2	52.3	56.4	77.0	92.5	81.9	67.6	84.6	91.6	108.9	1,030.4
MISO	2,367.0	2,264.5	2,334.1	1,778.8	1,471.5	2,316.5	1,506.8	2,174.4	1,702.8	921.9	1,021.6	1,397.2	21,257.0
ALTE	543.3	515.6	631.8	420.7	245.3	444.1	244.7	349.3	141.1	80.7	72.9	88.7	3,778.3
ALTW	19.3	28.7	54.0	46.8	38.6	86.8	6.6	33.4	5.3	8.8	5.3	16.4	350.0
AMIL	20.8	15.7	9.4	0.5	7.5	150.3	5.3	88.4	24.6	6.9	1.0	2.3	332.6
CIN	764.7	716.1	633.9	502.3	386.3	626.6	424.6	667.1	494.4	175.8	244.8	423.6	6,060.1
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	19.8	4.0	5.4	18.3	13.6	28.3	11.4	13.7	23.1	14.5	27.3	19.0	198.2
MEC	481.6	513.7	487.1	504.1	518.5	519.0	471.6	567.9	548.8	417.2	452.3	556.3	6,038.2
MECS	402.7	350.1	365.9	168.5	181.1	281.3	179.9	297.6	258.9	83.4	78.5	94.8	2,742.6
NIPS	0.0	0.8	0.1	0.0	0.2	16.9	39.9	52.0	99.6	76.6	88.1	99.5	473.7
WEC	114.6	119.8	146.7	117.5	80.5	163.3	122.7	105.0	107.2	58.1	51.4	96.5	1,283.4
NYISO	2,356.9	1,946.2	1,871.4	1,252.7	1,269.5	1,844.7	1,844.4	1,979.7	1,736.7	1,755.7	1,771.7	2,310.0	21,939.8
HUDS	416.4	375.4	369.0	213.4	173.4	284.1	334.1	387.4	277.0	224.3	209.3	171.7	3,435.5
LIND	235.4	221.1	235.1	145.9	213.2	210.3	212.7	222.9	225.2	237.5	175.1	237.8	2,572.2
NEPT	491.9	465.8	499.0	471.9	392.0	470.3	494.9	497.6	337.0	496.6	425.1	493.5	5,535.6
NYIS	1,213.3	883.9	768.3	421.5	491.0	880.0	802.7	871.7	897.5	797.4	962.2	1,407.0	10,396.5
TVA	271.1	53.9	81.1	208.1	150.8	308.3	395.5	422.9	312.5	69.1	107.1	202.1	2,582.4
Total	5,319.4	4,400.5	4,451.6	3,371.3	2,998.1	4,964.5	3,981.6	4,791.3	4,045.3	2,932.1	3,073.5	4,098.3	48,427.5

## Real-Time Interface Pricing Point Imports and Exports

Interfaces differ from interface pricing points. An interface is a point of interconnection between PJM and a neighboring balancing authority which market participants may designate as a path on which scheduled imports or exports will flow.<sup>7</sup> An interface pricing point defines the price at which transactions are priced, and is based on the path of the actual, physical transfer of energy. While a market participant designates a scheduled path from a generation control area (GCA) to a load control area (LCA), this path reflects the scheduled path as defined by the transmission reservations only, and may not reflect how the energy actually flows from the GCA to LCA. For example, the import transmission path from LG&E Energy, L.L.C. (LGEE), through MISO and into PJM would

<sup>7</sup> There are multiple paths between any generation and load balancing authority. Market participants select the path based on transmission service availability and the transmission costs for moving energy from generation to load and interface prices.

show the transfer of power into PJM at the PJM/MISO Interface based on the scheduled path of the transaction. However, the physical flow of energy does not enter the PJM footprint at the PJM/MISO Interface, but enters PJM at the southern boundary. For this reason, PJM prices an import with the GCA of LGEE at the SOUTH interface pricing point rather than the MISO pricing point.

Interfaces differ from interface pricing points. The challenge is to create interface prices, composed of external pricing points, which accurately represent the locational price impact of flows between PJM and external sources of energy and that reflect the underlying economic fundamentals across balancing authority borders.<sup>8</sup>

Transactions can be scheduled to an interface based on a contract transmission path, but pricing points are developed and applied based on the estimated electrical impact of the external power source on PJM tie lines, regardless of the contract transmission path.<sup>9</sup> PJM establishes prices for transactions with external balancing authorities by assigning interface pricing points to individual balancing authorities based on the generation control area and load control area as specified on the NERC Tag. Dynamic interface pricing calculations use actual system conditions to determine a set of weights for each external pricing point in an interface price definition. The weights are designed so that the interface price reflects actual system conditions. However, the weights are an approximation given the complexity of the transmission network outside PJM and the dynamic nature of power flows. Table 9-20 presents the interface pricing points used in 2024. On October 21, 2020, PJM updated the mappings of external balancing authorities to individual pricing points. Figure 9-4 shows a map of the default interface pricing point assignments for all external balancing authorities. Figure 9-4 shows that the balancing authorities in the Western Interconnection are mapped to either the MISO interface pricing point or the SOUTH interface pricing point. This determination was made by PJM

based on geographic location rather than the electrical impact on the PJM system. When power is scheduled across a DC tie line, its effects on the PJM system are as if a generator is located at the point in the Eastern Interconnection where the DC tie line connects. The electrical impact on PJM tie lines from sources in the Western Interconnection differ based on the relevant DC tie line and could vary from the MISO interface pricing point to the SOUTH interface pricing point. The MMU recommends that transactions sourcing in the Western Interconnection be priced at either the MISO interface pricing point or the SOUTH interface pricing point based on the locational price impact of flows between the DC tie line point of connection with the Eastern Interconnection and PJM rather than geographical location. The MMU recommends that PJM review the mappings of external balancing authority pricing points at least annually to reflect the fact that changes to the system topology can affect the electrical impact of external power sources on PJM.

The MMU has made multiple recommendations to either retire or consolidate interface pricing points used by PJM. The reasons for those recommendations include: pricing points that could no longer be used to price actual transactions; pricing points that were inappropriately used to support special agreements; pricing points that were treated as multiple pricing points when they were a single pricing point; and pricing points that were noncontiguous to the PJM footprint that created opportunities for sham scheduling. Table 9-6 shows the interface pricing points, the recommendation and the date the recommendation was adopted.

**Table 9-6 MMU interface pricing point recommendations and dates adopted**

Interface Pricing Point	Recommendation	Date Adopted
IMO	Retire Pricing Point - Noncontiguous	
Southeast (Real-Time Market)	Retire Pricing Point - Support Special Agreements	1-Oct-2022
Southwest (Real-Time Market)	Retire Pricing Point - Support Special Agreements	1-Oct-2022
SOUTHEXP	Consolidate Pricing Points	1-Jun-2021
SOUTHIMP	Consolidate Pricing Points	1-Jun-2021
Southeast	Retire Pricing Point - Support Special Agreements	15-Apr-2021
Southwest	Retire Pricing Point - Support Special Agreements	15-Apr-2021
NCMPAEXP	Retire Pricing Point - Preferential Treatment	3-Nov-2020
NCMPAIMP	Retire Pricing Point - Preferential Treatment	3-Nov-2020
Northwest	Retire Pricing Point - Noncontiguous	1-Oct-2020
CPLEEXP	Retire Pricing Point - Preferential Treatment	1-Jun-2020
CPLEIMP	Retire Pricing Point - Preferential Treatment	1-Jun-2020
DUKEXP	Retire Pricing Point - Preferential Treatment	1-Jun-2020
DUKIMP	Retire Pricing Point - Preferential Treatment	1-Jun-2020
NIPSCO	Retire Pricing Point - Obsolete (Integration into MISO)	1-Jun-2020
OVEC	Retire Pricing Point - Obsolete (Integration into PJM)	1-Dec-2018

<sup>8</sup> See the 2007 Annual State of the Market Report for PJM, Volume II, Appendix D, "Interchange Transactions," for a more complete discussion of the development of pricing points.

<sup>9</sup> See "Interface Pricing Point Assignment Methodology," (June 1, 2023) <<http://www.pjm.com/~media/etools/exschedule/interface-pricing-point-assignment-methodology.ashx>>. PJM periodically updates these definitions on its website.



The interface pricing method implies that the weighting factors reflect the actual system flows in a dynamic manner. In fact, the weightings are static, and are modified by PJM only occasionally.<sup>10</sup> The MMU recommended that PJM monitor, and adjust as necessary, the weights applied to the components of the interfaces to ensure that the interface prices reflect ongoing changes in system conditions. At the March 20, 2024, meeting of the Markets and Reliability Committee, PJM stakeholders approved the implementation of a new annual review of interface pricing definitions.<sup>11</sup> <sup>12</sup> The annual review evaluates, and adjusts as necessary, the interface pricing definitions to ensure the buses and weightings used in the interface pricing definitions capture changes in system topology over time and reflect current system conditions.

The contract transmission path only reflects the path of energy into or out of PJM to one neighboring balancing authority. The NERC Tag requires the complete path to be specified from the generation control area (GCA) to the load control area (LCA), but participants do not always do so. The NERC Tag path is used by PJM to determine the interface pricing point that PJM assigns to the transaction. This approach will correctly identify the interface pricing point only if the market participant provides the complete path in the Tag.

In the real-time energy market, in 2024, there were net scheduled exports at five of PJM's seven interface pricing points eligible for real-time transactions. The top three net exporting interface pricing points in the real-time energy market accounted for 84.9 percent of the total net scheduled exports: PJM/MISO with 48.7 percent, PJM/NYIS with 22.3 percent and PJM/NEPTUNE with 13.9 percent of the net scheduled export volume. The four separate interface pricing points that connect PJM to the NYISO (PJM/NYIS, PJM/NEPTUNE, PJM/HUDSONTP and PJM/LINDENVFT) together represented 51.3 percent of the total net PJM scheduled exports in the real-time energy market.

In the real-time energy market, in 2024, there were net scheduled imports at two of PJM's seven interface pricing points eligible for real-time transactions. The top importing interface pricing point in the real-time energy market was the PJM/SOUTH interface pricing point, which accounted for 85.2 percent of the total net scheduled import volume. The four separate interface pricing points that connect PJM to the NYISO (PJM/NYIS, PJM/NEPTUNE, PJM/HUDSONTP and PJM/LINDENVFT) had net scheduled exports in the real-time energy market.

**Table 9-7 Real-time scheduled net interchange volume by interface pricing point (GWh): 2024**

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
IMO	183.1	78.8	28.3	43.8	75.9	26.3	98.3	61.9	37.6	72.7	87.0	256.8	1,050.5
MISO	(2,102.3)	(2,210.5)	(2,262.1)	(1,704.5)	(1,216.8)	(2,199.2)	(1,383.7)	(2,063.5)	(1,594.5)	(613.0)	(839.4)	(1,201.5)	(19,390.9)
NYISO	(2,222.7)	(1,826.7)	(1,748.7)	(1,129.9)	(1,140.0)	(1,694.6)	(1,694.3)	(1,851.2)	(1,626.2)	(1,630.3)	(1,657.5)	(2,177.5)	(20,399.7)
HUDSONTP	(416.4)	(375.4)	(369.0)	(213.4)	(173.4)	(284.1)	(334.1)	(387.4)	(277.0)	(224.3)	(209.3)	(171.7)	(3,435.4)
LINDENVFT	(235.4)	(221.1)	(235.1)	(145.9)	(213.2)	(210.3)	(210.3)	(222.7)	(225.2)	(237.4)	(175.1)	(237.8)	(2,569.5)
NEPTUNE	(491.9)	(465.7)	(499.0)	(471.8)	(391.9)	(470.2)	(494.9)	(497.6)	(337.0)	(496.6)	(425.1)	(493.5)	(5,535.2)
NYIS	(1,079.0)	(764.4)	(645.7)	(298.8)	(361.6)	(730.0)	(654.9)	(743.5)	(787.0)	(672.0)	(848.1)	(1,274.5)	(8,859.6)
SOUTH	337.5	864.1	689.4	760.5	777.1	(230.3)	179.1	36.1	81.9	944.4	770.1	838.2	6,048.2
Total	(3,804.4)	(3,094.3)	(3,293.1)	(2,030.1)	(1,503.8)	(4,097.8)	(2,800.5)	(3,816.7)	(3,101.2)	(1,226.2)	(1,639.8)	(2,284.0)	(32,692.0)

**Table 9-8 Real-time scheduled gross import volume by interface pricing point (GWh): 2024**

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
IMO	189.0	79.7	30.1	49.4	76.8	45.9	105.0	67.2	37.9	73.5	88.6	259.4	1,102.5
MISO	138.2	49.5	59.9	58.6	244.7	96.1	115.6	99.0	95.7	299.9	173.2	187.1	1,617.5
NYISO	131.1	119.4	122.1	119.8	128.8	145.9	148.8	128.1	110.5	125.3	114.1	131.2	1,524.9
HUDSONTP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1
LINDENVFT	0.0	0.0	0.0	0.0	0.0	0.0	2.3	0.3	0.0	0.0	0.0	0.0	2.6
NEPTUNE	0.0	0.0	0.0	0.1	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.4
NYIS	131.1	119.4	122.1	119.6	128.7	145.8	146.5	127.8	110.4	125.3	114.0	131.2	1,521.8
SOUTH	1,056.8	1,057.6	946.5	1,113.5	1,044.0	578.8	811.5	680.3	700.0	1,207.2	1,057.8	1,236.5	11,490.5
Total	1,514.9	1,306.2	1,158.5	1,341.2	1,494.2	866.7	1,181.0	974.6	944.1	1,705.9	1,433.7	1,814.2	15,735.5

<sup>10</sup> On June 1, 2015, PJM began using a dynamic weighting factor in the calculation for the Ontario interface pricing point.

<sup>11</sup> See "Manual 11 Revisions – Interface Pricing Points Review," Presented at the PJM Markets and Reliability Committee (MRC) meeting held on March 20, 2024 <<https://www.pjm.com/-/media/committees-groups/committees/mrc/2024/20240320/20240320-consent-agenda-b---1-manual-11-revisions-interface-pricing-points---presentation.ashx>>.

<sup>12</sup> See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 133 (December 17, 2024).

**Table 9-9 Real-time scheduled gross export volume by interface pricing point (GWh): 2024**

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
IMO	5.9	0.8	1.9	5.5	0.8	19.6	6.8	5.3	0.3	0.9	1.6	2.6	52.0
MISO	2,240.5	2,260.1	2,321.9	1,763.1	1,461.6	2,295.3	1,499.3	2,162.5	1,690.2	912.8	1,012.5	1,388.6	21,008.4
NYISO	2,353.7	1,946.1	1,870.8	1,249.7	1,268.8	1,840.5	1,843.1	1,979.3	1,736.7	1,755.6	1,771.6	2,308.8	21,924.6
HUDSONTP	416.4	375.4	369.0	213.4	173.4	284.1	334.1	387.4	277.0	224.3	209.3	171.7	3,435.5
LINDENVFT	235.4	221.1	235.1	145.9	213.2	210.3	212.7	222.9	225.2	237.5	175.1	237.8	2,572.2
NEPTUNE	491.9	465.8	499.0	471.9	392.0	470.3	494.9	497.6	337.0	496.6	425.1	493.5	5,535.6
NYIS	1,210.1	883.8	767.7	418.5	490.3	875.8	801.4	871.3	897.5	797.3	962.1	1,405.7	10,381.4
SOUTH	719.3	193.5	257.0	353.0	266.8	809.1	632.4	644.2	618.1	262.8	287.8	398.3	5,442.3
Total	5,319.4	4,400.5	4,451.6	3,371.3	2,998.1	4,964.5	3,981.6	4,791.3	4,045.3	2,932.1	3,073.5	4,098.3	48,427.5

## Day-Ahead Interface Imports and Exports

In the day-ahead energy market, as in the real-time energy market, scheduled imports and exports are determined by the scheduled path, which is the transmission path a market participant selects from the original source to the final sink. Entering external energy transactions in the day-ahead energy market requires fewer steps than in the real-time energy market. Market participants need to acquire a valid, willing to pay congestion (WPC) OASIS reservation to prove that their day-ahead schedule could be supported in the real-time energy market.<sup>13</sup> Day-ahead energy market schedules need to be cleared through the day-ahead energy market process in order to become an approved schedule. The day-ahead energy market transactions are financially binding, but will not physically flow unless they are also submitted in the real-time energy market. In the day-ahead energy market, a market participant is not required to acquire a ramp reservation, a NERC Tag, or to go through a neighboring balancing authority checkout process.

There are three types of day-ahead external energy transactions: fixed; up to congestion; and dispatchable.<sup>14</sup>

In the day-ahead energy market, transaction sources and sinks are determined solely by market participants. In Table 9-10, Table 9-11, and Table 9-12, the scheduled interface designation is determined by the transmission reservation that was acquired and associated with the day-ahead market transaction, and does not bear any necessary relationship to the pricing point designation selected at the time the transaction is submitted to PJM in real time. For example, if market participants want to import energy from the Southwest Power Pool

(SPP) to PJM, they are likely to choose a scheduled path with the fewest transmission providers along the path and therefore the lowest transmission costs for the transaction, regardless of whether the resultant path is related to the physical flow of power. The lowest cost transmission path runs from SPP, through MISO, and into PJM, requiring only three transmission reservations, two of which are available at no cost (MISO transmission would be free based on the regional through and out rates, and the PJM transmission would be free, if using spot import transmission). Any other transmission path entering PJM, where the generating control area is to the south, would require the market participant to acquire transmission through nonmarket balancing authorities, and thus incur additional transmission costs. PJM's interface pricing method recognizes that transactions sourcing in SPP and sinking in PJM will create flows across the southern border and prices those transactions at the SOUTH interface price. As a result, a market participant who plans to submit a transaction from SPP to PJM may have a transmission reservation with a point of receipt of MISO and a point of delivery of PJM but may select SOUTH as the import pricing point when submitting the transaction in the day-ahead energy market. In the scheduled interface tables, the import transaction would appear as scheduled through the MISO Interface, and in the scheduled interface pricing point tables, the import transaction would appear as scheduled through the SOUTH interface pricing point, which reflects the expected power flow.

Table 9-10 through Table 9-12 show the day-ahead scheduled interchange totals at the individual interfaces. Net scheduled interchange in the day-ahead energy market is shown by interface for 2024 in Table 9-10, while gross scheduled imports and exports are shown in Table 9-11 and Table 9-12.

<sup>13</sup> Effective September 17, 2010, up to congestion transactions no longer required a willing to pay congestion transmission reservation.

<sup>14</sup> See the 2010 Annual State of the Market Report for PJM, Volume 2, Section 4, "Interchange Transactions," for details.

In the day-ahead energy market, in 2024, there were net scheduled exports at 14 of PJM's 19 interfaces. The top three net exporting interfaces in the day-ahead energy market accounted for 57.0 percent of the total net scheduled exports: PJM/NYISO (NYIS) with 23.6 percent, PJM/Neptune (NEPT) with 18.5 percent and PJM/MidAmerican Energy Company (MEC) with 14.8 percent of the net scheduled export volume. The four separate interfaces that connect PJM to the NYISO (PJM/NYIS, PJM/NEPT, PJM/HUDS and PJM/Linden (LIND)) together represented 56.5 percent of the total net PJM scheduled exports in the day-ahead energy market. In 2024, there were net exports in the day-ahead energy market at seven of the 10 separate interfaces that connect PJM to MISO. Those seven interfaces represented 33.4 percent of the total net PJM exports in the day-ahead energy market.

In the day-ahead energy market, in 2024, there were net scheduled imports at three of PJM's 19 interfaces. The top importing interface in the day-ahead energy market was the PJM/Duke (DUK) Interface, which accounted for 99.8 percent of the net scheduled import volume. The four separate interfaces that connect PJM to the NYISO (PJM/NYIS, PJM/NEPT, PJM/HUDS and PJM/Linden (LIND)) had net scheduled exports in the day-ahead energy market. In 2024, there were net imports in the day-ahead energy market at two of the 10 separate interfaces that connect PJM to MISO. Those two interfaces represented 0.2 percent of the total net PJM imports in the day-ahead energy market.<sup>15</sup>

**Table 9-10 Day-ahead scheduled net interchange volume by interface (GWh): 2024**

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPLW	(47.9)	(12.2)	(31.3)	(28.3)	(7.3)	(30.1)	(22.7)	(34.6)	(42.0)	(31.4)	(15.9)	(12.0)	(315.7)
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	88.4	213.6	138.7	98.1	130.0	(97.7)	90.5	33.5	48.1	210.5	87.3	121.3	1,162.3
LGEE	(130.8)	(119.2)	(107.0)	(69.0)	(63.8)	(74.6)	(88.3)	(78.4)	(73.3)	(86.0)	(85.8)	(109.2)	(1,085.3)
MISO	(988.8)	(1,034.4)	(1,217.2)	(943.8)	(739.9)	(1,205.2)	(830.8)	(980.6)	(671.4)	(348.9)	(459.3)	(632.7)	(10,053.1)
ALTE	(214.8)	(150.2)	(271.0)	(185.8)	(135.4)	(232.9)	(151.5)	(220.3)	(46.0)	4.5	(8.1)	(8.8)	(1,620.2)
ALTW	(20.8)	(23.3)	(51.5)	(42.7)	(37.3)	(78.1)	(5.1)	(34.0)	(1.4)	9.3	2.7	(9.0)	(291.2)
AMIL	(6.6)	4.6	4.0	1.0	4.0	(18.6)	(4.6)	(2.1)	0.0	18.8	0.6	0.0	1.1
CIN	(245.6)	(362.9)	(315.4)	(258.3)	(127.3)	(282.1)	(154.4)	(199.1)	(143.9)	11.3	(68.9)	(158.4)	(2,305.0)
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.2	0.0	0.0	1.2
MEC	(353.8)	(323.8)	(333.3)	(323.9)	(372.3)	(426.5)	(399.0)	(406.0)	(406.8)	(367.6)	(351.5)	(403.8)	(4,468.4)
MECS	(53.1)	(83.3)	(129.5)	(34.4)	(17.0)	(43.1)	(18.9)	(42.2)	2.7	9.5	0.9	18.0	(390.4)
NIPS	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	(1.4)	(8.8)	(15.1)	(25.4)
WEC	(94.1)	(95.4)	(120.6)	(99.7)	(54.5)	(124.0)	(97.4)	(77.0)	(76.0)	(34.4)	(26.1)	(55.6)	(954.8)
NYISO	(1,935.5)	(1,644.3)	(1,442.4)	(1,037.4)	(1,002.8)	(1,544.4)	(1,443.6)	(1,534.0)	(1,245.5)	(1,244.6)	(1,095.1)	(1,847.8)	(17,017.4)
HUDS	(396.9)	(358.9)	(352.2)	(202.1)	(165.5)	(267.7)	(319.5)	(317.4)	(277.8)	(217.8)	(192.1)	(178.7)	(3,246.6)
LIND	(103.5)	(97.9)	(103.5)	(52.8)	(78.9)	(78.6)	(77.2)	(91.8)	(95.3)	(104.8)	(78.4)	(105.7)	(1,068.4)
NEPT	(500.9)	(470.5)	(500.5)	(481.8)	(408.5)	(479.7)	(493.7)	(497.3)	(333.6)	(502.5)	(420.6)	(486.7)	(5,576.2)
NYIS	(934.2)	(717.0)	(486.3)	(300.6)	(350.0)	(718.4)	(553.1)	(627.5)	(538.8)	(419.6)	(404.1)	(1,076.7)	(7,126.1)
TVA	(148.2)	(34.0)	8.4	(143.3)	(123.1)	(254.9)	(352.8)	(253.1)	(279.7)	63.3	(30.6)	(113.2)	(1,661.2)
Total without Up To Congestion	(3,162.7)	(2,630.4)	(2,650.9)	(2,123.8)	(1,807.0)	(3,206.9)	(2,647.7)	(2,847.2)	(2,263.7)	(1,437.0)	(1,599.4)	(2,593.5)	(28,970.3)
Up To Congestion	(741.2)	(496.0)	(276.2)	255.2	16.3	12.3	(103.1)	152.8	126.8	208.0	(110.5)	436.5	(519.0)
Total	(3,903.9)	(3,126.4)	(2,927.1)	(1,868.6)	(1,790.7)	(3,194.7)	(2,750.8)	(2,694.5)	(2,137.0)	(1,229.0)	(1,709.9)	(2,157.0)	(29,489.4)

<sup>15</sup> In the day-ahead energy market, two PJM interfaces had a net interchange of zero (PJM/Carolina Power and Light West (CPLW) and PJM/City Water Light & Power (CWLP)).

Table 9-11 Day-ahead scheduled gross import volume by interface (GWh): 2024

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	2.2	7.7	16.4	2.1	19.5	0.8	5.2	2.0	13.8	5.7	3.6	15.4	94.4
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	126.9	217.3	144.7	133.9	132.1	54.0	132.3	59.4	96.0	213.5	112.7	131.1	1,553.8
LGEE	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	2.0	0.0	1.4	0.0	3.4
MISO	74.5	12.5	12.9	17.0	110.3	24.9	35.8	29.4	50.3	188.0	54.2	86.2	695.9
ALTE	18.2	0.3	3.7	2.5	9.3	0.0	0.0	1.2	9.5	14.4	5.8	4.7	69.5
ALTW	0.0	0.0	0.0	0.0	1.7	1.7	0.8	1.4	1.3	15.2	3.6	0.7	26.4
AMIL	0.6	4.6	4.0	1.0	4.0	0.0	0.0	0.0	0.0	18.8	0.6	0.0	33.5
CIN	35.2	4.2	4.9	6.5	76.4	19.0	14.8	16.5	28.3	110.5	33.6	57.3	407.1
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.2	0.0	0.0	1.2
MEC	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
MECS	19.3	3.5	0.0	0.0	2.6	0.2	7.1	2.4	2.7	18.8	1.9	18.0	76.4
NIPS	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
WEC	1.2	0.0	0.3	7.1	16.3	4.1	13.2	8.0	8.5	9.1	8.6	5.5	81.7
NYISO	0.5	0.0	0.0	1.3	1.4	6.5	10.1	10.0	1.4	18.7	104.6	72.2	226.7
HUDS	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
LIND	0.0	0.0	0.0	0.0	0.0	0.0	2.4	0.3	0.0	0.0	0.0	0.0	2.7
NEPT	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NYIS	0.5	0.0	0.0	1.3	1.4	6.5	7.7	9.7	1.4	18.7	104.6	72.2	224.0
TVA	26.6	8.0	82.3	25.7	22.2	7.8	11.0	111.3	11.1	117.8	67.2	67.6	558.6
Total without Up To Congestion	230.7	245.5	256.2	180.1	285.5	94.0	194.4	212.1	174.7	543.6	343.6	372.5	3,132.9
Up To Congestion	682.3	736.0	963.0	828.8	560.0	560.2	431.6	706.8	773.1	831.8	571.0	1,124.3	8,769.1
Total	913.0	981.5	1,219.2	1,008.9	845.5	654.3	626.0	918.9	947.8	1,375.4	914.6	1,496.8	11,901.9

Table 9-12 Day-ahead scheduled gross export volume by interface (GWh): 2024

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	50.1	19.9	47.7	30.5	26.8	30.9	27.9	36.6	55.8	37.0	19.6	27.4	410.1
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	38.4	3.7	5.9	35.9	2.1	151.7	41.8	25.9	48.0	3.0	25.4	9.8	391.6
LGEE	130.8	119.2	107.0	69.0	63.9	74.6	88.4	78.4	75.2	86.0	87.1	109.2	1,088.8
MISO	1,063.2	1,046.9	1,230.1	960.8	850.2	1,230.2	866.7	1,010.0	721.6	536.8	513.5	718.9	10,749.0
ALTE	233.0	150.5	274.7	188.3	144.7	232.9	151.5	221.4	55.4	9.9	13.9	13.5	1,689.8
ALTW	20.8	23.3	51.5	42.7	39.0	79.9	5.9	35.4	2.7	5.8	1.0	9.6	317.5
AMIL	7.2	0.0	0.0	0.0	0.0	18.6	4.6	2.1	0.0	0.0	0.0	0.0	32.4
CIN	280.8	367.1	320.3	264.8	203.7	301.0	169.2	215.6	172.2	99.3	102.5	215.7	2,712.2
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
MEC	353.8	323.8	333.3	323.9	372.3	426.5	399.0	406.0	406.8	367.6	351.5	403.8	4,468.4
MECS	72.4	86.8	129.5	34.4	19.6	43.3	25.9	44.6	0.0	9.3	1.1	0.0	466.8
NIPS	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.4	8.8	15.1	25.4
WEC	95.3	95.4	120.9	106.8	70.8	128.0	110.6	85.0	84.5	43.5	34.8	61.1	1,036.6
NYISO	1,935.9	1,644.3	1,442.4	1,038.7	1,004.2	1,550.8	1,453.7	1,544.0	1,246.9	1,263.4	1,199.7	1,920.0	17,244.0
HUDS	396.9	358.9	352.2	202.1	165.5	267.7	319.5	317.4	277.8	217.8	192.1	178.7	3,246.6
LIND	103.5	97.9	103.5	52.8	78.9	78.6	79.6	92.1	95.3	104.8	78.4	105.7	1,071.1
NEPT	500.9	470.5	500.5	481.8	408.5	479.7	493.7	497.3	333.6	502.5	420.6	486.7	5,576.2
NYIS	934.7	717.0	486.3	301.9	351.3	724.8	560.8	637.2	540.2	438.3	508.6	1,148.9	7,350.1
TVA	174.9	42.0	73.9	169.0	145.3	262.7	363.8	364.4	290.8	54.4	97.7	180.8	2,219.7
Total without Up To Congestion	3,393.4	2,875.9	2,907.2	2,303.9	2,092.5	3,301.0	2,842.1	3,059.3	2,438.4	1,980.6	1,943.0	2,966.0	32,103.2
Up To Congestion	1,423.4	1,232.0	1,239.1	573.6	543.7	548.0	534.7	554.0	646.4	623.9	681.5	687.8	9,288.1
Total	4,816.9	4,107.9	4,146.3	2,877.5	2,636.2	3,849.0	3,376.8	3,613.3	3,084.8	2,604.5	2,624.5	3,653.8	41,391.3

## Day-Ahead Interface Pricing Point Imports and Exports

Table 9-13 through Table 9-18 show the day-ahead scheduled interchange totals at the interface pricing points. In 2024, up to congestion transactions accounted for 73.7 percent of all scheduled import MW transactions and 22.4 percent of all scheduled export MW transactions in the day-ahead energy market. The day-ahead net scheduled interchange in 2024, including up to congestion transactions, is shown by interface pricing point in Table 9-13. Scheduled up to congestion transactions by interface pricing point in 2024 are shown in Table 9-14. Day-ahead gross scheduled imports and exports, including up to congestion transactions, are shown in Table 9-15 and Table 9-17, while gross scheduled import and export up to congestion transactions are shown in Table 9-16 and Table 9-18.

Maintaining outdated definitions of interface pricing points is unnecessary, inconsistent with the tariff and creates artificial opportunities for gaming by virtual transactions and FTRs. PJM should immediately eliminate interface pricing points when changes to the market mean that the pricing points can no longer be used to price actual transactions and do not reflect actual price formation.

In the day-ahead energy market, in 2024, there were net scheduled exports at six of PJM's seven interface pricing points eligible for day-ahead transactions. The top three net exporting interface pricing points in the day-ahead energy market accounted for 82.2 percent of the total net scheduled exports: PJM/NYIS with 32.6 percent, PJM/MISO with 31.7 percent and PJM/NEPTUNE (NEPT) with 18.0 percent of the net scheduled export volume. The four separate interface pricing points that connect PJM to the NYISO (PJM/NYIS, PJM/NEPTUNE, PJM/HUDSONTP and PJM/LINDENVFT) together represented 68.3 percent of the total net PJM scheduled exports in the day-ahead energy market.

In the day-ahead energy market, in 2024, there were net scheduled imports at one of PJM's seven interface pricing points eligible for day-ahead transactions. The top importing interface pricing point in the day-ahead energy market was the PJM/SOUTH interface pricing point, which accounted for 100.0 percent of the net scheduled import volume. The four separate interface pricing points that connect PJM to the NYISO (PJM/NYIS, PJM/NEPTUNE, PJM/HUDSONTP and PJM/LINDENVFT) had net scheduled exports in the day-ahead energy market.

In the day-ahead energy market, in 2024, up to congestion transactions had net scheduled exports at four of PJM's seven interface pricing points eligible for day-ahead transactions. The top two net exporting interface pricing points eligible for up to congestion transactions accounted for 92.4 percent of the total net up to congestion scheduled exports: PJM/NYIS with 71.0 percent and PJM/HUDSONTP with 21.5 percent of the net up to congestion scheduled export volume. The four separate interface pricing points that connect PJM to the NYISO (PJM/NYIS, PJM/NEPTUNE, PJM/HUDSONTP and PJM/LINDENVFT) together represented 97.7 percent of the total net scheduled up to congestion exports in the day-ahead energy market. However, the PJM/NEPTUNE interface pricing point had net up to congestion scheduled imports in the day-ahead energy market.

In the day-ahead energy market, in 2024, up to congestion transactions had net scheduled imports at three of PJM's seven interface pricing points eligible for day-ahead transactions. The top importing interface pricing points eligible for up to congestion transactions accounted for 74.1 percent of the total up to congestion scheduled imports: PJM/SOUTH with 74.1 percent of the net up to congestion scheduled import volume. The four separate interface pricing points that connect PJM to the NYISO (PJM/NYIS, PJM/NEPTUNE, PJM/HUDSONTP and PJM/LINDENVFT) together represented 5.9 percent of the total net scheduled up to congestion imports in the day-ahead energy market. However, the PJM/HUDSONTP, PJM/LINDENVFT and PJM/NYIS interface pricing points had net up to congestion scheduled exports in the day-ahead energy market.

**Table 9-13 Day-ahead scheduled net interchange volume by interface pricing point (GWh): 2024**

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
IMO	(29.4)	(81.5)	(2.6)	45.1	3.8	10.8	13.0	(4.0)	4.4	9.9	(35.0)	57.9	(7.6)
MISO	(1,319.4)	(1,300.7)	(1,189.8)	(783.1)	(759.9)	(1,074.0)	(832.8)	(832.0)	(323.7)	(67.0)	(393.3)	(595.2)	(9,470.7)
NYISO	(2,411.4)	(2,147.2)	(2,016.3)	(1,186.9)	(1,144.4)	(1,747.0)	(1,649.5)	(1,699.9)	(1,600.7)	(1,585.3)	(1,332.4)	(1,917.9)	(20,438.8)
HUDSONTP	(532.3)	(525.4)	(444.8)	(218.6)	(181.6)	(289.7)	(339.4)	(348.9)	(373.8)	(275.2)	(256.4)	(254.2)	(4,040.2)
LINDENVFT	(139.7)	(127.3)	(123.9)	(63.6)	(102.3)	(87.1)	(71.8)	(90.4)	(109.7)	(122.6)	(80.4)	(143.9)	(1,262.8)
NEPTUNE	(477.2)	(456.7)	(484.8)	(475.1)	(392.0)	(455.9)	(481.1)	(463.2)	(326.4)	(494.2)	(416.1)	(466.6)	(5,389.3)
NYIS	(1,262.3)	(1,037.6)	(962.8)	(429.5)	(468.5)	(914.2)	(757.2)	(797.4)	(790.9)	(693.3)	(579.6)	(1,053.2)	(9,746.5)
SOUTH	(143.7)	402.9	281.5	56.4	109.8	(384.4)	(281.6)	(158.6)	(217.0)	413.4	50.8	298.1	427.7
Total	(3,903.9)	(3,126.4)	(2,927.1)	(1,868.6)	(1,790.7)	(3,194.7)	(2,750.8)	(2,694.5)	(2,137.0)	(1,229.0)	(1,709.9)	(2,157.0)	(29,489.4)



Table 9-14 Up to congestion scheduled net interchange volume by interface pricing point (GWh): 2024

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
IMO	(47.5)	(84.8)	(2.6)	45.8	1.1	11.9	0.3	(6.4)	1.5	(8.7)	(36.9)	40.1	(86.2)
MISO	(340.8)	(262.8)	31.7	160.5	(16.7)	128.5	10.8	151.0	349.7	300.0	67.9	55.4	635.3
NYISO	(475.1)	(503.0)	(578.6)	(150.0)	(142.3)	(201.5)	(205.9)	(165.8)	(354.9)	(340.9)	(237.3)	(70.1)	(3,425.5)
HUDSONTP	(135.4)	(166.6)	(92.6)	(16.6)	(16.1)	(22.0)	(19.8)	(31.5)	(96.0)	(57.4)	(64.2)	(75.5)	(793.7)
LINDENVFT	(36.2)	(29.4)	(20.4)	(10.8)	(23.4)	(8.5)	5.4	1.4	(14.4)	(17.8)	(2.0)	(38.2)	(194.4)
NEPTUNE	23.7	13.8	15.7	6.7	16.5	23.8	12.6	34.1	7.2	8.2	4.5	20.1	186.9
NYIS	(327.2)	(320.8)	(481.3)	(129.4)	(119.2)	(194.8)	(204.1)	(169.8)	(251.8)	(273.9)	(175.6)	23.5	(2,624.4)
SOUTH	122.2	354.6	273.4	199.0	174.1	73.4	91.7	174.0	130.5	257.5	95.8	411.1	2,357.3
Total Interfaces	(741.2)	(496.0)	(276.2)	255.2	16.3	12.3	(103.1)	152.8	126.8	208.0	(110.5)	436.5	(519.0)
INTERNAL	8,489.0	7,167.4	8,772.3	6,714.9	5,815.5	6,026.4	5,601.8	5,590.2	6,271.4	6,589.9	5,456.6	6,135.5	78,630.9
Total	7,747.9	6,671.4	8,496.2	6,970.1	5,831.8	6,038.6	5,498.7	5,743.0	6,398.2	6,797.9	5,346.1	6,572.0	78,111.9

Table 9-15 Day-ahead scheduled gross import volume by interface pricing point (GWh): 2024

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
IMO	50.3	31.4	36.9	54.2	28.3	37.5	37.7	32.7	29.7	44.6	26.9	100.5	510.8
MISO	354.1	250.7	507.5	449.2	386.6	364.0	263.9	395.2	507.7	572.8	392.7	443.3	4,887.5
NYISO	119.9	88.8	70.3	54.2	55.5	82.4	69.3	124.1	104.2	96.3	179.3	258.9	1,303.2
HUDSONTP	14.9	12.3	13.5	10.0	10.6	15.3	12.1	14.1	10.6	6.9	7.8	13.6	141.7
LINDENVFT	21.4	15.4	15.1	7.4	8.2	12.9	18.4	15.1	20.0	9.0	9.0	18.4	170.3
NEPTUNE	35.5	35.8	22.5	14.4	23.2	33.8	17.9	36.8	25.0	15.9	17.0	37.3	315.2
NYIS	48.2	25.4	19.2	22.4	13.5	20.4	20.9	58.1	48.5	64.5	145.4	189.6	676.0
SOUTH	388.7	610.6	604.6	451.3	375.1	170.3	255.2	366.9	306.2	661.9	315.8	694.0	5,200.5
Total	913.0	981.5	1,219.2	1,008.9	845.5	654.3	626.0	918.9	947.8	1,375.4	914.6	1,496.8	11,901.9

Table 9-16 Up to congestion scheduled gross import volume by interface pricing point (GWh): 2024

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
IMO	31.2	27.9	36.9	54.2	25.7	33.9	25.0	30.3	26.7	25.8	25.0	82.6	425.2
MISO	298.9	241.8	494.6	432.2	278.9	342.7	240.7	368.1	460.2	403.6	340.4	375.0	4,276.9
NYISO	119.4	88.8	70.3	52.9	54.2	76.0	59.2	114.2	102.9	77.5	74.7	186.8	1,076.9
HUDSONTP	14.9	12.3	13.5	10.0	10.6	15.3	12.1	14.1	10.6	6.9	7.8	13.6	141.7
LINDENVFT	21.4	15.4	15.1	7.4	8.2	12.9	16.0	14.8	20.0	9.0	9.0	18.4	167.6
NEPTUNE	35.5	35.8	22.5	14.4	23.2	33.8	17.9	36.8	25.0	15.9	17.0	37.3	315.2
NYIS	47.7	25.4	19.2	21.1	12.2	13.9	13.2	48.5	47.3	45.7	40.8	117.5	452.5
SOUTH	232.8	377.6	361.2	289.5	201.3	107.7	106.7	194.2	183.2	325.0	130.9	479.9	2,990.1
Total Interfaces	682.3	736.0	963.0	828.8	560.0	560.2	431.6	706.8	773.1	831.8	571.0	1,124.3	8,769.1

Table 9-17 Day-ahead scheduled gross export volume by interface pricing point (GWh): 2024

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
IMO	79.7	112.9	39.5	9.1	24.6	26.7	24.7	36.7	25.3	34.7	61.9	42.6	518.4
MISO	1,673.4	1,551.4	1,697.3	1,232.3	1,146.4	1,438.1	1,096.6	1,227.2	831.4	639.8	785.9	1,038.5	14,358.2
NYISO	2,531.4	2,235.9	2,086.5	1,241.1	1,200.0	1,829.4	1,718.7	1,824.0	1,704.9	1,681.6	1,511.7	2,176.8	21,742.0
HUDSONTP	547.1	537.8	458.2	228.6	192.2	305.1	351.5	363.0	384.4	282.0	264.2	267.8	4,181.9
LINDENVFT	161.1	142.7	139.0	71.0	110.6	100.1	90.1	105.5	129.7	131.6	89.4	162.3	1,433.1
NEPTUNE	512.7	492.5	507.3	489.5	415.2	489.7	499.1	499.9	351.4	510.2	433.1	503.9	5,704.5
NYIS	1,310.5	1,063.0	982.1	451.9	482.0	934.5	778.1	855.5	839.4	757.8	725.0	1,242.7	10,422.5
SOUTH	532.3	207.7	323.1	394.9	265.2	554.7	536.8	525.5	523.2	248.5	264.9	395.9	4,772.8
Total	4,816.9	4,107.9	4,146.3	2,877.5	2,636.2	3,848.9	3,376.8	3,613.3	3,084.8	2,604.5	2,624.5	3,653.8	41,391.3

Table 9-18 Up to congestion scheduled gross export volume by interface pricing point (GWh): 2024

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
IMO	78.6	112.7	39.5	8.4	24.6	22.0	24.7	36.7	25.3	34.5	61.9	42.4	511.4
MISO	639.7	504.5	462.9	271.7	295.6	214.1	229.9	217.2	110.5	103.5	272.4	319.6	3,641.6
NYISO	594.5	591.8	648.9	202.9	196.4	277.5	265.1	280.0	457.9	418.4	312.0	257.0	4,502.4
HUDSONTP	150.3	178.9	106.1	26.6	26.7	37.4	32.0	45.6	106.6	64.3	72.1	89.1	935.4
LINDENVFT	57.5	44.8	35.5	18.2	31.7	21.4	10.5	13.4	34.4	26.8	11.0	56.6	361.9
NEPTUNE	11.8	22.0	6.8	7.7	6.7	10.0	5.3	2.7	17.8	7.7	12.6	17.2	128.3
NYIS	374.9	346.1	500.6	150.4	131.4	208.7	217.2	218.3	299.1	319.7	216.4	94.0	3,076.8
SOUTH	110.6	23.0	87.9	90.6	27.1	34.3	15.0	20.2	52.7	67.5	35.1	68.8	632.8
Total Interfaces	1,423.4	1,232.0	1,239.1	573.6	543.7	548.0	534.7	554.0	646.4	623.9	681.5	687.8	9,288.1

Table 9-19 Active scheduling interfaces: 2024<sup>16</sup>

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
ALTE	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
ALTW	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
AMIL	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
CIN	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
CPL	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
CPLW	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
CWLP	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
DUK	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
HUDS	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
IPL	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
LGEE	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
LIND	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
MEC	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
MECS	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
NEPT	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
NIPS	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
NYIS	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
TVA	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
WEC	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active

Figure 9-3 PJM's footprint and its external scheduling interfaces


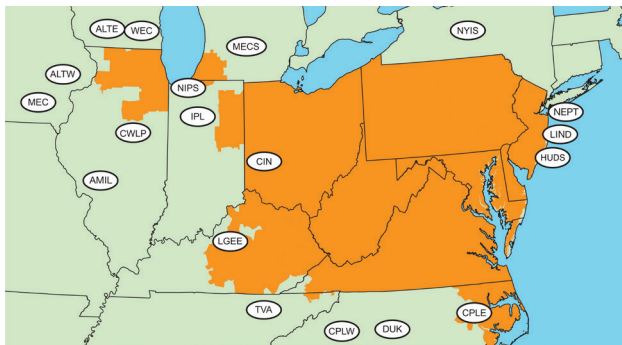


Table 9-20 Active scheduled interface pricing points: 2024

	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec
HUDSONTP	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
LINDENVFT	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
MISO	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
NEPTUNE	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
NYIS	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
Ontario IESO	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active
SOUTH	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active	Active

<sup>16</sup> On July 2, 2012, Duke Energy Corp. (DUK) completed a merger with Progress Energy Inc. (CPL and CPLW). As of December 31, 2024, DUK, CPL and CPLW continued to operate as separate balancing authorities, and are still defined as distinct interfaces in the PJM energy market.

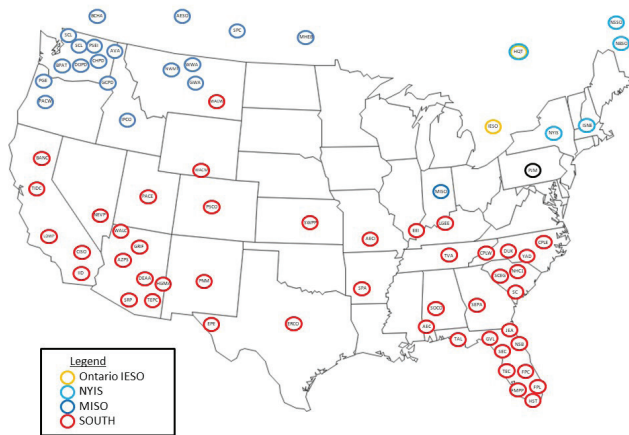**Figure 9-4 External balancing authority default interface pricing point assignments**



## Loop Flows

Actual energy flows are the real-time metered power flows at an interface for a defined period. The comparable scheduled flows are the real-time power flows scheduled at an interface for a defined period. Inadvertent interchange is the difference between the total actual flows for the PJM system (net actual interchange) and the total scheduled flows for the PJM system (net scheduled interchange) for a defined period. Loop flows are the difference between actual and scheduled power flows at a specific interface. Loop flows can exist at the same time that inadvertent interchange is zero. For example, actual imports could exceed scheduled imports at one interface and actual exports could exceed scheduled exports at another interface by the same amount. The result is loop flow, despite the fact that system actual and scheduled power flow net to a zero difference.<sup>17</sup>

Loop flows result, in part, from a mismatch between incentives to use a particular scheduled transmission path and the market-based price differentials at interface pricing points that result from the actual physical flows on the transmission system.

PJM's approach to interface pricing attempts to match prices with physical power flows and their impacts on the transmission system. For example, if market participants want to import energy from the Southwest Power Pool (SPP) to PJM, they are likely to choose a scheduled path with the fewest transmission providers along the

path and therefore the lowest transmission costs for the transaction, regardless of whether the resultant path is related to the physical flow of power. The lowest cost transmission path runs from SPP, through MISO, and into PJM, requiring only three transmission reservations, two of which are available at no cost (MISO transmission would be free based on the regional through and out rates, and the PJM transmission would be free, if using spot import transmission). Any other transmission path entering PJM, where the generating control area is to the south, would require the market participant to acquire transmission through nonmarket balancing authorities, and thus incur additional transmission costs. PJM's interface pricing method recognizes that transactions sourcing in SPP and sinking in PJM will create flows across the southern border and prices those transactions at the SOUTH interface price. As a result, the transaction is priced appropriately, but a difference between scheduled and actual flows is created at PJM's borders. For example, if a 100 MW transaction were submitted, there would be 100 MW of scheduled flow at the PJM/MISO interface border, but there would be no actual flows on the interface. Correspondingly, there would be no scheduled flows at the PJM/SOUTH interface border, but there would be 100 MW of actual flows on the interface. In 2024, of the 6,048.2 GWh of net scheduled interchange that received the SOUTH interface pricing point, 2,294.1 GWh (37.9 percent) were scheduled through MISO. There were no net scheduled flows across the southern interface that received the MISO interface pricing point.

In 2024, net scheduled interchange was -32,692.0 GWh and net actual interchange was -32,867.8 GWh, a difference of 175.8 GWh. In 2023, net scheduled interchange was -39,897.2 GWh and net actual interchange was -40,003.7 GWh, a difference of 106.5 GWh. This difference is inadvertent interchange. PJM attempts to minimize the amount of accumulated inadvertent interchange by continually monitoring and correcting for inadvertent interchange. PJM can reduce the accumulation of inadvertent interchange by using unilateral or bilateral paybacks. Inadvertent interchange accumulations that are paid back unilaterally are paid by controlling to a non-zero area control error (ACE). For example, Table 9-21 shows that PJM had 175.8 GW of inadvertent interchange in 2024. To reduce this inadvertent interchange, PJM can control to an ACE greater than zero, which would result in over generating.

<sup>17</sup> See the 2012 *Annual State of the Market Report for PJM*, Volume 2, Section 8, "Interchange Transactions," for a more detailed discussion.

By way of the power balance equation, power would flow out of PJM to its neighboring balancing authority areas. This would create increased actual exports that were not scheduled, thus reducing the overall inadvertent. To maintain reliability, unilateral paybacks are accounted for in the control performance standard calculations. Bilateral paybacks are scheduled with other balancing authority areas by scheduling a correction and incorporating that amount as a bias in the energy management system.<sup>18 19</sup>

Table 9-21 shows that in 2024, the Northern Indiana Public Service (NIPS) Interface had the largest loop flows of any interface with -480.1 GWh of net scheduled interchange and -12,826.2 GWh of net actual interchange, a difference of 12,346.1 GWh.

**Table 9-21 Net scheduled and actual PJM flows by interface (GWh): 2024**

Interface	Actual	Net Scheduled	Difference (GWh)
CPLP	3,478.8	131.7	3,347.1
CPLW	(238.9)	2.8	(241.7)
DUK	3,189.3	3,855.9	(666.6)
LGEE	2,399.1	(907.6)	3,306.7
MISO	(27,174.4)	(16,077.7)	(11,096.7)
ALTE	(1,283.3)	(3,538.6)	2,255.3
ALTW	(2,750.1)	(278.6)	(2,471.4)
AMIL	(3,672.4)	1,881.1	(5,553.6)
CIN	(3,604.7)	(5,284.6)	1,679.9
CWLP	(444.6)	0.0	(444.6)
IPL	(2,873.0)	(116.5)	(2,756.5)
MEC	(8,670.8)	(5,764.6)	(2,906.2)
MECS	4,441.7	(1,561.6)	6,003.3
NIPS	(12,826.2)	(480.1)	(12,346.1)
WEC	4,509.1	(934.2)	5,443.2
NYISO	(20,359.4)	(20,368.4)	9.0
HUDES	(3,435.4)	(3,435.4)	0.0
LIND	(2,569.5)	(2,569.5)	0.0
NEPT	(5,535.2)	(5,535.2)	0.0
NYIS	(8,819.3)	(8,828.3)	9.0
TVA	5,837.6	671.3	5,166.3
Total	(32,867.8)	(32,692.0)	(175.8)

Every external balancing authority is mapped to an import and export interface pricing point. The mapping is designed to reflect the physical flow of energy between PJM and each balancing authority. The net scheduled values for interface pricing points are defined as the MWh of scheduled transactions that will receive the interface pricing point based on the external balancing authority mapping.<sup>20</sup> For example, the MWh for a transaction whose transmission path is SPP through

MISO and into PJM would be reflected in the SOUTH interface pricing point net schedule totals because SPP is mapped to the SOUTH interface pricing point. The actual flow on an interface pricing point is defined as the metered flow across the transmission lines that are included in the interface pricing point.

The differences between the scheduled MWh mapped to a specific interface pricing point and actual power flows at the interface pricing points provide a better measure of loop flows than differences at the interfaces. The scheduled transactions are mapped to interface pricing points based on the expected flow from the generation balancing authority and load balancing authority, whereas scheduled transactions are assigned to interfaces based solely on the OASIS path that the market participants reflect the transmission path into or out of PJM to one neighboring balancing authority. Power flows at the interface pricing points provide a more accurate reflection of where scheduled power flows actually enter or leave the PJM footprint based on the complete transaction path. Table 9-22 shows the net scheduled and actual PJM flows by interface pricing point.

The IMO interface pricing point with the Ontario IESO was created to reflect the fact that transactions that originate or sink in the Ontario Independent Electricity System Operator (IMO) balancing authority create physical flows that are split between the MISO and NYISO interface pricing points depending on transmission system conditions, so a mapping to a single interface pricing point does not reflect the actual flows. PJM created the IMO interface pricing point to reflect the actual power flows across both the MISO/PJM and NYISO/PJM Interfaces. The IMO does not have physical ties with PJM because it is not contiguous. Table 9-22 shows actual flows associated with the IMO interface pricing point as zero because there is no PJM/IMO Interface. The actual flows between IMO and PJM are included in the actual flows at the MISO and NYISO interface pricing points.

Table 9-22 shows that in 2024, the SOUTH interface pricing point had the largest loop flows of any interface pricing point with 6,048.2 GWh of net scheduled interchange and 14,666.0 GWh of net actual interchange, a difference of 8,617.8 GWh.

<sup>18</sup> See PJM, "Manual 12: Balancing Operations," Rev. 54 (December 17, 2024).

<sup>19</sup> PJM does not publish data on inadvertent payback.

<sup>20</sup> The terms balancing authority and control area are used interchangeably in this section. The NERC Tag applications maintained the terminology of generation control area (GCA) and load control area (LCA) after the implementation of the NERC functional model. The NERC functional model classifies the balancing authority as a reliability service function, with, among other things, the responsibility for balancing generation, demand and interchange balance.

**Table 9-22 PJM flows by interface pricing point (GWh): 2024**

Interface Pricing Point	Actual	Net Scheduled	Difference (GWh)
IMO	0.0	1,050.5	(1,050.5)
MISO	(27,174.4)	(19,390.9)	(7,783.5)
NYISO	(20,359.4)	(20,399.7)	40.3
HUDSONTP	(3,435.4)	(3,435.4)	0.0
LINDENVFT	(2,569.5)	(2,569.5)	0.0
NEPTUNE	(5,535.2)	(5,535.2)	0.0
NYIS	(8,819.3)	(8,859.6)	40.3
SOUTH	14,666.0	6,048.2	8,617.8
Total	(32,867.8)	(32,692.0)	(175.8)

Table 9-23 shows the net scheduled and actual PJM flows by interface pricing point, with adjustments made to the MISO and NYISO scheduled interface pricing points based on the quantities of scheduled interchange where transactions from the IMO entered the PJM energy market. For example, 1,019.2 of the 1,050.5 GWh (97.0 percent) of net scheduled transactions that were mapped to the IMO interface pricing point were scheduled through MISO (Table 9-25).

**Table 9-23 PJM flows by interface pricing point (GWh) (Adjusted for IMO Scheduled Interfaces): 2024**

Interface Pricing Point	Actual	Net Scheduled	Difference (GWh)
MISO	(27,174.4)	(18,371.8)	(8,802.6)
NYISO	(20,359.4)	(20,368.4)	9.0
HUDSONTP	(3,435.4)	(3,435.4)	0.0
LINDENVFT	(2,569.5)	(2,569.5)	0.0
NEPTUNE	(5,535.2)	(5,535.2)	0.0
NYIS	(8,819.3)	(8,828.3)	9.0
SOUTH	14,666.0	6,048.2	8,617.8
Total	(32,867.8)	(32,692.0)	(175.8)

The NERC Tag requires the complete path to be specified from the generation control area (GCA) to the load control area (LCA), but participants do not always do so. The NERC Tag path is used by PJM to determine the interface pricing point that PJM assigns to the transaction. This approach will correctly identify the interface pricing point only if the market participant provides the complete path in the Tag. This approach will not correctly identify the interface pricing point if the market participant breaks the transaction into portions, each with a separate Tag. The breaking of transactions into portions can be a way to manipulate markets and the result of such behavior can be incorrect and noncompetitive pricing of transactions.

PJM attempts to ensure that external energy transactions are priced appropriately through the assignment of

interface prices based on the expected actual flow from the generation balancing authority (source) and load balancing authority (sink) as specified on the NERC Tag. Assigning prices in this manner is a reasonable approach to ensuring that transactions receive or pay the PJM market value of the transaction based on expected flows, but this method does not address loop flow issues.

Loop flows remain a significant concern for the efficiency of the PJM market. Loop flows can have negative impacts on the efficiency of markets with explicit locational pricing, including impacts on locational prices, on FTR revenue adequacy and on system operations, and can be evidence of attempts to game the markets.

The MMU recommends that PJM implement a validation method for submitted transactions that would prohibit market participants from breaking transactions into smaller segments to defeat the interface pricing rule and receive higher prices (for imports) or lower prices (for exports) from PJM resulting from the inability to identify the true source or sink of the transaction. If all of the Northeast ISOs and RTOs implemented validation to prohibit the breaking of transactions into smaller segments, the level of Lake Erie loop flow would be reduced.

The MMU also recommends that PJM implement a validation method for submitted transactions that would require market participants to submit transactions on paths that reflect the expected actual power flow in order to reduce unscheduled loop flows.

Table 9-24 shows the net scheduled and actual PJM flows by interface and interface pricing point. This table shows the interface pricing points that were assigned to energy transactions that had paths at each of PJM's interfaces. For example, Table 9-24 shows that in 2024, the majority of imports to the PJM energy market for which a market participant specified Ameren-Illinois (AMIL) as the interface with PJM based on the scheduled transmission path, had a generation control area mapped to the SOUTH Interface, and thus actual flows were assigned the SOUTH interface pricing point (2,098.7 GWh). The majority of exports from the PJM energy market for which a market participant specified AMIL as the interface with PJM based on the scheduled transmission path had a load control area for which the



actual flows would leave the PJM energy market at the MISO Interface, and were assigned the MISO interface pricing point (-217.6 GWh).

**Table 9-24 Net scheduled and actual flows by interface and interface pricing point (GWh): 2024**

Interface	Interface Pricing Point	Actual	Net Scheduled	Difference (GWh)	Interface	Interface Pricing Point	Actual	Net Scheduled	Difference (GWh)
ALTE		(1,283.3)	(3,538.6)	2,255.3	LGEE		2,399.1	(907.6)	3,306.7
	IMO	0.0	2.6	(2.6)		SOUTH	2,399.1	(907.6)	3,306.7
	MISO	(1,283.3)	(3,512.8)	2,229.6	LIND		(2,569.5)	(2,569.5)	0.0
	SOUTH	0.0	(28.4)	28.4		LINDENVFT	(2,569.5)	(2,569.5)	0.0
ALTW		(2,750.1)	(278.6)	(2,471.4)	MEC		(8,670.8)	(5,764.6)	(2,906.2)
	MISO	(2,750.1)	(279.2)	(2,470.8)		MISO	(8,670.8)	(5,755.0)	(2,915.7)
	SOUTH	0.0	0.6	(0.6)		SOUTH	0.0	(9.6)	9.6
AMIL		(3,672.4)	1,881.1	(5,553.6)	MECS		4,441.7	(1,561.6)	6,003.3
	MISO	(3,672.4)	(217.6)	(3,454.8)		IMO	0.0	936.8	(936.8)
	SOUTH	0.0	2,098.7	(2,098.7)		MISO	4,441.7	(2,586.6)	7,028.3
CIN		(3,604.7)	(5,284.6)	1,679.9		SOUTH	0.0	88.2	(88.2)
	IMO	0.0	5.4	(5.4)	NEPT		(5,535.2)	(5,535.2)	0.0
	MISO	(3,604.7)	(5,247.4)	1,642.6		NEPTUNE	(5,535.2)	(5,535.2)	0.0
	SOUTH	0.0	(42.7)	42.7	NIPS		(12,826.2)	(480.1)	(12,346.1)
CPLE		3,478.8	131.7	3,347.1		MISO	(12,826.2)	(480.1)	(12,346.1)
	SOUTH	3,478.8	131.7	3,347.1	NYIS		(8,819.3)	(8,828.3)	9.0
CPLW		(238.9)	2.8	(241.7)		IMO	0.0	31.3	(31.3)
	SOUTH	(238.9)	2.8	(241.7)		NYIS	(8,819.3)	(8,859.6)	40.3
CWLP		(444.6)	0.0	(444.6)	TVA		5,837.6	671.3	5,166.3
	MISO	(444.6)	0.0	(444.6)		SOUTH	5,837.6	671.3	5,166.3
DUK		3,189.3	3,855.9	(666.6)	WEC		4,509.1	(934.2)	5,443.2
	SOUTH	3,189.3	3,855.9	(666.6)		MISO	4,509.1	(1,125.7)	5,634.8
HUDS		(3,435.4)	(3,435.4)	0.0		SOUTH	0.0	191.6	(191.6)
	HUDSONTP	(3,435.4)	(3,435.4)	0.0	Grand Total		(32,867.8)	(32,692.0)	(175.8)
IPL		(2,873.0)	(116.5)	(2,756.5)					
	IMO	0.0	74.3	(74.3)					
	MISO	(2,873.0)	(186.4)	(2,686.5)					
	SOUTH	0.0	(4.4)	4.4					

Table 9-25 shows the net scheduled and actual PJM flows by interface pricing point and interface. The grouping is reversed from Table 9-24. Table 9-25 shows the interfaces where transactions were scheduled which received the individual interface pricing points. For example, Table 9-25 shows that in 2024, the majority of imports to the PJM energy market for which a market participant specified a generation control area for which it was assigned the SOUTH interface pricing point, had a path that entered the PJM energy market at the DUK Interface (3,855.9 GWh). The majority of exports from the PJM energy market for which a market participant specified a load control area for which it was assigned the SOUTH interface pricing point, had a path that would leave the PJM energy market at the LGEE Interface (-907.6 GWh).

**Table 9-25 Net scheduled and actual flows by interface pricing point and interface (GWh): 2024**

Interface Pricing Point	Interface	Actual	Net Scheduled	Difference (GWh)	Interface Pricing Point	Interface	Actual	Net Scheduled	Difference (GWh)
HUDSONTP		(3,435.4)	(3,435.4)	0.0	NEPTUNE		(5,535.2)	(5,535.2)	0.0
	HUDS	(3,435.4)	(3,435.4)	0.0		NEPT	(5,535.2)	(5,535.2)	0.0
IMO		0.0	1,050.5	(1,050.5)	NYIS		(8,819.3)	(8,859.6)	40.3
	ALTE	0.0	2.6	(2.6)		NYIS	(8,819.3)	(8,859.6)	40.3
	CIN	0.0	5.4	(5.4)	SOUTH		14,666.0	6,048.2	8,617.8
	IPL	0.0	74.3	(74.3)		ALTE	0.0	(28.4)	28.4
	MECS	0.0	936.8	(936.8)		ALTW	0.0	0.6	(0.6)
	NYIS	0.0	31.3	(31.3)		AMIL	0.0	2,098.7	(2,098.7)
LINDENVFT		(2,569.5)	(2,569.5)	0.0		CIN	0.0	(42.7)	42.7
	LIND	(2,569.5)	(2,569.5)	0.0		CPL	3,478.8	131.7	3,347.1
MISO		(27,174.4)	(19,390.9)	(7,783.5)		CPLW	(238.9)	2.8	(241.7)
	ALTE	(1,283.3)	(3,512.8)	2,229.6		DUK	3,189.3	3,855.9	(666.6)
	ALTW	(2,750.1)	(279.2)	(2,470.8)		IPL	0.0	(4.4)	4.4
	AMIL	(3,672.4)	(217.6)	(3,454.8)		LGEE	2,399.1	(907.6)	3,306.7
	CIN	(3,604.7)	(5,247.4)	1,642.6		MEC	0.0	(9.6)	9.6
	CWLP	(444.6)	0.0	(444.6)		MECS	0.0	88.2	(88.2)
	IPL	(2,873.0)	(186.4)	(2,686.5)		TVA	5,837.6	671.3	5,166.3
	MEC	(8,670.8)	(5,755.0)	(2,915.7)		WEC	0.0	191.6	(191.6)
	MECS	4,441.7	(2,586.6)	7,028.3	Grand Total		(32,867.8)	(32,692.0)	(175.8)
	NIPS	(12,826.2)	(480.1)	(12,346.1)					
	WEC	4,509.1	(1,125.7)	5,634.8					

## Data Required for Full Loop Flow Analysis

Loop flows are defined as the difference between actual and scheduled power flows at one or more specific interfaces. The differences between actual and scheduled power flows can be the result of a number of underlying causes. To adequately investigate the causes of loop flows, complete data are required.

Loop flows exist because electricity flows on the path of least resistance regardless of the path specified by contractual agreement or regulatory prescription. Loop flows can arise from transactions scheduled into, out of or around a balancing authority on contract paths that do not correspond to the actual physical paths on which energy flows. Outside of LMP-based energy markets, energy is scheduled and paid for based on contract path, without regard to the path of the actual energy flows. Loop flows can also result from actions within balancing authorities.

Loop flows are a significant concern. Loop flows can have negative impacts on the efficiency of markets with explicit locational pricing, including impacts on locational prices, on FTR revenue adequacy and on system operations, and can be evidence of attempts to game such markets. Loop flows also have poorly understood impacts on nonmarket areas. In general, the detailed sources of the identified differences between

scheduled and actual flows remain unclear as a result of incomplete or inadequate access to the required data.

A complete analysis of loop flow could provide additional insight that could lead to enhanced overall market efficiency and clarify the interactions among market and nonmarket areas. A complete analysis of loop flow would improve the overall transparency of electricity transactions. There are areas with transparent markets, and there are areas with less transparent markets (nonmarket areas), but these areas together comprise a market, and overall market efficiency would benefit from the increased transparency that would derive from a better understanding of loop flows.

For a complete loop flow analysis, several types of data are required from all balancing authorities in the Eastern Interconnection. The Commission required access to NERC Tag data. In addition to the Tag data, actual tie line data, dynamic schedule and pseudo tie data are required in order to analyze the differences between actual and scheduled transactions. ACE data, market flow impact data and generation and load data are required in order to understand the sources, within each balancing authority, of loop flows that do not result from differences between actual and scheduled transactions.<sup>21</sup>

<sup>21</sup> It is requested that all data be made available in downloadable format in order to make analysis possible. A data viewing tool alone is not adequate.

## NERC Tag Data

An analysis of loop flow requires knowledge of the scheduled path of energy transactions. NERC Tag data include the scheduled path and energy profile of the transactions, including the Generation Control Area (GCA), the intermediate Control Areas, the Load Control Area (LCA) and the energy profile of all transactions. Complete tag data include the identity of the specific market participants. FERC Order No. 771 required access to NERC Tag data for the Commission, regional transmission organizations, independent system operators and market monitoring units.<sup>22</sup>

## Actual Tie Line Flow Data

An analysis of loop flow requires knowledge of the actual path of energy transactions. Currently, a very limited set of tie line data is made available via the NERC IDC and the Central Repository for Curtailments (CRC) website. The available tie line data, and the data within the IDC, are presented as information on a screen, which does not permit analysis of the underlying data.

## Dynamic Schedule and Pseudo Tie Data

Dynamic schedule and pseudo ties represent another type of interchange transaction between balancing authorities. While dynamic schedules are required to be tagged, the tagged profile is only an estimate of what energy is expected to flow. Dynamic schedules are implemented within each balancing authority's Energy Management System (EMS), with the current values shared over Inter-Control Center Protocol (ICCP) links. By definition, the dynamic schedule scheduled and actual values will always be identical from a balancing authority standpoint, and the tagged profile should be removed from the calculation of loop flows to eliminate double counting of the energy profile. Dynamic schedule data from all balancing authorities are required in order to account for all scheduled and actual flows.

Pseudo ties are similar to dynamic schedules in that they represent a transaction between balancing authorities and are handled within the EMS systems and data are shared over the ICCP. Pseudo ties differ from dynamic schedules in how the generating resource is modeled within the balancing authorities' ACE equations. Dynamic schedules are modeled as resources located in one area serving load in another, while pseudo ties are modeled as resources in one area moved to another

area. Unlike dynamic schedules, pseudo tie transactions are not required to be tagged. Pseudo tie data from all balancing authorities are required in order to account for all scheduled and actual flows.

## Area Control Error (ACE) Data

Area control error (ACE) data provides information about how well each balancing authority is matching their generation with their load. This information, combined with the scheduled and actual interchange values will show whether an individual balancing authority is pushing on or leaning on the interconnection, contributing to loop flows.

NERC makes real-time ACE graphs available on their Reliability Coordinator Information System (RCIS) website. This information is presented only in graphical form, and the underlying data is not available for analysis.

## Market Flow Impact Data

In addition to interchange transactions, internal dispatch can also affect flows on balancing authorities' tie lines. The impact of internal dispatch on tie lines is called market flow. Market flow data are imported in the IDC, but there is only limited historical data, as only market flow data related to TLR levels 3 or higher are required to be made available via a Congestion Management Report (CMR). The remaining data are deleted.

There is currently a project in development through the NERC Operating Reliability Subcommittee (ORS) called the Market Flow Impact Tool. The purpose of this tool is to make visible the impacts of dispatch on loop flows. The MMU supports the development of this tool, but, equally important, requests that FERC and NERC ensure that the underlying data are provided to market monitors and other approved entities.

## Generation and Load Data

Generation data (both real-time scheduled generation and actual output) and load data would permit analysis of the extent to which balancing authorities are meeting their commitments to serve load. If a balancing authority is not meeting its load commitment with adequate generation, the result is unscheduled flows across the interconnections to establish power balance.

Market areas are transparent in providing real-time load while nonmarket areas are not. For example, PJM

<sup>22</sup> 141 FERC ¶ 61,235 (2012).

posts real-time load via its eDATA application. Most nonmarket balancing authorities provide only the expected peak load on their individual websites. Data on generation are not made publicly available, as this is considered market sensitive information.

The MMU recommends, that in order to permit a complete analysis of loop flow, FERC and NERC ensure that the identified data are made available to market monitors as well as other industry entities determined appropriate by FERC.

## PJM and MISO Interface Prices

Both the PJM/MISO and MISO/PJM interface pricing points represent the value of power at the relevant border, as determined in each market. In both cases, the interface price is the price at which transactions are settled. For example, a transaction into PJM from MISO would receive the PJM/MISO interface price upon entering PJM, while a transaction into MISO from PJM would receive the MISO/PJM interface price. PJM and MISO use network models to determine these prices and to attempt to ensure that the prices are consistent with the underlying electrical flows.

Under the PJM/MISO Joint Operating Agreement, the two RTOs mutually determine a set of transmission facilities on which both RTOs have an impact, and therefore jointly operate to those constraints. These jointly controlled facilities are M2M (Market to Market) flowgates. When a M2M constraint binds, PJM's LMP calculations at the buses that make up PJM's MISO interface pricing point are based on the PJM model's distribution factors of the selected buses to the binding M2M constraint and PJM's shadow price of the binding M2M constraint. MISO's LMP calculations at the buses that make up MISO's PJM interface pricing point are based on the MISO model's distribution factors of the selected buses to the binding M2M constraint and MISO's shadow price of the binding M2M constraint.

Prior to June 1, 2014, the PJM interface definition for MISO consisted of nine buses located near the middle of the MISO system and not at the border between the RTOs.<sup>23</sup> The interface definitions led to questions

about the level of congestion included in interchange pricing.

PJM modified the definition of the PJM/MISO interface price effective June 1, 2014. PJM's new MISO interface pricing point includes 10 equally weighted buses that are close to the PJM/MISO border. The 10 buses were selected based on PJM's analysis that showed that over 80 percent of the hourly tie line flows between PJM and MISO occurred on 10 ties composed of MISO and PJM monitored facilities. On June 1, 2017, MISO modified their MISO/PJM interface definition to match PJM's PJM/MISO interface definition.


## Real-Time and Day-Ahead PJM/MISO Interface Prices

In 2024, the direction of flow was consistent with price differentials in 55.2 percent of the hours. Table 9-26 shows the number of hours and average hourly price differences between the PJM/MISO Interface and the MISO/PJM Interface based on LMP differences and flow direction. Table 9-26 shows that PJM was a net exporter of energy to MISO in all but 158 hours during 2024. The lack of response to relative prices on the PJM/MISO interface was consistent with the ongoing pattern that there are net exports from PJM to MISO in almost every hour, regardless of relative prices. In 2024, flows were in the uneconomic direction on the PJM/MISO interface in 44.8 percent of all hours. Figure 9-5 shows the underlying variability in prices calculated on a daily hourly average basis. There are a number of relevant measures of variability, including the number of times the price differential fluctuates between positive and negative, the standard deviation of individual prices and of price differences and the absolute value of the price differences (Table 9-30).

**Table 9-26 PJM and MISO flow based hours and price differences: 2024**

LMP Difference	Flow Direction	Average	
		Number of Hours	Hourly Price Difference
MISO/PJM LMP > PJM/MISO LMP	Total Hours	4,809	\$9.12
	Consistent Flow (PJM to MISO)	4,752	\$9.07
	Inconsistent Flow (MISO to PJM)	57	\$13.15
	No Flow	1	\$1.98
	Total Hours	3,975	\$9.82
PJM/MISO LMP > MISO/PJM LMP	Consistent Flow (MISO to PJM)	101	\$18.43
	Inconsistent Flow (PJM to MISO)	3,874	\$9.59
	No Flow	0	\$0.00

<sup>23</sup> See "LMP Aggregate Definitions," (December 11, 2024) <<http://www.pjm.com/~media/markets-ops/energy/lmp-model-info/lmp-aggregate-definitions.ashx>>. PJM periodically updates these definitions on its website. See <<http://www.pjm.com>>.

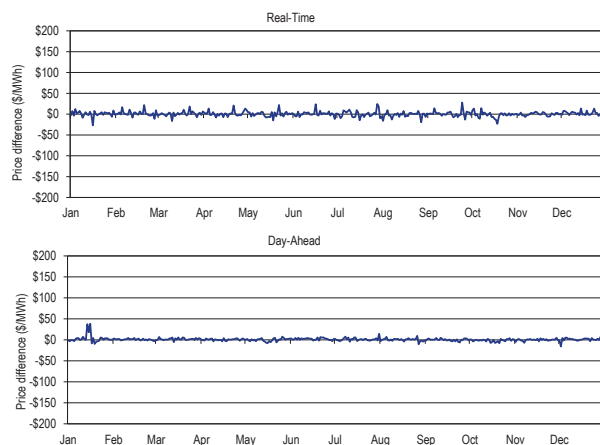**Figure 9-5 Price differences (MISO/PJM Interface minus PJM/MISO Interface): 2024**

## Distribution and Prices of Hourly Flows at the PJM/MISO Interface

Almost without exception, power flows from PJM to MISO regardless of the direction of price differences. In 2024, the direction of hourly energy flows was consistent with PJM and MISO interface price differentials in 4,853 hours (55.2 percent of all hours), and was inconsistent with price differentials in 3,931 hours (44.8 percent of all hours). Table 9-27 shows the distribution of hourly energy flows between PJM and MISO based on the price differences between the PJM/MISO and MISO/PJM prices. Of the 3,931 hours where flows were in a direction inconsistent with price differences, 3,367 of those hours (85.7 percent) had a price difference greater than or equal to \$1.00 and 1,875 of those hours (47.7 percent) had a price difference greater than or equal to \$5.00. The largest price difference with such flows was \$405.23. Of the 4,853 hours where flows were consistent with price differences, 4,177 of those hours (86.1 percent) had a price difference greater than or equal to \$1.00 and 1,790 of all such hours (36.9 percent) had a price difference greater than or equal to \$5.00. The largest price difference with such flows was \$630.63.

**Table 9-27 Distribution of hourly flows that are consistent and inconsistent with price differences between PJM and MISO: 2024**

Price Difference Range (Greater Than or Equal To)	Percent of Inconsistent		Percent of Consistent	
	Inconsistent Hours	Inconsistent Hours	Consistent Hours	Consistent Hours
\$0.00	3,931	100.0%	4,853	100.0%
\$1.00	3,367	85.7%	4,177	86.1%
\$5.00	1,875	47.7%	1,790	36.9%
\$10.00	1,031	26.2%	801	16.5%
\$15.00	659	16.8%	536	11.0%
\$20.00	459	11.7%	392	8.1%
\$25.00	337	8.6%	301	6.2%
\$50.00	107	2.7%	140	2.9%
\$75.00	46	1.2%	77	1.6%
\$100.00	23	0.6%	52	1.1%
\$200.00	2	0.1%	23	0.5%
\$300.00	1	0.0%	11	0.2%
\$400.00	1	0.0%	8	0.2%
\$500.00	0	0.0%	3	0.1%

## PJM and NYISO Interface Prices

If interface prices were defined in a comparable manner by PJM and the NYISO, if identical rules governed external transactions in PJM and the NYISO, if time lags were not built into the rules governing such transactions and if no risks were associated with such transactions, then prices at the interfaces would be expected to be very close and the level of transactions would be expected to be related to any price differentials. The fact that none of these conditions exists is important in explaining the observed relationship between interface prices and inter-RTO/ISO power flows, and those price differentials.<sup>24</sup>

PJM and NYISO each calculate an interface LMP using network models including distribution factor impacts. On May 1, 2017, PJM modified the PJM/NYIS interface price to be based on four buses within NYISO. The four buses were chosen based on a power flow analysis of transfers between PJM and the NYISO and the resultant distribution of flows across the free flowing A/C ties.

Prior to May 1, 2017, PJM's PJM/NYIS interface definition used two buses and included the impact of the ConEd wheeling agreement. The ConEd wheeling agreement ended on May 1, 2017. The end of the wheeling agreement meant that the expected actual power flows would change and therefore the definition of the interface price needed to change.

The NYISO uses proxy buses to calculate interface prices with neighboring balancing authorities. A proxy bus is

<sup>24</sup> See the 2012 Annual State of the Market Report for PJM, Volume 2, Section 8, "Interchange Transactions," for a more detailed discussion.



a single bus, located outside the NYISO footprint, which represents generation and load in a neighboring balancing authority area. The NYISO models imports from PJM as generation at the Keystone proxy bus, delivered to the NYISO reference bus with the assumption that 32 percent of the flow will enter the NYISO across the free flowing A/C ties, 32 percent will enter the NYISO across the Ramapo PARs, 21 percent will enter the NYISO across the ABC PARs and 15 percent will enter the NYISO across the J/K PARs. The NYISO models exports to PJM as being delivered to load at the Keystone proxy bus, sourced from the NYISO reference bus with the assumption that 32 percent of the flow will enter PJM across the free flowing A/C ties, 32 percent will enter PJM across the Ramapo PARs, 21 percent will enter PJM across the ABC PARs and 15 percent will enter PJM across the J/K PARs.


### Real-Time and Day-Ahead PJM/NYISO Interface Prices

In 2024, the relationship between prices at the PJM/NYIS Interface and at the NYISO/PJM proxy bus and the relationship between interface price differentials and power flows continued to be affected by differences in institutional and operating practices between PJM and the NYISO. The direction of flow was consistent with price differentials in 62.7 percent of the hours in 2024. Table 9-28 shows the number of hours and average hourly price differences between the PJM/NYIS Interface and the NYIS/PJM proxy bus based on LMP differences and flow direction. Figure 9-6 shows the underlying variability in prices calculated on a daily hourly average basis. There are a number of relevant measures of variability, including the number of times the price differential fluctuates between positive and negative, the standard deviation of individual prices and of price differences and the absolute value of the price differences (Table 9-30).

**Table 9-28 PJM and NYISO flow based hours and price differences: 2024<sup>25</sup>**

LMP Difference	Flow Direction	Number of Hours	Average Hourly Price Difference
NYIS/PJM proxy bus LBMP > PJM/NYIS LMP	Total Hours	5,599	\$9.30
	Consistent Flow (PJM to NYIS)	5,378	\$9.04
	Inconsistent Flow (NYIS to PJM)	221	\$15.75
	No Flow	0	\$0.00
PJM/NYIS LMP > NYIS/PJM proxy bus LBMP	Total Hours	3,185	\$14.50
	Consistent Flow (NYIS to PJM)	129	\$21.35
	Inconsistent Flow (PJM to NYIS)	3,056	\$14.21
	No Flow	0	\$0.00

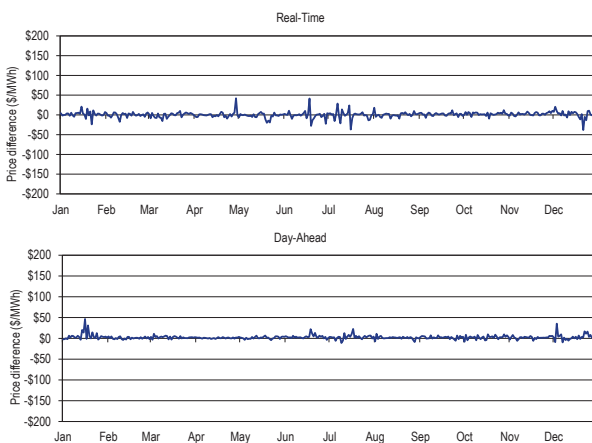**Figure 9-6 Price differences (NY/PJM proxy – PJM/NYIS Interface): 2024**



<sup>25</sup> The NYISO Locational Based Marginal Price (LBMP) is the equivalent term to PJM's Locational Marginal Price (LMP).

## Distribution and Prices of Hourly Flows at the PJM/NYISO Interface

In 2024, the direction of hourly energy flows was consistent with PJM/NYISO and NYISO/PJM price differences in 5,507 hours (62.7 percent of all hours), and was inconsistent with price differences in 3,277 hours (37.3 percent of all hours). Table 9-29 shows the distribution of hourly energy flows between PJM and NYISO based on the price differences between the PJM/NYISO and NYISO/PJM prices. Of the 3,277 hours where flows were in a direction inconsistent with price differences, 2,904 of those hours (88.6 percent) had a price difference greater than or equal to \$1.00 and 1,852 of all those hours (56.5 percent) had a price difference greater than or equal to \$5.00. The largest price difference with such flows was \$803.92. Of the 5,507 hours where flows were consistent with price differences, 5,111 of those hours (92.8 percent) had a price difference greater than or equal to \$1.00 and 3,072 of all such hours (55.8 percent) had a price difference greater than or equal to \$5.00. The largest price difference with such flows was \$799.85.

**Table 9-29 Distribution of hourly flows that are consistent and inconsistent with price differences between PJM and NYISO: 2024**

Price Difference Range (Greater Than or Equal To)	Percent of Inconsistent		Percent of Consistent	
	Inconsistent Hours	Hours	Consistent Hours	Hours
\$0.00	3,277	100.0%	5,507	100.0%
\$1.00	2,904	88.6%	5,111	92.8%
\$5.00	1,852	56.5%	3,072	55.8%
\$10.00	1,208	36.9%	1,344	24.4%
\$15.00	861	26.3%	676	12.3%
\$20.00	606	18.5%	433	7.9%
\$25.00	464	14.2%	310	5.6%
\$50.00	158	4.8%	86	1.6%
\$75.00	90	2.7%	49	0.9%
\$100.00	53	1.6%	31	0.6%
\$200.00	14	0.4%	9	0.2%
\$300.00	3	0.1%	4	0.1%
\$400.00	3	0.1%	2	0.0%
\$500.00	2	0.1%	1	0.0%

## Summary of Interface Prices between PJM and Organized Markets

Some measures of the real-time and day-ahead PJM interface pricing with MISO and with the NYISO are summarized and compared in Table 9-30, including average prices and measures of variability.

**Table 9-30 PJM, NYISO and MISO border price averages: 2024<sup>26</sup>**

	Description	Real-Time		Day-Ahead	
		NYISO	MISO	NYISO	MISO
Average Interval Price	PJM Price at ISO Border	\$31.13	\$27.04	\$31.37	\$27.53
	ISO Price at PJM Border	\$31.82	\$27.59	\$33.95	\$28.42
	Difference at Border (PJM-ISO)	(\$0.69)	(\$0.55)	(\$2.58)	(\$0.89)
	Average Absolute Value of Interval Difference at Border	\$14.12	\$12.50	\$5.11	\$4.16
	Sign Changes per Day	52.8	63.5	3.6	3.9
Standard Deviation	PJM Price at ISO Border	\$32.28	\$29.89	\$17.75	\$16.73
	ISO Price at PJM Border	\$38.94	\$51.13	\$18.71	\$17.14
	Difference at Border (PJM-ISO)	\$44.15	\$54.25	\$7.49	\$6.73

<sup>26</sup> Effective April 1, 2018, PJM implemented five minute LMP settlements in the real-time energy market. The sign changes per day represented in this table reflect the number of intervals where the sign changed per day. For the real-time energy market, there are 288 five minute intervals per day. For the day-ahead market there are 24 hourly intervals per day.

## Neptune Underwater Transmission Line to Long Island, New York

The Neptune Line is a 65 mile direct current (DC) merchant 230 kV transmission line, with a capacity of 660 MW, providing a direct connection between PJM (Sayreville, New Jersey), and NYISO (Nassau County on Long Island). Schedule 14 of the PJM Open Access Transmission Tariff provides that power flows will only be from PJM to New York. The flows were consistent with price differentials in 78.9 percent of the hours in 2024. Table 9-31 shows the number of hours and average hourly price differences between the PJM/NEPT Interface and the NYIS/Neptune bus based on LMP differences and flow direction.

**Table 9-31 PJM and NYISO flow based hours and price differences (Neptune): 2024**

LMP Difference	Flow Direction	Number of Hours	Average Hourly Price Difference
NYIS/Neptune Bus LBMP > PJM/NEPT LMP	Total Hours	7,269	\$17.32
	Consistent Flow (PJM to NYIS)	6,931	\$17.40
	Inconsistent Flow (NYIS to PJM)	0	\$0.00
	No Flow	338	\$15.66
PJM/NEPT LMP > NYIS/Neptune Bus LBMP	Total Hours	1,515	\$15.93
	Consistent Flow (NYIS to PJM)	0	\$0.00
	Inconsistent Flow (PJM to NYIS)	1,477	\$16.05
	No Flow	38	\$11.52

To move power from PJM to NYISO using the Neptune Line, two PJM transmission service reservations are required. A transmission service reservation is required from the PJM Transmission System to the Neptune HVDC Line (“Out Service”) and another transmission service reservation is required on the Neptune HVDC Line (“Neptune Service”).<sup>27</sup> The PJM Out Service is covered by normal PJM OASIS business operations.<sup>28</sup> The Neptune Service falls under the provisions for controllable merchant facilities, Schedule 14 of the PJM Tariff. The Neptune Service is also acquired on the PJM OASIS.

Neptune Service is owned by a primary rights holder, and any nonfirm service that is not used (as defined by a schedule on a NERC Tag) may be released either voluntarily by the primary rights holder or by default by PJM. The primary rights holder may elect to voluntarily release monthly, weekly, daily or hourly firm or nonfirm service. Voluntarily releasing the service allows for the primary rights holder to specify a rate to be charged for the released service. If the primary rights holder does not elect to voluntarily release nonfirm service, and does not use the service, the available transmission will be released by default at 12:00, one business day before the start of service. On December 31, 2024, the rate for the nonfirm service released by default was \$10.00 per MWh. The primary rights holder remains obligated to pay for the released service unless a second transmission customer acquires the released service.


Table 9-32 shows the percent of scheduled interchange across the Neptune Line by the primary rights holder since commercial operations began in July 2007. Table 9-32 shows that in 2024, the primary rights holder was responsible for 100 percent of the scheduled interchange across the Neptune Line in all months. Figure 9-7 shows the hourly average flow across the Neptune Line for 2024.

<sup>27</sup> See OASIS “PJM Business Practices for Neptune Transmission Service,” (August 21, 2015) <<http://www.pjm.com/~media/etools/oasis/merch-trans-facilities/neptune-oasis-Business-practices-doc-clean.ashx>>.

<sup>28</sup> See OASIS “Regional Transmission and Energy Scheduling Practices,” Rev. 12 (July 26, 2023) <<http://www.pjm.com/~media/etools/oasis/regional-practices-clean-pdf.ashx>>.

**Table 9-32 Percent of scheduled interchange across the Neptune Line by primary rights holder: July 2007 through December 2024**

	2007	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
January	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
February	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
March	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
April	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	99.99%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
May	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
June	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
July	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
August	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
September	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
October	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
November	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
December	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%

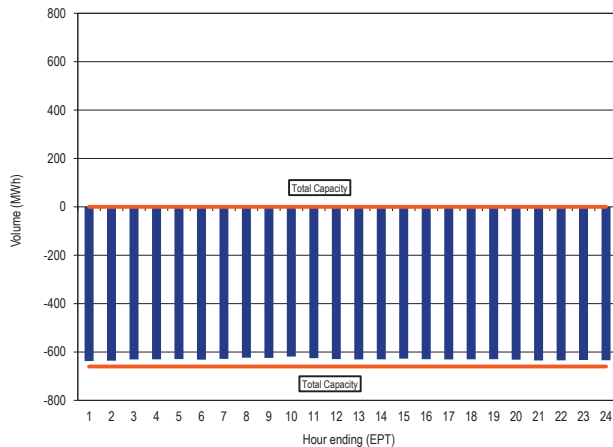**Figure 9-7 Neptune hourly average flow: 2024**

## Linden Variable Frequency Transformer (VFT) facility

The Linden VFT facility is a controllable AC merchant transmission facility, with a capacity of 315 MW, providing a direct connection between PJM (Linden, New Jersey) and NYISO (Staten Island, New York). The flows were consistent with price differentials in 79.5 percent of the hours in 2024. Table 9-33 shows the number of hours and average hourly price differences between the PJM/LIND Interface and the NYIS/Linden Bus based on LMP differences and flow direction.

**Table 9-33 PJM and NYISO flow based hours and price differences (Linden): 2024**

LMP Difference	Flow Direction	Average	
		Number of Hours	Hourly Price Difference
NYIS/Linden Bus LBMP > PJM/LIND LMP	Total Hours	7,156	\$14.90
	Consistent Flow (PJM to NYIS)	6,981	\$14.96
	Inconsistent Flow (NYIS to PJM)	0	\$0.00
	No Flow	175	\$12.49
PJM/LIND LMP > NYIS/Linden Bus LBMP	Total Hours	1,628	\$15.25
	Consistent Flow (NYIS to PJM)	0	\$0.00
	Inconsistent Flow (PJM to NYIS)	1,578	\$15.46
	No Flow	50	\$8.54

To move power from PJM to NYISO on the Linden VFT Line, two PJM transmission service reservations are required. A transmission service reservation is required from the PJM Transmission System to the Linden VFT (“Out Service”) and another transmission service reservation is required on the Linden VFT (“Linden VFT Service”).<sup>29</sup> The PJM Out Service is covered by normal PJM OASIS business operations.<sup>30</sup> The Linden VFT Service falls under the provisions for

<sup>29</sup> See OASIS “PJM Business Practices for Linden VFT Transmission Service,” (June 1, 2011) <<http://www.pjm.com/~media/etools/oasis/merch-trans-facilities/linden-vft-oasis-Business-practices-doc-clean.ashx>>.

<sup>30</sup> See OASIS “Regional Transmission and Energy Scheduling Practices,” Rev. 12 (July 26, 2023) <<https://www.pjm.com/~media/etools/oasis/regional-practices-clean-pdf.ashx>>.

controllable merchant facilities, Schedule 16 and Schedule 16-A of the PJM Tariff. The Linden VFT Service is also acquired on the PJM OASIS.


Linden VFT Service is owned by a primary rights holder, and any nonfirm service that is not used (as defined by a schedule on a NERC Tag) may be released either voluntarily by the primary rights holder or by default by PJM. The primary rights holder may elect to voluntarily release monthly, weekly, daily or hourly firm or nonfirm service. Voluntarily releasing the service allows for the primary rights holder to specify a rate to be charged for the released service. If the primary rights holder elects to not voluntarily release nonfirm service, and does not use the service, the available transmission will be released by default at 1200 (EPT), one business day before the start of service. On December 31, 2024, the rate for the nonfirm service released by default was \$6.00 per MWh. The primary rights holder remains obligated to pay for the released service unless a second transmission customer acquires the released service.

Table 9-34 shows the percent of scheduled interchange across the Linden VFT Line by the primary rights holder since commercial operations began in November, 2009. Table 9-34 shows that in 2024, the primary rights holder was responsible for 100 percent of the scheduled interchange across the Linden VFT Line in all months. Figure 9-8 shows the hourly average flow across the Linden VFT Line for 2024.

**Table 9-34 Percent of scheduled interchange across the Linden VFT Line by primary rights holder: November 2009 through December 2024**

	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
January	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	70.53%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
February	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	94.95%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
March	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	96.46%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
April	NA	99.97%	100.00%	100.00%	100.00%	99.98%	100.00%	49.32%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
May	NA	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
June	NA	100.00%	100.00%	100.00%	100.00%	27.27%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
July	NA	100.00%	100.00%	100.00%	100.00%	29.56%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
August	NA	100.00%	100.00%	100.00%	100.00%	82.46%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
September	NA	100.00%	100.00%	100.00%	100.00%	81.68%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
October	NA	100.00%	100.00%	100.00%	100.00%	35.05%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
November	100.00%	100.00%	100.00%	100.00%	99.86%	100.00%	61.45%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%
December	100.00%	100.00%	100.00%	98.22%	100.00%	100.00%	84.57%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%	100.00%

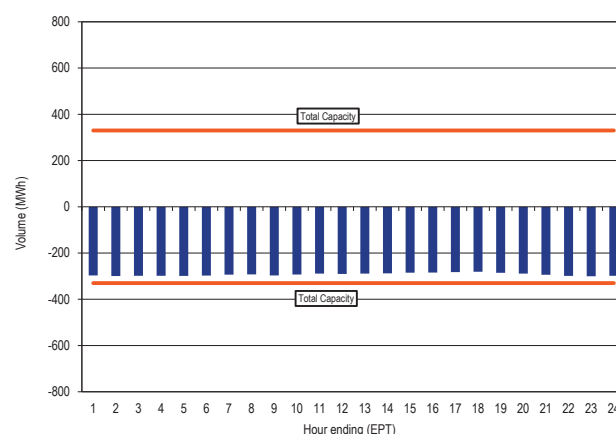**Figure 9-8 Linden hourly average flow: 2024<sup>31</sup>**



## Hudson Direct Current (DC) Merchant Transmission Line

The Hudson direct current (DC) Line is a bidirectional merchant 230 kV transmission line, with a capacity of 673 MW, providing a direct connection between PJM (Public Service Electric and Gas Company's (PSE&G) Bergen 230 kV Switching Station located in Ridgefield, New Jersey) and NYISO (Consolidated Edison's (Con Ed) W. 49<sup>th</sup> Street 345 kV Substation in New York City). The connection is a submarine cable system. While the Hudson DC Line is a bidirectional line, power flows are only from PJM to New York because the Hudson Transmission Partners, LLC had only requested withdrawal rights (320 MW of firm withdrawal rights, and 353 MW of nonfirm withdrawal rights). The flows were consistent with price differentials in 80.5 percent

<sup>31</sup> The Linden VFT Line is a bidirectional facility. The "Total Capacity" lines represent the maximum amount of interchange possible in either direction. These lines were included to maintain a consistent scale, for comparison purposes, with the Neptune DC Tie Line.



of the hours in 2024. Table 9-35 shows the number of hours and average hourly price differences between the PJM/HUDS Interface and the NYIS/Hudson bus based on LMP differences and flow direction.

**Table 9-35 PJM and NYISO flow based hours and price differences (Hudson): 2024**

LMP Difference	Flow Direction	Number of Hours	Average Hourly Price Difference
NYIS/Hudson Bus LBMP > PJM/HUDS LMP	Total Hours	7,129	\$15.10
	Consistent Flow (PJM to NYIS)	7,071	\$14.98
	Inconsistent Flow (NYIS to PJM)	0	\$0.00
	No Flow	58	\$29.72
	Total Hours	1,655	\$15.41
PJM/HUDS LMP > NYIS/Hudson Bus LBMP	Consistent Flow (NYIS to PJM)	0	\$0.00
	Inconsistent Flow (PJM to NYIS)	1,638	\$15.34
	No Flow	17	\$22.04
	Total Hours		

To move power from PJM to NYISO on the Hudson Line, two PJM transmission service reservations are required. A transmission service reservation is required from the PJM Transmission System to the Hudson Line (“Out Service”) and another transmission service reservation is required on the Hudson Line (“Hudson Service”).<sup>32</sup> The PJM Out Service is covered by normal PJM OASIS business operations.<sup>33</sup> The Hudson Service falls under the provisions for controllable merchant facilities, Schedule 17 of the PJM Tariff. The Hudson Service is also acquired on the PJM OASIS.

Hudson Service is owned by a primary rights holder, and any nonfirm service that is not used (as defined by scheduled on a NERC Tag) may be released either voluntarily by the primary rights holder or by default by PJM. The primary rights holder may elect to voluntarily release monthly, weekly, daily or hourly firm or nonfirm service. Voluntarily releasing the service allows for the primary rights holder to specify a rate to be charged for the released service. If the primary rights holder elects to not voluntarily release nonfirm service, and does not use the service, the available transmission will be released by default at 1200 (EPT), one business day before the start of service. On December 31, 2024, the rate for the nonfirm service released by default was \$10.00 per MWh. The primary rights holder remains obligated to pay for the released service unless a second transmission customer acquires the released service.

Table 9-36 shows the percent of scheduled interchange across the Hudson Line by the primary rights holder since commercial operations began in May, 2013. Table 9-36 shows that in 2024, the primary rights holder was responsible for less than 100 percent of the scheduled interchange across the Hudson Line in August, and the primary rights holder was responsible for 100 percent of the scheduled interchange across the Hudson Line in the remaining months. Figure 9-9 shows the hourly average flow across the Hudson Line for 2024.

**Table 9-36 Percent of scheduled interchange across the Hudson Line by primary rights holder: May 2013 through December 2024<sup>34</sup>**


	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
January	NA	51.22%	16.27%	100.00%	NA	24.44%	52.21%	29.70%	37.64%	64.30%	81.40%	100.00%
February	NA	49.00%	14.67%	NA	NA	23.25%	77.12%	23.61%	47.37%	64.34%	82.72%	100.00%
March	NA	40.40%	71.88%	NA	NA	9.55%	72.42%	87.24%	53.27%	82.65%	83.41%	100.00%
April	NA	100.00%	100.00%	NA	NA	15.13%	100.00%	10.02%	70.90%	84.91%	100.00%	100.00%
May	100.00%	26.87%	100.00%	100.00%	NA	92.18%	100.00%	20.53%	65.15%	84.15%	100.00%	100.00%
June	100.00%	5.89%	59.72%	100.00%	NA	44.89%	44.98%	38.26%	73.81%	100.00%	100.00%	100.00%
July	100.00%	18.51%	84.34%	NA	NA	16.26%	36.43%	27.56%	76.56%	100.00%	89.66%	100.00%
August	100.00%	75.17%	65.48%	NA	NA	19.24%	43.10%	35.64%	59.09%	100.00%	100.00%	80.35%
September	100.00%	75.31%	78.73%	NA	NA	22.90%	43.42%	30.75%	53.66%	100.00%	100.00%	100.00%
October	100.00%	99.71%	18.65%	100.00%	NA	22.67%	33.60%	52.58%	56.26%	100.00%	100.00%	100.00%
November	85.57%	99.60%	24.67%	100.00%	80.12%	50.44%	44.36%	38.60%	65.24%	68.68%	70.50%	100.00%
December	28.32%	1.68%	100.00%	NA	21.93%	29.38%	41.78%	38.82%	61.11%	70.02%	83.43%	100.00%

<sup>32</sup> See OASIS “PJM Business Practices for Hudson Transmission Service,” <<http://www.pjm.com/~media/etools/oasis/merch-trans-facilities/http-Business-practices.ashx>>.

<sup>33</sup> See OASIS “Regional Transmission and Energy Scheduling Practices,” Rev. 12 (July 26, 2023) <<http://www.pjm.com/~media/etools/oasis/regional-practices-clean-doc.ashx>>.

<sup>34</sup> The designation of “NA” means there was no flow on the Hudson Line during those months.

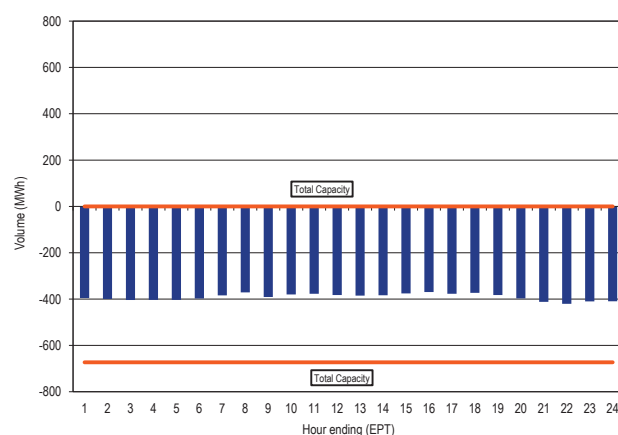Figure 9-9 Hudson hourly average flow: 2024



## Interchange Activity During High Load Hours

The PJM metered system peak load during 2024 was 148,890 MW in the HE 1700 (EPT) on July 16, 2024. PJM was a net scheduled exporter of energy in 23 of the 24 hours on July 16, 2024, with average hourly scheduled exports of 2,844 MW. During HE 1700 on July 16, 2024, PJM had net scheduled exports of 508 MW and net metered actual exports of 637 MW. Net transaction exports during this time were consistent with price differences between PJM and the NYISO. Net transaction exports during this time were inconsistent with price differences between the PJM/NEPT Interface and the NYIS/Neptune bus, the PJM/LIND Interface and the NYIS/Linden Bus, the PJM/HUDS Interface and the NYIS/Hudson Bus and between PJM and MISO. During July 2024, PJM was a net scheduled exporter of energy in 733 of the 744 hours (98.5 percent). During July 2024, the average hourly scheduled interchange was -3,764 MW (representing 3.5 percent of the average hourly load of 105,326 MW in July 2024).

## Operating Agreements with Bordering Areas

To improve reliability and reduce potential seams issues, PJM and its neighbors have developed operating agreements, including: operating agreements with MISO and the NYISO; a reliability agreement with TVA, LG&E and KU; an operating agreement with Duke Energy Progress, Inc.; a reliability coordination agreement with VACAR South; a balancing authority operations agreement with the Wisconsin Electric Power Company (WEC); and a Northeastern planning coordination protocol with NYISO and ISO New England.

Table 9-37 shows a summary of the elements included in each of the operating agreements PJM has with its bordering areas.

**Table 9-37 Summary of elements included in operating agreements with bordering areas**

Agreement:	PJM-MISO	PJM-NYISO	PJM-TVA-LGE-KU	PJM-DEP	PJM-VACAR	PJM-WEP	Northeastern Protocol
Data Exchange							
Real-Time Data	YES	YES	YES	YES	YES	YES	NO
Projected Data	YES	YES	YES	YES	NO	NO	NO
SCADA Data	YES	YES	YES	YES	NO	NO	NO
EMS Models	YES	YES	YES	YES	NO	NO	YES
Operations Planning Data	YES	YES	YES	YES	NO	NO	YES
Available Flowgate Capability Data	YES	YES	YES	YES	NO	NO	YES
Near-Term System Coordination							
Operating Limit Violation Assistance	YES	YES	YES	YES	YES	NO	NO
Over/Under Voltage Assistance	YES	YES	YES	YES	YES	NO	NO
Emergency Energy Assistance	YES	YES	NO	YES	YES	NO	NO
Outage Coordination	YES	YES	YES	YES	YES	NO	NO
Long-Term System Coordination	YES	YES	YES	YES	NO	NO	YES
Congestion Management Process							
ATC Coordination	YES	YES	YES	YES	NO	NO	NO
Market Flow Calculations	YES	YES	YES	NO	NO	NO	NO
Firm Flow Entitlements	YES	YES	YES	NO	NO	NO	NO
Market to Market Redispatch	YES - Redispatch	YES - Redispatch	NO	NO	NO	NO	NO
Joint Checkout Procedures	YES	YES	YES	YES	NO	YES	NO

PJM-MISO = MISO/PJM Joint Operating Agreement

PJM-NYISO = New York ISO/PJM Joint Operating Agreement

PJM-TVA-LGE-KU = Joint Reliability Coordination Agreement Between PJM - Tennessee Valley Authority (TVA), Louisville Gas and Electric Company (LGE) and Kentucky Utilities Company (KU)

PJM-DEP = Duke Energy Progress (DEP) - PJM Joint Operating Agreement

PJM-VACAR = PJM-VACAR South Reliability Coordination Agreement

PJM-WEP = Balancing Authority Operations Coordination Agreement Between Wisconsin Electric Power Company and PJM Interconnection, LLC

Northeastern Protocol = Northeastern ISO-Regional Transmission Organization Planning Coordination Protocol

## PJM and MISO Joint Operating Agreement<sup>35</sup>

The Joint Operating Agreement between MISO and PJM Interconnection, L.L.C. was executed on December 31, 2003. The PJM/MISO JOA includes provisions for congestion management that, for designated flowgates within MISO and PJM, allows for redispatch of units within the PJM and MISO regions to jointly manage congestion on these flowgates and to assign the costs of congestion management. This process was designed to address the impacts of market flows which are the loop flows on MISO's system created by PJM generators serving PJM load and vice versa. In 2012, MISO and PJM initiated a joint stakeholder process to address issues associated with the operation of the markets at the seam.<sup>36</sup>

Under the market to market rules, the organizations coordinate pricing at their borders. PJM and MISO each calculate an interface LMP using network models including distribution factor impacts. PJM uses 10 buses along the PJM/MISO border to calculate the PJM/MISO interface pricing point LMP. Prior to June 1, 2017, MISO used all of the PJM generator buses in its model of the PJM system in its calculation of the MISO/PJM interface pricing point.<sup>37</sup> On June 1, 2017, MISO modified their MISO/PJM interface definition to match PJM's PJM/MISO interface definition.

Coordinated flowgates are identified to determine which flowgates the market flows from PJM or MISO affect significantly. This set of flowgates may then be used in the congestion management process. PJM and MISO will conduct sensitivity studies to determine which flowgates are significantly affected by the market flows of the operating entity's control zones (historic control areas that existed in the IDC). There are five studies to determine which flowgates the operating entity will monitor and help control. These studies include generation to load distribution factor studies, transfer distribution factor analysis and an external asynchronous resource study. PJM or MISO may also specify additional flowgates that have not passed any of the five studies to be coordinated flowgates where the operating entity expects to use the TLR process to manage congestion. A reciprocal coordinated flowgate (RCF) is a CF that is monitored and controlled by PJM or MISO, on which both have significant impacts. Only RCFs are

<sup>35</sup> See "Joint Operating Agreement Between the Midwest Independent Transmission System Operator, Inc. and PJM Interconnection, L.L.C.," (December 11, 2008) <<http://www.pjm.com/directory/merged-tariffs/miso-joa.pdf>>.

<sup>36</sup> See "PJM/MISO Joint and Common Market Initiative," <<http://www.pjm.com/committees-and-groups/stakeholder-meetings/pjm-miso-joint-common.aspx>>.

<sup>37</sup> See the 2012 Annual State of the Market Report for PJM, Volume 2, Section 8, "Interchange Transactions," for a more detailed discussion.

subject to the market to market congestion management process.<sup>38</sup>

As of January 1, 2024, PJM had 199 flowgates eligible for M2M (Market to Market) coordination. In 2024, PJM added 17 flowgates and deleted eight flowgates, resulting in 208 flowgates eligible for M2M coordination as of December 31, 2024. As of January 1, 2024, MISO had 163 flowgates eligible for M2M coordination. In 2024, MISO added 72 flowgates and deleted 13 flowgates, resulting in 222 flowgates eligible for M2M coordination as of December 31, 2024.

The firm flow entitlement (FFE) represents the amount of historic 2004 market flows that each RTO had created on each RCF used in the market to market settlement process. The FFE establishes the amount of market flow that each RTO is permitted to create on the RCF before incurring redispatch costs during the market to market process. If the nonmonitoring RTO's real-time market flow is greater than their FFE plus the approved MW adjustment from day-ahead coordination, then the nonmonitoring RTO will pay the monitoring RTO the difference between their market flow and their FFE times the monitoring RTO's shadow price of the RCF. The shadow price is the incremental cost of dispatching marginal generation resources to relieve congestion on the RCF. If the nonmonitoring RTO's real-time market flow is less than their FFE plus the approved MW adjustment from day-ahead coordination, then the monitoring RTO will pay the nonmonitoring RTO for congestion relief provided by the nonmonitoring RTO. This payment is the difference between the nonmonitoring RTO's market flow and their FFE times the monitoring RTO's shadow price of the RCF.

April 1, 2004, known as the freeze date, is used to determine the firm rights on flowgates based on historic firm market flows that occurred prior to the implementation of M2M coordination. In the 20 years since 2004, significant topology and market changes have occurred, making the 2004 market flows irrelevant in 2024. The RTOs and stakeholders recognize that a modification to the definition of firm rights on flowgates is necessary. PJM and MISO stakeholders have spent years on the freeze date issues. No resolution to these issues appears imminent. The status quo results in significant payments by PJM customers to MISO customers. The

final resolution should account for the investments made by each RTO in the transmission system. The final resolution should reflect current interchange patterns. In 2004, PJM was primarily an importer of energy from MISO. In 2024, as it has been since about 2010, PJM is primarily an exporter of energy to MISO.

The MMU recommends eliminating the mechanism that defines FFE and M2M payments. These mechanisms are not consistent with markets and are not needed for efficient interface pricing. PJM and MISO have demonstrated a longstanding failure to resolve the definition of firm rights on flowgates and related issues. The MMU recommends that PJM file with the Commission to eliminate the FFE calculation and M2M payment of the PJM and MISO joint operating agreement.

The original logic of FFEs was not clear, the calculation of FFEs was not clear, and the measurement of market flows was and is imprecise at best. It does not make sense to use outdated and meaningless FFEs from 2004. If current FFEs are used based on actual current power flows, the role of FFEs is not clear. Fully dynamic FFEs are equivalent to eliminating FFEs while continuing to price power flows at the correct shadow price.

The solution to the FFE and M2M issue is to eliminate FFEs. Elimination of FFEs, while maintaining the exchange of shadow price information and cooperative dispatch, would keep the benefits of efficient constraint resolution between PJM and MISO.

In 2024, market to market operations resulted in MISO and PJM redispatching units to control congestion on M2M flowgates and the exchange of payments for this redispatch. Table 9-38 shows credits for coordinated congestion management between PJM and MISO. In 2024, MISO payments to PJM were \$17.7 million, and PJM payments to MISO were \$58.6 million, for a net payment from PJM to MISO of \$40.9 million. The large settlements in 2022 were due to the large amount of congestion and high LMPs observed in December during Elliott.

<sup>38</sup> See "Joint Operating Agreement Between the Midwest Independent Transmission System Operator, Inc. and PJM Interconnection, LLC," (December 11, 2008) <<http://www.pjm.com/directory/merged-tariffs/miso-joa.pdf>>.

**Table 9-38 PJM/MISO credits for coordinated congestion management: April 2005 through December 2024<sup>39</sup>**

Year	Payments from PJM to MISO	Payments from MISO to PJM	Net Payment from PJM to MISO
2005	\$25,068,903	\$3,411,188	\$21,657,715
2006	\$18,664,630	\$21,381,460	(\$2,716,830)
2007	\$29,917,241	\$17,774,637	\$12,142,604
2008	\$60,615,478	\$15,417,040	\$45,198,438
2009	\$48,101,017	\$10,632,885	\$37,468,132
2010	\$56,330,068	\$20,558,982	\$35,771,087
2011	\$87,113,498	\$9,445,949	\$77,667,550
2012	\$56,227,681	\$7,602,112	\$48,625,569
2013	\$32,589,519	\$14,733,770	\$17,855,748
2014	\$62,572,610	\$19,263,896	\$43,308,713
2015	\$49,379,823	\$11,266,866	\$38,112,957
2016	\$50,628,816	\$9,826,347	\$40,802,469
2017	\$69,812,858	\$16,698,276	\$53,114,581
2018	\$110,501,078	\$10,400,122	\$100,100,956
2019	\$44,391,547	\$7,886,392	\$36,505,155
2020	\$53,038,595	\$7,985,027	\$45,053,568
2021	\$45,704,128	\$18,792,183	\$26,911,945
2022	\$191,716,652	\$8,560,992	\$183,155,660
2023	\$63,976,499	\$5,467,435	\$58,509,064
2024 (Jan)	\$2,811,935	\$402,537	\$2,409,398
2024 (Feb)	\$1,352,485	\$309,386	\$1,043,099
2024 (Mar)	\$5,342,037	\$271,934	\$5,070,102
2024 (Apr)	\$11,635,888	\$3,251,148	\$8,384,740
2024 (May)	\$10,941,200	\$823,387	\$10,117,814
2024 (Jun)	\$6,653,964	\$3,235,443	\$3,418,521
2024 (Jul)	\$2,071,584	\$868,622	\$1,202,962
2024 (Aug)	\$2,445,346	\$451,623	\$1,993,723
2024 (Sep)	\$1,394,879	\$172,468	\$1,222,412
2024 (Oct)	\$3,687,568	\$613,438	\$3,074,130
2024 (Nov)	\$2,912,569	\$4,366,679	(\$1,454,110)
2024 (Dec)	\$7,332,775	\$2,916,019	\$4,416,756
2024	\$58,582,230	\$17,682,683	\$40,899,547

## PJM and New York Independent System Operator Joint Operating Agreement (JOA)<sup>40</sup>

The Joint Operating Agreement between NYISO and PJM Interconnection, L.L.C. became effective on January 15, 2013. Under the market to market rules, the organizations coordinate pricing at their borders. Unlike the PJM/MISO JOA where firm flow entitlements are based on a freeze date, the PJM/NYISO JOA requires that each party calculates an M2M entitlement on each M2M flowgate and compare results at least once a year. This annual coordination of entitlements ensures that the impact of upgrades on both systems are incorporated into the M2M calculation. PJM and NYISO may mutually agree to not recalculate entitlements in a given year.

<sup>39</sup> The totals represented in this figure represent the settlements as of the time of this report and may not include adjustments or resettlements.

<sup>40</sup> See "New York Independent System Operator, Inc., Joint Operating Agreement with PJM Interconnection, L.L.C.," (September 16, 2019) <<http://www.pjm.com/~media/documents/agreements/nyiso-joa.ashx>>.

On June 28, 2019, NYISO and PJM submitted revisions to the NYISO-PJM Joint Operating Agreement (JOA). The revisions addressed RTO concerns identified in their joint request for limited waiver of the JOA to authorize redispatch of generation in PJM. The intent of the redispatch is to mitigate post-contingency overloads of transmission equipment on the New York side of the East Towanda-Hillside 230 kV Transmission Line. The agreement allows the RTOs to control for this contingency without the exchange of payments for redispatch.<sup>41</sup>

In 2024, market to market operations did not result in NYISO and PJM redispatching units to control congestion on M2M flowgates. Therefore, there was no exchange of payments for redispatch in 2024. Table 9-39 shows credits for coordinated congestion management between PJM and NYISO.

**Table 9-39 PJM/NYISO credits for coordinated congestion management (flowgates): 2013 through 2024<sup>42</sup>**

Year	Payments from PJM to NYISO	Payments from NYISO to PJM	Net Payment from PJM to NYISO
2013	\$119,121	\$0	\$119,121
2014	\$58,631	\$1,005	\$57,626
2015	\$242,488	\$5,063	\$237,425
2016	\$632,768	\$50,550	\$582,219
2017	\$422,304	\$895	\$421,409
2018	\$0	\$0	\$0
2019	\$0	\$0	\$0
2020	\$0	\$0	\$0
2021	\$0	\$0	\$0
2022	\$0	\$0	\$0
2023	\$0	\$0	\$0
2024 (Jan)	\$0	\$0	\$0
2024 (Feb)	\$0	\$0	\$0
2024 (Mar)	\$0	\$0	\$0
2024 (Apr)	\$0	\$0	\$0
2024 (May)	\$0	\$0	\$0
2024 (Jun)	\$0	\$0	\$0
2024 (Jul)	\$0	\$0	\$0
2024 (Aug)	\$0	\$0	\$0
2024 (Sep)	\$0	\$0	\$0
2024 (Oct)	\$0	\$0	\$0
2024 (Nov)	\$0	\$0	\$0
2024 (Dec)	\$0	\$0	\$0
2024	\$0	\$0	\$0

The M2M coordination process focuses on real-time market coordination to manage transmission limitations that occur on M2M flowgates in a cost effective manner. Coordination between NYISO and PJM includes not

<sup>41</sup> See NYISO Filing, FERC Docket No. ER19-2282-000 (June 28, 2019).

<sup>42</sup> The totals represented in this figure represent the settlements as of the time of this report and may not include adjustments or resettlements.



only joint redispatch, but also incorporates coordinated operation of the PARs that are located at the PJM/NYIS border. This real-time coordination results in an efficient economic dispatch solution across both markets to manage the real-time transmission constraints that affect both markets, focusing on the actual flows in real time to manage constraints.<sup>43</sup> For each M2M flowgate, a PAR settlement will occur for each interval during coordinated operations. The PAR settlements are determined based on whether the measured real-time flow on each of the PARs is greater than or less than the calculated target value. If the actual flow is greater than the target flow, NYISO will make a payment to PJM. This payment is calculated as the product of the M2M flowgate shadow price, the PAR shift factor and the difference between the actual and target PAR flow. If the actual flow is less than the target flow, PJM will make a payment to NYISO. This payment is calculated as the product of the M2M flowgate shadow price, the PAR shift factor and the difference between the target and actual PAR flow. Effective May 1, 2017, coincident with the termination of the ConEd wheel, PJM and NYISO began M2M coordination at all of the PARs along the PJM/NYISO seam. Prior to May 1, 2017, only the Ramapo PARs were included in the M2M process. In 2024, market to market operations resulted in NYISO and PJM adjusting PARs to control congestion and the exchange of payments for this coordination. In 2024, PJM payments to NYISO were \$376,435, and NYISO payments to PJM were \$1,227,033, for a net payment from NYISO to PJM of \$850,597. Table 9-40 shows the PAR credits for coordinated congestion management between PJM and NYISO.

**Table 9-40 PJM/NYISO credits for coordinated congestion management (PARs): 2013 through 2024<sup>44</sup>**

Year	Payments from PJM to NYISO	Payments from NYISO to PJM	Net Payment from PJM to NYISO
2013	\$7,403,255	\$0	\$7,403,255
2014	\$5,723,571	\$0	\$5,723,571
2015	\$4,691,302	\$0	\$4,691,302
2016	\$617,733	\$0	\$617,733
2017	\$2,328,763	\$2,115,126	\$213,637
2018	\$3,327,747	\$2,407,667	\$920,081
2019	\$3,341,615	\$2,923,715	\$417,900
2020	\$3,004,543	\$2,048,317	\$956,226
2021	\$8,911,160	\$6,751,890	\$2,159,270
2022	\$21,126,437	\$13,609,266	\$7,517,171
2023	\$1,755,207	\$2,208,388	(\$453,181)
2024 (Jan)	\$158,441	\$243,765	(\$85,324)
2024 (Feb)	\$13,024	\$10,517	\$2,507
2024 (Mar)	\$11,284	\$5,891	\$5,393
2024 (Apr)	\$0	\$0	\$0
2024 (May)	\$20,531	\$9,744	\$10,788
2024 (Jun)	\$11,324	\$458,680	(\$447,356)
2024 (Jul)	\$15,025	\$73,656	(\$58,631)
2024 (Aug)	\$9,034	\$18,230	(\$9,196)
2024 (Sep)	\$52,654	\$96,183	(\$43,530)
2024 (Oct)	\$196	\$75	\$121
2024 (Nov)	\$699	\$932	(\$233)
2024 (Dec)	\$84,223	\$309,360	(\$225,137)
2024	\$376,435	\$1,227,033	(\$850,597)

### PJM and TVA/LG&E and KU Joint Reliability Coordination Agreement (JRCA)<sup>45</sup>

The joint reliability coordination agreement (JRCA) executed on April 22, 2005, provides for the exchange of information and the implementation of reliability and efficiency protocols between TVA and PJM. The agreement also provides for the management of congestion and arrangements for both near-term and long-term system coordination. Under the JRCA, PJM and TVA honor constraints on the other's flowgates in their Available Transmission Capability (ATC) calculations. Market flows are calculated on reciprocal flowgates. When a constraint occurs on a reciprocal flowgate within TVA, PJM has the option to redispatch generation to reduce market flow, and therefore alleviate the constraint. Unlike the M2M procedure between MISO and PJM, this redispatch does not result in M2M payments. However, electing to redispatch generation within PJM can avoid potential market disruption by curtailing transactions under the Transmission Line Loading Relief (TLR) procedure to achieve the same relief. In 2022, PJM and TVA began discussions to add Louisville Gas and Electric

<sup>43</sup> See "New York Independent System Operator, Inc., Joint Operating Agreement with PJM Interconnection, LLC," (September 16, 2019) <<http://www.pjm.com/~media/documents/agreements/nyiso-joa.aspx>>.

<sup>44</sup> The totals in this figure are from the settlements at the time of this report and may change based on later adjustments or resettlements.

<sup>45</sup> See "Joint Reliability Coordination Agreement Among and Between PJM Interconnection, LLC, and Tennessee Valley Authority," (October 15, 2014) <<http://www.pjm.com/~media/documents/agreements/joint-reliability-coordination-agreement-miso-pjm-tva.aspx>>.

Company (LG&E) and Kentucky Utilities (KU) as parties to the JRCA. The revisions to add LG&E and KU to the agreement were filed with the Commission on June 6, 2023.<sup>46</sup> On August 5, 2023, the Commission approved the filing.<sup>47</sup> The agreement remained in effect in 2024.

## PJM and Duke Energy Progress, Inc. Joint Operating Agreement<sup>48</sup>

On September 9, 2005, FERC approved a JOA between PJM and Progress Energy Carolinas, Inc. (PEC), with an effective date of July 30, 2005. As part of this agreement, both parties agreed to develop a formal congestion management protocol (CMP). On February 2, 2010, PJM and PEC filed a revision to include a CMP under Article 14 of the JOA.<sup>49</sup> On January 20, 2011, the Commission conditionally accepted the compliance filing. On July 2, 2012, Duke Energy and Progress Energy Inc. completed a merger. At that time, Progress Energy Carolinas Inc., now a subsidiary of Duke Energy, changed its name to Duke Energy Progress (DEP).

On May 20, 2019, PJM and DEP submitted revisions to the JOA to delete Article 14.<sup>50</sup> PJM and DEP requested an effective date of July 22, 2019, for the filed revisions. On July 2, 2019, the Commission issued a letter order accepting the revisions to the JOA to delete the congestion management agreement effective July 22, 2019.<sup>51</sup>

## PJM and VACAR South Reliability Coordination Agreement<sup>52</sup>

On May 23, 2007, PJM and VACAR South (comprised of Duke Energy Carolinas, LLC (DUK), DEP, South Carolina Public Service Authority (SCPSA), Southeast Power Administration (SEPA), South Carolina Energy and Gas Company (SCE&G) and Yadkin Inc. (part of Alcoa)) entered into a reliability coordination agreement which provides for system and outage coordination, emergency procedures and the exchange of data. The parties meet on a yearly basis. The agreement remained in effect in 2024.

<sup>46</sup> See *PJM Interconnection, LLC*, Docket No. ER23-2078-000 (June 6, 2023).

<sup>47</sup> See *PJM Interconnection, LLC*, Docket No. ER23-2078-000 (August 5, 2023).

<sup>48</sup> See "Amended and Restated Joint Operating Agreement Among and Between PJM Interconnection, LLC, and Duke Energy Progress Inc.," (July 22, 2019) <<http://www.pjm.com/directory/merged-tariffs/progress-joa.pdf>>.

<sup>49</sup> See *PJM Interconnection, LLC and Progress Energy Carolinas, Inc.* Docket No. ER10-713-000 (February 2, 2010).

<sup>50</sup> See *PJM Interconnection, LLC*, Docket No. ER19-1905-000 (May 20, 2019).

<sup>51</sup> FERC Docket No. ER19-1905-000.

<sup>52</sup> See "PJM-VACAR South RC Agreement," (November 7, 2014) <<http://www.pjm.com/~media/documents/agreements/executed-pjm-vacar-rc-agreement.ashx>>.

## Balancing Authority Operations Coordination Agreement between Wisconsin Electric Power Company (WEC) and PJM Interconnection, LLC<sup>53</sup>

The Balancing Authority Operations Coordination Agreement executed on July 20, 2013, provides for the exchange of information between WEC and PJM. The purpose of the data exchange is to allow for the coordination of balancing authority actions to ensure the reliable operation of the systems. The agreement remained in effect in 2024.

## Northeastern ISO-Regional Transmission Organization Planning Coordination Protocol<sup>54</sup>

The Northeastern ISO-RTO Planning Coordination Protocol executed on December 8, 2004, provides for the exchange of information among PJM, NYISO and ISO New England. The purpose of the data exchange is to allow for the long-term planning coordination among and between the ISOs and RTOs in the Northeast. The agreement remained in effect in 2024.

## Interchange Transaction Issues PJM Transmission Loading Relief Procedures (TLRs)

TLRs are called to control flows on electrical facilities when economic redispatch cannot solve overloads on those facilities. TLRs are called to control flows related to external balancing authorities, as redispatch within an LMP market can generally resolve overloads on internal transmission facilities.

The number of PJM issued TLRs of level 3a or higher was zero in 2023, and zero in 2024. The number of different flowgates for which PJM declared a TLR 3a was zero in 2023, and zero in 2024. The total MWh of transaction curtailments was zero in 2023, and zero MWh in 2024.<sup>55</sup>

The number of MISO issued TLRs of level 3a or higher increased from 16 in 2023 to 20 in 2024. The number of different flowgates for which MISO declared a TLR

<sup>53</sup> See "Balancing Authority Operations Coordination Agreement between Wisconsin Electric Power Company and PJM Interconnection, LLC," (July 20, 2013) <<https://www.pjm.com/directory/merged-tariffs/rs43.pdf>>.

<sup>54</sup> See "Northeastern ISO/RTO Planning Coordination Protocol," (December 8, 2004) <<http://www.pjm.com/~media/documents/agreements/northeastern-iso-rt0-planning-coordination-protocol.ashx>>.

<sup>55</sup> TLR Level 3a is the first level of TLR that results in the curtailment of transactions. See the 2020 *Annual State of the Market Report for PJM*, Volume 2, Appendix E, "Interchange Transactions," for a more complete discussion of TLR levels.

3a was 11 in 2023, and 14 in 2024. The total MWh of transaction curtailments increased by 173.3 percent from 6,087 MWh in 2023 to 16,635 MWh in 2024.

The number of NYISO issued TLRs of level 3a or higher decreased from 15 in 2023 to two in 2024. The number of different flowgates for which NYISO declared a TLR 3a or higher was one in 2023, and one in 2024. The total MWh of transaction curtailments decreased by 83.4 percent from 69,967 MWh in 2023, to 11,597 MWh in 2024.

**Table 9-41 PJM, MISO, and NYISO TLR procedures: 2024<sup>56</sup>**

Month	Number of TLRs Level 3 and Higher			Number of Unique Flowgates That Experienced TLRs			Curtailment Volume (MWh)		
	PJM	MISO	NYISO	PJM	MISO	NYISO	PJM	MISO	NYISO
Jan-24	0	4	2	0	4	1	0	2,301	11,597
Feb-24	0	0	0	0	0	0	0	0	0
Mar-24	0	2	0	0	2	0	0	228	0
Apr-24	0	1	0	0	1	0	0	0	0
May-24	0	1	0	0	1	0	0	201	0
Jun-24	0	1	0	0	1	0	0	2,277	0
Jul-24	0	5	0	0	4	0	0	4,118	0
Aug-24	0	0	0	0	0	0	0	0	0
Sep-24	0	3	0	0	3	0	0	3,383	0
Oct-24	0	0	0	0	0	0	0	0	0
Nov-24	0	2	0	0	1	0	0	89	0
Dec-24	0	1	0	0	1	0	0	4,038	0
Total	0	20	2	0	14	1	0	16,635	11,597

**Table 9-42 Number of TLRs by TLR level by reliability coordinator: 2024<sup>57</sup>**

Year	Reliability Coordinator							Total
	3a	3b	4	5a	5b	6		
2024								
	MISO	5	3	0	2	10	0	20
	NYIS	2	0	0	0	0	0	2
	ONT	8	0	0	0	0	0	8
	PJM	0	0	0	0	0	0	0
	SOCO	75	58	0	0	0	0	133
	SWPP	65	121	3	17	21	0	227
	TVA	57	81	0	9	11	0	158
	VACS	7	10	0	0	1	0	18
Total		219	273	3	28	43	0	566

## Up To Congestion Transactions

The original purpose, in 2000, of up to congestion transactions (UTC) was to allow market participants to submit a maximum congestion charge, up to \$25 per MWh, they were willing to pay on an import, export or wheel through transaction in the day-ahead energy

market. This product was offered as a tool for market participants to limit their congestion exposure on scheduled transactions in the real-time energy market.<sup>58</sup>

Up to congestion transactions affect the day-ahead dispatch and unit commitment. Despite that, up to congestion transactions were not required to pay uplift charges from their introduction in 2010 through October 31, 2020. On July 16, 2020, FERC issued an Order directing PJM to revise uplift allocation rules to allocate uplift to one side of up to congestion transactions.<sup>59</sup> The Order requires PJM to treat an up to congestion transaction, for uplift allocation purposes, as if the

up to congestion transaction were equivalent to a DEC at its sink point. On November 1, 2020, PJM began allocating uplift to up to congestion transactions. Up to congestion transactions also negatively affect FTR funding.<sup>60</sup>

Figure 9-10 shows the monthly volume of cleared up to congestion transactions. Following an initial decline, UTC volumes had steadily increased following the allocation of uplift charges to UTCs effective November 1, 2020. However, the volume of cleared UTC transactions has declined again in the recent 12 month period to levels below what was seen prior to the allocation of uplift charges to UTCs. Table 9-43 shows the UTC volumes from the 12 month period prior to the allocation of uplift charges (November 1, 2019, through October 31, 2020), to the most recent 12 month period (January 1, 2024 through December 31, 2024). Table 9-44 shows the UTC volumes for 2023 and 2024.

<sup>56</sup> The total row in the columns of the number of unique flowgates that experience TLRs are not a sum of the individual months. The total row represents the number of unique flowgates that have experienced TLRs for the year to date.

<sup>57</sup> Southern Company Services, Inc. (SOCO) is the reliability coordinator covering a portion of Mississippi, Alabama, Florida and Georgia. Southwest Power Pool (SWPP) is the reliability coordinator for SPP. VACAR-South (VACS) is the reliability coordinator covering a portion of North Carolina and South Carolina.

<sup>58</sup> See the *2012 Annual State of the Market Report for PJM*, Volume 2, Section 8, "Interchange Transactions," for a more detailed discussion.

<sup>59</sup> 172 FERC ¶ 61,046 (2020).

<sup>60</sup> See the *2024 Annual State of the Market Report for PJM*, Volume 2, Section 13: FTRs and ARRs, "FTR Forfeitures" for more information on up to congestion transaction impacts on FTRs.

Figure 9–10 Monthly up to congestion cleared bids in MWh: 2005 through 2024

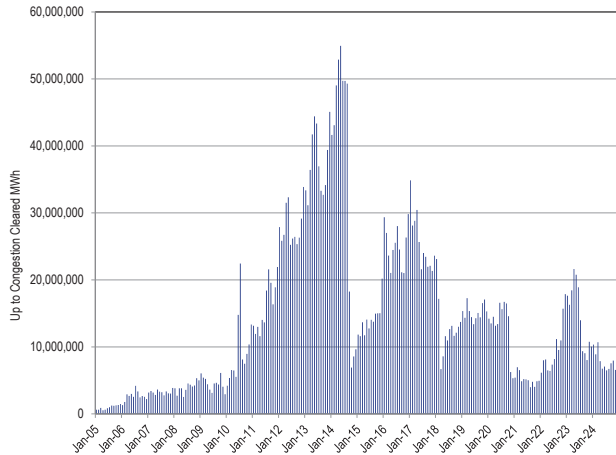


Table 9–43 Up to congestion volumes: November 1, 2019 through October 31, 2020 compared to December 1, 2024 through December 31, 2024

Category	November 1, 2019 – October 31, 2020	January 1, 2024 – December 31, 2024	Percent Change
Daily Average UTC Bids Submitted	53,368	36,127	(32.3%)
Daily Average UTC Bids Cleared	26,415	15,995	(39.4%)
Daily Average UTC Volume Submitted (MWh)	1,279,124	768,280	(39.9%)
Daily Average UTC Volume Cleared (MWh)	495,001	269,610	(45.5%)

Table 9–44 Up to congestion volumes: 2023 and 2024

Category	2023	2024	Percent Change
Daily Average UTC Bids Submitted	60,524	36,760	(39.3%)
Daily Average UTC Bids Cleared	21,072	16,189	(23.2%)
Daily Average UTC Volume Submitted (MWh)	1,669,453	752,776	(54.9%)
Daily Average UTC Volume Cleared (MWh)	479,134	258,566	(46.0%)

Table 9–45 shows the monthly cleared submitted volume of UTC bids from January 2024 through December 2024. In 2024, the cleared MW volume of up to congestion transactions was comprised of 7.1 percent imports, 7.6 percent exports, 2.2 percent wheeling transactions and 83.1 percent internal transactions. Less than 0.1 percent of the up to congestion transactions had matching real-time energy market transactions.

Table 9-45 Monthly volume of cleared and submitted up to congestion bids: January through December, 2024

Month	Bid MW					Bid Volume				
	Import	Export	Wheel	Internal	Total	Import	Export	Wheel	Internal	Total
Jan-24	1,393,908	3,446,217	622,629	20,738,830	26,201,585	109,639	177,019	28,013	925,575	1,240,246
Feb-24	1,276,448	3,487,721	557,922	15,563,296	20,885,387	85,438	162,871	19,625	641,688	909,622
Mar-24	2,114,589	3,095,560	615,033	22,158,786	27,983,969	104,029	137,178	15,664	806,929	1,063,800
Apr-24	2,553,802	880,919	631,655	21,263,080	25,329,456	132,464	57,815	12,169	836,727	1,039,175
May-24	1,770,205	1,086,810	351,244	19,034,294	22,242,552	112,625	64,120	11,640	977,182	1,165,567
Jun-24	1,623,412	1,186,571	207,398	15,883,613	18,900,994	82,777	64,774	8,241	826,865	982,657
Jul-24	1,382,861	1,410,922	228,738	17,081,886	20,104,409	88,958	74,617	8,613	967,827	1,140,015
Aug-24	1,745,713	1,889,045	395,980	16,778,581	20,809,318	113,673	84,362	11,550	962,180	1,171,765
Sep-24	1,919,983	2,052,034	378,662	18,032,721	22,383,400	108,782	95,667	13,048	956,495	1,173,992
Oct-24	2,506,298	1,888,422	299,715	20,096,647	24,791,083	131,812	96,221	11,494	959,073	1,198,600
Nov-24	1,630,883	1,941,307	369,918	17,782,010	21,724,119	96,476	102,770	12,427	825,449	1,037,122
Dec-24	2,915,183	2,366,307	412,163	18,466,015	24,159,668	159,107	140,388	18,745	1,013,390	1,331,630
TOTAL	22,833,284	24,731,836	5,071,059	222,879,760	275,515,939	1,325,780	1,257,802	171,229	10,699,380	13,454,191

Month	Cleared MW					Cleared Volume				
	Import	Export	Wheel	Internal	Total	Import	Export	Wheel	Internal	Total
Jan-24	432,931	1,174,081	249,337	8,489,035	10,345,385	50,907	74,004	11,400	448,898	585,209
Feb-24	490,568	986,528	245,479	7,167,365	8,889,940	34,100	54,648	6,789	296,101	391,638
Mar-24	688,499	964,650	274,492	8,772,338	10,699,978	37,226	54,211	5,702	348,530	445,669
Apr-24	575,102	319,891	253,730	6,714,925	7,863,648	37,781	23,217	4,342	320,186	385,526
May-24	391,409	375,117	168,607	5,815,471	6,750,604	36,393	27,920	3,660	398,792	466,765
Jun-24	488,592	476,316	71,640	6,026,374	7,062,923	35,413	30,970	3,012	390,313	459,708
Jul-24	352,243	455,325	79,374	5,601,800	6,488,742	37,627	30,095	1,938	493,552	563,212
Aug-24	563,725	410,942	143,077	5,590,248	6,707,992	56,263	24,647	4,618	540,450	625,978
Sep-24	634,070	507,312	139,039	6,271,395	7,551,817	41,991	31,418	5,009	484,376	562,794
Oct-24	734,933	526,973	96,888	6,589,942	7,948,736	43,705	33,318	3,706	417,490	498,219
Nov-24	418,179	528,677	152,846	5,456,604	6,556,306	33,395	31,180	4,160	315,374	384,109
Dec-24	945,870	509,356	178,429	6,135,454	7,769,108	69,597	43,388	8,311	435,152	556,448
TOTAL	6,716,121	7,235,170	2,052,939	78,630,949	94,635,178	514,398	459,016	62,647	4,889,214	5,925,275

## Sham Scheduling

Sham scheduling refers to a scheduling method under which a market participant breaks a single transaction, from generation balancing authority (source) to load balancing authority (sink), into multiple segments. Sham scheduling hides the actual source of generation from the load balancing authority. When unable to identify the source of the energy, the load balancing authority cannot see how the power will flow to the load, which can create loop flows and result in inaccurate pricing for transactions.

For example, if the generation balancing authority (source) is NYISO, and the load balancing authority (sink) is PJM, the transaction would be priced, in the PJM energy market, at the PJM/NYIS Interface regardless of the submitted path. However, if a market participant were to break the transaction into multiple segments, one on the NYIS-ONT path, and a second segment on the ONT-MISO-PJM path, the market participant would conceal the true source (NYISO) from PJM, and PJM would price the transaction as if its source were Ontario (the ONT interface price).

Sham scheduling can also be achieved by submitting a transaction that is in the opposite direction of a portion of a larger transaction schedule.

For example, market participants can submit one transaction with multiple segments among balancing authorities and another transaction which offsets all or part of a segment of the first transaction. If a market participant submits two separate transactions, one on the ONT-MISO-PJM path, and a second on the PJM-MISO path, the result of these transactions would be a net scheduled transaction from ONT to MISO, as the MISO-PJM segment of the first transaction is offset by the PJM-MISO transaction. In this example, PJM is not required to raise or lower generation as a result of these transactions, as they would for an import or an export, and there are no associated power flows across PJM. Nonetheless, the market participant is paid the price difference between the PJM/ONT interface pricing point and the PJM/MISO interface pricing point. The market participant would be paid the PJM/ONT interface pricing point for the first transaction (ONT to PJM import) and the market participant would pay the PJM/MISO interface



pricing point for the second transaction (PJM to MISO export). If the PJM/ONT interface price were higher than the PJM/MISO interface price, the market participant would be paid a net profit from the PJM market even though there was no impact on PJM operations.

At the April 10, 2013, PJM Market Implementation Committee (MIC), the MMU presented a problem statement and issue charge to address sham scheduling activities.<sup>61</sup> The expected deliverables from the stakeholder meetings were revisions to the Tariff and PJM business manuals. The topic was discussed at several MIC meetings. While there was stakeholder agreement that sham scheduling activity was inappropriate, consensus on revised tariff and manual language was not achieved. The topic was closed. The MMU clarified that it would continue to monitor transactions for sham scheduling activities and that the MMU could refer market participants for sham scheduling activities.

The MMU monitors for sham scheduling activities on a daily basis. Following the stakeholder discussions in 2013, the net profits obtained from sham scheduling activities fell by 104.9 percent, from net profits of \$15.5 million in 2014, to a net loss of \$761,012 in 2024. The total number of hours of sham scheduling segments where the MW profile matched exactly across all segments of the path combinations in the same hour fell by 86.6 percent, from 1,898 hours in 2014 to 254 hours in 2024.

The MMU recommends that PJM implement rules to prevent sham scheduling. The MMU recommends that PJM apply after the fact market settlement adjustments to identified sham scheduling segments to ensure that market participants cannot benefit from sham scheduling.

## Elimination of Ontario Interface Pricing Point

The PJM/IMO interface pricing point (Ontario) was created to reflect the fact that transactions that originate or sink in the IESO balancing authority create actual energy flows that are split between the MISO and NYISO interface pricing points. PJM created the PJM/IMO interface pricing point to reflect the actual power flows across both the MISO/PJM and NYISO/PJM Interfaces.

<sup>61</sup> See Market Path/Interface Pricing Point alignment Problem Statement, at: <[http://www.monitoringanalytics.com/reports/Presentations/2013/IMM\\_MIC\\_Market\\_Path\\_Interface\\_Pricing\\_Point\\_Alignment\\_Problem\\_Statement\\_201304010.pdf](http://www.monitoringanalytics.com/reports/Presentations/2013/IMM_MIC_Market_Path_Interface_Pricing_Point_Alignment_Problem_Statement_201304010.pdf)>.

The IMO does not have physical ties with PJM because it is not contiguous.

Prior to June 1, 2015, the PJM/IMO interface pricing point was defined as the LMP at the IESO Bruce bus. The LMP at the Bruce bus includes a congestion and loss component across the MISO and NYISO balancing authorities.

The noncontiguous nature of the PJM/IMO interface pricing point creates opportunities for market participants to engage in sham scheduling activities.<sup>62</sup> For example, a market participant can use two separate transactions to create a flow from Ontario to MISO. In this example, the market participant uses the PJM energy market as a temporary generation and load point by first submitting a wheeling transaction from Ontario, through MISO and into PJM, then by submitting a second transaction from PJM to MISO. These two transactions, combined, create an actual flow along the Ontario/MISO Interface. Through sham scheduling, the market participant receives settlements from PJM when no changes in generation occur. This activity is similar to that observed when PJM had a Southwest and Southeast interface pricing point. During that time, market participants would use the PJM spot market as a temporary load and generation point to wheel transactions through the PJM energy market. This was done to take advantage of the price differences between the interfaces without providing the market benefits of congestion relief.

A new PJM/IMO interface price method was implemented on June 1, 2015. The new method uses a dynamic weighting of the PJM/MISO interface price and the PJM/NYIS interface price, based on the performance of the Michigan-Ontario PARs. When the absolute value of the actual flows on the PARs are greater than or equal to the absolute value of the scheduled flows on the PARs, and the scheduled and actual flows are in the same direction, the PJM/IMO interface price will be equal to the PJM/MISO interface price (i.e. 100 percent weighting on the PJM/MISO Interface). When actual flows on the PARs are in the opposite direction of the scheduled flows on the PARs, the PJM/IMO interface price will be equal to the PJM/NYIS interface price (i.e. 100 percent weighting on the PJM/NYIS Interface). When the absolute value of the actual flows on the PARs are less than or equal to the absolute value of the scheduled flows on the PARs, and

<sup>62</sup> See "Sham Scheduling," Presented at the PJM Market Monitoring Unit Advisory Committee (MMUAC) meeting held on December 6, 2013 <[http://www.monitoringanalytics.com/reports/Presentations/2013/IMM\\_Shams\\_Scheduling\\_20131206.pdf](http://www.monitoringanalytics.com/reports/Presentations/2013/IMM_Shams_Scheduling_20131206.pdf)>.

the scheduled and actual flows are in the same direction, the PJM/IMO interface price will be a combination to the PJM/MISO interface price and the PJM/NYIS interface price. In this case the weightings of the PJM/MISO and PJM/NYIS interface prices are determined based on the scheduled and actual flows. For example, in a given interval, the scheduled flow on the Michigan-Ontario PARs is 1,000 MW, and the actual flow is 800 MW. If in that same interval, the PJM/MISO interface price is \$45.00 and the PJM/NYIS interface price \$30.00, the PJM/IMO interface price would be calculated with a weighting of 80 percent of the PJM/MISO interface price ( $\$45.00 \times 0.8$ , or \$36.00) and 20 percent of the PJM/NYIS interface price ( $\$30.00 \times 0.2$ , or \$6.00), for a PJM/IMO interface price of \$42.00.

The MMU believes that the new PJM/IMO interface price method is a step in the right direction towards pricing energy that sources or sinks in Ontario based on the path of the actual, physical transfer of energy. The MMU remains concerned about the assumption of PAR operations, and will continue to evaluate the impact of PARs on the scheduled and actual flows and the impacts on the PJM/IMO interface price. The MMU remains concerned about the potential for market participants to continue to engage in sham scheduling activities after the new method is implemented.

The MMU recommends that if the PJM/IMO interface price remains and with PJM's new method in place, that PJM implement additional business rules to remove the incentive to engage in sham scheduling activities using the PJM/IMO interface price. Such rules would prohibit the same market participant from scheduling an export transaction from PJM to any balancing authority while at the same time an import transaction is scheduled to PJM that receives the PJM/IMO interface price. PJM should also prohibit the same market participant from scheduling an import transaction to PJM from any balancing authority while at the same time an export transaction is scheduled from PJM that receives the PJM/IMO interface price.

In 2024, of the 1,050.5 GWh of net scheduled transactions between PJM and IESO, 1,019.2 GWh (97.0 percent) wheeled through MISO (Table 9-25). The MMU recommends that PJM eliminate the PJM/IMO interface pricing point, and assign the transactions that originate

or sink in the IESO balancing authority to the PJM/MISO interface pricing point.<sup>63</sup>

## PJM and NYISO Coordinated Interchange Transactions

Coordinated transaction scheduling (CTS) provides the option for market participants to submit intra-hour transactions between the NYISO and PJM that include an interface spread bid on which transactions are evaluated.<sup>64</sup> The evaluation is based on the forward-looking prices as determined by PJM's intermediate term security constrained economic dispatch tool (IT SCED) and the NYISO's real-time commitment (RTC) tool. PJM shares its PJM/NYISO interface price IT SCED results with the NYISO. The NYISO compares the PJM/NYISO interface price with its RTC calculated NYISO/PJM interface price. If the PJM and NYISO interface price spread is greater than the market participant's CTS bid, the transaction is approved. If the PJM and NYISO interface price spread is less than the CTS bid, the transaction is denied.

The IT SCED application runs every five minutes and each run produces forecast LMPs for the intervals approximately 30 minutes, 45 minutes, 90 minutes and 135 minutes ahead. Therefore, for each 15 minute interval, the various IT SCED solutions will produce 12 forecasted PJM/NYIS interface prices. To evaluate the accuracy of IT SCED forecasts, the forecasted PJM/NYIS interface price for each 15 minute interval from IT SCED was compared to the actual real-time interface LMP for 2024. Table 9-46 shows that over all 12 forecast ranges, IT SCED predicted the real-time PJM/NYIS interface LMP within the range of \$0.00 to \$5.00 in 28.9 percent of the intervals. In those intervals, the average price difference between the IT SCED forecasted LMP and the actual real-time LMP was \$2.12 per MWh. In 14.7 percent of all intervals, the absolute value of the average price difference between the IT SCED forecasted LMP and the actual real-time interface LMP was greater than \$20.00. The average price differences were \$61.81 when the price difference was greater than \$20.00, and \$61.26 when the price difference was greater than -\$20.00.

<sup>63</sup> On October 1, 2013, a sub-group of PJM's Market Implementation Committee started stakeholder discussions to address this inconsistency in market pricing.

<sup>64</sup> PJM and the NYISO implemented CTS on November 4, 2014. 146 FERC ¶ 61,096 (2014).

**Table 9-46 Differences between forecast and actual PJM/NYIS interface prices: 2024**

Range of Price Differences	Percent of All Intervals	Average Price Difference
> \$20	8.7%	\$61.81
\$10 to \$20	9.0%	\$14.00
\$5 to \$10	12.3%	\$7.17
\$0 to \$5	28.9%	\$2.12
\$0 to -\$5	22.9%	\$1.97
-\$5 to -\$10	7.1%	\$7.10
-\$10 to -\$20	5.0%	\$14.03
< -\$20	6.0%	\$61.26

Table 9-47 shows how the accuracy of the IT SCED forecasted LMPs changes as the cases approach real-time. In the final IT SCED results prior to real time, in 48.6 percent of all intervals, the average price difference between the IT SCED forecasted LMP and the actual real-time interface LMP fell within +/- \$5.00 of the actual PJM/NYIS interface real-time LMP, compared to 48.7 percent in the 135 minute ahead IT SCED results.

**Table 9-47 Differences between forecast and actual PJM/NYIS interface prices: 2024**

Range of Price Differences	~ 135 Minutes Prior to Real-Time		~ 90 Minutes Prior to Real-Time		~ 45 Minutes Prior to Real-Time		~ 30 Minutes Prior to Real-Time	
	Percent of Intervals	Average Price Difference	Percent of Intervals	Average Price Difference	Percent of Intervals	Average Price Difference	Percent of Intervals	Average Price Difference
> \$20	15.5%	\$87.57	6.5%	\$45.05	6.8%	\$47.68	8.0%	\$46.20
\$10 to \$20	10.0%	\$14.19	8.4%	\$13.91	8.5%	\$13.91	9.7%	\$14.13
\$5 to \$10	11.8%	\$7.20	11.9%	\$7.13	12.4%	\$7.14	12.3%	\$7.20
\$0 to \$5	28.1%	\$2.05	31.3%	\$2.09	28.9%	\$2.13	25.2%	\$2.22
\$0 to -\$5	20.6%	\$1.88	23.8%	\$1.94	23.4%	\$2.04	23.4%	\$2.12
-\$5 to -\$10	5.4%	\$7.11	7.1%	\$7.09	7.9%	\$7.12	8.7%	\$7.10
-\$10 to -\$20	3.9%	\$14.02	5.0%	\$14.04	5.5%	\$14.08	6.0%	\$14.01
< -\$20	4.7%	\$63.23	6.0%	\$61.33	6.6%	\$60.04	6.8%	\$58.78

In 14.8 percent of the intervals in the 30 minute ahead forecast, the absolute value of the average price difference between the IT SCED forecasted LMP and the actual real-time interface LMP was greater than \$20.00. The average price difference was \$46.20 when the price difference was greater than \$20.00, and \$58.78 when the price difference was greater than -\$20.00.

Table 9-48 and Table 9-49 show the monthly differences between forecasted and actual PJM/NYIS interface prices. Analysis of the data on a monthly basis shows that there is a decline in the accuracy of the IT SCED forecast during periods of cold and hot weather.

Table 9-48 Monthly Differences between forecast and actual PJM/NYIS interface prices (percent of intervals): 2024

Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 30 Minutes Prior to Real-Time	> \$20	18.0%	9.5%	8.8%	6.3%	9.8%	5.2%	7.8%	5.6%	5.5%	4.2%	4.0%	11.3%	8.0%
	\$10 to \$20	10.3%	11.2%	11.9%	11.3%	13.8%	8.0%	9.9%	7.9%	9.1%	7.1%	7.3%	8.5%	9.7%
	\$5 to \$10	12.3%	15.0%	13.3%	17.0%	15.1%	12.4%	10.2%	11.5%	12.0%	9.6%	9.1%	9.9%	12.3%
	\$0 to \$5	20.1%	23.7%	26.8%	33.6%	24.4%	30.6%	25.3%	25.3%	22.9%	26.0%	25.6%	18.1%	25.2%
	\$0 to -\$5	16.6%	18.6%	20.2%	19.4%	19.2%	26.5%	25.4%	25.6%	28.6%	30.5%	30.7%	19.8%	23.4%
	-\$5 to -\$10	6.5%	8.5%	7.4%	5.5%	7.4%	7.7%	8.8%	10.3%	9.3%	10.8%	12.3%	10.1%	8.7%
	-\$10 to -\$20	6.3%	6.6%	5.4%	3.1%	5.2%	4.4%	4.7%	6.7%	6.3%	5.4%	8.0%	9.4%	6.0%
	< -\$20	9.9%	6.9%	6.3%	4.0%	5.1%	5.2%	8.0%	7.2%	6.2%	6.4%	3.1%	12.8%	6.8%
Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 45 Minutes Prior to Real-Time	> \$20	12.7%	7.4%	7.8%	7.2%	8.5%	2.8%	5.0%	3.4%	4.4%	4.9%	5.4%	12.4%	6.8%
	\$10 to \$20	9.4%	10.5%	11.1%	8.5%	12.5%	6.7%	7.0%	6.8%	7.7%	6.7%	6.3%	8.5%	8.5%
	\$5 to \$10	11.9%	14.3%	11.8%	17.6%	15.4%	12.5%	12.3%	10.0%	10.7%	9.3%	11.0%	11.8%	12.4%
	\$0 to \$5	22.8%	26.1%	29.0%	36.0%	26.9%	35.7%	29.6%	30.1%	28.6%	30.2%	28.3%	23.2%	28.9%
	\$0 to -\$5	19.1%	19.5%	20.7%	19.1%	19.8%	25.5%	25.7%	26.5%	27.4%	28.9%	30.3%	18.5%	23.4%
	-\$5 to -\$10	7.3%	8.7%	7.3%	5.0%	7.0%	7.3%	7.5%	9.2%	9.1%	9.1%	9.5%	8.1%	7.9%
	-\$10 to -\$20	6.8%	6.5%	5.7%	2.8%	4.6%	4.1%	4.5%	6.6%	6.0%	5.0%	6.3%	7.2%	5.5%
	< -\$20	10.1%	7.0%	6.6%	3.8%	5.3%	5.4%	8.3%	7.4%	6.0%	5.9%	2.7%	10.4%	6.6%
Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 90 Minutes Prior to Real-Time	> \$20	13.1%	7.4%	7.0%	6.0%	5.7%	2.6%	5.8%	3.2%	5.4%	5.8%	3.4%	12.1%	6.5%
	\$10 to \$20	10.3%	10.3%	10.7%	11.5%	10.0%	5.2%	6.9%	5.7%	7.4%	7.2%	6.1%	9.1%	8.4%
	\$5 to \$10	12.3%	13.4%	12.7%	14.9%	15.3%	11.7%	9.2%	10.9%	9.8%	9.3%	11.9%	11.8%	11.9%
	\$0 to \$5	24.7%	28.1%	30.0%	37.1%	31.6%	37.5%	32.1%	32.3%	31.0%	33.3%	32.6%	25.4%	31.3%
	\$0 to -\$5	17.8%	20.8%	21.9%	20.4%	20.5%	27.9%	26.3%	26.8%	28.1%	27.6%	29.3%	18.4%	23.8%
	-\$5 to -\$10	7.3%	7.7%	6.9%	3.8%	7.1%	6.1%	7.0%	8.8%	7.1%	7.0%	8.7%	7.6%	7.1%
	-\$10 to -\$20	5.6%	6.0%	5.0%	2.6%	5.2%	3.9%	4.7%	5.1%	5.4%	4.8%	5.2%	6.7%	5.0%
	< -\$20	9.0%	6.3%	5.9%	3.7%	4.6%	5.1%	8.1%	7.1%	5.7%	5.0%	2.8%	8.8%	6.0%
Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 135 Minutes Prior to Real-Time	> \$20	22.2%	17.3%	20.8%	21.6%	16.8%	7.0%	10.5%	8.0%	14.0%	15.8%	12.9%	18.5%	15.5%
	\$10 to \$20	11.2%	11.3%	11.0%	11.4%	13.8%	7.3%	8.4%	8.2%	10.0%	8.0%	8.4%	10.6%	10.0%
	\$5 to \$10	11.9%	11.6%	11.6%	13.5%	15.1%	12.5%	10.9%	12.0%	10.6%	11.0%	10.3%	10.7%	11.8%
	\$0 to \$5	21.1%	24.8%	25.3%	31.1%	26.7%	35.5%	30.3%	31.1%	28.7%	30.2%	29.2%	23.3%	28.1%
	\$0 to -\$5	16.2%	19.2%	19.2%	16.0%	16.0%	25.2%	23.3%	22.9%	23.1%	22.7%	27.1%	16.8%	20.6%
	-\$5 to -\$10	5.6%	5.8%	4.6%	2.3%	5.2%	4.8%	6.0%	7.2%	5.1%	5.4%	6.4%	6.7%	5.4%
	-\$10 to -\$20	4.3%	5.6%	3.6%	1.5%	3.6%	3.2%	3.5%	4.6%	4.5%	3.2%	3.6%	6.1%	3.9%
	< -\$20	7.4%	4.4%	3.9%	2.5%	2.9%	4.7%	7.0%	6.0%	3.9%	3.6%	2.1%	7.2%	4.7%

**Table 9-49 Monthly differences between forecast and actual PJM/NYIS interface prices (average price difference): 2024**

Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 30 Minutes Prior to Real-Time	> \$20	\$63.59	\$35.71	\$39.05	\$40.05	\$35.37	\$36.31	\$46.19	\$52.49	\$43.38	\$38.75	\$35.17	\$54.10	\$46.20
	\$10 to \$20	\$13.85	\$14.17	\$14.21	\$14.10	\$14.47	\$14.27	\$14.03	\$13.53	\$14.47	\$14.17	\$14.17	\$13.96	\$14.13
	\$5 to \$10	\$7.27	\$7.20	\$7.34	\$7.17	\$7.31	\$7.08	\$7.20	\$7.13	\$7.17	\$7.25	\$6.98	\$7.22	\$7.20
	\$0 to \$5	\$2.41	\$2.34	\$2.20	\$2.48	\$2.31	\$2.10	\$2.14	\$2.15	\$2.10	\$2.08	\$2.15	\$2.16	\$2.22
	\$0 to -\$5	\$2.26	\$2.22	\$2.01	\$2.04	\$2.27	\$1.95	\$1.89	\$2.01	\$2.07	\$2.22	\$2.34	\$2.13	\$2.12
	-\$5 to -\$10	\$7.21	\$7.12	\$7.16	\$7.06	\$7.09	\$6.99	\$6.97	\$7.17	\$7.05	\$7.07	\$7.01	\$7.31	\$7.10
	-\$10 to -\$20	\$13.91	\$14.23	\$14.18	\$14.24	\$13.80	\$13.83	\$14.16	\$13.45	\$14.00	\$13.92	\$13.88	\$14.42	\$14.01
	< -\$20	\$75.15	\$40.06	\$52.10	\$51.91	\$57.26	\$81.38	\$78.64	\$60.29	\$48.30	\$66.14	\$51.77	\$42.17	\$58.78
Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 45 Minutes Prior to Real-Time	> \$20	\$50.64	\$37.48	\$41.12	\$51.03	\$44.83	\$38.16	\$52.25	\$55.39	\$44.34	\$60.16	\$44.64	\$50.16	\$47.68
	\$10 to \$20	\$13.77	\$13.89	\$14.33	\$13.79	\$14.13	\$13.33	\$13.46	\$13.43	\$13.84	\$13.94	\$14.18	\$14.36	\$13.91
	\$5 to \$10	\$7.23	\$7.23	\$7.23	\$7.01	\$7.25	\$7.08	\$7.13	\$7.27	\$7.03	\$6.96	\$7.01	\$7.15	\$7.14
	\$0 to \$5	\$2.27	\$2.17	\$2.08	\$2.38	\$2.28	\$1.95	\$2.08	\$2.06	\$1.97	\$1.96	\$2.14	\$2.23	\$2.13
	\$0 to -\$5	\$2.23	\$2.21	\$2.01	\$1.94	\$2.19	\$1.83	\$1.95	\$1.90	\$1.95	\$2.01	\$2.20	\$2.21	\$2.04
	-\$5 to -\$10	\$7.27	\$7.14	\$7.13	\$7.10	\$7.12	\$7.06	\$7.07	\$7.30	\$7.04	\$7.10	\$6.95	\$7.20	\$7.12
	-\$10 to -\$20	\$14.13	\$14.41	\$14.21	\$14.32	\$14.06	\$13.64	\$14.34	\$13.65	\$14.17	\$13.78	\$13.86	\$14.42	\$14.08
	< -\$20	\$76.60	\$39.12	\$50.94	\$49.91	\$56.01	\$83.61	\$77.03	\$61.37	\$51.45	\$67.76	\$56.14	\$43.70	\$60.04
Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 90 Minutes Prior to Real-Time	> \$20	\$48.90	\$35.63	\$39.21	\$48.73	\$51.07	\$39.45	\$48.43	\$43.85	\$46.55	\$55.06	\$39.31	\$41.05	\$45.05
	\$10 to \$20	\$14.36	\$13.92	\$14.03	\$13.98	\$13.40	\$13.65	\$13.87	\$13.34	\$13.85	\$13.92	\$14.19	\$14.07	\$13.91
	\$5 to \$10	\$7.32	\$7.14	\$7.24	\$7.14	\$7.07	\$7.06	\$7.03	\$7.20	\$7.16	\$6.98	\$7.00	\$7.21	\$7.13
	\$0 to \$5	\$2.26	\$2.24	\$2.00	\$2.24	\$2.28	\$1.93	\$2.02	\$1.97	\$1.95	\$2.04	\$2.00	\$2.24	\$2.09
	\$0 to -\$5	\$1.95	\$2.17	\$1.94	\$1.91	\$2.07	\$1.80	\$1.89	\$1.95	\$1.84	\$1.89	\$1.97	\$2.01	\$1.94
	-\$5 to -\$10	\$7.16	\$6.96	\$7.01	\$7.07	\$7.06	\$7.11	\$7.01	\$7.15	\$7.03	\$6.94	\$7.21	\$7.26	\$7.09
	-\$10 to -\$20	\$14.00	\$14.14	\$14.45	\$14.27	\$14.17	\$13.89	\$13.57	\$13.83	\$13.68	\$13.84	\$13.62	\$14.86	\$14.04
	< -\$20	\$77.04	\$39.73	\$52.88	\$52.66	\$55.99	\$84.96	\$78.41	\$61.48	\$49.81	\$72.55	\$55.78	\$45.15	\$61.33
Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 135 Minutes Prior to Real-Time	> \$20	\$77.64	\$83.72	\$94.05	\$91.18	\$91.92	\$48.16	\$54.76	\$56.55	\$66.64	\$158.00	\$125.60	\$63.16	\$87.57
	\$10 to \$20	\$14.00	\$14.59	\$14.18	\$14.53	\$14.08	\$13.94	\$14.07	\$13.69	\$14.45	\$14.13	\$14.00	\$14.44	\$14.19
	\$5 to \$10	\$7.29	\$7.38	\$7.38	\$7.12	\$7.12	\$7.10	\$7.18	\$7.18	\$7.21	\$7.21	\$7.11	\$7.18	\$7.20
	\$0 to \$5	\$2.16	\$2.13	\$1.92	\$2.28	\$2.21	\$1.85	\$1.99	\$1.99	\$1.88	\$2.04	\$2.01	\$2.17	\$2.05
	\$0 to -\$5	\$1.93	\$2.16	\$1.86	\$1.75	\$2.00	\$1.74	\$1.79	\$1.84	\$1.73	\$1.89	\$2.00	\$2.00	\$1.88
	-\$5 to -\$10	\$7.06	\$7.06	\$6.98	\$7.28	\$7.01	\$7.30	\$7.08	\$7.18	\$7.03	\$6.96	\$7.19	\$7.21	\$7.11
	-\$10 to -\$20	\$14.08	\$14.18	\$14.19	\$14.40	\$13.86	\$13.64	\$14.17	\$13.72	\$13.67	\$13.59	\$13.61	\$14.81	\$14.02
	< -\$20	\$75.89	\$41.82	\$58.98	\$56.14	\$52.71	\$83.96	\$82.44	\$62.02	\$50.24	\$73.56	\$57.40	\$44.11	\$63.23

The NYISO uses PJM's IT SCED forecasted LMPs to compare against the NYISO Real-Time Commitment (RTC) results in its evaluation of CTS transactions. The NYISO approves CTS (spread bid) transactions when the offered spread is less than or equal to the spread between the IT SCED forecast PJM/NYIS interface LMP and the NYISO RTC forecast NYIS/PJM interface LMP. The large differences between forecast and actual LMPs in the intervals closest to real-time could cause CTS transactions to be approved that would contribute to transactions being scheduled counter to real-time economic signals, and contribute to inefficient scheduling across the PJM/NYIS border.


CTS transactions are evaluated based on the spread bid, which limits the amount of price convergence that can occur. As long as balancing operating reserve charges are applied and CTS transactions are optional, the CTS proposal represents a small incremental step toward better interface pricing. The NYISO has a 75 minute bid submission deadline. While market participants have the option to specify bid data on 15 minute intervals, market participants must submit their bids 75 minutes prior to the requested transaction start time. The 75 minute bid submission deadline associated with scheduling energy transactions in the NYISO should be shortened. Reducing this deadline could significantly improve pricing efficiency at the PJM/NYISO border for non-CTS transactions and for CTS transactions as market participants would be able to adjust their bids in response to real-time price signals.

CTS transactions were evaluated for each 15 minute interval. From November 4, 2014, through December 31, 2024, 946,388 15 minute CTS schedules were approved through the CTS process based on the forecast LMPs. When the



forecast LMPs for the approved intervals were compared to the hourly integrated real-time LMPs, the direction of the flow in 290,401 (30.7 percent) of the intervals was inconsistent with the differences in real-time PJM/NYISO and NYISO/PJM prices. For example, if a market participant submits a CTS transaction from NYISO to PJM with a spread bid of \$5.00, and NYISO's forecasted PJM interface price was at least \$5.00 lower than PJM's forecasted NYISO interface price, the transaction would be approved. For 30.7 percent of the approved transactions, the actual, real-time price differentials were in the opposite direction of the forecast differential. The actual, real-time price differentials meant that the transactions would have been economic in the opposite direction. For 69.3 percent of the intervals, the forecast price differentials were consistent with real-time PJM/NYISO and NYISO/PJM price differences. Figure 9-11 shows the monthly volume of cleared PJM/NYIS CTS bids. Figure 9-11 also shows the percent of cleared bids that resulted in flows consistent and inconsistent with price differences.

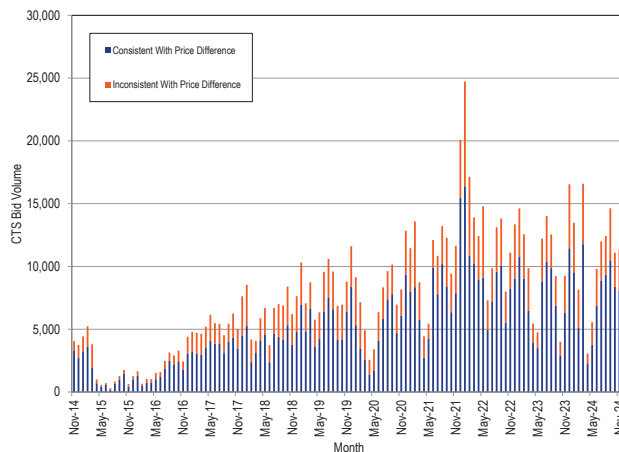**Figure 9-11 Monthly cleared PJM/NYIS CTS bid volume: November 4, 2014 through December 31, 2024**



The data reviewed show that IT SCED is not a highly accurate predictor of the real-time PJM/NYIS interface prices. This limits the effectiveness of CTS in improving interface pricing between PJM and NYISO.

## Reserving Ramp on the PJM/NYISO Interface

Prior to the implementation of CTS, PJM held ramp space for all transactions submitted between PJM and the NYISO as soon as the NERC Tag was approved.

At that time, once transactions were evaluated by the NYISO through their real-time market clearing process, any adjustments made to the submitted transactions would be reflected on the NERC Tags and the PJM ramp was adjusted accordingly.

As part of this process, PJM was often required to make adjustments to transactions on its other interfaces in order to bring total system ramp back to within its limit. The default ramp limit in PJM is +/- 1,000 MW. For example, the ramp in a given interval is currently -1,000 MW, consisting of 2,000 MW of imports from the NYISO to PJM and 3,000 MW of exports from PJM on its other interfaces. If, through the NYISO real-time market clearing process, the NYISO only approves 1,000 MW of the imports, the other 1,000 MW of import transactions from the NYISO would be curtailed. The ramp in this interval would then be -2,000 MW, consisting of the 1,000 MW of cleared imports from the NYISO to PJM and 3,000 MW of exports from PJM on its other interfaces. PJM would then be required to curtail an additional 1,000 MW of exports at its other interface to bring the limit back to within +/- 1,000. These curtailments were made on a last in first out basis as determined by the timestamp on the NERC Tag.

With the implementation of the CTS product with the NYISO, PJM modified how ramp is handled at the PJM/NYISO Interface. Effective November 4, 2014, PJM no longer holds ramp room for any transactions submitted between PJM and the NYISO at the time of submission. Only after the NYISO completes its real-time market clearing process, and communicates the results to PJM, does PJM perform a ramp evaluation on transactions scheduled with the NYISO. If, in the event the NYISO market clearing process would violate ramp, PJM would make additional adjustments based on a last-in first-out basis as determined by the timestamp on the NERC Tag. This process prevents the transactions scheduled at the PJM/NYISO Interface from holding (or creating) ramp until NYISO has completed its economic evaluation and the transactions are approved through the NYISO market clearing process.

## PJM and MISO Coordinated Interchange Transaction Proposal

PJM and MISO proposed the implementation of coordinated interchange transactions, similar to the PJM/NYISO approach, through the Joint and Common

Market Initiative. The PJM/MISO coordinated transaction scheduling (CTS) process provides the option for market participants to submit intra-hour transactions between the MISO and PJM that include an interface spread bid on which transactions are evaluated. Similar to the PJM/NYISO approach, the evaluation is based, in part, on the forward-looking prices as determined by PJM's intermediate term security constrained economic dispatch tool (IT SCED). Unlike the PJM/NYISO CTS process in which the NYISO performs the evaluation, the PJM/MISO CTS process uses a joint clearing process in which both RTOs share forward looking prices. On October 3, 2017, PJM and MISO implemented the CTS process.

The IT SCED application runs every five minutes and each run produces forecast LMPs for the intervals approximately 30 minutes, 45 minutes, 90 minutes and 135 minutes ahead. Therefore, for each 15 minute interval, the various IT SCED solutions will produce 12 forecasted PJM/MISO interface prices. To evaluate the accuracy of IT SCED forecasts, the forecasted PJM/MISO interface price for each 15 minute interval from IT SCED was compared to the actual real-time interface LMP for 2024. Table 9-50 shows that over all 12 forecast ranges, IT SCED predicted the real-time PJM/MISO interface LMP within the range of \$0.00 to \$5.00 in 28.6 percent of all intervals. In those intervals, the average price difference between the IT SCED forecasted LMP and the actual real-time LMP was \$2.07. In 14.9 percent of all intervals, the absolute value of the average price difference between the IT SCED forecasted LMP and the actual real-time interface LMP was greater than \$20.00. The average price differences were \$61.07 when the price difference was greater than \$20.00, and \$65.48 when the price difference was greater than -\$20.00.

**Table 9-50 Differences between forecast and actual PJM/MISO interface prices: 2024**

Range of Price Differences	Percent of All Intervals	Average Price Difference
> \$20	10.4%	\$61.07
\$10 to \$20	9.4%	\$14.00
\$5 to \$10	12.6%	\$7.18
\$0 to \$5	28.6%	\$2.07
\$0 to -\$5	23.4%	\$1.90
-\$5 to -\$10	6.9%	\$7.08
-\$10 to -\$20	4.3%	\$13.90
< -\$20	4.5%	\$65.48

Table 9-51 shows how the accuracy of the IT SCED forecasted LMPs change as the cases approach real-time. In the final IT SCED results prior to real-time, in 49.2 percent of all intervals, the average price difference between the IT SCED forecasted LMP and the actual real-time interface LMP fell within +/- \$5.00 of the actual PJM/MISO interface real-time LMP, compared to 49.6 percent in the 135 minute ahead IT SCED results.

**Table 9-51 Differences between forecast and actual PJM/MISO interface prices: 2024**

Range of Price Differences	~ 135 Minutes Prior to Real-Time		~ 90 Minutes Prior to Real-Time		~ 45 Minutes Prior to Real-Time		~ 30 Minutes Prior to Real-Time	
	Percent of Intervals	Average Price Difference	Percent of Intervals	Average Price Difference	Percent of Intervals	Average Price Difference	Percent of Intervals	Average Price Difference
> \$20	16.7%	\$87.55	8.7%	\$48.20	8.2%	\$49.74	9.8%	\$45.25
\$10 to \$20	9.6%	\$14.00	8.8%	\$13.86	9.2%	\$13.93	9.9%	\$14.11
\$5 to \$10	12.5%	\$7.23	12.7%	\$7.19	12.7%	\$7.15	11.7%	\$7.23
\$0 to \$5	28.3%	\$2.00	30.9%	\$2.04	28.3%	\$2.08	24.6%	\$2.16
\$0 to -\$5	21.3%	\$1.80	24.0%	\$1.88	24.1%	\$1.96	24.6%	\$2.04
-\$5 to -\$10	5.3%	\$7.04	6.5%	\$7.06	7.8%	\$7.11	8.7%	\$7.11
-\$10 to -\$20	3.0%	\$13.77	4.0%	\$13.81	4.7%	\$13.99	5.4%	\$13.94
< -\$20	3.4%	\$68.89	4.5%	\$64.85	5.0%	\$63.36	5.3%	\$62.81

In 15.1 percent of the intervals in the 30 minute ahead forecast, the absolute value of the average price difference between the IT SCED forecasted LMP and the actual real-time interface LMP was greater than \$20.00, the average price differences were \$45.25 when the price difference was greater than \$20.00, and \$62.81 when the price difference was greater than -\$20.00.

Table 9-52 and Table 9-53 show the monthly differences between forecasted and actual PJM/MISO interface prices. Analysis of the data on a monthly basis shows that there is a decline in the accuracy of the IT SCED forecast during periods of cold and hot weather.

**Table 9-52 Monthly differences between forecast and actual PJM/MISO interface prices (percent of intervals): 2024**


Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 30 Minutes Prior to Real-Time	> \$20	12.8%	4.6%	6.8%	13.3%	17.4%	8.3%	9.8%	6.0%	8.3%	10.2%	7.7%	12.3%	9.8%
	\$10 to \$20	8.1%	10.5%	10.6%	12.6%	14.3%	9.7%	10.7%	7.9%	8.2%	10.4%	8.6%	7.3%	9.9%
	\$5 to \$10	12.3%	15.4%	12.7%	14.9%	13.0%	11.1%	10.0%	10.0%	9.9%	9.8%	11.0%	11.1%	11.7%
	\$0 to \$5	28.0%	29.3%	25.7%	24.7%	20.3%	24.2%	22.2%	26.3%	23.9%	23.2%	24.4%	23.2%	24.6%
	\$0 to -\$5	22.8%	23.7%	23.9%	18.6%	16.4%	25.6%	24.5%	32.1%	31.5%	26.5%	24.9%	24.9%	24.6%
	-\$5 to -\$10	6.9%	8.2%	9.4%	7.4%	7.3%	9.4%	9.1%	8.2%	8.0%	9.1%	11.2%	9.5%	8.7%
	-\$10 to -\$20	4.0%	4.6%	6.4%	4.3%	5.9%	6.3%	5.9%	3.9%	5.0%	4.7%	8.2%	6.0%	5.4%
	< -\$20	5.1%	3.7%	4.5%	4.2%	5.5%	5.4%	7.8%	5.6%	5.1%	6.2%	4.0%	5.8%	5.3%
Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 45 Minutes Prior to Real-Time	> \$20	10.7%	4.4%	7.0%	12.6%	14.7%	5.1%	6.3%	3.3%	5.4%	8.7%	8.6%	11.3%	8.2%
	\$10 to \$20	7.9%	9.1%	10.1%	11.0%	14.4%	9.4%	8.7%	6.2%	7.7%	10.1%	8.1%	7.7%	9.2%
	\$5 to \$10	12.1%	15.7%	12.7%	17.4%	14.4%	12.2%	12.7%	10.5%	10.7%	11.1%	11.2%	11.9%	12.7%
	\$0 to \$5	30.4%	31.4%	28.3%	27.2%	22.3%	29.2%	28.2%	31.6%	28.7%	27.7%	26.8%	27.6%	28.3%
	\$0 to -\$5	23.8%	23.8%	23.6%	17.4%	17.0%	24.1%	23.1%	30.5%	30.1%	25.5%	26.3%	24.3%	24.1%
	-\$5 to -\$10	6.4%	7.5%	8.8%	6.8%	6.6%	9.4%	7.6%	8.0%	7.7%	7.9%	9.2%	7.4%	7.8%
	-\$10 to -\$20	3.8%	4.7%	5.2%	3.4%	5.4%	5.2%	5.4%	3.8%	4.8%	3.4%	6.6%	5.1%	4.7%
	< -\$20	5.0%	3.4%	4.4%	4.2%	5.1%	5.4%	8.1%	6.1%	4.9%	5.6%	3.3%	4.7%	5.0%
Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 90 Minutes Prior to Real-Time	> \$20	11.2%	5.6%	6.0%	13.7%	13.1%	6.8%	9.3%	4.7%	7.7%	10.4%	5.4%	9.9%	8.7%
	\$10 to \$20	8.1%	7.3%	9.9%	11.5%	15.0%	8.8%	7.7%	5.7%	6.8%	8.6%	8.4%	7.6%	8.8%
	\$5 to \$10	13.3%	15.6%	14.0%	17.0%	14.7%	11.4%	12.0%	9.9%	10.0%	11.1%	11.1%	12.1%	12.7%
	\$0 to \$5	31.7%	32.1%	31.9%	28.0%	23.9%	30.7%	29.1%	35.9%	31.7%	30.4%	32.0%	33.1%	30.9%
	\$0 to -\$5	22.6%	24.6%	23.2%	17.6%	16.4%	25.4%	24.4%	28.4%	29.2%	25.7%	26.6%	23.5%	24.0%
	-\$5 to -\$10	5.3%	6.8%	6.7%	5.5%	6.6%	8.1%	6.4%	6.6%	5.9%	5.8%	8.4%	6.2%	6.5%
	-\$10 to -\$20	3.3%	4.5%	4.6%	3.1%	5.2%	4.3%	4.4%	3.1%	4.2%	3.0%	5.1%	3.6%	4.0%
	< -\$20	4.5%	3.4%	3.7%	3.6%	5.1%	4.4%	6.6%	5.6%	4.6%	5.0%	3.0%	4.0%	4.5%
Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 135 Minutes Prior to Real-Time	> \$20	18.3%	14.1%	18.0%	26.1%	23.7%	10.7%	14.6%	10.0%	16.5%	18.8%	14.2%	15.2%	16.7%
	\$10 to \$20	9.4%	9.7%	11.8%	10.7%	15.6%	9.7%	7.4%	6.1%	7.7%	8.4%	8.9%	9.1%	9.6%
	\$5 to \$10	12.9%	13.6%	12.6%	14.7%	14.2%	11.0%	12.1%	11.8%	10.5%	11.6%	11.6%	12.8%	12.5%
	\$0 to \$5	29.1%	28.4%	27.5%	25.3%	20.5%	29.7%	28.8%	33.6%	29.7%	29.0%	28.3%	29.6%	28.3%
	\$0 to -\$5	19.4%	22.5%	19.5%	15.4%	14.1%	24.4%	22.2%	26.2%	24.7%	22.3%	23.8%	21.9%	21.3%
	-\$5 to -\$10	5.2%	5.9%	4.7%	3.5%	4.8%	7.0%	5.2%	5.2%	4.7%	4.5%	6.9%	5.7%	5.3%
	-\$10 to -\$20	2.3%	3.7%	3.5%	2.2%	3.9%	3.4%	3.7%	2.2%	2.9%	1.7%	4.3%	2.6%	3.0%
	< -\$20	3.5%	2.2%	2.4%	2.3%	3.1%	4.0%	6.0%	4.9%	3.3%	3.6%	2.2%	3.1%	3.4%

**Table 9-53 Monthly differences between forecast and actual PJM/MISO interface prices (average price difference): 2024**

Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 30 Minutes Prior to Real-Time	> \$20	\$56.74	\$34.18	\$37.33	\$47.66	\$39.94	\$37.47	\$39.50	\$64.23	\$41.02	\$46.63	\$38.20	\$52.80	\$45.25
	\$10 to \$20	\$14.02	\$13.73	\$14.25	\$13.55	\$14.41	\$13.93	\$14.26	\$14.16	\$14.10	\$14.30	\$14.40	\$14.26	\$14.11
	\$5 to \$10	\$7.04	\$7.31	\$7.28	\$7.30	\$7.41	\$7.29	\$7.21	\$7.08	\$7.08	\$7.42	\$7.11	\$7.11	\$7.23
	\$0 to \$5	\$2.23	\$2.37	\$2.22	\$2.42	\$2.33	\$2.05	\$2.10	\$1.86	\$1.93	\$2.08	\$2.18	\$2.14	\$2.16
	\$0 to -\$5	\$2.10	\$2.06	\$2.04	\$2.15	\$2.20	\$1.95	\$1.80	\$1.94	\$1.86	\$2.06	\$2.33	\$2.13	\$2.04
	-\$5 to -\$10	\$7.01	\$7.13	\$7.15	\$7.17	\$7.35	\$7.37	\$7.11	\$6.98	\$7.02	\$6.90	\$7.06	\$7.05	\$7.11
	-\$10 to -\$20	\$13.68	\$14.25	\$13.94	\$14.29	\$14.17	\$13.38	\$14.21	\$13.84	\$13.96	\$13.68	\$13.93	\$13.95	\$13.94
	< -\$20	\$70.84	\$48.35	\$55.08	\$43.94	\$52.56	\$88.27	\$71.03	\$73.88	\$60.89	\$74.48	\$42.12	\$51.67	\$62.81
Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 45 Minutes Prior to Real-Time	> \$20	\$53.94	\$46.17	\$40.89	\$51.06	\$46.28	\$37.61	\$39.66	\$69.40	\$51.51	\$63.26	\$44.97	\$52.98	\$49.74
	\$10 to \$20	\$13.84	\$13.64	\$13.84	\$13.59	\$14.13	\$13.91	\$13.86	\$13.77	\$13.87	\$14.39	\$13.99	\$14.25	\$13.93
	\$5 to \$10	\$6.95	\$7.19	\$7.17	\$7.18	\$7.23	\$7.10	\$7.20	\$7.05	\$7.09	\$7.27	\$7.13	\$7.13	\$7.15
	\$0 to \$5	\$2.12	\$2.19	\$2.11	\$2.46	\$2.38	\$1.88	\$1.90	\$1.83	\$1.77	\$2.09	\$2.19	\$2.14	\$2.08
	\$0 to -\$5	\$1.99	\$2.07	\$2.02	\$2.00	\$2.07	\$1.91	\$1.84	\$1.76	\$1.74	\$1.96	\$2.18	\$2.07	\$1.96
	-\$5 to -\$10	\$7.15	\$7.04	\$7.12	\$7.09	\$7.09	\$7.26	\$7.18	\$7.04	\$7.20	\$6.89	\$7.17	\$7.08	\$7.11
	-\$10 to -\$20	\$13.80	\$14.01	\$13.89	\$13.86	\$14.31	\$13.67	\$14.02	\$13.56	\$14.55	\$13.73	\$13.95	\$14.24	\$13.99
	< -\$20	\$70.94	\$47.36	\$55.21	\$41.66	\$53.31	\$82.02	\$68.35	\$74.23	\$64.86	\$78.16	\$47.45	\$51.66	\$63.36
Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 90 Minutes Prior to Real-Time	> \$20	\$46.67	\$46.12	\$39.90	\$50.84	\$46.17	\$38.99	\$44.00	\$52.69	\$57.62	\$64.08	\$40.53	\$43.45	\$48.20
	\$10 to \$20	\$13.85	\$13.57	\$13.93	\$13.79	\$13.85	\$13.84	\$13.98	\$13.59	\$13.69	\$13.84	\$14.12	\$14.11	\$13.86
	\$5 to \$10	\$7.00	\$7.11	\$7.28	\$7.24	\$7.23	\$7.25	\$7.25	\$7.03	\$7.18	\$7.26	\$7.23	\$7.16	\$7.19
	\$0 to \$5	\$2.12	\$2.18	\$2.10	\$2.34	\$2.28	\$1.85	\$1.87	\$1.76	\$1.81	\$2.06	\$2.08	\$2.10	\$2.04
	\$0 to -\$5	\$1.89	\$2.00	\$1.86	\$2.08	\$2.19	\$1.87	\$1.80	\$1.73	\$1.57	\$1.85	\$1.97	\$1.92	\$1.88
	-\$5 to -\$10	\$6.92	\$6.90	\$7.07	\$7.12	\$7.12	\$7.17	\$6.98	\$7.07	\$6.90	\$7.06	\$7.15	\$7.19	\$7.06
	-\$10 to -\$20	\$13.79	\$13.92	\$13.72	\$14.39	\$13.61	\$13.72	\$14.12	\$13.34	\$13.87	\$13.63	\$13.83	\$13.87	\$13.81
	< -\$20	\$72.10	\$46.59	\$59.42	\$46.18	\$53.42	\$88.87	\$74.43	\$74.21	\$60.32	\$77.18	\$48.26	\$54.16	\$64.85
Interval	Range of Price Differences	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	YTD Avg
~ 135 Minutes Prior to Real-Time	> \$20	\$73.26	\$98.66	\$96.93	\$91.68	\$88.54	\$53.45	\$52.87	\$57.96	\$77.69	\$149.31	\$115.09	\$60.86	\$87.55
	\$10 to \$20	\$13.86	\$13.76	\$14.11	\$14.07	\$14.37	\$13.50	\$13.95	\$13.83	\$13.85	\$14.09	\$14.22	\$14.03	\$14.00
	\$5 to \$10	\$7.17	\$7.30	\$7.30	\$7.19	\$7.32	\$7.25	\$7.32	\$7.10	\$7.27	\$7.09	\$7.23	\$7.18	\$7.23
	\$0 to \$5	\$2.08	\$2.11	\$2.04	\$2.40	\$2.28	\$1.84	\$1.79	\$1.84	\$1.76	\$2.10	\$1.98	\$1.99	\$2.00
	\$0 to -\$5	\$1.75	\$2.02	\$1.75	\$1.92	\$2.09	\$1.70	\$1.74	\$1.62	\$1.53	\$1.82	\$1.94	\$1.96	\$1.80
	-\$5 to -\$10	\$6.99	\$6.87	\$6.98	\$7.16	\$7.15	\$7.03	\$7.14	\$7.13	\$6.97	\$6.87	\$7.01	\$7.17	\$7.04
	-\$10 to -\$20	\$13.80	\$13.63	\$13.93	\$14.28	\$13.62	\$14.06	\$13.89	\$13.57	\$13.92	\$13.51	\$13.62	\$13.41	\$13.77
	< -\$20	\$73.88	\$52.49	\$69.81	\$50.97	\$61.35	\$88.96	\$75.21	\$76.35	\$57.56	\$80.08	\$51.06	\$54.82	\$68.89

CTS transactions were evaluated for each interval. From October 3, 2017, through December 31, 2024, 291,502 CTS schedules were approved through the CTS process based on the forecast LMPs. When the forecast LMPs for the approved intervals were compared to the hourly integrated real-time LMPs, the direction of the flow in 59,445 (20.4 percent) of the intervals was inconsistent with the differences in real-time PJM/MISO and MISO/PJM prices. For example, if a market participant submits a CTS transaction from MISO to PJM with a spread bid of \$5.00, and MISO's forecasted PJM interface price was at least \$5.00 lower than PJM's forecasted MISO interface price, the transaction would be approved. For 20.4 percent of the approved transactions, the actual, real-time price differentials were in the opposite direction of the forecast differential. The actual, real-time price differentials meant that the transactions would have been economic in the opposite direction. For 79.6 percent of the intervals, the forecast price differentials were consistent with real-time PJM/MISO and MISO/PJM price differences. Figure 9-12 shows the monthly volume of cleared PJM/MISO CTS bids. Figure 9-12 also shows the percent of cleared bids that resulted in flows consistent and inconsistent with price differences. In June 2022, MISO experienced software issues that prevented the submission and clearing of CTS transactions. The issue was resolved in August 2022. It is unclear why market participants did not resume scheduling CTS transactions at the MISO interface until February 2023. Market participants have not used the MISO CTS transaction option since June 2024. While the forecast LMPs have not proven to be a good predictor of real time LMPs, that has not changed. It is not clear why market participants stopped using the MISO CTS transaction option.

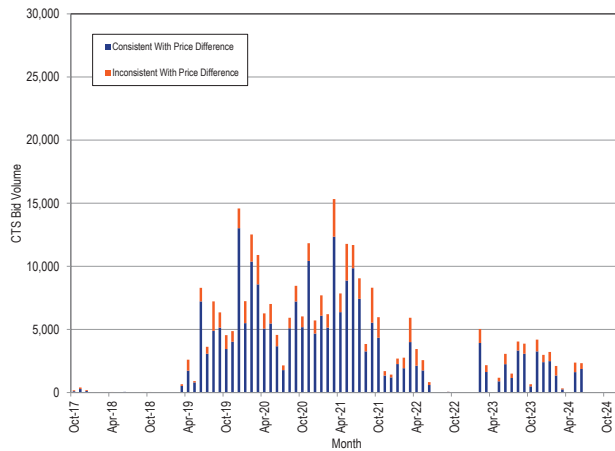**Figure 9–12 Monthly cleared PJM/MISO CTS bid volume: October 3, 2017 through December 31, 2024**



The data reviewed show that IT SCED is not a highly accurate predictor of the real-time PJM/MISO interface prices. This limits the effectiveness of CTS in improving interface pricing between PJM and MISO.

### Willing to Pay Congestion and Not Willing to Pay Congestion

When reserving nonfirm transmission, market participants have the option to choose whether or not they are willing to pay congestion. When the market participant elects to pay congestion, PJM operators redispatch the system if necessary to allow the energy transaction to continue to flow. The system redispatch often creates price separation across buses on the PJM system. The difference in LMPs between two buses in PJM is the congestion cost (and losses) that the market participant pays in order for their transaction to continue to flow.

The MMU recommended that PJM modify the not willing to pay congestion product to address the issues of uncollected congestion charges. The MMU recommended charging market participants for any congestion incurred while the transaction is loaded, regardless of their election of transmission service, and restricting the use of not willing to pay congestion transactions (as well as all other real-time external energy transactions) to transactions at interfaces.

On April 12, 2011, the PJM Market Implementation Committee (MIC) endorsed the changes recommended by the MMU. The elimination of internal sources and

sinks on transmission reservations addressed most of the MMU concerns, as there can no longer be uncollected congestion charges for imports to PJM or exports from PJM. There is still potential exposure to uncollected congestion charges in wheel through transactions, and the MMU will continue to evaluate if additional mitigation measures would be appropriate to address this exposure.

Table 9-54 shows that since the inception of the business rule change on April 12, 2013, there was uncollected congestion in only two months (January 2016 and February 2019). In both months, there was negative uncollected congestion. The negative congestion means that market participants who used the not willing to pay congestion transmission option for their wheel through transactions had transactions that flowed in the direction opposite to congestion. When market participants use the not willing to pay congestion product, it also means that they are not willing to receive congestion credits, which was the case in both January 2016 and February 2019.



**Table 9-54 Monthly uncollected congestion charges:  
January 2010 through December 2024**

Month	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
Jan	\$148,764	\$3,102	\$0	\$5	\$0	\$0	(\$44)	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
Feb	\$542,575	\$1,567	(\$15)	\$249	\$0	\$0	\$0	\$0	\$0	(\$69,992)	\$0	\$0	\$0	\$0	\$0
Mar	\$287,417	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
Apr	\$31,255	\$4,767	(\$68)	(\$3,114)	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
May	\$41,025	\$0	(\$27)	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
Jun	\$169,197	\$1,354	\$78	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
Jul	\$827,617	\$1,115	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
Aug	\$731,539	\$37	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
Sep	\$119,162	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
Oct	\$257,448	(\$31,443)	(\$6,870)	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
Nov	\$30,843	(\$795)	(\$4,678)	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
Dec	\$127,176	(\$659)	(\$209)	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0	\$0
Total	\$3,314,018	(\$20,955)	(\$11,789)	(\$2,860)	\$0	\$0	(\$44)	\$0	\$0	(\$69,992)	\$0	\$0	\$0	\$0	\$0

## Transmission Service Requests

Requests for transmission service are made on the PJM Open Access Same Time Information System (OASIS) on any of the posted paths. The products available on the OASIS include both firm and nonfirm service. Nonfirm service is available on an hourly, daily, weekly and monthly basis. Firm transmission service is defined as either short term or long term firm. Short term firm transmission is available on a daily, weekly or monthly basis, and long term firm is available for a period of one year or longer.

The total transfer capability (TTC) reflects the maximum amount of power that can be transferred over a transmission line or a group of transmission lines. In order to maintain reliability, transmission providers do not make the entire TTC available to be used. The available flowgate capability (AFC) is calculated for each path and product pair by taking the TTC and subtracting existing service requests, a capacity benefit margin<sup>65</sup>, a transmission reliability margin<sup>66</sup> and taking postbacks and counterflows into consideration. The amount of transmission service that can be reserved is the Available Transfer Capability (ATC). The ATC is calculated for each path and product, and is determined by taking the AFC and adjusting it for all other committed transmission service requests that impact that path.

PJM calculates and posts ATC for all valid posted paths product pairs. The range of calculated ATCs depends on

the duration of service. Hourly service is available up to seven days in advance, daily service is available 35 days in advance, weekly service is available five weeks in advance and monthly service is available 18 months in advance. Any transmission request that falls within the posted ATC period is evaluated based on the posted ATC. If there is sufficient capability, the transmission service request is accepted. If there is not sufficient capability, the transmission service request is denied.

Long term firm transmission service requests that extend beyond the ATC posting calculation are subject to system impact studies and must be submitted and evaluated in the new services queue. There is currently a backlog of projects in the new services queue. The backlog is being resolved through a transition to a new planning process, but new transmission service requests may not be evaluated or approved until 2027.<sup>67</sup>

## Spot Imports

Figure 9-13 shows the spot import service use for the NYISO Interface, and for all other interfaces, from January 1, 2013 through December 31, 2024. The yellow line shows the total monthly MWh of spot import service reserved and the orange line shows the total monthly MWh of tagged spot import service. The gray shaded area between the yellow and orange lines represents the MWh of retracted spot import service and may represent potential hoarding volumes. This ATC was initially reserved, but not tagged (used). It is possible that in some instances the reserved transmission consisted of the only available ATC which could have been used by another market participant had it not been reserved and


<sup>65</sup> The capacity benefit margin is defined by NERC as "the amount of firm transmission transfer capability preserved by the transmission provider for Load-Serving Entities (LSEs), whose loads are located on that Transmission Service Provider's system, to enable access by the LSEs to generation from interconnected systems to meet generation reliability requirements. Preservation of CBM for an LSE allows that entity to reduce its installed generating capacity below that which may otherwise have been necessary without interconnections to meet its generation reliability requirements. The transmission transfer capability preserved as CBM is intended to be used by the LSE only in times of emergency generation deficiencies."

<sup>66</sup> The transmission reliability margin is defined by NERC as "the amount of TTC necessary to provide reasonable assurance that the interconnected transmission network will be secure."

<sup>67</sup> See the 2024 Annual State of the Market Report for PJM, Volume II, Section 12, "Generation and Transmission Planning," for additional details.

not used. The blue shaded area between the orange line and green shaded area represents the MWh of curtailed transactions using spot import service. This area may also represent hoarding opportunities, particularly at the NYISO Interface. In this instance, it is possible that while the market participant reserved and scheduled the transmission, they may have submitted purposely uneconomic bids in the NYISO market so that their transaction would be curtailed, yet their transmission would not be retracted. The NYISO allows for market participants to modify their bids on an hourly basis, so these market participants can hold their transmission service and evaluate their bids hourly, while withholding the transmission from other market participants that may wish to use it. The green shaded area represents the total settled MWh of spot import service. Figure 9-13 shows that while there are proportionally fewer retracted MWh on the NYISO Interface than on all other interfaces, the NYISO has proportionally more curtailed MWh. This is a result of the NYISO market clearing process.<sup>68</sup>

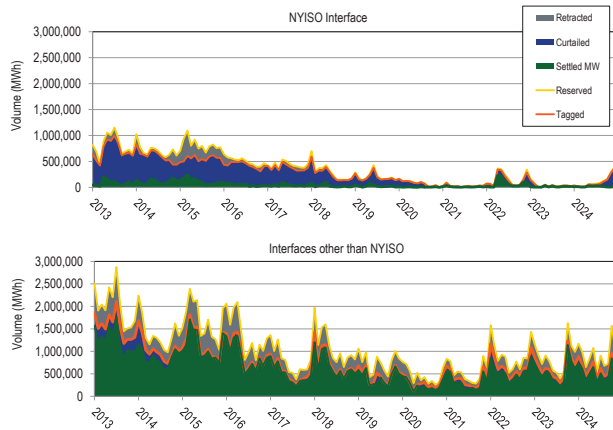**Figure 9-13 Spot import service use: 2013 through 2024**



The MMU continues to recommend that PJM permit unlimited spot market imports (as well as all nonfirm point to point willing to pay congestion imports and exports) at all PJM interfaces.

## Interchange Optimization

When PJM prices are higher than prices in surrounding balancing authorities, imports will flow into PJM until the prices are approximately equal. This is an appropriate market response to price differentials. Given the nature of interface pricing and the treatment of interface

<sup>68</sup> See the 2018 Annual State of the Market Report for PJM, Volume 2, Section 9, "Interchange Transactions," for a more complete discussion of the history of spot import transmission service.

transactions, it is not possible for PJM system operators to reliably predict the quantity or sustainability of such imports. The inability to predict interchange volumes creates additional challenges for PJM dispatch in trying to meet loads, especially on high load days. If all external transactions were submitted as real-time dispatchable transactions during emergency conditions, PJM would be able to include interchange transactions in its supply stack, and dispatch only enough interchange to meet the demand.

The MMU recommends that the submission deadline for real-time dispatchable transactions be modified from 1800 (EPT) on the prior day to three hours prior to the requested start time, and that the minimum duration be modified from one hour to 15 minutes.<sup>69</sup> These changes would give PJM a more flexible product that could be used to meet load based on economic dispatch rather than guessing the sensitivity of the transactions to price changes.

In addition to changing prices, transmission line loading relief procedures (TLRs), market participants' curtailments for economic reasons, and external balancing authority curtailments affect the duration of interchange transactions.

The MMU recommends that PJM explore an interchange optimization solution with its neighboring balancing authorities that would remove the need for market participants to schedule physical transactions across seams. Such a solution would include an optimized, but limited, joint dispatch approach that uses supply curves and treats seams between balancing authorities as constraints, similar to other constraints within an LMP market.

## Interchange Cap During Emergency Conditions

An interchange cap is a limit on the level of interchange permitted for nondispatchable energy using spot import or hourly point to point transmission. An interchange cap is a nonmarket intervention which should be a temporary solution and should be replaced with a market based solution as soon as possible. Since the approval of this process on October 30, 2014, PJM has not yet needed to implement an interchange cap.

<sup>69</sup> The minimum duration for a real-time dispatchable transaction was modified to 15 minutes as per FERC Order No. 764. See *Integration of Variable Energy Resources*, Order No. 764, 139 FERC ¶ 61,246, order on reh'g, Order No. 764-A, 141 FERC ¶ 61231 (2012).

The purpose of the interchange cap is to help ensure that actual interchange more closely meets operators' expectations of interchange levels when internal PJM resources, e.g. CTs or demand response, are dispatched to meet the peak load. Once these resources have been called on, PJM must honor their minimum operating constraints regardless of whether additional interchange then materializes. Therefore any interchange received in excess of what was expected can have a suppressive effect on energy and reserve pricing and result in increased uplift.

PJM will notify market participants of the possible use of the interchange cap the day before. The interchange cap will be implemented for the forecasted peak and surrounding hours during emergency conditions.

The interchange cap will limit the acceptance of spot import and hourly nonfirm point to point interchange (imports and exports) not submitted as real time with price transactions once net interchange has reached the interchange cap value. Spot imports and hourly nonfirm point to point transactions submitted prior to the implementation of the interchange cap will not be limited. In addition, schedules with firm or network designated transmission service will not be limited either, regardless of whether net interchange is at or above the cap.

The calculation of the interchange cap is based on the operator expectation of interchange at the time the cap is calculated plus an additional margin. The margin is set at 700 MW, which is half of the largest contingency on the system. The additional margin also allows interchange to adjust to the loss of a unit or deviation between actual load and forecasted load. The interchange cap is based on the maximum sustainable interchange from PJM reliability studies.

## 45 Minute Schedule Duration Rule

PJM limits the change in interchange volumes on 15 minute intervals. These changes are referred to as ramp. The PJM ramp limit is designed to limit the change in the amount of imports or exports in each 15 minute interval to account for the physical characteristics of the generation to respond to changes in the level of imports and exports. The purpose of imposing a ramp limit is to help ensure the reliable operation of the PJM system. The 1,000 MW ramp limit per 15 minute interval

was based on the availability of ramping capability by generators in the PJM system. The limit is based on the assumption that the available generation in the PJM system can only move 1,000 MW over any 15 minute period, although there is no supporting analysis. As an example of how the ramp limit works, if at 0800 (EPT) the sum of all external transactions were -3,000 MW (negative sign indicates net exporting), the limit for 0815 would be -2,000 MW to -4,000 MW. In other words, the starting or ending of transactions would be limited so that the overall change from the previous 15 minute period would not exceed 1,000 MW in either direction.

In 2008, there was an increase in 15 minute external energy transactions that caused swings in imports and exports submitted in response to intrahour LMP changes. This activity was due to market participants' ability to observe price differences between RTOs in the first third of the hour, and predict the direction of the price difference on an hourly integrated basis. Large quantities of MW would then be scheduled between the RTOs for the last 15 minute interval to capture those hourly integrated price differences with relatively little risk of prices changing. This increase in interchange on 15 minute intervals created operational control issues, and in some cases led to an increase in uplift charges due to calling on resources with minimum run times greater than 15 minutes needed to support the interchange transactions. As a result, a new business rule was proposed and approved that required all transactions to be at least 45 minutes in duration.

On June 22, 2012, FERC issued Order No. 764, which required transmission providers to give transmission customers the option to schedule transmission service at 15 minute intervals to reflect more accurate power production forecasts, load and system conditions.<sup>70</sup> On April 17, 2014, FERC issued its order which found that PJM's 45 minute duration rule was inconsistent with Order No. 764.<sup>71</sup>

PJM and the MMU issued a statement indicating ongoing concern about market participants' scheduling behavior, and a commitment to address any scheduling behavior that raises operational or market manipulation concerns.<sup>72</sup>

<sup>70</sup> *Id.* at P 51.

<sup>71</sup> See *Id.* at P 12.

<sup>72</sup> See joint statement of PJM and the MMU re Interchange Scheduling issued July 29, 2014 <[http://www.monitoringanalytics.com/reports/Market\\_Messages/Messages/PJM\\_IMM\\_Statement\\_on\\_Interchange\\_Scheduling\\_20140729.pdf](http://www.monitoringanalytics.com/reports/Market_Messages/Messages/PJM_IMM_Statement_on_Interchange_Scheduling_20140729.pdf)>.

## MISO Multi-Value Project Usage Rate (MUR)

MISO defines a multi-value project (MVP) to be a project which, according to MISO, enables the reliable and economic delivery of energy in support of public policy needs, provides multiple types of regional economic value or provides a combination of regional reliability and economic value. On July 15, 2010, MISO submitted revisions to the MISO Tariff to implement criteria for identifying and allocating the costs of MVPs.<sup>73</sup> On December 16, 2010, the Commission accepted the proposed MVP charge for export and wheel-through transactions, except for transactions that sink in PJM.<sup>74</sup> The Commission stated that MISO had not shown that their proposal did not constitute a resumption of rate pancaking along the MISO-PJM seam. Following the December 16, 2010, Order, MISO began applying a multi-value usage rate (MUR) to monthly net actual energy withdrawals, export schedules and through schedules with the exception of transactions sinking in PJM. The MUR charge was applied to the relevant transactions in addition to the applicable transmission, ancillary service and network upgrade charges.

On June 7, 2014, the U.S. Court of Appeals for the Seventh Circuit granted a petition for review regarding the Commission's determination in the MVP Order and MVP Rehearing Order.<sup>75</sup> The Court ordered the Commission to consider on remand whether, in light of current conditions, what if any limitations on export pricing to PJM by MISO are justified.<sup>76</sup> The Seventh Circuit highlighted the fact that at the time of the Commission's decision to prohibit rate pancaking on transactions between MISO and PJM, all of MISO's transmission projects were local and provided only local benefits.<sup>77</sup>

On July 13, 2016, FERC issued an order permitting MISO to collect charges associated with MVPs for all transactions sinking in PJM, effective immediately.<sup>78</sup> The July 13<sup>th</sup> Order noted that in light of "the development of large scale wind generation capable of serving both MISO's and its neighbors' energy policy requirements in the western areas of MISO; the reported need of PJM entities to access those resources; and the reported need

for MISO to build new transmission facilities to deliver the output of those resources within MISO for export... it is appropriate to allow MISO to assess the MVP usage charge for transmission service used to export to PJM just as MISO assesses the MVP usage charge for transmission service used to export energy to other regions."<sup>79</sup>

The policy rationale for permitting MISO to impose transmission costs on PJM market participants without clear criteria is weak and results in pancaking of rates. The impact is expected to increase.

Table 9-55 shows the projected usage rate to be collected for all wheels through and exports from MISO, including those that sink in PJM, for 2024 through 2042.<sup>80</sup> As shown in Table 9-4, there were 5,179.3 GWh of imports from MISO in 2024. At the 2024 MUR of \$1.54 per MWh, PJM market participants paid \$7.9 million towards the costs of MISO's multi value projects. It is not clear whether the MUR charge has affected interchange volumes from MISO into PJM.

**Table 9-55 MISO projected multi value project usage rate: 2024 through 2044**

Year	Total Indicative MVP Usage Rate (\$/MWh)
2024	\$1.54
2025	\$1.57
2026	\$1.55
2027	\$1.53
2028	\$1.50
2029	\$1.47
2030	\$1.45
2031	\$1.42
2032	\$1.40
2033	\$1.37
2034	\$1.35
2035	\$1.32
2036	\$1.30
2037	\$1.27
2038	\$1.25
2039	\$1.23
2040	\$1.20
2041	\$1.18
2042	\$1.16
2043	\$1.13
2044	\$1.11

<sup>73</sup> See Midwest Independent Transmission Operator Inc. filing, Docket No. ER10-1791-000 (July 15, 2010).

<sup>74</sup> 133 FERC ¶ 61,221; *order on reh'g*, 137 FERC ¶ 61,074 (2011).

<sup>75</sup> Illinois Commerce Commission, et al. v. FERC, 721 F.3d 764, 778–780 (7<sup>th</sup> Cir. 2013).

<sup>76</sup> *Id.* at 780.

<sup>77</sup> *Id.* at 779.

<sup>78</sup> 156 FERC ¶ 61,034 (2016).

<sup>79</sup> *Id.* at P 55.

<sup>80</sup> See MISO, "Schedule 26A Indicative Annual Charges," (June 12, 2024) <<https://cdn.misoenergy.org/Schedule%2026A%20Indicative%20Annual%20Charges106365.xlsx>>.





## Ancillary Service Markets

FERC defined six ancillary services in Order No. 888: scheduling, system control and dispatch; reactive supply and voltage control from generation service; regulation and frequency response service; energy imbalance service; operating reserve - spinning reserve service; and operating reserve - supplemental reserve service.<sup>1</sup> PJM provides scheduling, system control and dispatch as part of the PJM administrative function. PJM provides reactive on what is asserted to be a cost of service basis. PJM provides regulation, energy imbalance, synchronized reserve, and supplemental reserve services through market mechanisms.<sup>2</sup> The PJM ancillary service markets are regulation, synchronized reserve, primary reserve, and 30-minute reserve. Although not defined by FERC as an ancillary service, black start service plays a comparable role. Black start service is provided on the basis of formula rates and cost of service rates.

The MMU analyzed measures of market structure, conduct and performance for the PJM Synchronized Reserve Market for 2024.

**Table 10-1 The synchronized reserve market results were not competitive**

Market Element	Evaluation	Market Design
Market Structure: Regional Markets	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Not Competitive	Flawed

- The synchronized reserve market structure was evaluated as not competitive due to moderate levels of supplier concentration in the MAD Reserve Subzone.
- Participant behavior was evaluated as competitive because the market rules require all available reserves to offer at cost-based offers.
- Market performance was evaluated as not competitive because the interaction of participant behavior with the market design does not result in competitive prices as a result of PJM's changes to the ORDC. In an attempt to counter poor synchronized reserve performance, PJM unilaterally and inappropriately extended the first step of the operating reserve demand curve (ORDC) for synchronized reserve, known as the synchronized

reserve reliability requirement, in May 2023, raising prices for synchronized reserves and energy.

- Market design was evaluated as flawed based on PJM's modifications to the ORDC. PJM previously adopted reforms, including several based on MMU recommendations, removing both physical and economic withholding from the market.
- Significant communications technology issues when calling resources during synchronized reserve events have resulted in slow response from resources. On December 17, 2024, PJM implemented an electronic deployment of reserves via an augmented dispatch signal, but PJM does not require that resources be able to receive this signal.

The MMU analyzed measures of market structure, conduct and performance for the PJM Nonsynchronized Reserve Market for 2024.

**Table 10-2 The nonsynchronized reserve market results were competitive**

Market Element	Evaluation	Market Design
Market Structure: Regional Markets	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Effective

- The nonsynchronized reserve market structure was evaluated as not competitive due to moderate levels of supplier concentration for primary reserve in the MAD Reserve Subzone.
- Participant behavior was evaluated as competitive because all available reserves are included by the PJM markets software, so withholding is not possible.
- Market performance was evaluated as competitive because the interaction of participant behavior with the market design results in competitive prices.
- Market design was evaluated as effective.

The MMU analyzed measures of market structure, conduct and performance for the PJM Secondary Reserve Market for 2024.

**Table 10-3 The secondary reserve market results were competitive**

Market Element	Evaluation	Market Design
Market Structure	Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Effective

<sup>1</sup> 75 FERC ¶ 61,080 (1996). PJM renamed spinning reserve as synchronized reserve based on PJM's inclusion of demand side resources in the product.

<sup>2</sup> Energy imbalance service refers to the real-time energy market.

- The secondary reserve market structure was evaluated as competitive, because the supply of 30-minute reserves was not concentrated in the real-time market. The secondary reserve market was moderately concentrated in the day-ahead market.
- Participant behavior was evaluated as competitive because all available reserves are included by the PJM software, so withholding is not possible.
- Market performance was evaluated as competitive because the combination of a competitive market structure and competitive participation resulted in competitive market outcomes.
- The market design was evaluated as effective because the market rules ensure competitive market offers and require repayment of offline cleared secondary reserves that are not available when called on to provide energy in 30 minutes.

The MMU analyzed measures of market structure, conduct and performance for the PJM Regulation Market for 2024.

**Table 10–4 The regulation market results were not competitive**

Market Element	Evaluation	Market Design
Market Structure	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Not Competitive	Flawed

- The regulation market structure was evaluated as not competitive because the PJM Regulation Market failed the three pivotal supplier (TPS) test in 94.7 percent of the hours in 2024.
- Participant behavior in the PJM Regulation Market was evaluated as competitive in 2024 because market power mitigation requires competitive offers when the three pivotal supplier test is failed, although the inclusion of a positive margin is not consistent with competitive offers.
- Market performance was evaluated as not competitive, because all units are not paid the same price on an equivalent MW basis.
- Market design was evaluated as flawed. The market design has failed to correctly incorporate a consistent implementation of the marginal benefit factor in optimization, pricing and settlement. The market results continue to include the incorrect definition of opportunity cost. The result is significantly flawed market signals to existing and prospective suppliers of regulation.

## Overview

### Primary Reserve

Primary reserves consist of both synchronized and nonsynchronized reserves that can provide energy within 10 minutes and sustain that output for at least 30 minutes during a contingency event. PJM made several changes to the primary reserve market, effective October 1, 2022. These included a must offer requirement and correction of misspecified cost-based offers. By removing opportunities for physical and economic withholding, the changes resulted in clearing increased quantities of available synchronized reserves at competitive prices. Starting in May 2023, to compensate for poor resource performance, PJM increased the synchronized reserve reliability requirement, which in turn increased the primary reserve reliability requirement.

### Market Structure

- **Supply.** Primary reserve is provided by both synchronized reserve (generation or demand response currently synchronized to the grid and available within 10 minutes) and nonsynchronized reserve (generation currently offline but available to start and provide energy within 10 minutes).
- **Demand.** The primary reserve reliability requirement is equal to 150 percent of the synchronized reserve reliability requirement. The primary reserve requirement is equal to the primary reserve reliability requirement, with a shortage penalty price of \$850 per MWh, plus the extended reserve requirement (190 MW), with a shortage penalty price of \$300 per MWh. The synchronized reserve requirement is equal to the synchronized reserve reliability requirement plus the extended reserve requirement, with a default level of 190 MW. The synchronized reserve reliability requirement is normally equal to the most severe single contingency (MSSC). Starting in May 2023, PJM increased the size of the synchronized reserve reliability requirement in the RTO Reserve Zone by 30 percentage points to 130 percent of the most severe single contingency (MSSC), in effect increasing the primary reserve reliability requirement to 195 percent of the MSSC. In 2024, the real-time average primary reserve requirement was 3,422.8 MW in the RTO Reserve Zone and 2,565.1 MW in the Mid-Atlantic Dominion Reserve Subzone.

- **Market Concentration.** Both the Mid-Atlantic Dominion (MAD) Reserve Subzone Market and the RTO Reserve Zone Market for primary reserve were characterized by structural market power in 2024. The average HHI for real-time primary reserve in the RTO Reserve Zone was 922, which is classified as unconcentrated. The average HHI for day-ahead primary reserve in the RTO Zone was 971, which is classified as unconcentrated. The average HHI for real-time primary reserve in the MAD Reserve Subzone was 1628, which is classified as moderately concentrated. The average HHI for day-ahead primary reserve in the MAD Reserve Subzone was 1563, which is classified as moderately concentrated.

## Synchronized Reserve Market

Synchronized reserves include all capacity synchronized to the grid and available to satisfy PJM's power balance requirements within 10 minutes. This includes online resources loaded below their full output, storage or condensing resources synchronized to the grid but consuming energy, and 10-minute demand response capability. As of October 1, 2022, all generation capacity resources must offer their full synchronized reserve capability to the PJM market at all times. PJM jointly optimizes energy, synchronized reserve, primary reserve, and 30-minute reserve needs in both the day-ahead and real-time markets. Synchronized reserve prices are based on opportunity costs calculated by PJM in the market optimization and the anticipated cost of a performance penalty. All real-time cleared synchronized reserves are obligated to perform when PJM initiates a synchronized reserve event based on a loss of supply.

## Market Structure

- **Supply.** In 2024, the real-time average supply of available synchronized reserve was 5,583.7 MW in the RTO Zone, of which 2,733.6 MW on average was located in the Mid-Atlantic Dominion Reserve Subzone.
- **Demand.** The synchronized reserve requirement is equal to the synchronized reserve reliability requirement, with a shortage penalty price of \$850 per MWh, plus the extended reserve requirement, with a shortage penalty price of \$300 per MWh and a default value of 190 MW. The synchronized reserve reliability requirement is normally equal to the most

severe single contingency (MSSC). Since May 19, 2023, PJM has inappropriately set the synchronized reserve reliability requirement to 130 percent of the MSSC for the RTO Reserve Zone. The real-time average synchronized reserve requirement in 2024 was 2,346.1 MW in the RTO Reserve Zone and 1,773.4 MW in the Mid-Atlantic Dominion Reserve Subzone. The day-ahead average synchronized reserve requirement in 2024 was 2,400.7 MW in the RTO Reserve Zone and 1,773.3 MW in the Mid-Atlantic Dominion Reserve Subzone.

- **Market Concentration.** The Mid-Atlantic Dominion (MAD) Reserve Subzone Market for synchronized reserve was characterized by structural market power in 2024. The average HHI for real-time synchronized reserve in the RTO Reserve Zone was 820, which is classified as unconcentrated. The average HHI for day-ahead synchronized reserve in the RTO Zone was 893, which is classified as unconcentrated. The average HHI for real-time synchronized reserve in the MAD Reserve Subzone was 1735, which is classified as moderately concentrated. The average HHI for day-ahead synchronized reserve in the MAD Reserve Subzone was 1589, which is classified as moderately concentrated.

## Market Conduct

- **Offers.** There is a must offer requirement for synchronized reserve. All nonemergency generation capacity resources are required to offer their full synchronized reserve capability. PJM calculates the available synchronized reserve for all conventional resources based on the energy offer ramp rate, energy dispatch point, and the lesser of the synchronized reserve maximum or economic maximum output. Hydro resources, energy storage resources, and demand response resources submit their available synchronized reserve MW. Wind, solar, and nuclear resources are by default considered incapable of providing synchronized reserve, but may offer with an exception approved by PJM. Synchronized reserve offers are capped at cost plus the expected value of performance penalties. PJM calculates opportunity costs based on LMP.

Significant communications technology issues when calling resources during spinning events result in slow response.

## Market Performance

- **Price.** In 2024, for the Mid-Atlantic Dominion Reserve Subzone, the weighted average real-time price for synchronized reserve was \$3.20 per MWh and the weighted average day-ahead price was \$2.80 per MWh. In 2024, for the RTO Reserve Zone, the weighted average real-time price for synchronized reserve was \$3.41 per MWh and the weighted average day-ahead price was \$3.04 per MWh.

## Nonsynchronized Reserve

Nonsynchronized reserve is comprised of nonemergency energy resources not currently synchronized to the grid that can provide energy within 10 minutes. Nonsynchronized reserve is available to meet the portions of the primary reserve requirement and the 30-minute reserve requirement not already satisfied by reserve cleared for the synchronized reserve requirement.

## Market Structure

- **Supply.** In 2024, the average supply of eligible and available nonsynchronized reserve was 946.5 MW in the RTO Reserve Zone, of which 664.6 MW on average was available in the Mid-Atlantic Dominion Reserve Subzone.
- **Demand.** Demand for nonsynchronized reserve is the primary reserve requirement less the amount of synchronized reserves cleared by PJM.<sup>3</sup> Although nonsynchronized reserve can be used to meet the 30-minute reserve requirement, any 30-minute reserve beyond the primary reserve requirement is usually provided by secondary reserves due to its lower cost and greater availability.

## Market Conduct

- **Offers.** Generation owners do not submit supply offers for nonsynchronized reserve from non-hydroelectric units. Nonemergency generation resources that are available to provide energy and can start in 10 minutes or less are defined to be available for nonsynchronized reserves. For non-hydroelectric units, PJM calculates the MW available from a unit based on the unit's energy offer. Hydroelectric units set their own offered reserve amount. For all units, the offer price of

nonsynchronized reserve is \$0 per MWh.<sup>4</sup> Hybrid units and energy storage resources are not eligible to provide nonsynchronized reserves.

## Market Performance

- **Price.** The nonsynchronized reserve price is determined by the marginal primary reserve resource. In 2024, the nonsynchronized reserve weighted average real-time price for all intervals in the RTO Reserve Zone was \$1.54 per MWh and the weighted average day-ahead price was \$1.32 per MWh. In 2024, the nonsynchronized reserve weighted average real-time price for all intervals in the MAD Reserve Subzone was \$1.78 per MWh and the weighted average day-ahead price was \$1.50 per MWh.

## 30-Minute Reserve Market

The supply of 30-minute reserves consists of resources, online or offline, which can respond within 30 minutes. This includes primary reserves and secondary reserves.

## Market Structure

- **Supply.** The supply of 30-minute reserve is provided by both primary reserve (synchronized and nonsynchronized resources that can provide energy within 10 minutes) and secondary reserve (synchronized and nonsynchronized resources that can provide energy within 30 minutes but that take more than 10 minutes). In 2024, the real-time average supply of available 30-minute reserve was 27,901.4 MW in the RTO Zone.
- **Demand.** The 30-minute reserve requirement is equal to the 30-minute reserve reliability requirement, with a shortage penalty price of \$850 per MWh, plus the extended reserve requirement (190 MW), with a shortage penalty price of \$300 per MWh. The 30-minute reserve reliability requirement is equal to the maximum of: the primary reserve reliability requirement; the largest active gas contingency; and 3,000 MW. Since PJM increased the synchronized reserve reliability requirement, the 30-minute reserve reliability requirement is frequently equal to the primary reserve reliability requirement. In 2024, the average 30-minute reserve requirement was

<sup>3</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.1 Overview of the PJM Reserve Markets, Rev. 133 (Dec. 17, 2024).

<sup>4</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.2.3 Reserve Market Resource Offer Structure, Rev. 133 (Dec. 17, 2024).



3,532.5 MW in the real-time market and 3,582.5 MW in the day-ahead market.

- **Market Concentration.** The RTO Reserve Zone Market for 30-minute reserves was characterized by moderate structural market power in 2024. For 2024, the average HHI for real-time 30-minute reserves was 909, which is classified as unconcentrated. For 2024, the average HHI for day-ahead 30-minute reserves was 1020, which is classified as moderately concentrated.

## Secondary Reserve

Secondary reserves are reserves that take more than 10 minutes to convert to energy, but less than 30 minutes. This includes the unloaded capacity of online generation that can be achieved according to the resource ramp rates in 10 to 30 minutes, and offline resources with a start time of less than 30 minutes. Secondary reserves can only be used to satisfy the 30-minute reserve requirement.

## Market Structure

- **Supply.** In 2024, the real-time average supply of available secondary reserve was 21,371.2 MW in the RTO Reserve Zone. As with the 30-minute reserve service, there is no defined reserve subzone for secondary reserves.
- **Demand.** Demand for secondary reserve is the 30-minute reserve requirement less the amount of primary reserves cleared by PJM.<sup>5</sup>

## Market Conduct

- **Offers.** Energy storage resources, hydroelectric resources, hybrid resources, and demand-side response resources submit their available secondary reserve MW. For all other resource types, PJM calculates the MW available from a resource based on the resource's energy offer. For all resources, the offer price of secondary reserve is \$0 per MWh.<sup>6</sup> In both the day-ahead and real-time secondary reserves markets, PJM uses lost opportunity costs as the offers and not offers submitted by market participants. For online secondary reserves, PJM calculates an opportunity cost based on LMP.

## Market Performance

- **Price.** The secondary reserve price is determined by the marginal 30-minute reserve resource. In 2024, the secondary reserve real-time price for all intervals was \$0.00 per MWh.

## Regulation Market

The PJM Regulation Market is a real-time market. Regulation is provided by generation resources and demand response resources that qualify to follow one of two regulation signals, RegA or RegD. PJM jointly optimizes regulation with synchronized reserve and energy to provide all three products at least cost. The PJM regulation market design includes three clearing price components: capability; performance; and opportunity cost. The RegA signal is designed for energy unlimited resources with physically constrained ramp rates. The RegD signal is designed for energy limited resources with fast ramp rates. In the regulation market RegD MW are converted to effective MW using a marginal rate of technical substitution (MRTS), called a marginal benefit factor (MBF). Correctly implemented, the MBF would be the marginal rate of technical substitution (MRTS) between RegA and RegD, holding the level of regulation service constant. The current market design is critically flawed as it has not properly implemented the MBF as an MRTS between RegA and RegD resource MW and the MBF has not been consistently applied in the optimization, clearing and settlement of the regulation market.

PJM filed significant changes to the regulation market design on April 16, 2024 that were accepted as filed by order of June 17, 2024.<sup>7</sup> PJM will implement the changes to the regulation market in two phases. Phase 1, scheduled to be implemented on October 1, 2025, will result in a single product, single signal market with one clearing price. Phase 2, to be implemented on October 1, 2026, will result in separate regulation up and regulation down markets. The proposed Phase 1 changes will eliminate many of the significant issues identified by the MMU that have resulted from a two product, two signal market design including the incorrect and inconsistent use and application of the MBF/MRTS.

This report analyzes the current regulation market design and results during 2024.

<sup>5</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.1 Overview of the PJM Reserve Markets, Rev. 133 (Dec. 17, 2024).

<sup>6</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.2.3 Reserve Market Resource Offer Structure, Rev. 133 (Dec. 17, 2024).

<sup>7</sup> PJM, "Regulation Market Design Filing," Docket No. ER24-1772-000 (April 16, 2024).



## Market Structure

- **Supply.** In 2024, the average hourly offered supply of regulation for nonramp hours was 723.3 performance adjusted MW (732.6 effective MW). This was a decrease of 29.6 performance adjusted MW (a decrease of 26.6 effective MW) from 2023. In 2024, the average hourly offered supply of regulation for ramp hours was 1,007.7 performance adjusted MW (1,059.7 effective MW). This was an increase of 3.1 performance adjusted MW (an increase of 14.7 effective MW) from 2023, when the average hourly offered supply of regulation was 1,004.6 performance adjusted MW (1,045.0 effective MW).
- **Demand.** The hourly regulation demand is 525.0 effective MW for nonramp hours and 800.0 effective MW for ramp hours.
- **Supply and Demand.** The nonramp regulation requirement of 525.0 effective MW was provided by a combination of cleared RegA and RegD resources equal to 477.6 hourly average performance adjusted actual MW in 2024. This is an increase of 0.8 performance adjusted actual MW from 2023, when the average hourly total regulation cleared performance adjusted actual MW for nonramp hours were 478.3 performance adjusted actual MW. The ramp regulation requirement of 800.0 effective MW was provided by a combination of cleared RegA and RegD resources equal to 696.0 hourly average performance adjusted actual MW in 2024. This is a decrease of 10.3 performance adjusted actual MW from 2023, where the average hourly regulation cleared MW for ramp hours were 706.3 performance adjusted actual MW.

The ratio of the average hourly offered supply of regulation to average hourly regulation demand (performance adjusted cleared MW) for nonramp hours was 1.51 in 2024 (1.45 in 2023). The ratio of the average hourly offered supply of regulation to average hourly regulation demand (performance adjusted cleared MW) for ramp hours was 1.45 in 2024 (1.42 in 2023).

- **Market Concentration.** In 2024, the three pivotal supplier test was failed in 94.7 percent of hours. In 2024, the effective MW weighted average HHI of RegA resources was 2517 which is highly concentrated and the effective MW weighted

average HHI of RegD resources was 1594 which is moderately concentrated. The effective MW weighted average HHI of all resources was 1301, which is moderately concentrated.

## Market Conduct

- **Offers.** Daily regulation offer prices are submitted for each unit by the unit owner. Owners are required to submit a cost-based offer and may submit a price-based offer. Offers include both a capability offer and a performance offer. Owners must specify which signal type the unit will be following, RegA or RegD.<sup>8</sup> In 2024, there were 189 resources following the RegA signal and 58 resources following the RegD signal.

## Market Performance

- **Price and Cost.** The weighted average clearing price for regulation was \$31.86 per MW of regulation in 2024, an increase of \$9.17 per MW, or 40.4 percent, from the weighted average clearing price of \$22.69 per MW in 2023. The weighted average cost of regulation in 2024 was \$40.08 per MW of regulation, an increase of 36.7 percent, from the weighted average cost of \$29.32 per MW in 2023.
- **Prices.** RegD resources continue to be incorrectly compensated relative to RegA resources due to an inconsistent application of the marginal benefit factor in the optimization, assignment and settlement processes. If the regulation market were functioning efficiently and competitively, RegD and RegA resources would be paid the same price per effective MW.
- **Marginal Benefit Factor.** The marginal benefit factor (MBF) is intended to measure the operational substitutability of RegD resources for RegA resources. The marginal benefit factor is incorrectly defined and applied in the PJM market clearing. The current incorrect and inconsistent implementation of the MBF has resulted in the PJM Regulation Market over procuring RegD relative to RegA in most hours and in an inefficient market signal about the value of RegD in every hour.

<sup>8</sup> See the 2024 Annual State of the Market Report for PJM, Appendix F "Ancillary Services Markets."

## Black Start Service

Black start service is required for the reliable restoration of the grid following a blackout. Black start service is the ability of a generating unit to start without an outside electrical supply, or is the demonstrated ability of a generating unit to automatically remain operating at reduced levels when disconnected from the grid (automatic load rejection or ALR).<sup>9</sup>

In 2024, total black start charges were \$73.8 million, including \$73.5 million in revenue requirement charges and \$0.33 million in uplift charges. Black start revenue requirements consist of fixed black start service costs, variable black start service costs, training costs, fuel storage costs, and an incentive payment. Black start uplift charges are paid to units scheduled in the day-ahead energy market or committed in real time to provide black start service under the ALR option or for black start testing. Black start zonal charges in 2024 ranged from \$0 in the OVEC and REC Zones to \$18.0 million in the AEP Zone.

CRF values are a key determinant of total payments to black start units. The CRF values in PJM tariff tables should have been changed for both black start and the capacity market when the tax laws changed effective January 1, 2018. As a result of the failure to reduce the CRF values, black start units have been and continue to be significantly overcompensated since the changes to the tax code. In March 2023, FERC issued an order establishing hearing and settlement judge procedures.<sup>10</sup> Hearing procedures have been terminated while the Commission's consideration of settlement options is pending.

## Reactive

Reactive service, reactive supply and voltage control are provided by generation and other sources of reactive power (measured in MVar). Reactive power helps maintain appropriate voltage levels on the transmission system and is essential to the flow of real power (measured in MW). The same equipment provides both MVar and MW. Generation resources are required to meet defined reactive capability requirements as a condition to receive interconnection service in PJM.<sup>11</sup> RTOs and their customers are not required to separately compensate generation resources for such reactive

capability.<sup>12</sup> In 2024, PJM customers paid \$379.2 million for reactive capability based on archaic, nonmarket and unsupported assertions about cost allocation and a regulatory review process of filings by individual units that results in unsupported black box settlements. The current rules have permitted over recovery of reactive costs through reactive capability charges. All costs of generators should be incorporated in the market.

The nonmarket approach to reactive capability payments will be eliminated based on FERC's Order No. 904.<sup>13</sup>

Reactive service charges based on opportunity costs are appropriately paid to units that operate in real time outside of their normal range at the direction of PJM for the purpose of providing real-time reactive power.

Total reactive charges decreased 2.16 percent from \$389.1 million in 2023 to \$380.7 million in 2024. Reactive capability charges decreased 2.39 percent from \$388.5 million in 2023 to \$379.2 million in 2024. Total zonal reactive service charges ranged from \$0 in the REC and OVEC Zones, to \$60.2 million in the AEP Zone in 2024.

## Frequency Response

The PJM Tariff requires that all new generator interconnection customers, both synchronous and nonsynchronous, have hardware and/or software that provides primary frequency responsive real power control with the ability to sense changes in system frequency and autonomously adjust real power output to correct for frequency deviations.<sup>14</sup> Primary frequency response begins within a few seconds and extends up to a minute. The purpose of primary frequency response is to arrest and stabilize the system until other measures (secondary and tertiary frequency response) become active. This includes a governor or equivalent controls capable of operating with a maximum five percent droop and a +/- 36 mHz deadband.<sup>15</sup> In addition to resource capability, resource owners must comply by setting control systems

12 See 182 FERC ¶ 61,033 at P 52 (January 27, 2023); see also *Standardization of Generator Interconnection Agreements & Procedures*, Order No. 2003, 104 FERC ¶ 61,103 at P 546 (2003), order on reh'g, Order No. 2003-A, 106 FERC ¶ 61,220 at P 28, order on reh'g, Order No. 2003-B, 109 FERC ¶ 61,287 (2004), order on reh'g, Order No. 2003-C, 111 FERC ¶ 61,401 (2005), *aff'd sub nom. National Association of Regulatory Utility Commissioners v. FERC*, 475 F.3d 1277 (D.C. Cir. 2007); *California ISO*, 160 FERC ¶ 61,035 at P 19 (2017); 119 FERC ¶ 61,199 at P 28 (2007), order on reh'g, 121 FERC ¶ 61,196 (2007); see also 178 FERC ¶ 61,088, at PP 29–31 (2022); 179 FERC ¶ 61,103, at PP 20–21 (2022).

13 *Compensation for Reactive Power within the Standard Power Factor Range*, Order No. 904, 189 FERC ¶ 61,034 (2024); PJM compliance filing, Docket No. ER24-1073 (January 28, 2025).

14 Nuclear Regulatory Commission (NRC) regulated facilities are exempt from this provision. Behind the meter generation that is sized to load is also exempt.

15 OATT Attachment O § 4.7.2 (Primary Frequency Response).

9 OATT Schedule 1 § 1.3BB. There are no ALR units currently providing black start service.

10 182 FERC ¶ 61,194 (2023).

11 OATT Attachment O.

to autonomously adjust real power output in a direction to correct for frequency deviations.

The response of generators within PJM to NERC identified frequency events remains under evaluation. A frequency event is declared whenever the system frequency goes outside of 60 Hz by +/- 40 mHz and stays there for 60 continuous seconds. The NERC BAL-003-2 requirement for balancing authorities (PJM is a balancing authority) uses a threshold value ( $L_{10}$ ) equal to -259.3 MW/0.1 Hz and has selected 12 frequency events between December 1, 2020, and November 30, 2021, to evaluate.

As a balancing authority, PJM requires all generators to be capable of providing primary frequency response and to operate with primary frequency response controls enabled.<sup>16</sup> PJM does monitor primary frequency response during NERC identified frequency events for all resources 50 MW or greater. Exclusions to PJM monitoring include nuclear plants, offline units, units with no available headroom, units assigned to regulation, and units with a current outage ticket in eDART.

## Market Procurement of Real-Time Ancillary Services

PJM uses market mechanisms to varying degrees in the procurement of ancillary services, including primary reserves, secondary reserves, and regulation. Ideally, all ancillary services would be procured taking full account of the interactions with the energy market. When a resource is used for an ancillary service instead of providing energy in real time, the cost of removing the resource, either fully or partially, from the energy market should be included in the offer for the ancillary service. The degree to which PJM markets account for these interactions depends on the timing of the product clearing, software limitations, and the accuracy of unit parameters and offers.

The synchronized reserve market clearing is more integrated with the energy market clearing than the other ancillary services. Synchronized reserves are jointly cleared with energy in every real-time market solution. Given the joint clearing of energy and flexible synchronized reserves, the synchronized reserve market clearing price should always cover the opportunity cost of providing flexible synchronized reserves. Inflexible

synchronized reserves, provided by resources that require hourly commitments due to run-time or staffing constraints, are not cleared with energy in the real-time market solution.<sup>17</sup> Instead, inflexible synchronized reserves are cleared hourly by the Ancillary Service Optimizer (ASO) or the day-ahead energy market. The ASO considers energy market price forecasts, availability of resources for flexible synchronized reserves, and regulation requirements to estimate the costs and benefits of using a resource for inflexible synchronized reserves. The ASO selected inflexible reserves are a fixed input to RT SCED, which clears the balance of the requirement with flexible synchronized reserves.

Nonsynchronized reserves and offline secondary reserves are cleared with every real-time energy market solution. The energy commitment decisions to keep the resources offline have already been made when the RT SCED clears the five-minute reserves markets. Therefore, offline reserves have no lost opportunity cost. They will not be called on for energy during the market interval for which they are assigned as offline resources.

Prices for the regulation and reserve markets are set by the pricing calculator (LPC), which uses the RT SCED solution as an input. The LPC includes fast start pricing logic and system marginal price caps, so the final prices can be inconsistent with the marginal cost of the resources that clear regulation and reserves.

## Recommendations

### Reserve Markets

- The MMU recommends that to minimize lag and improve performance, PJM use an electronic synchronized reserve event notification process for all resources and that all resources be required to have the ability to receive and respond to the notifications. (Priority: Medium. First reported 2023. Status: Partially adopted December 17, 2024.)
- The MMU recommends that PJM replace the Mid-Atlantic Dominion Reserve Subzone with a reserve zone structure consistent with the actual deliverability of reserves based on current transmission constraints. (Priority: High. First reported 2019. Status: Partially adopted October 1, 2022.)

<sup>16</sup> *Id.*; see also "PJM Manual 12: Balancing Operations," § 3.6 Primary Frequency Response, Rev. 54 (Dec. 17, 2024).

<sup>17</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.4.3 Reserve Market Clearing, Rev. 133 (Dec. 17, 2024).

- The MMU recommends that the components of the cost-based offers for providing regulation and synchronous condensing be defined in Schedule 2 of the Operating Agreement. (Priority: Low. First reported 2019. Status: Not adopted.)
- The MMU recommends that, for calculating the penalty for a synchronized reserve resource failing to meet its scheduled obligation during a spinning event, the unit repay all credits back to the last time that the unit successfully responded to an event 10 minutes or longer. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that, for calculating the penalty for a synchronized reserve resource failing to meet its scheduled obligation during a spinning event, the synchronized reserve shortfall penalty should include LOC payments as well as SRMCP and MW of shortfall. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that aggregation not be permitted to offset unit specific penalties for failure to respond to a synchronized reserve event. (Priority: Medium. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM remove the 30 percent increase to the synchronized reserve reliability requirement. (Priority: High. New recommendation. Status: Not adopted.)

## Regulation Market

- The MMU recommends that the two signal regulation market design be replaced with a one signal regulation market design. (Priority: Medium. First reported 2023. Status: Not adopted.)<sup>18</sup>
- The MMU recommends that the ability to make dual offers (to make offers as both a RegA and a RegD resource in the same market hour) be removed from the regulation market. (Priority: High. First reported 2019. Status: Not adopted.)<sup>19</sup>
- The MMU recommends that the regulation market be modified to incorporate a consistent application of the marginal benefit factor (MBF) throughout the

optimization, assignment and settlement process. The MBF should be defined as the Marginal Rate of Technical Substitution (MRTS) between RegA and RegD. (Priority: High. First reported 2012. Status: Not adopted. FERC rejected.)<sup>20</sup><sup>21</sup>

- The MMU recommends that the current calculation of the performance score (based on precision, delay and correlation metrics) be replaced with the current calculation of the precision score. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends that the regulation market commitment period be reduced from a 60-minute commitment to a 30-minute commitment. (Priority: Medium. First reported 2023. Status: Not adopted.)<sup>22</sup>
- The MMU recommends that the lost opportunity cost in the ancillary services markets be calculated using the schedule on which the unit was scheduled to run in the energy market. (Priority: High. First reported 2010. Status: Not adopted. FERC rejected.)<sup>23</sup>
- The MMU recommends that the lost opportunity cost calculation used in the regulation market be based on the resource's dispatched energy offer schedule, not the lower of its price or cost offer schedule. (Priority: Medium. First reported 2010. Status: Not adopted. FERC rejected.)<sup>25</sup> <sup>26</sup>
- The MMU recommends that the \$12.00 margin adder be eliminated from the definition of the cost based regulation offer because it is a markup and not a cost. (Priority: Medium. First reported 2021. Status: Not adopted.)
- The MMU recommends that the ramp rate limited desired MW output be used in the regulation uplift calculation, to reflect the physical limits of the unit's ability to ramp and to eliminate overpayment for opportunity costs when the payment uses an unachievable MW. (Priority: Medium. First reported 2022. Status: Not adopted.)<sup>27</sup>
- The MMU recommends enhanced documentation of the implementation of the regulation market design.

<sup>18</sup> PJM filed proposed changes to the regulation market with the FERC on April 16, 2024 (Regulation Market Design Filing," Docket No. ER24-1772-000). The Commission Order on June 17, 2024 accepted the PJM Proposal as filed. PJM will implement the changes to the regulation market in two phases. Phase 1, scheduled to be implemented on October 1, 2025, will result in a single signal, bidirectional market with one clearing price that eliminates the need for an MBF. Phase 1 will eliminate RegA and RegD dual offers. Phase 1 will reduce the regulation commitment period from a 60-minute commitment to a 30-minute commitment. In Phase 1 the lost opportunity cost calculation used in the regulation market will be based on the resource's dispatched energy offer schedule, not the lower of its price or cost offer schedule.

<sup>19</sup> Id.

<sup>20</sup> 162 FERC ¶ 61,295 (2018), *reh'g denied*, 170 FERC ¶ 61,259 (2020).

<sup>21</sup> Id.

<sup>22</sup> Id.

<sup>23</sup> This recommendation was adopted by PJM for the energy market. Lost opportunity costs in the energy market are calculated using the schedule on which the unit was scheduled to run. In the regulation market, this recommendation has not been adopted, as the LOC continues to be calculated based on the lower of price or cost in the energy market offer.

<sup>24</sup> 162 FERC ¶ 61,295 (2018), *reh'g denied*, 170 FERC ¶ 61,259 (2020).

<sup>25</sup> Id.

<sup>26</sup> Id.

<sup>27</sup> In Phase 1 the ramp rate limited desired MW output will be used in the regulation uplift calculation. The MMU does not agree with how this change will be implemented and will be reviewing the market results in Phase 1.



(Priority: Medium. First reported 2010. Status: Not adopted. FERC rejected.)<sup>28</sup>

- The MMU recommends that PJM be required to save data elements necessary for verifying the performance of the regulation market. (Priority: Medium. First reported 2010. Status: Not adopted.)
- The MMU recommends that all data necessary to perform the regulation market three pivotal supplier test be saved by PJM so that the test can be replicated. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends that all data necessary to perform the generator primary frequency response evaluation be saved by PJM so that the test can be replicated. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends that the total regulation (TReg) signal sent on a fleet wide basis be eliminated and replaced with individual regulation signals for each unit. (Priority: Low. First reported 2019. Status: Not adopted.)
- The MMU recommends that, to prevent gaming, there be a penalty enforced in the regulation market as a reduction in performance score and/or a forfeiture of revenues when resource owners elect to deassign assigned regulation resources within the hour. (Priority: Medium. First reported 2016. Status: Not adopted. FERC rejected.)<sup>29</sup>

## Frequency Response, Reactive, and Black Start

- The MMU recommends that all resources, new and existing, have a requirement to include and maintain equipment for primary frequency response capability as a condition of interconnection service. The PJM markets already compensate resources for frequency response capability and any marginal costs. (Priority: Medium. First reported 2018. Status: Partially adopted.)
- The MMU recommends that new CRF rates for black start units, incorporating current tax code changes, be implemented immediately. The new CRF rates should apply to all black start units. Black start units should be required to providing

black start service for the life of the unit. (Priority: High. First reported 2020. Status: Not adopted.)

- The MMU recommends that black start planning and coordination be on a regional basis and not on a zonal basis and that the costs of black start service be shared on an equal per MWh basis across the region. (Priority: Medium. First reported 2023. Status: Not adopted.)
- The MMU recommends that separate cost of service payments for reactive capability be eliminated and the cost of reactive capability be recovered in PJM markets. (Priority: Medium. First reported 2016. Status: Not adopted.)<sup>30</sup>
- The MMU recommends that payments for reactive capability, if continued, be based on the 0.95 power factor included in the voltage schedule in Interconnection Service Agreements. (Priority: Medium. First reported 2018. Status: Not adopted.)<sup>31</sup>
- The MMU recommends that, if payments for reactive are continued, fleet wide cost of service rates used to compensate resources for reactive capability be eliminated and replaced with compensation based on unit specific costs. (Priority: Low. First reported 2019. Status: Not adopted.)<sup>32</sup>
- The MMU recommends that, if payments for reactive are continued, Schedule 2 to OATT be revised to state explicitly that only generators that provide reactive capability to the transmission system that PJM operates and has responsibility for are eligible for reactive capability compensation. (Priority: Medium. First reported 2020. Status: Not adopted.)<sup>33</sup>

## Conclusion

The October 1, 2022, changes to the reserve markets included a synchronized reserve must offer requirement applicable to all generation capacity resources. This resulted in an increase in available supply. Combined with the removal of the \$7.50 per MWh margin and the invalid variable operations and maintenance cost, supply and demand logic predicts lower prices, which occurred in 2022, except during Winter Storm Elliott. This is evidence of market efficiency. With the elimination of tier 1 reserves, the total reserve market clearing price

<sup>28</sup> *Id.*  
<sup>29</sup> *Id.*

<sup>30</sup> On October 17, 2024, the Commission issued a final rule, Order No. 904, eliminating separate payments for reactive in all jurisdictional markets, including PJM. On January 28, 2025, PJM submitted a compliance filing to implement Order No. 904 ("Compliance Filing") that proposed a transition mechanism lasting through May 31, 2026. See Docket No. ER25-1073.

<sup>31</sup> *Id.*  
<sup>32</sup> *Id.*  
<sup>33</sup> *Id.*



credits, while based on lower prices, are paid to a larger MW quantity. However, prices have been higher since PJM extended the ORDCs in May 2023.

The new reserve market design has been called into question by PJM based on a slow response during synchronized reserve events. In all cases, other than during Winter Storm Elliott, the ACE recovered within the required time frame and no reliability problems occurred. PJM responded to this poor performance by unilaterally and inappropriately increasing reserve requirements. This increase shifts the burden of poor resource performance from the resources themselves to customers, clearing more reserves instead of directly dealing with the causes of poor performance. These increases were the cause of higher reserve prices in 2023 and 2024, including 35 intervals of shortage pricing in May 2023 and several intervals of shortage pricing during spin events on January 29, 2024, June 3, 2024, and July 8, 2024, even while reserve markets cleared over 1,000 MW more than what was normally cleared in the months and years prior.

The data on synchronized reserve event recovery do not support the conclusion that there is an immediate need to change how reserves clear. If PJM insists on an immediate change, the focus should be on correcting the supply of reserves rather than increasing demand.

The immediate solution is to improve the deployment of reserves in synchronized reserve events by requiring the capability to use an electronic signal for all synchronized reserves. The archaic telephone communications technology has been a source of slow response times. Phone calls are not an effective or efficient method for deploying resources for immediate response. The MMU recommends that to minimize lag and improve performance, PJM use an electronic synchronized reserve event notification process for all resources and that all resources be required to have the ability to receive and respond to the notifications. On December 17, 2024, PJM partially adopted this recommendation by implementing an electronic deployment of reserves via an augmented dispatch signal, but PJM does not require that resources be able to receive this signal.

Along with changes to the deployment process, PJM and the MMU have worked with generators to identify circumstances where reserves were not accurately measured based on the energy and reserve offer

parameters. More broadly, the MMU's proposal is to buy the correct amount of reserves. No increase in demand is required. There has been no change in the need/demand for reserves. PJM ignored the supply side. The issue is that resources have not provided the reserves that were offered and paid for. With the improved communications, instead of buying more MW of poorly performing reserves, PJM will be able to accurately recognize the actual supply of reserves and to more efficiently deploy them in synchronized reserve events. PJM should remove the 30 percent increase to the synchronized reserve reliability requirement in place from May 2023 through 2024.

The design of the current PJM Regulation Market is significantly flawed.<sup>34</sup> The market design does not correctly incorporate the marginal rate of technical substitution (MRTS) in market clearing and settlement. The market design uses the marginal benefit factor (MBF) to incorrectly represent the MRTS and uses a mileage ratio instead of the MBF in settlement. The current market design allows regulation units that have the capability to provide both RegA and RegD MW to submit an offer for both signal types in the same market hour. However, the method of clearing the regulation market for an hour in which one or more units has a dual offer incorrectly accounts for the amount of RegD and the effective MW of the RegD that it clears. The result of the flaw is that the MBF in the clearing phase is incorrectly low compared to the MBF in the solution phase and the actual amount of effective MW procured is higher than the regulation requirement. This failure to correctly and consistently incorporate the MRTS into the regulation market design has resulted in both underpayment and overpayment of RegD resources and in the over procurement of RegD resources in all hours. Under the current design, slower response RegA resources (generating units) must provide additional regulation to offset the negative impact of RegD resources (largely batteries) that are charging in the middle of a regulation hour. The ability of some resources to submit offers for both RegA and RegD (dual offers) results in inefficient high prices. The market results continue to include the incorrect definition of opportunity cost. These issues are the basis for the MMU's conclusion that the regulation market design is flawed.

<sup>34</sup> The current PJM regulation market design that incorporates two signals using two resource types was a result of FERC Order No. 755 and subsequent orders. Order No. 755, 137 FERC ¶ 61,064 at PP 197–200 (2011).

PJM filed proposed changes to the regulation market with the FERC on April 16, 2024.<sup>35</sup> The MMU filed a protest to the PJM filing on May 7, 2024, and answer to PJM's answer on June 7, 2024. The Commission Order on June 17, 2024 accepted the PJM Proposal as filed. PJM will implement the changes to the regulation market in two phases. Phase 1, scheduled to be implemented on October 1, 2025, will result in a single signal, bidirectional market with one clearing price. Phase 2, to be implemented on October 1, 2026, will result in separate regulation up and regulation down markets. The proposed changes to move to a single signal market, as approved by FERC, will eliminate the issues caused by the incorrect and inconsistent use and application of the MBF/MRTS in the regulation market.

The benefits of markets can be realized under the current approach to ancillary service markets. Even in the presence of structurally noncompetitive markets, there can be transparent, market clearing prices based on competitive offers that account explicitly and accurately for opportunity cost. This is consistent with the market design goal of ensuring competitive outcomes that provide appropriate incentives without reliance on the exercise of market power and with explicit mechanisms to prevent the exercise of market power. But there are significant issues with the PJM ancillary services markets.

The MMU concludes that the regulation market results were not competitive, and the market design is significantly flawed. The MMU concludes that the synchronized reserve market results were competitive. The MMU concludes that the nonsynchronized reserve market results were competitive. The MMU concludes that the secondary reserve market results were competitive.

## PJM Reserve Markets

Reserve resources are scheduled and paid for the availability to respond to a loss of supply on the system by increasing their energy output within defined time limits. When a resource clears in a reserve market, it is assigned scheduled reserve MW by that reserve market. Most reserve MW are cleared by the reserve markets, but PJM has the ability to schedule resources outside of the markets when needed.

PJM clears reserves to satisfy defined reserve service requirements. There are three reserve services: the

synchronized reserve service (SR), the primary reserve service (PR), and the 30-minute reserve service (TMR). Each reserve service is defined by its response time requirement and by whether the service can be provided by offline resources (Table 10-5). Only the synchronized reserve service requires that all providers be online and synchronized to the grid. The other two services, primary reserve and 30-minute reserve, can be provided by both online and offline resources.

**Table 10-5 Reserve services and their definitions**

Service	Response Requirement (minutes)	Provided by Online Resources	Provided by Offline Resources
Synchronized Reserve	10 or less	Yes	No
Primary Reserve	10 or less	Yes	Yes
30-Minute Reserve	30 or less	Yes	Yes

Each reserve service requires a specified number of MW to be available in order to cover a potential loss of supply event, known as that service's reserve requirement. The size of a service's requirement depends on the contingencies that the service is designed to address (determining the service's reliability requirement), plus the option to add a requirement to account for potential demand increases due to temporary conditions like emergencies and weather alerts (determining the extended requirement). A service's total requirement is equal to the sum of its reliability requirement, which is unique to each service, plus the extended reserve requirement, which is the same for all services and has a base value of 190 MW.<sup>36</sup> The default extended reserve requirement of 190 MW was designed to phase in the price impacts of shortage pricing in real time.

The reserve services are nested, such that the satisfaction of the synchronized reserve requirement counts towards the satisfaction of the primary reserve requirement, which counts towards the satisfaction of the 30-minute reserve requirement. The principal contingency for which reserves are cleared is the loss, in a single event, of the largest generator or group of generators, known as the "most severe single contingency," or the MSSC. Therefore, the reliability requirement of each service, in whole or in part, depends upon the size of the MSSC. Table 10-6 shows the default definitions of the reliability requirements and the full requirements.


<sup>36</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.3 Reserve Requirement Determination, Rev. 133 (Dec. 17, 2024).

<sup>35</sup> PJM, "Regulation Market Design Filing," Docket No. ER24-1772-000 (April 16, 2024).

PJM selectively calls upon reserve services to respond to events. For example, to engage synchronized reserves, PJM initiates a synchronized reserve event, also called a spinning event.<sup>37</sup> In 2024, PJM did not call on primary reserves or 30-minute reserves to collectively respond to a reserve event. PJM calls on some non-synchronized resources to individually respond during synchronized reserve events.

During an event, reserves respond either by increasing their energy output to the grid or by decreasing their energy consumption from the grid. The delivery of this energy is constrained by transmission limits, such that there are also limited locational requirements for each of the reserve services, except for the 30-minute reserve service.<sup>38</sup> PJM uses these constraints to define a reserve subzone with its own smaller requirements for synchronized reserve and primary reserve. Reserves in the subzone count towards the satisfaction of the requirements for the entire RTO Reserve Zone.<sup>39</sup> For example, satisfaction of the synchronized reserve requirement in the Mid-Atlantic Dominion (MAD) Reserve Subzone also counts towards the primary reserve requirement in the MAD Subzone and the synchronized reserve requirement in the RTO Zone, which in turn counts towards the satisfaction of the primary reserve requirement in the RTO Zone. There is only one active reserve subzone at a time. Figure 10-1 shows how reserve requirements for the MAD Reserve Subzone are nested inside the RTO Reserve Zone when the MAD Subzone is the active subzone.

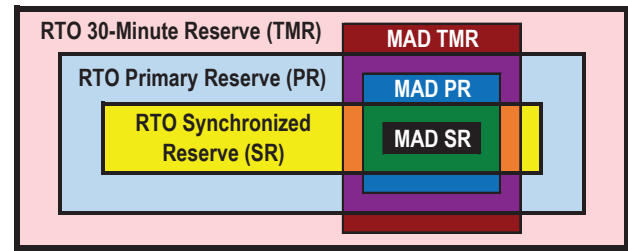**Figure 10-1 Service nesting in the RTO Reserve Zone and the Mid-Atlantic Dominion (MAD) Reserve Subzone**



In May 2023, PJM made two unilateral changes in succession to the reserve requirements to compensate for the asserted lack of performance during spin events. Table 10-21 shows the average performance for events 10 or more minutes long. The average response to the two events of 10 minutes or more that occurred in the first four months of 2023, both in January, was 56.9 percent, compared to 50.3 percent in the last three months of 2022. On May 12, 2023, PJM inappropriately increased the extended reserve requirement by 1,588 MW and on May 15, 2023, PJM reversed the increase. On May 19, 2023, PJM inappropriately increased the synchronized reserve reliability requirement by 30 percentage points to 130 percent of the MSSC. Figure 10-19 compares the changes in demand. PJM has not identified an end date or end criteria for this change.<sup>41</sup>

The reserve requirements effective for a scheduling interval can change from interval to interval depending on the contingencies and needs of the grid. When maintenance work at a power station risks tripping multiple generators whose total output is larger than the MSSC, PJM can increase the requirement for synchronized reserve to include that total output. PJM can increase the reserve requirement due to emergencies and weather alerts. In May 2023, PJM unilaterally modified *PJM Manual 11: Energy & Ancillary Services Market Operations* to allow PJM to temporarily increase the requirements to compensate for poor resource performance in order to continue compliance with

**Table 10-6 Service requirement definitions<sup>40</sup>**

Service	Service Reliability Requirement	Service Extended Requirement
Synchronized Reserve	Most Severe Single Contingency	SR Reliability Requirement + Extended Reserve Requirement
Primary Reserve	1.5 × SR Reliability Requirement	PR Reliability Requirement + Extended Reserve Requirement
30-Minute Reserve	max(Largest Active Gas Contingency, PR Reliability Requirement, 3,000 MW)	TMR Reliability Requirement + Extended Reserve Requirement

<sup>37</sup> See PJM, "PJM Manual 12: Balancing Operations," § 4.1.2 Loading Reserves, Rev. 54 (Dec. 17, 2024).

<sup>38</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.3.1 Locational Aspect of Reserves, Rev. 133 (Dec. 17, 2024).

<sup>39</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.4.1 Product and Locational Substitution, Rev. 133 (Dec. 17, 2024).

<sup>40</sup> From mid-May 2023 through 2024, PJM has set the synchronized reserve reliability requirement to be 130 percent of the MSSC. This change, although implemented without specific criteria for ending the increase, is defined as temporary. See "Synchronized Reserve Requirement Reliability Update," (May 18, 2023). <<https://www.pjm.com/-/media/markets-ops/ancillary/reserves-procedure-memo.ashx>>.

<sup>41</sup> See "Market Monitor Report," Monitoring Analytics presentation to the Members Committee Information Webinar. (May 22, 2023) <<https://pjm.com/-/media/committees-groups/committees/mc/2023/20230522-webinar/item-04---imm-report.ashx>>.

ReliabilityFirst's regional criteria.<sup>42 43</sup> Table 10-7 shows the instances identified by the MMU when PJM temporarily increased the reserve requirements during 2024.

**Table 10-7 Temporary adjustments to 30-minute, primary, and synchronized reserve requirements: 2024<sup>44</sup>**

From	To	Number of Hours	Amount of Adjustment
19-May-23	Ongoing	14,232+	30 percent increase to synchronized reserve reliability requirement
26-Jan-24	28-Jan-24	48	30-Minute Reserve (10 MW), Primary Reserve (10 MW), Synchronized Reserve (7 MW)
26-Feb-24	18-Mar-24	504	30-Minute Reserve (0 MW), Primary Reserve (0 MW), Synchronized Reserve (0 MW)
18-Apr-24	30-Apr-24	300	30-Minute Reserve (0 MW), Primary Reserve (10 MW), Synchronized Reserve (7 MW)
5-Jun-24	7-Jun-24	55	30-Minute Reserve (50 MW), Primary Reserve (50 MW), Synchronized Reserve (33 MW)
13-Oct-24	15-Oct-24	48	30-Minute Reserve (571 MW), Primary Reserve (925 MW), Synchronized Reserve (617 MW)
5-Nov-24	6-Nov-24	41	30-Minute Reserve (0 MW), Primary Reserve (1 MW), Synchronized Reserve (1 MW)

PJM must comply with the reserve requirements imposed by NERC and ReliabilityFirst but PJM uses requirements that are more restrictive than NERC requirements. NERC Performance Standard BAL-002-3, which describes NERC's Disturbance Control Standard (DCS), defines a requirement for contingency reserve, which PJM implements as primary reserve, but not for synchronized reserve nor for 30-minute reserve.<sup>45</sup> NERC requires that contingency reserves respond within 15 minutes, while PJM requires that primary reserves respond within 10 minutes. ReliabilityFirst Regional Criteria RFC\_Criteria\_BAL-002-02 in effect requires that the amount of cleared synchronized reserve be at least 50 percent of the MSSC, while PJM requires cleared synchronized reserve to be at least 100 percent of the MSSC.<sup>46</sup> A NERC DCS event is defined as the loss of supply, in a single event, of 80 percent or more of the MSSC. The event begins as soon as the Reporting ACE (a version of the area control error) starts to drop and ends when the Reporting ACE returns to the lesser of zero and its value at the start of the event. Although PJM uses synchronized reserve events to recover from DCS events, synchronized reserve events can be longer than their corresponding DCS events (Table 10-23).

There are three kinds of resources that can provide reserves: online generators that can increase their energy output, offline generators that can start and provide their energy output, and demand-response resources that can decrease their energy use. From these resources, there are three reserve products: synchronized reserves (SR), nonsynchronized reserves (NSR), and secondary reserves (SecR).<sup>47</sup> A reserve product is defined by its response-time requirement and by the types of resources that can provide it (Table 10-8).

**Table 10-8 Reserve products and definitions**

Reserve Product	Response Requirement (minutes)	Provided by Online Generators	Provided by Offline Generators	Provided by Demand-Side Response
Synchronized Reserve	10 or less	Yes	No	Yes
Nonsynchronized Reserve	10 or less	No	Yes	No
Secondary Reserve	10 exclusive to 30 exclusive	Yes	Yes	Yes

A reserve product can only be used to satisfy a reserve service's scheduling requirement if it also satisfies that service's response-time requirement and synchronization requirement, which are listed in Table 10-5. Table 10-9 shows which reserve products can be used to satisfy which reserve services.

<sup>42</sup> RFC\_Criteria\_BAL-002-02. "Operating Reserves," August 29, 2012. <[https://rfirst.org/ProgramAreas/Standards/Criteria/Regional%20Criteria%20Library/RFC\\_Criteria\\_BAL-002-02.pdf](https://rfirst.org/ProgramAreas/Standards/Criteria/Regional%20Criteria%20Library/RFC_Criteria_BAL-002-02.pdf)>.

<sup>43</sup> See *id.*, which describes the document as a "ReliabilityFirst Board of Directors approved good utility practice document which are not reliability standards" and notes that "ReliabilityFirst Regional Criteria are not NERC reliability standards, regional reliability standards, or regional variances, and therefore are not enforceable under authority delegated by NERC pursuant to delegation agreements and do not require NERC approval."

<sup>44</sup> PJM does not make public the exact increases in reserves nor the exact times increases are used. This table shows the differences between the average reserve values inside times that have been identified for possible increases in reserves with the average values before and after those times. The ranges given can include several overlapping timespans of possible increases.

<sup>45</sup> NERC BAL-002-3. "Disturbance Control Standard – Contingency Reserve for Recovery from a Balancing Contingency Event," April 1, 2019. <<https://www.nerc.com/pa/Stand/Reliability%20Standards/BAL-002-3.pdf>>.

<sup>46</sup> RFC\_Criteria\_BAL-002-02. "Operating Reserves," August 29, 2012. <[https://rfirst.org/ProgramAreas/Standards/Criteria/Regional%20Criteria%20Library/RFC\\_Criteria\\_BAL-002-02.pdf](https://rfirst.org/ProgramAreas/Standards/Criteria/Regional%20Criteria%20Library/RFC_Criteria_BAL-002-02.pdf)>.

<sup>47</sup> OATT, Attachment K - Appendix S 1.7.19 (Ramping).

**Table 10-9 Reserve products and the services they can provide**

Reserve Product	Can Provide Synchronized Reserve	Can Provide Primary Reserve	Can Provide 30-Minute Reserve
Synchronized Reserve	Yes	Yes	Yes
Nonsynchronized Reserve	No	Yes	Yes
Secondary Reserve	No	No	Yes

Figure 10-2 shows how reserve products were cleared in real time to meet the reserve service requirements in 2024. In the figure, each line represents the extended requirement of a reserve service, which is the service's reliability requirement plus the generic extended requirement. The colored areas represent how the cleared MW of the three reserve products combine to satisfy the reserve requirements. As can be seen in the figure, the cleared reserve products providing the services do not exactly equal the service requirements. In 2024, the total amounts of cleared synchronized reserve and 30-minute reserve were frequently greater than their requirements. This can result from cleared resources providing more reserves than needed to satisfy the remainder of a requirement and can result from PJM clearing reserve products to help satisfy the requirements of the next broader reserve service. For example, since mid-January, PJM has cleared synchronized reserves in excess of the synchronized reserve requirement in order to, along with the cleared nonsynchronized reserve, more economically satisfy the primary reserve requirement.

Although not seen in Figure 10-2, PJM does not always clear enough reserves to satisfy a reserve requirement. When a service's requirement is not met, the result is shortage pricing.

**Figure 10-2 Daily average real-time reserve products cleared and daily average real-time reserve service requirements used by RT SCED: 2024**

PJM uses market mechanisms to clear resources. In general, products that meet shorter response time requirements and that can be used to satisfy multiple reserve requirements have higher prices. The objective is to minimize total cost when purchasing reserves and energy.

## Implementation of PJM Reserve Markets

While the primary reserve requirement and 30-minute reserve requirement can be satisfied using multiple products, the products are purchased separately. There are separate markets for synchronized reserves, nonsynchronized reserves, and secondary reserves.<sup>48</sup> MW that are selected as reserve are said to have cleared the market. Effective October 1, 2022, each product's reserve market has a day-ahead component and a real-time component. The obligations of a reserve resource depend on its real-time assignment, which in turn depends on how the resource clears the day-ahead and real-time markets. A resource that cleared one market is not guaranteed to have cleared the other market, and a resource that cleared both markets need not clear the same amount in real time as it did day ahead. Although multiple reserve products can be used to satisfy the same reserve service requirements, the reserve products are not necessarily paid the same market clearing prices. Each market for a reserve product has a single market clearing price that is applied to all reserve MW cleared in that market, regardless of the service that required the clearing of those MW.

In general, the reserve MW available from a resource are calculated by PJM based on the parameters in the resource's energy offer and reserve parameters. Some resource types, such as hydroelectric resources, energy storage resources, and load response resources, can specify reserve offer amounts.<sup>49</sup> Generation capacity resources are required to participate in the reserve markets. However, nuclear, solar, and wind resources are excluded by default and must request inclusion in the reserve markets. PJM can automatically deselect a resource from participating in the reserve market for performance reasons.<sup>50 51</sup> PJM can temporarily

48 See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.4.1 Product and Locational Substitution, Rev. 132 (Dec. 17, 2024).

49 See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.2.3 Reserve Market Resource Offer Structure, Rev. 133 (Dec. 17, 2024).

50 See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.2.1 Reserve Market Eligibility, Rev. 133 (Dec. 17, 2024).

51 See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.4.3.1 Deselection of Reserve Resources in Real-Time, Rev. 133 (Dec. 17, 2024).



deselect a resource from providing reserves for, among other reasons, failing to reliably follow PJM's dispatch signal. A resource that is deselected for failing to follow PJM's dispatch signal is in violation of its must-offer requirement.<sup>52</sup>

A generation resource can request a maximum MW value for its reserve offer (synchronized, secondary, or both individually) that is lower than its economic maximum if that generator's reserve offer is subject to a physical limitation that cannot be modeled by a segmented hourly ramp rate.<sup>53</sup> Such a request must include documentation and data demonstrating the limitation. Both PJM and the MMU review the request. PJM must respond within 30 days after data supporting the request is submitted, telling the generation owner whether the request was accepted or denied, and if denied, for what reason.

The clearing of resources to meet PJM's operational requirements includes multiple steps to commit resources, dispatch resources, and calculate clearing prices.<sup>54</sup> Each program in the commitment and dispatching process estimates future needs. The day-ahead market solution software schedules resources in one-hour blocks.<sup>56</sup> The real-time software schedules resources in five-minute intervals.

Due to their start and notification times, some resources can only be cleared in the earlier steps of PJM's commitment and dispatching process. Depending on their physical run-time requirements, resources are described as either flexible or inflexible. Inflexible resources are those that must run for at least one hour and are only committed in real-time by the hour-ahead real-time software or by a PJM operator, and can include demand response resources, offline CTs and hydro resources that can operate in condensing mode, and resources whose economic minimum output equals their economic maximum output. Flexible resources are those that can be cleared for reserves by RT SCED later in the process. Such resources are already online for energy, require no notification time, and can be automatically dispatched.

In general, resources do not have to clear the same amounts in the real-time and day-ahead markets, and a resource that cleared one of the markets is not guaranteed to have cleared the other. However, if an inflexible condenser or an inflexible economic load response resource has a day-ahead assignment, that assignment is also applied to the operating day.<sup>57</sup>

Not all resources that provide reserves necessarily clear the reserve market. When needed, PJM is able to manually schedule a resource for reserves if that resource would not have otherwise run.<sup>58</sup> Similarly, not all inflexible reserve resources cleared by the ASO and IT SCED are necessarily used for reserves. When needed, PJM can manually switch inflexible resources from providing reserves to providing energy.

Figure 10-4 compares the daily average requirements of the day-ahead clearing engine, the ASO, and RT SCED. Figure 10-4 shows that the reserve requirements used by the ASO and RT SCED do not differ significantly. Until May 12, 2023, the daily average 30-minute reserve requirement was almost always 3,190 MW in the day-ahead, ASO, and RT SCED (Figure 10-4).

Figure 10-3 compares the daily average cleared MW of the day-ahead clearing engine, the ASO, and RT SCED. In addition to the increase in cleared secondary reserve resulting from PJM correcting its software error, Figure 10-3 shows that the day-ahead market also tended to clear the most nonsynchronized reserve. For satisfying the primary reserve requirement, the ASO uses more synchronized reserves, clearing less nonsynchronized reserves than RT SCED due to differences in the available MW that result from differences in the applied unit schedules. This difference is also seen in Figure 10-25.

<sup>52</sup> See *id.*

<sup>53</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.2.2.1 Communication for Reserve Capability Limitation, Rev. 133 (Dec. 17, 2024).

<sup>54</sup> For more on the market solution software, see the 2024 Annual State of the Market Report for PJM, Appendix E – Ancillary Service Markets.

<sup>55</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 5.2 Scheduling Tools, Rev. 133 (Dec. 17, 2024).

<sup>56</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.4.2 Day-ahead Reserve Market Clearing, Rev. 133 (Dec. 17, 2024).


<sup>57</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.4.3 Real-time Reserve Market Clearing, Rev. 133 (Dec. 17, 2024).

<sup>58</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.4.3 Real-time Reserve Market Clearing, Rev. 133 (Dec. 17, 2024).

**Figure 10-3 MW cleared by the day-ahead engine, the ASO, and RT SCED: 2024**



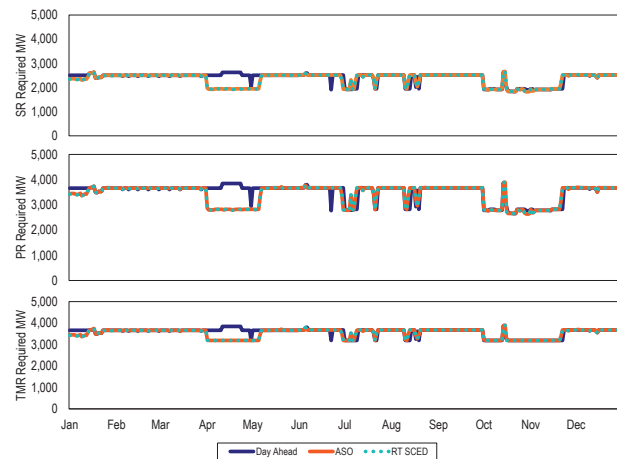**Figure 10-4 Requirements used in the day-ahead engine, the ASO, and RT SCED: 2024**




There is a defined MW demand only for synchronized reserves, primary reserves, and 30-minute reserves. The demand for nonsynchronized reserves and for secondary reserves is derived from those defined MW demand levels and cleared supply. PJM's administratively defined demand curve for reserves is called the Operating Reserve Demand Curve (ORDC) and has two steps. The first step of each service's ORDC is set at that service's reliability requirement and is priced at \$850 per MWh. The second step is the extended reserve requirement and is priced at \$300 per MWh. Figure 10-5 shows example ORDCs for the three reserve services using an example MSSC of 1,000 MW with no increases in the extended reserve requirement.

In 2014, PJM added an optional second step to the ORDC, which could be increased from its default value of 0 MW to account for increased uncertainty identified by PJM. In 2017, PJM proposed a minimum value of 190 MW for the then optional second step, bringing it to its current form.<sup>59 60</sup>

Figure 10-5 shows an example of the three operating reserve demand curves for each reserve product for an example MSSC at 1,000 MW with no increases in the extended reserve requirement. The adjusted ORDCs resulting from PJM's increase to the synchronized reserve reliability requirement are shown in Figure 10-20.

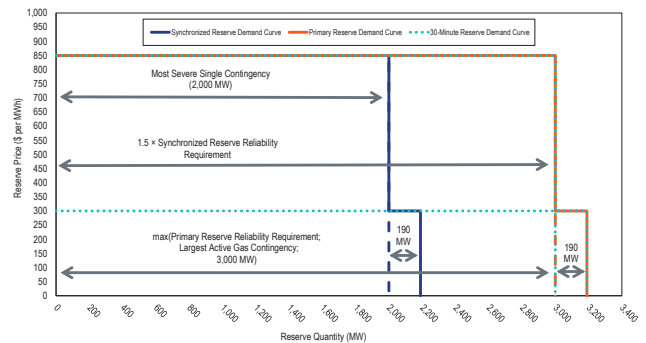**Figure 10-5 An example of the reserve product real-time operating reserve demand curves, including the permanent second steps**



During periods of shortage pricing, the reserve market clearing prices can be higher than the limits shown in Figure 10-5. Offer prices for synchronized reserve are cost based and are capped at the expected value of the synchronized reserve penalty. The product substitution cost is a function of LMPs, the marginal cost of energy for the resources providing reserves, and the minimized cost of substituted MW providing energy. At the margin, the price is the sum of the offer price and the product substitution cost of the marginal unit(s).<sup>61</sup>

Like the markets, credits and charges for reserves have day-ahead and real-time components. Day-ahead credits depend only on a resource's day-ahead assignment and the day-ahead market clearing price. There are no lost opportunity cost (LOC) credits in the day-ahead market,

<sup>59</sup> See the transmittal letter to Revisions to OA Schedule 1 and OATT Att K-Appx RE Operating Reserve Demand Curve, Docket No. ER17-1590-000 (May 12, 2017) at 8.

<sup>60</sup> For background data, see "Shortage Pricing ORDC - Order 825," PJM presentation to the Market Implementation Committee, (October 26, 2016) <<https://www.pjm.com/-/media/committees-groups/committees/mic/20161026-special/20161026-item-03-shortage-ordc.aspx>>

<sup>61</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.2.9 Synchronized Reserve Market Clearing Price (SRMCP) Calculation, Rev. 121 (July 7, 2022). This version of the manual has a definition that is more clear than later versions.

nor are there any shortfall charges applied to day-ahead assignments when evaluating resource performance. These concepts apply only to the real-time reserve markets.

The real-time component, known as the balancing credit, is added to day-ahead credits based on the difference between the real-time and day-ahead assignments. This balancing credit for a resource is the sum of a resource's balancing MCP credit and LOC credit, less any shortfall charge for failing to provide the service. If a resource clears less MW in real-time than in the day-ahead market, and if it is found to be at fault for this reduction, then the balancing MCP credit is negative and so the resource buys back this difference at real-time prices. If the resource clears more in real time, then it is positive. If a resource's real-time assignment is the same as its day-ahead assignment, then the balancing MCP credit is \$0 and the resource's total MCP credit uses only the day-ahead MCP.

For the synchronized reserve product and the secondary reserve product, the MW for which a resource receives real-time credit can be capped at a value less than the cleared real-time amount. This capping accounts for a resource's real-time energy output and prevents crediting a resource for a reserve amount that it did not actually provide.

## Reserve Subzones

Reserve subzones address transmission limits that may prevent the lowest cost reserves from being deliverable throughout the RTO. A reserve subzone has its own reserve requirements, which can only be satisfied by resources within the subzone. The RTO Reserve Zone has only one active subzone at any time. In practice, PJM has maintained only one subzone, the Mid-Atlantic Dominion Reserve Subzone (MAD), and in every market solution, the most limiting constraining path sets the transfer limit between the RTO and in MAD. The price in MAD may exceed the price in the rest of the RTO when the constraints are binding.


While PJM generally triggers synchronized reserve events for the entire RTO, PJM has the option to only load reserves in the defined subzone. For example, on February 24, 2024, PJM initiated a synchronized reserve event only for MAD.

The choice of MAD was a result of historical congestion patterns. Transmission limits at times required maintaining out of merit reserves in the MAD area. On most days, the MAD Subzone is no longer binding. As of October 1, 2022, PJM has a process to revise the definition of the subzone. The subzone definition may change as often as daily based on system conditions, and new subzones can be defined as needed.<sup>62</sup> In 2023 and 2024, PJM did not change the subzone.

Figure 10-6 is a map of constraints and major generation sources, showing how the constraints separating the RTO Reserve Zone and MAD Reserve Subzone are defined by the underlying grid topology. The most frequently binding constraints in 2024 were Brighton-Conastone, Bedington-Black Oak, and Belmont-Cochran Mill.


Figure 10-7 shows the reserve service requirements and cleared reserve product in the MAD Reserve Subzone in 2024. As there is no 30-minute reserve requirement for the MAD Reserve Subzone, secondary reserve is excluded. The increase in reserve requirements in effect since mid-May 2023 does not apply to the MAD Reserve Subzone, only to the RTO Reserve Zone.

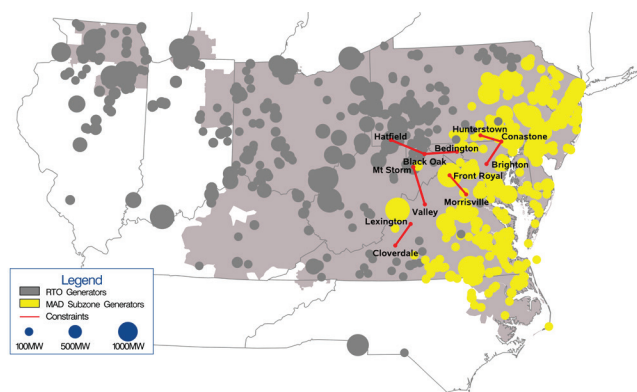**Figure 10-6 PJM RTO Zone and MAD Subzone map of constraints and generation sources**



<sup>62</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.3.2 Creation of New Reserve Subzones, Rev. 133 (Dec. 17, 2024).

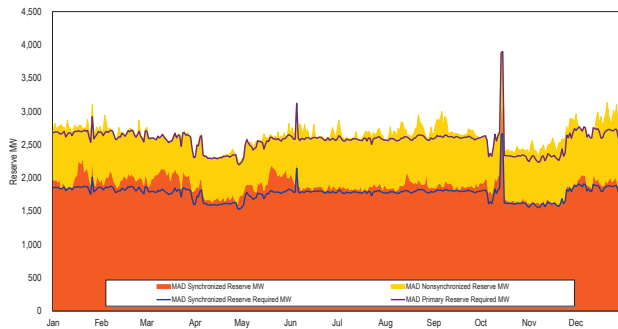**Figure 10-7 Daily average real-time MAD reserve products and daily average real-time MAD reserve service requirements: 2024**



## Primary Reserve

NERC Performance Standard BAL-002-3, Disturbance Control Standard – Contingency Reserve for Recovery from a Balancing Contingency Event, requires PJM to carry sufficient contingency reserve to recover from a sudden balancing contingency (usually a loss of generation). The Contingency Event Recovery Period is the time required to return the Reporting ACE to the lesser of zero and its pre-event level. The Contingency Reserve Restoration period is the time required to restore contingency (primary) reserves to a level greater than or equal to the largest single contingency after the end of the Contingency Event Recovery Period. NERC standards set the Contingency Event Recovery Period as 15 minutes and the Contingency Reserve Restoration Period as 90 minutes.<sup>63</sup> The NERC requirement is 100 percent compliance and status must be reported quarterly. PJM implements this contingency reserve recovery period requirement using primary reserves.<sup>64</sup> PJM maintains 10-minute reserves (primary reserve) which is more conservative than the NERC requirement. PJM's primary reserves are made up of resources, both synchronized and nonsynchronized, that can provide energy within 10 minutes. PJM does not have a Contingency Reserve Restoration Period standard.

<sup>63</sup> See PJM, "PJM Manual 12: Balancing Operations," Rev. 54 (Dec. 17, 2024) Attachment D, "the Disturbance Recovery Period is 15 minutes after the start of a Reportable Disturbance. Subsequently, PJM must fully restore the Synchronized Reserve within 90 minutes." While this cited attachment only references restoring synchronized reserves, PJM Manuals 10 & 13 make it clear that primary reserves serve as PJM's contingency reserves, although PJM generally uses synchronized reserves to recover from contingency events.


<sup>64</sup> See PJM, "PJM Manual 10: Pre-Scheduling Operations," § 3.1 Reserve Definitions, Rev. 45 (Nov. 21, 2024).

## Market Structure

### Demand

Demand for primary reserves is based on the primary reserve requirement. The primary reserve requirement is equal to the sum of the primary reserve reliability requirement, unique to the primary reserve service, plus the extended reserve requirement, which is the same for all services. The primary reserve reliability requirement is equal to 150 percent of the synchronized reserve reliability requirement. Figure 10-8 shows an example operating reserve demand curve for primary reserve for an example synchronized reserve reliability requirement of 2,000 MW plus the default 190 MW extension.

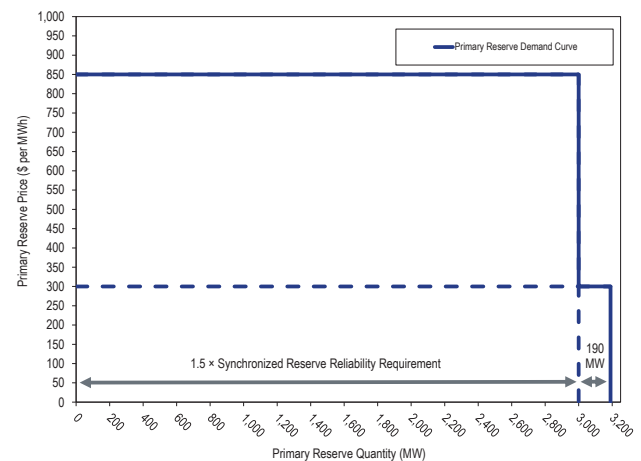**Figure 10-8 An example of a primary reserve real-time operating reserve demand curve, including the permanent second step**



In 2024, the average primary reserve requirement for the RTO Zone was 3,422.8 MW. The average primary reserve requirement in the MAD Subzone was 2,565.1 MW. The average synchronized reserve requirement in the RTO Zone was 2,346.1 MW. The average synchronized reserve requirement in the MAD Subzone was 1,773.4 MW.

In an attempt to offset poor synchronized reserve performance, PJM unilaterally and inappropriately made changes to the reserve requirements in May 2023. On May 12, 2023, PJM inappropriately increased the extended reserve requirement by 1,588 MW and on May 15, 2023, PJM reversed the increase. On May 19, 2023, PJM inappropriately increased the synchronized reserve reliability requirement by 30 percentage points to 130 percent of the MSSC.

## Supply

In 2024, the demand for primary reserve was satisfied by synchronized reserves and nonsynchronized reserves. The primary reserve requirement is met from the least expensive combination of synchronized and nonsynchronized reserves that satisfies the requirements of the primary reserve service and the synchronized reserve service. Table 10-10 shows the real-time average available MW from synchronized and nonsynchronized resources in 2024.

**Table 10-10 Average available MW for clearing: 2024**

Location	Synchronized Reserve MW	Nonsynchronized Reserve MW
RTO	5,583.7	946.5
MAD	2,733.6	664.6

Table 10-11 provides the average dispatched reserves, by reserve product, used by the RT SCED market solution to satisfy the primary reserve requirement in the MAD Subzone from January 2023 through December 2024. Table 10-12 shows the average dispatched reserves, by reserve product, used by the RT SCED market solution to satisfy the primary reserve requirement in the RTO Zone from January 2023 through December 2024.

**Table 10-11 Average monthly reserves used to satisfy the primary reserve requirement, MAD Subzone: 2023 through 2024**

Year	Month	Synchronized Reserve MW	Nonsynchronized Reserve MW	Total Primary Reserve MW
2023	Jan	1,932.9	791.9	2,724.8
2023	Feb	1,955.1	672.8	2,627.9
2023	Mar	1,695.5	678.2	2,373.7
2023	Apr	1,664.1	615.4	2,279.5
2023	May	1,940.1	685.2	2,625.3
2023	Jun	1,973.0	688.2	2,661.2
2023	Jul	1,958.5	714.1	2,672.6
2023	Aug	1,965.5	763.5	2,729.0
2023	Sep	1,925.4	731.5	2,656.9
2023	Oct	1,975.1	688.2	2,663.3
2023	Nov	1,756.3	719.4	2,475.7
2023	Dec	1,927.3	797.6	2,724.9
2023	Average	1,886.2	735.1	2,621.3
2024	Jan	2,007.8	754.0	2,761.8
2024	Feb	1,991.5	707.2	2,698.7
2024	Mar	2,024.3	578.1	2,602.3
2024	Apr	1,724.3	632.6	2,356.9
2024	May	1,968.1	606.3	2,574.4
2024	Jun	1,891.4	782.2	2,673.5
2024	Jul	1,856.2	789.4	2,645.6
2024	Aug	1,906.5	792.3	2,698.7
2024	Sep	1,883.0	839.6	2,722.6
2024	Oct	1,862.0	702.5	2,564.5
2024	Nov	1,685.3	860.2	2,545.5
2024	Dec	1,943.7	896.3	2,840.0
2024	Average	1,895.9	744.9	2,640.8

**Table 10-12 Average monthly reserves used to satisfy the primary reserve requirement, RTO Zone: 2024**

Year	Month	Synchronized Reserve MW	Nonsynchronized Reserve MW	Total Primary Reserve MW
2023	Jan	1,934.6	861.0	2,795.6
2023	Feb	1,974.8	718.4	2,693.2
2023	Mar	1,722.1	812.4	2,534.5
2023	Apr	1,787.9	770.9	2,558.8
2023	May	2,425.4	803.9	3,229.3
2023	Jun	2,628.5	847.8	3,476.2
2023	Jul	2,710.1	845.8	3,556.0
2023	Aug	2,464.1	1,079.3	3,543.5
2023	Sep	2,531.2	1,203.6	3,734.8
2023	Oct	2,544.1	992.3	3,536.4
2023	Nov	2,232.2	1,114.5	3,346.7
2023	Dec	2,567.7	1,211.6	3,779.3
2023	Average	2,296.2	939.8	3,236.0
2024	Jan	2,732.1	950.0	3,682.1
2024	Feb	2,826.8	867.6	3,694.4
2024	Mar	3,006.7	662.7	3,669.4
2024	Apr	2,130.2	753.3	2,883.5
2024	May	2,874.4	674.4	3,548.8
2024	Jun	2,779.6	950.8	3,730.4
2024	Jul	2,584.6	965.0	3,549.6
2024	Aug	2,736.1	929.0	3,665.1
2024	Sep	2,771.0	1,011.1	3,782.2
2024	Oct	2,100.6	792.6	2,893.2
2024	Nov	2,203.0	1,048.5	3,251.5
2024	Dec	2,679.5	1,238.1	3,917.7
2024	Average	2,619.1	903.4	3,522.5

## Market Concentration

In 2024, for the day-ahead market, the RTO and MAD primary reserve markets were moderately concentrated. In 2024, for the real-time market, the RTO primary reserve market was unconcentrated and the MAD primary reserve market was moderately concentrated. Table 10-13 shows the average of the HHI values of each interval for primary reserves in 2024.

**Table 10-13 Average primary reserve HHI: 2024**

Location	Market	Average HHI	Percent of Intervals		Description
			Max Market Share	Above 20%	
RTO	RT	922		42.0%	Unconcentrated
RTO	DA	971		46.4%	Unconcentrated
MAD	RT	1628		85.1%	Moderately Concentrated
MAD	DA	1563		81.2%	Moderately Concentrated

## Market Performance

Figure 10-9 shows daily weighted average synchronized and nonsynchronized market clearing prices in 2024. The synchronized reserve market clearing prices for the RTO Reserve Zone and the MAD Reserve Subzone diverged in 1,505 five-minute intervals, 1.4 percent of the total 105,408 intervals in 2024. The nonsynchronized reserve




market clearing prices for the RTO Reserve Zone and the MAD Reserve Subzone diverged in 1,261 five-minute intervals, 1.2 percent of the total 105,408 intervals in 2024.

The prices of synchronized reserve and nonsynchronized reserve spiked on January 16, January 17, and November 5, 2024, during conservative operations for cold weather. Prices spiked on August 1, August 4, and August 26 during hot weather alerts. Prices spiked on December 12 and December 13 during cold weather alerts. There was shortage pricing in the RTO Reserve Zone for primary reserve on January 20, January 22, January 29, March 10, March 18, April 14, May 21, June 3, July 8, July 28, September 4, October 15, November 22, and December 6. There was shortage pricing in the MAD Reserve Subzone for primary reserve on January 20, January 21, January 22, June 3, and October 14, 2024. There was shortage pricing in the RTO for synchronized reserve on June 3 and July 28. Shortage intervals for primary reserves on January 29, June 3, and July 8 occurred during spinning events.

Of the 39 intervals short of primary reserve in the RTO Reserve Zone or the MAD Reserve Subzone, 25 were shortage intervals only as a result of the 30 percent increase to the synchronized reserve reliability requirement imposed by PJM in May 2023. There were four intervals of shortage pricing for primary reserve for which PJM would not have met the primary reserve requirement in RT SCED even without 30 percent increase to the demand for synchronized reserves.

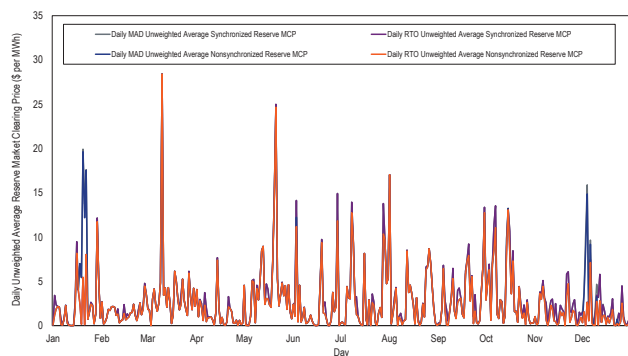**Figure 10-9 Daily average market clearing prices for synchronized reserve and nonsynchronized reserve: 2024**



## Synchronized Reserve

All eligible generation capacity resources capable of providing synchronized reserves have a must offer requirement, and all cleared synchronized reserves have an obligation to perform and receive payment based on the synchronized reserve market clearing price. PJM Manual 11: Energy & Ancillary Services Market Operations states, “Any generator that is a PJM generation capacity resource that has a Reliability Pricing Model (RPM) or Fixed Resource Requirement (FRR) Resource commitment that is eligible to provide Reserves must offer their 10-minute and 30-minute reserve capability, unless the unit is unavailable due to an approved planned outage, maintenance outage or forced outage.”<sup>65</sup>

Since October 1, 2022, the reserve market design for synchronized reserve includes both day-ahead and real-time markets. Prior to that date, synchronized reserve was only a real-time product.

PJM uses synchronized reserve when PJM calls synchronized reserve events, also called spin events or spinning events.

## Market Structure

For most resources, synchronized reserves consist of any online capacity not being used for energy that can be achieved within 10 minutes from the current dispatch point according to the resource’s ramp rate. The PJM market solves an economic dispatch to determine which, if any, of these resources should be backed down to provide reserves. Some nondispatchable resources can provide synchronized reserves, including storage resources, hydro resources with storage, synchronous condensers, and demand response resources. For both the RTO and the reserve subzone, the day-ahead market clears hourly synchronized reserve assignments and the real-time market clears five-minute synchronized reserve assignments.

## Demand

Demand for the synchronized reserve product comes from the reserve requirement for the synchronized reserve service. The synchronized reserve requirement is equal to the synchronized reserve reliability requirement plus the extended reserve requirement. The synchronized

<sup>65</sup> See PJM, “PJM Manual 11: Energy & Ancillary Services Market Operations,” § 4.2.2 Reserve Resource Offer Requirements, Rev. 133 (Dec. 17, 2024).

reserve reliability requirement is normally equal to the most severe single contingency (MSSC). Figure 10-5 shows an example operating reserve demand curve for synchronized reserve.

In the first four months of 2023, the demand portion of the first step of the ORDC for synchronized reserve was equal to the MSSC. PJM unilaterally increased the extended reserve requirement by 1,588 MW from May 12, 2023, through May 15, 2023. PJM then unilaterally increased the synchronized reserve reliability requirement to 130 percent of the MSSC on May 19, 2023, which increased the effective primary reserve reliability requirement from 150 percent of the MSSC to 195 percent of the MSSC. Since May 19, 2023, the demand portion has been equal to 130 percent of the MSSC. PJM did not increase demand in the MAD Reserve Subzone, only in the RTO Reserve Zone. Figure 10-19 compares the old and new RTO ORDCs with an example MSSC of 1,000 MW.

Figure 10-2 shows a plot of the daily average real-time requirement for synchronized reserve. In 2024, the average real-time synchronized requirement in the RTO Reserve Zone was 2,346.1 MW and the average day-ahead requirement was 2,400.7 MW. In the MAD Reserve Subzone, the average real-time synchronized requirement was 1,773.4 MW and the average day-ahead requirement was 1,773.3 MW.

NERC allows contingency reserves to include “operating reserves – spinning” and “operating reserves – supplemental.” Operating reserves – spinning are fully synchronized generation and interruptible load that can respond within 10 minutes. Operating reserves – supplemental are any resources that qualify as operating reserves – spinning plus nonsynchronized generation that can respond within 10 minutes. ReliabilityFirst (RF) follows NERC’s definition for operating reserves, but RF recommends (but does not require or have the authority to require) for contingency reserves that PJM maintain operating reserves – spinning equal to at least half of the most severe single contingency, that PJM not assign interruptible load as operating reserves – spinning, and that no more than 25 percent of operating reserves – supplemental be interruptible load.<sup>66 67</sup> Figure 10-16

<sup>66</sup> RFC\_Criteria\_BAL-002-02, “Operating Reserves,” August 29, 2012. <[https://www.rfirst.org/wp-content/uploads/2023/10/RFC\\_Criteria\\_BAL-002-02.pdf](https://www.rfirst.org/wp-content/uploads/2023/10/RFC_Criteria_BAL-002-02.pdf)>.

<sup>67</sup> See *id.*, which describes the document as a “ReliabilityFirst Board of Directors approved good utility practice document which are not reliability standards” and notes that “ReliabilityFirst Regional Criteria are not NERC reliability standards, regional reliability standards, or regional variances, and therefore are not enforceable under authority delegated by NERC pursuant to delegation agreements and do not require NERC approval.”

compares cleared primary reserve with the DSR portion of cleared synchronized reserve. In effect, no more than 25 percent of PJM’s contingency reserves can be DSR resources. Prior to October 1, 2022, DSR resources were limited by PJM to being no more than 33 percent of cleared synchronized reserves, but that limitation was removed on October 1, 2022, as part of the changes to the reserve markets.


## Supply

The supply of synchronized reserves consists of all unloaded capacity that can convert to energy in 10 minutes from online resources and all synchronized load that can curtail in 10 minutes. Any of this capacity that is not offered as dispatchable in the energy market does not have a lost opportunity cost in the security constrained economic dispatch (SCED). This includes synchronous condensers, storage resources, and demand response. Synchronous condensers and demand response are also considered inflexible in the reserve market and require an hourly commitment, which is made by the Ancillary Services Optimizer (ASO) in real time. This means that these resources enter the SCED reserves supply curve with a marginal cost of zero because PJM is effectively committing them as must run, block loaded reserves.

In general, a resource’s reserve MW are the lesser of a resource’s 10-minute ramp and the difference between its energy output and its economic maximum output. A generation resource can request a maximum MW value for its synchronized reserve offer that is lower than its economic maximum if that generator’s reserve offer is subject to a physical limitation that cannot be modeled by a segmented hourly ramp rate.<sup>68</sup> Figure 10-10 shows how use of the exception for a lower synchronized reserve maximum MW has grown. If generators in need of the exception request it, PJM should see improved reserve performance due to better calculation of the available reserve MW.


<sup>68</sup> See PJM, “PJM Manual 11: Energy & Ancillary Services Market Operations,” § 4.2.2.1 Communication for Reserve Capability Limitation, Rev. 133 (Dec. 17, 2024).

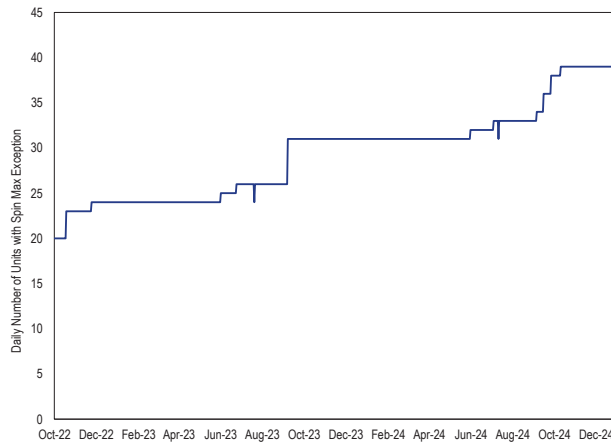**Figure 10-10 Number of units per day allowed to use a spin max less than eco max: October 2022 through December 2024**



In 2024, the average supply of daily offered and eligible synchronized reserve was 5,583.7 MW in the RTO Reserve Zone, of which 2,733.6 MW was located in the MAD Reserve Subzone. Figure 10-11 shows the daily average available synchronized reserve MW.

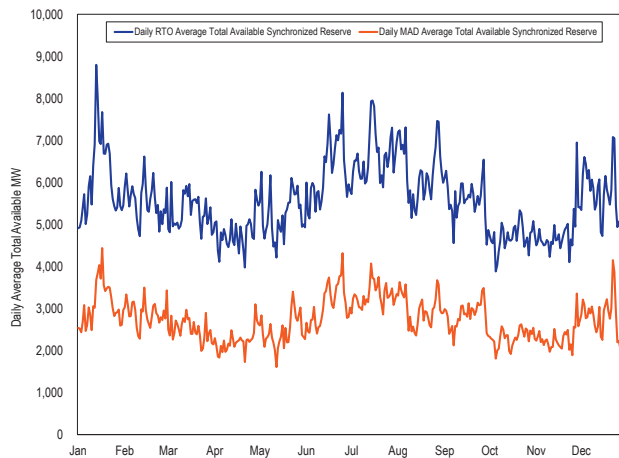**Figure 10-11 Daily Average Available Synchronized Reserve: 2024**



## Market Concentration

Table 10-14 provides the average HHI and the percent of intervals during which the maximum market share was above 20 percent for the day-ahead and real-time synchronized reserve markets for 2024. In 2024, the MAD real-time and day-ahead synchronized reserve markets were moderately concentrated. In 2024, the RTO real-time and day-ahead synchronized reserve markets were unconcentrated.

**Table 10-14 Day-ahead and real-time synchronized reserve average HHI: 2024**

Location	Market	Average HHI	Percent of Intervals		Description
			Max Market Share	Above 20%	
RTO	RT	820		18.4%	Unconcentrated
RTO	DA	893		37.4%	Unconcentrated
MAD	RT	1735		90.5%	Moderately Concentrated
MAD	DA	1589		86.6%	Moderately Concentrated

In 2024, the Ancillary Service Optimizer, which schedules economic inflexible resources while considering all resources against forecasted LMPs, failed the three pivotal supplier test in 4,063 out of 8,236 hours, or 49.3 percent of the total target times.

## Market Behavior


The synchronized reserve offer price must be cost based and is capped at the expected value of the synchronized reserve penalty, which equals the average penalty multiplied by the average rate of nonperformance multiplied by the probability that an event will occur.<sup>69</sup> These values are listed in Table 10-15. For resources that do not provide an offer price, the offer price is treated as \$0 per MWh. In 2024, the weighted average offer price for generators that set their offer MW was \$0.01 per MWh. In 2024, the weighted average offer price for DSR resources that set their offer MW was \$0.02 per MWh.

<sup>69</sup> See PJM, "PJM Manual 15: Cost Development Guidelines," § 4.7 Synchronized Reserve, Rev. 45 (Sept. 1, 2024).

**Table 10-15 Expected values of the synchronized reserve penalty: 2023 through 2024<sup>70</sup>**

Year	Month	Value of Expected Penalty (\$/MWh)
2023	Jan	\$0.14
2023	Feb	\$0.11
2023	Mar	\$0.09
2023	Apr	\$0.07
2023	May	\$0.06
2023	Jun	\$0.06
2023	Jul	\$0.06
2023	Aug	\$0.05
2023	Sep	\$0.05
2023	Oct	\$0.04
2023	Nov	\$0.04
2023	Dec	\$0.04
2024	Jan	\$0.04
2024	Feb	\$0.04
2024	Mar	\$0.04
2024	Apr	\$0.04
2024	May	\$0.04
2024	Jun	\$0.04
2024	Jul	\$0.04
2024	Aug	\$0.04
2024	Sep	\$0.04
2024	Oct	\$0.04
2024	Nov	\$0.04
2024	Dec	\$0.04

Figure 10-12 shows the average supply of synchronized reserve MW seen by the ASO based on the effective offers for the interval. A generator's effective offer is the sum of the generator's offer price, energy use cost, and the absolute value of the product substitution cost. A DSR resource's effective offer is equal to the offer price. Figure 10-12 also shows the average synchronized reserve requirement across all intervals used by the ASO and the maximum average supply of synchronized reserve MW using the highest effective offer.

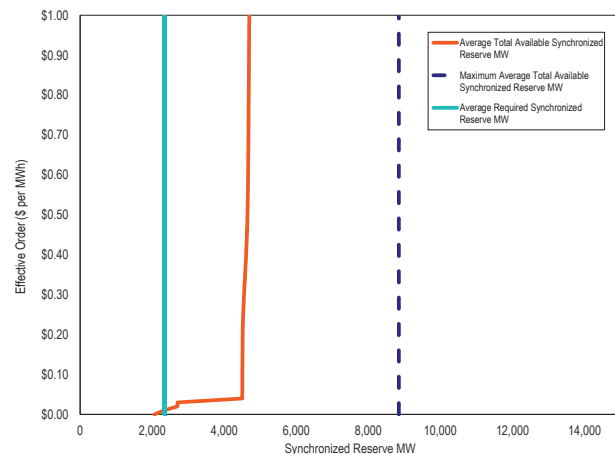**Figure 10-12 Average total available MW by effective offer: 2024**

70 PJM. Synchronized Reserve Offer Cap Penalty, Dec. 3, 2024. <<https://www.pjm.com/-/media/markets-ops/ancillary/synchronized-reserve-offer-cap-penalty.ashx>>.

## Market Performance

In 2024, the real-time RTO weighted average synchronized reserve market clearing price (SRMCP) was \$3.20 per MWh and the day-ahead RTO weighted average SRMCP was \$2.80 per MWh. The real-time MAD weighted average SRMCP was \$3.41 per MWh and the day-ahead MAD weighted average SRMCP was \$3.04 per MWh. The real-time RTO SRMCP was \$0 per MWh in 11,720 out of all 105,408 five-minute intervals (11.1 percent of the total). The real-time MAD SRMCP was \$0 per MWh in 10,610 out of all 105,408 five-minute intervals (10.1 percent of the total).

Figure 10-13 shows the daily unweighted average prices for synchronized reserve in the real-time and day-ahead markets. Higher prices on January 16 and January 17 were a result of conservative operations for cold weather during Winter Storm Gerri. Higher prices on March 10, April 14, and May 21 corresponded with shortage pricing for primary reserve in the RTO Reserve Zone, though there were no intervals with shortage pricing for synchronized reserve during that time. Higher prices on June 3 were a result of shortage pricing for synchronized reserve and primary reserve used during a spinning event. Higher prices in July correspond with hot weather alerts, spin events, and shortage pricing on July 28. Higher prices in August correspond with hot weather alerts. Higher prices on September 4 are due to shortage pricing for synchronized reserve. Higher prices on October 14, October 15, and November 22 correspond with shortage pricing for primary reserve. Higher prices on November 6 are due to conservative operations. Higher prices on December 12 and December 13 occurred during cold weather alerts.

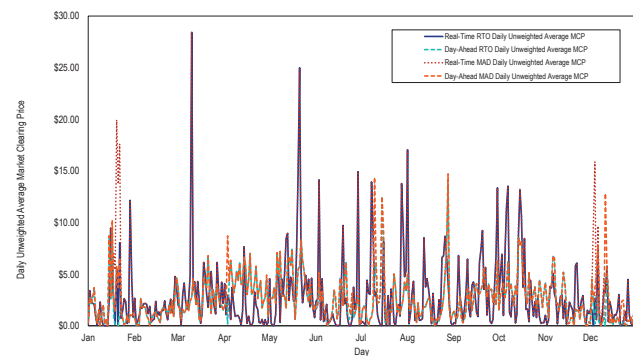
**Figure 10-13 Day-ahead and real-time synchronized reserve average market clearing prices: 2024**

Table 10-16 and Table 10-17 compare the dispatch run and pricing run weighted average prices for the day-ahead and real-time markets. For the real-time values, these are the LPC prices weighted using the RT SCED MW. For the day-ahead values, these are the DA prices weighted using the DA dispatch MW. PJM dispatchers can update assignments after RT SCED has run, so these weights differ from the weighted average value reported elsewhere in this section.<sup>71</sup>

**Table 10-16 Day-ahead and real-time fast start pricing in the RTO synchronized reserve market: 2023 through 2024**

Year	Month	Day-Ahead				Real-Time			
		Dispatch-Run MCP	Pricing-Run MCP	Difference	Percent Difference	Dispatch-Run MCP	Pricing-Run MCP	Difference	Percent Difference
2023	Jan	\$0.34	\$0.35	\$0.02	4.8%	\$0.78	\$0.96	\$0.18	22.9%
2023	Feb	\$0.33	\$0.36	\$0.03	9.4%	\$0.10	\$0.20	\$0.10	107.3%
2023	Mar	\$0.33	\$0.35	\$0.01	4.4%	\$0.15	\$0.26	\$0.11	68.9%
2023	Apr	\$1.60	\$1.64	\$0.04	2.5%	\$0.64	\$1.22	\$0.58	90.8%
2023	May	\$4.83	\$4.82	(\$0.02)	(0.3%)	\$4.51	\$6.16	\$1.65	36.6%
2023	Jun	\$1.94	\$1.96	\$0.02	1.0%	\$0.55	\$0.99	\$0.44	80.6%
2023	Jul	\$4.71	\$4.79	\$0.08	1.7%	\$1.00	\$1.64	\$0.64	64.4%
2023	Aug	\$1.26	\$1.32	\$0.06	4.4%	\$0.35	\$0.54	\$0.20	56.6%
2023	Sep	\$1.26	\$1.32	\$0.05	4.3%	\$0.50	\$0.68	\$0.18	36.1%
2023	Oct	\$9.60	\$9.65	\$0.05	0.5%	\$3.02	\$4.70	\$1.69	55.9%
2023	Nov	\$5.59	\$5.69	\$0.09	1.7%	\$1.21	\$1.85	\$0.64	52.8%
2023	Dec	\$1.31	\$1.34	\$0.03	2.6%	\$1.16	\$1.65	\$0.49	41.8%
2023	All	\$3.07	\$3.11	\$0.04	1.4%	\$1.24	\$1.84	\$0.61	49.1%
2024	Jan	\$1.69	\$1.72	\$0.03	1.9%	\$1.98	\$2.53	\$0.55	28.0%
2024	Feb	\$1.49	\$1.50	\$0.00	0.3%	\$1.29	\$1.82	\$0.53	40.9%
2024	Mar	\$2.72	\$2.74	\$0.02	0.8%	\$2.69	\$3.88	\$1.19	44.3%
2024	Apr	\$4.14	\$4.15	\$0.01	0.2%	\$0.99	\$1.54	\$0.55	55.1%
2024	May	\$4.29	\$4.28	(\$0.01)	(0.2%)	\$3.28	\$4.99	\$1.72	52.4%
2024	Jun	\$2.02	\$2.13	\$0.11	5.5%	\$2.29	\$2.56	\$0.27	11.8%
2024	Jul	\$2.63	\$2.80	\$0.17	6.3%	\$3.00	\$3.69	\$0.69	23.0%
2024	Aug	\$2.33	\$2.44	\$0.11	4.7%	\$2.81	\$3.44	\$0.62	22.2%
2024	Sep	\$2.72	\$2.82	\$0.11	3.9%	\$2.77	\$3.73	\$0.96	34.8%
2024	Oct	\$4.01	\$4.10	\$0.09	2.1%	\$3.62	\$4.45	\$0.82	22.7%
2024	Nov	\$2.13	\$2.18	\$0.05	2.4%	\$1.32	\$2.22	\$0.90	68.1%
2024	Dec	\$0.92	\$0.95	\$0.03	3.0%	\$1.16	\$1.64	\$0.48	40.9%
2024	All	\$2.59	\$2.65	\$0.06	2.3%	\$2.29	\$3.08	\$0.79	34.2%

**Table 10-17 Day-ahead and real-time fast start pricing in the MAD synchronized reserve market: 2023 through 2024**

Year	Month	Day-Ahead				Real-Time			
		Dispatch-Run MCP	Pricing-Run MCP	Difference	Percent Difference	Dispatch-Run MCP	Pricing-Run MCP	Difference	Percent Difference
2023	Jan	\$0.34	\$0.35	\$0.01	2.8%	\$1.22	\$1.12	(\$0.09)	(7.5%)
2023	Feb	\$1.09	\$1.17	\$0.09	8.0%	\$0.63	\$0.70	\$0.08	12.5%
2023	Mar	\$0.41	\$0.43	\$0.02	3.9%	\$0.16	\$0.25	\$0.09	53.5%
2023	Apr	\$1.69	\$1.73	\$0.04	2.4%	\$0.56	\$1.04	\$0.48	85.2%
2023	May	\$4.79	\$4.78	(\$0.01)	(0.3%)	\$4.73	\$6.30	\$1.58	33.3%
2023	Jun	\$2.00	\$2.03	\$0.02	1.2%	\$0.53	\$0.93	\$0.40	74.4%
2023	Jul	\$4.31	\$4.40	\$0.08	1.9%	\$0.90	\$1.44	\$0.54	60.4%
2023	Aug	\$1.34	\$1.40	\$0.06	4.3%	\$0.37	\$0.56	\$0.19	52.3%
2023	Sep	\$1.30	\$1.36	\$0.06	4.2%	\$0.51	\$0.65	\$0.14	26.9%
2023	Oct	\$9.73	\$9.77	\$0.05	0.5%	\$3.25	\$4.80	\$1.55	47.9%
2023	Nov	\$5.43	\$5.53	\$0.09	1.7%	\$1.29	\$1.94	\$0.65	50.3%
2023	Dec	\$1.55	\$1.58	\$0.04	2.4%	\$1.30	\$1.78	\$0.48	36.4%
2023	All	\$3.36	\$3.40	\$0.05	1.4%	\$1.41	\$1.99	\$0.58	40.8%
2024	Jan	\$2.63	\$2.68	\$0.05	1.8%	\$3.59	\$4.22	\$0.63	17.5%
2024	Feb	\$1.64	\$1.65	\$0.00	0.3%	\$1.37	\$1.89	\$0.53	38.4%
2024	Mar	\$2.85	\$2.87	\$0.02	0.7%	\$2.69	\$3.81	\$1.12	41.7%
2024	Apr	\$4.37	\$4.38	\$0.01	0.3%	\$0.93	\$1.41	\$0.48	51.3%
2024	May	\$4.19	\$4.18	(\$0.00)	(0.1%)	\$3.19	\$4.73	\$1.54	48.4%
2024	Jun	\$2.34	\$2.41	\$0.07	2.8%	\$2.59	\$2.83	\$0.24	9.1%
2024	Jul	\$3.10	\$3.30	\$0.20	6.5%	\$2.81	\$3.40	\$0.59	21.0%
2024	Aug	\$2.43	\$2.56	\$0.13	5.3%	\$3.19	\$3.82	\$0.63	19.9%
2024	Sep	\$2.89	\$3.00	\$0.11	3.8%	\$2.91	\$3.95	\$1.04	35.8%
2024	Oct	\$3.94	\$4.02	\$0.08	2.0%	\$3.73	\$4.49	\$0.76	20.3%
2024	Nov	\$2.20	\$2.25	\$0.05	2.3%	\$1.37	\$2.23	\$0.86	62.5%
2024	Dec	\$2.57	\$2.60	\$0.03	1.2%	\$2.76	\$3.28	\$0.52	18.9%
2024	All	\$2.98	\$3.04	\$0.06	2.0%	\$2.64	\$3.41	\$0.76	28.8%

<sup>71</sup> See PJM, "PJM Manual 01: Control Center and Data Exchange Requirements," § 1.7 Dispatch Management Tool (DMT), Rev. 48 (Sep. 25, 2023).



Figure 10-14 shows the dispatch run synchronized reserve RTO market clearing prices of the day-ahead software (DA), the hour-ahead software (ASO), and the real-time software (RT SCED). The pricing-run market clearing prices, calculated by the LPC, are in Figure 10-13. As seen in Figure 10-14, there can be significant differences in the clearing prices. Because the ASO's clearing is used by RT SCED, it is possible for a lower MCP in the ASO to prevent an inflexible resource from being cleared in real time, even when its bid price is lower than MCP calculated by RT SCED and by the LPC.

**Figure 10-14 Dispatch run synchronized reserve market clearing prices from the day-ahead software, the ASO, and RT SCED: 2024**

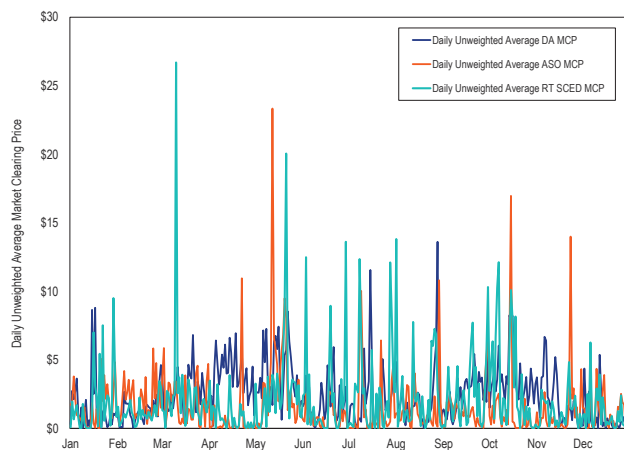


Table 10-18 shows total synchronized reserve payments by month for January 2023 through December 2024. Balancing credits for all but four months are negative, because, on average, resources buy back their day-ahead positions at higher real-time prices. LOC credits are paid to cover negative balancing credits if PJM converted a resource's day-ahead reserve position to energy in the real-time market. LOC credits are also paid to inflexible reserves when prices do not cover their opportunity costs. Shortfall charges are incurred by resources that do not provide their cleared reserve positions in real time. In Table 10-18, the only months with synchronized reserve events that lasted for 10 or more minutes were January 2023, December 2023, February 2024, July 2024, August 2024, and November 2024, so there are no shortfall charges possible outside of those months. Day-ahead credits were larger in May 2023 due to shortage pricing from PJM's unilateral change in the reserve requirements. Day-ahead credits were larger in

July 2023 due to higher prices during hot weather alerts on July 28 and July 29. Day-ahead credits were larger in October 2023 and November 2023 due to higher, more volatile prices corresponding to tighter supply and a change in how condensers cleared. Day-ahead credits were larger in April and May 2024, corresponding with higher requirements in April and lower supply in May.

**Table 10-18 Total payments and charges by month: 2023 through 2024**

Year	Month	Total Day-Ahead Credits	Total Balancing MCP Credits	Total LOC Credits	Total Shortfall Charges	Total Credits
2023	Jan	\$505,431	(\$114,068)	\$946,432	\$336,246	\$1,001,549
2023	Feb	\$735,351	\$99,577	\$488,214	\$0	\$1,323,142
2023	Mar	\$439,364	(\$5,172)	\$739,554	\$0	\$1,173,746
2023	Apr	\$2,088,876	\$55,121	\$700,991	\$0	\$2,844,988
2023	May	\$8,590,787	(\$1,102,233)	\$1,519,309	\$0	\$9,007,863
2023	Jun	\$4,061,466	(\$136,555)	\$505,132	\$0	\$4,430,044
2023	Jul	\$10,125,951	(\$209,684)	\$840,369	\$0	\$10,756,637
2023	Aug	\$2,822,099	(\$101,170)	\$585,730	\$0	\$3,306,658
2023	Sep	\$2,808,344	(\$352,447)	\$763,461	\$0	\$3,219,358
2023	Oct	\$21,150,975	(\$806,826)	\$1,026,062	\$0	\$21,370,211
2023	Nov	\$11,822,028	(\$959,271)	\$635,741	\$0	\$11,498,499
2023	Dec	\$2,843,149	(\$313,929)	\$628,588	\$80,447	\$3,077,361
2023	All	\$67,993,820	(\$3,946,658)	\$9,379,585	\$416,692	\$73,010,055
2024	Jan	\$4,327,646	(\$426,107)	\$1,144,741	\$0	\$5,046,280
2024	Feb	\$2,894,089	(\$98)	\$536,025	\$19,515	\$3,410,501
2024	Mar	\$5,930,989	(\$297,375)	\$1,078,487	\$0	\$6,712,102
2024	Apr	\$9,018,149	(\$907,004)	\$594,268	\$0	\$8,705,412
2024	May	\$9,477,497	(\$169,439)	\$1,260,078	\$0	\$10,568,136
2024	Jun	\$4,594,840	(\$602,073)	\$788,610	\$0	\$4,781,377
2024	Jul	\$5,994,640	\$88,604	\$1,400,608	\$508,031	\$6,975,821
2024	Aug	\$5,015,123	(\$203,403)	\$1,001,664	\$22,653	\$5,790,731
2024	Sep	\$5,792,899	(\$174,272)	\$913,531	\$0	\$6,532,157
2024	Oct	\$6,502,979	(\$238,832)	\$1,154,336	\$0	\$7,418,483
2024	Nov	\$3,503,209	\$23,756	\$600,313	\$13,867	\$4,113,411
2024	Dec	\$3,463,659	(\$93,407)	\$681,863	\$0	\$4,052,116
2024	All	\$66,515,719	(\$2,999,649)	\$11,154,522	\$564,066	\$74,106,527


Table 10-19 provides the day-ahead and real-time synchronized reserve by resource type and fuel type for 2024. For synchronized reserve, the MW for which a resource is credited at the market clearing price is capped at the lesser of its real-time assignment and the difference between its real-time output and the lesser of its economic maximum and its real-time reserve maximum. During spin events, this capped value is equal to the cleared MW. As it is this capped value for which a resource is credited, Table 10-19 only shows the capped value, excluding the additional cleared MW.

**Table 10-19 Day-ahead and real-time synchronized reserve by resource type and fuel type: 2024**

Resource / Fuel Type	Day-Ahead MWh	Real-Time Capped MWh	Day-Ahead Credits	Balancing MCP Credits	LOC Credits	Shortfall Charges	Total Credits
Combined Cycle	11,293,671	7,467,937	\$28,352,268	(\$10,119,320)	\$4,310,633	\$172,807	\$22,370,774
CT - Natural Gas	2,021,203	3,022,332	\$13,453,797	\$2,867,238	\$2,613,588	\$224,340	\$18,710,284
DSR	1,462,985	3,433,960	\$5,289,092	\$4,511,955	\$1,219,641	\$7,548	\$11,013,140
Steam - Coal	5,327,995	5,255,510	\$8,194,962	\$756,854	\$1,621,484	\$97,221	\$10,476,079
CT - Oil	417,126	523,362	\$2,401,614	\$261,913	\$346,811	\$16	\$3,010,322
Hydro - Run of River	1,006,597	928,017	\$2,085,978	\$433,431	\$46,803	\$2,231	\$2,563,981
Hydro - Pumped Storage	1,234,145	746,633	\$3,855,013	(\$1,677,174)	\$214,633	\$17,025	\$2,375,447
Steam - Natural Gas	519,438	746,741	\$1,306,916	\$690,522	\$382,528	\$21,328	\$2,358,637
RICE - Other	309,829	181,736	\$796,623	(\$417,692)	\$117,663	\$11,726	\$484,868
Steam - Other	101,694	19,702	\$194,406	(\$126,343)	\$189,310	\$266	\$257,107
RICE - Natural Gas	42,157	12,728	\$430,246	(\$230,104)	\$53,296	\$125	\$253,314
Other	42,816	56,070	\$154,804	\$49,071	\$38,132	\$9,433	\$232,574


Before the October 1, 2022, changes, DSR was limited to 33 percent of the cleared synchronized reserves. This limitation was removed. In 2024, DSR was more than 33 percent of the cleared synchronized reserves in 871 of 105,408 five-minute intervals. In all of the 871 intervals, DSR exceeded 33 percent of the real-time MW, but not of the day-ahead MW. During these 871 intervals, on average, DSR made up 35.9 percent of the synchronized reserve MW. Figure 10-15 shows the portion of synchronized reserve provided by DSR. Since September 2023, there has been an increase in the use of DSR, but not enough to frequently exceed the former limit.

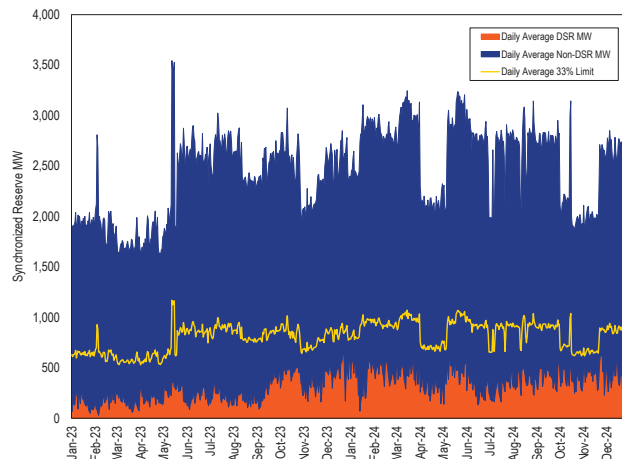**Figure 10-15 Daily average synchronized reserve from DSR and non-DSR: 2023 through 2024**



ReliabilityFirst's regional criteria recommend that DSR be no more than 25 percent of contingency reserve, which PJM implements as primary reserve.<sup>72</sup> Figure 10-16 shows the daily average DSR percentage of primary reserve, which PJM purchases as synchronized reserve. In 2024, the amount of cleared DSR exceeded 25 percent of the amount of cleared primary reserve in 121 intervals. During those intervals, the average percent of primary reserve that was DSR was 28.1 percent.

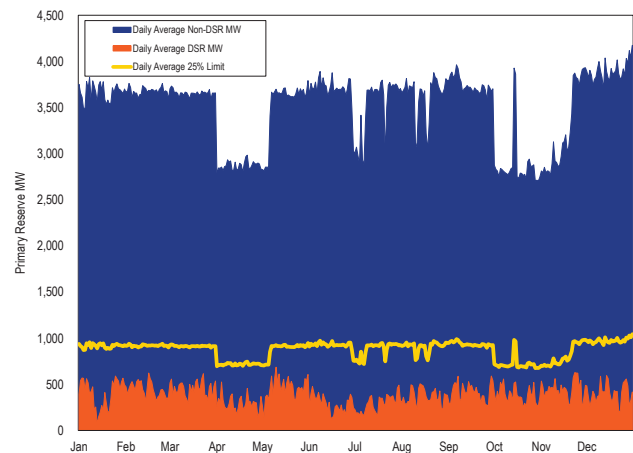**Figure 10-16 Comparison of daily average cleared primary reserve and daily average cleared DSR: 2024**



<sup>72</sup> RFC\_Criteria\_BAL-002-02. "Operating Reserves," August 29, 2012. <[https://rfirst.org/ProgramAreas/Standards/Criteria/Regional%20Criteria%20Library/RFC\\_Criteria\\_BAL-002-02.pdf](https://rfirst.org/ProgramAreas/Standards/Criteria/Regional%20Criteria%20Library/RFC_Criteria_BAL-002-02.pdf)>.

## Synchronized Reserve Performance

Resources providing synchronized reserves are paid for being available to respond to a synchronized reserve event and not for the actual response. Synchronized reserve resources are paid for their output in the energy market when they respond to an event.

Actual synchronized reserve event response is determined by final output minus initial output where final output is the largest output between 9 and 11 minutes after the start of the event, and initial output is the lowest output between one minute before and one minute after the start of the event.<sup>73</sup> Cleared synchronized reserve resources are obligated to sustain their final output for the shorter of the length of the event or 30 minutes. The owner of a cleared resource is penalized if it fails to perform during any synchronized reserve event lasting 10 minutes or longer, although the resource owner can use overperformance from another resource to offset those losses. As synchronized reserve resources are allowed 10 minutes to ramp up to their cleared output, performance penalties are not assessed for events lasting less than 10 minutes.

Table 10-20 shows synchronized reserve event response compliance for events that lasted 10 minutes or longer, using only response from cleared synchronized reserves. In 2023, three events were 10 minutes or longer. In 2024, five events were 10 minutes or longer. Of those five reserve events, four were due to unit losses and one was due to low ACE. Of those five reserve events, only one was associated with a DCS event. For all other DCS events, any associated reserve event lasted less than 10 minutes.

Actual synchronized reserve response is the total increase in MW from all resources from the moment the spinning event is called to 10 minutes after. The overall response to spinning events was adequate or more than adequate to meet NERC requirements, in which the Reporting ACE must return to the lesser of zero and the value of the Reporting ACE before the disturbance that caused the event.<sup>74</sup> PJM, in practice, not only corrects the Reporting ACE disturbance that led to the event but over corrects. In three of the five spinning events of 10 minutes or longer in 2024, the Reporting ACE recovered not just to the NERC required level of zero but overshoot by over approximately 1,000 MW.

<sup>73</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.2.10 Settlements, Rev. 133 (Dec. 17, 2024).

<sup>74</sup> See PJM, "PJM Manual 12: Balancing Operations," Rev. 54(Dec. 17, 2024) Attachment D.

Table 10-20 Response compliance for synchronized reserve events 10 minutes or longer: 2023 through 2024<sup>75</sup>

Spin Event	Duration (Minutes)	Resource/Fuel Type	Total Capped		Total Synchronized Reserve Resource Shortfall (MW)	Synchronized Reserve Response Percent
			Total Synchronized Reserve Scheduled (MW)	Synchronized Reserve Resource Response (MW)		
05-Jan-2023 1243 (EPT)	11.6	Combined Cycle	586	354	232	60%
		Steam - Coal	410	143	267	35%
		Steam - Natural Gas	83	59	24	71%
		Other	635	456	178	72%
		Total	1,714	1,012	702	59%
10-Jan-2023 0706 (EPT)	17.5	Combined Cycle	563	207	356	37%
		CT - Natural Gas, Oil	738	328	410	44%
		DSR	370	227	144	61%
		Steam - Coal	352	243	109	69%
		Steam - Other	64	19	45	29%
		Other	281	274	7	98%
14-Dec-2023 1941 (EPT)	12.3	Total	2,368	1,297	1,071	55%
		Combined Cycle	770	303	467	39%
		CT - Natural Gas	432	69	363	16%
		DSR	488	411	77	84%
		Steam - Coal	535	278	257	52%
		Steam - Other	37	22	15	60%
		Other	450	355	96	79%
24-Feb-2024 1548 (EPT)	12.3	Total	2,712	1,437	1,275	53%
		Combined Cycle	925	579	347	63%
		CT - Natural Gas	445	34	411	8%
		DSR	262	20	243	7%
		Steam	774	28	747	4%
		Other	544	67	477	12%
08-Jul-2024 1757 (EPT)	14.5	Total	2,951	727	2,225	25%
		Combined Cycle	701	237	463	34%
		CT - Natural Gas, Oil	1,535	696	838	45%
		Hydro	261	212	49	81%
		Steam - Coal	465	202	263	43%
		Steam - Other	133	29	104	22%
		Other	141	101	39	72%
21-Jul-2024 1753 (EPT)	10.2	Total	3,234	1,479	1,755	46%
		Combined Cycle	560	356	203	64%
		CT - Natural Gas	494	327	167	66%
		DSR	553	533	20	96%
		Hydro	168	130	38	77%
		Steam - Coal	530	415	116	78%
		Other	74	5	69	7%
18-Aug-2024 1604 (EPT)	15.9	Total	2,379	1,766	613	74%
		Combined Cycle	318	230	88	72%
		DSR	529	477	51	90%
		Hydro	366	156	210	43%
		Steam - Coal	525	417	107	80%
		Other	207	61	146	30%
10-Nov-2024 0020 (EPT)	10.8	Total	1,945	1,342	603	69%
		Combined Cycle	555	322	233	58%
		DSR	481	451	30	94%
		Hydro	305	287	18	94%
		Steam - Coal	553	421	132	76%
		Other	26	3	24	10%
		Total	1,919	1,483	436	77%

<sup>75</sup> Results for identified technologies shown only if they are consistent with PJM confidentiality rules.


In 2024, compliance with calls to respond to the single synchronized reserve event was significantly less than 100 percent. Table 10-21 shows the average amount of cleared synchronized reserve MW that responded to events 10 minutes or longer from January 2017 through December 2024. PJM experienced five synchronized reserve event longer than 10 minutes in 2024, of which one applied only to the MAD Reserve Subzone.

**Table 10-21 Average synchronized reserve response for events longer than 10 minutes: 2017 through 2024**


Year	No. of Events Longer than 10 Minutes	Average Percent of Scheduled Synchronized Reserve MW that Responded
2017	6	87.6%
2018	8	74.2%
2019	3	86.8%
2020	5	59.5%
2021	5	83.1%
2022 (Jan - Sep)	3	71.2%
2022 (Oct - Dec)	7	50.3%
2023	3	55.6%
2024	5	58.2%

In the first nine months of 2022, cleared synchronized reserve was provided by tier 2 synchronized reserves, which were cleared when the estimated response from tier 1 resources was insufficient to cover the requirement. Since October 1, 2022, the requirement is fully met by cleared resources that offer the new synchronized reserve product. Figure 10-17 shows the distribution of resources cleared for synchronized reserve from January 2022 through December 2023, representing approximately 900 resources. Figure 10-18 shows the totals by resource type of the average available synchronized reserve MW from all resources offering tier 2 synchronized reserve and all resources with available synchronized reserve under the new market structure. Figure 10-17 shows that different resource types have made up the bulk of cleared synchronized reserve since the October 1 changes. Many of the resources that have cleared since October 1, 2022, did not clear in the nine months prior to the change. Therefore, resource performance during synchronized reserve events from before and after the change are not directly comparable. Figure 10-18 supports that much of the poor performance seen in the months following the switch is a result of a change of which resources are cleared, not a change by specific resources.

**Figure 10-17 Cleared synchronized reserves by type: 2022 through 2023**

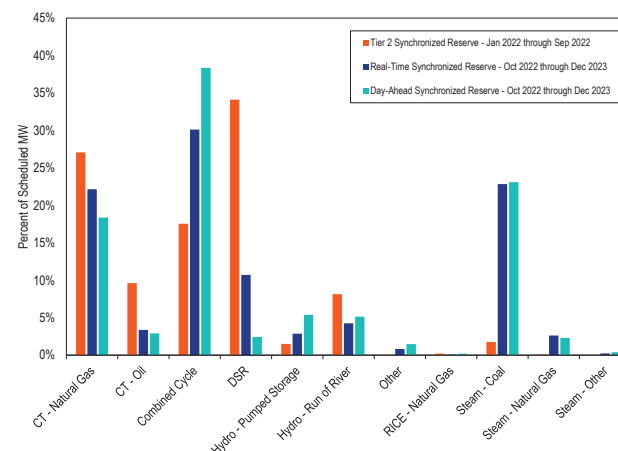

**Figure 10-18 Total average available synchronized reserve from offering resources by type: 2022 through 2023**

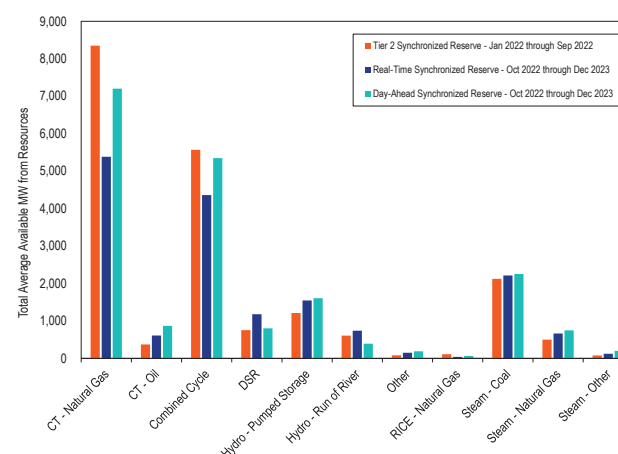

Although resources are required to fully respond within 10 minutes, resources do not necessarily have a full 10 minutes to respond. PJM schedules reserve MW with the expectation that resources will start responding as soon as an event begins, but this expectation fails to consider communication delays that result from how a resource's market operation center (MOC) notifies the resource of events. When a MOC receives PJM's ALL-CALL, it can take several minutes for the MOC to acknowledge the call and to contact the appropriate resources, which then can take minutes more to start responding.

The MMU recommends that to minimize lag, PJM use an electronic synchronized reserve event notification process for all resources and that all resources be



required to have the ability to receive and respond to the notifications. PJM currently has an optional inter-control room connection protocol (ICCP) signal that some control rooms use, but it was not widely used in 2023 and 2024. This or another form of electronic signal should be required for all resources. Stakeholders approved a joint PJM/MMU proposal to implement an electronic communications and reserve deployment process on July 24, 2024. On December 17, 2024, PJM implemented changes to augment the SCED dispatch signal to include reserve response during reserve events. However, this new process is not required for all synchronized reserve resources and does not replace the ALL-CALL. The new process mainly benefits units that automatically respond to the dispatch signal, such as by following AGC. Between December 17, 2024 and the end of 2024, there were no events lasting 10 or more minutes with which to sufficiently test the augmented dispatch signal.

The penalty structure when a resource fails to respond fully to a spinning event has two components. The first component is, for each interval during the day on which the event occurred, the forfeiture of awarded SRMCP credits in the amount of the lesser of the resource's capped synchronized reserve assignment during that interval and the resource's maximum shortfall MW during that day. The second component is a required return of SRMCP credits paid in the Immediate Past Interval (IPI), equal to the sum of, for each scheduled interval within the IPI, the SRMCP multiplied by the lesser of a resource's capped MW assignment during the penalized interval and the resource's penalty obligation for the day of the event. The IPI is calculated as the average time, in number of days, since the start of the previous event over the previous two years or, if less, the number of days since the resource last failed to fully respond. For example, the maximum IPI effective January 1, 2024, is 18 days and was calculated using the events from November 1, 2021 through October 31, 2023.<sup>76</sup>

There are several problems with this penalty structure.<sup>77</sup> First, resource owners are permitted to aggregate the response of multiple cleared reserve resources

within the same portfolio, allowing owners to reduce the penalty obligation of a resource's underresponse by offsetting it with another scheduled resource's overresponse.<sup>78</sup> Second, the maximum IPI is calculated using events of any length, even though a resource is automatically considered compliant for events less than 10 minutes in length, artificially shortening the applied IPI significantly. Third, the historical component of the penalty only applies to a resource's SRMCP credits, but not to LOC credits, even though a large portion of credits is awarded for LOC. For the five events that lasted for 10 or more minutes in 2024, for each resource interval in which the resource's penalty obligation MW was greater than or equal to the resource's capped MW during the penalized interval, the total historical penalty was \$716,389 and the total LOC credit was \$124,409.

The penalty structure for synchronized reserve nonperformance does not provide appropriate or reasonable performance incentives. Under the current penalty structure and due to the low frequency of sufficiently long events, it is possible for a resource to not respond to any spin events and yet still receive net revenues for providing synchronized reserve. The MMU continues to recommend that the penalty's repayment include the LOC credits in addition to the SRMCP credits. The MMU also recommends that a unit that fails to respond to a synchronized reserve event 10 minutes or longer repay all credits back to the last time that the unit successfully responded to an event 10 minutes or longer. A resource should not be paid for reserves that it does not provide.

The MMU also continues to recommend that aggregation not be permitted to offset resource specific penalties for failure to respond to a synchronized reserve event. Including aggregate responses from all cleared resources weakens the incentive to perform and creates an incentive to withhold reserves from other resources. Synchronized reserve commitment is resource specific, so the obligation to respond should also be resource specific.

Table 10-22 shows the possible total historical penalty if the historical penalty had been defined differently in a single aspect for 2024. It compares the status quo, the amount if the IPI was defined using only events of 10 or more minutes, the amount if LOC credits were penalized

<sup>76</sup> See "2023 Third Quarter Synchronized Reserve Performance," PJM presentation to the Operations Committee. (December 7, 2023) <<https://www.pjm.com/-/media/committees-groups/committees/oc/2023/20231207/20231207-item-07---synchronous-reserve-update.ashx>>.

<sup>77</sup> See "IMM Proposal: Reserve Deployment and Compensation," IMM presentation to the Reserve Certainty Senior Task Force. (March 13, 2024) <<https://pjm.com/-/media/committees-groups/task-forces/rstf/2024/20240313/20240313-item-02---imm-proposal---deployment-and-compensation.ashx>>.

<sup>78</sup> See PJM, "PJM Manual 28: Operating Agreement Accounting," § 6.3 Charges for Synchronized Reserve, Rev. 98 (Dec. 17, 2024).

in an amount proportionate to the shortfall, and if aggregate response were not allowed. As can be seen in the table, the values are similar for the status quo, for penalizing LOC credits, and for disallowing aggregate response. The effect of only using 10-minute events is larger due to the amount of time between the 10-minute events on February 24 and July 8, increasing the amount of time since resources could have last failed to perform.

**Table 10-22 Comparison of historical/retroactive penalties using possible different definitions: 2024**

Description	Total Retroactive Penalty
Status Quo	\$1,437,837
Using only 10-minute events for IPI	\$3,967,670
Including LOC credits in retroactive penalty	\$1,705,407
Disallowing aggregate response	\$1,465,106
All three changes	\$4,606,472

Resources should not be paid for reserves that they do not provide. The MMU recommends reclaiming credits back to the last known fully compliant performance, while providing the opportunity to demonstrate performance between events. Resources do not control when PJM calls 10-minute events, nor do they control whether they are scheduled during the few 10-minute events that PJM calls. While actual performance is the key to not being penalized, those factors contribute to defining penalties for many resources. The solution is not to arbitrarily limit the penalized period, as PJM does with its IPI, but to instead provide opportunities, between events, for resources to demonstrate that they are capable of providing reserves.


## PJM's 2023 Response to Poor Performance

In 2023, for the three events that were 10 or more minutes, the average response of synchronized reserve resources was 55.6 percent (Table 10-20). In May 2023, in response to poor reserve performance since the market changes made on October 1, 2022, PJM made two unilateral decisions without approval from stakeholders or FERC. On May 12, 2023, PJM inappropriately increased the extended reserve requirement by 1,588 MW and on May 15, 2023, PJM reversed the increase. On May 19, 2023, PJM inappropriately increased the synchronized reserve reliability requirement by 30 percentage points to 130 percent of the MSSC.

Figure 10-19 compares, for an example MSSC of 1,000 MW, the initial synchronized reserve ORDC from before these changes, the intermediate ORDC with the extension


to the second step, and the new ORDC with the increase in the first step.

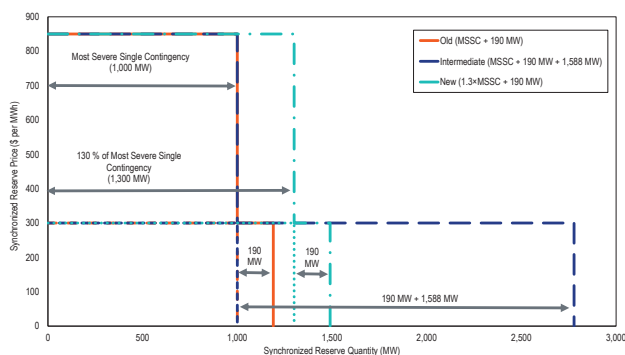**Figure 10-19 An example comparison of the old, intermediate, and new real-time synchronized reserve ORDCs**



Because the definitions of the reserve reliability requirements are nested, PJM's increase to the synchronized reserve reliability requirement also increased the primary reserve reliability requirement, whose increase in turn increased the 30-minute reserve reliability requirement. Figure 10-20 shows the new ORDCs of the three reserve services using an example MSSC of 1,000 MW and the default 190 MW for the extended requirements. Figure 10-5 shows the original ORDCs for the same example MSSC. As seen in Figure 10-2, and although not shown in Figure 10-20, due to the increase, the 30-minute reserve requirement is now usually equal to the primary reserve requirement.

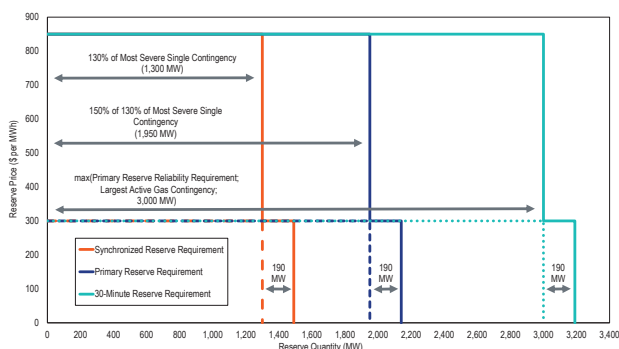**Figure 10-20 An example of the reserve services' new real-time operating reserve demand curves, including the permanent second steps**



PJM did not have the authority to increase the extended reserve requirements without a hot or cold weather alert or an emergency condition. The most common cause

of doubled synchronized reserve requirement in the first four months of 2023 and in prior years was the possibility of large units tripping or being disconnected while undergoing maintenance work, which is a clear increase in the size of the most severe single contingency.

The doubling of the requirement for May 12 to May 16, 2023, lead to 31 intervals of shortage pricing for synchronized reserve and primary reserve in the RTO, even though, based on the actual contingencies, both services cleared well in excess of what was actually needed. In addition, because there was no spin event on either May 12 or May 15, it is unknown whether the response that could have been gained by this increase in demand justified these higher prices.

After making these changes, PJM later modified Manual 11 to allow “temporarily” increasing contingency reserve requirements “as necessary to account for resource performance.”<sup>79</sup> Neither temporary nor resource performance criteria are specified. Furthermore, PJM already clears additional 10-minute reserve in the form of nonsynchronized reserve. PJM had and continues to have the option to use all 10-minute reserve that it clears for recovering within 10 minutes, but instead chooses to increase the amount of all 10-minute reserve that PJM clears, even though it only ever uses a subset.<sup>80</sup> However, despite PJM’s unexplained reluctance to call a nonsynchronized reserve event, PJM does use NSR resources to respond to synchronized reserve events. That PJM occasionally uses certain nonsynchronized resources to respond to synchronized reserve events while wishing to avoid the general use of NSR suggests a mismatch between NSR’s definition, its actual characteristics, and PJM’s definition of its operational needs.

PJM gave several reasons to support the changes to the reserve ORDCs, including that resource response to spin events has been poor and that the average length of spin events greater than 10 minutes has increased. In addition, PJM was concerned that it might be less able to avoid Disturbance Control Standard (DCS) violations, in which PJM would exceed the NERC-imposed 15-minute limit for recovering Reporting ACE from changes due to

Reportable Disturbances.<sup>81</sup> The MMU agrees about the underlying facts, with caveats, but does not agree with the assumption about DCS events or that any of these reasons support PJM’s actions.

The MMU agrees that average event length has increased, but notes that recent DCS event lengths have remained well below requirements, except in one case. On December 26, 2022, during Winter Storm Elliott, PJM recovered from a DCS event in 15 minutes and 52 seconds, longer than NERC’s requirement of recovery within 15 minutes. Due to possible extenuating circumstances, NERC has yet to determine whether that recovery was actually a DCS violation. Regardless, the data do not support the assertion that PJM is at risk of violating NERC standards during nonemergency conditions and the data do not support the assertion that there has been a change in PJM’s DCS event response times. In general, PJM’s recovery times are clearly and significantly shorter than NERC’s 15-minute requirement and PJM’s self-imposed 10-minute requirement. In many cases, PJM recovers Reporting ACE within 5 minutes. Table 10-23 compares the lengths of recent DCS events with the lengths of their corresponding spin events. As can be seen, many spin events are minutes longer than the DCS event for which they were triggered. In the cases where a spin event continues for more than 10 minutes, this can mean that resource performance becomes subject to evaluation for spin events whose purpose had already been achieved minutes ago (that is, the recovery of the Reporting ACE and the end of the DCS event). While there are reasons for PJM dispatchers to continue a spin event even after ACE recovers, Table 10-23 shows that the lengths of spin events do not suggest that PJM has become closer to having a DCS violation. Table 10-23 also shows that the lengths of DCS events with corresponding spin events from before the changes to the reserve markets were implemented on October 1, 2022, are not significantly different from the lengths of such events since then.

79 See PJM, “PJM Manual 11: Energy & Ancillary Services Market Operations,” § 6.3 Charges for Synchronized Reserve, Rev. 133 (Dec. 17, 2024). “In order to meet Reliability First (RF) Regional Criteria, PJM may schedule additional Contingency Reserves on a temporary basis in order to meet the Largest Single Contingency, as necessary to account for resource performance. PJM shall post details regarding additional scheduling of reserves in Markets Gateway.”


80 See PJM, “PJM Manual 12: Balancing Operations,” § 4.1.2 Loading Reserves, Rev. 54 (Dec. 17, 2024).

81 See PJM, “PJM Manual 12: Balancing Operations,” Rev. 54 (Dec. 17, 2024) Attachment D.

**Table 10-23 A comparison of the lengths of recent DCS events with that of their corresponding spin events: January 2022 through December 2024**

DCS Start	DCS End	DCS Length	Spin Start	Spin End	Spin Length
03-Mar-2022 1218 (EPT)	03-Mar-2022 1224 (EPT)	00:06:03	03-Mar-2022 1220 (EPT)	03-Mar-2022 1227 (EPT)	00:07:21
06-Apr-2022 1144 (EPT)	06-Apr-2022 1149 (EPT)	00:05:12	06-Apr-2022 1145 (EPT)	06-Apr-2022 1155 (EPT)	00:09:43
14-Apr-2022 0928 (EPT)	14-Apr-2022 0934 (EPT)	00:05:40	14-Apr-2022 0930 (EPT)	14-Apr-2022 0938 (EPT)	00:08:07
16-May-2022 1531 (EPT)	16-May-2022 1537 (EPT)	00:06:12	16-May-2022 1532 (EPT)	16-May-2022 1543 (EPT)	00:11:05
16-May-2022 1553 (EPT)	16-May-2022 1556 (EPT)	00:03:18	16-May-2022 1553 (EPT)	16-May-2022 1603 (EPT)	00:09:34
23-May-2022 1717 (EPT)	23-May-2022 1720 (EPT)	00:03:17	23-May-2022 1717 (EPT)	23-May-2022 1732 (EPT)	00:15:00
27-Jun-2022 1700 (EPT)	27-Jun-2022 1704 (EPT)	00:04:16	27-Jun-2022 1701 (EPT)	27-Jun-2022 1710 (EPT)	00:09:03
07-Jul-2022 1720 (EPT)	07-Jul-2022 1724 (EPT)	00:03:27	07-Jul-2022 1721 (EPT)	07-Jul-2022 1729 (EPT)	00:07:52
26-Sep-2022 0335 (EPT)	26-Sep-2022 0342 (EPT)	00:06:16	26-Sep-2022 0339 (EPT)	26-Sep-2022 0345 (EPT)	00:06:02
29-Oct-2022 0210 (EPT)	29-Oct-2022 0215 (EPT)	00:04:42	29-Oct-2022 0212 (EPT)	29-Oct-2022 0224 (EPT)	00:11:52
04-Nov-2022 1501 (EPT)	04-Nov-2022 1504 (EPT)	00:02:58	04-Nov-2022 1503 (EPT)	04-Nov-2022 1507 (EPT)	00:04:25
29-Nov-2022 1629 (EPT)	29-Nov-2022 1638 (EPT)	00:08:23	29-Nov-2022 1630 (EPT)	29-Nov-2022 1647 (EPT)	00:16:45
24-Dec-2022 0223 (EPT)	24-Dec-2022 0223 (EPT)	00:05:15	24-Dec-2022 0223 (EPT)	24-Dec-2022 0254 (EPT)	00:30:35
05-Jan-2023 1242 (EPT)	05-Jan-2023 1247 (EPT)	00:04:56	05-Jan-2023 1243 (EPT)	05-Jan-2023 1255 (EPT)	00:11:33
10-Aug-2023 0039 (EPT)	10-Aug-2023 0043 (EPT)	00:04:02	10-Aug-2023 0041 (EPT)	10-Aug-2023 0049 (EPT)	00:07:33
14-Dec-2023 1939 (EPT)	14-Dec-2023 1943 (EPT)	00:03:58	15-Dec-2023 0041 (EPT)	15-Dec-2023 0053 (EPT)	00:12:15
19-Dec-2023 0449 (EPT)	19-Dec-2023 0450 (EPT)	00:01:25	19-Dec-2023 1451 (EPT)	19-Dec-2023 1458 (EPT)	00:06:30
13-Jan-2024 0157 (EPT)	13-Jan-2024 0201 (EPT)	00:04:26	13-Jan-2024 0159 (EPT)	13-Jan-2024 0204 (EPT)	00:05:15
25-Jan-2024 1237 (EPT)	25-Jan-2024 1241 (EPT)	00:04:48	25-Jan-2024 1239 (EPT)	25-Jan-2024 1247 (EPT)	00:08:37
29-Jan-2024 1202 (EPT)	29-Jan-2024 1206 (EPT)	00:04:35	29-Jan-2024 1203 (EPT)	29-Jan-2024 1212 (EPT)	00:08:54
24-Feb-2024 1546 (EPT)	24-Feb-2024 1551 (EPT)	00:05:36	24-Feb-2024 1548 (EPT)	24-Feb-2024 1600 (EPT)	00:12:19
04-Apr-2024 1047 (EPT)	04-Apr-2024 1052 (EPT)	00:04:45	04-Apr-2024 1050 (EPT)	04-Apr-2024 1055 (EPT)	00:05:15
03-Jun-2024 1852 (EPT)	03-Jun-2024 1858 (EPT)	00:06:41	03-Jun-2024 1853 (EPT)	03-Jun-2024 1902 (EPT)	00:08:35
29-Jun-2024 2101 (EPT)	29-Jun-2024 2106 (EPT)	00:04:48	29-Jun-2024 2103 (EPT)	29-Jun-2024 2109 (EPT)	00:05:36
12-Aug-2024 1709 (EPT)	12-Aug-2024 1713 (EPT)	00:04:25	12-Aug-2024 1710 (EPT)	12-Aug-2024 1720 (EPT)	00:09:39
26-Aug-2024 1352 (EPT)	26-Aug-2024 1355 (EPT)	00:02:48	26-Aug-2024 1353 (EPT)	26-Aug-2024 1357 (EPT)	00:04:13
27-Nov-2024 1934 (EPT)	27-Nov-2024 1939 (EPT)	00:04:35	27-Nov-2024 1934 (EPT)	27-Nov-2024 1946 (EPT)	00:11:57
11-Dec-2024 0819 (EPT)	11-Dec-2024 0823 (EPT)	00:04:00	11-Dec-2024 0821 (EPT)	11-Dec-2024 0827 (EPT)	00:06:00

As an example of the differences between the lengths of spin events and the lengths of DCS events, Figure 10-21 shows PJM ACE during a DCS event and its corresponding spin event on January 5, 2023. The DCS event lasted 4 minutes and 56 seconds, while the spin event lasted 11 minutes and 33 seconds, more than twice as long. The DCS event ends when Reporting ACE (RACE) recovers to its level at the time of the loss of supply, while the spin event ends based on PJM discretion.

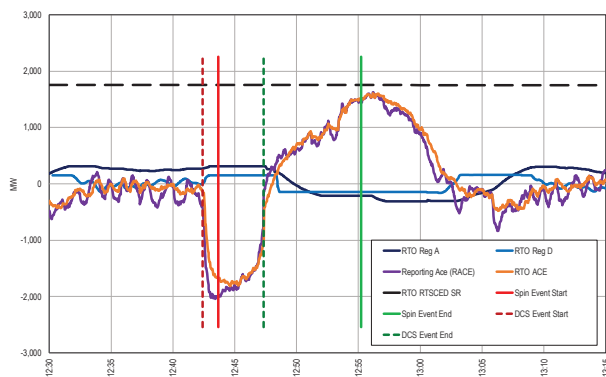
**Figure 10-21 DCS Event vs. Spin Event: January 5, 2023**

If the basis of the original definition of the synchronized reserve reliability requirement was an amount of MW needed to recover within 10 minutes, then an increase in the amount of cleared reserve can shorten the length of synchronized reserve events to be less than 10 minutes. In the remainder of 2023 after the increase in the reliability requirement in May 2023, there were eight spin events, of which seven were less than 10 minutes. Similarly, of the 19 spin events in 2024, 13 were less than 10 minutes. Because those shorter events lasted less than 10 minutes, only

a small portion of the events since the increase qualify for performance assessment under the PJM Market Rules. PJM has stated that they monitor performance for events less than 10 minutes. If the PJM analysis fails to consider the lags that the ALL-CALL system introduces, different for each contacted resource, then it will continue to show underperformance.

In 20 of the 26 spin events for the RTO Reserve Zone that have occurred since the reserve requirement increase, ACE response is consistent with the rate of recovery that would be expected if reserves had performed adequately. Figure 10-22 shows one such event on January 29, 2024. However, some resources are responding to PJM's event notifications when they did not clear the reserve market, so they do not have reserve assignments during those events and so do not count towards reserve performance. PJM has defined the problem as one not of poor overall system response nor of poor ACE recovery, but one of poor performance from the assigned reserves. Although 21 of those 26 events lasted less than 10 minutes, PJM evaluated performance as unsatisfactory due to the under-response from the assigned resources. Therefore, PJM maintains the increase to the reserve requirements, but the fact that performance remains unsatisfactory for multiple events in the months with the increased requirements is evidence that the increase is not the correct solution to the asserted problem.

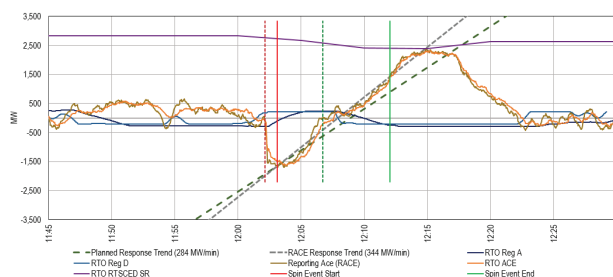**Figure 10-22 ACE response during a synchronized reserve event: January 29, 2024 from 12:03 to 12:12 EPT**



The MMU disagrees with PJM that increasing the reserve requirement is the correct solution for accounting for poor reserve performance.<sup>82</sup> The MMU's position is that these problems with the supply of reserves should not be solved by changing the demand for reserves. The situation is a problem on the supply side, and it should be dealt with and solved on the supply side.

<sup>82</sup> See "Market Monitor Report," MMU presentation to the Members Committee Webinar. (May 22, 2023) <<https://pjm.com/-/media/committees-groups/committees/mc/2023/20230522-webinar/item-04---imm-report.ashx>>.

The lack of response means that resource data inputs, such as ramp rates, the times needed for condensers to start, and economic maximums, are incorrect. It is the responsibility of market participants to correct their offer parameters and operating parameters. It is their obligation to submit correct data.

The data on synchronized reserve event recovery do not support the conclusion that there is an immediate need to change how reserves clear. If PJM insists on an immediate change, the focus should be on correcting the supply of reserves rather than increasing demand.

PJM's logic is that because reserves are responding at an average rate of about 50 percent during spin events, the solution is to buy twice as many MW of reserves. The result is that PJM is overpaying for reserve MW. PJM is paying for 1.0 MW but receiving 0.5 MW. PJM's solution is to pay for 2.0 MW in order to receive 1.0 MW.

Instead of increasing the demand requirement, the MMU proposes to purchase reserve MW from resources only in the amounts for which they can actually perform. If an underperforming resource's behavior shows that they can only reliably provide five MW of reserve, then PJM should only be purchasing five MW of reserve from them. PJM should not be paying MCP credit for MW that are not reliably provided, especially when it only recovers a portion of that money later via penalties and charges.

The MMU proposal is to pay for 0.5 MW from the underperforming unit. The MMU proposal is to pay for actual unit specific MW. The MMU proposal is to pay for 0.5 MW from each of two underperforming units. The result is to pay for 1.0 MW and to receive 1.0 MW of reserves. The MMU proposal is to buy the correct amount of reserves. No increase in demand is required.

The solution is not to buy more MW of poorly performing reserves. The solution is to accurately recognize the actual supply of reserves. The solution is to buy the correct amount of reserves, accounting for the actual performance of supply.

A focus on the supply side issues should be implemented immediately: ensure correct and timely signals; provide education on requirements; buy required reliable MW, based on actual performance; pay only for reliable MW based on actual performance; and do not pay for MW



not provided. Detailed, unit by unit analysis of the reasons for poor performance is needed. Potential unit specific issues include: ensuring the ability to receive and respond to signals; discontinuities in offer curves; the accuracy of ramp rates; ambient derates; fuel availability; demand side resource response; failure to follow dispatch; incorrect eco max or spin max; and incorrect parameters.

One result of PJM's changes to the reserve requirements is that the total cost of the synchronized reserve market has increased. For May 2023 through December 2023, total credits paid for synchronized reserve were \$66.7 million in eight months or \$8.3 million per month, compared to \$6.4 million in four months or \$1.6 million per month for January 2023 through April 2023. In 2024, the total credits paid for synchronized reserve were \$74.1 million dollars. The cost of underperformance by reserve suppliers is paid by PJM customers, while it should be incurred by the suppliers who fail to meet their responsibilities. If reserve suppliers cannot provide the energy that they offer and clear during synchronized reserve events, they should not be paid from the last time they successfully responded to a spin event. These suppliers are not accurately representing their true capability to the PJM market and/or have failed to establish processes to ensure that they follow PJM's instructions.

## History of Synchronized Reserve Events

Synchronized reserve is designed to provide relief for disturbances.<sup>83</sup> <sup>84</sup> A disturbance is defined as loss of the lesser of 900 MW and 80 percent of the largest single contingency within 60 seconds. In the absence of a disturbance, PJM operators have used synchronized reserve as a source of energy to provide relief from low ACE. Of the 12 spin events that occurred in 2023, three were explicitly due to low ACE. Of those three events, none were longer than 10 minutes. Of the 19 events that occurred in 2024, two were explicitly due to low ACE. Of those two, one was longer than 10 minutes.

The risk of using synchronized reserves for energy or any other nondisturbance reason is that it reduces the amount of synchronized reserve available for a disturbance. Disturbances are unpredictable. Synchronized reserve has a requirement to sustain its output for 30 minutes at the most. When reserve output is still needed after 30 minutes, that output should come from secondary reserves, not synchronized reserves.

From January 2019 through December 2024, PJM experienced 102 synchronized reserve events, approximately 1.4 events per month, with an average duration of 11.1 minutes. Table 10-24 shows these events with their region and their duration rounded to the nearest minute.

<sup>83</sup> 2012 Annual State of the Market Report for PJM, Appendix E – PJM's DCS Performance.

<sup>84</sup> See PJM, "PJM Manual 12: Balancing Operations," § 4.1.2 Loading Reserves, Rev. 54 (Dec. 17, 2024).


Table 10-24 Synchronized reserve events: 2019 through 2024<sup>85</sup>

Effective Time	Region	Duration (Minutes)	Effective Time	Region	Duration (Minutes)	Effective Time	Region	Duration (Minutes)
22-Jan-2019 2230 (EPT)	RTO	8	24-Jan-2021 2232 (EPT)	RTO	6	05-Jan-2023 1243 (EPT)	RTO	12
31-Jan-2019 0126 (EPT)	RTO	5	09-Mar-2021 0751 (EPT)	RTO	11	10-Jan-2023 0706 (EPT)	RTO	18
31-Jan-2019 0926 (EPT)	RTO	9	13-Apr-2021 2005 (EPT)	RTO	9	26-Jan-2023 1452 (EPT)	MAD	7
25-Feb-2019 0025 (EPT)	RTO	9	30-Apr-2021 2030 (EPT)	RTO	12	02-Feb-2023 0606 (EPT)	RTO	8
03-Mar-2019 1231 (EPT)	RTO	9	26-May-2021 1417 (EPT)	RTO	10	28-May-2023 2009 (EPT)	RTO	7
06-Mar-2019 2206 (EPT)	RTO	9	21-Jun-2021 0554 (EPT)	RTO	7	11-Jun-2023 1611 (EPT)	MAD	9
27-Jul-2019 2331 (EPT)	RTO	7	23-Jun-2021 0333 (EPT)	RTO	5	23-Jun-2023 1905 (EPT)	RTO	7
11-Aug-2019 1214 (EPT)	RTO	8	21-Jul-2021 1828 (EPT)	RTO	5	08-Aug-2023 0041 (EPT)	RTO	8
03-Sep-2019 1339 (EPT)	MAD	9	25-Jul-2021 1617 (EPT)	RTO	6	07-Nov-2023 1619 (EPT)	RTO	5
23-Sep-2019 1606 (EPT)	RTO	11	23-Aug-2021 1644 (EPT)	RTO	18	10-Nov-2023 0621 (EPT)	RTO	8
01-Oct-2019 1856 (EPT)	RTO	11	24-Aug-2021 1038 (EPT)	RTO	8	15-Dec-2023 0041 (EPT)	RTO	12
11-Dec-2019 2108 (EPT)	RTO	8	27-Sep-2021 1656 (EPT)	RTO	8	19-Dec-2023 0951 (EPT)	RTO	7
18-Dec-2019 1507 (EPT)	RTO	9	11-Oct-2021 0923 (EPT)	RTO	9			
			16-Oct-2021 0130 (EPT)	RTO	8	13-Jan-2024 0159 (EPT)	RTO	5
20-Jan-2020 1406 (EPT)	MAD	8	12-Nov-2021 1325 (EPT)	RTO	12	25-Jan-2024 1239 (EPT)	RTO	9
23-Jan-2020 1617 (EPT)	RTO	9	30-Nov-2021 0540 (EPT)	RTO	9	29-Jan-2024 1203 (EPT)	RTO	9
07-Feb-2020 1206 (EPT)	RTO	6	30-Nov-2021 0957 (EPT)	RTO	9	24-Feb-2024 1548 (EPT)	MAD	12
08-Feb-2020 0344 (EPT)	RTO	8	08-Dec-2021 0504 (EPT)	RTO	7	04-Apr-2024 1050 (EPT)	RTO	5
10-Feb-2020 2015 (EPT)	RTO	9				13-Apr-2024 0036 (EPT)	RTO	7
18-Feb-2020 1116 (EPT)	RTO	10	03-Jan-2022 1227 (EPT)	RTO	9	03-Jun-2024 1853 (EPT)	RTO	9
08-Mar-2020 0517 (EPT)	MAD	5	03-Mar-2022 1220 (EPT)	RTO	7	29-Jun-2024 2103 (EPT)	RTO	6
13-Apr-2020 2001 (EPT)	RTO	8	06-Apr-2022 1145 (EPT)	RTO	10	08-Jul-2024 1757 (EPT)	RTO	15
03-May-2020 1229 (EPT)	RTO	6	13-Apr-2022 1725 (EPT)	RTO	28	18-Jul-2024 1524 (EPT)	RTO	7
06-Jul-2020 2122 (EPT)	RTO	10	14-Apr-2022 0931 (EPT)	RTO	8	21-Jul-2024 1753 (EPT)	RTO	10
24-Jul-2020 0103 (EPT)	RTO	9	16-May-2022 1532 (EPT)	RTO	11	12-Aug-2024 1710 (EPT)	RTO	10
25-Jul-2020 1639 (EPT)	MAD	11	16-May-2022 1553 (EPT)	RTO	10	18-Aug-2024 1604 (EPT)	RTO	16
10-Sep-2020 0019 (EPT)	RTO	10	23-May-2022 1717 (EPT)	RTO	15	26-Aug-2024 1353 (EPT)	RTO	4
10-Oct-2020 1852 (EPT)	RTO	8	26-May-2022 1409 (EPT)	RTO	6	22-Oct-2024 1002 (EPT)	RTO	6
12-Oct-2020 0429 (EPT)	RTO	9	22-Jun-2022 1506 (EPT)	RTO	7	10-Nov-2024 0020 (EPT)	RTO	11
13-Nov-2020 0746 (EPT)	RTO	6	27-Jun-2022 1701 (EPT)	RTO	9	27-Nov-2024 1936 (EPT)	RTO	10
16-Dec-2020 1638 (EPT)	MAD	10	07-Jul-2022 1721 (EPT)	RTO	8	29-Nov-2024 1103 (EPT)	RTO	7
			26-Sep-2022 0339 (EPT)	RTO	6	11-Dec-2024 0821 (EPT)	RTO	6
			29-Sep-2022 1025 (EPT)	RTO	6			
			29-Oct-2022 1412 (EPT)	RTO	12			
			04-Nov-2022 1503 (EPT)	RTO	4			
			14-Nov-2022 22:01 (EPT)	RTO	7			
			29-Nov-2022 1630 (EPT)	RTO	17			
			23-Dec-2022 1014 (EPT)	RTO	11			
			23-Dec-2022 1617 (EPT)	RTO	111			
			24-Dec-2022 0501 (EPT)	RTO	26			
			24-Dec-2022 0223 (EPT)	RTO	31			
			24-Dec-2022 0423 (EPT)	RTO	88			

85 For full history of spinning events, see the 2022 Annual State of the Market Report for PJM, Appendix E - Ancillary Service Markets.

Figure 10-23 shows spin event durations over the past 4 years. Some events last longer than 30 minutes. Beyond 30 minutes, reserves no longer have an obligation to perform. It is not clear what resources are instructed or expected to do after the 30-minute performance obligation. This ambiguity applies to three synchronized reserve events during Winter Storm Elliott in December 2022, which all lasted longer than 30 minutes.

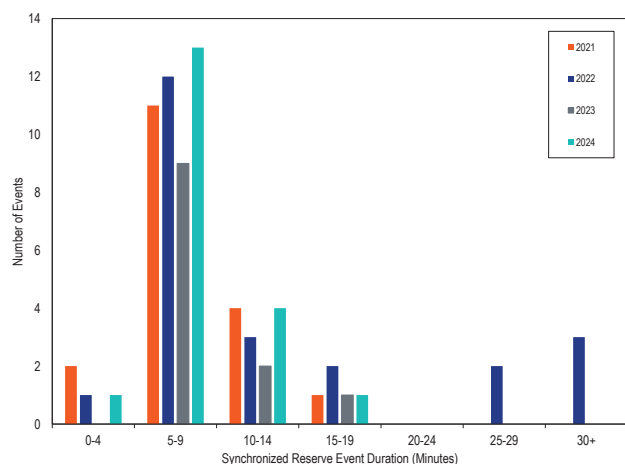**Figure 10-23 Synchronized reserve events duration distribution curve: 2021 through 2024**



## Nonsynchronized Reserve

Nonsynchronized reserve consists of MW available within 10 minutes but not synchronized to the grid. Startup time for nonsynchronized reserve resources is not subject to testing and is based on the parameters in the energy offers submitted by resource owners. There is no defined requirement for nonsynchronized reserve; it is available to economically meet the primary reserve requirement. Generation resources that have designated their entire output as emergency are not eligible to provide nonsynchronized reserves. Generation resources that are not available to provide energy are not eligible to provide nonsynchronized reserves.

The nonsynchronized reserve market has a day-ahead and a real-time component. There are no lost opportunity costs for nonsynchronized reserve. Offline units cannot be dispatched to provide energy, because PJM has not called them to come online, so they do not have a lost opportunity to provide energy. As a result, the supply curve for nonsynchronized reserve has a price of zero and there are no uplift credits paid when LMP is higher

than the incremental cost of nonsynchronized reserve units.

PJM defines the demand curve for nonsynchronized reserve, and PJM defines the supply curve based on nonemergency generation resources that are available to provide energy and can start in 10 minutes or less. Since nonsynchronized reserve is considered a lower quality product than synchronized reserve, its clearing price is less than or equal to the synchronized reserve market clearing price. In most market intervals, the nonsynchronized reserve market clearing price is \$0 per MWh.

PJM uses nonsynchronized reserve when PJM calls nonsynchronized reserve events and when PJM calls specific nonsynchronized reserve resources to respond to synchronized reserve events. There were no nonsynchronized reserve events in 2024.

## Market Structure

### Demand

There is no explicit demand for nonsynchronized reserve beyond a more general demand for primary reserve, which can be satisfied by the synchronized and nonsynchronized reserve products, and for 30-minute reserve, which can be satisfied by all three reserve products. Beyond the synchronized reserve requirement, the balance of primary reserve can be made up by the economic combination of synchronized and nonsynchronized reserve. While it can be used to satisfy the 30-minute reserve requirement, as seen in Figure 10-2, nonsynchronized reserve is mainly used for satisfying the primary reserve requirement.

In the RTO Reserve Zone, in 2024, the average amount of real-time cleared nonsynchronized reserve was 902.4 MW and the average day-ahead cleared nonsynchronized reserve was 1,000.5 MW. In the MAD Reserve Subzone, in 2024, the average real-time cleared nonsynchronized reserve was 650.7 MW and the average day-ahead cleared nonsynchronized reserve was 663.6 MW.

### Supply

The market solution considers the available supply of nonsynchronized reserve to be all generation resources currently not synchronized to the grid but available and capable of providing energy within 10 minutes.

Generators that have made themselves unavailable or have defined themselves to be emergency only are not considered. Resources that generally qualify as nonsynchronized reserve include run of river hydro, pumped hydro, combustion turbines, diesels, and combined cycles that can start in 10 minutes or less.

The available reserve MW for nonsynchronized reserve units is the lesser of the economic maximum or the ramp rate times 10 minutes minus the startup and notification time. Hydroelectric resources must separately specify their availability and offer MW.

In 2024, an average of 902.4 MW of nonsynchronized reserve was cleared per five-minute interval out of 946.5 eligible MW as part of the primary reserve requirement in the RTO Reserve Zone. Figure 10-24 shows daily average total nonsynchronized reserve MW available in 2024.

**Figure 10-24 Daily Average Available Nonsynchronized Reserve: 2024**


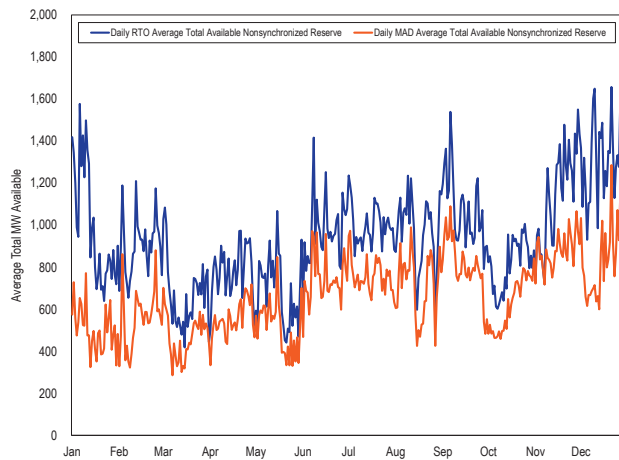


Figure 10-25 shows the daily average total available NSR MW in the ASO, RT SCED, and day-ahead solutions. The available MW in the ASO are consistently lower due to differences in the available MW from flexible units based on the goal of the ASO.

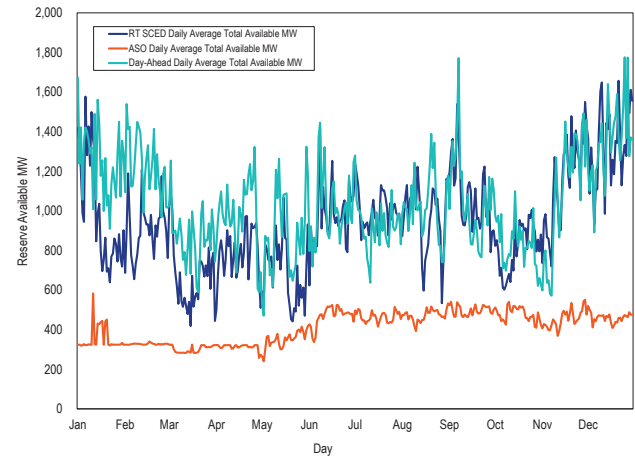**Figure 10-25 Daily average total available MW in the day-ahead, ASO, and RT SCED solutions: 2024**



## Market Behavior

The offer price for nonsynchronized reserve for all resources is cost based, which is \$0 per MWh for all resources.


## Market Performance

The settled price of nonsynchronized reserve is calculated in real time every five minutes for the RTO Reserve Zone and the MAD Reserve Subzone. Figure 10-26 shows the daily average nonsynchronized reserve market clearing price (NSRMCP) and average credited MW for the RTO Reserve Zone. In 2024, the real-time weighted average NSRMCP for all intervals was \$1.54 per MWh and the real-time average nonsynchronized reserve cleared was 902.4 MW. The day-ahead weighted average NSRMCP for all intervals was \$1.32 per MWh and the day-ahead average nonsynchronized reserve cleared MW was 1,000.5 MW.

Shortage pricing was used in the RTO Reserve Zone for primary reserve on January 20, January 22, January 29, March 10, March 18, April 14, May 21, June 3, July 8, July 28, September 4, October 14, October 15, November 22, and December 6. Shortage pricing was used in the MAD Reserve Subzone for primary reserve on January 20, January 21, January 22, June 3, and October 14. Conservative operations due to cold weather were in place from January 13 through January 17. Prices spiked on December 12 during a cold weather alert. The shortage pricing on January 29, June 3, and July 8 occurred during spin events. During most of these short intervals, there was not a true shortage, as PJM still

cleared above the average reserve requirements used before PJM's mid-May 2023 increase.

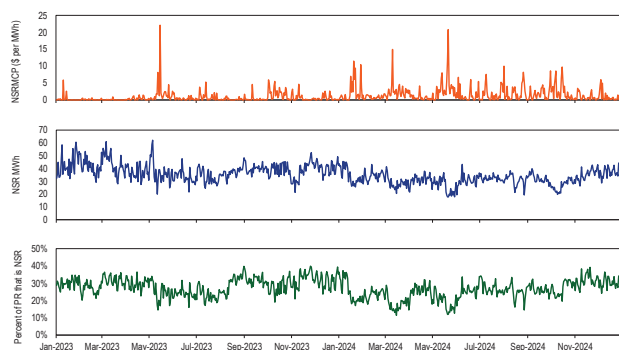**Figure 10-26 Daily weighted average RTO Zone nonsynchronized reserve market clearing price, average MW purchased, and average percent of PR that is NSR: 2023 through 2024**



The NSRMCP in most intervals of 2024 was greater than \$0 per MWh. Table 10-25 shows the number of five-minute intervals with an NSRMCP above \$0 per MWh. The day-ahead market clears by hour, equivalent to blocks of 12 five-minute intervals. There were 105,408 five-minute intervals in 2024. The NSRMCP is equal to the cost of the marginal primary reserve resource.<sup>86</sup> While the offer price of NSR resources is cost based and therefore \$0 per MWh, if the marginal resource of primary reserve in an interval is an SR resource with a nonzero cost, then the NSRMCP in that interval will also be nonzero.


**Table 10-25 Number of five minute intervals with NSRMCP above \$0 per MWh: 2024**

Location	Market	Number of Intervals Where NSRMCP Above \$0 per MWh	Percent of Intervals Where NSRMCP Above \$0 per MWh
RTO	RT	66,239	62.8%
RTO	DA	67,272	63.8%
MAD	RT	67,209	63.8%
MAD	DA	68,676	65.2%

Figure 10-27 shows the number of intervals per day for which a nonzero NSRMCP equaled the SRMCP. Since the increase to the reserve requirement on May 12, 2023, the average number of such intervals per day has increased, with the maximum number and given number of such intervals per day both trending upwards. In 2024, the number of such intervals differed for the RTO Reserve Zone and the MAD Reserve Subzone from January

17 through January 24, when PJM increased reserve requirements during conservative operations (Table 10-7) and when PJM used shortage pricing for primary reserve. Table 10-26 shows a summary of the intervals for which a nonzero NSRMCP did not equal the SRMCP.

**Figure 10-27 Number of intervals per day for which a nonzero NSRMCP equaled the SRMCP: 2023 through 2024**

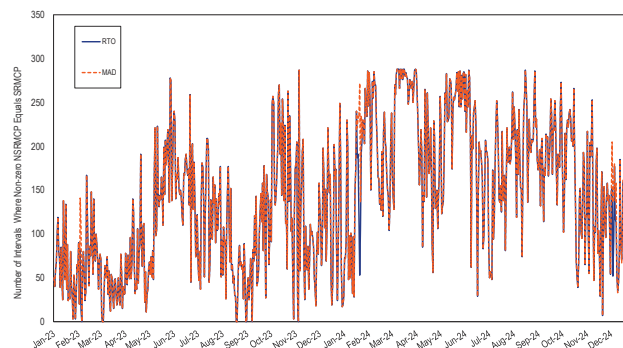

**Table 10-26 Intervals with a nonzero NSRMCP in which the NSRMCP did not equal the SRMCP: 2024**

Day	Intervals where NSRMCP differs from SRMCP		Average Absolute MCP Difference	
	RTO	MAD	RTO	MAD
21-Jan-2024	0	3	NA	\$7.08
22-Jan-2024	0	1	NA	\$0.02
29-Jan-2024	1	1	\$106.74	\$106.74
3-Jun-2024	1	1	\$850.00	\$550.00
28-Jul-2024	1	1	\$702.06	\$702.06
2-Dec-2024	4	13	\$0.02	\$0.12
3-Dec-2024	12	70	\$0.02	\$7.05
4-Dec-2024	29	50	\$0.02	\$5.73
5-Dec-2024	2	4	\$0.02	\$0.19
6-Dec-2024	5	25	\$11.38	\$4.00
7-Dec-2024	5	15	\$0.01	\$0.67
9-Dec-2024	15	19	\$2.93	\$3.95
10-Dec-2024	6	26	\$2.18	\$7.91
14-Dec-2024	0	5	NA	\$1.74
16-Dec-2024	2	6	\$0.02	\$0.20

Table 10-27 shows the effect of fast start pricing on the nonsynchronized reserve market's monthly weighted average market clearing price since October 2022. For the real-time market, these are the LPC prices weighted by the RT SCED MW. For the day-ahead values, these are the DA prices weighted by the DA dispatch MW. The weighted average market clearing price for each month tends to be higher in the pricing run than in the dispatch run. In 2024, the weighted average real-time price from the pricing run was 33.1 percent higher than the weighted average real-time price from the dispatch

<sup>86</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations," § 4.4.5.2 Determination of Non-Synchronized Reserve Clearing Prices, Rev. 133 (Dec. 17, 2024).



run. In 2024, the weighted average day-ahead price from the pricing run was 2.7 percent higher than the weighted average day-ahead price from the dispatch run.

**Table 10-27 Comparison of fast start and dispatch RTO pricing: 2023 through 2024**

Year	Month	Day-Ahead				Real-Time			
		Dispatch-Run MCP	Pricing-Run MCP	Difference	Percent Difference	Dispatch-Run MCP	Pricing-Run MCP	Difference	Percent Difference
2023	Jan	\$0.06	\$0.07	\$0.00	7.4%	\$0.23	\$0.28	\$0.05	22.4%
2023	Feb	\$0.05	\$0.05	\$0.00	0.1%	\$0.06	\$0.10	\$0.05	81.1%
2023	Mar	\$0.08	\$0.08	\$0.00	3.6%	\$0.03	\$0.06	\$0.03	94.3%
2023	Apr	\$0.31	\$0.32	\$0.01	2.1%	\$0.24	\$0.40	\$0.16	69.4%
2023	May	\$0.94	\$0.94	(\$0.00)	(0.0%)	\$1.59	\$2.10	\$0.51	31.8%
2023	Jun	\$0.88	\$0.90	\$0.01	1.6%	\$0.23	\$0.41	\$0.17	73.3%
2023	Jul	\$2.28	\$2.34	\$0.06	2.6%	\$0.47	\$0.78	\$0.31	65.0%
2023	Aug	\$0.52	\$0.55	\$0.04	6.8%	\$0.11	\$0.18	\$0.07	64.2%
2023	Sep	\$0.68	\$0.72	\$0.04	5.9%	\$0.21	\$0.32	\$0.11	49.8%
2023	Oct	\$5.11	\$5.16	\$0.05	0.9%	\$1.08	\$1.71	\$0.63	57.8%
2023	Nov	\$2.66	\$2.70	\$0.04	1.5%	\$0.32	\$0.52	\$0.20	63.0%
2023	Dec	\$0.39	\$0.40	\$0.01	3.0%	\$0.31	\$0.45	\$0.13	42.6%
2023	All	\$1.00	\$1.02	\$0.02	2.0%	\$0.40	\$0.61	\$0.20	49.8%
2024	Jan	\$0.48	\$0.49	\$0.01	1.4%	\$1.13	\$1.38	\$0.26	22.6%
2024	Feb	\$0.48	\$0.48	\$0.00	0.3%	\$0.58	\$0.81	\$0.23	40.4%
2024	Mar	\$1.57	\$1.58	\$0.01	0.7%	\$1.71	\$2.43	\$0.72	42.1%
2024	Apr	\$2.77	\$2.79	\$0.02	0.6%	\$0.47	\$0.73	\$0.26	54.1%
2024	May	\$2.09	\$2.09	(\$0.00)	(0.2%)	\$2.00	\$3.12	\$1.13	56.5%
2024	Jun	\$1.11	\$1.19	\$0.08	7.1%	\$1.11	\$1.26	\$0.15	13.6%
2024	Jul	\$1.56	\$1.68	\$0.11	7.4%	\$1.32	\$1.65	\$0.32	24.6%
2024	Aug	\$1.19	\$1.25	\$0.06	5.0%	\$1.66	\$1.99	\$0.32	19.4%
2024	Sep	\$1.39	\$1.44	\$0.06	4.1%	\$1.31	\$1.77	\$0.46	35.5%
2024	Oct	\$1.75	\$1.78	\$0.02	1.4%	\$1.89	\$2.31	\$0.42	22.5%
2024	Nov	\$0.88	\$0.90	\$0.02	2.4%	\$0.43	\$0.80	\$0.37	85.8%
2024	Dec	\$0.39	\$0.40	\$0.01	3.3%	\$0.36	\$0.48	\$0.12	33.3%
2024	All	\$1.20	\$1.24	\$0.03	2.7%	\$1.11	\$1.48	\$0.37	33.1%

**Table 10-28 Comparison of fast start and dispatch MAD pricing: January 2023 through December 2024**

Year	Month	Day-Ahead				Real-Time			
		Dispatch-Run MCP	Pricing-Run MCP	Difference	Percent Difference	Dispatch-Run MCP	Pricing-Run MCP	Difference	Percent Difference
2023	Jan	\$0.09	\$0.10	\$0.00	4.0%	\$0.43	\$0.45	\$0.02	4.2%
2023	Feb	\$0.12	\$0.12	(\$0.00)	(0.0%)	\$0.16	\$0.23	\$0.07	44.7%
2023	Mar	\$0.12	\$0.13	\$0.00	3.6%	\$0.05	\$0.09	\$0.04	83.5%
2023	Apr	\$0.53	\$0.54	\$0.01	2.1%	\$0.34	\$0.59	\$0.25	72.0%
2023	May	\$1.05	\$1.04	(\$0.00)	(0.3%)	\$1.88	\$2.50	\$0.61	32.7%
2023	Jun	\$0.93	\$0.94	\$0.01	1.0%	\$0.27	\$0.47	\$0.20	76.8%
2023	Jul	\$2.23	\$2.27	\$0.04	1.7%	\$0.49	\$0.82	\$0.33	67.3%
2023	Aug	\$0.66	\$0.69	\$0.03	4.7%	\$0.15	\$0.24	\$0.09	56.0%
2023	Sep	\$0.66	\$0.69	\$0.03	4.1%	\$0.35	\$0.44	\$0.09	26.6%
2023	Oct	\$5.27	\$5.31	\$0.04	0.7%	\$1.37	\$2.11	\$0.73	53.5%
2023	Nov	\$3.18	\$3.22	\$0.04	1.2%	\$0.41	\$0.67	\$0.27	65.6%
2023	Dec	\$0.42	\$0.43	\$0.01	2.2%	\$0.42	\$0.60	\$0.18	42.7%
2023	All	\$1.08	\$1.10	\$0.02	1.4%	\$0.53	\$0.77	\$0.24	45.7%
2024	Jan	\$0.67	\$0.68	\$0.01	1.1%	\$2.09	\$2.46	\$0.36	17.4%
2024	Feb	\$0.51	\$0.51	\$0.00	0.3%	\$0.72	\$1.01	\$0.29	40.9%
2024	Mar	\$1.78	\$1.79	\$0.01	0.8%	\$1.98	\$2.82	\$0.84	42.4%
2024	Apr	\$3.16	\$3.18	\$0.02	0.6%	\$0.58	\$0.87	\$0.29	49.5%
2024	May	\$2.12	\$2.11	(\$0.01)	(0.3%)	\$2.07	\$3.27	\$1.20	57.9%
2024	Jun	\$1.23	\$1.26	\$0.04	2.9%	\$1.25	\$1.41	\$0.16	13.1%
2024	Jul	\$1.82	\$1.93	\$0.11	5.9%	\$1.43	\$1.78	\$0.35	24.3%
2024	Aug	\$1.32	\$1.38	\$0.06	4.5%	\$1.90	\$2.27	\$0.38	19.9%
2024	Sep	\$1.46	\$1.51	\$0.05	3.4%	\$1.46	\$1.98	\$0.52	35.4%
2024	Oct	\$2.36	\$2.39	\$0.03	1.3%	\$2.12	\$2.58	\$0.46	21.7%
2024	Nov	\$1.20	\$1.23	\$0.03	2.4%	\$0.51	\$0.90	\$0.39	75.7%
2024	Dec	\$0.95	\$0.96	\$0.01	1.3%	\$0.96	\$1.11	\$0.15	15.7%
2024	All	\$1.47	\$1.50	\$0.03	2.0%	\$1.38	\$1.80	\$0.42	30.5%

In 2024, the weighted average price of nonsynchronized reserve was \$1.54 per MWh and the weighted average credit for nonsynchronized reserve was \$1.28 per MWh.

Table 10-29 shows the total nonsynchronized reserve payments by month from January 2023 through December 2024. In May 2023 through December 2024, payments increased due to the increased reserve requirements. However, as can be seen in Figure 10-26 and Figure 10-27, this large increase in payments was not entirely the result of a large increase in the amount of cleared NSR. In addition to clearing more nonsynchronized reserve, PJM needed to clear more of the costlier synchronized reserve product in order to satisfy the primary reserve requirement. In Figure 10-26, this can be seen in how many of the price spikes for nonsynchronized reserve correspond with decreases in the percentage of primary reserve that is nonsynchronized reserve. Higher day-ahead credits in July 2023 are due to prices spikes for hot weather alerts for July 27 and July 28.

**Table 10-29 Total nonsynchronized reserve payments and charges by month: 2023 through 2024**

Year	Month	Real-Time and		LOC Credits	Shortfall Charges	Total Credits
		Day-Ahead Credits	Balancing MCP Credits			
2023	Jan	\$73,610	(\$156,594)	\$5,650	NA	(\$77,333)
2023	Feb	\$72,133	(\$113,616)	\$25,262	NA	(\$16,222)
2023	Mar	\$72,194	(\$37,459)	\$2,515	NA	\$37,250
2023	Apr	\$220,075	(\$114,010)	\$60,599	NA	\$166,664
2023	May	\$764,690	(\$602,088)	\$477,365	NA	\$639,967
2023	Jun	\$648,961	(\$134,877)	\$48,934	NA	\$563,017
2023	Jul	\$1,697,877	(\$227,431)	\$30,765	NA	\$1,501,211
2023	Aug	\$422,257	(\$17,911)	\$317	NA	\$404,663
2023	Sep	\$503,832	\$66,886	\$2,149	NA	\$572,867
2023	Oct	\$2,934,103	\$4,297	\$115,662	NA	\$3,054,062
2023	Nov	\$1,789,002	(\$4,285)	\$59,988	NA	\$1,844,705
2023	Dec	\$387,670	(\$90,673)	\$35,279	NA	\$332,276
2023	All	\$9,586,405	(\$1,427,760)	\$864,483	NA	\$9,023,128
2024	Jan	\$549,761	(\$805,570)	\$246,452	NA	(\$9,357)
2024	Feb	\$406,207	(\$224,893)	\$144,292	NA	\$325,606
2024	Mar	\$907,106	(\$493,717)	\$265,668	NA	\$679,056
2024	Apr	\$1,854,995	(\$145,771)	\$81,932	NA	\$1,791,156
2024	May	\$1,236,498	(\$655,115)	\$575,064	NA	\$1,156,446
2024	Jun	\$879,638	(\$184,066)	\$41,825	NA	\$737,397
2024	Jul	\$1,271,008	(\$182,792)	\$42,317	NA	\$1,130,532
2024	Aug	\$952,433	(\$144,541)	\$71,568	NA	\$879,460
2024	Sep	\$1,072,480	(\$391,855)	\$267,027	NA	\$947,653
2024	Oct	\$1,038,044	(\$128,961)	\$157,580	NA	\$1,066,664
2024	Nov	\$695,733	(\$31,505)	\$74,935	NA	\$739,163
2024	Dec	\$694,695	(\$52,364)	\$93,799	NA	\$736,131
2024	All	\$11,558,598	(\$3,441,150)	\$2,062,460	NA	\$10,179,908

Table 10-30 provides the day-ahead and real-time nonsynchronized reserve by resource type and fuel type for 2024.

**Table 10-30 Day-ahead and real-time nonsynchronized reserve by resource type and fuel type: 2024**

Resource / Fuel Type	Real-Time		Day-Ahead Credits	Balancing MCP Credits	LOC Credits	Total Credits
	Day-Ahead MWh	Scheduled MWh				
Oil	3,238,369	3,258,187	\$7,953,655	(\$109,521)	\$2,072	\$7,846,206
Hydro	5,009,775	4,165,028	\$3,108,828	(\$3,161,913)	\$2,004,989	\$1,951,905
RICE - Natural Gas	471,877	379,732	\$399,036	(\$127,397)	\$52,198	\$323,837
CT - Natural Gas	35,855	110,699	\$19,496	\$15,725	\$12	\$35,233
Other	32,594	12,680	\$77,582	(\$58,044)	\$3,189	\$22,726

## 30-Minute Reserve

The 30-minute reserve service is provided by resources that can respond in 30 minutes. The requirement for the 30-minute reserve service can be satisfied by the primary reserve product and the secondary reserve product. There is no NERC standard for 30-minute reserve.


## Market Structure

### Demand

Demand for the 30-minute reserve service comes from the 30-minute reserve requirement. By default, the 30-minute reserve requirement is equal to the extended reserve requirement plus the 30-minute reserve reliability requirement. The 30-minute reserve reliability requirement is equal to the maximum of: the primary reserve reliability requirement; the largest active gas contingency; and 3,000 MW.<sup>87</sup> Unlike with synchronized reserve and primary reserve, PJM does not model a 30-minute reserve requirement for the defined reserve subzone.<sup>88</sup> However, PJM has the option to define a subzone natural gas contingency reserve requirement using 30-minute reserves. PJM did not exercise this option in 2024.

Figure 10-28 shows an example ORDC for 30-minute reserve for when the primary reserve reliability requirement and the largest active gas contingency are both less than 3,000 MW, and when the extended reserve requirement is equal to its base value of 190 MW. Since the increase to the synchronized reserve reliability requirement in May 2023, the 30-minute reserve requirement has frequently equaled the primary reserve requirement.

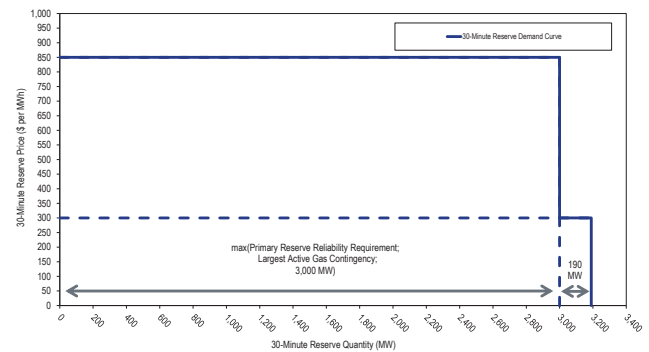**Figure 10-28** An example of a 30-minute reserve real-time operating reserve demand curve, including the permanent second step



In 2024, the average real-time 30-minute requirement was 3,532.5 MW and the average day-ahead 30-minute requirement was 3,582.5 MW (Figure 10-4).

### Supply

The supply of 30-minute reserves includes all reserves that can convert to energy in 30 minutes. All reserve products can participate in the 30-minute reserve service. In 2024, the demand for 30-minute reserve was satisfied by primary reserves (made of synchronized reserves and nonsynchronized reserves) and secondary reserves. The 30-minute reserve requirement is met from the least expensive combination of synchronized, nonsynchronized, and secondary reserves that satisfies the requirements of the synchronized, primary, and 30-minute reserve services (Table 10-9).

## Market Concentration

Table 10-31 shows the average HHI of the 30-minute reserve market, including synchronized, nonsynchronized, and secondary reserves, and the percent of intervals for which the maximum market share is above 20 percent. In 2024, the RTO Reserve Zone was moderately concentrated in the day-ahead market and unconcentrated in the real-time market.

**Table 10-31** PJM 30-minute reserve market HHI: 2024

		Percent of Intervals		
		Average	Max Market Share	
Location	Market	HHI	Above 20%	Description
RTO	RT	909	68.5%	Unconcentrated
RTO	DA	1020	85.1%	Moderately Concentrated

<sup>87</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations" § 4.3 Reserve Requirement Determination, Rev. 133 (Dec. 17, 2024).

<sup>88</sup> See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations" § 4.3.1 Locational Aspect of Reserves, Rev. 133 (Dec. 17, 2024).

## Market Performance

Due to the large amount of available secondary reserve, most 30-minute reserve is procured for little cost, with the amount of cleared secondary reserve far exceeding what is strictly needed to satisfy the 30-minute reserve requirement (Figure 10-2). In 2024, no interval was ever short of 30-minute reserves.

## Secondary Reserve

PJM defines secondary reserve as reserves (online or offline available for dispatch) that can be converted to energy in 10 to 30 minutes. There is no NERC standard for secondary reserve. The secondary reserve product can only be used to satisfy the 30-minute reserve service requirement, and is cleared for five-minute intervals in real time and 60-minute intervals in day ahead. Failure to convert offline secondary reserves to energy at PJM's request results in a shortfall charge.

Unlike synchronized reserves and nonsynchronized reserves, there is no "event" process to deploy secondary reserves. Instead, PJM uses secondary reserve via the normal energy commitment and dispatch process.

## Market Structure

### Demand

There is no explicit demand for secondary reserve beyond a more general demand for 30-minute reserve, which can be satisfied by the synchronized, nonsynchronized, and secondary reserve products. Beyond the primary reserve requirement, the balance of 30-minute reserve can be made up by the economic combination of synchronized, nonsynchronized, and secondary reserve.

When the secondary reserve market clearing price is \$0 per MWh, PJM's clearing engines clear all available secondary reserve MW. Because of the large amount of secondary reserve cleared, most 30-minute reserve is secondary reserve and most cleared secondary reserve is cleared well in excess of the 30-minute reserve requirement (Figure 10-2).

### Supply


Secondary reserves are reserves that can convert to energy within 10 to 30 minutes. This includes the unloaded capacity of online generation that can be achieved according to the resource ramp rates in 10 to

30 minutes. It also includes offline resources that offer a time to start of less than 30 minutes but more than 10 minutes. Secondary reserves do not include pre-emergency or emergency demand response resources, even if they offer to start in less than 30 minutes. Secondary reserves do not include exports that can be recalled in less than 30 minutes.

As with the other reserve products, for most resources, PJM determines the MW available for secondary reserve based on energy offer parameters.<sup>89</sup> Energy storage resources, hydroelectric resources, and demand response resources must specify their availability and MW separately. Online resources' secondary reserves are based on ramp rates and the lesser of the secondary reserve maximum or economic maximum parameters, as well as any cleared synchronized reserve.<sup>90</sup> The use of the secondary reserve maximum output limit requires prior approval by PJM.<sup>91</sup> Offline resources' secondary reserves are based on the time to start, which is the start-up time plus notification time, and any cleared nonsynchronized reserve.<sup>92</sup> Certain resource types, including nuclear, wind, and solar units, are by default excluded from providing secondary reserves.

Figure 10-29 shows the daily average total available secondary reserve in 2024. In 2024, the average real-time supply of secondary reserve was 21,371.2 MW.

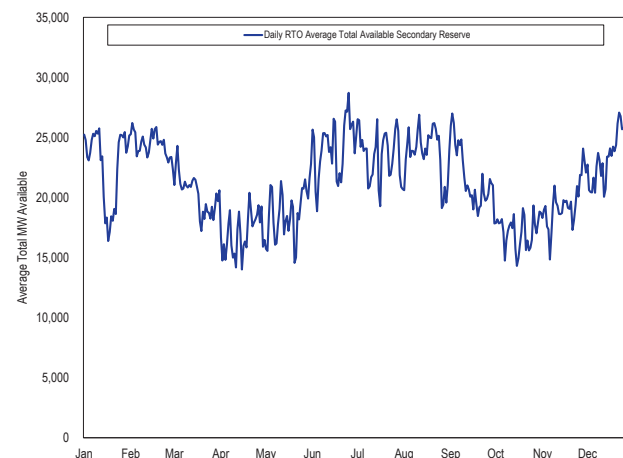**Figure 10-29 Daily Average Available Secondary Reserve: 2024**



89 See PJM. "PJM Manual 11: Energy & Ancillary Services Market Operations" § 4.2.3 Reserve Market Resource Offer Structure, Rev. 133 (Dec. 17, 2024).

90 See PJM. "PJM Manual 11: Energy & Ancillary Services Market Operations" § 4.2.5.1 Reserve Market Capability for Online Generation Resources, Rev. 133 (Dec. 17, 2024).

91 See PJM. "PJM Manual 11: Energy & Ancillary Services Market Operations" § 4.2.2.1 Communication for Reserve Capability Limitation, Rev. 133 (Dec. 17, 2024).

92 See PJM. "PJM Manual 11: Energy & Ancillary Services Market Operations" § 4.2.5.2 Reserve Market Capability for Offline Generation Resources, Rev. 132 (Sept. 1, 2024).

## Market Behavior

For all resources, the secondary reserve offer price is \$0 per MWh.<sup>93</sup> For online resources, the energy market opportunity cost is calculated by PJM based on market prices.

## Market Performance

Figure 10-30 provides the prices for secondary reserves for 2024. In 2024, the secondary reserve market clearing price in the real-time and day-ahead markets was always \$0 per MWh.

**Figure 10-30 Secondary reserve prices: 2024**

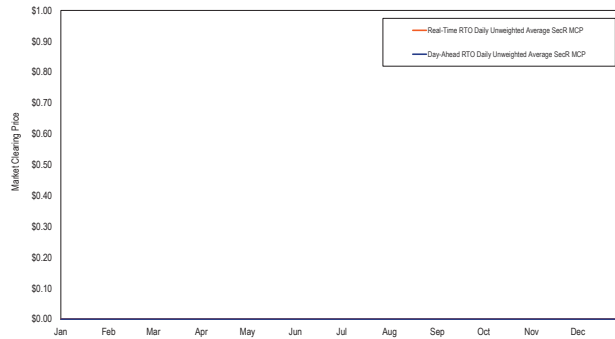


Table 10-32 compares the dispatch run and pricing run market clearing prices for the day-ahead and real-time secondary reserve markets. For both the dispatch run and the pricing run, the real-time values are the LPC prices for each run weighted by the RT SCED MW. For the day-ahead values, these are the DA prices weighted by the DA dispatch MW. In 2024, the day-ahead and real-time prices of secondary reserve were always \$0 per MWh in both the pricing run and the dispatch run.

**Table 10-32 Comparison of fast start and dispatch pricing components: 2023 through 2024**

Year	Month	Day-Ahead				Real-Time			
		Dispatch-Run MCP	Pricing-Run MCP	Difference	Percent Difference	Dispatch-Run MCP	Pricing-Run MCP	Difference	Percent Difference
2023	Jan	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2023	Feb	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2023	Mar	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2023	Apr	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2023	May	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2023	Jun	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2023	Jul	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2023	Aug	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2023	Sep	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2023	Oct	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2023	Nov	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2023	Dec	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2023	All	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2024	Jan	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2024	Feb	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2024	Mar	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2024	Apr	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2024	May	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2024	Jun	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2024	Jul	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2024	Aug	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2024	Sep	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2024	Oct	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2024	Nov	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2024	Dec	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA
2024	All	\$0.00	\$0.00	\$0.00	NA	\$0.00	\$0.00	\$0.00	NA

93 See PJM, "PJM Manual 11: Energy & Ancillary Services Market Operations" § 4.2.3 Reserve Market Resource Offer Structure, Rev. 133 (Dec. 17, 2024).



Table 10-33 shows the day-ahead credits, balancing market credits, LOC credits, and effective shortfall charges for secondary reserves from 2023 through 2024.<sup>94</sup> In 2024, the weighted average secondary reserve market clearing price was \$0.00 per MWh. In 2024, the weighted average credit per MWh, considering the total credits paid and the capped MWh, was \$0.02 per MWh.

**Table 10-33 Monthly secondary reserve settlements: 2023 through 2024**

Year	Month	Total Day-Ahead Credits	Total Balancing MCP Credits	Total LOC Credits	Total Effective Shortfall Charge	Total Credits
2023	Jan	\$0	\$0	\$5,059	\$0	\$5,059
2023	Feb	\$0	\$0	\$34,067	\$0	\$34,067
2023	Mar	\$0	\$0	\$12,349	\$0	\$12,349
2023	Apr	\$0	\$0	\$15,177	\$0	\$15,177
2023	May	\$0	\$0	\$64,999	\$0	\$64,999
2023	Jun	\$0	\$0	\$137,039	\$0	\$137,039
2023	Jul	\$0	\$0	\$351,860	\$0	\$351,860
2023	Aug	\$0	\$0	\$133,222	\$0	\$133,222
2023	Sep	\$0	\$0	\$157,995	\$0	\$157,995
2023	Oct	\$0	\$0	\$119,615	\$0	\$119,615
2023	Nov	\$0	\$0	\$149,472	\$0	\$149,472
2023	Dec	\$0	\$0	\$54,212	\$0	\$54,212
2023	All	\$0	\$0	\$1,235,066	\$0	\$1,235,066
2024	Jan	\$0	\$0	\$159,892	\$0	\$159,892
2024	Feb	\$0	\$0	\$96,114	\$0	\$96,114
2024	Mar	\$0	\$0	\$129,812	\$0	\$129,812
2024	Apr	\$0	\$0	\$96,528	\$0	\$96,528
2024	May	\$0	\$0	\$289,740	\$0	\$289,740
2024	Jun	\$0	\$0	\$123,529	\$0	\$123,529
2024	Jul	\$0	\$0	\$311,806	\$0	\$311,806
2024	Aug	\$0	\$0	\$395,574	\$0	\$395,574
2024	Sep	\$0	\$0	\$114,300	\$0	\$114,300
2024	Oct	\$0	\$0	\$365,548	\$0	\$365,548
2024	Nov	\$0	\$0	\$45,482	\$0	\$45,482
2024	Dec	\$0	\$0	\$138,490	\$0	\$138,490
2024	All	\$0	\$0	\$2,266,815	\$0	\$2,266,815

Table 10-34 provides secondary reserve credits by resource type for 2024. Despite clearing a total of tens of thousands of MWh day-ahead, combined-cycle units, coal steam units, and natural-gas steam units cleared zero MWh of secondary reserve in real time.

**Table 10-34 Secondary reserve credits by resource type: 2024**

Resource / Fuel Type	Real-Time		Day-Ahead Credits	Balancing MCP Credits	LOC Credits	Total Credits
	Day-Ahead MWh	Capped MWh				
CT - Natural Gas	95,900,249	129,768,083	\$0	\$0	\$1,976,145	\$1,976,145
Other	46,959	18,928,493	\$0	\$0	\$65,033	\$65,033
CT - Oil	16,440,396	18,915,393	\$0	\$0	\$65,022	\$65,022
Combined Cycle	55,757	0	\$0	\$0	\$58,852	\$58,852
RICE - Natural Gas	507,075	432,451	\$0	\$0	\$21,466	\$21,466
RICE - Oil	904,921	1,030,496	\$0	\$0	\$18,597	\$18,597
Steam - Coal	23,642	0	\$0	\$0	\$352	\$352
Steam - Natural Gas	6,657	0	\$0	\$0	\$107	\$107

Among other reasons, a secondary reserve resource is paid LOC credit when PJM determines that the resource was backed down in order to clear more secondary reserve. Because the supply of secondary reserves greatly exceeds the amount needed to meet the 30-minute reserve requirement, PJM does not actually back down resources to clear more secondary reserve. However, because of the method used by PJM to determine whether a resource was backed

<sup>94</sup> Unlike synchronized reserve, for secondary reserve, shortfall is accounted for in the balancing MCP credits and is not a separate item. The effective shortfall charge is the real-time SecR MCP multiplied by the shortfall MWh, a value used when calculating the balancing MCP credits.

down, PJM at times pays resources for an incorrectly determined real-time opportunity cost. For example, PJM erroneously treated resources coming online to provide energy as having been backed down to provide secondary reserves. PJM does not back down resources below their economic minimum to provide secondary reserves, but in 2024, for secondary reserve resources that did not clear day-ahead and were generating below their economic minimum points, PJM paid \$2,082,948 in LOC credits.

## Regulation Market

Regulation matches generation with short term changes in load by moving the output of selected resources up and down via an automatic control signal. Regulation is provided by generators with a short-term response capability (less than five minutes) or by demand response (DR). The PJM Regulation Market is operated as a single real-time market.

PJM filed proposed significant changes to the regulation market design with FERC on April 16, 2024.<sup>95</sup> The Commission Order of June 14, 2024, accepted the PJM proposal as filed. PJM will implement the changes to the regulation market in two phases.<sup>96</sup> Phase 1, scheduled to be implemented on October 1, 2025, will result in a single product, single signal market with one clearing price. Phase 2, to be implemented on October 1, 2026, will result in separate regulation up and regulation down markets. The proposed Phase 1 changes will eliminate many of the significant issues identified by the MMU that have resulted from a two product, two signal market design including the incorrect and inconsistent use and application of the MBF/MRTS.

This report analyzes the current regulation market design and results during 2024.

## Market Design

PJM's regulation market design is a result of Order No. 755.<sup>97</sup> The objective of PJM's regulation market design should be to minimize the cost to provide regulation using two resource types in a single market.

The regulation market includes resources following two signals: RegA and RegD. Resources responding to either signal help control ACE (area control error). RegA is

PJM's slow oscillation regulation signal and is designed for resources with the ability to sustain energy output for long periods of time, with slower ramp rates. RegD is PJM's fast oscillation regulation signal and is designed for resources with limited ability to sustain energy output and with faster ramp rates. Resources must qualify to follow one or both of the RegA and RegD signals, but will be assigned by the market clearing engine to follow only one signal in a given market hour.

The PJM regulation market design includes three clearing price components: capability (\$/MW, based on the MW offered); performance (\$/mile, based on the total MW movement requested by the control signal, known as mileage); and lost opportunity cost (\$/MW of lost revenue from the energy market as a result of providing regulation). The marginal benefit factor (MBF) and performance score translate a RegD resource's capability (actual) MW into marginal effective MW and offers into \$/effective MW.

The goal of the regulation market solution should be to meet the regulation requirement with the least cost combination of RegA and RegD. When solving for the least cost combination of RegA and RegD MW to meet the regulation requirement, the regulation market will substitute RegD MW for RegA MW when RegD is cheaper. Performance adjusted RegA MW are used as the common unit of measure, called effective MW, of regulation service. All resource MW (RegA and RegD) are converted into effective MW. RegA MW are converted into effective MW by multiplying the RegA MW offered by their performance score. RegD MW are converted into effective MW by multiplying the RegD offered by their performance score and by the MBF. The regulation requirement is defined as the total effective MW required to provide a defined amount of area control error (ACE) control.

The regulation market converts performance adjusted RegD MW into effective MW using the MBF in the PJM design. The MBF is used to convert incremental additions of RegD MW into incremental effective MW. The total effective MW for a given amount of RegD MW equal the area under the MBF curve (the sum of the incremental effective MW contributions). RegA and RegD resources should be paid the same price per effective MW.

The marginal rate of technical substitution (MRTS) is the marginal measure of substitutability of RegD resources

<sup>95</sup> PJM, "Regulation Market Design Filing," Docket No. ER24-1772-000 (April 16, 2024).

<sup>96</sup> See 187 FERC ¶ 61,173.

<sup>97</sup> Order No. 755, 137 FERC ¶ 61,064 at P 2 (2011).

for RegA resources in satisfying a defined regulation requirement at feasible combinations of RegA and RegD MW. While resources following RegA and RegD can both provide regulation service in PJM's Regulation Market, PJM's joint optimization is intended to determine and assign the optimal mix of RegA and RegD MW to meet the hourly regulation requirement. The optimal mix is a function of the relative effectiveness and cost of available RegA and RegD resources.

At any valid combination of RegA and RegD, regulation offers are converted to dollars per effective MW using the RegD offer and the MBF associated with that combination of RegA and RegD. The marginal contribution of a RegD MW to effective MW is equal to the MRTS associated with that RegA/RegD combination.

For example, a 1.0 MW RegD resource with a total offer price of \$2 per MW with a MBF of 0.5 and a performance score of 100 percent would be calculated as offering 0.5 effective MW (0.5 MBF times 1.00 performance score times 1 MW). The total offer price would be \$4 per effective MW (\$2 per MW offer divided by the 0.5 effective MW).

Regulation performance scores (0.0 to 1.0) measure the response of a regulating resource to its assigned regulation signal (RegA or RegD) every 10 seconds by measuring: delay, the time delay of the regulation response to a change in the regulation signal; correlation, the correlation between the regulating resource output and the regulation signal; and precision, the difference between the regulation response and the regulation requested.<sup>98</sup> Performance scores are reported on an hourly basis for each resource.


Table 10-35 and Figure 10-31 show the average performance score by resource type and the signal followed in 2024. In these figures, the MW used are actual MW and the performance score is the hourly performance score of the regulation resource.<sup>99</sup> Each category (color bar) is based on the percentage of the full performance score distribution for each resource (or signal) type. As Figure 10-31 shows, 75.4 percent of RegD resources had average performance scores within the 0.91-1.00 range, and 21.8 percent of RegA resources had average performance scores within that range in 2024. In 2023, 68.0 percent of RegD resources

had average performance scores within the 0.91-1.00 range, and 20.3 percent of RegA resources had average performance scores within that range.

**Table 10-35 Hourly average performance score by unit type: 2024**

		Performance Score Range			
		61-70	71-80	81-90	91-100
RegA	Battery	0.0%	0.0%	0.0%	100.0%
	CT	0.0%	3.7%	77.3%	19.0%
	Diesel	0.0%	0.0%	2.0%	98.0%
	DSR	0.0%	0.0%	0.0%	100.0%
	Hydro	2.4%	1.5%	45.8%	50.3%
	Steam	3.9%	24.0%	61.8%	9.9%
RegD	Battery	0.3%	4.0%	20.2%	75.6%
	CT	1.2%	16.8%	13.3%	68.7%
	Diesel	0.0%	0.0%	44.8%	55.2%
	DSR	0.0%	19.3%	4.6%	76.1%
	Hydro	0.0%	0.0%	100.0%	0.0%
	Steam	-	-	-	-

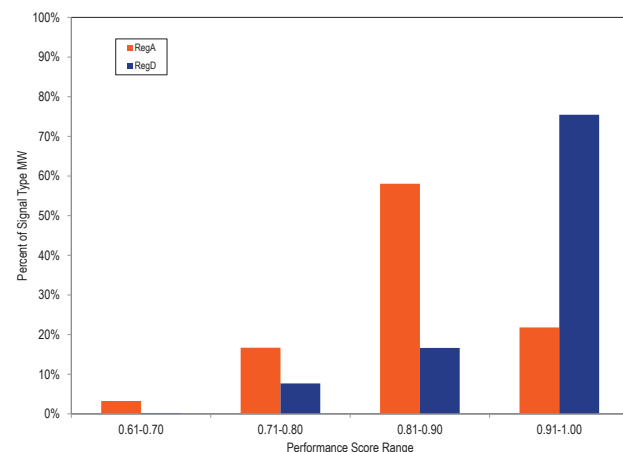**Figure 10-31 Hourly average performance score by regulation signal type: 2024**



Each cleared resource in a class (RegA or RegD) is allocated a portion of the class signal (RegA or RegD). This portion of the class signal is based on the cleared regulation MW of the resource relative to the cleared MW for that class. This signal is called the Total Regulation Signal (TREG) for the resource. A resource that cleared 10 MW of capability (AREG) will be provided a percentage TREG signal asking for a positive or negative regulation movement between negative and positive 100 percent (10 MW) around its regulation set point.

The MMU identified an issue with the current method of calculating the regulation performance score of a resource. The issue is that the delay and correlation components of the performance score do not accurately

<sup>98</sup> PJM "Manual 12: Balancing Operations," § 4.5.6 Performance Score Calculation, Rev. 54 (July Dec. 17, 2024).

<sup>99</sup> Except where explicitly referred to as effective MW or effective regulation MW, MW means actual MW unadjusted for either MBF or performance factor.

reflect how well a unit is responding to the regulation signal. These delay and correlation components can remain high, even when a unit is responding poorly to the regulation signal, and artificially inflate the overall performance score of the unit. For example, during the Winter Storm Elliott event, several units were not able to maintain their response to the regulation signal. These units received a precision score of zero, however, their delay and accuracy scores were near perfect (>0.95). This resulted in several units receiving regulation credits because their overall performance score was approximately 0.65 (each component of the performance score has an equal 1/3 weighting) despite not actually providing regulation. To address this issue, the MMU has proposed to evaluate regulation performance using a precision based performance score, which would only depend on the difference between the regulation signal and the unit's response to that signal.

$$Performance\ Score_{10Sec} = 1 - ABS\left(\frac{RegOutputMW - SignalMW}{AReg}\right)$$

With the total performance score for the clearing interval being the average of each 10 second performance score. This means that, in a simplified 10 second interval, a unit that cleared 10 MW (AREG = 10 MW) responding with a steady 7.5 MW (75 percent of their total capability) to a positive pegged signal (Signal MW = 10; TREG = 100 percent) would logically receive a performance score of 0.75. The MMU presented this recommendation to the regulation market senior task force.

PJM's proposed solution evaluates the 10 second error in a unit's output based on the average regulation signal MW during the entire clearing interval.<sup>100</sup>


$$Performance\ Score_{10Sec} = 1 - ABS\left[\frac{(RegOutputMW - SignalMW)}{\left(\frac{ClearingIntervalAvgSignal + AReg}{2}\right)}\right]$$

This has the effect of scaling each 10 second performance score based on the clearing interval average of the overall regulation signal. Using this equation in the simplified case above would yield a performance score equal to 0.75 only if the clearing interval average signal is pegged, and less than 0.75 when the clearing interval average signal is close to zero.

Figure 10-32 illustrates an example unit that cleared 100 MW of regulation, following the regulation signal for one hour. Based on the MMU's proposed performance score calculation, the unit would have a performance score of 0.8450 for the hour. Using PJM's proposed calculation, that same unit would have a performance score of only 0.6981 for the hour because the clearing interval average signal is small (2.7 MW). If both the regulation signal and the unit's response in this example were shifted up (or down) by 10 MW, the MMU's result would remain the same, because it only depends on the response of the unit to the signal it is supposed to follow. The PJM result however, would change to 0.7249 because the clearing interval average signal would increase to 12.7 MW. PJM's calculation would lead to different results, based solely on the overall clearing interval average of the regulation signal; identical unit performance would yield different performance score results.

<sup>100</sup> The current regulation clearing interval is one hour. The proposed change is to move to a 30 minute clearing interval.

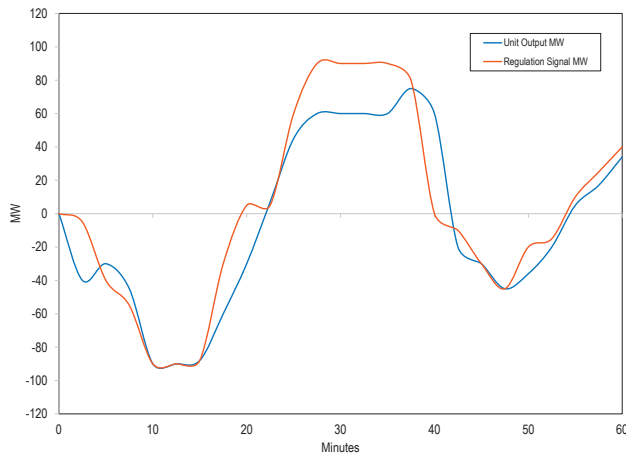**Figure 10-32 A unit providing 100 MW of regulation while following an almost neutral regulation signal**



Resources are paid Regulation Market Clearing Price (RMCP) credits and lost opportunity cost credits, which are uplift payments. If a resource's lost opportunity costs for an hour are greater than its RMCP credits, that resource receives lost opportunity cost credits equal to the difference. PJM posts clearing prices for the regulation market (RMCCP, RMPCP and RMCP) in dollars per effective MW. The regulation market clearing price (RMCP in \$/effective MW) for the hour is the simple average of the 12 five minute RMCPs within the hour. The RMCP is set in each five minute interval based on the marginal offer in each interval. The performance clearing price (RMPCP in \$/effective MW) is based on the marginal performance offer (RMPCP) for the hour. The capability clearing price (RMCCP in \$/effective MW) is equal to the difference between the RMCP for the hour and the RMPCP for the hour. This is done so the total of RMPCP plus RMCCP equals the total clearing price (RMCP) but the RMPCP is maximized.

Market solution software relevant to regulation consists of the Ancillary Services Optimizer (ASO) solving hourly; the intermediate term security constrained economic dispatch market solution (IT SCED) solving every 15 minutes; and the real-time security constrained economic dispatch market solution (RT SCED) solving approximately every five minutes. The market clearing price is determined by pricing software (LPC) that looks at the units cleared in the most recently approved RT SCED case, approximately 10 minutes ahead of the target solution time. The marginal prices assigned by the

LPC to five minute intervals are averaged over the hour for an hourly regulation market clearing price.

## Market Design Issues

PJM's current regulation market design is severely flawed and is not efficient or competitive. The market results do not represent the least cost solution for the defined level of regulation service.

In a well functioning market, every resource should be paid the same clearing price per unit produced. That is not true in the PJM Regulation Market. RegA and RegD resources are not paid the same clearing price in dollars per effective MW. RegD resources are being paid more than the market clearing price. This flaw in the market design has caused operational issues, has caused over investment in RegD resources.

If all MW of regulation were treated the same in both the clearing of the market and in settlements, many of the issues in the PJM Regulation Market would be resolved. However, the current PJM rules result in the payment to RegD resources being up to 1,000 times the correct price.

RegA and RegD have different physical capabilities. In order to permit RegA and RegD to compete in the single PJM Regulation Market, RegD must be translated into the same units as RegA. One MW of RegA is one effective MW. The translation is done using the marginal benefit factor (MBF). As more RegD is added to the market, the relative value of RegD declines, based on its actual performance attributes. For example, if the MBF is 0.001, a MW of RegD is worth 0.001 MW of RegA (or 1/1,000 of a MW of RegA). This is the same thing as saying that 1.0 MW of RegD is equal to 0.001 effective MW when the MBF is 0.001.

Almost all of the issues in PJM's Regulation Market are caused by the inconsistent application of the MBF. Because the MBF is not included in settlements, when the MBF is less than 1.0, RegD resources are paid too much. When the MBF is less than 1.0, each MW of RegD is worth less than 1.0 MW of RegA. The market design buys the correct amount of RegD, but pays RegD as if the MBF were 1.0. In an extreme case, when the MBF is 0.001, RegD MW are paid 1,000 times too much. If the market clearing price is \$1.00 per MW of RegA, RegD is paid \$1,000 per effective MW. Resolution of this problem



requires that PJM pay RegD for the same effective MW it provides in regulation, 0.001 MW.

To address the identified market flaws, the MMU and PJM developed a joint proposal which was approved by the PJM Members Committee on July 27, 2017, and filed with FERC on October 17, 2017. The PJM/MMU joint proposal addresses issues with the inconsistent application of the marginal benefit factor throughout the optimization and settlement process in the PJM Regulation Market. FERC rejected the proposal finding it inconsistent with Order No. 755.

The MBF related issues with the regulation market have been raised in the PJM stakeholder process. In 2015, PJM stakeholders approved an interim, partial solution to the RegD over procurement problem which was implemented on December 14, 2015. The interim solution was designed to reduce the relative value of RegD MW in all hours and to cap purchases of RegD MW during critical performance hours. But the interim solution did not address the fundamental issues in the optimization or the lack of consistency in the application of the MBF.

Additional changes were implemented on January 9, 2017. These modifications included changing the definition of off peak and on peak hours, adjusting the currently independent RegA and RegD signals to be interdependent, and changing the 15 minute neutrality requirement of the RegD signal to a 30 minute neutrality requirement.

The January 9, 2017, design changes appear to have been intended to make RegD more valuable. That is not a reasonable design goal. The design goal should be to determine the least cost way to provide needed regulation. The RegA signal is now slower than it was previously, which may make RegA following resources less useful as ACE control. RegA is now explicitly used to support the conditional energy neutrality of RegD. The RegD signal is now the difference between ACE and RegA. RegA is required to offset RegD when RegD moves in the opposite direction of that required by ACE control in order to permit RegD to recharge. These changes in the signal design will allow PJM to accommodate more RegD in its market solutions. The new signal design is not making the most efficient use of RegA and RegD resources. The explicit reliance on RegA to offset issues with RegD is a significant conceptual change to the design that is inconsistent with the long term design

goal for regulation. PJM increased the regulation requirement as part of these changes.

The January 9, 2017, design changes replaced off peak and on peak hours with nonramp and ramp hours with definitions that vary by season. The regulation requirement for ramp hours was increased from 700 MW to 800 MW (Table 10-36). These market changes did not address the fundamental issues in the optimization or the lack of consistency in the application of the MBF.

**Table 10-36 Seasonal regulation requirement definitions<sup>101</sup>**

Season	Dates	Nonramp Hours	Ramp Hours
Winter	Dec 1 – Feb 28(29)	00:00 – 03:59	04:00 – 08:59
		09:00 – 15:59	16:00 – 23:59
Spring	Mar 1 – May 31	00:00 – 04:59	05:00 – 07:59
		08:00 – 16:59	17:00 – 23:59
Summer	Jun 1 – Aug 31	00:00 – 04:59	05:00 – 13:59
		14:00 – 17:59	18:00 – 23:59
Fall	Sep 1 – Nov 30	00:00 – 04:59	05:00 – 07:59
		08:00 – 16:59	17:00 – 23:59

### Performance Scores

Performance scores, by class and unit, are not an indicator of how well resources contribute to ACE control. Performance scores are an indicator only of how well the resources follow their TREG signal. High performance scores with poor signal design are not a meaningful measure of performance. For example, if ACE indicates the need for more regulation but RegD resources have provided all their available energy, the RegD regulation signal will be in the opposite direction of what is needed to control ACE. So, despite moving in the wrong direction for ACE control, RegD resources would get a good performance score for following the RegD signal and will be paid for moving in the wrong direction.

The RegD signal prior to January 9, 2017, is an example of a signal that resulted in high performance scores, but due to 15 minute energy neutrality built into the signal, ran counter to ACE control at times. Energy neutrality means that energy produced equals energy used within a defined timeframe. With 15 minute energy neutrality, if a battery were following the regulation signal to provide MWh for 7.5 minutes, it would have to consume the same amount of MWh for the next 7.5 minutes. When neutrality correction of the RegD signal is triggered, it overrides ACE control in favor of achieving zero net

<sup>101</sup> See PJM, "Regulation Requirement Definition," <<http://www.pjm.com/~media/markets-ops/ancillary/regulation-requirement-definition.ashx>>.

energy over the 15 minute period. When this occurs, the RegD signal runs counter to the control of ACE and hurts rather than helps ACE. In that situation, the control of ACE, which must also offset the negative impacts of RegD, depends entirely on RegA resources following the RegA signal. High performance scores under the signal design prior to January 9, 2017, was not an indication of good ACE control.

The January 9, 2017, design changes did not address the fundamental issues with the definition of performance or the nature of payments for performance in the regulation market design. The regulation signal should not be designed to favor a particular technology. The signal should be designed to result in the lowest cost of regulation to the market. Only with a performance score based on full substitutability among resource types should payments be based on following the signal. The MRTS must be redesigned to reflect the actual capabilities of technologies to provide regulation. The PJM regulation market design remains fundamentally flawed.

In addition, the absence of a performance penalty, imposed as a reduction in performance score and/or as a forfeiture of revenues, for deselection initiated by the resource owner within the hour, creates a possible gaming opportunity for resources which may overstate their capability to follow the regulation signal. The MMU recommends that there be a penalty enforced as a reduction in performance score and/or a forfeiture of revenues when resource owners elect to deassign assigned regulation resources within the hour, to prevent gaming.

## Battery Settlement

The change from 15 to 30 minute signal neutrality, implemented in the January 9, 2017, design changes, resulted in the reduction of performance scores for short duration batteries. In April 2017 several participants filed a complaint against PJM, asserting that these changes discriminated against their battery units.<sup>102</sup> The MMU objected to the complaints. Despite the unsupported assertions in the complaint, PJM settled with the participants. The settlement was approved by FERC on April 7, 2020.<sup>103</sup> Table 10-37 shows the battery units that are part of the settlement. Starting July 1, 2020, the affected battery units began receiving compensation

based on the greater of their current performance score, or their rolling average actual hourly performance score for the last 100 hours the resource operated prior to the January 9, 2017, implementation of the 30-minute conditional neutrality.

In addition to paying uneconomic regulation credits based on inflated performance scores, the settlement also required that the affected battery units be cleared in the regulation market regardless of whether their offer was economic. As long as the settlement batteries were offered as either self scheduled with a zero offer, or as a zero priced offer, they must be cleared despite the fact that these units would not necessarily have cleared based on economics.<sup>104</sup> In order to comply with this condition, PJM cleared additional MW beyond what was needed for the regulation requirement in cases where the settlement battery units did not clear but met the offer rules of the settlement. This resulted in excess charges to customers for regulation service.

The total additional regulation credits received as a result of the settlement, as well as the additional regulation MW cleared as a result of the settlement, from July 2020 through December 2023, are shown in Table 10-38. From July 2020 through December 2023, the battery settlement provided \$5.6 million in excess regulation credits, and resulted in 32,536.1 MW of additional cleared regulation. The term of the settlement was for 42 months, and ended December 31, 2023.

**Table 10-37 Batteries in settlement**

Parent Company	Unit	MW	Status
The AES Corporation	Laurel Mountain	32.0	Active
	Warrior Run	10.0	Retired
Energy Capital Partners, LLC	Hazel	20.0	Active
	Trent	4.0	Retired
Galt Power, Inc.	McHenry	20.0	Active
	Beckjord 1	2.0	Active
	Beckjord 2	2.0	Active
Invenergy, LLC	Beech Ridge	31.5	Active
	Grand Ridge 6	4.5	Retired
	Grand Ridge 7	31.5	Active
	Lee Dekalb	20.0	Active
NextEra Energy, Inc.	Garrett	10.4	Active
	Meyersdale	18.0	Active
	Mantua Creek	2.0	Active
Renewable Energy Systems Holdings, LTD	Joliet	20.0	Retired
	West Chicago	20.0	Retired
Sumitomo Corporation	Wiley	6.0	Active

<sup>102</sup> See FERC Docket Nos. EL17-64-000 and EL17-65-000.

<sup>103</sup> See 170 FERC ¶ 61,258 (2020).

<sup>104</sup> See *id.* at P 17.

**Table 10–38 Total excess regulation credits received and monthly additional MW cleared due to battery settlement: July 2020 through December 2023**

Battery Settlement Impact			
Year	Month	Regulation Credit (\$)	Additional Cleared Regulation MW
2020	Jul	\$56,031	171.2
	Aug	\$42,673	233.1
	Sep	\$33,153	535.2
	Oct	\$70,934	631.7
	Nov	\$63,252	603.3
	Dec	\$70,873	1,127.3
	Total	\$336,917	3,301.7
2021	Jan	\$90,139	3,149.4
	Feb	\$107,544	1,727.7
	Mar	\$113,896	3,192.6
	Apr	\$140,436	4,872.3
	May	\$183,125	7,718.7
	Jun	\$62,989	147.4
	Jul	\$78,109	26.3
	Aug	\$136,571	8.5
	Sep	\$113,884	26.9
	Oct	\$190,648	1,046.2
	Nov	\$226,473	238.7
	Dec	\$119,035	4.9
	Total	\$1,562,848	22,159.4
2022	Jan	\$234,340	54.5
	Feb	\$94,937	384.3
	Mar	\$114,254	833.3
	Apr	\$129,724	24.7
	May	\$108,873	78.9
	Jun	\$180,607	33.5
	Jul	\$170,781	240.9
	Aug	\$227,416	234.9
	Sep	\$183,432	182.8
	Oct	\$149,534	133.1
	Nov	\$86,040	83.1
	Dec	\$665,772	105.2
	Total	\$2,345,711	2,389.1
2023	Jan	\$94,110	47.5
	Feb	\$78,473	122.7
	Mar	\$89,127	334.9
	Apr	\$152,817	1,548.2
	May	\$134,084	201.3
	Jun	\$126,184	267.5
	Jul	\$130,840	187.9
	Aug	\$109,813	118.2
	Sep	\$131,305	1,183.1
	Oct	\$146,004	313.5
	Nov	\$93,332	241.6
	Dec	\$82,918	119.6
	Total	\$1,369,008	4,685.8
Total		\$5,614,484	32,536.1

## Regulation Signal

As with any signal design for substitutable resources, the MBF function should be determined by the ability of RegA and RegD resources to follow their signals, including conditions under which neutrality cannot be maintained by RegD resources. The ability of energy limited RegD to provide ACE control depends on the availability of excess RegA capability to support RegD under the conditional neutrality design. When

RegD resources are largely energy limited resources, a correctly calculated MBF would exhibit a rapid decrease in the MBF value for every MW of RegD added. The result is that only a small amount of energy limited RegD is economic. The current and proposed signals and corresponding MBF functions do not reflect these principles or the actual substitutability of resource types.

Through the ongoing stakeholder regulation task force, the MMU has proposed several changes to address the current issues with the regulation signal market design. The MMU proposes that the two signals be combined into one, simplified regulation signal. All units would be cleared based on their total performance adjusted offers, with performance scores used as a tie breaker for equal offers (the status quo). Performance scores would be modified to only include a precision score. The move to a single signal would also eliminate the 30-minute signal neutrality but the regulation market clearing period would be shortened from one hour to 30 minutes. This would allow units with issues providing for a full hour to leave the market if needed without the regulation signal being tailored to uneconomically accommodate specific unit types.

## Marginal Benefit Factor Issues

The MBF function, as implemented in the PJM Regulation Market, is not equal to the MRTS between RegA and RegD. The MBF is not consistently applied throughout the market design, from optimization to settlement, and market clearing does not confirm that the resulting combinations of RegA and RegD are realistic and can meet the defined regulation demand. The calculation of total regulation cleared using the MBF is incorrect.<sup>105</sup>

The result has been that the PJM Regulation Market has over procured RegD relative to RegA in most hours, has provided a consistently inefficient market signal to participants regarding the value of RegD in every hour, and has overpaid for RegD. This over procurement has degraded the ability of PJM to control ACE in some hours while at the same time increasing the cost of regulation. When the price paid for RegD is above the level defined by an accurate MBF function, there is an artificial incentive for inefficient entry of RegD resources.

PJM and the MMU filed a joint proposal with FERC on October 17, 2017, to address issues with the inconsistent

<sup>105</sup> The MBF, as used in this report, refers to PJM's incorrectly calculated MBF and not the MBF equivalent to the MRTS.

application of the marginal benefit factor throughout the optimization and settlement process in the PJM Regulation Market, but the proposal was rejected by FERC.<sup>106</sup>

### Marginal Benefit Factor Not Correctly Defined

The MBF used in the PJM Regulation Market prior to the December 14, 2015, changes did not accurately reflect the MRTS between RegA and RegD resources under the old market design, and it does not accurately reflect the MRTS between RegA and RegD resources under the current design. The MBF function is incorrectly defined and improperly implemented in the current PJM Regulation Market.

The MBF should be the marginal rate of technical substitution between RegA and RegD MW at different, feasible combinations of RegA and RegD that can be used to provide a defined level of regulation service. The objective of the market design is to find, given the relative costs of RegA and RegD MW, the least cost feasible combination of RegA and RegD MW. If the MBF function is incorrectly defined, or improperly implemented in the market clearing and settlement, the resulting combinations of RegA and RegD will not represent the least cost solution and may not be a feasible way to reach the target level of regulation.

The MBF is not included in PJM's settlement process. This is a design flaw that results in incorrect payments for regulation. The issue results from two FERC orders. From October 1, 2012, through October 31, 2013, PJM implemented a FERC order that required the MBF to be fixed at 1.0 for settlement calculations only. On October 2, 2013, FERC directed PJM to eliminate the use of the MBF entirely from settlement calculations of the capability and performance credits and replace it with the RegD to RegA mileage ratio in the performance credit paid to RegD resources, effective retroactively to October 1, 2012.<sup>107</sup> That rule continues in effect. The result of the current FERC order is that the MBF is used in market clearing to determine the relative value of an additional MW of RegD, but the MBF is not used in the settlement for RegD.

If the MBF were consistently applied, every resource would receive the same clearing price per marginal effective MW. But the MBF is not consistently applied

and resources do not receive the same clearing price per marginal effective MW.

The change in design decreased RegA mileage (the change in MW output in response to regulation signal per MW of capability), increased the proportion of cleared RegD resources' capability that was called by the RegD signal (increased REG for a given MW) to better match offered capability, increased the mileage required of RegD resources and changed the energy neutrality component of the signal from a strict 15 minute neutrality to a conditional 30 minute neutrality. The changes in signal design increased the mileage ratio (the ratio of RegD mileage to RegA mileage). In addition, to adapt to the 30 minute neutrality requirement, some RegD resources decreased their offered capability to maintain their performance.


Figure 10-33 shows the daily average MBF and the mileage ratio. The weighted average mileage ratio decreased from 5.97 in 2023, to 5.75 in 2024 (a decrease of 3.6 percent). The average MBF decreased from 0.92 in 2023, to 0.80 in 2024 (a decrease of 13.3 percent). The high mileage ratios are the result of the mechanics of the mileage ratio calculation. Extreme mileage ratios result when the RegA signal is fixed at a single value (pegged) to control ACE and the RegD signal is not. If RegA is held at a constant MW output, mileage is zero for RegA. The result of a fixed RegA signal is that RegA mileage is very small and therefore the mileage ratio is very large.

These results are an example of why it is not appropriate to use the mileage ratio, rather than the MBF, to measure the relative value of RegA and RegD resources. In these events, RegA resources are providing ACE control by providing a fixed level of MW output which means zero mileage, while RegD resources alternate between helping and hurting ACE control, both of which result in positive mileage.

<sup>106</sup> 162 FERC ¶ 61,295 (2018), *reh'g denied*, 170 FERC ¶ 61,259 (2020).

<sup>107</sup> 145 FERC ¶ 61,011 (2013).

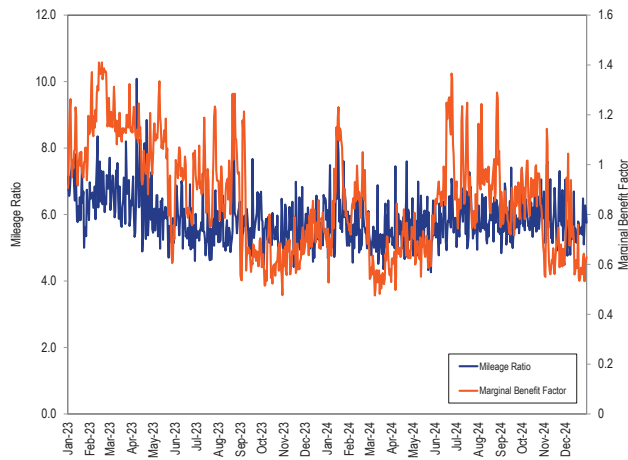**Figure 10–33 Daily average MBF and mileage ratio: January 2023 through December 2024**



The increase in the average mileage ratio caused by the signal design changes introduced on January 9, 2017, caused a large increase in payments to RegD resources on a performance adjusted MW basis.

Table 10-39 shows RegD resource payments on a performance adjusted actual MW basis and RegA resource payments on a performance adjusted MW basis by month, from January 1, 2023, through December 31, 2024. The average regulation market clearing price in 2024 was \$9.17 higher than in 2023 (See Table 10-53.) In 2024, RegD resources earned 15.8 percent more per performance adjusted actual MW than RegA resources (22.0 percent in 2023) due to the inclusion of the mileage ratio in RegD MW settlement.

**Table 10-39 Average monthly price paid per performance adjusted actual MW of RegD and RegA: January 2023 through December 2024**

Settlement Payments				
Year	Month	RegD	RegA	Percent RegD
		(\$/Performance Adjusted MW)	(\$/Performance Adjusted MW)	Overpayment (\$/Performance Adjusted MW)
2023	Jan	\$21.52	\$17.01	26.6%
	Feb	\$21.57	\$15.49	39.2%
	Mar	\$20.50	\$16.82	21.9%
	Apr	\$27.77	\$23.00	20.8%
	May	\$31.40	\$24.78	26.7%
	Jun	\$27.01	\$20.64	30.9%
	Jul	\$26.74	\$22.53	18.7%
	Aug	\$24.85	\$20.62	20.5%
	Sep	\$27.41	\$22.73	20.6%
	Oct	\$36.21	\$31.66	14.4%
	Nov	\$21.56	\$19.69	9.5%
	Dec	\$22.24	\$17.97	23.8%
Yearly		\$25.76	\$21.12	22.0%
2024	Jan	\$42.62	\$35.76	19.2%
	Feb	\$23.01	\$19.04	20.9%
	Mar	\$27.25	\$22.86	19.2%
	Apr	\$24.87	\$23.34	6.6%
	May	\$40.91	\$36.91	10.8%
	Jun	\$30.59	\$27.62	10.7%
	Jul	\$46.18	\$39.32	17.5%
	Aug	\$33.72	\$30.57	10.3%
	Sep	\$35.49	\$27.58	28.7%
	Oct	\$37.74	\$33.32	13.3%
	Nov	\$32.37	\$28.30	14.4%
	Dec	\$40.02	\$33.56	19.3%
Total		\$34.67	\$29.94	15.8%

The current settlement process does not result in paying RegA and RegD resources the same price per effective MW. RegA resources are paid on the basis of dollars per effective MW of RegA. RegD resources are not paid in terms of dollars per effective MW of RegA because the MBF is not used in settlements. Instead of being paid based on the MBF,  $(RMCCP + RMPCP) \times MBF$ , RegD resources are paid based on the mileage ratio  $(RMCCP + (RMPCP \times \text{mileage ratio}))$ . Because the RMCCP component makes up the majority of the overall clearing price, when the MBF is above one, RegD resources can be underpaid on a per effective MW basis by the current payment method, unless offset by a high mileage ratio. When the MBF is less than one, RegD resources are overpaid on a per effective MW basis, unless offset by a low mileage ratio. The average MBF was less than 1.0 in 2024 (0.80).

The effect of using the mileage ratio instead of the MBF for purposes of settlement is illustrated in Table 10-40. Table 10-40 shows how much RegD resources are currently being paid, adjusted to a per effective MW basis, on average, in 2023 and 2024 under the current rules, compared to how much RegD resources should




have been paid if they were actually paid for effective MW. Using the MBF consistently throughout the PJM regulation market would result in RegA and RegD resources being paid exactly the same on a per effective MW basis. However, the PJM regulation market only uses the MBF in the market clearing and setting of price on a dollar per effective MW basis, it does not use the MBF to convert RegD MW into effective MW for purposes of settlement. Because the MBF is not used to convert RegD MW into effective MW for purposes of settlement, RegD resources are paid the dollar per effective MW price, but this is paid for performance adjusted MW, not for effective MW. This causes the MW value of RegD resources to be inflated in settlement when the MBF is less than one and to be undervalued in settlement when the MBF is greater than one. In 2024, the MBF averaged 0.80, while the average daily mileage ratio was 5.75, resulting in RegD resources being paid \$12.8 million more than they would have been paid on an effective MW basis if the MBF were correctly implemented. In 2023, the MBF averaged 0.92, and the average mileage ratio was 5.97, resulting in RegD resources being paid \$7.6 million more than they would have been paid if the MBF were correctly implemented.

**Table 10-40 Average monthly price paid per effective MW of RegD and RegA under mileage and MBF based settlement: January 2023 through December 2024**

RegD Settlement Payments						
Year	Month	Mileage Based RegD (\$/Effective MW)	Marginal Rate of Technical Substitution Based RegD (\$/Effective MW)	RegA (\$/Effective MW)	Percent RegD Overpayment (\$/Effective MW)	Total RegD Overpayment (\$)
2023	Jan	\$22.25	\$17.01	\$17.01	30.9%	\$293,915
	Feb	\$16.90	\$15.49	\$15.49	9.1%	\$63,924
	Mar	\$17.10	\$16.82	\$16.82	1.7%	(\$115,093)
	Apr	\$26.48	\$23.00	\$23.00	15.1%	\$176,675
	May	\$32.82	\$24.78	\$24.78	32.4%	\$438,285
	Jun	\$32.81	\$20.64	\$20.64	59.0%	\$824,293
	Jul	\$29.16	\$22.53	\$22.53	29.4%	\$391,521
	Aug	\$35.51	\$20.62	\$20.62	72.2%	\$535,233
	Sep	\$47.29	\$22.73	\$22.73	108.1%	\$1,082,569
	Oct	\$83.65	\$31.66	\$31.66	164.2%	\$1,940,934
	Nov	\$41.59	\$19.69	\$19.69	111.2%	\$910,484
	Dec	\$40.18	\$17.97	\$17.97	123.6%	\$1,078,581
Yearly		\$35.62	\$21.12	\$21.12	68.6%	\$7,621,320
2024	Jan	\$56.67	\$35.76	\$35.76	58.4%	\$879,903
	Feb	\$33.20	\$19.04	\$19.04	74.4%	\$670,940
	Mar	\$72.24	\$22.86	\$22.86	216.0%	\$1,774,338
	Apr	\$48.61	\$23.34	\$23.34	108.3%	\$915,045
	May	\$89.43	\$36.91	\$36.91	142.3%	\$1,898,186
	Jun	\$33.39	\$27.62	\$27.62	20.9%	\$64,580
	Jul	\$57.63	\$39.32	\$39.32	46.6%	\$956,416
	Aug	\$36.83	\$30.57	\$30.57	20.5%	\$146,692
	Sep	\$49.28	\$27.58	\$27.58	78.7%	\$1,443,266
	Oct	\$42.57	\$33.32	\$33.32	27.8%	\$525,106
	Nov	\$66.99	\$28.30	\$28.30	136.7%	\$1,488,457
	Dec	\$88.99	\$33.56	\$33.56	165.1%	\$2,038,914
Total		\$56.52	\$29.94	\$29.94	88.8%	\$12,801,842

Figure 10-34 shows, the monthly maximum, minimum and average MBF, for January 2023 through December 2024. The average daily MBF in 2024 was 0.80. The average daily MBF in 2023 was 0.92. The bottom of the MBF range results from PJM's administratively defined MBF minimum threshold of 0.1.

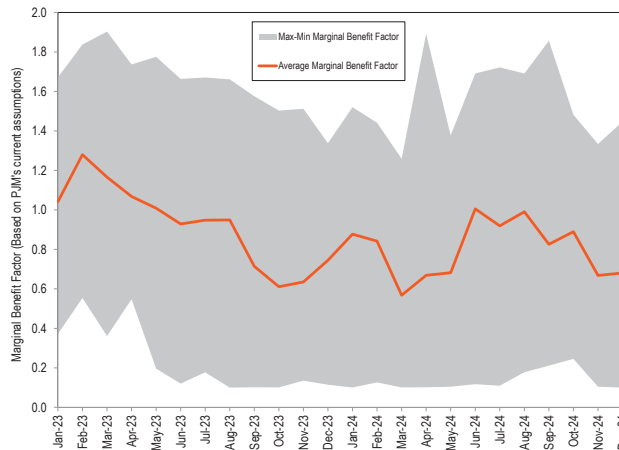**Figure 10-34 Maximum, minimum, and average PJM calculated MBF by month: January 2023 through December 2024**



The MMU recommends that the regulation market be modified to incorporate a consistent and correct application of the MBF throughout the optimization, assignment and settlement process.<sup>108</sup>

The overpayment of RegD has resulted in offers from RegD resources that are almost all at an effective cost of \$0.00 (\$0.00 offers plus self scheduled offers). RegD MW providers are ensured that such offers will clear and will be paid a price determined by the offers of RegA resources. This is evidence of the impact of the flaws in the clearing engine and the overpayment of RegD resources on the offer behavior of RegD resources.

Table 10-41 shows, by month, cleared RegD MW with an effective price of \$0.00 (units with zero offers plus self scheduled units) for January 2023 through December 2024. In 2024, an average of 92.7 percent of all RegD MW clearing the market had an effective offer of \$0.00. In 2023, an average of 95.3 percent of all cleared RegD MW had an effective cost of \$0.00. In 2024, an average of 67.2 percent of all RegD offers were self scheduled,

compared to an average of 62.1 percent of all RegD offers in 2023.

The high percentage of self scheduled offers is a result of the incentives created by the flaws in the regulation market. Because self scheduled offers are price takers, they are cleared along with the zero cost offers in the market clearing engine. However, unlike zero cost offers, self scheduled offers do not risk having an LOC added to their offer during the market clearing process, ensuring that self scheduled offers have a zero cost during market clearing. Given the increasing saturation of the regulation market with RegD MW, specifically demand response and battery units which do not receive LOC, market participants eligible for LOC that offer at zero instead of self scheduling, run the risk of an LOC added to their offer, and thus not clearing the market.

The average monthly RegD cleared in the market increased 11.3 MW (6.3 percent), from 179.8 MW in 2023 to 191.0 MW in 2024. The average monthly RegD cleared with an effective cost of zero increased 5.9 MW (3.4 percent), from 171.2 MW in 2023 to 177.0 MW in 2024. Self scheduled RegD cleared MW increased 15.8 MW (14.1 percent), from 112.4 MW in 2023 to 128.2 MW in 2024. Average cleared RegD MW with a zero cost offer decreased 9.9 MW (16.9 percent), from 58.8 MW in 2023 to 48.9 MW in 2024. The incorrect way that dual offers are offered and cleared in the regulation market has led to the decrease in the average monthly RegD cleared and the increase in the average monthly MBF seen in Figure 10-34.

<sup>108</sup> See "Regulation Market Review," Operating Committee (May 5, 2015) <<http://www.pjm.com/-/media/committees-groups/committees/oc/20150505/20150505-item-17-regulation-market-review.ashx>>.

**Table 10-41 Average cleared RegD MW and average cleared RegD with an effective price of \$0.00 by month: January 2023 through December 2024**

		Average Performance Adjusted Cleared RegD MW					
		\$0.00 Offer		Self Scheduled		Total Effective Cost of	Effective Cost of Zero
		\$0.00	Percent of	Self	Percentage	Cost of	Percentage
Year	Month	Offer	Total	Scheduled	of Total	Zero	of Total
2023	Jan	56.6	33.4%	110.5	65.2%	167.1	98.5%
	Feb	66.6	43.0%	82.9	53.5%	149.5	96.6%
	Mar	63.3	41.7%	84.7	55.8%	147.9	97.4%
	Apr	63.9	39.2%	88.7	54.4%	152.7	93.6%
	May	55.2	32.8%	100.0	59.5%	155.2	92.3%
	Jun	59.6	31.5%	120.4	63.6%	179.9	95.1%
	Jul	57.4	30.4%	124.0	65.6%	181.4	96.0%
	Aug	52.7	27.9%	120.9	64.0%	173.6	92.0%
	Sep	58.1	29.9%	128.6	66.3%	186.7	96.2%
	Oct	57.8	29.4%	130.5	66.4%	188.2	95.8%
	Nov	56.5	28.9%	129.3	66.1%	185.8	95.0%
	Dec	57.8	29.4%	128.0	65.2%	185.9	94.6%
Yearly		58.7	32.6%	112.6	62.6%	171.3	95.2%
2024	Jan	54.5	28.0%	126.2	64.9%	180.7	92.9%
	Feb	45.5	24.5%	128.6	69.2%	174.1	93.7%
	Mar	52.0	26.0%	138.1	68.9%	190.1	94.9%
	Apr	49.3	25.5%	130.4	67.4%	179.8	92.8%
	May	50.5	26.3%	126.4	65.9%	177.0	92.3%
	Jun	41.8	22.5%	131.8	70.9%	173.6	93.4%
	Jul	46.6	23.8%	131.5	67.3%	178.0	91.1%
	Aug	48.8	26.0%	121.4	64.6%	170.3	90.6%
	Sep	48.7	26.8%	119.2	65.6%	167.9	92.4%
	Oct	38.6	21.9%	125.5	71.2%	164.1	93.1%
	Nov	47.9	24.4%	132.7	67.6%	180.6	92.0%
	Dec	62.0	30.6%	126.4	62.5%	188.4	93.1%
Total		48.9	25.6%	128.2	67.1%	177.1	92.7%

### Incorrect MBF and total effective MW when clearing units with dual product offers

Under PJM market rules, regulation units that have the capability to provide both RegA and RegD MW are permitted to submit an offer for both signal types in the same market hour. While the objective of the PJM market design is to find the least cost combination of RegA and RegD resources to provide the required level of regulation service, the method of clearing the regulation market for an hour in which one or more units has a dual offer is incorrect and leads to solutions that are not the most economic. The result of the flaw is that the MBF in the regulation market clearing phase is incorrectly low compared to the MBF in the market solution phase, too little RegD is cleared relative to the efficient amount, the RegD resources that do clear are underpaid when the resulting MBF is greater than 1.0 and the actual amount of effective MW procured is higher than the regulation requirement.

In order for the clearing engine to provide the correct economic solution when the pool of available resources contains one or more units with dual offers,

the calculation would have to be performed iteratively to determine which of the dual offers would provide the least cost solution. But this is not how PJM clears the regulation market when there are dual offer units. PJM rank orders the regulation supply curve by potential effective cost assuming the dual offer resources are available as both RegA and RegD resources simultaneously, and assigns every RegD resource, including dual offer resources, a unit specific benefit factor.

Each dual offer resource is assigned to run as either a RegD or RegA resource based on which of the two offers has a lower effective cost. But PJM does not redefine the supply curve using appropriately recalculated unit specific benefit factors for the remaining RegD resources prior to clearing the market.


During the clearing phase, the MBF of RegD resources is a function of the RegD MW that clear. The MBF for all RegD resources declines as more RegD resources are cleared. Based on this relationship, in the case where a dual offer unit is assigned to be a RegA resource rather than a RegD resource, the MBF of remaining RegD resources in the supply curve should increase. The placeholder RegD MW from the dual offer should be removed, the cleared MW from below the placeholder should be shifted up the supply/MBF curve, and additional RegD MW offers that were pushed below an MBF of zero and initially not included, should be considered. But PJM does not recalculate the MBF values for the remaining RegD resources when determining the cleared effective MW needed to satisfy the regulation requirement during the clearing phase. The result is that the MBF in the clearing phase is incorrectly low, and the actual amount of effective MW procured is higher.

After meeting the target effective MW to satisfy the regulation requirement for that hour through the clearing process, the unit specific benefit factors of those displaced units are recalculated in the real-time

operating phase and increased based on their actual contribution. The effective MW contributions of those originally displaced units are correctly calculated in the operating phase, but because the supply for that hour has already been set based on their incorrect effective MW, the solution includes more effective MW than calculated in the clearing phase. As a result, the market solution includes more than the target level of effective MW in the actual operating hour.


The issue is illustrated in Figure 10-35. The example shows a clearing phase and a real time operating phase. In this example, a 150 MW unit offers both RegA and RegD. The 150 MW unit's position in the RegD effective cost curve and the potential effective MW are represented as the orange area under the curve in the clearing phase. The effective MW of the cleared RegD resources with higher effective costs are represented by the blue triangle in the clearing phase. Not shown are additional RegD MW with higher effective costs that were assigned an MBF of 0 and not cleared. The 150 MW dual offer unit is chosen to operate as a RegA resource in the operational hour. As a result, the cleared supply for RegA in the clearing phase is the same RegA supply realized in the real time operating phase. But that is not the case for the RegD supply. Since the supply curve and unit specific benefit factors of RegD MW are not recalculated in the clearing phase after the 150 MW RegD offer is removed, the amount of effective MW realized in the real-time operating phase is inconsistent with the clearing phase. Because the RegD portion of the 150 MW dual offer unit was not chosen to be RegD MW, the RegD resources represented by the blue triangle in the clearing phase will contribute more effective MW (the blue area in the real-time solution phase) in the real-time solution phase than was assumed in the clearing phase because the MBF in the clearing phase was too low. Since the blue area under the curve in the real-time solution phase is greater than the blue area in the clearing phase and the amount of RegA remains the same between the clearing phase and real-time operating phase, the market will have cleared too many effective MW relative to the effective MW requirement. The MBF in the operating phase is higher than if the clearing had been solved correctly.

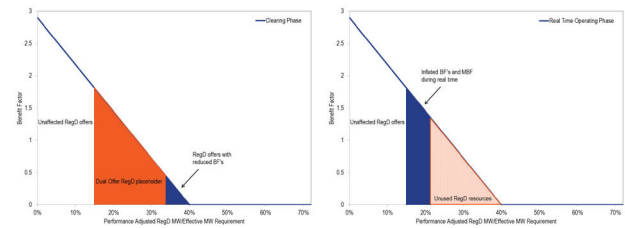**Figure 10-35 Clearing phase BF/effective MW reduction, real-time BF/effective MW inflation, and exclusion of available RegD resources**



In 2024, 41.2 percent of all hours had at least one unit with a dual offer. In 2024, 27.8 percent of all hours had at least one dual offer unit that was chosen to run as RegA, resulting in an average MBF increase of 0.26 in the operating phase. The average MBF increase due to dual offers clearing as RegA in 2023 was 0.45. This indicates that the amount of MW clearing as RegA from dual offers has increased, and the amount of RegD clearing has been artificially reduced, resulting in a higher MBF of RegD in the market solution in 2023. If the market had been cleared correctly, the correct average MBF would have been significantly lower in real time (operating phase), because additional RegD offers with lower benefit factors that were initially excluded, would have been included after the removal of the dual offer placeholder, reducing the MBF. Figure 10-36 illustrates the PJM calculated average MBF in real time (operating phase), the average amount the MBF is artificially increased (MBF displacement) due to dual offers clearing as RegA, and what the correct average MBF would have been in each hour of the day for 2024 if the clearing solution were solved correctly.

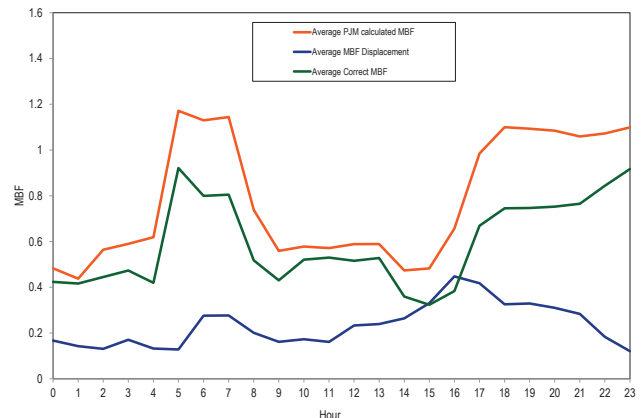**Figure 10-36 Effect of PJM's current dual offer clearing method on the average MBF in each hour of the day: 2024**



Absent the ability to correctly clear dual offers, the MMU recommends that the ability of resources to submit dual offers be removed. Under this revision to the rules, resources could offer as either RegA or RegD in a given hour, but not both within the same market hour.

## Price Spikes


Beginning in 2018, extreme price spikes were identified in the regulation market. The price spikes were caused by a combination of the inconsistent application of the MBF in the market design and the discrepancy between the hour ahead estimated LOC and the actual realized within hour LOC.

The regulation market is cleared on an hour ahead basis, using offers that are adjusted by dividing each component of an offer (capability, performance, and lost opportunity cost) by the product of the unit specific benefit factor and unit specific performance score. To calculate the hour ahead estimate of the adjusted LOC offer component, hour ahead projections of LMPs are used. Units are then cleared based on the sum of each of their hour ahead adjusted offer components. The actual LOC is used to determine the final, actual interval specific all in offer of RegD resources.

In some cases the estimated LOC is very low or zero but the actual within hour LOC is a positive number. In instances where the MBF of the within hour marginal unit is less than one (e.g. the marginal unit is a RegD unit), this discrepancy in the estimated and realized LOC will cause a large discrepancy between the expected offer price (as low as \$0/MW) and the realized offer price of the resource in the actual market result. This will cause a significant price spike in the regulation market. In cases where the MBF of the marginal resource is very low, such as 0.001, the price spikes can be very significant for a small change between expected and actual LOC. In January 2019, FERC approved PJM's proposal to create a 0.1 floor for the MBF to reduce the occurrence of these price spikes.<sup>109</sup> This change reduced the amount and frequency of the price spikes, but it was not designed to eliminate them and it did not eliminate them.

Figure 10-37 shows the LOC in each five minute interval in which the marginal unit had a unit specific benefit factor less than one (e.g. a RegD unit) and the LOC was greater than zero from 2022 through 2024.

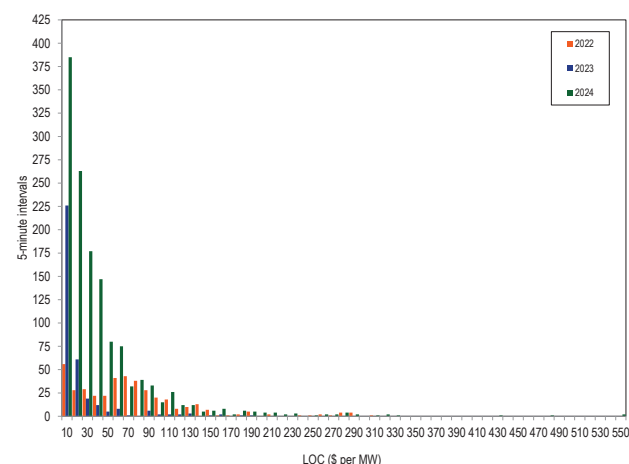**Figure 10-37 LOC distribution in each five minute interval with a RegD marginal unit and an LOC greater than zero: 2022, 2023, and 2024**



For a RegD resource to clear the regulation market with an MBF of 0.001, the resource's offer, in dollars per marginal effective MW, must be less than or equal to competing offers from RegA MW. A RegD offer of 1 MW with an MBF of 0.001 and a price of \$1 per MW, would provide 0.001 effective MW at a price of \$1,000 per effective MW. So long as RegA MW are available for less than \$1,000 per effective MW, this resource will not clear. The only way for RegD MW to clear to the point where the MBF of the last MW is 0.001, is if the offer price of the relevant resources that clear, including estimated LOC, is \$0.00. But, if the same resource(s) has a positive LOC within the hour, based on real-time changes in LMP, the zero priced offer is adjusted to reflect the positive LOC, resulting in an extremely high offer and clearing price for regulation.

While an incorrect estimate of a potential LOC can result in an extremely high price, the resulting regulation market prices are mathematically correct for the price of each effective MW. The prices in every interval reflect the marginal costs of regulation given the resources dispatched and accurately reflect the marginal offer of minimally effective resources which had unexpectedly high LOC components of their within hour offers. But, due to the current market design's failure to use the MBF in settlement, RegD is not paid on a dollar per effective MW basis. This disconnect between the process of setting price and the process of paying resources is the primary source of the market failure in PJM's Regulation Market and the cause of the observed

<sup>109</sup> See 166 FERC ¶ 61,040 (2019).



price spikes in the regulation market. In the example, the 0.001 MW from the RegD resource should be paid \$1,000 times 0.001 MW or \$1.00. But the current rules would pay the RegD resource \$1,000 times 1.0 MW or \$1,000. If the market clearing and the settlements rules were consistent, the incentive for this behavior would be eliminated. The current rules provide a strong incentive for this behavior.

The price spikes observed in PJM's Regulation Market are a symptom of a market failure in PJM's Regulation Market caused by an inconsistent application of the MBF between market clearing and market settlement. Due to the inconsistent application of the MBF, the current market results are not consistent with a competitive market outcome. In any market, resources should be paid the marginal clearing price for their marginal contribution. In the regulation market, all resources should be paid the marginal clearing price per effective MW and all resources in the regulation market should be paid for each of their effective MW. PJM's Regulation Market does not do this. PJM's market applies the MBF in determining the relative and total value of RegD MW in the market solution for purposes of market clearing and price, but does not apply the same logic in determining the payment of RegD for purposes of settlement. As a result, market prices do not align with payment for contributions to regulation service in market settlements.

The inconsistent application of the MBF in PJM's regulation market design is generating perverse incentives and perverse market results. The price spikes are a symptom of the problem, not the problem itself.

### Uplift Calculation Issues

Regulation uplift is calculated by comparing a resource's regulation offer price plus its regulation lost opportunity cost (including shoulder LOC if applicable) adjusted by the performance score, to the clearing price credits the unit received.<sup>110</sup> If the sum of the resource's offer plus LOC is greater than the amount of clearing price credits received, additional uplift credits are given equal to the difference.

The calculation of regulation uplift during settlements for coal and natural gas units is incorrect, and results in

the overpayment of uplift.<sup>111</sup> In order to determine the amount of regulation uplift, the difference between the MW output of the unit while it was providing regulation is compared to the desired MW output of the unit if it had not provided regulation. The desired MW output at LMP used in the calculation of regulation uplift during settlements is determined based on a unit's energy offer and the LMP during the interval being evaluated. But this desired MW does not account for the ability of a unit to actually produce the desired output because it ignores the fact that units have a limited physical ability ramp. It does not take into account the ramp rate. This results in the overpayment of uplift by paying for MW that the unit could not have produced given their energy market output at the beginning of the interval and their ramp rate.

Table 10-42 shows the amount of uplift overpayment by fuel type for 2024, as a result of the ramp rate not being used in the current calculation. The overpayments are calculated using a desired MW level that can be achieved in a five minute market interval based on the units' ramp rates. In 2024, overpayments totaled \$27.3 million. Coal units received 68.3 percent of the overpayment while providing 5.0 percent of settled regulation MW.

The MMU recommends that the ramp rate limited desired MW output be used in the regulation uplift calculation, to reflect the physical limits of the unit's ability to ramp and to eliminate overpayment for opportunity costs when the payment uses an unachievable MW.

<sup>110</sup> The clearing price for each interval is set by the marginal unit's total offer (capability and performance offers plus LOC), adjusted by the marginal unit's performance score, and does not include any shoulder LOC.

<sup>111</sup> Hydro units operate on a schedule rather than an energy bid, therefore a different equation is used to calculate their regulation LOC and uplift. The issue discussed does not effect that calculation. Also, demand response and battery units do not receive uplift.

**Table 10-42 Amount of LOC overpayment: January 2023 through December 2024**

		Uplift overpayment		
Year	Month	Coal	Natural Gas	Total
2023	Jan	\$219,632	\$409,362	\$628,995
	Feb	\$304,776	\$399,282	\$704,058
	Mar	\$606,703	\$547,406	\$1,154,109
	Apr	\$825,524	\$602,421	\$1,427,946
	May	\$528,304	\$847,798	\$1,376,102
	Jun	\$857,736	\$787,690	\$1,645,426
	Jul	\$1,061,210	\$508,118	\$1,569,328
	Aug	\$1,810,618	\$511,049	\$2,321,667
	Sep	\$937,997	\$544,952	\$1,482,949
	Oct	\$395,527	\$1,011,206	\$1,406,733
	Nov	\$307,590	\$538,204	\$845,794
	Dec	\$709,710	\$469,619	\$1,179,329
Total		\$8,565,327	\$7,177,108	\$15,742,435
2024	Jan	\$1,232,475	\$668,296	\$1,900,771
	Feb	\$776,377	\$351,419	\$1,127,796
	Mar	\$1,004,166	\$685,613	\$1,689,779
	Apr	\$1,554,338	\$725,974	\$2,280,312
	May	\$1,254,186	\$954,532	\$2,208,717
	Jun	\$1,675,670	\$636,096	\$2,311,766
	Jul	\$2,576,400	\$674,632	\$3,251,032
	Aug	\$1,908,099	\$496,129	\$2,404,228
	Sep	\$2,331,876	\$1,122,113	\$3,453,989
	Oct	\$1,008,340	\$1,145,836	\$2,154,176
	Nov	\$1,913,037	\$505,352	\$2,418,389
	Dec	\$1,400,408	\$700,542	\$2,100,950
Total		\$18,635,373	\$8,666,533	\$27,301,905

## Market Redesign

PJM proposes to separate the regulation market into two products: one that only needs to respond when the regulation signal is above zero (RegUp), and one that only needs to respond when the regulation signal is below zero (RegDown). This change would also allow units to clear both signals and operate the way they do currently. PJM has not done any systematic testing of the proposal. PJM has not explained what problem this design change is intended to fix, or analyzed what impact this design would have on reliability, or how this will affect the cost of regulation. The MMU recommends a single product market with a single signal.

On June 14, 2024, the FERC approved PJM's proposed market redesign, to be implemented in two phases. Phase one, using one signal and one market price, will go into effect on October 1, 2025, and will implement the proposed changes to the LOC and performance score. Phase two will go into effect on October 1, 2026, and will implement the RegUp and RegDown signal with a separate price for RegUp and for RegDown.<sup>112</sup>

<sup>112</sup> See Docket No. ER24-1772-000.

## Market Structure

### Supply

Table 10-43 shows average hourly offered MW (actual and effective), and average hourly cleared MW (actual and effective) for all hours in 2024.<sup>113</sup> Actual MW are adjusted by the historic 100-hour moving average performance score to get performance adjusted MW, and by the resource specific benefit factor to get effective MW. A resource can choose to follow either signal. For that reason, the sum of each signal type's capability can exceed the full regulation capability. Offered MW are calculated based on the offers from units that are designated as available for the day. These are daily offers that can be modified on an hourly basis up to 65 minutes before the hour.<sup>114</sup> Eligible MW are calculated from the hourly offers from units with daily offers and units that are offered as unavailable for the day, but still offer MW into some hours. Units with daily offers are permitted to offer above or below their daily offer from hour to hour. As a result of these hourly MW adjustments, the average hourly Eligible MW can be higher than the Offered MW.

In 2024, the average hourly offered supply of regulation for nonramp hours was 723.3 actual MW (732.6 effective MW). This was a decrease of 29.6 actual MW (a decrease of 26.6 effective MW) from 2023, when the average hourly offered supply of regulation was 693.7 actual MW (706.0 effective MW). In 2024, the average hourly offered supply of regulation for ramp hours was 1,007.7 actual MW (1,059.7 effective MW). This was an increase of 3.1 actual MW (an increase of 14.7 effective MW) from 2023, when the average hourly offered supply of regulation was 1,004.6 actual MW (1,045.0 effective MW).<sup>115</sup>

The ratio of the average hourly offered supply of regulation to average hourly regulation demand (actual cleared MW) for nonramp hours was 1.51 in 2024 (1.45 in 2023). The ratio of the average hourly offered supply of regulation to average hourly regulation demand (actual cleared MW) for ramp hours was 1.45 in 2024 (1.42 in 2023).

<sup>113</sup> Unless otherwise noted, analysis provided in this section uses PJM market data based on PJM's internal calculations of effective MW values, based on PJM's currently incorrect MBF curve. The MMU is working with PJM to correct the MBF curve.


<sup>114</sup> See "PJM Manual 11: Energy & Ancillary Services Market Operations," § 3.2.2 Regulation Market Eligibility, Rev. 133 (Dec. 17, 2024).

<sup>115</sup> Effective MW equal actual MW multiplied by the performance score and benefit factor for each unit. In the case of RegA, the benefit factor is always equal to one, and performance scores are always less than one, so effective MW of RegA are less than actual MW. For RegD resources effective MW can be larger than actual MW, if the benefit factor is greater than one. When adding RegA and RegD total MW together, actual MW can be larger or smaller than effective MW, depending on the influence of RegA MW and RegD MW.

**Table 10-43 Hourly average actual and effective MW offered and cleared: 2024<sup>116</sup>**

		By Resource Type			By Signal Type	
		All Regulation	Generating Resources	Demand Resources	RegA Following Resources	RegD Following Resources
Actual Offered MW	Ramp	1,007.7	953.1	54.6	777.7	230.0
	Nonramp	723.3	679.1	44.2	525.8	197.5
Effective Offered MW	Ramp	1,059.7	968.4	91.3	665.9	393.8
	Nonramp	732.6	673.0	59.6	449.1	283.5
Actual Cleared MW	Ramp	697.0	642.7	54.3	485.3	211.8
	Nonramp	477.8	435.3	42.5	284.8	193.0
Effective Cleared MW	Ramp	799.9	708.9	91.0	417.8	382.1
	Nonramp	526.5	467.6	58.8	244.8	281.7

The average hourly offered and cleared actual MW from RegA resources are shown in Figure 10-38. The average hourly offered MW from RegA resources during ramp hours for 2024 was 777.7 actual MW, an increase of 0.6 percent from 2023 (772.9 actual MW.) The average hourly offered MW from RegA resources during nonramp hours for 2024 was 525.8 actual MW, an increase of 4.6 percent from 2023 (502.5 actual MW). The average hourly cleared MW from RegA resources during ramp hours for 2024 was 485.3 actual MW, a decrease of 3.7 percent from 2023 (503.7 actual MW). The average hourly cleared MW from RegA resources during nonramp hours for 2024 was 284.8 actual MW, a decrease of 3.7 percent from 2023 (295.8 actual MW).

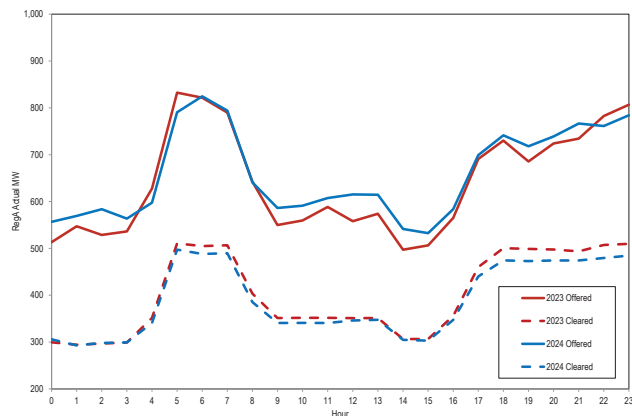**Figure 10-38 Average hourly RegA actual MW offered and cleared: 2023 through 2024<sup>117</sup>**

The average hourly offered MW from RegD resources during ramp hours for 2024 was 230.0 actual MW, a decrease of 0.7 percent from 2023 (231.7 actual MW). (Figure 10-39) The average hourly offered MW from

RegD resources during nonramp hours for 2024 was 197.5 actual MW, an increase of 3.3 percent from 2023 (191.2 actual MW) (Figure 10-39). The average hourly cleared MW from RegD resources during ramp hours for 2024 was 211.8 actual MW, an increase of 4.4 percent from 2023 (202.8 actual MW). The average hourly cleared MW from RegD resources during nonramp hours for 2024 was 193.0 actual MW, an increase of 6.1 percent from 2023 (182.0 actual MW).

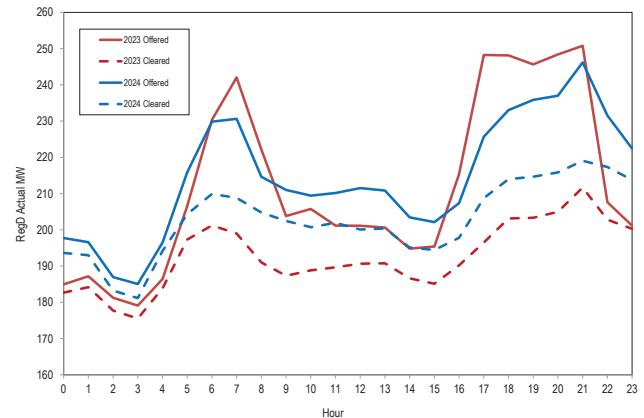
**Figure 10-39 Average hourly RegD actual MW offered and cleared: 2023 through 2024<sup>118</sup>**

Table 10-45 provides the settled regulation MW by source unit type, the total settled regulation MW provided by all resources, the percent of settled regulation provided by unit type, and the clearing price, uplift, and total regulation credits. In Table 10-45, the MW have been adjusted by the performance score since this adjustment forms the basis of payment for units providing regulation. Total regulation performance adjusted settled MW increased 0.7 percent from 4,525,718.7 MW in 2023 to 4,557,537.6 MW in 2024. The average proportion of regulation provided by demand response units increased

<sup>116</sup> PJM operations treats some nonramp hours as ramp hours, with a regulation requirement of 800 MW rather than 525 MW. All ramp/nonramp analysis performed is based on the requirement used in each hour rather than the definitions given in Table 10-2. A ramp hour occurring during what is normally a nonramp period is treated as a ramp hour.

<sup>117</sup> Offered MW includes MW from units that are dual offering as both RegA and RegD.

<sup>118</sup> Offered MW includes MW from units that are dual offering as both RegA and RegD.

the most, by 2.9 percentage points from 5.7 percent in 2023 to 8.6 percent in 2024, which reflected a 51.4 percent increase in the performance adjusted settled regulation MW from DR. Hydro units had the largest decrease in average proportion of regulation provided, decreasing 2.4 percentage points, from 19.7 percent in 2023 to 17.3 percent in 2024, which reflected a 11.8 percent decrease in the performance adjusted settled regulation MW from Hydro. The total regulation credits in 2024 were \$183,169,835, an increase of 41.3 percent from \$129,655,552 in 2023. The increase in regulation credits is due to higher energy prices in 2024 compared to 2023, resulting in a higher LOC component of the clearing price (LOC accounted for 81.0 percent of the daily weighted average clearing price), as well as higher uplift due to LOC.

When a resource offers into the regulation market, an estimated regulation LOC is added by PJM to form a total offer (units self scheduled or not providing in the energy market have a regulation LOC of zero). After a unit clears, the actual five minute interval LMP is used to calculate each unit's regulation LOC, update their total offers, and determine a marginal unit/clearing price in each five minute interval. This within hour calculation of total offers, including LOC, uses each cleared resource's rolling 100 hour average performance score. During settlements, each unit's regulation LOC and total offers are recalculated using each unit's within hour actual performance score. This recalculated LOC and offer using the actual within hour performance score is not used to recalculate the within hour clearing price. This means that the clearing price for the hour will not equal the correct clearing price. Where the resulting market price is lower than an individual resource offer adjusted for the within hour performance score, the resource is paid uplift to make up the difference.

The top 10 units that received the most regulation uplift in 2024 are shown in Table 10-44.

**Table 10-44 Top 10 recipients of regulation uplift credits: 2024**

Rank	Parent Company	Unit Name	Fuel Type	Total Regulation Uplift Credit	Share of Total Regulation Uplift Credits
1	American Electric Power Company Inc	AEP MITCHELL - KAMMER 1 F	COAL	\$3,851,655	14.8%
2	American Electric Power Company Inc	AEP MITCHELL - KAMMER 2 F	COAL	\$3,256,648	12.5%
3	American Electric Power Company Inc	AEP MOUNTAINEER 1 F	COAL	\$3,166,481	12.1%
4	American Electric Power Company Inc	AEP MOUNTAINEER 1 F	COAL	\$2,162,794	8.3%
5	Dominion Energy Inc	VP BATH COUNTY 1-6 H	HYDRO	\$2,037,202	7.8%
6	American Electric Power Company Inc	AEP AMOS 3 F	COAL	\$1,486,414	5.7%
7	American Electric Power Company Inc	AEP MITCHELL - KAMMER 2 F	COAL	\$1,332,184	5.1%
8	Constellation Energy Generation LLC	PE MUDDY RUN 1-8 H	HYDRO	\$1,325,091	5.1%
9	American Electric Power Company Inc	AEP AMOS 2 F	COAL	\$1,201,415	4.6%
10	American Electric Power Company Inc	AEP ROCKPORT 1 F	COAL	\$1,195,550	4.6%
Total of Top 10				\$21,015,433	80.6%
Total Regulation Uplift Credits				\$26,069,673	100.0%

The uplift credits received for each unit type are shown in Table 10-45. The total uplift credits received increased 59.5 percent from \$18,557,563 in 2023 to \$29,602,023 in 2024. This increase, like the increase in total credits, is due in part to higher LOC components of regulation prices and offers as a result of higher energy prices in 2024 compared to 2023. Coal units had the largest decrease in uplift payments, increasing from \$8,036,939 (43.3 percent of total uplift) in 2023, to \$17,417,905 (58.8 percent of total uplift) in 2024.

Table 10-45 PJM regulation by source: 2023 and 2024<sup>119</sup>

Year	Source	Number of Units	Performance Adjusted Settled Regulation (MW)	Percent of Settled Regulation	Clearing Price Credits	Uplift Credits	Total Regulation Credits
2023	Battery	22	1,267,627	28.0%	\$33,672,750	\$0	\$33,672,750
	Coal	17	197,968	4.4%	\$5,351,651	\$8,036,939	\$13,388,591
	Hydro	27	891,916	19.7%	\$21,502,768	\$2,784,372	\$24,287,140
	Natural Gas	142	1,909,917	42.2%	\$43,277,664	\$7,736,252	\$51,013,916
	DR	21	258,291	5.7%	\$7,293,155	\$0	\$7,293,155
Total		229	4,525,718.7	100.0%	\$111,097,989	\$18,557,563	\$129,655,552
2024	Battery	24	1,217,608	26.7%	\$42,673,761	\$322	\$42,674,082
	Coal	19	229,226	5.0%	\$8,740,058	\$17,417,905	\$26,157,963
	Hydro	26	786,909	17.3%	\$29,374,605	\$3,226,498	\$32,601,103
	Natural Gas	145	1,932,641	42.4%	\$58,825,512	\$8,957,298	\$67,782,810
	DR	19	391,154	8.6%	\$13,953,877	\$0	\$13,953,877
Total		233	4,557,537.6	100.0%	\$153,567,812	\$29,602,023	\$183,169,835

### Battery Projects in the Queue

Significant flaws in the regulation market design have led to an over procurement of RegD MW primarily in the form of storage capacity. The incorrect market signals have contributed to more storage projects entering PJM's interconnection queue, despite clear evidence that the market design is flawed and despite operational evidence that the RegD market is saturated (Table 10-46).

Table 10-46 Active battery storage projects by submitted year: 2014 through 2024

Year	Number of Storage Projects	Total Capacity (MW)
2014	1	10.0
2015	1	20.0
2016	0	0.0
2017	0	0.0
2018	6	432.0
2019	34	2,153.5
2020	66	5,459.2
2021	243	17,491.2
2022	137	14,673.5
2023	42	4,977.4
2024	0	0.0
Total	530	45,216.8

The supply of regulation can be affected by regulating units retiring from service. If all units that are requesting retirement through 2024 retire, the supply of regulation in PJM will be reduced by less than one percent.

### Demand

The demand for regulation does not change with price. The regulation requirement is set by PJM to meet NERC control standards, based on reliability objectives, which means that a significant amount of judgment is exercised by PJM in determining the actual demand. Prior to October 1, 2012, the regulation requirement

was 1.0 percent of the forecast peak load for on peak hours and 1.0 percent of the forecast valley load for off peak hours. Between October 1, 2012, and December 31, 2012, PJM changed the regulation requirement several times. It had been scheduled to be reduced from 1.0 percent of peak load forecast to 0.9 percent on October 1, 2012, but instead it was changed from 1.0 percent of peak load forecast to 0.78 percent of peak load forecast. It was

further reduced to 0.74 percent of peak load forecast on November 22, 2012 and reduced again to 0.70 percent of peak load forecast on December 18, 2012. On December 14, 2013, it was reduced to 700 effective MW during peak hours and 525 effective MW during off peak hours. The regulation requirement remained 700 effective MW during peak hours and 525 effective MW during off peak hours until January 9, 2017. A change to the regulation requirement was approved by the RMISTF in 2016, with an implementation date of January 9, 2017. The regulation requirement was increased from 700 effective MW to 800 effective MW during ramp hours (Table 10-36).

Table 10-47 shows the average hourly required regulation by month and the ratio of supply to demand for both actual and effective MW, for ramp and nonramp hours. The average hourly required regulation by month is an average of the ramp and nonramp hours in the month. Changes in the actual MW required to satisfy the regulation requirement are the result of the amount of RegD actual MW cleared. When more RegD MW are cleared, the MBF is lower, resulting in those actual MW being worth less effective MW, requiring more actual MW to satisfy the requirement. When MBFs are higher, the actual MW of RegD are worth more effective MW, reducing the amount of actual MW needed to satisfy the requirement.

The nonramp regulation requirement of 525.0 effective MW was provided by a combination of cleared RegA and RegD resources equal to 477.6 hourly average performance adjusted actual MW in 2024. This is a decrease of 0.8 performance adjusted actual MW from 2023, when the average hourly total regulation cleared

<sup>119</sup> Biomass data have been added to the natural gas category based on confidentiality rules.



performance adjusted actual MW for nonramp hours were 478.3 performance adjusted actual MW. The ramp regulation requirement of 800.0 effective MW was provided by a combination of cleared RegA and RegD resources equal to 696.0 hourly average performance adjusted actual MW in 2024. This is a decrease of 10.3 performance adjusted actual MW from 2023, where the average hourly regulation cleared MW for ramp hours were 706.3 performance adjusted actual MW.<sup>120</sup>

**Table 10-47 Required regulation and ratio of supply to requirement 2023 through 2024**

Hours	Month	Average Required Regulation (MW)		Average Required Regulation (Effective MW)		Ratio of Supply MW to MW Requirement		Ratio of Supply Effective MW to Effective MW Requirement	
		2023	2024	2023	2024	2023	2024	2023	2024
Ramp	Jan	696.1	705.7	800.1	800.1	1.45	1.39	1.30	1.29
	Feb	715.5	691.8	800.0	800.0	1.48	1.36	1.34	1.27
	Mar	719.9	688.5	800.0	800.0	1.48	1.36	1.35	1.27
	Apr	704.6	691.9	800.0	800.0	1.39	1.37	1.29	1.26
	May	712.6	693.1	800.0	800.0	1.43	1.41	1.33	1.30
	Jun	712.7	703.9	800.0	799.8	1.40	1.42	1.30	1.31
	Jul	713.0	701.6	800.0	799.7	1.38	1.45	1.29	1.33
	Aug	708.0	703.2	799.9	800.0	1.43	1.48	1.31	1.35
	Sep	704.9	697.6	800.0	800.0	1.39	1.54	1.28	1.39
	Oct	701.3	693.1	800.0	800.1	1.43	1.54	1.31	1.39
	Nov	695.0	691.1	799.9	800.0	1.41	1.54	1.30	1.39
	Dec	692.4	690.7	800.0	800.0	1.41	1.50	1.30	1.37
Nonramp	Jan	466.3	477.4	525.3	525.1	1.44	1.43	1.32	1.33
	Feb	494.3	473.0	558.1	525.1	1.50	1.41	1.36	1.31
	Mar	463.6	484.8	525.0	525.1	1.43	1.54	1.31	1.42
	Apr	464.4	489.1	524.7	536.8	1.44	1.41	1.33	1.32
	May	475.6	481.8	524.8	525.0	1.50	1.49	1.38	1.37
	Jun	484.6	474.1	525.1	525.4	1.40	1.40	1.31	1.30
	Jul	482.1	479.0	524.7	527.3	1.40	1.44	1.30	1.34
	Aug	475.5	473.9	525.3	525.1	1.51	1.40	1.38	1.30
	Sep	485.0	473.7	525.7	525.5	1.43	1.47	1.33	1.35
	Oct	486.0	461.7	525.0	525.2	1.51	1.69	1.38	1.51
	Nov	482.4	479.6	525.3	525.0	1.41	1.71	1.32	1.55
	Dec	480.0	482.4	525.6	525.0	1.45	1.62	1.34	1.48

## Market Concentration

In 2024, the effective MW weighted average HHI of RegA resources was 2517 which is highly concentrated and the effective MW weighted average HHI of RegD resources was 1594 which is moderately concentrated.

Table 10-48 includes a monthly summary of three pivotal supplier (TPS) results. In 2024, the three pivotal supplier test was failed in 94.7 percent of hours. The MMU concludes that the PJM Regulation Market in 2024 was characterized by structural market power. The results presented here are calculated by PJM. The MMU has been unable to verify these results, as some of the underlying data necessary to replicate these calculations are not saved. PJM has submitted a request to the vendor to save all data necessary for verification.

<sup>120</sup> The supply of performance adjusted MW is less than the demand because the regulation requirement is based on effective MW. Effective MW are performance adjusted MW multiplied by the MBF.

**Table 10-48 Regulation market monthly three pivotal supplier results: 2023 through 2024**

Month	Percent of Hours Pivotal	
	2023	2024
Jan	92.1%	96.2%
Feb	91.6%	98.1%
Mar	96.0%	94.4%
Apr	91.8%	98.8%
May	89.1%	93.3%
Jun	95.0%	96.2%
Jul	96.8%	97.3%
Aug	94.5%	94.6%
Sep	95.3%	90.0%
Oct	95.7%	91.9%
Nov	95.8%	92.5%
Dec	92.5%	93.5%
Average	93.8%	94.7%

## Market Conduct

### Offers

Resources seeking to regulate must qualify to follow a regulation signal by passing a test for that signal with at least a 75 percent performance score. The regulating resource must be able to supply at least 0.1 MW of regulation and not allow the sum of its regulating ramp rate and energy ramp rate to exceed its overall ramp rate.<sup>121</sup> When offering into the regulation market, regulating resources must submit a cost-based offer and may submit a price-based offer (capped at \$100 per MW) by 1415 the day before the operating day. Regulation resources are also permitted to change and/or submit intraday offers.<sup>122</sup>

Offers in the PJM Regulation Market consist of a capability component for the MW of regulation capability provided and a performance component for the miles ( $\Delta$ MW of regulation movement) provided. The capability component for cost-based offers is not to exceed the increased fuel costs resulting from operating the regulating unit at a lower output level than its economically optimal output level, plus a \$12.00 per MW margin. The \$12.00 margin embeds market power in the regulation offers, is not part of the cost of regulation, and should be eliminated. The performance component for cost-based offers is not to exceed the increased costs (increased short run marginal costs including increased fuel costs) resulting from moving the unit up and down to provide regulation. Batteries and flywheels have zero cost for lower efficiency from providing regulation

instead of energy, as they are not net energy producers. There is an energy storage loss component for batteries and flywheels as a cost component of regulation performance offers to reflect the net energy consumed to provide regulation service.<sup>123</sup>

Up until 65 minutes before the operating hour, the regulating resource must provide: status (available, unavailable, or self scheduled); capability (movement up and down in MW); regulation maximum and regulation minimum (the highest and lowest levels of energy output while regulating in MW); and the regulation signal type (RegA or RegD). Resources may offer regulation for both the RegA and RegD signals, but will be assigned to follow only one signal for a given operating hour. Resources have the option to submit a minimum level of regulation they are willing to provide.<sup>124</sup>

All LSEs are required to provide regulation in proportion to their load share. LSEs can purchase regulation in the regulation market, purchase regulation from other providers bilaterally, or self schedule regulation to satisfy their obligation (Table 10-51).<sup>125</sup> Figure 10-40 compares average hourly regulation and self scheduled regulation during ramp and nonramp hours on an effective MW basis. Self scheduled regulation averaged 51.2 percent of all effective MW during ramp hours (50.1 percent in 2023) and 65.8 percent of all effective MW during nonramp hours (65.0 percent in 2023) in 2024. Over all hours in 2024, self scheduled regulation averaged 57.0 percent of all effective MW (56.0 percent in 2023) (See Table 10-49). The average hourly regulation is the amount of regulation that actually cleared and is not the same as the regulation requirement because PJM clears the market within a two percent band around the requirement.<sup>126</sup>

<sup>121</sup> See "PJM Manual 11: Energy & Ancillary Services Market Operations," § 3.2.1 Regulation Market Eligibility, Rev. 132 (Sept. 1, 2024).

<sup>122</sup> Id. at 3.2.2, at p. 62.

<sup>123</sup> See "PJM Manual 15: Cost Development Guidelines," § 7.8 Regulation Cost, Rev. 45 (Sept. 1, 2024).

<sup>124</sup> See "PJM Manual 11: Energy & Ancillary Services Market Operations," § 3.2.1 Regulation Market Eligibility, Rev. 133 (Dec. 17, 2024).

<sup>125</sup> See "PJM Manual 28: Operating Agreement Accounting," § 4.1 Regulation Accounting Overview, Rev. 98 (Dec. 17, 2024).

<sup>126</sup> See "PJM Manual 11: Energy & Ancillary Services Market Operations," § 3.2.1 Regulation Market Eligibility, Rev. 133 (Dec. 17, 2024).

Figure 10-40 Nonramp and ramp regulation levels: January 2023 through December 2024

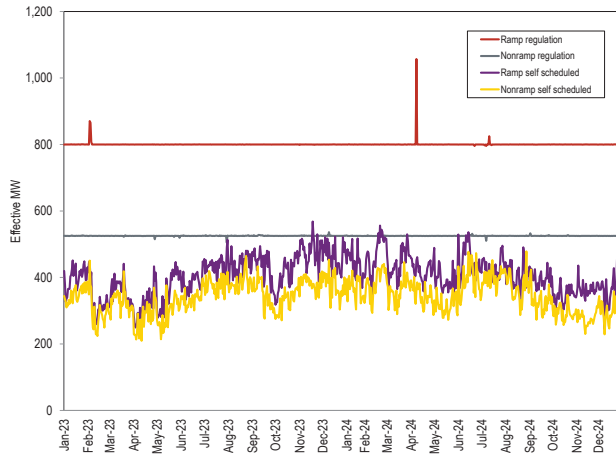


Table 10-49 Total Effective MW and Self Scheduled Effective MW during ramp and non ramp hours: 2023 and 2024

Year		Effective MW	Self Scheduled Effective MW	Percent Effective MW
2023	Ramp	292,144.6	146,429.6	50.1%
	Non Ramp	191,672.2	124,546.7	65.0%
Total		483,816.8	270,976.4	56.0%
2024	Ramp	285,067.7	146,048.3	51.2%
	Non Ramp	186,938.2	122,981.6	65.8%
Total		472,005.9	269,029.9	57.0%

Table 10-50 shows the role of RegD resources in the regulation market. RegD resources are both a growing proportion of the market (10.9 percent of the total effective MW at the start of the performance based regulation market design in October 2012 and 51.2 percent of the total effective MW in December 2024) and a growing proportion of resources that self schedule (25.0 percent of all self scheduled effective MW in October 2012 and 68.0 percent of all self scheduled effective MW in December 2024). In 2024, the average RegD percentage of total self scheduled effective MW was 65.8 percent, an increase of 6.3 percentage points from 2023, when the average was 59.5 percent.

Table 10-50 RegD self scheduled regulation by month: January 2023 through December 2024

Year	Month	RegD Self Scheduled Effective MW	RegD Effective MW	Total Self Scheduled Effective MW	Total Effective MW	RegD Percent of Total Self Scheduled Effective MW	RegD Percent of Total Effective MW
2023	Jan	217.4	312.5	376.5	674.2	57.7%	46.3%
2023	Feb	178.5	293.4	313.7	685.0	56.9%	42.8%
2023	Mar	180.7	284.8	341.1	641.2	53.0%	44.4%
2023	Apr	188.0	295.4	293.5	639.6	64.0%	46.2%
2023	May	203.1	303.3	322.3	646.8	63.0%	46.9%
2023	Jun	233.1	339.6	368.2	698.4	63.3%	48.6%
2023	Jul	242.0	344.6	416.2	710.1	58.1%	48.5%
2023	Aug	238.1	342.9	418.8	704.9	56.9%	48.6%
2023	Sep	239.1	332.4	389.6	657.5	61.4%	50.6%
2023	Oct	237.5	328.3	364.9	639.6	65.1%	51.3%
2023	Nov	241.7	327.7	423.7	640.5	57.0%	51.2%
2023	Dec	244.8	341.2	424.2	674.2	57.7%	50.6%
Average		220.3	320.5	371.1	667.7	59.5%	48.0%
2024	Jan	247.3	348.5	404.2	708.4	61.2%	49.2%
2024	Feb	247.2	333.6	431.4	674.0	57.3%	49.5%
2024	Mar	251.6	332.6	395.0	639.8	63.7%	52.0%
2024	Apr	246.3	328.7	378.4	646.1	65.1%	50.9%
2024	May	244.2	326.1	347.9	639.6	70.2%	51.0%
2024	Jun	269.3	343.2	432.9	716.4	62.2%	47.9%
2024	Jul	257.8	350.8	415.0	711.5	62.1%	49.3%
2024	Aug	244.2	341.8	391.7	706.5	62.3%	48.4%
2024	Sep	227.2	318.7	359.3	639.7	63.2%	49.8%
2024	Oct	239.5	313.9	315.8	639.7	75.8%	49.1%
2024	Nov	247.9	332.3	315.4	651.0	78.6%	51.0%
2024	Dec	230.7	344.9	339.5	673.9	68.0%	51.2%
Average		246.1	334.6	377.2	619.0	65.8%	49.9%

LSE's can satisfy their obligation to provide regulation by purchasing in the spot market, self scheduling, or through bilateral agreements. Increased self scheduled regulation lowers the requirement for cleared regulation, resulting in fewer MW cleared in the market and lower clearing prices. For total spot market regulation and self scheduled regulation, Table 10-51 shows monthly data for January 2023 through December 2024, and Table 10-52 shows annual data for 2012 through 2024. Table 10-51 and Table 10-52 are based on settled (purchased) MW.

Table 10-51 Regulation sources: spot market and self scheduled purchases: January 2023 through December 2024

Year	Month	Spot Market Regulation (Unadjusted MW)	Self Scheduled Regulation (Unadjusted MW)
2023	Jan	126,117.0	197,873.7
	Feb	183,580.7	144,902.8
	Mar	154,809.4	181,862.7
	Apr	194,988.7	142,019.7
	May	178,797.9	162,369.6
	Jun	166,079.8	177,662.2
	Jul	143,524.9	210,702.6
	Aug	137,645.3	212,801.4
	Sep	136,353.0	195,056.8
	Oct	152,769.2	191,675.7
	Nov	103,207.6	219,949.2
	Dec	114,297.3	225,054.8
Total		1,792,170.7	2,261,931.1
2024	Jan	154,709.3	206,512.1
	Feb	102,320.8	210,400.6
	Mar	119,518.6	205,632.7
	Apr	129,745.9	187,429.4
	May	162,153.9	166,226.4
	Jun	140,119.8	204,187.0
	Jul	141,454.2	211,045.4
	Aug	154,173.9	193,923.2
	Sep	128,113.1	174,698.6
	Oct	178,601.8	145,997.5
	Nov	189,442.1	143,507.1
	Dec	171,235.2	172,522.1
Total		1,771,588.7	2,222,082.2

**Table 10-52 Regulation sources: spot market and self scheduled: 2012 through 2024**

Year	Spot Market Regulation (Unadjusted MW)	Self Scheduled Regulation (Unadjusted MW)
2012	6,149,110.0	1,484,446.2
2013	3,088,963.1	2,064,156.7
2014	2,327,322.4	2,161,996.5
2015	2,546,688.3	1,888,040.0
2016	2,260,701.6	2,104,775.1
2017	2,504,264.1	1,783,045.7
2018	2,755,355.7	1,558,388.9
2019	2,367,346.1	1,867,285.3
2020	2,156,968.5	2,215,555.1
2021	2,382,245.5	2,022,719.3
2022	2,426,586.3	1,705,256.9
2023	1,792,170.7	2,261,931.1
2024	1,771,588.7	2,222,082.2

In 2024, DR provided an average of 54.3 MW of regulation per hour during ramp hours (38.8 MW of regulation per hour during ramp hours in 2023), and an average of 42.5 MW of regulation per hour during nonramp hours (27.0 MW of regulation per hour during nonramp hours in 2023). Generating units supplied an average of 642.7 MW of regulation per hour during ramp hours in 2024 (667.7 MW of regulation per hour during ramp hours in 2023), and an average of 435.3 MW per hour during nonramp hours in 2024 (450.7 MW of regulation per hour during nonramp hours in 2023).

## Market Performance

### Price

Table 10-53 shows the regulation price and regulation cost per MW for 2009 through 2024. The weighted average RMCP for 2024 was \$31.86 per MW. This is an increase of \$9.17 per MW, or 40.4 percent, from the weighted average RMCP of \$22.69 per MW in 2023. This increase in the regulation clearing price was the result of an increase in energy prices in 2024 and the related increase in the opportunity cost component of RMCP.

**Table 10-53 Comparison of average price and cost for regulation: 2009 through 2024**

Year	Weighted Regulation Market Price	Weighted Regulation Market Cost	Regulation Price as Percent of Cost
2009	\$23.00	\$30.68	75.0%
2010	\$18.00	\$32.86	54.8%
2011	\$16.49	\$29.72	55.5%
2012	\$19.02	\$25.32	75.1%
2013	\$30.85	\$35.79	86.2%
2014	\$44.49	\$53.82	82.7%
2015	\$31.92	\$38.36	83.2%
2016	\$15.73	\$18.13	86.7%
2017	\$16.79	\$23.03	72.9%
2018	\$25.32	\$31.94	79.3%
2019	\$16.27	\$20.32	80.1%
2020	\$13.55	\$16.73	81.0%
2021	\$26.00	\$31.49	82.6%
2022	\$53.53	\$65.10	82.2%
2023	\$22.69	\$29.32	77.4%
2024	\$31.86	\$40.08	79.5%

The introduction of fast start pricing in the PJM energy market on September 1, 2021, had an effect on the regulation market LOC included in regulation offers and in the resulting clearing price for regulation. Table 10-54 shows the effect of fast start pricing on the regulation market monthly capability component of price and the total regulation market clearing price from September 2021 through December 2024. In 2024, fast start pricing increased the average regulation market clearing price by \$2.47 (an increase of 8.4 percent), from \$29.39 to \$31.86, compared to dispatch pricing. This resulted in an additional \$11.3 million in regulation credits.



**Table 10-54 Comparison of fast start and dispatch pricing: September 2021 through December 2024<sup>127</sup>**

		Weighted Average Price (\$/Perf. Adj. Actual MW)				
		Capability Clearing Price		Regulation Market Clearing Price		
Year	Month	Dispatch	Fast Start	Dispatch	Fast Start	Percent Fast Start Increase
2021	Sep	\$27.22	\$29.08	\$28.55	\$30.41	6.5%
	Oct	\$35.64	\$39.92	\$37.12	\$41.40	11.5%
	Nov	\$50.56	\$54.40	\$52.43	\$56.28	7.3%
	Dec	\$25.62	\$27.37	\$27.05	\$28.79	6.4%
2022	Jan	\$68.25	\$71.14	\$69.68	\$72.56	4.1%
	Feb	\$31.14	\$31.93	\$32.76	\$33.55	2.4%
	Mar	\$23.91	\$25.94	\$25.70	\$27.73	7.9%
	Apr	\$45.07	\$48.85	\$47.49	\$51.27	7.9%
	May	\$38.09	\$41.85	\$39.84	\$43.60	9.4%
	Jun	\$47.26	\$52.57	\$49.17	\$54.48	10.8%
	Jul	\$47.40	\$54.51	\$48.92	\$56.04	14.5%
	Aug	\$57.43	\$64.13	\$59.17	\$65.87	11.3%
	Sep	\$46.17	\$48.84	\$48.07	\$50.73	5.5%
	Oct	\$33.38	\$36.76	\$35.33	\$38.70	9.6%
	Nov	\$21.29	\$23.08	\$22.42	\$24.21	8.0%
	Dec	\$115.65	\$112.52	\$116.94	\$113.81	(2.7%)
Total		\$48.66	\$51.82	\$50.37	\$53.53	6.3%
2023	Jan	\$16.61	\$17.25	\$17.58	\$18.22	3.7%
	Feb	\$15.12	\$15.48	\$16.29	\$16.65	2.2%
	Mar	\$17.11	\$17.80	\$17.89	\$18.57	3.8%
	Apr	\$21.51	\$23.20	\$22.60	\$24.29	7.5%
	May	\$22.75	\$24.58	\$24.31	\$26.14	7.5%
	Jun	\$19.77	\$20.88	\$21.27	\$22.38	5.2%
	Jul	\$21.45	\$23.43	\$22.56	\$24.54	8.8%
	Aug	\$20.10	\$21.32	\$21.17	\$22.39	5.8%
	Sep	\$22.34	\$23.92	\$23.49	\$25.08	6.7%
	Oct	\$28.11	\$32.37	\$29.25	\$33.51	14.6%
	Nov	\$18.48	\$20.83	\$18.95	\$21.30	12.4%
	Dec	\$16.78	\$18.12	\$17.81	\$19.15	7.5%
Total		\$20.01	\$21.60	\$21.10	\$22.69	7.5%
2024	Jan	\$35.33	\$36.70	\$36.91	\$38.28	3.7%
	Feb	\$17.72	\$19.44	\$18.70	\$20.42	9.2%
	Mar	\$20.05	\$22.88	\$21.21	\$24.04	13.3%
	Apr	\$20.36	\$24.52	\$20.75	\$24.90	20.0%
	May	\$32.60	\$37.59	\$33.66	\$38.64	14.8%
	Jun	\$27.57	\$28.96	\$28.29	\$29.68	4.9%
	Jul	\$37.03	\$39.87	\$38.51	\$41.35	7.4%
	Aug	\$29.85	\$31.48	\$30.56	\$32.18	5.3%
	Sep	\$25.66	\$28.31	\$27.36	\$30.01	9.7%
	Oct	\$33.33	\$35.59	\$34.27	\$36.53	6.6%
	Nov	\$25.68	\$28.52	\$26.60	\$29.45	10.7%
	Dec	\$31.90	\$33.14	\$33.45	\$34.69	3.7%
Total		\$28.29	\$30.76	\$29.39	\$31.86	8.4%

Figure 10-41 shows the capability price, performance price, and the opportunity cost component for the PJM Regulation Market on a performance adjusted MW basis. The regulation clearing price is determined based on the marginal unit's total offer (RCP + RPP + PJM calculated LOC). Then the maximum performance offer price (RPP) of any of the cleared units is used to set the marginal performance clearing price for the purposes of settlements. The difference between the marginal total

<sup>127</sup> The performance component of the regulation market clearing price is unaffected by fast start pricing.

clearing price and the highest performance clearing price (RMPCP) is the marginal capability clearing price (RMCCP). The capability price presented here is equal to the clearing price, minus the maximum cleared performance offer price. This data is based on actual five minute interval operational data.

Figure 10-41 illustrates the components of the regulation market clearing price. Each section represents the contribution of the lost opportunity cost (green area), capability price (blue area), and performance price (orange area), to the total price. From this figure, it is clear that the lost opportunity cost is the predominant component of the total clearing price. In 2024, LOC accounted for 78.2 percent of the daily weighted average capability price, and 81.0 percent of the daily weighted average total clearing price.

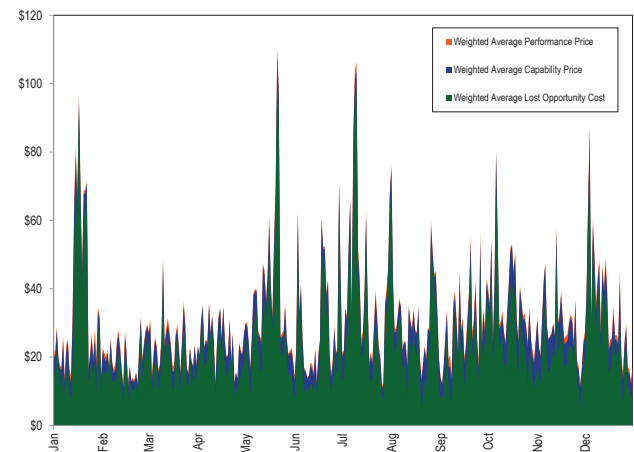
**Figure 10-41 Regulation market clearing price components (Dollars per MW): January through December, 2024**

Table 10-55 shows the capability and performance components of the monthly average regulation prices. These components differ from the components of the marginal unit's offers in Figure 10-41 because the performance component of the settlement price for each hour is determined from the average of the highest performance offers in each five minute interval, calculated independent of the marginal unit's offers in those intervals.

**Table 10-55 Regulation market monthly component of price (Dollars per MW): January through December, 2024**

Month	Weighted Average Regulation Market Capability Clearing Price (\$/Perf. Adj. Actual MW)	Weighted Average Regulation Market Performance Clearing Price (\$/Perf. Adj. Actual MW)	Weighted Average Regulation Market Clearing Price (\$/Perf. Adj. Actual MW)
Jan	\$36.70	\$1.58	\$38.28
Feb	\$19.44	\$0.98	\$20.42
Mar	\$22.88	\$1.16	\$24.04
Apr	\$24.52	\$0.38	\$24.90
May	\$37.59	\$1.05	\$38.64
Jun	\$28.96	\$0.73	\$29.68
Jul	\$39.87	\$1.48	\$41.35
Aug	\$31.48	\$0.70	\$32.18
Sep	\$28.31	\$1.70	\$30.01
Oct	\$35.59	\$0.94	\$36.53
Nov	\$28.52	\$0.93	\$29.45
Dec	\$33.14	\$1.55	\$34.69
Average	\$30.76	\$1.10	\$31.86

Monthly and total annual scheduled regulation MW and regulation charges, as well as monthly average regulation price and regulation cost are shown in Table 10-56. Total scheduled regulation is based on settled performance adjusted MW. The total of all regulation charges in 2024 was \$183,211,752, compared to \$133,996,478 in 2023.

**Table 10-56 Total regulation charges: January 2023 through December 2024**

Year	Month	Scheduled Regulation (MW)	Total Regulation Charges (\$)	Weighted Average Regulation Market Price (\$/MW)	Cost of Regulation (\$/MW)	Price as Percent of Cost
2023	Jan	393,338.7	\$9,819,046	\$18.22	\$24.96	73.0%
	Feb	362,742.5	\$8,129,962	\$16.65	\$22.41	74.3%
	Mar	378,020.0	\$9,522,499	\$18.57	\$25.19	73.7%
	Apr	367,767.4	\$11,314,002	\$24.29	\$30.76	79.0%
	May	374,017.5	\$12,558,409	\$26.14	\$33.58	77.8%
	Jun	387,059.0	\$11,599,709	\$22.38	\$29.97	74.7%
	Jul	402,672.4	\$12,687,645	\$24.54	\$31.51	77.9%
	Aug	398,401.7	\$11,924,512	\$22.39	\$29.93	74.8%
	Sep	371,319.8	\$11,923,165	\$25.08	\$32.11	78.1%
	Oct	379,772.9	\$15,165,910	\$33.51	\$39.93	83.9%
	Nov	364,104.7	\$9,288,549	\$21.30	\$25.51	83.5%
	Dec	391,045.4	\$9,760,581	\$19.15	\$24.96	76.7%
Total		4,570,260.9	\$133,996,478	\$22.69	\$29.32	77.4%
2024	Jan	408,753.4	\$20,438,488	\$38.28	\$50.00	76.6%
	Feb	359,472.4	\$9,511,886	\$20.42	\$26.46	77.2%
	Mar	373,821.3	\$11,459,995	\$24.04	\$30.66	78.4%
	Apr	365,623.4	\$11,540,004	\$24.90	\$31.56	78.9%
	May	370,688.3	\$17,378,965	\$38.64	\$46.88	82.4%
	Jun	394,543.8	\$14,952,926	\$29.68	\$37.90	78.3%
	Jul	409,957.7	\$21,711,218	\$41.35	\$52.96	78.1%
	Aug	404,773.1	\$16,107,937	\$32.18	\$39.79	80.9%
	Sep	354,056.7	\$13,015,973	\$30.01	\$36.76	81.6%
	Oct	367,726.3	\$16,434,456	\$36.53	\$44.69	81.7%
	Nov	368,499.2	\$13,925,495	\$29.45	\$37.79	77.9%
	Dec	392,668.3	\$16,734,410	\$34.69	\$42.62	81.4%
Total		4,570,583.9	\$183,211,752	\$31.86	\$40.08	79.5%

The capability, performance, and opportunity cost components of the cost of regulation are shown in Table 10-57. Total scheduled regulation is based on settled performance adjusted MW. In 2024, the average total cost of regulation was \$40.08 per MW, 36.7 percent higher than \$29.32 in 2023. In 2024, the monthly average capability component cost of regulation was \$30.78, 42.5 percent higher than \$21.60 in 2023. In 2024, the monthly average performance component cost of regulation was \$2.82, 4.2 percent higher than \$2.71 in 2023. The increase of the average total cost in 2024 versus 2023, was primarily a result of higher LOC values due to higher prices in the energy market.


Table 10-57 Components of regulation cost: January 2023 through December 2024

Year	Month	Cost of Regulation				Total Cost (\$/MW)
		Scheduled Regulation (MW)	Cost of Regulation Capability (\$/MW)	Performance (\$/MW)	Opportunity Cost (\$/MW)	
2023	Jan	393,338.7	\$17.27	\$2.44	\$5.25	\$24.96
	Feb	362,742.5	\$15.48	\$2.89	\$4.04	\$22.41
	Mar	378,020.0	\$17.77	\$1.90	\$5.52	\$25.19
	Apr	367,767.4	\$23.18	\$2.60	\$4.98	\$30.76
	May	374,017.5	\$24.58	\$3.77	\$5.22	\$33.58
	Jun	387,059.0	\$20.88	\$3.80	\$5.29	\$29.97
	Jul	402,672.4	\$23.45	\$2.62	\$5.43	\$31.51
	Aug	398,401.7	\$21.34	\$2.61	\$5.99	\$29.93
	Sep	371,319.8	\$23.92	\$2.97	\$5.22	\$32.11
	Oct	379,772.9	\$32.40	\$2.94	\$4.59	\$39.93
	Nov	364,104.7	\$20.83	\$1.21	\$3.47	\$25.51
	Dec	391,045.4	\$18.13	\$2.68	\$4.14	\$24.96
Total		4,570,260.9	\$21.60	\$2.71	\$5.01	\$29.32
2024	Jan	408,753.4	\$36.74	\$3.97	\$9.29	\$50.00
	Feb	359,472.4	\$19.47	\$2.40	\$4.59	\$26.46
	Mar	373,821.3	\$22.90	\$2.93	\$4.84	\$30.66
	Apr	365,623.4	\$24.56	\$0.97	\$6.03	\$31.56
	May	370,688.3	\$37.61	\$2.58	\$6.70	\$46.88
	Jun	394,543.8	\$28.96	\$1.72	\$7.21	\$37.90
	Jul	409,957.7	\$39.90	\$3.90	\$9.16	\$52.96
	Aug	404,773.1	\$31.53	\$1.76	\$6.51	\$39.79
	Sep	354,056.7	\$28.31	\$4.58	\$3.87	\$36.76
	Oct	367,726.3	\$35.58	\$2.48	\$6.64	\$44.69
	Nov	368,499.2	\$28.53	\$2.47	\$6.79	\$37.79
	Dec	392,668.3	\$33.14	\$4.00	\$5.48	\$42.62
Total		4,570,583.9	\$30.78	\$2.82	\$6.49	\$40.08

## Performance Standards

PJM's performance as measured by CPS1 and BAAL standards is shown in Figure 10-42 for every month from January 2011 through December 2024 with the dashed vertical line marking the date (October 1, 2012) of the implementation of the Performance Based Regulation Market design.<sup>128</sup> The horizontal dashed lines represent PJM internal goals for CPS1 and BAAL performance.

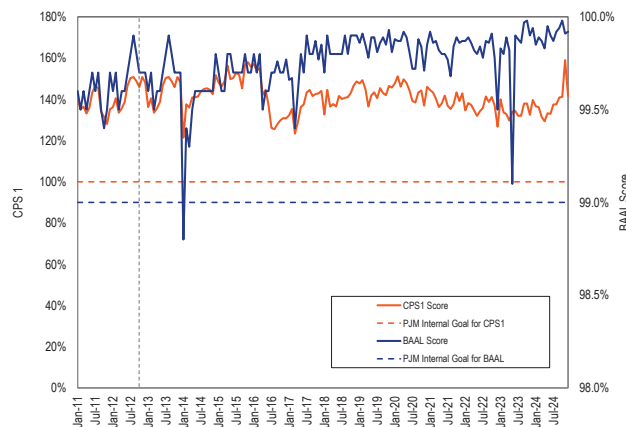Figure 10-42 Monthly CPS1 and BAAL performance: January 2011 through December 2024



<sup>128</sup> See 2019 Annual State of the Market Report for PJM, Appendix F: Ancillary Services.

## Black Start Service

Black start service is required for the reliable restoration of the grid following a blackout. Black start service is the ability of a generating unit to start without an outside electrical supply, or the demonstrated ability of a generating unit to automatically remain operating at reduced levels when disconnected from the grid (automatic load rejection or ALR).<sup>129</sup> Although the issue is being addressed in the stakeholder process, there are currently no firm fuel requirements for black start units.

PJM does not have a market to provide black start service, but compensates black start resource owners on the basis of cost of service rates defined in the tariff.<sup>130</sup> Currently, there are a small number of units in unique circumstances with bilateral agreements with their transmission operator (TO) to provide black start service that were entered into prior to joining PJM. These units are compensated directly by the TO.

PJM defines required black start capability zonally, while recognizing that the most effective way to provide black start service is a regional approach that recognizes cost effective ways to provide black start across transmission zonal boundaries.<sup>131</sup> Under the current rules PJM has substantial flexibility in procuring black start resources and is responsible for black start resource selection.<sup>132</sup> But PJM's stated principles for system restoration are not fully incorporated into the rules in Schedule 6A. Costs should also be allocated on a regional basis to reflect the regional benefits of black start service.

The MMU recommends that black start planning and coordination be on a regional basis and not on a zonal basis. Similarly, the region as a whole benefits from black start service, regardless of the transmission zone in which it is located, and the costs of black start service should be shared equally across the region.

By order issued October 6, 2023, the FERC approved revisions to Schedule 6A concerning fuel assurance for black start units, effective July 12, 2023.<sup>133</sup> The revisions were approved over the protest of the MMU, which

identified significant flaws.<sup>134</sup> The planning criteria for fuel assured units and charges are applied on a zonal basis and not a regional basis, even though PJM is a regional transmission operator. The revisions to the tariff ignore the attributes of existing fuel assured units if they do not offer into the fuel assurance RFP. Intermittent resources are treated as if they are fuel assured. The X factor for fuel assured hydro units is arbitrarily doubled from 0.01 to 0.02. The incentive factor for fuel assured units is arbitrarily doubled from 10 percent to 20 percent. For black start units in service prior to June 6, 2021, the rules apply CRF rates that ignore significant reductions in federal tax rates, including depreciation provisions, resulting in significant overpayments by PJM customers. The rules do not address environmental permits, which may limit the ability of units to provide black start service. The rules do not define DER's provision of black start service. The rules do not require testing units without notice to operators. The rules do not address the availability of natural gas and stored water levels. Reporting requirements for onsite fuel are not adequate. The reliability backstop improperly depends on TOs to secure black start service if PJM has two failed auctions.

In the November 8, 2024, MIC meeting PJM proposed to change the definition of Net CONE used in the Black Start Base Formula Rate (BFR) calculation.<sup>135</sup> The rationale was that Net CONE values based on a combined cycle reference resource could be negative at times. PJM did not retract its proposal even after PJM decided to not use a combined cycle as the reference resource. The MMU presented historical information on payments under the BFR rate and argued that no change is needed to the Net CONE calculation.<sup>136</sup> If the BFR rate is to be reevaluated, it should be based on the cost of providing the black start service, including an incentive, rather than the unsupported use of Net CONE.

On April 7, 2021, PJM issued an incremental RFP for black start service in the BGE and PEPCO Zones. On November 1, 2021, PJM made awards for the April 7, 2021, incremental RFP. The planned in service date was June 2024. On August 1, 2022, PJM issued an

<sup>129</sup> OATT Schedule 1 § 1.3BB.

<sup>130</sup> See OATT Schedule 6A para. 18.

<sup>131</sup> See Motion for Leave to Answer and Answer of PJM Interconnection, LLC to Comments, FERC Docket No. ER13-1911-000 (August 19, 2013) at 5 ("To be sure, restoration plans utilizing interconnecting Transmission Owners is not new and is currently included in all restoration plans today. Geographic or political boundaries play no role in the evaluation of the most reliable and efficient restoration strategies").

<sup>132</sup> See Docket No. ER13-1911-000.

<sup>133</sup> See 85 FERC ¶ 91,000.

<sup>134</sup> See Comments of the Independent Market Monitor for PJM, FERC Docket No. ER23-1874-000 (June 6, 2023) and Answer and Motion for Leave to Answer of the Independent Market Monitor for PJM, FERC Docket No. ER23-1874-000 (July 6, 2023).

<sup>135</sup> See MIC, Problem Statement and Issues Charge, "Black Start Base Formula Rate," <<https://www.pjm.com/-/media/DotCom/committees-groups/committees/mic/2024/20241108/20241108-item-03-1---black-start-base-formula-rate---problem-statement.pdf>> and <<https://www.pjm.com/-/media/DotCom/committees-groups/committees/mic/2024/20241108/20241108-item-03-2---black-start-base-formula-rate---issue-charge.pdf>> (Nov. 8, 2024).

<sup>136</sup> See MIC, IMM Education, Black Start Costs and Net CONE <<https://www.pjm.com/-/media/DotCom/committees-groups/committees/mic/2025/20250205/20250205-item-03-2---black-start-base-formula-rate---imm-solution.pdf>> (February 5, 2025).

incremental RFP for black start service in the PECO Zone.<sup>137</sup> On March 26, 2024, PJM made an award for the August 1, 2022 RFP. The planned in service date is December 31, 2026.

On June 20, 2023, PJM issued a RTO wide request for proposals (RFP) in accordance with the five year black start selection process. The RFP is for black start service and fuel assured black start service. In service dates are estimated to be June 1, 2024 through April 2027.

On April 29, 2024, PJM issued an incremental RFP for fuel assured black start service, because the 2023 RTO wide black start service RFP did not attract offers for fuel assured black start units in all zones. The result illustrated the inefficiency and excess cost to customers of ignoring the attributes of existing fuel assured units if they do not offer into the fuel assurance RFP. As a result, PJM will procure more black start resources than PJM's target level. Level 1 proposals were due June 18, 2024, and Level 2 proposals were due August 20, 2024. These proposals will be non binding. Evaluations and awards are projected to be between August 20, 2024, and May 31, 2024. In service dates are projected to be January 1, 2027, for units that will require updates to meet fuel assurance requirements.

Total black start charges are the sum of black start revenue requirement charges and black start uplift (operating reserve) charges.

Black start revenue requirements for black start units consist of fixed black start service costs, variable black start service costs, training costs, fuel storage costs, and an incentive factor applicable when CRF rates are not used. The tariff specifies how to calculate each component of the revenue requirement formula.<sup>138</sup>

Fixed black start service costs are calculated using one of three methods chosen by the black start provider from the options defined in the OATT Schedule 6A: base formula rate; capital cost recovery rate; or incremental black start NERC-CIP cost recovery. The base formula rate is Net CONE multiplied by the black start unit's capacity multiplied by the X factor. The X factor is 0.01 for hydro units and 0.02 for CT units. The capital recovery rate is the capital investment multiplied by the CRF rate. The incremental NERC-CIP cost, for existing

black start resources that need to add additional capital to meet NERC-CIP requirements, is calculated using the capital cost recovery rate. Black start uplift charges are paid to units committed in real time to provide black start service or for black start testing.<sup>139</sup> Total black start charges are allocated monthly to PJM customers based on their zone and nonzone peak transmission use and point to point transmission reservations.<sup>140</sup>

No black start units have requested new or additional black start NERC – CIP Capital Costs.<sup>141</sup>

In 2024, total black start charges were \$73.8 million, an increase of \$6.6 million (9.8 percent) from 2023. In 2024, total revenue requirement charges were \$73.5 million, an increase of \$6.6 million (9.8 percent) from 2023. In the 2024, total uplift charges were \$0.3 million, an increase of \$0.003 million (0.1 percent) from 2023. Table 10-58 shows total charges for January through December of each year from 2010 through 2024.<sup>142</sup>

**Table 10-58 Black start revenue requirement charges: 2010 through 2024**

Year	Revenue Requirement		Total
	Charges	Uplift Charges	
2010	\$11,490,379	\$0	\$11,490,379
2011	\$13,695,331	\$0	\$13,695,331
2012	\$18,749,617	\$8,384,651	\$27,134,269
2013	\$20,874,535	\$86,701,561	\$107,576,097
2014	\$26,945,112	\$32,906,733	\$59,851,845
2015	\$56,425,648	\$5,175,644	\$61,601,292
2016	\$69,376,257	\$279,017	\$69,655,275
2017	\$69,258,169	\$257,174	\$69,515,342
2018	\$64,439,926	\$294,753	\$64,734,679
2019	\$64,327,918	\$226,014	\$64,553,932
2020	\$64,643,080	\$230,754	\$64,873,834
2021	\$67,694,868	\$316,437	\$68,011,305
2022	\$68,110,179	\$476,876	\$68,587,055
2023	\$66,950,499	\$323,028	\$67,273,527
2024	\$73,515,489	\$326,675	\$73,842,164

Black start zonal charges in 2024 ranged from \$0 in the OVEC and REC Zones to \$17,956,824 in the AEP Zone. For each zone, Table 10-59 shows black start charges, zonal peak loads, and black start rates (calculated as charges per MW-day).<sup>143 144</sup>

<sup>139</sup> There are no black start units currently using the ALR option.

<sup>140</sup> OATT Schedule 6A (paras. 25, 26 and 27 outline how charges are to be applied).

<sup>141</sup> OATT Schedule 6A para. 21. "The Market Monitoring Unit shall include a Black Start Service summary in its annual State of the Market report which will set forth a descriptive summary of the new or additional Black Start NERC-CIP Capital costs requested by Black Start Units, and include a list of the types of capital costs requested and the overall cost of such capital improvements on an aggregate basis such that no data is attributable to an individual Black Start Unit."

<sup>142</sup> Starting December 1, 2012, PJM defined a separate black start uplift category. ALR units accounted for the high uplift charges in 2013 – 2015. All ALR units had been replaced by April 2015.

<sup>143</sup> See "PJM Manual 27: Open Access Transmission Tariff Accounting," § 7.3 Black Start Service Charges, Rev. 102 (Jan. 23, 2025).

<sup>144</sup> For each zone and import export/wheels the black start rates (\$/MW day) are calculated by taking total charges by zone and divided by peak load then divided by days in the period.

<sup>137</sup> RFPs are on the PJM website. <<http://www.pjm.com/markets-and-operations/ancillary-services.aspx>>.

<sup>138</sup> See OATT Schedule 6A para. 18.



Table 10–59 Black start zonal charges: 2023 and 2024<sup>145</sup>

Zone	2023					2024				
	Revenue Requirement Charges	Uplift Charges	Total Charges	Peak Load (MW)	Black Start Rate (\$/MW–day)	Revenue Requirement Charges	Uplift Charges	Total Charges	Peak Load (MW)	Black Start Rate (\$/MW–day)
ACEC	\$1,969,568	\$15,036	\$1,984,604	2,614	\$2.08	\$2,201,229	\$14,619	\$2,215,849	2,629	\$2.30
AEP	\$19,285,163	\$42,661	\$19,327,824	21,717	\$2.44	\$17,932,984	\$23,840	\$17,956,824	22,826	\$2.15
APS	\$5,761,231	\$792	\$5,762,023	9,154	\$1.72	\$5,987,458	\$6,602	\$5,994,060	9,303	\$1.76
ATSI	\$5,631,354	\$8,976	\$5,640,330	12,771	\$1.21	\$4,612,943	\$8,398	\$4,621,341	11,963	\$1.06
BGE	\$34,876	\$144	\$35,019	6,520	\$0.01	\$3,825,454	\$6,417	\$3,831,871	6,406	\$1.63
COMED	\$8,795,756	\$66,474	\$8,862,230	21,262	\$1.14	\$8,471,269	\$58,581	\$8,529,850	22,467	\$1.04
DAY	\$196,753	\$28,039	\$224,792	3,362	\$0.18	\$246,041	\$18,647	\$264,688	3,241	\$0.22
DUKE	\$292,832	\$11,487	\$304,319	5,166	\$0.16	\$385,485	\$15,060	\$400,545	5,135	\$0.21
DUQ	\$1,015,384	\$3,083	\$1,018,467	2,715	\$1.03	\$949,995	\$3,479	\$953,474	2,534	\$1.03
DOM	\$4,920,259	\$53,630	\$4,973,888	21,156	\$0.64	\$4,736,390	\$97,307	\$4,833,697	22,189	\$0.60
DPL	\$1,190,837	\$22,754	\$1,213,591	4,125	\$0.81	\$1,276,784	\$13,503	\$1,290,287	4,078	\$0.86
EKPC	\$285,400	\$4,052	\$289,452	2,994	\$0.26	\$325,518	\$13,893	\$339,411	3,755	\$0.25
JCPLC	\$536,405	\$2,484	\$538,889	6,123	\$0.24	\$515,668	\$953	\$516,621	5,731	\$0.25
MEC	\$412,288	\$26,498	\$438,786	3,021	\$0.40	\$475,732	\$8,721	\$484,453	2,890	\$0.46
OVEC	\$0	\$0	\$0	NA	NA	\$0	\$0	\$0	NA	NA
PECO	\$1,319,134	\$3,246	\$1,322,380	8,583	\$0.42	\$1,427,946	\$2,099	\$1,430,045	8,163	\$0.48
PE	\$4,279,716	\$8,829	\$4,288,545	2,830	\$4.15	\$4,136,036	\$8,340	\$4,144,377	2,763	\$4.10
PEPCO	\$175,578	\$1,150	\$176,727	5,834	\$0.08	\$5,153,085	\$1,839	\$5,154,924	5,872	\$2.40
PPL	\$4,884,980	\$1,674	\$4,886,654	7,489	\$1.79	\$4,626,537	\$176	\$4,626,713	7,083	\$1.78
PSEG	\$1,624,773	\$2,857	\$1,627,630	10,147	\$0.44	\$1,633,115	\$3,645	\$1,636,759	9,561	\$0.47
REC	\$0	\$0	\$0	NA	NA	\$0	\$0	\$0	NA	NA
(Imp/Exp/Wheels)	\$4,338,214	\$19,163	\$4,357,377	10,901	\$1.10	\$4,595,819	\$20,556	\$4,616,375	10,662	\$1.18
Total	\$66,950,499	\$323,028	\$67,273,527	168,484	\$1.09	\$73,515,489	\$326,675	\$73,842,164	169,249	\$1.19

Table 10–60 provides a revenue requirement estimate by zone for the 2023/2024, 2024/2025, and 2025/2026 Delivery Years.<sup>146</sup> Revenue requirement values are rounded up to the nearest \$50,000, reflecting the uncertainty about future black start revenue requirement costs. These values are illustrative only. The estimates are based on the best available data including current black start unit revenue requirements, expected black start unit termination and in service dates, changes in recovery rates, and owner provided cost estimates of incoming black start units at the time of publication and may change significantly. The estimates do not reflect the impact of FERC decisions that could affect compensation for black start.

Table 10–60 Black start zonal revenue requirement estimate: 2024/2025 through 2026/2027 Delivery Years<sup>147</sup>

Zone	2024 / 2025 Revenue Requirement	2025 / 2026 Revenue Requirement	2026 / 2027 Revenue Requirement
ACEC	\$2,700,000	\$2,550,000	\$2,600,000
AEP	\$15,350,000	\$8,500,000	\$6,000,000
APS	\$6,850,000	\$3,150,000	\$450,000
ATSI	\$3,800,000	\$3,400,000	\$3,350,000
BGE	\$3,900,000	\$5,150,000	\$5,500,000
COMED	\$8,550,000	\$2,250,000	\$2,400,000
DAY	\$300,000	\$250,000	\$200,000
DUKE	\$450,000	\$300,000	\$300,000
DUQ	\$1,100,000	\$1,100,000	\$100,000
DOM	\$5,150,000	\$2,600,000	\$1,300,000
DPL	\$1,500,000	\$1,000,000	\$900,000
EKPC	\$400,000	\$250,000	\$250,000
JCPLC	\$650,000	\$550,000	\$550,000
MEC	\$600,000	\$400,000	\$400,000
OVEC	\$0	\$0	\$0
PECO	\$1,600,000	\$1,350,000	\$1,350,000
PE	\$4,650,000	\$750,000	\$750,000
PEPCO	\$8,900,000	\$8,800,000	\$8,850,000
PPL	\$5,050,000	\$750,000	\$750,000
PSEG	\$1,850,000	\$800,000	\$800,000
REC	\$0	\$0	\$0
Total	\$73,350,000	\$43,900,000	\$36,800,000

<sup>145</sup> Peak load for each zone is used to calculate the black start rate per MW day.

<sup>146</sup> The System Restoration Strategy Task Force requested that the MMU provide estimated black start revenue requirements.

<sup>147</sup> The Net CONE values used for the 2026/2027 Delivery Year are the values in the December 9, 2024 PJM filing.

## CRF Issues

The capital recovery factor (CRF) defines the revenue requirement of black start units when new equipment is added to provide black start capability.<sup>148</sup> The CRF is a rate, which when multiplied by the investment, provides for a return on and of capital over a defined time period. CRFs are calculated using a formula (or a correctly defined standard financial model) that accounts for the weighted average cost of capital and its components, plus depreciation and taxes. The PJM CRF table was created in 2007 as part of the new RPM capacity market design.<sup>149</sup> That CRF table provided for the accelerated return of incremental investment in capacity resources based on concerns about the fact that some old coal units would be making substantial investments related to pollution control. The CRF values were later added to the black start rules.<sup>150</sup> The CRF table in the tariff included assumptions about tax rates that were significantly too high after the changes to the tax code in 2017. The PJM tariff tables including CRF values should have been changed for both black start and the capacity market when the tax laws changed in 2017.

The CRF table for existing black start units includes the column header, term of black start commitment, which is misleading and incorrect. The column is simply the cost recovery period. Accelerated recovery reduces risk to black start units and should not be the basis for a shorter commitment. Full payment of all costs of black start investment on an accelerated basis should not be a reason for a shortened commitment period. Regardless of the recovery period, payment of the full costs of the black start investment should require commitment for the life of the unit.<sup>151</sup> In addition, there is no need for such short recovery periods for black start investment costs. Two periods, based on unit age, are more than adequate.

The U.S. Internal Revenue Code changed significantly in December 2017.<sup>152</sup> <sup>153</sup> The PJM CRF table did not change to reflect these changes.<sup>154</sup> <sup>155</sup> As a result, CRF

values have overcompensated black start units since the changes to the tax code. The new tax law allows for a more accelerated depreciation and reduced the corporate tax rate to 21 percent.

Updated CRF rates, incorporating the tax code changes and applicable to all black start units, should have been implemented immediately. The updated CRF rates should apply to all black start units because the actual tax payments for all black start units were reduced by the tax law changes. Without this change, black start units are receiving and will continue to receive an unexpected and inappropriate windfall.

On April 7, 2021, PJM filed with FERC to update the CRF values for new black start service units.<sup>156</sup> PJM proposed to bifurcate the CRF calculation, applying an updated CRF calculation that incorporates the new federal tax law to new black start units while leaving the outdated and incorrect CRF in place for existing black start units. Rather than fix the inaccurate CRF values used for existing black start units, PJM's filing would have made the use of inaccurate values permanent. The MMU filed comments on April 28, 2021.<sup>157</sup> The MMU objected to the continued use of the outdated CRF for existing units. The MMU also introduced a CRF formula for calculating the CRF for new black start units and requested that the CRF formula be included in the tariff.<sup>158</sup> <sup>159</sup> On August 10, 2021, FERC issued an order ("August 10<sup>th</sup> Order") that accepted PJM's tariff revisions that apply to new black start units (selected for service after June 6, 2021) and directed PJM to include the CRF formula proposed by the MMU.<sup>160</sup> The August 10<sup>th</sup> Order also established a show cause proceeding in a new docket to "determine whether the existing rates for generating units providing Black Start Service (Black Start Units), which are based on a federal corporate income tax that pre-dates the Tax Cuts and Jobs Act of 2017 (TCJA), remains just and reasonable."<sup>161</sup> The MMU requested rehearing over the Commission's conclusion that the MMU had requested "retroactive changes to the rates previously paid to generators."<sup>162</sup> <sup>163</sup> The request for rehearing was

148 See OATT Schedule 6A para. 18.

149 See OATT Attachment DD § 6.8(a).

150 See OATT Schedule 6A.

151 PJM's recent filing to revise Schedule 6A includes a required commitment to provide black start service for the life of the unit. See FERC Docket No. ER21-1635.

152 Tax Cuts and Jobs Act, Pub. L. No. 115-97, 131 Stat. 2096, Stat. 2105 (2017).

153 26 U.S. Code §11(b).

154 The corporate tax rate was lowered to 21 percent and bonus depreciation, which allows generator owners to depreciate 100 percent of the capital investment in the first year of operation, was introduced.

155 Bonus depreciation is 100 percent for capital investments placed in service after September 27, 2017 and before January 1, 2023. Bonus depreciation is 80 percent for capital investments placed in service after December 31, 2022 and before January 1, 2024, and the bonus depreciation level is reduced by 20 percent for each subsequent year through 2026. Capital

investments placed in service after December 31, 2026 are not eligible for bonus depreciation.

See 26 U.S. Code §168(k)(6)(A).

156 See Docket No. ER21-1635-000.

157 See Comments of the Independent Market Monitor for PJM, FERC Docket No. ER21-1635-000 (April 28, 2021).

158 Answer and Motion to Leave to Answer of the independent Market Monitor for PJM, ER21-1635 (May 20, 2021).

159 Comments of the Independent Market Monitor for PJM, FERC Docket No. ER21-1635 (July 2, 2021).

160 176 FERC ¶ 61,080 at 42 and 44 (2021).

161 176 FERC ¶ 61,080 at 2 (2021).

162 Id. at 50.

163 Request for Rehearing of the Independent Market Monitor for PJM, FERC Docket No. ER21-1635 (September 9, 2021).

denied.<sup>164</sup> PJM's compliance filing to address the August 10 Order was accepted by letter order, subject to edits proposed by the MMU, on December 16, 2021.<sup>165</sup>

PJM's response to the show cause directive in the August 10<sup>th</sup> Order continued to support the use of the outdated CRF despite the Commission's statement that the CRF values "appear to be unjust, unreasonable, unduly discriminatory or preferential, or otherwise unlawful."<sup>166</sup> <sup>167</sup> The MMU responded with analysis showing that PJM's proposal for maintaining the outdated CRF values would result in significant over recovery of black start capital investments.<sup>168</sup> In March 2023, FERC issued an order establishing hearing and settlement judge procedures.<sup>169</sup> An impasse was declared on August 23, 2023 and a hearing procedural schedule was ordered.<sup>170</sup> <sup>171</sup> Settlement talks continued and in January 2024 Commission Trial Staff moved to suspend the proceeding because a settlement had been reached in principle.<sup>172</sup> The MMU filed comments in opposition to the settlement, and the settlement was not certified to the Commission.<sup>173</sup> <sup>174</sup> The hearing process then resumed, with an initial decision expected to issue in March 2025. Rather than hold a hearing, PJM, with the support of FERC Staff, submitted a second offer of settlement on behalf of itself and certain black start unit owners, AMP, ODEC and the PJM ICC. The settlement included exactly the same values as the first settlement, but also included affidavits. The second settlement was certified to the Commission as uncontested because the MMU was deemed to waive its objections because its opposing filing was treated as untimely.<sup>175</sup> The MMU filed its own offer of settlement, but that filing was not certified primarily based on a determination that the offer was a settlement in name only.<sup>176</sup> On November 15, 2024, the MMU filed a motion for reconsideration that is pending.

<sup>164</sup> 177 FERC ¶ 62,017 (2021).

<sup>165</sup> 177 FERC ¶ 61,202 (2021).

<sup>166</sup> *PJM Interconnection, LLC, Response to Commission's Show Cause Order*, Docket No. EL21-91 (October 12, 2021).

<sup>167</sup> August 10<sup>th</sup> Order at 47.

<sup>168</sup> Errata Filing of the Independent Market Monitor for PJM, Attachment B at 17, Docket No. EL21-91 (November 18, 2022).

<sup>169</sup> 182 FERC ¶ 61,194 (2023).

<sup>170</sup> *Order Declaring Impasse*, EL21-91-000 (August 23, 2023).

<sup>171</sup> *Order Adopting Procedural Schedule and Confirming Bench Ruling Regarding Protective Order*, EL21-91-000 (October 12, 2023).

<sup>172</sup> Motion of Commission Trial Staff to Suspend Procedural Schedule and Shorten Answer Period, Docket No. EL21-91-003 (January 10, 2024).

<sup>173</sup> Comments of the Independent Market Monitor for PJM in Opposition to Offer of Settlement, Docket No. EL21-91-000, -003 (February 20, 2024).

<sup>174</sup> 186 FERC ¶ 63,019 (2024).

<sup>175</sup> See 189 FERC ¶ 63,007 at P.3 (2024). The Market Monitor timely filed opposing comments, but the filing was rejected the following day due to the identification of a sentence as confidential that was no longer confidential in one of the supporting exhibits. Filing the corrected supporting exhibit resulted in a new filing date that was one day late.

<sup>176</sup> *Id.* at P.244.

There are 49 black start generators that have received payments based on the outdated CRF. Thirteen of the units have completed their black start capital cost recovery terms. Sixteen units started their black start service prior to January 1, 2018, and are currently receiving capital recovery payments. These units would not have been eligible for the TCJA bonus depreciation. The remaining 20 black start generators began their service terms after January 1, 2018, and are currently receiving capital recovery payments. Units with capital investments that began black start service after January 1, 2018, would have been eligible for bonus depreciation.

The November 15, 2024 settlement reduced the capital recovery payments for 38 black start generators. Table 10-61 shows the new CRF values from the settlement. The settlement CRF values became effective on January 1, 2024.

**Table 10-61 Settlement CRF Values**

Capital Recovery Period (years)	Original CRF Value	November 2024 Settlement CRF Value
5	0.363	0.310
10	0.198	0.177
15	0.146	0.135
20	0.125	0.118

There is no financial basis for the settlement CRF values and the settlement will result in significant over recovery for the owners of the black start generators. The settlement reduced the excess recovery payments from \$89.7 million to \$74.1 million.

Of the 36 units that are still receiving black start recovery payments, all but ten have fully recovered the capital investment. In other words, the owners of the units have received sufficient revenue to cover the return on and the return of the capital investments and the income tax liabilities associated with the capital recovery revenue. If recovery payments for these 26 units were stopped immediately and if the recovery payments for the ten other units were stopped in the future when the units reached full recovery, an additional \$52 million in excess payments could be avoided.

## Reactive Service and Capability

Under Schedule 2 to the OATT, suppliers of reactive power have been compensated separately for both reactive service and reactive capability.<sup>177 178 179 180</sup>

On October 17, 2024, the Commission issued a final rule, Order No. 904, eliminating separate payments for reactive in all jurisdictional markets, including PJM.<sup>181</sup> On January 28, 2025, PJM submitted a compliance filing to implement Order No. 904 (“Compliance Filing”).<sup>182</sup> The Compliance Filing proposed a transition mechanism lasting through May 31, 2026. The purpose of the transition mechanism was to permit continued payments for reactive capability because reactive revenues were included in the energy and ancillary service offset in the capacity market demand curve at \$2,199 per MW-Year and in market seller offer caps. The MMU filed comments arguing that resources in the DOM and BGE zones should not receive payments because the offset did not influence capacity prices in those zones, and that transition payments should not exceed the level of the reactive revenue offset in the capacity market demand curve, \$2,199 per MW-year. The Compliance Filing is pending.<sup>183</sup>

## Reactive Costs

Customers in PJM paid total reactive capability charges of \$388.0 million in 2023. Under the current rules, compensation for reactive capability is approved separately for each resource or resource group by FERC per Schedule 2 of the OATT.<sup>184</sup> Reactive capability credits are based on FERC approved filings for individual unit revenue requirements that are typically black box settlements.<sup>185</sup> Reactive service credits are paid to units that operate in real time outside of their normal range at the direction of PJM for the purpose of providing

reactive service. Compensation for reactive power service is based on real-time lost opportunity costs.<sup>186</sup>

Total reactive capability charges are the sum of FERC approved reactive supply revenue requirements. Zonal reactive supply revenue requirement charges are allocated monthly to PJM customers based on their zonal and to any nonzonal (outside of PJM) peak transmission use and daily average point to point transmission reservations.<sup>187 188</sup>

In 2024, total reactive charges were \$380.7 million, a decrease of \$8.4 million (2.16 percent) from 2023. In 2024, total reactive capability charges were \$379.2 million, a decrease of \$9.3 million (2.39 percent) from 2023. In 2024, total reactive service charges were \$1.5 million, an increase of \$0.89 million from 2023.

Table 10-62 shows reactive service charges for each year from 2010 through 2024.

**Table 10-62 Reactive service charges and reactive capability charges: January through December, 2010 through 2024**

Year	Reactive Service Charges	Reactive Capability Charges	Total
2010	\$69,314,376	\$241,994,431	\$311,308,807
2011	\$44,568,672	\$255,910,059	\$300,478,731
2012	\$76,100,839	\$272,864,535	\$348,965,374
2013	\$312,640,950	\$276,918,698	\$589,559,649
2014	\$29,560,453	\$280,840,576	\$310,401,029
2015	\$10,543,187	\$276,567,702	\$287,110,889
2016	\$2,498,279	\$294,389,603	\$296,887,882
2017	\$20,379,379	\$302,704,116	\$323,083,495
2018	\$13,183,120	\$303,465,206	\$316,648,326
2019	\$570,589	\$329,215,657	\$329,786,246
2020	\$428,629	\$345,647,272	\$346,075,901
2021	\$909,343	\$364,007,391	\$364,916,734
2022	\$1,513,558	\$384,991,729	\$386,505,287
2023	\$609,938	\$388,451,473	\$389,061,411
2024	\$1,500,424	\$379,153,040	\$380,653,464

Table 10-63 shows zonal reactive service charges for 2023 and 2024, reactive capability charges and total charges. Reactive service charges show charges to each zone for reactive service. Reactive capability charges show charges to each zone for reactive capability.

<sup>177</sup> See MMU, 2024 State of the Market Report for PJM: January–September (November 14, 2024) at 652–656, for history and analysis of reactive power in PJM.

<sup>178</sup> See Order No. 2003, 104 FERC ¶ 61,103 at P 544 (2003), *order on reh'g*, Order No. 2003-A, 106 FERC ¶ 61,220 at P 28, *order on reh'g*, Order No. 2003-B, 109 FERC ¶ 61,287 (2004), *order on reh'g*, Order No. 2003-C, 111 FERC ¶ 61,401 (2005), *aff'd sub nom. National Association of Regulatory Utility Commissioners v. FERC*, 475 F.3d 1277 (D.C. Cir. 2007); CAISO, 160 FERC ¶ 61,035 at P 19 (2017); SPP, 119 FERC ¶ 61,199 at P 28 (2007), *order on reh'g*, 121 FERC ¶ 61,196 (2007); see also 178 FERC ¶ 61,088, at PP 29–31 (2022); 179 FERC ¶ 61,103, at PP 20–21 (2022).

<sup>179</sup> OATT Attachment O.

<sup>180</sup> See *MISO*, 182 FERC ¶ 61,033 at P 52 (January 27, 2023) (*MISO*); see also *Standardization of Generator Interconnection Agreements & Procedures*, Order No. 2003, 104 FERC ¶ 61,103 at P 546.

<sup>181</sup> *Compensation for Reactive Power within the Standard Power Factor Range*, Order No. 904, 189 FERC ¶ 61,034 (2024) (“Order No. 904”).

<sup>182</sup> See Docket No. ER25–1073.

<sup>183</sup> Comments of the Independent Market Monitor for PJM, Docket No. ER25–1073 (February 18, 2025).

<sup>184</sup> See “PJM Manual 27: Open Access Transmission Tariff Accounting,” § 3.2 Reactive Supply and Voltage Control Credits, Rev. 102 (Jan. 23, 2025).

<sup>185</sup> OATT Schedule 2.

<sup>186</sup> See OA Schedule 1 § 3.2.3B.

<sup>187</sup> OATT Schedule 2.

<sup>188</sup> See “PJM Manual 27: Open Access Transmission Tariff Accounting,” § 3.3 Reactive Supply and Voltage Control Charges, Rev. 102 (Jan. 23, 2025).

Table 10-63 Reactive service charges and reactive capability charges by zone: 2023 and 2024

Zone	2023			2024		
	Reactive Service Charges	Reactive Capability Charges	Total Charges	Reactive Service Charges	Reactive Capability Charges	Total Charges
ACEC	\$0	\$2,749,871	\$2,749,871	\$807,871	\$2,459,663	\$3,267,534
AEP	\$117,229	\$58,675,783	\$58,793,012	\$0	\$60,210,971	\$60,210,971
APS	\$0	\$21,264,175	\$21,264,175	\$9,251	\$20,494,171	\$20,503,422
ATSI	\$0	\$27,928,341	\$27,928,341	\$0	\$28,292,194	\$28,292,194
BGE	\$382,859	\$6,526,162	\$6,909,021	\$44,256	\$6,540,605	\$6,584,860
COMED	\$0	\$48,561,061	\$48,561,061	\$0	\$48,614,689	\$48,614,689
DAY	\$0	\$2,767,693	\$2,767,693	\$0	\$2,773,818	\$2,773,818
DUKE	\$0	\$7,881,561	\$7,881,561	\$0	\$7,960,000	\$7,960,000
DOM	\$0	\$53,198,175	\$53,198,175	\$0	\$47,415,771	\$47,415,771
DPL	\$0	\$9,858,129	\$9,858,129	\$125,907	\$9,664,540	\$9,790,448
DUQ	\$0	\$81,515	\$81,515	\$0	\$81,384	\$81,384
EKPC	\$0	\$2,142,848	\$2,142,848	\$481,617	\$2,147,591	\$2,629,208
JCPLC	\$0	\$7,394,341	\$7,394,341	\$0	\$6,039,017	\$6,039,017
MEC	\$93,612	\$5,977,396	\$6,071,008	\$31,523	\$5,952,967	\$5,984,490
OVEC	\$0	\$0	\$0	\$0	\$0	\$0
PECO	\$0	\$20,571,627	\$20,571,627	\$0	\$20,477,158	\$20,477,158
PE	\$16,237	\$15,339,224	\$15,355,461	\$0	\$14,111,966	\$14,111,966
PEPCO	\$0	\$8,631,510	\$8,631,510	\$0	\$8,469,924	\$8,469,924
PPL	\$0	\$35,899,963	\$35,899,963	\$0	\$35,966,987	\$35,966,987
PSEG	\$0	\$26,741,001	\$26,741,001	\$0	\$26,642,306	\$26,642,306
REC	\$0	\$0	\$0	\$0	\$0	\$0
(Imp/Exp/Wheels)	\$0	\$26,261,097	\$26,261,097	\$0	\$24,837,320	\$24,837,320
Total	\$609,938	\$388,451,473	\$389,061,411	\$1,500,425	\$379,153,040	\$380,653,465

Table 10-64 shows the units which received reactive service credits in 2024.

Table 10-64 Reactive service credits by plant (Total dollars): 2024

2024		
Zone	Plant	Reactive Service Credits
AECO	ACE CARLLS 1 CT	\$208,041
AECO	ACE CARLLS 2 CT	\$53,901
AECO	ACE CLAYVILLE 1 CT	\$7,768
AECO	ACE CUMBERLAND 1 CT	\$5,106
AECO	ACE CUMBERLAND 2 CT	\$4,830
AECO	ACE SHERMAN 1 CT	\$519,379
AECO	ACE VINELAND 11 CT	\$8,847
APS	AP CHAMBERSBURG - GUILFORD CT 12	\$3,238
APS	AP CHAMBERSBURG - GUILFORD CT 13	\$3,310
APS	AP CHAMBERSBURG 4-7 D	\$329
APS	AP GANS 8 CT	\$1,186
APS	AP GANS 9 CT	\$1,189
BGE	BC PERRYMAN 51 F	\$44,256
DPL	DPL BAYVIEW 1 D	\$22
DPL	DPL BAYVIEW 2 D	\$599
DPL	DPL BAYVIEW 3 D	\$591
DPL	DPL EASTON DIESEL	\$27,238
DPL	DPL GARRISON EC 1 CC	\$3,947
DPL	DPL INDIAN RIVER 4 F	\$46,169
DPL	DPL TASLEY 10 CT	\$47,342
EKPC	EKPC COOPER 1 F	\$464,946
EKPC	EKPC JK SMITH 1 CT	\$3,222
EKPC	EKPC JK SMITH 10 CT	\$2,170
EKPC	EKPC JK SMITH 2 CT	\$3,192
EKPC	EKPC JK SMITH 3 CT	\$3,754
EKPC	EKPC JK SMITH 7 CT	\$2,640
EKPC	EKPC JK SMITH 9 CT	\$1,694
METED	ME MOUNTAIN 1 CT	\$9,974
METED	ME MOUNTAIN 2 CT	\$15,225
METED	ME TOLNA 2 CT	\$6,324
Total		\$1,500,424



Table 10-65 shows the settled reactive capability revenue requirements by technology effective on December 1, 2024, for active units.<sup>189</sup> These revenue requirements do not include revenue requirements that were filed but not yet final. The table demonstrates the wide disparity in payments for reactive capability that result from the current cost of service rate case model settlement process.

**Table 10-65 Total settled reactive revenue requirements by unit type and fuel type for active units<sup>190</sup>: December 1, 2024**

Unit Type	Fuel Type	Total Revenue Requirement per Year	MW	Number of Resources	Revenue Requirement per MW-year	Minimum Revenue Requirement per MW-year	Maximum Revenue Requirement per MW-year
CC	Gas	\$126,430,872.93	49,023.3	152	\$378,418.13	\$302.10	\$22,500.00
CT	Gas	\$46,208,603.73	28,465.9	247	\$530,480.05	\$103.64	\$19,610.84
CT	Oil	\$4,066,386.49	2,732.6	99	\$145,672.90	\$289.74	\$4,052.58
Diesel	Oil	\$839,703.17	145.3	31	\$183,630.75	\$395.37	\$8,812.75
Diesel	Other - Gas	\$1,117,240.13	103.9	12	\$116,892.23	\$4,382.50	\$13,188.62
FC	Gas	\$45,000.00	2.4	1	\$18,750.00	\$18,750.00	\$18,750.00
Hydro	Water	\$26,089,578.48	6,426.2	53	\$445,745.22	\$137.04	\$67,223.40
Nuclear	Nuclear	\$68,190,421.13	32,534.6	31	\$75,769.69	\$807.91	\$7,097.69
Solar	Solar	\$5,840,392.13	1,498.9	13	\$88,194.45	\$705.15	\$15,007.81
Steam	Coal	\$46,500,152.97	34,993.1	58	\$133,672.99	\$255.85	\$9,804.78
Steam	Gas	\$5,959,834.62	5,726.6	17	\$20,133.04	\$626.53	\$3,737.86
Steam	Oil	\$2,968,019.83	2,390.2	9	\$13,224.66	\$308.89	\$3,211.11
Steam	Other - Solid	\$340,000.00	34.0	2	\$18,919.11	\$8,311.11	\$10,608.00
Steam	Wood	\$331,895.06	153.0	3	\$6,507.75	\$2,169.25	\$2,169.25
Wind	Wind	\$18,299,020.69	4,882.6	38	\$156,443.53	\$1,860.80	\$9,564.74
All		\$353,227,121.36	169,112.6	766	\$2,088.71	\$103.64	\$67,223.40

## Frequency Control Definition

There are four distinct types of frequency control, distinguished by response timeframe and operational nature: Inertial Response, Primary Frequency Response, Secondary Frequency Control (Regulation), and Tertiary Frequency Control (Primary Reserve).

- **Inertial Response.** Inertial response to frequency excursion is the natural resistance of rotating mass turbine generators to changes in their stored kinetic energy. This response is immediate and resists short term changes to ACE from the instant of the disturbance up to twenty seconds after the disturbance.
- **Primary Frequency Response.** Primary frequency response is a response to a disturbance based on a local detection of frequency and local operational control settings. Primary frequency response begins within a few seconds and extends up to a minute. The purpose of primary frequency response is to arrest and stabilize the system until other measures (secondary and tertiary frequency response) become active.
- **Secondary Frequency Control.** Secondary frequency control is called regulation. In PJM it begins to respond within 10 to 15 seconds and can continue up to an hour. Regulation is controlled by PJM which detects the grid frequency, calculates a counterbalancing signal, and transmits that signal to all regulating resources.
- **Tertiary Frequency Control.** Tertiary frequency control and imbalance control lasting 10 minutes to an hour is called primary reserve.

## Primary Frequency Response

Primary Frequency Response (“PFR”) is achieved through the use of automatic governors installed on generators. A governor can be either an electronic or mechanical device that increases or decreases a generator’s output based on frequency changes in the system. Governors are set to respond to any frequency changes larger than a defined minimum, called a deadband, which is expressed in Hertz (Hz). Governors have a frequency change limit, called

<sup>189</sup> The total amount in the final row of Table 10-65 is the amount that would be paid if the total rate effective on December 1, 2024 were effective for an entire year. The total rates effective on any given day depend on requests made by resource owners in filings to FERC and FERC approval of those rates.

<sup>190</sup> For aggregate requirements, in which a single payment is made for the combined output of multiple units, the aggregate requirement was distributed in proportion to unit size for calculating a resource’s individual revenue requirement. For wind, solar, and hydro resources, that size is the ELCC. For all other resources, that size is the ICAP.

droop, which is expressed as a percentage of the frequency change from the optimal 60 Hz (e.g. 2 percent droop equals  $0.02 * 60$  Hz, or 1.2 Hz). Governor droop changes resource output in proportion to the deviation of frequency once frequency has exceeded the deadband limit. Primary frequency response alone does not restore frequency to the original scheduled value primarily because governor directed changes only occur when frequency is beyond the governor deadband.

On February 15, 2018, the Commission issued Order No. 842, which modified the pro forma large and small generator interconnection agreements and procedures to require all newly interconnecting non nuclear generating facilities, both synchronous and nonsynchronous, to include equipment for primary frequency response capability as a condition to receive interconnection service. Such equipment must include a governor or equivalent controls with the capability of operating at a maximum 5 percent droop and  $\pm 0.036$  Hz deadband (or the equivalent or better).<sup>191</sup> PJM filed revisions in compliance with Order No. 842 that substantively incorporated the pro forma agreements into its market rules.<sup>192</sup>

PJM evaluates generators' primary frequency capabilities using two to three frequency events per month, with events being chosen on the criteria that the frequency stays outside  $\pm 0.040$  Hz deadband for at least one minute, and the minimum/maximum frequency reaches  $\pm 0.053$  Hz. Nuclear units, offline units, units with no available headroom/footroom, units assigned regulation, and units with an active eDART ticket for governor outage are not evaluated. The performance of each unit is evaluated, with each event evaluated separately with a responsive/non-responsive pass/fail determination, and then averaged quarterly. A quarterly unit performance of 50 percent or greater is considered responsive.<sup>193</sup> The underlying unit data and results of these primary frequency response events are not saved in PJM's databases, so the MMU is not currently able to verify the results of these tests.

The MMU recommends that the same capability be required of both new and existing resources. The MMU agrees with Order No. 842 that RTOs not be required to provide additional compensation specifically for frequency response. The current PJM market design

provides compensation for all capacity costs, including these, in the PJM markets. The current market design provides compensation, through heat rate adjusted energy offers, for any costs associated with providing frequency response. Because the PJM market design already compensates resources for frequency response capability and any costs associated with providing frequency response, any separate filings submitted on behalf of resources for compensation under section 205 of the Federal Power Act should be rejected as double recovery.

On August 15, 2024, NERC proposed Project 2020-02, a modification to the PRC-029-1 reliability standard, called, "The frequency and voltage ride through requirement for inverter based generating resources ("IBRs")." This proposed standard is intended to address the risk to reliability associated with the rapid adoption of IBRs, by requiring that IBRs remain operational during and after defined frequency and voltage excursions.<sup>194</sup> To achieve this, IBRs must continue to deliver pre-disturbance levels of active and reactive power, and would only be permitted to trip to avoid equipment damage. This proposal is currently in the final stages of evaluation and adoption.

<sup>191</sup> 157 FERC ¶ 61,122 (2016).

<sup>192</sup> See 164 FERC ¶ 61,224 (2018).

<sup>193</sup> See PJM Manual 12: Balancing Operations, § 3.6.2. Rev. 53 (July 24, 2024).

<sup>194</sup> See NERC, "PRC-029-1," <<https://www.nerc.com>> (Accessed November 6, 2024).

## Congestion and Marginal Losses

When there are binding transmission constraints and locational price differences, load pays more for energy than generation is paid to produce that energy.<sup>1</sup> The difference is congestion.<sup>2</sup> As a result, congestion belongs to load and should be returned to load. Congestion is not the difference in CLMP between nodes. Congestion is not the billing line item labeled congestion.<sup>3</sup>

Congestion is not a useful metric for determining whether there is a benefit to building more transmission. Analyses that use congestion to support the need for transmission expansion incorrectly count congestion as a cost to load without accounting for how the congestion dollars are or are not returned to the load through ARR and FTRs.

If FTRs worked perfectly and were assigned directly to load, FTRs would return all congestion to the load that paid the congestion. Congestion is not a cost, it is an accounting result of a market based on locational energy prices in which all load in a constrained area pays the higher single market clearing locational price, resulting in excess payments by load that are not paid to generation, which should be returned to load.

Counterintuitively, congestion can actually increase when the transmission capacity between areas with lower cost generation and areas with higher cost generation is expanded but does not fully eliminate the need for some higher cost local generation. The smaller the amount of higher cost local generation needed to meet load, the more of the local load is met via low cost generation delivered over the transmission system and therefore the higher can be the difference between what load pays and generation receives, congestion.

For all these reasons, if done correctly and if FTRs/ARRs returned 100 percent of congestion to load, the cost/benefit analysis for transmission projects would include the total net change in production costs and would not include congestion. The change in production costs correctly measures the changes in cost to load that result from a project. There clearly can be benefits to transmission expansion but congestion is not the correct

metric for measuring those benefits. The correct metric is the change in production costs which measures the reduction in the reliance on higher cost generation to meet load in the presence of a transmission constraint.

This issue also illustrates the unintended and negative consequences of misunderstanding congestion and FTRs. The unintended result is to overstate the benefits of transmission expansion by not correctly recognizing how congestion dollars should be returned to load. Even in the case where there is only a partial return of congestion to load, the actual return of congestion to load must be accounted for in order to correctly identify the benefits. Ignoring the return of congestion to load from ARR/FTRs overstates the potential benefits of transmission expansion, and ignores the value of smaller upgrades that may not eliminate a constraint, but may reduce production costs and therefore the average cost of energy for load.

The locational marginal price (LMP) is the incremental price of energy at a bus. The LMP at a bus can be divided into three components: the system marginal price (SMP) or energy component, the congestion component (CLMP), and the marginal loss component (MLMP). SMP, MLMP and CLMP are the simultaneous products of the least cost, security constrained dispatch of system resources to meet system load and the use of a load-weighted reference bus. The relative values of SMP and CLMP are arbitrary and depend on the reference bus.

SMP is defined as the incremental price of energy for the system, given the current dispatch, at the load-weighted reference bus, or LMP net of losses and congestion. SMP is the LMP at the load-weighted reference bus. The load-weighted reference bus is not a fixed location but varies with the distribution of load at system load buses. For SMP, energy means the component of LMP not associated with a binding transmission constraint. All other locational prices that result from the least cost, security constrained market solution are higher or lower than this reference point price (SMP) as a result of binding constraints. The reference bus is a point of reference. For a given market solution, changing the reference bus does not change the LMP for any node on the system, but changes only the elements of the nodal prices that are positive or negative due to the binding constraints in that solution, further illustrating that the relative levels of SMP and LMP are arbitrary.

<sup>1</sup> Load is generically referred to as withdrawals and generation is generically referred to as injections, unless specified otherwise.

<sup>2</sup> The difference in losses is not part of congestion.

<sup>3</sup> PJM billing examples can be found in *2024 Annual State of the Market Report for PJM*, Appendix F: Congestion and Marginal Losses.

CLMP is defined as the incremental price of meeting load at each bus when a transmission constraint is binding, based on the shadow price associated with the relief of a binding transmission constraint in the security constrained optimization. (The shadow price is the difference between the CLMPs across the transmission constraint.) There can be multiple binding transmission constraints. CLMPs are positive or negative depending on location relative to binding constraints and relative to the load-weighted reference bus. In an unconstrained system CLMPs will be zero. This means that CLMP at a bus is not congestion. The difference between CLMPs at buses is not congestion, it is just the absolute LMP difference between the two buses caused by transmission constraints, or the shadow price. CLMP is the portion of the LMP at a bus that indicates whether the LMP at that bus is higher or lower than the marginal price of energy SMP at the selected reference bus due to binding transmission constraints. The relative values of SMP and CLMP are arbitrary and depend on the reference bus.

MLMP is defined as the incremental price of losses at a bus, based on marginal loss factors in the security constrained optimization. Losses refer to energy lost to physical resistance in the transmission network as power is moved from generation to load.

Total losses refer to total system wide transmission losses as a result of moving power from injections to withdrawals on the system. Marginal losses are the incremental change in system losses caused by changes in load and generation.

Congestion is neither good nor bad, but is a direct measure of the extent to which there are multiple marginal generating units with different offers dispatched to serve load as a result of transmission constraints. Congestion occurs when available, least-cost energy cannot be delivered to all load because transmission facilities are not adequate to deliver that energy to one or more areas, and higher cost units in the constrained area(s) must be dispatched to meet the load.<sup>4</sup> When the least-cost available energy cannot be delivered to load in a transmission constrained area, higher cost units in the constrained area must be dispatched to meet that load. The result is that the price of energy in the constrained

area is higher than in the unconstrained area because of the combination of transmission limitations and the cost of local generation. Congestion is the difference between the total cost of energy paid by load in the transmission constrained area based on the single higher price at load buses and the total revenue received by generation based on the prices at the generator buses to provide that energy, after virtual bids have been settled. Congestion equals the sum of day-ahead and balancing congestion. The actual incremental cost paid by load in the constrained area is the difference in price (shadow price) times the MW of load served by higher cost local generation. This is also the higher production costs that result from the constraint.

The energy, marginal losses and congestion metrics must be interpreted carefully.

In PJM accounting, the term total congestion refers to net implicit CLMP charges plus net explicit CLMP charges plus net inadvertent CLMP charges. The net implicit CLMP charges are the implicit withdrawal CLMP charges less implicit injection CLMP credits.

As with congestion, total system energy costs are more precisely termed net system energy costs and total marginal loss costs are more precisely termed net marginal loss costs. Ignoring interchange, total generation MWh must be greater than total load MWh in any hour in order to provide for losses. Since the hourly integrated energy component of LMP is the same for every bus within every hour, the net energy bill is negative (ignoring net interchange), with more generation credits than load payments in every hour.<sup>5</sup>

While PJM accounting focuses on CLMPs, the individual CLMP values at any bus are irrelevant to the calculation of congestion, as CLMPs are just an artificial deconstruction of LMP based on a selected reference bus. Holding aside the marginal loss component of LMP, differences in the LMPs are caused by binding constraints in the least cost security constrained dispatch market solution and total congestion is the net surplus revenue that remains after all sources and sinks are credited or charged their LMPs. Changing the components of LMP by electing a different reference bus does not change the LMPs or the difference between LMPs for a given market solution, it merely changes the components of the LMP. This means

<sup>4</sup> This is referred to as dispatching units out of economic merit order. Economic merit order is the order of all generator offers from lowest to highest cost. Congestion occurs when loadings on transmission facilities mean the next unit in merit order cannot be used and a higher cost unit must be used in its place. Dispatch within the constrained area follows merit order for the units available to relieve the constraint.

<sup>5</sup> The total congestion and marginal losses for 2024 were calculated as of January 15, 2025, and are subject to change, based on continued PJM billing updates.

that no particular importance should be assigned to the levels of SMP and CLMP at a bus.

Local congestion is the congestion paid by load at a specific bus or set of buses and is calculated on a constraint specific basis. For a given market solution, a change in the reference bus does not change the LMP at any bus and does not change total congestion paid by load and does not change the local congestion paid by load at a specific location. Holding aside the marginal loss component of LMP, local congestion is the sum of the total LMP charges to load at the defined set of buses minus the sum of the total LMP credits received by all generation that supplied that load, given the set of all binding transmission constraints, regardless of location. Local congestion reflects the underlying characteristics of the complete power system as it affects the defined area, including the nature and capability of transmission facilities, the offers and geographic distribution of generation facilities, the level and geographic distribution of incremental bids and offers and the geographic and temporal distribution of load. Local congestion fully reflects the least cost security constrained system solution and the LMPs that result from that solution.

PJM implemented fast start pricing in both day-ahead and real-time markets starting September 1, 2021. PJM's fast start pricing logic results in pricing run locational marginal prices (PLMP). PLMP is the price that load pays and generators receive in the PJM energy market.

While PLMP is the official settlement price, PJM continues to calculate LMP based on the logic that PJM uses to actually dispatch system resources and used prior to the introduction of fast start to consistently define dispatch and prices. The LMPs from the dispatch run are dispatch run locational marginal prices (DLMP). While the settlement prices are PLMP, settlement MW are based on the dispatch run in the day-ahead market and are metered output in the real-time market.

PJM inappropriately uses artificial constraints in the day-ahead and real-time markets to force specific resources (generation or demand response) to be marginal in order to have those resources set price. The resultant, artificially uniform source dfax and sink dfax of the artificial constraint can be modified, along with the line limits, by PJM to meet market outcome goals and are a source of often significant modeling

differences between the day-ahead and real-time market. These modeling differences result in inefficient market outcomes and false arbitrage opportunities for virtual transactions. These artificial constraints have been used to hide uplift costs by making uplift costs negative congestion charges. The use of artificial constraints is an inappropriate use of PJM discretion as the market operator, putting PJM in the position of a market actor, arbitrarily changing market results, market prices, generation revenues, congestion costs and load charges.

## Overview

### Congestion Cost

- **Total Congestion.** Total congestion costs increased by \$685.8 million or 64.2 percent, from \$1,068.6 million in 2023 to \$1,754.4 million in 2024.
- **Day-Ahead Congestion.** Day-ahead congestion costs increased by \$694.1 million or 50.9 percent, from \$1,364.5 million in 2023 to \$2,058.6 million in 2024.
- **Balancing Congestion.** Negative balancing congestion costs increased by \$8.3 million, from -\$295.9 million in 2023 to -\$304.2 million in 2024. Negative balancing explicit charges decreased by \$37.7 million, from -\$219.9 million in 2023 to -\$182.1 million in 2024.
- **Real-Time Congestion.** Real-time congestion costs increased by \$655.1 million, from \$1,411.7 million in 2023 to \$2,066.8 million in 2024.
- **Monthly Congestion.** Monthly total congestion costs in 2024 ranged from \$53.2 million in February to \$330.5 million in July.
- **Geographic Differences in CLMP.** Differences in CLMP between southern and eastern control zones in PJM were primarily a result of binding constraints on the Nottingham Series Reactor, the Lenox – North Meshoppen Line, the Yorkana Circuit Breaker, the Conastone – Northwest Line, and the AP South Interface.
- **Congestion Frequency.** Congestion frequency continued to be significantly higher in the day-ahead energy market than in the real-time energy market in 2024. The number of congestion event hours in the day-ahead energy market was about three times the number of congestion event hours in the real-time energy market.



Day-ahead congestion frequency increased by 6.5 percent from 73,522 congestion event hours in 2023 to 78,295 congestion event hours in 2024.

Real-time congestion frequency increased by 22.0 percent from 22,687 congestion event hours in 2023 to 27,680 congestion event hours in 2024.

- **Congested Facilities.** Day-ahead, congestion event hours decreased on transformers and increased on interfaces, lines and flowgates.

The Nottingham Series Reactor was the largest contributor to congestion costs in 2024. With \$222.8 million in total congestion costs, it accounted for 20.9 percent of the total PJM congestion costs in 2024.

- **CT Price Setting Logic and Closed Loop Interface Related Congestion.** PJM's use of CT pricing logic officially ended with the implementation of fast start pricing on September 1, 2021. While CT pricing logic was officially discontinued, PJM continues to use a related logic to force inflexible units and demand response to be on the margin in both real time and day ahead. None of the PJM defined closed loop interfaces were binding in 2023 or 2024.
- **Zonal Congestion.** AEP had the highest zonal congestion costs among all control zones in 2024. AEP had \$286.6 million in zonal congestion costs, comprised of \$333.3 million in day-ahead congestion costs and -\$46.7 million in balancing congestion costs.

## Marginal Loss Cost

- **Total Marginal Loss Costs.** Total marginal loss costs increased by \$138.4 million or 17.8 percent, from \$777.2 million in 2023 to \$915.6 million in 2024. The loss MWh in PJM increased by 891.8 GWh or 5.9 percent, from 15,056.8 GWh in 2023 to 15,948.6 GWh in 2024. The loss component of real-time LMP in 2024 was \$0.03, compared to \$0.02 in 2023.
- **Day-Ahead Marginal Loss Costs.** Day-ahead marginal loss costs increased by \$128.0 million or 15.1 percent, from \$850.2 million in 2023 to \$978.2 million in 2024.
- **Balancing Marginal Loss Costs.** Negative balancing marginal loss costs decreased by \$10.4 million or 14.3 percent, from -\$73.0 million in 2023 to -\$62.6 million in 2024.

- **Total Marginal Loss Surplus.** The total marginal loss surplus increased by \$75.8 million or 28.7 percent, from \$264.0 million in 2023, to \$339.8 million in 2024.

- **Monthly Total Marginal Loss Costs.** Monthly total marginal loss costs in 2024 ranged from \$41.5 million in March to \$129.8 million in July.

## System Energy Cost

- **Total System Energy Costs.** Total system energy costs decreased by \$66.6 million or 13.1 percent, from -\$507.5 million in 2023 to -\$574.1 million in 2024.
- **Day-Ahead System Energy Costs.** Day-ahead system energy costs decreased by \$19.9 million or 3.0 percent, from -\$666.0 million in 2023 to -\$685.9 million in 2024.
- **Balancing System Energy Costs.** Balancing system energy costs decreased by \$51.6 million or 33.5 percent, from \$154.2 million in 2023 to \$102.6 million in 2024.
- **Monthly Total System Energy Costs.** Monthly total system energy costs in 2024 ranged from -\$86.3 million in January to -\$27.6 million in March.

## Conclusion

Congestion is defined as the total payments by load in excess of the total payments to generation, excluding marginal losses. The level and distribution of congestion reflects the underlying characteristics of the power system, including the nature and defined capability of transmission facilities, the offers and geographic distribution of generation facilities, the level and geographic distribution of incremental bids and offers and the geographic and temporal distribution of load.

Total congestion costs increased by \$685.8 million or 64.2 percent, from \$1,068.6 million in 2023 to \$1,754.4 million in 2024.

Monthly total congestion costs ranged from \$53.2 million in February to \$330.5 million in July in 2024.

The current ARR/FTR design does not ensure that load receives the rights to all congestion revenues. The congestion offset provided by ARRs and self-scheduled FTRs in the first seven months of the 2024/2025 planning period was 55.9 percent. The cumulative offset of congestion by ARRs for the 2011/2012 planning

period through the first seven months of the 2024/2025 planning period, using the rules effective for each planning period, was 69.6 percent. Load has received \$4.6 billion less than load should have received from the 2011/2012 planning period through the first seven months of the 2024/2025 planning period.

## Issues

### Artificial Constraints, Closed Loop Interfaces and CT Pricing Logic

PJM has used, and in some cases, continues to use, artificial constraints in the day-ahead and real-time markets to force specific resources (generation or demand response) to be marginal in order to have those resources set price. Some of these artificial constraints, such as CT pricing logic and closed loop interfaces, result in negative congestion charges that are an artifact of the artificial nature of the constraints that cause generation to be paid more than load pays for energy affected by the constraint. PJM also makes use of artificial constraints that function like closed loop interfaces but which result in positive or negative balancing congestion. These constraints are called Real-Time Short-Term Marginal Value Overrides. These constraints are similar to a closed loop interface in that they enforce artificially uniform price effects, but unlike closed loop interfaces that only affect prices on the constrained side, these artificial constraints enforce artificially uniform price spreads between the two sides of the constraint through large uniform dfax on the constrained side and small uniform dfax on the unconstrained side. These artificial constraints take the form of interfaces or enforced contingencies (modifications) on existing constraints. The uniform source dfax and uniform sink dfax of the artificial constraint can be modified, along with the transmission line limits, by PJM to meet market outcome goals and are a source of often significant modeling differences between the day-ahead and real-time market. These modeling differences result in inefficient market outcomes and false arbitrage opportunities for virtual transactions. This is an inappropriate use of these tools as it puts PJM in the position of a market actor, arbitrarily changing market results, market prices, generation revenues, congestion costs and load charges. One of the side effects of these changes in parameters, besides causing modeling differences between the day-ahead and real-time market, is that the apparent location

of the interface or parent constraint can move intraday relative to source and sink points.

While CT pricing logic was officially discontinued by PJM with the implementation of fast start pricing on September 1, 2021, PJM continues to use the same basic logic (Real-Time Short-Term Marginal Value Overrides) to force inflexible units to be on the margin in both real time and day ahead. PJM used CT pricing logic to force otherwise uneconomic resources to be marginal and set price in the day-ahead or real-time market solution. PJM used CT pricing logic to create an artificial constraint with a variable flow limit, paired with an artificial override of the inflexible resource's economic minimum, to make the resource marginal in PJM's LMP security constrained pricing logic. The purpose of forcing inflexible units to be marginal is to artificially reduce the uplift associated with the dispatch of inflexible resources.

Through the assumption of artificial flexibility of the affected unit and artificially creating a constraint for which the otherwise inflexible resource can be marginal, PJM's use of CT pricing logic forced the affected resource bus LMP to match the marginal offer of the resource. PJM adjusts the constraint limit based on the output of the resource. Sometimes the constraint limit does not match the flows on the constraint, and the constraint violates instead of binding, resulting in prices set by the transmission constraint penalty factor.

In the case of a closed loop interface, all buses within the interface were modeled with a distribution factor (dfax) of 1.0 to the constraint and therefore with the same constraint related congestion component of price at the marginal resource's bus. In the CT pricing logic case, the constraint affected the CLMP of constrained side buses in proportion to their dfax to that constraint.<sup>6</sup> One objective of making inflexible resources marginal was to artificially minimize the uplift costs associated with the inflexible resources that PJM commits for system security reasons.

The use of artificial constraints was and is a source of modeling differences between the day-ahead and real-time markets. When artificial constraints are not included in the day-ahead market in exactly the same way as in the real-time market, including specific constraints and limits, the differences between the day-

<sup>6</sup> The constrained side means the higher priced side with a positive CLMP created by the constraint.

ahead and real-time market model result in positive or negative balancing congestion.

Failure to model the same constraints in the day-ahead and real-time markets results in pricing and congestion settlement differences between the day-ahead and real-time market. Any modeling differences create false arbitrage opportunities for virtual bids and contribute to negative balancing congestion.

Use of artificial constraints, closed loop interfaces and CT price setting logic requires manipulation of the economic dispatch model. Closed loop interfaces and CT price setting logic, like fast start pricing logic that replaced it, force higher cost inflexible units to be marginal.

Like closed loop interfaces and CT pricing logic, some of the artificially enforced constraint results in negative congestion. As a result, more power is produced in the artificial closed loop or constrained area than would result without the artificial constraint. This means that there are more generation credits than load charges in the constrained area. The constrained area exports power, the lower cost generators outside the constrained area are backed down and prices are lower outside the constrained area as a result. All of the generation within the artificially constrained area is paid the higher CLMP, but only a smaller amount of load (in some cases no load) in the constrained area pays this higher CLMP. As a result, load pays less than generation receives in the artificially constrained area. This difference is negative congestion. In the day-ahead market this reduces the total congestion dollars that are available to FTR holders. In the balancing market these costs are allocated directly to load as negative balancing charges.

## Locational Marginal Price (LMP) Components

PJM uses a distributed load reference bus. With a distributed load reference bus, the energy component of LMP is a load-weighted system price. Some price effects of binding constraints may be included in the load-weighted reference bus price.

LMP at a bus reflects the incremental price of energy at that bus. LMP at any bus can be disaggregated into three components: the system marginal price (SMP), marginal loss component (MLMP), and congestion component (CLMP).

SMP, MLMP and CLMP are a product of the least cost, security constrained dispatch of system resources to meet system load. SMP is the incremental cost of system energy, given the current dispatch and given the choice of reference bus. SMP is LMP net of losses and congestion. Losses refer to energy lost to physical resistance in the transmission and distribution network as power is moved from generation to load. Marginal losses are the incremental change in system power losses caused by changes in the system load and generation patterns.<sup>7</sup> The first derivative of total losses with respect to the power flow is marginal losses. Congestion cost reflects the incremental cost of relieving transmission constraints while maintaining system power balance. Congestion occurs when available, least-cost energy cannot be delivered to all loads because transmission facilities are not adequate to deliver that energy. When the least-cost available energy cannot be delivered to load in a transmission constrained area, higher cost units in the constrained area must be dispatched to meet that load.<sup>8</sup> The result is that the price of energy in the constrained area is higher than in the unconstrained area because of the combination of transmission limitations and the cost of local generation. Load in the constrained area pays the higher price for all energy including energy from low cost generation and energy from high cost generation. Congestion is the difference between the total cost of energy paid by load in the transmission constrained area and the total revenue received by generation to meet the load in the transmission constrained area, net

<sup>7</sup> For additional information, see the *MMU Technical Reference for PJM Markets*, at "Marginal Losses," <[http://www.monitoringanalytics.com/reports/Technical\\_References/references.shtml](http://www.monitoringanalytics.com/reports/Technical_References/references.shtml)>.

<sup>8</sup> This is referred to as dispatching units out of economic merit order. Economic merit order is the order of all generator offers from lowest to highest cost. Congestion occurs when loadings on transmission facilities mean the next unit in merit order cannot be used and a higher cost unit must be used in its place.

of losses. Congestion equals the sum of day-ahead and balancing congestion.

Table 11-1 shows the monthly comparison of real-time constrained and unconstrained hours in 2023 and 2024. A constrained hour is any hour during which one or more facilities are congested. There were more real-time constrained hours in 2024 than in 2023.

**Table 11-1 Real-time constrained and unconstrained hours by month: 2023 through 2024**

	2023		2024		Difference	
	Constrained Hours	Unconstrained Hours	Constrained Hours	Unconstrained Hours	Constrained Hours	Unconstrained Hours
Jan	534	210	721	23	187	(187)
Feb	543	129	686	10	143	(119)
Mar	690	54	701	43	11	(11)
Apr	690	30	660	60	(30)	30
May	664	80	708	36	44	(44)
Jun	670	50	704	16	34	(34)
Jul	717	27	707	37	(10)	10
Aug	729	15	669	75	(60)	60
Sep	703	17	652	68	(51)	51
Oct	739	5	690	54	(49)	49
Nov	680	40	629	91	(51)	51
Dec	730	14	741	3	11	(11)
Total	8,089	671	8,268	516	179	(155)

## Congestion

### Congestion Accounting

In PJM accounting, total congestion costs equal net implicit CLMP charges, plus net explicit CLMP charges, plus net inadvertent CLMP charges. Implicit CLMP charges equal implicit withdrawal charges less implicit injection credits. Explicit CLMP charges are the net CLMP charges associated with the injection credits and withdrawal charges for point to point energy transactions. Inadvertent CLMP charges are not directly attributable to specific participants that are distributed on a load ratio basis. Each of these categories of congestion costs is comprised of day-ahead and balancing congestion costs.

While PJM accounting focuses on CLMPs, the individual CLMP values at any bus are irrelevant to the calculation of congestion, as CLMPs are just an artificial deconstruction of LMP based on a selected reference bus. Holding aside the marginal loss component of LMP, differences in the LMPs are caused by binding constraints in the least cost security constrained dispatch market solution, and total congestion is the net surplus revenue that remains after all sources and sinks are credited or charged their LMPs. Changing the components of LMP by electing a

different reference bus does not change the LMPs or the difference between LMPs for a given market solution or actual congestion, it merely changes the components of the LMP.

Congestion occurs in the day-ahead and real-time energy markets.<sup>9</sup> Day-ahead congestion costs are based on day-ahead MWh while balancing congestion costs are based on deviations between day-ahead and real-time MWh priced at the congestion price in the real-time energy market.

Implicit CLMP charges are the CLMP charges calculated for energy injected or withdrawn at a location. The explicit CLMP charges are the CLMP charges calculated for transactions with a defined source and a sink. For example, implicit CLMP charges are calculated for network load and explicit CLMP charges are calculated for up to congestion transactions (UTCs). Inadvertent

CLMP charges are CLMP charges resulting from the differences between the net actual energy flow and the net scheduled energy flow into or out of the PJM control area each hour.

CLMP charges and CLMP credits are calculated for both the day-ahead and balancing energy markets.

- **Day-Ahead Implicit Load CLMP Charges.** Day-ahead implicit withdrawal charges are calculated for all cleared demand, decrement bids and day-ahead energy market sale transactions. Day-ahead implicit withdrawal charges are calculated using MW and the load bus CLMP, the decrement bid bus CLMP or the CLMP at the source of the sale transaction.
- **Day-Ahead Implicit Generation CLMP Credits.** Day-ahead implicit injection credits are calculated for all cleared generation, increment offers and day-ahead energy market purchase transactions.<sup>10</sup> Day-ahead

<sup>9</sup> When the term *congestion charge* is used in documents by PJM's Market Settlement Operations, it has the same meaning as the term *congestion costs* as used here.

<sup>10</sup> Internal bilateral transactions are included in the tariff definitions of Market Participant Energy Injections and Market Participant Energy Withdrawals. The purchase part of an internal bilateral transaction is an injection to the buyer and the sale part of an internal bilateral transaction is a withdrawal to the seller. The tariff (Attachment K) also says market participants will be charged implicit CLMP charges for all Market Participant Energy Withdrawals and will be credited implicit CLMP credits for all Market Participant Energy Injections. The seller of an internal bilateral transaction will be charged implicit CLMP charges at the source and the buyer of an internal bilateral transaction will be credited implicit CLMP credits at the sink. Internal bilateral transaction CLMP credits and charges sum to zero, as the IBT is merely a transfer of ownership injection and withdrawal MW and associated charges and credits between participants, meaning that the sum of all MW and all credits and all charges with and without IBTs are the same.

implicit injection credits are calculated using MW and the generator bus CLMP, the increment offer's bus CLMP or the CLMP at the sink of the purchase transaction.

- **Balancing Implicit Load CLMP Charges.** Balancing implicit withdrawal charges are calculated for all deviations between a PJM member's real-time load and energy sale transactions and their day-ahead cleared demand, decrement bids and energy sale transactions. Balancing implicit withdrawal charges are calculated using MW deviations and the real-time CLMP for each aggregate where a deviation exists.
- **Balancing Implicit Generation CLMP Credits.** Balancing implicit injection credits are calculated for all deviations between a PJM member's real-time generation and energy purchase transactions and the day-ahead cleared generation, increment offers and energy purchase transactions. Balancing implicit injection credits are calculated using MW deviations and the real-time CLMP for each aggregate where a deviation exists.
- **Explicit CLMP Charges.** Explicit CLMP charges are the net CLMP costs associated with point to point energy transactions. Day-ahead explicit CLMP charges equal the product of the transacted MW and CLMP differences between sources (origins) and sinks (destinations) in the day-ahead energy market. Balancing explicit CLMP charges equal the product of the deviations between the real-time and day-ahead transacted MW and the differences between the real-time CLMP at the transactions' sources and sinks. Explicit CLMP charges are calculated for internal purchase, import and export transaction, and up to congestion transactions (UTCs.)
- **Inadvertent CLMP Charges.** Inadvertent CLMP charges are charges resulting from the differences between the net actual energy flow and the net scheduled energy flow into or out of the PJM control area each hour. This inadvertent interchange of energy may be positive or negative, where positive interchange typically results in a charge while negative interchange typically results in a credit. Inadvertent CLMP charges are common costs, not directly attributable to specific participants that are distributed on a load ratio basis.<sup>11</sup>

The congestion accounting calculation equations are in Table 11-2.

**Table 11-2 Congestion accounting calculations**

Congestion Category	Calculation
Day-Ahead Implicit Withdrawal CLMP Charges	Day-Ahead Demand MWh * Day-Ahead CLMP
Day-Ahead Implicit Injection CLMP Credits	Day-Ahead Supply MWh * Day-Ahead CLMP
Day-Ahead Explicit CLMP Charges	Day-Ahead Transaction MW * (Day-Ahead Sink CLMP - Day-Ahead Source CLMP)
Day-Ahead Total Congestion Costs	Day-Ahead Implicit Withdrawal CLMP Charges - Day-Ahead Implicit Injection CLMP Credits + Day-Ahead Explicit CLMP Charges
Balancing Implicit Withdrawal CLMP Charges	Balancing Demand MWh * Real-Time CLMP
Balancing Implicit Injection CLMP Credits	Balancing Supply MWh * Real-Time CLMP
Balancing Explicit CLMP Costs	Balancing Transaction MW * (Real-Time Sink CLMP - Real-Time Source CLMP)
Balancing Total Congestion Costs	Balancing Implicit Withdrawal CLMP Charges - Balancing Implicit Injection CLMP Credits + Balancing Explicit CLMP Costs
Total Congestion Costs	Day-Ahead Total Congestion Costs + Balancing Total Congestion Costs
MWh Category	Definition
Day-Ahead Demand MWh	Cleared Demand, Decrement Bids, Energy Sale Transactions
Day-Ahead Supply MWh	Cleared Generation, Increment Bids, Energy Purchase Transactions
Real-Time Demand MWh	Load and Energy Sale Transactions
Real-Time Supply MWh	Generation and Energy Purchase Transactions
Balancing Demand MWh	Real-Time Demand MWh - Day-Ahead Demand MWh
Balancing Supply MWh	Real-Time Supply MWh - Day-Ahead Supply MWh

PJM billing items include Day-Ahead Transmission Congestion Charges, Day-Ahead Transmission Congestion Credits, Balancing Transmission Congestion Charges, and Balancing Transmission Congestion Credits. Those line items are calculated for each PJM member. The congestion bill shows the CLMP charges or credits collected from the PJM market participants. However, the sum of an individual customer's CLMP credits or charges on the customer's bill is not a measure of the congestion paid by that customer.

<sup>11</sup> PJM Operating Agreement Schedule 1 §3.7.



The congestion paid by a customer is the difference between what the customer paid for energy and what all network sources of that energy were paid to serve that customer. A load customer's congestion bill, in contrast, merely indicates whether the LMP they paid for their withdrawals is higher or lower than the system energy price due to transmission constraints. The customer's bill does not measure congestion paid by the customer, only how much the customer was charged and credited for their MW positions. The congestion costs associated with specific constraints are the sum of the total day-ahead and balancing congestion costs associated with those constraints. Zonal congestion is calculated on a constraint by constraint basis. The congestion calculations are the total difference between what the zonal load pays in CLMP charges and what the generation that serves that load is paid, regardless of whether the zone is a net importer or a net exporter of generation. CLMPs can be both positive and negative and CLMP charges and CLMP credits can be both positive and negative. CLMP charges, positive or negative, are paid by withdrawals and CLMP credits, positive or negative, are paid to injections. Total congestion costs (the sum of charges and credits), when positive, measure the net congestion payment by a participant group and when negative, measure the net congestion credit paid to a participant group. Explicit CLMP charges, when positive, measure the CLMP payment from a PJM member and when negative, measure the CLMP credit paid to a PJM member. Explicit CLMP charges are calculated for up to congestion transactions (UTCs). In all cases, whether positive or negative, CLMP charges and credits merely indicate whether the LMP being paid by withdrawals or credited to injections is higher or lower than the system weighted average price due to binding transmission constraints.

The congestion accounting definitions are misleading. Load pays congestion. Congestion is the difference between what load pays for energy and what generation is paid for energy due to binding transmission constraints. Generation does not pay congestion. Some generation receives a price lower than SMP and some generation receives a price greater than SMP but that does not mean that generation is paying congestion. It means only that generation is being paid an LMP that is higher or lower than the system load-weighted average LMP.


The CLMP is calculated with respect to the LMP at the system reference bus, also called the system marginal price (SMP). When a transmission constraint occurs, the resulting CLMP is positive on one side of the constraint and negative on the other side of the constraint and the corresponding CLMP costs are positive or negative. For each transmission constraint, the CLMP reflects the cost of a constraint at a pricing node and is equal to the product of the constraint shadow price and the distribution factor from the constraint to the pricing node. The total CLMP at a pricing node is the sum of all constraint contributions to LMP and is equal to the difference between the actual LMP that results from transmission constraints, excluding losses, and the SMP. If an area experiences lower prices because of a constraint, the CLMP in that area is negative.<sup>12</sup>

Load-weighted LMP components are calculated relative to a load-weighted, average LMP. At the load-weighted reference bus, which represents the load center of the system, the LMP calculation is designed to include no congestion or loss components, but it may include congestion. The load-weighted average CLMP across all load buses, calculated relative to that reference bus, is equal to, or very close to, zero, with non-zero results caused by state estimator error and after the fact meter updates. The sum of load related CLMP charges is logically zero and the small reported differences are the result of accounting issues. A positive CLMP at a load bus indicates that the load at that bus has a total energy price higher than the average LMP, due to transmission constraints. A negative CLMP at a load bus indicates that the load at that bus has a total energy price lower than the average LMP, due to transmission constraints. The LMPs at the load buses are a function of marginal generation bus LMPs determined through the least cost security constrained economic dispatch which accounts for transmission constraints and marginal losses. Due to transmission constraints, the average generation weighted CLMP for generation resources is lower than the LMP at the load-weighted reference bus price. Calculated relative to the load reference bus which has a CLMP of zero, this means that the average of the generation bus CLMPs is negative. This means that total generation CLMP credits are negative. Figure 11-1 shows the weighted average CLMPs of generation and load in the day-ahead market. Figure

<sup>12</sup> For an example of the congestion accounting methods used in this section, see *MMU Technical Reference for PJM Markets*, at "FTRs and ARRs," <[http://www.monitoringanalytics.com/reports/Technical\\_References/docs/2010-som-pjm-technical-reference.pdf](http://www.monitoringanalytics.com/reports/Technical_References/docs/2010-som-pjm-technical-reference.pdf)>.

11-1 shows that from January 2022 to December 2024, day-ahead generation weighted CLMPs were generally negative and day-ahead, load weighted CLMPs were generally positive, indicating that load was charged a higher weighted average LMP for energy as a result of transmission constraints than the weighted average LMP generation was paid to provide that energy. This means that total CLMP load payments are higher than total CLMP generation credits. The difference in load payments and generation credits (load charges minus generation credits) is congestion (Table 11-5 and Table 11-6). This result is a product of the least cost, security constrained dispatch and the use of a load-weighted reference bus that is used for the determination of the components of LMP. More generally, in a least cost, security constrained market solution the weighted average LMP at load buses is higher than the weighted average price at generation buses.

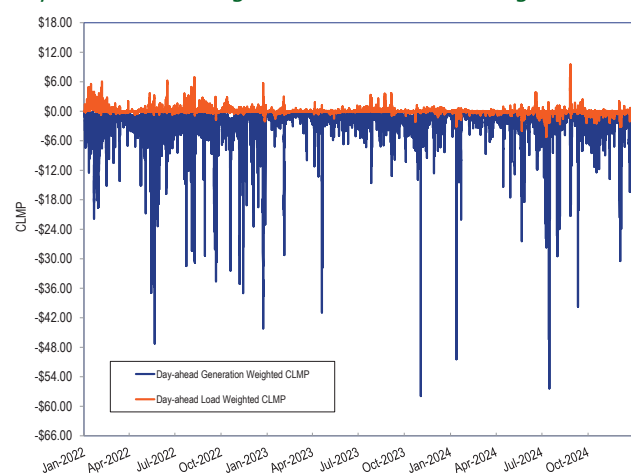**Figure 11-1 Day-ahead generation weighted CLMPs and day-ahead load-weighted CLMPs: 2022 through 2024**



## Total Congestion

Total congestion costs in PJM in 2024 were \$1,754.4 million, comprised of implicit withdrawal charges of \$603.5 million, minus implicit injection credits of -\$1,187.6 million, and plus explicit charges of -\$36.7 million. Total congestion is the difference between what load pays for energy and what generation is paid for energy, due to binding transmission constraints.

Table 11-3 shows total congestion for 2008 through 2024. Total congestion costs in Table 11-3 include congestion associated with PJM facilities and those

associated with reciprocal, coordinated flowgates in MISO and in NYISO.<sup>13 14</sup>

**Table 11-3 Total congestion costs (Dollars (Millions)): 2008 through 2024<sup>15</sup>**

	Congestion Cost	Percent Change	Total PJM Billing	Percent of PJM Billing
2008	\$2,052	NA	\$34,300	6.0%
2009	\$719	(65.0%)	\$26,550	2.7%
2010	\$1,423	98.0%	\$34,770	4.1%
2011	\$999	(29.8%)	\$35,890	2.8%
2012	\$529	(47.0%)	\$29,180	1.8%
2013	\$677	28.0%	\$33,860	2.0%
2014	\$1,932	185.5%	\$50,030	3.9%
2015	\$1,385	(28.3%)	\$42,630	3.2%
2016	\$1,024	(26.1%)	\$39,050	2.6%
2017	\$698	(31.9%)	\$40,170	1.7%
2018	\$1,310	87.8%	\$49,790	2.6%
2019	\$583	(55.5%)	\$41,690	1.4%
2020	\$529	(9.4%)	\$36,300	1.5%
2021	\$995	88.2%	\$54,100	1.8%
2022	\$2,501	151.3%	\$86,240	2.9%
2023	\$1,069	(57.3%)	\$48,500	2.2%
2024	\$1,754	64.2%	\$51,740	3.4%

CLMP charges and credits are not congestion. CLMP charges and credits reflect marginal energy price differences caused by binding system constraints. Congestion is the sum of all congestion related charges and credits. In a two settlement system all virtual bids have net zero MW after their day-ahead and balancing positions are cleared, which means that virtual bids are fully settled in terms of CLMP credits and charges at the close of the market for any particular day, with either a net loss or profit due to differences between day-ahead and real-time prices. Net payouts (negative credits) to virtual bids appear as negative adjustments to either day-ahead or balancing congestion and net charges to virtual bids appear as positive adjustments to either day-ahead or balancing congestion.

Table 11-4 shows total congestion by day-ahead and balancing component for 2008 through 2024.

<sup>13</sup> See "Joint Operating Agreement Between the Midwest Independent Transmission System Operator, Inc. and PJM Interconnection, LLC," (December 11, 2008) Section 6.1, Effective Date: May 30, 2016. <<http://www.pjm.com/documents/agreements.aspx>>.

<sup>14</sup> See "NYISO Tariffs New York Independent System Operator, Inc.," (June 21, 2017) 35.12.1, Effective Date: May 1, 2017. <<http://www.pjm.com/documents/agreements.aspx>>.

<sup>15</sup> In Table 11-10, the MMU used the total PJM billing values provided by PJM through 2018. Starting in 2019, the total PJM billing values in Table 11-10 are modified by the MMU, to more accurately reflect PJM total billing. The total PJM billing shown in Table 11-10 is different from the total cost shown in Table 1-9. The total PJM billing in Table 11-10 represents the total dollars that pass through the PJM settlement process, while the total cost shown in Table 1-9 represents the portion of the total billing associated with the cost to load and includes additional costs to load accounted for outside the PJM settlement process.

**Table 11-4 Total CLMP credits and charges by accounting category (Dollars (Millions)): 2008 through 2024**

	Day-Ahead				Balancing				
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Inadvertent Charges
2008	\$1,260.3	(\$1,133.1)	\$203.0	\$2,596.5	(\$225.9)	\$79.2	(\$239.5)	(\$544.6)	\$0.0
2009	\$292.3	(\$525.2)	\$83.9	\$901.4	(\$39.0)	\$10.1	(\$133.4)	(\$182.4)	\$0.0
2010	\$376.4	(\$1,239.8)	\$96.9	\$1,713.1	(\$37.5)	\$72.8	(\$179.5)	(\$289.8)	(\$0.0)
2011	\$400.5	(\$777.6)	\$66.9	\$1,245.0	\$53.5	\$109.5	(\$190.0)	(\$246.0)	\$0.0
2012	\$122.7	(\$525.3)	\$131.9	\$779.9	(\$7.6)	\$57.9	(\$185.4)	(\$250.9)	\$0.0
2013	\$281.2	(\$592.5)	\$137.6	\$1,011.3	\$5.9	\$131.3	(\$209.0)	(\$334.4)	\$0.0
2014	\$595.5	(\$1,671.2)	(\$35.4)	\$2,231.3	\$52.7	\$218.1	(\$133.6)	(\$299.1)	\$0.0
2015	\$614.2	(\$967.6)	\$50.3	\$1,632.1	\$0.6	\$69.8	(\$177.6)	(\$246.9)	\$0.0
2016	\$405.3	(\$654.1)	\$41.0	\$1,100.4	(\$4.5)	\$28.4	(\$43.9)	(\$76.8)	(\$0.0)
2017	\$187.6	(\$554.1)	(\$8.6)	\$733.1	\$22.2	\$47.2	(\$10.4)	(\$35.5)	\$0.0
2018	\$349.3	(\$1,048.6)	(\$18.9)	\$1,378.9	\$11.5	\$62.0	(\$18.5)	(\$69.0)	\$0.0
2019	\$246.0	(\$412.3)	\$55.7	\$714.0	\$3.7	\$51.1	(\$83.3)	(\$130.7)	\$0.0
2020	\$193.2	(\$401.7)	\$67.5	\$662.5	(\$14.7)	\$41.5	(\$77.6)	(\$133.8)	\$0.0
2021	\$411.9	(\$747.0)	\$67.3	\$1,226.2	(\$20.3)	\$110.0	(\$100.7)	(\$230.9)	\$0.0
2022	\$1,206.3	(\$1,672.1)	\$146.8	\$3,025.2	\$22.5	\$191.0	(\$355.4)	(\$523.9)	(\$0.0)
2023	\$590.0	(\$627.4)	\$147.1	\$1,364.5	\$13.5	\$89.6	(\$219.9)	(\$295.9)	\$0.0
2024	\$575.2	(\$1,337.9)	\$145.4	\$2,058.6	\$28.3	\$150.4	(\$182.1)	(\$304.2)	\$0.0

## Charges and Credits versus Congestion: Virtual Transactions, Load and Generation

In PJM's two settlement system, there is a day-ahead market and a real-time, balancing market that make up a market day.

In a two settlement system all virtual bids have net zero MW after their day-ahead and balancing positions are cleared, which means that virtual bids are fully settled in terms of CLMP credits and charges at the close of each market day, with either a net loss or profit due to differences between day-ahead and real-time prices. Net payouts (negative credits) to virtual bids appear as negative adjustments to either day-ahead or balancing congestion and net charges to virtual bids appear as positive adjustments to either day-ahead or balancing congestion.

Unlike virtual bids, physical load and generation have net MW at the close of a market day's day-ahead and balancing settlement.

Generation does not pay congestion. Some generation receives a price lower than SMP and some generation receives a price greater than SMP but that does not mean that generation is paying congestion. It means that generation is being paid an LMP that is higher or lower than the system load-weighted average LMP.

The residual difference between total load charges (day-ahead and balancing) and generation credits (day-ahead and balancing) after virtual bids have settled their day-ahead and balancing positions is congestion. That is, congestion is the difference between what withdrawals (load) pay for energy and what injections (generation) are paid for energy due to binding transmission constraints, after virtual bids are settled at the end of the market day. Load is the source of the net surplus after generation is paid and virtuals are settled at the end of the market day. Load pays congestion.

Table 11-5 and Table 11-6 show the total CLMP charges and credits for each transaction type in 2024 and 2023. Table 11-5 shows that in 2024 DECs were paid \$30.5 million in CLMP charges in the day-ahead market, were paid \$9.0 million in CLMP credits in the balancing energy market, resulting in a net payment of \$21.5 million. In 2024, INCs paid \$103.9 million in CLMP charges in the day-ahead market, were paid \$173.2 million in CLMP credits in the balancing energy market resulting in a net payment of \$69.3 million. In 2024, up to congestion (UTCs) paid \$144.5 million in CLMP charges in the day-ahead market, were paid \$178.6 million in CLMP credits in the balancing market resulting in a total payment of \$34.1 million in total CLMP credits.

Table 11-5 Total CLMP credits and charges by transaction type (Dollars (Millions)): 2024

Transaction Type	CLMP Credits and Charges (Millions)									
	Day-Ahead				Balancing					
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Inadvertent Charges	Grand Total
DEC	(\$30.5)	\$0.0	\$0.0	(\$30.5)	\$9.0	\$0.0	\$0.0	\$9.0	\$0.0	(\$21.5)
Demand	\$74.3	\$0.0	\$0.0	\$74.3	\$54.6	\$0.0	\$0.0	\$54.6	\$0.0	\$128.9
Demand Response	\$0.0	\$0.0	\$0.0	\$0.0	\$0.3	\$0.0	\$0.0	\$0.3	\$0.0	\$0.3
Explicit Congestion Only	\$0.0	\$0.0	\$0.2	\$0.2	\$0.0	\$0.0	(\$0.2)	(\$0.2)	\$0.0	(\$0.1)
Explicit Congestion and Loss Only	\$0.0	\$0.0	(\$0.6)	(\$0.6)	\$0.0	\$0.0	\$0.1	\$0.1	\$0.0	(\$0.5)
Export	(\$48.8)	\$0.0	(\$0.6)	(\$49.4)	(\$20.8)	\$0.0	(\$1.5)	(\$22.3)	\$0.0	(\$71.7)
Generation	\$0.0	(\$1,812.8)	\$0.0	\$1,812.8	\$0.0	\$6.1	\$0.0	(\$6.1)	\$0.0	\$1,806.7
Import	\$0.0	(\$3.9)	\$0.0	\$3.9	\$0.0	(\$14.1)	\$0.0	\$14.2	\$0.0	\$18.0
INC	\$0.0	(\$103.9)	\$0.0	\$103.9	\$0.0	\$173.2	\$0.0	(\$173.2)	\$0.0	(\$69.3)
Internal Bilateral	\$580.6	\$582.9	\$2.4	(\$0.0)	(\$12.8)	(\$12.8)	\$0.0	(\$0.0)	\$0.0	(\$0.0)
Up to Congestion	\$0.0	\$0.0	\$144.5	\$144.5	\$0.0	\$0.0	(\$178.6)	(\$178.6)	\$0.0	(\$34.1)
Wheel In	\$0.0	(\$0.4)	(\$0.4)	(\$0.0)	\$0.0	(\$1.9)	(\$1.9)	\$0.0	\$0.0	(\$0.0)
Wheel Out	(\$0.4)	\$0.0	\$0.0	(\$0.4)	(\$1.9)	\$0.0	\$0.0	(\$1.9)	\$0.0	(\$2.3)
Total	\$575.2	(\$1,337.9)	\$145.4	\$2,058.6	\$28.3	\$150.4	(\$182.1)	(\$304.2)	\$0.0	\$1,754.4

Table 11-6 Total CLMP credits and charges by transaction type (Dollars (Millions)): 2023

Transaction Type	CLMP Credits and Charges (Millions)									
	Day-Ahead				Balancing					
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Inadvertent Charges	Grand Total
DEC	\$20.1	\$0.0	\$0.0	\$20.1	(\$27.9)	\$0.0	\$0.0	(\$27.9)	\$0.0	(\$7.8)
Demand	\$54.8	\$0.0	\$0.0	\$54.8	\$62.2	\$0.0	\$0.0	\$62.2	\$0.0	\$117.1
Demand Response	(\$0.2)	\$0.0	\$0.0	(\$0.2)	\$0.2	\$0.0	\$0.0	\$0.2	\$0.0	(\$0.1)
Explicit Congestion Only	\$0.0	\$0.0	\$1.4	\$1.4	\$0.0	\$0.0	(\$0.3)	(\$0.3)	\$0.0	\$1.2
Explicit Congestion and Loss Only	\$0.0	\$0.0	(\$0.6)	(\$0.6)	\$0.0	\$0.0	(\$0.1)	(\$0.1)	\$0.0	(\$0.7)
Export	(\$71.9)	\$0.0	(\$0.5)	(\$72.4)	(\$15.4)	\$0.0	(\$1.6)	(\$17.0)	\$0.0	(\$89.4)
Generation	\$0.0	(\$1,176.2)	\$0.0	\$1,176.2	\$0.0	\$22.8	\$0.0	(\$22.8)	\$0.0	\$1,153.4
Import	\$0.0	(\$0.4)	\$0.0	\$0.4	\$0.0	(\$1.2)	\$0.0	\$1.2	\$0.0	\$1.6
INC	\$0.0	(\$40.2)	\$0.0	\$40.2	\$0.0	\$73.6	\$0.0	(\$73.6)	\$0.0	(\$33.4)
Internal Bilateral	\$587.3	\$589.5	\$2.2	\$0.0	(\$4.6)	(\$4.6)	\$0.0	(\$0.0)	\$0.0	(\$0.0)
Up to Congestion	\$0.0	\$0.0	\$144.9	\$144.9	\$0.0	\$0.0	(\$215.9)	(\$215.9)	\$0.0	(\$71.0)
Wheel In	\$0.0	(\$0.2)	(\$0.2)	(\$0.1)	\$0.0	(\$0.9)	(\$2.0)	(\$1.1)	\$0.0	(\$1.2)
Wheel Out	(\$0.2)	\$0.0	\$0.0	(\$0.2)	(\$0.9)	\$0.0	\$0.0	(\$0.9)	\$0.0	(\$1.1)
Total	\$590.0	(\$627.4)	\$147.1	\$1,364.5	\$13.5	\$89.6	(\$219.9)	(\$295.9)	\$0.0	\$1,068.6

Table 11-7 shows the change in total CLMP credits and charges by transaction type in 2023 and 2024. Total negative CLMP credits to generation increased by \$653.3 million, and total CLMP charges to demand increased by \$11.8 million. The total CLMP credits to up to congestion transactions (UTCs) increased by \$36.9 million in 2024. Total day-ahead CLMP charges to UTCs decreased by \$0.4 million in 2024. Balancing CLMP credits to UTCs increased by \$37.3 million in 2024.

Table 11-7 Change in total CLMP credits and charges by transaction type (Dollars (Millions)): 2023 to 2024

Transaction Type	Change in CLMP Credits and Charges (Millions)									
	Day-Ahead				Balancing					
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Inadvertent Charges	Grand Total
DEC	(\$50.6)	\$0.0	\$0.0	(\$50.6)	\$36.9	\$0.0	\$0.0	\$36.9	\$0.0	(\$13.7)
Demand	\$19.5	\$0.0	\$0.0	\$19.5	(\$7.7)	\$0.0	\$0.0	(\$7.7)	\$0.0	\$11.8
Demand Response	\$0.2	\$0.0	\$0.0	\$0.2	\$0.1	\$0.0	\$0.0	\$0.1	\$0.0	\$0.3
Explicit Congestion Only	\$0.0	\$0.0	(\$1.3)	(\$1.3)	\$0.0	\$0.0	\$0.1	\$0.1	\$0.0	(\$1.2)
Explicit Congestion and Loss Only	\$0.0	\$0.0	\$0.1	\$0.1	\$0.0	\$0.0	\$0.1	\$0.1	\$0.0	\$0.2
Export	\$23.1	\$0.0	(\$0.1)	\$23.0	(\$5.3)	\$0.0	\$0.0	(\$5.3)	\$0.0	\$17.7
Generation	\$0.0	(\$636.6)	\$0.0	\$636.6	\$0.0	(\$16.7)	\$0.0	\$16.7	\$0.0	\$653.3
Import	\$0.0	(\$3.5)	\$0.0	\$3.5	\$0.0	(\$12.9)	\$0.0	\$12.9	\$0.0	\$16.4
INC	\$0.0	(\$63.7)	\$0.0	\$63.7	\$0.0	\$99.6	\$0.0	(\$99.6)	\$0.0	(\$35.9)
Internal Bilateral	(\$6.8)	(\$6.6)	\$0.2	(\$0.0)	(\$8.2)	(\$8.2)	\$0.0	(\$0.0)	\$0.0	(\$0.0)
Up to Congestion	\$0.0	\$0.0	(\$0.4)	(\$0.4)	\$0.0	\$0.0	\$37.3	\$37.3	\$0.0	\$36.9
Wheel In	\$0.0	(\$0.2)	(\$0.2)	\$0.0	\$0.0	(\$1.0)	\$0.2	\$1.1	\$0.0	\$1.2
Wheel Out	(\$0.2)	\$0.0	\$0.0	(\$0.2)	(\$1.0)	\$0.0	\$0.0	(\$1.0)	\$0.0	(\$1.2)
Total	(\$14.8)	(\$710.5)	(\$1.7)	\$694.1	\$14.8	\$60.8	\$37.7	(\$8.3)	\$0.0	\$685.8

Table 11-8 compares CLMP credits and charges for each transaction type between the dispatch run and pricing run in 2024. Total CLMP charges to generation decreased by \$79.7 million, and total CLMP charges to demand increased by \$1.3 million from the dispatch run to the pricing run. The total CLMP credits to DECs increased by \$0.0 million, the total CLMP credits to INCs decreased by \$3.1 million and the total CLMP credits to UTCs decreased by \$9.2 million from the dispatch run to the pricing run.

Table 11-8 Total CLMP credits and charges by dispatch run and pricing run (Dollars (Millions)): 2024

Transaction Type	CLMP Credits and Charges (Millions)								
	Dispatch Run			Pricing Run			Difference		
	Day-Ahead	Balancing	Total	Day-Ahead	Balancing	Total	Day-Ahead	Balancing	Total
DEC	(\$32.7)	\$11.2	(\$21.6)	(\$30.5)	\$9.0	(\$21.5)	\$2.2	(\$2.2)	\$0.0
Demand	\$77.2	\$50.4	\$127.6	\$74.3	\$54.6	\$128.9	(\$2.9)	\$4.2	\$1.3
Demand Response	\$0.0	\$0.3	\$0.3	\$0.0	\$0.3	\$0.3	\$0.0	(\$0.0)	\$0.0
Explicit Congestion Only	\$0.2	(\$0.2)	(\$0.0)	\$0.2	(\$0.2)	(\$0.1)	(\$0.0)	\$0.0	(\$0.0)
Explicit Congestion and Loss Only	(\$0.6)	\$0.1	(\$0.5)	(\$0.6)	\$0.1	(\$0.5)	\$0.0	\$0.0	\$0.0
Export	(\$49.3)	(\$19.8)	(\$69.0)	(\$49.4)	(\$22.3)	(\$71.7)	(\$0.1)	(\$2.6)	(\$2.6)
Generation	\$1,890.2	(\$3.8)	\$1,886.4	\$1,812.8	(\$6.1)	\$1,806.7	(\$77.4)	(\$2.3)	(\$79.7)
Import	\$3.9	\$14.2	\$18.0	\$3.9	\$14.2	\$18.0	(\$0.0)	(\$0.0)	(\$0.0)
INC	\$103.3	(\$169.5)	(\$66.2)	\$103.9	(\$173.2)	(\$69.3)	\$0.6	(\$3.7)	(\$3.1)
Internal Bilateral	\$0.0	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$0.0	\$0.0
Up to Congestion	\$143.7	(\$168.6)	(\$24.9)	\$144.5	(\$178.6)	(\$34.1)	\$0.8	(\$10.0)	(\$9.2)
Wheel In	(\$0.0)	\$0.2	\$0.1	(\$0.0)	\$0.0	(\$0.0)	(\$0.0)	(\$0.1)	(\$0.1)
Wheel Out	(\$0.4)	(\$1.9)	(\$2.2)	(\$0.4)	(\$1.9)	(\$2.3)	\$0.0	(\$0.0)	(\$0.0)
Total	\$2,135.3	(\$287.5)	\$1,847.8	\$2,058.6	(\$304.2)	\$1,754.4	(\$76.7)	(\$16.7)	(\$93.4)

## UTCs and Negative Balancing Explicit CLMP Charges

Figure 11-2 shows the change in up to congestion balancing explicit CLMP charges from 2014 through 2024. Figure 11-2 shows that UTCs account for almost all balancing explicit CLMP charges in PJM. As shown in Figure 11-2, UTCs are generally paid balancing CLMP credits, which take the form of negative balancing CLMP charges being allocated to UTC positions. In 2024, 98.1 percent (-\$178.6 million out of -\$182.1 million) of negative balancing explicit CLMP charges was incurred by UTCs and 1.9 percent (-\$3.5 out of -\$182.1 million) was incurred by Explicit Congestion Only, Export, Import and Wheel In transactions (Table 11-5). The vertical line at February 22, 2018, marks the date on which the FERC order that limited UTC trading to hubs, residual metered load, and interfaces was effective.<sup>16</sup> The vertical line at November 1, 2020, marks the date on which the FERC order that required PJM to allocate uplift to up to congestion transactions was effective.<sup>17</sup>


<sup>16</sup> For additional information about the FERC order, see the 2024 Annual State of the Market Report for PJM, Appendix F: Congestion and Marginal Losses.

<sup>17</sup> 172 FERC ¶ 61,046 (2020).



Negative balancing explicit CLMP charges were substantially higher in December 2022 than in other months as a result of transmission constraint penalty factors in the real-time market in 2022. The total negative balancing explicit CLMP charges on December 7 and 8, 2022, and the Winter Storm Elliott days of December 23 through 26, 2022, were 64.1 percent (-\$62.3 million out of -\$97.2 million) of total negative balancing explicit CLMP charges in December 2022.

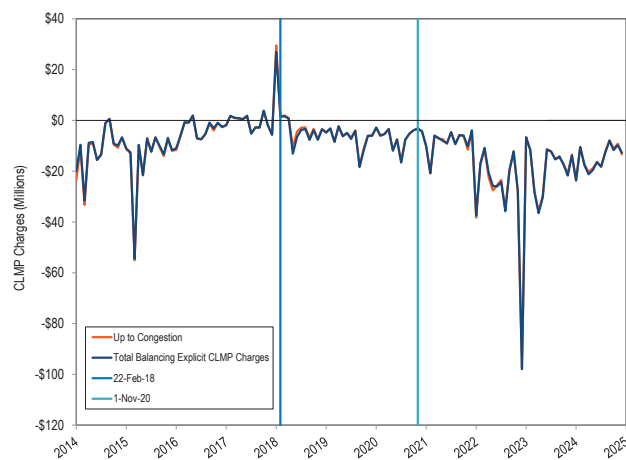**Figure 11-2 Monthly balancing explicit CLMP charges incurred by UTCs: 2014 through 2024**



Balancing congestion is caused by settling real-time deviations from day-ahead positions at real-time prices. Whether balancing congestion is positive or negative depends on the differences between market solutions (changes in load and/or generation) and differences between the day-ahead and real-time market models including modeled constraints, the transfer capability (line limits) of the modeled constraints and the differences in deviations between day-ahead and real-time flows that result. The deviations are priced at the real-time LMPs.

For example, one source of negative balancing congestion is that the PJM system has less transmission transfer capability in the real-time market than is modeled in the day-ahead market. In order to reduce processing time in the presence of large number of virtual bids and offers, PJM only enforces or models a subset of its physical transmission limits in the day-ahead market. Transmission constraints not modeled in the day-ahead market have unlimited transfer capability in the day-ahead market model. The inclusion of the actual, lower

transmission capability in the real-time market requires the use of more high cost generation and the use of less low cost generation to serve load, which means a decrease in congestion.<sup>18</sup> The reduction in real-time congestion compared to day-ahead congestion creates negative balancing congestion.

As a day-ahead spread bid, UTCs can take advantage of and profit from LMP differences caused by modeling differences between the day-ahead and real-time market. UTCs clear between source and sink points with little or no price difference in the day-ahead market, and settle the resulting deviations at higher real-time price differences in the real-time market. The result is negative balancing congestion caused by and paid to UTCs in the form of CLMP credits. This is an example of false arbitrage because the UTCs cannot cause prices to converge and the profits to decrease. As a result of the FERC order requiring load to pay balancing congestion, load is responsible for paying the balancing congestion caused by UTCs.<sup>19</sup>

Table 11-9 provides an example of how UTCs can profit from differences in day-ahead and real-time models and generate negative balancing congestion. In the example, Bus A and Bus B are linked by a transmission line. In the day-ahead market the transmission limit is modeled as 9,999 MW (no limit is enforced in the day-ahead market solution). In the real-time market the physical limit between bus A and bus B is 50 MW. Generation at A has a price of \$1.00 and Generation at B has a price of \$6. There is 100 MW of load at bus A and 100 MW of load at bus B. There is a UTC of 200 MW that will source at bus A and sink at bus B if the spread in the prices between A and B is less than \$1.

As a result of the fact that the transmission capability between A and B is unlimited in the day-ahead market, all of load at A and B can be met with the \$1 generation at bus A. The constraint between A and B does not bind in day-ahead so the price at A and B is \$1. The price spread between bus A and bus B is zero, which is less than the UTC spread requirement of \$1, so the UTC clears. The UTC causes a 200 MW injection at A and 200 MW withdrawal at B, creating 200 MW of flow between bus A and bus B. The 300 MW of combined flow from

<sup>18</sup> Although it seems counter intuitive, as the amount of low cost generation decreases and the amount of high cost generation increases, the difference between load payments to generation and the payments received by generators goes down. High cost generation receives what load pays.

<sup>19</sup> On September 15, 2016, FERC ordered PJM to allocate balancing congestion to load, rather than to FTRs, to modify PJM's Stage 1A ARR allocation process and to continue to use portfolio netting. 153 FERC ¶ 61,180 (2016).

generation at A and UTC injections at A to the load and UTC sink at B does not exceed the DA modeled limit between A and B. This means that all 200 MW of the UTC injection at A and 200 MW of withdrawal at B can clear without forcing a price spread between A and B. Total day-ahead congestion, which is the difference between CLMP charges and credits, is zero. There is no price difference between the two nodes and every MW of injection and every MW of withdrawal at bus A and bus B settles at the same price.

In the real-time market, the transmission line between bus A and bus B has a 50 MW limit. The UTC does not physically exist in the real-time market and therefore has deviations at Bus A (-200 MW) and at Bus B (+200 MW). The UTC must buy at bus A at the real-time price and sell at bus B at the real-time price to settle its deviations. The load at A (100 MW) and B (100 MW) does not change, so there are no load deviations. With only 50 MW of transmission capability between A and B, the generation at A cannot be used to meet total load on the system. Generation from A meets the load at A (100 MW) and can supply only 50 MW of the 100 MW of load at B. Due to the binding constraint between A and B, the remaining 50 MW of load at B must be met with local generation at B at a cost of \$6 and the price at A remains \$1.

The UTC must buy 200 MW at A at the real-time price of \$1 and sell 200 MW at B at the real-time price of \$6. The UTC pays \$200 at A and is paid \$1,200 at B. The result is a net payment to the UTC of \$1,000 in balancing credits.

Table 11-9 shows the balancing credits and charges associated with the real-time deviations in the example. Total congestion (day-ahead plus balancing congestion) in this example is negative \$1,250. Total CLMP credits (payments) to generation and the UTC exceed the total charges collected from load. The negative balancing congestion that results is paid by the load under the FERC order.<sup>20</sup>

The UTC did not and could not contribute to price convergence between the day-ahead and real-time market and did not and could not improve efficiency in system dispatch or commitment. The UTC took advantage of the modeling differences between the day-ahead and real-time markets. The UTC did significantly increase payments by load. Load was required to pay the UTC \$1,000 in negative balancing, over and above the costs of generation that was needed to meet real-time load. The differences in modeling would have resulted in only \$250 in negative balancing congestion if there had been no UTCs.

**Table 11-9 Example of UTC causing and profiting from negative balancing congestion**

Prices	Bus A	Transfer Capability (Line Limit MW)	Bus B	
LMP DA	\$1.00	9,999	\$1.00	
LMP RT	\$1.00	50	\$6.00	
<b>Day-Ahead MW</b>	<b>Bus A</b>		<b>Bus B</b>	<b>Total MW</b>
Day-Ahead Generation	200		0	200
Day-Ahead Load	(100)		(100)	(200)
Day-Ahead UTC (+/-)	200		(200)	0
Total MW	300		(300)	0
<b>Day-Ahead Credits and Charges</b>	<b>Bus A</b>		<b>Bus B</b>	<b>Total Day-Ahead Congestion</b>
Total DA Gen Credits	\$200.00		\$0.00	
Total DA Load Charges	\$100.00		\$100.00	
Total DA UTC Credits	\$200.00		(\$200.00)	
Total DA Credits	\$300.00		(\$300.00)	\$0.00
Total Day-Ahead Congestion (Charges - Credits)				\$0.00
<b>Balancing Deviation MW</b>	<b>Bus A</b>		<b>Bus B</b>	<b>Total Deviations</b>
RT GEN Deviations	(50)		50	
RT Load Deviations	0		0	
DA UTC (+/-)	(200)		200	
Total Deviations	(250)		250	0
<b>Balancing Credits and Charges</b>	<b>Bus A</b>		<b>Bus B</b>	<b>Balancing Congestion Credits</b>
Total BA Gen Credits	(\$50.00)		\$300.00	\$250.00
Total BA Load Charges	\$0.00		\$0.00	
Total BA UTC Credits	(\$200.00)		\$1,200.00	\$1,000.00
Total BA Credits	(\$250.00)		\$1,500.00	\$1,250.00
Total Balancing Congestion (Charges - Credits)				(\$1,250.00)

<sup>20</sup> 153 FERC ¶ 61,180 (2016).

## Zonal and Load Aggregate Congestion

Zonal, and load aggregate, congestion is calculated on a constraint specific basis for a specific location or set of load pricing nodes (a zone or an aggregate). Local congestion is the difference between what load pays for energy and what generation is paid for energy due to individual binding transmission constraints. Local congestion includes all energy charges or credits incurred to serve a specific load, zone or load aggregate. Local congestion calculations account for the total difference between what the specified load pays and what the generation that serves that load is paid, regardless of whether the zone is a net importer or a net exporter of generation.

Local congestion is calculated on a constraint specific basis. Congestion is the total congestion payments by load at the buses within a defined area minus total CLMP credits received by generation that supplied that load, given the transmission constraints. Congestion reflects the underlying characteristics of the entire power system as it affects the defined area, including the nature and capability of transmission facilities, the offers and geographic distribution of generation facilities, the level and geographic distribution of decremental bids and incremental offers and the geographic and temporal distribution of load.

On a system wide basis, congestion results from transmission constraints that prevent the lowest cost generation from serving some load that must be served by higher cost generation.

The total congestion caused by a constraint is equal to the product of the constraint shadow price times the net flow on the binding constraint. (The shadow price is the difference between the CLMPs across the constraint.) Total congestion caused by the constraint can also be calculated using the CLMPs caused by the constraint at every bus and the net MW injections or MW withdrawals at every affected bus. Congestion associated with a specific constraint is equal to load CLMP charges (CLMP of that specific constraint at each bus times load MW at each bus) caused by that constraint in excess of generation CLMP credits (CLMP of that specific constraint at each bus times generation MW at each bus) caused by that constraint. Equivalently, total congestion caused by the constraint can also be calculated by the shadow price of the constraint times the market flow on that constraint.

Congestion paid by zonal load is a function of the load share of the total load market flow on all binding constraints. Congestion is the difference between what load pays for energy due to binding transmission constraints and what generation, whether inside or outside the load's zone, is paid to serve that load. This calculation is done for both day-ahead congestion and balancing congestion.

Table 11-10 shows day-ahead and balancing congestion by zone and the proportion of congestion resulting from constraints that are external to or internal to each zone, in 2024. Constraints are internal to a zone if both the source and sink points of the constraint are in the zone. AEP had the largest zonal congestion costs among all control zones in 2024. AEP had \$286.6 million in zonal congestion costs, comprised of \$333.3 million in zonal day-ahead congestion costs and -\$46.7 million in zonal balancing congestion costs. The Nottingham Series Reactor, the Conastone – Northwest Line, the Lenox – North Meshoppen Line, the Yorkana Circuit Breaker, and the East Lima – Haviland Line contributed \$72.5 million, or 25.3 percent of the AEP zonal congestion costs.<sup>21</sup>

<sup>21</sup> For additional information about the top 20 constraints that affected each zone, see the 2024 Annual State of the Market Report for PJM, Appendix F: Congestion and Marginal Losses.

Table 11-11 shows congestion costs by zone in 2023.

**Table 11-10 CLMP credits and charges and total congestion revenue collected by zone (Dollars (Millions)): 2024**

CLMP Credits and Charges (Millions)											
Control Zone	Day-Ahead				Balancing				Congestion Costs		
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Internal to Zone	External to Zone	Grand Total
ACEC	\$5.0	(\$13.5)	\$1.4	\$19.9	\$0.2	\$1.7	(\$2.0)	(\$3.6)	\$0.5	\$15.8	\$16.3
AEP	\$78.0	(\$228.9)	\$26.5	\$333.3	\$5.1	\$23.1	(\$28.7)	(\$46.7)	\$47.8	\$238.8	\$286.6
APS	\$44.6	(\$90.1)	\$9.6	\$144.4	\$2.2	\$10.5	(\$12.9)	(\$21.2)	\$7.2	\$116.0	\$123.1
ATSI	\$39.1	(\$121.0)	\$13.6	\$173.7	\$2.6	\$11.9	(\$14.5)	(\$23.7)	\$8.4	\$141.7	\$150.0
BGE	\$26.3	(\$47.7)	\$4.8	\$78.8	\$1.9	\$6.2	(\$7.3)	(\$11.6)	\$8.5	\$58.7	\$67.2
COMED	\$53.0	(\$208.8)	\$16.9	\$278.7	\$4.8	\$16.6	(\$17.0)	(\$28.8)	\$91.6	\$158.4	\$250.0
DAY	\$7.5	(\$29.6)	\$3.5	\$40.6	\$0.7	\$3.1	(\$3.9)	(\$6.3)	\$0.0	\$34.3	\$34.3
DOM	\$100.2	(\$173.5)	\$19.7	\$293.4	\$5.8	\$23.8	(\$29.0)	(\$47.0)	\$66.0	\$180.4	\$246.4
DPL	\$46.8	(\$21.5)	\$3.7	\$72.0	(\$1.1)	\$2.8	(\$4.0)	(\$7.9)	\$37.9	\$26.3	\$64.2
DUKE	\$15.5	(\$37.8)	\$5.0	\$58.4	\$1.1	\$4.8	(\$5.9)	(\$9.5)	\$2.4	\$46.4	\$48.8
DUQ	\$7.3	(\$17.0)	\$1.9	\$26.2	\$0.6	\$2.4	(\$2.9)	(\$4.8)	\$0.6	\$20.8	\$21.4
EKPC	\$7.9	(\$22.6)	\$2.9	\$33.3	\$0.5	\$2.5	(\$3.2)	(\$5.2)	\$0.2	\$27.9	\$28.1
EXT	\$9.3	(\$25.4)	\$2.8	\$37.4	\$0.6	\$3.7	(\$5.1)	(\$8.3)	\$1.5	\$27.7	\$29.2
JCPLC	\$15.3	(\$36.9)	\$3.7	\$55.9	\$0.6	\$4.8	(\$5.8)	(\$10.0)	\$2.0	\$43.9	\$45.9
MEC	\$12.1	(\$21.3)	\$2.3	\$35.6	(\$1.6)	\$2.5	(\$3.2)	(\$7.4)	\$2.4	\$25.8	\$28.2
OVEC	\$0.5	(\$1.3)	\$1.2	\$3.0	\$0.0	\$0.2	(\$0.2)	(\$0.4)	\$1.1	\$1.6	\$2.6
PE	\$15.0	(\$26.8)	\$2.9	\$44.6	(\$0.0)	\$2.8	(\$3.6)	(\$6.5)	\$8.4	\$29.8	\$38.2
PECO	\$17.8	(\$54.1)	\$5.1	\$77.0	\$0.8	\$6.7	(\$8.2)	(\$14.1)	\$7.9	\$54.9	\$62.8
PEPCO	\$22.9	(\$39.2)	\$4.3	\$66.4	\$1.5	\$5.6	(\$6.7)	(\$10.7)	\$0.2	\$55.5	\$55.7
PPL	\$27.3	(\$60.1)	\$7.1	\$94.5	\$0.8	\$6.8	(\$8.6)	(\$14.6)	\$11.7	\$68.2	\$80.0
PSEG	\$22.8	(\$58.8)	\$6.0	\$87.6	\$1.0	\$7.4	(\$9.0)	(\$15.5)	\$0.4	\$71.7	\$72.1
REC	\$1.3	(\$1.9)	\$0.6	\$3.8	\$0.0	\$0.3	(\$0.3)	(\$0.5)	\$0.9	\$2.4	\$3.3
Total	\$575.2	(\$1,337.9)	\$145.4	\$2,058.6	\$28.3	\$150.4	(\$182.1)	(\$304.2)	\$307.6	\$1,446.8	\$1,754.4

**Table 11-11 CLMP credits and charges and total congestion revenue collected by zone (Dollars (Millions)): 2023**

CLMP Credits and Charges (Millions)											
Control Zone	Day-Ahead				Balancing				Congestion Costs		
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Internal to Zone	External to Zone	Grand Total
ACEC	\$5.1	(\$6.3)	\$1.3	\$12.6	(\$0.1)	\$0.8	(\$2.3)	(\$3.3)	\$0.4	\$9.0	\$9.4
AEP	\$83.0	(\$102.6)	\$25.9	\$211.5	\$3.0	\$13.9	(\$33.6)	(\$44.5)	\$18.6	\$148.4	\$167.0
APS	\$41.5	(\$38.3)	\$9.1	\$88.8	\$1.0	\$5.8	(\$14.3)	(\$19.0)	\$4.5	\$65.2	\$69.8
ATSI	\$41.0	(\$51.3)	\$12.2	\$104.5	\$1.6	\$7.2	(\$17.2)	(\$22.8)	\$4.0	\$77.7	\$81.7
BGE	\$22.8	(\$23.2)	\$5.3	\$51.3	\$1.2	\$3.8	(\$8.2)	(\$10.8)	\$7.1	\$33.4	\$40.5
COMED	\$76.2	(\$100.6)	\$16.8	\$193.6	\$3.5	\$11.3	(\$22.3)	(\$30.1)	\$58.5	\$105.0	\$163.5
DAY	\$9.3	(\$14.0)	\$3.4	\$26.7	\$0.5	\$1.9	(\$4.6)	(\$6.1)	\$0.0	\$20.6	\$20.6
DOM	\$97.0	(\$84.6)	\$24.4	\$205.9	\$3.5	\$15.7	(\$38.3)	(\$50.4)	\$25.8	\$129.7	\$155.5
DPL	\$38.8	(\$12.5)	\$3.5	\$54.8	(\$2.5)	\$0.5	(\$4.5)	(\$7.5)	\$33.3	\$14.0	\$47.3
DUKE	\$16.4	(\$20.2)	\$5.5	\$42.0	\$0.7	\$3.0	(\$7.1)	(\$9.3)	\$1.8	\$30.9	\$32.7
DUQ	\$8.4	(\$8.0)	\$1.9	\$18.2	\$0.3	\$1.4	(\$3.5)	(\$4.7)	\$0.8	\$12.8	\$13.6
EKPC	\$8.2	(\$10.8)	\$2.7	\$21.7	\$0.3	\$1.5	(\$3.6)	(\$4.8)	\$0.1	\$16.8	\$16.9
EXT	\$12.1	(\$10.2)	\$2.6	\$24.9	\$1.2	\$3.3	(\$7.7)	(\$9.8)	\$1.2	\$13.9	\$15.0
JCPLC	\$17.6	(\$18.1)	\$3.5	\$39.2	(\$0.2)	\$2.4	(\$6.7)	(\$9.2)	\$3.6	\$26.4	\$30.0
MEC	\$11.4	(\$11.3)	\$2.3	\$25.0	(\$0.5)	\$1.4	(\$4.0)	(\$5.9)	\$3.3	\$15.7	\$19.1
OVEC	\$0.8	(\$0.8)	\$0.8	\$2.3	\$0.0	\$0.1	(\$0.3)	(\$0.4)	\$0.6	\$1.4	\$1.9
PE	\$13.2	(\$12.6)	\$2.7	\$28.5	\$0.2	\$1.6	(\$4.3)	(\$5.7)	\$3.0	\$19.8	\$22.8
PECO	\$18.1	(\$26.2)	\$4.9	\$49.2	(\$0.4)	\$3.1	(\$9.3)	(\$12.8)	\$7.3	\$29.1	\$36.4
PEPCO	\$19.9	(\$20.1)	\$4.9	\$44.9	\$1.0	\$3.4	(\$7.5)	(\$9.9)	\$0.2	\$34.7	\$34.9
PPL	\$25.0	(\$28.7)	\$7.2	\$60.9	(\$0.6)	\$3.6	(\$10.1)	(\$14.2)	\$4.0	\$42.7	\$46.7
PSEG	\$22.9	(\$26.5)	\$5.5	\$54.8	(\$0.2)	\$3.7	(\$10.3)	(\$14.2)	\$0.9	\$39.8	\$40.6
REC	\$1.4	(\$0.8)	\$1.0	\$3.2	(\$0.0)	\$0.1	(\$0.4)	(\$0.5)	\$1.3	\$1.4	\$2.7
Total	\$590.0	(\$627.4)	\$147.1	\$1,364.5	\$13.5	\$89.6	(\$219.9)	(\$295.9)	\$180.3	\$888.3	\$1,068.6

In cases where PJM has used an artificial constraint that causes net negative congestion and/or there is no load bus on the constrained side of a binding constraint, the congestion of the artificial constraint is handled as a special case. In 2024, the total congestion costs associated with these special cases were \$11.0 million or 0.6 percent of the total congestion costs. Table 11-10 and Table 11-11 include congestion allocations from these special case artificial constraints.

There are five categories of artificial constraint based specific allocation special cases that can cause negative congestion: congestion associated with artificial constraints with no downstream load bus (no load bus); congestion associated with artificial constraints with downstream load buses with zero value CLMPs (zero CLMP); congestion associated with closed loop interfaces (closed loop interfaces); congestion associated with CT price setting logic (CT price setting logic); and congestion associated with nontransmission artificial facility constraints in the day-ahead energy market and/or any unaccounted for difference between PJM billed CLMP charges and calculated congestion costs including rounding errors (unclassified).<sup>22</sup>

Table 11-12 and Table 11-13 show total congestion by type of special case, congestion, and total congestion by zone. Closed loop interfaces and CT pricing logic, and similar artificial constraints employed by PJM to force resources to be marginal, generally result in negative congestion on a constraint specific basis. PJM's use of both the closed loop interfaces and CT Pricing Logic forces the affected resource bus LMP to match the marginal offer of the resource. This causes higher CLMP payments to the affected generation than the CLMP load charges to any affected load, resulting in negative congestion associated with the constraint. None of the closed loop interfaces were binding in 2023 or 2024. The congestion associated with Real-Time Short-Term Marginal Value Overrides is included in the Normal Constraint Congestion totals.

**Table 11-12 CLMP charges and credits and total congestion collected by zone and special case logic (Dollars (Millions)): 2024**

CLMP Credits and Charges (Millions)																		
Day-Ahead										Balancing								
Control Zone	Load Bus Zero CLMP	CT Price Setting Logic	Closed Loop Interfaces	No Load Buses	Unclassified	Normal Constraint Congestion	Total	Load Bus Zero CLMP	CT Price Setting Logic	Closed Loop Interfaces	No Load Buses	Unclassified	Normal Constraint Congestion	Total	Grand Total	Special Cases Total	Percent of Special Cases	
ACEC	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$19.9	\$19.9	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	(\$3.5)	(\$3.6)	\$16.3	(\$0.0)	(0.3%)	
AEP	\$0.0	(\$0.1)	\$0.0	\$1.3	\$0.0	\$332.0	\$333.3	\$0.0	(\$0.5)	\$0.0	\$0.0	\$0.0	(\$46.2)	(\$46.7)	\$286.6	\$0.8	0.3%	
APS	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$144.4	\$144.4	\$0.0	(\$0.2)	\$0.0	\$0.0	\$0.0	(\$21.0)	(\$21.2)	\$123.1	(\$0.2)	(0.2%)	
ATSI	\$0.0	(\$0.0)	\$0.0	\$1.2	\$0.0	\$172.6	\$173.7	\$0.0	(\$0.3)	\$0.0	\$0.0	\$0.0	(\$23.5)	(\$23.7)	\$150.0	\$0.9	0.6%	
BGE	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$78.8	\$78.8	\$0.0	(\$0.1)	\$0.0	\$0.0	\$0.0	(\$11.5)	(\$11.6)	\$67.2	(\$0.1)	(0.2%)	
COMED	\$0.9	(\$0.0)	\$0.0	\$4.2	\$0.0	\$273.7	\$278.7	\$0.0	(\$0.5)	\$0.0	\$0.0	\$0.0	(\$28.2)	(\$28.8)	\$250.0	\$4.5	1.8%	
DAY	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$40.6	\$40.6	\$0.0	(\$0.1)	\$0.0	\$0.0	\$0.0	(\$6.2)	(\$6.3)	\$34.3	(\$0.1)	(0.2%)	
DOM	\$0.0	(\$0.0)	\$0.0	\$0.4	\$0.0	\$293.1	\$293.4	\$0.0	(\$0.5)	\$0.0	\$0.0	\$0.0	(\$46.6)	(\$47.0)	\$246.4	(\$0.1)	(0.1%)	
DPL	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$72.0	\$72.0	\$0.0	(\$0.1)	\$0.0	\$0.0	\$0.0	(\$7.8)	(\$7.9)	\$64.2	(\$0.1)	(0.1%)	
DUKE	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$58.4	\$58.4	\$0.0	(\$0.1)	\$0.0	\$0.0	\$0.0	(\$9.4)	(\$9.5)	\$48.8	(\$0.1)	(0.2%)	
DUQ	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$26.2	\$26.2	\$0.0	(\$0.1)	\$0.0	\$0.0	\$0.0	(\$4.8)	(\$4.8)	\$21.4	(\$0.1)	(0.3%)	
EKPC	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$33.3	\$33.3	\$0.0	(\$0.1)	\$0.0	\$0.0	\$0.0	(\$5.2)	(\$5.2)	\$28.1	(\$0.1)	(0.2%)	
EXT	\$1.5	(\$0.0)	\$0.0	\$0.0	\$0.0	\$36.0	\$37.4	\$0.0	(\$0.2)	\$0.0	(\$0.0)	\$0.0	(\$8.1)	(\$8.3)	\$29.2	\$1.3	4.4%	
JCPCLC	\$2.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$53.8	\$55.9	\$0.0	(\$0.1)	\$0.0	\$0.0	\$0.0	(\$9.9)	(\$10.0)	\$45.9	\$1.9	4.2%	
MEC	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$35.6	\$35.6	\$0.0	(\$0.1)	\$0.0	\$0.0	\$0.0	(\$7.3)	(\$7.4)	\$28.2	(\$0.1)	(0.2%)	
OVEC	\$0.0	(\$0.0)	\$0.0	\$1.1	\$0.0	\$1.9	\$3.0	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	(\$0.4)	(\$0.4)	\$2.6	\$1.1	40.7%	
PE	\$0.0	(\$0.0)	\$0.0	\$0.3	\$0.0	\$44.4	\$44.6	\$0.0	(\$0.1)	\$0.0	\$0.0	\$0.0	(\$6.4)	(\$6.5)	\$38.2	\$0.2	0.5%	
PECO	\$0.0	(\$0.0)	\$0.0	\$0.1	\$0.0	\$76.9	\$77.0	\$0.0	(\$0.1)	\$0.0	\$0.0	\$0.0	(\$14.0)	(\$14.1)	\$62.8	(\$0.1)	(0.2%)	
PEPCO	\$0.0	(\$0.0)	\$0.0	\$0.1	\$0.0	\$66.4	\$66.4	\$0.0	(\$0.1)	\$0.0	\$0.0	\$0.0	(\$10.6)	(\$10.7)	\$55.7	(\$0.0)	(0.0%)	
PPL	\$0.1	(\$0.0)	\$0.0	\$1.5	\$0.0	\$92.9	\$94.5	\$0.0	(\$0.1)	\$0.0	\$0.0	\$0.0	(\$14.4)	(\$14.6)	\$80.0	\$1.5	1.8%	
PSEG	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$87.6	\$87.6	\$0.0	(\$0.2)	\$0.0	\$0.0	\$0.0	(\$15.3)	(\$15.5)	\$72.1	(\$0.2)	(0.2%)	
REC	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$3.8	\$3.8	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	(\$0.5)	(\$0.5)	\$3.3	(\$0.0)	(0.2%)	
Total	\$4.5	(\$0.3)	\$0.0	\$10.1	\$0.0	\$2,044.2	\$2,058.6	\$0.0	(\$3.4)	\$0.0	\$0.0	\$0.0	(\$300.8)	(\$304.2)	\$1,754.4	\$11.0	0.6%	

<sup>22</sup> While CT pricing logic was officially discontinued by PJM on September 1, 2021, PJM continued to use a related logic to force inflexible units to be on the margin in both real time and day ahead. These results have been included in the CT Pricing Logic totals.



Table 11-13 CLMP charges and credits and congestion collected by zone and special case logic (Dollars (Millions)): 2023

CLMP Credits and Charges (Millions)																		
Day-Ahead								Balancing										
Control Zone	Load Bus Zero CLMP	CT Price Setting Logic	Closed Loop Interfaces	No Load Buses	Unclassified	Normal Constraint Congestion	Total	Load Bus Zero CLMP	CT Price Setting Logic	Closed Loop Interfaces	No Load Buses	Unclassified	Normal Constraint Congestion	Total	Grand Total	Special Cases of Total	Percent of Special Cases	
ACEC	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$12.7	\$12.6	\$0.0	(\$0.0)	\$0.0	(\$0.0)	\$0.0	(\$3.2)	(\$3.3)	\$9.4	(\$0.0)	(0.4%)
AEP	\$0.0	(\$0.1)	\$0.0	\$1.1	\$0.0	\$0.0	\$210.4	\$211.5	\$0.0	(\$0.5)	\$0.0	(\$0.0)	\$0.0	(\$44.0)	(\$44.5)	\$167.0	\$0.5	0.3%
APS	\$0.0	(\$0.1)	\$0.0	\$0.0	\$0.0	\$0.0	\$88.9	\$88.8	\$0.0	(\$0.2)	\$0.0	(\$0.0)	\$0.0	(\$18.8)	(\$19.0)	\$69.8	(\$0.3)	(0.4%)
ATSI	\$0.0	(\$0.0)	\$0.0	\$0.8	\$0.0	\$0.0	\$103.7	\$104.5	\$0.0	(\$0.3)	\$0.0	(\$0.0)	\$0.0	(\$22.5)	(\$22.8)	\$81.7	\$0.5	0.6%
BGE	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$51.4	\$51.3	\$0.0	(\$0.1)	\$0.0	(\$0.0)	\$0.0	(\$10.7)	(\$10.8)	\$40.5	(\$0.2)	(0.4%)
COMED	\$1.2	(\$0.0)	\$0.0	\$5.6	\$0.0	\$0.0	\$186.9	\$193.6	\$0.0	(\$0.4)	\$0.0	(\$0.0)	\$0.0	(\$29.7)	(\$30.1)	\$163.5	\$6.2	3.8%
DAY	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$26.7	\$26.7	\$0.0	(\$0.1)	\$0.0	(\$0.0)	\$0.0	(\$6.0)	(\$6.1)	\$20.6	(\$0.1)	(0.4%)
DOM	\$0.0	(\$0.2)	\$0.0	\$0.1	\$0.0	\$0.0	\$205.9	\$205.9	\$0.0	(\$0.5)	\$0.0	(\$0.0)	\$0.0	(\$49.9)	(\$50.4)	\$155.5	(\$0.5)	(0.3%)
DPL	\$0.1	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$54.7	\$54.8	\$0.0	(\$0.1)	\$0.0	(\$0.0)	\$0.0	(\$7.4)	(\$7.5)	\$47.3	(\$0.0)	(0.1%)
DUKE	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$42.0	\$42.0	\$0.0	(\$0.1)	\$0.0	(\$0.0)	\$0.0	(\$9.2)	(\$9.3)	\$32.7	(\$0.1)	(0.4%)
DUQ	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$18.2	\$18.2	\$0.0	(\$0.1)	\$0.0	(\$0.0)	\$0.0	(\$4.6)	(\$4.7)	\$13.6	(\$0.1)	(0.4%)
EKPC	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$21.7	\$21.7	\$0.0	(\$0.1)	\$0.0	(\$0.0)	\$0.0	(\$4.7)	(\$4.8)	\$16.9	(\$0.1)	(0.4%)
EXT	\$1.1	(\$0.0)	\$0.0	\$0.1	\$0.0	\$0.0	\$23.7	\$24.9	\$0.0	(\$0.1)	\$0.0	(\$0.0)	\$0.0	(\$9.7)	(\$9.8)	\$15.0	\$1.0	6.8%
JCLPLC	\$3.5	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$35.7	\$39.2	\$0.0	(\$0.1)	\$0.0	(\$0.0)	\$0.0	(\$9.1)	(\$9.2)	\$30.0	\$3.4	11.4%
MEC	\$0.0	(\$0.0)	\$0.0	\$0.1	\$0.0	\$0.0	\$24.9	\$25.0	\$0.0	(\$0.1)	\$0.0	(\$0.0)	\$0.0	(\$5.9)	(\$5.9)	\$19.1	\$0.0	0.1%
OVEC	\$0.0	(\$0.0)	\$0.0	\$0.6	\$0.0	\$0.0	\$1.7	\$2.3	\$0.0	(\$0.0)	\$0.0	(\$0.0)	\$0.0	(\$0.4)	(\$0.4)	\$1.9	\$0.6	28.9%
PE	\$0.0	(\$0.0)	\$0.0	\$1.1	\$0.0	\$0.0	\$27.5	\$28.5	\$0.0	(\$0.1)	\$0.0	(\$0.0)	\$0.0	(\$5.7)	(\$5.7)	\$22.8	\$1.0	4.3%
PECO	(\$0.0)	(\$0.0)	\$0.0	\$0.1	\$0.0	\$0.0	\$49.1	\$49.2	\$0.0	(\$0.1)	\$0.0	(\$0.0)	\$0.0	(\$12.6)	(\$12.8)	\$36.4	(\$0.1)	(0.3%)
PEPCO	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$44.9	\$44.9	\$0.0	(\$0.1)	\$0.0	(\$0.0)	\$0.0	(\$9.8)	(\$9.9)	\$34.9	(\$0.1)	(0.4%)
PPL	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$60.9	\$60.9	\$0.0	(\$0.2)	\$0.0	(\$0.0)	\$0.0	(\$14.0)	(\$14.2)	\$46.7	(\$0.2)	(0.3%)
PSEG	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$54.8	\$54.8	\$0.0	(\$0.2)	\$0.0	(\$0.0)	\$0.0	(\$14.0)	(\$14.2)	\$40.6	(\$0.2)	(0.4%)
REC	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$3.2	\$3.2	\$0.0	(\$0.0)	\$0.0	(\$0.0)	\$0.0	(\$0.5)	(\$0.5)	\$2.7	(\$0.0)	(0.2%)
Total	\$5.9	(\$0.6)	\$0.0	\$9.6	\$0.0	\$0.0	\$1,349.7	\$1,364.5	\$0.0	(\$3.3)	\$0.0	(\$0.2)	\$0.0	(\$292.4)	(\$295.9)	\$1,068.6	\$11.3	1.1%

Table 11-14 and Table 11-15 show total balancing congestion caused by each of the Real-Time Short-Term Marginal Value Overrides constraints PJM used in 2024 (Table 11-14) and 2023 (Table 11-15). The congestion associated with Real-Time Short-Term Marginal Value Overrides is included in the Normal Constraint Congestion totals. Real-Time Short-Term Marginal Value Overrides are artificial transmission contingencies on physical transmission elements. Real-Time Short-Term Marginal Value Overrides temporarily force a generator to be marginal. Real-Time Short-Term Marginal Value Overrides are typically in place for a period of from several hours to a few days. Real-Time Short-Term Marginal Value Overrides are similar to a closed loop interface in that they enforce artificially uniform price effects, but unlike closed loop interfaces that only affect prices on the constrained side, these artificial constraints enforce artificially uniform price spreads between the two sides of the constraint through large uniform dfax on the constrained side and small uniform dfax on the unconstrained side. The uniform source dfax and uniform sink dfax of the artificial constraint can be modified, along with the transmission line limits, by PJM to meet market outcome goals and are a source of significant modeling differences between the day-ahead and real-time market.

Table 11-14 CLMP charges and credits and congestion collected by Real-Time Short-Term Marginal Value Overrides by affected Constraint: 2024

CLMP Credits and Charges (Millions)								Percent of Total Congestion Caused by Real-Time Short- Term Marginal Value Overrides
Balancing								
				Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	
No.	Constraint	Type	Location					
1	Carlisle Pike - Roxbury	Line	PE	(\$1.6)	(\$0.2)	\$0.0	(\$1.4)	62.1%
2	Carlisle Pike - Gardners	Line	PE	(\$0.3)	\$0.2	\$0.0	(\$0.4)	19.0%
3	Cloverdale - Jacksons Ferry	Line	AEP	\$0.0	\$0.0	(\$0.2)	(\$0.2)	9.6%
4	Bair - Jackson	Line	MEC	(\$0.1)	\$0.0	(\$0.0)	(\$0.1)	3.8%
5	Preston - Todd	Line	DPL	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.1)	2.7%
6	Edwards Ferry - Dickerson Station	Line	DOM	\$0.0	\$0.0	(\$0.0)	(\$0.0)	1.8%
7	Concord - Laurel	Line	DPL	(\$0.0)	\$0.0	(\$0.0)	(\$0.0)	1.3%
8	Black Oak - Hatfield	Line	APS	(\$0.0)	(\$0.0)	\$0.0	\$0.0	(1.2%)
9	Howard - Melmore	Line	AEP	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	0.7%
10	Skimmer	Transformer	AEP	\$0.0	\$0.0	(\$0.0)	(\$0.0)	0.2%
11	Corbin - Crescent Ridge	Line	MISO	(\$0.0)	(\$0.0)	(\$0.0)	\$0.0	(0.1%)
12	Lenox - North Meshoppen	Line	PE	\$0.0	\$0.0	\$0.0	(\$0.0)	0.1%
13	Conastone	Transformer	500	\$0.0	\$0.0	(\$0.0)	(\$0.0)	0.1%
Total				(\$2.0)	\$0.1	(\$0.3)	(\$2.3)	100.0%

**Table 11-15 CLMP charges and credits and congestion collected by Real-Time Short-Term Marginal Value Overrides by affected Constraint: 2023**

CLMP Credits and Charges (Millions)								
Balancing								Percent of Total Congestion Caused by Real-Time Short-Term Marginal Value Overrides
No.	Constraint	Type	Location	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	
1	Abingdon - South Abingdon	Line	AEP	(\$1.5)	\$0.1	(\$0.0)	(\$1.6)	44.2%
2	Harwood	Transformer	PPL	(\$0.6)	\$0.1	(\$0.0)	(\$0.7)	20.2%
3	Carlisle Pike - Gardners	Line	PE	(\$0.3)	\$0.0	(\$0.1)	(\$0.4)	11.6%
4	Greys Point - Rappahannock	Line	DOM	(\$0.0)	\$0.2	(\$0.1)	(\$0.3)	8.6%
5	Greys Point - Harmony Village	Line	DOM	(\$0.1)	\$0.1	(\$0.1)	(\$0.3)	8.5%
6	Hinchmans - Jackson Road	Line	PSEG	(\$0.0)	\$0.0	(\$0.1)	(\$0.1)	2.6%
7	Hopewell - Chesterfield	Line	DOM	(\$0.0)	\$0.0	(\$0.0)	(\$0.1)	1.6%
8	Newberry - Round Top	Line	MEC	(\$0.0)	\$0.0	(\$0.0)	(\$0.0)	1.2%
9	939 Mulberry - Tazewell	Line	COMED	(\$0.0)	\$0.0	\$0.0	(\$0.0)	1.1%
10	Mountain - PPGI	Line	MEC	(\$0.0)	\$0.0	\$0.0	(\$0.0)	0.2%
11	Mole Creek - 939 Mulberry	Line	COMED	(\$0.0)	\$0.0	(\$0.0)	(\$0.0)	0.1%
12	Spring Creek - Wolf Hills	Line	AEP	\$0.0	\$0.0	\$0.0	(\$0.0)	0.0%
Total				(\$2.5)	\$0.6	(\$0.5)	(\$3.6)	100.0%

## Fast Start Pricing Effect on Zonal Congestion

PJM implemented fast start pricing in both day-ahead and real-time markets starting September 1, 2021. Table 11-16 compares the congestion costs between the dispatch run and the pricing run in 2024. The table shows that the implementation of fast starting pricing logic caused day-ahead total congestion costs to decrease \$76.7 million (or 3.6 percent), caused negative balancing congestion costs to decrease \$16.7 million (or 5.8 percent), and caused total congestion costs to decrease \$93.4 million (or 5.1 percent) from the dispatch run to the pricing run in 2024. In comparing the two pricing results, the same MW, from the dispatch run in the day-ahead market and metered output in the real-time market, are used in the accounting cost calculations.

**Table 11-16 Total congestion by dispatch and pricing run (Dollars (Millions)): 2024**

Congestion Costs (Millions)									
Control Zone	Dispatch Run			Pricing Run			Difference		
	Day-Ahead	Balancing	Total	Day-Ahead	Balancing	Total	Day-Ahead	Balancing	Total
ACEC	\$20.0	(\$3.4)	\$16.6	\$19.9	(\$3.6)	\$16.3	(\$0.0)	(\$0.2)	(\$0.3)
AEP	\$344.4	(\$44.2)	\$300.2	\$333.3	(\$46.7)	\$286.6	(\$11.1)	(\$2.5)	(\$13.6)
APS	\$145.4	(\$20.1)	\$125.3	\$144.4	(\$21.2)	\$123.1	(\$1.1)	(\$1.1)	(\$2.2)
ATSI	\$175.1	(\$22.4)	\$152.7	\$173.7	(\$23.7)	\$150.0	(\$1.4)	(\$1.3)	(\$2.7)
BGE	\$79.0	(\$11.0)	\$68.0	\$78.8	(\$11.6)	\$67.2	(\$0.2)	(\$0.7)	(\$0.9)
COMED	\$331.7	(\$27.4)	\$304.3	\$278.7	(\$28.8)	\$250.0	(\$53.0)	(\$1.4)	(\$54.4)
DAY	\$40.6	(\$5.9)	\$34.7	\$40.6	(\$6.3)	\$34.3	(\$0.0)	(\$0.3)	(\$0.4)
DOM	\$294.1	(\$44.4)	\$249.7	\$293.4	(\$47.0)	\$246.4	(\$0.7)	(\$2.6)	(\$3.3)
DPL	\$72.0	(\$7.2)	\$64.8	\$72.0	(\$7.9)	\$64.2	\$0.0	(\$0.7)	(\$0.7)
DUKE	\$58.3	(\$9.0)	\$49.3	\$58.4	(\$9.5)	\$48.8	\$0.0	(\$0.5)	(\$0.5)
DUQ	\$26.5	(\$4.6)	\$21.9	\$26.2	(\$4.8)	\$21.4	(\$0.3)	(\$0.3)	(\$0.5)
EKPC	\$33.4	(\$4.9)	\$28.4	\$33.3	(\$5.2)	\$28.1	(\$0.0)	(\$0.3)	(\$0.3)
EXT	\$45.3	(\$7.9)	\$37.5	\$37.4	(\$8.3)	\$29.2	(\$7.9)	(\$0.4)	(\$8.3)
JCPLC	\$56.0	(\$9.4)	\$46.6	\$55.9	(\$10.0)	\$45.9	(\$0.1)	(\$0.6)	(\$0.7)
MEC	\$35.7	(\$7.1)	\$28.6	\$35.6	(\$7.4)	\$28.2	(\$0.1)	(\$0.3)	(\$0.4)
OVEC	\$3.0	(\$0.4)	\$2.7	\$3.0	(\$0.4)	\$2.6	(\$0.0)	(\$0.0)	(\$0.0)
PE	\$44.9	(\$6.1)	\$38.8	\$44.6	(\$6.5)	\$38.2	(\$0.3)	(\$0.3)	(\$0.6)
PECO	\$77.0	(\$13.3)	\$63.7	\$77.0	(\$14.1)	\$62.8	(\$0.1)	(\$0.8)	(\$0.9)
PEPCO	\$66.6	(\$10.1)	\$56.5	\$66.4	(\$10.7)	\$55.7	(\$0.2)	(\$0.6)	(\$0.7)
PPL	\$94.7	(\$13.8)	\$80.9	\$94.5	(\$14.6)	\$80.0	(\$0.1)	(\$0.8)	(\$1.0)
PSEG	\$87.8	(\$14.6)	\$73.2	\$87.6	(\$15.5)	\$72.1	(\$0.2)	(\$0.9)	(\$1.1)
REC	\$3.8	(\$0.5)	\$3.3	\$3.8	(\$0.5)	\$3.3	(\$0.0)	(\$0.0)	(\$0.0)
Total	\$2,135.3	(\$287.5)	\$1,847.8	\$2,058.6	(\$304.2)	\$1,754.4	(\$76.7)	(\$16.7)	(\$93.4)

## Monthly Congestion

Table 11-17 shows day-ahead, balancing and inadvertent congestion costs by month for 2023 through 2024.

Total negative balancing congestion costs in 2024 were highest in July. The top constraint that contributed to the total balancing congestion costs in 2024 was the Lenox – North Meshoppen Line. The constraint accounted for 7.1 percent of the total balancing congestion costs in 2024. The majority (107.2 percent) of negative balancing congestion costs for the Lenox – North Meshoppen Line were the result of Increments.

In 2024, total congestion costs were highest in July and lowest in February.

**Table 11-17 Monthly congestion costs by market (Dollars (Millions)): 2023 through 2024**

	Congestion Costs (Millions)							
	2023				2024			
	Day-Ahead	Balancing	Inadvertent Charges	Total	Day-Ahead	Balancing	Inadvertent Charges	Total
Jan	\$69.3	(\$7.0)	(\$0.0)	\$62.2	\$230.9	(\$35.0)	\$0.0	\$196.0
Feb	\$102.8	(\$16.4)	\$0.0	\$86.4	\$67.8	(\$14.6)	\$0.0	\$53.2
Mar	\$54.2	(\$27.3)	\$0.0	\$26.8	\$99.9	(\$28.2)	(\$0.0)	\$71.8
Apr	\$128.9	(\$43.4)	(\$0.0)	\$85.5	\$108.4	(\$28.2)	\$0.0	\$80.1
May	\$96.9	(\$35.9)	\$0.0	\$61.0	\$199.3	(\$26.7)	\$0.0	\$172.6
Jun	\$87.1	(\$12.7)	\$0.0	\$74.4	\$155.3	(\$27.5)	\$0.0	\$127.8
Jul	\$166.2	(\$26.7)	\$0.0	\$139.6	\$371.5	(\$41.0)	\$0.0	\$330.5
Aug	\$133.6	(\$22.8)	\$0.0	\$110.8	\$256.6	(\$18.3)	\$0.0	\$238.3
Sep	\$138.3	(\$24.7)	\$0.0	\$113.6	\$128.7	(\$13.2)	\$0.0	\$115.5
Oct	\$153.2	(\$34.0)	\$0.0	\$119.2	\$137.3	(\$22.0)	\$0.0	\$115.2
Nov	\$135.1	(\$28.7)	\$0.0	\$106.4	\$84.6	(\$18.5)	\$0.0	\$66.1
Dec	\$98.9	(\$16.3)	\$0.0	\$82.6	\$218.2	(\$31.0)	(\$0.0)	\$187.3
Total	\$1,364.5	(\$295.9)	\$0.0	\$1,068.6	\$2,058.6	(\$304.2)	\$0.0	\$1,754.4

Figure 11-3 shows PJM monthly total congestion cost for 2008 through 2024.

**Figure 11-3 Monthly total congestion cost (Dollars (Millions)): 2008 through 2024**

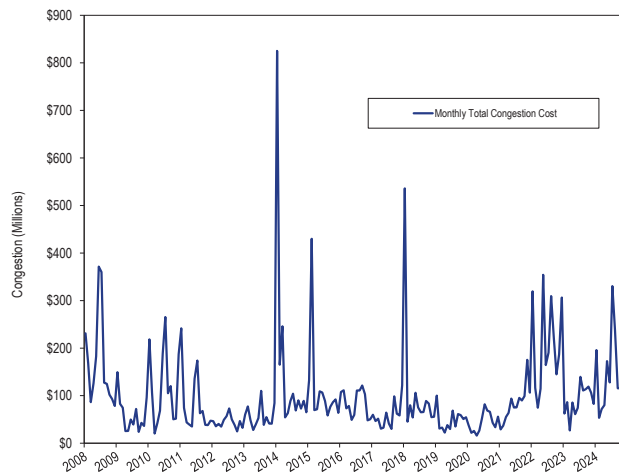


Table 11-18 shows monthly total CLMP credits and charges for each virtual transaction type for 2023 through 2024. Virtual transaction CLMP charges, when positive, are the total CLMP charges to the virtual transactions and when negative, are the total CLMP credits to the virtual transactions. The negative totals in Table 11-18 show that virtuals were paid, in net, CLMP credits in 2024 and 2023. In 2024, 31.1 percent of the total credits to virtuals went to UTCs, compared to 63.2 percent in 2023. In 2024, the average hourly cleared UTC MW decreased by 46.0 percent, compared to 2023.

Table 11-18 Monthly CLMP charges by virtual transaction type (Dollars (Millions)): 2023 through 2024

CLMP Credits and Charges (Millions)										
Year	DEC			INC			Up to Congestion			Grand Total
	Day-Ahead	Balancing	Total	Day-Ahead	Balancing	Total	Day-Ahead	Balancing	Total	
2023										
Jan	(\$1.9)	\$0.3	(\$1.6)	\$2.3	(\$1.7)	\$0.6	\$6.4	(\$6.6)	(\$0.2)	(\$1.1)
Feb	\$5.6	(\$3.1)	\$2.5	\$3.8	(\$3.5)	\$0.3	\$5.5	(\$11.7)	(\$6.1)	(\$3.4)
Mar	(\$2.9)	\$2.2	(\$0.7)	\$4.4	(\$5.2)	(\$0.8)	\$8.6	(\$27.9)	(\$19.3)	(\$20.8)
Apr	(\$3.8)	\$2.6	(\$1.1)	\$7.9	(\$14.2)	(\$6.3)	\$18.0	(\$35.8)	(\$17.8)	(\$25.2)
May	(\$2.4)	\$1.5	(\$0.9)	\$4.4	(\$6.4)	(\$2.0)	\$20.4	(\$29.4)	(\$9.1)	(\$12.0)
Jun	\$1.3	(\$1.8)	(\$0.5)	\$1.0	(\$2.4)	(\$1.5)	\$14.9	(\$11.3)	\$3.6	\$1.6
Jul	\$7.7	(\$10.7)	(\$3.0)	\$1.4	(\$4.2)	(\$2.8)	\$12.9	(\$12.3)	\$0.6	(\$5.2)
Aug	\$9.8	(\$8.9)	\$0.9	\$2.2	(\$3.8)	(\$1.6)	\$9.6	(\$15.2)	(\$5.6)	(\$6.3)
Sep	\$5.1	(\$6.5)	(\$1.5)	\$3.4	(\$8.0)	(\$4.6)	\$10.2	(\$14.1)	(\$4.0)	(\$10.0)
Oct	(\$1.9)	\$3.3	\$1.4	\$8.4	(\$16.8)	(\$8.5)	\$13.1	(\$17.1)	(\$4.0)	(\$11.1)
Nov	\$0.2	(\$3.7)	(\$3.6)	\$2.7	(\$5.6)	(\$2.9)	\$14.3	(\$20.9)	(\$6.6)	(\$13.0)
Dec	\$3.3	(\$3.0)	\$0.3	(\$1.6)	(\$1.7)	(\$3.3)	\$11.0	(\$13.5)	(\$2.5)	(\$5.6)
Total	\$20.1	(\$27.9)	(\$7.8)	\$40.2	(\$73.6)	(\$33.4)	\$144.9	(\$215.9)	(\$71.0)	(\$112.2)
2024										
Jan	\$2.1	(\$6.6)	(\$4.6)	\$5.5	(\$10.5)	(\$4.9)	\$16.2	(\$23.6)	(\$7.4)	(\$16.9)
Feb	(\$0.6)	\$0.5	(\$0.1)	\$6.9	(\$9.7)	(\$2.9)	\$9.5	(\$10.5)	(\$1.0)	(\$4.0)
Mar	\$0.8	(\$3.2)	(\$2.5)	\$9.3	(\$13.8)	(\$4.5)	\$15.3	(\$17.3)	(\$2.0)	(\$8.9)
Apr	(\$0.6)	\$0.8	\$0.3	\$14.9	(\$18.2)	(\$3.3)	\$16.8	(\$20.3)	(\$3.4)	(\$6.4)
May	(\$2.8)	\$4.1	\$1.3	\$12.6	(\$18.0)	(\$5.4)	\$16.6	(\$18.8)	(\$2.2)	(\$6.3)
Jun	\$0.5	\$0.7	\$1.2	\$6.0	(\$11.1)	(\$5.1)	\$15.3	(\$16.3)	(\$1.1)	(\$4.9)
Jul	(\$1.4)	(\$2.3)	(\$3.7)	\$6.6	(\$20.3)	(\$13.7)	\$12.0	(\$18.2)	(\$6.2)	(\$23.6)
Aug	\$3.4	(\$3.8)	(\$0.4)	\$4.7	(\$5.7)	(\$1.1)	\$10.0	(\$12.3)	(\$2.3)	(\$3.8)
Sep	(\$5.4)	\$5.9	\$0.5	\$4.0	(\$6.3)	(\$2.3)	\$6.2	(\$7.8)	(\$1.6)	(\$3.3)
Oct	(\$2.9)	\$1.7	(\$1.2)	\$6.2	(\$11.5)	(\$5.2)	\$9.5	(\$11.0)	(\$1.5)	(\$7.9)
Nov	(\$6.4)	\$2.7	(\$3.8)	\$12.3	(\$18.0)	(\$5.7)	\$7.6	(\$9.2)	(\$1.6)	(\$11.1)
Dec	(\$17.1)	\$8.5	(\$8.7)	\$14.8	(\$30.0)	(\$15.3)	\$9.5	(\$13.4)	(\$3.8)	(\$27.8)
Total	(\$13.4)	\$0.5	(\$12.8)	\$89.1	(\$143.1)	(\$54.0)	\$135.0	(\$165.2)	(\$30.3)	(\$97.1)

## Congested Facilities

A congestion event exists when a unit or units must be dispatched out of merit order to control for the potential impact of a contingency on a monitored facility or to control an actual overload. A congestion event hour exists when a specific facility is constrained for one or more five-minute intervals within an hour. A congestion event hour differs from a constrained hour, which is any hour during which one or more facilities are congested. If two facilities are constrained during an hour, the result is one constrained hour and two congestion event hours. Constraints are often simultaneous, so the number of congestion event hours usually exceeds the number of constrained hours and the number of congestion event hours usually exceeds the number of hours in a year.

In order to have a consistent metric for real-time and day-ahead congestion frequency, real-time congestion frequency is measured using the convention that an hour is constrained if any of its component five-minute intervals is constrained. This is consistent with the way in which PJM reports real-time congestion.

In 2024, there were 78,295 day-ahead congestion event hours compared to 73,522 day-ahead congestion event hours in 2023. Of the day-ahead congestion event hours in 2024, only 13,779 (17.6 percent) were also constrained in the real-time energy market (Table 11-20). In 2024, there were 27,680 real-time, congestion event hours compared to 22,687 real-time, congestion event hours in 2023. Of the real-time congestion event hours in 2024, 14,048 (50.8 percent) were also constrained in the day-ahead energy market (Table 11-21).

## Congestion Event Hours

Table 11-19 compares the monthly day-ahead and real-time congestion event hours in 2023 and 2024. Day-ahead congestion event hours are significantly greater than real-time congestion event hours.

**Table 11-19 Monthly day-ahead and real-time congestion event hours: 2023 through 2024**

	Day-Ahead Congestion Event Hours		Real-Time Congestion Event Hours	
	2023	2024	2023	2024
Jan	6,272	6,003	1,113	2,037
Feb	6,223	5,516	1,210	1,709
Mar	6,111	7,877	1,717	2,527
Apr	6,816	6,464	2,406	2,648
May	6,769	6,833	1,708	2,930
Jun	5,930	6,601	1,487	2,731
Jul	6,728	6,379	1,940	2,397
Aug	5,594	5,822	1,828	1,885
Sep	5,842	5,974	2,172	1,884
Oct	5,739	7,039	2,530	2,472
Nov	4,998	5,782	2,423	1,808
Dec	6,512	8,015	2,152	2,652
Total	73,534	78,305	22,686	27,680

Table 11-20 and Table 11-21 compare day-ahead and real-time congestion event hours. Among the hours for which a facility is constrained in the day-ahead energy market, the number of hours during which the facility is also constrained in the real-time energy market are presented in Table 11-20.<sup>23</sup>

Among the hours for which a facility was constrained in the real-time energy market, the number of hours during which the facility was also constrained in the day-ahead energy market are presented in Table 11-21.

Congestion frequency continued to be significantly higher in the day-ahead energy market than in the real-time energy market in 2024. The number of congestion event hours in the day-ahead energy market was about three times the number of congestion event hours in the real-time energy market.

In the real-time market, PJM has the ability to model and monitor almost all PJM transmission facilities. In the day-ahead market, PJM can model and monitor only a portion of PJM transmission facilities. This difference in modeling is the basis of false arbitrage and the source of significant virtual profits. While more constraints are modeled and monitored in the PJM real-time market than the day-ahead market, there is significantly more network flow in the day-ahead market than in the real-time market as a result of virtual bids and offers. Virtual bids and offers also contribute to day-ahead market flows that do not align with realized real-time physical flows. The number of congestion event hours in the day-ahead energy market was about three times the number of congestion event hours in the real-time energy market, despite the fact that only a portion of PJM transmission facilities are modeled in the day-ahead market.

**Table 11-20 Congestion event hours (day-ahead against real-time): 2023 and 2024**

Type	Congestion Event Hours					
	2023			2024		
	Day-Ahead Constrained	Corresponding Real-Time Constrained	Percent	Day-Ahead Constrained	Corresponding Real-Time Constrained	Percent
Flowgate	6,822	1,747	25.6%	8,372	1,747	20.9%
Interface	576	20	3.5%	862	179	20.8%
Line	49,563	6,171	12.5%	52,728	8,451	16.0%
Transformer	9,562	640	6.7%	9,129	608	6.7%
Other	6,999	3,718	53.1%	7,204	2,794	38.8%
Total	73,522	12,296	16.7%	78,295	13,779	17.6%

<sup>23</sup> Constraints are mapped to transmission facilities. In the day-ahead energy market, within a given hour, a single transmission facility may be associated with multiple constraints. In such situations, the same facility accounts for more than one congestion event hour for a given hour in the day-ahead energy market. Similarly in the real-time market a facility may account for more than one congestion event hour within a given hour.



Table 11-21 Congestion event hours (real-time against day-ahead): 2023 and 2024

Congestion Event Hours						
Type	2023			2024		
	Real-Time Constrained	Corresponding Day-Ahead Constrained	Percent	Real-Time Constrained	Corresponding Day-Ahead Constrained	Percent
Flowgate	5,340	1,752	32.8%	5,354	1,747	32.6%
Interface	60	23	38.3%	412	256	62.1%
Line	11,685	6,261	53.6%	16,210	8,579	52.9%
Transformer	1,257	674	53.6%	1,516	612	40.4%
Other	4,345	3,737	86.0%	4,188	2,854	68.1%
Total	22,687	12,447	54.9%	27,680	14,048	50.8%

Table 11-22 shows congestion costs by facility voltage class in 2024. Congestion costs in 2024 increased for all facility voltage classes except for 161 kV compared to 2023.

Table 11-22 Congestion summary (By facility voltage): 2024

CLMP Credits and Charges (Millions)											
Voltage (kV)	Day-Ahead				Balancing				Event Hours		
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Congestion Costs	Day- Ahead	Real- Time
765	(\$4.6)	(\$29.1)	\$3.2	\$27.7	\$1.8	\$6.3	(\$2.4)	(\$7.0)	\$20.7	512	70
500	\$145.9	(\$183.4)	\$12.7	\$342.0	\$2.9	\$16.2	(\$19.9)	(\$33.2)	\$308.9	2,602	988
345	\$3.1	(\$210.3)	\$31.2	\$244.5	(\$9.8)	\$40.8	(\$40.7)	(\$91.3)	\$153.2	7,678	3,312
230	\$358.1	(\$455.8)	\$40.3	\$854.2	\$32.2	\$22.9	(\$33.3)	(\$24.0)	\$830.1	22,579	6,763
161	(\$0.5)	(\$3.5)	\$0.2	\$3.2	\$0.1	\$0.9	(\$1.9)	(\$2.7)	\$0.5	268	244
138	\$30.8	(\$303.5)	\$50.3	\$384.7	(\$12.4)	\$29.6	(\$71.2)	(\$113.2)	\$271.5	26,317	11,330
115	\$4.4	(\$162.3)	\$4.8	\$171.5	\$17.4	\$34.1	(\$9.2)	(\$25.9)	\$145.5	10,769	4,487
69	\$37.9	\$9.9	\$2.7	\$30.8	(\$3.5)	(\$1.6)	(\$1.9)	(\$3.7)	\$27.0	7,544	383
23	\$0.0	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	21	0
13.8	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	0	0
13.2	\$0.0	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	5	0
4.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	0	0
Unclassified	\$0.0	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	NA	NA
Total	\$575.2	(\$1,338.0)	\$145.4	\$2,058.5	\$28.7	\$149.2	(\$180.6)	(\$301.1)	\$1,757.4	78,295	27,577

Table 11-23 Congestion summary (By facility voltage): 2023

CLMP Credits and Charges (Millions)											
Voltage (kV)	Day-Ahead				Balancing				Event Hours		
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Costs	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Costs	Total	Congestion Costs	Day- Ahead	Real- Time
765	(\$0.1)	(\$0.9)	\$0.6	\$1.4	\$0.0	\$0.1	(\$0.3)	(\$0.3)	\$1.1	59	2
500	\$58.2	(\$76.6)	\$16.3	\$151.2	\$4.3	\$7.7	(\$10.9)	(\$14.2)	\$137.0	2,507	639
345	(\$9.9)	(\$137.6)	\$25.8	\$153.4	(\$6.5)	\$8.6	(\$23.8)	(\$38.9)	\$114.6	9,315	2,297
230	\$442.2	(\$203.7)	\$72.8	\$718.6	\$26.6	\$48.9	(\$128.2)	(\$150.5)	\$568.1	25,978	9,417
161	(\$0.8)	(\$3.1)	\$0.9	\$3.1	\$0.4	\$1.3	(\$0.9)	(\$1.8)	\$1.3	386	143
138	\$65.8	(\$141.1)	\$22.4	\$229.3	(\$10.3)	\$3.6	(\$46.9)	(\$60.8)	\$168.5	21,119	7,397
115	\$11.4	(\$69.4)	\$6.9	\$87.7	\$2.5	\$20.2	(\$8.6)	(\$26.3)	\$61.4	8,328	2,509
69	\$23.3	\$4.9	\$1.4	\$19.7	(\$3.1)	(\$1.2)	(\$0.3)	(\$2.2)	\$17.5	5,819	199
23	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	0	0
13.8	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	1	0
13.2	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	0	0
4.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	10	0
Unclassified	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	NA	NA
Total	\$589.9	(\$627.4)	\$147.1	\$1,364.5	\$13.9	\$89.0	(\$220.0)	(\$295.0)	\$1,069.4	73,522	22,603

## Congestion by Facility Type and Voltage

Day-ahead, congestion event hours decreased on transformers and increased on flowgates, interfaces, and lines in 2024. Congestion event hours on lines increased by 3,165 congestion event hours from 49,563 day-ahead, congestion event hours in 2023 to 52,728 day-ahead congestion event hours in 2024 (Table 11-24).

Real-time, congestion event hours increased on flowgates, interfaces, lines and transformers in 2024 (Table 11-25). Lines increased by 4,526 congestion event hours from 11,684 real-time, congestion event hours in 2023 to 16,210 real-time congestion event hours in 2024.

Table 11-24 provides congestion event hour subtotals and congestion cost subtotals comparing 2024 results by facility type: line, transformer, interface, flowgate and unclassified facilities.<sup>24 25</sup>

**Table 11-24 Congestion summary (By facility type): 2024**

CLMP Credits and Charges (Millions)											
Type	Day-Ahead				Balancing				Event Hours		
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Congestion Costs	Day-Ahead	Real-Time
Flowgate	\$2.7	(\$139.5)	\$37.5	\$179.7	(\$3.8)	\$17.1	(\$45.9)	(\$66.7)	\$113.1	8,372	5,354
Interface	\$50.6	(\$85.7)	\$9.0	\$145.3	(\$4.4)	\$5.8	(\$13.6)	(\$23.8)	\$121.5	862	412
Line	\$263.2	(\$845.7)	\$64.4	\$1,173.3	\$18.7	\$84.4	(\$93.5)	(\$159.2)	\$1,014.1	52,728	16,210
Transformer	\$110.5	(\$172.7)	\$17.9	\$301.0	\$3.6	\$21.4	(\$12.7)	(\$30.6)	\$270.4	9,129	1,516
Other	\$148.1	(\$94.3)	\$16.6	\$259.1	\$14.3	\$21.7	(\$16.5)	(\$23.9)	\$235.2	7,204	4,188
Unclassified	\$0.1	\$0.0	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	NA	NA
Total	\$575.2	(\$1,337.9)	\$145.4	\$2,058.6	\$28.3	\$150.4	(\$182.1)	(\$304.2)	\$1,754.4	78,295	27,680

**Table 11-25 Congestion summary (By facility type): 2023**

CLMP Credits and Charges (Millions)											
Type	Day-Ahead				Balancing				Event Hours		
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Congestion Costs	Day-Ahead	Real-Time
Flowgate	(\$35.3)	(\$115.7)	\$10.6	\$91.0	(\$5.5)	\$6.6	(\$45.7)	(\$57.8)	\$33.2	6,822	5,340
Interface	\$17.5	(\$36.8)	\$4.1	\$58.4	(\$0.6)	\$1.4	(\$4.0)	(\$6.0)	\$52.4	576	60
Line	\$343.7	(\$381.6)	\$81.7	\$807.0	(\$2.2)	\$39.7	(\$106.0)	(\$147.9)	\$659.1	49,563	11,684
Transformer	\$37.1	(\$99.9)	\$21.1	\$158.0	(\$11.1)	\$6.0	(\$9.5)	(\$26.6)	\$131.4	9,562	1,257
Other	\$227.0	\$6.5	\$29.6	\$250.1	\$33.0	\$36.0	(\$54.7)	(\$57.7)	\$192.4	6,999	4,345
Unclassified	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	NA	NA
Total	\$590.0	(\$627.4)	\$147.1	\$1,364.5	\$13.6	\$89.6	(\$219.9)	(\$295.9)	\$1,068.6	73,522	22,686

<sup>24</sup> Unclassified are congestion costs related to nontransmission facility constraints in the day-ahead energy market and any unaccounted for difference between PJM billed CLMP charges and calculated congestion costs including rounding errors. Nontransmission facility constraints include day-ahead market only constraints such as constraints on virtual transactions and constraints associated with phase-angle regulators.

<sup>25</sup> The term flowgate refers to MISO reciprocal coordinated flowgates and NYISO M2M flowgates.

## Constraint Frequency

Table 11-26 lists the constraints for 2023 and 2024 that were most frequently binding and Table 11-27 shows the constraints which experienced the largest change in congestion event hours from 2023 to 2024. In Table 11-26, constraints are presented in descending order of total day-ahead event hours and real-time event hours in 2024. In Table 11-27, the constraints are presented in descending order of absolute value of day-ahead event hour changes plus real-time event hour changes from 2023 to 2024.

**Table 11-26 Top 25 constraints: 2023 and 2024**

No.	Constraint	Type	Congestion Event Hours						Percent of Annual Hours					
			Day-Ahead			Real-Time			Day-Ahead			Real-Time		
			2023	2024	Change	2023	2024	Change	2023	2024	Change	2023	2024	Change
1	Lenox - North Meshoppen	Line	1,907	4,541	2,634	2,018	3,924	1,906	21.8%	52%	30%	23%	45%	22%
2	Nottingham	Other	6,211	3,702	(2,509)	3,929	1,571	(2,358)	71%	42%	(29%)	45%	18%	(27%)
3	Kewanee	Other	256	2,049	1,793	128	1,777	1,649	3%	23%	20%	1%	20%	19%
4	Prest - Tibb	Flowgate	442	1,633	1,191	628	1,472	844	5%	19%	14%	7%	17%	10%
5	East Towanda - Hillside	Line	696	1,914	1,218	665	1,139	474	8%	22%	14%	8%	13%	5%
6	Haumesser Road - Steward	Line	402	1,610	1,208	218	1,228	1,010	5%	18%	14%	2%	14%	11%
7	Gardners - Texas Eastern	Line	1,479	1,765	286	143	84	(59)	17%	20%	3%	2%	1%	(1%)
8	Sayreville - Sayreville	Line	2,232	1,743	(489)	0	0	0	25%	20%	(6%)	0%	0%	0%
9	Graceton - Safe Harbor	Line	3,334	1,119	(2,215)	1,654	611	(1,043)	38%	13%	(25%)	19%	7%	(12%)
10	East Lima - Haviland	Line	275	1,224	949	87	410	323	3%	14%	11%	1%	5%	4%
11	Easton - Emuni	Line	2,501	1,476	(1,025)	0	0	0	29%	17%	(12%)	0%	0%	0%
12	Conastone - Northwest	Line	1,097	903	(194)	583	508	(75)	13%	10%	(2%)	7%	6%	(1%)
13	Mountain	Transformer	2,116	1,364	(752)	0	0	0	24%	16%	(9%)	0%	0%	0%
14	Rising - Bondville	Flowgate	0	692	692	0	601	601	0%	8%	8%	0%	7%	7%
15	Yorkana	Other	0	811	811	0	448	448	0%	9%	9%	0%	5%	5%
16	Mardela - Vienna	Line	177	973	796	120	204	84	2%	11%	9%	1%	2%	1%
17	Fremont - Fremont	Line	880	1,169	289	0	0	0	10%	13%	3%	0%	0%	0%
18	Highland - Commerce	Line	194	629	435	80	512	432	2%	7%	5%	1%	6%	5%
19	Haurd - Lee Co. Energy Ctr.	Line	192	1,103	911	0	0	0	2%	13%	10%	0%	0%	0%
20	Mehoopany - North Meshoppen	Line	645	1,069	424	27	6	(21)	7%	12%	5%	0%	0%	(0%)
21	Grabill - Robinson Park	Line	0	868	868	9	158	149	0%	10%	10%	0%	2%	2%
22	Preston - Tanyard	Line	556	980	424	0	2	2	6%	11%	5%	0%	0%	0%
23	All Dam - Kittanning	Line	411	795	384	62	175	113	5%	9%	4%	1%	2%	1%
24	Hinshaw - Burr Oak	Flowgate	0	506	506	0	385	385	0%	6%	6%	0%	4%	4%
25	Lockwood - Richland	Line	22	715	693	2	95	93	0%	8%	8%	0%	1%	1%

**Table 11-27 Top 25 constraints year to year change in occurrence: 2023 and 2024**

No.	Constraint	Type	Congestion Event Hours						Percent of Annual Hours					
			Day-Ahead			Real-Time			Day-Ahead			Real-Time		
			2023	2024	Change	2023	2024	Change	2023	2024	Change	2023	2024	Change
1	Nottingham	Other	6,211	3,702	(2,509)	3,929	1,571	(2,358)	71%	42%	(29%)	45%	18%	(27%)
2	Lenox - North Meshoppen	Line	1,907	4,541	2,634	2,018	3,924	1,906	22%	52%	30%	23%	45%	22%
3	Kewanee	Other	256	2,049	1,793	128	1,777	1,649	3%	23%	20%	1%	20%	19%
4	Graceton - Safe Harbor	Line	3,334	1,119	(2,215)	1,654	611	(1,043)	38%	13%	(25%)	19%	7%	(12%)
5	Haumesser Road - Steward	Line	402	1,610	1,208	218	1,228	1,010	5%	18%	14%	2%	14%	11%
6	Turkey Hill - Hilgard	Flowgate	1,061	19	(1,042)	1,012	11	(1,001)	12%	0%	(12%)	12%	0%	(11%)
7	Prest - Tibb	Flowgate	442	1,633	1,191	628	1,472	844	5%	19%	14%	7%	17%	10%
8	East Towanda - Hillside	Line	696	1,914	1,218	665	1,139	474	8%	22%	14%	8%	13%	5%
9	Allen - R.P. Mone	Line	1,521	92	(1,429)	120	162	42	17%	1%	(16%)	1%	2%	0%
10	Rising - Bondville	Flowgate	0	692	692	0	601	601	0%	8%	8%	0%	7%	7%
11	Weedman - Mahomet	Flowgate	622	0	(622)	651	0	(651)	7%	0%	(7%)	7%	0%	(7%)
12	East Lima - Haviland	Line	275	1,224	949	87	410	323	3%	14%	11%	1%	5%	4%
13	Yorkana	Other	0	811	811	0	448	448	0%	9%	9%	0%	5%	5%
14	Chicago Ave - Praxair	Flowgate	695	122	(573)	539	84	(455)	8%	1%	(7%)	6%	1%	(5%)
15	Easton - Emuni	Line	2,501	1,476	(1,025)	0	0	0	29%	17%	(12%)	0%	0%	0%
16	Grabill - Robinson Park	Line	0	868	868	9	158	149	0%	10%	10%	0%	2%	2%
17	Haurd - Lee Co. Energy Ctr.	Line	192	1,103	911	0	0	0	2%	13%	10%	0%	0%	0%
18	Hinshaw - Burr Oak	Flowgate	0	506	506	0	385	385	0%	6%	6%	0%	4%	4%
19	Mardela - Vienna	Line	177	973	796	120	204	84	2%	11%	9%	1%	2%	1%
20	Highland - Commerce	Line	194	629	435	80	512	432	2%	7%	5%	1%	6%	5%
21	Garrett - Garrett Tap	Line	872	13	(859)	0	0	0	10%	0%	(10%)	0%	0%	0%
22	Mahomet - OCB	Flowgate	462	29	(433)	446	47	(399)	5%	0%	(5%)	5%	1%	(5%)
23	Ramapo (ConEd) - S Mahwah (RECO)	Line	1,105	289	(816)	0	0	0	13%	3%	(9%)	0%	0%	0%
24	Lockwood - Richland	Line	22	715	693	2	95	93	0%	8%	8%	0%	1%	1%
25	Mountain	Transformer	2,116	1,364	(752)	0	0	0	24%	16%	(9%)	0%	0%	0%

## Top Constraints

The top five constraints by congestion costs contributed \$454.2 million, or 25.9 percent, of the total PJM congestion costs in 2024. The top five constraints were the Nottingham Series Reactor, the Lenox – North Meshoppen Line, the Yorkana Circuit Breaker, the Conastone – Northwest Line, and the AP South Interface. Table 11-28 and Table 11-29 show the top constraints contributing to congestion costs by facility for 2024 and 2023.

The Nottingham Series Reactor was the largest contributor to congestion costs in 2024 with \$106.5 million and 6.1 percent of total PJM congestion costs. The day-ahead congestion event hours of the Nottingham Series Reactor decreased from 6,211 in 2023 to 3,702 in 2024 and the real-time congestion event hours of the Nottingham Series Reactor decreased from 3,929 in 2023 to 1,571 in 2024 (Table 11-26). The frequent binding of the Nottingham Series Reactor in both day-ahead and real-time was a result of a consistent gas price spread between cheaper PA gas and more expensive gas in DC, MD, and VA.

The Lenox – North Meshoppen Line was the second largest contributor to congestion costs in 2024 with \$106.2 million and 6.1 percent of total PJM congestion costs. The day-ahead congestion event hours of the Lenox – North Meshoppen Line increased from 1,907 in 2023 to 4,541 in 2024 and the real-time congestion event hours of the Lenox – North Meshoppen Line increased from 2,018 in 2023 to 3,924 in 2024 (Table 11-26). The frequent binding of the Lenox – North Meshoppen Line in both day-ahead and real-time was a result of exports into NY across the NYIS interface during normal, cold conditions, due to price differences between PJM (relatively low) and NYISO (relatively high).

The Yorkana Circuit Breaker was the third largest contributor to congestion costs in 2024 with \$87.6 million and 5.0 percent of total PJM congestion costs. The day-ahead congestion event hours of the Yorkana Circuit Breaker increased from 0 in 2023 to 811 in 2024 and the real-time congestion event hours of the Yorkana Circuit Breaker increased from 0 in 2023 to 448 in 2024 (Table 11-26). The frequent binding of the Yorkana Circuit Breaker in both day ahead and real time was a result of multiple unplanned Conastone 500 kV transformer outages.

The Conastone – Northwest Line was the fourth largest contributor to congestion costs in 2024 with \$86.9 million and 5.0 percent of the total PJM congestion costs. The day-ahead congestion event hours of the Conastone – Northwest Line decreased from 1,097 in 2023 to 903 in 2024 and the real-time congestion event hours of the Conastone – Northwest Line decreased from 583 in 2023 to 508 in 2024 (Table 11-26). The frequent binding of the Conastone – Northwest Line in both day ahead and real time was a result of demand in BGE and relatively expensive constraint relief generation on the help side of The Conastone – Northwest Line in BGE.

The AP South Interface was the fifth largest contributor to congestion costs in 2024 with \$66.9 million and 3.8 percent of total PJM congestion costs. The frequent binding of the AP South interface in both day ahead and real time was a result of increased gas prices on the eastern part of the grid due to cold weather and pipeline restrictions during a cold weather alert in the middle of January.

The Lenox – North Meshoppen Line was the largest contributor to negative congestion costs in 2024. The Lenox – North Meshoppen Line constraint was binding due to an outage during July 22 – 26, August 6, and September 3 – 6 in 2024. In the real-time market, the Lenox – North Meshoppen Line had constraint violations on July 5th, 9th, 12th, and 30th, August 1st and 6th, and for 21 days in December of 2024 for which the transmission penalty factors were set to \$2,000. The majority (107.2 percent) of negative balancing congestion costs for the Lenox – North Meshoppen Line were caused by related balancing payments to INCs.

Table 11–28 Top 25 constraints affecting congestion costs: 2024<sup>26</sup>

CLMP Credits and Charges (Millions)													
Day-Ahead							Balancing						Percent of Total PJM Congestion
No.	Constraint	Type	Location	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Congestion Costs	Costs
1	Nottingham	Other	PECO	\$112.5	\$21.8	\$13.4	\$104.0	\$13.0	\$2.1	(\$8.4)	\$2.5	\$106.5	6.1%
2	Lenox - North Meshoppen	Line	PE	\$4.8	(\$119.9)	\$3.2	\$128.0	\$20.0	\$33.8	(\$8.0)	(\$21.7)	\$106.2	6.1%
3	Yorkana	Other	MEC	\$46.0	(\$41.6)	\$2.5	\$90.1	\$5.3	\$4.9	(\$2.9)	(\$2.5)	\$87.6	5.0%
4	Conastone - Northwest	Line	BGE	\$50.8	(\$32.9)	\$3.3	\$86.9	\$7.5	\$5.3	(\$2.2)	(\$0.0)	\$86.9	5.0%
5	AP South	Interface	500	\$33.4	(\$35.7)	\$3.0	\$72.1	(\$0.8)	\$0.5	(\$3.9)	(\$5.2)	\$66.9	3.8%
6	Conastone	Transformer	500	\$28.0	(\$32.7)	\$1.8	\$62.5	\$4.1	\$3.3	(\$2.7)	(\$1.9)	\$60.5	3.5%
7	Chaparral - Carson	Line	DOM	\$9.3	(\$44.8)	\$2.9	\$57.1	\$0.0	\$0.0	\$0.0	\$0.0	\$57.1	3.3%
8	Pleasant View	Other	DOM	(\$10.3)	(\$64.0)	\$0.0	\$53.7	\$1.8	(\$0.1)	\$0.3	\$2.2	\$55.9	3.2%
9	Goose Creek	Transformer	DOM	\$33.7	(\$20.8)	\$1.2	\$55.8	\$2.6	\$3.5	(\$2.6)	(\$3.6)	\$52.2	3.0%
10	East Towanda - Hillside	Line	PE	(\$1.8)	(\$39.8)	(\$0.1)	\$37.9	\$4.0	\$0.8	(\$0.7)	\$2.4	\$40.3	2.3%
11	Pleasant View - Ashburn	Line	DOM	\$14.9	(\$22.5)	\$1.6	\$39.0	\$1.9	\$1.5	(\$0.4)	(\$0.0)	\$39.0	2.2%
12	Bedington - Black Oak	Interface	500	\$16.3	(\$25.5)	\$2.9	\$44.7	(\$0.3)	\$4.2	(\$3.1)	(\$7.6)	\$37.1	2.1%
13	Elk Run D.P. - Rollins Ford	Line	DOM	\$1.2	(\$33.6)	\$1.0	\$35.9	\$0.1	\$0.0	(\$0.0)	\$0.1	\$35.9	2.0%
14	Graceton - Safe Harbor	Line	BGE	\$30.2	(\$3.0)	\$3.2	\$36.4	\$4.4	\$2.2	(\$3.0)	(\$0.8)	\$35.6	2.0%
15	Braidwood - East Frankfort	Line	COMED	(\$4.8)	(\$41.8)	\$0.2	\$37.2	(\$0.1)	\$2.2	(\$1.7)	(\$3.9)	\$33.3	1.9%
16	Ashburn - Goose Creek	Line	DOM	\$12.9	(\$17.9)	\$0.9	\$31.8	\$0.0	\$0.0	\$0.0	\$0.0	\$31.8	1.8%
17	Coolspring - Milford	Line	DPL	\$1.2	(\$34.7)	\$0.0	\$36.0	(\$7.9)	(\$2.2)	(\$0.1)	(\$5.8)	\$30.2	1.7%
18	East Lima - Haviland	Line	AEP	(\$47.6)	(\$80.0)	\$3.7	\$36.1	\$3.1	\$6.0	(\$3.2)	(\$6.2)	\$30.0	1.7%
19	Plymouth Meeting - Whitpain	Line	PECO	(\$0.7)	(\$31.2)	\$0.3	\$30.8	\$1.4	\$1.7	(\$0.7)	(\$0.9)	\$29.9	1.7%
20	George Washington - Kammer	Line	AEP	(\$4.9)	(\$28.0)	\$2.1	\$25.2	\$1.4	(\$1.2)	(\$1.4)	\$1.2	\$26.4	1.5%
21	Fremont - Fremont	Line	AEP	(\$4.5)	(\$26.0)	\$3.7	\$25.2	\$0.0	\$0.0	\$0.0	\$0.0	\$25.2	1.4%
22	Cedar Creek - Silver Run	Line	DPL	(\$3.7)	(\$29.1)	\$0.4	\$25.8	(\$1.2)	(\$0.5)	\$0.1	(\$0.7)	\$25.1	1.4%
23	Juniata	Transformer	500	\$10.6	(\$14.4)	\$0.3	\$25.2	(\$0.2)	\$0.6	(\$0.2)	(\$1.0)	\$24.3	1.4%
24	Prest - Tibb	Flowgate	MISO	(\$2.4)	(\$27.2)	\$4.0	\$28.9	\$1.1	\$2.7	(\$5.3)	(\$6.9)	\$21.9	1.3%
25	Davis Besse	Other	ATSI	\$0.0	\$0.0	\$0.0	\$0.0	(\$2.1)	\$15.3	(\$3.2)	(\$20.5)	(\$20.5)	(1.2%)
Top 25 Total				\$325.1	(\$825.3)	\$55.8	\$1,206.2	\$59.0	\$86.6	(\$53.2)	(\$80.9)	\$1,125.4	64.1%
All Other Constraints				\$250.1	(\$512.7)	\$89.6	\$852.3	(\$30.7)	\$63.7	(\$128.9)	(\$223.3)	\$629.1	35.9%
Total				\$575.2	(\$1,337.9)	\$145.4	\$2,058.6	\$28.3	\$150.4	(\$182.1)	(\$304.2)	\$1,754.4	100.0%

Table 11–29 Top 25 constraints affecting congestion costs: 2023<sup>27</sup>

CLMP Credits and Charges (Millions)													
Day-Ahead							Balancing						Percent of
				Implicit Withdrawal	Implicit Injection	Explicit		Implicit Withdrawal	Implicit Injection	Explicit		Congestion	Total PJM Congestion
No.	Constraint	Type	Location	Charges	Credits	Charges	Total	Charges	Credits	Charges	Total	Costs	Costs
1	Nottingham	Other	PECO	\$224.5	\$11.4	\$27.9	\$241.0	\$30.6	\$28.2	(\$20.6)	(\$18.2)	\$222.8	20.9%
2	Conastone – Northwest	Line	BGE	\$63.8	(\$19.1)	\$6.0	\$88.9	\$8.3	\$7.1	(\$4.0)	(\$2.8)	\$86.0	8.1%
3	Graceton – Safe Harbor	Line	BGE	\$72.6	(\$1.7)	\$8.4	\$82.6	\$8.7	\$6.0	(\$4.9)	(\$2.1)	\$80.5	7.5%
4	Coolspring – Milford	Line	DPL	\$3.4	(\$50.5)	\$0.1	\$53.9	(\$9.1)	(\$5.1)	(\$0.8)	(\$4.8)	\$49.1	4.6%
5	Possum Point	Transformer	DOM	\$4.1	(\$22.8)	\$1.7	\$28.6	\$0.9	\$2.0	(\$1.4)	(\$2.5)	\$26.1	2.4%
6	AP South	Interface	500	\$10.9	(\$12.1)	\$2.2	\$25.2	\$0.1	\$0.6	(\$0.4)	(\$0.9)	\$24.3	2.3%
7	Collins	Transformer	COMED	(\$1.4)	(\$14.9)	\$9.3	\$22.8	\$0.0	\$0.0	\$0.0	\$0.0	\$22.8	2.1%
8	Dresden	Transformer	COMED	\$7.7	(\$16.5)	\$0.7	\$24.9	(\$1.6)	\$1.7	\$0.1	(\$3.2)	\$21.7	2.0%
9	Beaumeade	Other	DOM	\$1.5	(\$0.4)	\$0.9	\$2.8	\$1.9	\$2.1	(\$23.1)	(\$23.3)	(\$20.4)	(1.9%)
10	Stillwell – Dumont	Line	MISO	(\$2.7)	(\$17.3)	\$5.3	\$20.0	\$0.0	\$0.0	\$0.0	\$0.0	\$20.0	1.9%
11	Lenox – North Meshoppen	Line	PE	\$5.5	(\$32.0)	\$2.5	\$40.1	\$2.6	\$17.8	(\$5.2)	(\$20.4)	\$19.7	1.8%
12	Bedington – Black Oak	Interface	500	\$5.6	(\$11.9)	\$1.7	\$19.2	\$0.0	\$0.0	\$0.0	\$0.0	\$19.2	1.8%
13	Conastone – Peach Bottom	Line	500	\$14.9	(\$2.2)	\$2.9	\$19.9	\$1.5	\$0.8	(\$1.4)	(\$0.7)	\$19.2	1.8%
14	Allen – R.P. Mone	Line	AEP	(\$5.1)	(\$20.5)	\$3.5	\$19.0	(\$0.7)	(\$0.7)	(\$0.3)	(\$0.4)	\$18.6	1.7%
15	Brambleton – Evergreen Mills	Line	DOM	\$16.3	(\$24.1)	\$1.9	\$42.3	\$2.8	\$2.2	(\$24.3)	(\$23.8)	\$18.5	1.7%
16	Pleasant View – Ashburn	Line	DOM	\$10.8	(\$12.9)	\$0.8	\$24.5	\$1.1	\$1.2	(\$6.7)	(\$6.8)	\$17.7	1.7%
17	Cedar Creek – Silver Run	Line	DPL	(\$1.0)	(\$20.0)	\$0.4	\$19.4	(\$3.8)	(\$2.3)	(\$0.3)	(\$1.8)	\$17.6	1.7%
18	Conastone	Transformer	500	\$9.7	(\$8.4)	\$0.6	\$18.7	\$2.4	\$3.0	(\$0.9)	(\$1.4)	\$17.3	1.6%
19	Gardners – Texas Eastern	Line	MEC	(\$4.4)	(\$21.5)	\$0.1	\$17.2	\$0.0	\$0.3	(\$0.4)	(\$0.7)	\$16.5	1.5%
20	Will County – Goodings Grove	Line	COMED	\$26.2	\$7.5	(\$2.3)	\$16.4	\$0.0	\$0.0	\$0.0	\$0.0	\$16.4	1.5%
21	Dumont – Stillwell	Line	AEP	\$0.0	\$0.0	\$0.0	\$0.0	(\$2.0)	\$0.7	(\$10.6)	(\$13.3)	(\$13.3)	(1.2%)
22	Pleasant View	Other	DOM	\$1.7	(\$0.1)	\$0.4	\$2.1	\$0.9	\$5.4	(\$10.7)	(\$15.2)	(\$13.0)	(1.2%)
23	Big Pine – Kiski Valley	Line	APS	\$56.3	\$45.4	(\$1.2)	\$9.6	(\$0.9)	(\$2.5)	\$0.1	\$1.6	\$11.3	1.1%
24	Doubs – Goose Creek	Line	APS	\$7.9	\$2.5	\$5.6	\$11.0	\$0.0	\$0.0	\$0.0	\$0.0	\$11.0	1.0%
25	Fremont – Fremont	Line	AEP	(\$2.9)	(\$12.2)	\$1.7	\$11.0	\$0.0	\$0.0	\$0.0	\$0.0	\$11.0	1.0%
Top 25 Total				\$525.9	(\$254.2)	\$81.0	\$861.1	\$43.7	\$68.3	(\$115.9)	(\$140.5)	\$720.6	67.4%
All Other Constraints				\$64.1	(\$373.2)	\$66.2	\$503.5	(\$30.1)	\$21.4	(\$103.9)	(\$155.4)	\$348.0	32.6%
Total				\$590.0	(\$627.4)	\$147.1	\$1,364.5	\$13.6	\$89.6	(\$219.9)	(\$295.9)	\$1,068.6	100.0%

26 All flowgates are mapped to MISO as Location if they are flowgates coordinated by both PJM and MISO regardless of the location of the flowgates.

27 All flowgates are mapped to MISO as Location if they are flowgates coordinated by both PJM and MISO regardless of the location of the flowgates.



Figure 11-4 shows the total hourly congestion costs of the top five constraints in 2024. The Nottingham Series Reactor was the top constraint.

**Figure 11-4 Top five constraints affecting total congestion costs: 2024**

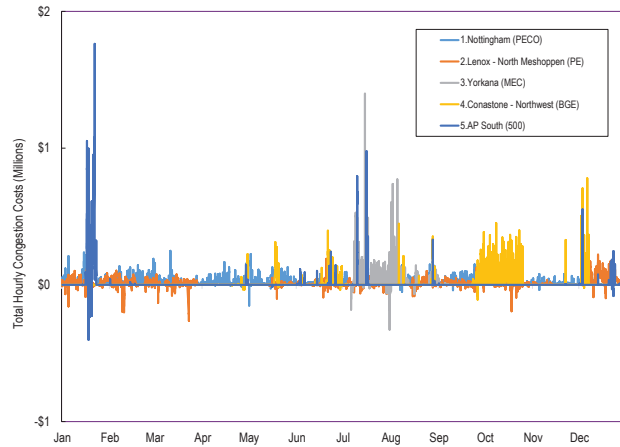


Figure 11-5 shows the total hourly balancing congestion costs of the top five constraints in 2024.

**Figure 11-5 Top five constraints affecting balancing congestion costs: 2024**

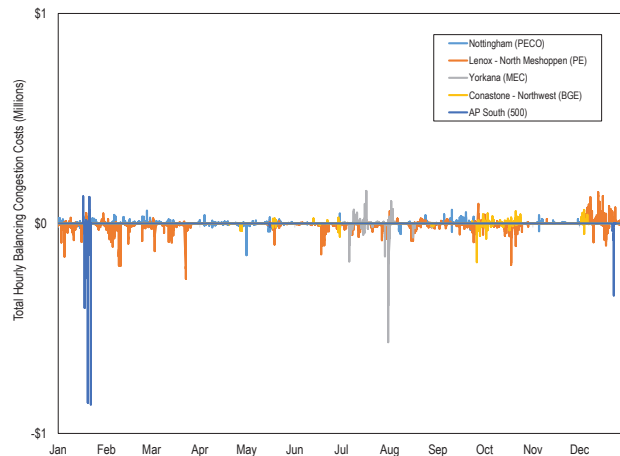


Figure 11-6 shows the total hourly day-ahead congestion costs of the top five constraints in 2024.

**Figure 11-6 Top five constraints affecting day-ahead congestion costs: 2024**

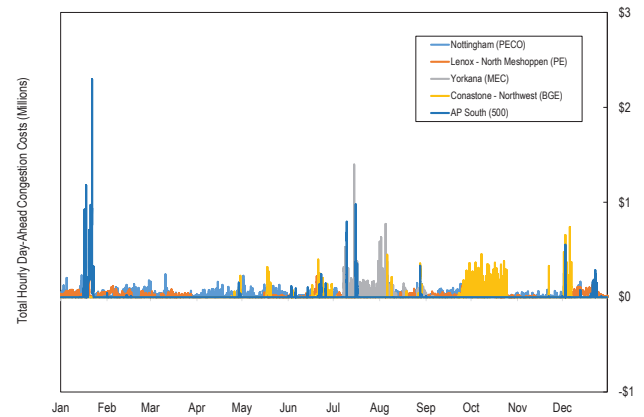


Figure 11-7 shows the locations of the top 10 constraints by total congestion costs on a contour map of the real-time, load-weighted average CLMP in 2024.

**Figure 11-7 Location of the top 10 constraints by total congestion costs: 2024**

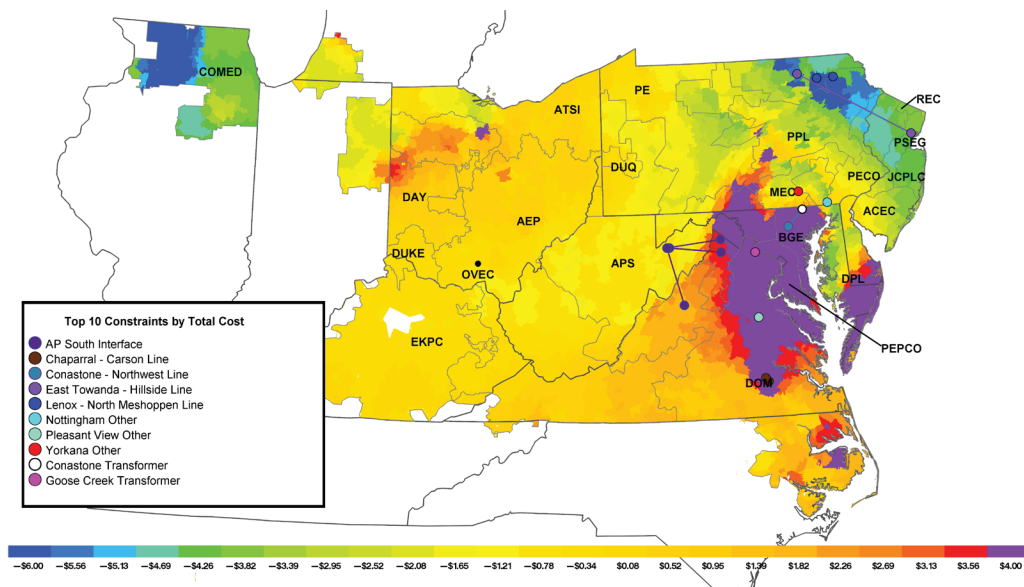


Figure 11-8 shows the locations of the top 10 constraints by balancing congestion costs on a contour map of the real-time load-weighted average CLMP in 2024.

**Figure 11-8 Location of top 10 constraints by balancing congestion costs: 2024**


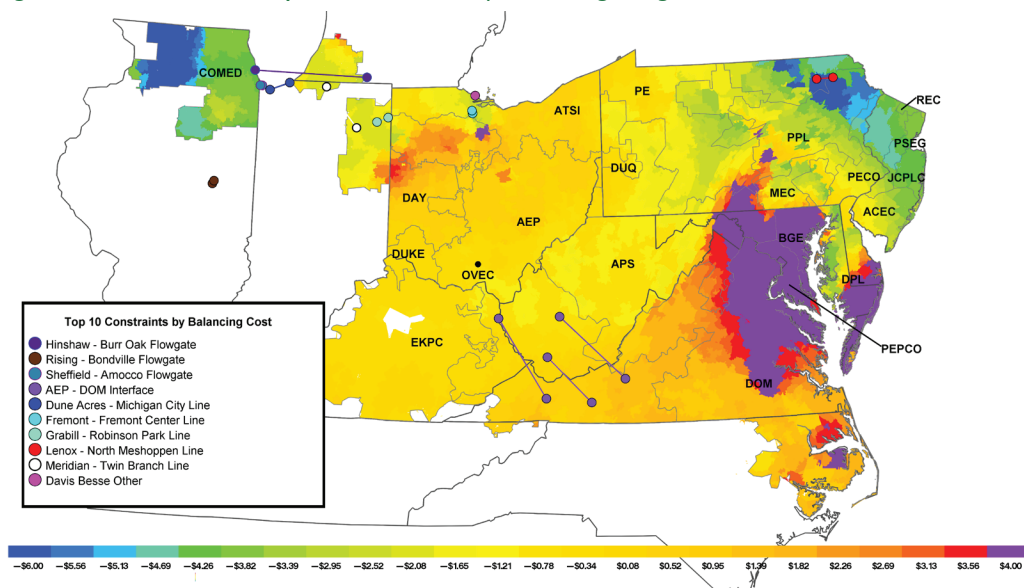


Figure 11-9 shows the locations of the top 10 constraints by day-ahead congestion costs on a contour map of the day-ahead load-weighted average CLMP in 2024.

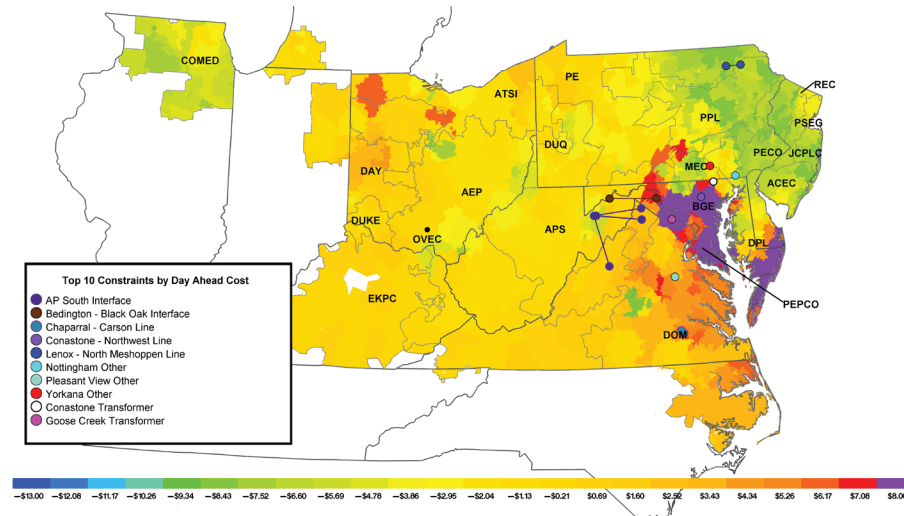**Figure 11-9 Location of top 10 constraints by day-ahead congestion costs: 2024**



Comparing Figure 11-8 (Location of the top 10 constraints by balancing congestion costs) and Figure 11-9 (location of the top 10 constraints by day-ahead congestion costs) shows the significant differences between the day-ahead and real-time markets.


### Congestion Event Summary: Impact of Changes in UTC Volumes

UTCs have a significant impact on congestion events in the day-ahead market and, as a result, contribute to differences between day-ahead and real-time congestion events. The greater the volume of UTCs, the greater the number of congestion events in the day-ahead market and the greater the differences between the day-ahead and real-time congestion events.<sup>28</sup>

In 2024, the average hourly cleared UTC MW decreased by 46.0 percent, compared to in 2023. Day-ahead congestion event hours increased by 6.5 percent from 73,522 congestion event hours in 2023 to 78,295 congestion event hours in 2024 (Table 11-20).

Figure 11-10 shows the daily day-ahead and real-time congestion event hours for 2014 through 2024.

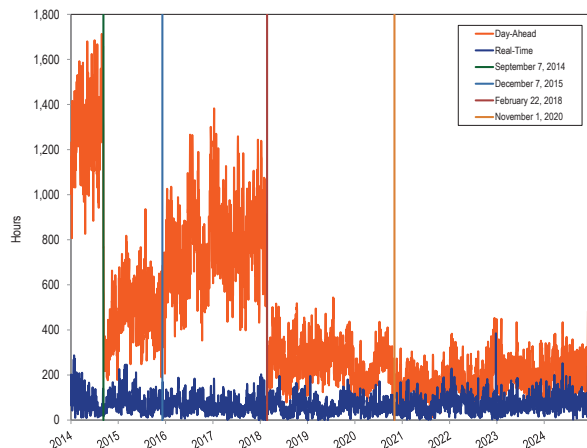**Figure 11-10 Daily congestion event hours: 2014 through 2024**



<sup>28</sup> A series of FERC orders has affected UTC activity which has in turn affected congestion events in the day-ahead market. See Appendix F: Congestion and Marginal Losses.

## Marginal Losses

### Marginal Loss Accounting

Marginal losses occur in the day-ahead and real-time energy markets. PJM calculates marginal loss costs for each PJM member. The loss cost is based on the applicable day-ahead and real-time marginal loss component of LMP (MLMP). Losses are the difference between what load (withdrawals) pay for energy and what generation (injections) are paid for energy, due to transmission line losses.

Losses increase with distance between sources and sinks and the amount of power moved. Total loss collected (loss surplus) increases with load, holding distance and resistance constant. Every incremental increase in load has to be met with a slightly larger increment of generation. The result is that the total energy losses increase as load increases.

Ignoring interchange, total generation MWh must be greater than total load MWh in any hour in order to provide for losses. Total marginal loss costs, analogous to total congestion costs, are equal to the net of the withdrawal loss charges minus injection loss credits, plus explicit loss charges, incurred in both the day-ahead energy market and the balancing energy market.

Total marginal loss costs can be more accurately thought of as net marginal loss costs. Total marginal loss costs equal implicit marginal loss charges plus explicit marginal loss charges plus net inadvertent loss charges. Implicit marginal loss charges equal withdrawal loss charges minus injection loss credits. Net explicit marginal loss costs are the net marginal loss costs associated with point to point energy transactions. Net inadvertent loss charges are the losses associated with the hourly difference between the net actual energy flow and the net scheduled energy flow into or out of the PJM control area.<sup>29</sup> Unlike the other categories of marginal loss accounting, inadvertent loss charges are costs not directly attributable to specific participants. Inadvertent loss charges are assigned to participants based on real-time load (excluding losses) ratio share.<sup>30</sup> Each of these categories of marginal loss costs is comprised of day-ahead and balancing marginal loss costs.

The accounting definitions can be misleading. Load pays losses. Losses are the difference between what

load pays for energy and what generation is paid for energy due to losses. Generation does not pay losses. Some generation receives a price lower than SMP and some generation receives a price greater than SMP due to the MLMP but that does not mean that generation is paying or being paid losses. It means that generation is being paid an LMP that is higher or lower than the system load-weighted, average LMP due to losses on the system.

While PJM accounting focuses on MLMPs, the individual MLMP values at any bus are irrelevant to the calculation of total losses. Total losses are the net surplus revenue that remains after all sources and sinks are credited or charged their LMPs. Changing the components of LMP by electing a different reference bus does not change the LMPs or the difference between LMPs for a given market solution or losses, it merely changes the components of the LMP.

The MLMP component of LMP is the marginal cost of energy, due to losses associated with serving load at the bus. The MLMP at the load-weighted reference bus is the marginal cost of energy at the load-weighted reference bus (holding the proportion of load at every bus constant). Due to losses, MLMP is non zero at the load reference bus. The LMP at the load reference bus is the system marginal price of energy (SMP) plus the marginal cost of energy due to losses at the reference bus.

Load-weighted LMP components are calculated relative to a load-weighted, average LMP. LMPs at specific load buses will reflect the fact that marginal generators must produce more (or less) energy due to losses to serve that bus than is needed to serve the load weighted reference bus. The LMP at any bus is a function of the SMP, losses and congestion. Relative to the system marginal price (SMP) at the load weighted reference bus, the loss factor can be either positive or negative.

At the load-weighted reference bus, the LMP includes no congestion component, but does include a loss component. The load weighted average MLMP across all load buses, calculated relative to that reference bus is positive. The LMPs at the load buses are a function of marginal generation bus LMPs determined through the least cost security constrained economic dispatch which accounts for transmission constraints and marginal losses.

<sup>29</sup> PJM Operating Agreement Schedule 1 §3.7.

<sup>30</sup> *Id.*

Other than the effect on the optimal dispatch point, LMP at the marginal generator bus, and therefore the payment to the generator, is not affected by marginal losses. By paying for losses based on marginal instead of average losses at the load bus, a revenue over collection occurs.

The residual difference between total marginal loss related load charges (day-ahead and balancing) and marginal loss related generation credits (day-ahead and balancing) after virtual bids have settled their marginal loss related credits and charges for their day-ahead and balancing positions is total loss. That is, losses are the difference between what withdrawals (load) are paying for energy and what injections (generation) are being paid for energy due to losses, after virtual bids marginal loss related charges and credits are settled at the end of the market day. Load is the source of the net loss surplus after generation is paid and virtuals are settled at the end of the market day. Load pays losses. Generation does not pay losses.

Day-ahead marginal loss costs are based on day-ahead MWh priced at the marginal loss price component of LMP. Balancing marginal loss costs are based on the load or generation deviations between the day-ahead and real-time energy markets priced at the marginal loss price component of LMP in the real-time energy market. If a participant has real-time generation or load that is greater than its day-ahead generation or load then the deviation will be positive. If there is a positive load deviation at a bus where the real-time LMP has a positive marginal loss component, positive balancing marginal loss costs will result. Similarly, if there is a positive load deviation at a bus where real-time LMP has a negative marginal loss component, negative balancing marginal loss costs will result. If a participant has real-time generation or load that is less than its day-ahead generation or load then the deviation will be negative. If there is a negative load deviation at a bus where real-time LMP has a positive marginal loss component, negative balancing marginal loss costs will result. Similarly, if there is a negative load deviation at a bus where real-time LMP has a negative marginal loss component, positive balancing marginal loss costs will result.

The total marginal loss surplus is the remaining loss amount from collection of marginal losses, after

accounting for total system energy costs and net residual market adjustments. The marginal loss surplus is allocated to PJM market participants based on real-time load plus export ratio share as marginal loss credits.<sup>31</sup>

## Day-Ahead Implicit Load MLMP Charges

- **Day-Ahead Implicit Load MLMP Charges.** Day-ahead implicit load MLMP charges are calculated for all cleared demand, decrement bids and day-ahead energy market sale transactions. Day-ahead implicit load MLMP charges are calculated using MW and the load bus MLMP, the decrement bid MLMP or the MLMP at the source of the sale transaction.
- **Day-Ahead Implicit Generation MLMP Credits.** Day-ahead implicit generation MLMP credits are calculated for all cleared generation and increment offers and day-ahead energy market purchase transactions. Day-ahead implicit generation MLMP credits are calculated using MW and the generator bus MLMP, the increment offer MLMP or the MLMP at the sink of the purchase transaction.
- **Balancing Implicit Load MLMP Charges.** Balancing implicit load MLMP charges are calculated for all deviations between a PJM member's real-time load and energy sale transactions and their day-ahead cleared demand, decrement bids and energy sale transactions. Balancing implicit load MLMP charges are calculated using MW deviations and the real-time MLMP for each bus where a deviation exists.
- **Balancing Implicit Generation MLMP Credits.** Balancing implicit Generation MLMP credits are calculated for all deviations between a PJM member's real-time generation and energy purchase transactions and the day-ahead cleared generation, increment offers and energy purchase transactions. Balancing implicit Generation MLMP credits are calculated using MW deviations and the real-time MLMP for each bus where a deviation exists.
- **Explicit Loss Charges.** Explicit loss charges are the net loss costs associated with point to point energy transactions, including UTCs. These costs equal the product of the transacted MW and MLMP differences between sources (origins) and sinks (destinations) in the day-ahead energy market. Balancing energy market explicit loss costs equal the product of the differences between the real-time and day-ahead

<sup>31</sup> See PJM, "Manual 28: Operating Agreement Accounting," Rev. 96 (Sept. 1, 2024).



transacted MW and the differences between the real-time MLMP at the transactions' sources and sinks.

- **Inadvertent Loss Charges.** Inadvertent loss charges are the net loss charges resulting from the differences between the net actual energy flow and the net scheduled energy flow into or out of the PJM control area each hour. This inadvertent interchange of energy may be positive or negative, where positive interchange typically results in a charge while negative interchange typically results in a credit. Inadvertent loss charges are common costs, not directly attributable to specific participants, which are distributed on a load plus export ratio basis.<sup>32</sup>

## Total Marginal Loss Cost

Total marginal loss is the difference between what withdrawals (load) pay for energy and what injections (generation) are paid for energy due to losses, after generation is paid and virtuals' marginal loss related charges and credits are settled. Load pays losses.

The total marginal loss cost in PJM for 2024, was \$915.6 million, which was comprised of implicit withdrawal MLMP charges of \$98.0 million minus implicit injection MLMP credits of -\$824.6 million plus explicit loss charges of -\$7.0 million plus inadvertent loss charges of \$0.0 million (Table 11-31).

Monthly marginal loss costs in 2024, ranged from \$41.5 million in March to \$129.8 million in July. Total marginal loss surplus decreased in 2024 by \$75.8 million or 28.7 percent from \$264.0 million in 2023 to \$339.8 million in 2024.

Table 11-30 shows the total marginal loss component costs and the total PJM billing for 2008 through 2024.

**Table 11-30 Total loss component costs (Dollars (Millions)): 2008 through 2024<sup>33 34</sup>**

	Loss Costs	Percent Change	Total PJM Billing	Percent of PJM Billing
2008	\$2,497	NA	\$34,300	7.3%
2009	\$1,268	(49.2%)	\$26,550	4.8%
2010	\$1,635	29.0%	\$34,770	4.7%
2011	\$1,380	(15.6%)	\$35,890	3.8%
2012	\$982	(28.8%)	\$29,180	3.4%
2013	\$1,035	5.5%	\$33,860	3.1%
2014	\$1,466	41.6%	\$50,030	2.9%
2015	\$969	(33.9%)	\$42,630	2.3%
2016	\$697	(28.1%)	\$39,050	1.8%
2017	\$691	(0.8%)	\$40,170	1.7%
2018	\$960	39.0%	\$49,790	1.9%
2019	\$642	(33.1%)	\$41,690	1.5%
2020	\$479	(25.5%)	\$36,300	1.3%
2021	\$955	99.5%	\$54,100	1.8%
2022	\$1,918	100.9%	\$86,240	2.2%
2023	\$777	(59.5%)	\$48,500	1.6%
2024	\$916	17.8%	\$51,740	1.8%

Table 11-31 shows PJM total marginal loss costs by accounting category for 2008 through 2024. Table 11-32 shows PJM total marginal loss costs by accounting category by market for 2008 through 2024.

**Table 11-31 Total marginal loss costs by accounting category (Dollars (Millions)): 2008 through 2024**

Marginal Loss Costs (Millions)				
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Inadvertent Charges
2008	(\$237.2)	(\$2,641.5)	\$92.4	\$0.0
2009	(\$78.5)	(\$1,314.3)	\$32.0	(\$0.0)
2010	(\$122.3)	(\$1,707.0)	\$50.2	(\$0.0)
2011	(\$174.0)	(\$1,551.9)	\$1.6	\$0.0
2012	(\$11.1)	(\$1,036.8)	(\$44.0)	\$0.0
2013	(\$4.1)	(\$1,083.3)	(\$43.9)	(\$0.0)
2014	(\$59.2)	(\$1,581.3)	(\$56.0)	\$0.0
2015	(\$31.7)	(\$1,021.0)	(\$20.5)	\$0.0
2016	(\$55.0)	(\$782.1)	(\$30.6)	(\$0.0)
2017	(\$40.9)	(\$766.9)	(\$35.1)	\$0.0
2018	(\$42.2)	(\$1,014.3)	(\$11.9)	\$0.0
2019	(\$44.7)	(\$703.4)	(\$16.6)	(\$0.0)
2020	(\$25.9)	(\$518.2)	(\$13.7)	\$0.0
2021	(\$2.7)	(\$966.3)	(\$8.9)	\$0.0
2022	\$165.2	(\$1,803.5)	(\$50.6)	(\$0.0)
2023	\$26.2	(\$759.7)	(\$8.8)	\$0.0
2024	\$98.0	(\$824.6)	(\$7.0)	\$0.0

<sup>33</sup> The loss costs include net inadvertent charges.

<sup>34</sup> In Table 11-30, the MMU used the total PJM billing values provided by PJM through 2018.

Starting in 2019, the total PJM billing values in Table 11-30 are modified by the MMU, to more accurately reflect PJM total billing. The total PJM billing shown in Table 11-30 is different from the total cost shown in Table 1-9. The total PJM billing in Table 11-30 represents the total dollars that pass through the PJM settlement process, while the total cost shown in Table 1-9 represents the portion of the total billing associated with the cost to load and includes additional costs to load accounted for outside the PJM settlement process.

<sup>32</sup> PJM Operating Agreement Schedule 1 §3.7.

Table 11-32 Total marginal loss costs by market (Dollars (Millions)): 2008 through 2024

	Marginal Loss Costs (Millions)									
	Day-Ahead					Balancing				
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Inadvertent Charges	Grand Total
2008	(\$158.1)	(\$2,582.2)	\$134.3	\$2,558.4	(\$79.1)	(\$59.4)	(\$42.0)	(\$61.7)	\$0.0	\$2,496.7
2009	(\$84.7)	(\$1,311.7)	\$65.4	\$1,292.3	\$6.2	(\$2.7)	(\$33.5)	(\$24.6)	(\$0.0)	\$1,267.7
2010	(\$146.3)	(\$1,716.1)	\$95.8	\$1,665.6	\$23.9	\$9.1	(\$45.6)	(\$30.8)	(\$0.0)	\$1,634.8
2011	(\$215.4)	(\$1,592.1)	\$53.8	\$1,430.5	\$41.4	\$40.2	(\$52.2)	(\$51.0)	\$0.0	\$1,379.5
2012	(\$43.0)	(\$1,060.3)	(\$13.4)	\$1,003.8	\$32.0	\$23.4	(\$30.6)	(\$22.1)	\$0.0	\$981.7
2013	(\$37.1)	(\$1,112.4)	\$62.4	\$1,137.8	\$33.0	\$29.1	(\$106.4)	(\$102.5)	(\$0.0)	\$1,035.3
2014	(\$113.9)	(\$1,618.8)	\$66.6	\$1,571.4	\$54.7	\$37.5	(\$122.5)	(\$105.3)	\$0.0	\$1,466.1
2015	(\$53.4)	(\$1,032.2)	\$33.8	\$1,012.6	\$21.7	\$11.3	(\$54.3)	(\$43.9)	\$0.0	\$968.7
2016	(\$61.7)	(\$781.6)	\$53.4	\$773.2	\$6.8	(\$0.5)	(\$84.0)	(\$76.7)	(\$0.0)	\$696.5
2017	(\$52.2)	(\$767.2)	\$54.9	\$769.9	\$11.3	\$0.3	(\$90.0)	(\$79.1)	\$0.0	\$690.8
2018	(\$48.3)	(\$1,003.8)	\$41.7	\$997.2	\$6.1	(\$10.5)	(\$53.7)	(\$37.0)	\$0.0	\$960.1
2019	(\$47.1)	(\$700.3)	\$43.3	\$696.5	\$2.4	(\$3.1)	(\$60.0)	(\$54.5)	(\$0.0)	\$642.0
2020	(\$27.6)	(\$517.4)	\$36.5	\$526.3	\$1.7	(\$0.8)	(\$50.3)	(\$47.7)	\$0.0	\$478.5
2021	(\$4.2)	(\$958.4)	\$33.7	\$987.9	\$1.5	(\$7.9)	(\$42.5)	(\$33.1)	\$0.0	\$954.8
2022	\$167.1	(\$1,786.0)	\$99.1	\$2,052.3	(\$1.9)	(\$17.5)	(\$149.8)	(\$134.2)	(\$0.0)	\$1,918.0
2023	\$27.3	(\$754.7)	\$68.2	\$850.2	(\$1.1)	(\$5.0)	(\$77.0)	(\$73.0)	\$0.0	\$777.2
2024	\$96.5	(\$827.2)	\$54.5	\$978.2	\$1.5	\$2.6	(\$61.5)	(\$62.6)	\$0.0	\$915.6

Table 11-33 and Table 11-34 show PJM accounting based total loss costs for each transaction type in 2024 and 2023.

Virtual transaction loss costs, when positive, measure the total loss costs to virtual transactions and when negative, measure the total loss credits to virtual transactions. In 2024, DEC were paid \$5.1 million in MLMP credits in the day-ahead market, paid \$7.8 million in MLMP in the balancing energy market and paid \$2.7 million in total MLMP charges. In 2024, INCs paid \$35.5 million in MLMP charges in the day-ahead market, were paid \$38.0 million in MLMP credits in the balancing energy market and were paid \$2.5 million in total MLMP credits. In 2024, up to congestion paid \$56.0 million in MLMP charges in the day-ahead market, were paid \$60.1 million in MLMP credits in the balancing energy market and received \$4.1 million in total MLMP credits.

Table 11-33 Total loss costs by transaction type (Dollars (Millions)): 2024

Transaction Type	Marginal Loss Costs (Millions)									
	Day-Ahead					Balancing				
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Inadvertent Charges	Grand Total
DEC	(\$5.1)	\$0.0	\$0.0	(\$5.1)	\$7.8	\$0.0	\$0.0	\$7.8	\$0.0	\$2.7
Demand	\$55.5	\$0.0	\$0.0	\$55.5	\$9.5	\$0.0	\$0.0	\$9.5	\$0.0	\$65.0
Demand Response	\$0.1	\$0.0	\$0.0	\$0.1	(\$0.1)	\$0.0	\$0.0	(\$0.1)	\$0.0	\$0.0
Explicit Congestion and Loss Only	\$0.0	\$0.0	(\$1.8)	(\$1.8)	\$0.0	\$0.0	(\$0.1)	(\$0.1)	\$0.0	(\$1.8)
Export	(\$17.7)	\$0.0	(\$0.3)	(\$17.9)	(\$10.1)	\$0.0	(\$1.0)	(\$11.0)	\$0.0	(\$29.0)
Generation	\$0.0	(\$851.8)	\$0.0	\$851.8	\$0.0	(\$15.9)	\$0.0	\$15.9	\$0.0	\$867.7
Import	\$0.0	(\$4.2)	\$0.0	\$4.2	\$0.0	(\$13.9)	\$0.0	\$13.9	\$0.0	\$18.1
INC	\$0.0	(\$35.5)	\$0.0	\$35.5	\$0.0	\$38.0	\$0.0	(\$38.0)	\$0.0	(\$2.5)
Internal Bilateral	\$63.7	\$64.3	\$0.6	\$0.0	(\$5.6)	(\$5.6)	\$0.0	(\$0.0)	\$0.0	(\$0.0)
Up to Congestion	\$0.0	\$0.0	\$56.0	\$56.0	\$0.0	\$0.0	(\$60.1)	(\$60.1)	\$0.0	(\$4.1)
Wheel In	\$0.0	\$0.0	(\$0.1)	(\$0.1)	\$0.0	\$0.0	(\$0.3)	(\$0.3)	\$0.0	(\$0.4)
Total	\$96.5	(\$827.2)	\$54.5	\$978.2	\$1.5	\$2.6	(\$61.5)	(\$62.6)	\$0.0	\$915.6

**Table 11-34 Total loss costs by transaction type (Dollars (Millions)): 2023**

Transaction Type	Marginal Loss Costs (Millions)									
	Day-Ahead					Balancing				
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Inadvertent Charges	Grand Total
DEC	(\$3.6)	\$0.0	\$0.0	(\$3.6)	\$5.3	\$0.0	\$0.0	\$5.3	\$0.0	\$1.8
Demand	\$16.2	\$0.0	\$0.0	\$16.2	\$9.0	\$0.0	\$0.0	\$9.0	\$0.0	\$25.2
Demand Response	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.0)	\$0.0	\$0.0	(\$0.0)	\$0.0	(\$0.0)
Explicit Congestion and Loss Only	\$0.0	\$0.0	(\$1.3)	(\$1.3)	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$0.0	(\$1.3)
Export	(\$19.4)	\$0.0	(\$0.2)	(\$19.6)	(\$10.5)	\$0.0	(\$0.8)	(\$11.4)	\$0.0	(\$31.0)
Generation	\$0.0	(\$761.0)	\$0.0	\$761.0	\$0.0	(\$17.1)	\$0.0	\$17.1	\$0.0	\$778.1
Import	\$0.0	(\$3.5)	\$0.0	\$3.5	\$0.0	(\$8.8)	\$0.0	\$8.8	\$0.0	\$12.3
INC	\$0.0	(\$24.7)	\$0.0	\$24.7	\$0.0	\$25.7	\$0.0	(\$25.7)	\$0.0	(\$1.0)
Internal Bilateral	\$34.0	\$34.5	\$0.5	\$0.0	(\$4.9)	(\$4.9)	\$0.0	(\$0.0)	\$0.0	(\$0.0)
Up to Congestion	\$0.0	\$0.0	\$69.3	\$69.3	\$0.0	\$0.0	(\$75.8)	(\$75.8)	\$0.0	(\$6.6)
Wheel In	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$0.0	\$0.0	(\$0.3)	(\$0.3)	\$0.0	(\$0.3)
Total	\$27.3	(\$754.7)	\$68.2	\$850.2	(\$1.1)	(\$5.0)	(\$77.0)	(\$73.0)	\$0.0	\$777.2

Table 11-35 compares MLMP credits and charges for each transaction type between the dispatch run and pricing run in 2024. Total MLMP charges to generation increased by \$2.6 million, and total MLMP charges to demand increased by \$1.0 million from the dispatch run to the pricing run. The total MLMP charges to DEC's increased by \$0.5 million, the total MLMP credits to INCs decreased by \$2.8 million and the total CLMP credits to UTCs decreased by \$4.6 million from the dispatch run to the pricing run.

**Table 11-35 Total loss costs by dispatch and pricing run (Dollars (Millions)): 2024**

Transaction Type	Marginal Loss Costs (Millions)								
	Dispatch Run			Pricing Run			Difference		
	Day-Ahead	Balancing	Total	Day-Ahead	Balancing	Total	Day-Ahead	Balancing	Total
DEC	(\$5.1)	\$7.3	\$2.2	(\$5.1)	\$7.8	\$2.7	(\$0.0)	\$0.5	\$0.5
Demand	\$55.3	\$8.7	\$64.0	\$55.5	\$9.5	\$65.0	\$0.2	\$0.8	\$1.0
Demand Response	\$0.1	(\$0.1)	\$0.0	\$0.1	(\$0.1)	\$0.0	\$0.0	(\$0.0)	(\$0.0)
Explicit Congestion and Loss Only	(\$1.8)	(\$0.1)	(\$1.8)	(\$1.8)	(\$0.1)	(\$1.8)	(\$0.0)	(\$0.0)	(\$0.0)
Export	(\$17.9)	(\$10.4)	(\$28.2)	(\$17.9)	(\$11.0)	(\$29.0)	(\$0.0)	(\$0.7)	(\$0.7)
Generation	\$850.1	\$15.0	\$865.0	\$851.8	\$15.9	\$867.7	\$1.7	\$0.9	\$2.6
Import	\$4.2	\$12.8	\$17.0	\$4.2	\$13.9	\$18.1	\$0.0	\$1.1	\$1.1
INC	\$35.4	(\$35.2)	\$0.3	\$35.5	(\$38.0)	(\$2.5)	\$0.1	(\$2.9)	(\$2.8)
Internal Bilateral	\$0.0	(\$0.0)	(\$0.0)	\$0.0	(\$0.0)	(\$0.0)	\$0.0	(\$0.0)	(\$0.0)
Up to Congestion	\$55.9	(\$55.3)	\$0.5	\$56.0	(\$60.1)	(\$4.1)	\$0.1	(\$4.8)	(\$4.6)
Wheel In	(\$0.1)	(\$0.3)	(\$0.4)	(\$0.1)	(\$0.3)	(\$0.4)	(\$0.0)	(\$0.0)	(\$0.0)
Total	\$976.2	(\$57.6)	\$918.6	\$978.2	(\$62.6)	\$915.6	\$2.0	(\$5.0)	(\$3.0)

## Monthly Marginal Loss Costs

Table 11-36 shows a monthly summary of marginal loss costs by market type for 2023 through 2024.

**Table 11-36 Monthly marginal loss costs (Millions): 2023 through 2024**

	Marginal Loss Costs (Millions)							
	2023				2024			
	Day-Ahead		Inadvertent		Day-Ahead		Inadvertent	
	Charges	Balancing	Charges	Total	Charges	Balancing	Charges	Total
Jan	\$88.3	(\$9.5)	(\$0.0)	\$78.8	\$137.5	(\$9.5)	\$0.0	\$128.1
Feb	\$73.0	(\$6.7)	(\$0.0)	\$66.3	\$52.0	(\$4.7)	\$0.0	\$47.3
Mar	\$61.5	(\$5.4)	\$0.0	\$56.1	\$46.7	(\$5.1)	(\$0.0)	\$41.5
Apr	\$51.2	(\$4.2)	\$0.0	\$47.0	\$48.6	(\$4.0)	\$0.0	\$44.6
May	\$57.2	(\$8.0)	(\$0.0)	\$49.1	\$72.6	(\$4.3)	\$0.0	\$68.2
Jun	\$59.0	(\$6.1)	\$0.0	\$52.9	\$84.8	(\$5.0)	\$0.0	\$79.7
Jul	\$109.7	(\$7.2)	\$0.0	\$102.5	\$136.4	(\$6.7)	\$0.0	\$129.8
Aug	\$77.0	(\$5.9)	\$0.0	\$71.0	\$103.8	(\$6.4)	\$0.0	\$97.4
Sep	\$70.0	(\$5.4)	\$0.0	\$64.6	\$62.9	(\$4.4)	\$0.0	\$58.5
Oct	\$68.5	(\$4.7)	\$0.0	\$63.8	\$67.1	(\$4.2)	\$0.0	\$63.0
Nov	\$69.0	(\$4.9)	\$0.0	\$64.1	\$59.3	(\$2.5)	(\$0.0)	\$56.8
Dec	\$65.8	(\$5.0)	\$0.0	\$60.8	\$106.5	(\$5.8)	(\$0.0)	\$100.7
Total	\$850.2	(\$73.0)	\$0.0	\$777.2	\$978.2	(\$62.6)	\$0.0	\$915.6

Figure 11-11 shows PJM monthly marginal loss costs for 2008 through 2024.

**Figure 11-11 Monthly marginal loss cost (Dollars (Millions)): 2008 through 2024**

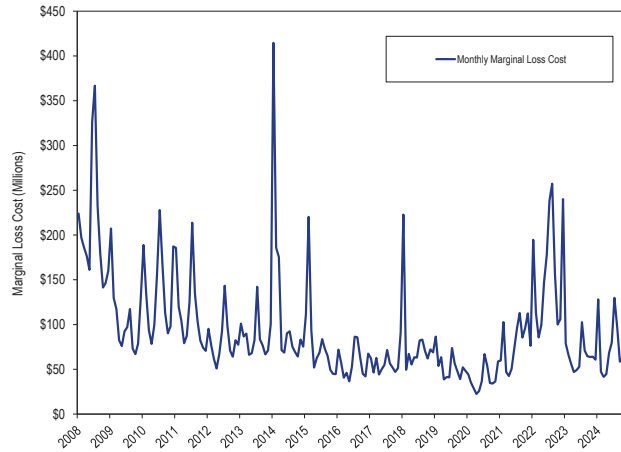


Table 11-37 shows the monthly total loss charges for each virtual transaction type for 2023 through 2024. In 2024, 105.6 percent of the total credits to virtuals went to UTCs, compared to 112.9 percent in 2023.

**Table 11-37 Monthly loss charges by virtual transaction type (Dollars (Millions)): 2023 through 2024**

Marginal Loss Charges (Millions)											
DEC				INC			Up to Congestion			Grand	
Year	Day-Ahead	Balancing	Total	Day-Ahead	Balancing	Total	Day-Ahead	Balancing	Total	Total	
2023											
Jan	(\$0.1)	\$0.2	\$0.1	\$2.4	(\$3.0)	(\$0.5)	\$8.2	(\$9.9)	(\$1.7)	(\$2.1)	
Feb	\$0.6	(\$0.2)	\$0.5	\$2.4	(\$2.5)	(\$0.1)	\$5.6	(\$5.8)	(\$0.3)	\$0.1	
Mar	(\$0.6)	\$0.7	\$0.1	\$1.9	(\$2.2)	(\$0.4)	\$5.0	(\$5.7)	(\$0.7)	(\$1.0)	
Apr	(\$0.7)	\$0.6	(\$0.0)	\$2.0	(\$2.0)	\$0.0	\$4.6	(\$5.1)	(\$0.4)	(\$0.4)	
May	(\$0.4)	\$0.6	\$0.1	\$2.0	(\$1.8)	\$0.2	\$8.5	(\$8.4)	\$0.1	\$0.4	
Jun	(\$0.7)	\$0.6	(\$0.1)	\$1.3	(\$1.1)	\$0.3	\$6.4	(\$6.1)	\$0.3	\$0.5	
Jul	(\$0.7)	\$1.3	\$0.6	\$1.8	(\$1.6)	\$0.1	\$7.3	(\$8.3)	(\$1.0)	(\$0.3)	
Aug	(\$0.5)	\$0.6	\$0.1	\$1.6	(\$1.6)	\$0.0	\$4.6	(\$5.9)	(\$1.3)	(\$1.2)	
Sep	(\$0.1)	\$0.3	\$0.2	\$1.6	(\$1.6)	(\$0.1)	\$4.4	(\$5.4)	(\$1.0)	(\$0.8)	
Oct	(\$0.2)	\$0.1	(\$0.0)	\$3.8	(\$3.7)	\$0.1	\$4.4	(\$4.2)	\$0.2	\$0.2	
Nov	(\$0.4)	\$0.5	\$0.1	\$2.4	(\$2.9)	(\$0.4)	\$5.4	(\$5.6)	(\$0.2)	(\$0.5)	
Dec	\$0.1	\$0.0	\$0.1	\$1.6	(\$1.8)	(\$0.3)	\$4.8	(\$5.4)	(\$0.6)	(\$0.8)	
Total	(\$3.6)	\$5.3	\$1.8	\$24.7	(\$25.7)	(\$1.0)	\$69.3	(\$75.8)	(\$6.6)	(\$5.8)	
2024											
Jan	(\$0.5)	\$0.5	(\$0.1)	\$3.2	(\$3.6)	(\$0.4)	\$9.0	(\$9.5)	(\$0.5)	(\$0.9)	
Feb	(\$0.7)	\$0.7	\$0.0	\$2.0	(\$2.5)	(\$0.5)	\$4.0	(\$4.9)	(\$0.8)	(\$1.3)	
Mar	(\$0.5)	\$0.5	(\$0.0)	\$2.5	(\$2.7)	(\$0.2)	\$4.6	(\$5.1)	(\$0.5)	(\$0.7)	
Apr	(\$0.7)	\$0.8	\$0.1	\$3.8	(\$3.5)	\$0.3	\$4.3	(\$4.2)	\$0.2	\$0.6	
May	(\$0.3)	\$0.5	\$0.2	\$4.0	(\$4.2)	(\$0.2)	\$4.7	(\$5.1)	(\$0.3)	(\$0.4)	
Jun	(\$0.6)	\$1.0	\$0.4	\$2.5	(\$2.9)	(\$0.5)	\$4.8	(\$5.1)	(\$0.3)	(\$0.4)	
Jul	\$0.2	\$0.9	\$1.1	\$3.1	(\$3.9)	(\$0.8)	\$5.6	(\$5.8)	(\$0.2)	\$0.0	
Aug	(\$0.2)	\$0.7	\$0.5	\$2.3	(\$2.5)	(\$0.1)	\$4.1	(\$4.6)	(\$0.5)	(\$0.1)	
Sep	(\$0.7)	\$0.6	(\$0.0)	\$1.6	(\$1.5)	\$0.1	\$2.9	(\$3.6)	(\$0.7)	(\$0.6)	
Oct	(\$0.6)	\$0.8	\$0.2	\$3.4	(\$3.0)	\$0.4	\$4.0	(\$4.0)	(\$0.0)	\$0.5	
Nov	(\$0.7)	\$0.6	(\$0.0)	\$2.9	(\$3.0)	(\$0.1)	\$2.5	(\$2.8)	(\$0.3)	(\$0.4)	
Dec	\$0.3	\$0.2	\$0.5	\$4.2	(\$4.7)	(\$0.5)	\$5.4	(\$5.5)	(\$0.0)	(\$0.1)	
Total	(\$5.1)	\$7.8	\$2.7	\$35.5	(\$38.0)	(\$2.5)	\$56.0	(\$60.1)	(\$4.1)	(\$3.9)	

## Marginal Loss Costs and Loss Credits

Total marginal loss surplus is calculated by adding the total system energy costs (which are negative), the total marginal loss costs (which are positive) and net residual market adjustments (which can be net positive or negative). The total system energy costs are equal to the net implicit energy charges (implicit withdrawal charges minus implicit injection credits) plus net inadvertent energy charges. Total marginal loss costs are equal to the net implicit marginal loss charges (implicit load MLMP charges less implicit generation MLMP credits) plus net explicit loss charges plus net inadvertent loss charges.

Ignoring interchange, total generation MWh must be greater than total load MWh in any hour in order to provide for losses. Since the hourly integrated energy component of LMP is the same for every bus within every hour, the net energy bill is negative (ignoring net interchange), with more injection credits than withdrawal charges in every hour. The greater the level of load the greater the difference between energy charges collected from load (SMP x load MW) and credited to generation (SMP x generation MW). Total system energy costs plus total marginal loss costs plus net

residual market adjustments equal marginal loss credits which are distributed to the PJM market participants according to the ratio of their real-time load plus their real-time exports to total PJM real-time load plus real-time exports as marginal loss credits. The net residual market adjustment is calculated as known day-ahead error value minus day-ahead loss MW congestion value and minus balancing loss MW congestion value.

Table 11-38 shows the total system energy costs, the total marginal loss costs collected, the net residual market adjustments and total marginal loss surplus redistributed for 2008 through 2024. The total marginal loss surplus increased by \$75.8 million or 28.7 percent in 2024 from 2023.

**Table 11-38 Marginal loss surplus (Dollars (Millions)):  
2008 through 2024<sup>35</sup>**

Marginal Loss Surplus (Millions)						
	System Energy Cost	Marginal Loss Costs	Net Residual Market Adjustments			Total Marginal Loss Surplus
			Known Day-Ahead Error	Day-Ahead Loss MW Congestion	Balancing Loss MW Congestion	
2008	(\$1,193.2)	\$2,496.7	\$0.0	\$0.0	\$0.0	\$1,303.5
2009	(\$628.8)	\$1,267.7	(\$0.0)	(\$0.4)	(\$0.1)	\$639.4
2010	(\$797.9)	\$1,634.8	\$0.0	(\$0.7)	(\$0.0)	\$837.7
2011	(\$793.8)	\$1,379.5	\$0.1	\$0.7	(\$0.0)	\$585.2
2012	(\$593.0)	\$981.7	\$0.1	(\$1.0)	\$0.1	\$389.6
2013	(\$687.6)	\$1,035.3	\$0.0	\$2.0	(\$0.0)	\$345.7
2014	(\$977.7)	\$1,466.1	\$0.0	(\$0.0)	(\$0.0)	\$488.4
2015	(\$627.4)	\$968.7	(\$0.0)	\$6.3	\$0.1	\$335.0
2016	(\$466.3)	\$696.5	(\$0.0)	\$5.1	(\$0.1)	\$225.2
2017	(\$475.2)	\$690.8	(\$0.0)	\$3.2	(\$0.2)	\$212.6
2018	(\$636.7)	\$960.1	\$0.0	\$1.1	(\$0.1)	\$322.4
2019	(\$435.2)	\$642.0	(\$0.0)	\$3.2	(\$0.1)	\$203.7
2020	(\$317.4)	\$478.5	(\$0.0)	\$1.7	(\$0.1)	\$159.6
2021	(\$623.2)	\$954.8	(\$0.0)	\$1.3	(\$0.1)	\$330.4
2022	(\$1,282.1)	\$1,918.0	(\$0.0)	\$2.0	(\$0.1)	\$633.9
2023	(\$507.5)	\$777.2	(\$0.0)	\$5.9	(\$0.3)	\$264.0
2024	(\$574.1)	\$915.6	(\$0.0)	\$2.0	(\$0.3)	\$339.8

<sup>35</sup> The net residual market adjustments included in the table are comprised of the known day-ahead error value minus the sum of the day-ahead loss MW congestion value, balancing loss MW congestion value and measurement error caused by missing data.

## System Energy Costs Energy Accounting

The system energy component of LMP is the system reference bus LMP, also called the system marginal price (SMP). The system energy cost is based on the day-ahead and real-time energy components of LMP. Total system energy costs, analogous to total congestion costs or total loss costs, are equal to the withdrawal energy charges minus injection energy credits, in both the day-ahead energy market and the balancing energy market, plus net inadvertent energy charges. Total system energy costs can be more accurately thought of as net system energy costs. Due to line losses associated with moving energy from generation to load, more energy is injected by generation than is withdrawn by load. Total system energy charges are negative because there are, due to losses, more generation MW being paid SMP (energy component of price) than load MW paying SMP (the energy component of price).

## Total System Energy Costs

The total system energy cost for 2024 was -\$574.1 million, which was comprised of implicit withdrawal energy charges of \$39,010.2 million, implicit injection energy credits of \$39,593.5 million, explicit energy charges of \$0.0 million and inadvertent energy charges of \$9.2 million. The monthly system energy costs for 2024 ranged from -\$86.3 million in January to -\$27.6 million in March. Table 11-39 shows total system energy costs and total PJM billing, for 2008 through 2024.



**Table 11-39 Total system energy costs (Dollars (Millions)): 2008 through 2024<sup>36 37</sup>**

	System Energy Costs	Percent Change	Total PJM Billing	Percent of PJM Billing
2008	(\$1,193)	NA	\$34,300	(3.5%)
2009	(\$629)	(47.3%)	\$26,550	(2.4%)
2010	(\$798)	26.9%	\$34,770	(2.3%)
2011	(\$794)	(0.5%)	\$35,890	(2.2%)
2012	(\$593)	(25.3%)	\$29,180	(2.0%)
2013	(\$688)	15.9%	\$33,860	(2.0%)
2014	(\$978)	42.2%	\$50,030	(2.0%)
2015	(\$627)	(35.8%)	\$42,630	(1.5%)
2016	(\$466)	(25.7%)	\$39,050	(1.2%)
2017	(\$475)	1.9%	\$40,170	(1.2%)
2018	(\$637)	34.0%	\$49,790	(1.3%)
2019	(\$435)	(31.6%)	\$41,690	(1.0%)
2020	(\$317)	(27.1%)	\$36,300	(0.9%)
2021	(\$623)	96.4%	\$54,100	(1.2%)
2022	(\$1,282)	105.7%	\$86,240	(1.5%)
2023	(\$508)	(60.4%)	\$48,500	(1.0%)
2024	(\$574)	13.1%	\$51,740	(1.1%)

System energy costs for 2008 through 2024 are shown in Table 11-40 and Table 11-41. Table 11-40 shows PJM system energy costs by accounting category and Table 11-41 shows PJM system energy costs by market category.

**Table 11-40 Total system energy costs by accounting category (Dollars (Millions)): 2008 through 2024**

System Energy Costs (Millions)					
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Inadvertent Charges	Total
2008	\$105,665.6	\$106,860.0	\$0.0	\$1.2	(\$1,193.2)
2009	\$42,535.2	\$43,165.7	\$0.0	\$1.7	(\$628.8)
2010	\$53,101.5	\$53,886.9	\$0.0	(\$12.6)	(\$797.9)
2011	\$47,658.9	\$48,481.0	\$0.0	\$28.3	(\$793.8)
2012	\$37,471.3	\$38,073.5	\$0.0	\$9.1	(\$593.0)
2013	\$42,774.3	\$43,454.6	\$0.0	(\$7.4)	(\$687.6)
2014	\$60,258.5	\$61,232.0	\$0.0	(\$4.2)	(\$977.7)
2015	\$40,601.8	\$41,231.9	\$0.0	\$2.7	(\$627.4)
2016	\$34,053.6	\$34,510.1	\$0.0	(\$9.8)	(\$466.3)
2017	\$35,152.1	\$35,634.4	\$0.0	\$7.1	(\$475.2)
2018	\$43,805.9	\$44,447.2	\$0.0	\$4.6	(\$636.7)
2019	\$30,647.4	\$31,081.1	\$0.0	(\$1.5)	(\$435.2)
2020	\$23,400.9	\$23,720.8	\$0.0	\$2.5	(\$317.4)
2021	\$42,312.4	\$42,938.3	\$0.0	\$2.7	(\$623.2)
2022	\$83,241.0	\$84,502.1	\$0.0	(\$21.0)	(\$1,282.1)
2023	\$35,212.8	\$35,724.7	\$0.0	\$4.3	(\$507.5)
2024	\$39,010.2	\$39,593.5	\$0.0	\$9.2	(\$574.1)

<sup>36</sup> The system energy costs include net inadvertent charges.

<sup>37</sup> In Table 11-39, the MMU used the total PJM billing values provided by PJM through 2018. Starting in 2019, the total PJM billing values in Table 11-39 are modified by the MMU, to more accurately reflect PJM total billing. The total PJM billing shown in Table 11-39 is different from the total cost shown in Table 1-9. The total PJM billing in Table 11-39 represents the total dollars that pass through the PJM settlement process, while the total cost shown in Table 1-9 represents the portion of the total billing associated with the cost to load and includes additional costs to load accounted for outside the PJM settlement process.

Table 11-41 Total system energy costs by market (Dollars (Millions)): 2008 through 2024

System Energy Costs (Millions)										
Day-Ahead					Balancing					
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Inadvertent Charges	Grand Total
2008	\$81,789.8	\$83,120.0	\$0.0	(\$1,330.1)	\$23,875.8	\$23,740.0	\$0.0	\$135.7	\$1.2	(\$1,193.2)
2009	\$42,683.8	\$43,351.2	\$0.0	(\$667.4)	(\$148.5)	(\$185.5)	\$0.0	\$36.9	\$1.7	(\$628.8)
2010	\$53,164.9	\$53,979.1	\$0.0	(\$814.1)	(\$63.4)	(\$92.2)	\$0.0	\$28.8	(\$12.6)	(\$797.9)
2011	\$48,144.9	\$48,880.0	\$0.0	(\$735.2)	(\$485.9)	(\$399.1)	\$0.0	(\$86.9)	\$28.3	(\$793.8)
2012	\$37,641.2	\$38,251.1	\$0.0	(\$609.9)	(\$169.9)	(\$177.6)	\$0.0	\$7.7	\$9.1	(\$593.0)
2013	\$42,795.2	\$43,628.9	\$0.0	(\$833.7)	(\$20.9)	(\$174.4)	\$0.0	\$153.5	(\$7.4)	(\$687.6)
2014	\$60,325.2	\$61,668.9	\$0.0	(\$1,343.7)	(\$66.7)	(\$436.9)	\$0.0	\$370.2	(\$4.2)	(\$977.7)
2015	\$40,837.8	\$41,595.7	\$0.0	(\$757.9)	(\$236.0)	(\$363.8)	\$0.0	\$127.8	\$2.7	(\$627.4)
2016	\$34,245.1	\$34,885.7	\$0.0	(\$640.6)	(\$191.5)	(\$375.6)	\$0.0	\$184.0	(\$9.8)	(\$466.3)
2017	\$35,490.1	\$36,138.6	\$0.0	(\$648.5)	(\$338.0)	(\$504.2)	\$0.0	\$166.2	\$7.1	(\$475.2)
2018	\$43,948.7	\$44,659.7	\$0.0	(\$711.0)	(\$142.9)	(\$212.6)	\$0.0	\$69.7	\$4.6	(\$636.7)
2019	\$31,034.3	\$31,562.9	\$0.0	(\$528.6)	(\$386.9)	(\$481.8)	\$0.0	\$94.9	(\$1.5)	(\$435.2)
2020	\$23,581.5	\$23,983.0	\$0.0	(\$401.4)	(\$180.6)	(\$262.2)	\$0.0	\$81.6	\$2.5	(\$317.4)
2021	\$42,431.6	\$43,109.9	\$0.0	(\$678.2)	(\$119.3)	(\$171.5)	\$0.0	\$52.3	\$2.7	(\$623.2)
2022	\$83,732.0	\$85,218.2	\$0.0	(\$1,486.2)	(\$491.1)	(\$716.1)	\$0.0	\$225.0	(\$21.0)	(\$1,282.1)
2023	\$35,515.2	\$36,181.3	\$0.0	(\$666.0)	(\$302.4)	(\$456.6)	\$0.0	\$154.2	\$4.3	(\$507.5)
2024	\$39,589.4	\$40,275.4	\$0.0	(\$685.9)	(\$579.3)	(\$681.9)	\$0.0	\$102.6	\$9.2	(\$574.1)

Table 11-42 and Table 11-43 show the total system energy costs for each transaction type in 2024 and 2023. In 2024, generation was paid \$27,961.2 million and demand paid \$26,463.7 million in net energy payment. In 2023, generation was paid \$25,676.0 million and demand paid \$24,042.3 million in net energy payment.

Table 11-42 Total system energy costs by transaction type (Dollars (Millions)): 2024

System Energy Costs (Millions)									
Transaction Type	Day-Ahead				Balancing				Grand Total
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	
DEC	\$1,606.3	\$0.0	\$0.0	\$1,606.3	(\$1,609.9)	\$0.0	\$0.0	(\$1,609.9)	(\$3.6)
Demand	\$26,085.0	\$0.0	\$0.0	\$26,085.0	\$378.7	\$0.0	\$0.0	\$378.7	\$26,463.7
Demand Response	(\$12.5)	\$0.0	\$0.0	(\$12.5)	\$12.1	\$0.0	\$0.0	\$12.1	(\$0.4)
Export	\$1,014.3	\$0.0	\$0.0	\$1,014.3	\$428.9	\$0.0	\$0.0	\$428.9	\$1,443.1
Generation	\$0.0	\$27,878.6	\$0.0	(\$27,878.6)	\$0.0	\$82.6	\$0.0	(\$82.6)	(\$27,961.2)
Import	\$0.0	\$106.6	\$0.0	(\$106.6)	\$0.0	\$423.0	\$0.0	(\$423.0)	(\$529.6)
INC	\$0.0	\$1,393.9	\$0.0	(\$1,393.9)	\$0.0	(\$1,398.5)	\$0.0	\$1,398.5	\$4.7
Internal Bilateral	\$10,889.9	\$10,889.9	\$0.0	\$0.0	\$178.1	\$178.1	\$0.0	\$0.0	\$0.0
Wheel In	\$0.0	\$6.3	\$0.0	(\$6.3)	\$0.0	\$33.0	\$0.0	(\$33.0)	(\$39.3)
Wheel Out	\$6.3	\$0.0	\$0.0	\$6.3	\$33.0	\$0.0	\$0.0	\$33.0	\$39.3
Total	\$39,589.4	\$40,275.4	\$0.0	(\$685.9)	(\$579.3)	(\$681.9)	\$0.0	\$102.6	(\$583.3)

Table 11-43 Total system energy costs by transaction type by (Dollars (Millions)): 2023

System Energy Costs (Millions)									
Transaction Type	Day-Ahead				Balancing				Grand Total
	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	Implicit Withdrawal Charges	Implicit Injection Credits	Explicit Charges	Total	
DEC	\$1,364.5	\$0.0	\$0.0	\$1,364.5	(\$1,339.3)	\$0.0	\$0.0	(\$1,339.3)	\$25.3
Demand	\$23,775.8	\$0.0	\$0.0	\$23,775.8	\$266.4	\$0.0	\$0.0	\$266.4	\$24,042.3
Demand Response	(\$3.2)	\$0.0	\$0.0	(\$3.2)	\$2.8	\$0.0	\$0.0	\$2.8	(\$0.4)
Export	\$1,018.8	\$0.0	\$0.0	\$1,018.8	\$544.4	\$0.0	\$0.0	\$544.4	\$1,563.2
Generation	\$0.0	\$25,512.2	\$0.0	(\$25,512.2)	\$0.0	\$163.8	\$0.0	(\$163.8)	(\$25,676.0)
Import	\$0.0	\$108.6	\$0.0	(\$108.6)	\$0.0	\$335.0	\$0.0	(\$335.0)	(\$443.5)
INC	\$0.0	\$1,201.2	\$0.0	(\$1,201.2)	\$0.0	(\$1,178.5)	\$0.0	\$1,178.5	(\$22.6)
Internal Bilateral	\$9,357.1	\$9,357.1	\$0.0	(\$0.0)	\$184.3	\$184.3	\$0.0	(\$0.0)	(\$0.0)
Wheel In	\$0.0	\$2.2	\$0.0	(\$2.2)	\$0.0	\$38.9	\$0.0	(\$38.9)	(\$41.1)
Wheel Out	\$2.2	\$0.0	\$0.0	\$2.2	\$38.9	\$0.0	\$0.0	\$38.9	\$41.1
Total	\$35,515.2	\$36,181.3	\$0.0	(\$666.0)	(\$302.4)	(\$456.6)	\$0.0	\$154.2	(\$511.8)

Table 11-44 compares the total system energy costs for each transaction type between the dispatch run and the pricing run in 2024. The system energy charges to demand increased \$87.5 million, and the energy credits to generation decreased \$58.5 million from the dispatch run to the pricing run. The energy charges to DEC decreased \$120.4 million, the energy credits to INC increased \$103.6 million from the dispatch run to the pricing run.

**Table 11-44 Total system energy costs by dispatch and pricing run (Dollars (Millions)): 2024**

Transaction Type	System Energy Costs (Millions)								
	Dispatch Run			Pricing Run			Difference		
	Day-Ahead	Balancing	Total	Day-Ahead	Balancing	Total	Day-Ahead	Balancing	Total
DEC	\$1,603.0	(\$1,486.3)	\$116.8	\$1,606.3	(\$1,609.9)	(\$3.6)	\$3.3	(\$123.7)	(\$120.4)
Demand	\$26,032.6	\$343.6	\$26,376.2	\$26,085.0	\$378.7	\$26,463.7	\$52.5	\$35.0	\$87.5
Demand Response	(\$12.4)	\$11.1	(\$1.4)	(\$12.5)	\$12.1	(\$0.4)	(\$0.0)	\$1.0	\$1.0
Export	\$1,012.2	\$405.1	\$1,417.3	\$1,014.3	\$428.9	\$1,443.1	\$2.1	\$23.8	\$25.8
Generation	(\$27,822.2)	(\$80.6)	(\$27,902.7)	(\$27,878.6)	(\$82.6)	(\$27,961.2)	(\$56.4)	(\$2.1)	(\$58.5)
Import	(\$106.4)	(\$388.7)	(\$495.1)	(\$106.6)	(\$423.0)	(\$529.6)	(\$0.2)	(\$34.2)	(\$34.4)
INC	(\$1,391.4)	\$1,292.4	(\$99.0)	(\$1,393.9)	\$1,398.5	\$4.7	(\$2.5)	\$106.1	\$103.6
Internal Bilateral	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0
Wheel In	(\$6.3)	(\$30.3)	(\$36.6)	(\$6.3)	(\$33.0)	(\$39.3)	(\$0.0)	(\$2.7)	(\$2.7)
Wheel Out	\$6.3	\$30.3	\$36.6	\$6.3	\$33.0	\$39.3	\$0.0	\$2.7	\$2.7
Total	(\$684.6)	\$96.7	(\$587.9)	(\$685.9)	\$102.6	(\$583.3)	(\$1.3)	\$5.9	\$4.6

## Monthly System Energy Costs

Table 11-45 shows a monthly summary of system energy costs by market type for 2023 through 2024. Total balancing system energy costs in 2024 decreased in every month compared to 2023 except for August and December. Monthly total system energy costs in 2024 ranged from -\$86.3 million in January to -\$27.6 million in March.

**Table 11-45 Monthly system energy costs (Dollars (Millions)): 2023 through 2024**

	System Energy Costs (Millions)							
	2023				2024			
	Inadvertent				Inadvertent			
	Day-Ahead	Balancing	Charges	Total	Day-Ahead	Balancing	Charges	Total
Jan	(\$73.0)	\$20.8	(\$0.7)	(\$52.9)	(\$99.5)	\$12.5	\$0.7	(\$86.3)
Feb	(\$59.1)	\$14.4	(\$0.4)	(\$45.1)	(\$39.3)	\$7.7	\$0.0	(\$31.7)
Mar	(\$49.6)	\$12.1	\$0.0	(\$37.5)	(\$36.8)	\$9.3	(\$0.1)	(\$27.6)
Apr	(\$47.1)	\$15.0	\$0.3	(\$31.8)	(\$36.3)	\$7.2	\$0.3	(\$28.8)
May	(\$51.0)	\$18.4	(\$0.0)	(\$32.6)	(\$51.6)	\$9.0	\$1.0	(\$41.6)
Jun	(\$48.9)	\$14.4	\$0.8	(\$33.8)	(\$58.1)	\$7.2	\$2.0	(\$49.0)
Jul	(\$79.5)	\$13.5	\$1.6	(\$64.5)	(\$88.1)	\$9.9	\$3.3	(\$74.9)
Aug	(\$55.4)	\$9.2	\$0.9	(\$45.2)	(\$68.7)	\$9.6	\$1.5	(\$57.6)
Sep	(\$50.3)	\$8.4	\$0.8	(\$41.2)	(\$44.4)	\$6.3	\$0.7	(\$37.4)
Oct	(\$51.1)	\$9.6	\$0.9	(\$40.6)	(\$47.2)	\$7.5	\$0.3	(\$39.4)
Nov	(\$51.6)	\$8.6	\$0.1	(\$42.9)	(\$42.5)	\$5.5	(\$0.1)	(\$37.1)
Dec	(\$49.4)	\$9.8	\$0.2	(\$39.4)	(\$73.3)	\$10.9	(\$0.4)	(\$62.9)
Total	(\$666.0)	\$154.2	\$4.3	(\$507.5)	(\$685.9)	\$102.6	\$9.2	(\$574.1)

Figure 11-12 shows PJM monthly system energy costs for 2008 through 2024. Ignoring interchange, total generation MWh must be greater than total load MWh in any hour in order to provide for losses. Since the hourly integrated energy component of LMP (SMP) is the same for every bus in the market in every hour, the net energy bill is always negative (ignoring net interchange):  $(\text{SMP} \times \text{withdrawals} + \text{SMP} \times \text{injections}) < 0$ . Assuming power balance is maintained in the presence of losses, the greater the level of load the greater the difference between energy charges collected from load ( $\text{SMP} \times \text{load MW}$ ) and credited to generation ( $\text{SMP} \times \text{generation MW}$ ). With higher load levels, there are generally higher SMPs and more negative total energy charges.

**Figure 11-12 Monthly system energy costs (Millions): 2008 through 2024**

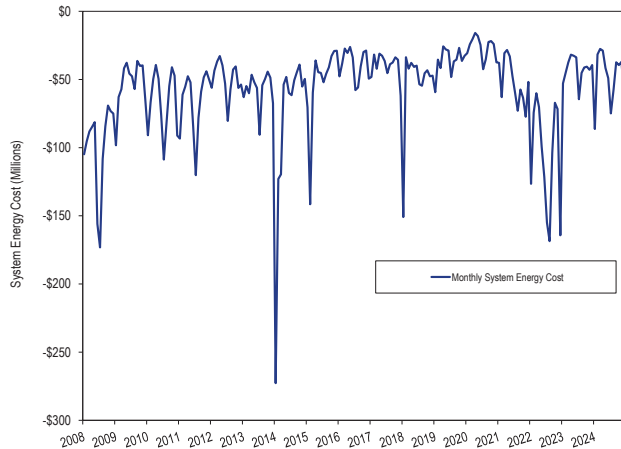


Table 11-46 shows the monthly total system energy costs for each virtual transaction type in 2024 and 2023. In 2024, DEC's paid \$1,606.3 million in energy charges compared to \$1,364.5 million in 2023 in the day-ahead market, were paid \$1,609.9 million in energy credits compared to \$1,339.3 million in 2023 in the balancing energy market and paid \$3.6 million in total energy charges compared to \$25.3 million in total energy credits in 2023. In 2024, INC's were paid \$1,393.9 million in energy credits compared to \$1,201.2 million in 2023 in the day-ahead market, paid \$1,398.5 million in energy charges compared to \$1,178.5 million in 2023 in the balancing market and were paid \$4.7 million in total energy credits compared to \$22.6 million in total energy charges in 2023. The system energy costs are zero for UTCs because the system energy costs for UTCs equal the difference in the energy component between source and sink and the energy component is the same at all buses.

**Table 11-46 Monthly energy charges by virtual transaction type (Dollars (Millions)): 2023 through 2024**

Energy Charges (Millions)								
DEC					INC			Grand Total
Year		Day-Ahead	Balancing	Total	Day-Ahead	Balancing	Total	
2023	Jan	\$124.3	(\$121.1)	\$3.2	(\$105.9)	\$103.3	(\$2.6)	\$0.7
	Feb	\$102.2	(\$84.4)	\$17.8	(\$98.3)	\$84.1	(\$14.1)	\$3.7
	Mar	\$101.0	(\$102.2)	(\$1.2)	(\$94.5)	\$94.2	(\$0.3)	(\$1.5)
	Apr	\$78.6	(\$76.9)	\$1.7	(\$106.0)	\$104.6	(\$1.4)	\$0.3
	May	\$92.1	(\$90.2)	\$1.8	(\$99.1)	\$97.5	(\$1.6)	\$0.2
	Jun	\$115.4	(\$113.1)	\$2.3	(\$81.5)	\$79.4	(\$2.0)	\$0.3
	Jul	\$167.5	(\$162.5)	\$5.0	(\$100.7)	\$99.0	(\$1.6)	\$3.3
	Aug	\$148.2	(\$154.5)	(\$6.3)	(\$70.7)	\$73.7	\$3.0	(\$3.3)
	Sep	\$125.2	(\$127.2)	(\$2.1)	(\$84.5)	\$85.2	\$0.7	(\$1.3)
	Oct	\$111.8	(\$109.7)	\$2.1	(\$150.4)	\$148.1	(\$2.4)	(\$0.2)
	Nov	\$96.8	(\$95.6)	\$1.2	(\$115.0)	\$113.9	(\$1.1)	\$0.0
	Dec	\$101.4	(\$101.8)	(\$0.3)	(\$94.6)	\$95.4	\$0.9	\$0.6
Total	\$1,364.5	(\$1,339.3)	\$25.3	(\$1,201.2)	\$1,178.5	(\$22.6)	\$2.6	
2024	Jan	\$185.4	(\$164.2)	\$21.2	(\$151.0)	\$135.1	(\$15.9)	\$5.3
	Feb	\$85.7	(\$90.4)	(\$4.7)	(\$90.6)	\$94.5	\$3.9	(\$0.9)
	Mar	\$96.9	(\$102.4)	(\$5.5)	(\$95.4)	\$99.5	\$4.0	(\$1.4)
	Apr	\$100.5	(\$101.1)	(\$0.6)	(\$110.1)	\$110.9	\$0.8	\$0.2
	May	\$131.5	(\$144.1)	(\$12.6)	(\$136.9)	\$151.1	\$14.2	\$1.7
	Jun	\$132.9	(\$135.7)	(\$2.8)	(\$104.8)	\$107.1	\$2.3	(\$0.4)
	Jul	\$182.2	(\$197.0)	(\$14.9)	(\$133.9)	\$145.2	\$11.3	(\$3.6)
	Aug	\$176.2	(\$179.7)	(\$3.5)	(\$102.0)	\$102.9	\$0.9	(\$2.6)
	Sep	\$130.7	(\$133.6)	(\$2.9)	(\$80.3)	\$82.9	\$2.6	(\$0.3)
	Oct	\$115.9	(\$111.0)	\$4.9	(\$124.2)	\$118.0	(\$6.2)	(\$1.3)
	Nov	\$102.4	(\$95.9)	\$6.5	(\$112.2)	\$105.7	(\$6.5)	(\$0.0)
	Dec	\$166.0	(\$154.8)	\$11.2	(\$152.4)	\$145.6	(\$6.8)	\$4.4
	Total	\$1,606.3	(\$1,609.9)	(\$3.6)	(\$1,393.9)	\$1,398.5	\$4.7	\$1.1





# Generation and Transmission Planning<sup>1</sup>

## Overview

## Generation Interconnection Planning

### Existing Generation Mix

- As of December 31, 2024, PJM had a total installed capacity of 198,841.1 MW, of which 38,776.4 MW (19.5 percent) are coal fired steam units, 56,124.2 MW (28.2 percent) are combined cycle units and 33,452.6 MW (16.8 percent) are nuclear units. This measure of installed capacity differs from capacity market installed capacity because it includes energy only units, excludes all external units, and uses nameplate values for solar and wind resources.
- Of the 198,841.1 MW of installed capacity, 69,023.7 MW (34.7 percent) are from units older than 40 years, of which 31,224.3 MW (45.2 percent) are coal fired steam units, 191.0 MW (0.3 percent) are combined cycle units and 22,100.6 MW (32.0 percent) are nuclear units.

### Generation Retirements<sup>2</sup>

- There are 60,030.1 MW of generation that have been, or are planned to be, retired between 2011 and 2028, of which 42,682.8 MW (71.1 percent) are coal fired steam units.
- In 2024, 527.4 MW of generation retired. The largest generator that retired in 2024 was the 180.0 MW Warrior Run coal fired steam unit located in the APS Zone. Of the 527.4 MW of generation that retired in 2024, 200.0 MW (37.9 percent) were located in the APS Zone.
- As of December 31, 2024, there are 5,284.8 MW of generation that have requested retirement after December 31, 2024, of which 2,168.8 MW (41.0 percent) are located in the BGE Zone. Of the generation requesting retirement in the BGE Zone, 1,273.0 MW (58.7 percent) are coal fired steam units.

### Generation Queue<sup>3</sup>

- On November 29, 2022, the Commission issued an order accepting PJM's tariff revisions to improve the queue process.<sup>4</sup> The new queue process includes modifications to implement a cluster/cycle based processing method to replace the first in/first out processing method.<sup>5</sup> This change will allow projects to move forward based on a first ready/first out analysis, where readiness is demonstrated through site control and financial milestones and there is an option to exit the study process early based on system impacts. The transition to the new queue process began on July 10, 2023.
- As of December 31, 2024, a total of 221,297.3 MW, on an energy basis, were in generation request queues in the status of active, under construction or suspended.<sup>6</sup> Based on historical completion rates, 38,520.2 MW (17.4 percent), on an energy basis, of new generation in the queue are expected to go into service. As projects move through the queue process, projects can be removed from the queue due to incomplete or invalid data, withdrawn by the market participant or placed in service.
- Of the 7,688.8 MW, on an energy basis, of combined cycle projects in the queue, 4,193.0 MW (54.5 percent) are expected to go in service based on historical completion rates as of December 31, 2024.
- Of the 45,186.8 MW, on an energy basis, of battery projects in the queue, only 1,448.3 MW (3.2 percent) are expected to go in service based on historical completion rates as of December 31, 2024.
- Of the 166,339.7 MW, on an energy basis, of renewable projects in the queue, 31,649.1 MW (19.0 percent) are expected to go in service based on historical completion rates as of December 31, 2024.
- Of the 7,487.1 MW, on a capacity basis that requested CIRs, of combined cycle projects requested in the generation queues in the status of active, under construction or suspended, 3,982.0 MW (53.2 percent) are expected to go into service based on historical completion rates. Based on historical completion rates and the ELCC derate factors

<sup>1</sup> Totals presented in this section include corrections to historical data and may not match totals presented in previous reports.

<sup>2</sup> See PJM. Planning. "Generator Deactivations," (Accessed on December 31, 2024) <<https://www.pjm.com/planning/service-requests/gen-deactivations>>.

<sup>3</sup> See PJM. Planning. "New Services Queue," (Accessed on December 31, 2024) <<https://www.pjm.com/planning/service-requests/serial-service-request-status>>.

<sup>4</sup> 181 FERC ¶ 61,162 (2022).

<sup>5</sup> See "Interconnection Process Reform," presented at April 27, 2022 meeting of the Members Committee. <<https://www.pjm.com/-/media/committees-groups/committees/mc/2022/20220427/20220427-item-01a-1-interconnection-process-reform-presentation.ashx>>.

<sup>6</sup> Unless otherwise noted, the queue totals in this report are the winter net MW energy for the interconnection requests ("MW Energy") as shown in the queue.

using the class ratings for the 2025/2026 Third Incremental Auction,<sup>7</sup> the 7,487.1 MW of capacity requests currently under construction, suspended or active in the queue would be reduced to 3,105.9 MW of capacity (41.5 percent of the total requested capacity).<sup>8</sup>

- Of the 40,343.3 MW, on a capacity basis that requested CIRs, of battery projects requested in the generation queues in the status of active, under construction or suspended, 192.8 MW (0.5 percent) are expected to go into service based on historical completion rates. Based on historical completion rates and the ELCC derate factors using the class ratings for the 2025/2026 Third Incremental Auction,<sup>9</sup> the 40,343.3 MW of capacity requests currently under construction, suspended or active in the queue would be reduced to 106.0 MW of capacity (0.3 percent of the total requested capacity).<sup>10</sup>
- Of the 90,259.5 MW, on a capacity basis that requested CIRs, of renewable projects requested in the generation queues in the status of active, under construction or suspended, 15,402.8 MW (17.1 percent) are expected to go into service based on historical completion rates. Based on historical completion rates and the ELCC derate factors using the class ratings for the 2025/2026 Third Incremental Auction,<sup>11</sup> the 90,259.5 MW of capacity requests currently under construction, suspended or active in the queue would be reduced to 2,531.2 MW of capacity (2.8 percent of the total requested capacity).<sup>12</sup>
- As of December 31, 2024, 140,173.0 MW of capacity requests (requested CIRs) were in the generation queues in the status of active, under construction or suspended. Based on historical completion rates, 20,773.6 MW (14.8 percent) are expected to go into service. Based on historical completion rates and the ELCC derate factors using the class ratings

for the 2025/2026 Third Incremental Auction, the 140,173.0 MW of capacity requests currently under construction, suspended or active in the queue would be reduced to 6,509.2 MW of capacity (4.6 percent of the total requested capacity).

- As of December 31, 2024, 8,190 projects, representing 827,897.9 MW, have entered the queue process since its inception in 1998. Of those, 1,219 projects, representing 91,789.6 MW (11.1 percent of the MW), went into service. Of the projects that entered the queue process, 4,401 projects, representing 514,811.0 MW (62.2 percent of the MW) withdrew prior to completion. Such projects may create barriers to entry for projects that would otherwise be completed, by taking up queue positions, increasing interconnection costs and creating uncertainty.
- In 2024, 4,431.3 MW from the queue went into service. Of the 4,431.3 MW that went in service, 4,099.0 MW (92.5 percent) were solar units, 289.8 MW (6.5 percent) were wind units and 42.5 MW (1.0 percent) were battery units.
- The number of queue entries increased during the past several years, primarily renewable projects. Of the 5,538 projects that entered the queue from January 1, 2015, through December 31, 2024, 4,121 projects (74.4 percent) were renewable. Of the 467 projects that entered the queue in 2023, 414 projects (88.7 percent) were renewable. Renewable projects make up 77.2 percent of all projects in the queue and account for 75.2 percent of the nameplate MW currently active, suspended or under construction in the queue as of December 31, 2024.
- On December 31, 2024, 37,129.1 MW, on an energy basis, were in generation request queues that had reached the construction service agreement milestone or equivalent, in the status of active, suspended or under construction. Of the 37,129.1 MW, 18,148.1 MW (48.9 percent) had not begun construction, 12,137.9 MW (32.7 percent) had begun construction, but are now suspended, and 6,843.1 MW (18.4 percent) are currently under construction. Reaching the final milestone required prior to construction does not mean a project will immediately begin construction or even that it necessarily will ever begin construction.

<sup>7</sup> ELCC Class Ratings for 2025/2026 Third Incremental Auction, PJM Interconnection LLC. (January 23, 2025) <<https://www.pjm.com/-/media/DotCom/planning/res-adeq/elcc/2025-26-3ia-elcc-class-ratings.pdf>>.

<sup>8</sup> The 2025/2026 Third Incremental Auction ELCC factors are used for the ELCC derate adjusted MW. The adjusted MW are calculated using the four hour storage ELCC derate for battery resources, tracking solar for solar resources and onshore wind for wind resources.

<sup>9</sup> ELCC Class Ratings for 2025/2026 Third Incremental Auction, PJM Interconnection LLC. (January 23, 2025) <<https://www.pjm.com/-/media/DotCom/planning/res-adeq/elcc/2025-26-3ia-elcc-class-ratings.pdf>>.

<sup>10</sup> The 2025/2026 Third Incremental Auction ELCC factors are used for the ELCC derate adjusted MW. The adjusted MW are calculated using the four hour storage ELCC derate for battery resources, tracking solar for solar resources and onshore wind for wind resources.

<sup>11</sup> ELCC Class Ratings for 2025/2026 Third Incremental Auction, PJM Interconnection LLC. (January 23, 2025) <<https://www.pjm.com/-/media/DotCom/planning/res-adeq/elcc/2025-26-3ia-elcc-class-ratings.pdf>>.

<sup>12</sup> The 2025/2026 Third Incremental Auction ELCC factors are used for the ELCC derate adjusted MW. The adjusted MW are calculated using the four hour storage ELCC derate for battery resources, tracking solar for solar resources and onshore wind for wind resources.

## Regional Transmission Expansion Plan (RTEP)

### Market Efficiency Process

- There are significant issues with PJM's benefit/cost analysis that should be addressed prior to approval of additional projects. If done correctly and if FTRs/ARRs returned 100 percent of congestion to load, the benefit/cost analysis would include the total net change in production costs and would not include congestion. In addition, PJM's benefit/cost analysis includes only the decreases in costs to load and ignores the increases in costs to load associated with market efficiency projects.
- Through December 31, 2024, PJM has completed five market efficiency cycles under Order No. 1000.<sup>13</sup> PJM delayed the opening of the 2022/2023 Long-Term Window until the reliability violations for the 2022 Window 3 are addressed. In January 2024, PJM completed updating the 2022/2023 market efficiency base case to include the solution selected from the 2022 Window 3. No flowgates experienced historical congestion that required an open window. PJM will continue to analyze the congestion patterns as part of the 2024/25 Market Efficiency cycle. In February 2024, PJM completed the 2024/2025 market efficiency base case. In May 2024, PJM posted the 2024/2025 Market Efficiency planning assumptions. PJM posted an updated 2024/2025 base case in July 2024, and requested stakeholder feedback by August 31, 2024. PJM is currently reviewing the feedback received from stakeholders. The long term market efficiency window is expected to open during the first quarter of 2025.

### PJM MISO Interregional Market Efficiency Process (IMEP)

- PJM and MISO developed a process to facilitate the construction of interregional projects in response to the Commission's concerns about interregional coordination along the PJM-MISO seam. This process, called the Interregional Market Efficiency Process (IMEP), operates on a two year study schedule and is designed to address forward looking congestion.

<sup>13</sup> See *Transmission Planning and Cost Allocation by Transmission Owning and Operating Public Utilities*, Order No. 1000, FERC Stats. & Regs. ¶ 31,323 (2011) (Order No. 1000), *order on reh'g*, Order No. 1000-A, 139 FERC ¶ 61,132 (2012).

The simultaneous use for joint projects of an incorrectly defined benefit/cost method by PJM and the correct method by MISO results in an over allocation of the costs associated with joint PJM/MISO projects to PJM participants and in some cases approval of projects that do not pass a correctly defined benefit/cost test.

### PJM MISO Targeted Market Efficiency Process (TMEP)

- PJM and MISO developed the Targeted Market Efficiency Process (TMEP) to facilitate the resolution of historic congestion issues that could be addressed through small, quick implementation projects.

### PJM MISO Interregional Transfer Capability Study (ITCS)

- PJM and MISO developed the Interregional Transfer Capability Study (ITCS) to help identify potential transmission projects that could incrementally improve the systems' ability to mitigate constraints, improve market efficiency, respond to extreme weather and increase interregional transfer capability.

### Supplemental Transmission Projects

- Supplemental projects are defined to be "transmission expansions or enhancements that are not required for compliance with PJM criteria and are not state public policy projects according to the PJM Operating Agreement. These projects are used as inputs to RTEP models, but are not required for reliability, economic efficiency or operational performance criteria, as determined by PJM."<sup>14</sup> Supplemental projects are exempt from competition.
- The average number of supplemental projects in each expected in service year increased by 1,025.0 percent, from 20 for years 1998 through 2007 (pre Order No. 890) to 225 for years 2008 through 2024 (post Order 890).<sup>15</sup>

<sup>14</sup> See PJM, "Transmission Construction Status," (Accessed on December 31, 2024) <<https://www.pjm.com/planning/mj/project-construction>>.

<sup>15</sup> See *Preventing Undue Discrimination and Preference in Transmission Service*, Order No. 890, 118 FERC ¶ 61,119, *order on reh'g*, Order No. 890-A, 121 FERC ¶ 61,297 (2007), *order on reh'g*, Order No. 890-B, 123 FERC ¶ 61,299 (2008), *order on reh'g*, Order No. 890-C, 126 FERC ¶ 61,228, *order on clarification*, Order No. 890-D, 129 FERC ¶ 61,126 (2009).

## End of Life Transmission Projects

- An end of life transmission project is a project submitted for the purpose of replacing existing infrastructure that is at, or is approaching, the end of its useful life. End of life transmission projects should be included in the RTEP process and should be subject to a transparent, robust and clearly defined mechanism to require competition to build the project. Under the current approach, end of life projects are excluded from the RTEP process and exempt from competition.

## Board Authorized Transmission Upgrades

- The Transmission Expansion Advisory Committee (TEAC) reviews proposals to improve transmission reliability in PJM and between PJM and neighboring regions. These proposals, which include reliability baseline, network, market efficiency and targeted market efficiency projects, as well as scope changes and project cancellations, but exclude supplemental and end of life projects, are periodically presented to the PJM Board of Managers for authorization.<sup>16</sup> In 2024, the PJM Board approved \$1.81 billion in upgrades. As of December 31, 2024, the PJM Board has approved \$50.1 billion in system enhancements since 1999.

## Transmission Competition

- The MMU makes several recommendations related to the competitive transmission planning process. The recommendations include improved process transparency, incorporation of competition between transmission and generation alternatives, and the removal of barriers to competition from nonincumbent transmission. These recommendations would help ensure that the process is an open and transparent process that results in the most competitive solutions.
- On May 24, 2018, the PJM Markets and Reliability Committee (MRC) approved a motion that required PJM, with input from the MMU, to develop a comparative framework to evaluate the quality and effectiveness of competitive transmission proposals with binding cost containment proposals compared to proposals from incumbent and nonincumbent

transmission companies without cost containment provisions.

## Qualifying Transmission Upgrades (QTU)

- A Qualifying Transmission Upgrade (QTU) is an upgrade to the transmission system, financed and built by market participants, that increases the Capacity Emergency Transfer Limit (CETL) into an LDA and can be offered into capacity auctions as capacity. Once a QTU is in service, the upgrade is eligible to continue to offer the approved incremental import capability into future RPM Auctions. As of December 31, 2024, no QTUs have cleared a Base Residual Auction or an Incremental Auction.

## Transmission Facility Outages

- PJM maintains a list of reportable transmission facilities. When a reportable transmission facility needs to be taken out of service, PJM transmission owners are required to report planned transmission facility outages as early as possible. PJM processes the transmission facility outage requests according to rules in PJM's Manual 3 to decide if the outage is on time or late and whether or not they will allow the outage.<sup>17</sup>
- There were 11,142 transmission outage requests submitted in the first seven months of the 2024/2025 planning period. Of the requested outages, 72.1 percent were planned for less than or equal to five days and 11.4 percent were planned for greater than 30 days. Of the requested outages, 41.1 percent were late according to the rules in PJM's Manual 3.

## Recommendations

### Generation Retirements

- The MMU recommends that CIRs should end on the date of retirement in order to help ensure competitive markets and competitive access to the grid. The rules need to ensure that incumbents cannot exploit control of CIRs to block or postpone entry of competitors or to exercise market power by requiring high payments for CIRs.<sup>18</sup> (Priority: Medium. First reported 2013. Status: Partially adopted, 2012.)

<sup>16</sup> Supplemental Projects, including the end of life subset of supplemental projects, do not require PJM Board of Managers authorization.

<sup>17</sup> See "PJM Manual 03: Transmission Operations," Rev. 67 (November 21, 2024).

<sup>18</sup> See Comments of the Independent Market Monitor for PJM, Docket No. ER12-1177-000 (March 12, 2012) <[http://www.monitoringanalytics.com/Filings/2012/IMM\\_Comments\\_ER12-1177-000\\_20120312.PDF](http://www.monitoringanalytics.com/Filings/2012/IMM_Comments_ER12-1177-000_20120312.PDF)>.



## Generation Queue

- Given the significance of data to market participants and regulators, the MMU recommends that all queue data and supplemental, network and baseline project data, including projected in service dates and estimated and final costs, be regularly updated with accurate and verifiable data. PJM does not update this data. (Priority: High. First reported 2023. Not adopted.)
- The MMU recommends that barriers to entry be addressed in a timely manner in order to help ensure that the capacity market will result in the entry of new capacity to meet the needs of PJM market participants. (Priority: Low. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM establish an expedited PJM managed queue process to identify commercially viable projects that could help eliminate or reduce the need for specific RMRs or that could address specific reliability needs and allow the identified projects to advance in the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming. (Priority: High. First reported Q2, 2024. Status: Not adopted.)
- The MMU recommends improvements in queue management including that PJM establish a review process to ensure that projects are removed from the queue if they are not viable, as well as an expedited process to allow commercially viable projects to advance in the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming.<sup>19</sup> (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends continuing analysis of the study phase of PJM's transmission planning to reduce the need for postponements of study results, to decrease study completion times, and to improve the likelihood that a project at a given phase in the study process will successfully go into service.<sup>20</sup> (Priority: Medium. First reported 2014. Status: Partially adopted.)
- The MMU recommends outsourcing interconnection studies to an independent party to avoid potential conflicts of interest. Currently, these studies are performed by incumbent transmission owners under

PJM's direction. This creates potential conflicts of interest, particularly when transmission owners are vertically integrated and the owner of transmission also owns generation. (Priority: Low. First reported 2013. Status: Not adopted.)

## Market Efficiency Process

- The MMU recommends that the market efficiency process be eliminated because it is not consistent with a competitive market design. (Priority: Medium. First reported 2019. Status: Not adopted.)
- The MMU recommends that, if the market efficiency process is retained, PJM modify the rules governing benefit/cost analysis, the evaluation process for selecting among competing market efficiency projects and cost allocation for economic projects in order to ensure that all changes in production costs but not congestion costs, including increased costs to load and the risk of project cost increases, in all zones are included in order to ensure that the correct metrics are used for defining benefits. The MMU also recommends that, if the market efficiency process is retained, market efficiency projects that fail to meet PJM benefit/cost criteria in a Schedule 6 annual reevaluation, prior to construction commencing or prior to state approval, be canceled and removed from further consideration. (Priority: Medium. First reported 2018. Status: Not adopted.)

## Comparative Cost Framework

- The MMU recommends that PJM modify the project proposal templates to include data necessary to perform a detailed project lifetime financial analysis. The required data includes, but is not limited to: capital expenditure; capital structure; return on equity; cost of debt; tax assumptions; ongoing capital expenditures; ongoing maintenance; and expected life. (Priority: Medium. First reported 2020. Status: Not adopted.)

## Transmission Competition

- The MMU recommends, to increase the role of competition, that the exemption of supplemental projects from the Order No. 1000 competitive process be terminated and that the basis for all such exemptions be reviewed and modified to ensure that the supplemental project designation is not used to

<sup>19</sup> PJM Filing, FERC Docket No. ER22-2110-000 (June 14, 2022); 181 FERC ¶ 61,162 (2022).

<sup>20</sup> Ibid.

exempt transmission projects from a transparent, robust and clearly defined mechanism to require competition to build such projects or to effectively replace the RTEP process. (Priority: Medium. First reported 2017. Status: Not adopted. Rejected by FERC.)<sup>21</sup>

- The MMU recommends, to increase the role of competition, that the exemption of end of life projects from the Order No. 1000 competitive process be terminated and that end of life transmission projects be included in the RTEP process and should be subject to a transparent, robust and clearly defined mechanism to require competition to build such projects. (Priority: Medium. First reported 2019. Status: Not adopted. Rejected by FERC.)<sup>22</sup>
- The MMU recommends that PJM enhance the transparency and queue management process for nonincumbent transmission investment. Issues related to data access and complete explanations of cost impacts should be addressed. The goal should be to remove barriers to competition from nonincumbent transmission providers. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM incorporate the principle that the goal of transmission planning should be the incorporation of transmission investment decisions into market driven processes as much as possible. (Priority: Low. First reported 2001. Status: Not adopted.)
- The MMU recommends the creation of a mechanism to permit a direct comparison, or competition, between transmission and generation alternatives, including which alternative is less costly and who bears the risks associated with each alternative. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM establish fair terms of access to rights of way and property, such as at substations, in order to remove any barriers to entry and require competition between incumbent transmission providers and nonincumbent transmission providers in the RTEP. (Priority: Medium. First reported 2014. Status: Not adopted.)

<sup>21</sup> The FERC accepted tariff provisions that exclude supplemental projects from competition in the RTEP. 162 FERC ¶ 61,129 (2018), *reh'g denied*, 164 FERC ¶ 61,217 (2018).

<sup>22</sup> In recent decisions addressing competing proposals on end of life projects, the Commission accepted a transmission owner proposal excluding end of life projects from competition in the RTEP process, 172 FERC ¶ 61,136 (2020), *reh'g denied*, 173 FERC ¶ 61,225 (2020), *affirmed*, American Municipal Power, Inc., et al. v. FERC, Case No. 20-1449 (D.C. Cir. November 17, 2023), and rejected a proposal from PJM stakeholders that would have included end of life projects in competition in the RTEP process, 173 FERC ¶ 61,242 (2020).

- The MMU recommends that rules be implemented to require competition to provide financing for transmission projects. This competition could reduce the cost of capital for transmission projects and significantly reduce total costs to customers. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that storage resources not be includable as transmission assets for any reason. (Priority: High. First reported 2020. Status: Not adopted.)

## Cost Allocation

- The MMU recommends a comprehensive review of the ways in which the solution based dfax allocation method is implemented. The goal for such a process would be to ensure that the most rational and efficient approach to implementing the solution based dfax method is used in PJM. Such an approach should allocate costs consistent with benefits and appropriately calibrate the incentives for investment in new transmission capability. No replacement approach should be approved until all potential alternatives, including the status quo, are thoroughly reviewed. (Priority: Medium. First reported 2020. Status: Not adopted.)
- The MMU recommends changing the minimum distribution factor in the allocation from 0.01 to 0.00 and adding a threshold minimum usage impact on the transmission facilities.<sup>23</sup> (Priority: Medium. First reported 2015. Status: Not adopted.)

## Transmission Line Ratings

- The MMU recommends that all PJM transmission owners use the same methods to define line ratings and that all PJM transmission owners implement dynamic line ratings (DLR), subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. (Priority: Medium. First reported 2019. Status: Partially adopted.)
- The MMU recommends that all PJM transmission owners investigate the applicability and potential cost savings of Grid Enhancing Technology (GET) and that all PJM transmission owners implement cost effective GET, subject to NERC standards and

<sup>23</sup> See 2015 State of the Market Report for PJM, Volume II, Section 12: Generation and Transmission Planning, at 463, Cost Allocation Issues.

guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. (Priority: Medium. First reported Q2, 2024. Status: Not adopted.)

- The MMU recommends that the implementation of Grid Enhancing Technology (GET) be opened to competition from third parties, subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. (Priority: Medium. First reported Q3, 2024. Status: Not adopted.)

## Transmission Facility Outages

- The MMU recommends that PJM reevaluate all transmission outage tickets as on time or late as if they were new requests when an outage is rescheduled, create options for late requests based on the reasons, and apply the modified rules for late submissions to any such outages. The MMU recommends that PJM create options for treatment of late outages. The current rules apply more stringent rules, based on controlling actions, to late outages without distinguishing among reasons for late outages. (Priority: Low. First reported 2014. Status: Not adopted.)
- The MMU recommends that PJM draft a definition of the economic and physical congestion analysis required for transmission outage requests and associated triggers, including both the extent of overloaded facilities and the level of economic congestion, to include in PJM manuals after appropriate review with appropriate rules for on time and late outage requests. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM create options for late requests based on the reasons, and modify the rules to reduce or eliminate the approval of late outage requests submitted or rescheduled after the FTR auction bidding opening date, based on those options. (Priority: Low. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM not permit transmission owners to divide long duration outages into smaller segments to avoid complying with the requirements for long duration outages. (Priority: Low. First reported 2015. Status: Not adopted.)

## Conclusion

The goal of the PJM market design should be to enhance competition and to ensure that competition is the core element of all PJM markets. Transmission investments have not been fully incorporated into competitive markets. The construction of new transmission facilities has significant impacts on the energy and capacity markets. When generating units retire or load increases, there is no market mechanism in place that would require or even permit direct competition between transmission and generation to meet loads in the affected area. In addition, despite FERC Order No. 1000, there is not yet a transparent, robust and clearly defined mechanism to require competition to build transmission projects, to ensure that competitors provide a total project cost cap, or to obtain least cost financing through the capital markets.

The MMU recognizes that the Commission has issued orders that are inconsistent with the recommendations of the MMU and that PJM cannot unilaterally modify those directives. It remains the recommendation of the MMU that the PJM rules for competitive transmission development through the RTEP should build upon FERC Order No. 1000 to create real competition between incumbent transmission providers and nonincumbent transmission providers. The ability of transmission owners to block competition for supplemental projects and end of life projects and the reasons for that policy should be reevaluated. PJM should enhance the transparency and queue management process for nonincumbent transmission investment. Issues related to data access and complete explanations of cost impacts should be addressed. The goal should be to remove barriers to competition from nonincumbent transmission.

Order No. 1000 removed the right of first refusal (ROFR) for transmission projects for incumbent transmission owners except for the case of supplemental projects. This created an incentive for incumbent transmission owners to designate projects as supplemental projects to avoid the Order No. 1000 competitive provisions. Two PJM states, Indiana and Michigan, have passed laws that provide ROFR to incumbent utilities/transmission owners.<sup>24 25</sup>

<sup>24</sup> See IN Code 5 8-1-38-9, effective 7/1/2023. Applies to transmission facilities approved for construction through an RTO planning process. Incumbent Transmission Owner must exercise within 90 days.

<sup>25</sup> See MCL §460.593, effective 12/17/2021. Applies to regionally cost shared transmission lines included in a plan adopted by a recognized planning authority. Must be exercised by the incumbent (s) within 90 days after plan is adopted/approved.

Given the slow pace of adoption by Transmission Owners of Grid Enhancing Technologies (GETs), PJM and the Commission should introduce rules that would allow third parties to propose adding GETs to the transmission system, subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. The third parties would be compensated in the same way that TOs would be compensated for comparable investments.

Another element of opening competition would be to consider transmission owners' ownership of property and rights of way at or around transmission substations. In many cases, the land acquired included property intended to support future expansion of the grid. Incumbents have included the costs of the property in their rate base, paid for by customers. PJM now has the responsibility for planning the development of the grid under its RTEP process. Property bought to facilitate future expansion should be a part of the RTEP process and be made available to all providers on equal terms.

The process for determining the reasonableness or purpose of supplemental transmission projects that are asserted to be not needed for reliability, economic efficiency or operational performance as defined under the RTEP process needs additional oversight and transparency. If there is a need for a supplemental project, that need should be clearly defined and there should be a transparent, robust and clearly defined mechanism to require competition to build the project. If there is no defined need for a supplemental project for reliability, economic efficiency or operational performance then the project should not be included in rates.

Managing the generation queues is a complex process. The PJM queue evaluation process will be significantly improved, based on the proposal submitted by PJM on June 14, 2022, and approved by FERC on November 29, 2022.<sup>26 27</sup> The new rules include significant modifications to the interconnection process designed to address some of the key underlying issues and significantly improve the efficiency of the process. These modifications include process efficiency enhancements, recognition of project clusters affecting the same transmission facilities, incentives to reduce the entry of speculative projects in the queue, and incentives to remove projects that are not expected to reach commercial operation. The new

process should help to reduce backlog and to remove projects that are not viable earlier to help improve the overall efficiency of the queue process.

While the changes in the queue process will clearly improve the process, the MMU's recommendations related to the queue process will remain until the new process is in place and it can be evaluated. The impact of the modifications to the queue process will need to be evaluated to determine if they successfully remove projects from the queue if they are not viable, and allow commercially viable projects to advance in the queue ahead of projects which have failed to make progress. The behavior of project developers also creates issues with queue management. When developers put multiple projects in the queue to maintain their own optionality while planning to build only one they also affect all the projects that follow them in the queue. Project developers may also enter speculative projects in the queue and then put the project in suspended status while they address financing. The impacts of such behavior and the incentives for such behavior are addressed in the new process which includes nonrefundable fees, credit requirements, enhanced site control, elimination of the ability to suspend a project and milestone requirements. The impact of these aspects of the revised interconnection process should continue to be evaluated to ensure that they are having the desired effect on project developer behavior. The PJM queue evaluation process should continue to be improved to help ensure that barriers to competition for new generation investments are not created. Issues that need to be addressed include the ownership rights to CIRs and whether transmission owners should perform interconnection studies.

The roles and efficiency of PJM, TOs and developers in the queue process all need to be examined and enhanced in order to help ensure that the queue process can function effectively and efficiently as the gateway to competition in the energy and capacity markets and not as a barrier to competition.

The Commission should require PJM, for example, to enhance the transparency and queue management process for nonincumbent transmission investment. Issues related to data access and complete explanations of cost impacts should be addressed. The goal should be to remove barriers to competition from nonincumbent transmission.

<sup>26</sup> See *PJM*, Docket No. ER22-2110 (June 14, 2022).

<sup>27</sup> 181 FERC ¶ 61,162 (2022).



The suggestion that generation owners should be permitted to avoid the queue process and directly transfer the generation CIRs to an affiliate or directly sell the CIRs to an unaffiliated entity should be rejected.<sup>28</sup> <sup>29</sup> This proposed approach is about creating a process to maximize the value of existing CIRs to incumbent generators and not about facilitating the efficient replacement of retiring resources. In effect, this approach, if adopted by the large number of retiring units, would create a chaotic, bilateral private queue process that would create market power and facilitate the exercise of market power in the sale of CIRs by incumbent generators. In effect the proposed approach would replace a significant part of the recently redesigned PJM queue process. The proposed continuation of retention of CIRs by incumbent generators creates the potential for delays of up to a year and the proponents have proposed the option to request further delays. This approach would inappropriately delegate the authority from PJM to the incumbent generator to choose the new resource based on highest offer for CIRs rather than based on PJM defined system reliability needs. There would be no requirement to even be a capacity resource and there would be no requirement to offer the capacity into the capacity market. After the entire process, the contribution to PJM reliability could be zero. PJM's recently proposed expedited process for addressing reliability needs (RRI) is preferable and should be considered as the preferred alternative to the proposed approach from the Planning Committee stakeholder process.

The PJM queue process should continue to define available and needed CIRs for all capacity queue projects. CIRs from retiring units should be made available to the next resource in the queue that can use them, on the retirement date of the retiring resource. Generation owners do not have property rights in CIRs. The value of CIRs is a result of the entire transmission system which has been paid for by customers and other generators. The value of CIRs is a result of the existence of a network and is not a result solely or even primarily of the investment that may or may not have been required in order to get CIRs. The cost of CIRs is part of project costs included in generation owners' investment decisions like any other project cost and subject to the same risk and reward structure. Open access to the

transmission system by new resources should not be limited by claims to own the access rights by retiring units. In addition, the proposal to bypass the PJM interconnection process with a private, bilateral process ignores the fact that if the new resource is a renewable resource or a storage resource, the new resource does not have a capacity market must offer requirement. The PJM interconnection process could be bypassed, CIRs transferred and then the resource does not offer into the capacity market. In that case, scarce CIRs will be withheld by a generator who does not provide capacity and customers have to pay for an additional capacity resource instead.

The MMU recommends that PJM establish an expedited PJM managed queue process to identify commercially viable projects that could help eliminate or reduce the need for specific RMRs or that could address specific reliability needs and allow the identified projects to advance in the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming. Rules should be developed to permit PJM to advance projects in the queue if they would resolve immediate reliability issues that result, for example, from unit retirements. The rules should be consistent with the flexibility included in the new queue process but add the option for PJM to expedite the interconnection and commercial operation of projects in the queue that would address identified reliability issues, consistent with the standing of the projects in the queue.

The fundamental purpose of the queue process is to provide open access to the grid for supply resources. More specifically, the fundamental purpose of the queue process for capacity resources is to provide open access to the grid and to ensure that the energy from capacity resources is deliverable so that capacity resources can meet their must offer obligations in the energy market and provide reliable energy supply during all conditions. In order to ensure that open access, all capacity resources should be required to have a must offer obligation in the capacity market. If they do not, such resources are effectively withholding access to the grid from capacity resources that would take on a must offer obligation in the capacity market. The result creates market power for the resources with no must offer obligation, noncompetitively limits access to the grid, increases capacity market prices above the competitive level, and

<sup>28</sup> See PJM, "Enhancing Capacity Interconnection Rights (CIR) Transfer Efficiency: Problem / Opportunity Statement," <<https://www.pjm.com/-/media/committees-groups/subcommittees/ips/2023/20230731/20230731-item-08b---enhancing-capacity-interconnection-rights---cir---transfer-efficiency-problem-statement.ashx>>.

<sup>29</sup> On April 30, 2024, the CIR Transfer Efficiency issue was transferred from the Interconnection Process Subcommittee (IPS) to the Planning Committee (PC).



creates uncertainty and unpredictable volatility in the capacity market.

The addition of a planned transmission project changes the parameters of the capacity auction for the area, changes the amount of capacity needed in the area, changes the capacity market supply and demand fundamentals in the area and may effectively forestall the ability of generation to compete. But there is no mechanism to permit a direct comparison, let alone competition, between transmission and generation alternatives. There is no mechanism to evaluate whether the generation or transmission alternative is less costly, whether there is more risk associated with the generation or transmission alternatives, or who bears the risks associated with each alternative. Creating such a mechanism should be an explicit goal of PJM market design.

The current market efficiency process does exactly the opposite by permitting transmission projects to be approved without competition from generation. The broader issue is that the market efficiency project approach explicitly allows transmission projects to compete against future generation projects, but without allowing the generation projects to compete. Projecting speculative transmission related benefits for 15 years based on the existing generation fleet and existing patterns of congestion eliminates the potential for new generation to respond to market signals. The market efficiency process allows assets built under the cost of service regulatory paradigm to displace generation assets built under the competitive market paradigm. In addition, there are significant issues with PJM's current benefit/cost analysis which cause it to consistently overstate the potential benefits of market efficiency projects. The market efficiency process is misnamed. The MMU recommends that the market efficiency process be eliminated.

In addition, the use of an incorrectly defined cost-benefit method by PJM and the correct method by MISO results in an over allocation of the costs associated with joint PJM/MISO transmission projects to PJM participants and in some cases approval of projects that do not pass a correctly defined benefit/cost test.

If it is retained, there are significant issues with PJM's benefit/cost analysis that should be addressed prior to approval of additional projects. The current benefit/cost analysis explicitly and incorrectly ignores the increased

costs to load in zones that results from an RTEP project when calculating the energy market benefits. All increases and decreases in costs should be included in all zones and LDAs. The definition of benefits should also be reevaluated.

The benefit/cost analysis should also account for the fact that the transmission project costs are not subject to cost caps and may exceed the estimated costs by a wide margin. When actual costs exceed estimated costs, the benefit/cost analysis is effectively meaningless and low estimated costs may result in inappropriately favoring transmission projects over market generation projects. The risk of cost increases for transmission projects should be incorporated in the benefit/cost analysis.

There are currently no market incentives for transmission owners to plan, submit and complete transmission outages in a timely and efficient manner. Requiring transmission owners to pay does not create an effective incentive when those payments are passed through to transmission customers. The process for the submission of planned transmission outages needs to be carefully reviewed and redesigned to limit the ability of transmission owners to submit transmission outages that are late for FTR auction bid submission dates and are late for the day-ahead energy market and that have large and unnecessary impacts on the PJM energy market. The submission of late transmission outages can inappropriately affect market outcomes when market participants do not have the ability to modify market bids and offers. The PJM process for evaluating the congestion impact of transmission outages needs to be clearly defined and upgraded to provide for management of transmission outages to minimize market impacts. The MMU continues to recommend that PJM draft a clear and expanded definition of the congestion analysis required for transmission outage requests that is incorporated in the PJM Market Rules. PJM Manual 38 currently defines congestion resulting from a transmission outage as an overload on transmission facilities rather than using the general economic definition of congestion resulting from out of merit generation to control constraints. PJM does not currently evaluate the economic impact of congestion when reviewing proposed transmission outages.<sup>30</sup>

The treatment by PJM and Dominion Virginia Power of the outage for the Lanexa – Dunnsville Line illustrates

<sup>30</sup> PJM, "Manual 38: Operations Planning," Rev. 18 (February 22, 2024) at 19-20.

some of the issues with the current process. The outage was submitted and delayed more than once. PJM's analysis of expected congestion did not highlight the magnitude of the issue. Dominion Virginia Power did not stage the outage so as to minimize market disruption and congestion until after there were significant disruptions and congestion.

As an example of the complexities of defining the benefits of transmission investments, the reduction in congestion is frequently and incorrectly cited as a metric of benefits. Congestion is frequently misunderstood. Congestion is not static. Congestion exhibits dynamic intertemporal variability and dynamic locational variability. More importantly, congestion is not the correct metric for evaluating the potential benefits of enhancing the transmission grid. The correct metric is the total net change in production costs.

There is not a secular trend towards increasing congestion in PJM. Congestion is volatile on a monthly basis. Congestion is also volatile on an hourly and daily basis. For example, higher congestion can result from changes in seasonal and daily/hourly fuel costs.

The level and distribution of congestion at a point in time is a function of the location and size of generating units, the relative costs of the fuels burned and the associated marginal costs of generating units, the location and size of load and the locational capability of the transmission grid. Each of these factors changes over time.

The geographic distribution of congestion is dynamic. The nature and location of congestion in the PJM system has changed significantly over the last 10 years and continues to change. The nature and location of congestion in PJM can also change from one day to the next as a result of changes in relative fuel costs. As a result, building transmission to address a specific pattern of congestion does not make sense, unless the technology can be easily moved to new locations as conditions change. The transmission system is only one of many reasons that congestion exists. The dynamic nature of congestion and the multiple, interactive causes of congestion make it virtually impossible to identify the standalone impacts of an individual transmission investment on future congestion. It is possible, for example, that congestion occurring during a period of a few days in the winter as a result of very high fuel prices, significantly increases the reported level of congestion

for the entire year. This has occurred in PJM. It would be a mistake to consider that level of congestion to be a signal to build transmission.

At a more fundamental level, congestion is not the correct metric for evaluating the potential benefits of enhancing the transmission grid. When there are binding transmission constraints and locational price differences, load pays more for energy than generation is paid to produce that energy. The difference is congestion. Congestion is neither good nor bad, but is a direct measure of the extent to which there are multiple marginal generating units with different offers dispatched to serve load as a result of transmission constraints. Congestion occurs when available, least-cost energy cannot be delivered to all load because transmission facilities are not adequate to deliver that energy to one or more areas, and higher cost units in the constrained area(s) must be dispatched to meet the load. The result is that the price of energy in the constrained area(s) is higher than in the unconstrained area. Load in the constrained area pays the higher price for all energy including energy from low cost generation and energy from high cost generation, while only high cost generators are paid the high price at their bus and low cost generators are paid only the low price at their bus.

If FTRs worked perfectly and were assigned directly to load, FTRs would return all congestion to the load that paid the congestion. Congestion is not a cost, it is an accounting result of a market based on locational energy prices in which all load in a constrained area pays the higher single market clearing locational price, resulting in excess payments by load that are not paid to generation, which should be returned to load.

Counterintuitively, congestion actually increases when the transmission capacity between areas with lower cost generation and areas with higher cost generation increases but does not fully eliminate the need for some higher cost local generation. The smaller the amount of higher cost local generation needed to meet load, the more of the local load is met via low cost generation delivered over the transmission system and therefore the higher is the difference between what load pays and generation receives, congestion.

For all these reasons, if done correctly and if FTRs/ARRs returned 100 percent of congestion to load, the benefit/cost analysis for transmission projects would

include the total net change in production costs and would not include congestion. The change in production costs correctly measures the changes in cost to load that result from a project.

The PJM Regional Transmission Expansion Plan (RTEP) successfully addresses the need for transmission investment to reliably meet load. Together with the requirement that new generation pay interconnection costs, the RTEP process has resulted in the appropriate level of new transmission investment in PJM. There is no evidence that the PJM planning process is not adequate to meet the requirements of the PJM markets. Additional transmission investment is not a panacea. Transmission investment is expensive and long lived and it is essential that transmission investments be carefully planned for clearly identified needs in order to ensure that power markets can continue to provide reliable service at a competitive price.

PJM must make out of market payments to units that want to retire (deactivate) but that PJM requires to remain in service, for limited operation, for a defined period because the unit is needed for reliability.<sup>31</sup> This provision has been known as Reliability Must Run (RMR) service but RMR is not defined in the PJM tariff. The correct term is Part V reliability service. The need to retain uneconomic units in service reflects a flawed market design and/or planning process problems. If a unit is needed for reliability, the market should reflect a locational value consistent with that need which would result in the unit remaining in service or being replaced by a competitor unit. The planning process should evaluate the impact of the loss of units at risk and determine in advance whether transmission upgrades are required in order to limit the duration of Part V service for individual units. It is essential that the deactivation provisions of the tariff be evaluated and modified. It is also essential that PJM look forward and attempt to plan for foreseeable unit retirements, whether for economic or regulatory reasons. PJM should consider an expedited queue process for projects that could replace the retiring capacity including the immediate transfer of the retiring unit's CIRs to units in the queue in order to permit generation to compete as an alternative to the current transmission only approach.

An area in northern Virginia in the Dominion Transmission Zone, known as Data Center Alley, has experienced

significant load growth from data centers. Dominion has presented 44 supplemental project requests to serve the increase in load through the summer of 2025. As part of the supplemental planning process, PJM performs a do no harm analysis. PJM identified the need for additional baseline reinforcements to support the load growth. These baseline reinforcements were addressed in the 2022 RTEP Window 3, when the PJM board approved \$1.2 billion of necessary baseline upgrades specific to the Data Center Alley reinforcements.<sup>32</sup> These regional transmission costs were allocated according to Schedule 12 of PJM's Open Access Transmission Tariff (OATT), where costs are shared across all zones by a combination of load ratio share and distribution factor impacts. The transmission owners include these project costs in their base case, and all retail customers in the PJM footprint pay for those upgrade costs through increased energy bills. The cost allocation of the \$1.2 billion in baseline upgrades are assigned to all retail customers and not solely to the customers requesting interconnection.

The high level of customer requests in Data Center Alley resulted in the need for significant baseline reliability upgrades. These costs were allocated per Schedule 12 of the PJM OATT. Not all customer requests result in reliability upgrades. Transmission upgrades for customer requests that are submitted through the supplemental planning process are allocated 100 percent to the zone where they are interconnecting. The transmission owner of that zone then includes those project costs in their rate base, and all retail customers in that zone pay those costs.

The main focus of PJM's planning requirements has been to ensure adequate transmission to allow for generation to reliably serve load. Historically, PJM has had enough excess generation to serve the forecasted load in the RTEP process. In recent years, due in part to the significant increase in load resulting from large load interconnection requests and an increase in thermal unit deactivations, meeting forecasted loads and reserves with existing generation has become an issue. In order to solve the RTEP study cases, PJM must make assumptions about the existing and future generation to include in the RTEP model based on the need to serve load. The RTEP analysis first includes all existing generation that is expected to remain in service for the year being

31 OATT Part V §114.

32 See "Transmission Expansion Advisory Committee (TEAC) Recommendations to the PJM Board," December 2023. <<https://www.pjm.com/-/media/committees-groups/committees/teac/2023/20231205/20231205-pjm-teac-board-whitepaper-december-2023.ashx>>.

studied. When the forecasted load exceeds the expected in service generation, the RTEP analysis includes future generation. Planned generators with a signed interconnection service agreement (ISA) or generation interconnection agreement (GIA), or that cleared a BRA, are included. When the PJM load in the RTEP analysis exceeds the sum of existing generation and generation with an executed final agreement, the RTEP analysis adds speculative new generation that is in its Phase 3 system impact study status to meet the load. If needed, additional generation (pre-GIA stage or with a suspended status) may be modeled consistent with the procedures noted in Manual 14B.<sup>33 34</sup> The RTEP analysis is not adequately coordinated with PJM markets analysis including the energy and capacity markets.

## Generation Interconnection Planning

### Existing Generation Mix

Table 12-1 shows the existing PJM capacity by control zone and unit type.<sup>35 36</sup> As of December 31, 2024, PJM had an installed capacity of 198,841.1 MW, of which 38,776.4 MW (19.5 percent) are coal fired steam units, 56,124.2 MW (28.2 percent) are combined cycle units and 33,452.6 MW (16.8 percent) are nuclear units. This measure of installed capacity differs from capacity market installed capacity because it includes energy only units, external units and uses nameplate values for solar and wind resources.

The AEP Zone has the most installed capacity of any PJM zone. Of the 198,841.1 MW of PJM installed capacity, 36,954.3 MW (18.6 percent) are in the AEP Zone, of which 13,463.0 MW (36.4 percent) are coal fired steam units, 9,294.0 MW (25.1 percent) are combined cycle units and 2,071.0 MW (5.6 percent) are nuclear units.

**Table 12-1 Existing capacity: December 31, 2024 (By zone and unit type (MW))<sup>37</sup>**

Zone	Battery	Combined Cycle	CT - Natural Gas	CT - Oil	CT - Other	Fuel Cell	Hydro - Pumped Storage	Hydro - Run of River	Nuclear	RICE - Natural Gas	RICE - Oil	RICE - Other	Solar + Storage	Solar + Wind	Steam - Coal	Steam - Natural Gas	Steam - Oil	Steam - Other	Wind + Storage	Total
ACEC	0.0	781.6	395.5	0.0	0.0	1.6	0.0	0.0	0.0	0.0	4.0	5.4	69.7	0.0	0.0	0.0	0.0	0.0	7.5	1,265.2
AEP	0.0	9,294.0	4,108.2	16.2	4.8	0.0	66.0	420.9	2,071.0	0.0	0.0	20.4	3,250.9	0.0	0.0	13,463.0	738.0	0.0	0.0	36,954.3
AMPT	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
APS	60.4	2,843.7	1,223.3	0.0	2.0	0.0	0.0	129.2	0.0	22.4	0.0	18.3	381.0	0.0	0.0	5,119.0	0.0	0.0	0.0	10,784.4
ATSI	0.0	4,647.5	1,383.0	183.0	6.4	0.0	0.0	0.0	2,134.0	0.0	5.5	5.6	483.0	0.0	0.0	0.0	325.0	0.0	136.0	9,309.0
BGE	3.5	0.0	267.6	228.8	0.0	0.0	0.0	0.0	1,716.0	0.0	0.0	4.2	1.1	0.0	0.0	1,273.0	143.5	702.0	57.0	4,396.7
COMED	104.5	4,631.1	7,053.3	226.2	0.0	0.0	0.0	0.0	10,473.5	0.0	0.0	15.0	59.0	0.0	0.0	2,646.0	0.0	0.0	0.0	30,585.3
DAY	0.0	0.0	897.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	34.0	0.0	692.9	0.0	0.0	0.0	0.0	0.0	0.0	1,624.4
DUKE	18.0	522.2	598.0	56.0	0.0	0.0	0.0	112.0	0.0	0.0	0.0	4.8	289.9	0.0	0.0	1,252.0	47.0	0.0	0.0	2,899.9
DUQ	0.0	306.0	0.0	15.0	0.0	0.0	0.0	6.3	1,777.0	14.4	0.0	0.0	54.2	0.0	0.0	0.0	0.0	0.0	0.0	2,172.9
DOM	20.0	9,138.0	3,835.3	256.4	10.0	0.0	3,003.0	586.3	3,581.3	0.0	18.0	94.7	4,826.9	0.0	0.0	2,473.2	55.0	0.0	318.4	28,992.5
DPL	0.0	1,742.5	978.2	478.2	0.0	30.0	0.0	0.0	0.0	0.0	22.0	14.1	470.9	0.0	0.0	410.0	710.0	153.0	70.0	5,078.9
EKPC	0.0	0.0	774.0	0.0	0.0	0.0	0.0	136.0	0.0	0.0	0.0	0.0	105.0	0.0	0.0	1,687.0	0.0	0.0	0.0	2,702.0
JCPLC	112.8	2,115.5	531.1	0.0	0.0	0.4	140.0	0.0	0.0	0.0	0.0	14.1	416.1	0.0	0.0	0.0	0.0	0.0	0.0	3,330.1
MEC	0.0	2,595.0	2.0	398.5	0.0	0.0	0.0	19.0	0.0	0.0	0.0	30.9	430.0	0.0	0.0	80.0	35.0	0.0	60.0	3,650.4
OVEC	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2,388.8	0.0	0.0	0.0	2,388.8
PECO	0.0	4,089.0	0.0	828.0	0.0	0.0	1,070.0	572.0	4,546.8	0.0	2.0	0.9	3.0	0.0	0.0	0.0	765.3	0.0	103.0	11,980.0
PE	28.4	1,900.0	422.1	57.0	0.0	0.0	513.0	77.8	0.0	120.1	28.0	11.0	168.5	0.0	0.0	4,169.5	610.0	0.0	42.0	9,385.4
PEPCO	0.0	1,736.5	770.2	150.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	8.7	35.6	0.0	0.0	0.0	1,164.1	0.0	52.0	3,917.1
PPL	20.0	5,558.5	234.0	36.0	20.6	0.0	0.0	706.6	2,520.0	12.0	5.0	14.7	75.0	0.0	0.0	1,859.9	3,137.0	0.0	29.0	14,444.8
PSEG	7.7	4,223.1	963.2	0.0	0.0	0.0	0.0	5.0	3,493.0	0.0	0.0	9.0	230.3	0.0	0.0	0.0	3.0	0.0	179.1	9,113.3
XIC	0.0	0.0	670.6	0.0	0.0	0.0	0.0	0.0	1,140.0	0.0	0.0	0.0	0.0	0.0	0.0	1,955.0	0.0	0.0	100.0	3,865.6
Total	375.3	56,124.2	25,107.1	2,929.3	43.8	32.0	4,792.0	2,771.1	33,452.6	168.9	118.5	271.8	12,043.0	0.0	0.0	38,776.4	7,732.9	855.0	1,046.5	198,841.1

33 See "Review of 2025 RTEP Assumptions," presented at the January 7, 2025 meeting of the Transmission Expansion Advisory Committee. <<https://www.pjm.com/-/media/DotCom/committees-groups/committees/teac/2025/20250107/20250107-item-11---2025-rtep-assumption.pdf>>.

34 See "PJM Manual 14B: PJM Region Transmission Planning Process," Rev. 56 (June 27, 2024).

35 The unit type RICE refers to Reciprocating Internal Combustion Engines.

36 XIC refers to external installed capacity.

37 The capacity described in this section refers to all capacity in PJM at the summer installed capacity rating, regardless of whether the capacity entered the RPM Auction.

Table 12-2 shows the installed capacity by state for each fuel type. Pennsylvania has the most installed capacity of any PJM state. Of the 198,841.1 MW of installed capacity, 47,183.5 MW (23.7 percent) are in Pennsylvania, of which 6,109.4 MW (12.9 percent) are coal fired steam units, 18,292.2 MW (38.8 percent) are combined cycle units and 8,843.8 MW (18.7 percent) are nuclear units.

**Table 12-2 Existing capacity: December 31, 2024 (By state and unit type (MW))**

State	CT -					Fuel Cell	Hydro -		Pumped Storage	Hydro -		RICE -			Steam -							Wind +		Total
	Battery	Combined Cycle	Natural Gas	CT - Oil	CT - Other		Run of River	Nuclear		Natural Gas	RICE - Oil	RICE - Other	Solar Storage	Solar + Wind	Steam - Coal	Natural Gas	- Oil	Steam - Other	Wind Storage					
DC	0.0	19.5	6.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	25.5	
DE	0.0	742.5	325.5	116.3	0.0	30.0	0.0	0.0	0.0	0.0	0.0	8.1	50.0	0.0	0.0	410.0	710.0	0.0	70.0	0.0	0.0	2,462.4		
IL	104.5	4,631.1	7,053.3	226.2	0.0	0.0	0.0	0.0	10,473.5	0.0	0.0	15.0	59.0	0.0	0.0	2,646.0	0.0	0.0	0.0	5,376.7	0.0	30,585.3		
IN	0.0	1,835.0	441.4	0.0	0.0	0.0	0.0	8.2	0.0	0.0	0.0	3.2	982.6	0.0	0.0	3,923.8	0.0	0.0	0.0	2,353.2	0.0	9,547.4		
KY	0.0	0.0	1,618.1	0.0	0.0	0.0	0.0	136.0	0.0	0.0	0.0	0.0	282.0	0.0	0.0	1,687.0	278.0	0.0	0.0	0.0	4,001.1			
MD	3.5	2,717.0	1,684.5	394.7	0.0	0.0	0.0	0.0	1,716.0	0.0	10.0	18.9	506.8	0.0	0.0	1,273.0	1,307.6	855.0	191.0	295.0	0.0	10,973.0		
MI	0.0	994.0	0.0	0.0	4.8	0.0	0.0	11.8	2,071.0	0.0	0.0	3.2	4.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3,089.4		
NC	0.0	165.0	0.0	0.0	0.0	0.0	0.0	315.0	0.0	18.0	0.0	0.0	1,181.5	0.0	0.0	0.0	0.0	0.0	0.0	397.0	0.0	2,076.5		
NJ	120.5	7,120.2	1,889.8	0.0	0.0	2.0	140.0	5.0	3,493.0	0.0	4.0	28.5	716.1	0.0	0.0	0.0	3.0	0.0	179.1	7.5	0.0	13,708.6		
OH	18.0	10,634.7	4,626.2	255.2	6.4	0.0	0.0	200.0	2,134.0	0.0	34.0	10.4	3,211.6	0.0	0.0	6,820.0	47.0	0.0	136.0	1,147.7	0.0	29,281.1		
PA	49.9	18,292.2	1,545.5	1,334.5	20.6	0.0	1,583.0	1,445.7	8,843.8	168.9	40.5	75.8	847.5	0.0	0.0	6,109.4	4,872.3	0.0	234.0	1,719.9	0.0	47,183.5		
TN	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0		
VA	20.0	8,973.0	4,172.3	591.4	12.0	0.0	3,069.0	460.1	3,581.3	0.0	12.0	100.7	4,081.4	0.0	0.0	1,468.2	515.0	0.0	236.4	12.0	0.0	27,304.8		
WV	58.9	0.0	1,073.9	11.0	0.0	0.0	0.0	189.3	0.0	0.0	0.0	8.0	120.0	0.0	0.0	12,484.0	0.0	0.0	0.0	791.7	0.0	14,736.8		
XIC	0.0	0.0	670.6	0.0	0.0	0.0	0.0	0.0	1,140.0	0.0	0.0	0.0	0.0	0.0	0.0	1,955.0	0.0	0.0	0.0	100.0	0.0	3,865.6		
Total	375.3	56,124.2	25,107.1	2,929.3	43.8	32.0	4,792.0	2,771.1	33,452.6	168.9	118.5	271.8	12,043.0	0.0	0.0	38,776.4	7,732.9	855.0	1,046.5	12,200.7	0.0	198,841.1		

Table 12-3 and Figure 12-1 show the age of existing PJM generators, by unit type, as of December 31, 2024. Of the 198,841.1 MW of installed capacity, 69,023.7 MW (34.7 percent) are from units older than 40 years, of which 31,224.3 MW (45.2 percent) are coal fired steam units, 191.0 MW (0.3 percent) are combined cycle units and 22,100.6 MW (32.0 percent) are nuclear units.

**Table 12-3 Capacity (MW) by unit type and age (years): December 31, 2024**

Age (years)	Battery	CT -				CT - Other	Fuel Cell	Hydro - Hydro -			RICE -			Steam -					Wind +		Total
		Combined Cycle	Natural Gas	CT - Oil	Oil			Pumped Storage	Run of River	Nuclear	Natural Gas	Oil	Other	Solar + Storage	Solar + Wind	Steam - Coal	Steam - Natural Gas	Steam - Oil	Steam - Other	Wind Storage	
Less than 20	375.3	36,892.9	2,349.8	0.0	0.0	32.0	0.0	293.6	0.0	134.5	2.0	154.4	12,043.0	0.0	2,950.0	82.0	0.0	47.4	12,016.2	67,416.8	
20 to 40	0.0	19,040.3	22,454.8	478.0	0.0	0.0	3,003.0	318.4	11,352.0	34.4	22.0	101.6	0.0	0.0	4,602.1	73.3	0.0	736.1	184.5	62,400.5	
40 to 60	0.0	0.0	191.0	302.5	2,433.6	0.0	0.0	1,789.0	182.0	22,100.6	0.0	76.5	15.8	0.0	0.0	28,835.5	5,375.1	855.0	57.0	0.0	62,213.6
Greater than 60	0.0	0.0	0.0	17.7	0.0	0.0	0.0	1,977.1	0.0	0.0	18.0	0.0	0.0	0.0	2,388.8	2,202.5	0.0	206.0	0.0	6,810.1	
Total	375.3	56,124.2	25,107.1	2,929.3	43.8	32.0	4,792.0	2,771.1	33,452.6	168.9	118.5	271.8	12,043.0	0.0	38,776.4	7,732.9	855.0	1,046.5	12,200.7	0.0	198,841.1

**Figure 12-1 Capacity (MW) by age (years): December 31, 2024**

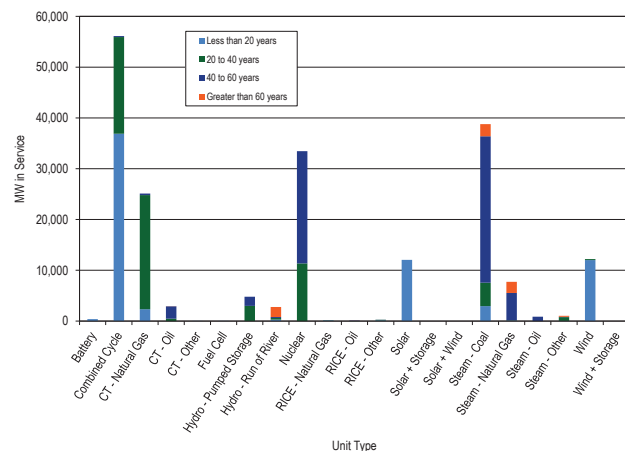
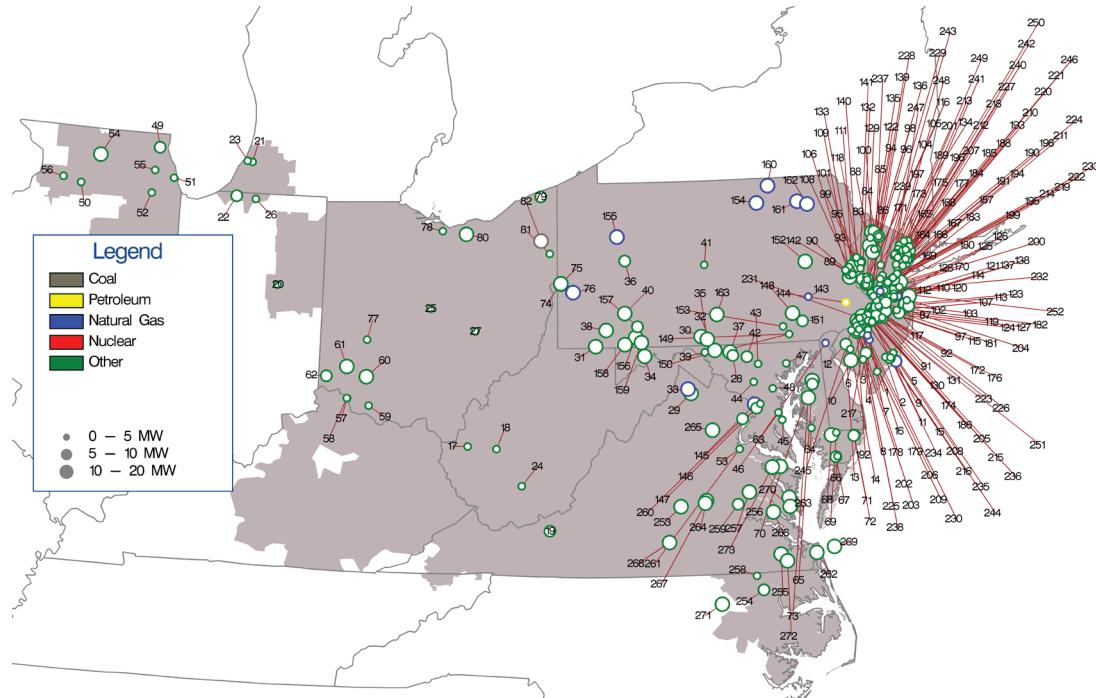




Figure 12-2 is a map of units, less than 20 MW in size that came online between January 1, 2011, and December 31, 2024. A mapping to these unit names is in Table 12-4.

**Figure 12-2 Map of unit additions (less than 20 MW): January 1, 2011 through December 31, 2024**

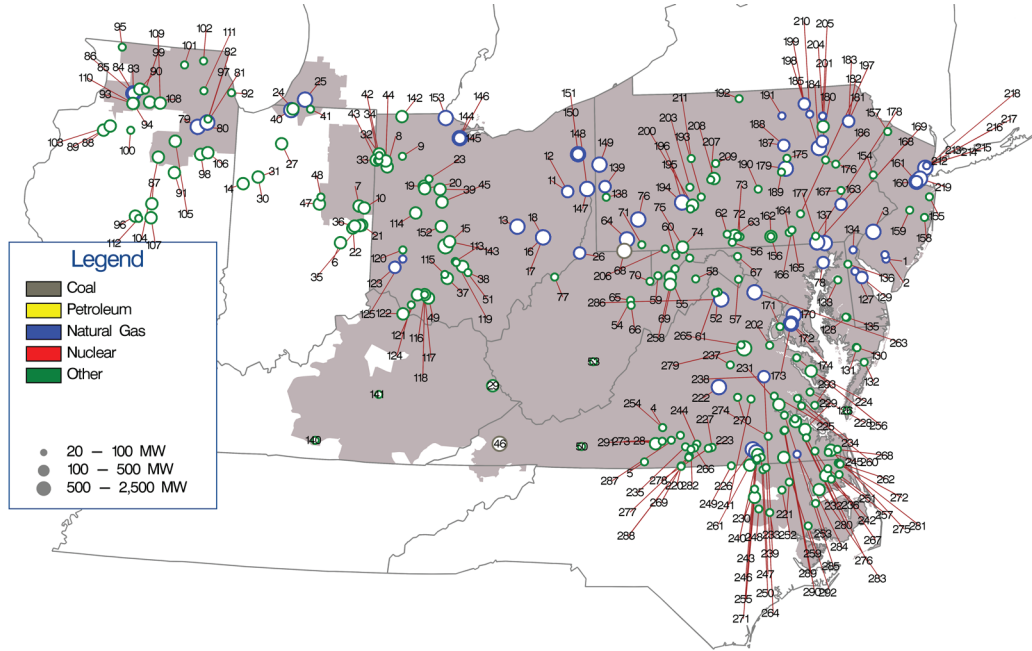


**Table 12-4 Unit identification for map of unit additions (less than 20 MW): January 1, 2011 through December 31, 2024**

ID	Unit	ID	Unit	ID	Unit	ID	Unit	ID	Unit
1	ACE CAPE MAY COUNTY 1 LF	56	COM STERLING RAIL 1 BT	111	JC HOLLAND 4 SP	166	PS BAYONNE 1 SP	221	PS NEWARK SOLAR 3 SP
2	ACE CATES ROAD 2 SP	57	DEOK BECKJORD 1 BT	112	JC HOLMDEL 9 SP	167	PS BAYONNE SOLAR 2 SP	222	PS NIXON LANE 2 SP
3	ACE CEDAR BRANCH 1 SP	58	DEOK BECKJORD 2 BT	113	JC HOWELL 1 SP	168	PS BELLEVILLE SOLAR 1 SP	223	PS NORTH AMERICAN 4 SP
4	ACE EGG HARBOR-KELLOGG 1 FC	59	DEOK BROWN COUNTY 1 LF	114	JC HOWELL 4 BT	169	PS BENNETTS SOLAR 1 SP	224	PS NORTH AVE SOLAR 1 SP
5	ACE GALLOWAY LANDFILL 2 SP	60	DEOK CLINTON 1 BT	115	JC JACOBSTOWN 1 SP	170	PS BLACK ROCK 1 SP	225	PS OWENS CORNING 1 SP
6	ACE GEMS LANDFILL 1 SP	61	DEOK NICKEL - CIN ZOO 1 SP	116	JC JUNCTION ROAD 6 SP	171	PS BRIDGEWATER SOLAR 2 SP	226	PS PARKLANDS 1 SP
7	ACE KETTLE RUN 1 SP	62	DEOK WILLEY 1 BT	117	JC LAKEHURST 3 SP	172	PS BUSTLETON 2 SP	227	PS PATERSON PLANK ROAD 1 SP
8	ACE MAYS LANDING 1 SP	63	DPL BLOOM ENERGY 1 FC	118	JC LEBANON 1 SP	173	PS CALDWELL PUMP 2 BT	228	PS PENNINGTON 3 BT
9	ACE MIDTOWN THERMAL 2 CT	64	DPL BUCKTOWN 1 SP	119	JC LEGLER LANDFILL 7 SP	174	PS CAMPUS DRIVE 2 SP	229	PS PENNINGTON 4 SP
10	ACE OAK FAIRTON 1 SP	65	DPL CHURCH HILL 1 SP	120	JC MANALAPAN 1 SP	175	PS CEDAR GROVE SOLAR 1 SP	230	PS PENNSAUKEN 1 LF
11	ACE PEAR STREET 1 SP	66	DPL COSTEN 1 SP	121	JC MILLHURST 3 SP	176	PS CEDAR LANE FLORENCE 6 SP	231	PS PENNSAUKEN 3 SP
12	ACE PILES GROVE 1 SP	67	DPL COSTEN 2 SP	122	JC MOUNT OLIVE 3 SP	177	PS COOK ROAD SOLAR 2 SP	232	PS PRINCETON HOSPITAL 1 CT
13	ACE PILES GROVE 2 SP	68	DPL HEBRON 1 SP	123	JC MUDDY FORGE 3 SP	178	PS COOPER HOSPITAL 1 BT	233	PS RARITAN CENTER 3 SP
14	ACE PITTS GROVE 1 SP	69	DPL KUMQUAT 1 SP	124	JC NORTH HANOVER 4 SP	179	PS COOPER HOSPITAL 15 SP	234	PS REEVES EAST 3 SP
15	ACE SEASHORE 1 SP	70	DPL POND TOWN 1 SP	125	JC NORTH PARK 1 SP	180	PS CRANBURY 2 SP	235	PS REEVES SOUTH 1 SP
16	ACE TANSBORO ROAD 1 FC	71	DPL WORCESTER NORTH 1 SP	126	JC NORTH PARK 2 SP	181	PS CROSSWIC 1 SP	236	PS REEVES WEST 4 SP
17	AEP BALLS GAP 1 BT	72	DPL WORCESTER SOUTH 2 SP	127	JC NORTH RUN 11 SP	182	PS CROSSWIC 2 SP	237	PS RIDER UNIVERSITY 3 SP
18	AEP CHARLESTON 1 LF	73	DPL WYE MILLS 1 SP	128	JC OLD BRIDGE 1 SP	183	PS DEVILSBROOK 1 SP	238	PS RIVER ROAD 2 SP
19	AEP CLOYDS MT 1 LF	74	DUQ BE-PINE 1 SP	129	JC PAUCH 3 SP	184	PS DOREMUS SOLAR 1 SP	239	PS ROSELAND SOLAR 1 SP
20	AEP DEERCREEK 1 SP	75	DUQ BE-PINE 2 SP	130	JC PEMBERTON 1 SP	185	PS E RUTHERFORD SOLAR 1 SP	240	PS RUTGERS GENERATION 1 F
21	AEP EAST WATERVLIET 1 SP	76	DUQ PIT MICROGRID 1 CT	131	JC PEMBERTON 2 SP	186	PS EASTAMPTON 1 SP	241	PS SADDLE BROOK SOLAR 1 SP
22	AEP OLIVE 1 SP	77	FE DOVETAIL 1 CT	132	JC QUAKERTOWN 9 SP	187	PS EDISON 1 SP	242	PS SPRINGFIELD SOLAR 1 SP
23	AEP ORCHARD HILLS 1 LF	78	FE ERIE COUNTY 1 LF	133	JC RICHLINE 3 SP	188	PS ESSEX 105 CT	243	PS SUNNYMEADE SOLAR 1 SP
24	AEP RALEIGH COUNTY 1 LF	79	FE GENEVA 1 LF	134	JC RINGOES 1 SP	189	PS FAIRLAWN SOLAR 1 SP	244	PS TAYLORS LANE 1 SP
25	AEP TRENT 1 BT	80	FE LORAIN 1 LF	135	JC ROY ROAD 5 BT	190	PS FOODBANK 1 SP	245	PS THOROFARE SOLAR 2 SP
26	AEP TWINBRANCH 1 SP	81	FE MAHONING 1 LF	136	JC SUSSEX 1 LF	191	PS FORTY NINTH SOLAR 1 SP	246	PS TURNPIKE 1 SP
27	AEP ZANESVILLE 2 LF	82	FE WARREN-EVERGREEN 1 CT	137	JC TINTON FALLS 3 SP	192	PS GLOUCESTER SOLAR 1 SP	247	PS W CALDWELL SOLAR 1 SP
28	AP BAKER POINT 1 SP	83	JC AUGUSTA 1 SP	138	JC UPPER FREEHOLD 1 SP	193	PS HACKENSACK 1 SP	248	PS W CALDWELL SOLAR 2 SP
29	AP DOUBLE TOLLGATE SP	84	JC BEAVER RUN 3 SP	139	JC WANTAGE 2 SP	194	PS HIGHLAND PARK 3 BT	249	PS WALDWICK SOLAR 1 SP
30	AP ELK HILL 1 SP	85	JC BERKSHIRE 2 SP	140	JC WARREN 1 SP	195	PS HIGHLAND PARK 4 SP	250	PS WEST ORANGE SOLAR 1 SP
31	AP GANS 5 SP	86	JC BERNARDS TOWNSHIP 1 SP	141	JC WASHBURN AVE 4 SP	196	PS HILLSDALE SOLAR 1 SP	251	PS WEST PEMBERTON 1 SP
32	AP HAGERSTOWN 1 SP	87	JC BRICKYARD 4 SP	142	ME GLENDON 1 LF	197	PS HINCHMANS SOLAR 1 SP	252	PS WEST WINDSOR 1 CT
33	AP HP HOOD 1 CT	88	JC BRIGHT ROAD 2 BT	143	ME READING HOSPITAL 1 CT	198	PS HOBOKEN SOLAR 2 SP	253	VP BUCKINGHAM 1 SP
34	AP JADE MEADOW 1 SP	89	JC COPPER HILL 4 SP	144	PE MORRIS ROAD 1 D	199	PS HOPEWELL 1 SP	254	VP COLICE HALL 1 SP
35	AP LETZBURG - ELK HILL 2 SP	90	JC CYPHERS ROAD 5 SP	145	PEP CAPITAL POWER PLANT 1 CT	200	PS HOPEWELL 2 BT	255	VP GARDNER FARMS 1 SP
36	AP MAHONING CREEK 1 H	91	JC DIXSOLAR 51 SP	146	PEP ROLLINS AVENUE 3 SP	201	PS JACKSON SOLAR 1 SP	256	VP GARDYS MILL ROAD 5 SP
37	AP MT ST MARYS PV PARK 2 SP	92	JC DIXSOLAR 52 SP	147	PEP SPECTRUM 1 SP	202	PS KINSLEY BEAVER 2 SP	257	VP HOLLYFIELD 1 SP
38	AP PECHIN 2 SP	93	JC DOMIN LANE 1 SP	148	PL DART CONTAINER 1-2 LF	203	PS KINSLEY DEPTFORD 1 SP	258	VP MURPHY 1 SP
39	AP PINESBURG 1 SP	94	JC DURBAN AVENUE 1 SP	149	PL HOLTWOOD 11	204	PS KUSER SOLAR 1 SP	259	VP NORTHEAST 2 LF
40	AP SPRING LANE 1 SP	95	JC E FLEMINGTON 5 SP	150	PL HOLTWOOD 13	205	PS LANDFILL 5 SP	260	VP OCCOQUAN 1 LF
41	AP STATE COLLEGE 1 BT	96	JC EAST AMWELL 7 SP	151	PL KEYSTONE 1 SP	206	PS LAWNSIDE 14 BT	261	VP OCCOQUAN 2 LF
42	AP UNION BRIDGE 1 SP	97	JC EGYPT 3 SP	152	PL PA SOLAR 1 SP	207	PS LEONIA SOLAR 1 SP	262	VP OCEANA 1 SP
43	BC ALPHA RIDGE 1 LF	98	JC FISCHER 8 SP	153	PL TURKEY HILL 1 WF	208	PS LUMBERTON STACY HAINES 5 SP	263	VP PULLER 1 SP
44	BC BRIGHTON DAM 1 H	99	JC FOUL RIFT ROAD 1 SP	154	PN ALPACA GLORY BARN 1 D	209	PS MANTUA CREEK 7 BT	264	VP QUILLWORT 4 SP
45	BC CHESAPEAKE BEACH 1 BT	100	JC FRANKFORD 4 SP	155	PN CLARION BOARDS 2 CT	210	PS MARION SOLAR 1 SP	265	VP REMINGTON 1 SP
46	BC FAIRHAVEN 2 BT	101	JC FRANKLIN 7 SP	156	PN GARRETT 1 BT	211	PS MATRIX PA SOLAR 2 SP	266	VP ROCHAMBEAU 1 SP
47	BC KINGSVILLE 1 SP	102	JC FREEMALL 1 FC	157	PN LAUREL HIGHLANDS 2 LF	212	PS MAYWOOD SOLAR 1 SP	267	VP SCOTT - POWHATAN 3 HB
48	BC MILLERSVILLE 1 LF	103	JC FRENCHES 2 SP	158	PN LISTONBURG 1 SP	213	PS METRO HQ 2 SP	268	VP TWITTYS CREEK 1 SP
49	COM COUNTRYSIDE 1 LF	104	JC FRENCHTOWN 1 SP	159	PN MEYERSDALE 2 BT	214	PS MIDDLESEX 1 SP	269	VP VIRGINIA OFFSHORE 1 WF
50	COM DIXON LEE 5 LF	105	JC FRENCHTOWN 2 SP	160	PN MILAN ENERGY 1 D	215	PS MILL CREEK 1 SP	270	VP WAN - GLOUCESTER 1 SP
51	COM GRAND RIDGE 6 BT	106	JC FRENCHTOWN 3 SP	161	PN NORTH MESHOPPEN 1 CT	216	PS MOORESTOWN 1 SP	271	VP WHITAKERS 1 SP
52	COM MAGID GLOVE 1 BT	107	JC HANOVER 2 SP	162	PN OXBOW CREEK ENERGY CENTER 1 D	217	PS MT LAUREL 1 SP	272	VP WHITE MARSH - SUFFOLK 1 SP
53	COM MORRIS 1 LF	108	JC HARMONY 1 SP	163	PN WHITETAIL 1 SP	218	PS NEW MILFORD SOLAR 1 SP	273	VP WOODBINE ROAD 1 SP
54	COM ORCHARD 1 LF	109	JC HIGH STREET 6 SP	164	PS ALDENE SOLAR 1 SP	219	PS NEW ROAD 1 SP		
55	COM SOLBERG 1 BT	110	JC HOFFMAN STATION ROAD 2 SP	165	PS ATHENIA SOLAR 1 SP	220	PS NEWARK SOLAR 1 SP		

Figure 12-3 is a map of units, 20 MW or greater in size, that came online between January 1, 2011 and December 31, 2024. A mapping to these unit names is in Table 12-5.

**Figure 12-3 Map of unit additions (20 MW or greater): January 1, 2011 through December 31, 2024**



**Table 12-5 Unit identification for map of unit additions (20 MW or greater): January 1, 2011 through December 31, 2024**

ID	Unit	ID	Unit	ID	Unit	ID	Unit	ID	Unit	ID	Unit
1	ACE CLAYVILLE 1 CT	56	AP BLAIRS VALLEY 12 SP	111	COM WEST CHICAGO 3 BT	166	ME COTTONTAIL 8 SP	221	VP AULANDER HOLLOMAN 1 SP	276	VP SOLIDAGO 1 SP
2	ACE WINELAND 11 CT	57	AP BLAKE 1 SP	112	COM WHITNEY HILL 2 WF	167	ME LYONS 1 SP	222	VP BEAR GARDEN	277	VP SOUTH BOSTON 1 F
3	ACE WEST DEPTFORD CROWN POINT 1 CC	58	AP CAPON BRIDGE 1 SP	113	DAY BUCKEYE PLAINS 2 SP	168	PE DELTA 1-4 CC	223	VP BLUESTONE FARM 1 SP	278	VP SPANISH GROVE 1 SP
4	AEP ALTAVISTA 1 SP	59	AP FAIR WIND 2 WF	114	DAY CLEARVIEW 1 SP	169	PE DELTA 5-7 CC	224	VP BOOKERS MILL 1 SP	279	VP SPOITSYLVANIA 1 SP
5	AEP AXTON 1 SP	60	AP FOURMILE RIDGE 1 WF	115	DAY FAYETTE 1 SP	170	PEP KEYS ENERGY CENTER 1 CC	225	VP BRIEL FARM 1 SP	280	VP SPRING GROVE 1 SP
6	AEP BELLFLOWER 1 SP	61	AP FOXGLOVE 1 SP	116	DAY HIGHLAND COUNTY 1 SP	171	PEP MILLS GROVE 1 SP	226	VP BRUNSWICK TCC	281	VP SUMMIT FARMS 1 SP
7	AEP BITTER RIDGE 1 WF	62	AP GREAT COVE 1 SP	117	DAY HIGHLAND COUNTY 2 SP	172	PEP ST CHARLES - KELSON RIDGE 1 CC	227	VP BUTCHER CREEK 1 SP	282	VP SUNNYBROOK FARM 1 SP
8	AEP BLUE CREEK 3 WF	63	AP GREAT COVE 2 SP	118	DAY HIGHLAND COUNTY 3-4 SP	173	PEP ST CHARLES-KELSON RIDGE 1 CC	228	VP CARVERS CREEK 1 SP	283	VP TIMBERMILL 1 WF
9	AEP BLUE HARVEST 1 SP	64	AP GREENE COUNTY 1 CC	119	DAY PICKAWAY COUNTY 1 SP	174	PEP ST CHARLES-KELSON RIDGE 2 CC	229	VP CAVALLER 1 SP	284	VP UNION CAMP 9-10 F
10	AEP BLUFF POINT 2 WF	65	AP LAUREL MOUNTAIN 1 BT	120	DAY TAIT 8 BT	175	PL EAST CHILLI 1 SP	230	VP CHESTNUT 1 SP	285	VP WARDS CREEK 1 SP
11	AEP CARROLL COUNTY 1 CC	66	AP LAUREL MOUNTAIN 1 WF	121	DEOK HILLCREST 1 SP	176	PL HAZEL 1 FW	231	VP CHICKAHOMINY 1 SP	286	VP WARREN COUNTY FRONT ROYAL CC
12	AEP CARROLL COUNTY 2 CC	67	AP MARLOWE 1 SP	122	DEOK MELDAHL DAM 1 H	177	PL HOLTWOOD 18	232	VP COLONIAL TRAIL WEST 1 SP	287	VP WATER STRIDER 1 SP
13	AEP DRESDEN 1 CC	68	AP NORTH LONGVIEW 1 F	123	DEOK MIDDLETOWN ENERGY 1 CC	178	PL HOLTWOOD 19	233	VP CONETOE 2 SP	288	VP WATLINGTON 1 SP
14	AEP FOWLER RIDGE 4 WF	69	AP PINNACLE 1 WF	124	DEOK NESTLEWOOD 1 SP	179	PL HUMMEL STATION 1 CC	234	VP CORRECTIONAL 1 SP	289	VP WAVERLY 1 SP
15	AEP FOX SQUIRREL 1 SP	70	AP ROTH ROCK 1 WF	125	DEOK YANKEE 1 F	180	PL HUNLOCK CC	235	VP CRYSTAL HILL 1 SP	290	VP WAVERLY 2 SP
16	AEP GUERNSEY 11 CC	71	AP SOUTH CHESTNUT 1 WF	126	DPL CHERRYDALE 1 SP	181	PL LACKAWANNA COUNTY 1 CC	236	VP DESERT 1 WF	291	VP WHITEHORN 1 SP
17	AEP GUERNSEY 21 CC	72	AP ST THOMAS 1 SP	127	DPL DEMEC - CLAYTON 2 CT	182	PL LACKAWANNA COUNTY 2 CC	237	VP DESPER 1 SP	292	VP WILKINSON ENERGY CENTER 1 SP
18	AEP GUERNSEY 31 CC	73	AP ST THOMAS 2 SP	128	DPL DORCHESTER COUNTY 1 SP	183	PL LACKAWANNA COUNTY 3 CC	238	VP DOSWELL 2 CT	293	VP WINTERBERRY 1 SP
19	AEP HARDIN 12 SP	74	AP TWIN RIDGES 1 WF	129	DPL GARRISON EC 1 CC	184	PL MOXIE FREEDOM 11 CC	239	VP DOSWELL 3 CT		
20	AEP HARDIN 23 SP	75	AP WARRIOR RUN 2 BT	130	DPL GREAT BAY KINGS CREEK 1 SP	185	PL MOXIE FREEDOM 21 CC	240	VP DRY BREAD 1 SP		
21	AEP HEADWATERS 1 WF	76	AP WESTMORELAND 1 CC	131	DPL GREAT BAY KINGS CREEK 2 SP	186	PL PA SOLAR 2 SP	241	VP DRY BRIDGE EC 1 BT		
22	AEP HEADWATERS 2 WF	77	AP WILLOW ISLAND 1 H	132	DPL OAK HALL 1 SP	187	PL PATRIOT 1 F	242	VP ELIZABETH CITY 1 SP		
23	AEP HOG CREEK 1 WF	78	BC PERRYMAN 6 CT	133	DPL PONDITOWN 2 SP	188	PL PATRIOT 2 F	243	VP FOUNTAIN CREEK 1 SP		
24	AEP HONEYSUCKLE 1 SP	79	COM 924 THREE RIVERS EC 1 CC	134	DPL RED LION 1 FC	189	PL PENN 3 SP	244	VP FOXHOUND 1 SP		
25	AEP INDIAN NILES ENERGY CENTER 1 CC	80	COM 924 THREE RIVERS EC 2 CC	135	DPL RICHFIELD 3 SP	190	PL WALKER 1 SP	245	VP GRASSFIELD 1 SP		
26	AEP LONG RIDGE ENERGY 1 CC	81	COM 929 JACKSON 1 CC	136	DPL TOWNSEND 1 SP	191	PN BEAVER DAM 1 D	246	VP GREENSVILLE 1 CC		
27	AEP MAPLEWOOD NORTH 1 SP	82	COM 929 JACKSON 2 CC	137	DPL WILDCAT POINT 1 CC	192	PN BIG LEVEL 1 WF	247	VP GUTENBERG - O'CONNOR 1 SP		
28	AEP MAPLEWOOD 1 SP	83	COM 942 NELSON 1 CC	138	DUO GAUCHO 2 SP	193	PN CHESTNUT FLATS 1 WF	248	VP HARTS MILL 1 SP		
29	AEP MARTIN COUNTY 1 SP	84	COM 942 NELSON 2 CC	139	DUO MONACA-PENNCHEM 1 CC	194	PN FAIRVIEW 1 CC	249	VP HAWTREE CREEK 1 SP		
30	AEP MEADOW LAKE 5 WF	85	COM 942 NELSON 3 CT	140	EKPC GLOVER CREEK 1 SP	195	PN FAIRVIEW 2 CC	250	VP IVORY LAKE 1 SP		
31	AEP MEADOW LAKE 6 WF	86	COM 942 NELSON 4 CT	141	EKPC TURKEY CREEK 1 SP	196	PN HIGHLAND NORTH 2 WF	251	VP IVY NECK 2 SP		
32	AEP PAULDING 3 WF	87	COM ALTA FARMS II 1 WF	142	FE ARCHE ENERGY 1 SP	197	PN LAUREL HILLS 1 WF	252	VP KELFORD 1 SP		
33	AEP PAULDING 41 WF	88	COM BISHOP HILL 1 WF	143	FE BIG PLAIN 2 SP	198	PN LIBERTY ASYLUM 10 F	253	VP MACKEYS ALBERMAE 1 SP		
34	AEP PAULDING 42 WF	89	COM BISHOP HILL 2 WF	144	FE FREMONT 1 SCCT	199	PN LIBERTY ASYLUM 20 F	254	VP MECHANICSVILLE 2 SP		
35	AEP RIVERSTART 1 SP	90	COM BLOOMING GROVE 1 WF	145	FE FREMONT 2 SCCT	200	PN MAPLE HILL-HIDDLERS 1 SP	255	VP MOCCASIN CREEK - FERN 1 SP		
36	AEP RIVERSTART 3 SP	91	COM BRIGHT STALK 1 WF	146	FE FREMONT ENERGY CENTER 3 CC	201	PN MEHOOPANY 1 WF	256	VP MONTROSS 1 SP		
37	AEP ROSS COUNTY 1 SP	92	COM GRAND RIDGE 7 BT	147	FE HIBBETS MILL SOUTHFIELD 1 CC	202	PN MEHOOPANY 2 WF	257	VP MORGAN CORNER 1 SP		
38	AEP SALT CITY 1 SP	93	COM GREEN RIVER 1 WF	148	FE HIBBETS MILL SOUTHFIELD 2 CC	203	PN PATTON 1 WF	258	VP NEW CREEK 1 WF		
39	AEP SCIOTO RIDGE 1 WF	94	COM GREEN RIVER 2 WF	149	FE HICKORY RUN 1 CC	204	PN PGCOGEN 1 CT	259	VP NEWSOMS 1 SP		
40	AEP ST JOSEPH ENERGY CENTER 1 CC	95	COM HIGHPOINT 11 SP	150	FE LORDSTOWN ENERGY CENTER 1 CC	205	PN PGCOGEN 2 CT	260	VP NORGE 2 SP		
41	AEP ST JOSEPH SOLAR PARK 1 SP	96	COM HILLTOPPER 1 WF	151	FE LORDSTOWN ENERGY CENTER 2 CC	206	PN RINGER HILL 1 WF	261	VP OAK 1 SP		
42	AEP TIMBER ROAD 1 SP	97	COM JOLLET 1 BT	152	FE MADISON FIELDS 1 SP	207	PN SANDY RIDGE 1 WF	262	VP OAK TRAIL 1 SP		
43	AEP TIMBER2 1 WF	98	COM KELLY CREEK 1 WF	153	FE OREGON ENERGY CENTER 1 CC	208	PN SANDY RIDGE 2 WF	263	VP PANDA STONEWALL 1 CC		
44	AEP TRISHE 1 WF	99	COM LEE DEKALB 3 BT	154	JC EDGE ROAD 5 BT	209	PN SCHOOL HOUSE 1 SP	264	VP PECAN 1 SP		
45	AEP UNION 1 SP	100	COM LONE TREE 3 WF	155	JC HAMILTON ROAD 5 SP	210	PN SUGAR RUN 2 CT	265	VP PINE GLADE 1 SP		
46	AEP VIRGINIA CITY 1 F	101	COM MARENGO 1 BT	156	JC JUSTIN COURT 10 BT	211	PN VIADUCT 1 SP	266	VP PINEY CREEK 1 SP		
47	AEP WILDCAT 1A WF	102	COM MCHENRY 1 BT	157	JC MONTAGUE STORAGE 3 BT	212	PS KEARNY 131 CT	267	VP PLEASANT HILL - SUFFOLK 2 SP		
48	AEP WILDCAT 1B WF	103	COM MIDLAND 1 WF	158	JC OAK RIDGE 3 SP	213	PS KEARNY 132 CT	268	VP POCATY 1 SP		
49	AEP WILLOWBROOK 1 SP	104	COM MINONK 1 WF	159	JC PLUMSTED ENERGY 6 BT	214	PS KEARNY 133 CT	269	VP POWELLS CREEK 1 SP		
50	AEP WYTHE COUNTY 1 SP	105	COM OTTER CREEK 1 WF	160	JC WOODBRIDGE 1 CC	215	PS KEARNY 134 CT	270	VP POWHATAN 2 SP		
51	AEP YELLOWBUD 1 SP	106	COM PILOT HILL 1 WF	161	JC WOODBRIDGE 2 CC	216	PS KEARNY 141 CT	271	VP PUMPKINSEED 1 SP		
52	AP BARTONSVILLE 1 SP	107	COM RADFORDS RUN 1 WF	162	ME ADAMS 1 SP	217	PS KEARNY 142 CT	272	VP RANCLAND 2 SP		
53	AP BEECH RIDGE 2 WF	108	COM SHADY OAKS 1 WF	163	ME BIRDSBORO 1 CC	218	PS NEWARK ENERGY CENTER 10 CC	273	VP RENAN 1 SP		
54	AP BEECH RIDGE 3 BT	109	COM SHADY OAKS 2 WF	164	ME COTTONTAIL 1 SP	219	PS SEWAREN 7 CC	274	VP SAFONY 1 SP		
55	AP BLACK ROCK 1 WF	110	COM WALNUT RIDGE 1 WF	165	ME COTTONTAIL 2 SP	220	VP ALTON POST OFFICE 1 SP	275	VP SHILLELAGH 1 SP		

## Generation Retirements<sup>38 39</sup>

Generating units generally plan to retire when they are not economic and do not expect to be economic. Generating units may also plan to retire if environmental restrictions make it too costly to comply or impossible to comply. The MMU performs an analysis of the economics of all units that plan to retire in order to verify that the units are not economic and there is no potential exercise of market power through physical withholding that could advantage the owner's portfolio.<sup>40</sup> The definition of economic is that unit net revenues are greater than or equal to the unit's avoidable or going forward costs.

PJM does not have the authority to order generating plants to continue operating. PJM's responsibility is to ensure system reliability. When a unit retirement creates reliability issues based on existing and planned generation facilities and on existing and planned transmission facilities, PJM identifies transmission solutions.<sup>41</sup> The U. S. Department of Energy does have the authority to temporarily order generating plants to continue operating under section 202(c) of the Federal Power Act in the event of emergency or reliability issues.<sup>42</sup>

Rules that preserve ownership of the Capacity Interconnection Rights (CIRs) associated with retired units, and with the conversion from Capacity Performance (CP) to energy only status, impose significant costs on new entrants. Currently, CIRs persist for one year if unused, and that period can be further extended, at no cost, if the CIRs are

<sup>38</sup> See PJM, Planning, "Generator Deactivations," (Accessed on December 31, 2024) <<https://www.pjm.com/planning/service-requests/gen-deactivations>>.

<sup>39</sup> Generation retirements reported in this section do not include external units. Therefore, retirement totals reported in this section may not match totals reported elsewhere in this report where external units are included.

<sup>40</sup> See OATT Part V and Attachment M-Appendix IV.

<sup>41</sup> See PJM, "Explaining Power Plant Retirements in PJM," at <<http://learn.pjm.com/three-priorities/planning-for-the-future/explaining-power-plant-retirements.aspx>>.

<sup>42</sup> See 16 U.S.C. § 824a(c).

assigned to a new project in the interconnection queue at the same point of interconnection.<sup>43</sup> There are currently no rules governing the retention of CIRs when units want to convert to energy only status or require time to upgrade to retain CP status. The rules governing conversion or upgrades should be the same as the rules governing retired units. Reforms that require the holders of CIRs to use or lose them, and that terminate CIRs on the date of retirement, would make new entry appropriately more attractive. There is no good economic and policy rationale for extending ownership rights to CIRs for inactive units. Incumbent providers receive a significant advantage simply by imposing on new entrants the entire cost of system upgrades needed to accommodate new entrants. In May 2012, PJM stakeholders (through the Interconnection Process Senior Task Force (IPSTF)) modified the rules to reduce the length of time for which CIRs are retained by the current owner after unit retirements from three years to one.<sup>44</sup> The MMU recognized the progress made in this rule change, but it did not fully address the issues. Even if the policy treatment of such CIRs remains unchanged, the rules need to ensure that incumbents cannot exploit control of CIRs to block or postpone entry of competitors or to exercise market power by requiring high payments for CIRs. The MMU recommends that CIRs should end on the date of retirement in order to help ensure competitive markets and competitive access to the grid.

A new dimension to the CIR issue has emerged as a result of the fact that intermittent and storage resources do not have a must offer obligation in the capacity market like the must offer requirement for the majority of capacity resources. In the absence of a uniform must offer requirement in the capacity market, those intermittent resources that hold CIRs but do not offer in the capacity market are effectively blocking entry of competitors who would offer in the capacity market. The MMU recommends that all capacity resources have a must offer requirement.<sup>45</sup>

## Generation Retirements 2011 through 2028

Table 12-6 shows that as of December 31, 2024, there are 60,030.1 MW of generation that have been, or are planned to be, retired between 2011 and 2028, of which 42,682.8 MW (71.1 percent) are coal fired steam units. Retirements are primarily a result of the inability of coal and other units to compete with efficient combined cycle units burning low cost gas.

**Table 12-6 Summary of unit retirements by unit type (MW): 2011 through 2028**

	CT -				Fuel		Hydro -		Hydro -		RICE -		Solar +		Steam -		Wind +		Total
	Battery	Combined Cycle	Natural Gas	CT - Oil	CT - Other	Cell	Pumped Storage	Run of River	Nuclear	Natural Gas	RICE - Oil	RICE - Other	Solar Storage	Solar + Wind	Coal	Natural Gas	Steam - Oil	Steam - Other	
Retirements 2011	0.0	0.0	0.0	128.3	0.0	0.0	0.0	0.0	0.0	0.0	2.7	0.0	0.0	0.0	543.0	522.5	0.0	0.0	1,196.5
Retirements 2012	0.0	0.0	250.0	240.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5,907.9	82.0	548.0	16.0	6,961.9
Retirements 2013	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5.9	7.0	0.0	0.0	2,589.9	82.0	166.0	8.0	2,858.8
Retirements 2014	0.0	0.0	136.0	422.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	15.3	0.0	0.0	2,239.0	158.0	0.0	0.0	2,970.3
Retirements 2015	0.0	0.0	1,319.0	856.2	2.0	0.0	0.0	0.0	0.0	0.0	10.3	0.0	0.0	0.0	7,064.8	0.0	0.0	10.4	9,262.7
Retirements 2016	0.0	0.0	0.0	65.0	6.0	0.0	0.5	0.0	0.0	0.0	8.0	3.9	0.0	0.0	243.0	74.0	0.0	0.0	400.4
Retirements 2017	40.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.8	0.0	0.0	2,038.0	34.0	0.0	0.0	2,112.8
Retirements 2018	1.0	425.0	0.0	38.0	1.6	0.0	0.0	0.0	614.5	0.0	17.2	6.9	0.0	0.0	3,166.5	1,016.0	148.0	108.0	5,542.7
Retirements 2019	0.0	0.0	346.8	51.4	6.4	0.0	0.0	0.0	805.0	0.0	0.0	15.9	0.0	0.0	4,110.5	100.3	10.0	10.0	5,456.3
Retirements 2020	0.0	0.0	232.5	24.0	6.0	0.0	0.0	0.0	0.0	0.0	0.0	14.7	0.0	0.0	2,131.8	0.0	786.0	60.0	3,255.0
Retirements 2021	4.0	118.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	15.9	0.0	0.0	1,020.4	102.0	0.0	50.0	1,310.3
Retirements 2022	41.0	240.5	99.0	360.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	36.6	0.0	0.0	5,385.0	0.0	0.0	0.0	6,162.4
Retirements 2023	0.0	114.0	52.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	36.0	19.2	0.0	0.0	4,380.0	1,326.0	800.0	0.0	6,727.8
Retirements 2024	24.0	0.0	149.2	108.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	11.7	0.0	0.0	180.0	0.0	0.0	50.0	527.4
Planned Retirements (January 1, 2025 and later)	0.0	15.0	1,404.9	433.9	0.0	0.0	0.0	0.0	0.0	0.0	2.0	5.0	0.0	0.0	1,683.0	886.0	855.0	0.0	5,284.8
<b>Total</b>	<b>110.0</b>	<b>912.5</b>	<b>3,990.0</b>	<b>2,727.1</b>	<b>22.0</b>	<b>0.0</b>	<b>0.5</b>	<b>0.0</b>	<b>1,419.5</b>	<b>0.0</b>	<b>82.1</b>	<b>152.9</b>	<b>0.0</b>	<b>0.0</b>	<b>42,682.8</b>	<b>4,300.8</b>	<b>3,313.0</b>	<b>302.0</b>	<b>60,030.1</b>

Table 12-7 shows the capacity, average size, and average age of units retiring in PJM, from 2011 through 2028, while Table 12-8 shows these retirements by state. Of the 60,030.1 MW of units that has been, or are planned to be, retired between 2011 and 2028, 42,682.8 MW (71.1 percent) are coal fired steam units. These coal fired steam units have an average age of 52.1 years and an average size of 224.6 MW. Over half of the retiring coal fired steam units, 55.7 percent, are located in Ohio or Pennsylvania.

<sup>43</sup> See OATT § 230.3.3.

<sup>44</sup> See PJM Interconnection, LLC, Docket No. ER12-1177 (Feb. 29, 2012).

<sup>45</sup> For more information, see *2024 Annual State of the Market Report for PJM*, Volume 2, Section 5: Capacity Market.



Table 12-7 Retirements by unit type: 2011 through 2028

Unit Type	Number of Units	Avg. Size (MW)	Avg. Age at Retirement		Percent
			(Years)	Total MW	
Battery	9	12.2	6.7	110.0	0.2%
Combined Cycle	8	114.1	30.5	912.5	1.5%
Combustion Turbine	161	30.2	35.7	6,739.1	11.2%
Natural Gas	77	51.8	39.7	3,990.0	6.6%
Oil	78	35.0	48.1	2,727.1	4.5%
Other	6	3.7	19.2	22.0	0.0%
Fuel Cell	0	0.0	0.0	0.0	0.0%
Hydro	1	0.5	113.8	0.5	0.0%
Pumped Storage	1	0.5	113.8	0.5	0.0%
Run of River	0	0.0	0.0	0.0	0.0%
Nuclear	2	709.8	47.2	1,419.5	2.4%
RICE	44	5.3	26.1	235.0	0.4%
Natural Gas	0	0.0	0.0	0.0	0.0%
Oil	17	4.8	39.3	82.1	0.1%
Other	27	5.7	12.8	152.9	0.3%
Solar	0	0	0	0	0.0%
Solar + Storage	0	0	0	0	0.0%
Solar + Wind	0	0	0	0	0.0%
Steam	235	188.7	46.2	50,598.6	84.3%
Coal	190	224.6	52.1	42,682.8	71.1%
Natural Gas	26	165.4	57.8	4,300.8	7.2%
Oil	10	331.3	49.5	3,313.0	5.5%
Other	9	33.6	25.3	302.0	0.5%
Wind	2	7.5	15.2	14.9	0.0%
Wind + Storage	0	0	0	0	0.0%
Total	462	129.9	44.6	60,030.1	100.0%

Table 12-8 Retirements (MW) by unit type and state: 2011 through 2028

State	CT - Combined Cycle		CT - Natural Gas		CT - Oil	Fuel Cell	Hydro - Pumped Storage		Hydro - Run of River	RICE - Natural Gas		RICE - Oil	RICE - Other	Solar	Solar + Storage	Solar + Wind	Steam - Coal		Steam - Natural Gas	Steam - Oil	Steam - Other	Wind + Wind		Total
	Battery	Cycle	Gas	Oil			Storage	Storage		Nuclear	Gas	Oil	Other				Coal	Gas				Storage	Storage	
DC	0.0	0.0	0.0	240.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	548.0	0.0	0.0	0.0	0.0	788.0
DE	0.0	0.0	0.0	16.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	664.0	136.0	0.0	0.0	0.0	0.0	0.0	816.4
IL	41.0	0.0	1,646.0	280.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	35.7	0.0	0.0	0.0	0.0	2,818.1	1,326.0	0.0	0.0	0.0	4.5	0.0	6,152.0
IN	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	982.0	0.0	0.0	0.0	0.0	0.0	0.0	982.0
KY	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	995.0	0.0	0.0	0.0	0.0	0.0	0.0	995.0
MD	20.0	0.0	402.4	398.8	1.6	0.0	0.0	0.0	0.0	0.0	2.0	3.2	0.0	0.0	0.0	0.0	4,521.0	297.0	855.0	0.0	0.0	0.0	0.0	6,501.0
NC	0.0	0.0	0.0	31.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	324.5	0.0	0.0	0.0	0.0	0.0	0.0	355.5
NJ	0.0	594.5	1,820.2	1,066.2	6.4	0.0	0.5	0.0	614.5	0.0	8.0	27.5	0.0	0.0	0.0	0.0	2,001.9	932.5	148.0	10.0	0.0	0.0	0.0	7,230.2
OH	46.0	0.0	0.0	307.0	0.0	0.0	0.0	0.0	0.0	0.0	32.3	45.9	0.0	0.0	0.0	0.0	16,607.4	0.0	0.0	0.0	0.0	0.0	0.0	17,038.6
PA	1.0	51.0	121.4	307.3	14.0	0.0	0.0	0.0	805.0	0.0	15.9	20.5	0.0	0.0	0.0	0.0	7,180.0	1,046.3	176.0	109.0	10.4	0.0	0.0	9,857.8
TN	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	50.0	0.0	0.0	0.0	50.0
VA	0.0	267.0	0.0	79.7	0.0	0.0	0.0	0.0	0.0	0.0	23.9	20.1	0.0	0.0	0.0	0.0	3,897.9	563.0	1,586.0	133.0	0.0	0.0	0.0	6,570.6
WV	2.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2,691.0	0.0	0.0	0.0	0.0	0.0	0.0	2,693.0
Total	110.0	912.5	3,990.0	2,727.1	22.0	0.0	0.5	0.0	1,419.5	0.0	82.1	152.9	0.0	0.0	0.0	0.0	42,682.8	4,300.8	3,313.0	302.0	14.9	0.0	0.0	60,030.1

Figure 12-4 is a map of unit retirements between 2011 and 2028, with a mapping to unit names in Table 12-9.

**Figure 12-4 Map of unit retirements: 2011 through 2028**

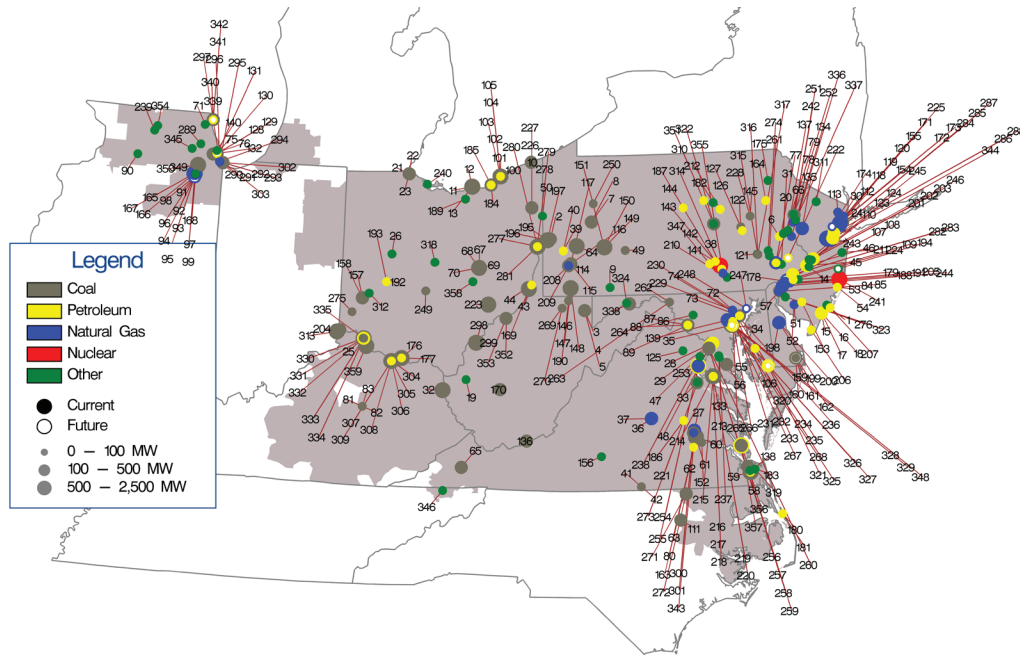


Table 12-9 Unit identification for map of unit retirements: 2011 through 2028

ID	Unit	ID	Unit	ID	Unit	ID	Unit	ID	Unit
1	AC Landfill Units 1 and 2	61	Chesterfield 4	121	Evergreen Power United Corstack	181	Kitty Hawk GT 2	241	Oyster Creek
2	AES Beaver Valley	62	Chesterfield 5	122	FRACKVILLE WHEELABRATOR 1	182	Koppers Co. IPP	242	PL MARTINS CREEK 1-4 CT
3	Albright 1	63	Chesterfield 6	123	Fairless Hills Landfill A	183	Lake Kingman	243	Parlin NUG
4	Albright 2	64	Chesterwick 1	124	Fairless Hills Landfill B	184	Lake Shore 18	244	Pedricktown Cogen CC
5	Albright 3	65	Clinch River 3	125	Fauquier County Landfill	185	Lake Shore EMD	245	Pennsburg Generator Landfill 1
6	Allentown CT 1-4	66	Columbia Dam Hydro	126	Fishbach CT 1	186	Janier 1 CT	246	Pennsburg Generator Landfill 2
7	Armstrong 1	67	Conesville 3	127	Fishbach CT 2	187	Lock Haven CT 1	247	Perryman 2
8	Armstrong 2	68	Conesville 4	128	Fisk CT 31	188	Logan	248	Perryman 6 Unit 1
9	Arnold (Green Mtn. Wind Farm	69	Conesville 5	129	Fisk CT 32	189	Lorain 1 LF	249	Picway 5
10	Ashtabula 5	70	Conesville 6	130	Fisk CT 33	190	MEA NUG (WVU)	250	Piney Creek NUG
11	Avon Lake 10	71	Countryside Landfill	131	Fisk CT 34	191	MHSO Markus Hook Co-gen	251	Portland 1
12	Avon Lake 7	72	Crane 1	132	Fisk Street 19	192	Mad River Cls A	252	Portland 2
13	Avon Lake 9	73	Crane 2	133	GUDE Landfill	193	Mad River Cls B	253	Possum Point 3
14	BC Landfill	74	Crane GT1	134	Gilbert 1-4	194	Manchester 1 LF	254	Possum Point 4
15	BL England 1	75	Crawford 7	135	Glen Gardner 1-8	195	Mansfield 1	255	Possum Point 5
16	BL England 2	76	Crawford 8	136	Glen Lyn 5-6	196	Mansfield 2	256	Potomac River 1
17	BL England 3	77	Cromby 1	137	Glendon LF	197	Mansfield 3	257	Potomac River 2
18	BL England Diesel Units 1-4	78	GL Gormet 2	138	Gosport 1 F	198	McKee 1	258	Potomac River 3
19	Balls Gap Battery Facility	79	Cromby D	139	Gould Street Generation Station	199	McKee 2	259	Potomac River 4
20	Barbados AES Battery	80	DINWIDDIE 1 CT	140	Grand Ridge Energy IV battery component	200	McKee 3	260	Potomac River 5
21	Bay Shore 2	81	Dale 1-2	141	Harrisburg 4 CT	201	Mercer 1	261	Pottstown LF (Moser)
22	Bay Shore 3	82	Dale 3	142	Harrisburg CT 1	202	Mercer 2	262	R Paul Smith 3
23	Bay Shore 4	83	Dale 4	143	Harrisburg CT 2	203	Mercer 3	263	R Paul Smith 4
24	Bayonne Cogen Plant (CC)	84	Deepwater 1	144	Harrisburg CT 3	204	Miami Fort 6	264	Reichs Ford Road Landfill Generator
25	Beckjord Battery Unit 2	85	Deepwater 6	145	Harwood 1-2	205	Mickleton CT1	265	Riverside 4
26	Bellefontaine Landfill Generating Station	86	Dickerson CT1	146	Hatfield's Ferry 1	206	Middle 1-3	266	Riverside 6
27	Bellemeade	87	Dickerson Unit 1	147	Hatfield's Ferry 2	207	Missouri Ave B,C,D	267	Riverside 7
28	Benning 15	88	Dickerson Unit 2	148	Hatfield's Ferry 3	208	Mitchell 2	268	Riverside 8
29	Benning 16	89	Dickerson Unit 3	149	Homer City 1	209	Mitchell 3	269	Riversville 5
30	Bergen 3	90	Dixon Lee Landfill Generator	150	Homer City 2	210	Modern Power Landfill NUG	270	Riversville 6
31	Bethlehem Renewable Energy Generator (Landfill)	91	ELWOOD CT 1	151	Homer City 3	211	Monmouth NUG landfill	271	Roanoke Valley 1
32	Big Sandy 2	92	ELWOOD CT 2	152	Hopewell James River Cogeneration	212	Montour ATG	272	Roanoke Valley 2
33	Birchwood Plant	93	ELWOOD CT 3	153	Howard Down 10	213	Morgantown CT 3	273	Rockville CT
34	Brandon Shores 1	94	ELWOOD CT 4	154	Hudson 1	214	Morgantown CT 4	274	Rolling Hills Landfill Generator
35	Brandon Shores 2	95	ELWOOD CT 5	155	Hudson 2	215	Morgantown CT 5	275	SMART Paper
36	Bremo 3	96	ELWOOD CT 6	156	Hurt NUG	216	Morgantown CT 6	276	Salem County LF
37	Bremo 4	97	ELWOOD CT 7	157	Hutchings 1-3, 5-6	217	Morgantown CT 7	277	Sammis 1
38	Brumer Island Diesels	98	ELWOOD CT 8	158	Hutchings 4	218	Morgantown CT2	278	Sammis Diesel Units
39	Brunot Island 1B	99	ELWOOD CT 9	159	Indian River CT10	219	Morgantown Unit 1	279	Sammis Unit 5
40	Brunot Island 1C	100	Eastlake 1	160	Indian River 1	220	Morgantown Unit 2	280	Sammis Unit 6
41	Buggs Island 1 (Mecklenberg)	101	Eastlake 2	161	Indian River 2	221	Morris Landfill Generator	281	Sammis Unit 7
42	Buggs Island 2 (Mecklenberg)	102	Eastlake 3	162	Indian River 4	222	Morris Road 1 D	282	Schuykill 1
43	Burger 3	103	Eastlake 4	163	Ingenco Petersburg	223	Muskingum River 1-5	283	Schuykill Diesel

## Current Year Generation Retirements

Table 12-10 shows that in 2024, 527.4 MW of generation retired. The largest generator that retired in 2024 was the 180.0 MW Warrior Run coal fired steam unit located in the APS Zone. Of the 527.4 MW of generation that retired, 200.0 MW (37.9 percent) were located in the APS Zone.

### Table 12-10 Unit deactivations: 2024

Owner	Unit Name	ICAP (MW)	Unit Type	Zone Name	Age (Years)	Retirement Date
Galt Power Inc.	Trent Battery Storage	4.0	Battery	AEP	10	01-Jan-24
BP P.L.C.	VP Virginia Beach	11.7	RICE-Other	DOM	20	01-Apr-24
Bridgepoint Group PLC	Carls Corner CT1	37.4	CT-Natural_Gas	ACEC	51	01-Jun-24
Bridgepoint Group PLC	Carls Corner CT2	41.2	CT-Natural_Gas	ACEC	51	01-Jun-24
Bridgepoint Group PLC	Mickleton CT1	70.6	CT-Natural_Gas	ACEC	50	01-Jun-24
GenOn Energy, Inc.	Morgantown CT 5	54.0	CT-Oil	PEPCO	51	01-Jun-24
GenOn Energy, Inc.	Morgantown CT 6	54.0	CT-Oil	PEPCO	51	01-Jun-24
The AES Corporation	Warrior Run	180.0	Steam-Coal	APS	24	01-Jun-24
Macquarie Group Limited	Gosport 1 F	50.0	Steam-Other	DOM	38	15-Jul-24
Invenergy LLC	Grand Ridge Energy IV battery component	4.5	Wind	COMED	15	01-Oct-24
The AES Corporation	Warrior Run 2 BT	20.0	Battery	APS	9	01-Oct-24
Total		527.4				

## Planned Generation Retirements

Table 12-11 shows that, as of December 31, 2024, there are 5,284.8 MW of generation that have requested retirement after December 31, 2024. Of the 5,284.8 MW requesting retirement, 1,683.0 MW (31.8 percent) are coal fired steam units. Of the 5,284.8 MW of planned retirements, 2,168.8 MW (41.0 percent) are located in the BGE Zone. Of the generation requesting retirement in the BGE Zone, 1,273.0 MW (58.7 percent) are coal fired steam units.

**Table 12-11 Planned retirement of units: December 31, 2024**

Owner	Unit Name	ICAP (MW)	Unit Type	Zone Name	Projected Deactivation Date
NextEra Energy, Inc.	Manchester 1 LF	5.0	RICE-Other	JCPLC	01-May-25
Constellation Energy Generation, LLC	Eddystone Unit 3	380.0	Steam-Natural Gas	PECO	31-May-25
Constellation Energy Generation, LLC	Eddystone Unit 4	380.0	Steam-Natural Gas	PECO	31-May-25
Pennoni Associates Inc	Morris Road 1 D	2.0	RICE-Oil	PECO	31-May-25
Constellation Energy Generation, LLC	Perryman 6 Unit 1	54.9	CT-Natural Gas	BGE	31-May-25
Electric Power Development Co. Ltd.	ELWOOD CT 1	150.0	CT-Natural Gas	COMED	01-Jun-25
Electric Power Development Co. Ltd.	ELWOOD CT 2	150.0	CT-Natural Gas	COMED	01-Jun-25
Electric Power Development Co. Ltd.	ELWOOD CT 3	150.0	CT-Natural Gas	COMED	01-Jun-25
Electric Power Development Co. Ltd.	ELWOOD CT 4	150.0	CT-Natural Gas	COMED	01-Jun-25
Electric Power Development Co. Ltd.	ELWOOD CT 5	150.0	CT-Natural Gas	COMED	01-Jun-25
Electric Power Development Co. Ltd.	ELWOOD CT 6	150.0	CT-Natural Gas	COMED	01-Jun-25
Electric Power Development Co. Ltd.	ELWOOD CT 7	150.0	CT-Natural Gas	COMED	01-Jun-25
Electric Power Development Co. Ltd.	ELWOOD CT 8	150.0	CT-Natural Gas	COMED	01-Jun-25
Electric Power Development Co. Ltd.	ELWOOD CT 9	150.0	CT-Natural Gas	COMED	01-Jun-25
NRG Energy Inc	Vienna 8	153.0	Steam-Oil	DPL	01-Jun-25
NRG Energy Inc	Vienna CT 10	15.9	CT-Oil	DPL	01-Jun-25
Talen Energy	Wagner 1	126.0	Steam-Natural Gas	BGE	01-Jun-25
Talen Energy	Wagner CT 1	12.9	CT-Oil	BGE	01-Jun-25
NRG Energy Inc	Fisk CT 31	49.1	CT-Oil	COMED	01-Jun-26
NRG Energy Inc	Fisk CT 32	50.8	CT-Oil	COMED	01-Jun-26
NRG Energy Inc	Fisk CT 33	49.1	CT-Oil	COMED	01-Jun-26
NRG Energy Inc	Fisk CT 34	24.1	CT-Oil	COMED	01-Jun-26
NRG Energy Inc	Indian River CT10	16.4	CT-Oil	DPL	01-Jun-26
Atlantic Power Corporation	Kenilworth	15.0	Combined Cycle	PSEG	01-Jun-26
GenOn Energy, Inc.	Morgantown CT 3	54.0	CT-Oil	PEPCO	01-Jun-26
GenOn Energy, Inc.	Morgantown CT 4	54.0	CT-Oil	PEPCO	01-Jun-26
NRG Energy Inc	Waukegan CT 31	53.1	CT-Oil	COMED	01-Jun-26
NRG Energy Inc	Waukegan CT 32	54.5	CT-Oil	COMED	01-Jun-26
NRG Energy Inc	Indian River 4	410.0	Steam-Coal	DPL	31-Dec-26
Talen Energy	Brandon Shores 1	635.0	Steam-Coal	BGE	31-Dec-28
Talen Energy	Brandon Shores 2	638.0	Steam-Coal	BGE	31-Dec-28
Talen Energy	Wagner 3	305.0	Steam-Oil	BGE	31-Dec-28
Talen Energy	Wagner 4	397.0	Steam-Oil	BGE	31-Dec-28
<b>Total</b>		<b>5,284.8</b>			

In addition to the 5,284.8 MW of announced unit retirements as of December 31, 2024, there are significantly more unit retirements expected as a result of environmental regulations and for economic reasons.<sup>46</sup>

## Generation Queue<sup>47</sup>

Any entity that requests interconnection of a new generating facility, including increases to the capacity of an existing generating unit, or that requests interconnection of a merchant transmission facility, must follow the process defined in the PJM tariff to obtain interconnection service.<sup>48</sup> PJM's process is designed to ensure that new generation is added in a reliable and systematic manner. The process is complex and time consuming at least in part as a result of the required analyses. The cost, time and uncertainty associated with interconnecting to the grid may create barriers to entry for potential entrants. But the behavior of project developers also creates issues with queue management and exacerbates the barriers.

<sup>46</sup> For more information, see *2024 Annual State of the Market Report for PJM*, Volume 2, Section 7: Net Revenue.

<sup>47</sup> Unless otherwise noted, the queue totals in this report are the winter net MW energy for the interconnection requests ("MW Energy") as shown in the queue.

<sup>48</sup> See OATT Parts IV & VI.

Generation request queues are groups of proposed projects, including new units, reratings of existing units, capacity resources and energy only resources. Each queue is open for a fixed amount of time. Studies commence on all projects in a given queue when that queue closes. Queues A and B were open for one year. Queues C through T were open for six months. Starting in February 2008, Queues U through Y1 were open for three months. In May 2012, the duration of the queue period was reset to six months, starting with Queue Y2. Queue AJ1 opened on April 1, 2023, and closed on July 10, 2023, coincident with the transition to the new queue process. On June 24, 2021, PJM requested tariff modifications to close queue windows on September 10 and March 10, rather than September 30 and March 31.<sup>49</sup> This change allowed more time to review the new requests to the queue without shortening the amount of time available for the resulting model builds and analyses. On August 23, 2021, the Commission approved the tariff modifications.<sup>50</sup>

Projects submitted to the queue undergo a deficiency review to ensure that all required information is provided. If a project is missing information, or if the submitting developer owes money from a prior queue request, the submission is defined to be deficient. PJM was required to perform the review and provide notification within five business days of receipt of the request. The developer had ten business days to respond. PJM had five business days to review the response. As a result of the large number of project submissions submitted close to the end of each queue window, PJM could not meet the required timeline. On June 24, 2021, PJM filed tariff changes to modify the deficiency review timeline.<sup>51</sup> PJM requested an increase in the initial notification to the interconnection customer from five to 15 business days, or as soon thereafter as practicable, making the deadline flexible. The developer has ten business days to respond. PJM requested an increase in PJM's time to respond from five to 15 business days, or as soon thereafter as practicable, making the deadline flexible. On August 23, 2021, the Commission approved the tariff modifications.<sup>52</sup> A queue position is assigned once the project has met the submission requirements. Projects that do not meet submission requirements are removed from the queue.

49 See PJM Filing, Docket ER21-2203 (June 24, 2021).

50 176 FERC ¶ 61,117 (2021).

51 See PJM Filing, Docket ER21-2203 (June 24, 2021).

52 176 FERC ¶ 61,117 (2021).

All projects that have entered a queue and have met the submission requirements have a status assigned. Projects listed as active are undergoing one of the studies (feasibility, system impact, facility) required to proceed. Other status options are under construction, suspended, and in service. A project cannot be suspended until it has reached the status of under construction. Any project that entered the queue before February 1, 2011, can be suspended for up to three years. Projects that entered the queue after February 1, 2011, face an additional restriction in that the suspension period is reduced to one year if they affect any project later in the queue.<sup>53</sup> When a project is suspended, PJM extends the scheduled milestones by the duration of the suspension. If, at any time, a milestone is not met, PJM will initiate the termination of the Interconnection Service Agreement (ISA) and the corresponding cancellation costs must be paid by the customer.<sup>54</sup>

PJM has generally met the deadlines for feasibility and system impact studies. The increase in the number of projects submitted have contributed to a significant backlog in performing timely facility studies. The facility study includes the conceptual design, stability analyses and determines the network upgrades, and the costs associated with those upgrades. Modifications to proposed facilities and restudies resulting from the withdrawal of projects from the queue also affect the time to complete a facility study. The PJM queue evaluation process should continue to be improved to help ensure that barriers to competition from new generation investments are not created. The PJM queue evaluation process should also evaluate and address the incentives to project developers to act in ways that are not consistent with an effective and efficient queue process for the system. For example, when developers put multiple projects in the queue to maintain their own optionality while planning to build only one they also affect all the projects that follow them in the queue by requiring multiple restudies.

In 2022, after a lengthy stakeholder process (Interconnection Process Reform Task Force (IPRTF)) PJM filed significant changes to improve overall queue management. On November 29, 2022, the Commission issued an order accepting PJM's tariff revisions modifying how PJM manages the new services queue.<sup>55</sup> The new

53 See "PJM Manual 14C: Generation and Transmission Interconnection Process," Rev. 16 (July 26, 2023).

54 PJM does not track the duration of suspensions or PJM termination of projects.

55 181 FERC ¶ 61,162 (2022).



queue process includes modifications to implement a cluster/cycle based processing method to replace the first in/first out processing method.<sup>56</sup> This change will allow projects to move forward based on a first ready/first out analysis, where readiness is demonstrated through site control and financial milestones and there is an option to exit the study process early based on system impacts.

The new process also includes defining progress to completion through three phases, with a customer decision at the end of each. The new process requires a stronger definition of site control, and includes readiness deposits (some of which are nonrefundable) based on the phase of development. Additional process modifications include limits to technology changes, improvements to the application review phase, removal of optional interconnection study processes, modifications to the study schedules to reduce the number of restudies required in the event of project modifications, adjusting the queue window schedule to coincide with the previous clusters' milestones, and modifications to cost responsibility by assigning responsibility to all projects within a queue cycle. The new process should help to reduce backlog and to remove projects that are not viable earlier to help improve the overall efficiency of the queue process. The transition to the new queue process began on July 10, 2023.

The transition to the new queue process began on July 10, 2023. The last open queue prior to July 10, 2023, was AJ1. The new process includes a transition which treats projects based on their current queue status. All projects through queue window AD2 will continue as part of the previous queue process. The transition process assigns existing queue projects in queue windows AE1 through AH1 to transition cycle 1 (TC1) and transition cycle 2 (TC2) and also provides for the expedited treatment (fast track) of projects submitted in the AE1 through AG1 queue windows with upgrade costs less than \$5 million. The start of the transition to the new queue process on July 10, 2023, also started the 60 day readiness review period for active projects in the AE1 through AG1 queues. During this time, project developers provided evidence of site control and provided the necessary readiness deposit.<sup>57</sup> Those projects in the AE1 through AG1 queues that had not yet received an interconnection service

agreement or a wholesale market power agreement and also met readiness requirements were reviewed to determine if they were eligible for the fast track process, or if they will be studied as part of transition cycle 1. Of the 734 projects in queues AE1 through AG1 reviewed, 306 projects (41.7 percent) qualified for the expedited process, 310 projects (42.2 percent) were assigned to transition cycle 1 and 118 projects (16.1 percent) were withdrawn from the queue. Transition cycle 1 began in early 2024. On December 20, 2024, coincident with the start of Phase 3 of Transition cycle 1, the application submission deadline for Transition cycle 2 closed. Phase 1 of Transition cycle 2 is expected to begin in the first quarter of 2025. Projects already submitted in queue windows AH2 through AJ1 will be evaluated starting in early 2026 under the new queue process. While new applications will continue to be accepted, the transition process will delay their consideration for an unknown period. The transition process itself will not begin until projects eligible for the existing queue process have an executed ISA or the equivalent. After the process for projects in transition cycles 1 and 2 has been completed, projects in queue AH2 and possible subsequent queues will be studied. The new process will not be fully implemented until PJM provides notice that it is accepting applications for the first cycle entirely under the new process. That notice will be provided only after PJM has complete all the prior required transition steps.

The transition process must also account for the fact that PJM significantly underestimated the level of CIRs required for intermittent resources. PJM had required only CIRs equal to the ELCC rating of intermittent resources when in fact those resources required CIRs equal to the maximum output that contributed to the ELCC rating. In general, CIRs were understated by the difference between the ELCC derating factor and the maximum facility output of the intermittent resource. PJM filed revised rules and FERC approved them.<sup>58</sup> PJM has created a process to permit such resources to increase their CIRs to the required level through appropriate investments in interconnection facilities.

On July 28, 2023, the Commission issued Order No. 2023.<sup>59</sup> The rule largely aligns with the PJM approach that has been accepted by FERC.<sup>60</sup> The rule addresses reforms to implement a first ready/first served cluster

<sup>56</sup> See "Interconnection Process Reform," presented at April 27, 2022 meeting of the Members Committee. <<https://www.pjm.com/-/media/committees-groups/committees/mc/2022/20220427/20220427-item-01a-1-interconnection-process-reform-presentation.ashx>>.

<sup>57</sup> See "PJM Manual 14H: New Service Requests Cycle Process," Rev. 00 (July 26, 2023) for a complete list of all readiness requirements.

<sup>58</sup> 183 FERC ¶61,009.

<sup>59</sup> See *Improvements to Generator Interconnection Procedures and Agreements*, Docket No. RM22-14-000, 184 FERC ¶ 61,054.

<sup>60</sup> 181 FERC ¶ 61,162 (2022).

study process, including cluster study costs and an allocation of network upgrade costs to the cluster, increased financial commitments and readiness requirements and improvements to the speed of the queue processing.

The MMU recommends improvements in queue management including that PJM establish a review process to ensure that projects are removed from the queue if they are not viable, as well as a process to allow commercially viable projects to advance in the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming.<sup>61</sup>

## Interconnection Process Studies and Agreements<sup>62</sup>

### Serial Service Process

Prior to implementation of the new Cycle Process, PJM used a Serial Service Process. In the study stage of the interconnection planning process, a series of studies are performed to determine the feasibility, impact, and cost of projects in the queue. Table 12-12 is an overview of the studies PJM performs in the study stage of the interconnection process. System impact and facilities studies are often redone when a project is withdrawn in order to determine the impact on the projects remaining in the queue.

**Table 12-12 Interconnection planning process: study stage**

Study	Purpose
Feasibility Study	The feasibility study determines preliminary estimates of the type, scope, cost and lead time for construction of facilities required to interconnect the project.
System Impact Study	The system impact study is a comprehensive regional analysis of the impact of adding the new generation and/or transmission facility to the system. The study identifies the system constraints related to the project and the necessary attachment facilities, local upgrades, and network upgrades. The study refines and more comprehensively estimates cost responsibility and construction lead times for facilities and upgrades.
Facilities Study	In the facilities study, stability analysis is performed and the system impact study results are modified as necessary to reflect changes in the characteristics of other projects in the queue.

In 2016, the PJM Earlier Queue Submitted Task Force stakeholder group made changes to the interconnection process to address some of the issues related to delays observed in the various stages of the study phase. The changes became effective with the AC2 Queue that closed on March 31, 2017. The MMU recommends continuing analysis of the study phase of PJM's transmission planning to reduce the need for postponements of study results, to decrease study completion times, and to improve the likelihood that a project at a given phase in the study process will successfully go into service.

In addition to the feasibility, system impact and facilities studies, PJM may also perform additional studies under certain circumstances. These studies include the affected systems study, interim deliverability study and the long term firm transmission studies. Table 12-13 is an overview of the additional studies PJM may perform.

**Table 12-13 Interconnection planning process: study stage – additional studies**

Study	Purpose
Affected System Study	PJM and its neighboring balancing authorities conduct interconnection studies to determine the impacts of interconnection requests on the neighboring transmission system.
Interim Deliverability Studies	Interim deliverability studies are conducted on a periodic basis in support of RPM auctions and other interconnection studies to determine if a new facility may come on line prior to its scheduled date. These studies evaluate the available system capability and provide the customer(s) with the availability of service by planning year. Interim deliverability studies use the same criteria used for the evaluation of the need for reinforcements associated with a project under study.
Long Term Firm Transmission Studies	Transmission service requests that extend beyond the available transfer capability horizon of 18 months are evaluated along with the other requests for service in the PJM new services queue to ensure deliverability. Long term firm transmission studies follow the same feasibility, system impact and facilities study process as new generation.

After the completion of a facility study, the project will enter the construction stage of the interconnection process. The final agreements required depend on the type of project. These agreements include a Construction Service Agreement (CSA), Interconnection Service Agreement (ISA), Upgrade Construction Service Agreement (UCSA),

<sup>61</sup> Once implemented, the approved solutions from PJM's Interconnection Process Reform Task Force (IPRTF) should result in improvements in these areas.

<sup>62</sup> See "PJM Manual 14A: New Services Request Process," Rev. 30 (July 26, 2023) for a complete explanation of the interconnection process studies and agreements.

Wholesale Market Participant Agreement (WMPA) or Transmission Service Agreement (TSA). Table 12-14 is an overview of the agreements in the construction stage of the interconnection process.

**Table 12-14 Interconnection planning process: construction stage agreements**

Agreement	Purpose
Interconnection Service Agreement (ISA)	An ISA defines the generation or transmission developer's cost responsibility for required system upgrades. For generation interconnection customers, the ISA defines the capacity interconnection rights for a capacity resource and any operational restrictions or other limitations. For transmission interconnection customers, the ISA defines transmission injection and withdrawal rights and applicable incremental delivery, available transfer capability revenue and auction revenue rights.
Interim Interconnection Service Agreements (I-ISA)	If a developer wishes to start project construction activities prior to completion of the generation or transmission interconnection facilities study, the interim ISA would commit the developer to pay all costs incurred for the construction activities being advanced.
Interconnection Construction Service Agreement (CSA)	The CSA defines the standard terms and conditions of the interconnection, including construction responsibility, includes a construction schedule and contains notification and insurance obligations.
Upgrade Construction Service Agreement (USCA)	A new service customer who proposes to make an upgrade to an existing transmission facility or who seeks incremental auction revenue rights (IARRs) will receive an upgrade construction service agreement after their study process is completed.
Wholesale Market Participation Agreement (WMPA)	Developers interconnecting to non-FERC jurisdictional facilities who intend to participate in the PJM wholesale market will receive a three party agreement (WMPA). The WMPA is a non-Tariff agreement which must be filed with the FERC. The WMPA is essentially an ISA without interconnection provisions.

## New Service Requests Cycle Process<sup>63</sup>

The transition to the new queue process began on July 10, 2023. The new queue process includes modifications to implement a cluster/cycle based processing method to replace the first in/first out processing method.<sup>64</sup> Each cycle consists of the: application phase, phase I, decision point I, phase II, decision point II, phase III, decision point III, and the final agreement negotiation phase.

### Application Phase

The application phase includes the submission and review of a new service request. A new service request could be a request to interconnect a new generating facility, a request to increase the capability of an existing generating facility, a request to interconnect a merchant transmission facility, a request to increase the capability of an existing merchant transmission facility, a request to interconnect a generating facility to distribution facilities located in PJM that are to be used for transmission of power in interstate commerce, and to make wholesale sales or a long term firm transmission service request outside of the 18 month available transfer capability (ATC) horizon. The deadline for submitting applications for a new cycle corresponds with the completion of phase II of the previous cycle. For an application to be considered complete, and included

in a cycle, PJM must receive a completed and executed application and studies agreement (ASA), required technical information, a wire transfer for the entirety of study deposit, a wire transfer or letter of credit for the entirety of Readiness Deposit No. 1 and, for generation requests, evidence of site control.

### Phase I

Phase 1 of a cycle begins after the application phase of a cycle is completed and a group of valid new service requests is established. During phase I of a cycle, PJM performs a phase I system impact study (SIS). The phase I SIS is conducted on an aggregate basis within a cycle, and results are provided in a single cycle format. The phase I SIS results are posted on PJM's website. The phase I SIS evaluates each new service request on a summer peak, winter peak and light load RTEP base case. PJM only performs a load flow analysis during the phase I system impact study. In phase I of the cycle, PJM also conducts an affected system screen and provides each affected system operator with a list of new service requests within the cycle including potential impacts to their system. During phase 1, PJM creates both the short circuit and stability base cases that will be used in the phase II SIS.

<sup>63</sup> Material in this section is based on information found in PJM Manual 14H. See "PJM Manual 14H: New Service Requests Cycle Process," Rev. 00 (July 26, 2023).

<sup>64</sup> See "Interconnection Process Reform," presented at April 27, 2022 meeting of the Members Committee. <<https://www.pjm.com/-/media/committees-groups/committees/mc/2022/20220427/20220427-item-01a-1-interconnection-process-reform-presentation.ashx>>.

### Decision Point I

New service requests that are studied in phase I will enter decision point I. After reviewing the results of the phase I SIS, the project developer must decide whether or not to move forward to phase II of the process. Decision point I starts on the first business day following the end of phase I and closes 30 calendar days later. Before the close of decision point I, the project developer can choose to either remain in the cycle by meeting the decision point I requirements or to withdraw its new service request. If a project developer fails to submit all required deposits, evidence, and data before the close of decision point I, the new service request will be terminated and withdrawn.

### Phase II

After the decision point I phase of a cycle is completed and a group of valid new service requests is established, phase II of a cycle will begin. During phase II of a cycle, PJM performs the phase II SIS. PJM retools the load flow results from the phase I SIS (summer peak, winter peak and light load) based on decisions made during decision point I. PJM also conducts any required voltage analyses, performs short circuit and stability analyses and coordinates with affected systems to confirm which projects in the cycle will require affected system studies. If the affected system operator indicates that an affected system study is required, PJM notifies the project developer of the need for an affected system study and the requirement to execute an affected system study agreement with the impacted affected system operator. If applicable and available, PJM includes the results of the affected system operator's affected system study in the phase II SIS results.

The phase II SIS includes a facilities study by the affected transmission owner that identifies any required network upgrades. The facilities studies will include good faith estimates of the costs to be charged to each affected new service customer for the network upgrades that are necessary to accommodate each new service request evaluated in the study, the time required to complete detailed design and construction of the facilities and upgrades and a description of any site-specific environmental issues or requirements that could reasonably be anticipated to affect the cost or time required to complete construction of such facilities and upgrades.

### Decision Point II

New service requests that are studied in phase II will enter decision point II. After reviewing the results of the phase II SIS, the project developer must decide whether or not to move forward to phase III of the process. Decision point II starts on the first business day following the end of phase II and closes 30 calendar days later. Before the close of decision point II, the project developer can choose to either remain in the cycle by meeting the decision point II requirements or to withdraw its new service request. If a project developer fails to submit all required deposits, evidence, and data before the close of decision point II, the new service request will be terminated and withdrawn.

### Phase III

After the decision point II phase of a cycle is completed and a group of valid new service requests is established, phase III of a cycle will begin. During phase III of a cycle, PJM performs the phase III SIS. PJM retools the load flow, short circuit and stability results from the phase II SIS based on decisions made during decision point II. PJM also coordinates with affected systems to conduct any studies required to determine the final impact of a new service request on any affected system. If applicable and available, PJM includes the results of the affected system operator's final affected system study in the phase III SIS results.

### Decision Point III

New service requests that are studied in phase III will enter decision point III. After reviewing the results of the phase III SIS, the project developer must decide whether or not to move forward to the final agreement negotiation phase. Decision point III starts on the first business day following the end of phase III and runs concurrently with the final agreement negotiation phase. The project developer can choose to either remain in the cycle by meeting the decision point III requirements or to withdraw its new service request. If a project developer fails to submit all required deposits, evidence, and data before the close of decision point III, the new service request will be terminated and withdrawn.

### Final Agreement Negotiation Phase

The final agreement negotiation phase starts on the first business day immediately following the end of phase III, and runs concurrently with decision point III. The purpose of the final agreement negotiation phase is

to negotiate, execute and enter into the applicable final interconnection related service agreement, conduct any remaining analyses or updated analyses based on new service requests withdrawn during decision point III and adjust the security obligation based on new service requests withdrawn during decision point III and/or during the final agreement negotiation phase. PJM uses reasonable efforts to complete the final agreement negotiation phase within 60 days. Table 12-15 is an overview of the agreements used in the new service requests cycle process.

**Table 12-15 Final agreements: new service requests cycle process**

Agreement	Purpose
Generation Interconnection Agreement (GIA)	The GIA defines the obligations of the project developer regarding cost responsibility for any required system upgrades. The GIA also confers the rights associated with the interconnection of a generating facility as a capacity resource and any operational restrictions or other limitations on which those rights depend. For transmission project developers, the GIA confers transmission injection and withdrawal rights and applicable incremental delivery rights and incremental auction revenue rights. The GIA further identifies any changes in construction responsibility from the standard option for transmission owner interconnection facilities due to the project developer exercising the negotiated contract option or option to build.
Construction Service Agreement (CSA)	The CSA defines the standard terms and conditions of the interconnection, including construction responsibility, includes a construction schedule and contains notification and insurance obligations. The CSA is included as a schedule within a GIA; however, a stand-alone CSA may be implemented in circumstances in which network upgrades to the system of a transmission owner are required to accommodate the interconnection request of a project developer, whose facilities do not directly interconnect to the transmission owner's system. Examples include project developers who are affected system customers (external to the PJM region), that require network upgrades to be constructed by PJM transmission owners, or project developers requiring upgrades to be constructed by PJM transmission owners, other than their interconnecting transmission owner
Upgrade Construction Service Agreement (USCA)	A new service customer who proposes to make an upgrade to an existing transmission facility or who seeks incremental auction revenue rights (IARRs) will receive an upgrade construction service agreement after their study process is completed.
Network Upgrade Cost Responsibility Agreement (NUCRA)	The NUCRA refers to the agreement entered into by two or more project developers and PJM, relating to construction of common use upgrades (network upgrades needed for the interconnection of generating or merchant transmission facilities for more than one project developer that share cost responsibility) and coordination of the construction and interconnection of associated generating facilities. A separate NUCRA will be executed for each set of common use upgrades on the system of a specific transmission owner that is associated with the interconnection of a generating facility or merchant transmission facility. The NUCRA includes the identified common use upgrades scope and schedule of work, the cost responsibility for the project developers that share cost responsibility, as well as the terms and conditions for the agreement.
Wholesale Market Participation Agreement (WMPA)	Developers interconnecting to non-FERC jurisdictional facilities who intend to participate in the PJM wholesale market will receive a three party agreement (WMPA). The WMPA is a non-Tariff agreement which must be filed with the FERC. The WMPA is essentially an ISA without interconnection provisions.

## Planned Generation Additions

Expected net revenues provide incentives to build new generation to serve PJM markets. The amount of planned new generation in PJM reflects investors' perception of the incentives provided by the combination of revenues from the PJM energy, capacity and ancillary service markets and from federal and state subsidies and incentives. On December 31, 2024, 221,297.3 were in generation request queues for construction through 2031. Although it is clear that not all generation in the queues will be built, PJM has added capacity steadily since markets were implemented on April 1, 1999.<sup>65</sup>

There were 268,490.7 MW in generation queues, in the status of active, under construction or suspended, at the end of 2023. As projects move through the queue process, projects can be removed from the queue due to incomplete or invalid data, withdrawn by the market participant or placed in service. On December 31, 2024, there were 221,297.3 MW in generation queues, in the status of active, under construction or suspended, a decrease of 47,193.4 MW (17.6 percent) from December 31, 2023. Table 12-16 shows MW in queues by expected completion year and MW changes in the queue between December 31, 2023, and December 31, 2024, for ongoing projects, i.e. projects with the status active, under construction or suspended.<sup>66</sup>

<sup>65</sup> See "PJM Generation Capacity and Funding Sources 2007/2008 through 2021/2022 Delivery Years," <[http://www.monitoringanalytics.com/reports/Reports/2020/IMM\\_2020\\_PJM\\_Generation\\_Capacity\\_and\\_Funding\\_Sources\\_20072008\\_through\\_20212022\\_DY\\_20200915.pdf](http://www.monitoringanalytics.com/reports/Reports/2020/IMM_2020_PJM_Generation_Capacity_and_Funding_Sources_20072008_through_20212022_DY_20200915.pdf)>.

<sup>66</sup> Expected completion dates are entered when the project enters the queue. Actual completion dates are generally different than expected completion dates.



**Table 12-16 Queue comparison by expected completion year (MW): December 31, 2023 and December 31, 2024<sup>67</sup>**

Year	Year Change			
	As of 12/31/2023	As of 12/31/2024	MW	Percent
2008	0.0	0.0	0.0	0.0%
2009	0.0	0.0	0.0	0.0%
2010	0.0	0.0	0.0	0.0%
2011	0.0	0.0	0.0	0.0%
2012	0.0	0.0	0.0	0.0%
2013	0.0	0.0	0.0	0.0%
2014	0.0	0.0	0.0	0.0%
2015	0.0	0.0	0.0	0.0%
2016	0.0	0.0	0.0	0.0%
2017	0.0	0.0	0.0	0.0%
2018	44.0	44.0	0.0	0.0%
2019	69.1	69.1	0.0	0.0%
2020	525.6	517.6	(8.0)	(1.5%)
2021	5,354.9	4,406.3	(948.6)	(17.7%)
2022	17,076.4	13,177.5	(3,898.9)	(22.8%)
2023	29,738.7	26,946.5	(2,792.2)	(9.4%)
2024	50,033.7	46,730.8	(3,302.9)	(6.6%)
2025	43,669.8	44,554.2	884.3	2.0%
2026	31,923.9	34,083.2	2,159.3	6.8%
2027	19,681.3	21,783.5	2,102.2	10.7%
2028	7,498.8	11,267.1	3,768.3	50.3%
2029	10,310.2	11,552.7	1,242.5	12.1%
2030	3,770.9	4,020.9	250.0	6.6%
2031	1,600.0	2,144.0	544.0	34.0%
Total	221,297.3	221,297.3	0.0	0.0%

Table 12-17 shows the project status changes in more detail and how scheduled queue MW have changed between December 31, 2023, and December 31, 2024. For example, of the total 235,611.7 MW marked as active on December 31, 2023, 25,039.0 MW were withdrawn, 4,888.5 MW were suspended, 4,656.5 MW started construction, and 880.2 MW went into service by December 31, 2024. Analysis of projects that were suspended on December 31, 2023 show that 2,149.0 MW came out of suspension and are now active as of December 31, 2024.

**Table 12-17 Change in project status (MW): December 31, 2023, to December 31, 2024**

Status at 12/31/2023	Status at 12/31/2024					
	Total at 12/31/2023	Active	In Service	Under Construction	Suspended	Withdrawn
(Entered during 2024)	0.0	0.0	0.0	0.0	0.0	0.0
Active	235,611.7	200,147.5	880.2	4,656.5	4,888.5	25,039.0
In Service	86,961.2	0.0	86,944.9	0.0	0.0	16.3
Under Construction	6,888.1	0.0	3,964.5	1,771.5	1,136.0	16.1
Suspended	9,923.0	2,149.0	0.0	434.9	6,113.4	1,225.7
Withdrawn	488,513.9	0.0	0.0	0.0	0.0	488,513.9
Total	827,897.9	202,296.5	91,789.6	6,862.9	12,137.9	514,811.0

On December 31, 2024, 221,297.3 were in generation request queues in the status of active, suspended or under construction. Table 12-18 shows each status by unit type. Of the 202,296.5 MW in the status of Active on December 31, 2024, 4,750.0 MW (2.3 percent) were combined cycle projects. Of the 6,862.9 MW in the status of under construction, 1,093.8 MW (15.9 percent) were combined cycle projects and 3,839.3 MW (55.9 percent) were solar projects. A significant amount of renewable hybrid projects (defined as solar + storage, solar + wind and wind + storage projects) have entered the queue in recent years. Of the 202,296.5 MW in the status of Active on December 31, 2024, 29,647.2 MW (14.7 percent) were renewable hybrid projects. Of the 6,862.9 MW in the status of under construction, 257.1 MW (3.8 percent) were renewable hybrid projects.

<sup>67</sup> Wind and solar capacity in Table 12-15 through Table 12-19 have not been adjusted to reflect derating.

**Table 12-18 Current project status (MW) by unit type: December 31, 2024**

	CT -					Hydro -		Hydro -		RICE -				Solar +				Steam -				Wind +	
	Combined		Natural	CT -		Fuel	Pumped	Run of	Natural		RICE -	RICE -	Solar +	Solar +	Steam	Natural	Steam	Steam	Wind				
	Battery	Cycle	Gas	CT -	Oil	Other	Cell	Storage	River	Nuclear	Gas	Oil	Other	Solar	Storage	Wind	- Coal	Gas	- Oil	- Other	Wind	Storage	Total
Active	44,522.9	4,750.0	1,848.7	0.0	49.3	5.0	0.0	92.3	0.0	0.0	0.0	0.0	89,346.4	29,288.2	209.0	0.0	0.0	0.0	10.0	32,024.7	150.0	202,296.5	
Suspended	642.9	1,845.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	7,650.0	17.5	0.0	0.0	0.0	0.0	0.0	1,982.5	0.0	12,137.9	
Under Construction	21.0	1,093.8	60.0	0.0	0.0	0.0	0.0	12.0	44.0	0.0	0.0	0.0	3,839.3	257.1	0.0	65.0	0.0	0.0	0.0	1,470.7	0.0	6,862.9	
Total	45,186.8	7,688.8	1,908.7	0.0	49.3	5.0	0.0	104.3	44.0	0.0	0.0	0.0	100,835.8	29,562.7	209.0	65.0	0.0	0.0	10.0	35,477.9	150.0	221,297.3	

A significant shift in the distribution of unit types within the PJM footprint continues to develop as renewable, hybrid and other intermittent resources enter the queue, fewer natural gas fired units enter the queue, and coal fired steam units retire. As of December 31, 2024, of the 221,297.3 MW in the generation request queues in the status of active, suspended or under construction, 100,835.8 MW (45.6 percent) were solar projects, 35,477.9 MW (16.0 percent) were wind projects, 9,597.5 MW (4.3 percent) were natural gas fired projects (including combined cycle units, CTs, RICE units, and natural gas fired steam units), 29,921.7 MW (13.5 percent) were renewable hybrid projects (solar + storage, solar + wind and wind + storage units), and 65.0 MW (.03 percent) were coal fired steam projects.

As of December 31, 2024, there are 1,683.0 MW of coal fired steam units and 1,404.9 MW of natural gas units slated for deactivation between January 1, 2025, and December 31, 2028 (See Table 12-11). The ongoing replacement of coal fired steam units by natural gas units will continue to significantly affect future congestion, the role of firm and interruptible gas supply, and natural gas supply infrastructure. The growing level of renewables, hybrids and other intermittents will have increasingly significant impacts on the energy and capacity markets.

On December 31, 2024, 37,129.1 MW, on an energy basis, were in generation request queues that had reached the construction service agreement milestone or equivalent, in the status of active, suspended or under construction. Table 12-19 shows the status by unit type. Of the 37,129.1 MW, 18,148.1 MW (48.9 percent) had not begun construction, 12,137.9 MW (32.7 percent) began construction, but are now suspended and 6,843.1 MW (18.4 percent) are currently under construction. Reaching the final milestone required prior to construction does not mean a project will immediately begin construction or even that it necessarily will ever begin construction.

**Table 12-19 Current status (MW) by unit type for projects that have reached the CSA Milestone: December 31, 2024**

	CT -					Hydro - Hydro -		RICE -				Steam -										
	Combined Natural		CT -		Fuel	Pumped	Run of	Natural		RICE -		Solar +		Solar +	Steam	Natural			Wind +			
	Battery	Cycle	Gas	CT - Oil	Other	Cell	Storage	River	Nuclear	Gas	Oil	Other	Solar	Storage	Wind	- Coal	Gas	- Oil	- Other	Wind	Storage	Total
Active	801.0	2,314.0	599.0	0.0	0.0	0.0	0.0	26.3	0.0	0.0	0.0	0.0	8,510.4	503.4	0.0	0.0	0.0	0.0	0.0	5,394.0	0.0	18,148.1
Suspended	642.9	1,845.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	7,650.0	17.5	0.0	0.0	0.0	0.0	0.0	1,982.5	0.0	12,137.9
Under Construction	21.0	1,093.8	60.0	0.0	0.0	0.0	0.0	12.0	44.0	0.0	0.0	0.0	3,819.5	257.1	0.0	65.0	0.0	0.0	0.0	1,470.7	0.0	6,843.1
Total	1,464.9	5,252.8	659.0	0.0	0.0	0.0	0.0	38.3	44.0	0.0	0.0	0.0	19,979.9	778.0	0.0	65.0	0.0	0.0	0.0	8,847.2	0.0	37,129.1

Table 12-20 shows the total MW in the status of active, in service, under construction, suspended, or withdrawn for each queue since the beginning of the RTEP process and the total MW that had been included in each queue. All projects in queues A-R are either in service or have been withdrawn. As of December 31, 2024, there are 221,297.3 MW in queues that are not yet in service or withdrawn, of which 5.5 percent are suspended, 3.1 percent are under construction and 91.4 percent have not begun construction.

Table 12-20 Queue totals by status (MW): December 31, 2024<sup>68</sup>

Queue	Under					Total
	Active	In Service	Construction	Suspended	Withdrawn	
A Expired 31-Jan-98	0.0	9,102.0	0.0	0.0	17,252.0	26,354.0
B Expired 31-Jan-99	0.0	4,292.4	0.0	0.0	14,958.8	19,251.2
C Expired 31-Jul-99	0.0	531.0	0.0	0.0	3,558.3	4,089.3
D Expired 31-Jan-00	0.0	850.6	0.0	0.0	7,358.0	8,208.6
E Expired 31-Jul-00	0.0	795.2	0.0	0.0	8,021.8	8,817.0
F Expired 31-Jan-01	0.0	52.0	0.0	0.0	3,092.5	3,144.5
G Expired 31-Jul-01	0.0	1,171.6	0.0	0.0	17,961.8	19,133.4
H Expired 31-Jan-02	0.0	702.5	0.0	0.0	8,421.9	9,124.4
I Expired 31-Jul-02	0.0	103.0	0.0	0.0	3,728.4	3,831.4
J Expired 31-Jan-03	0.0	42.0	0.0	0.0	846.0	888.0
K Expired 31-Jul-03	0.0	93.1	0.0	0.0	485.3	578.4
L Expired 31-Jan-04	0.0	256.5	0.0	0.0	4,033.7	4,290.2
M Expired 31-Jul-04	0.0	504.8	0.0	0.0	3,705.6	4,210.4
N Expired 31-Jan-05	0.0	2,398.8	0.0	0.0	8,129.3	10,528.0
O Expired 31-Jul-05	0.0	1,890.2	0.0	0.0	5,466.8	7,357.0
P Expired 31-Jan-06	0.0	3,290.3	0.0	0.0	5,320.5	8,610.8
Q Expired 31-Jul-06	0.0	3,147.9	0.0	0.0	11,385.7	14,533.6
R Expired 31-Jan-07	0.0	1,892.5	0.0	0.0	20,708.9	22,601.4
S Expired 31-Jul-07	0.0	3,543.5	54.9	0.0	12,396.5	15,994.9
T Expired 31-Jan-08	0.0	4,196.5	0.0	0.0	23,313.3	27,509.8
U1 Expired 30-Apr-08	0.0	218.9	0.0	0.0	7,937.8	8,156.7
U2 Expired 31-Jul-08	0.0	716.9	0.0	0.0	16,218.6	16,935.5
U3 Expired 31-Oct-08	0.0	333.0	0.0	0.0	2,635.6	2,968.6
U4 Expired 31-Jan-09	0.0	85.2	0.0	0.0	4,945.0	5,030.2
V1 Expired 30-Apr-09	0.0	197.9	0.0	0.0	2,572.8	2,770.7
V2 Expired 31-Jul-09	0.0	989.9	0.0	0.0	3,641.2	4,631.1
V3 Expired 31-Oct-09	0.0	1,132.0	0.0	0.0	3,822.7	4,954.7
V4 Expired 31-Jan-10	0.0	748.8	0.0	0.0	3,708.0	4,456.8
W1 Expired 30-Apr-10	0.0	567.4	0.0	0.0	5,139.5	5,706.9
W2 Expired 31-Jul-10	0.0	351.7	0.0	0.0	3,051.7	3,403.4
W3 Expired 31-Oct-10	0.0	505.5	0.0	0.0	8,695.9	9,201.4
W4 Expired 31-Jan-11	0.0	1,415.8	0.0	0.0	4,152.6	5,568.4
X1 Expired 30-Apr-11	0.0	1,101.7	0.0	0.0	6,200.6	7,302.3
X2 Expired 31-Jul-11	0.0	3,706.4	0.0	0.0	5,578.4	9,284.7
X3 Expired 31-Oct-11	0.0	109.2	0.0	0.0	7,665.9	7,775.1
X4 Expired 31-Jan-12	0.0	2,948.9	0.0	0.0	2,419.4	5,368.3
Y1 Expired 30-Apr-12	0.0	1,795.5	0.0	0.0	6,279.7	8,075.2
Y2 Expired 31-Oct-12	0.0	1,477.2	0.0	0.0	9,636.5	11,113.7
Y3 Expired 30-Apr-13	0.0	1,630.5	0.0	0.0	4,609.2	6,239.6
Z1 Expired 31-Oct-13	0.0	3,283.5	0.0	0.0	4,730.0	8,013.5
Z2 Expired 30-Apr-14	0.0	3,058.6	0.0	0.0	3,037.8	6,096.5
AA1 Expired 31-Oct-14	0.0	4,868.9	150.0	78.2	6,973.4	12,070.5
AA2 Expired 30-Apr-15	550.0	3,031.6	0.0	0.0	12,484.7	16,066.3
AB1 Expired 31-Oct-15	1,436.8	2,800.6	976.0	575.0	14,665.3	20,453.7
AB2 Expired 31-Mar-16	349.8	3,534.5	290.2	49.9	10,918.4	15,142.8
AC1 Expired 30-Sep-16	572.2	5,261.4	694.7	1,108.7	12,399.0	20,035.9
AC2 Expired 30-Apr-17	842.7	1,212.8	453.8	672.6	9,387.8	12,569.6
AD1 Expired 30-Sep-17	1,047.0	1,229.8	1,092.6	940.0	6,927.2	11,236.6
AD2 Expired 31-Mar-18	472.0	1,473.1	927.4	1,464.8	15,801.3	20,138.6
AE1 Expired 30-Sep-18	4,065.7	471.3	570.7	3,961.4	24,597.1	33,666.1
AE2 Expired 31-Mar-19	8,935.2	1,411.6	646.0	2,400.9	20,321.3	33,715.0
AF1 Expired 30-Sep-19	11,449.9	946.7	672.8	657.7	14,821.0	28,548.1
AF2 Expired 31-Mar-20	13,826.9	278.7	283.0	138.8	13,278.2	27,805.5
AG1 Expired 30-Sep-20	18,998.2	36.8	50.8	90.0	18,022.2	37,197.9
AG2 Expired 31-Mar-21	44,231.8	1.0	0.0	0.0	12,383.2	56,616.0
AH1 Expired 10-Sep-21	35,999.0	0.0	0.0	0.0	13,796.6	49,795.6
AH2 Expired 10-Mar-22	26,586.7	0.0	0.0	0.0	7,758.8	34,345.5
AI1 Expired 10-Sep-22	20,360.3	0.0	0.0	0.0	3,329.7	23,690.0
AI2 Expired 10-Mar-23	8,099.4	0.0	0.0	0.0	122.0	8,221.4
AJ1 Expired 10-Sep-23	4,473.0	0.0	0.0	0.0	0.0	4,473.0
Total	202,296.5	91,789.6	6,862.9	12,137.9	514,811.0	827,897.9

<sup>68</sup> Projects listed as partially in service are counted as in service for the purposes of this analysis.

Table 12-21 shows the projects with a status of active, suspended or under construction, by unit type, and control zone. As of December 31, 2024, 221,297.3 MW were in generation request queues for construction through 2031. Table 12-21 also shows the planned retirements for each zone.

**Table 12-21 Queue totals for projects (active, suspended and under construction) by LDA, control zone and unit type (MW): December 31, 2024<sup>69</sup>**

LDA	Zone	CT -						Hydro -		Hydro -		RICE -				Steam -				Total		Planned	
		Battery	CC	Natural Gas	CT - Oil	CT - Other	Fuel Cell	Pumped Storage	Run of River	Nuclear	Natural Gas	RICE - Oil	RICE - Other	Solar	Solar + Storage	Solar + Wind	Steam - Coal	Natural Gas	Oil	Other	Wind + Storage		Queue Capacity
EMAAC	ACEC	1,544.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	620.7	203.0	0.0	0.0	0.0	0.0	0.0	1,941.6	0.0	4,309.3	0.0
	DPL	590.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,910.8	325.5	0.0	0.0	0.0	0.0	10.0	6,049.5	0.0	8,885.9	595.3
	JCPLC	1,360.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	615.2	140.0	0.0	0.0	0.0	0.0	0.0	11,916.9	0.0	14,032.1	5.0
	PECO	0.0	0.0	0.0	0.0	0.0	0.0	0.0	44.0	0.0	0.0	0.0	82.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	126.8	762.0
	PSEG	1,210.0	51.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	16.0	0.0	0.0	0.0	0.0	0.0	0.0	1,310.0	0.0	2,587.1	15.0
	REC	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	EMAAC Total	4,704.0	51.1	0.0	0.0	0.0	0.0	0.0	0.0	44.0	0.0	0.0	3,245.6	668.5	0.0	0.0	0.0	0.0	10.0	21,218.0	0.0	29,941.2	1,377.3
SWMAAC	BGE	1,195.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	154.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,349.9	2,168.8
	PEPCO	2,117.0	45.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	184.2	809.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3,155.7	108.0
	SWMAAC Total	3,312.0	45.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	339.1	809.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4,505.6	2,276.8
WMAAC	MEC	615.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	314.6	201.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,130.9	0.0
	PE	1,000.0	30.0	0.0	0.0	3.6	0.0	0.0	0.0	0.0	0.0	0.0	4,042.7	1,560.9	0.0	0.0	0.0	0.0	0.0	436.7	0.0	7,073.9	0.0
	PPL	170.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,587.9	480.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2,238.1	0.0
	WMAAC Total	1,785.0	30.0	0.0	0.0	3.6	0.0	0.0	0.0	0.0	0.0	0.0	5,945.2	2,242.4	0.0	0.0	0.0	0.0	0.0	436.7	0.0	10,442.9	0.0
Non-MAAC	AEP	10,646.5	1,150.0	791.0	0.0	35.6	0.0	0.0	51.0	0.0	0.0	0.0	38,701.7	12,188.9	0.0	65.0	0.0	0.0	0.0	2,541.2	0.0	66,170.9	0.0
	AMPT	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	105.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	105.0	0.0
	APS	2,404.0	4,055.0	30.0	0.0	0.0	0.0	0.0	15.0	0.0	0.0	0.0	3,506.9	3,639.9	0.0	0.0	0.0	0.0	0.0	1,014.0	0.0	14,664.8	0.0
	ATSI	1,138.0	1,068.0	458.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4,236.7	316.6	0.0	0.0	0.0	0.0	0.0	297.7	0.0	7,515.7	0.0
	COMED	8,777.6	677.7	60.0	0.0	0.0	5.0	0.0	0.0	0.0	0.0	0.0	12,538.0	1,626.5	199.0	0.0	0.0	0.0	0.0	6,503.1	0.0	30,386.9	1,630.7
	DAY	390.0	0.0	0.0	0.0	10.0	0.0	0.0	0.0	0.0	0.0	0.0	2,508.0	560.9	0.0	0.0	0.0	0.0	0.0	100.0	0.0	3,569.0	0.0
	DUKE	302.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	177.0	800.0	10.0	0.0	0.0	0.0	0.0	0.0	0.0	1,289.2	0.0
	DLCO	105.0	0.0	0.0	0.0	0.0	0.0	0.0	38.3	0.0	0.0	0.0	34.7	107.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	285.5	0.0
	DOM	11,474.5	612.0	569.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	22,864.3	5,030.5	0.0	0.0	0.0	0.0	0.0	3,367.3	150.0	44,067.6	0.0
	EKPC	148.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6,413.6	1,393.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	7,954.7	0.0
	OVEC	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	220.0	178.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	398.5	0.0
	RMU	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
	Non-MAAC Total	35,385.8	7,562.7	1,908.7	0.0	45.7	5.0	0.0	104.3	0.0	0.0	0.0	91,305.9	25,842.3	209.0	65.0	0.0	0.0	0.0	13,823.3	150.0	176,407.6	1,630.7
Total		45,186.8	7,688.8	1,908.7	0.0	49.3	5.0	0.0	104.3	44.0	0.0	0.0	100,835.8	29,562.7	209.0	65.0	0.0	0.0	10.0	35,477.9	150.0	221,297.3	5,284.8

## Withdrawn Projects

The queue contains a substantial number of projects that are not likely to be built. The queue process results in a substantial number of projects that are withdrawn. Manual 14B requires PJM to apply a commercial probability factor at the feasibility study stage to improve the accuracy of capacity and cost estimates. The commercial probability factor is based on the historical incidence of projects dropping out of the queue at the impact study stage, but the actual calculation of commercial probability factors is less than transparent.<sup>70</sup> The impact and facilities studies are performed using the full amount of planned generation in the queues. The actual withdrawal rates are shown in Table 12-22 and Table 12-23.

Table 12-22 shows the milestone status when projects were withdrawn, for all withdrawn projects. Of the 4,401 projects withdrawn as of December 31, 2024, 2,257 (51.3 percent) were withdrawn before the system impact study was completed. Once a Construction Service Agreement (CSA) is executed, the financial obligation for any necessary transmission upgrades cannot be retracted. Of the 4,401 projects withdrawn, 801 projects (18.2 percent) were withdrawn after the completion of a Construction Service Agreement as of December 31, 2024.

**Table 12-22 Last milestone at time of withdrawal: January 1, 1997 through December 31, 2024**

	Projects		Average	Maximum	MW
Milestone Completed	Withdrawn	Percent	Days	Days	Withdrawn
Never Started	1,143	26.0%	90,530	386	2,841.0
Feasibility Study	1,114	25.3%	202,646	341	1,752.0
System Impact Study	962	21.9%	122,897	871	3,248.0
Facilities Study	381	8.7%	53,783	1,234	4,107.0
Construction Service Agreement (CSA) or beyond	801	18.2%	44,955	1,440	7,864.0
Total	4,401	100.0%			19,812.0

<sup>69</sup> This data includes only projects with a status of active, under construction, or suspended.

<sup>70</sup> See "PJM Manual 14B: PJM Region Transmission Planning Process," Rev. 56 (June 27, 2024).

## Average Time in Queue

Table 12-23 shows the time spent at various stages in the queue process and the completion time for the studies performed. For completed projects, there is an average time of 1,212 days, or 3.3 years, between entering a queue and going into service. For withdrawn projects, there is an average time of 767 days, or 2.1 years, between entering a queue and withdrawing.

**Table 12-23 Project queue times by status (days): December 31, 2024<sup>71</sup>**

Status	Average (Days)	Standard Deviation	Maximum
Active	1,263	470	3,533
In-Service	1,212	835	5,306
Suspended	2,295	425	3,787
Under Construction	2,498	652	6,496
Withdrawn	767	754	7,864

Table 12-24 presents information on the time in the stages of the queue for those projects not yet in service or already withdrawn. Of the 2,570 projects in the queue, in the status of active, under construction or suspended, as of December 31, 2024, 78 (3.0 percent) had a completed feasibility study and 397 (15.4 percent) had a completed construction service agreement.

**Table 12-24 Project queue times by milestone (days): December 31, 2024**

Milestone Reached	Number of Projects	Percent of Total Projects	Average Days	Maximum Days
Under Review	1,765	68.7%	2,493	2,985
Feasibility Study	78	3.0%	1,601	1,945
System Impact Study	167	6.5%	1,791	2,345
Facilities Study	163	6.3%	1,760	2,314
Construction Service Agreement (CSA) or beyond	397	15.4%	2,310	6,496
Total	2,570	100.0%		

Table 12-25 shows the time spent in the queue by fuel type, and year the project entered the queue, for projects that are in service. The time from when a project enters the queue to the time the project goes in service has generally been decreasing compared to the period prior to 2017 although there are significant exceptions. For example, for a battery project entering the queue in 2015, there was an average of 2,062 days from the time it entered the queue until it went in service, compared to 1,409 days when entering the queue in 2018.

**Table 12-25 Average time in queue (days) by fuel type and year submitted (In Service Projects): December 31, 2024<sup>72</sup>**

Unit Type	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023
Battery	983	609	417	692	789	2,062	941		1,409	972	1,084			
CC	1,310	1,551	1,663	1,419	1,175	1,208	1,199	1,013	1,140	1,069	1,634			
CT - Natural Gas	1,131	804	953	1,073	1,409	619	1,566	1,192	938	317	805			
CT - Oil	717		259							280				
CT - Other	729	634	954	1,248	718	360								
Fuel Cell						827				280				
Hydro - Pumped Storage						1,402								
Hydro - Run of River			1,325	614	332		580	426	606					
Nuclear	885	866		1,234			2,409	1,100	1,747					
RICE - Natural Gas			1,702	1,053	1,332	798		250		770				
RICE - Oil						1,849								
RICE - Other	638	1,385	1,479	241	627	622	491		466					
Solar	1,701	1,395	969	1,014	1,003	1,761	1,773	1,860	1,543	1,339	857			
Solar + Storage						635	322		553		1,176			
Solar + Wind														
Steam - Coal	745		513	1,010	583	853	684	647	1,122					
Steam - Natural Gas				1,182		421	751				1,217			
Steam - Oil														
Steam - Other	256	838	643											
Wind	2,748	2,711	1,750	2,103	1,205	1,463	1,620	1,398	1,289		997			
Wind + Storage							2,680							

<sup>71</sup> The queue data shows that some projects were withdrawn and a withdrawal date was not identified. These projects were removed for the purposes of this analysis.

<sup>72</sup> A blank cell in this table means that no project of that fuel type, which was submitted to the queue in that year, subsequently went in service.



Table 12-26 shows 827,897.9 MW have entered PJM generation queues from January 1, 1997, through December 31, 2024. Table 12-26 presents totals by fuel type and projected in service date as of December 31, 2024. Of the 827,897.9 MW to enter the queue, 351,951.3 MW (42.5 percent) were thermal units.

**Table 12-26 Total (MW Energy) by unit type and projected in service year: December 31, 2024**

	CT -					Hydro - Hydro -					RICE -					Steam -						
		Natural		CT -	Fuel		Hydro -	Run of		Natural		RICE -	RICE -		Solar +	Solar +	Steam -	Natural	Steam	Steam	Wind +	
Year	Battery	CC	Gas	CT -	Cell	Storage	River	Nuclear	Gas	Oil	Other	Solar	Storage	Wind	Coal	Gas	Oil	Other	Wind	Storage	Total	
1997	0.0	775.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4,911.0	0.0	0.0	0.0	0.0	0.0	5,686.0	
1998	0.0	4,659.0	0.0	0.0	3.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4,662.1	
1999	0.0	22,573.7	2.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	7.0	0.0	0.0	0.0	20.4	0.0	22,603.2	
2000	0.0	9,900.8	409.6	0.0	3.8	0.0	0.0	0.0	0.0	0.0	1.2	0.0	0.0	0.0	20.0	0.0	0.0	0.0	0.0	0.0	10,335.3	
2001	0.0	7,088.5	432.0	315.0	29.0	0.0	0.0	165.0	0.0	0.0	0.0	0.0	0.0	0.0	110.6	2.5	0.0	0.0	0.0	0.0	8,142.6	
2002	0.0	2,622.2	2,442.0	6.5	0.0	0.0	107.0	60.0	0.0	2.9	0.0	0.0	0.0	0.0	42.0	10.0	0.0	0.0	65.5	0.0	5,358.1	
2003	0.0	4,072.1	638.7	0.0	59.4	0.0	198.0	46.0	0.0	17.2	0.0	0.0	0.0	0.0	2.0	0.0	0.0	0.0	263.6	0.0	5,297.0	
2004	0.0	14,918.2	77.3	33.0	16.1	0.0	41.0	8.0	23.3	0.0	0.0	0.0	0.0	0.0	42.0	0.0	0.0	0.0	75.0	0.0	15,233.9	
2005	0.0	17,149.1	993.0	251.0	42.1	0.0	0.0	1,693.0	29.0	5.0	7.5	0.0	0.0	0.0	1,880.0	0.0	0.0	0.0	0.0	0.0	22,859.6	
2006	0.0	6,033.0	23.3	49.5	43.4	0.0	147.2	0.0	2.0	30.5	58.5	0.0	0.0	0.0	527.0	0.0	529.0	1,480.2	0.0	0.0	8,923.6	
2007	0.0	3,502.6	131.0	17.0	84.0	0.0	2.5	174.0	19.5	0.0	86.6	0.0	0.0	0.0	750.0	5.0	50.0	1,087.8	0.0	0.0	5,910.0	
2008	1.0	7,003.4	628.0	59.3	38.4	0.0	2.9	331.0	0.0	0.0	27.6	3.3	0.0	0.0	254.5	101.0	0.0	20.0	2,103.2	0.0	10,603.6	
2009	120.0	2,717.2	257.7	108.6	118.7	0.0	340.0	252.5	0.0	0.0	41.2	28.7	0.0	0.0	1,058.0	40.0	0.0	6.0	4,351.5	0.0	9,440.2	
2010	16.0	1,912.9	137.8	83.9	320.7	0.0	16.0	94.9	301.0	10.5	0.0	15.8	23.4	0.0	5,599.0	0.0	0.0	80.8	9,286.1	0.0	18,106.8	
2011	52.5	10,887.5	816.4	23.0	110.0	0.0	27.0	512.0	0.0	16.0	41.8	1,818.5	0.0	0.0	9,614.0	5.5	0.0	108.9	5,355.2	0.0	29,388.2	
2012	27.0	13,786.8	389.5	310.0	121.3	0.0	82.9	391.0	0.0	6.4	2.0	1,892.3	0.0	0.0	3,407.0	0.0	0.0	426.6	7,689.5	0.0	28,532.2	
2013	73.0	9,252.2	62.5	730.5	78.9	0.0	219.0	238.0	0.0	10.0	113.0	674.9	0.0	0.0	1,949.0	44.0	0.0	254.1	8,057.4	0.0	21,756.5	
2014	159.1	7,105.5	0.0	684.0	96.0	0.0	1,120.0	74.0	0.0	0.0	13.3	904.5	0.0	0.0	3,288.0	0.0	0.0	63.8	11,758.7	186.0	25,452.9	
2015	214.6	15,591.3	417.4	42.0	21.9	0.0	378.5	147.8	19.5	9.0	3.8	1,240.1	0.0	0.0	1,271.5	0.0	0.0	81.5	4,161.6	0.0	23,600.4	
2016	422.5	16,553.3	332.1	0.0	144.9	2.8	0.0	71.2	4,082.0	46.9	30.2	1,737.6	3.4	0.0	50.0	40.0	107.8	4,459.3	0.0	0.0	28,083.9	
2017	134.1	17,489.5	835.0	401.0	135.0	2.0	0.0	38.2	1,640.0	283.6	18.2	2,158.3	47.0	606.5	47.0	606.5	7.2	3,010.2	0.0	0.0	26,805.7	
2018	175.0	17,902.0	404.9	0.0	11.6	1.1	34.0	12.5	1,644.0	95.0	41.0	3,371.1	0.6	0.0	148.0	57.0	0.0	0.0	5,135.7	0.0	29,033.5	
2019	303.0	14,803.5	1,036.8	14.0	0.0	0.0	0.0	20.5	0.0	79.7	0.0	33.6	7,221.3	629.8	1,710.0	0.0	16.0	5,377.6	16.3	31,262.0		
2020	671.7	7,243.7	1,206.0	0.0	0.0	2.1	0.0	2.4	128.0	39.9	4.0	0.8	6,146.6	615.5	20.0	64.0	0.0	0.0	8,899.3	0.0	25,044.0	
2021	1,530.9	17,904.2	687.3	4.0	0.0	0.0	99.0	0.0	15.7	0.0	0.0	17,206.1	2,512.0	0.0	47.0	6.0	62.5	5,250.4	90.0	45,415.0		
2022	5,070.9	12,855.2	2,126.7	0.0	6.0	0.0	1,030.0	33.2	0.0	34.4	6.6	0.0	20,273.1	4,771.0	10.0	0.0	0.0	3,725.8	0.0	49,942.8		
2023	12,702.7	12,674.0	1,441.6	13.0	18.9	3.0	0.0	54.8	0.0	0.0	0.0	32,656.5	10,741.1	199.0	0.0	0.0	20.0	3,322.2	0.0	73,901.1		
2024	12,291.7	4,650.5	646.0	0.0	363.5	0.0	0.0	12.0	1,594.0	0.0	0.0	0.0	37,097.8	10,593.2	0.0	18.0	5.0	0.0	7,427.3	0.0	74,699.0	
2025	12,948.2	2,313.7	463.0	0.0	0.0	5.0	0.0	16.8	0.0	0.0	0.0	0.0	27,572.8	7,105.6	0.0	11.0	0.0	7,054.7	0.0	57,490.8		
2026	7,703.0	3,990.0	700.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	14,503.8	4,570.7	0.0	0.0	0.0	7,072.4	150.0	38,699.9		
2027	8,005.2	625.0	735.0	0.0	0.0	0.0	200.0	0.0	0.0	0.0	0.0	0.0	6,810.6	2,525.7	0.0	0.0	0.0	8,626.7	0.0	28,527.2		
2028	4,175.0	595.0	49.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4,342.0	2,282.0	0.0	0.0	0.0	2,009.8	0.0	13,453.1		
2029	1,050.0	0.0	569.0	0.0	0.0	0.0	0.0	9.5	0.0	0.0	0.0	851.6	333.0	0.0	0.0	0.0	0.0	12,999.8	0.0	15,812.9		
2030	250.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	360.0	0.0	0.0	0.0	0.0	0.0	3,480.9	0.0	4,090.9		
2031	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	150.0	394.0	0.0	0.0	0.0	0.0	3,200.0	0.0	3,744.0		
Total	68,096.9	291,150.5	19,091.0	3,145.3	1,866.6	15.9	1,620.0	3,043.4	13,275.0	683.7	110.8	586.2	189,253.1	47,077.5	209.0	36,783.6	986.5	0.0	1,844.2	148,616.4	442.3	827,897.9

Table 12-27 shows there are 221,297.3 MW in the queue in the status of active, under construction and suspended as of December 31, 2024. Table 12-27 presents totals by fuel type and projected in service date. Of the 221,297.3 MW, 9,662.5 MW (4.4 percent) are thermal units. Of the 176,136.3 MW with projected in service dates between 2024 and 2031, 8,349.0 MW (3.8 percent) are thermal units.

**Table 12-27 Total (MW Energy) by unit type and projected in service year (active, under construction and suspended): December 31, 2024**

	CT -					Hydro - Hydro -				RICE -				Steam -				Wind +					
	Natural					CT -	Fuel	Pumped	Run of	Nuclear	Natural	RICE -	RICE -	Solar +	Solar +	Steam	Natural	Steam	Wind				
Year	Battery	CC	Gas	CT -	Oil	Other	Cell	Storage	River	Nuclear	Gas	Oil	Other	Solar	Storage	Wind	- Coal	Gas	- Oil	- Other	Wind	Storage	Total
1997	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1998	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
1999	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2000	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2001	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2002	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2003	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2004	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2005	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2006	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2007	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2008	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2009	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2010	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2011	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2012	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2013	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2014	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2015	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2016	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2017	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
2018	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	44.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	44.0
2019	0.0	51.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	18.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	69.1
2020	50.0	0.0	33.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	422.0	0.0	0.0	0.0	0.0	0.0	0.0	12.6	0.0	517.6
2021	324.0	0.0	0.0	0.0	0.0	0.0	0.0	51.0	0.0	0.0	0.0	0.0	0.0	3,419.7	63.2	0.0	36.0	0.0	0.0	0.0	512.5	0.0	4,406.3
2022	1,408.4	127.0	497.4	0.0	6.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	7,952.7	1,999.9	10.0	0.0	0.0	0.0	0.0	1,176.1	0.0	13,177.5
2023	5,150.4	569.0	0.0	0.0	18.9	0.0	0.0	15.0	0.0	0.0	0.0	0.0	0.0	14,992.2	4,667.2	199.0	0.0	0.0	0.0	0.0	1,334.8	0.0	26,946.5
2024	9,277.6	128.0	0.0	0.0	24.4	0.0	0.0	12.0	0.0	0.0	0.0	0.0	0.0	25,854.3	8,673.7	0.0	18.0	0.0	0.0	0.0	2,742.9	0.0	46,730.8
2025	9,557.7	2,228.7	0.0	0.0	0.0	0.0	5.0	0.0	16.8	0.0	0.0	0.0	0.0	23,196.5	5,049.3	0.0	11.0	0.0	0.0	0.0	4,489.1	0.0	44,554.2
2026	2,713.0	3,990.0	700.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	12,984.6	3,728.4	0.0	0.0	0.0	0.0	10.0	5,307.2	150.0	34,083.2
2027	7,430.7	0.0	60.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6,686.1	2,372.2	0.0	0.0	0.0	0.0	0.0	5,232.5	0.0	21,783.5
2028	3,775.0	595.0	49.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4,016.0	2,282.0	0.0	0.0	0.0	0.0	0.0	549.8	0.0	11,267.1
2029	750.0	0.0	569.0	0.0	0.0	0.0	0.0	9.5	0.0	0.0	0.0	0.0	0.0	851.6	333.0	0.0	0.0	0.0	0.0	0.0	9,039.6	0.0	11,552.7
2030	250.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	290.0	0.0	0.0	0.0	0.0	0.0	0.0	3,480.9	0.0	4,020.9
2031	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	150.0	394.0	0.0	0.0	0.0	0.0	0.0	1,600.0	0.0	2,144.0
Total	45,186.8	7,688.8	1,908.7	0.0	49.3	5.0	0.0	104.3	44.0	0.0	0.0	0.0	0.0	100,835.8	29,562.7	209.0	65.0	0.0	0.0	10.0	35,477.9	150.0	221,297.3

Table 12-28 shows there were 514,811.0 MW withdrawn from the queue from January 1, 1997, through December 31, 2024. Table 12-28 presents totals by fuel type and projected in service date. Of the 514,811.0 MW withdrawn from the queue, 279,734.1 MW (54.3 percent) were thermal units. Of the 57,537.8 MW withdrawn with projected in service dates between 2024 and 2031, 7,016.5 MW (12.2 percent) were thermal units.

**Table 12-28 Total (MW Energy) by unit type and projected in service year (withdrawn): December 31, 2024**

	CT -		CT -			Fuel	Hydro - Hydro -		RICE -					Solar +		Steam -		Steam -		Wind +				
Year	Battery	CC	Gas	CT - Oil	Other	Cell	Storage	Run of River	Nuclear	Natural	Gas	Oil	Other	Solar	Storage	Wind	Coal	Natural	Gas	- Oil	- Other	Wind	Storage	Total
1997	0.0	775.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4,911.0	0.0	0.0	0.0	0.0	0.0	0.0	5,686.0
1998	0.0	4,659.0	0.0	0.0	3.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4,662.1
1999	0.0	22,573.7	2.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	22,575.8
2000	0.0	9,900.8	0.0	0.0	3.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	9,904.5
2001	0.0	6,988.5	0.0	0.0	5.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	51.6	0.0	0.0	0.0	0.0	0.0	0.0	7,045.1
2002	0.0	14.2	0.0	0.0	0.0	0.0	0.0	0.0	45.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	28.0	0.0	0.0	0.0	0.0	50.5	0.0	137.7
2003	0.0	1,287.1	0.0	0.0	59.4	0.0	0.0	0.0	2.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	73.6	0.0	1,422.1
2004	0.0	12,073.2	0.0	0.0	12.0	0.0	0.0	41.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	75.0	0.0	12,201.2
2005	0.0	17,134.0	0.0	1.0	42.1	0.0	0.0	0.0	0.0	0.0	5.0	0.0	0.0	0.0	0.0	0.0	1,860.0	0.0	0.0	0.0	0.0	802.4	0.0	19,844.5
2006	0.0	4,847.0	0.0	0.0	43.4	0.0	0.0	142.0	0.0	0.0	30.5	0.0	0.0	0.0	0.0	0.0	520.0	0.0	0.0	0.0	0.0	1,430.2	0.0	7,013.1
2007	0.0	3,455.0	0.0	0.0	71.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	675.0	0.0	0.0	0.0	0.0	50.0	0.0	4,805.6
2008	1.0	6,826.0	0.0	0.0	38.4	0.0	0.0	2.9	18.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	152.0	0.0	0.0	0.0	0.0	1,857.0	0.0	8,895.3
2009	120.0	2,618.2	0.0	61.0	113.7	0.0	0.0	252.0	0.0	0.0	0.0	0.0	0.0	28.7	0.0	0.0	935.0	0.0	0.0	6.0	3,129.5	0.0	7,264.1	
2010	16.0	1,776.9	0.0	81.0	302.5	0.0	0.0	54.9	0.0	0.0	0.0	0.0	0.0	168.5	0.0	0.0	5,512.0	0.0	0.0	20.8	7,853.1	0.0	15,785.7	
2011	25.1	8,985.5	0.0	0.0	98.6	0.0	0.0	0.0	140.0	0.0	16.0	0.0	0.0	1,747.5	0.0	0.0	8,817.0	0.0	0.0	108.0	4,781.0	0.0	24,718.7	
2012	20.5	13,711.5	0.5	310.0	87.7	0.0	0.0	82.9	0.0	0.0	6.4	0.0	0.0	1,801.8	0.0	0.0	2,751.0	0.0	0.0	426.6	6,535.0	0.0	25,733.9	
2013	72.0	9,168.0	0.0	730.0	38.6	0.0	0.0	79.0	34.0	0.0	10.0	0.0	0.0	651.0	0.0	0.0	1,861.0	0.0	0.0	254.1	7,686.3	0.0	20,584.1	
2014	114.1	6,438.0	0.0	684.0	96.0	0.0	0.0	1,085.1	74.0	0.0	0.0	0.0	0.0	809.7	0.0	0.0	3,212.0	0.0	0.0	10.0	11,308.7	0.0	23,931.6	
2015	115.6	13,216.5	12.5	42.0	10.7	0.0	0.0	218.0	0.0	0.6	9.0	0.0	0.0	1,041.4	0.0	0.0	1,251.0	0.0	0.0	81.5	3,956.6	0.0	19,955.4	
2016	400.1	9,812.3	35.4	0.0	144.0	2.0	0.0	71.2	3,980.0	26.0	0.0	11.7	1,484.8	0.0	0.0	0.0	50.0	0.0	0.0	107.8	4,181.8	0.0	20,307.1	
2017	134.1	13,041.4	696.0	401.0	135.0	1.3	0.0	15.0	1,640.0	263.7	0.0	17.1	1,822.2	0.0	0.0	0.0	0.0	0.0	0.0	7.2	2,375.2	0.0	20,549.1	
2018	109.5	10,224.0	64.9	0.0	11.6	1.1	0.0	0.0	1,600.0	89.8	0.0	36.2	3,017.5	0.0	0.0	0.0	80.0	27.0	0.0	0.0	4,618.0	0.0	19,879.6	
2019	303.0	10,771.9	922.8	14.0	0.0	0.0	0.0	15.0	0.0	39.9	0.0	33.6	6,771.8	629.8	0.0	1,710.0	0.0	0.0	16.0	4,286.6	16.3	25,530.6		
2020	621.7	5,987.7	1,022.0	0.0	0.0	2.1	0.0	0.0	100.0	39.9	0.0	0.0	4,789.8	614.4	0.0	20.0	0.0	0.0	0.0	0.0	7,786.4	0.0	20,984.0	
2021	1,205.4	14,345.5	330.3	4.0	0.0	0.0	0.0	48.0	0.0	1.3	0.0	0.0	12,666.9	2,448.8	0.0	0.0	6.0	0.0	0.0	0.0	4,178.0	90.0	35,324.2	
2022	3,635.7	8,417.3	1,533.8	0.0	0.0	0.0	1,030.0	33.2	0.0	34.4	6.6	0.0	10,894.9	2,771.1	0.0	0.0	0.0	0.0	0.0	0.0	2,549.7	0.0	30,906.6	
2023	7,497.3	10,861.0	851.5	0.0	0.0	0.0	0.0	39.8	0.0	0.0	0.0	0.0	14,694.2	6,057.0	0.0	0.0	0.0	0.0	20.0	1,705.0	0.0	41,725.8		
2024	3,011.6	4,522.5	646.0	0.0	339.1	0.0	0.0	0.0	1,594.0	0.0	0.0	0.0	8,717.3	1,919.5	0.0	0.0	0.0	0.0	0.0	0.0	4,583.6	0.0	25,333.6	
2025	3,370.5	85.0	463.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4,376.2	2,056.3	0.0	0.0	0.0	0.0	0.0	0.0	2,376.6	0.0	12,727.6	
2026	490.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,519.2	842.3	0.0	0.0	0.0	0.0	0.0	0.0	1,765.2	0.0	4,616.7	
2027	574.5	625.0	675.0	0.0	0.0	0.0	200.0	0.0	0.0	0.0	0.0	0.0	122.5	153.5	0.0	0.0	0.0	0.0	0.0	0.0	4,393.2	0.0	6,743.7	
2028	400.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	326.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,460.0	0.0	2,186.0	
2029	300.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3,960.2	0.0	4,260.2	
2030	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	70.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	70.0	0.0	70.0
2031	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,600.0	0.0	1,600.0	
Total	22,537.5	235,141.6	7,255.8	2,328.0	1,655.8	6.4	1,230.0	2,180.0	9,227.0	495.6	83.5	98.6	77,521.9	17,492.7	0.0	34,396.6	33.0	0.0	1,108.0	101,912.6	106.3	514,811.0		

## Completion Rates

The probability of a project going into service increases as each step of the planning process is completed. Table 12-29 shows the historic completion rates (MW energy) by unit type for projects that have completed the system impact study (SIS), facilities study agreement (FSA) and any milestone completed beyond the FSA including a Construction Service Agreement (CSA), Interconnection Service Agreement (ISA), Upgrade Construction Service Agreement (UCSA) and Wholesale Market Participant Agreement (WMPA) as well as the historic completion rates for all projects including those withdrawn before reaching the SIS milestone.<sup>73</sup> For each unit type, the total MW in service was divided by the total energy MW entered in the queue. To calculate the completion rates for projects that reached the individual milestones, only those projects that reached a final status of withdrawn or in service were evaluated. For example, if a project was withdrawn after the completion of its SIS, but before the completion of the FSA, the totals would be included in the calculation of the SIS completion rate, but not in the calculation of the FSA or CSA completion rates. Similarly, if a project was withdrawn after the completion of its FSA, but before the completion of the CSA, the totals would be included in the calculation of the SIS and FSA completion rates, but not in the calculation of the CSA completion rate. The completion rates show that of all battery projects to ever enter the queue and complete the system impact study stage, 6.2 percent of the queued MW have gone into service. The completion rate for battery projects increases to 26.7 percent when battery projects complete the facility study agreement and further increases to 39.3 percent when battery projects complete the construction service agreement. Of all battery projects to enter the queue, only 0.5 percent of the queued MW have gone into service.

<sup>73</sup> All milestones after the FSA are included in the totals under the CSA headings of the tables within Section 12, "Generation and Transmission Planning."

**Table 12-29 Historic completion rates (MW energy) by unit type for projects with a completed SIS, FSA and CSA: December 31, 2024**

Unit Type	Completion Rate (SIS)	Completion Rate (FSA)	Completion Rate (CSA)	Completion Rate (ALL)
Battery	6.2%	26.7%	39.3%	0.5%
CC	33.9%	49.8%	71.9%	16.4%
CT - Natural Gas	59.1%	70.2%	72.0%	47.8%
CT - Oil	35.7%	60.0%	90.9%	25.4%
CT - Other	12.1%	18.4%	29.5%	8.4%
Fuel Cell	50.6%	51.8%	51.8%	28.4%
Hydro - Pumped Storage	35.8%	35.8%	66.1%	24.1%
Hydro - Run of River	42.5%	60.0%	67.2%	20.9%
Nuclear	34.7%	41.9%	51.3%	28.5%
RICE - Natural Gas	32.4%	44.7%	49.4%	27.4%
RICE - Oil	34.0%	59.7%	59.7%	24.6%
RICE - Other	88.9%	91.3%	92.0%	77.9%
Solar	25.4%	47.9%	63.9%	6.1%
Solar + Storage	0.3%	2.3%	5.8%	0.4%
Solar + Wind	0.0%	0.0%	0.0%	0.0%
Steam - Coal	13.7%	25.5%	37.6%	6.4%
Steam - Natural Gas	90.5%	91.1%	91.1%	90.5%
Steam - Oil	0.0%	0.0%	0.0%	0.0%
Steam - Other	30.3%	39.8%	47.7%	26.9%
Wind	16.4%	34.4%	52.9%	7.4%
Wind + Storage	45.3%	45.3%	45.3%	30.0%

On December 31, 2024, 221,297.3 MW were in generation request queues in the status of active, under construction or suspended. Of the total 221,297.3 MW in the queue, 71,040.1 MW (32.1 percent) have reached at least the SIS milestone and 150,257.2 MW (67.9 percent) have not received a completed SIS. Based on historical completion rates, (applying the unit type specific completion rates for those projects that have reached the SIS, FSA or any milestone beyond the FSA, and using the overall completion rates for those projects that have not yet reached the SIS milestone), 38,520.2 MW (17.4 percent) of new generation in the queue are expected to go into service.

Table 12-30 shows the percent of all project MW, by unit type, to go in service by year submitted to the queue. Of all battery projects that entered the queue in 2010, 65.5 percent reached the status of in service by December 31, 2024. Of all battery projects that entered the queue in 2016, only 1.3 percent have reached the status of in service as of December 31, 2024.

**Table 12-30 Percent of all projects (MW energy) to go in service by unit type and year submitted to the queue: December 31, 2024**

Unit Type	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
Battery	65.5%	8.3%	15.1%	43.9%	21.5%	11.5%	1.3%	0.0%	3.1%	0.4%	0.2%	0.0%	0.0%	0.0%	0.0%
CC	14.6%	24.5%	30.8%	35.6%	53.6%	13.4%	20.7%	8.1%	4.1%	2.3%	0.0%	0.0%	0.0%	0.0%	0.0%
CT - Natural Gas	100.0%	98.3%	71.6%	42.2%	56.8%	0.2%	13.2%	38.9%	8.5%	5.4%	7.2%	0.0%	0.0%	NA	0.0%
CT - Oil	100.0%	NA	1.2%	0.0%	0.0%	NA	NA	NA	0.0%	100.0%	0.0%	NA	NA	NA	0.0%
CT - Other	28.8%	26.2%	36.1%	100.0%	0.0%	100.0%	NA	0.0%	NA	NA	NA	0.0%	NA	NA	0.0%
Fuel Cell	NA	NA	NA	NA	NA	67.4%	0.0%	0.0%	NA	100.0%	NA	0.0%	NA	NA	0.0%
Hydro - Pumped Storage	NA	NA	NA	NA	NA	100.0%	NA	NA	0.0%	0.0%	NA	0.0%	NA	NA	0.0%
Hydro - Run of River	0.0%	0.0%	57.6%	49.6%	11.2%	NA	100.0%	26.8%	100.0%	0.0%	0.0%	0.0%	NA	NA	0.0%
Nuclear	15.5%	1.6%	0.0%	100.0%	NA	NA	25.4%	100.0%	100.0%	NA	0.0%	NA	NA	NA	0.0%
RICE - Natural Gas	NA	NA	100.0%	66.7%	5.4%	6.2%	0.0%	5.4%	NA	100.0%	NA	0.0%	NA	NA	0.0%
RICE - Oil	0.0%	0.0%	NA	NA	NA	30.8%	NA	NA	NA	NA	NA	NA	0.0%	NA	0.0%
RICE - Other	100.0%	100.0%	100.0%	100.0%	79.7%	25.5%	2.8%	0.0%	100.0%	NA	NA	NA	NA	NA	0.0%
Solar	10.7%	8.1%	16.9%	24.4%	30.5%	29.3%	34.4%	12.0%	3.8%	7.1%	0.5%	0.0%	0.0%	0.0%	0.0%
Solar + Storage	NA	NA	NA	NA	NA	100.0%	0.7%	0.0%	0.0%	0.0%	0.2%	0.0%	0.0%	0.0%	0.0%
Solar + Wind	NA	NA	NA	NA	NA	NA	NA	NA	NA	NA	0.0%	0.0%	NA	NA	0.0%
Steam - Coal	100.0%	0.0%	1.4%	68.4%	1.2%	23.4%	37.5%	100.0%	22.4%	0.0%	NA	NA	NA	NA	0.0%
Steam - Natural Gas	NA	NA	NA	100.0%	0.0%	100.0%	100.0%	100.0%	NA	NA	45.5%	NA	NA	NA	0.0%
Steam - Oil	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Steam - Other	0.5%	61.2%	16.6%	0.0%	0.0%	NA	NA	NA	NA	NA	NA	0.0%	0.0%	NA	0.0%
Wind	6.1%	3.4%	2.5%	20.9%	20.7%	12.5%	21.0%	2.6%	1.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%
Wind + Storage	NA	NA	NA	NA	NA	NA	0.0%	0.0%	NA	NA	NA	NA	0.0%	NA	0.0%
All	11.6%	19.0%	25.9%	35.9%	42.3%	15.7%	25.0%	10.0%	3.0%	4.0%	0.4%	0.0%	0.0%	0.0%	0.0%

Table 12-31 shows the total MW that went in service each year, by unit type, since 1999. In 2024, 4,431.3 MW from the queue went in service. Of the 4,431.3 MW that went in service, 4,099.0 MW (92.5 percent) were solar units, 289.8 MW (6.5 percent) were wind units and 42.5 MW (1.0 percent) were battery units.

**Table 12-31 Total (MW Energy) by unit type and year project went in service: December 31, 2024**

Unit Type	1999	2000	2001	2002	2003	2004	2005	2006	2007	2008	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018	2019	2020	2021	2022	2023	2024
Battery	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	27.4	4.5	23.0	24.0	110.4	10.0	2.0	40.0	25.5	0.0	1.5	0.0	61.8	42.5
CC	0.0	0.0	100.0	2,608.0	2,785.0	2,845.0	15.1	1,196.0	22.0	177.0	52.0	136.0	1,869.0	162.7	82.2	2,155.7	2,977.7	5,418.0	3,888.1	10,865.0	2,983.0	88.0	3,424.7	1,825.9	2,644.0	0.0
CT - Natural Gas	0.0	409.6	432.0	2,442.0	638.7	61.3	993.0	39.3	97.0	821.0	181.7	97.8	850.4	393.0	95.0	125.2	317.9	72.0	212.0	388.0	104.0	156.0	314.0	153.5	532.1	0.0
CT - Oil	0.0	0.0	315.0	6.5	0.0	33.0	292.0	7.5	21.0	15.3	85.6	0.0	23.9	2.0	0.5	2.0	0.0	0.0	0.0	0.0	0.0	13.0	0.0	0.0	0.0	0.0
CT - Other	0.0	0.0	10.0	0.0	0.0	4.1	0.0	0.0	11.0	6.9	0.0	18.2	0.0	70.7	17.6	6.0	8.0	5.9	0.0	0.0	3.2	0.0	0.0	0.0	0.0	0.0
Fuel Cell	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.5	0.0	3.0	0.0	0.0	0.0	0.0
Hydro - Pumped Storage	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	340.0	16.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	34.0	0.0	0.0	0.0	0.0	0.0	0.0
Hydro - Run of River	0.0	0.0	0.0	107.0	196.0	2.0	0.0	5.7	2.5	0.0	6.2	180.0	27.0	0.0	6.0	28.9	160.5	0.0	29.5	5.5	0.0	2.4	0.0	0.0	0.0	0.0
Nuclear	54.2	0.0	165.0	15.0	44.0	0.0	1,693.0	242.0	130.0	115.0	0.0	281.0	422.0	328.0	117.0	80.0	54.0	133.8	130.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
RICE - Natural Gas	0.0	0.0	0.0	0.0	0.0	8.0	29.0	2.0	19.5	0.0	0.0	10.5	0.0	0.0	0.0	0.0	18.9	20.9	19.9	5.2	39.8	0.0	14.4	0.0	0.0	0.0
RICE - Oil	0.0	0.0	0.0	0.0	0.0	23.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4.0	0.0	0.0	0.0	0.0
RICE - Other	0.0	1.2	0.0	2.9	17.2	0.0	27.5	44.9	86.6	57.6	38.8	13.8	39.8	2.0	109.0	0.0	3.8	19.3	22.4	0.0	0.8	0.0	0.0	0.0	0.0	0.0
Solar	15.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3.3	5.1	6.8	137.2	98.9	44.4	59.8	172.1	290.8	332.9	285.7	555.6	1,670.8	807.5	1,078.5	1,232.0	4,099.0
Solar + Storage	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	1.0	2.0	1.1	0.0	0.0	0.0	17.0	0.0
Solar + Wind	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Steam - Coal	12.0	20.0	59.0	21.0	0.0	37.0	20.0	14.0	55.0	720.5	123.0	177.0	97.0	708.0	48.0	16.0	92.5	0.0	47.0	24.0	20.0	0.0	11.0	0.0	0.0	0.0
Steam - Natural Gas	5.0	0.0	2.5	10.0	0.0	0.0	0.0	0.0	25.0	145.0	0.0	0.0	5.5	0.0	0.0	0.0	0.0	696.5	0.0	0.0	0.0	64.0	0.0	0.0	0.0	0.0
Steam - Oil	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Steam - Other	0.0	0.0	0.0	0.0	0.0	0.0	0.0	529.0	0.0	20.0	0.0	122.5	0.9	0.0	50.0	3.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Wind	0.0	0.0	0.0	15.0	190.0	20.4	7.5	380.0	867.3	729.8	622.0	1,183.5	326.6	1,424.5	150.0	500.0	455.0	465.8	700.7	762.0	535.0	1,008.6	310.0	0.0	282.4	289.8
Wind + Storage	0.0	0.0	0.0	0.0	0.0	0.0	0.0	186.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Total	86.2	430.8	1,083.5	5,227.4	3,870.9	3,034.1	3,077.1	2,460.4	1,522.9	2,811.4	1,454.4	2,243.1	3,826.6	3,194.2	742.7	3,001.4	4,371.8	7,133.0	5,385.5	12,412.9	4,268.0	3,009.8	4,883.1	3,057.9	4,769.3	4,431.3

## Queue Analysis by Fuel Group

The time it takes to complete a study depends on the backlog and the number of projects in the queue, but not on the size of the project. Table 12-32 shows the number of projects that entered the queue by year and by fuel group. The fuel groups are nuclear units, renewable units (including hydro run of river, solar and wind units (including renewable solar and wind hybrids), storage units (including battery and pumped storage hydro units), thermal units (including combined cycle, CT natural gas and oil, RICE natural gas and oil and steam coal, natural gas and oil) and other units (all other fuels). The number of queue entries has increased during the past several years, primarily by renewable projects. Of the 5,538 projects entered from January 2015 through December 2024, 4,121 projects (74.4 percent) were renewable.

Table 12-32 Number of projects entered in the queue: December 31, 2024

Year Entered	Fuel Group										Total
	Nuclear	Percent Nuclear	Renewable	Percent Renewable	Storage	Percent Storage	Thermal	Percent Thermal	Other	Percent Other	
1997	2	15.38%	0	0.00%	0	0.00%	11	84.62%	0	0.00%	13
1998	0	0.00%	0	0.00%	0	0.00%	18	100.00%	0	0.00%	18
1999	1	1.11%	5	5.56%	0	0.00%	82	91.11%	2	2.22%	90
2000	2	2.41%	3	3.61%	0	0.00%	75	90.36%	3	3.61%	83
2001	4	4.40%	6	6.59%	0	0.00%	78	85.71%	3	3.30%	91
2002	3	5.88%	15	29.41%	0	0.00%	23	45.10%	10	19.61%	51
2003	1	1.89%	34	64.15%	0	0.00%	13	24.53%	5	9.43%	53
2004	4	7.41%	17	31.48%	0	0.00%	23	42.59%	10	18.52%	54
2005	3	2.26%	74	55.64%	1	0.75%	36	27.07%	19	14.29%	133
2006	9	5.73%	67	42.68%	0	0.00%	47	29.94%	34	21.66%	157
2007	9	4.11%	64	29.22%	1	0.46%	124	56.62%	21	9.59%	219
2008	3	1.39%	102	47.22%	7	3.24%	79	36.57%	25	11.57%	216
2009	10	5.78%	107	61.85%	2	1.16%	34	19.65%	20	11.56%	173
2010	5	1.13%	370	83.90%	5	1.13%	40	9.07%	21	4.76%	441
2011	6	1.69%	264	74.37%	4	1.13%	61	17.18%	20	5.63%	355
2012	2	1.26%	59	37.11%	11	6.92%	69	43.40%	18	11.32%	159
2013	1	0.65%	54	35.06%	21	13.64%	69	44.81%	9	5.84%	154
2014	0	0.00%	100	52.08%	21	10.94%	59	30.73%	12	6.25%	192
2015	0	0.00%	130	42.07%	63	20.39%	103	33.33%	13	4.21%	309
2016	2	0.50%	284	71.18%	22	5.51%	65	16.29%	26	6.52%	399
2017	2	0.56%	280	78.87%	7	1.97%	47	13.24%	19	5.35%	355
2018	1	0.23%	341	77.50%	50	11.36%	47	10.68%	1	0.23%	440
2019	0	0.00%	546	78.34%	100	14.35%	50	7.17%	1	0.14%	697
2020	2	0.20%	780	78.23%	193	19.36%	21	2.11%	1	0.10%	997
2021	0	0.00%	976	73.11%	338	25.32%	10	0.75%	11	0.82%	1,335
2022	0	0.00%	370	68.65%	160	29.68%	8	1.48%	1	0.19%	539
2023	0	0.00%	414	88.65%	42	8.99%	11	2.36%	0	0.00%	467
2024	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0
Total	72	0.88%	5,462	66.69%	1,048	12.80%	1,303	15.91%	305	3.72%	8,190

As of December 31, 2024, renewable projects make up 77.2 percent of all projects in the queue and those projects account for 75.2 percent of the nameplate MW currently active, suspended or under construction in the queue as of December 31, 2024 (Table 12-33).

Table 12-33 Queue details by fuel group: December 31, 2024

Fuel Group	Number of Projects	Percent of Projects	MW	Percent MW
Nuclear	1	0.0%	44.0	0.0%
Renewable	1,984	77.2%	166,339.7	75.2%
Storage	528	20.5%	45,186.8	20.4%
Thermal	47	1.8%	9,662.5	4.4%
Other	10	0.4%	64.3	0.0%
Total	2,570	100.0%	221,297.3	100.0%

Historical completion rates for renewable projects may not be an accurate predictor of completion rates for current renewable projects. The outcomes for current projects will provide additional information and improve the ability to assess the likely future generation mix based on the type of projects in the queue.

Since wind resources cannot be dispatched on demand, PJM rules previously required that the unforced capacity of wind resources be derated to 20 percent of nameplate capacity until actual generation data are available. Beginning with Queue U, PJM derated wind resources to 13 percent of nameplate capacity until there was operational data to support a different conclusion.<sup>74</sup> PJM derated solar resources to 38 percent of nameplate capacity. Effective June 1, 2017, PJM adjusted the derates of wind and solar resources. The capacity factor derates for wind resources are dependent on the wind farm locations and have an average derate of 16.2 percent. The capacity factor derates for solar resources are dependent on the solar installation type and have an average derate of 46.7 percent.

74 See "PJM Manual 14B: PJM Region Transmission Planning Process," Rev. 56 (June 27, 2024).



Beginning with the 2023/2024 Delivery Year, unforced capacity for intermittent resources and limited duration resources are determined by PJM's effective load carrying capability (ELCC) analysis. The PJM ELCC analysis will determine capacity derates by resource class for each delivery year. The unforced capacity derate for a specific resource will equal the product of the ELCC class rating and a resource specific performance factor. For example, the 2025/2026 Third Incremental Auction ELCC class rating for onshore wind resources is 38.0 percent, for solar resources with tracking panels is 14.0 percent and for solar resources with fixed panels is 10.0 percent.<sup>75</sup> The ELCC class rating for battery or energy storage resources replaces the 10 hour rule that was previously used to determine the unforced capacity value for an energy storage resource. PJM defined four different energy storage classes differentiated by duration. The ELCC class rating is 55.0 percent for storage resources that can continuously generate energy at the nameplate capacity for four hours (four hour storage). The ELCC class rating is 65.0 percent for six hour storage and 68.0 percent for 8 hour storage and 77.0 percent for 10 hour storage.<sup>76</sup>

While renewables currently make up the majority of both projects and nameplate MW in the queue, historical completion rates and derating factors must be accounted for when evaluating the share of capacity resources that are likely to be contributed by renewables (Table 12-29). Table 12-34 shows the total MW of all projects in the queue as of December 31, 2024, in the status of active, suspended and under construction, by unit type. Table 12-34 also shows the total MW Energy and MW Capacity for each fuel type adjusted based on current historical completion rates and, for Capacity MW in the queue, adjusted for ELCC derates.<sup>77 78</sup>

Table 12-34 shows that of the 7,688.8 MW, on an energy basis, of combined cycle projects in the queue, 4,193.0 MW (54.5 percent) are expected to go in service based on historical completion rates as of December 31, 2024.

Of the 45,186.8 MW, on an energy basis, of battery projects in the queue, 1,448.3 MW (3.2 percent) are expected to go in service based on historical completion rates as of December 31, 2024.

Of the 166,339.7 MW, on an energy basis, of renewable projects in the queue, 31,649.1 MW (19.0 percent) are expected to go in service based on historical completion rates as of December 31, 2024.

Of the 7,487.1 MW, on a capacity basis that requested CIRs, of combined cycle projects requested in the generation queues in the status of active, under construction or suspended, 3,982.0 MW (53.2 percent) are expected to go into service based on historical completion rates. Based on historical completion rates and the ELCC derate factors using the class ratings for the 2025/2026 Third Incremental Auction,<sup>79</sup> the 7,487.1 MW of capacity requests currently under construction, suspended or active in the queue would be reduced to 3,105.9 MW of capacity (41.5 percent of the total requested capacity).<sup>80</sup>

Of the 40,343.3 MW, on a capacity basis that requested CIRs, of battery projects requested in the generation queues in the status of active, under construction or suspended, 192.8 MW (0.5 percent) are expected to go into service based on historical completion rates. Based on historical completion rates and the ELCC derate factors using the class ratings for the 2025/2026 Third Incremental Auction,<sup>81</sup> the 40,343.3 MW of capacity requests currently under construction, suspended or active in the queue would be reduced to 106.0 MW of capacity (0.3 percent of the total requested capacity).<sup>82</sup>

Of the 90,259.5 MW, on a capacity basis that requested CIRs, of renewable projects requested in the generation queues in the status of active, under construction or suspended, 15,402.8 MW (17.1 percent) are expected to go into service based on historical completion rates. Based on historical completion rates and the ELCC derate factors using the class ratings for the 2025/2026 Third Incremental Auction, the 90,259.5 MW of capacity

75 ELCC Class Ratings for 2025/2026 Third Incremental Auction, PJM Interconnection LLC. (January 23, 2025) <<https://www.pjm.com/-/media/DotCom/planning/res-adeq/elcc/2025-26-3ia-elcc-class-ratings.pdf>>

76 Additional information available in *PJM Manual 21A: Determination of Accredited UCAP Using Effective Load Carrying Capability Analysis*, PJM Interconnection LLC., Rev. 5 (June 27, 2024).

77 The 2025/2026 Third Incremental Auction ELCC factors are used for the ELCC derate adjusted MW. The adjusted MW are calculated using the four hour storage ELCC derate of 55.0 percent for battery resources, 38.0 percent ELCC derate for wind resources and 14.0 percent ELCC derate for solar resources.

78 ELCC Class Ratings for 2025/2026 Third Incremental Auction, PJM Interconnection LLC. (January 23, 2025) <<https://www.pjm.com/-/media/DotCom/planning/res-adeq/elcc/2025-26-3ia-elcc-class-ratings.pdf>>

79 ELCC Class Ratings for 2025/2026 Third Incremental Auction, PJM Interconnection LLC. (January 23, 2025) <<https://www.pjm.com/-/media/DotCom/planning/res-adeq/elcc/2025-26-3ia-elcc-class-ratings.pdf>>

80 The 2025/2026 Third Incremental Auction ELCC factors are used for the ELCC derate adjusted MW. The adjusted MW are calculated using the four hour storage ELCC derate for battery resources, tracking solar for solar resources and onshore wind for wind resources.

81 ELCC Class Ratings for 2025/2026 Third Incremental Auction, PJM Interconnection LLC. (January 23, 2025) <<https://www.pjm.com/-/media/DotCom/planning/res-adeq/elcc/2025-26-3ia-elcc-class-ratings.pdf>>

82 The 2025/2026 Third Incremental Auction ELCC factors are used for the ELCC derate adjusted MW. The adjusted MW are calculated using the four hour storage ELCC derate for battery resources, tracking solar for solar resources and onshore wind for wind resources.

requests currently under construction, suspended or active in the queue would be reduced to 2,531.2 MW of capacity (2.8 percent of the total requested capacity).<sup>83</sup>

As of December 31, 2024, 140,173.0 MW of capacity requests (requested CIRs) were in the generation queues in the status of active, under construction or suspended. Based on historical completion rates, 20,773.6 MW (14.8 percent) are expected to go into service. Based on historical completion rates and the ELCC derate factors using the class ratings for the 2025/2026 Third Incremental Auction, the 140,173.0 MW of capacity requests currently under construction, suspended or active in the queue would be reduced to 6,509.2 MW of capacity (4.6 percent of the total requested capacity).

**Table 12-34 Queue totals for projects (active, suspended and under construction) by unit type adjusted for current historical completion rates and ELCC derates (MW): December 31, 2024<sup>84</sup>**

Energy (MW)			Capacity (MW)		Completion
Unit Type	Completion		Total	Completion Rate Adjusted	Rate and ELCC Adjusted
	Total	Rate Adjusted			
Battery	45,186.8	1,448.3	40,343.3	192.8	106.0
CC	7,688.8	4,193.0	7,487.1	3,982.0	3,105.9
CT - Natural Gas	1,908.7	1,174.6	1,910.5	1,142.2	719.6
CT - Oil	0.0	0.0	0.0	0.0	0.0
CT - Other	49.3	4.1	48.6	4.1	2.6
Fuel Cell	5.0	1.4	5.0	0.5	0.5
Hydro - Pumped Storage	0.0	0.0	0.0	0.0	0.0
Hydro - Run of River	104.3	50.5	80.0	39.2	14.5
Nuclear	44.0	22.6	44.0	22.1	21.0
RICE - Natural Gas	0.0	0.0	0.0	0.0	0.0
RICE - Oil	0.0	0.0	0.0	0.0	0.0
RICE - Other	0.0	0.0	0.0	0.0	0.0
Solar	100,835.8	24,329.8	58,690.5	13,708.3	1,919.2
Solar + Storage	29,562.7	203.9	21,824.9	131.0	18.3
Solar + Wind	209.0	0.0	54.5	0.0	0.0
Steam - Coal	65.0	24.4	65.0	24.5	20.3
Steam - Natural Gas	0.0	0.0	0.0	0.0	0.0
Steam - Oil	0.0	0.0	0.0	0.0	0.0
Steam - Other	10.0	2.7	10.0	2.6	1.9
Wind	35,477.9	7,019.8	9,583.2	1,512.5	574.8
Wind + Storage	150.0	45.0	26.4	11.8	4.5
Total	221,297.3	38,520.2	140,173.0	20,773.6	6,509.2

## Queue Analysis by Unit Type and Project Classification

Table 12-35 shows the current status of all generation queue projects by unit type and project classification from January 1, 1997, through December 31, 2024. As of December 31, 2024, 8,190 projects, representing 827,897.9 MW, have entered the queue process since its inception. Of those, 1,219 projects, representing 91,789.6 MW (11.1 percent of the MW), went into service. Of the projects that entered the queue process, 4,401 projects, representing 514,811.0 MW (62.2 percent of the MW) withdrew prior to completion. Such projects may create barriers to entry for projects that would otherwise be completed by taking up queue positions, increasing interconnection costs and creating uncertainty.

A total of 6,184 projects have been classified as new generation and 2,006 projects have been classified as upgrades. Natural gas, wind, solar and renewable hybrid projects (including solar + storage, solar + wind and wind + storage) have accounted for 6,448 projects (78.7 percent) of all 8,190 generation queue projects to enter the queue since January 1, 1997.

<sup>83</sup> The 2025/2026 Third Incremental Auction ELCC factors are used for the ELCC derate adjusted MW. The adjusted MW are calculated using the four hour storage ELCC derate for battery resources, tracking solar for solar resources and onshore wind for wind resources.

<sup>84</sup> The 2025/2026 Third Incremental Auction ELCC factors are used for the ELCC derate adjusted MW. The adjusted MW are calculated using the four hour storage ELCC derate for battery resources, tracking solar for solar resources and onshore wind for wind resources.

Table 12-35 Status of all generation queue projects: January 1, 1997 through December 31, 2024

Project Status	Project Classification	Number of Projects																						
		CT -				Hydro - Hydro -				RICE -				Steam -				Total						
		Natural	Battery	CC	Oil	Other	Fuel	Pumped	Run of	Nuclear	Natural	RICE -	RICE -	Solar	Solar +	Solar +	Steam		Natural	Gas	Steam	Wind		
In Service	New Generation	31	67	50	10	25	2	7	19	45	9	2	16	73	0	0	57	10	0	7	18	1	553	
Under Construction	New Generation	2	1	0	0	0	0	0	0	0	0	0	0	49	2	0	0	0	0	0	0	5	0	60
	Upgrade	0	2	1	0	0	0	0	0	1	0	0	0	22	2	0	3	0	0	0	1	0	32	
Suspended	New Generation	9	2	0	0	0	0	0	0	0	0	0	0	96	1	0	0	0	0	0	7	0	115	
	Upgrade	4	0	0	0	0	0	0	0	0	0	0	0	16	0	0	0	0	0	0	0	0	20	
Withdrawn	New Generation	336	439	32	10	84	28	4	46	9	30	12	16	1,983	222	0	55	1	0	35	495	1	3,838	
	Upgrade	137	108	25	15	12	0	1	5	15	0	3	3	169	15	0	15	2	0	2	35	1	563	
Active	New Generation	301	7	2	0	5	0	0	3	0	0	0	0	858	263	2	0	0	0	1	62	1	1,505	
	Upgrade	212	13	16	0	2	2	0	1	0	0	0	0	460	38	1	0	0	0	0	93	0	838	
Total Projects	New Generation	679	516	84	20	114	30	4	60	11	41	12	71	3,264	494	2	63	7	0	40	669	3	6,184	
	Upgrade	361	242	179	38	19	3	4	25	61	9	5	19	740	55	1	75	12	0	9	147	2	2,006	

Table 12-36 shows the totals in Table 12-35 by share of classification as new generation or upgrade. Within a unit type the shares of upgrades add to 100 percent and the shares of new generation add to 100 percent. For example, 76.0 percent of all hydro run of river projects classified as upgrades are currently in service in PJM, 20.0 percent of hydro run of river upgrades were withdrawn and 4.0 percent of hydro run of river upgrades are active in the queue.

Table 12-36 Status of all generation queue projects as a percent of total projects by classification: January 1, 1997 through December 31, 2024

Project Status	Project Classification	Percent of Projects																					
		CT -				Hydro - Hydro -				RICE -				Steam -				Wind -					
		Natural	Gas	Oil	Other	Fuel	Pumped	Run of	Nuclear	Natural	RICE -	RICE -	Solar	Solar +	Solar +	Steam	Natural	Steam	Steam	Wind +			
In Service	New Generation	4.6%	13.0%	59.5%	50.0%	21.9%	6.7%	0.0%	16.7%	18.2%	26.8%	0.0%	77.5%	8.5%	1.2%	0.0%	12.7%	85.7%	0.0%	10.0%	14.9%	33.3%	10.8%
	Upgrade	2.2%	49.2%	76.5%	60.5%	26.3%	33.3%	75.0%	76.0%	73.8%	100.0%	40.0%	84.2%	9.9%	0.0%	0.0%	76.0%	83.3%	0.0%	77.8%	12.2%	50.0%	27.6%
Under Construction	New Generation	0.3%	0.2%	0.0%	0.0%	0.0%	0.0%	0.0%	1.7%	0.0%	0.0%	0.0%	0.0%	1.5%	0.4%	0.0%	0.0%	0.0%	0.0%	0.0%	0.7%	0.0%	1.0%
	Upgrade	0.0%	0.8%	0.6%	0.0%	0.0%	0.0%	0.0%	0.0%	1.6%	0.0%	0.0%	0.0%	3.0%	3.6%	0.0%	4.0%	0.0%	0.0%	0.0%	0.7%	0.0%	1.6%
Suspended	New Generation	1.3%	0.4%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	2.9%	0.2%	0.0%	0.0%	0.0%	0.0%	0.0%	1.0%	0.0%	1.9%
	Upgrade	1.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	2.2%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	1.0%
Withdrawn	New Generation	49.5%	85.1%	38.1%	50.0%	73.7%	93.3%	100.0%	76.7%	81.8%	73.2%	100.0%	22.5%	60.8%	44.9%	0.0%	87.3%	14.3%	0.0%	87.5%	74.0%	33.3%	62.1%
	Upgrade	38.0%	44.6%	14.0%	39.5%	63.2%	0.0%	25.0%	20.0%	24.6%	0.0%	60.0%	15.8%	22.8%	27.3%	0.0%	20.0%	16.7%	0.0%	22.2%	23.8%	50.0%	28.1%
Active	New Generation	44.3%	1.4%	2.4%	0.0%	4.4%	0.0%	0.0%	5.0%	0.0%	0.0%	0.0%	0.0%	26.3%	53.2%	100.0%	0.0%	0.0%	0.0%	2.5%	9.3%	33.3%	24.3%
	Upgrade	58.7%	5.4%	8.9%	0.0%	10.5%	66.7%	0.0%	4.0%	0.0%	0.0%	0.0%	0.0%	62.2%	69.1%	100.0%	0.0%	0.0%	0.0%	0.0%	63.3%	0.0%	41.8%

Table 12-37 shows the total MW of projects in the PJM generation queue by unit type and project classification. For example, the 495 new generation wind projects that have been withdrawn from the queue as of December 31, 2024, (as shown in Table 12-35) constitute 97,500.8 MW. The 439 new generation combined cycle projects that have been withdrawn in the same time period constitute 221,312.8 MW.

Table 12-37 Status of all generation (MW) in the generation queue: January 1, 1997 through December 31, 2024

Project Status	Project Classification	Battery	Project MW																													
			CT -		Hydro - Hydro -		RICE -			Steam -		Natural		RICE -		RICE -		Solar +		Solar +		Steam -		Natural		Steam		Steam		Wind +		Total
			Natural	Gas	CT - Oil	Other	Fuel	Pumped	Run of	Nuclear	Natural	RICE -	RICE -	Solar	Storage	Wind	Coal	Gas	- Oil	- Other	Wind	Storage	Wind	Storage	Wind	Storage	Wind	Storage	Wind	Storage		
In Service	New Generation	320.2	39,701.9	6,734.4	676.5	149.2	1.5	0.0	371.5	1,639.0	170.8	0.0	440.1	9,823.5	22.1	0.0	1,343.0	728.0	0.0	60.9	10,901.8	186.0	73,270.4									
	Upgrade	52.4	8,618.1	3,192.1	140.8	12.3	3.0	390.0	387.6	2,365.0	17.3	27.3	47.5	1,071.9	0.0	0.0	979.0	225.5	0.0	665.3	324.1	0.0	18,519.2									
Under Construction	New Generation	21.0	940.0	0.0	0.0	0.0	0.0	0.0	12.0	0.0	0.0	0.0	0.0	3,179.1	153.9	0.0	0.0	0.0	0.0	0.0	0.0	1,364.8	0.0	5,670.8								
	Upgrade	0.0	153.8	60.0	0.0	0.0	0.0	0.0	0.0	44.0	0.0	0.0	0.0	660.2	103.2	0.0	65.0	0.0	0.0	0.0	0.0	105.9	0.0	1,192.1								
Suspended	New Generation	500.7	1,845.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	7,260.0	17.5	0.0	0.0	0.0	0.0	0.0	0.0	1,982.5	0.0	11,605.7								
	Upgrade	142.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	390.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	532.2				
Withdrawn	New Generation	19,041.2	221,312.8	5,794.3	1,735.0	1,587.1	6.4	1,200.0	2,072.8	8,161.0	495.6	63.9	88.6	73,222.3	17,284.2	0.0	33,511.6	27.0	0.0	1,070.9	97,500.8	90.0	484,265.5									
	Upgrade	3,496.3	13,828.9	1,461.5	593.0	68.7	0.0	30.0	107.2	1,066.0	0.0	19.6	10.0	4,299.6	208.5	0.0	885.0	6.0	0.0	37.1	4,411.8	16.3	30,545.4									
Active	New Generation	35,649.6	4,459.0	1,269.0	0.0	49.3	0.0	0.0	41.3	0.0	0.0	0.0	0.0	79,745.2	27,425.3	209.0	0.0	0.0	0.0	10.0	30,481.9	150.0	179,489.5									
	Upgrade	8,873.3	291.0	579.7	0.0	0.0	5.0	0.0	51.0	0.0	0.0	0.0	0.0	9,601.3	1,862.9	0.0	0.0	0.0	0.0	0.0	0.0	1,542.8	0.0	22,807.0								
Total Projects	New Generation	55,532.7	268,258.7	13,797.7	2,411.5	1,785.6	7.9	1,200.0	2,497.6	9,800.0	666.4	63.9	528.7	173,230.1	44,903.0	209.0	34,854.6	755.0	0.0	1,141.8	142,231.8	426.0	754,302.0									
	Upgrade	12,564.2	22,891.8	5,293.3	733.8	81.0	8.0	420.0	545.8	3,475.0	17.3	46.9	57.5	16,023.0	2,174.6	0.0	1,929.0	231.5	0.0	702.4	6,384.6	16.3	73,595.9									

Table 12-38 shows the MW totals in Table 12-37 by share by classification as new generation or upgrade. Within a unit type the shares of upgrades add to 100 percent and the shares of new generation add to 100 percent. For example, 68.6 percent of wind project MW classified as new generation have been withdrawn from the queue between January 1, 1997, and December 31, 2024.

**Table 12-38 Status of all generation queue projects as percent of total MW in project classification: January 1, 1997 through December 31, 2024**

Project Status	Project Classification	Percent of Total Projects by Classification																				
		CT -					Hydro -		Hydro -		RICE -				Solar +		Solar +		Steam -		Wind	
		Battery	CC	Gas	CT - Oil	Other	Fuel Cell	Pumped Storage	Run of River	Nuclear	Natural Gas	RICE - Oil	RICE - Other	Solar Storage	Solar Wind	Solar + Wind	Steam Coal	Natural Gas	Steam Oil	Steam Other	Wind Storage	+ Total
In Service	New Generation	0.6%	14.8%	48.8%	28.1%	8.4%	19.2%	0.0%	14.9%	16.7%	25.6%	0.0%	83.2%	5.7%	0.0%	0.0%	96.4%	0.0%	5.3%	7.7%	43.0%	9.7%
	Upgrade	0.4%	37.6%	60.3%	19.2%	15.2%	37.5%	92.9%	71.0%	68.1%	100.0%	58.2%	82.6%	6.7%	0.0%	50.8%	97.4%	0.0%	94.7%	5.1%	0.0%	25.2%
Under Construction	New Generation	0.0%	0.4%	0.0%	0.0%	0.0%	0.0%	0.0%	0.5%	0.0%	0.0%	0.0%	0.0%	1.8%	0.3%	0.0%	0.0%	0.0%	0.0%	1.0%	0.0%	0.8%
	Upgrade	0.0%	0.7%	1.1%	0.0%	0.0%	0.0%	0.0%	0.0%	1.3%	0.0%	0.0%	0.0%	4.1%	4.7%	0.0%	3.4%	0.0%	0.0%	1.7%	0.0%	1.6%
Suspended	New Generation	0.9%	0.7%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	4.2%	0.0%	0.0%	0.0%	0.0%	0.0%	1.4%	0.0%	1.5%
	Upgrade	1.1%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	2.4%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.0%	0.7%
Withdrawn	New Generation	34.3%	82.5%	42.0%	71.9%	88.9%	80.8%	100.0%	83.0%	83.3%	74.4%	100.0%	16.8%	42.3%	38.5%	0.0%	96.1%	3.6%	93.8%	68.6%	21.1%	64.2%
	Upgrade	27.8%	60.4%	27.6%	80.8%	84.8%	0.0%	7.1%	19.6%	30.7%	0.0%	41.8%	17.4%	26.8%	9.6%	0.0%	45.9%	2.6%	5.3%	69.1%	100.0%	41.5%
Active	New Generation	64.2%	1.7%	9.2%	0.0%	2.8%	0.0%	0.0%	1.7%	0.0%	0.0%	0.0%	0.0%	46.0%	61.1%	100.0%	0.0%	0.0%	0.9%	21.4%	35.2%	23.8%
	Upgrade	70.6%	1.3%	11.0%	0.0%	0.0%	62.5%	0.0%	9.3%	0.0%	0.0%	0.0%	0.0%	59.9%	85.7%	0.0%	0.0%	0.0%	0.0%	24.2%	0.0%	31.0%

Table 12-39 shows the project MW that entered the PJM generation queue by unit type and year of entry. Since 2016, 70.2 percent of all new projects entering the generation queue have been combined cycle (10.0 percent), wind (17.5 percent) or solar projects (42.7 percent). Prior to 2015, no renewable hybrid units (solar + storage, solar + wind and wind + storage) entered the queue. In the time period from January 1, 2015 through December 31, 2024, 47,728.8 MW of renewable hybrid units have entered the queue.

**Table 12-39 Queue project MW by unit type and queue entry year: January 1, 1997 through December 31, 2024**

	CT -						Hydro -	Hydro -	RICE -				RICE -		Solar +	Solar +	Steam -	Steam -	Steam -	Wind +			
	Natural		CT - Oil		Other	Fuel Cell	Pumped	Run of	Natural		RICE - Oil		Other	Solar	Storage	Wind	Coal	Natural	- Oil	Other	Wind	Storage	Total
Year	Battery	CC	Gas	Oil				River	Nuclear	Gas	RICE	Oil											
1997	0.0	4,148.0	321.0	315.0	0.0	0.0	0.0	0.0	50.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6.0	0.0	0.0	0.0	0.0	0.0	4,840.0
1998	0.0	7,006.0	1,775.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	8,781.0
1999	0.0	29,412.7	2,069.1	0.0	10.0	0.0	0.0	196.0	45.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	47.0	0.0	0.0	525.0	115.4	0.0	32,420.2
2000	0.0	21,144.8	493.6	31.5	8.8	0.0	0.0	0.0	95.0	0.0	0.0	0.0	1.2	0.0	0.0	0.0	37.0	2.5	0.0	0.0	95.6	0.0	21,909.9
2001	0.0	25,411.7	264.0	0.0	0.0	0.0	0.0	107.0	90.0	0.0	0.0	15.6	0.0	0.0	0.0	0.0	1,244.6	10.0	0.0	0.0	234.9	0.0	27,377.8
2002	0.0	4,154.0	11.7	0.0	70.5	0.0	0.0	293.0	236.0	8.0	23.3	4.5	0.0	0.0	0.0	0.0	1,895.0	0.0	0.0	0.0	790.9	0.0	7,486.9
2003	0.0	2,361.4	10.0	8.0	0.8	0.0	0.0	2.0	0.0	29.0	0.0	27.5	0.0	0.0	0.0	0.0	522.0	0.0	0.0	165.0	997.0	0.0	4,122.7
2004	0.0	3,610.0	43.3	20.0	49.1	0.0	0.0	0.0	1,911.0	0.0	35.5	17.5	0.0	0.0	0.0	0.0	1,187.0	0.0	0.0	0.0	1,428.7	186.0	8,488.1
2005	0.0	5,824.6	961.0	281.0	51.4	0.0	340.0	174.2	242.0	21.5	0.0	65.1	0.0	0.0	0.0	0.0	6,360.0	0.0	0.0	24.0	6,020.0	0.0	20,364.9
2006	0.0	4,188.1	454.3	607.5	73.1	0.0	0.0	159.0	6,894.0	0.0	0.0	93.0	0.0	0.0	0.0	0.0	9,586.0	0.0	0.0	258.5	7,650.7	0.0	29,964.2
2007	0.0	13,944.6	941.2	215.9	149.5	0.0	16.0	161.6	368.0	0.0	0.0	56.5	3.3	0.0	0.0	0.0	9,078.0	190.0	0.0	50.5	18,510.5	0.0	43,685.5
2008	121.0	26,001.0	129.7	1,113.0	488.8	0.0	0.0	1,254.5	105.0	6.0	0.0	32.0	66.3	0.0	0.0	0.0	1,200.5	0.0	0.0	189.8	10,955.5	0.0	41,663.1
2009	34.0	5,548.4	14.0	66.0	214.2	0.0	0.0	133.9	1,933.8	4.5	16.0	15.2	636.4	0.0	0.0	0.0	1,273.0	5.5	0.0	148.0	6,672.6	0.0	16,715.1
2010	72.4	9,185.4	176.0	7.9	117.3	0.0	0.0	132.6	426.0	0.0	2.4	54.6	3,672.6	0.0	0.0	0.0	64.0	0.0	0.0	173.5	9,803.4	0.0	23,888.1
2011	24.1	19,744.0	29.5	0.0	172.5	0.0	0.0	30.0	182.0	0.0	14.0	75.3	2,014.0	0.0	0.0	0.0	357.0	0.0	0.0	49.0	5,576.4	0.0	28,267.8
2012	142.6	18,014.8	102.1	42.5	48.4	0.0	0.0	11.8	369.0	37.2	0.0	4.0	284.6	0.0	0.0	0.0	1,837.0	0.0	0.0	143.1	1,529.8	0.0	22,566.8
2013	217.4	10,493.1	1,201.8	5.0	11.2	0.0	0.0	89.4	102.0	59.7	0.0	1.6	231.7	0.0	0.0	0.0	1,580.0	40.0	0.0	44.7	1,296.6	0.0	13,952.1
2014	246.9	11,704.5	1,532.5	401.0	7.7	0.0	0.0	60.5	0.0	48.0	0.0	17.7	1,585.6	0.0	0.0	0.0	1,730.5	27.0	0.0	43.1	1,691.3	0.0	19,096.3
2015	546.9	27,550.8	1,324.5	0.0	0.9	2.3	34.0	0.0	0.0	320.4	13.0	31.4	2,919.3	3.4	0.0	47.0	606.5	0.0	0.0	0.0	2,160.6	0.0	35,560.9
2016	111.1	18,802.5	1,392.0	0.0	0.0	2.9	0.0	12.5	59.0	23.5	0.0	38.9	11,538.9	85.6	0.0	80.0	77.0	0.0	0.0	0.0	3,445.7	16.3	35,685.9
2017	24.6	5,477.6	691.0	0.0	4.1	2.7	0.0	20.5	39.1	97.1	0.0	33.8	13,886.8	324.9	0.0	14.0	17.0	0.0	0.0	0.0	5,137.0	90.0	25,660.3
2018	1,413.7	11,080.1	2,612.4	14.0	0.0	0.0	700.0	2.4	28.1	0.0	0.0	0.8	20,143.9	3,957.9	0.0	49.0	0.0	0.0	0.0	0.0	17,683.3	0.0	57,585.6
2019	5,244.5	3,901.5	1,003.7	13.0	0.0	3.0	500.0	99.0	0.0	14.4	0.0	0.0	30,290.8	6,902.0	0.0	11.0	0.0	0.0	0.0	0.0	11,254.4	0.0	59,237.3
2020	11,629.1	50.0	846.6	4.0	0.0	0.0	0.0	80.2	100.0	0.0	0.0	0.0	38,442.9	8,001.6	199.0	0.0	11.0	0.0	0.0	0.0	6,611.1	0.0	65,975.6
2021	25,763.1	2,129.0	771.0	0.0	388.4	5.0	30.0	23.5	0.0	14.4	0.0	0.0	47,678.3	16,269.1	10.0	0.0	0.0	0.0	20.0	11,160.0	0.0	104,261.7	
2022	17,528.0	192.0	20.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6.6	0.0	14,992.8	9,846.5	0.0	0.0	0.0	0.0	10.0	14,214.3	150.0	56,960.2	
2023	4,977.4	70.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,064.6	1,686.5	0.0	0.0	0.0	0.0	0.0	0.0	3,580.9	0.0	11,379.3
2024	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Total	68,096.9	291,150.5	19,091.0	3,145.3	1,866.6	15.9	1,620.0	3,043.4	13,275.0	683.7	110.8	586.2	189,253.1	47,077.5	209.0	36,783.6	986.5	0.0	1,844.2	148,616.4	442.3	827,897.7	

## Combined Cycle Project Analysis

Table 12-40 shows the status of all combined cycle projects by number of projects that entered PJM generation queues from January 1, 1997, through December 31, 2024, by zone. Of the 25 combined cycle projects classified as new generation or upgrade currently active, suspended or under construction in the PJM generation queue, seven projects (28.0 percent) are located in the DOM Zone.

**Table 12-40 Status of all combined cycle queue projects by zone (number of projects): January 1, 1997 through December 31, 2024**

Project Status	Project Classification	Number of Projects																		
		ACEC	AEP	AMPT	APS	ATSI	BGE	COMED	DAY	DUKE	DUQ	DOM	DPL	EPKC	JCLPC	MEC	OVEC	PECO	PE	PEPCO
In Service	New Generation	1	7	0	3	4	2	3	0	2	0	7	2	0	7	4	0	5	2	4
	Upgrade	3	16	0	10	5	0	6	0	0	0	17	5	0	6	5	0	13	3	4
Under Construction	New Generation	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Upgrade	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0
Suspended	New Generation	0	0	0	1	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0
	Upgrade	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Withdrawn	New Generation	24	20	0	46	14	8	16	1	2	18	16	3	26	25	0	44	41	35	42
	Upgrade	7	9	0	11	4	0	4	0	1	0	11	6	0	8	7	0	4	7	6
Active	New Generation	0	2	0	4	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0
	Upgrade	0	0	0	1	2	0	1	0	0	0	6	0	0	0	0	0	1	1	0
Total Projects	New Generation	25	29	0	54	19	10	20	1	3	2	26	18	3	33	29	0	49	43	39
	Upgrade	10	25	0	22	11	0	12	0	1	0	34	11	0	14	12	0	17	11	11

Table 12-41 shows the status of all combined cycle projects by MW that entered PJM generation queues from January 1, 1997, through December 31, 2024, by zone. Of the 7,688.8 MW of combined cycle projects classified as new generation or upgrade currently active, suspended or under construction in the PJM generation queue, 4,055.0 MW (52.7 percent) are located in the APS Zone.

**Table 12-41 Status of all combined cycle queue projects by zone (MW): January 1, 1997 through December 31, 2024**

	Project	Project MW																						
Project Status	Classification	ACEC	AEP	AMPT	APS	ATSI	BGE	COMED	DAY	DUKE	DUQ	DOM	DPL	EKPC	JCPLC	MEC	OVEC	PECO	PE	PEPCO	PPL	PSEG	REC	Total
In Service	New Generation	650.0	5,611.0	0.0	1,970.0	3,751.0	140.0	2,960.9	0.0	533.0	0.0	5,828.6	319.2	0.0	1,665.8	2,557.0	0.0	2,665.0	1,900.0	1,560.0	5,892.0	1,698.5	0.0	39,701.9
	Upgrade	229.0	1,300.0	0.0	959.7	344.0	0.0	642.6	0.0	0.0	0.0	1,053.0	102.0	0.0	110.0	188.9	0.0	1,075.5	112.3	228.6	1,426.6	845.9	0.0	8,618.1
Under Construction	New Generation	0.0	0.0	0.0	0.0	940.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	940.0
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	102.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	51.1	0.0	153.8
Suspended	New Generation	0.0	0.0	0.0	1,270.0	0.0	0.0	575.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,845.0
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Withdrawn	New Generation	8,542.5	13,559.5	0.0	22,373.1	9,596.0	3,122.1	10,817.0	1,150.0	134.5	665.0	12,961.0	5,145.4	991.8	13,562.6	13,001.0	0.0	24,140.0	16,114.0	22,268.2	18,917.7	24,244.6	6.9	221,312.8
	Upgrade	156.9	1,031.0	0.0	1,368.0	636.0	0.0	1,735.0	0.0	36.0	0.0	780.4	1,410.0	0.0	413.0	1,742.0	0.0	245.0	1,125.6	229.1	703.0	2,217.9	0.0	13,828.9
Active	New Generation	0.0	1,150.0	0.0	2,740.0	0.0	0.0	0.0	0.0	0.0	0.0	569.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4,459.0
	Upgrade	0.0	0.0	0.0	45.0	128.0	0.0	0.0	0.0	0.0	0.0	43.0	0.0	0.0	0.0	0.0	0.0	0.0	30.0	45.0	0.0	0.0	0.0	291.0
Total Projects	New Generation	9,192.5	20,320.5	0.0	28,353.1	14,287.0	3,262.1	14,352.9	1,150.0	667.5	665.0	19,358.6	5,464.6	991.8	15,228.4	15,558.0	0.0	26,805.0	18,014.0	23,828.2	24,809.7	25,943.1	6.9	268,258.7
	Upgrade	385.9	2,331.0	0.0	2,372.7	1,108.0	0.0	2,480.3	0.0	36.0	0.0	1,876.4	1,512.0	0.0	523.0	1,930.9	0.0	1,320.5	1,267.9	502.7	2,129.6	3,114.9	0.0	22,891.8

Of the 25 combined cycle units in the queue as of December 31, 2024, in the status of Active, Under Construction or Suspended, eight units, representing 747.1 MW had a projected in service date prior to January 1, 2024 and 17 units, representing 6,941.7 MW had a projected in service date between January 1, 2024, and March 31, 2028.

## Combustion Turbine - Natural Gas Project Analysis

Table 12-42 shows the status of all combustion turbine natural gas projects by number of projects that entered PJM generation queues from January 1, 1997, through December 31, 2024, by zone. Of the 19 combustion turbine natural gas projects classified as new generation or upgrade currently active, suspended or under construction in the PJM generation queue, nine projects (47.4 percent) are located in the DOM Zone.

**Table 12-42 Status of all combustion turbine - natural gas generation queue projects by zone (number of projects): January 1, 1997 through December 31, 2024**

		Number of Projects																						
Project Status	Project																							
	Classification	ACEC	AEP	AMPT	APS	ATSI	BGE	COMED	DAY	DUKE	DUQ	DOM	DPL	EKPC	JCPLC	MEC	OVEC	PECO	PE	PEPCO	PPL	PSEG	REC	Total
In Service	New Generation	5	0	0	6	0	3	1	0	0	1	3	6	0	2	1	0	2	5	2	4	9	0	50
	Upgrade	4	11	0	10	5	0	20	6	0	0	28	8	0	5	5	0	4	8	5	4	14	0	137
Under Construction	New Generation	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Upgrade	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1
Suspended	New Generation	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
	Upgrade	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Withdrawn	New Generation	2	6	0	0	0	2	1	1	0	0	4	0	1	1	0	0	1	6	0	1	6	0	32
	Upgrade	3	1	0	1	1	0	5	3	0	2	3	0	0	0	1	0	0	2	3	0	0	0	25
Active	New Generation	0	1	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	2
	Upgrade	1	2	0	1	4	0	0	0	0	0	8	0	0	0	0	0	0	0	0	0	0	0	16
Total Projects	New Generation	7	7	0	6	0	5	2	1	0	1	8	6	1	3	1	0	3	11	2	5	15	0	84
	Upgrade	8	14	0	12	10	0	26	9	0	2	39	8	0	5	6	0	4	10	8	4	14	0	179

Table 12-43 shows the status of all combustion turbine natural gas projects by MW that entered PJM generation queues from January 1, 1997, through December 31, 2024, by zone. Of the 1,908.7 MW of combustion turbine natural gas projects classified as new generation or upgrade currently active, suspended or under construction in the PJM generation queue, 791.0 MW (41.4 percent) are located in the AEP Zone.

**Table 12-43 Status of all combustion turbine - natural gas queue projects by zone (MW): January 1, 1997 through December 31, 2024**

	Project	Project MW																							
Project Status	Classification	ACEC	AEP	AMPT	APS	ATSI	BGE	COMED	DAY	DUKE	DUQ	DOM	DPL	EKPC	JCPLC	MEC	OVEC	PECO	PE	PEPCO	PPL	PSEG	REC	Totals	
In Service	New Generation	360.7	0.0	0.0	1,184.0	0.0	23.0	190.0	0.0	0.0	205.0	1,081.0	1,140.0	0.0	520.0	10.0	0.0	559.0	379.9	5.0	150.9	925.9	0.0	6,734.4	
	Upgrade	43.7	278.1	0.0	269.7	105.0	0.0	744.0	83.5	0.0	0.0	925.7	86.0	0.0	20.0	47.6	0.0	42.0	40.5	39.0	252.3	215.0	0.0	3,192.1	
Under Construction	New Generation	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	60.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	60.0	
Suspended	New Generation	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Withdrawn	New Generation	237.5	1,519.0	0.0	0.0	0.0	153.6	10.0	104.0	0.0	0.0	1,069.8	0.0	73.0	2.1	0.0	0.0	0.5	789.8	0.0	19.9	1,815.1	0.0	5,794.3	
	Upgrade	165.5	6.0	0.0	4.0	25.0	0.0	686.2	124.0	0.0	18.5	57.0	0.0	0.0	0.0	0.0	0.0	0.0	327.0	48.3	0.0	0.0	0.0	1,461.5	
Active	New Generation	0.0	700.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	569.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,269.0	
	Upgrade	0.0	91.0	0.0	30.0	458.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	579.7	
Total Projects	New Generation	598.2	2,219.0	0.0	1,184.0	0.0	176.6	200.0	104.0	0.0	205.0	2,719.8	1,140.0	73.0	522.1	10.0	0.0	559.5	1,169.7	5.0	170.8	2,741.0	0.0	13,797.7	
	Upgrade	209.2	375.1	0.0	303.7	588.7	0.0	1,490.2	207.5	0.0	18.5	982.7	86.0	0.0	20.0	47.6	0.0	42.0	367.5	87.3	252.3	215.0	0.0	5,293.3	



## Wind Project Analysis

Table 12-44 shows the status of all wind generation projects, by number of projects that entered PJM generation queues from January 1, 1997, through December 31, 2024, by zone. Of the 168 wind projects classified as new generation or upgrade currently active, suspended or under construction in the PJM generation queue, 64 projects (38.1 percent) are located in the COMED Zone.

**Table 12-44 Status of all wind generation queue projects by zone (number of projects): January 1, 1997 through December 31, 2024**

Project Status	Project Classification	Number of Projects																					
		ACEC	AEP	AMPT	APS	ATSI	BGE	COMED	DAY	DUKE	DUQ	DOM	DPL	EKPC	JCPLC	MEC	OVEC	PECO	PE	PEPCO	PPL	PSEG	REC
In Service	New Generation	1	19	0	17	0	0	28	0	0	0	4	0	0	0	0	0	23	0	8	0	0	100
	Upgrade	0	0	0	3	0	0	9	0	0	0	0	0	0	0	0	0	6	0	0	0	0	18
Under Construction	New Generation	0	0	0	1	0	0	3	0	0	0	0	0	0	0	0	0	1	0	0	0	0	5
	Upgrade	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1
Suspended	New Generation	1	0	0	1	1	0	2	0	0	0	1	0	0	1	0	0	0	0	0	0	0	7
	Upgrade	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Withdrawn	New Generation	20	120	0	46	10	0	119	15	0	0	23	15	1	10	0	0	64	0	50	2	0	495
	Upgrade	2	2	0	7	0	0	7	0	0	0	3	2	0	4	0	0	6	0	2	0	0	35
Active	New Generation	3	12	0	5	0	0	21	1	0	0	4	7	0	7	0	0	1	0	0	1	0	62
	Upgrade	2	23	0	10	1	0	37	0	0	0	2	3	0	5	0	0	10	0	0	0	0	93
Total Projects	New Generation	25	151	0	70	11	0	173	16	0	0	32	22	1	18	0	0	89	0	58	3	0	669
	Upgrade	4	25	0	20	1	0	54	0	0	0	5	5	0	9	0	0	22	0	2	0	0	147

Table 12-45 shows the status of all wind projects by MW that entered PJM generation queues from January 1, 1997, through December 31, 2024, by zone. Of the 35,477.9 MW of wind projects classified as new generation or upgrade currently active, suspended or under construction in the PJM generation queue, 11,916.9 MW (33.6 percent) are located in the JCPLC Zone.

**Table 12-45 Status of all wind generation queue projects by zone (MW): January 1, 1997 through December 31, 2024**

	Project	Project MW																						
Project Status	Classification	ACEC	AEP	AMPT	APS	ATSI	BGE	COMED	DAY	DUKE	DUQ	DOM	DPL	EKPC	JCPLC	MEC	OVEC	PECO	PE	PEPCO	PPL	PSEG	REC	Total
In Service	New Generation	7.5	3,544.6	0.0	1,178.0	0.0	0.0	4,386.7	0.0	0.0	0.0	511.5	0.0	0.0	0.0	0.0	0.0	0.0	1,047.0	0.0	226.5	0.0	0.0	10,901.8
	Upgrade	0.0	0.0	0.0	5.0	0.0	0.0	213.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	105.9	0.0	0.0	0.0	0.0	324.1
Under Construction	New Generation	0.0	0.0	0.0	54.9	0.0	0.0	1,200.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	109.9	0.0	0.0	0.0	0.0	1,364.8
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	105.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	105.9
Suspended	New Generation	432.0	0.0	0.0	80.0	297.7	0.0	278.7	0.0	0.0	0.0	78.2	0.0	0.0	816.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,982.5
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Withdrawn	New Generation	6,143.6	24,731.4	0.0	3,552.2	1,814.0	0.0	28,269.7	2,128.0	0.0	0.0	6,588.6	4,120.8	150.3	9,540.2	0.0	0.0	0.0	5,307.0	0.0	3,835.2	1,320.0	0.0	97,500.8
	Upgrade	5.0	370.0	0.0	119.4	0.0	0.0	754.0	0.0	0.0	0.0	114.0	470.0	0.0	2,330.0	0.0	0.0	0.0	243.4	0.0	6.0	0.0	0.0	4,411.8
Active	New Generation	1,509.6	2,328.6	0.0	671.5	0.0	0.0	4,561.1	100.0	0.0	0.0	3,289.1	5,534.2	0.0	11,100.9	0.0	0.0	0.0	77.0	0.0	0.0	1,310.0	0.0	30,481.9
	Upgrade	0.0	212.6	0.0	207.6	0.0	0.0	357.5	0.0	0.0	0.0	0.0	515.3	0.0	0.0	0.0	0.0	0.0	249.8	0.0	0.0	0.0	0.0	1,542.8
Total Projects	New Generation	8,092.7	30,604.6	0.0	5,536.6	2,111.7	0.0	38,696.1	2,228.0	0.0	0.0	10,467.4	9,655.0	150.3	21,457.1	0.0	0.0	0.0	6,540.8	0.0	4,061.7	2,630.0	0.0	142,231.8
	Upgrade	5.0	582.6	0.0	332.0	0.0	0.0	1,430.6	0.0	0.0	0.0	114.0	985.3	0.0	2,330.0	0.0	0.0	0.0	599.1	0.0	6.0	0.0	0.0	6,384.6

A total of 82 offshore wind projects entered PJM generation queues from January 1, 1997, through December 31, 2024. Offshore wind projects are included in the wind generation statistics. Of the 168 wind projects classified as new generation or upgrade currently active, suspended or under construction in the PJM generation queue (Table 12-44), 33 projects (19.6 percent) are offshore wind. Of the 35,477.9 MW of wind projects classified as new generation or upgrade currently active, suspended or under construction in the PJM generation queue (Table 12-45), 23,165.1 MW (65.3 percent) are offshore wind projects. Table 12-44 shows that 530 wind projects have been withdrawn from the queue. Of those 530 wind projects, 48 projects (9.1 percent) were offshore wind. Table 12-45 shows that those 530 wind projects that have been withdrawn from the queue totaled 101,912.3 MW. Of the 101,912.3 MW of withdrawn wind projects, 21,570.7 MW (21.2 percent) were offshore wind projects.

## Solar Project Analysis

Table 12-46 shows the status of all solar generation projects by number of projects that entered PJM generation queues from January 1, 1997, through December 31, 2024, by zone. Of the 1,501 solar projects classified as new generation or upgrade currently active, suspended or under construction in the PJM generation queue, 422 projects (28.1 percent) are located in the AEP Zone.

Table 12-46 Status of all solar generation queue projects by zone (number of projects): January 1, 1997 through December 31, 2024

Project Status	Project Classification	Number of Projects																						
		ACEC	AEP	AMPT	APS	ATSI	BGE	COMED	DAY	DUKE	DUQ	DOM	DPL	EKPC	JCPLC	MEC	OVEC	PECO	PE	PEPCO	PPL	PSEG	REC	Total
In Service	New Generation	11	20	0	20	3	1	2	2	3	3	73	18	2	55	5	0	1	5	3	5	46	0	278
	Upgrade	2	7	0	4	2	0	1	0	3	1	21	12	1	12	0	0	0	1	0	3	3	0	73
Under Construction	New Generation	3	10	0	5	1	2	0	5	0	0	7	6	2	1	0	0	0	5	0	1	1	0	49
	Upgrade	0	2	0	2	0	0	0	4	0	0	11	0	1	1	0	0	0	0	0	0	1	0	22
Suspended	New Generation	1	23	1	5	5	0	3	2	1	0	22	2	0	1	4	0	0	14	2	10	0	0	96
	Upgrade	0	6	0	0	0	0	0	1	0	0	3	3	0	0	1	0	0	2	0	0	0	0	16
Withdrawn	New Generation	192	178	0	181	70	15	65	37	21	2	338	163	27	206	66	2	15	154	28	99	124	0	1,983
	Upgrade	4	18	0	14	16	0	11	4	1	0	36	3	3	9	7	3	0	18	3	16	3	0	169
Active	New Generation	17	214	0	52	46	3	63	16	2	3	209	37	60	23	1	1	6	76	3	25	1	0	858
	Upgrade	6	167	1	24	23	0	37	17	1	1	63	20	16	8	9	0	0	35	0	30	2	0	460
Total Projects	New Generation	224	445	1	263	125	21	133	62	27	8	649	226	91	286	76	3	22	254	36	140	172	0	3,264
	Upgrade	12	200	1	44	41	0	49	26	5	2	134	38	21	30	17	3	0	56	3	49	9	0	740

Table 12-47 shows the status of all solar projects by MW that entered PJM generation queues from January 1, 1997, through December 31, 2024, by zone. Of the 100,835.8 MW of solar projects classified as new generation or upgrade currently active, suspended or under construction in the PJM generation queue, 38,701.7 MW (38.4 percent) are located in the AEP Zone.

Table 12-47 Status of all solar generation queue projects by zone (MW): January 1, 1997 through December 31, 2024

	Project	Project MW																						
Project Status	Classification	ACEC	AEP	AMPT	AP01	ATSI	BGE	COMED	DAY	DUKE	DUO	DOWLE	DPL	EKPC	JCLPC	MEC	OVEC	PECO	PE	PEPCO	PPL	PSEG	REC	Total
In Service	New Generation	67.6	2,362.0	0.0	607.1	423.0	1.1	59.0	402.5	214.9	45.9	4,157.6	296.5	85.0	417.1	160.0	0.0	3.3	168.5	35.6	77.0	241.9	0.0	9,823.5
	Upgrade	0.0	517.0	0.0	0.0	60.0	0.0	50.0	0.0	85.0	8.3	266.9	39.8	20.0	13.1	0.0	0.0	0.0	0.0	0.0	10.0	1.8	0.0	1,071.9
Under Construction	New Generation	13.6	1,228.9	0.0	296.8	125.0	30.0	0.0	296.7	0.0	0.0	438.2	315.1	150.0	19.8	0.0	0.0	0.0	17.9	0.0	80.0	6.0	0.0	3,179.1
	Upgrade	0.0	40.0	0.0	60.0	0.0	0.0	0.0	144.8	0.0	0.0	385.8	0.0	20.0	7.6	0.0	0.0	0.0	0.0	0.0	0.0	2.0	0.0	660.2
Suspended	New Generation	49.7	2,381.0	40.0	99.5	567.9	0.0	140.0	227.9	100.0	0.0	2,456.0	93.0	0.0	10.0	274.6	0.0	0.0	454.4	40.0	326.0	0.0	0.0	7,260.0
	Upgrade	0.0	183.0	0.0	0.0	0.0	0.0	0.0	20.0	0.0	0.0	85.0	52.0	0.0	0.0	20.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	390.0
Withdrawn	New Generation	2,120.2	13,467.1	0.0	5,077.7	3,433.3	121.6	5,953.1	3,033.0	1,071.4	33.0	23,416.4	2,950.5	1,770.8	1,715.9	1,335.5	198.0	160.8	4,242.9	460.9	2,050.1	610.3	0.0	73,222.3
	Upgrade	120.5	1,983.2	0.0	270.0	662.7	0.0	2,750.0	112.0	20.0	0.0	1,397.6	0.0	150.0	28.8	158.9	90.0	0.0	3.6	234.2	1.3	4.0	0.0	4,601.5
Active	New Generation	509.0	30,952.2	0.0	2,981.2	7,341.9	124.0	10,050.0	1,700.1	77.0	34.7	71,765.1	1,356.0	6,009.8	566.2	32.0	220.0	82.8	1,041.8	144.0	255.0	8.0	0.0	79,745.2
	Upgrade	48.0	3,915.6	65.0	288.9	202.0	0.0	2,347.1	118.5	0.0	0.0	17,335.4	95.5	233.8	11.0	0.0	0.0	0.0	337.5	0.0	22.5	0.0	0.0	9,601.3
Total Projects	New Generation	2,760.5	50,392.2	40.0	8,862.8	7,891.0	277.6	16,203.0	5,660.1	1,463.3	113.6	48,234.0	5,011.3	8,015.6	2,729.6	1,790.1	418.0	246.9	8,086.6	680.7	3,487.1	866.2	0.0	173,200.1
	Upgrade	220.5	5,138.8	65.0	549.6	924.7	0.0	2,622.1	395.3	105.0	8.3	8,868.8	186.3	423.8	55.5	178.0	90.0	0.0	712.5	3.6	47.0	5.1	0.0	16,230.3

## Battery Project Analysis

Table 12-48 shows the status of all battery generation projects by number of projects that entered PJM generation queues from January 1, 1997, through December 31, 2024, by zone. Of the 528 battery projects currently active, suspended or under construction in the PJM generation queue, 181 projects (34.3 percent) are located in the DOM Zone.

**Table 12-48 Status of all battery generation queue projects by zone (number of projects): January 1, 1997 through December 31, 2024**

Project Status	Project Classification	Number of Projects																							
		ACEC	AEP	AMPT	APS	ATSI	BGE	COMED	DAY	DUKE	DUQ	DOM	DPL	EKPC	JCPLC	MEC	OVEC	PECO	PE	PEPCO	PPL	PSEG	REC	Total	
In Service	New Generation	0	2	0	3	0	2	7	1	4	0	1	0	0	7	0	0	1	0	0	1	2	0	31	
	Upgrade	0	1	0	0	0	0	0	1	1	0	0	0	0	3	0	0	0	2	0	0	0	0	8	
Under Construction	New Generation	0	0	0	0	0	0	0	0	0	0	0	1	0	1	0	0	0	0	0	0	0	0	2	
	Upgrade	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	
Suspended	New Generation	0	2	0	0	0	0	0	0	0	0	2	0	0	0	0	0	0	1	0	2	2	0	9	
	Upgrade	0	1	0	0	0	0	1	0	1	0	1	0	0	0	0	0	0	0	0	0	0	0	4	
Withdrawn	New Generation	12	37	0	10	14	28	34	3	5	3	76	26	1	42	6	0	4	7	4	13	11	0	336	
	Upgrade	7	17	0	17	5	1	13	2	1	0	34	3	1	7	5	0	3	16	0	5	0	0	137	
Active	New Generation	12	67	0	13	6	6	34	2	1	3	115	6	4	11	3	0	0	7	5	0	6	0	301	
	Upgrade	3	45	1	12	7	1	46	4	0	0	63	8	3	5	4	0	0	8	0	1	1	0	212	
Total Projects	New Generation	24	108	0	26	20	36	75	6	10	6	194	33	5	61	9	0	5	15	9	16	21	0	679	
	Upgrade	10	64	1	29	12	2	60	7	3	0	98	11	4	15	9	0	3	26	0	6	1	0	361	

Table 12-49 shows the status of all battery projects by MW that entered PJM generation queues from January 1, 1997, through December 31, 2024, by zone. Of the 45,186.8 MW of battery generation currently active, suspended or under construction in the PJM generation queue, 11,474.5 MW (25.4 percent) are located in the DOM Zone.

**Table 12-49 Status of all battery generation queue projects by zone (MW): January 1, 1997 through December 31, 2024**

		Project MW																							
Project Status	Project Classification	ACEC	AEP	AMPT	APS	ATSI	BGE	COMED	DAY	DUKE	DUQ	DOM	DPL	EKPC	JCPLC	MEC	OVEC	PECO	PE	PEPCO	PPL	PSEG	REC	Total	
In Service	New Generation	0.0	6.0	0.0	39.9	0.0	3.5	86.0	12.0	16.0	0.0	20.0	0.0	0.0	112.8	0.0	0.0	1.0	0.0	0.0	20.0	3.0	0.0	320.2	
	Upgrade	0.0	4.0	0.0	0.0	0.0	0.0	0.0	8.0	4.0	0.0	0.0	0.0	0.0	8.0	0.0	0.0	0.0	28.4	0.0	0.0	0.0	0.0	52.4	
Under Construction	New Generation	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	20.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	21.0	
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	
Suspended	New Generation	0.0	100.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	55.7	0.0	0.0	0.0	0.0	0.0	0.0	160.0	0.0	170.0	15.0	0.0	500.7	
	Upgrade	0.0	40.0	0.0	0.0	0.0	0.0	10.0	0.0	52.2	0.0	40.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	142.2	
Withdrawn	New Generation	519.0	1,681.4	0.0	734.2	1,366.1	705.6	2,395.0	319.9	300.5	420.0	6,370.8	784.0	20.3	1,016.1	395.9	0.0	4.3	545.8	321.0	529.8	611.5	0.0	19,041.2	
	Upgrade	20.0	549.2	0.0	689.3	40.3	115.0	560.9	95.0	20.0	0.0	787.5	54.0	28.0	55.1	189.0	0.0	60.0	193.0	0.0	40.0	0.0	0.0	3,496.3	
Active	New Generation	1,544.0	8,024.1	0.0	1,321.0	750.0	895.0	6,302.2	185.0	250.0	105.0	10,144.3	474.0	148.0	1,250.0	330.0	0.0	0.0	630.0	2,117.0	0.0	1,180.0	0.0	35,649.6	
	Upgrade	0.0	2,482.4	0.0	1,083.0	388.0	300.0	2,465.4	205.0	0.0	0.0	1,234.5	115.0	0.0	90.0	285.0	0.0	0.0	210.0	0.0	0.0	15.0	0.0	8,873.3	
Total Projects	New Generation	2,063.0	9,811.5	0.0	2,095.1	2,116.1	1,604.1	8,783.2	516.9	566.5	525.0	16,590.8	1,259.0	168.3	2,398.9	725.9	0.0	5.3	1,335.8	2,438.0	719.8	1,809.5	0.0	55,532.7	
	Upgrade	20.0	3,075.6	0.0	1,772.3	428.3	415.0	3,036.3	308.0	76.2	0.0	2,062.0	169.0	28.0	153.1	474.0	0.0	60.0	431.4	0.0	40.0	15.0	0.0	12,564.2	

## Renewable Hybrid Project Analysis

Table 12-50 shows the status of all renewable hybrid generation projects (solar + storage, solar + wind and wind + storage) by number of projects that entered PJM generation queues from January 1, 1997, through December 31, 2024, by zone.<sup>85</sup> Of the 310 renewable hybrid projects currently active, suspended or under construction in the PJM generation queue, 91 projects (29.4 percent) are located in the AEP Zone.

**Table 12-50 Status of all renewable hybrid generation queue projects by zone (number of projects): January 1, 1997 through December 31, 2024**

		Number of Projects																						
Project Status	Project Classification	ACEC	AEP	AMPT	APS	ATSI	BGE	COMED	DAY	DUKE	DUQ	DOM	DPL	EKPC	JCPLC	MEC	OVEC	PECO	PE	PEPCO	PPL	PSEG	REC	Total
In Service	New Generation	0	0	0	1	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	5	0	7
	Upgrade	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1
Under Construction	New Generation	0	1	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	2
	Upgrade	0	2	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	2
Suspended	New Generation	0	0	0	0	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	1
	Upgrade	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Withdrawn	New Generation	7	26	0	25	9	0	7	2	1	0	56	2	12	4	9	0	1	16	2	33	11	0	223
	Upgrade	0	1	0	3	2	0	0	0	0	0	5	0	0	0	1	0	0	0	0	4	0	0	16
Active	New Generation	3	81	0	22	7	0	15	10	2	2	50	7	19	3	16	1	0	16	1	11	0	0	266
	Upgrade	1	7	0	5	1	0	3	3	0	0	5	0	2	0	0	0	0	7	0	5	0	0	39
Total Projects	New Generation	10	108	0	48	16	0	22	12	3	3	107	10	31	7	25	1	1	32	3	44	16	0	499
	Upgrade	1	10	0	8	3	0	4	3	0	0	10	0	2	0	1	0	0	7	0	9	0	0	58

Table 12-51 shows the status of all renewable hybrid projects by MW that entered PJM generation queues from January 1, 1997, through December 31, 2024, by zone. Of the 29,921.7 MW of renewable hybrid generation currently active, suspended or under construction in the PJM generation queue, 12,188.9 MW (40.7 percent) are located in the AEP Zone.

**Table 12-51 Status of all renewable hybrid generation queue projects by zone (MW): January 1, 1997 through December 31, 2024**

		Project MW																						
Project Status	Project Classification	ACEC	AEP	AMPT	APS	ATSI	BGE	COMED	DAY	DUKE	DUQ	DOM	DPL	EKPC	JCPLC	MEC	OVEC	PECO	PE	PEPCO	PPL	PSEG	REC	Total
In Service	New Generation	0.0	0.0	0.0	186.0	0.0	0.0	0.0	0.0	0.0	0.0	17.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5.1	0.0	0.0	208.1
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Under Construction	New Generation	0.0	150.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	153.9
	Upgrade	0.0	103.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	103.2
Suspended	New Generation	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	17.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	17.5
	Upgrade	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Withdrawn	New Generation	77.5	5,571.7	0.0	942.4	859.9	0.0	1,004.9	89.9	40.0	0.0	5,673.5	104.5	1,399.0	95.0	40.9	0.0	5.0	767.0	120.0	527.0	56.1	0.0	17,374.2
	Upgrade	0.0	0.0	0.0	16.3	30.0	0.0	0.0	0.0	0.0	0.0	60.0	0.0	0.0	0.0	3.7	0.0	0.0	0.0	0.0	114.8	0.0	0.0	224.8
Active	New Generation	143.0	10,960.7	0.0	3,437.5	286.5	0.0	1,805.5	520.9	810.0	90.0	5,041.5	321.6	1,328.1	140.0	201.3	178.5	0.0	1,405.7	809.5	304.0	0.0	0.0	27,784.3
	Upgrade	60.0	975.0	0.0	202.4	30.1	0.0	20.0	40.0	0.0	0.0	139.0	0.0	65.0	0.0	0.0	0.0	0.0	155.2	0.0	176.2	0.0	0.0	1,862.9
Total Projects	New Generation	220.5	16,682.4	0.0	4,565.9	1,146.4	0.0	2,810.4	610.8	850.0	107.5	10,732.0	430.0	2,727.1	235.0	242.2	178.5	5.0	2,172.7	929.5	831.0	61.1	0.0	45,538.0
	Upgrade	60.0	1,078.2	0.0	218.7	60.1	0.0	20.0	40.0	0.0	0.0	199.0	0.0	65.0	0.0	3.7	0.0	0.0	155.2	0.0	291.0	0.0	0.0	2,190.9

## Relationship Between Project Developer and Transmission Owner

A transmission owner (TO) is an “entity that owns, leases or otherwise has a possessory interest in facilities used for the transmission of electric energy in interstate commerce under the tariff.”<sup>86</sup> Where the transmission owner is a vertically integrated company that also owns generation, there is a potential conflict of interest when the transmission owner evaluates the interconnection requirements of new generation which is a competitor to the generation or transmission of the parent company and when the transmission owner evaluates the interconnection requirements of new generation which is part of the same company as the transmission owner. There is also a potential conflict of interest when the transmission owner evaluates the interconnection requirements of a nonincumbent transmission developer which is a competitor of the transmission owner. The MMU recommends outsourcing interconnection studies to an independent party to avoid potential conflicts of interest.

Table 12-52 shows the relationship between the project developer and transmission owner for all project MW that have entered the PJM generation queue from January 1, 1997, through December 31, 2024, by transmission owner and unit type. A project where the developer is affiliated with the transmission owner is classified as related. A project where the developer is not affiliated with the transmission owner is classified as unrelated. For example,

<sup>85</sup> PJM does not currently have a definition of a hybrid resource.

<sup>86</sup> See OATT § 1 (Transmission Owner).

36.0 MW of combined cycle generation projects that have entered the PJM generation queue in the DUKE Zone were projects developed by Duke Energy or subsidiaries of Duke Energy, the transmission owner for the DUKE Zone. These project MW are classified as related. There have been 667.5 MW of combined cycle projects that have entered the PJM generation queue in the DUKE Zone by developers not affiliated with Duke Energy. These project MW are classified as unrelated.

Of the 827,897.9 MW that have entered the queue during the time period of January 1, 1997, through December 31, 2024, 67,099.1 MW (8.1 percent) have been submitted by transmission owners building in their own service territory. PSEG is the transmission owner with the highest percentage of affiliates building in their own service territory. Of the 39,566.7 MW that entered the queue in the PSEG Zone during the time period of January 1, 1997, through December 31, 2024, 13,480.8 MW (34.1 percent) were submitted by PSEG or one of their affiliated companies.

**Table 12-52 Relationship between project developer and transmission owner for all interconnection queue projects MW by unit type: December 31, 2024**

Parent Company	Transmission Owner	Related to Developer	Number of Projects	MW by Unit Type																		Percent of Total												
				CT - Natural		CT - Oil		CT - Other	Fuel Cell	Hydro - Pumped Storage	Hydro - Run of River	RICE - Natural		RICE - Oil	RICE - Other	Solar	Solar + Storage	Solar + Wind	Steam - Coal	Steam - Natural Gas	Steam - Oil		Steam - Other	Wind	Wind + Storage									
				Battery	CC	Gas	Oil					Nuclear	Gas																					
AEP	AEP	Related	50	116.0	678.0	0.0	0.0	0.0	0.0	34.0	2.4	214.0	0.0	0.0	0.0	299.7	0.0	0.0	3,918.0	90.0	0.0	452.0	31,187.2	0.0	153,419.1	96.6%								
		Unrelated	1,260	12,771.1	21,973.5	2,594.1	7.5	502.0	0.0	0.0	453.6	0.0	12.0	0.0	75.4	55,231.3	17,760.6	0.0	10,399.0	0.0	0.0	0.0	0.0	0.0	1,436.0	11.4%								
AES	DAY	Related	14	20.0	0.0	47.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	21.5	0.0	0.0	1,347.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,436.0	11.4%			
		Unrelated	138	804.9	1,150.0	264.5	0.0	12.0	0.0	0.0	0.0	0.0	0.0	0.0	10.0	6,033.9	650.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2,228.0	0.0	11,154.1	88.6%		
AMP	AMPT	Related	0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0%			
		Unrelated	3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	105.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	105.0	100.0%			
DUQ	DUQ	Related	0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0%			
		Unrelated	49	525.0	665.0	223.5	40.0	19.2	0.0	0.0	194.6	1,879.0	14.4	0.0	0.0	121.9	107.5	0.0	2,810.0	0.0	0.0	20.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6,620.1	100.0%			
DOM	DOM	Related	207	896.7	11,397.5	1,476.7	100.0	0.0	0.0	340.0	0.0	1,944.0	0.0	0.0	60.0	5,213.2	17.0	0.0	301.0	0.0	4.0	946.1	0.0	22,696.2	18.8%									
		Unrelated	1,201	17,756.1	9,837.5	2,225.8	0.5	227.3	0.0	0.0	35.0	0.0	0.0	10.0	116.2	46,889.6	10,764.0	0.0	20.0	0.0	0.0	316.3	9,635.3	150.0	97,983.6	81.2%								
DUKE	DUKE	Related	12	37.3	36.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	105.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	178.7	4.5%			
		Unrelated	45	605.4	667.5	0.0	0.0	0.0	0.0	0.0	112.0	0.0	0.0	0.0	4.8	1,462.9	840.0	10.0	120.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3,822.6	95.5%			
EKPC	EKPC	Related	2	0.0	821.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	821.8	6.5%			
		Unrelated	157	196.3	170.0	73.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	8,439.4	2,792.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	150.3	0.0	11,821.0	93.5%		
Exelon	ACEC	Related	4	0.0	530.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	8.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	538.3	2.2%			
		Unrelated	390	2,083.0	9,048.4	807.4	388.0	20.7	2.8	0.0	0.0	0.0	2.0	5.0	10.3	2,972.7	280.5	0.0	15.0	5.5	0.0	10.0	8,097.7	0.0	23,749.0	97.8%								
	BGE	Related	15	22.5	250.0	10.0	0.0	0.0	0.0	0.0	0.0	117.2	0.0	0.0	8.5	20.0	0.0	0.0	10.0	101.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	539.2	5.7%			
		Unrelated	78	1,996.6	3,012.1	166.6	18.0	133.0	0.0	0.0	0.4	3,280.0	1.3	0.0	0.0	257.6	0.0	0.0	0.0	2.5	0.0	25.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	8,893.1	94.3%			
	COMED	Related	17	0.0	0.0	296.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	9.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,490.0	1.6%			
		Unrelated	667	11,819.5	16,833.2	1,394.2	42.0	65.2	5.0	0.0	22.7	0.0	35.0	0.0	67.7	18,816.1	2,631.4	199.0	1,926.0	91.0	0.0	90.0	40,126.7	0.0	94,164.7	98.4%								
	DPL	Related	5	1.0	60.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	7.4	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	68.4	0.2%			
		Unrelated	426	1,427.0	6,916.6	1,226.0	600.9	40.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	84.6	5,190.3	430.0	0.0	653.0	15.0	0.0	75.0	10,640.3	0.0	27,299.2	99.8%							
	PECO	Related	33	40.0	7,515.0	5.0	83.0	0.0	0.0	0.0	0.0	265.0	437.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	8,352.8	28.0%			
		Unrelated	98	25.3	20,610.5	596.5	8.5	15.0	0.0	0.0	0.0	0.0	0.0	0.0	17.0	3.7	246.9	5.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	21,528.4	72.0%			
	PEPCO	Related	5	1.0	503.0	0.0	0.0	4.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	508.0	1.7%			
		Unrelated	120	2,437.0	23,827.9	92.3	34.0	5.0	0.0	0.0	0.0	0.0	1,640.0	32.0	0.0	3.5	684.3	929.5	0.0	0.0	6.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	29,691.5	98.3%		
First Energy	APS	Related	10	0.0	1,453.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	71.2	0.0	0.0	1,710.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	3,234.2	5.1%			
		Unrelated	675	3,867.4	29,272.8	1,487.7	0.0	84.4	0.0	0.0	638.3	0.0	154.4	53.8	25.4	9,341.2	4,582.3	0.0	4,092.0	0.0	0.0	184.4	5,868.6	202.3	59,855.0	94.9%								
	ATSI	Related	6	0.0	1,678.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	16.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,694.0	5.5%			
		Unrelated	283	2,544.4	13,717.0	588.7	10.5	166.4	0.0	0.0	0.0	0.0	0.0	59.7	6.6	8,815.7	1,206.5	0.0	0.0	16.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2,111.7	0.0	29,250.5	94.5%	
	JCPLC	Related	2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	20.0	0.0	0.0	0.0	12.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	32.0	0.1%			
		Unrelated	490	2,552.0	15,751.4	542.1	0.0	4.8	0.2	30.0	1.6	0.0	0.6	0.0	12.8	2,773.1	235.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	30.0	23,787.1	0.0	45,720.6	99.9%
	MEC	Related	0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0%			
		Unrelated	220	1,199.9	17,488.9	57.6	1,204.4	52.1	0.0	0.0	0.0	93.0	0.0	8.0	23.2	1,968.1	245.9	0.0	0.0	0.0	0.0	0.0	84.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	22,425.1	100.0%		
	PE	Related	4	0.0	534.0	5.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,860.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2,399.0	5.3%			
		Unrelated	628	1,767.2	18,747.9	1,532.2	0.0	218.0	3.0	16.0	46.3	0.0	341.8	8.0	14.8	8,799.1	2,327.9	0.0	561.0	590.0	0.0	525.0	7,139.9	0.0	42,637.9	94.7%								
OVEC	OVEC	Related	0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0%			
		Unrelated	7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	686.5	100.0%			
PPL	PPL	Related	25	0.0	2,261.0	0.0	0.0	0.0	0.0	0.0	0.0	109.0	1,650.0	0.0	0.0	0.0	146.8	0.0	0.0	111.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	4,277.8	8.9%		
		Unrelated	454	759.8	24,678.3	423.1	8.0	234.5	0.0	1,200.	142.6	438.0	19.9	2.4	44.7	3,810.5	1,032.0	0.0	6,899.1	0.0	0.0	28.5	4,067.7	90.0	43,879.1	91.1%								
PSEG	PSEG	Related	105	0.0	11,035.0	1,818.1	0.0	0.0	0.0	0.0	0.0	0.0	381.0	0.0	0.0	174.0	4.7	0.0	24.0	44.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	13,480.8	34.1%			
		Unrelated	283	1,824.5	18,023.0	1,137.9	600.0	62.5	4.9	0.0	1,000.0	0.0	10.6	0.0	13.7	697.3	56.5	0.0	25.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2,630.0	0.0	26,085.9	65.9%	
Con Ed	REC	Related	0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0%				
		Unrelated	2	0.0	6.9	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6.9	100.0%			
Total		Related	516																															



## Combined Cycle Project Developer and Transmission Owner Relationships

Table 12-53 shows the relationship between the project developer and transmission owner for all combined cycle project MW that have entered the PJM generation queue from January 1, 1997, through December 31, 2024, by transmission owner and project status. Of the 49,413.8 combined cycle project MW that are in service or currently under construction, 8,648.5 MW (17.5 percent) have been developed by transmission owners building in their own service territory. EKPC is the transmission owner with the highest percentage of affiliates building combined cycle projects in their own service territory. Of the 991.8 MW that entered the queue in the EKPC Zone during the time period of January 1, 1997, through December 31, 2024, 821.8 MW (82.9 percent) have been submitted by EKPC or one of their affiliated companies.

**Table 12-53 Relationship between project developer and transmission owner for all combined cycle project MW in the queue: December 31, 2024**

Parent Company	Transmission Owner	Related to Developer	MW by Project Status						Percent of Total
			Active	In Service	Under Construction	Suspended	Withdrawn	Total	
AEP	AEP	Related	0.0	678.0	0.0	0.0	0.0	678.0	3.0%
		Unrelated	1,150.0	6,233.0	0.0	0.0	14,590.5	21,973.5	97.0%
AES	DAY	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	1,150.0	1,150.0	100.0%
AMP	AMPT	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
DUQ	DUQ	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	665.0	665.0	100.0%
DOM	DOM	Related	19.0	4,837.5	0.0	0.0	6,541.0	11,397.5	53.7%
		Unrelated	593.0	2,044.1	0.0	0.0	7,200.4	9,837.5	46.3%
DUKE	DUKE	Related	0.0	0.0	0.0	0.0	36.0	36.0	5.1%
		Unrelated	0.0	533.0	0.0	0.0	134.5	667.5	94.9%
EKPC	EKPC	Related	0.0	0.0	0.0	0.0	821.8	821.8	82.9%
		Unrelated	0.0	0.0	0.0	0.0	170.0	170.0	17.1%
Exelon	ACEC	Related	0.0	0.0	0.0	0.0	530.0	530.0	5.5%
		Unrelated	0.0	879.0	0.0	0.0	8,169.4	9,048.4	94.5%
	BGE	Related	0.0	130.0	0.0	0.0	120.0	250.0	7.7%
		Unrelated	0.0	10.0	0.0	0.0	3,002.1	3,012.1	92.3%
	COMED	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	3,603.5	102.7	575.0	12,552.0	16,833.2	100.0%
	DPL	Related	0.0	60.0	0.0	0.0	0.0	60.0	0.9%
		Unrelated	0.0	361.2	0.0	0.0	6,555.4	6,916.6	99.1%
	PECO	Related	0.0	0.0	0.0	0.0	7,515.0	7,515.0	26.7%
		Unrelated	0.0	3,740.5	0.0	0.0	16,870.0	20,610.5	73.3%
	PEPCO	Related	0.0	80.0	0.0	0.0	423.0	503.0	2.1%
		Unrelated	45.0	1,708.6	0.0	0.0	22,074.3	23,827.9	97.9%
First Energy	APS	Related	0.0	525.0	0.0	0.0	928.0	1,453.0	4.7%
		Unrelated	2,785.0	2,404.7	0.0	1,270.0	22,813.1	29,272.8	95.3%
	ATSI	Related	0.0	0.0	0.0	0.0	1,678.0	1,678.0	10.9%
		Unrelated	128.0	4,095.0	940.0	0.0	8,554.0	13,717.0	89.1%
	JCPLC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	1,775.8	0.0	0.0	13,975.6	15,751.4	100.0%
	MEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	2,745.9	0.0	0.0	14,743.0	17,488.9	100.0%
	PE	Related	0.0	0.0	0.0	0.0	534.0	534.0	2.8%
		Unrelated	30.0	2,012.3	0.0	0.0	16,705.6	18,747.9	97.2%
OVEC	OVEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
PPL	PPL	Related	0.0	600.0	0.0	0.0	1,661.0	2,261.0	8.4%
		Unrelated	0.0	6,718.6	0.0	0.0	17,959.7	24,678.3	91.6%
PSEG	PSEG	Related	0.0	1,738.0	0.0	0.0	9,297.0	11,035.0	38.0%
		Unrelated	0.0	806.4	51.1	0.0	17,165.5	18,023.0	62.0%
Con Ed	REC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	6.9	6.9	100.0%
Total		Related	19.0	8,648.5	0.0	0.0	30,084.8	38,752.3	13.3%
		Unrelated	4,731.0	39,671.5	1,093.8	1,845.0	205,056.8	252,398.2	86.7%

### Combustion Turbine – Natural Gas Project Developer and Transmission Owner Relationships

Table 12-54 shows the relationship between the project developer and transmission owner for all CT – natural gas project MW that have entered the PJM generation queue from January 1, 1997, through December 31, 2024, by transmission owner and project status. Of the 9,986.5 CT – natural gas project MW that are in service or currently under construction, 1,803.0 (18.1 percent) have been developed by Transmission Owners building in their own service territory. PSEG is the transmission owner with the highest percentage of affiliates building CT – natural gas projects in their own service territory. Of the 2,956.0 MW that entered the queue in the PSEG Zone during the time period of January 1, 1997, through December 31, 2024, 1,818.1 MW (61.5 percent) have been submitted by PSEG or one of their affiliated companies.

**Table 12-54 Relationship between project developer and transmission owner for all CT – natural gas project MW in the queue: December 31, 2024**

Parent Company	Transmission Owner	Related to Developer	MW by Project Status					Total	Percent of Total
			Active	In Service	Under Construction	Suspended	Withdrawn		
AEP	AEP	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	791.0	278.1	0.0	0.0	1,525.0	2,594.1	100.0%
AES	DAY	Related	0.0	47.0	0.0	0.0	0.0	47.0	15.1%
		Unrelated	0.0	36.5	0.0	0.0	228.0	264.5	84.9%
AMP	AMPT	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
DUQ	DUQ	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	205.0	0.0	0.0	18.5	223.5	100.0%
DOM	DOM	Related	569.0	824.0	0.0	0.0	83.7	1,476.7	39.9%
		Unrelated	0.0	1,182.7	0.0	0.0	1,043.1	2,225.8	60.1%
DUKE	DUKE	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
EKPC	EKPC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	73.0	73.0	100.0%
Exelon	ACEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	404.4	0.0	0.0	403.0	807.4	100.0%
	BGE	Related	0.0	10.0	0.0	0.0	0.0	10.0	5.7%
		Unrelated	0.0	13.0	0.0	0.0	153.6	166.6	94.3%
	COMED	Related	0.0	0.0	0.0	0.0	296.0	296.0	17.5%
		Unrelated	0.0	934.0	60.0	0.0	400.2	1,394.2	82.5%
	DPL	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	1,226.0	0.0	0.0	0.0	1,226.0	100.0%
	PECO	Related	0.0	5.0	0.0	0.0	0.0	5.0	0.8%
		Unrelated	0.0	596.0	0.0	0.0	0.5	596.5	99.2%
	PEPCO	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	44.0	0.0	0.0	48.3	92.3	100.0%
First Energy	APS	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	30.0	1,453.7	0.0	0.0	4.0	1,487.7	100.0%
	ATSI	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	458.7	105.0	0.0	0.0	25.0	588.7	100.0%
	JCPLC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	540.0	0.0	0.0	2.1	542.1	100.0%
	MEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	57.6	0.0	0.0	0.0	57.6	100.0%
	PE	Related	0.0	5.0	0.0	0.0	0.0	5.0	0.3%
		Unrelated	0.0	415.4	0.0	0.0	1,116.8	1,532.2	99.7%
OVEC	OVEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
PPL	PPL	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	403.2	0.0	0.0	19.9	423.1	100.0%
PSEG	PSEG	Related	0.0	912.0	0.0	0.0	906.1	1,818.1	61.5%
		Unrelated	0.0	228.9	0.0	0.0	909.0	1,137.9	38.5%
Con Ed	REC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
Total		Related	569.0	1,803.0	0.0	0.0	1,285.8	3,657.8	19.2%
		Unrelated	1,279.7	8,123.5	60.0	0.0	5,970.0	15,433.2	80.8%

## Wind Project Developer and Transmission Owner Relationships

Table 12-55 shows the relationship between the project developer and transmission owner for all wind project MW that have entered the PJM generation queue from January 1, 1997, through December 31, 2024, by transmission owner and project status. Of the 12,696.6 wind project MW that are in service or currently under construction, 12.0 MW (0.1 percent) have been developed by transmission owners building in their own service territory. DOM is the transmission owner with the highest percentage of affiliates building wind projects in their own service territory. Of the 10,581.4 MW that entered the queue in the DOM Zone during the time period of January 1, 1997, through December 31, 2024, 946.1 MW (8.9 percent) have been submitted by DOM or one of their affiliated companies.

**Table 12-55 Relationship between project developer and transmission owner for all wind project MW in the queue: December 31, 2024**

Parent Company	Transmission Owner	Related to Developer	MW by Project Status						Percent of Total
			Active	In Service	Under Construction	Suspended	Withdrawn	Total	
AEP	AEP	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	2,541.2	3,544.6	0.0	0.0	25,101.4	31,187.2	100.0%
AES	DAY	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	100.0	0.0	0.0	0.0	2,128.0	2,228.0	100.0%
AMP	AMPT	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
DUQ	DUQ	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
DOM	DOM	Related	800.1	12.0	0.0	0.0	134.0	946.1	8.9%
		Unrelated	2,489.0	499.5	0.0	78.2	6,568.6	9,635.3	91.1%
DUKE	DUKE	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
EKPC	EKPC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	150.3	150.3	100.0%
Exelon	ACEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	1,509.6	7.5	0.0	432.0	6,148.6	8,097.7	100.0%
	BGE	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
	COMED	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	4,918.6	4,599.9	1,305.9	278.7	29,023.7	40,126.7	100.0%
	DPL	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	6,049.5	0.0	0.0	0.0	4,590.8	10,640.3	100.0%
	PECO	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
	PEPCO	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
First Energy	APS	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	879.1	1,183.0	54.9	80.0	3,671.6	5,868.6	100.0%
	ATSI	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	297.7	1,814.0	2,111.7	100.0%
	JCPLC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	11,100.9	0.0	0.0	816.0	11,870.2	23,787.1	100.0%
	MEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
	PE	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	326.8	1,152.9	109.9	0.0	5,550.3	7,139.9	100.0%
OVEC	OVEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
PPL	PPL	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	226.5	0.0	0.0	3,841.2	4,067.7	100.0%
PSEG	PSEG	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	1,310.0	0.0	0.0	0.0	1,320.0	2,630.0	100.0%
Con Ed	REC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
Total		Related	800.1	12.0	0.0	0.0	134.0	946.1	0.6%
		Unrelated	31,224.6	11,213.9	1,470.7	1,982.5	101,778.6	147,670.3	99.4%

## Solar Project Developer and Transmission Owner Relationships

Table 12-56 shows the relationship between the project developer and transmission owner for all solar project MW that have entered the PJM generation queue from January 1, 1997, through December 31, 2024, by transmission owner and project status. Of the 14,734.7 solar project MW that are in service or currently under construction, 2,163.2 MW (14.7 percent) have been developed by transmission owners building in their own service territory. PSEG is the transmission owner with the highest percentage of affiliates building solar projects in their own service territory. Of the 871.3 MW that entered the queue in the PSEG Zone during the time period of January 1, 1997, through December 31, 2024, 174.0 MW (20.0 percent) have been submitted by PSEG or one of their affiliated companies.

**Table 12-56 Relationship between project developer and transmission owner for all solar project MW in the queue: December 31, 2024**

Parent Company	Transmission Owner	Related to Developer	MW by Project Status						Percent of Total
			Active	In Service	Under Construction	Suspended	Withdrawn	Total	
AEP	AEP	Related	100.0	34.7	0.0	0.0	165.0	299.7	0.5%
		Unrelated	34,768.8	2,844.3	1,268.9	2,564.0	13,785.3	55,231.3	99.5%
AES	DAY	Related	0.0	0.0	0.0	0.0	21.5	21.5	0.4%
		Unrelated	1,818.6	402.5	441.5	247.9	3,123.5	6,033.9	99.6%
AMP	AMPT	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	65.0	0.0	0.0	40.0	0.0	105.0	100.0%
DUQ	DUQ	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	34.7	54.2	0.0	0.0	33.0	121.9	100.0%
DOM	DOM	Related	2,587.3	1,530.1	448.9	20.0	626.9	5,213.2	10.0%
		Unrelated	16,912.0	2,894.4	375.1	2,521.0	24,187.1	46,889.6	90.0%
DUKE	DUKE	Related	49.0	0.0	0.0	0.0	56.4	105.4	6.7%
		Unrelated	28.0	299.9	0.0	100.0	1,035.0	1,462.9	93.3%
EKPC	EKPC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	6,243.6	105.0	170.0	0.0	1,920.8	8,439.4	100.0%
Exelon	ACEC	Related	0.0	0.0	0.0	0.0	8.3	8.3	0.3%
		Unrelated	557.4	67.6	13.6	49.7	2,284.4	2,972.7	99.7%
	BGE	Related	0.0	0.0	0.0	0.0	20.0	20.0	7.2%
		Unrelated	124.9	1.1	30.0	0.0	101.6	257.6	92.8%
	COMED	Related	0.0	9.0	0.0	0.0	0.0	9.0	0.0%
		Unrelated	12,398.0	100.0	0.0	140.0	6,178.1	18,816.1	100.0%
	DPL	Related	0.0	7.4	0.0	0.0	0.0	7.4	0.1%
		Unrelated	1,450.7	328.9	315.1	145.0	2,950.5	5,190.3	99.9%
	PECO	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	82.8	3.3	0.0	0.0	160.8	246.9	100.0%
	PEPCO	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	144.2	35.6	0.0	40.0	464.5	684.3	100.0%
First Energy	APS	Related	52.4	0.0	0.0	0.0	18.8	71.2	0.8%
		Unrelated	2,998.2	607.1	356.8	99.5	5,279.6	9,341.2	99.2%
	ATSI	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	3,543.9	483.0	125.0	567.9	4,095.9	8,815.7	100.0%
	JCPLC	Related	0.0	0.0	0.0	0.0	12.0	12.0	0.4%
		Unrelated	577.8	430.2	27.4	10.0	1,727.7	2,773.1	99.6%
	MEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	20.0	160.0	0.0	294.6	1,493.5	1,968.1	100.0%
	PE	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	3,379.3	168.5	179.0	484.4	4,587.9	8,799.1	100.0%
OVEC	OVEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	220.0	0.0	0.0	0.0	288.0	508.0	100.0%
PPL	PPL	Related	0.0	0.0	0.0	0.0	146.8	146.8	3.7%
		Unrelated	1,181.9	85.0	80.0	326.0	2,137.5	3,810.5	96.3%
PSEG	PSEG	Related	0.0	131.1	2.0	0.0	40.9	174.0	20.0%
		Unrelated	8.0	112.6	6.0	0.0	570.7	697.3	80.0%
Con Ed	REC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
Total		Related	2,788.6	1,712.3	450.9	20.0	1,116.5	6,088.3	3.2%
		Unrelated	86,557.8	9,183.1	3,388.4	7,630.0	76,405.4	183,164.7	96.8%

## Battery Project Developer and Transmission Owner Relationships

Table 12-57 shows the relationship between the project developer and transmission owner for all battery project MW that have entered the PJM generation queue from January 1, 1997, through December 31, 2024, by transmission owner and project status. Of the 393.6 battery project MW that are in service or currently under construction, 63.5 MW (16.1 percent) have been developed by transmission owners building in their own service territory. PECO is the transmission owner with the highest percentage of affiliates building battery projects in their own service territory. Of the 65.3 MW that entered the queue in the PECO Zone during the time period of January 1, 1997, through December 31, 2024, 40.0 MW (61.3 percent) have been submitted by PECO or one of their affiliated companies.

**Table 12-57 Relationship between project developer and transmission owner for all battery project MW in the queue: December 31, 2024**

Parent Company	Transmission Owner	Related to Developer	MW by Project Status						Percent of Total
			Active	In Service	Under Construction	Suspended	Withdrawn	Total	
AEP	AEP	Related	100.0	6.0	0.0	0.0	10.0	116.0	0.9%
		Unrelated	10,406.5	4.0	0.0	140.0	2,220.6	12,771.1	99.1%
AES	DAY	Related	0.0	20.0	0.0	0.0	0.0	20.0	2.4%
		Unrelated	390.0	0.0	0.0	0.0	414.9	804.9	97.6%
AMP	AMPT	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
DUQ	DUQ	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	105.0	0.0	0.0	0.0	420.0	525.0	100.0%
DOM	DOM	Related	761.0	20.0	0.0	95.7	20.0	896.7	4.8%
		Unrelated	10,617.8	0.0	0.0	0.0	7,138.3	17,756.1	95.2%
DUKE	DUKE	Related	0.0	14.0	0.0	0.0	23.3	37.3	5.8%
		Unrelated	250.0	6.0	0.0	52.2	297.2	605.4	94.2%
EKPC	EKPC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	148.0	0.0	0.0	0.0	48.3	196.3	100.0%
Exelon	ACEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	1,544.0	0.0	0.0	0.0	539.0	2,083.0	100.0%
	BGE	Related	0.0	2.5	0.0	0.0	20.0	22.5	1.1%
		Unrelated	1,195.0	1.0	0.0	0.0	800.6	1,996.6	98.9%
	COMED	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	8,767.6	86.0	0.0	10.0	2,956.0	11,819.5	100.0%
	DPL	Related	0.0	0.0	1.0	0.0	0.0	1.0	0.1%
		Unrelated	589.0	0.0	0.0	0.0	838.0	1,427.0	99.9%
	PECO	Related	0.0	0.0	0.0	0.0	40.0	40.0	61.3%
		Unrelated	0.0	1.0	0.0	0.0	24.3	25.3	38.7%
	PEPCO	Related	0.0	0.0	0.0	0.0	1.0	1.0	0.0%
		Unrelated	2,117.0	0.0	0.0	0.0	320.0	2,437.0	100.0%
First Energy	APS	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	2,404.0	39.9	0.0	0.0	1,423.5	3,867.4	100.0%
	ATSI	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	1,138.0	0.0	0.0	0.0	1,406.4	2,544.4	100.0%
	JCPLC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	1,340.0	120.8	20.0	0.0	1,071.2	2,552.0	100.0%
	MEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	615.0	0.0	0.0	0.0	584.9	1,199.9	100.0%
	PE	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	840.0	28.4	0.0	160.0	738.8	1,767.2	100.0%
OVEC	OVEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
PPL	PPL	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	20.0	0.0	170.0	569.8	759.8	100.0%
PSEG	PSEG	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	1,195.0	3.0	0.0	15.0	611.5	1,824.5	100.0%
Con Ed	REC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
Total		Related	861.0	62.5	1.0	95.7	114.3	1,134.5	1.7%
		Unrelated	43,661.9	310.1	20.0	547.2	22,423.3	66,962.5	98.3%

## Renewable Hybrid Project Developer and Transmission Owner Relationships

Table 12-58 shows the relationship between the project developer and transmission owner for all renewable hybrid project MW that have entered the PJM generation queue from January 1, 1997, through December 31, 2024, by transmission owner and project status. Of the 465.1 renewable hybrid project MW that are in service or currently under construction, 21.7 MW (4.7 percent) have been developed by transmission owners building in their own service territory. PSEG is the transmission owner with the highest percentage of affiliates building hybrid projects in their own service territory. Of the 61.1 MW that entered the queue in the PSEG Zone during the time period of January 1, 1997, through December 31, 2024, 4.7 MW (7.7 percent) have been submitted by PSEG or one of their affiliated companies.

**Table 12-58 Relationship between project developer and transmission owner for all hybrid project MW in the queue: December 31, 2024**

Parent Company	Transmission Owner	Related to Developer	MW by Project Status					Total	Percent of Total
			Active	In Service	Under Construction	Suspended	Withdrawn		
AEP	AEP	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	11,935.7	0.0	253.2	0.0	5,571.7	17,760.6	100.0%
AES	DAY	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	560.9	0.0	0.0	0.0	89.9	650.8	100.0%
AMP	AMPT	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
DUQ	DUQ	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	90.0	0.0	0.0	17.5	0.0	107.5	100.0%
DOM	DOM	Related	0.0	17.0	0.0	0.0	0.0	17.0	0.2%
		Unrelated	5,180.5	0.0	0.0	0.0	5,733.5	10,914.0	99.8%
DUKE	DUKE	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	810.0	0.0	0.0	0.0	40.0	850.0	100.0%
EKPC	EKPC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	1,393.1	0.0	0.0	0.0	1,399.0	2,792.1	100.0%
Exelon	ACEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	203.0	0.0	0.0	0.0	77.5	280.5	100.0%
	BGE	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
	COMED	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	1,825.5	0.0	0.0	0.0	1,004.9	2,830.4	100.0%
	DPL	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	321.6	0.0	3.9	0.0	104.5	430.0	100.0%
	PECO	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	5.0	5.0	100.0%
	PEPCO	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	809.5	0.0	0.0	0.0	120.0	929.5	100.0%
First Energy	APS	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	3,639.9	186.0	0.0	0.0	958.7	4,784.6	100.0%
	ATSI	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	316.6	0.0	0.0	0.0	889.9	1,206.5	100.0%
	JCPLC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	140.0	0.0	0.0	0.0	95.0	235.0	100.0%
	MEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	201.3	0.0	0.0	0.0	44.6	245.9	100.0%
	PE	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	1,560.9	0.0	0.0	0.0	767.0	2,327.9	100.0%
OVEC	OVEC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	178.5	0.0	0.0	0.0	0.0	178.5	100.0%
PPL	PPL	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	480.2	0.0	0.0	0.0	641.8	1,122.0	100.0%
PSEG	PSEG	Related	0.0	4.7	0.0	0.0	0.0	4.7	7.7%
		Unrelated	0.0	0.4	0.0	0.0	56.1	56.5	92.3%
Con Ed	REC	Related	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
		Unrelated	0.0	0.0	0.0	0.0	0.0	0.0	0.0%
Total		Related	0.0	21.7	0.0	0.0	0.0	21.7	0.0%
		Unrelated	29,647.2	186.4	257.1	17.5	17,599.0	47,707.1	100.0%



## Transition Cycle 1

On November 29, 2022, the Commission issued an order accepting PJM's tariff revisions to improve the queue process.<sup>87</sup> The new queue process includes modifications to implement a cluster/cycle based processing method to replace the first in/first out processing method.<sup>88</sup> This change will allow projects to move forward based on a first ready/first out analysis, where readiness is demonstrated through site control and financial milestones and there is an option to exit the study process early based on system impacts. The transition to the new queue process began on July 10, 2023.

Transition cycle 1 (TC1) is comprised of 310 proposed generation projects. Those projects make up 41,214.6 MW. On December 31, 2024, all projects in TC1 were either in the status of active or were withdrawn from the cycle. Table 12-59 shows each status by unit type. Of the 41,214.6 MW in TC1, 26,916.7 MW (65.3 percent) were active and 14,297.9 MW (34.7 percent) were withdrawn. Of the 26,916.7 MW in the status of active, 15,425.3 MW (57.3 percent) were solar projects, 4,954.6 MW (18.4 percent) were wind projects, and 569.0 MW (1.4 percent) were gas-fired CTs.

**Table 12-59 Transition Cycle 1 project status (MW) by unit type: December 31, 2024**

	CT -										Hydro -				Hydro -				RICE -				Steam -							
	Combined		Natural	CT -		Fuel	Pumped	Run of	Natural		RICE -	RICE -	Solar +		Solar +	Steam	Natural		Steam	Steam	Wind +		Total							
	Battery	Cycle	Gas	CT -	Oil	Other	Cell	Storage	River	Nuclear	Gas	Oil	Other	Solar	Storage	Wind	- Coal	Gas	- Oil	- Other	Wind	Storage								
Active	3,593.6	569.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	15,425.3	2,175.3	199.0	0.0	0.0	0.0	0.0	4,954.6	0.0	26,916.7							
Withdrawn	2,751.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6,058.9	2,032.9	0.0	0.0	0.0	0.0	0.0	3,454.4	0.0	14,297.9							
Total	6,345.4	569.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	21,484.2	4,208.2	199.0	0.0	0.0	0.0	0.0	8,409.0	0.0	41,214.6							

On May 20, 2024, PJM completed the phase 1 system impact study for transition cycle 1. Developers had 30 days (until June 20, 2024) to decide whether to proceed with their new service requests into the next study phase of TC1 or to withdraw their projects. Continuing with phase 2 required developers to meet the decision point 1 requirements (including additional readiness deposits and proof of site control).<sup>89</sup>

On December 20, 2024, PJM completed the phase 2 system impact study for transition cycle 1. Developers have 30 days (until January 19, 2025) to decide whether to proceed with their new service requests into the next study phase of TC1 or to withdraw their projects.

Continuing with phase 3 requires developers to meet the decision point 2 requirements, (including additional readiness deposits and proof of site control).<sup>90</sup>

## Transition Cycle 2

The application phase for transition cycle 2 (TC2) opened on June 20, 2024, coincident with the close of phase 1 of transition cycle 1. The application phase required all active projects in queues AG2 and AH1 to reapply under the new rules. The application phase of TC2 was open for 180 days, and closed on December 17, 2024. The TC2 application review stage began at the close of the application phase. PJM will review the submissions for required data and deposits and build the models required for the TC2 system impact studies. The TC2 application review stage is expected to be completed early in the second quarter of 2025.

## Reliability Resource Initiative (RRI)

On December 13, 2024, PJM submitted modifications to its Open Access Transmission Tariff to add provisions, through a one-time reliability based expansion of the projects in TC2.<sup>91</sup> The proposed RRI Tariff revisions will create a second TC2 application window that will enable RRI projects to join TC2 and be studied for interconnection during the transition period.

The RRI application window will not limit the number and type of projects (or any restriction on fuel type of projects) that may apply to enter the RRI process. However, PJM will restrict the number of RRI projects to be added to TC2 by scoring all the RRI applications using weighted criteria to determine the 50 projects that best satisfy the need for reliable capacity that can be available quickly.

The MMU supports the stated goals of the December 13th Filing, and supports approval of the December 13th Filing, but also identifies significant flaws that compromise the ability of the proposal to achieve its stated goals.<sup>92</sup> PJM's RRI scoring criteria place undue emphasis on ELCC values rather than on dispatchability.

<sup>87</sup> 181 FERC ¶ 61,162 (2022).

<sup>88</sup> See "Interconnection Process Reform," presented at April 27, 2022 meeting of the Members Committee. <<https://www.pjm.com/-/media/committees-groups/committees/mc/2022/20220427/20220427-item-01a-1-interconnection-process-reform-presentation.ashx>>.

<sup>89</sup> See "PJM Manual 14H: New Service Requests Cycle Process," Rev. 00 (July 26, 2023) for a complete list of all readiness requirements.

<sup>90</sup> See "PJM Manual 14H: New Service Requests Cycle Process," Rev. 00 (July 26, 2023) for a complete list of all readiness requirements.

<sup>91</sup> See *PJM Interconnection LLC*, Docket No. ER25-712 (December 13, 2024).

<sup>92</sup> See IMM Comments, *PJM Interconnection LLC*, Docket No. ER25-712.

PJM states that the goal is to be fuel and technology neutral. That is not the appropriate objective when there are defined differences in reliability and dispatchability across resource types, by fuel and technology. The goal of the December 13th Filing should be to select the most reliable fuel and technology combinations. PJM also focuses on an arbitrary number of projects (50) that could qualify as RRI projects rather than on a target level of MW needed for reliability. PJM should identify the number of MW, with the required reliability characteristics, that it believes are needed to address PJM's identified reliability shortfall and use the RRI process to obtain those MW. PJM's RRI scoring criteria should be a series of thresholds that must be met in sequence rather than a single formula that considers all elements simultaneously and assumes that the criteria are comparable through relative weights. The first threshold would be that the resource is in the right location to address the identified locational reliability issue. The second threshold would be that the operational characteristics of the resource fully address the identified reliability issue including technology and fuel source(s). The third threshold would be commercial viability within a defined time period with detailed tracking and strong financial incentives. No RRI resource would be approved unless it met all three thresholds.

PJM includes a range of important enforceable provisions that help ensure that the selected RRI resources will actually go online as promised. These provisions include a must offer obligation which is essential to the efficacy of the entire filing as capacity resources that do not offer do not help solve the identified problem. The MMU supports these provisions.

In addition to the one time RRI process, the MMU recommends that PJM establish an ongoing expedited PJM managed queue process to identify commercially viable projects that could help eliminate or reduce the need for specific RMRs or that could address specific reliability needs and allow the identified projects to advance in the queue ahead of projects which have failed to make progress, subject to rules to prevent gaming.<sup>93</sup> While it is important to respect the existing, improved PJM queue process, it is essential to provide strong

and clear incentives for projects to actually resolve reliability issues and to actually guarantee timely in service dates in order to help ensure that the queue is not a mirage as it has been in significant part for its recent history. Recognizing that improved queue rules are being implemented, the history of queue projects becoming actual in service capacity resources suggests strongly that such incentives have not been provided by the queue process.

## Interconnection Costs for New Projects

Any entity that requests interconnection of a new generating facility, including increases to the capacity of an existing generating unit, or that requests interconnection of a merchant transmission facility, must follow the process defined in the PJM tariff to obtain interconnection service.<sup>94</sup> PJM's process is designed to ensure that new generation is added in a reliable and systematic manner. As part of the interconnection planning process, a series of studies are performed to determine the feasibility, impact, and cost of interconnecting projects in the queue. Interconnection requests are for energy only resources and for capacity resources.

Interconnecting capacity resources must meet a higher standard than energy only resources. For interconnecting capacity resources, PJM performs deliverability studies that ensure that the energy from the proposed generator can be reliably provided to the PJM region. Deliverability studies identify network upgrades needed to ensure that the transmission system is capable of delivering the aggregate system generating capacity at peak load, including the new resource, with all firm transmission service modeled.<sup>95</sup> The interconnection service agreement identifies the transmission modifications needed to maintain the reliability of the transmission system as a result of a new service request. These identified modifications are known as network upgrades. In general, there are fewer network upgrades associated with energy only resources, as energy only resources are not required to be deliverable to the entire PJM footprint.<sup>96</sup> On December 31, 2024, there were 2,570 projects in generation request queues in the status of active, under construction or suspended, and 1,856 active network transmission upgrades. If a project is withdrawn from the queue, the network upgrades

<sup>93</sup> The MMU has consistently supported a stronger role for PJM in addressing immediate reliability needs. As part of the CIR Transfer Efficiency initiative, the MMU proposed to allow PJM to initiate an expedited fast track process to address PJM identified reliability issues. The proposed expedited process would have allowed PJM to open a limited scope expedited reliability process to select projects that address the reliability issues. See "CIR Transfer Efficiency IMM Package," MMU presentation to the PJM Planning Committee (October 8, 2024), <[https://www.monitoringanalytics.com/reports/Presentations/2024/IMM\\_PC\\_CIR\\_Transfer\\_Efficiency\\_IMM\\_Package\\_20241008\\_v2.pdf](https://www.monitoringanalytics.com/reports/Presentations/2024/IMM_PC_CIR_Transfer_Efficiency_IMM_Package_20241008_v2.pdf)>.

<sup>94</sup> See OATT Parts IV & VI.

<sup>95</sup> See "PJM Manual 14B: PJM Regional Transmission Planning Process," Rev. 56 (June 27, 2024).

<sup>96</sup> See "PJM Manual 14G: Generation Interconnection Requests," Rev. 8 (July 26, 2023).

associated with that project are no longer required, unless it is required to support another queue project.

While not all projects in the queue require network upgrades, the number of planned network transmission upgrades is strongly correlated with the number of active projects in the queue. The number of planned network upgrades is also strongly correlated with the number of new generation projects requesting interconnection as a capacity resource. After the execution of an interconnection service agreement, queue projects become part of the RTEP study and the costs of any upgrade later necessary to preserve their Capacity Interconnection Rights are included as part of the overall transmission system costs paid by all transmission customers.

The system impact study is a detailed system analysis performed for new service requests that tests deliverability under peak load conditions and light load conditions. The system impact study identifies system constraints caused by the request and the local upgrades and network upgrades required to solve those constraints. The system impact study includes power flow analysis and short circuit analysis. The power flow analysis includes expected output level from the new resource under summer peak and light load system conditions.<sup>97</sup> PJM's recent improvements to the deliverability analyses reflect more accurate information about the expected performance of intermittent resources, by type of resource (solar fixed, solar tracking, onshore wind and offshore wind), by season (summer, winter and light load) and by region (PJM West, Mid-Atlantic and Dominion), under each of these system conditions. Those modifications are necessary to accurately reflect the expected output of intermittent resources under various seasons and system conditions as the penetration and role of intermittents in PJM increases.<sup>98</sup> For example, the expected output of onshore wind varies from its maximum facility output to zero, depending on weather conditions, and the expected output levels are used for each system load condition.<sup>99</sup>

#### Capacity resources receive Capacity Interconnection Rights (CIRs) based on the deliverable MW which result

<sup>97</sup> Winter peak load is included in the generation deliverability powerflow analysis during the RTEP baseline reliability analysis, but is not currently performed for new interconnection requests. The light load analysis ensures generation deliverability during light load conditions, which is defined as 50 percent of the annual peak demand.

<sup>98</sup> See "PJM Manual 14B: PJM Region Transmission Planning Process," Rev. 56 (June 27, 2024).

<sup>99</sup> See "Generation Deliverability Test Modifications: Light Load, Summer & Winter," presented at January 25, 2023 meeting of the Markets and Reliability Committee <<https://www.pjm.com/-/media/committees-groups/committees/mrc/2023/20230125/consent-agenda-c---1-generator-deliverability-test-revisions---presentation.aspx>>.

from a combination of upgrades paid for by each project and existing system capability. Intermittent resources also require CIRs. The level of CIRs required for intermittent resources has been significantly understated because the required CIRs have been based on the derated capacity value of intermittents rather than the maximum energy injections required to achieve the derated value.

After a lengthy stakeholder process, on April 7, 2023, FERC approved updates to PJM's ELCC method that cap the level of an intermittent generator's output used to calculate the generator's reliability contribution (ELCC derated MW) at the generator's CIR level.<sup>100</sup> Rules prior to the FERC order allowed generation at a level greater than the CIR value, and that was therefore not deliverable, to be inappropriately included in the ELCC calculations. For example, if a 100 MW solar resource has CIRs of 60 MW, generation in excess of 60 MW will not be included in the ELCC calculations under the updated rules. Prior to the update, the generation in excess of the CIR level was included, overstating the ELCC ratings and reliability contribution of ELCC resources. The overstatement of intermittent capacity has inefficiently suppressed capacity market clearing prices.<sup>101 102</sup> In order to retain the prior, incorrectly calculated ELCC values, existing intermittent generating units are required to increase their CIRs by going through an expedited queue process. The ELCC updates established a transitional period during which intermittent generators can be awarded temporary increases in their CIRs based on the availability of transmission system capability.<sup>103</sup> PJM expects a transitional period of four years, beginning with the 2025/2026 Base Residual Auction, to be sufficient time for intermittent resources to reenter the queue and be awarded additional CIRs. New intermittent generators will be required to pay for CIRs consistent with their calculated reliability contribution.

Figure 12-5 shows the latest estimated interconnection costs for new generators (network transmission project cost) by projected and actual in service year for generators that are in service (red line), and for the total of generators in service and still in the queue in active status (blue line). The estimated costs for in service projects (red line) are much lower than the estimated

<sup>100</sup> 183 FERC ¶61,009.


<sup>101</sup> See "Analysis of the 2023/2024 RPM Base Residual Auction," <[http://www.monitoringanalytics.com/reports/Reports/2022/IMM\\_Analysis\\_of\\_the\\_20232024\\_RPM\\_Base\\_Residual\\_Auction\\_20221028.pdf](http://www.monitoringanalytics.com/reports/Reports/2022/IMM_Analysis_of_the_20232024_RPM_Base_Residual_Auction_20221028.pdf)>. (October 28, 2022).

<sup>102</sup> See "Analysis of the 2022/2023 RPM Base Residual Auction—Revised," <[https://www.monitoringanalytics.com/reports/Reports/2023/IMM\\_Analysis\\_of\\_the\\_20222023\\_RPM\\_BRA\\_Revised\\_20230113.pdf](https://www.monitoringanalytics.com/reports/Reports/2023/IMM_Analysis_of_the_20222023_RPM_BRA_Revised_20230113.pdf)> (January 13, 2023).

<sup>103</sup> 183 FERC ¶61,009 at 31.

costs that also include all projects in the queue (blue line). The increase in estimated total network upgrade costs for planned projects is a result of the large number of requests in the new services queue and the existing backlog (Figure 12-5). However, as generators withdraw from the queue, the overall network costs decrease. The estimated network upgrade costs for in service projects are much lower. The projected in service dates for network projects are not updated regularly, and therefore, may not be an accurate predictor of when these projects are actually expected to go in service. Figure 12-5 shows a significant level of estimated interconnection costs for resources with projected in service dates as far back as 2008 and a peak for projects with a projected in service date of 2021. Even the costs for projects that are in service are only estimates because PJM does not track final project costs. The final in service costs include only the last estimate provided by PJM before the project went in service. PJM's data collection, management and retention related to transmission spending of all types is inadequate and needs a significant upgrade. The failure to collect data on estimated and final project costs makes it impossible to track transmission project costs for all project types. Given the significance of data to market participants and regulators, the MMU recommends that all queue data and supplemental, network and baseline project data, including projected in service dates and estimated and final costs, be regularly updated with accurate and verifiable data.

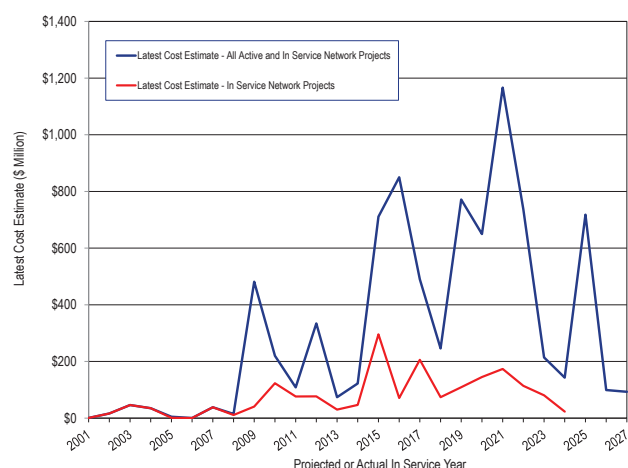**Figure 12-5 Cost estimates of network projects by projected and actual in service year: January 1, 2001 through December 31, 2027**



## Regional Transmission Expansion Plan (RTEP)<sup>104</sup>

The PJM RTEP process is designed to identify needed transmission system additions and improvements to continue to provide reliable service throughout the RTO. The objective of the RTEP process is to provide PJM with an optimal set of solutions necessary to solve reliability issues, operational performance issues and transmission constraints.

The RTEP process initially considered only factors such as load growth and the generation interconnection requests in its development of the 15 year plan. Currently, the RTEP process includes a broader range of inputs including the effects of public policy, market efficiency, interregional coordination and the effects of aging infrastructure.

### RTEP Process

The PJM RTEP process is a 24 month planning process that identifies reliability issues for the next 15 year period. This 24 month planning process includes a process to build power flow models that represent the expected future system topology, studies to identify issues, stakeholder input and PJM Board of Managers approvals. The 24 month planning process is made up of overlapping 18 month planning cycles to identify and develop shorter lead time transmission upgrades and one 24 month planning cycle to provide sufficient time for the identification and development of longer lead time transmission upgrades that may be required to satisfy planning criteria.

### Market Efficiency Process

PJM's Regional Transmission Expansion Plan (RTEP) process includes a market efficiency analysis. The stated purpose of the market efficiency analysis is to: determine which reliability based enhancements have economic benefit if accelerated; identify new transmission enhancements that result in economic benefits; and identify economic benefits associated with modification to existing RTEP reliability based enhancements that when modified would relieve one or more economic constraints. The PJM market efficiency analysis is badly flawed and results in concluding there are net benefits when there are not. PJM presents the RTEP market

<sup>104</sup> The material in this section is based in part on the PJM Manual 14B: PJM Region Transmission Planning Process. See PJM, "PJM Manual 14B: PJM Region Transmission Planning Process," Rev. 56 (June 27, 2024).



efficiency enhancements to the PJM Board, along with stakeholder input, for Board approval.

To be recommended to the PJM Board of Managers for approval, the relative benefits and costs of the economic based enhancement or expansion of the proposed project must reduce congestion on one or more constraints by at least one dollar, meet a ratio threshold of at least 1.25:1 and have an independent cost review, performed by PJM, if expected costs are over \$50 million. PJM provides the review of a project with a projected cost of over \$50 million using its own staff or outside consultants. PJM presents its findings to the TEAC where PJM's findings are reviewed by the stakeholders. While stakeholders can comment on the findings, PJM makes the final decision about what costs will be used for the purpose of calculating the benefit/cost ratio for the project. The benefit/cost ratio is the ratio of the present value of the total annual benefit for 15 years to the present value of the total annual cost for the first 15 years of the life of the enhancement or expansion.

The market efficiency process is comprised of a 12 month cycle and a 24 month cycle, both of which begin and end on the calendar year. The 12 month cycle is used for analysis of modifications and accelerations to approved RTEP projects only. The 24 month cycle is used for analysis of new economic transmission projects for years five through 15. This long-term proposal window takes place concurrently with the long-term proposal window for reliability projects.

PJM's first market efficiency analysis was performed in 2013, prior to Order 1000. The 2013 window was open from August 12, 2013, through September 26, 2013. This window accepted proposals to address historical congestion on 25 identified flowgates. PJM received 17 proposals from six entities. One project, submitted by an incumbent transmission owner, was approved by the PJM Board.

The first market efficiency cycle conducted under Order 1000 was performed during the 2014/2015 RTEP long term window. The 2014/2015 long term window was open from November 1, 2014, through February 28, 2015. This window accepted proposals to address historical congestion on 12 identified flowgates. PJM received 93 proposals from 19 entities. Thirteen projects, all submitted by an incumbent transmission owner, were approved by the PJM Board.

The second market efficiency cycle was performed during the 2016/2017 RTEP long term window. The 2016/2017 long term window was open from November 1, 2016, through February 28, 2017. This window accepted proposals to address historical congestion on four identified flowgates. PJM received 96 proposals from 20 entities. Four projects, all submitted by an incumbent transmission owner, were approved by the PJM Board.

PJM also held an addendum 2016/2017 long term window. This 2016/2017 1A long term window was open from September 14, 2017, through September 28, 2017. This window accepted proposals to address historical congestion on one identified flowgate. PJM received three proposals from two entities. One project, submitted by an incumbent transmission owner, was approved by the PJM Board.

The fourth market efficiency cycle was performed for the 2018/2019 RTEP long term window. The 2018/2019 long term window was open from November 2, 2018, through March 15, 2019. This window accepted proposals to address historical congestion on one internal and three interregional flowgates. PJM received 33 proposals from 10 entities. One project, submitted by an incumbent transmission owner, was approved by the PJM Board to address the historical congestion on the internal flowgate, and one project, submitted by an incumbent transmission owner, was approved by the PJM Board to address the historical congestion on one of the interregional flowgates.<sup>105</sup>

The fifth market efficiency cycle was performed for the 2020/2021 RTEP long term window. The 2020/2021 RTEP long term window was open from November 11, 2020, through May 11, 2021. This window accepted proposals to address historical congestion on four internal flowgates. PJM received 24 proposals from seven entities. Four projects, all submitted by an incumbent transmission owner, were approved by the PJM Board.

The sixth market efficiency cycle is currently being performed for the 2022/2023 RTEP long term window. The 2022/2023 RTEP long term window was delayed until the reliability violations for the 2022 Window 3 (Dominion data center loads) could be addressed. On November 21, 2023, PJM requested that the Commission

<sup>105</sup> No proposals effectively resolved the congestion on two of the three identified interregional market efficiency flowgates.

grant a waiver to extend the time for PJM to complete its annual review of the benefit/cost analysis associated with the market efficiency cycle.<sup>106</sup> PJM requested the waiver to remain in effect until PJM completes its 2023 annual review no later than the end of the second quarter of 2024. On December 21, 2023, The Commission approved the waiver request.<sup>107</sup> In January 2024, PJM completed updating the 2022/2023 market efficiency base case to include the solution selected from the 2022 Window 3. No flowgates experienced historical congestion that required an open window. PJM will continue to analyze the congestion patterns as part of the 2024/2025 market efficiency cycle.

In February 2024, PJM completed the 2024/2025 market efficiency base case. In May 2024, PJM posted the 2024/2025 Market Efficiency planning assumptions. PJM posted an updated 2024/2025 base case in July 2024, and requested stakeholder feedback by August 31, 2024. PJM is currently reviewing the feedback received from stakeholders. The long term market efficiency window is expected to open during the first quarter of 2025.

## The Benefit/Cost Evaluation

For an RTEP project to be recommended to the PJM Board of Managers for approval as a market efficiency project, the relative benefits and costs of the economic based enhancement or expansion must meet a benefit/cost ratio threshold of at least 1.25:1.

The total benefit of a project is calculated as the sum of the net present value of calculated energy market benefits and calculated reliability pricing model (RPM) benefits for a 15 year period, starting with the projected in service date of the project. Depending on the type of project being evaluated PJM may measure benefits as reductions in estimated load charges and production costs in the energy market and reductions in estimated load capacity payments and in system capacity costs in the capacity market, but does not weight increases and decreases in benefits equally. There are significant issues with PJM's definition of benefits. If done correctly and if FTRs/ARRs returned 100 percent of congestion to load, the benefit/cost analysis would include the total net change in production costs and would not include congestion. The change in production costs correctly

measures the changes in cost to load that result from a project.

The energy market benefit analysis uses an energy market simulation tool that produces an hourly least-cost, security constrained market solution, including total operational costs, hourly LMPs, bus specific injections and bus specific withdrawals for each modeled year with and without the proposed RTEP project. Using the output from the model, PJM calculates changes in energy production costs and load energy payments.

The definition of the energy benefit analysis depends on whether the project is regional or subregional. A regional project is any project rated at or above 230 kV. A subregional project is any project rated at less than 230 kv. For a regional project, the energy benefit for each modeled year is equal to 50 percent of the change in system wide total system energy production costs with and without the project plus 50 percent of the change in zonal load payments with and without the project but, inexplicably, only for those zones where the project reduces the load payments and ignoring zones where the project increases load payments. For subregional projects, the calculation of benefits for each modeled year ignores any impact on system wide energy production costs and is instead based only the change in zonal load energy payments with and without the project, but again only for those zones where the project reduces the load energy payments and ignoring zones where the project increases load payments.

In both the regional and subregional analysis, changes in zonal load energy payments subtract the estimated value of any Auction Revenue Rights (ARR) that sink in that zone. An increase in ARR revenues that result from a project would reduce the benefits of that project to load. If done correctly and if ARRs returned 100 percent of congestion to load, the changes in load payments would equal the change in production costs. However, the calculated ARR credits in the benefit/cost analysis ignore any increases in ARR MW and include only the reduction in the estimated CLMP differences. Estimated ARR credits are calculated for each simulated year using the most recent planning year's actual ARR MW combined with the simulation's CLMP differences between ARR source and sink points. ARR MW are not adjusted to reflect any increase in ARR MW created by the RTEP upgrade. This means that the reduction in

<sup>106</sup> See *PJM Interconnection, LLC*, Docket No. ER24-477-000 (November 21, 2023).

<sup>107</sup> 185 FERC ¶61,212.



the ARR offset value is too large, the reduction in load payments is overstated, and the value of the proposed project is artificially increased.

The Reliability Pricing Model (RPM) Benefit analysis uses the RPM solution software, with and without the proposed RTEP project, using a set of estimated capacity offers.

The definition of the benefit in the RPM benefit analysis depends on whether the project is regional or subregional. For a regional project, the RPM benefit for each modeled year is equal to 50 percent of the change in system wide total system capacity payments with and without the project plus 50 percent of the change in zonal capacity payments with and without the project, including only those zones where the project reduced the capacity payments. For subregional projects, the reliability pricing model benefits for each modeled year ignores any impact on system wide total capacity payments and is equal to the change in zonal capacity payments with and without the project, including only those zones where the project reduced the capacity payments.

The difference in the benefits calculation used in the regional and subregional benefit/cost threshold tests is related to how the direct costs of the transmission projects are allocated for approved regional and subregional projects. The costs of an approved regional project are allocated so that 50 percent of the total costs are allocated on a system wide load ratio share basis and the remaining 50 percent of the total costs are allocated to zones with projected energy market benefits and reliability pricing model benefits in proportion to those projected positive benefits. The costs of an approved subregional project are allocated so that the total costs of the project is allocated to zones with projected energy market benefits and reliability pricing model benefits in proportion to those projected positive benefits. The allocation will be incorrect to the extent that the benefits calculations are incorrect.

There are significant issues with PJM's benefit/cost analysis. The current rules governing benefit/cost analysis of competing transmission projects do not correctly measure the relative costs and benefits of transmission projects. PJM measures benefits as reductions in estimated load charges and production costs in the energy market and reductions in estimated

load capacity payments in the capacity market, but PJM's analysis ignores any increases in costs. This means that PJM's benefit/cost analysis systematically overstates the benefits of transmission projects. ARR MW allocations are not adjusted to reflect any potential changes in ARR MW that result from the RTEP upgrade. This means that the reduction in the ARR offset value is too large, the ARR offset is too small, and the result is to artificially increase the value of the proposed project. The correct metric is the change in production costs. In addition, the current rules do not account for the fact that the benefits of projects are uncertain and highly sensitive to the modeling assumptions used, or for the fact that the project costs are nonbinding estimates, are not subject to cost caps and may significantly exceed the estimated costs. These flaws have contributed to PJM approving market efficiency projects with forecasted benefits that only appear to, but do not actually exceed the forecasted costs. In addition, there is no after the fact analysis to validate the planning assumptions and there is no data gathered on the actual costs and benefits that would permit such an analysis.

The recent introduction of storage as transmission assets (SATA) raises a number of additional concerns about PJM's benefit/cost analysis. PJM's benefit/cost analysis uses a 15 year forecast for purposes of evaluating benefits and costs of traditional transmission assets with an expected useful life of 50 years or more. Using the same 15 year horizon does not make sense for SATA resources with an expected useful life of 10 years or less, depending on use. Using a 15 year benefit horizon exaggerates the forecasted benefit stream relative to the stream of benefits that could be produced over the expected useful life relative to traditional transmission assets. Further, the rules for how to account for the actual, and forecasted, revenues and charges for operating the SATA to provide transmission load relief have not been established. Without clear rules on how to allocate operational revenues and costs it is impossible to develop forecasted benefits and/or costs of a SATA project.

The broader issue is that the market efficiency project approach explicitly allows transmission projects to compete against future generation projects, but without allowing the generation projects to compete. Projecting speculative transmission related benefits for 15 years based on the existing generation fleet and existing

patterns of congestion eliminates the potential for new generation to respond to market signals. The market efficiency process allows assets built under the cost of service regulatory paradigm to displace generation assets built under the competitive market paradigm. The MMU recommends that the market efficiency process be eliminated.

## The Transource Project

The Transource Project (Project 9A) is an example of a PJM approved market efficiency project that initially passed PJM's 1.25 benefit/cost threshold test despite having benefits, if correctly calculated, that were less than forecasted costs. This project also illustrates the risks of ignoring potential cost increases given that the costs included in the benefit/cost calculation are nonbinding estimates. The Transource Project was proposed in PJM's 2014/2015 RTEP long term window. PJM's 2014/2015 RTEP long term window was the first market efficiency cycle under Order 1000. The 2014/2015 long term window was open from November 1, 2014, through February 28, 2015. This window accepted proposals to address what PJM terms historical unhedgeable congestion on 12 identified flowgates, where unhedgeable congestion is actually the production costs. The AP South Interface was one of the 12 identified flow gates listed in the 2014/2015 RTEP Long Term Proposal Window Problem Statement.

The initial study had a benefit/cost ratio of 2.48, with a capital cost of \$340.6 million. The sum of the positive (energy cost reductions) effects was \$1,188.07 million. The sum of negative effects (energy cost increases) was \$851.67 million. The net actual benefit of the project in the study was therefore \$336.40 million, not the \$1,188.07 used in the study. Using the total benefits (positive and negative) to compare to the net present value of costs, the benefit/cost ratio was 0.70, not 2.48. The project should have been rejected on those grounds.

Subsequent PJM studies of the 9A project have reduced its benefit/cost ratio as a result of increased costs, decreased congestion on the AP South Interface since 2014 and a reduction in peak load forecasts since 2015.

A portion of Project 9A in Pennsylvania was challenged in a proceeding at the Pennsylvania PUC. On May 20, 2021, the Pennsylvania PUC denied the Transource application to build in Pennsylvania based on failure to demonstrate need combined with negative economic

and environmental effects.<sup>108</sup> Transource appealed the decision at the state and federal level.<sup>109</sup> On May 5, 2022, the state court denied the appeal. On December 6, 2023, the U.S. District Court for the Middle District of Pennsylvania granted the appeal, stating that the Pennsylvania PUC's decision violated the Supremacy Clause and the Dormant Commerce Clause.<sup>110</sup> The federal court found that the PUC's order was not a valid use of the PUC's siting oversight authority. The Pennsylvania PUC filed a notice of appeal with the U.S. Court of Appeals for the Third Circuit on January 10, 2024.<sup>111</sup>

On September 22, 2021, the PJM Board endorsed PJM's recommendation to suspend the Transource IEC (9A) Project, based on the rejection by the Pennsylvania PUC. Project 9A was removed from PJM's planning models pending future updates.<sup>112</sup> At the time of the suspension, \$131.9 million in material, engineering, land rights and project support costs had been incurred by developers, but there was no increase in transmission capability associated with the project.<sup>113</sup>

While suspended, PJM has stated that it is required by Schedule 6 of the Operating Agreement (OA) to "annually review the cost and benefits" of Board approved market efficiency projects that have not commenced construction or have not received state siting approval.

PJM's 2023 reevaluation of 9A showed a B/C ratio of 0.81 with an in service cost of \$420.9 million.<sup>114</sup> <sup>115</sup> In addition, PJM's 2023 reevaluation of 9A showed that Project 9A, given other projects approved after the Project 9A suspension would, if completed, cause uncontrollable overloads on a number of constraints in the PJM modeling analysis starting in 2030.<sup>116</sup> The

<sup>108</sup> See *Applications of Transource Pennsylvania, LLC for approval of the Siting and Construction of the 230 kV Transmission Line Associated with the Independence Energy Connection-East and West Projects in portions of York and Franklin Counties, Pennsylvania et al., Pennsylvania Public Utility Commission, Opinion and Order, Docket No. A-2017-2640195 et al.* (May 20, 2021).

<sup>109</sup> See *Transource Pennsylvania, LLC et al. v. Pennsylvania Public Utility Commission*, Docket No. 689 CD 2021 (Commonwealth of Pennsylvania Court); *Transource Pennsylvania LLC v. Gladys Brown Dutrieuille, et al.*, Docket No. 21-2567 (USDC M.D. Pa.).

<sup>110</sup> See *Transource Pennsylvania, LLC et al. v. Steven M. Defrank, et al.*, Case No. 1:21-CV-01101 (M.D. Pa. December 6, 2023).

<sup>111</sup> See *Transource Pa, LLC v. Dutrieuille*, Case No. 21-2567.

<sup>112</sup> Nick Dumitriu, Principal Engineer, PJM Market Simulation, Market Efficiency Update presented to the Transmission Expansion Advisory Committee (November 30, 2021) at 18 <<https://www.pjm.com/-/media/committees-groups/committees/teac/2021/20211130/20211130-item-02-market-efficiency-update.ashx>>.

<sup>113</sup> Nick Dumitriu, Principal Engineer, PJM Market Simulation, Market Efficiency Update presented to the Transmission Expansion Advisory Committee (November 30, 2021) at 19 <<https://www.pjm.com/-/media/committees-groups/committees/teac/2021/20211130/20211130-item-02-market-efficiency-update.ashx>>.

<sup>114</sup> Nick Dumitriu, Manager, Market Simulation, Market Efficiency Update presented to the Transmission Expansion Advisory Committee (June 4, 2024) at 21 <<https://www.pjm.com/-/media/committees-groups/committees/teac/2024/20240604/20240604-item-04---market-efficiency-update.ashx>>.

<sup>115</sup> On December 21, 2023, FERC issued an order granting a waiver for delaying the 2023 reevaluation and directed that the analysis be completed by June 30, 2024. PJM presented the results of its 2023 reevaluation on June 4, 2024.

<sup>116</sup> Nick Dumitriu, Manager, Market Simulation, Market Efficiency Update presented to the Transmission Expansion Advisory Committee (June 4, 2024) at 22-23 <<https://www.pjm.com/-/media/committees-groups/committees/teac/2024/20240604/20240604-item-04---market-efficiency-update.ashx>>.

sum of the positive (energy cost reductions) effects was \$371.0 million, a reduction of \$818.5 million (-68.8 percent) from the initial study. The sum of negative effects (energy cost increases) was \$2,988.1 million, an increase of \$2,136.4 million (250.8 percent) in the negative effects from the -\$851.7 results of the initial study. The net benefit of the project in the 2023 study was -\$2,517.2 million, not the \$1,188.1 from the initial study. Using the total benefits (positive and negative) to compare to the net present value of costs in the 2023 analysis, the benefit/cost ratio was -5.71, not 0.81.

On November 26, 2024, PJM filed a request at FERC for a waiver of the timing requirement associated with the Annual Reevaluation Analysis to permit PJM time to update its market efficiency model to include the Board-approved 2024 RTEP Window #1 projects.<sup>117</sup> PJM requested the waiver because the 9A project made the evaluation model infeasible.<sup>118</sup> PJM wanted time to include RTEP projects that it expected to be approved in the first quarter of 2025 in the model. The MMU challenged the need for a reevaluation due to project 9A's repeated failures to meet the benefit/cost ratio requirement for project approval.<sup>119</sup> FERC did not respond to the request for a waiver prior to December 31, 2024. As a result PJM withdrew its request for a waiver and reused its 2023 models to run its 2024 reevaluation of project 9A.

PJM's 2024 reevaluation of 9A used its 2023 market model and, as a result, showed the same result as the 2023 reevaluation. PJM's 2024 reevaluation of 9A showed a Benefit/Cost ratio of 0.81 with an in service cost of \$420.9 million.<sup>120</sup> PJM's 2024 reevaluation of 9A showed that Project 9A, given other projects approved after the Project 9A suspension would, if completed, cause uncontrollable overloads on a number of constraints in the PJM modeling analysis starting in 2030.<sup>121</sup> The sum of the positive (energy cost reductions) effects was \$371.0 million, a reduction of \$818.5 million (-68.8 percent) from the initial study. The sum of negative effects (energy cost increases) was \$2,988.1

million, an increase of \$2,136.4 million (250.8 percent) in the negative effects from the -\$851.7 results of the initial study. The net benefit of the project in the 2024 study was -\$2,517.2 million, not the \$1,188.07 from the initial study. Using the total benefits (positive and negative) to compare to the net present value of costs in the 2024 analysis, the benefit/cost ratio was -5.71, not 0.81.

The MMU does not agree that PJM is required by Schedule 6 to annually reevaluate a market efficiency project that, prior to construction commencing or prior to state approval, fails to meet the PJM benefit/cost criteria (OA Schedule 6 § 1.5.7(f)).

PJM has stated changes in system conditions, such as changes in load forecasts, justify continued reevaluation of market efficiency transmission projects prior to construction commencing or prior to state approval, regardless of the results on the benefit/cost reevaluation in prior years.<sup>122</sup> However, the purpose of the annual benefit/cost analysis of an economic project (OA Schedule 6 § 1.5.7(f)) is to "[t]o assure that new Economic-based Enhancements or Expansions included in the Regional Transmission Expansion Plan continue to be cost beneficial, the Office of the Interconnection annually shall review the costs and benefits of constructing such enhancements and expansions." Consideration of changes in system conditions, such as changes in load forecasts, are not a separate criterion in this process but part of the reevaluation of benefit/cost that is required to assure that the new Economic-based Enhancements or Expansions included in the Regional Transmission Expansion Plan continue to be cost beneficial. Absent assurance of continued benefit via the annual analysis (the benefit/cost ratio falls below the 1.25 benefit threshold), the project should be removed from the RTEP.

PJM is currently planning an updated re-evaluation of 9A in 2025 that includes RTEP projects that are approved in 2025. The project should be rejected rather than simply suspended.

<sup>117</sup> PJM Waiver Request, November 26, 2024, Docket No. ER25-612-000.

<sup>118</sup> Market Simulation, Market Efficiency Update (December 31, 2024) <<https://www.pjm.com/-/media/DotCom/committees-groups/committees/teac/2025/20250107/20250107-item-04a---market-efficiency-update---annual-re-evaluation.pdf>>.

<sup>119</sup> Protest of the Independent Market Monitor for PJM, December 10, 2024, Docket No. ER25-612-000.

<sup>120</sup> Nick Dumitriu, Manager, Market Simulation, Market Efficiency Update presented to the Transmission Expansion Advisory Committee (December 31, 2024) at 21 <<https://www.pjm.com/-/media/DotCom/committees-groups/committees/teac/2025/20250107/20250107-item-04a---market-efficiency-update---annual-re-evaluation.pdf>>.

<sup>121</sup> Nick Dumitriu, Manager, Market Simulation, Market Efficiency Update presented to the Transmission Expansion Advisory Committee (June 4, 2024) at 22-23 <<https://www.pjm.com/-/media/committees-groups/committees/teac/2024/20240604/20240604-item-04---market-efficiency-update.ashx>>.

<sup>122</sup> Market Simulation, Market Efficiency Update (December 31, 2024) <<https://www.pjm.com/-/media/DotCom/committees-groups/committees/teac/2025/20250107/20250107-item-04a---market-efficiency-update---annual-re-evaluation.pdf>>.

## PJM MISO Interregional Market Efficiency Process (IMEP)

PJM and MISO developed a process to facilitate the construction of interregional projects in response to the Commission's concerns about interregional coordination along the PJM-MISO seam. This process, called the Interregional Market Efficiency Process (IMEP), operates on a two year study schedule and is designed to address forward looking congestion. To qualify as an IMEP project, the project must be evaluated in a joint study process, qualify as an economic transmission enhancement in both PJM and MISO transmission expansion models and meet specific IMEP cost benefit criteria.<sup>123</sup> The allocation of costs to each RTO for IMEPs will be in proportion to the benefits received.

While the IMEP process is a joint effort, PJM and MISO perform their own analysis of benefits to their own system and each uses a different modeling approach and a different metric for determining the benefits of a proposed project. PJM uses the benefit/cost analysis used for its own internal market efficiency projects which will, by definition, overstate project benefits by ignoring areas where energy costs are increased. MISO, on the other hand, measures benefits as changes in projected system wide production cost caused by the project. The use of different approaches to measuring benefits is an issue when studying potential benefits of projects in a joint effort, and when using the defined benefits to allocate the costs of IMEP projects to each RTO. PJM's approach will over allocate the costs of IMEP projects to PJM members and under allocate costs to MISO members.

No interregional constraints were identified in either PJM's or MISO's regional processes. Therefore, an IMEP study was not required during the 2020/2021 IMEP cycle. No interregional constraints were identified in either PJM or MISO's regional processes. Therefore, an IMEP study was not required during the 2022/2023 IMEP cycle.

PJM and MISO are currently coordinating on interregional congestion issues to identify potential constraints to address in the 2024/2025 IMEP cycle.

<sup>123</sup> See "Joint Operating Agreement Between the Midwest Independent Transmission System Operator, Inc. and PJM Interconnection, LLC," (December 11, 2008) <<http://www.pjm.com/directory/merged-tariffs/miso-joa.pdf>>.

## PJM MISO Targeted Market Efficiency Process (TMEP)

PJM and MISO developed the Targeted Market Efficiency Process (TMEP) to facilitate the resolution of historic congestion issues that could be addressed through small, quick implementation projects. The TMEP process operates on a 12 month study schedule. To qualify as a TMEP project, the project must have an estimated in service date by the third summer peak season from the year the project was approved, have an estimated cost of less than \$20 million and must have estimated benefits, based on the projected congestion reduction over a four year period that exceed the expected installed capacity cost of the proposed project.<sup>124</sup> <sup>125</sup> The TMEP process calculates congestion and assigns congestion costs to load but fails to account for the offsetting value of ARRs and FTRs. The current rules incorrectly count congestion as a cost to load without accounting for how the congestion dollars are or are not returned to the load through ARRs and FTRs. The correct benefit metric is the change in production costs.

The benefit of a proposed TMEP project is calculated as the value of reducing congestion on the affected constraint over a four year period. PJM and MISO calculate the estimated value of eliminating congestion by calculating the average congestion for the two prior years prior and multiplying by four. Congestion is correctly calculated as the shadow price (difference in CLMP) times the market flow on the line.

The allocation of costs to each RTO for an approved TMEP project will be in proportion to the benefits, as calculated by PJM and MISO, received by that RTO.<sup>126</sup> The proportion of benefits is calculated using the change in the average shadow price of the constraint times the dfax to the affected downstream buses times the MW of load at the buses. This correctly identifies the proportion of the benefits that go to the load that would benefit from the project. Within an RTO, the RTO's share of the cost of the approved project is allocated to each transmission control area in proportion to the benefits received by each transmission control area.

<sup>124</sup> See "Joint Operating Agreement Between the Midwest Independent Transmission System Operator, Inc. and PJM Interconnection, LLC," (December 11, 2008) <<http://www.pjm.com/directory/merged-tariffs/miso-joa.pdf>>.

<sup>125</sup> On November 2, 2017, PJM submitted a compliance filing including additional revisions to the MISO-PJM JOA to include stakeholder feedback in the TMEP project selection process. See *PJM Interconnection, LLC*, Docket No. ER17-718-000, et al. (November 2, 2017).

<sup>126</sup> See *PJM Interconnection, LLC*, Docket No. ER17-729-000 (December 30, 2016).



PJM and MISO did not conduct a TMEP study in 2019. As a result of decreases in M2M congestion and the addition of transmission upgrades already in process that affect the top congested historical M2M flowgates, PJM and MISO did not conduct a TMEP study in 2020. PJM and MISO agreed to assess the impact of planned upgrades and congestion using an additional year of market data. As a result, PJM and MISO did not conduct a TMEP study in 2021. The 2022 TMEP study focused on 23 flowgates as potential TMEP projects. Of the 23 initial flowgates, 19 were eliminated due to their relationship with other existing reliability projects already included in PJM's RTEP or MISO's MTEP plans, or the identified congestion was caused by outages.<sup>127</sup> Two projects were eliminated after studies showed that congestion was not persistent in October 2022, and an additional project was eliminated in December 2022 after further studies showed congestion was not persistent, leaving one TMEP project (Powerton - Towerline 138 kV) that was approved for implementation by the PJM Board on February 15, 2023, and by the MISO Board on March 23, 2023.<sup>128 129 130</sup> For both 2023 and 2024, the RTOs decided not to initiate a Coordinated System Plan (CSP) study, and to continue to assess the impact of planned upgrades and congestion persistence with additional market data.

The PJM and MISO TMEP process for measuring the projected benefits of a TMEP transmission projects is flawed. The current rules incorrectly count congestion as a cost to load without accounting for how the congestion dollars are or are not returned to the load through ARRs and FTRs. The benefit of a TMEP transmission upgrade should be the expected difference in the total production cost of energy before and after the upgrade to all affected load. This measurement would include the change in expected LMP of all affected load before and after the upgrade, times the MW of load, plus the change in congestion dollars returned to the affected load before and after the upgrade. Congestion revenue returned to load is not a cost to the load, it is a credit against the overpayment of load payments compared to generation

credits caused by the transmission constraint. Ignoring the return of congestion from ARRs/FTRs overstates the potential benefits of eliminating congestion through the TMEP upgrades, and ignores the value of smaller upgrades that may not eliminate a constraint, but may reduce the average cost of energy for load.

## Multi Driver Process

On September 12, 2014, PJM filed revisions to the tariff to include provisions allowing PJM to include multi driver projects in its regional transmission expansion plan.<sup>131</sup> When a transmission project addresses a combination of reliability, market efficiency and/or public policy objectives, it is termed a multi driver project. PJM may choose a solution using either the proportional multi driver method or the incremental multi driver method. The proportional method combines separate solutions that address reliability, economics and/or public policy into a single transmission enhancement or expansion project. The incremental method expands a proposed single driver solution to include one or more additional component(s) to address a combination of reliability, economic and/or public policy drivers.<sup>132</sup> On February 20, 2015, the Commission approved the tariff revisions with an effective date of November 12, 2014.<sup>133</sup>

On June 7, 2022, PJM opened its first multi driver proposal window. The window seeks to address reliability and market efficiency needs on three identified facilities. PJM accepted proposed solutions until August 8, 2022. PJM received 14 proposals from three entities. After conducting a cost review, a reliability analysis and a market efficiency analysis on the 14 proposals and a combination of the proposals, PJM proposed a combination of two proposals made by two companies (Project 644 + 908) as its preferred solution. The preferred solution has an estimated capital cost of \$82.30 million with a PJM determined expected benefit/cost ratio of 1.99.<sup>134</sup> PJM shared its recommendation with MISO for their evaluation. MISO did not indicate any concern with the proposed solution. On February 7, 2023, the PJM Board approved the recommended solution (Project 644 + 908).

<sup>127</sup> See "Interregional Planning Update," presented at the August 9, 2022 meeting of the Transmission Expansion Advisory Committee. <<https://www.pjm.com/-/media/committees-groups/committees/teac/2022/20220809/item-01---interregional-planning-update.ashx>>.

<sup>128</sup> See "Interregional Planning Update," presented at the October 4, 2022 meeting of the Transmission Expansion Advisory Committee. <<https://www.pjm.com/-/media/committees-groups/committees/teac/2022/20221004/item-01---interregional-planning-update.ashx>>.

<sup>129</sup> See "PJM-MISO IPSAC," presented at the December 15, 2022 meeting of the PJM-MISO Interregional Planning Stakeholder Advisory Committee <<https://www.pjm.com/-/media/committees-groups/stakeholder-meetings/ipsac/2022/20221215/ipsac-presentation.ashx>>.

<sup>130</sup> See "PJM-MISO IPSAC," presented at the December 11, 2023 meeting of the PJM-MISO Interregional Planning Stakeholder Advisory Committee <<https://www.pjm.com/-/media/committees-groups/stakeholder-meetings/ipsac/2024/20240325/20240325-miso-seam-identified-issues-and-solutions-ashx>>.

<sup>131</sup> See PJM. Docket No. ER14-2864 (September 12, 2014).

<sup>132</sup> See "PJM Manual 14B: PJM Region Transmission Planning Process," Rev. 56 (June 27, 2024).

<sup>133</sup> 150 FERC ¶ 61,117 (February 20, 2015).

<sup>134</sup> See "2022 RTEP Multi-Driver Proposal Window No. 1," presented at the December 6, 2022 meeting of the Transmission Expansion Advisory Committee <<https://www.pjm.com/-/media/committees-groups/committees/teac/2022/20221206/item-07---multi-driver-proposal-window-update.ashx>>.

The benefit/cost analysis used in the multi driver review is the same flawed benefit/cost analysis that PJM uses for evaluating Market Efficiency projects. PJM's assumed benefit of the combined project was calculated as the sum of the present value of positive (energy cost reductions to some loads) effects of \$169.8 million. The sum of the present value of negative effects (energy cost increases to other loads), which was ignored in the PJM calculation of benefits, was \$149.1 million. The total benefit of the proposed multi driver project is therefore only \$20.7 million, not the \$169.8 asserted by PJM, even ignoring the use of changes in congestion rather than changes in production costs. Using the total positive and negative effects to compare to the net present value of costs in the PJM's analysis, the benefit/cost ratio is 0.24, not 1.99. All \$149.1 million of the increases in energy costs (negative benefits) would be paid by load in the ComEd Zone. Based on the requirement of benefit/cost ratio of 1.25, the energy efficiency portion of the multi driver project should have been rejected.

## PJM MISO Interregional Transfer Capability Study (ITCS)

PJM and MISO are performing an Interregional Transfer Capability Study (ITCS).<sup>135</sup> PJM and MISO are coordinating assumptions and models, but will not perform a joint study. The PJM/MISO Interregional Transfer Capability Study is part of PJM's and MISO's strategy to comply with FERC Order No. 1920. The ITCS study appears to mirror PJM's multi driver RTEP process in that it identifies several drivers (efficiency, reliability, transfer needs) for evaluating the value or need for a project, though neither MISO or PJM provide any specificity as to the exact metrics for the evaluation of the benefits or costs within each identified driver, how the drivers will be weighted or how costs of potential projects should be allocated. This stated purpose of the PJM/MISO Interregional Transfer Capability Study is to allow PJM and MISO to consider needs, assumptions, cost allocations and analysis outside the prescriptions of the existing PJM/MIO JOA/CSP process. The goal of the PJM and MISO ITCS is to identify opportunities to enhance transfer capability on an incremental basis over and above other JOA/CSP based studies.

The ITCS study is intended to look out through 2032. In its ITCS study, PJM plans to use a model that blends

<sup>135</sup> See PJM and MISO Interregional Capability Study (ICTS) FAQ <<https://www.pjm.com/-/media/DotCom/planning/interregional-planning/pjm-and-miso-interregional-transfer-capability-study-faq.pdf>>.

MISO planning models for MISO's footprint and a set of PJM's long-term planning assumptions for PJM's footprint. PJM is calling this a blended model. PJM's blended model will use the 2023 Regional Transmission Expansion Plan (RTEP) topology with 2022 RTEP Window 3 solutions, the PJM 2024 official Load Forecast, retirements due to federal regulations and states' laws based on the Independent State Agencies Committee (ISAC) workbook and the assumption of sufficient replacement generation or storage for resource adequacy (i.e. to meet 1-in-10 Loss of Load Expectation) selected from interconnection requests and withdrawals.

PJM and MISO plan to present the results of the ITCS study in the first half of 2025.

## New Jersey State Agreement Approach for Offshore Wind

In 2021, the New Jersey Board of Public Utilities (NJ BPU) initiated a proposal window under the provisions of the PJM Operating Agreement's State Agreement Approach (SAA) to meet New Jersey's goal of interconnecting up to 7,500 MW of offshore wind.<sup>136</sup> PJM received 80 proposals covering solutions that addressed onshore and offshore reliability criteria and transmission connections. PJM worked with the NJ BPU to analyze the proposals. The NJ BPU selected a proposal to interconnect 3,742 MW of offshore wind to central New Jersey. The total estimated cost for the project is \$1.1 billion, with various required in service dates ranging from December 2027 through June 2030. The costs for the NJ BPU offshore wind project will be recovered from customers in the state of New Jersey. On December 6, 2022, the PJM Board approved the BPU's proposal.

On September 22, 2023, Public Service Electric and Gas Company filed an application for an abandoned plant incentive.<sup>137</sup> The filing seeks "authorization for the ability to recover 100 percent of prudently incurred costs for certain transmission upgrades that PSE&G will construct in the event that the [offshore wind] transmission upgrades are abandoned or cancelled (in whole or in part) for reasons that are outside of PSE&G's control."

On October 31, 2023, Danish wind power developer Ørsted announced that it was canceling two major offshore wind projects, Ocean Wind 1 (1,100 MW) and

<sup>136</sup> See PJM Operating Agreement, Schedule 6, Section 1.5.9

<sup>137</sup> See *Public Service Electric and Gas Company*, Docket No. ER23-2916 (September 22, 2023).



Ocean Wind 2 (1,148 MW), that were planned off the coast of New Jersey. Ørsted is taking a \$2.9 billion impairment attributed to Ocean Wind 1.<sup>138</sup>

## Long Term Regional Transmission Planning

On May 13, 2024, the Commission issued Order No. 1920 which requires public utility transmission providers to engage in long-term regional transmission planning over a 20-year planning horizon, develop long-term scenarios to identify long-term transmission needs and enable the identification and evaluation of transmission facilities to meet those transmission needs. Order No. 1920 also requires transmission providers to determine a cost allocation method for long-term regional transmission facilities, make other reforms to enhance transparency in local transmission planning, to correctly size transmission projects and include interregional transmission coordination to support the development of cost-effective projects.<sup>139</sup>

On November 21, 2024, the Commission issued Order No. 1920-A.<sup>140</sup> Order No. 1920-A significantly expanded the role of States in the long-term regional transmission planning. Order No. 1920-A requires states' input into regional transmission planning and cost allocation processes, both in the transmission providers' development of Order No. 1920 compliance filings and the ongoing implementation of these reforms in the future. Order No. 1920-A also increases the states' role in: (i) developing long term scenarios; (ii) requesting additional scenarios beyond the three Long-Term Scenarios required by Order No. 1920; (iii) developing the evaluation processes and criteria for selecting new transmission facilities in the long-term regional transmission; (iv) developing cost allocation approaches for selected transmission facilities; and (v) voluntary funding opportunities.

PJM requested that the Commission extend PJM's deadline to comply with Order No. 1920's compliance directives by six months, (to December 12, 2025), while leaving the implementation deadline of two years after the initial due date of the compliance filing (June 12, 2027) unchanged. The extension was requested to

accommodate the States' broader role required by Order No. 1920-A in developing Order No. 1920-compliant Long-Term Regional Transmission Planning protocols.<sup>141</sup>

## Supplemental Transmission Projects

Supplemental projects are asserted to be "transmission expansions or enhancements that are not required for compliance with PJM criteria and are not state public policy projects according to the PJM Operating Agreement. These projects are used as inputs to RTEP models, but are not required for reliability, economic efficiency or operational performance criteria, as determined by PJM."<sup>142</sup> Attachment M-3 of the PJM OATT defines the process that Transmission Owners (TO) must follow in adding Supplemental Projects in their local plan.

The M-3 Process requires TOs to present the criteria, assumptions and models that they will use to plan and identify Supplemental Projects on a yearly basis. The criteria identified for Supplemental Projects are very broad and include: equipment material condition, performance and risk, operational flexibility and efficiency, infrastructure resilience, customer service or other, as well as asset management.

While the identification of the criteria violations and solutions are reviewed, and stakeholders have the opportunity to comment, the solution that is submitted in the Local Plan is the Transmission Owner's decision. PJM conducts a do no harm analysis to ensure the Supplemental Projects do not negatively affect the reliability of the system. Supplemental Projects are ultimately included in PJM's Regional Transmission Expansion Plan and are allocated 100 percent to the zone in which the transmission facilities are located. Supplemental Projects may displace projects that would have otherwise been implemented through the RTEP process.

Supplemental projects are currently exempt from the Order No. 1000 competitive process.<sup>143</sup> Transmission owners have a clear incentive to increase investments in rate base given that transmission owners are paid for these projects on a cost of service basis.

<sup>138</sup> Ørsted, Ørsted ceases development of its US offshore wind projects Ocean Wind 1 and 2, takes final investment decision on Revolution Wind, and recognizes DKK 28.4 billion impairments (October 31, 2023) <<https://orsted.com/en/company-announcement-list/2023/10/orsted-ceases-development-of-its-us-offshore-wind-73751>>.

<sup>139</sup> See *Building for the Future Through Electric Regional Transmission Planning and Cost Allocation*, Order No. 1920, 187 FERC ¶ 61,068 (2022).

<sup>140</sup> See *Order on rehearing and clarification*, Order No. 1920-A, 189 FERC ¶ 61,126 (2024).

<sup>141</sup> See PJM Interconnection, LLC., Docket No. RM21-17-000 (December 20, 2024).

<sup>142</sup> See PJM. Planning. "Transmission Construction Status," (Accessed on December 31, 2024) <<https://www.pjm.com/planning/project-construction>>.

<sup>143</sup> FERC accepted tariff provisions that exclude supplemental projects from competition in the RTEP. 162 FERC ¶ 61,129 (2018), *reh'g denied*, 164 FERC ¶ 61,217 (2018).

Figure 12-6 shows the latest cost estimate of all baseline and supplemental projects by expected in service year. Baseline projects are RTEP projects needed for reliability. FERC Order No. 890 was issued on February 16, 2007, and implemented in PJM starting in 2008. Order No. 890 required Transmission Providers to participate in a coordinated, open and transparent planning process. Prior to the implementation of Order No. 890, there were transmission projects planned by transmission owners and included in the PJM planning models that were not included in the totals shown in Figure 12-6, Table 12-60 and Table 12-61 because PJM did not track or report such projects. There has been a significant increase in supplemental projects coincident with the implementation of Order No. 890 starting in 2008 and the competitive planning process introduced by FERC Order No. 1000 starting in 2011.

PJM's data collection, management and retention related to transmission spending of all types is inadequate and needs a significant upgrade. The failure to collect data on estimated and final project costs makes it impossible to track transmission project costs for all project types. Given the significance of data to market participants and regulators, the MMU recommends that all queue data and supplemental, network and baseline project data, including projected in service dates and estimated and final costs, be regularly updated with accurate and verifiable data.

**Figure 12-6 Cost estimate of baseline and supplemental projects by expected in service year: January 1, 1998 through December 31, 2024**

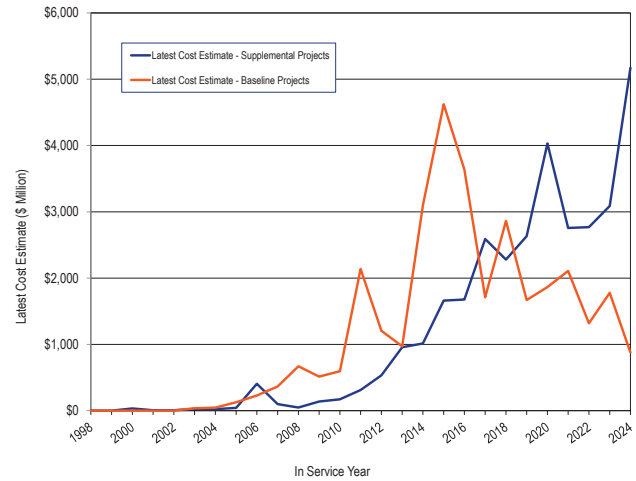


Table 12-60 shows the number of supplemental projects by expected in service year for each transmission zone. The average number of supplemental projects in each expected in service year increased by 1,025.0 percent, from 20 for years 1998 through 2007 (pre Order No. 890) to 225 for years 2008 through 2024 (post Order No. 890). As of December 31, 2024, there are 2,235 supplemental projects with expected in service dates between January 1, 2024 and December 31, 2028.

**Table 12-60 Number of supplemental projects by expected in service year and zone: 1998 through 2040**

Year	ACEC	AEP	AMPT	APS	ATSI	BGE	COMED	DAY	DUKE	DUQ	DOM	DPL	EKPC	JCPLC	MEC	NEET	OVEC	PECO	PE	PEPCO	PPL	PSEG	REC	Total
1998	0	0	0	0	0	0	0	0	0	0	0	3	0	0	0	0	0	0	0	0	0	0	0	3
1999	0	0	0	0	0	0	0	0	0	0	0	2	0	0	1	0	0	0	0	0	0	0	0	3
2000	0	0	0	0	0	0	0	0	0	0	0	11	0	0	0	0	0	0	0	0	0	0	0	11
2001	0	0	0	0	0	0	0	0	0	0	0	14	0	0	0	0	0	0	0	0	0	0	0	14
2002	0	0	0	0	0	0	0	0	0	0	0	10	0	0	0	0	0	0	0	0	0	0	0	10
2003	3	0	0	0	0	0	0	0	0	0	0	10	0	0	0	0	0	0	2	0	0	0	0	15
2004	5	0	0	10	0	0	9	0	0	0	0	12	0	2	0	0	0	0	0	0	0	2	0	40
2005	4	2	0	8	0	0	4	0	0	0	1	14	0	1	0	0	0	1	2	0	0	2	0	39
2006	4	2	0	5	0	0	6	0	0	0	0	9	0	1	0	0	0	0	1	0	2	1	0	31
2007	1	1	0	5	0	4	5	0	0	4	0	6	0	0	0	0	0	0	2	0	1	6	0	35
2008	3	0	0	15	0	1	6	0	0	1	7	3	0	0	1	0	0	0	0	0	3	1	0	41
2009	3	1	0	6	0	1	8	0	0	3	3	5	0	0	0	0	0	5	1	0	1	2	0	39
2010	0	6	0	7	0	3	4	0	0	6	3	0	0	1	2	0	0	2	0	0	3	5	0	42
2011	0	8	0	8	0	0	2	0	0	5	2	0	0	1	0	0	0	4	0	0	6	4	0	40
2012	0	5	0	6	4	1	2	0	7	3	16	1	0	2	0	0	0	1	0	0	5	11	0	64
2013	5	21	0	4	5	0	11	0	6	4	13	1	0	1	1	0	0	1	0	1	14	19	0	107
2014	2	31	0	2	8	2	14	0	5	6	18	3	3	2	0	0	0	1	2	0	9	15	0	123
2015	4	15	0	2	9	1	37	0	8	4	17	5	3	2	0	0	0	1	0	4	7	23	0	142
2016	6	17	0	4	17	0	26	0	6	2	13	4	2	0	1	0	0	3	2	3	11	29	0	146
2017	8	107	0	3	26	1	23	0	3	8	31	11	5	0	3	0	0	0	3	1	22	43	0	298
2018	10	143	0	3	13	1	20	0	14	3	22	6	4	0	0	0	0	2	0	1	20	25	0	287
2019	3	163	0	4	30	5	14	2	16	1	33	8	5	3	14	0	0	1	15	0	15	27	0	359
2020	5	132	0	4	35	6	12	5	13	1	30	2	6	9	17	0	0	3	34	1	17	23	0	355
2021	4	154	0	6	31	8	4	7	13	2	22	0	8	16	23	0	0	22	24	0	19	23	0	386
2022	1	149	0	12	32	5	10	7	9	1	28	2	6	13	37	0	0	5	28	0	18	17	0	380
2023	5	169	0	13	29	10	6	4	9	1	38	4	6	9	28	2	0	4	14	5	15	19	0	390
2024	7	354	1	31	25	11	7	7	4	0	40	4	10	34	21	0	0	8	25	5	17	17	0	628
2025	3	355	3	21	37	3	8	27	9	3	45	0	6	27	43	0	0	6	69	6	19	17	0	707
2026	5	143	3	24	19	5	10	11	11	2	41	3	6	13	24	0	0	2	19	1	27	6	0	375
2027	4	145	5	24	18	1	3	22	5	3	22	5	8	12	15	0	5	3	3	0	22	18	0	343
2028	7	70	1	10	8	4	3	10	3	0	14	1	2	5	0	0	0	1	9	12	14	8	0	182
2029	5	54	0	5	4	3	0	1	1	0	3	0	2	0	1	0	0	1	1	1	5	9	0	96
2030	0	59	1	0	1	0	0	2	0	0	0	0	0	0	0	0	0	0	0	0	7	0	0	70
2031	0	36	0	0	1	0	0	0	1	0	0	1	0	0	0	0	0	0	0	0	0	0	0	39
2032	1	4	0	1	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	7
2033	0	0	0	1	0	0	0	0	0	1	0	0	0	0	0	0	0	0	0	0	16	0	0	18
2034	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	6	0	4	0	0	10
2035	0	1	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	1
2036	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
2037	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
2038	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
2039	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
2040	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0	0
Total	108	2,347	14	244	352	76	254	105	144	64	462	160	82	154	232	2	5	77	262	41	319	372	0	5,876

Table 12-61 shows the latest cost estimate of supplemental projects by expected in service year for each transmission zone. The average cost of supplemental projects in each expected in service year increased by 2,845.7 percent, from \$64.5 million for years 1998 through 2007 (pre Order No. 890) to \$1.9 billion for years 2008 through 2024 (post Order No. 890). As of December 31, 2024, the 2,235 supplemental projects with expected in service dates between January 1, 2024 and December 31, 2028, have a total cost estimate of \$26.6 billion.

**Table 12-61 Latest cost estimate by expected in service year and zone (\$ millions): 1998 through 2040**

Year	ACEC	AEP	AMPT	APS	ATSI	BGE	COMED	DAY	DUKE	DUQ	DOM	DPL	EKPC	JCLC	MEC	NEET	OVEC	PECO	PE	PEPCO	PPL	PSEG	REC	Total
1998	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$1.67	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$1.67
1999	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.77	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.77
2000	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$32.94	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$32.94
2001	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$6.79	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$6.79
2002	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$6.99	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$6.99
2003	\$7.42	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$8.77	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$9.60	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$25.79
2004	\$4.45	\$0.00	\$0.00	\$10.00	\$0.00	\$0.00	\$0.02	\$0.00	\$0.00	\$0.00	\$0.00	\$7.33	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$22.60
2005	\$4.06	\$14.66	\$0.00	\$10.12	\$0.00	\$0.00	\$2.57	\$0.00	\$0.00	\$0.00	\$0.02	\$10.98	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.50	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$42.91
2006	\$4.03	\$309.70	\$0.00	\$0.93	\$0.00	\$0.00	\$48.93	\$0.00	\$0.00	\$0.00	\$0.00	\$1.62	\$0.00	\$6.00	\$0.00	\$0.00	\$0.00	\$1.50	\$0.00	\$4.63	\$18.80	\$0.00	\$0.00	\$406.14
2007	\$0.56	\$2.06	\$0.00	\$9.85	\$0.00	\$37.61	\$4.64	\$0.00	\$0.00	\$31.75	\$0.00	\$9.71	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.34	\$2.28	\$0.00	\$0.00	\$98.80
2008	\$2.36	\$0.00	\$0.00	\$12.03	\$0.00	\$0.45	\$7.61	\$0.00	\$0.00	\$7.00	\$14.01	\$2.27	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$1.59	\$0.00	\$0.00	\$0.00	\$47.32
2009	\$0.77	\$0.90	\$0.00	\$12.22	\$0.00	\$5.00	\$21.11	\$0.00	\$0.00	\$19.60	\$2.12	\$2.35	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$48.10	\$2.73	\$0.00	\$0.16	\$17.60	\$0.00	\$137.66
2010	\$0.00	\$34.36	\$0.00	\$12.13	\$0.00	\$18.90	\$1.38	\$0.00	\$0.00	\$34.45	\$14.98	\$0.00	\$0.00	\$0.03	\$4.58	\$0.00	\$0.00	\$31.80	\$0.00	\$0.00	\$1.86	\$17.72	\$0.00	\$172.19
2011	\$0.00	\$37.60	\$9.30	\$0.00	\$0.00	\$0.00	\$1.00	\$0.00	\$0.00	\$16.72	\$85.67	\$0.00	\$0.00	\$1.16	\$0.00	\$0.00	\$0.00	\$113.30	\$0.00	\$0.00	\$11.87	\$34.60	\$0.00	\$311.22
2012	\$0.00	\$46.00	\$0.00	\$5.12	\$0.35	\$2.20	\$12.60	\$0.00	\$26.06	\$11.60	\$165.74	\$0.99	\$0.00	\$6.61	\$0.00	\$0.00	\$0.00	\$12.60	\$0.00	\$0.00	\$19.66	\$223.01	\$0.00	\$532.54
2013	\$3.15	\$134.93	\$0.00	\$1.10	\$33.68	\$0.00	\$59.25	\$0.00	\$9.93	\$79.10	\$25.03	\$0.99	\$0.00	\$0.05	\$4.10	\$0.00	\$0.00	\$22.50	\$0.00	\$2.40	\$76.70	\$503.72	\$0.00	\$956.63
2014	\$8.03	\$387.00	\$0.00	\$5.97	\$58.70	\$1.20	\$60.37	\$0.00	\$2.43	\$14.90	\$88.61	\$5.96	\$0.72	\$5.60	\$0.00	\$0.00	\$0.00	\$13.30	\$1.30	\$0.00	\$33.47	\$305.30	\$0.00	\$1,012.86
2015	\$3.73	\$237.45	\$0.00	\$3.80	\$21.90	\$2.00	\$376.00	\$0.00	\$14.12	\$4.53	\$113.53	\$13.06	\$1.22	\$0.30	\$0.00	\$0.00	\$0.00	\$33.80	\$0.00	\$42.50	\$50.17	\$741.91	\$0.00	\$1,660.02
2016	\$74.54	\$84.13	\$0.00	\$18.40	\$182.70	\$0.00	\$308.15	\$0.00	\$15.13	\$26.95	\$40.68	\$26.60	\$0.25	\$0.00	\$0.00	\$0.00	\$0.00	\$86.40	\$0.40	\$7.80	\$58.76	\$742.48	\$0.00	\$1,675.74
2017	\$66.28	\$648.74	\$0.00	\$8.60	\$164.45	\$0.09	\$145.97	\$0.00	\$64.31	\$3.62	\$104.25	\$92.29	\$2.21	\$0.00	\$14.70	\$0.00	\$0.00	\$0.00	\$8.30	\$12.00	\$264.34	\$988.92	\$0.00	\$2,589.07
2018	\$66.55	\$816.23	\$0.00	\$14.60	\$42.12	\$4.08	\$80.94	\$0.00	\$69.80	\$3.13	\$162.94	\$68.94	\$10.87	\$0.00	\$0.00	\$0.00	\$0.00	\$47.60	\$0.00	\$156.00	\$197.34	\$537.85	\$0.00	\$2,278.99
2019	\$64.30	\$1,164.94	\$0.00	\$11.97	\$190.40	\$76.55	\$90.19	\$0.30	\$90.69	\$0.30	\$90.14	\$33.55	\$23.67	\$0.90	\$62.30	\$0.00	\$0.00	\$2.00	\$75.80	\$0.00	\$298.00	\$356.41	\$0.00	\$2,632.41
2020	\$59.58	\$920.44	\$0.00	\$0.30	\$115.41	\$62.58	\$78.09	\$13.66	\$72.06	\$6.40	\$258.72	\$39.50	\$25.61	\$2.30	\$23.10	\$0.00	\$0.00	\$2.40	\$73.50	\$102.70	\$215.29	\$1,959.38	\$0.00	\$4,031.02
2021	\$86.54	\$1,088.72	\$0.00	\$9.50	\$184.21	\$32.52	\$140.90	\$26.10	\$117.39	\$18.90	\$98.40	\$0.00	\$25.67	\$46.70	\$85.89	\$0.00	\$0.00	\$73.40	\$63.48	\$0.00	\$197.67	\$460.84	\$0.00	\$2,756.83
2022	\$81.40	\$756.85	\$0.00	\$24.72	\$215.32	\$190.13	\$147.60	\$36.05	\$64.32	\$45.00	\$194.60	\$9.38	\$27.00	\$32.98	\$128.84	\$0.00	\$0.00	\$72.80	\$59.79	\$0.00	\$231.92	\$450.83	\$0.00	\$2,769.53
2023	\$59.10	\$851.64	\$0.00	\$39.66	\$193.86	\$18.35	\$48.34	\$4.05	\$112.27	\$0.00	\$345.67	\$87.57	\$33.50	\$14.82	\$131.10	\$68.77	\$0.00	\$18.60	\$23.67	\$218.84	\$189.73	\$628.26	\$0.00	\$3,087.80
2024	\$87.60	\$2,583.32	\$20.00	\$82.40	\$152.91	\$27.31	\$215.80	\$120.25	\$44.13	\$0.00	\$517.60	\$95.30	\$65.02	\$197.16	\$106.80	\$0.00	\$0.00	\$40.55	\$75.68	\$2.99	\$215.95	\$521.74	\$0.00	\$5,172.51
2025	\$50.53	\$2,461.42	\$25.50	\$265.71	\$608.71	\$134.70	\$193.80	\$161.85	\$95.07	\$58.25	\$957.96	\$0.00	\$56.10	\$96.76	\$223.72	\$0.00	\$0.00	\$166.45	\$188.23	\$593.94	\$366.40	\$444.43	\$0.00	\$7,149.53
2026	\$90.11	\$1,473.41	\$32.74	\$202.52	\$340.26	\$398.00	\$545.70	\$85.90	\$86.45	\$0.00	\$967.39	\$70.98	\$62.00	\$69.65	\$108.69	\$0.00	\$0.00	\$36.20	\$64.30	\$0.60	\$640.00	\$244.20	\$0.00	\$5,519.10
2027	\$104.63	\$1,387.31	\$47.00	\$198.87	\$343.11	\$0.00	\$169.00	\$188.57	\$70.39	\$168.50	\$774.10	\$104.60	\$92.66	\$88.56	\$171.40	\$0.00	\$4.40	\$53.00	\$18.30	\$0.00	\$341.98	\$675.70	\$0.00	\$5,002.08
2028	\$139.46	\$656.22	\$15.30	\$60.93	\$218.52	\$491.55	\$372.90	\$80.40	\$63.72	\$0.00	\$368.95	\$15.00	\$31.66	\$15.48	\$0.00	\$0.00	\$0.00	\$36.00	\$250.20	\$8.89	\$477.66	\$476.58	\$0.00	\$3,779.42
2029	\$168.40	\$311.36	\$0.00	\$33.65	\$62.42	\$276.00	\$0.00	\$5.20	\$10.24	\$0.00	\$299.02	\$0.00	\$30.10	\$0.00	\$26.40	\$0.00	\$0.00	\$82.00	\$138.00	\$0.50	\$171.30	\$942.50	\$0.00	\$2,557.09
2030	\$0.00	\$235.93	\$29.00	\$0.00	\$12.60	\$0.00	\$0.00	\$69.10	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$39.75	\$0.00	\$0.00	\$386.38
2031	\$0.00	\$292.90	\$0.00	\$0.00	\$80.00	\$0.00	\$0.00	\$2.40	\$0.00	\$0.00	\$42.50	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$417.80
2032	\$50.00	\$242.23	\$0.00	\$1.90	\$0.00	\$0.00	\$0.00	\$0.00	\$2.99	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$297.12
2033	\$0.00	\$0.00	\$0.00	\$1.90	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$30.40	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$242.17	\$0.00	\$0.00	\$274.47
2034	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$443.00	\$0.00	\$89.40	\$0.00	\$0.00	\$0.00	\$532.40
2035	\$0.00	\$107.10	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$107.10
2036	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
2037	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
2038	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
2039	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
2040	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
Total	\$1,287.58	\$17,287.55	\$169.54	\$1,068.20	\$3,221.63	\$1,799.22	\$3,133.66	\$791.43	\$1,033.90	\$581.10	\$5,690.13	\$814.40	\$488.26	\$585.06	\$1,093.99	\$68.77	\$4.40	\$993.30	\$1,497.78	\$1,149.16	\$4,438.11	\$11,295.06	\$0.00	\$58,492.23

On September 28, 2023, the Office of Ohio Consumers' Counsel filed a complaint regarding the impact of the volume and costs of supplemental projects on consumers. The complaint requests that the Commission develop a mechanism, to be included in the PJM Tariff and Operating Agreement, whereby "FERC would review the need, prudence and cost-effectiveness of local transmission projects in Ohio." The complaint also requests the Commission to appoint an Independent Transmission Monitor (ITM) to assist "in reviewing the planning, need, prudence and cost-effectiveness of local transmission projects for consumers in Ohio", and to "consider precluding the Ohio Transmission Utilities from using formula rates for establishing transmission rates."<sup>144</sup> The Office of Ohio Consumers' Counsel's complaint is pending.

On December 19, 2024, a group of consumer interests filed against multiple transmission owners and RTOs/ISOs.<sup>145</sup> The complaint alleges that provisions in the tariffs of the transmission owning utilities and the RTOs/ISOs inappropriately authorize individual transmission owners to plan facilities rated at 100 kilovolts kV and above without regard to efficiency or cost-effectiveness. The complaint does not challenge the rates for any specific locally planned projects, but, rather, alleges that the cumulative effect of tariff provisions allowing local planning of transmission projects rated at 100 kV and above results in unjust and unreasonable transmission rates.<sup>146</sup> The complaint requests issuance of an order that, for transmission facilities rated at 100 kV and above, requires: (i) removal of planning from transmission owner tariffs (and RTO tariffs that confirm such transmission owner planning); (ii) amendment of regional planning tariffs to require that all planning be done at the regional or interregional level (specifying facilities reaching the end of operational life); and (iii) amendment of regional planning tariffs be to require that the regional planning

<sup>144</sup> See Office of the Ohio Consumers' Counsel v. PJM, et al., Docket No. EL23-105 (September 28, 2023).

<sup>145</sup> See Industrial Energy Consumers of America v. PJM, et al., Docket No. EL25-44-000 (December 19, 2024).

<sup>146</sup> *Id.* at 11.

within the existing Order No. 1000 regions be conducted by independent transmission system planners.<sup>147</sup> The complaint recommends that independent transmission planners be structured similar to independent market monitors or be included in an expanded market monitoring function.<sup>148</sup> The consumer interests' planning complaint is pending.

The MMU recommends, to increase the role of competition, that the exemption of supplemental projects from the Order No. 1000 competitive process be terminated.

## End of Life Transmission Projects

An end of life transmission project is a project submitted for the purpose of replacing existing infrastructure that is at, or is approaching, the end of its useful life. Under the current process, end of life transmission projects are not subject to the RTEP open window process and have become a form of supplemental project that is exempt from competition under the existing rules.<sup>149</sup>

The MMU recommends, to increase the role of competition, that the exemption of end of life projects from the Order No. 1000 competitive process be terminated and that end of life transmission projects be included in the RTEP process and should be subject to a transparent, robust and clearly defined mechanism to require competition to build such projects.

## Competitive Planning Process Exclusions

There are several project types that are currently exempt from the competitive planning process. These project types include:

- **Immediate Need Exclusion.** If the violation needs to be resolved within three years or less, all such projects are excluded from competition. The local Transmission Owner is the Designated Entity.<sup>150</sup>

On October 17, 2019, the Commission issued an Order Instituting Section 206 Proceedings to determine if RTOs have implemented the exemption in a manner consistent with the Commission's directives under

Order 1000.<sup>151</sup> Some supplemental projects are in this category. In a decision issued August 19, 2022, the U.S. Court of Appeals for the D.C. Circuit found that FERC reasonably approved MISO's Immediate Need Reliability Exception.<sup>152</sup> The Court rejected arguments challenging the MISO rule because (i) the definition of projects eligible for the exception was insufficiently limited and (ii) the rule allows for designating the incumbent developer before posting of the basis for the exception.<sup>153</sup> The decision was largely based on deference to FERC expertise.<sup>154</sup>

- **Below 200kV.** All projects at voltages less than 200kV are excluded from competition. The local Transmission Owner is the Designated Entity.<sup>155</sup> Some supplemental projects are in this category.
- **Substation Equipment.** If the limiting element(s) is substation equipment, such projects are excluded from competition. The local Transmission Owner is the Designated Entity.<sup>156</sup> Some supplemental projects are in this category.

While the PJM Operating Agreement defines the Designated Entity for projects that are excluded from the competitive planning process, neither the PJM Operating Agreement nor the various commission orders on transmission competition prohibit PJM from permitting competition to provide financing for such projects. The MMU recommends that rules be implemented to require competition to provide financing for transmission projects. This competition could reduce the cost of capital for transmission projects and significantly reduce total costs to customers. In addition, the criteria for and need for all exclusions from the competitive process should be reviewed. There does not appear to be any market reason to exclude transmission projects from competition for any of these exclusion categories.

## Dominion Data Center Alley Immediate Need and Long Term Solution

Dominion has presented 44 supplemental project requests to serve new data center load through the summer of 2025. PJM identified the need for additional baseline reinforcements to support the load growth. Rather than a competitive process, PJM decided to designate the

<sup>147</sup> *Id.* at 42–43.

<sup>148</sup> *Id.*, Attachment C (Declaration of Michael A. Giberson) at 36:11–37:8.

<sup>149</sup> In recent decisions addressing competing proposals on end of life projects from competition in the RTEP process, 172 FERC ¶ 61,136 (2020), *reh'g denied*, 173 FERC ¶ 61,225 (2020), *affirmed*, American Municipal Power, Inc., et al. v. FERC, Case No. 20-1449 (D.C. Cir. November 17, 2023), and rejected a proposal from PJM stakeholders that would have included end of life projects in competition in the RTEP process, 173 FERC ¶ 61,242 (2020).

<sup>150</sup> See OA Schedule 6 § 1.5.8(m).

<sup>151</sup> 169 FERC ¶ 61,054 (2019).

<sup>152</sup> LSP Transmission Holdings II, LLC v. FERC, 45 F.4th 979.

<sup>153</sup> *Id.* at 999.

<sup>154</sup> *Id.*

<sup>155</sup> See OA Schedule 6 § 1.5.8(n).

<sup>156</sup> See OA Schedule 6 § 1.5.8(p).

upgrades as immediate need and allowed Dominion to construct these lines.<sup>157 158</sup>

The 2022 RTEP Window 3 addressed long term reliability needs as well as the additional baseline reinforcements for Data Center Alley. The proposal window was open from February 24, 2023, to May 31, 2023, and received 72 submissions from 10 entities. The cost estimate for the total scope of work was \$5.1 billion, \$1.2 billion of which was for the necessary baseline upgrades specific to the Data Center Alley reinforcements.<sup>159</sup> The proposed Data Center Alley solution includes 500kV and 230kV lines extensions, the reconductoring of multiple 230kV lines and substation work.<sup>160</sup>

On December 8, 2023, the Maryland Office of People's Counsel (MDOPC) submitted a letter to the PJM Board.<sup>161</sup> The letter requested that the PJM Board defer the December 11, 2023, vote on the 2022 RTEP Window 3 proposal. The MDOPC letter cited concerns regarding the scale, scope and cost of the proposal. Additionally, the MDOPC expressed concerns that "the current failure to unpack the relative contribution of each of the "drivers" of the need for the W3 projects makes it impossible for the public to understand how cost causation principles apply to the projects." On December 11, 2023, the PJM Board approved the recommended solution.

## Comparative Cost Framework

The MMU recommended that rules be implemented to require that project cost caps on new transmission projects be part of the evaluation of competing projects. On May 24, 2018, the PJM Markets and Reliability Committee (MRC) approved a motion that required PJM, with input from the MMU, to develop a comparative cost framework to evaluate the quality and effectiveness of binding cost containment proposals versus proposals without cost containment provisions. On March 20, 2020, the Commission approved PJM's filing to amend

the PJM Operating Agreement to incorporate this requirement.<sup>162</sup>

The 2020 RTEP Window 1 was the first open window that received cost capping proposals to be evaluated under the comparative cost framework. PJM has not provided the requested data to the MMU to allow for an analysis of their financial review process. Without this data and analysis, the MMU cannot verify that the analysis performed under the comparative cost framework was sufficient or adequately followed the process defined in the PJM manual.<sup>163</sup> The existing proposal templates do not provide enough information to adequately perform a financial analysis. The MMU recommends that PJM modify the project proposal templates to include data necessary to perform a detailed project lifetime financial analysis. The required data includes, but is not limited to: capital expenditure; capital structure; return on equity; cost of debt; tax assumptions; ongoing capital expenditures; ongoing maintenance; and expected life.

## Storage As A Transmission Asset (SATA)

The PJM Planning Committee considered whether storage devices should be included in the RTEP process as transmission assets.<sup>164</sup> On February 24, 2021, the Markets and Reliability Committee (MRC) voted to defer endorsement of governing document language associated with Storage as a Transmission Asset in reliability planning.<sup>165</sup> The MRC chose to defer the language until a comprehensive proposal addressing all aspects of incorporation of storage resources into markets, operations and planning. The issue is currently on hold in the stakeholder process.

Transmission and generation have, and have always had, a symbiotic relationship in the provision of wholesale power. Transmission needs generation to function and generation needs transmission to function. Transmission can substitute for generation at the margin and generation can substitute for transmission at the margin. This relationship has always been a relatively unexamined area in the design of competitive wholesale power markets. For example, there is little if any explicit

<sup>157</sup> See "Dominion Northern Virginia Area Violations," presented at the July 12, 2022 meeting of the Transmission Expansion Advisory Committee. <<https://www.pjm.com/-/media/committees-groups/committees/teac/2022/20220712/item-08---dominion-northern-virginia-area-violations---need-statement.ashx>>.

<sup>158</sup> See "Dominion Northern Virginia Area Immediate Need," presented at the July 12, 2022 meeting of the Transmission Expansion Advisory Committee. <<https://www.pjm.com/-/media/committees-groups/committees/teac/2022/20220712/item-08---dominion-northern-virginia---immediate-need.ashx>>.

<sup>159</sup> See "Transmission Expansion Advisory Committee (TEAC) Recommendations to the PJM Board," December 2023. <<https://www.pjm.com/-/media/committees-groups/committees/teac/2023/20231205/20231205-pjm-teac-board-whitepaper-december-2023.ashx>>.

<sup>160</sup> See "Reliability Analysis Report: 2022 RTEP Window 3," December 8, 2023. <<https://www.pjm.com/-/media/committees-groups/committees/teac/2023/20231205/20231205-2022-rtep-window-3-reliability-analysis-report.ashx>>.

<sup>161</sup> See "MD Office of People's Counsel Letter regarding 2022 RETP Window 3 Procurement," <<https://www.pjm.com/-/media/about-pjm/who-we-are/public-disclosures/20231208-pjm-board-letter-2023-12-08-md-opc-final.ashx>>.

<sup>162</sup> 170 FERC ¶ 61,243 (2020).

<sup>163</sup> See "PJM Manual 14F: Competitive Planning Process," Rev. 9 (April 27, 2022).

<sup>164</sup> See PJM. "Storage As A Transmission Asset: Problem / Opportunity Statement," <<https://www.pjm.com/-/media/committees-groups/committees/pc/2020/20200605-special/20200605-item-02a-storage-as-a-transmission-asset-problem-statement-clean.ashx>>.

<sup>165</sup> See PJM. "Minutes of the February 24, 2021 Markets and Reliability Committee," <<https://www.pjm.com/-/media/committees-groups/committees/mrc/2021/20210329/20210329-caa-draft-minutes-mrc-20210224.ashx>>.



consideration of the impact of transmission planning on competitive generation investment in RTO/ISO market rules. Improvement is needed in these areas. Introducing confusion about what assets are classified as generation and what assets are classified as transmission frustrates potential reform and undermines the competitive markets.

On July 22, 2020, through the supplemental planning process, American Electric Power Service Corporation (AEP) filed, on behalf of Kentucky Power Company (Kentucky Power), a Petition for Declaratory Order seeking confirmation that its Middle Creek energy storage project is eligible for cost of service recovery through AEP's formula rates.<sup>166</sup> AEP's Middle Creek energy storage project was a proposed battery storage device that would discharge energy to serve retail load at the Middle Creek substation in the event of a transmission outage. On December 21, 2020, the Commission ruled that the Middle Creek energy storage project did not perform a transmission function, and was ineligible to recover its costs through formula rates.<sup>167</sup>

Storage devices like batteries that are defined to be part of PJM markets should not be treated as transmission assets. These devices should be treated as market assets. The MMU recommends that storage resources not be includable as transmission assets for any reason.

## Board Authorized Transmission Upgrades

The Transmission Expansion Advisory Committee (TEAC) regularly reviews internal and external proposals to improve transmission reliability throughout PJM. These proposals, which include reliability baseline, network, market efficiency and targeted market efficiency projects, as well as scope changes and project cancellations, but exclude supplemental and end of life projects, are periodically presented to the PJM Board of Managers for authorization.<sup>168</sup>

An RTEP project can be approved by the PJM Board if the project ensures compliance with NERC, regional and local transmission owner planning criteria or to address market efficiency congestion relief. These projects are considered Baseline Projects. PJM Board approved RTEP

projects that are necessary to allow new generation to interconnect reliably are considered Network Projects.

In 2024, the PJM Board approved a net change of \$1.8 billion in transmission upgrades. As of December 31, 2024, the PJM Board had approved \$50.1 billion in transmission system enhancements since 1999.

## Qualifying Transmission Upgrades (QTU)

A Qualifying Transmission Upgrade (QTU) is an upgrade to the transmission system, financed and built by market participants, that increases the Capacity Emergency Transfer Limit (CETL) into an LDA and can be offered into capacity auctions as capacity. Once a QTU is in service, the upgrade is eligible to continue to offer the approved incremental import capability into future RPM Auctions.

If a QTU that was cleared in a Base Residual Auction (BRA) or Incremental Auction (IA) is not completed by the start of the Delivery Year, the submitting party is required to provide replacement capacity. Once a QTU is in service, the upgrade is eligible to continue to offer the approved incremental import capability into future RPM Auctions. As of December 31, 2024, no QTUs have cleared a BRA or IA.

## Cost Allocation

In response to complaints against PJM RTEP Baseline Upgrade Filings in 2014 that included cost allocations for \$1.5 billion in baseline transmission enhancements and expansions, on November 24, 2015, FERC issued an order directing investigation of "whether there is a definable category of reliability projects within PJM for which the solution-based DFAX cost allocation method may not be just and reasonable, such as projects addressing reliability violations that are not related to flow on the planned transmission facility, and whether an alternative just and reasonable *ex ante* cost allocation method could be established for any such category of projects."<sup>169</sup> FERC convened a technical conference on January 12, 2016, to address the complaints in multiple proceedings and to address these two core issues.<sup>170</sup>

The issues identified in the complaints and at the technical conference included: whether the solutions based allocation method is appropriate for upgrades

<sup>166</sup> See AEP, Docket No. EL20-58 (July 22, 2020).

<sup>167</sup> 173 FERC ¶ 61,264 (2020).

<sup>168</sup> Supplemental Projects, including the end of life subset of supplemental projects, do not require PJM Board of Managers authorization.

<sup>169</sup> 153 FERC ¶ 61,245 at P 35 (2015).

<sup>170</sup> See Docket Nos. EL15-18-000 (ConEd), EL15-67-000 (Linden), and EL15-95-000 (Artificial Island).

not related to transmission overload issues; whether the solutions based allocation method correctly identifies all the beneficiaries of the upgrades; whether it is reasonable to allocate a level of costs to a merchant transmission project that could force bankruptcy; and whether the significant shifts in allocation that result from use of the 0.01 distribution factor cutoff are appropriate.

On February 20, 2020, the Commission issued an Order denying rehearing requests.<sup>171</sup> The Commission found that PJM's solution based dfax method for regional cost allocation, including the 0.01 distribution cutoff factor, is just and reasonable.

On appeal, the U.S. Court of Appeals for the D.C. Circuit found that FERC had failed to explain its distinction between the projects eligible to use the dfax method and those not eligible.<sup>172</sup> The Court objected that without adequate explanation: "The Bergen project 'addresses a non-flow related reliability issue,' just like the non-flow-based stability issue in Artificial Island, but FERC had treated the two projects differently."<sup>173</sup> The Court also rejected the 0.01 distribution cutoff factor as "absurd."<sup>174</sup> The Court remanded issues concerning PJM's solution based dfax method to FERC, where the matter is now pending.<sup>175</sup>

It is clear that the allocation issues are difficult. Nonetheless, allocation methods affect the efficiency of the markets. Allocation methods also affect the degree to which transmission upgrades required to serve data center load are allocated to other customers. The MMU recommends a comprehensive review of the ways in which the solution based dfax is implemented. The goal for such a process would be to ensure that the most rational and efficient approach to implementing the solution based dfax method is used in PJM. Such an approach should allocate costs consistent with benefits and appropriately calibrate the incentives for investment in new transmission capability. No replacement approach should be approved until all potential alternatives are thoroughly reviewed.

As an example, the use of the arbitrary 0.01 distribution factor cutoff can result in large and inappropriate shifts in cost allocation. If the intent of the use of the 0.01 cutoff is to help eliminate small, arbitrary cost allocations

to geographically distant areas, this could be achieved by adding a threshold for a minimum usage impact on the line. The MMU recommends changing the minimum distribution factor in the allocation from 0.01 to 0.00 and adding a threshold minimum impact on the load on the line based on a complete analysis of the intent of the allocation and the impacts of the allocation.

## Transmission Line Ratings

Transmission line ratings, and more broadly transmission facility ratings, are the metric for the ability of transmission lines to transmit power from one point to another. Transmission line ratings have significant and frequently underappreciated impacts on competitive wholesale power markets like PJM. Line ratings directly affect energy and capacity prices, the frequency and level of congestion in the day-ahead and real-time energy market, day-ahead nodal price differences and the associated value of FTRs, locational price differences in the capacity market, the need to invest in additional transmission capacity, the need to invest in additional generation capacity, the location of new power plants, and the costs for the interconnection of new power plants. The impact of transmission facility ratings on markets is a function both of the line ratings directly and the use of those ratings by the RTO/ISO.

Congestion payments by load result when lower cost generation is not available to meet all the load in an area as a result of limits on the transmission system. When higher cost local generation is needed to meet part of the local load because of transmission limits, 100 percent of the local load pays the higher price while only the local generation receives the higher price. The difference between what the load pays and generators receive is congestion. Since 2008, congestion costs in PJM have ranged from \$0.5 billion to \$2.05 billion per year. The fact that PJM rules continue to fail to ensure the return of 100 percent of congestion costs to the load that pays them means that higher congestion increases costs to load.

LMP may, at times, be set by transmission constraint penalty factors. When a transmission constraint is binding and there are no generation alternatives to resolve the constraint, system operators may allow the transmission limit to be violated. When this occurs, the shadow price of the constraint is set by transmission constraint penalty factors. The shadow price directly

<sup>171</sup> 170 FERC ¶ 61,122 (2020).

<sup>172</sup> See *Consolidated Edison v. FERC et al.*, 45 F.4th 265 (D.C. Cir. August 9, 2022).

<sup>173</sup> *Id.* at 9.

<sup>174</sup> See *id.*

<sup>175</sup> See FERC Docket Nos. EL15-67-000, et al.

affects the LMP. Transmission constraint penalty factors were fully implemented in PJM pricing effective February 1, 2019.<sup>176</sup>

Transmission line ratings can result in short term, significant increases in prices as a result of the application of transmission constraint penalty factors. For example, violation of a transmission constraint, meaning that the flow exceeds the line limit, generally results in at least a \$2,000 per MWh price. As the power flows approach their rated limits, PJM dispatchers often reduce the control percent on transmission limits applied in SCED by the setting the limit to an average of 95 percent of its actual limit.<sup>177</sup> Violation of these reduced control percent line ratings results in penalty factors setting prices in SCED.<sup>178</sup>

Holding aside the issues with operators reducing the control percent in SCED, the more important point is that the underlying line ratings have a significant impact on the cost of energy and capacity but have never been reviewed or standardized by ISOs/RTOs or by regulators. The line ratings issues will begin to be addressed beginning on July 12, 2025.<sup>179</sup>

Capacity market prices separate locally when transmission capability into Locational Deliverable Areas (LDA) is not adequate to meet the LDA capacity requirement with the lowest cost capacity. The available transmission capability into LDAs is defined as the Capacity Emergency Transfer Limit (CETL). Higher cost LDAs are the equivalent in the capacity market of congestion in the energy market. Load in the higher cost LDAs pay more for capacity than those in lower cost LDAs. For example, the clearing price for the BGE LDA in the 2021/2022 Base Residual Auction was \$200.30 per MW-day. The clearing price for the EMAAC LDA was \$165.73 per MW-day.<sup>180</sup>

Transmission line ratings for a given transmission facility vary by the duration of the power flow, by ambient temperatures, by wind speed and by other conditions. Transmission lines can operate with higher

loads for shorter periods of time. This is significant when a contingency is expected to last for only a short period. The transmission line rating can mean the difference between substantial congestion costs and no congestion costs. The transmission line rating can mean the difference between a transmission penalty factor and no penalty factor.

In PJM, transmission owners use a range of ratings by duration.<sup>181</sup> PJM requires transmission owners to provide thermal ratings under normal operating conditions, long term emergency operating conditions, short term emergency operating conditions and the extreme load dump conditions. But there is no requirement that the ratings differ for these operating conditions. PJM typically uses normal line ratings for precontingency (base case) constraints and long term emergency line ratings (four hours) for contingency constraints. PJM requires transmission owners to provide temperature based line ratings separately for night and day times. The temperature ranges from 32 degree Fahrenheit or below to 95 degree Fahrenheit or above in nine degree increments. But there is no requirement that the ratings differ for these operating condition temperatures. In PJM, transmission owners are responsible for developing their own methods to compute line ratings subject to a range of NERC guidelines and requirements. PJM does not review or verify the accuracy of transmission owners' methods to compute line ratings. In PJM, transmission owners have substantial discretion in the approach to line ratings.<sup>182</sup>

Given the significant impact of transmission line ratings on all aspects of wholesale power markets, ensuring and improving the accuracy and transparency of line ratings is essential. Line ratings should incorporate ambient temperature conditions, wind speed and other relevant operating conditions. PJM real-time prices are calculated every five minutes for thousands of nodes. PJM prices are extremely sensitive to transmission line ratings. For consistency with the dynamic nature of wholesale power markets, line ratings should be updated in real time to reflect real time conditions and to help ensure that real-time prices are based on actual current line ratings. New technologies that permit dynamic line ratings (DLR) should be implemented.

<sup>176</sup> For more information, see the 2024 Annual State of the Market Report for PJM, Volume 2, Section 3: Energy Market.

<sup>177</sup> See "Transmission Constraint Control Logic and Penalty Factors," presented at May 10, 2018, meeting of the Markets Implementation Committee Special Session Transmission Constraint Penalty Factors at p14. <<https://www.pjm.com/-/media/committees-groups/committees/mic/20180510-special/20180510-item-03-transmission-constraint-penalty-factor-education.ashx>>.

<sup>178</sup> See the 2024 Annual State of the Market Report for PJM, Volume 2, Section 3: Energy Market.

<sup>179</sup> *Managing Transmission Line Ratings*, Order No. 881, 177 FERC ¶ 61,179 at P 39 (2021) ("Order No. 881"), order on reh'g, Order No. 881-A, 179 FERC ¶ 61,125 (2022) ("Order No. 881-A").

<sup>180</sup> See the "Analysis of the 2021/2022 RPM Base Residual Auction," <[https://www.monitoringanalytics.com/reports/Reports/2018/IMM\\_Analysis\\_of\\_the\\_20212022\\_RPM\\_BRA\\_Revised\\_20180824.pdf](https://www.monitoringanalytics.com/reports/Reports/2018/IMM_Analysis_of_the_20212022_RPM_BRA_Revised_20180824.pdf)> (August 24, 2018).

<sup>181</sup> See "PJM Manual 03: Transmission Operations," Rev. 67 (November 21, 2024) § 2.1.1, at p 30.

<sup>182</sup> PJM presentation to the Planning Committee (PC) (May 3, 2018) "Transmission Owner Ratings Development and Reporting in PJM" ("There are no requirements for PJM to approve or verify a TO's ratings or do any kind of consistency check.") at 24.

Line ratings determine the actual value of transmission in market operations. Yet the methods for defining line ratings remain opaque and vary significantly across transmission owners. Under defining line ratings results in over building transmission. Dynamic line ratings are essential to reflect the actual availability of transmission in real time as ambient conditions change. Ensuring that system operators have accurate information about line ratings, including a wide range of line ratings by duration of load, are essential to ensure that all market participants receive the maximum value from the investment in the transmission system.

Given the significant impact of transmission line ratings on all aspects of wholesale power markets, ensuring and improving the accuracy and transparency of line ratings is essential. Line ratings should incorporate ambient temperature conditions, wind speed and other relevant operating conditions. In PJM, real-time prices are calculated every five minutes for thousands of nodes. PJM prices are extremely sensitive to transmission line ratings.

The MMU recommends that all PJM transmission owners use the same methods to define line ratings and implement dynamic line ratings (DLR), subject to NERC standards and guidelines, subject to review by NERC, PJM and the MMU, and approval by FERC. The same facilities should have the same basic ratings under the same operating conditions regardless of the transmission owner. Transmission owner discretion should be minimized or eliminated. The line rating methods should be based on the basic engineering facts of the transmission system components and reflect the impact of actual operating conditions on the ratings of transmission facilities, including ambient temperatures and wind speed when relevant.<sup>183</sup> The line rating methods should be public and fully transparent.

The MMU recommends that PJM routinely review all transmission facility ratings and any changes to those ratings to ensure that the normal, emergency and load dump ratings used in modeling the transmission system are accurate and reflect standard ratings practice.<sup>184</sup> All line rating changes and the detailed reasons for those changes should be public and fully transparent.

The Commission adopted rules that enhance the ability of PJM and the MMU to understand and monitor line ratings on the PJM grid. Order No. 881, issued December 16, 2021, requires that: transmission providers implement ambient adjusted ratings on transmission lines; RTOs/ISOs implement the systems and procedures necessary for hourly ratings updates; transmission providers use uniquely determined emergency ratings; transmission owners share transmission line ratings and transmission line rating methods with RTOs/ISOs and market monitors; transmission providers maintain a database of transmission line ratings and transmission line rating methods on OASIS or other password-protected website.<sup>185 186</sup>

On rehearing, the Commission provided clarification of market monitors' ability to take action based on information received about transmission line ratings: "We expect that market monitors may use the transmission line rating information available to them in furtherance of their existing responsibilities, which are set forth in the Commission's regulations and the relevant tariffs of each RTO/ISO."<sup>187</sup>

Order No. 881 enhances transparency of information on line ratings and how they are determined. Requiring ambient and hourly adjustments constitutes substantive improvement. Continued reform consistent with the MMU's recommendations is needed in order to ensure consistent and accurate transmission line ratings in PJM.

By letter order issued November 22, 2023, the Commission accepted PJM's filing in compliance with Order Nos. 881 and 881-A, to be implemented no later than July 12, 2025.<sup>188</sup>

Order No. 881 did not require the use of dynamic line ratings ("DLR") based on an insufficient record.<sup>189</sup> On June 27, 2024, the Commission issued an Advanced Notice of Proposed Rulemaking in Docket RM24-6 on the implementation of dynamic line ratings.<sup>190</sup>

<sup>183</sup> See "Transmission Owner Ratings Development and Reporting in PJM," presented at May 3, 2018 meeting of the Planning Committee.

<sup>184</sup> See the 2024 Annual State of the Market Report for PJM, Volume 2, Section 3: Energy Market.

<sup>185</sup> *Managing Transmission Line Ratings*, Order No. 881, 177 FERC ¶ 61,179 at P 39 (2021) ("Order No. 881"), order on reh'g, Order No. 881-A, 179 FERC ¶ 61,125 (2022) ("Order No. 881-A").

<sup>186</sup> See 18 CFR 5 35.28(c)(5)(g)(13).

<sup>187</sup> Order No. 881-A at P 91.

<sup>188</sup> See Docket No. ER22-2359-000. PJM must notify the Commission of the effective date no later than November 12, 2024.

<sup>189</sup> Order No. 881 at PP 25, 254.

<sup>190</sup> See 187 FERC ¶ 61,201.



## Dynamic Line Ratings (DLR) and Grid Enhancing Technology (GETs)

For consistency with the dynamic nature of wholesale power markets, line ratings should be updated in real time to reflect real time conditions and to help ensure that real time prices are based on actual current line ratings. The relevant real-time conditions include ambient air temperature, wind speeds, solar heating, transmission line tension, and transmission line sag. The widespread adoption of dynamic line ratings should be pursued. The adoption of dynamic line ratings does not require the exorbitant incentives proposed by some. Dynamic line rating technology (DLR) and other Grid Enhancing Technology (GET) should be subject to competition and the costs of implementation should be capped at the costs that would result from the current cost of service method applied to transmission owners. The proposal that providers of GET should receive a share of forecast benefits is not consistent with competition, would pay rates of return many multiples of market rates of return and suffers from the same intractable problem of defining speculative benefits for long periods.

As a first small step towards broader implementation of DLR by all transmission owners in PJM, PPL Electric Utilities, on its own initiative, implemented DLR for three 230 KV transmission lines in northeastern Pennsylvania on October 6, 2022, that have experienced congestion. (The two circuit Susquehanna-Harwood path and the Juniata-Cumberland line.) PPL provides streaming data from the DLR system to PJM operators.

PJM developed technical reference guides to aid in the understanding and consideration of grid enhancing technologies on the PJM system. The technical reference guides provide additional information on dynamic line ratings, advanced power flow controllers, topology control and optimization and advanced conductors.<sup>191</sup>

<sup>191</sup> See PJM, "About PJM "Grid Optimization Solutions," <<https://www.pjm.com/about-pjm/advanced-technologies/grid-optimization-solutions>>.

## Transmission Facility Outages Scheduling Transmission Facility Outage Requests

A transmission facility is designated as reportable by PJM if a change in its status can affect a transmission constraint on any Monitored Transmission Facility or could impede free flowing ties within the PJM RTO and/or adjacent areas.<sup>192</sup> When a reportable transmission facility needs to be taken out of service, the transmission owner is required to submit an outage request as early as possible.<sup>193</sup> The specific timeline is shown in Table 12-63.<sup>194</sup>

Transmission outages have significant impacts on PJM markets, including impacts on FTR auctions, on congestion, and on expected market outcomes in the day-ahead and real-time markets. The efficient functioning of the markets depends on clear, enforceable rules governing transmission outages.

The outage data for the FTR market are for outages scheduled to occur in the 2023/2024 planning period and in the first seven months of the 2024/2025 planning period, regardless of when they were initially submitted.<sup>195</sup> The outage data for the day-ahead market are for outages scheduled to occur from January 2015 through December 2024.

Transmission outages are categorized by duration: greater than 30 calendar days; less than or equal to 30 calendar days; greater than five calendar days; less than or equal to five calendar days.<sup>196</sup> Table 12-62 shows that 72.1 percent of requested outages were planned for less than or equal to five days and 11.5 percent of requested outages were planned for greater than 30 days in the first seven months of the 2024/2025 planning period. Table 12-62 also shows that 76.3 percent of the requested outages were planned for less than or equal to five days and 8.8 percent of requested outages were planned for greater than 30 days in the 2023/2024 planning period.

<sup>192</sup> If a transmission facility is not modeled in the PJM EMS or the facility is not expected to significantly impact PJM system security or congestion management, it is not reportable. See PJM, "Manual 3: Transmission Operations," Rev. 67 (Nov. 21, 2024).

<sup>193</sup> See PJM, "Manual 3: Transmission Operations," Rev. 67 (Nov. 21, 2024).

<sup>194</sup> See PJM, "Manual 3: Transmission Operations," Rev. 67 (Nov. 21, 2024).

<sup>195</sup> The hotline tickets, EMS tripping tickets or test outage tickets were excluded. The analysis includes only the transmission outage tickets submitted by PJM companies which are currently active.

<sup>196</sup> *Id.* at 70.

**Table 12-62 Transmission facility outage request summary by planned duration: June 2023 through December 2024**

Planned Duration (Days)	2023/2024 (12 months)		2024/2025 (7 months)	
	Outage Requests	Percent of Total	Outage Requests	Percent of Total
<=5	14,916	76.3%	8,033	72.1%
>5 & <=30	2,903	14.9%	1,833	16.4%
>30	1,718	8.8%	1,279	11.5%
Total	19,537	100.0%	11,145	100.0%

After receiving a transmission facility outage request from a TO, PJM assigns a received status to the request based on its submission date and outage planned duration. The received status can be On Time or Late, as defined in Table 12-63.<sup>197</sup>

The purpose of the rules defined in Table 12-63 is to require the TOs to submit transmission facility outages prior to the Financial Transmission Right (FTR) auctions so that market participants have complete information about market conditions on which to base their FTR bids and PJM can accurately model market conditions.<sup>198</sup>

**Table 12-63 Transmission facility outage request received status definition**

Planned Duration (Calendar Days)	Request Submitted	Received Status
<=5	Before the first of the month one month prior to the starting month of the outage	On Time
	After or on the first of the month one month prior to the starting month of the outage	Late
> 5 & <=30	Before the first of the month six months prior to the starting month of the outage	On Time
	After or on the first of the month six months prior to the starting month of the outage	Late
>30	Before the earlier of 1) February 1, 2) the first of the month six months prior to the starting month of the outage	On Time
	After or on the earlier of 1) February 1, 2) the first of the month six months prior to the starting month of the outage	Late

Table 12-64 shows a summary of requests by received status. In the first seven months of the 2024/2025 planning period, 41.1 percent of outage requests received were late. In the 2023/2024 planning period, 38.0 percent of outage requests received were late.

**Table 12-64 Transmission facility outage requests by received status: June 2023 through December 2024**

Planned Duration (Days)	2023/2024 (12 months)				2024/2025 (7 months)			
	On Time	Late	Total	Percent Late	On Time	Late	Total	Percent Late
<=5	9,808	5,108	14,916	34.2%	5,058	2,975	8,033	37.0%
>5 & <=30	1,642	1,261	2,903	43.4%	1,010	823	1,833	44.9%
>30	660	1,058	1,718	61.6%	494	785	1,279	61.4%
Total	12,110	7,427	19,537	38.0%	6,562	4,583	11,145	41.1%

Once received, PJM processes outage requests in priority order: emergency transmission outage request; transmission outage request submitted on time; and transmission outage request submitted late. Transmission outage requests that are submitted late may be approved if the outage does not affect the reliability of PJM or cause congestion in the system.<sup>199</sup>

Outages with emergency status will be approved even if submitted late after PJM determines that the outage does not result in Emergency Procedures. PJM cancels or withholds approval of any outage that results in Emergency Procedures.<sup>200</sup> Table 12-65 is a summary of outage requests by emergency status. Of all outage requests scheduled to occur in the first seven months of the 2024/2025 planning period, 12.9 percent were for emergency outages. Of all outage requests scheduled to occur in the 2023/2024 planning period, 11.8 percent were for emergency outages.

<sup>197</sup> See PJM, "Manual 3: Transmission Operations," Rev. 67 (Nov. 21, 2024).

<sup>198</sup> See "Report of PJM Interconnection, LLC on Transmission Oversight Procedures," Docket No. EL01-122-000 (November 2, 2001).

<sup>199</sup> See PJM, "Manual 3: Transmission Operations," Rev. 67 (Nov. 21, 2024). The following language was removed from Manual 3 Rev. 50: PJM retains the right to deny all jobs submitted after 8 a.m. three days prior to the requested start date unless the request is an emergency job or an exception request (i.e. a generator tripped and the Transmission Owner is taking advantage of a situation that was not available before the unit trip).

<sup>200</sup> PJM, "Manual 3: Transmission Operations," Rev. 67 (Nov. 21, 2024).



**Table 12-65 Transmission facility outage requests by emergency: June 2023 through December 2024**

Planned Duration (Days)	2023/2024 (12 months)				2024/2025 (7 months)			
	Emergency	Non Emergency	Total	Percent Emergency	Emergency	Non Emergency	Total	Percent Emergency
<=5	1,663	13,253	14,916	11.1%	956	7,077	8,033	11.9%
>5 &lt;=30	357	2,546	2,903	12.3%	236	1,597	1,833	12.9%
>30	282	1,436	1,718	16.4%	245	1,034	1,279	19.2%
Total	2,302	17,235	19,537	11.8%	1,437	9,708	11,145	12.9%

PJM will approve all transmission outage requests that are submitted on time and do not jeopardize the reliability of the PJM system. PJM will approve all transmission outage requests that are submitted late and are not expected to cause congestion on the PJM system and do not jeopardize the reliability of the PJM system. Each outage is studied and if it is expected to cause a constraint to exceed a limit, PJM will flag the outage ticket as “congestion expected.”<sup>201</sup>

After PJM determines that a late request may cause congestion, PJM informs the transmission owner of solutions available to eliminate the congestion. For example, if a generator planned or maintenance outage request is contributing to the congestion, PJM can request that the generation owner defer the outage. If no solutions are available, PJM may require the transmission owner to reschedule or cancel the outage.

Table 12-66 is a summary of outage requests by congestion status. Of all outage requests submitted to occur in the first seven months of the 2024/2025 planning period, 10.3 percent were expected to cause congestion. Of all the outage requests that were expected to cause congestion, 5.4 percent (62 out of 1,162) were denied by PJM in the first seven months of the 2024/2025 planning period and 20.1 percent (231 out of 1,152) were cancelled (Table 12-68). Of all outage requests submitted to occur in the 2023/2024 planning period, 7.8 percent were expected to cause congestion. Of all the outage requests that were expected to cause congestion, 4.1 percent (62 out of 1,520) were denied by PJM in the 2023/2024 planning period and 17.9 percent (272 out of 1,520) were cancelled (Table 12-68).

**Table 12-66 Transmission facility outage requests by congestion: June 2023 through December 2024**

Planned Duration (Days)	2023/2024 (12 months)				2024/2025 (7 months)			
	Congestion Expected	No Congestion Expected	Total	Percent Congestion Expected	Congestion Expected	No Congestion Expected	Total	Percent Congestion Expected
<=5	1,052	13,864	14,916	7.1%	786	7,247	8,033	9.8%
>5 &lt;=30	309	2,594	2,903	10.6%	241	1,592	1,833	13.1%
>30	159	1,559	1,718	9.3%	125	1,154	1,279	9.8%
Total	1,520	18,017	19,537	7.8%	1,152	9,993	11,145	10.3%

Table 12-67 shows the outage requests summary by received status, congestion status and emergency status. In the first seven months of the 2024/2025 planning period, 28.4 percent of requests were submitted late and were nonemergency while 1.8 percent of requests (200 out of 11,145) were late, nonemergency, and expected to cause congestion. In the 2023/2024 planning period, 26.4 percent of requests were submitted late and were nonemergency while 1.2 percent of requests (229 out of 19,537) were late, nonemergency, and expected to cause congestion.

**Table 12-67 Transmission facility outage requests by received status, emergency and congestion: June 2023 through December 2024**

Received Status	2023/2024 (12 months)				2024/2025 (7 months)			
	Congestion Expected	No Congestion Expected	Total	Percent of Total	Congestion Expected	No Congestion Expected	Total	Percent of Total
Late								
Emergency	94	2,173	2,267	11.6%	78	1,345	1,423	12.8%
Non Emergency	229	4,931	5,160	26.4%	200	2,960	3,160	28.4%
On Time								
Emergency	6	29	35	0.2%	1	13	14	0.1%
Non Emergency	1,191	10,884	12,075	61.8%	873	5,675	6,548	58.8%
Total	1,520	18,017	19,537	100.0%	1,152	9,993	11,145	100.0%

<sup>201</sup> PJM added this definition to Manual 38 in February 2017. PJM, “Manual 38: Operations Planning,” Rev. 18 (Jan. 24, 2024).

Once PJM processes an outage request, the outage request is labelled as Submitted, Received, Denied, Approved, Cancelled by Company, PJM Admin Closure, Revised, Active or Complete according to the processed stage of a request.<sup>202</sup> Table 12-68 shows the detailed process status for outage requests only for the outage requests that are expected to cause congestion. Status Submitted and status Received are in the In Process category and status Cancelled by Company and status PJM Admin Closure are in the Cancelled category in Table 12-68. Table 12-68 shows that of all the outage requests that were expected to cause congestion, 5.4 percent (62 out of 1,152) were denied by PJM in the first seven months of the 2024/2025 planning period, 63.7 percent were complete and 20.1 percent (231 out of 1,152) were cancelled. Of all the outage requests that were expected to cause congestion, 4.1 percent (62 out of 1,520) were denied by PJM in the 2023/2024 planning period, 69.8 percent were complete and 17.9 percent (272 out of 1,520) were cancelled.

**Table 12-68 Transmission facility outage requests by processed status<sup>203</sup>: June 2023 through December 2024**

		2023/2024 (12 months)						2024/2025 (7 months)					
Received Status		Cancelled	Complete	In Process	Denied	Congestion Expected	Percent Complete	Cancelled	Complete	In Process	Denied	Congestion Expected	Percent Complete
Late	Emergency	2	88	2	2	94	93.6%	9	65	3	1	78	83.3%
	Non Emergency	34	164	11	16	229	71.6%	33	137	13	16	200	68.5%
On Time	Emergency	1	4	0	0	6	66.7%	0	1	0	0	1	100.0%
	Non Emergency	235	811	85	44	1,191	68.1%	189	532	101	45	873	60.9%
Total		272	1,067	98	62	1,520	70.2%	231	735	117	62	1,152	63.8%

There are clear rules defined for assigning On Time or Late status for submitted outage requests in both the PJM tariff and PJM manuals.<sup>204</sup> The On Time or Late status affects the way in which PJM addresses the potential to exceed transmission limits. Table 12-68 shows that in the first seven months of the 2024/2025 planning period, 200 nonemergency outage requests were submitted late and expected to cause congestion. The expected impact on congestion and the options for controlling that congestion is the basis for PJM's treatment of late outage requests.

The definition of this congestion analysis in the PJM manuals is about physical limits and not about economic congestion. PJM approves on time outages based solely on whether limits are exceeded and available controlling actions, without regard to the resulting level of economic congestion. The MMU recommends that PJM draft a definition of the congestion analysis required for transmission outage requests and associated triggers, including both the extent of overloaded facilities and the level of economic congestion, to include in PJM manuals after appropriate review with appropriate rules for on time and late outage requests.<sup>205</sup>

The treatment by PJM and Dominion Virginia Power of the outage for the Lanexa – Dunnsville Line illustrates some of the issues with the current process. The outage was submitted and delayed more than once. It is not clear that PJM's analysis of expected congestion identified or highlighted the magnitude of the economic impact. Dominion Virginia Power did not stage the outage so as to minimize market disruption and congestion. After high congestion costs of Greys Point - Harmony Village constraint and market participant manipulative behavior caused by the outage were identified by the end of January, on February 11, 2022 Dominion decided to temporarily terminate the outage in March in order to work on upgrading Greys Point, Harmony Village and White Stone path. The Greys Point - Harmony Village Line has not been binding since March 14, 2022. It indicates that if the market impact of the outage was identified during PJM outage analysis process and action was taken because of the analysis result, the high congestion costs and manipulative behavior could have been prevented.

<sup>202</sup> See PJM Markets & Operations, PJM Tools "Outage Information," <<http://www.pjm.com/markets-and-operations/etools/oasis/system-information/outage-info.aspx>> (2019).

<sup>203</sup> The number of denied transmission outage requests is lower than calculated by PJM the MMU includes only the transmission outage requests with "Denied" as a final status, while PJM included both transmission outage requests with "Denied" as a final status and transmission outage requests with "Denied" as an intermediate status.

<sup>204</sup> OA Schedule 1 § 1.9.2.

<sup>205</sup> "PJM Manual 38: Operations Planning," Rev. 18 (Jan. 24, 2024), p. 21. Manual 38 states: "The outages are analyzed for reliability and expected off-costs. Each outage is studied and any constraints (actual or facility/contingency pair) trending toward a limit or exceeding a limit is noted in eDART. The trending or exceeding of a limit in the study is referred to as potential "congestion". The limit may be any or a combination of thermal, voltage, or stability issues. If there is an expected constraint, PJM will mark the corresponding eDART ticket as "congestion expected". The "congestion expected" flag is used to indicate a potential issue that may occur in the Day-Ahead Market or in Real-time Operations. If there are non-cost controlling actions, changes to the generation pattern, or changes to system conditions, the noted congestion may not occur in the Day-Ahead Market or in Real-time Operations. For "On-time" outages, PJM ensures the constraint can be mitigated by applying both non-cost and off-cost operations. If there are no limit exceedances as a result, the outage will be approved. For "Late" outages, PJM will apply only non-cost operations."

## Rescheduling Transmission Facility Outage Requests

A TO can reschedule or cancel an outage after initial submission. Table 12-69 is a summary of all the outage requests planned for the 2023/2024 planning period and the first seven months of the 2024/2025 planning period which were approved and then cancelled or rescheduled by TOs at least once. If an outage request was submitted, approved and subsequently rescheduled at least once, the outage request will be counted as Approved and Rescheduled. If an outage request was submitted, approved and subsequently cancelled at least once, the outage request will be counted as Approved and Cancelled. In the first seven months of the 2024/2025 planning period, 30.8 percent of transmission outage requests were approved by PJM and then rescheduled by the TOs, and 12.4 percent of the transmission outages were approved by PJM and subsequently cancelled by the TOs. In the 2023/2024 planning period, 29.3 percent of transmission outage requests were approved by PJM and then rescheduled by the TO, and 12.2 percent of the transmission outages were approved by PJM and subsequently cancelled by the TO.

**Table 12-69 Rescheduled and cancelled transmission outage requests: June 2023 through December 2024**

Planned Duration (Days)	2023/2024 (12 months)					2024/2025 (7 months)				
	Outage Requests	Approved and Rescheduled	Percent Approved and Rescheduled	Approved and Cancelled	Percent Approved and Cancelled	Outage Requests	Approved and Rescheduled	Percent Approved and Rescheduled	Approved and Cancelled	Percent Approved and Cancelled
<=5	14,916	3,029	20.3%	2,095	14.0%	8,033	1,755	21.8%	1,199	14.9%
>5 &lt;=30	2,903	1,608	55.4%	202	7.0%	1,833	961	52.4%	135	7.4%
>30	1,718	1,117	65.0%	87	5.1%	1,279	718	56.1%	47	3.7%
Total	19,537	5,754	29.5%	2,384	12.2%	11,145	3,434	30.8%	1,381	12.4%

If a requested outage is determined to be late and TO reschedules the outage, the outage will be reevaluated by PJM again as On Time or Late.

A transmission outage ticket with duration of five days or less with an On Time status can retain its On Time status if the outage is rescheduled within the original scheduled month.<sup>206</sup> This rule allows a TO to reschedule within the same month with very little notice.

A transmission outage ticket with a duration exceeding five days with an On Time status can retain its On Time status if the outage is rescheduled to a future month, and the revision is submitted by the first of the month prior to the revised month in which the outage will occur.<sup>207</sup>

<sup>206</sup> PJM, "Manual 3: Transmission Operations," Rev. 67 (Nov. 21, 2024).

<sup>207</sup> *Id.*

This rescheduling rule is much less strict than the rule that applies to the first submission of outage requests with similar duration. When first submitted, the outage request with a duration exceeding five days needs to be submitted before the first of the month six months prior to the month in which the outage was expected to occur. The rescheduling rule allows TOs to avoid the timing requirements associated with outages exceeding five days.

The MMU recommends that PJM reevaluate all transmission outage tickets as on time or late as if they were new requests when an outage is rescheduled, create options for late requests based on the reasons, and apply the modified rules for late submissions to any such outages. The MMU recommends that PJM create options for treatment of late outages. The current rules apply more stringent rules, based on controlling actions, to late outages without distinguishing among reasons for late outages.

## Long Duration Transmission Facility Outage Requests

PJM rules (Table 12-63) define a transmission outage request as On Time or Late based on the planned

outage duration and the time of submission. The rule has stricter submission requirements for transmission outage requests planned for longer than 30 days. In order to avoid the stricter submission requirement, some transmission owners divided the duration of outage requests longer than 30 days into shorter segments for the same equipment and submitted one request for each segment. The MMU recommends that PJM not permit transmission owners to divide long duration outages into smaller segments to avoid complying with the requirements for long duration outages.

More than one outage request can be submitted for the same transmission equipment. In order to accurately

present the results, Table 12-70 shows equipment outages by the equipment instead of by outage request.

Table 12-70 shows that there were 7,989 transmission equipment planned outages in the first seven months of the 2024/2025 planning period, of which 1,133 or 14.2 percent were longer than 30 days, and of which 105 or 1.3 percent were scheduled longer than 30 days when the duration of all the outage requests are combined for the same equipment.

**Table 12-70 Transmission equipment outages: June 2023 through December 2024**

2023/2024 (12 months)				2024/2025 (7 months)	
Planned Duration (Days)	Divided into Shorter Periods	Count of Equipment with Planned Outages	Percent of Total	Count of Equipment with Planned Outages	Percent of Total
> 30	No	1,493	11.9%	1,133	14.2%
	Yes	262	2.1%	105	1.3%
<= 30		10,752	86.0%	6,751	84.5%
Total		12,507	100.0%	7,989	100.0%

Table 12-71 shows the details of long duration (> 30 days) outages when combining the duration of the outage requests for the same equipment.<sup>208</sup> The actual duration of scheduled outages would be longer than 30 days if the duration of the outage requests was appropriately combined for the same equipment. An effective duration was calculated for each piece of equipment by subtracting the start date of the earliest outage request from the end date of the latest outage request of the equipment. In the first seven months of the 2024/2025 planning period, within effective duration greater than a month and shorter than two months, there were 38 outages with a combined duration longer than 30 days.

**Table 12-71 Transmission equipment outages by effective duration: June 2023 through December 2024**

2023/2024 (12 months)			2024/2025 (7 months)	
Effective Duration of Outage	Count of Equipment with Planned Outages	Percent of Total	Count of Equipment with Planned Outages	Percent of Total
<=31	6	2.3%	3	2.9%
>31 & <=62	34	13.0%	38	36.2%
>62 & <=93	19	7.3%	18	17.1%
>93	203	77.5%	46	43.8%
Total	262	100.0%	105	100.0%

<sup>208</sup> A transmission facility is modeled as equipment in the EMS model. Equipment has three identifiers: location (B1), voltage level (B2) and equipment name (B3). The types of equipment include, for example, lines, transformers, and capacitors. There can be multiple outage requests associated with the same equipment.

## Transmission Facility Outage Analysis for the FTR Market

Transmission facility outages affect the price and quantity outcomes of FTR Auctions. The purpose of the rules governing outage reporting is to ensure that outages are known with enough lead time prior to FTR Auctions so that market participants can understand market conditions and PJM can accurately model market conditions.

There are Long Term, Annual and Monthly Balance of Planning Period auctions in the FTR Market. For each type of auction, PJM includes a set of outages to be modeled.

### Annual FTR Market

The Annual FTR Market includes the Annual ARR Allocation and the Annual FTR Auction. When determining

transmission outages to be modeled in the simultaneous feasibility test used in the Annual FTR Market, PJM considers all outages with planned duration longer than or equal to two weeks as an initial list. Then PJM may exercise significant discretion in selecting outages to be modeled in the final model. PJM posts the final FTR outage list to the FTR web page usually at least one week before the auction bidding opening day.<sup>209</sup>

In the first four months of the 2024/2025 planning period, 224 outage requests were included in the annual FTR market outage list and 6,228 outage requests were not included.<sup>210</sup> In the 2023/2024 planning period, 393 outage requests were included in the annual FTR market outage list and 19,142 outage requests were not included. Table 12-72, Table 12-73, Table 12-74 and Table 12-75 show the summary information on the modeled outage requests and Table 12-76 and Table 12-77 show the summary information on outages that were not included in the Annual FTR Market.

<sup>209</sup> PJM Financial Transmission Rights, "Annual ARR Allocation and FTR Auction Transmission Outage Modeling," <<https://www.pjm.com/-/media/markets-ops/ftr/annual-ftr-auction/2018-2019/2018-2019-annual-outage-modeling.ashx?la=en>> (April 5, 2018). There is no documentation on the deadline for when modeling outages should be posted on the PJM website.

<sup>210</sup> PJM's treatment of transmission outages in the FTR models is discussed in the *2024 Quarterly State of the Market Report for PJM: January through June*, Section 13: FTRs and ARRs, Supply and Demand.

Table 12-72 shows that 25.6 percent of the outage requests modeled in the Annual FTR Market for the first seven months of the 2024/2025 planning period had a planned duration of less than two weeks and that 19.3 percent of the outage requests (64 out of 332) modeled in the Annual FTR Market for the planning period were submitted late according to outage submission rules. It also shows that 29.3 percent of the outage requests modeled in the Annual FTR Market for the 2023/2024 planning period had a planned duration of less than two weeks and that 17.0 percent of the outage requests (67 out of 393) modeled in the Annual FTR Market for the planning period were submitted late according to outage submission rules.

**Table 12-72 Annual FTR market modeled transmission facility outage requests by received status: June 2023 through December 2024**

Planned Duration	2023/2024 (12 months)				2024/2025 (7 months)			
	On Time	Late	Total	Percent of Total	On Time	Late	Total	Percent of Total
<2 weeks	100	15	115	29.3%	77	8	85	25.6%
>=2 weeks & <2 months	102	19	121	30.8%	91	16	107	32.2%
>=2 months	124	33	157	39.9%	100	40	140	42.2%
Total	326	67	393	100.0%	268	64	332	100.0%

Table 12-73 shows the annual FTR market modeled outage requests summary by emergency status and received status. Three of the annual FTR market modeled outages expected to occur in the first seven months of the 2024/2025 planning period were emergency outages. Four of the modeled outages expected to occur in the 2023/2024 planning period were emergency outages.

**Table 12-73 Annual FTR market modeled transmission facility outage requests by emergency: June 2023 through December 2024**

Received Status	Planned Duration	2023/2024 (12 months)				2024/2025 (7 months)			
		Emergency	Non Emergency	Total	Percent Non Emergency	Emergency	Non Emergency	Total	Percent Non Emergency
On Time	<2 weeks	0	100	100	100.0%	0	77	77	100.0%
	>=2 weeks & <2 months	0	102	102	100.0%	1	90	91	98.9%
	>=2 months	1	123	124	99.2%	0	100	100	100.0%
	Total	1	325	326	99.7%	1	267	268	99.6%
Late	<2 weeks	1	14	15	93.3%	0	8	8	100.0%
	>=2 weeks & <2 months	0	19	19	100.0%	0	16	16	100.0%
	>=2 months	3	30	33	90.9%	3	37	40	92.5%
	Total	4	63	67	94.0%	3	61	64	95.3%

PJM determines expected congestion for both On Time and Late outage requests. A Late outage request may be denied or cancelled if it is expected to cause congestion. Table 12-74 shows a summary of requests by expected congestion and received status. Of all the annual FTR market modeled outages expected to occur in the first seven months of the 2024/2025 planning period and submitted late, 14.1 percent (9 out of 64) were expected to cause congestion. Of all the annual FTR market modeled outages expected to occur in the 2023/2024 planning period and submitted late, 14.9 percent (10 out of 67) were expected to cause congestion.



**Table 12-74 Annual FTR market modeled transmission facility outage requests by congestion: June 2023 through December 2024**

Received Status	Planned Duration	2023/2024 (12 months)				2024/2025 (7 months)			
		Congestion Expected	No Congestion Expected	Total	Percent Congestion Expected	Congestion Expected	No Congestion Expected	Total	Percent Congestion Expected
On Time	<2 weeks	27	73	100	27.0%	20	57	77	26.0%
	>=2 weeks & <2 months	27	75	102	26.5%	25	66	91	27.5%
	>=2 months	27	97	124	21.8%	23	77	100	23.0%
	Total	81	245	326	24.8%	68	200	268	25.4%
Late	<2 weeks	2	13	15	13.3%	2	6	8	25.0%
	>=2 weeks & <2 months	5	14	19	26.3%	2	14	16	12.5%
	>=2 months	3	30	33	9.1%	5	35	40	12.5%
	Total	10	57	67	14.9%	9	55	64	14.1%

Table 12-75 shows that 18.7 percent of outage requests modeled in the annual FTR market for the first seven months of the 2024/2025 planning period and with a duration of two weeks or longer but shorter than two months were cancelled after the FTR auction was open, compared to 24.0 percent for the 2023/2024 planning period. Table 12-75 also shows that 19.3 percent of outages requests modeled in the Annual FTR Market for the first seven months of the 2024/2025 planning period and with a duration of two months or longer were cancelled, compared to 22.3 percent for the 2023/2024 planning period.

**Table 12-75 Annual FTR market modeled transmission facility outage requests by processed status: June 2023 through December 2024**

Planned Duration	Processed Status	2023/2024 (12 months)		2024/2025 (7 months)	
		Outage Requests	Percent	Outage Requests	Percent
<2 weeks	In Progress	9	7.8%	5	5.9%
	Denied	0	0.0%	1	1.2%
	Approved	0	0.0%	1	1.2%
	Cancelled	26	22.6%	24	28.2%
	Active	0	0.0%	0	0.0%
	Completed	80	69.6%	54	63.5%
	Total	115	100.0%	85	100.0%
>=2 weeks & <2 months	In Progress	13	10.7%	23	21.5%
	Denied	0	0.0%	0	0.0%
	Approved	1	0.8%	2	1.9%
	Cancelled	29	24.0%	20	18.7%
	Active	0	0.0%	0	0.0%
	Completed	78	64.5%	62	57.9%
	Total	121	100.0%	107	100.0%
>=2 months	In Progress	22	14.0%	23	16.4%
	Denied	0	0.0%	1	0.7%
	Approved	1	0.6%	1	0.7%
	Cancelled	35	22.3%	27	19.3%
	Active	8	5.1%	24	17.1%
	Completed	91	58.0%	64	45.7%
	Total	157	100.0%	140	100.0%
Total Cancelled		90	22.9%	71	21.4%
Grand Total		393		332	

More outage requests were not modeled in the Annual FTR Market than were modeled in the Annual FTR Market. In the first seven months of the 2024/2025 planning period, 332 outage requests were modeled and 10,813 outage requests were not modeled in the Annual FTR Market. In the 2023/2024 planning period, 393 outage requests were modeled and 19,144 outage requests were not modeled in the Annual FTR Market.

Table 12-76 shows that 14.8 percent of outage requests not modeled in the Annual FTR Auction with duration longer than or equal to two months, labeled On Time according to the rules, were submitted or rescheduled after the Annual

FTR Auction bidding opening date in the first seven months of the 2024/2025 planning period compared to 15.9 percent in the 2023/2024 planning period.

**Table 12-76 Transmission facility outage requests not modeled in Annual FTR Auction: June 2023 through December 2024**

Planned Duration	2023/2024 (12 months)						2024/2025 (7 months)					
	On Time			Late			On Time			Late		
	Before Bidding Opening Date	After Bidding Opening Date	Percent After	Before Bidding Opening Date	After Bidding Opening Date	Percent After	Before Bidding Opening Date	After Bidding Opening Date	Percent After	Before Bidding Opening Date	After Bidding Opening Date	Percent After
<2 weeks	1,796	8,700	82.9%	216	5,592	96.3%	1,701	3,798	69.1%	163	3,266	95.2%
>=2 weeks & <2 months	660	401	37.8%	142	763	84.3%	508	111	17.9%	127	476	78.9%
>=2 months	191	36	15.9%	268	379	58.6%	150	26	14.8%	245	242	49.7%
Total	2,647	9,137	77.5%	626	6,734	91.5%	2,359	3,935	62.5%	535	3,984	88.2%

Table 12-77 shows that 94.6 percent of late outage requests that were submitted after the Annual FTR Auction bidding opening date, were not modeled in the Annual FTR Auction, and had a duration longer than or equal to two months, were completed in the first seven months of the 2024/2025 planning period. It also shows that 85.5 percent of late outage requests which were not modeled in the Annual FTR Auction with duration longer than or equal to two months and submitted after the Annual FTR Auction bidding opening date were active or completed in the 2023/2024 planning period.

**Table 12-77 Late transmission facility outage requests: June 2023 through December 2024**

Planned Duration	2023/2024 (12 months)			2024/2025 (7 months)		
	Completed Outages	Total	Percent Complete	Completed Outages	Total	Percent Complete
<2 weeks	4,861	5,592	86.9%	2,776	3,266	85.0%
>=2 weeks & <2 months	630	763	82.6%	399	476	83.8%
>=2 months	324	379	85.5%	229	242	94.6%
Total	5,815	6,734	86.4%	3,404	3,984	85.4%

Although the definition of late outages was developed in order to prevent outages for the planning period being submitted after the opening of bidding in the Annual FTR Auction, the rules have not functioned effectively because the rule has no direct connection to the date on which bidding opens for the Annual FTR Auction. By requiring all long-duration transmission outages to be submitted before February 1, PJM outage submission rules only prevent long-duration transmission outages from being submitted late. The rule does not address the situation in which long-duration transmission outages are submitted on time, but are rescheduled so that they are late. There is no rule to address the situation in

which short-duration outages (duration <= 5 days) are submitted on time, but are changed to long-duration transmission outages after the outages are approved and active. The Annual FTR Auction model may consider transmission outages planned for longer than two weeks but less than two months. Those outages not only include

long duration outages but also include outages shorter than 30 days. In those cases, PJM outage submission rules failed to prevent those transmission outages from being submitted late. The MMU recommends that PJM create options for late requests based on the reasons, and modify the rules to reduce or eliminate the approval of late outage requests submitted or rescheduled after the FTR auction opening date, based on those options.

## Monthly FTR Market

When determining transmission outages to be modeled in the Monthly Balance of Planning Period FTR Auction, PJM considers all outages with planned duration longer than five days and may consider outages with planned durations less than or equal to five days. PJM exercises significant discretion in selecting outages to be modeled. PJM posts an FTR outage list to the FTR webpage usually at least one week before the auction bidding opening day.<sup>211</sup> Table 12-78 and Table 12-79 show the summary information on outage requests modeled in the Monthly Balance of Planning Period FTR Auction and Table 12-80 and Table 12-81 show the summary information on outage requests not modeled in the Monthly Balance of Planning Period FTR Auction.

Table 12-78 shows that on average, 30.2 percent of the outage requests modeled in the Monthly Balance of

<sup>211</sup> PJM Financial Transmission Rights, "2015/2016 Monthly FTR Auction Transmission Outage Modeling," <<http://www.pjm.com/-/media/markets-ops/ftr/ftr-allocation/monthly-ftr-auctions/2015-2016-monthly-transmission-outages-that-may-cause-infeasibilities.ashx?la=en>> (December 9, 2015).

Planning Period FTR Auction were submitted late according to outage submission rules in the first seven months of the 2024/2025 planning period. On average, 27.9 percent of the outage requests modeled in the Monthly Balance of Planning Period FTR Auction were submitted late according to outage submission rules in the 2023/2024 planning period.

**Table 12-78 Monthly Balance of Planning Period FTR Auction modeled transmission facility outage requests by received status: June 2023 through December 2024**

Month	2023/2024				2024/2025			
	On Time	Late	Total	Percent Late	On Time	Late	Total	Percent Late
Jun	244	106	350	30.3%	272	134	406	33.0%
Jul	129	83	212	39.2%	154	100	254	39.4%
Aug	148	71	219	32.4%	211	101	312	32.4%
Sep	440	117	557	21.0%	488	175	663	26.4%
Oct	620	165	785	21.0%	542	190	732	26.0%
Nov	481	170	651	26.1%	511	197	708	27.8%
Dec	423	155	578	26.8%	359	127	486	26.1%
Jan	231	76	307	24.8%				
Feb	253	117	370	31.6%				
Mar	406	139	545	25.5%				
Apr	518	183	701	26.1%				
May	440	187	627	29.8%				
Average	361	131	492	27.9%	362	146	509	30.2%

Table 12-79 shows that on average, 19.1 percent of outage requests modeled in the Monthly Balance of Planning Period FTR Auction were cancelled in the first four months of the 2024/2025 planning period. On average, 19.1 percent of outage requests modeled in the Monthly Balance of Planning Period FTR Auction were cancelled in the 2023/2024 planning period.

**Table 12-79 Monthly Balance of Planning Period FTR Auction modeled transmission facility outage requests by processed status: June 2023 through December 2024**

Planning Year	Month	In							Percent	
		Process	Denied	Approved	Cancelled	Revised	Active	Complete	Total	Cancelled
2023/2024	Jun	21	1	10	59	0	71	188	350	16.9%
	Jul	23	7	14	38	1	57	72	212	17.9%
	Aug	16	4	12	43	0	62	82	219	19.6%
	Sep	60	8	12	107	1	175	194	557	19.2%
	Oct	71	3	17	168	0	214	312	785	21.4%
	Nov	58	6	15	119	0	199	254	651	18.3%
	Dec	57	6	16	111	1	90	297	578	19.2%
	Jan	40	8	13	56	2	93	95	307	18.2%
	Feb	42	0	9	60	0	117	142	370	16.2%
	Mar	56	4	11	102	0	142	230	545	18.7%
	Apr	74	10	23	143	0	167	284	701	20.4%
	May	52	7	19	120	2	136	291	627	19.1%
	Average	48	5	14	94	1	127	203	492	19.1%
2024/2025	Jun	28	13	16	93	0	90	166	406	22.9%
	Jul	22	8	15	41	0	97	71	254	16.1%
	Aug	18	16	10	68	0	81	119	312	21.8%
	Sep	70	7	30	111	0	192	253	663	16.7%
	Oct	60	1	19	174	2	209	267	732	23.8%
	Nov	63	5	23	124	0	185	308	708	17.5%
	Dec	40	16	8	101	0	101	220	486	20.8%
	Average	35	11	18	78	0	115	152	409	19.1%

Table 12-80 shows that on average, 15.3 percent of outage requests not modeled in the Monthly Balance of Planning Period FTR Auction, labeled On Time according to the rules, were submitted after the monthly FTR auction bidding opening dates in the first seven months of the 2024/2025 planning period, compared to 10.3 percent in the 2023/2024 planning period. On average, 59.8 percent of outage requests not modeled in the Monthly Balance of Planning Period FTR Auction, labeled Late according to the rules, were submitted after the Monthly Balance of Planning Period FTR Auction bidding opening dates in the first seven months of the 2024/2025 planning period, compared to 57.6 percent in the 2023/2024 planning period.

**Table 12-80 Transmission facility outage requests not modeled in Monthly Balance of Planning Period FTR Auction: June 2023 through December 2024**

	2023/2024						2024/2025					
	On Time			Late			On Time			Late		
	Before Bidding Opening Date	After Bidding Opening Date	Percent After	Before Bidding Opening Date	After Bidding Opening Date	Percent After	Before Bidding Opening Date	After Bidding Opening Date	Percent After	Before Bidding Opening Date	After Bidding Opening Date	Percent After
Jun	765	65	7.8%	431	463	51.8%	684	151	18.1%	370	572	60.7%
Jul	363	62	14.6%	295	467	61.3%	438	152	25.8%	305	540	63.9%
Aug	402	60	13.0%	324	498	60.6%	455	105	18.8%	296	482	62.0%
Sep	856	89	9.4%	362	478	56.9%	985	103	9.5%	338	527	60.9%
Oct	1,073	90	7.7%	389	641	62.2%	1,120	124	10.0%	415	730	63.8%
Nov	931	89	8.7%	402	492	55.0%	724	74	9.3%	445	528	54.3%
Dec	676	73	9.7%	366	471	56.3%	604	115	16.0%	430	485	53.0%
Jan	679	112	14.2%	323	474	59.5%						
Feb	761	82	9.7%	357	417	53.9%						
Mar	1,235	126	9.3%	376	497	56.9%						
Apr	1,377	156	10.2%	426	591	58.1%						
May	1,297	129	9.0%	447	648	59.2%						
Average	868	94	10.3%	375	511	57.6%	716	118	15.3%	371	552	59.8%

Table 12-81 shows that on average, 68.3 percent of late outage requests which were not modeled in the Monthly Balance of Planning Period FTR Auction, submitted after the Monthly Balance of Planning Period FTR Auction bidding opening dates, were approved and completed in the first seven months of the 2024/2025 planning period, compared to 68.7 percent in the 2023/2024 planning period.

**Table 12-81 Late transmission facility outage requests: June 2023 through December 2024**

	2023/2024			2024/2025		
	Completed Outages	Total	Percent Complete	Completed Outages	Total	Percent Complete
Jun	324	463	70.0%	367	572	64.2%
Jul	329	467	70.4%	380	540	70.4%
Aug	350	498	70.3%	359	482	74.5%
Sep	340	478	71.1%	360	527	68.3%
Oct	415	641	64.7%	472	730	64.7%
Nov	310	492	63.0%	367	528	69.5%
Dec	332	471	70.5%	324	485	66.8%
Jan	309	474	65.2%			
Feb	285	417	68.3%			
Mar	350	497	70.4%			
Apr	390	591	66.0%			
May	482	648	74.4%			
Average	351	511	68.7%	376	552	68.3%

Table 12-81 shows that only 3.0 percent of all outage requests were modeled in the Annual FTR Auction in the first seven months of the 2024/2025 planning period, and 2.0 percent were modeled in the 2023/2024 planning period. For Monthly FTR Auctions in the first seven months of the 2024/2025 planning period, an average of 27.5 percent of all outage requests were modeled, and 25.7 percent were modeled in the 2023/2024 planning period.

**Table 12-82 FTR market modeled transmission facility outage requests: June 2023 through December 2024**

Planned Duration	2023/2024 (12 months)			2024/2025 (7 months)		
	Annual Modeled	Monthly Modeled	Total	Annual Modeled	Monthly Modeled	Total
<2 weeks	115	3,106	3,221	85	1,822	1,907
>=2 weeks & <2 months	121	1,342	1,463	107	798	905
>=2 months	157	577	734	140	441	581
Total	393	5,025	5,418	332	3,061	3,393
All outage requests			19,537			11,145
Percent of Modeled	2.0%	25.7%	27.7%	3.0%	27.5%	30.4%

## Transmission Facility Outage Analysis in the Day-Ahead Energy Market

Transmission facility outages also affect the energy market. Just as with the FTR market, it is critical that outages that affect the operating day are known prior to the submission of offers in the day-ahead energy market so that market participants can understand market conditions and PJM can accurately model market conditions in the day-ahead market. PJM requires transmission owners to submit changes to outages scheduled for the next two days no later than 09:30 am.<sup>212</sup>

There are three relevant time periods for the analysis of the impact of transmission outages on the energy market: before the day-ahead market is closed; when the day-ahead market save cases are created; and during the operating day. The list of approved or active outage requests before the day-ahead market is closed is available to market participants. The day-ahead market model uses outages included in the day-ahead market save cases as an input. The outages that actually occurred during the operating day are the outages that affect the real-time market. If the three sets of outages are the same, there is no potential impact on markets. If the three sets of outages differ, there is a potential negative impact on markets. For example, if the list of outages before the day-ahead market was closed was different from the list of outages that included in the day-ahead market save cases, the day-ahead market participant would have inconsistent outage information as what day-ahead market model used.

For example for the operating day of March 31, 2024, Figure 12-7 shows that: there were 503 approved or active outages seen by market participants before the day-ahead market was closed; there were 417 outage requests included in the day-ahead market model; there

were 385 outage requests included in both sets of outage; there were 118 outage requests approved or active before the day-ahead market was closed but not included as inputs in day-ahead market model; and there were 32 outage requests included in day-ahead market model but not available to market participants prior to the day-ahead market.


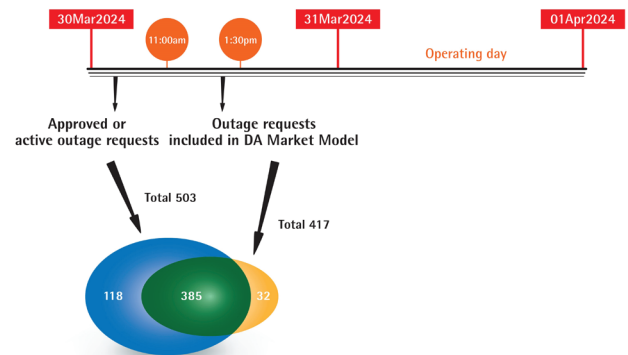
**Figure 12-7 Illustration of day-ahead market analysis: March 31, 2024**

Figure 12-8 compares the weekly average number of active or approved outages available to market participants prior to the close of the day-ahead market with the outages included as inputs to the day-ahead market by PJM. Figure 12-8 shows that the number of outages visible to market participants but excluded in the day-ahead model has decreased significantly for the 2023/2024 and 2024/2025 planning periods.

**Figure 12-8 Approved or active outage requests: January 2015 through December 2024**

<sup>212</sup> PJM, "Manual 3: Transmission Operations," Rev. 67 (Nov. 21, 2024).

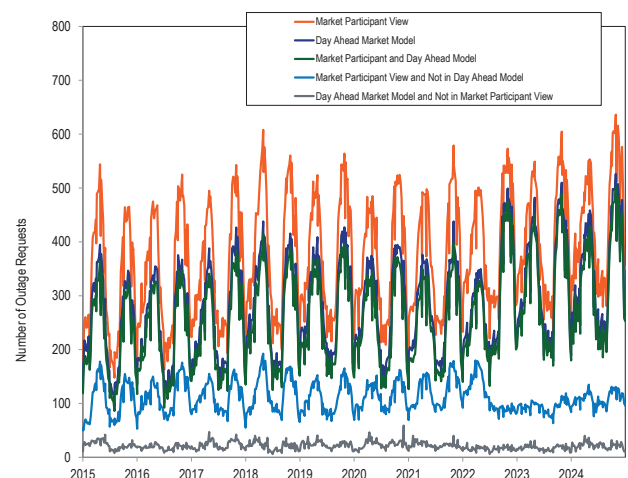

Figure 12-9 compares the weekly average number of outages included in the day-ahead market with the outages that actually occurred during the operating day. Figure 12-9 shows that in the latter half of the first nine months of 2024, the weekly average number of outages included in the day-ahead market as indicated by dark blue line was consistently higher than the weekly average number of outages indicated by orange line that actually occurred through the end of September 2024.

**Figure 12-9 Day-ahead market model outages: January 2015 through December 2024**

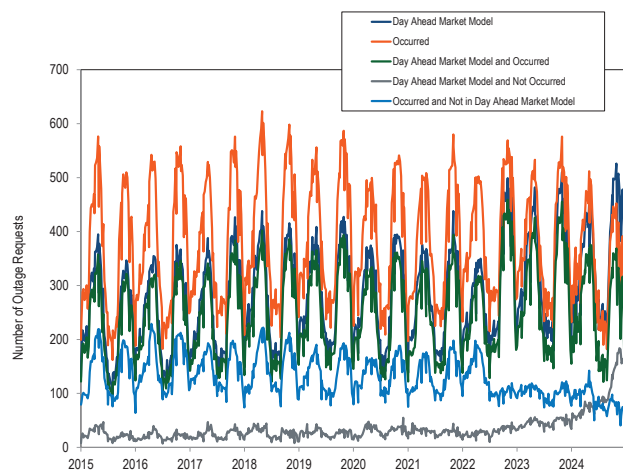


Figure 12-10 compares the weekly average number of active or approved outages for which information was available to market participants prior to the close of the day-ahead market with the outages that actually occurred during the operating day. Figure 12-4 shows a sharp quarterly increase of outages that are visible to market participants but do not occur, indicated by the lighter blue line in the last 2 weeks of June, September, December, and March beginning in 2017. In the second half of 2024, there was an increase in the number of outages shown to market participants in eDART, but many of these outages did not actually occur. It is not clear why PJM is including an increased number of outages in eDART when those outages did not actually occur.

**Figure 12-10 Approved or active outage requests: January 2015 through December 2024**

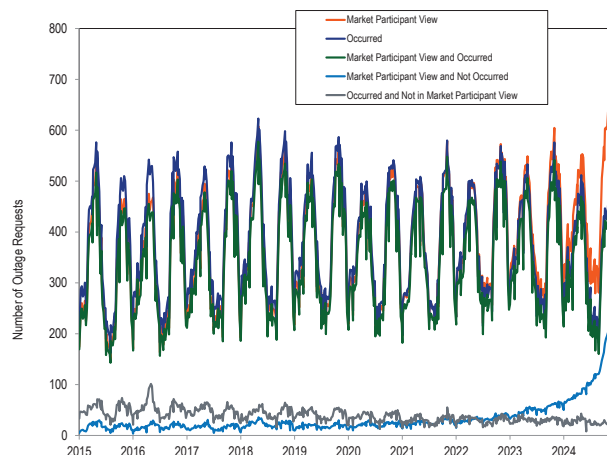


Figure 12-8, Figure 12-9, and Figure 12-10 show that on a weekly average basis, for the full year 2023 and the first nine months of 2024, the active or approved outages for which information was available to day-ahead market participants, the outages included as inputs in the day-ahead market model and the outages that actually occurred in real time are not consistent.

## Financial Transmission and Auction Revenue Rights

In an LMP market, the lowest cost generation is dispatched to meet the load, but when there are transmission constraints, load pays the high local price for all generation, including the low cost generation serving part of that load. The low cost generation receives payment only for its low local price and does not receive the payment made by load for the output of the low cost generation at the high local price. The result is that load pays the correct local price but pays too much in total for energy because it is paying more for the low cost generation than the low cost generation receives. Load pays the difference between the high local price and the low local price of the low cost generation. That payment is appropriately not made to the low cost generation which is paid its LMP. In an LMP market, load pays more than generation receives. FTRs are the mechanism for returning those excess payments to load. But the current FTR mechanism in PJM does not and cannot return all the excess payments to load. The FTR mechanism in PJM needs a significant redesign in order to achieve that objective. The FTR mechanism has become unduly complicated and has deviated significantly from its original purpose. Return of all the excess payments to load would result in a perfect hedge against congestion. The current FTR mechanism has significantly attenuated the value of the FTR/ARR design as a hedge against congestion for load.

The FTR mechanism should be a simple accounting method for assigning congestion rights to load. But PJM has added increasingly complex rules and regularly intervenes in the FTR mechanism as the PJM FTR design has moved further and further from these economic fundamentals. Some market participants have profited in various ways from these design flaws and those market participants now strongly defend the current design in the PJM stakeholder process and at FERC. The customers who ultimately pay congestion are generally not aware of the current, flawed FTR design and do not understand the extent to which the current design fails to offset their congestion payments compared to a fundamentally correct FTR design that would return congestion to load.

When the lowest cost generation is remote from load centers, the physical transmission system permits that

lowest cost generation to be delivered to load, subject to transmission limits. This was true prior to the introduction of LMP markets and continues to be true in LMP markets.

After the introduction of LMP markets in PJM, financial transmission rights (FTRs) were introduced, effective April 1, 1999, for the real-time market and June 1, 2000, for the combined day-ahead and real-time (balancing) markets. FTRs permitted the loads, which pay for the transmission system, to continue to receive the economic benefits of access to either local or remote low cost generation by returning congestion to the load.<sup>1</sup> FTRs and the associated congestion revenues were directly provided to load in recognition of the fact that, as a result of LMP, load was required to pay more for low cost generation than is paid to low cost generation. But there was a flaw built in from the very beginning of the PJM FTR design that had no significant impact initially but which was ultimately the source of all the issues with the FTR mechanism. That flaw was the idea that congestion was based on contract paths in a network system rather than a result of the actual operation of the complex network. Prior to the introduction of LMP markets, payment for the delivery of low cost generation to load was based both on intrazonal generation and intrazonal transmission, both under cost of service rates, and on contracts with specific remote generation outside the local zone and the associated point to point transmission contracts. Most load was served by intrazonal generation. In both cases, customers paid for the physical rights associated with the transmission system used to provide for the delivery of low cost generation to load. There was no congestion revenue because customers paid only the actual cost of the low cost generation. The flawed idea that congestion is based on contract paths was inconsistent with the most basic logic of LMP and the resultant fissure has continued to widen. FTRs were a core part of the LMP design. FTRs ensured that the introduction of locational marginal pricing would not result in overpayments by load. The origin of FTRs was the recognition that the way to hold load harmless from making the excess payments created by the LMP system was to return the excess payments to load. The rights to congestion belong to load. If implemented correctly, FTRs would be the financial equivalent of firm transmission service for load. If implemented correctly, FTRs would be a

<sup>1</sup> See 81 FERC ¶ 61,257 at 62,241 (1997).

perfect hedge against congestion for load. The result of the current FTR mechanism is a significant reduction in the value of FTRs as a hedge for load. The current FTR mechanism results in significant wealth transfers from the load that pays congestion to traders of FTRs and traders of virtuals. The current FTR mechanism results in uneven and arbitrary differences in the share of congestion returned to load, depending on location and PJM's assignment of ARR.

The notion that FTRs exist in order to provide a hedge for generation is a fallacy. In an LMP system, the basic incentive structure for generation derives from the fact that generation is paid the LMP at the generator bus. If generation were to be guaranteed a price at a distant constrained load bus rather than at the generation bus, there would be no incentive for generation to locate where it is needed on the system. In addition, the payment of the price at the generator bus is fundamental to the logic of locational marginal pricing which produces local prices equal to the marginal value of generation at every point. There is no logical or theoretical basis in locational marginal pricing for the assertion that generation at low price nodes is underpaid and should be paid more from congestion dollars. Generation does not pay congestion. Some generation receives a price lower than the system marginal price (SMP) and some generation receives a price greater than SMP, but that does not mean that generation is paying congestion. It means that generation is being paid an LMP that is higher or lower than the system load-weighted average LMP. If a generating unit wants a hedge, it may enter into an arm's length transaction with a willing counterparty as a hedge. That is the way hedges work in markets. That is not the purpose of FTRs.

In an LMP system, the only way to ensure that load receives the benefits associated with the use of the transmission system to deliver low cost energy is to use FTRs, or an equivalent mechanism, to pay back to load the difference between the total load payments and the total generation revenues. FTRs are a core theoretical part of the LMP design and were included in the PJM market design to offset the congestion costs that load pays in an LMP market. Congestion revenues are the source of the funds to pay FTRs. Congestion revenues should be assigned to the load that paid them through FTRs.<sup>2</sup> The only way to ensure that load receives the benefits associated with the use of the transmission system to

deliver low cost energy is to ensure that all congestion revenues are returned to load or, more precisely, that the rights to all congestion revenues are assigned to load. In order to do that, congestion payments must be defined correctly based on the way that power actually flows in the PJM network and not based on arbitrary contract paths.

Effective April 1, 1999, when FTRs were introduced with the LMP market, there was a real-time market but no day-ahead market, and FTRs returned real-time congestion revenue to load. Effective June 1, 2000, the day-ahead market was introduced and FTRs returned total congestion including day-ahead and real-time (balancing) congestion to load.<sup>3</sup> Congestion is the sum of day-ahead and balancing congestion. Effective June 1, 2003, PJM replaced the direct allocation of FTRs to load with an allocation of Auction Revenue Rights (ARRs). Under the ARR design, the load still owns the rights to congestion revenue, but the ARR design allows load to either claim the FTRs directly (through a process called self scheduling), or to sell the rights to congestion revenue in the FTR auction in exchange for a revenue stream based on the auction clearing prices of the FTRs. Under the ARR design, the right to all congestion revenues should belong to load and load should have the ability to retain or sell the congestion revenue rights on terms that load defines and accepts. The actual ARR implementation produces a very different result and fails to assign all congestion revenue rights to load.

ARRs were an add on concept, defined based on a misunderstanding of FTRs, which had its roots in the assignment of congestion to load using contract paths (generation to load paths) rather than on the calculation of congestion actually paid. Contract paths are a fiction in a network. ARRs used assumed contract paths to assign congestion to load. The use of contract paths for ARRs was a more critical mistake than using contract paths for FTRs because contract paths did not, do not, and cannot account for all congestion. The use of contract paths led to the mistaken conclusion that there was some excess congestion that did not belong to load and could be sold to FTR buyers. The ARR concept, as it is currently implemented, does not allow the FTR sellers, load, to establish a price at which they are willing to sell, but forces load to accept whatever prices buyers are willing to pay. The revenue from the sale of congestion

<sup>2</sup> See *id.* at 62, 259–62, 260 & n. 123.

<sup>3</sup> PJM refers to the combination of the day-ahead and real-time (balancing) markets as a two settlement system.

rights is not even paid in full to ARR holders. Sellers are required to return some of the cleared auction revenue to FTR buyers when FTR payments are less than target allocations. So called surplus revenue is paid to FTR holders to ensure payment, despite the fact that willing FTR buyers paid the revenues in the auction for the rights to an uncertain level of congestion.

The use of generation to load contract paths, rather than the direct calculation of congestion, led to an increased divergence between FTR target allocations on the generation to load contract paths and actual total congestion. This divergence between actual network use and historic contract paths was exacerbated as new zones were added with their own historic generation to load contract paths and as significant numbers of generating units retired and new units were added.<sup>4</sup> Rather than understanding that the divergence resulted from the fact that a contract path based approach did not correctly calculate congestion in a network system, especially as the system grew significantly, the issue was characterized as the existence of excess capacity on the transmission system. But congestion was never about capacity on the transmission system. Prior to the introduction of ARRs, the so called excess congestion that exceeded the congestion on the defined contract paths was returned to load, regardless of its source. There is no such thing as excess congestion. Congestion is congestion. In a well designed LMP/FTR system, all congestion is returned to load, neither more nor less. The overlay of ARRs on the FTR concept did not change the fundamental logic of congestion, but permitted the introduction of a system in which the divergence was formally created between the amount of congestion paid by load and the amount of congestion returned to load. Congestion belongs to the load, by definition. The introduction of ARRs based on the contract path fiction undermined the assignment of all congestion rights to load.

FTR revenue adequacy, like surplus congestion revenue, is a misnomer. FTR revenue adequacy, as defined in PJM rules, is an artifact of the flawed design of the current approach to FTR/ARRs. If FTRs only returned congestion to FTR holders, there could be no such thing as revenue inadequacy. As currently defined in PJM, FTR revenue adequacy simply compares day-

ahead congestion revenues to FTR target allocations. (Target allocations are the day-ahead CLMP differences, shadow prices, between the source and sink of the FTR times the MW of the FTR.) There is no reason to expect congestion revenues to equal FTR target allocations under the path based approach. There are systematic differences between FTR target allocations and actual congestion in aggregate and on a path by path basis. Revenue adequacy is not a benchmark for how well the FTR process is working. Target allocations are not congestion. FTR revenue adequacy is not equivalent to the adequacy of ARRs as an offset for load against total congestion. A path specific target allocation is not a guarantee of payment. Yet PJM treats target allocations as a guarantee of payment and takes what is termed surplus auction revenue from ARR holders (load) and gives it to FTR holders when day-ahead congestion revenues are not enough to cover all FTR target allocations.

The contract path fiction is also the source of the incorrect definition of the product that is bought and sold as FTRs, the available supply of the product and the price paid to the buyers of the product. The FTR product is defined as the difference in congestion prices in the day-ahead market only, across specific transmission contract paths (the shadow price), multiplied by the FTR MW position on those paths. That is the definition of FTR target allocation. The difference in congestion prices across contract paths is not congestion and is not equal to congestion revenues when multiplied by the FTR MW position. The MW quantity of the product made available for sale in the FTR auctions is defined as system capability, meaning the capacity of the transmission system to deliver power. But system capability is not actual market flows and system capability is not congestion and system capability is not the difference in congestion prices across transmission contract paths nor the potential for such difference. Congestion is defined as the difference in congestion prices across a path multiplied by the market flow on that path, recognizing both day-ahead and balancing market results. That is the measure of the amount load pays in excess of what generation receives. The definition of ARRs based on contract paths led to the mistaken idea that some transmission system capacity was used by ARRs but some was not and that both the ARR capability and the excess capacity was available for sale as FTRs. This fundamental confusion in the design of the market is

<sup>4</sup> For a comprehensive report on capacity retirements and capacity additions in PJM, see: "2020 PJM Generation Capacity and Funding Sources: 2007/2008 through 2021/2022," (September 15, 2020) available at <[http://www.monitoringanalytics.com/reports/Reports/2020/Constraint\\_Based\\_Congestion\\_Calculations\\_20200722.pdf](http://www.monitoringanalytics.com/reports/Reports/2020/Constraint_Based_Congestion_Calculations_20200722.pdf)>.



the source of so called revenue shortfalls, of the redesign of the market to exclude balancing congestion, and of the need for PJM to intervene in the market. PJM has had to regularly intervene in the market because the market as designed cannot reach equilibrium based on the economic fundamentals. The product, the quantity of the product, and the price of the product are all incorrectly defined.

The ARR/FTR design does not serve as an efficient mechanism for returning congestion to load as a result of an FTR design that was flawed from its introduction and as a result of various distortions added to the design since its introduction. The distortions include the definition of target allocations based on day-ahead price differences only, the fact that ARR holders cannot set the sale price for the congestion revenue rights they own, the return of market revenues to FTR buyers when profit targets are not met, the failure to assign all FTR auction revenues to ARR holders, the differences between modeled and actual system capability, the definition and allocation of surplus, and the numerous cross subsidies among participants. The fundamental distortion was the assignment of the rights to congestion revenue based on specific generation to load transmission contract paths. This approach retained the contract path based view of how load is served that is fundamentally inconsistent with the way load is actually served in a network system and therefore inconsistent with the role of FTRs in a nodal, network system with locational marginal pricing.

The cumulative offset of congestion by ARRs for the 2011/2012 planning period through the first seven months of the 2024/2025 planning period, using the rules effective for each planning period, was 69.6 percent. Only 69.6 percent of congestion was returned to load over this period. Load was underpaid by \$4.6 billion from the 2011/2012 planning period through the first seven months of the 2024/2025 planning period. This is an increase of \$0.6 billion in underpayment to load from the end of the 2023/2024 planning period through the first seven months of the 2024/2025 planning period.

The overall underassignment of congestion to load includes dramatically different results by zone. Load in some zones receives congestion revenues well in excess of the congestion they pay while the reverse is true for other zones.

If the original PJM FTR approach had been designed to return congestion revenues to load without use of the generation to load contract paths, and if the distortions subsequently introduced into the FTR design had not been added, many of the subsequent issues with the FTR design and complex redesigns would have been avoided. PJM would not have had to repeatedly intervene in the functioning of the FTR system in an effort to meet the artificial and incorrectly defined goal of revenue adequacy. The design should simply have provided for the return of all congestion revenues to load. The design should have also provided for the ability of load to sell the rights to congestion revenue. That sale could be organized as an FTR auction with the product and the price clearly defined. Now is a good time to address the issues of the FTR design and to return the design to its original purpose. This would eliminate much of the complexity associated with ARRs and FTRs and eliminate unnecessary controversy about the appropriate recipients of congestion revenues.

The *2024 Annual State of the Market Report for PJM* focuses on the first seven months of the 2024/2025 planning period as well as the 2024/2025 Long Term and Annual FTR auctions and ARR allocation, specifically covering June 1, 2024, through December 31, 2024. The Market Monitoring Unit (MMU) analyzed measures of market structure, participant conduct and market performance, including market size, concentration, offer behavior, and price. The MMU concludes that the PJM FTR auction market results were partially competitive in 2024.

**Table 13-1 The FTR/ARR markets results were partially competitive**

Market Element	Evaluation	Market Design
Market Structure	Competitive	
Participant Behavior	Partially Competitive	
Market Performance	Partially Competitive	Flawed

- Market structure was evaluated as competitive. The ownership of FTR obligations is unconcentrated for the individual years of the 2024/2027 Long Term FTR Auction, the 2024/2025 Annual FTR Auction and each period of the Monthly Balance of Planning Period Auctions for prevailing flow FTRs. The ownership of FTR options is moderately or highly concentrated for every Monthly FTR Auction period and unconcentrated for the 2024/2025 Annual FTR Auction. Ownership of FTRs is disproportionately



(75.3 percent) by financial participants. The ownership of ARRs is unconcentrated.

- Participant behavior was evaluated as partially competitive because ARR holders who are the sellers of FTRs have no option to set an acceptable sale price and are not permitted to participate in the market clearing in any way and are not assured they will receive 100 percent of auction revenues.
- Market performance was evaluated as partially competitive because of the significant and persistent flaws in the market design. Sellers, the ARR holders, cannot set a sale price. Buyers can reclaim some of their purchase price after the market clears if the product does not meet a profitability target. The market resulted in a substantial shortfall in congestion payments to load and significant and unsupportable disparities among zones in the share of congestion returned to load. FTR purchases by financial entities remain persistently profitable in part as a result of the flaws in the market design.
- Market design was evaluated as flawed because there are significant, fundamental and persistent flaws in the basic ARR/FTR design. The FTR auction market is not actually a market because the sellers have no independent role in the process. ARR holders cannot determine the price at which they are willing to sell rights to congestion revenue. Buyers have the ability to reclaim some of the price paid for FTRs after the market clears and, as a result, sellers are not assured they will receive 100 percent of auction revenues. The market design is not an efficient or effective way to ensure that the rights to all congestion revenues are assigned to load. The product sold to FTR buyers is incorrectly defined as target allocations rather than a share of congestion revenue. ARR holders' rights to congestion revenues are not correctly defined because the contract path based assignment of congestion rights is inadequate and incorrect. The ongoing PJM subjective intervention in the FTR market that affects market fundamentals is also an issue and a symptom of the fundamental flaws in the design. The product, the quantity of the product and the price of the product are all incorrectly defined.
- The fact that load is not able to define its willingness to sell FTRs or to set the prices at which it is willing to sell FTRs and the fact that load is required to

return some of the cleared auction revenue to FTR buyers when FTR profits are deemed to be not adequate, means that the FTR design does not actually function as a market and is evidence of basic flaws in the market design.

## Overview

### Auction Revenue Rights

#### Market Structure

- **ARR Ownership.** In the 2024/2025 planning period ARRs were allocated to 1,523 individual participants, held by 126 parent companies, up from 1,504 individual parents, held by 123 parent companies in the 2023/2024 planning period. ARR ownership for the 2024/2025 planning period was unconcentrated with an HHI of 610, down from 617 for the 2023/2024 planning period.

#### Market Behavior

- **Self Scheduled FTRs.** For the 2024/2025 planning period, 25.3 percent of eligible ARRs were self scheduled as FTRs, up from 24.1 percent for the 2023/2024 planning period.

#### Market Performance

- **ARRs as an Offset to Congestion.** ARRs have not served as an effective mechanism to return all congestion revenues to load. For the first seven months of the 2024/2025 planning period, ARRs and self scheduled FTRs offset 55.9 percent of total congestion. Congestion payments by load in some zones were more than offset and congestion payments in some zones were less than offset. Load has been underpaid congestion revenues by \$4.6 billion from the 2011/2012 planning period through the first seven months of the 2024/2025 planning period. The cumulative offset for that period was 69.6 percent of total congestion.
- **ARR Payments.** For the first seven months of the 2024/2025 planning period, the ARR target allocations, which are based on the nodal price differences from the Annual FTR Auction, were \$1,429.7 million, while PJM collected \$1,654.3 million from the combined Long Term, Annual and Monthly Balance of Planning Period FTR Auctions. For the 2023/2024 planning period, the

ARR target allocations were \$1,592.2 million while PJM collected \$1,874.5 million from the combined Annual and Monthly Balance of Planning Period FTR Auctions.

- **ARR.** For the first seven months of the 2024/2025 planning period there was not enough day-ahead congestion revenue to pay FTR target allocations. As a result, \$77.1 million of FTR auction revenue was transferred from ARR holders to FTR holders. Although PJM refers to this as a surplus, there is no such thing as surplus FTR auction revenue based on market logic. FTR Auction revenue results from the market prices paid by willing FTR buyers, should be paid to ARR holders, and should not be returned to FTR buyers for any reason.
- **Residual ARRs.** Residual ARRs are only available on contract paths prorated in Stage 1 of the annual ARR allocation, are only effective for single, whole months and cannot be self scheduled. Residual ARR clearing prices are based on monthly FTR auction clearing prices. Residual ARRs with negative target allocations are not allocated to participants. Instead they are removed and the model is rerun.

In the first seven months of the 2024/2025 planning period, PJM allocated a total of 12,242.3 MW of residual ARRs with a total target allocation of \$7.1 million, down from 15,045.3 MW, with a total target allocation of \$5.0 million, in the same period of the 2023/2024 planning period.

- **ARR Reassignment for Retail Load Switching.** There were 26,290 MW of ARRs associated with \$0.5 million of revenue that were reassigned for the first seven months of the 2024/2025 planning period. There were 34,601 MW of ARRs associated with \$0.8 million of revenue that were reassigned in the 2023/2024 planning period.

## Financial Transmission Rights

### Market Design

- **Monthly Balance of Planning Period FTR Auctions.** The design of the Monthly Balance of Planning Period FTR Auctions includes auctions for each remaining month in the planning period.

### Market Structure

- **Patterns of Ownership.** For the Monthly Balance of Planning Period Auctions, financial entities purchased 80.4 of all prevailing and counter flow FTRs, including 75.2 percent of prevailing flow and 86.8 percent of counter flow FTRs for the first seven months of the 2024/2025 planning period. Financial entities owned 75.3 percent of all prevailing and counter flow FTRs, including 69.0 percent of all prevailing flow FTRs and 83.4 percent of all counter flow FTRs during the first seven months of the 2024/2025 planning period. Self scheduled FTRs account for 4.4 percent of all FTRs held.
- **Market Concentration.** In the Monthly Balance of Planning Period Auctions for the first seven months of the 2024/2025 planning period, ownership of cleared prevailing flow bids was unconcentrated in all periods. Ownership of cleared counter flow bids was unconcentrated in 88.9 percent of periods and moderately concentrated in 11.1 percent of periods.

### Market Behavior

- **Sell Offers.** In a given auction, market participants can sell FTRs acquired in preceding auctions or preceding rounds of auctions. In the 2024/2027 Long Term FTR Auction, total participant FTR sell offers were 1,293,978 MW. In the 2024/2025 Annual FTR Auction, total participant FTR sell offers were 1,172,749 MW. In the Monthly Balance of Planning Period FTR Auctions for the first seven months of the 2024/2025 planning period, total participant FTR sell offers were 36,232,818 MW.
- **Buy Bids.** In the 2024/2027 Long Term FTR auction, total FTR buy bids were 5,729,618 MW, up 312.7 percent from 1,388,159 MW the previous long term auction. There were 4,770,381 MW of buy and self scheduled bids in the 2024/2025 Annual FTR Auction, up 26.4 percent from 3,773,919 MW the previous planning period. The total FTR buy bids from the Monthly Balance of Planning Period FTR Auctions for the first seven months of the 2024/2025 planning period were 48,161,694 MW.
- **FTR Forfeitures.** Total FTR forfeitures were \$1.96 million for the first seven months of the 2024/2025 planning period, up 20.2 percent from \$1.63 million for the first seven months of the 2023/2024 planning period.

- **Credit.** There were no collateral defaults and one payment default in 2024.

## Market Performance

- **Quantity.** In the 2024/2027 Long Term FTR Auction 638,671 MW (11.1 percent) of buy bids cleared and 139,507 MW (10.8 percent) of sell offers cleared. In the Annual FTR Auction for the 2024/2025 planning period 1,028,420 MW (21.6 percent) of buy and self scheduled bids cleared, up 17.1 percent from 878,232 (23.3 percent) for the previous planning period. In the first seven months of the 2024/2025 planning period, Monthly Balance of Planning Period FTR Auctions cleared 8,102,377 MW (16.8 percent) of FTR buy bids and 5,237,013 MW (14.5 percent) of FTR sell offers. For the 2023/2024 planning period, Monthly Balance of Planning Period FTR Auctions cleared 9,710,278 MW (14.5 percent) of FTR buy bids and 5,894,197 MW (16.2 percent) of FTR sell offers.
- **Price.** The weighted average buy bid FTR price in the 2024/2027 Long Term FTR Auction was \$0.07 per MW, down from \$0.13 from the 2023/2026 Long Term FTR Auction. The weighted average buy bid FTR price in the Annual FTR Auction for the 2024/2025 planning period was \$0.30 per MW, down from \$0.33 per MW in the 2023/2024 planning period. The weighted average buy bid cleared FTR price in the Monthly Balance of Planning Period FTR Auctions for all periods in the first seven months of the 2024/2025 planning period was \$0.44 per MWh, up from \$0.48 in the 2023/2024 planning period.
- **Revenue.** The 2024/2027 Long Term FTR Auction generated \$102.6 million of net revenue for all FTRs, down 44.4 percent from \$184.5 million from the 2023/2026 Long Term FTR Auction. The 2024/2025 Annual FTR Auction generated \$1,475.2 million in net revenue, down 12.9 percent from \$1,694.3 million for the 2023/2024 Annual FTR Auction. The Monthly Balance of Planning Period FTR Auctions resulted in net revenue of \$69.0 million in the first seven months of the 2024/2025 planning period, up 1.2 percent from \$68.1 million in the first seven months of the 2023/2024 planning period.
- **"Revenue Adequacy."** For the first seven months of the 2024/2025 planning period there was not enough day-ahead congestion revenue to pay FTR

target allocations. As a result, \$77.1 million of FTR auction revenue was transferred from ARR holders (load) to FTR holders, and FTRs were paid 100.0 percent of the target allocations for the first seven months of the 2024/2025 planning period. Based on market logic, there is no such thing as surplus FTR auction revenue and there is no such thing as revenue inadequacy.

- **Profitability.** FTR profitability is the difference between the revenue received directly from holding an FTR plus any revenue from the sale of an FTR, and the cost of buying the FTR. In the first seven months of the 2024/2025 planning period, profits for all participants were \$518.2 million, up from \$167.8 million in profits in the same time period in the 2023/2024 planning period. In the first seven months of the 2024/2025 planning period, physical entities received \$134.6 million in profits on FTRs purchased directly (not self scheduled), up from \$54.3 million profits in the same time period in the 2023/2024 planning period. Financial entities received \$383.5 million in profits, up from \$113.4 million profits in the same time period in the 2023/2024 planning period.

## Markets Timeline

Any PJM member can participate in the Long Term FTR Auction, the Annual FTR Auction and the Monthly Balance of Planning Period FTR Auctions.

Table 13-2 shows the date of first availability and final closing date for all annual ARR and FTR auctions.

**Table 13-2 Annual FTR auction dates**

Auction	Initial Open Date	Final Close Date
2024/2027 Long Term	6/1/2023	3/1/2024
2024/2025 ARR	2/28/2024	3/22/2024
2024/2025 Annual	4/3/2024	4/26/2024
2025/2028 Long Term	6/3/2024	3/3/2025

## Recommendations

### Market Design

- The MMU recommends that the current ARR/FTR design be replaced with defined congestion revenue rights (CRRs). A CRR is the right to actual congestion revenue that is paid by physical load at a specific bus, zone or aggregate. (Priority: High. First reported 2015. Status: Not adopted.)

### ARR

- The MMU recommends that the ARR/FTR design be modified to ensure that the rights to all congestion revenues are assigned to load. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that all historical generation to load paths be eliminated as a basis for assigning ARRs. The MMU recommends that the current design be replaced with a design in which the rights to actual congestion paid are assigned directly to the load that paid that congestion by node. (Priority: High. First reported 2015. Status: Partially adopted.)
- The MMU recommends that, under the current FTR design, the rights to all congestion revenue be allocated as ARRs prior to sale as FTRs. Reductions in allocated revenue as a contingency for outages and increased system capability should be reserved for ARRs rather than sold in the Long Term FTR Auction. (Priority: High. First reported 2017. Status: Not adopted.)
- The MMU recommends that IARRs be eliminated from PJM's tariff, but that if IARRs are not eliminated, IARRs should be subject to the same proration rules that apply to all other ARR rights. (Priority: Low. First reported 2018. Status: Not adopted.)

### FTR

- The MMU recommends that FTR funding be based on total congestion, including both day-ahead and balancing congestion. (Priority: High. First reported 2017. Status: Not adopted.)
- The MMU recommends that bilateral transactions be eliminated and that all FTR transactions occur in the PJM market. (Priority: High. First reported 2022. Status: Not adopted.)<sup>5</sup>

- The MMU recommends a requirement that the details of all bilateral FTR transactions be reported to PJM. (Priority: High. First reported 2020. Status: Not adopted.)
- The MMU recommends that PJM continue to evaluate the bilateral indemnification rules and any asymmetries they may create. (Priority: Low. First reported 2018. Status: Not adopted.)
- The MMU recommends that PJM reduce FTR sales on paths with persistent overallocation of FTRs, including a clear definition of persistent overallocation and how the reduction will be applied. (Priority: High. First reported 2013. Status: Partially adopted, 2014/2015 planning period.)
- The MMU recommends that PJM eliminate generation to generation paths and all other paths that do not represent the delivery of power to load. (Priority: High. First reported 2018. Status: Not adopted.)
- The MMU recommends that the Long Term FTR product be eliminated. If the Long Term FTR product is not eliminated, the Long Term FTR Market should be modified so that the supply of prevailing flow FTRs in the Long Term FTR Market is based solely on counter flow offers in the Long Term FTR Market. (Priority: High. First reported 2017. Status: Not adopted.)
- The MMU recommends that PJM improve transmission outage modeling in the FTR auction models, including the use of probabilistic outage modeling. (Priority: Low. First reported 2013. Status: Not adopted.)

### “Surplus”

- The MMU recommends that all FTR auction revenue be distributed to ARR holders monthly, regardless of FTR funding levels. (Priority: High. First reported 2015. Status: Not adopted.)
- The MMU recommends that, under the current FTR design, all congestion revenue in excess of FTR target allocations be distributed to ARR holders on a monthly basis. (Priority: High. First reported 2018. Status: Not adopted.)
- The MMU recommends that FTR auction revenues not be used by PJM to buy counter flow FTRs for the

<sup>5</sup> If adopted, this recommendation would replace the next two recommendations.



purpose of improving FTR payout ratios.<sup>6</sup> (Priority: High. First reported 2015. Status: Not adopted.)

## FTR Subsidies

- The MMU recommends that PJM eliminate portfolio netting to eliminate cross subsidies among FTR market participants. (Priority: High. First reported 2012. Status: Not adopted. Rejected by FERC.)
- The MMU recommends that PJM eliminate subsidies to counter flow FTRs by applying the payout ratio to counter flow FTRs in the same way the payout ratio is applied to prevailing flow FTRs. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends that PJM eliminate geographic cross subsidies. (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that PJM examine the mechanism by which self scheduled FTRs are allocated when load switching among LSEs occurs throughout the planning period. (Priority: Low. First reported 2011. Status: Not adopted.)

## FTR Liquidation

- The MMU recommends that the FTR portfolio of a defaulted member be canceled rather than liquidated or allowed to settle as a default cost to the membership. (Priority: High. First reported 2018. Status: Not adopted.)

## Credit

- The MMU recommends the use of at least a 99 percent confidence interval when calculating initial margin requirements for FTR market participants, in order to assign the cost of managing risk to the FTR holders who benefit or lose from their FTR positions. (Priority: High. First reported 2021. Status: Adopted 2023.)

## Conclusion

### Solutions

The annual ARR allocation should be designed to ensure that the rights to all congestion revenues are assigned to load, without requiring contract path or point to point physical or financial transmission rights that are inconsistent with the network based delivery of power

and the actual way congestion is generated in PJM's security constrained LMP market. When there are binding transmission constraints and locational price differences, load pays more for energy than generation is paid to produce that energy. The difference is congestion. As a result, congestion belongs to load and should be returned to load.

The current contract path based design should be replaced with a design in which the rights to actual congestion paid are assigned directly to the load that paid that congestion by node. The assigned right should be to the actual difference between load payments, both day-ahead and balancing, and revenues paid to the generation used to serve that load. The load can retain the right to the congestion revenues or sell the rights through auctions. The correct assignment of congestion revenues to load is fully consistent with retaining FTR auctions for the voluntary sale by load of their congestion revenue rights at terms defined by load, recognizing that load has property rights to congestion.

## Issues

If the original PJM FTR approach had been designed to return congestion revenues to load without the use of generation to load contract paths, and if the distortions subsequently introduced into the FTR design had not been added, many of the subsequent issues with the FTR design and complex redesigns would have been avoided. PJM would not have had to repeatedly intervene in the functioning of the FTR system in an effort to meet the artificial and incorrectly defined goal of revenue adequacy.

PJM has persistently and subjectively intervened in the FTR market in order to affect the payments to FTR holders. These interventions are not appropriate. For example, in the 2014/2015, 2015/2016 and 2016/2017 planning periods, PJM significantly reduced the allocation of ARR capacity, and FTRs, in order to guarantee full FTR funding. PJM reduced system capability in the FTR auction model by including more outages, reducing line limits and including additional constraints. PJM's modeling changes resulted in significant reductions in Stage 1B and Stage 2 ARR allocations, a corresponding reduction in the available quantity of FTRs, a reduction in congestion revenues assigned to ARRs, and an associated surplus of congestion revenue relative to FTR target allocations. This also resulted in a significant

<sup>6</sup> See "PJM Manual 6: Financial Transmission Rights," Rev. 33 (Sep. 25, 2024).



redistribution of ARR holders based on differences in allocations between Stage 1A and Stage 1B ARRs. Starting in the 2017/2018 planning period, with the allocation of balancing congestion and M2M payments to load rather than FTRs, PJM increased system capability allocated to Stage 1B and Stage 2 ARRs, but continued to conservatively select outages to manage FTR funding levels.

PJM has intervened aggressively in the FTR market since its inception in order to meet various subjective objectives including so called revenue adequacy. PJM should not intervene in the FTR market to subjectively manage FTR funding. PJM should fix the FTR/ARR design and then should let the market work to return congestion to load and to let FTR values reflect actual congestion.

Load should never be required to subsidize payments to FTR holders, regardless of the reason.<sup>7</sup> The FERC order of September 15, 2016, introduced a subsidy to FTR holders at the expense of ARR holders.<sup>8</sup> The order requires PJM to ignore balancing congestion when calculating total congestion dollars available to fund FTRs. As a result, balancing congestion and M2M payments are assigned to load, rather than to FTR holders, as of the 2017/2018 planning period. When combined with the direct assignment of both surplus day-ahead congestion and surplus FTR auction revenues to FTR holders, the Commission's order shifted substantial revenue from load to the holders of FTRs and further reduced the offset to congestion payments by load. This approach ignores the fact that load pays both day-ahead and balancing congestion, and that actual congestion is the sum of day-ahead and balancing congestion. Eliminating balancing congestion from the FTR revenue calculation requires load to pay twice for congestion. Load pays total congestion and pays negative balancing congestion again. The fundamental reasons that there has been a significant and persistent difference between day-ahead and balancing congestion include inadequate transmission modeling in the FTR auction and the role of UTCs in taking advantage of these modeling differences and creating negative balancing congestion. There is no reason to impose these costs on load.

These changes were made in order to increase the payout to holders of FTRs who are not loads. Increasing the

payout to FTR holders at the expense of the load is not a supportable market objective. PJM should implement an FTR design that calculates and assigns congestion rights to load rather than continuing to modify the current, fundamentally flawed, design.

Load was made significantly worse off as a result of the changes made to the FTR/ARR process by PJM based on the FERC order of September 15, 2016. ARR revenues were significantly reduced for the 2017/2018 FTR Auction, the first auction under the new rules. ARRs and self scheduled FTRs offset only 49.5 percent of total congestion costs for the 2017/2018 planning period rather than the 58.0 percent offset that would have occurred under the prior rules, a difference of \$101.4 million.

A subsequent rule change was implemented that modified the allocation of what is termed surplus auction revenue to load. Beginning with the 2018/2019 planning period, surplus day-ahead congestion and surplus FTR auction revenue are assigned to FTR holders only up total target allocations, and then distributed to ARR holders.<sup>9</sup> ARR holders will only be allocated this surplus after FTRs are paid 100 percent of their target allocations. While this rule change increased the level of congestion revenues returned to load under some conditions, the rules do not recognize ARR holders' rights to all congestion revenue, and only improves congestion payouts to load when there is a surplus. There was no surplus for the 2020/2021 or 2021/2022 planning years. With this rule in effect for the 2021/2022 planning period, ARRs and self scheduled FTRs offset 31.6 percent of total congestion. There was surplus for the 2022/2023 and the 2023/2024 planning periods. However, FTR auction surplus revenues were taken from load and given to FTR holders because day-ahead congestion revenues were less than target allocations in the 2023/2024 planning period. Based on market logic, there is no such thing as surplus FTR auction revenue. FTR Auction revenue results from the market prices paid by willing FTR buyers, should be paid to ARR holders, and should not be returned to FTR buyers for any reason. ARRs and self scheduled FTRs offset only 55.9 percent of total congestion paid by ARR holders in the first seven months of the 2024/2025 planning period. Load has been underpaid congestion revenues by \$4.6 billion from the 2011/2012 planning period through the first seven months of the 2024/2025

<sup>7</sup> Such subsidies have been suggested repeatedly. See FERC Dockets Nos. EL13-47-000 and EL12-19-000.

<sup>8</sup> See 156 FERC ¶ 61,180 (2016), *reh'g denied*, 158 FERC ¶ 61,093 (2017).

<sup>9</sup> 163 FERC ¶ 61,165 (2018).

planning period. The cumulative offset for that period was 69.6 percent of total congestion.

The complex process related to what is termed the overallocation of Stage 1A ARRs is entirely an artificial result of reliance on the contract path model in the assignment of FTRs. For example, there is a reason that transmission is not actually built to address the Stage 1A overallocation issue. The Stage 1A overallocation issue is a fiction based on the use of outdated and irrelevant generation to load contract paths to assign Stage 1A rights that have nothing to do with actual power flows.

PJM proposed, and on March 11, 2022, FERC accepted, an increase to Stage 1A ARR allocations from 50 percent of Network Service Base Load (NSBL) to 60 percent of Network Service Peak Load (NSPL).<sup>10</sup> NSBL is a network service customer's contribution to the lowest daily zonal peak load in the prior twelve month period, and NSPL is a network service customer's contribution to the highest daily zonal peak load in the prior twelve month period. PJM's new ARR allocation rules have increased Stage 1A rights at the cost of Stage 1B and Stage 2 ARR allocations. More importantly, PJM's new ARR allocation rules have exacerbated the current misalignment between congestion property rights and the congestion paid by load.

## Proposed Design

To address the issues with the current contract path based ARR/FTR market design, the MMU recommends that the current design be replaced with a design in which the rights to actual congestion paid are assigned directly to the load that paid that congestion by node. The assigned right would be the actual difference between load payments, both day-ahead and balancing, and revenues paid to the generation used to serve that load. The load could retain the right to the congestion or sell the right through auctions. The correct assignment of congestion revenues to load is fully consistent with retaining FTR auctions for the voluntary sale by load of their congestion revenue rights at terms defined by load.

With a network assignment of actual congestion, there would be no cross subsidies among rights holders and no over or under allocation of rights relative to actual network market solutions. There would be no revenue shortfalls as congestion payments equal congestion collected. The risk of default would be isolated to the

buyer and seller of the right, and any default would not be socialized to other rights holders. In the case of a defaulting buyer, the rights to the congestion revenues would revert to the load. There would be no risk of a network right flipping in value from positive to negative, because congestion is always the positive difference between what load pays for energy and what generation is paid for energy as a result of transmission constraints.

The MMU proposal requires the calculation of constraint specific congestion and the calculation of that specific constraint's congestion related charges to each physical load bus downstream of that constraint. Under the MMU proposal, the constraint specific congestion calculated by hour, from both the day-ahead and balancing market would be paid directly to the physical load as a credit against the associated load serving entity's (LSE) energy bill. This right to the congestion is defined as the congestion revenue right (CRR) that belongs to the physical load at a defined bus, zone or aggregate. The LSE could choose to sell all or a portion of the CRR through auctions.

A CRR is the right to actual, realized network related congestion that is paid by physical load at a specific bus, zone or aggregate. Under the MMU proposal a bus, zone or aggregate specific CRR could be sold as a defined share of the actual congestion. For example, an LSE could sell 50 percent of its congestion revenue right for the planning period to a third party. The third party buyer would then be entitled to 50 percent of the congestion that is credited to that specific bus, zone or aggregate for the planning period. The remaining 50 percent of the congestion credit for the specified bus, zone or aggregate would be paid to the LSE along with the auction clearing price for the 50 percent of the CRR that was sold to the third party. Depending on actual congestion and the price paid for a CRR, an LSE selling its congestion revenue rights could be better or worse off than if it retained its rights.

Under the MMU proposal, the LSE would be able to set reservation prices in the auction for the sale of portions or all of its CRR. Third parties would have an opportunity to bid for the offered portions of the CRR, and the market for the congestion revenue associated with the specified bus, zone or aggregate would clear at a price. If the reservation price of an identified portion of the offered CRR was not met at the clearing price,

<sup>10</sup> See 178 FERC ¶ 61,170.

that portion of the offered CRR would remain with the load. Auctions could be annual and/or monthly and/or more frequent.

Under the MMU proposal, point to point rights (FTRs) could exist as a separate, self-funded hedging product based on simultaneously feasible prevailing and counter flows in a PJM managed network based auction. The only supply and the only source of revenues in the point to point market for prevailing flow FTRs would be counter flow offers and direct payments for specific rights.

## Auction Revenue Rights

Auction Revenue Rights (ARRs) are the mechanism used to assign congestion rights to load, using an archaic and invalid contract path based approach, and to sell those rights to FTR buyers in various auctions. ARR values are based on nodal price differences established by cleared FTR bids in the Annual FTR Auction. ARR sellers have no opportunity to define a price at which they are willing to sell and must accept the prices set by FTR buyers. ARR revenues are a function of FTR auction participants' expectations of congestion, risk, competition and available supply. But some auction revenues may be returned to FTR buyers as "surplus," despite the fact that FTR buyers willingly paid a defined price for FTRs. There is no surplus. PJM has significant discretion over the level of supply made available to FTR buyers. That discretion is needed only as a result of the flawed design. As long as the current design persists, the goals of that discretion should be significantly limited and defined clearly in the tariff.

ARRs are available only as obligations (not options) and only as a 24 hour product. ARRs are available to the nearest 0.1 MW. The ARR target allocation is equal to the product of the ARR MW and the price difference between the ARR sink and source from the Annual FTR Auction.<sup>11</sup> The value of ARR target allocations is set by the Annual FTR Auction. It is logically possible for ARRs to be revenue inadequate if the money collected from the FTR auction is not enough to pay the entirety of ARR target allocations for the planning period. This is extremely unlikely and can only happen if there is a modeling difference between the system model used for ARRs and the system model used for FTRs and the FTR MW are reduced. An ARR's target allocation, or value,

<sup>11</sup> These nodal prices are a function of the market participants' annual FTR bids and binding transmission constraints.

which is established from the Annual FTR Auction, can be a benefit or liability depending on the price difference between sink and source.

The goal of the ARR/FTR design should be to provide an efficient mechanism to ensure that load receives the rights to all congestion revenues. In the current design, all auction revenues should be paid to ARR holders.

The quantity of the product made available as ARRs or for sale in the FTR auctions is defined as system capability, meaning the capacity of the transmission system to deliver power. But system capability is not congestion and system capability is not the difference in congestion prices across transmission contract paths nor the potential for such difference and system capability is not the market flow across transmission paths. The concept of system capability is not relevant to assigning the rights to congestion revenues to load. The use, or misuse, of the concept of system capability in assigning ARRs is derived entirely from the contract path approach used in the PJM design. The definition of ARRs based on contract paths led to the mistaken idea that some transmission system capacity was used by ARRs but some was not and that both the ARR capability and the excess capability were available for sale as FTRs. Power does not flow on contract paths. In the current approach, system capability available to ARR holders is limited by the system capability made available in PJM's annual FTR transmission system market model. PJM's annual FTR transmission market model represents annual, expected system capability, modified by PJM to achieve PJM's goal of guaranteeing revenue equal to target allocations for FTRs, and subject to the requirement that all Stage 1A ARR requests must be allocated. Stage 1A ARR right requests are guaranteed and system capability necessary to accommodate the rights must be included in PJM's annual FTR transmission system market model despite the fact that there are not real world paths, real world capability, or real world flows that correspond to Stage 1A rights.

## Market Design

ARRs have been available to network service and firm, point to point transmission service customers since June 1, 2003, when the annual ARR allocation was first implemented for the 2003/2004 planning period. The initial allocation covered the Mid-Atlantic Region and the APS Control Zone. For the 2006/2007 planning

period, the choice of ARRs or direct allocation FTRs was available to eligible market participants in the AEP, DAY, DUQ and DOM Control Zones. For the 2007/2008 and subsequent planning periods through the present, all eligible market participants were allocated ARRs.

Each March, PJM allocates annual ARRs to eligible customers in a three stage process: Stage 1A, Stage 1B and Stage 2B. Stage 1A ARRs are assigned based on historic contract paths and Stage 1A ARRs must be preserved for at least ten planning periods regardless of system or regulatory changes.<sup>12</sup>

The 2022/2023 planning period annual auction was the first auction under PJM's new ARR allocation rules. Under the new rules, Stage 1A ARR allocations increase from 50 percent of Network Service Base Load (NSBL) to 60 percent of Network Service Peak Load (NSPL).<sup>13</sup> NSBL is a network service customer's contribution to the lowest daily zonal peak load in the prior 12 month period, and NSPL is a network service customer's contribution to the highest daily zonal peak load in the prior twelve month period. PJM's new ARR allocation rules have increased Stage 1A rights at the cost of Stage 1B and Stage 2 ARR allocations.

In Stage 1A, LSEs can obtain ARRs, based on their contribution to the network service peak load (NSPL) and based on putative generation to load contract paths, or their qualified replacements if the resource has retired and PJM has replaced it with a different generator regardless of whether there is a contract. The historical reference year is the year in which PJM markets were implemented, which is 1999 for the original zones, or the year in which a zone joined PJM. Firm, point to point transmission service customers can obtain Stage 1A ARRs up to 50 percent of the MW of firm, point to point transmission service provided between the receipt and delivery points for the historical reference year, subject to a cap of 60 percent of the participants total network service peak load for the zone or load aggregation zone that the ARRs are obtained. Effective for the 2023/2024 planning period, network service customers can obtain Stage 1A ARRs based on the MW of firm service provided during the reference year, subject to a cap of 60 percent of the participants total network service peak load for the zone or load aggregation zone that the ARRs are obtained. Stage 1A

ARRs cannot be prorated. If Stage 1A ARRs are found to be infeasible, transmission system upgrades must be undertaken to maintain feasibility.<sup>14</sup> However, PJM does not actually upgrade the transmission system to address Stage 1A ARR infeasibility because there is no actual physical infeasibility. The apparent infeasibility is an artificial result based on the fiction that power flows on the unsupported, outdated, fictional and irrelevant generation to load contract paths on which PJM's current and incorrect ARR allocation is based. Stage 1A rights have nothing to do with actual power flows or transmission limits.

In Stage 1B, network transmission service customers can obtain ARRs, up to the difference between their share of network service peak load and Stage 1A allocations. Effective for the 2023/2024 planning period, Stage 1B ARRs can be obtained from historical generation resources, qualified replacement resources, hubs, zones, or interfaces to designated load aggregation zones. Firm, point to point transmission service customers can obtain ARRs based on the MW of long-term, firm, point to point service provided between the receipt and delivery points for the historical reference year.

In Stage 2, network transmission service customers can obtain ARRs from any hub, control zone, generator bus or interface pricing point to any part of their aggregate load in the control zone, load aggregation zone, or any generator, interface, hub or zone, up to their total peak network load in that zone. Firm, point to point transmission service customers can obtain ARRs consistent with their transmission service as in Stage 1A and Stage 1B.

ARR holders can self schedule ARRs as FTRs during the Annual FTR Auction.<sup>15</sup> When ARR holders self schedule FTRs, the ARR holders choose to be paid based on variable FTR target allocations rather than the fixed ARR value determined in the annual FTR auction. ARRs can be traded between LSEs prior to the first round of the Annual FTR Auction.

Effective for the 2015/2016 planning period, when residual zonal pricing was introduced, ARRs default to sinking at the load settlement point if different than the zone, but the ARR holder may elect to sink their ARR at the zone instead.<sup>16</sup>

<sup>12</sup> See "PJM Manual 6: Financial Transmission Rights," Rev. 33 (Sep. 25, 2024) at 23.

<sup>13</sup> See 178 FERC ¶ 61,170.

<sup>14</sup> See "PJM Manual 6: Financial Transmission Rights," Rev. 33 (Sep. 24, 2024).

<sup>15</sup> OATT Attachment K 7.1.1.(b).

<sup>16</sup> See "PJM Manual 6: Financial Transmission Rights," Rev. 33 (Sep. 24, 2024) at 35.



In 2016, FERC ordered PJM to remove retired resources from the generation to load contract paths used to allocate Stage 1A ARR. <sup>17</sup> PJM replaced retired units with operating generators, termed qualified replacement resources (QRRs), regardless of whether there was a corresponding contract. <sup>18</sup> Existing Stage 1A resources retain their current allocations, while ARR allocations to QRRs that replace retired Stage 1A resources are prorated based on the feasibility of these ARRs after existing resources are allocated. As a result of this proration, ARRs for QRRs have lower priority than ARRs from generators that existed in 1998.

Generation to load paths, even from active generators, are based on a contract path model rather than a network model. Generation to load contract paths should not be used as a basis for assigning the rights to congestion revenue. There is no basis for assuming that a contract existed in 1999 or exists currently. Contract paths are a fiction and are not an accurate representation of the reasons that congestion exists or of how load is served in a network and will, by definition, not accurately measure the exposure of load to congestion.

## Market Structure

ARRs are allocated on an annual basis. For the 2024/2025 planning period there were 1,523 individual participants and 126 parent companies, up from 1,504 individual participants and 123 parent companies for the 2023/2024 planning period.

The ownership of ARRs was unconcentrated, with an HHI of 610, for the 2024/2025 planning period compared to 617 for the 2023/2024 planning period.

## Market Performance

### Volume

Table 13-3 shows the MW of ARR allocations for each round of the 2023/2024 and 2024/2025 planning periods. There was a 950 MW increase (0.6 percent) in Network Service Peak Load (NSPL) between the 2023/2024 and 2024/2025 planning period. This increase resulted in an increase in ARR MW requested by load in the annual auction of 1,344 MW (0.7 percent) from the 2023/2024 to the 2024/2025 planning period. The ARR MW actually provided to load increased by 3,758 MW (3.4 percent) from the 2023/2024 to the 2024/2025 planning period. The cleared volume of Stage 1B ARR MW increased 4.6 percentage points from 21.9 percent in the 2022/2023 planning period to 26.5 percent in the 2023/2024 planning period.

**Table 13-3 Annual ARR allocation volume: 2023/2024 and 2024/2025 planning periods**

Planning Period	Stage	Round	Requested Count	Requested Volume (MW)	Cleared Volume (MW)	Cleared Volume	Uncleared Volume (MW)	Uncleared Volume
2023/2024	1A	0	36,717	87,085	87,073	100.0%	12	0.0%
	1B	1	10,454	51,491	11,290	21.9%	40,201	78.1%
		2	11,170	32,848	5,325	16.2%	27,523	83.8%
		3	10,687	33,045	7,570	22.9%	25,475	77.1%
		Total	21,857	65,893	12,895	19.6%	52,998	80.4%
	Total		69,028	204,469	111,258	54.4%	93,211	45.6%
2024/2025	1A	0	33,729	86,657	86,657	100.0%	0	0.0%
	1B	1	11,182	56,080	14,880	26.5%	41,200	73.5%
		2	14,374	31,556	5,691	18.0%	25,865	82.0%
		3	9,552	31,520	7,788	24.7%	23,732	75.3%
		Total	23,926	63,076	13,479	21.4%	49,597	78.6%
	Total		68,837	205,813	115,016	55.9%	90,797	44.1%

Table 13-4 shows the share of ARR MW, by stage, for ARRs with paths that source inside or outside the zone where the load is located, for the 2024/2025 planning period. Table 13-4 shows that, for the 2024/2025 planning period, 77.6 percent of the ARR MW are based on generation inside the zone where the ARR load is located and 22.4 percent of the ARR MW are based on generation outside the zone where the ARR load is located.

<sup>17</sup> 156 FERC ¶ 61,180 (2016) *reh'g denied*, 158 FERC ¶ 61,093 (2017).

<sup>18</sup> See FERC Docket No. EL16-6-003.



Table 13-55 shows that, for the 2024/2025 planning period, 77.6 percent of the ARR MW are based on generation inside the zone where the ARR load is located and 22.1 percent of the ARR MW are based on generation outside the zone where the ARR load is located. In contrast, only 17.4 percent of congestion resulted from constraints inside the zone where load is located and 82.6 percent of congestion resulted from constraints outside the zone where load is located during the 2024/2025 planning period. This illustrates one of the fundamental issues with the path based approach which originated in a cost of service design where most load was served by generation in the same zone as load. In fact, in the PJM market, which operates as an integrated network, a significant proportion of congestion results from constraints that are not in the same zone as load. The path based approach cannot and does not reflect the actual congestion paid by load.

**Table 13-4 Share of ARRs that source in/out of load zone: 2024/2025 planning period**

	Stage 1A		Stage 1B		Stage 2		Total	
	Out of Zone	In Zone	Out of Zone	In Zone	Out of Zone	In Zone	Out of Zone	In Zone
ACEC	25.3%	34.1%	13.2%	0.2%	16.6%	10.6%	55.1%	44.9%
AEP	7.7%	65.3%	1.1%	17.8%	0.6%	7.4%	9.4%	90.6%
APS	9.4%	66.3%	5.3%	15.5%	1.3%	2.3%	15.9%	84.1%
ATSI	33.1%	46.7%	1.0%	4.8%	1.0%	13.3%	35.1%	64.9%
BGE	37.0%	43.0%	2.9%	16.8%	0.0%	0.3%	39.9%	60.1%
COMED	0.0%	71.0%	0.0%	11.2%	0.1%	17.7%	0.1%	99.9%
DAY	87.1%	1.8%	4.5%	5.4%	1.0%	0.1%	92.6%	7.4%
DOM	0.3%	67.4%	0.4%	10.2%	1.3%	20.4%	2.0%	98.0%
DPL	21.6%	69.5%	4.3%	1.7%	0.0%	2.8%	26.0%	74.0%
DUKE	45.2%	44.3%	4.0%	6.4%	0.0%	0.1%	49.1%	50.9%
DUQ	73.3%	0.0%	4.0%	0.0%	19.7%	3.0%	97.0%	3.0%
EKPC	51.6%	0.0%	48.4%	0.0%	0.0%	0.0%	100.0%	0.0%
EXT	23.2%	0.0%	0.0%	0.0%	76.8%	0.0%	100.0%	0.0%
JCPL	1.9%	31.2%	28.0%	0.5%	28.9%	9.5%	58.9%	41.1%
MEC	23.8%	46.4%	6.2%	0.4%	8.7%	14.5%	38.7%	61.3%
OVEC	0.0%	0.0%	0.0%	0.0%	66.7%	33.3%	66.7%	0.0%
PE	23.2%	30.1%	0.3%	3.7%	1.1%	41.6%	24.6%	75.4%
PECO	3.2%	85.7%	2.8%	0.8%	0.8%	6.7%	6.9%	93.1%
PEPCO	44.0%	50.1%	2.9%	0.6%	0.0%	2.4%	46.9%	53.1%
PPL	0.0%	56.4%	0.6%	7.8%	5.2%	30.0%	5.8%	94.2%
PSEG	17.2%	30.0%	18.5%	0.2%	18.8%	15.2%	54.6%	45.4%
REC	0.0%	0.0%	83.0%	0.0%	17.0%	0.0%	100.0%	100.0%
Total	14.1%	54.9%	4.2%	9.0%	4.1%	13.6%	22.4%	77.6%

## Stage 1A Infeasibility

Stage 1A ARRs are allocated for a year, but guaranteed for 10 years, with the ability for a participant to opt out of any planning period within the 10 years. PJM conducts a simultaneous feasibility analysis to determine the transmission upgrades required to ensure that the long term ARRs can remain feasible. The rules

provide that if a simultaneous feasibility test violation occurs in any year, PJM will identify or accelerate any transmission upgrades to resolve the violation and these upgrades will be recommended for inclusion in the PJM RTEP process. But such transmission upgrades must pass PJM's RTEP process.

PJM's transmission planning process (RTEP) does not identify a need for new transmission associated with Stage 1A overallocations because there is, in fact, no need for new transmission associated with Stage 1A ARRs. The Stage 1A overallocation issue is a fiction based on the use of outdated and irrelevant generation to load contract paths to assign Stage 1A rights that have nothing to do with actual power flows. This continues to be true even with the replacement of retired generating units.

For the 2023/2024 and 2024/2025 planning periods, Stage 1A of the Annual ARR Allocation was infeasible, resulting in an over allocation of ARRs on the affected facilities. As a result, modeled system capability, in excess of actual system capability, was provided to the Stage 1A ARRs and added to the FTR auction. According to Section 7.4.2 (i) of the OATT, the capability limits of the binding constraints rendering these ARRs infeasible must be increased in the model and these increased limits must be used in subsequent ARR and FTR allocations and auctions for the entire planning period, except in the case of extraordinary circumstances. Stage 1A related over allocations have to be made up elsewhere in PJM's FTR market model, in the form of reduced system capability, in order for PJM to achieve its goal of fully funding FTRs. The need for and use of these artificial and factually incorrect calculations are another illustration of the failure of the FTR/ARR design to meet basic logical standards.

Table 13-5 shows the MW quantity and count of overloaded facilities and the reasons for the modeled overload for the 2023/2024 and 2024/2025 planning periods. In order to eliminate the infeasibilities for the requested Stage 1A ARR allocations, PJM needed to raise the modeled capacity limits above the actual transmission line limits on 98 facility/contingency pairs, 57 of which were internal to PJM, a total of 16,874 MW in the 2024/2025 planning period, an increase of 30 facility/contingency pairs (44.1 percent), an increase of 12 facility/contingency pairs internal to PJM, (26.7

percent), and an increase of 5,245 MW (45.1percent) compared to the 2023/2024 planning period.<sup>19</sup>

**Table 13-5 Stage 1A overloaded facility reasons and MW: 2023/2024 and 2024/2025 planning periods**

Reason	Type	2023/2024		2024/2025	
		MW	Count	MW	Count
Network Load	Internal PJM	0	0	2,745	5
Network Load	M2M Flowgate	2,057	19	2,003	26
Transmission Outage	Internal PJM	9,506	45	12,031	57
Transmission Outage	M2M Flowgate	62	3	95	10
Transmission Outage	Tie Line	4	1	0	0
Total		11,629	68	16,874	98

Table 13-6 shows the share of Stage 1A over allocations for the 2023/2024 and 2024/2025 planning periods for ARR allocations that source inside and outside the zone where the over allocated MW sink. The share of over allocated capacity that has a source outside the zone in which it sinks, decreased 0.2 percent from 27.0 percent in the 2023/2024 planning period to 26.8 percent in the 2024/2025 planning period.

**Table 13-6 Stage 1A overloaded paths that sink inside and outside source zone: 2023/2024 and 2024/2025 planning periods**

	2023/2024 Planning Period				2024/2025 Planning Period			
	MW		Proportion		MW		Proportion	
	In Zone	Out of Zone	In Zone	Out of Zone	In Zone	Out of Zone	In Zone	Out of Zone
ACEC	0.0	0.2	0.0%	100.0%	0.0	0.1	0.0%	100.0%
AEP	4,288.5	811.8	84.1%	15.9%	2,779.5	692.9	80.0%	20.0%
APS	0.1	478.0	0.0%	100.0%	19.0	486.0	3.8%	96.2%
ATSI	2,783.3	1,985.7	58.4%	41.6%	1,327.2	1,840.3	41.9%	58.1%
BGE	0.0	461.7	0.0%	100.0%	0.0	972.3	0.0%	100.0%
COMED	3,271.0	0.0	100.0%	0.0%	3,222.5	0.0	100.0%	0.0%
DAY	0.0	504.8	0.0%	100.0%	0.0	234.9	0.0%	100.0%
DOM	4,757.3	3.9	99.9%	0.1%	8,481.8	3.7	100.0%	0.0%
DPL	68.4	45.7	59.9%	40.1%	166.0	107.1	60.8%	39.2%
DUKE	0.0	1,330.2	0.0%	100.0%	0.0	647.6	0.0%	100.0%
DUQ	0.0	177.7	0.0%	100.0%	0.0	178.9	0.0%	100.0%
EKPC	0.0	100.0	0.0%	100.0%	0.0	104.1	0.0%	100.0%
JCPL	0.0	21.6	0.0%	100.0%	0.0	0.0	NA	NA
MEC	0.0	5.1	0.0%	100.0%	19.5	10.9	64.1%	35.9%
PE	582.6	220.5	72.5%	27.5%	174.5	369.7	32.1%	67.9%
PECO	223.7	0.0	100.0%	0.0%	424.1	0.0	100.0%	0.0%
PEPCO	286.7	166.6	63.2%	36.8%	0.0	427.8	0.0%	100.0%
PPL	916.0	0.0	100.0%	0.0%	0.0	0.0	NA	NA
PSEG	0.0	48.5	0.0%	100.0%	0.0	0.0	NA	NA
TOTAL	17,177.6	6,362.0	73.0%	27.0%	16,614.1	6,076.3	73.2%	26.8%

Figure 13-1 shows the predicted and estimated impact of Stage 1A infeasibilities on FTR funding for the 2012/2013 through 2023/2024 planning periods, as well as the predicted impact on funding for the 2024/2025 planning period. The predicted funding is based on the infeasible ARR MW and the nodal price of the source and sink in the Annual FTR Auction. The estimated funding is calculated assuming every infeasible ARR MW is self scheduled, and uses the hourly congestion LMP values of the applicable day-ahead hours. Predicted funding impacts are lower in the 2017/2018, 2018/2019 and 2019/2020 planning periods from the previous two planning periods, likely as a result of PJM relaxing model constraints. PJM's Qualified Replacement Resource rules may slightly reduce revenue inadequacy from Stage 1A ARRs, but do not eliminate the actual issues with historical Stage 1A resources.

<sup>19</sup> PJM 2023/2024 Stage 1A Over allocation notice, PJM FTRs, <<https://pjm.com/-/media/markets-ops/ftr/annual-arr-allocation/2023-2024/2023-2024-stage-1a-over-allocation-notice.ashx>> (March 6, 2023).

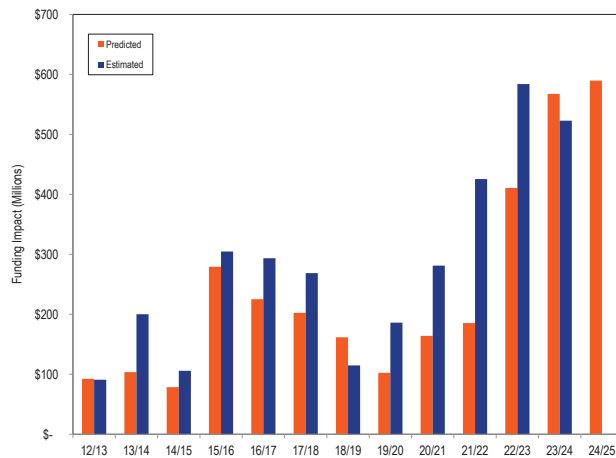
**Figure 13-1 Stage 1A Infeasibility funding impact**

Table 13-7 shows the MW of retired generation sources for Stage 1A ARRs, the QRR MW assigned by PJM for all resources and the replacement MW that were considered rate based. A rate based unit is a replacement generator that is owned by the ARR holder, or subject to firm energy and capacity supply contracts. The term rate based is a misleading reference to the premarket cost of service regulation paradigm. If PJM does not find such a unit, PJM will use another unit that is close to where the retired unit was located even if it is not owned or under contract. The PJM synthetic zone Midatlantic is an historical artifact that is used for reporting only, not for determining possible replacement generators for QRR assignment. The actual zones within the synthetic zone Midatlantic (AECO, Allegheny Electric Coop, APS, BGE, Buckeye REC, DPL, JCPL, METED, PECO, PENELEC, PEPCO, PPL, PSEG, UGI) are used for determining possible replacement generators for QRR assignment. It is not clear why PJM created the synthetic zone Midatlantic for the QRR assignment.

**Table 13-7 Qualified Replacement Resource results: 2024/2025 planning period**

Zone	Historical Retired	Replacement (All)	Replacement (Rate-based)
AEP/DAY	10,741.1	8,039.8	1,846.1
ATSI	7,154.3	4,642.1	36.7
COMED	8,503.8	6,423.1	4.5
DEOK	3,234.5	2,029.2	57.6
DOM	5,996.6	6,380.1	5,204.4
DUQ	2,045.0	811.7	0.0
EKPC	198.1	229.3	0.0
Midatlantic	22,890.1	16,730.4	374.6
OVEC	0.0	459.2	1,854.0
Total	60,763.5	45,744.9	9,377.9

## ARR Reassignment for Retail Load Switching

PJM rules provide that when load switches between LSEs during the planning period, an LSE gaining load in the same control zone is allocated a proportional share of positively valued ARRs and residual ARRs within the control zone based on the shifted load.<sup>20</sup> ARRs are reassigned to the nearest 0.001 MW and may be reassigned multiple times over a planning period. The reassignment of positively valued ARRs supports competition by ensuring that the offset to congestion follows load, thereby removing a barrier to competition among LSEs and, by ensuring that only ARRs with a positive value are reassigned, preventing an LSE from assigning poor ARR choices to other LSEs. However, when ARRs are self scheduled as FTRs, the self scheduled FTRs do not follow load that shifts while the ARRs do follow load that shifts, and this may result in lower value of the ARRs for the receiving LSE compared to the total value held by the original ARR holder.

Table 13-8 summarizes ARR MW and associated revenue reassigned for network load in each control zone where changes occurred between June 2023 and December 2024.

There were 26,290 MW of ARRs associated with \$474.0 thousand of revenue that were reassigned for the first seven months of the 2024/2025 planning period. There were 34,601 MW of ARRs associated with \$827.2 thousand of revenue that were reassigned for the 2023/2024 planning period.

<sup>20</sup> See "PJM Manual 6: Financial Transmission Rights," Rev. 33 (Sep. 24, 2024).

**Table 13–8 ARR and ARR revenue automatically reassigned for network load changes by control zone: June 2023 through December 2024**

Control Zone	ARRs Reassigned (MW-day)		ARR Revenue Reassigned [Dollars (Thousands) per MW-day]	
	2023/2024	2024/2025	2023/2024	2024/2025
	(12 months)	(7 months)	(12 months)	(7 months)
ACEC	292	193	\$3.3	\$1.6
AEP	4,685	4,057	\$71.1	\$43.4
APS	1,500	998	\$55.7	\$28.2
ATSI	5,513	4,356	\$119.3	\$66.2
BGE	2,044	1,615	\$96.9	\$67.9
COMED	2,409	1,466	\$18.9	\$10.1
DAY	1,285	996	\$14.6	\$9.3
DUKE	2,021	1,328	\$103.4	\$48.7
DUQ	1,351	1,149	\$8.8	\$5.1
DOM	320	565	\$23.2	\$30.2
DPL	806	167	\$49.8	\$13.7
EKPC	0	0	\$0.0	\$0.0
JCPLC	853	572	\$5.2	\$2.6
MEC	1,064	753	\$36.0	\$15.1
OVEC	0	0	\$0.0	\$0.0
PECO	3,317	2,896	\$25.4	\$18.6
PE	1,476	843	\$34.0	\$13.6
PEPCO	1,702	2,490	\$61.6	\$48.4
PPL	2,987	545	\$75.2	\$12.3
PSEG	867	1,265	\$23.2	\$38.6
REC	109	35	\$1.7	\$0.4
Total	34,601	26,290	\$827.2	\$474.0

## Revenue

ARRs are allocated to qualifying customers rather than sold, so ARR revenue (target allocation) is different from the revenue that results from the FTR auctions, which generally exceeds the sum of the ARR target allocations.


Figure 13–2 shows the revenue per ARR MW held for each month of the 2010/2011 planning period through the 2023/2024 planning period. The revenue per ARR MW held does not include target allocation related payouts for self scheduled FTRs or surplus revenue, but does include Residual ARRs starting in August 2012.

PJM has had to repeatedly intervene in the functioning of the FTR system in an effort to meet the artificial and incorrectly defined goal of revenue adequacy. FTR prices increased in the 2014/2015 Annual FTR Auction in part as a result of reduced supply caused by PJM's assumption of more outages in the model relative to prior years. The decrease in system capability caused by PJM's more conservative modeling of the FTR market model reduced Stage 1B and Stage 2 ARR allocations. The increased FTR prices resulted in an increase in revenue per ARR MW, but there are fewer ARR MW. For the 2014/2015 planning period, the total dollars per

MW of ARR allocation was \$11,279, while the previous planning period resulted in revenue per MW of \$6,692, a 68.5 percent increase in revenue per allocated ARR MW. Some of the ARR MW lost from proration were provided in the Residual ARR process, but the residual allocations are not comparable to the ARRs awarded in the annual process because residual ARR allocations change each month and cannot be self scheduled as FTRs. For the 2015/2016 and 2016/2017 planning periods, the revenue per MW of ARR allocation was \$10,641.54 and \$10,411. During these planning periods PJM chose more restrictive modeling criteria, which did not release the full capacity of the FTR model to account for revenue inadequacies. Beginning in the 2017/2018 planning period, when balancing congestion was removed from FTR funding, PJM reinstated less restrictive modeling criteria, and the revenue per MW of ARR decreased due to an increase in modeled capability. For the 2017/2018 and 2018/2019 planning periods the revenue per MW of ARR was \$5,168 and \$6,841. For the 2022/2023 planning period, cleared ARR MW decreased significantly (see Table 13–3) from the previous planning period, indicating that PJM again chose more restrictive modeling criteria for the FTR model to improve FTR funding. This results in fewer ARRs being awarded. Due to significant increases in FTR prices in the 2022/2023 planning period, the revenue per MW of ARR was \$12,274. For the 2023/2024 planning period, FTR prices decreased slightly compared to the 2022/2023 planning period and the revenue per MW of ARR was \$11,859, a 3.4 percent decrease.

Under the current rules, load is required to directly pay balancing congestion costs, not included in Figure 13–2, which reduce the revenue received by ARR holders. There is no support for the assertion made by proponents of shifting balancing congestion to load that higher ARR values would result, and there is no evidence of any kind that load is better off as a result of the arbitrary assignment of balancing congestion to load.

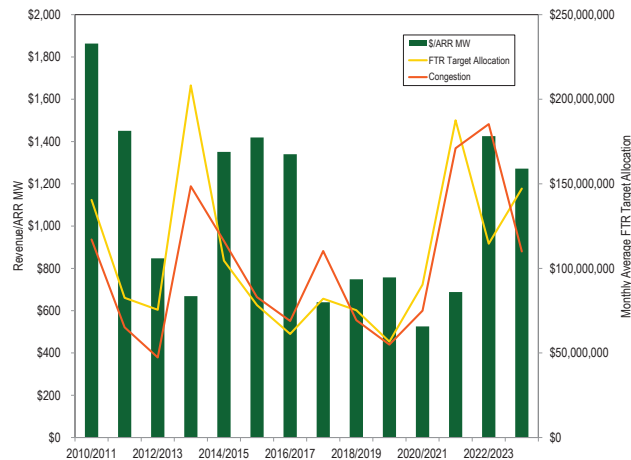**Figure 13-2 Revenue per ARR MW paid to ARR holders compared to congestion and FTR target allocations: 2010/2011 through 2023/2024 planning periods**



ARR holders have limited options to pick source points for their ARRs. The holders of Stage 1A rights are limited to specific historical sources (or PJM defined replacement sources when resources retire). Of the stage 1A rights allocated to ARR holders, 54.9 percent were sourced within the ARR holder's zone in the 2024/2025 planning period. Table 13-4 shows that, for the 2024/2025 planning period, 77.6 percent of the ARR MW are based on generation inside the zone where the ARR load is located and 22.4 percent of the ARR MW are based on generation outside the zone where the ARR load is located. In contrast, only 17.1 percent of congestion resulted from constraints inside the zone where load is located and 82.9 percent of congestion resulted from constraints outside the zone where load is located during the first seven months of the 2024/2025 planning period. The primary source of a load zone's actual congestion is the result of transmission constraints that separate that zone from resources external to that zone, not by constraints internal to that zone. The congestion offset revenues per MW of internally sourced Stage 1A ARR rights are less than the revenue per MW of Stage 1A ARR rights from externally sourced resources. Table 13-9 shows the share of ARR revenue, by stage, for ARRs with paths that source inside or outside the zone where the load is located, for the 2024/2025 planning period. While 22.4 percent of all ARR MW are Stage 1A ARRs with sources outside the zone where load is located (see Table 13-4), those ARRs provide 31.1 percent of the total ARR revenues.

This illustrates one of the fundamental issues with the path based approach which originated in a cost of service design where most load was served by, or assumed to be served by, generation in the same zone as load. In fact, in the PJM market, which operates as an integrated network, a significant proportion of congestion is based on constraints that are not in the same zone as load. The path based approach does not and cannot reflect the actual congestion paid by load. The use of the path based approach is the fundamental source of the under assignment of congestion revenue rights to load in the ARR/FTR model.

**Table 13-9 Share of ARR revenue that sources in/out of load zone: 2024/2025 planning period**

	Stage 1A		Stage 1B		Stage 2		Total	
	Out of Zone	In Zone	Out of Zone	In Zone	Out of Zone	In Zone	Out of Zone	In Zone
ACEC	22.0%	29.6%	21.9%	0.2%	17.3%	9.1%	61.2%	38.8%
AEP	13.1%	68.3%	0.5%	12.1%	0.5%	5.5%	14.1%	85.9%
APS	21.2%	62.7%	4.0%	8.9%	1.4%	1.7%	26.7%	73.3%
ATSI	70.8%	19.4%	1.3%	0.0%	0.4%	8.0%	72.5%	27.5%
BGE	83.7%	14.1%	1.1%	1.1%	0.0%	0.1%	84.8%	15.2%
COMED	0.0%	52.6%	0.0%	2.5%	0.1%	44.9%	0.1%	99.9%
DAY	94.9%	0.1%	4.0%	0.3%	0.7%	0.0%	99.6%	0.4%
DOM	0.6%	78.1%	0.5%	7.1%	1.5%	12.2%	2.5%	97.5%
DPL	24.3%	70.3%	2.5%	1.2%	0.0%	1.7%	26.9%	73.1%
DUKE	87.1%	10.8%	0.7%	1.3%	0.0%	0.0%	87.9%	12.1%
DUQ	90.9%	(0.0%)	1.9%	0.0%	6.6%	0.7%	99.3%	0.7%
EKPC	90.4%	0.0%	9.6%	0.0%	0.0%	0.0%	100.0%	0.0%
EXT	14.3%	0.0%	0.0%	0.0%	85.7%	0.0%	100.0%	0.0%
JCPL	4.4%	13.6%	39.7%	0.0%	37.4%	4.9%	81.5%	18.5%
MEC	14.5%	41.4%	4.7%	0.1%	8.8%	30.5%	28.0%	72.0%
OVEC	0.0%	0.0%	0.0%	0.0%	100.0%	0.0%	100.0%	0.0%
PE	18.9%	30.9%	0.4%	0.8%	1.6%	47.4%	20.9%	79.1%
PECO	(0.7%)	102.6%	(2.7%)	(0.1%)	0.3%	0.6%	(3.1%)	103.1%
PEPCO	90.3%	7.2%	2.2%	0.2%	0.0%	0.1%	92.5%	7.5%
PPL	(0.0%)	55.0%	0.3%	3.9%	13.3%	27.6%	13.5%	86.5%
PSEG	17.6%	39.0%	11.5%	0.1%	19.4%	12.3%	48.6%	51.4%
REC	0.0%	0.0%	79.1%	0.0%	20.9%	0.0%	100.0%	0.0%
Total	25.7%	52.6%	2.1%	4.5%	3.3%	11.8%	31.1%	68.9%

## Residual ARRs

Introduced August 1, 2012, Residual ARRs are available for eligible ARR holders when a transmission outage was modeled in the Annual ARR Allocation, but the transmission facility returns to service during the planning period. Residual ARRs can only be allocated to participants whose ARRs were prorated in Stage 1B and only to a maximum of the prorated reduction, so not all available Residual ARRs are allocated. Residual ARRs are automatically assigned to eligible participants the month before the effective date, are effective for a single month and cannot be self scheduled. Residual ARR target allocations are based on the clearing prices



from FTR obligations in the relevant monthly auction, may not exceed zonal network services peak load or firm transmission reservation levels and are only available up to the prorated ARR MW capacity as allocated in the Annual ARR Allocation. For the following planning period, these Residual ARRs are available as ARRs in the annual ARR allocation. Residual ARRs are a separate product from incremental ARRs. Beginning with the June 2017 monthly auction, Residual ARRs that would have cleared with a negative target allocation are not assigned to participants.<sup>21</sup> In prior planning periods, PJM's modeling of excess outages in order to manage FTR market outcomes resulted in the allocation of some ARRs that would have been allocated in Stage 1B being allocated as Residual ARRs on a month to month basis without the option to self schedule.

Table 13-10 shows the Residual ARRs allocated to participants and the associated target allocations. The available volume is the total additional capacity available to be allocated as Residual ARRs. The cleared volume is the residual ARR capacity actually allocated to participants with prorated ARRs based on the level of prorated ARRs in Stage 1B and the affected paths. In the first seven months of the 2024/2025 planning period, PJM allocated a total of 12,242.3 MW of Residual ARRs with a target allocation of \$7.4 million. In the 2023/2024 planning period, PJM allocated a total of 27,055.0 MW of residual ARRs with a target allocation of \$8.7 million.

**Table 13-10 Residual ARR allocation volume and target allocation: 2014/2015 planning period through 2024/2025 planning period**

Planning Period	Available Volume (MW)	Cleared Volume (MW)	Cleared Volume	Target Allocation
2014/2015	65,095.3	22,532.9	34.6%	\$8,160,918.27
2015/2016	61,807.0	37,042.4	59.9%	\$8,620,353.27
2016/2017	71,000.7	35,034.9	49.3%	\$6,986,723.44
2017/2018	81,040.8	39,597.4	48.9%	\$17,497,625.78
2018/2019	49,646.9	27,335.6	55.1%	\$11,817,002.00
2019/2020	48,286.5	27,233.2	56.4%	\$12,369,580.58
2020/2021	43,484.2	25,028.0	57.6%	\$11,677,033.36
2021/2022	46,092.0	27,619.2	59.9%	\$18,806,123.46
2022/2023	71,068.9	34,502.8	48.5%	\$38,140,961.08
2023/2024	81,055.2	27,055.0	33.4%	\$8,721,412.56
2024/2025	58,262.3	12,242.3	21.0%	\$7,367,687.48

\*First seven months of 2024/2025 planning period

21 See FERC Letter Order, Docket No. ER17-1057 (April 5, 2017).

## IARRs

In theory, Incremental Auction Revenue Rights (IARRs) are ARRs made available by physical transmission system upgrades from customer funded transmission projects or from merchant transmission or generation interconnection requests. In order for a transmission project to result in IARRs, the project must create simultaneously feasible incremental market flow capability in PJM's ARR market model, over and above all system capability being used by existing allocated ARRs and/or would be used by granting any prorated outstanding ARR requests, in the ARR market model.<sup>22</sup>

There are three sources of IARRs: IARRs based on a specific transmission investment; IARRs based on merchant transmission or generation interconnection projects; and IARRs based on RTEP upgrades. In the case of a specific transmission investment, the participant elects desired IARR MW between a specified source and sink and PJM and the affected transmission owners determine the upgrades necessary to create incremental capability.<sup>23</sup> In the other two cases, the participants paying for the upgrades are assigned IARRs if any are created. There have been 13 successful IARR requests totaling 2,990.1 MW. One IARR path of 64.5 MW was terminated (June 1, 2012), leaving 12 unique source and sink combinations of 2,925.6 MW of IARRs. Of these 12 unique paths, three paths consisting of 1,200.0 MW were based on specific transmission investments requests, six paths consisting of 1,047.4 MW were based on merchant transmission requests and three paths consisting of 678.6 MW were based on customer funded (RTEP) transmission projects. The three paths based on specific transmission investments involved a generation company working with its affiliated transmission company. The other nine paths were based on projects that would have been built regardless of the addition of IARRs.

The MMU supports increased competition to provide transmission using market mechanisms. The IARR process is not a viable mechanism for facilitating competitive transmission investments. Maintaining the IARR process impedes the search for real solutions. PJM's process for creating and assigning IARRs is fundamentally flawed

22 See PJM Incremental Auction Revenue Rights Model Development and Analysis, PJM June 12, 2017. <<https://www.pjm.com/~media/markets-ops/ftr/pjm-iarr-model-development-and-analysis.aspx>>.

23 See Attachment EE of the PJM Open Access Transmission Tariff <<https://www.pjm.com/directory/merged-tariffs/oatt.pdf>>.

and cannot be made consistent with the requirements of Order No. 681 which established IARRs.<sup>24</sup>

Order No. 681 requires that long-term firm transmission rights made feasible by transmission upgrades or expansions be available upon request to the party that pays for such upgrades or expansions.<sup>25</sup> Order No. 681 also requires that the rights granted by upgrades/expansions cannot come at the expense of transmission rights held by others. IARRs are treated as Stage 1A rights, which are given first and absolute priority in PJM's annual allocation process. Granting Stage 1A status to IARRs is preferential treatment of IARR rights relative to the ARR rights belonging to load. If the annual market model used to assign existing ARR rights in a given year cannot simultaneously support all Stage 1A ARR requests, the system model is modified so as to make the Stage 1A ARR requests feasible. The result is an over allocation of congestion rights relative to expected congestion. To avoid having FTR target allocations exceed expected congestion, PJM reduces the annual supply (market model system capability) available to non-Stage 1A rights through selective line outages and line rating reductions. The resulting market model artificially supports all the Stage 1A ARR requests and artificially reduces the amount of remaining later tier ARRs from other rights holders. Stage 1A ARRs, including IARRs, are approved at the expense of other preexisting congestion rights. In the case of IARRs, this is in violation of Order No. 681.

The MMU recommends that IARRs be eliminated from the PJM tariff. If IARRs are not eliminated, the MMU recommends that IARRs be subject to prorating like all other ARR rights rather than being exempt from prorating.

## Financial Transmission Rights

FTRs are financial instruments that entitle their holders to receive revenue or require them to pay charges based on locational congestion price differences in the day-ahead energy market across specific FTR transmission paths. These day-ahead congestion price differences (shadow prices), multiplied by the FTR position in MW, are termed the FTR target allocations. The FTR target allocations define the maximum, but not guaranteed, payout for FTRs. The target allocation of an FTR reflects the difference in day-ahead congestion prices (CLMPs) rather than the difference in LMPs, which includes both congestion and marginal losses. Negative target allocations require the FTR holder to make payments rather than receive revenues in the FTR market. One of the fundamental flaws in the FTR design is the mismatch between congestion and the differences in day-ahead prices between nodes. The difference in day-ahead congestion prices is not congestion. Target allocations are not congestion.

Under the current rules, the revenue available to pay FTR holders' target allocations in a given month includes day-ahead congestion, payments by holders of negatively valued FTRs, auction revenues greater than ARR target allocations, and any charges made to day-ahead operating reserves which occur where there are hours with net negative congestion. Any such revenue above FTR target allocations from prior months in a planning period are used to pay any current month shortfalls. Target allocations are a cap on payments to FTR holders for each planning period. At the end of each planning period, any surplus revenue above the target allocations is distributed to ARR holders.

FTR funding is not on a path specific basis or on an hour to hour basis and treats all FTRs the same. For example, if the payout ratio is less than 1.0 at the end of the planning period, the payments to all FTRs are reduced. Payments are made pro rata based on target allocations. The result is widespread cross subsidies because assignment of path specific FTRs may exceed system capability and affect the payments to FTRs on other paths. FTR auction revenues and excess revenues are carried forward from prior months and distributed back from later months within a planning period. At the end of a planning period, if the total revenue is less than the total target allocations, an uplift charge is collected from any FTR market participants that hold FTRs for

<sup>24</sup> See November 7, 2019 Comments on TranSource, LLC v. PJM, 168 FERC ¶ 61,119 (2019) ("Opinion No. 566").

<sup>25</sup> *Long-Term Firm Transmission Rights in Organized Electricity Markets*, Order No. 681, 116 FERC ¶ 61,077 (2006) ("Order No. 681"), order on reh'g, Order No. 618-A, 117 FERC ¶ 61,201 (2006), order on reh'g, Order No. 681-A, 126 FERC ¶ 61,254 (2009).

the planning period, based on their pro rata share of total net positive FTR target allocations, excluding any charge to FTR holders with a net negative FTR position for the planning period.

Auction market participants may offer to buy FTRs between any eligible pricing nodes on the system, as defined by PJM for each auction. For the Annual FTR Auction and FTRs bought in the monthly auctions, the available FTR source and sink points include hubs, control zones, aggregates, generator buses, load buses and interface pricing points. For the Long Term FTR Auction there is a more restricted set of available hubs, control zones, aggregates, generator buses and interface pricing points available. PJM does not allow FTR buy bids to clear with a price of zero unless there is at least one constraint in the auction which affects the FTR path. FTRs are available to the nearest 0.1 MW.

FTRs are bought from supply defined by PJM. The fact that load is selling congestion revenue rights is not fully recognized in the FTR design, although FTR buyers can resell FTRs at a price they agree to accept. Load has no role in defining the price at which PJM sells FTRs on their behalf. PJM's objective in the auctions is to maximize auction revenue, but only based on the total set of bid prices and bid MW, but absent reservation prices from load. The failure to allow sellers the ability to decide at what price to sell FTRs is a fundamental flaw in the FTR market. The result is that PJM cannot actually maximize auction revenue and that the FTR market is not really a market.

Once bought from PJM, FTRs can be bought and sold. Buy bids are bids to buy FTRs in the auctions. Sell offers are offers to sell existing FTRs in the auctions.

Market participants can buy and sell existing FTRs, outside of the auction process, through a voluntary bulletin board, termed the PJM bilateral market. FTRs can also be exchanged bilaterally without using the bulletin board. There is no requirement to report bilateral transactions, or any information about them, to PJM.

## Supply and Demand

Total FTR supply in each auction is limited by the definition of the transmission system capacity included in the PJM FTR market model as modified, for example, by PJM assumptions about transmission outages, for

which there are no clear rules. PJM may also limit available transmission capacity through subjective judgment exercised without any clear guidelines.

The MMU recommends that the full transmission capacity of the system be allocated as ARR as prior to sale as FTRs.

The FTR auction process does not account for the fact that significant transmission outages, which have not been provided to PJM by transmission owners prior to the auction date, will occur during the periods covered by the auctions. Such transmission outages may or may not be planned in advance or may be emergency outages.<sup>26</sup> In addition, it is difficult to model in an annual auction two outages of similar significance and similar duration in different areas which do not overlap in time. The choice of which to model will generally have significant distributional consequences; they will affect different areas very differently. The fact that outages are modeled at significantly lower than historical levels results in selling too much FTR capacity, which creates downward pressure on ARR prices. To address this issue within the existing design, the MMU recommends that PJM use probabilistic outage modeling to better align the supply of ARRs and FTRs with actual expected transmission capacity.

## Long Term FTR Auctions

In July 2006, FERC approved Order No. 681 mandating the creation of long term firm transmission rights in transmission organizations with organized electricity markets. FERC's goal was that "load serving entities be able to request and obtain transmission rights up to a reasonable amount on a long-term firm basis, instead of being limited to obtaining exclusively annual rights."<sup>27</sup> Despite that order and inconsistent with the directive in that order, LSEs are not able to request ARRs nor are LSEs guaranteed rights to the revenue from Long Term FTR Auctions in PJM's long term FTR auction market design. Excess system capability in years two and three of the long term FTR auction is never made available to load in the form of ARRs and is only made available to FTR buyers.

PJM conducts the Long Term FTR Auction for the next three consecutive planning periods. The Long Term FTR Auction consists of five rounds beginning in June of

<sup>26</sup> See the 2022 Annual State of the Market Report for PJM, Volume 2, Section 12: Transmission Facility Outages: Transmission Facility Outages Analysis for the FTR Market.

<sup>27</sup> Order No. 681 at P 17.

the preceding planning period and continuing through March. FTRs purchased in prior rounds or Long Term Auctions may be offered for sale in subsequent rounds of the long term, annual or monthly FTR auctions. FTRs obtained in the Long Term FTR Auctions have terms of one year. FTR products available in the Long Term Auction include 24 hour, on peak and off peak FTR obligations, with FTR options unavailable in the Long Term FTR Auctions.

Beginning with Round 2 of the 2019/2022 Long Term FTR Auction, PJM implemented revisions to the determination of residual system capability made available in the Long Term FTR Auctions, and eliminated the YRALL product, consistent with the MMU's recommendation. The revisions affect the determination of ARR rights reserved for ARR holders. Rather than simply preserving the ARR cleared capacity from the previous annual allocation, PJM reruns the simultaneous feasibility test for the ARR/FTR market model, without outages, using the previous year's ARR requests, prorated when necessary, and uses the resulting ARRs as the basis for reserving capability for ARR holders in the Long Term FTR Auction. The ARR requests are greater than the previously cleared ARRs. The difference between the requested ARRs and the ARR/FTR market model's transmission system capacity, both without outages, determines the residual capability offered in the Long Term FTR Auction. The revisions provide ARR holders with more congestion rights in the Long Term FTR Auction that will carry into the Annual FTR Auction.

But the revisions do not address the congestion revenue rights sold in years two and three of the Long Term FTR Auction, which remain unavailable to ARRs. Capacity awarded in the Long Term FTR Auction is unavailable as ARRs in years two and three. As a result, the rights to significant congestion revenues are still assigned to the Long Term FTR Auction without ever having been made available to ARR holders. That outcome is inconsistent with the basic logic of ARRs and inconsistent with the stated intent of the market design which is to return all congestion revenues to load.

Long Term FTR Auction transmission capacity is determined by removing all outages and running an offline model of the previous Annual FTR Auction model with all ARR bids from the prior annual ARR allocation. Any ARR MW that clear in this offline model

are reserved for ARR holders in the relevant planning periods, and are removed from the Long Term FTR Auction capability. Even this approach does not, and cannot, preserve all possible capacity for ARR holders in the first year of the Long Term Auction due to changes in system topology and outage selection between planning periods. PJM outage assumptions are a key factor in determining the supply of ARRs and the related supply of FTRs in the Annual FTR Auction.

### Annual FTR Auctions

Annual FTRs are effective for an entire planning period, June 1 through May 31. Outages expected to last two or more months, as well as any outages of a shorter duration that PJM decides would cause FTR revenue inadequacy if not modeled, are included in the determination of the simultaneous feasibility for the Annual FTR Auction.<sup>28</sup> While the full list of outages selected is publicly posted, PJM exercises significant subjective judgment in selecting outages to accomplish FTR revenue adequacy goals and the process by which these outages are selected is not clear, is not defined and is not documented. ARR holders who wish to self schedule must inform PJM prior to round one of the annual auction. Any self scheduled ARR requests clear 25 percent of the requested volume in each round of the Annual FTR Auction as price takers. The Annual FTR Auction consists of four rounds that allow any PJM member to bid for any FTR or to offer for sale any FTR that they currently hold. FTRs in the auctions include obligations and options and 24 hour, peak, off peak, and weekend peak products. FTRs purchased in one round of the Annual FTR Auction can be sold in later rounds or in the Monthly Balance of Planning Period FTR Auctions.

### Monthly Balance of Planning Period FTR Auctions

Total Monthly FTR Auction capacity is based on the residual capacity available after the Long Term and Annual FTR auctions are conducted and adjustments are made to outages to reflect anticipated system conditions for the time periods auctioned. Outages expected to last five or more days are included in the determination of the simultaneous feasibility test for the Monthly Balance of Planning Period FTR Auction. These are single round monthly auctions that allow any transmission service customer or PJM member to bid for any FTR or to offer for sale any FTR that they currently hold. Beginning with

28 See "PJM Manual 6: Financial Transmission Rights," Rev. 33 (Sep. 24, 2024).



the 2020/2021 planning period, market participants can bid for or offer monthly FTRs for any of the remaining individual calendar months in the planning period. FTRs in the auctions include obligations and options and 24 hour, peak, off peak, and weekend peak products.<sup>29</sup>

## Bilateral Market

Market participants can buy and sell existing FTRs, outside of the auction process, through a voluntary bulletin board, termed the PJM bilateral market. FTRs can also be exchanged bilaterally without using the bulletin board. Bilateral transactions that are not done through PJM can involve parties that are not PJM members. PJM has no knowledge of bilateral transactions, or the terms and risks of bilateral transactions, that are done outside of PJM's bilateral market system. Prior to June 30, 2024, there was no requirement to report accurate detailed information about bilateral transactions settled through PJM billing systems. Effective June 30, 2024, the Commission accepted PJM's proposed revisions to the rules that required the reporting of bilateral price information and corroborating contract documents of any bilateral change of FTR ownership between participants/accounts that is settled through PJM settlement systems.<sup>30</sup> Bilateral transactions remain dependent on the contract established between the parties.

For bilateral trades reported to PJM, the FTR transmission path must remain the same, FTR obligations must remain obligations, and FTR options must remain options. However, an individual FTR may be split up into multiple, smaller FTRs, down to increments of 0.1 MW. Bilateral FTRs reported to PJM can also include more restrictive start and end times, meaning that the start time cannot be earlier than the original FTR start time and the end time cannot be later than the original FTR end time. Once the bilateral transaction is reported to PJM, PJM transfers ownership and adjusts credit requirements accordingly. Participants have used bilateral trades reported to PJM to reduce their credit requirements.

PJM's revised rules related to bilateral contracts fail to address the impact of PJM's indemnification rules. PJM stated that the "maintenance of the assumption of risk and costs is not a continuing interest in the FTR once sold; a continuing interest would be a right or benefit

with respect to the subject FTR that survives the bilateral transaction." Contrary to logic, PJM asserts that only positive interests count as interests. Assumption of risks and costs of an FTR is, by definition, assumption of a financial interest in an FTR. When a participant buys an FTR in an auction, they assume the risks and costs of the FTR. Under PJM's indemnification rules the participant that bilaterally trades an FTR retains risks and costs associated with that FTR. Under PJM's indemnification rules, a bilateral seller of an FTR therefore has a continuing direct financial interest in that FTR and a direct financial interest in the credit and collateral of the buyer.

PJM's FTR market is the most transparent of all PJM markets. The facilitation of confidential bilateral transactions undercuts that transparency and therefore the efficiency of the FTR market. The bilateral information would be provided solely to PJM and not to the market. Transparency for PJM alone is not market transparency. The facilitation of confidential bilateral transactions does nothing to advance or improve the basic function of FTR markets.

There is no reason to continue to permit bilateral transactions outside the PJM FTR market. The MMU recommends that the bilateral FTR transactions market be eliminated and that all FTR transactions should take place in the FTR auctions, in order to provide full transparency, effective price discovery, and to minimize risk to market participants and PJM members.<sup>31</sup> The bilateral FTR market provides a PJM facilitated mechanism that undermines transparency for market participants and for loads whose congestion revenues fund FTRs. Bilateral FTR trading outside of PJM's transparent FTR market is inefficient, inconsistent with the basic structure and purpose of the PJM FTR market, and creates unnecessary credit risk.

## Market Structure

In order to evaluate the ownership of FTRs, the MMU categorizes all participants owning FTRs in PJM as either physical or financial. Physical entities include utilities and customers which primarily take physical positions in PJM markets. Financial entities include banks, trading firms and hedge funds which primarily take financial positions in PJM markets. International

<sup>29</sup> See "PJM Manual 6: Financial Transmission Rights," Rev. 33 (Sep. 24, 2024).

<sup>30</sup> See 187 FERC ¶ 61,020.

<sup>31</sup> See Protest of the Independent Market Monitor for PJM, Docket No. ER24-374-000 (November 30, 2023); Comments of the Independent Market Monitor for PJM, Docket No. ER24-374-000 (February 6, 2024).



market participants that primarily take financial positions in PJM markets are generally considered to be financial entities even if they are utilities in their own countries.

Table 13-11 shows the 2024/2027 Long Term FTR Auction market cleared FTRs by trade type, organization type and FTR direction. The results show that financial entities purchased 87.8 percent of prevailing flow buy bid FTRs and 91.0 percent of counter flow buy bid FTRs with the result that financial entities purchased 89.3 percent of all long term FTR auction cleared buy bids. Physical entities purchased 10.7 percent of all cleared long term FTRs in the 2023/2026 Long Term FTR Auction, down 1.7 percentage points from the previous Long Term FTR Auction.

**Table 13-11 Long term FTR auction patterns of ownership by FTR direction: 2024/2027 auction**

Trade Type	Organization Type	FTR Direction		
		Prevailing Flow	Counter Flow	All
Buy Bids	Physical	12.2%	9.0%	10.7%
	Financial	87.8%	91.0%	89.3%
	Total	100.0%	100.0%	100.0%
Sell Offers	Physical	8.3%	8.6%	8.4%
	Financial	91.7%	91.4%	91.6%
	Total	100.0%	100.0%	100.0%

Table 13-12 shows the HHI for the individual periods in the 2017/2020 through 2024/2025 Long Term FTR Auctions and the entire auction. The YRALL auction was highly concentrated until its removal in the 2020/2023 Long Term Auction. The individual annual auctions are unconcentrated with the exception of years two and three of the 2017/2020 Auction and year three of the 2023/2026 Auction.

**Table 13-12 Long term HHIs by auction**

Auction	YR1	YR2	YR3	YRALL	Entire Auction
2017/2020 Long Term Auction	779	1779	1354	8533	884
2018/2021 Long Term Auction	711	940	749	8654	693
2019/2022 Long Term Auction	492	647	768	9954	506
2020/2023 Long Term Auction	567	575	638	NA	463
2021/2024 Long Term Auction	495	535	767	NA	460
2022/2025 Long Term Auction	518	626	888	NA	598
2023/2026 Long Term Auction	496	713	1049	NA	644
2024/2027 Long Term Auction	473	656	949	NA	592

Table 13-13 shows the annual FTR auction cleared FTRs for the 2024/2025 planning period by trade type, organization type and FTR direction. In the Annual FTR Auction for the 2024/2025 planning period, financial entities purchased 82.9 percent of prevailing flow FTRs,

down 2.0 percentage points, and 90.6 percent of counter flow FTRs, up 0.4 percentage points, with the results that financial entities purchased 85.7 percent, up 1.5 percentage points, of all annual FTR auction cleared buy bids for the 2024/2025 planning period.

**Table 13-13 Annual FTR Auction patterns of ownership by FTR direction: 2024/2025 planning period**

Trade Type	Organization Type	Self-Scheduled FTRs	FTR Direction		
			Prevailing Flow	Counter Flow	All
Buy Bids	Physical	Yes	4.5%	0.0%	2.9%
		No	12.6%	9.4%	11.4%
	Total		17.1%	9.4%	14.3%
	Financial	No	82.9%	90.6%	85.7%
	Total		100.0%	100.0%	100.0%
Sell Offers	Physical		5.4%	8.8%	6.8%
	Financial		94.6%	91.2%	93.2%
	Total		100.0%	100.0%	100.0%

Table 13-14 shows the HHI values for cleared buy and self scheduled bids for the 2016/2017 through 2024/2025 Annual FTR Auctions. Obligation buy bids are consistently unconcentrated, while Option buy bids are unconcentrated to moderately concentrated. Cleared self scheduled bids are always highly concentrated.

**Table 13-14 Annual auction HHIs by auction**

Auction	Offset Type	Trade Type	HHI
2024/2025 Annual Auction	Obligation	Buy	399
		Self Scheduled	2,975
	Option	Buy	822
2023/2024 Annual Auction	Obligation	Buy	425
		Self Scheduled	2,595
	Option	Buy	1,220
2022/2023 Annual Auction	Obligation	Buy	424
		Self Scheduled	3,398
	Option	Buy	884
2021/2022 Annual Auction	Obligation	Buy	420
		Self Scheduled	3,291
	Option	Buy	957
2020/2021 Annual Auction	Obligation	Buy	278
		Self Scheduled	2,970
	Option	Buy	1,299
2019/2020 Annual Auction	Obligation	Buy	251
		Self Scheduled	2,661
	Option	Buy	978
2018/2019 Annual Auction	Obligation	Buy	357
		Self Scheduled	2,620
	Option	Buy	1,213
2017/2018 Annual Auction	Obligation	Buy	303
		Self Scheduled	2,794
	Option	Buy	2,099

Table 13-15 presents the monthly balance of planning period FTR auction cleared FTRs for the first seven months of the 2024/2025 planning period by trade type, organization type and FTR direction. Financial entities purchased 75.2 percent of prevailing flow FTRs, down

5.5 percentage points, and 86.8 percent of counter flow FTRs, down 4.9 percentage points, from the 2023/2024 planning period, with the result that financial entities purchased 80.4 percent, down 5.3 percentage points, of all prevailing and counter flow FTR buy bids in the monthly balance of planning period FTR auction for the first seven months of the 2024/2025 planning period.

**Table 13-15 Monthly Balance of Planning Period FTR Auction patterns of ownership by FTR direction: 2024/2025 planning period**

Trade Type	Organization Type	FTR Direction		
		Prevailing Flow	Counter Flow	All
Buy Bids	Physical	24.8%	13.2%	19.6%
	Financial	75.2%	86.8%	80.4%
	Total	100.0%	100.0%	100.0%
Sell	Physical	10.0%	8.7%	9.6%
	Financial	90.0%	91.3%	90.4%
	Total	100.0%	100.0%	100.0%

Table 13-16 shows the monthly cumulative HHI values for cleared obligation MW for the first seven months of the 2024/2025 planning period monthly auctions for prevailing flow FTRs. Ownership of cleared prevailing flow bids was unconcentrated in 100 percent of auction periods.<sup>32</sup>

**Table 13-16 Monthly Balance of Planning Period FTR Auction HHIs by period for prevailing flow FTRs**

Auction	Auction Period											
	JUN	JUL	AUG	SEP	OCT	NOV	DEC	JAN	FEB	MAR	APR	MAY
Jun-24	418	512	468	551	556	579	610	540	565	574	656	654
Jul-24		415	447	547	544	587	609	505	523	579	657	662
Aug-24			414	580	550	609	597	509	513	594	645	670
Sep-24				490	545	569	596	513	516	597	617	657
Oct-24					457	560	559	507	514	574	607	633
Nov-24						489	542	499	514	584	597	636
Dec-24							486	494	507	586	598	636

Table 13-17 shows the monthly cumulative HHI values for cleared obligation MW for the first seven months of the 2024/2025 planning period monthly auctions by month for counter flow FTRs. Ownership of cleared counter flow bids was unconcentrated in 11.1 percent of periods and moderately concentrated in 88.9 percent of auction periods.

**Table 13-17 Monthly Balance of Planning Period FTR Auction HHIs by period for counter flow FTRs**

Auction	Auction Period											
	JUN	JUL	AUG	SEP	OCT	NOV	DEC	JAN	FEB	MAR	APR	MAY
Jun-24	685	676	692	790	944	926	937	1055	984	1085	1051	1062
Jul-24		618	639	779	943	877	892	943	902	1030	945	1005
Aug-24			580	776	897	850	896	949	917	1008	955	969
Sep-24				631	836	833	880	956	950	987	966	969

Table 13-18 shows the average daily FTR ownership for all FTRs for the first seven months of the 2024/2025 planning period by organization type, by FTR direction and self scheduled FTRs.

**Table 13-18 Daily FTR held position ownership by FTR direction: June through September, 2024/2025 planning period**

Organization Type	FTR Direction		
	Prevailing Flow	Counter Flow	All
Physical	23.1%	16.6%	20.2%
Physical Self Scheduled	7.9%	0.0%	4.4%
Financial	69.0%	83.4%	75.3%
Total	100.0%	100.0%	100.0%

<sup>32</sup> See 2024 Quarterly State of the Market Report for PJM: January through March, Section 3: Energy Market, Competitive Assessment for HHI definitions.

## Market Performance

### Volume

PJM regularly intervenes in the FTR market based on subjective judgment which is not based on clear or documented guidelines. Such intervention in the FTR market, or any market, is not appropriate and not consistent with the operation of competitive markets. In an apparent effort to manage FTR revenues, PJM may adjust normal transmission limits in the FTR auction model. If, in PJM's judgment, the normal transmission limit is not consistent with revenue adequacy goals and simultaneous feasibility, then transmission limits are reduced pro rata based on the MW of Stage 1A infeasibility and the availability of auction bids for counter flow FTRs.<sup>33</sup> PJM may also remove or reduce infeasibilities caused by transmission outages by clearing counter flow bids without being required to clear the corresponding prevailing flow bids.<sup>34</sup> The use of both of these procedures is contingent on the conditions that: PJM actions not affect the revenue adequacy of allocated ARRs; all requested self scheduled FTRs clear; and net FTR auction revenue is positive.

### Long Term FTR Auction

In the 2024/2027 Long Term FTR Auction, 304,456 MW (18.3 percent of bid volume; 47.7 percent of total FTR volume) of counter flow FTR buy bids cleared, a decrease from 209,710 MW and an decrease from 74.36 percent of total FTR volume. In the same auction, prevailing flow FTR buy bids cleared 638,671 MW (11.1 percent of bid volume; 52.3 percent of total FTR volume) an increase from 72,547 MW and a decrease from 74.3 percent of total FTR volume. In the 2024/2027 Long Term FTR Auction, 48,391 MW (9.5 percent) of counter flow sell offers and 91,116 MW (11.6 percent) of prevailing flow sell offers cleared.

**Table 13-19 Long Term FTR Auction market volume: 2024/2027 auction**

		Period	Bid and	Bid and				
Trade Type	FTR Direction	Type	Requested	Requested	Cleared	Cleared	Uncleared	Uncleared
			Count	Volume (MW)	Volume (MW)	Volume	Volume (MW)	Volume
Buy bids	Counter Flow	Year 1	189,443	653,456	139,218	21.3%	514,238	78.7%
		Year 2	132,032	519,028	81,943	15.8%	437,085	84.2%
		Year 3	117,906	489,914	83,295	17.0%	406,618	83.0%
		Total	439,381	1,662,397	304,456	18.3%	1,357,941	81.7%
	Prevailing Flow	Year 1	348,254	1,648,771	159,555	9.7%	1,489,215	90.3%
		Year 2	230,970	1,272,042	90,045	7.1%	1,181,997	92.9%
		Year 3	189,780	1,146,408	84,615	7.4%	1,061,793	92.6%
		Total	769,004	4,067,221	334,216	8.2%	3,733,005	91.8%
	Total	1,208,385	5,729,618	638,671	11.1%	5,090,946	88.9%	
	Sell offers	Counter Flow	Year 1	99,172	281,431	33,255	11.8%	248,176
Year 2			59,554	161,934	11,923	7.4%	150,011	92.6%
Year 3			26,929	64,401	3,213	5.0%	61,188	95.0%
Total			185,655	507,767	48,391	9.5%	459,375	90.5%
Prevailing Flow		Year 1	110,044	409,452	55,993	13.7%	353,458	86.3%
		Year 2	78,492	300,129	29,275	9.8%	270,855	90.2%
		Year 3	24,303	76,630	5,848	7.6%	70,783	92.4%
		Total	212,839	786,211	91,116	11.6%	695,095	88.4%
Total		398,494	1,293,978	139,507	10.8%	1,154,471	89.2%	

<sup>33</sup> See "PJM Manual 6: Financial Transmission Rights," Rev. 33 (Sep. 24, 2024).

<sup>34</sup> See *id.*

Figure 13-3 shows the percent of FTR MW cleared, and bid and cleared volume, by direction, for each round of the Long Term FTR Auction from the 2015/2018 through the 2024/2027 auctions.

**Figure 13-3 Long Term FTR Auction bid and cleared volume by round and direction**

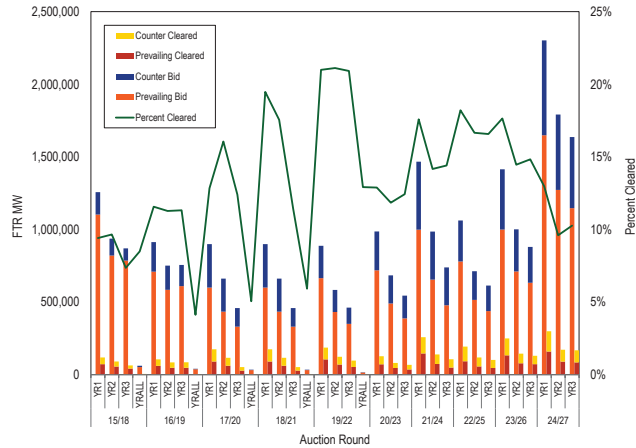


Table 13-20 compares cleared FTR obligations (not options) acquired in the Long Term FTR Auctions to the total cleared FTR obligations from the Annual FTR Auction, for FTRs in the 2014/2015 through 2024/2025 planning periods. A three year FTR is distributed to each individual planning period during its three year effective period. Long term FTRs that are effective in a single planning period were an average of 40.4 percent of total FTR volume in the 2014/2015 through 2024/2025 planning periods.

**Table 13-20 Long Term and Annual Auction total cleared FTR MW**

Effective Planning Period	Long Term FTR Product (Including YRALL)			Obligation Volume (MW)		
	YR3	YR2	YR1	Total Long Term	Annual	Long Term
					(including self scheduled)	Percent of Total Cleared
2014/2015	81,666	86,754	131,911	300,330	356,522	45.7%
2015/2016	89,419	99,329	123,400	312,148	355,682	46.7%
2016/2017	97,837	95,637	107,182	300,656	397,258	43.1%
2017/2018	69,161	86,323	108,126	263,609	493,683	34.8%
2018/2019	87,232	109,827	176,998	374,057	549,669	40.5%
2019/2020	80,947	118,112	188,438	387,496	576,937	40.2%
2020/2021	54,451	125,330	127,054	306,835	525,550	36.9%
2021/2022	98,829	80,998	205,008	384,835	512,449	42.9%
2022/2023	67,603	120,621	193,268	381,492	467,194	45.0%
2023/2024	100,973	118,618	249,482	469,073	770,310	37.8%
2024/2025	101,674	144,699	298,773	545,145	944,669	36.6%

Table 13-21 shows the MW proportion of FTRs by source and sink node type for cleared buy bids in the 2024/2027 Long Term FTR Auction. Generator to generator FTRs comprise 61.9 percent of all cleared FTR buy bids, up 1.8 percentage points from the 2023/2026 Long Term FTR Auction.

Table 13-21 Long Term FTR node type matrix: 2024/2027 auction

Source Type	Sink Type						Zone
	Aggregate	Generator	Hub	Interface	Load	Residual Metered Aggregate	
Aggregate	1.4%	6.4%	0.1%	0.3%	0.1%	0.2%	0.3%
Generator	5.8%	61.9%	2.5%	2.6%	1.2%	0.9%	3.0%
Hub	0.2%	0.5%	1.2%	0.1%	0.0%	0.2%	2.1%
Interface	0.1%	0.3%	0.0%	0.0%	0.0%	0.0%	0.1%
Load	0.1%	0.5%	0.0%	0.0%	0.0%	0.0%	0.0%
Residual Metered Aggregate	0.2%	1.3%	0.1%	0.0%	0.0%	0.0%	0.1%
Zone	0.4%	2.2%	1.2%	0.2%	0.1%	0.4%	1.9%

## Annual FTR Auction

Table 13-22 shows the annual FTR auction market volume for the 2024/2025 Annual FTR Auction. Total FTR buy bids were 4,741,013 MW, up 26.5 percent from 3,746,935 MW for the previous Annual FTR Auction. For the 2024/2025 Annual FTR Auction 999,108 MW (21.1 percent) of buy bids cleared, up 17.4 percent from 851,248 MW (22.7 percent) for the previous Annual FTR Auction. There were 1,172,749 MW of sell offers, up 30.5 percent from 898,579 for the previous Annual FTR Auction. For the 2024/2025 Annual FTR Auction 124,227 MW (10.6 percent) of sell offers cleared, up 35.4 percent from 91,769 for the previous Annual FTR Auction. The total volume of cleared buy and self scheduled bids was 1,028,420 MW, up 17.1 percent from 878,232 MW in the previous Annual FTR Auction.

Table 13-22 Annual FTR Auction market volume: 2024/2025 auction

Trade Type	Type	FTR Direction	Bid and Requested Count	Bid and Requested Volume (MW)	Cleared Volume (MW)	Cleared Volume	Uncleared Volume (MW)	Uncleared Volume
Buy bids	Obligations	Counter Flow	324,545	1,138,470	380,256	33.4%	758,214	66.6%
		Prevailing Flow	669,280	2,704,200	535,100	19.8%	2,169,100	80.2%
		Total	993,825	3,842,671	915,357	23.8%	2,927,314	76.2%
	Options	Counter Flow	0	0	0	NA	0	NA
		Prevailing Flow	91,803	898,342	83,752	9.3%	814,591	90.7%
		Total	91,803	898,342	83,752	9.3%	814,591	90.7%
	Total	Counter Flow	324,545	1,138,470	380,256	33.4%	758,214	66.6%
		Prevailing Flow	761,083	3,602,543	618,852	17.2%	2,983,691	82.8%
		Total	1,085,628	4,741,013	999,108	21.1%	3,741,905	78.9%
	Self-scheduled bids	Counter Flow	48	178	122	68.6%	56	31.4%
		Prevailing Flow	7,972	29,190	29,190	100.0%	0	0.0%
		Total	8,020	29,368	29,312	99.8%	56	0.2%
Buy and self-scheduled bids	Obligations	Counter Flow	324,593	1,138,648	380,378	33.4%	758,270	66.6%
		Prevailing Flow	677,252	2,733,390	564,290	20.6%	2,169,100	79.4%
		Total	1,001,845	3,872,038	944,669	24.4%	2,927,370	75.6%
	Options	Counter Flow	0	0	0	NA	0	NA
		Prevailing Flow	91,803	898,342	83,752	9.3%	814,591	90.7%
		Total	91,803	898,342	83,752	9.3%	814,591	90.7%
	Total	Counter Flow	324,593	1,138,648	380,378	33.4%	758,270	66.6%
		Prevailing Flow	769,055	3,631,733	648,042	17.8%	2,983,691	82.2%
		Total	1,093,648	4,770,381	1,028,420	21.6%	3,741,960	78.4%
	Sell offers	Counter Flow	136,335	473,730	50,626	10.7%	423,104	89.3%
		Prevailing Flow	184,232	679,355	72,977	10.7%	606,378	89.3%
		Total	320,567	1,153,085	123,603	10.7%	1,029,482	89.3%
	Options	Counter Flow	0	0	0	NA	0	NA
		Prevailing Flow	6,416	19,663	624	3.2%	19,039	96.8%
		Total	6,416	19,663	624	3.2%	19,039	96.8%
	Total	Counter Flow	136,335	473,730	50,626	10.7%	423,104	89.3%
		Prevailing Flow	190,648	699,018	73,601	10.5%	625,417	89.5%
		Total	326,983	1,172,749	124,227	10.6%	1,048,522	89.4%



Figure 13-4 shows the percent of FTR MW cleared and bid and cleared volume, by direction, for each round of the Annual FTR Auction from the 2015/2016 planning period through the 2024/2025 planning period.

**Figure 13-4 Annual FTR Auction bid and cleared volume by round and direction**

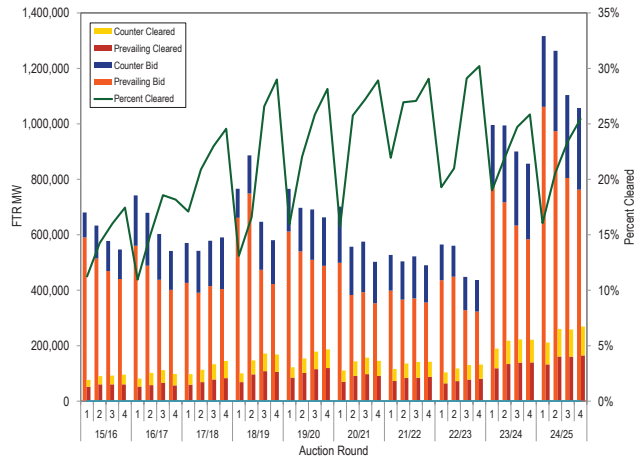


Figure 13-5 shows the proportion of ARRs self scheduled as FTRs for the last sixteen planning periods. The maximum possible level of self scheduled FTRs is equal to total ARRs. Eligible participants self scheduled 29,312 MW (25.3 percent) of ARRs as FTRs for the 2024/2025 planning period, compared to 26,984MW (24.1 percent) in the previous planning period.

**Figure 13-5 Comparison of self scheduled FTRs: 2009/2010 through 2024/2025 planning periods**

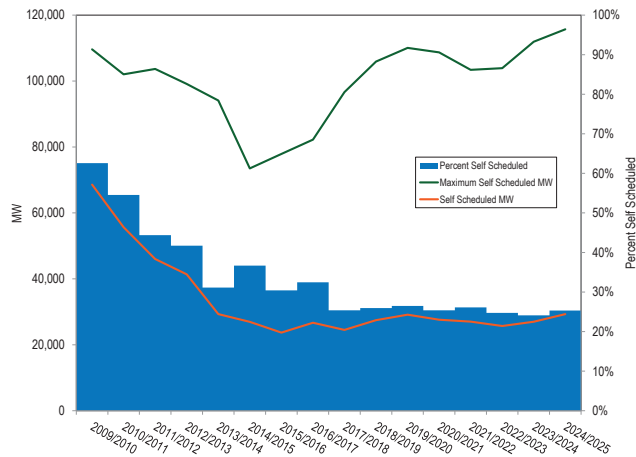


Table 13-23 shows the MW proportion of FTRs by source and sink node type for cleared buy and self scheduled bids in the 2024/2025 Annual FTR Auction.

Generator to generator FTRs comprise 57.7 percent of all cleared FTR buy and self scheduled bids in the 2024/2025 Annual Auction, up 6.4 percentage points from the previous planning period. Generator to generator FTRs make up a disproportionate share of total FTRs. Congestion results from load paying more for generation than generators receive. By definition, congestion is between generator sources and load sinks. Generator to generator paths do not represent the delivery of generation to load. FTRs between generators simply create a speculative opportunity because they can be a low cost or zero cost FTR in the current design with a significant payoff if there is a price difference between the two nodes.

The MMU recommends that PJM examine the source and sink node combinations available in the FTR market and eliminate generation to generation paths and all other paths that do not represent the delivery of power to load.

**Table 13-23 Annual auction FTR node type matrix by proportion of MW: 2024/2025 auction**

Source Type	Sink Type						Zone
	Aggregate	Generator	Hub	Interface	Load	Residual Metered Aggregate	
Aggregate	1.7%	6.0%	0.2%	0.1%	0.0%	0.4%	0.7%
Generator	10.7%	57.7%	3.1%	1.1%	0.4%	3.8%	5.2%
Hub	0.3%	0.6%	0.3%	0.0%	0.0%	0.3%	1.3%
Interface	0.1%	0.6%	0.0%	0.0%	0.0%	0.1%	0.1%
Load	0.0%	0.3%	0.0%	0.0%	0.0%	0.0%	0.0%
Residual Metered Aggregate	0.1%	0.6%	0.0%	0.0%	0.0%	0.0%	0.2%
Zone	0.2%	1.2%	0.7%	0.1%	0.0%	0.6%	1.0%

## Monthly Balance of Planning Period Auctions

Table 13-24 provides the monthly balance of planning period FTR auction market volume for the entire 2023/2024 and the first seven months of the 2024/2025 planning periods. There were 37,813,622 MW of FTR obligation buy bids and 32,235,529 MW of FTR obligation sell offers for all bidding periods in the first seven months of the 2024/2025 planning period.<sup>35</sup> The monthly balance of planning period FTR auction cleared 7,497,280 (19.8 percent) of FTR obligation buy bids and 4,530,061 MW (14.1 percent) of FTR obligation sell offers.

There were 10,347,072 MW of FTR option buy bids and 3,997,290 MW of FTR option sell offers for all bidding periods in the Monthly Balance of Planning Period FTR Auctions for the first seven months of the 2024/2025 planning period. The monthly balance of planning period FTR auction auctions cleared 605,096 MW (5.8 percent) of FTR option buy bids and 706,952 MW (17.7 percent) of FTR option sell offers.

<sup>35</sup> The term obligation is used only to distinguish FTRs from options.

Table 13-24 Monthly Balance of Planning Period FTR Auction market volume: June 2023 through December 2024

Monthly Auction	Type	Trade Type	Bid and Requested Count	Bid and Requested Volume (MW)	Cleared Volume (MW)	Cleared Volume	Uncleared Volume (MW)	Uncleared Volume
Jun-24	Obligations	Buy bids	1,312,933	6,919,534	1,299,715	18.8%	5,619,819	81.2%
		Sell offers	1,647,119	6,669,597	1,232,151	18.5%	5,437,446	81.5%
	Options	Buy bids	143,742	1,710,475	129,676	7.6%	1,580,799	92.4%
		Sell offers	128,612	613,087	144,607	23.6%	468,481	76.4%
Jul-24	Obligations	Buy bids	1,304,470	6,368,767	1,252,921	19.7%	5,115,847	80.3%
		Sell offers	1,448,437	5,340,586	875,146	16.4%	4,465,439	83.6%
	Options	Buy bids	116,055	1,674,802	114,886	6.9%	1,559,916	93.1%
		Sell offers	124,464	604,421	118,377	19.6%	486,043	80.4%
Aug-24	Obligations	Buy bids	1,199,373	5,921,371	1,135,585	19.2%	4,785,786	80.8%
		Sell offers	1,284,629	4,786,365	649,828	13.6%	4,136,537	86.4%
	Options	Buy bids	88,767	1,889,366	99,863	5.3%	1,789,503	94.7%
		Sell offers	115,553	604,259	110,750	18.3%	493,510	81.7%
Sep-24	Obligations	Buy bids	1,146,593	5,376,183	1,064,493	19.8%	4,311,690	80.2%
		Sell offers	1,149,098	4,389,929	522,532	11.9%	3,867,397	88.1%
	Options	Buy bids	76,902	1,483,823	75,670	5.1%	1,408,153	94.9%
		Sell offers	108,198	589,944	74,525	12.6%	515,420	87.4%
Oct-24	Obligations	Buy bids	1,026,105	5,004,045	1,042,143	20.8%	3,961,903	79.2%
		Sell offers	1,051,380	4,041,127	407,262	10.1%	3,633,865	89.9%
	Options	Buy bids	70,212	1,284,723	66,866	5.2%	1,217,856	94.8%
		Sell offers	97,347	589,330	96,944	16.4%	492,386	83.6%
Nov-24	Obligations	Buy bids	891,303	4,371,808	915,892	20.9%	3,455,916	79.1%
		Sell offers	890,882	3,771,468	502,529	13.3%	3,268,939	86.7%
	Options	Buy bids	61,329	1,255,768	68,211	5.4%	1,187,557	94.6%
		Sell offers	85,879	522,108	83,596	16.0%	438,512	84.0%
Dec-24	Obligations	Buy bids	775,044	3,851,913	786,531	20.4%	3,065,381	79.6%
		Sell offers	755,204	3,236,457	340,614	10.5%	2,895,843	89.5%
	Options	Buy bids	47,755	1,049,116	49,924	4.8%	999,192	95.2%
		Sell offers	70,976	474,140	78,154	16.5%	395,986	83.5%
2023/2024*	Obligations	Buy bids	9,213,400	56,541,361	9,043,238	16.0%	47,498,123	84.0%
		Sell offers	7,784,244	30,557,705	4,723,139	15.5%	25,834,565	84.5%
	Options	Buy bids	713,936	10,376,686	667,040	6.4%	9,709,645	93.6%
		Sell offers	1,960,198	5,798,307	1,171,058	20.2%	4,627,249	79.8%
2024/2025**	Obligations	Buy bids	7,655,821	37,813,622	7,497,280	19.8%	30,316,342	80.2%
		Sell offers	8,226,749	32,235,529	4,530,061	14.1%	27,705,467	85.9%
	Options	Buy bids	604,762	10,348,072	605,096	5.8%	9,742,976	94.2%
		Sell offers	731,029	3,997,290	706,952	17.7%	3,290,338	82.3%

\*Shows 12 months for 2023/2024 \*\*Shows 7 months for 2024/2025

Figure 13-6 shows the bid volume from each monthly auction for each period of the Monthly Balance of Planning Period FTR Auctions of the first seven months of the 2024/2025 planning period. The prompt month is the final month for which FTRs for a specific month are sold. For example, June is the prompt month for June FTRs sold in the June auction, which occurs in May. The bid volume for the non-prompt months is significantly lower than for the prompt months. On average, the non-prompt month bid volume is 44.4 percent of the prompt month bid volume.

**Figure 13-6 Monthly Balance of Planning Period FTR Auction bid volume (MW per period): June 2024 through December 2024 Auction**

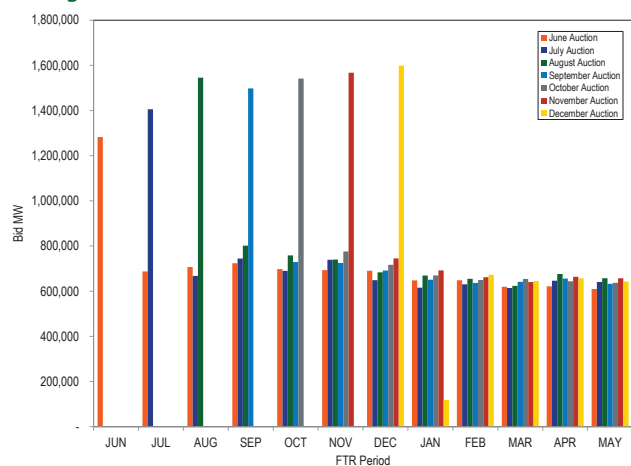


Figure 13-7 shows the cleared volume from each monthly auction for each period of the Monthly Balance of Planning Period FTR Auctions of the first seven months of the 2024/2025 planning period. The cleared volume for non-prompt months is also significantly lower than in prompt months. On average, the non-prompt months cleared volume is 30.5 percent of the prompt month cleared volume.

**Figure 13-7 Monthly Balance of Planning Period FTR Auction cleared volume (MW per period): June 2024 through December 2024 Auction**

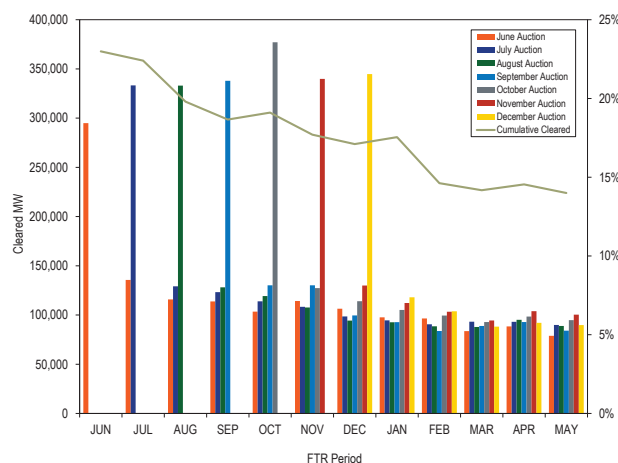


Figure 13-8 shows the FTR bid, net bid and cleared volume from June 2003 through December 2024 for Long Term, Annual and Monthly Balance of Planning Period Auctions. Cleared volume includes FTR buy and sell

offers that were accepted. The net bid volume includes the total buy, sell and self scheduled offers, counting sell offers as a negative volume. The bid volume is the total of all bid and self scheduled offers, excluding sell offers. Following the implementation of the Historical Simulation Initial Margining (HSIM) analysis model in the September 2022 Monthly Auction, bid and net bid volumes have increased significantly. On average in the first seven months of the 2024/2025 planning period there was a 3.4 percent decrease in bid volume and a 37.9 percent decrease in net bid volume compared to the same month in the previous year.

**Figure 13-8 Long Term, Annual and Monthly FTR Auction bid and cleared volume: June 2003 through December 2024**


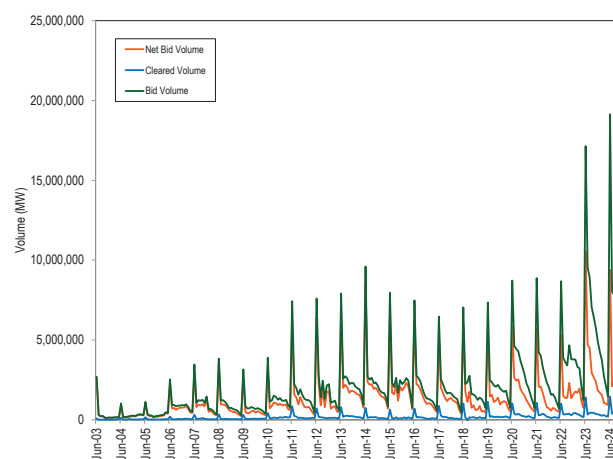


Figure 13-9 shows cleared auction volumes by auction type as a percent of the total FTR cleared volume by calendar months for June 2004 through December 2024. FTR volumes are included in the calendar month they are effective, with long term and annual FTR auction volumes spread equally to each month in the relevant planning period. Over the course of each planning period an increasing number of Monthly Balance of Planning Period FTRs are purchased, resulting in a greater share of total FTRs. When the Annual FTR Auction occurs, FTRs purchased in previous Monthly Balance of Planning Period Auctions, other than the current June auction, are no longer effective, resulting in a smaller share for monthly and a greater share for annual FTRs.

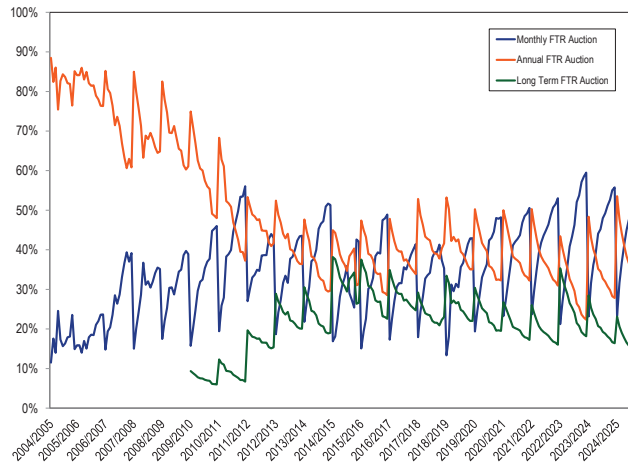**Figure 13-9 Cleared auction volume (MW) as a percent of total FTR cleared volume by calendar month: June 2004 through December 2024**



## Bilateral Market

Table 13-25 provides the PJM registered secondary bilateral FTR market volume for the entire 2023/2024 and the first seven months of the 2024/2025 planning periods. Bilateral FTR transactions registered through PJM do not need to include an accurate price or the entire volume of the transaction. Bilateral FTR transactions are not required to be registered through PJM. As a result, the bilateral data are not a reliable basis for evaluating actual bilateral activity in PJM FTRs.

In the first seven months of the 2024/2025 planning period, there were eight total pairs of bilaterally trading participants, two pairs of unaffiliated participants and 115 total bilateral FTR transactions. For the 2023/2024 planning period there were six pairs of bilaterally trading participants, two pairs of unaffiliated participants and 205 total bilateral FTR transactions.

**Table 13-25 Secondary bilateral FTR market volume: 2023/2024 and 2024/2025 planning period<sup>36</sup>**

Planning Period	Type	Class Type	Volume (MW)
2023/2024	Obligation	24-Hour	10,052.2
		On Peak	1,180.8
		Daily Off Peak	467.1
		Weekend On Peak	10.0
		Total	11,710.1
	Option	24-Hour	0.0
		On Peak	0.0
		Daily Off Peak	0.0
		Weekend On Peak	0.0
		Total	0.0
2024/2025*	Obligation	24-Hour	1,172.4
		On Peak	479.4
		Daily Off Peak	126.9
		Weekend On Peak	146.8
		Total	1,925.5
	Option	24-Hour	0.0
		On Peak	0.0
		Daily Off Peak	0.0
		Weekend On Peak	0.0
		Total	0.0

\*First seven months of 2024/2025

## Price

Table 13-26 shows the cleared, weighted average prices by trade type, FTR direction, period type and class type for the 2024/2027 Long Term FTR Auction. Only FTR obligation products (no options) are available in the Long Term FTR Auctions. In this auction, weighted average buy bid counter flow and prevailing flow FTR prices were  $-\$0.55$  and  $\$0.64$ , compared to  $-\$0.77$  and  $\$0.90$  from the 2023/2026 Long Term FTR Auction. Weighted average sell bid counter flow and prevailing flow FTR prices were  $-\$0.66$  and  $\$0.64$ , compared to  $-\$0.83$  for counter flow FTRs and  $\$0.83$  for prevailing flow FTRs for the 2023/2025 Long Term FTR Auction.

<sup>36</sup> The 2021/2022 planning period covers bilateral FTRs that are effective for any time between June 1, 2021 through May 31, 2022, which originally had been purchased in a Long Term FTR Auction, Annual FTR Auction or Monthly Balance of Planning Period FTR Auction.



**Table 13-26 Long Term FTR Auction weighted average cleared prices (Dollars per MW): 2024/2027 auction**

Trade Type	FTR Direction	Period Type	Class Type				All
			24-Hour	On Peak	Weekend On Peak	Daily Off Peak	
Buy bids	Counter Flow	Year 1	(\$1.64)	(\$0.71)	(\$0.50)	(\$0.33)	(\$0.69)
		Year 2	(\$2.11)	(\$0.69)	(\$0.49)	(\$0.39)	(\$0.72)
		Year 3	(\$1.04)	(\$0.34)	(\$0.24)	(\$0.18)	(\$0.33)
		Total	(\$1.55)	(\$0.54)	(\$0.39)	(\$0.27)	(\$0.55)
		Prevailing Flow					
	Prevailing Flow	Year 1	\$2.03	\$0.76	\$0.62	\$0.38	\$0.76
		Year 2	\$2.28	\$0.83	\$0.62	\$0.48	\$0.87
		Year 3	\$1.27	\$0.35	\$0.25	\$0.24	\$0.41
		Total	\$1.76	\$0.61	\$0.47	\$0.34	\$0.64
		Total	\$0.18	\$0.08	\$0.06	\$0.03	\$0.07
Sell offers	Counter Flow	Year 1	(\$1.81)	(\$0.76)	(\$0.69)	(\$0.42)	(\$0.68)
		Year 2	(\$2.63)	(\$0.81)	(\$0.57)	(\$0.44)	(\$0.73)
		Year 3	(\$3.52)	(\$0.37)	(\$0.22)	(\$0.21)	(\$0.40)
		Total	(\$2.30)	(\$0.72)	(\$0.61)	(\$0.40)	(\$0.66)
		Prevailing Flow					
	Prevailing Flow	Year 1	\$0.82	\$0.78	\$0.69	\$0.44	\$0.67
		Year 2	\$0.86	\$0.89	\$0.69	\$0.48	\$0.74
		Year 3	\$0.16	\$0.29	\$0.24	\$0.17	\$0.25
		Total	\$0.77	\$0.75	\$0.64	\$0.42	\$0.64
		Total	(\$0.29)	\$0.25	\$0.21	\$0.13	\$0.19

Table 13-27 shows the weighted average cleared buy bid prices by trade type, FTR product, FTR direction and class type for the Annual FTR Auction for the 2024/2025 planning period. The weighted average cleared buy bid price in the 2024/2025 Annual FTR Auction was \$1.87 per MW, down from \$3.03 per MW in the 2023/2024 Annual FTR Auction.

**Table 13-27 Annual FTR Auction weighted average cleared prices (Dollars per MW): 2024/2025 planning period**

Trade Type	Type	FTR Direction	Class Type				All
			24-Hour	On Peak	Weekend On Peak	Daily Off Peak	
Buy bids	Obligations	Counter Flow	(\$0.82)	(\$0.46)	(\$0.35)	(\$0.22)	(\$0.39)
		Prevailing Flow	\$2.30	\$0.80	\$0.66	\$0.40	\$0.78
		Total	\$1.06	\$0.30	\$0.24	\$0.13	\$0.30
	Options	Counter Flow	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
		Prevailing Flow	\$0.31	\$0.38	\$0.29	\$0.21	\$0.30
		Total	\$0.31	\$0.38	\$0.29	\$0.21	\$0.30
Self-scheduled bids	Obligations	Counter Flow	(\$0.10)	\$0.00	\$0.00	\$0.00	(\$0.10)
		Prevailing Flow	\$2.23	\$1.36	\$0.75	\$0.52	\$2.18
		Total	\$2.22	\$1.36	\$0.75	\$0.52	\$2.17
Buy and self-scheduled bids	Obligations	Counter Flow	(\$1.12)	(\$0.42)	(\$0.35)	(\$0.21)	(\$0.39)
		Prevailing Flow	\$2.70	\$0.96	\$0.72	\$0.46	\$1.20
		Total	\$2.13	\$0.39	\$0.27	\$0.15	\$0.59
	Options	Counter Flow	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
		Prevailing Flow	\$0.45	\$0.61	\$0.55	\$0.35	\$0.49
		Total	\$0.45	\$0.61	\$0.55	\$0.35	\$0.49
	Obligations	Counter Flow	(\$1.73)	(\$0.83)	(\$0.59)	(\$0.40)	(\$0.84)
		Prevailing Flow	\$0.75	\$0.68	\$0.47	\$0.33	\$0.54
		Total	(\$1.05)	\$0.12	\$0.06	\$0.02	(\$0.04)
	Options	Counter Flow	\$0.00	\$0.00	\$0.00	\$0.00	\$0.00
		Prevailing Flow	\$0.45	\$0.47	\$0.39	\$0.23	\$0.37
		Total	\$0.45	\$0.47	\$0.39	\$0.23	\$0.37

Table 13-28 shows the cleared buy bid volume, cleared buy bid revenue and cleared revenue/cleared MW for the last twelve planning periods. In the 2014/2015 planning period the \$/MW increased significantly from the 2013/2014 planning period due to PJM's decisions to limit capacity through conservative modeling. In the 2017/2018 Annual FTR Auction, the \$/MW decreased to lower than 2013/2014 levels, due in part to the partial relaxation of PJM's conservative modeling practices due to the reassignment of balancing congestion and M2M payments to load and exports. This reduction continued into the 2019/2020 planning period. Due to the more restrictive modeling for the 2022/2023 planning period (relative to the 2021/2022 planning period), quantities and revenue were similar

to 2016/2017 levels, when PJM was restricting the FTR market to account for balancing congestion. The reassignment of balancing congestion and M2M payments to load did not increase the per MW value of ARR.


The 2023/2024 Annual FTR Auction was the first Annual FTR Auction to use the HSIM model. Following the high revenue from the 2022/2023 planning period, and the implementation of the HSIM model, the 2023/2024 Annual FTR Auction cleared buy bid volume increased by 75.9 percent. For the 2023/2024 Annual FTR Auction, the cleared buy bid volume increased 75.9 percent, total buy bid revenue decreased 12.6 percent, and buy bid revenue per MW decreased 50.1 percent. For the 2024/2025 Annual FTR Auction, cleared buy bid volume increased 17.4 percent, total buy bid revenue decreased 1.7 percent, and buy bid revenue per MW decreased 16.3 percent.

**Table 13-28 Cleared volume, revenue and \$/MW: 2012/2013 through 2024/2025 Annual FTR Auction**

	Buy Bid Volume	Cleared Buy Bid Volume	Percent Cleared	Buy Bid Revenue (millions)	Buy Bid Revenue (\$/MW)
2012/2013	2,520,119	329,578	13.1%	\$389.1	\$1,181
2013/2014	3,245,033	391,148	12.1%	\$382.5	\$978
2014/2015	3,243,346	338,879	10.4%	\$506.3	\$1,494
2015/2016	2,437,964	354,630	14.5%	\$620.5	\$1,750
2016/2017	2,565,494	393,509	15.3%	\$615.8	\$1,565
2017/2018	2,281,534	488,734	21.4%	\$406.5	\$832
2018/2019	2,880,105	587,628	20.4%	\$635.7	\$1,082
2019/2020	2,787,716	611,878	21.9%	\$649.0	\$1,061
2020/2021	2,336,551	556,034	23.8%	\$449.6	\$809
2021/2022	2,043,408	535,277	26.2%	\$519.0	\$970
2022/2023	1,984,377	483,988	24.4%	\$1,096.3	\$2,265
2023/2024	3,746,935	851,248	22.7%	\$957.9	\$1,125
2024/2025	4,741,013	999,108	21.1%	\$941.4	\$942

Figure 13-10 shows the weighted average cleared buy bid price of obligations in the Monthly Balance of Planning Period FTR Auctions by bidding period for the first seven months of the 2024/2025 planning period and the average price per MWh for each of the FTR periods. The average price per MWh across all bidding periods for the first seven months of the 2024/2025 planning period was \$0.44.

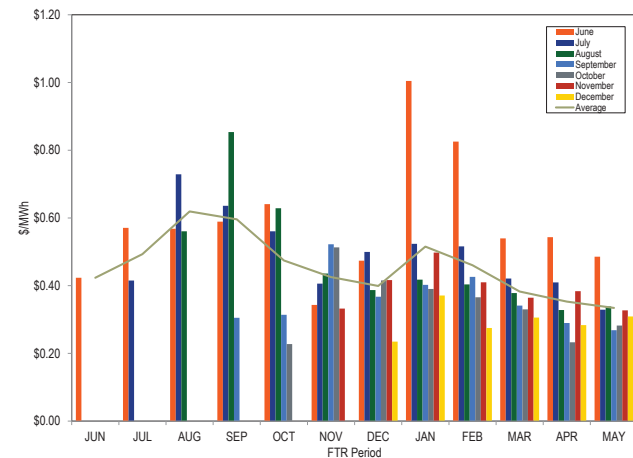**Figure 13-10 Monthly Balance of Planning Period FTR Auction cleared weighted-average buy bid price per period (Dollars per MWh): 2024/2025 planning period**



## Profitability

FTR profitability is the difference between the revenue received directly from holding an FTR plus any revenue from the sale of an FTR, and the cost of the FTR. FTR profitability is relevant only to participants purchasing FTRs and is not relevant to self scheduled FTRs. For a prevailing flow FTR, the FTR revenue is the actual revenue that an FTR holder is paid as the target allocation plus the auction price from the sale of the FTR, if relevant, and the FTR cost is the auction price. For a counter flow FTR, the FTR revenue is the auction price that an FTR holder is paid to take the FTR plus the positive auction price from the sale of the FTR, if relevant, and the FTR cost is the target allocation that the FTR holder must pay plus the negative auction price from the sale of the FTR, if relevant. Profits include the payment of surplus to FTRs. Bilateral transactions are excluded from the profit calculations. Bilateral profits and losses net to zero in market total profits and losses. ARR holders that self schedule FTRs receive congestion revenues but do not receive profits from those FTRs because ARR holders are assigned the rights to congestion revenues which they choose to take directly as the congestion payments associated with the corresponding FTRs.

Profits in the first seven months of the 2024/2025 planning period include the auction cost and revenue from both buying and selling FTRs that were effective from June 2024 through December 2024. This includes FTRs from the 2022/2025, 2023/2026 and 2024/2027 Long Term auctions, the 2024/2025 Annual auction,

and the Monthly auctions from June 2024 through December 2024. The costs and revenues of the yearly FTR products are prorated based on the period of the FTRs. Any revenues or costs related to bilateral transactions are not included in profits.

Hourly FTR profits are the sum of the hourly revenues minus the hourly costs for each FTR. The hourly revenues equal any positive hourly FTR target allocations, adjusted by the payout ratio plus any hourly auction revenues from the sale and/or the purchase of the FTR. The hourly auction costs equal any negative hourly FTR target allocations plus any hourly auction costs from the purchase and/or the sale of the FTR. The hourly auction costs and auction revenues are the product of the FTR MW and the auction price divided by the period of the FTR in hours. The FTR revenues do not include after the fact adjustments which are very small and do not occur in every month.

The surplus includes surplus day-ahead congestion revenue and FTR auction surplus. The surplus is first allocated to FTR holders to cover any shortfall in paying FTR target allocations for the current month or prior months in the planning period. A negative surplus (shortfall) at the end of the planning period is a deficiency that is charged as FTR uplift to FTR holders. The end of planning period surplus or uplift was distributed to FTR holders prorata based on FTR positive target allocations through the 2017/2018 planning period. Beginning with the 2018/2019 planning period, any surplus is given to FTR holders only up to FTR target allocations within the planning period, and, after any surplus assigned to FTRs, the net surplus at the end of the planning period is distributed to ARR holders. Profits include any surplus distribution or uplift payments that was used to satisfy any shortfall in FTR target allocations.

The fact that FTR profits in each planning period have been positive for financial entities as a group, regardless of the payout ratio, raises questions about the competitiveness of the market.

FTR profits for financial entities were not positive in the 2019/2020 planning period when accounting for GreenHat losses but were positive otherwise. FTR profits for financial entities without GreenHat losses were positive in every

planning period from 2012/2013 through 2024/2025 except the 2016/2017 planning period, and were positive if summed over the entire period. Financial entities have been much more profitable than physical and physical ARR entities combined except for the 2015/2016 and the 2016/2017 planning periods (Table 13-31). It is not clear, in a competitive market, why FTRs remain persistently profitable for financial entities and much more profitable for financial entities than for other participants. In a competitive market, it is expected that profits would be competed to zero.

Table 13-29 lists FTR profits, and the congestion returned through self scheduled FTRs, by organization type and FTR direction in the first seven months of the 2024/2025 planning period. All participants who were assigned ARRs are classified as physical. Some participants that are not eligible for ARRs are classified as physical because they are physical participants, for example companies that own only generation.

In the first seven months of the 2024/2025 planning period, physical entities, including physical ARR participants, received \$134.6 million in profits on FTRs purchased directly (not self scheduled), up from \$54.3 million profits in the same time period in the 2023/2024 planning period. Financial participants received \$383.5 million in profits, up from \$113.4 million in profits in the same time period in the 2023/2024 planning period. Self scheduled FTRs have zero cost. ARR holders who self scheduled FTRs received \$283.7 million in congestion revenues, up from \$202.0 million in revenue in the same time period in the 2023/2024 planning period. Revenues from self scheduled FTRs are a return of congestion to the load that paid the congestion and are not profits. Since the revenue from self scheduled FTRs is not profit it is excluded from the other tables in the profitability section.

**Table 13-29 FTR profits and revenues by organization type and FTR direction: June through December, 2024/2025**

Organization Type	Purchased FTRs Profit			Self Scheduled FTRs Revenue Returned		
	Prevailing Flow	Counter Flow	Total	Prevailing Flow	Counter Flow	Total
Financial	\$307,540,695	\$75,991,581	\$383,532,276			
Physical	\$117,959,616	\$25,580,749	\$143,540,365			
Physical ARR	(\$6,813,530)	(\$2,108,971)	(\$8,922,502)	\$284,067,560	(\$338,016)	\$283,729,544
Total	\$418,686,780	\$99,463,358	\$518,150,139	\$284,067,560	(\$338,016)	\$283,729,544

Table 13-30 lists the monthly FTR profits for the 2023/2024 planning period and the first seven months of the 2024/2025 planning period by organization type. In the first seven months of the 2024/2025 planning period, profits for all participants were \$518.2 million, up from \$167.8 million in profits in the same time period in the 2023/2024 planning period and the second highest level of profits since the 2013/2014 planning period. The increase in profits is due to the large increase in target allocation credit which was a result of increased congestion. July had the largest monthly profit in the first seven months of the 2024/2025 planning period, \$175.1 million, followed by December with a profit of \$121.1 million. November was the only month when the FTR market as a whole recorded losses, a loss of \$10.2 million. The largest month to month increase in profits in the first seven months of the 2024/2025 planning period was in July, an increase of \$138.3 million, followed by December, an increase of \$115.8 million. Among organization types, financial organizations' profits were the largest, \$383.5 million, or 74.0 percent of the market total profits. Financial organizations also had the largest increase in profits, \$270.1 million. Only physical ARR organizations had losses, a loss of \$8.9 million, and showed a decrease in profits, a decrease by \$39.8 million, in the seven months of the 2024/2025 planning period.

**Table 13-30 Monthly FTR profits by organization type: 2023/2024 and 2024/2025 planning period**

Month	Organization Type			
	Financial	Physical	Physical ARR	Total
Jun-23	(\$13,556,206)	(\$1,095,051)	\$299,482	(\$14,351,774)
Jul-23	\$28,204,991	\$7,822,448	\$740,057	\$36,767,496
Aug-23	\$5,286,286	\$7,908,660	\$7,229,737	\$20,424,682
Sep-23	\$19,744,118	\$9,320,697	\$7,858,083	\$36,922,898
Oct-23	\$28,385,826	\$5,084,165	\$21,213,527	\$54,683,518
Nov-23	\$38,826,695	(\$6,652,977)	(\$4,105,247)	\$28,068,472
Dec-23	\$6,530,524	\$1,107,566	(\$2,394,060)	\$5,244,031
Jan-24	\$46,940,380	\$12,498,167	(\$7,396,166)	\$52,042,381
Feb-24	(\$16,460,492)	(\$6,096,965)	(\$8,516,698)	(\$31,074,155)
Mar-24	\$14,716,482	(\$3,901,918)	(\$6,100,904)	\$4,713,660
Apr-24	\$9,781,984	(\$7,676,316)	(\$3,122,813)	(\$1,017,146)
May-24	\$44,222,684	\$1,418,114	\$4,746,456	\$50,387,254
Summary for Planning Period 2023/2024				
Total	\$212,623,270	\$19,736,591	\$10,451,455	\$242,811,317
Jun-24	\$46,073,926	\$1,653,593	(\$5,794,114)	\$41,933,406
Jul-24	\$109,996,510	\$57,768,423	\$7,293,254	\$175,058,186
Aug-24	\$74,898,948	\$30,277,757	(\$2,423,454)	\$102,753,250
Sep-24	\$35,149,424	\$10,114,435	(\$2,852,125)	\$42,411,734
Oct-24	\$30,936,571	\$8,996,864	\$5,191,031	\$45,124,467
Nov-24	\$10,562,703	(\$8,929,870)	(\$11,817,684)	(\$10,184,850)
Dec-24	\$75,914,192	\$43,659,163	\$1,480,590	\$121,053,945
Summary for Planning Period 2024/2025				
Total	\$383,532,276	\$143,540,365	(\$8,922,502)	\$518,150,139

Table 13-31 lists the historical profits by planning period by organization type beginning in the 2012/2013 planning period for purchased FTRs. (Profits do not include congestion revenue to self scheduled FTRs.) The rules governing the allocation of surplus are described later in this section.

Table 13-31 FTR profits by organization type: 2012/2013 through 2024/2025 planning period

		2012/2013	2013/2014	2014/2015	2015/2016	2016/2017	2017/2018	2018/2019
Financial	Profit	\$201,825,234	\$913,502,323	\$250,551,943	\$68,895,867	(\$12,525,947)	\$239,981,474	\$113,086,231
	Surplus	(\$50,304,408)	(\$145,080,521)	\$19,453,837	\$4,921,078	\$8,810,267	\$90,361,918	
	Total	\$151,520,826	\$768,421,802	\$270,005,781	\$73,816,945	(\$3,715,680)	\$330,343,392	\$113,086,231
Financial without GreenHat	Profit	\$201,825,234	\$913,502,323	\$250,551,785	\$70,094,918	(\$11,821,248)	\$240,111,850	\$223,376,757
	Surplus	(\$50,304,408)	(\$145,080,521)	\$19,453,837	\$4,921,078	\$8,810,267	\$90,361,918	
	Total	\$151,520,826	\$768,421,802	\$270,005,623	\$75,015,995	(\$3,010,981)	\$330,473,768	\$223,376,757
Physical	Profit	\$68,537,800	\$297,456,284	\$82,853,390	\$10,007,327	(\$4,010,669)	\$57,532,872	(\$5,945,233)
	Surplus	(\$41,626,011)	(\$53,642,077)	\$5,395,706	\$1,865,146	\$4,181,855	\$34,296,618	
	Total	\$26,911,789	\$243,814,207	\$88,249,096	\$11,872,473	\$171,186	\$91,829,490	(\$5,945,233)
Physical ARR	Profit	\$26,572,818	\$366,128,947	\$112,609,140	\$82,181,795	(\$2,468,152)	\$66,458,939	(\$6,248,557)
	Surplus	(\$25,873,836)	(\$81,279,067)	\$18,515,990	\$7,110,576	\$12,040,688	\$47,753,635	
	Surplus from Self scheduled FTRs	(\$45,978,766)	(\$81,765,964)	\$15,530,158	\$3,073,711	\$6,469,297	\$42,513,186	
	Total	\$698,982	\$284,849,881	\$131,125,130	\$89,292,371	\$9,572,536	\$114,212,574	(\$6,248,557)
Total		\$179,131,597	\$1,297,085,890	\$489,380,007	\$174,981,788	\$6,028,043	\$536,385,456	\$100,892,442

		2019/2020	2020/2021	2021/2022	2022/2023	2023/2024	2024/2025*
Financial	Profit	(\$21,139,644)	\$280,586,579	\$831,489,515	\$376,720,527	\$212,623,270	\$383,532,276
	Surplus						
	Total	(\$21,139,644)	\$280,586,579	\$831,489,515	\$376,720,527	\$212,623,270	\$383,532,276
Financial without GreenHat	Profit	\$25,150,852	\$280,906,014	\$831,489,515	\$376,720,527	\$212,623,270	\$383,532,276
	Surplus						
	Total	\$25,150,852	\$280,906,014	\$831,489,515	\$376,720,527	\$212,623,270	\$383,532,276
Physical	Profit	(\$42,860,656)	\$60,941,495	\$228,289,196	\$10,155,622	\$19,736,591	\$143,540,365
	Surplus						
	Total	(\$42,860,656)	\$60,941,495	\$228,289,196	\$10,155,622	\$19,736,591	\$143,540,365
Physical ARR	Profit	(\$49,614,191)	\$18,982,052	\$35,163,444	(\$14,794,445)	\$10,451,455	(\$8,922,502)
	Surplus						
	Surplus from Self scheduled FTRs						
	Total	(\$49,614,191)	\$18,982,052	\$35,163,444	(\$14,794,445)	\$10,451,455	(\$8,922,502)
Total		(\$113,614,490)	\$360,510,126	\$1,094,942,155	\$372,081,704	\$242,811,317	\$518,150,139

\* The first seven months of the 2024/2025 planning period.

Table 13-32 shows the profits and losses of the five most and the five least profitable participants by ownership type. Total MWh is the sum of all MWh by ownership type regardless of profitability. The Top 5 Profit is the sum of the profits of the five most profitable participants by ownership type. The Top 5 Profit/MWh is the Top 5 Profit divided by the sum of the MWh of the top 5 participants by ownership type. The Top 5 Market Share of MWh is the sum of the MWh of the top 5 participants by ownership type divided by Total MWh of that ownership type. The Top 5 Profit Share Among Profitable Participants is the Top 5 Profit divided by the sum of the profits of all profitable participants by ownership type. The same logic applies for the statistics related to the Bottom 5 participants. The All row considers all ownership types when selecting the Top 5 and Bottom 5 participants.

The Top 5 financial participants' profit per MWh was the smallest while the sum of all their profits was the largest of all the ownership types. The Top 5 financial participants' profit share among profitable participants was the lowest, 38.5 percent, while the Top 5 physical ARR participants' profit share was the highest, 75.8 percent. In the first seven months of the 2024/2025 planning period, 94.3 percent of the financial participants were profitable while only 43.2 percent of the physical ARR participants were profitable (Table 13-33). In addition, there are only a small number of physical ARR participants who directly purchase FTRs. The Bottom 5 financial participants' loss per MWh and sum of losses were the smallest while the Bottom 5 physical ARR participants had the largest loss per MWh and the largest sum of losses. There was one physical ARR participant who made much larger losses than any other bottom 5 participants, losing more than \$20.5 million, which is 68.2 percent of the bottom 5 physical ARR participants' sum of losses. When all participants across ownership types are considered, four of the Top 5 participants and none of the bottom 5 participants were financial participants. Overall, the five most profitable participants' profits increased and the five least profitable participants' losses decreased in the first seven months of the 2024/2025 planning period compared with the same time period in the 2023/2024 planning period.



There are participants who have had persistent losses for multiple years. It is possible for PJM FTR participants to have complementary positions in other trading platforms such as the Intercontinental Exchange (ICE) or Nodal Exchange.

**Table 13-32 Top 5 and bottom 5 FTR profits by ownership type: June through December, 2024/2025**

Organization Type	Total MWh	Top 5 Profit	Top 5 Profit/MWh	Top 5 Market Share in MWh	Top 5 Profit Share Among Profitable Participants	Bottom 5 Loss	Bottom 5 Loss/MWh	Bottom 5 Market Share in MWh	Bottom 5 Loss Share Among Unprofitable Participants
Financial	2,375,554,547	\$151,514,758	\$0.29	22.0%	38.5%	(\$5,476,760)	(\$0.21)	1.1%	54.0%
Physical	464,184,898	\$88,429,300	\$0.46	41.4%	56.9%	(\$8,061,720)	(\$0.25)	6.9%	67.5%
Physical ARR	173,950,948	\$17,703,080	\$0.37	27.4%	75.8%	(\$30,132,228)	(\$0.34)	51.0%	93.4%
All	3,013,690,392	\$163,607,634	\$0.38	14.2%	28.6%	(\$32,593,178)	(\$0.30)	3.6%	60.0%

Table 13-33 shows the shares of profitable and unprofitable participants by ownership type weighted by FTR MWh in the first seven months of the 2024/2025 planning period. Compared with the same time period in the 2023/2024 planning period, in the first seven months of the 2024/2025 planning period the share of profitable participants increased by 15.8 percentage points from 73.9 percent to 89.7 percent. The share of the profitable participants for the financial organization type was the largest in the first seven months of the 2024/2025 planning period, 94.3 percent, increased from 75.3 percent in the same time period in the 2023/2024 planning period. The share of the profitable participants increased for the physical organization type, from 66.0 percent to 83.7 percent. The share of profitable physical ARR participants was the lowest among the organization type, 43.2 percent, decreased from 69.4 percent.

**Table 13-33 Share of participants MWh by profitability by ownership type: June through December, 2024/2025**

Organization Type	Unprofitable	Profitable
Financial	5.7%	94.3%
Physical	16.3%	83.7%
Physical ARR	56.8%	43.2%
Total	10.3%	89.7%

Table 13-34 shows the profits by source and sink node type in the first seven months of the 2024/2025 planning period. The sink total row is the sum of all profits and losses of FTRs that have the same sink node type. The source total column is the sum of all profits and losses of FTRs that have the same source node type. The profits of generator to generator FTRs were the largest, \$218.3 million, 42.1 percent of the total profits, in the first seven months of the 2024/2025 planning period. In the same time period in the 2023/2024 planning period, profits of generator to generator FTRs were the second largest and the profits of zone to hub FTRs were the largest, \$193.2 million. The losses of zone to zone FTRs were the largest, a loss of \$20.0 million, in the first seven months of the 2024/2025 planning period. The losses of hub to zone FTRs were the largest in the same time period in the 2023/2024 planning period, a loss of \$149.7. Compared with the same time period in the 2023/2024 planning period, the profits of zone to hub FTRs decreased the most, by \$199.6 million and the profits of hub to zone FTRs increased the most, by \$161.4 million.

**Table 13-34 Profits by node type matrix: June through December, 2024/2025**

Source Type	Sink Type						Residual Metered		
	Aggregate	EHVAGG	Generator	Hub	Interface	Load	Aggregate	Zone	Source Total
Aggregate	\$1,720,017	\$159,373	(\$7,353,332)	\$1,191,333	\$1,166,230	\$1,499,452	\$809,643	(\$1,759,746)	(\$2,567,030)
EHVAGG	(\$73,510)	\$3,026,592	(\$64,751)	\$3,729	\$8,032	\$2,643,376	(\$11,325)	(\$51,327)	\$5,480,816
Generator	\$57,686,291	\$1,380,412	\$218,302,218	\$70,226,826	\$20,001,069	\$24,293,096	\$10,805,542	\$54,930,471	\$457,625,924
Hub	\$955,509	\$53,094	\$2,047,264	\$8,844,518	\$7,161,162	\$151,239	\$1,326,547	\$11,679,726	\$32,219,059
Interface	(\$1,098,828)	(\$2,391)	(\$8,140,792)	\$805,887	\$159,452	\$43,067	(\$319,117)	(\$1,967,282)	(\$10,520,003)
Load	\$1,384,305	\$851,389	\$3,446,038	\$47,228	\$200,537	\$34,552,804	\$104,882	(\$74,097)	\$40,513,086
Residual Metered Aggregate	\$837,205	(\$6,369)	\$2,190,196	\$476,337	\$107,355	\$320,159	\$303,079	\$516,738	\$4,744,700
Zone	\$1,108,732	(\$46,944)	(\$530,764)	(\$6,353,998)	\$13,709,027	\$709,332	\$2,077,350	(\$20,019,150)	(\$9,346,415)
Sink Total	\$62,519,721	\$5,415,157	\$209,896,077	\$75,241,861	\$42,512,865	\$64,212,525	\$15,096,600	\$43,255,333	\$518,150,139

Table 13-35 shows the profit per MWh by source and sink node type in the first seven months of the 2024/2025 planning period. The sink total row represents the average profit per MWh of FTRs that have the same sink type. The source total column shows the average profit per MWh of FTRs that have the same source type. Hub to interface FTRs had the highest profit per MWh, \$3.76 per MWh. All of the three highest profit per MWh node type have Interface as a sink type, hub to interface, zone to interface and EHV aggregate to interface. Zone to EHV Aggregate FTRs had the largest loss per MWh, -\$3.40 per MWh. Profit per MWh of generator to generator FTRs was \$0.15 per MWh which is smaller than market average, \$0.17 per MWh.

**Table 13-35 Profit per MWh by node type matrix: June through December, 2024/2025**

Source Type	Sink Type						Residual Metered Aggregate	Zone	Source Total
	Aggregate	EHVAGG	Generator	Hub	Interface	Load			
Aggregate	\$0.05	\$0.49	(\$0.05)	\$0.23	\$0.42	\$0.24	\$0.07	(\$0.11)	(\$0.01)
EHVAGG	(\$0.15)	\$0.64	(\$0.02)	\$0.08	\$1.10	\$0.41	(\$0.11)	(\$0.35)	\$0.36
Generator	\$0.27	\$0.40	\$0.15	\$0.79	\$0.56	\$0.33	\$0.28	\$0.36	\$0.23
Hub	\$0.08	\$0.69	\$0.13	\$0.27	\$3.76	\$0.32	\$0.09	\$0.11	\$0.18
Interface	(\$0.44)	(\$0.96)	(\$0.79)	\$0.85	\$0.33	\$0.37	(\$0.39)	(\$0.76)	(\$0.59)
Load	\$0.27	\$0.26	\$0.06	\$0.04	\$0.43	\$0.13	\$0.12	(\$0.06)	\$0.12
Residual Metered Aggregate	\$0.20	(\$0.23)	\$0.11	\$0.40	\$0.32	\$0.36	\$0.25	\$0.11	\$0.15
Zone	\$0.09	(\$3.40)	(\$0.02)	(\$0.16)	\$1.65	\$0.43	\$0.06	(\$0.33)	(\$0.05)
Sink Total	\$0.22	\$0.46	\$0.12	\$0.44	\$0.85	\$0.18	\$0.15	\$0.13	\$0.17

## Revenue

### Long Term FTR Auction Revenue

Table 13-36 shows the Long Term FTR Auction revenue data by trade type, FTR direction, period type and class type. The 2024/2025 Long Term FTR Auction netted \$102.6 million in revenue, \$81.9 million less (44.4 percent) than the previous Long Term FTR Auction. Buyers paid \$189.7 million and sellers received \$87.1 million, down \$249.2 million (23.9 percent) and up \$22.4 million (34.7 percent) over the previous Long Term FTR Auction.

**Table 13-36 Long Term FTR Auction Revenue: 2024/2027 auction**

				Class Type			
Trade Type	FTR Direction	Period	Weekend On			All	
		Type	24-Hour	On Peak	Peak		Daily Off Peak
Buy bids	Counter Flow	Year 1	(\$101,225,323)	(\$137,381,954)	(\$35,537,829)	(\$42,587,463)	(\$316,732,569)
		Year 2	(\$60,795,012)	(\$80,423,436)	(\$21,010,173)	(\$28,898,225)	(\$191,126,846)
		Year 3	(\$44,057,065)	(\$80,800,646)	(\$21,205,799)	(\$27,981,943)	(\$174,045,452)
		Total	(\$206,077,400)	(\$298,606,036)	(\$77,753,801)	(\$99,467,631)	(\$681,904,867)
	Prevailing Flow	Year 1	\$102,471,721	\$184,807,088	\$51,683,601	\$51,575,767	\$390,538,177
		Year 2	\$72,986,257	\$115,915,577	\$29,876,588	\$34,648,317	\$253,426,738
		Year 3	\$81,276,283	\$90,851,210	\$23,042,800	\$32,482,611	\$227,652,904
		Total	\$256,734,260	\$391,573,874	\$104,602,989	\$118,706,694	\$871,617,818
	Total		\$50,656,860	\$92,967,839	\$26,849,188	\$19,239,064	\$189,712,951
	Sell offers	Counter Flow	Year 1	(\$4,722,113)	(\$39,606,753)	(\$12,407,795)	(\$12,432,826)
Year 2			(\$3,926,143)	(\$14,365,136)	(\$3,881,153)	(\$4,564,102)	(\$26,736,535)
Year 3			(\$2,284,692)	(\$3,738,801)	(\$724,620)	(\$1,243,626)	(\$7,991,739)
Total			(\$10,932,948)	(\$57,710,690)	(\$17,013,568)	(\$18,240,554)	(\$103,897,760)
Prevailing Flow		Year 1	\$4,032,290	\$67,951,926	\$21,940,416	\$20,761,688	\$114,686,320
		Year 2	\$2,786,659	\$41,202,284	\$10,723,261	\$12,402,735	\$67,114,939
		Year 3	\$151,183	\$6,042,308	\$1,408,781	\$1,570,465	\$9,172,736
		Total	\$6,970,131	\$115,196,518	\$34,072,457	\$34,734,888	\$190,973,995
Total			(\$3,962,817)	\$57,485,828	\$17,058,889	\$16,494,335	\$87,076,235
Total			\$54,619,677	\$35,482,011	\$9,790,299	\$2,744,729	\$102,636,716

## Annual FTR Auction Revenue

Table 13-37 shows the Annual FTR Auction revenue by trade type, type, FTR direction and class type. The Annual FTR Auction for the 2024/2025 planning period generated \$1,475.3 million, down 12.9 percent from \$1,694.3 million in the 2023/2024 Annual FTR Auction. Counter flow FTR holders received \$323.4 million, up 35.9 percent from the previous Annual FTR Auction and prevailing flow FTR holders paid \$1,798.6 million, down 6.9 percent from the previous planning period.

**Table 13-37 Annual FTR auction revenue: 2024/2025 planing period**

					Class Type			
Trade Type	Type	FTR Direction	24-Hour	On Peak	Weekend On Peak	Daily Off Peak	All	
Buy bids	Obligations	Counter Flow	(\$67,605,486)	(\$247,997,950)	(\$73,947,571)	(\$75,563,399)	(\$465,114,406)	
		Prevailing Flow	\$286,566,622	\$668,048,001	\$192,733,680	\$178,514,937	\$1,325,863,241	
		Total	\$218,961,136	\$420,050,051	\$118,786,110	\$102,951,538	\$860,748,835	
	Options	Counter Flow	\$0	\$0	\$0	\$0	\$0	
		Prevailing Flow	\$8,911,347	\$41,996,865	\$13,444,247	\$16,294,297	\$80,646,755	
		Total	\$8,911,347	\$41,996,865	\$13,444,247	\$16,294,297	\$80,646,755	
	Total	Counter Flow	(\$67,605,486)	(\$247,997,950)	(\$73,947,571)	(\$75,563,399)	(\$465,114,406)	
		Prevailing Flow	\$295,477,969	\$710,044,866	\$206,177,927	\$194,809,233	\$1,406,509,996	
		Total	\$227,872,483	\$462,046,916	\$132,230,356	\$119,245,834	\$941,395,590	
	Self-scheduled bids	Obligations	Counter Flow	(\$98,311)	\$0	\$0	\$0	(\$98,311)
			Prevailing Flow	\$507,501,137	\$6,594,513	\$1,421,923	\$1,541,382	\$517,058,955
			Total	\$507,402,826	\$6,594,513	\$1,421,923	\$1,541,382	\$516,960,644
Buy and self-scheduled bids	Obligations	Counter Flow	(\$67,703,797)	(\$247,997,950)	(\$73,947,571)	(\$75,563,399)	(\$465,212,717)	
		Prevailing Flow	\$794,067,759	\$674,642,515	\$194,155,603	\$180,056,319	\$1,842,922,195	
		Total	\$726,363,962	\$426,644,564	\$120,208,032	\$104,492,920	\$1,377,709,479	
	Options	Counter Flow	\$0	\$0	\$0	\$0	\$0	
		Prevailing Flow	\$8,911,347	\$41,996,865	\$13,444,247	\$16,294,297	\$80,646,755	
		Total	\$8,911,347	\$41,996,865	\$13,444,247	\$16,294,297	\$80,646,755	
	Total	Counter Flow	(\$67,703,797)	(\$247,997,950)	(\$73,947,571)	(\$75,563,399)	(\$465,212,717)	
		Prevailing Flow	\$802,979,106	\$716,639,379	\$207,599,849	\$196,350,615	\$1,923,568,950	
		Total	\$735,275,309	\$468,641,429	\$133,652,279	\$120,787,216	\$1,458,356,233	
	Sell offers	Obligations	Counter Flow	(\$54,222,433)	(\$53,398,395)	(\$14,379,159)	(\$19,856,633)	(\$141,856,620)
			Prevailing Flow	\$8,849,238	\$74,402,629	\$18,385,245	\$22,563,051	\$124,200,162
			Total	(\$45,373,195)	\$21,004,234	\$4,006,086	\$2,706,418	(\$17,656,458)
Options		Counter Flow	\$0	\$0	\$0	\$0	\$0	
		Prevailing Flow	\$16,445	\$447,414	\$105,318	\$158,383	\$727,560	
		Total	\$16,445	\$447,414	\$105,318	\$158,383	\$727,560	
Total		Counter Flow	(\$54,222,433)	(\$53,398,395)	(\$14,379,159)	(\$19,856,633)	(\$141,856,620)	
		Prevailing Flow	\$8,865,683	\$74,850,043	\$18,490,563	\$22,721,434	\$124,927,723	
		Total	(\$45,356,750)	\$21,451,648	\$4,111,404	\$2,864,801	(\$16,928,897)	
Total			\$780,632,059	\$447,189,781	\$129,540,875	\$117,922,415	\$1,475,285,131	

FTRs sold in Long Term FTR Auctions are sold at a substantial discount to the same FTRs sold in Annual FTR Auctions. Table 13-38 shows the increase in total auction revenue that would have resulted for the 2014/2015 through 2024/2025 planning periods if long term FTRs were sold at annual auction clearing prices.

Long Term FTR Auction transmission capacity is determined by removing all outages and running an offline model of the previous Annual FTR Auction model with all ARR bids from the prior annual ARR allocation. Any ARR MW that clear in this offline model are reserved for ARR holders in the relevant planning periods, and are removed from the Long Term FTR Auction capability. But even this approach does not, and cannot, preserve all the capacity for ARR holders in the first year of the Long Term Auction. The system capacity purchased in the Long Term FTR Auction is made available to FTR holders before ARR holders have access to it. The result is that capacity is reserved, inappropriately and for unexplained reasons, in future auctions for FTR holders. This difference provides an estimate of the value of the transmission capability made available in the Long Term FTR Auction that is not made available to ARR holders. This capability should be made available to ARR holders in the Annual FTR Auctions where it is the most valuable. Under the current market rules, capability made available in the Long Term FTR auction is not available to ARR holders as ARRs. The MMU recommends that the Long Term FTR product be eliminated. If the Long

Term FTR product is not eliminated, the Long Term FTR Market should be modified so that the supply of prevailing flow FTRs in the Long Term FTR Market is based solely on counter flow offers in the Long Term FTR Market, and not projected residual system capability based on a snapshot of prior ARR requests.

**Table 13-38 Estimated additional Long Term FTR Auction revenue at Annual FTR Auction prices**

Long Term FTR Product					Total
Planning Period	YR3	YR2	YR1	YRALL	Difference
2014/2015	\$59,598,642	\$30,284,173	\$52,030,909	\$926,989	\$142,840,713
2015/2016	\$67,896,588	\$40,975,278	\$9,936,078	\$303,082	\$119,111,026
2016/2017	\$42,378,048	\$3,854,373	\$11,055,824	\$1,079,901	\$58,368,147
2017/2018	\$6,134,076	(\$1,841,715)	\$12,396,817	\$227,524	\$16,916,702
2018/2019	\$7,872,604	\$2,926,457	\$13,480,353	(\$111,226)	\$24,168,189
2019/2020	\$9,711,188	\$4,098,887	\$103,227,004	\$805,425	\$117,842,504
2020/2021	(\$416,585)	\$52,736,819	(\$9,690,808)	\$1,242,707	\$43,872,132
2021/2022	\$73,050,796	(\$3,111,721)	\$13,856,264	NA	\$83,795,339
2022/2023	\$42,759,622	\$62,664,762	\$104,025,268	NA	\$209,449,652
2023/2024	\$45,464,085	\$31,335,632	\$39,140,382	NA	\$115,940,099
2024/2025	\$42,500,160	\$23,979,155	\$36,720,756	NA	\$103,200,071
Total	\$396,949,223	\$247,902,102	\$386,178,846	\$4,474,401	\$1,035,504,573

### Monthly Balance of Planning Period FTR Auction Revenue

Table 13-39 shows monthly balance of planning period FTR auction revenue by trade type, type and class type for the 2023/2024 planning period and the first seven months of the 2024/2025 planning period. The Monthly Balance of Planning Period FTR Auctions for the first seven months of the 2024/2025 planning period netted \$69.0 million in revenue, the difference between buyers paying \$516.6 million and sellers receiving \$447.6 million. For the entire 2023/2024 planning period, the Monthly Balance of Planning Period FTR Auctions netted \$85.6 million in revenue with buyers paying \$613.7 million and sellers receiving \$528.2 million. Revenue from obligation buy bids for the first seven months of the 2025/2025 planning period were up 2.0 percent compared to the same period of the 2023/2024 planning period. Revenue from obligation sell offers in the first seven months of the 2024/2025 planning period was up 15.8 percent compared to the same period of the 2023/2024 planning period.

Table 13-39 Monthly Balance of Planning Period FTR Auction revenue: 2023/2024 and 2024/2025 planning period

Monthly Auction	Type	Trade Type	Class Type				
			24-Hour	On Peak	Daily Off Peak	Weekend On Peak	All
Jun-24	Obligations	Buy bids	\$53,275,330	\$54,718,171	\$8,493,638	\$11,371,523	\$127,858,663
		Sell offers	\$7,807,469	\$49,440,818	\$17,076,707	\$12,401,626	\$86,726,620
	Options	Buy bids	\$461,678	\$3,724,319	\$1,739,790	\$1,453,407	\$7,379,195
		Sell offers	\$2,249,987	\$10,937,423	\$3,348,148	\$3,958,745	\$20,494,303
Jul-24	Obligations	Buy bids	\$16,036,836	\$32,477,255	\$6,843,572	\$9,947,926	\$65,305,589
		Sell offers	\$1,881,329	\$26,464,388	\$7,826,420	\$7,809,423	\$43,981,561
	Options	Buy bids	\$846,989	\$3,722,193	\$1,910,667	\$1,478,788	\$7,958,636
		Sell offers	\$1,608,081	\$10,403,697	\$3,132,288	\$4,221,724	\$19,365,790
Aug-24	Obligations	Buy bids	\$13,328,631	\$38,277,002	\$5,776,288	\$10,349,142	\$67,731,063
		Sell offers	\$4,021,298	\$29,831,996	\$5,739,436	\$7,968,314	\$47,561,044
	Options	Buy bids	\$667,568	\$2,579,053	\$1,547,224	\$1,179,027	\$5,972,872
		Sell offers	\$1,621,069	\$10,147,704	\$3,284,540	\$3,661,035	\$18,714,349
Sep-24	Obligations	Buy bids	\$15,750,966	\$24,497,517	\$4,548,667	\$8,496,799	\$53,293,950
		Sell offers	\$2,271,707	\$22,068,003	\$4,330,490	\$7,123,254	\$35,793,454
	Options	Buy bids	\$546,740	\$2,547,227	\$1,360,542	\$1,019,627	\$5,474,135
		Sell offers	\$1,700,037	\$8,132,348	\$2,881,078	\$3,577,378	\$16,290,840
Oct-24	Obligations	Buy bids	\$20,413,368	\$19,550,396	\$4,968,498	\$6,489,590	\$51,421,852
		Sell offers	\$2,007,386	\$20,578,937	\$5,392,692	\$6,307,143	\$34,286,158
	Options	Buy bids	\$1,328,041	\$2,591,330	\$869,189	\$918,808	\$5,707,369
		Sell offers	\$1,713,452	\$7,824,599	\$3,688,718	\$3,532,162	\$16,758,930
Nov-24	Obligations	Buy bids	\$11,032,377	\$20,855,251	\$6,838,559	\$8,201,643	\$46,927,830
		Sell offers	\$2,737,173	\$17,653,513	\$5,200,891	\$5,995,895	\$31,587,473
	Options	Buy bids	\$3,043,983	\$2,053,683	\$686,137	\$832,578	\$6,616,382
		Sell offers	\$1,862,588	\$7,118,432	\$4,109,346	\$3,787,984	\$16,878,349
Dec-24	Obligations	Buy bids	\$6,332,977	\$14,269,691	\$8,184,511	\$6,506,756	\$35,293,935
		Sell offers	\$645,453	\$9,660,272	\$3,916,243	\$3,514,868	\$17,736,836
	Options	Buy bids	\$2,722,786	\$1,975,475	\$698,775	\$705,885	\$6,102,921
		Sell offers	\$2,842,118	\$7,274,716	\$4,829,448	\$3,801,603	\$18,747,886
2023/2024*	Obligations	Buy bids	\$149,522,849	\$256,255,978	\$70,891,477	\$82,022,645	\$558,692,949
		Sell offers	\$24,970,124	\$206,011,406	\$62,886,522	\$62,796,621	\$356,664,672
	Options	Buy bids	\$10,879,213	\$23,713,536	\$11,207,303	\$9,254,655	\$55,054,707
		Sell offers	\$18,717,782	\$80,508,245	\$37,394,943	\$34,877,994	\$171,498,964
	Net Total		\$116,714,157	(\$6,550,137)	(\$18,182,685)	(\$6,397,315)	\$85,584,020
2024/2025**	Obligations	Buy bids	\$53,956,163	\$271,342,455	\$64,178,705	\$67,484,506	\$456,961,829
		Sell offers	\$17,959,612	\$217,513,789	\$54,385,223	\$54,983,449	\$344,842,073
	Options	Buy bids	\$11,809,089	\$25,698,557	\$12,096,702	\$9,997,666	\$59,602,014
		Sell offers	\$11,190,101	\$55,271,883	\$18,266,176	\$18,024,457	\$102,752,616
	Net Total		\$36,615,540	\$24,255,341	\$3,624,008	\$4,474,266	\$68,969,154

\*Shows twelve months for 2023/2024 \*\*Shows seven months for 2024/2025

## FTR Target Allocations

FTR target allocations were examined separately by source and sink contribution. Hourly FTR target allocations were divided into those that were benefits and liabilities and summed by sink and by source. Figure 13-11 shows the 10 largest positive and negative FTR target allocations, summed by sink, for the first seven months of the 2024/2025 planning period. The top 10 sinks that produced financial benefit accounted for 19.5 percent of total positive target allocations with the Western Hub accounting for 7.4 percent of all positive target allocations. The top 10 sinks that created liability accounted for 12.5 percent of total negative target allocations with PPL accounting for 2.2 percent of all negative target allocations.



**Figure 13-11 Ten largest positive and negative FTR target allocations summed by sink: June through December, 2024/2025**


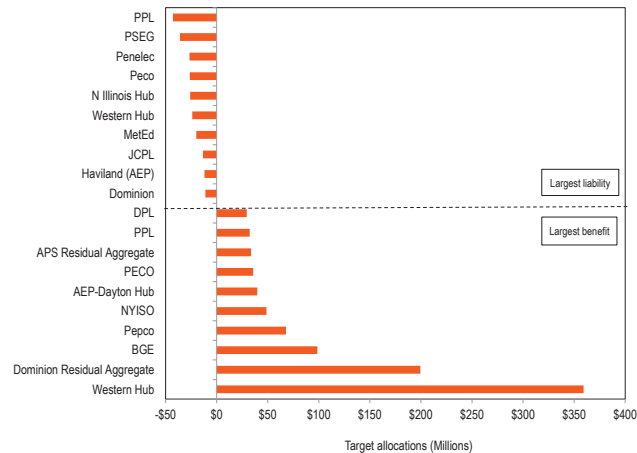


Figure 13-12 shows the 10 largest positive and negative FTR target allocations, summed by source, for the first seven months of the 2024/2025 planning period. The top 10 sources with a positive target allocation accounted for 11.9 percent of total positive target allocations with Western Hub accounting for 2.6 percent of total positive target allocations. The top 10 sources with a negative target allocation accounted for 15.8 percent of all negative target allocations, with the Western Hub accounting for 9.6 percent of total negative target allocations.

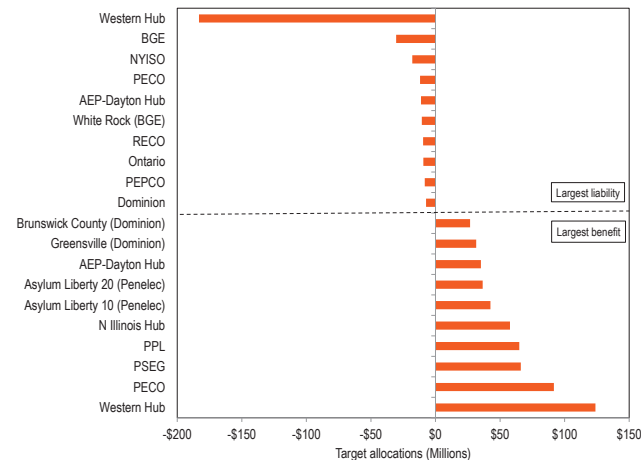**Figure 13-12 Ten largest positive and negative FTR target allocations summed by source: June through December, 2024/2025**



### The Effect of Fast Start Pricing on FTR Target Allocations

PJM implemented fast start pricing on September 1, 2021, and as a result, PJM produces separate dispatch and pricing market solutions. The dispatch run results in dispatch instructions and matching prices, termed dispatch run locational marginal prices, or DLMP. The DLMP prices are the prices that would have been the LMPs prior to fast start pricing. The pricing run results in the final prices used in settlements and for FTR target allocations, termed pricing run locational marginal prices, or PLMP. The two runs result in different sets of target allocations for the same FTR paths. Table 13-40 compares the target allocations that result from the pricing and dispatch runs for both self scheduled and all other FTRs for the 2021/2022 planning period through the first seven months of the 2024/2025

planning period. The difference indicates whether the target allocations were increased or decreased as a result of fast start pricing.

**Table 13-40 Pricing run and dispatch run FTR Target Allocations: 2021/2022 through 2024/2025 planning periods**

Planning Period		Pricing Run	Dispatch Run	Difference	Percent Difference
2021/2022*	Not Self Scheduled	\$1,499,077,738	\$1,497,963,895	\$1,113,844	0.1%
	Self Scheduled	\$429,271,338	\$430,800,598	(\$1,529,260)	(0.4%)
	Total	\$1,928,349,076	\$1,928,764,493	(\$415,416)	(0.0%)
2022/2023	Not Self Scheduled	\$1,641,324,421	\$1,586,284,502	\$55,039,919	3.4%
	Self Scheduled	\$622,535,802	\$668,468,552	(\$45,932,751)	(7.4%)
	Total	\$2,263,860,223	\$2,254,753,054	\$9,107,169	0.4%
2023/2024	Not Self Scheduled	\$1,396,273,015	\$1,435,733,398	(\$39,460,383)	(2.8%)
	Self Scheduled	\$371,433,164	\$371,620,633	(\$187,469)	(0.1%)
	Total	\$1,767,706,179	\$1,807,354,031	(\$39,647,853)	(2.2%)
2024/2025**	Not Self Scheduled	\$1,185,357,095	\$1,192,194,237	(\$6,837,142)	(0.6%)
	Self Scheduled	\$283,724,016	\$284,314,746	(\$590,730)	(0.2%)
	Total	\$1,469,081,111	\$1,476,508,983	(\$7,427,873)	(0.5%)

\* starting in September 2021

\*\* first seven months of the 2024/2025 planning period

## Surplus Congestion Revenue

Surplus congestion revenue is a misnomer. In fact, there is no such thing as surplus congestion revenue. The rights to all congestion revenue belong to load. Surplus congestion revenue, as defined in PJM rules, is an artifact of the flawed design of the current approach to FTR/ARRs. In the current design, surplus congestion revenue should be allocated to ARR holders because such revenue is part of total congestion revenues.

Based on market logic, there is no such thing as surplus FTR auction revenue. FTR Auction revenue results from the market prices paid by willing FTR buyers, should be paid to ARR holders who are the sellers, and should not be returned to FTR buyers for any reason.

Surplus day-ahead congestion is defined as the difference between the day-ahead congestion collected and FTR target allocations. Surplus FTR auction revenue is defined as the difference between the sum of monthly FTR auction revenue from the Long Term, Annual and monthly auctions, and ARR target allocations. Surplus FTR auction revenue can result from high prices in the FTR auctions, and from FTR capacity sold in excess of assigned ARR capacity on specific paths, and FTR capacity sold on paths not available to ARR holders.

Surplus congestion revenue is defined as the sum of the surplus day-ahead congestion revenue and the

surplus FTR auction revenue at the end of each month.<sup>37</sup> Beginning with the 2014/2015 planning period, PJM may use surplus FTR auction revenue to pay for the clearing of counter flow FTRs as part of the auction clearing process.<sup>38</sup> The remaining surplus is first used to ensure that ARR target allocations in the month are fully funded. Any remaining surplus is used to pay any negative difference between day-ahead congestion revenue and FTR target allocations for the current month or prior months in the planning period. Any remaining surplus is used to pay any negative difference

between day-ahead congestion revenue and FTR target allocations for the entire planning period at the end of the planning period. Any remaining surplus after that is distributed to ARR holders.<sup>39</sup>

If, at the end of the planning period, all the surplus congestion revenue has been provided to FTR holders and target allocations for the year are not covered, an uplift charge is assigned to FTR holders to cover the net planning period deficiency. An individual participant's uplift charge allocation is the ratio of their share of net positive target allocations to the total net positive target allocations.

Figure 13-13 shows the monthly composition of total surplus, by surplus FTR auction revenue and surplus congestion revenue from June 2017 through December 2024 as if FTRs were settled monthly, based on the congestion and FTR auction revenue in each individual month. In only two of the first seven months of the 2024/2025 planning period (July 2024 and August 2024) the day ahead congestion in that month alone was enough to pay FTR target allocations for the month. Figure 13-13 shows the extent to which FTRs are funded by the auction surplus. As part of the illogic of the FTR/ARR construct and as an illustration that it is unlike

<sup>37</sup> Prior to the 2017/2018 planning period, the surplus congestion revenue was not the simple sum of the surplus FTR auction revenue and surplus day-ahead congestion because there were various cross market charges subtracted from FTR revenue, including M2M and competing use charges, which reduced available surplus congestion revenue.

<sup>38</sup> See "PJM Manual 6: Financial Transmission Rights," Rev. 33 (Sep. 24, 2024).

<sup>39</sup> On May 31, 2018, a rule change was implemented. Effective for the 2018/2019 planning period, surplus day-ahead congestion charges and surplus FTR auction revenue that remain at the end of the Planning Period allocated to ARR holders, rather than to FTR holders. 163 FERC ¶ 61,165 (2018).

any actual market, FTR buyers pay ARR holders for the rights to congestion but FTR buyers may reclaim part of their payment if actual congestion is less than they expected and not enough to cover target allocations.

The market rules should recognize that ARR holders have the right to all surplus revenue, not just the remainder after guaranteeing that FTRs are paid target allocations. The surplus revenue results from the prices that FTR buyers willingly paid for the rights to price differences across specific paths. The MMU recommends that all FTR auction revenue be distributed to ARR holders monthly, regardless of FTR funding levels. The MMU recommends that, under the current FTR design, all congestion revenue in excess of FTR target allocations be distributed to ARR holders on a monthly basis. Under the MMU recommendation, the amount represented by each bar in Figure 13-14 would be assigned to ARR holders in every month.

**Figure 13-13 Monthly surplus auction revenue and surplus congestion revenue: June 2017 through December 2024<sup>40</sup>**

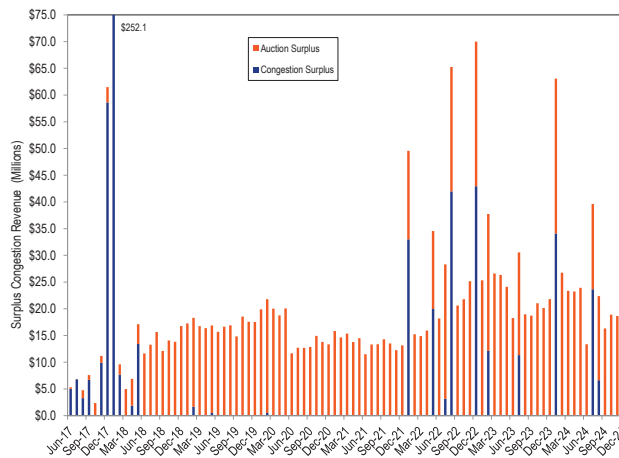


Figure 13-14 shows the increase or decrease in total accrued surplus for the planning period for each month (orange line). In Figure 13-14, if the FTR payments from the auction surplus are positive in a month (blue line above zero), that means that FTR payments in that month were dependent on FTR auction surplus from that month to cover the FTR target allocations in that month. If the change in the total accrued surplus for a month is positive, that means that there was surplus revenue (equal to the height of the orange bar) left over after paying FTR target allocations in that month

<sup>40</sup> The bar for January 2018 is truncated.

from congestion or from auction revenue. This net surplus is carried until the end of the planning period and used to backfill FTR target allocations as needed before distributing to ARR holders. If the change in total accrued surplus for a month is negative, that means that there were insufficient revenues, including the auction surplus, to pay FTR target allocations in that month. If the net surplus is negative at the end of the planning period, total revenue paid to FTRs will be lower than total FTR target allocations. Under the current rules, FTRs are made whole using surplus revenue from other months within the same planning period or by an uplift charge to all FTR holders at the end of the planning period.

In the 2023/2024 planning period there were four months (September through December) that did not have enough revenue from congestion plus auction surplus to pay FTR target allocations, resulting in a reduction to the planning period surplus of \$162.9 million. Under current rules, any month with a shortfall will be paid from months with a surplus of congestion plus auction revenue and/or with any surplus congestion and auction revenues left at the end of the planning period. The final settlements are not known until the end of the planning period.

In the first seven months of the 2024/2025 planning period, \$77.1 million of surplus revenue was transferred to FTR holders that would have been paid to ARR holders under the MMU's recommendation. Day-ahead congestion increased by \$439.1 million, 48.1 percent, from \$913.0 million in the first seven months of the 2023/2024 planning period to \$1,352.1 million in the first seven months of the 2024/2025 planning period. Target allocations increased by \$445.0 million, 43.5 percent, from \$1,023.5 million in the first seven months of the 2023/2024 planning period to \$1,468.5 million in the first seven months of the 2024/2025 planning period. The actual day-ahead congestion (\$1,352.1 million) was less than the target allocations (\$1,468.5 million) in the first seven months of the 2024/2025 planning period. This disconnect between target allocations and congestion is a result of the fact that target allocations are not congestion and that property rights to congestion in the current ARR/FTR market design are not correctly defined, and further illustrates the illogic of the current design.

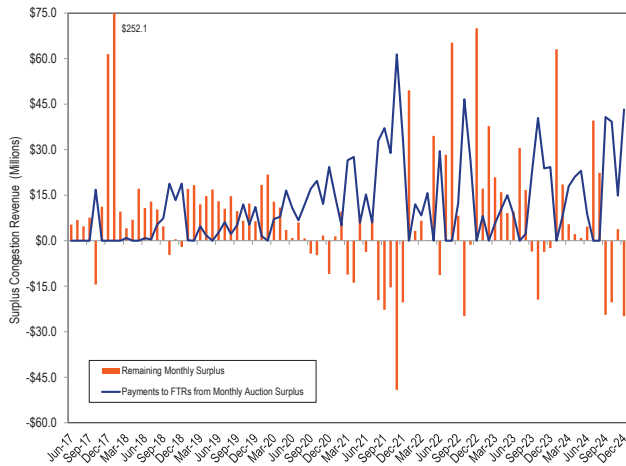
**Figure 13-14 Monthly ARR surplus: June 2017 through December 2024<sup>41</sup>**

Figure 13-15 shows the surplus FTR auction revenue from the 2011/2012 planning period through the first seven months of the 2024/2025 planning period. Each new planning period introduces a new FTR model, including outages and PJM's discretionary adjustments for revenue adequacy. The differences in the assumptions in the market model can result in large differences in FTR auction surplus and ARR revenue from one planning period to another. Payments to FTRs have relied on payments from the surplus rather than from day-ahead congestion. The persistent mismatch between target allocations and day-ahead congestion and the use of the surplus are another illustration of the internal illogic and incoherence of the PJM FTR/ARR design.

FTR auction revenue is the value that FTR buyers assign to congestion rights that belong to ARR holders. There is no logical or market based reason to assign any part of that auction revenue back to the FTR buyers. It is inconsistent with the operation of a market that sellers are required to return some of the purchase price to buyers if the purchase is less profitable for buyers than expected. Auction revenue from the sale of FTRs should be distributed directly and completely to ARR holders.

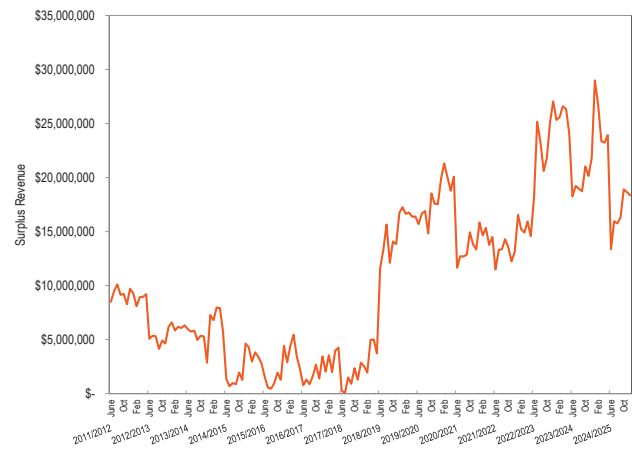
**Figure 13-15 Monthly FTR auction surplus: 2011/2012 through 2024/2025 planning period**

Table 13-41 shows the surplus FTR auction revenue, surplus day-ahead congestion revenue and surplus congestion revenue for planning periods 2010/2011 through the first seven months of the 2024/2025 planning period.

**Table 13-41 Surplus FTR Auction Revenue: 2010/2011 through 2024/2025 planning period<sup>42</sup>**

Planning Period	Surplus FTR Auction Revenue (Millions)	Surplus Day-Ahead Congestion Revenue (Millions)	Surplus Congestion Revenue (Millions)
2010/2011	\$29.7	(\$1,218.7)	(\$449.3)
2011/2012	\$108.9	(\$460.3)	(\$192.5)
2012/2013	\$66.7	(\$328.5)	(\$292.3)
2013/2014	\$71.7	(\$715.3)	(\$678.7)
2014/2015*	\$29.0	\$139.8	\$139.6
2015/2016	\$29.6	\$56.4	\$42.5
2016/2017	\$27.9	\$97.1	\$72.6
2017/2018	\$27.4	\$344.0	\$371.2
2018/2019	\$180.8	(\$68.5)	\$112.3
2019/2020	\$217.8	(\$87.9)	\$140.7
2020/2021	\$166.1	(\$185.1)	(\$14.5)
2021/2022	\$168.5	(\$198.0)	(\$29.5)
2022/2023	\$289.2	(\$54.0)	\$235.2
2023/2024	\$264.4	(\$146.7)	\$117.8
2024/2025**	\$117.3	(\$116.4)	\$0.9
Total	\$1,795.1	(\$2,942.1)	(\$424.1)

\*Start of counter flow "buy back"

\*\*First seven months of the 2024/2025 planning period

<sup>41</sup> The bar for January 2018 is truncated.

<sup>42</sup> Total congestion surplus not equal to the sum of the columns in years prior to the 2017/2018 planning period because other charges were subtracted from the congestion surplus.

## “Revenue Adequacy”

FTR revenue adequacy, like surplus congestion revenue, is a misnomer. FTR revenue adequacy, as defined in PJM rules, is an artifact of the flawed design of the current approach to FTR/ARRs. If FTRs only returned congestion to FTR holders, there could be no such thing as revenue inadequacy.

As currently defined in PJM, FTR revenue adequacy simply compares day-ahead congestion revenues to FTR target allocations. (Target allocations are the day-ahead CLMP differences, shadow prices, between the source and sink of the FTR times the MW of the FTR. Congestion revenues are the day-ahead CLMP differences, shadow prices, between sources and sinks times the MW flow on the lines.) There is no reason to expect congestion revenues to equal FTR target allocations under the path based approach. There are systematic differences between FTR target allocations and actual congestion in aggregate and on a path by path basis. Revenue adequacy is not a benchmark for how well the FTR process is working. Target allocations are not congestion. FTR revenue adequacy is not equivalent to the adequacy of ARRs as an offset for load against total congestion. A path specific target allocation is not a guarantee of payment. Yet PJM treats target allocations as a guarantee of payment and takes what is termed surplus auction revenue from ARR holders (load) and gives it to FTR holders when day-ahead congestion revenues are not enough to cover all FTR target allocations.

Actual day-ahead congestion revenues are not a result of PJM’s decisions about the FTR auction model, but result from the operation of the day-ahead energy market. As a result, the fewer FTRs sold, the higher the probability that congestion will exceed the sum of the FTR target allocations. For example, PJM’s subjective decision to reduce available ARR/FTR supply (system capability) in the ARR/FTR market model through outage selection for the 2014/2015 through 2016/2017 planning periods resulted in actual day-ahead congestion exceeding target allocations at the expense of a reduction in available ARRs and associated FTRs. PJM’s decisions have included the arbitrary use of higher outage levels and the decision to include additional constraints (closed loop interfaces) both of which reduced the FTRs made available for sale in FTR auctions. PJM’s actions have led to a significant reduction in the allocation of

Stage 1B and Stage 2 ARRs and therefore a reduction in available FTRs.

PJM’s arbitrary decision to increase outages in the ARR allocation and in the Annual FTR Auction did not address the Stage 1A ARR over allocation issue directly because Stage 1A ARR allocations cannot be prorated. Instead, PJM’s actions for the 2014/2015 through 2016/2017 planning periods resulted in decreased Stage 1B ARR allocations, decreased Stage 2 ARR allocations and decreased FTR capability. The direct assignment of balancing congestion (generally negative) and M2M payments to load beginning in the 2017/2018 planning period arbitrarily decreased congestion available for load and increased the congestion revenue available to pay FTR holders. PJM reduced the number of outages taken in the ARR allocation and in the Annual FTR Auction, increasing the supply of ARRs and FTRs. The current ARR/FTR design does not serve as an efficient way to ensure that load receives all the congestion revenues or has the ability to receive the auction revenues associated with all the potential congestion revenues. There are several reasons for the disconnect between congestion revenues and ARR/FTR revenues in the current design. The reasons include: the use of generation to load paths rather than a measure of total congestion to assign congestion revenue rights; the failure to provide to ARR holders the full system capability that is provided to FTR purchasers in the Long Term FTR Auction; unavoidable modeling differences such as emergency outages; avoidable modeling differences such as outage modeling decisions; and cross subsidies among and between FTR participants and ARR holders.

Revenue adequacy for ARRs is, for practical purposes, a meaningless concept. Revenue adequacy for ARRs means that FTR buyers collectively pay more than zero for FTRs in FTR auctions, and that those payments were received by ARR holders. For that reason, ARRs have unsurprisingly been defined to be revenue adequate for every auction to date. ARR revenue adequacy has nothing to do with the adequacy of ARRs as an offset to total congestion. ARRs can be revenue adequate at the same time that ARRs return only half of congestion to load, or even much less.

Total net FTR auction revenue for the 2023/2024 planning period, before accounting for self scheduling, load shifts or residual ARRs, was \$1,874.5 million. For



the first seven months of the 2024/2025 planning period, total net FTR auction revenue was \$1,654.3 million.

Table 13-42 presents the PJM FTR revenue detail for the 2023/2024 planning period and the first seven months of the 2024/2025 planning period. This includes ARR target allocations from the Annual ARR Allocation and net revenue sources from the Long Term, Annual and Monthly Balance of Planning Period FTR Auctions.<sup>43</sup> In this table, under the balancing congestion and M2M payment rules, any negative congestion is from day-ahead congestion and does not include balancing congestion. A remaining surplus will be distributed to ARR holders at the end of the planning period, while a remaining deficiency will be charged to all FTR holders as FTR uplift at the end of the planning period. The actual surplus or deficiency for the planning period is not known until the end of the planning period. In the 2023/2024 planning period and the first seven months of the 2024/2025 planning period, FTRs were paid part of the ARR auction surplus to ensure the payment of the FTR target allocations.

FTR target allocations are defined based on hourly CLMP differences in the day-ahead energy market for FTR paths. FTR credits are paid to FTR holders and, depending on market conditions, can be less than the target allocations but are capped at target allocations. Table 13-43 lists the FTR revenues, target allocations, credits, payout ratios, congestion credit deficiencies and excess congestion charges by month for the 2023/2024 planning period and the first seven months of the 2024/2025 planning period.

The total row in Table 13-43 is not the sum of each of the monthly rows because the monthly rows may include excess revenues carried forward from prior months and excess revenues distributed back from later months.

**Table 13-42 Total annual ARR and FTR revenue detail (Dollars (Millions)): 2023/2024 and 2024/2025 planning periods**

Accounting Element	2023/2024	2024/2025*
<b>ARR Information</b>		
ARR Target Allocations	\$1,592.2	\$1,429.7
ARR Credits	\$1,592.2	\$1,429.7
<b>FTR Auction Revenue</b>	<b>\$1,874.5</b>	<b>\$1,654.3</b>
Annual FTR Auction Net Revenue	\$1,694.3	\$1,475.3
Long Term FTR Auction Net Revenue	\$94.7	\$110.0
Monthly Balance of Planning Period FTR Auction Net Revenue	\$85.6	\$69.0
<b>Surplus Auction Revenue</b>		
ARR Surplus	\$264.4	\$224.5
ARR Payout Ratio	100%	100%
<b>FTR targets</b>		
Positive Target Allocations	\$2,190.6	\$1,709.4
Negative Target Allocations	(\$424.4)	(\$240.9)
FTR Target Allocations	\$1,766.1	\$1,468.5
<b>FTR Revenues</b>		
ARR Surplus	\$264.4	\$224.5
<b>Congestion</b>		
Net Negative Congestion	\$0.0	\$0.0
Hourly Congestion Revenue	\$1,619.5	\$1,352.1
Surplus Congestion Revenues Distributed to Other Months	\$29.1	\$69.6
<b>Total FTR Congestion Credits</b>	<b>\$1,766.1</b>	<b>\$1,469.4</b>
<b>FTR Payout Ratio</b>		
Congestion	91.7%	92.1%
Congestion and ARR Surplus	100.0%	100.0%
Remaining Deficiency	\$0.0	\$0.0
<b>Remaining Surplus</b>	<b>\$117.8</b>	<b>\$0.8</b>

\*First seven months of the 2024/2025 planning period

<sup>43</sup> The final ARR values may change if load shifts.

Table 13-43 Monthly FTR accounting summary (Dollars (Millions)): 2023/2024 and 2024/2025 planning period

Period	FTR Revenues (with adjustments)	FTR Target Allocations	FTR Payout Ratio (original)	FTR Credits (with adjustments)	FTR Payout Ratio (with adjustments)	Monthly Credits Surplus (with adjustments)	Monthly Credits Deficiency (with adjustments)
Jun-23	\$105.4	\$95.8	100.0%	\$105.4	100.0%	\$9.6	\$0.0
Jul-23	\$185.5	\$157.9	100.0%	\$185.5	100.0%	\$30.5	\$0.0
Aug-23	\$152.6	\$135.9	100.0%	\$152.6	100.0%	\$16.7	\$0.0
Sep-23	\$157.0	\$160.6	97.8%	\$160.6	100.0%	\$0.0	(\$3.6)
Oct-23	\$174.1	\$193.6	90.0%	\$193.6	100.0%	\$0.0	(\$19.4)
Nov-23	\$155.2	\$158.9	97.7%	\$158.9	100.0%	\$0.0	(\$3.7)
Dec-23	\$121.4	\$123.9	98.0%	\$123.9	100.0%	\$0.0	(\$2.4)
Jan-24	\$259.9	\$196.8	100.0%	\$196.8	100.0%	\$63.1	\$0.0
Feb-24	\$94.6	\$76.1	100.0%	\$76.1	100.0%	\$18.5	\$0.0
Mar-24	\$123.3	\$117.9	100.0%	\$117.9	100.0%	\$5.4	\$0.0
Apr-24	\$131.6	\$129.5	100.0%	\$129.5	100.0%	\$2.2	\$0.0
May-24	\$223.3	\$222.4	100.0%	\$222.4	100.0%	\$0.9	\$0.0
Summary for Planning Period 2023/2024							
Total	\$1,884.0	\$1,769.1		\$1,823.1		\$117.8	
Jun-24	\$168.6	\$164.0	100.0%	\$164.0	100.0%	\$4.7	\$0.0
Jul-24	\$387.4	\$347.8	100.0%	\$347.8	100.0%	\$39.6	\$0.0
Aug-24	\$272.4	\$250.0	100.0%	\$250.0	100.0%	\$22.4	\$0.0
Sep-24	\$144.9	\$169.4	85.5%	\$169.4	100.0%	\$0.0	(\$24.4)
Oct-24	\$156.2	\$176.5	88.5%	\$176.5	100.0%	\$0.0	(\$20.3)
Nov-24	\$103.2	\$99.4	100.0%	\$99.4	100.0%	\$3.8	\$0.0
Dec-24	\$236.6	\$261.5	90.5%	\$261.5	100.0%	\$0.0	(\$24.9)
Summary for Planning Period 2024/2025							
Total	\$1,469.3	\$1,468.5		\$1,468.5		\$0.9	

\* First seven months of the 2024/2025 planning period

Figure 13-16 shows the original PJM reported FTR payout ratio by month, excluding excess revenue distribution, for January 2004 through December 2024. The months with payout ratios above 100 percent have congestion revenue greater than the target allocations and the months with payout ratios under 100 percent have congestion revenue that is less than the target allocations. Figure 13-16 also shows the payout ratio after distributing surplus congestion revenue across months within the planning period. The payout ratio for months with a payout ratio less than 100 percent in the current planning period may change if surplus congestion revenue is collected in the remainder of the planning period and assigned to prior months.

Figure 13-16 FTR payout ratio by month, excluding and including excess revenue distribution: January 2004 through December 2024

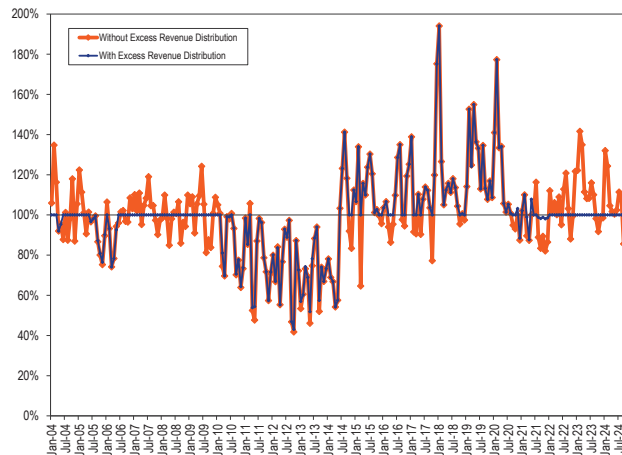


Table 13-44 shows the FTR payout ratio by planning period from the 2003/2004 planning period forward. The 2013/2014 planning period includes the additional revenue from unallocated congestion charges from Balancing Operating Reserves. Beginning with the 2018/2019 planning period payments to FTRs are limited to 100 percent of the target allocations.

The first seven months of the 2024/2025 planning period had a payout ratio of 100.0 percent based on the payment of surplus to FTR holders.


**Table 13-44 Reported FTR payout ratio by planning period<sup>44</sup>**

Planning Period	FTR Payout Ratio
2003/2004	97.7%
2004/2005	100.0%
2005/2006	90.7%
2006/2007	100.0%
2007/2008	100.0%
2008/2009	100.0%
2009/2010	96.9%
2010/2011	85.0%
2011/2012	80.6%
2012/2013	67.8%
2013/2014	72.8%
2014/2015	116.2%
2015/2016	106.8%
2016/2017	112.6%
2017/2018	138.5%
2018/2019	100.0%
2019/2020	100.0%
2020/2021	98.7%
2021/2022	99.0%
2022/2023	100.0%
2023/2024	100.0%
2024/2025*	100.0%

\*First seven months of 2024/2025

Figure 13-17 shows the day-ahead balancing, total congestion and the FTR surplus from 2005 through December 2024.

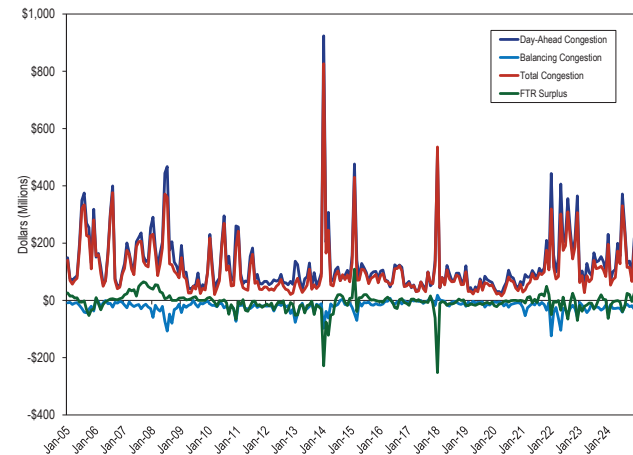**Figure 13-17 FTR surplus and day-ahead, balancing and total congestion: 2005 through December 2024**



### Target Allocations and Congestion by Constraint Do Not Match

One of the reasons that the current path based ARR/FTR market design does not provide a reasonable way to return congestion to load is because target allocations on the FTR paths do not align with congestion based on actual network use. A comparison of FTR market flow to the physical system limits enforced in the day ahead and real time market provides evidence of this misalignment.

Table 13-45 shows the total congestion, balancing congestion, FTR target allocations, and excess FTR target allocation for binding constraints where the FTR market flow is greater than the binding day ahead constraint line limit. FTR market flow on every constraint in the day ahead and real time market model is calculated, for every hour, by treating each FTR source as an injection equal to the MW of the FTR and each FTR sink as a withdrawal equal to the MW of the FTR. Market flow includes prevailing flow and counterflow FTRs. On constraints where FTR market flow is greater than the modeled day ahead system capability, the FTR target allocations are greater than the day ahead congestion on the constraint. In cases where the real time line limits are lower than the day ahead line limits in the same hour and balancing congestion is negative, the difference between the FTR target allocations and the total congestion (the sum of day ahead and balancing congestion) on the constraint is even larger. When FTR target allocations exceed congestion on a constraint, the

<sup>44</sup> The actual payout ratios for the 2006/2007, 2007/2008, and 2008/2009 planning periods may have exceeded 100 percent.

FTR is over allocated. Excess FTR target allocations on a constraint are the difference between FTR target allocations and total congestion.

Table 13-45 also shows the total number of binding constraint hours and the number of binding constraint hours where the FTR market flow is greater than the binding constraint limit.<sup>45</sup> In the first seven months of the 2024/2025 planning period, FTR market flow exceeded the constraint limit in 99.7 percent of binding constraint hours, compared to 98.8 percent in the 2023/2024 planning period. In the first seven months of the 2024/2025 planning period, FTR target allocations were \$182.1 million (14.2 percent) greater than total congestion for constraint hours where FTR market flow exceeded the constraint limit, compared to \$184.4 million (11.6 percent) in the 2023/2024 planning period.

**Table 13-45 Total congestion, balancing congestion, FTR target allocations and excess FTR target allocations for binding constraint hours where FTR flow is greater than line limit: 2023/2024 and 2024/2025 planning period**

Binding Constraint Hours where FTR Flow > Constraint Limit											
Month	Binding Constraint Hours	Constraint Hours where FTR Flow > Constraint Limit	Percent of Constraint Hours where FTR Flow > Constraint Limit	Total Congestion	Average Congestion Per Constraint Hour	Balancing Congestion	Average Balancing Congestion Per Constraint Hour	FTR Target Allocations	FTR Target Allocations Per Constraint Hour	Excess FTR Target Allocations	Average Excess FTR Target Allocations Per Constraint Hour
Jun-23	5,930	5,816	98.1%	\$84,858,168	\$14,590	(\$1,009,644)	(\$173.6)	\$95,432,128	\$16,409	\$10,573,960	\$1,818
Jul-23	6,728	6,701	99.6%	\$158,178,031	\$23,605	(\$7,241,328)	(\$1,080.6)	\$154,850,314	\$23,109	(\$3,327,717)	(\$497)
Aug-23	5,594	5,587	99.9%	\$130,600,142	\$23,376	(\$3,015,859)	(\$539.8)	\$136,041,737	\$24,350	\$5,441,595	\$974
Sep-23	5,842	5,793	99.2%	\$133,267,063	\$23,005	(\$4,822,979)	(\$833)	\$160,805,383	\$27,759	\$27,538,320	\$4,754
Oct-23	5,739	5,710	99.5%	\$152,963,582	\$26,789	(\$153,907)	(\$27)	\$194,325,750	\$34,033	\$41,362,168	\$7,244
Nov-23	4,998	4,961	99.3%	\$134,632,079	\$27,138	(\$392,757)	(\$79)	\$159,163,104	\$32,083	\$24,531,026	\$4,945
Dec-23	6,512	6,429	98.7%	\$98,303,995	\$15,291	(\$533,053)	(\$83)	\$123,851,052	\$19,264	\$25,547,057	\$3,974
Jan-24	6,003	5,886	98.1%	\$228,733,307	\$38,861	(\$1,959,739)	(\$333)	\$197,025,736	\$33,474	(\$31,707,572)	(\$5,387)
Feb-24	5,721	5,646	98.7%	\$62,049,154	\$10,990	(\$8,676,899)	(\$1,537)	\$79,671,754	\$14,111	\$17,622,600	\$3,121
Mar-24	7,877	7,722	98.0%	\$96,116,206	\$12,447	(\$3,717,637)	(\$481)	\$117,876,892	\$15,265	\$21,760,686	\$2,818
Apr-24	6,464	6,339	98.1%	\$108,073,002	\$17,049	(\$66,292)	(\$10)	\$129,236,935	\$20,388	\$21,163,933	\$3,339
May-24	6,833	6,744	98.7%	\$198,888,768	\$29,491	(\$342,924)	(\$51)	\$222,792,080	\$33,036	\$23,903,312	\$3,544
Summary for 2023/2024 Planning Period											
Total	74,241	73,334	98.8%	\$1,586,663,498	\$21,636	(\$31,933,021)	(\$435)	\$1,771,072,865	\$24,151	\$184,409,367	\$2,515
Jun-24	6,601	6,532	99.0%	\$152,153,569	\$23,294	(\$2,671,817)	(\$409)	\$163,975,902	\$25,103	\$11,822,333	\$1,810
Jul-24	6,379	6,371	99.9%	\$319,790,027	\$50,195	(\$3,129,904)	(\$491)	\$348,190,460	\$54,652	\$28,400,433	\$4,458
Aug-24	5,822	5,799	99.6%	\$255,431,810	\$44,048	(\$1,013,646)	(\$175)	\$249,951,643	\$43,103	(\$5,480,167)	(\$945)
Sep-24	5,974	5,968	99.9%	\$127,836,975	\$21,420	(\$804,940)	(\$135)	\$169,406,326	\$28,386	\$41,569,351	\$6,965
Oct-24	7,039	7,039	100.0%	\$135,338,499	\$19,227	(\$1,928,212)	(\$274)	\$176,563,214	\$25,084	\$41,224,715	\$5,857
Nov-24	5,787	5,775	99.8%	\$74,192,938	\$12,847	(\$10,352,893)	(\$1,793)	\$99,387,427	\$17,210	\$25,194,488	\$4,363
Dec-24	8,015	7,997	99.8%	\$222,103,743	\$27,773	\$3,916,117	\$490	\$261,477,705	\$32,697	\$39,373,961	\$4,924
Summary for 2024/2025 Planning Period											
Total	45,617	45,481	99.7%	\$1,286,847,562	\$28,294	(\$15,985,295)	(\$351)	\$1,468,952,677	\$32,298	\$182,105,115	\$4,004

<sup>45</sup> Only includes hours where constraints are binding day ahead.

Table 13-46 shows the total congestion, balancing congestion, FTR target allocations and excess FTR target allocations for binding constraints where the FTR market flow is less than the binding constraint line limit. Table 13-46 also shows the total number of binding constraint hours and the number of binding constraint hours where the FTR market flow is less than the binding constraint limit. In the first seven months of the 2024/2025 planning period FTR target allocations were \$114.6 thousand less than the total congestion for constraint hours where FTR market flow did not exceed the constraint limit, compared to \$1.9 million in the 2023/2024 planning period.

**Table 13-46 Total congestion, balancing congestion, FTR target allocations and excess FTR target allocations for binding constraint hours where FTR flow is less than line limit: 2023/2024 and 2024/2025 planning period**

Binding Constraint Hours where FTR Flow < Constraint Limit											
Month	Binding Constraint Hours	Constraint Hours where FTR Flow < Constraint Limit	Percent of Constraint Hours where FTR Flow < Constraint Limit	Total Congestion	Average Congestion Per Constraint Hour	Balancing Congestion	Average Balancing Congestion Per Constraint Hour	FTR Target Allocations	FTR Target Allocations Per Constraint Hour	Excess FTR Target Allocations	Average Excess FTR Target Allocations Per Constraint Hour
Jun-23	5,930	114	1.9%	\$1,258,252	\$11,037	\$0	\$0	\$621,793	\$5,454	(\$636,458)	(\$5,583)
Jul-23	6,728	27	0.4%	\$819,708	\$30,360	\$0	\$0	\$341,660	\$12,654	(\$478,048)	(\$17,705)
Aug-23	5,594	7	0.1%	\$7,900	\$1,129	\$0	\$0	\$2,236	\$319	(\$5,664)	(\$809)
Sep-23	5,842	49	0.8%	\$176,209	\$3,596	\$0	\$0	\$52,157	\$1,064	(\$124,052)	(\$2,532)
Oct-23	5,739	29	0.5%	\$26,356	\$909	\$0	\$0	\$4,987	\$172	(\$21,369)	(\$737)
Nov-23	4,998	37	0.7%	\$43,662	\$1,180	\$0	\$0	(\$1,585)	(\$43)	(\$45,247)	(\$1,223)
Dec-23	6,512	83	1.3%	\$110,574	\$1,332	\$0	\$0	\$13,262	\$160	(\$97,312)	(\$1,172)
Jan-24	6,003	117	1.9%	\$234,274	\$2,002	\$0	\$0	\$586	\$5	(\$233,688)	(\$1,997)
Feb-24	5,721	75	1.3%	\$35,402	\$472	\$0	\$0	(\$1,275)	(\$17)	(\$36,677)	(\$489)
Mar-24	7,877	155	2.0%	\$113,238	\$731	\$0	\$0	(\$2,576)	(\$17)	(\$115,814)	(\$747)
Apr-24	6,464	125	1.9%	\$260,140	\$2,081	\$0	\$0	\$211,227	\$1,690	(\$48,913)	(\$391)
May-24	6,833	89	1.3%	\$118,087	\$1,327	\$0	\$0	\$59,341	\$667	(\$58,747)	(\$660)
Summary for 2023/2024 Planning Period											
Total	74,241	907	1.2%	\$3,203,802	\$3,532	\$0	\$0	\$1,301,813	\$1,435	(\$1,901,989)	(\$2,097)
Jun-24	6,601	69	1.0%	\$422,287	\$6,120	\$0	\$0	\$507,396	\$7,354	\$85,109	\$1,233
Jul-24	6,379	8	0.1%	\$20,070	\$2,509	\$0	\$0	\$24,236	\$3,029	\$4,166	\$521
Aug-24	5,822	23	0.4%	\$179,530	\$7,806	\$0	\$0	\$48,360	\$2,103	(\$131,170)	(\$5,703)
Sep-24	5,974	6	0.1%	\$7,287	\$1,214	\$0	\$0	\$2,806	\$468	(\$4,481)	(\$747)
Oct-24	7,039	0	0.0%	\$0	NA	\$0	NA	\$0	NA	\$0	NA
Nov-24	5,787	0	0.0%	\$27,633	NA	\$0	NA	\$1,249	NA	(\$26,384)	NA
Dec-24	8,015	18	0.2%	\$51,959	\$2,887	\$0	\$0	\$10,167	\$565	(\$41,792)	(\$2,322)
Summary for 2024/2025 Planning Period											
Total	45,617	124	0.3%	\$708,767	\$5,716	\$0	\$0	\$594,215	\$4,792	(\$114,552)	(\$924)

In addition to not reflecting physical line limits, the ARR and FTR rights that are defined by the current ARR/FTR market design are not aligned. Table 13-47 and Table 13-48 illustrate this difference when compared to Table 13-45 and Table 13-46.

Table 13-47 shows the total congestion, balancing congestion, FTR target allocations, and excess FTR target allocations for binding constraints where the ARR market flow is greater than the binding day-ahead and real-time constraint line limit. ARR market flow on every constraint in the day-ahead and real-time market model is calculated, for every hour, by treating each ARR source as an injection equal to the MW of the ARR and each ARR sink as a withdrawal equal to the MW of the ARR.

Table 13-47 also shows that the ARR market flow exceeds the day-ahead constraint line limit less often than the FTR market flow exceeds the day-ahead constraint line limit. In the first seven months of the 2024/2025 planning period, ARR market flow exceeded the day ahead constraint line limit in 54.2 percent of binding constraint hours, compared to 70.7 percent of binding constraint hours in the 2023/2024 planning period.



**Table 13-47 Total congestion, balancing congestion, FTR target allocations and excess FTR target allocations for binding constraint hours where ARR flow is greater than line limit: 2023/2024 and 2024/2025 planning periods**

Binding Constraint Hours where ARR Flow > Constraint Limit											
Month	Binding Constraint Hours	Constraint Hours where ARR Flow > Constraint Limit	Percent of Constraint Hours where FTR Flow > Constraint Limit	Total Congestion	Average Congestion Per Constraint Hour	Balancing Congestion	Average Balancing Congestion Per Constraint Hour	FTR Target Allocations	FTR Target Per Constraint Hour	Excess FTR Target Allocations	Average Excess FTR Target Per Constraint Hour
Jun-23	5,930	3,201	54.1%	\$64,013,369	\$19,998	\$1,127	\$0.4	\$80,285,781	\$25,081	\$16,272,413	\$5,084
Jul-23	6,728	3,589	53.3%	\$110,416,240	\$30,765	(\$224,768)	(\$62.6)	\$112,838,751	\$31,440	\$2,422,511	\$675
Aug-23	5,594	3,282	58.7%	\$101,151,696	\$30,820	\$0	\$0.0	\$112,700,174	\$34,339	\$11,548,479	\$3,519
Sep-23	5,842	3,402	58.3%	\$113,311,586	\$33,307	\$10,560	\$3	\$140,468,736	\$41,290	\$27,157,150	\$7,983
Oct-23	5,739	3,531	61.5%	\$124,095,718	\$35,145	(\$153,907)	(\$44)	\$171,000,392	\$48,428	\$46,904,674	\$13,284
Nov-23	4,998	3,255	65.1%	\$102,696,538	\$31,550	(\$392,757)	(\$121)	\$136,639,072	\$41,978	\$33,942,534	\$10,428
Dec-23	6,512	3,538	54.3%	\$72,469,797	\$20,483	\$198,392	\$56	\$103,699,047	\$29,310	\$31,229,250	\$8,827
Jan-24	6,003	3,049	50.8%	\$118,375,199	\$38,824	(\$25,358)	(\$8)	\$118,566,174	\$38,887	\$190,975	\$63
Feb-24	5,721	2,456	43.5%	\$29,093,399	\$11,846	\$39,258	\$16	\$36,985,376	\$15,059	\$7,891,977	\$3,213
Mar-24	7,877	4,294	54.7%	\$58,962,869	\$13,731	(\$261,820)	(\$61)	\$83,189,143	\$19,373	\$24,226,274	\$5,642
Apr-24	6,464	3,958	61.3%	\$77,364,582	\$19,546	\$41,446	\$10	\$104,347,546	\$26,364	\$26,982,964	\$6,817
May-24	6,833	4,823	70.7%	\$166,159,835	\$34,452	\$58,919	\$12	\$194,255,891	\$40,277	\$28,096,056	\$5,825
Summary for 2023/2024 Planning Period											
Total	74,241	42,378	57.1%	\$1,138,110,828	\$26,856	(\$708,908)	(\$17)	\$1,394,976,085	\$32,917	\$256,865,256	\$6,061
Jun-24	6,601	3,569	54.1%	\$98,817,133	\$27,688	\$112,632.08	\$32	\$114,736,522	\$32,148	\$15,919,389	\$4,460
Jul-24	6,379	3,270	51.3%	\$173,192,794	\$52,964	(\$1,447,137)	(\$443)	\$203,245,713	\$62,155	\$30,052,918	\$9,190
Aug-24	5,822	3,334	57.3%	\$162,050,400	\$48,605	(\$138,326)	(\$41)	\$164,266,716	\$49,270	\$2,216,316	\$665
Sep-24	5,974	3,661	61.3%	\$99,998,174	\$27,314	\$222,819	\$61	\$138,147,285	\$37,735	\$38,149,111	\$10,420
Oct-24	7,039	4,200	59.7%	\$100,001,689	\$23,810	(\$174,115)	(\$41)	\$141,436,562	\$33,675	\$41,434,873	\$9,865
Nov-24	5,787	3,278	56.6%	\$65,140,783	\$19,872	(\$788,163)	(\$240)	\$81,929,385	\$24,994	\$16,788,602	\$5,122
Dec-24	8,015	3,420	42.7%	\$91,776,716	\$26,835	\$8,287	\$2	\$92,600,527	\$27,076	\$823,812	\$241
Summary for 2024/2025 Planning Period											
Total	45,617	24,732	54.2%	\$790,977,691	\$31,982	(\$1,250,012)	(\$51)	\$936,362,711	\$37,860	\$145,385,020	\$5,878

Table 13-48 shows the total congestion, balancing congestion, FTR target allocations and excess FTR target allocations for binding constraint hours where the ARR market flow is less than the binding constraint day-ahead and real-time line limit. Table 13-48 also shows the number of binding constraint hours where the ARR market flow is less than the binding day-ahead and real-time constraint limit.

**Table 13-48 Total congestion, balancing congestion, FTR target allocations and excess FTR target allocations for binding constraint hours where ARR flow is less than line limit: 2023/2024 and 2024/2025 planning periods**

Binding Constraint Hours where ARR Flow < Constraint Limit											
Month	Binding Constraint Hours	Constraint Hours where ARR Flow < Limit	Percent of Constraint Hours where ARR Flow < Limit	Total Congestion	Average Congestion Per Hour	Balancing Congestion	Average Balancing Congestion Per Hour	FTR Target Allocations	FTR Target Per Hour	Excess Allocations	Average Excess FTR Target Per Constraint Hour
Jun-23	5,930	2,718	45.9%	\$22,065,933	\$8,118	(\$1,010,772)	(\$372)	\$15,734,785	\$5,789	(\$6,331,147)	(\$2,329)
Jul-23	6,728	3,139	46.7%	\$48,581,499	\$15,477	(\$7,016,560)	(\$2,235)	\$42,353,223	\$13,493	(\$6,228,276)	(\$1,984)
Aug-23	5,594	2,310	41.3%	\$29,447,869	\$12,748	(\$3,015,859)	(\$1,306)	\$23,337,272	\$10,103	(\$6,110,598)	(\$2,645)
Sep-23	5,842	2,436	41.7%	\$20,117,338	\$8,258	(\$4,833,539)	(\$1,984)	\$20,377,015	\$8,365	\$259,677	\$107
Oct-23	5,739	2,208	38.5%	\$28,894,220	\$13,086	\$0	\$0	\$23,330,345	\$10,566	(\$5,563,875)	(\$2,520)
Nov-23	4,998	1,742	34.9%	\$31,978,771	\$18,358	\$0	\$0	\$22,522,397	\$12,929	(\$9,456,374)	(\$5,428)
Dec-23	6,512	2,974	45.7%	\$25,944,772	\$8,724	(\$731,445)	(\$246)	\$20,165,267	\$6,781	(\$5,779,505)	(\$1,943)
Jan-24	6,003	2,954	49.2%	\$110,592,382	\$37,438	(\$1,934,382)	(\$655)	\$78,460,147	\$26,561	(\$32,132,235)	(\$10,878)
Feb-24	5,721	3,194	56.5%	\$31,277,713	\$9,793	(\$8,666,519)	(\$2,713)	\$40,570,439	\$12,702	\$9,292,726	\$2,909
Mar-24	7,877	3,563	45.3%	\$36,952,538	\$10,371	(\$3,455,817)	(\$970)	\$34,494,874	\$9,681	(\$2,457,664)	(\$690)
Apr-24	6,464	2,504	38.7%	\$30,967,737	\$12,367	(\$107,738)	(\$43)	\$25,101,218	\$10,024	(\$5,866,520)	(\$2,343)
May-24	6,833	1,996	29.3%	\$32,812,527	\$16,439	(\$401,843)	(\$201)	\$28,583,558	\$14,320	(\$4,228,968)	(\$2,119)
Summary for 2023/2024 Planning Period											
Total	74,241	31,738	42.7%	\$449,633,300	\$14,167	(\$31,174,474)	(\$982)	\$375,030,540	\$11,816	(\$74,602,759)	(\$2,351)
Jun-24	6,601	3,032	45.9%	\$53,757,683	\$17,730	(\$2,784,449)	(\$918)	\$49,746,592	\$16,407	(\$4,011,091)	(\$1,323)
Jul-24	6,379	3,109	48.7%	\$146,617,302	\$47,159	(\$1,682,767)	(\$541)	\$144,968,983	\$46,629	(\$1,648,320)	(\$530)
Aug-24	5,822	2,488	42.7%	\$93,543,292	\$37,598	(\$875,320)	(\$352)	\$85,713,456	\$34,451	(\$7,829,836)	(\$3,147)
Sep-24	5,974	2,313	38.7%	\$27,846,088	\$12,039	(\$1,027,759)	(\$444)	\$31,261,847	\$13,516	\$3,415,759	\$1,477
Oct-24	7,039	2,839	40.3%	\$35,266,755	\$12,422	(\$1,754,097)	(\$618)	\$35,055,749	\$12,348	(\$211,005)	(\$74)
Nov-24	5,787	2,509	43.4%	\$9,052,155	\$3,608	(\$9,564,730)	(\$3,812)	\$17,458,042	\$6,958	\$8,405,886	\$3,350
Dec-24	8,015	4,595	57.3%	\$130,332,901	\$28,364	\$3,907,830	\$850	\$168,884,649	\$36,754	\$38,551,748	\$8,390
Summary for 2024/2025 Planning Period											
Total	45,617	20,885	45.8%	\$496,416,176	\$23,769	(\$6,370,294)	(\$305)	\$533,089,317	\$25,525	\$36,673,141	\$1,756

The path based ARR/FTR market design does not align with congestion based on actual network use. A comparison of the FTR target allocations for individual constraints to the day-ahead and total congestion by constraint provides evidence of this misalignment. Total congestion is the sum of day-ahead and balancing congestion. If FTR target allocations on some paths are significantly greater than actual congestion and FTR target allocations on other paths are significantly less than actual congestion, this is evidence of a serious flaw in the design. It is evidence of a mismatch between the definition of target allocations paid to FTR holders and the congestion that is the purported source of those payments.

FTR target allocations are the result of constraints on day-ahead paths in the energy market. Any specific FTR path may be affected by multiple constraints. Constraints that result in FTR target allocations greater than the congestion that results from those constraints mean that the FTR target allocations are greater than the actual congestion. Figure 13-18 shows the constraints that are the top 10 sources of positive FTR target allocations, for the first seven months of the 2024/2025 planning period. Figure 13-18 also shows the corresponding day-ahead congestion and total congestion that result from the identified constraints. Constraints for which FTR target allocations were greater than total congestion resulted in \$368.6 million of excess target allocations not funded by actual congestion. Such constraints include constraints in Figure 13-18, such as Lenox – North Meshoppen, which resulted in FTR target allocations that were 2.0 times larger than the corresponding total congestion. In order to pay FTRs their target allocations on these constraints, congestion from other constraints where congestion exceeds target allocations and auction surplus are used as the source. This is not consistent with an efficient market either for other FTR holders or for load.

**Figure 13-18 Top ten constraint sources of positive FTR target allocations: June through December, 2024**

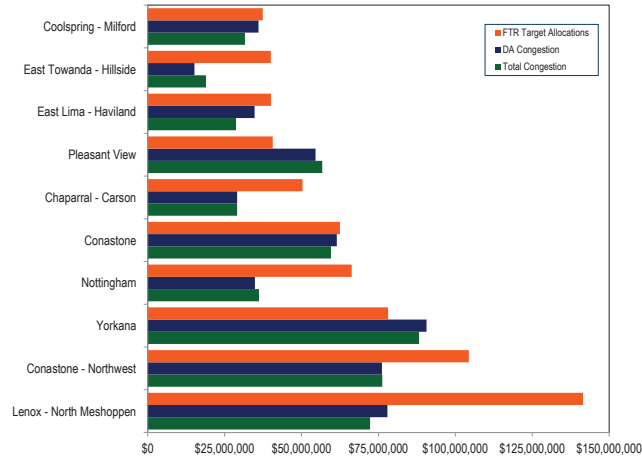


Figure 13-19 shows the hourly FTR target allocations, day-ahead congestion and balancing congestion for the Lenox – North Meshoppen constraint for the first seven months of the 2024/2025 planning period. The Lenox – North Meshoppen constraint was the largest source of FTR target allocations during this period. The significant and variable difference between constraint specific FTR target allocations and constraint specific day ahead congestion provides evidence of the misalignment and over allocation of the path based FTR congestion rights relative to the actual network use of the physical energy market.

The Lenox – North Meshoppen constraint was a significant component of the overallocation of FTRs. FTRs routinely receive more target allocations than the congestion collected from the system because of the misalignment and over allocation of the path based FTR congestion rights relative to the actual network use of the physical energy market. The misalignment and overallocation of path based FTRs is exacerbated when line outages reduce the physical system capability between generation and load (the source of congestion revenue) relative to system capability assumed in the FTR market model. Figure 13-19 shows a large deviation between FTR target allocations and congestion for the Lenox – North Meshoppen constraint in December 2024. The main contributing factor for the deviation was the outage of the Grover – Scotch Hollow line.

**Figure 13-19 Hourly FTR target allocations, day-ahead congestion and balancing congestion for the Lenox – North Meshoppen constraint: June through December, 2024**

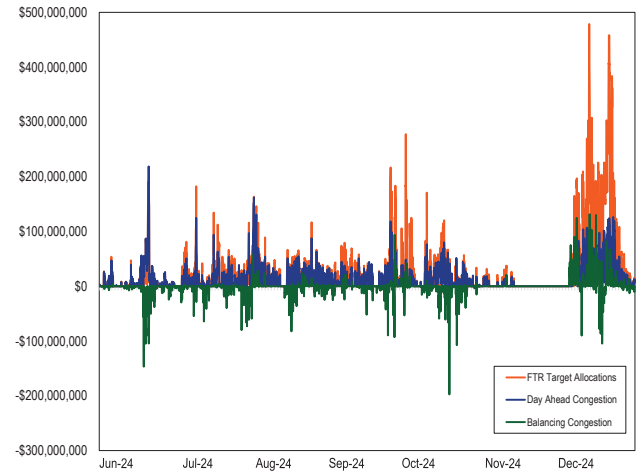


Table 13-49 shows the monthly FTR target allocation, total congestion, and FTR overallocation for the Lenox – North Meshoppen constraint in the first seven months of the 2024/2025 planning period. FTR overallocation is FTR target allocation collected by the constraint that is in excess of the congestion collected by the constraint. The FTR target allocation for the Lenox – North Meshoppen in December, 2024 constraint was 208.9 percent of the total congestion and 572.6 percent of the average FTR target allocations in the first six months of the 2024/2025 planning period. Overallocation of FTRs contributes to FTR underfunding and reduces surplus that is distributed among ARR holders at the end of the planning.


**Table 13-49 Monthly FTR overallocation for the Lenox – North Meshoppen constraint: January through December 2024**

Month	FTR Target Allocation	Total Congestion	FTR Overallocation
June, 2024	\$6,915,539	\$3,872,742	\$3,042,797
July, 2024	\$11,949,705	\$4,148,749	\$7,800,956
August, 2024	\$18,176,062	\$15,338,831	\$2,837,231
September, 2024	\$16,934,305	\$9,316,148	\$7,618,157
October, 2024	\$16,046,413	\$6,019,777	\$10,026,635
November, 2024	\$1,501,265	\$916,287	\$584,978
December, 2024	\$68,251,595	\$32,671,270	\$35,580,325
Total	\$139,774,883	\$72,283,803	\$67,491,080

Figure 13-20 shows the constraints that are the top 10 sources of negative FTR target allocations (counter flow) for the first seven months of the 2024/2025 planning period. Figure 13-20 also shows the corresponding day-ahead congestion and total congestion that result from the identified constraints.

In the first seven months of the 2024/2025 planning period, there were 30 constraints that were sources of negative target allocations. All of the 30 constraints with negative target allocations resulted in positive actual total congestion. Constraints that contribute positive congestion revenues and have negative FTR target allocations are a source of funds used in the settlement process to pay for FTR target allocations on FTR paths that are overallocated relative to actual congestion.

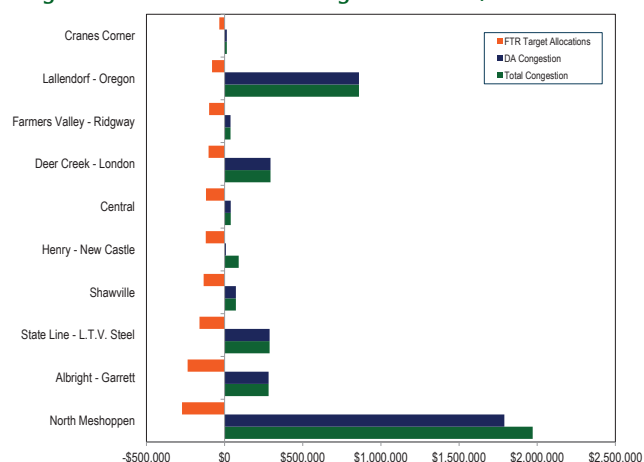**Figure 13-20 Top ten constraint sources of negative FTR target allocations: June through December, 2024**



## ARRs as an Offset to Congestion for Load

Load pays 100 percent of congestion revenues. FTRs, and later ARR, were intended to return congestion revenues to load to offset an unintended consequence of locational marginal pricing. With the implementation of the current, path based FTR/ARR design, the purpose of FTRs has been subverted. The inconsistencies between actual network solutions used to serve load and path based rights available to load cause a misalignment of congestion paid by load and the congestion paid to load, in aggregate and on a specific load basis. These inconsistencies between actual network use and path based rights cause cross subsidies between ARR holders and FTR holders and among ARR holders. One result of this misalignment is that individual zones have very different offsets due to the location of their path based ARRs compared to their actual congestion costs from actual network use.

Table 13-50 shows the ARR and FTR revenue paid to load, the congestion offset available to load with and without allocating balancing congestion to load and the congestion offset when surplus congestion revenue is allocated to load. The highlighted offsets are the actual offsets based on the rules that were effective in that planning period. The pre 2017/2018 offset is calculated as the ARR credits and the FTR credits excluding balancing congestion and M2M payments, divided by the total day-ahead congestion and the load share of balancing and M2M payments.

Total ARR and self scheduled FTR revenue offset 55.9 percent of total congestion costs for the first seven months of the 2024/2025 planning period.

**Table 13-50 ARR and self scheduled FTR total congestion offset (in millions) for ARR holders: 2011/2012 through 2024/2025 planning periods**

Planning Period	Revenue						Post 2017/2018		Prec 2017/2018		2017/2018 (With Balancing)		(With Balancing and Surplus)		Effective Offset	
							Surplus Revenue	Surplus Revenue	Post	Total	Current	Percent	New	New	Cumulative	Offset
	ARR Credits	SS FTR Credits	Day Ahead Congestion	+ M2M Congestion	Total Congestion	2017/2018	2017/2018	2017/2018	ARR/FTR	Percent	Revenue Received	Percent	Revenue Received	Offset	Revenue	Offset
2011/2012	\$515.6	\$310.0	\$1,025.4	(\$275.7)	\$749.7	(\$50.6)	\$35.6	\$113.9	\$775.0	103.4%	\$585.5	78.1%	\$663.8	88.5%	\$775.0	103.4%
2012/2013	\$356.4	\$268.4	\$904.7	(\$379.9)	\$524.8	(\$94.0)	\$18.4	\$62.1	\$530.7	101.1%	\$263.2	50.2%	\$306.9	58.5%	\$530.7	101.1%
2013/2014	\$339.4	\$626.6	\$2,231.3	(\$360.6)	\$1,870.6	(\$139.4)	(\$49.0)	(\$49.0)	\$826.5	44.2%	\$556.3	29.7%	\$556.3	29.7%	\$826.5	44.2%
2014/2015	\$487.4	\$348.1	\$1,625.9	(\$268.3)	\$1,357.6	\$36.7	\$111.2	\$400.6	\$872.2	64.2%	\$678.4	50.0%	\$967.8	71.3%	\$872.2	64.2%
2015/2016	\$641.8	\$209.2	\$1,098.7	(\$147.6)	\$951.1	\$9.2	\$42.1	\$188.9	\$860.2	90.4%	\$745.5	78.4%	\$892.3	93.8%	\$860.2	90.4%
2016/2017	\$648.1	\$149.9	\$885.7	(\$104.8)	\$780.8	\$15.1	\$36.5	\$179.0	\$813.1	104.1%	\$729.6	93.4%	\$872.1	111.7%	\$813.1	104.1%
2017/2018	\$429.6	\$212.3	\$1,322.1	(\$129.5)	\$1,192.6	\$52.3	\$80.4	\$370.7	\$694.2	58.2%	\$592.8	49.7%	\$883.1	74.1%	\$592.8	49.7%
2018/2019	\$531.6	\$130.1	\$832.7	(\$152.6)	\$680.0	(\$5.8)	\$16.2	\$112.2	\$655.87	96.4%	\$525.3	77.2%	\$621.3	91.4%	\$621.3	91.4%
2019/2020	\$547.6	\$91.9	\$612.1	(\$169.4)	\$442.7	(\$1.6)	\$21.6	\$157.8	\$637.9	144.1%	\$491.7	111.1%	\$627.9	141.8%	\$627.9	141.8%
2020/2021	\$392.7	\$179.9	\$899.6	(\$256.2)	\$643.4	(\$43.2)	(\$0.0)	(\$0.0)	\$529.31	82.3%	\$316.4	49.2%	\$316.4	49.2%	\$316.4	49.2%
2021/2022	\$469.7	\$500.5	\$2,069.2	(\$457.4)	\$1,611.8	(\$104.6)	(\$2.9)	(\$2.9)	\$865.6	53.7%	\$509.9	31.6%	\$509.9	31.6%	\$509.9	31.6%
2022/2023	\$998.7	\$630.0	\$2,223.5	(\$526.5)	\$1,697.1	(\$80.6)	\$65.1	\$235.2	\$1,548.2	91.2%	\$1,167.4	68.8%	\$1,337.5	78.8%	\$1,337.5	78.8%
2023/2024	\$912.1	\$371.4	\$1,618.9	(\$327.0)	\$1,291.9	(\$44.1)	\$24.6	\$117.2	\$1,239.4	95.9%	\$981.2	76.0%	\$1,073.7	83.1%	\$1,073.7	83.1%
2024/2025*	\$552.4	\$283.7	\$1,352.1	(\$185.4)	\$1,166.8	(\$35.6)	\$0.2	\$0.9	\$800.5	68.6%	\$650.9	55.8%	\$651.7	55.9%	\$651.7	55.9%
Total	\$7,823.0	\$4,312.1	\$18,701.8	(\$3,740.9)	\$14,960.9	(\$486.3)	\$400.0	\$1,886.6	\$11,648.8	77.9%	\$8,794.1	58.8%	\$10,280.8	68.7%	\$10,409.0	69.6%

\*First seven months of the 2024/2025 planning period

Table 13-50 illustrates the inadequacies of the ARR/FTR design. The goal of the design should be to give the rights to 100 percent of the congestion revenues to the load.

Table 13-51 shows the cumulative offset and shortfall using the rules that were effective in the given planning period to calculate the ARR/FTR revenue. The cumulative offset, beginning in the 2011/2012 planning period, is the sum of the revenue received for that planning period and all previous planning periods divided by the total congestion for that planning period and all previous planning periods. The cumulative shortfall is the cumulative difference between the ARR holders' revenue and the congestion they paid, for the planning period and prior planning periods.

From the 2011/2012 planning period through the first seven months of the 2024/2025 planning period, the cumulative offset, the cumulative return of congestion to load, was only 69.6 percent based on the total congestion and the effective offset rules that were in place for each planning period. Load has been underpaid by \$4.6 billion from the 2011/2012 planning period through the first seven months of the 2024/2025 planning period. This is an increase of \$0.6 billion from the \$4.0 billion that load had been underpaid for the 2011/2012 planning period through the 2023/2024 planning period. The \$4.6 billion is the difference between the total congestion column (\$15.0 billion) and the total offset column (\$10.4 billion) in Table 13-50.

**Table 13-51 ARR and self scheduled FTR cumulative offset for ARR holders: 2011/2012 through 2024/2025 planning periods**

Planning Period	Cumulative Offset	Cumulative Shortfall (Millions)
2011/2012	103.4%	\$25.3
2012/2013	102.4%	\$31.2
2013/2014	67.8%	(\$1,012.9)
2014/2015	66.7%	(\$1,498.3)
2015/2016	70.9%	(\$1,589.2)
2016/2017	75.0%	(\$1,556.9)
2017/2018	71.0%	(\$2,156.7)
2018/2019	72.7%	(\$2,215.4)
2019/2020	76.3%	(\$2,030.2)
2020/2021	74.4%	(\$2,357.2)
2021/2022	68.0%	(\$3,459.1)
2022/2023	69.5%	(\$3,818.7)
2023/2024	70.7%	(\$4,036.8)
2024/2025*	69.6%	(\$4,552.0)

\*First seven months of the 2024/2025 planning period

## Zonal ARR Congestion Offset

Zonal ARR congestion offsets vary significantly across zones. There is no good reason that this should be the result of a system designed to return congestion to load. PJM has offered no explanation for this result. This outcome is a direct result of the flawed definition of congestion and of the method for assigning rights to congestion to ARR holders. The results show that path based ARR assignments in the current path based ARR/FTR design are not aligned with actual network use by load, and are therefore not aligned with how congestion is actually paid by load on actual network usage. Due to this misalignment of ARR rights relative to actual network usage, individual loads cannot claim the



congestion they paid through assigned ARR. The misalignment of path based ARR rights produces cross subsidies among ARR holders.

ARRs are allocated to zonal load based on historical generation to load transmission contract paths, in many cases based on 1999 contract paths. ARRs are allocated within zones based on zonal base load (Stage 1A) and zonal peak loads (other stages). ARR revenue is the result of the prices that result from the sale of FTRs through the FTR auctions. ARR revenue for each zone is the revenue for the ARRs that sink in each zone.

Congestion paid by load in a zone is the total difference between what the zonal load pays in congestion charges net of payments to the generation that serves the zonal load, including generation in the zone and outside the zone.<sup>46</sup>

Table 13-52 shows the day-ahead congestion and balancing congestion and M2M charges paid by load in each zone along with the congestion offsets paid to load: FTR auction revenue; self scheduled FTR revenue adjusted by the payout ratio for FTRs if below 100 percent; and the allocation of end of planning period surplus.<sup>47</sup> The offset for the first seven months of the 2024/2025 planning period assigns the current surplus revenue at the end of the quarter to ARR holders. Table 13-52 also shows payments by load for balancing congestion and M2M payments. The total congestion offset paid to load is the sum of all of those credits and charges.

The zonal offset percentage shown in Table 13-52 is the sum of the congestion related revenues (offset) paid to load in each zone divided by the total congestion payment made by load in each zone.

**Table 13-52 Zonal ARR and self scheduled FTR total congestion offset (in millions) for ARR holders: 2024/2025 planning period**

Zone	ARR Credits	Adjusted FTR Credits	Balancing+ M2M Charge	Surplus Allocation	Total Offset	Day Ahead Congestion	Balancing Congestion	M2M Payments	Total Congestion	Offset
ACEC	\$2.6	(\$0.0)	(\$2.34)	\$0.0	\$0.2	\$13.8	(\$2.2)	(\$0.2)	\$11.5	1.7%
AEP	\$41.8	\$32.2	(\$28.0)	\$0.1	\$46.0	\$218.8	(\$25.8)	(\$2.2)	\$190.7	24.1%
APS	\$37.2	\$22.8	(\$12.6)	\$0.1	\$47.5	\$93.4	(\$11.8)	(\$0.8)	\$80.8	58.8%
ATSI	\$35.8	\$0.6	(\$14.4)	\$0.0	\$22.1	\$115.2	(\$13.2)	(\$1.2)	\$100.8	22.0%
BGE	\$82.8	\$10.7	(\$7.2)	\$0.1	\$86.4	\$56.3	(\$6.6)	(\$0.5)	\$49.2	175.8%
COMED	\$32.4	\$0.0	(\$18.6)	\$0.0	\$13.8	\$174.1	(\$17.0)	(\$1.6)	\$155.5	8.9%
DAY	\$7.3	\$1.0	(\$3.8)	\$0.0	\$4.5	\$27.3	(\$3.5)	(\$0.3)	\$23.4	19.3%
DOM	\$44.6	\$186.9	(\$28.1)	\$0.0	\$203.4	\$193.7	(\$25.9)	(\$2.2)	\$165.7	122.8%
DPL	\$46.7	\$13.2	(\$5.1)	\$0.0	\$54.8	\$54.2	(\$4.8)	(\$0.3)	\$49.2	111.5%
DUKE	\$27.1	\$0.8	(\$5.8)	\$0.2	\$22.3	\$38.4	(\$5.4)	(\$0.5)	\$32.6	68.5%
DUQ	\$6.9	\$0.2	(\$3.0)	\$0.1	\$4.2	\$18.3	(\$2.8)	(\$0.2)	\$15.3	27.6%
EKPC	\$4.7	\$0.0	(\$3.0)	\$0.0	\$1.7	\$21.6	(\$2.8)	(\$0.2)	\$18.6	9.1%
EXT	\$0.4	\$0.0	(\$3.9)	\$0.0	(\$3.5)	\$19.0	(\$3.9)	\$0.0	\$15.1	(23.2)%
JCPLC	\$5.4	\$0.0	(\$6.2)	\$0.0	(\$0.8)	\$37.3	(\$5.8)	(\$0.4)	\$31.1	(2.7)%
MEC	\$13.4	\$0.6	(\$4.8)	\$0.0	\$9.2	\$22.6	(\$4.6)	(\$0.3)	\$17.8	51.4%
OVEC	\$0.0	\$0.0	(\$0.2)	\$0.0	(\$0.2)	\$2.0	(\$0.2)	(\$0.0)	\$1.8	(12.2)%
PE	\$24.6	\$6.2	(\$4.0)	\$0.0	\$26.8	\$28.6	(\$3.8)	(\$0.3)	\$24.6	109.3%
PECO	\$17.0	(\$0.1)	(\$8.8)	\$0.0	\$8.2	\$51.6	(\$8.1)	(\$0.7)	\$42.8	19.1%
PEPCO	\$33.9	\$6.2	(\$6.6)	\$0.0	\$33.5	\$46.6	(\$6.1)	(\$0.5)	\$40.0	83.8%
PPL	\$38.8	\$2.1	(\$8.8)	\$0.0	\$32.2	\$60.0	(\$8.1)	(\$0.7)	\$51.2	62.8%
PSEG	\$47.2	\$0.3	(\$9.7)	\$0.0	\$37.7	\$56.7	(\$9.0)	(\$0.8)	\$47.0	80.4%
REC	\$1.9	\$0.0	(\$0.3)	\$0.0	\$1.5	\$2.6	(\$0.3)	(\$0.0)	\$2.2	68.3%
Total	\$552.4	\$283.7	(\$185.4)	\$0.9	\$651.7	\$1,352.1	(\$171.5)	(\$13.9)	\$1,166.8	55.9%

The total congestion offset paid to loads in the first seven months of the 2024/2025 planning period was 55.9 percent of congestion costs. The results vary significantly by zone. Loads in some zones, like BGE, receive substantially more in offsets than their total congestion payments. Loads in other zones, like COMED, receive substantially less in offsets than their total congestion payments. The offsets are a function of the assignment of ARRs and the valuation of ARRs in the FTR auctions.

<sup>46</sup> See "Constraint Based Congestion Calculations," PJM ARR FTR Market Task Force (July 17, 2020) <<https://www.pjm.com/-/media/committees-groups/task-forces/afmtf/2020/20200722/20200722-item-03a-constraint-based-congestion-calculations.ashx>>.

<sup>47</sup> See 2020 Annual State of the Market Report for PJM, Volume II, Section 11: Congestion and Marginal Losses

The amount and proportion of the offset that can be realized by load serving entities via their ARR allocations varies by planning period. The offsets are a function of the assignment of ARRs relative actual network sources of congestion paid, the valuation of ARRs in the FTR auctions and the congestion revenue from self scheduled ARRs. If the prices for FTRs are high relative to realized congestion, the offset provided by ARR is increased relative to cases where the prices for FTRs are low relative to realized congestion. While the amount of congestion that is returned to the load varies by planning period, PJM's ARR/FTR design has consistently failed to return the congestion revenues to the load that paid it. It is not possible for load to recover all of the congestion that they pay under the current design in which the rights to congestion revenues are assigned based on fictitious contract paths.

## Offset If All ARRs Are Held As ARRs

Table 13-53 shows the total congestion offset that would be available to ARR holders via allocated ARRs, by zone, if the ARR holders held all their allocated ARRs in the 2022/2023, 2023/2024, and the first seven months of the 2024/2025 planning periods and did not self schedule any. If ARR holders held all their allocated ARRs for the first seven months of the 2024/2025 planning period, the ARR Target Allocations would have offset 57.3 percent of the congestion paid by load. However, the offset that would be received by individual zones varies widely, from -12.2 percent for OVEC to 167.9 percent for BGE.

**Table 13-53 Offset available to load if all ARRs are held: 2022/2023 through 2024/2025 planning periods**

	2022/2023 Planning Period				2023/2024 Planning Period				2024/2025 Planning Period*			
	ARR Held TA	Bal+M2M Charges	Congestion +M2M	Offset	ARR Held TA	Bal+M2M Charges	Congestion +M2M	Offset	ARR Held TA	Bal+M2M Charges	Congestion +M2M	Offset
ACEC	\$3.8	(\$6.2)	\$16.3	(14.6%)	\$4.9	(\$3.8)	\$10.8	9.7%	\$2.6	(\$2.3)	\$11.5	2.3%
AEP	\$187.1	(\$79.3)	\$274.1	39.3%	\$185.2	(\$50.4)	\$201.8	66.8%	\$93.2	(\$28.0)	\$190.7	34.2%
APS	\$104.0	(\$31.4)	\$105.8	68.6%	\$85.5	(\$22.4)	\$87.6	72.1%	\$53.9	(\$12.6)	\$80.8	51.1%
ATSI	\$39.6	(\$40.7)	\$133.1	(0.8%)	\$50.3	(\$25.6)	\$99.4	24.8%	\$36.3	(\$14.4)	\$100.8	21.7%
BGE	\$151.5	(\$19.4)	\$68.4	193.2%	\$145.8	(\$12.5)	\$44.4	300.4%	\$89.7	(\$7.2)	\$49.2	167.9%
COMED	\$42.4	(\$56.2)	\$182.5	(7.5%)	\$44.9	(\$31.4)	\$215.9	6.3%	\$32.4	(\$18.6)	\$155.5	8.9%
DAY	\$9.9	(\$10.8)	\$32.4	(2.7%)	\$13.3	(\$6.7)	\$23.7	27.7%	\$8.0	(\$3.8)	\$23.4	17.8%
DOM	\$218.5	(\$85.5)	\$270.1	49.3%	\$642.0	(\$52.0)	\$181.8	324.6%	\$249.1	(\$28.1)	\$165.7	133.4%
DPL	\$95.3	(\$13.7)	\$64.6	126.3%	\$69.6	(\$8.4)	\$51.2	119.7%	\$53.4	(\$5.1)	\$49.2	98.3%
DUKE	\$48.7	(\$16.9)	\$51.7	61.5%	\$52.1	(\$10.3)	\$37.7	110.9%	\$28.8	(\$5.8)	\$32.6	70.5%
DUQ	\$11.2	(\$8.3)	\$18.5	15.8%	\$8.6	(\$5.2)	\$15.1	22.5%	\$7.1	(\$3.0)	\$15.3	26.7%
EKPC	\$6.8	(\$8.4)	\$27.2	(5.6%)	\$6.5	(\$5.7)	\$20.6	4.0%	\$4.7	(\$3.0)	\$18.6	9.1%
EXT	\$0.0	(\$12.7)	\$28.9	(43.8%)	\$1.9	(\$9.6)	\$26.4	(29.1%)	\$0.7	(\$3.9)	\$15.1	(20.9%)
JCPLC	\$7.6	(\$16.3)	\$53.0	(16.4%)	\$4.6	(\$10.4)	\$32.4	(18.1%)	\$5.4	(\$6.2)	\$31.1	(2.7%)
MEC	\$50.1	(\$11.2)	\$32.4	119.6%	\$34.2	(\$6.7)	\$21.8	126.3%	\$14.2	(\$4.8)	\$17.8	52.4%
OVEC	NA	(\$0.5)	\$3.3	(15.4%)	(\$0.0)	(\$0.4)	\$2.1	(19.1%)	\$0.0	(\$0.2)	\$1.8	(12.2%)
PE	\$28.5	(\$10.8)	\$35.3	50.2%	\$22.2	(\$6.5)	\$28.3	55.6%	\$29.2	(\$4.0)	\$24.6	102.5%
PECO	\$36.6	(\$24.0)	\$74.9	16.8%	\$21.2	(\$14.9)	\$42.3	14.8%	\$17.5	(\$8.8)	\$42.8	20.3%
PEPCO	\$76.3	(\$17.9)	\$61.0	95.8%	\$65.4	(\$11.6)	\$38.3	140.7%	\$38.2	(\$6.6)	\$40.0	79.1%
PPL	\$151.0	(\$28.2)	\$83.7	146.6%	\$80.0	(\$15.6)	\$57.9	111.2%	\$39.9	(\$8.8)	\$51.2	60.8%
PSEG	\$103.5	(\$27.1)	\$75.4	101.4%	\$69.3	(\$16.4)	\$50.3	105.0%	\$47.6	(\$9.7)	\$47.0	80.5%
REC	\$0.9	(\$0.9)	\$4.5	(1.0%)	\$2.7	(\$0.6)	\$2.2	98.8%	\$1.8	(\$0.3)	\$2.2	65.8%
Total	\$1,373.4	(\$526.4)	\$1,697.1	49.9%	\$1,610.1	(\$327.0)	\$1,291.9	99.3%	\$853.6	(\$185.4)	\$1,166.8	57.3%

\* First seven months of the 2024/2025 planning period

## Offset If All ARRs Are Self Scheduled

Table 13-54 shows the total congestion offset that would be available to ARR holders via allocated ARRs, by zone, if the ARR holders self scheduled all their ARRs received in the annual auction process as FTRs in the 2022/2023, 2023/2024, and the first seven months of the 2024/2025 planning periods. Market rules allow ARRs available in the annual auction process to be self scheduled as FTRs. Any ARRs awarded monthly as residual ARRs cannot be self scheduled but provide ARR revenue based on monthly auction results. The calculated self scheduled FTR target allocations assume a 100 percent payout ratio. Residual ARRs cannot be self scheduled and are included in addition to the self scheduled FTR target allocations. If ARR holders had self scheduled all their allocated ARRs to FTRs for the first seven months of the 2024/2025 planning period, the ARR Target Allocations would have offset 72.4 percent of the congestion paid by load. The results show that the recovery of congestion varies significantly by zone and that

the load in some zones recovers more than the congestion paid and the load in other zones recovers less. This result is not consistent with a rational FTR/ARR design under which all load would be returned their congestion, but no more and no less.

**Table 13-54 Offset available to load if all ARR self scheduled: 2022/2023 through 2024/2025 planning periods**

	22/23 Planning Period					23/24 Planning Period					24/25 Planning Period*				
	Residual SS FTR	ARR Credits	Bal+M2M Charges	+M2M	Congestion Offset	Residual SS FTR	ARR Credits	Bal+M2M Charges	+M2M	Congestion Offset	Residual SS FTR	ARR Credits	Bal+M2M Charges	+M2M	Congestion Offset
ACEC	\$3.0	\$0.0	(\$6.2)	\$16.3	(19.6%)	\$4.5	\$0.0	(\$3.8)	\$10.8	6.6%	\$0.2	\$0.0	(\$2.3)	\$11.5	(18.4%)
AEP	\$208.7	\$1.0	(\$79.3)	\$274.1	47.6%	\$101.4	\$3.2	(\$50.4)	\$201.8	26.8%	\$91.5	\$1.8	(\$28.0)	\$190.7	34.2%
APS	\$70.4	\$7.9	(\$31.4)	\$105.8	44.3%	\$77.5	\$0.6	(\$22.4)	\$87.6	63.5%	\$70.7	\$1.9	(\$12.6)	\$80.8	74.3%
ATSI	\$84.8	\$0.7	(\$40.7)	\$133.1	33.7%	\$84.3	\$0.1	(\$25.6)	\$99.4	59.1%	\$50.1	\$0.1	(\$14.4)	\$100.8	35.5%
BGE	\$194.0	\$0.0	(\$19.4)	\$68.4	255.2%	\$190.3	\$0.0	(\$12.5)	\$44.4	400.6%	\$132.0	\$0.1	(\$7.2)	\$49.2	254.1%
COMED	\$31.1	\$0.5	(\$56.2)	\$182.5	(13.5%)	\$83.0	\$0.0	(\$31.4)	\$215.9	23.9%	\$74.2	\$0.0	(\$18.6)	\$155.5	35.8%
DAY	\$11.4	\$0.0	(\$10.8)	\$32.4	1.8%	\$12.3	\$0.2	(\$6.7)	\$23.7	24.4%	\$11.7	\$0.5	(\$3.8)	\$23.4	35.9%
DOM	\$663.2	\$19.2	(\$85.5)	\$270.1	221.0%	\$292.8	\$0.5	(\$52.0)	\$181.8	132.8%	\$253.2	\$1.7	(\$28.1)	\$165.7	136.9%
DPL	\$56.2	\$1.0	(\$13.7)	\$64.6	67.3%	\$87.8	\$0.0	(\$8.4)	\$51.2	155.3%	\$80.2	\$0.5	(\$5.1)	\$49.2	153.6%
DUKE	\$81.4	\$0.0	(\$16.9)	\$51.7	124.7%	\$55.8	\$0.0	(\$10.3)	\$37.7	120.8%	\$20.8	\$0.1	(\$5.8)	\$32.6	46.3%
DUQ	\$15.0	\$0.0	(\$8.3)	\$18.5	36.5%	\$19.7	\$0.0	(\$5.2)	\$15.1	96.3%	\$10.9	\$0.0	(\$3.0)	\$15.3	51.6%
EKPC	\$13.0	\$0.0	(\$8.4)	\$27.2	17.3%	\$8.7	\$0.0	(\$5.7)	\$20.6	14.4%	\$2.7	\$0.4	(\$3.0)	\$18.6	0.9%
EXT	NA	\$0.0	(\$12.7)	\$28.9	(43.8%)	\$1.3	\$0.0	(\$9.6)	\$26.4	(31.4%)	\$0.5	\$0.0	(\$3.9)	\$15.1	(22.5%)
JCPCLC	\$5.3	\$0.0	(\$16.3)	\$53.0	(20.8%)	\$6.1	\$0.0	(\$10.4)	\$32.4	(13.3%)	\$2.6	\$0.1	(\$6.2)	\$31.1	(11.3%)
MEC	\$46.5	\$0.0	(\$11.2)	\$32.4	108.7%	\$5.4	\$0.0	(\$6.7)	\$21.8	(6.3%)	\$7.0	\$0.2	(\$4.8)	\$17.8	13.1%
OVEC	NA	\$0.0	(\$0.5)	\$3.3	(15.4%)	(\$0.0)	\$0.0	(\$0.4)	\$2.1	(18.0%)	(\$0.0)	\$0.0	(\$0.2)	\$1.8	(12.2%)
PE	\$20.5	\$0.2	(\$10.8)	\$35.3	28.3%	\$46.0	\$0.0	(\$6.5)	\$28.3	139.5%	\$60.8	\$0.0	(\$4.0)	\$24.6	231.1%
PECO	\$6.8	\$0.0	(\$24.0)	\$74.9	(22.8%)	\$29.0	\$0.0	(\$14.9)	\$42.3	33.4%	(\$0.8)	\$0.0	(\$8.8)	\$42.8	(22.4%)
PEPCO	\$95.2	\$0.0	(\$17.9)	\$61.0	126.7%	\$73.3	\$0.0	(\$11.6)	\$38.3	161.4%	\$53.4	\$0.1	(\$6.6)	\$40.0	117.2%
PPL	\$117.4	\$0.0	(\$28.2)	\$83.7	106.4%	\$37.1	\$0.0	(\$15.6)	\$57.9	37.1%	\$64.6	\$0.4	(\$8.8)	\$51.2	109.8%
PSEG	\$48.7	\$0.4	(\$27.1)	\$75.4	29.1%	\$49.3	\$0.0	(\$16.4)	\$50.3	65.3%	\$33.4	\$0.0	(\$9.7)	\$47.0	50.4%
REC	\$0.8	\$0.0	(\$0.9)	\$4.5	(4.2%)	\$3.7	\$0.0	(\$0.6)	\$2.2	143.6%	\$2.5	\$0.0	(\$0.3)	\$2.2	96.5%
Total	\$1,773.4	\$31.0	(\$526.4)	\$1,697.1	75.3%	\$1,269.4	\$4.5	(\$327.0)	\$1,291.9	73.3%	\$1,022.1	\$8.0	(\$185.4)	\$1,166.8	72.4%

\* First seven months of the 2024/2025 planning period

## ARR Allocation and Congestion In and Out of Zone

Table 13-55 shows the share of ARR MW for the 2023/2024 and 2024/2025 planning period with paths that source inside and outside the zone where the ARR load is located (see Table 13-4) and the proportion of congestion that results from constraints that are inside and outside the zone. Table 13-55 allows a comparison of externally sourced ARRs with the congestion that results from external constraints. For example, 97.1 percent of ACEC congestion in the first seven months of 2024/2025 results from constraints that are outside of the zone, but only 55.1 percent of ACEC ARRs originate outside the zone for the 2024/2025 planning period ARR allocations.

Table 13-55 illustrates one of the fundamental issues with the contract path based approach to ARR/FTR design. In the PJM market, which operates as an integrated network, a significant proportion of congestion results from constraints that are not in the same zone as load, but the assignment of ARRs is inconsistent with that fact. This inconsistency makes it impossible for load to match ARRs with the actual sources of congestion.

**Table 13–55 ARR Allocation and Congestion from inside and outside zone: 2023/2024 and 2024/2025 planning period**

	2023/2024 ARRs		2023/2024 Congestion		2024/2025 ARRs		2024/2025 Congestion*	
	Out of Zone	In Zone	Out of Zone	In Zone	Out of Zone	In Zone	Out of Zone	In Zone
ACEC	49.1%	50.9%	97.2%	2.8%	55.1%	44.9%	97.1%	2.9%
AEP	10.1%	89.9%	89.1%	10.9%	9.4%	90.6%	83.7%	16.3%
APS	17.3%	82.7%	96.2%	3.8%	15.9%	84.1%	94.1%	5.9%
ATSI	33.2%	66.8%	95.8%	4.2%	35.1%	64.9%	94.8%	5.2%
BGE	38.0%	62.0%	86.5%	13.5%	39.9%	60.1%	84.6%	15.4%
COMED	0.0%	100.0%	58.6%	41.4%	0.1%	99.9%	70.2%	29.8%
DAY	87.2%	12.8%	100.0%	0.0%	92.6%	7.4%	100.0%	0.0%
DOM	0.4%	99.6%	87.8%	12.2%	2.0%	98.0%	69.5%	30.5%
DPL	23.2%	76.8%	61.9%	38.1%	26.0%	74.0%	35.3%	64.7%
DUKE	45.0%	55.0%	94.6%	5.4%	49.1%	50.9%	95.4%	4.6%
DUQ	96.2%	3.8%	99.8%	0.2%	97.0%	3.0%	96.1%	3.9%
EKPC	100.0%	0.0%	99.8%	0.2%	100.0%	0.0%	98.9%	1.1%
EXT	100.0%	0.0%	94.4%	5.6%	100.0%	0.0%	97.8%	2.2%
JCPL	34.6%	65.4%	97.9%	2.1%	58.9%	41.1%	95.1%	4.9%
OVEC	38.8%	61.2%	80.0%	20.0%	38.7%	61.3%	55.4%	44.6%
MEC	100.0%	0.0%	91.1%	8.9%	66.7%	0.0%	93.8%	6.2%
PE	16.2%	83.8%	86.2%	13.8%	24.6%	75.4%	77.7%	22.3%
PECO	21.6%	78.4%	90.2%	9.8%	6.9%	93.1%	88.1%	11.9%
PEPCO	47.2%	52.8%	99.8%	0.2%	46.9%	53.1%	99.6%	0.4%
PPL	2.6%	97.4%	92.0%	8.0%	5.8%	94.2%	83.8%	16.2%
PSEG	47.8%	52.2%	99.2%	0.8%	54.6%	45.4%	100.0%	-0.0%
REC	100.0%	0.0%	83.4%	16.6%	100.0%	0.0%	72.4%	27.6%
Total	22.1%	77.9%	85.6%	14.4%	22.4%	77.6%	82.6%	17.4%

\*first seven months of the 2024/2025 planning period for congestion

## Credit

There were no collateral defaults and one payment default that was promptly cured in 2024.

On December 21, 2021, PJM submitted a change to the credit rules to FERC.<sup>48</sup> PJM proposed to replace the current credit calculation, which is largely based on a weighted average historical FTR value, with an initial margin based on a risk confidence interval from an Historical Simulation Initial Margining (HSIM) analysis model. PJM's proposal included the use of a 97 percent confidence interval, meaning a 97 percent probability that the initial margin collected would cover potential default costs.

On February 28, 2022, FERC rejected PJM's filing recommending a 97 percent confidence interval because the record did not support 97 percent.<sup>49</sup> FERC instituted a Section 206 proceeding, but recognized that PJM could propose revisions through a Section 205 filing. On June 3, 2022, PJM submitted the same change to the credit rules as the December 21, 2021, filing to FERC.<sup>50</sup> The June 3, 2022, filing included a cost benefit analysis for the proposed use of a 97 percent confidence interval compared to the use of a 99 percent confidence interval. The MMU objected to PJM's filing and proposed a 99 percent confidence interval, with a transition to a 100 percent confidence interval.<sup>51</sup> On September 21, 2023, FERC directed PJM to use a 99 percent confidence level in the HSIM model.<sup>52</sup>

The most fundamental point is that if costs are shifted from FTR buyers to other market participants, no logical cost-benefit analysis can show that the other market participants benefit in any way. Under the current default rules, the cost of default is socialized to all market participants, not just those participating in the FTR market. The 99 percent confidence interval places more of the risk where it belongs, on the FTR market participants that are engaged in the risky behavior, than the 97 percent confidence interval. The goal of internalizing as much of the risk to the FTR participants as possible, where it belongs, could be more directly addressed either by using 100 percent or by directly

48 See "Revisions to PJM's FTR Credit Requirement and Request for 28-Day Comment Period," Docket No. ER22-000 (December 21, 2021).

49 See 178 FERC ¶ 61,146.

50 See "Revisions to PJM's FTR Credit Requirement," Docket No. ER22-2029-000 (June 3, 2022).

51 See Comments of the Independent Market Monitor for PJM, Docket No. ER22-2029-000 et al. (October 31, 2022).

52 See 184 FERC ¶ 61,168.

assigning the risk to those in the FTR market rather than all market participants.

## Treatment of Defaulted Portfolios

Under the method applied to the GreenHat default, when an FTR participant defaults on their positions, their portfolio remains in the FTR market and continues to accrue revenues and/or charges and must be reconciled. Under this method, PJM leaves the participant's positions unchanged, lets the positions settle at day-ahead prices, and charges any net losses to the default allocation assessment. This method exposes all members in PJM to an uncertain charge for the default allocation assessment that will not be known until those FTRs settle.

The MMU recommends that the defaulted FTRs be canceled rather than holding or liquidating them.<sup>53</sup> Canceling the FTRs would release the FTRs to the FTR market. The market would then decide the value of the capacity released and the timing of its release. There would be no discretion necessary to settle the defaulted position and the losses would be contained within the ARR/FTR market.

Cancellation of a defaulting portfolio does not change congestion. Cancellation of a defaulting portfolio can affect ARR/FTR funding as a result of changes in auction revenue, changes in the net target allocations, and potential simultaneous feasibility violations, while any collateral collected from the defaulted participant is available to offset losses from the cancelled FTRs. However, PJM can and does address similar issues routinely. PJM has tools available, such as the counter flow buyback and Stage 1A over allocation rules, and uses them regularly in the Annual FTR Auction, to improve funding as well as address feasibility concerns. Cancellation of FTRs would isolate the costs of the default to those participating in and benefitting from the FTR market.

<sup>53</sup> See Comments of the Independent Market Monitor for PJM, Docket No. ER18-2068-000 (August 16, 2018).

## FTR Forfeitures

By order issued January 19, 2017, the Commission determined that the FTR forfeiture rule is just and reasonable and "...serves to deter such manipulation" related to virtual transaction cross product manipulation.<sup>54</sup> The Commission identified four main tenets with which the Forfeiture Rule must comply, including that it: deter manipulation, provide transparency allowing participants to modify their behavior, base forfeitures on an individual participant's actions and is not punitive.<sup>55</sup>

The point of the FTR forfeiture rule is to avoid an inefficient and costly market power mitigation process and to establish an objective rule that prevents manipulation of the FTR market. The FTR forfeiture rule is designed to remove the incentive to engage in manipulation. The rule does not result in findings of manipulation.<sup>56</sup>

The FTR forfeiture rule considers the impact of a participant's net virtual transaction portfolio on all constraints.<sup>57</sup> If a participant's net virtual portfolio impacts a constraint by the greater of 0.1 MW or 10 percent or more of the constraint line limit, and that constraint affects an individual FTR's target allocation by \$0.01 or more, the participant's net virtual portfolio increased the value of the FTR, and the FTR is subject to FTR forfeiture. The FTR forfeiture also requires that congestion on the FTR path in the day ahead market be greater than congestion on that path in the real time market.

The FTR forfeiture rule does not require FTR holders to pay penalties. The FTR forfeiture rule does not affect the profits or losses of virtual activity. The FTR forfeiture rule, if triggered by a participant's virtual portfolio, results in forfeiting only FTR profits and only in the specific hours for which the rule is violated. The profit is calculated as the hourly FTR target allocation minus the FTR's hourly cost. Even when FTR profits are forfeited, the value that the buyer assigned to congestion in the FTR auction (the price paid) is not affected. For example, if a buyer paid \$5.00/MWh for congestion and congestion was \$5.00/MWh, the forfeiture would be zero. If congestion were \$7.00/MWh, the forfeiture

<sup>54</sup> See 158 FERC ¶ 61,038 at P 33 (2017).

<sup>55</sup> See *id.* at P 62.

<sup>56</sup> See "Protest and Motion for Rejection of the Independent Market Monitor for PJM," Docket No. EL20-41 (June 1, 2020).

<sup>57</sup> A modified FTR forfeiture rule was implemented effective January 19, 2017. See 2019 *Annual State of the Market Report for PJM*, Volume II, Section 13: Financial Transmission Rights for the full history.



would be \$2.00/MWh. Market participants understand the relationship between FTR and virtual positions in detail and can avoid violating the FTR forfeiture rule if they choose to do so.

The FTR forfeiture rule is less effective than initially intended as a result of the element of the rule requiring that day-ahead congestion on the FTR path be greater than real-time congestion the same path. As a result of model differences, there is a significant opportunity for virtual participants to profit from differences between day-ahead and real-time prices without driving the prices together, termed false arbitrage. As a result, FTR holders can use virtual positions to make their FTR positions more valuable without violating the rule.

The FTR forfeiture rule has not reduced participation in the PJM FTR market or participation in virtual activity. There has been an increase in the number of participants in the FTR market since the implementation of the new FTR forfeiture rule, and a decrease in the number of participants with forfeitures.

On June 24, 2019, PJM implemented a new method to calculate the hourly cost of an FTR only for hours in which it is effective.<sup>58</sup> Beginning with the September 2019 bill, PJM began billing using the correct hourly cost calculation. For the 2020/2021 planning period, total FTR forfeitures were \$4.6 million.

On May 20, 2021, FERC issued an order ruling the \$0.01 definition of an increase in the value of an FTR unjust and unreasonable, but upheld the other parts of PJM's forfeiture rule.<sup>59</sup> In this order, FERC required PJM to modify the FTR forfeiture rule and submit a compliance filing. As a result, there was no FTR forfeiture rule in place from May 21, 2021 until February 1, 2022. These months have zero forfeiture in Figure 13-21.


On June 21, 2021, PJM filed a request for clarification, or alternatively rehearing.<sup>60</sup> PJM asked that FERC clarify the status of the forfeitures that were assessed over the four years between the initial FERC order for a compliance filing, and their order rejecting PJM's compliance filing. On July 19, 2021, PJM made a compliance filing to address FERC's concerns with the \$0.01 element of the FTR forfeiture rule.<sup>61</sup> PJM's compliance filing eliminated

that element and replaced it with a constraint based FTR forfeiture. The forfeiture is based on the increased value of each constraint that violates the rule, determined by the shadow price multiplied by the net dfax on that constraint. This change meets FERC's previously established criteria established under the initial FERC order and creates a more precise FTR forfeiture value, to meet the criteria established under the new FERC order.

On January 31, 2022, FERC accepted PJM's July 19, 2021 compliance filing to implement FTR forfeitures using a constraint based method, effective February 1, 2022.<sup>62</sup>

Figure 13-21 shows the monthly FTR forfeitures under the FTR forfeiture rules in effect from January 19, 2017, through December 31, 2024. As required by the FERC order, PJM began retroactively billing FTR forfeitures with the September 2017 bill. In the period from January 2017 through September 2017, participants did not have good information about the level of their FTR forfeitures, so they could not accurately modify their bidding behavior to avoid FTR forfeitures. After September 2017, FTR forfeitures decreased significantly, and stabilized, as participants received information on their FTR forfeitures. Calculations of forfeitures under the new constraint specific rule from February 1, 2022, through December 31, 2024, are included in Figure 13-21.

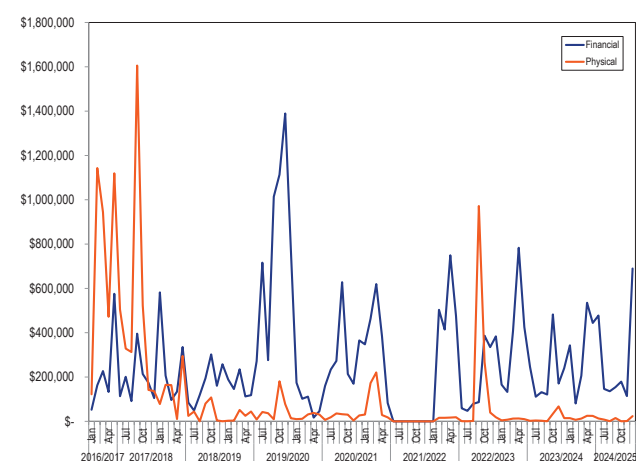**Figure 13-21 Monthly FTR forfeitures for physical and financial participants: January 2017 through December 2024**



58 See "Minor modification to Tariff Language for FTR Forfeiture Rule," Docket No. ER19-2240 (June 24, 2019).

59 See 175 FERC ¶ 61,137 (2021).

60 See Request for Clarification or, in the Alternative, Rehearing of PJM Interconnection, LLC, FERC Docket No. ER17-1433-000 (June 21, 2021).

61 See "FTR Forfeiture Rule Compliance Filing," FERC Docket No. ER17-1433 (July 19, 2021).

62 See 178 FERC ¶ 61,079, *reh'g denied*, 179 FERC ¶ 61,010 (2022), *affirmed*, *XO Energy MA, LPC, et al. v. FERC*, Case No. 22-1096 (D.C. Cir. January 24, 2023), *affirmed en banc*, *XO Energy MA, LPC, et al. v. FERC*, Case No. 22-1096 (D.C. Cir. September 13, 2023).

