

Financial Transmission and Auction Revenue Rights

In an LMP market, the lowest cost generation is dispatched to meet the load, subject to the ability of the transmission system to deliver that energy. When the lowest cost generation is remote from load centers, the physical transmission system permits that lowest cost generation to be delivered to load. This was true prior to the introduction of LMP markets and continues to be true in LMP markets. Prior to the introduction of LMP markets, contracts based on the physical rights associated with the transmission system were the mechanism used to provide for the delivery of low cost generation to load. Firm transmission customers who paid for the transmission system through rates were the beneficiaries of the system through access to low cost energy via the transmission system.

After the introduction of LMP markets, financial transmission rights (FTRs) permitted the loads which pay for the transmission system to continue to receive those benefits in the form of revenues which offset congestion to the extent permitted by the transmission system.¹ Financial transmission rights and the associated revenues were directly provided to loads in recognition of the fact that loads pay for the transmission system which permits low cost generation to be delivered to load and that load pays the constrained price which creates the funds available to offset congestion costs in an LMP market.^{2,3} It is load overpayment for generation in an LMP system that is the source of revenues for FTR funding. FTRs are simply a mechanism to return the overpayment to load.

The *2013 Quarterly State of the Market Report for PJM: January through September*, focuses on the Monthly Balance of Planning Period FTR Auctions during the 2013 to 2014 planning period, which covers June 1, 2013, through September 30, 2013.

¹ See 81 FERC ¶ 61,257, at 62,241 (1997).

² See *Id.* at 62, 259–62,260 & n. 123.

³ For a more complete explanation, see the *2012 State of the Market Report for PJM*, Volume II, Section 12, "FTRs."

Table 13–1 The FTR Auction Markets results were competitive

Market Element	Evaluation	Market Design
Market Structure	Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Effective

- Market structure was evaluated as competitive because the FTR auction is voluntary and the ownership positions resulted from the distribution of ARRs and voluntary participation.
- Participant behavior was evaluated as competitive because there was no evidence of anti-competitive behavior.
- Market performance was evaluated as competitive because it reflected the interaction between participant demand behavior and FTR supply, limited by PJM's analysis of system feasibility.
- Market design was evaluated as mixed because while there are many positive features of the FTR design including a wide range of options for market participants to acquire FTRs and a competitive auction mechanism, there are several features of the FTR design which result in underfunding and features of the FTR design which incorporate subsidies which also contribute to underfunding. The market design incorporates widespread cross subsidies which are not consistent with an efficient market design.

Overview

Financial Transmission Rights

Market Structure

- **Supply.** Market participants can also sell FTRs. In the Monthly Balance of Planning Period FTR Auctions for the 2013 to 2014 planning period through September 30, 2013, total participant FTR sell offers were 2,334,947 MW, up from 2,217,995 MW for the same period during the 2012 to 2013 planning period.
- **Demand.** The total FTR buy bids from the Monthly Balance of Planning Period FTR Auctions for the 2013 to 2014 planning period increased 5.9

percent from 9,223,203 MW for the first four months of the prior planning period, to 9,765,083 MW.

- **Patterns of Ownership.** For the Monthly Balance of Planning Period Auctions, financial entities purchased 75.6 percent of prevailing flow and 85.7 percent of counter flow FTRs for January through September of 2013. Financial entities owned 62.2 percent of all prevailing and counter flow FTRs, including 53.4 percent of all prevailing flow FTRs and 79.4 percent of all counter flow FTRs during the January through September 2013 period.

Market Behavior

- **FTR Forfeitures.** Total forfeitures of FTR profits resulting from the FTR forfeiture rule for the 2013 to 2014 planning period, through August 2013, were \$440,526 for Increment Offers and Decrement Bids.
- **Credit Issues.** Eight participants defaulted in 2013, through August, from twelve default events. The average of these defaults was \$320,125 with nine based on inadequate collateral and three based on nonpayment. The average collateral default was \$377,579 and the average nonpayment default was \$147,761. The majority of these defaults were promptly cured, with one partial cure. These defaults were not necessarily related to FTR positions.

Market Performance

- **Volume.** For the 2013 to 2014 planning period, through September 2013, the Monthly Balance of Planning Period FTR Auctions cleared 1,308,752 MW (13.4 percent) of FTR buy bids and 443,885 MW (19.0 percent) of FTR sell offers.
- **Price.** The weighted average buy bid FTR price in the Monthly Balance of Planning Period FTR Auctions for the 2013 to 2014 planning period, through September 2013, was \$0.07, down from \$0.11 per MW for the same time period in the 2012 to 2013 planning period.

- **Revenue.** The Monthly Balance of Planning Period FTR Auctions generated \$7.3 million in net revenue for all FTRs for the first four months of the 2013 to 2014 planning period, down from \$11.9 million for the same time period in the 2012 to 2013 planning period.
- **Revenue Adequacy.** FTRs were paid at 67.8 percent of the target allocation for the entire 2012 to 2013 planning period. FTRs were paid at 77.3 percent of the target allocation level for the first four months of the 2013 to 2014 planning period. Congestion revenues are allocated to FTR holders based on FTR target allocations. PJM collected \$287.4 million of FTR revenues during the 2013 to 2014 planning period through September 30, 2013 and \$614.0 million during the 2012 to 2013 planning period.

For the 2013 to 2014 planning period, the top sink and top source with the highest positive FTR target allocations were Dominion Zone and Northern Illinois Hub. Similarly, the top sink and top source with the largest negative FTR target allocations were Vienna and Western Hub.

- **Profitability.** FTR profitability is the difference between the revenue received for an FTR and the cost of the FTR. The cost of self-scheduled FTRs is zero in the FTR profitability calculation. FTRs were profitable overall, with \$138.8 million in profits for physical entities, of which \$134.0 million was from self-scheduled FTRs, and \$132.1 million for financial entities. As shown in Table 13-9, not every FTR was profitable. For example, prevailing flow FTRs purchased by physical entities, but not self-scheduled, were not profitable in March 2013.

Auction Revenue Rights

Market Structure

- **Residual ARRs.** Effective August 1, 2012, PJM is required to offer ARRs to eligible participants when a transmission outage was modeled in the Annual ARR Allocation, but the facility becomes available during the relevant planning year. These ARRs are automatically assigned the month before the effective date and only available on paths prorated in Stage 1 of the Annual ARR Allocation. Residual ARRs are only effective for single, whole months, cannot be self scheduled and their clearing

prices are based on monthly FTR auction clearing prices. For the 2013 to 2014 planning period, through September 2013, PJM allocated a total of 11,586.4 MW of residual ARRs with a total target allocation of \$3.3 million.

- **ARR Reassignment for Retail Load Switching.** There were 25,157 MW of ARRs associated with approximately \$125,800 of revenue that were reassigned in the first four months of the 2013 to 2014 planning period.

Market Performance

- **Revenue Adequacy.** For the first four months of the 2013 to 2014 planning period, the ARR target allocations were \$503.4 million while PJM collected \$559.0 million from the combined Long Term, Annual and Monthly Balance of Planning Period FTR Auctions, making ARRs revenue adequate. For the 2012 to 2013 planning period, the ARR target allocations were \$565.4 million while PJM collected \$614.8 million from the combined Long Term, Annual and Monthly Balance of Planning Period FTR Auctions, making ARRs revenue adequate for that period.
- **ARRs and FTRs as an Offset to Congestion.** The effectiveness of ARRs as an offset to congestion can be measured by comparing the revenue received by ARR holders to the congestion costs experienced by these ARR holders in the Day-Ahead Energy Market and the balancing energy market. For the 2013 to 2014 planning period through September 30, 2013, the total revenues received by ARR holders, including self-scheduled FTRs, offset 85.5 percent of the congestion costs experienced by these ARR holders in the Day-Ahead Energy Market and the balancing energy market. For the 2012 to 2013 planning period, the total revenues received by the holders of all ARRs and FTRs offset more than 92.6 percent of the total congestion costs within PJM and for the 2011 to 2012 planning period 88.9 percent.

Recommendations

- Report correct monthly payout ratios to reduce overstatement of underfunding problem on a monthly basis.

- Eliminate portfolio netting to eliminate cross subsidies across FTR marketplace participants.
- Eliminate subsidies to counter flow FTR holders by treating them comparably to prevailing flow FTR holders when the payout ratio is applied.
- Eliminate cross geographic subsidies.
- Improve transmission outage modeling in the FTR auction models.
- Reduce FTR sales on paths with persistent underfunding including clear rules for what defines persistent underfunding and how the reduction will be applied.
- Implement a seasonal ARR and FTR allocation system to better represent outages.
- Eliminate over allocation requirement of ARRs in the Annual ARR Allocation process.
- Apply the FTR forfeiture rule to up to congestion transactions consistent with the application of the FTR forfeiture rule to increment offers and decrement bids.

Conclusion

The annual ARR allocation provides firm transmission service customers with the financial equivalent of physically firm transmission service, without requiring physical transmission rights that are difficult to define and enforce. The fixed charges paid for firm transmission services result in the transmission system which provides physically firm transmission service. With the creation of ARRs, FTRs no longer serve their original function of providing firm transmission customers with the financial equivalent of physically firm transmission service. ARRs now serve that function. FTR holders, with the creation of ARRs, do not have the right to financially firm transmission service and FTR holders do not have the right to revenue adequacy. In the PJM model, FTRs are a financial product that PJM makes available when excess transmission capability permits.

Revenue adequacy has received a lot of attention in the PJM FTR market. There are several factors that can affect the reported, distribution of and quantity of funding in the FTR market. Revenue adequacy is misunderstood. FTR holders, with the creation of ARRs, do not have the right to financially firm transmission service and FTR holders do not have the right to revenue adequacy. ARR holders do have those rights based on their payment for the transmission system. FTR holders appropriately receive revenues based on actual congestion in both day-ahead and real-time markets. When day-ahead congestion differs significantly from real-time congestion, as has occurred only recently, this is evidence that there are reporting issues, cross subsidization issues, issues with the level of FTRs sold, and issues with modeling differences between the day-ahead and real time. Such differences are not an indication that FTR holders are being underallocated total congestion dollars.

The market response to the revenue adequacy issue has been to reduce bid prices and to increase bid volumes and offer volumes. Clearing prices have fallen and cleared quantities have increased.

In the 2010 to 2011 planning period the clearing price for an FTR obligation was \$0.71 per MW, and in the 2013 to 2014 planning period the clearing price was \$0.30 per MW, a 57.7 percent decrease. In the 2010 to 2011 planning period, the clearing price for FTR Obligation sell offers was \$0.22 per MW, and in the 2013 to 2014 planning period was \$0.05 per MW for, a 340 percent decrease.

The volume of cleared buy bids and self-scheduled bids in the Annual FTR Auctions increased from 287,294 MW in the 2010 to 2011 planning period to 420,489 MW in the 2013 to 2014 planning period, an increase of 133,095 MW or 115.9 percent. The volume of cleared sell offers increased from 10,315 MW in the 2010 to 2011 planning period to 37,821 MW in the 2013 to 2014 planning period, an increase of 266.7 percent.

In June 2010, which includes the Annual, Long Term and monthly auctions, the bid volume was 3,894,566 MW, with a net bid volume of 3,177,131 MW. The net bid volume is the buy bid volume minus the sell bid volume. In June

2013 the bid volume was 7,909,805 MW (a 103.1 percent increase) and the net bid volume was 6,607,570 MW (a 108.0 percent increase). The net bid volume to bid volume ratio in June 2010 was 0.82, while the ratio was 0.84 in June 2013, indicating a slight increase in the ratio of sell offers to buy bids.

The monthly payout ratio reported by PJM is understated. The PJM reported monthly payout ratio does not appropriately consider negative target allocations as a source of revenue to fund FTRs on a monthly basis. PJM's reported monthly payout ratios are based on an estimate of the results for the entire year. The reported monthly payout ratio should be the actual monthly results including all revenue. The MMU recommends that the calculation of the monthly FTR payout ratio appropriately include negative target allocations as a source of revenue, consistent with actual settlement payout.

FTR target allocations are currently netted within each organization in each hour. This means that within an hour, positive and negative target allocations within an organization's portfolio are offset prior to the application of the payout ratio to the positive target allocation FTRs. The payout ratios are also calculated based on these net FTR positions. The current method requires those participants with fewer negative target allocation FTRs to subsidize those with more negative target allocation FTRs. The current method treats a positive target allocation FTR differently depending on the portfolio of which it is a part. The correct method would treat all FTRs with positive target allocations exactly the same, which would eliminate this form of cross subsidy. This should also be extended to include the end of planning period FTR uplift calculation. The net of a participant's portfolio should not determine their FTR uplift liability, rather their portion of total positive target allocations should be used to determine a participant's uplift charge.

If netting within portfolios were eliminated and the payout ratio were calculated correctly, the payout ratio in the 2012 to 2013 planning period would have been 84.6 percent instead of the reported 67.8 percent. The MMU recommends that netting of positive and negative target allocations within portfolios be eliminated.

The current rules create an asymmetry between the treatment of counter flow and prevailing flow FTRs. Counter flow FTR holders make payments over the planning period, in the form of negative target allocations. These negative target allocations are paid at 100 percent regardless of whether positive target allocation FTRs are paid at less than 100 percent.

There is no reason to treat counter flow FTRs more favorably than prevailing flow FTRs. Counter flow FTRs should also be affected when the payout ratio is less than 100 percent. This would mean that counter flow FTRs would pay back an increased amount that mirrors the decreased payments to prevailing flow FTRs. The adjusted payout ratio would evenly divide the burden of underfunding among counter flow FTR holders and prevailing flow FTR holders by increasing negative counter flow target allocations by the same amount it decreases positive target allocations.

The result of removing portfolio netting and applying a payout ratio to counter flow FTRs would increase the calculated payout ratio in the 2012 to 2013 planning period from the reported 67.8 percent to 88.6 percent. The MMU recommends that counter flow and prevailing flow FTRs should be treated symmetrically with respect to the application of a payout ratio.

In addition to addressing these issues, the approach to the question of FTR funding should also look at the fundamental reasons that there has been a significant and persistent difference between day-ahead and balancing congestion. These reasons include the inadequate transmission outage modeling in the FTR auction model which ignores all but long term outages known in advance; the different approach to transmission line ratings in the day-ahead and real time markets, including reactive interfaces, which directly results in differences in congestion between day ahead and real time markets; differences in day-ahead and real time modeling including the treatment of loop flows, the treatment of outages, the modeling of PARs and the nodal location of load, which directly results in differences in congestion between day ahead and real time markets; the overallocation of ARRs which directly results in underfunding; the appropriateness of seasonal ARR allocations to better match actual market conditions with the FTR auction model; geographic

subsidies from the holders of positively valued FTRs in some locations to the holders of consistently negatively valued FTRs in other locations; the contribution of up-to congestion transactions to FTR underfunding; and the continued sale of FTR capability on persistently underfunded pathways. The MMU recommends that these issues be reviewed and modifications implemented. Regardless of how these issues are addressed, funding issues that persist as a result of modeling differences and flaws in the design of the FTR market should be borne by FTR holders operating in the voluntary FTR market and not imposed on load through the mechanism of balancing congestion.

Financial Transmission Rights

FTRs are financial instruments that entitle their holders to receive revenue or require them to pay charges based on locational congestion price differences in the Day-Ahead Energy Market across specific FTR transmission paths, subject to revenue availability. Effective June 1, 2007, PJM added marginal losses as a component in the calculation of LMP.⁴ The value of an FTR reflects the difference in congestion prices rather than the difference in LMPs, which includes both congestion and marginal losses. Auction market participants are free to request FTRs between any pricing nodes on the system, including hubs, control zones, aggregates, generator buses, load buses and interface pricing points. FTRs are available to the nearest 0.1 MW. The FTR target allocation is calculated hourly and is equal to the product of the FTR MW and the congestion price difference between sink and source that occurs in the Day-Ahead Energy Market. The value of an FTR can be positive or negative depending on the sink minus source congestion price difference, with a negative difference resulting in a liability for the holder. The FTR target allocation is a cap on what FTR holders can receive. Revenues above that level on individual FTR paths are used to fund FTRs on paths which received less than their target allocations. Available revenue to pay FTR holders is based on the amount of Day-Ahead and balancing congestion collected, along with Market to Market payments, excess ARR revenues available at the end of a month and any charges made to Day-Ahead Operating Reserves.

⁴ For additional information on marginal losses, see the 2012 *State of the Market Report for PJM*, Volume II, Section 10, "Congestion and Marginal Losses," at "Marginal Losses."

FTR funding is on an aggregate basis and is not on a path specific basis or on a time specific basis. As a result, there are widespread cross subsidies paid to equalize payments across paths and across time periods within a planning period. All paths receive the same proportional level of target revenue at the end of the planning period. FTR auction revenues and excess revenues are carried forward from prior months and distributed back from later months. At the end of a planning period, if some months remain not fully funded, an uplift charge is collected from any FTR market participants that hold FTRs for the planning period based on their pro rata share of total net positive FTR target allocations, excluding any charge to FTR holders with a net negative FTR position for the planning year.

Depending on the amount of FTR revenues collected, FTR holders with a positively valued FTR may receive congestion credits between zero and their target allocations. Revenues to fund FTRs come from both day-ahead congestion charges on the transmission system and balancing congestion charges. FTR holders with a negatively valued FTR are required to pay charges equal to their target allocations. When FTR holders receive their target allocations, the associated FTRs are considered fully funded. The objective function of all FTR auctions is to maximize the bid-based value of FTRs awarded in each auction.

FTRs can be bought, sold and self scheduled. Buy bids are FTRs that are bought in the auctions; sell offers are existing FTRs that are sold in the auctions; and self-scheduled bids are FTRs that have been directly converted from ARRs in the Annual FTR Auction.

There are two types of FTR products: obligations and options. An obligation provides a credit, positive or negative, equal to the product of the FTR MW and the congestion price difference between FTR sink (destination) and source (origin) that occurs in the Day-Ahead Energy Market. An option provides only positive credits and options are available for only a subset of the possible FTR transmission paths.

There are three classes of FTR products: 24-hour, on peak and off peak. The 24-hour products are effective 24 hours a day, seven days a week, while the on

peak products are effective during on peak periods defined as the hours ending 0800 through 2300, Eastern Prevailing Time (EPT) Mondays through Fridays, excluding North American Electric Reliability Council (NERC) holidays. The off peak products are effective during hours ending 2400 through 0700, EPT, Mondays through Fridays, and during all hours on Saturdays, Sundays and NERC holidays.

PJM operates an Annual FTR Auction for all participants. In addition, PJM conducts Monthly Balance of Planning Period FTR Auctions for the remaining months of the planning period, which allows participants to buy and sell residual transmission capability. PJM also runs a Long Term FTR Auction for the following three consecutive planning years. FTR options are not available in the Long Term FTR Auction. A secondary bilateral market is also administered by PJM to allow participants to buy and sell existing FTRs. FTRs can also be exchanged bilaterally outside PJM markets.

FTR buy bids and sell offers may be made as obligations or options and as any of the three classes. FTR self-scheduled bids are available only as obligations and 24-hour class, consistent with the associated ARRs, and only in the Annual FTR Auction.

As one of the measures to address FTR funding, effective August 5, 2011, PJM does not allow FTR buy bids to clear with a price of zero unless there is at least one constraint in the auction which affects the FTR path.

Market Structure

Any PJM member can participate in the Long Term FTR Auction, the Annual FTR Auction and the Monthly Balance of Planning Period FTR Auctions.

Supply and Demand

PJM oversees the process of selling and buying FTRs through FTR Auctions. Market participants purchase FTRs by participating in Long Term, Annual and Monthly Balance of Planning Period FTR Auctions.⁵ FTRs can also be traded

⁵ See PJM, "Manual 6: Financial Transmission Rights," Revision 13 (June 28, 2012), p. 38.

between market participants through bilateral transactions. ARRs may be self scheduled as FTRs for participation only in the Annual FTR Auction.

Total FTR supply is limited by the capability of the transmission system to simultaneously accommodate the set of requested FTRs and the numerous combinations of FTRs that are feasible including self scheduled ARRs. For the Annual FTR Auction, known transmission outages that are expected to last for two months or more are included in the model, while known outages of five days or more are included in the model for the Monthly Balance of Planning Period FTR Auctions as well as any outages of a shorter duration that PJM determines would cause FTR revenue inadequacy if not modeled.⁶

But the auction process does not account for the fact that significant transmission outages, which have not been provided to PJM by transmission owners prior to the auction date, will occur during the periods covered by the auctions. Such transmission outages may or may not be planned in advance or may be emergency outages. In addition, it is difficult to model in an annual auction two outages of similar significance and similar duration in different areas which do not overlap in time. The choice of which to model may have significant distributional consequences.

These issues are a reason to implement probabilistic outage modeling, seasonal ARR allocations and explicit rules governing the treatment of non simultaneous outages during an FTR auction period.

Monthly Balance of Planning Period FTR Auctions

The residual capability of the PJM transmission system, after the Long Term and Annual FTR Auctions are concluded, is offered in the Monthly Balance of Planning Period FTR Auctions. Existing FTRs are modeled as fixed injections and withdrawals. Outages expected to last five or more days are included in the determination of the simultaneous feasibility test for the Monthly Balance of Planning Period FTR Auction. These are single-round monthly auctions that allow any transmission service customer or PJM member to bid for any FTR or to offer for sale any FTR that they currently hold. Market participants

⁶ See PJM, "Manual 6: Financial Transmission Rights," Revision 13 (June 28, 2012), p. 54.

can bid for or offer monthly FTRs for any of the next three months remaining in the planning period, or quarterly FTRs for any of the quarters remaining in the planning period. FTRs in the auctions include obligations and options and 24-hour, on peak and off peak products.⁷

Secondary Bilateral Market

Market participants can buy and sell existing FTRs through the PJM administered, bilateral market, or market participants can trade FTRs among themselves without PJM involvement. Bilateral transactions that are not done through PJM can involve parties that are not PJM members. PJM has no knowledge of bilateral transactions that are done outside of PJM's bilateral market system.

For bilateral trades done through PJM, the FTR transmission path must remain the same, FTR obligations must remain obligations, and FTR options must remain options. However, an individual FTR may be split up into multiple, smaller FTRs, down to increments of 0.1 MW. FTRs can also be given different start and end times, but the start time cannot be earlier than the original FTR start time and the end time cannot be later than the original FTR end time.

Buy Bids

The total FTR buy bids in the 2013 to 2014 Annual FTR Auction were 3,274,373 MW. The total FTR buy bids in the Monthly Balance of Planning Period FTR Auctions for the 2012 to 2013 planning period were 19,685,688 MW.

Patterns of Ownership

The overall ownership structure of FTRs and the ownership of prevailing flow and counter flow FTRs is descriptive and is not necessarily a measure of actual or potential FTR market structure issues, as the ownership positions result from competitive auctions.

In order to evaluate the ownership of prevailing flow and counter flow FTRs, the MMU categorized all participants owning FTRs in PJM as either physical or financial. Physical entities include utilities and customers which primarily

⁷ See PJM, "Manual 6: Financial Transmission Rights," Revision 13 (June 28, 2012), p. 39.

take physical positions in PJM markets. Financial entities include banks and hedge funds which primarily take financial positions in PJM markets. International market participants that primarily take financial positions in PJM markets are generally considered to be financial entities even if they are utilities in their own countries.

Table 13-2 presents the Monthly Balance of Planning Period FTR Auction cleared FTRs for January through September 2013 by trade type, organization type and FTR direction. Financial entities purchased 75.6 percent of prevailing flow and 85.7 percent of counter flow FTRs for the first nine months of the year, with the result that financial entities purchased 79.6 percent of all prevailing and counter flow FTR buy bids in the Monthly Balance of Planning Period FTR Auction cleared FTRs for January through September 2013.

Table 13-2 Monthly Balance of Planning Period FTR Auction patterns of ownership by FTR direction: January through September 2013

Trade Type	Organization Type	FTR Direction		All
		Prevailing Flow	Counter Flow	
Buy Bids	Physical	24.4%	14.3%	20.4%
	Financial	75.6%	85.7%	79.6%
	Total	100.0%	100.0%	100.0%
Sell Offers	Physical	32.5%	28.6%	31.9%
	Financial	67.5%	71.4%	68.1%
	Total	100.0%	100.0%	100.0%

Table 13-3 presents the daily net position ownership for all FTRs for January through September 2013, by FTR direction.

Table 13-3 Daily FTR net position ownership by FTR direction: January through September 2013

Organization Type	FTR Direction		All
	Prevailing Flow	Counter Flow	
Physical	46.6%	20.6%	37.8%
Financial	53.4%	79.4%	62.2%
Total	100.0%	100.0%	100.0%

Market Behavior

FTR Forfeitures

An FTR holder may be subject to forfeiture of any profits from an FTR if it meets the criteria defined in Section 5.2.1 (b) of Schedule 1 of the PJM Operating Agreement, the FTR forfeiture rule. If a participant has a cleared increment offer or decrement bid for an applicable hour at or near the source or sink of any FTR they own and the day-ahead congestion LMP difference is greater than the real time congestion LMP difference the profits from that FTR may be subject to forfeiture for that hour. An increment offer or decrement bid is considered near the source or sink point if 75 percent or more of the energy injected or withdrawn, and which is withdrawn or injected at any other bus, is reflected on the constrained path between the FTR source or sink. This rule only applies to increment offers and decrement bids that would increase the price separation between the FTR source and sink points.

Figure 13-1 demonstrates the FTR forfeiture rule for INCs and DECs. The INC or DEC distribution factor (dfax) is compared to the largest impact withdrawal or injection dfax. If the absolute difference between the virtual bid and its counterpart is greater than or equal to 75 percent, the virtual bid is considered for forfeiture. This is the metric in the rule which defines the impact of the virtual bid on the constraint.

In the first part of the example in Figure 13-1, the INC has a dfax of 0.25 and the maximum withdrawal dfax on the constraint is -0.5. The difference between the two dfaxes is -0.75 (0.25 minus -0.5). The absolute value is 0.75. In the second part of the example in Figure 13-1, the DEC has dfax of 0.5 and the maximum injection dfax on the constraint is -0.25. The difference between the two dfaxes is 0.75 (-0.25 minus 0.5). The absolute value is also 0.75.

Figure 13-1 Illustration of INC/DEC FTR forfeiture rule


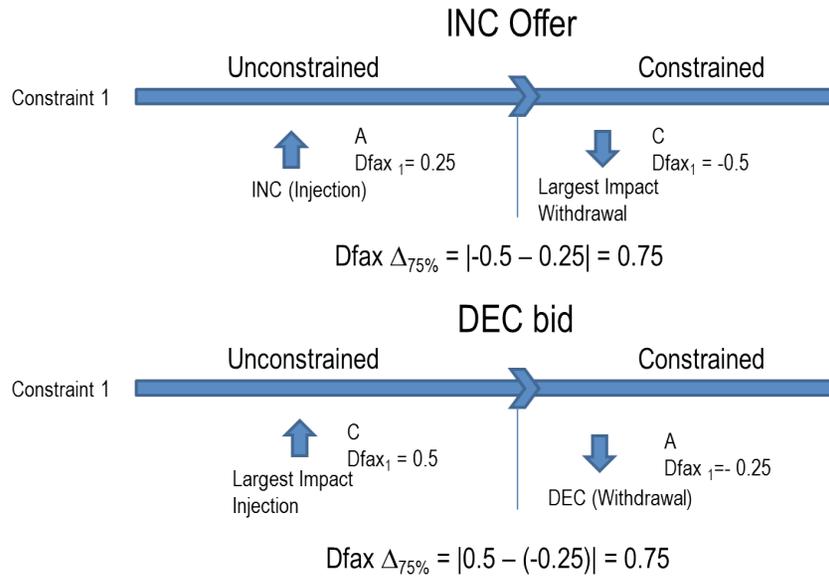


Figure 13-2 shows the FTR forfeitures values for both counter flow and prevailing flow FTRs for each month of June 2010 through September 2013 by company type.⁸ Currently, FTRs that alleviate a constraint are not subject to forfeiture regardless of INC or DEC positions. Total forfeitures for the 2013 to 2014 planning period, through September 2013, were \$440,526 (0.1 percent of total FTR target allocations).⁹

Figure 13-2 Monthly FTR Forfeitures for physical and financial participants: June 2010 through September 2013

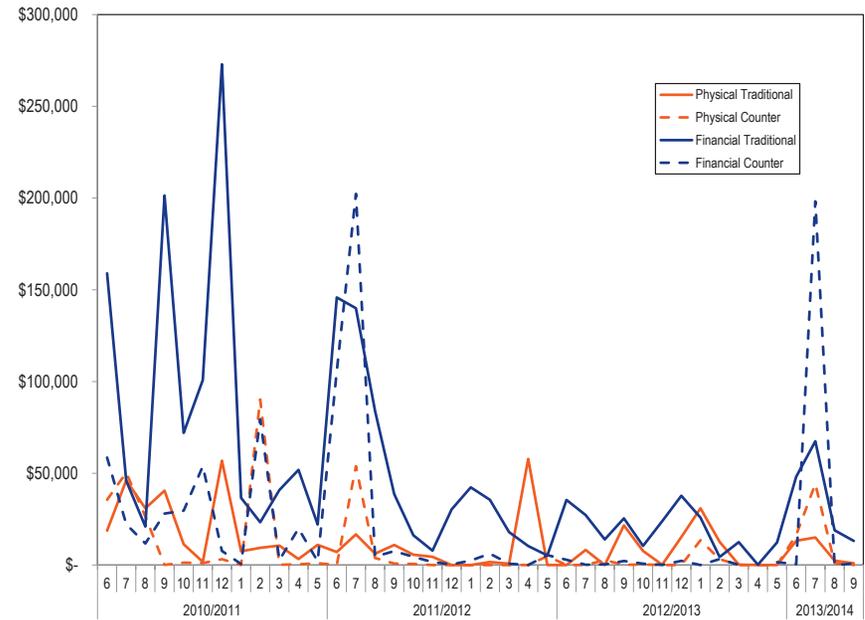

Credit Issues

The credit issues reported here were not necessarily related to FTR positions.

Eight participants defaulted during 2013, through August, from twelve default events. The average of these defaults was \$320,125 with nine based on inadequate collateral and three based on nonpayment. The average collateral default was \$377,579 and the average nonpayment default was \$147,761. The majority of these defaults were promptly cured, with one partial cure.

⁸ Counter flow FTRs are defined for this purpose as FTRs with a negative auction price.

⁹ Forfeiture total is different in this State of the Market Report than previous due to adjustments made to correct errors in August 2012, September 2012, November 2012 and April 2013.

Market Performance

Volume

Table 13-4 Monthly Balance of Planning Period FTR Auction market volume: January through September 2013

Monthly Auction	Hedge Type	Trade Type	Bid and Requested Count	Bid and Requested Volume (MW)	Cleared Volume (MW)	Cleared Volume	Uncleared Volume (MW)	Uncleared Volume
Jan-13	Obligations	Buy bids	150,397	963,036	166,622	17.3%	796,414	82.7%
		Sell offers	84,563	297,609	34,710	11.7%	262,899	88.3%
	Options	Buy bids	2,830	104,318	6,767	6.5%	97,551	93.5%
		Sell offers	10,204	73,624	17,322	23.5%	56,302	76.5%
Feb-13	Obligations	Buy bids	164,620	1,035,756	166,386	16.1%	869,369	83.9%
		Sell offers	76,210	261,631	36,402	13.9%	225,229	86.1%
	Options	Buy bids	2,518	94,039	4,749	5.0%	89,290	95.0%
		Sell offers	9,053	62,833	16,434	26.2%	46,399	73.8%
Mar-13	Obligations	Buy bids	168,718	1,092,986	188,849	17.3%	904,138	82.7%
		Sell offers	77,248	256,820	40,079	15.6%	216,741	84.4%
	Options	Buy bids	2,674	103,046	5,591	5.4%	97,455	94.6%
		Sell offers	10,054	84,993	21,581	25.4%	63,411	74.6%
Apr-13	Obligations	Buy bids	130,671	742,450	143,747	19.4%	598,703	80.6%
		Sell offers	55,739	206,725	33,203	16.1%	173,522	83.9%
	Options	Buy bids	1,852	47,911	4,069	8.5%	43,842	91.5%
		Sell offers	6,017	58,130	17,259	29.7%	40,870	70.3%
May-13	Obligations	Buy bids	99,964	562,240	119,522	21.3%	442,718	78.7%
		Sell offers	25,028	93,603	19,917	21.3%	73,686	78.7%
	Options	Buy bids	792	33,223	2,901	8.7%	30,322	91.3%
		Sell offers	2,634	24,643	15,506	62.9%	9,137	37.1%
Jun-13	Obligations	Buy bids	268,004	1,548,839	275,485	17.8%	1,273,354	82.2%
		Sell offers	150,754	474,950	59,536	12.5%	415,415	87.5%
	Options	Buy bids	4,155	313,972	14,825	4.7%	299,147	95.3%
		Sell offers	23,090	198,850	55,455	27.9%	143,395	72.1%
Jul-13	Obligations	Buy bids	296,234	2,006,362	281,879	14.0%	1,724,483	86.0%
		Sell offers	142,594	429,555	57,422	13.4%	372,133	86.6%
	Options	Buy bids	10,303	564,738	16,412	2.9%	548,326	97.1%
		Sell offers	20,146	140,558	51,541	36.7%	89,018	63.3%
Aug-13	Obligations	Buy bids	337,418	2,283,124	334,179	14.6%	1,948,945	85.4%
		Sell offers	133,353	385,475	61,167	15.9%	324,309	84.1%
	Options	Buy bids	8,850	443,384	12,719	2.9%	430,665	97.1%
		Sell offers	21,320	147,295	45,916	31.2%	101,379	68.8%
Sep-13	Obligations	Buy bids	316,757	2,128,460	354,081	16.6%	1,774,379	83.4%
		Sell offers	186,831	421,145	65,522	15.6%	355,623	84.4%
	Options	Buy bids	8,735	476,204	19,173	4.0%	457,032	96.0%
		Sell offers	20,991	137,118	47,328	34.5%	89,790	65.5%
2012/2013*	Obligations	Buy bids	2,255,105	12,956,832	2,171,751	16.8%	10,785,081	83.2%
		Sell offers	1,080,775	3,922,225	468,426	11.9%	3,453,798	88.1%
	Options	Buy bids	103,926	6,728,856	74,889	1.1%	6,653,967	98.9%
		Sell offers	149,274	1,088,211	268,684	24.7%	819,527	75.3%
2013/2014**	Obligations	Buy bids	1,218,413	7,966,785	1,245,623	15.6%	6,721,161	84.4%
		Sell offers	613,532	1,711,126	243,646	14.2%	1,467,479	85.8%
	Options	Buy bids	32,043	1,798,298	63,129	3.5%	1,735,169	96.5%
		Sell offers	85,547	623,821	200,239	32.1%	423,583	67.9%

* Shows Twelve Months for 2012/2013; ** Shows four months ended 30-Sep-13 for 2013/2014

Table 13-4 provides the Monthly Balance of Planning Period FTR Auction market volume for the entire 2012 to 2013 planning period and the first four months of the 2013 to 2014 planning period. There were 7,966,785 MW of FTR buy bid obligations and 1,711,126 MW of FTR sell offer obligations for all bidding periods in the 2013 to 2014 planning period. The 2013 to 2014 planning period Monthly Balance of Planning Period Auctions cleared 1,245,623 MW (15.6 percent) of FTR buy bid obligations and 243,646 MW (14.2 percent) of FTR sell offer obligations.

There were 1,798,298 MW of FTR buy bid options and 623,821 MW of FTR sell offer options for all bidding periods in the Monthly Balance of Planning Period FTR Auctions for the 2013 to 2014 planning period. The monthly auctions cleared 63,129 MW (3.5 percent) of FTR buy bid options, and 200,239 MW (32.1 percent) of FTR sell offers.

Table 13-5 presents the buy-bid, bid and cleared volume of the Monthly Balance of Planning Period FTR Auction, and the effective periods for the volume. The average monthly cleared volume for January through September 2013 is 235,328.3 MW. The average monthly cleared volume for January through September 2012 was 176,697.9 MW.

Table 13-5 Monthly Balance of Planning Period FTR Auction buy-bid, bid and cleared volume (MW per period): January through September 2013

Monthly Auction	MW Type	Prompt Month	Second Month	Third Month	Q1	Q2	Q3	Q4	Total
Jan-13	Bid	595,260	191,417	115,207				165,471	1,067,354
	Cleared	125,075	24,018	8,251				16,045	173,389
Feb-13	Bid	654,446	174,360	177,548				123,440	1,129,794
	Cleared	131,562	15,659	13,975				9,939	171,135
Mar-13	Bid	645,247	232,876	224,105				93,804	1,196,032
	Cleared	136,007	27,219	24,669				6,544	194,440
Apr-13	Bid	610,571	179,789						790,360
	Cleared	127,896	19,920						147,816
May-13	Bid	595,463							595,463
	Cleared	122,423							122,423
Jun-13	Bid	766,947	218,427	205,723	112,180	195,196	193,766	170,571	1,862,810
	Cleared	141,332	31,035	25,346	14,149	27,397	25,560	25,491	290,310
Jul-13	Bid	921,277	343,637	244,602	0	329,350	349,639	382,594	2,571,100
	Cleared	158,643	30,086	15,959	0	27,840	34,134	31,628	298,291
Aug-13	Bid	1,076,550	268,252	266,570	0	331,723	393,247	390,165	2,726,508
	Cleared	178,551	26,336	22,399	0	30,116	47,483	42,012	346,898
Sep-13	Bid	934,389	330,547	344,156	0	250,625	375,174	369,773	2,604,664
	Cleared	188,437	37,569	36,258	0	23,153	45,357	42,480	373,253

Figure 13-3 shows cleared auction volumes as a percent of the total FTR cleared volume by calendar months for June 2004 through September 2013, by type of auction. FTR volumes are included in the calendar month they are effective, with Long Term and Annual FTR auction volume spread equally to each month in the relevant planning period. This figure shows the share of FTRs purchased in each auction type by month. Over the course of the planning period an increasing number of Monthly Balance of Planning Period FTRs are purchased, making them a greater portion of active FTRs. When the Annual FTR Auction occurs, FTRs purchased in any previous Monthly Balance of Planning Period Auction, other than the current June auction, are no longer in effect, so there is a reduction in their share of total FTRs with an accompanying rise in the share of Annual FTRs.

Figure 13-3 Cleared auction volume (MW) as a percent of total FTR cleared volume by calendar month: June 2004 through September 2013

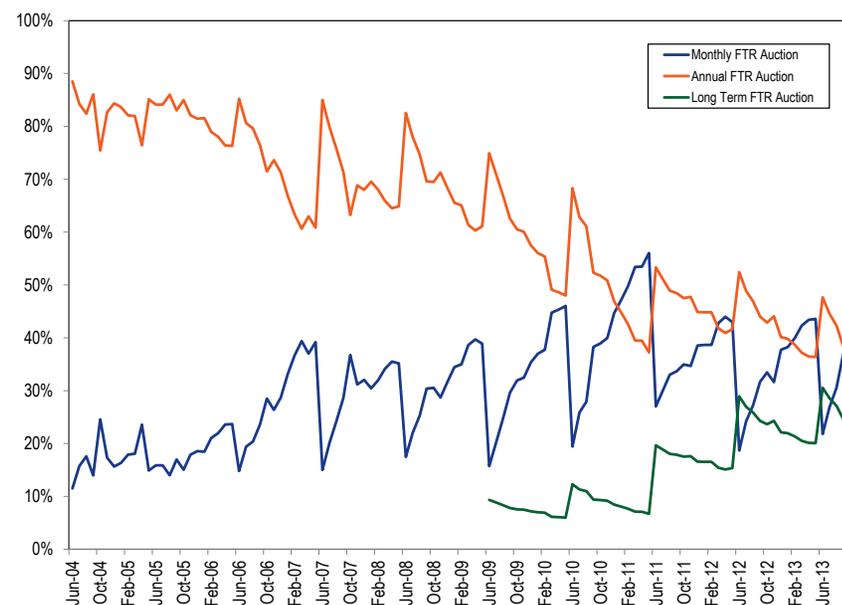


Table 13-6 provides the secondary bilateral FTR market volume for the entire 2012 to 2013 planning period and the first four months of the 2013 to 2014 planning period.


Table 13-6 Secondary bilateral FTR market volume: Planning periods 2012 to 2013 and 2013 to 2014¹⁰

Planning Period	Hedge Type	Class Type	Volume (MW)	
2012/2013	Obligation	24-Hour	95	
		On Peak	137	
		Off Peak	60	
			Total	292
	Option	24-Hour	0	
		On Peak	0	
Off Peak		0		
		Total	0	
2013/2014	Obligation	24-Hour	110	
		On Peak	41,590	
		Off Peak	34,178	
		Total	75,879	
	Option	24-Hour	0	
		On Peak	9,724	
		Off Peak	914	
		Total	10,638	

Figure 13-4 shows the FTR bid, cleared and net bid volume from June 2003 through September 2013 for Long Term, Annual and Monthly Balance of Planning Period Auctions. Cleared volume is the volume of FTR buy and sell offers that were accepted. The net bid volume includes the total buy, sell and self-scheduled offers, counting sell offers as a negative volume. The bid volume is the total of all bid and self-scheduled offers, excluding sell offers. Bid volumes and net bid volumes have increased since 2003. Cleared volume was relatively steady until 2010, with an increase in 2011 followed by a slight decrease in 2012. The demand for FTRs has increased while availability of FTRs generally did not increase until 2011.

¹⁰ The 2013 to 2014 planning period covers bilateral FTRs that are effective for any time between June 1, 2013 through September 30, 2013, which originally had been purchased in a Long Term FTR Auction, Annual FTR Auction or Monthly Balance of Planning Period FTR Auction.

Figure 13-4 Long Term, Annual and Monthly FTR Auction bid and cleared volume: June 2003 through September 2013

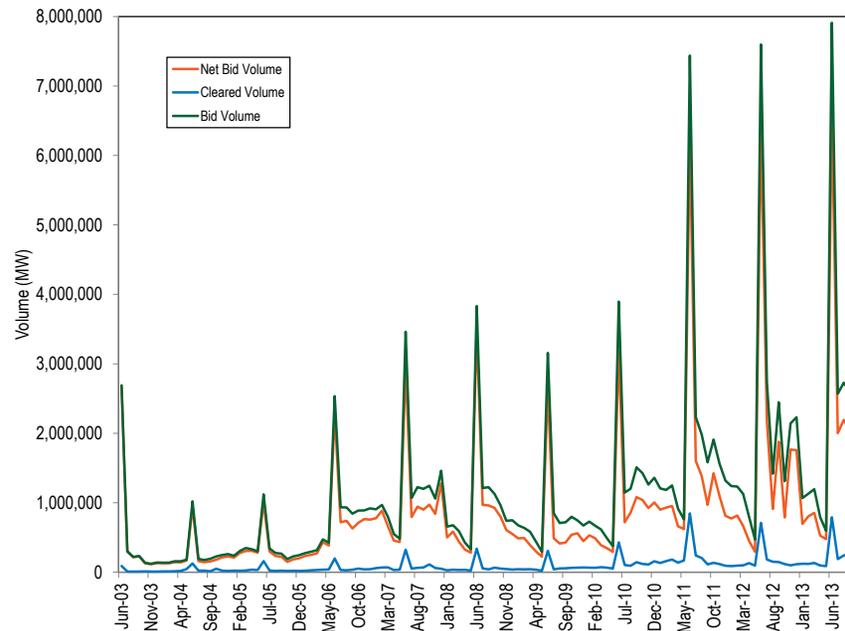

Price

Table 13-7 shows the weighted-average cleared buy-bid price in the Monthly Balance of Planning Period FTR Auctions by bidding period for January 2013 through September 2013. For example, for the January 2013 Monthly Balance of Planning Period FTR Auction, the current month column is January, the second month column is February and the third month column is March. Quarters 1 through 4 are represented in the Q1, Q2, Q3 and Q4 columns. The total column represents all of the activity within the January 2013 Monthly Balance of Planning Period FTR Auction.

The cleared weighted-average price paid in the Monthly Balance of Planning Period FTR Auctions for January through September 2013 was \$0.09 per MW, down from \$0.10 per MW in the same time last year.

Table 13-7 Monthly Balance of Planning Period FTR Auction cleared, weighted-average, buy-bid price per period (Dollars per MW): January through September 2013

Monthly Auction	Prompt Month	Second Month	Third Month	Q1	Q2	Q3	Q4	Total
Jan-13	\$0.11	\$0.20	\$0.05				\$0.09	\$0.11
Feb-13	\$0.09	\$0.12	\$0.10				\$0.13	\$0.10
Mar-13	\$0.10	\$0.12	\$0.10				\$0.05	\$0.10
Apr-13	\$0.10	\$0.16						\$0.11
May-13	\$0.09	\$0.00						\$0.09
Jun-13	\$0.08	\$0.21	\$0.19	\$0.15	\$0.16	\$0.14	\$0.10	\$0.06
Jul-13	\$0.10	\$0.17	(\$0.14)		\$0.12	\$0.07	\$0.06	\$0.08
Aug-13	\$0.08	\$0.17	\$0.07		\$0.07	\$0.07	\$0.06	\$0.08
Sep-13	\$0.06	\$0.07	\$0.04		\$0.11	\$0.09	\$0.06	\$0.07

Profitability

FTR profitability is the difference between the revenue received for an FTR and the cost of the FTR. For a prevailing flow FTR, the FTR credits are the actual revenue that an FTR holder receives and the auction price is the cost. For a counter flow FTR, the auction price is the revenue that an FTR holder is paid and the FTR credits are the cost to the FTR holder, which the FTR holder must pay. The cost of self-scheduled FTRs is zero. ARR holders that self schedule FTRs purchase the FTRs in the Annual FTR Auction, but the ARR holders receive offsetting ARR credits that equal the purchase price of the FTRs.

Table 13-8 lists FTR profits by organization type and FTR direction for the period from January through September, 2013. FTR profits are the sum of the daily FTR credits, including for self-scheduled FTRs, minus the daily FTR auction costs for each FTR held by an organization. The FTR target allocation is equal to the product of the FTR MW and congestion price differences between sink and source in the Day-Ahead Energy Market. The FTR credits do not

include after the fact adjustments. The daily FTR auction costs are the product of the FTR MW and the auction price divided by the time period of the FTR in days, but self-scheduled FTRs have zero cost. FTRs were profitable overall, with \$138.8 million in profits for physical entities, of which \$135.9 million was from self-scheduled FTRs, and \$132.1 million for financial entities.

Table 13-8 FTR profits by organization type and FTR direction: January through September 2013

Organization Type	FTR Direction				All
	Prevailing Flow	Self Scheduled Prevailing Flow	Counter Flow	Self Scheduled Counter Flow	
Physical	(\$31,163,287)	\$133,960,556	\$34,103,968	\$1,947,419	\$138,848,656
Financial	\$38,900,996	NA	\$93,163,353	NA	\$132,064,349
Total	\$7,737,709	\$133,960,556	\$127,267,321	\$1,947,419	\$270,913,005

Table 13-9 lists the monthly FTR profits in 2013 by organization type.

Table 13-9 Monthly FTR profits by organization type: January through September 2013

Month	Organization Type			Total
	Physical	Self Scheduled Physical FTRs	Financial	
Jan	\$4,433,798	\$24,630,019	\$13,640,158	\$42,703,975
Feb	\$14,090,796	\$20,676,306	\$16,980,941	\$51,748,044
Mar	(\$9,498,908)	\$15,149,289	\$4,849,731	\$10,500,113
Apr	(\$12,666,550)	\$6,571,358	\$2,187,796	(\$3,907,396)
May	(\$3,242,261)	\$14,590,963	\$12,513,107	\$23,861,810
Jun	\$1,557,793	\$12,289,397	\$14,357,719	\$28,204,910
Jul	\$9,677,398	\$20,442,580	\$33,133,249	\$63,253,226
Aug	(\$11,149,377)	\$6,876,920	\$3,987,989	(\$284,468)
Sep	\$9,737,992	\$14,681,142	\$30,413,658	\$54,832,792
Total	\$2,940,681	\$135,907,975	\$132,064,349	\$270,913,005

Revenue

Monthly Balance of Planning Period FTR Auction Revenue

Table 13-10 Monthly Balance of Planning Period FTR Auction revenue: January through September 2013

Monthly Auction	Type	Trade Type	Class Type			All
			24-Hour	On Peak	Off Peak	
Jan-13	Obligations	Buy bids	\$42,552	\$4,558,023	\$3,371,362	\$7,971,937
		Sell offers	\$106,975	\$2,609,123	\$1,599,772	\$4,315,870
	Options	Buy bids	\$0	\$237,321	\$153,334	\$390,655
Feb-13	Obligations	Sell offers	\$0	\$1,133,641	\$1,206,317	\$2,339,958
		Buy bids	\$176,565	\$3,587,647	\$2,468,155	\$6,232,366
	Options	Sell offers	\$401,600	\$1,782,016	\$1,097,066	\$3,280,682
Mar-13	Obligations	Buy bids	\$5,100	\$99,651	\$128,731	\$233,482
		Sell offers	\$0	\$861,109	\$904,603	\$1,765,712
	Options	Buy bids	\$189,939	\$4,040,854	\$3,035,268	\$7,266,060
Apr-13	Obligations	Sell offers	\$61,862	\$2,221,264	\$1,434,875	\$3,718,001
		Buy bids	\$16,526	\$229,272	\$95,137	\$340,935
	Options	Sell offers	\$0	\$1,242,062	\$1,381,010	\$2,623,072
May-13	Obligations	Buy bids	(\$27,848)	\$3,384,641	\$2,231,023	\$5,587,816
		Sell offers	\$414,627	\$1,703,707	\$1,085,350	\$3,203,684
	Options	Buy bids	\$46,767	\$236,939	\$92,241	\$375,947
Jun-13	Obligations	Sell offers	\$0	\$816,642	\$702,628	\$1,519,270
		Buy bids	\$22,637	\$2,501,391	\$1,418,753	\$3,942,781
	Options	Sell offers	\$210,649	\$1,133,878	\$524,793	\$1,869,320
Jul-13	Obligations	Buy bids	\$0	\$146,702	\$55,903	\$202,605
		Sell offers	\$441	\$739,219	\$602,794	\$1,342,454
	Options	Buy bids	\$258,896	\$12,840,102	\$8,210,854	\$21,309,852
Aug-13	Obligations	Sell offers	\$6,203,476	\$4,763,316	\$2,821,569	\$13,788,360
		Buy bids	\$1,937	\$527,792	\$270,176	\$799,905
	Options	Sell offers	\$0	\$4,338,954	\$2,862,300	\$7,201,254
Sep-13	Obligations	Buy bids	\$510,314	\$9,102,951	\$4,353,703	\$13,966,968
		Sell offers	\$93,068	\$5,789,068	\$4,745,346	\$10,627,482
	Options	Buy bids	\$4,131	\$627,541	\$557,307	\$1,188,979
2012/2013*	Obligations	Sell offers	\$0	\$3,737,741	\$3,401,595	\$7,139,335
		Buy bids	\$865,368	\$8,730,071	\$6,036,457	\$15,631,896
	Options	Sell offers	\$80,061	\$5,495,491	\$4,455,681	\$10,031,232
2013/2014**	Obligations	Buy bids	\$2,361	\$533,585	\$446,817	\$982,762
		Sell offers	\$0	\$2,977,768	\$2,590,004	\$5,567,772
	Options	Buy bids	\$528,800	\$8,147,903	\$5,670,300	\$14,347,003
2012/2013*	Obligations	Sell offers	\$219,616	\$4,804,814	\$3,795,424	\$8,819,854
		Buy bids	\$633	\$617,446	\$628,494	\$1,246,573
	Options	Sell offers	\$0	\$3,184,129	\$2,500,854	\$5,684,983
2013/2014**	Obligations	Buy bids	\$67,116	\$76,349,386	\$43,832,157	\$120,248,659
		Sell offers	\$4,731,328	\$40,127,400	\$18,982,130	\$63,840,858
	Options	Buy bids	\$152,160	\$4,512,768	\$2,793,076	\$7,458,004
2013/2014**	Obligations	Sell offers	\$313,760	\$22,240,204	\$17,444,010	\$39,997,974
		Buy bids	(\$4,825,812)	\$18,494,550	\$10,199,092	\$23,867,830
	Options	Buy bids	\$2,163,379	\$38,821,027	\$24,271,313	\$65,255,719
2013/2014**	Obligations	Sell offers	\$6,596,220	\$20,852,688	\$15,818,020	\$43,266,929
		Buy bids	\$159,285	\$6,291,340	\$4,425,694	\$10,876,319
	Options	Sell offers	\$0	\$14,238,592	\$11,354,752	\$25,593,344
Total			(\$4,273,556)	\$10,021,086	\$1,524,235	\$7,271,765

* Shows Twelve Months; ** Shows four months ended 30-Sep-2013 for 2013/2014

Table 13-10 shows Monthly Balance of Planning Period FTR Auction revenue data by trade type, type and class type for January through September 2013. The Monthly Balance of Planning Period FTR Auction netted \$7.3 million in revenue, with buyers paying \$76.1 million and sellers receiving \$68.9 million for the first four months of the 2013 to 2014 planning period. For the first four months of the 2012 to 2013 planning period, the Monthly Balance of Planning Period FTR Auction netted \$11.9 million.

Figure 13-5 summarizes total revenue associated with all FTRs, regardless of source, to the FTR sinks that produced the largest positive and negative revenue in the Monthly Balance of Planning Period FTR Auctions during the 2013 to 2014 planning period through September. The top 10 positive revenue producing FTR sources accounted for \$29.9 million of the total revenue of \$0.7 million paid in the auction, they also comprised 5.1 percent of all FTRs bought in the auction. The top 10 negative revenue producing FTR sinks accounted for -\$10.8 million of revenue and constituted 1.4 percent of all FTRs bought in the auction.

Figure 13-5 Ten largest positive and negative revenue producing FTR sinks purchased in the Monthly Balance of Planning Period FTR Auctions: planning period 2013 to 2014 through September


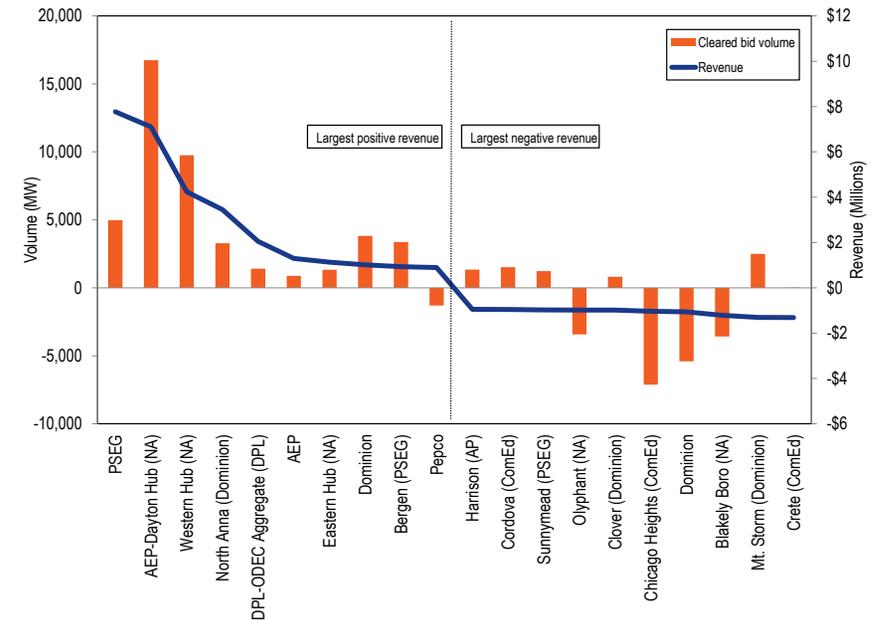


Figure 13-6 summarizes total revenue associated with all FTRs, regardless of sink, from the FTR sources that produced the largest positive and negative revenue from the Monthly Balance of Planning Period FTR Auctions during the 2013 to 2014 planning period through September. The top 10 positive revenue producing FTR sources accounted for \$30.3 million of the total revenue of \$23.9 million paid in the auction, they also comprised 3.3 percent of all FTRs bought in the auction. The top 10 negative revenue producing FTR sinks accounted for -\$11.1 million of revenue and constituted 0.5 percent of all FTRs bought in the auction.

Figure 13-6 Ten largest positive and negative revenue producing FTR sources purchased in the Monthly Balance of Planning Period FTR Auctions: planning period 2013 to 2014 through September

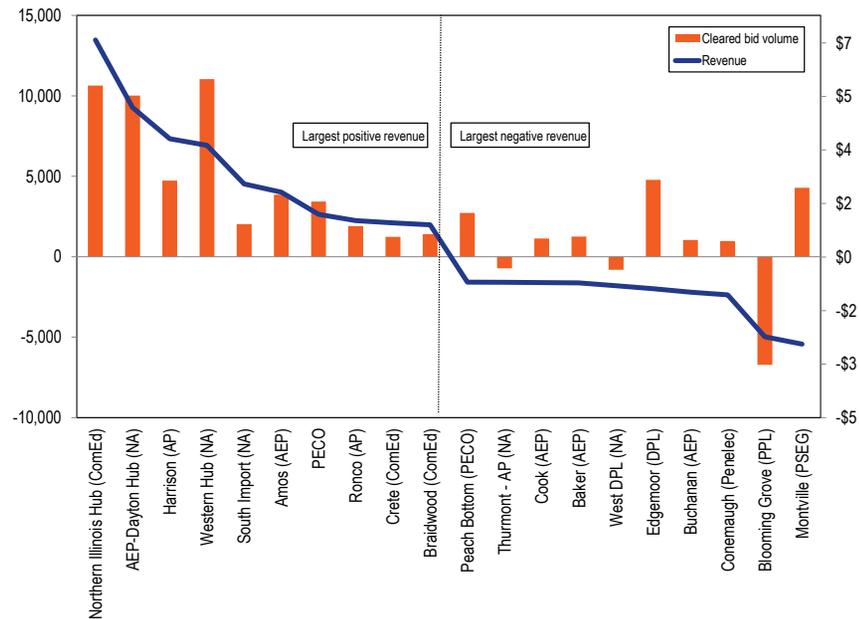

FTR Target Allocations

FTR target allocations were examined separately by source and sink contribution. Hourly FTR target allocations were divided into those that were benefits and liabilities and summed by sink and by source for the 2013 to 2014 planning period through September 30, 2013. Figure 13-7 shows the ten largest positive and negative FTR target allocations, summed by sink, for the 2013 to 2014 planning period. The top 10 sinks that produced financial benefit accounted for 18.4 percent of total positive target allocations during the 2013 to 2014 planning period with the Dominion zone accounting for 3.2 percent of all positive target allocations. The top 10 sinks that created liability accounted for 8.9 percent of total negative target allocations with Vienna accounting for 1.2 percent of all negative target allocations.

Figure 13-7 Ten largest positive and negative FTR target allocations summed by sink: 2013 to 2014 planning period through September 30, 2013


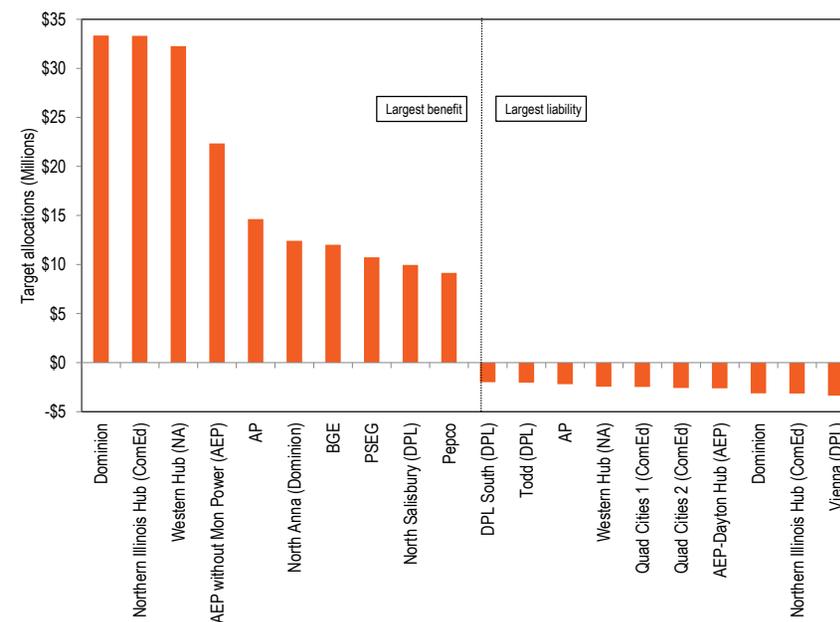


Figure 13-8 shows the ten largest positive and negative FTR target allocations, summed by source, for the 2013 to 2014 planning period. The top 10 sources with a positive target allocation accounted for 12.4 percent of total positive target allocations with the Northern Illinois Hub accounting for 1.9 percent of total positive target allocations. The top 10 sources with a negative target allocation accounted for 7.5 percent of all negative target allocations, with the Western Hub accounting for 1.8 percent.

Figure 13-8 Ten largest positive and negative FTR target allocations summed by source: 2013 to 2014 planning period through September 30, 2013

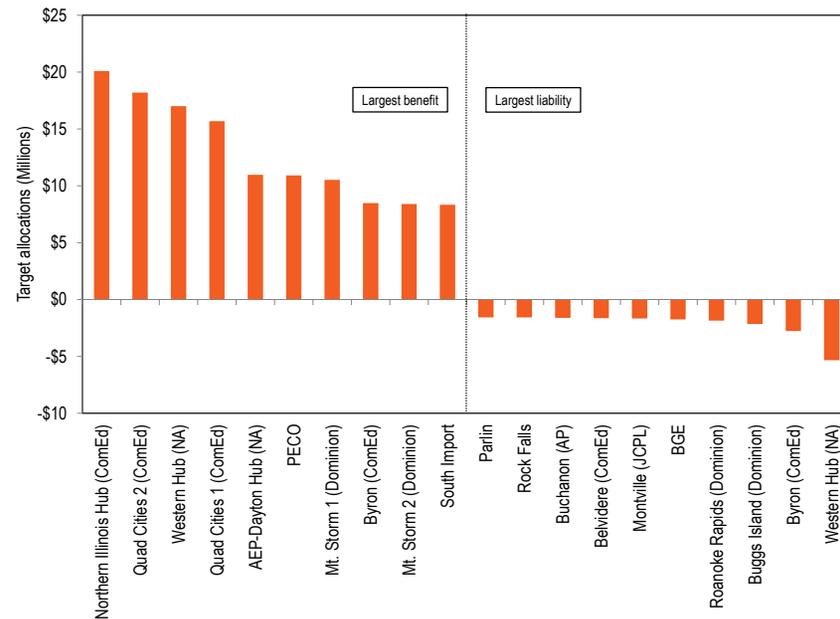

Revenue Adequacy

Congestion revenue is created in an LMP system when all loads pay and all generators receive their respective LMPs. When load in a constrained area pays more than the amount that generators receive, excluding losses, positive congestion revenue exists and is available to cover the target allocations of FTR holders. The load MW exceed the generation MW in constrained areas because part of the load is served by imports using transmission capability into the constrained areas. That is why load, which pays for the transmission capability, receives ARRs to offset congestion in the constrained areas. Generating units that are the source of such imports are paid the price at their own bus which does not reflect congestion in constrained areas. Generation in constrained areas receives the congestion price and all load in constrained areas pays the congestion price. As a result, load congestion payments are greater than the

congestion-related payments to generation.¹¹ This overpayment by load is the source of the congestion revenue to pay holders of ARRs and FTRs. In general, FTR revenue adequacy exists when the sum of congestion credits is equal to or greater than the sum of congestion across the positively valued FTRs. If PJM allocated FTRs equal to the transmission capability into constrained areas, FTR payouts would equal the sum of congestion.

Revenue adequacy must be distinguished from the adequacy of FTRs as an offset against total congestion. Revenue adequacy is a narrower concept that compares total congestion revenues to the total target allocations across the specific paths for which FTRs were available and purchased. A path specific target allocation is not a guarantee of payment. The adequacy of FTRs as an offset against congestion compares FTR revenues to total congestion on the system as a measure of the extent to which FTRs offset the actual, total congestion across all paths paid by market participants, regardless of the availability or purchase of FTRs.

FTRs are paid each month from congestion revenues, both day ahead and balancing, FTR auction revenues and excess revenues are carried forward from prior months and distributed back from later months. At the end of a planning period, if some months remain not fully funded, an uplift charge is collected from any FTR market participants that hold FTRs during the planning period based on their pro rata share of total net positive FTR target allocations, excluding any charge to FTR holders with a net negative FTR position for the planning year. For the 2011 to 2012 planning period, FTRs were not fully funded and thus an uplift charge was collected.

FTR revenues are primarily comprised of hourly congestion revenue, from the day ahead and balancing markets, and unallocated congestion charges.¹² FTR revenues also include ARR excess which is the difference between ARR target allocations and FTR auction revenues. Competing use revenues are based on the Unscheduled Transmission Service Agreement between the New York Independent System Operator (NYISO) and PJM. This agreement sets

¹¹ For an illustration of how total congestion revenue is generated and how FTR target allocations and congestion receipts are determined, see Table G-1, "Congestion revenue, FTR target allocations and FTR congestion credits: Illustration," *MMU Technical Reference for PJM Markets*, at "Financial Transmission and Auction Revenue Rights."

¹² Hourly congestion revenues may be negative.

forth the terms and conditions under which compensation is provided for transmission service in connection with transactions not scheduled directly or otherwise prearranged between NYISO and PJM. Congestion revenues appearing in Table 13-11 include both congestion charges associated with PJM facilities and those associated with reciprocal, coordinated flowgates in the MISO whose operating limits are respected by PJM.¹³ The operating protocol governing the wheeling contracts between Public Service Electric and Gas Company (PSE&G) and Consolidated Edison Company of New York (Con Edison) resulted in no payment of congestion charges to Con Edison in the 2013 to 2014 planning period.^{14,15}

FTRs were paid at 77.3 percent of the target allocation level for the first four months of the 2013 to 2014 planning period. Congestion revenues are allocated to FTR holders based on FTR target allocations. PJM collected \$614.0 million of FTR revenues during the 2012 to 2013 planning period, and \$799.6 million during the 2011 to 2012 planning period, a 23.2 percent decrease. For the 2012 to 2013 planning period, the top sink and top source with the highest positive FTR target allocations were Dominion and the Northern Illinois Hub. Similarly, the top sink and top source with the largest negative FTR target allocations were Vienna and the Western Hub.

Table 13-11 presents the PJM FTR revenue detail for the 2012 to 2013 and first four months of the 2013 to 2014 planning period.

Table 13-11 Total annual PJM FTR revenue detail (Dollars (Millions)): Planning periods 2012 to 2013 and 2013 to 2014 through September 2013

Accounting Element	2012/2013	2013/2014*
ARR information		
ARR target allocations	\$587.0	\$175.0
FTR auction revenue	\$653.6	\$197.5
ARR excess	\$66.7	\$22.5
FTR targets		
FTR target allocations	\$906.8	\$372.4
Adjustments:		
Adjustments to FTR target allocations	(\$1.0)	\$0.4
Total FTR targets	\$905.8	\$372.0
FTR revenues		
ARR excess	\$66.7	\$22.5
Competing uses	\$0.1	\$0.0
Congestion		
Net Negative Congestion (enter as negative)	(\$90.6)	(\$26.1)
Hourly congestion revenue	\$668.4	\$284.0
Midwest ISO M2M (credit to PJM minus credit to Midwest ISO)	\$41.1	\$2.2
Consolidated Edison Company of New York and Public Service Electric and Gas Company Wheel (CEPSW) congestion credit to Con Edison (enter as negative)	\$0.0	\$0.0
Adjustments:		
Excess revenues carried forward into future months	\$0.0	\$0.0
Excess revenues distributed back to previous months	\$0.0	\$0.0
Other adjustments to FTR revenues	(\$0.0)	\$0.0
Total FTR revenues	\$603.4	\$278.2
Excess revenues distributed to other months	\$0.0	\$0.0
Net Negative Congestion charged to DA Operating Reserves	\$12.1	\$9.2
Excess revenues distributed to CEPSW for end-of-year distribution	\$0.0	\$0.0
Excess revenues distributed to FTR holders	\$0.0	\$0.0
Total FTR congestion credits	\$614.0	\$287.4
Total congestion credits on bill (includes CEPSW and end-of-year distribution)	\$614.0	\$287.4
Remaining deficiency	\$291.8	\$84.6

* Shows four months ended 30-Sep-13

Unallocated Congestion Charges

When congestion revenue at the end of an hour is negative, the hourly target allocations in that hour are set to zero, and there is a congestion liability for that hour. At the end of the month, if excess ARR revenue and excess congestion from other hours and months are not adequate to offset the sum of these hourly differences, Day-Ahead Operating Reserves are charged the

¹³ See "Joint Operating Agreement between the Midwest Independent System Operator, Inc. and PJM Interconnection, L.L.C.," (December 11, 2008), Section 6.1 <<http://www.pjm.com/~Media/documents/agreements/joa-complete.ashx>>. (Accessed March 13, 2012)

¹⁴ 111 FERC ¶ 61,228 (2005).

¹⁵ See the 2012 State of the Market Report for PJM, Volume II, Section 4, "Interchange Transactions," at "Con Edison and PSE&G Wheeling Contracts" and Appendix E, "Interchange Transactions" at Table E-2, "Con Edison and PSE&G wheel settlements data: 2012."

unallocated congestion charges so that the total congestion for the month is not less than zero. This charge is applied retroactively at the end of the month as additional Day-Ahead Operating Reserves charges and is never credited back to Day-Ahead Operating Reserves in the case of excess congestion. This means that within an hour, the congestion dollars collected from load were less than the congestion dollars paid to generation and there was not enough excess during the month to pay the difference. From 2010 through May 31, 2012, these charges were only made three times, for a total of \$7.3 million. However, in the 2012 to 2013 planning period these charges were made in five months for a total of \$12.1 million in just one planning period. For the first four months of the 2013 to 2014 planning period the unallocated congestion charges were \$9.2 million.

Table 13-12 shows the monthly unallocated congestion charges made to Day-Ahead Operating Reserves for the 2012 to 2013 planning period. Months with no unallocated congestion are excluded from the table.¹⁶

Table 13-12 Unallocated congestion charges: Planning period 2012 to 2013 and first four month of 2013 and 2014

Period	Charge
Oct-12	\$794,752
Dec-12	\$193,429
Jan-13	\$5,233,445
Mar-13	\$701,303
May-13	\$5,210,739
Jun-13	\$2,828,660
Sep-13	\$6,411,602
2012/2013	\$12,133,668
2013/2014	\$9,240,262

FTR target allocations are based on hourly prices in the Day-Ahead Energy Market for the respective FTR paths and are defined to be the revenue required to compensate FTR holders for congestion on those specific paths. FTR credits are paid to FTR holders and, depending on market conditions, can be less than the target allocations. Table 13-13

¹⁶ See Section 4, "Operating Reserves" at "Operating Reserve Charges" for the impact of Unallocated Congestion Charges on Operating Reserve rates.

lists the FTR revenues, target allocations, credits, payout ratios, congestion credit deficiencies and excess congestion charges by month. At the end of the 12-month planning period, excess congestion charges are used to offset any monthly congestion credit deficiencies.

The total row in Table 13-13 is not the sum of each of the monthly rows because the monthly rows may include excess revenues carried forward from prior months and excess revenues distributed back from later months.

Table 13-13 Monthly FTR accounting summary (Dollars (Millions)): Planning period 2012 to 2013 and 2013 to 2014 through September 30, 2013

Period	FTR Revenues (with adjustments)	FTR Target Allocations	FTR Payout Ratio (original)	FTR Credits (with adjustments)	FTR Payout Ratio (with adjustments)	Monthly Credits Excess/Deficiency (with adjustments)
Jun-12	\$58.5	\$62.9	92.9%	\$58.5	93.0%	(\$4.4)
Jul-12	\$71.3	\$80.0	88.9%	\$71.3	88.9%	(\$8.8)
Aug-12	\$54.1	\$55.4	97.1%	\$54.1	97.3%	(\$1.3)
Sep-12	\$38.7	\$82.5	46.7%	\$38.7	46.8%	(\$43.8)
Oct-12	\$24.3	\$58.2	41.8%	\$25.1	42.7%	(\$33.1)
Nov-12	\$52.0	\$59.6	87.2%	\$52.0	87.3%	(\$7.5)
Dec-12	\$36.3	\$50.1	72.2%	\$36.5	72.5%	(\$13.6)
Jan-13	\$63.4	\$120.3	53.4%	\$68.6	56.5%	(\$51.7)
Feb-13	\$77.2	\$128.1	60.5%	\$77.2	60.2%	(\$50.9)
Mar-13	\$51.7	\$70.7	73.2%	\$52.4	74.2%	(\$18.2)
Apr-13	\$32.7	\$47.4	69.4%	\$32.7	69.0%	(\$14.7)
May-13	\$41.8	\$90.7	46.1%	\$47.0	51.9%	(\$43.7)
Summary for Planning Period 2012 to 2013						
Total	\$601.9	\$905.8		\$614.0	67.8%	(\$291.8)
Jun-13	\$61.3	\$81.9	74.7%	\$64.1	78.2%	(\$17.8)
Jul-13	\$113.5	\$128.3	88.3%	\$113.5	88.5%	(\$14.74)
Aug-13	\$43.1	\$45.8	94.0%	\$43.1	94.0%	(\$2.74)
Sep-13	\$43.1	\$116.0	52.0%	\$66.7	57.5%	(\$49.28)
Summary for Planning Period 2013 to 2014						
Total	\$260.9	\$372.0		\$287.4	77.3%	(\$84.6)

Figure 13-9 shows the original PJM reported FTR payout ratio by month, excluding excess revenue distribution, for January 2004 through September 2013. The months with payout ratios above 100 percent are overfunded and the months with payout ratios under 100 percent are underfunded. Figure 13-9 also shows the payout ratio after distributing excess revenue across months

within the planning period as well as any unallocated congestion charges. If there are excess revenues in a given month, the excess is distributed to other months within the planning period that were revenue deficient. Unallocated congestion charges are charged to Day-Ahead Operating Reserves when there is negative congestion within a month. The payout ratios for months in the 2012 to 2013 planning period may change if excess revenue is collected in the remainder of the planning period.

Figure 13-9 FTR payout ratio by month, excluding and including excess revenue distribution: January 2004 through September 2013

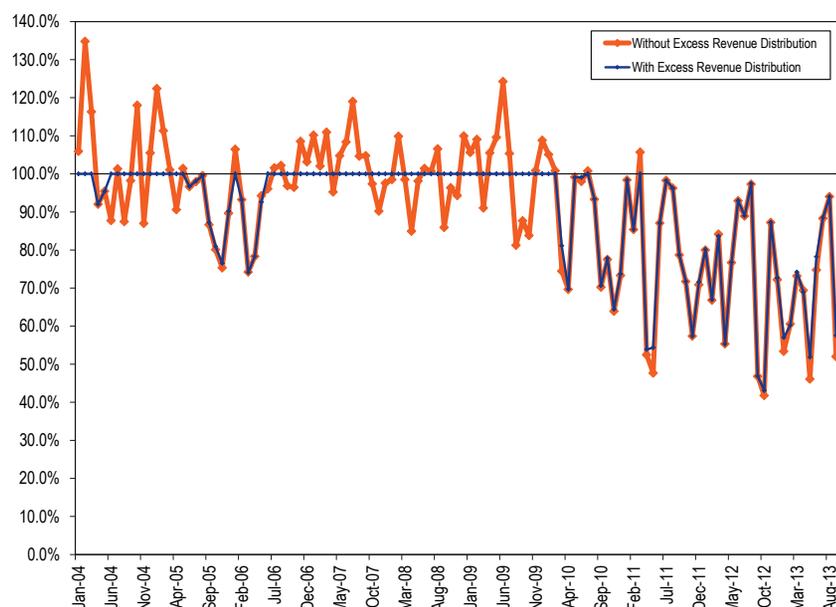


Table 13-14 shows the FTR payout ratio by planning period from the 2003 to 2004 planning period forward. Planning period 2013 to 2014 includes the additional revenue from unallocated congestion charges from Balancing Operating Reserves.

Table 13-14 PJM Reported FTR payout ratio by planning period

Planning Period	FTR Payout Ratio
2003/2004	97.7%
2004/2005	100.0%
2005/2006	90.7%
2006/2007	100.0%
2007/2008	100.0%
2008/2009	100.0%
2009/2010	96.9%
2010/2011	85.0%
2011/2012	80.6%
2012/2013	67.8%
2013/2014	77.3%

*2013/2014 Through 30-Sep-13

FTR Uplift Charge

At the end of the planning period, an uplift charge is applied to FTR holders. This charge is to cover the net of the monthly deficiencies in the target allocations calculated for individual participants. An individual participant's uplift charge is a pro-rata charge, to cover this deficiency, based on their net target allocation with respect to the total net target allocation of all participants with net positive target allocations for the planning period. Participants pay an uplift charge that is a ratio of their share of net positive target allocations to the total net positive target allocations.

The uplift charge is only applied to, and calculated from, members with a net positive target allocation at the end of the planning period. Members with a net negative target allocation have their year-end target allocation set to zero for all uplift calculations. Since participants in the FTR market with net positive target allocations are paying the uplift charge to fully fund FTRs, their payout ratio cannot be 100 percent. The end of planning period payout ratio is calculated as the participant's target allocations minus the uplift charge applied to them divided by their target allocations. The calculations of uplift are structured so that, at the end of the planning period, every participant in the FTR market with a positive net target allocation receives payments based on the same payout ratio. At the end of the planning period and the end of a given month no payout ratio is actually applied to a participant's

target allocations. The payout ratio is simply used as a reporting mechanism to demonstrate the amount of revenue available to pay target allocations and represent the percentage of target allocations a participant with a net positive portfolio has been paid for the planning period. However, this same calculation is not accurate when calculating a single month's payout ratio as currently reported, where the calculation of available revenue is not the same.

The total planning period target allocation deficiency is the sum of the monthly deficiencies throughout the planning period. The monthly deficiency is the difference in the net target allocation of all participants and the total revenue collected for that month. The total revenue paid to FTR holders is based on the hourly congestion revenue collected, which includes hourly M2M, wheel payments and unallocated congestion credits.

Table 13-15 provides a demonstration of how the FTR uplift charge is calculated. In this example it is important to note that the sum of the net positive target allocations is \$32 and the total monthly deficiency is \$10. The uplift charge is structured so that those with higher target allocations pay more of the deficit, which ultimately impacts their net payout. Also, in this example, and in the PJM settlement process, the monthly payout ratio varies for all participants, but the uplift charge is structured so that once the uplift charge is applied the end of planning period payout ratio is the same for all participants.

For the 2012 to 2013 planning period, the total deficiency was \$291.8 million. The top ten participants with the highest target allocations paid 53.6 percent of the total deficiency for the planning period. All of the uplift money is collected from individual participants, and distributed so that every participant experiences the same payout ratio. This means that some participants subsidize others and receive less payout from their FTRs after the uplift is applied, while others receive a subsidy and get a higher payout after the uplift is applied. In this example, participants 1 and 5 are paid less after the uplift charge is applied, while participants 3 and 4 are paid more.

Table 13-15 End of planning period FTR uplift charge example

Participant	Net Target Allocation	Total Monthly Payment	Monthly Deficiency	Uplift Charge	Net Payout	Monthly Payout Ratio	EOPP Payout Ratio
1	\$10.00	\$8.00	\$2.00	\$3.13	\$6.88	80.0%	68.8%
2	(\$4.00)	\$0.00	\$0.00	\$0.00	(\$4.00)	100.0%	100.0%
3	\$15.00	\$10.00	\$5.00	\$4.69	\$10.31	66.7%	68.8%
4	\$3.00	\$1.00	\$2.00	\$0.94	\$2.06	33.3%	68.8%
5	\$4.00	\$3.00	\$1.00	\$1.25	\$2.75	75.0%	68.8%
Total	\$28.00	\$22.00	\$10.00	\$10.00	\$18.00		

Revenue Adequacy Issues and Solutions

PJM Reported Payout Ratio

The payout ratios shown above in Table 13-14 reflect the PJM reported payout ratios for each month of the planning period. These reported payout ratios equal congestion revenue divided by the sum of the net positive and net negative target allocations for each hour of the month. This does not correctly measure the payout ratio actually received by positive target allocation FTR holders in the month, but provides an estimate of the ratio based on the approach to end of planning period calculations, including cross subsidies.

The payout ratio is intended to measure the proportion of the target allocation received by the holders of FTRs with positive target allocations in a month. In fact, the actual monthly payout ratio includes the net negative target allocations as a source of funding for FTRs with net positive target allocations in an hour. Revenue from FTRs with net negative target allocations in an hour are included with congestion revenue when funding FTRs with net positive target allocations.¹⁷ Also included in this revenue is any M2M charge or credit for the month and any excess ARR revenues for the month. The revenue and net target allocations are then summed over the month to calculate the monthly payout ratio. There is no payout ratio applied on a monthly basis, each participant receives a different share of the available revenue based on availability, it is simply used as a reporting mechanism. At the end of a given month, a participant's FTR payments are a proportion of the congestion credits collected, based on the participant's share of the total monthly target

¹⁷ See PJM, "Manual 28: Operating Agreement Accounting," Revision 56 (October 1, 2012), p. 50

allocation. The payout ratio is only used and calculated at the end of the planning period after uplift is applied to each participant. The actual monthly payout ratio received by FTR holders equals congestion revenue plus the net negative target allocations divided by the net positive target allocations for each hour. The actual payout ratio received by the holders of positive target allocation FTRs, reported on a monthly basis, is greater than reported by PJM.

Table 13-16 shows the PJM reported and actual monthly payout ratio for the 2012 to 2013 planning period. In September the PJM reported payout ratio is 3.4 percentage points below the actual payout ratio. On a month to month basis, the payout ratio currently reported by PJM does not take into account all sources of revenue available to pay FTR holders. This provides a slightly overstated level of underfunding on a monthly basis.

Table 13-16 PJM Reported and Actual Monthly Payout Ratios: Calendar year 2013

	Reported Monthly Payout Ratio	Actual Monthly Payout Ratio
Jan-13	57.0%	59.9%
Feb-13	60.3%	62.5%
Mar-13	74.2%	75.5%
Apr-13	68.9%	70.8%
May-13	51.9%	54.2%
Jun-13	78.3%	79.5%
Jul-13	88.8%	89.3%
Aug-13	94.1%	94.7%
Sep-13	57.5%	60.9%

Netting Target Allocations within Portfolios

Currently FTR target allocations are netted within each organization in each hour. This means that within an hour, positive and negative target allocations within an organization's portfolio are offset prior to the application of the payout ratio to the positive target allocation FTRs. The payout ratios are also calculated based on these net FTR positions.

The current method requires those with fewer negative target allocation FTRs to subsidize those with more negative target allocation FTRs. The current

method treats a positive target allocation FTR differently depending on the portfolio of which it is a part. The correct method would treat all FTRs with positive target allocations exactly the same, which would eliminate this form of cross subsidy.

For example, a participant has \$200 of positive target allocation FTRs and \$100 of negative target allocation FTRs and the payout ratio is 80 percent. Under the current method, the positive and negative positions are first netted to \$100 and then the payout ratio is applied. In this example, the holder of the portfolio would receive 80 percent of \$100, or \$80.

The correct method would first apply the payout ratio to FTRs with positive target allocations and then net FTRs with negative target allocations. In the example, the 80 percent payout ratio would first be applied to the positive target allocation FTRs, 80 percent of \$200 is \$160. Then the negative target allocation FTRs would be netted against the positive target allocation FTRs, \$160 minus \$100, so that the holder of the portfolio would receive \$60.

In fact, if done correctly, the payout ratio would also change, although the total net payments made to or from participants would not change. The sum of all positive and negative target allocations is the same in both methods. The net result of this change would be that holders of portfolios with smaller shares of negative target allocation FTRs would no longer subsidize holders of portfolios with larger shares of negative target allocation FTRs.

Under the current system all participants with a net positive target allocation in a month are paid a payout ratio based on each participant's net portfolio position. The correct approach would calculate payouts to FTRs with positive target allocations, without netting in an hour. This would treat all FTRs the same, regardless of a participant's portfolio. This approach would also eliminate the requirement that participants with larger shares of positive target allocation FTRs subsidize participants with larger shares of negative target allocation FTRs.

Elimination of portfolio netting should also be applied to the end of planning period FTR uplift calculation. With this approach, negative target allocations would not offset positive target allocations at the end of the planning period when allocating uplift. The FTR uplift charge would be based on participants' share of the total positive target allocations paid for the planning period.

Table 13-17 shows an example of the effects of calculating FTR payouts on a per FTR basis rather than the current method of portfolio netting for four hypothetical organizations for an example hour. The positive and negative TA columns show the total positive and negative target allocations, calculated separately, for each organization. The percent negative target allocations is the share of the portfolio which is negative target allocation FTRs. The net TA is the net of the positive and negative target allocations for the given hour. The FTR netting payout column shows what a participant would see on their bill, including payout ratio adjustments, under the current method. The per FTR payout column shows what a participant would see on their bill, including payout ratio adjustments, if FTR target allocations were done correctly.

This table shows the effects of a per FTR target allocation calculation on individual participants. The total payout does not change, but the allocation across individual participants does.

The largest change in payout is for participants 1 and 2. Participant 1, who has a large proportion of FTRs with negative target allocations, receives less payment. Participant 2, who has no negative target allocations, receives more payment.

Table 13-17 Example of FTR payouts from portfolio netting and without portfolio netting

Participant	Positive TA	Negative TA	Percent Negative TA	Net TA	FTR Netting Payout (Current)	No Netting Payout (Proposed)	Percent Change
1	\$60.00	(\$40.00)	66.7%	\$20.00	\$8.33	(\$3.33)	(140.0%)
2	\$30.00	\$0.00	0.0%	\$30.00	\$12.50	\$18.33	46.7%
3	\$90.00	(\$20.00)	22.2%	\$70.00	\$29.17	\$35.00	20.0%
4	\$0.00	(\$5.00)	100.0%	(\$5.00)	(\$5.00)	(\$5.00)	0.0%
Total	\$180.00	(\$65.00)	0.0%	\$115.00	\$45.00	\$45.00	0.0%

Table 13-18 shows the total value for the 2012 to 2013 and first month of the 2013 to 2014 planning periods of FTRs with positive and negative target allocations. The Net Positive Target Allocation column shows the value of all portfolios with an hourly net positive value after negative target allocation FTRs are netted against positive target allocation FTRs. The Net Negative Target Allocation column shows the value of all portfolios with an hourly net negative value after negative target allocation FTRs are netted against positive target allocation FTRs. The Per FTR Positive Allocation column shows the total value of the hourly positive target allocation FTRs without netting. The Per Negative Allocation column shows the total value of the hourly negative target allocation FTRs without netting.

The Reported Payout Ratio column is the monthly payout ratio as currently reported by PJM, calculated as total revenue divided by the sum of the net positive and net negative target allocations. The No Netting FTR Payout Ratio column is the payout ratio that participants with positive target allocations would receive if FTR payouts were calculated without portfolio netting, calculated by dividing the total revenue minus the per FTR negative target allocation by the per FTR positive target allocations. The total revenue available to fund the holders of positive target allocation FTRs is calculated by adding any negative target allocations to the congestion credits for that month.

If netting within portfolios were eliminated and the payout ratio were calculated correctly, the payout ratio for the 2012 to 2013 planning period would have been 84.5 percent instead of the reported 67.8 percent and the payout ratio for the first four months of the 2013 to 2014 planning period would have been 89.4 percent instead of 77.3 percent.

Table 13-18 Monthly positive and negative target allocations and payout ratios with and without hourly netting: Planning period 2012 to 2013 and 2013 to 2014

	Net Positive Target Allocations	Net Negative Target Allocations	Per FTR Positive Target Allocations	Per FTR Negative Target Allocations	Total Congestion Revenue	Reported Payout Ratio (Current)	No Netting Payout Ratio (Proposed)
Jan-13	\$129,096,732	(\$8,682,957)	\$233,783,161	(\$113,347,680)	\$68,617,681	57.0%	77.8%
Feb-13	\$135,702,271	(\$7,613,234)	\$259,657,461	(\$131,557,526)	\$77,154,565	60.3%	80.4%
Mar-13	\$74,421,312	(\$3,760,700)	\$146,552,085	(\$75,878,638)	\$52,428,118	74.2%	87.6%
Apr-13	\$50,520,958	(\$3,090,289)	\$108,760,047	(\$61,325,460)	\$32,698,909	68.9%	86.5%
May-13	\$95,352,565	(\$4,678,790)	\$190,798,195	(\$100,110,478)	\$47,015,169	51.9%	77.1%
Jun-13	\$86,723,727	(\$4,836,912)	\$164,066,220	(\$82,101,063)	\$64,060,468	78.3%	89.1%
Jul-13	\$134,302,957	(\$6,017,378)	\$255,724,128	(\$127,113,708)	\$113,548,567	88.8%	94.1%
Aug-13	\$51,545,380	(\$5,741,003)	\$104,601,365	(\$58,796,985)	\$43,059,687	94.1%	97.4%
Sep-13	\$126,168,822	(\$10,172,695)	\$279,972,757	(\$163,977,565)	\$66,719,631	57.5%	82.4%
2012/2013 Total	\$992,878,752	(\$86,061,137)	\$1,897,830,880	(\$990,471,801)	\$614,014,377	67.7%	84.5%
2013/2014 Total	\$398,740,885	(\$26,767,987)	\$804,364,470	(\$431,989,320)	\$287,388,353	77.3%	89.4%

Counter Flow FTRs and Revenues

The current rules create an asymmetry between the treatment of counter flow and prevailing flow FTRs. Counter flow FTR holders make payments over the planning period, in the form of negative target allocations. These negative target allocation FTRs are paid at 100 percent regardless of whether positive target allocation FTRs are paid at less than 100 percent.

A counter flow FTR is profitable if the hourly negative target allocation is smaller than the hourly auction payment they received. A prevailing flow FTR is profitable if the hourly positive target allocation is larger than the auction payment they made.

For a prevailing flow FTR, the target allocation would be subject to a reduced payout ratio, while a counter flow FTR holder would not be subject to the reduced payout ratio. The profitability of the prevailing flow FTRs is affected by the payout ratio while the profitability of the counter flow FTRs is not affected by the payout ratio.

There is no reason to treat counter flow FTRs more favorably than prevailing flow FTRs. Counter flow FTRs should also be affected when the payout ratio

is less than 100 percent. This would mean that counter flow FTRs would pay back an increased amount that mirrors the decreased payments to prevailing flow FTRs. The adjusted payout ratio would evenly divide the burden of underfunding among counter flow FTR holders and prevailing flow FTR holders by increasing negative counter flow target allocations by the same amount it decreases positive target allocations. This increased payout ratio would apply only to negative target allocations associated with counter flow FTRs.

Table 13-19 provides an example of how the counter flow adjustment method would impact a two FTR system. In this example there is \$15 of total congestion revenue available, corresponding to a reported payout ratio of 75 percent and a monthly actual payout ratio of 87.5 percent. In the example, the profit before and after underfunding can be seen in addition to the profit after underfunding with the counter flow adjustment made. As illustrated, a counter flow FTR's profit does not change when underfunding is applied, whereas a prevailing flow FTR's profit decreases. Applying the counter flow adjustment distributes the underfunding penalty evenly to both prevailing and counter flow FTR holders.

Table 13-19 Example implementation of counter flow adjustment method

	Prevailing A-B 10MW	Counter C-D 10MW
Auction Cost	\$50.00	(\$30.00)
Target Allocation	\$40.00	(\$20.00)
Payout	\$30.00	(\$20.00)
Profit without underfunding	(\$10.00)	\$10.00
Profit after underfunding	(\$20.00)	\$10.00
Payout for Positive TA	\$35.00	(\$20.00)
Profit for Positive TA	(\$15.00)	\$10.00
Payout after CF Adjustment	\$36.67	(\$21.67)
Profit after CF Adjustment	(\$13.33)	\$8.33
Profit Difference	\$1.67	(\$1.67)

The result of removing portfolio netting and applying a payout ratio to counter flow FTRs would increase the calculated payout ratio for the first four months of the 2013 to 2014 planning period from the reported 77.2 percent to 92.3 percent.

Figure 13-10 shows the FTR surplus, collected day-ahead, balancing and total congestion payments from January 2005 through September 2013.

Table 13-20 Counter flow FTR payout ratio adjustment impacts


	Positive Target Allocations	Negative Target Allocations	Total Target Allocations	Total Congestion Revenue	Reported Payout Ratio*	Total Revenue Available	Adjusted Counterflow Payout Ratio	Adjusted Counter Flow Revenue Available
Jan-13	\$233,783,161	(\$113,347,680)	\$120,435,482	\$68,617,681	57.0%	\$181,965,360	83.4%	\$194,865,402
Feb-13	\$259,657,461	(\$131,557,526)	\$128,099,935	\$77,154,565	60.2%	\$208,712,090	85.4%	\$221,784,584
Mar-13	\$146,552,085	(\$75,878,638)	\$70,673,447	\$52,428,118	74.2%	\$128,306,756	90.8%	\$133,040,564
Apr-13	\$108,760,047	(\$61,325,460)	\$47,434,587	\$32,698,909	68.9%	\$94,024,369	90.2%	\$98,077,747
May-13	\$190,798,195	(\$100,110,478)	\$90,687,717	\$47,015,169	51.8%	\$147,125,648	82.9%	\$158,212,887
Jun-13	\$164,066,220	(\$82,101,063)	\$81,965,157	\$64,060,468	78.2%	\$146,161,531	91.9%	\$150,770,760
Jul-13	\$255,724,128	(\$127,113,708)	\$128,610,420	\$113,548,567	88.3%	\$240,662,275	95.6%	\$244,362,737
Aug-13	\$104,601,365	(\$58,796,985)	\$45,804,380	\$43,059,687	94.0%	\$101,856,672	98.1%	\$102,592,928
Sep-13	\$279,972,757	(\$163,977,565)	\$115,995,192	\$66,719,631	57.5%	\$230,697,196	87.3%	\$244,550,556
Total 2012/2013	\$1,897,830,880	(\$990,471,801)	\$907,359,079	\$614,537,096	67.7%	\$1,605,008,896	88.6%	\$1,681,443,058
Total 2013/2014	\$804,364,470	(\$431,989,320)	\$372,375,150	\$287,388,353	77.2%	\$719,377,673	92.3%	\$742,276,981

* Reported payout ratios may vary due to rounding differences when netting

Table 13-20 shows the monthly positive, negative and total target allocations.¹⁸ Table 13-20 also shows the total congestion revenue available to fund FTRs, as well as the total revenue available to fund positive target allocation FTR holders on a per FTR basis and on a per FTR basis with counter flow payout adjustments. Implementing this change to the payout ratio for counter flow FTRs would result in an additional \$22.9 million (27.1 percent of underfunding) in revenue available to fund positive target allocations for the first four months of the 2013 to 2014 planning period.

¹⁸ Reported payout ratio may differ between Table 13-18 and Table 13-20 due to rounding differences when netting target allocations and considering each FTR individually.

Figure 13-10 FTR Surplus and the collected Day-Ahead, Balancing and Total congestion: January 2005 through September 2013

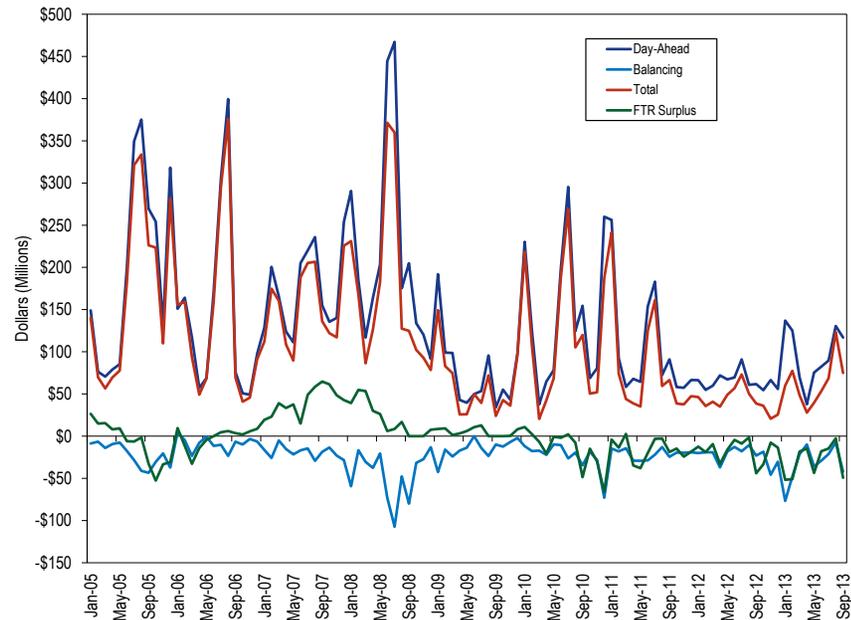

Up-to-Congestion Impacts on FTR Funding

In order to study the impacts of UTCs on FTR funding, the Day-Ahead Market was rerun by PJM with and without UTC transactions for five days in May 2013.

Analysis of PJM's data from these reruns of the May 2, 4, 22, 23, 27 of 2013 day ahead market with and without UTC bids supports the hypothesis that UTC transactions contribute significantly to FTR underfunding.¹⁹ The data indicate that removal of UTCs significantly improves FTR funding for each of the five days. FTR underfunding is a measure of the difference between total FTR target allocations and total congestion dollars available to fund FTRs. When FTR target allocations are greater than total congestion dollars,

¹⁹ These conclusions are based on the five days selected by PJM and the system conditions on those days.

FTRs are considered underfunded, as FTR obligations are less than congestion dollars available. When FTR target allocations are less than congestion dollars available, FTRs are considered fully funded and there is a surplus of congestion dollars. Table 13-21 shows, for each study day, the actual FTR underfunding for the day, the FTR underfunding after the removal of UTC, the change in FTR underfunding caused by the removal of UTC from PJM's day ahead market model.

Analysis of PJM's data shows that for the five days studied, the removal of UTCs changed FTR funding relative to target allocations from a deficit of -\$4.1 million to a net surplus of \$537 thousand, a gain in funding relative to target allocations of \$4.7 million. The magnitude of the effect depends on the day, but the results indicate that the removal of UTC takes PJM FTRs from a state of underfunding to a state of surplus in the five days studied.

Analysis of PJM's data from these reruns shows that removal of UTCs significantly decreases FTR target allocations on the five studied days. Target allocations are a function of FTR MW and the difference in the day ahead CLMP at the FTR source and sink bus. The removal of UTC bids significantly decreased day ahead congestion and CLMPs. This reduction in congestion and CLMPs reduced the target allocations of all FTRs. Table 13-21 shows, for each study day, the actual target allocations, the target allocations after the removal of UTC, and the change in target allocations caused by the removal of UTC from PJM's day ahead market model. PJM's data show that removing UTCs reduced the target allocations over the five study days by \$8.5 million, or 52 percent.

Table 13-21 Changes in target allocations in PJM results by day: May 2, 4, 22, 23, 27 of 2013

Date	Actual Target Allocations	No UTC Target Allocations	Difference in Target Allocations	Change in Target Allocations
2-May-13	\$1,361,464	\$1,060,874	(\$300,590)	(22.1%)
4-May-13	\$934,840	\$137,589	(\$797,250)	(85.3%)
22-May-13	\$7,002,555	\$2,605,640	(\$4,396,915)	(62.8%)
23-May-13	\$6,125,559	\$3,779,988	(\$2,345,571)	(38.3%)
27-May-13	\$817,088	\$196,132	(\$620,956)	(76.0%)
Total	\$16,241,505	\$7,780,223	(\$8,461,282)	(52.1%)

The PJM data show that the inclusion of UTCs significantly increased total day ahead congestion compared to the case where there were no UTCs in the market, and significantly increased (made balancing charges more negative) the real time balancing congestion adjustment offset to day ahead total congestion compared to the case with no UTCs.

Table 13-22 Changes in FTR funding in PJM results by day: May 2, 4, 22, 23, 27 of 2013

	Actual Underfunding	No UTC Underfunding	Difference in Underfunding	Change in Underfunding
2-May-13	(\$456,443)	(\$424,086)	\$32,358	(7.1%)
4-May-13	(\$305,854)	\$124,345	\$430,200	(140.7%)
22-May-13	(\$1,758,420)	\$1,175,869	\$2,934,289	(166.9%)
23-May-13	(\$1,874,367)	(\$631,962)	\$1,242,406	(66.3%)
27-May-13	(\$38,119)	(\$24,031)	\$14,089	(37.0%)
Total	(\$4,433,204)	\$220,137	\$4,653,341	(105.0%)

Up-to-Congestion Transactions and FTR Forfeitures

Currently there is no FTR forfeiture rule implemented for Up-to-Congestion Transactions (UTCs). A proposed tariff change that would apply the FTR forfeiture rule to UTCs is pending at FERC.²⁰ The FTR forfeiture rule should be applied to UTCs in the same way it is applied to INCs and DEC. The goal of the rule is to prevent the use of virtual bids (generally unprofitable virtual bids) to increase Day-Ahead congestion on an FTR path in order to increase the value of the FTRs. The proposed penalty should be the same as it is for

²⁰ See FERC Docket No. ER13-11654.

the INC and DEC rule, the forfeiture of any profits from FTRs whose value is affected by a UTC with the same owner.

However the rule submitted by PJM, currently under review by FERC, would not be consistent with the application of the current forfeiture rule for INCs and DEC. Under PJM's proposed method the simple net dfax of the UTC transaction is the only consideration for forfeiture, representing the contract path of the UTC transaction. Under this method, the net dfax is the sink dfax of the UTC minus the source dfax of the UTC. The net dfax alone cannot be used as an indication of helping or hurting a constraint, rather, the direction of the constraint must also be considered. In addition, the PJM method only considers UTC transactions whose net dfax is positive. This logic not only passes transactions that should fail the forfeiture test, but fails transactions that should pass the forfeiture test.

PJM's logic also does not hold when one of the points of the UTC is far from the constraint. In this case, one side of the UTC would have a dfax of zero, indicating no connection to the constraint being considered. If a point of the UTC transaction has no connection to the constraint, there can be no power flow directly between the two UTC points, so the simple net dfax, which relies on the contract path of the UTC, cannot logically be used in this case to indicate whether a UTC is eligible for forfeiture. Under the IMM method this UTC would be treated as an INC or DEC and follow the same rules as the current INC/DEC FTR forfeiture rule.

Figure 13-11 shows an example of the two proposed FTR forfeiture rules for UTC transactions. In both cases the net dfax of the UTC is taken. Under the PJM method the net dfax of the UTC is calculated by subtracting the dfax of the sink bus A (0.2) from the dfax of the source bus B (0.5) to get a net dfax of -0.3. If this net dfax value is greater than 0.75 the UTC is subject to forfeiture. Under the IMM method, the net dfax is calculated by subtracting the dfax of sink A (0.2) from the dfax of source bus B (0.5) to get a net dfax of 0.3. This net dfax is then compared to the withdrawal point with the largest impact on the constraint. The IMM method compares the net UTC dfax to a withdrawal because the UTC is a net injection. In this example, the net dfax is 0.3 and it is

compared to the largest withdrawal dfax at C (-0.5). The absolute value of the difference is calculated from these two points to determine if the UTC fails the FTR forfeiture rule. In this case, the absolute value of the difference is the dfax of bus C (-0.5) minus the net UTC dfax (0.3) for a total impact of 0.8, which is over the 0.75 threshold for the FTR forfeiture rule. The result is that this UTC fails the FTR forfeiture rule. The IMM proposes to apply the same rules to UTC transactions as is applied to INCs and DECs, treat the UTC as equivalent to an INC or a DEC depending on its net impact. A UTC transaction is essentially a paired INC/DEC, it has a net impact on the flow across a constraint, as an INC or DEC does. While total system power balance is maintained by a UTC, local flows may change based on the UTC's net impact on a constraint. The IMM method captures this impact.

Figure 13-11 Illustration of UTC FTR forfeiture rule


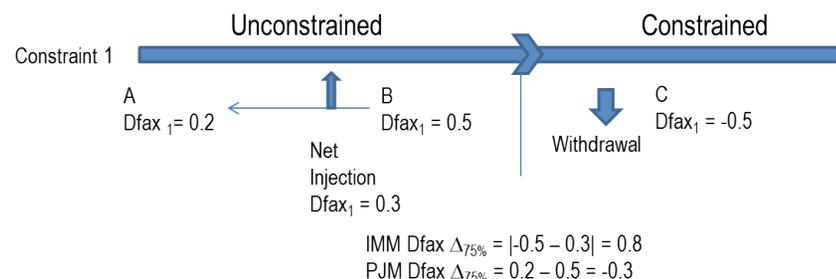


Figure 13-12 demonstrates where the assumption of contract path for UTCs in PJM's method does not hold with actual system conditions when either the source or sink of the UTC does not have any impact on the constraint being considered. In this case, the UTC is effectively an INC or a DEC relative to the constraint, as the other end of the UTC has no impact on the constraint. However, the PJM approach would not treat the UTC as an INC or DEC, despite the effective absence of the other end of the UTC. This is a flawed result.

As demonstrated in Figure 13-12, the UTC is no different than in INC on the constraint be considered. In the PJM method this UTC would pass the FTR forfeiture rule. The net dfax would be calculated as the dfax of bus B (0)

minus the dfax of bus A (0.25) for a net dfax of -0.25, with no comparison to any withdrawal bus. Since the dfax is negative, it would pass the PJM FTR forfeiture rule. Under the IMM's method, the net dfax is calculated as an injection with a dfax of 0.25, and then the absolute value of the difference is calculated between that injection and the dfax of the largest withdrawal on the constraint. In this example that is bus C, with a dfax of -0.5. The result is an absolute value of the dfax difference of 0.75, meaning that this UTC fails the FTR forfeiture test.

Figure 13-12 Illustration of UTC FTR Forfeiture rule with one point far from constraint

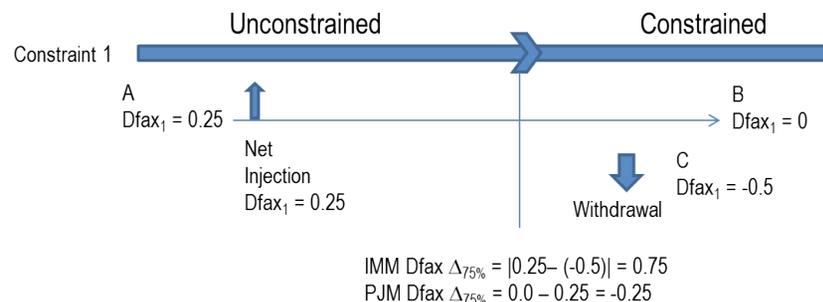

The MMU recommends that the FTR forfeiture rule be applied to UTCs in the same way it is applied to INCs and DECs.

Auction Revenue Rights

ARRs are financial instruments that entitle the holder to receive revenues or to pay charges based on nodal price differences determined in the Annual FTR Auction.²¹ These price differences are based on the bid prices of participants in the Annual FTR Auction. The auction clears the set of feasible FTR bids which produce the highest net revenue. ARR revenues are a function of FTR auction participants' expectations of locational congestion price differences and the associated level of revenue sufficiency.²²

²¹ These nodal prices are a function of the market participants' annual FTR bids and binding transmission constraints. An optimization algorithm selects the set of feasible FTR bids that produces the most net revenue.

²² For a more complete explanation, see the 2012 State of the Market Report for PJM, Volume II, Section 12, "FTRs."

Market Structure

ARRs have been available to network service and firm, point-to-point transmission service customers since June 1, 2003, when the annual ARR allocation was first implemented for the 2003 to 2004 planning period. The initial allocation covered the Mid-Atlantic Region and the AP Control Zone. For the 2006 to 2007 planning period, the choice of ARRs or direct allocation FTRs was available to eligible market participants in the AEP, DAY, DLCO and Dominion control zones. For the 2007 to 2008 and subsequent planning periods through the 2013 to 2014 planning period, all eligible market participants were allocated ARRs.

ARR Reassignment for Retail Load Switching

PJM rules provide that when load switches between LSEs during the planning period, a proportional share of associated ARRs that sink into a given control or load aggregation zone is automatically reassigned to follow that load.²³ ARR reassignment occurs daily only if the LSE losing load has ARRs with a net positive economic value to that control zone. An LSE gaining load in the same control zone is allocated a proportional share of positively valued ARRs within the control zone based on the shifted load. ARRs are reassigned to the nearest 0.001 MW and any MW of load may be reassigned multiple times over a planning period. Residual ARRs are also subject to the rules of ARR reassignment. This practice supports competition by ensuring that the offset to congestion follows load, thereby removing a barrier to competition among LSEs and, by ensuring that only ARRs with a positive value are reassigned, preventing an LSE from assigning poor ARR choices to other LSEs. However, when ARRs are self scheduled as FTRs, these underlying self-scheduled FTRs do not follow load that shifts while the ARRs do follow load that shifts, and this may diminish the value of the ARRs for the receiving LSE compared to the total value held by the original ARR holder.

There were 52,825 MW of ARRs associated with approximately \$498,800 of revenue that were reassigned in the 2012 to 2013 planning period. In the first

four months of the 2013 to 2014 planning period, there were 25,157 MW of ARRs associated with approximately \$125,800 of revenue.

Table 13-23 summarizes ARR MW and associated revenue automatically reassigned for network load in each control zone where changes occurred between June 2012 and September 2013.

Table 13-23 ARRs and ARR revenue automatically reassigned for network load changes by control zone: June 1, 2012, through September 30, 2013

Control Zone	ARRs Reassigned (MW-day)		ARR Revenue Reassigned [Dollars (Thousands) per MW-day]	
	2012/2013 (12 months)	2013/2014 (4 months)*	2012/2013 (12 months)	2013/2014 (4 months)*
AECO	581	597	\$3.0	\$2.3
AEP	4,656	1,617	\$58.9	\$14.2
AP	3,518	876	\$84.3	\$19.0
ATSI	5,314	2,437	\$8.3	\$2.6
BGE	3,203	2,056	\$37.3	\$14.6
ComEd	11,824	5,114	\$170.9	\$21.1
DAY	589	164	\$0.9	\$0.3
DEOK	2,979	2,126	\$1.6	\$2.9
DLCO	2,708	2,996	\$19.1	\$6.7
DPL	1,989	1,071	\$11.5	\$7.4
Dominion	0	5	\$0.0	\$0.1
EKPC	NA	0	NA	\$0.0
JCPL	1,373	710	6	\$3.3
Met-Ed	1,107	393	9	\$3.1
PECO	3,416	494	23	\$4.1
PENELEC	920	408	8	\$4.6
PPL	3,198	1,395	21	\$5.3
PSEG	2,313	1,044	17	\$10.1
Pepco	3,073	1,474	21	\$4.2
RECO	67	179	0	\$0.1
Total	52,825	25,157	\$499.8	\$125.8

* Through 30-Sep-2013

²³ See PJM, "Manual 6: Financial Transmission Rights," Revision 12 (July 1, 2009), p. 28.

Residual ARR

Only ARR holders that had their Stage 1A or Stage 1B ARRs prorated are eligible to receive residual ARRs. Residual ARRs are available if additional transmission system capability is added during the planning period after the annual ARR allocation. This additional transmission system capability would not have been accounted for in the initial annual ARR allocation, but it enables the creation of residual ARRs. Residual ARRs are effective on the first day of the month in which the additional transmission system capability is included in FTR auctions and exist until the end of the planning period. For the following planning period, any residual ARRs are available as ARRs in the annual ARR allocation. Stage 1 ARR holders have a priority right to ARRs. Residual ARRs are a separate product from incremental ARRs.

Effective August 1, 2012, as ordered by FERC in Docket No. EL12-50-000, in addition to new transmission, residual ARRs are now available for eligible participants when a transmission outage was modeled in the Annual ARR Allocation, but the transmission facility becomes available during the modeled year. These residual ARRs are determined the month before the effective date, are only available on paths prorated in Stage 1 of the Annual ARR Allocation and are allocated automatically to participants. Residual ARRs are effective for single, whole months and cannot be self scheduled. ARR target allocations are based on the clearing prices from FTR obligations in the effective monthly auction, may not exceed zonal Network Services Peak Load or Firm Transmission Reservation Levels and are only available up to the prorated ARR MW capacity as allocated in the Annual ARR Allocation.

Table 13-24 shows the Residual ARRs automatically allocated to eligible participants, along with the target allocations from the effective month.

Table 13-24 Residual ARR allocation volume and target allocation January 2013 through September 2013

Month	Bid and Requested Volume (MW)	Cleared Volume (MW)	Cleared Volume	Target Allocation
Jan-13	6,773.0	1,547.2	22.8%	\$488,251
Feb-13	1,567.4	1,493.7	95.3%	\$229,856
Mar-13	5,351.2	1,522.7	28.5%	\$286,193
Apr-13	5,452.1	1,608.9	29.5%	\$325,662
May-13	6,054.7	1,647.4	27.2%	\$282,425
Jun-13	10,864.1	1,272.7	11.7%	\$667,291
Jul-13	10,936.9	1,323.7	12.1%	\$714,675
Aug-13	9,357.2	767.2	8.2%	\$236,885
Sep-13	1,855.0	402.9	21.7%	\$85,884
Total	58,211.6	11,586.4	19.9%	\$3,317,123

Market Performance

Revenue

As ARRs are allocated to qualifying customers rather than sold, there is no ARR revenue comparable to the revenue that results from the FTR auctions.

Revenue Adequacy

As with FTRs, revenue adequacy for ARRs must be distinguished from the adequacy of ARRs as an offset to total congestion. Revenue adequacy is a narrower concept that compares the revenues available to ARR holders to the value of ARRs as determined in the Annual FTR Auction. ARRs have been revenue adequate for every auction to date. Customers that self schedule ARRs as FTRs have the same revenue adequacy characteristics as all other FTRs.

The adequacy of ARRs as an offset to total congestion compares ARR revenues to total congestion sinking in the participant's load zone as a measure of the extent to which ARRs offset market participants' actual, total congestion into their zone. Customers that self schedule ARRs as FTRs provide the same offset to congestion as all other FTRs.

ARR holders received a projected \$626.7 million in credits from the FTR auctions during the 2012 to 2013 planning period, with a projected average

hourly ARR credit of \$0.66 per MW. During the comparable 2011 to 2012 planning period, ARR holders received \$1,055.9 million in ARR credits with an average hourly ARR credit of \$1.06 per MW.

Table 13-25 lists projected ARR target allocations from the Annual ARR Allocation, and net revenue sources from the Annual and Monthly Balance of Planning Period FTR Auctions for the 2012 to 2013 and the 2013 to 2014 planning periods.

Table 13-25 Projected ARR revenue adequacy (Dollars (Millions)): Planning periods 2012 to 2013 and 2013 to 2014

	2012/2013	2013/2014
Total FTR auction net revenue	\$626.7	\$559.0
Annual FTR Auction net revenue	\$602.9	\$558.4
Monthly Balance of Planning Period FTR Auction net revenue*	\$23.9	\$0.6
ARR target allocations	\$570.5	\$503.4
ARR credits	\$570.5	\$503.4
Surplus auction revenue	\$56.2	\$55.6
ARR payout ratio	100%	100%
FTR payout ratio*	67.8%	77.3%


* Shows twelve months for 2012/2013 and four months for 2013/2014.

ARR and FTR Revenue and Congestion

FTR Prices and Zonal Price Differences

As an illustration of the relationship between FTRs and congestion, Figure 13-13 shows Annual FTR Auction prices and an approximate measure of day-ahead and real-time congestion for each PJM control zone for the 2013 to 2014 planning period through September 30, 2013. The day-ahead and real-time congestion are based on the difference between zonal congestion prices and Western Hub congestion prices.

Figure 13-13 Annual FTR Auction prices vs. average day-ahead and real-time congestion for all control zones relative to the Western Hub: Planning period 2013 to 2014 through September 30, 2013

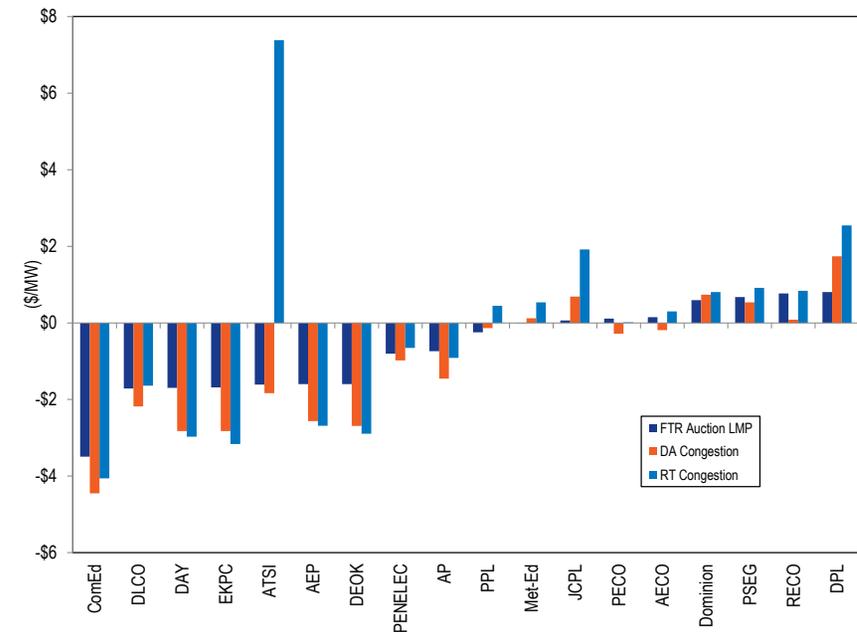

Effectiveness of ARRs as an Offset to Congestion

One measure of the effectiveness of ARRs as an offset to congestion is a comparison of the revenue received by the holders of ARRs and the congestion paid by the holders of ARRs in both the Day-Ahead Energy Market and the Balancing Energy Market. The revenue which serves as an offset for ARR holders comes from the FTR auctions while the revenue for FTR holders is provided by the congestion payments from the Day-Ahead Energy Market and the balancing energy market. During the first ten months of the 2012 to 2013 planning period, the total revenues received by the holders of all ARRs and FTRs offset 92.6 percent of the total congestion costs within PJM.

The comparison between the revenue received by ARR holders and the actual congestion experienced by these ARR holders in the Day-Ahead Energy Market and the balancing energy market is presented by control zone in Table 13-26. ARRs and self-scheduled FTRs that sink at an aggregate are assigned to a control zone if applicable.²⁴ Total revenue equals the ARR credits and the FTR credits from ARRs which are self scheduled as FTRs. The ARR credits do not include the ARR credits for the portion of any ARR that was self scheduled as an FTR since ARR holders purchase self-scheduled FTRs in the Annual FTR Auction and that revenue is then paid back to the ARR holders, netting the transaction to zero. ARR credits are calculated as the product of the ARR MW (excludes any self-scheduled FTR MW) and the cleared price for the ARR path from the Annual FTR Auction.

FTR credits equal FTR target allocations adjusted by the FTR payout ratio. The FTR target allocation is equal to the product of the FTR MW and the congestion price differences between sink and source that occur in the Day-Ahead Energy Market. FTR credits are paid to FTR holders and may be less than the target allocation. The FTR payout ratio was 77.3 percent of the target allocation for the 2013 to 2014 planning period through September 30, 2013. The target allocation is not a guarantee of payment nor does it reflect congestion incurred on a particular FTR path. The target allocation is used to set a cap on path specific FTR payouts.

The Congestion column shows the amount of congestion in each control zone from the Day-Ahead Energy Market and the balancing energy market and includes only the congestion costs incurred by the organizations that hold ARRs or self-scheduled FTRs. The last column shows the difference between the total revenue and the congestion for each ARR control zone sink.

²⁴ For Table 13-26 through Table 13-28, aggregates are separated into their individual bus components and each bus is assigned to a control zone. The "External" Control Zone includes all aggregate sinks that are external to PJM or buses that cannot otherwise be assigned to a specific control zone.

Table 13-26 ARR and self-scheduled FTR congestion offset (in millions) by control zone: 2013 to 2014 planning period through September 30, 2013²⁵

Control Zone	ARR Credits	Self-Scheduled FTR Credits	Total Revenue	Congestion	Total Revenue - Congestion Difference	Percent Offset
AECO	\$4.1	\$0.0	\$4.1	\$0.4	\$3.7	>100%
AEP	\$32.1	\$17.8	\$49.9	\$3.7	\$51.5	>100%
APS	\$38.9	\$7.9	\$46.8	(\$0.1)	\$49.2	>100%
ATSI	\$5.8	\$0.1	\$5.9	\$0.4	\$5.5	>100%
BGE	\$29.3	\$0.5	\$29.8	\$2.1	\$27.8	>100%
ComEd	\$74.6	\$0.0	\$74.6	\$3.5	\$71.1	>100%
DAY	\$4.0	(\$0.0)	\$4.0	(\$0.1)	\$4.1	>100%
DEOK	\$3.7	\$0.5	\$4.2	(\$0.1)	\$4.5	>100%
DLCO	\$1.9	(\$0.0)	\$1.8	\$0.0	\$1.8	>100%
Dominion	\$7.5	\$21.6	\$29.1	(\$0.0)	\$35.5	>100%
DPL	\$17.1	\$1.6	\$18.7	\$1.1	\$18.1	>100%
EKPC	\$0.6	\$0.0	\$0.6	\$0.2	\$0.5	>100%
External	\$2.6	(\$0.0)	\$2.6	\$0.4	\$2.2	>100%
JCPL	\$6.6	\$0.0	\$6.6	\$1.3	\$5.3	>100%
Met-Ed	\$6.7	\$0.1	\$6.8	\$0.5	\$6.3	>100%
PECO	\$22.3	\$0.0	\$22.3	\$0.2	\$22.2	>100%
PENELEC	\$12.2	(\$0.0)	\$12.2	\$0.6	\$11.6	>100%
Pepco	\$16.0	\$1.0	\$17.1	\$2.6	\$14.8	>100%
PPL	\$9.4	\$0.1	\$9.5	\$1.4	\$8.2	>100%
PSEG	\$37.2	\$1.1	\$38.3	\$1.7	\$36.9	>100%
RECO	\$0.1	\$0.0	\$0.1	\$0.1	\$0.0	>100%
Total	\$333.0	\$56.2	\$389.2	\$19.5	\$386.2	>100%

Effectiveness of ARRs and FTRs as an Offset to Congestion

Table 13-27 compares the revenue for ARR and FTR holders and the congestion in both the Day-Ahead Energy Market and the balancing energy market for the 2012 to 2013 planning period. This compares the total offset provided by all ARRs and all FTRs to the total congestion costs within each control zone. ARRs and FTRs that sink at an aggregate or a bus are assigned to a control zone if applicable. ARR credits are calculated as the product of the ARR MW and the cleared price of the ARR path from the Annual FTR Auction. The "FTR Credits" column represents the total FTR target allocation for FTRs that sink in each control zone from the applicable FTRs from the Long Term FTR Auction, Annual FTR Auction, the Monthly Balance of Planning Period FTR Auctions, and any FTRs that were self scheduled from ARRs, adjusted by the FTR payout

²⁵ The "External" zone was labeled as "PJM" in previous State of the Market Reports. The name was changed to "External" to clarify that this component of congestion is accrued on energy flows between external buses and PJM interfaces.

ratio. The FTR target allocation is equal to the product of the FTR MW and congestion price differences between sink and source that occur in the Day-Ahead Energy Market. FTR credits are the product of the FTR target allocations and the FTR payout ratio. The FTR payout ratio was 77.3 percent of the target allocation for the 2013 to 2014 planning period through September 30, 2013. The “FTR Auction Revenue” column shows the amount paid for FTRs that sink in each control zone from the applicable FTRs from the Long Term FTR Auction, the Annual FTR Auction, the Monthly Balance of Planning Period FTR Auctions and any ARRs that were self scheduled as FTRs. ARR holders that self schedule FTRs purchased the FTRs in the Annual FTR Auction and that revenue was then paid back to those ARR holders through ARR credits on a monthly basis throughout the planning period, ultimately netting the transaction to zero. The total ARR and FTR offset is the sum of the ARR credits and the FTR credits minus the FTR auction revenue. The “Congestion” column shows the total amount of congestion in the Day-Ahead Energy Market and the Balancing Energy Market in each control zone.²⁶ The last column shows the difference between the total ARR and FTR offset and the congestion cost for each control zone.

Table 13-27 ARR and FTR congestion offset (in millions) by control zone: 2013 to 2014 planning period through September 30, 2013

Control Zone	ARR Credits	FTR Credits	FTR Auction Revenue	Total ARR and FTR Offset	Congestion	Total Offset - Congestion Difference	Percent Offset
AECO	\$4.1	\$0.6	\$4.3	\$0.4	\$3.9	(\$3.6)	9.0%
AEP	\$83.4	\$41.6	\$104.4	\$20.6	\$45.3	(\$24.7)	45.5%
APS	\$63.5	\$12.3	\$32.4	\$43.5	\$30.1	\$13.5	>100%
ATSI	\$5.9	\$13.8	(\$0.1)	\$19.7	(\$22.6)	\$42.4	>100%
BGE	\$30.5	\$15.7	\$30.2	\$16.0	\$19.8	(\$3.8)	80.8%
ComEd	\$84.2	\$42.3	\$60.9	\$65.6	\$67.9	(\$2.3)	96.6%
DAY	\$4.0	\$2.3	\$4.0	\$2.4	\$1.6	\$0.7	>100%
DEOK	\$4.4	\$3.4	\$4.7	\$3.1	(\$2.6)	\$5.6	>100%
DLCO	\$2.1	\$0.1	\$0.9	\$1.3	\$0.8	\$0.5	>100%
Dominion	\$94.9	\$52.0	\$134.1	\$12.8	\$32.1	(\$19.3)	39.8%
DPL	\$19.3	\$21.4	\$14.8	\$25.9	\$13.9	\$11.9	>100%
EKPC	\$2.1	\$0.1	\$2.9	(\$0.7)	(\$1.1)	\$0.4	0.0%
External	\$3.2	(\$0.9)	\$1.9	\$0.4	(\$0.5)	\$0.8	>100%
JCPL	\$6.6	\$13.5	\$7.3	\$12.8	\$12.5	\$0.3	>100%
Met-Ed	\$6.9	\$6.7	\$8.3	\$5.2	\$2.2	\$3.0	>100%
PECO	\$22.4	\$3.9	\$17.9	\$8.4	(\$2.8)	\$11.2	>100%
PENELEC	\$12.1	\$16.7	\$43.7	(\$14.9)	\$15.1	(\$30.0)	0.0%
Pepco	\$19.3	\$23.8	\$71.6	(\$28.5)	\$25.4	(\$53.8)	0.0%
PPL	\$9.5	\$7.5	\$1.6	\$15.5	\$0.9	\$14.5	>100%
PSEG	\$39.4	\$13.9	\$44.4	\$9.0	\$13.4	(\$4.4)	66.9%
RECO	\$0.1	(\$0.3)	(\$0.8)	\$0.6	\$0.9	(\$0.3)	65.2%
Total	\$518.0	\$290.7	\$589.5	\$219.2	\$256.3	(\$37.2)	85.5%

Table 13-28 shows the total offset due to ARRs and FTRs for the entire 2012 to 2013 planning period and the 2013 to 2014 planning period through September 30, 2013.

Table 13-28 ARR and FTR congestion hedging (in millions): Planning periods 2012 to 2013 and 2013 to 2014 through September 30, 2013²⁷

Planning Period	ARR Credits	FTR Credits	FTR Auction Revenue	Total ARR and FTR Offset	Congestion	Total Offset - Congestion Difference	Percent Offset
2012/2013	\$577.2	\$610.3	\$654.1	\$533.4	\$575.9	(\$42.5)	92.6%
2013/2014	\$518.0	\$290.7	\$589.5	\$219.2	\$256.3	(\$37.2)	85.5%

²⁶ The total zonal congestion numbers were calculated as of November 6, 2013 and may change as a result of continued PJM billing updates.

²⁷ The FTR credits do not include after-the-fact adjustments. For the 2013 to 2014 planning period, the ARR credits were the total credits allocated to all ARR of this planning period, and the FTR Auction Revenue includes the net revenue in the Monthly Balance of Planning Period FTR Auctions for the planning period and the portion of Annual FTR Auction revenue distributed to the entire planning period.

