


Appendix A PJM Geography

In 2015, the PJM footprint included 20 control zones located in Delaware, Illinois, Indiana, Kentucky, Maryland, Michigan, New Jersey, North Carolina, Ohio, Pennsylvania, Tennessee, Virginia, West Virginia and the District of Columbia (Figure A-1).

Figure A-1 PJM's footprint and its 20 control zones

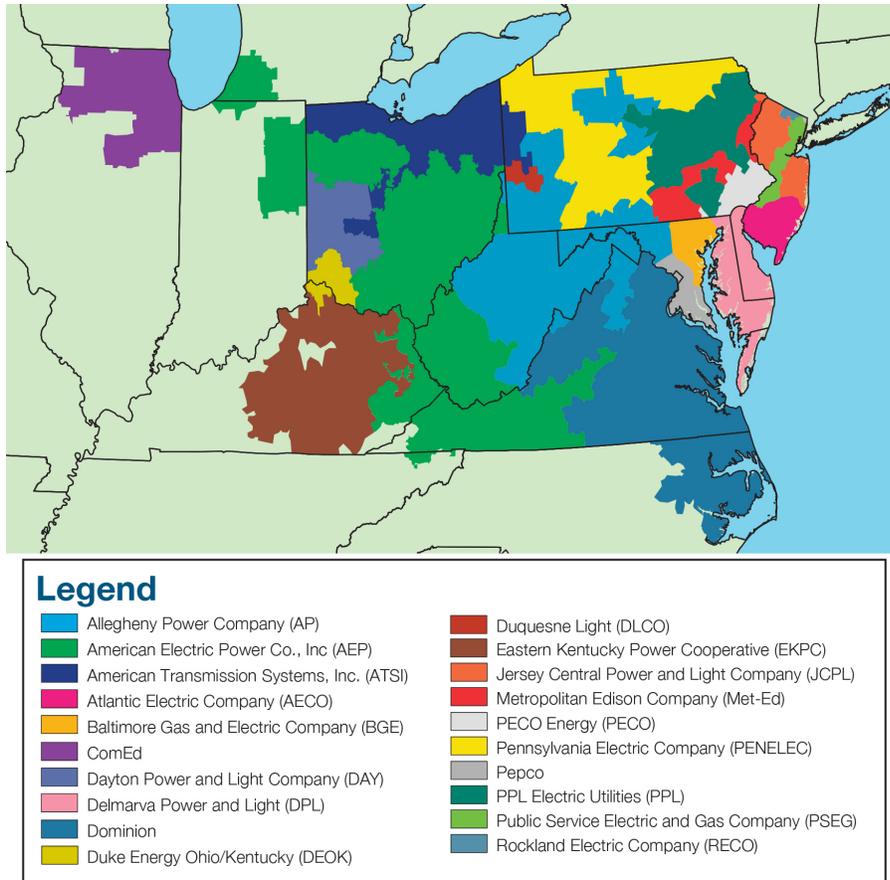

Analysis of 2015 market results includes comparisons to market results in prior years. In 2015 and 2014 no changes were made to the PJM footprint. In 2013, PJM integrated the Eastern Kentucky Power Cooperative (EKPC) Control Zone. In 2012, PJM integrated the Duke Energy Ohio and Kentucky (DEOK) Control Zone. In 2011, PJM integrated the ATSI Control Zone. In 2006 through 2010, the PJM footprint was stable. In 2004 and 2005, PJM integrated five new control zones, three in 2004 and two in 2005.

Figure A-2 shows the eight phases corresponding to market integration dates:¹

- **Phase 1 (2004).** The four-month period from January 1, through April 30, 2004, during which PJM was comprised of the Mid-Atlantic Region, including its 11 zones, and the Allegheny Power Company (AP) Control Zone.^{2 3}

- **Phase 2 (2004).** The five-month period from May 1, through September 30, 2004, during which PJM was comprised of the Mid-Atlantic Region, including its 11 zones, the AP Control Zone and the ComEd Control Area.⁴

- **Phase 3 (2004).** The three-month period from October 1, through December 31, 2004, during which PJM was comprised of the Mid-Atlantic Region, including its 11 zones, the AP Control Zone and the ComEd Control Zone plus the American Electric Power Control Zone (AEP) and The Dayton Power & Light Company Control Zone (DAY). The ComEd Control Area became the ComEd Control Zone on October 1.

- **Phase 4 (2005).** The four-month period from January 1, through April 30, 2005, during which PJM was comprised of the Mid-Atlantic Region, including its 11 zones, the AP Control Zone, the ComEd Control Zone, the AEP

¹ See the *2004 State of the Market Report* (March 8, 2005) for more detailed descriptions of Phases 1, 2 and 3 and the *2005 State of the Market Report* (March 8, 2006) for more detailed descriptions of Phases 4 and 5.

² The Mid-Atlantic Region is comprised of the AECO, BGE, DPL, JCPL, Met-Ed, PECO, PENELEC, Pepco, PPL, PSEG and RECO control zones.


³ Zones, control zones and control areas are geographic areas that customarily bear the name of a large utility service provider operating within their boundaries. Names apply to the geographic area, not to any single company. The geographic areas did not change with the formalization of these concepts during PJM integrations. For simplicity, zones are referred to as control zones for all phases. The only exception is ComEd which is called the ComEd Control Area for Phase 2 only.

⁴ During the five-month period May 1, through September 30, 2004, the ComEd Control Zone (ComEd) was called the Northern Illinois Control Area (NICA).

Control Zone and the DAY Control Zone plus the Duquesne Light Company (DLCO) Control Zone which was integrated into PJM on January 1, 2005.

- **Phase 5 (2005 through 2011).** The period from May 1, 2005, through May 31, 2011, during which PJM was comprised of the Phase 4 elements plus the Dominion Control Zone which was integrated into PJM on May 1, 2005.
- **Phase 6 (2011).** The period from June 1, through December 31, 2011, during which PJM was comprised of the Phase 5 elements plus the ATSI Control Zone which was integrated into PJM on June 1, 2011.
- **Phase 7 (2012).** The period from January 1, 2012, through May 31, 2013, during which PJM was comprised of the Phase 6 elements plus the DEOK Control Zone which was integrated into PJM on January 1, 2012.
- **Phase 8 (2013 through the present).** The period from June 1, 2013, through the present, during which PJM was comprised of the Phase 7 elements plus the EKPC Control Zone which was integrated into PJM on June 1, 2013.

Figure A-2 PJM integration phases

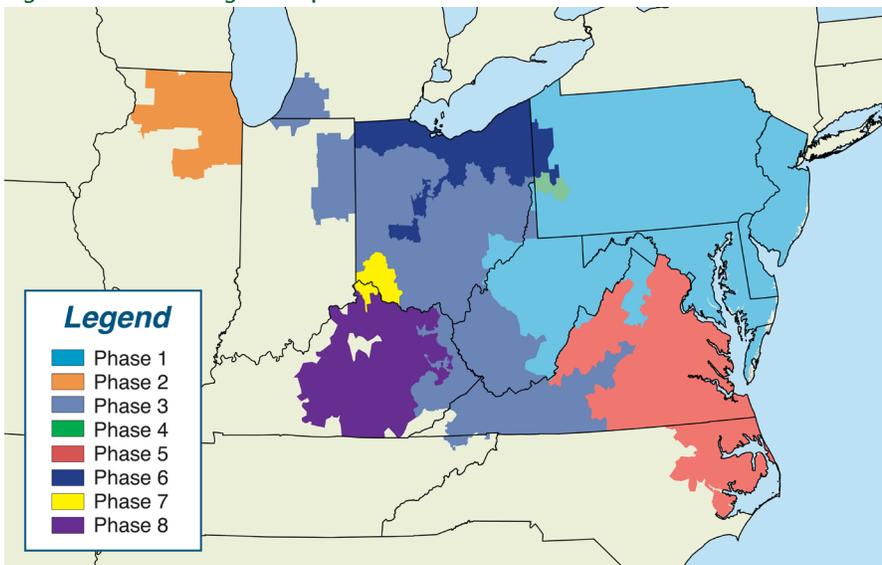


A locational deliverability area (LDA), defined in the RPM Capacity Market, is a Control Zone, part of a Control Zone, or a combination of Control Zones within PJM with defined internal generation and defined transmission capability to import capacity.⁵

Figure A-3 shows LDAs that are combinations of Control Zones. Figure A-4 and Figure A-5 show LDAs that are part of a Control Zone.

⁵ OATT Attachment DD § 2.38.

Figure A-3 PJM locational deliverability areas

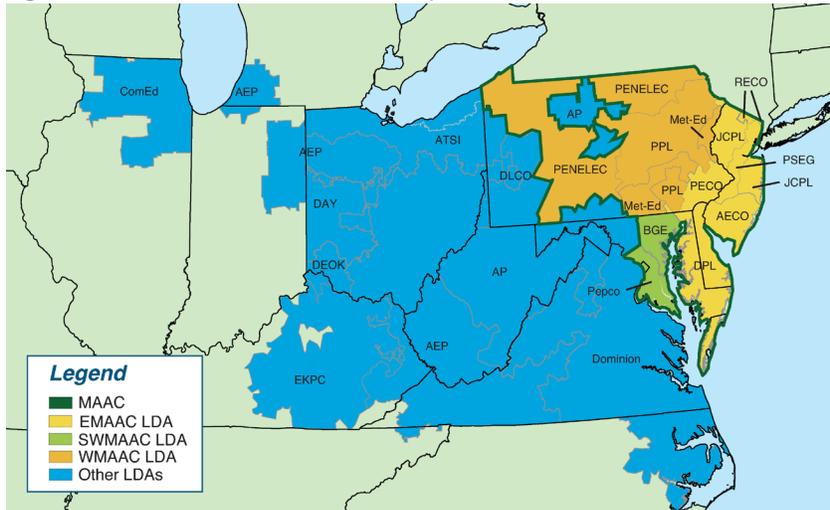

In PJM's Reliability Pricing Model (RPM) Auctions, an LDA becomes a separate market when it cannot meet its reliability requirements through a combination of economic merit order imports and internal capacity without the purchase of out of merit capacity internal capacity. The regional transmission organization (RTO) market comprises the entire PJM footprint, unless an LDA is constrained. Each constrained LDA or group of LDAs is a separate market with a separate clearing price, and the Rest of RTO market is the balance of the footprint.

For the 2007/2008 and 2008/2009 Base Residual Auctions, the defined markets were RTO, EMAAC and SWMAAC. For the 2009/2010 Base Residual Auction, the defined markets were RTO, MAAC+APS and SWMAAC. The MAAC+APS LDA consists of the WMAAC, EMAAC, and SWMAAC LDAs, as shown in Figure A-3, plus the Allegheny Power System (APS or AP) Zone as shown in Figure A-1. For the 2010/2011 Base Residual Auction, the defined markets were RTO and DPL South. The DPL South LDA is shown in Figure A-4. For the 2011/2012 Base Residual Auction, the only defined market was RTO. For the 2012/2013 Base Residual Auction, the defined markets were RTO, MAAC, EMAAC, PSEG North, and DPL South. The PSEG North LDA is shown in Figure A-4. For the 2013/2014 Base Residual Auction, the defined markets were RTO, MAAC, EMAAC, and Pepco. For the 2014/2015 Base Residual Auction, the defined markets were RTO, MAAC, and PSEG North. For the 2015/2016 Base Residual Auction, the defined markets were RTO, MAAC, and ATSI. For the 2016/2017 Base Residual

Auction, the defined markets were RTO, MAAC, PSEG, and ATSI. For the 2017/2018 Base Residual Auction, the defined markets were RTO and PSEG. For the 2018/2019 Base Residual Auction, the defined markets were RTO, EMAAC, and ComEd.

Figure A-4 PJM RPM EMAAC locational deliverability area, including PSEG North and DPL South

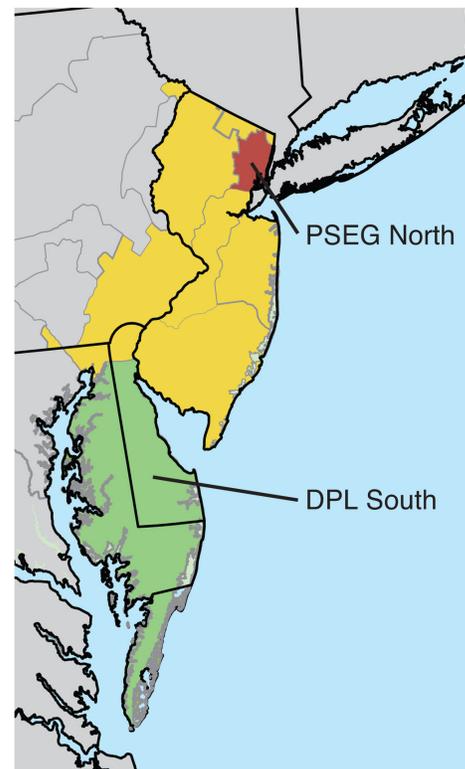


Figure A-5 Map of PJM RPM ATSI subzonal LDA



Appendix B PJM Market Milestones

Year	Month	Event
1996	April	FERC Order 888, "Promoting Wholesale Competition Through Open Access Non-discriminatory Transmission Services by Public Utilities; Recovery of Stranded Costs by Public Utilities and Transmitting Utilities"
1997	April	Energy Market with cost-based offers and market-clearing prices
	November	FERC approval of ISO status for PJM
1998	April	Cost-based Energy LMP Market
1999	January	Daily Capacity Market
	March	FERC approval of market-based rates for PJM
	March	Monthly and Multimonthly Capacity Market
	March	FERC approval of Market Monitoring Plan
	April	Offer-based Energy LMP Market
	April	FTR Market
2000	June	Regulation Market
	June	Day-Ahead Energy Market
	July	Customer Load-Reduction Pilot Program
2001	June	PJM Emergency and Economic Load-Response Programs
2002	April	Integration of AP Control Zone into PJM Western Region
	June	PJM Emergency and Economic Load-Response Programs
	December	Spinning Reserve Market
	December	FERC approval of RTO status for PJM
2003	May	Annual FTR Auction
2004	May	Integration of ComEd Control Area into PJM
	October	Integration of AEP Control Zone into PJM Western Region
	October	Integration of DAY Control Zone into PJM Western Region
2005	January	Integration of DLCO Control Zone into PJM
	May	Integration of Dominion Control Zone into PJM
2006	May	Balance of Planning Period FTR Auction
2007	April	First RPM Auction
	June	Marginal loss component in LMPs
2008	June	Day-Ahead Scheduling Reserve (DASR) Market
	August	Independent, External MMU created as Monitoring Analytics, LLC
	October	Long Term FTR Auction
	December	Modified Operating Reserve accounting rules
	December	Three Pivotal Supplier Test in Regulation Market
2011	June	Integration of ATSI Control Zone into PJM
2012	January	Integration of DEOK Control Zone into PJM
	October	Regulation Market: Slow and fast frequency response
	October	Scarcity pricing in Energy Market
2013	June	Integration of Eastern Kentucky Power Cooperative (EKPC) into PJM
2015	August	First Capacity Performance Auction

Appendix C Energy Market

This appendix provides more detailed information about load, locational marginal prices (LMP), offer-capped units and energy market uplift (operating reserves).

Load

Frequency Distribution of Load

Table C-1 provides the frequency distributions of PJM accounting load by hour, for 2007 through 2015.¹ The table shows the number of hours (frequency) and the percent of hours (cumulative percent) when the load was between zero GWh and 20 GWh and then by five GWh intervals. The integrations of the AP Control Zone in 2002, the ComEd, AEP and DAY control zones in 2004, the DLCO and Dominion control zones in 2005, the ATSI Control Zone in 2011, the DEOK Control Zone in 2012, and the EKPC Control Zone in 2013 mean that annual comparisons of load frequency are significantly affected by PJM's growth.²

Table C-1 Frequency distribution of PJM real-time, hourly load: 2007 through 2015³

Load (GWh)	2007		2008		2009		2010		2011	
	Frequency	Cumulative Percent								
0 to 20	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
20 to 25	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
25 to 30	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
30 to 35	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
35 to 40	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
40 to 45	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
45 to 50	0	0.00%	0	0.00%	15	0.17%	12	0.14%	5	0.06%
50 to 55	79	0.90%	127	1.45%	376	4.46%	272	3.24%	104	1.24%
55 to 60	433	5.84%	517	7.33%	738	12.89%	582	9.89%	325	4.95%
60 to 65	637	13.12%	667	14.92%	836	22.43%	699	17.87%	602	11.83%
65 to 70	890	23.28%	941	25.64%	915	32.88%	805	27.05%	858	21.62%
70 to 75	878	33.30%	1,048	37.57%	1,342	48.20%	1,323	42.16%	1,120	34.41%
75 to 80	1,227	47.31%	1,535	55.04%	1,488	65.18%	1,272	56.68%	1,176	47.83%
80 to 85	1,338	62.58%	1,208	68.80%	966	76.21%	948	67.50%	1,259	62.20%
85 to 90	981	73.78%	916	79.22%	742	84.68%	794	76.56%	1,024	73.89%
90 to 95	741	82.24%	655	86.68%	549	90.95%	659	84.09%	719	82.10%
95 to 100	577	88.82%	457	91.88%	388	95.38%	487	89.65%	495	87.75%
100 to 105	382	93.18%	292	95.21%	205	97.72%	318	93.28%	279	90.94%
105 to 110	223	95.73%	181	97.27%	121	99.10%	195	95.50%	194	93.15%
110 to 115	179	97.77%	133	98.78%	48	99.65%	151	97.23%	173	95.13%
115 to 120	106	98.98%	58	99.44%	26	99.94%	108	98.46%	149	96.83%
120 to 125	43	99.47%	35	99.84%	5	100.00%	84	99.42%	95	97.91%
125 to 130	31	99.83%	14	100.00%	0	100.00%	40	99.87%	68	98.69%
130 to 135	12	99.97%	0	100.00%	0	100.00%	11	100.00%	49	99.25%
135 to 140	3	100.00%	0	100.00%	0	100.00%	0	100.00%	35	99.65%
140 to 145	0	100.00%	0	100.00%	0	100.00%	0	100.00%	16	99.83%
145 to 150	0	100.00%	0	100.00%	0	100.00%	0	100.00%	9	99.93%
150 to 155	0	100.00%	0	100.00%	0	100.00%	0	100.00%	6	100.00%
155 to 160	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
> 160	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%

¹ The definitions of load are discussed in the *Technical Reference for PJM Markets*, at "Load Definitions." <http://www.monitoringanalytics.com/reports/Technical_References/references.shtml>.

² See the *2014 State of the Market Report for PJM*, Volume II, Appendix A, "PJM Geography."

³ Each range in the tables in this Appendix excludes the start value and includes the end value.

Table C-1 Frequency distribution of PJM real-time, hourly load: 2007 through 2015 (continued)

Load (GWh)	2012		2013		2014		2015	
	Frequency	Cumulative Percent						
0 to 20	0	0.00%	0	0.00%	0	0.00%	0	0.00%
20 to 25	0	0.00%	0	0.00%	0	0.00%	0	0.00%
25 to 30	0	0.00%	0	0.00%	0	0.00%	0	0.00%
30 to 35	0	0.00%	0	0.00%	0	0.00%	0	0.00%
35 to 40	0	0.00%	0	0.00%	0	0.00%	0	0.00%
40 to 45	0	0.00%	0	0.00%	0	0.00%	0	0.00%
45 to 50	0	0.00%	0	0.00%	0	0.00%	0	0.00%
50 to 55	0	0.00%	0	0.00%	0	0.00%	0	0.00%
55 to 60	104	1.18%	81	0.92%	78	0.89%	76	0.87%
60 to 65	471	6.55%	390	5.38%	379	5.22%	447	5.97%
65 to 70	629	13.71%	572	11.91%	573	11.76%	636	13.23%
70 to 75	785	22.64%	728	20.22%	726	20.05%	793	22.28%
75 to 80	1,010	34.14%	857	30.00%	800	29.18%	867	32.18%
80 to 85	1,390	49.97%	1,177	43.44%	1,170	42.53%	1,289	46.89%
85 to 90	1,233	64.00%	1,224	57.41%	1,241	56.70%	1,083	59.26%
90 to 95	973	75.08%	1,042	69.30%	860	66.52%	803	68.42%
95 to 100	691	82.95%	877	79.32%	785	75.48%	625	75.56%
100 to 105	436	87.91%	682	87.10%	685	83.30%	558	81.93%
105 to 110	289	91.20%	401	91.68%	550	89.58%	515	87.81%
110 to 115	185	93.31%	270	94.76%	357	93.65%	384	92.19%
115 to 120	152	95.04%	157	96.55%	225	96.22%	286	95.46%
120 to 125	135	96.57%	127	98.00%	156	98.00%	162	97.31%
125 to 130	121	97.95%	67	98.77%	100	99.14%	128	98.77%
130 to 135	77	98.83%	42	99.25%	63	99.86%	72	99.59%
135 to 140	46	99.35%	20	99.47%	12	100.00%	34	99.98%
140 to 145	39	99.80%	14	99.63%	0	100.00%	2	100.00%
145 to 150	16	99.98%	20	99.86%	0	100.00%	0	100.00%
150 to 155	2	100.00%	12	100.00%	0	100.00%	0	100.00%
155 to 160	0	100.00%	0	100.00%	0	100.00%	0	100.00%
> 160	0	100.00%	0	100.00%	0	100.00%	0	100.00%

Off-Peak and On-Peak Load

Table C-2 shows summary load statistics for 1998 through 2015 for the off-peak and on-peak hours. Table C-3 shows the annual change in each statistic. The on-peak period is defined for each weekday (Monday through Friday) as the hour ending 0800 to the hour ending 2300 Eastern Prevailing Time (EPT), excluding North American Electric Reliability Council (NERC) holidays.

Table C-2 Off-peak and on-peak load (MW): 1998 through 2015

	Average			Median			Standard Deviation		
	Off Peak	On Peak	On Peak/ Off Peak	Off Peak	On Peak	On Peak/ Off Peak	Off Peak	On Peak	On Peak/ Off Peak
1998	25,269	32,344	1.28	24,729	31,081	1.26	4,091	4,388	1.07
1999	26,454	33,269	1.26	25,780	31,950	1.24	4,947	4,824	0.98
2000	26,917	33,797	1.26	26,313	32,757	1.24	4,466	4,181	0.94
2001	26,804	34,303	1.28	26,433	33,076	1.25	4,225	4,851	1.15
2002	31,734	40,314	1.27	30,590	38,365	1.25	6,111	7,464	1.22
2003	33,598	41,755	1.24	32,973	40,802	1.24	5,545	5,424	0.98
2004	44,631	56,020	1.26	43,028	56,578	1.31	10,845	12,595	1.16
2005	70,291	87,164	1.24	68,049	82,503	1.21	12,733	15,236	1.20
2006	71,810	88,323	1.23	70,300	84,810	1.21	11,348	12,662	1.12
2007	73,499	91,066	1.24	71,751	88,494	1.23	11,501	11,926	1.04
2008	72,175	87,915	1.22	70,516	85,431	1.21	11,378	11,205	0.98
2009	68,745	84,337	1.23	67,159	81,825	1.22	10,924	10,523	0.96
2010	72,186	88,066	1.22	70,318	85,435	1.21	12,942	13,753	1.06
2011	74,815	91,413	1.22	72,661	87,938	1.21	12,978	14,835	1.14
2012	79,046	96,193	1.22	76,930	92,199	1.20	13,182	14,426	1.09
2013	80,232	97,624	1.22	78,751	95,465	1.21	12,588	13,105	1.04
2014	80,942	98,456	1.22	78,993	97,042	1.23	13,086	13,161	1.01
2015	80,669	97,620	1.21	77,648	94,316	1.21	14,288	14,387	1.01

Table C-3 Changes in off-peak and on-peak load (MW): 1998 through 2015

	Average			Median			Standard Deviation		
	Off Peak	On Peak	On Peak/ Off Peak	Off Peak	On Peak	On Peak/ Off Peak	Off Peak	On Peak	On Peak/ Off Peak
1998	NA	NA	NA	NA	NA	NA	NA	NA	NA
1999	4.7%	2.9%	(1.7%)	4.3%	2.8%	(1.4%)	20.9%	9.9%	(9.1%)
2000	1.8%	1.6%	(0.2%)	2.1%	2.5%	0.5%	(9.7%)	(13.3%)	(4.0%)
2001	(0.4%)	1.5%	1.9%	0.5%	1.0%	0.5%	(5.4%)	16.0%	22.6%
2002	18.4%	17.5%	(0.7%)	15.7%	16.0%	0.2%	44.6%	53.9%	6.4%
2003	5.9%	3.6%	(2.2%)	7.8%	6.4%	(1.3%)	(9.3%)	(27.3%)	(19.9%)
2004	32.8%	34.2%	1.0%	30.5%	38.7%	6.3%	95.6%	132.2%	18.7%
2005	57.5%	55.6%	(1.2%)	58.2%	45.8%	(7.8%)	17.4%	21.0%	3.0%
2006	2.2%	1.3%	(0.8%)	3.3%	2.8%	(0.5%)	(10.9%)	(16.9%)	(6.8%)
2007	2.4%	3.1%	0.7%	2.1%	4.3%	2.2%	1.3%	(5.8%)	(7.1%)
2008	(1.8%)	(3.5%)	(1.7%)	(1.7%)	(3.5%)	(1.8%)	(1.1%)	(6.0%)	(5.0%)
2009	(4.8%)	(4.1%)	0.7%	(4.8%)	(4.2%)	0.6%	(4.0%)	(6.1%)	(2.2%)
2010	5.0%	4.4%	(0.6%)	4.7%	4.4%	(0.3%)	18.5%	30.7%	10.3%
2011	3.6%	3.8%	0.2%	3.3%	2.9%	(0.4%)	0.3%	7.9%	7.6%
2012	5.7%	5.2%	(0.4%)	5.9%	4.8%	(1.0%)	1.6%	(2.8%)	(4.3%)
2013	1.5%	1.5%	(0.0%)	2.4%	3.5%	1.1%	(4.5%)	(9.2%)	(4.9%)
2014	0.9%	0.9%	(0.0%)	0.3%	1.7%	1.3%	4.0%	0.4%	(3.4%)
2015	(0.3%)	(0.8%)	(0.5%)	(1.7%)	(2.8%)	(1.1%)	9.2%	9.3%	0.1%

Locational Marginal Price (LMP)

Three measures of LMP are calculated: average LMP; load-weighted average LMP; and fuel-cost-adjusted, load-weighted average LMP. Differences in average LMP measure the change in reported price. Differences in load-weighted average LMP measure the change in reported price weighted by the actual hourly MWh load to reflect what customers actually pay for energy. Differences in fuel-cost adjusted, load-weighted average LMP measure what the change in reported price actually paid by load would have been if fuel costs in 2015 had been the same as in 2014, holding everything else constant.⁴

The zonal LMP includes every bus in the zone and is not affected by the choices of LSEs. The zonal LMP is defined by weighting each load bus LMP by its hourly contribution to total zonal load. The LMP for a defined aggregate is calculated by weighting each included load bus LMP by its hourly contribution to the total load of the defined aggregate.

During the settlement process, total load that is assigned to a load serving entity (LSE) in a zone is settled based on the LSE's choice to be charged either at the zonal price or at a different defined aggregate of nodal prices. Any LSE may request to settle at a different aggregate price instead of zonal LMP, but the change can only take effect on June 1 of each year.⁵ If an LSE chooses to settle at a different aggregate, the load of the LSE is distributed to all of the buses in the aggregate.⁶ If the LSE settles at the zonal price, the load of the LSE will be distributed to all of the buses in the zone.⁷

⁴ See the *Technical Reference for PJM Markets*, at "Calculating Locational Marginal Price."

⁵ See PJM "Manual 27: Open Access Transmission Tariff Accounting," Revision 84 (January 1, 2015), Section 5, p. 22-24.

⁶ OATT. Common Service Provisions (Designation of Network Load) §31.7.

⁷ OATT. Common Service Provisions (Designation of Network Load) §31.7.

Market rules related to the use of zonal pricing will change starting with the 2015/2016 planning period.⁸ A residual zonal price will become the default price for load that has not elected to settle at nodal prices. When some load in a zone is nodally priced, the residual zonal price is the price of energy for the residual load, the load that is not priced nodally. The residual price is the average price at the nodes at which non-nodal load is served. The zonal LMP will continue to be used for virtual bidding, Financial Transmission Rights (FTRs), and bilateral energy transactions.

In the Day-Ahead Energy Market buyers may submit bids at specific locations such as a transmission zone, aggregate or a single bus. Price sensitive demand bids specify price and MW quantities and a location for the bid. Market participants may submit increment offers or decrement bids at any hub, transmission zone, aggregate, single bus or eligible external interfaces. PJM provides the definitions of the transmission zones, aggregates, and single buses.⁹

Real-Time LMP

Frequency Distribution of Real-Time Average LMP

Table C-4 provides frequency distributions of PJM real-time hourly average LMP for 2007 through 2015. The table shows the number of hours (frequency) and the percent of hours (cumulative percent) when the hourly PJM real-time LMP was, when negative, within a \$100 per MWh price interval below \$0 per MWh, or, when positive, within a given \$10 per MWh price interval and lower than \$300 per MWh, or within a given \$100 per MWh price interval and higher than \$300 per MWh. In the Real-Time Energy Market, prices reached a high for the year of \$434.26 per MWh on July 20, 2015, in the hour ending 1700 EPT.

⁸ OATT, Common Service Provisions (Designation of Network Load) §31.7.

⁹ See PJM "Manual 11: Energy & Ancillary Services Market Operations," Revision 72 (January 16, 2015), Section 2, p. 10.

Table C-4 Frequency distribution by hours of PJM Real-Time Energy Market LMP (Dollars per MWh): 2007 through 2015

LMP	2007		2008		2009		2010		2011	
	Frequency	Cumulative Percent								
-\$200 to -\$100	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
-\$100 to \$0	23	0.26%	45	0.51%	60	0.68%	34	0.39%	33	0.38%
\$0 to \$10	33	0.64%	49	1.07%	57	1.34%	31	0.74%	33	0.75%
\$10 to \$20	185	2.75%	129	2.54%	218	3.82%	127	2.19%	89	1.77%
\$20 to \$30	1,571	20.68%	490	8.12%	2,970	37.73%	1,810	22.85%	1,764	21.91%
\$30 to \$40	1,470	37.47%	1,443	24.54%	2,951	71.42%	3,150	58.81%	3,967	67.19%
\$40 to \$50	1,108	50.11%	1,533	42.00%	1,269	85.90%	1,462	75.50%	1,334	82.42%
\$50 to \$60	931	60.74%	1,212	55.79%	555	92.24%	766	84.25%	489	88.00%
\$60 to \$70	827	70.18%	845	65.41%	276	95.39%	427	89.12%	303	91.46%
\$70 to \$80	726	78.47%	709	73.49%	151	97.11%	274	92.25%	174	93.45%
\$80 to \$90	646	85.84%	502	79.20%	95	98.20%	165	94.13%	133	94.97%
\$90 to \$100	451	90.99%	385	83.58%	62	98.90%	134	95.66%	108	96.20%
\$100 to \$110	240	93.73%	352	87.59%	30	99.25%	82	96.60%	61	96.89%
\$110 to \$120	178	95.76%	265	90.61%	21	99.49%	71	97.41%	61	97.59%
\$120 to \$130	110	97.02%	199	92.87%	15	99.66%	61	98.11%	46	98.12%
\$130 to \$140	76	97.89%	144	94.51%	7	99.74%	44	98.61%	33	98.49%
\$140 to \$150	53	98.49%	111	95.78%	9	99.84%	29	98.94%	25	98.78%
\$150 to \$160	26	98.79%	102	96.94%	3	99.87%	22	99.19%	25	99.06%
\$160 to \$170	29	99.12%	68	97.71%	3	99.91%	11	99.32%	17	99.26%
\$170 to \$180	18	99.33%	52	98.30%	5	99.97%	13	99.46%	15	99.43%
\$180 to \$190	9	99.43%	45	98.82%	0	99.97%	12	99.60%	6	99.50%
\$190 to \$200	15	99.60%	29	99.15%	1	99.98%	9	99.70%	8	99.59%
\$200 to \$210	6	99.67%	20	99.37%	1	99.99%	7	99.78%	6	99.66%
\$210 to \$220	4	99.71%	11	99.50%	1	100.00%	4	99.83%	5	99.71%
\$220 to \$230	4	99.76%	14	99.66%	0	100.00%	3	99.86%	4	99.76%
\$230 to \$240	2	99.78%	10	99.77%	0	100.00%	5	99.92%	0	99.76%
\$240 to \$250	5	99.84%	2	99.80%	0	100.00%	3	99.95%	3	99.79%
\$250 to \$260	2	99.86%	5	99.85%	0	100.00%	1	99.97%	3	99.83%
\$260 to \$270	4	99.91%	4	99.90%	0	100.00%	0	99.97%	3	99.86%
\$270 to \$280	0	99.91%	1	99.91%	0	100.00%	0	99.97%	3	99.90%
\$280 to \$290	0	99.91%	1	99.92%	0	100.00%	1	99.98%	0	99.90%
\$290 to \$300	0	99.91%	0	99.92%	0	100.00%	0	99.98%	2	99.92%
\$300 to \$400	2	99.93%	6	99.99%	0	100.00%	2	100.00%	4	99.97%
\$400 to \$500	4	99.98%	1	100.00%	0	100.00%	0	100.00%	0	99.97%
\$500 to \$600	1	99.99%	0	100.00%	0	100.00%	0	100.00%	0	99.97%
\$600 to \$700	1	100.00%	0	100.00%	0	100.00%	0	100.00%	0	99.97%
\$700 to \$800	0	100.00%	0	100.00%	0	100.00%	0	100.00%	3	100.00%
\$800 to \$900	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
\$900 to \$1000	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
> \$1,000	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%

Table C-4 Frequency distribution by hours of PJM Real-Time Energy Market LMP (Dollars per MWh): 2007 through 2015 (continued)

LMP	2012		2013		2014		2015	
	Frequency	Cumulative Percent						
-\$200 to -\$100	2	0.02%	0	0.00%	0	0.00%	5	0.06%
-\$100 to \$0	50	0.59%	3	0.03%	15	0.17%	31	0.41%
\$0 to \$10	79	1.49%	64	0.76%	40	0.63%	108	1.64%
\$10 to \$20	510	7.30%	147	2.44%	224	3.18%	1,091	14.10%
\$20 to \$30	4,002	52.86%	3,077	37.57%	2,662	33.57%	4,527	65.78%
\$30 to \$40	2,801	84.74%	3,447	76.92%	2,782	65.33%	1,477	82.64%
\$40 to \$50	668	92.35%	1,116	89.66%	1,161	78.58%	566	89.10%
\$50 to \$60	244	95.13%	391	94.12%	619	85.65%	270	92.18%
\$60 to \$70	136	96.68%	187	96.26%	287	88.93%	168	94.10%
\$70 to \$80	75	97.53%	99	97.39%	206	91.28%	116	95.42%
\$80 to \$90	51	98.11%	67	98.15%	142	92.90%	89	96.44%
\$90 to \$100	38	98.54%	38	98.58%	102	94.06%	77	97.32%
\$100 to \$110	32	98.91%	23	98.85%	71	94.87%	42	97.80%
\$110 to \$120	20	99.13%	24	99.12%	55	95.50%	31	98.15%
\$120 to \$130	15	99.31%	13	99.27%	50	96.07%	29	98.48%
\$130 to \$140	10	99.42%	20	99.50%	42	96.55%	24	98.76%
\$140 to \$150	7	99.50%	1	99.51%	21	96.79%	11	98.88%
\$150 to \$160	8	99.59%	3	99.54%	22	97.04%	21	99.12%
\$160 to \$170	5	99.65%	4	99.59%	22	97.29%	9	99.22%
\$170 to \$180	1	99.66%	5	99.65%	21	97.53%	12	99.36%
\$180 to \$190	2	99.68%	3	99.68%	24	97.81%	6	99.43%
\$190 to \$200	3	99.72%	1	99.69%	18	98.01%	6	99.50%
\$200 to \$210	2	99.74%	3	99.73%	17	98.21%	8	99.59%
\$210 to \$220	1	99.75%	4	99.77%	14	98.37%	5	99.65%
\$220 to \$230	0	99.75%	3	99.81%	11	98.49%	4	99.69%
\$230 to \$240	4	99.80%	4	99.85%	10	98.61%	4	99.74%
\$240 to \$250	5	99.85%	1	99.86%	8	98.70%	3	99.77%
\$250 to \$260	5	99.91%	1	99.87%	6	98.77%	4	99.82%
\$260 to \$270	0	99.91%	3	99.91%	5	98.82%	2	99.84%
\$270 to \$280	1	99.92%	1	99.92%	9	98.93%	1	99.85%
\$280 to \$290	1	99.93%	0	99.92%	10	99.04%	2	99.87%
\$290 to \$300	0	99.93%	1	99.93%	7	99.12%	1	99.89%
\$300 to \$400	6	100.00%	5	99.99%	35	99.52%	7	99.97%
\$400 to \$500	0	100.00%	1	100.00%	22	99.77%	3	100.00%
\$500 to \$600	0	100.00%	0	100.00%	6	99.84%	0	0.00%
\$600 to \$700	0	100.00%	0	100.00%	1	99.85%	0	0.00%
\$700 to \$800	0	100.00%	0	100.00%	2	99.87%	0	0.00%
\$800 to \$900	0	100.00%	0	100.00%	4	99.92%	0	0.00%
\$900 to \$1000	0	100.00%	0	100.00%	1	99.93%	0	0.00%
> \$1,000	0	100.00%	0	100.00%	6	100.00%	0	0.00%

Off-Peak and On-Peak, PJM Real-Time, Load-Weighted Average LMP

Table C-5 shows load-weighted, average real-time LMP for 2014 and 2015 during off-peak and on-peak periods.

Table C-5 Off-peak and on-peak, PJM load-weighted, average LMP (Dollars per MWh): 2014 and 2015

	2014			2015			Percent Change		
	Off Peak	On Peak	On Peak/ Off Peak	Off Peak	On Peak	On Peak/ Off Peak	Off Peak	On Peak	On Peak/ Off Peak
Average	\$42.33	\$63.33	1.50	\$30.48	\$41.50	1.36	(28.0%)	(34.5%)	(9.0%)
Median	\$30.26	\$41.55	1.37	\$24.43	\$30.84	1.26	(19.3%)	(25.8%)	(8.1%)
Standard deviation	\$51.45	\$92.59	1.80	\$27.21	\$33.42	1.23	(47.1%)	(63.9%)	(31.7%)

Off-Peak and On-Peak, Real-Time, Fuel-Cost Adjusted, Load-Weighted, Average LMP

In a competitive market, changes in LMP result from changes in demand and changes in supply. The supply curve is a function of the short run marginal costs of marginal units, the units setting LMP. As competitive offers are the short run marginal costs of generation and fuel costs make up between 80 percent and 90 percent of short run marginal costs on average, fuel cost is a key factor affecting the competitive clearing price. In a competitive market, if fuel costs increase and nothing else changes, the competitive price also increases.

The impact of fuel cost on marginal cost and on LMP depends on the fuel burned by marginal units and changes in fuel costs.¹⁰ Changes in emission allowance costs are another contributor to changes in the marginal cost of marginal units. To account for the changes in fuel and allowance costs between 2014 and 2015, the load-weighted, average LMP for 2015 was adjusted to reflect the daily price of fuels and emission allowances used by marginal units from a base period, 2014. The fuel cost adjusted, load-weighted, average LMP for 2015 is compared to the load-weighted, average LMP for 2014 and load-weighted, average LMP for 2015.¹¹

Table C-6 shows the real-time, load-weighted, average LMP for 2014 and the real-time, fuel-cost adjusted, load-weighted, average LMP for 2015 for on-peak and off-peak hours. The fuel-cost adjusted load-weighted, average LMP for 2015 on-peak hours was 25.7 percent

lower than the load-weighted, average LMP for 2014 on-peak hours. If the fuel costs had been the same as in 2014, holding everything else constant, the 2015 real time load-weighted, average LMP for on-peak hours would have been higher, \$47.08 per MWh than the observed \$41.50 per MWh. The fuel-cost adjusted load-weighted,

average LMP for 2015 off-peak hours was 14.0 percent lower than the load-weighted, average LMP for 2014 off-peak hours. If the fuel

costs had been the same as in 2014, holding everything else constant, the 2015 real-time load-weighted, average LMP for off-peak hours would have been higher, \$36.41 per MWh instead of the observed \$30.48 per MWh. The decrease in fuel and emissions costs in 2015 resulted in lower prices in 2015 for both on peak and off peak periods than would have occurred if fuel and emissions costs had remained at their 2014 levels, although the difference was a larger proportion for the off peak period than for the on peak period. The decrease in fuel costs accounted for 25.6 percent of the decrease in load-weighted LMP from 2014 to 2015 for the peak period and 50.0 percent for the off-peak period.

Table C-6 On-peak and off-peak real-time PJM fuel-cost adjusted, load-weighted, average LMP (Dollars per MWh): year over year

	2015 Load-Weighted LMP	2015 Fuel-Cost-Adjusted, Load-Weighted LMP	Change
Off Peak Average	\$30.48	\$36.41	19.5%
Peak Average	\$41.50	\$47.08	13.4%
	2014 Load-Weighted LMP	2015 Fuel-Cost-Adjusted, Load-Weighted LMP	Change
Off Peak Average	\$42.33	\$36.41	(14.0%)
Peak Average	\$63.33	\$47.08	(25.7%)
	2014 Load-Weighted LMP	2015 Load-Weighted LMP	Change
Off Peak Average	\$42.33	\$30.48	(28.0%)
Peak Average	\$63.33	\$41.50	(34.5%)

¹⁰ See the *2015 State of the Market Report for PJM*, Volume II, Section 3, "Energy Market," at Table 3-6, "Type of fuel used (By real-time marginal units): 2011 through 2015."

¹¹ See the *Technical Reference for PJM Markets*, at "Calculation and Use of Generator Sensitivity/Unit Participation Factors."

PJM Real-Time, Load-Weighted Average LMP during Constrained Hours

Table C-7 provides a comparison of PJM load-weighted, average LMP during constrained and unconstrained hours for 2014 and 2015.

Table C-7 PJM real-time load-weighted, average LMP during constrained and unconstrained hours (Dollars per MWh): 2014 and 2015

	2014		2015		Percent Change	
	Unconstrained Hours LMP	Constrained Hours LMP	Unconstrained Hours LMP	Constrained Hours LMP	Unconstrained Hours	Constrained Hours
Average	\$34.18	\$54.32	\$24.54	\$36.80	(28.2%)	(32.3%)
Median	\$31.04	\$36.54	\$22.96	\$27.95	(26.0%)	(23.5%)
Standard deviation	\$15.85	\$78.29	\$17.64	\$31.51	11.3%	(59.8%)

Table C-8 shows the number of hours and the number of constrained hours in each month in 2014 and 2015.

Table C-8 PJM real-time constrained hours: 2014 and 2015

	2014			2015		
	Constrained Hours	Total Hours	Percent of Total	Constrained Hours	Total Hours	Percent of Total
Jan	722	744	97.0%	734	744	98.7%
Feb	619	672	92.1%	661	672	98.4%
Mar	697	743	93.8%	706	743	95.0%
Apr	625	720	86.8%	701	720	97.4%
May	713	744	95.8%	729	744	98.0%
Jun	700	720	97.2%	675	720	93.8%
Jul	630	744	84.7%	686	744	92.2%
Aug	640	744	86.0%	646	744	86.8%
Sep	664	720	92.2%	630	720	87.5%
Oct	744	744	100.0%	714	744	96.0%
Nov	721	721	100.0%	714	721	99.0%
Dec	740	744	99.5%	662	744	89.0%
Avg	685	730	93.8%	688	730	94.3%

Day-Ahead LMP

Frequency Distribution of Day-Ahead Average LMP

Table C-9 provides frequency distributions of PJM day-ahead hourly average LMP for 2007 through 2015. The table shows the number of hours (frequency) and the percent of hours (cumulative percent) when the hourly PJM day-ahead LMP was, when negative, within a \$100 per MWh price interval below \$0 per MWh, or, when positive, within a \$10 per MWh price interval and lower than \$300 per MWh, or within a given \$100 per MWh price interval and higher than \$300 per MWh.

In the Day-Ahead Energy Market, prices reached a high for the year of \$399.49 per MWh on February 19, 2015, in the hour ending 1900 EPT.

Table C-9 Frequency distribution by hours of PJM Day-Ahead Energy Market LMP (Dollars per MWh): 2007 through 2015

LMP	2007		2008		2009		2010		2011	
	Frequency	Cumulative Percent								
-\$200 to -\$100	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
-\$100 to \$0	0	0.00%	0	0.00%	0	0.00%	0	0.00%	0	0.00%
\$0 to \$10	3	0.03%	0	0.00%	23	0.26%	5	0.06%	0	0.00%
\$10 to \$20	88	1.04%	19	0.22%	343	4.18%	31	0.41%	33	0.38%
\$20 to \$30	1,291	15.78%	320	3.86%	2,380	31.35%	1,502	17.56%	1,595	18.58%
\$30 to \$40	1,495	32.84%	1,148	16.93%	3,221	68.12%	2,851	50.10%	3,359	56.93%
\$40 to \$50	1,221	46.78%	1,546	34.53%	1,717	87.72%	2,131	74.43%	2,024	80.03%
\$50 to \$60	1,266	61.23%	1,491	51.50%	557	94.08%	954	85.32%	872	89.99%
\$60 to \$70	1,301	76.08%	1,107	64.11%	253	96.96%	471	90.70%	406	94.62%
\$70 to \$80	939	86.80%	942	74.83%	138	98.54%	302	94.14%	174	96.61%
\$80 to \$90	504	92.56%	682	82.59%	68	99.32%	193	96.35%	87	97.60%
\$90 to \$100	264	95.57%	542	88.76%	33	99.69%	125	97.77%	61	98.30%
\$100 to \$110	155	97.34%	289	92.05%	19	99.91%	86	98.76%	29	98.63%
\$110 to \$120	104	98.53%	193	94.25%	6	99.98%	46	99.28%	30	98.97%
\$120 to \$130	59	99.20%	131	95.74%	2	100.00%	29	99.61%	16	99.16%
\$130 to \$140	33	99.58%	112	97.02%	0	100.00%	14	99.77%	21	99.39%
\$140 to \$150	13	99.73%	67	97.78%	0	100.00%	7	99.85%	17	99.59%
\$150 to \$160	8	99.82%	54	98.39%	0	100.00%	6	99.92%	7	99.67%
\$160 to \$170	7	99.90%	46	98.92%	0	100.00%	3	99.95%	3	99.70%
\$170 to \$180	3	99.93%	23	99.18%	0	100.00%	2	99.98%	2	99.73%
\$180 to \$190	4	99.98%	20	99.41%	0	100.00%	0	99.98%	2	99.75%
\$190 to \$200	1	99.99%	16	99.59%	0	100.00%	2	100.00%	2	99.77%
\$200 to \$210	1	100.00%	8	99.68%	0	100.00%	0	100.00%	1	99.78%
\$210 to \$220	0	100.00%	9	99.78%	0	100.00%	0	100.00%	0	99.78%
\$220 to \$230	0	100.00%	4	99.83%	0	100.00%	0	100.00%	2	99.81%
\$230 to \$240	0	100.00%	3	99.86%	0	100.00%	0	100.00%	1	99.82%
\$240 to \$250	0	100.00%	2	99.89%	0	100.00%	0	100.00%	0	99.82%
\$250 to \$260	0	100.00%	0	99.89%	0	100.00%	0	100.00%	2	99.84%
\$260 to \$270	0	100.00%	4	99.93%	0	100.00%	0	100.00%	2	99.86%
\$270 to \$280	0	100.00%	0	99.93%	0	100.00%	0	100.00%	0	99.86%
\$280 to \$290	0	100.00%	2	99.95%	0	100.00%	0	100.00%	0	99.86%
\$290 to \$300	0	100.00%	2	99.98%	0	100.00%	0	100.00%	4	99.91%
\$300 to \$400	0	100.00%	2	100.00%	0	100.00%	0	100.00%	8	100.00%
\$400 to \$500	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
\$500 to \$600	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
\$600 to \$700	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
\$700 to \$800	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
\$800 to \$900	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
\$900 to \$1000	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%
> \$1000	0	100.00%	0	100.00%	0	100.00%	0	100.00%	0	100.00%

Table C-9 Frequency distribution by hours of PJM Day-Ahead Energy Market LMP (Dollars per MWh): 2007 through 2015 (continued)

LMP	2012		2013		2014		2015	
	Frequency	Cumulative Percent						
-\$200 to -\$100	0	0.00%	0	0.00%	0	0.00%	0	0.00%
-\$100 to \$0	0	0.00%	0	0.00%	0	0.00%	0	0.00%
\$0 to \$10	19	0.22%	1	0.01%	12	0.14%	71	0.81%
\$10 to \$20	467	5.53%	76	0.88%	112	1.42%	871	10.80%
\$20 to \$30	3,402	44.26%	2,364	27.87%	2,106	25.46%	3,760	53.88%
\$30 to \$40	3,521	84.35%	3,794	71.18%	2,648	55.68%	2,430	81.73%
\$40 to \$50	908	94.68%	1,761	91.28%	1,866	76.99%	772	90.58%
\$50 to \$60	247	97.50%	421	96.08%	827	86.43%	293	93.94%
\$60 to \$70	106	98.70%	169	98.01%	346	90.38%	130	95.43%
\$70 to \$80	39	99.15%	64	98.74%	191	92.56%	97	96.54%
\$80 to \$90	21	99.39%	35	99.14%	108	93.79%	83	97.49%
\$90 to \$100	12	99.52%	22	99.39%	77	94.67%	64	98.22%
\$100 to \$110	7	99.60%	12	99.53%	51	95.25%	37	98.65%
\$110 to \$120	6	99.67%	4	99.58%	33	95.63%	34	99.04%
\$120 to \$130	7	99.75%	3	99.61%	26	95.92%	17	99.23%
\$130 to \$140	4	99.80%	2	99.63%	34	96.31%	11	99.36%
\$140 to \$150	2	99.82%	2	99.66%	18	96.52%	10	99.47%
\$150 to \$160	1	99.83%	2	99.68%	31	96.87%	10	99.59%
\$160 to \$170	3	99.86%	5	99.74%	22	97.12%	8	99.68%
\$170 to \$180	1	99.87%	3	99.77%	26	97.42%	2	99.70%
\$180 to \$190	0	99.87%	2	99.79%	29	97.75%	4	99.75%
\$190 to \$200	2	99.90%	2	99.82%	24	98.03%	1	99.76%
\$200 to \$210	2	99.92%	3	99.85%	14	98.18%	3	99.79%
\$210 to \$220	2	99.94%	2	99.87%	13	98.33%	1	99.81%
\$220 to \$230	1	99.95%	4	99.92%	15	98.50%	1	99.82%
\$230 to \$240	2	99.98%	0	99.92%	8	98.60%	2	99.84%
\$240 to \$250	0	99.98%	1	99.93%	10	98.71%	2	99.86%
\$250 to \$260	1	99.99%	1	99.94%	6	98.78%	4	99.91%
\$260 to \$270	0	99.99%	0	99.94%	9	98.88%	3	99.94%
\$270 to \$280	1	100.00%	1	99.95%	15	99.05%	0	99.94%
\$280 to \$290	0	100.00%	0	99.95%	7	99.13%	1	99.95%
\$290 to \$300	0	100.00%	2	99.98%	6	99.20%	4	100.00%
\$300 to \$400	0	100.00%	2	100.00%	31	99.55%	0	100.00%
\$400 to \$500	0	100.00%	0	100.00%	15	99.73%	0	100.00%
\$500 to \$600	0	100.00%	0	100.00%	12	99.86%	0	100.00%
\$600 to \$700	0	100.00%	0	100.00%	6	99.93%	0	100.00%
\$700 to \$800	0	100.00%	0	100.00%	1	99.94%	0	100.00%
\$800 to \$900	0	100.00%	0	100.00%	1	99.95%	0	100.00%
\$900 to \$1000	0	100.00%	0	100.00%	4	100.00%	0	100.00%
> \$1000	0	100.00%	0	100.00%	0	100.00%	0	100.00%

Off-Peak and On-Peak, Day-Ahead and Real-Time, Average LMP

Table C-10 shows PJM average LMP during off-peak and on-peak periods for the Day-Ahead and Real-Time Energy Markets in 2015. Figure C-1 and Figure C-2 show the difference between real-time and day-ahead LMP in 2015 during the on-peak and off-peak hours.

Table C-10 Off-peak and on-peak, average day-ahead and real-time LMP (Dollars per MWh): 2015

	Day Ahead		Real Time		Difference		Percent Change	
	Off Peak	On Peak	Off Peak	On Peak	Off Peak	On Peak	Off Peak	On Peak
Average	\$39.12	\$60.65	\$38.72	\$59.12	\$0.41	\$1.54	(1.0%)	(2.5%)
Median	\$31.37	\$44.55	\$29.39	\$40.50	\$1.98	\$4.05	(6.3%)	(9.1%)
Standard deviation	\$34.48	\$64.56	\$43.64	\$81.78	(\$9.16)	(\$17.22)	26.6%	26.7%

Figure C-1 Hourly real-time LMP minus day-ahead LMP (On-peak hours): 2015


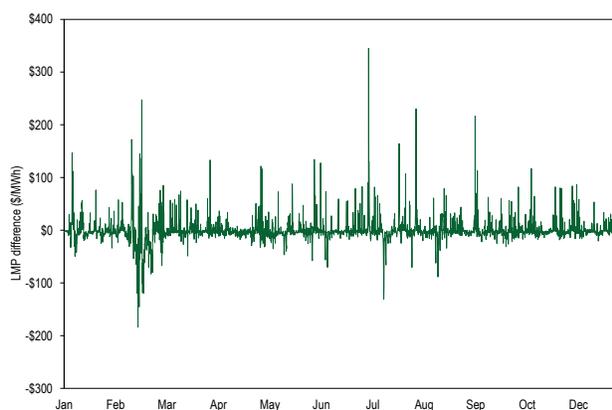


Figure C-2 Hourly real-time LMP minus day-ahead LMP (Off-peak hours): 2015

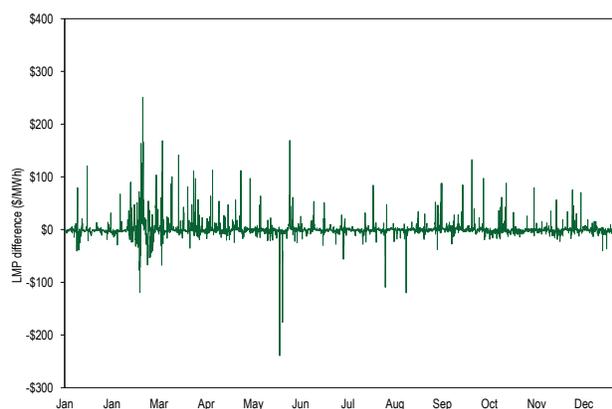

On-Peak and Off-Peak, Zonal, Day-Ahead and Real-Time, Average LMP

Table C-11 and Table C-12 show the on-peak and off-peak, average LMP for each zone in the Day-Ahead and Real-Time Energy Markets in 2014 and 2015.

Table C-11 On-peak, zonal, average day-ahead and real-time LMP (Dollars per MWh): 2014 and 2015

	2014				2015			
	Day Ahead	Real Time	Difference	Percent of Real Time	Day Ahead	Real Time	Difference	Percent of Real Time
AECO	\$66.15	\$63.00	(\$3.15)	(5.0%)	\$41.40	\$39.31	(\$2.09)	(5.3%)
AEP	\$55.04	\$53.15	(\$1.89)	(3.6%)	\$38.20	\$37.22	(\$0.98)	(2.6%)
AP	\$58.84	\$57.81	(\$1.03)	(1.8%)	\$41.76	\$40.93	(\$0.83)	(2.0%)
ATSI	\$57.54	\$55.62	(\$1.92)	(3.4%)	\$39.32	\$38.20	(\$1.12)	(2.9%)
BGE	\$73.57	\$72.78	(\$0.79)	(1.1%)	\$52.44	\$51.19	(\$1.25)	(2.4%)
ComEd	\$50.94	\$49.43	(\$1.51)	(3.1%)	\$34.02	\$33.76	(\$0.26)	(0.8%)
DAY	\$55.54	\$53.00	(\$2.54)	(4.8%)	\$38.67	\$37.73	(\$0.94)	(2.5%)
DEOK	\$53.35	\$50.29	(\$3.05)	(6.1%)	\$38.04	\$36.80	(\$1.24)	(3.4%)
DLCO	\$52.61	\$50.46	(\$2.15)	(4.3%)	\$37.32	\$36.36	(\$0.96)	(2.6%)
Dominion	\$65.36	\$66.20	\$0.84	1.3%	\$45.97	\$43.60	(\$2.37)	(5.4%)
DPL	\$72.45	\$69.87	(\$2.58)	(3.7%)	\$45.75	\$42.69	(\$3.06)	(7.2%)
EKPC	\$52.41	\$49.96	(\$2.45)	(4.9%)	\$36.20	\$34.97	(\$1.23)	(3.5%)
JCPL	\$67.01	\$63.34	(\$3.67)	(5.8%)	\$41.15	\$38.44	(\$2.71)	(7.0%)
Met-Ed	\$64.19	\$61.44	(\$2.75)	(4.5%)	\$40.19	\$38.44	(\$1.75)	(4.6%)
PECO	\$64.65	\$61.88	(\$2.77)	(4.5%)	\$40.23	\$37.55	(\$2.68)	(7.1%)
PENELEC	\$60.85	\$58.34	(\$2.51)	(4.3%)	\$40.74	\$39.96	(\$0.78)	(2.0%)
Pepco	\$71.33	\$70.93	(\$0.39)	(0.6%)	\$48.71	\$46.27	(\$2.44)	(5.3%)
PPL	\$64.31	\$61.50	(\$2.81)	(4.6%)	\$40.11	\$37.92	(\$2.19)	(5.8%)
PSEG	\$70.56	\$66.39	(\$4.17)	(6.3%)	\$42.93	\$41.08	(\$1.85)	(4.5%)
RECO	\$70.02	\$66.05	(\$3.97)	(6.0%)	\$43.43	\$42.24	(\$1.19)	(2.8%)

Table C-12 Off-peak, zonal, average day-ahead and real-time LMP (Dollars per MWh): 2014 and 2015

	2014				2015			
	Day Ahead	Real Time	Difference	Percent of Real Time	Day Ahead	Real Time	Difference	Percent of Real Time
AECO	\$42.73	\$40.85	(\$1.88)	(4.6%)	\$27.47	\$27.20	(\$0.27)	(1.0%)
AEP	\$35.79	\$36.08	\$0.29	0.8%	\$26.95	\$26.97	\$0.02	0.1%
AP	\$38.24	\$38.71	\$0.47	1.2%	\$29.09	\$29.39	\$0.30	1.0%
ATSI	\$36.63	\$36.47	(\$0.17)	(0.5%)	\$26.76	\$26.74	(\$0.02)	(0.1%)
BGE	\$48.58	\$46.64	(\$1.94)	(4.2%)	\$36.07	\$35.50	(\$0.57)	(1.6%)
ComEd	\$30.81	\$30.92	\$0.10	0.3%	\$22.74	\$23.33	\$0.59	2.6%
DAY	\$36.04	\$35.73	(\$0.32)	(0.9%)	\$27.00	\$27.18	\$0.18	0.7%
DEOK	\$34.66	\$34.17	(\$0.49)	(1.4%)	\$26.37	\$26.27	(\$0.10)	(0.4%)
DLCO	\$33.62	\$33.79	\$0.16	0.5%	\$25.34	\$25.26	(\$0.08)	(0.3%)
Dominion	\$43.51	\$44.30	\$0.79	1.8%	\$32.26	\$31.65	(\$0.61)	(1.9%)
DPL	\$45.98	\$43.57	(\$2.41)	(5.5%)	\$30.21	\$31.62	\$1.41	4.7%
EKPC	\$34.39	\$34.59	\$0.20	0.6%	\$25.71	\$25.81	\$0.10	0.4%
JCPL	\$42.98	\$40.18	(\$2.79)	(7.0%)	\$27.34	\$27.02	(\$0.32)	(1.2%)
Met-Ed	\$41.50	\$39.28	(\$2.21)	(5.6%)	\$26.57	\$26.67	\$0.10	0.4%
PECO	\$42.08	\$40.04	(\$2.04)	(5.1%)	\$26.89	\$26.75	(\$0.14)	(0.5%)
PENELEC	\$39.09	\$38.30	(\$0.79)	(2.1%)	\$27.41	\$27.77	\$0.36	1.3%
Pepco	\$46.88	\$45.49	(\$1.39)	(3.0%)	\$33.88	\$33.01	(\$0.87)	(2.6%)
PPL	\$41.51	\$39.26	(\$2.25)	(5.7%)	\$26.77	\$26.68	(\$0.09)	(0.3%)
PSEG	\$45.15	\$42.66	(\$2.49)	(5.8%)	\$28.36	\$28.50	\$0.14	0.5%
RECO	\$44.46	\$41.54	(\$2.92)	(7.0%)	\$28.30	\$28.68	\$0.38	1.3%

PJM Day-Ahead and Real-Time, Average LMP during Constrained Hours

Table C-13 shows the number of constrained hours for the Day-Ahead and Real-Time Energy Markets and the total number of hours in each month for 2015.

Table C-13 PJM day-ahead and real-time, market-constrained hours: 2015

	DA Constrained Hours	RT Constrained Hours	Total Hours
Jan	744	734	744
Feb	672	661	672
Mar	743	706	743
Apr	720	701	720
May	744	729	744
Jun	720	675	720
Jul	744	686	744
Aug	744	646	744
Sep	720	630	720
Oct	744	714	744
Nov	721	714	721
Dec	744	662	744
Avg	730	688	730

Table C-14 shows PJM average LMP during constrained and unconstrained hours in the Day-Ahead and Real-Time Energy Markets.

Table C-14 PJM average LMP during constrained and unconstrained hours (Dollars per MWh): 2015¹²

	Day Ahead		Real Time		Difference		Percent Change	
	Unconstrained Hours LMP	Constrained Hours LMP						
Average	NA	\$53.61	\$32.51	\$49.26	NA	(\$4.35)	NA	(8.1%)
Median	NA	\$41.48	\$30.26	\$34.82	NA	(\$6.66)	NA	(16.1%)
Standard deviation	NA	\$53.95	\$15.08	\$66.96	NA	\$13.01	NA	24.1%

¹² All hours in 2015 were constrained in the Day Ahead Energy Market.

LMP by Zone and by Jurisdiction Jurisdiction Real-Time, Average LMP

Table C-15 Jurisdiction real-time, average LMP (Dollars per MWh): 2014 and 2015

	2014	2015	Difference	Percent Change
Delaware	\$52.99	\$33.81	(\$19.18)	(36.2%)
Illinois	\$39.54	\$28.21	(\$11.33)	(28.7%)
Indiana	\$42.31	\$30.32	(\$11.99)	(28.3%)
Kentucky	\$42.40	\$30.52	(\$11.88)	(28.0%)
Maryland	\$57.37	\$40.82	(\$16.55)	(28.9%)
Michigan	\$43.47	\$30.78	(\$12.69)	(29.2%)
New Jersey	\$52.53	\$33.61	(\$18.92)	(36.0%)
North Carolina	\$52.55	\$36.45	(\$16.10)	(30.6%)
Ohio	\$43.86	\$31.72	(\$12.14)	(27.7%)
Pennsylvania	\$48.14	\$32.06	(\$16.08)	(33.4%)
Tennessee	\$44.03	\$30.82	(\$13.21)	(30.0%)
Virginia	\$53.81	\$36.78	(\$17.03)	(31.7%)
West Virginia	\$44.17	\$33.31	(\$10.86)	(24.6%)
District of Columbia	\$57.58	\$39.33	(\$18.25)	(31.7%)

Hub Real-Time, Average LMP

Table C-16 Hub real-time, average LMP (Dollars per MWh): 2014 and 2015

	2014	2015	Difference	Percent Change
AEP Gen Hub	\$40.69	\$29.86	(\$10.83)	(26.6%)
AEP-DAY Hub	\$42.94	\$31.20	(\$11.74)	(27.3%)
ATSI Gen Hub	\$44.63	\$31.26	(\$13.37)	(30.0%)
Chicago Gen Hub	\$38.22	\$27.12	(\$11.10)	(29.1%)
Chicago Hub	\$39.62	\$28.30	(\$11.32)	(28.6%)
Dominion Hub	\$53.68	\$36.60	(\$17.08)	(31.8%)
Eastern Hub	\$56.15	\$37.24	(\$18.91)	(33.7%)
N Illinois Hub	\$39.33	\$28.14	(\$11.19)	(28.4%)
New Jersey Hub	\$52.32	\$33.33	(\$18.99)	(36.3%)
Ohio Hub	\$42.82	\$30.94	(\$11.88)	(27.7%)
West Interface Hub	\$47.21	\$32.67	(\$14.54)	(30.8%)
Western Hub	\$49.95	\$35.23	(\$14.72)	(29.5%)

Jurisdiction Real-Time, Load-Weighted, Average LMP

Table C-17 Jurisdiction real-time, load-weighted, average LMP (Dollars per MWh): 2014 and 2015

	2014	2015	Difference	Percent Change
Delaware	\$60.71	\$38.21	(\$22.50)	(37.1%)
Illinois	\$42.04	\$29.85	(\$12.19)	(29.0%)
Indiana	\$44.35	\$31.55	(\$12.80)	(28.9%)
Kentucky	\$48.47	\$33.18	(\$15.29)	(31.5%)
Maryland	\$66.81	\$45.42	(\$21.39)	(32.0%)
Michigan	\$46.14	\$32.29	(\$13.85)	(30.0%)
New Jersey	\$59.64	\$36.44	(\$23.20)	(38.9%)
North Carolina	\$57.07	\$40.58	(\$16.49)	(28.9%)
Ohio	\$47.03	\$33.64	(\$13.39)	(28.5%)
Pennsylvania	\$53.64	\$35.47	(\$18.17)	(33.9%)
Tennessee	\$51.19	\$33.86	(\$17.33)	(33.9%)
Virginia	\$62.27	\$40.95	(\$21.32)	(34.2%)
West Virginia	\$48.50	\$35.99	(\$12.51)	(25.8%)
District of Columbia	\$63.15	\$42.16	(\$20.99)	(33.2%)

Zonal Day-Ahead, Average LMP

Table C-18 Zonal day-ahead, average LMP (Dollars per MWh): 2014 and 2015

	2014	2015	Difference	Percent Change
AECO	\$53.64	\$33.98	(\$19.66)	(36.6%)
AEP	\$44.76	\$32.21	(\$12.55)	(28.0%)
AP	\$47.83	\$35.01	(\$12.82)	(26.8%)
ATSI	\$46.37	\$32.63	(\$13.74)	(29.6%)
BGE	\$60.22	\$43.73	(\$16.49)	(27.4%)
ComEd	\$40.19	\$28.01	(\$12.18)	(30.3%)
DAY	\$45.13	\$32.45	(\$12.68)	(28.1%)
DEOK	\$43.36	\$31.82	(\$11.54)	(26.6%)
DLCO	\$42.47	\$30.94	(\$11.53)	(27.1%)
Dominion	\$53.69	\$38.67	(\$15.02)	(28.0%)
DPL	\$58.30	\$37.48	(\$20.82)	(35.7%)
EKPC	\$42.78	\$30.61	(\$12.17)	(28.4%)
JCPL	\$54.17	\$33.80	(\$20.37)	(37.6%)
Met-Ed	\$52.07	\$32.94	(\$19.13)	(36.7%)
PECO	\$52.59	\$33.13	(\$19.46)	(37.0%)
PENELEC	\$49.22	\$33.65	(\$15.57)	(31.6%)
Pepco	\$58.27	\$40.81	(\$17.46)	(30.0%)
PPL	\$52.13	\$33.01	(\$19.12)	(36.7%)
PSEG	\$56.98	\$35.17	(\$21.81)	(38.3%)
RECO	\$56.37	\$35.37	(\$21.00)	(37.2%)

Jurisdiction Day-Ahead, Average LMP

Table C-19 Jurisdiction day-ahead, average LMP (Dollars per MWh): 2014 and 2015

	2014	2015	Difference	Percent Change
Delaware	\$55.31	\$34.56	(\$20.75)	(37.5%)
Illinois	\$40.19	\$28.01	(\$12.18)	(30.3%)
Indiana	\$44.14	\$31.12	(\$13.02)	(29.5%)
Kentucky	\$43.20	\$30.97	(\$12.23)	(28.3%)
Maryland	\$58.82	\$42.03	(\$16.79)	(28.5%)
Michigan	\$43.95	\$31.46	(\$12.49)	(28.4%)
New Jersey	\$52.10	\$34.64	(\$17.46)	(33.5%)
North Carolina	\$55.72	\$37.79	(\$17.93)	(32.2%)
Ohio	\$44.17	\$31.85	(\$12.32)	(27.9%)
Pennsylvania	\$50.22	\$33.16	(\$17.06)	(34.0%)
Tennessee	\$43.15	\$31.12	(\$12.03)	(27.9%)
Virginia	\$52.99	\$38.25	(\$14.74)	(27.8%)
West Virginia	\$44.56	\$32.93	(\$11.63)	(26.1%)
District of Columbia	\$58.42	\$40.96	(\$17.46)	(29.9%)

Zonal Day-Ahead, Load-Weighted, Average LMP

Table C-20 Zonal day-ahead, load-weighted, average LMP (Dollars per MWh): 2014 and 2015

	2014	2015	Difference	Percent Change
AECO	\$57.24	\$36.86	(\$20.38)	(35.6%)
AEP	\$48.82	\$34.20	(\$14.62)	(30.0%)
AP	\$52.60	\$37.95	(\$14.65)	(27.9%)
ATSI	\$49.52	\$34.34	(\$15.18)	(30.7%)
BGE	\$68.52	\$47.92	(\$20.60)	(30.1%)
ComEd	\$42.82	\$29.45	(\$13.37)	(31.2%)
DAY	\$48.95	\$34.39	(\$14.56)	(29.7%)
DEOK	\$46.19	\$33.90	(\$12.29)	(26.6%)
DLCO	\$44.95	\$32.57	(\$12.38)	(27.5%)
Dominion	\$60.44	\$43.09	(\$17.35)	(28.7%)
DPL	\$66.59	\$42.28	(\$24.31)	(36.5%)
EKPC	\$48.80	\$33.42	(\$15.38)	(31.5%)
JCPL	\$59.42	\$36.86	(\$22.56)	(38.0%)
Met-Ed	\$57.42	\$35.82	(\$21.60)	(37.6%)
PECO	\$57.60	\$35.96	(\$21.64)	(37.6%)
PENELEC	\$51.32	\$35.90	(\$15.42)	(30.0%)
Pepco	\$64.04	\$44.38	(\$19.66)	(30.7%)
PPL	\$59.04	\$36.62	(\$22.42)	(38.0%)
PSEG	\$61.29	\$37.82	(\$23.47)	(38.3%)
RECO	\$59.75	\$38.10	(\$21.65)	(36.2%)

Jurisdiction Day-Ahead, Load-Weighted, Average LMP

Table C-21 Jurisdiction day-ahead, load-weighted, average LMP (Dollars per MWh): 2014 and 2015

	2014	2015	Difference	Percent Change
Delaware	\$62.74	\$38.49	(\$24.25)	(38.7%)
Illinois	\$42.82	\$29.45	(\$13.37)	(31.2%)
Indiana	\$47.49	\$32.32	(\$15.17)	(31.9%)
Kentucky	\$49.21	\$33.50	(\$15.71)	(31.9%)
Maryland	\$66.25	\$46.20	(\$20.05)	(30.3%)
Michigan	\$47.82	\$32.86	(\$14.96)	(31.3%)
New Jersey	\$57.45	\$37.43	(\$20.02)	(34.8%)
North Carolina	\$60.19	\$42.35	(\$17.84)	(29.6%)
Ohio	\$47.38	\$33.61	(\$13.77)	(29.1%)
Pennsylvania	\$54.83	\$36.00	(\$18.83)	(34.3%)
Tennessee	\$47.64	\$33.46	(\$14.18)	(29.8%)
Virginia	\$59.54	\$42.60	(\$16.94)	(28.4%)
West Virginia	\$48.88	\$35.28	(\$13.60)	(27.8%)
District of Columbia	\$62.91	\$43.67	(\$19.24)	(30.6%)

Zonal Price Differences Between Day-Ahead and Real-Time

Table C-22 Zonal day-ahead and real-time average LMP (Dollars per MWh): 2015

	Day Ahead	Real Time	Difference	Percent of Real Time
AECO	\$33.98	\$32.86	(\$1.12)	(3.4%)
AEP	\$32.21	\$31.76	(\$0.45)	(1.4%)
AP	\$35.01	\$34.78	(\$0.23)	(0.7%)
ATSI	\$32.63	\$32.10	(\$0.53)	(1.7%)
BGE	\$43.73	\$42.84	(\$0.89)	(2.1%)
ComEd	\$28.01	\$28.21	\$0.20	0.7%
DAY	\$32.45	\$32.11	(\$0.34)	(1.1%)
DEOK	\$31.82	\$31.19	(\$0.63)	(2.0%)
DLCO	\$30.94	\$30.45	(\$0.49)	(1.6%)
Dominion	\$38.67	\$37.24	(\$1.43)	(3.8%)
DPL	\$37.48	\$30.45	(\$7.03)	(23.1%)
EKPC	\$30.61	\$30.10	(\$0.51)	(1.7%)
JCPL	\$33.80	\$32.36	(\$1.44)	(4.4%)
Met-Ed	\$32.94	\$32.17	(\$0.77)	(2.4%)
PECO	\$33.13	\$31.80	(\$1.33)	(4.2%)
PENELEC	\$33.65	\$33.47	(\$0.18)	(0.5%)
Pepco	\$40.81	\$39.21	(\$1.60)	(4.1%)
PPL	\$33.01	\$31.93	(\$1.08)	(3.4%)
PSEG	\$35.17	\$34.38	(\$0.79)	(2.3%)
RECO	\$35.37	\$35.02	(\$0.35)	(1.0%)
PJM	\$34.12	\$33.39	(\$0.73)	(2.2%)

Jurisdictional Price Differences Between Day-Ahead and Real-Time

Table C-23 Jurisdiction day-ahead and real-time average LMP (Dollars per MWh): 2015

	Day Ahead	Real Time	Difference	Percent of Real Time
Delaware	\$34.56	\$33.81	(\$0.75)	(2.2%)
Illinois	\$28.01	\$28.21	\$0.20	0.7%
Indiana	\$31.12	\$30.32	(\$0.80)	(2.6%)
Kentucky	\$30.97	\$30.52	(\$0.45)	(1.5%)
Maryland	\$42.03	\$40.82	(\$1.21)	(3.0%)
Michigan	\$31.46	\$30.78	(\$0.68)	(2.2%)
New Jersey	\$34.64	\$33.61	(\$1.03)	(3.1%)
North Carolina	\$37.79	\$36.45	(\$1.34)	(3.7%)
Ohio	\$31.85	\$31.72	(\$0.13)	(0.4%)
Pennsylvania	\$33.16	\$32.26	(\$0.90)	(2.8%)
Tennessee	\$31.12	\$30.82	(\$0.30)	(1.0%)
Virginia	\$38.25	\$36.78	(\$1.47)	(4.0%)
West Virginia	\$32.93	\$33.31	\$0.38	1.1%
District of Columbia	\$40.96	\$39.33	(\$1.63)	(4.1%)

Offer-Capped Units

PJM's market power mitigation goals have focused on market designs that promote competition and that limit market power mitigation to situations where market structure is not competitive and thus where market design alone cannot mitigate market power. In the PJM Energy Market, this situation occurs primarily in the case of local market power. Offer capping occurs as a result of structurally noncompetitive local markets and noncompetitive offers in the Day-Ahead and Real-Time Energy Markets. PJM also uses offer capping for units that are committed for reliability reasons, specifically for providing black start, reactive service and for units committed manually as part of conservative operations.

PJM has clear rules limiting the exercise of local market power.¹³ The rules provide for offer capping when conditions on the transmission system create a structurally noncompetitive local market, when units in that local market have made noncompetitive offers and when such offers would set the price above the competitive level in the absence of mitigation. Offer caps are set at the level of a competitive offer. Offer capped units receive the higher of the market price or their offer cap. Thus, if broader market conditions lead to a price greater than the offer cap, the unit receives the higher market price. The rules governing the exercise of local market power recognize that units in certain areas of the system would be in a position to extract monopoly profits, but for these rules.

Table C-24 Average day-ahead, offer capped units: 2011 through 2015

	2011		2012		2013		2014		2015	
	Avg. Units Capped	Percent								
Jan	0.0	0.0%	0.0	0.0%	12.6	3.3%	6.3	1.3%	2.5	0.6%
Feb	0.0	0.0%	0.8	0.2%	12.4	3.2%	1.6	0.4%	2.3	0.5%
Mar	0.1	0.0%	0.1	0.0%	10.3	2.7%	2.3	0.5%	2.5	0.6%
Apr	0.3	0.1%	0.0	0.0%	8.6	2.4%	1.6	0.4%	4.3	1.1%
May	0.1	0.0%	0.8	0.2%	10.5	2.8%	1.9	0.5%	4.4	1.1%
Jun	0.0	0.0%	0.1	0.0%	14.5	3.4%	3.2	0.7%	5.4	1.2%
Jul	0.2	0.0%	0.1	0.0%	14.2	3.0%	1.3	0.3%	2.7	0.6%
Aug	0.3	0.1%	0.1	0.0%	13.7	3.2%	0.3	0.1%	2.2	0.5%
Sep	0.2	0.1%	5.0	1.4%	17.1	4.4%	0.7	0.2%	0.9	0.2%
Oct	0.0	0.0%	10.0	3.1%	17.4	4.7%	3.1	0.8%	1.0	0.3%
Nov	0.1	0.0%	9.7	2.8%	12.8	3.3%	4.4	1.1%	1.8	0.5%
Dec	0.0	0.0%	13.1	3.6%	9.0	2.1%	2.7	0.6%	0.7	0.2%

Table C-25 Average day-ahead, offer capped MW: 2011 through 2015

	2011		2012		2013		2014		2015	
	Avg. MW Capped	Percent								
Jan	5	0.0%	0	0.0%	1,949	2.0%	905	0.8%	311	0.3%
Feb	0	0.0%	515	0.5%	1,982	2.0%	372	0.4%	355	0.3%
Mar	8	0.0%	68	0.1%	1,363	1.5%	609	0.6%	402	0.4%
Apr	33	0.0%	1	0.0%	1,340	1.6%	168	0.2%	1,164	1.5%
May	14	0.0%	36	0.0%	1,826	2.2%	179	0.2%	1,015	1.2%
Jun	4	0.0%	4	0.0%	2,486	2.6%	565	0.6%	1,587	1.7%
Jul	20	0.0%	3	0.0%	2,632	2.5%	320	0.3%	858	0.8%
Aug	43	0.0%	28	0.0%	2,076	2.1%	64	0.1%	787	0.8%
Sep	25	0.0%	650	0.7%	2,117	2.4%	79	0.1%	110	0.1%
Oct	1	0.0%	1,052	1.3%	2,108	2.5%	373	0.5%	243	0.3%
Nov	22	0.0%	1,210	1.4%	1,791	2.0%	454	0.5%	355	0.4%
Dec	0	0.0%	1,724	1.9%	1,883	1.9%	282	0.3%	49	0.1%

¹³ See OA Schedule 1, § 6.4.2.

Under existing rules, PJM suspends offer capping when structural market conditions, as determined by the three pivotal supplier test, indicate that suppliers are reasonably likely to behave in a competitive manner.¹⁴ The goal is to apply a clear rule to limit the exercise of market power by generation owners in load pockets, but to apply the rule in a flexible manner in real time and to lift offer capping when the exercise of market power is unlikely based on the real-time application of the market structure screen.

(reactive support, black start service and conservative operations).

In order to help understand the frequency of offer capping in more detail, Table C-28 through Table C-32 show the number of generating units that met the specified criteria for total offer capped run hours and percentage of offer capped run hours for the years 2011 through 2015 in the Real-Time Energy Market.

Table C-26 Average real-time, offer capped units: 2011 through 2015

	2011		2012		2013		2014		2015	
	Avg. Units Capped	Percent								
Jan	2.5	0.6%	4.0	0.9%	13.6	2.9%	13.2	2.4%	3.7	0.8%
Feb	2.1	0.5%	6.7	1.5%	13.8	3.0%	4.3	0.8%	4.7	0.9%
Mar	1.2	0.3%	9.8	2.2%	10.8	2.3%	6.4	1.2%	3.9	0.8%
Apr	2.6	0.7%	7.5	1.7%	9.9	2.2%	1.7	0.4%	5.2	1.1%
May	1.8	0.5%	6.1	1.3%	10.9	2.3%	3.0	0.6%	5.5	1.1%
Jun	4.1	0.9%	4.8	0.9%	15.2	3.0%	4.6	0.9%	6.3	1.2%
Jul	7.9	1.5%	5.9	1.0%	15.8	2.8%	2.6	0.5%	3.5	0.6%
Aug	2.0	0.4%	5.3	1.0%	14.6	2.9%	0.8	0.2%	3.1	0.6%
Sep	3.7	0.9%	8.4	1.9%	20.0	4.2%	1.4	0.3%	2.3	0.5%
Oct	2.4	0.6%	10.4	2.5%	18.1	4.0%	3.8	0.9%	1.8	0.4%
Nov	2.4	0.6%	10.3	2.4%	14.0	3.1%	4.9	1.1%	2.5	0.6%
Dec	3.1	0.7%	14.4	3.2%	11.2	2.4%	3.2	0.7%	1.6	0.3%

Table C-27 Average real-time, offer capped MW: 2011 through 2015

	2011		2012		2013		2014		2015	
	Avg. MW Capped	Percent								
Jan	149	0.2%	254	0.3%	1,886	2.0%	1,363	1.3%	351	0.4%
Feb	106	0.1%	987	1.1%	1,902	2.0%	452	0.5%	353	0.3%
Mar	86	0.1%	1,162	1.5%	1,315	1.5%	824	0.9%	487	0.5%
Apr	236	0.3%	688	0.9%	1,328	1.7%	192	0.2%	1,091	1.4%
May	157	0.2%	461	0.6%	1,614	2.0%	264	0.3%	1,003	1.2%
Jun	274	0.3%	384	0.4%	2,403	2.6%	649	0.7%	1,580	1.7%
Jul	402	0.4%	482	0.5%	2,632	2.6%	372	0.4%	957	1.0%
Aug	126	0.1%	542	0.6%	2,095	2.2%	90	0.1%	708	0.7%
Sep	215	0.3%	954	1.1%	2,309	2.7%	121	0.1%	207	0.2%
Oct	193	0.3%	1,017	1.3%	2,223	2.8%	431	0.6%	248	0.3%
Nov	176	0.2%	1,078	1.3%	2,159	2.5%	425	0.5%	368	0.5%
Dec	208	0.2%	1,752	2.0%	2,376	2.6%	298	0.3%	100	0.1%

Levels of offer capping have generally been low and stable over the last five years. Table C-24 through Table C-27 show offer capping by month, including the number of offer capped units and the level of offer capped MW in the Day-Ahead and Real-Time Energy Markets. The statistics include units that are capped for failing the TPS test to provide constraint relief as well as units committed on their cost schedule for reliability reasons

¹⁴ See the *Technical Reference for PJM Markets*, Section 8, "Three Pivotal Supplier Test."

Table C-28 Offer-capped unit statistics: 2011

Run Hours Offer-Capped, Percent Greater Than Or Equal To:	2011 Offer-Capped Hours					
	Hours ≥ 500	Hours ≥ 400 and < 500	Hours ≥ 300 and < 400	Hours ≥ 200 and < 300	Hours ≥ 100 and < 200	Hours ≥ 1 and < 100
90%	0	0	0	6	9	4
80% and < 90%	0	0	1	2	5	9
75% and < 80%	0	0	0	0	3	3
70% and < 75%	0	0	0	0	0	10
60% and < 70%	0	1	0	1	1	20
50% and < 60%	0	0	0	2	13	23
25% and < 50%	2	0	0	5	19	70
10% and < 25%	9	2	0	0	2	49

Table C-29 Offer capped unit statistics: 2012

Run Hours Offer-Capped, Percent Greater Than Or Equal To:	2012 Offer-Capped Hours					
	Hours ≥ 500	Hours ≥ 400 and < 500	Hours ≥ 300 and < 400	Hours ≥ 200 and < 300	Hours ≥ 100 and < 200	Hours ≥ 1 and < 100
90%	0	1	0	1	1	1
80% and < 90%	0	1	1	0	1	2
75% and < 80%	0	0	0	0	0	2
70% and < 75%	0	0	0	0	1	2
60% and < 70%	0	0	0	1	1	9
50% and < 60%	3	0	1	0	1	6
25% and < 50%	6	1	0	3	2	45
10% and < 25%	2	2	0	3	12	58

Table C-30 Offer capped unit statistics: 2013

Run Hours Offer-Capped, Percent Greater Than Or Equal To:	2013 Offer-Capped Hours					
	Hours ≥ 500	Hours ≥ 400 and < 500	Hours ≥ 300 and < 400	Hours ≥ 200 and < 300	Hours ≥ 100 and < 200	Hours ≥ 1 and < 100
90%	0	0	0	0	0	0
80% and < 90%	0	0	0	1	1	3
75% and < 80%	0	0	0	0	1	2
70% and < 75%	0	0	1	0	0	3
60% and < 70%	0	0	0	0	0	4
50% and < 60%	0	0	0	0	0	9
25% and < 50%	0	3	3	1	7	44
10% and < 25%	2	0	0	4	3	46

Table C-31 Offer capped unit statistics: 2014

Run Hours Offer-Capped, Percent Greater Than Or Equal To:	2014 Offer-Capped Hours					
	Hours ≥ 500	Hours ≥ 400 and < 500	Hours ≥ 300 and < 400	Hours ≥ 200 and < 300	Hours ≥ 100 and < 200	Hours ≥ 1 and < 100
90%	1	0	0	0	0	0
80% and < 90%	2	0	0	3	0	0
75% and < 80%	1	0	0	0	1	0
70% and < 75%	0	0	0	0	0	0
60% and < 70%	0	0	0	1	7	5
50% and < 60%	0	0	0	0	3	6
25% and < 50%	0	3	1	1	10	45
10% and < 25%	0	1	4	1	8	56

Table C-32 Offer-capped unit statistics: 2015

Run Hours Offer-Capped, Percent Greater Than Or Equal To:	2015 Offer-Capped Hours					
	Hours ≥ 500	Hours ≥ 400 and < 500	Hours ≥ 300 and < 400	Hours ≥ 200 and < 300	Hours ≥ 100 and < 200	Hours ≥ 1 and < 100
90%	2	0	0	0	1	4
80% and < 90%	0	1	1	0	0	6
75% and < 80%	0	0	0	0	0	3
70% and < 75%	0	0	0	0	0	4
60% and < 70%	0	0	0	1	0	9
50% and < 60%	0	0	0	0	1	9
25% and < 50%	0	0	0	0	1	26
10% and < 25%	0	0	5	2	5	34

Energy Uplift

Credits and Charges to Generators

Table C-33 and Table C-34 compare the share of balancing operating reserve charges paid by generators and balancing operating reserve credits paid to generators in the Eastern Region and the Western Region. Generator charges are defined in these tables as the allocation of charges paid by generators due to generator deviations from day-ahead schedules or not following PJM dispatch.

Table C-33 shows that on average, 13.8 percent of the RTO and Eastern Region balancing generator charges, including lost opportunity cost and canceled resources charges, were paid by generators deviating in the Eastern Region while these generators received 68.2 percent of all balancing generator credits.

Table C-33 Monthly balancing operating reserve charges and credits to generators in the Eastern Region (Millions): 2015

	Generators RTO Deviation Charges	Generators Regional Deviation Charges	Generators LOC and Canceled Resources Charges	Total Charges	Balancing, LOC and Canceled Resources Credits
Jan	\$1.7	\$0.1	\$0.7	\$2.5	\$20.3
Feb	\$4.6	\$0.1	\$4.1	\$8.7	\$52.1
Mar	\$0.5	\$0.2	\$1.9	\$2.7	\$17.5
Apr	\$0.2	\$0.1	\$0.7	\$0.9	\$6.3
May	\$0.5	\$0.2	\$1.0	\$1.7	\$7.9
Jun	\$0.2	\$0.1	\$0.6	\$0.8	\$5.0
Jul	\$0.4	\$0.1	\$0.7	\$1.1	\$6.6
Aug	\$0.4	\$0.0	\$0.3	\$0.7	\$6.7
Sep	\$0.2	\$0.1	\$0.5	\$0.8	\$5.7
Oct	\$0.1	\$0.0	\$0.2	\$0.4	\$2.6
Nov	\$0.1	\$0.1	\$0.5	\$0.7	\$2.4
Dec	\$0.1	\$0.0	\$0.3	\$0.5	\$2.2
East Generators Total	\$9.0	\$1.2	\$11.4	\$21.5	\$135.5
PJM Total	\$65.8	\$4.8	\$85.0	\$155.6	\$198.5
Share	13.6%	24.1%	13.4%	13.8%	68.2%

Table C-34 shows that generators in the Western Region paid 12.0 percent of the RTO and Western Region balancing generator charges including lost opportunity cost and canceled resources charges while these generators received 31.5 percent of all balancing generator credits.

Table C-34 Monthly balancing operating reserve charges and credits to generators in the Western Region (Millions): 2015

	Generators RTO Deviation Charges	Generators Regional Deviation Charges	Generators LOC and Canceled Resources Charges	Total Charges	Balancing, LOC and Canceled Resources Credits
Jan	\$1.7	\$0.0	\$0.7	\$2.4	\$4.1
Feb	\$4.0	\$0.1	\$3.1	\$7.2	\$18.6
Mar	\$0.5	\$0.1	\$1.8	\$2.4	\$7.2
Apr	\$0.2	\$0.0	\$0.7	\$1.0	\$2.1
May	\$0.5	\$0.1	\$0.8	\$1.3	\$7.6
Jun	\$0.2	\$0.0	\$0.5	\$0.7	\$3.8
Jul	\$0.3	\$0.0	\$0.5	\$0.8	\$5.5
Aug	\$0.3	\$0.0	\$0.3	\$0.6	\$2.3
Sep	\$0.1	\$0.0	\$0.4	\$0.6	\$3.3
Oct	\$0.1	\$0.0	\$0.2	\$0.4	\$2.5
Nov	\$0.1	\$0.0	\$0.5	\$0.6	\$3.7
Dec	\$0.1	\$0.0	\$0.3	\$0.4	\$2.0
West Generators Total	\$8.1	\$0.4	\$9.8	\$18.4	\$62.6
PJM Total	\$65.8	\$1.9	\$85.0	\$152.7	\$198.5
Share	12.3%	21.6%	11.6%	12.0%	31.5%

Table C-35 shows that on average in 2015, energy uplift charges paid by generators were 12.7 percent of all energy uplift charges, 2.5 percentage point higher than the average in 2014. Generators received 99.9 percent of all energy uplift credits, while the remaining 0.1 percent of credits were paid to import transactions and demand resources.

Table C-35 Percentage of generators credits and charges of total credits and charges: 2014 and 2015

	2014		2015	
	Generators Share of Total Energy Uplift Charges	Generators Share of Total Energy Uplift Credits	Generators Share of Total Energy Uplift Charges	Generators Share of Total Energy Uplift Credits
Jan	9.4%	100.0%	10.9%	100.0%
Feb	15.9%	100.0%	15.1%	99.7%
Mar	13.6%	100.0%	14.3%	99.9%
Apr	7.1%	100.0%	13.7%	99.8%
May	12.6%	100.0%	13.9%	100.0%
Jun	11.1%	100.0%	8.3%	100.0%
Jul	8.8%	100.0%	11.1%	100.0%
Aug	10.0%	100.0%	9.4%	99.8%
Sep	8.1%	100.0%	9.7%	99.9%
Oct	8.7%	100.0%	8.3%	99.8%
Nov	10.2%	100.0%	12.2%	100.0%
Dec	7.9%	100.0%	9.7%	100.0%
Average	10.2%	100.0%	12.7%	99.9%

Energy Uplift Charges by Transaction/Resource Type

Table C-36 shows the energy uplift charges and applicable rates for each type of resource or transaction in PJM.

Table C-36 Energy uplift charge by transaction/resource type

Charge	Rate	Transaction / Resource Type										
		Load	Generation	Imports ¹	Exports ¹	Wheels	Economic	DR	INCs	DECs	IBTs	UTCs
Day-Ahead Operating Reserve	Day-Ahead Operating Reserve Rate	X				X					X	
Balancing Operating Reserves for Reliability	RTO Reliability Rate	X				X						
Balancing Operating Reserves for Deviations ²	Regional (East or West) Reliability Rate	X				X						
	RTO Deviation Rate	X	X	X	X		X	X	X	X		
	Regional (East or West) Deviation Rate	X	X	X	X		X	X	X	X		
	LOC Rate	X	X	X	X		X	X	X	X		
	Canceled Resources Rate	X	X	X	X		X	X	X	X		
Reactive Services	Implicit Rates	X										
Black Start Services	Implicit Rates	X ³		X ⁴	X ⁴	X ⁴						
Synchronous Condensing	Implicit Rate	X				X						

1 Dynamic scheduled transactions are exempt from operating reserve charges.

2 Participants only pay deviation charges if they incur deviations based on the rules specified in Manual 28.

3 Load is charged black start services based on their zonal peak load contribution.

4 Interchange transactions are charged black start services based on their point to point firm and non-firm reservations.

Appendix D Local Energy Market Structure: TPS Results

The three pivotal supplier test is applied by PJM on an ongoing basis in order to determine whether structural market power requires offer capping to prevent the potential exercise of local market power for binding constraints.

The MMU analyzed the results of the three pivotal supplier tests conducted by PJM for the Real-Time Energy Market for the period January 1, 2015, through December 31, 2015. The three pivotal supplier test is applied every time the system solution indicates that out of merit resources are needed to relieve a transmission constraint. Only uncommitted resources, which would be started to relieve the transmission constraint, are subject to offer capping. Already committed units that can provide incremental relief cannot be offer capped if they were committed for another reason. The results of the TPS test are shown for tests that could have resulted in offer capping and tests that did result in offer capping.

Overall, the results confirm that the three pivotal supplier test results in offer capping when the local market is structurally noncompetitive and does not result in offer capping when that is not the case. Local markets are noncompetitive when the number of suppliers is relatively small.

This appendix provides data on the TPS tests that were applied in PJM control zones that had congestion from one or more constraints for 100 or more hours in real time. In 2015, the AECO, AEP, AP, ATSI, BGE, ComEd, DEOK, DLCO, Dominion, DPL, MetEd, PECO, PENELEC, PPL and PSEG control zones experienced congestion resulting from one or more constraints binding for 100 or more hours. Using the three pivotal supplier results for 2015, actual competitive conditions associated with each of these frequently binding constraints were analyzed for the Real Time Energy Market.¹ The DAY, EKPC, JCPL, Pepco, and RECO control zones were not affected by constraints binding for 100 or more hours.

¹ See the *Technical Reference for PJM Markets*, at "Three Pivotal Supplier Test" for a more detailed explanation of the three pivotal supplier test.

Information is provided, by qualifying zone, for each constraint including the number of tests applied, the number of tests that could have resulted in offer capping and the number of tests that did result in offer capping.² Additional information is provided for each constraint including the average MW required to relieve a constraint, the average supply available, the average number of owners included in each test and the average number of owners that passed or failed each test.

AECO Control Zone Results

In 2015, there was one constraint that occurred for more than 100 hours in the AECO Control Zone. Table D-1 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owners passing and failing. Table D-1 shows that for the Monroe – Vineland Constraint in the AECO Zone, there was one owner, on average, with available supply to relieve the constraint.

Table D-1 Three pivotal supplier test details for constraints located in the AEP Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Monroe - Vineland	Peak	21	23	1	0	1
	Off Peak	13	14	1	0	1

Table D-2 shows the total tests applied for the constraint in the AECO Zone, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-2 shows that for the Monroe – Vineland Constraint in the AECO Zone, one percent or fewer of the total tests applied resulted in offer capping.

² The three pivotal supplier test in the Real-Time Energy Market is applied by PJM as necessary and may be applied multiple times within a single hour for a specific constraint. Each application of the test is done in a five-minute interval.

Table D-2 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the AECO Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping
Monroe - Vineland	Peak	149	2	1%	1	1%	50%
	Off Peak	25	0	0%	0	0%	0%

AEP Control Zone Results

In 2015, there were five constraints that occurred for more than 100 hours in the AEP Control Zone. Table D-3 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owners passing and failing. Table D-3 shows that for three of the constraints in the AEP Zone, there was one owner, on average, with available supply to relieve the constraint.

Table D-3 Three pivotal supplier test details for constraints located in the AEP Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Carnegie - Tidd	Peak	32	22	1	0	1
	Off Peak	30	21	1	0	1
East Danville - Banister	Peak	9	1	1	0	1
	Off Peak	10	3	1	0	1
Laporte - Michigan City	Peak	14	16	3	0	3
	Off Peak	10	13	4	0	4
Mahans Lane - Tidd	Peak	34	17	1	0	1
	Off Peak	34	15	1	0	1
Wolf Creek	Peak	33	13	2	0	2
	Off Peak	40	19	2	0	2

Table D-4 shows the total tests applied for the constraints in the AEP Zone, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-4 shows that for all five constraints in the AEP Zone, zero percent of the total tests applied resulted in offer capping.

Table D-4 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the AEP Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping
Carnegie - Tidd	Peak	1,107	0	0%	0	0%	0%
	Off Peak	858	0	0%	0	0%	0%
East Danville - Banister	Peak	136	0	0%	0	0%	0%
	Off Peak	299	0	0%	0	0%	0%
Laporte - Michigan City	Peak	905	5	1%	0	0%	0%
	Off Peak	1,709	0	0%	0	0%	0%
Mahans Lane - Tidd	Peak	1,192	0	0%	0	0%	0%
	Off Peak	1,695	0	0%	0	0%	0%
Wolf Creek	Peak	914	0	0%	0	0%	0%
	Off Peak	1,251	0	0%	0	0%	0%

AP Control Zone Results

In 2015, there was one constraint that occurred for more than 100 hours in the AP Control Zone. Table D-5 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owners passing and failing. Table D-5 shows that on average, there was one owner with available supply on peak and off peak for the Crupperneck - Nettie Line.

Table D-5 Three pivotal supplier test details for constraints located in the AP Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Crupperneck - Nettie	Peak	31	11	1	0	1
	Off Peak	27	17	1	0	1

Table D-6 shows the total tests applied for the constraint in the AP Zone, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-6 shows that none of the tests applied to the Crupperneck - Nettie Constraint in the AP Zone resulted in offer capping.

Table D-6 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the AP Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping
Crupperneck - Nettie	Peak	329	0	0%	0	0%	0%
	Off Peak	695	0	0%	0	0%	0%

ATSI Control Zone Results

In 2015, there were two constraints in the ATSI Control Zone that occurred for more than 100 hours. Table D-7 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owners passing and failing. Table D-7 shows that for both the constraints in the ATSI Zone, there were less than three owners, on average, with available supply to relieve the constraint.

Table D-7 Three pivotal supplier test details for constraints located in the ATSI Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Cleveland	Peak	194	202	1	0	1
	Off Peak	0	0	0	0	0
Lakeview - Greenfield	Peak	29	32	2	0	2
	Off Peak	23	22	1	0	1

Table D-8 shows the subset of three pivotal supplier tests that could have resulted in the offer capping of uncommitted units and those tests that did result in offer capping for constraints in the ATSI Zone. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-8 shows that none of the tests applied resulted in offer capping for both the constraints.

Table D-8 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the ATSI Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping	
						Percent Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping
Cleveland	Peak	65	0	0%	0	0%	0%
	Off Peak	0	0	0%	0	0%	0%
Lakeview - Greenfield	Peak	468	0	0%	0	0%	0%
	Off Peak	352	1	0%	0	0%	0%

BGE Control Zone Results

In 2015, there were four constraints that occurred for more than 100 hours in the BGE Control Zone. Table D-9 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owner passing and failing. Table D-9 shows that for three of the constraints in the BGE Zone, there were at least seven owners, on average, with available supply to relieve the constraint.

Table D-9 Three pivotal supplier test details for constraints located in the BGE Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Bagley - Graceton	Peak	95	124	11	1	10
	Off Peak	86	122	11	1	10
Conastone - Northwest	Peak	130	177	12	1	11
	Off Peak	110	156	12	1	11
Glenarm - Windy Edge	Peak	26	15	2	0	2
	Off Peak	29	13	2	0	2
Graceton - Safe Harbor	Peak	58	66	7	0	7
	Off Peak	44	50	8	0	7

Table D-10 shows the total tests applied for the three constraints in the BGE Zone, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-10 shows that two percent or less of the tests applied to the constraints in the BGE Zone could have resulted in offer capping and one percent or less of the tests resulted in offer capping.

Table D-10 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the BGE Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as
							Percent of Tests that Could Have Resulted in Offer Capping
Bagley - Graceton	Peak	8,286	171	2%	72	1%	42%
	Off Peak	15,414	217	1%	100	1%	46%
Conastone - Northwest	Peak	15,197	345	2%	133	1%	39%
	Off Peak	6,895	123	2%	36	1%	29%
Glenarm - Windy Edge	Peak	3,472	11	0%	1	0%	9%
	Off Peak	1,238	3	0%	0	0%	0%
Graceton - Safe Harbor	Peak	761	5	1%	2	0%	40%
	Off Peak	603	1	0%	0	0%	0%

ComEd Control Zone Results

In 2015, there were seven constraints that occurred for more than 100 hours in the ComEd Control Zone. Table D-11 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owner passing and failing. Table D-11 shows that for five out of the seven constraints in the ComEd Zone, on average, the number of owners with available supply was less than three.

Table D-11 Three pivotal supplier test details for constraints located in the ComEd Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Burnham - Munster	Peak	75	130	9	0	9
	Off Peak	68	108	8	1	7
Cherry Valley	Peak	21	24	1	0	1
	Off Peak	12	20	1	0	1
Crete - St Johns	Peak	70	109	4	0	4
	Off Peak	49	86	4	0	4
Dixon - McGirr	Peak	14	102	2	0	2
	Off Peak	12	113	2	0	2
Kewanee - Hennepin Tap	Peak	11	24	1	0	1
	Off Peak	9	19	1	0	1
Lancaster - Maryland	Peak	7	12	2	0	2
	Off Peak	5	5	2	0	2
Nelson	Peak	31	63	1	0	1
	Off Peak	4	1	1	0	1

Table D-12 shows the total tests applied for the seven constraints in the ComEd Zone, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-12 shows that for all constraints, one percent or less of the tests applied resulted in offer capping.

Table D-12 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the ComEd Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping
Burnham - Munster	Peak	562	10	2%	6	1%	60%
	Off Peak	928	7	1%	1	0%	14%
Cherry Valley	Peak	1,109	0	0%	0	0%	0%
	Off Peak	881	0	0%	0	0%	0%
Crete - St Johns	Peak	303	0	0%	0	0%	0%
	Off Peak	581	0	0%	0	0%	0%
Dixon - McGirr	Peak	1,885	1	0%	1	0%	100%
	Off Peak	1,561	0	0%	0	0%	0%
Kewanee - Hennepin Tap	Peak	246	0	0%	0	0%	0%
	Off Peak	196	0	0%	0	0%	0%
Lancaster - Maryland	Peak	369	0	0%	0	0%	0%
	Off Peak	222	0	0%	0	0%	0%
Nelson	Peak	142	0	0%	0	0%	0%
	Off Peak	97	0	0%	0	0%	0%

DEOK Control Zone Results

In 2015, there was one constraint that occurred for more than 100 hours in the DEOK Control Zone. Table D-13 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owner passing and failing. Table D-13 shows that for the Miami Fort - Willey Constraint, on average, the number of owners with available supply was two or less.

Table D-13 Three pivotal supplier test details for constraints located in the DEOK Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Miami Fort - Willey	Peak	12	7	1	0	1
	Off Peak	10	6	2	0	2

Table D-14 shows the total tests applied for the constraint in the DEOK Zone, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-14 shows that none of the tests applied to the Miami Fort - Willey Constraint resulted in offer capping.

Table D-14 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the DEOK Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping
Miami Fort - Willey	Peak	1,080	2	0%	0	0%	0%
	Off Peak	57	0	0%	0	0%	0%

DLCO Control Zone Results

In 2015, there were two constraints that occurred for more than 100 hours in the DLCO Control Zone. Table D-15 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owner passing and failing. Table D-11 shows that for both the constraints in the DLCO Zone, on average, the number of owners with available supply was two or less.

Table D-15 Three pivotal supplier test details for constraints located in the DLCO Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Dravosburg - West Mifflin	Peak	66	41	1	0	1
	Off Peak	87	49	1	0	1
USAP - Woodville	Peak	22	34	2	0	2
	Off Peak	37	38	2	0	2

Table D-16 shows the total tests applied for the two constraints in the DLCO Zone, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-16 shows that none of the tests applied resulted in offer capping for either constraint.

Table D-16 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the DLCO Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping
Dravosburg - West Mifflin	Peak	672	0	0%	0	0%	0%
	Off Peak	990	0	0%	0	0%	0%
USAP - Woodville	Peak	179	0	0%	0	0%	0%
	Off Peak	714	2	0%	0	0%	0%

Dominion Control Zone Results

In 2015, there were four constraints that occurred for more than 100 hours in the Dominion Control Zone. Table D-17 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owner passing and failing. Table D-17 shows that for two of the constraints in the Dominion Zone, on average, the number of owners with available supply was one.

Table D-17 Three pivotal supplier test details for constraints located in the Dominion Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Bremo	Peak	62	182	1	0	1
	Off Peak	60	150	1	0	1
Halifax	Peak	76	142	1	0	1
	Off Peak	52	90	1	0	1
Person - Halifax	Peak	69	45	5	0	4
	Off Peak	77	41	4	0	4
Pleasant View - Ashburn	Peak	95	127	10	1	10
	Off Peak	115	142	12	1	11

Table D-18 shows the total tests applied for the four constraints in the Dominion Zone, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-18 shows that three percent or less of the tests applied to the constraint in the Dominion Zone resulted in offer capping.

Table D-18 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the Dominion Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping
Bremo	Peak	551	0	0%	0	0%	0%
	Off Peak	216	0	0%	0	0%	0%
Halifax	Peak	2,506	0	0%	0	0%	0%
	Off Peak	1,671	0	0%	0	0%	0%
Person - Halifax	Peak	914	15	2%	8	1%	53%
	Off Peak	900	12	1%	7	1%	58%
Pleasant View - Ashburn	Peak	300	11	4%	8	3%	73%
	Off Peak	843	16	2%	8	1%	50%

DPL Control Zone Results

In 2015, there were four constraints that occurred for more than 100 hours in the DPL Control Zone. Table D-19 shows the average constraint relief required on each constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owners passing and failing. Table D-19 shows that for three of the four constraints in the DPL Zone, on average, the number of owners with available supply was one.

Table D-19 Three pivotal supplier test details for constraints located in the DPL Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Easton	Peak	24	21	1	0	1
	Off Peak	22	15	1	0	1
Kenney - Stockton	Peak	46	48	1	0	1
	Off Peak	27	27	1	0	1
Milford - Steele	Peak	64	73	3	0	3
	Off Peak	61	62	2	0	2
Mount Olive - Piney Grove	Peak	31	32	1	0	1
	Off Peak	19	20	1	0	1

Table D-20 shows the total tests applied for the four constraints in the DPL Zone, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-20 shows that only two percent or less of the tests applied to the constraints resulted in offer capping.

Table D-20 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the DPL Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping
Easton	Peak	1,079	6	1%	2	0%	33%
	Off Peak	633	5	1%	0	0%	0%
Kenney - Stockton	Peak	2,581	18	1%	1	0%	6%
	Off Peak	1,571	1	0%	0	0%	0%
Milford - Steele	Peak	523	16	3%	9	2%	56%
	Off Peak	593	24	4%	6	1%	25%
Mount Olive - Piney Grove	Peak	2,215	6	0%	0	0%	0%
	Off Peak	2,058	37	2%	0	0%	0%

MetEd Control Zone Results

In 2015, there was one constraint that occurred for more than 100 hours in the MetEd Control Zone. Table D-21 shows the average constraint relief required on each constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owner passing and failing. Table D-21 shows that for the Gardners – Texas East Constraint in the MetEd Zone, on average, the number of owners with available supply was one.

Table D-21 Three pivotal supplier test details for constraints located in the MetEd Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Gardners - Texas East	Peak	18	8	1	0	1
	Off Peak	10	12	1	0	1

Table D-24 shows the total tests applied for the constraints in the MetEd Zone, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-22 shows that two percent or less of the tests applied to the Gardners – Texas East Constraint in the MetEd Zone could have resulted in offer capping.

Table D-22 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the MetEd Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping
Gardners - Texas East	Peak	125	3	2%	1	1%	33%
	Off Peak	38	0	0%	0	0%	0%

PECO Control Zone Results

In 2015, there were three constraints that occurred for more than 100 hours in the PECO Control Zone. Table D-23 shows the average constraint relief required on each constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owner passing and failing. Table D-23 shows that for all three constraints in the PECO Zone, on average, the number of owners with available supply was two or less.

Table D-23 Three pivotal supplier test details for constraints located in the PECO Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Burlington - Croydon	Peak	32	89	2	0	2
	Off Peak	28	79	1	0	1
Emilie	Peak	52	137	1	0	1
	Off Peak	53	132	1	0	1
Emilie - Falls	Peak	25	49	2	0	2
	Off Peak	20	56	1	0	1

Table D-24 shows the total tests applied for the constraints in the PECO Zone, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-24 shows that one percent or less of the tests applied to the constraints in the PECO Zone could have resulted in offer capping.

Table D-24 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the PECO Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping
Burlington - Croydon	Peak	599	1	0%	1	0%	100%
	Off Peak	683	2	0%	1	0%	50%
Emilie	Peak	1,403	12	1%	0	0%	0%
	Off Peak	287	0	0%	0	0%	0%
Emilie - Falls	Peak	2,070	7	0%	0	0%	0%
	Off Peak	123	0	0%	0	0%	0%

PENELEC Control Zone Results

In 2015, there were three constraints that occurred for more than 100 hours in the PENELEC Control Zone. Table D-25 shows the average constraint relief required on each constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owner passing and failing. Table D-25 shows that for all three constraints in the PENELEC Zone, on average, the number of owners with available supply was one.

Table D-25 Three pivotal supplier test details for constraints located in the PENELEC Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Homer City	Peak	164	229	1	0	1
	Off Peak	128	174	1	0	1
SENECA	Peak	98	112	1	0	1
	Off Peak	100	126	1	0	1
Warren	Peak	60	60	1	0	1
	Off Peak	19	29	1	0	1

Table D-26 shows the total tests applied for the constraints in the PENELEC Zone, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-26 shows that none of the tests applied to the constraints in the PENELEC Zone could have resulted in offer capping.

Table D-26 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the PENELEC Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping
Homer City	Peak	1,214	0	0%	0	0%	0%
	Off Peak	102	0	0%	0	0%	0%
SENECA	Peak	3,776	0	0%	0	0%	0%
	Off Peak	6,234	0	0%	0	0%	0%
Warren	Peak	6	0	0%	0	0%	0%
	Off Peak	19	0	0%	0	0%	0%

PPL Control Zone Results

In 2015, there was one constraint that occurred for more than 100 hours in the PPL Control Zone. Table D-27 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owner passing and failing. Table D-27 shows that for the Conastone – Otter Creek Line, on average, there were nine owners on peak and eleven owners off peak with available supply to relieve the constraint.

Table D-27 Three pivotal supplier test details for constraints located in the PPL Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
Conastone - Otter Creek	Peak	89	110	9	0	9
	Off Peak	76	108	11	1	11

Table D-28 shows the total tests applied for the constraint in the PPL Zone, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-28 shows that one percent or fewer of the tests applied to the Conastone – Otter Creek Constraint in the PPL Zone resulted in offer capping.

Table D-28 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the PPL Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping
Conastone - Otter Creek	Peak	826	25	3%	12	1%	48%
	Off Peak	615	1	0%	0	0%	0%

PSEG Control Zone Results

In 2015, there were three constraints that occurred for more than 100 hours in the PSEG Control Zone. Table D-29 shows the average constraint relief required on the constraint, the average effective supply available to relieve the constraint, the average number of owners with available relief in the defined market and the average number of owners passing and failing. Table D-29 shows that for two of the three constraints in the PSEG Zone, the average number of owners with available supply was one.

Table D-29 Three pivotal supplier test details for constraints located in the PSEG Control Zone: 2015

Constraint	Period	Average Constraint Relief (MW)	Average Effective Supply (MW)	Average Number Owners	Average Number Owners Passing	Average Number Owners Failing
49th Street - Hoboken	Peak	26	47	1	0	1
	Off Peak	24	33	1	0	1
Bergen - New Milford	Peak	73	94	1	0	1
	Off Peak	60	103	1	0	1
Maywood - Saddlebrook	Peak	70	102	2	0	2
	Off Peak	79	108	2	0	2

Table D-30 shows the total tests applied for the constraints in the PSEG Zone, the subset of three pivotal supplier tests that could have resulted in offer capping and the portion of those tests that did result in offer capping. The results reflect the fact that units that are already running cannot be offer capped. Only uncommitted units, which would be started to provide constraint relief, are eligible to be offer capped. Table D-30 shows that two percent or less of the tests applied to the three constraints in the PSEG Zone could have resulted in offer capping.

Table D-30 Summary of three pivotal supplier tests applied to uncommitted units for constraints located in the PSEG Control Zone: 2015

Constraint	Period	Total Tests Applied	Total Tests that Could Have Resulted in Offer Capping	Percent Total Tests that Could Have Resulted in Offer Capping	Total Tests Resulted in Offer Capping	Percent Total Tests Resulted in Offer Capping	Tests Resulted in Offer Capping as Percent of Tests that Could Have Resulted in Offer Capping
49th Street - Hoboken	Peak	852	15	2%	14	2%	93%
	Off Peak	518	8	2%	8	2%	100%
Bergen - New Milford	Peak	2,693	19	1%	19	1%	100%
	Off Peak	3,266	13	0%	13	0%	100%
Maywood - Saddlebrook	Peak	2,715	22	1%	15	1%	68%
	Off Peak	1,183	11	1%	10	1%	91%

Appendix E Interchange Transactions

Submitting Transactions into PJM

In competitive wholesale power markets, market participants' decisions to buy and sell power are based on actual and expected prices. If contiguous wholesale power markets incorporate security constrained nodal pricing, well designed interface pricing provides economic signals for import and export decisions by market participants, although those signals may be attenuated by a variety of institutional arrangements.

The institutional details of completing import and export transactions include the Open Access Same-Time Information System (OASIS), North American Electric Reliability Council (NERC) Tags, neighboring balancing authority check out processes, and transaction curtailment rules.¹

Real-Time Energy Market

Market participants that wish to transact energy into, out of, or through PJM in the Real-Time Energy Market are required to make their requests to PJM via a NERC Interchange Transaction Tag (NERC Tag). PJM's Enhanced Energy Scheduler (EES) software interfaces with NERC Tags to create an interface that both PJM market participants and PJM can use to evaluate and manage external transactions that affect the PJM RTO.

Scheduling Requirements

External offers can be made either on the basis of an individual generator (resource specific offer), an aggregate of generation supply (aggregate offer) or an external market (pool supplied). Schedules are submitted to PJM by submitting a valid NERC Tag.

Specific timing requirements apply for the submission of schedules. Schedules can be submitted up to 20 minutes prior to the scheduled start time for hourly transactions. Schedules can be submitted up to four hours prior to the scheduled start time for transactions that are more than 24 hours in duration. For a schedule

to be included in PJM's day-ahead checkout process, the NERC Tag must be approved by all entities who have approval rights, and be in a status of "Implemented," by 1400 (EPT) one day prior to start of schedule. Schedules utilizing the Real-Time with Price option, also known as dispatchable schedules, must be submitted prior to 1800 (EPT) the day prior to the scheduled start time. Schedules utilizing firm point-to-point transmission service must be submitted by 1000 (EPT) one day prior to start of schedule. Transactions utilizing firm point-to-point transmission submitted after 1000 (EPT) one day prior will be accommodated if practicable.

Acquiring Ramp

PJM allows market participants to reserve ramp while they complete their scheduling responsibilities. The ramp reservation is validated against the submitted NERC Tag to ensure that the energy profile and path match. Upon submission of a ramp reservation request, if PJM verifies ramp availability, the ramp reservation will move into a status of "Pending Tag" which means that it is a valid reservation that can be associated with a NERC Tag to complete the scheduling process.

Specific timing requirements apply for the submission of ramp reservations. Ramp reservations can be made up to 30 minutes prior to the scheduled start time for hourly transactions. Ramp reservations can be made up to 4 hours prior to start time for transactions that are more than 24 hours in duration. Ramp reservations utilizing the Real-Time with Price option must be made prior to 1800 (EPT) the day prior to the scheduled start time. Ramp reservations expire if they are not used.

With the implementation of the coordinated transaction scheduling (CTS) product with the NYISO, PJM modified how ramp is handled at the PJM/NYISO Interface. Effective November 4, 2014, PJM no longer holds ramp room for any transactions submitted between PJM and the NYISO at the time of submission. Only after the NYISO completes its real-time market clearing process, and communicates the results to PJM, will PJM perform a ramp evaluation on transactions scheduled with the NYISO. If, in the event the NYISO market clearing process violates ramp, PJM makes additional adjustments on a last-in first-out basis as determined by the timestamp on the NERC Tag. This process prevents the transactions scheduled at the PJM/NYISO Interface from holding (or

¹ The material in this section is based in part on PJM's Regional Transmission and Energy Scheduling Practices Document. See PJM. "Regional Transmission and Energy Scheduling Practices," Version 24 (February 2, 2015). (Accessed January 22, 2016) <<http://www.pjm.com/~media/etools/oasis/regional-practices-clean-doc.aspx>> (465 KB).

creating) ramp until they have completed their economic evaluation and are approved through the NYISO market clearing process. The MMU has not observed any adverse effects of the new process. The MMU will continue to monitor and evaluate the process.

Acquiring Transmission

All external transaction requests require a confirmed transmission reservation from the PJM OASIS.² Due to ramp limitations, PJM may require market participants to shift their transaction requests. If the market participant shifts the request up to one hour in either direction, they are not required to purchase additional transmission. If the market participant chooses to fix a ramp violation by extending the duration of the transaction, they do not have to purchase additional transmission if the total MWh capacity of the transmission request is not exceeded, and the transaction does not extend beyond one hour prior to the start, or one hour past the end time of the transmission reservation.

Transmission Products

The OASIS products available for reservation include firm, network, non-firm and spot import service. The product type designated on the OASIS reservation determines when and how the transaction can be curtailed.

- **Firm.** Transmission service that is intended to be available at all times.
- **Network.** Transmission service that is for the sole purpose of serving network load. Network transmission service is only eligible to network customers.
- **Non-Firm.** Point-to-point transmission service under the PJM tariff that is reserved and scheduled on an as available basis and is subject to curtailment or interruption. Non-firm point-to-point transmission service is available for periods ranging from one hour to one month.
- **Spot Import.** The spot import service is an option for non-load serving entities to offer into the PJM spot market at the interface as price takers. Prior to April 2007, PJM did not limit spot import service. Effective April 2007, the availability of spot import

service was limited by the Available Transmission Capacity (ATC) on the transmission path.

Source and Sink

For a real-time import energy transaction, when a market participant selects the Point of Receipt (POR) and Point of Delivery (POD) on their OASIS reservation, the source defaults to the associated interface price as defined by the POR/POD path. For example, if the selected POR is TVA and the POD is PJM, the source would initially default to TVA's Interface Pricing point (SouthIMP). At the time the energy is scheduled, if the Generation Control Area (GCA) on the NERC Tag represents physical flow entering PJM at an interface other than the SouthIMP Interface, the source would then default to that new interface. The sink bus is selected by the market participant at the time the OASIS reservation is made and can be any bus, hub or aggregate in the PJM footprint where LMP is calculated.

For a real-time export energy transaction, when a market participant selects the Point of Receipt (POR) and Point of Delivery (POD) on their OASIS reservation, the sink defaults to the associated interface price as defined by the POR/POD path. For example, if the selected POR is PJM and the POD is TVA, the sink would initially default to TVA's Interface Pricing point (SouthEXP). At the time the energy is scheduled, if the Load Control Area (LCA) on the NERC Tag represents physical flow leaving PJM at an interface other than the SouthEXP Interface, the sink would then default to that new interface. The source bus is selected by the market participant at the time the OASIS reservation is made and can be any bus, hub or aggregate in the PJM footprint where LMP is calculated.

For a real-time wheel through energy transaction, when a market participant selects the Point of Receipt (POR) and Point of Delivery (POD) on their OASIS reservation, both the source and sink default to the associated interface prices as defined by the POR/POD path. For example, if the selected POR is TVA and the POD is NYIS, the source would initially default to TVA's Interface Pricing point (SouthIMP), and the sink would initially default to NYIS's Interface Pricing point (NYIS). At the time the energy is scheduled, if the GCA on the NERC Tag represents physical flow entering PJM at an interface other than the SouthIMP Interface, the source would then default to that new interface. Similarly, if the LCA on the NERC Tag represents physical flow leaving PJM

² For additional details see PJM, "Regional Transmission and Energy Scheduling Practices," Version 24 (February 2, 2015). (Accessed January 22, 2016) <<http://www.pjm.com/~media/etools/oasis/regional-practices-clean-doc.ashx>>

at an interface other than the NYIS Interface, the sink would then default to that new interface.

Real-Time Market Schedule Submission

Market participants enter schedules in PJM by submitting a valid NERC Tag. A NERC Tag can be submitted without a ramp reservation. When EES detects a NERC Tag that has been submitted without a ramp reservation, it will create a ramp reservation which will be evaluated against ramp, and approved or denied based on available ramp room at the time the NERC Tag is submitted.

Real-Time with Price Schedule Submission

Real-Time with Price schedules, also known as dispatchable schedules, differ from other schedules. To enter a Real-Time with Price schedule, the market participant must first make a ramp reservation in EES specifying “Real-Time with Price” and must enter a price associated with each energy block. Upon submission, the Real-Time with Price request will automatically move to the “Pending Tag” status, as Real-Time with Price schedules do not hold ramp. Once the information is entered in EES, a NERC Tag must be submitted with the ramp reservation associated on the NERC Tag. Upon implementation of the NERC Tag, PJM will curtail the tag to zero MW. During the operating day, if the dispatchable transaction is to be loaded, PJM will then reload the tag. The process of issuing curtailments and reloading the tag continues through the operating day as the economics of the system dictate.

Dynamic Transfers³

An entity that owns or controls a generating resource in the PJM Region may request that all or part of the generating resource’s output be electronically moved from the PJM Region (native BA) to another balancing authority (receiving BA). An entity that owns or controls a generating resource outside of the PJM Region may request that all or part of the generating resource’s output be electronically removed from its balancing authority to the PJM Region. This is referred to as a dynamic transfer. Dynamic transfers include dynamic schedules and pseudo-ties.

³ The material in this section is based in part on PJM’s Manual 12: Balancing Operations. See PJM, “PJM Manual 12: Balancing Operations,” Revision: 34 (April 28, 2016). (Accessed May 23, 2016) <<http://www.pjm.com/~media/documents/manuals/m12.ashx>> (1,513 KB).

Dynamic Schedule

A dynamic schedule is a time varying energy transfer that is updated in real-time and included in scheduled net interchange in the same way as an interchange schedule in the Area Control Error (ACE) equation for both balancing authorities. A dynamically scheduled resource remains within its native balancing authority’s metered boundary while providing services to the receiving balancing authority. A dynamic schedule is modeled as an interchange schedule, and therefore is subject to NERC Tagging requirements.

Pseudo-Tie

A pseudo-tie is a time-varying energy transfer that is updated in real-time and included in actual net interchange in the same way as a tie line in the ACE equation. A pseudo-tie is accounted for as actual interchange. A pseudo-tied resource is considered to be within the receiving BA’s metered boundary, and must therefore be modeled in the receiving BA’s Energy Management System (EMS). Pseudo-ties are usually not subject to NERC Tagging because they are part of congestion management procedures, like the PJM/MISO Market to Market Congestion Management Agreement.

Pseudo-ties must register with the North American Energy Standards Board (NAESB) to assist with inter-regional coordination management. Pseudo-ties are subject to NERC Tagging requirements unless the pseudo-tie is included in congestion management procedures.

Real-Time Evaluation and Checkout

PJM conducts an hourly checkout with each adjacent balancing authority using both the electronic approval of schedules and telephone calls. Once the tag has been approved by all parties with approval rights, the tag status moves to an “Implemented” status, and the schedule is ready for the adjacent balancing authority checkout.

PJM operators must verify all requested energy schedules with PJM’s neighboring balancing authorities. Only if the neighboring balancing authority agrees with the expected interchange will the transaction flow. Both balancing authorities must enter the same values in their Energy Management Systems (EMS) to avoid inadvertent energy flows between balancing authorities.

With the exception of the New York Independent System Operator (NYISO), all neighboring balancing authorities handle transaction requests in the same way as PJM. While the NYISO also requires NERC Tags, the NYISO utilizes their Market Information System (MIS) as their primary scheduling tool. The NYISO's Real-Time Commitment (RTC) tool evaluates all bids and offers each hour, performs a least cost economic dispatch solution, and accepts or denies individual transactions in whole or in part based on this evaluation. Upon market clearing, the NYISO implements NERC Tag adjustments to match the output of the RTC. PJM and the NYISO can verify interchange transactions once the NYISO Tag adjustments are sent and approved. The results of the adjustments made by the NYISO affect PJM operations, as the adjustments often cause large swings in expected ramp for the next hour.

Real-Time with Price Evaluation and Checkout

Real-time with price schedules, dispatchable schedules, are evaluated hourly to determine whether or not they will be loaded for the upcoming hour. Since Real-Time with Price schedules do not hold ramp room, there may be times when the schedule is economic but will not be loaded because ramp is not available.

Curtailement of Transactions

Once a transaction has been implemented, energy flows between balancing authorities. Transactions can be curtailed based on economic and reliability considerations. There are three types of economic curtailments: curtailments of dispatchable schedules based on price; curtailments of transactions based on their OASIS designation as not willing to pay congestion; and self curtailments by market participant. Reliability curtailments are implemented by the balancing authorities and are termed TLRs or transmission loading relief.

Dispatchable transactions will be curtailed if the system operator does not believe that the transaction will be economic for the next hour. Not willing to pay congestion transactions will be curtailed when there is, or is expected to be, realized congestion between the designated source and sink. Transactions utilizing spot import service will be curtailed if the interface price where the transaction enters PJM reaches zero. All self

curtailments must be requested on 15 minute intervals and will be approved only if there is available ramp.

Transmission Loading Relief (TLR)

TLRs are called to control flows on transmission facilities when economic redispatch cannot solve overloads on those facilities. TLRs are called to control flows related to external balancing authorities, as redispatch within an LMP market can generally resolve overloads on internal transmission facilities.

There are seven TLR levels and additional sublevels, determined by the severity of system conditions and whether the interchange transactions contributing to congestion on the impacted flowgates are using firm or non-firm transmission. Reliability coordinators are not required to implement TLRs in order. The TLR levels are described below.⁴

- **TLR Level 0 – TLR concluded:** A TLR Level 0 is initiated when the System Operating Limit (SOL) or Interconnection Reliability Operating Limit (IROL) violations are mitigated and the system is returned to a reliable state. Upon initiation of a TLR Level 0, transactions with the highest transmission priorities are reestablished first when possible. The purpose of a TLR Level 0 is to inform all affected parties that the TLR has been concluded.
- **TLR Level 1 – Potential SOL or IROL Violations:** A TLR Level 1 is initiated when the transmission system is still in a secure state but a reliability coordinator anticipates a transmission or generation contingency or other operating problem that could lead to a potential violation. No actions are required during a TLR Level 1. The purpose of a TLR Level 1 is to inform other reliability coordinators of a potential SOL or IROL.
- **TLR Level 2 – Hold transfers at present level to prevent SOL or IROL Violations:** A TLR Level 2 is initiated when the transmission system is still in a secure state but one or more transmission facilities are expected to approach, are approaching or have reached their SOL or IROL. The purpose of a TLR Level 2 is to prevent additional transactions that have an adverse impact on the identified transmission facility(ies) from starting.

⁴ Additional details regarding the TLR procedure can be found in NERC. "Standard IRO-006-4 – Reliability Coordination – Transmission Loading Relief"(October 23, 2007) (Accessed January 22, 2016) <<http://www.nerc.com/files/IR0-006-4.pdf>>.

- **TLR Level 3a – Reallocation of transmission service by curtailing interchange transactions using non-firm point-to-point transmission service to allow interchange transactions using higher priority transmission service:** A TLR Level 3a is initiated when the transmission system is secure but one or more transmission facilities are expected to approach, or are approaching their SOL or IROL, when there are transactions using non-firm point-to-point transmission service that have a greater than 5 percent effect on the facility and when there are transactions using a higher priority point-to-point transmission reservation that wish to begin. Curtailments to transactions in a TLR 3a begin on the top of the hour only. The purpose of TLR Level 3a is to curtail transactions using lower priority non-firm point-to-point transmission to allow transactions using higher priority transmission to flow.
- **TLR Level 3b – Curtail interchange transactions using non-firm transmission service arrangements to mitigate a SOL or IROL violation:** A TLR Level 3b is initiated when one or more transmission facilities is operating above their SOL or IROL; such operation is imminent and it is expected that facilities will exceed their reliability limits if corrective action is not taken; or one or more transmission facilities will exceed their SOL or IROL upon the removal from service of a generating unit or other transmission facility and transactions are flowing that are using non-firm point-to-point transmission service and have a greater than 5 percent impact on the facility. Curtailments of transactions in a TLR 3b can occur at any time within the operating hour. The purpose of a TLR Level 3b is to curtail transactions using non-firm point-to-point transmission service which impact the constraint by greater than 5 percent in order to mitigate a SOL or IROL.
- **TLR Level 4 – Reconfigure Transmission:** A TLR Level 4 is initiated when one or more transmission facilities are above their SOL or IROL limits or such operation is imminent and it is expected that facilities will exceed their reliability limits if corrective action is not taken. Upon issuance of a TLR Level 4, all transactions using non-firm point-to-point transmission service, in the current and next hour, with a greater than 5 percent impact on the facility, have been curtailed under the TLR 3b. The purpose of a TLR Level 4 is to request that the affected transmission operators reconfigure transmission on their system, or arrange for reconfiguration on other transmission systems, to mitigate the constraint if a SOL or IROL violation is imminent or occurring.
- **TLR Level 5a – Reallocation of transmission service by curtailing interchange transactions using firm point-to-point transmission service on a pro rata basis to allow additional interchange transactions using firm point-to-point transmission service:** A TLR Level 5a is initiated when one or more transmission facilities are at their SOL or IROL; all interchange transactions using non-firm point-to-point transmission service that affect the constraint by greater than 5 percent have been curtailed; no additional effective transmission configuration is available; and a transmission provider has been requested to begin an interchange transaction using previously arranged firm point-to-point transmission service. Curtailments to transactions in a TLR 5a begin on the top of the hour only. The purpose of a TLR Level 5a is to curtail existing interchange transactions, which are using firm point-to-point transmission service, on a pro rata basis to allow for the newly requested interchange transaction, also using firm point-to-point transmission service, to flow.
- **TLR Level 5b – Curtail transactions using firm point-to-point transmission service to mitigate an SOL or IROL violation:** A TLR Level 5b is initiated when one or more transmission facilities are operating above their SOL or IROL or such operation is imminent; one or more transmission facilities will exceed their SOL or IROL upon removal of a generating unit or another transmission facility; all interchange transactions using non-firm point-to-point transmission service that affect the constraint by greater than 5 percent have been curtailed; and no additional effective transmission configuration is available. Unlike a TLR 5a, curtailments to transactions in a TLR 5b can occur at any time within the operating hour. The purpose of a TLR Level 5b is to curtail transactions using firm point-to-point transmission service to mitigate a SOL or IROL.
- **TLR Level 6 – Emergency Procedures:** A TLR Level 6 is initiated when all interchange transactions using both non-firm and firm point-to-point transmission have been curtailed and one or more transmission

facilities are above their SOL or IROL, or will exceed their SOL or IROL upon removal of a generating unit or other transmission facility. The purpose of a TLR Level 6 is to instruct balancing authorities and transmission providers to redispatch generation, reconfigure transmission or reduce load to mitigate the critical condition.

Table E-1 below shows the number of TLRs, by level, issued by reliability coordinators in the Eastern Interconnection since 2004.

Table E-1 TLRs by level and reliability coordinator: 2004 through 2015

Year	Reliability Coordinator							Year	Reliability Coordinator								
		3a	3b	4	5a	5b	6			Total	3a	3b	4	5a	5b	6	Total
2004	EES	47	15	88	1	3	0	154	2010	ICTE	72	25	149	50	30	0	326
	FPL	0	1	0	0	0	0	1		MISO	123	93	0	15	18	0	249
	IMO	33	2	0	0	0	0	35		NYIS	104	0	0	0	0	0	104
	MAIN	8	3	0	0	0	0	11		ONT	94	5	0	1	0	0	100
	MISO	650	210	409	9	3	0	1,281		PJM	65	45	0	0	0	0	110
	PJM	270	115	35	4	5	0	429		SWPP	244	1,049	19	63	32	0	1,407
	SOCO	1	0	0	0	0	0	1		TVA	37	64	8	1	6	0	116
	SWPP	185	107	14	5	6	0	317		VACS	1	1	0	0	0	0	2
	TVA	56	17	0	0	1	0	74		Total	740	1,282	176	130	86	0	2,414
VACN	8	1	0	0	0	0	9										
Total		1,258	471	546	19	18	0	2,312	2011	ICTE	23	12	123	54	48	0	260
2005	EES	49	10	101	6	3	1	170		MISO	92	30	1	9	9	0	141
	IMO	57	2	0	0	0	0	59		NYIS	161	0	0	0	0	0	161
	MISO	776	296	200	5	14	0	1,291		ONT	88	0	0	0	0	0	88
	PJM	201	94	29	1	1	0	326		PJM	34	28	0	0	0	0	62
	SWPP	193	78	19	4	2	0	296		SWPP	292	298	1	25	22	0	638
	TVA	172	61	12	2	3	0	250	TVA	75	99	9	2	15	0	200	
	VACN	0	3	0	0	0	0	3	VACS	9	3	0	0	0	0	12	
VACS	2	2	0	1	0	0	5	Total	774	470	134	90	94	0	1,562		
Total		1,450	546	361	19	23	1	2,400	2012	ICTE	25	7	11	63	40	0	146
2006	EES	71	20	93	5	1	0	190		MISO	75	26	0	16	43	0	160
	ICTE	11	6	14	0	1	0	32		NYIS	60	0	0	0	0	0	60
	IMO	1	0	0	0	0	0	1		ONT	47	1	0	0	0	0	48
	MISO	414	214	136	17	19	0	800		PJM	18	19	0	0	0	0	37
	ONT	27	3		0	0	0	30		SOCO	0	1	0	0	0	0	1
	PJM	88	30	18	0	0	0	136	SWPP	248	165	5	78	33	0	529	
	SWPP	189	121	201	11	13	0	535	TVA	55	32	9	7	5	0	108	
	TVA	90	52	31	1	2	0	176	VACS	6	4	0	0	0	0	10	
VACS	0	1	0	0	0	0	1	Total	534	255	25	164	121	0	1,099		
Total		891	447	493	34	36	0	1,901	2013	ICTE	0	0	0	0	0	0	0
2007	ICTE	95	42	139	19	10	0	305		MISO	119	48	2	128	73	0	370
	MISO	414	273	89	17	26	0	819		NYIS	3	0	0	0	0	0	3
	ONT	47	4	1	0	0	0	52		ONT	7	0	0	0	0	0	7
	PJM	46	31	1	1	1	0	80		PJM	25	22	0	1	1	0	49
	SWPP	777	935	35	53	24	0	1,824		SOCO	0	0	0	0	0	0	0
	TVA	45	40	25	2	2	0	114	SWPP	342	114	0	76	24	0	556	
	VACS	4	1	0	0	0	0	5	TVA	29	26	2	5	5	0	67	
Total		1428	1326	290	92	63	0	3,199	VACS	5	7	0	0	0	0	12	
								Total	530	217	4	210	103	0	1,064		
2008	ICTE	132	41	112	43	25	0	353	2014	MISO	63	45	1	16	16	0	141
	MISO	320	235	21	8	15	0	599		NYIS	2	0	0	0	0	0	2
	ONT	153	7	1	0	0	0	161		ONT	3	0	0	0	0	0	3
	PJM	55	92	2	0	1	0	150		PJM	3	3	0	1	1	0	8
	SWPP	687	1,077	11	59	44	0	1,878		SOCO	4	1	0	0	0	0	5
	TVA	48	72	29	5	4	0	158		SWPP	260	80	0	54	34	0	428
Total		1,395	1,524	176	115	89	0	3,299	TVA	31	40	2	25	34	0	132	
								VACS	7	16	3	2	0	0	28		
2009	ICTE	82	35	55	75	18	1	266	Total	373	185	6	98	85	0	747	
	MISO	199	140	2	15	25	0	381	2015	MISO	28	32	0	16	12	0	88
	NYIS	101	8	0	0	0	0	109		NYIS	4	0	0	0	0	0	4
	ONT	169	0	0	0	0	0	169		ONT	3	1	0	0	0	0	4
	PJM	61	68	0	0	0	0	129		PJM	13	7	0	1	1	0	22
	SWPP	383	1,466	33	77	24	0	1,983		SOCO	0	0	0	0	0	0	0
	TVA	8	22	29	0	0	0	59		SWPP	102	59	0	32	19	0	212
VACS	0	1	0	0	0	0	1	TVA		36	64	0	24	36	0	160	
Total		1,003	1,740	119	167	67	1	3,097	VACS	0	2	0	0	1	0	3	
								Total	186	165	0	73	69	0	493		

Day-Ahead Energy Market

For day-ahead market scheduling, EES serves only as an interface to the eMKT application. Day-ahead market transactions are evaluated in the Day-Ahead Energy Market, and the results sent to EES. No checkout is performed on day-ahead market schedules as they are considered financially binding transactions and not physical schedules.

Submitting Day-Ahead Energy Market Schedules

Market participants can submit day-ahead market schedules to the eMKT application through EES. These schedules do not require a NERC Tag, as they are not physical schedules for actual flow. Day-ahead market schedules require an OASIS number to be associated upon submission.⁵ The path is identified on the OASIS reservation. In addition to the selection of OASIS and pricing points, the market participant must enter their energy profile. "Fixed" act as a price taker, "dispatchable" set a floor or ceiling price criteria for acceptance and "up-to" set the maximum amount of congestion the market participant is willing to pay.

NYISO Issues

If interface prices were defined in a comparable manner by PJM and the NYISO, if identical rules governed external transactions in PJM and the NYISO, if time lags were not built into the rules governing such transactions and if no risks were associated with such transactions, then prices at the interfaces would be expected to be very close and the level of transactions would be expected to be related to any price differentials. The fact that none of these conditions exists is important in explaining the observed relationship between interface prices and inter-ISO power flows, and those price differentials.⁶

There are institutional differences between PJM and the NYISO markets that are relevant to observed differences in border prices.⁷ The NYISO requires hourly bids or offer prices for each export or import transaction and clears

its market for each hour based on hourly bids.⁸ Import transactions to the NYISO are treated by the NYISO as generator bids at the NYISO/PJM proxy bus. Export transactions are treated by the NYISO as price-capped load offers. Competing bids and offers are evaluated along with other NYISO resources and a proxy bus price is derived. Bidders are notified of the outcome. This process is repeated, with new bids and offers each hour. A significant lag exists between the time when offers and bids are submitted to the NYISO and the time when participants are notified that they have cleared. The lag is a result of the Real-Time Commitment (RTC) system and the fact that transactions can only be scheduled at the beginning of the hour.

As a result of the NYISO's RTC timing, market participants must submit bids or offers by no later than 75 minutes before the operating hour. The bid or offer includes the MW volume desired and, for imports into NYISO, the asking price or, for exports out of the NYISO, the price the participants are willing to pay. The required lead time means that participants make price and MW bids or offers based on expected prices. Transactions are accepted only for a single hour.

Under PJM operating practices, in the Real-Time Energy Market, participants must make a request to import or export power at one of PJM's interfaces at least 20 minutes before the desired start which can be any quarter hour.⁹ The duration of the requested transaction can vary from 15 minutes to an unlimited amount of time. Generally, PJM market participants provide only the MW, the duration and the direction of the real-time transaction. While bid prices for transactions are allowed in PJM, less than one percent of all transactions submit an associated price. Transactions are accepted, with virtually no lag, in order of submission, based on whether PJM has the capability to import or export the requested MW. If transactions do not submit a price, the transactions are priced at the real-time price for their scheduled imports or exports. As in the NYISO, the required lead time means that participants must make offers to buy or sell MW based on expected prices, but

⁵ On September 17, 2010, up-to congestion transactions no longer required a willing to pay congestion transmission reservation. Additionally, effective May 15, 2012, up to congestion transactions were required to be submitted for the PJM day-ahead market evaluation in the eMarket application, and are no longer accepted through the EES application. Additional details can be found under the "Up to Congestion" heading in Section 9: Interchange Transactions of this report.

⁶ See also the discussion of these issues in the 2005 State of the Market Report, Section 4, "Interchange Transactions," (March 8, 2006).

⁷ See the 2005 State of the Market Report (March 8, 2006), pp. 195-198.

⁸ See NYISO. "NYISO Transmission Services Manual," Version 2.0 (February 1, 2005) [Accessed January 22, 2016] <http://www.nyiso.com/public/webdocs/documents/manuals/operations/tran_ser_mnl.pdf>.

⁹ See PJM. "Regional Transmission and Energy Scheduling Practices," Version 24 (February 2, 2015). [Accessed January 22, 2016] <<http://www.pjm.com/~media/etools/oasis/regional-practices-clean-doc.ashx>>.

the required lead time is substantially shorter in the PJM market.

The NYISO rules provide that the RTC results should be available 45 minutes before the operating hour. Winning bidders then have 25 minutes from the time when the RTC results indicate that their transaction will flow to meet PJM's 20-minute notice requirement. To get a transaction cleared with PJM, the market participant must have a valid NERC Tag, an OASIS reservation and a PJM ramp reservation. Each of these requirements takes time to process.

The length of required lead times in both markets may be a contributor to the observed relationship between price differentials and flows. Market conditions can change significantly in a relatively short time. The resulting uncertainty could weaken the observed relationship between contemporaneous interface prices and flows.

Consolidated Edison Company (Con Edison) Wheeling Contracts

To help meet the demand for power in New York City, Con Edison uses electricity generated in upstate New York and wheeled through New York and New Jersey. A common path is through Westchester County using lines controlled by the NYISO. Another path is through northern New Jersey using lines controlled by PJM. This wheeled power creates loop flow across the PJM system. The Con Edison/PSE&G contracts governing the New Jersey path evolved during the 1970s and were the subject of a Con Edison complaint to the FERC in 2001. In May 2005, the FERC issued an order setting out a protocol developed by the two companies, PJM and the NYISO.¹⁰ In July 2005, the protocol was implemented. Con Edison filed a protest with the FERC regarding the delivery performance in January 2006. In August 2007, the FERC denied a rehearing request on Con Edison's complaints regarding protocol performance and refunds. PJM continued to operate under the terms of the protocol through 2012.

These contracts provided for the delivery of up to 1,000 MW of power from Con Edison's Ramapo Substation in Rockland County, New York, to PSE&G at its Waldwick Switching Substation in Bergen County, New Jersey.

PSE&G wheels the power across its system and delivers it to Con Edison across lines connecting directly into New York City (Figure E-1). Two separate contracts covered these wheeling arrangements. A 1975 agreement covers delivery of up to 400 MW through Ramapo (New York) to PSE&G's Waldwick Switching Station (New Jersey) then to the New Milford Switching Station (New Jersey) via the J Line and ultimately from the Linden Switching Station (New Jersey) to the Goethals Substation (New York) and from the Hudson Generating Station (New Jersey) to the Farragut Switching Station (New York), via the A and B feeders, respectively. A 1978 agreement covered delivery of up to an additional 600 MW through Ramapo to Waldwick then to Fair Lawn, via the K Line, and ultimately through a second Hudson-to-Farragut Line, the C feeder.

Figure E-1 Con Edison wheel



After years of litigation concerning whether or on what terms Con Edison's protocol would be renewed, on February 23, 2009, PJM filed a settlement on behalf of the parties to resolve remaining issues with these contracts and the proposed rollover of the agreements

¹⁰ 111 FERC ¶ 61,228 (2005).

under the PJM OATT.¹¹ By order issued September 16, 2010, the Commission approved this settlement,¹² which extends Con Edison's special protocol indefinitely. The Commission approved transmission service agreements provide for Con Edison to take firm point-to-point service going forward under the PJM OATT. The Commission rejected objections raised first by NRG and FERC trial staff, and later by the MMU, that this arrangement is discriminatory and inconsistent with the Commission's open access transmission policy.¹³ The settlement defined Con Edison's cost responsibility for upgrades included in the PJM Regional Transmission Expansion Plan. Con Edison is responsible for their share of required transmission enhancements, and must pay the associated charges during the term of its service, and any subsequent roll over of the service.¹⁴ Con Edison's rolled over service became effective on May 1, 2012. At that time, Con Edison became responsible for the entire 1,000 MW of transmission service and all associated charges and credits.

Corrected Interface Imports and Exports

The following tables show corrected real-time and day-ahead market interface totals that reflect the integration of MidAmerican Energy Company (MEC) with MISO on September 1, 2009. Prior reports incorrectly included MEC as a separate interface and excluded the MEC interchange in the MISO totals.

Table E-2 Real-time scheduled net interchange volume by interface (GWh): 2009

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	(62.7)	(161.8)	(208.1)	(281.1)	(113.8)	(293.2)	(317.7)	(242.9)	(241.7)	35.9	3.1	53.2	(1,830.8)
CPLW	(71.4)	(67.4)	(74.3)	(72.0)	(60.3)	(69.8)	(74.6)	(76.7)	(57.6)	0.0	(3.5)	(56.1)	(683.7)
DUK	622.7	67.8	89.9	10.6	60.9	(86.0)	(135.9)	(67.5)	(180.9)	(70.2)	(39.2)	126.6	398.8
EKPC	(173.5)	(78.8)	(88.6)	(57.4)	67.3	(9.7)	(45.0)	(57.3)	(113.1)	(40.8)	(35.6)	(41.8)	(674.3)
LGEE	137.4	90.7	176.3	101.4	169.8	32.6	(3.9)	54.6	43.5	69.4	80.9	62.6	1,015.3
MEC	150.4	302.1	146.1	155.1	(148.4)	(239.8)	(117.9)	(26.8)					220.8
MISO	388.0	(153.5)	(96.0)	(804.4)	81.0	(277.4)	405.6	(78.5)	(437.1)	(481.1)	(68.1)	(97.7)	(1,619.2)
ALTE	44.4	(41.8)	(86.5)	(147.3)	(117.6)	(143.6)	(136.3)	(94.9)	(39.1)	(27.7)	(9.0)	39.4	(760.0)
ALTW	(65.6)	(69.6)	(74.3)	(97.5)	(66.4)	(175.3)	(230.4)	(151.1)	(92.2)	(70.8)	(29.5)	(4.2)	(1,126.9)
AMIL	126.2	23.7	8.7	(14.9)	28.0	(24.0)	(6.8)	(13.6)	24.6	39.8	17.7	(43.6)	165.8
CIN	102.6	(96.1)	(179.7)	(216.6)	14.7	(91.8)	154.0	133.9	206.5	70.9	109.9	187.2	395.5
CWLP	0.0	0.0	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.7
FE	(215.6)	(221.5)	(166.6)	(204.3)	(178.6)	(93.1)	(16.8)	(80.2)	(168.8)	(45.9)	(63.6)	(78.1)	(1,533.1)
IPL	47.1	(17.5)	(88.6)	(79.8)	101.5	(23.9)	173.4	(5.7)	(14.2)	(18.0)	25.3	67.8	167.4
MEC									(446.6)	(483.0)	(451.8)	(446.7)	(1,828.1)
MECS	421.7	361.8	552.3	60.9	341.6	398.7	512.8	258.3	157.3	113.9	276.8	163.6	3,619.7
NIPS	(8.2)	(51.5)	(35.5)	(60.0)	(3.9)	(38.1)	(13.9)	(71.5)	(28.0)	(11.4)	(0.6)	(19.3)	(341.9)
WEC	(64.6)	(41.0)	(26.5)	(44.9)	(38.3)	(86.3)	(30.4)	(53.7)	(36.6)	(48.9)	56.7	36.2	(378.3)
NYISO	(690.9)	(634.2)	(698.4)	(581.7)	(700.0)	(922.9)	(983.5)	(1,068.2)	(844.6)	(970.7)	(1,143.3)	(1,682.4)	(10,920.8)
LIND									(8.9)	(44.5)	(151.8)	(148.8)	(354.0)
NEPT	(294.8)	(402.5)	(445.1)	(400.9)	(434.5)	(456.9)	(493.9)	(484.6)	(382.6)	(265.4)	(426.0)	(473.5)	(4,960.7)
NYIS	(396.1)	(231.7)	(253.3)	(180.8)	(265.5)	(466.0)	(489.6)	(583.6)	(453.1)	(660.8)	(565.5)	(1,060.1)	(5,606.1)
OVEC	1,171.3	994.2	1,018.4	1,012.5	970.4	995.2	1,116.3	1,125.0	865.0	1,015.1	1,041.3	1,198.6	12,523.3
TVA	244.0	128.7	167.6	35.2	69.3	(160.0)	(73.1)	(23.1)	(42.7)	(21.0)	(30.1)	(131.2)	163.6
Total	1,715.3	487.8	432.9	(481.8)	396.2	(1,031.0)	(229.7)	(461.4)	(1,009.2)	(463.4)	(194.5)	(568.2)	(1,407.0)

11 See FERC Docket Nos. ER08-858-000, et al. The settling parties are the New York Independent System Operator, Inc. (NYISO), Con Ed, PSE&G, PSE&G Energy Resources & Trading LLC and the New Jersey Board of Public Utilities.

12 132 FERC ¶ 61,221 (2010).

13 See, e.g., Motion to Intervene Out-of-Time and Comments of the Independent Market Monitor for PJM in Docket No. ER08-858-000, et al. (May 11, 2010).

14 The terms of the settlement state that Con Edison shall have no liability for transmission enhancement charges prior to the commencement of, or after the termination of, the term of the rolled over service.

Table E-3 Real-time scheduled gross import volume by interface (GWh): 2009

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	223.9	69.4	66.8	39.9	115.1	16.8	9.3	17.0	5.2	139.8	115.7	325.2	1,144.1
CPLW	2.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.1
DUK	737.8	277.9	209.5	154.1	239.2	151.2	101.4	98.5	72.6	155.4	90.9	308.5	2,597.0
EKPC	2.7	6.1	12.9	2.5	90.3	33.2	11.6	4.2	0.9	11.8	9.4	11.8	197.4
LGEE	187.4	125.2	183.6	125.8	172.0	55.7	48.0	72.1	44.3	70.4	84.5	89.5	1,258.5
MEC	337.6	428.2	371.7	361.2	77.8	26.5	113.5	182.9					1,899.4
MISO	1,529.0	983.6	1,245.6	627.0	1,015.4	1,105.8	1,482.9	1,058.8	914.4	880.4	1,077.2	1,162.1	13,082.2
ALTE	170.4	65.4	18.2	1.7	0.1	0.1	1.7	0.0	2.1	0.0	0.0	44.4	304.1
ALTW	45.7	22.2	1.7	0.0	1.9	3.5	5.1	0.3	4.8	0.0	24.9	14.3	124.4
AMIL	147.3	44.9	38.3	26.8	62.2	48.6	65.8	54.0	46.5	76.9	51.3	66.3	728.9
CIN	382.9	265.0	335.2	209.3	256.2	335.3	332.8	402.7	443.7	315.4	279.0	388.5	3,946.0
CWLP	0.0	0.0	0.7	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.7
FE	60.5	32.6	101.6	60.8	73.0	160.0	251.7	180.8	130.3	207.3	185.4	177.1	1,621.1
IPL	107.5	43.8	51.9	63.5	148.6	65.7	199.1	52.0	33.0	34.4	53.7	79.2	932.4
MEC									4.8	15.5	26.4	51.7	98.4
MECS	573.5	500.4	679.7	264.3	458.0	486.8	601.6	368.9	246.7	220.0	355.6	248.8	5,004.3
NIPS	32.5	8.1	0.5	0.0	11.0	0.0	18.2	0.0	0.0	1.3	1.4	0.0	73.0
WEC	8.7	1.2	17.8	0.6	4.4	5.8	6.9	0.1	2.5	9.6	99.5	91.8	248.9
NYISO	1,004.4	589.8	829.7	982.3	795.2	791.0	862.5	915.8	738.0	810.7	763.7	819.8	9,902.9
LIND									0.0	0.5	0.2	0.0	0.7
NEPT	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NYIS	1,004.4	589.8	829.7	982.3	795.2	791.0	862.5	915.8	738.0	810.2	763.5	819.8	9,902.2
OVEC	1,171.3	994.2	1,018.4	1,012.5	970.4	995.2	1,116.3	1,125.0	865.0	1,015.1	1,041.3	1,198.6	12,523.3
TVA	292.8	185.1	214.2	107.1	146.2	31.4	65.9	88.9	86.0	66.6	72.5	83.0	1,439.7
Total	5,489.0	3,659.5	4,152.4	3,412.4	3,621.6	3,206.8	3,811.4	3,563.2	2,726.4	3,150.2	3,255.2	3,998.5	44,046.6

Table E-4 Real-time scheduled gross export volume by interface (GWh): 2009

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	286.6	231.2	274.9	321.0	228.9	310.0	327.0	259.9	246.9	103.9	112.6	272.0	2,974.9
CPLW	73.5	67.4	74.3	72.0	60.3	69.8	74.6	76.7	57.6	0.0	3.5	56.1	685.8
DUK	115.1	210.1	119.6	143.5	178.3	237.2	237.3	166.0	253.5	225.6	130.1	181.9	2,198.2
EKPC	176.2	84.9	101.5	59.9	23.0	42.9	56.6	61.5	114.0	52.6	45.0	53.6	871.7
LGEE	50.0	34.5	7.3	24.4	2.2	23.1	51.9	17.5	0.8	1.0	3.6	26.9	243.2
MEC	187.2	126.1	225.6	206.1	226.2	266.3	231.4	209.7					1,678.6
MISO	1,141.0	1,137.1	1,341.6	1,431.4	934.4	1,383.2	1,077.3	1,137.3	1,351.5	1,361.5	1,145.3	1,259.8	14,701.4
ALTE	126.0	107.2	104.7	149.0	117.7	143.7	138.0	94.9	41.2	27.7	9.0	5.0	1,064.1
ALTW	111.3	91.8	76.0	97.5	68.3	178.8	235.5	151.4	97.0	70.8	54.4	18.5	1,251.3
AMIL	21.1	21.2	29.6	41.7	34.2	72.6	72.6	67.6	21.9	37.1	33.6	109.9	563.1
CIN	280.3	361.1	514.9	425.9	241.5	427.1	178.8	268.8	237.2	244.5	169.1	201.3	3,550.5
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
FE	276.1	254.1	268.2	265.1	251.6	253.1	268.5	261.0	299.1	253.2	249.0	255.2	3,154.2
IPL	60.4	61.3	140.5	143.3	47.1	89.6	25.7	57.7	47.2	52.4	28.4	11.4	765.0
MEC									451.4	498.5	478.2	498.4	1,926.5
MECS	151.8	138.6	127.4	203.4	116.4	88.1	88.8	110.6	89.4	106.1	78.8	85.2	1,384.6
NIPS	40.7	59.6	36.0	60.0	14.9	38.1	32.1	71.5	28.0	12.7	2.0	19.3	414.9
WEC	73.3	42.2	44.3	45.5	42.7	92.1	37.3	53.8	39.1	58.5	42.8	55.6	627.2
NYISO	1,695.3	1,224.0	1,528.1	1,564.0	1,495.2	1,713.9	1,846.0	1,984.0	1,582.6	1,781.4	1,907.0	2,502.2	20,823.7
LIND									8.9	45.0	152.0	148.8	354.7
NEPT	294.8	402.5	445.1	400.9	434.5	456.9	493.9	484.6	382.6	265.4	426.0	473.5	4,960.7
NYIS	1,400.5	821.5	1,083.0	1,163.1	1,060.7	1,257.0	1,352.1	1,499.4	1,191.1	1,471.0	1,329.0	1,879.9	15,508.3
OVEC	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
TVA	48.8	56.4	46.6	71.9	76.9	191.4	139.0	112.0	128.7	87.6	102.6	214.2	1,276.1
Total	3,773.7	3,171.7	3,719.5	3,894.2	3,225.4	4,237.8	4,041.1	4,024.6	3,735.6	3,613.6	3,449.7	4,566.7	45,453.6

Table E-5 Day-ahead scheduled net interchange volume by interface (GWh): 2009

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPLE	49.1	(23.0)	(86.0)	(81.0)	(88.1)	(157.1)	(158.8)	(109.9)	(91.0)	(43.0)	(103.0)	(109.6)	(1,001.4)
CPLW	(176.6)	(166.0)	(184.5)	(180.0)	(155.9)	(176.2)	(184.7)	(184.0)	(147.8)	7.7	(5.0)	(165.5)	(1,718.5)
DUK	255.9	26.4	1.1	22.3	120.9	58.7	88.5	45.5	(30.9)	85.8	(6.0)	70.3	738.6
EKPC	(31.1)	(22.8)	(1.1)	0.0	0.0	0.0	0.0	(1.4)	(0.3)	(1.2)	(0.1)	(1.4)	(59.4)
LGEE	(16.5)	(8.9)	23.5	6.9	9.7	39.9	38.0	2.7	46.4	(0.4)	(0.5)	4.2	145.0
MEC	27.3	(90.0)	(173.4)	(185.3)	(209.3)	(252.9)	(216.0)	(207.8)					(1,307.4)
MISO	(1,745.7)	(1,357.3)	(995.7)	(1,356.4)	(870.3)	(275.1)	57.2	(252.5)	(1,398.4)	(2,640.2)	(456.3)	(367.6)	(11,658.3)
ALTE	(142.2)	(61.4)	(518.5)	(673.0)	(779.1)	(521.6)	(340.1)	(409.7)	(542.5)	(573.2)	(321.9)	(26.8)	(4,910.0)
ALTW	(722.6)	(756.0)	(604.5)	(746.7)	(389.5)	(497.7)	(392.8)	(552.0)	(417.7)	(1,261.5)	(320.2)	(246.4)	(6,907.6)
AMIL	52.8	72.3	42.2	86.6	102.4	261.6	153.3	32.6	6.3	33.8	7.7	47.9	899.5
CIN	(225.4)	(96.3)	(47.8)	57.5	(36.7)	55.7	(8.5)	85.2	80.3	23.1	20.5	(97.6)	(190.0)
CWLP	(0.7)	(0.1)	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	(0.8)
FE	(206.7)	(233.8)	(241.4)	(197.3)	(206.0)	(116.4)	(119.4)	(76.8)	(115.4)	(152.1)	53.3	(21.5)	(1,633.5)
IPL	(316.7)	(191.0)	(157.2)	(67.1)	85.2	143.0	254.3	165.3	(34.8)	(35.4)	(1.3)	(46.3)	(202.0)
MEC									(448.7)	(497.0)	(482.6)	(491.7)	(1,920.0)
MECS	101.9	172.9	250.4	261.1	370.6	433.8	548.7	356.0	257.0	9.2	111.6	77.8	2,951.0
NIPS	(233.7)	(320.9)	(71.3)	(194.6)	(286.2)	(62.2)	(81.7)	(287.8)	(591.0)	(828.0)	(341.6)	(77.6)	(3,376.6)
WEC	(52.5)	57.0	352.4	117.2	269.0	28.7	43.4	434.7	409.8	642.4	818.2	521.4	3,641.7
NYISO	(167.7)	(257.3)	(315.6)	(394.7)	(438.4)	(480.5)	(489.0)	(533.8)	(564.7)	(534.1)	(710.3)	(920.5)	(5,806.6)
LIND									(2.7)	(44.0)	(82.8)	(55.1)	(184.6)
NEPT	(326.4)	(403.8)	(446.4)	(402.1)	(436.6)	(472.3)	(496.9)	(491.7)	(408.7)	(262.6)	(440.2)	(476.6)	(5,064.3)
NYIS	158.7	146.5	130.8	7.5	(1.8)	(8.2)	7.9	(42.1)	(153.3)	(227.5)	(187.3)	(388.8)	(557.7)
OVEC	835.6	743.5	786.0	738.6	824.2	857.3	1,028.8	1,038.7	795.4	914.6	1,004.2	938.3	10,505.2
TVA	482.5	384.6	151.7	81.8	5.4	(42.8)	18.0	79.6	(22.7)	5.4	10.6	(33.9)	1,120.2
Total	(487.2)	(770.8)	(794.0)	(1,347.6)	(801.8)	(428.7)	182.0	(122.9)	(1,412.3)	(2,203.9)	(266.4)	(578.9)	(9,032.5)

Table E-6 Day-ahead scheduled gross import volume by interface (GWh): 2009

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPLE	187.6	75.8	14.4	21.0	24.0	7.8	7.4	19.8	12.4	40.7	12.4	44.4	467.7
CPLW	9.5	2.1	0.6	0.0	2.8	0.0	2.2	2.0	0.0	9.7	1.4	1.5	31.8
DUK	291.9	102.7	55.9	71.4	138.8	90.0	123.6	66.8	83.6	116.1	28.9	103.9	1,273.6
EKPC	0.8	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3	0.0	0.0	1.1
LGEE	2.9	0.2	24.9	8.1	11.4	41.0	40.1	5.2	46.4	0.1	0.1	4.2	184.6
MEC	173.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0					173.2
MISO	2,090.9	2,059.3	2,312.2	1,779.9	1,700.4	1,947.7	2,704.6	2,558.3	2,005.4	2,239.6	2,257.1	1,739.4	25,394.8
ALTE	675.2	674.4	470.1	173.7	52.2	106.5	367.9	191.1	171.6	314.2	285.0	396.0	3,877.9
ALTW	190.8	183.6	33.2	2.3	0.0	12.5	29.9	40.4	15.8	47.7	59.5	20.4	636.1
AMIL	59.4	75.0	44.5	91.5	105.0	261.6	155.7	76.1	17.7	33.8	8.4	48.3	977.0
CIN	103.2	159.2	178.5	247.6	190.5	320.2	273.2	328.9	391.8	316.2	193.2	134.5	2,837.0
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
FE	15.2	44.9	60.0	23.0	10.3	100.7	206.1	227.7	242.0	140.3	341.6	177.1	1,588.9
IPL	246.5	159.9	153.2	254.2	258.7	250.0	389.3	374.6	77.6	126.5	32.6	1.2	2,324.3
MEC									1.7	1.5	0.0	6.8	10.0
MECS	504.9	400.1	488.5	606.8	631.9	626.5	769.8	595.9	390.9	336.1	359.3	285.6	5,996.3
NIPS	284.5	248.4	490.5	208.0	135.6	151.4	338.2	231.6	152.0	72.6	74.6	29.2	2,416.6
WEC	11.2	113.8	393.7	172.7	316.2	118.3	174.5	492.0	546.0	852.2	902.9	647.1	4,740.6
NYISO	890.3	584.5	776.0	776.4	612.0	675.0	840.6	958.6	710.3	748.1	733.2	731.1	9,036.1
LIND									0.0	0.1	0.0	0.0	0.1
NEPT	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NYIS	890.3	584.5	776.0	776.4	612.0	675.0	840.6	958.6	710.3	748.0	733.2	731.1	9,036.0
OVEC	866.7	766.6	810.5	763.1	828.4	858.2	1,032.0	1,043.8	840.5	954.7	1,036.2	981.4	10,782.1
TVA	496.4	407.2	172.8	104.0	20.2	12.0	40.4	96.3	46.0	46.9	50.7	30.7	1,523.6
Total	5,010.2	3,998.4	4,167.3	3,524.0	3,338.0	3,631.7	4,790.9	4,750.8	3,746.3	4,157.7	4,120.0	3,643.4	48,878.7

Table E-7 Day-ahead scheduled gross export volume by interface (GWh): 2009

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	138.5	98.8	100.4	102.0	112.1	164.9	166.2	129.7	103.4	83.7	115.4	154.0	1,469.1
CPLW	186.1	168.1	185.1	180.0	158.7	176.2	186.9	186.0	147.8	2.0	6.4	167.0	1,750.3
DUK	36.0	76.3	54.8	49.1	17.9	31.3	35.1	21.3	114.5	30.3	34.9	33.6	535.0
EKPC	31.9	22.8	1.1	0.0	0.0	0.0	0.0	1.4	0.3	1.5	0.1	1.4	60.5
LGEE	19.4	9.1	1.4	1.2	1.7	1.1	2.1	2.5	0.0	0.5	0.6	0.0	39.6
MEC	145.9	90.0	173.4	185.3	209.3	252.9	216.0	207.8					1,480.6
MISO	3,836.6	3,416.6	3,307.9	3,136.3	2,570.7	2,222.8	2,647.4	2,810.8	3,403.8	4,879.8	2,713.4	2,107.0	37,053.1
ALTE	817.4	735.8	988.6	846.7	831.3	628.1	708.0	600.8	714.1	887.4	606.9	422.8	8,787.9
ALTW	913.4	939.6	637.7	749.0	389.5	510.2	422.7	592.4	433.5	1,309.2	379.7	266.8	7,543.7
AMIL	6.6	2.7	2.3	4.9	2.6	0.0	2.4	43.5	11.4	0.0	0.7	0.4	77.5
CIN	328.6	255.5	226.3	190.1	227.2	264.5	281.7	243.7	311.5	293.1	172.7	232.1	3,027.0
CWLP	0.7	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.8
FE	221.9	278.7	301.4	220.3	216.3	217.1	325.5	304.5	357.4	292.4	288.3	198.6	3,222.5
IPL	563.2	350.9	310.4	321.3	173.5	107.0	135.0	209.3	112.4	161.9	33.9	47.5	2,526.3
MEC									450.4	498.5	482.6	498.5	1,930.0
MECS	403.0	227.2	238.1	345.8	261.3	192.7	221.1	239.9	133.9	326.9	247.7	207.8	3,045.3
NIPS	518.2	569.3	561.8	402.6	421.8	213.6	419.9	519.4	743.0	900.6	416.2	106.8	5,793.2
WEC	63.7	56.8	41.3	55.5	47.2	89.6	131.1	57.3	136.2	209.8	84.7	125.7	1,098.9
NYISO	1,058.0	841.8	1,091.6	1,171.1	1,050.4	1,155.5	1,329.6	1,492.4	1,275.0	1,282.2	1,443.5	1,651.6	14,842.7
LIND									2.7	44.1	82.8	55.1	184.7
NEPT	326.4	403.8	446.4	402.1	436.6	472.3	496.9	491.7	408.7	262.6	440.2	476.6	5,064.3
NYIS	731.6	438.0	645.2	768.9	613.8	683.2	832.7	1,000.7	863.6	975.5	920.5	1,119.9	9,593.7
OVEC	31.1	23.1	24.5	24.5	4.2	0.9	3.2	5.1	45.1	40.1	32.0	43.1	276.9
TVA	13.9	22.6	21.1	22.2	14.8	54.8	22.4	16.7	68.7	41.5	40.1	64.6	403.4
Total	5,497.4	4,769.2	4,961.3	4,871.6	4,139.8	4,060.4	4,608.9	4,873.7	5,158.6	6,361.6	4,386.4	4,222.3	57,911.2

Table E-8 Real-time scheduled net interchange volume by interface (GWh): 2010

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	(70.4)	(72.8)	(40.8)	(141.2)	(114.0)	(154.2)	(150.1)	(162.4)	(154.8)	(172.5)	(126.6)	(227.8)	(1,587.6)
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	219.7	92.2	(32.8)	(22.9)	123.6	(116.4)	(50.8)	(21.0)	(113.3)	(33.9)	(146.1)	52.0	(49.7)
EKPC	(65.5)	(99.2)	14.1	39.3	(0.2)	(19.5)	81.2	88.4	(43.5)	(32.1)	(63.2)	(79.9)	(180.1)
LGEE	31.9	144.5	29.7	44.1	116.8	130.0	160.3	103.4	185.4	290.7	262.4	252.3	1,751.5
MISO	(572.4)	62.3	16.9	(427.2)	(309.0)	(791.8)	(1,140.5)	(999.4)	(1,409.6)	(1,246.3)	(802.7)	(558.4)	(8,178.1)
ALTE	3.6	(9.5)	13.7	(7.1)	(0.7)	(66.2)	(90.3)	(46.3)	(116.0)	(64.5)	(62.1)	(146.2)	(591.6)
ALTW	(32.1)	(8.4)	1.4	(16.1)	(27.7)	(148.3)	(80.2)	(54.7)	(106.3)	(70.3)	(58.1)	(44.9)	(645.7)
AMIL	(141.6)	(85.5)	(63.5)	(25.6)	37.1	18.8	22.1	77.6	(7.4)	(12.8)	(11.8)	(30.7)	(223.3)
CIN	78.4	323.4	233.5	(112.2)	189.0	155.8	(37.8)	(52.3)	(333.5)	(307.7)	(70.4)	(54.4)	11.8
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	(13.8)	(8.5)	0.0	0.0	(22.3)
FE	(117.4)	(60.2)	(70.6)	(114.3)	(142.5)	(173.5)	(182.1)	(211.3)	(86.1)	(86.9)	(96.5)	110.3	(1,231.1)
IPL	(28.4)	48.4	(4.6)	112.6	61.3	(61.2)	(177.9)	(121.3)	(170.1)	4.3	(8.3)	6.2	(339.0)
MEC	(454.2)	(422.0)	(458.1)	(383.0)	(436.0)	(429.4)	(440.7)	(402.4)	(420.2)	(453.9)	(435.6)	(428.7)	(5,164.2)
MECS	195.1	312.7	387.5	199.7	95.9	103.2	34.9	0.5	20.1	(101.2)	61.2	238.3	1,547.9
NIPS	(24.0)	(10.8)	(4.9)	(0.6)	(1.9)	(111.1)	(98.2)	(49.9)	(56.7)	(43.4)	(33.8)	(63.2)	(498.5)
WEC	(7.7)	2.3	18.2	(28.3)	(22.0)	(45.2)	(48.6)	(92.8)	(75.9)	(76.9)	(54.6)	(90.3)	(521.8)
NYISO	(1,307.0)	(1,039.9)	(1,109.6)	(950.3)	(1,334.9)	(1,257.1)	(1,003.0)	(1,029.6)	(1,219.8)	(1,145.5)	(1,143.5)	(963.0)	(13,503.2)
LIND	(146.0)	(125.5)	(115.7)	(75.8)	(89.8)	(100.4)	(99.2)	(63.6)	(113.0)	(114.0)	(95.1)	(106.5)	(1,244.6)
NEPT	(496.7)	(423.6)	(449.9)	(280.9)	(464.8)	(466.6)	(411.5)	(292.7)	(375.7)	(391.0)	(419.5)	(379.9)	(4,852.8)
NYIS	(664.3)	(490.8)	(544.0)	(593.6)	(780.3)	(690.1)	(492.3)	(673.3)	(731.1)	(640.5)	(628.9)	(476.6)	(7,405.8)
OVEC	1,176.9	943.0	1,018.8	854.0	805.9	1,001.9	781.7	1,004.6	931.1	947.2	1,149.0	1,198.8	11,812.9
TVA	(39.0)	(121.5)	(129.3)	(88.3)	(7.8)	(43.4)	69.0	(97.4)	2.7	32.5	50.6	144.9	(227.0)
Total	(581.7)	(63.3)	(197.3)	(640.2)	(658.1)	(1,215.8)	(1,210.5)	(1,066.9)	(1,778.1)	(1,335.4)	(787.4)	(126.3)	(9,661.0)

Table E-9 Real-time scheduled gross import volume by interface (GWh): 2010

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	128.3	113.4	99.8	0.6	22.7	9.9	28.2	26.5	6.4	9.9	12.8	23.4	481.9
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	408.5	235.2	135.1	142.6	258.6	174.8	229.5	243.7	104.5	113.3	166.6	248.9	2,461.3
EKPC	15.8	3.0	53.9	58.1	34.8	36.6	88.9	104.2	22.6	10.2	9.7	7.8	445.6
LGEE	48.9	150.5	73.5	58.7	135.6	161.8	187.6	171.8	218.2	297.3	267.4	274.9	2,046.2
MISO	1,142.9	1,388.4	1,292.1	852.6	907.3	1,055.0	866.6	748.7	656.4	503.7	729.3	1,303.8	11,446.8
ALTE	30.0	8.0	28.9	2.4	9.4	1.0	1.3	6.7	3.3	9.4	4.2	0.0	104.6
ALTW	0.0	5.4	7.6	1.1	2.8	6.3	7.6	17.6	14.5	12.4	20.8	5.3	101.4
AMIL	23.5	49.2	39.2	45.6	55.0	37.1	33.3	88.8	17.3	11.6	9.6	20.2	430.4
CIN	500.9	555.4	454.8	227.2	364.7	551.6	366.0	314.9	216.4	149.9	343.6	507.9	4,553.3
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
FE	181.6	207.6	205.4	156.0	147.5	162.3	176.9	150.8	218.3	186.5	178.8	333.1	2,304.8
IPL	47.1	116.7	16.2	115.9	113.5	71.8	16.0	1.5	4.3	8.2	4.6	26.4	542.2
MEC	44.1	28.1	35.7	52.3	61.5	34.7	41.7	46.5	43.7	24.5	32.7	54.8	500.3
MECS	304.3	385.9	475.1	283.7	181.5	185.2	215.2	150.5	170.9	122.3	156.9	408.9	3,040.4
NIPS	0.0	0.0	0.0	0.2	13.4	6.4	2.9	14.7	10.8	0.4	0.0	2.0	50.8
WEC	55.5	60.2	64.9	20.5	19.5	33.3	47.4	3.2	0.6	3.0	10.8	0.0	318.9
NYISO	934.4	901.2	922.5	765.7	890.8	916.1	1,184.7	1,084.6	916.6	896.8	884.9	1,010.0	11,308.3
LIND	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NEPT	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NYIS	934.4	901.2	922.5	765.7	890.8	916.1	1,184.7	1,084.6	916.6	896.8	884.9	1,010.0	11,308.3
OVEC	1,176.9	943.0	1,018.8	854.0	805.9	1,001.9	781.7	1,004.6	931.1	947.2	1,149.0	1,226.7	11,840.8
TVA	134.6	35.7	47.7	63.0	115.6	67.9	237.4	116.4	131.8	85.1	142.9	237.4	1,415.5
Total	4,034.4	3,798.5	3,679.1	2,847.6	3,232.8	3,458.7	3,646.3	3,547.0	3,031.3	2,888.0	3,395.3	4,387.7	41,946.7

Table E-10 Real-time scheduled gross export volume by interface (GWh): 2010

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	198.7	186.2	140.6	141.8	136.7	164.1	178.3	188.9	161.2	182.4	139.4	251.2	2,069.5
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	188.8	143.0	167.9	165.5	135.0	291.2	280.3	264.7	217.8	147.2	312.7	196.9	2,511.0
EKPC	81.3	102.2	39.8	18.8	35.0	56.1	7.7	15.8	66.1	42.3	72.9	87.7	625.7
LGEE	17.0	6.0	43.8	14.6	18.8	31.8	27.3	68.4	32.8	6.6	5.0	22.6	294.7
MISO	1,715.3	1,326.1	1,275.2	1,279.8	1,216.3	1,846.8	2,007.1	1,748.1	2,066.0	1,750.0	1,532.0	1,862.2	19,624.9
ALTE	26.4	17.5	15.2	9.5	10.1	67.2	91.6	53.0	119.3	73.9	66.3	146.2	696.2
ALTW	32.1	13.8	6.2	17.2	30.5	154.6	87.8	72.3	120.8	82.7	78.9	50.2	747.1
AMIL	165.1	134.7	102.7	71.2	17.9	18.3	11.2	11.2	24.7	24.4	21.4	50.9	653.7
CIN	422.5	232.0	221.3	339.4	175.7	395.8	403.8	367.2	549.9	457.6	414.0	562.3	4,541.5
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	13.8	8.5	0.0	0.0	22.3
FE	299.0	267.8	276.0	270.3	290.0	335.8	359.0	362.1	304.4	273.4	275.3	222.8	3,535.9
IPL	75.5	68.3	20.8	3.3	52.2	133.0	193.9	122.8	174.4	3.9	12.9	20.2	881.2
MEC	498.3	450.1	493.8	435.3	497.5	464.1	482.4	448.9	463.9	478.4	468.3	483.5	5,664.5
MECS	109.2	73.2	87.6	84.0	85.6	82.0	180.3	150.0	150.8	223.5	95.7	170.6	1,492.5
NIPS	24.0	10.8	4.9	0.8	15.3	117.5	101.1	64.6	67.5	43.8	33.8	65.2	549.3
WEC	63.2	57.9	46.7	48.8	41.5	78.5	96.0	96.0	76.5	79.9	65.4	90.3	840.7
NYISO	2,241.4	1,941.1	2,032.1	1,716.0	2,225.7	2,173.2	2,187.7	2,114.2	2,136.4	2,042.3	2,028.4	1,973.0	24,811.5
LIND	146.0	125.5	115.7	75.8	89.8	100.4	99.2	63.6	113.0	114.0	95.1	106.5	1,244.6
NEPT	496.7	423.6	449.9	280.9	464.8	466.6	411.5	292.7	375.7	391.0	419.5	379.9	4,852.8
NYIS	1,598.7	1,392.0	1,466.5	1,359.3	1,671.1	1,606.2	1,677.0	1,757.9	1,647.7	1,537.3	1,513.8	1,486.6	18,714.1
OVEC	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	27.9	27.9
TVA	173.6	157.2	177.0	151.3	123.4	111.3	168.4	213.8	129.1	52.6	92.3	92.5	1,642.5
Total	4,616.1	3,861.8	3,876.4	3,487.8	3,890.9	4,674.5	4,856.8	4,613.9	4,809.4	4,223.4	4,182.7	4,514.0	51,607.7

Table E-11 Day-ahead scheduled net interchange volume by interface (GWh): 2010

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	(89.3)	(111.3)	(114.7)	(122.2)	(108.3)	(134.2)	372.0	(119.5)	(70.8)	(129.3)	(206.7)	(141.3)	(975.6)
CPLW	10.2	(1.0)	1.0	(0.9)	(1.0)	(1.5)	6.7	2.0	5.6	7.9	4.6	19.7	53.3
DUK	161.4	38.4	8.6	12.6	72.5	23.2	(222.7)	(100.4)	29.2	17.2	64.5	65.6	170.1
EKPC	(1.5)	(5.9)	(3.4)	(0.2)	(1.4)	(3.0)	(4.5)	(3.5)	(0.1)	0.0	0.1	0.1	(23.3)
LGEE	1.0	5.3	0.0	(0.1)	1.4	(8.0)	(13.7)	(51.5)	(3.7)	0.9	0.0	0.0	(68.4)
MISO	(197.1)	(604.6)	(794.9)	(1,883.5)	(1,482.6)	(238.6)	3,103.8	363.5	(369.1)	(1,605.3)	515.0	1,654.6	(1,538.8)
ALTE	227.6	(257.5)	(136.2)	(302.4)	(711.0)	(168.0)	73.0	145.9	(9.0)	(403.9)	315.8	1,466.5	240.8
ALTW	(282.2)	(414.3)	(1,220.9)	(1,761.3)	(766.8)	(2,195.9)	(1,908.2)	(567.7)	68.1	437.3	663.7	273.4	(7,674.8)
AMIL	14.4	97.5	6.7	12.4	44.5	114.6	1.7	9.0	(1.3)	(6.4)	19.7	80.1	392.9
CIN	182.9	(60.8)	43.1	(70.3)	41.8	310.0	1,376.9	161.3	4.2	(215.5)	(11.0)	(88.6)	1,674.0
CWLP	0.0	0.0	0.0	0.0	(0.3)	0.0	(19.5)	0.0	(11.8)	(8.5)	0.0	0.0	(40.1)
FE	(70.5)	(20.7)	118.8	(72.4)	(79.3)	390.4	1,007.5	20.4	(218.3)	(519.1)	(112.7)	(107.6)	336.5
IPL	(53.4)	(18.4)	(44.7)	(8.5)	(42.0)	68.9	131.8	41.7	(41.0)	(54.2)	(44.8)	(131.3)	(195.9)
MEC	(479.4)	(444.1)	(482.8)	(433.0)	(464.1)	(789.0)	(374.3)	(457.0)	(448.1)	(477.0)	(468.6)	(428.7)	(5,746.1)
MECS	387.8	654.4	885.6	732.9	546.6	1,223.9	1,484.6	767.5	379.5	(263.9)	247.4	681.6	7,727.9
NIPS	(204.5)	(217.0)	(143.3)	(87.6)	(120.2)	(103.9)	394.9	(34.3)	(67.1)	(49.7)	(43.8)	(65.1)	(741.6)
WEC	80.2	76.3	178.8	106.7	68.2	910.4	935.4	276.7	(24.3)	(44.4)	(50.7)	(25.7)	2,487.6
NYISO	(969.0)	(912.0)	(825.4)	(752.7)	(1,017.9)	(1,657.9)	(4,727.8)	(904.8)	(894.0)	(945.2)	(948.1)	(973.6)	(15,528.4)
LIND	(21.1)	(18.3)	(53.2)	(11.4)	(15.3)	(12.0)	(24.7)	(9.9)	(53.2)	(50.8)	(47.9)	(66.3)	(384.1)
NEPT	(502.6)	(445.2)	(456.7)	(301.3)	(473.4)	(472.7)	(420.9)	(317.7)	(374.8)	(392.2)	(423.9)	(407.1)	(4,988.5)
NYIS	(445.3)	(448.5)	(315.5)	(440.0)	(529.2)	(1,173.2)	(4,282.2)	(577.2)	(466.0)	(502.2)	(476.3)	(500.2)	(10,155.8)
OVEC	1,074.0	1,243.3	1,300.5	917.1	679.0	1,058.2	1,045.7	978.5	711.5	740.6	853.3	970.1	11,571.8
TVA	(5.3)	37.8	(27.0)	(60.9)	(5.4)	7.7	(335.1)	16.4	18.0	87.4	127.9	7.8	(130.7)
Total	(15.6)	(310.0)	(455.3)	(1,890.8)	(1,863.7)	(954.1)	(775.6)	180.7	(573.4)	(1,825.8)	410.6	1,603.0	(6,470.0)

Table E-12 Day-ahead scheduled gross import volume by interface (GWh): 2010

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	64.2	39.5	29.3	10.7	15.8	49.1	595.7	124.6	89.2	37.7	57.5	138.4	1,251.7
CPLW	15.6	0.6	1.8	0.0	1.4	0.8	6.7	2.0	7.1	8.5	4.7	19.7	68.9
DUK	176.3	96.2	48.1	40.2	107.2	77.8	139.9	112.9	108.6	66.2	105.1	135.0	1,213.5
EKPC	0.0	0.0	0.4	0.0	0.0	0.0	0.2	0.0	0.0	0.0	0.1	0.1	0.8
LGEE	1.0	5.4	0.0	0.0	1.8	0.5	1.4	6.5	2.2	12.1	2.4	0.0	33.3
MISO	2,419.3	2,743.9	3,124.7	2,697.4	2,321.8	7,613.9	12,736.6	4,629.8	3,926.3	3,783.8	5,158.0	7,406.7	58,562.2
ALTE	866.4	762.4	662.8	382.9	263.8	721.2	2,191.6	1,241.3	1,728.4	1,650.5	2,471.8	4,524.1	17,467.2
ALTW	72.0	67.2	72.4	53.6	40.2	345.7	896.3	257.6	542.7	863.2	1,014.1	464.7	4,689.7
AMIL	68.1	157.9	50.5	32.1	44.8	114.6	1.7	10.5	4.5	4.1	29.5	88.7	607.0
CIN	436.8	592.0	555.1	590.4	430.6	969.6	1,988.3	701.1	238.3	118.6	139.5	127.9	6,888.2
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
FE	156.2	176.9	364.9	203.7	179.3	752.7	1,536.1	519.1	204.8	125.7	327.1	299.4	4,845.9
IPL	26.9	29.4	30.7	102.8	97.0	1,045.3	1,004.8	124.0	16.8	4.0	30.3	9.9	2,521.9
MEC	18.8	5.6	12.2	18.6	70.2	158.8	247.8	33.6	20.7	1.4	0.0	56.5	644.2
MECS	606.2	801.7	1,125.2	1,118.7	1,035.2	2,223.8	2,629.9	1,246.7	1,060.7	787.7	848.1	1,446.8	14,930.7
NIPS	28.6	19.5	24.3	33.1	26.9	292.1	1,115.1	84.5	19.3	45.0	93.0	154.7	1,936.1
WEC	139.3	131.3	226.6	161.5	133.8	990.1	1,125.0	411.4	90.1	183.6	204.6	234.0	4,031.3
NYISO	835.3	885.1	1,095.7	883.7	858.1	1,165.0	1,202.9	1,219.8	1,047.4	1,048.7	1,069.3	1,115.3	12,426.3
LIND	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NEPT	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NYIS	835.3	885.1	1,095.7	883.7	858.1	1,165.0	1,202.9	1,219.8	1,047.4	1,048.7	1,069.3	1,115.3	12,426.3
OVEC	1,133.2	1,259.7	1,379.9	922.0	802.1	1,063.8	1,086.8	985.3	793.4	925.9	1,199.3	1,299.9	12,851.3
TVA	75.9	77.8	36.7	15.2	44.4	55.3	357.2	120.3	79.1	239.1	316.3	273.9	1,691.2
Total	4,720.8	5,108.2	5,716.6	4,569.2	4,152.6	10,026.2	16,127.4	7,201.2	6,053.3	6,122.0	7,912.7	10,389.0	88,099.2

Table E-13 Day-ahead scheduled gross export volume by interface (GWh): 2010

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	153.5	150.8	144.0	132.9	124.1	183.3	223.7	244.1	160.0	167.0	264.2	279.7	2,227.3
CPLW	5.4	1.6	0.8	0.9	2.4	2.3	0.0	0.0	1.5	0.6	0.1	0.0	15.6
DUK	14.9	57.8	39.5	27.6	34.7	54.6	362.6	213.3	79.4	49.0	40.6	69.4	1,043.4
EKPC	1.5	5.9	3.8	0.2	1.4	3.0	4.7	3.5	0.1	0.0	0.0	0.0	24.1
LGEE	0.0	0.1	0.0	0.1	0.4	8.5	15.1	58.0	5.9	11.2	2.4	0.0	101.7
MISO	2,616.4	3,348.5	3,919.6	4,580.9	3,804.4	7,852.5	9,632.8	4,266.3	4,295.4	5,389.1	4,643.0	5,752.1	60,101.0
ALTE	638.8	1,019.9	799.0	685.3	974.8	889.2	2,118.6	1,095.4	1,737.4	2,054.4	2,156.0	3,057.6	17,226.4
ALTW	354.2	481.5	1,293.3	1,814.9	807.0	2,541.6	2,804.5	825.3	474.6	425.9	350.4	191.3	12,364.5
AMIL	53.7	60.4	43.8	19.7	0.3	0.0	0.0	1.5	5.8	10.5	9.8	8.6	214.1
CIN	253.9	652.8	512.0	660.7	388.8	659.6	611.4	539.8	234.1	334.1	150.5	216.5	5,214.2
CWLP	0.0	0.0	0.0	0.0	0.3	0.0	19.5	0.0	11.8	8.5	0.0	0.0	40.1
FE	226.7	197.6	246.1	276.1	258.6	362.3	528.6	498.7	423.1	644.8	439.8	407.0	4,509.4
IPL	80.3	47.8	75.4	111.3	139.0	976.4	873.0	82.3	57.8	58.2	75.1	141.2	2,717.8
MEC	498.2	449.7	495.0	451.6	534.3	947.8	622.1	490.6	468.8	478.4	468.6	485.2	6,390.3
MECS	218.4	147.3	239.6	385.8	488.6	999.9	1,145.3	479.2	681.2	1,051.6	600.7	765.2	7,202.8
NIPS	233.1	236.5	167.6	120.7	147.1	396.0	720.2	118.8	86.4	94.7	136.8	219.8	2,677.7
WEC	59.1	55.0	47.8	54.8	65.6	79.7	189.6	134.7	114.4	228.0	255.3	259.7	1,543.7
NYISO	1,804.3	1,797.1	1,921.1	1,636.4	1,876.0	2,822.9	5,930.7	2,124.6	1,941.4	1,993.9	2,017.4	2,088.9	27,954.7
LIND	21.1	18.3	53.2	11.4	15.3	12.0	24.7	9.9	53.2	50.8	47.9	66.3	384.1
NEPT	502.6	445.2	456.7	301.3	473.4	472.7	420.9	317.7	374.8	392.2	423.9	407.1	4,988.5
NYIS	1,280.6	1,333.6	1,411.2	1,323.7	1,387.3	2,338.2	5,485.1	1,797.0	1,513.4	1,550.9	1,545.6	1,615.5	22,582.1
OVEC	59.2	16.4	79.4	4.9	123.1	5.6	41.1	6.8	81.9	185.3	346.0	329.8	1,279.5
TVA	81.2	40.0	63.7	76.1	49.8	47.6	692.3	103.9	61.1	151.7	188.4	266.1	1,821.9
Total	4,736.4	5,418.2	6,171.9	6,460.0	6,016.3	10,980.3	16,903.0	7,020.5	6,626.7	7,947.8	7,502.1	8,786.0	94,569.2

Table E-14 Real-time scheduled net interchange volume by interface (GWh): 2011

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	(122.7)	(29.5)	(43.3)	(29.1)	(76.8)	(78.7)	(81.0)	(81.5)	(51.5)	(8.2)	(13.7)	(33.6)	(649.7)
CPLW	0.0	0.0	0.0	0.0	0.0	2.4	0.0	0.0	0.0	0.0	0.0	0.0	2.4
DUK	(25.6)	218.8	(17.1)	12.8	34.7	(36.8)	33.9	(289.3)	(132.1)	(53.4)	(74.4)	57.7	(271.0)
EKPC	(61.4)	(10.1)	5.6	135.0	41.4	106.4	107.0	100.7	80.4	(70.6)	28.2	11.0	473.6
LGEE	392.9	385.8	314.6	200.0	241.7	322.1	303.1	246.6	327.7	416.9	368.5	361.6	3,881.4
MISO	(503.5)	(792.1)	(1,206.6)	(1,594.4)	(974.3)	(1,132.2)	(1,251.5)	(1,318.5)	(1,804.0)	(929.2)	(1,433.0)	(1,876.1)	(14,815.5)
ALTE	(116.1)	(128.3)	(76.0)	(4.5)	(7.6)	(105.7)	(210.6)	(193.5)	(378.8)	(467.0)	(722.0)	(1,015.2)	(3,425.3)
ALTW	(30.9)	(14.5)	(28.6)	(49.9)	(68.8)	(83.2)	(119.3)	(83.2)	(249.3)	(28.4)	(53.6)	(64.9)	(874.5)
AMIL	(2.9)	45.5	14.3	8.6	37.8	(17.5)	(34.8)	(101.8)	(120.2)	6.2	(10.5)	49.2	(126.2)
CIN	(85.6)	(314.7)	(454.6)	(713.8)	(242.7)	(423.9)	(338.1)	(113.3)	(376.2)	0.7	(298.9)	(410.5)	(3,771.6)
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
FE	149.9	(43.9)	(159.1)	(250.2)	(250.9)	0.2							(554.2)
IPL	21.8	3.5	8.8	(3.4)	11.0	(12.8)	(60.6)	(111.3)	(30.9)	48.8	(12.1)	(18.0)	(155.2)
MEC	(426.0)	(403.2)	(462.3)	(463.2)	(478.5)	(456.3)	(675.5)	(565.8)	(616.7)	(517.7)	(471.6)	(479.0)	(6,015.6)
MECS	193.0	190.8	112.6	33.2	160.1	128.8	413.2	218.8	223.3	421.4	433.9	400.2	2,929.4
NIPS	(114.3)	(51.0)	(69.7)	(72.6)	(53.7)	(71.9)	(80.0)	(62.6)	(42.8)	(29.9)	(69.4)	(67.3)	(785.1)
WEC	(92.3)	(76.4)	(92.1)	(78.6)	(81.0)	(89.9)	(145.9)	(305.7)	(212.5)	(363.3)	(228.9)	(270.6)	(2,037.2)
NYISO	(1,349.2)	(1,268.3)	(1,021.4)	(855.2)	(721.4)	(665.7)	(929.2)	(1,336.3)	(1,141.1)	(1,030.7)	(858.9)	(964.1)	(12,141.5)
LIND	(156.0)	(145.3)	(115.1)	(128.9)	(90.5)	(77.8)	(25.1)	(90.8)	(121.9)	(40.9)	(29.3)	(39.7)	(1,061.4)
NEPT	(404.2)	(370.6)	(375.6)	(284.6)	(379.5)	(235.7)	(365.0)	(450.8)	(307.0)	(381.7)	(325.4)	(436.6)	(4,316.8)
NYIS	(789.1)	(752.3)	(530.7)	(441.6)	(251.4)	(352.2)	(539.0)	(794.8)	(712.2)	(608.1)	(504.2)	(487.7)	(6,763.4)
OVEC	1,242.2	1,110.7	1,065.8	1,018.9	1,030.7	1,014.6	1,040.8	1,011.9	828.9	666.5	759.6	903.9	11,694.6
TVA	681.6	222.8	170.3	20.0	(98.5)	(36.7)	264.2	41.8	36.4	151.9	360.8	249.3	2,063.8
Total	254.3	(162.0)	(732.1)	(1,092.1)	(522.5)	(504.7)	(512.8)	(1,624.6)	(1,855.3)	(856.9)	(862.8)	(1,290.3)	(9,761.8)

Table E-15 Real-time scheduled gross import volume by interface (GWh): 2011

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	0.2	1.5	0.8	2.8	7.5	13.4	5.2	2.4	1.1	6.2	0.6	1.6	43.2
CPLW	0.0	0.0	0.0	0.0	0.0	2.4	0.0	0.0	0.0	0.0	0.0	0.0	2.4
DUK	271.7	309.8	186.2	208.2	197.7	184.4	299.8	121.8	103.3	190.6	258.6	276.4	2,608.7
EKPC	31.7	46.5	41.0	143.3	85.5	112.3	116.7	110.3	85.9	36.2	32.3	21.6	863.2
LGEE	393.0	386.3	324.1	233.6	250.3	334.9	322.7	268.5	328.3	420.1	373.5	364.6	3,999.8
MISO	1,194.5	864.7	755.7	409.5	718.2	542.9	998.2	714.4	605.1	882.1	945.1	1,113.9	9,744.3
ALTE	0.0	0.0	0.0	0.0	0.0	0.2	1.6	0.0	0.0	0.0	0.0	0.0	1.8
ALTW	0.0	0.0	0.0	0.0	0.0	0.9	0.0	0.6	0.0	0.0	0.0	0.0	1.5
AMIL	23.9	68.0	42.2	26.0	55.4	37.8	85.2	75.0	7.3	34.8	28.4	105.5	589.5
CIN	400.0	270.3	315.2	180.8	348.0	260.0	359.4	344.9	261.8	292.7	361.9	467.5	3,862.6
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
FE	436.8	220.5	122.3	55.5	71.2	0.3							906.6
IPL	25.4	4.8	15.3	5.6	19.3	66.9	89.3	37.1	39.6	71.5	70.7	94.0	539.5
MEC	53.2	30.8	19.1	0.0	0.0	0.0	0.0	0.0	6.0	5.3	0.5	0.0	115.0
MECS	250.9	270.3	241.4	141.4	224.3	176.7	460.7	256.8	289.3	477.8	479.6	442.7	3,711.8
NIPS	0.0	0.0	0.2	0.2	0.0	0.0	2.0	0.0	0.0	0.0	2.2	4.2	8.9
WEC	4.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.0	0.0	1.8	0.0	7.3
NYISO	681.0	534.7	646.6	686.3	911.1	975.9	1,144.4	961.2	731.3	652.8	637.5	713.9	9,276.6
LIND	0.0	0.0	0.0	0.0	0.0	14.3	51.7	27.9	10.6	19.1	17.6	24.4	165.6
NEPT	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NYIS	681.0	534.7	646.6	686.3	911.1	961.6	1,092.6	933.3	720.7	633.7	619.9	689.5	9,111.0
OVEC	1,242.2	1,110.7	1,091.3	1,019.0	1,030.7	1,014.6	1,063.6	1,013.7	834.7	666.6	782.2	929.2	11,798.5
TVA	725.7	255.5	212.0	128.8	79.7	92.0	360.3	152.7	69.8	159.0	387.0	294.9	2,917.4
Total	4,540.1	3,509.7	3,257.7	2,831.4	3,280.8	3,272.7	4,310.7	3,344.9	2,759.5	3,013.6	3,416.9	3,716.0	41,254.1

Table E-16 Real-time scheduled gross export volume by interface (GWh): 2011

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	123.0	31.0	44.1	31.9	84.3	92.2	86.1	83.9	52.5	14.4	14.3	35.2	692.9
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	297.3	91.1	203.3	195.5	163.0	221.2	265.9	411.1	235.5	244.1	333.0	218.7	2,879.6
EKPC	93.1	56.6	35.4	8.3	44.1	5.9	9.6	9.6	5.5	106.8	4.1	10.5	389.6
LGEE	0.1	0.4	9.5	33.6	8.6	12.8	19.6	21.9	0.6	3.2	5.0	3.0	118.4
MISO	1,698.0	1,656.9	1,962.3	2,003.9	1,692.5	1,675.1	2,249.7	2,032.9	2,409.1	1,811.3	2,378.1	2,990.1	24,559.8
ALTE	116.1	128.3	76.0	4.5	7.6	105.9	212.2	193.5	378.8	467.0	722.0	1,015.2	3,427.1
ALTW	30.9	14.5	28.6	49.9	68.8	84.1	119.3	83.8	249.3	28.4	53.6	64.9	876.0
AMIL	26.8	22.5	27.9	17.4	17.6	55.4	120.0	176.8	127.5	28.6	38.9	56.3	715.6
CIN	485.5	585.0	769.8	894.7	590.7	683.9	697.5	458.2	638.0	292.0	660.8	878.1	7,634.1
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
FE	286.9	264.4	281.4	305.7	322.2	0.1							1,460.8
IPL	3.6	1.3	6.5	8.9	8.3	79.7	149.9	148.4	70.5	22.7	82.8	112.0	694.7
MEC	479.2	434.1	481.3	463.2	478.5	456.3	675.5	565.8	622.7	523.0	472.1	479.0	6,130.6
MECS	57.9	79.5	128.8	108.2	64.2	47.8	47.4	38.1	66.0	56.4	45.7	42.5	782.4
NIPS	114.3	51.0	69.9	72.8	53.7	71.9	82.0	62.6	42.8	29.9	71.5	71.5	794.0
WEC	96.8	76.4	92.1	78.6	81.0	89.9	145.9	305.7	213.5	363.3	230.7	270.6	2,044.5
NYISO	2,030.2	1,803.0	1,667.9	1,541.5	1,632.5	1,641.6	2,073.6	2,297.5	1,872.5	1,683.5	1,496.3	1,678.0	21,418.1
LIND	156.0	145.3	115.1	128.9	90.5	92.1	76.8	118.7	132.5	59.9	46.9	64.1	1,226.9
NEPT	404.2	370.6	375.6	284.6	379.5	235.7	365.0	450.8	307.0	381.7	325.4	436.6	4,316.8
NYIS	1,470.0	1,287.1	1,177.2	1,128.0	1,162.5	1,313.8	1,631.7	1,728.1	1,433.0	1,241.8	1,124.0	1,177.2	15,874.4
OVEC	0.0	0.0	25.5	0.0	0.0	0.0	22.8	1.8	5.8	0.0	22.6	25.3	103.9
TVA	44.1	32.7	41.7	108.9	178.2	128.7	96.0	110.9	33.5	7.2	26.2	45.6	853.6
Total	4,285.8	3,671.8	3,989.8	3,923.5	3,803.3	3,777.4	4,823.4	4,969.6	4,614.9	3,870.5	4,279.7	5,006.3	51,015.9

Table E-17 Day-ahead scheduled net interchange volume by interface (GWh): 2011

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	(11.3)	89.8	126.8	234.4	159.9	(83.0)	(322.5)	(673.9)	(617.9)	(213.6)	13.6	6.3	(1,291.4)
CPLW	17.1	6.4	1.8	11.0	5.9	15.4	45.6	42.1	18.3	43.4	51.1	27.2	285.4
DUK	91.8	115.8	41.0	789.1	234.0	(240.7)	(617.8)	(495.5)	39.2	20.4	32.1	(25.5)	(16.2)
EKPC	(27.5)	(18.4)	27.8	6.8	(5.3)	1.0	(9.6)	(2.9)	(0.3)	(3.0)	(0.5)	(0.9)	(32.9)
LGEE	19.0	1.8	2.0	16.6	35.5	1.9	22.5	19.7	(2.1)	(2.0)	(21.7)	(12.3)	80.9
MISO	1,685.9	483.3	(645.5)	242.0	(19.7)	1,043.6	1,175.2	590.7	197.3	(215.7)	(712.0)	(402.9)	3,422.4
ALTE	1,996.5	908.2	99.1	833.9	1,037.2	1,333.0	911.8	729.9	583.2	(283.7)	(819.3)	(1,113.2)	6,216.7
ALTW	164.8	(49.7)	(48.1)	(40.1)	(7.3)	139.3	(0.4)	(42.6)	(205.5)	(74.1)	(198.4)	(183.1)	(545.2)
AMIL	34.6	70.2	67.5	31.0	33.6	(4.6)	74.1	(129.5)	(687.4)	(323.0)	41.1	32.0	(760.2)
CIN	(125.8)	(90.5)	(175.1)	(94.3)	(18.0)	(131.4)	(0.4)	100.0	178.4	217.7	114.7	315.4	290.8
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	(1.7)	(0.0)	(1.4)	(0.1)	0.0	(3.1)
FE	(189.2)	(339.8)	(317.2)	(479.3)	(1,299.6)	(1.5)							(2,626.5)
IPL	(175.6)	(162.6)	(163.9)	(75.1)	(123.5)	(97.9)	(152.7)	(106.0)	(125.5)	(161.9)	(194.6)	(183.9)	(1,723.1)
MEC	(458.7)	(421.3)	(463.2)	(455.3)	(472.2)	(437.3)	(542.1)	(493.2)	(512.4)	(525.7)	(512.6)	(502.3)	(5,796.3)
MECS	742.4	580.2	567.2	591.2	992.6	336.2	931.9	816.5	1,150.4	898.1	732.5	769.7	9,108.9
NIPS	(280.6)	(111.0)	(130.3)	(65.8)	(108.9)	(90.9)	(50.9)	(1.7)	(6.8)	12.5	10.0	(39.8)	(864.1)
WEC	(22.6)	99.6	(81.4)	(4.3)	(53.7)	(1.4)	3.8	(281.1)	(177.1)	25.6	114.7	502.3	124.6
NYISO	(892.0)	(681.9)	(496.7)	(220.9)	611.3	(242.7)	(987.4)	(1,169.2)	(902.6)	(769.2)	(673.8)	(919.7)	(7,344.8)
LIND	(105.0)	(104.7)	(77.9)	(110.8)	(75.0)	(171.2)	(659.8)	(740.4)	(822.6)	(279.9)	(54.5)	(48.9)	(3,250.9)
NEPT	(427.9)	(379.7)	(385.0)	(298.1)	(405.2)	(250.0)	(396.6)	(508.6)	(339.6)	(395.2)	(362.6)	(450.5)	(4,598.9)
NYIS	(359.1)	(197.5)	(33.8)	187.9	1,091.5	178.5	69.0	79.8	259.6	(94.0)	(256.6)	(420.3)	505.0
OVEC	1,046.0	1,051.1	1,279.5	1,502.8	1,636.3	1,167.6	1,025.6	643.8	1,163.3	564.8	(390.9)	1,859.2	12,549.0
TVA	282.8	111.2	106.7	85.8	56.5	55.6	(422.1)	(489.9)	(118.6)	(116.8)	(237.5)	(390.1)	(1,076.4)
Total	2,211.7	1,159.2	443.4	2,667.6	2,714.6	1,718.7	(90.4)	(1,535.1)	(223.5)	(691.7)	(1,939.5)	141.3	6,576.2

Table E-18 Day-ahead scheduled gross import volume by interface (GWh): 2011

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	137.6	146.3	197.4	305.0	242.6	29.5	40.6	45.3	48.2	33.0	28.5	34.6	1,288.6
CPLW	19.5	6.5	8.1	13.9	24.6	27.2	64.9	69.3	47.9	71.8	87.9	48.2	489.8
DUK	150.8	155.5	88.5	935.0	269.0	50.9	99.2	50.2	55.3	44.9	46.4	48.5	1,994.2
EKPC	5.4	0.0	28.3	6.8	6.3	2.8	0.2	0.3	0.3	1.1	0.5	0.3	52.5
LGEE	21.6	2.1	13.5	17.1	40.8	41.6	71.0	21.6	14.1	15.9	2.7	12.0	274.0
MISO	7,415.7	5,802.5	5,336.9	4,399.2	5,702.8	5,859.2	7,151.3	7,250.9	7,074.5	5,577.4	6,308.0	7,925.1	75,803.5
ALTE	4,872.3	3,576.6	3,109.0	2,156.0	2,959.3	3,808.9	3,588.3	3,520.1	3,761.2	2,596.8	2,470.0	2,916.7	39,335.2
ALTW	375.6	52.1	29.0	19.3	74.1	284.8	183.7	129.2	51.9	72.0	41.8	53.3	1,366.7
AMIL	44.8	71.1	70.7	34.2	35.8	45.2	77.2	34.2	50.9	23.1	43.7	32.3	563.3
CIN	266.2	440.5	360.6	511.2	263.4	728.0	760.3	692.0	662.2	583.9	926.4	970.3	7,165.0
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
FE	232.9	140.5	141.0	55.5	17.0	0.0							586.8
IPL	17.0	2.9	0.0	6.5	2.8	1.7	0.8	1.0	4.8	0.0	1.5	1.5	40.4
MEC	21.7	19.8	20.1	8.2	15.9	67.5	102.8	107.1	106.2	74.7	60.8	131.9	736.7
MECS	1,409.4	1,207.9	1,438.1	1,402.0	2,167.9	772.1	2,254.1	2,644.6	2,260.5	1,890.5	2,214.2	2,785.6	22,446.9
NIPS	32.0	48.2	27.0	33.9	11.6	29.2	33.2	35.2	26.0	43.0	58.5	17.0	394.8
WEC	143.7	242.8	141.4	172.4	155.0	121.9	151.0	87.5	150.8	293.5	491.2	1,016.5	3,167.7
NYISO	910.1	988.6	1,149.1	1,399.2	2,467.1	1,560.2	1,666.6	1,763.1	1,997.7	1,520.7	1,305.1	1,266.5	17,994.0
LIND	0.0	0.0	0.0	0.0	0.0	8.7	29.1	22.2	0.8	1.6	2.7	3.2	68.3
NEPT	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NYIS	910.1	988.6	1,149.1	1,399.2	2,467.1	1,551.5	1,637.5	1,740.9	1,997.0	1,519.1	1,302.4	1,263.3	17,925.7
OVEC	1,272.8	1,355.2	1,898.8	1,976.7	2,223.0	1,886.6	2,006.4	2,750.1	2,146.5	2,091.7	2,412.5	3,918.9	25,939.4
TVA	412.1	318.7	318.9	341.8	286.8	529.3	748.6	639.7	421.3	470.5	409.8	285.0	5,182.5
Total	10,345.6	8,775.5	9,039.6	9,394.6	11,263.0	9,987.4	11,848.8	12,590.5	11,805.9	9,827.0	10,601.5	13,539.2	129,018.5

Table E-19 Day-ahead scheduled gross export volume by interface (GWh): 2011

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	148.9	56.5	70.7	70.5	82.7	112.5	363.1	719.2	666.1	246.5	14.9	28.4	2,579.9
CPLW	2.4	0.1	6.2	2.9	18.6	11.8	19.2	27.2	29.6	28.4	36.8	21.1	204.4
DUK	59.1	39.7	47.5	145.9	35.0	291.6	717.0	545.7	16.2	24.5	14.3	74.0	2,010.4
EKPC	32.9	18.4	0.5	0.0	11.6	1.9	9.9	3.2	0.6	4.1	1.1	1.2	85.4
LGEE	2.6	0.3	11.5	0.5	5.2	39.8	48.5	1.9	16.2	17.9	24.5	24.3	193.1
MISO	5,729.8	5,319.2	5,982.4	4,157.2	5,722.5	4,815.6	5,976.0	6,660.1	6,877.2	5,793.2	7,020.0	8,328.0	72,381.1
ALTE	2,875.8	2,668.4	3,009.9	1,322.1	1,922.0	2,475.9	2,676.5	2,790.1	3,178.1	2,880.5	3,289.3	4,029.9	33,118.5
ALTW	210.8	101.8	77.1	59.4	81.4	145.5	184.1	171.8	257.4	146.0	240.3	236.4	1,911.9
AMIL	10.2	0.9	3.2	3.2	2.2	49.8	3.1	163.7	738.3	346.1	2.6	0.3	1,323.5
CIN	392.0	531.0	535.7	605.5	281.5	859.4	760.6	592.0	483.8	366.2	811.7	654.8	6,874.2
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.7	0.0	1.4	0.1	0.0	3.1
FE	422.1	480.2	458.2	534.8	1,316.6	1.5							3,213.4
IPL	192.6	165.5	163.9	81.6	126.3	99.6	153.5	106.9	130.2	161.9	196.0	185.5	1,763.6
MEC	480.4	441.2	483.3	463.4	488.1	504.8	644.8	600.3	618.6	600.4	573.5	634.2	6,533.0
MECS	667.0	627.7	870.9	810.8	1,175.4	435.9	1,322.1	1,828.1	1,110.1	992.4	1,481.7	2,015.9	13,338.0
NIPS	312.6	159.2	157.3	99.8	120.4	120.0	84.1	36.9	32.8	30.5	48.5	56.8	1,258.9
WEC	166.3	143.3	222.8	176.6	208.7	123.2	147.1	368.6	327.9	267.8	376.5	514.2	3,043.1
NYISO	1,802.1	1,670.5	1,645.8	1,620.1	1,855.7	1,802.9	2,654.0	2,932.4	2,900.3	2,289.9	1,978.9	2,186.2	25,338.7
LIND	105.0	104.7	77.9	110.8	75.0	179.9	688.9	762.7	823.4	281.5	57.3	52.1	3,319.1
NEPT	427.9	379.7	385.0	298.1	405.2	250.0	396.6	508.6	339.6	395.2	362.6	450.5	4,598.9
NYIS	1,269.2	1,186.1	1,182.9	1,211.2	1,375.6	1,373.0	1,568.5	1,661.1	1,737.4	1,613.1	1,559.0	1,683.6	17,420.7
OVEC	226.8	304.1	619.3	474.0	586.7	719.0	980.8	2,106.3	983.2	1,527.0	2,803.4	2,059.7	13,390.4
TVA	129.3	207.5	212.2	255.9	230.3	473.7	1,170.7	1,129.5	539.9	587.3	647.3	675.1	6,258.9
Total	8,133.9	7,616.3	8,596.2	6,727.0	8,548.4	8,268.7	11,939.2	14,125.6	12,029.3	10,518.7	12,541.1	13,397.9	122,442.3

Table E-20 Real-time scheduled net interchange volume by interface (GWh): 2012

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	(52.5)	(29.2)	(27.8)	(34.3)	(15.3)	(22.7)	238.8	232.1	(30.4)	(32.4)	(36.6)	(45.8)	143.8
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.1
DUK	98.9	(85.3)	(13.0)	(73.2)	160.6	46.6	114.7	(9.7)	30.1	75.9	24.3	1.5	371.5
EKPC	(37.5)	(19.2)	(14.3)	(61.9)	(52.8)	(71.2)	(59.8)	(69.8)	(165.8)	(174.1)	(115.8)	(83.5)	(925.8)
LGEE	357.0	141.4	128.3	181.6	35.0	194.3	279.5	239.8	239.8	331.3	334.5	224.4	2,686.8
MISO	(837.5)	(588.4)	21.5	(780.8)	(849.2)	(622.1)	(1,514.0)	(690.2)	(712.6)	(1,065.8)	307.6	(318.5)	(7,649.8)
ALTE	(693.8)	(557.5)	(179.2)	(651.7)	(653.7)	(453.4)	(799.3)	(599.4)	(516.2)	(807.9)	(324.4)	(483.2)	(6,719.8)
ALTW	(49.7)	(22.7)	(4.9)	(12.9)	(32.6)	(12.1)	(9.5)	(42.6)	(16.4)	(31.8)	(15.0)	(32.0)	(282.2)
AMIL	17.7	39.9	106.3	(55.2)	(17.2)	(17.1)	146.1	151.3	133.3	146.2	248.2	249.6	1,148.9
CIN	377.7	179.8	300.2	241.2	13.5	87.1	(254.9)	161.4	41.5	(32.8)	233.9	162.2	1,510.7
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	(172.2)	(76.5)	27.6	(123.5)	(162.6)	(72.9)	(224.2)	(98.3)	(202.1)	(193.4)	32.1	(72.4)	(1,338.5)
MEC	(468.8)	(446.6)	(430.5)	(400.2)	(482.9)	(467.3)	(485.4)	(475.5)	(475.9)	(490.6)	(463.1)	(303.2)	(5,389.9)
MECS	378.4	488.4	348.5	366.7	551.8	494.4	355.0	436.8	472.1	676.9	720.4	392.7	5,682.2
NIPS	(18.4)	(17.4)	14.3	10.4	19.3	(39.8)	(83.9)	(30.9)	76.8	(36.3)	(13.5)	(52.9)	(172.3)
WEC	(208.4)	(175.8)	(160.7)	(155.5)	(84.7)	(140.9)	(157.9)	(193.1)	(225.6)	(296.1)	(111.0)	(179.3)	(2,089.0)
NYISO	(1,127.3)	(750.9)	(508.4)	(317.8)	(110.2)	(396.7)	(577.6)	(1,168.5)	(869.2)	(523.8)	(825.8)	(1,228.7)	(8,404.8)
LIND	(63.9)	(6.3)	(64.5)	(60.6)	33.1	(39.4)	(62.6)	(119.1)	(77.0)	(8.5)	(8.2)	(159.3)	(636.3)
NEPT	(415.7)	(329.7)	(288.4)	(155.4)	(119.8)	0.0	(1.4)	(275.7)	(237.1)	(64.6)	(109.1)	(256.5)	(2,253.2)
NYIS	(647.8)	(414.9)	(155.5)	(101.8)	(23.5)	(357.3)	(513.5)	(773.8)	(555.1)	(450.7)	(708.4)	(812.9)	(5,515.3)
OVEC	712.5	693.4	588.3	627.1	835.9	714.4	834.9	745.2	526.7	814.1	1,007.9	825.6	8,925.8
TVA	783.0	787.2	580.6	485.4	794.0	883.5	1,229.6	703.0	254.9	377.9	456.6	287.7	7,623.4
Total	(103.4)	149.0	755.1	26.1	798.0	726.0	546.2	(18.2)	(726.5)	(196.8)	1,152.7	(337.2)	2,770.9

Table E-21 Real-time scheduled gross import volume by interface (GWh): 2012

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	0.3	0.0	0.4	1.6	2.1	2.7	274.0	256.4	0.0	0.9	0.0	2.4	540.8
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.1
DUK	277.1	168.8	134.8	187.5	288.2	142.0	268.7	167.6	120.5	149.4	198.6	115.7	2,218.9
EKPC	41.0	31.5	26.7	3.2	8.1	7.6	30.2	24.2	3.4	1.3	8.4	14.3	199.9
LGEE	365.4	147.0	149.7	186.2	94.6	204.4	282.2	244.2	243.3	331.4	335.2	252.0	2,835.6
MISO	1,196.1	1,030.0	1,025.4	1,229.2	1,148.0	929.4	991.6	1,112.7	1,189.2	1,420.6	1,541.9	1,313.0	14,126.9
ALTE	1.3	4.8	0.2	0.0	0.6	0.0	0.0	3.8	3.9	0.0	0.1	0.0	14.7
ALTW	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.4	0.0	1.5
AMIL	46.5	78.1	134.2	13.5	24.3	34.1	201.4	172.2	183.7	194.1	273.2	295.8	1,651.1
CIN	526.9	330.4	340.5	530.7	379.8	314.7	216.9	288.7	312.4	376.1	392.7	362.2	4,372.0
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	127.3	88.2	126.3	94.8	60.7	58.4	67.5	52.9	58.5	124.6	103.0	64.4	1,026.5
MEC	16.9	7.3	0.1	0.2	0.2	0.0	0.0	0.3	1.3	0.0	7.0	181.0	214.2
MECS	408.3	520.4	390.7	519.7	598.0	521.5	504.1	587.9	503.9	713.5	726.1	409.7	6,403.8
NIPS	59.4	0.7	32.5	70.2	84.0	0.7	1.6	6.3	125.5	12.1	38.3	0.0	431.3
WEC	9.6	0.0	0.9	0.0	0.6	0.0	0.0	0.7	0.0	0.2	0.1	0.0	11.9
NYISO	506.4	678.4	887.4	824.9	886.8	883.2	1,004.0	900.4	818.0	883.6	718.2	759.4	9,750.6
LIND	10.7	19.6	12.2	18.6	52.2	25.0	33.4	21.0	14.1	35.6	0.0	1.8	244.3
NEPT	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NYIS	495.6	658.7	875.1	806.3	834.6	858.2	970.6	879.5	803.9	848.0	718.2	757.6	9,506.3
OVEC	738.2	716.7	611.5	647.2	856.0	731.7	853.5	763.8	544.3	832.3	1,029.0	847.4	9,171.8
TVA	802.8	845.0	610.7	510.0	835.2	927.7	1,272.0	742.8	273.1	386.6	471.8	303.7	7,981.3
Total	3,927.2	3,617.4	3,446.6	3,589.7	4,118.9	3,828.7	4,976.3	4,212.1	3,191.9	4,006.1	4,303.1	3,608.0	46,825.9

Table E-22 Real-time scheduled gross export volume by interface (GWh): 2012

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	52.8	29.2	28.2	35.9	17.4	25.5	35.2	24.3	30.5	33.3	36.6	48.1	397.0
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	178.2	254.1	147.7	260.6	127.6	95.4	154.0	177.3	90.5	73.5	174.3	114.2	1,847.4
EKPC	78.5	50.7	41.1	65.1	60.8	78.8	90.0	169.2	175.3	124.1	97.8	1,125.6	
LGEE	8.4	5.6	21.4	4.6	59.6	10.1	2.7	4.4	3.5	0.2	0.8	27.6	148.9
MISO	2,033.5	1,618.4	1,003.8	2,010.0	1,997.2	1,551.4	2,505.6	1,802.9	1,901.8	2,486.4	1,234.3	1,631.5	21,776.8
ALTE	695.1	562.3	179.5	651.7	654.4	453.4	799.3	603.2	520.1	807.9	324.4	483.2	6,734.4
ALTW	49.7	22.8	4.9	12.9	32.6	12.1	9.5	42.6	16.4	31.8	16.4	32.0	283.7
AMIL	28.7	38.3	28.0	68.7	41.5	51.2	55.3	20.9	50.4	47.9	25.0	46.2	502.1
CIN	149.2	150.6	40.3	289.6	366.4	227.6	471.9	127.3	270.9	408.9	158.8	200.0	2,861.3
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	299.5	164.7	98.7	218.3	223.3	131.3	291.7	151.2	260.6	318.0	70.9	136.7	2,364.9
MEC	485.7	453.9	430.5	400.4	483.0	467.3	485.4	475.8	477.2	490.6	470.1	484.2	5,604.1
MECS	29.9	32.0	42.2	153.0	46.1	27.1	149.1	151.1	31.9	36.6	5.6	17.0	721.6
NIPS	77.8	18.1	18.2	59.8	64.7	40.5	85.5	37.2	48.7	48.4	51.9	52.9	603.6
WEC	218.0	175.8	161.6	155.5	85.3	140.9	157.9	193.7	225.6	296.3	111.1	179.3	2,100.9
NYISO	1,633.7	1,429.2	1,395.7	1,142.7	997.0	1,279.9	1,581.6	2,069.0	1,687.2	1,407.4	1,543.9	1,988.2	18,155.5
LIND	74.6	26.0	76.7	79.2	19.1	64.4	96.0	140.0	91.1	44.1	8.2	161.1	880.7
NEPT	415.7	329.7	288.4	155.4	119.8	0.0	1.4	275.7	237.1	64.6	109.1	256.5	2,253.2
NYIS	1,143.4	1,073.6	1,030.6	908.1	858.1	1,215.6	1,484.1	1,653.2	1,359.0	1,298.7	1,426.6	1,570.6	15,021.6
OVEC	25.7	23.3	23.3	20.1	20.1	17.3	18.6	18.6	17.7	18.2	21.2	21.8	246.0
TVA	19.8	57.8	30.2	24.6	41.2	44.1	42.4	39.8	18.2	8.7	15.2	15.9	357.9
Total	4,030.6	3,468.4	2,691.5	3,563.6	3,320.9	3,102.7	4,430.2	4,230.3	3,918.4	4,202.9	3,150.4	3,945.2	44,055.0

Table E-23 Day-ahead scheduled net interchange volume by interface (GWh): 2012

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	(46.8)	(19.9)	(24.9)	(29.6)	(15.3)	(23.9)	(8.8)	182.6	(27.6)	(33.0)	(23.3)	(43.9)	(114.3)
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	39.0	18.6	19.8	11.3	40.4	35.5	29.5	96.6	35.2	39.4	26.5	35.7	427.5
EKPC	(35.6)	(34.8)	(37.2)	(36.0)	(37.2)	(36.0)	(37.2)	(36.6)	(36.0)	(37.2)	(36.1)	(37.2)	(437.0)
LGEE	52.9	0.0	(18.6)	4.6	12.3	39.2	50.8	18.1	48.4	59.0	102.3	72.5	441.5
MISO	(911.9)	(697.6)	(314.6)	(400.3)	(568.8)	(468.4)	(977.7)	(752.8)	(649.9)	(858.2)	(569.6)	(840.8)	(8,010.7)
ALTE	(474.1)	(476.4)	(145.4)	(410.0)	(243.1)	(170.6)	(438.6)	(356.9)	(204.6)	(318.0)	(132.9)	(261.1)	(3,631.7)
ALTW	(26.1)	(7.8)	(2.6)	(2.4)	(6.1)	(6.6)	(0.8)	(22.5)	(1.7)	(18.0)	(11.7)	(29.6)	(135.8)
AMIL	(3.1)	0.0	0.0	0.8	0.0	2.4	0.0	0.8	3.6	1.4	4.8	(1.0)	9.7
CIN	130.6	205.2	236.5	322.4	59.2	131.0	(90.5)	91.3	91.4	(2.6)	30.8	30.3	1,235.5
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	(15.0)	(10.2)	(1.9)	(5.1)	(10.9)	(7.9)	(27.0)	(13.8)	(16.6)	(13.1)	(7.1)	(11.8)	(140.5)
MEC	(485.7)	(454.2)	(429.3)	(386.5)	(482.1)	(462.9)	(470.7)	(472.7)	(461.3)	(480.5)	(468.7)	(483.6)	(5,538.1)
MECS	81.3	148.4	112.3	183.2	177.4	115.5	128.7	133.8	58.2	82.9	128.8	34.0	1,384.5
NIPS	0.0	0.0	0.0	0.0	0.0	0.0	(3.8)	(33.3)	(46.4)	(46.2)	(51.1)	(50.0)	(230.8)
WEC	(119.9)	(102.6)	(84.1)	(102.5)	(63.2)	(69.4)	(75.0)	(79.4)	(72.6)	(64.1)	(62.5)	(68.1)	(963.3)
NYISO	(1,175.9)	(928.5)	(661.4)	(399.5)	(302.6)	(458.5)	(679.2)	(966.4)	(821.6)	(613.4)	(690.2)	(856.7)	(8,553.8)
LIND	(10.2)	(2.2)	(7.2)	(0.7)	29.3	1.2	10.3	3.0	(2.4)	19.9	0.0	(3.3)	37.7
NEPT	(425.2)	(355.9)	(314.5)	(160.0)	(142.8)	0.0	(9.2)	(274.5)	(244.4)	(70.4)	(109.7)	(262.7)	(2,369.3)
NYIS	(740.4)	(570.4)	(339.7)	(238.8)	(189.2)	(459.8)	(680.3)	(694.9)	(574.8)	(562.9)	(580.5)	(590.7)	(6,222.2)
OVEC	545.7	521.4	440.8	472.6	625.9	552.9	640.1	548.9	379.4	610.5	726.9	584.8	6,649.8
TVA	204.7	195.9	92.8	95.4	275.9	136.6	156.9	147.4	64.6	116.5	104.7	5.6	1,597.0
Total without Up-To Congestion	(1,327.9)	(945.0)	(503.3)	(281.4)	30.5	(222.7)	(825.6)	(762.2)	(1,007.4)	(716.4)	(358.7)	(1,080.1)	(8,000.1)
Up-To Congestion	(519.6)	(17.7)	28.2	(1,223.6)	2,670.4	364.2	177.9	(586.8)	(872.8)	(1,980.3)	(1,354.7)	(1,233.5)	(4,548.3)
Total	(1,847.5)	(962.7)	(475.1)	(1,505.0)	2,700.9	141.5	(647.7)	(1,349.0)	(1,880.2)	(2,696.6)	(1,713.4)	(2,313.6)	(12,548.4)

Table E-24 Day-ahead scheduled gross import volume by interface (GWh): 2012

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	0.0	0.0	0.0	0.0	0.0	0.0	27.6	204.2	0.0	0.0	0.0	0.0	231.8
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	40.8	47.9	32.8	18.9	41.2	35.5	35.4	116.5	35.2	39.4	28.4	35.7	507.8
EKPC	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
LGEE	52.9	0.0	0.0	4.6	12.3	39.2	50.8	18.1	48.4	59.0	102.3	72.5	460.1
MISO	217.0	367.5	359.3	522.0	385.0	336.6	249.9	294.8	273.9	345.0	222.9	131.5	3,705.5
ALTE	0.0	0.0	0.0	1.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.6
ALTW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.5	0.0	1.5
AMIL	0.4	0.0	0.0	0.8	0.0	2.4	0.0	0.8	3.6	1.4	4.8	1.3	15.5
CIN	135.3	219.1	247.0	336.5	207.7	218.7	120.8	149.6	210.2	254.7	87.8	92.2	2,279.5
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.1
MEC	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.8	0.0	0.0	0.0	0.8
MECS	81.3	148.4	112.3	183.2	177.4	115.5	129.0	144.5	59.3	88.9	128.8	38.0	1,406.5
NIPS	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
WEC	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NYISO	359.7	533.6	728.6	655.1	688.1	717.4	790.0	766.6	684.3	735.2	564.6	651.1	7,874.3
LIND	0.0	1.4	1.7	7.7	32.8	6.4	18.9	14.8	5.0	23.9	0.0	0.3	112.9
NEPT	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NYIS	359.7	532.3	726.9	647.4	655.3	710.9	771.1	751.8	679.4	711.3	564.6	650.7	7,761.4
OVEC	571.3	544.6	464.0	491.4	645.9	552.9	640.1	567.3	397.1	610.5	726.9	584.8	6,797.0
TVA	217.7	223.7	100.5	105.5	307.3	149.1	165.0	150.1	64.8	117.1	111.2	8.0	1,720.0
Total without Up-To Congestion	1,459.4	1,717.4	1,685.2	1,797.4	2,079.8	1,830.6	1,958.9	2,117.7	1,503.9	1,906.3	1,756.4	1,483.5	21,296.4
Up-To Congestion	13,728.0	12,936.0	13,418.2	15,214.5	17,586.0	12,925.9	13,350.2	13,068.1	12,381.2	12,361.9	6,804.3	5,570.9	149,345.1
Total	15,187.4	14,653.3	15,103.4	17,011.9	19,665.8	14,756.4	15,309.1	15,185.8	13,885.1	14,268.1	8,560.7	7,054.4	170,641.5

Table E-25 Day-ahead scheduled gross export volume by interface (GWh): 2012

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPLE	46.8	19.9	24.9	29.6	15.3	23.9	36.4	21.5	27.6	33.0	23.3	43.9	346.1
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	1.8	29.3	13.0	7.6	0.8	0.0	5.9	20.0	0.0	0.0	1.9	0.0	80.3
EKPC	35.6	34.8	37.2	36.0	37.2	36.0	37.2	36.6	36.0	37.2	36.1	37.2	437.0
LGEE	0.0	0.0	18.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	18.6
MISO	1,128.9	1,065.1	673.8	922.3	953.9	805.0	1,227.6	1,047.6	923.8	1,203.2	792.5	972.3	11,716.2
ALTE	474.1	476.4	145.4	411.6	243.1	170.6	438.6	356.9	204.6	318.0	132.9	261.1	3,633.3
ALTW	26.1	7.8	2.6	2.4	6.1	6.6	0.8	22.5	1.7	18.0	13.2	29.6	137.3
AMIL	3.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.4	5.9
CIN	4.7	13.9	10.5	14.1	148.5	87.7	211.3	58.2	118.8	257.4	57.0	61.9	1,044.0
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	15.0	10.2	1.9	5.1	10.9	7.9	27.1	13.8	16.6	13.1	7.1	11.8	140.6
MEC	485.7	454.2	429.3	386.5	482.1	462.9	470.7	472.7	462.1	480.5	468.7	483.6	5,538.9
MECS	0.0	0.0	0.0	0.0	0.0	0.0	0.3	10.7	1.1	6.0	0.0	4.0	22.1
NIPS	0.0	0.0	0.0	0.0	0.0	0.0	3.8	33.3	46.4	46.2	51.1	50.0	230.8
WEC	119.9	102.6	84.1	102.5	63.2	69.4	75.0	79.4	72.6	64.1	62.5	68.1	963.3
NYISO	1,535.5	1,462.1	1,390.0	1,054.5	990.7	1,175.9	1,469.2	1,733.0	1,505.9	1,348.7	1,254.9	1,507.8	16,428.1
LIND	10.2	3.6	8.9	8.4	3.4	5.2	8.6	11.9	7.4	4.0	0.0	3.6	75.2
NEPT	425.2	355.9	314.5	160.0	142.8	0.0	9.2	274.5	244.4	70.4	109.7	262.7	2,369.3
NYIS	1,100.1	1,102.7	1,066.6	886.2	844.5	1,170.7	1,451.4	1,446.7	1,254.1	1,274.2	1,145.1	1,241.4	13,983.6
OVEC	25.6	23.3	23.3	18.8	20.1	0.0	0.0	18.5	17.7	0.0	0.0	0.0	147.2
TVA	13.0	27.8	7.7	10.1	31.4	12.5	8.2	2.7	0.3	0.6	6.5	2.4	123.0
Total without Up-To Congestion	2,787.3	2,662.4	2,188.5	2,078.8	2,049.3	2,053.3	2,784.5	2,879.9	2,511.2	2,622.6	2,115.1	2,563.6	29,296.5
Up-To Congestion	14,247.6	12,953.7	13,390.0	16,438.1	14,915.6	12,561.6	13,172.3	13,654.9	13,254.1	14,342.2	8,159.0	6,804.4	153,893.4
Total	17,034.9	15,616.0	15,578.5	18,516.9	16,964.9	14,614.9	15,956.8	16,534.8	15,765.3	16,964.8	10,274.1	9,368.0	183,189.9

Table E-26 Real-time scheduled net interchange volume by interface (GWh): 2013

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPLE	(19.1)	(59.6)	(80.6)	(25.6)	(45.4)	185.5	213.2	171.0	(58.0)	(17.0)	(69.0)	(46.2)	149.3
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1
DUK	175.2	122.7	148.1	80.9	294.6	221.9	263.2	134.0	(49.5)	(22.2)	(171.9)	77.2	1,274.2
EKPC	(149.7)	(139.9)	(152.7)	(152.2)	(108.8)								(703.3)
LGEE	281.5	272.0	302.2	182.9	204.3	253.5	312.2	263.2	206.7	254.8	341.0	362.3	3,236.6
MISO	(201.0)	127.5	413.7	201.0	(405.7)	(402.4)	198.4	(796.9)	(908.0)	(782.5)	(130.4)	(622.5)	(3,308.5)
ALTE	(306.7)	(176.9)	(239.3)	(214.3)	(454.5)	(449.7)	(370.3)	(474.7)	(420.9)	(363.1)	(122.8)	(251.4)	(3,844.8)
ALTW	(9.0)	(4.5)	(3.0)	(3.8)	(25.3)	(40.2)	(1.8)	(33.8)	(17.9)	(18.4)	(5.6)	(96.5)	(259.6)
AMIL	181.7	153.6	181.5	150.2	170.1	11.8	340.6	(76.7)	(145.2)	(99.3)	(94.7)	131.5	905.1
CIN	253.3	285.4	349.7	272.0	129.6	350.0	376.1	315.0	165.9	98.6	174.8	(94.3)	2,676.1
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	(43.4)	48.1	63.8	74.5	(29.2)	128.7	239.6	50.6	(10.8)	43.2	273.9	8.2	847.2
MEC	(484.1)	(390.8)	(158.9)	(421.4)	(509.1)	(464.2)	(492.5)	(478.1)	(465.7)	(483.1)	(468.9)	(259.4)	(5,076.2)
MECS	322.3	298.9	322.5	433.4	529.0	291.8	205.0	24.1	130.0	273.9	306.0	132.3	3,269.1
NIPS	(22.9)	(12.5)	(22.0)	(25.6)	(71.6)	(5.0)	9.3	(7.7)	(6.2)	(8.6)	(9.1)	35.8	(146.0)
WEC	(92.1)	(73.8)	(80.5)	(64.0)	(144.7)	(225.6)	(107.6)	(115.6)	(137.1)	(225.7)	(184.0)	(228.7)	(1,679.4)
NYISO	(1,077.4)	(1,042.5)	(1,130.5)	(357.8)	(277.7)	(637.1)	(1,006.3)	(916.2)	(829.5)	(557.9)	(324.6)	(1,339.1)	(9,496.7)
HUDS				(15.4)	(42.2)	(25.8)	(33.4)	(18.5)	(8.2)	(7.3)	(48.1)	(133.8)	(332.8)
LIND	(168.8)	(152.9)	(94.0)	(67.4)	(79.5)	(58.1)	(75.8)	(74.5)	(87.7)	(35.4)	(63.6)	(220.4)	(1,178.1)
NEPT	(276.9)	(251.2)	(244.6)	(252.5)	(104.7)	(171.5)	(416.9)	(422.7)	(228.6)	(267.6)	(233.4)	(393.6)	(3,264.1)
NYIS	(631.7)	(638.4)	(791.9)	(22.6)	(51.4)	(381.8)	(480.2)	(400.4)	(505.0)	(247.6)	20.6	(591.3)	(4,721.7)
OVEC	798.2	713.5	585.0	542.8	712.0	908.3	985.5	825.5	685.2	854.9	715.3	928.9	9,255.1
TVA	643.8	461.4	235.8	94.2	278.8	217.6	475.5	297.6	119.5	164.3	110.9	274.7	3,374.1
Total	451.5	455.1	321.1	566.1	652.1	747.3	1,441.7	(21.7)	(833.6)	(105.6)	471.3	(364.6)	3,780.9

Table E-27 Real-time scheduled gross import volume by interface (GWh): 2013

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	37.3	0.1	1.6	15.0	4.6	220.1	246.0	233.3	20.6	8.3	2.0	5.6	794.6
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.1	0.1
DUK	225.0	190.6	157.0	137.4	320.4	265.8	301.2	202.6	70.7	94.0	91.3	194.8	2,250.8
EKPC	4.4	1.5	25.6	21.8	33.0								86.3
LGEE	299.0	272.4	302.2	186.0	205.0	255.4	318.3	264.2	223.2	258.8	342.2	362.4	3,289.0
MISO	1,026.9	1,019.3	1,431.1	1,205.3	1,264.4	1,193.4	1,599.9	1,001.3	897.7	860.2	1,062.1	1,085.7	13,647.3
ALTE	0.0	1.1	0.0	0.0	0.0	0.0	3.7	0.0	0.0	0.0	1.5	0.0	6.2
ALTW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
AMIL	207.0	177.1	215.1	198.2	213.8	79.0	386.4	98.4	107.6	46.9	35.6	289.0	2,054.2
CIN	374.5	394.7	455.5	438.9	358.2	519.7	518.4	493.0	361.8	259.1	323.5	297.4	4,794.7
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	95.9	76.5	101.6	101.3	70.4	176.3	289.3	103.6	62.7	115.8	336.2	87.6	1,617.3
MEC	0.2	48.2	320.6	6.2	0.0	0.0	3.9	3.3	1.1	0.8	0.0	228.6	613.0
MECS	349.1	321.6	338.3	458.2	621.9	418.4	383.5	302.8	362.5	437.6	365.4	141.1	4,500.5
NIPS	0.2	0.0	0.0	2.4	0.0	0.0	14.7	0.2	1.9	0.0	0.0	42.1	61.3
WEC	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NYISO	871.1	782.2	820.8	1,038.1	858.0	895.3	984.4	914.6	834.4	921.5	957.6	856.9	10,734.9
HUDD				0.3	0.3	0.2	0.0	0.0	0.0	0.0	0.0	0.0	0.8
LIND	0.7	10.5	7.5	13.7	7.9	10.4	19.9	9.1	8.4	17.1	22.1	0.0	127.1
NEPT	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.1	0.0	0.1	0.4	0.0	0.8
NYIS	870.5	771.6	813.2	1,024.1	849.8	884.8	964.5	905.4	825.9	904.4	935.1	856.9	10,606.2
OVEC	798.3	713.5	585.1	543.8	728.4	916.1	985.6	825.5	685.2	854.9	715.3	928.9	9,280.6
TVA	689.8	630.0	399.1	261.5	431.9	265.9	493.8	313.8	146.9	184.1	143.6	317.9	4,278.3
Total	3,951.8	3,609.6	3,722.5	3,408.9	3,845.8	4,012.0	4,929.0	3,755.3	2,878.6	3,181.9	3,314.0	3,752.3	44,361.8

Table E-28 Real-time scheduled gross export volume by interface (GWh): 2013

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	56.4	59.7	82.1	40.6	50.0	34.6	32.8	62.3	78.6	25.3	71.0	51.8	645.3
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	49.8	67.9	8.9	56.5	25.8	43.9	37.9	68.6	120.2	116.2	263.2	117.6	976.6
EKPC	154.0	141.4	178.3	174.0	141.8								789.6
LGEE	17.5	0.4	0.0	3.1	0.7	1.8	6.1	1.1	16.5	4.0	1.1	0.1	52.3
MISO	1,227.9	891.8	1,017.4	1,004.3	1,670.1	1,595.8	1,401.4	1,798.1	1,805.7	1,642.7	1,192.5	1,708.1	16,955.7
ALTE	306.7	178.0	239.3	214.3	454.5	449.7	374.0	474.7	420.9	363.1	124.3	251.4	3,851.1
ALTW	9.0	4.5	3.0	3.8	25.3	40.2	1.8	33.8	17.9	18.4	5.6	96.5	259.6
AMIL	25.3	23.5	33.6	48.0	43.7	67.3	45.7	175.2	252.8	146.1	130.3	157.5	1,149.1
CIN	121.2	109.3	105.8	166.9	228.6	169.7	142.3	178.0	195.9	160.5	148.7	391.6	2,118.6
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	139.3	28.4	37.8	26.8	99.7	47.6	49.7	53.0	73.5	72.7	62.3	79.3	770.1
MEC	484.4	439.0	479.6	427.6	509.1	464.2	496.4	481.4	466.8	483.9	468.9	488.0	5,689.2
MECS	26.8	22.7	15.8	24.8	93.0	126.6	178.6	278.7	232.6	163.7	59.3	8.9	1,231.4
NIPS	23.0	12.5	22.0	28.0	71.6	5.0	5.4	7.8	8.1	8.6	9.1	6.2	207.3
WEC	92.1	73.8	80.5	64.0	144.7	225.6	107.6	115.6	137.1	225.7	184.0	228.7	1,679.4
NYISO	1,948.6	1,824.7	1,951.3	1,395.9	1,135.8	1,532.4	1,990.7	1,830.8	1,663.9	1,479.4	1,282.2	2,196.0	20,231.6
HUDD				15.7	42.5	26.0	33.4	18.6	8.2	7.3	48.2	133.8	333.6
LIND	169.5	163.4	101.6	81.0	87.4	68.5	95.6	83.6	96.1	52.4	85.7	220.4	1,305.2
NEPT	276.9	251.3	244.6	252.5	104.7	171.5	416.9	422.8	228.6	267.6	233.8	393.6	3,264.9
NYIS	1,502.1	1,410.0	1,605.1	1,046.7	901.2	1,266.5	1,444.7	1,305.8	1,330.9	1,152.0	914.6	1,448.2	15,327.9
OVEC	0.1	0.0	0.0	1.1	16.4	7.8	0.0	0.0	0.0	0.0	0.0	0.0	25.4
TVA	46.0	168.7	163.3	167.3	153.1	48.3	18.3	16.1	27.4	19.8	32.7	43.3	904.3
Total	3,500.2	3,154.5	3,401.4	2,842.7	3,193.7	3,264.7	3,487.3	3,777.0	3,712.2	3,287.5	2,842.7	4,116.9	40,580.8

Table E-29 Day-ahead scheduled net interchange volume by interface (GWh): 2013

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	(33.4)	(28.5)	(41.2)	(30.5)	(24.1)	172.0	208.7	215.4	(47.1)	(18.8)	(11.2)	(15.7)	345.4
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	78.0	70.1	75.8	82.3	145.7	127.5	149.9	80.9	22.3	24.0	46.6	113.9	1,017.1
EKPC	(36.6)	(33.6)	(37.2)	(36.0)	(37.2)								(180.5)
LGEE	58.3	65.8	81.8	40.3	2.3	0.0	0.0	0.0	0.0	4.4	70.0	55.2	378.0
MISO	(725.1)	(488.3)	(526.4)	(457.3)	(809.4)	(765.2)	(667.9)	(892.5)	(798.5)	(851.4)	(539.2)	(955.0)	(8,476.2)
ALTE	(177.8)	(79.5)	(119.1)	(99.9)	(238.2)	(267.3)	(289.0)	(318.5)	(296.3)	(229.6)	(51.3)	(168.4)	(2,334.7)
ALTW	(7.6)	(2.5)	0.0	0.0	(2.5)	(35.8)	0.0	(24.0)	(6.8)	(14.7)	0.0	(36.7)	(130.5)
AMIL	8.7	5.2	26.3	13.5	(0.9)	(1.2)	1.9	(5.0)	(38.2)	(39.9)	(21.6)	0.0	(51.1)
CIN	7.9	45.9	37.1	32.3	18.3	44.4	41.6	37.1	61.9	57.9	(10.1)	(186.4)	187.9
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	(0.9)	(5.9)	(1.6)	0.0	0.0	33.9	117.5	54.5	0.0	0.0	0.0	0.0	197.6
MEC	(483.0)	(435.7)	(477.7)	(423.0)	(484.7)	(462.9)	(463.0)	(472.9)	(454.9)	(481.0)	(468.2)	(484.1)	(5,591.1)
MECS	23.4	45.8	102.9	93.1	97.9	36.9	8.9	(55.8)	72.2	(22.8)	118.1	51.1	571.9
NIPS	(22.2)	(12.5)	(21.5)	(27.8)	(70.7)	0.0	0.6	0.0	(0.2)	0.0	0.0	0.0	(154.3)
WEC	(73.7)	(49.2)	(72.8)	(45.5)	(128.8)	(113.1)	(86.4)	(107.9)	(136.4)	(121.4)	(106.1)	(130.6)	(1,171.8)
NYISO	(833.6)	(874.4)	(944.3)	(459.5)	(386.6)	(707.5)	(968.7)	(910.2)	(777.0)	(587.7)	(373.5)	(1,056.7)	(8,879.7)
HUDS	0.0	0.0	0.0	0.0	(32.5)	(36.6)	(18.4)	(12.1)	(7.9)	(2.7)	(28.3)	(97.8)	(236.5)
LIND	(15.3)	(14.3)	(2.6)	0.1	0.0	0.1	0.0	0.0	0.0	0.0	(9.4)	(34.1)	(75.6)
NEPT	(278.5)	(255.2)	(248.7)	(253.1)	(101.5)	(193.7)	(420.0)	(425.6)	(236.7)	(275.7)	(237.6)	(394.3)	(3,320.7)
NYIS	(539.7)	(604.9)	(693.0)	(206.5)	(252.6)	(477.2)	(530.3)	(472.4)	(532.3)	(309.2)	(98.1)	(530.5)	(5,246.9)
OVEC	561.5	494.4	408.0	324.6	522.8	644.8	691.9	598.5	498.0	607.0	529.4	693.9	6,574.8
TVA	32.7	3.6	(3.6)	41.2	92.4	18.6	71.9	47.0	42.9	60.2	26.6	25.1	458.6
Total without Up-To Congestion	(898.1)	(790.9)	(987.2)	(494.9)	(494.1)	(509.7)	(514.3)	(860.9)	(1,059.5)	(762.2)	(251.2)	(1,139.4)	(8,762.3)
Up-To Congestion	(1,704.8)	(1,336.7)	(875.0)	(421.3)	(191.6)	(457.4)	(252.3)	(374.2)	(505.0)	(1,331.0)	(1,346.8)	(44.9)	(8,840.9)
Total	(2,602.8)	(2,127.7)	(1,862.2)	(916.1)	(685.7)	(967.1)	(766.5)	(1,235.0)	(1,564.5)	(2,093.3)	(1,598.0)	(1,184.3)	(17,603.2)

Table E-30 Day-ahead scheduled gross import volume by interface (GWh): 2013

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	0.0	0.0	0.0	0.0	0.0	202.5	237.7	228.5	0.0	0.0	0.0	0.0	668.7
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	78.0	70.1	75.8	82.3	145.7	127.5	149.9	80.9	24.2	27.4	47.7	116.3	1,026.0
EKPC	0.0	0.0	0.0	0.0	0.0								0.0
LGEE	58.3	65.8	81.8	40.3	2.3	0.0	0.0	0.0	0.0	4.4	70.0	55.2	378.0
MISO	75.2	115.2	196.6	184.4	231.6	229.4	270.8	213.2	235.3	187.0	167.2	61.1	2,167.1
ALTE	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
ALTW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
AMIL	8.7	5.2	26.3	13.5	3.9	1.9	1.9	0.0	7.9	0.0	0.0	0.0	69.5
CIN	21.5	64.2	58.4	77.7	61.9	52.0	41.6	41.5	62.7	59.7	1.2	10.0	552.4
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	5.6	0.0	0.0	0.0	0.0	33.9	117.5	54.5	0.0	0.0	0.0	0.0	211.6
MEC	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
MECS	39.3	45.8	111.9	93.1	165.8	141.6	109.2	117.1	164.6	127.3	166.0	51.1	1,333.0
NIPS	0.0	0.0	0.0	0.0	0.0	0.0	0.6	0.0	0.0	0.0	0.0	0.0	0.6
WEC	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NYISO	726.2	650.4	717.7	768.3	601.6	726.7	755.8	749.1	696.8	740.8	723.9	705.2	8,562.4
HUDS	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
LIND	0.1	9.3	2.9	0.1	0.0	0.1	0.0	0.0	0.0	0.0	1.4	0.0	13.8
NEPT	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NYIS	726.2	641.1	714.8	768.2	601.6	726.6	755.8	749.1	696.8	740.8	722.5	705.2	8,548.6
OVEC	561.5	494.4	408.0	324.6	522.8	644.8	691.9	598.5	498.0	607.0	529.4	693.9	6,574.8
TVA	41.7	13.6	3.6	42.7	102.8	21.5	74.1	47.0	50.1	63.5	35.4	36.9	532.7
Total without Up-To Congestion	1,540.9	1,409.5	1,483.5	1,442.6	1,606.8	1,952.4	2,180.1	1,917.2	1,504.4	1,630.0	1,573.5	1,668.7	19,909.7
Up-To Congestion	4,637.9	3,481.0	4,226.5	4,728.9	4,890.0	4,135.3	3,571.1	3,422.3	3,183.9	2,387.3	2,972.8	3,692.9	45,329.9
Total	6,178.8	4,890.5	5,710.0	6,171.5	6,496.8	6,087.8	5,751.2	5,339.5	4,688.3	4,017.3	4,546.4	5,361.6	65,239.6

Table E-31 Day-ahead scheduled gross export volume by interface (GWh): 2013

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	33.4	28.5	41.2	30.5	24.1	30.5	29.0	13.1	47.1	18.8	11.2	15.7	323.2
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.0	3.3	1.1	2.4	8.8
EKPC	36.6	33.6	37.2	36.0	37.2								180.5
LGEE	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
MISO	800.2	603.5	723.1	641.7	1,041.1	994.6	938.7	1,105.7	1,033.8	1,038.4	706.4	1,016.1	10,643.3
ALTE	177.8	79.5	119.1	99.9	238.2	267.3	289.0	318.5	296.3	229.6	51.3	168.4	2,334.7
ALTW	7.6	2.5	0.0	0.0	2.5	35.8	0.0	24.0	6.8	14.7	0.0	36.7	130.5
AMIL	0.0	0.0	0.0	0.0	4.8	3.2	0.0	5.0	46.1	39.9	21.6	0.0	120.6
CIN	13.7	18.3	21.3	45.5	43.5	7.6	0.0	4.4	0.8	1.7	11.3	196.4	364.5
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	6.5	5.9	1.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	14.0
MEC	483.0	435.7	477.7	423.0	484.7	462.9	463.0	472.9	454.9	481.0	468.2	484.1	5,591.1
MECS	15.9	0.0	9.1	0.0	67.9	104.7	100.3	172.9	92.5	150.1	47.8	0.0	761.1
NIPS	22.2	12.5	21.5	27.8	70.7	0.0	0.0	0.0	0.2	0.0	0.0	0.0	154.9
WEC	73.7	49.2	72.8	45.5	128.8	113.1	86.4	107.9	136.4	121.4	106.1	130.6	1,171.8
NYISO	1,559.8	1,524.8	1,662.1	1,227.8	988.2	1,434.2	1,724.5	1,659.3	1,473.8	1,328.4	1,097.3	1,761.9	17,442.1
HUDS	0.0	0.0	0.0	0.0	32.5	36.6	18.4	12.1	7.9	2.7	28.3	97.8	236.5
LIND	15.4	23.6	5.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	10.8	34.1	89.4
NEPT	278.5	255.2	248.7	253.1	101.5	193.7	420.0	425.6	236.7	275.7	237.6	394.3	3,320.7
NYIS	1,265.9	1,246.0	1,407.8	974.7	854.2	1,203.9	1,286.1	1,221.6	1,229.1	1,050.0	820.6	1,235.7	13,795.5
OVEC	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
TVA	9.0	10.0	7.2	1.5	10.4	2.9	2.2	0.0	7.1	3.2	8.7	11.8	74.1
Total without Up-To Congestion	2,439.0	2,200.5	2,470.7	1,937.5	2,100.9	2,462.2	2,694.4	2,778.1	2,563.9	2,392.2	1,824.8	2,808.0	28,672.0
Up-To Congestion	6,342.6	4,817.7	5,101.5	5,150.2	5,081.6	4,592.7	3,823.4	3,796.4	3,688.9	3,718.4	4,319.6	3,737.9	54,170.8
Total	8,781.6	7,018.2	7,572.2	7,087.7	7,182.4	7,054.9	6,517.8	6,574.5	6,252.8	6,110.6	6,144.4	6,545.9	82,842.8

Table E-32 Real-time scheduled net interchange volume by interface (GWh): 2014

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	(56.0)	3.7	(11.7)	(20.6)	(20.5)	39.6	(24.6)	(10.7)	(12.9)	(14.8)	(7.7)	(16.0)	(152.2)
CPLW	0.0	0.6	5.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5.8
DUK	294.7	395.5	541.7	107.3	183.8	(37.1)	(135.1)	(114.3)	(41.3)	65.3	26.1	189.9	1,476.4
LGEE	262.4	230.3	159.5	49.9	129.6	233.3	182.1	207.7	182.3	207.1	187.6	179.1	2,211.0
MISO	771.4	(847.9)	(1,860.0)	(1,192.7)	44.6	(562.3)	(284.6)	210.3	(1,053.2)	(791.2)	(216.8)	(498.3)	(6,280.8)
ALTE	(140.8)	(241.9)	(770.7)	(516.4)	(361.5)	(412.4)	(290.0)	(199.4)	(501.5)	(428.0)	(419.0)	(278.0)	(4,559.4)
ALTW	(49.5)	(85.5)	(98.5)	(109.8)	(8.1)	(8.7)	(4.0)	(0.5)	(39.5)	(0.9)	(1.6)	(2.0)	(408.6)
AMIL	917.6	478.4	317.9	396.1	566.6	576.5	791.0	764.2	667.5	499.8	725.9	524.5	7,225.9
CIN	318.9	(341.6)	(350.1)	(263.9)	(32.6)	15.2	9.5	16.8	(132.5)	(68.3)	141.4	(56.5)	(743.6)
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	87.3	(65.3)	(2.3)	13.5	7.1	(222.1)	(75.2)	6.7	(58.7)	(23.7)	82.4	(22.3)	(272.5)
MEC	(421.8)	(387.0)	(239.8)	(357.4)	(409.2)	(472.0)	(473.4)	(474.6)	(529.5)	(479.9)	(465.5)	(484.1)	(5,194.2)
MECS	158.2	(25.4)	(564.6)	(387.1)	140.3	(41.1)	(31.4)	134.1	(363.7)	(267.6)	(181.9)	(91.2)	(1,521.6)
NIPS	15.2	(51.6)	(3.7)	112.3	266.0	179.3	(4.1)	53.3	93.8	80.7	0.3	11.2	752.7
WEC	(113.6)	(128.0)	(148.3)	(79.9)	(124.0)	(177.2)	(207.1)	(90.4)	(189.2)	(103.2)	(98.8)	(99.8)	(1,559.5)
NYISO	(1,121.7)	(1,357.7)	(1,734.4)	(925.6)	(47.2)	(438.4)	(667.3)	(579.4)	(455.3)	(426.5)	(368.4)	(919.4)	(9,041.2)
HUDS	(81.4)	(214.2)	(101.2)	(0.2)	(2.9)	(6.4)	(10.2)	(4.4)	(34.8)	(22.3)	(15.7)	(48.8)	(542.5)
LIND	(75.5)	(137.5)	(120.2)	(50.1)	66.9	5.3	2.5	(16.5)	(30.0)	(30.4)	16.3	(101.8)	(471.0)
NEPT	(310.0)	(433.0)	(399.0)	(444.6)	(262.0)	(377.6)	(435.4)	(471.9)	(317.1)	(350.5)	(391.2)	(383.3)	(4,575.5)
NYIS	(654.7)	(573.0)	(1,114.1)	(430.7)	150.8	(59.7)	(224.2)	(86.6)	(73.4)	(23.5)	22.3	(385.5)	(3,452.2)
OVEC	1,055.5	990.6	972.3	584.7	631.7	875.9	911.9	841.7	866.2	548.0	718.1	891.2	9,887.7
TVA	349.8	552.2	545.5	190.3	368.7	153.0	102.7	42.3	49.1	112.8	240.6	324.0	3,031.1
Total	1,556.0	(32.7)	(1,381.8)	(1,206.8)	1,290.8	264.0	85.2	597.6	(465.0)	(299.4)	579.5	150.5	1,137.8

Table E-33 Real-time scheduled gross import volume by interface (GWh): 2014

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPLE	5.4	20.7	5.9	8.7	12.8	83.9	13.8	10.4	19.5	15.2	13.3	10.8	220.4
CPLW	0.0	0.6	5.2	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	5.8
DUK	355.0	427.5	563.5	200.6	310.3	196.6	166.9	148.7	157.0	232.5	224.4	375.1	3,358.2
LGEE	263.5	230.3	162.7	70.4	130.9	233.9	182.5	208.1	185.8	207.1	195.0	193.7	2,263.9
MISO	1,939.4	1,066.5	1,144.8	1,299.5	1,668.9	1,523.0	1,571.0	1,362.4	1,177.5	1,165.0	1,567.9	1,293.9	16,779.9
ALTE	55.0	9.3	0.3	0.8	1.4	0.3	75.2	1.0	1.5	4.4	1.5	135.6	286.2
ALTW	0.5	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.5
AMIL	967.4	627.9	486.4	534.2	619.9	615.6	829.8	807.1	694.2	516.3	755.5	552.9	8,007.3
CIN	517.5	160.6	176.7	275.4	327.3	303.7	254.5	124.9	97.5	176.8	329.1	145.9	2,889.8
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	141.4	44.7	166.9	139.4	165.0	121.1	128.4	87.5	66.5	169.8	220.1	141.4	1,592.2
MEC	16.5	0.2	226.2	1.0	0.0	0.0	2.9	0.0	0.0	3.7	3.8	0.9	255.2
MECS	215.2	219.9	85.1	215.1	287.3	301.4	278.0	288.6	224.0	213.4	257.5	305.8	2,891.1
NIPS	25.9	3.9	0.9	133.6	267.8	180.9	2.1	53.3	93.8	80.7	0.3	11.2	854.4
WEC	0.0	0.0	2.4	0.1	0.2	0.0	0.2	0.1	0.1	0.0	0.0	0.2	3.3
NYISO	1,022.6	839.0	774.0	811.6	984.9	993.5	1,005.6	936.4	830.6	929.6	1,039.9	1,015.5	11,183.2
HUDES	0.0	0.0	0.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.2
LIND	23.3	5.3	5.9	1.7	82.6	25.9	46.9	18.1	18.1	33.5	41.5	12.0	315.0
NEPT	0.1	0.0	0.0	0.0	0.1	0.0	0.1	0.0	0.0	0.0	0.0	0.1	0.5
NYIS	999.1	833.6	767.9	809.9	902.2	967.5	958.7	918.3	812.5	896.1	998.3	1,003.3	10,867.5
OVEC	1,082.6	1,016.0	995.4	602.4	649.7	892.8	929.3	859.3	883.0	564.6	739.8	915.4	10,130.3
TVA	413.4	559.8	549.5	200.6	385.8	182.7	140.2	107.6	88.0	123.5	296.7	335.8	3,383.5
Total	5,081.8	4,160.5	4,200.9	3,193.9	4,143.4	4,106.3	4,009.3	3,632.9	3,341.4	3,237.6	4,077.0	4,140.2	47,325.3

Table E-34 Real-time scheduled gross export volume by interface (GWh): 2014

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPLE	61.4	17.0	17.6	29.4	33.4	44.3	38.4	21.0	32.3	30.0	21.0	26.8	372.6
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	60.3	32.0	21.8	93.3	126.5	233.8	302.0	263.0	198.3	167.3	198.3	185.3	1,881.8
LGEE	1.1	0.0	3.2	20.6	1.3	0.5	0.4	0.4	3.6	0.0	7.4	14.6	53.0
MISO	1,168.1	1,914.3	3,004.8	2,492.2	1,624.3	2,085.3	1,855.6	1,152.2	2,230.7	1,956.2	1,784.7	1,792.3	23,060.6
ALTE	195.9	251.2	771.0	517.1	362.9	412.7	365.1	200.3	502.9	432.4	420.5	413.6	4,845.6
ALTW	50.1	85.5	98.5	109.8	8.1	8.7	4.0	0.5	39.5	0.9	1.6	2.0	409.1
AMIL	49.8	149.6	168.5	138.1	53.3	39.1	38.8	42.9	26.7	16.5	29.7	28.4	781.3
CIN	198.6	502.1	526.7	539.3	359.9	288.4	245.0	108.2	230.0	245.1	187.8	202.4	3,633.5
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	54.1	110.0	169.2	125.9	157.8	343.2	203.6	80.8	125.2	193.5	137.7	163.7	1,864.6
MEC	438.3	387.1	466.0	358.3	409.2	472.0	476.4	474.6	529.5	483.6	469.4	485.0	5,449.4
MECS	57.1	245.3	649.7	602.2	147.0	342.5	309.4	154.5	587.6	481.0	439.4	397.0	4,412.7
NIPS	10.7	55.5	4.6	21.4	1.8	1.6	6.2	0.0	0.0	0.0	0.0	0.0	101.7
WEC	113.6	128.0	150.7	80.0	124.2	177.2	207.2	90.4	189.3	103.2	98.8	100.0	1,562.7
NYISO	2,144.3	2,196.7	2,508.4	1,737.2	1,032.1	1,431.8	1,673.0	1,515.8	1,285.9	1,356.2	1,408.3	1,934.9	20,224.4
HUDES	81.4	214.2	101.3	0.2	2.9	6.4	10.3	4.4	34.8	22.3	15.7	48.8	542.7
LIND	98.9	142.8	126.1	51.7	15.7	20.6	44.5	34.6	48.1	63.9	25.2	113.9	786.0
NEPT	310.1	433.0	399.0	444.6	262.1	377.6	435.4	471.9	317.1	350.5	391.3	383.4	4,576.0
NYIS	1,653.9	1,406.6	1,882.0	1,240.6	751.3	1,027.2	1,182.8	1,004.9	885.9	919.6	976.0	1,388.8	14,319.7
OVEC	27.1	25.5	23.0	17.7	18.1	16.9	17.4	17.5	16.7	16.7	21.7	24.2	242.6
TVA	63.6	7.6	4.0	10.3	17.0	29.6	37.5	65.4	38.9	10.7	56.2	11.7	352.5
Total	3,525.8	4,193.1	5,582.8	4,400.7	2,852.6	3,842.3	3,924.1	3,035.3	3,806.4	3,537.0	3,497.5	3,989.7	46,187.5

Table E-35 Day-ahead scheduled net interchange volume by interface (GWh): 2014

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	(30.1)	(15.5)	(13.9)	(20.2)	(25.2)	15.7	(22.4)	(12.5)	(24.9)	(17.8)	(10.2)	(11.0)	(188.0)
CPLW	0.0	0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.6
DUK	151.9	128.5	270.6	116.8	152.3	73.5	42.0	8.6	9.0	35.0	51.3	133.9	1,173.3
LGEE	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
MISO	(571.4)	(903.8)	(1,508.3)	(1,128.8)	(679.9)	(937.1)	(988.4)	(609.0)	(1,215.9)	(1,106.5)	(924.0)	(898.0)	(11,470.9)
ALTE	(96.1)	(148.5)	(516.3)	(439.3)	(263.1)	(315.0)	(311.1)	(167.5)	(396.2)	(363.2)	(349.6)	(372.7)	(3,738.7)
ALTW	(7.3)	(18.8)	(13.8)	(9.9)	0.0	0.0	(3.5)	0.0	(36.2)	0.0	0.0	0.0	(89.4)
AMIL	25.4	81.2	27.2	(17.0)	(7.5)	(20.0)	(16.7)	(1.3)	5.1	11.0	34.9	8.5	130.8
CIN	(31.5)	(209.0)	(221.1)	(179.5)	37.7	84.4	(23.5)	(5.7)	(46.4)	(26.3)	(2.8)	(58.6)	(682.3)
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	0.0	0.0	87.1	0.0	(28.3)	(21.2)	(7.2)	(1.2)	(4.9)	(68.8)	(9.9)	(14.4)	(68.8)
MEC	(433.6)	(375.5)	(438.5)	(230.5)	(402.9)	(460.0)	(475.6)	(473.5)	(466.9)	(481.4)	(469.5)	(485.1)	(5,193.0)
MECS	75.0	(113.1)	(360.3)	(180.8)	86.1	(51.9)	40.9	126.8	(82.5)	(71.8)	(31.0)	106.7	(455.9)
NIPS	0.0	(45.2)	0.0	(6.9)	0.0	0.0	(4.4)	0.0	0.0	0.0	0.0	0.0	(56.4)
WEC	(103.4)	(74.9)	(72.5)	(64.8)	(101.9)	(153.4)	(187.4)	(86.6)	(187.9)	(106.0)	(96.1)	(82.4)	(1,317.3)
NYISO	(1,140.8)	(1,230.9)	(1,482.8)	(988.0)	(285.5)	(594.6)	(834.2)	(667.4)	(534.3)	(636.5)	(641.9)	(1,047.3)	(10,084.1)
HUDD	(45.7)	(141.5)	(77.2)	0.0	(0.6)	(0.8)	(1.0)	0.0	(20.0)	(17.6)	(13.8)	(47.0)	(365.1)
LIND	(10.2)	(22.3)	(15.8)	(11.7)	5.4	5.5	(4.1)	(1.5)	(3.8)	(8.8)	0.8	(8.8)	(75.4)
NEPT	(280.3)	(437.6)	(430.2)	(445.9)	(260.4)	(378.2)	(434.5)	(467.5)	(317.9)	(373.9)	(396.9)	(390.5)	(4,613.8)
NYIS	(804.6)	(629.4)	(959.6)	(530.4)	(29.9)	(221.1)	(394.6)	(198.4)	(192.6)	(236.3)	(232.1)	(600.9)	(5,029.9)
OVEC	727.2	728.3	733.3	439.0	451.0	634.3	642.8	616.9	597.2	388.4	505.2	622.4	7,085.9
TVA	8.8	29.3	55.2	35.1	13.6	4.5	6.9	(16.7)	6.3	4.2	4.8	34.4	186.3
Total without Up-To Congestion	(854.4)	(1,263.4)	(1,945.9)	(1,546.1)	(373.7)	(803.7)	(1,153.3)	(680.0)	(1,162.7)	(1,333.2)	(1,014.9)	(1,165.6)	(13,296.8)
Up-To Congestion	(578.5)	(482.9)	143.1	(446.1)	(1,399.6)	598.5	423.1	(260.6)	267.6	250.4	69.8	406.6	(1,008.7)
Total	(1,433.0)	(1,746.3)	(1,802.8)	(1,992.1)	(1,773.3)	(205.2)	(730.2)	(940.6)	(895.2)	(1,082.8)	(945.1)	(759.0)	(14,305.5)

Table E-36 Day-ahead scheduled gross import volume by interface (GWh): 2014

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	0.0	0.0	0.0	3.2	0.0	40.9	0.0	0.0	0.0	0.0	0.0	0.0	44.1
CPLW	0.0	0.6	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.6
DUK	157.5	128.5	270.6	125.7	153.2	95.6	85.7	63.6	49.5	60.1	64.3	145.3	1,399.5
LGEE	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
MISO	152.3	127.1	150.7	219.8	283.2	247.9	146.2	203.2	289.4	135.7	191.3	201.4	2,348.3
ALTE	1.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	31.9	1.1	0.0	0.0	34.0
ALTW	0.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.3
AMIL	25.4	88.7	45.4	0.0	0.0	0.0	0.0	0.1	5.5	11.0	37.1	8.5	221.7
CIN	26.1	0.0	0.0	114.4	151.8	122.8	41.8	15.3	6.4	0.8	13.1	0.0	492.6
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	0.0	0.0	87.1	0.0	0.0	0.0	0.0	0.0	0.0	0.0	6.9	0.0	94.0
MEC	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.8	0.0	0.0	0.0	2.8
MECS	99.4	38.4	15.9	105.4	131.4	125.1	104.4	187.8	242.9	122.8	134.2	192.8	1,500.6
NIPS	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
WEC	0.0	0.0	2.3	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	2.3
NYISO	679.5	611.9	610.9	629.3	684.3	771.1	761.1	753.4	644.5	668.5	697.6	737.0	8,249.1
HUDD	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
LIND	3.6	2.6	3.5	1.1	11.0	15.7	8.3	5.1	6.5	0.3	2.3	0.6	60.5
NEPT	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
NYIS	675.9	609.4	607.4	628.2	673.3	755.4	752.8	748.3	638.0	668.2	695.3	736.4	8,188.6
OVEC	727.3	728.3	733.3	439.0	467.2	651.2	660.2	632.5	635.0	405.1	526.1	646.6	7,251.7
TVA	29.7	29.3	55.2	35.1	20.5	12.8	10.4	2.0	21.0	5.9	25.8	35.0	282.7
Total without Up-To Congestion	1,746.2	1,625.7	1,820.7	1,452.1	1,608.4	1,819.6	1,663.6	1,654.7	1,639.4	1,275.3	1,505.1	1,765.1	19,575.9
Up-To Congestion	3,054.9	3,127.2	3,778.6	3,384.6	3,397.8	3,948.4	3,877.9	3,194.9	1,603.4	851.5	908.9	1,133.1	32,261.1
Total	4,801.1	4,752.9	5,599.2	4,836.7	5,006.1	5,768.0	5,541.5	4,849.6	3,242.8	2,126.7	2,414.0	2,898.3	51,836.9

Table E-37 Day-ahead scheduled gross export volume by interface (GWh): 2014

Interface	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Total
CPL	30.1	15.5	13.9	23.4	25.2	25.2	22.4	12.5	24.9	17.8	10.2	11.0	232.0
CPLW	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
DUK	5.6	0.0	0.0	8.8	0.9	22.1	43.8	55.0	40.5	25.0	13.0	11.4	226.2
LGEE	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
MISO	723.7	1,030.8	1,659.0	1,348.6	963.0	1,185.0	1,134.6	812.2	1,505.3	1,242.2	1,115.3	1,099.3	13,819.2
ALTE	97.2	148.5	516.3	439.3	263.1	315.0	311.1	167.5	428.1	364.3	349.6	372.7	3,772.7
ALTW	7.6	18.8	13.8	9.9	0.0	0.0	3.5	0.0	36.2	0.0	0.0	0.0	89.7
AMIL	0.0	7.5	18.3	17.0	7.5	20.0	16.7	1.4	0.3	0.0	2.3	0.0	90.9
CIN	57.6	209.0	221.1	293.9	114.1	38.4	65.3	21.0	52.8	27.1	15.9	58.6	1,174.9
CWLP	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
IPL	0.0	0.0	0.0	0.0	28.3	21.2	7.2	1.2	4.9	68.8	16.8	14.4	162.8
MEC	433.6	375.5	438.5	230.5	402.9	460.0	475.6	473.5	469.7	481.4	469.5	485.1	5,195.7
MECS	24.4	151.5	376.2	286.2	45.3	177.0	63.6	61.0	325.4	194.6	165.2	86.1	1,956.4
NIPS	0.0	45.2	0.0	6.9	0.0	0.0	4.4	0.0	0.0	0.0	0.0	0.0	56.4
WEC	103.4	74.9	74.8	64.8	101.9	153.4	187.4	86.6	187.9	106.0	96.1	82.4	1,319.6
NYISO	1,820.3	1,842.8	2,093.7	1,617.3	969.7	1,365.7	1,595.3	1,420.8	1,178.8	1,305.0	1,339.5	1,784.2	18,333.2
HUDS	45.7	141.5	77.2	0.0	0.6	0.8	1.0	0.0	20.0	17.6	13.8	47.0	365.1
LIND	13.8	24.9	19.3	12.9	5.6	10.2	12.5	6.6	10.3	9.0	1.5	9.4	135.9
NEPT	280.3	437.6	430.2	445.9	260.4	378.2	434.5	467.5	317.9	373.9	396.9	390.5	4,613.8
NYIS	1,480.5	1,238.8	1,567.0	1,158.6	703.2	976.6	1,147.3	946.7	830.6	904.5	927.4	1,337.3	13,218.4
OVEC	0.1	0.0	0.0	0.0	16.2	16.9	17.4	15.6	37.9	16.7	20.9	24.1	165.8
TVA	20.9	0.0	0.0	0.0	6.9	8.4	3.5	18.6	14.7	1.7	21.0	0.6	96.3
Total without Up-To Congestion	2,600.6	2,889.1	3,766.6	2,998.2	1,982.1	2,623.3	2,816.9	2,334.7	2,802.1	2,608.4	2,520.0	2,930.7	32,872.7
Up-To Congestion	3,633.4	3,610.2	3,635.5	3,830.6	4,797.4	3,349.9	3,454.7	3,455.5	1,335.8	601.1	839.1	726.6	33,269.7
Total	6,234.0	6,499.3	7,402.0	6,828.8	6,779.4	5,973.2	6,271.7	5,790.2	4,137.9	3,209.5	3,359.1	3,657.3	66,142.5

Appendix F Ancillary Service Markets

This appendix covers five areas related to Ancillary Service Markets: area control error, Control Performance Standard 1 and Balancing Authority ACE Limit, Disturbance Control Standard (DCS), Regulation Market design changes, and the Synchronized Reserve Market clearing process.

Area Control Error (ACE)

Area control error (ACE) is a real-time measure of the instantaneous MW imbalance between load plus net interchange and generation within PJM.¹ PJM dispatchers seek to ensure grid reliability by balancing ACE. The metrics for success in balancing ACE are control performance standard 1 (CPS1) and balancing authority ACE limit (BAAL) performance. These measurements are mandated by the North American Electric Reliability Council (NERC).²

In the absence of a severe grid disturbance, the primary tool used by dispatchers to control ACE is regulation. Regulation is defined as a variable amount of energy under automatic control which is independent of economic cost signal and is obtainable within five minutes. Regulation contributes to maintaining the balance between load and generation by moving the output of selected generators up and down via an automatic generation control (AGC) signal.³

Control Performance Standard 1 (CPS1) and Balancing Authority ACE Limit (BAAL)

Control Performance Standard 1 (CPS1) and Balancing Authority ACE Limit (BAAL) are the NERC metrics for the effectiveness of ACE control. The goal of ACE control is to maintain power balance and interconnection frequency within predefined MW and frequency profiles under

all conditions (normal and abnormal). CPS1/BAAL are performance standards used to measure and report how well PJM accomplishes ACE and frequency balance. CPS1 is defined according to NERC Standard BAL-001-0.1a.⁴ BAAL is defined according to BAL-001-2.⁵ Frequency (as it applies to the electric power grid) is the rate at which alternating current cycles between minimum and maximum. Usually this is 60 Hz (one Hz is one cycle per second). PJM measures the instantaneous frequency every two seconds. Frequency changes when there is an imbalance between generation and load causing a mismatch between actual and scheduled tie-line flow. PJM dispatchers seek to minimize this deviation. If the mismatch persists, a time error can accumulate.

CPS1 is a statistical measure of ACE variability and its relationship to frequency error. It is measured each minute and averaged over a year. CPS1 is defined as “the average of the clock-minute averages of a Balancing Area’s ACE divided by minus 10 B (where B is Balancing Area frequency bias) times the corresponding clock-minute averages of the Interconnection’s frequency error. CPS1 must be less than a specific limit. This limit, ‘ε’, is a constant derived from a targeted frequency bound (limit) that is reviewed and set, as necessary, by NERC.”⁶

Frequency bias is a physical attribute of a control area. It is defined as the natural response in MW of that control area (at estimated yearly peak demand) to a change in frequency of 0.1Hz.⁷ NERC requires each balancing authority to review and report its frequency bias by January 1 each year.

NERC Standard BAL-001-0.1a requires PJM “[t]o maintain Interconnection steady-state frequency within defined limits by balancing real power demand and supply in real-time.”⁸ Meeting the CPS1 standard requires PJM dispatchers to maintain ACE within a fixed range around zero. The defined fixed range for the 2016 operating year (+/-258.31 MW/0.1Hz) is called

1 The PJM Manuals define ACE and the methodology for calculating it: “Area Control Error is a measure of the imbalance between sources of power and uses of power within the PJM RTO. This imbalance is calculated indirectly as the difference between scheduled and actual net interchange, plus the frequency bias contribution to yield ACE in megawatts. Two additional terms may be included in ACE under certain conditions—the time error bias term and PJM dispatcher adjustment term (manual add). These provide for automatic inadvertent interchange payback and error compensation, respectively.” “PJM Manual 12: Balancing Operations,” Revision 30 (December 1, 2013), para. 3.1.1, “PJM Area Control Error,” p. 12.

2 NERC standard BAL-001-0.1a “Real Power Balancing Control Performance,” <<http://www.nerc.com/pa/stand/reliability%20standards%20complete%20set/rscompleteset.pdf>>.

3 See PJM. “Manual 11: Energy & Ancillary Services Market Operations,” Revision 80 (March 31, 2016), pp. 51.

4 NERC Standard BAL-001-0.1a Real Power Balancing Control Performance <<http://www.nerc.com/pa/Stand/Reliability%20Standards/BAL-001-1.pdf>>

5 BAL-001-2 – Real Power Balancing Control Performance Standard Background Document, Feb 2013 <http://www.nerc.com/pa/Stand/Project%202010141%20%20Phase%201%20of%20Balancing%20Authority%20Re/BAL-001-2_Background_Document_Clean-20130301.pdf>

6 See PJM. “Manual 12: Balancing Operations,” Revision 33 (December 1, 2015), Section 3, “NERC Control Performance Standard” pg. 15.

7 See Frequency Response and Bias Standard BAL-003-0.1a <http://www.nerc.com/files/BAL-003-0_1a.pdf>.

8 See PJM. “Manual 12: Balancing Operations,” Revision 33 (December 1, 2015), Section 3, “NERC Control Performance Standard” pg. 12.

L_{10} . Compliance with the CPS1 standard requires that 90 percent of 10-minute periods have an average ACE value within the L_{10} range. The L_{10} was last changed on December 1, 2015. Previously it had been +/-297.8 MW/0.1Hz.

CPS1 is calculated as $CPS1 = (2-CF)*100\%$. It can be seen from this equation that if the yearly one-minute average deviations (CF) were zero the CPS1 score would be a perfect 200 percent. The frequency related compliance factor (CF) is a ratio of the accumulating clock-minute compliance parameters for the most recent twelve consecutive calendar months, divided by the square of the target frequency bound ($\epsilon 1_i$). The $\epsilon 1_i$ value for the Eastern Interconnection is 0.018 Hz.

CPS1 is intended to provide a frequency-sensitive evaluation of how well PJM meets its demand requirements with its supply resources. The maximum CPS1 score is 200 percent. This is achieved when either the frequency error is zero or the ACE is zero. The minimum passing score is 100 percent monthly.

Since August 1, 2006, PJM has participated in the NERC Standard Proof-Of-Concept Field Test for establishing a new metric, Balancing Authority ACE Limit (BAAL), which is intended to replace the old CPS2. BAAL is a measure of the relationship between frequency and ACE such that both must remain within the blue area in Figure F-2. The $BAAL_{High}$ and $BAAL_{Low}$ limits are curves which are functions of measured frequency and scheduled frequency.

PJM counts the total number of minutes that ACE complies with the BAAL limits (high and low) and divides it by the total number of minutes for a month, with a passing level for this goal being set at 99.0 percent for each month. BAAL high and low limits are defined dynamically.⁹

When actual frequency is less than Scheduled Frequency, $BAAL_{High}$ does not apply, and $BAAL_{Low}$ is calculated as:

$$BAAL_{Low} = (-10B_i \times (FTL_{Low} - F_s)) \times \frac{(FTL_{Low} - F_s)}{(F_A - F_s)}$$


When actual frequency is greater than Scheduled Frequency, $BAAL_{Low}$ does not apply and the $BAAL_{High}$ is calculated as:

$$BAAL_{High} = (-10B_i \times (FTL_{High} - F_s)) \times \frac{(FTL_{High} - F_s)}{(F_A - F_s)}$$

$BAAL_{Low}$ is the Low Balancing Authority ACE Limit (MW), $BAAL_{High}$ is the High Balancing Authority ACE Limit (MW), 10 is a constant to convert the Frequency Bias Setting from MW/0.1 Hz to MW/Hz, B_i is the Frequency Bias Setting for a Balancing Authority (expressed as MW/0.1 Hz), F_A is the measured frequency in Hz, F_s is the scheduled frequency in Hz, FTL_{Low} is the Low Frequency Trigger Limit (calculated as $F_s - 3\epsilon 1_i$ Hz), and FTL_{High} is the High Frequency Trigger Limit (calculated as $F_s + 3\epsilon 1_i$ Hz). The constant $\epsilon 1_i$ is the derived from a targeted frequency bound for each Interconnection as follows: Eastern Interconnection $\epsilon 1_i$ is 0.018 Hz, Western Interconnection $\epsilon 1_i$ is 0.0228 Hz, ERCOT Interconnection $\epsilon 1_i$ is 0.030 Hz, and Quebec Interconnection $\epsilon 1_i$ is 0.021 Hz.

Figure F-1 shows the relationship of measured frequency to allowable ACE deviation when measured frequency is less than scheduled frequency (defined by the $BAAL_{Low}$ equation, scheduled frequency = 60 Hz and negative ACE only). As the measured frequency approaches the scheduled frequency (60 Hz), the allowable ACE increases in absolute value.

Figure F-1 Allowable ACE as a function of measured frequency

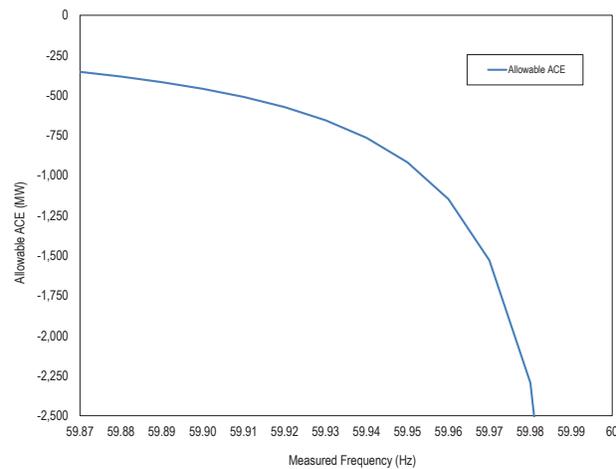

9 NERC BAL-001-2, Real Power Balancing Control Performance. Feb. 2013.

As an example consider a single 2-second measurement under the following scenario. The frequency bias is -1,574 MW/0.1Hz (as it is in the Eastern Interconnection), the frequency profile is calling for a scheduled frequency of 60Hz (this is normal but can be changed by PJM dispatch under certain circumstances), and the measured real-time frequency is 59.92. Under this scenario, applying the formula for $BAAL_{Low}$ shows that ACE needs to be greater than -573.723 MW in order for this one measurement to be within acceptable BAAL limits. A complete scenario is provided by adding the ACE deviation for measured frequency greater than scheduled frequency $BAAL_{High}$ (Figure F-2).


Figure F-2 Example set of BAAL measurements: Set of measurements is every two seconds for four minutes



PJM's CPS/BAAL Performance

Figure F-3 shows PJM's CPS1 and BAAL performance from January 2011 through March 2016, with the dashed vertical line marking the date (October 1, 2012) of the implementation of the performance based regulation market design. While PJM did not meet its internal goal for BAAL performance in January 2014, PJM remained in compliance with the applicable NERC standards throughout 2014. Since January 2014, PJM has remained within its internal goal and the NERC standard for compliance for both CPS1 and BAAL metrics.

Figure F-3 PJM CPS1/BAAL performance: 2011 through 2015

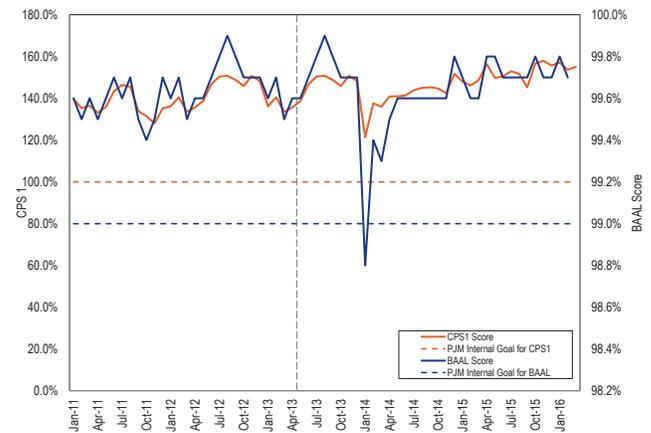

PJM's DCS Performance

The NERC disturbance control standard (DCS) measures how well ACE recovers from a disturbance.¹⁰ A disturbance is defined by NERC as any ACE deviation caused by sudden loss of generation greater than, or equal to, 80 percent of PJM's most severe single contingency loss. Disturbance control is measured and must be reported to NERC quarterly as percentage of recovery (R_i) as defined below.

If ACE was positive or zero just before the disturbance then ACE must be returned to zero within fifteen minutes. Full disturbance recovery within fifteen minutes represents 100 percent performance under this measure. Less than full recovery in fifteen minutes earns a score defined as:

$$R_i = \left(\frac{MW_{loss} - \max(0, ACE_a - ACE_m)}{MW_{loss}} \right) * 100\%$$

If ACE was negative just before the disturbance then ACE must be returned to its pre-disturbance value. Full disturbance recovery within fifteen minutes represents 100 percent performance under this measure. Less than full recovery in fifteen minutes earns a score as per:

$$R_i = \left(\frac{MW_{loss} - \max(0, -ACE_m)}{MW_{loss}} \right) * 100\%$$

¹⁰ For more information on the NERC DCS, see "Standard BAL-002-0 – Disturbance Control Performance" (4/1/2012) <www.nerc.com/files/BAL-002-0.pdf>.


Where MW_{loss} is the MW size of the disturbance from the beginning of the loss, ACE_a is the pre-disturbance ACE, ACE_m is the maximum algebraic value of the ACE measured within fifteen minutes following the disturbance.

PJM experienced 14 DCS events in 2015 (Table F-1). PJM compliance has remained at 100% since 2012. (Figure F-4)

Table F-1 DCS Events, cause, and duration: January 2015 – May 2016

Start Date and Time	Resource	ACE Recovery Duration (MM:SS)
FEB-23-2015 21:40	Loss of Limerick 1 (1197 MW)	11:40
FEB-28-2015 07:31	Loss of Gavin 1 (1330 MW)	7:36
MAR-03-2015 12:01	Loss of Byron 1 (1190 MW)	6:36
APR-02-2015 04:25	Loss of North Anna 1 (1023MW)	4:56
APR-07-2015 12:39	Loss of Calvert Cliffs 1 & 2 (1753 MW) & Panda (205 MW)	6:44
APR-24-2015 23:19	Loss of Gavin 2 (1172 MW)	7:28
JUN-06-2015 16:36	Loss of Stuart 1-4 (1354 MW)	6:48
JUL-30-2015 10:01	Loss of Gavin 2 (1306 MW)	7:48
AUG-05-2015 15:38	Loss of Salem 2 (1198 MW)	5:40
SEP-04-2015 21:07	Loss of Gavin 2 (1397 MW)	7:08
SEP-28-2015 20:46	Loss of Hope Creek 1 (1239 MW)	4:56
NOV-12-2015 11:32	Loss of Susquehanna 1 (1280 MW)	7:00
NOV-21-2015 12:08	Loss of Gavin 2 (1147 MW)	7:08
DEC-15-2015 20:27	Loss of Keystone 1 (839 MW) & Bath County 5 (344 MW)	3:00
<hr/>		
FEB-08-2016 15:04	Loss of Perry 1 (1157 MW)	8:08
FEB-14-2016 20:59	Loss of Salem 2 (1238 MW)	4:48
APR-14-2016 20:05	Loss of Amos 3 (1104 MW)	6:32

Figure F-4 DCS event count and PJM performance (By month): 2012-2016

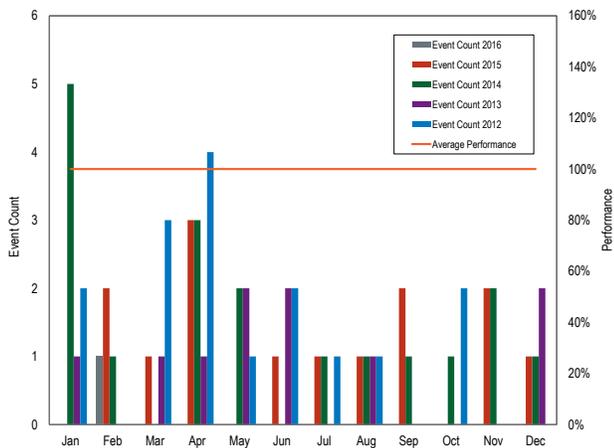

Although PJM recovered from all DCS events by declaring a synchronized reserve event, not all synchronized reserve events are caused by DCS events. DCS events are “sudden unanticipated losses of supply-side resources.”¹¹ Several significant synchronized reserve events in 2013 and 2014, most notably the 68 minute event of September 10, 2013, the 33 minute event of October 28, 2013, and the 34 minute event of January 7, 2014 were caused by low ACE and were therefore not reportable as DCS events. The event of February 28, 2016 was caused by low ACE. In all there have been 16 spinning events between January 2013 and March 2016 caused by “Low ACE.”¹²

Regulation Market Design Changes

On October 20, 2011, FERC issued Order No. 755 directing PJM and other RTOs/ISOs to modify their regulation market rules to include fast as well as traditional slow response regulation resources.¹³

A rationale for the new market design was the assumption that new, fast response technologies could be used, in combination with slow resources, to reduce the total amount of resources needed to meet regulation requirements and thereby reduce the cost of regulation. Order No. 755 required that the fast and slow resources be purchased in a single market, with compensation for both capacity (MW) and miles (ΔMW).¹⁴ Regulation miles are calculated as the sum of the absolute value of a given regulation resource’s movement (up and down) in response to a regulation signal.

To incorporate the new fast regulation, PJM developed a fast regulation signal (RegD) that responds faster

11 Standard BAL-002-0 – Disturbance Control Performance,” (April 1, 2005) <www.nerc.com/files/BAL-002-0.pdf> (61 KB) para. 1.4, page 4.

12 Energy Reserve Pricing & Interchange Volatility Meeting, Oct 3, 2014 Updated – PJM ERPIV Presentation <<http://wired.pjm.com/~media/committees-groups/committees/mic/20141003-energy/20141003-updated-erpiv-presentation.ashx>>

13 Order No. 755 at P 3. FERC ordered PJM “to compensate frequency regulation resources based on the actual service provided, including a capacity payment that includes the marginal unit’s opportunity costs and a payment for performance that reflects the quantity of frequency regulation service provided by a resource when the resource is accurately following the dispatch signal.”

14 Id. at PP 99, 131 & 177.

to changes in ACE in addition to the traditional slow regulation signal (RegA). Resources are free to choose which signal they will follow. A study by KEMA for PJM indicated that including a combination of RegA and RegD following resources in the Regulation Market would allow PJM to reduce its regulation requirement but still maintain CPS1 scores close to the historical average (significantly above the passing score of 100 percent).¹⁵

According to the study, the smaller the proportion of fast regulation MW and the greater the proportion of slow regulation used, the greater the benefit to adding one more MW of fast regulation. The smaller the proportion of fast regulation used, the more slow regulation each MW of fast regulation can replace. Conversely, as the proportion of fast regulation increases, there is a decrease in the benefit of substituting fast capability for slow capability. This rate of substitution between fast and slow resources is the marginal benefit factor or MBF. The marginal benefit factor measures the equivalent MW of slow regulation that can be displaced by one MW of fast regulation. If one MW of fast regulation can replace two MW of slow regulation while maintaining the same overall regulation performance, the marginal benefit factor is 2.0. The marginal benefit factor decreases as the amount of fast resources increases. Eventually, the addition of another MW of fast capability results in a decreasing MBF to 1.0, to less than 1.0 and to less than zero which means that adding another MW of fast regulation requires the addition of slow regulation in order to maintain a regulation performance target. At this point the rate of substitution is negative and the addition of fast resources makes it harder to maintain a regulation performance target.¹⁶ In other words, it is possible for PJM to achieve a passing CPS1 score (100 percent) entirely with slow regulation resources as PJM has done since its inception, but PJM cannot achieve a passing CPS1 score using only fast regulation resources.

PJM monitors compliance using the current regulation signals CRegA and CRegD. The CRegA signal tracks compliance with the RegA signal and the CRegD signal tracks compliance with the RegD signal. The current

regulation signals CRegA and CRegD are calculated every two seconds as the sum of the response of a regulation resource (an individual resource, a fleet of resources, or the entire set of RegA or RegD resources). The current regulation signals CRegA and CRegD are a measure of real time regulation feedback sent to PJM to determine if and to what degree the regulation signals RegA and RegD are being followed.¹⁷ Figure F-5 shows a screenshot of a typical 10-minute time period of PJM's RegA signal and CRegA signal for all RegA resources. Figure F-6 shows a screenshot of typical 10-minute time period of PJM's RegD signal and CRegD signal for all RegD resources.

Figure F-5 PJM RegA signal and CReg compliance signal. Example of typical 10-minute time period


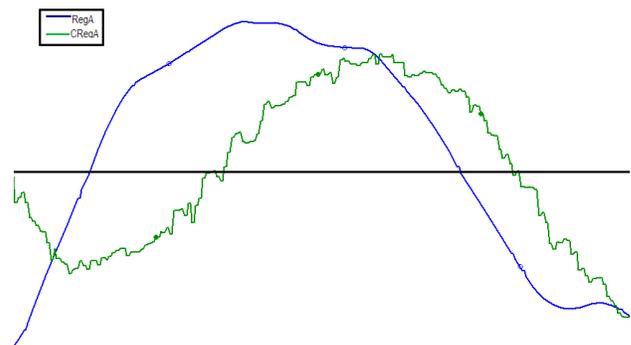


Figure F-6 PJM RegD signal and CRegD compliance signal. Example of typical 10-minute time period

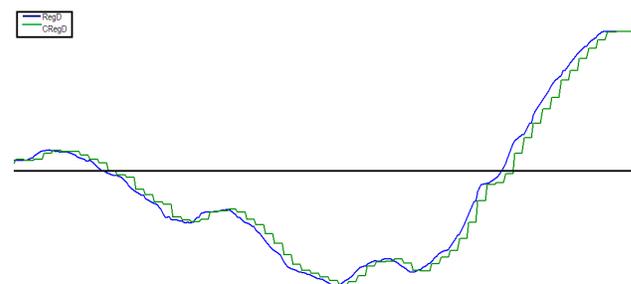

Regulation signals are designed for the purpose of moderating ACE, accounting for the characteristics of the expected response from the resources following the signal. The RegD signal is designed to contribute to the moderation of ACE given the attributes of fast regulation resources. The RegA signal is designed to contribute to

¹⁵ See KEMA. "KERMIT Study Report," (December 13, 2011).

¹⁶ PJM calculates a marginal benefit factor using a function that is arbitrarily defined to have zero as its lower bound. The practical impact of this incorrect functional form is likely to be negligible in the near term because substantially more RegD resources would have to be added to result in a negative marginal benefit factor but the function should be corrected. See PJM. "Manual 11: Energy & Ancillary Services Markets Operations," Revision 80 (March 31, 2016), p. 62.

¹⁷ See PJM. "Manual 12: Balancing Operations," Revision 33 (December 1, 2015), p. 43.

the moderation of ACE given the attributes of traditional sources of regulation. Even a very fast regulating unit will need to have some capability to provide sustained MWh to help with ACE correction, and even a unit with a large MW capability must be able to react with some speed to help with ACE correction. The relationship between the two types of regulating resources is under constant review and the relationship between the two (the marginal benefit factor) is subject to change.

- Regulation Offers.** All owners of generating and demand resources qualified to provide regulation may offer their regulation capability price in \$/MWh at cost plus up to \$12 adder daily into the Regulation Market using the PJM market user interface. There is no must offer requirement for resources qualified to provide regulation. Users must also enter the signal type they want to follow (RegA or RegD), their regulation capability in MW, as well as cost validation parameters including fuel cost, heat rate at economic maximum, heat rate at regulation minimum, and the VOM rate. Regulating units may also self-schedule. Self-scheduled units have zero lost opportunity cost (LOC) and are the first to be assigned. Owners may also enter price based offers up to a maximum of \$100/MW. Demand resources are eligible to offer regulation and did so for the first time in November 2011. Demand resources have an LOC of zero. Under current PJM rules, no more than 25 percent of the total regulation requirement may be supplied by demand resources.¹⁸ Total regulation offers are the sum of all regulation capable units that offer regulation into the market for the day and that are not out of service or fully committed to provide energy. Owners of units that have entered offers into the PJM market user interface system have the ability to set unit status to “unavailable” for regulation for the day, or for a specific hour or set of hours. They also have the ability to change the amount of regulation MW offered in each hour. Unit owners do not have the ability to change their regulation offer price during a day. All regulation offers that are not set to unavailable for the day are summed to calculate the total daily regulation offered, a figure that changes each hour.

- Regulation Offered and Eligible.** Sixty minutes before the market hour, PJM runs the Ancillary Services Optimizer software (ASO) to determine the amount of Tier 2 synchronized reserve/non-synchronized reserve required, develop regulation and synchronized reserve supply curves, and assign regulation, synchronized reserve, and non-synchronized reserve to specific units. All regulation resource units which have made offers in the daily Regulation Market are evaluated by ASO for regulation. ASO excludes units according to the following ordered criteria: daily or hourly unavailable status; units for which the economic minimum is set equal to economic maximum (unless the unit is a hydroelectric unit or has self-scheduled regulation); units assigned synchronized reserve; units for which regulation minimum is set equal to regulation maximum (unless the unit is a hydroelectric unit or has self-scheduled regulation); units that are offline (except combustion turbine units).¹⁹
- Regulation Market Clearing and Dispatch.** The Regulation Market is cleared by the ASO sixty minutes before the operational hour. The specific units scheduled to regulate are selected at that time based on the lowest price set of units sufficient to fill the regulation requirement. The actual unit dispatch happens at the start of the operational hour and is under the control of unit operators. PJM rules permit generation owners to substitute other units in their fleet for the actual units that cleared the market. The final Regulation Market Clearing Price used to settle the regulation market is based on the costs and LMPs of the units that are actually dispatched. Differences between market clearing and market dispatch can cause unnecessary uplift payments or a final price paid to all units based on a less than optimal set of dispatched regulating units.

Even after ASO has run and selected units for regulation, PJM dispatchers can dispatch units uneconomically to provide regulation for several reasons including: to control transmission constraints; to avoid over-generation during periods of minimum generation alert;

¹⁸ See PJM, “Manual 11: Energy & Ancillary Services Markets Operations,” Revision 80 (March 31, 2016), p. 55.

¹⁹ See PJM, “Manual 11: Energy & Ancillary Services Markets Operations,” Revision 80 (March 31, 2016), pp. 31.

to remove a unit temporarily unable to regulate; or to remove a unit with a malfunctioning data link.²⁰

For each offered and eligible unit in the regulation supply, the regulation total capability offer price is calculated using the sum of the unit's regulation cost-based offer (divided by the marginal benefit factor of the resource type and the historic performance score of the resource) plus the opportunity cost based on the forecast LMP, unit economic minimum and economic maximum, regulation minimum and regulation maximum, startup costs and relevant offer schedule. Based on this result, ASO determines if the period has three or fewer pivotal suppliers. If it does, all owners who are pivotal have their offers limited to the lesser of their cost or price offer. ASO uses price-based offers for those operators not offer capped and re-solves. Unit assignments based on this solution are final. The final clearing price is not determined at the time of unit assignment.

The Regulation, Synchronized Reserve, and Non-Synchronized Reserve Markets are cleared, prior to the hour, and supplementally within the hour, on a real-time basis. The Regulation, Synchronized Reserve, and Non-Synchronized Reserve Markets are cleared and priced interactively with the energy market and secondary reserve requirements to minimize the cost of the combined products subject to reactive limits, resource constraints, unscheduled power flows, inter area transfer limits, resource distribution factors, self-scheduled resources, limited fuel resources, bilateral transactions, hydrological constraints, generation requirements, reserve requirements and prior to the hour assignments for regulation and reserves.²¹ The final clearing prices are calculated at five-minute intervals based on the real-time prices and LMPs of energy. These five-minute prices are averaged to arrive at the final hourly clearing price. This price is sent to Settlements and used as the basis for credits and charges.

- **Cleared Regulation.** Regulation actually assigned by ASO is cleared regulation. The capability and performance prices are calculated every five minutes by the Locational Pricing Calculator (LPC) with the final hourly clearing price averaged from the five minute prices. In real time, resources that have been

assigned an ancillary service are expected to provide that ancillary service for the designated hour.

- **Settled Regulation.** Owners of regulation resources are compensated by RMCP (Regulation Market Clearing Price) credits and opportunity cost credits. RMCP credits are the sum of RMCCP (Regulation Market Capability Clearing Price) credits and RMPCP (Regulation Market Performance Clearing Price) credits. RMCCP credits are calculated as MW of regulation capability times the performance score times RMCCP. For RegA resources, RMPCP credits are calculated as MW of regulation capability times performance score times RMPCP. For RegD resources, RMPCP credits are calculated as MW of regulation capability times performance score times RegD to RegA mileage ratio times RMPCP. When calculating RMCCP and RMPCP credits, the MW of regulation capability are defined as the actual MW provided (as opposed to cleared MW or effective MW). The owner of a regulation resource receives opportunity cost credits only if its RMCP credits are less than its offer plus opportunity cost (including lost opportunity cost during shoulder hours). The cost per actual MW of settled regulation can be higher than the regulation clearing price because actual MW and cleared MW may differ and RMCP credits may not completely cover lost opportunity costs.

Synchronized Reserve Market Clearing

PJM's market clearing engines consider resources capable of providing Tier 2 synchronized reserve to be either flexible or inflexible. CTs operating below their economically desired MW will sometimes be dispatched flexibly intra hour. Hydro resources are often a source of flexible Tier 2. Inflexible units are scheduled by the hourly market solution sixty minutes before the operating hour, are committed to provide synchronized reserve for the entire hour, and are paid the higher of the SRMCP or their offer price plus LOC (demand response resources are paid SRMCP). Demand response resources are defined to be inflexible. Flexible units are identified and may be scheduled every time the market solution runs (hour ahead, intermediate term, and short term) and can be assigned to either synchronized reserve or to energy depending on the economic solution. This

²⁰ See PJM, "Manual 11: Energy & Ancillary Services Markets Operations," Revision 80 (March 31, 2016), pp. 38-40.

²¹ See PJM, "Manual 11: Energy & Ancillary Services Markets Operations," Revision 80 (March 31, 2016), pp. 90.

flexibility allows for a less expensive hourly cost when intrahour events such as constraints binding, changes in imports or exports and performance problems occur.

In the Mid-Atlantic Dominion Subzone, the market for Tier 2 synchronized reserve is cleared in four steps.

One hour before the market hour, ASO estimates the sum of the available Tier 1 synchronized reserve within the MAD Subzone and the available transfer capacity from outside the MAD Subzone. ASO subtracts this estimated sum from the MAD Subzone synchronized reserve requirement to determine the amount of MAD Tier 2 synchronized reserve needed to satisfy the requirement. If the synchronized reserve requirement is not filled from available Tier 1 and imports then self-scheduled Tier 2 synchronized reserve is assigned. If the required synchronized reserve is still not satisfied, ASO clears a market for inflexible synchronized reserve. Tier 2 synchronized reserve flexible resources can be changed throughout the hour by both the intermediate term and short term market clearing software.

Half an hour before the market hour, the intermediate term solution (IT SCED) performs the same functions as ASO up to the point of logging and committing individual resources, taking into account the amount of inflexible resources already committed by ASO. After IT SCED produces its solution, a PJM operator reviews the solution, calls the inflexible resources to commit them to provide Tier 2 synchronized reserve, and logs each resource separately. As with ASO, the amount of Tier 2 synchronized reserve provided by flexible resources is not logged and is not carried through to later steps in the clearing process.

Fifteen minutes before each 5-minute period in the market hour, real-time solution (RT SCED) estimates the amount of needed Tier 2 synchronized reserve, taking into account the amount of inflexible resources already committed by ASO and IT SCED. RT SCED considers only flexible resources due to the notification-time requirements of inflexible resources. Once RT SCED generates its solution, RT SCED commits the resources from its solution and logs these resources.

Every 5 minutes within the market hour, LPC calculates market clearing prices by incorporating resource offers and LOC based on real-time LMP and the cost

of the marginal unit. LPC computes the price of Tier 2 synchronized based on these factors and the committed resources and uses this price as the within-hour five-minute clearing price. For the hour, the Synchronized Reserve Market Clearing Price is the simple average of the twelve 5-minute clearing prices. When there is a simultaneous shortage of primary reserve and synchronized reserves the real-time prices for synchronized reserve will be the sum of the primary reserve and synchronized reserve penalty factors.²²

Whereas the hourly price is the average of the five-minute prices within the hour, the hourly cost (per MW) is the sum of credits for cleared and self-scheduled synchronized reserve and credits for after market lost opportunity cost divided by the total MW of synchronized reserve cleared and self-scheduled. PJM guarantees resources to be made whole to their offer plus opportunity costs.

²² See PJM. "Manual 11: Energy & Ancillary Services Market Operations," Revision 80 (March 31, 2016), p. 79.

Appendix G Congestion and Marginal Losses

The locational marginal price (LMP) is the incremental price of energy at a bus. The LMP at a bus is made up of three components: the system marginal price or energy component (SMP), the marginal loss component of LMP (MLMP), and the congestion component of LMP (CLMP).¹

SMP, MLMP and CLMP are products of the least cost, security constrained dispatch of system resources to meet system load.² SMP is the incremental cost of energy, given the current dispatch and given the choice of reference bus, or LMP net of losses and congestion. Losses refer to energy lost to physical resistance in the transmission network as power is moved from generation to load. Total losses refer to the total system-wide transmission losses as a result of moving power from injections to withdrawals on the system. Total system-wide transmission losses for 2015 were 16,214 GWh, a 5.3 percent decrease compared to 2014. Marginal losses are the incremental change in system losses caused by changes in load and generation. Congestion occurs when available, least-cost energy cannot be delivered to all load because transmission facilities are not adequate to deliver that energy and higher cost units in the constrained area must be dispatched to meet that load.³ The result is that the price of energy in the constrained area is higher than in the unconstrained area.

Congestion is neither good nor bad, but is a direct measure of the extent to which there are multiple marginal generating units dispatched to serve load as a result of transmission constraints.

The energy, marginal losses and congestion metrics must be interpreted carefully. The term total congestion refers to what is actually net congestion, which is calculated as

net implicit congestion costs plus net explicit congestion costs plus net inadvertent congestion charges. The net implicit congestion costs are the load congestion payments less generation congestion credits. This section refers to total energy costs and total marginal loss costs in the same way. As with congestion, total energy costs are more precisely termed net energy costs and total marginal loss costs are more precisely termed net marginal loss costs.

The components of LMP are the basis for calculating participant and location specific congestion and marginal losses.⁴

Congestion Costs Zonal Congestion Costs

Day-ahead and balancing congestion costs by zone for 2015 and 2014 are presented in Table G-1 and Table G-2.⁵ While total congestion costs represent the overall charge or credit to a zone, the components of congestion costs measure the extent to which load or generation bear congestion costs. Load congestion payments, when positive, measure the congestion cost to load in an area. Load congestion payments, when negative, measure the congestion credit to load in an area. Negative load congestion payments result when load is on the lower priced side of a constraint or constraints. For example, congestion across the AP South Interface means lower prices in western control zones and higher prices in eastern and southern control zones. Load in western control zones will benefit from lower prices and receive a congestion credit (negative load congestion payment). Load in the eastern and southern control zones will incur a congestion charge (positive load congestion payment). The reverse is true for generation congestion credits. Generation congestion credits, when positive, measure the congestion credit to generation in an area. Generation congestion credits, when negative, measure the congestion cost to generation in an area. Negative generation congestion credits result when generation is on the lower priced side of a constraint or constraints. For example, congestion across the AP South interface

¹ On January 1, 2012, PJM integrated the Duke Energy Ohio/Kentucky (DEOK) Control Zone. On June 1, 2013, PJM integrated the East Kentucky Power Cooperative (EKPC) Control Zone. The metrics reported in this section treat DEOK as part of MISO for the first hour of January 2012 and as part of PJM for the second hour of January through December 2012. The metrics reported in this section treat EKPC as part of MISO for the first hour of June 2013 and as part of PJM for the second hour of June through June 2013.

² For more information about LMP see the Technical Reference for PJM Markets, "Calculating Locational Marginal Price," <http://www.monitoringanalytics.com/reports/Technical_References/references.shtml>.

³ This is referred to as dispatching units out of economic merit order. Economic merit order is the order of all generator offers from lowest to highest cost. Congestion occurs when loadings on transmission facilities mean the next unit in merit order cannot be used and a higher cost unit must be used in its place. Dispatch within the constrained area follows merit order for the units available to relieve the constraint.

⁴ The total congestion and marginal losses were calculated as of February 18, 2016, and are subject to change, based on continued PJM billing updates.

⁵ The total zonal congestion numbers were calculated as of February 18, 2016 and are based on PJM billing data which is subject to change. As of February 28, 2016, the total zonal congestion related numbers here differed from the February 28, 2016 PJM totals by \$0.13 Million, a difference of .0096 percent. The difference is primarily the result of missing dfax data and rounding.

means lower prices in the western control zones and higher prices in the eastern and southern control zones. Generation in the western control zones will receive lower prices and incur a congestion charge (negative generation congestion credit). Generation in the eastern and southern control zones will receive higher prices and receive a congestion credit (positive generation congestion credit).

PJM congestion accounting nets load congestion payments against generation congestion credits by billing organization. The net congestion bill for a zone or constraint may be either positive or negative, depending on the relative size and sign of load congestion payments and generation congestion credits. When summed across a zone, the net congestion bill shows the overall congestion charge or credit for an area, not including explicit congestion. But the net congestion bill is not a good measure of whether load is paying higher prices in the form of congestion.

The ComEd Control Zone, AEP Control Zone and the AP Control Zone are examples of how a positive net congestion bill can result from very different combinations of load payments and generation credits. The ComEd Control Zone had the highest congestion charges, \$311.3 million, of any control zone in 2015. The positive congestion costs in the ComEd Control Zone were the result of negative load congestion payments offset by larger negative generation congestion credits. Thus, the lower prices in ComEd, which resulted from a lower congestion component of LMP, meant that load paid lower prices and lower congestion, and that generators received lower prices and a lower congestion component. The result was positive measured congestion costs. This result follows from the fact that total zonal load is less than total zonal generation because the zone is a net exporter. In 2015, the total ComEd zonal generation was 125,658.7 GWh and total zonal load was 95,365.1 GWh.

The AEP Control Zone had the second highest congestion charges, \$276.0 million, of any control zone in 2015. The positive congestion costs in the AEP Control Zone were the result of negative load congestion payments offset by larger negative generation congestion credits.

The AP Control Zone had the sixth highest congestion charges, \$93.7 million, of any control zone in 2015. The positive congestion costs in the AP Control Zone were the result of positive load congestion payments offset by negative generation congestion credits.

The External category is not a control zone. The External category is comprised of external pricing points (buses) associated with interfaces.⁶ The total congestion cost for the external category was \$104.9 million in 2015.

⁶ The new external pricing points associated with interfaces can be found at the following link. <<http://www.pjm.com/markets-and-operations/energy/lmp-model-info.aspx>>

Table G-1 Congestion cost summary (By control zone): 2015

Congestion Costs (Millions)									
Control Zone	Day Ahead				Balancing				Grand Total
	Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	
AECO	(\$0.4)	(\$4.7)	\$1.9	\$6.1	\$0.8	\$1.5	(\$2.0)	(\$2.7)	\$3.4
AEP	(\$322.7)	(\$640.9)	(\$18.7)	\$299.5	\$10.0	\$24.0	(\$9.5)	(\$23.5)	\$276.0
AP	\$60.4	(\$41.8)	(\$1.8)	\$100.4	\$1.6	(\$0.1)	(\$8.4)	(\$6.8)	\$93.7
ATSI	(\$154.5)	(\$170.6)	(\$0.6)	\$15.4	\$0.9	\$12.6	(\$1.6)	(\$13.3)	\$2.1
BGE	\$460.0	\$340.1	\$15.7	\$135.7	(\$1.4)	(\$9.9)	(\$17.4)	(\$8.9)	\$126.8
ComEd	(\$696.2)	(\$1,042.3)	(\$11.4)	\$334.7	\$7.3	\$12.9	(\$17.7)	(\$23.3)	\$311.3
DAY	(\$46.4)	(\$39.0)	(\$0.2)	(\$7.6)	\$0.6	\$0.5	(\$1.0)	(\$0.9)	(\$8.5)
DEOK	(\$47.0)	(\$52.0)	\$4.5	\$9.5	\$6.2	\$2.4	(\$5.9)	(\$2.2)	\$7.3
DLCO	(\$41.2)	(\$52.5)	(\$0.4)	\$10.8	(\$2.1)	\$1.1	(\$0.7)	(\$4.0)	\$6.9
DPL	\$85.7	\$31.2	\$3.4	\$58.0	(\$8.7)	(\$4.4)	(\$5.3)	(\$9.6)	\$48.4
Dominion	\$983.9	\$877.7	\$11.7	\$117.9	(\$4.2)	(\$3.8)	(\$15.8)	(\$16.2)	\$101.7
EKPC	(\$39.3)	(\$35.1)	\$0.5	(\$3.7)	(\$0.7)	\$2.9	(\$1.5)	(\$5.0)	(\$8.7)
External	\$7.8	(\$117.6)	(\$1.8)	\$123.6	(\$10.1)	\$4.4	(\$4.2)	(\$18.7)	\$104.9
JCPL	(\$11.7)	(\$23.7)	(\$1.3)	\$10.7	\$2.2	\$3.7	\$1.3	(\$0.2)	\$10.5
Met-Ed	(\$11.0)	(\$41.1)	(\$2.7)	\$27.4	\$3.5	\$3.4	\$0.9	\$1.0	\$28.4
PECO	(\$32.7)	(\$116.5)	(\$4.0)	\$79.9	\$6.4	\$8.3	\$3.3	\$1.3	\$81.2
PENELEC	(\$63.8)	(\$141.2)	\$0.4	\$77.8	\$0.4	\$11.5	(\$2.3)	(\$13.4)	\$64.4
Pepco	\$430.4	\$300.5	\$6.8	\$136.7	(\$1.0)	(\$3.3)	(\$6.2)	(\$3.9)	\$132.7
PPL	(\$13.5)	(\$32.3)	(\$0.3)	\$18.5	\$5.1	\$3.4	(\$3.4)	(\$1.7)	\$16.8
PSEG	\$64.8	\$34.0	\$48.1	\$78.9	(\$15.5)	(\$1.4)	(\$78.9)	(\$93.0)	(\$14.1)
RECO	\$1.6	\$0.2	\$0.5	\$2.0	(\$0.5)	\$0.0	(\$1.3)	(\$1.9)	\$0.1
Total	\$614.2	(\$967.6)	\$50.3	\$1,632.1	\$0.6	\$69.8	(\$177.6)	(\$246.9)	\$1,385.3

Table G-2 Congestion cost summary (By control zone): 2014

Congestion Costs (Millions)									
Control Zone	Day Ahead				Balancing				Grand Total
	Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	
AECO	\$48.1	\$28.2	(\$0.3)	\$19.6	\$1.9	(\$0.1)	\$0.4	\$2.4	\$22.0
AEP	(\$788.9)	(\$1,322.1)	(\$22.9)	\$510.4	\$32.2	\$52.7	(\$36.0)	(\$56.4)	\$454.0
AP	(\$71.9)	(\$298.2)	(\$17.1)	\$209.2	\$10.0	\$24.6	(\$5.1)	(\$19.7)	\$189.5
ATSI	(\$270.6)	(\$305.2)	(\$7.3)	\$27.3	\$3.5	\$28.7	(\$11.5)	(\$36.8)	(\$9.4)
BGE	\$550.1	\$418.2	\$10.7	\$142.6	\$6.8	(\$22.9)	(\$21.6)	\$8.1	\$150.7
ComEd	(\$1,184.9)	(\$1,593.2)	(\$27.0)	\$381.3	\$12.4	\$26.4	\$1.8	(\$12.2)	\$369.1
DAY	(\$106.6)	(\$100.5)	(\$0.4)	(\$6.6)	\$5.0	\$3.9	\$1.4	\$2.6	(\$4.0)
DEOK	(\$141.9)	(\$127.3)	\$2.1	(\$12.6)	\$5.0	\$8.8	(\$3.7)	(\$7.5)	(\$20.0)
DLCO	(\$85.3)	(\$84.9)	(\$1.1)	(\$1.4)	(\$3.0)	\$5.4	\$1.5	(\$6.9)	(\$8.3)
DPL	\$217.0	\$94.9	\$7.1	\$129.2	(\$20.6)	(\$11.0)	(\$7.3)	(\$16.9)	\$112.3
Dominion	\$1,047.6	\$826.7	\$12.8	\$233.7	\$8.5	\$14.3	(\$25.2)	(\$31.1)	\$202.6
EKPC	(\$80.9)	(\$74.1)	(\$0.1)	(\$7.0)	\$0.1	\$6.5	(\$0.6)	(\$7.1)	(\$14.1)
External	(\$45.5)	(\$145.2)	(\$3.4)	\$96.3	(\$20.9)	(\$6.8)	(\$11.1)	(\$25.2)	\$71.2
JCPL	\$115.0	\$32.4	(\$11.4)	\$71.3	\$1.0	\$5.5	\$8.8	\$4.2	\$75.5
Met-Ed	\$65.0	\$58.0	(\$2.8)	\$4.1	\$3.5	\$7.7	\$1.9	(\$2.4)	\$1.7
PECO	\$200.0	\$182.5	(\$1.8)	\$15.8	\$6.9	\$14.0	\$0.9	(\$6.2)	\$9.6
PENELEC	(\$95.0)	(\$246.5)	(\$5.1)	\$146.4	(\$5.5)	\$22.9	(\$4.2)	(\$32.6)	\$113.8
Pepco	\$584.1	\$431.6	\$4.3	\$156.8	\$2.0	(\$0.8)	(\$11.4)	(\$8.6)	\$148.2
PPL	\$220.3	\$221.9	(\$2.1)	(\$3.8)	\$7.5	\$15.3	\$2.0	(\$5.7)	(\$9.5)
PSEG	\$409.2	\$331.0	\$31.1	\$109.3	(\$3.4)	\$23.2	(\$14.7)	(\$41.3)	\$68.0
RECO	\$10.5	\$0.6	(\$0.5)	\$9.3	(\$0.2)	\$0.0	\$0.3	\$0.0	\$9.3
Total	\$595.5	(\$1,671.2)	(\$35.4)	\$2,231.3	\$52.7	\$218.1	(\$133.6)	(\$299.1)	\$1,932.2

Details of Regional and Zonal Congestion

Constraints can affect prices and congestion across multiple zones. PJM is comprised of three regions: the PJM Mid-Atlantic Region with 11 control zones (the AECO, BGE, DPL, JCPL, Met-Ed, PECO, PENELEC, Pepco, PPL, PSEG and RECO control zones); the PJM West Region with eight control zones (the AP, ATSI, ComEd, AEP, DLCO, DEOK, DAY and EKPC control zones); and the PJM South Region with one control zone (the Dominion Control Zone).⁷

Table G-3 through Table G-42 present the top 15 constraints affecting each control zone's congestion costs, including the facility type and the location of the constrained facility for both 2015 and 2014. In addition, day-ahead and real-time congestion-event hours are presented for each of the highlighted constraints. The tables present the constraints in descending order of the absolute value of total congestion costs for each zone. In addition to the top 15 constraints, these tables show the top five local constraints for the control zone, which were not in the top 15 constraints, but are located inside the respective control zone. In 2014, the RECO Control Zone only had one internal constraint, thus the RECO table shows the top 15 constraints and one local constraint.

For each of the constraints presented in the following tables, the zonal cost impacts are decomposed into their Day-Ahead Energy Market and balancing market components. Total congestion costs are the sum of the day-ahead and balancing congestion cost components. Total congestion costs associated with a given constraint may be positive or negative in value.

⁷ See "Operating Agreement of PJM Interconnection, L.L.C.," (February 16, 2015) Sections 1.20A 1.35B 1.36B <<http://www.pjm.com/documents/agreements.aspx>>

Mid-Atlantic Region Congestion-Event Summaries

AECO Control Zone

Table G-3 AECO Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation		Load Payments	Generation		Grand Total	Day Ahead	Real Time		
					Credits	Explicit		Total	Credits				Explicit	Total
1	Bagley - Graceton	Line	BGE	(\$17.9)	(\$11.8)	(\$0.4)	(\$6.6)	\$0.1	\$0.6	\$0.4	(\$0.1)	(\$6.6)	7,088	3,946
2	Conastone - Northwest	Line	BGE	(\$16.9)	(\$12.3)	(\$0.5)	(\$5.1)	\$0.1	\$1.4	\$0.6	(\$0.7)	(\$5.8)	5,072	3,468
3	5004/5005 Interface	Interface	500	\$12.1	\$8.3	\$0.1	\$3.8	\$0.1	(\$0.3)	(\$0.0)	\$0.4	\$4.2	1,356	642
4	Monroe - Vineland	Line	AECO	\$8.5	\$3.9	\$2.5	\$7.1	(\$0.6)	(\$0.8)	(\$3.2)	(\$3.0)	\$4.2	6,242	394
5	East	Interface	500	\$4.6	\$3.2	\$0.1	\$1.5	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$1.5	1,080	32
6	Central	Interface	500	\$4.6	\$3.3	\$0.0	\$1.4	\$0.0	(\$0.1)	(\$0.0)	\$0.1	\$1.5	582	82
7	Glenarm - Windy Edge	Line	BGE	(\$2.4)	(\$1.3)	(\$0.1)	(\$1.2)	\$0.0	\$0.2	\$0.1	(\$0.1)	(\$1.3)	1,802	844
8	Beckett - Paulsboro	Line	AECO	\$0.8	\$0.1	\$0.1	\$0.8	(\$0.0)	\$0.2	\$0.2	\$0.3	\$1.1	258	18
9	West	Interface	500	\$1.8	\$1.1	\$0.0	\$0.7	(\$0.0)	(\$0.0)	(\$0.0)	\$0.0	\$0.7	638	98
10	Bedington - Black Oak	Interface	500	\$2.0	\$1.5	\$0.0	\$0.6	(\$0.0)	(\$0.1)	(\$0.0)	\$0.1	\$0.7	5,866	688
11	Maywood - Saddlebrook	Line	PSEG	(\$1.2)	(\$0.8)	(\$0.0)	(\$0.4)	\$0.0	\$0.3	\$0.0	(\$0.2)	(\$0.6)	6,912	1,018
12	Deepwater - Woodstown	Line	AECO	\$0.3	(\$0.2)	\$0.0	\$0.5	(\$0.0)	(\$0.0)	\$0.0	(\$0.0)	\$0.5	402	38
13	Pinehill - Terrace	Line	AECO	\$0.6	\$0.1	\$0.0	\$0.5	\$0.0	\$0.0	\$0.0	\$0.0	\$0.5	146	0
14	Mahans Lane - Tidd	Line	AEP	\$1.4	\$1.0	\$0.0	\$0.4	\$0.0	(\$0.1)	(\$0.0)	\$0.1	\$0.5	2,098	788
15	Person - Halifax	Flowgate	MISO	\$1.6	\$1.2	\$0.0	\$0.5	(\$0.0)	(\$0.0)	(\$0.0)	\$0.0	\$0.5	2,824	12
16	Churchtown	Transformer	AECO	(\$0.0)	(\$0.6)	(\$0.1)	\$0.5	\$0.0	\$0.1	\$0.1	(\$0.0)	\$0.4	290	82
18	Pine Hill - Terrace	Line	AECO	\$0.0	\$0.0	\$0.0	\$0.0	\$0.6	\$0.0	(\$0.2)	\$0.3	\$0.3	0	36
20	Monroe	Transformer	AECO	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.0)	\$0.3	\$0.0	(\$0.3)	(\$0.3)	0	14
26	Mickleton - Monroe	Line	AECO	(\$0.1)	(\$0.3)	\$0.0	\$0.2	(\$0.0)	\$0.0	(\$0.0)	(\$0.0)	\$0.2	88	56
31	Carney's Point - Deepwater	Line	AECO	\$0.1	(\$0.0)	\$0.0	\$0.1	\$0.1	\$0.0	(\$0.0)	\$0.0	\$0.2	300	36

Table G-4 AECO Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation		Load Payments	Generation		Grand Total	Day Ahead	Real Time		
					Credits	Explicit		Total	Credits				Explicit	Total
1	West	Interface	500	\$41.3	\$24.6	(\$0.1)	\$16.6	\$0.4	(\$0.3)	(\$0.0)	\$0.8	\$17.4	3,068	830
2	Bagley - Graceton	Line	BGE	(\$20.2)	(\$9.5)	(\$0.4)	(\$11.1)	\$1.1	\$0.8	\$0.3	\$0.6	(\$10.5)	9,168	3,768
3	East	Interface	500	\$5.0	\$2.7	\$0.2	\$2.5	\$0.0	(\$0.1)	\$0.0	\$0.1	\$2.6	3,468	34
4	Readington - Roseland	Line	PSEG	(\$4.9)	(\$2.7)	(\$0.3)	(\$2.5)	\$0.0	\$0.3	\$0.2	(\$0.0)	(\$2.5)	2,338	378
5	AP South	Interface	500	\$3.5	\$1.9	(\$0.2)	\$1.4	\$0.1	(\$0.2)	\$0.3	\$0.6	\$2.0	10,180	1,962
6	Monroe - Vineland	Line	AECO	\$3.1	\$1.2	\$0.7	\$2.6	(\$0.5)	(\$0.3)	(\$0.5)	(\$0.7)	\$1.9	2,696	48
7	5004/5005 Interface	Interface	500	\$2.7	\$1.5	\$0.0	\$1.2	\$0.2	(\$0.6)	(\$0.1)	\$0.7	\$1.9	1,108	672
8	Benton Harbor - Palisades	Flowgate	MISO	\$3.4	\$1.8	\$0.1	\$1.7	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$1.7	6,050	274
9	Cloverdale	Transformer	AEP	\$2.5	\$1.3	(\$0.0)	\$1.2	\$0.0	(\$0.0)	\$0.0	\$0.1	\$1.3	8,246	572
10	Cook - Palisades	Flowgate	MISO	\$2.1	\$0.9	\$0.1	\$1.3	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$1.3	4,632	616
11	Atlantic - Larrabee	Line	JCPL	(\$1.9)	(\$0.9)	(\$0.7)	(\$1.7)	\$0.0	\$0.1	\$0.6	\$0.5	(\$1.2)	1,550	88
12	Central	Interface	500	\$2.7	\$1.5	(\$0.0)	\$1.2	\$0.0	(\$0.0)	(\$0.0)	\$0.0	\$1.2	668	20
13	Burlington - Croydon	Line	PECO	\$1.6	\$0.7	\$0.2	\$1.1	\$0.0	(\$0.0)	(\$0.1)	(\$0.0)	\$1.1	9,942	1,088
14	Bedington - Black Oak	Interface	500	\$2.3	\$1.2	(\$0.0)	\$1.1	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$1.1	5,592	646
15	Keeney	Transformer	DPL	\$1.2	\$0.6	\$0.0	\$0.6	(\$0.0)	(\$0.2)	\$0.1	\$0.3	\$0.9	6,198	116
26	Mickleton - Monroe	Line	AECO	(\$0.1)	(\$0.2)	(\$0.0)	\$0.2	\$0.0	(\$0.1)	\$0.0	\$0.2	\$0.3	126	6
28	Beckett - Paulsboro	Line	AECO	\$0.4	\$0.1	\$0.0	\$0.4	(\$0.1)	(\$0.1)	(\$0.0)	(\$0.0)	\$0.3	110	18
33	Lewis	Transformer	AECO	\$0.4	\$0.0	\$0.2	\$0.5	\$0.1	\$0.0	(\$0.3)	(\$0.3)	\$0.2	450	22
46	Absecon - Lewis	Line	AECO	\$0.2	\$0.0	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	54	16
65	Marven - Marven Tap	Line	AECO	\$0.1	\$0.0	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	416	0

BGE Control Zone

Table G-5 BGE Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	Conastone - Northwest	Line	BGE	\$120.7	\$86.7	\$5.4	\$39.3	(\$1.9)	(\$3.6)	(\$6.2)	(\$4.5)	\$34.8	5,072	3,468
2	Bagley - Graceton	Line	BGE	\$120.0	\$90.6	\$6.2	\$35.6	(\$3.0)	(\$3.9)	(\$5.4)	(\$4.5)	\$31.1	7,088	3,946
3	Bedington - Black Oak	Interface	500	\$35.5	\$29.4	\$0.5	\$6.6	\$0.4	(\$0.3)	(\$0.3)	\$0.5	\$7.1	5,866	688
4	BCPEP	Interface	Pepco	\$25.5	\$19.8	\$0.9	\$6.5	\$0.0	\$0.0	\$0.0	\$0.0	\$6.5	1,792	0
5	5004/5005 Interface	Interface	500	\$17.1	\$11.4	(\$1.4)	\$4.3	\$0.8	(\$0.2)	\$0.4	\$1.4	\$5.7	1,356	642
6	Glenarm - Windy Edge	Line	BGE	\$20.4	\$16.9	\$1.3	\$4.9	\$1.3	\$0.4	(\$1.3)	(\$0.4)	\$4.4	1,802	844
7	Person - Halifax	Flowgate	MISO	\$17.6	\$13.4	\$0.2	\$4.4	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$4.4	2,824	12
8	Brandon Shores - Riverside	Line	BGE	\$4.0	(\$0.0)	\$0.1	\$4.2	(\$0.0)	(\$0.0)	\$0.0	\$0.0	\$4.2	394	56
9	AP South	Interface	500	\$16.0	\$13.6	\$0.3	\$2.7	\$0.1	(\$0.0)	(\$0.0)	\$0.1	\$2.7	2,570	84
10	Pumphrey	Transformer	Pepco	\$5.9	\$3.7	\$0.5	\$2.7	\$0.0	\$0.0	\$0.0	\$0.0	\$2.7	498	0
11	Graceton	Transformer	BGE	\$6.4	\$3.9	\$0.3	\$2.7	(\$0.2)	(\$0.2)	(\$0.2)	(\$0.2)	\$2.5	540	176
12	Central	Interface	500	(\$5.5)	(\$4.3)	(\$1.3)	(\$2.4)	(\$0.0)	\$0.0	\$0.2	\$0.2	(\$2.3)	582	82
13	Graceton - Safe Harbor	Line	BGE	\$6.1	\$4.3	\$0.5	\$2.3	\$0.1	(\$0.1)	(\$0.5)	(\$0.3)	\$2.0	890	266
14	Riverside	Line	BGE	\$1.5	(\$0.3)	\$0.1	\$1.9	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$1.9	234	16
15	Dravosburg - West Mifflin	Line	DLCO	\$4.9	\$3.6	\$0.0	\$1.2	\$0.4	(\$0.2)	(\$0.0)	\$0.6	\$1.8	904	514
20	Concord Street - Greene Street	Line	BGE	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.6)	\$0.2	(\$0.5)	(\$1.3)	(\$1.3)	0	90
22	Concord - Green Street	Line	BGE	\$1.6	\$0.5	\$0.1	\$1.2	\$0.0	\$0.0	\$0.0	\$0.0	\$1.2	184	0
23	Green Street - Westport	Line	BGE	\$1.1	\$0.2	\$0.1	\$1.0	\$0.0	\$0.0	\$0.0	\$0.0	\$1.0	92	0
24	Erdman - Windy Edge	Line	BGE	\$1.1	\$0.2	\$0.1	\$1.0	\$0.0	\$0.0	\$0.0	\$0.0	\$1.0	52	0
26	Brandon Shores - Waugh Chapel	Line	BGE	\$1.3	\$0.6	\$0.1	\$0.8	(\$0.1)	(\$0.3)	(\$0.2)	\$0.1	\$0.9	232	24

Table G-6 BGE Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	Bagley - Graceton	Line	BGE	\$129.0	\$95.4	\$6.1	\$39.8	(\$1.1)	(\$3.6)	(\$4.8)	(\$2.3)	\$37.5	9,168	3,768
2	West	Interface	500	\$133.0	\$100.0	(\$3.5)	\$29.5	\$1.4	(\$0.4)	\$0.2	\$1.9	\$31.5	3,068	830
3	AP South	Interface	500	\$128.5	\$106.2	\$5.1	\$27.3	\$3.9	(\$4.7)	(\$6.4)	\$2.2	\$29.6	10,180	1,962
4	BCPEP	Interface	Pepco	\$41.2	\$29.4	\$1.9	\$13.7	(\$0.2)	(\$11.9)	(\$7.3)	\$4.3	\$18.0	1,914	82
5	Bedington - Black Oak	Interface	500	\$34.8	\$27.6	\$1.2	\$8.5	\$0.5	(\$0.1)	(\$1.0)	(\$0.4)	\$8.1	5,592	646
6	Cloverdale	Transformer	AEP	\$18.5	\$14.2	\$0.5	\$4.8	\$0.2	(\$0.4)	(\$0.3)	\$0.4	\$5.1	8,246	572
7	Brambleton - Loudoun	Line	Dominion	\$16.0	\$11.3	\$0.3	\$5.0	\$0.0	(\$0.0)	(\$0.1)	\$0.0	\$5.0	194	28
8	Readington - Roseland	Line	PSEG	(\$12.0)	(\$9.3)	(\$1.0)	(\$3.7)	\$0.1	(\$0.1)	\$0.9	\$1.0	(\$2.7)	2,338	378
9	5004/5005 Interface	Interface	500	\$3.9	\$2.5	(\$0.3)	\$1.1	\$0.3	(\$0.5)	\$0.7	\$1.5	\$2.5	1,108	672
10	Graceton - Safe Harbor	Line	BGE	\$10.2	\$6.6	\$1.6	\$5.2	\$0.2	(\$0.1)	(\$3.1)	(\$2.8)	\$2.4	3,562	802
11	Benton Harbor - Palisades	Flowgate	MISO	\$8.2	\$6.1	(\$0.1)	\$2.0	\$0.0	\$0.0	\$0.1	\$0.1	\$2.1	6,050	274
12	Riverside	Line	BGE	\$1.5	(\$0.2)	\$0.1	\$1.8	\$0.1	\$0.0	(\$0.1)	(\$0.0)	\$1.8	366	34
13	East	Interface	500	(\$5.2)	(\$4.2)	(\$0.9)	(\$1.8)	(\$0.0)	(\$0.1)	\$0.0	\$0.1	(\$1.8)	3,468	34
14	Conastone - Northwest	Line	BGE	\$4.8	\$3.5	\$0.3	\$1.5	\$0.1	(\$0.3)	(\$0.5)	(\$0.1)	\$1.4	206	216
15	Central	Interface	500	(\$3.3)	(\$2.9)	(\$0.9)	(\$1.3)	\$0.0	\$0.0	\$0.1	\$0.1	(\$1.3)	668	20
21	Glenarm - Windy Edge	Line	BGE	\$3.3	\$2.5	\$0.2	\$1.0	(\$0.0)	(\$0.0)	(\$0.3)	(\$0.3)	\$0.7	586	158
26	Conastone - Graceton	Line	BGE	\$1.1	\$0.7	\$0.1	\$0.5	\$0.0	\$0.0	\$0.0	\$0.0	\$0.5	314	0
35	Brandon Shores - Riverside	Line	BGE	\$0.3	\$0.0	\$0.0	\$0.3	\$0.0	\$0.0	\$0.0	\$0.0	\$0.3	40	0
59	Gould Street - Westport	Line	BGE	\$0.0	(\$0.0)	\$0.1	\$0.2	\$0.0	\$0.0	\$0.0	\$0.0	\$0.2	7,734	0
66	Five Forks - Rock Ridge Tap	Line	BGE	\$0.3	\$0.2	\$0.0	\$0.2	\$0.0	\$0.0	\$0.0	\$0.0	\$0.2	78	2

DPL Control Zone

Table G-7 DPL Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	Easton	Transformer	DPL	\$29.0	\$6.6	\$1.3	\$23.7	(\$1.2)	\$0.2	(\$0.3)	(\$1.7)	\$22.0	6,198	644
2	Bagley - Graceton	Line	BGE	(\$32.7)	(\$13.4)	(\$1.1)	(\$20.4)	\$0.4	(\$0.7)	\$1.1	\$2.2	(\$18.2)	7,088	3,946
3	Conastone - Northwest	Line	BGE	(\$31.1)	(\$13.0)	(\$1.3)	(\$19.3)	\$0.3	(\$1.0)	\$1.4	\$2.7	(\$16.6)	5,072	3,468
4	5004/5005 Interface	Interface	500	\$25.2	\$10.8	\$0.1	\$14.5	\$1.2	\$0.3	(\$0.3)	\$0.6	\$15.1	1,356	642
5	Central	Interface	500	\$9.9	\$3.4	\$0.1	\$6.7	\$0.0	\$0.1	(\$0.1)	(\$0.2)	\$6.5	582	82
6	East	Interface	500	\$9.6	\$4.0	\$0.2	\$5.7	(\$0.0)	\$0.1	(\$0.0)	(\$0.1)	\$5.6	1,080	32
7	Milford - Steele	Line	DPL	\$10.0	\$3.0	\$1.3	\$8.3	(\$1.2)	\$0.3	(\$3.1)	(\$4.7)	\$3.6	2,482	250
8	Cedar Creek - Red Lion	Line	DPL	\$5.9	\$1.5	\$0.7	\$5.1	\$0.2	\$0.4	(\$1.3)	(\$1.5)	\$3.5	1,048	76
9	Bedington - Black Oak	Interface	500	\$4.9	\$2.0	\$0.1	\$3.0	\$0.1	\$0.2	(\$0.1)	(\$0.1)	\$2.9	5,866	688
10	Mount Olive - Piney Grove	Line	DPL	\$12.2	\$7.9	\$0.4	\$4.7	(\$3.0)	(\$1.4)	(\$0.5)	(\$2.1)	\$2.6	1,246	1,116
11	Loretto - Vienna	Line	DPL	\$2.3	\$0.2	\$0.4	\$2.5	\$0.0	\$0.0	\$0.0	\$0.0	\$2.5	1,790	0
12	West	Interface	500	\$3.7	\$1.4	\$0.1	\$2.4	\$0.0	\$0.0	(\$0.0)	(\$0.1)	\$2.3	638	98
13	Mahans Lane - Tidd	Line	AEP	\$3.1	\$1.2	\$0.0	\$1.9	\$0.1	\$0.0	(\$0.0)	\$0.0	\$1.9	2,098	788
14	Person - Halifax	Flowgate	MISO	\$3.5	\$1.4	(\$0.3)	\$1.9	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$1.9	2,824	12
15	Glenarm - Windy Edge	Line	BGE	(\$4.5)	(\$2.7)	(\$0.1)	(\$2.0)	(\$0.0)	(\$0.1)	\$0.2	\$0.3	(\$1.7)	1,802	844
16	Easton - Trappe	Line	DPL	\$1.8	\$0.4	\$0.1	\$1.5	\$0.0	\$0.0	\$0.0	\$0.0	\$1.5	840	0
17	Preston - Tanyard	Line	DPL	\$1.6	\$0.3	\$0.2	\$1.5	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$1.5	1,248	4
20	Kenney - Stockton	Line	DPL	\$14.2	\$9.5	\$0.1	\$4.8	(\$5.1)	(\$2.0)	(\$0.4)	(\$3.5)	\$1.2	1,234	1,068
21	Coolspring - Milford	Line	DPL	\$1.4	\$0.1	\$0.1	\$1.4	\$0.0	\$0.0	(\$0.2)	(\$0.1)	\$1.2	254	18
22	Chapelst - Harmony	Line	DPL	\$1.2	\$0.2	\$0.1	\$1.1	\$0.1	\$0.0	(\$0.1)	(\$0.0)	\$1.0	744	42

Table G-8 DPL Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	West	Interface	500	\$84.9	\$41.0	\$0.4	\$44.2	\$1.8	(\$0.6)	(\$0.3)	\$2.1	\$46.3	3,068	830
2	Bagley - Graceton	Line	BGE	(\$33.8)	(\$14.6)	(\$2.1)	(\$21.3)	\$0.3	(\$1.8)	\$2.1	\$4.2	(\$17.1)	9,168	3,768
3	Cedar Creek - Red Lion	Line	DPL	\$14.2	\$3.6	\$1.1	\$11.7	(\$0.9)	(\$0.7)	(\$0.5)	(\$0.7)	\$11.0	2,188	48
4	Church - New Meredith	Line	DPL	\$13.2	\$3.9	\$0.5	\$9.8	\$0.0	\$0.0	\$0.0	\$0.0	\$9.8	2,694	0
5	Kenney - Stockton	Line	DPL	\$42.8	\$29.0	\$0.5	\$14.3	(\$18.3)	(\$12.7)	(\$2.4)	(\$8.1)	\$6.3	3,034	2,938
6	Worcester - Ocean Pines	Line	DPL	\$6.4	\$0.7	\$0.2	\$6.0	\$0.0	\$0.0	\$0.0	\$0.0	\$6.0	1,896	0
7	East	Interface	500	\$9.6	\$4.3	\$0.4	\$5.7	\$0.1	(\$0.0)	(\$0.1)	\$0.0	\$5.7	3,468	34
8	Readington - Roseland	Line	PSEG	(\$8.9)	(\$3.6)	(\$0.3)	(\$5.7)	\$0.0	\$0.1	\$0.2	\$0.1	(\$5.5)	2,338	378
9	AP South	Interface	500	\$9.4	\$4.4	(\$0.0)	\$4.9	\$0.6	\$0.2	\$0.2	\$0.6	\$5.5	10,180	1,962
10	Easton	Transformer	DPL	\$7.1	\$1.4	\$0.4	\$6.1	(\$0.1)	\$0.4	(\$0.3)	(\$0.7)	\$5.4	3,516	182
11	Harrington - Wells	Line	DPL	\$6.3	\$1.0	\$0.8	\$6.1	(\$1.1)	\$0.3	(\$0.9)	(\$2.2)	\$3.9	1,532	192
12	5004/5005 Interface	Interface	500	\$4.8	\$1.7	\$0.0	\$3.0	\$0.7	(\$0.0)	(\$0.1)	\$0.6	\$3.6	1,108	672
13	Benton Harbor - Palisades	Flowgate	MISO	\$6.0	\$2.5	\$0.1	\$3.5	\$0.0	\$0.0	\$0.0	\$0.0	\$3.6	6,050	274
14	Kent - Vaughn	Line	DPL	\$3.5	\$0.4	\$0.2	\$3.3	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$3.3	860	4
15	Cloverdale	Transformer	AEP	\$5.2	\$2.3	\$0.0	\$3.0	\$0.2	\$0.0	(\$0.0)	\$0.1	\$3.1	8,246	572
16	New Meredith - Church	Line	DPL	\$0.0	\$0.0	\$0.0	\$0.0	(\$2.2)	\$1.0	\$0.1	(\$3.1)	(\$3.1)	0	270
18	Indian River - Nelson	Line	DPL	\$0.2	\$0.0	\$0.1	\$0.2	(\$0.3)	\$0.6	(\$2.0)	(\$3.0)	(\$2.8)	48	82
19	Keeney	Transformer	DPL	\$4.6	\$1.8	\$0.9	\$3.7	\$0.1	\$0.4	(\$0.8)	(\$1.1)	\$2.6	6,198	116
21	Mardela - Vienna	Line	DPL	\$6.0	\$1.5	\$1.3	\$5.9	(\$1.5)	\$0.7	(\$1.4)	(\$3.5)	\$2.3	9,254	12
24	New Church - Piney Grove	Line	DPL	\$0.8	\$0.1	\$0.8	\$1.5	\$0.0	\$0.0	\$0.0	\$0.0	\$1.5	1,304	0

JCPL Control Zone

Table G-9 JCPL Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	5004/5005 Interface	Interface	500	\$29.7	\$13.2	\$0.2	\$16.7	(\$0.1)	(\$0.2)	(\$0.2)	(\$0.1)	\$16.6	1,356	642
2	Bagley - Graceton	Line	BGE	(\$36.4)	(\$25.5)	(\$0.4)	(\$11.3)	\$0.1	(\$0.3)	\$0.4	\$0.8	(\$10.4)	7,088	3,946
3	Conastone - Northwest	Line	BGE	(\$35.8)	(\$26.8)	(\$0.6)	(\$9.6)	\$0.7	\$0.3	\$0.7	\$1.2	(\$8.4)	5,072	3,468
4	Central	Interface	500	\$9.9	\$4.8	\$0.0	\$5.1	(\$0.0)	\$0.0	(\$0.0)	(\$0.1)	\$5.0	582	82
5	East	Interface	500	\$8.8	\$4.8	\$0.1	\$4.2	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$4.1	1,080	32
6	Maywood - Saddlebrook	Line	PSEG	(\$6.2)	(\$2.3)	(\$0.2)	(\$4.0)	\$0.1	\$0.1	\$0.1	\$0.1	(\$3.9)	6,912	1,018
7	Bergen - New Milford	Line	PSEG	(\$3.4)	(\$1.2)	(\$0.1)	(\$2.3)	\$0.1	\$0.1	\$0.1	\$0.0	(\$2.3)	5,940	1,590
8	Person - Halifax	Flowgate	MISO	\$3.7	\$1.7	\$0.0	\$2.0	(\$0.0)	\$0.0	(\$0.0)	(\$0.0)	\$2.0	2,824	12
9	West	Interface	500	\$3.9	\$2.0	\$0.0	\$1.9	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$1.9	638	98
10	49 Street - Hoboken	Line	PSEG	(\$2.8)	(\$1.0)	(\$0.1)	(\$1.9)	\$0.0	\$0.0	\$0.0	\$0.0	(\$1.9)	3,286	0
11	Atlantic - Red Bank	Line	JCPL	\$2.0	\$0.1	\$0.0	\$1.8	\$0.0	\$0.0	\$0.0	\$0.0	\$1.8	100	0
12	Mahans Lane - Tidd	Line	AEP	\$3.2	\$1.4	\$0.0	\$1.8	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$1.8	2,098	788
13	Glenarm - Windy Edge	Line	BGE	(\$5.3)	(\$3.5)	(\$0.1)	(\$1.8)	\$0.2	\$0.3	\$0.1	\$0.0	(\$1.8)	1,802	844
14	Dravosburg - West Mifflin	Line	DLCO	\$2.4	\$1.0	\$0.0	\$1.5	\$0.1	\$0.1	(\$0.0)	(\$0.1)	\$1.4	904	514
15	Bedington - Black Oak	Interface	500	\$3.2	\$1.7	\$0.0	\$1.5	\$0.0	\$0.1	(\$0.0)	(\$0.1)	\$1.4	5,866	688
19	Traynor - Whippany	Line	JCPL	\$7.2	\$5.4	\$0.0	\$1.9	\$0.4	\$2.9	(\$0.0)	(\$2.5)	(\$0.6)	436	158
48	Sayreville - Sayreville	Line	JCPL	\$0.0	\$0.0	(\$0.2)	(\$0.2)	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.2)	6,154	0
56	Red Oak - Sayreville	Line	JCPL	(\$0.0)	(\$0.1)	(\$0.0)	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	592	0
131	Traynor - Summit	Line	JCPL	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	8	0
201	Franklin - Vernon	Line	JCPL	(\$0.0)	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	584	0

Table G-10 JCPL Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	West	Interface	500	\$88.2	\$35.5	(\$0.7)	\$52.0	(\$0.0)	\$2.6	(\$0.1)	(\$2.7)	\$49.3	3,068	830
2	Bagley - Graceton	Line	BGE	(\$38.4)	(\$26.0)	(\$0.6)	(\$13.0)	\$0.9	\$0.7	\$0.6	\$0.8	(\$12.2)	9,168	3,768
3	Bridgewater - Middlesex	Line	PSEG	\$17.3	\$5.8	(\$0.6)	\$10.8	(\$1.2)	\$0.1	\$0.3	(\$1.1)	\$9.8	446	62
4	Cedar Grove - Clifton	Line	PSEG	(\$10.7)	(\$3.7)	(\$4.3)	(\$11.2)	\$0.1	(\$0.1)	\$1.4	\$1.6	(\$9.7)	3,028	284
5	Atlantic - Larrabee	Line	JCPL	\$8.1	(\$0.9)	\$0.3	\$9.4	(\$0.1)	(\$0.6)	(\$0.3)	\$0.1	\$9.5	1,550	88
6	East	Interface	500	\$9.0	\$4.4	\$0.4	\$5.0	\$0.0	\$0.2	(\$0.0)	(\$0.2)	\$4.7	3,468	34
7	Benton Harbor - Palisades	Flowgate	MISO	\$8.5	\$4.0	\$0.2	\$4.7	(\$0.0)	\$0.0	(\$0.0)	(\$0.1)	\$4.6	6,050	274
8	Athenia - Clifton	Line	PSEG	(\$2.2)	(\$0.4)	(\$1.6)	(\$3.4)	\$0.0	\$0.0	\$0.0	\$0.0	(\$3.4)	1,250	0
9	Central	Interface	500	\$5.6	\$2.3	\$0.0	\$3.3	\$0.0	\$0.1	(\$0.0)	(\$0.0)	\$3.3	668	20
10	Readington - Roseland	Line	PSEG	(\$6.8)	(\$4.0)	(\$1.9)	(\$4.7)	\$0.1	(\$0.4)	\$0.9	\$1.5	(\$3.2)	2,338	378
11	Cloverdale	Transformer	AEP	\$5.0	\$2.0	(\$0.1)	\$2.9	\$0.0	\$0.2	\$0.0	(\$0.2)	\$2.7	8,246	572
12	Brambleton - Loudoun	Line	Dominion	\$4.8	\$1.9	(\$0.0)	\$2.8	\$0.0	\$0.1	(\$0.0)	(\$0.1)	\$2.7	194	28
13	Cook - Palisades	Flowgate	MISO	\$5.2	\$2.6	\$0.1	\$2.7	(\$0.0)	\$0.0	(\$0.0)	(\$0.1)	\$2.6	4,632	616
14	Wescosville	Transformer	PPL	\$2.9	\$0.8	\$0.5	\$2.6	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$2.6	2,351	8
15	Maywood - Saddlebrook	Line	PSEG	(\$3.2)	(\$1.0)	(\$1.1)	(\$3.2)	(\$0.0)	\$0.0	\$1.0	\$1.0	(\$2.2)	3,022	372
17	Cookstown - Van Hiseville	Line	JCPL	\$3.9	\$2.3	\$0.2	\$1.8	(\$0.0)	\$0.1	(\$0.0)	(\$0.1)	\$1.7	828	34
28	Red Oak - Sayreville	Line	JCPL	(\$0.0)	(\$0.6)	(\$0.0)	\$0.6	\$0.0	\$0.1	\$0.1	\$0.1	\$0.7	616	40
35	Traynor - Whippany	Line	JCPL	\$0.5	\$0.4	\$0.0	\$0.1	(\$0.2)	(\$0.4)	\$0.2	\$0.4	\$0.5	126	20
43	Franklin - Vernon	Line	JCPL	\$0.0	\$0.0	\$0.3	\$0.4	\$0.0	\$0.0	\$0.0	\$0.0	\$0.4	2,940	0
50	Sayreville - Sayreville	Line	JCPL	\$0.1	\$0.0	(\$0.3)	(\$0.3)	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.3)	5,738	0

Met-Ed Control Zone

Table G-11 Met-Ed Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	Bagley - Graceton	Line	BGE	(\$28.7)	(\$41.7)	(\$1.0)	\$12.1	\$0.5	\$1.3	\$0.9	\$0.1	\$12.2	7,088	3,946
2	Conastone - Northwest	Line	BGE	(\$27.6)	(\$36.7)	(\$1.4)	\$7.7	\$0.2	\$2.0	\$1.6	(\$0.2)	\$7.5	5,072	3,468
3	Jackson - Three Mile Island	Line	Met-Ed	\$2.8	(\$1.8)	\$0.5	\$5.1	\$0.6	(\$0.9)	(\$1.0)	\$0.6	\$5.7	408	92
4	5004/5005 Interface	Interface	500	\$21.7	\$24.6	(\$0.6)	(\$3.5)	\$1.0	\$0.5	(\$0.1)	\$0.4	(\$3.1)	1,356	642
5	Gardners - Texas East	Line	Met-Ed	\$2.5	(\$0.6)	\$0.2	\$3.2	(\$0.0)	\$0.5	(\$0.1)	(\$0.6)	\$2.7	2,126	222
6	Glenarm - Windy Edge	Line	BGE	(\$4.9)	(\$6.9)	(\$0.1)	\$1.9	\$0.1	\$0.2	\$0.2	\$0.1	\$2.0	1,802	844
7	Middletown Jct - Three Mile Island	Line	Met-Ed	\$0.6	(\$1.0)	\$0.1	\$1.7	\$0.0	\$0.0	\$0.0	\$0.0	\$1.7	276	0
8	Hummelstown - Middletown Jct	Line	Met-Ed	\$0.1	(\$0.3)	\$0.0	\$0.4	\$0.2	(\$1.3)	(\$0.5)	\$1.0	\$1.3	46	34
9	East	Interface	500	\$1.1	(\$0.2)	(\$0.2)	\$1.1	\$0.0	\$0.0	\$0.1	\$0.1	\$1.1	1,080	32
10	Hunterstown	Transformer	Met-Ed	\$1.2	\$0.2	\$0.1	\$1.1	\$0.0	\$0.0	\$0.0	\$0.0	\$1.1	490	0
11	Person - Halifax	Flowgate	MISO	\$2.9	\$3.7	(\$0.2)	(\$1.1)	\$0.0	(\$0.0)	(\$0.0)	(\$0.0)	(\$1.1)	2,824	12
12	Middletown Jct - Brunner Island	Line	PPL	(\$0.3)	(\$1.1)	\$0.0	\$0.9	\$0.0	\$0.0	\$0.0	\$0.0	\$0.9	296	0
13	West	Interface	500	\$3.0	\$3.9	\$0.1	(\$0.9)	\$0.0	\$0.0	(\$0.0)	\$0.0	(\$0.9)	638	98
14	Wescosville	Transformer	PPL	\$0.8	\$0.2	\$0.2	\$0.8	\$0.0	\$0.0	(\$0.0)	\$0.0	\$0.8	428	22
15	Mahans Lane - Tidd	Line	AEP	\$2.6	\$3.4	\$0.0	(\$0.8)	\$0.1	\$0.0	(\$0.0)	\$0.0	(\$0.8)	2,098	788
20	Jackson - North Hanover	Line	Met-Ed	\$0.4	\$0.1	\$0.0	\$0.3	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$0.3	84	4
22	Ironwood - South Lebanon	Line	Met-Ed	\$0.0	(\$0.3)	(\$0.0)	\$0.3	\$0.0	\$0.0	\$0.0	\$0.0	\$0.3	32	0
24	Three Mile Island	Transformer	Met-Ed	\$0.5	\$0.4	\$0.1	\$0.3	\$0.0	(\$0.0)	(\$0.1)	(\$0.0)	\$0.3	208	54
28	Middletown Jct - Yorkhaven	Line	Met-Ed	\$0.1	\$0.0	\$0.2	\$0.2	\$0.0	\$0.0	\$0.0	\$0.0	\$0.2	710	0
33	Brunner Island - Yorkanna	Line	Met-Ed	\$0.1	(\$0.1)	\$0.0	\$0.2	\$0.0	\$0.0	\$0.0	\$0.0	\$0.2	104	0

Table G-12 Met-Ed Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	Bagley - Graceton	Line	BGE	(\$28.6)	(\$42.6)	(\$2.0)	\$11.9	\$0.6	\$1.0	\$2.0	\$1.6	\$13.5	9,168	3,768
2	West	Interface	500	\$65.9	\$76.6	\$0.3	(\$10.5)	\$1.0	\$3.6	(\$0.5)	(\$3.0)	(\$13.5)	3,068	830
3	Wescosville	Transformer	PPL	\$1.5	(\$0.1)	\$0.2	\$1.8	\$0.0	(\$0.0)	\$0.0	\$0.0	\$1.8	2,390	8
4	Graceton - Safe Harbor	Line	BGE	(\$3.8)	(\$5.1)	(\$0.3)	\$1.0	\$0.1	\$0.5	\$0.8	\$0.4	\$1.3	3,562	802
5	5004/5005 Interface	Interface	500	\$4.1	\$4.4	(\$0.0)	(\$0.4)	\$0.6	\$1.3	\$0.0	(\$0.7)	(\$1.0)	1,108	672
6	Readington - Roseland	Line	PSEG	(\$5.8)	(\$6.9)	(\$0.1)	\$1.0	(\$0.0)	\$0.0	\$0.1	(\$0.0)	\$1.0	2,338	378
7	Cloverdale	Transformer	AEP	\$4.1	\$5.1	\$0.1	(\$0.9)	\$0.1	\$0.1	(\$0.0)	(\$0.1)	(\$1.0)	8,246	572
8	Cook - Palisades	Flowgate	MISO	\$3.0	\$3.9	\$0.0	(\$0.9)	\$0.0	(\$0.0)	(\$0.1)	(\$0.0)	(\$0.9)	4,632	616
9	Brunner Island - Yorkanna	Line	Met-Ed	\$0.1	(\$0.7)	\$0.0	\$0.8	\$0.0	\$0.0	\$0.0	\$0.0	\$0.8	216	0
10	AP South	Interface	500	\$5.8	\$6.5	\$0.5	(\$0.3)	\$0.3	\$0.3	(\$0.5)	(\$0.5)	(\$0.8)	10,180	1,962
11	Benton Harbor - Palisades	Flowgate	MISO	\$4.8	\$5.6	\$0.1	(\$0.7)	\$0.0	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.7)	6,050	274
12	Northwood	Transformer	Met-Ed	\$0.9	\$0.3	\$0.0	\$0.6	(\$0.0)	(\$0.0)	(\$0.1)	(\$0.1)	\$0.6	578	76
13	Brambleton - Loudoun	Line	Dominion	\$3.6	\$4.1	\$0.0	(\$0.5)	\$0.0	\$0.1	(\$0.0)	(\$0.1)	(\$0.6)	194	28
14	Wolf Creek	Transformer	AEP	\$0.9	\$1.2	\$0.0	(\$0.3)	\$0.1	\$0.3	(\$0.0)	(\$0.3)	(\$0.6)	10,204	262
15	Conastone - Northwest	Line	BGE	(\$1.1)	(\$1.5)	(\$0.1)	\$0.3	\$0.0	\$0.0	\$0.2	\$0.2	\$0.5	206	216
21	Jackson - Three Mile Island	Line	Met-Ed	\$0.1	(\$0.2)	\$0.0	\$0.3	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$0.3	156	4
23	Hunterstown	Transformer	Met-Ed	\$0.3	\$0.0	\$0.2	\$0.5	\$0.0	\$0.0	(\$0.1)	(\$0.1)	\$0.3	950	10
38	Middletown Jct - Yorkhaven	Line	Met-Ed	\$0.0	\$0.0	\$0.1	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	2,084	0
41	Gardners - Texas East	Line	Met-Ed	\$0.1	(\$0.0)	\$0.0	\$0.2	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$0.1	178	0
47	Ironwood - South Lebanon	Line	Met-Ed	(\$0.0)	(\$0.1)	(\$0.0)	\$0.1	(\$0.0)	\$0.0	(\$0.0)	(\$0.0)	\$0.1	142	0

PECO Control Zone

Table G-13 PECO Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	Bagley - Graceton	Line	BGE	(\$75.6)	(\$112.1)	(\$1.6)	\$34.9	\$1.4	\$1.5	\$1.7	\$1.6	\$36.4	7,088	3,946
2	Conastone - Northwest	Line	BGE	(\$71.9)	(\$109.5)	(\$1.9)	\$35.7	\$1.0	\$3.1	\$2.2	\$0.1	\$35.9	5,072	3,468
3	5004/5005 Interface	Interface	500	\$54.2	\$60.2	\$0.1	(\$5.9)	\$1.5	\$2.5	(\$0.7)	(\$1.7)	(\$7.6)	1,356	642
4	East	Interface	500	\$17.3	\$10.7	(\$0.1)	\$6.4	\$0.0	(\$0.3)	\$0.0	\$0.3	\$6.8	1,080	32
5	Glenarm - Windy Edge	Line	BGE	(\$11.1)	(\$16.6)	(\$0.4)	\$5.2	\$0.1	\$0.4	\$0.5	\$0.2	\$5.3	1,802	844
6	Central	Interface	500	\$19.7	\$24.2	\$0.1	(\$4.5)	\$0.1	(\$0.1)	(\$0.2)	(\$0.1)	(\$4.6)	582	82
7	Emilie	Transformer	PECO	(\$0.0)	(\$3.9)	(\$0.1)	\$3.9	\$0.2	(\$0.2)	\$0.1	\$0.4	\$4.3	1,776	416
8	Bedington - Black Oak	Interface	500	\$8.7	\$12.0	\$0.0	(\$3.3)	\$0.2	\$0.2	(\$0.0)	\$0.0	(\$3.3)	5,866	688
9	West	Interface	500	\$7.7	\$9.6	\$0.1	(\$1.9)	\$0.1	\$0.0	(\$0.0)	\$0.0	(\$1.9)	638	98
10	Burlington - Croydon	Line	PECO	(\$1.3)	(\$2.8)	(\$0.0)	\$1.5	\$0.1	(\$0.1)	\$0.1	\$0.4	\$1.9	1,760	428
11	Person - Halifax	Flowgate	MISO	\$7.1	\$8.6	(\$0.2)	(\$1.7)	\$0.0	\$0.0	(\$0.0)	(\$0.0)	(\$1.7)	2,824	12
12	Peachbottom	Transformer	PECO	\$0.7	(\$1.0)	(\$0.1)	\$1.7	\$0.0	\$0.0	\$0.0	\$0.0	\$1.7	174	0
13	AP South	Interface	500	\$2.9	\$4.3	(\$0.0)	(\$1.4)	\$0.0	\$0.0	(\$0.0)	(\$0.0)	(\$1.4)	2,570	84
14	Graceton	Transformer	BGE	(\$3.2)	(\$4.5)	(\$0.1)	\$1.3	\$0.0	\$0.0	\$0.0	\$0.1	\$1.3	540	176
15	Burnham - Munster	Flowgate	MISO	\$2.5	\$3.9	\$0.0	(\$1.3)	\$0.0	\$0.0	\$0.0	\$0.0	(\$1.3)	3,496	0
17	Conastone - Peach Bottom	Line	PECO	(\$1.2)	(\$2.3)	\$0.0	\$1.2	\$0.1	\$0.2	\$0.0	(\$0.0)	\$1.1	460	146
20	Plymouth Meeting - Whitpain	Line	PECO	\$1.4	\$0.5	\$0.1	\$1.0	\$0.0	\$0.0	\$0.0	\$0.0	\$1.0	82	0
21	Chichester - Eddystone	Line	PECO	\$0.9	\$0.0	\$0.0	\$1.0	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$1.0	200	50
28	Cromby - Moser	Line	PECO	\$1.2	\$0.2	\$0.0	\$1.0	(\$0.1)	\$0.2	(\$0.1)	(\$0.4)	\$0.6	904	184
32	Emilie - Falls	Line	PECO	(\$3.9)	(\$4.7)	(\$0.2)	\$0.6	(\$0.1)	\$0.2	\$0.2	(\$0.1)	\$0.5	2,318	536

Table G-14 PECO Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	Bagley - Graceton	Line	BGE	(\$88.5)	(\$131.2)	(\$2.9)	\$39.8	\$1.5	\$1.8	\$2.7	\$2.4	\$42.3	9,168	3,768
2	West	Interface	500	\$200.4	\$233.8	\$0.4	(\$33.1)	\$1.9	\$6.3	(\$0.5)	(\$4.8)	(\$37.9)	3,068	830
3	Burlington - Croydon	Line	PECO	(\$5.8)	(\$15.9)	(\$0.3)	\$9.8	\$0.0	\$0.3	\$0.3	(\$0.0)	\$9.8	9,942	1,088
4	AP South	Interface	500	\$16.6	\$25.5	\$0.1	(\$8.8)	\$0.5	\$1.1	\$0.1	(\$0.5)	(\$9.3)	10,180	1,962
5	East	Interface	500	\$20.5	\$14.4	\$0.3	\$6.4	\$0.1	\$0.1	(\$0.1)	(\$0.1)	\$6.4	3,468	34
6	Bedington - Black Oak	Interface	500	\$10.5	\$14.4	\$0.2	(\$3.7)	\$0.2	\$0.2	(\$0.3)	(\$0.3)	(\$4.0)	5,592	646
7	Central	Interface	500	\$12.7	\$15.8	(\$0.0)	(\$3.1)	\$0.0	\$0.1	(\$0.1)	(\$0.1)	(\$3.2)	668	20
8	Benton Harbor - Palisades	Flowgate	MISO	\$15.6	\$18.3	\$0.1	(\$2.7)	\$0.0	(\$0.0)	(\$0.0)	\$0.1	(\$2.6)	6,050	274
9	Plymouth Meeting - Whitpain	Line	PECO	\$4.5	\$2.1	\$0.6	\$3.0	(\$0.0)	\$0.1	(\$0.3)	(\$0.4)	\$2.6	836	20
10	Graceton - Safe Harbor	Line	BGE	(\$3.7)	(\$6.5)	\$0.2	\$2.9	(\$0.1)	\$0.1	(\$0.3)	(\$0.4)	\$2.5	3,562	802
11	Cloverdale	Transformer	AEP	\$12.3	\$14.7	\$0.1	(\$2.4)	\$0.1	\$0.2	(\$0.0)	(\$0.1)	(\$2.4)	8,246	572
12	Readington - Roseland	Line	PSEG	(\$24.8)	(\$27.5)	(\$0.7)	\$2.0	(\$0.1)	\$0.1	\$0.4	\$0.2	\$2.2	2,338	378
13	5004/5005 Interface	Interface	500	\$12.3	\$14.2	\$0.1	(\$1.8)	\$1.1	\$1.1	(\$0.3)	(\$0.3)	(\$2.1)	1,108	672
14	Conastone - Northwest	Line	BGE	(\$3.4)	(\$5.6)	(\$0.1)	\$2.1	\$0.1	\$0.2	\$0.1	(\$0.0)	\$2.1	206	216
15	Keeney	Transformer	DPL	\$3.3	\$1.3	\$0.3	\$2.2	\$0.0	(\$0.1)	(\$0.3)	(\$0.2)	\$2.1	6,198	116
19	Peachbottom	Transformer	PECO	\$0.5	(\$1.0)	\$0.0	\$1.5	\$0.0	\$0.0	\$0.0	\$0.0	\$1.5	390	0
20	Emilie	Transformer	PECO	\$0.2	(\$1.7)	\$0.1	\$2.1	\$0.0	\$0.3	(\$0.3)	(\$0.6)	\$1.5	2,022	418
30	Eddington - Holmesburg	Line	PECO	(\$0.0)	(\$0.6)	(\$0.0)	\$0.5	\$0.0	\$0.0	\$0.0	\$0.0	\$0.5	182	0
43	Gen Lead Emilie - Ford Mill	Line	PECO	(\$0.0)	(\$0.3)	\$0.1	\$0.4	\$0.0	\$0.0	\$0.0	\$0.0	\$0.4	1,082	0
46	Emilie - Falls	Line	PECO	(\$1.1)	(\$1.5)	(\$0.0)	\$0.4	(\$0.2)	\$0.1	\$0.3	(\$0.0)	\$0.3	854	0

PENELEC Control Zone

Table G-15 PENELEC Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	5004/5005 Interface	Interface	500	(\$35.6)	(\$74.2)	(\$2.3)	\$36.3	\$0.6	\$7.1	\$2.1	(\$4.4)	\$31.9	1,356	642
2	Conastone - Northwest	Line	BGE	(\$27.1)	(\$38.1)	(\$0.2)	\$10.8	\$0.8	\$2.3	\$0.1	(\$1.4)	\$9.4	5,072	3,468
3	Bagley - Graceton	Line	BGE	(\$28.4)	(\$38.2)	\$0.2	\$9.9	\$0.6	\$1.3	\$0.0	(\$0.6)	\$9.3	7,088	3,946
4	Bedington - Black Oak	Interface	500	(\$23.4)	(\$32.7)	(\$0.4)	\$9.0	\$0.3	\$0.3	\$0.1	(\$0.1)	\$9.1	5,866	688
5	Mahans Lane - Tidd	Line	AEP	\$8.4	\$13.8	\$0.1	(\$5.2)	(\$0.1)	(\$0.2)	(\$0.2)	(\$0.1)	(\$5.3)	2,098	788
6	Central	Interface	500	(\$3.4)	(\$8.8)	(\$0.5)	\$4.8	(\$0.0)	\$0.1	\$0.1	(\$0.0)	\$4.8	582	82
7	AP South	Interface	500	(\$10.5)	(\$15.1)	(\$0.2)	\$4.4	\$0.1	\$0.1	\$0.0	\$0.0	\$4.4	2,570	84
8	Dravosburg - West Mifflin	Line	DLCO	\$6.0	\$9.9	(\$0.0)	(\$4.0)	(\$0.1)	\$0.1	(\$0.0)	(\$0.1)	(\$4.1)	904	514
9	SENECA	Interface	PENELEC	\$0.6	\$2.1	\$0.8	(\$0.7)	(\$0.4)	\$0.6	(\$2.0)	(\$3.0)	(\$3.7)	1,876	2,364
10	West	Interface	500	(\$3.7)	(\$7.7)	(\$0.2)	\$3.7	\$0.0	\$0.4	\$0.1	(\$0.3)	\$3.5	638	98
11	Person - Halifax	Flowgate	MISO	\$3.8	\$6.5	\$0.0	(\$2.7)	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	(\$2.7)	2,824	12
12	Glenarm - Windy Edge	Line	BGE	(\$5.0)	(\$7.3)	\$0.0	\$2.4	\$0.2	\$0.1	\$0.1	\$0.1	\$2.5	1,802	844
13	East	Interface	500	(\$4.2)	(\$6.8)	(\$0.3)	\$2.3	\$0.0	\$0.1	\$0.1	\$0.0	\$2.3	1,080	32
14	Hoyt Dale - Maple	Line	ATSI	\$3.2	\$5.2	\$0.0	(\$2.0)	(\$0.3)	(\$0.1)	\$0.0	(\$0.1)	(\$2.1)	142	170
15	Edgewood - Shelocta	Line	PENELEC	\$4.8	\$3.2	\$0.1	\$1.7	(\$0.0)	(\$0.5)	(\$0.2)	\$0.3	\$2.0	284	26
18	Niles Valley - Sabinsville	Line	PENELEC	\$0.5	\$0.4	(\$0.0)	\$0.1	(\$0.6)	\$0.1	(\$0.5)	(\$1.2)	(\$1.2)	134	254
20	Falconer - Warren	Line	PENELEC	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	\$0.3	(\$0.9)	(\$1.1)	(\$1.1)	0	16
27	Lewis Run	Transformer	PENELEC	\$0.5	(\$0.3)	\$0.0	\$0.8	(\$0.0)	\$0.1	\$0.2	\$0.0	\$0.8	492	36
33	Homer City	Transformer	PENELEC	\$0.1	(\$0.7)	\$0.0	\$0.8	(\$0.0)	\$0.1	(\$0.1)	(\$0.1)	\$0.7	644	288
38	East Towanda - Tennessee Gas Tap	Line	PENELEC	\$0.5	\$0.2	\$0.2	\$0.6	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$0.6	1,918	12

Table G-16 PENELEC Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	West	Interface	500	(\$42.0)	(\$119.3)	(\$8.6)	\$68.8	\$0.8	\$6.8	\$2.1	(\$3.9)	\$64.8	3,068	830
2	AP South	Interface	500	(\$89.0)	(\$129.0)	(\$1.4)	\$38.6	\$2.4	\$8.4	\$1.9	(\$4.1)	\$34.5	10,180	1,962
3	SENECA	Interface	PENELEC	\$5.6	\$9.9	\$2.6	(\$1.8)	(\$3.0)	\$1.2	(\$8.0)	(\$12.2)	(\$14.0)	7,124	6,454
4	Bagley - Graceton	Line	BGE	(\$30.2)	(\$44.1)	(\$0.8)	\$13.1	\$0.9	\$1.6	\$1.3	\$0.6	\$13.7	9,168	3,768
5	Bedington - Black Oak	Interface	500	(\$16.6)	(\$24.3)	\$0.3	\$8.0	\$0.2	\$0.3	(\$0.4)	(\$0.5)	\$7.4	5,592	646
6	5004/5005 Interface	Interface	500	(\$4.2)	(\$11.7)	(\$0.8)	\$6.7	\$0.4	\$2.3	\$2.0	\$0.1	\$6.8	1,108	672
7	Corry East - Warren	Line	PENELEC	\$1.9	\$1.2	(\$0.0)	\$0.7	(\$5.4)	\$0.8	(\$0.3)	(\$6.5)	(\$5.8)	846	1,074
8	Benton Harbor - Palisades	Flowgate	MISO	\$17.2	\$21.4	(\$0.8)	(\$5.0)	\$0.0	(\$0.0)	\$0.2	\$0.2	(\$4.8)	6,050	274
9	Homer City - Shelocta	Line	PENELEC	(\$14.3)	(\$17.7)	(\$0.2)	\$3.1	\$0.1	\$0.4	\$0.6	\$0.3	\$3.4	1,054	76
10	Cook - Palisades	Flowgate	MISO	\$10.7	\$13.9	(\$0.8)	(\$4.0)	\$0.1	\$0.1	\$0.8	\$0.8	(\$3.2)	4,632	616
11	Cloverdale	Transformer	AEP	\$4.6	\$7.8	\$0.9	(\$2.2)	(\$0.0)	(\$0.1)	(\$0.5)	(\$0.4)	(\$2.6)	8,246	572
12	USAP - Woodville	Line	DLCO	\$2.9	\$5.4	\$0.1	(\$2.4)	\$0.0	\$0.0	(\$0.2)	(\$0.2)	(\$2.6)	1,490	244
13	Central	Interface	500	(\$0.5)	(\$3.4)	(\$0.4)	\$2.5	\$0.0	\$0.1	\$0.0	(\$0.1)	\$2.4	668	20
14	Readington - Roseland	Line	PSEG	\$6.2	\$2.9	(\$2.4)	\$1.0	\$0.0	\$0.0	\$1.3	\$1.2	\$2.2	2,338	378
15	East	Interface	500	(\$3.1)	(\$5.8)	(\$0.6)	\$2.1	(\$0.0)	\$0.1	\$0.1	\$0.0	\$2.1	3,468	34
16	Timblin - Trade City	Line	PENELEC	(\$2.1)	(\$5.9)	(\$0.1)	\$3.7	(\$0.6)	\$1.6	\$0.5	(\$1.8)	\$1.9	1,082	398
19	Goudey - Laurel Lake	Line	PENELEC	\$3.0	\$1.2	\$0.1	\$1.9	(\$0.0)	(\$0.1)	(\$0.3)	(\$0.2)	\$1.7	788	52
27	Glade - Forest	Line	PENELEC	\$3.9	\$0.5	(\$0.5)	\$2.9	(\$1.5)	\$0.9	(\$1.5)	(\$3.8)	(\$1.0)	1,196	266
35	Seneca	Transformer	PENELEC	(\$0.1)	\$0.1	\$0.9	\$0.8	\$0.0	\$0.0	\$0.0	\$0.0	\$0.8	3,848	80
42	Morgan Street - Venango Jct	Line	PENELEC	(\$0.1)	(\$0.8)	(\$0.0)	\$0.7	\$0.0	\$0.1	(\$0.1)	(\$0.1)	\$0.6	350	26

Pepco Control Zone

Table G-17 Pepco Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	Bagley - Graceton	Line	BGE	\$93.1	\$60.1	\$2.2	\$35.2	(\$0.5)	(\$0.7)	(\$1.9)	(\$1.7)	\$33.5	7,088	3,946
2	Conastone - Northwest	Line	BGE	\$99.7	\$68.1	\$2.3	\$33.9	(\$0.9)	(\$2.1)	(\$2.7)	(\$1.5)	\$32.4	5,072	3,468
3	Bedington - Black Oak	Interface	500	\$52.7	\$39.4	\$0.5	\$13.8	(\$0.1)	(\$0.2)	(\$0.3)	(\$0.1)	\$13.6	5,866	688
4	BCPEP	Interface	Pepco	\$31.0	\$20.6	\$0.9	\$11.2	\$0.0	\$0.0	\$0.0	\$0.0	\$11.2	1,792	0
5	Person - Halifax	Flowgate	MISO	\$28.9	\$22.2	\$0.1	\$6.8	\$0.0	(\$0.0)	(\$0.0)	\$0.0	\$6.9	2,824	12
6	AP South	Interface	500	\$25.5	\$19.0	\$0.2	\$6.8	(\$0.0)	(\$0.0)	(\$0.1)	(\$0.1)	\$6.8	2,570	84
7	Glenarm - Windy Edge	Line	BGE	\$16.5	\$11.4	\$0.5	\$5.6	(\$0.2)	(\$0.2)	(\$0.5)	(\$0.5)	\$5.1	1,802	844
8	5004/5005 Interface	Interface	500	\$8.8	\$6.4	(\$0.3)	\$2.0	\$0.1	(\$0.0)	\$0.5	\$0.6	\$2.6	1,356	642
9	Central	Interface	500	(\$8.9)	(\$6.6)	(\$0.3)	(\$2.6)	\$0.0	\$0.0	\$0.1	\$0.1	(\$2.5)	582	82
10	AEP - DOM	Interface	500	\$10.1	\$7.9	(\$0.0)	\$2.2	(\$0.0)	\$0.0	\$0.0	(\$0.0)	\$2.2	2,656	88
11	East	Interface	500	(\$6.5)	(\$5.0)	(\$0.4)	(\$1.9)	(\$0.0)	\$0.0	\$0.0	\$0.0	(\$1.9)	1,080	32
12	Joshua Falls	Transformer	AEP	\$6.8	\$5.3	\$0.0	\$1.6	\$0.1	\$0.0	\$0.0	\$0.1	\$1.6	1,128	108
13	Dravosburg - West Mifflin	Line	DLCO	\$6.4	\$4.9	\$0.0	\$1.5	\$0.2	\$0.1	(\$0.0)	\$0.1	\$1.6	904	514
14	Valley	Transformer	Dominion	\$6.8	\$5.2	\$0.1	\$1.7	(\$0.1)	(\$0.0)	(\$0.0)	(\$0.1)	\$1.6	1,736	180
15	Graceton - Safe Harbor	Line	BGE	\$4.2	\$2.6	\$0.1	\$1.7	\$0.0	\$0.0	(\$0.1)	(\$0.1)	\$1.5	890	266
36	Pumphrey	Transformer	Pepco	(\$0.8)	(\$0.5)	(\$0.0)	(\$0.3)	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.3)	498	0
42	Buzzard Point	Transformer	Pepco	\$0.3	\$0.0	\$0.0	\$0.2	\$0.0	\$0.0	\$0.0	\$0.0	\$0.2	44	0
47	Blue Plains - Palmers Corner	Line	Pepco	\$0.3	\$0.1	\$0.0	\$0.2	\$0.0	\$0.0	\$0.0	\$0.0	\$0.2	70	0
54	Blue Plains - Potomac	Line	Pepco	\$0.3	\$0.1	\$0.0	\$0.2	\$0.0	\$0.0	\$0.0	\$0.0	\$0.2	40	0
68	Bethesda - O St.	Line	Pepco	\$0.3	\$0.2	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	28	0

Table G-18 Pepco Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	AP South	Interface	500	\$194.8	\$148.5	\$5.8	\$52.1	\$2.1	\$1.8	(\$6.2)	(\$6.0)	\$46.1	10,180	1,962
2	Bagley - Graceton	Line	BGE	\$102.7	\$75.1	\$2.7	\$30.3	\$0.4	(\$1.5)	(\$2.0)	(\$0.1)	\$30.2	9,168	3,768
3	West	Interface	500	\$92.6	\$66.0	(\$9.4)	\$17.2	\$0.6	\$0.2	\$1.6	\$2.0	\$19.2	3,068	830
4	BCPEP	Interface	Pepco	\$50.4	\$35.7	\$1.7	\$16.4	(\$2.4)	(\$2.6)	(\$1.6)	(\$1.4)	\$15.0	1,914	82
5	Bedington - Black Oak	Interface	500	\$48.9	\$36.4	\$1.7	\$14.2	\$0.0	\$0.3	(\$1.5)	(\$1.7)	\$12.5	5,592	646
6	Cloverdale	Transformer	AEP	\$25.5	\$19.3	\$0.9	\$7.1	\$0.3	\$0.0	(\$0.5)	(\$0.2)	\$6.8	8,246	572
7	Brambleton - Loudoun	Line	Dominion	\$22.5	\$16.9	\$0.3	\$5.8	\$0.0	(\$0.0)	(\$0.1)	(\$0.0)	\$5.8	194	28
8	Readington - Roseland	Line	PSEG	(\$11.5)	(\$8.6)	(\$1.0)	(\$4.0)	\$0.1	\$0.3	\$0.7	\$0.4	(\$3.6)	2,338	378
9	Benton Harbor - Palisades	Flowgate	MISO	\$7.8	\$5.8	\$0.3	\$2.3	\$0.0	(\$0.0)	(\$0.1)	(\$0.0)	\$2.3	6,050	274
10	East	Interface	500	(\$6.4)	(\$4.8)	(\$0.5)	(\$2.1)	(\$0.0)	(\$0.0)	\$0.1	\$0.1	(\$2.0)	3,468	34
11	Graceton - Safe Harbor	Line	BGE	\$7.4	\$5.5	\$0.3	\$2.1	\$0.2	(\$0.0)	(\$0.6)	(\$0.3)	\$1.8	3,562	802
12	Central	Interface	500	(\$4.5)	(\$3.4)	(\$0.3)	(\$1.4)	\$0.0	(\$0.0)	\$0.0	\$0.1	(\$1.3)	668	20
13	Wolf Creek	Transformer	AEP	\$4.2	\$3.2	\$0.2	\$1.3	\$0.3	(\$0.1)	(\$0.2)	\$0.1	\$1.3	10,204	262
14	Michigan City - Laporte	Flowgate	MISO	\$4.2	\$3.0	\$0.1	\$1.3	\$0.0	\$0.0	\$0.0	\$0.0	\$1.3	6,222	0
15	Cook - Palisades	Flowgate	MISO	\$4.6	\$3.5	\$0.2	\$1.3	\$0.0	(\$0.1)	(\$0.1)	(\$0.0)	\$1.3	4,632	616
20	Oak Grove - Chalk Point	Line	Pepco	\$0.5	(\$0.4)	\$0.0	\$0.9	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$0.9	54	16
25	Dickerson - Pleasant View	Line	Pepco	\$2.6	\$1.9	\$0.1	\$0.8	\$0.0	\$0.0	\$0.0	\$0.0	\$0.8	38	0
50	Potomac	Transformer	Pepco	\$0.4	\$0.1	\$0.0	\$0.3	\$0.0	\$0.0	\$0.0	\$0.0	\$0.3	302	0
62	Dickerson - Dickerson Station	Line	Pepco	\$0.2	\$0.2	\$0.0	\$0.0	(\$0.1)	\$0.1	(\$0.0)	(\$0.2)	(\$0.2)	152	0
103	Pumphrey	Transformer	Pepco	(\$0.1)	(\$0.1)	(\$0.0)	(\$0.1)	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.1)	108	0

PPL Control Zone

Table G-19 PPL Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	5004/5005 Interface	Interface	500	\$78.1	\$91.7	\$1.5	(\$12.1)	\$1.0	(\$0.8)	(\$4.4)	(\$2.7)	(\$14.7)	1,356	642
2	Bagley - Graceton	Line	BGE	(\$74.8)	(\$88.4)	(\$0.7)	\$12.9	\$1.3	\$1.1	\$0.8	\$0.9	\$13.8	7,088	3,946
3	Conastone - Northwest	Line	BGE	(\$71.5)	(\$84.8)	(\$1.1)	\$12.2	\$0.7	\$2.5	\$1.2	(\$0.5)	\$11.7	5,072	3,468
4	Wescosville	Transformer	PPL	\$9.2	\$5.4	\$0.6	\$4.4	\$0.1	(\$0.2)	(\$0.2)	\$0.2	\$4.6	428	22
5	Central	Interface	500	\$18.4	\$21.6	(\$0.0)	(\$3.2)	\$0.0	\$0.1	(\$0.2)	(\$0.2)	(\$3.5)	582	82
6	Hummelstown - Middletown Jct	Line	Met-Ed	\$0.5	\$0.2	\$0.0	\$0.3	\$0.2	(\$1.3)	(\$0.5)	\$1.0	\$1.3	46	34
7	West	Interface	500	\$8.7	\$10.1	\$0.1	(\$1.2)	\$0.0	\$0.0	(\$0.0)	(\$0.0)	(\$1.3)	638	98
8	East	Interface	500	\$0.3	(\$0.8)	(\$0.1)	\$1.0	\$0.0	(\$0.0)	\$0.0	\$0.1	\$1.1	1,080	32
9	Jackson - Three Mile Island	Line	Met-Ed	\$0.7	\$0.1	\$0.2	\$0.8	\$0.1	(\$0.5)	(\$0.3)	\$0.3	\$1.1	408	92
10	Mahans Lane - Tidd	Line	AEP	\$7.7	\$8.7	\$0.0	(\$0.9)	\$0.0	(\$0.0)	(\$0.0)	\$0.0	(\$0.9)	2,098	788
11	Middletown Jct - Brunner Island	Line	PPL	(\$0.2)	(\$0.9)	\$0.1	\$0.8	\$0.0	\$0.0	\$0.0	\$0.0	\$0.8	296	0
12	Three Mile Island	Transformer	Met-Ed	\$0.1	(\$0.6)	\$0.0	\$0.8	\$0.1	\$0.0	(\$0.1)	(\$0.0)	\$0.8	208	54
13	Conastone - Otter Creek	Line	PPL	(\$3.5)	(\$4.3)	(\$0.1)	\$0.8	\$0.1	\$0.2	\$0.1	(\$0.0)	\$0.8	376	270
14	Glenarm - Windy Edge	Line	BGE	(\$13.4)	(\$13.0)	(\$0.2)	(\$0.6)	\$0.2	(\$0.9)	\$0.2	\$1.4	\$0.7	1,802	844
15	Person - Halifax	Flowgate	MISO	\$8.6	\$9.2	(\$0.1)	(\$0.7)	\$0.0	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.7)	2,824	12
17	Siegfried	Transformer	PPL	\$0.3	(\$0.4)	(\$0.0)	\$0.7	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$0.7	62	2
28	Brunner Island - Middletown	Line	PPL	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.2)	\$0.1	(\$0.1)	(\$0.4)	(\$0.4)	0	166
31	Jenkins - Susquehanna	Line	PPL	\$0.0	(\$0.3)	(\$0.0)	\$0.4	\$0.0	\$0.0	\$0.0	\$0.0	\$0.4	44	0
34	Alburtis	Transformer	PPL	(\$0.0)	(\$0.1)	\$0.0	\$0.1	\$0.0	\$0.2	(\$0.3)	(\$0.4)	(\$0.3)	44	12
40	Brunner Island - Yorkanna	Line	PPL	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.1)	\$0.2	\$0.0	(\$0.3)	(\$0.3)	0	58

Table G-20 PPL Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	West	Interface	500	\$203.2	\$223.4	\$1.3	(\$18.9)	\$2.6	\$8.1	(\$1.2)	(\$6.7)	(\$25.6)	3,068	830
2	Wescosville	Transformer	PPL	\$33.0	\$19.2	\$2.4	\$16.2	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$16.2	2,390	8
3	5004/5005 Interface	Interface	500	\$14.8	\$17.6	\$0.2	(\$2.6)	\$1.2	\$3.3	(\$1.9)	(\$4.1)	(\$6.7)	1,108	672
4	Bagley - Graceton	Line	BGE	(\$76.1)	(\$80.6)	(\$2.0)	\$2.4	\$0.7	\$1.2	\$2.0	\$1.5	\$3.9	9,168	3,768
5	AP South	Interface	500	\$3.1	(\$0.1)	(\$0.6)	\$2.6	\$0.1	(\$0.0)	\$0.8	\$1.0	\$3.6	10,180	1,962
6	Susquehanna	Transformer	PPL	\$0.0	\$0.0	\$0.0	\$0.0	\$1.5	(\$1.8)	(\$1.1)	\$2.2	\$2.2	36	42
7	Benton Harbor - Palisades	Flowgate	MISO	\$16.1	\$18.3	\$0.2	(\$2.1)	\$0.0	\$0.0	(\$0.0)	(\$0.0)	(\$2.1)	6,050	274
8	Readington - Roseland	Line	PSEG	(\$16.2)	(\$18.4)	(\$1.2)	\$1.1	(\$0.0)	(\$0.4)	\$0.6	\$0.9	\$2.1	2,338	378
9	Central	Interface	500	\$10.6	\$12.2	(\$0.2)	(\$1.9)	\$0.0	\$0.1	(\$0.1)	(\$0.1)	(\$2.0)	668	20
10	Cook - Palisades	Flowgate	MISO	\$10.0	\$12.0	\$0.1	(\$1.9)	\$0.0	\$0.1	(\$0.0)	(\$0.1)	(\$2.0)	4,632	616
11	Cloverdale	Transformer	AEP	\$11.5	\$12.3	\$0.1	(\$0.7)	\$0.1	\$0.6	(\$0.0)	(\$0.6)	(\$1.3)	8,246	572
12	Cedar Grove - Roseland	Line	PSEG	(\$0.9)	(\$1.1)	(\$0.0)	\$0.1	\$0.1	(\$0.5)	\$0.5	\$1.0	\$1.2	660	364
13	Northwood	Transformer	Met-Ed	(\$2.3)	(\$3.6)	(\$0.5)	\$0.8	(\$0.0)	\$0.2	\$0.5	\$0.3	\$1.2	578	76
14	Wolf Creek	Transformer	AEP	\$2.4	\$2.8	(\$0.0)	(\$0.3)	\$0.2	\$0.9	(\$0.0)	(\$0.8)	(\$1.1)	10,204	262
15	Lakeview - Greenfield	Line	ATSI	\$4.3	\$4.6	\$0.1	(\$0.2)	\$0.2	\$1.0	(\$0.1)	(\$0.9)	(\$1.1)	1,828	312
16	Sunbury	Transformer	PPL	\$0.2	\$0.0	\$0.6	\$0.8	\$0.0	(\$0.3)	(\$0.1)	\$0.3	\$1.0	9,594	8
22	Quarry - Steel City	Line	PPL	\$0.1	(\$0.3)	\$0.1	\$0.5	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.5	556	52
25	Face Rock	Transformer	PPL	(\$0.9)	(\$1.5)	(\$0.1)	\$0.5	\$0.0	\$0.0	\$0.0	\$0.0	\$0.5	952	0

PSEG Control Zone

Table G-21 PSEG Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	Bergen - New Milford	Line	PSEG	\$30.9	\$28.7	\$17.4	\$19.6	(\$8.1)	\$5.2	(\$48.4)	(\$61.7)	(\$42.1)	5,940	1,590
2	49th Street - Hoboken	Line	PSEG	\$0.0	\$0.0	\$0.0	\$0.0	(\$2.7)	(\$0.8)	(\$14.0)	(\$15.9)	(\$15.9)	0	788
3	Maywood - Saddlebrook	Line	PSEG	\$21.8	\$18.6	\$6.4	\$9.6	(\$4.5)	\$2.6	(\$18.2)	(\$25.3)	(\$15.7)	6,912	1,018
4	49 Street - Hoboken	Line	PSEG	\$3.3	(\$0.7)	\$7.2	\$11.3	\$0.0	\$0.0	\$0.0	\$0.0	\$11.3	3,286	0
5	Bagley - Graceton	Line	BGE	(\$77.6)	(\$78.1)	(\$0.9)	(\$0.3)	\$1.1	(\$7.1)	\$0.9	\$9.1	\$8.8	7,088	3,946
6	Conastone - Northwest	Line	BGE	(\$75.8)	(\$75.9)	(\$1.2)	(\$1.1)	\$0.9	(\$7.6)	\$1.2	\$9.8	\$8.7	5,072	3,468
7	5004/5005 Interface	Interface	500	\$58.9	\$59.1	\$0.5	\$0.3	(\$1.1)	\$3.3	(\$0.1)	(\$4.4)	(\$4.1)	1,356	642
8	Bergen - Leonia	Line	PSEG	(\$0.6)	(\$1.5)	\$3.2	\$4.0	\$0.0	\$0.0	\$0.0	\$0.0	\$4.0	2,912	0
9	49th Street - Bergen	Line	PSEG	\$2.1	\$1.2	\$3.0	\$3.9	\$0.0	\$0.0	\$0.0	\$0.0	\$3.9	510	0
10	Cedar Grove - Clifton	Line	PSEG	\$6.4	\$3.5	\$1.4	\$4.3	(\$0.0)	\$0.4	(\$0.4)	(\$0.9)	\$3.4	1,548	28
11	Emilie - Falls	Line	PECO	\$4.6	\$1.0	\$0.7	\$4.3	(\$0.3)	(\$0.0)	(\$0.7)	(\$1.0)	\$3.2	2,318	536
12	Essex	Transformer	PSEG	\$1.1	(\$1.8)	\$0.3	\$3.1	\$0.0	(\$0.6)	(\$0.6)	(\$0.0)	\$3.1	1,244	138
13	Bedington - Black Oak	Interface	500	\$6.0	\$7.7	\$0.1	(\$1.6)	(\$0.1)	\$0.5	(\$0.1)	(\$0.7)	(\$2.4)	5,866	688
14	Newport - S Waterfront	Line	PSEG	\$0.8	\$0.7	\$1.5	\$1.6	\$0.0	\$0.0	\$0.0	\$0.0	\$1.6	574	0
15	Central	Interface	500	\$19.8	\$21.2	\$0.1	(\$1.2)	(\$0.1)	\$0.2	(\$0.1)	(\$0.4)	(\$1.6)	582	82
16	Hoboken - Newport	Line	PSEG	\$0.9	\$0.7	\$1.4	\$1.5	\$0.0	\$0.0	\$0.0	\$0.0	\$1.5	1,160	0
19	Roseland - William	Line	PSEG	\$1.6	\$0.6	\$0.0	\$1.0	\$0.0	\$0.0	\$0.0	\$0.0	\$1.0	112	0
25	Bergen - Homestead	Line	PSEG	\$0.9	\$0.7	\$0.5	\$0.7	\$0.0	\$0.0	\$0.0	\$0.0	\$0.7	88	0
26	Athenia - East Rutherford	Line	PSEG	\$0.9	\$0.5	\$0.3	\$0.6	\$0.0	\$0.0	\$0.0	\$0.0	\$0.6	56	0
28	Aldene - Stanley Terrace	Line	PSEG	\$0.8	\$0.5	\$0.2	\$0.5	\$0.0	(\$0.0)	\$0.0	\$0.1	\$0.6	126	30

Table G-22 PSEG Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	Readington - Roseland	Line	PSEG	\$80.5	\$37.1	\$1.0	\$44.4	(\$0.2)	\$3.4	(\$0.6)	(\$4.2)	\$40.1	2,338	378
2	West	Interface	500	\$172.0	\$184.7	\$1.0	(\$11.6)	(\$1.1)	\$3.0	(\$0.9)	(\$5.0)	(\$16.7)	3,068	830
3	Bergen - New Milford	Line	PSEG	\$26.6	\$19.5	\$13.7	\$20.9	(\$1.9)	\$1.7	(\$5.2)	(\$8.8)	\$12.1	9,490	662
4	Cedar Grove - Clifton	Line	PSEG	\$31.1	\$20.0	\$2.8	\$13.9	(\$0.1)	\$0.7	(\$1.1)	(\$1.8)	\$12.0	3,028	284
5	Bagley - Graceton	Line	BGE	(\$81.9)	(\$92.0)	(\$1.8)	\$8.4	\$1.8	\$3.0	\$1.4	\$0.2	\$8.6	9,168	3,768
6	AP South	Interface	500	\$0.1	\$8.7	\$0.0	(\$8.5)	\$0.0	(\$0.1)	\$1.3	\$1.4	(\$7.1)	10,180	1,962
7	Cedar Grove - Roseland	Line	PSEG	\$2.8	\$1.3	\$0.2	\$1.6	(\$0.3)	\$2.0	(\$3.4)	(\$5.6)	(\$3.9)	660	364
8	Athenia - Clifton	Line	PSEG	\$6.5	\$3.9	\$1.0	\$3.6	\$0.0	\$0.0	\$0.0	\$0.0	\$3.6	1,250	0
9	Atlantic - Larrabee	Line	JCPL	\$4.4	(\$0.4)	(\$0.2)	\$4.6	(\$0.2)	\$1.2	\$0.1	(\$1.3)	\$3.3	1,550	88
10	Hillsdale - New Milford	Line	PSEG	\$2.0	\$1.3	\$1.7	\$2.3	(\$0.2)	\$1.0	(\$4.0)	(\$5.2)	(\$2.9)	664	110
11	Maywood - Saddlebrook	Line	PSEG	\$8.7	\$4.1	(\$1.6)	\$3.0	(\$0.7)	\$0.6	\$1.0	(\$0.3)	\$2.7	3,022	372
12	Bridgewater - Middlesex	Line	PSEG	\$5.1	\$1.8	(\$0.8)	\$2.4	(\$0.1)	\$0.0	\$0.5	\$0.3	\$2.7	446	62
13	Branchburg - Readington	Line	PSEG	\$5.3	\$2.7	\$0.1	\$2.7	\$0.0	\$0.0	\$0.0	\$0.0	\$2.7	130	0
14	Wescosville	Transformer	PPL	\$1.6	(\$0.8)	\$0.2	\$2.6	\$0.0	\$0.0	\$0.0	\$0.0	\$2.6	2,390	8
15	5004/5005 Interface	Interface	500	\$11.7	\$11.4	\$0.3	\$0.6	(\$0.1)	\$2.1	(\$0.6)	(\$2.8)	(\$2.2)	1,108	672
17	Deans - Pierson Avenue	Line	PSEG	\$3.6	\$1.8	\$0.4	\$2.1	\$0.0	\$0.0	\$0.0	\$0.0	\$2.1	360	0
18	Bergen - Leonia	Line	PSEG	\$0.6	\$0.0	\$1.5	\$2.1	\$0.0	\$0.0	\$0.0	\$0.0	\$2.1	4,256	0
20	Athenia - Fairlawn	Line	PSEG	\$0.1	\$0.1	\$0.0	\$0.0	(\$0.3)	\$0.5	(\$1.4)	(\$2.2)	(\$2.1)	60	146
21	Homestead - North Bergen	Line	PSEG	\$1.1	(\$0.2)	\$0.5	\$1.8	\$0.0	\$0.0	\$0.0	\$0.0	\$1.8	1,280	82
22	Aldene - Stanley Terrace	Line	PSEG	\$2.7	\$1.1	\$0.1	\$1.7	(\$0.0)	\$0.1	(\$0.0)	(\$0.1)	\$1.6	324	984

RECO Control Zone

Table G-23 RECO Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	Bagley - Graceton	Line	BGE	(\$2.2)	(\$0.1)	(\$0.2)	(\$2.3)	\$0.1	\$0.0	\$0.1	\$0.3	(\$2.0)	7,088	3,946
2	Conastone - Northwest	Line	BGE	(\$2.2)	(\$0.1)	(\$0.2)	(\$2.2)	\$0.1	\$0.0	\$0.2	\$0.4	(\$1.9)	5,072	3,468
3	5004/5005 Interface	Interface	500	\$1.6	\$0.1	\$0.0	\$1.5	(\$0.2)	(\$0.0)	(\$0.0)	(\$0.2)	\$1.3	1,356	642
4	East	Interface	500	\$0.5	\$0.0	\$0.0	\$0.5	(\$0.0)	\$0.0	(\$0.0)	(\$0.0)	\$0.5	1,080	32
5	Central	Interface	500	\$0.5	\$0.0	\$0.0	\$0.5	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$0.5	582	82
6	49 Street - Hoboken	Line	PSEG	\$0.4	\$0.0	\$0.1	\$0.5	\$0.0	\$0.0	\$0.0	\$0.0	\$0.5	3,286	0
7	49th Street - Hoboken	Line	PSEG	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.1)	(\$0.0)	(\$0.4)	(\$0.5)	(\$0.5)	0	788
8	Glenarm - Windy Edge	Line	BGE	(\$0.3)	(\$0.0)	(\$0.0)	(\$0.3)	\$0.0	\$0.0	\$0.0	\$0.1	(\$0.3)	1,802	844
9	Person - Halifax	Flowgate	MISO	\$0.2	\$0.0	\$0.0	\$0.2	(\$0.0)	\$0.0	\$0.0	(\$0.0)	\$0.2	2,824	12
10	Cedar Grove - Clifton	Line	PSEG	\$0.2	\$0.0	\$0.0	\$0.2	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$0.2	1,548	28
11	West	Interface	500	\$0.2	\$0.0	\$0.0	\$0.2	(\$0.0)	\$0.0	\$0.0	(\$0.0)	\$0.2	638	98
12	Cedar Grove - Roseland	Line	PSEG	\$0.2	\$0.0	\$0.0	\$0.3	(\$0.0)	(\$0.0)	(\$0.1)	(\$0.1)	\$0.1	250	142
13	Mahans Lane - Tidd	Line	AEP	\$0.2	\$0.0	\$0.0	\$0.2	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$0.1	2,098	788
14	Brucea	Transformer	EXT	\$0.0	\$0.0	\$0.1	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	2,720	0
15	Dravosburg - West Mifflin	Line	DLCO	\$0.1	\$0.0	\$0.0	\$0.1	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$0.1	904	514

Table G-24 RECO Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	West	Interface	500	\$4.1	\$0.3	(\$0.1)	\$3.7	(\$0.1)	(\$0.0)	(\$0.0)	(\$0.1)	\$3.6	3,068	830
2	Readington - Roseland	Line	PSEG	\$3.2	\$0.2	\$0.0	\$3.0	(\$0.1)	(\$0.0)	(\$0.0)	(\$0.1)	\$2.9	2,338	378
3	Bagley - Graceton	Line	BGE	(\$2.3)	(\$0.2)	(\$0.1)	(\$2.2)	\$0.1	\$0.0	\$0.1	\$0.2	(\$2.0)	9,168	3,768
4	Cedar Grove - Clifton	Line	PSEG	\$1.1	\$0.1	(\$0.1)	\$0.9	(\$0.0)	(\$0.0)	\$0.1	\$0.0	\$0.9	3,028	284
5	Benton Harbor - Palisades	Flowgate	MISO	\$0.8	\$0.1	\$0.0	\$0.8	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$0.7	6,050	274
6	Cook - Palisades	Flowgate	MISO	\$0.5	\$0.0	\$0.0	\$0.5	(\$0.0)	\$0.0	(\$0.0)	(\$0.0)	\$0.5	4,632	616
7	East	Interface	500	\$0.5	\$0.0	(\$0.0)	\$0.4	(\$0.0)	\$0.0	(\$0.0)	(\$0.0)	\$0.4	3,468	34
8	AP South	Interface	500	(\$0.4)	(\$0.0)	(\$0.0)	(\$0.4)	\$0.0	\$0.0	\$0.0	\$0.1	(\$0.4)	10,180	1,962
9	Maywood - Saddlebrook	Line	PSEG	\$0.4	\$0.0	(\$0.0)	\$0.4	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.1)	\$0.3	3,022	372
10	Central	Interface	500	\$0.3	\$0.0	(\$0.0)	\$0.3	(\$0.0)	\$0.0	(\$0.0)	(\$0.0)	\$0.2	668	20
11	5004/5005 Interface	Interface	500	\$0.3	\$0.0	\$0.0	\$0.3	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$0.2	1,108	672
12	Brambleton - Loudoun	Line	Dominion	\$0.2	\$0.0	(\$0.0)	\$0.2	(\$0.0)	\$0.0	\$0.0	(\$0.0)	\$0.2	194	28
13	Cloverdale	Transformer	AEP	\$0.2	\$0.0	(\$0.0)	\$0.2	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$0.2	8,246	572
14	Bridgewater - Middlesex	Line	PSEG	\$0.2	\$0.0	(\$0.0)	\$0.2	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.2	446	62
15	Branchburg - Readington	Line	PSEG	\$0.2	\$0.0	\$0.0	\$0.2	\$0.0	\$0.0	\$0.0	\$0.0	\$0.2	130	0
412	Burns - Corporate Road	Line	RECO	(\$0.0)	(\$0.0)	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.0)	8	0

West Region Congestion-Event Summaries

AEP Control Zone

Table G-25 AEP Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	AEP - DOM	Interface	500	(\$12.4)	(\$57.1)	\$0.7	\$45.3	\$0.7	\$1.8	(\$2.5)	(\$3.6)	\$41.8	2,656	88
2	Joshua Falls	Transformer	AEP	\$1.6	(\$33.5)	(\$4.1)	\$31.0	\$0.4	\$0.5	\$2.0	\$2.0	\$33.0	1,128	108
3	5004/5005 Interface	Interface	500	(\$92.8)	(\$114.7)	(\$1.9)	\$20.0	\$1.8	\$2.9	\$1.6	\$0.4	\$20.4	1,356	642
4	Bedington - Black Oak	Interface	500	(\$53.7)	(\$69.3)	(\$3.0)	\$12.6	\$0.4	\$1.2	\$1.9	\$1.1	\$13.8	5,866	688
5	Mahans Lane - Tidd	Line	AEP	(\$26.9)	(\$40.9)	(\$2.3)	\$11.7	\$0.1	\$0.8	\$1.9	\$1.2	\$12.9	2,098	788
6	East Danville - Banister	Line	AEP	\$9.6	(\$1.2)	\$1.3	\$12.1	\$1.0	(\$0.2)	(\$0.4)	\$0.8	\$12.8	6,930	252
7	Amos	Transformer	AEP	\$11.5	(\$3.2)	\$1.2	\$15.9	\$3.8	\$3.5	(\$3.5)	(\$3.2)	\$12.7	1,426	214
8	Breed - Wheatland	Flowgate	MISO	\$1.2	(\$9.3)	(\$0.4)	\$10.1	\$0.1	(\$0.5)	(\$0.1)	\$0.5	\$10.6	2,716	298
9	Kammer - Natrium Plant	Line	AEP	\$0.0	\$0.0	\$0.0	\$0.0	(\$2.3)	\$2.8	(\$4.9)	(\$9.9)	(\$9.9)	0	138
10	AP South	Interface	500	(\$30.2)	(\$42.4)	(\$2.6)	\$9.5	\$0.0	\$0.2	\$0.2	\$0.0	\$9.5	2,570	84
11	Bunsonville - Eugene	Flowgate	MISO	\$11.6	\$18.5	(\$3.0)	(\$9.9)	(\$0.0)	(\$0.1)	\$0.5	\$0.6	(\$9.3)	7,524	1,496
12	Cloverdale	Transformer	AEP	(\$7.2)	(\$16.2)	(\$1.4)	\$7.5	\$0.2	\$0.6	\$1.4	\$1.0	\$8.6	1,456	188
13	Tidd	Transformer	AEP	\$0.4	(\$4.3)	\$0.5	\$5.2	\$0.2	\$0.2	\$0.5	\$0.5	\$5.7	7,606	184
14	Wolf Creek	Transformer	AEP	(\$10.5)	(\$17.1)	(\$0.7)	\$5.8	(\$0.3)	\$0.7	\$0.7	(\$0.2)	\$5.6	1,420	342
15	Belmont	Transformer	AP	(\$12.3)	(\$18.3)	(\$0.4)	\$5.5	\$0.3	\$0.9	\$0.4	(\$0.2)	\$5.3	1,680	188
16	West Bellaire	Transformer	AEP	\$2.7	(\$4.0)	\$0.1	\$6.8	(\$0.2)	\$0.1	(\$1.3)	(\$1.6)	\$5.3	930	60
17	Laporte - Michigan City	Line	AEP	\$0.0	\$0.0	\$0.0	\$0.0	(\$3.4)	(\$0.9)	(\$2.7)	(\$5.3)	(\$5.3)	0	792
21	Kanawha River	Transformer	AEP	\$3.4	(\$0.6)	\$0.2	\$4.2	\$0.1	\$0.1	(\$0.2)	(\$0.2)	\$4.0	938	10
23	Ohio Central - Powelson	Line	AEP	\$2.1	(\$1.8)	\$0.0	\$3.9	(\$0.0)	(\$0.1)	\$0.0	\$0.1	\$3.9	342	20
24	Moseley - Roanoke	Line	AEP	\$4.1	\$0.5	\$0.0	\$3.5	\$0.0	(\$0.0)	\$0.1	\$0.1	\$3.7	746	32

Table G-26 AEP Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	AP South	Interface	500	(\$226.5)	(\$349.3)	(\$3.7)	\$119.2	\$10.5	\$13.3	\$4.9	\$2.1	\$121.3	10,180	1,962
2	Breed - Wheatland	Flowgate	MISO	\$4.1	(\$61.6)	(\$11.4)	\$54.2	\$1.5	(\$0.3)	\$6.1	\$7.9	\$62.1	7,516	1,204
3	West	Interface	500	(\$288.9)	(\$348.6)	(\$11.4)	\$48.3	\$7.3	\$6.2	\$4.4	\$5.5	\$53.8	3,068	830
4	Monticello - East Winamac	Flowgate	MISO	\$16.1	(\$26.2)	\$0.9	\$43.2	\$1.9	\$2.8	(\$4.9)	(\$5.8)	\$37.4	7,022	2,880
5	Benton Harbor - Palisades	Flowgate	MISO	(\$31.9)	(\$60.6)	(\$3.6)	\$25.1	\$0.1	\$0.2	\$0.2	\$0.1	\$25.2	6,050	274
6	Cook - Palisades	Flowgate	MISO	(\$15.9)	(\$39.6)	(\$3.2)	\$20.5	\$0.5	\$0.5	(\$0.6)	(\$0.6)	\$19.9	4,632	616
7	Amos	Transformer	AEP	\$10.5	(\$3.4)	\$0.1	\$14.0	\$0.8	(\$1.4)	(\$1.5)	\$0.7	\$14.6	2,192	364
8	Bedington - Black Oak	Interface	500	(\$51.1)	(\$67.7)	(\$2.4)	\$14.1	\$0.3	\$1.8	\$1.5	(\$0.0)	\$14.1	5,592	646
9	AEP - DOM	Interface	500	(\$6.6)	(\$24.2)	\$2.3	\$19.9	\$3.3	\$4.8	(\$5.0)	(\$6.4)	\$13.5	5,022	132
10	Wolf Creek	Transformer	AEP	(\$13.3)	(\$20.9)	\$0.7	\$8.3	\$0.7	\$3.6	(\$18.5)	(\$21.4)	(\$13.1)	10,204	262
11	Michigan City - Laporte	Flowgate	MISO	\$23.6	\$19.5	\$5.2	\$9.3	\$0.0	\$0.0	\$0.0	\$0.0	\$9.3	6,222	0
12	Laporte - Michigan City	Line	AEP	\$0.0	\$0.0	\$0.0	\$0.0	(\$1.7)	(\$2.1)	(\$8.0)	(\$7.6)	(\$7.6)	0	1,046
13	Gomingo - Joshua Falls	Line	AEP	(\$1.1)	(\$7.8)	\$0.7	\$7.4	\$0.0	\$0.0	\$0.0	\$0.0	\$7.4	1,936	0
14	5004/5005 Interface	Interface	500	(\$18.0)	(\$22.6)	(\$0.6)	\$4.0	\$2.6	\$3.3	\$2.2	\$1.5	\$5.5	1,108	672
15	Cloverdale	Transformer	AEP	(\$75.7)	(\$101.5)	(\$11.9)	\$13.9	\$1.0	\$3.0	(\$6.6)	(\$8.5)	\$5.3	8,246	572
17	Muskingum River	Transformer	AEP	\$2.3	(\$2.7)	\$0.7	\$5.7	(\$1.7)	(\$0.0)	(\$0.7)	(\$2.3)	\$3.4	5,718	430
19	East Lima - New Liberty	Line	AEP	\$0.4	(\$1.8)	\$1.0	\$3.2	\$0.0	\$0.0	\$0.0	\$0.0	\$3.2	1,838	0
21	Kammer - Natrium	Line	AEP	\$2.8	(\$0.0)	\$0.2	\$3.0	\$0.0	\$0.0	\$0.0	\$0.0	\$3.0	1,386	0
23	Lockwood - South Hicksville	Line	AEP	(\$1.5)	(\$2.9)	\$0.5	\$1.9	(\$2.1)	\$1.9	(\$0.8)	(\$4.8)	(\$2.9)	522	50
26	Sullivan	Transformer	AEP	(\$0.4)	(\$5.7)	(\$0.4)	\$4.8	\$0.1	\$1.4	(\$0.7)	(\$2.0)	\$2.9	2,352	54

AP Control Zone

Table G-27 AP Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	Bedington - Black Oak	Interface	500	(\$5.1)	(\$30.9)	(\$4.8)	\$21.0	\$0.8	\$0.6	\$1.7	\$1.9	\$22.8	5,866	688
2	AP South	Interface	500	(\$5.0)	(\$19.1)	(\$0.6)	\$13.4	\$0.1	(\$0.1)	\$0.1	\$0.3	\$13.7	2,570	84
3	Person - Halifax	Flowgate	MISO	\$7.3	\$0.6	\$0.1	\$6.8	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$6.8	2,824	12
4	Dravosburg - West Mifflin	Line	DLCO	\$12.6	\$5.9	\$0.8	\$7.5	\$0.5	\$0.1	(\$1.3)	(\$1.0)	\$6.5	904	514
5	Mahans Lane - Tidd	Line	AEP	\$9.8	\$5.2	\$1.0	\$5.6	(\$0.1)	(\$0.1)	(\$1.4)	(\$1.4)	\$4.2	2,098	788
6	Conastone - Northwest	Line	BGE	\$13.5	\$10.2	\$0.7	\$4.0	\$0.3	(\$0.5)	(\$0.8)	(\$0.0)	\$3.9	5,072	3,468
7	Bagley - Graceton	Line	BGE	\$13.7	\$10.8	\$0.8	\$3.7	(\$0.0)	(\$0.4)	(\$0.5)	(\$0.2)	\$3.5	7,088	3,946
8	Valley	Transformer	Dominion	(\$0.8)	(\$4.0)	\$0.1	\$3.3	\$0.2	\$0.0	(\$0.1)	\$0.1	\$3.4	1,736	180
9	Tiltonville - Windsor	Line	AP	\$3.3	\$0.5	\$0.3	\$3.1	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$3.0	658	20
10	AEP - DOM	Interface	500	(\$1.7)	(\$4.7)	(\$0.5)	\$2.5	\$0.2	(\$0.1)	\$0.1	\$0.4	\$2.9	2,656	88
11	5004/5005 Interface	Interface	500	(\$25.6)	(\$28.4)	(\$2.1)	\$0.8	\$0.0	(\$0.5)	\$1.4	\$1.9	\$2.6	1,356	642
12	Joshua Falls	Transformer	AEP	\$1.3	(\$0.6)	\$0.2	\$2.1	\$0.1	(\$0.0)	(\$0.1)	(\$0.0)	\$2.0	1,128	108
13	USAP - Woodville	Line	DLCO	\$4.3	\$1.6	\$0.4	\$3.1	\$0.0	(\$0.0)	(\$1.2)	(\$1.1)	\$1.9	358	222
14	502 Junction	Transformer	AP	\$1.7	(\$0.2)	(\$0.1)	\$1.7	\$0.1	(\$0.1)	(\$0.0)	\$0.2	\$1.9	82	16
15	Pleasants - St. Marys	Line	AP	\$0.0	\$0.0	\$0.0	\$0.0	(\$1.3)	\$0.3	(\$0.2)	(\$1.8)	(\$1.8)	0	58
16	Belmont	Transformer	AP	\$4.3	\$6.1	\$0.5	(\$1.3)	\$0.0	(\$0.3)	(\$0.6)	(\$0.3)	(\$1.6)	1,680	188
24	Enon Tap - Gilboa	Line	AP	\$3.6	\$2.8	\$0.3	\$1.2	(\$0.1)	(\$0.0)	(\$0.3)	(\$0.4)	\$0.7	1,110	190
26	Bartonsville - Stephenson	Line	AP	\$0.5	(\$0.1)	\$0.0	\$0.7	\$0.0	\$0.0	\$0.0	\$0.0	\$0.7	92	0
28	Butler - Karns City	Line	AP	\$0.4	(\$0.3)	(\$0.0)	\$0.7	(\$0.0)	\$0.0	\$0.0	(\$0.0)	\$0.6	1,008	66
32	Kingwood - Pruntytown	Line	AP	\$0.3	(\$0.1)	\$0.0	\$0.5	\$0.0	\$0.0	\$0.0	\$0.0	\$0.5	226	0

Table G-28 AP Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	AP South	Interface	500	(\$50.4)	(\$193.3)	(\$9.9)	\$132.9	\$7.1	\$18.7	\$6.3	(\$5.4)	\$127.6	10,180	1,962
2	West	Interface	500	(\$97.9)	(\$94.8)	(\$23.6)	(\$26.7)	(\$1.5)	\$4.5	\$5.9	(\$0.1)	(\$26.8)	3,068	830
3	Bedington - Black Oak	Interface	500	(\$3.1)	(\$28.7)	(\$3.6)	\$22.0	\$1.1	\$1.1	\$1.7	\$1.7	\$23.7	5,592	646
4	Cloverdale	Transformer	AEP	\$11.4	\$5.3	\$4.3	\$10.4	\$0.3	\$0.0	(\$2.0)	(\$1.7)	\$8.7	8,246	572
5	Wolf Creek	Transformer	AEP	\$7.8	\$11.1	\$3.6	\$0.2	\$0.8	(\$0.9)	(\$10.4)	(\$8.7)	(\$8.5)	10,204	262
6	USAP - Woodville	Line	DLCO	\$8.7	\$1.8	\$0.9	\$7.7	\$0.3	\$0.0	(\$0.9)	(\$0.6)	\$7.1	1,490	244
7	Brambleton - Loudoun	Line	Dominion	\$3.5	(\$1.6)	\$1.0	\$6.1	\$0.1	(\$0.0)	(\$0.2)	(\$0.1)	\$6.0	194	28
8	Rivesville - Wove	Line	AP	\$3.6	(\$1.5)	(\$0.1)	\$4.9	\$0.3	\$0.2	\$0.0	\$0.1	\$5.0	794	340
9	Benton Harbor - Palisades	Flowgate	MISO	\$7.5	\$4.1	\$1.1	\$4.5	\$0.0	(\$0.0)	(\$0.2)	(\$0.2)	\$4.3	6,050	274
10	Grafton - Pruntytown	Line	AP	\$3.3	(\$0.8)	\$0.1	\$4.1	\$0.1	\$0.1	\$0.1	\$0.1	\$4.2	680	94
11	Bagley - Graceton	Line	BGE	\$13.2	\$10.5	(\$0.8)	\$2.0	\$0.3	(\$0.1)	\$0.9	\$1.3	\$3.2	9,168	3,768
12	Readington - Roseland	Line	PSEG	(\$2.6)	(\$0.6)	(\$1.9)	(\$4.0)	\$0.0	\$0.1	\$1.2	\$1.1	(\$2.9)	2,338	378
13	Kingwood - Pruntytown	Line	AP	\$1.7	(\$0.6)	\$0.5	\$2.8	\$0.0	\$0.0	\$0.0	\$0.0	\$2.8	1,738	0
14	5004/5005 Interface	Interface	500	(\$4.8)	(\$6.5)	(\$1.0)	\$0.6	\$0.1	\$0.3	\$2.1	\$1.8	\$2.4	1,108	672
15	Dravosburg - West Mifflin	Line	DLCO	\$2.9	\$0.7	\$1.1	\$3.3	\$0.1	\$0.1	(\$1.0)	(\$0.9)	\$2.3	578	202
19	Lakelynn - Westrun	Line	AP	\$0.6	(\$0.9)	\$0.0	\$1.5	\$0.0	\$0.0	\$0.0	\$0.0	\$1.5	546	0
21	Enon Tap - Gilboa	Line	AP	\$3.9	\$3.4	\$0.9	\$1.4	\$0.0	\$0.0	(\$0.1)	(\$0.1)	\$1.3	576	44
23	Butler - Karns City	Line	AP	\$0.9	(\$0.4)	(\$0.0)	\$1.3	(\$0.2)	\$0.1	\$0.2	(\$0.1)	\$1.2	1,538	120
24	All Dam - Kittanning	Line	AP	(\$0.3)	(\$1.8)	(\$0.1)	\$1.4	(\$0.1)	\$0.1	\$0.1	(\$0.2)	\$1.2	1,406	0
26	Doubs - Mt. Storm	Line	AP	(\$0.1)	(\$1.2)	\$0.0	\$1.1	\$0.0	\$0.0	\$0.0	\$0.0	\$1.1	104	0

ATSI Control Zone

Table G-29 ATSI Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	5004/5005 Interface	Interface	500	(\$44.3)	(\$40.2)	(\$0.7)	(\$4.8)	(\$0.6)	\$3.7	\$0.3	(\$4.0)	(\$8.8)	1,356	642
2	Bedington - Black Oak	Interface	500	(\$31.4)	(\$26.9)	(\$0.3)	(\$4.8)	\$0.1	\$1.0	\$0.2	(\$0.7)	(\$5.5)	5,866	688
3	Monroe - Bayshore	Flowgate	MISO	\$10.5	\$6.9	\$0.0	\$3.7	(\$0.2)	(\$0.1)	(\$0.1)	(\$0.1)	\$3.6	1,144	430
4	Juniper	Transformer	ATSI	\$3.8	\$0.3	\$0.1	\$3.6	(\$0.0)	\$0.0	(\$0.0)	(\$0.0)	\$3.6	210	6
5	AP South	Interface	500	(\$19.9)	(\$16.9)	(\$0.3)	(\$3.4)	(\$0.0)	\$0.1	\$0.1	(\$0.1)	(\$3.4)	2,570	84
6	Person - Halifax	Flowgate	MISO	(\$14.6)	(\$11.6)	\$0.0	(\$3.0)	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	(\$3.0)	2,824	12
7	Ottawa - West Fremont	Line	ATSI	(\$1.9)	(\$5.0)	\$0.1	\$3.1	\$0.0	\$0.1	(\$0.0)	(\$0.1)	\$3.0	536	42
8	Beaver - Mansfield	Line	DLCO	(\$1.0)	(\$3.5)	\$0.1	\$2.6	(\$0.3)	(\$0.7)	(\$0.1)	\$0.3	\$2.9	240	146
9	Bay Shore - Jeep	Line	ATSI	\$1.7	(\$0.9)	\$0.0	\$2.6	(\$0.1)	\$0.0	\$0.0	(\$0.1)	\$2.5	170	84
10	Lakeview - Greenfield	Line	ATSI	\$1.5	(\$1.4)	\$0.3	\$3.3	(\$0.0)	\$0.4	(\$0.4)	(\$0.8)	\$2.5	948	234
11	AEP - DOM	Interface	500	(\$14.2)	(\$12.2)	(\$0.0)	(\$2.1)	(\$0.1)	\$0.2	(\$0.0)	(\$0.3)	(\$2.4)	2,656	88
12	West Akron - Brush	Line	ATSI	\$5.3	\$3.6	\$0.0	\$1.7	(\$0.1)	(\$0.5)	(\$0.0)	\$0.4	\$2.1	250	80
13	Mahans Lane - Tidd	Line	AEP	(\$9.4)	(\$8.0)	(\$0.2)	(\$1.5)	(\$0.1)	\$0.4	\$0.2	(\$0.4)	(\$1.9)	2,098	788
14	Lakeview - Ottawa	Line	ATSI	\$1.0	(\$0.5)	\$0.2	\$1.7	\$0.0	\$0.0	\$0.0	\$0.0	\$1.7	390	0
15	Bagley - Graceton	Line	BGE	\$2.4	\$1.4	(\$0.2)	\$0.8	\$0.0	(\$0.2)	\$0.5	\$0.7	\$1.6	7,088	3,946
17	Astor - Crestwood	Line	ATSI	\$1.1	(\$0.3)	\$0.1	\$1.5	\$0.0	\$0.0	\$0.0	\$0.0	\$1.5	550	0
25	Juniper - Northfield	Line	ATSI	\$1.0	\$0.1	\$0.1	\$0.9	\$0.2	\$0.0	(\$0.1)	\$0.1	\$1.0	498	16
29	Hoyt Dale - Maple	Line	ATSI	(\$3.6)	(\$4.1)	(\$0.1)	\$0.4	\$0.8	\$2.1	\$0.1	(\$1.2)	(\$0.8)	142	170
32	Clinic Hospital - Inland	Line	ATSI	\$0.7	\$0.1	\$0.1	\$0.7	\$0.0	\$0.0	\$0.0	\$0.0	\$0.7	278	0
34	Babb - Evans	Line	ATSI	\$0.7	\$0.0	\$0.0	\$0.7	\$0.0	\$0.0	\$0.0	\$0.0	\$0.7	66	0

Table G-30 ATSI Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	AP South	Interface	500	(\$181.3)	(\$167.6)	(\$8.5)	(\$22.2)	(\$0.5)	\$7.3	\$7.6	(\$0.3)	(\$22.5)	10,180	1,962
2	West	Interface	500	(\$122.1)	(\$114.9)	(\$4.7)	(\$11.9)	\$0.3	\$3.5	\$1.1	(\$2.1)	(\$13.9)	3,068	830
3	Benton Harbor - Palisades	Flowgate	MISO	\$39.5	\$27.4	\$0.0	\$12.1	(\$0.4)	(\$0.1)	(\$1.1)	(\$1.5)	\$10.7	6,050	274
4	SENECA	Interface	PENELEC	\$0.0	\$0.0	(\$8.3)	(\$8.3)	\$0.0	\$0.0	\$0.5	\$0.5	(\$7.8)	7,124	6,454
5	Cook - Palisades	Flowgate	MISO	\$26.6	\$15.4	\$1.1	\$12.3	(\$0.8)	(\$0.1)	(\$4.2)	(\$4.9)	\$7.5	4,632	616
6	South Canton - Star	Line	AEP	\$7.4	\$3.4	\$1.2	\$5.2	(\$0.1)	(\$0.2)	(\$0.3)	(\$0.3)	\$4.9	1,186	10
7	Cloverdale	Transformer	AEP	(\$10.5)	(\$6.8)	\$1.2	(\$2.5)	(\$0.2)	\$0.3	(\$0.7)	(\$1.2)	(\$3.7)	8,246	572
8	Bedington - Black Oak	Interface	500	(\$28.7)	(\$25.4)	(\$0.3)	(\$3.5)	\$0.3	\$0.7	\$0.5	\$0.1	(\$3.5)	5,592	646
9	Ottawa - West Fremont	Line	ATSI	(\$1.4)	(\$4.4)	\$0.2	\$3.2	(\$0.0)	\$0.0	(\$0.1)	(\$0.1)	\$3.1	552	66
10	East Lima - New Liberty	Line	AEP	\$4.0	\$2.1	\$0.6	\$2.4	\$0.0	\$0.0	\$0.0	\$0.0	\$2.4	1,838	0
11	Wolf Creek	Transformer	AEP	(\$2.0)	(\$0.4)	\$0.2	(\$1.5)	(\$0.1)	\$0.1	(\$0.7)	(\$0.9)	(\$2.3)	10,204	262
12	Beaver Valley - Hanna	Line	DLCO	\$1.4	(\$0.6)	\$0.2	\$2.3	\$0.0	\$0.0	\$0.0	\$0.0	\$2.3	242	0
13	Highland - Salt Springs	Line	ATSI	\$2.0	\$0.2	\$0.3	\$2.1	\$0.0	\$0.0	\$0.0	\$0.0	\$2.1	436	0
14	AEP - DOM	Interface	500	(\$5.9)	(\$4.6)	(\$0.0)	(\$1.3)	(\$0.0)	\$0.4	(\$0.3)	(\$0.8)	(\$2.1)	5,022	132
15	Inland - Pofok Tie	Line	ATSI	\$1.5	\$0.3	\$0.7	\$1.9	\$0.0	\$0.0	\$0.0	\$0.0	\$1.9	2,856	0
17	Lakeview - Greenfield	Line	ATSI	\$11.1	(\$1.1)	\$4.9	\$17.1	\$1.1	\$9.3	(\$7.0)	(\$15.2)	\$1.9	1,828	312
19	Longview - ARMCO	Line	ATSI	\$2.7	\$1.5	\$0.8	\$2.0	\$0.6	\$0.3	(\$0.6)	(\$0.3)	\$1.7	676	148
22	Juniper - Northfield	Line	ATSI	\$1.6	\$0.2	\$0.2	\$1.5	\$1.2	\$0.2	(\$1.0)	(\$0.0)	\$1.5	378	44
23	Brookside - Troy	Line	ATSI	\$1.9	\$1.0	\$0.4	\$1.4	\$0.0	\$0.0	\$0.0	\$0.0	\$1.4	1,208	0
24	West Akron - Brush	Line	ATSI	\$1.8	\$0.6	\$0.2	\$1.4	\$0.0	\$0.0	\$0.0	\$0.0	\$1.4	534	0

ComEd Control Zone

Table G-31 ComEd Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	Cherry Valley	Flowgate	MISO	\$13.3	(\$59.7)	\$5.1	\$78.1	\$0.0	\$0.0	\$0.0	\$0.0	\$78.1	2,696	0
2	Oak Grove - Galesburg	Flowgate	MISO	(\$23.6)	(\$52.1)	(\$3.7)	\$24.8	\$0.3	\$0.8	(\$1.5)	(\$2.0)	\$22.8	6,712	2,612
3	Braidwood - East Frankfort	Line	ComEd	(\$2.4)	(\$21.1)	\$0.2	\$18.9	\$0.5	\$0.5	(\$0.3)	(\$0.3)	\$18.6	2,898	116
4	Bunsonville - Eugene	Flowgate	MISO	(\$59.9)	(\$81.3)	(\$4.3)	\$17.0	\$0.3	(\$0.0)	\$0.6	\$1.0	\$18.0	7,524	1,496
5	Rising	Flowgate	MISO	(\$41.1)	(\$56.4)	(\$5.2)	\$10.1	\$0.4	\$0.1	\$2.5	\$2.8	\$12.9	1,398	918
6	5004/5005 Interface	Interface	500	(\$61.1)	(\$70.3)	(\$1.3)	\$7.9	\$0.7	\$0.3	\$0.8	\$1.2	\$9.2	1,356	642
7	Nelson	Flowgate	MISO	\$0.2	(\$8.1)	\$0.5	\$8.8	\$0.0	\$0.0	\$0.0	\$0.0	\$8.8	1,416	0
8	Dixon - McGirr Rd	Flowgate	MISO	\$1.8	(\$6.3)	(\$0.1)	\$8.0	\$0.0	\$0.0	\$0.0	\$0.0	\$8.0	2,080	0
9	Person - Halifax	Flowgate	MISO	(\$59.6)	(\$69.0)	(\$1.6)	\$7.9	(\$0.0)	(\$0.0)	\$0.0	\$0.0	\$7.9	2,824	12
10	Braidwood	Transformer	ComEd	(\$0.0)	(\$6.4)	\$0.6	\$6.9	\$0.0	\$0.0	\$0.0	\$0.0	\$6.9	7,454	0
11	Bedington - Black Oak	Interface	500	(\$38.6)	(\$44.7)	(\$0.8)	\$5.3	\$0.1	(\$0.6)	\$0.5	\$1.2	\$6.5	5,866	688
12	Burnham - Munster	Flowgate	MISO	(\$52.0)	(\$62.1)	(\$3.8)	\$6.4	\$0.0	\$0.0	\$0.0	\$0.0	\$6.4	3,496	0
13	Mercer IP - Galesburg	Flowgate	MISO	(\$5.9)	(\$13.0)	(\$0.6)	\$6.5	(\$0.0)	\$0.4	(\$0.5)	(\$0.9)	\$5.6	1,632	412
14	Cherry Valley - Belvidere	Line	ComEd	\$0.7	(\$3.9)	\$1.0	\$5.7	\$0.0	(\$0.0)	(\$0.1)	(\$0.1)	\$5.6	2,590	14
15	Conastone - Northwest	Line	BGE	\$28.3	\$33.1	\$1.0	(\$3.8)	(\$0.6)	(\$0.1)	(\$1.3)	(\$1.7)	(\$5.6)	5,072	3,468
17	Cherry Valley	Transformer	ComEd	\$3.6	(\$4.4)	\$1.4	\$9.4	(\$1.7)	\$2.5	(\$10.6)	(\$14.8)	(\$5.4)	1,578	1,770
28	Byron - Cherry Valley	Line	ComEd	\$0.0	(\$0.0)	\$0.0	\$0.1	(\$0.2)	\$1.0	(\$1.6)	(\$2.9)	(\$2.8)	30	76
29	Quad Cities - Sterling Steel	Line	ComEd	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.4	(\$2.4)	(\$2.7)	(\$2.7)	4	56
30	Lancaster - Maryland	Line	ComEd	\$0.9	(\$0.5)	\$0.2	\$1.6	\$0.2	\$2.6	(\$1.9)	(\$4.3)	(\$2.6)	114	316
31	Cherry Valley - Byron	Line	ComEd	\$0.3	(\$1.9)	\$0.4	\$2.5	\$0.0	\$0.0	\$0.0	\$0.0	\$2.5	128	0

Table G-32 ComEd Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	West	Interface	500	(\$205.5)	(\$246.9)	(\$5.6)	\$35.8	\$1.6	\$1.6	\$2.9	\$3.0	\$38.8	3,068	830
2	Oak Grove - Galesburg	Flowgate	MISO	(\$30.4)	(\$69.2)	(\$1.0)	\$37.7	\$0.6	\$0.5	(\$0.1)	(\$0.0)	\$37.7	13,810	2,118
3	Cherry Valley	Transformer	ComEd	\$23.0	(\$20.2)	\$4.9	\$48.1	(\$5.0)	\$0.5	(\$10.7)	(\$16.2)	\$31.9	5,524	648
4	AP South	Interface	500	(\$208.3)	(\$242.6)	(\$5.8)	\$28.4	\$3.7	\$6.6	\$5.7	\$2.8	\$31.2	10,180	1,962
5	Nelson - Cordova	Line	ComEd	\$16.3	(\$10.6)	\$4.0	\$30.9	\$0.2	\$0.8	(\$3.2)	(\$3.8)	\$27.0	8,214	558
6	Breed - Wheatland	Flowgate	MISO	(\$60.8)	(\$78.2)	(\$1.3)	\$16.1	\$0.6	\$1.3	\$0.6	(\$0.1)	\$16.0	7,516	1,204
7	Cloverdale	Transformer	AEP	(\$63.2)	(\$77.6)	(\$1.4)	\$13.1	\$1.0	\$0.4	\$0.9	\$1.5	\$14.5	8,246	572
8	Benton Harbor - Palisades	Flowgate	MISO	(\$126.0)	(\$144.1)	(\$4.6)	\$13.5	\$0.2	\$0.1	\$0.6	\$0.7	\$14.2	6,050	274
9	Hegewisch - Burnham	Line	ComEd	(\$19.9)	(\$32.4)	(\$1.0)	\$11.5	(\$2.1)	(\$0.0)	\$0.1	(\$1.9)	\$9.6	3,074	618
10	Braidwood	Transformer	ComEd	(\$0.0)	(\$8.8)	\$0.6	\$9.4	\$0.0	\$0.0	\$0.0	\$0.0	\$9.4	15,484	0
11	Cook - Palisades	Flowgate	MISO	(\$85.1)	(\$96.2)	(\$3.9)	\$7.1	\$0.8	\$0.3	\$1.8	\$2.2	\$9.3	4,632	616
12	Michigan City - Laporte	Flowgate	MISO	(\$74.4)	(\$86.8)	(\$3.4)	\$9.0	\$0.0	\$0.0	\$0.0	\$0.0	\$9.0	6,222	0
13	Bunsonville - Eugene	Flowgate	MISO	(\$22.0)	(\$29.8)	(\$0.7)	\$7.1	\$0.4	(\$0.1)	\$0.2	\$0.6	\$7.7	4,536	1,408
14	Bedington - Black Oak	Interface	500	(\$40.6)	(\$47.2)	(\$0.9)	\$5.8	\$0.7	(\$0.4)	\$0.6	\$1.7	\$7.4	5,592	646
15	Braidwood - East Frankfort	Line	ComEd	(\$1.4)	(\$8.6)	\$0.3	\$7.6	\$0.5	\$0.7	(\$1.4)	(\$1.6)	\$6.0	2,490	50
21	Cherry Valley - Byron	Line	ComEd	\$0.6	(\$3.1)	\$0.3	\$4.0	\$0.0	\$0.0	\$0.0	\$0.0	\$4.0	162	0
24	Plano	Transformer	ComEd	\$2.0	(\$1.1)	(\$0.2)	\$2.9	\$0.0	\$0.0	\$0.0	\$0.0	\$2.9	168	0
31	Byron - Cherry Valley	Line	ComEd	\$1.5	(\$6.1)	\$1.0	\$8.6	(\$0.1)	\$2.7	(\$3.3)	(\$6.1)	\$2.5	1,950	232
33	Quad Cities - Cordova Energy	Line	ComEd	(\$0.0)	(\$0.0)	\$0.0	\$0.0	(\$0.1)	\$0.1	(\$2.2)	(\$2.4)	\$2.4	8	0
34	Wempletown - Byron	Line	ComEd	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.3	(\$1.8)	(\$2.1)	\$2.1	0	0

DAY Control Zone

Table G-33 DAY Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)															
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours			
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time	
1	5004/5005 Interface	Interface	500	(\$10.3)	(\$9.0)	(\$0.3)	(\$1.6)	(\$0.1)	\$0.0	\$0.1	\$0.0	(\$1.5)	1,356	642	
2	Person - Halifax	Flowgate	MISO	(\$8.5)	(\$7.5)	(\$0.2)	(\$1.2)	\$0.0	\$0.0	\$0.0	(\$0.0)	(\$1.2)	2,824	12	
3	Bedington - Black Oak	Interface	500	(\$6.7)	(\$5.6)	(\$0.2)	(\$1.4)	\$0.1	\$0.0	\$0.1	\$0.2	(\$1.1)	5,866	688	
4	AP South	Interface	500	(\$4.2)	(\$3.4)	(\$0.2)	(\$1.0)	(\$0.0)	(\$0.0)	\$0.0	\$0.0	(\$1.0)	2,570	84	
5	AEP - DOM	Interface	500	(\$5.4)	(\$4.7)	(\$0.1)	(\$0.8)	\$0.0	\$0.1	\$0.0	(\$0.1)	(\$0.9)	2,656	88	
6	Miami Fort - Willey	Line	DEOK	\$2.0	\$1.4	\$0.3	\$0.9	\$0.0	\$0.0	(\$0.1)	(\$0.1)	\$0.8	3,170	224	
7	Mahans Lane - Tidd	Line	AEP	(\$2.7)	(\$2.1)	(\$0.1)	(\$0.7)	\$0.0	\$0.0	\$0.1	\$0.1	(\$0.6)	2,098	788	
8	Beckjord - Pierce	Line	DEOK	\$1.3	\$1.0	\$0.2	\$0.5	\$0.0	(\$0.1)	(\$0.0)	\$0.1	\$0.5	954	52	
9	Wolf Creek	Transformer	AEP	(\$1.8)	(\$1.3)	(\$0.1)	(\$0.6)	\$0.0	\$0.0	\$0.1	\$0.1	(\$0.5)	1,420	342	
10	Pierce - Foster	Flowgate	MISO	\$0.3	\$0.2	\$0.0	\$0.2	\$0.2	\$0.5	(\$0.4)	(\$0.6)	(\$0.4)	86	22	
11	Joshua Falls	Transformer	AEP	(\$3.8)	(\$3.5)	(\$0.1)	(\$0.4)	(\$0.0)	\$0.1	\$0.0	(\$0.1)	(\$0.4)	1,128	108	
12	Dravosburg - West Mifflin	Line	DLCO	(\$1.4)	(\$1.1)	(\$0.1)	(\$0.4)	(\$0.0)	\$0.0	\$0.1	\$0.0	(\$0.4)	904	514	
13	Central	Interface	500	(\$2.3)	(\$1.9)	(\$0.0)	(\$0.4)	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.4)	582	82	
14	Bagley - Graceton	Line	BGE	\$4.5	\$4.3	\$0.1	\$0.3	(\$0.0)	(\$0.1)	(\$0.0)	\$0.1	\$0.4	7,088	3,946	
15	Valley	Transformer	Dominion	(\$2.3)	(\$1.9)	(\$0.0)	(\$0.4)	\$0.0	(\$0.0)	\$0.0	\$0.1	(\$0.3)	1,736	180	
20	College Corner - Drewersburg	Line	DAY	\$0.5	\$0.3	\$0.1	\$0.3	\$0.0	\$0.0	\$0.0	\$0.0	\$0.3	874	0	
74	Trenton - Hutchings	Line	DAY	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	142	0	
80	Darby - Watkins Tap	Line	DAY	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	156	0	
210	Foster2 - Pierce	Line	DAY	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	28	0	
278	West Milton - Greenville	Line	DAY	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.0)	(\$0.0)	(\$0.0)	0	2	

Table G-34 DAY Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)															
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours			
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time	
1	AP South	Interface	500	(\$33.9)	(\$29.4)	(\$1.2)	(\$5.7)	\$1.7	\$1.1	\$1.1	\$1.7	(\$4.0)	10,180	1,962	
2	West	Interface	500	(\$32.2)	(\$30.3)	(\$0.9)	(\$2.8)	\$0.8	\$1.6	\$0.5	(\$0.4)	(\$3.2)	3,068	830	
3	Benton Harbor - Palisades	Flowgate	MISO	(\$2.1)	(\$3.5)	\$0.6	\$2.0	\$0.0	\$0.0	(\$0.1)	(\$0.2)	\$1.8	6,050	274	
4	Lakeview - Greenfield	Line	ATSI	(\$3.7)	(\$2.8)	(\$0.2)	(\$1.1)	\$0.3	\$0.3	\$0.1	\$0.1	(\$1.1)	1,828	312	
5	Cook - Palisades	Flowgate	MISO	(\$1.3)	(\$2.0)	\$0.5	\$1.2	\$0.0	\$0.1	(\$0.2)	(\$0.3)	\$0.9	4,632	616	
6	Bedington - Black Oak	Interface	500	(\$6.4)	(\$5.7)	(\$0.3)	(\$1.0)	\$0.1	(\$0.0)	\$0.2	\$0.3	(\$0.6)	5,592	646	
7	East Lima - New Liberty	Line	AEP	(\$1.1)	(\$0.6)	(\$0.2)	(\$0.6)	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.6)	1,838	0	
8	Monticello - East Winamac	Flowgate	MISO	(\$0.5)	(\$0.4)	\$0.2	\$0.1	\$0.0	\$0.1	(\$0.6)	(\$0.6)	(\$0.5)	7,022	2,880	
9	AEP - DOM	Interface	500	(\$2.3)	(\$2.2)	(\$0.1)	(\$0.2)	\$0.2	\$0.6	\$0.1	(\$0.3)	(\$0.5)	5,022	132	
10	West Moulton-St. Mary	Line	AEP	\$0.3	\$0.0	\$0.2	\$0.4	\$0.0	\$0.0	\$0.0	\$0.0	\$0.4	2,244	0	
11	Amos	Transformer	AEP	(\$1.4)	(\$0.9)	\$0.0	(\$0.5)	\$0.1	(\$0.1)	(\$0.0)	\$0.1	(\$0.4)	2,192	364	
12	BCPEP	Interface	Pepco	(\$1.5)	(\$1.5)	(\$0.1)	(\$0.2)	\$0.2	(\$0.2)	\$0.1	\$0.5	\$0.4	1,914	82	
13	Urbana - Clark	Line	DAY	\$0.1	\$0.0	\$0.3	\$0.4	\$0.0	\$0.0	\$0.0	\$0.0	\$0.4	1,422	0	
14	East Bend	Transformer	DEOK	\$0.0	\$0.0	\$0.4	\$0.4	\$0.0	\$0.0	\$0.0	\$0.0	\$0.4	10,164	0	
15	5004/5005 Interface	Interface	500	(\$2.0)	(\$2.0)	(\$0.1)	(\$0.1)	\$0.4	\$0.1	\$0.2	\$0.5	\$0.3	1,108	672	
104	Greene - Clark	Line	DAY	(\$0.0)	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	308	0	
112	Shelby - Miami	Line	DAY	(\$0.0)	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	420	0	
140	Trenton - Hutchings	Line	DAY	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	46	0	
347	Darby - Watkins Tap	Line	DAY	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	4	0	
395	College Corner - Drewersburg	Line	DAY	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	30	0	

DEOK Control Zone

Table G-35 DEOK Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)															
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours			
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time	
1	Miami Fort - Willey	Line	DEOK	\$7.8	\$1.1	\$0.9	\$7.6	\$0.8	\$0.4	(\$0.6)	(\$0.3)	\$7.4	3,170	224	
2	Person - Halifax	Flowgate	MISO	(\$14.4)	(\$9.3)	(\$0.0)	(\$5.1)	\$0.0	\$0.0	\$0.0	\$0.0	(\$5.1)	2,824	12	
3	5004/5005 Interface	Interface	500	(\$15.0)	(\$10.1)	(\$0.0)	(\$4.9)	\$1.0	\$0.5	\$0.1	\$0.5	(\$4.4)	1,356	642	
4	Beckjord - Pierce	Line	DEOK	\$5.3	\$1.6	\$0.2	\$3.9	\$0.1	\$0.0	(\$0.1)	(\$0.0)	\$3.8	954	52	
5	East Bend	Transformer	DEOK	(\$0.0)	(\$3.8)	(\$0.0)	\$3.7	\$0.0	\$0.0	\$0.0	\$0.0	\$3.7	5,616	0	
6	Miami Fort - Hebron	Line	DEOK	\$4.0	\$0.8	\$0.1	\$3.2	\$0.0	\$0.0	\$0.0	\$0.0	\$3.2	1,048	0	
7	Bagley - Graceton	Line	BGE	\$7.0	\$4.2	\$0.0	\$2.8	(\$0.0)	(\$0.2)	(\$0.0)	\$0.2	\$3.0	7,088	3,946	
8	Bedington - Black Oak	Interface	500	(\$9.2)	(\$6.2)	(\$0.1)	(\$3.1)	\$0.3	\$0.1	\$0.0	\$0.2	(\$2.9)	5,866	688	
9	Conastone - Northwest	Line	BGE	\$6.4	\$3.8	\$0.1	\$2.7	\$0.0	(\$0.1)	(\$0.1)	(\$0.0)	\$2.7	5,072	3,468	
10	Miami Fort	Transformer	DEOK	\$2.2	\$0.0	\$0.1	\$2.3	\$0.0	(\$0.1)	(\$0.0)	\$0.0	\$2.3	1,630	6	
11	Joshua Falls	Transformer	AEP	(\$6.2)	(\$4.1)	(\$0.0)	(\$2.1)	\$0.1	\$0.1	\$0.0	\$0.0	(\$2.1)	1,128	108	
12	AEP - DOM	Interface	500	(\$7.7)	(\$5.5)	(\$0.1)	(\$2.3)	\$0.3	\$0.0	\$0.0	\$0.2	(\$2.1)	2,656	88	
13	Bunsonville - Eugene	Flowgate	MISO	\$5.4	\$3.5	\$0.1	\$2.0	(\$0.0)	(\$0.0)	\$0.0	(\$0.0)	\$1.9	7,524	1,496	
14	AP South	Interface	500	(\$5.6)	(\$4.0)	(\$0.1)	(\$1.7)	\$0.0	\$0.0	\$0.0	\$0.0	(\$1.7)	2,570	84	
15	Terminal	Transformer	DEOK	\$2.1	(\$0.4)	(\$0.0)	\$2.5	(\$0.2)	(\$0.0)	(\$0.6)	(\$0.8)	\$1.7	870	104	
16	Miami Fort - Greendale	Line	DEOK	\$1.8	\$0.5	\$0.3	\$1.6	\$0.0	\$0.0	\$0.0	\$0.0	\$1.6	438	0	
22	Miami Fort - Clifty Creek	Line	DEOK	\$1.1	\$0.3	\$0.1	\$1.0	\$0.0	\$0.0	(\$0.1)	(\$0.1)	\$0.9	268	38	
31	Buffington	Transformer	DEOK	\$0.6	\$0.1	\$0.1	\$0.5	\$0.0	\$0.0	\$0.0	\$0.0	\$0.5	80	0	
39	Fairfield - Willey	Line	DEOK	\$0.1	(\$0.0)	\$0.0	\$0.1	\$0.5	\$0.1	(\$0.1)	\$0.2	\$0.3	48	46	
42	Foster - Pierce	Line	DEOK	\$0.0	\$0.0	\$0.0	\$0.0	\$0.2	(\$0.1)	(\$0.1)	\$0.3	\$0.3	0	38	

Table G-36 DEOK Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)															
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours			
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time	
1	AP South	Interface	500	(\$43.7)	(\$35.2)	(\$0.1)	(\$8.6)	\$0.9	\$3.6	\$0.1	(\$2.6)	(\$11.3)	10,180	1,962	
2	West	Interface	500	(\$45.0)	(\$37.8)	(\$0.1)	(\$7.3)	(\$0.2)	\$1.8	\$0.2	(\$1.8)	(\$9.1)	3,068	830	
3	Miami Fort - Hebron	Line	DEOK	\$4.2	\$0.5	\$0.4	\$4.1	(\$0.3)	(\$0.1)	(\$0.0)	(\$0.2)	\$3.9	3,228	74	
4	Breed - Wheatland	Flowgate	MISO	\$10.3	\$7.7	\$0.8	\$3.5	\$0.1	(\$0.2)	(\$0.4)	(\$0.1)	\$3.4	7,516	1,204	
5	Batesville - Hubble	Flowgate	MISO	\$4.8	\$1.9	\$0.4	\$3.3	(\$0.0)	\$0.0	(\$0.3)	(\$0.3)	\$3.0	876	32	
6	Miami Fort	Transformer	DEOK	\$2.2	(\$0.2)	\$0.9	\$3.2	\$0.3	(\$0.2)	(\$0.8)	(\$0.2)	\$3.0	17,640	46	
7	Cloverdale	Transformer	AEP	(\$14.5)	(\$12.1)	(\$0.0)	(\$2.4)	\$0.1	\$0.3	\$0.0	(\$0.2)	(\$2.7)	8,246	572	
8	Todd Hunter	Flowgate	MISO	\$1.1	(\$1.1)	(\$0.1)	\$2.1	\$0.0	\$0.0	\$0.0	\$0.0	\$2.1	1,734	0	
9	Bagley - Graceton	Line	BGE	\$7.0	\$4.7	\$0.1	\$2.4	(\$0.5)	(\$0.2)	(\$0.1)	(\$0.3)	\$2.1	9,168	3,768	
10	Bedington - Black Oak	Interface	500	(\$9.0)	(\$6.7)	(\$0.0)	(\$2.3)	\$0.3	\$0.2	\$0.1	\$0.2	(\$2.1)	5,592	646	
11	Cook - Palisades	Flowgate	MISO	(\$4.8)	(\$2.9)	\$0.1	(\$1.8)	\$0.2	(\$0.2)	(\$0.3)	\$0.0	(\$1.8)	4,632	616	
12	Benton Harbor - Palisades	Flowgate	MISO	(\$7.3)	(\$5.6)	\$0.1	(\$1.5)	\$0.1	\$0.1	(\$0.0)	(\$0.0)	(\$1.6)	6,050	274	
13	Lakeview - Greenfield	Line	ATSI	(\$4.6)	(\$3.8)	(\$0.1)	(\$0.8)	(\$0.2)	\$0.6	\$0.1	(\$0.7)	(\$1.5)	1,828	312	
14	East Bend	Transformer	DEOK	(\$0.0)	(\$2.0)	(\$0.5)	\$1.4	\$0.0	\$0.0	\$0.0	\$0.0	\$1.4	10,164	0	
15	AEP - DOM	Interface	500	(\$3.2)	(\$2.4)	\$0.0	(\$0.8)	(\$0.1)	\$0.5	\$0.1	(\$0.6)	(\$1.4)	5,022	132	
17	Silver Grove	Other	DEOK	\$0.6	(\$0.5)	\$0.2	\$1.3	\$0.0	\$0.0	\$0.0	\$0.0	\$1.3	1,318	0	
24	Toddhunt	Transformer	DEOK	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.7	\$0.1	\$0.0	\$0.6	\$0.6	86	68	
32	East Bend - Miami Fort	Line	DEOK	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.0)	\$0.0	(\$0.3)	(\$0.3)	(\$0.3)	0	16	
69	Charles - Rochelle	Line	DEOK	\$0.1	(\$0.0)	(\$0.0)	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	46	0	
87	Rochelle - Terminal	Line	DEOK	\$0.1	\$0.0	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	40	0	

DLCO Control Zone

Table G-37 DLCO Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	Dravosburg - West Mifflin	Line	DLCO	(\$13.5)	(\$11.0)	(\$0.4)	(\$2.9)	(\$1.7)	\$0.5	\$0.3	(\$1.8)	(\$4.7)	904	514
2	Arsenal - Oakland	Line	DLCO	\$0.3	(\$1.4)	\$0.0	\$1.7	\$0.0	\$0.0	\$0.0	\$0.0	\$1.7	228	0
3	Arsenal - Brunot Island	Line	DLCO	\$1.2	\$0.2	\$0.0	\$1.0	(\$0.0)	(\$0.1)	(\$0.0)	\$0.1	\$1.1	132	4
4	Mahans Lane - Tidd	Line	AEP	(\$0.8)	(\$1.8)	(\$0.0)	\$0.9	(\$0.0)	\$0.0	\$0.0	(\$0.0)	\$0.9	2,098	788
5	Beaver Valley - Valley	Line	DLCO	\$0.6	(\$0.2)	\$0.0	\$0.8	\$0.0	\$0.0	\$0.0	\$0.0	\$0.8	136	0
6	5004/5005 Interface	Interface	500	(\$10.5)	(\$12.0)	(\$0.2)	\$1.3	(\$0.3)	\$0.4	\$0.1	(\$0.5)	\$0.8	1,356	642
7	Person - Halifax	Flowgate	MISO	(\$1.4)	(\$2.1)	(\$0.0)	\$0.6	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	\$0.6	2,824	12
8	Crescent	Transformer	DLCO	\$1.3	(\$0.1)	\$0.1	\$1.5	\$0.0	\$0.0	(\$0.9)	(\$0.9)	\$0.6	320	118
9	AP South	Interface	500	(\$4.6)	(\$5.3)	(\$0.1)	\$0.6	(\$0.0)	\$0.0	\$0.0	(\$0.1)	\$0.6	2,570	84
10	Bedington - Black Oak	Interface	500	(\$7.9)	(\$8.7)	(\$0.2)	\$0.7	(\$0.1)	\$0.2	\$0.1	(\$0.1)	\$0.6	5,866	688
11	AEP - DOM	Interface	500	(\$2.3)	(\$2.8)	(\$0.0)	\$0.5	(\$0.0)	\$0.0	\$0.0	(\$0.0)	\$0.5	2,656	88
12	Collier	Transformer	DLCO	\$0.6	\$0.2	\$0.0	\$0.4	\$0.0	\$0.0	\$0.0	\$0.0	\$0.4	120	0
13	Hoyt Dale - Maple	Line	ATSI	(\$1.0)	(\$1.4)	(\$0.1)	\$0.4	(\$0.0)	\$0.2	\$0.2	\$0.0	\$0.4	142	170
14	Tiltonsville - Windsor	Line	AP	\$0.9	\$0.6	\$0.0	\$0.4	\$0.0	(\$0.0)	(\$0.0)	\$0.0	\$0.4	658	20
15	West Akron - Brush	Line	ATSI	(\$1.0)	(\$1.3)	(\$0.0)	\$0.3	(\$0.0)	(\$0.0)	\$0.0	\$0.0	\$0.3	250	80
24	USAP - Woodville	Line	DLCO	(\$3.1)	(\$3.1)	(\$0.2)	(\$0.2)	\$0.0	\$0.0	\$0.3	\$0.3	\$0.2	358	222
28	Crescent - Mansfield	Line	DLCO	\$0.1	(\$0.1)	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	20	0
32	Beaver - Mansfield	Line	DLCO	\$0.5	\$0.5	\$0.3	\$0.4	\$0.0	(\$0.0)	(\$0.5)	(\$0.5)	(\$0.1)	240	146
36	Crescent - Mt Nebo	Line	DLCO	\$0.1	(\$0.0)	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	62	0
45	Beaver - Sammis	Line	DLCO	(\$0.0)	(\$0.1)	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	66	0

Table G-38 DLCO Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total	Grand Total	Day Ahead	Real Time
1	West	Interface	500	(\$29.8)	(\$26.3)	(\$0.8)	(\$4.2)	(\$0.4)	\$0.8	\$0.2	(\$1.0)	(\$5.3)	3,068	830
2	AP South	Interface	500	(\$44.0)	(\$43.8)	(\$2.1)	(\$2.4)	(\$1.8)	\$2.4	\$2.3	(\$1.9)	(\$4.3)	10,180	1,962
3	USAP - Woodville	Line	DLCO	(\$7.7)	(\$6.6)	(\$0.8)	(\$2.0)	(\$0.2)	\$0.4	\$0.2	(\$0.4)	(\$2.4)	1,490	244
4	Collier	Transformer	DLCO	\$2.5	\$0.7	\$0.1	\$1.8	(\$0.1)	(\$0.0)	(\$0.4)	(\$0.4)	\$1.4	160	50
5	Dravosburg - West Mifflin	Line	DLCO	(\$3.3)	(\$2.8)	(\$0.2)	(\$0.7)	(\$0.3)	\$1.0	\$1.0	(\$0.3)	(\$1.0)	578	202
6	Crescent	Transformer	DLCO	\$0.9	\$0.0	\$0.1	\$1.0	\$0.1	(\$0.0)	(\$0.1)	(\$0.0)	\$1.0	412	46
7	Rivesville - Wove	Line	AP	\$1.1	\$0.4	\$0.1	\$0.9	\$0.0	(\$0.0)	(\$0.1)	(\$0.1)	\$0.8	794	340
8	Arsenal - Oakland	Line	DLCO	(\$0.0)	(\$0.8)	(\$0.0)	\$0.8	(\$0.0)	(\$0.0)	\$0.0	(\$0.0)	\$0.8	300	12
9	Cook - Palisades	Flowgate	MISO	\$1.8	\$2.6	\$0.2	(\$0.5)	\$0.0	(\$0.0)	(\$0.2)	(\$0.1)	(\$0.7)	4,632	616
10	Lakeview - Greenfield	Line	ATSI	\$3.5	\$3.3	\$0.6	\$0.8	\$0.2	(\$0.2)	(\$0.7)	(\$0.3)	\$0.5	1,828	312
11	Benton Harbor - Palisades	Flowgate	MISO	\$2.8	\$3.7	\$0.5	(\$0.4)	\$0.0	\$0.0	(\$0.1)	(\$0.1)	(\$0.5)	6,050	274
12	Clinton - Findlay	Line	DLCO	\$0.4	(\$0.0)	\$0.1	\$0.5	\$0.0	(\$0.0)	(\$0.0)	\$0.0	\$0.5	326	16
13	Beaver - Sammis	Line	DLCO	(\$0.5)	(\$1.0)	(\$0.0)	\$0.4	(\$0.0)	\$0.0	\$0.1	\$0.0	\$0.5	426	30
14	Michigan City - Laporte	Flowgate	MISO	\$1.0	\$1.4	(\$0.0)	(\$0.4)	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.4)	6,222	0
15	5004/5005 Interface	Interface	500	(\$2.2)	(\$2.3)	(\$0.1)	\$0.1	(\$0.2)	\$0.4	\$0.2	(\$0.4)	(\$0.3)	1,108	672
18	Arsenal - Brunot Island	Line	DLCO	\$0.4	\$0.1	\$0.0	\$0.3	\$0.0	\$0.0	\$0.0	\$0.0	\$0.3	192	0
20	Beaver - Hanna	Line	DLCO	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	\$0.3	\$0.2	\$0.2	0	124
23	Beaver Valley - Hanna	Line	DLCO	(\$0.7)	(\$1.0)	(\$0.2)	\$0.2	\$0.0	\$0.0	\$0.0	\$0.0	\$0.2	242	0
30	St. Joe - Valley	Line	DLCO	(\$0.0)	(\$0.0)	\$0.1	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	1,774	0
37	Crescent - Montour	Line	DLCO	\$0.1	\$0.0	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	36	0

Table G-39 EKPC Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)															
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours			
				Load Payments	Generation			Load Payments	Generation			Grand Total	Day Ahead	Real Time	
					Credits	Explicit	Total		Credits	Explicit	Total				
1	AEP - DOM	Interface	500	\$0.0	(\$1.9)	\$0.0	\$1.9	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$1.9	2,656	88	
2	SummerShadeTVA - SummerShadeTap	Flowgate	MISO	\$0.0	\$0.0	\$0.0	\$0.0	(\$1.2)	\$0.2	(\$0.3)	(\$1.7)	(\$1.7)	0	38	
3	Person - Halifax	Flowgate	MISO	(\$9.5)	(\$8.2)	(\$0.1)	(\$1.4)	(\$0.0)	\$0.0	\$0.0	(\$0.0)	(\$1.4)	2,824	12	
4	5004/5005 Interface	Interface	500	(\$7.7)	(\$7.2)	(\$0.0)	(\$0.5)	\$0.2	\$1.1	\$0.0	(\$0.9)	(\$1.3)	1,356	642	
5	Miami Fort - Willey	Line	DEOK	(\$0.7)	\$0.5	(\$0.0)	(\$1.2)	(\$0.0)	(\$0.0)	\$0.1	\$0.1	(\$1.1)	3,170	224	
6	Bagley - Graceton	Line	BGE	\$3.4	\$2.4	\$0.1	\$1.1	(\$0.0)	(\$0.1)	(\$0.1)	(\$0.0)	\$1.1	7,088	3,946	
7	Conastone - Northwest	Line	BGE	\$3.1	\$2.1	\$0.1	\$1.0	(\$0.1)	(\$0.1)	(\$0.1)	(\$0.0)	\$1.0	5,072	3,468	
8	East Danville - Banister	Line	AEP	(\$1.0)	(\$0.4)	(\$0.0)	(\$0.6)	(\$0.0)	\$0.0	\$0.0	(\$0.0)	(\$0.6)	6,930	252	
9	Bedington - Black Oak	Interface	500	(\$4.2)	(\$3.8)	(\$0.0)	(\$0.4)	(\$0.1)	\$0.2	(\$0.0)	(\$0.2)	(\$0.6)	5,866	688	
10	Joshua Falls	Transformer	AEP	(\$3.8)	(\$3.5)	(\$0.0)	(\$0.3)	(\$0.1)	\$0.2	\$0.0	(\$0.2)	(\$0.5)	1,128	108	
11	Beckjord - Pierce	Line	DEOK	\$0.2	\$0.6	\$0.0	(\$0.4)	\$0.0	\$0.1	(\$0.0)	(\$0.1)	(\$0.5)	954	52	
12	Person - Halifax	Line	Dominion	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.5	\$0.0	(\$0.5)	(\$0.5)	0	538	
13	Batesville - Hubble	Flowgate	MISO	(\$0.5)	\$0.1	(\$0.1)	(\$0.7)	\$0.1	(\$0.1)	(\$0.0)	\$0.2	(\$0.4)	430	246	
14	Belmont	Transformer	AP	(\$1.1)	(\$0.8)	(\$0.0)	(\$0.3)	(\$0.0)	\$0.1	\$0.0	(\$0.1)	(\$0.4)	1,680	188	
15	Breed - Wheatland	Flowgate	MISO	\$1.1	\$0.7	\$0.1	\$0.5	\$0.0	(\$0.0)	(\$0.1)	(\$0.1)	\$0.4	2,716	298	
19	Barren County	Transformer	EKPC	\$0.2	(\$0.0)	\$0.1	\$0.3	\$0.0	\$0.0	\$0.0	\$0.0	\$0.3	140	0	
34	Bonnville - Bonnville	Line	EKPC	\$0.1	\$0.0	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	44	0	
41	Sumshade	Transformer	EKPC	\$0.1	\$0.0	\$0.0	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	34	0	
47	Jamestown - Russel Junction City	Line	EKPC	\$0.0	(\$0.1)	(\$0.0)	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	28	0	
162	Marion County - Marion	Line	EKPC	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	\$0.0	12	0	

Table G-40 EKPC Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)															
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours			
				Load Payments	Generation			Load Payments	Generation			Grand Total	Day Ahead	Real Time	
					Credits	Explicit	Total		Credits	Explicit	Total				
1	Monticello - East Winamac	Flowgate	MISO	(\$3.5)	(\$0.8)	(\$0.6)	(\$3.3)	(\$0.0)	\$0.2	\$0.2	(\$0.1)	(\$3.4)	7,022	2,880	
2	West	Interface	500	(\$25.0)	(\$23.6)	(\$0.0)	(\$1.4)	\$0.3	\$1.1	\$0.0	(\$0.8)	(\$2.2)	3,068	830	
3	Breed - Wheatland	Flowgate	MISO	\$6.2	\$4.4	\$0.2	\$2.0	\$0.1	\$0.1	(\$0.1)	(\$0.1)	\$1.9	7,516	1,204	
4	Cloverdale	Transformer	AEP	(\$9.0)	(\$7.7)	(\$0.1)	(\$1.4)	\$0.1	\$0.4	\$0.0	(\$0.2)	(\$1.5)	8,246	572	
5	Benton Harbor - Palisades	Flowgate	MISO	(\$4.2)	(\$3.2)	(\$0.0)	(\$1.1)	\$0.0	\$0.0	(\$0.0)	(\$0.0)	(\$1.1)	6,050	274	
6	AP South	Interface	500	(\$18.8)	(\$19.7)	\$0.2	\$1.1	(\$0.3)	\$1.7	(\$0.2)	(\$2.1)	(\$1.0)	10,180	1,962	
7	Huntington Junction - Huntington	Line	AP	\$0.0	\$0.0	(\$1.0)	(\$1.0)	\$0.0	\$0.0	\$0.0	\$0.0	(\$1.0)	9,016	0	
8	Batesville - Hubble	Flowgate	MISO	(\$0.7)	\$0.1	(\$0.1)	(\$0.9)	\$0.0	(\$0.0)	\$0.0	\$0.0	(\$0.9)	876	32	
9	Bagley - Graceton	Line	BGE	\$3.1	\$2.4	\$0.2	\$0.9	\$0.0	(\$0.1)	(\$0.2)	(\$0.1)	\$0.9	9,168	3,768	
10	Cook - Palisades	Flowgate	MISO	(\$2.6)	(\$2.0)	(\$0.1)	(\$0.7)	\$0.0	\$0.0	(\$0.0)	(\$0.0)	(\$0.7)	4,632	616	
11	AEP - DOM	Interface	500	(\$0.5)	(\$1.0)	\$0.1	\$0.6	\$0.2	\$0.0	(\$0.1)	\$0.0	\$0.7	5,022	132	
12	Wolf Creek	Transformer	AEP	(\$1.3)	(\$1.3)	\$0.0	\$0.0	(\$0.1)	\$0.6	\$0.0	(\$0.7)	(\$0.7)	10,204	262	
13	5004/5005 Interface	Interface	500	(\$1.5)	(\$1.4)	(\$0.0)	(\$0.1)	(\$0.0)	\$0.4	\$0.0	(\$0.4)	(\$0.5)	1,108	672	
14	Lakeview - Greenfield	Line	ATSI	(\$2.3)	(\$2.1)	(\$0.0)	(\$0.2)	\$0.0	\$0.3	\$0.0	(\$0.2)	(\$0.4)	1,828	312	
15	Nelson - Cordova	Line	ComEd	(\$0.9)	(\$0.6)	(\$0.0)	(\$0.4)	(\$0.0)	\$0.0	\$0.0	\$0.0	(\$0.4)	8,214	558	
20	Kenton - Spurlock	Line	EKPC	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.0)	\$0.3	\$0.0	(\$0.2)	(\$0.2)	0	130	
39	Renaker - Spurlock	Line	EKPC	(\$0.0)	(\$0.1)	(\$0.0)	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	24	0	
46	Jellico - Mcreryco	Line	EKPC	\$0.1	\$0.0	(\$0.0)	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$0.1	88	0	
58	Jacksonville - Renaker	Line	EKPC	\$0.0	(\$0.0)	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.0)	(\$0.0)	\$0.0	26	14	
93	Summer Shade - Summer Shade Tap	Line	EKPC	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	(\$0.0)	0	16	

South Region Congestion-Event Summaries

Dominion Control Zone

Table G-41 Dominion Control Zone top congestion cost impacts (By facility): 2015

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation		Total	Load Payments	Generation		Total	Grand Total	Day Ahead	Real Time
					Credits	Explicit			Credits	Explicit				
1	AP South	Interface	500	\$93.1	\$73.5	(\$1.3)	\$18.2	\$0.0	\$0.0	\$0.2	\$0.3	\$18.5	2,570	84
2	Bedington - Black Oak	Interface	500	\$104.2	\$88.1	\$1.3	\$17.4	(\$0.0)	(\$0.6)	(\$0.6)	(\$0.0)	\$17.4	5,866	688
3	Valley	Transformer	Dominion	\$67.9	\$53.1	\$1.6	\$16.3	(\$0.6)	(\$0.4)	(\$2.4)	(\$2.6)	\$13.8	1,736	180
4	Bagley - Graceton	Line	BGE	\$165.1	\$156.7	\$2.2	\$10.6	(\$1.9)	(\$2.1)	(\$2.0)	(\$1.9)	\$8.7	7,088	3,946
5	Person - Halifax	Flowgate	MISO	\$178.9	\$186.4	(\$0.7)	(\$8.2)	\$0.0	(\$0.0)	(\$0.1)	(\$0.0)	(\$8.2)	2,824	12
6	Conastone - Northwest	Line	BGE	\$154.8	\$146.2	\$2.2	\$10.8	(\$2.7)	(\$1.7)	(\$2.8)	(\$3.7)	\$7.1	5,072	3,468
7	AEP - DOM	Interface	500	\$82.5	\$78.0	(\$0.8)	\$3.7	(\$0.5)	(\$0.1)	\$0.2	(\$0.2)	\$3.5	2,656	88
8	Everetts - Greenville	Line	Dominion	\$15.5	\$12.4	\$0.8	\$3.9	(\$0.1)	(\$0.4)	(\$0.7)	(\$0.4)	\$3.5	1,364	166
9	Glenarm - Windy Edge	Line	BGE	\$22.8	\$20.4	\$0.4	\$2.8	(\$0.4)	(\$1.1)	(\$0.3)	\$0.4	\$3.2	1,802	844
10	Cloverdale	Transformer	AEP	\$19.2	\$15.6	\$0.1	\$3.7	\$0.1	\$0.3	(\$0.4)	(\$0.5)	\$3.1	1,456	188
11	Greenwich - Elizabeth River	Line	Dominion	\$5.0	\$2.0	\$0.0	\$3.1	\$0.0	\$0.0	\$0.0	\$0.0	\$3.1	54	0
12	5004/5005 Interface	Interface	500	(\$36.3)	(\$38.5)	(\$0.0)	\$2.1	\$0.4	(\$0.3)	\$0.1	\$0.8	\$3.0	1,356	642
13	Yadkin	Transformer	Dominion	\$6.6	\$3.3	\$0.2	\$3.4	\$0.8	\$0.7	(\$0.8)	(\$0.7)	\$2.8	132	50
14	Powhatan - Bremono	Line	Dominion	\$3.1	\$1.0	\$0.1	\$2.2	\$0.3	\$0.2	(\$0.2)	(\$0.1)	\$2.1	294	94
15	Beechwood D.P. - Five Fork	Line	Dominion	\$3.7	\$1.5	\$0.4	\$2.5	(\$0.0)	\$0.2	(\$0.3)	(\$0.5)	\$2.1	1,626	128
16	Beechwood D.P. - Kerr Dam	Line	Dominion	\$3.5	\$1.8	\$0.9	\$2.6	\$0.1	\$0.8	(\$0.4)	(\$1.2)	\$1.4	1,736	138
21	Greenwich - Chesapeake Energy Center	Line	Dominion	\$0.0	\$0.0	\$0.0	\$0.0	(\$0.7)	\$0.1	(\$0.2)	(\$1.0)	(\$1.0)	0	42
24	Charlottesville - Proffit D.P.	Line	Dominion	\$1.4	\$0.8	\$0.4	\$1.0	\$0.1	\$0.1	(\$0.0)	(\$0.1)	\$0.9	760	32
25	Halifax - Halifax Worsted	Line	Dominion	\$0.1	\$0.0	\$0.8	\$0.9	\$0.0	\$0.0	\$0.0	\$0.0	\$0.9	2,390	0
26	Four Rivers - Hanover	Line	Dominion	\$0.6	(\$0.2)	\$0.0	\$0.8	\$0.1	\$0.0	\$0.0	\$0.0	\$0.9	68	10

Table G-42 Dominion Control Zone top congestion cost impacts (By facility): 2014

Congestion Costs (Millions)														
No.	Constraint	Type	Location	Day Ahead				Balancing				Event Hours		
				Load Payments	Generation		Total	Load Payments	Generation		Total	Grand Total	Day Ahead	Real Time
					Credits	Explicit			Credits	Explicit				
1	AP South	Interface	500	\$875.4	\$727.9	\$8.5	\$156.0	\$5.9	\$14.1	(\$7.2)	(\$15.5)	\$140.5	10,180	1,962
2	Cloverdale	Transformer	AEP	\$120.7	\$99.6	\$3.0	\$24.1	\$0.4	(\$0.5)	(\$0.8)	\$0.1	\$24.2	8,246	572
3	West	Interface	500	(\$223.7)	(\$208.1)	(\$10.4)	(\$26.0)	(\$0.0)	(\$2.0)	\$2.2	\$4.1	(\$21.9)	3,068	830
4	Bagley - Graceton	Line	BGE	\$177.3	\$164.0	\$3.3	\$16.5	(\$1.4)	(\$4.3)	(\$3.1)	(\$0.2)	\$16.3	9,168	3,768
5	Bedington - Black Oak	Interface	500	\$89.4	\$75.3	\$3.2	\$17.4	(\$0.0)	(\$0.9)	(\$2.8)	(\$1.9)	\$15.4	5,592	646
6	Wake - Carso	Flowgate	MISO	\$0.0	\$0.0	\$0.0	\$0.0	\$1.5	\$0.0	(\$8.7)	(\$7.1)	(\$7.1)	0	230
7	Everetts - Greenville	Line	Dominion	\$20.6	\$17.1	\$2.1	\$5.6	\$0.0	\$0.0	\$0.0	\$0.0	\$5.6	1,372	0
8	Lynnhaven - Landstown	Line	Dominion	\$6.9	\$3.3	\$0.2	\$3.8	\$0.5	\$0.6	(\$0.6)	(\$0.6)	\$3.1	220	102
9	Readington - Roseland	Line	PSEG	(\$21.1)	(\$19.3)	(\$1.2)	(\$2.9)	\$0.1	\$0.2	\$0.5	\$0.4	(\$2.5)	2,338	378
10	Loudoun	Transformer	Dominion	\$1.4	(\$1.9)	\$0.1	\$3.4	\$0.2	\$0.4	(\$0.8)	(\$1.0)	\$2.4	240	90
11	Brambleton - Loudoun	Line	Dominion	(\$59.4)	(\$62.0)	(\$0.7)	\$1.9	(\$0.1)	(\$0.4)	\$0.1	\$0.4	\$2.3	194	28
12	AEP - DOM	Interface	500	\$32.4	\$30.4	\$0.2	\$2.2	\$0.8	\$4.1	(\$1.0)	(\$4.3)	(\$2.0)	5,022	132
13	5004/5005 Interface	Interface	500	(\$6.6)	(\$7.3)	(\$0.1)	\$0.6	\$0.2	\$0.0	\$1.0	\$1.2	\$1.8	1,108	672
14	Grottoes - Elkton	Line	Dominion	\$0.7	(\$1.2)	(\$0.0)	\$1.8	\$0.0	\$0.0	\$0.0	\$0.0	\$1.8	816	0
15	Valley	Transformer	Dominion	\$14.1	\$10.3	\$0.8	\$4.7	(\$0.7)	\$0.2	(\$2.0)	(\$2.9)	\$1.8	698	124
18	Loudoun - Gainsville	Line	Dominion	(\$2.2)	(\$3.6)	(\$0.1)	\$1.3	\$0.0	\$0.0	\$0.0	\$0.0	\$1.3	120	0
21	Dooms	Transformer	Dominion	\$3.0	\$1.8	\$0.2	\$1.4	(\$0.2)	\$0.0	(\$0.3)	(\$0.4)	\$1.0	158	10
22	Crozet - Dooms	Line	Dominion	\$2.5	\$1.7	\$0.2	\$1.0	\$0.0	\$0.0	(\$0.1)	(\$0.1)	\$1.0	438	8
25	Fredericksburg - Cranes Corner	Line	Dominion	(\$1.8)	(\$2.7)	(\$0.1)	\$0.8	\$0.0	\$0.0	\$0.0	\$0.0	\$0.8	72	4
26	Carolina	Transformer	Dominion	\$0.8	\$0.3	\$0.4	\$0.8	\$0.0	\$0.0	\$0.0	\$0.0	\$0.8	1,636	2

Marginal Losses

Zonal Marginal Loss Costs

Table G-43 provides marginal loss costs by control zone and type for 2015. Table G-44 provides total marginal loss costs by control zone and month for 2014 and 2015. The total marginal loss cost for the External category was \$50.3 million in 2015.

Table G-43 Marginal loss costs by control zone and type (Dollars (Millions)): 2015

	Marginal Loss Costs by Control Zone (Millions)									
	Day Ahead				Balancing				Inadvertent Charges	Grand Total
	Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total		
AECO	\$8.4	(\$1.1)	\$0.9	\$10.5	\$0.3	(\$0.5)	(\$1.1)	(\$0.3)	\$0.0	\$10.1
AEP	(\$100.9)	(\$317.0)	(\$0.2)	\$216.0	\$4.3	\$7.9	(\$11.0)	(\$14.6)	\$0.0	\$201.4
AP	(\$2.7)	(\$58.4)	\$2.1	\$57.7	\$0.6	\$0.5	(\$4.3)	(\$4.2)	\$0.0	\$53.5
ATSI	\$22.3	(\$45.3)	\$4.1	\$71.7	\$5.9	\$2.6	(\$6.8)	(\$3.5)	\$0.0	\$68.2
BGE	\$54.7	\$24.5	\$3.1	\$33.3	\$1.0	(\$2.0)	(\$3.4)	(\$0.4)	\$0.0	\$32.9
ComEd	(\$216.3)	(\$370.0)	(\$1.0)	\$152.7	\$5.7	(\$1.0)	(\$0.7)	\$6.0	\$0.0	\$158.7
DAY	\$5.7	(\$29.6)	\$4.6	\$39.9	\$0.0	(\$0.5)	(\$4.1)	(\$3.6)	\$0.0	\$36.3
DEOK	(\$32.2)	(\$37.2)	\$2.0	\$7.0	\$3.5	\$1.1	(\$2.2)	\$0.2	\$0.0	\$7.1
DLCO	(\$12.4)	(\$23.1)	\$0.1	\$10.8	(\$0.2)	\$0.1	(\$0.2)	(\$0.5)	\$0.0	\$10.2
Dominion	\$87.3	(\$6.4)	\$2.4	\$96.1	\$2.3	\$1.1	(\$4.7)	(\$3.6)	\$0.0	\$92.5
DPL	\$31.9	\$5.4	\$3.2	\$29.8	(\$1.5)	(\$1.1)	(\$3.3)	(\$3.7)	\$0.0	\$26.1
EKPC	(\$19.4)	(\$25.0)	\$0.6	\$6.2	\$0.4	\$1.5	(\$0.9)	(\$2.0)	\$0.0	\$4.2
External	(\$1.5)	(\$51.3)	\$2.0	\$51.8	(\$2.8)	(\$1.6)	(\$0.4)	(\$1.6)	\$0.0	\$50.3
JCPL	\$21.4	\$6.4	\$0.6	\$15.6	\$0.5	\$0.0	(\$0.7)	(\$0.3)	\$0.0	\$15.3
Met-Ed	\$3.5	(\$13.7)	(\$0.1)	\$17.1	\$0.6	\$0.1	(\$0.3)	\$0.2	\$0.0	\$17.3
PECO	\$17.1	(\$14.5)	\$0.3	\$31.9	\$1.1	(\$0.3)	(\$0.6)	\$0.8	\$0.0	\$32.7
PENELEC	(\$17.4)	(\$67.5)	\$1.7	\$51.8	(\$0.2)	\$0.2	(\$3.2)	(\$3.6)	\$0.0	\$48.2
Pepco	\$49.8	\$25.5	\$1.1	\$25.4	\$0.1	(\$0.8)	(\$1.9)	(\$0.9)	\$0.0	\$24.4
PPL	\$2.4	(\$39.2)	(\$0.4)	\$41.1	\$1.2	\$0.5	(\$0.1)	\$0.6	\$0.0	\$41.7
PSEG	\$43.2	\$5.2	\$6.5	\$44.6	(\$0.9)	\$3.4	(\$4.0)	(\$8.4)	\$0.0	\$36.2
RECO	\$1.6	\$0.1	\$0.3	\$1.9	(\$0.1)	(\$0.0)	(\$0.4)	(\$0.5)	\$0.0	\$1.3
Total	(\$53.4)	(\$1,032.2)	\$33.8	\$1,012.6	\$21.7	\$11.3	(\$54.3)	(\$43.9)	\$0.0	\$968.7

Table G-44 Monthly marginal loss costs by control zone (Dollars (Millions)): 2014 and 2015

Marginal Loss Costs by Control Zone (Millions)														
2014														
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Inadvertent Charges	Grand Total
AECO	\$4.5	\$1.7	\$1.6	\$0.5	\$0.1	\$1.1	\$1.8	\$0.9	\$0.6	\$0.0	\$0.7	\$0.5	\$0.0	\$13.9
AEP	\$104.3	\$44.7	\$48.6	\$16.2	\$13.3	\$19.3	\$20.2	\$15.0	\$14.4	\$12.5	\$17.8	\$15.8	\$0.0	\$342.0
AP	\$29.5	\$10.9	\$10.7	\$2.9	\$2.7	\$4.4	\$4.5	\$3.7	\$4.2	\$3.7	\$4.5	\$4.0	\$0.0	\$85.8
ATSI	\$27.1	\$16.5	\$13.9	\$7.9	\$8.2	\$7.6	\$8.0	\$7.2	\$6.6	\$6.9	\$7.1	\$6.6	\$0.0	\$123.6
BGE	\$14.8	\$4.9	\$4.8	\$2.2	\$1.8	\$3.6	\$4.1	\$2.7	\$2.0	\$1.6	\$2.7	\$2.4	\$0.0	\$47.5
ComEd	\$59.4	\$23.9	\$25.3	\$13.0	\$10.3	\$14.8	\$14.5	\$11.6	\$11.7	\$11.1	\$17.0	\$13.9	\$0.0	\$226.5
DAY	\$17.4	\$8.6	\$6.1	\$2.8	\$2.4	\$3.5	\$4.0	\$3.4	\$3.5	\$3.1	\$3.8	\$3.0	\$0.0	\$61.8
DEOK	\$2.3	\$3.1	\$1.4	\$0.6	\$1.2	\$1.3	\$1.6	\$1.8	\$1.1	\$1.5	\$1.6	\$0.7	\$0.0	\$18.1
DLCO	(\$0.2)	\$2.2	\$2.7	\$1.3	\$0.4	\$1.2	\$1.2	\$1.0	\$1.1	\$1.1	\$1.5	\$1.1	\$0.0	\$14.6
Dominion	\$34.1	\$14.7	\$12.8	\$4.1	\$5.5	\$8.2	\$8.1	\$6.8	\$6.0	\$5.0	\$6.7	\$6.3	\$0.0	\$118.3
DPL	\$13.4	\$5.4	\$5.7	\$1.7	\$0.9	\$2.5	\$3.2	\$2.2	\$1.5	\$0.9	\$2.1	\$1.6	\$0.0	\$41.0
EKPC	\$4.9	\$3.1	\$2.0	\$0.6	\$0.6	\$0.8	\$0.5	\$0.3	\$0.6	\$0.3	\$0.3	\$0.4	\$0.0	\$14.2
External	\$23.9	\$6.5	\$5.5	(\$0.5)	\$0.6	\$1.5	\$1.5	\$0.9	\$0.0	\$0.0	\$0.6	\$1.2	\$0.0	\$41.7
JCPL	\$11.4	\$4.4	\$5.1	\$1.1	\$0.7	\$1.1	\$1.9	\$0.8	\$0.6	\$0.1	\$0.9	\$0.7	\$0.0	\$28.6
Met-Ed	\$4.9	\$2.6	\$2.3	\$1.5	\$1.5	\$1.6	\$1.4	\$1.3	\$1.5	\$1.6	\$1.2	\$1.7	\$0.0	\$23.1
PECO	\$7.6	\$4.9	\$4.7	\$2.8	\$5.1	\$3.0	\$2.7	\$2.9	\$3.1	\$3.7	\$2.2	\$2.9	\$0.0	\$45.4
PENELEC	\$13.1	\$10.1	\$7.6	\$4.7	\$7.1	\$6.7	\$5.0	\$5.6	\$4.4	\$4.5	\$4.8	\$4.4	\$0.0	\$78.0
Pepco	\$13.6	\$4.0	\$3.7	\$1.4	\$1.2	\$2.4	\$2.4	\$1.6	\$1.3	\$0.9	\$1.8	\$1.6	\$0.0	\$36.0
PPL	\$13.8	\$7.7	\$5.4	\$3.4	\$3.0	\$3.1	\$3.0	\$2.6	\$2.2	\$2.9	\$3.5	\$3.2	\$0.0	\$53.8
PSEG	\$13.6	\$5.5	\$5.1	\$3.3	\$2.1	\$2.4	\$2.9	\$3.0	\$2.8	\$3.0	\$2.5	\$3.5	\$0.0	\$49.7
RECO	\$1.0	\$0.5	\$0.5	\$0.1	\$0.0	\$0.1	\$0.2	\$0.1	\$0.0	(\$0.0)	\$0.1	\$0.1	\$0.0	\$2.6
Total	\$414.6	\$185.8	\$175.4	\$71.4	\$68.7	\$90.2	\$92.5	\$75.2	\$69.2	\$64.3	\$83.3	\$75.4	\$0.0	\$1,466.1
Marginal Loss Costs by Control Zone (Millions)														
2015														
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Inadvertent Charges	Grand Total
AECO	\$1.2	\$2.4	\$1.1	\$0.2	\$0.6	\$0.7	\$1.3	\$1.1	\$0.6	\$0.3	\$0.4	\$0.3	\$0.0	\$10.1
AEP	\$26.2	\$53.6	\$21.0	\$10.5	\$10.5	\$13.6	\$15.8	\$14.7	\$12.6	\$8.2	\$7.3	\$7.3	\$0.0	\$201.4
AP	\$5.9	\$13.7	\$4.9	\$2.0	\$2.0	\$3.5	\$4.8	\$4.3	\$4.3	\$2.9	\$2.7	\$2.6	\$0.0	\$53.5
ATSI	\$7.5	\$12.9	\$7.8	\$5.4	\$5.8	\$4.3	\$5.2	\$4.4	\$4.7	\$3.4	\$3.5	\$3.0	\$0.0	\$68.2
BGE	\$3.6	\$7.7	\$3.1	\$1.2	\$2.0	\$2.7	\$3.0	\$2.8	\$2.2	\$1.8	\$1.4	\$1.5	\$0.0	\$32.9
ComEd	\$18.0	\$29.8	\$12.6	\$11.0	\$12.5	\$11.3	\$13.0	\$10.7	\$9.8	\$11.8	\$9.9	\$8.4	\$0.0	\$158.7
DAY	\$3.4	\$7.5	\$2.3	\$1.7	\$2.8	\$3.0	\$3.1	\$3.0	\$2.9	\$2.7	\$1.8	\$2.2	\$0.0	\$36.3
DEOK	\$0.9	\$0.1	\$1.1	\$0.5	\$0.9	\$0.6	\$0.7	\$0.3	\$1.0	\$0.7	\$0.6	(\$0.1)	\$0.0	\$7.1
DLCO	\$1.2	\$2.3	\$1.1	\$0.5	\$0.4	\$0.7	\$0.9	\$0.7	\$0.6	\$0.3	\$0.8	\$0.7	\$0.0	\$10.2
Dominion	\$8.7	\$19.5	\$7.4	\$3.9	\$7.4	\$8.3	\$9.7	\$7.9	\$6.6	\$4.4	\$4.2	\$4.6	\$0.0	\$92.5
DPL	\$3.9	\$7.7	\$2.7	\$0.7	\$1.0	\$1.6	\$2.2	\$1.8	\$1.5	\$1.0	\$0.9	\$1.0	\$0.0	\$26.1
EKPC	(\$0.0)	\$2.0	(\$0.2)	(\$0.1)	\$0.1	\$0.3	\$1.0	\$0.3	\$0.3	\$0.1	\$0.2	\$0.3	\$0.0	\$4.2
External	\$7.1	\$16.5	\$6.7	\$2.3	\$1.9	\$2.3	\$3.7	\$3.2	\$2.0	\$1.4	\$1.1	\$2.2	\$0.0	\$50.3
JCPL	\$2.3	\$5.1	\$1.5	\$0.4	\$0.6	\$0.7	\$1.4	\$1.3	\$0.9	\$0.5	\$0.3	\$0.5	\$0.0	\$15.3
Met-Ed	\$1.9	\$3.0	\$1.7	\$1.4	\$1.2	\$1.4	\$1.5	\$1.5	\$1.2	\$1.0	\$0.7	\$1.1	\$0.0	\$17.3
PECO	\$2.6	\$4.9	\$2.8	\$2.7	\$3.4	\$2.6	\$3.0	\$2.5	\$2.5	\$1.7	\$2.0	\$1.9	\$0.0	\$32.7
PENELEC	\$5.4	\$9.7	\$5.1	\$3.4	\$3.5	\$3.7	\$4.2	\$3.9	\$3.3	\$1.9	\$2.3	\$1.9	\$0.0	\$48.2
Pepco	\$2.6	\$6.1	\$2.5	\$0.8	\$0.8	\$1.7	\$2.3	\$2.1	\$1.5	\$1.6	\$1.2	\$1.2	\$0.0	\$24.4
PPL	\$5.0	\$8.9	\$4.7	\$1.7	\$3.0	\$2.7	\$3.1	\$3.0	\$3.4	\$2.0	\$2.4	\$1.9	\$0.0	\$41.7
PSEG	\$4.2	\$6.3	\$3.3	\$2.0	\$2.2	\$2.7	\$3.7	\$3.4	\$3.1	\$1.8	\$1.3	\$2.0	\$0.0	\$36.2
RECO	\$0.2	\$0.4	\$0.2	(\$0.0)	\$0.0	\$0.1	\$0.2	\$0.2	\$0.1	\$0.0	\$0.0	\$0.0	\$0.0	\$1.3
Total	\$111.7	\$220.3	\$93.2	\$52.0	\$62.6	\$68.6	\$83.6	\$72.9	\$65.0	\$49.5	\$44.9	\$44.6	\$0.0	\$968.7

Energy

Zonal Energy Costs

Table G-45 provides energy costs by control zone and type for 2015. Table G-46 provides total energy costs by control zone and month for 2014 and 2015. The total energy cost for the External category in 2015 was -\$913.7 million.

Table G-45 Energy costs by control zone and type (Dollars (Millions)): 2015

	Energy Costs by Control Zone (Millions)									
	Day Ahead				Balancing				Inadvertent Charges	Grand Total
	Load Payments	Generation Credits	Explicit	Total	Load Payments	Generation Credits	Explicit	Total		
AECO	\$409.0	\$280.0	\$0.0	\$128.9	\$5.0	(\$16.5)	\$0.0	\$21.5	\$0.0	\$150.5
AEP	\$6,148.5	\$6,720.5	\$0.0	(\$572.0)	(\$97.3)	(\$182.9)	\$0.0	\$85.7	\$0.4	(\$485.9)
AP	\$1,970.1	\$1,839.3	\$0.0	\$130.8	(\$2.6)	(\$45.7)	\$0.0	\$43.2	\$0.2	\$174.1
ATSI	\$2,853.0	\$2,298.5	\$0.0	\$554.5	(\$33.7)	(\$113.4)	\$0.0	\$79.6	\$0.2	\$634.4
BGE	\$1,935.6	\$1,585.8	\$0.0	\$349.8	\$8.9	(\$42.0)	\$0.0	\$50.9	\$0.1	\$400.8
ComEd	\$4,856.8	\$5,629.9	\$0.0	(\$773.1)	(\$62.0)	\$6.1	\$0.0	(\$68.1)	\$0.3	(\$840.9)
DAY	\$734.4	\$629.6	\$0.0	\$104.8	(\$7.0)	(\$9.5)	\$0.0	\$2.5	\$0.1	\$107.3
DEOK	\$1,039.4	\$685.2	\$0.0	\$354.3	(\$27.5)	(\$30.2)	\$0.0	\$2.7	\$0.1	\$357.0
DLCO	\$562.6	\$653.7	\$0.0	(\$91.1)	\$11.9	(\$8.9)	\$0.0	\$20.8	\$0.0	(\$70.3)
Dominion	\$7,114.1	\$6,903.3	\$0.0	\$210.8	(\$78.6)	(\$104.3)	\$0.0	\$25.7	\$0.4	\$236.9
DPL	\$751.2	\$331.0	\$0.0	\$420.2	\$0.8	\$18.4	\$0.0	(\$17.6)	\$0.1	\$402.7
EKPC	\$470.5	\$374.1	\$0.0	\$96.4	(\$4.8)	(\$21.5)	\$0.0	\$16.7	\$0.1	\$113.1
External	\$582.6	\$1,415.0	\$0.0	(\$832.4)	\$94.7	\$176.0	\$0.0	(\$81.3)	\$0.0	(\$913.7)
JCPL	\$920.4	\$580.0	\$0.0	\$340.3	\$5.4	(\$1.9)	\$0.0	\$7.3	\$0.1	\$347.7
Met-Ed	\$671.7	\$906.5	\$0.0	(\$234.8)	\$5.0	(\$18.5)	\$0.0	\$23.6	\$0.1	(\$211.2)
PECO	\$1,718.7	\$2,390.8	\$0.0	(\$672.1)	\$10.3	(\$17.0)	\$0.0	\$27.3	\$0.1	(\$644.7)
PENELEC	\$2,067.4	\$2,800.0	\$0.0	(\$732.6)	(\$39.6)	(\$84.6)	\$0.0	\$45.0	\$0.1	(\$687.6)
Pepco	\$2,352.5	\$1,638.4	\$0.0	\$714.1	(\$9.9)	(\$28.4)	\$0.0	\$18.5	\$0.1	\$732.7
PPL	\$1,870.9	\$2,260.4	\$0.0	(\$389.5)	\$3.0	(\$8.0)	\$0.0	\$11.0	\$0.1	(\$378.4)
PSEG	\$1,747.2	\$1,670.6	\$0.0	\$76.6	(\$14.6)	\$169.4	\$0.0	(\$183.9)	\$0.1	(\$107.2)
RECO	\$61.3	\$3.1	\$0.0	\$58.3	(\$3.4)	(\$0.3)	\$0.0	(\$3.1)	\$0.0	\$55.2
Total	\$40,837.8	\$41,595.7	\$0.0	(\$757.9)	(\$236.0)	(\$363.8)	\$0.0	\$127.8	\$2.7	(\$627.4)

Table G-46 Monthly energy costs by control zone (Dollars (Millions)): 2014 and 2015

Energy Costs by Control Zone (Millions)														
2014														
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Inadvertent Charge	Grand Total
AECO	\$63.3	\$34.2	\$35.9	\$23.6	\$24.2	\$28.5	\$30.2	\$18.9	\$19.4	\$19.1	\$19.8	\$13.6	(\$0.0)	\$330.7
AEP	(\$346.5)	(\$208.4)	(\$295.3)	(\$120.5)	(\$78.4)	(\$114.1)	(\$115.4)	(\$74.1)	(\$56.9)	\$3.6	(\$29.5)	(\$47.3)	(\$0.7)	(\$1,483.7)
AP	\$124.4	\$29.2	\$28.9	\$22.2	\$22.2	\$7.5	\$2.9	(\$6.5)	(\$16.3)	(\$15.9)	\$10.6	\$14.8	(\$0.3)	\$223.6
ATSI	\$120.6	\$114.2	\$102.0	\$55.7	\$60.4	\$57.6	\$37.8	\$47.4	\$29.7	\$45.0	\$32.6	\$43.0	(\$0.4)	\$745.7
BGE	\$148.9	\$64.6	\$74.2	\$22.0	\$25.8	\$45.0	\$48.6	\$39.2	\$28.0	\$24.5	\$34.8	\$35.1	(\$0.2)	\$590.5
ComEd	(\$261.0)	(\$89.1)	(\$149.4)	(\$94.3)	(\$42.3)	(\$61.6)	(\$64.3)	(\$37.0)	(\$60.5)	(\$72.5)	(\$105.4)	(\$89.8)	(\$0.5)	(\$1,127.7)
DAY	\$8.9	(\$0.7)	\$21.1	\$5.6	\$21.1	\$9.6	(\$2.6)	\$9.8	(\$0.6)	\$8.0	\$8.0	\$14.4	(\$0.1)	\$102.4
DEOK	\$85.5	\$27.9	\$43.3	\$40.4	\$55.8	\$43.5	\$16.3	\$18.0	\$22.4	\$5.3	\$13.3	\$30.1	(\$0.1)	\$401.8
DLCO	\$60.2	(\$19.1)	(\$27.8)	(\$13.1)	\$8.9	(\$11.1)	(\$8.9)	(\$8.7)	(\$10.3)	(\$12.8)	(\$18.5)	(\$13.2)	(\$0.1)	(\$74.5)
Dominion	\$92.5	\$24.8	\$83.4	\$43.8	\$32.7	\$26.1	\$35.8	\$18.1	\$40.4	\$39.2	\$19.3	\$26.6	(\$0.5)	\$482.1
DPL	\$151.0	\$76.0	\$68.0	\$31.6	\$31.3	\$35.7	\$35.7	\$30.4	\$24.3	\$26.7	\$32.2	\$32.4	(\$0.1)	\$575.2
EKPC	\$34.5	\$2.7	\$2.8	\$4.8	\$4.2	\$8.3	\$9.2	\$10.9	\$3.2	\$7.3	\$13.3	\$9.3	(\$0.1)	\$110.6
External	(\$353.4)	(\$9.8)	\$54.4	\$32.4	(\$67.2)	(\$29.3)	(\$20.1)	(\$22.3)	\$11.8	(\$0.7)	(\$28.6)	(\$29.3)	\$0.0	(\$462.1)
JCPL	\$161.0	\$79.6	\$72.8	\$21.8	\$18.9	\$32.5	\$43.1	\$26.9	\$28.2	\$25.1	\$19.2	\$24.8	(\$0.1)	\$553.9
Met-Ed	(\$37.2)	(\$27.7)	(\$27.1)	(\$16.2)	(\$16.9)	(\$20.7)	(\$23.7)	(\$22.0)	(\$27.1)	(\$22.2)	(\$6.4)	(\$22.0)	(\$0.1)	(\$269.3)
PECO	(\$164.5)	(\$71.5)	(\$62.3)	(\$68.5)	(\$114.0)	(\$83.1)	(\$63.2)	(\$69.1)	(\$68.2)	(\$75.6)	(\$39.3)	(\$61.7)	(\$0.2)	(\$941.1)
PENELEC	(\$239.5)	(\$156.9)	(\$130.7)	(\$71.0)	(\$91.6)	(\$103.7)	(\$71.8)	(\$77.4)	(\$57.3)	(\$59.8)	(\$70.0)	(\$59.8)	(\$0.1)	(\$1,189.7)
Pepco	\$201.4	\$97.1	\$79.6	\$49.8	\$47.5	\$68.7	\$68.9	\$67.3	\$56.3	\$49.2	\$60.8	\$61.3	(\$0.2)	\$907.7
PPL	(\$90.6)	(\$61.8)	(\$46.2)	(\$39.9)	(\$20.8)	(\$34.0)	(\$35.5)	(\$16.7)	(\$7.3)	(\$17.6)	(\$23.1)	(\$19.3)	(\$0.3)	(\$413.0)
PSEG	(\$48.6)	(\$33.5)	(\$52.1)	\$11.8	\$24.8	\$27.3	\$8.6	(\$9.4)	(\$9.3)	(\$19.1)	(\$2.4)	(\$16.2)	(\$0.2)	(\$118.5)
RECO	\$17.2	\$8.1	\$8.0	\$4.5	\$5.0	\$6.1	\$6.4	\$5.2	\$4.6	\$4.0	\$4.5	\$4.1	(\$0.0)	\$77.7
Total	(\$271.7)	(\$120.2)	(\$116.5)	(\$53.6)	(\$48.4)	(\$61.2)	(\$62.2)	(\$51.0)	(\$45.3)	(\$39.1)	(\$54.7)	(\$49.3)	(\$4.2)	(\$977.7)
Energy Costs by Control Zone (Millions)														
2015														
	Jan	Feb	Mar	Apr	May	Jun	Jul	Aug	Sep	Oct	Nov	Dec	Inadvertent Charge	Grand Total
AECO	\$17.0	\$24.8	\$8.8	\$12.5	\$15.8	\$12.1	\$15.7	\$15.2	\$12.1	\$7.5	\$1.6	\$7.3	\$0.0	\$150.5
AEP	(\$118.7)	(\$214.8)	(\$80.2)	(\$28.2)	\$5.1	(\$13.0)	(\$32.1)	(\$48.6)	(\$30.6)	\$27.1	\$29.2	\$18.4	\$0.4	(\$485.9)
AP	\$30.9	\$61.3	\$31.6	\$22.8	\$28.0	\$12.5	(\$2.0)	(\$0.8)	(\$12.4)	\$2.4	(\$5.7)	\$5.1	\$0.2	\$174.1
ATSI	\$60.9	\$100.4	\$78.2	\$75.2	\$48.1	\$46.2	\$52.7	\$41.1	\$33.8	\$32.5	\$21.8	\$43.4	\$0.2	\$634.4
BGE	\$41.9	\$101.7	\$48.0	\$17.0	\$22.7	\$26.9	\$30.9	\$35.9	\$24.2	\$15.5	\$15.6	\$20.4	\$0.1	\$400.8
ComEd	(\$95.7)	(\$125.1)	(\$64.6)	(\$73.0)	(\$78.0)	(\$64.5)	(\$60.0)	(\$38.5)	(\$42.3)	(\$88.3)	(\$69.8)	(\$41.4)	\$0.3	(\$840.9)
DAY	\$18.2	\$13.3	\$18.8	\$15.2	\$6.1	\$6.7	\$12.3	\$5.6	\$6.4	(\$2.6)	\$8.0	(\$0.7)	\$0.1	\$107.3
DEOK	\$27.6	\$62.5	\$17.9	\$15.6	\$28.9	\$36.4	\$32.1	\$33.0	\$22.5	\$20.3	\$27.6	\$32.6	\$0.1	\$357.0
DLCO	(\$8.8)	(\$14.8)	(\$12.4)	(\$6.5)	\$5.7	(\$5.2)	(\$6.5)	(\$5.6)	(\$1.5)	\$3.2	(\$10.0)	(\$8.0)	\$0.0	(\$70.3)
Dominion	\$47.0	\$69.1	\$47.5	\$50.9	\$10.9	(\$6.1)	\$4.3	(\$5.2)	\$2.2	\$24.3	\$14.3	(\$22.7)	\$0.4	\$236.9
DPL	\$45.6	\$93.9	\$46.4	\$14.4	\$20.8	\$28.6	\$31.4	\$28.2	\$22.4	\$23.6	\$23.6	\$23.7	\$0.1	\$402.7
EKPC	\$16.8	\$12.9	\$15.6	\$7.3	\$6.4	\$10.3	\$0.4	\$9.1	\$9.5	\$8.6	\$9.4	\$6.6	\$0.1	\$113.1
External	(\$76.8)	(\$252.9)	(\$116.8)	(\$80.3)	(\$85.1)	(\$51.8)	(\$62.1)	(\$49.1)	(\$20.1)	(\$28.0)	(\$31.9)	(\$58.7)	\$0.0	(\$913.7)
JCPL	\$40.7	\$85.2	\$38.9	\$17.5	\$20.9	\$25.2	\$35.5	\$31.6	\$20.9	\$9.3	\$11.5	\$10.4	\$0.1	\$347.7
Met-Ed	(\$20.2)	(\$30.8)	(\$16.9)	(\$21.8)	(\$15.0)	(\$19.9)	(\$18.3)	(\$18.6)	(\$14.4)	(\$17.1)	(\$1.9)	(\$16.4)	\$0.1	(\$211.2)
PECO	(\$45.2)	(\$45.2)	(\$69.6)	(\$57.0)	(\$54.2)	(\$51.2)	(\$62.1)	(\$56.7)	(\$44.0)	(\$51.4)	(\$57.0)	(\$51.1)	\$0.1	(\$644.7)
PENELEC	(\$80.0)	(\$149.6)	(\$71.2)	(\$61.9)	(\$67.0)	(\$55.6)	(\$48.0)	(\$45.1)	(\$33.9)	(\$22.6)	(\$31.5)	(\$21.3)	\$0.1	(\$687.6)
Pepco	\$72.0	\$113.2	\$70.4	\$47.8	\$53.8	\$53.1	\$62.1	\$65.0	\$54.9	\$44.9	\$44.3	\$51.1	\$0.1	\$732.7
PPL	(\$38.7)	(\$34.0)	(\$42.9)	(\$2.7)	(\$15.5)	(\$39.5)	(\$45.4)	(\$51.9)	(\$45.4)	(\$21.4)	(\$26.6)	(\$14.5)	\$0.1	(\$378.4)
PSEG	(\$10.9)	(\$24.1)	(\$10.5)	(\$3.9)	(\$8.1)	(\$1.0)	\$1.3	\$4.2	(\$9.8)	(\$24.0)	(\$4.8)	(\$15.8)	\$0.1	(\$107.2)
RECO	\$4.9	\$8.7	\$4.4	\$3.1	\$5.0	\$4.6	\$5.8	\$5.1	\$4.5	\$3.3	\$2.9	\$2.8	\$0.0	\$55.2
Total	(\$71.3)	(\$144.3)	(\$58.6)	(\$35.9)	(\$44.9)	(\$45.1)	(\$52.1)	(\$45.9)	(\$41.1)	(\$32.8)	(\$29.2)	(\$28.9)	\$2.7	(\$627.4)

Appendix H FTR Volumes

This Appendix presents the data used to create Figure 13-8 in the 2015 State of the Market Report for PJM. Each table shows the FTR bid volume, cleared volume and net bid volume by planning period. The bid volume includes the buy, sell and self-scheduled offers. The cleared volume includes the cleared buy, cleared sell and self-scheduled offers. The net bid volume includes all bid and self-scheduled offers, excluding sell offers. The Annual Auction volume is included in June of each planning period.

Table H-1 Annual and Monthly FTR Auction bid and cleared volume: Planning period 2003 to 2004

Auction Date	Net Bid Volume (MW)	Cleared Volume (MW)	Bid Volume (MW)
Jun-03	2,679,072	89,840	2,690,737
Jul-03	295,753	8,642	300,808
Aug-03	215,206	9,978	220,241
Sep-03	226,994	9,068	234,315
Oct-03	127,739	10,522	135,885
Nov-03	114,211	8,247	122,362
Dec-03	131,180	8,352	139,221
Jan-04	128,086	10,947	136,657
Feb-04	128,303	12,187	137,790
Mar-04	144,617	13,827	156,543
Apr-04	141,437	17,358	157,776
May-04	168,480	44,641	178,973
Total	4,501,077	243,608	4,611,308

Table H-2 Annual and Monthly FTR Auction bid and cleared volume: Planning period 2004 to 2005

Auction Date	Net Bid Volume (MW)	Cleared Volume (MW)	Bid Volume (MW)
Jun-04	939,214	125,044	1,019,868
Jul-04	160,472	21,761	190,198
Aug-04	144,402	22,650	176,642
Sep-04	155,837	13,999	194,229
Oct-04	180,542	49,816	226,156
Nov-04	213,036	23,912	247,780
Dec-04	226,271	18,384	260,964
Jan-05	212,061	22,549	236,135
Feb-05	276,385	20,700	305,613
Mar-05	306,472	25,712	348,416
Apr-05	307,297	36,914	330,088
May-05	280,690	32,545	300,966
Total	3,402,681	413,987	3,837,056

Table H-3 Annual and Monthly FTR Auction bid and cleared volume: Planning period 2005 to 2006

Auction Date	Net Bid Volume (MW)	Cleared Volume (MW)	Bid Volume (MW)
Jun-05	1,011,821	159,049	1,120,404
Jul-05	300,153	23,929	340,891
Aug-05	233,493	17,966	276,936
Sep-05	222,404	22,133	266,577
Oct-05	147,493	18,906	189,458
Nov-05	183,750	20,525	227,432
Dec-05	200,886	19,422	244,608
Jan-06	234,473	21,431	275,081
Feb-06	250,308	26,463	293,774
Mar-06	272,662	31,968	317,705
Apr-06	431,398	36,603	472,732
May-06	384,767	38,977	424,962
Total	3,873,608	437,372	4,450,561

Table H-4 Annual and Monthly FTR Auction bid and cleared volume: Planning period 2006 to 2007

Auction Date	Net Bid Volume (MW)	Cleared Volume (MW)	Bid Volume (MW)
Jun-06	2,274,846	198,380	2,533,660
Jul-06	719,494	31,662	934,424
Aug-06	738,375	26,392	932,469
Sep-06	630,072	37,351	841,698
Oct-06	710,045	51,193	888,011
Nov-06	765,177	40,110	890,318
Dec-06	757,683	42,848	919,549
Jan-07	778,266	59,813	905,249
Feb-07	884,953	68,179	969,447
Mar-07	661,938	69,754	799,130
Apr-07	455,411	30,963	551,601
May-07	432,783	37,207	480,219
Total	9,809,046	693,852	11,645,776

Table H-5 Annual and Monthly FTR Auction bid and cleared volume: Planning period 2007 to 2008

Auction Date	Net Bid Volume (MW)	Cleared Volume (MW)	Bid Volume (MW)
Jun-07	2,961,754	323,632	3,462,015
Jul-07	794,490	51,248	1,068,961
Aug-07	944,015	63,392	1,224,668
Sep-07	901,284	66,611	1,200,730
Oct-07	973,936	112,427	1,245,797
Nov-07	841,326	61,592	1,059,631
Dec-07	1,276,687	49,825	1,461,068
Jan-08	501,642	27,377	655,581
Feb-08	583,749	37,288	676,847
Mar-08	437,241	31,941	590,524
Apr-08	326,050	34,805	427,105
May-08	280,005	22,837	331,327
Total	10,822,178	882,975	13,404,256

Table H-6 Annual and Monthly FTR Auction bid and cleared volume: Planning period 2008 to 2009

Auction Date	Net Bid Volume (MW)	Cleared Volume (MW)	Bid Volume (MW)
Jun-08	3,511,130	339,654	3,832,169
Jul-08	968,615	53,843	1,211,784
Aug-08	961,694	40,027	1,224,054
Sep-08	925,250	64,901	1,127,274
Oct-08	802,966	52,768	965,756
Nov-08	607,441	45,707	738,336
Dec-08	550,352	37,633	748,485
Jan-09	488,102	43,739	673,525
Feb-09	492,216	40,439	639,274
Mar-09	391,938	42,722	581,075
Apr-09	299,908	35,685	440,629
May-09	222,092	21,016	295,198
Total	10,221,706	818,134	12,477,560

Table H-7 Annual and Monthly FTR Auction bid and cleared volume: Planning period 2009 to 2010

Auction Date	Net Bid Volume (MW)	Cleared Volume (MW)	Bid Volume (MW)
Jun-09	2,652,340	307,584	3,156,826
Jul-09	488,748	41,389	849,742
Aug-09	414,151	55,261	708,452
Sep-09	427,221	56,998	718,246
Oct-09	538,476	64,328	797,069
Nov-09	559,750	65,577	745,333
Dec-09	447,221	68,470	672,986
Jan-10	529,887	64,435	728,765
Feb-10	490,391	62,153	670,272
Mar-10	389,934	73,069	615,690
Apr-10	345,301	66,017	489,638
May-10	291,537	52,036	375,812
Total	7,574,956	977,318	10,528,830

Table H-8 Annual and Monthly FTR Auction bid and cleared volume: Planning period 2010 to 2011

Auction Date	Net Bid Volume (MW)	Cleared Volume (MW)	Bid Volume (MW)
Jun-10	3,177,131	428,603	3,894,566
Jul-10	720,172	102,883	1,145,991
Aug-10	859,260	93,226	1,202,137
Sep-10	1,079,947	144,423	1,510,812
Oct-10	1,041,425	120,281	1,427,494
Nov-10	922,444	111,442	1,261,969
Dec-10	1,005,436	157,609	1,359,582
Jan-11	902,052	132,866	1,207,101
Feb-11	931,164	160,750	1,184,383
Mar-11	952,963	182,340	1,250,283
Apr-11	660,480	138,230	913,583
May-11	620,691	169,610	762,538
Total	12,873,166	1,942,261	17,120,443

Table H-9 Annual and Monthly FTR Auction bid and cleared volume: Planning period 2011 to 2012

Auction Date	Net Bid Volume (MW)	Cleared Volume (MW)	Bid Volume (MW)
Jun-11	6,233,773	847,183	7,437,352
Jul-11	1,602,795	241,288	2,233,307
Aug-11	1,385,040	204,442	1,981,888
Sep-11	969,184	112,746	1,581,241
Oct-11	1,424,062	134,653	1,908,956
Nov-11	1,098,133	117,705	1,562,764
Dec-11	811,035	93,492	1,318,347
Jan-12	772,843	88,683	1,240,355
Feb-12	816,356	93,977	1,234,341
Mar-12	665,949	99,659	1,126,207
Apr-12	449,078	131,218	795,785
May-12	295,103	94,642	470,495
Total	16,523,352	2,259,688	22,891,036

Table H-10 Annual and Monthly FTR Auction bid and cleared volume: Planning period 2012 to 2013

Auction Date	Net Bid Volume (MW)	Cleared Volume (MW)	Bid Volume (MW)
Jun-12	6,407,647	710,169	7,598,008
Jul-12	2,177,990	182,695	2,735,269
Aug-12	909,111	151,693	1,418,249
Sep-12	1,877,747	146,352	2,446,553
Oct-12	788,486	118,052	1,310,859
Nov-12	1,765,875	98,494	2,142,231
Dec-12	1,757,292	115,322	2,230,391
Jan-13	696,121	121,357	1,067,354
Feb-13	805,330	118,298	1,129,794
Mar-13	854,219	132,779	1,196,032
Apr-13	525,505	97,353	790,360
May-13	477,217	87,001	595,463
Total	15,684,148	1,522,778	19,881,561

Table H-11 Annual and Monthly FTR Auction bid and cleared volume: Planning period 2013 to 2014

Auction Date	Net Bid Volume (MW)	Cleared Volume (MW)	Bid Volume (MW)
Jun-13	6,607,570	791,995	7,909,805
Jul-13	2,000,987	189,328	2,571,100
Aug-13	2,193,738	239,816	2,726,508
Sep-13	2,046,401	260,404	2,604,664
Oct-13	1,692,645	222,661	2,233,085
Nov-13	1,823,502	237,130	2,307,163
Dec-13	1,795,279	216,021	2,298,733
Jan-14	1,713,078	185,284	2,092,055
Feb-14	1,588,809	157,166	1,979,691
Mar-14	1,560,077	169,500	1,918,025
Apr-14	1,247,111	127,436	1,559,987
May-14	757,354	80,601	934,844
Total	25,026,550	2,877,341	31,135,659

Table H-12 Annual and Monthly FTR Auction bid and cleared volume: Planning period 2014 to 2015

Auction Date	Net Bid Volume (MW)	Cleared Volume (MW)	Bid Volume (MW)
Jun-14	8,631,333	744,482	9,600,316
Jul-14	2,365,262	123,067	2,689,241
Aug-14	2,191,719	154,391	2,513,616
Sep-14	2,232,435	167,077	2,636,101
Oct-14	1,935,928	153,735	2,289,409
Nov-14	2,006,939	175,554	2,339,892
Dec-14	1,831,645	116,545	2,138,480
Jan-15	1,586,530	81,368	1,849,891
Feb-15	1,446,978	110,669	1,701,821
Mar-15	1,395,961	97,219	1,684,143
Apr-15	1,194,256	78,599	1,429,386
May-15	699,951	42,698	817,152
Total	27,518,938	2,045,403	31,689,447

Table H-13 Annual and Monthly FTR Auction bid and cleared volume: Planning period 2015 to 2016 through December 2015

Auction Date	Net Bid Volume (MW)	Cleared Volume (MW)	Bid Volume (MW)
Jun-15	6,726,193	634,988	7,956,486
Jul-15	1,713,451	90,329	2,341,646
Aug-15	1,593,674	78,196	2,046,131
Sep-15	2,160,014	160,357	2,628,872
Oct-15	1,196,435	71,600	1,704,518
Nov-15	2,060,194	92,310	2,482,819
Dec-15	1,834,874	93,273	2,239,329
Total	17,284,836	1,221,052	21,399,801

Figure H-1 summarizes the total revenue associated with all FTRs, regardless of source, to FTR sinks that produced the largest positive and negative revenue from the 2016 to 2019 Long Term FTR Auction. The top 10 positive revenue producing FTR sinks accounted for \$68.4 million (38.4 percent of the total positive revenue from sinks) and 5.8 percent of all FTRs purchased in the auction. The top 10 negative revenue producing FTR sinks accounted for -\$42.3 million (49.0 percent of total negative revenue from sinks) and constituted 3.3 percent of all FTRs bought in the auction.

Figure H-1 Ten largest positive and negative revenue producing FTR sinks purchased in the Long Term FTR Auction: Planning periods 2016 to 2019

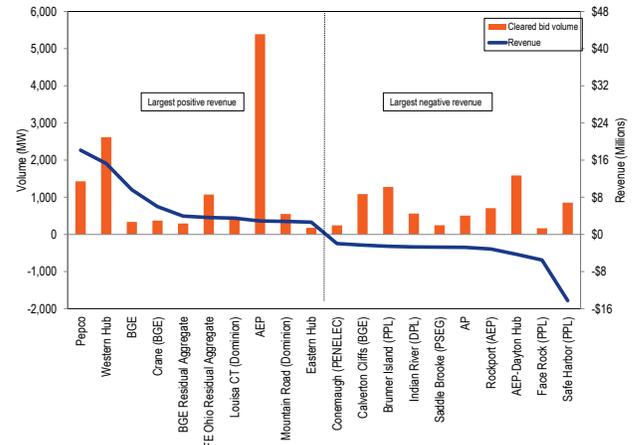


Figure H-2 summarizes the total revenue associated with all FTRs, regardless of sink, to FTR sources that produced the largest positive and negative revenue from the 2016 to 2019 Long Term FTR Auction. The top 10 positive revenue producing FTR sources accounted for \$73.8 million (41.1 percent of the total positive revenue from sources) and 6.5 percent of all FTRs bought in the auction. The top 10 negative revenue producing FTR sources accounted for -\$47.4 million (30.0 percent of total negative revenue from sources) and constituted 2.9 percent of all FTRs bought in the auction.

Figure H-2 Ten largest positive and negative revenue producing FTR sources purchased in the Long Term FTR Auction: Planning periods 2016 to 2019

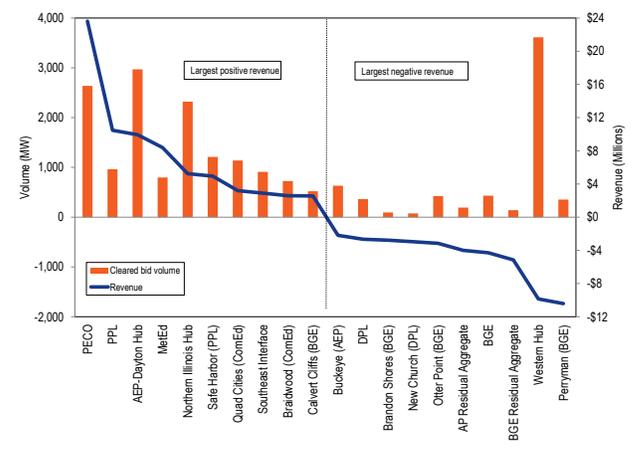


Figure H-3 summarizes the total revenue associated with all FTR sink points, regardless of source, that produced the largest positive and negative revenue in the Annual FTR Auction for the 2015 to 2016 planning period. The top 10 positive revenue sinks accounted for \$560.1 million (59.7 percent of total positive revenue from sinks) and 14.8 percent of all FTRs purchased. The top 10 negative revenue sinks accounted for -\$23.2 million (28.8 percent of total negative revenue from sinks) and 2.5 percent of all FTRs purchased.

Figure H-3 Ten largest positive and negative revenue producing FTR sinks purchased in the Annual FTR Auction: Planning period 2015 to 2016

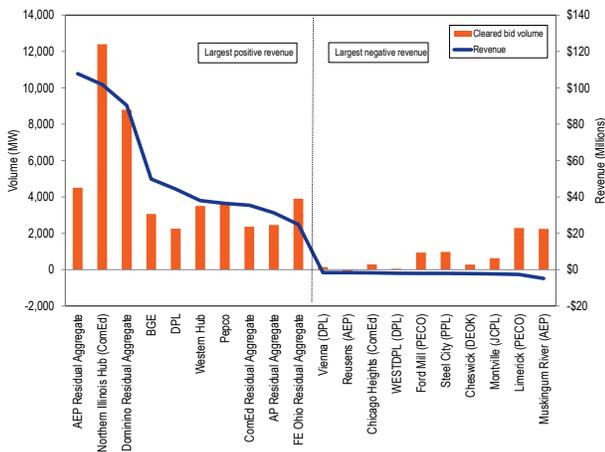


Figure H-4 summarizes total revenue associated with all FTR source points, regardless of sink, that produced the largest positive and negative revenue in the Annual FTR Auction for the 2015 to 2016 planning period. The top 10 positive revenue sources accounted for \$425.1 million (41.3 percent of total positive revenue from sources) and 13.3 percent of all FTRs purchased. The top 10 negative revenue sources accounted for -\$31.1 million (34.1 percent of total negative revenue from sources) and 1.4 percent of all FTRs purchased.

Figure H-4 Ten largest positive and negative revenue producing FTR sources purchased in the Annual FTR Auction: Planning period 2015 to 2016

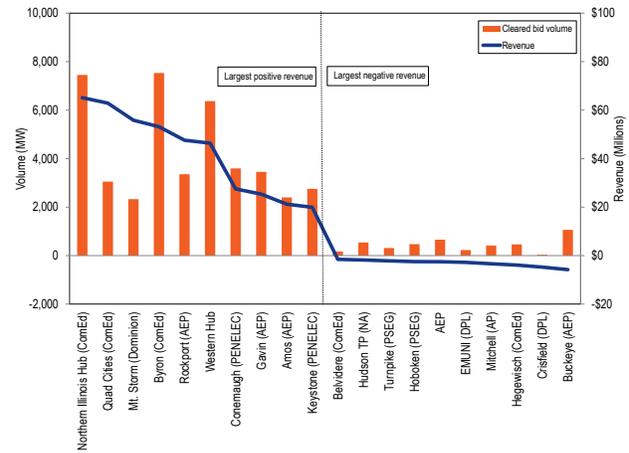


Figure H-5 summarizes total revenue associated with all FTRs, regardless of source, to the FTR sinks that produced the largest positive and negative revenue in the Monthly Balance of Planning Period FTR Auctions during the 2015 to 2016 planning period. The top 10 positive revenue sinks accounted for \$108.6 million (56.1 percent of total positive revenue from sinks) and 8.9 percent of all FTRs purchased. The top 10 negative revenue sinks accounted for -\$47.4 million (28.2 percent of total negative revenue from sinks) and 0.8 percent of all FTRs purchased.

Figure H-5 Ten largest positive and negative revenue producing FTR sinks purchased in the Monthly Balance of Planning Period FTR Auctions: planning period 2015 to 2016 through December 31, 2015

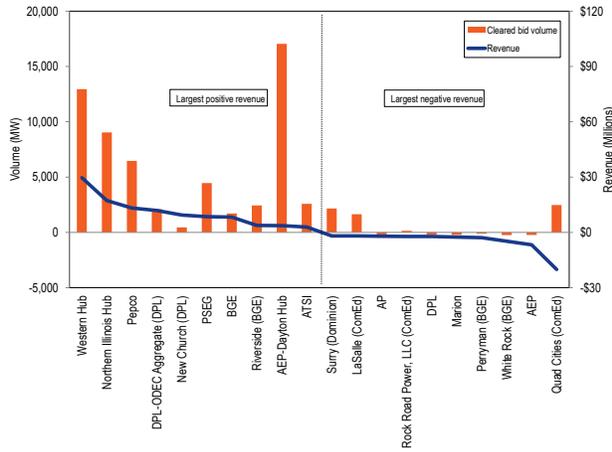


Figure H-6 Ten largest positive and negative revenue producing FTR sources purchased in the Monthly Balance of Planning Period FTR Auctions: planning period 2015 to 2016 through December 31, 2015

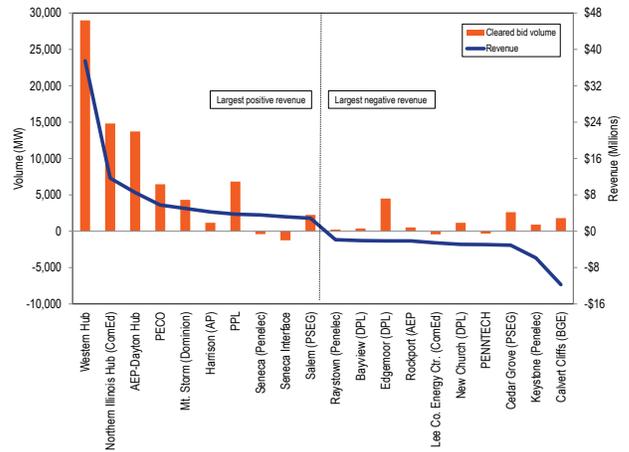


Figure H-6 summarizes the total revenue associated with all FTR source points, regardless of sink, that produced the largest positive and negative revenue in the Monthly Balance of Planning Period FTR Auctions during the 2015 to 2016 planning period. The top 10 positive revenue sources accounted for \$86.1 million (49.0 percent of total positive revenue from sources) and 5.3 percent of all FTRs purchased. The top 10 negative revenue sources accounted for -\$37.3 million (23.8 percent of total negative revenue from sources) and 0.8 percent of all FTRs purchased.

Glossary

Aggregate

Combination of buses or bus prices.

Ancillary Services

Those services that are necessary to support the transmission of capacity and energy from resources to loads while maintaining reliable operation of the Transmission Provider's Transmission System in accordance with Good Utility Practice.

Area Control Error (ACE)

Area Control Error of the PJM RTO is the actual net interchange minus the biased scheduling net interchange, including time error. It is the sum of tie-in errors and frequency errors.

Associated unit (AU)

A unit that is located at the same site as a frequently mitigated unit (FMU) and which has identical electrical and economic impacts on the transmission system as an FMU but which does not qualify for FMU status.

Auction Revenue Right (ARR)

A financial instrument entitling its holder to auction revenue from Financial Transmission Rights (FTRs) based on locational marginal price (LMP) differences across a specific path in the Annual FTR Auction.

Automatic Generation Control (AGC)

An automatic control system comprised of hardware and software. Hardware is installed on generators allowing their output to be automatically adjusted and monitored by an external signal and software is installed facilitating that output adjustment.

Average hourly LMP

An LMP calculated by averaging hourly LMP with equal hourly weights; also referred to as a simple average hourly LMP.

Avoidable cost rate (ACR)

The costs that a generation owner would not incur if the generating unit did not operate for one year, in particular the delivery year. The ACR calculation is based on the categories of cost that are specified in Section 6.8 of Attachment DD of the PJM Tariff.

Avoidable Project

Investment Recovery Rate (APIR) A component of the avoidable cost rate (ACR) calculation. Project investment is the capital reasonably required to enable a capacity resource to continue operating or improve availability during peak-hour periods during the delivery year.

Balancing energy market

Energy that is generated and financially settled during real time.

Base Residual Auction (BRA)

Reliability Pricing Model (RPM) auction held in May three years prior to the start of the delivery year. Allows for the procurement of resource commitments to satisfy the region's unforced capacity obligation and allocates the cost of those commitments among the LSEs through the Locational Reliability Charge.

Behind the Meter

Behind The Meter Generation refers to a generation unit that delivers energy to load without using the Transmission System or any distribution facilities (unless the entity that owns or leases the distribution facilities has consented to such use of the distribution facilities and such consent has been demonstrated to the satisfaction of the Office of the Interconnection); provided, however, that Behind The Meter Generation does not include (i) at any time, any portion of such generating unit's capacity that is designated as a Generation Capacity Resource; or (ii) in an hour, any portion of the output of such generating unit[s] that is sold to another entity for consumption at another electrical location or into the PJM Interchange Energy Market. (OATT 1.3B)

Bilateral agreement

An agreement between two parties for the sale and delivery of a service.

Black Start Unit

A generating unit with the ability to go from a shutdown condition to an operating condition and start delivering power without any outside assistance from the transmission system or interconnection.

Bottled generation

Economic generation that cannot be dispatched because of local operating constraints.

Burner tip fuel price

The cost of fuel delivered to the generator site equaling the fuel commodity price plus all transportation costs.

Bus

An interconnection point.

Capacity deficiency rate (CDR)

The CDR was designed to reflect the annual fixed costs of a new combustion turbine (CT) in PJM and the annual fixed costs of the associated transmission investment, including a return on investment, depreciation and fixed operation and maintenance expense, net of associated energy revenues. The CDR is used in applying penalties for capacity deficiencies. To express the CDR in terms of unforced capacity, it must be further divided by the quantity 1 minus the EFORD.

Capacity Emergency Transfer Limit (CETL)

The capability of the transmission system to support deliveries of electric energy to a given area experiencing a localized capacity emergency as determined in accordance with the PJM Manuals.

Capacity queue

A collection of Regional Transmission Expansion Planning (RTEP) capacity resource project requests received during a particular timeframe and designating an expected in-service date.

Combined Cycle (CC)

An electric generating technology in which electricity and process steam are produced from otherwise lost waste heat exiting from one or more combustion turbines. The exiting heat is routed to a conventional boiler or to a heat recovery steam generator for use by a conventional steam turbine in the production of electricity. This process increases the efficiency of the electric generating facility.

Combustion Turbine (CT)

A generating unit in which a combustion turbine engine is the prime mover for an electrical generator.

Congestion Management Process (CMP)

A process used between neighboring balancing authorities to coordinate the re-dispatch of resources to relieve transmission constraints.

Control Zone

An area within the PJM Control Area, as set forth in the PJM Open Access Transmission Tariff and the RAA. Schedule 16 of the RAA defines the distinct zones that comprise the PJM Control Area.

Decrement Bids (DEC)

An hourly bid, expressed in MWh, to purchase energy in the PJM Day-Ahead Energy Market if the Day-Ahead LMP is less than or equal to the specified bid price. This bid must specify hourly quantity, bid price and location (transmission zone, hub, aggregate or single bus).

Demand deviations

Hourly deviations in the demand category, equal to the difference between the sum of cleared decrement bids, day-ahead load, day-ahead sales, and day-ahead-exports, to the sum of real-time load, real-time sales, and real-time exports.

Demand Resource

A capacity resource with a demonstrated capability to provide a reduction in demand or otherwise control load. A Demand Resource may be an existing or planned resource.

Dispatch Rate

The control signal, expressed in dollars per MWh, calculated and transmitted continuously and dynamically to direct the output level of all generation resources dispatched by PJM in accordance with the Offer Data.

Disturbance Control Standard

A NERC-defined metric measuring the ability of a control area to return area control error (ACE) either to zero or to its predisturbance level after a disturbance such as a generator or transmission loss.

Eastern Prevailing Time (EPT)

Eastern Prevailing Time (EPT) is equivalent to Eastern Standard Time (EST) or Eastern Daylight Time (EDT) as is in effect from time to time.

Eastern Region

Defined region for purposes of allocating balancing operating reserve charges. Includes the BGE, Dominion, PENELEC, Pepco, Met-Ed, PPL, JCPL, PECO, DPL, PSEG, and RECO transmission zones.

Economic generation

Units producing energy at an offer price less than or equal to LMP.

Effective MW

The MW of regulation provided by a regulating resource multiplied by that resource's marginal benefit factor and performance score.

End-use customer

Any customer purchasing electricity at retail.

Equivalent availability factor (EAF)

The proportion of hours in a year that a unit is available to generate at full capacity.

Equivalent demand forced outage rate (EFORD)

A measure of the probability that a generating unit will not be available due to forced outages or forced deratings when there is a demand on the unit to generate.

Equivalent forced outage factor (EFOF)

The proportion of hours in a year that a unit is unavailable because of forced outages.

Equivalent maintenance outage factor (EMOF)

The proportion of hours in a year that a unit is unavailable because of maintenance outages.

Equivalent planned outage factor (EPOF)

The proportion of hours in a year that a unit is unavailable because of planned outages.

External resource

A generation resource located outside metered boundaries of the PJM RTO.

Financial Transmission Right (FTR)

A financial instrument entitling the holder to receive revenues based on transmission congestion measured as hourly energy LMP differences in the PJM Day-Ahead Energy Market across a specific path.

Firm Point-to-Point Transmission Service

Transmission Service that is reserved and/or scheduled between specified Points of Receipt and Delivery.

Firm Transmission Service

Transmission service that is intended to be available at all times to the maximum extent practicable, subject to an emergency, and unanticipated failure of a facility, or other event beyond the control of the owner or operator of the facility, or the Office of the Interconnection.

Fixed Demand Bid

Bid to purchase a defined MW level of energy, regardless of LMP.

Fixed Resource Requirement (FRR)

An alternative method for a party to satisfy its obligation to provide Unforced Capacity. Allows an LSE to avoid direct participation in the RPM Auctions by meeting their fixed capacity resource requirement using internally owned capacity resources.

Flowgate

A transmission facility or group of facilities that consist of the total interface between control areas, a partial interface, or an interface within a control area.

Frequently mitigated unit (FMU)

A unit that was offer-capped for more than a defined proportion of its real-time run hours in the most recent 12-month period. FMU thresholds are 60 percent, 70 percent and 80 percent of run hours. Such units are permitted a defined adder to their cost-based offers in place of the usual 10 percent adder.

Generation Control Area (GCA) and Load Control Area (LCA)

Designations used on a NERC Tag to describe the balancing authority where the energy is generated (GCA) and the balancing authority where the load is served (LCA). Note: the terms "Control Area" in these acronyms are legacy terms for balancing authority, and are expected to be changed in the future.

Generator deviations

Hourly deviations in the generator category, equal to the difference between a unit's cleared day-ahead generation, and a unit's hourly, integrated real-time generation.

Generation Offers

Schedules of MW offered and the corresponding offer price.

Generation owner

A PJM member that owns or leases, with rights equivalent to ownership, facilities for generation of electric energy that are located within PJM.

Gross export volume (energy)

The sum of all export transaction volume (MWh).

Gross import volume (energy)

The sum of all import transaction volume (MWh).

Gigawatt (GW)

A unit of power equal to 1,000 megawatts.

Gigawatt-day

One GW of energy flow or capacity for one day.

Gigawatt-hour (GWh)

One GWh is a gigawatt produced or consumed for one hour.

Herfindahl-Hirschman Index (HHI)

HHI is calculated as the sum of the squares of the market share percentages of all firms in a market.

Hertz (Hz)

Electricity system frequency is measured in hertz.

Hot/Cold Weather Alerts

A Hot Weather Alert is issued to prepare personnel and facilities for extreme hot and/or humid weather conditions that may cause unit unavailability to be higher than forecast for an extended period. It can be issued on a control zone basis and PJM communicates to members whether fuel limited resources are to be placed into Maximum Emergency category.

A Cold Weather Alert is issued to prepare personnel and facilities for extreme cold weather conditions. It can be initiated when actual temperatures in a zone fall near or below ten degrees Fahrenheit or at higher temperatures if PJM projects a portion of gas fired capacity is unable to obtain spot market gas during load pick-up periods.

HRSG

Heat recovery steam generator. An air-to-steam heat exchanger.

Increment offers (INC)

Financial offers in the Day-Ahead Energy Market to supply specified amounts of MW at, or above, a given price.

Incremental Auction

Reliability Pricing Model (RPM) auction to allow for an incremental procurement of resource commitments to satisfy an increase in the region's unforced capacity obligation due to a load forecast increase or a decrease in the amount of resource commitments due to a resource cancellation, delay, derating, EFORd increase, or decrease in the nominated value of a Planned Demand Resource.

Inframarginal unit

A unit that is operating, with an accepted offer that is less than the clearing price.

Installed capacity

Installed capacity is the as-tested maximum net dependable capability of the generator, measured in MW.

Load

Demand for electricity at a given time.

Load Management

Previously known as ALM (Active Load Management). ALM was a term that PJM used prior to the implementation of RPM where end use customer load could be reduced at the request of PJM. The ability to reduce metered load, either manually by the customer, after a request from the resource provider which holds the Load management rights or its agent (for Contractually Interruptible), or automatically in response to a communication signal from the resource provider which holds the Load management rights or its agent (for Direct Load Control).

Load-serving entity (LSE)

Load-serving entities provide electricity to retail customers. Load-serving entities include traditional distribution utilities and new entrants into the competitive power market.

Locational Deliverability Area (LDA)

Sub-regions used to evaluate locational constraints. LDAs include EDC zones, sub-zones, and combination of zones.

Marginal Benefit Factor

For RegD resources, this is the marginal rate of substitution between RegA and RegD resources.

Marginal unit

The last, highest cost, generation unit to supply power under a merit order dispatch system.

Market-clearing price

The price that is paid by all load and paid to all suppliers.

Market participant

A PJM market participant can be a market supplier, a market buyer or both. Market buyers and market sellers are members that have met creditworthiness standards as established by the PJM Office of the Interconnection.

Market user interface

A thin client application allowing generation sellers to provide and to view generation data, including bids, unit status and market results.

Maximum daily starts

The maximum number of times a unit can start in a day. An operating parameter incorporated in a unit's schedule.

Maximum weekly starts

The maximum number of times a unit can start in a week. An operating parameter incorporated in a unit's schedule.

Mean

The arithmetic average.

Median

The midpoint of data values. Half the values are above and half below the median.

Megawatt (MW)

A unit of power equal to 1,000 kilowatts.

Megawatt-day

One MW of energy flow or capacity for one day.

Megawatt-hour (MWh)

One MWh is a megawatt produced or consumed for one hour.

Megawatt-year

One MW of energy flow or capacity for one calendar year.

Minimum down time

The minimum amount of time that a unit has to stay off before starting again. An operating parameter incorporated in a unit's schedule.

Minimum Offer Price Rule (MOPR)

The MOPR rule sets a floor offer price in the RPM Capacity Market, based on the average net cost of new entry (CONE) for certain classes of new or uprated generation capacity resources as defined in the OATT Attachment DD 5.13(h).

Minimum run time

The minimum amount of time that a unit has to stay on before shutting down. An operating parameter incorporated in a unit's schedule.

Monthly CCM

The capacity credits cleared each month through the PJM Monthly Capacity Credit Market (CCM).

Multimonthly CCM

The capacity credits cleared through PJM Multimonthly Capacity Credit Market (CCM).

Net excess (capacity)

The net of gross excess and gross deficiency, therefore the total PJM capacity resources in excess of the sum of load-serving entities' obligations.

Net exchange (capacity)

Capacity imports less exports.

Net interchange (energy)

Gross import volume less gross export volume in MWh.

Network Transmission Service

Transmission service that is for the sole purpose of serving network load. Network transmission service is only available to network customers.

Noneconomic generation

Units producing energy at an offer price greater than the LMP.

Non-Firm Transmission Service

Point-to-point transmission service under the PJM tariff that is reserved and scheduled on an as available basis and is subject to curtailment or interruption. Non-firm point to point transmission service is available on a stand-alone basis for periods ranging from one hour to one month.

Non-Synchronized Reserve

Reserve MW available within ten minutes, but not synchronized to the grid.

North American Electric Reliability Council (NERC)

A voluntary organization of U.S. and Canadian utilities and power pools established to assure coordinated operation of the interconnected transmission systems.

Off peak

For the PJM Energy Market, off-peak periods are all NERC holidays (i.e., New Year's Day, Memorial Day, Independence Day, Labor Day, Thanksgiving Day, Christmas Day) and weekend hours plus weekdays from the hour ending at midnight until the hour ending at 0700.

On peak

For the PJM Energy Market, on-peak periods are weekdays, except NERC holidays (i.e., New Year's Day, Memorial Day, Independence Day, Labor Day, Thanksgiving Day, Christmas Day) from the hour ending at 0800 until the hour ending at 2300.

Opportunity cost

In general, the value of the opportunity foregone when a specific action is taken. In the ancillary services markets, the difference in compensation from the Energy Market between what a unit receives when providing regulation or synchronized reserve and what it would have received had it provided energy instead.

Parameter-limited schedule

A schedule for a unit that has parameters that are used when the unit fails the three pivotal supplier test, or in a maximum generation emergency event. These parameters are pre-determined by the MMU based on unit class, unless an exception is otherwise granted.

Performance Score

This is a measure of the quality of response of a regulating resource to its assigned regulation signal (RegA or RegD).

PJM member

Any entity that has completed an application and satisfies the requirements of the PJM Board of Managers to conduct business with PJM, including transmission owners, generating entities, load-serving entities and marketers.

PJM planning year

The calendar period from June 1 through May 31.

Point of Receipt (POR) and Point of Delivery (POD)

Designations used on a transmission reservation. The designations, when combined, determine the transmission reservations' market path.

Pool-scheduled resource

A generating resource that the seller has turned over to PJM for scheduling and control.

Price duration curve

A graphic representation of the percent of hours that a system's price was at or below a given level during the year.

Price-sensitive bid

Purchases of a defined MW level of energy only up to a specified LMP. Above that LMP, the load bid is zero.

Primary operating interfaces

Primary operating interfaces are typically defined by a cross section of transmission paths or single facilities which affect a wide geographic area. These interfaces are modeled as constraints whose operating limits are respected in performing dispatch operations.

Ramp-limited desired (MW)

The achievable MW based on the UDS requested ramp rate.

Reactive Service

Reactive Service, Reactive Supply and Voltage Control from Generation or Other Sources Service, is provided by generation and other sources (such as static VAR compensators and capacitor banks) of reactive power (measured in VAR). Reactive power helps maintain appropriate voltages on the transmission system and is essential to the flow of real power (measured in MW).

RegA

PJM's slow-oscillation regulation signal designed for resources with the ability to sustain energy output for long periods of time, but with limited ramp rates. PJM can satisfy the RTO-wide regulation requirement with only RegA resources.

RegD

PJM's fast-oscillation regulation signal designed for resources with the ability to quickly adjust energy output, but with limited ability to sustain energy output for long periods of time. PJM cannot satisfy the RTO-wide regulation requirement with only RegD resources.

Regional Transmission Expansion Planning (RTEP)

The process by which PJM recommends specific transmission facility enhancements and expansions based on reliability and economic criteria. Regulation is an ancillary service that corrects short-term imbalances between generation and load and is provided by resources capable of responding to a PJM-generated signal.

ReliabilityFirst Corporation

ReliabilityFirst Corporation (RFC) began operation January 1, 2006, as the successor to three other reliability organizations: the Mid-Atlantic Area Council (MAAC), the East Central Area Coordination Agreement (ECAR), and the Mid-American Interconnected Network (MAIN). PJM is registered with RFC to comply with its reliability standards for balancing authority (BA), planning coordinator (PC), reliability coordinator (RC), resource planner (RP), transmission operator (TOP), transmission planner (TP) and transmission service provider (TSP).

Reliability Pricing Model (RPM)

PJM's resource adequacy construct. The purpose of RPM is to develop a long term pricing signal for capacity resources and LSE obligations that is consistent with the PJM Regional Transmission Expansion Planning Process (RTEPP). RPM adds stability and a locational nature to the pricing signal for capacity.

Reserve

Energy available within a defined time for the purpose of correcting an imbalance between supply and demand.

Selective catalytic reduction (SCR)

NO_x reduction equipment usually installed on combined-cycle generators.

Self-scheduled generation

Units scheduled to run by their owners regardless of system dispatch signal. Self-scheduled units do not follow system dispatch signal and are not eligible to set LMP. Units can be submitted as a fixed block of MW that must be run, or as a minimum amount of MW that must run plus a dispatchable component above the minimum.

Shadow price

The constraint shadow price represents the incremental reduction in congestion cost achieved by relieving a constraint by 1 MW. The shadow price multiplied by the flow (in MW) on the constrained facility during each hour equals the hourly gross congestion cost for the constraint.

Short-Term Resource Procurement Target

The Short-Term Resource Procurement Target is equal to 2.5% of the PJM Region Reliability Requirement determined for such Base Residual Auction, 2% of the PJM Region Reliability Requirement as calculated at the time of the Base Residual Auction for purposes of the First Incremental Auction, and 1.5% of the PJM Region Reliability Requirement as calculated at the time of the Base Residual Auction for purposes of the Second Incremental Auction. The stated rationale for this administrative reduction in demand is to permit short lead time resource procurement in later auctions for the delivery year.

Sources and sinks

Sources are the origins or the injection end of a transmission transaction. Sinks are the destinations or the withdrawal end of a transaction.

Spot Import Transmission Service

Transmission service introduced as an option for non-load serving entities to offer into the PJM spot market at the border/interface as price takers.

Spot market

Transactions made in the Real-Time and Day-Ahead Energy Market at hourly LMP.

Static Var compensator

A static Var compensator (SVC) is an electrical device for providing fast-acting, reactive power compensation on high-voltage electricity transmission networks.

Summer Net Capability

The Summer Net Capability of each unit or station shall be based on summer conditions and on the power factor level normally expected for that unit or station at the time of the PJM summer peak load.

Summer conditions shall reflect the 50% probability of occurrence (approximated by the mean) of temperature and humidity conditions of the time of the PJM summer peak load. Conditions shall be based on local weather bureau records of the past 15 years, updated at 5 year intervals. When local weather records are not available, the values shall be estimated from the best data available.

For steam units, summer conditions shall mean, where applicable, the probable intake water temperature of once-through or open cooling systems experienced in June, July, and August at the time of the PJM peak each weekday.

For combustion turbine units, summer conditions shall mean, where applicable, the probable ambient air temperature and humidity condition experienced at the unit location at the time of the annual summer PJM peak.

The determination of the Summer Net Capability of hydro and pumped storage units shall be based on operational data or test results taken once each year at any time during the year. The same operational data

or test results can be used for the determination of the Winter Net Capability.

For combined-cycle units, summer conditions shall mean where applicable, the probable intake water temperature of once-through or open cooling systems experienced in June, July, and August at the time of the PJM peak each weekday, and the probable ambient air temperature and humidity condition experienced at the unit location at the time of the annual summer PJM peak.

Supply deviations

Hourly deviations in the supply category, equal to the difference between the sum of cleared increment offers, day-ahead purchases, and day-ahead imports, to the sum of real-time purchases and real-time imports.

Synchronized reserve

Reserve capability which is required in order to enable an area to restore its tie lines to the pre-contingency state within 10 minutes of a contingency that causes an imbalance between load and generation. During normal operation, these reserves must be provided by increasing energy output on electrically synchronized equipment, by reducing load on pumped storage hydroelectric facilities or by reducing the demand by demand-side resources. During system restoration, customer load may be classified as synchronized reserve.

System installed capacity

System total installed capacity measures the sum of the installed capacity (in installed, not unforced, terms) from all internal and qualified external resources designated as PJM capacity resources.

System lambda

The cost to the PJM system of generating the next unit of output.

Temperature-humidity index (THI)

A temperature-humidity index (THI) gives a single, numerical value reflecting the outdoor atmospheric conditions of temperature and humidity as a measure of comfort (or discomfort) during warm weather. THI is defined as: $THI = T_d - (0.55 - 0.55RH) * (T_d - 58)$ if T_d is > 58 ; else $THI = T_d$ (where T_d is the dry-bulb temperature and RH is the percentage of relative humidity.)

Transmission Adequacy and Reliability Assessment (TARA)

An analysis tool that can calculate generation to load impacts. This tool is used to facilitate loop flow analysis across the Eastern Interconnection.

Turn down ratio

The ratio of dispatchable megawatts on a unit's schedule. Calculated by a unit's economic maximum MW divided by its economic minimum MW. An operating parameter of a unit's schedule.

Unforced capacity

Installed capacity adjusted by forced outage rates.

Western region

Defined region for purposes of allocating balancing operating reserve charges. Includes the AEP, AP, ComEd, DLCO, and DAY transmission zones.

Wheel-through

An energy transaction flowing through a transmission grid whose origination and destination are outside of the transmission grid.

Winter Weather Parameter (WWP)

WWP is wind speed adjusted temperature. WWP is defined as: $WWP = T_d - (0.5 * (WIND - 10))$ if $WIND > 10$ mph; $WWP = T_d$ if $WIND \leq 10$ mph (where T_d is the dry-bulb temperature and $WIND$ is the wind speed.)

Zone

See "Control zone" (above).

List of Acronyms

AC2	Advanced Control Center	ATSI	American Transmission Systems, Inc.
ACE	Area control error	AU	Associated unit
ACR	Avoidable cost rate	BA	Balancing authority
AECI	Associated Electric Cooperative Inc.	BAAL	Balancing authority ACE limit
AECO	Atlantic City Electric Company	BACT	Best Available Control Technology
AEG	Alliant Energy Corporation	BCPEP	BGE Pepco Interface
AEP	American Electric Power Company, Inc.	BGE	Baltimore Gas and Electric Company
AFD	Adjusted Fixed Demand	BGS	Basic generation service
AGC	Automatic generation control	BME	Balancing market evaluation
ALM	Active load management	BOR	Balancing Operating Reserve
ALR	Automatic load rejection black start	BORCA	Balancing operating reserve cost allocation
ALTE	Eastern Alliant Energy Corporation	BRA	Base Residual Auction
ALTW	Western Alliant Energy Corporation	BSSWG	Black Start Services Working Group
AMI	Advanced Metering Infrastructure	BTU	British thermal unit
AMIL	Ameren - Illinois	BTM	Behind the meter
AMRN	Ameren	C&I	Commercial and industrial customers
AP	Allegheny Power Company	CAAA	Clean Air Act Amendments
APIR	Avoidable Project Investment Recovery	CAIR	Clean Air Interstate Rule
ARR	Auction Revenue Right	CAISO	California Independent System Operator
ARS	Automatic reserve sharing	CAMR	Clean Air Mercury Rule
ASO	Ancillary Service Optimization	CATR	Clean Air Transport Rule
ATC	Available transfer capability	CBL	Customer base line
		CC	Combined cycle

CCM	Capacity Credit Market	CRC	Central Repository for Curtailments
CCR	Cost Containment Reserves	CRF	Capital Recovery Factor
CDR	Capacity deficiency rate	CSAPR	Cross State Air Pollution Rule
CDS	Cost Development Subcommittee	CSP	Curtailment service provider
CDTF	Cost Development Task Force	CSTF	Capacity Senior Task Force
CETL	Capacity emergency transfer limit	CT	Combustion turbine
CETO	Capacity emergency transfer objective	CTO	Combustion Turbine Optimizer
CF	Coordinated flowgate under the Joint Operating Agreement between PJM and the Midwest Independent Transmission System Operator, Inc.	CTR	Capacity transfer right
CILC	Central Illinois Light Company Interface	DAOR	Day – Ahead Operating Reserve
CILCO	Central Illinois Light Company	DASR	Day-Ahead Scheduling Reserve
CIDS	Critical Infrastructure Protocol	DARRCA	Day – ahead reliability and reactive cost allocation
CIN	Cinergy Corporation	DAY	Dayton Power & Light Company
CIR	Capacity injection rights	DC	Direct current
CLMP	Congestion component of LMP	DCS	Disturbance control standard
CMP	Congestion management process	DEC	Decrement bid
CMR	Congestion Management Report	DFAX	Distribution factor
ComEd	The Commonwealth Edison Company	DGP	Degree of Generator Performance
Con Edison	The Consolidated Edison Company	DL	Diesel
CONE	Cost of new entry	DLC	Direct Load Control
CP	Pulverized coal-fired generator	DLCO	Duquesne Light Company
CPI	Consumer Price Index	DPL	Delmarva Power & Light Company
CPL	Carolina Power & Light Company	DPLN	Delmarva Peninsula north
CPS	Control performance standard	DPLS	Delmarva Peninsula south
		DR	Demand response
		DRS	Demand Response Subcommittee
		DRSDTF	Demand Response Subzonal Dispatch Task Force

DSIRE	Database of State Incentives for Renewables & Efficiency	EMUSTF	Energy Market Uplift Senior Task Force
DSR	Demand-side response	EPA	Environmental Protection Agency
DUK	Duke Energy Corporation	EPOF	Equivalent planned outage factor
EAC	Excess Availability Capacity	EPT	Eastern Prevailing Time
EAF	Equivalent availability factor	ESP	Electrostatic precipitators (Baghouses)
ECAR	East Central Area Reliability Council	EST	Eastern Standard Time
EDC	Electricity distribution company	ExGen	Exelon Generation Company, L.L.C.
EDT	Eastern Daylight Time	FE	FirstEnergy Corp.
EE	Energy efficiency	FERC	The United States Federal Energy Regulatory Commission
EEA	Emergency energy alert	FFE	Firm flow entitlement
EERS	Energy Efficiency Standards	FGD	Flue-gas desulfurization
EES	Enhanced energy scheduler	FMU	Frequently mitigated unit
EFOF	Equivalent forced outage factor	FPA	Federal Power Act
EFORd	Equivalent demand forced outage rate	FPR	Forecast pool requirement
EFORp	Equivalent forced outage rate during peak hours	FRR	Fixed resource requirement
EGU	Electric Generating Units	FSL	Firm service load
EHV	Extra-high-voltage	FTR	Financial transmission right
EIS	Environmental Information Services	FTRTF	Financial Transmission Rights Task Force
EKPC	East Kentucky Power Cooperative, Inc.	GACT	Generally Available Control Technology
ELRP	Economic load response program	GCA	Generation control area
EMAAC	Eastern Mid-Atlantic Area Council	GE	General Electric Company
EMOF	Equivalent maintenance outage factor	GHG	Greenhouse Gas
EMS	Energy management system	GLD	Guaranteed load drop
		GSU	Generator Step-Up Transformers

GW	Gigawatt	IRM	Installed reserve margin
GWh	Gigawatt-hour	IROL	Interconnection Reliability Operating Limit
HAP	Hazardous air pollutants		
HE	Hour Ending	IRR	Internal rate of return
HEDD	NJ High Energy Demand Day	ISA	Interconnection service agreement
HHI	Herfindahl-Hirschman Index	ISO	Independent system operator
HRSG	Heat recovery steam generator	ITSCED	Intermediate term security constrained economic dispatch
HVDC	High-voltage direct current	JCPL	Jersey Central Power & Light Company
Hz	Hertz		
IARR	Incremental ARR's	JOA	Joint operating agreement
IA	RPM Incremental Auction	JOU	Jointly owned units
IBTs	Internal Bilateral Transactions	JRCA	Joint Reliability Coordination Agreement
ICAP	Installed capacity	KV	KiloVolt
ICCP	Inter-control center protocol	KDAEV	Known Day-Ahead Error Value
ICSA	Interconnection construction service agreement	LAER	Lowest Achievable Emissions Rate
IDC	Interchange distribution calculator	LAS	PJM Load Analysis Subcommittee
IESO	Ontario Independent Electricity System Operator	LCA	Load control area
IGCC	Integrated Gasification Combined Cycle	LDA	Locational deliverability area
ILR	Interruptible load for reliability	LGEE	LG&E Energy, L.L.C.
INC	Increment offer	LGIA	Large generator interconnection agreement
IP	Illinois Power Company	LGIP	Large generator interconnection procedure
IPL	Indianapolis Power & Light Company	LIND	Linden Variable Frequency Transformer (VFT)
IPP	Independent power producer	LM	Load management
IPSTF	Interconnection Process Senior Task Force	LMP	Locational marginal price
		LMTF	Load Management Task Force

LOC	Lost opportunity cost	MIS	Market information system
LPC	Locational Pricing Calculator	MISO	Midcontinent Independent Transmission System Operator, Inc.
LSE	Load-serving entity	MMU	PJM Market Monitoring Unit
M2M	Market to market	Mon Power	Monongahela Power
MAAC	Mid-Atlantic Area Council	MOPR	Minimum Offer Price Rule
MAAC+APS	Mid-Atlantic Area Council plus the Allegheny Power System	MP	Market participant
MACRS	Modified accelerated cost recovery schedule	MP2	Monitored Priority 2
MACT	Maximum Achievable Control Technology	MRC	Markets and Reliability Committee
MAD	Mid-Atlantic Dominion subzone	MRT	Minimum run time
MAIN	Mid-America Interconnected Network, Inc.	MUI	Market user interface
MAPP	Mid-Continent Area Power Pool	MW	Megawatt
MATS	Mercury and Air Toxics Standards rule	MWh	Megawatt-hour
MBF	Marginal Benefit Factor	MWS	Maximum weekly starts
MCP	Market-clearing price	NAESB	North American Energy Standards Board
MDS	Maximum daily starts	NAAQS	National Ambient Air Quality Standards
MDT	Minimum down time	NBT	Net Benefits Test
MEC	MidAmerican Energy Company	NCMPA	North Carolina Municipal Power Agency
MECS	Michigan Electric Coordinated System	NEPT	Neptune DC line
Met-Ed	Metropolitan Edison Company	NERC	North American Electric Reliability Council
MIC	Market Implementation Committee	NESHAP	National Emission Standards for Hazardous Air Pollutants
MICHFE	The pricing point for the Michigan Electric Coordinated System and FirstEnergy control areas	NICA	Northern Illinois Control Area
MIL	Mandatory interruptible load	NIPSCO	Northern Indiana Public Service Company

NJDEP	New Jersey Department of Environmental Protection	ORS	NERC Operating Reliability Subcommittee
NNL	Network and native load	PAR	Phase angle regulator
NOPR	Notice of Proposed Rulemaking	PATH	Potomac – Appalachian Transmission Highline
NO _x	Nitrogen oxides		
NPS	National Park Service	PCLLRW	Post Contingency Local Load Relief Warning
NSPS	New Source Performance Standards	PE	PECO Zone
NSR	New Source Review	PEC	Progress Energy Carolinas, Inc.
NSRMCP	Non-Synchronized Reserve Market Clearing Price	PECO	PECO Energy Company
NUG	Non-utility generator	PENELEC	Pennsylvania Electric Company
NYISO	New York Independent System Operator	Pepco	Formerly Potomac Electric Power Company or PEPCO
OA	Amended and Restated Operating Agreement of PJM Interconnection, L.L.C.	PHI	Pepco Holdings, Inc.
OASIS	Open Access Same-Time Information System	PJM	PJM Interconnection, L.L.C.
OATI	Open Access Technology International, Inc.	PJM/AEPNI	The interface between the American Electric Power Control Zone and Northern Illinois
OATT	PJM Open Access Transmission Tariff	PJM/AEPPJM	The interface between the American Electric Power Control Zone and PJM
ODEC	Old Dominion Electric Cooperative	PJM/AEPVVP	The single interface pricing point formed in March 2003 from the combination of two previous interface pricing points: PJM/American Electric Power Company, Inc. and PJM/Dominion Resources, Inc.
OEM	Original equipment manufacturer		
OI	PJM Office of the Interconnection		
Ontario IESO	Ontario Independent Electricity System Operator	PJM/AEPVPEXP	The export direction of the PJM/AEPVVP interface pricing point
OPSI	Organization of PJM States, Inc.	PJM/AEPVPIMP	The import direction of the PJM/AEPVVP interface pricing point
OMC	Outside Management Control		
OVEC	Ohio Valley Electric Corporation	PJM/ALTE	The interface between PJM and the eastern portion of the Alliant Energy Corporation's control area

PJM/ALTW	The interface between PJM and the western portion of the Alliant Energy Corporation's control area	PJM/LGEE	The interface between PJM and the Louisville Gas and Electric Company's control area
PJM/AMRN	The interface between PJM and the Ameren Corporation's control area	PJM/LIND	The interface between PJM and the New York System Operator over the Linden VFT line
PJM/CILC	The interface between PJM and the Central Illinois Light Company's control area	PJM/MEC	The interface between PJM and MidAmerican Energy Company's control area
PJM/CIN	The interface between PJM and the Cinergy Corporation's control area	PJM/MECS	The interface between PJM and the Michigan Electric Coordinated System's control area
PJM/CPLE	The interface between PJM and the eastern portion of the Carolina Power & Light Company's control area	PJM/MISO	The interface between PJM and the Midwest Independent System Operator
PJM/CPLW	The interface between PJM and the western portion of the Carolina Power & Light Company's control area	PJM/NEPT	The interface between PJM and the New York Independent System Operator over the Neptune DC line
PJM/CWPL	The interface between PJM and the City Water, Light & Power's (City of Springfield, IL) control area	PJM/NIPS	The interface between PJM and the Northern Indiana Public Service Company's control area
PJM/DLCO	The interface between PJM and the Duquesne Light Company's control area	PJM/NYIS	The interface between PJM and the New York Independent System Operator
PJM/DUK	The interface between PJM and the Duke Energy Corp.'s control area	PJM/Ontario IESO	PJM/Ontario IESO pricing point
PJM/EKPC	The interface between PJM and the Eastern Kentucky Power Corporation's control area	PJM/OVEC	The interface between PJM and the Ohio Valley Electric Corporation's control area
PJM/FE	The interface between PJM and the FirstEnergy Corp.'s control area	PJM/TVA	The interface between PJM and the Tennessee Valley Authority's control area
PJM/ICC	PJM Industrial Customer Coalition	PJM/VAP	The interface between PJM and the Dominion Virginia Power's control area
PJM/IP	The interface between PJM and the Illinois Power Company's control area	PJM/WEC	The interface between PJM and the Wisconsin Energy Corporation's control area
PJM/IPL	The interface between PJM and the Indianapolis Power & Light Company's control area	PLC	Peak Load Contribution

PLS	Parameter limited schedule	RICE	Reciprocating Internal Combustion Engines
PMSS	Preliminary market structure screen	RLD (MW)	Ramp-limited desired (Megawatts)
PNNE	PENELEC's northeastern subarea	RLR	Retail load responsibility
PNNW	PENELEC's northwestern subarea	RMCCP	Regulation market capability clearing price
POD	Point of delivery	RMCP	Regulation market-clearing price
POR	Point of receipt	RMPCP	Regulation market performance clearing price
PPB	Parts per billion	RMR	Reliability Must Run
PPL	PPL Electric Utilities Corporation	ROFR	Right of First Refusal
PSE&G	Public Service Electric and Gas Company (a wholly owned subsidiary of PSEG)	RPM	Reliability Pricing Model
PSEG	Public Service Enterprise Group	RPS	Renewable Portfolio Standard
PSD	Prevention of Significant Deterioration	RRMSE	Relative Root Mean Squared Error
PSN	PSEG north	RSI	Residual supply index
PSNC	PSEG north central	RSI _x	Residual supply index, using "x" pivotal suppliers
QF	Qualifying Facility	RTC	Real-time commitment
RAA	Reliability Assurance Agreement among Load-Serving Entities	RTEP	Regional Transmission Expansion Plan
RAC	Reliability Assessment Commitment	RTSCED	Real time security constrained economic dispatch
RCF	Reciprocal Coordinated Flowgate	RTO	Regional transmission organization
RCIS	Reliability Coordinator Information System	SAA	Symmetrical Additive Adjustment
REC	Renewable Energy Credit	SCE&G	South Carolina Energy and Gas
RECO	Rockland Electric Company zone	SCED	Security Constrained Economic Dispatch
RFC	ReliabilityFirst Corporation	SCPA	South central Pennsylvania subarea
RFP	Request for Proposal	SCR	Selective catalytic reduction
RGGI	Regional Greenhouse Gas Initiative		

SEPA	Southeast Power Administration	TARA	Transmission adequacy and reliability assessment
SEPJM	Southeastern PJM subarea	TDR	Turn down ratio
SERC	SERC Reliability Corporation	TEAC	Transmission Expansion Advisory Committee
SGIA	Small Generator Interconnection Agreement	THI	Temperature-humidity index
SGIP	Small Generator Interconnection Procedures	TISTF	Transactions Issues Senior Task Force
SIPs	State Implementation Plan	TLR	Transmission loading relief
SFT	Simultaneous feasibility test	TPS	Three pivotal supplier
SMECO	Southern Maryland Electric Cooperative	TPSTF	Three Pivotal Supplier Task Force
SMP	System marginal price	TPY	Tons Per Year
SNCR	Selective Non-Catalytic Reduction	TrAIL	Trans – Allegheny Interstate Line
SNJ	Southern New Jersey	TSA	Thunderstorm Alert
SO ₂	Sulfur dioxide	TSIN	NERC Transmission System Information Network
SOUTHEXP	South Export pricing point	TVA	Tennessee Valley Authority
SOUTHIMP	South Import pricing point	UCAP	Unforced capacity
SPP	Southwest Power Pool, Inc.	UCSA	Upgrade construction service agreement
SPREGO	Synchronized reserve and regulation optimizer (market-clearing software)	UDS	Unit dispatch system
SRMCP	Synchronized reserve market-clearing price	UGI	UGI Utilities, Inc.
SRSTF	System Restoration Strategy Task Force	ULSD	Ultra-Low Sulfur Diesel
STD	Standard deviation	UPF	Unit participation factor
STRPTAS	Short Term Resource Procurement Applicable Share	VACAR	Virginia and Carolinas Area
SVC	Static Var compensator	VAP	Dominion Virginia Power
SWMAAC	Southwestern Mid-Atlantic Area Council	VFT	Variable frequency transformer
		VOCs	Volatile Organic Compounds

VOM	Variable operation and maintenance expense
VRR	Variable resource requirement
WEC	Wisconsin Energy Corporation
WLR	Wholesale load responsibility
WPC	Willing to pay congestion
WWP	Winter Weather Parameter
XEFORd	EFORd modified to exclude OMC outages