

Ancillary Service Markets

The FERC defined six ancillary services in Order No. 888: scheduling, system control and dispatch; reactive supply and voltage control from generation service; regulation and frequency response service; energy imbalance service; operating reserve—synchronized reserve service; and operating reserve—supplemental reserve service.¹ PJM provides scheduling, system control and dispatch and reactive on a cost basis. PJM provides regulation, energy imbalance, synchronized reserve, and supplemental reserve services through market mechanisms.² Although not defined by the FERC as an ancillary service, black start service plays a comparable role. Black start service is provided on the basis of formulaic rates or cost.

The MMU analyzed measures of market structure, conduct and performance for the PJM Synchronized Reserve Market, the PJM DASR Market, and the PJM Regulation Market for the first nine months of 2017.

Table 10-1 The Tier 2 Synchronized Reserve Market results were competitive

Market Element	Evaluation	Market Design
Market Structure: Regional Markets	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Mixed

- The Tier 2 Synchronized Reserve Market structure was evaluated as not competitive because of high levels of supplier concentration.
- Participant behavior was evaluated as competitive because the market rules require competitive, cost-based offers.
- Market performance was evaluated as competitive because the interaction of participant behavior with the market design results in competitive prices.
- Market design was evaluated as mixed. Market power mitigation rules result in competitive outcomes despite high levels of supplier concentration. However, tier 1 reserves are inappropriately compensated when the nonsynchronized reserve market clears with a nonzero price.

¹ 75 FERC ¶ 61,080 (1996).

² Energy imbalance service refers to the Real-Time Energy Market.

Table 10-2 The Day-Ahead Scheduling Reserve Market results were competitive

Market Element	Evaluation	Market Design
Market Structure	Not Competitive	
Participant Behavior	Mixed	
Market Performance	Competitive	Mixed

- The Day-Ahead Scheduling Reserve Market structure was evaluated as not competitive because market participants failed the three pivotal supplier test in 18.9 percent of all cleared hours in the first nine months of 2017.
- Participant behavior was evaluated as mixed because while most offers were equal to marginal costs, a significant proportion of offers reflected economic withholding.
- Market performance was evaluated as competitive because there were adequate offers in every hour to satisfy the requirement and the clearing prices reflected those offers, although there is concern about offers above the competitive level affecting prices. Offers above \$0.00 set the clearing price in 2,057 hours (31.4 percent).
- Market design was evaluated as mixed because the DASR product does not include performance obligations, and the three pivotal supplier test and appropriate market power mitigation should be added to the market to ensure that market power cannot be exercised at times of system stress.

Table 10-3 The Regulation Market results were competitive

Market Element	Evaluation	Market Design
Market Structure	Not Competitive	
Participant Behavior	Competitive	
Market Performance	Competitive	Flawed

- The regulation market structure was evaluated as not competitive for the first nine months of 2017 because the PJM Regulation Market failed the three pivotal supplier (TPS) test in 89.9 percent of the hours in the first nine months of 2017.

- Participant behavior in the PJM Regulation Market was evaluated as competitive for the first nine months of 2017 because market power mitigation requires competitive offers when the three pivotal supplier test is failed and there was no evidence of generation owners engaging in noncompetitive behavior.
- Market performance was evaluated as competitive, despite significant issues with the market design.
- Market design was evaluated as flawed. The market design has failed to correctly incorporate a consistent implementation of the marginal benefit factor in optimization, pricing and settlement. The market results continue to include the incorrect definition of opportunity cost. The result is significantly flawed market signals to existing and prospective suppliers of regulation.

Overview

Primary Reserve

PJM's primary reserves are made up of resources, both synchronized and nonsynchronized, that can provide energy within 10 minutes. Primary reserve is PJM's implementation of the NERC 15-minute contingency reserve requirement.³

Market Structure

- **Supply.** Primary reserve is satisfied by both synchronized reserve (generation or demand response currently synchronized to the grid and available within 10 minutes), and nonsynchronized reserve (generation currently off-line but available to start and provide energy within 10 minutes).
- **Demand.** The PJM primary reserve requirement is 150 percent of the largest contingency. From January 8, 2015, through May 10, 2017, the primary reserve requirement in the RTO Zone was 2,175 MW of which 1,700 MW was required to be available within the Mid-Atlantic Dominion (MAD) Subzone. As of May 10, 2017, the MAD requirement was raised to

2,175 MW. Temporary adjustments to the primary reserve requirement can occur when grid maintenance or outages change the largest contingency. Demand for primary reserve was redefined as 150 percent of the hourly largest contingency on July 12, 2017. In the third quarter of 2017 the average primary reserve requirement was 2,199.2 MW in the RTO Zone and 2,184.9 MW in the MAD Subzone.

Tier 1 Synchronized Reserve

Synchronized reserve is provided by generators or demand response resources synchronized to the grid and capable of increasing output or decreasing load within 10 minutes. Synchronized reserve consists of tier 1 and tier 2 synchronized reserves.

Tier 1 synchronized reserve is part of primary reserve and is the capability of online resources following economic dispatch to ramp up in 10 minutes from their current output in response to a synchronized reserve event. There is no formal market for tier 1 synchronized reserve.

- **Supply.** No offers are made for tier 1 synchronized reserve. The market solution estimates tier 1 synchronized reserve as available 10-minute ramp from the energy dispatch. In the first nine months of 2017, there was an average hourly supply of 1,172.0 MW of tier 1 for the RTO Synchronized Reserve Zone, and an average hourly supply of 1,156.6 MW of tier 1 in the Mid-Atlantic Dominion Subzone.
- **Demand.** The synchronized reserve requirement is calculated hourly as the largest contingency within both the RTO Zone and the MAD Subzone. The requirement can be met with tier 1 or tier 2 synchronized reserves.
- **Tier 1 Synchronized Reserve Event Response.** Tier 1 synchronized reserve is paid when a synchronized reserve event occurs and it responds. When a synchronized reserve event is called, all tier 1 response is paid the average of five minute LMPs during the event, rather than hourly integrated LMP, plus \$50 per MW. This is the Synchronized Energy Premium Price.

Of the Degree of Generator Performance (DGP) adjusted tier 1 synchronized reserve MW estimated at market clearing, 60.1 percent actually responded

³ See PJM, "Manual 10: Pre-Scheduling Operations," Rev. 35 (January 1, 2017), p. 24.

during the six synchronized reserve events with duration of 10 minutes or longer in the first nine months of 2017.

- **Issues.** The competitive offer for tier 1 synchronized reserves is zero, as there is no incremental cost associated with the ability to ramp up from the current economic dispatch point and the appropriate payment for responding to an event is the five-minute LMP plus \$50 per MWh. A tariff change included in the shortage pricing tariff changes (October 1, 2012) added the requirement to pay tier 1 synchronized reserve the tier 2 synchronized reserve market clearing price whenever the nonsynchronized reserve market clearing price rises above zero. This requirement was unnecessary and inconsistent with efficient markets. The rationale for this change was and is unclear, but it has had a significant impact on the cost of tier 1 synchronized reserves, resulting in a windfall payment of \$89,719,045 to tier 1 resources in 2014, \$34,397,441 in 2015, \$4,948,084 in 2016, and \$1,995,133 in the first nine months of 2017.

Tier 2 Synchronized Reserve Market

Tier 2 synchronized reserve is part of primary reserve and is comprised of resources that are synchronized to the grid, that incur costs to be synchronized, that have an obligation to respond, that have penalties for failure to respond, and that must be dispatched in order to satisfy the synchronized reserve requirement.

When the synchronized reserve requirement cannot be met with tier 1 synchronized reserve, PJM uses a market to satisfy the balance of the requirement with tier 2 synchronized reserve. The Tier 2 Synchronized Reserve Market includes the PJM RTO Reserve Zone and a subzone, the Mid-Atlantic Dominion Reserve Subzone (MAD).

Market Structure

- **Supply.** In the first nine months of 2017, the supply of offered and eligible tier 2 synchronized reserve was 24,015.8 MW in the RTO Zone of which 6,726.4 MW (including 1,497.7 MW of DSR) was located in the MAD Subzone.

- **Demand.** The average hourly required synchronized reserve requirement was 1,522.8 MW in the RTO Reserve Zone and 1,514.8 MW for the Mid-Atlantic Dominion Reserve Subzone. The hourly average required tier 2 synchronized reserve was 455.1 MW in the MAD Subzone and 524.3 MW in the RTO.
- **Market Concentration.** Both the Mid-Atlantic Dominion Subzone Tier 2 Synchronized Reserve Market and the RTO Synchronized Reserve Zone Market were characterized by structural market power in the first nine months of 2017.

In the first nine months of 2017, the weighted average HHI for tier 2 synchronized reserve in the Mid-Atlantic Dominion Subzone was 5895, which is classified as highly concentrated. The MMU calculates that the three pivotal supplier test in the Mid-Atlantic Dominion Subzone would have been failed in 64.4 percent of hours.

In the first nine months of 2017, the weighted average HHI for cleared tier 2 synchronized reserve in the RTO Synchronized Reserve Zone was 6653, which is classified as highly concentrated. The MMU calculates that the three pivotal supplier test in the RTO Synchronized Reserve Zone would have been failed in 63.9 percent of hours.

Market Conduct

- **Offers.** There is a must offer requirement for tier 2 synchronized reserve. All nonemergency generation capacity resources are required to submit a daily offer for tier 2 synchronized reserve, unless the unit type is exempt. Tier 2 synchronized reserve offers from generating units are subject to an offer cap of marginal cost plus \$7.50 per MW, plus opportunity cost which is calculated by PJM. There has been less than complete compliance with the tier 2 synchronized reserve must offer requirement.

Market Performance

- **Price.** The weighted average price for tier 2 synchronized reserve for all cleared hours in the Mid-Atlantic Dominion (MAD) Subzone was \$3.34

per MW in the first nine months of 2017, a decrease of \$1.05 from the first nine months of 2016.

The weighted average price for tier 2 synchronized reserve for all cleared hours in the RTO Synchronized Reserve Zone was \$3.44 per MW in the first nine months of 2017, a decrease of \$0.91 from the first nine months of 2016.

Nonsynchronized Reserve Market

Nonsynchronized reserve is part of primary reserve and includes the RTO Reserve Zone and the Mid-Atlantic Dominion Reserve Subzone (MAD). Nonsynchronized reserve is comprised of nonemergency energy resources not currently synchronized to the grid that can provide energy within 10 minutes. Nonsynchronized reserve is available to fill the primary reserve requirement above the synchronized reserve requirement. Generation owners do not submit supply offers. PJM defines the demand curve for nonsynchronized reserve and PJM defines the supply curve based on nonemergency generation resources that are available to provide energy and can start in 10 minutes or less (based on offer parameters), and on the resource opportunity costs calculated by PJM.

Market Structure

- **Supply.** In the first nine months of 2017, the average hourly supply of eligible nonsynchronized reserve was 2,382.6 MW in the RTO Zone and 2,035.0 MW in MAD Subzone.
- **Demand.** Demand for nonsynchronized reserve equals the primary reserve requirement minus the tier 1 synchronized reserve estimate and minus the scheduled tier 2 synchronized reserve.⁴ In the RTO Zone, the market cleared an hourly average of 1,226.0 MW of nonsynchronized reserve in the first nine months of 2017. The MAD Subzone cleared an average of 863.0 MW in the first nine months of 2017.
- **Market Concentration.** In the first nine months of 2017, the weighted average HHI for cleared nonsynchronized reserve in the MAD Subzone

⁴ See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017), p. 81. "Because Synchronized Reserve may be utilized to meet the Primary Reserve requirement, there is no explicit requirement for non-synchronized reserves."

was 3661 which is classified as highly concentrated. In the RTO Zone the weighted average HHI was 3657, which is also highly concentrated. The MMU calculates that the three pivotal supplier test would have been failed in 48.4 percent of hours in the MAD Subzone and zero hours in the RTO Zone.

Market Conduct

- **Offers.** Generation owners do not submit supply offers. Nonemergency generation resources that are available to provide energy and can start in 10 minutes or less are considered available for nonsynchronized reserves by the market solution software. PJM calculates the associated offer prices based on PJM calculations of resource specific opportunity costs.

Market Performance

- **Price.** The nonsynchronized reserve price is determined by the opportunity cost of the marginal nonsynchronized reserve unit. The nonsynchronized reserve weighted average price for all hours in both the RTO Reserve Zone and MAD Subzone was \$0.17 per MW in the first nine months of 2017. The price cleared above \$0.00 only 2.1 percent of hours.

Secondary Reserve

There is no NERC standard for secondary reserve. PJM defines secondary reserve as reserves (online or offline available for dispatch) that can be converted to energy in 30 minutes. PJM defines a secondary reserve requirement but does not have a goal to maintain this reserve requirement in real time.

PJM maintains a day-ahead, offer based market for 30-minute day-ahead secondary reserve. The Day-Ahead Scheduling Reserve Market (DASR) has no performance obligations except that a unit which clears the DASR market may not be on an outage in real time.⁵ If DASR units are on an outage in real time, the DASR payment is not made.

⁵ See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017), p. 172.511.1.

Market Structure

- **Supply.** The DADR Market is a must offer market. Any resources that do not make an offer have their offer set to \$0.00 per MW. DADR is calculated by the day-ahead market solution as the lesser of the thirty minute energy ramp rate or the economic maximum MW minus the day-ahead dispatch point for all online units. In the first nine months of 2017, the average available hourly DADR was 36,567.3 MW.
- **Demand.** The DADR requirement for 2017 is 5.52 percent of peak load forecast, down from 5.70 percent in 2016. The average DADR MW purchased was 5,756.4 MW per hour in the first nine months of 2017, compared to the 6,345.0 MW per hour in the same time period of 2016.
- **Concentration.** In the first nine months of 2017, the MMU estimates that the DADR Market would have failed the three pivotal supplier test in 18.9 percent of hours.

Market Conduct

- **Withholding.** Economic withholding remains an issue in the DADR Market. The direct marginal cost of providing DADR is zero. PJM calculates the opportunity cost for each resource. All offers by resource owners greater than zero constitute economic withholding. In the first nine months of 2017, a daily average of 41.0 percent of units offered above \$0.00. A daily average of 11.7 percent of units offered above \$5.
- **DR.** Demand resources are eligible to participate in the DADR Market. Some demand resources have entered offers for DADR. No demand resources cleared the DADR market in the first nine months of 2017.

Market Performance

- **Price.** In the first nine months of 2017, the weighted average DADR price for all hours when the DASRMCP was above \$0.00 was \$3.10.

Regulation Market

The PJM Regulation Market is a real-time market. Regulation is provided by generation resources and demand response resources that qualify to follow one of two regulation signals, RegA or RegD. PJM jointly optimizes regulation with synchronized reserve and energy to provide all three products at least cost. The PJM regulation market design includes three clearing price components: capability; performance; and opportunity cost. The RegA signal is designed for energy unlimited resources with physically constrained ramp ability. The RegD signal is designed for energy limited resources with fast ramp rates. In the Regulation Market RegD MW are converted to effective MW using a marginal rate of substitution (MRTS), called a marginal benefit function (MBF). Correctly implemented, the MBF would be the marginal rate of technical substitution (MRTS) between RegA and RegD, holding the level of regulation service constant. The current market design is critically flawed as it has not properly implemented the MBF as an MRTS between RegA and RegD resource MW and the MBF has not been consistently applied in the optimization, clearing and settlement of the Regulation Market.

Market Structure

- **Supply.** In the first nine months of 2017, the average hourly eligible supply of regulation for nonramp hours was 1,135.6 performance adjusted MW (858.9 effective MW).⁶ This was a decrease of 79.4 performance adjusted MW (an increase of 9.4 effective MW) from the first nine months of 2016, when the average hourly eligible supply of regulation for nonramp hours was 1,215.0 performance adjusted MW (849.6 effective MW). In the first nine months of 2017, the average hourly eligible supply of regulation for ramp hours was 1,423.0 performance adjusted MW (1,173.7 effective MW). This was an increase of 231.6 performance adjusted MW (225.5 effective MW) from the first nine months of 2016, when the average hourly eligible supply of regulation was 1,191.4 performance adjusted MW (948.2 effective MW).

⁶ On peak and off peak hours are now designated as ramp and nonramp hours. The definitions change by season. See "Regulation requirement definition," <<http://www.pjm.com/~media/markets-ops/ancillary/regulation-requirement-definition.ashx>>.

- **Demand.** Prior to January 9, 2017, the hourly regulation demand was set to 525.0 effective MW for nonramp hours and 700.0 effective MW for ramp hours. Starting January 9, 2017, the hourly regulation demand was set to 525.0 effective MW for nonramp hours and 800.0 effective MW for ramp hours.
- **Supply and Demand.** The nonramp regulation requirement of 525.0 effective MW was provided by a combination of RegA and RegD resources equal to 491.6 hourly average MW in the first nine months of 2017. This is a decrease of 26.6 MW from the first nine months of 2016, when the average hourly total regulation cleared MW for nonramp hours were 518.3 MW. The ramp regulation requirement of 700.0 effective MW prior to January 9, 2017, and 800.0 effective MW after January 9, 2017, was provided by a combination of RegA and RegD resources equal to 718.8 hourly average MW in the first nine months of 2017. This is an increase of 80.9 MW from the first nine months of 2016, where the average hourly regulation cleared MW for ramp hours were 637.9 MW.

The ratio of the average hourly eligible supply of regulation to average hourly regulation demand for ramp hours was 1.98 in the first nine months of 2017. This is an increase of 6.1 percent from the first nine months of 2016, when the ratio was 1.87. The ratio of the average hourly eligible supply of regulation to average hourly regulation demand required for nonramp hours was 2.31 in the first nine months of 2017. This is a decrease of 1.6 percent from the first nine months of 2016, when the ratio was 2.35.

- **Market Concentration.** In the first nine months of 2017, the three pivotal supplier test was failed in 89.9 percent of hours. In the first nine months of 2017, the weighted average HHI of RegA resources was 2730, which is highly concentrated and the weighted average HHI of RegD resources was 1595, which is also highly concentrated. The weighted average HHI of all resources was 1144, which is moderately concentrated.

Market Conduct

- **Offers.** Daily regulation offer prices are submitted for each unit by the unit owner. Owners are required to submit a cost-based offer and may submit a price-based offer. Offers include both a capability offer and a performance offer. Owners must specify which signal type the unit will be following, RegA or RegD.⁷ In the first nine months of 2017, there were 215 resources following the RegA signal and 54 resources following the RegD signal.

Market Performance

- **Price and Cost.** The weighted average clearing price for regulation was \$15.70 per effective MW of regulation in the first nine months of 2017. This is a decrease of \$0.82 per MW, or 4.9 percent, from the weighted average clearing price of \$16.52 per MW in the first nine months of 2016. The weighted average cost of regulation in the first nine months of 2017 was \$21.68 per effective MW of regulation. This is an increase of \$2.69 per MW, or 14.2 percent, from the weighted average cost of \$18.99 per MW in the first nine months of 2016. The decrease in regulation price in the first nine months of 2017 resulted primarily from reductions in the opportunity cost component of the regulation clearing prices due to low energy prices in the first nine months of 2017 compared to the first nine months of 2016.
- **Prices.** RegD resources continue to be incorrectly compensated relative to RegA resources due to an inconsistent application of the marginal benefit factor in the optimization, assignment and settlement processes. If the Regulation Market were functioning efficiently, RegD and RegA resources would be paid the same price per effective MW. RegA resources are paid on the basis of dollars per effective MW of RegA. RegD resources are not paid in terms of dollars per effective MW of RegA because the marginal benefit factor is not used in settlements. When the marginal benefit factor is above 1.0, RegD resources are generally (depending on the mileage ratio) underpaid on a per effective MW basis. When the MBF is less than one, RegD resources are generally overpaid on a per effective MW

⁷ See the 2016 State of the Market Report for PJM, Volume 2, Appendix F "Ancillary Services Markets."

basis. Currently, the average MBF is less than 1.0, resulting in persistent overpayment of RegD resources that creates an artificial incentive for inefficient entry of RegD resources. The MBF averaged less than 1.0 in five of the first nine months of 2017, resulting in RegD resources being paid an average of \$14.1 million (385.3 percent) more than they should have in the first nine months of 2017. In each of the first nine months of 2016, the average MBF was less than 1.0, resulting in RegD resources being paid an average of \$11.02 million (1,855.6 percent) more than they should have been.

- Marginal Benefit Factor Function.** The marginal benefit factor (MBF) is intended to measure the operational substitutability of RegD resources for RegA resources. The marginal benefit factor function is incorrectly defined and applied in the PJM market clearing. Correctly defined, the MBF function represents the Marginal Rate of Technical Substitution (MRTS) between RegA and RegD. Correctly implemented, the MBF would be consistently applied in the Regulation Market clearing and settlement. The current incorrect and inconsistent implementation of the MBF function has resulted in the PJM Regulation Market over procuring RegD relative to RegA in most hours and in a consistently inefficient market signal to participants regarding the value of RegD to the market in every hour. This over procurement began to degrade the ability of PJM to control ACE in some hours while at the same time increasing the cost of regulation.⁸
- Changes to the Regulation Market.** On December 14, 2015, PJM changed the MBF curve in an attempt to reduce the over procurement of RegD. The modification to the marginal benefit curve did not correct the identified issues. PJM made additional changes which went into effect on January 9, 2017. These include changing the definition of nonramp and ramp hours based on the season, increasing the effective MW requirement during ramp hours from 700 MW to 800 MW, adjusting the currently independent RegA and RegD signals to be interdependent, and changing the 15-minute neutrality requirement of the RegD signal to a 30-minute

conditional neutrality requirement. The January 9 changes did not resolve the underlying issues. As a result of the changes implemented on January 9, 2017, the average daily payment per performance adjusted RegD MW increased by 57.2 percent, from \$10.01 between the January 1, 2016, through January 8, 2017, period (prior to the change in signal design), to \$15.74 between the January 9, 2017, through September 30, 2017, period (after the change in signal design). Effective July 31, 2017, PJM ended the use of excursion hours (hours ending 7:00, 8:00, 18:00-21:00), in which PJM had decided that more RegA was needed and PJM did not clear any RegD with an MBF less than 1.0.

Black Start Service

Black start service is required for the reliable restoration of the grid following a blackout. Black start service is the ability of a generating unit to start without an outside electrical supply, or is the demonstrated ability of a generating unit to automatically remain operating at reduced levels when disconnected from the grid (automatic load rejection or ALR).⁹

In the first nine months of 2017, total black start charges were \$46.9 million, including \$46.8 million in revenue requirement charges and \$0.182 million in operating reserve charges. Black start revenue requirements consist of fixed black start service costs, variable black start service costs, training costs, fuel storage costs, and an incentive factor. Black start operating reserve charges are paid to units scheduled in the Day-Ahead Energy Market or committed in real time to provide black start service under the ALR option or for black start testing. Black start zonal charges for the first nine months of 2017 ranged from \$0.05 per MW-day in the DLCO Zone (total charges were \$33,750) to \$4.27 per MW-day in the PENELEC Zone (total charges were \$3,016,578).

Reactive

Reactive service, reactive supply and voltage control are provided by generation and other sources of reactive power (measured in MVar). Reactive power helps maintain appropriate voltages on the transmission system and is **essential to the flow of real power** (measured in MW).

⁸ The issues associated with over procurement were brought before the PJM Operating Committee in May of 2015. Regulation Performance Impacts, PJM Operating Committee, (May 26, 2015), which can be accessed at: <<http://www.pjm.com/committees-and-groups/committees/oc.aspx>>.

⁹ OATT Schedule 1 § 1.3BB.

Reactive capability revenue requirements are based on FERC approved filings.¹⁰ Reactive service charges are paid to units that operate in real time outside of their normal range at the direction of PJM for the purpose of providing reactive service. Reactive service charges are paid for scheduling in the Day-Ahead Energy Market and committing units in real time that provide reactive service. In the first nine months of 2017, total reactive charges were \$249.5 million, a 12.6 percent increase from \$221.6 million in the first nine months of 2016. Reactive capability revenue requirement charges increased from \$220.8 million in the first nine months of 2016 to \$235.4 million in the first nine months of 2017 and reactive service charges increased from \$0.8 million in the first nine months of 2016 to \$14.0 million in the first nine months of 2017. Total reactive service charges in the first nine months of 2017 ranged from \$1,239 in the RECO Zone to \$31.9 million in the ComEd Zone.

Ancillary Services Costs per MWh of Load: January through September, 1999 through 2017

Table 10-4 shows PJM ancillary services costs for January through September, 1999 through 2017, per MWh of load. The rates are calculated as the total charges for the specified ancillary service divided by the total PJM real-time load in MWh. The scheduling, system control, and dispatch category of costs is comprised of PJM scheduling, PJM system control and PJM dispatch; owner scheduling, owner system control and owner dispatch; other supporting facilities; black start services; direct assignment facilities; and ReliabilityFirst Corporation charges. The cost per MWh of load in Table 10-4 is a different metric than the cost of each ancillary service per MW of that service. The cost per MWh of load includes the effects both of price changes per MW of the ancillary service and changes in total load.

¹⁰ OATT Schedule 2.

Table 10-4 History of ancillary services costs per MWh of Load: January through September, 1999 through 2017¹¹

Year (Jan-Sep)	Regulation	Scheduling, Dispatch and System Control	Reactive	Synchronized Reserve	Total
1999	\$0.16	\$0.22	\$0.25	\$0.00	\$0.63
2000	\$0.33	\$0.29	\$0.31	\$0.00	\$0.93
2001	\$0.55	\$0.70	\$0.22	\$0.00	\$1.47
2002	\$0.42	\$0.82	\$0.19	\$0.00	\$1.43
2003	\$0.53	\$1.01	\$0.23	\$0.13	\$1.90
2004	\$0.50	\$0.99	\$0.25	\$0.14	\$1.88
2005	\$0.78	\$0.73	\$0.26	\$0.11	\$1.88
2006	\$0.55	\$0.74	\$0.28	\$0.07	\$1.64
2007	\$0.65	\$0.72	\$0.27	\$0.06	\$1.70
2008	\$0.78	\$0.44	\$0.33	\$0.07	\$1.62
2009	\$0.36	\$0.34	\$0.36	\$0.04	\$1.10
2010	\$0.38	\$0.36	\$0.36	\$0.06	\$1.16
2011	\$0.36	\$0.36	\$0.38	\$0.09	\$1.19
2012	\$0.23	\$0.41	\$0.44	\$0.03	\$1.11
2013	\$0.27	\$0.41	\$0.67	\$0.03	\$1.38
2014	\$0.36	\$0.41	\$0.40	\$0.14	\$1.31
2015	\$0.25	\$0.41	\$0.36	\$0.12	\$1.14
2016	\$0.11	\$0.41	\$0.37	\$0.05	\$0.94
2017	\$0.13	\$0.47	\$0.44	\$0.06	\$1.10

Recommendations

- The MMU recommends that the Regulation Market be modified to incorporate a consistent application of the marginal benefit factor (MBF) throughout the optimization, assignment and settlement process. The MBF should be defined as the Marginal Rate of Technical Substitution (MRTS) between RegA and RegD. (Priority: High. First reported 2012. Status: Not adopted.)
- The MMU recommends that the lost opportunity cost in the ancillary services markets be calculated using the schedule on which the unit was scheduled to run in the energy market. (Priority: High. First reported 2010. Status: Not adopted.)

¹¹ Note: The totals in this table account for after the fact billing adjustments made by PJM and may not match totals presented in past reports.

- The MMU recommends that all data necessary to perform the Regulation Market three pivotal supplier test be saved so that the test can be replicated. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends that, to prevent gaming, there be a penalty enforced in the Regulation Market as a reduction in performance score and/or a forfeiture of revenues when resource owners elect to deassign assigned regulation resources within the hour. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends market design changes to improve the performance of the Regulation Market, including use of a single five minute clearing price based on actual LMP and actual LOC, modifications to the LOC calculation, a software change to save some data elements necessary for verifying market outcomes, and further documentation of the implementation of the market design. (Priority: Medium. First reported 2010. Status: Partially adopted in 2012.)
- The MMU recommends that the rule requiring that tier 1 synchronized reserve resources are paid the tier 2 price when the nonsynchronized reserve price is above zero be eliminated immediately and that, under the current rule, tier 1 synchronized reserve resources not be paid the tier 2 price when they do not respond. (Priority: High. First reported 2013. Status: Not adopted.)
- The MMU recommends that the tier 2 synchronized reserve must offer requirement be enforced. The MMU recommends that PJM define a set of acceptable reasons why a unit can be made unavailable daily or hourly and require unit owners to select a reason in Markets Gateway whenever making a unit unavailable either daily or hourly or setting the offer MW to 0 MW. (Priority: Medium. First reported 2013. Status: Partially adopted.)
- The MMU recommends that PJM be more explicit and transparent about why tier 1 biasing is used in defining demand in the Tier 2 Synchronized Reserve Market. The MMU recommends that PJM define rules for estimating tier 1 MW, define rules for the use and amount of tier 1 biasing and identify the rule based reasons for each instance of biasing. (Priority: Medium. First reported 2012. Status: Not adopted.)
- The MMU recommends that the single clearing price for synchronized reserves be determined based on the actual five minute LMP and actual LOC and not the forecast LMP. (Priority: Low. First reported 2010. Status: Adopted, 2016.)
- The MMU recommends that no payments be made to tier 1 resources if they are deselected in the PJM market solution. The MMU also recommends that documentation of the Tier 1 synchronized reserve deselection process be published. (Priority: High. First reported 2014. Status: Adopted, 2014.)
- The MMU recommends that a reason code be attached to every hour in which PJM market operations adds additional DASR MW. (Priority: Medium. First reported 2015. Status: Not adopted.)
- The MMU recommends that PJM modify the DASR Market to ensure that all resources cleared incur a real-time performance obligation. (Priority: Low. First reported 2013. Status: Not adopted.)
- The MMU recommends that the three pivotal supplier test and market power mitigation be incorporated in the DASR Market. (Priority: Low. First reported 2009. Status: Not adopted.)
- The MMU recommends that separate payments for reactive capability be eliminated and the cost of reactive capability be recovered in the capacity market. (Priority: Medium. First reported 2016. Status: Not adopted.)
- The MMU recommends that for oil tanks which are shared with other resources that only a proportionate share of the minimum tank suction level (MTSL) be allocated to black start service. The MMU further recommends that the PJM tariff be updated to clearly state how the MTSL will be calculated for black start units sharing oil tanks. (Priority: Medium. New recommendation. Status: Not adopted.)

Conclusion

The current PJM Regulation Market design that incorporates two signals using two resource types was a result of Commission Order No. 755 and subsequent orders that required a flawed design.¹²

The current design of the PJM Regulation Market is significantly flawed. The market design has failed to correctly incorporate the marginal rate of technical substitution (MRTS) in market clearing and settlement. The market design uses the marginal benefit factor (MBF) to incorrectly represent the MRTS and uses a mileage ratio instead of the MBF in settlement. This failure to correctly and consistently incorporate the MRTS into the regulation market design has resulted in both underpayment and overpayment of RegD resources and in the over procurement of RegD resources in all hours. The market results continue to include the incorrect definition of opportunity cost. These issues have led to the MMU's conclusion that the regulation market design is flawed.

To address these flaws, the MMU and PJM developed a joint proposal which was approved by the PJM Members Committee on July 27, 2017. The PJM/MMU joint proposal addresses issues with the inconsistent application of the marginal benefit factor throughout the optimization and settlement process in the PJM Regulation Market.

The structure of the Tier 2 Synchronized Reserve Market has been evaluated and the MMU has concluded that these markets are not structurally competitive as they are characterized by high levels of supplier concentration and inelastic demand. As a result, these markets are operated with market clearing prices and with offers based on the marginal cost of producing the product plus a margin. As a result of these requirements, the conduct of market participants within these market structures has been consistent with competition, and the market performance results have been competitive. However, compliance with calls to respond to actual synchronized reserve events remains less than 100 percent. For the six spinning events 10 minutes or longer in 2016, the average tier 2 synchronized reserve response was 85.5 percent of all scheduled MW.

For the six spinning events 10 minutes or longer in the first nine months of 2017, the response was 87.6 percent of scheduled tier 2 MW.

The rule that requires payment of the tier 2 synchronized reserve price to tier 1 synchronized reserve resources when the nonsynchronized reserve price is greater than zero, is inefficient and results in a substantial windfall payment to the holders of tier 1 synchronized reserve resources. Tier 1 resources have no obligation to perform and pay no penalties if they do not perform, and tier 1 resources do not incur any costs when they are part of the tier 1 estimate in the market solution. Tier 1 resources are already paid for their response if they do respond. Tier 1 resources require no additional payment. If tier 1 resources wish to be paid as tier 2 resources, the rules provide the opportunity to make competitive offers in the tier 2 market and take on the associated obligations. Overpayment of tier 1 resources based on this rule added \$89.7 million to the cost of primary reserve in 2014, \$34.1 million in 2015, \$4.9 million in 2016, and \$2.0 million in the first nine months of 2017.

The benefits of markets are realized under these approaches to ancillary service markets. Even in the presence of structurally noncompetitive markets, there can be transparent, market clearing prices based on competitive offers that account explicitly and accurately for opportunity cost. This is consistent with the market design goal of ensuring competitive outcomes that provide appropriate incentives without reliance on the exercise of market power and with explicit mechanisms to prevent the exercise of market power.

The MMU concludes that the regulation market results were competitive, although the market design is flawed. The MMU concludes that the synchronized reserve market results were competitive. The MMU concludes that the DASR market results were competitive, although offers above the competitive level continue to affect prices.

¹² *Frequency Regulation Compensation in the Organized Wholesale Power Markets*, Order No. 755, 137 FERC ¶ 61,064 at PP 197–200 (2011).

Primary Reserve

NERC Performance Standard BAL-002-1, Disturbance Control Performance, requires PJM to carry sufficient contingency reserve to recover from a sudden loss of load (disturbance) within 15 minutes. The NERC requirement is 100 percent compliance and status must be reported quarterly. PJM implements this contingency reserve requirement using primary reserves.¹³ PJM maintains 10 minute reserves (primary reserve) to ensure reliability in the event of disturbances. PJM's primary reserves are made up of resources, both synchronized and nonsynchronized, that can provide energy within 10 minutes.

Market Structure

Demand

PJM requires that 150 percent of the largest contingency on the system be maintained as primary reserve. PJM can make temporary adjustments to the primary reserve requirement when grid maintenance or outages change the largest contingency or in cases of hot weather alerts or cold weather alerts.

Until July 12, 2017, PJM's primary reserve requirement was 2,175 MW for the RTO Zone. From January 1 through May 9, 2017, the primary reserve requirement was 1,700 MW for the MAD Subzone. On May 10, 2017, the primary reserve requirement for the MAD subzone was raised to 2,175 MW. This means that the full 2,175 MW of primary reserve must at all times be deliverable everywhere across the RTO. On July 12, 2017, PJM adopted a dynamic reserve requirement set equal to 150 percent of the largest contingency, determined hourly, based on the forecasted dispatch.

On January 10, 2017, the default primary reserve requirement in the RTO Reserve Zone was temporarily raised from 2,175 MW to 3,300 MW for 32 hours. On May 10, 2017, the default primary reserve requirement for the RTO Reserve Zone was temporarily raised from 2,175 MW to 2,550 MW for two hours. The hourly average RTO primary reserve requirement from January 1, 2017 through July 11, 2017 was 2,183.3 MW. From July 12, 2017 through


¹³ See PJM, "Manual 10: Pre-Scheduling Operations," Rev. 35 (January 1, 2017) at 2425.

September 30, 2017, the average primary reserve requirement in the RTO Zone was 2,199.2 MW.

No temporary changes were applied to the primary reserve requirement in the MAD Subzone between January 1 and July 11, 2017. From July 12, 2017 through September 30, 2017, the average primary reserve requirement was 2,184.9 MW.

Transmission constraints limit the deliverability of reserves within the RTO, requiring the definition of the Mid-Atlantic Dominion (MAD) Subzone (Figure 10-1).¹⁴

Figure 10-1 PJM RTO Zone and MAD Subzone geography: 2017

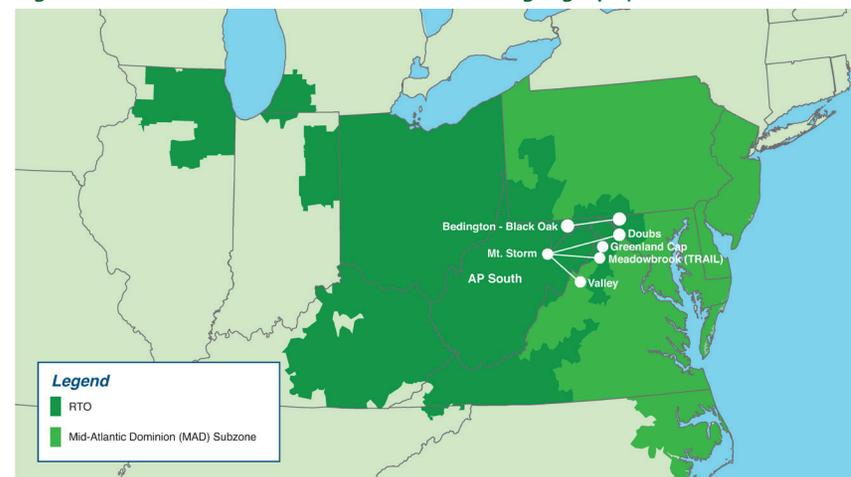

The MAD Subzone is generally defined dynamically by the most limiting constraint separating MAD from the PJM RTO Reserve Zone. However, PJM can override the dynamic determination. Between January 1, 2017, and September 30, 2017, Bedington - Black Oak was the most limiting interface in 70.1 percent of hourly market solutions and AP South was the most limiting interface in the other 29.9 percent of hours.

¹⁴ Additional subzones may be defined by PJM to meet system reliability needs. PJM will notify stakeholders in such an event. See PJM Manual 11: Energy & Ancillary Services Market Operations, Rev. 90 (July 27, 2017) at 87.

PJM requires that synchronized reserves equal at least 100 percent of the largest contingency. Prior to PJM's introduction of the dynamic, real time determination of the largest contingency in every spinning market solution on July 12, 2017, the primary reserve requirement was 1,450 MW in every hour for both RTO Reserve Zone and the Mid Atlantic Dominion Reserve Subzone. From July 12, through September 30, 2017, the synchronized reserve requirement averaged 1,514.8 MW per hour in the MAD Subzone and 1,522.8 MW per hour in the RTO Zone.

Supply

The demand for primary reserve is satisfied by tier 1 synchronized reserves, tier 2 synchronized reserves and nonsynchronized reserves, subject to the requirement that synchronized reserves equal 100 percent of the largest contingency. After the hourly synchronized reserve requirement is satisfied, the remainder of primary reserves can come from the least expensive combination of synchronized and nonsynchronized reserves.

Estimated tier 1 is credited against PJM's primary reserve requirement as well as PJM's synchronized reserve requirement. In the MAD Subzone an average of 1,077.6 MW of tier 1 was identified by the ASO market solution as available hour ahead during the first nine months of 2017 (Table 10-6).¹⁵ Tier 1 synchronized reserve fully satisfied the MAD Subzone synchronized reserve requirement in 3.9 percent of hours in the first nine months of 2017. In the RTO Zone, an average of 1,156.8 MW of tier 1 was available (Table 10-6). Tier 1 synchronized reserve fully satisfied the RTO Zone synchronized reserve requirement in 33.1 percent of all hours. The tier 1 MW in this report includes the impact of tier 1 MW reductions caused by tier 1 biasing by PJM operators. Tier 1 biasing is discussed in detail in the Tier 1 Estimate Bias section.

Regardless of online/offline state, all nonemergency generation capacity resources must submit a daily offer for tier 2 synchronized reserve in Markets Gateway prior to the offer submission deadline (14:15 the day prior to the operating day). Resources listed as available for tier 2 synchronized reserve

without a synchronized reserve offer will have their offer price automatically set to \$0.00. Offer MW and other non-cost offer parameters can be changed during the operating day. Owners are permitted to make resources unavailable for tier 2 synchronized reserve daily or hourly, but only if they are physically unavailable. Certain unit types including nuclear, wind, solar, and energy storage resources, are expected to have zero MW tier 2 synchronized reserve offer quantities.¹⁶

After tier 1 is estimated, the remainder of the synchronized reserve requirement is met by tier 2. In the RTO Zone, there were 24,010.7 MW of tier 2 synchronized reserve offered daily. Of this, 6,513.7 MW were located in the MAD Subzone (Figure 10-11) and available to meet the average tier 2 hourly demand of 441.5 MW (Table 10-5).

In the MAD Subzone, there was an average of 2,037.9 MW of eligible nonsynchronized reserve supply available to meet the average hourly demand of 424.3 MW. (Table 10-6) In the RTO Zone, an hourly average of 2,388.2 MW supply was available to meet the average hourly demand of 439.0 MW (Table 10-5).

Table 10-5 provides the average monthly reserves, by type, uses to satisfy the primary reserve requirement in the MAD subzone from January 1, 2016, through September 30, 2017.

¹⁵ ASO, Ancillary Services Optimizer. This is the hour-ahead market software that optimizes ancillary services with energy. ASO schedules hourly the Tier 2 Synchronized Reserve, Regulation, and Nonsynchronized Reserves.

¹⁶ See PJM. "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 86.

Table 10-5 Average monthly reserves used to satisfy the primary reserve requirement, MAD Subzone: January 1, 2016 through September 30, 2017

Year	Month	Tier 1 Total MW	Tier 2 Synchronized Reserve MW	Nonsynchronized Reserve MW	Total Primary Reserve MW
2016	Jan	1,263.5	228.5	295.9	1,787.9
2016	Feb	1,230.1	241.5	302.2	1,773.8
2016	Mar	993.3	485.7	265.7	1,744.7
2016	Apr	912.4	565.0	289.2	1,766.5
2016	May	956.5	511.3	292.2	1,760.0
2016	Jun	1,116.9	348.4	368.7	1,834.0
2016	Jul	1,254.7	208.8	621.3	2,084.7
2016	Aug	1,228.4	239.7	669.1	2,137.2
2016	Sep	1,170.6	293.0	603.7	2,067.2
2016	Oct	1,086.1	481.3	508.7	2,076.2
2016	Nov	774.8	687.8	360.4	1,822.9
2016	Dec	995.0	479.6	520.7	1,995.3
2016		1,081.8	397.5	424.8	1,904.2
2017	Jan	981.6	508.5	361.1	1,851.2
2017	Feb	1,111.6	355.5	377.7	1,844.9
2017	Mar	767.4	693.3	399.3	1,860.0
2017	Apr	896.9	555.4	435.4	1,887.7
2017	May	1,164.6	492.3	440.8	2,097.8
2017	Jun	1,373.0	348.9	459.9	2,181.8
2017	Jul	1,391.9	354.1	448.2	2,194.2
2017	Aug	1,438.3	309.9	451.8	2,200.0
2017	Sep	1,419.2	346.8	442.1	2,208.1
2017		1,171.6	440.5	424.0	2,036.2

Table 10-6 provides the average monthly reserves, by type, uses to satisfy the primary reserve requirement in the RTO zone from January 1, 2016, through September 30, 2017.

Table 10-6 Average monthly reserves used to satisfy the primary reserve requirement, RTO Zone: January 1, 2016 through September 30, 2017

Year	Month	Tier 1 Total MW	Tier 2 Synchronized Reserve MW	Nonsynchronized Reserve MW	Total Primary Reserve MW
2016	Jan	1,659.4	374.5	319.1	2,353.0
2016	Feb	1,564.1	411.4	329.4	2,304.9
2016	Mar	1,089.1	818.1	300.0	2,207.2
2016	Apr	1,011.7	878.3	318.0	2,207.9
2016	May	1,160.9	722.6	349.5	2,233.0
2016	Jun	1,546.0	497.1	384.2	2,427.3
2016	Jul	1,663.8	360.1	634.0	2,657.9
2016	Aug	1,605.6	419.0	682.4	2,707.0
2016	Sep	1,290.4	578.6	617.5	2,486.5
2016	Oct	802.7	982.4	524.0	2,309.1
2016	Nov	810.8	1,014.1	375.4	2,200.4
2016	Dec	953.1	807.3	533.0	2,293.4
2016		1,263.1	655.3	447.2	2,365.6
2017	Jan	1,020.4	915.5	372.3	2,308.2
2017	Feb	1,172.0	686.0	395.1	2,253.2
2017	Mar	654.2	1,128.9	420.9	2,204.0
2017	Apr	805.1	959.2	452.2	2,216.5
2017	May	924.1	879.4	454.0	2,257.5
2017	Jun	1,413.5	644.7	474.9	2,533.0
2017	Jul	1,540.1	676.1	459.5	2,675.7
2017	Aug	1,512.8	610.2	466.9	2,589.9
2017	Sep	1,368.9	620.2	453.2	2,442.3
2017		1,156.8	791.1	438.8	2,386.7

Supply and Demand

The market solution software relevant to reserves consists of: the Ancillary Services Optimizer (ASO) solving hourly; the intermediate term security constrained economic dispatch market solution (IT-SCED); and the real-time (short term) security constrained economic dispatch market solution (RT-SCED).


The ASO jointly optimizes energy, synchronized reserves, and nonsynchronized reserves based on forecast system conditions to determine the most economic set of reserve resources to commit for the upcoming operating hour. IT-SCED runs at 15 minute intervals and jointly optimizes energy and reserves given the ASO's inflexible unit commitments. IT-SCED estimates available tier 1 synchronized reserve and can commit additional reserves (flexibly or inflexibly) if needed. RT-SCED runs at five minute intervals and produces load forecasts up to 20 minutes ahead. The RT-SCED estimates the available tier 1, provides a real-time ancillary services solution and can commit additional tier 2 resources (flexibly or inflexibly) if needed.

Figure 10-2 illustrates how the ASO satisfies the primary reserve requirement (orange line) for the Mid-Atlantic Dominion Subzone. For the Mid-Atlantic Dominion Reserve Zone primary reserve solution the ASO must first satisfy the synchronized reserve requirement (yellow line) which is calculated hourly in the MAD Subzone. The ASO first estimates how much tier 1 synchronized reserve (green area) is available. If there is enough tier 1 MW available to satisfy the synchronized reserve requirement, then ASO jointly optimizes synchronized reserve and nonsynchronized reserve to assign the remaining primary reserve up to the primary reserve requirement. If there is not enough tier 1 synchronized reserve then the remaining synchronized reserve requirement up to the synchronized reserve is filled with tier 2 synchronized reserve (dark blue area). After synchronized reserve is assigned, the primary reserve requirement is filled by jointly optimizing synchronized reserve and nonsynchronized reserve (light blue area). Since nonsynchronized reserve is priced lower than or equal to synchronized reserve, almost all primary reserve above the synchronized reserve requirement is filled by nonsynchronized reserve.

There is a serious shortcoming with the ASO market solution based on the rule that tier 1 synchronized reserve will be paid the tier 2 synchronized reserve market clearing price whenever the nonsynchronized reserve market clearing price is above \$0. The ancillary services market solution treats the cost of estimated tier 1 synchronized reserve as \$0, even when the nonsynchronized

reserve market clearing price is above \$0. As a result, the optimization cannot minimize the total cost of primary reserves.

Figure 10-2 Mid-Atlantic Dominion Subzone primary reserve MW by source (Daily Averages): January through September, 2017

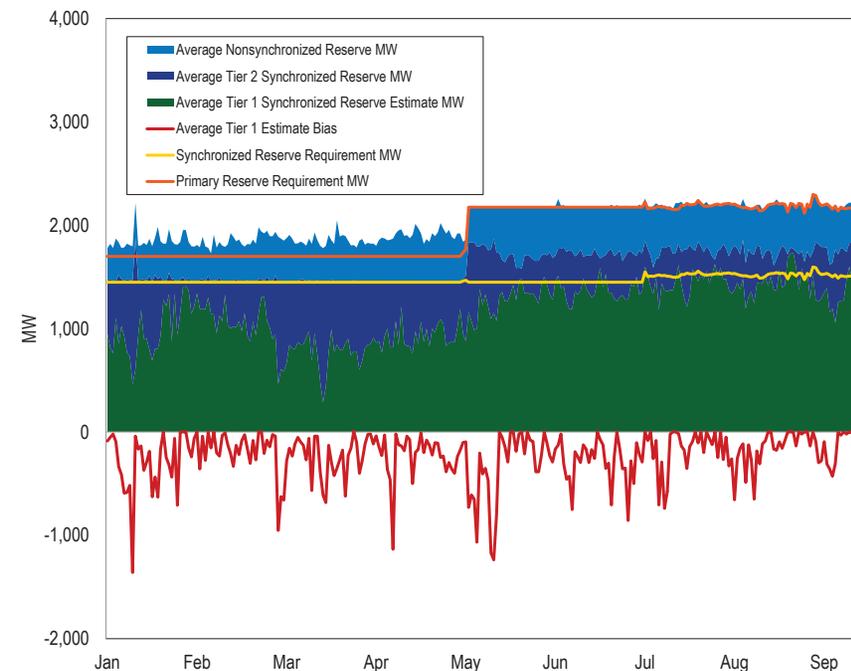

The solution method is the same for the RTO Reserve Zone.¹⁷ Figure 10-3 shows how the hour ahead ASO satisfies the primary reserve requirement for the RTO Zone.

¹⁷ Although tier 1 has a price of zero, changes made with shortage pricing on November 1, 2012, have given tier 1 a very high cost in some hours. This high cost raises questions about the economics of the solution method used by the ASO, IT-SCED, and RT-SCED market solutions which assume zero cost.

Figure 10-3 RTO Reserve Zone primary reserve MW by source (Daily Averages): January through September, 2017


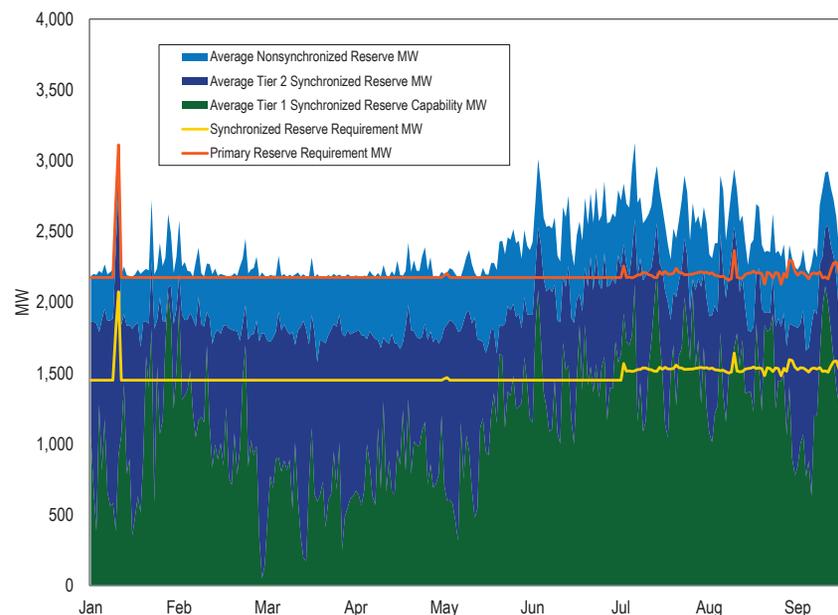


Figure 10-2 and Figure 10-3 show that tier 1 synchronized reserve remains the major contributor to satisfying the synchronized reserve requirements both in the RTO Zone and the Mid-Atlantic Dominion (MAD) Subzone.

Price and Cost

Figure 10-4 shows daily average synchronized and nonsynchronized market clearing prices in the first nine months of 2017.

Figure 10-4 Daily weighted average market clearing prices (\$/MW) for synchronized reserve and nonsynchronized reserve: January through September, 2017

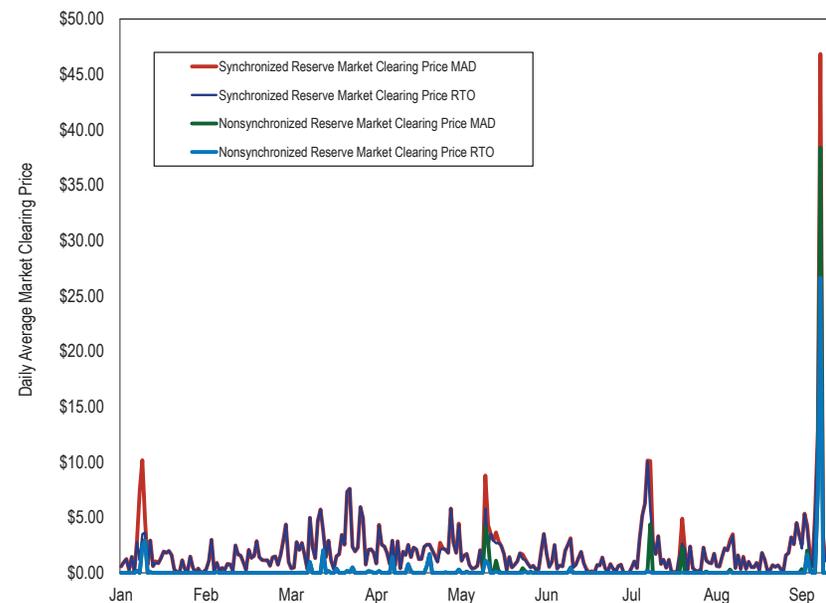

PJM's primary reserves are made up of three components, tier 1 synchronized reserve, tier 2 synchronized reserve, and nonsynchronized reserve, each with its own price and cost determinants and interdependent scheduling algorithms. The overall price and cost for meeting the BAL-002-1 primary reserve requirement is calculated by combining the three components (Table 10-7). The "Cost per MW" column is the total credits divided by the total MW of reserves.

On a combined basis, the ratio of price to cost for all primary reserve during the first nine months of 2017 is low at 33.4 percent. This is partly a result of the unnecessary payment of the tier 2 price to tier 1 resources, and partly a result of the poor price to cost ratio of nonsynchronized reserves. While tier 1 has zero actual incremental cost, estimated tier 1 is paid the tier 2 clearing price in any hour where nonsynchronized reserves clears at a non-zero price. Table 10-7 shows that the cost of tier 1 reserves is \$18.97 per MW when the price of nonsynchronized reserve is greater than zero and more than twice the cost of tier 2 reserves which is \$8.32 per MW.

Table 10-7 MW credited, price, cost, and all-in price for primary reserve and its component products, RTO Reserve Zone: January through September, 2017

Product	MW Share of Primary Reserve Requirement	MW	Credits Paid	Price Per MW Reserve	Cost Per MW Reserve
Tier 1 Synchronized Reserve Response	NA	5,063	\$461,439	NA	\$91.13
Tier 1 Synchronized Reserve Estimated	1.0%	105,195	\$1,995,133	\$0.00	\$18.97
Tier 2 Synchronized Reserve Scheduled	35.0%	3,569,981	\$29,709,256	\$3.14	\$8.32
Nonsynchronized Reserve Scheduled	63.9%	6,507,984	\$4,758,140	\$0.17	\$0.73
Primary Reserve (total of above)	100.0%	10,188,223	\$36,923,968	\$1.21	\$3.62

Tier 1 Synchronized Reserve

Tier 1 synchronized reserve is a component of primary reserve comprised of all online resources following economic dispatch and able to ramp up from their current output in response to a synchronized reserve event. The tier 1 synchronized reserve for a unit is measured as the lower of the available 10 minute ramp and the difference between the economic dispatch point and the economic maximum output. Tier 1 resources are identified by the market solution. The sum of their 10 minute availability equals available tier 1 synchronized reserve. Tier 1 synchronized reserve is the first element of primary reserve identified by the market software and has an incremental cost of zero. Tier 1 reserves are paid to respond to a synchronized reserve event. Tier 1 reserves are paid a clearing price whenever the nonsynchronized reserve market clearing price is above \$0, regardless of their actual response.

While PJM relies on tier 1 resources to respond to a synchronized reserve event, tier 1 resources are not obligated to respond during an event. Tier 1 resources are credited if they do respond but are not penalized if they do not.

Market Structure

Supply

All generating resources operating on the PJM system with the exception of those assigned to tier 2 synchronized reserve are available for tier 1 synchronized reserve and any response to a spinning event will be credited at the Synchronized Energy Premium Price.

The process for estimating tier 1 synchronized reserve has been refined. Beginning January 2015, DGP (Degree of Generator Performance) was introduced as a metric to improve the accuracy of the tier 1 MW estimate used by the market solution. DGP is calculated for all online resources for each market solution. DGP measures how closely the unit has been following economic dispatch for the past 30 minutes.¹⁸

The available tier 1 MW estimated by the market solution for each resource is based upon its economic dispatch, and energy schedule ramp rate or submitted synchronized reserve ramp rate, adjusted by its DGP. PJM communicates to generation operators whose tier 1 MW is part of the market solution the latest estimate of units' tier 1 MW and units' current DGP.¹⁹

In the first nine months of 2017, PJM estimated tier 1 MW for an average of 146 units as part of the market solution each hour for which the average DGP was 88.8 percent.

The supply of tier 1 synchronized reserve available to the market solution is further adjusted by eliminating tier 1 MW from units that cannot reliably provide synchronized reserve. These units are nuclear, wind, solar, energy storage, and hydro units.²⁰ These units will be credited the synchronized energy premium price, like any other responding unit, if they respond to a

¹⁸ See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 80 (July 27, 2017) at 85.

¹⁹ PJM, Ancillary Services, "Communication of Synchronized Reserve Quantities to Resource Owners," <<http://www.pjm.com/~media/markets-ops/ancillary/communication-of-synchronized-reserve-quantities-to-resource-owners.ashx>> (May 6, 2015).

²⁰ See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 83.

spinning event. These units will not, however, be paid as tier 1 resources when the nonsynchronized reserve market clearing price goes above \$0.

In the first nine months of 2017, in the RTO Reserve Zone, the average hourly estimated tier 1 synchronized reserve was 1,156.6 MW (Table 10-8). In 48.7 percent of hours, the estimated tier 1 synchronized reserve was greater than the synchronized reserve requirement, meaning that the synchronized reserve requirement was met entirely by tier 1 synchronized reserve.

In the first nine months of 2017, in the MAD Reserve Subzone, the average hourly estimated tier 1 synchronized reserve was 491.5 MW in the MAD subzone and 665.1 MW were available from the RTO (Table 10-8). In 5.3 percent of hours, the estimated tier 1 synchronized reserve available in MAD was greater than the synchronized reserve requirement, meaning that the synchronized reserve requirement was met entirely by tier 1 synchronized reserve.

Table 10-8 Monthly average market solution tier 1 synchronized reserve (MW) identified hourly: January 1, 2016 through September 30, 2017

Year	Month	Average Hourly Tier		Average Hourly Tier	
		1 Local To MAD	Tier 1 Synchronized Reserve From RTO Zone	1 Used in MAD	1 Used in RTO Zone
2016	Jan	586.1	659.3	1,245.4	1,659.4
2016	Feb	609.3	635.9	1,245.2	1,564.1
2016	Mar	402.4	660.7	1,063.0	1,089.1
2016	Apr	341.7	620.2	961.9	1,011.7
2016	May	408.2	613.9	1,022.1	1,160.9
2016	Jun	638.4	504.0	1,142.5	1,546.0
2016	Jul	756.7	513.5	1,270.2	1,663.8
2016	Aug	750.5	495.2	1,245.7	1,605.6
2016	Sep	658.9	566.8	1,225.7	1,290.4
2016	Oct	393.6	723.9	1,117.5	802.7
2016	Nov	385.2	478.6	863.8	810.8
2016	Dec	660.4	419.8	1,080.2	953.1
2016		549.3	574.3	1,123.6	1,263.1
2017	Jan	530.0	450.9	980.9	1,019.5
2017	Feb	528.0	586.6	1,114.6	1,177.0
2017	Mar	292.4	475.0	767.4	654.3
2017	Apr	288.8	607.5	896.3	805.5
2017	May	384.5	777.2	1,161.7	920.1
2017	Jun	558.4	813.7	1,372.1	1,411.9
2017	Jul	695.2	695.9	1,391.1	1,541.4
2017	Aug	582.9	856.4	1,439.3	1,513.2
2017	Sep	564.5	854.7	1,419.2	1,368.7
2017		491.6	679.8	1,171.4	1,156.8

Demand

There is no required amount of tier 1 synchronized reserve.


The ancillary services market solution treats the cost of estimated tier 1 synchronized reserve as \$0, even when the nonsynchronized reserve market clearing price is above \$0. As a result, the optimization cannot minimize the total cost of primary reserves.

Supply and Demand

When solving for the synchronized reserve requirement the market solution first subtracts the amount of self scheduled synchronized reserve from the requirement and then estimates the amount of tier 1.

In the MAD Subzone, the market solution takes all tier 1 MW estimated to be available within the MAD Subzone (gray area of Figure 10-5). It then adds the tier 1 MW estimated to be available within the MAD Subzone from the RTO Zone (green area of Figure 10-5) up to the synchronized reserve requirement. If the total tier 1 synchronized reserve is less than the synchronized reserve requirement, the remainder of the synchronized reserve requirement is filled with tier 2 synchronized reserve (white area below the synchronized reserve required line in Figure 10-5).

Figure 10-5 Daily average tier 1 synchronized reserve supply (MW) in the MAD Subzone: January through September, 2017

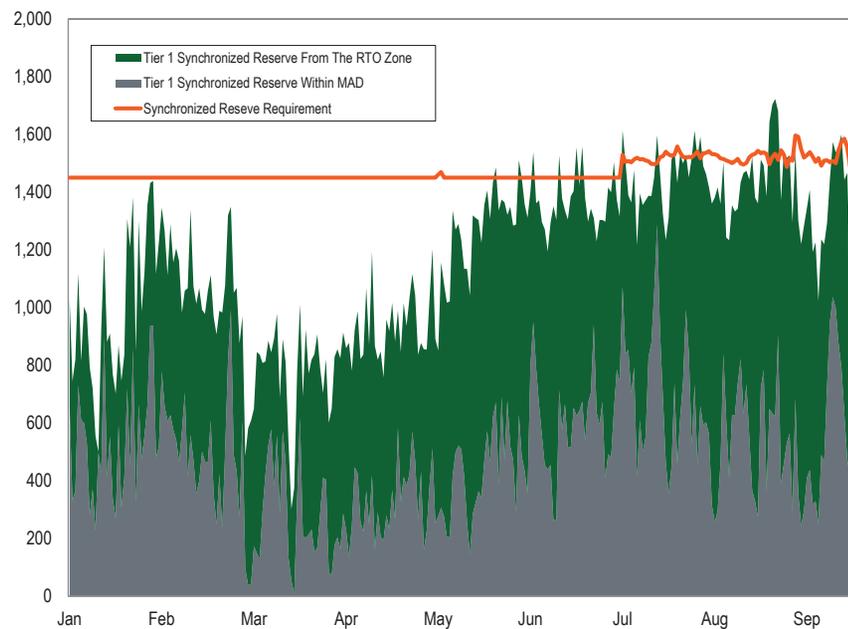

Average demand for synchronized reserve in the RTO Zone in the first nine months of 2017 was 1,471.8 MW. There was a temporary increase in the hourly synchronized reserve requirement to 2,200 MW on January 10 and 11, to 1,658 MW for two hours on May 8, and to 1,680 MW for three hours on May 9, 2017.

Tier 1 Synchronized Reserve Event Response

Tier 1 synchronized reserve is awarded credits when a synchronized reserve event occurs and it responds. These synchronized reserve event response credits for tier 1 response are independent of the tier 1 estimated, independent of the synchronized reserve market clearing price, and independent of the nonsynchronized reserve market clearing price. Credits are awarded to tier 1 synchronized reserve resources equal to the increase in MW output (or decrease in MW consumption for demand resources) for each five minute interval times the five minute LMP plus \$50 per MW. During a synchronized reserve event, tier 1 credits are awarded to all units that increase their output during the event regardless of their estimated tier 1 MW, or tier 1 deselection status at market clearing time, unless the units have cleared the tier 2 market.

In the first nine months of 2017, tier 1 synchronized reserve event response credits of \$461,439 were paid for 5,063.4 MWh of tier 1 response at an average cost per MWh of \$91.13, for 19 spinning event hours (Table 10-9).

Table 10-9 Tier 1 synchronized reserve event response costs: January 1, 2016 through September 30, 2017

Year	Month	Total Synchronized Reserve Event Response Hour Count	Total Credited Tier 1 Synchronized Reserve Event Response MWh	Total Tier 1 Synchronized Reserve Event Response Credits	Tier 1 Synchronized Reserve Event Response Cost Per MWh	Average Tier 1 MWh Response
2016	Jan	2	731.1	\$70,330	\$96.24	365.4
2016	Feb	2	675.0	\$40,622	\$60.18	337.5
2016	Mar	0	0.0	\$0	\$0.00	0.0
2016	Apr	1	339.0	\$66,199	\$195.27	339.0
2016	May	2	113.4	\$9,790	\$86.35	56.7
2016	Jun	1	206.9	\$11,129	\$53.78	206.9
2016	Jul	3	714.3	\$58,114	\$81.36	357.1
2016	Aug	1	334.5	\$13,026	\$38.95	334.5
2016	Sep	2	452.4	\$34,824	\$76.97	226.2
2016	Oct	2	281.1	\$24,130	\$85.85	140.5
2016	Nov	1	204.3	\$10,910	\$53.41	204.3
2016	Dec	1	256.8	\$14,766	\$57.50	256.8
2016		18	4,308.8	\$353,840	\$76.57	235.4
2017	Jan	6	1,250.2	\$60,447	\$48.35	208.4
2017	Feb	3	624.1	\$55,705	\$89.26	208.0
2017	Mar	2	757.9	\$55,300	\$72.96	379.0
2017	Apr	2	297.2	\$16,955	\$57.05	148.6
2017	May	1	405.6	\$21,848	\$53.87	405.6
2017	Jun	2	624.8	\$29,228	\$46.78	312.4
2017	Sep	3	1,103.7	\$221,957	\$201.10	367.9
2017		19	5,063.4	\$461,439	\$91.13	290.0

Paying Tier 1 the Tier 2 Price

Tier 1 synchronized reserve has zero marginal cost and the corresponding price for tier 1 synchronized reserves is also zero. However, the PJM rules artificially create a marginal cost of tier 1 when the price of nonsynchronized reserve is greater than zero and tier 1 is paid the tier 2 price. But the PJM market solutions do not include that marginal cost and therefore do not solve for the efficient level of tier 1, tier 2 and nonsynchronized reserve in those cases. When called to respond to a spinning event tier 1 is compensated at the Synchronized Energy Premium Price (Table 10-12). However, the shortage pricing tariff changes (October 1, 2012) modified the pricing of tier 1 so that tier 1 synchronized reserve is paid the tier 2 synchronized reserve market

clearing price whenever the nonsynchronized reserve market clearing price rises above zero. The rationale for this change was and is unclear, but it has had a significant impact on the cost of tier 1 synchronized reserves. The nonsynchronized reserve market clearing price was above \$0.00 in 151 hours in the first nine months of 2017. For those 151 hours, tier 1 synchronized reserve resources were paid a weighted average synchronized reserve market clearing price of \$16.90 per MW and earned \$1,995,133 in credits. In 2016, PJM paid \$4,948,084 in credits for tier 1 estimated during the 297 hours when the nonsynchronized reserve market clearing price was above \$0.

Table 10-10 Weighted price of tier 1 synchronized reserve attributable to a nonsynchronized reserve price above zero: January 1, 2016 through September 30, 2017

Year	Month	Total Hours When NSRMCP>\$0	Weighted Average SRMCP for Hours When NSRMCP>\$0	Total Tier 1 MW Credited for Hours When NSRMCP>\$0	Total Tier 1 Credits Paid When NSRMCP>\$0	Average Tier 1 MW Paid
2016	Jan	41	\$14.18	56,841	\$806,038	1,624.0
2016	Feb	16	\$9.42	24,752	\$233,208	1,768.0
2016	Mar	73	\$6.57	105,142	\$690,294	1,440.3
2016	Apr	40	\$28.83	38,662	\$1,114,670	1,137.1
2016	May	22	\$9.01	27,027	\$243,515	1,228.5
2016	Jun	9	\$15.24	11,630	\$177,275	1,453.8
2016	Jul	10	\$21.38	13,975	\$298,736	1,397.5
2016	Aug	14	\$32.45	19,649	\$637,554	1,403.6
2016	Sep	9	\$26.22	11,247	\$294,857	1,249.7
2016	Oct	50	\$12.12	33,761	\$409,208	675.2
2016	Nov	12	\$3.04	13,867	\$42,216	1,155.6
2016	Dec	1	\$0.58	888	\$515	888.2
2016		297	\$13.84	357,442	\$4,948,084	1,285.1
2017	Jan	26	\$11.38	19,441	\$221,157	747.7
2017	Feb	1	\$12.35	1,293	\$15,971	1,293.2
2017	Mar	14	\$14.27	13,389	\$191,084	956.4
2017	Apr	16	\$9.82	11,680	\$114,662	730.0
2017	May	30	\$10.61	20,242	\$214,816	674.7
2017	Jun	13	\$4.96	7,563	\$37,542	581.8
2017	Jul	10	\$29.58	6,631	\$196,128	663.1
2017	Aug	6	\$14.04	3,926	\$55,108	654.4
2017	Sep	35	\$45.11	21,030	\$948,664	600.9
2017		151	\$16.90	105,195	\$1,995,133	766.9

The additional payments to tier 1 synchronized reserves under the shortage pricing rule are a windfall. The additional payment does not create an incentive to provide more tier 1 synchronized reserves. The additional payment is not a payment for performance; all estimated tier 1 receives the higher payment regardless of whether they provide any response during any spinning event. Tier 1 resources are not obligated to respond to synchronized reserve events. In the first nine months of 2017, 60.1 percent of the DGP adjusted market solution's estimated tier 1 resources MW actually responded during synchronized reserve events of 10 minutes or longer. Thus, 39.9 percent of DGP adjusted tier 1 estimated MW did not respond during spinning events. However, all resources that were included in the Tier 1 estimates were paid the Tier 2 price for their full estimated MW when the nonsynchronized reserve (NSR) price was greater than zero. Unlike tier 1 resources, tier 2 synchronized reserve resources are paid the market clearing price for tier 2 because they stand ready to respond and incur costs to do so, have an obligation to perform and pay penalties for nonperformance.

When the next MW of nonsynchronized reserve required to satisfy the primary reserve requirement increases in price from \$0.00 per MW to \$0.01 per MW, the cost of all tier 1 MW increases significantly.

In the first nine months of 2017, tier 1 synchronized reserve was paid \$458,674 for responding to synchronized reserve events. During the same time period tier 1 synchronized reserve was paid a windfall of \$1,995,133 simply because the NSRMCP was greater than \$0.00 in 151 hours (Table 10-11).

Table 10-11 Excess payments for tier 1 synchronized reserve: January 1, 2016 through September 30, 2017

Year	Month	Synchronized Reserve Events			Hours When NSRMCP > \$0		
		Total MWh	Total Credits	Average MWh Per Event	Total MW	Total Credits	Average MW Per Hour
2016	Jan	754	\$70,330	366	56,841	\$806,038	1,624.0
2016	Feb	675	\$40,622	338	24,752	\$233,208	1,768.0
2016	Mar	0	\$0	0	105,142	\$690,294	1,440.3
2016	Apr	339	\$66,199	339	38,662	\$1,114,670	1,137.1
2016	May	113	\$9,790	57	27,028	\$243,515	1,228.5
2016	Jun	207	\$11,129	207	11,630	\$177,275	1,453.8
2016	Jul	714	\$58,114	238	13,975	\$298,736	1,397.5
2016	Aug	334	\$13,026	334	19,650	\$637,554	1,403.6
2016	Sep	452	\$34,824	226	11,247	\$294,857	1,249.7
2016	Oct	141	\$24,130	141	33,761	\$409,208	675.2
2016	Nov	204	\$10,910	204	13,867	\$42,216	1,155.6
2016	Dec	695	\$43,512	347	888	\$515	888.2
2016		4,629	\$382,585	233	357,442	\$4,948,084	1,285.1
2017	Jan	1,250	\$60,447	208	19,441	\$221,157	1,143.6
2017	Feb	624	\$55,705	208	1,293	\$15,971	1,293.2
2017	Mar	758	\$55,300	379	13,389	\$191,084	956.4
2017	Apr	297	\$16,955	149	11,680	\$114,662	730.0
2017	May	406	\$21,848	406	20,242	\$214,816	1,065.4
2017	Jun	625	\$29,228	312	7,563	\$37,542	945.4
2017	Jul	0	\$0	NA	6,631	\$196,128	663.1
2017	Aug	0	\$0	NA	3,926	\$55,108	654.4
2017	Sep	1,104	\$221,957	368	21,030	\$948,664	600.9
2017		5,064	\$461,439	290	105,195	\$1,995,133	894.7

The MMU recommends that the rule requiring the payment of tier 1 synchronized reserve resources when the nonsynchronized reserve price is above zero be eliminated immediately.²¹ Tier 1 should be compensated only for a response to synchronized reserve events, as it was before the shortage pricing changes. This compensation requires that when a synchronized reserve event is called, all tier 1 response is paid the average of five-minute LMPs during the event, rather than hourly integrated LMP, plus \$50/MW, termed the Synchronized Energy Premium Price.

²¹ This recommendation was presented as a proposal, "Tier 1 Compensation," to the Markets and Reliability Committee Meeting, October 22, 2015. The MMU proposal and a PJM counterproposal were both rejected.

PJM's current tier 1 compensation rules are presented in Table 10-12.

Table 10-12 Tier 1 compensation as currently implemented by PJM

Tier 1 Compensation by Type of Hour as Currently Implemented by PJM		
Hourly Parameters	No Synchronized Reserve Event	Synchronized Reserve Event
NSRMCP=\$0	T1 credits = \$0	T1 credits = Synchronized Energy Premium Price * actual response MWh
NSRMCP>\$0	T1 credits = T2 SRMCP * estimated tier 1 MW	T1 credits = T2 SRMCP * min(calculated tier 1 MW, actual response MWh)

The MMU's recommended compensation rules for tier 1 MW are in Table 10-13.

Table 10-13 Tier 1 compensation as recommended by MMU

Tier 1 Compensation by Type of Hour as Recommended by MMU		
Hourly Parameters	No Synchronized Reserve Event	Synchronized Reserve Event
NSRMCP=\$0	T1 credits = \$0	T1 credits = Synchronized Energy Premium Price * actual response MWh
NSRMCP>\$0	T1 credits = \$0	T1 credits = Synchronized Energy Premium Price * actual response MWh

Tier 1 Estimate Bias

PJM's market solution software allows the dispatcher to bias the tier 2 synchronized reserve solution by forcing the software to assume a different tier 1 MW value than it actually estimates. PJM no longer allows dispatchers to use tier 1 biasing in the intermediate and real-time SCED solutions, but tier 1 biasing is used in the hour ahead reserve market solution, ASO. Biasing means manually modifying (decreasing or increasing) the tier 1 synchronized reserve estimate of the market solution. This forces the market clearing engine to clear more or less tier 2 synchronized reserve and nonsynchronized reserve to satisfy the synchronized reserve and primary reserve requirements than would have cleared under the market solution. Negative biasing is the primary form of biasing actually used.

PJM uses tier 1 estimate biasing in the MAD Subzone and in the full RTO Zone of the ASO market solution (Table 10-14).

Table 10-14 RTO Zone ASO tier 1 estimate biasing: January 2016 through September 2017

Year	Month	Number of Hours Biased Negatively	Average Negative Bias (MW)	Number of Hours Biased Positively	Average Positive Bias (MW)
2016	Jan	21	(682.7)	64	1,104.7
2016	Feb	27	(484.3)	12	762.5
2016	Mar	1	(400.0)	28	732.1
2016	Apr	31	(303.2)	22	502.1
2016	May	19	(452.4)	21	335.7
2016	Jun	46	(502.1)	3	500.0
2016	Jul	53	(532.1)	1	250.0
2016	Aug	134	(687.1)	1	1,000.0
2016	Sep	105	(864.7)	0	NA
2016	Oct	77	(729.9)	0	NA
2016	Nov	139	(877.0)	1	100.0
2016	Dec	262	(1,420.4)	0	NA
2016		915	(661.3)	153	648.4
2017	Jan	332	(987.7)	4	362.5
2017	Feb	194	(719.7)	0	NA
2017	Mar	354	(760.5)	3	200.0
2017	Apr	227	(697.1)	0	NA
2017	May	301	(1,000.3)	13	207.7
2017	Jun	253	(873.5)	0	NA
2017	Jul	244	(938.1)	0	NA
2017	Aug	179	(805.3)	2	1,250.0
2017	Sep	144	(682.6)	0	NA
2017		2228	(829.4)	22	256.7

Tier 1 biasing is not mentioned in the PJM manuals and does not appear to be defined in any public document. PJM dispatchers use tier 1 biasing to compensate for uncertainty in short-term load forecasting and uncertainty about expected generator performance, which result in uncertainty about the accuracy of the market solution's tier 1 estimate. The purpose of Tier 1 estimate biasing is to modify the demand for tier 2 and therefore the market results both for tier 2 synchronized reserve and for nonsynchronized reserve. Biasing the tier 1 estimate forces the market solution to clear more or less tier 2 and thus affects the price for tier 2 reserves. The average SRMCP in the MAD Subzone for hours when tier 1 is biased negatively is \$2.43 and \$2.14 when tier 1 is biased positively. The average SRMCP when there is no tier 1 bias is \$1.80.

The MMU recommends that PJM be more explicit and transparent about why tier 1 biasing is used in defining demand in the Tier 2 Synchronized Reserve Market. The MMU recommends that PJM define rules for estimating tier 1 MW, define rules for the use and amount of tier 1 biasing and identify the rule based reasons for each instance of biasing.

Tier 2 Synchronized Reserve Market

Synchronized reserve is provided by generators or demand response resources synchronized to the grid and capable of increasing output or decreasing load within 10 minutes. Synchronized reserve consists of tier 1 and tier 2 synchronized reserves. When the synchronized reserve requirement cannot be met by tier 1 synchronized reserve, PJM clears a market to satisfy the requirement with tier 2 synchronized reserve. Tier 2 synchronized reserve is provided by online resources, either synchronized to the grid but not producing energy, or dispatched to provide synchronized reserve at an operating point below their economic dispatch point. Tier 2 synchronized reserve is also provided by demand resources that have offered to reduce load in the event of a synchronized reserve event. Tier 2 synchronized reserves are committed to be available in the event of a synchronized reserve event. Tier 2 resources have a must offer requirement. Tier 2 resources are scheduled by the ASO sixty minutes before the operating hour, are committed to provide synchronized reserve for the entire hour, and are paid the higher of the SRMCP or their offer price plus lost opportunity cost (LOC). Demand response resources are paid the clearing price (SRMCP).

Tier 2 synchronized reserve resources committed for a full hour by the hour ahead market solution are defined to be inflexible resources. Inflexible resources cannot be released for energy during the operating hour. Tier 2 synchronized reserve resources may also be inflexible because of asserted physical limitations. Such resources include synchronous condensers operating solely for the purpose of providing synchronized reserves and demand resources. Demand side resources are also considered to be inflexible.

During the operating hour, the IT-SCED and the RT-SCED market solutions software can dispatch additional resources flexibly. A flexible commitment is one in which the IT-SCED or RT-SCED redispatches tier 1 generating resources as tier 2 synchronized reserve to meet the synchronized and primary reserve requirements within the operational hour. Resources that are redispatched as tier 2 within the hour are required to maintain their available ramp and are paid the SRMCP plus any lost opportunity costs or energy use costs that exceed the SRMCP.

Market Structure

Supply

PJM has a must offer tier 2 synchronized reserve requirement. All nonemergency generating resources are required to submit tier 2 synchronized reserve offers. All online, nonemergency generating resources are deemed available to provide both tier 1 and tier 2 synchronized reserve although certain unit types are exempt. If PJM issues a primary reserve warning, voltage reduction warning, or manual load dump warning, all offline emergency generation capacity resources available to provide energy must submit an offer for tier 2 synchronized reserve.²²

In the first nine months of 2017, the Mid Atlantic Dominion (MAD) Reserve Subzone averaged 6,513.7 MW of tier 2 synchronized reserve offers, and the RTO Reserve Zone averaged 24,010.7 MW of tier 2 synchronized reserve offers (Figure 10-11).

The supply of tier 2 synchronized reserve in the first nine months of 2017 was sufficient to cover the ASO hourly requirement net of tier 1 in both the RTO Reserve Zone and the MAD Reserve Subzone. The supply of tier 2 synchronized reserve was short in two 5 minute intervals in the RTO Zone during a spinning event on September 21.

The largest portion of cleared tier 2 synchronized reserve in the first nine months of 2017 was from CTs, 65.5 percent (Figure 10-6). Although demand resources are limited to 33 percent of the total synchronized reserve

²² See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 84.

requirement, the amount of tier 2 synchronized reserve required in any hour is often much less than the full synchronized reserve requirement because so much of it is met with tier 1 synchronized reserve. This means that in many hours demand resources make up considerably more than 33 percent of the cleared Tier 2 MW. The DR MW share of the total cleared Tier 2 Synchronized Reserve Market was 8.8 percent in 2016.²³ The DR MW share of the total cleared Tier 2 Synchronized Reserve Market in the first nine months of 2017 was 23.2 percent.

Figure 10-6 Cleared tier 2 synchronized reserve average hourly MW per hour by unit type, RTO Zone: January 1, 2016 through September 30, 2017


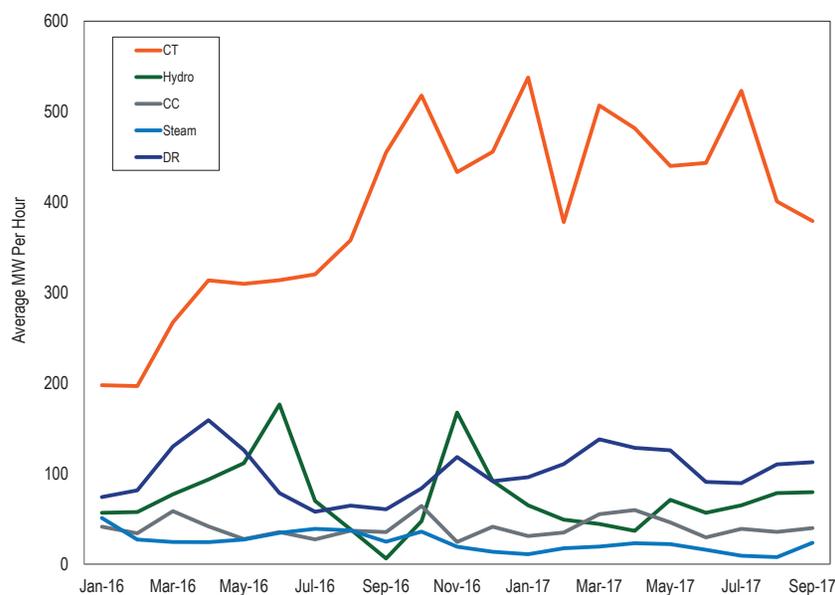


Figure 10-7 provides the average hourly cleared tier 2 MW by unit type by tier 2 clearing price range (SRMCP).

²³ The cap on demand response participation is defined in MW terms. There is no cap on the proportion of cleared demand response consistent with the MW cap.

Figure 10-7 Average hourly tier 2 MW by unit type by SRMCP range: January through September, 2017

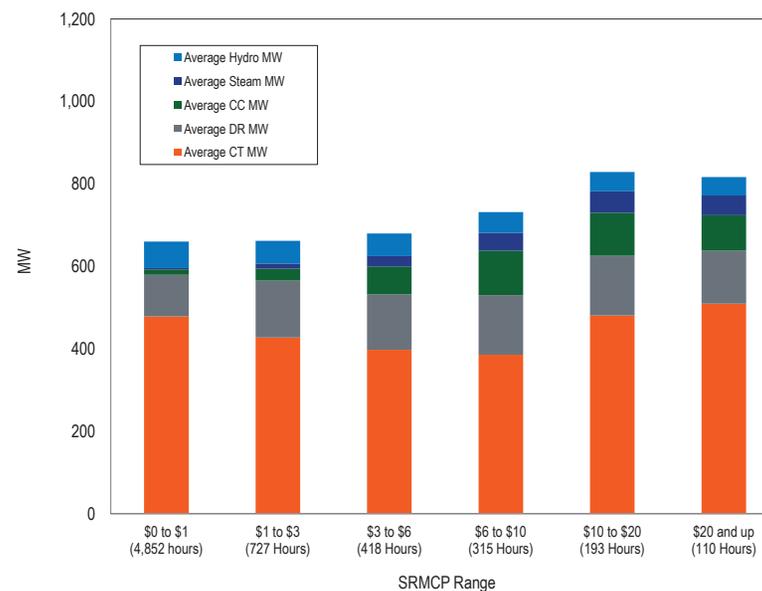

Demand

Until July 12, 2017 the default synchronized reserve requirement was set to 1,450 MW in both the Mid-Atlantic Dominion Subzone and the RTO Zone (Table 10-15). On July 12, 2017, PJM adopted a dynamic reserve requirement set equal to 150 percent of the largest contingency, determined hourly, based on the forecasted dispatch. There are two circumstances in which PJM may alter the synchronized reserve requirement from its 150 percent of the largest contingency value. When PJM operators anticipate periods of heavy load, they may bring on additional units to account for increased operational uncertainty in meeting load. When a Hot Weather Alert, Cold Weather Alert or an escalating emergency procedure (as defined in Manual 11 § 4.2.2 Synchronized Reserve Requirement Determination) has been issued for the operating day, operators may increase the synchronized reserve requirement


up to the full amount of the additional MW brought on line.²⁴ The synchronized reserve requirement was temporarily increased for the RTO Zone on January 10 and January 11, 2017, for a 31 hour period to 2,200 MW. The synchronized reserve requirement was increased for a two hour period on May 10, 2017 to 1,680 MW. The synchronized reserve requirement was increased slightly from September 11, 2017 through September 22, 2017, for a temporary switching condition.

Table 10-15 Default Tier 2 Synchronized Reserve Markets required MW, RTO Zone and Mid-Atlantic Dominion Subzone

Mid-Atlantic Dominion Subzone			RTO Synchronized Reserve Zone		
From Date	To Date	Required MW	From Date	To Date	Required MW
May 10, 2008	May 8, 2010	1,150	May 10, 2008	Jan 1, 2009	1,305
May 8, 2010	Jul 13, 2010	1,200	Jan 1, 2009	Mar 15, 2010	1,320
July 13, 2010	Jan 1, 2015	1,300	Mar 15, 2010	Nov 12, 2012	1,350
Jan 1, 2015	Jan 8, 2015	1,342	Nov 12, 2012	Jan 8, 2015	1,375
Jan 8, 2015	Jul 11, 2017	1,450	Jan 8, 2015	Jul 11, 2017	1,450
Jul 12, 2017		Calculated Hourly	Jul 12, 2017		Calculated Hourly

PJM may also change the synchronized reserve requirement from its default value when grid maintenance or outages change the largest contingency. Figure 10-8 shows monthly average actual synchronized reserve requirements and the default synchronized reserve requirements.

Figure 10-8 Monthly average actual vs default synchronized reserve requirements, RTO Zone and MAD Subzone: January 2016 through September 2017

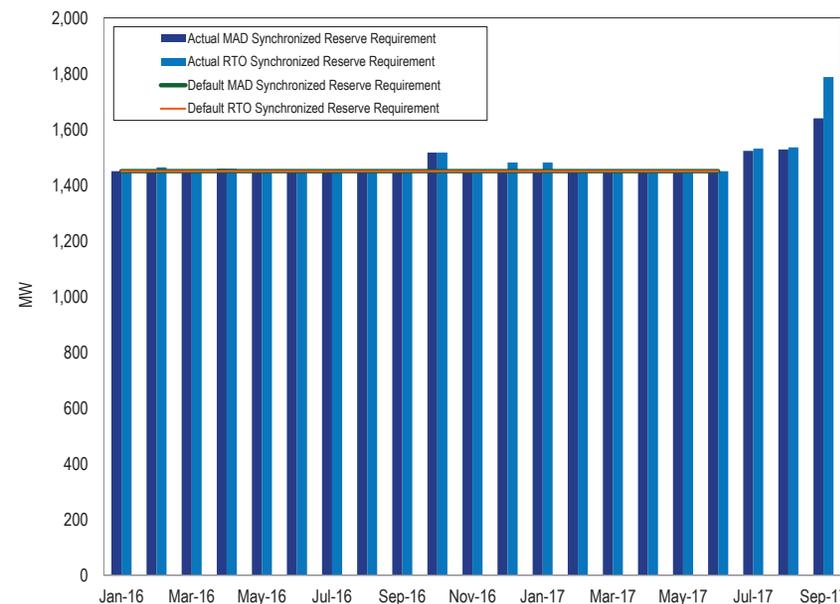

The RTO Reserve Zone purchased an hourly average of 1,147.6 MW of tier 2 synchronized reserves the first nine months of 2017. Of this, an average of 455.1 MW cleared within the MAD Subzone.

Figure 10-9 and Figure 10-10 show the average monthly synchronized reserve required and the average monthly tier 2 synchronized reserve MW scheduled (PJM scheduled plus self scheduled) from January 2016 through September 2017, for the RTO Reserve Zone and MAD Reserve Subzone. The shortage pricing on September 21, 2017, was the result of a nine-hour period of ACE control problems. PJM called a “low ACE” spinning event during hour 14. There were 11 intervals of step 1 primary reserve shortage (NSRMCP=\$300), and two intervals of step 2 synchronized reserve shortage (SRMCP=\$300). In

²⁴ PJM. "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 88.

three subsequent intervals the SRMCP reached \$768.59. The hourly SRMCP for September 21, hour 14 was \$465.30.²⁵

Figure 10-9 MAD monthly average tier 2 synchronized reserve scheduled MW: January 1, 2016 through September 30, 2017


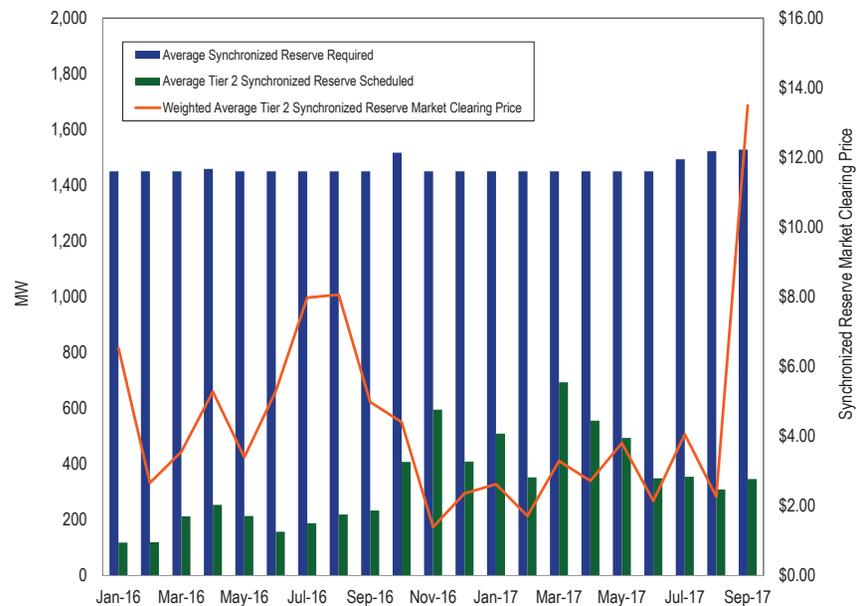


Figure 10-10 RTO monthly average tier 2 synchronized reserve scheduled MW: January 1, 2016 through September 30, 2017

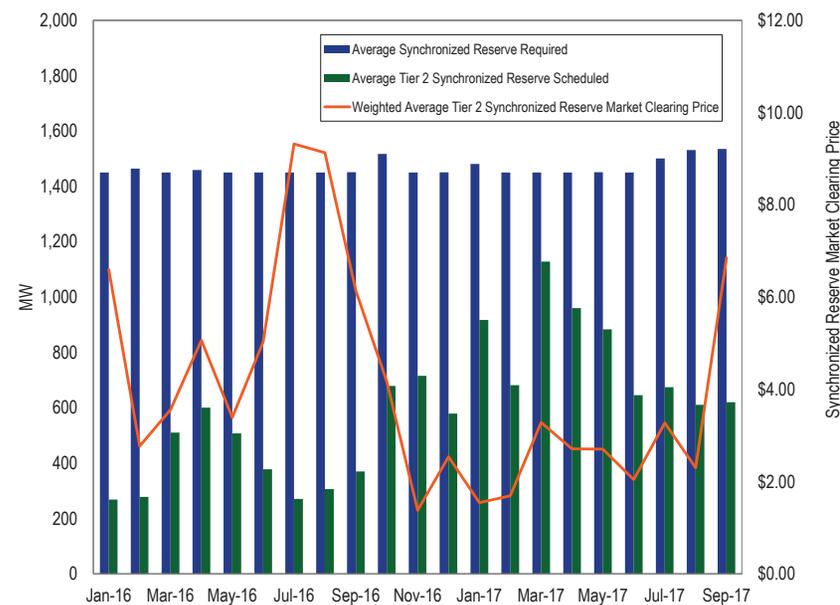

Market Concentration

The HHI for tier 2 synchronized reserve for cleared hours in the Mid-Atlantic Dominion Subzone Tier 2 Synchronized Reserve Market in the first nine months of 2017 was 5895, which is defined as highly concentrated. The largest hourly market share was 100 percent and 99.7 percent of all cleared hours had a maximum market share greater than or equal to 40 percent.

The HHI for tier 2 synchronized reserve for cleared hours of the RTO Zone Tier 2 Synchronized Reserve Market in the first nine months of 2017 was 6653, which is defined as highly concentrated. The largest hourly market share was 100 percent and 94.0 percent of cleared hours had a maximum market share greater than or equal to 40 percent.

²⁵ See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 86.

In the MAD Subzone, flexible synchronized reserve was 7.1 percent of all tier 2 synchronized reserve in the first nine months of 2017. In the RTO Zone, flexible synchronized reserve assigned was 10.5 percent of all tier 2 synchronized reserve during the same period.

The MMU calculates that 64.4 percent of hours would have failed the three pivotal supplier test in the MAD Subzone in the first nine months of 2017 for the inflexible Synchronized Reserve Market (excluding self scheduled synchronized reserve) in the hour ahead market (Table 10-16) and 63.9 percent of hours would have failed a three pivotal supplier test in the RTO Zone during the same time period.

Table 10-16 Three pivotal supplier test results for the RTO Zone and MAD Subzone: January 1, 2016 through September 30, 2017

Year	Month	Mid Atlantic Dominion Reserve Subzone	
		Pivotal Supplier Hours	RTO Reserve Zone Pivotal Supplier Hours
2016	Jan	82.7%	43.1%
2016	Feb	72.0%	39.6%
2016	Mar	93.4%	59.1%
2016	Apr	97.9%	55.6%
2016	May	94.2%	31.3%
2016	Jun	90.4%	27.4%
2016	Jul	79.4%	14.2%
2016	Aug	75.9%	14.4%
2016	Sep	84.3%	41.9%
2016	Oct	87.9%	80.9%
2016	Nov	96.0%	65.9%
2016	Dec	92.3%	69.8%
2016		87.2%	45.3%
<hr/>			
2017	Jan	79.3%	67.0%
2017	Feb	73.8%	57.6%
2017	Mar	72.6%	38.3%
2017	Apr	75.0%	51.0%
2017	May	70.9%	69.8%
2017	Jun	62.6%	84.9%
2017	Jul	57.3%	69.5%
2017	Aug	34.8%	71.0%
2017	Sep	53.7%	66.4%
2017		64.4%	63.9%

The market structure results indicate that the RTO Zone and Mid-Atlantic Dominion Subzone Tier 2 Synchronized Reserve Markets are not structurally competitive.

Market Behavior

Offers


Daily cost-based offers are submitted for each unit by the unit owner. For generators the offer must include tier 1 synchronized reserve ramp rate, a tier 1 synchronized reserve maximum, self scheduled status, synchronized reserve availability, synchronized reserve offer quantity (MW), tier 2 synchronized reserve offer price, energy use for tier 2 condensing resources (MW), condense to gen cost, shutdown costs, condense startup cost, condense hourly cost, condense notification time, spin as a condenser status, and condense available status. The synchronized reserve offer price made by the unit owner is subject to an offer cap of marginal cost plus \$7.50 per MW. All suppliers are paid the higher of the market clearing price or their offer plus their unit specific opportunity cost. The offer quantity is limited to the economic maximum. PJM monitors this offer by checking to ensure that all offers are greater than or equal to 90 percent of the resource's ramp rate times 10 minutes. A resource that is unable to participate in the synchronized reserve market during a given hour may set its hourly offer to 0.00 MW. Certain defined resource types are not required to offer tier 2 because they cannot reliably provide synchronized reserve. These include: nuclear, wind, solar, landfill gas and energy storage resources.²⁶

Figure 10-11 shows the daily average of hourly offered tier 2 synchronized reserve MW for both the RTO Synchronized Reserve Zone and the Mid-Atlantic Dominion Synchronized Reserve Subzone. In the first nine months of 2017, the ratio of online and eligible tier 2 synchronized reserve to synchronized reserve required in the Mid-Atlantic Dominion Subzone was 4.96 averaged over all hours. For the RTO Synchronized Reserve Zone the ratio was 5.74.

²⁶ See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 86.

PJM has a tier 2 synchronized reserve must offer requirement for all generation that is online, nonemergency, and physically able to operate with an output less than dictated by economic dispatch. Tier 2 synchronized reserve offers are made on a daily basis with hourly updates permitted. Daily offers can be changed as a result of maintenance status or physical limitations only and are required regardless of online/offline state.²⁷ The Tier 2 Synchronized Reserve Market is not actually cleared based on daily offers but based on hourly updates to the daily offers. As a result of hourly updates the actual amount of eligible tier 2 MW can change significantly every hour (Figure 10-11). Changes to the hourly offer status are only permitted when resources are physically unable to provide tier 2. Changes to hourly eligibility levels are the result of online status, minimum/maximum runtimes, minimum notification times, maintenance status and grid conditions including constraints. However, resource operators can make their units unavailable for an hour or block of hours without having to provide a reason.

Figure 10-11 Tier 2 synchronized reserve hourly offer and eligible volume (MW), averaged daily: January through September, 2017

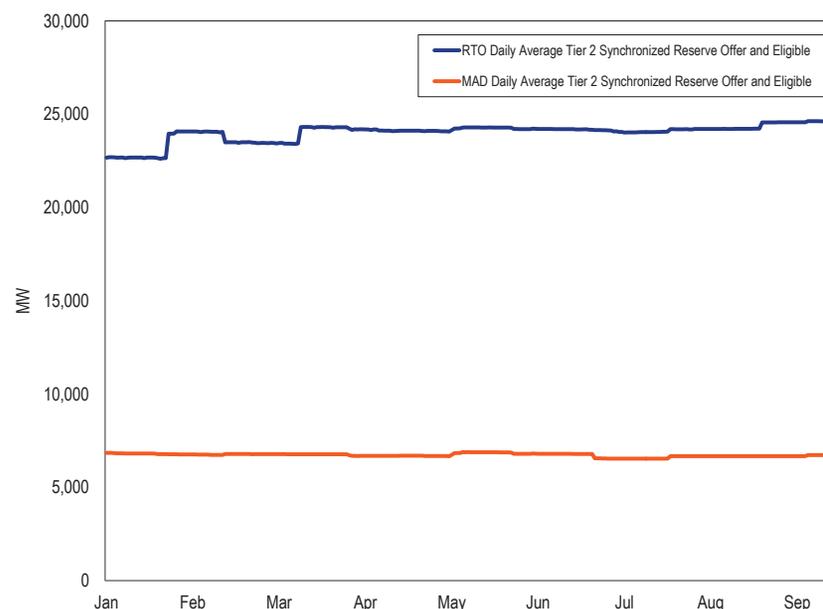

Of all nonemergency resources capable of reliably producing synchronized reserve and therefore obligated to offer, an average of 2.6 percent of units capable of providing tier 2 synchronized reserve did not enter a daily tier 2 synchronized reserve offer for the first nine months of 2017.

The MMU recommends that the tier 2 synchronized reserve must offer requirement be enforced. The MMU recommends that PJM define a set of acceptable reasons why a unit can be made unavailable daily or hourly and require unit owners to select a reason in Markets Gateway whenever making a unit unavailable either daily or hourly or setting the offer MW to 0 MW.²⁸

²⁷ See *id.* ("Regardless of online/offline state, all non-emergency generation capacity resources must submit a daily offer for Tier 2 Synchronized Reserve in eMKT...").

²⁸ PJM has adopted a new business rule in the third quarter of 2017 to enforce compliance with the tier 2 must-offer requirement. PJM enters a zero dollar offer price for all units with a must offer obligation for tier 2 synchronized reserves.

Figure 10-12 shows average offer MW volume by market and unit type for the MAD Subzone and Figure 10-13 shows average offer MW volume by market and unit type for the RTO Zone.

Figure 10-12 MAD average daily tier 2 synchronized reserve offer by unit type (MW): January through September, 2014 through 2017


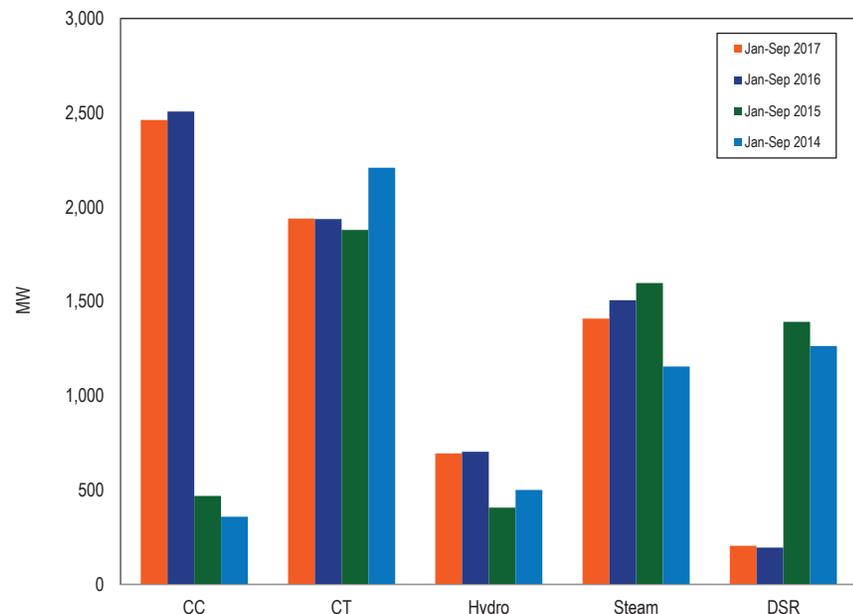


Figure 10-13 RTO Zone average daily tier 2 synchronized reserve offer by unit type (MW): January through September, 2014 through 2017

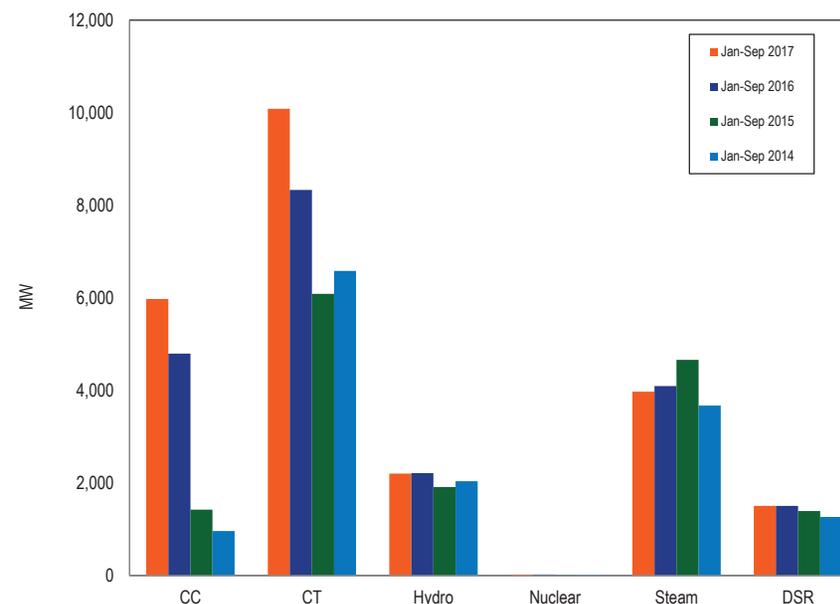

Market Performance

Price

The price of tier 2 synchronized reserve is calculated in real time every five minutes and averaged each hour for the RTO Reserve Zone and the MAD Subzone. In hours where total tier 1 MW synchronized reserve MW is less than the synchronized reserve requirement, PJM must clear a Tier 2 Synchronized Reserve Market for synchronized reserves.

In the first nine months of 2017, a Tier 2 Synchronized Reserve Market was cleared for the MAD Subzone in 98.1 percent of all hours. In 1.9 percent of hours there was enough tier 1 synchronized reserve to cover the full requirement. The MAD tier 2 market cleared an average of 343.3 MW at a

weighted average clearing price of \$3.34 compared to \$4.39 in the first nine months of 2016.

In the first nine months of 2017, the Tier 2 Synchronized Reserve Market for the RTO Zone cleared an average of 524.3 MW at a weighted average price of \$3.44 compared to \$5.35 in the first nine months of 2016.

In 98.2 percent of cleared hours, the synchronized reserve market clearing price was the same for both the MAD Subzone and the RTO Zone. In the 1.8 percent of hours when the price diverged, the average clearing price was \$19.74 in the MAD Subzone, and \$23.13 in the RTO Zone.

Although influenced by tier 1 bias, supply, performance, and demand are reflected in the price of synchronized reserve. (Figure 10-9 and Figure 10-10).

Table 10-17 Mid-Atlantic Dominion subzone, weighted average SRMCP and average scheduled, tier 1 estimated and demand response MW: January 1, 2016 through September 30, 2017

Year	Month	Weighted Average Synchronized Reserve Market Clearing Price	Average Tier 2 Generation Synchronized Reserve Purchased (MW)	Average Hourly Tier 1 Synchronized Reserve Estimated Hour Ahead (MW)	Average Hourly Demand Response Cleared (MW)
2016	Jan	\$4.70	206.1	1,263.5	62.2
2016	Feb	\$1.99	205.3	1,230.1	63.1
2016	Mar	\$3.07	386.8	993.3	97.8
2016	Apr	\$4.62	500.9	912.4	125.7
2016	May	\$2.88	432.0	956.5	96.6
2016	Jun	\$4.34	311.7	1,116.9	67.1
2016	Jul	\$7.98	188.0	1,254.7	46.8
2016	Aug	\$8.06	219.2	1,228.4	50.5
2016	Sep	\$4.66	230.6	1,170.6	43.6
2016	Oct	\$4.00	407.9	1,086.1	58.8
2016	Nov	\$1.28	595.1	774.8	92.8
2016	Dec	\$2.21	408.7	995.0	69.5
2016		\$4.15	341.0	1,089.7	72.9
2017	Jan	\$2.18	400.8	981.6	75.3
2017	Feb	\$1.60	288.8	1,111.6	84.8
2017	Mar	\$2.88	549.5	767.4	108.4
2017	Apr	\$2.69	419.0	896.9	100.7
2017	May	\$3.13	409.8	1,164.6	98.4
2017	Jun	\$2.03	287.4	1,373.0	51.2
2017	Jul	\$3.11	305.5	1,391.9	45.8
2017	Aug	\$2.02	270.3	1,438.3	58.9
2017	Sep	\$10.42	304.8	1,419.2	65.2
2017		\$3.34	359.6	1,171.6	76.5

Table 10–18 RTO zone weighted average SRMCP and average scheduled, tier 1 estimated and demand response MW: January 1, 2016 through September 30, 2017

Year	Month	Weighted Average Synchronized Reserve Market Clearing Price	Average Tier 2 Generation Synchronized Reserve Purchased (MW)	Average Hourly Tier 1 Synchronized Reserve Estimated Hour Ahead (MW)	Average Hourly Demand Response Cleared (MW)
2016	Jan	\$6.64	269.5	1,659.4	74.3
2016	Feb	\$2.76	277.9	1,564.1	81.5
2016	Mar	\$3.56	510.2	1,089.1	130.0
2016	Apr	\$5.06	602.2	1,011.7	159.3
2016	May	\$3.39	508.3	1,160.9	125.8
2016	Jun	\$5.03	378.3	1,546.0	78.4
2016	Jul	\$9.32	270.5	1,663.8	59.6
2016	Aug	\$9.13	306.0	1,605.6	64.5
2016	Sep	\$5.62	364.6	1,290.4	60.7
2016	Oct	\$4.17	678.9	802.7	83.5
2016	Nov	\$1.37	715.6	810.8	117.7
2016	Dec	\$2.54	578.6	953.1	92.5
2016		\$4.88	455.1	1,399.0	94.0
2017	Jan	\$2.00	639.4	1,020.4	100.9
2017	Feb	\$1.70	483.5	1,172.0	110.6
2017	Mar	\$3.28	728.4	654.2	140.7
2017	Apr	\$2.71	629.6	805.1	129.6
2017	May	\$3.15	571.9	924.1	129.3
2017	Jun	\$2.09	407.8	1,413.5	92.2
2017	Jul	\$3.60	435.0	1,540.1	90.0
2017	Aug	\$2.29	392.8	1,512.8	111.8
2017	Sep	\$10.17	430.0	1,368.9	116.8
2017		\$3.44	524.3	1,156.8	113.5

Cost

As a result of changing grid conditions, load forecasts, and unexpected generator performance, prices do not always cover the full cost including the final LOC for each resource. Because price formation occurs within the hour (on a five minute basis integrated over the hour) but the synchronized reserve commitment occurs prior to the hour, the realized within hour price can be zero even when some tier 2 synchronized reserve is cleared. All resources cleared in the market are guaranteed to be made whole and are paid if the SRMCP does not compensate them for their offer plus LOC.

The full cost of tier 2 synchronized reserve including payments for the clearing price and out of market costs is calculated and compared to the price. The closer the price to cost ratio is to one hundred percent, the more the market price reflects the full cost of tier 2 synchronized reserve. A price to cost ratio close to one hundred percent is an indicator of an efficient synchronized reserve market design.

In the first nine months of 2017, the price to cost (including self scheduled) ratio of the RTO Zone Tier 2 Synchronized Reserve Market averaged 32.6 percent (Table 10-19); the price to cost ratio of the MAD Subzone averaged 34.5 percent.

Table 10–19 RTO Zone, Mid-Atlantic Subzone tier 2 synchronized reserve MW, credits, weighted price, and cost (including self scheduled): January 1 through September 30, 2017

Zone	Year	Month	Tier 2		Weighted Average Synchronized Reserve Market Clearing Price	Tier 2 Synchronized Reserve Cost	Price/Cost Ratio
			Credited MW	Tier 2 Credits			
MAD Subzone	2017	Jan	212,748	\$1,833,559	\$2.64	\$8.62	30.6%
MAD Subzone	2017	Feb	139,977	\$1,353,401	\$1.71	\$9.67	17.7%
MAD Subzone	2017	Mar	230,808	\$2,367,585	\$3.21	\$10.26	31.3%
MAD Subzone	2017	Apr	189,960	\$1,657,748	\$2.72	\$8.73	31.2%
MAD Subzone	2017	May	183,897	\$1,903,448	\$3.80	\$10.35	36.7%
MAD Subzone	2017	Jun	130,934	\$1,508,315	\$2.14	\$11.52	18.6%
MAD Subzone	2017	July	143,248	\$2,271,979	\$3.88	\$15.86	24.4%
MAD Subzone	2017	Aug	131,617	\$1,244,528	\$2.27	\$9.46	24.0%
MAD Subzone	2017	Sep	143,624	\$3,668,027	\$13.50	\$25.54	52.9%
MAD Subzone	2017		1,506,814	\$17,808,590	\$3.98	\$12.22	32.6%
RTO Zone	2017	Jan	492,122	\$3,222,096	\$1.58	\$6.55	24.1%
RTO Zone	2017	Feb	338,732	\$2,106,454	\$1.70	\$6.22	27.3%
RTO Zone	2017	Mar	554,786	\$4,376,913	\$3.20	\$7.89	40.6%
RTO Zone	2017	Apr	472,760	\$3,622,022	\$2.71	\$7.66	35.4%
RTO Zone	2017	May	443,223	\$3,289,276	\$2.83	\$7.42	38.1%
RTO Zone	2017	Jun	305,739	\$2,287,713	\$2.04	\$7.48	27.3%
RTO Zone	2017	July	336,342	\$3,526,998	\$3.20	\$10.49	30.5%
RTO Zone	2017	Aug	304,851	\$2,046,481	\$2.25	\$6.71	33.5%
RTO Zone	2017	Sep	321,426	\$5,231,304	\$8.73	\$16.28	53.6%
RTO Zone	2017		3,569,981	\$29,709,256	\$3.14	\$8.32	34.5%

Compliance

The MMU has identified and quantified the actual performance of scheduled tier 2 synchronized reserve resources when called on to deliver during synchronized reserve events since 2011.²⁹ When synchronized reserve resources self schedule or clear the Tier 2 Synchronized Reserve Market they are obligated to provide their full scheduled tier 2 MW during a synchronized reserve event. Actual synchronized reserve event response is determined by final output minus initial output where final output is the largest output between 9 and 11 minutes after start of the event, and initial output is the lowest output between one minute before the event and one minute after the event.³⁰ Tier 2 resources are obligated to sustain their final output for the shorter of the length of the event or 30 minutes. Penalties can be assessed for failure of a scheduled tier 2 resource to perform during any synchronized reserve event lasting 10 minutes or longer.

The MMU has reported the wide range of synchronized reserve event response levels and recommended that PJM take action to increase compliance rates. In 2015, there were 21 spinning events of which seven were 10 minutes or longer. In 2016, there were 16 spinning events of which six were 10 minutes or longer. In the first nine months of 2017, there have been 16 spinning events, six of which were 10 minutes or longer.

Tier 1 resource owners are paid for the actual amount of synchronized reserve they provide in response to a synchronized reserve event.³¹ Tier 2 resource owners are paid for being available and responding but are not paid based on the actual response to a synchronized reserve event. Tier 1 resource owners do not have an obligation to respond and are not penalized for a failure to respond. Tier 2 resource owners are penalized for a failure to respond.

A tier 2 resource is penalized for the amount of MW it falls short of its offer for the entire hour, not just for the portion of the hour covered by

²⁹ See 2011 State of the Market Report for PJM, Vol. 2, Section 9, "Ancillary Services," at 250.

³⁰ See PJM. "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) § 4.2.11 Verification at 97.

³¹ See *id.* at 98.

the synchronized reserve event.³² The penalty period extends for the average number of days between spinning events. For the first nine months of 2017, PJM used the average number of days between spinning events from November 2015 through October 2016 which is 13 days.³³ Resource owners are permitted to aggregate the response of multiple units to offset an under response from one unit with an overresponse from a different unit to reduce an under response penalty.

There were six synchronized reserve events of 10 minutes or longer in the first nine months of 2017. For those six events, 12.4 percent of all scheduled tier 2 synchronized reserve MW were not delivered and were penalized (Table 10–20).

Table 10–20 Synchronized reserve events 10 minutes or longer, tier 2 response compliance, RTO Reserve Zone: January 1 through September 30, 2017

Spin Event (Day, Time)	Duration (Minutes)	Tier 1						
		Estimate (MW Adj by DGP)	Tier 1 Response (MW)	Tier 2 Scheduled (MW)	Tier 2 Response (MW)	Tier 2 Penalty (MW)	Tier 1 Response Percent	Tier 2 Response Percent
Mar 23, 2017 06:48	24	926.8	549.6	742.8	559.1	183.7	59.3%	75.3%
Apr 8, 2017 11:53	10	1,222.6	827.2	879.3	828.7	50.6	67.7%	94.2%
May 8, 2017 04:18	10	1,325.6	976.3	335.1	298.5	36.6	73.6%	89.1%
Jun 8, 2017 03:39	10	974.4	726.7	575.7	522.4	53.3	74.6%	90.7%
Sep 4, 2017 20:03	15	476.3	68.1	601.0	563.8	37.2	14.3%	93.8%
Sep 21, 2017 14:15	16	305.8	217.4	1,253.9	1,037.3	216.6	71.1%	82.7%
2017 Average	14.2	871.9	560.9	731.3	635.0	96.3	60.1%	87.6%

History of Synchronized Reserve Events

Synchronized reserve is designed to provide relief for disturbances.³⁴ ³⁵ A disturbance is defined as loss of 1,000 MW of generation and/or transmission resources within 60 seconds. In the absence of a disturbance, PJM dispatchers have used synchronized reserve as a source of energy to provide relief from low ACE. There were 5 low ACE events in the first nine months of 2017, on

³² See PJM. "Manual 28: Operating Agreement Accounting," Rev. 76 (June 1, 2017) p. 47. See also PJM. "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) § 4.2.12 Non-Performance, p. 99.

³³ "2016 Third Quarter Synchronized Reserve Performance & 2017 Synchronized Reserve Penalty Days," presentation to the Operating Committee, December 13, 2016. <<http://www.pjm.com/~media/committees-groups/committees/oc/20161213/20161213-item-16-2016-third-quarter-synchronized-reserve-performance-with-2017-penalty-days.ashx>>.

³⁴ 2013 State of the Market Report for PJM, Appendix F – PJM's DCS Performance, at 451–452.

³⁵ See PJM. "Manual 12: Balancing Operations," Rev. 36 (February 1, 2017) § 4.1.2 Loading Reserves at 40.


Table 10–21 Synchronized reserve events: January 1, 2010 through September 30, 2017 (continued)

Effective Time	Region	Duration (Minutes)	Effective Time	Region	Duration (Minutes)	Effective Time	Region	Duration (Minutes)	Effective Time	Region	Duration (Minutes)
JAN-06-2014 22:01	RTO	68	JAN-07-2015 22:36	RTO	8	JAN-18-2016 17:58	RTO	12	JAN-08-2017 03:21	RTO	7
JAN-07-2014 02:20	RTO	25	FEB-24-2015 02:51	RTO	5	FEB-08-2016 15:05	RTO	10	JAN-09-2017 19:24	RTO	9
JAN-07-2014 04:18	RTO	34	FEB-26-2015 15:20	RTO	6	FEB-28-2016 18:29	RTO	8	JAN-10-2017 13:05	MAD	9
JAN-07-2014 11:27	RTO	11	MAR-03-2015 17:02	RTO	11	APR-14-2016 20:09	RTO	10	JAN-15-2017 20:13	RTO	8
JAN-07-2014 13:20	RTO	41	MAR-16-2015 10:25	RTO	24	MAY-11-2016 15:55	RTO	6	JAN-23-2017 09:08	RTO	7
JAN-10-2014 16:46	RTO	12	MAR-17-2015 23:34	RTO	17	JUN-01-2016 09:01	RTO	5	FEB-13-2017 18:30	RTO	7
JAN-21-2014 18:52	RTO	6	MAR-23-2015 23:44	RTO	15	JUL-06-2016 00:40	RTO	5	FEB-14-2017 00:11	RTO	6
JAN-22-2014 02:26	RTO	7	APR-06-2015 14:23	RTO	8	JUL-28-2016 13:28	RTO	15	FEB-15-2017 06:37	RTO	6
JAN-22-2014 22:54	RTO	8	APR-07-2015 17:11	RTO	31	AUG-31-2016 19:29	RTO	8	MAR-23-2017 06:48	RTO	24
JAN-25-2014 05:22	RTO	10	APR-15-2015 08:14	RTO	8	SEP-09-2016 19:11	RTO	6	APR-08-2017 11:53	RTO	10
JAN-26-2014 17:11	RTO	6	APR-25-2015 03:21	RTO	9	SEP-11-2016 19:30	RTO	9	MAY-08-2017 04:18	RTO	10
JAN-31-2014 15:05	RTO	13	JUL-30-2015 14:04	RTO	10	OCT-12-2016 08:21	RTO	5	JUN-08-2017 03:39	RTO	10
FEB-02-2014 14:03	Dominion	8	AUG-05-2015 19:47	RTO	7	OCT-12-2016 14:40	RTO	7	JUN-20-2017 05:38	RTO	9
FEB-08-2014 06:05	Dominion	18	AUG-19-2015 16:47	RTO	9	NOV-04-2016 17:13	RTO	11	SEP-04-2017 20:18	MAD	15
FEB-22-2014 23:05	RTO	7	SEP-05-2015 01:16	RTO	7	DEC-03-2016 00:11	RTO	7	SEP-07-2017 09:16	RTO	9
MAR-01-2014 05:18	RTO	26	SEP-10-2015 10:12	RTO	8	DEC-31-2016 05:10	RTO	12	SEP-21-2017 14:15	RTO	16
MAR-05-2014 21:25	RTO	8	SEP-29-2015 00:58	Mid-Atlantic	11						
MAR-13-2014 20:39	RTO	8	NOV-12-2015 16:42	RTO	8						
MAR-27-2014 10:37	RTO	56	NOV-21-2015 17:17	RTO	8						
APR-14-2014 01:16	RTO	10	DEC-04-2015 22:41	RTO	7						
APR-25-2014 17:33	RTO	6	DEC-24-2015 17:42	RTO	8						
MAY-01-2014 14:18	RTO	13									
MAY-03-2014 17:11	RTO	13									
MAY-14-2014 01:36	RTO	5									
JUL-08-2014 03:07	RTO	9									
JUL-25-2014 19:19	RTO	7									
SEP-06-2014 13:32	RTO	18									
SEP-20-2014 23:42	RTO	14									
SEP-29-2014 10:08	RTO	15									
OCT-20-2014 06:35	RTO	15									
OCT-23-2014 11:03	RTO	27									
NOV-01-2014 06:50	RTO	9									
NOV-08-2014 02:08	RTO	8									
NOV-22-2014 05:27	RTO	21									
NOV-22-2014 08:19	RTO	10									
DEC-10-2014 18:58	RTO	8									
DEC-31-2014 21:42	RTO	12									

The risk of using synchronized reserves for energy or any other non-disturbance reason is that it reduces the amount of synchronized reserve available for a disturbance. Disturbances are unpredictable. Synchronized reserve has a requirement to sustain its output for only up to thirty minutes. When the need is for reserve extending past thirty minutes secondary reserve is the appropriate source of the response. The use of synchronized reserve is an expensive solution during an hour when the hour ahead market solution and reserve dispatch indicated no shortage of primary reserve. PJM's primary reserve levels have been sufficient to recover from disturbances and should remain available in the absence of disturbance.

From January 1, 2010 through September 30, 2017, PJM experienced 207 synchronized reserve events (Table 10-21), approximately 2.2 events per month. During this period, synchronized reserve events had an average duration of 12.2 minutes.

Figure 10-14 Synchronized reserve events duration distribution curve: January, 2012 through September, 2017

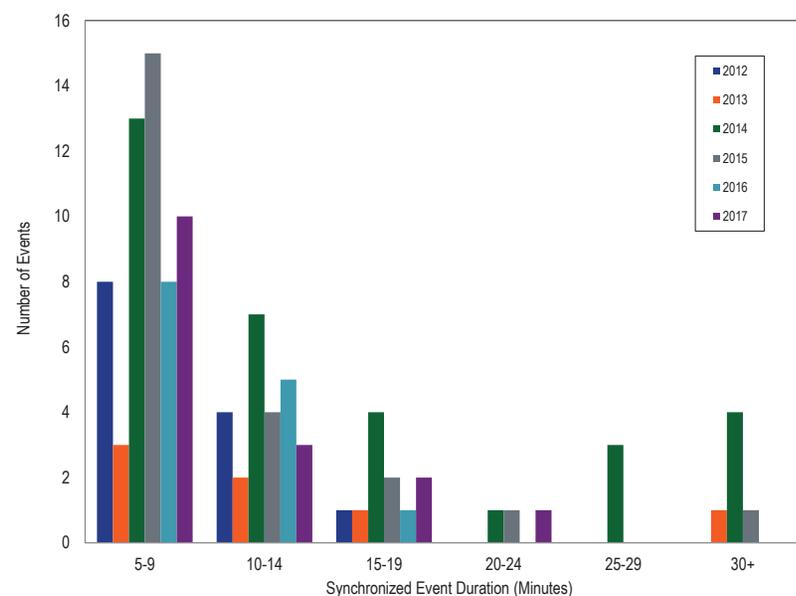

Nonsynchronized Reserve Market

Nonsynchronized reserve consists of MW available within 10 minutes but not synchronized to the grid. Startup time for nonsynchronized reserve resources is not subject to testing and is based on parameters in offers submitted by resource owners. There is no defined requirement for nonsynchronized reserves. It is available to meet the primary reserve requirement. Generation resources that have designated their entire output as emergency are not eligible to provide nonsynchronized reserves. Generation resources that are not available to provide energy are not eligible to provide nonsynchronized reserves.

The market mechanism for nonsynchronized reserve does not include any direct participation by market participants. PJM defines the demand curve for nonsynchronized reserve and PJM defines the supply curve based on nonemergency generation resources that are available to provide energy and can start in 10 minutes or less and on the associated resource opportunity costs calculated by PJM. Generation owners do not submit supply offers. Since nonsynchronized reserve is a lower quality product, its clearing price is always less than or equal to the synchronized reserve market clearing price. In most hours, the nonsynchronized reserve clearing price is zero.

Market Structure

Demand

Prior to July 12, 2017, PJM specified that 2,175 MW of primary reserve must be available in the Mid-Atlantic Dominion Reserve Subzone, of which 1,450 MW must be synchronized reserve (Figure 10-2), and that 2,175 MW of primary reserve must be available in the RTO Reserve Zone of which 1,450 MW must be synchronized reserve (Figure 10-3). As of July 12, 2017, the largest contingency is calculated dynamically in every synchronized and nonsynchronized reserve market solution and the primary requirement is set equal to 150 percent of the largest expected contingency within the upcoming hour. The balance of primary reserve can be made up by the most economic combination of synchronized and nonsynchronized reserve. PJM market

operations increased the required amount of primary reserve from 2,175 MW to 3,300 MW on January 10 and January 11, 2017, for a 32 hour period. On May 10, 2017 the default primary reserve requirement for the RTO Reserve Zone was raised from 2,175 MW to 2,550 MW for three hours.

The RTO Zone demand for nonsynchronized reserve increased significantly on May 10, 2017, as a result of the PJM rule change that increased the primary reserve requirement in the MAD Subzone from 1,700 MW to 2,175 MW. In addition, this increase changed the mix of scheduled MW from mostly hydro to mostly CT resources.

Supply

Figure 10-2 shows that most of the primary reserve requirement (orange line) in excess of the synchronized reserve requirement (yellow line) is satisfied by nonsynchronized reserve (light blue area).

There are no offers for nonsynchronized reserve. The hour ahead market solution considers the MW supply of nonsynchronized reserve to be all generation resources currently not synchronized to the grid but available and capable of providing energy within 10 minutes. Generators that have set themselves as unavailable or have set their output to be emergency only will not be considered. The market solution considers the offered MW to be the lesser of the economic maximum or the ramp rate times 10 minutes minus the startup and notification time. The offer price of nonsynchronized is the unit's opportunity cost of providing reserves.

The market solution optimizes synchronized reserve, nonsynchronized reserve, and energy to satisfy the primary reserve requirement at the lowest cost. Nonsynchronized reserve resources are scheduled economically based on LOC until the Primary Reserve requirement is filled. The nonsynchronized reserve market clearing price is determined at the end of the hour based on the LOC of the marginal unit. When a unit clears the nonsynchronized reserve market and is scheduled, it is committed to remain offline for the hour and available to provide 10 minute reserves.

Resources that generally qualify as nonsynchronized reserve include run of river hydro, pumped hydro, combustion turbines, combined cycles and diesels.³⁶ In the first nine months of 2017, an average of 863.0 MW of nonsynchronized reserve was scheduled hourly out of 2,035.0 eligible MW as part of the primary reserve requirement in the Mid-Atlantic Dominion Subzone. In the first nine months of 2017, an average of 1,226.0 MW of nonsynchronized reserve was scheduled hourly out of 2,382.6 MW eligible MW in the RTO Zone.

In the first nine months of 2017, CTs provided 54.2 percent of scheduled nonsynchronized reserve and hydro provided 44.7 percent. The remaining 1.1 percent of cleared nonsynchronized reserve was provided by diesel resources.

Market Concentration

The supply of nonsynchronized reserves in the Mid-Atlantic Dominion Subzone and the RTO Zone was highly concentrated in the first nine months of 2017.

Table 10-22 Nonsynchronized reserve market HHIs: January 1 through September 30, 2017

Year	Month	MAD HHI	RTO HHI
2017	Jan	3995	3986
2017	Feb	3968	3966
2017	Mar	4359	4343
2017	Apr	3808	3799
2017	May	3446	3444
2017	Jun	3257	3257
2017	Jul	3451	3451
2017	Aug	3457	3457
2017	Sep	3211	3207
2017	Average	3661	3657

³⁶ See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 101.

Table 10-23 Nonsynchronized reserve market pivotal supply test: January 1 through September 30, 2017


Year	Month	MAD Three Pivotal Supplier Hours	RTO Three Pivotal Supplier Hours
2017	Jan	32.2%	0.0%
2017	Feb	31.1%	0.0%
2017	Mar	38.1%	0.0%
2017	Apr	38.1%	0.0%
2017	May	52.3%	0.0%
2017	Jun	60.4%	0.0%
2017	Jul	55.9%	0.0%
2017	Aug	57.1%	0.0%
2017	Sep	70.8%	0.0%
2017	Average	48.4%	0.0%

Price

The price of nonsynchronized reserve is calculated in real time every five minutes and averaged hourly for the RTO Reserve Zone and the Mid-Atlantic Dominion Reserve Subzone.

Figure 10- 15 shows the daily average nonsynchronized reserve market clearing price and average scheduled MW for the RTO Zone. In the MAD Subzone and the RTO Zone in the first nine months of 2017, the average nonsynchronized market clearing price was \$0.17 per MW. The hourly average nonsynchronized reserve assigned was 863.0 MW in the MAD Subzone and 1,226.0 in the RTO Zone. The market cleared at a price greater than \$0 in 136 hours. The maximum hourly clearing price was \$388.72 per MW on September 21, 2017 during the course of a low ACE spinning event.

Figure 10-15 Daily average RTO Zone nonsynchronized reserve market clearing price and MW purchased: January 1 through September 30, 2017

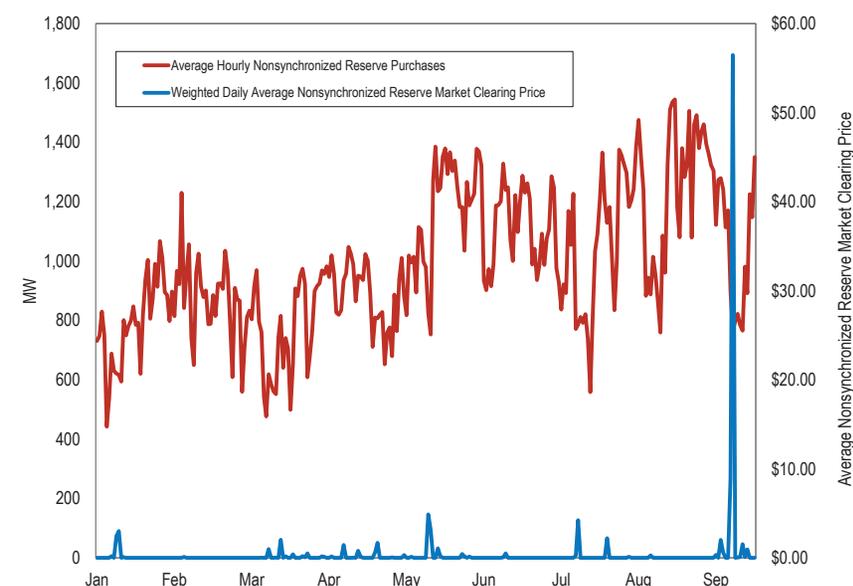

Price and Cost

As a result of changing grid conditions, load forecasts, and unexpected generator performance, prices sometimes do not cover the full LOC of each resource. All resources cleared in the market are guaranteed to be made whole and are paid uplift credits if the NSRMCP does not fully compensate them. When real-time LMP rises above the generator’s cost at economic minimum, then an LOC is paid.³⁷

The full cost of nonsynchronized reserve including payments for the clearing price and uplift costs is calculated and compared to the price (Table 10-24). The closer the price to cost ratio comes to one, the more the market price reflects the full cost of nonsynchronized reserve.

³⁷ See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 103.

In the first nine months of 2017, the price to cost ratio in both the RTO Zone Nonsynchronized Reserve Market averaged 22.4 percent; and the price to cost ratio of the MAD Subzone averaged 22.6 percent.

Resources that are not synchronized to the grid are generally off because it is not economic for them to produce energy. A resource scheduled for nonsynchronized reserve is obligated to remain unsynchronized even if its LMP changes and it becomes economic to start. In that case, the unit has a positive LOC.

Both nonsynchronized reserve markets cleared at a price above \$0 in only 2.1 percent of hours. The nonsynchronized reserve market clearing price was the same in the RTO zone and MAD subzone in all but 33 hours.

The costs of nonsynchronized reserves could be minimized if PJM could flexibly substitute lower LOC units for higher LOC units in real time as system conditions changed. Under current rules, PJM is required to keep committed a unit for which the LOC increases within the hour even if lower LOC units are available as substitutes.

Table 10-24 RTO zone, MAD subzone nonsynchronized reserve MW, charges, price, and cost: January 1 through September 30, 2017

Market	Year	Month	Total	Total	Weighted	Nonsynchronized Reserve Cost	Price/Cost Ratio
			Nonsynchronized Reserve MW	Nonsynchronized Reserve Charges	Nonsynchronized Reserve Market Price		
RTO Zone	2017	Jan	585,298	\$384,707	\$0.15	\$0.66	23.0%
RTO Zone	2017	Feb	599,304	\$171,893	\$0.00	\$0.29	1.2%
RTO Zone	2017	Mar	548,004	\$382,728	\$0.14	\$0.70	20.2%
RTO Zone	2017	Apr	653,872	\$360,626	\$0.13	\$0.55	24.1%
RTO Zone	2017	May	794,278	\$518,916	\$0.17	\$0.65	25.5%
RTO Zone	2017	Jun	842,213	\$356,180	\$0.03	\$0.42	7.3%
RTO Zone	2017	Jul	746,265	\$890,665	\$0.13	\$1.19	11.0%
RTO Zone	2017	Aug	874,607	\$548,271	\$0.01	\$0.63	1.4%
RTO Zone	2017	Sep	867,108	\$1,229,492	\$0.73	\$1.42	51.6%
RTO Zone	2017	Total	6,510,949	\$4,843,478	\$0.17	\$0.74	22.4%
MAD	2017	Jan	584,637	\$363,906	\$0.15	\$0.62	23.8%
MAD	2017	Feb	599,245	\$171,392	\$0.00	\$0.29	1.2%
MAD	2017	Mar	546,848	\$370,275	\$0.14	\$0.68	20.8%
MAD	2017	Apr	653,266	\$354,709	\$0.13	\$0.54	24.5%
MAD	2017	May	794,037	\$516,541	\$0.17	\$0.65	25.6%
MAD	2017	Jun	842,192	\$356,062	\$0.03	\$0.42	7.3%
MAD	2017	Jul	746,246	\$890,397	\$0.13	\$1.19	11.0%
MAD	2017	Aug	874,590	\$546,787	\$0.01	\$0.63	1.5%
MAD	2017	Sep	866,922	\$1,188,069	\$0.73	\$1.37	52.9%
MAD	2017	Total	6,507,984	\$4,758,140	\$0.17	\$0.73	22.6%

Secondary Reserve

There is no NERC standard for secondary reserve. PJM defines secondary reserve as reserves (online or offline available for dispatch) that can be converted to energy in 30 minutes. PJM defines a secondary reserve requirement but does not have a goal to maintain this reserve requirement in real time.

PJM maintains a day-ahead, offer based market for 30-minute day-ahead secondary reserve. The Day-Ahead Scheduling Reserve Market (DASR) has no performance obligations except that a unit which clears the DASR market is required to be available for dispatch in real time.³⁸

³⁸ See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 170.511.2.3.

Market Structure

Supply

DASR is offered by both generation and demand resources. DASR offers consist of price only. DASR MW are calculated by the market clearing engine. DASR MW are the lesser of the energy ramp rate per minute for online units times thirty minutes, or the economic maximum MW minus the day-ahead dispatch point. For offline resources capable of being online in thirty minutes, the DASR quantity is the economic maximum. In the first nine months of 2017, the average available hourly DASR was 36,567.3 MW, a 1.8 percent increase from the first nine months of 2016. The DASR hourly MW purchased averaged 5,756.4 MW, a decrease from 6,345.0 MW the first nine months of 2016.

PJM excludes resources that cannot reliably provide reserves in real time from participating in the DASR Market. Such resources include nuclear, run-of-river hydro, self scheduled pumped hydro, wind, solar, and energy storage resources.³⁹ The intent of this proposal is to limit cleared DASR resources to those resources actually capable of providing reserves in the real-time market. Owners of excluded resources may request an exemption from their default non-eligibility.

On December 14, 2015, PJM announced a plan to recover DASR credits awarded to owners for units that clear the day-ahead scheduled reserve market but become unavailable through forced outages in real time.⁴⁰ The recovery was for hours cleared from April 2015 through March 2016. This recovery is completed for a total of \$404,000.

Of the 5,756.4 MW average hourly DASR cleared in the first nine months of 2017, 65.2 percent was from CTs, 6.5 percent was from steam, 18.5 percent was from hydro, and 6.5 percent was CCs. Load response resources which are registered in PJM's Economic Load Response and are dispatchable by PJM

39 See PJM "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 169 §11.2.2 Day-Ahead Scheduling Reserve Market Eligibility.

40 See PJM Market Settlements Subcommittee Meeting, December 14, 2015, "Item 01 – CT LOC Reconciliation," <<http://www.pjm.com/~media/committees-groups/subcommittees/mss/20151214/20151214-item-01-ct-loc-reconciliation.ashx>>

are eligible to provide DASR. In the first nine months of 2017, seven demand resources offered into the DASR Market.

Demand

Secondary reserve (30-minute reserve) requirements are determined by PJM for each reliability region. In the Reliability *First* (RFC) region, secondary reserve requirements are calculated based on historical under-forecasted load rates and generator forced outage rates.⁴¹ The RFC and Dominion secondary reserve requirements are added together to form a single RTO DASR requirement defined as the sum of a percent of the load forecast error and forced outage rate times the daily peak load forecast. For 2017, the DASR requirement is set to 5.52 percent of daily peak load forecast. This is down from 5.70 for 2016. The DASR requirement is applicable for all hours of the operating day.

Effective March 1, 2015, the DASR requirement can be increased by PJM dispatch under conditions of "hot weather or cold weather alert or max emergency generation alert or other escalating emergency."⁴² The amount of additional DASR MW that may be required is the Adjusted Fixed Demand (AFD) determined by a Seasonal Conditional Demand (SCD) factor.⁴³ The SCD factor is calculated separately for the winter (November through March) and summer (April through October) seasons. The SCD factor is calculated every year based on the top 10 peak load days from the prior year. For November 2015 through October 2016, the SCD values are 3.45 percent for winter and 2.88 percent for summer. PJM Dispatch may also schedule additional Day-Ahead Scheduling Reserves as deemed necessary for conservative operations.⁴⁴ PJM has defined the reasons for conservative operations to include, potential fuel delivery issues, forest/brush fires, extreme weather events, environmental alerts, solar disturbances, unknown grid operating state, physical or cyber attacks.⁴⁵ The result is substantial discretion for PJM to increase the demand for DASR under a variety of circumstances. PJM invoked adjusted fixed demand on 14 days

41 See PJM. "Manual 13: Emergency Operations," Rev. 64 (June 1, 2017) at 12.

42 PJM. "Energy and Reserve Pricing & Interchange Volatility Final Proposal Report," <<http://www.pjm.com/~media/committees-groups/committees/mrc/20141030/20141030-item-04-erpv-final-proposal-report.ashx>>.

43 See PJM. "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 166 at 11.2.1 Day-Ahead Scheduling Reserve Market Requirement.

44 See PJM. "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 167 at 11.2.1 Day-Ahead Scheduling Reserve Market Requirement.

45 See PJM. "Manual 13: Emergency Operations," Rev. 64, (June 1, 2017) at 58 at 3.2 Conservative Operations.

during the first nine months of 2017. All days were between May 17 and September 25. The top 60 hours with highest DASR market clearing price were all during days when adjusted fixed demand was invoked.

The MMU recommends that PJM modify the DASR Market to ensure that all resources cleared incur a real-time performance obligation.

Market Concentration

DASR market three pivotal test results are provided in Table 10-25.

Table 10-25 DASR market three pivotal supplier test results and number of hours with DASRMCP above \$0: January 1, 2016 through September 30, 2017

Year	Month	Number of Hours When	
		DASRMCP > \$0	Percent of Hours Pivotal
2016	Jan	326	0.3%
2016	Feb	235	0.4%
2016	Mar	369	1.9%
2016	Apr	392	0.0%
2016	May	259	4.2%
2016	Jun	193	6.2%
2016	Jul	474	38.0%
2016	Aug	402	42.8%
2016	Sep	383	45.7%
2016	Oct	373	35.1%
2016	Nov	351	20.8%
2016	Dec	209	23.9%
2016	Average	331	18.3%
<hr/>			
2017	Jan	93	16.1%
2017	Feb	49	2.0%
2017	Mar	359	2.5%
2017	Apr	402	9.5%
2017	May	250	44.0%
2017	Jun	242	37.8%
2017	Jul	341	36.8%
2017	Aug	165	8.3%
2017	Sep	179	12.8%
2017	Average	231	18.9%

Market Conduct

PJM rules allow any unit with reserve capability that can be converted into energy within 30 minutes to offer into the DASR Market.⁴⁶ Units that do not offer have their offers set to \$0.00 per MW during the day-ahead market clearing process.

Economic withholding remains an issue in the DASR Market. The marginal cost of providing DASR is zero. All offers greater than zero constitute economic withholding. In the first nine months of 2017, 41.0 percent of generation units offered DASR at a daily price above \$0.00. This compares to 36.2 percent in 2016. In the first nine months of 2017, 11.7 percent of daily offers were above \$5.00 per MW.

Market Performance

In the first nine months of 2017, the DASR Market cleared at a price above \$0 in 2,080 hours. In the first nine months of 2017, the weighted average DASR price for all 2,080 hours when the DASRMCP was above \$0.00 was \$3.10. In 2016, the weighted average DASR price for all hours when the DASRMCP was above \$0.00 was \$3.24. In 2016, the average cleared MW in all hours was 4,538.1 MW. The average cleared MW in all hours when the DASRMCP was above \$0.00 was 5,315.7 MW. The highest DASR price was \$174.45 on September 25, 2017.

The introduction of Adjusted Fixed Demand (AFD) on March 1, 2015, created a bifurcated market (Table 10-27). In 2015, PJM added AFD to the normal 5.93 percent of forecast load in 367 hours. In 2016, PJM added AFD to the normal 5.7 percent of forecast load in 522 hours. In the first nine months of 2017, PJM added AFD to the normal 5.52 percent of forecast load in 336 hours. The difference in market clearing price, MW cleared, obligation incurred, and charges to PJM load are substantial (Table 10-26).

⁴⁶ See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) p. 168.

Table 10-26 Impact of Adjusted Fixed Demand on DASR prices and demand: January 1, 2017 through September 30, 2017

Metric	Year	Number Hours	Weighted Day-Ahead Scheduling Reserve Market Clearing Price (DASRMCP)	Average Additional DASR MW	Average Hourly Total DASR MW
All Hours	2017	6,553	\$1.42	272.1	4,422.4
All Hours when DASRMCP > \$0	2017	2,080	\$3.10	640.6	5,317.9
All Hours when AFD is used	2017	322	\$9.72	4,606.9	10,310.6

While the new rules allow PJM dispatch substantial discretion to add to DASR demand for a variety of reasons, the rationale for each specific increase is not always clear. The MMU recommends that PJM Market Operations attach a reason code to every hour in which PJM dispatch adds additional DASR MW above the default DASR hourly requirement. The addition of such a code would make the reason explicit, increase transparency and facilitate analysis of the use of PJM’s ability to add DASR MW.

Table 10-27 DASR Market, regular hours vs. adjusted fixed demand hours: January 1, 2016 through September 30, 2017.


Year	Month	Number of Hours DASRMCP>\$0		Weighted DASRMCP		Average PJM Load MW		Hourly Average Cleared DASR MW		Average Hourly DASR Credits	
		Normal Hour	AFD Hour	Normal Hour	AFD Hour	Normal Hour	AFD Hour	Normal Hour	AFD Hour	Normal Hour	AFD Hour
2016	Jan	326	0	\$0.15		103,263		4,723		\$720	
2016	Feb	212	24	\$0.05	\$3.10	102,040	107,852	4,640	6,830	\$249	\$21,167
2016	Mar	369	0	\$0.04		83,994		4,175		\$175	
2016	Apr	393	0	\$0.26		80,925		4,083		\$1,060	
2016	May	259	0	\$0.43		89,181		4,228		\$1,839	
2016	Jun	191	0	\$0.53		111,102		5,377		\$2,892	
2016	Jul	188	288	\$0.71	\$8.23	117,686	112,587	5,794	10,226	\$4,117	\$84,195
2016	Aug	247	143	\$0.76	\$10.82	122,187	113,823	6,076	11,150	\$4,639	\$120,663
2016	Sep	316	67	\$1.11	\$11.53	100,198	110,940	5,231	12,163	\$5,792	\$138,972
2016	Oct	373	0	\$0.58		82,824		4,265		\$2,494	
2016	Nov	350	0	\$0.10		84,561		4,095		\$420	
2016	Dec	210	0	\$0.04		102,293		4,444		\$169	
2016		3,434	522	\$0.40	\$8.42	98,355	111,301	4,761	10,092	\$2,047	\$91,249
2017	Jan	93	0	\$0.02		106,095		4,386		\$91	
2017	Feb	49	0	\$0.02		96,628		4,444		\$92	
2017	Mar	359	0	\$0.08		91,182		4,092		\$329	
2017	Apr	402	0	\$0.04		80,834		3,828		\$159	
2017	May	250	48	\$0.07	\$18.13	85,581	98,184	4,004	10,727	\$280	\$194,491
2017	Jun	242	73	\$0.18	\$6.63	108,482	116,172	5,099	11,713	\$907	\$77,542
2017	Jul	341	115	\$0.29	\$6.41	114,832	117,568	5,288	10,669	\$1,551	\$68,397
2017	Aug	165	12	\$0.42	\$1.23	114,916	125,601	5,507	10,585	\$2,311	\$12,980
2017	Sep	179	22	\$1.17	\$40.30	105,850	104,097	5,105	11,620	\$5,966	\$468,298
2017		2,080	270	\$3.10	\$12.25	100,489	112,324	4,639	11,317	\$1,298	\$164,341

The implementation of AFD in 522 hours of 2016 and 270 hours of 2017 significantly increased the cost of DASR as a result of increases in DASR MW cleared and corresponding increases in the DASR clearing prices (Table 10-28).

Table 10-28 DASR Market all hours of DASR market clearing price greater than \$0: January 1, 2016 through September 30, 2017

Year	Month	Number of Hours DASRMCP > \$0	Weighted DASR Market Clearing Price	Average Hourly RT Load MW	Total PJM Cleared DASR MW	Total PJM Cleared Additional DASR MW	Total Charges
2016	Jan	326	\$0.15	103,263	1,539,783	0	\$234,679
2016	Feb	212	\$0.49	102,631	1,147,608	72,197	\$560,692
2016	Mar	369	\$0.04	83,994	1,540,415	0	\$64,728
2016	Apr	393	\$0.26	80,925	1,604,693	0	\$416,418
2016	May	259	\$0.43	89,181	1,094,991	0	\$476,305
2016	Jun	191	\$0.54	111,102	1,027,053	0	\$552,455
2016	Jul	476	\$6.20	114,601	4,034,436	1,161,661	\$25,022,218
2016	Aug	390	\$5.94	119,563	3,095,240	742,332	\$18,400,638
2016	Sep	383	\$4.51	102,077	2,467,814	409,330	\$11,141,362
2016	Oct	373	\$0.58	82,824	1,591,016	0	\$930,355
2016	Nov	350	\$0.10	84,561	1,433,267	0	\$147,023
2016	Dec	210	\$0.04	102,292	933,225	0	\$33,582
2016	Average	328	\$1.61	98,085	1,792,462	198,793	\$4,831,704
2016	Total	3,932			21,509,542	2,385,520	\$57,980,453
2017	Jan	93	\$0.02	106,095	407,922	0	\$8,426
2017	Feb	49	\$0.02	96,628	217,737	0	\$4,487
2017	Mar	359	\$0.08	91,182	1,468,921	0	\$117,995
2017	Apr	402	\$0.04	80,834	1,539,010	0	\$63,852
2017	May	250	\$6.76	87,849	1,303,480	246,420	\$8,809,449
2017	Jun	242	\$3.20	110,611	1,677,956	383,822	\$5,365,628
2017	Jul	341	\$3.39	115,755	2,422,053	516,238	\$8,216,211
2017	Aug	165	\$0.53	115,693	969,557	49,896	\$509,320
2017	Sep	179	\$10.63	105,635	1,057,048	136,136	\$11,239,260
2017	Average	231	\$3.10	101,142	1,229,298	148,057	\$3,814,959
2017	Total	2,080			11,063,684	1,332,512	\$34,334,628

Figure 10-16 Daily average components of DASR clearing price (\$/MW), marginal unit offer and LOC: January through September, 2017

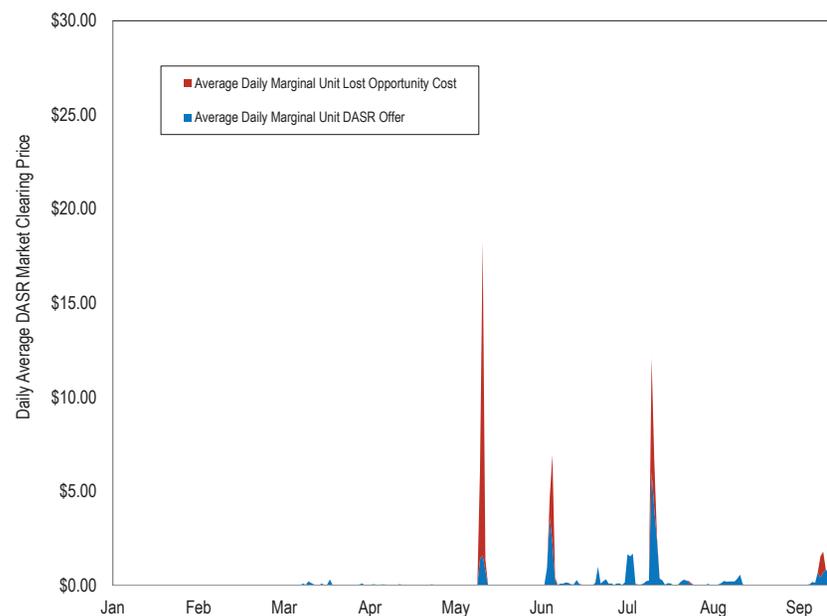

When the DASR requirement is increased by PJM dispatch, the reserve requirement frequently cannot be met without redispatching online resources which significantly affects the price by creating an LOC, (Figure 10-16). DASR prices increase at peak loads as a result of high LOCs. DASR prices were low to moderate in January through April, 2017. The weighted average DASRMCP on September 25, 2017, of \$10.63 per MW was a three year high. A hot weather alert declared for that day led to 142,119 MW additional DASR and three consecutive hourly DASR prices above \$100.

Regulation Market

Regulation matches generation with very short term changes in load by moving the output of selected resources up and down via an automatic control signal. Regulation is provided by generators with a short-term response capability (less than five minutes) or by demand response (DR). The PJM Regulation Market is operated as a single real-time market.

Market Design

PJM's Regulation Market design is a result of Order 755.⁴⁷ The objective of PJM's regulation market design is to minimize the cost to provide regulation using two resource types in a single market.

The regulation market includes resources following two signals: RegA and RegD. Resources responding to either signal help control ACE (area control error). RegA is PJM's slow-oscillation regulation signal and is designed for resources with the ability to sustain energy output for long periods of time, with slower ramp rates. RegD is PJM's fast-oscillation regulation signal and is designed for resources with limited ability to sustain energy output and with faster ramp rates. Resources must qualify to follow one or both of the RegA and RegD signals, but will be assigned by the market clearing engine to follow only one signal in a given market hour.

The PJM regulation market design includes three clearing price components: capability (\$/MW, based on the MW being offered); performance (\$/mile, based on the total MW movement requested by the control signal, known as mileage); and lost opportunity cost (\$/MW of lost revenue from the energy market as a result of providing regulation). The MBF and performance score translate a RegD resource's capability (actual) MW into marginal effective MW and offers into \$/effective MW.

The regulation market solution is intended to meet the regulation requirement with the least cost combination of RegA and RegD. When solving for the least cost combination of RegA and RegD MW to meet the regulation requirement, the Regulation Market will substitute RegD MW for RegA MW when RegD

is cheaper. Performance adjusted RegA MW are used as the common unit of measure, called effective MW, of regulation service. All resource MW (RegA and RegD) are converted into effective MW. RegA MW are converted into effective MW by multiplying the RegA MW offered by their performance score. RegD MW are converted into effective MW by multiplying the RegD offered by their performance score and by the marginal benefit function (MBF). The regulation requirement is defined as the total effective MW required to provide a defined amount of area control error (ACE) control.

The Regulation Market converts performance adjusted RegD MW into effective MW using the marginal benefit function (MBF) in the PJM design. The MBF is used to convert incremental additions of RegD MW into incremental effective MW. The total effective MW for a given amount of RegD MW equal the area under the MBF curve (the sum of the incremental effective MW contributions). RegA and RegD resources should be paid the same price per marginal effective MW.

The MBF function describing the engineering substitutability between RegA and RegD must be correctly defined and consistently applied throughout the market design, from optimization to settlement. The MBF should be equal to the marginal rate of technical substitution (MRTS) between RegA and RegD, holding the level of regulation service constant. The MRTS is the marginal measure of substitutability of RegD resources for RegA resources in satisfying a defined regulation requirement at feasible combinations of RegA and RegD MW. Consistently applying the MBF from optimization to settlement is the only way to ensure that the rate of substitution between RegA and RegD in providing a defined level of regulation is reflected in the relative value of RegA and RegD resources. While resources following RegA and RegD can both provide regulation service in PJM's Regulation Market, PJM's joint optimization is intended to determine and assign the optimal mix of RegA and RegD MW to meet the hourly regulation requirement. The optimal mix is a function of the relative effectiveness and cost of available RegA and RegD resources.

⁴⁷ Frequency Regulation Compensation in the Organized Wholesale Power Markets, Order No. 755, 137 FERC ¶ 61,064 at P 2 (2011).


At any valid combination of RegA and RegD, regulation offers are converted to dollars per effective MW using the RegD offer and the MBF associated with that combination of RegA and RegD. The marginal contribution of a RegD MW to effective MW is equal to the MRTS associated with that RegA/RegD combination.

For example, a 1.0 MW RegD resource with a total offer price of \$2/MW with a MBF of 0.5 and a performance score of 100 percent would be calculated as offering 0.5 effective MW (0.5 MBF times 1.00 performance score times 1 MW). The total offer price would be \$4 per effective MW (\$2/MW offer divided by the 0.5 effective MW).

Regulation performance scores (0.0 to 1.0) measure the response of a regulating resource to its assigned regulation signal (RegA or RegD) every 10 seconds by measuring: delay, the time delay of the regulation response to a change in the regulation signal; correlation, the correlation between the regulating resource output and the regulation signal; and precision, the difference between the regulation response and the regulation requested.⁴⁸ Performance scores are reported on an hourly basis for each resource.

Figure 10-17 and Figure 10-18 show the average performance score by resource type and the signal followed for the first nine months of 2017. In these figures, the MW used are actual MW and the performance score is the hourly performance score of the regulation resource.⁴⁹ Each category (color bar) is based on the percentage of the full performance score distribution for each resource (or signal) type. As Figure 10-18 shows, 56.5 percent of RegD resources had average performance scores within the 0.91-1.00 range, and 23.1 percent of RegA resources had average performance scores within that range.


Figure 10-17 Hourly average performance score by unit type: January 1 through September 30, 2017

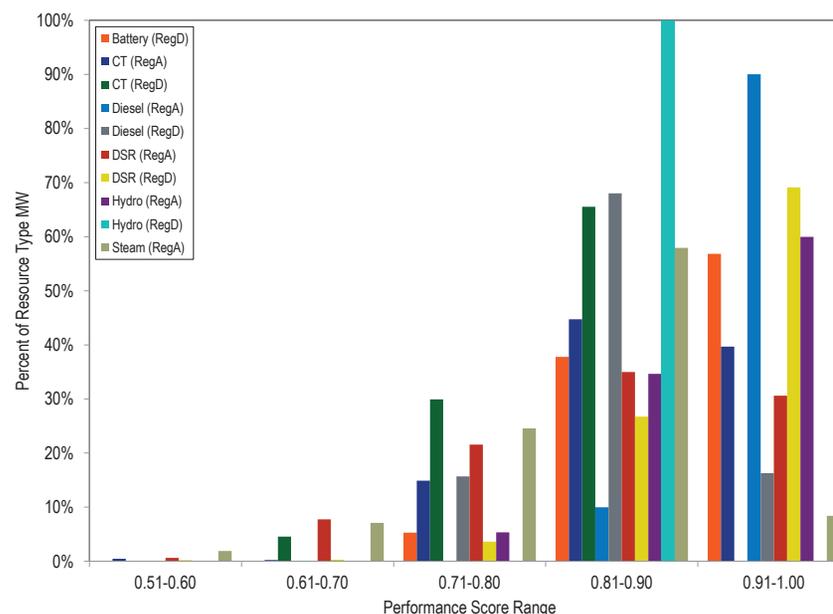

48 PJM. "Manual 12: Balancing Operations," Rev. 36 (February 1, 2017) at 4.5.6, p 54.

49 Except where explicitly referred to as effective MW or effective regulation MW, MW means actual MW unadjusted for either MBF or performance factor.

Figure 10-18 Hourly average performance score by regulation signal type: January 1 through September 30, 2017

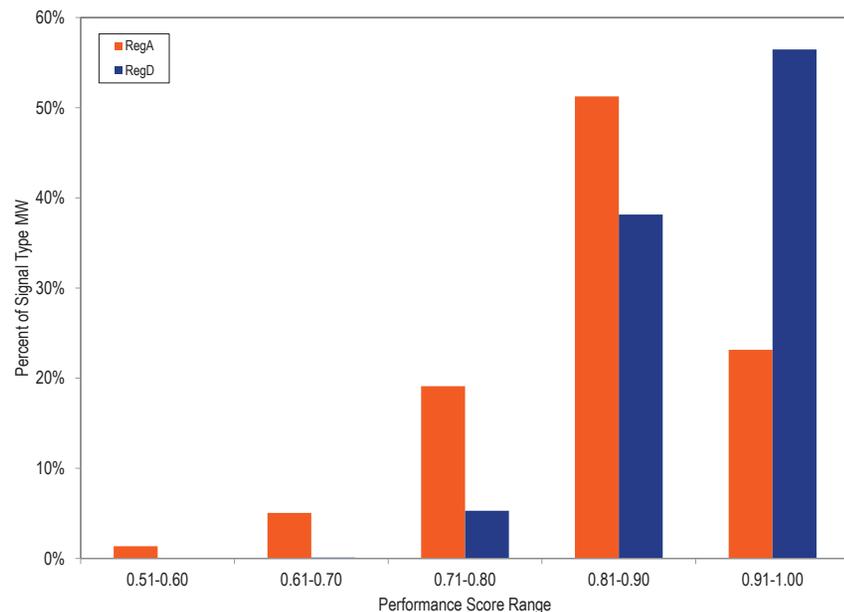

Each cleared resource in a class (RegA or RegD) is allocated a portion of the class signal (RegA or RegD). This portion of the class signal is based on the cleared regulation MW of the resource relative to the cleared MW cleared for that class. This signal is called the Total Regulation Signal (TREG) for the resource. A resource with 10 MW of capability will be provided a TREG signal asking for a positive or negative regulation movement between negative and positive 10 MW around its regulation set point.

Resources are paid Regulation Market Clearing Price (RMCP) credits and lost opportunity cost credits. If a resource's lost opportunity costs for an hour are greater than its RMCP credits, that resource receives lost opportunity cost credits equal to the difference. PJM posts clearing prices for the Regulation Market (RMCCP, RMPCP and RMCP) in dollars per effective MW. The regulation market clearing price (RMCP in \$/effective MW) for the hour is the

simple average of the 12 five minute RMCPs within the hour. The RMCP is set in each five-minute interval based on the marginal offer in each interval. The performance clearing price (RMPCP in \$/effective MW) is based on the marginal performance offer (RMPCP) for the hour. The capability clearing price (RMCCP in \$/effective MW) is equal to the difference between the RMCP for the hour and the RMPCP for the hour. This is done so the total of RMPCP plus RMCCP equals the total clearing price (RMCP) but the RMPCP is maximized.

Market solution software relevant to regulation consists of the Ancillary Services Optimizer (ASO) solving hourly; the intermediate term security constrained economic dispatch market solution (IT-SCED) solving every 15 minutes; and the real-time security constrained economic dispatch market solution (RT-SCED) solving every five minutes. The market clearing price is determined by pricing software (LPC) that looks at the units cleared in the RT-SCED 15 minutes ahead of the pricing interval. The marginal price as identified by the LPC for each of these intervals is then averaged over the hour for an hourly regulation market clearing price.

Market Design Issues

PJM's current regulation market design is severely flawed and does not follow the appropriate basic design logic. The market results do not represent the least cost solution for the defined level of regulation service. PJM is working with the MMU and market participants to address these issues.

The MBF related issues with the Regulation Market have been raised in the PJM stakeholder process. In 2015, PJM stakeholders approved an interim, partial solution to the RegD over procurement problem which was implemented on December 14, 2015. The interim solution was designed to reduce the relative value of RegD MW in all hours and to cap purchases of RegD MW during critical performance hours. But the interim solution did not address the fundamental issues in the optimization or the lack of consistency in the application of the MBF.

Additional changes were implemented on January 9, 2017. These modifications included changing the definition of off peak and on peak hours, adjusting

the currently independent RegA and RegD signals to be interdependent, and changing the 15 minute neutrality requirement of the RegD signal to a 30 minute neutrality requirement.

The January design changes appear to have been intended to make RegD more valuable. That is not a reasonable design goal. The design goal should be to determine the least cost way to provide needed regulation. The RegA signal is now slower than it was previously, which may make RegA following resources less useful as ACE control. RegA is now explicitly used to support the conditional energy neutrality of RegD. The RegD signal is now the difference between ACE and RegA. RegA is required to offset RegD when RegD moves in the opposite direction of that required by ACE control in order to permit RegD to recharge. These changes in the signal design will allow PJM to accommodate more RegD in its market solutions. The new signal design is not making the most efficient use of RegA and RegD resources. The explicit reliance on RegA to offset issues with RegD is a significant conceptual change to the design that is inconsistent with the long term design goal for regulation. PJM increased the regulation requirement as part of these changes.

The January design changes replaced off peak and on peak hours with nonramp and ramp hours with definitions that vary by season. The regulation requirement for ramp hours was increased from 700 MW to 800 MW (Table 10-29). These market changes still do not address the fundamental issues in the optimization or the lack of consistency in the application of the MBF.

Table 10-29 Seasonal regulation requirement definitions⁵⁰

Season	Dates	Nonramp Hours	Ramp Hours
Winter	Dec 1 - Feb 28(29)	00:00 - 03:59	04:00 - 08:59
		09:00 - 15:59	16:00 - 23:59
Spring	Mar 1 - May 31	00:00 - 04:59	05:00 - 07:59
		08:00 - 16:59	17:00 - 23:59
Summer	Jun 1 - Aug 31	00:00 - 04:59	05:00 - 13:59
		14:00 - 17:59	18:00 - 23:59
Fall	Sep 1 - Nov 30	00:00 - 04:59	05:00 - 07:59
		08:00 - 16:59	17:00 - 23:59

⁵⁰ See PJM, "Regulation Requirement Definition," <<http://www.pjm.com/~media/markets-ops/ancillary/regulation-requirement-definition.ashx>>.

Performance Scores

Performance scores, by class and unit, are not an indicator of how well resources contribute to ACE control. Performance scores are an indicator only of how well the resources follow their TREG signal. High performance scores with poor signal design are not a meaningful measure of performance. For example, if ACE indicates the need for more regulation but RegD resources have provided all their available energy, the RegD regulation signal will be in the opposite direction of what is needed to control ACE. So, despite moving in the wrong direction for ACE control, RegD resources would get a good performance score for following the signal and will be paid for moving in the wrong direction.

The RegD signal prior to January 9, 2017, is an example of a signal that resulted in high performance scores, but due to 15 minute energy neutrality built into the signal, ran counter to ACE control at times. Energy neutrality means that energy produced equals energy used. With 15 minute energy neutrality, if a battery were following the regulation signal to provide MWh for 7.5 minutes, it would have to consume MWh for the next 7.5 minutes. When neutrality correction of the RegD signal is triggered, it overrides ACE control in favor of achieving zero net energy over the 15 minute period. When this occurs, the RegD signal runs counter to the control of ACE and hurts rather than helps ACE. In that situation, the control of ACE, which must also offset the negative impacts of RegD, depends entirely on RegA resources following the RegA signal. High performance scores under the signal design prior to January 9, 2017, was not an indication of good ACE control.

The January design changes did not address the fundamental issues with the definition of performance or the nature of payments for performance in the regulation market design. The regulation signal should not be designed to favor a particular technology. The signal should be designed to result in the lowest cost of regulation to the market. Only with a regulation signal based on full substitutability among resource types should payments be based on following the signal. The MRTS must be redesigned to reflect the actual capabilities of technologies to provide regulation. The PJM regulation market design remains fundamentally flawed.

In addition, the absence of a performance penalty, imposed as a reduction in performance score and/or as a forfeiture of revenues, for deselection initiated by the resource owner within the hour, creates a possible gaming opportunity for resources which may overstate their capability to follow the regulation signal. The MMU recommends that there be a penalty enforced as a reduction in performance score and/or a forfeiture of revenues when resource owners elect to deassign assigned regulation resources within the hour, to prevent gaming.

Regulation Signal

With any signal design for substitutable resources, the MBF function should be determined by the ability of RegA and RegD resources to follow the signal, including conditions under which neutrality cannot be maintained by RegD resources. The ability of energy limited RegD to provide ACE control depends on the availability of excess RegA capability to support RegD under the conditional neutrality design. When RegD resources are largely energy limited resources, a correctly calculated MBF would exhibit a rapid decrease in the MBF value for every MW of RegD added. This means that only a small amount of energy limited RegD is economic. The current and proposed signals and corresponding MBF functions do not reflect these principles or the actual substitutability of resource types.

MBF Issues

The MBF function, as implemented in the PJM Regulation Market, is not equal to the MRTS between RegA and RegD. The MBF is not consistently applied throughout the market design, from optimization to settlement, and market clearing does not confirm that the resulting combinations of RegA and RegD are realistic and can meet the defined regulation demand. The calculation of total regulation cleared using the MBF is incorrect.⁵¹

The result has been that the PJM Regulation Market has over procured RegD relative to RegA in most hours, has provided a consistently inefficient market signal to participants regarding the value of RegD in every hour, and has overpaid for RegD. In 2015, this over procurement began to degrade the

⁵¹ The MBF, as used in this report, refers to PJM's incorrectly calculated MBF and not the MBF equivalent to the MRTS.

ability of PJM to control ACE in some hours while at the same time increasing the cost of regulation. When the price paid for RegD is above the level defined by an accurate MBF function, there is an artificial incentive for inefficient entry of RegD resources.

Marginal Benefit Factor Not Correctly Defined

The MBF used in the PJM Regulation Market did not accurately reflect the MRTS between RegA and RegD resources under the old market design and it does not accurately reflect the MRTS between RegA and RegD resources under the modified design. The MBF function is incorrectly defined and improperly implemented in the current PJM Regulation Market.

The MBF should be the marginal rate of technical substitution between RegA and RegD MW at different, feasible combinations of RegA and RegD that can be used to provide a defined level of regulation service. The objective of the market design is to find, given the relative costs of RegA and RegD MW, the least cost feasible combination of RegA and RegD MW. If the MBF function is incorrectly defined, or improperly implemented in the market clearing and settlement, the resulting combinations of RegA and RegD will not represent the least cost solution and may not be a feasible way to reach the target level of regulation.

The MBF is not included in PJM's settlement process. This is a design flaw that results in incorrect payments for regulation. The issue results from two FERC orders. From October 1, 2012, through October 31, 2013, PJM implemented a FERC order that required the MBF to be fixed at 1.0 for settlement calculations only. On October 2, 2013, FERC directed PJM to eliminate the use of the MBF entirely from settlement calculations of the capability and performance credits and replace it with the RegD to RegA mileage ratio in the performance credit paid to RegD resources, effective retroactively to October 1, 2012.⁵² That rule continues in effect. The result of the current FERC order is that the MBF is used in market clearing to determine the relative value of an additional MW of RegD, but the MBF is not used in the settlement for RegD.

⁵² 145 FERC ¶ 61,011 (2013).

If the MBF were consistently applied, every resource would receive the same clearing price per marginal effective MW. But the MBF is not consistently applied and resources do not receive the same clearing price per marginal effective MW.

While prices are set on the basis of dollars per effective MW, only RegA resources receive payments based on this price per effective MW.⁵³ RegA resources are paid the RMCCP times MW times the performance factor times the MBF, plus the RMPCCP times MW times the performance factor times the MBF. (The RegA MBF is 1.0.) RegD resources do not receive payments based on this price per effective MW. RegD resources are paid the RMCCP times MW times the performance factor, plus the RMPCCP times MW times the performance factor times the mileage ratio.⁵⁴ As a result, the current market design does not send the correct price signal to the RegD resources.

Figure 10-19 compares the daily average MBF and the mileage ratio for excursion and nonexcursion hours. Excursion hours (hours ending 7:00, 8:00, 18:00-21:00) were hours in which PJM had decided that more RegA was needed and PJM would not clear any RegD with an MBF less than 1.0. Excursion hours were discontinued by PJM as of July 31, 2017. The shift in both the MBF values and the mileage ratio (Figure 10-19) resulted from the design changes implemented on January 9, 2017.

The change in design decreased RegA mileage (the change in MW output in response to regulation signal per MW of capability), increased the proportion of cleared RegD resources' capability that was called by the RegD signal (increased REG for a given MW) to better match offered capability, increased the mileage required of RegD resources and changed the energy neutrality component of the signal from a strict 15 minute neutrality to a conditional 30 minute neutrality. The changes in signal design increased the mileage ratio (the ratio of RegD mileage to RegA mileage). In addition, to adapt to the 30 minute neutrality requirement, RegD resources decreased their offered capability to maintain their performance. The reduction in offered capability

reduced the amount of RegD MW clearing and increased the amount of RegA MW clearing, meaning a higher MBF in every hour.


The weighted average mileage ratio during nonexcursion hours increased from 2.81 in the first nine months of 2016, to 5.97 in the first nine months of 2017 (an increase of 112.4 percent). The high mileage ratio values are the result of the mechanics of the mileage ratio calculation. The extreme mileage ratios result when the RegA signal is fixed at a single value ("pegged") to control ACE and the RegD signal is not. If RegA is held at a constant MW output, mileage is zero for RegA. The result of a fixed RegA signal is that RegA mileage is very small and therefore the mileage ratio is very large.

These results are an example of why it is not appropriate to use the mileage ratio, rather than the MBF, to measure the relative value of RegA and RegD resources. In these events, RegA resources are providing ACE control by providing a fixed level of MW output which means zero mileage, while RegD resources alternate between helping and hurting ACE control, both of which result in positive mileage.

⁵³ This is due to the fact that RegA resources performance adjusted MW are their effective MW as the MRTS of RegA resources is always equal to one, as effective MW are defined in terms of RegA performance adjusted MW.

⁵⁴ Performance adjusted RegD MW are converted to effective MW by multiplying the performance adjusted MW by the market clearing MRTS.

Figure 10-19 Daily average MBF and mileage ratio during excursion and nonexcursion hours: January 1, 2016 through September 30, 2017⁵⁵

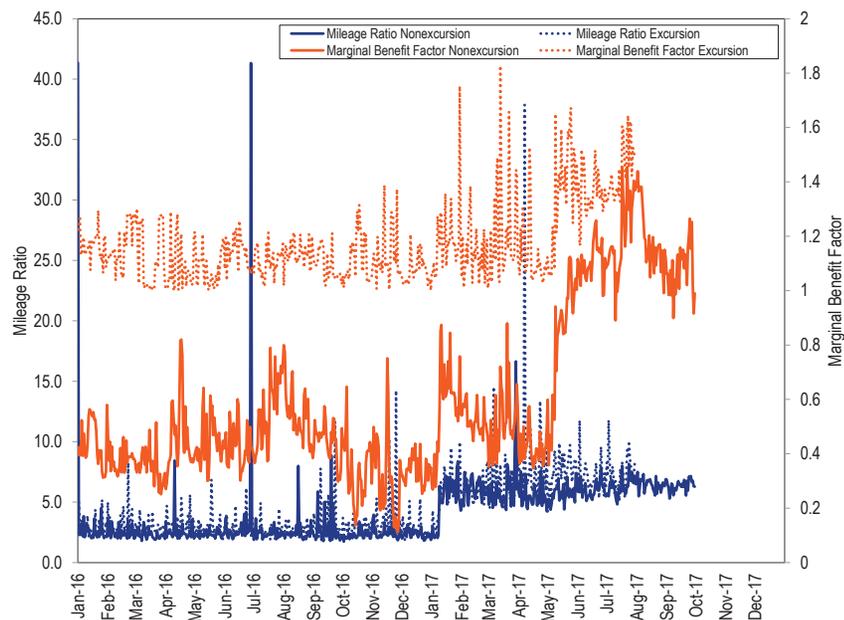

The increase in the average mileage ratio caused by the signal design changes introduced on January 9, 2017 caused a large increase in payments to RegD resources on a performance adjusted MW basis. The average daily payment per performance adjusted RegD MW increased by 57.2 percent, from \$10.01 in the period from January 1, 2016, through January 8, 2017, to \$15.74 in the period between January 9, 2017, and September 30, 2017.

Table 10-30 shows RegD resource payments on a performance adjusted MW basis and RegA resource payments on a performance adjusted MW basis by month, from January 1, 2016, through September 30, 2017. In the first nine months of 2016, RegD resources earned 12.1 percent more per performance adjusted MW than RegA resources. In the first nine months of 2017, RegD

⁵⁵ Excursion hours were discontinued as of 00:00 on July 31, 2017.

resources earned 83.5 percent more per performance adjusted MW than RegA resources.

Table 10-30 Average monthly price paid per performance adjusted MW of RegD and RegA: January 1 through September 30, 2016 through 2017

Settlement Payments				
Year	Month	RegD (\$/Performance Adjusted RegD MW)	RegA (\$/Performance Adjusted MW)	Percent Performance Adjusted RegD/RegA Under/Over Payment
2016	Jan	\$17.20	\$15.60	10.3%
	Feb	\$19.55	\$17.56	11.3%
	Mar	\$15.00	\$13.21	13.5%
	Apr	\$21.10	\$18.87	11.8%
	May	\$18.31	\$15.42	18.8%
	Jun	\$14.93	\$13.81	8.1%
	Jul	\$19.34	\$17.48	10.6%
	Aug	\$18.57	\$17.15	8.3%
	Sep	\$19.38	\$17.47	10.9%
	Oct	\$17.58	\$15.44	13.9%
	Nov	\$15.39	\$13.01	18.3%
	Dec	\$12.38	\$11.15	11.0%
Yearly		\$17.39	\$15.51	12.1%
Jan-Sep		\$18.15	\$16.28	11.5%
2017	Jan	\$17.07	\$13.62	25.4%
	Feb	\$16.58	\$10.64	55.8%
	Mar	\$26.76	\$15.06	77.7%
	Apr	\$32.60	\$15.58	109.2%
	May	\$28.45	\$17.89	59.0%
	Jun	\$28.88	\$13.23	118.2%
	Jul	\$28.49	\$15.00	89.9%
	Aug	\$32.06	\$13.24	142.1%
	Sep	\$37.89	\$21.33	77.6%
Jan-Sep		\$27.64	\$15.07	83.5%

The current settlement process does not result in paying RegA and RegD resources the same price per effective MW. RegA resources are paid on the basis of dollars per effective MW of RegA. RegD resources are not paid in terms of dollars per effective MW of RegA because the MBF is not used in settlements. When the MBF is above one, RegD resources are underpaid on a per effective MW basis, although this could be offset by a high mileage ratio. When the MBF is less than one, RegD resources are overpaid on a per

effective MW basis. The average MBF was less than 1.0 in 2016 (0.60) and the first nine months of 2017 (0.95), resulting in an average overpayment of RegD resources.


The effect of using the mileage ratio instead of the MBF to convert RegD MW into effective MW for purposes of settlement is illustrated in Table 10-31. Table 10-31 compares the monthly average payment to RegD per effective MW under the current settlement process to the monthly average payment RegD resources should have received using the MBF to convert RegD MW to effective MW. This also shows that using the MBF would result in RegA and RegD resources being paid exactly the same on a per effective MW basis. The MBF averaged less than one in each month of 2016, while the average daily mileage ratio was 2.79, resulting in RegD resources being paid \$11.2 million (1,855.6 percent) more than they should have been paid per effective MW in the first nine months of 2016. In the first nine months of 2017, the MBF also averaged less than one, while the average daily mileage ratio was 6.24, resulting in RegD resources being paid \$14.1 million (385.3 percent) more than they should have been.

Table 10-31 Average monthly price paid per effective MW of RegD and RegA under mileage and MBF based settlement: January 1 through September 30, 2016 through 2017

Year	Month	RegD Settlement Payments				Total RegD Under/Over Payment (\$)
		Mileage Based (\$/Effective RegD MW)	Marginal Rate of Technical Substitution Based (\$/Effective RegD MW)	RegA (\$/Effective MW)	Percent RegD Under/Over Payment	
2016	Jan	\$30.61	\$15.60	\$15.60	96.2%	\$1,319,364
	Feb	\$43.33	\$17.56	\$17.56	146.8%	\$1,591,651
	Mar	\$70.02	\$13.21	\$13.21	430.1%	\$1,375,711
	Apr	\$90.59	\$18.87	\$18.87	380.1%	\$1,335,655
	May	\$449.89	\$15.42	\$15.42	2,817.9%	\$1,452,512
	Jun	\$181.02	\$13.81	\$13.81	1,210.8%	\$996,391
	Jul	\$782.84	\$17.48	\$17.48	4,378.3%	\$884,677
	Aug	\$43.91	\$17.15	\$17.15	156.1%	\$985,398
	Sep	\$1,057.96	\$17.47	\$17.47	5,954.5%	\$1,259,051
	Oct	\$166.40	\$15.44	\$15.44	977.9%	\$1,251,166
	Nov	\$36.01	\$13.01	\$13.01	176.8%	\$1,109,221
	Dec	\$57.00	\$11.15	\$11.15	411.4%	\$1,041,258
Yearly		\$258.17	\$15.50	\$15.50	1,565.7%	\$14,602,055
Jan-Sep		\$318.19	\$16.27	\$16.27	1,855.6%	\$11,200,410
2017	Jan	\$80.44	\$13.62	\$13.62	490.7%	\$956,485
	Feb	\$293.97	\$10.64	\$10.64	2,662.3%	\$1,161,959
	Mar	\$80.90	\$15.06	\$15.06	437.2%	\$1,977,295
	Apr	\$79.84	\$15.58	\$15.58	412.4%	\$2,848,281
	May	\$34.79	\$17.89	\$17.89	94.4%	\$1,229,953
	Jun	\$24.18	\$13.23	\$13.23	82.7%	\$1,498,653
	Jul	\$22.16	\$15.00	\$15.00	47.7%	\$995,254
	Aug	\$26.53	\$13.24	\$13.24	100.4%	\$1,881,033
	Sep	\$35.67	\$21.33	\$21.33	67.2%	\$1,588,929
Jan-Sep		\$73.27	\$15.10	\$15.10	385.3%	\$14,137,842

Figure 10-20 shows, for the first nine months of 2017, the maximum, minimum and average MBF, by month, for excursion and nonexcursion hours. The average MBF during excursion hours from January 1, 2017, to July 30, 2017, was 1.26, and the average MBF during nonexcursion hours in the first nine months of 2017 was 0.80. The average MBF during excursion hours in the first nine months of 2016 was 1.12, and the average MBF during nonexcursion hours in the first nine months of 2016 was 0.44. The floor MBF for excursion hours was set to 1.0.

Figure 10-20 Maximum, minimum, and average PJM calculated MBF by month for excursion and nonexcursion hours: January 1 through September 30, 2017⁵⁶

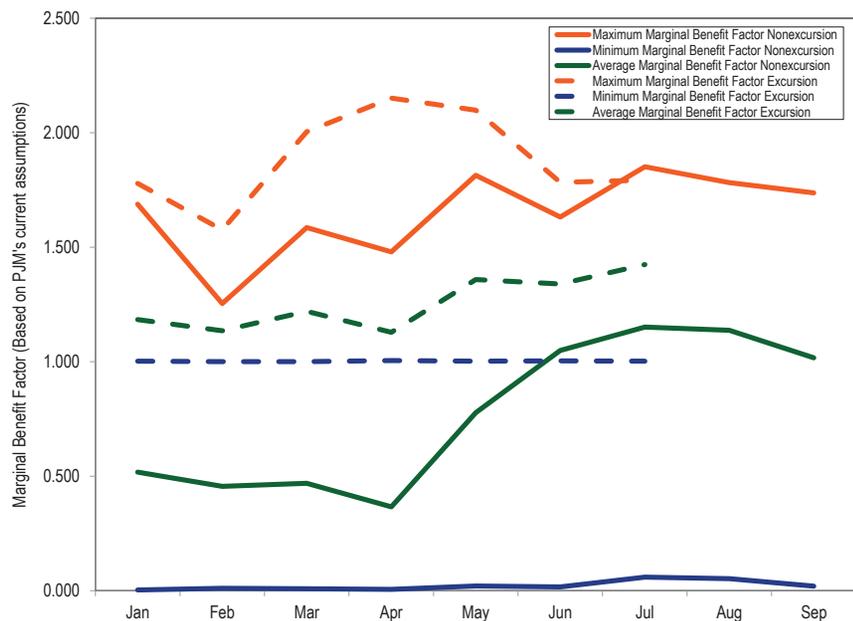

The increase in the average MBF seen in Figure 10-20 during the second quarter of 2017 is a result of a decrease in the eligible and cleared RegD MW. Table 10-32 shows performance adjusted and effective MW that were eligible and cleared during the first nine months of 2016 and 2017.


⁵⁶ Excursion hours were discontinued as of 00:00 on July 31, 2017.

Table 10-32 Performance adjusted and effective RegD MW eligible and cleared: January through September : 2016 and 2017

Performance Adjusted RegD MW (Jan-Sep)			
	2016	2017	Change
Actual Eligible	378.4	325.5	(14.0%)
Effective Eligible	340.9	319.5	(6.3%)
Actual Cleared	225.0	192.3	(14.5%)
Effective Cleared	339.3	314.2	(7.4%)

Figure 10-21 shows the MBF curve before and after the December 14, 2015, modification. Figure 10-21 shows the change in RegA for a change in RegD (MBF of RegD on the y-axis) for given ratio of RegD MW as a percentage of the effective MW requirement (Percentage RegD on the x-axis). The objective of the modification of the MBF was to reduce the operational issues caused by the over procurement of RegD. The modification to the MBF curve reduced the amount of RegD procured, but did not correct for identified issues with the definition of the MBF that are causing the over procurement to occur.

Figure 10-21 MBF curve before and after December 14, 2015, revisions by PJM

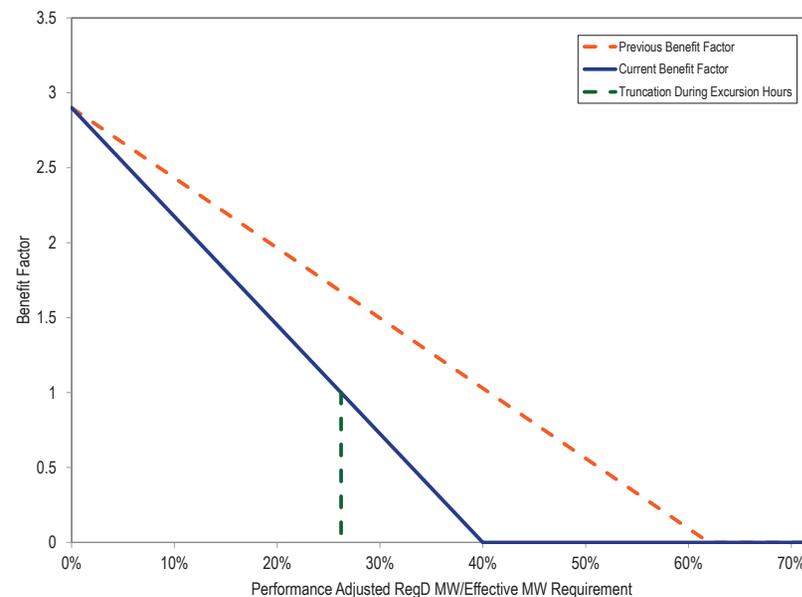

The MMU recommends that the Regulation Market be modified to incorporate a consistent and correct application of the MBF throughout the optimization, assignment and settlement process.⁵⁷

MBF Creates Results in Market Solutions that are not Feasible

An additional significant problem that results from using the incorrect MBF is that the market clearing is done without confirming that the resulting combinations of RegA and RegD are feasible and can meet the defined demand for regulation. This guarantees that an increasing proportion of RegD MW in the market incorrectly appears as a cheap feasible source of incremental effective regulation MW even when there are not enough RegA MW clearing the market to support this market solution.

The problem is illustrated in Table 10-33, for both the MBF curve used prior to December 14, 2015, and the current MBF curve. In Table 10-33, the contribution to the total regulation requirement of 800.0 MW for a ramp hour is given on both a performance adjusted RegD MW basis and effective RegD MW basis. For example, if the market cleared 320.0 MW of performance adjusted RegD (40 percent of the 800.0 performance adjusted MW needed) at a price of zero, the market would calculate that as 464.0 effective MW of RegD (area under curve) consistent with the MBF of 0.00, and determine it would need 336.0 MW of RegA to meet the 800.0 MW requirement using the current MBF curve. The resulting proportion of actual RegD MW to total regulation cleared would be 48.8 percent for the current MBF curve (320.0 actual RegD MW/(320.0 actual RegD MW + 336.0 actual RegA)), rather than the 40.0 percent defined by the MBF function. Although there is a smaller difference between the proportion of RegD cleared under the current MBF curve and the correct amount than under the prior MBF curve (48.8 percent versus 65.1 percent), the error is not **eliminated**. The result should be to maintain the desired proportions of RegA

⁵⁷ See "Regulation Market Review," Operating Committee meeting (May 5, 2015) <<http://www.pjm.com/~media/committees-groups/committees/oc/20150505/20150505-item-17-regulation-market-review.ashx>>.

and RegD regardless of the amount of RegD cleared. To do this, the MBF must be defined as the relationship between RegA MW and RegD MW, rather than the percent of RegD.


Table 10-33 MBF assumed RegD proportions versus market solution realized RegD proportions⁵⁸

RegD Percent of 800 MW	RegD MW (Performance Adjusted)	MBF (Previous)	MBF (Current)	Effective MW from RegD MW (Previous)	Effective MW from RegD MW (Current)	Residual A (800 MW Target, Previous)	Residual A (800 MW Target, Current)	RegD/(RegA+RegD, Previous)	RegD/(RegA+RegD, Current)
5.0%	40.0	2.67	2.54	111.3	108.8	688.7	691.3	5.5%	5.5%
10.0%	80.0	2.43	2.18	213.3	203.0	586.7	597.0	12.0%	11.8%
15.0%	120.0	2.20	1.81	305.9	282.8	494.1	517.3	19.5%	18.8%
20.0%	160.0	1.96	1.45	389.2	348.0	410.8	452.0	28.0%	26.1%
25.0%	200.0	1.73	1.09	463.1	398.8	336.9	401.3	37.2%	33.3%
30.0%	240.0	1.50	0.73	527.6	435.0	272.4	365.0	46.8%	39.7%
35.0%	280.0	1.26	0.36	582.8	456.8	217.2	343.3	56.3%	44.9%
40.0%	320.0	1.03	0.00	628.6	464.0	171.4	336.0	65.1%	48.8%
45.0%	360.0	0.80	-	665.1	-	134.9	-	72.7%	-
50.0%	400.0	0.56	-	692.3	-	107.7	-	78.8%	-
55.0%	440.0	0.33	-	710.0	-	90.0	-	83.0%	-
60.0%	480.0	0.09	-	718.5	-	81.5	-	85.5%	-

An example illustrates the issue. Figure 10-22 shows the same MBF curve, in terms of RegD percent (left diagram) and RegD MW (right diagram) in a scenario where 700 MW of effective MW are needed and the market clears 300 MW of RegD (actual MW), all priced at \$0.00, and 400 MW of RegA. Figure 10-22 shows that the 300 MW of cleared RegD are 42.9 percent of total cleared actual MW and that the MBF is 1.0.

⁵⁸ This example assumes that the calculation of effective MW from RegD was calculated correctly as the area under the MBF curve.

Figure 10-22 Example MBF functions with percent RegD and RegD MW

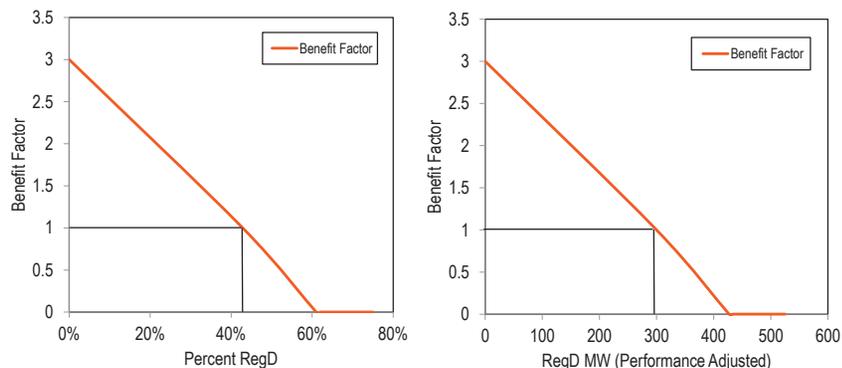

The Market Buys Too Much RegD

In 2015, the MMU determined that the PJM market design was buying too much RegD because the regulation market solution understates the amount of effective MW provided by RegD. PJM calculates the total effective MW of a unit as the simple product of the MW and the MBF, rather than the area under the MBF. The result is that 100 MW of RegD provided by a single resource (one 100 MW unit) will appear to provide fewer effective MW than 100 MW of RegD provided by two 50 MW units although they provide exactly the same total effective MW. This is the unit block issue.

The understatement of RegD was amplified by the treatment, in the market solution, of all RegD resources with the same price as a single resource for purposes of assigning a benefit factor and calculating total effective MW. All of the MW associated with multiple units with the same price were assigned the MBF of the last MW of the last unit of that block of resources. PJM calculates the total effective MW as the product of the MW and the marginal MBF, rather than the area under the MBF curve. This resulted in understating total effective MW from RegD resources cleared. This price block issue was solved by the modification of December 14, 2015.

The unit block issue was not addressed by the modification made on December 14, 2015. A complete correction of the effective MW calculation requires the use of the area under the curve.

Using PJM’s unit block method, all RegD resources are assigned the lowest MBF associated with the last RegD MW purchased. In this example (Figure 10-23), all 300 MW have an MBF of 1.0. PJM calculates total effective MW from RegD resources to be 300 (300 MW x 1.0 = 300 effective MW). In Figure 10-23, PJM’s price block/unit block calculation of total effective MW from RegD is represented by the area of the blue rectangle which is 300 effective MW.

The marginal benefit curve represents a marginal rate of substitution between RegD and RegA MW, and the area under the curve, at any RegD amount, represents the total effective MW supplied by RegD at that point. RegD is providing effective MW equal to the area of the green triangle plus the blue rectangle in Figure 10-23. This equals 600 effective MW from RegD resources, not 300 effective MW. The actual total effective MW cleared in the market is 300 more effective MW than needed to meet the regulation requirement.

Figure 10-23 Illustration of correct method for calculating effective MW


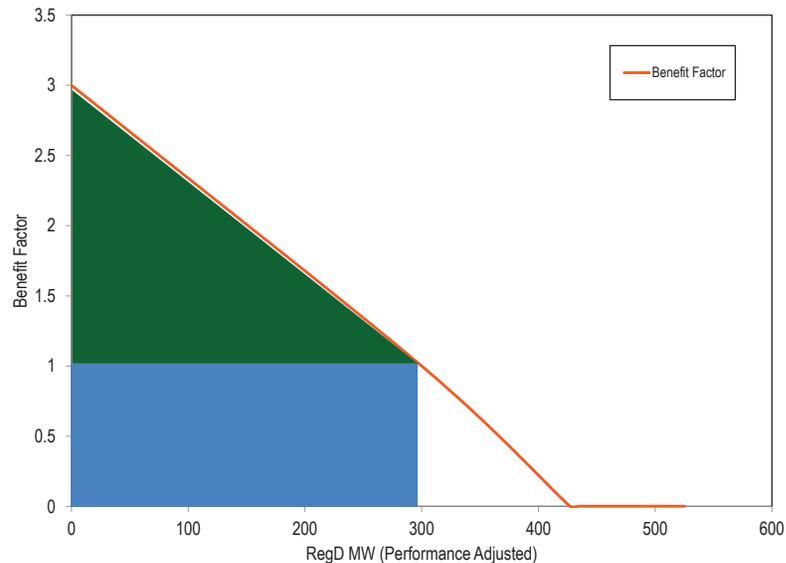


Figure 10-24 shows the average monthly peak and ramp total effective MW as calculated by PJM's MBF and as calculated by a correctly applied MBF for the January 1, 2016, through September 30, 2017, period. The figure also shows the monthly average performance adjusted RegA MW and RegD MW cleared in the Regulation Market for the period.


As a result of the changes made on January 9, 2017, the average cleared performance adjusted RegD MW during on peak hours decreased from 218.6 MW in December 2016, to 162.3 (a decrease of 25.7 percent) during ramp hours in September 2017. The average cleared performance adjusted RegA MW during on peak hours increased from 340.2 MW in December 2016, to 459.6 MW (an increase of 35.1 percent) during ramp hours in June 2017.

Figure 10-24 Average monthly total effective MW and RegA and RegD performance adjusted MW: PJM market calculated versus benefit factor based: January 1, 2016 through September 30, 2017

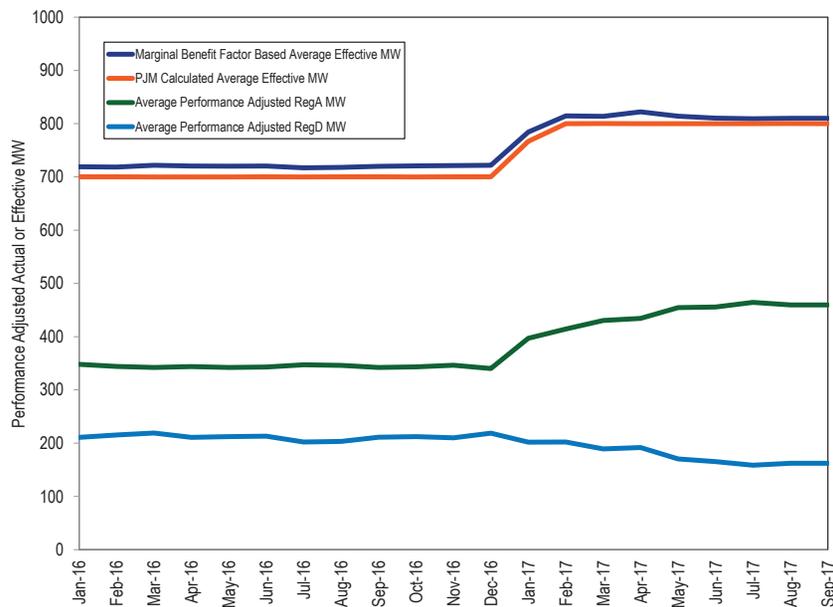

The excess procurement of RegD combined with the overpayment of RegD resulted in an increase in the level of \$0.00 offers from RegD resources. RegD MW providers are ensured that \$0.00 offers will be cleared and will be paid a price determined by the offers of RegA resources. Figure 10-25 shows, by month, the proportion of cleared RegD MW with an effective price of \$0.00 from January 1, 2016, through September 30, 2017. The figure shows that all RegD MW clearing the market in the period between January 1, 2016, and April 30, 2017, had an effective offer of \$0.00. From May 1, 2017 through September 30, 2017, an average of 98.2 percent of cleared RegD MW had an effective cost of \$0.00. The total level of RegD clearing the market leveled off beginning in January 2016 because the market cleared the maximum allowed RegD MW. Due to the changes implemented in January 2017, the total level of RegD cleared in the market decreased 16.4 percent in the first nine months of 2017 compared to the first nine months of 2016.

Figure 10-25 Average cleared RegD MW and average cleared RegD with an effective price of \$0.00 by month: January 1, 2016 through September 30, 2017

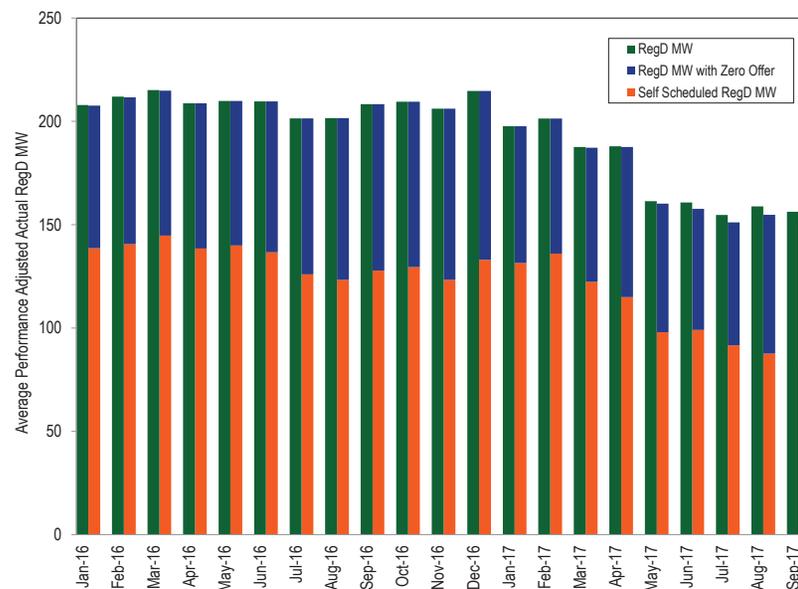


The Cost of Buying Too Much Regulation

Figure 10-26 shows the estimated cost of the excess effective MW cleared by month, peak and off peak, from January 1, 2017, through September 30, 2017, caused by PJM’s calculation of effective MW from RegD resources using mileage rather than MBF. To determine this excess cost, the total effective MW of RegD are calculated using the full area under the PJM MBF curve, and the difference between that value and the value used by PJM is multiplied by the price in each hour. The calculation of excess cost shown in Figure 10-26 that is caused by purchasing too much RegD is conservatively underestimated because it does not incorporate how the market clearing price and settlement would have been affected by replacing the current optimization and settlement process with a correct and consistent utilization of the MBF. Specifically, the calculation only reflects differences in RegA and RegD proportions due to incorrect versus correct application of the MBF, holding the actual market price and the mileage ratio based settlement constant and ignoring the actual MRTS.

In the first nine months of 2017, the estimated total cost of excess effective RegD MW during ramp and nonramp hours was \$0.83 million and \$0.71 million. In the first nine months of 2016, the estimated total cost of excess RegD MW during on peak and off peak hours was \$1.76 million and \$0.30 million. The implementation of the partial solution to the effective MW calculation and the changes in the MBF curve in December of 2015 reduced, but did not eliminate, the excess effective MW clearing in the regulation market.

Figure 10-26 Cost of excess effective MW cleared by month, peak and off peak: January 1, 2016 through September 30, 2017⁵⁹

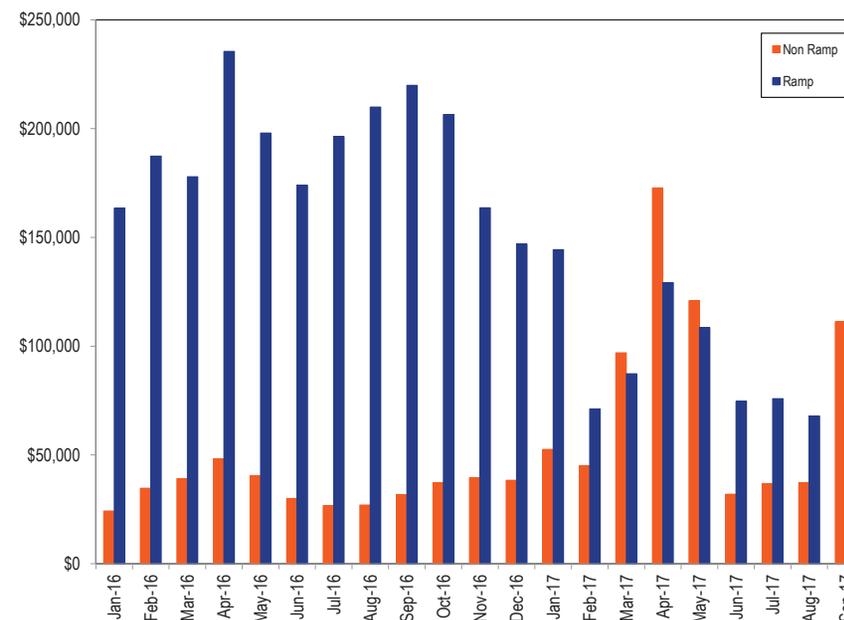

Market Structure

Supply

Table 10-34 shows capability MW (performance adjusted), average daily offer MW (performance adjusted), average hourly eligible MW (performance adjusted and effective), and average hourly cleared MW (performance adjusted and effective) for all hours in the first nine months of 2017.⁶⁰ Total MW are adjusted by the historic 100-hour moving average performance score to get performance adjusted MW, and additionally by the resource specific benefit factor to get effective MW. A resource can choose to follow either signal. For that reason, the sum of each signal type’s capability can exceed the full

⁵⁹ Prior to January 9, 2017, on peak hours were defined between 05:00-23:59, off peak hours were defined as 00:00-04:59. After January 9, 2017, ramp and nonramp hours are defined seasonally. Please see Table 10-1 for a list of what hours are considered ramp and nonramp.
⁶⁰ Unless otherwise noted, analysis provided in this section uses PJM market data based on PJM’s internal calculations of effective MW values, based on PJM’s currently incorrect MBF curve. The MMU is working with PJM to correct the MBF curve.

regulation capability. Offered MW are calculated based on the daily offers from units that are offered as available for the day. Eligible MW are calculated from the hourly offers from units with daily offers and units that are offered as unavailable for the day, but still offer MW into some hours. Units with daily offers are permitted to offer above or below their daily offer from hour to hour. As a result of these hourly MW adjustments, the average hourly Eligible MW can be higher than the Offered MW.

In the first nine months of 2017, the average hourly eligible supply of regulation for nonramp hours was 1,135.6 performance adjusted MW (858.9 effective MW). This was a decrease of 79.4 performance adjusted MW (an increase of 9.4 effective MW) from the first nine months of 2016, when the average hourly eligible supply of regulation was 1,215.0 performance adjusted MW (849.6 effective MW). In the first nine months of 2017, the average hourly eligible supply of regulation for ramp hours was 1,423.0 performance adjusted MW (1,173.7 effective MW). This was an increase of 231.6 performance adjusted MW (225.5 effective MW) from the first nine months of 2016, when the average hourly eligible supply of regulation was 1,191.4 performance adjusted MW (948.2 effective MW).

The ratio of the average hourly eligible supply of regulation to average hourly regulation demand (performance adjusted cleared MW) for ramp hours was 1.98 in the first nine months of 2017. This is an increase of 6.1 percent from the first nine months of 2016, when the ratio was 1.87. The ratio of the average hourly eligible supply of regulation to average hourly regulation demand (performance adjusted cleared MW) for nonramp hours was 2.31 in the first nine months of 2017. This is a decrease of 1.6 percent from the first nine months of 2016, when the ratio was 2.35.

Table 10-34 PJM regulation capability, daily offer and hourly eligible: January through September, 2017^{61 62}

		By Resource Type			By Signal Type	
		All Regulation	Generating Resources	Demand Resources	RegA Following Resources	RegD Following Resources
Capability MW	Daily	10,479.8	10,451.9	27.9	10,100.9	705.6
Offered MW	Daily	4,993.0	4,976.6	16.4	4,673.9	319.1
Actual Eligible MW	Ramp	1,423.0	1,408.6	14.4	1,093.9	329.1
	Nonramp	1,135.6	1,122.0	13.5	814.0	321.6
Effective Eligible MW	Ramp	1,173.7	1,155.2	18.5	811.7	362.0
	Nonramp	858.9	843.5	15.4	585.9	273.0
Actual Cleared MW	Ramp	718.2	709.9	8.3	522.3	195.8
	Nonramp	492.2	484.8	7.5	303.7	188.5
Effective Cleared MW	Ramp	795.6	778.7	16.9	441.2	354.3
	Nonramp	527.6	513.0	14.5	257.3	270.2

Table 10-35 provides the settled regulation MW by source unit type, the total settled regulation MW provided by all resources, and the percent of settled regulation provided by unit type. In Table 10-35 the MW have been adjusted by the performance score since this adjustment forms the basis of payment for units providing regulation. Total regulation performance adjusted capability MW increased 26.4 percent from 3,694,467.2 MW in the first nine months of 2016 to 4,670,170.9 MW in the first nine months of 2017. The average proportion of regulation provided by battery units had the largest increase, providing 41.1 percent of regulation in the first nine months of 2016 and 47.0 percent of regulation in the first nine months of 2017. Hydro units had the largest decrease in average proportion of regulation provided, decreasing from 18.7 percent in the first nine months of 2016, to 14.9 percent in the first nine months of 2017. The total regulation credits in the first nine months of 2017 were \$74,274,392, up 11.8 percent from \$66,444,595 in the first nine months of 2016.

⁶¹ Average Daily Offer MW excludes units that have offers but are unavailable for the day.

⁶² Total offer capability is defined as the sum of the maximum daily offer volume for each offering unit during the period, without regard to the actual availability of the resource or to the day on which the maximum was offered.

Table 10-35 PJM regulation by source: January through September, 2016 and 2017⁶³

Source	2016 (Jan-Sep)				2017 (Jan-Sep)			
	Number of Units	Performance Adjusted Settled Regulation (MW)	Percent of Settled Regulation	Total Regulation Credits	Number of Units	Performance Adjusted Settled Regulation (MW)	Percent of Settled Regulation	Total Regulation Credits
Battery	21	1,517,433.0	41.1%	\$24,507,644	21	2,196,108.6	47.0%	\$28,783,598
Coal	49	321,659.9	8.7%	\$7,464,327	44	294,539.0	6.3%	\$6,734,837
Hydro	39	691,254.3	18.7%	\$14,917,596	26	696,665.0	14.9%	\$13,451,226
Natural Gas	152	1,117,613.6	30.3%	\$18,794,966	148	1,386,066.5	29.7%	\$24,014,694
DR	35	46,506.5	1.3%	\$760,062	28	96,791.9	2.1%	\$1,290,038
Total	296	3,694,467.2	100.0%	\$66,444,595	267	4,670,170.9	100.0%	\$74,274,392

Significant flaws in the regulation market design have led to a significant over procurement of RegD MW primarily in the form of storage capacity. The incorrect market signals have led to more storage projects entering PJM's interconnection queue, despite clear evidence that the market design is flawed and despite operational evidence that the RegD market is saturated (Table 10-36).

Table 10-36 Active battery storage projects in the PJM queue system by submitted year: 2012 to 2017

Year	Number of Storage Projects	Total Capacity (MW)
2012	1	4.5
2013	0	0.0
2014	7	128.4
2015	34	236.1
2016	12	85.6
2017	3	0.5
Total	57	455.1

The supply of regulation can be affected by regulating units retiring from service. If all units that are requesting retirement through the end of 2017 retire, the supply of regulation in PJM will be reduced by less than one percent.

Although the MBF for RegA resources is 1.0, the effective MW of RegA resources were lower than the offered MW in the first nine months of 2017, because the average performance score was less than 1.00. For the first nine

months of 2017, the MW weighted average RegA performance score was 0.85 and there were 215 resources following the RegA signal.

For RegD resources, the total effective MW do not equal performance adjusted MW because the MBF for RegD resources can range from 0.0 to 2.9. In the first nine months of 2017, the MBF for cleared RegD resources ranged from 0.003 to 1.851 with an average over all nonexcursion hours of 0.796 and from 1.000 to 2.151 with an average over all excursion hours of 1.257. In the first nine months of 2017, the MW weighted average RegD resource performance score was 0.90 and there were 54 resources following the RegD signal.

Demand

The demand for regulation does not change with price. The regulation requirement is set by PJM to meet NERC control standards, based on reliability objectives, which means that a significant amount of judgment is exercised by PJM in determining the actual demand. Prior to October 1, 2012, the regulation requirement was 1.0 percent of the forecast peak load for on peak hours and 1.0 percent of the forecast valley load for off peak hours. Between October 1, 2012, and December 31, 2012, PJM changed the regulation requirement several times. It had been scheduled to be reduced from 1.0 percent of peak load forecast to 0.9 percent on October 1, 2012, but instead it was changed from 1.0 percent of peak load forecast to 0.78 percent of peak load forecast. It was further reduced to 0.74 percent of peak load forecast on November 22, 2012 and reduced again to 0.70 percent of peak load forecast on December 18, 2012. On December 14, 2013, it was reduced to 700 effective MW during peak hours and 525 effective MW during off peak hours. The regulation requirement remained 700 effective MW during peak hours and 525 effective MW during off peak hours until January 9, 2017. A change to the regulation requirement was approved by the RMISTF in 2016, with an implementation

⁶³ Biomass data have been added to the natural gas category for confidentiality purposes.

date of January 9, 2017. The regulation requirement was increased from 700 effective MW to 800 effective MW during ramp hours (See Table 10-37).

Table 10-37 shows the average hourly required regulation by month and the ratio of supply to demand for both actual and effective MW, for ramp and nonramp hours. The average hourly required regulation by month is an average of the ramp and nonramp hours in the month.

The nonramp regulation requirement of 525.0 effective MW was provided by a combination of RegA and RegD resources equal to 491.6 hourly average MW in the first nine months of 2017. This is a decrease of 26.6 MW from the first nine months of 2016, when the average hourly total regulation cleared MW for nonramp hours were 518.3 MW. The ramp regulation requirement of 700.0 effective MW prior to January 9, 2017, and 800.0 effective MW after January 9, 2017, was provided by a combination of RegA and RegD resources equal to 718.8 hourly average MW in the first nine months of 2017. This is an increase of 80.9 MW from the first nine months of 2016, where the average hourly regulation cleared MW for ramp hours were 637.9 MW.

Table 10-37 PJM Regulation Market required MW and ratio of eligible supply to requirement for ramp and nonramp hours: January through September, 2016 and 2017⁶⁴

Hours	Month	Average Required Regulation (MW)		Average Required Regulation (Effective MW)		Ratio of Supply MW to MW Requirement		Ratio of Supply Effective MW to Effective MW Requirement	
		2016	2017	2016	2017	2016	2017	2016	2017
Ramp	Jan	657.5	690.8	700.1	766.8	1.83	2.10	1.34	1.48
	Feb	663.6	705.8	700.1	800.1	1.84	2.11	1.38	1.52
	Mar	640.6	714.7	700.0	800.1	1.90	1.96	1.39	1.41
	Apr	633.8	730.6	699.9	800.0	1.78	1.86	1.32	1.41
	May	625.4	723.6	699.9	800.0	1.82	1.88	1.29	1.44
	Jun	632.2	719.9	700.1	800.0	1.98	1.98	1.38	1.49
	Jul	628.7	727.6	700.0	799.9	1.85	2.00	1.37	1.52
	Aug	630.6	727.8	700.1	800.3	1.88	1.97	1.35	1.50
	Sep	628.5	728.3	700.1	799.9	1.95	1.90	1.38	1.46
Nonramp	Jan	553.8	503.6	525.0	525.1	2.15	2.45	1.56	1.65
	Feb	550.0	508.3	525.6	525.0	2.17	2.47	1.56	1.75
	Mar	517.0	499.9	525.0	525.0	2.25	2.22	1.57	1.52
	Apr	513.1	519.0	525.0	525.0	2.23	2.20	1.54	1.60
	May	504.5	479.7	525.0	525.1	2.24	2.26	1.52	1.59
	Jun	509.0	471.9	525.2	525.1	2.62	2.31	1.78	1.63
	Jul	506.9	484.9	525.0	541.0	2.42	2.32	1.65	1.66
	Aug	502.0	481.8	525.0	535.2	2.58	2.41	1.74	1.71
	Sep	508.3	475.8	525.0	526.4	2.47	2.26	1.65	1.62

Market Concentration

In the first nine months of 2017, the effective MW weighted average HHI of RegA resources was 2730 which is highly concentrated and the weighted average HHI of RegD resources was 1595 which is also highly concentrated.⁶⁵ The weighted average HHI of all resources was 1144, which is moderately concentrated. The HHI of RegA resources and the HHI of RegD resources are higher than the HHI for all resources because different owners have large market shares in the RegA and RegD markets.

Table 10-38 includes a monthly summary of three pivotal supplier (TPS) results. In the first nine months of 2017, 89.9 percent of hours had three or

⁶⁴ The regulation requirement for January 2017 includes eight days of 700 effective MW and 23 days of 800 effective MW.

⁶⁵ HHI results are based on market shares of effective MW, defined as regulation capability MW adjusted by performance score and resource specific benefit factor, consistent with the way the regulation market is cleared.

fewer pivotal suppliers. The MMU concludes that the PJM Regulation Market in the first nine months of 2017 was characterized by structural market power. The TPS values are provided by PJM. The TPS results cannot be verified by the MMU or PJM because PJM does not save the necessary data. The MMU recommends that PJM save this data and make it available so that the TPS test calculations can be replicated by both PJM and the MMU. PJM has agreed that the lack of information is an issue but does not have a specific plan or timeline to resolve the issue.

Table 10-38 Regulation market monthly three pivotal supplier results: January 1, 2015 through September 30, 2017

Month	Percent of Hours Pivotal		
	2015	2016	2017
Jan	97.8%	93.9%	90.6%
Feb	96.3%	90.9%	93.1%
Mar	97.3%	87.8%	92.7%
Apr	98.1%	93.5%	92.9%
May	99.3%	94.0%	88.7%
Jun	98.6%	89.3%	89.2%
Jul	98.8%	92.2%	91.0%
Aug	97.7%	93.7%	88.0%
Sep	97.1%	94.0%	82.6%
Oct	96.1%	90.6%	
Nov	99.2%	96.2%	
Dec	97.2%	90.4%	
Average	97.8%	92.2%	89.9%

Market Conduct

Offers

Resources seeking to regulate must qualify to follow a regulation signal by passing a test for that signal with at least a 75 percent performance score. The regulating resource must be able to supply at least 0.1 MW of regulation and not allow the sum of its regulating ramp rate and energy ramp rate to exceed its overall ramp rate.⁶⁶ When offering into the regulation market, regulating resources must submit a cost offer and may submit a price offer (capped at \$100/MW) by 2:15 pm the day before the operating day.⁶⁷

⁶⁶ See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 64.

⁶⁷ See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 69.

Offers in the PJM Regulation Market consist of a capability component for the MW of regulation capability provided and a performance component for the miles (Δ MW of regulation movement) provided. The capability component for cost offers is not to exceed the increased fuel costs resulting from operating the regulating unit at a lower output level than its economically optimal output level, plus a \$12.00/MW adder. The performance component for cost offers is not to exceed the increased costs (increased VOM and increased fuel costs) resulting from moving the unit up and down to provide regulation. Batteries and flywheels have zero cost for lower efficiency from providing regulation instead of energy, as they are not net energy producers. There is an energy storage loss component for batteries and flywheels as a cost component of regulation performance offers to reflect the net energy consumed to provide regulation service.⁶⁸

Up until one hour before the operating hour, the regulating resource must provide: status (available, unavailable, or self scheduled); capability (movement up and down in MW); regulation maximum and regulation minimum (the highest and lowest levels of energy output while regulating in MW); and the regulation signal type (RegA or RegD). Resources may offer regulation for both the RegA and RegD signals, but will be assigned to follow only one signal for a given operating hour. Resources have the option to submit a minimum level of regulation they are willing to provide.⁶⁹

All LSEs are required to provide regulation in proportion to their load share. LSEs can purchase regulation in the regulation market, purchase regulation from other providers bilaterally, or self schedule regulation to satisfy their obligation (Table 10-40).⁷⁰ Figure 10-27 compares average hourly regulation and self scheduled regulation during ramp and nonramp hours on an effective MW basis. The average hourly regulation is the amount of regulation that actually cleared and is not the same as the regulation requirement because PJM clears the market within a two percent band around the requirement.⁷¹ Self scheduled regulation comprised an average of 40.0 percent during ramp

⁶⁸ See PJM, "Manual 15: Cost Development Guidelines," Rev. 29 (May 15, 2017) at 62.

⁶⁹ See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 67.

⁷⁰ See PJM, "Manual 28: Operating Agreement Accounting," Rev. 76 (June 1, 2017) at 4.1 at 22.

⁷¹ See PJM, "Manual 11: Energy & Ancillary Services Market Operations," Rev. 90 (July 27, 2017) at 3.2.9 at 78.

hours and 46.5 percent during nonramp hours in the first nine months of 2017.

Figure 10-27 Off peak, on peak, nonramp, and ramp regulation levels: January 1, 2016 through September 30, 2017⁷²

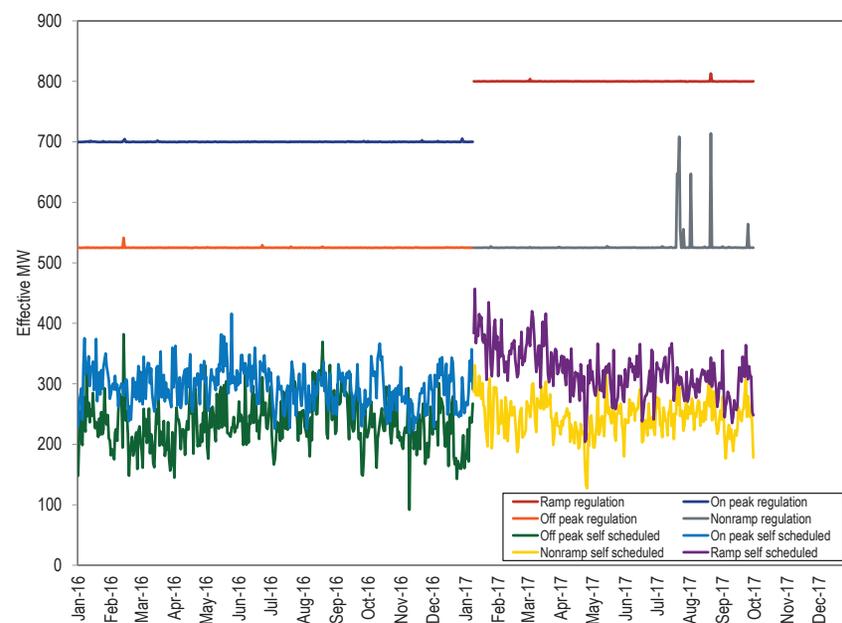


Table 10-39 shows the role of RegD resources in the regulation market. RegD resources are both a growing proportion of the market (10.9 percent of the total effective MW at the start of the performance based regulation market design in October 2012 and 46.5 percent of the total effective MW in September 2017) and a growing proportion of resources that self schedule (10.1 percent of all self scheduled MW in October 2012 and 24.5 percent of all self scheduled MW in September 2017). The increase in the share of RegD in 2016 was a result of the use of the unit block method of calculating the MBF over the previous price block method (See Figure 10-23). The decrease in the RegD share of total effective MW for the first nine months of 2017 was a result of a decrease in the amount of eligible MW of RegD (Table 10-32) in response to the changes to the regulation market on January 9, 2017.

⁷² The MW increase during the nonramp hours of Q3 was a result of PJM operations treating those hours as ramp hours.

Table 10-39 RegD self scheduled regulation by month: October 31, 2012 through September 30, 2017

Year	Month	RegD Self Scheduled Effective MW	RegD Effective MW	Total Self Scheduled Effective MW	Total Effective MW	Percent of Total Self Scheduled	RegD Percent of Total Self Scheduled	RegD Percent of Total Effective MW
2012	Oct	66.3	71.8	264.7	658.1	40.2%	10.1%	10.9%
2012	Nov	74.4	88.3	196.5	716.5	27.4%	10.4%	12.3%
2012	Dec	82.5	88.8	188.8	701.1	26.9%	11.8%	12.7%
2013	Jan	35.7	82.5	133.6	720.0	18.6%	5.0%	11.5%
2013	Feb	84.8	90.2	212.2	724.3	29.3%	11.7%	12.5%
2013	Mar	80.1	119.3	279.8	680.7	41.1%	11.8%	17.5%
2013	Apr	82.3	106.9	266.0	594.1	44.8%	13.8%	18.0%
2013	May	74.0	109.0	268.2	616.2	43.5%	12.0%	17.7%
2013	Jun	79.6	122.7	334.9	730.6	45.8%	10.9%	16.8%
2013	Jul	77.6	120.4	303.6	822.9	36.9%	9.4%	14.6%
2013	Aug	83.6	127.6	366.0	756.8	48.4%	11.0%	16.9%
2013	Sep	112.2	152.1	381.6	669.9	57.0%	16.7%	22.7%
2013	Oct	120.2	163.7	349.6	613.3	57.0%	19.6%	26.7%
2013	Nov	133.9	175.7	396.5	663.3	59.8%	20.2%	26.5%
2013	Dec	136.5	180.7	313.6	663.5	47.3%	20.6%	27.2%
2013	Average	91.7	129.2	300.5	688.0	44.1%	13.6%	19.0%
2014	Jan	132.9	193.5	261.1	663.6	39.3%	20.0%	29.2%
2014	Feb	134.3	193.4	289.0	663.6	43.5%	20.2%	29.1%
2014	Mar	131.8	193.8	287.2	663.8	43.3%	19.9%	29.2%
2014	Apr	126.8	212.4	270.8	663.7	40.8%	19.1%	32.0%
2014	May	121.7	248.5	265.6	663.6	40.0%	18.3%	37.4%
2014	Jun	123.3	231.0	365.5	663.9	55.0%	18.6%	34.8%
2014	Jul	126.4	235.5	352.7	663.5	53.2%	19.0%	35.5%
2014	Aug	117.6	229.8	368.2	663.6	55.5%	17.7%	34.6%
2014	Sep	121.0	242.6	393.8	663.6	59.3%	18.2%	36.6%
2014	Oct	116.1	255.4	352.7	663.6	53.2%	17.5%	38.5%
2014	Nov	113.5	235.1	347.5	664.2	52.3%	17.1%	35.4%
2014	Dec	116.7	254.3	353.0	663.6	53.2%	17.6%	38.3%
2014	Average	123.5	227.1	325.6	663.7	49.1%	18.6%	34.2%
2015	Jan	116.4	250.1	304.8	663.7	45.9%	17.5%	37.7%
2015	Feb	111.3	245.8	242.6	663.5	36.6%	16.8%	37.0%
2015	Mar	113.8	255.2	229.9	663.8	34.6%	17.1%	38.5%
2015	Apr	110.1	248.2	283.7	663.7	42.7%	16.6%	37.4%
2015	May	121.8	265.1	266.7	663.6	40.2%	18.4%	39.9%
2015	Jun	158.9	283.1	321.2	663.7	48.4%	23.9%	42.6%
2015	Jul	161.4	278.3	314.0	663.8	47.3%	24.3%	41.9%
2015	Aug	159.5	276.0	300.7	663.6	45.3%	24.0%	41.6%
2015	Sep	155.4	289.2	286.0	663.5	43.1%	23.4%	43.6%
2015	Oct	147.1	299.0	292.8	663.4	44.1%	22.2%	45.1%
2015	Nov	164.9	302.1	298.1	664.2	44.9%	24.8%	45.5%
2015	Dec	144.6	317.2	260.7	663.9	39.3%	21.8%	47.8%
2015	Average	138.8	275.8	283.4	663.7	42.7%	20.9%	41.6%

Year	Month	RegD Self Scheduled Effective MW	RegD Effective MW	Total Self Scheduled Effective MW	Total Effective MW	Percent of Total Self Scheduled	RegD Percent of Total Self Scheduled	RegD Percent of Total Effective MW
2016	Jan	187.7	335.9	295.3	663.8	44.5%	28.3%	50.6%
2016	Feb	179.9	339.0	274.6	663.6	41.4%	27.1%	51.1%
2016	Mar	182.6	340.8	280.1	663.7	42.2%	27.5%	51.3%
2016	Apr	182.2	339.5	287.0	663.5	43.3%	27.5%	51.2%
2016	May	183.9	341.1	301.5	663.5	45.4%	27.7%	51.4%
2016	Jun	178.8	340.5	302.4	663.6	45.6%	26.9%	51.3%
2016	Jul	165.2	337.5	273.3	663.5	41.2%	24.9%	50.9%
2016	Aug	165.8	338.5	283.2	663.5	42.7%	25.0%	51.0%
2016	Sep	160.9	341.4	279.9	663.6	42.2%	24.2%	51.4%
2016	Oct	168.6	340.0	283.0	663.5	42.6%	25.4%	51.2%
2016	Nov	156.2	338.0	259.8	664.3	39.1%	23.5%	50.9%
2016	Dec	162.2	342.7	274.7	663.6	41.4%	24.4%	51.6%
2016	Average	172.8	339.6	282.9	663.7	42.6%	26.0%	51.2%
2017	Jan	187.1	334.9	318.0	673.9	47.2%	27.8%	49.7%
2017	Feb	192.7	337.8	296.6	674.2	44.0%	28.6%	50.1%
2017	Mar	172.2	315.3	297.5	638.5	46.6%	27.0%	49.4%
2017	Apr	159.9	306.4	255.0	639.6	39.9%	25.0%	47.9%
2017	May	167.6	297.0	265.7	639.7	41.5%	26.2%	46.4%
2017	Jun	178.6	315.6	284.3	696.9	40.8%	25.6%	45.3%
2017	Jul	171.9	310.3	290.0	703.1	41.3%	24.5%	44.1%
2017	Aug	176.7	314.0	286.3	700.9	40.8%	25.2%	44.8%
2017	Sep	156.9	297.8	259.0	640.4	40.4%	24.5%	46.5%
2017	Jan-Sep Average	173.7	299.0	283.6	333.9	42.5%	8.7%	47.1%

Increased self scheduled regulation lowers the requirement for cleared regulation, resulting in fewer MW cleared in the market and lower clearing prices. Of the LSEs' obligation to provide regulation in the first nine months of 2017, 54.1 percent was purchased in the PJM market, 40.2 percent was self scheduled, and 5.8 percent was purchased bilaterally (Table 10-40). Table 10-41 shows the total regulation by source including spot market regulation, self scheduled regulation, and bilateral regulation for the first nine months of each year from 2012 to 2017. Table 10-40 and Table 10-41 are based on settled (purchased) MW.

Table 10-40 Regulation sources: spot market, self scheduled, bilateral purchases: January 1, 2016 through September 30, 2017

Year	Month	Spot Market Regulation (Unadjusted MW)	Spot Market Percent of Total	Self Scheduled Regulation (Unadjusted MW)	Self Scheduled Percent of Total	Bilateral Regulation (Unadjusted MW)	Bilateral Percent of Total	Total Regulation (Unadjusted MW)
2016	Jan	197,085.6	47.8%	193,843.1	47.0%	21,671.0	5.3%	412,599.7
2016	Feb	190,668.7	49.7%	173,704.0	45.2%	19,546.0	5.1%	383,918.8
2016	Mar	196,173.9	49.4%	178,691.7	45.0%	22,017.0	5.5%	396,882.6
2016	Apr	192,872.3	50.1%	173,923.2	45.2%	18,058.0	4.7%	384,853.5
2016	May	185,673.4	47.4%	185,434.2	47.4%	20,221.0	5.2%	391,328.7
2016	Jun	177,041.1	46.7%	180,936.5	47.7%	21,295.5	5.6%	379,273.1
2016	Jul	176,073.5	45.6%	168,116.9	43.5%	42,233.0	10.9%	386,423.4
2016	Aug	187,641.6	48.6%	172,116.0	44.6%	26,299.5	6.8%	386,057.1
2016	Sep	169,565.3	45.0%	171,466.0	45.5%	35,462.5	9.4%	376,493.8
2016	Oct	190,611.4	49.0%	174,555.6	44.8%	24,074.0	6.2%	389,241.0
2016	Nov	206,016.3	55.0%	155,359.8	41.5%	13,289.5	3.5%	374,665.6
2016	Dec	191,278.5	48.9%	176,628.1	45.1%	23,642.5	6.0%	391,549.0
	Total	2,260,701.6	48.6%	2,104,775.1	45.2%	287,809.5	6.2%	4,653,286.2
2017	Jan	181,386.7	45.8%	188,924.6	47.7%	25,490.5	6.4%	395,801.8
2017	Feb	179,488.3	50.4%	154,308.8	43.3%	22,371.0	6.3%	356,168.1
2017	Mar	174,026.3	46.3%	177,638.3	47.3%	23,963.0	6.4%	375,627.5
2017	Apr	206,895.4	55.7%	145,424.6	39.1%	19,207.5	5.2%	371,527.5
2017	May	212,510.8	57.8%	139,361.6	37.9%	15,967.5	4.3%	367,839.9
2017	Jun	221,942.4	57.5%	142,537.9	36.9%	21,535.0	5.6%	386,015.3
2017	Jul	227,034.0	55.8%	152,610.9	37.5%	27,183.5	6.7%	406,828.4
2017	Aug	238,636.3	59.2%	141,754.6	35.2%	22,844.5	5.7%	403,235.5
2017	Sep	206,302.9	58.1%	130,394.2	36.7%	18,197.0	5.1%	354,894.1
	Jan-Sep	1,848,223.0	54.1%	1,372,955.6	40.2%	196,759.5	5.8%	3,417,938.1

Table 10-41 Regulation sources: January through September, 2012 through 2017

Year (Jan-Sep)	Spot Market Regulation (Unadjusted MW)	Spot Market Percent of Total	Self Scheduled Regulation (Unadjusted MW)	Self Scheduled Percent of Total	Bilateral Regulation (Unadjusted MW)	Bilateral Percent of Total	Total Regulation (Unadjusted MW)
2012	5,110,747.9	79.7%	1,122,671.9	17.5%	180,121.0	2.8%	6,413,540.8
2013	2,528,830.3	60.8%	1,478,608.5	35.5%	152,328.5	3.7%	4,159,767.3
2014	1,836,480.7	51.8%	1,543,266.0	43.5%	166,857.0	4.7%	3,546,603.7
2015	1,897,225.7	54.7%	1,380,004.7	39.8%	193,529.1	5.6%	3,470,759.5
2016	1,672,795.5	47.8%	1,598,231.6	45.7%	226,803.5	6.5%	3,497,830.6
2017	1,848,223.0	54.1%	1,372,955.6	40.2%	196,759.5	5.8%	3,417,938.1

In the first nine months of 2017, DR provided an average of 8.3 MW of regulation per hour during ramp hours (7.1 MW of regulation per hour during ramp hours in the first nine months of 2016), and an average of 7.5 MW of regulation per hour during nonramp hours (5.3 MW of regulation per hour during off peak hours in the first nine months of 2016). Generating units supplied an average of 709.9 MW of regulation per hour during ramp hours (630.7 MW of regulation per hour during ramp hours in the first nine months of 2016), and an average of 484.8 MW per hour during nonramp hours (512.8 MW of regulation per hour during nonramp hours in the first nine months of 2016).

Market Performance

Price

After regulation performance was implemented on October 1, 2012, both regulation price and regulation cost per MW were higher than they were prior to October 1, 2012, for each year until 2016 (Table 10-45). The weighted average RMCP for the first nine months of 2017 was \$15.70 per effective MW. This is a decrease of \$0.82 per MW, or 4.9 percent, from the weighted average RMCP of \$16.52 per MW in the first nine months of 2016. The decrease in the regulation clearing price was the result of a reduction

in energy prices and the related reduction in the opportunity cost component of RMCP. The increase in self supply and \$0.00 offers from RegD resources since 2016 also contributed to lower prices.

In September 2016, an issue was identified concerning the real time clearing price for five minute intervals in the regulation market. Regulation units available to set price in a given five minute interval are based on the latest five minute RT-SCED 15 minute look ahead scheduling and assignment of regulation resources. This means that at the end of an hour, pricing in 5 minute intervals starting at 00:45, 00:50, and 00:55 is based on RT-SCED scheduling information (regulation assignments) from 01:00, 01:05, and 01:10 of the following hour. In cases where units provided regulation in an hour, but are not assigned to provide regulation in the following hour, these deassigned units appeared as unavailable for purposes of determining price in the last three, 5 minute intervals of their assigned regulation hour (00:45, 00:50, and 00:55). The pricing algorithm instead used the list of resources assigned to regulation for the next hour to set the price in intervals 00:45, 00:50, and 00:55 of the current hour. The result was that the prices did not accurately reflect the units actually running in intervals 00:45, 00:50, and 00:55. In November 2016, PJM corrected this problem by forcing the pricing algorithm to use the regulation availability status of the current hour to determine which units are eligible to set the regulation price for the current hour.

Figure 10-28 shows the daily weighted average regulation market clearing price and the opportunity cost component for the marginal units in the PJM Regulation Market on a performance adjusted MW basis. This data is based on actual five minute interval operational data. As

Figure 10-28 illustrates, the opportunity cost (blue line) is the largest component of the clearing price.

Figure 10-28 PJM regulation market daily weighted average market-clearing price, marginal unit opportunity cost and offer price (Dollars per MW): January 1 through September 30, 2017

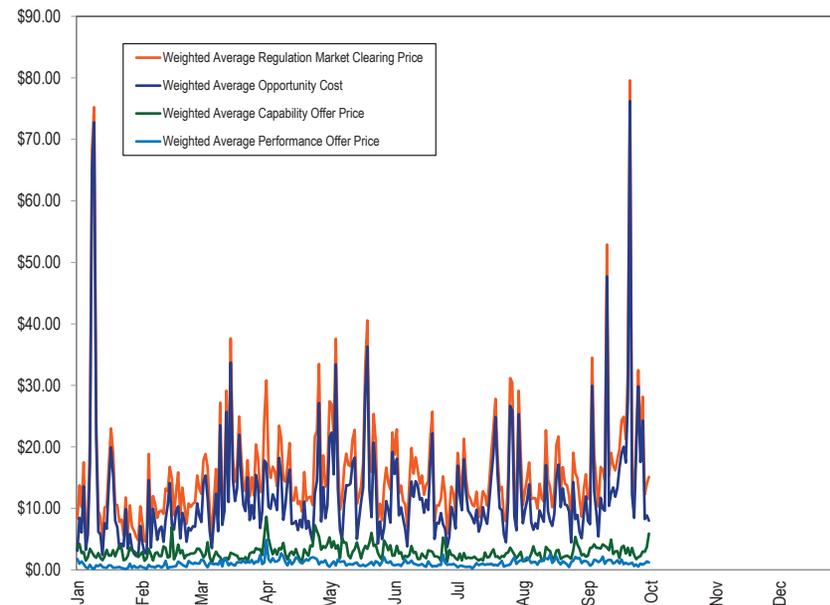


Table 10-42 shows the components of the monthly average regulation prices. NA is the unexplained portion of the total weighted average market price.

Table 10-42 PJM regulation market monthly component of price (Dollars per MW): January 1 through September 30, 2017

Month	Weighted Average Regulation Marginal Unit LOC (\$/Actual MW)	Weighted Average Regulation Marginal Unit Capability Offer (\$/Actual MW)	Weighted Average Regulation Marginal Unit Performance Offer (\$/Actual MW)	Weighted Average Regulation Market Clearing Price (\$/ Actual MW)	NA	Weighted Average Regulation Market Price from Settlements (\$/Actual MW)
Jan	\$11.77	\$2.68	\$0.59	\$15.04	\$0.95	\$14.08
Feb	\$7.49	\$2.84	\$0.75	\$11.08	(\$0.05)	\$11.12
Mar	\$12.81	\$2.50	\$1.21	\$16.52	\$0.20	\$16.32
Apr	\$10.96	\$3.65	\$1.65	\$16.26	\$0.04	\$16.21
May	\$14.22	\$3.60	\$1.08	\$18.90	\$0.05	\$18.85
Jun	\$10.31	\$2.63	\$0.98	\$13.92	\$0.08	\$13.85
Jul	\$12.52	\$2.29	\$0.89	\$15.71	\$0.05	\$15.66
Aug	\$9.79	\$2.57	\$1.49	\$13.85	\$0.15	\$13.70
Sep	\$17.63	\$3.30	\$1.21	\$22.13	\$0.15	\$21.98
Average	\$11.94	\$2.90	\$1.09	\$15.94	\$0.18	\$15.75

Monthly, total annual, and total year to date scheduled regulation MW and regulation charges, as well as monthly and monthly average regulation price and regulation cost are shown in Table 10-43. Total scheduled regulation is based on settled performance adjusted MW. The total of all regulation charges for the first nine months of 2017 was \$74.1 million, compared to \$66.4 million for the first nine months of 2016.

Table 10-43 Total regulation charges: January 1, 2016 through September 30, 2017⁷³

Year	Month	Scheduled Regulation (MW)	Total Regulation Charges (\$)	Weighted Average Regulation Market Price (\$/MW)	Cost of Regulation (\$/MW)	Price as Percent of Cost
2016	Jan	412,599.7	\$7,594,184	\$15.65	\$18.41	85.1%
2016	Feb	383,918.8	\$7,682,435	\$17.63	\$20.01	88.1%
2016	Mar	396,882.6	\$6,111,918	\$13.43	\$15.40	87.2%
2016	Apr	384,853.5	\$8,372,956	\$19.07	\$21.76	87.7%
2016	May	391,328.7	\$7,220,908	\$15.67	\$18.45	84.9%
2016	Jun	379,273.1	\$5,997,055	\$14.03	\$15.81	88.7%
2016	Jul	386,423.4	\$7,959,676	\$17.86	\$20.60	86.7%
2016	Aug	386,057.1	\$7,707,370	\$17.58	\$19.96	88.1%
2016	Sep	376,493.8	\$7,783,970	\$17.91	\$20.67	86.6%
2016	Oct	389,241.0	\$7,019,998	\$15.68	\$18.04	87.0%
2016	Nov	374,665.6	\$5,777,522	\$13.12	\$15.42	85.1%
2016	Dec	391,549.0	\$5,133,457	\$11.17	\$13.11	85.2%
2016	Annual	4,653,286.2	\$84,361,450	\$15.73	\$18.14	86.7%
2017	Jan	395,801.8	\$6,851,605	\$14.08	\$17.31	81.4%
2017	Feb	356,168.1	\$5,332,548	\$11.12	\$14.97	74.3%
2017	Mar	375,627.5	\$8,604,453	\$16.32	\$22.91	71.2%
2017	Apr	371,527.5	\$9,048,650	\$16.21	\$24.36	66.6%
2017	May	367,839.9	\$8,943,812	\$18.85	\$24.31	77.5%
2017	Jun	386,015.3	\$7,726,835	\$13.85	\$20.02	69.2%
2017	Jul	406,828.4	\$8,698,944	\$15.66	\$21.38	73.2%
2017	Aug	403,235.5	\$8,395,118	\$13.70	\$20.82	65.8%
2017	Sep	354,894.1	\$10,508,379	\$21.98	\$29.61	74.2%
	Jan-Sep	3,417,938.1	\$74,110,345	\$15.75	\$21.74	72.6%

The capability, performance, and opportunity cost components of the cost of regulation are shown in Table 10-44. Total scheduled regulation is based on settled performance adjusted MW. In the first nine months of 2017, the monthly average total cost of regulation was \$21.74, 14.4 percent higher than \$19.01 in the first nine months of 2016. In the first nine months of 2017, the monthly average capability component cost of regulation was \$13.30, 12.5 percent lower than \$15.19 in the first nine months of 2016. In the first nine months of 2017, the monthly average performance component cost of regulation was \$6.79, 195.9 percent higher than \$2.30 in the first nine months of 2016

⁷³ Weighted average market clearing prices presented here are taken from PJM settlements data, and differ from the values reported in Table 10-42, which are from five minute interval operational data. The MMU is investigating the cause of the discrepancies with PJM.

Table 10-44 Components of regulation cost, January 1, 2016, through September 30, 2017

Year	Month	Scheduled Regulation (MW)	Cost of Regulation Capability (\$/MW)	Cost of Regulation Performance (\$/MW)	Opportunity Cost (\$/MW)	Total Cost (\$/MW)
	Jan	412,599.7	\$14.49	\$1.97	\$1.95	\$18.41
	Feb	383,918.8	\$16.00	\$2.61	\$1.40	\$20.01
	Mar	396,882.6	\$12.01	\$2.25	\$1.14	\$15.40
	Apr	384,853.5	\$17.38	\$2.70	\$1.67	\$21.76
	May	391,328.7	\$13.56	\$3.50	\$1.39	\$18.45
2016	Jun	379,273.1	\$13.33	\$1.38	\$1.10	\$15.81
	Jul	386,423.4	\$16.52	\$2.27	\$1.80	\$20.60
	Aug	386,057.1	\$16.74	\$1.66	\$1.56	\$19.96
	Sep	376,493.8	\$16.68	\$2.32	\$1.68	\$20.67
	Oct	389,241.0	\$14.11	\$2.73	\$1.19	\$18.04
	Nov	374,665.6	\$11.28	\$3.11	\$1.03	\$15.42
	Dec	391,549.0	\$10.14	\$1.73	\$1.25	\$13.11
	Yearly	4,653,286.2	\$14.35	\$2.35	\$1.43	\$18.14
	Jan-Sep	3,497,830.6	\$15.19	\$2.30	\$1.52	\$19.01
	Jan	395,801.8	\$13.19	\$2.43	\$1.69	\$17.31
	Feb	356,168.1	\$9.91	\$3.68	\$1.38	\$14.97
	Mar	375,627.5	\$13.93	\$6.99	\$1.98	\$22.91
	Apr	371,527.5	\$12.94	\$9.78	\$1.64	\$24.36
2017	May	367,839.9	\$16.77	\$5.78	\$1.77	\$24.31
	Jun	386,015.3	\$10.81	\$7.95	\$1.26	\$20.02
	Jul	406,828.4	\$13.19	\$6.37	\$1.82	\$21.38
	Aug	403,235.5	\$10.10	\$9.34	\$1.38	\$20.82
	Sep	354,894.1	\$18.83	\$8.81	\$1.96	\$29.61
	Jan-Sep	3,417,938.1	\$13.30	\$6.79	\$1.65	\$21.74

Table 10-45 provides a comparison of the average price and cost for PJM regulation. The ratio of regulation market price to the actual cost of regulation in the first nine months of 2017 was 72.6 percent, a 14.4 percent decrease from 87.0 percent in the first nine months of 2016.


Table 10-45 Comparison of average price and cost for PJM regulation: January through September, 2009 through 2017

Year (Jan-Sep)	Weighted Regulation Market Price	Weighted Regulation Market Cost	Regulation Price as Percent Cost
2009	\$24.94	\$32.28	77.3%
2010	\$19.47	\$34.54	56.4%
2011	\$17.04	\$32.70	52.1%
2012	\$15.16	\$21.07	71.9%
2013	\$33.29	\$38.49	86.5%
2014	\$50.19	\$60.94	82.4%
2015	\$35.56	\$43.00	82.7%
2016	\$16.52	\$18.99	87.0%
2017	\$15.70	\$21.68	72.4%

Performance Standards

PJM's performance as measured by CPS1 and BAAL standards is shown in Figure 10-29 for every month from January 2011 through June 2017 with the dashed vertical line marking the date (October 1, 2012) of the implementation of the Performance Based Regulation Market design.⁷⁴ The horizontal dashed lines represent PJM internal goals for CPS1 and BAAL performance. While PJM did not meet its internal goal for BAAL performance in January 2014, PJM remained in compliance with the applicable NERC standards.

Figure 10-29 PJM monthly CPS1 and BAAL performance: January 1, 2011 through September 30, 2017

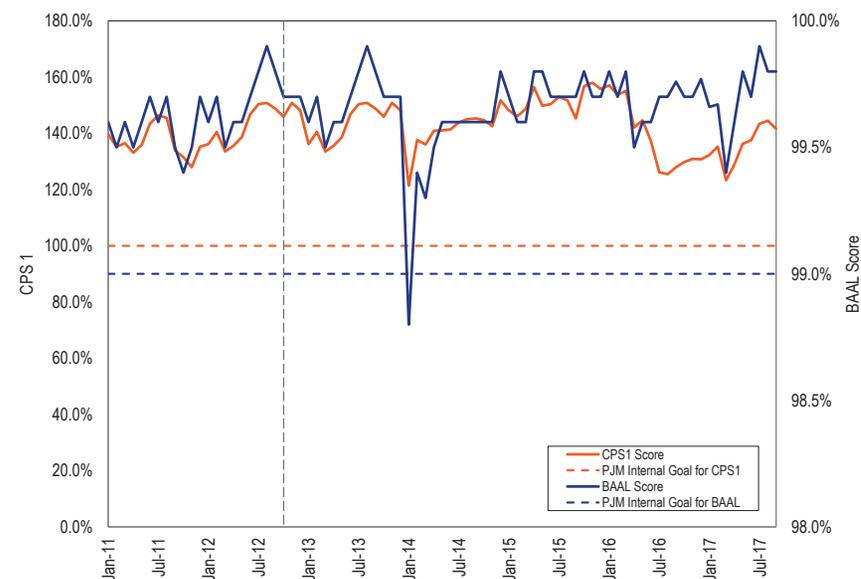

Black Start Service

Black start service is necessary to ensure the reliable restoration of the grid following a blackout. Black start service is the ability of a generating unit to start without an outside electrical supply, or the demonstrated ability of a generating unit to automatically remain operating when disconnected from the grid.

PJM does not have a market to provide black start service, but compensates black start resource owners on the basis of an incentive rate or for the costs associated with providing this service.

PJM defines required black start capability zonally, while recognizing that the most effective way to provide black start service may be across zones,

⁷⁴ See 2016 State of the Market Report for PJM, Appendix F: Ancillary Services.

and ensures the availability of black start service by charging transmission customers according to their zonal load ratio share and compensating black start unit owners. Substantial rule changes to the black start restoration and procurement strategy were implemented on February 28, 2013, following a stakeholder process in the System Restoration Strategy Task Force (SRSTF) and the Markets and Reliability Committee (MRC) that approved the PJM and MMU joint proposal for system restoration. These changes gave PJM substantial flexibility in procuring black start resources and made PJM responsible for black start resource selection.

On July 1, 2013, PJM initiated its first RTO-wide request for proposals (RFP) under the new rules.⁷⁵ ⁷⁶ PJM identified zones with black start shortages and began awarding contracts on January 14, 2014. PJM and the MMU coordinated closely during the selection process.

PJM issued two additional RFPs in 2014. On April 11, 2014, PJM sought additional black start in the AEP Zone and one proposal was selected. On November 24, 2014, PJM sought additional black start in northeastern Ohio and western Pennsylvania, but no proposals were selected because they did not meet the bid requirements. On July 28, 2015, PJM issued an Incremental Request for Proposals, for northeastern Ohio and western Pennsylvania together. On August 8, 2016, PJM made one award which will cover both areas.

Black start payments are nontransparent payments made to units by load to maintain adequate reliability to restart the system in case of a blackout. Current rules appear to prevent publishing detailed data regarding these black start resources, hindering transparency and competitive replacement RFPs. In 2014, zonal reporting of black start payments was implemented, partially fulfilling the recommendation.

Total black start charges are the sum of black start revenue requirement charges and black start operating reserve charges. Black start revenue requirements for black start units consist of fixed black start service costs, variable black start

service costs, training costs, fuel storage costs, and an incentive factor. Section 18 of Schedule 6A of the OATT specifies how to calculate each component of the revenue requirement formula. Black start resources can choose to recover fixed costs under a formula rate based on zonal Net CONE and unit ICAP rating, a cost recovery rate based on incremental black start NERC-CIP compliance capital costs, or a cost recovery rate based on incremental black start equipment capital costs. Black start operating reserve charges are paid to units scheduled in the Day-Ahead Energy Market or committed in real time to provide black start service under the automatic load rejection (ALR) option or for black start testing. Total black start charges are allocated monthly to PJM customers proportionally to their zone and nonzone peak transmission use and point to point transmission reservations.⁷⁷

In the first nine months of 2017, total black start charges were \$46.9 million, a decrease of \$4.78 million (-9.2 percent) from the same period of 2016. Operating reserve charges for black start service increased from \$0.180 million in 2016 to \$0.182 million in 2017. Table 10-46 shows total revenue requirement charges from 2010 through 2017. Prior to December 2012, PJM did not define a black start operating reserve category. As a result of the changes in the black start operating reserve category, 2013 was the first full year in which operating reserve charges were allocated to black start, resulting in the increase in operating reserve charges. Starting in 2014, the ALR black start units began to be replaced with new black start units, resulting in a decline in operating reserve charges. As of April 2015 all ALR units had been replaced and no longer provided black start service. Prior to December 2012, operating reserve charges resulting from units providing black start service were allocated as operating reserve charges for reliability in the western region.

⁷⁵ See PJM, "RTO-Wide Five-Year Selection Process Request for Proposal for Black Start Service," (July 1, 2013).

⁷⁶ RFPs issued can be found on the PJM website. See PJM. <<http://www.pjm.com/markets-and-operations/ancillary-services.aspx>>.

⁷⁷ OATT Schedule 6A (paras. 25, 26 and 27 outline how charges are to be applied).

Table 10-46 Black start revenue requirement charges: January 1 through September 30, 2010 through 2017

Year	Revenue Requirement Charges	Operating Reserves Charges	Total
2010	\$7,510,928	\$0	\$7,510,928
2011	\$8,654,215	\$0	\$8,654,215
2012	\$11,490,631	\$0	\$11,490,631
2013	\$13,989,520	\$61,518,802	\$75,508,322
2014	\$15,815,883	\$22,785,301	\$38,601,184
2015	\$34,142,507	\$5,069,722	\$39,212,229
2016	\$45,605,755	\$180,265	\$45,786,021
2017	\$46,767,195	\$181,926	\$46,949,121

Black start zonal charges in the first nine months of 2017 ranged from \$0.05 per MW-day in the DLCO Zone (total charges were \$33,750) to \$4.27 per MW-day in the PENELEC Zone (total charges were \$3,016,578). For each zone, Table 10-47 shows black start charges, the sum of monthly zonal peak loads multiplied by the number of days of the month in which the peak load occurred, and black start rates (calculated as charges per MW-day). For black start service, point-to-point transmission customers paid on average \$1.18 per MW of reserve capacity during the first nine months of 2017.

Table 10-47 Black start zonal charges for network transmission use: January 1 through September 30, 2016 and 2017

Zone	Jan-Sep 2016						Jan-Sep 2017					
	Revenue Requirement Charges	Operating Reserve Charges	Total Charges	Peak Load (MW)	Days	Black Start Rate (\$/MW-day)	Revenue Requirement Charges	Operating Reserve Charges	Total Charges	Peak Load (MW)	Days	Black Start Rate (\$/MW-day)
AECO	\$1,745,007	\$9,224	\$1,754,230	2,553	274	\$2.51	\$1,769,087	\$5,349	\$1,774,436	2,380	273	\$2.73
AEP	\$11,938,798	\$22,540	\$11,961,338	24,725	274	\$1.77	\$11,605,846	\$36,723	\$11,642,569	20,005	273	\$2.13
AP	\$3,024,958	\$2,304	\$3,027,262	9,594	274	\$1.15	\$2,571,139	\$1,394	\$2,572,532	7,759	273	\$1.21
ATSI	\$2,258,046	\$1,974	\$2,260,021	12,356	274	\$0.67	\$2,013,123	\$0	\$2,013,123	11,351	273	\$0.65
BGE	\$5,512,091	\$3,069	\$5,515,161	6,712	274	\$3.00	\$3,540,226	\$3,310	\$3,543,536	5,876	273	\$2.21
ComEd	\$3,633,698	\$24,735	\$3,658,432	20,162	274	\$0.66	\$3,243,260	\$15,010	\$3,258,270	18,848	273	\$0.63
DAY	\$177,715	\$8,784	\$186,499	3,281	274	\$0.21	\$166,287	\$9,966	\$176,253	2,974	273	\$0.22
DEOK	\$865,047	\$586	\$865,633	5,123	274	\$0.62	\$693,849	\$2,057	\$695,906	4,725	273	\$0.54
Dominion	\$2,658,236	\$20,361	\$2,678,597	21,651	274	\$0.45	\$2,862,391	\$28,576	\$2,890,967	17,391	273	\$0.61
DPL	\$1,217,655	\$7,978	\$1,225,632	4,114	274	\$1.09	\$1,515,092	\$5,393	\$1,520,485	3,673	273	\$1.52
DLCO	\$38,048	\$0	\$38,048	2,804	274	\$0.05	\$33,750	\$0	\$33,750	2,489	273	\$0.05
EKPC	\$281,004	\$0	\$281,004	3,490	274	\$0.29	\$274,344	\$0	\$274,344	2,562	273	\$0.39
JCPL	\$5,131,573	\$0	\$5,131,573	5,818	274	\$3.22	\$4,536,914	\$9,358	\$4,546,272	5,300	273	\$3.14
Met-Ed	\$446,028	\$44,848	\$490,876	2,798	274	\$0.64	\$387,055	\$37,512	\$424,566	2,624	273	\$0.59
PECO	\$1,193,965	\$1,253	\$1,195,218	8,094	274	\$0.54	\$1,071,896	\$1,777	\$1,073,673	7,445	273	\$0.53
PENELEC	\$3,402,344	\$3,372	\$3,405,716	3,024	274	\$4.11	\$3,014,955	\$1,623	\$3,016,578	2,590	273	\$4.27
Pepco	\$1,899,415	\$19,951	\$1,919,366	6,268	274	\$1.12	\$1,677,856	\$12,426	\$1,690,281	5,860	273	\$1.06
PPL	\$845,429	\$0	\$845,429	8,055	274	\$0.38	\$802,979	\$0	\$802,979	6,253	273	\$0.47
PSEG	\$3,160,022	\$2,303	\$3,162,325	9,595	274	\$1.20	\$2,781,080	\$2,805	\$2,783,885	8,723	273	\$1.17
RECO	\$0	\$0	\$0	NA/	274	NA	\$0	\$0	\$0	NA	273	NA
(Imp/Exp/Wheels)	\$2,115,484	\$6,984	\$2,122,468	6,829	274	\$1.13	\$2,206,067	\$8,649	\$2,214,716	6,884	273	\$1.18
Total	\$51,544,562	\$180,265	\$51,724,827	167,047		\$1.13	\$46,767,195	\$181,926	\$46,949,121	145,710		\$1.18

Figure 10-30 Oil tank MTSL not changed from addition of black start generator

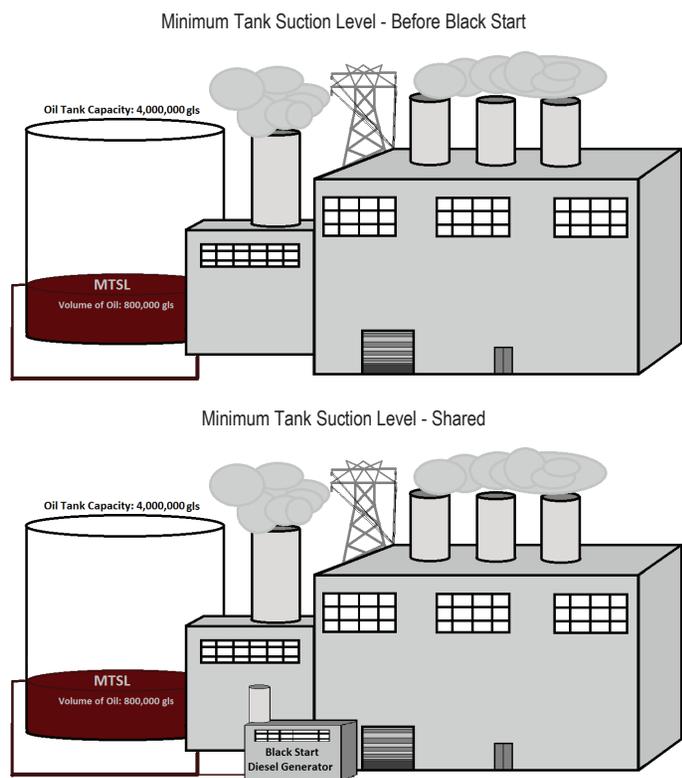


Figure 10-31 Oil tank black start MTSL portion

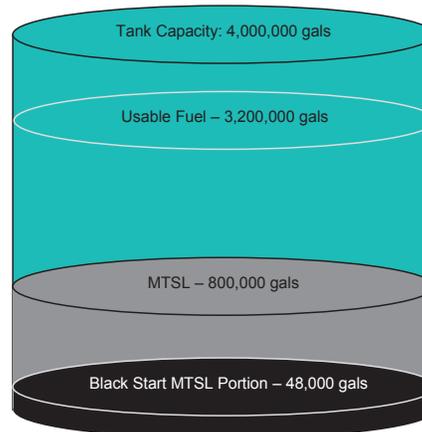


Table 10-48 provides a revenue requirement estimate by zone for the 2016/2017, 2017/2018 and 2018/2019 delivery years.⁷⁸ Revenue requirement values are rounded up to the nearest \$50,000 to reflect uncertainty about future black start revenue requirement costs. These values are illustrative only. The estimates are based on the best available data including current black start unit revenue requirements, expected black start unit termination and in-service dates, and owner provided cost estimates of incoming black start units, at the time of publication and may change significantly.

NERC – CIP

Currently, no black start units have requested new or additional black start NERC – CIP Capital Costs.⁷⁹

⁷⁸ The System Restoration Strategy Task Force requested that the MMU provide estimated black start revenue requirements.

⁷⁹ OATT Schedule 6A para. 21. "The Market Monitoring Unit shall include a Black Start Service summary in its annual State of the Market report which will set forth a descriptive summary of the new or additional Black Start NERC-CIP Capital costs requested by Black Start Units, and include a list of the types of capital costs requested and the overall cost of such capital improvements on an aggregate basis such that no data is attributable to an individual Black Start Unit."

Minimum Tank Suction Level (MTSL)

Some units that participate in the PJM Energy Market have oil tanks. All oil tanks at PJM units have a MTSL regardless of whether the units provide black start service (unless they use direct current pumps). The MTSL is the amount of fuel at the bottom of a tank which cannot be recovered for use.

PJM has required that customers pay black start unit owners carrying cost recovery for one hundred percent of the MTSL for tanks which are shared with units in the energy market. These tanks were sized to meet the needs of the generating units, which use significantly more fuel than the black start units. In some instances the MTSL is greater than the total amount of fuel that the black start unit needs to operate to meet its black start obligations. When a black start diesel is added at the site of an oil-fired generating unit, the additional MTSL is zero.

Figure 10-30 illustrates how the size of the oil tank does not change with the addition of the black start unit. Figure 10-31 shows how the MTSL could be proportionally divided between the generator and the black start unit. The tank is 4,000,000 gallons with an MTSL of 800,000 gallons leaving 3,200,000 gallons of usable fuel. The black start unit running 16 hours using 12,000 gallons per hour would need a total of 192,000 gallons, or six percent of the total usable fuel. Assigning six percent of the MTSL (800,000 gallons) would yield 48,000 gallons which could be assigned to the black start proportion for the MTSL.

The MMU recommends that for oil tanks which are shared with other resources that only a proportionate share of the MTSL be allocated for black start units. The MMU further recommends that the PJM tariff be updated to clearly state how the MTSL will be calculated for black start units sharing oil tanks.

Table 10-48 Black start zonal revenue requirement estimate: 2017/2018 through 2019/2020 delivery years

Zone	2017 / 2018 Revenue Requirement	2018 / 2019 Revenue Requirement	2019 / 2020 Revenue Requirement
AECO	\$2,900,000	\$2,850,000	\$2,850,000
AEP	\$19,000,000	\$18,750,000	\$18,800,000
AP	\$4,100,000	\$4,100,000	\$4,100,000
ATSI	\$3,150,000	\$3,150,000	\$3,150,000
BGE	\$2,050,000	\$500,000	\$450,000
ComEd	\$5,200,000	\$4,400,000	\$4,550,000
DAY	\$300,000	\$200,000	\$250,000
DEOK	\$1,100,000	\$400,000	\$400,000
DLCO	\$100,000	\$1,150,000	\$2,250,000
Dominion	\$4,450,000	\$3,650,000	\$3,650,000
DPL	\$2,400,000	\$2,300,000	\$2,300,000
EKPC	\$450,000	\$350,000	\$350,000
JCPL	\$7,200,000	\$7,100,000	\$7,100,000
Met-Ed	\$700,000	\$550,000	\$550,000
PECO	\$1,800,000	\$1,450,000	\$1,450,000
PENELEC	\$4,800,000	\$4,650,000	\$4,650,000
Pepco	\$2,650,000	\$2,600,000	\$2,600,000
PPL	\$1,300,000	\$1,200,000	\$1,200,000
PSEG	\$4,350,000	\$4,300,000	\$4,300,000
RECO	\$0	\$0	\$0
Total	\$68,000,000	\$63,650,000	\$64,950,000

Reactive Service

Suppliers of reactive power are compensated separately for reactive capability, day-ahead operating reserves, and for real-time lost opportunity costs. Compensation for reactive capability must be approved by FERC per Schedule 2 of the OATT. Generators may obtain FERC approval to recover a share of units' fixed costs by calculating a reactive revenue requirement, the reactive capability rate, and to collect such rates from PJM transmission customers.⁸⁰

Any reactive service provided operationally that involves a MW reduction outside of its normal operating range or a startup for reactive power will be logged by PJM operators and awarded uplift or LOC credits.

⁸⁰ See PJM, "Manual 27: Open Access Transmission Tariff Accounting," Rev. 87, (February 1, 2017) at 3.

Reactive Service, Reactive Supply and Voltage Control are provided by generation and other sources of reactive power (such as static VAR compensators and capacitor banks).⁸¹ While a fixed requirement for reactive power is not established, reactive power helps maintain appropriate voltages on the transmission system.

Total reactive capability charges are the sum of FERC approved reactive supply revenue requirements which are posted monthly on the PJM website.⁸² Zonal reactive supply revenue requirement charges are allocated monthly to PJM customers proportionally to their zone and to any nonzone (i.e. outside of the PJM Region) peak transmission use and point to point transmission reservations.⁸³

In 2016, the FERC began to reexamine its policies on reactive compensation.⁸⁴ Changes in the default capabilities of generators, disparities between nameplate values and tested values and questions about the way the allocation factors have been calculated have called continued reliance on the *AEP* method into question.⁸⁵ The continued use of fleet rates rather than unit specific rates is also an issue.

Recommended Market Approach to Reactive Costs

The best approach for recovering reactive capability costs is through markets where markets are available as they are in PJM and some other RTOs/ISOs. The best approach for recovering reactive capability costs in PJM is through the capacity market. The capacity market already incorporates reactive costs and reactive revenues. The treatment of reactive costs in the PJM market needs to be modified so that the capacity market incorporates reactive costs and revenues in a more efficient manner.

81 OATT Schedule 2.

82 See PJM, Markets & Operations: Billing, Settlements & Credit, "Reactive Revenue Requirements," <<http://www.pjm.com/~media/markets-ops/settlements/reactive-revenue-requirements-table-may-2016.ashx>> (June 8, 2016).

83 OATT Schedule 2.

84 See *Reactive Supply Compensation in Markets Operated by Regional Transmission Organizations and Independent System Operators*, Docket No. AD16-17-000 (March 17, 2016) (Notice of Workshop).

85 See 88 FERC ¶ 61,141 (1999).

Reactive capability is an integral part of all generating units; no generating unit is built without reactive capability.⁸⁶ There is no reason that the fixed costs of reactive capability either can be or should be separated from the total fixed costs of a generating unit. There is no reason that reactive capability should be compensated outside the markets when the units participate in organized markets. Reactive capability is a precondition for participating in organized markets. Resources must invest in the equipment needed to have minimum reactive capability as a condition of receiving interconnection service from PJM and other markets.⁸⁷ The Commission has recently extended the interconnection service requirement to have reactive capability to wind and solar units, which previously had been exempt.⁸⁸ Reactive capability is a requirement for participating in organized markets and is therefore appropriately treated as part of the gross Cost of New Entry in organized markets.

PJM requires a power factor of at least 0.95 leading to 0.90 lagging for synchronous units and at least 0.95 leading to 0.95 lagging for nonsynchronous units.⁸⁹ The regulations specify a minimum power factor range of 0.95 leading and 0.95 lagging power factor unless the market operators' rules specify otherwise.⁹⁰

There are two ways to address the cost of reactive in the PJM market design.

Under the current capacity market rules, the gross costs of the entire plant, including any reactive costs, are included in the gross Cost of New Entry (CONE) and the revenues from reactive service capability rates are an offset

86 See *Reactive Power Requirements for Non-Synchronous Generation*, Order No. 827, 155 FERC ¶ 61,277 at P 9 (2016) ("[T]he equipment needed for a wind generator to provide reactive power has become more commercially available and less costly, such that the cost of installing equipment that is capable of providing reactive power is comparable to the costs of a traditional generator.")

87 See 18 CFR § 35.28(f)(1); *Standardization of Generator Interconnection Agreements and Procedures*, Order No. 2003, FERC Stats. & Regs. ¶ 31,146, Appendix G (Large Generator Interconnection Agreement (LGIA)), *order on reh'g*, Order No. 2003-A, FERC Stats. & Regs. ¶ 31,160, *order on reh'g*, Order No. 2003-B, FERC Stats. & Regs. ¶ 31,171 (2004), *order on reh'g*, Order No. 2003-C, FERC Stats. & Regs. ¶ 31,190 (2005), *aff'd sub nom. Nat'l Ass'n of Regulatory Util. Comm'rs v. FERC*, 475 F.3d 1277 (D.C. Cir. 2007), *cert. denied*, 552 U.S. 1230 (2008); *Standardization of Small Generator Interconnection Agreements and Procedures*, Order No. 2006, FERC Stats. & Regs. ¶ 31,180, Attachment F (Small Generator Interconnection Agreement), *order on reh'g*, Order No. 2006-A, FERC Stats. & Regs. ¶ 31,196 (2005), *order granting clarification*, Order No. 2006-B, FERC Stats. & Regs. ¶ 31,221 (2006).

88 *Reactive Power Requirements for Non-Synchronous Generation*, Order No. 827, 155 FERC ¶ 61,277 (2016); see also 151 FERC ¶ 61,097 at P 28 (2015).

89 See OATT Attachment O Appendix 2 § 4.7.

90 See LGIA Article 9.6.1 ("Interconnection Customer shall design the Large Generating Facility to maintain a composite power delivery at continuous rated power output at the Point of Interconnection at a power factor within the range of 0.95 leading to 0.95 lagging, unless Transmission Provider has established different requirements that apply to all generators in the Control Area on a comparable basis.")

to the gross CONE. The result is that, conceptually, the cost of reactive is not part of net CONE.⁹¹ This is logically consistent with the separate collection of reactive costs through a cost of service rate in that there is no double counting if the revenue offset is done accurately. Under this approach there is a separate collection of reactive capability costs. This approach also requires that any capacity resource calculating unit specific net revenues must include the cost of service reactive revenues in the calculation.

An alternative approach to the current treatment of reactive costs in the capacity market would be to include the gross costs of the entire plant including any reactive costs in the gross Cost of New Entry (CONE) but to calculate net CONE without a reactive revenue offset for reactive service capability rates. The result of this approach would be that the cost of reactive is part of net CONE. This is logically consistent with the elimination of the separate collection of reactive costs through a cost of service rate in that there is no double counting if done accurately. Under this approach there would be no separate collection of reactive capability costs.

PJM currently uses the first approach. There is no reason that PJM could not easily implement the second approach.

The second approach is preferable. The second approach relies on competitive markets to provide incentives to provide energy, both real and reactive, at the lowest possible cost. The second approach provides a consistent and nondiscriminatory approach to compensation, avoiding reliance on a large number of costly and sporadic ratemaking proceedings. The second approach does not require the use of arbitrary, approximate and generally inaccurate allocators to determine the cost of providing reactive. The second approach does not require the use of estimated, average and inaccurate net reactive revenue offsets to calculate Net CONE. It is critical in the PJM Capacity Market that Net CONE be as accurate as possible. Only the second approach assures this.

Units are compensated for reactive capability costs under the second approach. **But the compensation is based on the outcome of a competitive capacity**

⁹¹ See OATT Attachment DD § 5.10(a)(iv).

market rather than based on current or historical cost of service filings for units or fleets of units.

The first approach, although internally logically consistent, relies on unnecessary and inaccurate approximations. The reactive allocator is such an approximation. The reactive revenue offset is an inaccurate estimate based on historical data from reactive revenue requirement filings. The reactive revenues used in the net CONE calculation are based on an average of reactive filings over the three years from 2005 through 2007 and therefore do not reflect even the allocated reactive costs and revenues for a new unit, as would be required to be consistent with the CONE logic.⁹² To the extent that the reactive portion of the Net Energy and Ancillary Services Offset is inaccurate, the net CONE is inaccurate.

The reactive revenue offset is set equal to \$ 2,199/MW-year in the OATT.⁹³ This figure is the average annual reactive revenue for combustion turbines from 2005 through 2007, based on the actual costs reported to the Commission in reactive service filings of CTs, as developed by the MMU.

The Net Cost of New Entry is a key parameter in the PJM Capacity Market as it affects the location of the VRR or demand curve and thus has a direct impact on capacity market prices.⁹⁴

If revenues for reactive capacity were removed from the Net Energy and Ancillary Services Revenue Offset, then the fixed costs for investment in reactive capability would be recoverable through the capacity market. By employing a simple and direct approach using CONE with no offset, the rules for cost of service compensation included in Schedule 2 could be eliminated and the requirement for cost of service filings would be eliminated.

⁹² OATT Attachment DD § 5.10(a)(v)(A) ("The Office of the Interconnection shall determine the Net Energy and Ancillary Services Revenue Offset each year for the PJM Region as (A) the annual average of the revenues that would have been received by the Reference Resource from the PJM energy markets during a period of three consecutive calendar years preceding the time of the determination, based on (1) the heat rate and other characteristics of such Reference Resource; (2) fuel prices reported during such period at an appropriate pricing point for the PJM Region with a fuel transmission adder appropriate for such region, as set forth in the PJM Manuals, assumed variable operation and maintenance expenses for such resource of \$6.47 per MWh, and actual PJM hourly average Locational Marginal Prices recorded in the PJM Region during such period; and (3) an assumption that the Reference Resource would be dispatched for both the Day-Ahead and Real-Time Energy Markets on a Peak-Hour Dispatch basis; plus (B) ancillary service revenues of \$2,199 per MW-year.")

⁹³ *Id.*

⁹⁴ *Id.*

As a result of the nature of reactive filings, it is not possible to identify the reactive capability revenues for all individual units that receive reactive capability revenues. As a result, the offer caps in the capacity market are not as accurate as they should be.

Relying on capacity markets instead of cost of service allocations would enhance competition and efficient pricing.

Actual experience with the cost of service approach suggests that customers would be better off under a competition based approach. The Commission's recent investigations into particular rates raises questions about the accuracy and basis of rates currently charged for reactive capability.

Cost of service ratemaking creates unnecessary monitoring difficulties. Because service providers do not have to file rates periodically, suppliers have no incentive to adjust reactive capability rates except when they increase. Suppliers have direct access to information about the costs for their own units. The Commission and other parties do not have such access. When rates are established on a fleet basis or result from a black box settlement, the ability of parties to review and challenge rates is further reduced.

The current FERC review provides an excellent opportunity to discard an anachronistic cost of service approach that has not been working well and that is inconsistent with markets and is unnecessary in organized markets.⁹⁵ Increased reliance on markets for the recovery of reactive capability costs would promote efficiency and consistency. Customers, market administrators and regulators will be better served by a simpler and more effective competition based approach.

The MMU recommends that separate payments for reactive capability be eliminated and the cost of reactive capability be recovered in the capacity market.

⁹⁵ See FERC Docket No. AD16-17-000.

Improvements to Current Approach

If OATT Schedule 2 reactive capability payments are not eliminated, then the MMU recommends, at a minimum, that steps be taken to ensure that payments are based on capability that is measured in tests performed by PJM or demonstrated in market data showing actual reactive output and based on capability levels that are useful to PJM system operators to maintain system stability. FERC has initiated a number of investigations into the basis for reactive rates, and the MMU has intervened in and is participating in those proceedings.⁹⁶

Under the *AEP* method, units must establish their MVAR rating based on “the capability of the generators to produce VAr.”⁹⁷ Typically this has meant reliance on manufacturers' specified nameplate power factor.⁹⁸ More recently, the Commission has, in the *Wabash* Orders, required that “reactive power revenue requirement filings must include reactive power test reports.”⁹⁹ Noting a difference between tested reactive MVAR ratings and nameplate MVAR ratings, the Commission has, in a number of cases, set the issue of MVAR rating degradation for hearing.¹⁰⁰

The Commission has identified a significant issue. Tests are essential to “evaluate and analyze” proposed reactive revenue requirements.¹⁰¹ The MVAR rating has a significant influence on the level of the requirements and should accurately reflect the MVAR capability actually available to maintain reliability.

There is no reason to use the nameplate MVAR rating to develop a reactive allocation and there is no basis in the *AEP* method for reliance on the nameplate MVAR rating. Nameplate reactive power ratings are generally higher than the actual ratings as defined by the PJM mandated tests of capability because

⁹⁶ See e.g., FERC Dockets Nos. EL16-32, EL16-44, EL16-51, EL16-54, EL16-65, EL16-66, EL16-79, EL16-89, EL16-90, EL16-98, EL16-72, EL16-100, EL16-103, EL16-118, EL16-1004, ER16-1456, ER16-2217, EL17-19, EL17-38, EL17-39, EL17-49, ER17-259 and ER17-801.

⁹⁷ *AEP* *mimeo* at 31.

⁹⁸ See, e.g., *id.*

⁹⁹ 154 FERC ¶ 61,246 at P 28 (2016); see also 154 FERC ¶ 61,246 at P 29 (*Wabash* Orders).

¹⁰⁰ See, e.g., *Talen Energy Marketing, LLC*, 154 FERC ¶ 61,087 at P 10 (2016) (“The Informational Filing contains information that raises concerns about the justness and reasonableness of Ironwood's reactive power rate, including, but not limited to, the degradation of the Facility's current MVAR capability as compared with the MVAR capability that was originally used to calculate the revenue requirement for Reactive Service included in Ironwood's reactive power rate.”).

¹⁰¹ 154 FERC ¶ 61,246 at P 28 (2016); see also 154 FERC ¶ 61,246 at P 29.

nameplate power ratings are generally calculated using leading and lagging power factors that are lower than are achievable when installed in a specific plant interconnected to a specific transmission network. Although this issue is characterized as degradation, the difference between pre installation nameplate ratings and post installation tested capability exists even when units are new. Testing reveals whether the tested capability changes. Reliance on tested results would address both the issue of degradation and the issue of theoretical versus actual MVAR ratings.

The logic of the *Wabash* orders should be extended to exclude manufacturers' nameplate MVAR ratings and the corresponding theoretical power factors. Nameplate MVAR ratings should not be relied upon to define the allocator used to calculate the costs of reactive capability. Current performance and testing show significant disparities between nameplate MVAR output and actual output. This is significant regardless of whether the cause is degradation of power factors or simply the difference between theoretical and tested power factors.¹⁰² PJM determined in 1999 that nameplate MVAR and power factor ratings do not reflect the value to the system operator of a unit's reactive output after it is interconnected at a specific location.¹⁰³ Only operator evaluation of reactive capability can provide a meaningful measure of reactive capability.

The information for MVAR ratings should come from data on the MVAR output provided. System operators can evaluate the usefulness and value of reactive capacity based on the actual availability and use of such capability.

Data from periodic testing for reactive capability is another approach to measuring MVAR output. Testing at relatively long intervals is not likely to be as accurate as actual market operations data, but it is more reliable than an untested and dated manufacturers' nameplate rating.

¹⁰² In response to a 1999 low voltage event, PJM performed a root cause analysis. The analysis concluded that "PJM narrowly avoided a voltage collapse" and that "if PJM had realized that the MVAR reserves that the EMS indicated were available were not realistic, other action could have been take [sic] to stabilize the system." PJM State & Member Training Dept., Slides, Reactive Reserves and Generator D-Curves at 13 (included as an Attachment) <<http://www.pjm.com/~media/training/nerc-certifications/gen-exam-materials/gof/20160104-reactive-reserves-and-d-curve.ashx>>.

¹⁰³ *Id.*, including Attachment.

The estimated capability costs also include estimated heating losses relative to MVAR output.¹⁰⁴ Heating losses are variable costs and not fixed costs and should not be included in the definition of reactive capability costs.¹⁰⁵ Heating losses can be accurately calculated for each hour of operation if each unit had an accurate, recent D-curve test. Heating losses are variable costs and should not be included in the cost of reactive capability. The production of reactive power slightly reduces the MWh output of the generator as the generator follows its D-curve. The value of this heating loss component is generally estimated based on estimated operation and associated estimated losses and estimated market prices, treated as a fixed cost, and included in the cost of reactive capability. Losses are minimal and occur during normal operations and should not be treated as a fixed cost. Losses can be better and more accurately accounted for as a variable cost based on actual unit operations and market conditions.

Reactive service is supplied during normal operation as needed and directed by PJM dispatchers. Most reactive service is provided with no impact to operational dispatch. When a need for reactive service requires that a unit's MW output be reduced outside of its normal operational range, or when a unit is started to provide reactive power, it is logged by PJM dispatchers and will be paid reactive service credits in the zone or zones where the reactive service was provided proportionally to their zone and nonzone peak transmission use and point to point transmission reservations.

Cost of service rates are established under Schedule 2 of the OATT and may cover rates for single units or a fleet of units.¹⁰⁶ Until the Commission took corrective action, fleet rates remained in place in PJM even when the actual units in the fleet changed as a result of unit retirements or sales of units.¹⁰⁷ New rules require unit owners to give notice of fleet changes in an informational filing or to file a new rate based on the remaining units, but do not yet require unit specific reactive rates.¹⁰⁸ Fleet rates should be eliminated. Compensation

¹⁰⁴ See, e.g., *id.* at P 10 n12, citing *PPL Energy Plus, LLC*, Letter Order, Docket No. ER08-1462-000 (Sept. 24, 2008); *Dynegy Midwest Generation, Inc.*, 125 FERC ¶ 61,280 at P 35 (2008).

¹⁰⁵ See Transcript, *Reactive Supply Compensation in Markets Operated by Regional Transmission System Operators Workshop*, AD16-17-000 (June 30, 2016) at 26:21–27:23.

¹⁰⁶ See, e.g., OATT Schedule 2; 114 FERC ¶ 61,318 (2006).

¹⁰⁷ See 149 FERC ¶ 61,132 (2014); 151 FERC ¶ 61,224 (2015); OATT Schedule 2.

¹⁰⁸ *Id.*

should be based on unit specific costs. Fleet rates make it almost impossible to monitor whether compensation for reactive capability is based on actual unit specific performance and costs.

To the extent that the Commission decides that PJM and other markets should continue to rely on a cost of service method to compensate reactive capability, the rules should be modified to improve the accuracy of the calculations of reactive capability cost. Rates that do not accurately reflect the cost of the service provided are not just and reasonable.

Reactive capability rate schedules must be accurate, and they must also coordinate properly with the PJM market rules. Revenues received for reactive capability are revenues for ancillary services that should be netted against avoidable costs whenever avoidable cost rate offers are submitted in RPM capacity market auctions.¹⁰⁹ Participants have not been properly including reactive revenues in capacity market offers, and the MMU has notified participants of its compliance concerns. The identification of revenues for reactive capability on a unit specific basis is necessary for the calculation of accurate avoidable cost rate offers and is needed to avoid disputes that could interfere with the orderly administration of RPM auctions. The MMU has sought to address this issue through participation in proceedings at FERC concerning reactive capability rates for PJM units.¹¹⁰

Reactive Costs

In the first nine months of 2017, total reactive charges were \$249.5 million, a 12.6 percent increase from the 2016 level of \$221.6 million.¹¹¹ Reactive service charges increased in the first nine months of 2017 to \$14.0 million from \$828.1 thousand in 2016. All \$14.0 million in 2017 were paid for reactive service provided by 31 units in 543 hours. The reason for the increase in reactive service charges from the first nine months in 2016 to 2017 is primarily due to the need to control regional voltages resulting from outages and locational loads.

¹⁰⁹ See OATT Attachment DD §§ 6.4, 6.8(d).

¹¹⁰ See, e.g., FERC Dockets Nos. EL16-44 et al.; EL16-1456; EL16-57 et al.; EL16-51 et al.; EL16-1004; EL16-32; EL16-72; EL16-66; EL16-65; EL16-54; EL16-90 et al.; EL16-103 et al.; EL16-89 et al.; EL16-98 et al.; EL16-79 et al.; EL16-80 et al.; EL16-81 et al.; EL16-82 et al.; EL16-83 et al.; EL16-2217 et al.; EL17-19; EL16-118.

¹¹¹ See 2015 State of the Market Report for PJM, Vol. 2, Section 4, "Energy Uplift."

Table 10-49 shows reactive service charges in 2016 and 2017, reactive capability revenue requirement charges and total charges.

Table 10-49 Reactive zonal charges for network transmission use: January 1 through September 30, 2016 and 2017

Zone	Jan-Sep 2016			Jan-Sep 2017		
	Reactive Service Charges	Reactive Capability Revenue Requirement Charges	Total Charges	Reactive Service Charges	Reactive Capability Revenue Requirement Charges	Total Charges
AECO	\$0	\$4,100,181	\$4,100,181	\$8,686	\$4,077,510	\$4,086,195
AEP	\$35,493	\$27,985,307	\$28,020,799	\$172,736	\$28,657,140	\$28,829,876
APS	\$0	\$12,490,982	\$12,490,982	\$135,676	\$12,384,032	\$12,519,709
ATSI	\$0	\$16,443,788	\$16,443,788	\$60,696	\$16,275,947	\$16,336,643
BGE	\$0	\$5,696,008	\$5,696,008	\$1,694,486	\$6,008,533	\$7,703,020
ComEd	\$1,091	\$19,941,655	\$19,942,745	\$7,535,612	\$24,379,843	\$31,915,455
DAY	\$0	\$6,382,228	\$6,382,228	\$15,845	\$5,509,864	\$5,525,709
DEOK	\$0	\$4,264,787	\$4,264,787	\$25,386	\$4,872,968	\$4,898,353
Dominion	\$16,427	\$22,436,415	\$22,452,842	\$120,722	\$24,878,192	\$24,998,913
DPL	\$712,627	\$9,128,961	\$9,841,587	\$748,342	\$8,623,103	\$9,371,444
DLCO	\$0	\$0	\$0	\$12,737	\$0	\$12,737
EKPC	\$0	\$1,620,466	\$1,620,466	\$12,013	\$1,608,259	\$1,620,272
JCPL	\$0	\$6,633,887	\$6,633,887	\$19,441	\$6,374,817	\$6,394,258
Met-Ed	\$15,071	\$4,631,539	\$4,646,610	\$68,170	\$4,182,570	\$4,250,740
PECO	\$0	\$13,343,032	\$13,343,032	\$103,510	\$12,829,527	\$12,933,036
PENELEC	\$32,108	\$6,070,926	\$6,103,034	\$1,641,212	\$8,028,226	\$9,669,437
Pepco	\$0	\$4,483,212	\$4,483,212	\$1,595,597	\$6,610,294	\$8,205,891
PPL	\$15,263	\$14,686,578	\$14,701,841	\$37,886	\$17,999,568	\$18,037,454
PSEG	\$0	\$27,212,928	\$27,212,928	\$37,255	\$26,374,116	\$26,411,371
RECO	\$0	\$0	\$0	\$1,239	\$0	\$1,239
(Imp/Exp/Wheels)	\$0	\$13,230,717	\$13,230,717	\$0	\$15,766,244	\$15,766,244
Total	\$828,078	\$220,783,599	\$221,611,677	\$14,047,245	\$235,440,752	\$249,487,997