

Environmental and Renewable Energy Regulations

Environmental requirements and renewable energy mandates have a significant impact on PJM markets.

The investments required for environmental compliance have resulted in higher offers in the Capacity Market, and in making the investments in some cases when those offers clear, and in the retirement of units in some cases when those offers do not clear. Environmental requirements and initiatives at both the federal and state levels and state renewable energy mandates and associated incentives have resulted in the construction of substantial amounts of renewable capacity in the PJM footprint, especially wind and solar resources. Renewable energy credit (REC) markets created by state programs, and federal tax credits have significant impacts on PJM wholesale markets. But state renewables programs in PJM are not coordinated with one another, are generally not consistent with the PJM market design or PJM prices, have widely differing objectives, have widely differing implied prices of carbon and are not transparent on pricing and quantities. The effectiveness of state renewables programs would be enhanced if they were coordinated with one another and with PJM markets, and increased transparency.

Overview

Federal Environmental Regulation

- **EPA Mercury and Air Toxics Standards Rule.** The U.S. Environmental Protection Agency's (EPA) Mercury and Air Toxics Standards rule (MATS) applies the Clean Air Act (CAA) maximum achievable control technology (MACT) requirement to new or modified sources of emissions of mercury and arsenic, acid gas, nickel, selenium and cyanide.¹ All coal steam units in PJM are compliant with the state and federal emissions limits established by MATS.
- **Air Quality Standards (NO_x and SO₂ Emissions).** The CAA requires each state to attain and maintain compliance with fine particulate matter (PM) and ozone national ambient air quality standards (NAAQS). The CAA also requires that each state

prohibit emissions that significantly interfere with the ability of another state to meet NAAQS.²

- **National Emission Standards for Reciprocating Internal Combustion Engines.** The national emissions standards uniformly apply to all RICE.³ All RICE are allowed to operate during emergencies, including declared Energy Emergency Alert Level 2 or five percent voltage/frequency deviations.⁴
- **Greenhouse Gas Emissions Rule.** On August 3, 2015, the EPA issued a final rule for regulating CO₂ from certain existing power generation facilities titled Carbon Pollution Emission Guidelines for Existing Stationary Sources: Electric Utility Generating Units (the Clean Power Plan).⁵ On February 9, 2016, the U.S. Supreme Court issued a stay of the rule that will prevent its taking effect until judicial review is completed.⁶ On October 10, 2017, the EPA proposed to repeal the Clean Power Plan based a determination that the Plan exceeds the EPA's authority under Section 111 of the EPAs Act.⁷
- **Cooling Water Intakes.** An EPA rule implementing Section 316(b) of the Clean Water Act (CWA) requires that cooling water intake structures reflect the best technology available for minimizing adverse environmental impacts.⁸

State Environmental Regulation

- **Regional Greenhouse Gas Initiative (RGGI).** The Regional Greenhouse Gas Initiative (RGGI) is a CO₂ emissions cap and trade agreement among Connecticut, Delaware, Maine, Maryland, Massachusetts, New Hampshire, New York, Rhode Island, and Vermont that applies to power generation facilities. New Jersey is in the process of resuming

¹ *National Emission Standards for Hazardous Air Pollutants From Coal and Oil-Fired Electric Utility Steam Generating Units and Standards of Performance for Fossil Fuel Fired Electric Utility, Industrial-Commercial-Institutional, and Small Industrial-Commercial-Institutional Steam Generating Units*, EPA Docket No. EPA-HQ-OAR-2009-0234, 77 Fed. Reg. 9304 (Feb. 16, 2012).

² CAA § 110(a)(2)(D)(i)(i).

³ EPA, Memorandum, Peter Tsirigotis Guidance on Vacatur of RICE NESHAP and NSPS Provisions for Emergency Engines (April 15, 2016).

⁴ See 40 CFR §§ 60.4211(f)(2)(ii)-(iii), 60.4243(d)(2)(ii)-(iii), and 63.6640(f)(2)(ii)-(iii) (Declared Energy Emergency Alert Level 2 or 5 percent voltage/frequency deviations); 40 CFR §§ 60.4211(f)(1), 60.4243(d)(1), and 63.6640(f)(1) ("There is no time limit on the use of emergency stationary ICE in emergency situations."); 40 CFR 60.4211(f)(3), 60.4243(d)(3), 63.6640(f)(3)-(4).

⁵ *Carbon Pollution Emission Guidelines for Existing Stationary Sources: Electric Utility Generating Units*, EPA-HQ-OAR-2013-0602, Final Rule mimeo (Aug. 3, 2015), also known as the "Clean Power Plan."

⁶ *North Dakota v. EPA*, et al., Order 15A793.

⁷ See *Repeal of Carbon Pollution Emission Guidelines for Existing Stationary Sources: Electric Utility Generating Units*, Proposed Rule, EPA Docket No. EPA-HQ-OAR-2017-0355, 82 Fed. Reg. 48035 (Oct. 16, 2017).

⁸ See EPA, *National Pollutant Discharge Elimination System—Final Regulations to Establish Requirements for Cooling Water Intake Structures at Existing Facilities and Amend Requirements at Phase I Facilities*, EPA-HQ-OW-2008-0667, 79 Fed. Reg. 48300 (Aug. 15, 2014).

participation.⁹ Virginia is making preparations to join.¹⁰ The auction price in the December 5, 2018, auction for the 2015/2018 compliance period was \$5.33 per ton. The clearing price is equivalent to a price of \$5.88 per metric tonne, the unit used in other carbon markets. The price increased by \$0.83 per ton, 18.4 percent, from \$4.50 per ton from September 9, 2018, to \$5.33 per ton for December 5, 2018.

- **Carbon Price.** If the price of carbon were \$50.00 per metric tonne, the short run marginal costs would increase by \$25.04 per MWh for a new combustion turbine (CT) unit, \$17.72 per MWh for a new combined cycle (CC) unit and \$43.15 per MWh for a new coal plant (CP).

State Renewable Portfolio Standards

Many states in PJM have enacted legislation to require that a defined percentage of retail suppliers' load be served by renewable resources, for which definitions vary. These are typically known as renewable portfolio standards, or RPS. As of December 31, 2018, Delaware, Illinois, Maryland, Michigan, New Jersey, North Carolina, Ohio, Pennsylvania, and Washington, DC had renewable portfolio standards. Virginia and Indiana had voluntary renewable portfolio standards. Kentucky and Tennessee did not have renewable portfolio standards.

Emissions Controls in PJM Markets

Environmental regulations affect decisions about emission control investments in existing units, investment in new units and decisions to retire units. As a result of environmental regulations and agreements to limit emissions, many PJM units burning fossil fuels have installed emission control technology. As of December 31, 2018, 93.6 percent of coal steam MW had some type of flue-gas desulfurization (FGD) technology to reduce SO₂ emissions, while 99.5 percent of coal steam MW had some type of particulate control, and 94.2 percent of fossil fuel fired capacity in PJM had NO_x emission control technology. All coal steam units in PJM are compliant with the state and federal emissions limits established by MATS.

⁹ Executive Order 7; see *Regional Greenhouse Gas Initiative*, State of New Jersey Department of Environmental Protection <<http://www.state.nj.us/dep/aqcs/rggi.html>>.

¹⁰ See Regulation for Emissions Trading, 9 VAC 5-140. The Virginia Air Pollution Control Board is developing the regulation and considering public comments.

Renewable Generation

Total wind and solar generation was 2.8 percent of total generation in PJM for 2018. Tier I generation was 4.5 percent of total generation in PJM and Tier II generation was 2.7 percent of total generation in PJM for 2018. Only Tier 1 generation is renewable.

Recommendations

- The MMU recommends that renewable energy credit markets based on state renewable portfolio standards be brought into PJM markets as they are an increasingly important component of the wholesale energy market. (Priority: Medium. First reported 2010. Status: Not adopted.)
- The MMU recommends that the Commission reconsider its disclaimer of jurisdiction over RECs markets because, given market changes since that decision, it is clear that RECs materially affect jurisdictional rates. (Priority: High. New recommendation. Status: Not adopted.)
- The MMU recommends that states consider the development of a multistate framework for RECs markets, for potential agreement on carbon pricing including the distribution of carbon revenues, and for coordination with PJM wholesale markets. (Priority: Medium. New recommendation. Status: Not adopted.)
- The MMU recommends that jurisdictions with a renewable portfolio standard make the price and quantity data on supply and demand more transparent. (Priority: Low. First reported Q2, 2018. Status: Not adopted.)

Conclusion

Environmental requirements and renewable energy mandates at both the federal and state levels have a significant impact on the cost of energy and capacity in PJM markets. Renewable energy credit (REC) markets are markets related to the production and purchase of wholesale power, but FERC has determined that RECs are not regulated under the Federal Power Act unless the REC is sold as part of a transaction that also includes a wholesale sale of electric energy in a

bundled transaction.¹¹ The MMU recommends that the Commission reconsider its disclaimer of jurisdiction over REC markets because, given market changes since that decision, it is clear that RECs materially affect jurisdictional rates.

RECs clearly affect prices in the PJM wholesale power market. Some resources are not economic except for the ability to purchase or sell RECs. RECs provide out of market payments to qualifying renewable resources, primarily wind and solar. The credits provide an incentive to make negative energy offers and more generally provide an incentive to enter the market, to remain in the market and to operate whenever possible. These subsidies affect the offer behavior and the operational behavior of these resources in PJM markets and in some cases the existence of these resources and thus the market prices and the mix of clearing resources.

REC markets are, as an economic fact, integrated with PJM markets including energy and capacity markets, but are not formally recognized as part of PJM markets. It would be preferable to have a single, transparent market for RECs operated by the PJM RTO that would meet the standards and requirements of all states in the PJM footprint including those with no RPS. This would provide better information for market participants about supply and demand and prices and contribute to a more efficient and competitive market and to better price formation. This could also facilitate entry by qualifying renewable resources by reducing the risks associated with lack of transparent market data. The MMU recommends that PJM states consider the development of a multistate framework for REC markets, for potential agreement on carbon pricing, and for coordination with PJM wholesale markets.

REC markets are not consistently or adequately transparent. Data on REC prices, clearing quantities and markets are not publicly available for all PJM states. The provision of more complete data would facilitate competition to provide energy from renewable sources.

The economic logic of RPS programs and the associated REC and SREC prices is not always clear. The price of carbon implied by REC prices ranges from \$4.67 per tonne in Washington, D.C. to \$35.41 per tonne in Pennsylvania. The price of carbon implied by SREC prices ranges from \$17.71 per tonne in Pennsylvania to \$812.07 per tonne in Washington, D.C. The effective prices for carbon compare to the 2018 average RGGI clearing price of \$4.86 per tonne and to the social cost of carbon which is estimated in the range of \$40 per tonne.¹² The impact on the cost of generation from a new combined cycle unit of an \$800 per tonne carbon price would be \$283.56 per MWh. The impact of a \$40 per tonne carbon price would be \$14.18 per MWh. This wide range of implied carbon prices is not consistent with an efficient, competitive, least cost approach to the reduction of emissions.

PJM markets provide a flexible mechanism for incorporating the costs of environmental controls and meeting environmental requirements in a cost effective manner. Costs for environmental controls are part of offers for capacity resources in the PJM Capacity Market. The costs of emissions credits are included in energy offers. PJM markets also provide a flexible mechanism that incorporates renewable resources and the impacts of renewable energy credit markets, and ensures that renewable resources have access to a broad market. PJM markets provide efficient price signals that permit valuation of resources with very different characteristics when they provide the same product.

PJM markets could also provide a flexible mechanism to limit carbon output, for example by incorporating a consistent carbon price in unit offers which would be reflected in PJM's economic dispatch. If there is a social decision to limit carbon output, a consistent carbon price would be the most efficient way to implement that decision. The states in PJM could agree, if they decided it was in their interests, with the appropriate information, on a carbon price and on how to allocate the revenues from a carbon price that would make all states better off. The MMU continues to recommend that PJM provide modeling information to the states adequate to inform such a decision making process. A carbon price would

¹¹ See 139 FERC ¶ 61,061 at PP 18, 22 (2012) (“[W]e conclude that unbundled REC transactions fall outside of the Commission’s jurisdiction under sections 201, 205 and 206 of the FPA. We further conclude that bundled REC transactions fall within the Commission’s jurisdiction under sections 201, 205 and 206 of the FPA... [A]lthough a transaction may not directly involve the transmission or sale of electric energy, the transaction could still fall under the Commission’s jurisdiction because it is ‘in connection with’ or ‘affects’ jurisdictional rates or charges.”)

¹² “Technical Update of the Social Cost of Carbon for Regulatory Impact Analysis – Under Executive Order 12899,” Interagency Working Group on the Social Cost of Greenhouse Gases, United States Government, (Aug, 2016), <https://19january2017snapshot.epa.gov/sites/production/files/2016-12/documents/sc_co2_tsd_august_2016.pdf>.

also be an alternative to specific subsidies to individual nuclear power plants and to the current wide range of implied carbon prices embedded in RPS programs and instead provide a market signal to which any resource could respond. The imposition of specific and prescriptive environmental dispatch rules would, in contrast, pose a threat to economic dispatch and efficient markets and create very difficult market power monitoring and mitigation issues. The provision of subsidies to individual units creates a discriminatory regime that is not consistent with competition. The use of inconsistent implied carbon prices by state is also inconsistent with an efficient market and inconsistent with the least cost approach to meeting state environmental goals.

Federal Environmental Regulation

The U.S. Environmental Protection Agency (EPA) administers the Clean Air Act (CAA). The CAA regulates air emissions by providing for the establishment of acceptable levels of emissions of hazardous air pollutants. The EPA issues technology based standards for major sources and area sources of emissions.^{13 14} EPA regulation of air quality covers:¹⁵

- **Control of Mercury and Other Hazardous Air Pollutants:** Section 112 of the CAA requires the EPA to promulgate emissions control standards, known as the National Emission Standards for Hazardous Air Pollutants (NESHAP), from both new and existing area and major sources. On December 21, 2011, the U.S. Environmental Protection Agency (EPA) issued its Mercury and Air Toxics Standards rule (MATS), which applies the CAA maximum achievable control technology (MACT) requirement to new or modified sources of emissions of mercury and arsenic, acid gas, nickel, selenium and cyanide. This rule remains under challenge in the courts, but the industry has already taken measures to come into compliance.
- **Air Quality Standards: Control of NO_x, SO₂ and O₃ Emissions Allowances:** The CAA requires each state to attain and maintain compliance with fine particulate matter and ozone national ambient air

quality standards (NAAQS). Under NAAQS, the EPA establishes emission standards for six air pollutants, including NO_x, SO₂, O₃ at ground level, PM, CO, and Pb, and approves state plans to implement these standards, known as State Implementation Plans (SIPs). In January, 2015, the EPA began implementation of the Cross-State Air Pollution Rule (CSAPR) to address the CAA's requirement that each state prohibit emissions that significantly interfere with the ability of another state to meet NAAQS. Implementation was delayed in the courts, but CSAPR is now fully effective. The CSAPR requires specific states in the eastern and central United States to reduce power plant emissions of SO₂ and NO_x that cross state lines and contribute to ozone and fine particle pollution in other states. The CSAPR requires reductions to levels consistent with the 1997 ozone and fine particle and 2006 fine particle NAAQS. The CSAPR covers 28 states, including all of the PJM states except Delaware, and also excluding the District of Columbia.

- **Emission Standards for Reciprocating Internal Combustion Engines:** On January 14, 2013, the EPA signed a final rule amending its rules regulating emissions from a wide variety of stationary reciprocating internal combustion engines (RICE). RICE include certain types of electrical generation facilities like diesel engines typically used for backup, emergency or supplemental power, including facilities located behind the meter. These rules include: National Emission Standard for Hazardous Air Pollutants (NESHAP) for Reciprocating Internal Combustion Engines (RICE); New Source Performance Standards (NSPS) of Performance for Stationary Spark Ignition Internal Combustion Engines; and Standards of Performance for Stationary Compression Ignition Internal Combustion Engines (collectively RICE Rules). The RICE Rules apply to emissions such as formaldehyde, acrolein, acetaldehyde, methanol, CO, NO_x, volatile organic compounds (VOCs) and PM. The regulatory regime for RICE is complicated, and the applicable requirements turn on whether the engine is an "area source" or "major source," and the starter mechanism for the engine (compression ignition or spark ignition).

¹³ 42 U.S.C. § 7401 et seq. (2000).

¹⁴ The EPA defines a "major source" as a stationary source or group of stationary sources that emit or have the potential to emit 10 tons per year or more of a hazardous air pollutant or 25 tons per year or more of a combination of hazardous air pollutants. An "area source" is any stationary source that is not a major source.

¹⁵ For more details, see the *2018 State of the Market Report for PJM*, Volume II, Appendix I: "Environmental and Renewable Energy Regulations."

The EPA's actions have and will continue to affect the cost to build and operate generating units in PJM, which in turn affects wholesale energy prices and capacity prices.

The EPA also administers the Clean Water Act (CWA), which regulates water pollution. The EPA implements the CWA through a permitting process, which regulates discharges from point sources that impact water quality and temperature in navigable waterways. In 2014, the EPA implemented new regulations for cooling water intakes under section 316(b) of the CWA.

CSAPR


CSAPR is a federal emissions trading program designed to address the CAA's requirement that each state prohibit emissions that significantly interfere with the ability of another state to meet NAAQS. CSAPR emissions prices may be compared with RGGI emissions prices.

Section 126 of the CAA permits a downwind state to file a petition with the EPA to regulate the emissions from particular resources in another state. On October 5, 2018, EPA denied petitions filed under this provision filed by Delaware and Maryland.¹⁶

Figure 8-1 shows average, monthly settled prices for NO_x, CO₂ and SO₂ emissions allowances including CSAPR related allowances for January 1, 2017 through December 31, 2018. Figure 8-1 also shows the average, monthly settled price for the Regional Greenhouse Gas Initiative (RGGI) CO₂ allowances.

In 2018, CSAPR annual NO_x prices were 6.9 percent lower than in 2017. The CSAPR Seasonal NO_x price hit a peak of \$710.12 in May 2017. The CSAPR Update resulted in fewer CSAPR Seasonal NO_x allowances.

Figure 8-1 Spot monthly average emission price comparison: 2017 through 2018

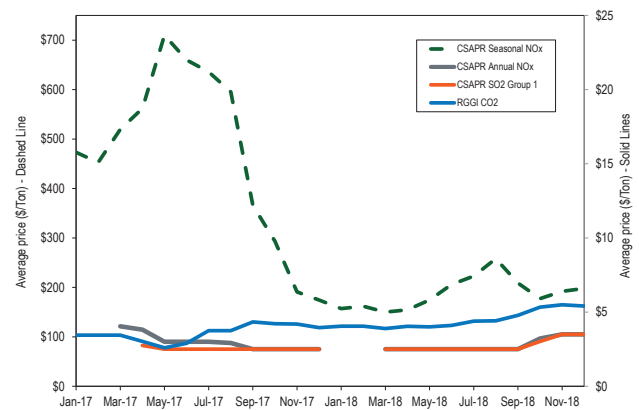

Federal Regulation of Greenhouse Gas Emissions

The EPA regulates CO₂ as a pollutant using CAA provisions that apply to pollutants not subject to NAAQS.^{17 18}

The U.S. Court of Appeals for the Seventh Circuit has determined that a government agency can reasonably consider the global benefits of carbon emissions reduction against costs imposed in the U.S. by regulations in analyses known as the “Social Costs of Carbon.”¹⁹ The Court rejected claims raised by petitioners that raised concerns that the Social Cost of Carbon estimates were arbitrary, were not developed through transparent processes, and were based on inputs that were not peer-reviewed.²⁰ Although the decision applies only to the Department of Energy's regulations of manufacturers, it bolsters the ability of the EPA and state regulators to rely on social cost of carbon analyses.

On September 20, 2013, the EPA proposed national limits on the amount of CO₂ that new power plants would be

¹⁶ See *Response to Clean Air Act Section 126(b) Petitions From Delaware and Maryland*, EPA Docket No. EPA-HQ-OAR-2018-0295, 83 Fed. Reg. 50444 (Oct. 5, 2018). Delaware filed a petition requesting that the EPA regulate emissions from the Brunner Island coal plant in Pennsylvania, the Harrison coal plant in West Virginia, the Homer City coal plant in Pennsylvania and the Conemaugh coal plant in Pennsylvania. Maryland filed a petition requesting that the EPA regulate 36 generating units at coal plants located in Indiana, Kentucky, Ohio, Pennsylvania and West Virginia.

¹⁷ See CAA § 111.

¹⁸ On April 2, 2007, the U.S. Supreme Court overruled the EPA's determination that it was not authorized to regulate greenhouse gas emissions under the CAA and remanded the matter to the EPA to determine whether greenhouse gases endanger public health and welfare. *Massachusetts v. EPA*, 549 U.S. 497. On December 7, 2009, the EPA determined that greenhouse gases, including carbon dioxide, methane, nitrous oxide, hydrofluorocarbons, perfluorocarbons, and sulfur hexafluoride, endanger public health and welfare. See *Endangerment and Cause or Contribute Findings for Greenhouse Gases Under Section 202(a) of the Clean Air Act*, 74 Fed. Reg. 66496, 66497 (Dec. 15, 2009). In a decision dated June 26, 2012, the U.S. Court of Appeals for the D.C. Circuit upheld the endangerment finding, rejecting challenges brought by industry groups and a number of states. *Coalition for Responsible Regulation, Inc., et al. v. EPA*, No 09-1322.

¹⁹ See *Zero Zone, Inc., et al., v. U.S. Dept. of Energy, et al.*, Case Nos. 14-2147, et al., Slip Op. (Aug. 8, 2016).

²⁰ *Id.*

allowed to emit.^{21 22} The proposed rule includes two limits for fossil fuel fired utility boilers and integrated gasification combined cycle (IGCC) units based on the compliance period selected: 1,100 lb CO₂/MWh gross over a 12 operating month period, or 1,000–1,050 lb CO₂/MWh gross over an 84 operating month (seven year) period. The proposed rule also includes two standards for natural gas fired stationary combustion units based on the size: 1,000 lb CO₂/MWh gross for larger units (> 850 MMBtu/hr), or 1,100 lb CO₂/MWh gross for smaller units (≤ 850 MMBtu/hr).

On August 3, 2015, the EPA issued a final rule for regulating CO₂ from certain existing power generation facilities titled Carbon Pollution Emission Guidelines for Existing Stationary Sources: Electric Utility Generating Units (the Clean Power Plan).²³ The rule requires that individual state plans be submitted by September 6, 2016. However, on February 9, 2016, the U.S. Supreme Court issued a stay of the rule that will prevent its taking effect until judicial review is completed.²⁴

On October 10, 2017, the EPA proposed to repeal the Clean Power Plan based on its determination that the Plan exceeds the EPA's authority under Section 111 of the EPA Act.²⁵ On August 8, 2017, the U.S. Court of Appeals for the District of Columbia Circuit issued an order continuing for 60 days to hold in abeyance court proceedings challenging the Clean Power Plan.²⁶

On August 21, 2018, the EPA proposed to replace the Clean Power Plan with the Affordable Clean Energy (ACE) rule, which would establish emission guidelines for states to develop plans to address greenhouse gas emissions from existing coal-fired power plants.²⁷ The ACE (i) determines the “best system of emission

reduction” (BSER) for existing power plants as on-site, heat-rate efficiency improvements; defines the “best system of emission reduction” (BSER) for existing power plants as on-site, heat-rate efficiency improvements; (ii) lists “candidate technologies” that states can use to establish standards of performance and incorporate into their plans; and (iii) revises the New Source Review (NSR) permitting program to promote improvements of existing power plants' efficiency.²⁸ The ACE would replace the Clean Power Plan's use of national greenhouse gas emissions limits with the application of emission reduction measures at the power plant. ACE would allow states to establish standards of performance based on a proposed list of candidate technologies to achieve the BSER standard. As a result, the impact on coal-fired generation would depend upon actions taken in their host state. ACE also proposes changes to New Source Review (NSR) regulations. NSR applies to new units or existing units receiving major modification. Under the revised NSR, only modifications that increase a plant's hourly rate of emissions would be deemed major and require an NSR analysis. Modifications that increased a plant's annual run time and annual emissions but not the hourly emissions rate would not require an NSR analysis.

Federal Regulation of Environmental Impacts on Water

The Clean Water Act (CWA) applies to the waters of the United States (WOTUS). The CWA defines WOTUS as “navigable waters.”²⁹ On June 17, 2017, the EPA issued a rulemaking to rescind the definition of WOTUS proposed in the 2015 Clean Water Rule.³⁰ The rule would avoid the potential implementation of a broader definition of WOTUS included in the 2015 rule that was never implemented as the result of a stay issued by a reviewing Court.³¹ The U.S. Supreme Court reversed the stay, but the EPA amended the 2015 Clean Water Rule to establish an applicability date of February 6, 2020.³² The proposed rule would restore the pre 2015 rule to the code and the interpreting precedent applicable to the pre 2015 rule. As a result of the new applicability date, the pre 2015 rule is now in effect. The pre 2015

21 *Standards of Performance for Greenhouse Gas Emissions from New Stationary Sources: Electric Utility Generating Units*, Proposed Rule, EPA-HQ-OAR-2013-0495, 79 Fed. Reg. 1430 (January 8, 2014); The President's Climate Action Plan, Executive Office of the President (June 2013) (Climate Action Plan); Presidential Memorandum—Power Sector Carbon Pollution Standards, Environmental Protection Agency (June 25, 2013); Presidential Memorandum—Power Sector Carbon Pollution Standards (June 25, 2013) (“June 25th Presidential Memorandum”). The Climate Action Plan can be accessed at: <<http://www.whitehouse.gov/sites/default/files/image/president27climateactionplan.pdf>>.

22 79 Fed. Reg. 1352 (Jan. 8, 2014).

23 *Carbon Pollution Emission Guidelines for Existing Stationary Sources: Electric Utility Generating Units*, EPA-HQ-OAR-2013-0602, Final Rule mimeo (Aug. 3, 2015), also known as the “Clean Power Plan.”

24 *North Dakota v. EPA*, et al., Order 15A793.

25 See *Repeal of Carbon Pollution Emission Guidelines for Existing Stationary Sources: Electric Utility Generating Units*, Proposed Rule, EPA Docket No. EPA-HQ-OAR-2017-0355, 82 Fed. Reg. 48035 (Oct. 16, 2017).

26 See *West Virginia v. EPA*, No. 15-1363 (D.C. Cir.); *North Dakota v. EPA*, No. 15-1381 (D.C. Cir.).

27 See *Emission Guidelines for Greenhouse Gas Emissions From Existing Electric Utility Generating Units; Revisions to Emission Guideline Implementing Regulations; Revisions to New Source Review Program*, EPA Docket No. EPA-HQ-OAR-2017-0355, 83 Fed. Reg. 44746 (Aug. 31, 2018).

28 *Id.*

29 33 U.S.C. § 1362(7).

30 80 Fed. Reg. 37054 (June 29, 2015).

31 The stay was issued by the U.S. Court of Appeals for the Sixth Circuit on October 9, 2015.

32 See *Definition of “Waters of the United States”—Addition of an Applicability Date to 2015 Clean Water Rule*, Final Rule, EPA Docket No. EPA-HQ-OW-2017-0644, 83 Fed. Reg. 5200 (Feb. 6, 2018); *National Assoc. of Mfg. v. Dept. of Defense*, No. 16-299 (S. Ct. Jan. 22, 2018).

rule includes all navigable waters and waters with a “significant nexus” to such waters.³³

On December 11, 2018, the EPA and Department of the Army proposed a replacement definition of “waters of the United States.”³⁴ The proposed definition would replace both the approaches used before and after the 2015 Rule. The proposed rule includes “waters within the ordinary meaning of the term, such as oceans, rivers, streams, lakes, ponds, and wetlands.”³⁵ The proposed rule excludes “features that flow only in response to precipitation; groundwater, including groundwater drained through subsurface drainage systems; certain ditches; prior converted cropland; artificially irrigated areas that would revert to upland if artificial irrigation ceases; certain artificial lakes and ponds constructed in upland; water-filled depressions created in upland incidental to mining or construction activity; storm water control features excavated or constructed in upland to convey, treat, infiltrate, or store storm water run-off; wastewater recycling structures constructed in upland; and waste treatment systems.”³⁶ The new rule would specifically exclude from EPA jurisdiction waters that are now included.

Water cooling systems at steam electric power generating stations are subject to regulation under the CWA. EPA regulations of discharges from steam electric power generating stations are set forth in the Generating Effluent Guidelines and Standards in 1974. These standards were amended most recently in 2015.

Section 301(a) of the CWA prohibits the point source discharge of pollutants to a water of the United States, unless authorized by permit. Section 402 of the CWA establishes the required permitting process, known as the National Pollutant Discharge Elimination System (NPDES). NPDES permits limit discharges and include monitoring and reporting requirements. NPDES permits last five years before they must be renewed.

NPDES permits must satisfy the more stringent of a technology based standard, known as Best Technology Available (BTA), or water quality standards. NPDES permits include limits designed to prevent discharges

that would cause or contribute to violations of water quality standards. Water quality standards include thermal limits.

PJM states are authorized to issue NPDES permits, with the exception of the District of Columbia. Pennsylvania, Delaware, Indiana and Illinois are partially authorized; the balance of PJM states are fully authorized.

The CWA regulates intakes in addition to discharges.

Section 316(b) of the CWA requires that cooling water intake structures reflect the BTA for minimizing adverse environmental impacts. The EPA’s rule implementing Section 316(b) requires an existing facility to use BTA to reduce impingement of aquatic organisms (pinned against intake structures) if the facility withdraws 25 percent or more of its cooling water from WOTUS and has a design intake flow of greater than two million gallons per day (mgd).³⁷

Existing facilities withdrawing 125 mgd must conduct studies that may result in a requirement to install site-specific controls for reducing entrainment of aquatic organisms (drawn into intake structures). If a new generating unit is added to an existing facility, the rule requires addition of BTA that either (i) reduces actual intake flow at the new unit to a level at least commensurate with what can be attained using a closed-cycle recirculating system or (ii) reduces entrainment mortality of all stages of aquatic organisms that pass through a sieve with a maximum opening dimension of 0.56 inches to a prescribed level.

Federal Regulation of Coal Ash

The EPA administers the Resource Conservation and Recovery Act (RCRA), which governs the disposal of solid and hazardous waste.³⁸

Solid waste is regulated under subtitle D, which encourages state management of nonhazardous industrial solid waste and sets nonbinding criteria for solid waste disposal facilities. Subtitle D prohibits open dumping. Subtitle D criteria are not directly enforced by the EPA. However, the owners of solid waste disposal

³³ *Rapanos v. U.S.*, 547 U.S. 715 (2006).

³⁴ See *Revised Definition of “Waters of the United States,”* EPA Docket No. EPA-HQ-OW-2018-0149, 84 Fed. Reg. 4154 (Feb. 14, 2019).

³⁵ *Id.* at 4155.

³⁶ *Id.*

³⁷ See EPA, *National Pollutant Discharge Elimination System—Final Regulations to Establish Requirements for Cooling Water Intake Structures at Existing Facilities and Amend Requirements at Phase I Facilities*, EPA-HQ-OW-2008-0667, 79 Fed. Reg. 48300 (Aug. 15, 2014).

³⁸ 42 U.S.C. §§ 6901 *et seq.*

facilities are exposed under the act to civil suits, and criteria set by the EPA under subtitle D can be expected to influence the outcome of such litigation.

Subtitle C governs the disposal of hazardous waste. Hazardous waste is subject to direct regulatory control by the EPA from the time it is generated until its ultimate disposal.

The EPA issued a rule under RCRA, the Coal Combustion Residuals rule (CCRR), which sets criteria for the disposal of coal combustion residues (CCRs), or coal ash, produced by electric utilities and independent power producers.³⁹ CCRs include fly ash (trapped by air filters), bottom ash (scooped out of boilers) and scrubber sludge (filtered using wet limestone scrubbers). These residues are typically stored on site in ponds (surface impoundments) or sent to landfills.

The CCRR exempts: (i) beneficially used CCRs that are encapsulated (i.e. physically bound into a product); (ii) coal mine filling; (iii) municipal landfills; (iv) landfills receiving CCRs before the effective date; (v) surface impoundments closed by the effective date; and (vi) landfills and surface impoundments on the site of generation facilities that deactivate prior to the effective date. Less restrictive criteria may also apply to some surface impoundments deemed inactive under not yet clarified criteria.

Table 8-1 describes the criteria and anticipated implementation dates.

Table 8-1 Minimum criteria for existing CCR ponds (surface impoundments) and landfills and date by which implementation is expected

Requirement	Description of requirement to be completed	Implementation Date
Location Restrictions (§ 257.60–§ 257.64)	For Ponds: Complete demonstration for placement above the uppermost aquifer, for wetlands, fault areas, seismic impact zones and unstable areas.	October 17, 2018
	For Landfills: Complete demonstration for unstable areas.	October 17, 2018
Design Criteria (§ 257.71)	For Ponds: Document whether CCR unit is either a lined or unlined CCR surface impoundment.	October 17, 2016
Structural Integrity (§ 257.73)	For Ponds: Install permanent marker.	December 17, 2015
	For Ponds: Compile a history of construction, complete initial hazard potential classification assessment, initial structural stability assessment, and initial safety factor assessment.	October 17, 2016
	Prepare emergency action plan.	April 17, 2017
Air Criteria (§ 257.80)	Ponds and Landfills: Prepare fugitive dust control plan.	October 17, 2015
Run-On and Run-Off Controls (§ 257.81)	For Landfills: Prepare initial run-on and run-off control system plan.	October 17, 2016
Hydrologic and Hydraulic Capacity (§ 257.82)	Prepare initial inflow design flood control system plan.	October 17, 2016
Inspections (§ 257.83)	For Ponds and Landfills: Initiate weekly inspections of the CCR unit.	October 17, 2015
	For Ponds: Initiate monthly monitoring of CCR unit instrumentation.	October 17, 2015
	For Ponds and Landfills: Complete the initial annual inspection of the CCR unit.	January 17, 2016
Groundwater Monitoring and Corrective Action (§ 257.90–§ 257.98)	For Ponds and Landfills: Install the groundwater monitoring system; develop the groundwater sampling and analysis program; initiate the detection monitoring program; and begin evaluating the groundwater monitoring data for statistically significant increases over background levels.	October 17, 2017
Closure and Post-Closure Care (§ 257.103–§ 257.104)	For Ponds and Landfills: Prepare written closure and post-closure care plans.	October 17, 2016
Recordkeeping, Notification, and Internet Requirements (§ 257.105–§ 257.107)	For Ponds and landfills: Conduct required recordkeeping; provide required notifications; establish CCR website.	October 17, 2015

³⁹ See *Hazardous and Solid Waste Management System; Disposal of Coal Combustion Residuals From Electric Utilities*, 80 Fed. Reg. 21302 (April 17, 2015).

On March 1, 2018, the EPA proposed a rule amending the CCRR.⁴⁰ The proposal includes:

- A change to allow a state regulatory program to establish alternative risk-based groundwater protection standards for constituents that do not have an established maximum contaminant level (MCL), rather than the use of background levels that are currently required. The proposal also requests public comment on whether a facility may be allowed to establish alternative risk-based standards using a certified professional engineer or other means, subject to EPA oversight.
- A request for comment on whether the current deadlines for groundwater monitoring and analysis remain appropriate.
- A request for public comment on modifying the location restrictions and associated deadlines concerning construction or operation of a CCR landfill or surface impoundment in certain areas.
- Changes to allow states to establish alternative requirements for how facilities respond to and remediate releases from CCR landfills and surface impoundments. The proposal also requests comment on allowing states to determine when an unlined surface impoundment that is leaking may undertake corrective action rather than be forced to stop receiving CCR and close.
- The addition of boron to the list of constituents for which facilities would need to perform assessment monitoring.

Effective August 9, 2018, the EPA approved (i) revised groundwater protections standards for constituents without an established MCL, (ii) alternative performance standards and (iii) extended deadlines for placement of waste in CCR units closing for cause in certain situations.⁴¹ The other identified issues remain pending.

⁴⁰ EPA Press Release, EPA Proposes First of Two Rules to Amend Coal Ash Disposal Regulations, Saving Up To \$100M Per Year in Compliance Costs <<https://www.epa.gov/newsreleases/epa-proposes-first-two-rules-amend-coal-ash-disposal-regulations-saving-100m-year>> (March 1, 2018).

⁴¹ See *Hazardous and Solid Waste Management System: Disposal of Coal Combustion Residuals From Electric Utilities; Amendments to the National Minimum Criteria (Phase One, Part One)*, EPA Docket No. EPA-HQ-OLEM-2017-0286, 83 Fed. Reg. 36435 (July 30, 2018).

State Environmental Regulation

States have in some cases enacted emissions regulations more stringent or potentially more stringent than federal requirements:⁴²

- **New Jersey HEDD.** Units that run only during peak demand periods have relatively low annual emissions, and have less reason to make such investments under the EPA transport rules. New Jersey addressed the issue of NO_x emissions on peak energy demand days with a rule that defines peak energy usage days, referred to as high electric demand days or HEDD, and imposes operational restrictions and emissions control requirements on units responsible for significant NO_x emissions on such high energy demand days. New Jersey's HEDD rule, which became effective May 19, 2009, applies to HEDD units, which include units that have a NO_x emissions rate on HEDD equal to or exceeding 0.15 lbs/MMBtu and lack identified emission control technologies.
- **Illinois Air Quality Standards (NO_x, SO₂ and Hg).** The State of Illinois has promulgated its own standards for NO_x, SO₂ and Hg (mercury) known as Multi-Pollutant Standards (MPS) and Combined Pollutants Standards (CPS). MPS and CPS establish standards that are more stringent and take effect earlier than comparable Federal regulations, such as the EPA's MATS.

State Regulation of Greenhouse Gas Emissions

RGGI

The Regional Greenhouse Gas Initiative (RGGI) is a cooperative effort by Connecticut, Delaware, Maine, Maryland, Massachusetts, New Hampshire, New York, Rhode Island, and Vermont to cap CO₂ emissions from power generation facilities.⁴³ New Jersey is in the process of resuming participation. On January 29, 2018, New Jersey Governor Phil Murphy signed an executive order to take all steps necessary to rejoin the RGGI program but New Jersey is still not part of RGGI.⁴⁴ Virginia is

⁴² For more details, see the *2018 State of the Market Report for PJM*, Volume 2, Appendix I: "Environmental and Renewable Energy Regulations."

⁴³ RGGI provides a link on its website to state statutes and regulations authorizing its activities, which can be accessed at: <<http://www.rggi.org/design/regulations>>.

⁴⁴ Executive Order 7; see Regional Greenhouse Gas Initiative, State of New Jersey Department of Environmental Protection <<http://www.state.nj.us/dep/aqes/rggi.html>>.

considering joining RGGI. The Virginia Air Pollution Control Board is in the process of developing administrative rules that would facilitate its participation.⁴⁵

RGGI generates revenues for the participating states which have spent approximately 64 percent of revenues on energy efficiency, 16 percent on clean and renewable energy, 4 percent on greenhouse gas abatements and 10 percent on direct bill assistance.⁴⁶

Table 8-2 RGGI CO₂ allowance auction prices and quantities in short tons and metric tonnes: 2009/2011, 2012/2014 and 2015/2018 Compliance Periods⁴⁷

Auction Date	Short Tons			Metric Tonnes		
	Clearing Price	Quantity Offered	Quantity Sold	Clearing Price	Quantity Offered	Quantity Sold
September 25, 2008	\$3.07	12,565,387	12,565,387	\$3.38	11,399,131	11,399,131
December 17, 2008	\$3.38	31,505,898	31,505,898	\$3.73	28,581,678	28,581,678
March 18, 2009	\$3.51	31,513,765	31,513,765	\$3.87	28,588,815	28,588,815
June 17, 2009	\$3.23	30,887,620	30,887,620	\$3.56	28,020,786	28,020,786
September 9, 2009	\$2.19	28,408,945	28,408,945	\$2.41	25,772,169	25,772,169
December 2, 2009	\$2.05	28,591,698	28,591,698	\$2.26	25,937,960	25,937,960
March 10, 2010	\$2.07	40,612,408	40,612,408	\$2.28	36,842,967	36,842,967
June 9, 2010	\$1.88	40,685,585	40,685,585	\$2.07	36,909,352	36,909,352
September 10, 2010	\$1.86	45,595,968	34,407,000	\$2.05	41,363,978	31,213,514
December 1, 2010	\$1.86	43,173,648	24,755,000	\$2.05	39,166,486	22,457,365
March 9, 2011	\$1.89	41,995,813	41,995,813	\$2.08	38,097,972	38,097,972
June 8, 2011	\$1.89	42,034,184	12,537,000	\$2.08	38,132,781	11,373,378
September 7, 2011	\$1.89	42,189,685	7,847,000	\$2.08	38,273,849	7,118,681
December 7, 2011	\$1.89	42,983,482	27,293,000	\$2.08	38,993,970	24,759,800
March 14, 2012	\$1.93	34,843,858	21,559,000	\$2.13	31,609,825	19,558,001
June 6, 2012	\$1.93	36,426,008	20,941,000	\$2.13	33,045,128	18,997,361
September 5, 2012	\$1.93	37,949,558	24,589,000	\$2.13	34,427,270	22,306,772
December 5, 2012	\$1.93	37,563,083	19,774,000	\$2.13	34,076,665	17,938,676
March 13, 2013	\$2.80	37,835,405	37,835,405	\$3.09	34,323,712	34,323,712
June 5, 2013	\$3.21	38,782,076	38,782,076	\$3.54	35,182,518	35,182,518
September 4, 2013	\$2.67	38,409,043	38,409,043	\$2.94	34,844,108	34,844,108
December 4, 2013	\$3.00	38,329,378	38,329,378	\$3.31	34,771,837	34,771,837
March 5, 2014	\$4.00	23,491,350	23,491,350	\$4.41	21,311,000	21,311,000
June 4, 2014	\$5.02	18,062,384	18,062,384	\$5.53	16,385,924	16,385,924
September 3, 2014	\$4.88	17,998,687	17,998,687	\$5.38	16,328,139	16,328,139
December 3, 2014	\$5.21	18,198,685	18,198,685	\$5.74	16,509,574	16,509,574
March 11, 2015	\$5.41	15,272,670	15,272,670	\$5.96	13,855,137	13,855,137
June 3, 2015	\$5.50	15,507,571	15,507,571	\$6.06	14,068,236	14,068,236
September 3, 2015	\$6.02	25,374,294	25,374,294	\$6.64	23,019,179	23,019,179
December 2, 2015	\$7.50	15,374,274	15,374,274	\$8.27	13,947,311	13,947,311
March 9, 2016	\$5.25	14,838,732	14,838,732	\$5.79	13,461,475	13,461,475
June 1, 2016	\$4.53	15,089,652	15,089,652	\$4.99	13,689,106	13,689,106
September 7, 2016	\$4.54	14,911,315	14,911,315	\$5.00	13,527,321	13,527,321
December 7, 2016	\$3.55	14,791,315	14,791,315	\$3.91	13,418,459	13,418,459
March 8, 2017	\$3.00	14,371,300	14,371,300	\$3.31	13,037,428	13,037,428
June 7, 2017	\$2.53	14,597,470	14,597,470	\$2.79	13,242,606	13,242,606
September 8, 2017	\$4.35	14,371,585	14,371,585	\$4.80	13,037,686	13,037,686
December 8, 2017	\$3.80	14,687,989	14,687,989	\$4.19	13,324,723	13,324,723
March 14, 2018	\$3.79	13,553,767	13,553,767	\$4.18	12,295,774	12,295,774
June 13, 2018	\$4.02	13,771,025	13,771,025	\$4.43	12,492,867	12,492,867
September 9, 2018	\$4.50	13,590,107	13,590,107	\$4.96	12,328,741	12,328,741
December 5, 2018	\$5.33	13,360,649	13,360,649	\$5.88	12,120,580	12,120,580

Table 8-2 shows the RGGI CO₂ auction clearing prices and quantities for the 2008/2011 compliance period auctions, the 2012/2014 compliance period auctions and 2015/2018 compliance period auctions held as of December 5, 2018, in short tons and metric tonnes.⁴⁸ Prices for auctions held December 5, 2018, were \$5.33 per allowance (equal to one

⁴⁵ Regulation for Emissions Trading, 9 VAC 5-140.

⁴⁶ Investment of RGGI Proceeds Through 2015, The Regional Greenhouse Gas Initiative, <https://www.rggi.org/sites/default/files/Uploads/Proceeds/RGGI_Proceeds_Report_2015.pdf>.

⁴⁷ See Regional Greenhouse Gas Initiative, "Auction Results," <http://www.rggi.org/market/co2_auctions/results> (Accessed Jan. 24, 2019).

⁴⁸ The September 3, 2015, auction included additional Cost Containment Reserves (CCRs) since the clearing price for allowances was above the CCR trigger price of \$6.00 per ton in 2015. The auctions on March 5, 2014, and September 3, 2015, were the only auctions to use CCRs.

ton of CO₂), above the current price floor of \$2.21 for RGGI auctions.⁴⁹ The RGGI base budget for CO₂ will be reduced by 2.5 percent per year each year from 2015 through 2020. The price increased from the last auction clearing price of \$4.50 in September 2018.

State Renewable Portfolio Standards

Nine PJM jurisdictions have enacted legislation that requires that a defined percentage of retail load be served by renewable resources, for which there are many standards and definitions. These requirements are known as renewable portfolio standards, or RPS. In PJM jurisdictions that have adopted an RPS, load serving entities are often required by law to meet defined shares of load using specific renewable and/or alternative energy sources commonly called “eligible technologies.” Load serving entities may generally fulfill these obligations in one of two ways: they may use their own generation resources classified as eligible technologies to produce power or they may purchase renewable energy credits (RECs) that represent a known quantity of power produced with eligible technologies by other market participants or in other geographical locations. Load serving entities that fail to meet the percent goals set in their jurisdiction’s RPS are penalized with alternative compliance payments.

Renewable energy sources replenish naturally in a short period of time but are flow limited and include solar, geothermal, wind, biomass and hydropower from flowing water. Renewable energy sources are virtually inexhaustible in duration but limited in the amount of energy that is available per unit of time. Nonrenewable energy sources do not replenish in a short period of time and include crude oil, natural gas, coal and uranium (nuclear energy).⁵⁰ Some state portfolios allow nonrenewable energy sources as part of their Renewable Portfolio Standard.

As of December 31, 2018, Delaware, Illinois, Maryland, Michigan, New Jersey, North Carolina, Ohio, Pennsylvania, and Washington, D.C. had renewable portfolio standards that are mandatory and include penalties in the form of alternative compliance payments for underperformance.

Two PJM jurisdictions have enacted voluntary renewable portfolio standards. Load serving entities in states with voluntary standards are not bound by law to participate and face no alternative compliance payments. Instead, incentives are offered to load serving entities to develop renewable generation or, to a more limited extent, purchase RECs. As of December 31, 2018, Virginia and Indiana had renewable portfolio standards that are voluntary and do not include penalties in the form of alternative compliance payments for underperformance.

In this section, voluntary standards will not be directly compared to RPS with enforceable compliance payments. Indiana’s voluntary standard illustrates the issue. Although a voluntary standard including target shares was enacted by the Indiana legislature in 2011, no load serving entities have volunteered to participate in the program.⁵¹

Three PJM states have no renewable portfolio standards. Kentucky and Tennessee have enacted no renewable portfolio standards. West Virginia had a voluntary standard, but it was repealed.⁵²

How each state satisfies its renewable portfolio standard requirements should be more transparent. While some jurisdictions publish transparent information regarding total REC generation, how the standard is fulfilled and the total cost to the state, some jurisdictions do not readily publish this information. Some states provide adequate information with respect to the total cost for the RPS, where the RECs originated that fulfill the RPS requirements and if the state fulfilled the RPS goals. Pennsylvania and Maryland both provide enough information and serve as a model for other states. The MMU recommends that jurisdictions with a renewable portfolio standard make the compliance data available in a more complete and transparent manner.

Since a REC may be applied in years other than the year in which it was generated, each vintage of RECs for each state has a different price. For example, the Pennsylvania Alternative Energy Portfolio Standard allows an electric distribution company or generation supplier to retain RECs from the current reporting year

49 RGGI measures carbon in short tons (short ton equals 2,000 pounds) while world carbon markets measure carbon in metric tonnes (metric tonne equals 1,000 kilograms or 2,204.6 pounds).

50 Renewable Energy Explained, U.S. Energy Information Administration, <https://www.eia.gov/energyexplained/index.php?page=renewable_home>, (Accessed March 1, 2019).

51 See the Indiana Utility Regulatory Commission’s “2018 Annual Report,” at 36 (Oct. 2018) <<https://www.in.gov/iurc/files/IURC%20AR%202018%20WEB3.pdf>>.

52 See Enr. Com. Sub. For H. B. No. 2001.

for use toward satisfying their REC obligation in either of the two subsequent reporting years.⁵³

Table 8-3 shows the percent of retail electric load that must be served by renewable and/or alternative energy resources under each PJM jurisdiction's RPS by year. Recent updates to RPS include legislation enacted on May 24, 2018, in New Jersey that raised New Jersey's RPS requirement to 21 percent by 2020, 35 percent by 2025, and 50 percent by 2030. The New Jersey statute requires generators to source increasing amounts of electricity from behind the meter solar, 4.3 percent by 2019, 4.9 percent by 2020, and 5.1 percent by 2021. The legislation also included provisions promoting the development of solar power in the state.⁵⁴ The Board of Public Utilities is directed to develop and provide an orderly transition to a new or modified program to support distributed solar. The Board must also design a Community Solar Energy Pilot Program that would "permit customers of an electric public utility to participate in a solar energy project that is remotely located from their properties but is within their electric public utility service territory to allow for a credit to the customer's utility bill equal to the electricity generated that is attributed to the customer's participation in the solar energy project." The pilot program would convert into a permanent program within three years. The statute targets the development of 600 MW of electric storage by 2021 and 2,000 MW by 2030.

In October 2016, the Council of the District of Columbia passed legislation that expanded the District's RPS program and increased the percent of retail load in the District that must be served by renewable energy resources to 50 percent by 2032.⁵⁵ On December 15, 2016, the Michigan State Senate approved Senate Bill 438 (S.B. 438) which increased the Michigan RPS percent requirements. The previous version of the bill required that 10 percent of retail electric load in Michigan be served by renewable and alternative energy resources in 2015 and subsequent years. S.B. 438 increased the percent of retail electric load to be served by renewable and alternative energy resources in Michigan to be 12.5 percent in 2019 and 2020 and 15 percent in 2021 and

subsequent years.⁵⁶ In February 2017, the Maryland State House approved House Bill 1106 which increased the total RPS requirement from 20 percent by 2022 to 25 percent by 2020. In 2016, Maryland legislation established a pilot program for community solar energy systems.⁵⁷ Regulations for a three year pilot program developed by the Maryland Public Service Commission became effective July 18, 2016.

New Jersey and Maryland have taken significant steps to promote offshore wind. Both states enacted legislation for offshore wind renewable energy credits (ORECs) in 2010.⁵⁸

On May 24, 2018, New Jersey enacted a statute directing the Board of Public Utilities to create an OREC program targeting installation of at least 3,500 MW of generation from qualified offshore wind projects by 2030 (plus 2,000 MW of energy storage capacity).⁵⁹ The New Jersey statute also reinstates certain tax incentives for offshore wind manufacturing activities. Governor Murphy has issued Executive Order No. 8, which call for full implementation of the statute. The BPU has initiated a proceeding considering the opening of an application window for qualified offshore wind projects.⁶⁰

In 2017, the Maryland Public Service Commission announced two awards of ORECs to two commercial wind projects, Deepwater Wind's 120-MW Skipjack Wind Farm and U.S. Wind's 248-MW project. These project awards are the first under Maryland's 2010 OREC program.

53 Pennsylvania General Assembly, "Alternative Energy Portfolio Standards Act - Enactment Act of Nov. 30, 2004, P.L. 1672, No. 213", Section (e)(6).

54 N.J. S. 2314/A. 3723.

55 See Council of the District of Columbia. B21-0650—Renewable Portfolio Standard Expansion Amendment Act of 2016. <<http://lirms.dccouncil.us/Legislation/B21-0650>> (Accessed April 26, 2018).

56 See Michigan Legislature. Senate Bill 0438 (2015) <<http://legislature.mi.gov/doc.aspx?2015-SB-0438>> (Accessed April 26, 2018).

57 Md. S.B. 1087.

58 See Offshore Wind Economic Development Act of 2010, P.L. 2010, c. 57, as amended, N.J.S.A. 48:3-87 to -87.2.

59 N.J. S. 2314/A. 3723.

60 BPU Docket No. Q018080851.

Table 8-3 Renewable standards of PJM jurisdictions: 2018 to 2030⁶¹

Jurisdiction with RPS	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030
Delaware	17.50%	19.00%	20.00%	21.00%	22.00%	23.00%	24.00%	25.00%	25.00%	25.00%	25.00%	25.00%	25.00%
Illinois	13.00%	14.50%	16.00%	17.50%	19.00%	20.50%	22.00%	23.50%	25.00%	25.00%	25.00%	25.00%	25.00%
Maryland	18.30%	20.40%	25.00%	25.00%	25.00%	25.00%	25.00%	25.00%	25.00%	25.00%	25.00%	25.00%	25.00%
Michigan	10.00%	12.50%	12.50%	15.00%	15.00%	15.00%	15.00%	15.00%	15.00%	15.00%	15.00%	15.00%	15.00%
New Jersey	19.13%	21.58%	28.60%	28.60%	28.60%	28.40%	28.30%	42.00%	41.85%	41.24%	40.57%	39.71%	54.08%
North Carolina	10.00%	10.00%	10.00%	12.50%	12.50%	12.50%	12.50%	12.50%	12.50%	12.50%	12.50%	12.50%	12.50%
Ohio	4.50%	5.50%	6.50%	7.50%	8.50%	9.50%	10.50%	11.50%	12.50%	12.50%	12.50%	12.50%	12.50%
Pennsylvania	14.70%	15.20%	15.70%	18.00%	18.00%	18.00%	18.00%	18.00%	18.00%	18.00%	18.00%	18.00%	18.00%
Washington, D.C.	16.50%	18.00%	20.00%	20.00%	20.00%	20.00%	23.00%	26.00%	29.00%	32.00%	35.00%	38.00%	42.00%
Jurisdiction with Voluntary Standard													
Indiana	4.00%	7.00%	7.00%	7.00%	7.00%	7.00%	7.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%
Virginia	7.00%	7.00%	7.00%	7.00%	12.00%	12.00%	12.00%	15.00%	15.00%	15.00%	15.00%	15.00%	15.00%
Jurisdiction with No Standard													
Kentucky	No Renewable Portfolio Standard												
Tennessee	No Renewable Portfolio Standard												
West Virginia	No Renewable Portfolio Standard												

Each PJM jurisdiction with an RPS identifies the type of generation resources that may be used for compliance. These resources are often called eligible technologies. Some PJM jurisdictions with RPS group different eligible technologies into tiers based on the magnitude of their environmental impact. Of the nine PJM states with mandatory RPS, Maryland, New Jersey, Pennsylvania, and Washington, DC group the eligible technologies that must be used to comply with their RPS programs into Tier I and Tier II resources. Though there are minor differences across these four jurisdictions' definitions of Tier I resources, technologies that use solar photovoltaic, solar thermal, wind, ocean, tidal, biomass, low-impact hydro, and geothermal sources to produce electricity are classified as Tier I resources. Table 8-4 shows the tier I standards for PJM states.⁶² All eligible technologies for the RPS standards in Table 8-4 satisfy the EIA definition of renewable energy.⁶³

Table 8-4 Tier I renewable standards of PJM jurisdictions: 2018 to 2030

Jurisdiction with RPS	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030
Maryland	15.80%	20.40%	25.00%	25.00%	25.00%	25.00%	25.00%	25.00%	25.00%	25.00%	25.00%	25.00%	25.00%
New Jersey	12.33%	14.18%	21.00%	21.00%	21.00%	21.00%	21.00%	35.00%	35.00%	35.00%	35.00%	35.00%	50.00%
Pennsylvania	6.50%	7.00%	7.50%	8.00%	8.00%	8.00%	8.00%	8.00%	8.00%	8.00%	8.00%	8.00%	8.00%
Washington, D.C.	15.50%	17.50%	20.00%	20.00%	20.00%	20.00%	23.00%	26.00%	29.00%	32.00%	35.00%	38.00%	42.00%

Delaware, Illinois, Michigan, North Carolina, and Ohio do not classify the resources eligible for their RPS standards by tiers. In Delaware, Illinois, North Carolina, and Ohio, eligible technologies are largely but not completely renewable resources. Michigan is the only state with an RPS that does not classify eligible technologies into tiers and also includes nonrenewable technologies. Michigan's RPS includes coal gasification, industrial cogeneration, and coal with carbon capture and storage as eligible technologies.

RECs do not need to be used during the year in which they are generated. The result is that there may be multiple prices for a REC based on the year in which it was generated. RECs typically have a shelf life of five years during which they can be used to satisfy a state's RPS requirement. For example if a load serving entity (LSE) owns renewable generation and the renewable generation exceeds the LSE's RECs purchase obligation for the current year, the LSE can either sell the REC to another LSE or hold the REC for use in a subsequent year.

Figure 8-2 shows the number of RECs eligible monthly by state for January 1, 2005, through December 31, 2018.⁶⁴ The figure includes Tier I or the equivalent REC type available in each state. Washington DC, Maryland, and Pennsylvania classify these RECs as Tier I, New Jersey classifies the RECs as Class I and Delaware, Illinois, Ohio, Virginia and

61 This shows the total standard of renewable resources in all PJM jurisdictions, including Tier I, Tier II and Tier III resources.


62 This includes New Jersey's Class I renewable standard.

63 Renewable Energy Explained, U.S. Energy Information Administration, <https://www.eia.gov/energyexplained/index.php?page=renewable_home>, (Accessed March 1, 2019).

64 Tier I REC volume obtained through PJM Environmental Information Services <<https://www.pjm-eis.com/reports-and-events/public-reports.aspx>> (Accessed March 1, 2019).

West Virginia classify these RECs as renewable or eligible. West Virginia repealed its renewable portfolio standard, and Virginia has a voluntary renewable portfolio standard.

Figure 8-2 Number of RECs eligible monthly by state: 2005 through 2018

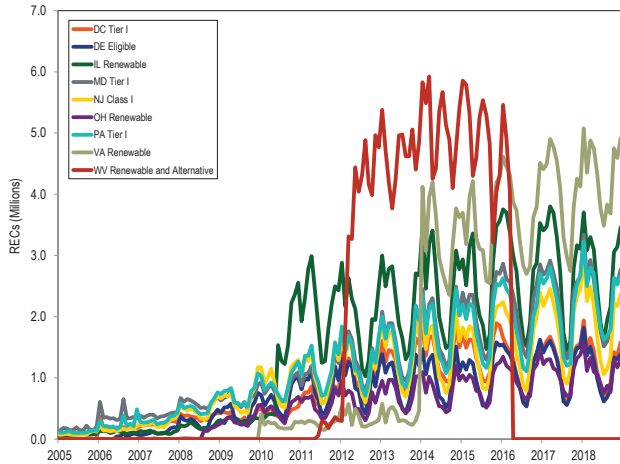

The REC prices are the average price for each vintage of REC, defined by the year in which the associated power was generated, regardless of when the REC is consumed. REC prices are required to be publicly disclosed in Maryland, Pennsylvania and the District of Columbia, but in the other states REC prices are not publicly available.

Figure 8-3 shows the average Tier I REC price by jurisdiction from January 1, 2009, through December 31, 2018. Tier I REC prices are lower than SREC prices.

Figure 8-3 Average Tier I REC price by jurisdiction: 2009 through 2018

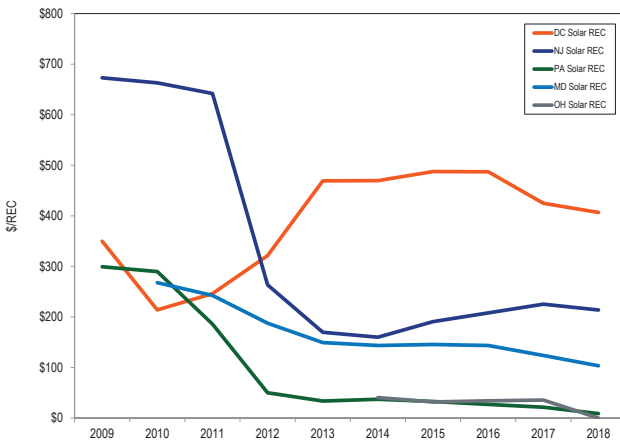


Table 8-5 shows the percent of retail electric load that must be served by Tier II or a specific type of resource under each PJM jurisdiction’s RPS by year. Tier II resources are generally not renewable resources. Table 8-5 also shows specific technology requirements that PJM jurisdictions have added to their renewable portfolio standards. The standards shown in Table 8-5 are included in the total RPS requirements presented in Table 8-3. Illinois requires that a defined proportion of retail load be served by wind and solar resources, increasing from 9.75 percent of load served in 2018 to 18.75 percent in 2026. Maryland, New Jersey, Pennsylvania and Washington, DC all have Tier II or “Class 2” standards, which allow specific nonrenewable technology types, such as waste coal units located in Pennsylvania, to qualify for renewable energy credits. By 2021, North Carolina’s RPS requires that 0.2 percent of power be generated using swine waste and that 900 GWh of power be produced by poultry waste. Maryland established a minimum standard for offshore wind in 2017 that takes effect in 2021 with a requirement that 1.37 percent of load be served by offshore wind. The standard increases to 2.03 percent in 2023.⁶⁵


65 Order No. 88192, Public Service Commission of Maryland, Table 2, p. 81, (May 11, 2017), <<https://www.psc.state.md.us/wp-content/uploads/Order-No.-88192-Case-No.-9431-Offshore-Wind.pdf>>.

Table 8-5 Additional renewable standards of PJM jurisdictions: 2018 to 2030

Jurisdiction	Type of Standard	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030
Illinois	Wind and Solar	9.75%	10.88%	12.00%	13.13%	14.25%	15.38%	16.50%	17.63%	18.75%	18.75%	18.75%	18.75%	18.75%
Illinois	Distributed Generation	0.13%	0.15%	0.16%	0.18%	0.19%	0.21%	0.22%	0.24%	0.25%	0.25%	0.25%	0.25%	0.25%
Maryland	Tier II Standard	2.50%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%
Maryland	Off Shore Wind				1.37%	1.36%	2.03%	2.01%	2.01%	1.99%	1.98%	1.96%	1.96%	1.94%
New Jersey	Class II Standard	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%
North Carolina	Swine Waste	0.14%	0.14%	0.14%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%
North Carolina	Poultry Waste (in GWh)	900	900	900	900	900	900	900	900	900	900	900	900	900
Pennsylvania	Tier II Standard	8.20%	8.20%	8.20%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%	10.00%
Washington, D.C.	Tier II Standard	1.00%	0.50%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%	0.00%


Figure 8-4 shows the number of Tier II RECs eligible monthly by state for January 1, 2005, through December 31, 2018.⁶⁶ The figure includes Tier II or the equivalent REC type available in each state. Washington DC, Maryland, and Pennsylvania classify these RECs as Tier II and New Jersey classifies the RECs as Class II.

Figure 8-4 Number of Tier II RECs eligible monthly by state: 2005 through 2018

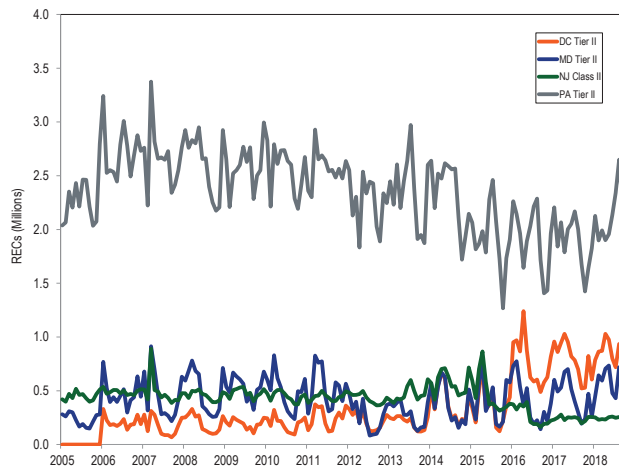

Tier II prices are lower than SREC and Tier I REC prices. Figure 8-5 shows the average Tier II REC price by jurisdiction for January 1, 2009 through December 31, 2018. Pennsylvania had the lowest average Tier II REC prices at \$0.08 per REC while New Jersey had the highest average Tier II REC prices at \$5.51 per REC.⁶⁷

Figure 8-5 Average Tier II REC price by jurisdiction: 2009 through 2018⁶⁸

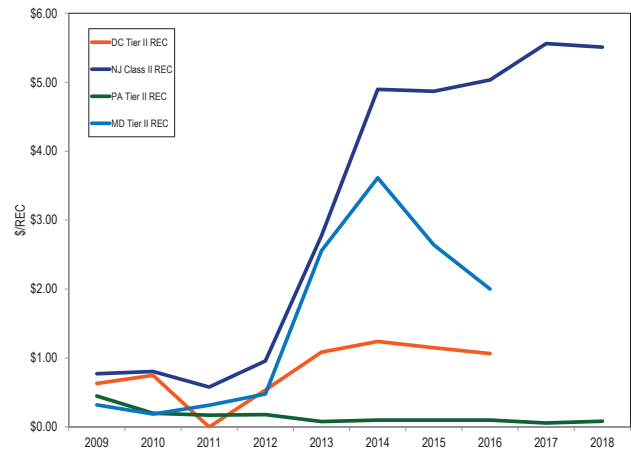

Some PJM jurisdictions have specific solar resource RPS requirements. These solar requirements are included in the total requirements shown in Table 8-3 but must be met by solar RECs (SRECs) only. Table 8-6 shows the percent of retail electric load that must be served by solar energy resources under each PJM jurisdiction’s RPS by year. Delaware, Illinois, Maryland, New Jersey, North Carolina, Ohio, Pennsylvania, and Washington, DC have requirements for the proportion of load to be served by solar. Pennsylvania and Delaware allow only solar photovoltaic resources to fulfill their solar requirements. Solar thermal units like solar hot water heaters that do not generate electricity are considered Tier II. Indiana, Kentucky, Michigan, Tennessee, Virginia, and West Virginia have no specific solar standards. The New Jersey legislature in May 2018 increased the solar standard from 3.2 percent to 4.3 percent for 2018. The new solar standard is 5.1 percent for energy years 2020

⁶⁶ Tier II REC volume obtained through PJM Environmental Information Services <<https://www.pjm-eis.com/reports-and-events/public-reports.aspx>> (Accessed March 1, 2019).

⁶⁷ Tier II REC price information obtained through Evomarkets <<http://www.evomarkets.com>> (Accessed Jan. 24, 2019). There were not any reported cleared purchases for January 1, through Dec. 31, 2018, for DC Tier II REC or MD Tier II RECs.

⁶⁸ Tier II REC price information obtained through Evomarkets <<http://www.evomarkets.com>> (Accessed Jan. 24, 2019). There were not any reported cleared purchases for January 1, 2017 through December 31, 2018 for DC Tier II REC or MD Tier II RECs.

through 2022 and the standard gradually decreases to 1.1 percent for 2032.⁶⁹

Table 8-6 Solar renewable standards by percent of electric load for PJM jurisdictions: 2018 to 2030

Jurisdiction with RPS	2018	2019	2020	2021	2022	2023	2024	2025	2026	2027	2028	2029	2030
Delaware	1.75%	2.00%	2.25%	2.50%	2.75%	3.00%	3.25%	3.50%	3.50%	3.50%	3.50%	3.50%	3.50%
Illinois	0.78%	0.87%	0.96%	1.05%	1.14%	1.23%	1.32%	1.41%	1.50%	1.50%	1.50%	1.50%	1.50%
Maryland	1.50%	1.95%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%	2.50%
Michigan	No Minimum Solar Requirement												
New Jersey	4.30%	4.90%	5.10%	5.10%	5.10%	4.90%	4.80%	4.50%	4.35%	3.74%	3.07%	2.21%	1.58%
North Carolina	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%	0.20%
Ohio	0.18%	0.22%	0.26%	0.30%	0.34%	0.38%	0.42%	0.46%	0.50%	0.50%	0.50%	0.50%	0.50%
Pennsylvania	0.34%	0.39%	0.44%	0.50%	0.50%	0.50%	0.50%	0.50%	0.50%	0.50%	0.50%	0.50%	0.50%
Washington, D.C.	1.15%	1.35%	1.58%	1.85%	2.18%	2.50%	2.60%	2.85%	3.15%	3.45%	3.75%	4.10%	4.50%
Jurisdiction with Voluntary Standard													
Indiana	No Minimum Solar Requirement												
Virginia	No Minimum Solar Requirement												
Jurisdiction with No Standard													
Kentucky	No Renewable Portfolio Standard												
Tennessee	No Renewable Portfolio Standard												
West Virginia	No Renewable Portfolio Standard												

Figure 8-6 shows the number of SRECs eligible monthly by state for January 1, 2005, through December 31, 2018.⁷⁰

Figure 8-6 Number of SRECs eligible monthly by state: 2005 through 2018

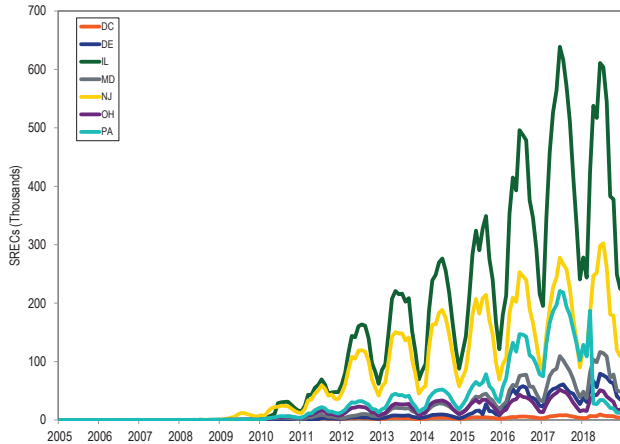


Figure 8-7 shows the average solar REC (SREC) price by jurisdiction for January 1, 2009, through December 31, 2018. The average NJ SREC prices dropped from \$673 per SREC in 2009 to \$214 per SREC in 2018. The limited supply of solar facilities in Washington, DC compared to the RPS requirement resulted in higher SREC prices. The

average Washington, D.C. SREC price increased from \$197 per SREC in 2011 to \$407 per SREC in 2018.⁷¹

Figure 8-7 Average SREC price by jurisdiction: 2009 through 2018

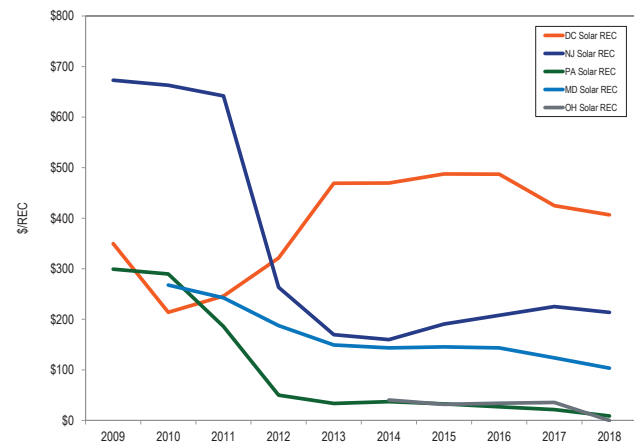


Figure 8-8 and Figure 8-9 show the percent of retail electric load that must be served by Tier I resources and Tier 2 resources in each PJM jurisdiction with a mandatory RPS. Figure 8-8 shows the percent of retail load that must be met with Tier I resources only. Because states that do not group eligible technologies into tiers generally classify eligible technologies in their RPS that are identical to Tier I resources, they are included in Figure 8-8. Figure 8-9 shows the percent of retail

⁶⁹ "Assembly, No. 3723", State of New Jersey, 218th Legislature, (March 22, 2018), <http://www.njleg.state.nj.us/2018/Bills/A4000/3723_11.PDF>.

⁷⁰ SREC volume obtained through PJM Environmental Information Services <<https://www.pjm-eis.com/reports-and-events/public-reports.aspx>> (Accessed March 1, 2019).

⁷¹ Solar REC average price information obtained through Evomarkets, <<http://www.evomarkets.com>> (Accessed Jan. 24, 2019).

load that must be met with all eligible technologies, including Tier I, Tier II and alternative energy resources in all PJM jurisdictions with RPS. States with higher percent requirements for renewable and alternative energy resources are shaded darker. Jurisdictions with no standards or with only voluntary renewable standards are shaded gray. Pennsylvania's RPS illustrates the need to differentiate between percent requirements for Tier I and Tier II resources separately. Like all other PJM states with mandatory RPS, the Pennsylvania RPS identifies solar photovoltaic, solar thermal, wind, geothermal, biomass, and low-impact hydropower as Tier I resources. The Pennsylvania RPS identifies waste coal, demand side management, large-scale hydropower, integrated gasification combined cycle, clean coal and municipal solid waste as eligible Tier II resources. As a result, the 14.7 percent number in Figure 8-9 overstates the percent of retail electric load in Pennsylvania that must be served by renewable energy resources. The 6.5 percent number in Figure 8-8 is a more accurate measure of the percent of retail electric load in Pennsylvania that must be served by renewable energy resources.

Figure 8-8 Map of retail electric load shares under RPS – Tier I resources only: 2018


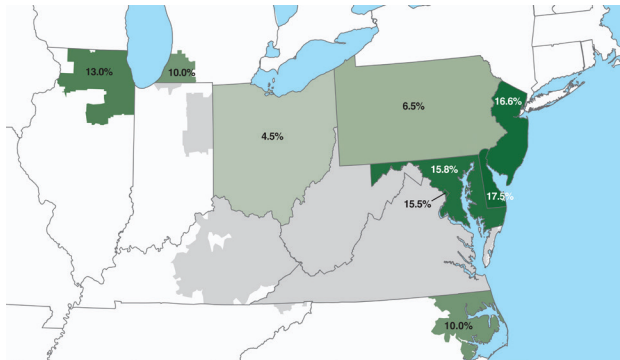


Figure 8-9 Map of retail electric load shares under RPS – Tier I and Tier II resources: 2018

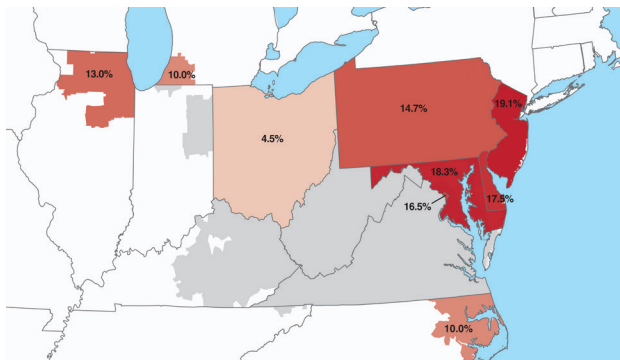

Under the existing state renewable portfolio standards, approximately 9.4 percent of PJM load must be served by Tier I and Tier II renewable and alternative energy resources in 2018 and, if the proportion of load among states remains constant, 16.3 percent of PJM load must be served by renewable and alternative energy resources in 2028 under defined RPS rules. Approximately 7.4 percent of PJM load must be served by Tier I renewables in 2018 and, if the proportion of load among states remains constant, 14.1 percent of PJM load must be served by Tier I renewables in 2028 under defined RPS rules.

In jurisdictions with an RPS, load serving entities must either generate power from eligible technologies identified in each jurisdiction's RPS or purchase RECs from resources classified as eligible technologies. Table 8-7 shows generation by jurisdiction and resource type for 2018. Wind output was 21,542.1 GWh of 37,612.4 Tier I GWh, or 57.3 percent, in the PJM footprint. As shown in Table 8-7, 60,177.8 GWh were generated by Tier I and Tier II resources, of which Tier I resources were 62.5 percent. Total wind and solar generation was 2.9 percent of total generation in PJM for 2018. Tier I generation was 4.5 percent of total generation in PJM and Tier II was 2.7 percent of total generation in PJM for 2018. Landfill gas, solid waste and waste coal were 17,882.0 GWh, or 29.7 percent of the total Tier I and Tier II.

Table 8-7 Tier I and Tier II generation by jurisdiction and renewable resource type (GWh): 2018

Jurisdiction	Tier I				Total Tier I Credit	Tier II			Total Tier II Credit	Total Credit GWh
	Landfill Gas	Run-of-River Hydro	Solar	Wind		Pumped-Storage Hydro	Solid Waste	Waste Coal		
Delaware	34.3	0.0	0.0	0.0	34.3	0.0	0.0	0.0	0.0	34.3
Illinois	110.8	0.0	14.0	8,602.4	8,727.2	0.0	0.0	0.0	0.0	8,727.2
Indiana	19.4	49.2	13.4	4,795.7	4,877.8	0.0	0.0	0.0	0.0	4,877.8
Kentucky	0.0	314.5	0.0	0.0	314.5	0.0	0.0	0.0	0.0	314.5
Maryland	68.0	0.0	391.6	740.8	1,200.3	0.0	669.1	0.0	669.1	1,869.4
Michigan	25.6	65.9	7.4	0.0	98.8	0.0	0.0	0.0	0.0	98.8
New Jersey	275.9	35.7	606.7	12.6	930.8	313.6	1,396.7	0.0	1,710.3	2,641.1
North Carolina	0.0	869.9	568.0	542.6	1,980.5	0.0	0.0	0.0	0.0	1,980.5
Ohio	371.6	669.2	1.3	1,674.4	2,716.6	0.0	0.0	0.0	0.0	2,716.6
Pennsylvania	770.5	6,958.5	22.5	3,569.9	11,321.4	2,108.8	1,289.0	7,356.1	10,753.9	22,075.3
Tennessee	0.0	1,185.3	0.0	0.0	1,185.3	0.0	0.0	0.0	0.0	1,185.3
Virginia	600.9	594.2	469.7	0.0	1,664.8	4,583.9	875.9	2,958.1	8,417.9	10,082.7
Washington, D.C.	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
West Virginia	45.9	910.6	0.0	1,603.7	2,560.1	0.0	0.0	1,014.3	1,014.3	3,574.4
Total	2,322.8	11,652.9	2,094.5	21,542.1	37,612.4	7,006.3	4,230.7	11,328.4	22,565.5	60,177.8
Percent of Renewable Generation	3.9%	19.4%	3.5%	35.8%	62.5%	11.6%	7.0%	18.8%	37.5%	100.0%
Percent of Total Generation	0.3%	1.4%	0.3%	2.6%	4.5%	0.8%	0.5%	1.4%	2.7%	7.2%

Figure 8-10 shows the average hourly output by fuel type for January 1 through December 31 of 2014 through 2018. Tier I includes landfill gas, run-of-river hydro, solar and wind resources, as defined by the relevant states. Tier II includes pumped storage, solid waste and waste coal resources, as defined by the relevant states. Other includes biomass, miscellaneous, heavy oil, light oil, coal gas, propane, diesel, distributed generation, other biogas, kerosene and batteries.⁷²

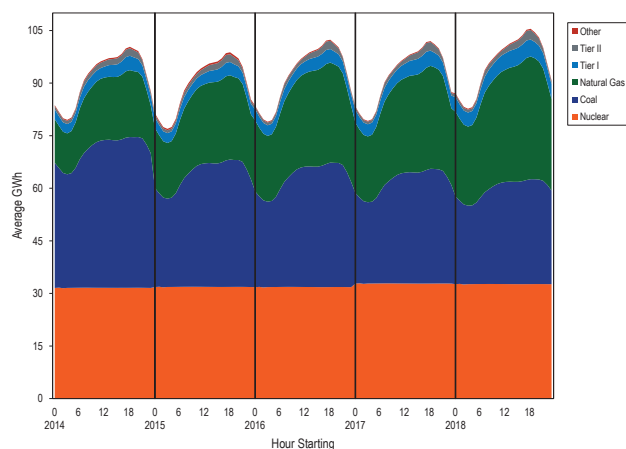
Figure 8-10 Average hourly output by fuel type: 2014 through 2018

Table 8-8 shows the capacity of Tier I and Tier II resources in PJM by jurisdiction, as defined by primary fuel type. This capacity includes coal and natural gas units that qualify because they have a renewable fuel

as an alternative fuel. For example, a coal generator that can also burn waste coal to generate power could list the alternative fuel as waste coal. A REC is only generated when using the fuel listed as Tier I or Tier II. New Jersey has the largest amount of solar capacity in PJM, 543.3 MW, or 31.5 percent of the total solar capacity. New Jersey's SREC prices were the highest in PJM at \$673 per REC in 2009, and at \$214 per REC in 2018. Wind resources are located primarily in western PJM, in Illinois and Indiana, which include 4,974.2 MW, or 61.1 percent of the total wind capacity.

⁷² 2018 State of the Market Report for PJM, Volume 2, Section 3: Energy Market, Table 3-9.

Table 8-8 PJM renewable capacity by jurisdiction (MW): December 31, 2018

Jurisdiction	Landfill		Natural	Oil	Pumped-		Run-of-	Solar	Solid	Waste		Total
	Coal	Gas	Gas		Storage	River	Hydro		Waste	Coal	Wind	
Delaware	0.0	8.1	1,797.0	13.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1,818.1
Illinois	0.0	45.8	360.0	0.0	0.0	0.0	0.0	9.0	0.0	0.0	3,337.2	3,752.0
Indiana	0.0	8.0	0.0	0.0	0.0	0.0	8.2	10.1	0.0	0.0	2,022.5	2,048.8
Kentucky	0.0	0.0	0.0	0.0	0.0	0.0	166.0	0.0	0.0	0.0	0.0	166.0
Maryland	0.0	24.3	0.0	69.0	0.0	0.0	494.4	204.3	128.2	0.0	190.0	1,110.2
Michigan	0.0	8.0	0.0	0.0	0.0	0.0	13.9	4.6	0.0	0.0	0.0	26.5
Missouri	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	146.0	146.0
New Jersey	0.0	77.7	0.0	0.0	0.0	453.0	11.0	543.3	162.0	0.0	4.5	1,251.4
North Carolina	0.0	0.0	0.0	0.0	0.0	0.0	465.0	450.7	0.0	0.0	208.0	1,123.7
Ohio	9,910.0	68.2	0.0	156.0	0.0	0.0	119.1	1.1	0.0	0.0	669.8	10,924.2
Pennsylvania	0.0	201.8	2,346.0	0.0	1,269.0	0.0	893.3	19.5	261.8	1,611.0	1,367.2	7,969.6
Tennessee	0.0	0.0	0.0	0.0	0.0	0.0	156.6	0.0	0.0	0.0	0.0	156.6
Virginia	0.0	134.1	0.0	17.0	0.0	5,347.5	169.2	479.2	123.0	585.0	0.0	6,855.0
West Virginia	0.0	5.4	0.0	0.0	0.0	0.0	257.9	0.0	0.0	165.0	686.3	1,114.6
PJM Total	9,910.0	581.3	4,503.0	255.0	0.0	7,069.5	2,754.5	1,721.8	675.0	2,361.0	8,631.4	38,462.5

Table 8-9 shows renewable capacity registered in the PJM generation attribute tracking system (GATS). For example, roof top solar panels within the PJM footprint generate SRECs but are not PJM units. This includes solar capacity of 5,029.2 MW of which 2,048.2 MW is in New Jersey. These resources can earn renewable energy credits, and can be used to fulfill the renewable portfolio standards in PJM jurisdictions. There are 2,020 MW of capacity located in jurisdictions outside PJM that may qualify for specific renewable energy credits in some PJM jurisdictions. For example, there are 141.5 MW of capacity registered with GATS located in Alabama.

Table 8-9 Renewable capacity by jurisdiction, non-PJM units registered in GATS (MW): on December 31, 2018⁷³

Jurisdiction	Coal	Hydroelectric	Landfill	Natural	Other	Other	Solar	Solid	Wind	Total
			Gas	Gas	Gas	Source		Waste		
Alabama	0.0	0.0	0.0	0.0	0.0	0.0	0.0	141.5	0.0	141.5
Arkansas	0.0	0.0	0.0	0.0	18.0	0.0	0.0	0.0	0.0	18.0
Delaware	0.0	0.0	2.2	0.0	0.0	0.0	109.2	0.0	2.1	113.5
Georgia	0.0	0.0	0.0	0.0	0.0	0.0	152.2	258.9	0.0	411.1
Illinois	0.0	21.4	97.3	0.0	5.5	0.0	76.6	0.0	300.3	501.2
Indiana	0.0	0.0	46.4	0.0	5.2	109.6	83.5	0.0	180.0	424.7
Iowa	0.0	0.0	1.6	0.0	0.0	0.0	3.2	0.0	336.8	341.6
Kentucky	600.0	162.2	18.6	0.0	0.4	0.0	36.8	93.0	0.0	911.0
Louisiana	0.0	0.0	0.0	0.0	0.0	0.0	0.0	129.2	0.0	129.2
Maryland	65.0	0.0	12.7	129.0	0.0	0.0	878.3	15.0	0.3	1,100.3
Michigan	55.0	1.3	4.8	0.0	0.0	0.0	4.9	31.0	29.4	126.4
Missouri	0.0	0.0	5.6	0.0	0.0	0.0	19.6	0.0	451.0	476.2
New Jersey	0.0	0.0	43.5	0.0	11.6	0.0	2,048.2	0.0	4.8	2,108.2
New York	0.0	0.0	0.0	0.0	0.0	0.0	0.4	0.0	0.0	0.4
North Carolina	0.0	430.4	0.0	0.0	0.0	0.0	898.2	151.5	0.0	1,480.1
North Dakota	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	360.0	360.0
Ohio	0.0	6.6	30.8	52.0	14.2	32.4	194.1	92.8	47.4	470.4
Pennsylvania	109.7	31.7	45.2	88.5	15.1	5.0	336.9	8.6	3.3	643.8
South Carolina	0.0	0.0	30.8	0.0	0.0	0.0	0.0	0.0	0.0	30.8
Tennessee	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
Texas	0.0	0.0	0.0	0.0	0.0	0.0	0.0	57.7	0.0	57.7
Virginia	0.0	17.9	11.3	0.0	3.1	0.0	123.1	287.6	0.0	443.0
West Virginia	0.0	0.0	0.0	0.0	0.0	0.0	4.1	0.0	0.0	4.1
Wisconsin	0.0	9.0	0.0	0.0	0.0	0.0	0.3	44.6	0.0	53.9
District of Columbia	0.0	0.0	0.0	0.0	49.4	0.0	59.4	0.0	0.0	108.8
Total	829.7	680.5	350.8	269.5	122.4	147.0	5,029.2	1,311.4	1,715.5	10,455.9

⁷³ See PJM – EIS (Environmental Information Services), Generation Attribute Tracking System, "Renewable Generators Registered in GATS," <<https://gats.pjm-eis.com/gats2/PublicReports/RenewableGeneratorsRegisteredinGATS>>.

Renewable energy credits are related to the production and purchase of wholesale power, but have not, when they constitute a transaction separate from a wholesale sale of power, been found subject to FERC regulation.⁷⁴ REC markets are, as an economic fact, integrated with PJM markets including energy and capacity markets, but are not formally recognized as part of PJM markets. Revenues from REC markets are revenues for PJM resources earned in addition to revenues earned from the sale of the same MWh in PJM markets. FERC has found that such revenues can be appropriately considered in the rates established through the operation of wholesale organized markets.⁷⁵ This decision is an important recognition of the integration of the REC markets and the other PJM markets.

Delaware, North Carolina, Michigan and Virginia allow various types of resources to earn multiple RECs per MWh, though typically one REC is equal to one MWh. For example, Delaware provided a three MWh REC for each MWh produced by in-state customer sited photovoltaic generation and fuel cells using renewable fuels that are installed on or before December 31, 2014.⁷⁶ This is equivalent to providing a REC price equal to three times its stated value per MWh. PJM Environmental Information Services (EIS), an unregulated subsidiary of PJM, operates the generation attribute tracking system (GATS), which is used by many jurisdictions to track these renewable energy credits.⁷⁷

In addition to GATS, there are several other REC tracking systems used by states in the PJM footprint. Illinois, Indiana and Ohio use both GATS and M-RETS, the REC tracking system for resources located in the Midcontinent ISO, to track the sales of RECs used to fulfill their RPS requirements. Michigan and North

Carolina have created their own state-wide tracking systems, MIRECS and NC-RETS, through which all RECs used to satisfy these states' RPS requirements must ultimately be traded. Table 8-10 shows the REC tracking systems used by each state within the PJM footprint.

Table 8-10 REC Tracking systems in PJM states with renewable portfolio standards

Jurisdiction with RPS	REC Tracking System Used	
Delaware	PJM-GATS	
Illinois	PJM-GATS	M-RETS
Maryland	PJM-GATS	
Michigan	MIRECS	
New Jersey	PJM-GATS	
North Carolina	NC-RETS	
Ohio	PJM-GATS	M-RETS
Pennsylvania	PJM-GATS	
Washington, D.C.	PJM-GATS	
Jurisdiction with Voluntary Standard		
Indiana	PJM-GATS	M-RETS
Virginia	PJM-GATS	

All PJM states with renewable portfolio standards have specified geographical restrictions governing the source of RECs to satisfy states' standards. Table 8-11 describes these restrictions. Indiana, Illinois, Michigan, and Ohio all have provisions in their renewables standards that require all or a portion of RECs used to comply with each state's standards to be generated by in-state resources. North Carolina has provisions that require RECs to be purchased from in-state resources but Dominion, the only utility located in both North Carolina and PJM, is exempt from these provisions. Pennsylvania added a provision in 2017 that requires SRECs used to comply with Pennsylvania's solar photovoltaics carve out standard to be sourced from resources located in Pennsylvania.

Pennsylvania requires that RECs used for compliance with its RPS are produced from resources located within the PJM footprint. Virginia requires that every load serving entity that chooses to participate in its voluntary renewable energy standard purchase RECs from the control area or RTO in which it is located. Delaware requires that RECs used for compliance with its RPS are produced from resources located within the PJM footprint or resources located elsewhere if these resources can demonstrate that the power they produce is directly deliverable to Delaware. The District of Columbia, Maryland and New Jersey allow RECs to be purchased from resources located within PJM in addition to large areas that adjoin PJM for compliance with their standards.

⁷⁴ See *WSPF, Inc.*, 139 FERC ¶ 61,051 at P 18 (2012) ("we conclude that unbundled REC transactions fall outside of the Commission's jurisdiction under sections 201, 205 and 206 of the FPA. We further conclude that bundled REC transactions fall within the Commission's jurisdiction under sections 201, 205 and 206 of the FPA"); citing *American Ref-Fuel Company, et al.*, 105 FERC ¶ 61,004 at PP 23-24 (2003) ("American Ref-Fuel, 105 FERC ¶ 61,004 at PP 23-24 ("RECs are created by the States. They exist outside the confines of PURPA... And the contracts for sales of OF capacity and energy, entered into pursuant to PURPA, ... do not control the ownership of RECs."); see also *Williams Solar LLC and Allico Finance Limited*, 156 FERC ¶ 61,042 (2016).

⁷⁵ See *ISO New England, Inc.*, 146 FERC ¶ 61,084 (2014) at P 32 ("We disagree with Exelon's argument that the Production Tax Credit and Renewable Energy Credits should be considered [out-of-market (OOM)] revenues. The relevant, Commission-approved Tariff provision defines OOM revenues as any revenues that are (i) not tradable throughout the New England Control Area or that are restricted to resources within a particular state or other geographic sub-region; or (ii) not available to all resources of the same physical type within the New England Control Area, regardless of the resource owner. [footnote omitted] Neither Production Tax Credit nor Renewable Energy Credits revenues fall within this definition.")

⁷⁶ See DSIRE, NC Clean Energy Technology Center. Delaware Renewable Portfolio Standard. <<http://programs.dsireusa.org/system/program/detail/1231>> (Accessed November 3, 2018).

⁷⁷ GATS publishes details on every renewable generator registered within the PJM footprint and aggregate emissions of renewable generation, but does not publish generation data by unit and does not make unit data available to the MMU.

Table 8-11 Geographic restrictions on REC purchases for renewable portfolio standard compliance in PJM states

State with RPS	RPS Contains	
	In-state Provision	Geographical Requirements for RPS Compliance
Delaware	No	RECs must be purchased from resources located either within PJM or from resources outside of PJM that are directly deliverable into Delaware.
Illinois	Yes	All RECs must first be purchased from resources located within Illinois or resources located in a state directly adjoining Illinois. If there are insufficient RECs from Illinois and adjoining states to fulfill the RPS requirements, utilities may purchase RECs from anywhere.
Maryland	No	RECs must come from within PJM, 10-30 miles offshore the coast of Maryland or from a control area adjacent to PJM that is capable of delivering power into PJM.
Michigan	Yes	RECs must either come from resources located within Michigan or anywhere in the service territory of retail electric provider in Michigan that is not an alternative electric supplier. There are many exceptions to these requirements (see Michigan S.B. 213).
New Jersey	No	RECs must either be purchased from resources located within PJM or from resources located outside of PJM for which the energy associated with the REC is delivered to PJM via dynamic scheduling.
North Carolina	Yes	Dominion, the only utility located in both the state of North Carolina and PJM, may purchase RECs from anywhere. Other utilities in North Carolina not located in PJM are subject to different REC requirements (see G.S. 62-113.8).
Ohio	Yes	All RECs must be generated from resources that are located in the state of Ohio or have the capability to deliver power directly into Ohio. Any renewable facility located in a state contiguous to Ohio has been deemed deliverable into the state of Ohio. For renewable resources in noncontiguous states, deliverability must be demonstrated to the Public Utilities Commission of Ohio.
Pennsylvania	Yes	RECs must be purchased from resources located within PJM. All SRECs used for compliance with the Solar PV standard must source from solar PV resources within the state of Pennsylvania.
Washington, D.C.	No	RECs must be purchased from either a PJM state or a state adjacent with PJM. A PJM state is defined as any state with a portion of their geographical boundary within the footprint of PJM. An adjacent state is defined as a state that lies next to a PJM state, i.e. SC, GA, AL, AR, IA, NY, MO, MS, and WI.
State with Voluntary Standard		
Indiana	Yes	At least 50 percent of RECs must be purchased from resources located within Indiana.
Virginia	No	RECs must be purchased from the RTO or control area in which the participating utility is a member.

Carbon Pricing

Table 8-12 shows the impact of a range of carbon prices on the cost per MWh of producing energy from three basic unit types.^{78 79} For example, if the price of carbon were \$50.00 per tonne, the short run marginal costs would increase by \$25.04 per MWh for a new combustion turbine (CT) unit, \$17.72 per MWh for a new combined cycle (CC) unit and \$43.15 per MWh for a new coal plant (CP).

Table 8-12 Carbon price per MWh by unit type

Unit Type	Carbon Price per MWh						
	Carbon \$5/tonne	Carbon \$10/tonne	Carbon \$15/tonne	Carbon \$50/tonne	Carbon \$100/tonne	Carbon \$200/tonne	Carbon \$400/tonne
CT	\$2.50	\$5.01	\$7.51	\$25.04	\$50.08	\$100.16	\$200.33
CC	\$1.77	\$3.54	\$5.32	\$17.72	\$35.45	\$70.89	\$141.78
CP	\$4.32	\$8.63	\$12.95	\$43.15	\$86.30	\$172.60	\$345.21

Table 8-12 also illustrates the effective cost of carbon included in the price of a REC or SREC. For example, the average price of an SREC in New Jersey was \$213.65 per MWh in 2018. The SREC price is paid in addition to the energy price paid at the time the solar energy is produced. If the MWh produced by the solar resource resulted in avoiding the production of a MWh from a CT, the value of carbon reduction implied by the SREC price is a carbon price of approximately \$400 per tonne. This result also assumes that the entire value of the SREC was based on reduced carbon emissions. The SREC price consistent with a carbon price of \$50.00 per tonne, assuming that a MWh from a CT is avoided, is \$25.04 per MWh.

Applying this method to tier I REC and SREC price histories yields the implied carbon prices in Table 8-13. The carbon price implied by the 2018 average REC price in Ohio of \$8.60 per tonne is higher than the RGGI clearing

⁷⁸ Heat rates from: 2018 State of the Market Report for PJM, Volume 2, Section 7: Net Revenue, Table 7-4.

⁷⁹ Carbon emissions rates from: Table A.3. Carbon Dioxide Uncontrolled Emission Factors, Energy Information Administration, <https://www.eia.gov/electricity/annual/html/cpa_a_03.html> (Accessed July 24, 2018).

price of \$4.86 per tonne and lower than the social cost of carbon which is estimated in the range of \$40 per tonne.⁸⁰ The carbon price implied by the 2018 average REC price in Washington, D.C. is \$4.67 per tonne. The carbon prices implied by REC prices in Maryland, New Jersey, and Pennsylvania for 2018 are more consistent with the social cost of carbon than the RGGI price. The carbon prices implied by SREC prices have no apparent relationship to carbon prices implied by the REC clearing prices. Except for Pennsylvania, the carbon prices implied by SREC prices are significantly greater than the prices implied by REC prices in each jurisdiction and in some cases significantly higher than the social price of carbon.

solar credits be 200 percent of the average market value of solar RECs sold in the RTO plus the value of any solar rebates. For all states with an alternative compliance payment, the alternative compliance payment creates a cap on REC prices. The 2018 average SREC price in New Jersey was \$213.65 compared to the alternative compliance payment level of \$268.00 per MWh. In 2011, the solar alternative compliance payment level in New Jersey was \$658 per MWh and as shown in Figure 8-7 New Jersey SREC prices exceeded \$600 per MWh in 2011. Illinois requires that 50 percent of the state's renewable portfolio standard be met through alternative compliance payments. In Michigan and North Carolina, there are no pre-established values for alternative compliance payments. The public utility commissions

Table 8-13 Implied carbon price based on REC and SREC prices: 2009 through 2018^{81 82}

	2009	2010	2011	2012	2013	2014	2015	2016	2017	2018
Jurisdiction with Tier I or Class I REC										
Carbon Price (\$ per Metric Tonne) Implied by REC Prices										
Delaware					\$35.94	\$36.94	\$32.05	\$33.24	\$12.09	\$11.74
Maryland	\$2.03	\$1.88	\$3.00	\$6.21	\$17.10	\$27.86	\$30.40	\$32.66	\$34.53	\$35.20
New Jersey	\$13.07	\$17.37	\$8.40	\$4.64	\$12.82	\$20.60	\$24.77	\$26.37	\$23.51	\$23.65
Ohio						\$9.95	\$8.34	\$5.18	\$6.14	\$8.60
Pennsylvania	\$6.68	\$7.96	\$3.26	\$4.20	\$15.54	\$26.10	\$29.55	\$32.79	\$34.67	\$35.41
Washington, D.C.							\$3.83	\$4.31	\$4.78	\$4.67
Jurisdiction with Solar REC										
Carbon Price (\$ per Metric Tonne) Implied by Solar REC Prices										
Delaware						\$114.81	\$83.63	\$84.69	\$42.45	\$56.91
Maryland		\$534.77	\$484.27	\$374.62	\$298.21	\$286.62	\$290.46	\$286.56	\$247.35	\$206.38
New Jersey	\$1,343.86	\$1,324.06	\$1,281.81	\$525.92	\$338.75	\$319.44	\$380.66	\$415.40	\$449.67	\$426.60
Ohio						\$80.61	\$63.52	\$68.09	\$70.89	
Pennsylvania	\$597.38	\$578.30	\$370.81	\$99.69	\$66.92	\$74.33	\$65.50	\$53.91	\$42.93	\$17.71
Washington, D.C.	\$698.17	\$427.22	\$491.20	\$641.90	\$936.69	\$937.57	\$973.40	\$972.85	\$848.18	\$812.07
Regional Greenhouse Gas Initiative										
CO₂ Allowance Price (\$ per Metric Tonne)										
RGGI clearing price	\$3.06	\$2.12	\$2.08	\$2.13	\$3.22	\$5.21	\$6.72	\$4.93	\$3.77	\$4.86

Alternative Compliance Payments

PJM jurisdictions have various methods for complying with required renewable portfolio standards. If a retail supplier is unable to comply with the renewable portfolio standards required by the jurisdiction, suppliers may make alternative compliance payments, with varying standards, to cover any shortfall between the RECs required by the state and those the retail supplier actually purchased. In New Jersey, solar alternative compliance payments are \$268.00 per MWh.⁸³ Pennsylvania requires that the alternative compliance payment for

in Michigan and North Carolina have the discretionary power to assess what a load serving entity must pay for any RPS shortfalls.

Table 8-14 shows the alternative compliance standards for RPS in PJM jurisdictions.

⁸⁰ "Technical Update of the Social Cost of Carbon for Regulatory Impact Analysis – Under Executive Order 12899," Interagency Working Group on the Social Cost of Greenhouse Gases, United States Government, (Aug. 2016), <https://19january2017snapshot.epa.gov/sites/production/files/2016-12/documents/sc_co2_tsd_august_2016.pdf>.

⁸¹ The 2017 and 2018 weighted average procurement prices reported by the SREC Delaware Program were used in the derivation of the Delaware implied carbon price <<http://www.srecdelaware.com/documentation/>>. All other SREC prices used in the derivation of the implied carbon price are average annual prices obtained through Evomarkets, <<http://www.evomarkets.com>> (Accessed Jan. 23, 2018).

⁸² There were no trades in 2018 for Ohio SRECs available in the Evomarkets data.

⁸³ N.J. S. 2314/A. 3723.

Table 8-14 Tier I and Tier II alternative compliance payments in PJM jurisdictions: December 31, 2018^{84, 85}

Jurisdiction with RPS	Standard Alternative Compliance (\$/MWh)	Tier II Alternative Compliance (\$/MWh)	Solar Alternative Compliance (\$/MWh)
Delaware	\$25.00		\$400.00
Illinois	\$1.89		
Maryland	\$37.50	\$15.00	\$175.00
Michigan	No specific penalties		
New Jersey	\$50.00		\$268.00
North Carolina	No specific penalties: At the discretion of the NC Utility Commission		
Ohio	\$51.31		\$250.00
Pennsylvania	\$45.00	\$45.00	200% market value plus rebates
Washington, D.C.	\$50.00	\$10.00	\$500.00
Jurisdiction with Voluntary Standard			
Indiana	Voluntary standard - No Penalties		
Virginia	Voluntary standard - No Penalties		
Jurisdiction with No Standard			
Kentucky	No standard		
Tennessee	No standard		
West Virginia	No standard		

Load serving entities participating in mandatory RPS programs in PJM jurisdictions must submit compliance reports to the relevant jurisdiction's public utility commission. In their submitted compliance reports, load serving entities must indicate the quantity of MWh that they have generated using eligible renewable or alternative energy resources. They must also identify the quantity of RECs they may have purchased to make up for renewable energy generation shortfalls or to comply with RPS provisions requiring that they purchase RECs. The public utility commissions then release RPS compliance reports to the public.

The Pennsylvania Public Utility Commission issued their 2017 compliance report for the Pennsylvania Alternative Energy Standards Act of 2004 during the first quarter of 2018.⁸⁶ Pennsylvania reported that the 20,634,311 credits retired during the compliance year exceeded the amount required by the standards by 1,995 credits. Not all suppliers met the required standard. Supplier obligations for six Tier I credits and 14 Tier II credits, were resolved through alternative compliance payments.

The Public Service Commission of the District of Columbia reported that 1,645,545 credits were retired

during the 2017 compliance year and there was a significant increase in compliance payments.⁸⁷ Compliance payments were \$26,571,010 for 2017, a 74.4 percent increase over the compliance payments for 2016. Solar standards contributed to the increase in compliance payments. Solar REC retirements in 2017 were 50.5 percent lower than solar REC retirements in 2016, with 30,765 solar RECs retired in 2017 and 62,173 retired in 2016.

The Public Service Commission of Maryland reported that "suppliers retired over 9.0 million RECs in 2017, slightly less than both the calculated obligation for the year and the 9.1 million RECs retired for compliance in 2016."⁸⁸ Alternative compliance payments totaled \$55,032 for 2017 with the majority of payments "made in lieu of purchasing Tier 1 RECs to satisfy Industrial Load Process ("IPL") obligations."⁸⁹

The Public Utilities Commission of Ohio reported that 2,682,588 non solar credits were retired in the 2016 compliance year, exceeding the credit obligation of 2,675,926 credits; and 135,146 solar credits were retired in the 2016 compliance year, exceeding the solar credit obligation of 134,828.⁹⁰ There were no alternative compliance payments for the 2016 compliance year.

Delmarva Power is the only retail electric supplier that must file a compliance report with the Delaware Public Service Commission. Delmarva Power reported to the Delaware Public Service Commission that they satisfied their REC obligation of 567,372 credits for the compliance year ending May 31, 2018 with zero

⁸⁴ The Ohio standard alternative compliance payment (ACP) is updated annually <<https://www.puco.ohio.gov/industry-information/industry-topics/acp-non-solar-alternative-compliance-payment-under-orc-492864/>>. The Illinois Commerce Commission periodically publishes updates to the effective ACP amount <<https://www.icc.illinois.gov/electricity/RPSCompliancePaymentNotices.aspx>>. For updated Maryland ACPs, see Table 3 of the 2017 Renewable Energy Portfolio Standard Report <<https://www.psc.state.md.us/commission-reports/>>. Pennsylvania ACPs are described on p. 43 of the 2017 Annual Report on the Alternative Energy Portfolio Standard <<https://www.pennaeps.com/reports/>>.

⁸⁵ See DSIRE, "Database of State Incentives for Renewables & Efficiency, "Policies & Incentives by State," <<http://www.dsireusa.org/>> (Accessed February 21, 2019).

⁸⁶ "2017 Annual Report - Alternative Energy Portfolio Standards Act of 2004," (March 2018), <<http://www.pennaeps.com/reports/>>.

⁸⁷ "Report on the Renewable Energy Portfolio Standard for Compliance Year 2017," Public Service Commission of the District of Columbia, (May 1, 2018), <<https://www.dcpsc.org/Utility-Information/Electric/Renewables/Renewable-Energy-Portfolio-Standard-Program.aspx>>.

⁸⁸ "Renewable Energy Portfolio Standard Report," Public Service Commission of Maryland, p. 7, November 2018, <<https://www.psc.state.md.us/wp-content/uploads/FINAL-Renewable-Energy-Portfolio-Standard-Report-with-data-for-CY-2017.pdf>>.

⁸⁹ Ibid., p. 8.

⁹⁰ "Renewable Portfolio Standard Report to the General Assembly for Compliance Year 2016," Public Utilities Commission of Ohio, (February 21, 2019), <<https://www.puco.ohio.gov/industry-information/industry-topics/ohioe28099s-renewable-and-advanced-energy-portfolio-standard/>>.

alternative compliance payments.⁹¹ Delmarva Power satisfied their solar REC obligation of 105,352 credits with zero alternative compliance payments.

The Illinois RPS requires electricity suppliers to satisfy at least 50 percent of their RPS obligation through alternative compliance payments. The Illinois Power Agency reported that most suppliers satisfied the remaining portion of their obligation for 2017 through the purchase of RECs rather than incur additional alternative compliance payments.⁹²

The North Carolina Utilities Commission reported that all electric power suppliers met or appear to have met the 2017 renewable energy portfolio standard, solar energy requirement, and poultry waste energy requirement.⁹³ ⁹⁴ The implementation of the swine waste energy requirement has been delayed and electric power suppliers were not subject to the swine waste energy requirement for 2017.

The Michigan Public Service Commission reported that electric power suppliers met the 2017 renewable energy standards by retiring 10,218,115 RECs.⁹⁵

New Jersey's Office of Clean Energy posted a summary of RPS compliance through the energy year ending May 31, 2018.⁹⁶ Electric power suppliers retired 9,166,102 class I RECs and 1,758,180 class II RECs. Alternative compliance payments were submitted for deficiencies of 24 class I credits and 9 class II credits. Electric power suppliers retired 2,357,814 solar RECs and there were no deficiencies requiring alternative compliance payments.

91 "Retail Electricity Supplier's RPS Compliance Report, Compliance Period: June 1, 2016 – May 31, 2017," Delmarva Power, (Sept. 25, 2018), <<https://depdc.delaware.gov/delawares-renewable-portfolio-standard-green-power-products/>>.

92 "Annual Report Fiscal Year 2017," Illinois Power Agency, p. 44, (Feb. 15, 2018), <<https://www2.illinois.gov/sites/ipa/Documents/Annual-Report-Illinois-Power-Agency-FY2017.pdf>>.

93 "Annual Report Regarding Renewable Energy and Energy Efficiency Portfolio Standard in North Carolina," North Carolina Utilities Commission, (Oct. 1, 2018), <<https://www.ncuc.net/Reps/Reps.html>>.

94 Ibid. at p. 53. Compliance plan approvals are pending for one municipally-owned electric utility and one electric membership corporation (EMC).

95 "Report on the Implementation and Cost-Effectiveness of the P.A. 295 Renewable Energy Standard," Michigan Public Service Commission, (Feb. 15, 2019), <<https://www.michigan.gov/mpsc/0,4639,7-159-16393---,00.html>>.

96 See RPS Report Summary 2005-2018, (Nov. 1, 2017), <<http://www.njcleanenergy.com/renewable-energy/program-updates/rps-compliance-reports>>.

Emissions Controlled Capacity and Renewables in PJM Markets

Emission Controlled Capacity in the PJM Region

Environmental regulations affect decisions about emission control investments in existing units, investment in new units and decisions to retire units lacking emission controls.⁹⁷ Most PJM units burning fossil fuels have installed emission control technology. All coal steam units in PJM are compliant with the state and federal emissions limits established by MATS.

Coal has the highest SO₂ emission rate, while natural gas and diesel oil have lower SO₂ emission rates.⁹⁸ Of the current 67,952.7 MW of coal capacity in PJM, 63,602.4 MW of capacity, 93.6 percent, has some form of FGD (flue-gas desulfurization) technology to reduce SO₂ emissions. Table 8-15 shows SO₂ emission controls by fossil fuel fired units in PJM.⁹⁹ ¹⁰⁰ ¹⁰¹

Table 8-15 SO₂ emission controls by fuel type (MW): on December 31, 2018¹⁰²

	SO ₂ Controlled	No SO ₂ Controls	Total	Percent Controlled
Coal	63,602.4	4,350.3	67,952.7	93.6%
Diesel Oil	0.0	5,379.6	5,379.6	0.0%
Natural Gas	0.0	75,741.0	75,741.0	0.0%
Other	325.0	4,805.7	5,130.7	6.3%
Total	63,927.4	90,276.6	154,204.0	41.5%

NO_x emission control technology is used by all fossil fuel fired unit types. Of current fossil fuel fired units in PJM, 145,309.8 MW, 94.2 percent, of 154,204.0 MW of capacity in PJM, have emission controls for NO_x. Table 8-16 shows NO_x emission controls by unit type in PJM. While most units in PJM have NO_x emission controls, many of these controls may need to be upgraded in order to meet each state's emission compliance standards based on whether a state is part of CSAPR, CAIR, Acid Rain Program (ARP) or a combination of the three.

97 See EPA. "National Ambient Air Quality Standards (NAAQS)," <<https://www.epa.gov/criteria-air-pollutants/naaqs-table>> (Accessed July 24, 2018).

98 Diesel oil includes number 1, number 2, and ultra-low sulfur diesel. See EPA. "Electronic Code of Federal Regulations, Title 40, Chapter 1, Subchapter C, Part 72, Subpart A Section 72.2," <http://www.ecfr.gov/cgi-bin/text-idx?SID=4f18612541a393473efb13acb879d470&mc=true&node=se40.18.72_12&trgn=div8> (Accessed July 24, 2018).

99 See EPA. "Air Market Programs Data," <<http://ampd.epa.gov/ampd/>> (Accessed February 12, 2019).

100 Air Markets Programs Data is submitted quarterly. Generators have 60 days after the end of the quarter to submit data, and all data is considered preliminary and subject to change until it is finalized in June of the following year.

101 The total MW are less than the 184,559.5 reported in Section 5: Capacity Market, because EPA data on controls could not be matched to some PJM units. "Air Markets Program Data," <<http://ampd.epa.gov/ampd/QueryToolie.html>> (Accessed Oct. 5, 2018).

102 The "other" category includes petroleum coke, wood, process gas, residual oil, other gas, and other oil. The EPA's "other" category does not have strict definitions for inclusion.

Future NO_x compliance standards will require selective catalytic reduction (SCRs) or selective non-catalytic reduction (SCNRs) for coal steam units, as well as SCRs or water injection technology for peaking combustion turbine units.¹⁰³

Table 8-16 NO_x emission controls by fuel type (MW): on December 31, 2018

	NO _x Controlled	No NO _x Controls	Total	Percent Controlled
Coal	67,417.9	534.8	67,952.7	99.2%
Diesel Oil	1,612.6	3,767.0	5,379.6	30.0%
Natural Gas	73,627.6	2,113.4	75,741.0	97.2%
Other	2,651.7	2,479.0	5,130.7	51.7%
Total	145,309.8	8,894.2	154,204.0	94.2%

Most coal units in PJM have particulate controls. Typically, technologies such as electrostatic precipitators (ESP) or fabric filters (baghouses) are used to reduce particulate matter from coal steam units.¹⁰⁴ Fabric filters work by allowing the flue gas to pass through a tightly woven fabric which filters out the particulates. Table 8-17 shows particulate emission controls by unit type in PJM. In PJM, 67,618.7 MW out of 67,952.7 MW, 99.5 percent, of all coal steam unit MW, have some type of particulate emissions control technology, as of December 31, 2018. All coal steam units in PJM are compliant with the state and federal emissions limits established by MATS.¹⁰⁵ In order to achieve compliance with MATS, most coal steam units in PJM have particulate emission controls in the form of ESPs, but many units have also installed baghouse technology, or a combination of an FGD and SCR. Currently, 154 of the 171 coal steam units have baghouse or FGD technology installed, representing 61,286.4 MW out of the 67,952.7 MW total coal capacity, or 90.2 percent.

Table 8-17 Particulate emission controls by fuel type (MW): on December 31, 2018

	Particulate Controlled	No Particulate Controls	Total	Percent Controlled
Coal	67,618.7	334.0	67,952.7	99.5%
Diesel Oil	0.0	5,379.6	5,379.6	0.0%
Natural Gas	2,786.0	72,955.0	75,741.0	3.7%
Other	2,970.5	2,160.2	5,130.7	57.9%
Total	73,375.2	80,828.8	154,204.0	47.6%


¹⁰³ See EPA, "Mercury and Air Toxics Standards, Cleaner Power Plants," <<https://www.epa.gov/mats/cleaner-power-plants#controls>> (Accessed Oct. 5, 2018).

¹⁰⁴ See EPA, "Air Pollution Control Technology Fact Sheet," <<https://www3.epa.gov/ttn/catc/dir1/ff-pulse.pdf>> (Accessed Oct. 5, 2018).

¹⁰⁵ On April 14, 2016, the EPA issued a final finding regarding the Mercury and Air Toxics Standards. See EPA, "Regulatory Actions," <<https://www.epa.gov/mats/regulatory-actions-final-mercury-and-air-toxics-standards-mats-power-plants>> (Accessed Oct. 5, 2018).

Figure 8-11 shows the total CO₂ short ton emissions (in millions) and the CO₂ short ton emissions per MWh within PJM, for all CO₂ emitting units, for each year from 1999 to 2018, as well as the CO₂ short ton emissions per MWh of total generation within PJM for 2010 to 2018.¹⁰⁶ Since 1999 the amount of CO₂ produced per MWh was at a minimum of 0.77 short tons per MWh in 2018, and a maximum of 0.94 short tons per MWh in 2010. In 2018, CO₂ emissions were 0.77 short tons per MWh. Total PJM generation increased from 808,229.7 GWh in 2017 to 837,648.3 GWh in 2018, while CO₂ produced decreased from 414.1 million tons in 2017 to 408.0 million tons in 2018.¹⁰⁷ The reduction in CO₂ emissions was primarily the result of a decrease in the use of coal and an increase in the use of natural gas for generation. Figure 8-12 shows the total on peak hour and off peak hour CO₂ short ton emissions (in millions) and the CO₂ short ton emissions per MWh within PJM, for all CO₂ emitting units, for 1999 to 2018. Since 1999 the amount of CO₂ produced per MWh during off peak hours was at a minimum of 0.78 short tons per MWh in 2018, and a maximum of 0.95 short tons per MWh in 2010. Since 1999 the amount of CO₂ produced per MWh during on peak hours was at a minimum of 0.76 short tons per MWh in 2018, and a maximum of 0.92 short tons per MWh in 2010. In 2018, CO₂ emissions were 0.78 short tons per MWh and 0.76 short tons per MWh for off and on peak hours.

Figure 8-11 CO₂ emissions by year (millions of short tons), by PJM units: 1999 through 2018^{108 109}

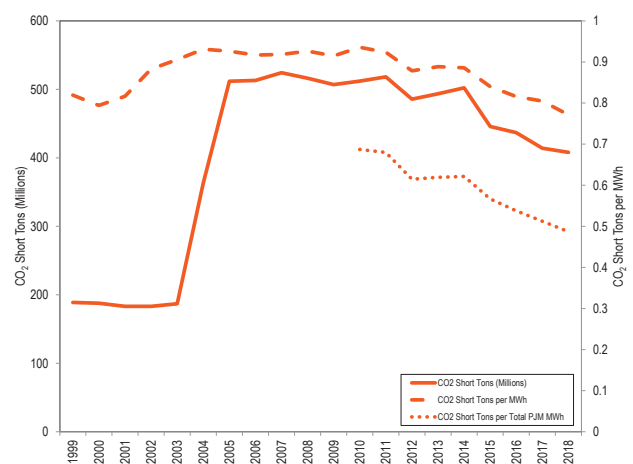

¹⁰⁶ Unless otherwise noted, emissions are measured in short tons. A short ton is 2,000 pounds.

¹⁰⁷ See the 2018 State of the Market Report for PJM, Section 3: Energy Market, Table 3-10.

¹⁰⁸ The emissions are calculated from the continuous emission monitoring system (CEMS) data from generators located within the PJM footprint.

¹⁰⁹ In 2004, PJM integrated the AEP, APS, ComEd, and DAY control zones. The large increase in total emissions in 2004 is a result of these integrations.

Figure 8-12 CO₂ emissions during on and off peak hours by year (millions of short tons), by PJM units: 1999 through 2018¹¹⁰


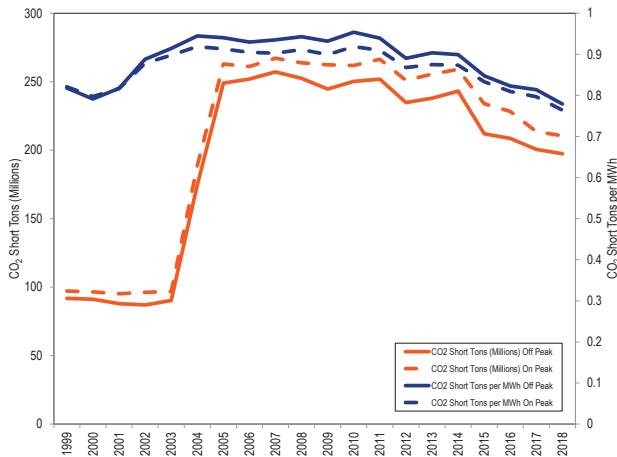


Figure 8-13 shows the total SO₂ and NO_x short ton emissions (in thousands) and the short ton emissions per MWh from emitting resources within PJM, for all SO₂ and NO_x emitting units, for 1999 to 2018, as well as the SO₂ and NO_x short ton emissions per MWh of total generation within PJM for 2010 to 2018. Since 1999 the amount of SO₂ produced per MWh was at a minimum of 0.000584 short tons per MWh in 2018, and a maximum of 0.007389 short tons per MWh in 2003. Since 1999, the amount of NO_x produced per MWh was at a minimum of 0.000406 short tons per MWh in 2018, and a maximum of 0.002070 short tons per MWh in 1999. In 2018, SO₂ emissions were 0.000584 short tons per MWh and NO_x emissions were 0.000406 short tons per MWh. The consistent decline in SO₂ and NO_x emissions starting in 2006 is the result of a decline in the use of coal, an increase in the use of natural gas, and the installation of environmental controls from 2006 to 2018.^{111 112}

Figure 8-14 shows the total on peak hour and off peak hour SO₂ and NO_x short ton emissions (in thousands) and the short ton emissions per MWh from emitting resources within PJM, for all SO₂ and NO_x emitting units, for each year from 1999 to 2018. Since 1999 the amount of SO₂ produced per MWh during off peak hours

was at a minimum of 0.000571 short tons per MWh in 2017, and a maximum of 0.007583 short tons per MWh in 2003. Since 1999 the amount of SO₂ produced per MWh during on peak hours was at a minimum of 0.000587 short tons per MWh in 2018, and a maximum of 0.007211 short tons per MWh in 2003. Since 1999, the amount of NO_x produced per MWh during off peak hours was at a minimum of 0.000407 short tons per MWh in 2018, and a maximum of 0.002043 short tons per MWh in 1999. Since 1999, the amount of NO_x produced per MWh during on peak hours was at a minimum of 0.000404 short tons per MWh in 2018, and a maximum of 0.002095 short tons per MWh in 1999. In 2018, SO₂ emissions were 0.000580 short tons per MWh and 0.000588 short tons per MWh for off and on peak hours. In 2018, NO_x emissions were 0.000407 short tons per MWh and 0.000404 short tons per MWh for off and on peak hours.

Figure 8-13 SO₂ and NO_x emissions by year (thousands of short tons), by PJM units: 1999 through 2018¹¹³

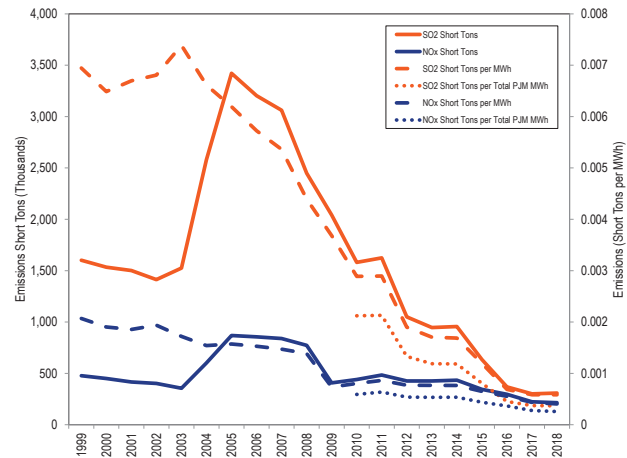


¹¹⁰ The emissions are calculated from the continuous emission monitoring system (CEMS) data from generators located within the PJM footprint.

¹¹¹ See EIA, "Changes in coal sector led to less SO₂ and NO_x emissions from electric power industry," <<https://www.eia.gov/todayinenergy/detail.php?id=37752>> (Accessed March 1, 2019).

¹¹² See EIA, "Sulfur dioxide emissions from U.S. power plants have fallen faster than coal generation," <<https://www.eia.gov/todayinenergy/detail.php?id=29812>> (Accessed March 1, 2019).

¹¹³ The emissions are calculated from the continuous emission monitoring system (CEMS) data from generators located within the PJM footprint.

Figure 8-14 SO₂ and NO_x emissions during on and off peak hours by year (thousands of short tons), by PJM units: 1999 through 2018¹¹⁴

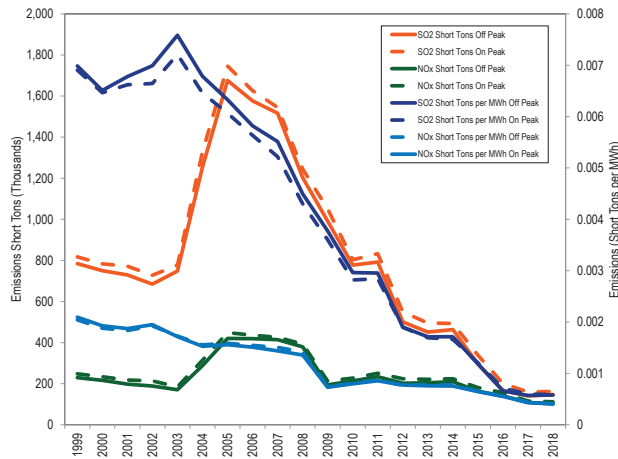

Wind and Solar Peak Hour Output


The capacity of solar and wind resources are derated for the PJM capacity market based on expected performance during high load hours. Figure 8-15 shows the wind and solar output during the top 100 load hours in PJM for 2018. The top 100 load hours in PJM during 2018, 93 are within PJM defined peak load periods. The hours are in descending order by load. The solid lines are the total ICAP of wind or solar PJM resources. The dashed lines are the total ICAP of wind and solar PJM resources derated to 13 and 38 percent.¹¹⁵ The actual output of the wind and solar resources during the top 100 peak load hours ranges above and below the derated capacity (ICAP) values. Wind output was above the derated ICAP for 66 hours and below the derated ICAP for 34 hours of the top 100 peak load hours of 2018. The wind capacity factor for the top 100 peak load hours of 2018 was 19.0 percent. Wind output was above the derated ICAP for 6,301 hours and below the derated ICAP for 2,459 hours in 2018. The wind capacity factor for 2018 was 32.3 percent. Solar output was above the derated ICAP for 75 hours and below the derated ICAP for 25 hours of the top 100 peak load hours of 2018. The solar capacity factor for the top 100 peak load hours of 2018 was 50.7 percent. Solar output was above the derated ICAP for

¹¹⁴ The emissions are calculated from the continuous emission monitoring system (CEMS) data from generators located within the PJM footprint.

¹¹⁵ PJM used derating factors of 13 and 38 percent until June 1, 2017. The current derating factors depend on installation type. PJM, Class Average Capacity Factors, <<https://www.pjm.com/-/media/planning/res-adeq/class-average-wind-capacity-factors.ashx?la=en>> [Accessed March 5, 2019].

2,020 hours and below the derated ICAP for 6,740 hours for 2018. The solar capacity factor for 2018 was YY percent.

Figure 8-15 Wind and solar output during the top 100 peak load hours in PJM: 2018

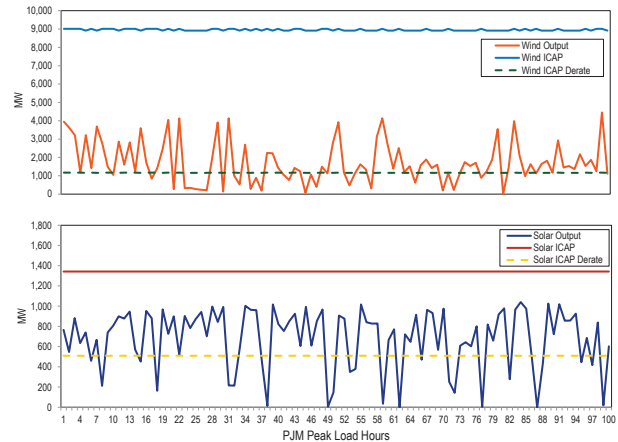

Wind Units

Table 8-18 shows the capacity factor of wind units in PJM. In 2018, the capacity factor of wind units in PJM was 32.3 percent. Wind units that were capacity resources had a capacity factor of 32.2 percent and an installed capacity of 7,869 MW. Wind units that were classified as energy only had a capacity factor of 33.9 percent and an installed capacity of 1,362 MW. Wind capacity in RPM is derated to 14.7 or 17.6 percent of nameplate capacity for the capacity market, based on the wind farm terrain, and energy only resources are not included in the capacity market.¹¹⁶

Table 8-18 Capacity factor of wind units in PJM: 2018¹¹⁷

Type of Resource	Capacity Factor	Installed Capacity (MW)
Energy-Only Resource	33.9%	1,362
Capacity Resource	32.2%	7,869
All Units	32.3%	9,230

Figure 8-16 shows the average hourly real-time generation of wind units in PJM, by month for January 1 through December 31, 2018. The hour with the highest average output, 4,228 MW, occurred in January, and the hour with the lowest average output, 805 MW, occurred in July. Wind output in PJM is generally higher in off-peak hours and lower in on-peak hours.

¹¹⁶ PJM, Class Average Capacity Factors, <<https://www.pjm.com/-/media/planning/res-adeq/class-average-wind-capacity-factors.ashx?la=en>> [Accessed March 5, 2019].

¹¹⁷ Capacity factor is calculated based on online date of the resource.

Figure 8-16 Average hourly real-time generation of wind units in PJM: 2018

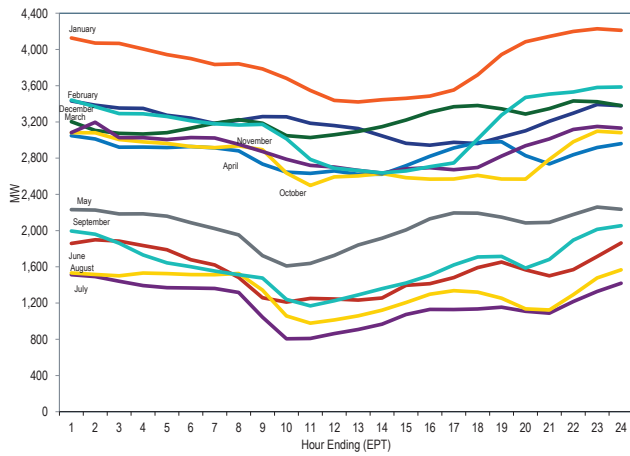


Figure 8-17 Average hourly day-ahead generation of wind units in PJM: 2018

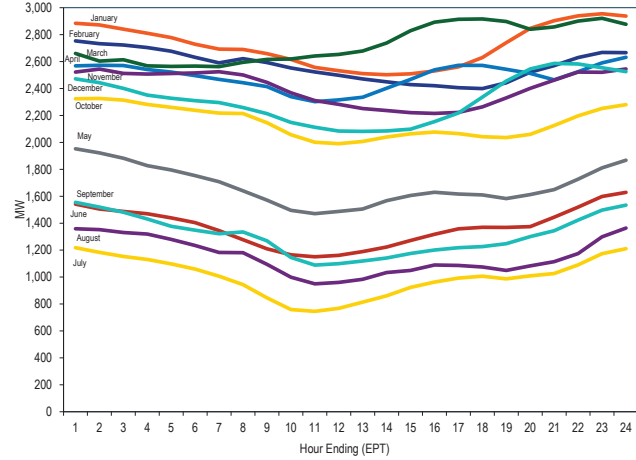


Table 8-19 shows the generation and capacity factor of wind units in each month of January 1, 2017 through December 31, 2018.


Table 8-19 Capacity factor of wind units in PJM by month: 2017 through 2018

Month	2017		2018	
	Generation (MWh)	Capacity Factor	Generation (MWh)	Capacity Factor
January	2,016,120.9	37.8%	2,856,292.5	48.3%
February	2,178,159.8	44.4%	2,148,206.1	40.4%
March	2,299,037.1	42.5%	2,387,719.3	41.7%
April	2,071,212.0	39.8%	2,044,167.0	37.7%
May	1,824,269.0	34.7%	1,519,815.5	27.5%
June	1,456,609.5	28.6%	1,117,467.9	21.1%
July	809,478.9	16.9%	881,491.2	16.8%
August	689,983.0	15.0%	984,116.9	19.0%
September	908,311.6	19.0%	1,164,672.2	22.1%
October	1,916,644.9	35.6%	2,081,941.6	35.8%
November	2,197,021.1	40.2%	2,089,084.0	35.7%
December	2,149,119.8	42.0%	2,332,656.7	37.3%
Annual	20,515,967.5	33.4%	21,607,630.8	32.3%

Output from wind turbines displaces output from other generation types. This displacement affects the output of marginal units in PJM. The magnitude and type of effect on marginal unit output depends on the level of the wind turbine output, its location, time and duration. One measure of this displacement is based on the mix of marginal units when wind is producing output. Figure 8-18 shows the hourly average proportion of marginal units by fuel type mapped to the hourly average MW of real-time wind generation in 2018. This is not an exact measure of displacement because it is not based on a redispatch of the system without wind resources. When wind appears as the displaced fuel at times when wind resources were on the margin this means that there was no displacement for those hours.

Wind units that are capacity resources are required, like all capacity resources except demand resources, to offer the energy associated with their cleared capacity in the Day-Ahead Energy Market and in the Real-Time Energy Market. Wind units may offer noncapacity related wind energy at their discretion. Figure 8-17 shows the average hourly day-ahead generation offers of wind units in PJM, by month. The hourly day-ahead generation offers of wind units in PJM may vary.

Figure 8-18 Marginal fuel at time of wind generation in PJM: 2018

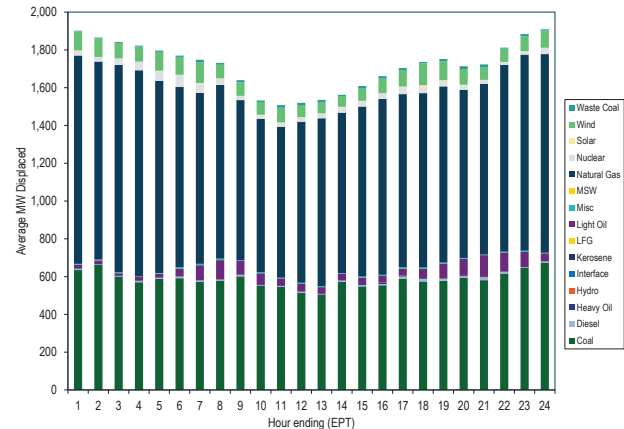

Solar Units

Solar units in PJM may be in front of or behind the meter. The data reported include all PJM solar units that are in front of the meter. As shown in Table 8-8, there are 1,721.8 MW capacity of solar registered in GATS that are PJM units. As shown in Table 8-9, there are 5,029.2 MW capacity of solar registered in GATS that are not PJM capacity or energy resources. Some behind the meter generation exists in clusters, such as community solar farms, and serves dedicated customers. Such customers may or may not be located at the same node on the transmission system as the solar farm. When behind the meter generation and its associated load are at separate nodes, loads should pay for the appropriate level of transmission service, and should not be permitted to escape their proper financial responsibility through badly designed rules, such as rules for netting.

Table 8-20 shows the capacity factor of solar units in PJM. In 2018, the capacity factor of solar units in PJM was 22.1 percent. Solar units that were capacity resources had a capacity factor of 22.4 percent and an installed capacity of 1,302 MW. Solar units that were classified as energy only had a capacity factor of 19.7 percent and an installed capacity of 176 MW. Solar capacity in RPM is derated to 42.0, 60.0 or 38.0 percent of nameplate capacity for the capacity market, based on the installation type, and energy only resources are not included in the capacity market.¹¹⁸

Table 8-20 Capacity factor of solar units in PJM: 2018

Type of Resource	Capacity Factor	Installed Capacity (MW)
Energy-Only Resource	19.7%	176
Capacity Resource	22.4%	1,302
All Units	22.1%	1,477

Solar output differs from month to month, based on seasonal variation and daylight hours during the month. Figure 8-19 shows the average hourly real-time generation of solar units in PJM, by month. The hour with the highest peak average output, 877 MW, occurred in June, and the hour with the lowest peak average output, 506 MW, occurred in February. Solar output in PJM is highest during the hours of 11:00 through 13:00 EPT.

Figure 8-19 Average hourly real-time generation of solar units in PJM: 2018

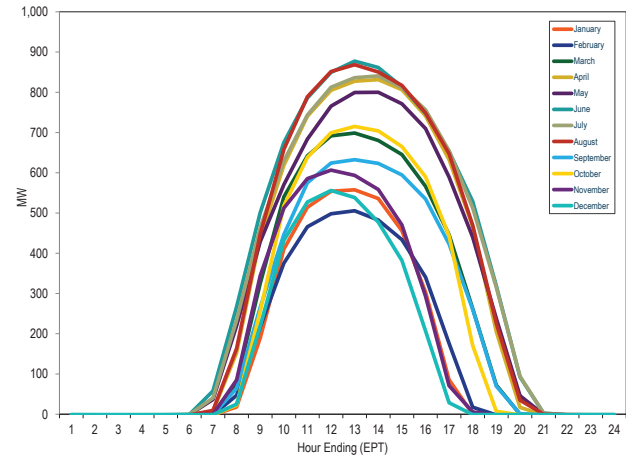


Table 8-21 shows the generation and capacity factor of solar units in each month of January 1, 2017 through December 31, 2018.

Table 8-21 Capacity factor of solar units in PJM by month: 2017 through 2018

Month	2017		2018	
	Generation (MWh)	Capacity Factor	Generation (MWh)	Capacity Factor
January	47,456.3	11.6%	102,161.8	15.4%
February	84,111.1	21.7%	90,296.5	14.2%
March	109,498.1	25.0%	159,360.7	22.4%
April	121,835.3	27.5%	201,333.0	28.2%
May	127,944.3	26.9%	202,986.0	27.4%
June	146,226.0	30.5%	222,134.5	30.6%
July	144,300.0	28.6%	220,548.3	29.5%
August	133,780.1	26.3%	216,827.5	28.9%
September	125,731.7	25.4%	141,575.2	21.0%
October	104,658.9	19.1%	153,871.8	21.3%
November	90,442.5	16.3%	111,123.6	15.2%
December	61,707.8	12.0%	93,572.8	12.6%
Annual	1,297,692.0	22.5%	1,915,791.6	22.4%

Solar units that are capacity resources are required, like all capacity resources except demand resources, to offer the energy associated with their cleared capacity in the Day-Ahead Energy Market and in the Real-Time Energy Market. Solar units may offer noncapacity related solar energy at their discretion. Figure 8-20 shows the average hourly day-ahead generation offers of solar units in PJM, by month.¹¹⁹

¹¹⁸ PJM Class Average Capacity Factors, <<https://www.pjm.com/-/media/planning/res-adeq/class-average-wind-capacity-factors.ashx?1a=en>> (Accessed March 5, 2019).

¹¹⁹ The average day-ahead generation of solar units in PJM is greater than 0 for hours when the sun is down due to some solar units being paired with landfill units.

Figure 8-20 Average hourly day-ahead generation of solar units in PJM: 2018

